


**PEDESTRIAN LEVEL  
WIND STUDY**

116 Beech Street  
Ottawa, Ontario

Report: 24-066-PLW

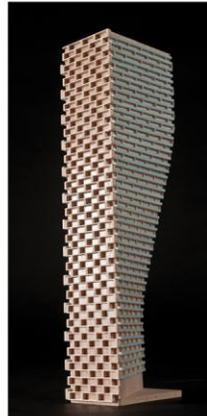

April 25, 2024

PREPARED FOR

Beech Street LP  
69 rue Jean-Proulx, Unite #301  
Gatineau, QC J8Z 1W2

PREPARED BY

Daniel Davalos, M.E.Sc. Wind Scientist  
David Huitema, M.Eng., Wind Scientist  
Justin Ferraro, P.Eng., Principal

## **EXECUTIVE SUMMARY**

This report describes a pedestrian level wind (PLW) study undertaken to satisfy Site Plan Control application submission requirements for the proposed development located at 116 Beech Street in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind conditions within and surrounding the subject site, and to identify areas where conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

The study involves simulation of wind speeds for sixteen (16) wind directions in a three-dimensional (3D) computer model using the computational fluid dynamics (CFD) technique, combined with meteorological data integration, to assess pedestrian wind comfort and safety within and surrounding the subject site according to City of Ottawa wind comfort and safety criteria. The results and recommendations derived from these considerations are detailed in the main body of the report (Section 5), illustrated in Figures 3A-9, and summarized as follows:

- 1) Most grade-level areas within and surrounding the subject site are predicted to experience conditions that are considered acceptable for the intended pedestrian uses throughout the year. Specifically, conditions over surrounding sidewalks and walkways, the neighbouring existing parking lot, the proposed surface parking and drive aisle, and in the vicinity of building access points, are considered acceptable. The areas predicted to experience windier conditions are described as follows:
  - a. Following the introduction of the proposed development, wind comfort conditions over Ev Tremblay Park to the east of the subject site are predicted to be suitable for a mix of mostly sitting and standing during the typical use period (May to October, inclusive), while conditions during the same period within the noted park under the existing massing are predicted to be suitable for mostly sitting with standing conditions at the southwest corner of the park.
  - b. During the typical use period, wind conditions within the parkland dedication to the northeast of the proposed development are predicted to be suitable for a mix of mostly sitting and standing. Comfort levels at designated seating areas within the parkland may



be improved by implementing elements around sensitive areas such as tall wind screens and coniferous plantings in dense arrangements, in combination with strategically placed seating with high-back benches and other local wind mitigation.

- The extent of mitigation measures is dependent on the programming of the parkland. If required by programming, an appropriate mitigation strategy is recommended to be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.
- 2) Regarding the amenity terrace at Level 7, wind comfort conditions are predicted to be suitable for mostly standing during the typical use period, with sitting conditions along the west façade of the 25-storey tower, and with an isolated region predicted to be suitable for strolling at the northwest corner of the tower.
- a. To extend sitting conditions over designated seating areas, the implementation of wind screens along the full perimeter of the terrace is recommended, rising to at least 1.8 m above the local walking surface. Additionally, inboard mitigation targeted around sensitive areas is recommended, which could take the form of inboard wind screens or other common landscape elements targeted around sensitive areas and canopies above designated seating areas. Canopies that extend above the terrace from the northwest and southwest corners of the tower may also be beneficial to deflect downwash, in combination with wind barriers at the corners of the tower to diffuse accelerating winds.
  - b. The extent of mitigation measures is dependent on the programming of the terrace. An appropriate mitigation strategy is recommended to be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.
- 3) The foregoing statements and conclusions apply to common weather systems, during which no dangerous wind conditions, as defined in Section 4.4, are expected anywhere over the subject site. During extreme weather events (for example, thunderstorms, tornadoes, and downbursts), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

**TABLE OF CONTENTS**

**1. INTRODUCTION ..... 1**

**2. TERMS OF REFERENCE..... 1**

**3. OBJECTIVES ..... 2**

**4. METHODOLOGY ..... 2**

**4.1 Computer-Based Context Modelling ..... 3**

**4.2 Wind Speed Measurements ..... 3**

**4.3 Historical Wind Speed and Direction Data ..... 4**

**4.4 Pedestrian Wind Comfort and Safety Criteria – City of Ottawa ..... 6**

**5. RESULTS AND DISCUSSION ..... 8**

**5.1 Wind Comfort Conditions – Grade Level..... 9**

**5.2 Wind Comfort Conditions – Level 7 Common Amenity Terrace..... 11**

**5.3 Wind Safety ..... 12**

**5.4 Applicability of Results..... 12**

**6. CONCLUSIONS AND RECOMMENDATIONS ..... 12**

**FIGURES**

**APPENDICES**

**Appendix A – Simulation of the Atmospheric Boundary Layer**



## **1. INTRODUCTION**

Gradient Wind Engineering Inc. (Gradient Wind) was retained by Beech Street LP to undertake a pedestrian level wind (PLW) study to satisfy Site Plan Control application submission requirements for the proposed development located at 116 Beech Street in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind conditions within and surrounding the subject site, and to identify areas where conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

Our work is based on industry standard computer simulations using the computational fluid dynamics (CFD) technique and data analysis procedures, City of Ottawa wind comfort and safety criteria, architectural drawings prepared by Project1 Studio Incorporated in April 2024, surrounding street layouts and existing and approved future building massing information obtained from the City of Ottawa, as well as recent satellite imagery.

## **2. TERMS OF REFERENCE**

The subject site is located at 116 Beech Street to the north of a rectangular parcel of land bounded by Beech Street to the north, Champagne Avenue South to the east, Hickory Street to the south, and Loretta Avenue South to the west. The proposed development comprises a 25-storey building with a 6-storey podium.

At the ground floor, the proposed development includes building entrances to the north and west, a parkland dedication to the northeast, and surface parking to the south. Access to the noted surface parking is provided by a drive aisle at the southwest corner from Loretta Avenue South, while access to the parking garage is provided at the southeast corner of the subject site from Champagne Avenue South.

The building steps back from the northwest elevation at Level 5, from all elevations at Level 7, and from the west elevation at Level 13. An outdoor amenity terrace is located at Level 7 to the west atop the ‘U’-shaped 6-storey podium.

The near-field surroundings, defined as an area within 200-metres (m) of the subject site, are characterized by a mix of mostly low- and mid-rise buildings from the south-southeast clockwise to the east-northeast, with high-rise buildings from the east clockwise to the south. Notably, a 14-storey building



to the immediate south of the proposed development and a two-tower development (22 and 25 storeys) located approximately 90 m to the southeast of the subject site are currently under construction at 90 Champagne Avenue South and 111 Champagne Avenue South, respectively. The far-field surroundings, defined as an area beyond the near-field but within a 2-kilometre (km) radius of the subject site, are characterized by a mix of low- and mid-rise buildings with isolated high-rise buildings from the west clockwise to the east, and by a mix of low-, mid-, and high-rise buildings followed by Dow's Lake and the Central Experimental Farm from the east-southeast clockwise to the southwest. The downtown core is located approximately 1.8 km to the north-northeast, Dow's Lake is located approximately 600 m to the southeast of the proposed development, and the Ottawa River is located approximately 1.7 km to the north-northwest of the subject site.

Site plans for the proposed and existing massing scenarios are illustrated in Figures 1A and 1B, while Figures 2A-2H illustrate the computational models used to conduct the study. The existing massing scenario includes the existing massing and any future developments approved by the City of Ottawa.

### **3. OBJECTIVES**

The principal objectives of this study are to (i) determine pedestrian level wind conditions at key areas within and surrounding the development site; (ii) identify areas where wind conditions may interfere with the intended uses of outdoor spaces; and (iii) recommend suitable mitigation measures, where required.

### **4. METHODOLOGY**

The approach followed to quantify pedestrian wind conditions over the site is based on CFD simulations of wind speeds across the subject site within a virtual environment, meteorological analysis of the Ottawa area wind climate, and synthesis of computational data with City of Ottawa wind comfort and safety criteria<sup>1</sup>. The following sections describe the analysis procedures, including a discussion of the noted pedestrian wind criteria.

---

<sup>1</sup> City of Ottawa Terms of References: Wind Analysis  
[https://documents.ottawa.ca/sites/default/files/torwindanalysis\\_en.pdf](https://documents.ottawa.ca/sites/default/files/torwindanalysis_en.pdf)

## 4.1 Computer-Based Context Modelling

A computer based PLW study was performed to determine the influence of the wind environment on pedestrian comfort over the proposed development site. Pedestrian comfort predictions, based on the mechanical effects of wind, were determined by combining measured wind speed data from CFD simulations with statistical weather data obtained from Ottawa Macdonald-Cartier International Airport. The general concept and approach to CFD modelling is to represent building and topographic details in the immediate vicinity of the subject site on the surrounding model, and to create suitable atmospheric wind profiles at the model boundary. The wind profiles are designed to have similar mean and turbulent wind properties consistent with actual site exposures.

An industry standard practice is to omit trees, vegetation, and other existing and planned landscape elements from the model due to the difficulty of providing accurate seasonal representation of vegetation. The omission of trees and other landscaping elements produces slightly stronger wind speeds.

## 4.2 Wind Speed Measurements

The PLW analysis was performed by simulating wind flows and gathering velocity data over a CFD model of the site for 16 wind directions. The CFD simulation model was centered on the proposed development, complete with surrounding massing within a radius of 480 m. The process was performed for two context massing scenarios, as noted in Section 2.


Mean and peak wind speed data obtained over the subject site for each wind direction were interpolated to 36 wind directions at 10° intervals, representing the full compass azimuth. Measured wind speeds approximately 1.5 m above local grade and 1.5 m above the common amenity terrace at Level 7 were referenced to the wind speed at gradient height to generate mean and peak velocity ratios, which were used to calculate full-scale values. Gradient height represents the theoretical depth of the boundary layer of the earth's atmosphere, above which the mean wind speed remains constant. Further details of the wind flow simulation technique are presented in Appendix A.

### 4.3 Historical Wind Speed and Direction Data

A statistical model for winds in Ottawa was developed from approximately 40 years of hourly meteorological wind data recorded at Ottawa Macdonald-Cartier International Airport and obtained from Environment and Climate Change Canada. Wind speed and direction data were analyzed during the appropriate hours of pedestrian usage (that is, between 06:00 and 23:00) and divided into four distinct seasons, as stipulated in the wind criteria. Specifically, the spring season is defined as March through May, the summer season is defined as June through August, the autumn season is defined as September through November, and the winter season is defined as December through February, inclusive.

The statistical model of the Ottawa area wind climate, which indicates the directional character of local winds on a seasonal basis, is illustrated on the following page. The plots illustrate seasonal distribution of measured wind speeds and directions in kilometers per hour (km/h). Probabilities of occurrence of different wind speeds are represented as stacked polar bars in sixteen azimuth divisions. The radial direction represents the percentage of time for various wind speed ranges per wind direction during the measurement period. The prominent wind speeds and directions can be identified by the longer length of the bars. For Ottawa, the most common winds occur for westerly wind directions, followed by those from the east, while the most common wind speeds are below 36 km/h. The directional prominence and relative magnitude of wind speed changes somewhat from season to season.

## SEASONAL DISTRIBUTION OF WIND OTTAWA MACDONALD-CARTIER INTERNATIONAL AIRPORT

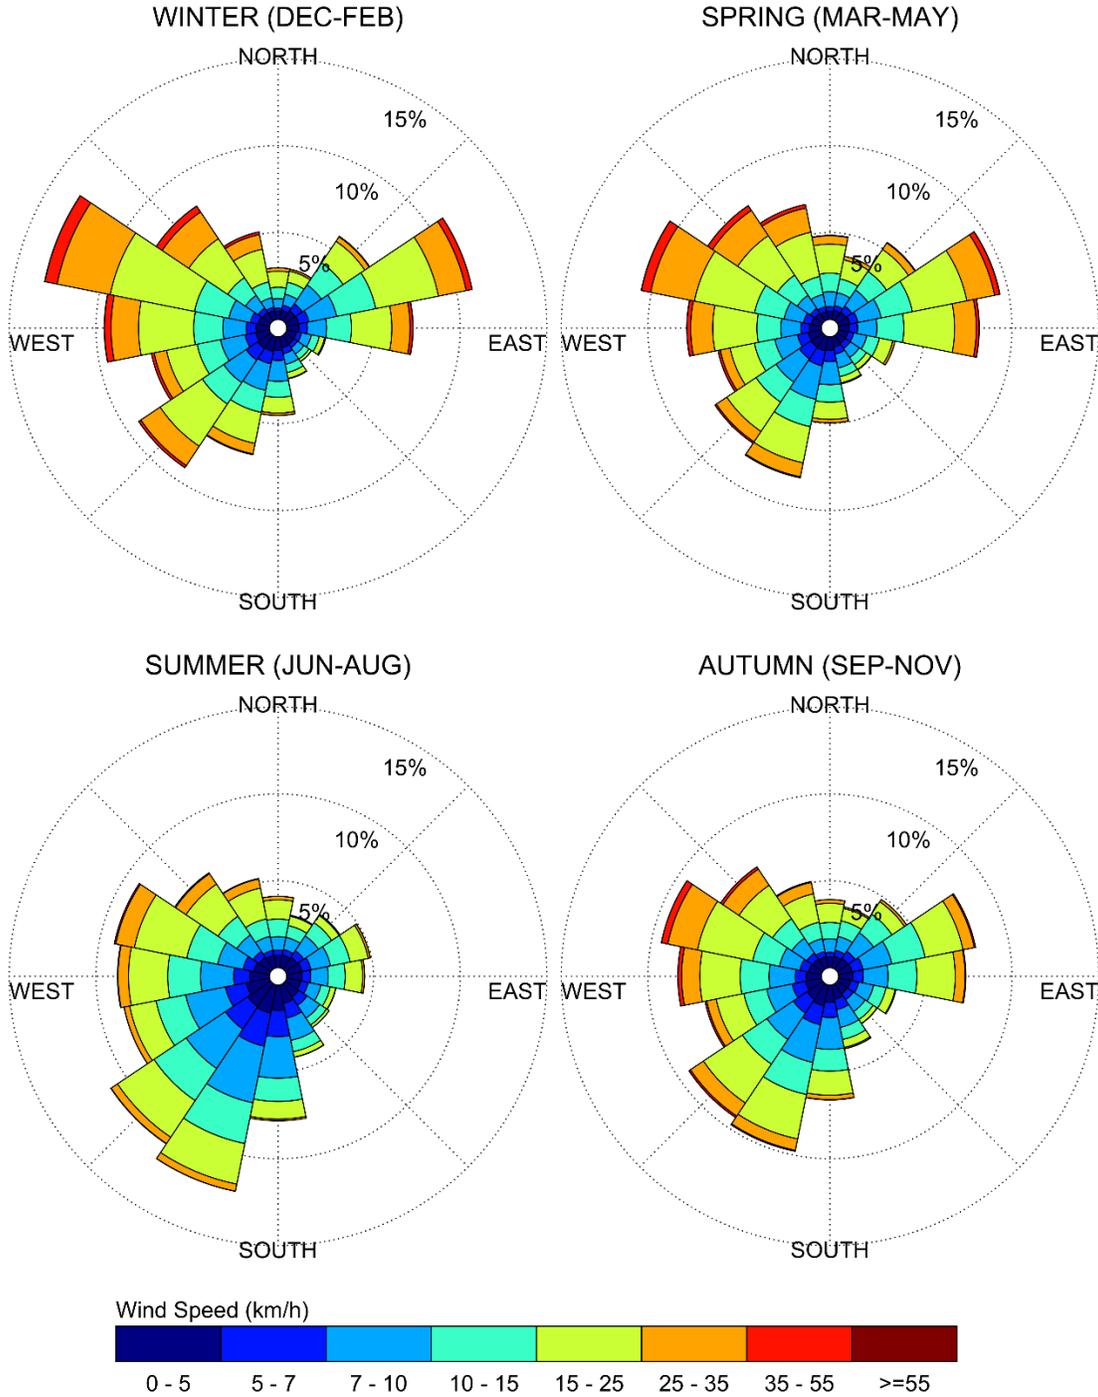

### Notes:

1. Radial distances indicate percentage of time of wind events.
2. Wind speeds are mean hourly in km/h, measured at 10 m above the ground.

#### 4.4 Pedestrian Wind Comfort and Safety Criteria – City of Ottawa

Pedestrian wind comfort and safety criteria are based on the mechanical effects of wind without consideration of other meteorological conditions (that is, temperature and relative humidity). The comfort criteria assume that pedestrians are appropriately dressed for a specified outdoor activity during any given season. Five pedestrian comfort classes based on 20% non-exceedance mean wind speed ranges are used to assess pedestrian comfort: (1) Sitting; (2) Standing; (3) Strolling; (4) Walking; and (5) Uncomfortable. The gust speeds, and equivalent mean speeds, are selected based on the Beaufort scale, which describes the effects of forces produced by varying wind speed levels on objects. Wind conditions suitable for sitting are represented by the colour blue, standing by green, strolling by yellow, and walking by orange; uncomfortable conditions are represented by the colour magenta. Specifically, the comfort classes, associated wind speed ranges, and limiting criteria are summarized as follows:

##### PEDESTRIAN WIND COMFORT CLASS DEFINITIONS

Wind Comfort Class	Mean Speed (km/h)	Description
SITTING	≤ 10	Mean wind speeds no greater than 10 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 16 km/h.
STANDING	≤ 14	Mean wind speeds no greater than 14 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 22 km/h.
STROLLING	≤ 17	Mean wind speeds no greater than 17 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 27 km/h.
WALKING	≤ 20	Mean wind speeds no greater than 20 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 32 km/h.
UNCOMFORTABLE	> 20	Uncomfortable conditions are characterized by predicted values that fall below the 80% target for walking. Brisk walking and exercise, such as jogging, would be acceptable for moderate excesses of this criterion.

Regarding wind safety, the pedestrian safety wind speed criterion is based on the approximate threshold that would cause a vulnerable member of the population to fall. A 0.1% exceedance gust wind speed of 90 km/h is classified as dangerous. From calculations of stability, it can be shown that gust wind speeds of 90 km/h would be the approximate threshold wind speed that would cause an average elderly person in good health to fall. Notably, pedestrians tend to be more sensitive to wind gusts than to steady winds for lower wind speed ranges. For strong winds approaching dangerous levels, this effect is less important because the mean wind can also create problems for pedestrians.

Experience and research on people's perception of mechanical wind effects has shown that if the wind speed levels are exceeded for more than 20% of the time, the activity level would be judged to be uncomfortable by most people. For instance, if a mean wind speed of 10 km/h (equivalent gust wind speed of approximately 16 km/h) were exceeded for more than 20% of the time most pedestrians would judge that location to be too windy for sitting. Similarly, if mean wind speed of 20 km/h (equivalent gust wind speed of approximately 32 km/h) at a location were exceeded for more than 20% of the time, walking or less vigorous activities would be considered uncomfortable. As these criteria are based on subjective reactions of a population to wind forces, their application is partly based on experience and judgment.

Once the pedestrian wind speed predictions have been established throughout the subject site, the assessment of pedestrian comfort involves determining the suitability of the predicted wind conditions for discrete regions within and surrounding the subject site. This step involves comparing the predicted comfort classes to the target comfort classes, which are dictated by the location type for each region (that is, a sidewalk, building entrance, amenity space, or other). An overview of common pedestrian location types and their typical windiest target comfort classes are summarized on the following page. Depending on the programming of a space, the desired comfort class may differ from this table.

**TARGET PEDESTRIAN WIND COMFORT CLASSES FOR VARIOUS LOCATION TYPES**

Location Types	Target Comfort Classes
Primary Building Entrance	Standing
Secondary Building Access Point	Walking
Public Sidewalk / Bicycle Path	Walking
Outdoor Amenity Space	Sitting / Standing
Café / Patio / Bench / Garden	Sitting / Standing
Transit Stop (Without Shelter)	Standing
Transit Stop (With Shelter)	Walking
Public Park / Plaza	Sitting / Standing
Garage / Service Entrance	Walking
Parking Lot	Walking
Vehicular Drop-Off Zone	Walking

**5. RESULTS AND DISCUSSION**

The following discussion of the predicted pedestrian wind conditions for the subject site is accompanied by Figures 3A-6B, illustrating wind conditions at grade level for the proposed and existing massing scenarios, and by Figures 8A-8D, which illustrate conditions over the common amenity terrace at Level 7. Conditions are presented as continuous contours of wind comfort throughout the subject site and correspond to the comfort classes presented in Section 4.4.

Wind comfort conditions are also reported for the typical use period, which is defined as May to October, inclusive. Figures 7A-7B and 9 illustrate wind comfort conditions at grade level and within the noted common amenity terrace serving the proposed development, respectively, consistent with the comfort classes in Section 4.4. The details of these conditions are summarized in the following sections.



## 5.1 Wind Comfort Conditions – Grade Level

**Public Sidewalks Along Beech Street:** Following the introduction of the proposed development, conditions over the public sidewalks along Beech Street are predicted to be suitable for a mix of sitting and standing during the summer and autumn, becoming suitable for strolling, or better, during the spring and winter. The noted conditions are considered acceptable.

Wind conditions over the public sidewalks along Beech Street with the existing massing are predicted to be suitable for sitting throughout the year, with regions predicted to be suitable for standing during the spring. While the introduction of the proposed development produces windier conditions in comparison to existing conditions, wind comfort conditions with the proposed development are nevertheless considered acceptable for public sidewalks.

**Public Sidewalks Along Champagne Avenue South:** Following the introduction of the proposed development, conditions over the public sidewalks along Champagne Avenue South are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for a mix of sitting, standing, and strolling throughout the remainder of the year, with a region of conditions suitable for walking at the northeast corner of the proposed development. The noted conditions are considered acceptable.

Wind comfort conditions over the public sidewalks along Champagne Avenue South with the existing massing are predicted to be suitable for standing, or better, throughout the year, with isolated regions predicted to be suitable for strolling during the spring and winter. While the introduction of the proposed development is predicted to produce windier conditions over the noted sidewalks in comparison to existing conditions, wind conditions with the proposed development are nevertheless considered acceptable.

**Ev Tremblay Park:** Following the introduction of the proposed development, conditions over Ev Tremblay Park to the east of the subject site are predicted to be suitable for a mix of sitting and standing during the typical use period, with an isolated region predicted to be suitable for strolling to the west of the park during the same period.

Wind conditions over Ev Tremblay Park with the existing massing are predicted to be suitable for mostly sitting during the typical use period, with regions predicted to be suitable for standing to the southwest of the park.

**Existing Walkway and Parking Lot South of Subject Site:** Prior to the introduction of the proposed development, conditions over the neighbouring existing walkway and parking lot to the immediate south of the subject site are predicted to be suitable for mostly sitting during the summer, becoming suitable for standing, or better, throughout the remainder of the year. Wind conditions over the noted areas are predicted to remain practically unchanged following the introduction of the proposed development, and the predicted wind conditions with the proposed development are considered acceptable.

**Public Sidewalks Along Loretta Avenue South:** Following the introduction of the proposed development, conditions over the public sidewalks along Loretta Avenue South are predicted to be suitable for a mix of sitting and standing throughout the year. The noted conditions are considered acceptable.

Wind conditions over the public sidewalks along Loretta Avenue South with the existing massing are predicted to be suitable for a mix of sitting and standing throughout the year. While the introduction of the proposed development produces windier conditions in comparison to existing conditions, wind comfort conditions with the proposed development are nevertheless considered acceptable.

**Surface Parking and Drive Aisle:** Wind conditions over the surface parking and drive aisle to the south and at the southwest corner of the proposed development, respectively, are predicted to be suitable for sitting during the summer and autumn, becoming suitable for standing, or better, during the spring and winter. The noted conditions are considered acceptable.

**Parkland Dedication:** During the typical use period, wind conditions within the parkland dedication to the northeast of the proposed development are predicted to be suitable for a mix of sitting and standing, with an isolated region predicted to be suitable for strolling at the southeast corner, as illustrated in Figure 7A.

Comfort levels at designated seating areas within parkland dedication may be improved by implementing landscaping elements around sensitive areas such as tall wind barriers and coniferous plantings in dense arrangements, in combination with strategically placed seating with high-back benches and other local wind mitigation.

The extent of mitigation measures is dependent on the programming of the space. If required by programming, an appropriate mitigation strategy is recommended to be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.

**Building Access Points and Internal Walkways:** Wind comfort conditions over the internal walkways and in the vicinity of all building access points serving the proposed development are predicted to be suitable for standing, or better, throughout the year. The noted conditions are considered acceptable.

## 5.2 Wind Comfort Conditions – Level 7 Common Amenity Terrace

During the typical use period, wind comfort conditions within the common amenity terrace serving the proposed development at Level 7 are predicted to be suitable for mostly standing, with conditions predicted to be suitable for sitting along the west façade of the 25-storey tower, and with an isolated region predicted to be suitable for strolling at the northwest corner of the noted tower, as illustrated in Figure 9.

To extend sitting conditions over designated seating areas within the terrace, the implementation of tall wind screens along the full perimeter of the terrace is recommended, rising to at least 1.8 m above the local walking surface. Additionally, inboard mitigation targeted around sensitive areas is recommended. This inboard mitigation could take the form of inboard wind screens or other common landscape elements targeted around sensitive areas and canopies above designated seating areas. Canopies extending from the northwest and southwest corners of the tower façade above the terrace may also be beneficial to deflect downwash incident on the terrace, in combination with wind barriers to diffuse accelerating winds around the northwest and southwest corners of the tower.

The extent of mitigation measures is dependent on the programming of the terrace. An appropriate mitigation strategy is recommended to be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.

### 5.3 Wind Safety

Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas within or surrounding the subject site are expected to experience conditions that could be considered dangerous, as defined in Section 4.4. During extreme weather events (for example, thunderstorms, tornadoes, and downburst), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

### 5.4 Applicability of Results

Pedestrian wind comfort and safety have been quantified for the specific configuration of existing and foreseeable construction around the subject site. Future changes (that is, construction or demolition) of these surroundings may cause changes to the wind effects in two ways, namely: (i) changes beyond the immediate vicinity of the subject site would alter the wind profile approaching the subject site; and (ii) development in proximity to the subject site would cause changes to local flow patterns.

## 6. CONCLUSIONS AND RECOMMENDATIONS

A complete summary of the predicted wind conditions is provided in Section 5 and illustrated in Figures 3A-9. Based on computer simulations using the CFD technique, meteorological data analysis of the Ottawa wind climate, City of Ottawa wind comfort and safety criteria, and experience with numerous similar developments, the study concludes the following:

- 1) Most grade-level areas within and surrounding the subject site are predicted to experience conditions that are considered acceptable for the intended pedestrian uses throughout the year. Specifically, conditions over surrounding sidewalks and walkways, the neighbouring existing parking lot, the proposed surface parking and drive aisle, and in the vicinity of building access points, are considered acceptable. The areas predicted to experience windier conditions are described as follows:
  - a. Following the introduction of the proposed development, wind comfort conditions over Ev Tremblay Park to the east of the subject site are predicted to be suitable for a mix of mostly sitting and standing during the typical use period (May to October, inclusive), while



conditions during the same period within the noted park under the existing massing are predicted to be suitable for mostly sitting with standing conditions at the southwest corner of the park.

- b. During the typical use period, wind conditions within the parkland dedication to the northeast of the proposed development are predicted to be suitable for a mix of mostly sitting and standing. Comfort levels at designated seating areas within the parkland may be improved by implementing elements around sensitive areas such as tall wind screens and coniferous plantings in dense arrangements, in combination with strategically placed seating with high-back benches and other local wind mitigation.
    - The extent of mitigation measures is dependent on the programming of the parkland. If required by programming, an appropriate mitigation strategy is recommended to be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.
- 2) Regarding the amenity terrace at Level 7, wind comfort conditions are predicted to be suitable for mostly standing during the typical use period, with sitting conditions along the west façade of the 25-storey tower, and with an isolated region predicted to be suitable for strolling at the northwest corner of the tower.
- a. To extend sitting conditions over designated seating areas, the implementation of wind screens along the full perimeter of the terrace is recommended, rising to at least 1.8 m above the local walking surface. Additionally, inboard mitigation targeted around sensitive areas is recommended, which could take the form of inboard wind screens or other common landscape elements targeted around sensitive areas and canopies above designated seating areas. Canopies that extend above the terrace from the northwest and southwest corners of the tower may also be beneficial to deflect downwash, in combination with wind barriers at the corners of the tower to diffuse accelerating winds.
  - b. The extent of mitigation measures is dependent on the programming of the terrace. An appropriate mitigation strategy is recommended to be developed in collaboration with the building and landscape architects as the design of the proposed development progresses.



- 3) The foregoing statements and conclusions apply to common weather systems, during which no dangerous wind conditions, as defined in Section 4.4, are expected anywhere over the subject site. During extreme weather events (for example, thunderstorms, tornadoes, and downbursts), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

Sincerely,

**Gradient Wind Engineering Inc.**



Daniel Davalos, MEng.  
Wind Scientist




David Huitema, M.Eng.  
Wind Scientist




Justin Ferraro, P.Eng.  
Principal




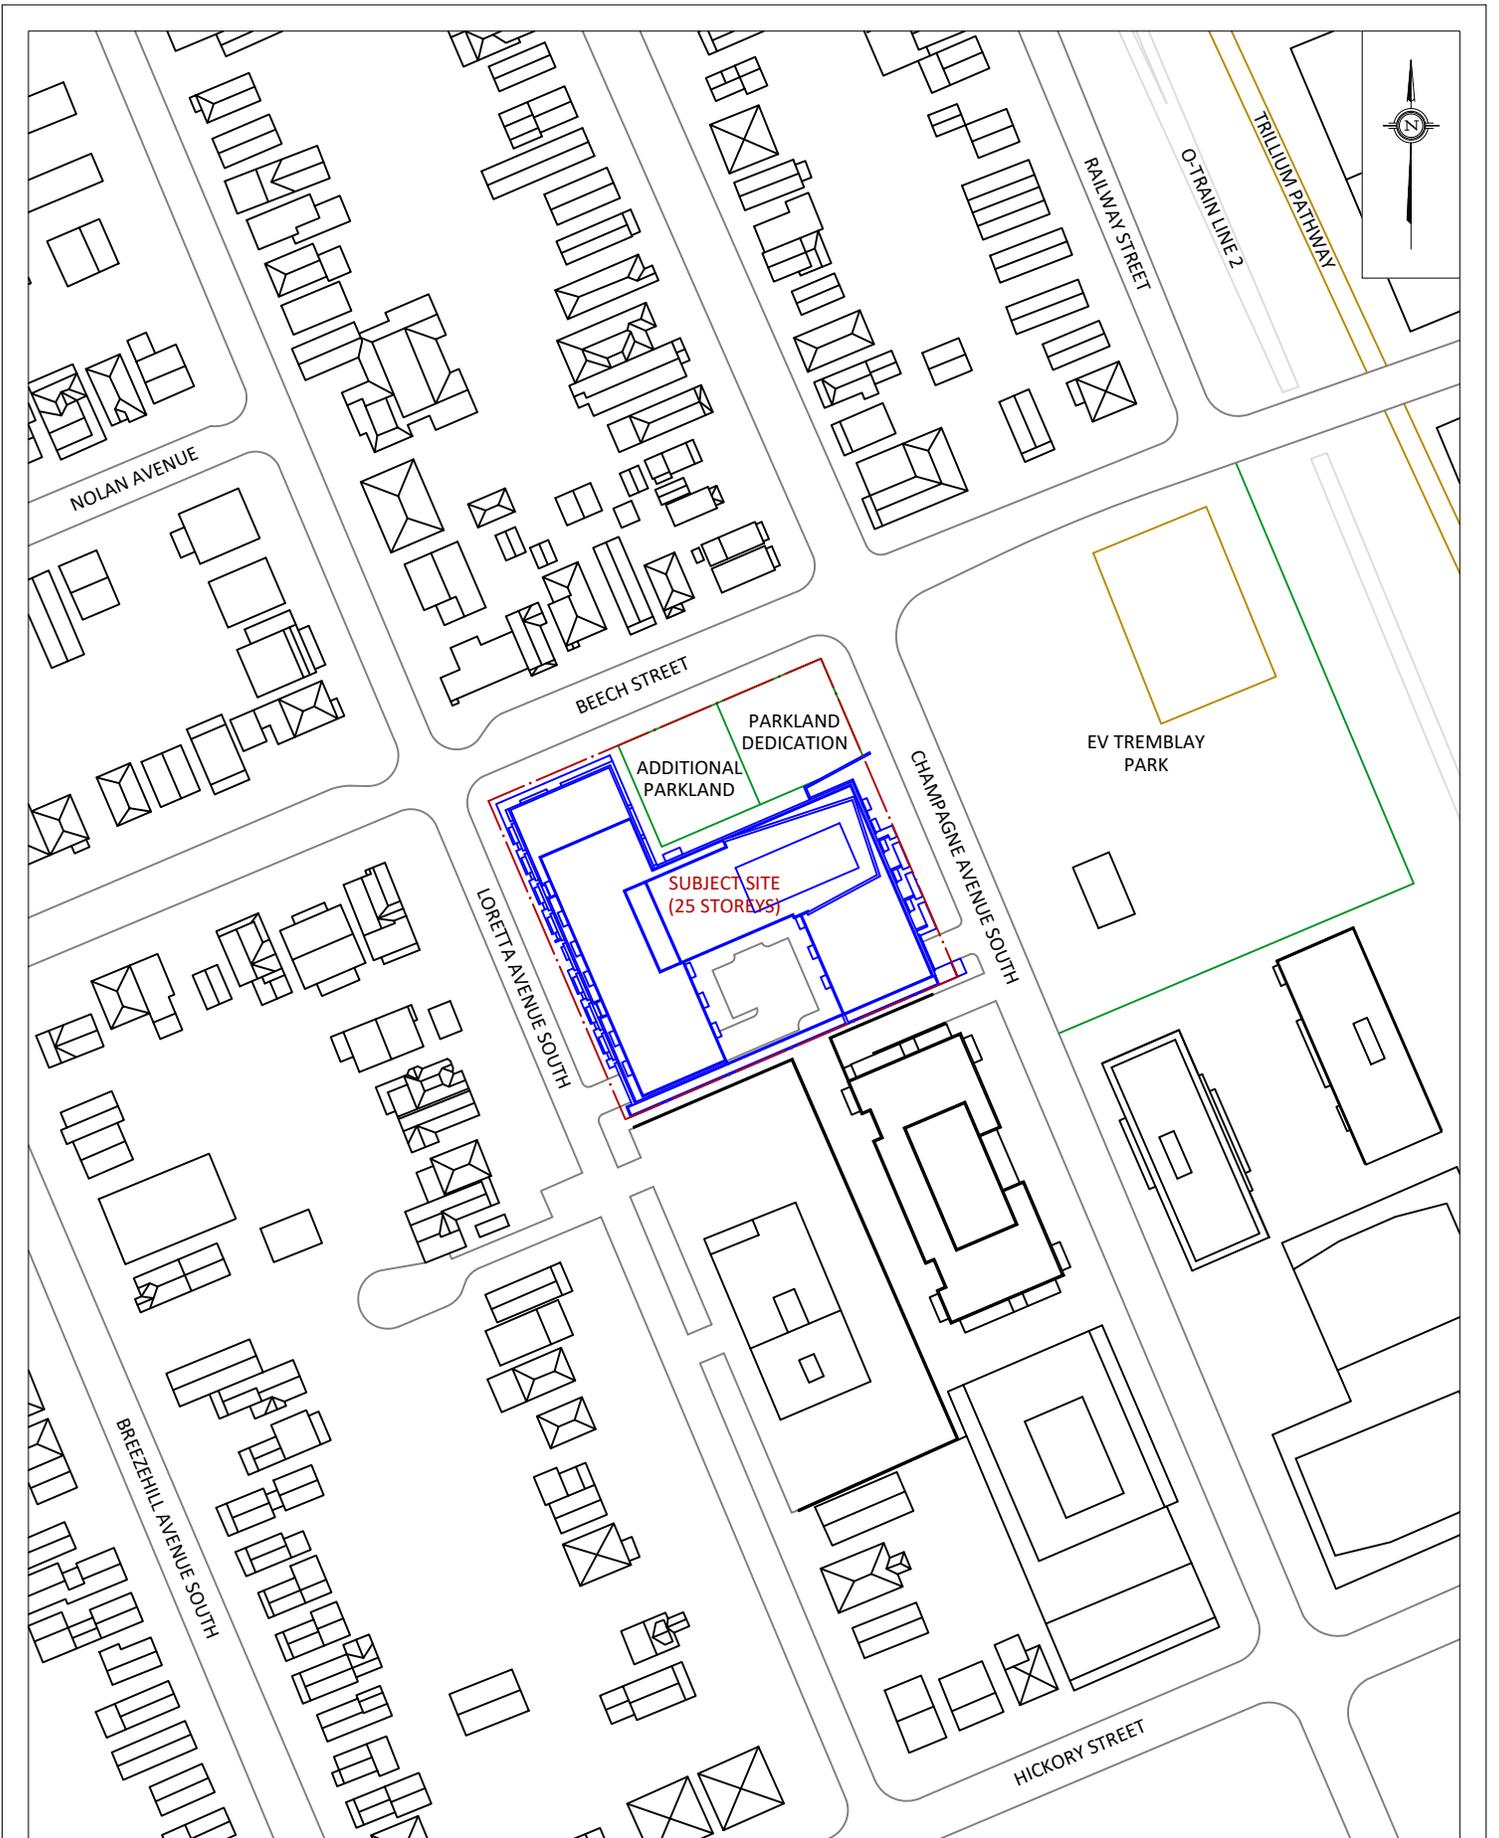


<b>GRADIENTWIND</b> ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT	116 BEECH STREET, OTTAWA PEDESTRIAN LEVEL WIND STUDY		DESCRIPTION	<b>FIGURE 1A:</b> PROPOSED SITE PLAN AND SURROUNDING CONTEXT
	SCALE	1:1500	DRAWING NO.	24-066-PLW-1A	
	DATE	APRIL 25, 2024	DRAWN BY	S.K.	

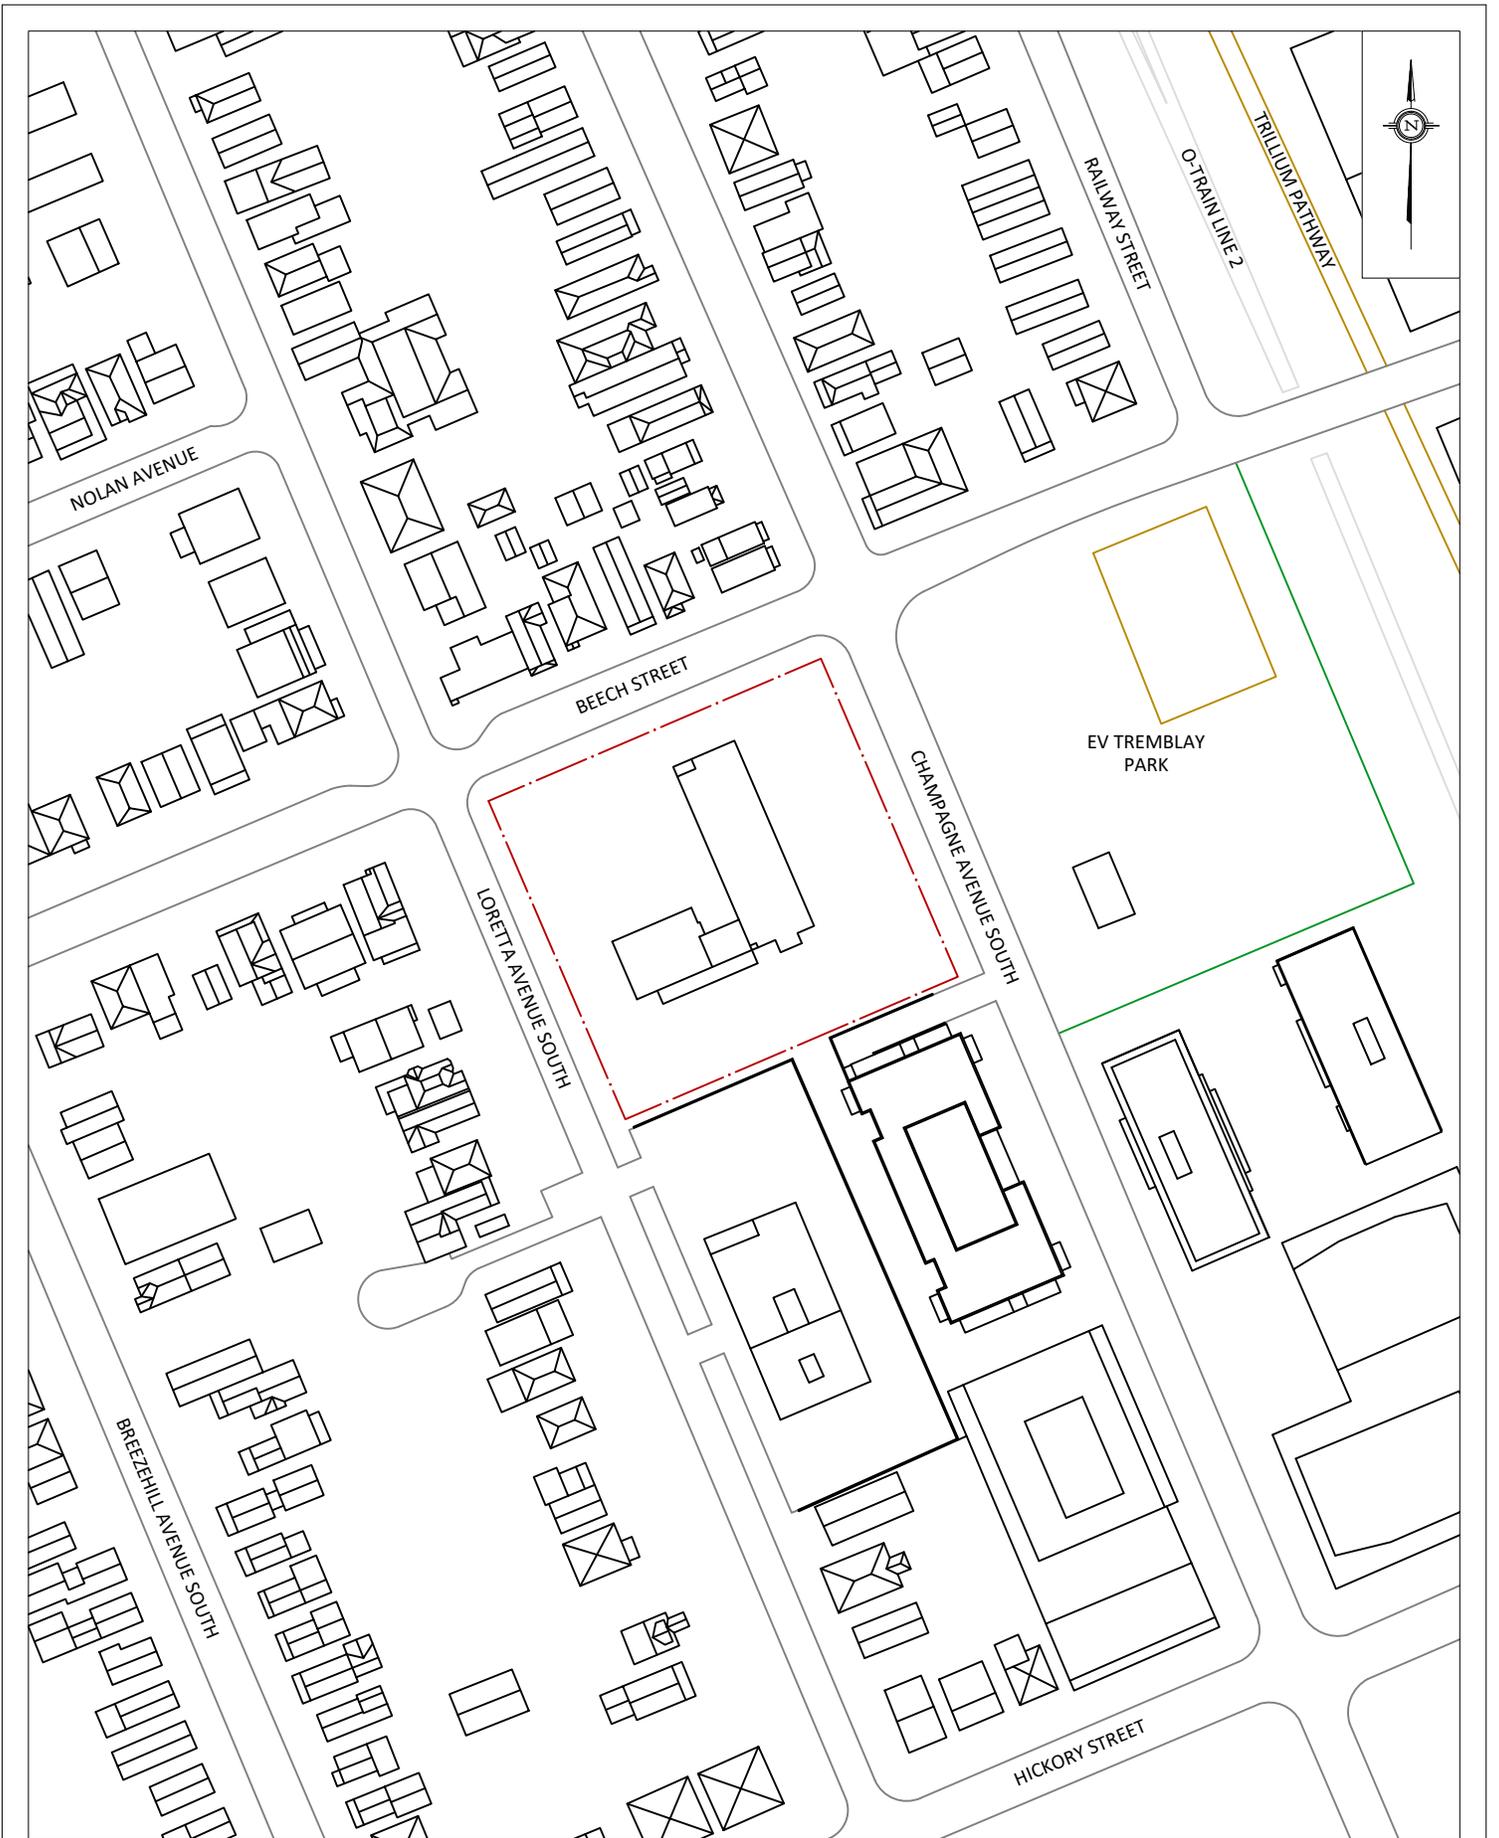

<b>GRADIENTWIND</b> ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT <b>116 BEECH STREET, OTTAWA          PEDESTRIAN LEVEL WIND STUDY</b>		DESCRIPTION <b>FIGURE 1B:          EXISTING SITE PLAN AND SURROUNDING CONTEXT</b>
	SCALE <b>1:1500</b>	DRAWING NO. <b>24-066-PLW-1B</b>	
	DATE <b>APRIL 25, 2024</b>	DRAWN BY <b>S.K.</b>	

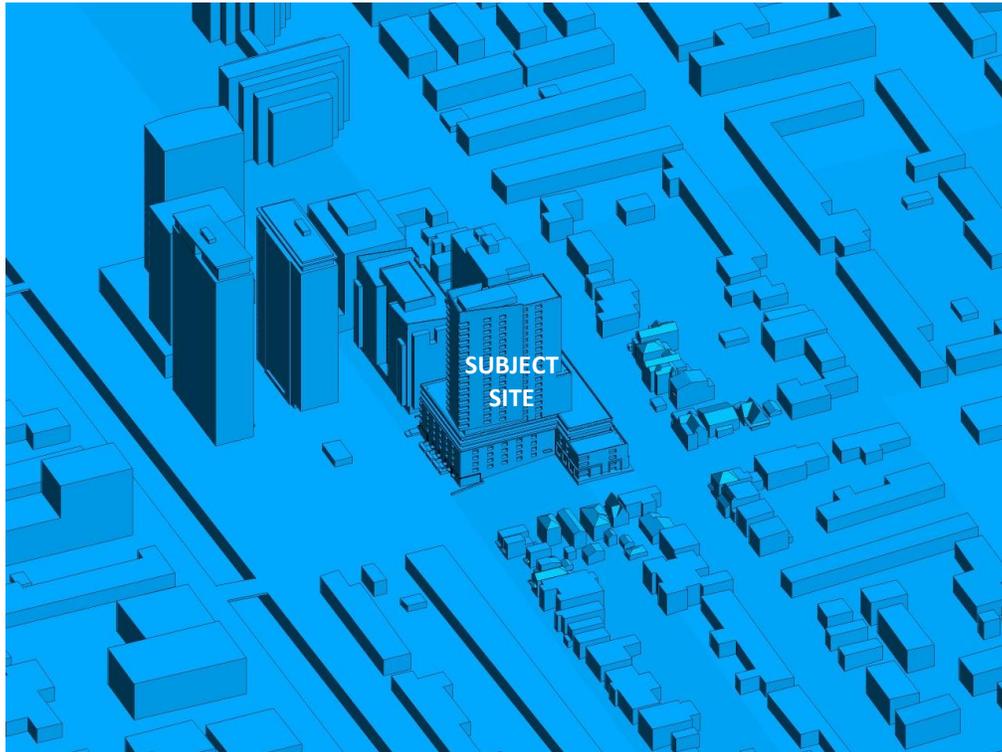

**FIGURE 2A: COMPUTATIONAL MODEL, PROPOSED MASSING, NORTH PERSPECTIVE**

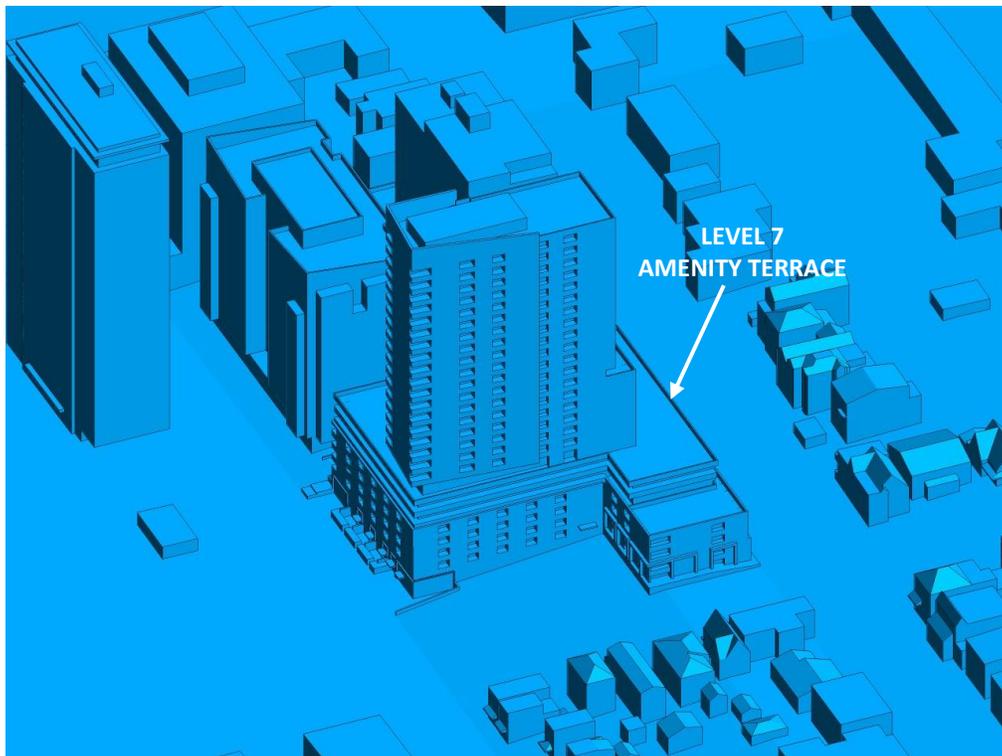


**FIGURE 2B: CLOSE UP OF FIGURE 2A**





**FIGURE 2C: COMPUTATIONAL MODEL, EXISTING MASSING, NORTH PERSPECTIVE**

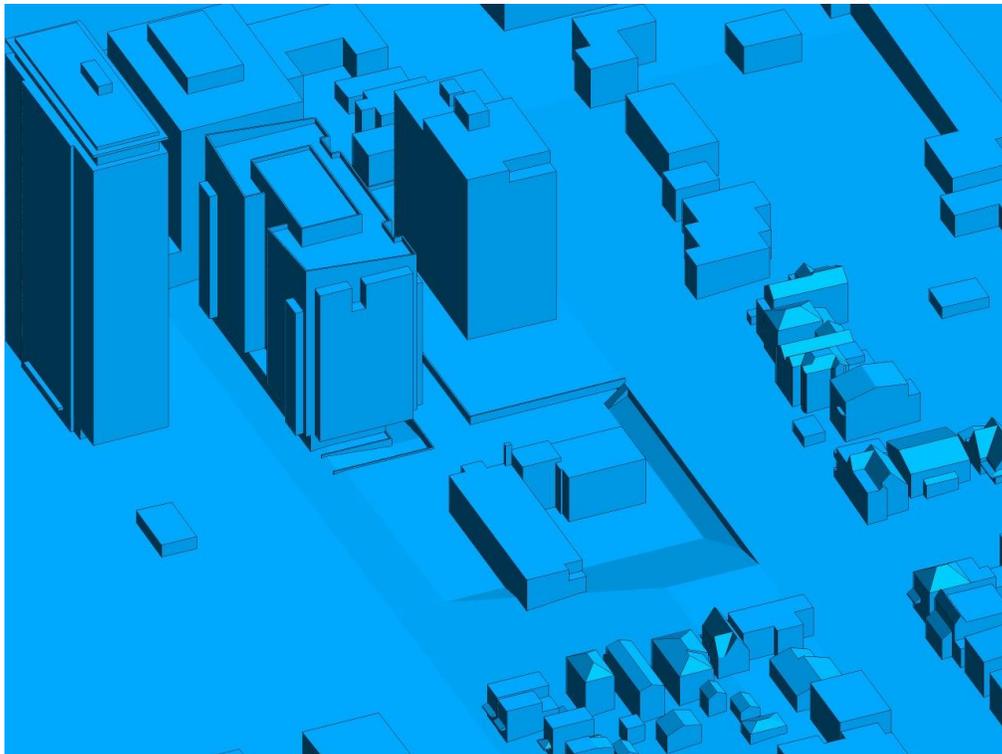

**FIGURE 2D: CLOSE UP OF FIGURE 2C**





**FIGURE 2E: COMPUTATIONAL MODEL, PROPOSED MASSING, SOUTH PERSPECTIVE**




**FIGURE 2F: CLOSE UP OF FIGURE 2E**





**FIGURE 2G: COMPUTATIONAL MODEL, EXISTING MASSING, SOUTH PERSPECTIVE**

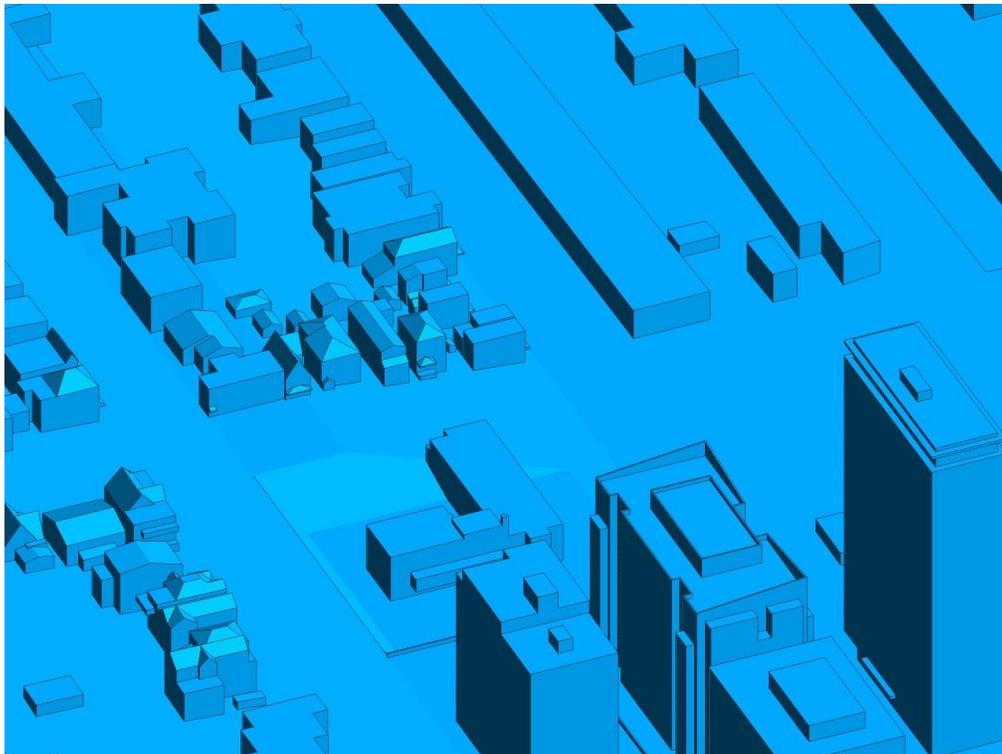

**FIGURE 2H: CLOSE UP OF FIGURE 2G**





FIGURE 3A: SPRING – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

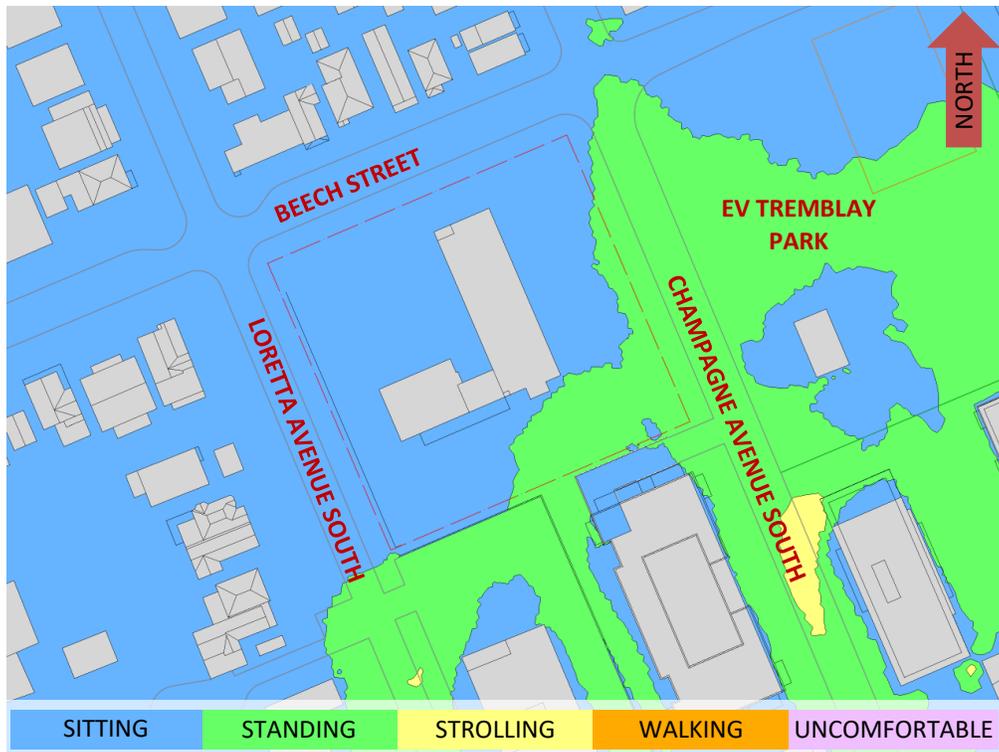


FIGURE 3B: SPRING – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



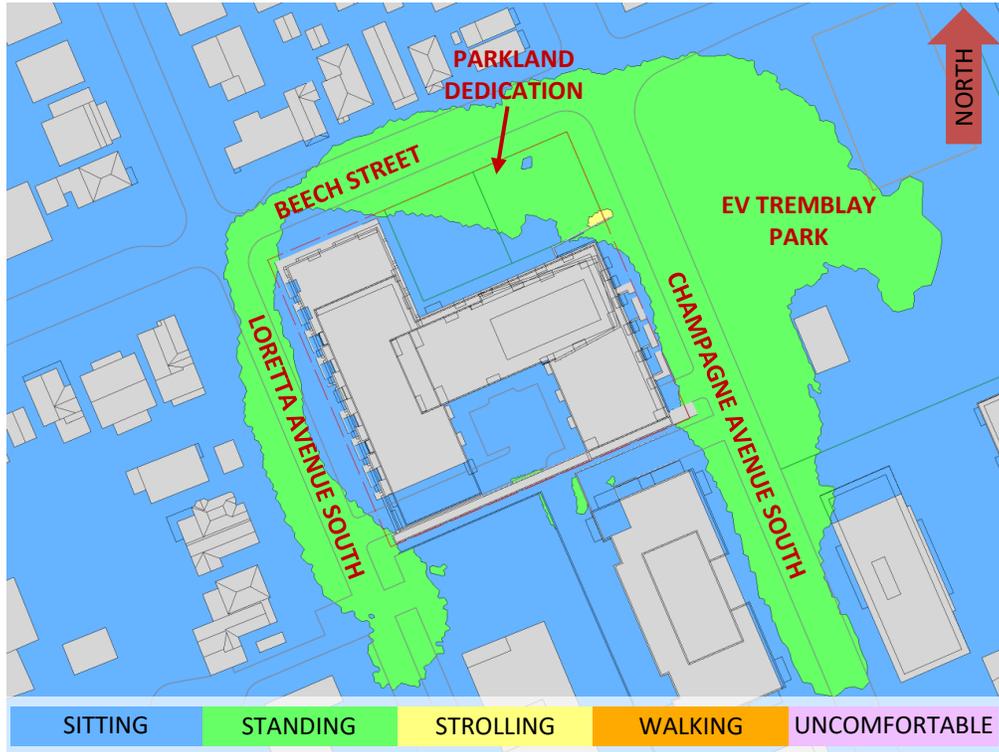


FIGURE 4A: SUMMER – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

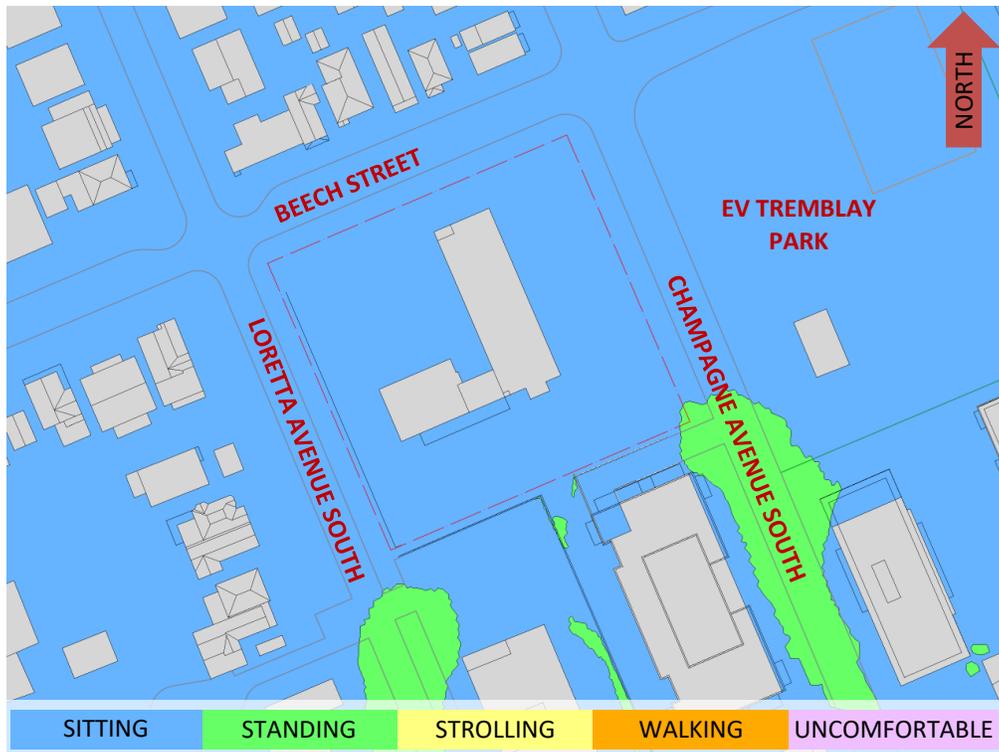


FIGURE 4B: SUMMER – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



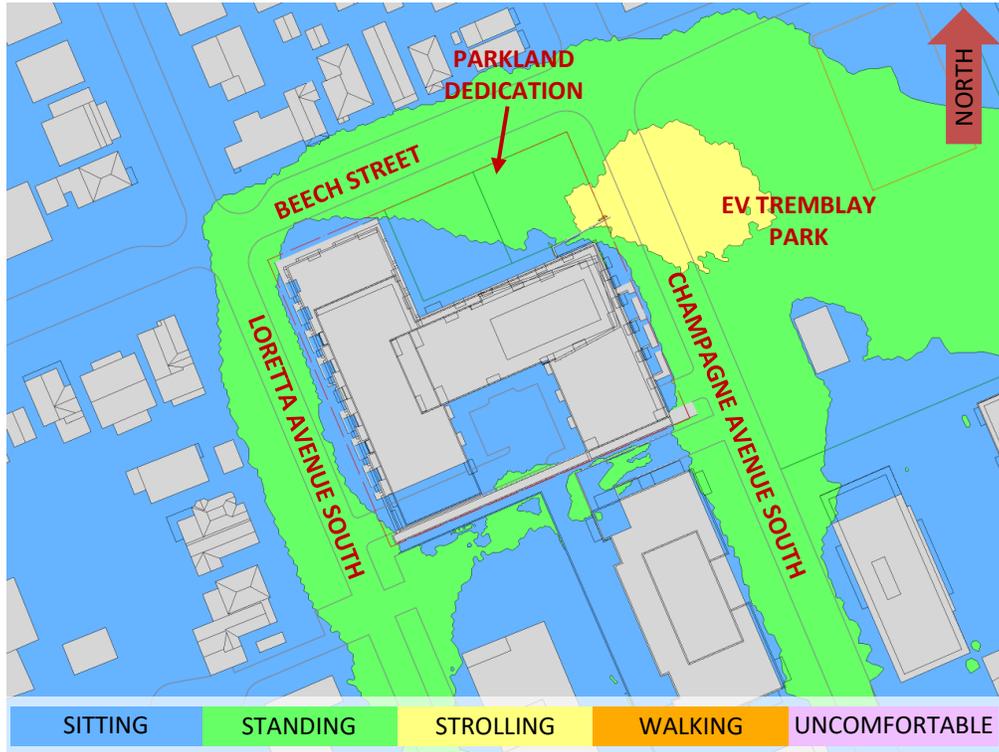


FIGURE 5A: AUTUMN – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

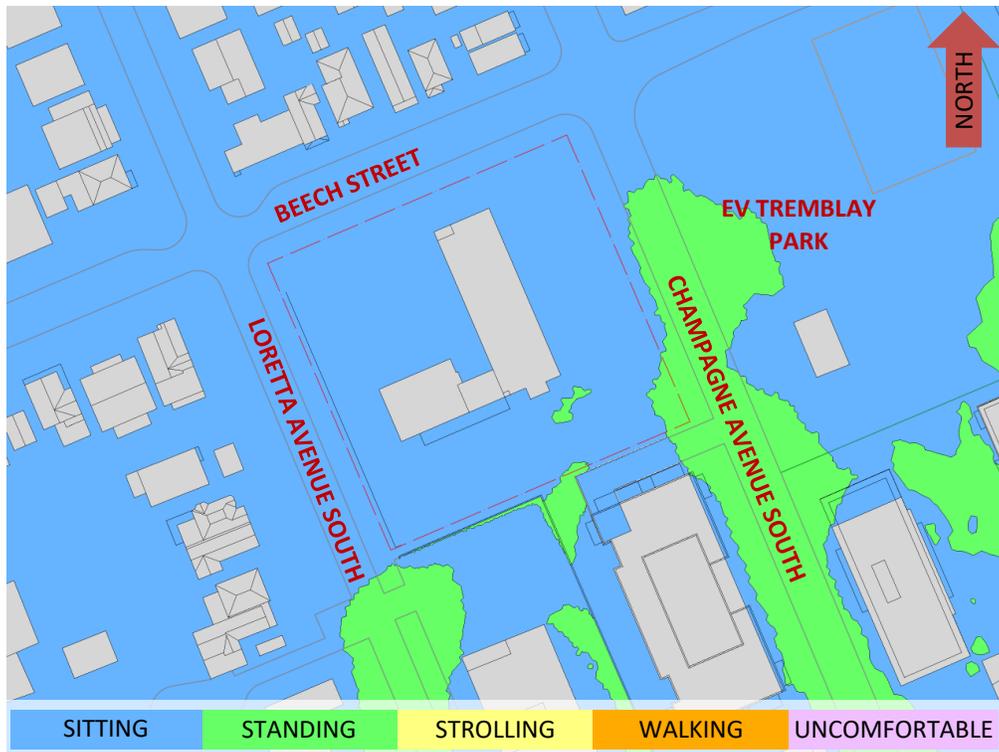


FIGURE 5B: AUTUMN – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



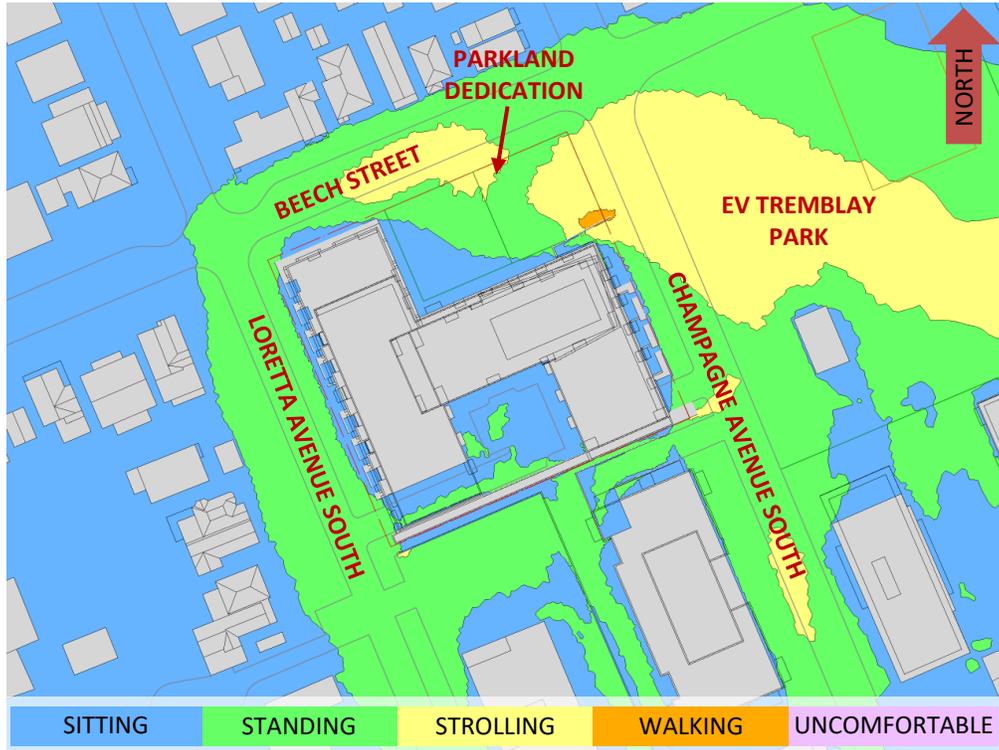


FIGURE 6A: WINTER – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

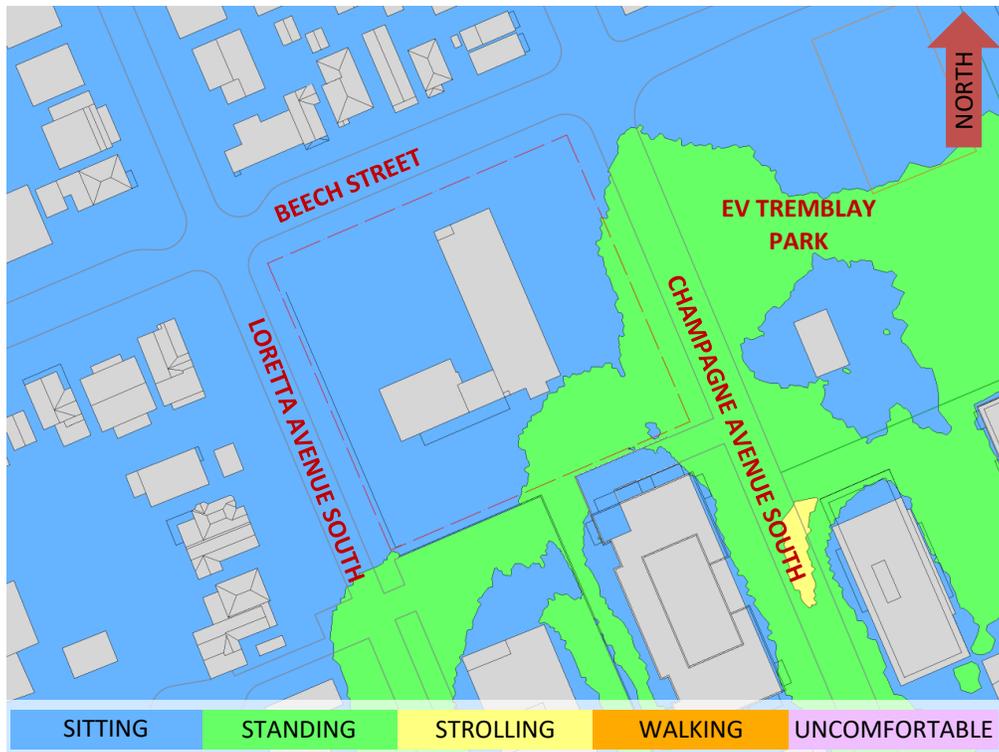


FIGURE 6B: WINTER – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



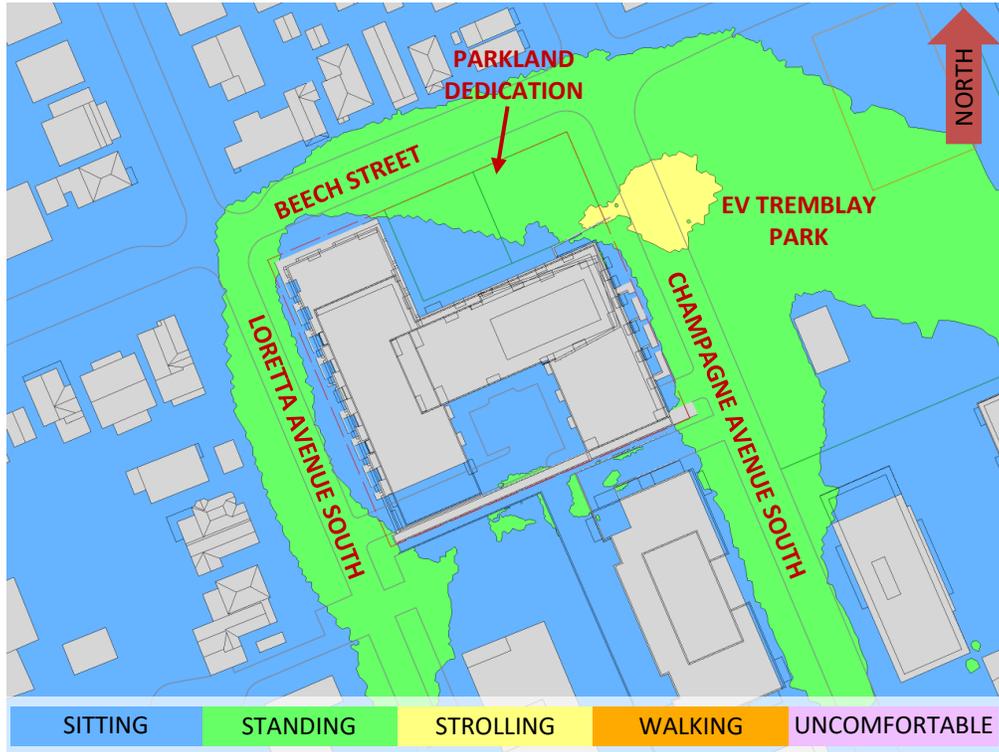


FIGURE 7A: TYPICAL USE PERIOD – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

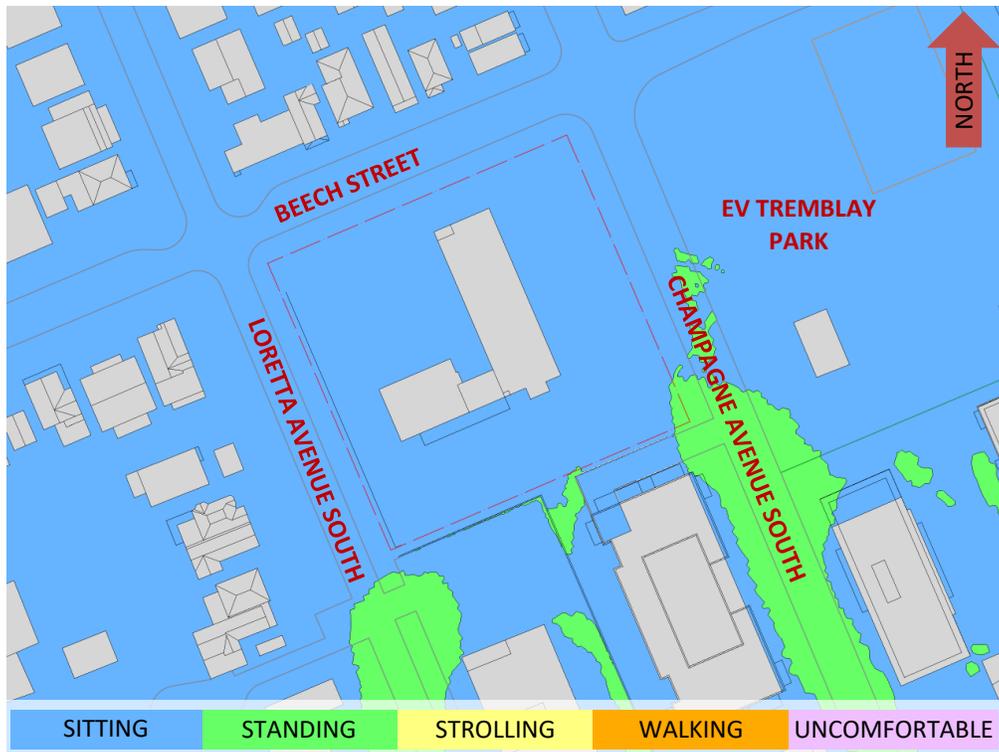


FIGURE 7B: TYPICAL USE PERIOD – WIND COMFORT, GRADE LEVEL – EXISTING MASSING





**FIGURE 8A: SPRING – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**



**FIGURE 8B: SUMMER – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**





**FIGURE 8C: AUTUMN – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**



**FIGURE 8D: WINTER – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**





**FIGURE 9: TYPICAL USE PERIOD – WIND COMFORT, LEVEL 7 COMMON AMENITY TERRACE**

# GRADIENTWIND

ENGINEERS & SCIENTISTS



## APPENDIX A

### SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

## **SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER**

The atmospheric boundary layer (ABL) is defined by the velocity and turbulence profiles according to industry standard practices. The mean wind profile can be represented, to a good approximation, by a power law relation, Equation (1), giving height above ground versus wind speed (1), (2).

$$U = U_g \left( \frac{Z}{Z_g} \right)^\alpha \quad \text{Equation (1)}$$

where,  $U$  = mean wind speed,  $U_g$  = gradient wind speed,  $Z$  = height above ground,  $Z_g$  = depth of the boundary layer (gradient height), and  $\alpha$  is the power law exponent.

For the model,  $U_g$  is set to 6.5 metres per second, which approximately corresponds to the 60% mean wind speed for Ottawa based on historical climate data and statistical analyses. When the results are normalized by this velocity, they are relatively insensitive to the selection of gradient wind speed.

$Z_g$  is set to 540 m. The selection of gradient height is relatively unimportant, so long as it exceeds the building heights surrounding the subject site. The value has been selected to correspond to our physical wind tunnel reference value.

$\alpha$  is determined based on the upstream exposure of the far-field surroundings (that is, the area that it not captured within the simulation model).

Table 1 presents the values of  $\alpha$  used in this study, while Table 2 presents several reference values of  $\alpha$ . When the upstream exposure of the far-field surroundings is a mixture of multiple types of terrain, the  $\alpha$  values are a weighted average with terrain that is closer to the subject site given greater weight.

**TABLE 1: UPSTREAM EXPOSURE (ALPHA VALUE) VS TRUE WIND DIRECTION**

Wind Direction (Degrees True)	Alpha Value ( $\alpha$ )
0	0.24
22.5	0.27
45	0.26
67.5	0.26
90	0.24
112.5	0.22
135	0.21
157.5	0.21
180	0.21
202.5	0.23
225	0.24
247.5	0.25
270	0.25
292.5	0.24
315	0.24
337.5	0.23

**TABLE 2: DEFINITION OF UPSTREAM EXPOSURE (ALPHA VALUE)**

Upstream Exposure Type	Alpha Value ( $\alpha$ )
Open Water	0.14-0.15
Open Field	0.16-0.19
Light Suburban	0.21-0.24
Heavy Suburban	0.24-0.27
Light Urban	0.28-0.30
Heavy Urban	0.31-0.33

The turbulence model in the computational fluid dynamics (CFD) simulations is a two-equation shear-stress transport (SST) model, and thus the ABL turbulence profile requires that two parameters be defined at the inlet of the domain. The turbulence profile is defined following the recommendations of the Architectural Institute of Japan for flat terrain (3).

$$I(Z) = \begin{cases} 0.1 \left(\frac{Z}{Z_g}\right)^{-\alpha-0.05}, & Z > 10 \text{ m} \\ 0.1 \left(\frac{10}{Z_g}\right)^{-\alpha-0.05}, & Z \leq 10 \text{ m} \end{cases} \quad \text{Equation (2)}$$

$$L_t(Z) = \begin{cases} 100 \text{ m} \sqrt{\frac{Z}{30}}, & Z > 30 \text{ m} \\ 100 \text{ m}, & Z \leq 30 \text{ m} \end{cases} \quad \text{Equation (3)}$$

where,  $I$  = turbulence intensity,  $L_t$  = turbulence length scale,  $Z$  = height above ground, and  $\alpha$  is the power law exponent used for the velocity profile in Equation (1).

Boundary conditions on all other domain boundaries are defined as follows: the ground is a no-slip surface; the side walls of the domain have a symmetry boundary condition; the top of the domain has a specified shear, which maintains a constant wind speed at gradient height; and the outlet has a static pressure boundary condition.

## REFERENCES

- [1] P. Arya, "Chapter 10: Near-neutral Boundary Layers," in *Introduction to Micrometeorology*, San Diego, California, Academic Press, 2001.
- [2] S. A. Hsu, E. A. Meindl and D. B. Gilhousen, "Determining the Power-Law Wind Profile Exponent under Near-neutral Stability Conditions at Sea," vol. 33, no. 6, 1994.
- [3] Y. Tamura, H. Kawai, Y. Uematsu, K. Kondo and T. Okhuma, "Revision of AIJ Recommendations for Wind Loads on Buildings," in *The International Wind Engineering Symposium, IWES 2003*, Taiwan, 2003.

