

**PROPOSED THREE-STOREY
RESIDENTIAL APARTMENT BUILDING SITE
LOT 47
R-PLAN 348
351 CROYDEN AVENUE
CITY OF OTTAWA**

**STORM DRAINAGE REPORT
REPORT R-817-21**

T.L. MAK ENGINEERING CONSULTANTS LTD.

JUNE 2017

REFERENCE FILE NUMBER 817-21

Introduction

The proposed three-storey apartment building site is located on the east side of Croydon Avenue, and situated north of Bond Street and south of Richmond Road. Its legal property description is Lot 47 Registered Plan 348 City of Ottawa. At this time, the residential lot under consideration is a vacant lot. The municipal address of the property is 351 Croydon Avenue.

The lot area under consideration is approximately 462.8 square metres. This property is proposed for the development of a three(3)-storey residential apartment building where the ground floor is approximately 50% below grade and three(3) storeys above the ground-floor level. The total square footage of the proposed building [all four (4) floor levels] is 7,521 square feet (698.32 square metres).

The building will house a total of eight(8) units consisting of four one(1)-bedroom and four two(2)-bedroom apartments. The storm-water outlet for this site is the existing 300mm diameter storm sewer located within the Croydon Avenue road right of way.

From storm-drainage criteria set by the staff at the City of Ottawa's Engineering Department, the allowable post-development runoff release rates shall not exceed the five(5)-year pre-development conditions. The allowable pre-development runoff coefficient is the calculated "C" existing value or C=0.5 maximum. If the uncontrolled storm-water runoff exceeds the specified requirements, then on-site storm-water management (SWM) control measures are necessary. The post-development runoff coefficient for this site is estimated at C=0.82, which exceeds the calculated pre-development allowable C=0.5 criteria for the Croydon Avenue storm sewer without on-site SWM control. Therefore, SWM measures are required. Refer to the attached Drainage Area Plan (Figure 1) as detailed in Appendix A.

This report will address and detail the grading, drainage, and storm-water management control measures required to develop this property. Based on the Proposed Site Grading and Storm-water Management Plan (Dwg. 817-21 G-1), the storm water of this lot will be entirely controlled on site.

The storm-water management calculations that follow will detail the extent of on-site SWM control to be implemented and the storage volume required on site to attain the appropriate runoff release that will conform to the City's established drainage criteria.

Site Data

1. Development Property Area

Post-Development Site Area Characteristics

Development Lot Area	=462.8m ²
Roof Surface Area	=216.92m ²
Asphalt Area	=149.28m ²
Concrete Area	=43.6m ²
Grass Area	=53.0m ²

$$C = \frac{(216.92 \times 0.9) + (149.28 \times 0.9) + (43.6 \times 0.8) + (53.0 \times 0.2)}{462.8}$$

$$C = \frac{375.06}{462.8}$$

$$C = 0.8104$$

Say "C"=0.82

Therefore, the average post-development "C" for this site is 0.82.

2. Controlled Area Data

Roof Surface Area	=216.92m ²
Asphalt Area	=140.28m ²
Concrete Area	=13.3m ²
Grass Area	=5.0m ²
Total Storm-water Controlled Area	=375.5m ²

$$C = \frac{(140.28 \times 0.9) + (5.0 \times 0.2) + (216.92 \times 0.9) + (13.3 \times 0.8)}{375.5}$$

$$C = \frac{330.12}{375.5}$$

$$C = 0.879$$

Say "C"=0.88

Therefore, the post-development "C" for the controlled storm-water drainage area is 0.88.

3. Uncontrolled Area Data

Asphalt Area	=9.0m ²
Grass Area	=48.0m ²
Concrete Area	=30.3m ²
Total Storm-water Uncontrolled Area	=87.3m ²

$$C = \frac{(30.3 \times 0.8) + (48.0 \times 0.2) + (9.0 \times 0.9)}{87.3}$$

$$C = \frac{41.94}{87.3}$$

$$C = 0.4804$$

Say "C"=0.48

Therefore, the post-development "C" for the uncontrolled storm-water drainage area of the site is 0.48.

The tributary area consisting of approximately 87.3 square metres will be out-letting off site uncontrolled from the residential apartment building site.

The SWM area to be controlled is 375.5m². Refer to the attached "Drainage Area Plan" in Figure 1 for details.

The site SWM storage area excluding the rooftop area that is to be controlled by the ICD in CB/MH1 is 375.5m² – 216.92m² = 158.58m² or 0.016ha.

Pre-Development Flow Estimation

Maximum allowable off-site flow: five(5)-year storm

Pre-Development Site Area Characteristics

Development Lot Area =462.8m²

Asphalt Area =453.0m²

Concrete Area =9.8m²

$$C = \frac{(453.0 \times 0.9) + (9.8 \times 0.8)}{462.8}$$

$$C = \frac{415.54}{462.8}$$

$$C = 0.898$$

Use C_{pre}=0.5 maximum allowable for redevelopment

T_c=D/V where D=30.0m, ΔH=0.34m, S=1.0%, and V=2.1feet/second=0.64m/s

Therefore,

$$T_c = \frac{30.0m}{0.64m/s}$$

T_c=0.78 minutes

Use T_c=10 minutes

I₅=104.4mm/hr [City of Ottawa, five(5)-year storm]

Using the Rational Method

$$Q=2.78 (0.5) (104.4) (0.0463)$$

$$Q=6.72\text{L/s}$$

Because 87.3 square metres are drained uncontrolled off site, the **net** allowable discharge for this site into the existing Croydon Avenue storm sewer system is $Q=\{2.78 (0.5) (104.4) (0.0463)-[2.78 (0.48) (178.6) (0.0087)]\}=6.72\text{L/s}-2.07\text{L/s}=4.65\text{L/s}$.

Storm-Water Management Analysis

The calculated flow rate of 4.65L/s for on-site storm-water management detention volume storage will be used for this SWM analysis. Because a total of two(2) controlled roof drains are proposed to restrict flow from the building at a rate of 1.26L/s into the Croydon Avenue storm sewer, therefore, the remainder of the site allowable release rate from the ICD in CB/MH1 is $4.65\text{L/s}-1.26\text{L/s}=3.39\text{L/s}$.

Therefore, the total allowable five(5)-year release rate of 6.72L/s will be entering into the existing 300mm diameter Croydon Avenue storm sewer. The runoff that is greater than the allowable release rate will be stored on site in the proposed storm-water management ponding areas at the asphalt parking lot area, underground storm pipes, and the flat rooftop of the proposed apartment building, all of which will be used for storm-water detention purposes.

The post-development inflow rate during the five(5)-year and 100-year storms for the parking lot drainage system and rooftop areas can be calculated as follows.

Design Discharge Computation

Parking Lot Surface and Underground Drainage System

The Rational Method was used to estimate peak flows.

$$Q=2.78 \text{ CIA}$$

Inflow rate Q_{ACTUAL} for the site is:

Five(5)-year event

C_5 =AVG "C" value of controlled area excluding roof area, where

$$C = \frac{(140.28 \times 0.9) + (5.0 \times 0.2) + (13.3 \times 0.8)}{158.58}$$

$$C = \frac{137.89}{158.58}$$

$$C = 0.87$$

Say $C_5=0.88$

$A=0.0159\text{ha}$

Inflow rate $Q_{A5}= 2.78 \text{ CIA}=2.78 (0.88) (0.0159\text{ha.}) \text{ I}$

$Q_{A1}= 0.039 \text{ I}$

$I=\text{mm/hr}$

The inflow rate for the controlled site tributary area can be calculated as follows:

$$Q_5 = 0.039 \text{ l}$$

100-year event

$C_{100} = 0.80$ (AVG "C" value of controlled area excluding roof area)

$$C = \frac{(140.28 \times 1.0) + (5.0 \times 0.2 \times 1.25) + (13.3 \times 0.8 \times 1.25)}{158.58}$$

$$C = \frac{154.83}{158.58}$$

$$C = 0.976$$

$$C_{100} = 0.98$$

Inflow rate $(Q_A)_{100} = 2.78 \text{ CIA} = 2.78 (0.98) (0.0159 \text{ ha.}) \text{ l}$

$$(Q_A)_{100} = 0.044 \text{ l}$$

$I = \text{mm/hr}$

This can be used to determine the storage volume for the site using the Modified Rational Method.

Actual flow Q_{ACTUAL} is calculated as $Q_A = 2.78 \text{ CIA}$

Q_{STORED} is calculated as $Q_S = Q_A - Q_{\text{ALLOW}}$

To Calculate Roof Storage Requirements

The proposed flat roof the apartment building on the property will incorporate two(2) roof drains to control flow off site. The smallest standard roof drain flow rate is each at 0.63L/s (10USgal./min.).

Therefore, the minimum storm-water flow that can be controlled from this rooftop and outletted off site is $0.63 \text{ L/s} \times 2 = 1.26 \text{ L/s}$.

$C = 0.9$ will be used for sizing roof storage volume in this case.

Inflow rate $(Q_A) = 2.78 \text{ CIA}$, where $C = 0.9$, $A = \text{surface area of roof}$, $I = \text{mm/hr}$

For Roof Area 1, $Q_{A1} = 2.78 \text{ CIA}$

Five (5)-Year Event

$$C_5 = 0.90$$

$$A = 119.9 \text{ m}^2$$

$I = \text{mm/hr}$

$$Q_{A1} = 2.78 (0.90) (0.012 \text{ ha.}) \text{ l} = 0.03 \text{ l}$$

100-Year Event

$$C_{100} = 1.0$$

$$A = 119.9 \text{ m}^2$$

$I = \text{mm/hr}$

$$Q_{A1}=2.78 (1.0)(0.012\text{ha.})I=0.0334I$$

For Roof Area 2, $Q_{A2}=2.78$ CIA

Five(5)-Year Event

$$C_5=0.90$$

$$A=97.02\text{m}^2$$

$I=\text{mm/hr}$

$$Q_{A1}=2.78 (0.90)(0.0097\text{ha.})I=0.0243I$$

100-Year Event

$$C_{100}=1.0$$

$$A=97.02\text{m}^2$$

$I=\text{mm/hr}$

$$Q_{A1}=2.78 (1.0) (0.0097\text{ha.}) I=0.027I$$

The summary results of the calculated inflow and the storage volume of the site and building's flat rooftop to store the five (5)-year and 100-year storm events are shown in Tables 1 to 6 inclusive.

Erosion and Sediment Control

The contractor shall implement Best Management Practices to provide for protection of the receiving storm sewer during construction activities. These practices are required to ensure no sediment and/or associated pollutants are released to the receiving watercourse. These practices include installation of a silt fence barrier (as per OPSD 219.110 and associated specifications) along Croydon Avenue and all other areas that sheet drain off site. Maintenance hole sediment barriers to be AMOCO 4555 non-woven geotextile or approved equivalent.

Conclusion

For development of this residential site ($\pm 0.0463\text{ha.}$) and in controlling the five(5)-year storm-water release rate off site to an allowable rate of 6.72L/s, a site storage volume of approximately 3.74m^3 minimum is required during the five(5)-year event. We estimate that approximately 3.10m^3 minimum of rooftop storage and 0.64m^3 minimum from the proposed underground storm-water drainage pipes and drainage structures are necessary to attenuate the five(5)-year storm event.

During the five-year storm event for the flat rooftop storage, the ponding depth on this rooftop is estimated at 120mm at the drain and 0mm at the roof perimeter, assuming a 2% minimum roof pitch to the drain. The rooftop storage available at Roof Area 1 is 2.99m^3 and 2.42m^3 at Roof Area 2, for a total of 5.41m^3 , which is greater than the required storage volume of 3.10m^3 .

As for the remaining storage volume of 0.64m^3 minimum required from the site development area, for the five(5)-year storm event, the estimated HWL of 72.33m will provide a total available storage volume of 1.29m^3 consisting of the proposed underground storm piping and drainage structures in the parking

lot and access road of the site. In total, the five(5)-year available site storage volume is approximately 6.70m^3 , which is greater than the required site storage volume of 3.74m^3 . See Appendix B for details.

To control the 100-year storm-water release rate off site to an allowable rate of 6.72L/s , a site storage volume of approximately 10.60m^3 minimum is required during the 100-year event. We estimate that approximately 7.92m^3 minimum of rooftop storage and 2.68m^3 minimum from the proposed underground drainage pipes and structures, and parking-lot surface storage area are necessary to attenuate the 100-year storm event.

During the 100-year storm event for the flat rooftop storage, the ponding depth on this rooftop is estimated at 150mm at the drain and 0mm at the roof perimeter, assuming a 2% minimum roof pitch to the drain. The rooftop storage available at Roof Area 1 is 5.91m^3 and 4.79m^3 at Roof Area 2, for a total of 10.70m^3 , which is greater than the required storage volume of 7.92m^3 .

As for the remaining storage volume of 2.68m^3 minimum required from the site development area, for the 100-year storm event, the estimated HWL of 74.08m will provide a total available storage volume of 4.43m^3 consisting of the proposed parking lot storm-water ponding area at CB/MH1 and CB3, underground storm pipes and drainage structures. In total, the 100-year available site storage volume is 15.13m^3 , which is greater than the required site storage volume of 10.60m^3 . See Appendix B for details.


Therefore, by means of flat building rooftop storage, grading the site to the proposed grades and constructing the proposed underground storm piping and drainage structures as shown on the Proposed Site Grading and Storm-water Management Plan Dwg. 817-21 G-1, the desirable five(5)-year storm and 100-year storm event detention volume of 6.70m^3 and 15.13m^3 respectively will be available on site.


An inlet control device (ICD) will be installed at the outlet of CB/MH 1 in the 300mm diameter storm pipe (outlet pipe) with $Q=3.39\text{L/s}$ under a head of 2.33m . A rooftop drain with a release rate of 0.63L/s will be installed at Roof Drain 1 and Roof Drain 2 of the proposed residential building rooftop as depicted on Dwg. 817-21 G-1. The five(5)-year and 100-year flow off site is restricted to 6.72L/s .

The ICD type recommended is a Hydrovex Regulator (50 VHV-1) or equivalent. See Appendix C for details.

The building weeping tile drainage will be outletted via a proposed 100mm PVC storm lateral. The building roof drains will be outletted via a separately proposed $125\text{mm}\varnothing$ PVC storm lateral which is required to be "wyed" or connected downstream of CB/MH1 into the proposed $300\text{mm}\varnothing$ PVC storm sewer to avoid surcharging storm water to the building.

PREPARED BY T.L. MAK ENGINEERING CONSULTANTS LTD.

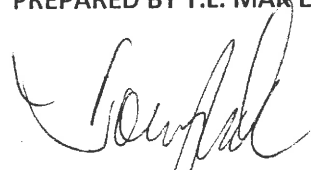
TONY L. MAK, P.ENG.

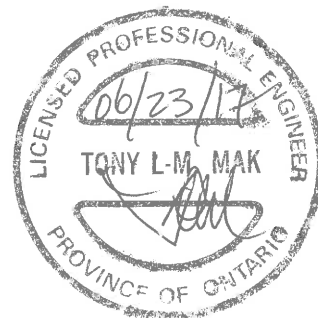

PROPOSED 351 CROYDON AVENUE RESIDENTIAL DEVELOPMENT SITE

TABLE 1

FIVE(5)-YEAR EVENT

SITE REQUIRED STORAGE VOLUME

t_c TIME (minutes)	I FIVE(5)-YEAR (mm/hr)	Q ACTUAL (L/s)	Q ALLOW (L/s)	Q STORED (L/s)	VOLUME STORED (m³)
5	141.20	5.51	3.39	2.12	0.64
10	104.20	4.06	3.39	0.67	0.40
15	83.50	3.26	3.39	0	0

Therefore, the required storage volume is 0.64m³.

PROPOSED 351 CROYDON AVENUE RESIDENTIAL DEVELOPMENT SITE

TABLE 2

FIVE(5)-YEAR EVENT

REQUIRED BUILDING ROOF AREA 1 STORAGE VOLUME

t_c TIME (minutes)	I 5-YEAR (mm/hr)	Q ACTUAL (L/s)	Q ALLOW (L/s)	Q STORED (L/s)	VOLUME STORED (m³)
10	104.20	3.13	0.63	2.50	1.50
15	83.50	2.51	0.63	1.88	1.69
20	70.30	2.11	0.63	1.48	1.78
25	60.90	1.83	0.63	1.20	1.80
30	53.93	1.62	0.63	0.99	1.78
35	48.50	1.46	0.63	0.83	1.74

Therefore, the required rooftop storage volume is 1.80m³.

PROPOSED 351 CROYDON AVENUE RESIDENTIAL DEVELOPMENT SITE

TABLE 3

FIVE(5)-YEAR EVENT

REQUIRED BUILDING ROOF AREA 2 STORAGE VOLUME

t_c TIME (minutes)	I 5-YEAR (mm/hr)	Q ACTUAL (L/s)	Q ALLOW (L/s)	Q STORED (L/s)	VOLUME STORED (m³)
10	104.20	2.53	0.63	1.90	1.14
15	83.50	2.03	0.63	1.40	1.26
20	70.30	1.71	0.63	1.08	1.30
25	60.90	1.48	0.63	0.85	1.28
30	53.93	1.32	0.63	0.69	1.24
35	48.50	1.18	0.63	0.55	1.16

Therefore, the required rooftop storage volume is 1.30m³.

PROPOSED 351 CROYDON AVENUE RESIDENTIAL DEVELOPMENT SITE

TABLE 4

100-YEAR EVENT

SITE REQUIRED STORAGE VOLUME

t_c TIME (minutes)	I 100-YEAR (mm/hr)	Q ACTUAL (L/s)	Q ALLOW (L/s)	Q STORED (L/s)	VOLUME STORED (m³)
5	242.8	10.68	3.39	7.29	2.19
10	178.6	7.86	3.39	4.47	2.68
15	142.9	6.29	3.39	2.90	2.61
20	120.0	5.28	3.39	1.89	2.27
25	103.9	4.57	3.39	1.18	1.77

Therefore, the required storage volume is 2.68m³.

PROPOSED 351 CROYDON AVENUE RESIDENTIAL DEVELOPMENT SITE

TABLE 5

100-YEAR EVENT

REQUIRED BUILDING ROOF AREA 1 STORAGE VOLUME

t_c TIME (minutes)	I 100-YEAR (mm/hr)	Q ACTUAL (L/s)	Q ALLOW (L/s)	Q STORED (L/s)	VOLUME STORED (m³)
10	178.6	5.97	0.63	5.34	3.20
15	142.9	4.77	0.63	4.14	3.73
20	120.0	4.01	0.63	3.38	4.06
25	103.9	3.47	0.63	2.84	4.26
30	91.9	3.07	0.63	2.44	4.39
35	82.6	2.76	0.63	2.13	4.47
40	75.1	2.51	0.63	1.88	4.51
45	69.1	2.31	0.63	1.68	4.54
50	63.9	2.13	0.63	1.50	4.50
55	59.6	1.99	0.63	1.36	4.49
60	55.9	1.87	0.63	1.24	4.46

Therefore, the required rooftop storage volume is 4.54m³.

PROPOSED 351 CROYDON AVENUE RESIDENTIAL DEVELOPMENT SITE

TABLE 6

100-YEAR EVENT

REQUIRED BUILDING ROOF AREA 2 STORAGE VOLUME

t_c TIME (minutes)	I 100-YEAR (mm/hr)	Q ACTUAL (L/s)	Q ALLOW (L/s)	Q STORED (L/s)	VOLUME STORED (m³)
10	178.6	4.82	0.63	4.19	2.51
15	142.9	3.86	0.63	3.23	2.91
20	120.0	3.24	0.63	2.61	3.13
25	103.9	2.81	0.63	2.18	3.27
30	91.9	2.48	0.63	1.85	3.33
35	82.6	2.24	0.63	1.61	3.38
40	75.1	2.03	0.63	1.40	3.36
45	69.1	1.87	0.63	1.24	3.35
50	63.9	1.73	0.63	1.10	3.30

Therefore, the required rooftop storage volume is 3.38m³.

PROPOSED THREE (3)-STOREY RESIDENTIAL APARTMENT BUILDING SITE

LOT 47

R-PLAN 348

351 CROYDON AVENUE


CITY OF OTTAWA

APPENDIX A



STORM DRAINAGE AREA PLAN

FIGURE 1

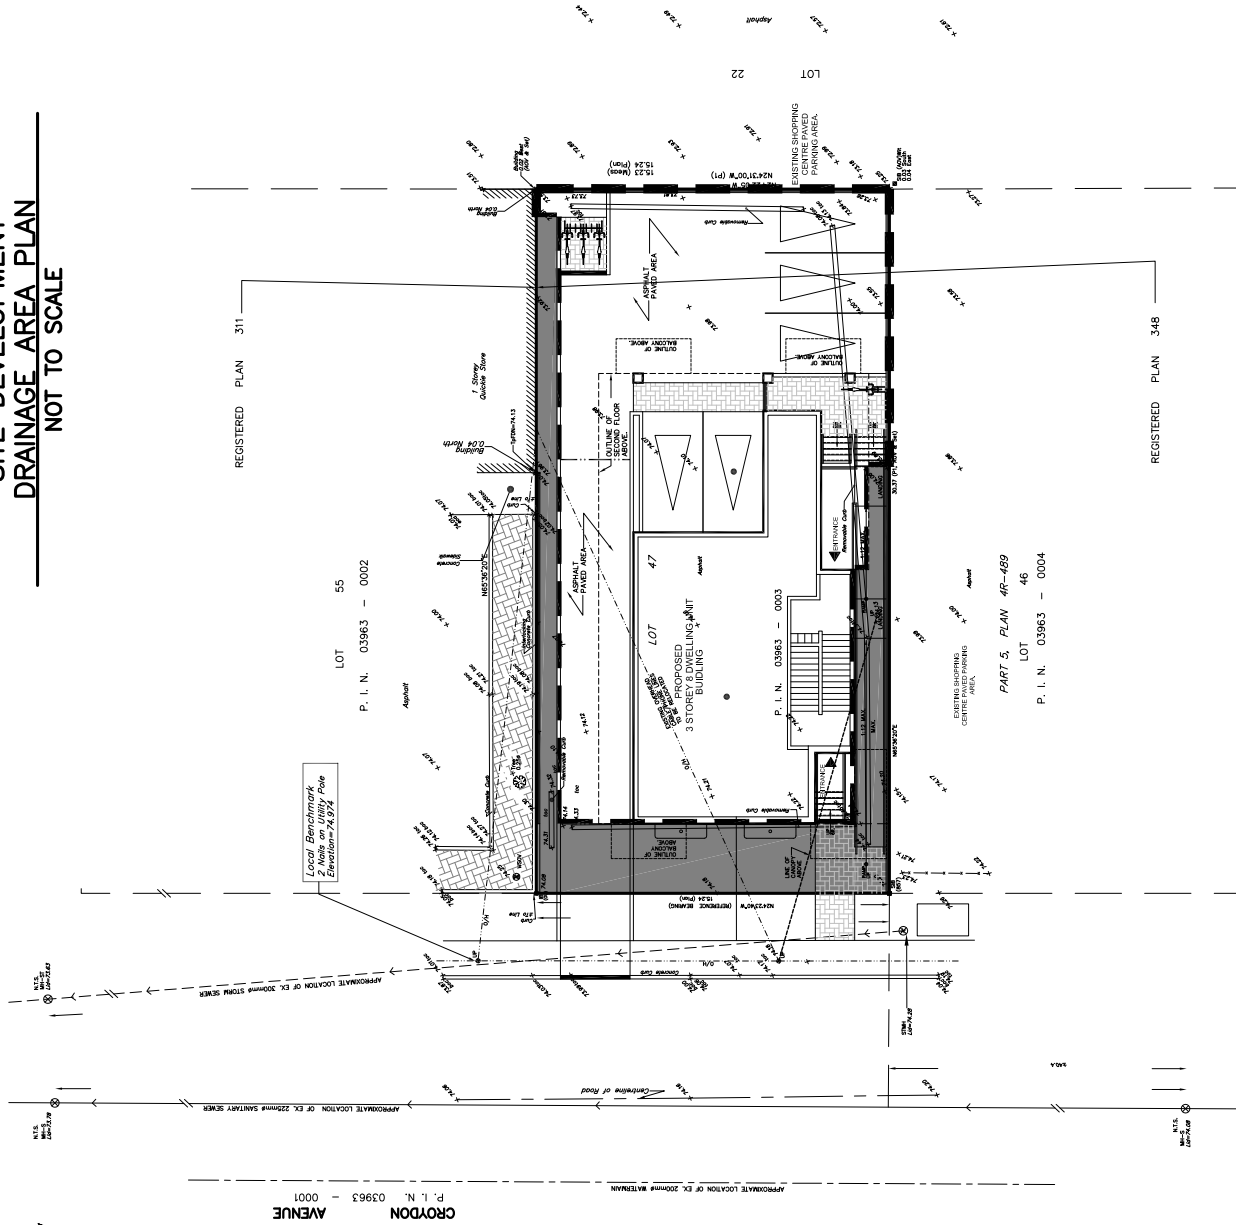**PROPOSED 351 CROYDON AVENUE
SITE DEVELOPMENT
DRAINAGE AREA PLAN
NOT TO SCALE**



LEGEND

-  **LIMIT OF CONTROLLED STORM DRAINAGE AREA = 375.50 SQ. M**
-  **UNCONTROLLED STORM DRAINAGE AREA = 87.3 SQ. M**

TOTAL AREA = 462.8 SQ. M

POST-DEVELOPMENT SITE AVERAGE "C" = 0.82

FIGURE 1

PROPOSED THREE (3)-STOREY RESIDENTIAL APARTMENT BUILDING SITE

LOT 47

R-PLAN 348

351 CROYDON AVENUE

CITY OF OTTAWA

APPENDIX B

DETAILED CALCULATIONS

FOR FIVE(5)-YEAR AND 100-YEAR

AVAILABLE STORAGE VOLUME

AVAILABLE STORAGE VOLUME CALCULATIONS

Five (5)-Year Event

Underground Storm Pipe and Drainage Structure Storage Volume
Assume five(5)-year HWL=72.33m (see attached Dwg. 817-21 G-1)

Drainage Structure Storage

CB/MH 1

$$V=3.14 (0.6)^2 (0.73)$$

$$V=0.83\text{m}^3$$

ST/MH 2

$$V=3.14 (0.6)^2 (0.43)$$

$$V=0.49\text{m}^3$$

CB 3

$$V=3.14 (0.6)^2 (0.25)$$

$$V=0.09\text{m}^3$$

Total drainage structure storage volume =1.41m³.

Underground Pipe Storage

Storm Pipe Storage

12.5m of 300mm diameter PVC pipe

$$V=\pi (0.15)^2 (12.5)$$

$$V=0.88\text{m}^3$$

6.0m of 250mm diameter PVC pipe

$$V=\pi (0.125)^2 (6.0)$$

$$V=0.29\text{m}^3$$

Total pipe storage volume =1.17m³.

Total effective underground storm pipe and drainage structure volume =2.58m³×0.5=1.29m³.

Therefore, the total underground storm pipe and drainage structure storage volume available at HWL=72.33m is estimated at 1.29m³ >required five(5)-year storage volume of 0.64m³ from Table 1.

Roof Storage at Flat Roof Building

The flat Roof Area 1 and Roof Area 2 will be used for storm-water detention. Each roof area will be drained by a controlled drain designed for a release rate of 10U.S.gal./min. or 0.63L/s.

Roof Storage Area 1

Available flat roof area for storage =119.9m² @roof slope of 2.0% minimum or 120mm of water height above the roof drain. Therefore, the available roof area will store a volume as shown below using the reservoir volume equation.

$$V = \frac{(0.12m)[75.69 + 4(18.49) + 0]}{6}$$

$$V = \frac{(0.12)(149.65)}{6}$$

$$V = 2.99\text{m}^3$$

The available Roof Area 1 storage volume of 2.99m³ >required five(5)-year storage volume of 1.80m³ from Table 2.

Roof Storage Area 2

Available flat roof area for storage =97.02m² @roof slope of 2.0% minimum or 120mm of water height above the roof drain. Therefore, the available roof area will store a volume as shown below using the reservoir volume equation.

$$V = \frac{(0.12m)[61.43 + 4(14.85) + 0]}{6}$$

$$V = \frac{(0.12)(120.83)}{6}$$

$$V = 2.42\text{m}^3$$

The available Roof Area 2 storage volume of 2.42m³ >required five(5)-year storage volume of 1.30m³ from Table 2.

Therefore, the ponding depth at the drain location is approximately 0.12m (120mm), and the five(5)-year level is estimated not to reach the roof perimeter of the building.

Hence, Roof Area 1 and Roof Area 2 of the proposed residential building flat rooftop storage is adequate to store the minimum required five(5)-year storm event volume of 3.10m³ given it can store up to 5.41m³. The total available underground drainage structure and storm pipe storage volume is 1.29m³, which is greater than the required 0.64m³ calculated volume at the estimated HWL=72.33m. The total storage available is 6.70m³, which is greater than the minimum required volume of 3.74m³.

AVAILABLE STORAGE VOLUME CALCULATIONS

100-Year Event

Asphalt Parking Lot Area Surface Storage Volume

Assume 100-year HWL=74.08m (see attached Dwg. 817-21 G-1 with the flood limit shown)

CB 3

$$V = \text{Available storage volume} = \frac{d}{6} (A_1 + 4A_2 + A_3)$$

$$V = \frac{(0.08)[26.2 + 4(10.2) + 0]}{6}$$

$$V = \frac{(0.08)(80.9)}{6}$$

$$V = 1.08\text{m}^3$$

CB/MH 1

V=Available storage volume

$$V = \frac{(0.08)[40.5 + 4(10.1) + 0]}{6}$$

$$V = \frac{(0.08)(67.0)}{6}$$

$$V = 0.89\text{m}^3$$

Total parking lot area surface storage volume=1.97m³.

Drainage Structures Storage

CB/MH 1

$$\begin{aligned} V &= 3.14 (0.6)^2 (1.2) + 3.14 (0.3)^2 (1.2) \\ &= 1.36 + 0.34 \\ &= 1.70\text{m}^3 \end{aligned}$$

ST MH 2

$$\begin{aligned} V &= 3.14 (0.6)^2 (0.90) + 3.14 (0.3)^2 (1.2) \\ &= 1.02 + 0.34 \\ &= 1.36\text{m}^3 \end{aligned}$$

CB 3

$$\begin{aligned} V &= (0.6)^2 (1.92) \\ &= 0.69\text{m}^3 \end{aligned}$$

Total drainage structure storage volume=3.75m³.

Underground Pipe Storage

Storm Pipe Storage

12.5m of 300mm diameter PVC pipe

$$V = \pi (0.15)^2 (12.5)$$

$$V = 0.88\text{m}^3$$

6.0m of 250mm diameter PVC pipe

$$V = \pi (0.125)^2 (6.0)$$

$$V = 0.29\text{m}^3$$

Total pipe storage volume = 1.17m³.

Total effective underground storm pipe and drainage structure volume = 4.92m³ × 0.5 = 2.46m³.

Therefore, the total parking lot surface, underground storm pipe and drainage structure storage volume available at HWL=74.08m is estimated at 4.43m³ > required 100-year storage volume of 2.68m³ from Table 4.

Roof Storage at Flat Roof Building

The flat Roof Area 1 and Roof Area 2 will be used for storm-water detention. Each roof area will be drained by a controlled drain designed for a release rate of 10U.S.gal./min. or 0.63L/s.

Roof Storage Area 1

Available flat roof area for storage = 119.9m² @ roof slope of 2.0% minimum or 150mm of fall from roof perimeter to roof drain. Therefore, the available roof area will store a volume as shown below using the reservoir volume equation.

$$V = \frac{(0.15\text{m})[119.9 + 4(29.16) + 0]}{6}$$

$$V = \frac{(0.15)(236.54)}{6}$$

$$V = 5.91\text{m}^3$$

The available Roof Area 1 storage volume of 5.91m³ > required 100-year storage volume of 4.54m³ from Table 5.

Roof Storage Area 2

Available flat roof area for storage = 97.02m² @ roof slope of 2.0% minimum or 150mm of fall from roof perimeter to roof drain. Therefore, the available roof area will store a volume as shown below using the reservoir volume equation.

$$V = \frac{(0.15\text{m})[97.02 + 4(23.66) + 0]}{6}$$

$$V = \frac{(0.15)(191.66)}{6}$$

$$V = 4.79\text{m}^3$$

The available Roof Area 2 storage volume of 4.79m³ > required 100-year storage volume of 3.38m³ from Table 6.

Therefore, the ponding depth at the drain location is approximately 0.15m (150mm), and at the perimeter of the flat roof area is 0mm above the roof perimeter surface. Accordingly, it is recommended that four (4) roof scuppers as shown on Dwg. 817-21 G-1 and the architect's roof plan be installed at the perimeter height of the rooftop for emergency overflow purposes in case of blockage from debris buildup at the roof drain.

Hence, Roof Area 1 and Roof Area 2 of the proposed residential building flat rooftop storage is adequate to store the minimum required 100-year storm event volume of 7.92m^3 given it can store up to 10.70m^3 . The total available parking lot surface, underground storm pipe, and drainage structure storage volume is 4.43m^3 , which is greater than the required 2.68m^3 calculated volume at the estimated HWL=74.08m. The total site storage available is 15.13m^3 , which is greater than the minimum site required volume of 10.60m^3 .

PROPOSED THREE (3)-STOREY RESIDENTIAL APARTMENT BUILDING SITE

LOT 47

R-PLAN 348

351 CROYDON AVENUE

CITY OF OTTAWA

APPENDIX C


INLET CONTROL DEVICE (ICD) DETAILS

HYDROVEX MODEL 50 VHV-1

CSO/STORMWATER MANAGEMENT



HYDROVEX[®] VHV / SVHV
Vertical Vortex Flow Regulator

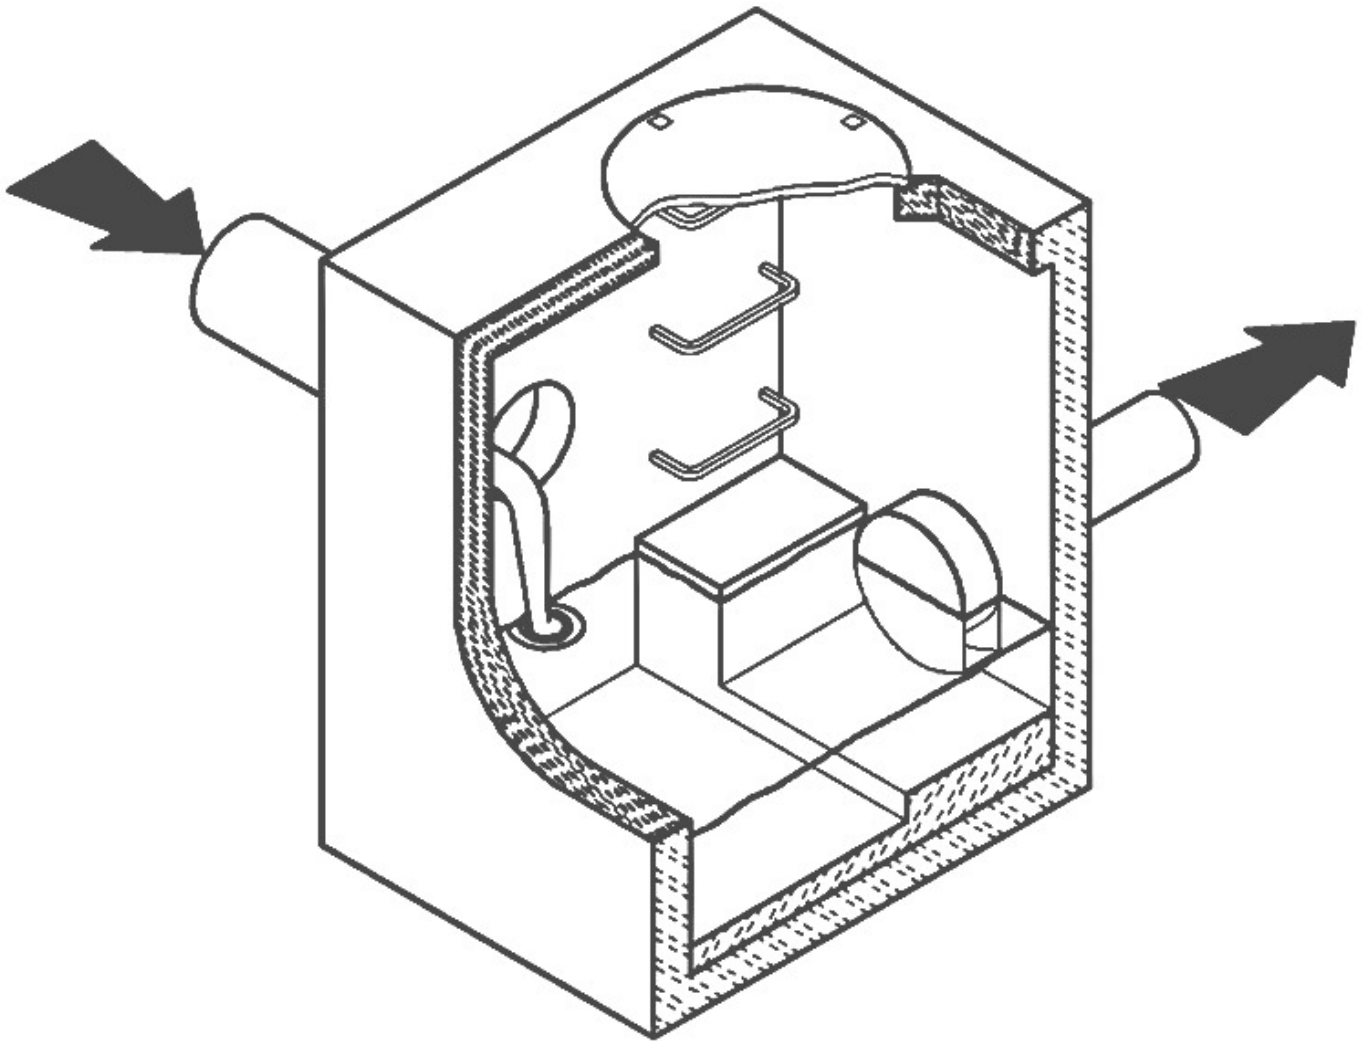

JOHN MEUNIER

HYDROVEX® VHV / SVHV VERTICAL VORTEX FLOW REGULATOR

APPLICATIONS

One of the major problems of urban wet weather flow management is the runoff generated after a heavy rainfall. During a storm event, uncontrolled flows may overload the drainage system and cause flooding. Sewer pipe wear and network deterioration are increased dramatically as a result of increased flow velocities. In a combined sewer system, the wastewater treatment plant will experience a significant increase in flows during storms, thereby losing its treatment efficiency.

A simple means of managing excessive water runoff is to control excessive flows at their point of origin, the manhole. **John Meunier Inc.** manufactures the **HYDROVEX® VHV / SVHV** line of vortex flow regulators for point source control of stormwater flows in sewer networks, as well as manholes, catch basins and other retention structures.

The **HYDROVEX® VHV / SVHV** design is based on the fluid mechanics principle of the forced vortex. The discharge is controlled by an air-filled vortex which reduces the effective water passage area without physically reducing orifice size. This effect grants precise flow regulation without the use of moving parts or electricity, thus minimizing maintenance. Although the concept is quite simple, over 12 years of research and testing have been invested in our vortex technology design in order to optimize its performance.

The **HYDROVEX® VHV / SVHV** Vertical Vortex Flow Regulators (refer to **Figure 1**) are manufactured entirely of stainless steel, and consist of a hollow body (1) (in which flow control takes place) and an outlet orifice (7). Two rubber "O" rings (3) seal and retain the unit inside the outlet pipe. Two stainless steel retaining rings (4) are welded on the outlet sleeve to ensure that there is no shifting of the "O" rings during installation and operation.

1. BODY
2. SLEEVE
3. O-RING
4. RETAINING RINGS
(SQUARE BAR)
5. ANCHOR PLATE
6. INLET
7. OUTLET ORIFICE

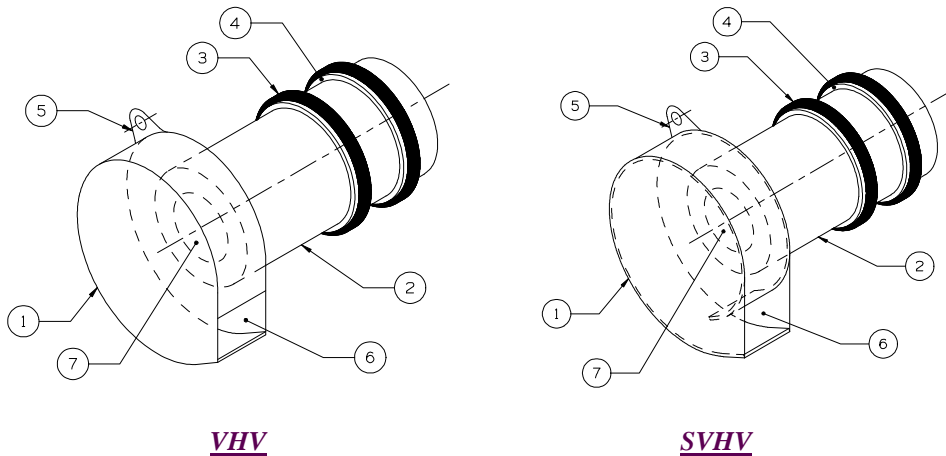


FIGURE 1: HYDROVEX® VHV-SVHV VERTICAL VORTEX FLOW REGULATORS

ADVANTAGES

- As a result of the air-filled vortex, a **HYDROVEX® VHV / SVHV** flow regulator will typically have an opening 4 to 6 times larger than an orifice plate. Larger opening sizes decrease the chance of blockage caused by sediments and debris found in stormwater flows. **Figure 2** shows the discharge curve of a vortex regulator compared to an equally sized orifice plate. One can see that for the same height of water and same opening size, the vortex regulator controls a flow approximately four times smaller than the orifice plate.
- Having no moving parts, they require minimal maintenance.
- Submerged inlet for floatables control.
- The **HYDROVEX® VHV / SVHV** line of flow regulators are manufactured entirely of stainless steel, making them durable and corrosion resistant.
- Installation of the **HYDROVEX® VHV / SVHV** flow regulators is quick and straightforward and is performed after all civil works are completed.
- Installation requires no assembly, special tools or equipment and may be carried out by any contractor.



VHV/SVHV Vortex Flow Regulator

