

Engineering

Land / Site
Development
Municipal
Infrastructure
Environmental /
Water Resources
Traffic /
Transportation
Structural
Recreational

Planning

Land / Site
Development
Planning Application
Management
Municipal Planning
Documents &
Studies
Expert Witness
(OMB)
Wireless Industry

Landscape Architecture

Urban Design &
Streetscapes
Open Space, Parks &
Recreation Planning
Community &
Residential
Developments
Commercial &
Institutional Sites
Environmental
Restoration



20 & 30 Frank Nighbor Place Ottawa, Ontario

Development Servicing Study and Stormwater Management Report

**PROPOSED CAMP MART DEVELOPMENT
AND PRIVATE ACCESS ROAD
20 & 30 FRANK NIGHBOR PLACE**

**DEVELOPMENT SERVICING STUDY AND
STORMWATER MANAGEMENT REPORT**

Prepared by:

NOVATECH

Suite 200, 240 Michael Cowpland Drive
Kanata, Ontario
K2M 1P6

February 9, 2018
Revised April 23, 2018
Revised May 24, 2018

Ref: R-2018-011
Novatech File No. 117193

May 24, 2018

20 Frank Nighbor Inc.
11266 Fifth Line
Halton Hills, ON
L7G 4S6

Attention: Mr. Sunny Bains

Dear Sir:

**Re: Development Servicing Study and Stormwater Management Report
Proposed Camp Mart Development and Private Access Road
20 & 30 Frank Nighbor Place, Ottawa, ON
Novatech File No.: 117193**

Enclosed is a copy of the revised 'Development Servicing Study and Stormwater Management Report' for the proposed development located at 20 & 30 Frank Nighbor Place, in the City of Ottawa. This report addresses the approach to site servicing and stormwater management and is submitted in support of site plan control applications for both the Camp Mart site and the private access road.

Please contact the undersigned, should you have any questions or require additional information.

Yours truly,

NOVATECH



François Thauvette, P. Eng.
Senior Project Manager

FT/sm

cc: Santhosh Kuruvilla (City of Ottawa)
Shawn Hickey (SiteCast Construction Corp.)

TABLE OF CONTENTS

1.0	INTRODUCTION	1
1.1	Purpose	1
1.2	Location and Site Description	1
1.3	Pre-Consultation Information	2
1.4	Proposed Development.....	2
1.5	Reference Material.....	2
2.0	SITE SERVICING – CAMP MART DEVELOPMENT	2
2.1	Sanitary Sewage	2
2.2	Water	3
2.2.1	Domestic Water Demand.....	4
2.2.1.1	Water Supply for Fire-Fighting.....	5
2.3	Storm Drainage and Stormwater Management.....	6
2.3.1	Stormwater Management Criteria and Objectives	6
2.3.2	Pre-Development Conditions and Allowable Release Rate	6
2.3.3	Post-Development Conditions	6
2.3.3.1	Area A-0 – Uncontrolled Runoff.....	7
2.3.3.2	Area A-1 – Controlled Flow from Main Parking Lot and Display Area.....	7
2.3.3.3	Area A-2 – Controlled Flow from Building Roof.....	7
2.3.3.4	Area A-3 – Controlled Flow from Rear Parking Lot and Display Area.....	8
2.3.3.5	Stormwater Quality Control.....	9
3.0	SITE SERVICING – PRIVATE ACCESS ROAD	10
3.1.1	Stormwater Management Criteria and Objectives	10
3.1.2	Pre-Development Conditions and Allowable Release Rate	11
3.1.3	Post-Development Conditions	11
3.1.3.1	Area A-4 – Controlled Flow from Private Access Road.....	11
4.0	SITE GRADING – CAMP MART DEVELOPMENT	12
4.1	Emergency Overland Flow Route.....	13
5.0	SITE GRADING – PRIVATE ACCESS ROAD	13
5.1	Emergency Overland Flow Route.....	13
6.0	GEOTECHNICAL INVESTIGATIONS – CAMP MART & PRIVATE ACCESS RD	13
7.0	EROSION & SEDIMENT CONTROL – CAMP MART & PRIVATE ACCESS RD	13
8.0	CONCLUSION – CAMP MART & PRIVATE ACCESS ROAD	14

LIST OF FIGURES

Figure 1 Aerial Plan

LIST OF APPENDICES

Appendix A: Correspondence

Appendix B: Development Servicing Study Checklist

Appendix C: Water Demands, Boundary Conditions Schematic of the Hydraulic Model, Hydraulic Modelling Results and FUS Calculations

Appendix D: IDF Curves and SWM Calculations, Storm Sewer Design Sheet, Excerpts from the previous SWM Report

Appendix E: Inlet Control Device (ICD) Information

Appendix F: Controlled Flow Roof Drain Information

Appendix G: Water Quality Treatment Unit Information

LIST OF PLANS

Camp Mart Site

General Plan of Services (117193-GP1, 117193-GP2)

Grading and Erosion & Sediment Control Plans (117193-GR1, 117193-GR2)

Stormwater Management Plans (117193-SWM1, 117193-SWM2)

Private Access Road

General Plan of Services (117193-GP3)

Grading and Erosion & Sediment Control Plan (117193-GR3)

Stormwater Management Plan (117193-SWM3)

1.0 INTRODUCTION

The new Camp Mart Canada site is being proposed by 20 Frank Nighbor Inc. and Novatech has been retained to complete the site servicing and stormwater management design for this project. Also included as part of the development is the private access road immediately south of the subject site.

1.1 Purpose

This report addresses the approach to site servicing and stormwater management and is being submitted in support of site plan control applications for both the Camp Mart site and the associated private access road.

1.2 Location and Site Description

The Camp Mart site is located at 20 Frank Nighbor Place, in the City of Ottawa. The site is currently vacant and approximately 1.99 ha in area. The site is located immediately south of Highway 417, west of the Home Depot. Vacant lands are located between the subject site and the Carp River to the west. The legal description of the Camp Mart site is designated as Parts 4, 5, 6 & 13 on Plan 4R-30745, Part of Block 2 on Plan 4M-1012, City of Ottawa.

The new private access road is located immediately south of the subject site at 30 Frank Nighbor Place, and covers an approximate area of 0.09 hectares. The legal description of the private access road is designated as Parts 2, 3, 7 to 12 on Plan 4R-30745, Part of Block 2 on Plan 4M-1012, City of Ottawa.

Figure 1 – Aerial Plan provides an aerial view of the site.



1.3 Pre-Consultation Information

A pre-consultation meeting was held with the City of Ottawa on August 2, 2017, at which time the client was advised of the general submission requirements. The Mississippi Valley Conservation (MVC) was also consulted regarding the proposed development and a pre-consultation meeting has been requested with the Ministry of Environment and Climate Change (MOECC). Refer to **Appendix A** for a summary of the correspondence related to the proposed development.

1.4 Proposed Development

The proposed Camp Mart development will consist of a trailer sales and service building, including trailer display areas and a parking lot. The proposed building will be serviced by extending new services to the municipal sanitary sewer, storm sewer and watermain in an existing easement located south of the subject site. Construction will proceed as a single phase.

A new private access road will also be constructed as part of the proposed development, immediately south of the subject site. The access road will be extended off Frank Nighbor Place and will provide the necessary site access for large trailers and emergency vehicles (i.e. fire trucks).

1.5 Reference Material

¹ The 'Terry Fox Business Park – Stormwater Design Plan' (Ref. No. 91005-3), prepared by Novatech Engineering Consultants Ltd., on August 9, 1994.

² The Geotechnical Investigation Report (Ref. No. PG4409-1), prepared by Paterson Group on February 9, 2018.

2.0 SITE SERVICING – CAMP MART DEVELOPMENT

The objective of the site servicing design is to provide proper sewage outlets, a suitable domestic water supply and to ensure that appropriate fire protection is provided for the proposed development. The servicing criteria, expected sewage flows and water demands are to conform to the requirements of the City of Ottawa municipal design guidelines for sewer and water distribution systems and are to be consistent with the approach described in the 'Terry Fox Business Park – Stormwater Design Plan'¹. Refer to the subsequent sections of the report for further details.

The City of Ottawa Servicing Study Guidelines for Development Applications requires that a Development Servicing Study Checklist be included to confirm that each applicable item is deemed complete and ready for review by City of Ottawa Infrastructure Approvals. A completed checklist is enclosed in **Appendix B** of the report.

2.1 Sanitary Sewage

The City of Ottawa Design Guidelines estimate the average daily sanitary sewage flow from industrial sites to be approximately 35,000 L/gross ha/day. The allowable average sewage flow from the subject site would therefore be approximately 0.81 L/s (or 35,000 L/ha/day x 1.99 ha).

The proposed building will be serviced by a new 200mm dia. sanitary service connected to the existing 450mm dia. sanitary sewer in the existing easement running along Frank Nighbor Place. The City of Ottawa design criteria were used to calculate the theoretical sanitary flows for the proposed development. The following design criteria were taken from Section 4 – ‘Sanitary Sewer Systems’ and Appendix 4-A - ‘Daily Sewage Flow for Various Types of Establishments’ of the City of Ottawa Sewer Design Guidelines:

- Design Population: 35-40 employees (use 40 in calculations)
- Average Daily Sewage Flows (Employees): 75 L/person/day
- Average Daily Sewage Flows (Service Bay): 40 L/vehicle/day
- Average Daily Sewage Flows (Service Bay Cleaning): 375 L/bay/day
- Average Daily Sewage Flows (Wash Bay): 400 L/vehicle/day
- Average number of vehicles serviced per day: 1 to 6 (use 6 in calculations)
- Average number of vehicles washed per day: 1 to 6 (use 6 in calculations)
- Commercial Peaking Factor = 1.5
- Infiltration Allowance: 0.28 L/s/ha x 1.99 ha site = 0.56 L/s

Table 1 identifies the theoretical sanitary flows for the proposed development based on the above design criteria.

Table 1: Theoretical Post-Development Sanitary Flows

Type of Use	Design Population (Employees/Vehicles/Bays)	Average Flow (L/s) ¹	Peaking Factor	Peak Flow (L/s)	Total Flow (L/s)
Office Staff	40 employees	0.10	1.5	0.15	0.15
Service Bay	6 vehicles	<0.01	1.5	0.02	0.02
Service Bay Cleaning	6 bays	0.08	1.5	0.12	0.12
Wash Bay	6 vehicles	0.08	1.5	0.12	0.12
Total	-	0.27	-	-	0.97 ²

¹Average Flow based on an 8-hour work day

²Includes an infiltration allowance of 0.28 L/s/ha

As indicated in the table above, the calculated post-development average sewage flow is less than the allowable sewage flow calculated based on a rate of 35,000 L/gross ha/day.

A 200mm dia. sanitary gravity sewer at a minimum slope of 1.0% has a full flow conveyance capacity of 34.2 L/s and will have sufficient capacity to convey the theoretical sanitary flows.

2.2 Water

The proposed development will be serviced by a new 200mm dia. watermain connected to the existing 300mm dia. watermain in the existing easement running along Frank Nighbor Place. The proposed water service will be reduced to a 150mm dia. line before entering the building. The service has been sized to provide both the required domestic water demand and fire flow. A shut-off valve will be provided on the proposed watermain at the property line. The water meter will be in the mechanical room inside the building; while the remote meter will be located on the exterior face of the building near the main entrance.

To determine if the existing 300mm dia. municipal watermain has adequate capacity to accommodate the proposed development a hydraulic analysis was completed based on boundary conditions provided by the City of Ottawa.

2.2.1 Domestic Water Demand

The City of Ottawa design criteria were used to calculate the theoretical water demand for the proposed development. The following design criteria were taken from Section 4 – ‘Water Distribution Systems’ of the Ottawa Design Guidelines – Water Distribution and Table 3-3 from the MOE design guidelines for drinking water systems:

- Design Population: 35-40 employees (use 40 in calculations)
- Average Daily Water Demand: 75 L/person/day
- Maximum Day Demand Peaking Factor = 1.5 x Avg. Day Demand (City Water Table 4.2)
- Peak Hour Demand Peaking Factor = 1.8 x Max. Day Demand (City Water Table 4.2)
- Average Daily Water Demand (Service Bay): 40 L/vehicle/day
- Average Daily Water Demand (Service Bay Cleaning): 375 L/bay/day
- Average Daily Water Demand (Wash Bay): 400 L/vehicle/day
- Average number of vehicles serviced per day: 1 to 6 (use 6 in calculations)
- Average number of vehicles washed per day: 1 to 6 (use 6 in calculations)

The following design criteria were taken from Section 4.2.2 – ‘Watermain Pressure and Demand Objectives’ of the City of Ottawa Design Guidelines for Water Distribution:

- Normal operating pressure are to range between 345 kPa (50 psi) and 552 kPa (80 psi) under Max Day demands
- Minimum system pressures are to be 276 kPa (40 psi) under Peak Hour demands
- Minimum system pressures are to be 140 kPa (20 psi) under Max Day + Fire Flow demands

Table 2 identifies the theoretical domestic water demands for the development based on the above design criteria.

Table 2: Theoretical Water Demand for Proposed Development

Type of Use	Design Population (Employees/Vehicles/ Bays)	Average Day Demand (L/s) ³	Max. Day Demand (L/s)	Peak Hour Demand (L/s)
Office Staff	40 employees	0.10	0.15	0.27
Service Bay	6 vehicles	0.003	0.004	0.008
Service Bay Cleaning	6 bays	0.08	0.12	0.22
Wash Bay	6 vehicles	0.08	0.12	0.22
Total	-	0.26	0.39	0.72

³Values taken from **Table 1** above.

2.2.1.1 Water Supply for Fire-Fighting

The proposed building will be fully sprinklered and supplied with a fire department siamese connection. The siamese connection will be located within 45m of the proposed on-site fire hydrant. The Fire Underwriters Survey (FUS) was used to estimate fire flow requirements for the proposed building. Non-combustible construction was used in the calculations based on information provided by the architect. Based on preliminary FUS calculations, the fire flow requirements for the building are expected to be in the order of 1,849 USGPM (or 7,000 L/min). The fire flow requirements include both sprinkler system and hose allowances in accordance with the OBC and NFPA 13. The sprinkler system will be designed by the fire protection (sprinkler) contractor as this process involves detailed hydraulic calculations based on building layout, pipe runs, head losses, fire pump requirements, etc. Booster pumps will not be required. Refer to **Appendix C** for a copy of the FUS fire flow calculations.

The hydraulic model EPANET was used to analyzing the performance of the proposed watermain for two theoretical conditions:

- 1) Maximum Day + Fire Flow Demand
- 2) Peak Hour Demand

A schematic representation of the hydraulic network depicts the node and pipe numbers used in the model. The model is based on hydraulic boundary conditions provided by the City of Ottawa. The model indicates that adequate pressure will exist throughout the watermain system under the specified design conditions. **Table 2A** and **Table 2B** summarize the hydraulic model results. Refer to **Appendix C** for City of Ottawa boundary conditions, the hydraulic modeling schematic and modeling results.

Table 2A: Maximum Day + Fire Flow Demand

Operating Condition	Minimum System Pressure	Maximum System Pressure
A Max Day demand of 0.4 L/s at Node J3 (Building) + a Fire Flow of 117 L/s at Node J4 (Hydrant)	A minimum system pressure of 492.66 kPa (71.45 psi) is available at Node J4 (Hydrant)	A maximum system pressure of 565.15 kPa (81.97 psi) is available at Nodes J1 and J2 (Hydrant Tee and Reducer)

Table 2B: Peak Hour Demand

Operating Condition	Minimum System Pressure	Maximum System Pressure
A Peak Hour demand of 0.72 L/s at Node J3 (Building)	A minimum system pressure of 604.30 kPa (87.65 psi) is available at Node J4 (Hydrant)	A maximum system pressure of 638.63 kPa (92.63 psi) is available at Nodes J1 and J2 (Hydrant Tee and Reducer)

The model indicates that the proposed 200mm dia. watermain will provide adequate system pressures for both 'Max Day + Fire Flow' and 'Peak Hour' conditions. Since the pressures will exceed 80 PSI (beyond the normal operating pressure range), the building will need to be equipped with a pressure reducing valve (PRV) per City of Ottawa Water Design Guidelines.

2.3 Storm Drainage and Stormwater Management

The proposed Camp Mart site will be serviced by connecting the proposed on-site storm sewer system to the existing 1050mm dia. storm sewer in the existing easement running along Frank Nighbor Place. The approach for the stormwater management design for the site is discussed in the subsequent sections of the report.

2.3.1 Stormwater Management Criteria and Objectives

The criteria and objectives for the proposed stormwater management design of the Camp Mart site are as follows:

- Provide a dual drainage system (i.e. minor system and emergency overland flow route, for events exceeding the 100-year design storm);
- Maximize the use of rooftop and surface storage available on site;
- Control the post-development flows from the site to the maximum allowable release rate of 50 L/s/ha for both the 5-year and 100-year design storms, as defined in the 'Terry Fox Business Park – Stormwater Design Plan'¹.
- Ensure that no surface ponding will occur on the paved surfaces (i.e. private drive aisles or parking lots) during the 2-year storm event.
- Provide on-site water quality control equivalent to a 'Normal' Level of Protection (i.e., minimum 70% TSS removal) prior to releasing flows from the site towards the Carp River;
- Provide guidelines to ensure that site preparation and construction is in accordance with the current Best Management Practices for Erosion and Sediment Control.

2.3.2 Pre-Development Conditions and Allowable Release Rate

The uncontrolled pre-development flows for the 1.99 ha site were calculated using the Rational Method to be 115.3 L/s during the 5-year design event and 247.0 L/s during the 100-year design event. Refer to **Appendix D** for detailed calculations. There are currently no water quantity or water quality control measures being provided on site.

The allowable release rate for the site, as specified in the 'Terry Fox Business Park – Stormwater Design Plan'¹, was calculated to be 99.5 L/s (50 L/s/ha x 1.99 ha). The site to be developed is located within 'Drainage Basin 1' as defined on Figure 2. Refer to **Appendix D** for excerpts from the 'Terry Fox Business Park – Stormwater Design Plan'¹.

2.3.3 Post-Development Conditions

The proposed building will be serviced by extending a new 200mm dia. storm service from the on-site storm sewer system. The on-site storm sewer system will outlet to the existing 1050mm dia. storm sewer, which discharges directly to the Carp River, approximately 210m to the west. Stormwater runoff from the site will be directed to various catchbasins and catch basin manholes located within the paved areas and/or towards landscape drains located within the grassed areas. To mitigate the stormwater related impacts due to the increase in imperviousness of the site, stormwater runoff will be attenuated using control flow roof drains and inlet control devices (ICD) installed within the on-site storm sewer system. Flows will be

attenuated for storms up to and including the 100-year design event. Due to the existing grades, runoff from a very small portion of the site will sheet drain uncontrolled off site.

2.3.3.1 Area A-0 – Uncontrolled Runoff

The uncontrolled post-development flow from this very small sub-catchment area was calculated using the Rational Method to be approximately 6.1 L/s during the 5-year design event and 12.4 L/s during the 100-year design event. Refer to **Appendix D** for SWM calculations.

2.3.3.2 Area A-1 – Controlled Flow from Main Parking Lot and Display Area

The post-development flow from this sub-catchment area will be attenuated using an ICD installed in the outlet pipe of CBMH 1. Stormwater runoff from this sub-catchment area will be temporarily stored within the grassed areas and on the paved parking lot prior to being discharged into the on-site storm sewer system. The site has been designed to ensure that no stormwater will pond on the private paved surfaces (i.e. drive aisles or parking lots) during the 2-year storm event.

Table 3A summarizes the post-development design flow from this sub-catchment area as well as the type of ICD, the anticipated ponding elevations, storage volumes required and storage volume provided for the 2-year, 5-year and the 100-year design events.

Table 3A: Design Flow and Inlet Control Device Table

Design Event	Sub-Catchment Area A-1				
	ICD Type	Design Flow (L/s)	Ponding Elevation (m)	Storage Vol. Required (m ³)	Max Storage Provided (m ³)
2-Year	Plug type ICD with a 88mm dia. circular orifice	23.1 L/s	94.84 m	127.4 m ³	631.9 m ³
5-Year		23.5 L/s	94.91 m	191.4 m ³	
100-Year		24.1 L/s	95.01 m	448.4 m ³	

Refer to **Appendix D** for SWM calculations. As indicated in the table above, this sub-catchment area will provide sufficient storage for the 2-year, 5-year and 100-year design events. Furthermore, no stormwater will pond on the private paved surfaces (i.e. drive aisles or parking lots) during the 2-year storm event.

2.3.3.3 Area A-2 – Controlled Flow from Building Roof

The post-development flow from this sub-catchment area will be attenuated using ten (10) Zurn Control-Flo roof drains, complete with parabolic weir (model number Z-105) prior to being directed to the proposed storm service.

Table 3B summarizes the post-development design flows from this sub-catchment area as well as the type of roof drains, the maximum anticipated ponding depths, storage volumes required and storage volumes provided for both the 5-year and the 100-year design events.

Table 3B: Design Flow and Roof Drain Table

Roof Drain ID & Drainage Area (ha)	Number of Roof Drains	Zurn Roof Drain Model ID (# of Notches)	Controlled Flow per Drain (L/s)		Approximate Ponding Depth Above Drains (m)		Storage Volume Required (m ³)		Max. Storage Available (m ³)
			1:5 Year	1:100 Year	1:5 Year	1:100 Year	1:5 Year	1:100 Year	
RD-1 (0.030 ha)	1	Z-105 (2 Notches)	2.52	3.16	0.10	0.13	3.5	8.6	21.1
RD-2 (0.032 ha)	1	Z-105 (2 Notches)	2.52	3.16	0.10	0.13	3.6	8.8	
RD-3 (0.039 ha)	1	Z-105 (3 Notches)	4.02	5.67	0.11	0.14	3.8	9.1	20.8
RD-4 (0.041 ha)	1	Z-105 (3 Notches)	4.02	5.67	0.11	0.14	4.0	9.3	
RD-5 (0.024 ha)	1	Z-105 (3 Notches)	3.30	4.74	0.09	0.13	1.8	4.7	15.5
RD-6 (0.027 ha)	1	Z-105 (3 Notches)	3.30	4.74	0.09	0.13	2.2	5.0	
RD-7 (0.021 ha)	1	Z-105 (1 Notch)	1.26	1.58	0.10	0.13	3.0	7.0	33.9
RD-8 (0.024 ha)	1	Z-105 (1 Notch)	1.26	1.58	0.10	0.13	3.1	7.2	
RD-9 (0.020 ha)	1	Z-105 (1 Notch)	1.26	1.58	0.10	0.13	3.0	7.0	
RD-10 (0.022 ha)	1	Z-105 (1 Notch)	1.26	1.58	0.10	0.13	3.1	7.0	
Total Roof (0.28 ha)	10	-	24.7	33.5	-	-	31.1	73.7	91.3

Refer to **Appendix D** for detailed SWM calculations and to **Appendix F** for roof drain information. As indicated in the table above, the building roof will provide sufficient storage for both the 5-year and 100-year design events.

2.3.3.4 Area A-3 – Controlled Flow from Rear Parking Lot and Display Area

The post-development flow from this sub-catchment area will be attenuated using an ICD installed in the outlet pipe of CBMH 12. Stormwater runoff from this sub-catchment area will be temporarily stored within the grassed areas and on the paved parking lot prior to being discharged into the on-site storm sewer system. The site has been designed to ensure that no ponding will occur on the private paved surfaces (i.e. drive aisles or parking lots) during the 2-year storm event.

Table 3C summarizes the post-development design flow from this sub-catchment area as well as the type of ICD, the anticipated ponding elevations, storage volumes required and storage volume provided for the 2-year, 5-year and the 100-year design events.

Table 3C: Design Flow and Inlet Control Device Table

Design Event	Sub-Catchment Area A-3				
	ICD Type	Design Flow (L/s)	Ponding Elevation (m)	Storage Vol. Required (m³)	Max Storage Provided (m³)
2-Year	Plug type ICD with a 100mm dia. circular orifice	27.6 L/s	94.84 m	12.8 m³	192.7 m³
5-Year		28.1 L/s	94.90 m	22.9 m³	
100-Year		29.1 L/s	95.02 m	69.1 m³	

Refer to **Appendix D** for SWM calculations and to **Appendix E** for ICD information. As indicated in the table above, this sub-catchment area will provide sufficient storage for the 2-year, 5-year and 100-year design events. Furthermore, no stormwater will pond on the paved surfaces (i.e. drive aisles or parking lots) during the 2-year storm event.

Table 3D compares the post-development flows from the proposed Camp Mart site (Areas A-0, A-1, A-2 and A-3) to both the uncontrolled pre-development flows and to the allowable release rate specified by the City of Ottawa, for both the 5-year and the 100-year design events.

Table 3D: Stormwater Flow Comparison Table

Design Event	Drainage Areas A-0, A-1, A-2 and A-3							
	Pre-Development Conditions		Post-Development Conditions					
	Uncontrolled Flow (L/s)	Allowable Release Rate (L/s)	A-0 Flow (L/s)	A-1 Flow (L/s)	A-2 Flow (L/s)	A-3 Flow (L/s)	Total Flow (L/s)	Reduction in Flow (L/s or %) ⁴
5-Yr	115.3	99.5	6.1	23.5	24.7	28.1	82.4	32.9 or 29%
100-Yr	247.0	99.5	12.4	24.1	33.5	29.1	99.1	147.9 or 60%

⁴Reduced flow compared to pre-development uncontrolled conditions

As indicated in the table above, both the 5-year and 100-year post-development flows from the site will be less than the allowable release rate specified by the City of Ottawa. Furthermore, this represents significant reductions in total site flow rate when compared to the respective pre-development conditions. Refer to **Appendix D** for SWM calculations and the 5-year storm sewer design sheet.

2.3.3.5 Stormwater Quality Control

The subject site is located within the jurisdiction of the Mississippi Valley Conservation (MVC) and is tributary to the Carp River. A 'Normal' Level of Protection, equivalent to a long-term average removal of 70% Total Suspended Solids (TSS), with at least 85% of the total rainfall being captured and treated, is required.

To achieve this level of quality control protection, a new oil-grit separator unit (CDS Model PMSU 20_20_5) will be installed downstream of STM MH 1 on the storm sewer outlet pipe from the site. Stormwater runoff collected by the on-site storm sewer system (1.91 ha tributary area)

will be directed through the proposed treatment unit. The contributing area includes the proposed paved parking areas, display areas, landscaped areas as well as the building roof.

As stated above, the proposed oil-grit separator has been sized to provide a 'Normal' Level of water quality treatment prior to discharging the stormwater into the municipal storm sewer and ultimately into the Carp River. Echelon Environmental and Contech Stormwater Solutions Inc. have modeled and analyzed the tributary area to provide a CDS unit capable of meeting the TSS removal requirements. The model parameters for the TSS removal were based on historical rainfall data for Ottawa from the Ontario Climate Centre. It was determined that a CDS Model PMSU 20_20_5 will exceed the target removal rate, providing a net annual 72.0% TSS removal. The CDS unit has a treatment capacity of approximately 31 L/s, a sediment storage capacity of 1.67m³; an oil storage capacity of 376 L and will treat a net annual volume of approximately 90.9% for the tributary area.

The shallow flat grass swales on site will provide additional stormwater quality control by reducing flow velocities and thus promoting infiltration and the removal of suspended solids. The CB and CBMH structures will be equipped with sumps to promote additional settling of sediment. It is expected that the proposed treatment train approach will be used to provide the requisite level of water quality control.

Maintenance and Monitoring of the Storm Sewer and Stormwater Management Systems

It is recommended that the client implement a maintenance and monitoring program for both the on-site storm sewers and the stormwater management systems: The storm drainage system should be inspected routinely (at least annually); the plug type ICDs should be inspected to ensure they are fitted securely and free of debris; and the oil-grit separator should be inspected at regular intervals and maintained when necessary to ensure optimum performance. Refer to **Appendix G** for the CDS unit design parameters, sizing analysis, operation, design, performance and maintenance summary parameters as well as the annual TSS removal efficiency data.

3.0 SITE SERVICING – PRIVATE ACCESS ROAD

Municipal services, including a 450mm dia. sanitary sewer, a 300mm dia. watermain and a 1050mm dia. storm sewer, are located within an existing easement below the proposed access road. Although no new sanitary sewers, watermains or storm sewers are being proposed within the private access road, two (2) new catchbasins are being proposed to capture roadway drainage. The catchbasins will be interconnected and equipped with a vortex type inlet control device (ICD) to attenuate flows, prior to discharging them into the municipal storm sewer.

3.1 Storm Drainage and Stormwater Management

The approach for the stormwater management design of the private access road is discussed in the subsequent sections of the report.

3.1.1 Stormwater Management Criteria and Objectives

The criteria and objectives for the proposed stormwater management design of the private access road are as follows:

- Provide a dual drainage system (i.e. minor and major system flows);
- Maximize the use of surface storage available within the private roadway;
- Control the post-development flows from the private access road to the maximum allowable release rate of 50 L/s/ha for both the 5-year and 100-year design storms, as defined in the 'Terry Fox Business Park – Stormwater Design Plan'¹.
- Provide guidelines to ensure that site preparation and construction is in accordance with the current Best Management Practices for Erosion and Sediment Control.

3.1.2 Pre-Development Conditions and Allowable Release Rate

The uncontrolled pre-development flows for the 0.09 ha private access road were calculated using the Rational Method to be 5.2 L/s during the 5-year design event and 11.2 L/s during the 100-year design event. Refer to **Appendix D** for detailed calculations. There are currently no water quantity or water quality control measures being provided on site.

The allowable release rate for the private access road, as specified in the 'Terry Fox Business Park – Stormwater Design Plan'¹, was calculated to be 4.5 L/s (50 L/s/ha x 0.09 ha).

3.1.3 Post-Development Conditions

Storm drainage from the private access road will be directed into the existing 1050mm dia. storm sewer, which outlets directly to the Carp River, approximately 210m to the west. To mitigate the stormwater related impacts due to the increase in imperviousness, stormwater runoff will be attenuated using an inlet control device (ICD) installed within the outlet pipe of the inter-connected catchbasins within the private roadway. Flows will be attenuated for storms up to and including the 100-year design event.

3.1.3.1 Area A-4 – Controlled Flow from Private Access Road

The post-development flow from this sub-catchment area will be attenuated by installing an ICD within the outlet pipe of CB 1A. Stormwater runoff from this sub-catchment area will be temporarily stored on the paved roadway prior to being discharged into the municipal storm sewer.

Table 4 summarizes the post-development design flow from this sub-catchment area as well as the type of ICD, the anticipated ponding elevations, storage volumes required and storage volume provided for both the 5-year and the 100-year design events.

Table 4: Design Flow and Inlet Control Device Table

Design Event	Sub-Catchment Area A-4				
	ICD Type	Design Flow (L/s)	Ponding Elevation (m)	Storage Vol. Required (m ³)	Max Storage Provided (m ³)
5-Year	Tempest LMF 'Model 60' Vortex ICD	4.3 L/s	94.95 m	8.9 m ³	38.9 m ³
100-Year		4.4 L/s	95.01 m	23.3 m ³	

Refer to **Appendix D** for SWM calculations and to **Appendix E** for ICD information. As indicated in the table above, this sub-catchment area will provide sufficient storage for both the 5-year and 100-year design events.

Table 4A compares the post-development flows from Area A-4 to both the uncontrolled pre-development flows and to the allowable release rate specified by the City of Ottawa, for both the 5-year and the 100-year design events.

Table 4A: Stormwater Flow Comparison Table

Design Event	Drainage Area A-4				
	Pre-Development Conditions		Post-Development Conditions		
	Uncontrolled Flow (L/s)	Allowable Release Rate (L/s)	A-3 Flow (L/s)	Total Flow (L/s)	Reduction in Flow (L/s or %) ⁴
5-Yr	5.2	4.5	4.3	4.3	0.9 or 17%
100-Yr	11.2	4.5	4.4	4.4	6.8 or 61%

⁴Reduced flow compared to pre-development uncontrolled conditions

As indicated in the table above, both the 5-year and 100-year post-development flows from the private access road will be less than the allowable release rate specified by the City of Ottawa. Furthermore, this represents significant reductions in total site flow rate when compared to the respective pre-development conditions. Post-development flows will be reduced by approximately 0.9 L/s (or 17%) during the 5-year event and by as much as 6.8 L/s (or 61%) during the 100-year design event, when compared to current conditions.

4.0 SITE GRADING – CAMP MART DEVELOPMENT

The elevation of the existing site varies from approximately 94.50m up to approximately 96.50m. The existing site generally slopes from east to west towards the Carp River, which is located approximately 210m west of the subject site.

The finished floor elevation (FFE) of the proposed building will be set at an elevation of 95.50m, which corresponds to the FFE of the Home Depot building to the east. The building and general site elevations will work well with the grades along the property lines, the views from Hwy 417 to the north, the existing access road to the east and the private access road off Frank Nighbor Place to the south. The grades along the property line will need to slope down temporarily to match into the existing grades on the vacant parcel to the west. The grade on the adjacent property to the west will be raised in the future once it is developed. Refer to the enclosed Grading and Erosion & Sediment Control Plans for details.

Any excess fill material generated from the proposed site development is to be reviewed by the geotechnical engineer to determine suitability for use as general fill on the adjacent vacant lots. Filling on the adjacent lots is only permitted outside the regulatory floodline as defined by the MVC. Limits of the works are to be established on-site by an OLS.

4.1 Emergency Overland Flow Route

In the case of a major rainfall event exceeding the design storms provided for, the stormwater located within the subject site will overflow towards the lower downstream sub-catchment areas and ultimately flow towards the proposed private access road. The Camp Mart building floor elevation (95.50m) has been set to be a minimum of 0.3m above the major system overflow points. Runoff will ultimately be directed to the Carp River. The emergency overland flow route is shown on the enclosed Grading and Erosion & Sediment Control Plan.

5.0 SITE GRADING – PRIVATE ACCESS ROAD

The private access road will match into the elevations of Frank Nighbor Place and rise approximately 0.5m to work with the entrance of the proposed Camp Mart site. The proposed access road has been designed to work with the elevations of Frank Nighbor Place, the Camp Mart site, as well as future developments to the south and west. The elevation of the private access road, will also slightly increase the cover over the existing municipal services.

The grades adjacent to the private roadway will be maintained until the vacant lots are developed in the future. Refer to the enclosed Grading and Erosion & Sediment Control Plan for details.

5.1 Emergency Overland Flow Route

In the case of a major rainfall event exceeding the design storms provided for, the stormwater located within the eastern portion of the private roadway will overflow towards Frank Nighbor Place. Stormwater within the western portion of the private roadway will overflow and sheet drain towards the Carp River. The emergency overland flow route is shown on the enclosed Grading and Erosion & Sediment Control Plan.

6.0 GEOTECHNICAL INVESTIGATIONS – CAMP MART DEVELOPMENT AND PRIVATE ACCESS ROAD

A Geotechnical Investigation Report has been prepared by Paterson Group for the proposed project. Refer to the Geotechnical Report² for subsurface conditions, construction recommendations and geotechnical inspection requirements.

7.0 EROSION AND SEDIMENT CONTROL – CAMP MART DEVELOPMENT AND PRIVATE ACCESS ROAD

To mitigate erosion and to prevent sediment from entering the storm sewer system, temporary erosion and sediment control measures will be implemented on-site during construction in accordance with the Best Management Practices for Erosion and Sediment Control. This includes the following temporary measures:

- Filter bags will be placed under the grates of nearby catchbasins, manholes and will remain in place until vegetation has been established and construction is completed.
- Silt fencing will be placed per OPSS 577 and OPSD 219.110 along the surrounding construction limits;
- Mud mats will be installed at the site entrances.

- Street sweeping and cleaning will be performed, as required, to suppress dust and to provide safe and clean roadways adjacent to the construction site.
- On-site dewatering is to be directed to a sediment trap and/or gravel splash pad and discharged safely to an approved outlet as directed by the engineer.

The temporary erosion and sediment control measures will be implemented prior to construction and will remain in place during all phases of construction. Regular inspection and maintenance of the erosion control measures will be undertaken.

In addition, the following measures will provide permanent erosion and sediment control on the proposed **Camp Mart** site:

- Shallow flat-bottom grass drainage swales along the north and east property lines as well as within the curbed island in the main parking lot;
- A CDS type Oil/Grit Separator will be installed to provide water quality control prior to releasing stormwater from sub-catchment areas A-1, A-2 and A-3.

8.0 CONCLUSION – CAMP MART AND PRIVATE ACCESS ROAD

This report has been prepared in support of site plan control applications for the proposed **Camp Mart** development and associated **Private Access Road** located at 20 & 30 Frank Nighbor Place.

The conclusions specific to the **Camp Mart** development are as follows:

- The proposed building will be serviced by the municipal watermain, sanitary and storm sewers in the existing easement running along Frank Nighbor Place.
- The building will be sprinklered and supplied with a fire department siamese connection. The siamese connection will be located within 45m of the proposed on-site fire hydrant.
- A total of ten (10) Zurn Control-Flo roof drains will control post-development flows from sub-catchment area A-2 (the proposed building roof).
- The site flows from sub-catchment areas A-1 and A-3 will be controlled by ICDs installed within the outlet pipes of CBMH 1 and CBMH 12 respectively.
- The total post-development site flow (from Areas A-0, A-1, A-2 and A-3) will be approximately 82.4 L/s during the 5-year design event and 99.1 L/s during the 100-year event, both less than the allowable release rate of 99.5 L/s. Post-development flows are being reduced by 32.9 L/s (or 29%) during the 5-year event and by as much as 147.9 L/s (or 60%) during the 100-year design event, when compared to current conditions.
- An oil / grit separator unit (CDS Model PMSU 20_20_5) will provide a 'Normal' Level of water quality control for the portion of the site discharging to the 1050mm dia. municipal storm sewer.
- Regular inspection and maintenance of the storm sewer system, including the ICDs, CDS treatment unit and controlled flow roof drains is recommended to ensure that the storm drainage system is clean and operational.
- Erosion and sediment controls are to be provided both during construction and on a permanent basis.

The conclusions specific to the **Private Access Road** are as follows:

- The site flows from sub-catchment area A-4 will be controlled by a single Tempest LMF 'Model 60' Vortex ICD installed in the outlet pipe from CB 1A.
- The total post-development site flow (from Area A-4) will be approximately 4.3 L/s during the 5-year design event and 4.4 L/s during the 100-year event, both less than the allowable release rate of 4.5 L/s. Post-development flows are being reduced by 0.9 L/s (or 17%) during the 5-year event and by as much as 6.8 L/s (or 61%) during the 100-year design event, when compared to current conditions.
- Regular inspection and maintenance of the storm sewer system, including the ICD and roadway catchbasins is recommended to ensure that the storm drainage system is clean and operational.
- Erosion and sediment controls are to be provided both during construction and on a permanent basis.

It is recommended that the proposed site servicing and stormwater management design for both the **Camp Mart** development and **Private Access Road** be approved for implementation.


NOVATECH

Prepared by:



Stephen Matthews, B.A. (Env.)
Senior Design Technologist

Reviewed by:

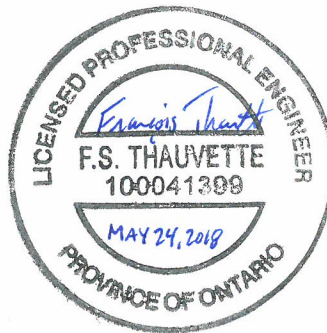

François Thauvette, P. Eng.
Senior Project Manager
Land Development & Public-Sector Engineering

APPENDIX A
Correspondence

20 Frank Nighbor Place Pre-Consultation Meeting Minutes

Date: Wednesday August 2, 2017, 2:30pm to 4:00pm

Location: Room 3107E City Hall

Attendance:

Stream Shen (Planner, City of Ottawa)
Tim Newton on behalf of Mark Fraser (Project Manager, City of Ottawa)
Rosanna Baggs (Transportation Project Manager, City of Ottawa)
Riley Carter (Transportation Project Manager, City of Ottawa)
Seana Turkington (Planning Student, City of Ottawa)
Greg Winters (Project Manager, Novatech)
Jennifer Luong (Transportation Engineer, Novatech)
John Riddell (Novatech)
Robert Matthews (Architect, N45 Architect)
Cal Kirkpatrick (Owner, Colonnade BridgePort)
Sunny Bains (Purchaser, Camp Mart)
Jim Rose (Purchaser, Camp Mart)

Overview from Applicant:

1. The applicant is looking to subdivide 20 Frank Nighbor into 4 parcels through a part lot control application.
2. A private street will be developed for access to the 2 westerly parcels. There will be a joint-use and maintenance and easement agreements between the 4 proposed parcels for the private street.
3. Camp Mart is looking to purchase the 2 future parcels to the east and Colonnade is to retain the 2 future parcels to the west.
4. Camp Mart is looking to develop a RV dealership on the easterly parcel fronting Highway 417 and proposes an automobile storage yard on the other parcel to the south.
5. Camp Mart sales travel trailers not motor homes. If a client needs a truck as well, Camp Mart also sells them as combo purchase.
6. A future hotel may be located on the parcel proposed for automobile storage yard.
7. It is the opinion of the applicant that the tri-party OMB decision governing roadway modification and cost sharing no longer applies.

8. Servicing will be located under the proposed private road. No high level concerns.
9. There may be cut and fill arrangement to be made between the 4 future parcels which will require conservation authority approval.

Comments from City Staff:

Planning

10. The project will be subject to a Site Plan Control application, manager approval, with public consultation. Application form, timeline and fee can be found here: <http://ottawa.ca/en/city-hall/planning-and-development/how-develop-property/development-application-review-process-2-1#site-plan-control>
11. A lifting of holding by-law application is also required, information can be found here: <http://ottawa.ca/en/city-hall/planning-and-development/how-develop-property/development-application-review-process-2-1#lifting-holding-law>
12. When preparing plans and studies, please review and conform to the basic plans and studies requirements outlined here: <http://ottawa.ca/en/city-hall/planning-and-development/how-develop-property/development-application-review-process-2-3>
13. The proposed RV dealership is a permitted use under the zoning by-law. However, note that the sales of supply and servicing of vehicle must be clearly accessory and smaller in scale to the principle use of RV sales. The two should not function as a stand-alone entity as they are currently either not permitted (servicing) or not permitted adjacent to Highway 417 (supply retail store). Both need to meet the definition below.

*Accessory means aiding or contributing in a secondary way to a principal use to carry out its function, and having regard to this definition: an **accessory use** is a land **use** that is **accessory** to a **principal use**.*
14. Storage yard for vehicles is currently not permitted under the zoning. A major zoning by-law amendment would be required to add it as a permitted use. Provision from exception 1414 also requires that all storage must be concealed or enclosed. Further rationale is needed on the appropriateness of the amendment.
15. Further information on Zoning By-law Amendment can be found here: <http://ottawa.ca/en/city-hall/planning-and-development/how-develop-property/development-application-review-process-2-1#zoning-law-amendment>
16. The part-lot control application to subdivide the land requires the four parcels to be considered one-lot for zoning purpose. Please provide rationale as part of the submission package on how the four parcels will meet zoning by-law section 93. If it does not meet the definition, the new extension and cul-de-sac will need to be developed to city standard and conveyed to the city as a public street in order to meet the frontage requirement under zoning by-law section 59.

17. Further information for Lifting of Part-lot control application can be found here:
<http://ottawa.ca/en/city-hall/planning-and-development/how-develop-property/development-application-review-process-2-1#lifting-part-lot-control>
18. Hotel is a permitted use, but will be subject to a new pre-consultation and set of required list of plans and studies to assess the impact and to address planning, engineering and transportation concerns if the applicant wishes to develop it in the future.
19. The property is located along the scenic route entrance to Ottawa, please ensure that the proposal has a high level of urban design and landscaping along Highway 417.
20. Please increase the amount of landscaping within the site. Please break up the parking area into smaller groupings using landscaped islands.
21. Please create a direct pedestrian connection from the entrance to the front door of the building.
22. Please illustrate how loading will be accommodated within the site and to the building.
23. Please identify and provide a description of all easements on-site at the time of submission.
24. A building, land use and sign permit from MTO will be required.
25. The application will be subject to MOECC approval post site plan approval.
26. As you are aware a contribution to the Carp River Restoration Project (CRRP) is required based on the subject lands abutting and benefitting from the CRRP. Please contact Debbie Belfie, Project Manager for KWOOG to confirm the amount of this contribution. The City will be collecting said payment as a condition of site plan approval.
27. Staff reserve the right to further comments at the time of submission. As the pre-consultation meeting is high level and not all detailed plans were available.
28. Please consult with Ward Councillor once the design is finalized.
29. The pre-consultation meeting comments and list of required plans and studies is valid for one year and will lapse on August 2, 2018.

Transportation

1. Please provide a transportation impact study for the area up to and including the Palladium and Silver Seven intersection.

Engineering

1. Given that the private street is aligning with the sewer easement, how will access be maintained to the 2 back parcels if repair is required? Consider increasing the right-of-way width.

Environmental

30. An Environmental Impact Statement is required. The EIS should refer to the findings of the Kanata West Owners Group's EIS which was completed by Kilgour (2014). It should also investigate potential habitat for other threatened and endangered species on the remainder of the property. The EIS should also address the watercourse setback policies (OP Section 4.7.3) because this stretch of Carp River has been identified as having unstable slopes and floodplain. The EIS should also refer to the findings and recommendations of the Carp River Watershed Subwatershed Study (2004).
31. Further details on the EIS requirements can be found in OP Section 4.7.8 and the EIS Guidelines:http://documents.ottawa.ca/sites/documents.ottawa.ca/files/documents/eis_guidelines2015_en.pdf
32. Please also contact the Ministry of Natural Resource and Forestry to determine any obligations under the Endangered Species Act and to identify which species to include in the study.
33. Please also contact the local Conservation Authority to determine if any permits or approvals are required under their regulations.

Please contact me at stream.shen@ottawa.ca or at 613-580-2424 ext. 24488 if you have any questions.

Sincerely,

A handwritten signature in black ink, appearing to read "Stream Shen".

Stream Shen MCIP RPP
Planner II
Development Review - West

APPLICANT'S STUDY AND PLAN IDENTIFICATION LIST

Legend: **S** indicates that the study or plan is required with application submission.

A indicates that the study or plan may be required to satisfy a condition of approval/draft approval.

For information and guidance on preparing required studies and plans refer to:

<http://ottawa.ca/en/development-application-review-process-0/guide-preparing-studies-and-plans>

S/A	Number of copies	ENGINEERING		S/A	Number of copies
S	15	1. Site Servicing Plan	2. Assessment of Adequacy of Public Services / Site Servicing Study / Brief	S	7
S	15	3. Grade Control and Drainage Plan	4. Geotechnical Study / Slope Stability Study	S	3
	2	5. Composite Utility Plan	6. Groundwater Impact Study		6
	5	7. Servicing Options Report	8. Wellhead Protection Study		6
S	9	9. Community Transportation Study and / or Transportation Impact Study / Brief	10. Erosion and Sediment Control Plan / Brief		6
S	6	11. Storm water Management Report / Brief	12. Hydro geological and Terrain Analysis		8
S	4	13. Hydraulic Water main Analysis	14. Noise / Vibration Study		3
A	15	15. Roadway Modification Design Plan	16. Confederation Line Proximity Study		9

S/A	Number of copies	PLANNING / DESIGN / SURVEY		S/A	Number of copies
	50	17. Draft Plan of Subdivision	18. Plan Showing Layout of Parking Garage		2
	30	19. Draft Plan of Condominium	20. Planning Rationale	S	3
S	15	21. Site Plan	22. Minimum Distance Separation (MDS)		3
	20	23. Concept Plan Showing Proposed Land Uses and Landscaping	24. Agrology and Soil Capability Study		5
	3	25. Concept Plan Showing Ultimate Use of Land	26. Cultural Heritage Impact Statement		3
S	15	27. Landscape Plan	28. Archaeological Resource Assessment Requirements: S (site plan) A (subdivision, condo)	S	3
S	2	29. Survey Plan	30. Shadow Analysis		3
S	3	31. Architectural Building Elevation Drawings (dimensioned)	32. Design Brief (includes the Design Review Panel Submission Requirements)		Available online
	6	33. Wind Analysis			

S/A	Number of copies	ENVIRONMENTAL		S/A	Number of copies
S	3	34. Phase 1 Environmental Site Assessment	35. Impact Assessment of Adjacent Waste Disposal/Former Landfill Site		6
A	3	36. Phase 2 Environmental Site Assessment (depends on the outcome of Phase 1)	37. Assessment of Landform Features		7
	4	38. Record of Site Condition	39. Mineral Resource Impact Assessment		4
	10	40. Tree Conservation Report	41. Environmental Impact Statement / Impact Assessment of Endangered Species	S	3
	4	42. Mine Hazard Study / Abandoned Pit or Quarry Study	43. Integrated Environmental Review (Draft, as part of Planning Rationale)		3

S/A	Number of copies	ADDITIONAL REQUIREMENTS		S/A	Number of copies
		44.	45.		

Meeting Date: 2017-Aug-02

Application Type: *Site Plan Control*

File Lead (Assigned Planner): Stream Shen

Infrastructure Approvals Project Manager: Mark Fraser

Site Address (Municipal Address): 20 Frank Nighbor

*Preliminary Assessment: 1 ☒ 2 ☐ 3 ☐ 4 ☐ 5 ☐

*One (1) indicates that considerable major revisions are required before a planning application is submitted, while five (5) suggests that proposal appears to meet the City's key land use policies and guidelines. **This assessment is purely advisory and does not consider technical aspects of the proposal or in any way guarantee application approval.**

It is important to note that the need for additional studies and plans may result during application review. If following the submission of your application, it is determined that material that is not identified in this checklist is required to achieve complete application status, in accordance with the Planning Act and Official Plan requirements, the Planning, Infrastructure and Economic Development Department will notify you of outstanding material required within the required 30 day period. Mandatory pre-application consultation will not shorten the City's standard processing timelines, or guarantee that an application will be approved. It is intended to help educate and inform the applicant about submission requirements as well as municipal processes, policies, and key issues in advance of submitting a formal

Francois Thauvette

From: Niall Oddie <NOddie@mvc.on.ca>
Sent: Wednesday, January 31, 2018 1:26 PM
To: Francois Thauvette
Cc: Nader Nakhaei
Subject: RE: MCV Pre-Consultation - Trailer Sales Site (20 Frank Nighbor Place)

Hi Francois,

Yes, the stormwater quality target for the Carp River is 'Normal' level of protection.

Regards

Niall Oddie MCIP, RPP | Environmental Planner | Mississippi Valley Conservation Authority
10970 Highway 7, Carleton Place, Ontario K7C 3P1
www.mvc.on.ca | t. 613 253 0006 ext. 229 | f. 613 253 0122 | noddie@mvc.on.ca



This e-mail originates from the Mississippi Valley Conservation Authority e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. If you are not the intended recipient, please notify me at the telephone number shown above or by return e-mail and delete this communication and any copy immediately. Thank you.

From: Francois Thauvette [mailto:f.thauvette@novatech-eng.com]
Sent: Wednesday, January 31, 2018 10:16 AM
To: Niall Oddie <NOddie@mvc.on.ca>
Subject: MCV Pre-Consultation - Trailer Sales Site (20 Frank Nighbor Place)

Hi Niall,


As discussed, we are working on the SWM design for a proposed Camp Mart (trailer sales) site at 20 Frank Nighbor Place in the City of Ottawa. The site is located immediately south of Hwy 417, between the Home Depot and the Carp River. Attached is a preliminary sketch of the site and overall area.

Please confirm if the stormwater quality target for the Carp River is a 'Normal' Level of Protection (i.e. 70% TSS removal). We need this information to size the proposed water quality treatment unit and to finalize our design.

We would also like to use this as a record of our pre-consultation with the MVC. Please let us know if you require anything else from us at this time.

Regards,

François Thauvette, P. Eng., Senior Project Manager | Land Development & Public Sector Engineering
NOVATECH Engineers, Planners & Landscape Architects

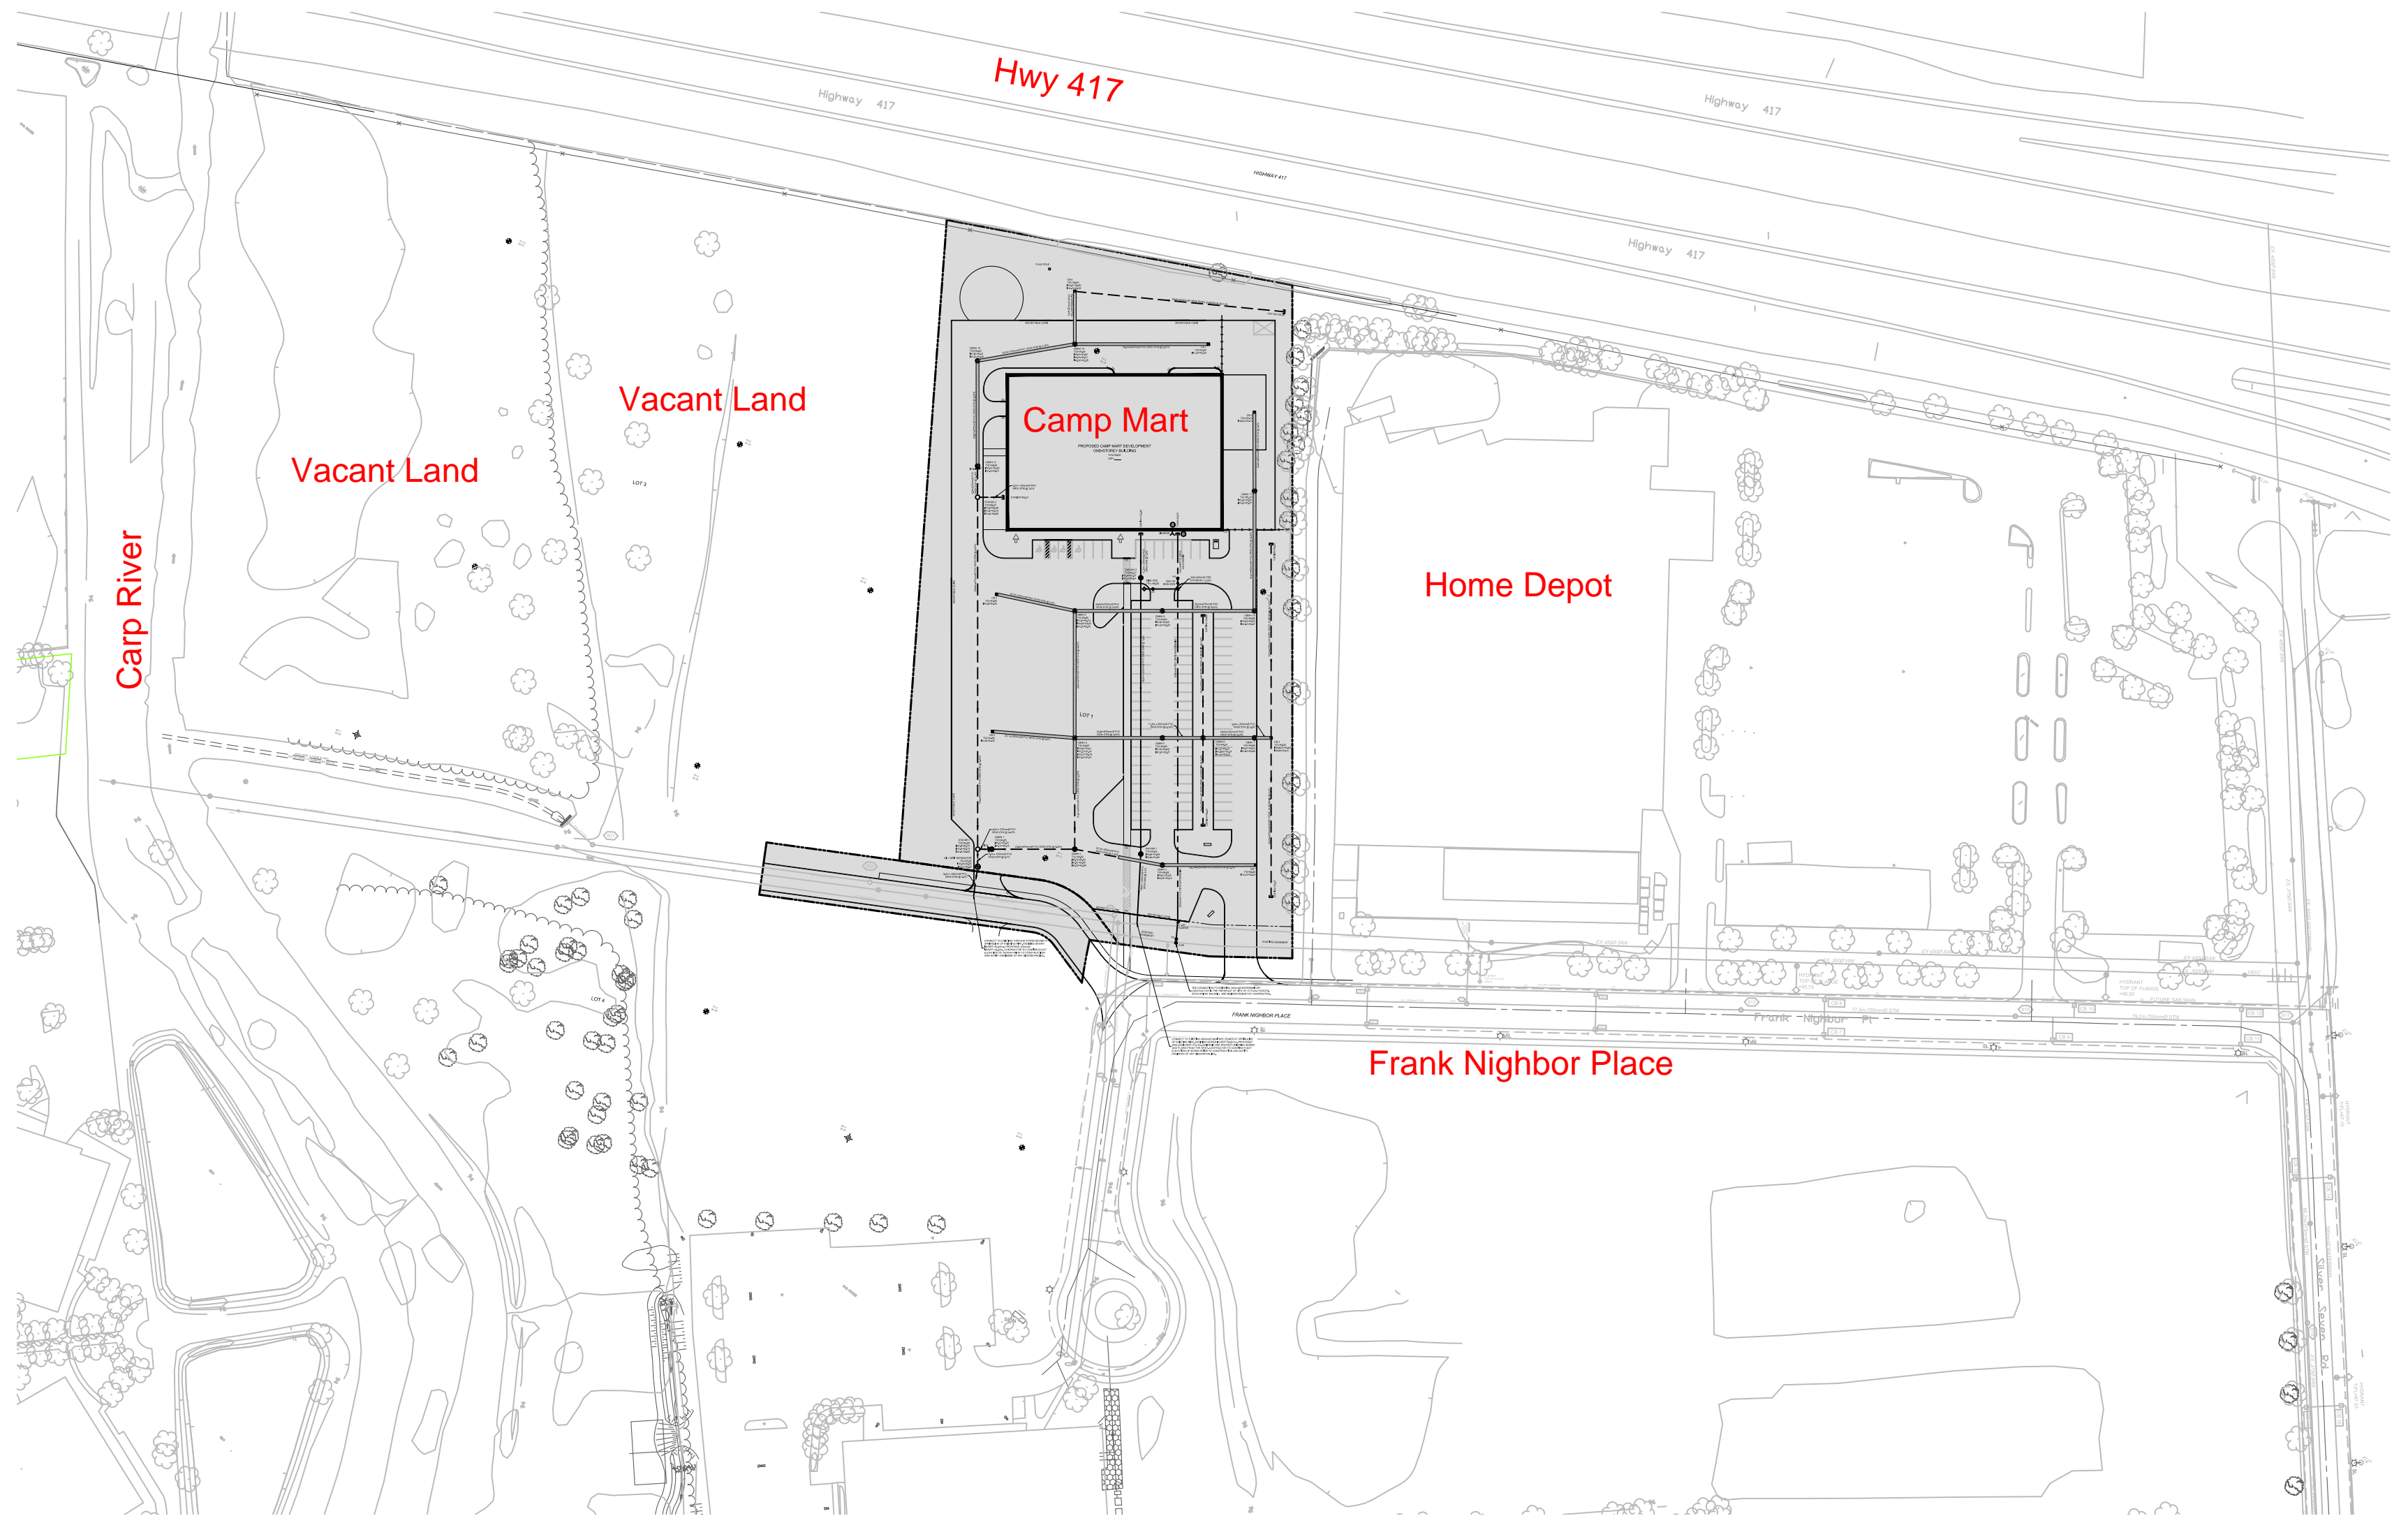

Francois Thauvette

From: Francois Thauvette
Sent: Wednesday, January 31, 2018 2:50 PM
To: 'Fraser, Mark'
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request & MOECC Pre-Consultation

Hi Mark,

We agree with the e-mail below and will complete the MOECC 'Pre-Submission Consultation Request Form' and submit it to the e-mail address specified below.

Regards,

François Thauvette, P. Eng., Senior Project Manager | Land Development & Public Sector Engineering

NOVATECH Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 219 | Cell: 613.276.0310 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

From: Fraser, Mark [mailto:Mark.Fraser@ottawa.ca]
Sent: Wednesday, January 31, 2018 1:17 PM
To: Francois Thauvette <f.thauvette@novatech-eng.com>
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request & MOECC Pre-Consultation

Hi Francois,

Please accept this email as confirmation that the City is in agreement with the below opinion that this project will be subject to an Environmental Compliance Approval (ECA) for Sewage Works under Section 53 of the Ontario Water Resources Act as the approval exemptions set out under Ontario Regulation 525/98: *Approval Exemptions* are not satisfied.

O. Reg. 525/98: Approval Exemptions under the OWRA

3. Subsections 53 (1) and (3) of the Act do not apply to the use, operation, establishment, alteration, extension or replacement of or a change in a storm water management facility that,

(a) is designed to service one lot or parcel of land;

(b) discharges into a storm sewer that is not a combined sewer;

(c) does not service industrial land or a structure located on industrial land; and

(d) is not located on industrial land.

"Industrial Land" means land used for the production, processing, repair, maintenance or storage of goods or materials, or the processing, storage, transfer or disposal of waste, but does not include land used primarily for the purpose of buying or selling,

(a) goods or materials other than fuel, or

(b) services other than vehicle repair services;

The City is in agreement that the type of application required is a **Direct Submission for Industrial Sewage Works** and not Transfer of Review under Additional Works eligible as the works receive drainage from "Industrial Land", where industrial land is defined by *Ontario Regulation 525/98*, and the works are private.

Please confirm you are in agreement with the above. Once concurrence has been provided you can proceed with the required pre-submission consultation with the local Ministry District Office in order to obtain clearance to proceed with the project under Direct Submission. Please note to request a pre-submission consultation with the Ministry the *Pre-Submission Consultation Request Form* is required to be completed and sent to the email MOECCOttawaSewage@ontario.ca.

Please note that the NEW Environmental Compliance Approval Application Form is required to be completed:
<http://www.forms.ssb.gov.on.ca/mbs/ssb/forms/ssbforms.nsf/FormDetail?OpenForm&ACT=RDR&TAB=PROFILE&SRCH=&ENV=WWE&TIT=environmental+compliance+approval&NO=012-8551E>

If you have any questions or require any clarification please let me know.

Regards,

Mark Fraser

Project Manager, Planning Services
Development Review West Branch
City of Ottawa | Ville d'Ottawa
Planning, Infrastructure and Economic Development Department
110 Laurier Avenue West, 4th Floor, Ottawa ON, K1P 1J1
[Tel:613.580.2424](tel:613.580.2424) ext. 27791
Fax: 613-580-2576
Mail: Code 01-14
Email: Mark.Fraser@ottawa.ca

**Please consider your environmental responsibility before printing this e-mail*

This message, including any document or file attached, is intended only for the addressee and may contain privileged and/or confidential information. Any person is strictly prohibited from reading, using, disclosing or copying this message. If you received this message in error, please notify the sender and delete the message. Thank you.

From: Francois Thauvette [<mailto:f.thauvette@novatech-eng.com>]
Sent: January 31, 2018 11:47 AM
To: Fraser, Mark <Mark.Fraser@ottawa.ca>
Cc: Newton, Tim <Tim.Newton@ottawa.ca>
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request & MOECC Pre-Consultation

Hi Mark,

I am following up to see if the Camp Mart water demands have been sent off to the City's Water Division? We require the watermain boundary conditions as soon as possible to complete our design, which includes a hydraulic network analysis (required as part of the SPA submission).

We are also in the process of completing the new MOECC 'Pre-Submission Consultation Request Form' for the proposed Camp Mart development and it is our understanding that the City must confirm the applicable ECA process. Given the nature of the proposed commercial/light industrial development (i.e. trailer sales and service site), we believe the site will require an ECA (Direct submission). Please review and confirm if the City agrees with this assessment.

Regards,

François Thauvette, P. Eng., Senior Project Manager | Land Development & Public Sector Engineering
NOVATECH Engineers, Planners & Landscape Architects
240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 219 | Cell: 613.276.0310 | Fax: 613.254.5867
The information contained in this email message is confidential and is for exclusive use of the addressee.

From: Francois Thauvette
Sent: Tuesday, January 30, 2018 8:34 AM
To: 'Fraser, Mark' <Mark.Fraser@ottawa.ca>
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request

Hi Mark,

APPENDIX B

Development Servicing Study Checklist

4. Development Servicing Study Checklist

The following section describes the checklist of the required content of servicing studies. It is expected that the proponent will address each one of the following items for the study to be deemed complete and ready for review by City of Ottawa Infrastructure Approvals staff.

The level of required detail in the Servicing Study will increase depending on the type of application. For example, for Official Plan amendments and re-zoning applications, the main issues will be to determine the capacity requirements for the proposed change in land use and confirm this against the existing capacity constraint, and to define the solutions, phasing of works and the financing of works to address the capacity constraint. For subdivisions and site plans, the above will be required with additional detailed information supporting the servicing within the development boundary.

4.1 General Content

- N/A ☐ Executive Summary (for larger reports only).
- ☒ Date and revision number of the report.
- ☒ Location map and plan showing municipal address, boundary, and layout of proposed development.
- ☒ Plan showing the site and location of all existing services.
- ☒ Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.
- ☒ Summary of Pre-consultation Meetings with City and other approval agencies.
- ☒ Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.
- ☒ Statement of objectives and servicing criteria.
- ☒ Identification of existing and proposed infrastructure available in the immediate area.
- ☒ Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).

- ☒ Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.
- N/A ☐ Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.
- N/A ☐ Proposed phasing of the development, if applicable.
- ☒ Reference to geotechnical studies and recommendations concerning servicing.
- ☒ All preliminary and formal site plan submissions should have the following information:
- Metric scale
 - North arrow (including construction North)
 - Key plan
 - Name and contact information of applicant and property owner
 - Property limits including bearings and dimensions
 - Existing and proposed structures and parking areas
 - Easements, road widening and rights-of-way
 - Adjacent street names

4.2 Development Servicing Report: Water

- N/A ☐ Confirm consistency with Master Servicing Study, if available
- ☒ Availability of public infrastructure to service proposed development
- ☒ Identification of system constraints
- ☒ Identify boundary conditions
- ☒ Confirmation of adequate domestic supply and pressure
- ☒ Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.
- ☒ Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.
- N/A ☐ Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design
- ☒ Address reliability requirements such as appropriate location of shut-off valves
- N/A ☐ Check on the necessity of a pressure zone boundary modification.

- ☒ Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range
- ☒ Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.
- N/A ☐ Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.
- ☒ Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.
- ☒ Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.

4.3 Development Servicing Report: Wastewater

- ☒ Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).
- N/A ☐ Confirm consistency with Master Servicing Study and/or justifications for deviations.
- ☒ Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.
- ☒ Description of existing sanitary sewer available for discharge of wastewater from proposed development.
- ☒ Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)
- N/A ☐ Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.
- N/A ☐ Description of proposed sewer network including sewers, pumping stations, and forcemains.

- N/A ☐ Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).
- N/A ☐ Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.
- N/A ☐ Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.
- N/A ☐ Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.
- ☒ Special considerations such as contamination, corrosive environment etc.

4.4 Development Servicing Report: Stormwater Checklist

- ☒ Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)
- ☒ Analysis of available capacity in existing public infrastructure.
- ☒ A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.
- ☒ Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.
- ☒ Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.
- ☒ Description of the stormwater management concept with facility locations and descriptions with references and supporting information.
- N/A ☐ Set-back from private sewage disposal systems.
- N/A ☐ Watercourse and hazard lands setbacks.
- ☒ Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.
- ☒ Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.

- ☒ Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).
- N/A ☐ Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.
- ☒ Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.
- N/A ☐ Any proposed diversion of drainage catchment areas from one outlet to another.
- ☒ Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.
- N/A ☐ If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.
- N/A ☐ Identification of potential impacts to receiving watercourses
- N/A ☐ Identification of municipal drains and related approval requirements.
- ☒ Descriptions of how the conveyance and storage capacity will be achieved for the development.
- ☒ 100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.
- N/A ☐ Inclusion of hydraulic analysis including hydraulic grade line elevations.
- ☒ Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.
- N/A ☐ Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.
- N/A ☐ Identification of fill constraints related to floodplain and geotechnical investigation.

4.5 Approval and Permit Requirements: Checklist

The Servicing Study shall provide a list of applicable permits and regulatory approvals necessary for the proposed development as well as the relevant issues affecting each approval. The approval and permitting shall include but not be limited to the following:

- NOTED ☐ Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.
- ☒ Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.
- N/A ☐ Changes to Municipal Drains.
- N/A ☐ Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)

4.6 Conclusion Checklist

- ☒ Clearly stated conclusions and recommendations
- TBD ☐ Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.
- ☒ All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario

APPENDIX C

Water Demands, Boundary Conditions, Schematic of the Hydraulic Model, Hydraulic Modeling Results and FUS Calculations

Francois Thauvette

From: Fraser, Mark <Mark.Fraser@ottawa.ca>
Sent: Friday, February 2, 2018 4:06 PM
To: Francois Thauvette
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request & MOECC Pre-Consultation
Attachments: 20 Frank Nighbor Place.docx; 20FrankNighbor-Lot1-WaterConnection.pdf; FUSv1-4.pdf; DSS&SWM_Excerpt-WaterDemandCalcs.pdf

Hi Francois,

Please find below boundary conditions for hydraulic analysis as requested based on the provided anticipated water demands:

Proposed Water Demands and Fire Flow Requirement:

Proposed Development Location: **20 Frank Nighbor**

Average Daily Demand = 0.27 L/s

Max Daily Demand = 2.46 L/s

Peak Hour Demand = 3.71 L/s

Fire Flow = 117 L/s

City of Ottawa Boundary Conditions:

The following are boundary conditions for hydraulic analysis (Pressure Zone 3W) at the specified connection point:

Specified Connection Point: Frank Nighbor (300mm dia.) [Connection 1]

Max HGL = 162.3m (95.9 psi)

PKHR = 157.6m (89.2 psi)

MXDY+FireFlow (7000 L/min.) = 158.6m (90.7 psi)

These are for current conditions and are based on computer model simulation.



Please refer to City of Ottawa, *Ottawa Design Guidelines – Water Distribution*, First Edition, July 2010, WDG001 Clause 4.2.2 for watermain pressure and demand objectives.

Please include an electronic version of the modeling file.

Disclaimer: *The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermain deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.*

Please note that the proposed water demands and identified connection point have not been reviewed and are subject to comment and revision upon submission and review of a development application.

If you have any questions or require any clarification please let me know.

Regards,

Mark Fraser

Project Manager, Planning Services
Development Review West Branch
City of Ottawa | Ville d'Ottawa
Planning, Infrastructure and Economic Development Department
110 Laurier Avenue West. 4th Floor, Ottawa ON, K1P 1J1
[Tel:613.580.2424](tel:613.580.2424) ext. 27791
Fax: 613-580-2576
Mail: Code 01-14
Email: Mark.Fraser@ottawa.ca

**Please consider your environmental responsibility before printing this e-mail*

This message, including any document or file attached, is intended only for the addressee and may contain privileged and /or confidential information. Any person is strictly prohibited from reading, using, disclosing or copying this message. If you received this message in error, please notify the sender and delete the message. Thank you.

From: Fraser, Mark
Sent: January 31, 2018 11:56 AM
To: 'Francois Thauvette' <f.thauvette@novatech-eng.com>
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request & MOECC Pre-Consultation

Hi Francois,

Please accept this email as confirmation that boundary conditions for hydraulic analysis have been requested from Infrastructure Planning based on the water demands provided for the subject development. Please note that it takes approximately 5-10 business days to receive and provide you with boundary conditions.

I will review and issue an email regarding this development being considered for an approval by the MOECC.

Regards,

Mark Fraser

Project Manager, Planning Services
Development Review West Branch
City of Ottawa | Ville d'Ottawa
Planning, Infrastructure and Economic Development Department
110 Laurier Avenue West. 4th Floor, Ottawa ON, K1P 1J1
[Tel:613.580.2424](tel:613.580.2424) ext. 27791
Fax: 613-580-2576
Mail: Code 01-14
Email: Mark.Fraser@ottawa.ca

**Please consider your environmental responsibility before printing this e-mail*

This message, including any document or file attached, is intended only for the addressee and may contain privileged and /or confidential information. Any person is strictly prohibited from reading, using, disclosing or copying this message. If you received this message in error, please notify the sender and delete the message. Thank you.

From: Francois Thauvette [<mailto:f.thauvette@novatech-eng.com>]
Sent: January 31, 2018 11:47 AM
To: Fraser, Mark <Mark.Fraser@ottawa.ca>
Cc: Newton, Tim <Tim.Newton@ottawa.ca>
Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request & MOECC Pre-Consultation

Hi Mark,

I am following up to see if the Camp Mart water demands have been sent off to the City's Water Division? We require the watermain boundary conditions as soon as possible to complete our design, which includes a hydraulic network analysis (required as part of the SPA submission).

We are also in the process of completing the new MOECC 'Pre-Submission Consultation Request Form' for the proposed Camp Mart development and it is our understanding that the City must confirm the applicable ECA process. Given the nature of the proposed commercial/light industrial development (i.e. trailer sales and service site), we believe the site will require an ECA (Direct submission). Please review and confirm if the City agrees with this assessment.

Regards,

François Thauvette, P. Eng., Senior Project Manager | Land Development & Public Sector Engineering

NOVATECH Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 219 | Cell: 613.276.0310 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

From: Francois Thauvette

Sent: Tuesday, January 30, 2018 8:34 AM

To: 'Fraser, Mark' <Mark.Fraser@ottawa.ca>

Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request

Hi Mark,

As requested, please find attached a sketch showing the proposed Camp Mart water service (highlighted in 'blue') and the connection point to the existing municipal watermain (shown within the 'red' revision cloud).

Regards,

François Thauvette, P. Eng., Senior Project Manager | Land Development & Public Sector Engineering

NOVATECH Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 219 | Cell: 613.276.0310 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

From: Fraser, Mark [<mailto:Mark.Fraser@ottawa.ca>]

Sent: Monday, January 29, 2018 3:28 PM

To: Francois Thauvette <f.thauvette@novatech-eng.com>

Subject: RE: 20 Frank Nighbor Place - Watermain Boundary Conditions Request

Hi Francois,

Please provide a drawing/sketch identifying the proposed connection point location.

Regards,

Mark Fraser

Project Manager, Planning Services

Development Review West Branch

City of Ottawa | Ville d'Ottawa

Planning, Infrastructure and Economic Development Department

110 Laurier Avenue West, 4th Floor, Ottawa ON, K1P 1J1

[Tel:613.580.2424](tel:613.580.2424) ext. 27791

Fax: 613-580-2576

Mail: Code 01-14

Email: Mark.Fraser@ottawa.ca

*Please consider your environmental responsibility before printing this e-mail

From: Francois Thauvette [<mailto:f.thauvette@novatech-eng.com>]
Sent: January 29, 2018 2:55 PM
To: Newton, Tim <Tim.Newton@ottawa.ca>
Cc: Fraser, Mark <Mark.Fraser@ottawa.ca>
Subject: 20 Frank Nighbor Place - Watermain Boundary Conditions Request

Hi Tim,

I am sending this e-mail to request the municipal WM boundary conditions for the existing 300mm dia. watermain in the easement (running along Frank Nighbor Place, south of the subject site). Based on preliminary calculations, using the City of Ottawa and MOE design guidelines for drinking water systems, the water demands for the proposed trailer sales site are as follows:

- Average Day Demand = 0.27 L/s (see attached excerpt from the DSS&SWM report)
- Max Day Demand = 2.46 L/s (Avg. Demand x 9.1, per MOE Table 3.3)
- Peak Hour Demand = 3.71 L/s (Avg. Demand x 13.7, per MOE Table 3.3)
- Fire Flow = 117 L/s (based on FUS calculations for a sprinklered building with non-combustible construction). Refer to the attached FUS calculations sheet.

Please review and provide municipal watermain boundary conditions.

Regards,

François Thauvette, P. Eng., Senior Project Manager | Land Development & Public Sector Engineering

NOVATECH Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 219 | Cell: 613.276.0310 | Fax: 613.254.5867

The information contained in this email message is confidential and is for exclusive use of the addressee.

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

,

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

FUS - Fire Flow Calculations

As per 1999 Fire Underwriter's Survey Guidelines



Engineers, Planners & Landscape Architects

Novatech Project #: 117193

Project Name: Camp Mart

Date: 24/01/2018

Input By: S. Matthews

Reviewed By: F. Thauvette

Legend

Input by User

No Information or Input Required


Building Description: RV Sales and Servicing, 1 Storey Building

Non-combustible construction

Step			Input	Multiplier Options	Value Used	Total Fire Flow (L/min)
Base Fire Flow						
1	Construction Material					
	Coefficient related to type of construction C	Wood frame		1.5	0.8	
		Ordinary construction		1		
		Non-combustible construction	Yes	0.8		
		Fire resistive construction (< 3 hrs)		0.7		
		Fire resistive construction (> 3 hrs)		0.6		
2	Floor Area					
	A	Building Footprint (m ²)	2685			
		Number of Floors/Storeys	1			
		Area of structure considered (m ²)	2,685			
	F	Base fire flow without reductions				9,000
		F = 220 C (A)^{0.5}				
Reductions or Surcharges						
3	Occupancy hazard reduction or surcharge					
	(1)	Non-combustible		-25%	0%	9,000
		Limited combustible		-15%		
		Combustible	Yes	0%		
		Free burning		15%		
		Rapid burning		25%		
4	Sprinkler Reduction					
	(2)	Adequately Designed System (NFPA 13)	Yes	-30%	-30%	-3,600
		Standard Water Supply	Yes	-10%	-10%	
		Fully Supervised System	No	-10%		
		Cumulative Total			-40%	
5	Exposure Surcharge (cumulative %)					
	(3)	North Side	> 45.1m		0%	1,350
		East Side	30.1- 45 m		5%	
		South Side	> 45.1m		0%	
		West Side	20.1 - 30 m		10%	
		Cumulative Total			15%	
Results						
6	(1) + (2) + (3)	Total Required Fire Flow, rounded to nearest 1000L/min			L/min	7,000
		(2,000 L/min < Fire Flow < 45,000 L/min)			or L/s	117
					or USGPM	1,849
7	Storage Volume	Required Duration of Fire Flow (hours)			Hours	2
		Required Volume of Fire Flow (m ³)			m ³	840

Camp Mart - 20 Frank Neighbor

Day 1, 12:00 AM

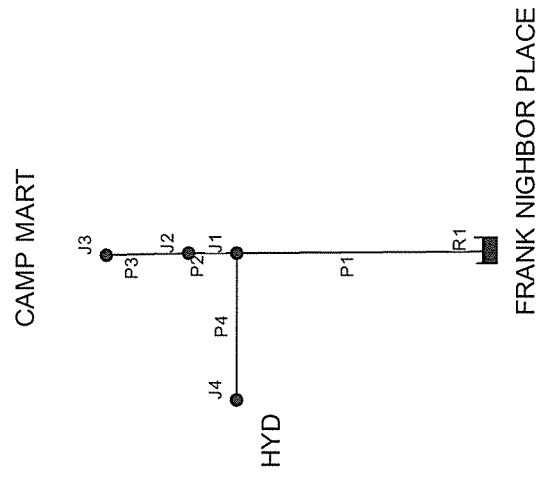

Camp Mart - 20 Frank Nighbor Place

Max Day + Fire Flow Demand

Network Table - Nodes

Node ID	Elevation m	Demand L/s	Head m	Pressure m	Pressure kPa	Pressure psi
Junc J1	92.5	0	150.11	57.61	565.15	81.97
Junc J2	92.5	0	150.11	57.61	565.15	81.97
Junc J3	95.5	0.39	150.11	54.61	535.72	77.70
Junc J4	96	117	146.22	50.22	492.66	71.45
Resvr R1	158.6	-117.39	158.6	0	0.00	0.00

Max Day + Fire Flow Demand

Network Table - Links

Link ID	Length m	Diameter mm	Roughness	Flow L/s	Velocity m/s	Unit Headloss m/km
Pipe P1	100	200	110	117.39	3.74	84.92
Pipe P2	2	200	110	0.39	0.01	0
Pipe P3	14.7	150	100	0.39	0.02	0.01
Pipe P4	9.5	150	100	117	6.62	408.86

Camp Mart - 20 Frank Nighbor Place

Peak Hour Demand
Network Table - Nodes

Node ID	Elevation m	Demand L/s	Head m	Pressure m	Pressure kPa	Pressure psi
Junc J1	92.5	0	157.6	65.1	638.63	92.63
Junc J2	92.5	0	157.6	65.1	638.63	92.63
Junc J3	95.5	0.72	157.6	62.1	609.20	88.36
Junc J4	96	0	157.6	61.6	604.30	87.65
Resvr R1	157.6	-0.72	157.6	0	0.00	0.00

Peak Hour Demand
Network Table - Links

Link ID	Length m	Diameter mm	Roughness	Flow L/s	Velocity m/s	Unit Headloss m/km
Pipe P1	100	200	110	0.72	0.02	0.01
Pipe P2	2	200	110	0.72	0.02	0.01
Pipe P3	14.7	150	100	0.72	0.04	0.03
Pipe P4	9.5	150	100	0	0	0

Camp Mart - 20 Frank Nighbor Place

Max HGL check

Network Table - Nodes

Node ID	Elevation m	Demand L/s	Head m	Pressure m	Pressure kPa	Pressure psi
Junc J1	92.5	0	162.3	69.8	684.74	99.31
Junc J2	92.5	0	162.3	69.8	684.74	99.31
Junc J3	95.5	0.72	162.3	66.8	655.31	95.04
Junc J4	96	0	162.3	66.3	650.40	94.33
Resvr R1	162.3	-0.72	162.3	0	0.00	0.00

Max HGL check

Network Table - Links

Link ID	Length m	Diameter mm	Roughness	Flow L/s	Velocity m/s	Unit Headloss m/km
Pipe P1	100	200	110	0.72	0.02	0.01
Pipe P2	2	200	110	0.72	0.02	0.01
Pipe P3	14.7	150	100	0.72	0.04	0.03
Pipe P4	9.5	150	100	0	0	0


APPENDIX D

**IDF Curves and SWM Calculations,
Storm Sewer Design Sheet,
Excerpts from the previous SWM Report**

Ottawa Sewer Design Guidelines

APPENDIX 5-A

OTTAWA INTENSITY DURATION FREQUENCY (IDF) CURVE

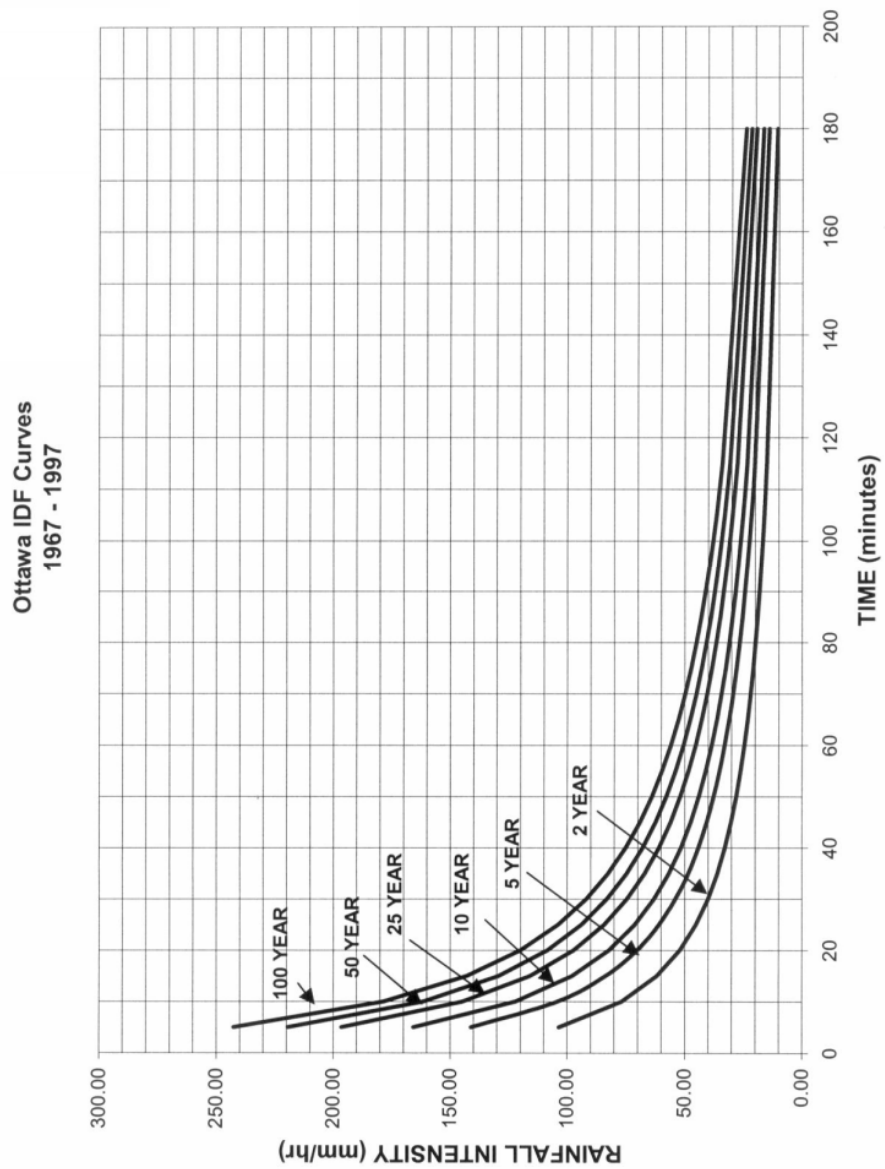

RATIONAL METHOD

The Rational Method was used to determine the pre-development and post-development runoff for the site. The equation is as follows:

$$Q = 2.78 \text{ CIA}$$

Where:

Q is the runoff in L/s

C is the weighted runoff coefficient*

I is the rainfall intensity in mm/hr**

A is the area in hectares

*The weighted runoff coefficient is determined for each of the catchment areas as follows:

$$C = \frac{(A_{\text{perv}} \times C_{\text{perv}}) + (A_{\text{imp}} \times C_{\text{imp}})}{A_{\text{tot}}}$$

Where:

A_{perv} is the pervious area in hectares

C_{perv} is the pervious area runoff coefficient ($C_{\text{perv}} = 0.20$)

A_{imp} is the impervious area in hectares

C_{imp} is the impervious area runoff coefficient ($C_{\text{imp}} = 0.90$)

A_{tot} is the catchment area ($A_{\text{perv}} + A_{\text{imp}}$) in hectares

Note: Increase the C values above by 25% for the 1:100 year event (max. $C_{\text{imp}} = 1.0$).

** The 1:5 year rainfall intensity for runoff being directed to the municipal sewer was determined to be 104.2 mm/hr based on a time of concentration of 10 minutes as specified by the City of Ottawa. The 1:100 year rainfall intensity used in the calculations below is 178.6 mm/hr.

PRE-DEVELOPMENT SAMPLE CALCULATIONS:

Drainage Area = 1.99 ha

Impervious Area = N/A

Pervious Area = 1.99 ha

Runoff Coefficient ($C_{5\text{yr}}$) = 0.20

Runoff Coefficient ($C_{100\text{yr}}$) = 0.25

Intensity (I_5) = 104.2 mm/hr

Intensity (I_{100}) = 178.6 mm/h

$$C_{5\text{yr}} = \frac{(0.0 \times 0.90) + (1.99 \times 0.20)}{1.99} = 0.20$$

$$C_{100\text{yr}} = \frac{(0.0 \times 1.0) + (1.99 \times 0.25)}{1.99} = 0.25$$

$$Q_5 = 2.78 \text{ CIA}$$

$$Q_5 = 2.78 \times 0.20 \times 104.2 \times 1.99$$

$$Q_5 = 115.3 \text{ L/s}$$

$$Q_{100} = 2.78 \text{ CIA}$$

$$Q_{100} = 2.78 \times 0.25 \times 178.6 \times 1.99$$

$$Q_{100} = 247.0 \text{ L/s}$$

UNCONTROLLED POST-DEVELOPMENT SAMPLE CALCULATIONS (A-1):

Drainage Area (A-1) = 1.23 ha
 Impervious Area = 0.84 ha
 Pervious Area = 0.39 ha
 Runoff Coefficient (C_{5yr}) = 0.68
 Runoff Coefficient (C_{100yr}) = 0.76
 Intensity (I_5) = 104.2 mm/hr
 Intensity (I_{100}) = 178.6 mm/h

$$C_{5yr} = \frac{(0.84 \times 0.90) + (0.39 \times 0.20)}{1.23} = 0.68$$

$$C_{100yr} = \frac{(0.84 \times 1.0) + (0.39 \times 0.25)}{1.23} = 0.76$$

$Q_5 = 2.78 \text{ CIA}$
 $Q_5 = 2.78 \times 0.68 \times 104.2 \times 1.23$
 $Q_5 = 242.3 \text{ L/s}$

$Q_{100} = 2.78 \text{ CIA}$
 $Q_{100} = 2.78 \times 0.76 \times 178.6 \times 1.23$
 $Q_{100} = 464.1 \text{ L/s}$

UNCONTROLLED POST-DEVELOPMENT SAMPLE CALCULATIONS (A-3):

Drainage Area (A-3) = 0.41 ha
 Impervious Area = 0.21 ha
 Pervious Area = 0.20 ha
 Runoff Coefficient (C_{5yr}) = 0.56
 Runoff Coefficient (C_{100yr}) = 0.63
 Intensity (I_5) = 104.2 mm/hr
 Intensity (I_{100}) = 178.6 mm/h

$$C_{5yr} = \frac{(0.21 \times 0.90) + (0.20 \times 0.20)}{0.41} = 0.56$$

$$C_{100yr} = \frac{(0.21 \times 1.0) + (0.20 \times 0.25)}{0.41} = 0.63$$

$Q_5 = 2.78 \text{ CIA}$
 $Q_5 = 2.78 \times 0.56 \times 104.2 \times 0.41$
 $Q_5 = 66.5 \text{ L/s}$

$Q_{100} = 2.78 \text{ CIA}$
 $Q_{100} = 2.78 \times 0.63 \times 178.6 \times 0.41$
 $Q_{100} = 128.2 \text{ L/s}$

Proposed Camp Mart Development 20 Frank Nighbor Place

Pre - Development Site Flows									
Description	A (ha)	A imp (ha) C=0.9	A grav (ha) C=0.6	A perv (ha) C=0.2	C ₅	C ₁₀₀	Pre-Development Flows		Allowable
							5 year (L/s)	100 year (L/s)	50 L/s/ha
Site Area	1.99	0.00	0.00	1.99	0.20	0.25	115.3	247.0	99.5

t_c=10mins

t_c=10mins

Post - Development : Total Uncontrolled Site Flows									
Area	Description	A (ha)	A imp (ha) C=0.9	A pavers (ha) C=0.7	A perv (ha) C=0.2	C ₅	C ₁₀₀	Uncontrolled Flow (L/s)	
								5 year	100 year
A-0	Un-Controlled Direct Runoff	0.07	0.01	0.00	0.06	0.30	0.36	6.1	12.4
A-1	Controlled Parking Lot Area (CBMH 1)	1.23	0.84	0.00	0.39	0.68	0.76	241.6	465.5
A-2	Controlled Building Roof	0.28	0.28	0.00	0.00	0.90	1.00	73.0	139.0
A-3	Controlled Parking Lot Area (CBMH 11)	0.41	0.21	0.00	0.20	0.56	0.63	66.3	129.1

Summed Area Check:

1.99

t_c=10mins

t_c=10mins

Post - Development : Total Flows for Controlled Site						
Area	Description	Flow (L/s)		Storage Required (m ³)		Provided (m ³)
		5 year	100 year	5 year	100 year	
A-0	Un-Controlled Direct Runoff	6.1	12.4	---	---	---
A-1	Controlled Parking Lot Area (CBMH 1)	23.5	24.1	191.4	448.4	640.5
A-2	Controlled Building Roof	24.7	33.5	31.1	73.7	91.3
A-3	Controlled Parking Lot Area (CBMH 11)	28.1	29.1	22.9	69.1	192.7
	Totals =	82.4	99.1	245.4	591.2	924.5

Over-Controlled by:

17.1

0.4

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:5 YEAR EVENT AREA A-0 Un-Controlled Direct Runoff				
OTTAWA IDF CURVE				
Area = 0.07 ha		Qallow = 6.1 L/s		
C = 0.30		Vol(max) = 0.0 m3		
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	141.18	8.24	2.16	0.65
10	104.19	6.08	0.00	0.00
15	83.56	4.88	-1.21	-1.08
20	70.25	4.10	-1.98	-2.38
25	60.90	3.56	-2.53	-3.79
30	53.93	3.15	-2.93	-5.28
35	48.52	2.83	-3.25	-6.83
40	44.18	2.58	-3.50	-8.41
45	40.63	2.37	-3.71	-10.02
50	37.65	2.20	-3.89	-11.66
55	35.12	2.05	-4.03	-13.31
60	32.94	1.92	-4.16	-14.98
65	31.04	1.81	-4.27	-16.66
70	29.37	1.71	-4.37	-18.35
75	27.89	1.63	-4.46	-20.05
90	24.29	1.42	-4.67	-25.19
105	21.58	1.26	-4.82	-30.39
120	19.47	1.14	-4.95	-35.62
135	17.76	1.04	-5.05	-40.87
150	16.36	0.96	-5.13	-46.15

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:100 YEAR EVENT AREA A-0 Un-Controlled Direct Runoff				
OTTAWA IDF CURVE				
Area = 0.07 ha		Qallow = 12.4 L/s		
C = 0.36		Vol(max) = 0.0 m3		
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	242.70	16.87	4.46	1.34
10	178.56	12.41	0.00	0.00
15	142.89	9.93	-2.48	-2.23
20	119.95	8.34	-4.08	-4.89
25	103.85	7.22	-5.20	-7.79
30	91.87	6.38	-6.03	-10.85
35	82.58	5.74	-6.67	-14.01
40	75.15	5.22	-7.19	-17.26
45	69.05	4.80	-7.61	-20.56
50	63.95	4.44	-7.97	-23.90
55	59.62	4.14	-8.27	-27.29
60	55.89	3.88	-8.53	-30.70
65	52.65	3.66	-8.75	-34.14
70	49.79	3.46	-8.95	-37.60
75	47.26	3.28	-9.13	-41.08
90	41.11	2.86	-9.56	-51.60
105	36.50	2.54	-9.88	-62.22
120	32.89	2.29	-10.13	-72.91
135	30.00	2.08	-10.33	-83.66
150	27.61	1.92	-10.49	-94.44

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:2 YEAR EVENT AREA A-1 Controlled Flow-Parking Lot Storage					
OTTAWA IDF CURVE					
Area = 1.23 ha		Qallow = 23.1 L/s			
C = 0.68		Vol(max) = 127.4 m3			
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	103.57	240.13	217.03	65.11	
10	76.81	178.07	154.97	92.98	
15	61.77	143.21	120.11	108.10	
20	52.03	120.64	97.54	117.04	
25	45.17	104.72	81.62	122.43	
30	40.04	92.84	69.74	125.53	
35	36.06	83.60	60.50	127.06	
40	32.86	76.20	53.10	127.43	
45	30.24	70.11	47.01	126.93	
50	28.04	65.01	41.91	125.74	
55	26.17	60.68	37.58	124.00	
60	24.56	56.94	33.84	121.81	
65	23.15	53.68	30.58	119.25	
70	21.91	50.81	27.71	116.36	
75	20.81	48.26	25.16	113.20	
90	18.14	42.06	18.96	102.41	
105	16.13	37.41	14.31	90.13	
120	14.56	33.76	10.66	76.77	
135	13.30	30.83	7.73	62.58	
150	12.25	28.41	5.31	47.75	

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:5 YEAR EVENT AREA A-1 Controlled Flow-Parking Lot Storage					
OTTAWA IDF CURVE					
Area = 1.23 ha		Qallow = 23.5 L/s			
C = 0.68		Vol(max) = 191.4 m3			
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	141.18	327.33	303.83	91.15	
10	104.19	241.57	218.07	130.84	
15	83.56	193.73	170.23	153.21	
20	70.25	162.88	139.38	167.25	
25	60.90	141.19	117.69	176.53	
30	53.93	125.03	101.53	182.76	
35	48.52	112.49	88.99	186.88	
40	44.18	102.44	78.94	189.46	
45	40.63	94.20	70.70	190.89	
50	37.65	87.30	63.80	191.40	
55	35.12	81.43	57.93	191.18	
60	32.94	76.38	52.88	190.37	
65	31.04	71.98	48.48	189.05	
70	29.37	68.10	44.60	187.32	
75	27.89	64.66	41.16	185.22	
90	24.29	56.31	32.81	177.19	
105	21.58	50.04	26.54	167.20	
120	19.47	45.14	21.64	155.78	
135	17.76	41.19	17.69	143.28	
150	16.36	37.94	14.44	129.92	

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:100 YEAR EVENT AREA A-1 Controlled Flow-Parking Lot Storage					
OTTAWA IDF CURVE					
Area = 1.23 ha		Qallow = 24.1 L/s			
C = 0.76		Vol(max) = 448.4 m3			
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	242.70	632.55	608.45	182.53	
10	178.56	465.37	441.27	264.76	
15	142.89	372.42	348.32	313.49	
20	119.95	312.62	288.52	346.22	
25	103.85	270.65	246.55	369.83	
30	91.87	239.43	215.33	387.60	
35	82.58	215.22	191.12	401.35	
40	75.15	195.85	171.75	412.19	
45	69.05	179.96	155.86	420.83	
50	63.95	166.68	142.58	427.74	
55	59.62	155.39	131.29	433.27	
60	55.89	145.68	121.58	437.67	
65	52.65	137.21	113.11	441.13	
70	49.79	129.76	105.66	443.79	
75	47.26	123.16	99.06	445.77	
90	41.11	107.15	83.05	448.44	
105	36.50	95.12	71.02	447.43	
120	32.89	85.73	61.63	443.75	
135	30.00	78.18	54.08	438.04	
150	27.61	71.96	47.86	430.74	

Area A-1 Storage	Surface CBMH 1		Surface CBMH 2		Surface CBMH 3		Surface CB 1		Surface CB 2		Surface CBMH 4		Surface CBMH 5		Surface CBMH 6		Surface CBMH 7		Surface CB 3		Surface CB 4		Surface CBMH 8		Surface CBMH 9		Surface CBMH 10		Total Storage
Elevation (m)	Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Ponding		Total Volume (m³)
	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	
94.50	-	-	-	-	-	-	-	-	-	-	-	-	-	-	0	0.00	-	-	0	0.00	-	-	-	-	-	-	-	-	0
94.55	-	-	-	-	-	-	-	-	-	-	-	-	-	-	43.32	1.08	-	-	87.69	2.19	-	-	-	-	-	-	-	-	3.3
94.60	-	-	-	-	-	-	-	-	-	-	-	-	-	-	73.84	4.01	-	-	183.86	8.98	-	-	-	-	-	-	-	-	13.0
94.65	-	-	-	-	-	-	-	-	-	-	-	-	-	-	99.71	8.35	-	-	248.47	19.79	-	-	-	-	-	-	-	-	28.1
94.70	-	-	-	-	-	-	-	-	-	-	-	-	-	-	125.49	13.98	-	-	312.70	33.82	-	-	-	-	-	-	-	-	47.8
94.75	-	-	-	-	-	-	-	-	-	-	-	-	-	-	151.46	20.90	-	-	377.24	51.07	-	-	-	-	-	-	-	-	72.0
94.80	-	-	-	-	-	-	-	-	-	-	-	-	-	-	177.62	29.13	-	-	442.84	71.57	-	-	-	-	-	-	-	-	100.7
94.85	0	0.00	0	0.00	0	0.00	0	0.00	0	0.00	0	0.00	0	0.00	203.97	38.67	-	-	508.73	95.36	-	-	-	-	-	-	-	-	134.0
94.90	20.45	0.51	21.20	0.53	15.30	0.38	13.84	0.35	32.99	0.82	40.29	1.01	28.16	0.70	230.50	49.53	19.14	0.48	575.05	122.45	32.95	0.82	31.33	0.78	28.21	0.71	19.16	0.48	179.6
94.95	99.54	3.51	84.80	3.18	61.20	2.29	55.20	2.07	131.94	4.95	161.17	6.04	112.68	4.22	257.23	61.73	74.70	2.82	641.90	152.88	131.79	4.94	127.27	4.75	100.03	3.91	73.87	2.80	260.1
95.00	196.76	10.92	195.65	10.19	138.82	7.30	124.58	6.57	296.87	15.67	362.64	19.14	253.58	13.38	284.15	75.26	166.62	8.86	708.98	186.65	296.54	15.65	265.34	14.56	206.86	11.58	146.27	8.31	404.0
95.05	303.19	23.42	301.53	22.62	230.74	16.53	207.07	14.86	503.36	35.67	593.60	43.04	417.00	30.15	311.26	90.15	272.18	19.83	763.08	223.45	507.31	35.75	445.70	32.34	364.62	25.87	252.03	18.27	631.9


88mm dia. Circular Plug Type ICD	
1:100 Yr	
Flow (L/s) = 24.1	
Head (m) = 2.08	
Elevation (m) = 95.01	
Outlet Pipe Dia.(mm) = 381	
Volume (m3) = 448.4	
1:5 Yr	
Flow (L/s) = 23.5	
Head (m) = 1.98	
Elevation (m) = 94.91	
Outlet Pipe Dia.(mm) = 381	
Volume (m3) = 191.4	
1:2 Yr	
Flow (L/s) = 23.1	
Head (m) = 1.91	
Elevation (m) = 94.84	
Outlet Pipe Dia.(mm) = 381	
Volume (m3) = 127.4	

Parking Lot Ponding Depth (cm)	
1:100 Yr	16
1:5 Yr	6

Orifice Size - 1:100 yr Flow Check		
Q=0.62xAx(2gh)^0.5		
	1:100 yr	Flow Check
Q (m³/s) =	0.0241	0.0241
g (m/s²) =	9.81	9.81
h (m) =	2.08	2.08
A (m²) =	0.006085502	0.00608
D (m) =	0.088024437	0.08800
D (mm) =	88	88.0

1:5 yr Flow Check		
	1:5 yr	
Q (m³/s) =	0.0235	
g (m/s²) =	9.81	
h (m) =	1.98	
A (m²) =	0.00608	
D (m) =	0.088	
D (mm) =	88	

1:2 yr Flow Check		
	1:5 yr	
Q (m³/s) =	0.0231	
g (m/s²) =	9.81	
h (m) =	1.91	
A (m²) =	0.00608	
D (m) =	0.088	
D (mm) =	88	

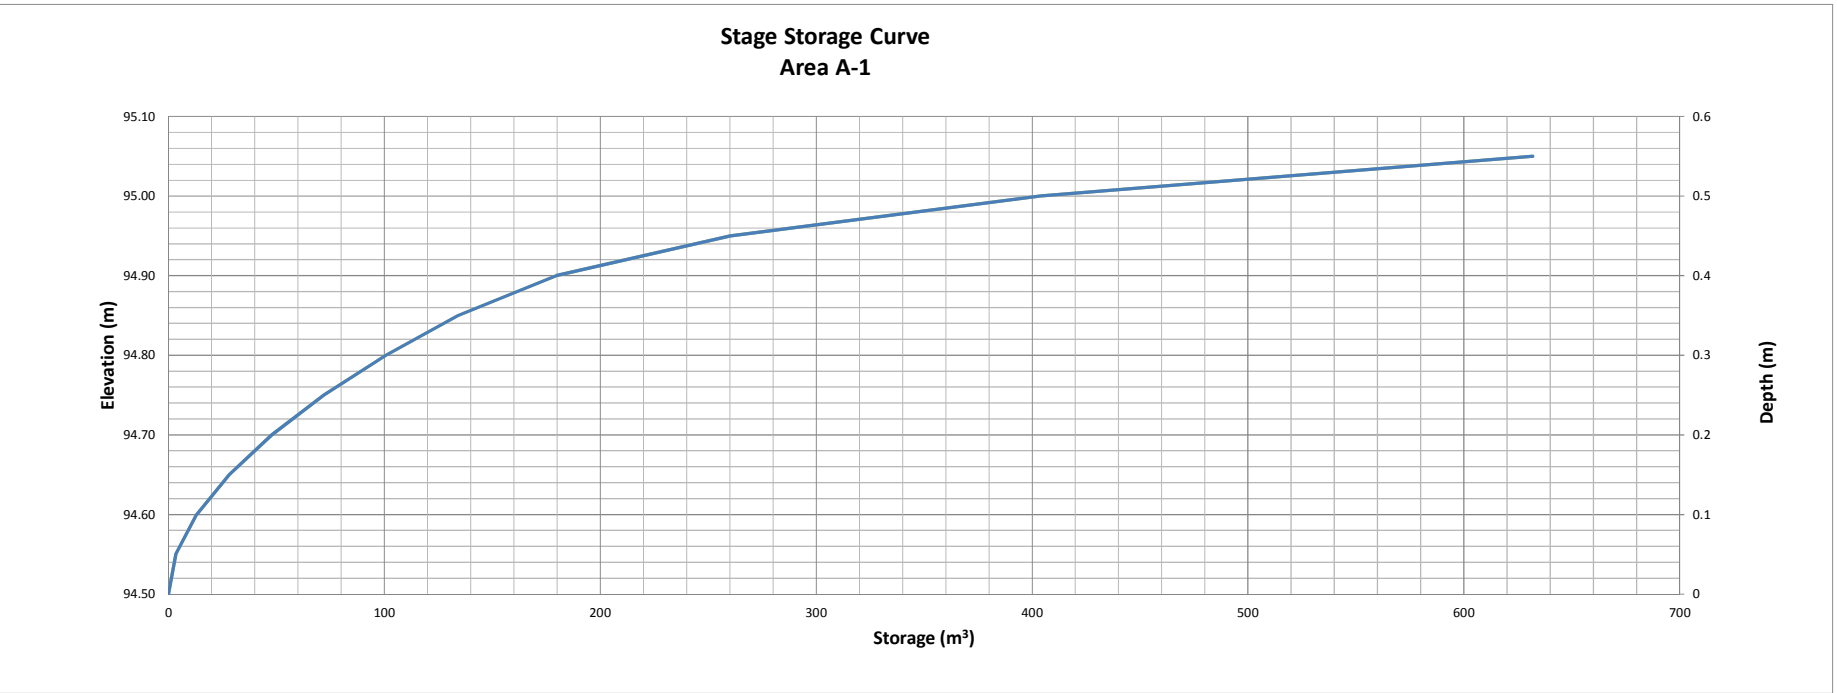


Camp Mart - 20 Frank Nighbor Place				
Project No. 117193				
REQUIRED STORAGE - 1:5 YEAR EVENT				
AREA A-2 Controlled Roof Drains 1&2				
OTTAWA IDF CURVE				
Area =	0.062	ha	Qallow =	5.04 L/s
C =	0.90		Vol(max) =	7.1 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	141.18	21.90	16.86	5.06
10	104.19	16.16	11.12	6.67
15	83.56	12.96	7.92	7.13
20	70.25	10.90	5.86	7.03
25	60.90	9.45	4.41	6.61
30	53.93	8.37	3.33	5.99
35	48.52	7.53	2.49	5.22
40	44.18	6.85	1.81	4.35
45	40.63	6.30	1.26	3.41
50	37.65	5.84	0.80	2.40
55	35.12	5.45	0.41	1.35
60	32.94	5.11	0.07	0.25
65	31.04	4.82	-0.22	-0.88
70	29.37	4.56	-0.48	-2.03
75	27.89	4.33	-0.71	-3.21
90	24.29	3.77	-1.27	-6.87
105	21.58	3.35	-1.69	-10.66
120	19.47	3.02	-2.02	-14.54

Camp Mart - 20 Frank Nighbor Place				
Project No. 117193				
REQUIRED STORAGE - 1:100 YEAR EVENT				
AREA A-2 Controlled Roof Drains 1&2				
OTTAWA IDF CURVE				
Area =	0.062	ha	Qallow =	6.32 L/s
C =	1.00		Vol(max) =	17.4 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	242.70	41.83	35.51	10.65
10	178.56	30.78	24.46	14.67
15	142.89	24.63	18.31	16.48
20	119.95	20.67	14.35	17.23
25	103.85	17.90	11.58	17.37
30	91.87	15.83	9.51	17.13
35	82.58	14.23	7.91	16.62
40	75.15	12.95	6.63	15.92
45	69.05	11.90	5.58	15.07
50	63.95	11.02	4.70	14.11
55	59.62	10.28	3.96	13.06
60	55.89	9.63	3.31	11.93
65	52.65	9.07	2.75	10.74
70	49.79	8.58	2.26	9.50
75	47.26	8.14	1.82	8.21
90	41.11	7.09	0.77	4.14
105	36.50	6.29	-0.03	-0.18
120	32.89	5.67	-0.65	-4.68

Zurn Clontrol-Flo Roof Drains:			Z-105 - 2 Notches (5 USGPM / inch of head / notch)		
Design Event	Flow/Drain (L/s)	Total Flow (L/s)	Ponding (cm)	Storage (m ³) Required	Storage (m ³) Provided
1:5 Year	2.52	5.04	10	7.1	21.1
1:100 Year	3.16	6.32	13	17.4	21.1

Roof Drain Storage Table for Area A-2		
Elevation	Area RD's 1&2	Total Volume
m	m ²	m ³
0.00	0	0
0.05	42.54	1.1
0.10	170.16	6.4
0.15	418.44	21.1

**Stage Storage Curve: Area A-2
Controlled Roof Drains 1 & 2**

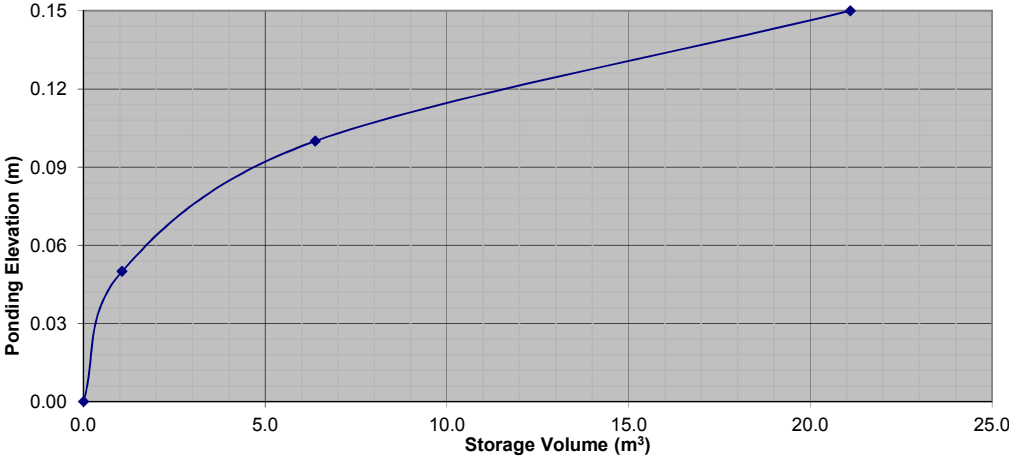


Camp Mart - 20 Frank Nighbor Place					
Project No. 117193					
REQUIRED STORAGE - 1:5 YEAR EVENT					
AREA A-2 Controlled Roof Drains 3&4					
OTTAWA IDF CURVE					
Area =	0.080	ha	Qallow =	8.04	L/s
C =	0.90		Vol(max) =	7.8	m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	141.18	28.26	20.22	6.07	
10	104.19	20.86	12.82	7.69	
15	83.56	16.72	8.68	7.82	
20	70.25	14.06	6.02	7.23	
25	60.90	12.19	4.15	6.22	
30	53.93	10.79	2.75	4.96	
35	48.52	9.71	1.67	3.51	
40	44.18	8.84	0.80	1.93	
45	40.63	8.13	0.09	0.25	
50	37.65	7.54	-0.50	-1.51	
55	35.12	7.03	-1.01	-3.33	
60	32.94	6.59	-1.45	-5.21	
65	31.04	6.21	-1.83	-7.12	
70	29.37	5.88	-2.16	-9.08	
75	27.89	5.58	-2.46	-11.06	
90	24.29	4.86	-3.18	-17.16	
105	21.58	4.32	-3.72	-23.44	
120	19.47	3.90	-4.14	-29.83	

Camp Mart - 20 Frank Nighbor Place					
Project No. 117193					
REQUIRED STORAGE - 1:100 YEAR EVENT					
AREA A-2 Controlled Roof Drains 3&4					
OTTAWA IDF CURVE					
Area =	0.080	ha	Qallow =	11.34	L/s
C =	1.00		Vol(max) =	18.4	m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	242.70	53.98	42.64	12.79	
10	178.56	39.71	28.37	17.02	
15	142.89	31.78	20.44	18.40	
20	119.95	26.68	15.34	18.40	
25	103.85	23.10	11.76	17.63	
30	91.87	20.43	9.09	16.36	
35	82.58	18.37	7.03	14.75	
40	75.15	16.71	5.37	12.89	
45	69.05	15.36	4.02	10.85	
50	63.95	14.22	2.88	8.65	
55	59.62	13.26	1.92	6.34	
60	55.89	12.43	1.09	3.93	
65	52.65	11.71	0.37	1.44	
70	49.79	11.07	-0.27	-1.12	
75	47.26	10.51	-0.83	-3.74	
90	41.11	9.14	-2.20	-11.86	
105	36.50	8.12	-3.22	-20.30	
120	32.89	7.32	-4.02	-28.97	

Zurn Clontrol-Flo Roof Drains:			Z-105 - 3 Notches (5 USGPM / inch of head / notch)		
Design Event	Flow/Drain (L/s)	Total Flow (L/s)	Ponding (cm)	Storage (m ³) Required	Provided
1:5 Year	4.02	8.04	11	7.8	20.8
1:100 Year	5.67	11.34	14	18.4	20.8

Roof Drain Storage Table for Area A-2		
Elevation	Area RD's 3&4	Total Volume
m	m ²	m ³
0.00	0	0
0.05	42.37	1.1
0.10	169.49	6.4
0.15	410.13	20.8

**Stage Storage Curve: Area A-2
Controlled Roof Drains 3 & 4**

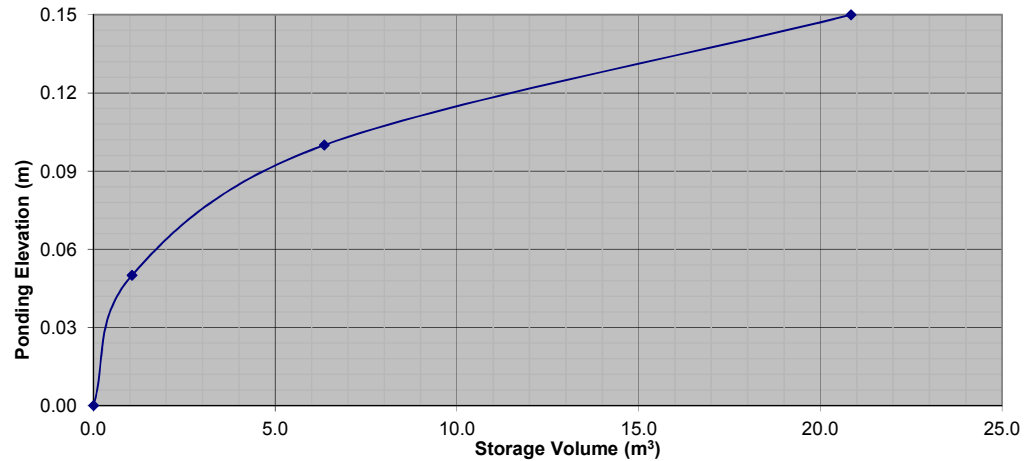


Camp Mart - 20 Frank Nighbor Place				
Project No. 117193				
REQUIRED STORAGE - 1:5 YEAR EVENT				
AREA A-2 Controlled Roof Drains 5&6				
OTTAWA IDF CURVE				
Area =	0.051	ha	Qallow =	6.60 L/s
C =	0.90		Vol(max) =	4.0 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	141.18	18.01	11.41	3.42
10	104.19	13.30	6.70	4.02
15	83.56	10.66	4.06	3.66
20	70.25	8.96	2.36	2.84
25	60.90	7.77	1.17	1.76
30	53.93	6.88	0.28	0.51
35	48.52	6.19	-0.41	-0.86
40	44.18	5.64	-0.96	-2.31
45	40.63	5.18	-1.42	-3.82
50	37.65	4.80	-1.80	-5.39
55	35.12	4.48	-2.12	-6.99
60	32.94	4.20	-2.40	-8.63
65	31.04	3.96	-2.64	-10.29
70	29.37	3.75	-2.85	-11.98
75	27.89	3.56	-3.04	-13.69
90	24.29	3.10	-3.50	-18.90
105	21.58	2.75	-3.85	-24.23
120	19.47	2.48	-4.12	-29.63

Camp Mart - 20 Frank Nighbor Place				
Project No. 117193				
REQUIRED STORAGE - 1:100 YEAR EVENT				
AREA A-2 Controlled Roof Drains 5&6				
OTTAWA IDF CURVE				
Area =	0.051	ha	Qallow =	9.48 L/s
C =	1.00		Vol(max) =	9.7 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	242.70	34.41	24.93	7.48
10	178.56	25.32	15.84	9.50
15	142.89	20.26	10.78	9.70
20	119.95	17.01	7.53	9.03
25	103.85	14.72	5.24	7.87
30	91.87	13.03	3.55	6.38
35	82.58	11.71	2.23	4.68
40	75.15	10.65	1.17	2.82
45	69.05	9.79	0.31	0.84
50	63.95	9.07	-0.41	-1.24
55	59.62	8.45	-1.03	-3.39
60	55.89	7.92	-1.56	-5.60
65	52.65	7.46	-2.02	-7.86
70	49.79	7.06	-2.42	-10.17
75	47.26	6.70	-2.78	-12.51
90	41.11	5.83	-3.65	-19.72
105	36.50	5.17	-4.31	-27.12
120	32.89	4.66	-4.82	-34.68

Zurn Clontrol-Flo Roof Drains:			Z-105 - 3 Notches (5 USGPM / inch of head / notch)		
Design Event	Flow/Drain (L/s)	Total Flow (L/s)	Ponding (cm)	Storage (m ³) Required	Storage (m ³) Provided
1:5 Year	3.30	6.60	9	4.0	15.5
1:100 Year	4.74	9.48	13	9.7	15.5

Roof Drain Storage Table for Area A-2		
Elevation	Area RD's 5&6	Total Volume
m	m ²	m ³
0.00	0	0
0.05	33.09	0.8
0.10	141.11	5.2
0.15	273.01	15.5

**Stage Storage Curve: Area A-2
Controlled Roof Drains 5 & 6**

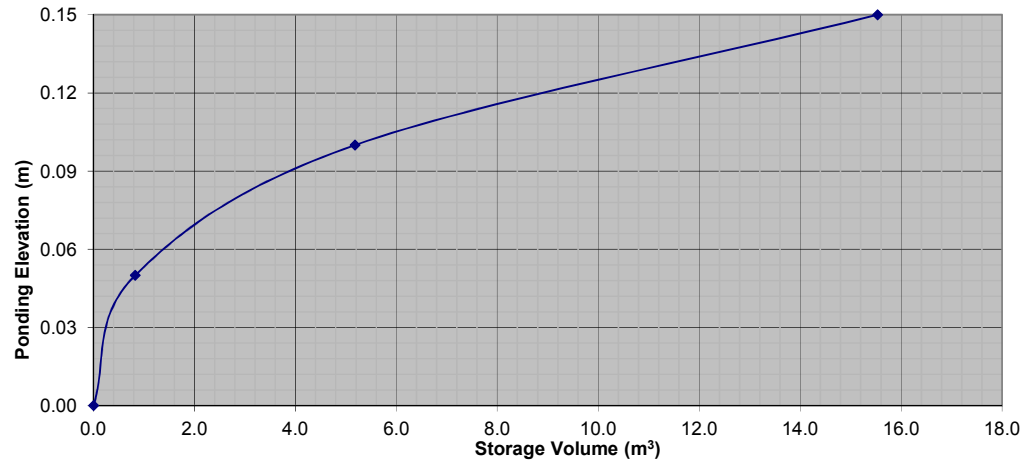


Camp Mart - 20 Frank Nighbor Place					
Project No. 117193					
REQUIRED STORAGE - 1:5 YEAR EVENT					
AREA A-2 Controlled Roof Drains 7-10					
OTTAWA IDF CURVE					
Area =	0.086	ha	Qallow =	5.04	L/s
C =	0.90		Vol(max) =	12.1	m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	141.18	30.38	25.34	7.60	
10	104.19	22.42	17.38	10.43	
15	83.56	17.98	12.94	11.65	
20	70.25	15.12	10.08	12.09	
25	60.90	13.10	8.06	12.09	
30	53.93	11.60	6.56	11.81	
35	48.52	10.44	5.40	11.34	
40	44.18	9.51	4.47	10.72	
45	40.63	8.74	3.70	10.00	
50	37.65	8.10	3.06	9.19	
55	35.12	7.56	2.52	8.31	
60	32.94	7.09	2.05	7.37	
65	31.04	6.68	1.64	6.39	
70	29.37	6.32	1.28	5.38	
75	27.89	6.00	0.96	4.32	
90	24.29	5.23	0.19	1.01	
105	21.58	4.64	-0.40	-2.50	
120	19.47	4.19	-0.85	-6.13	

Camp Mart - 20 Frank Nighbor Place					
Project No. 117193					
REQUIRED STORAGE - 1:100 YEAR EVENT					
AREA A-2 Controlled Roof Drains 7-10					
OTTAWA IDF CURVE					
Area =	0.086	ha	Qallow =	6.32	L/s
C =	1.00		Vol(max) =	28.2	m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)	
5	242.70	58.03	51.71	15.51	
10	178.56	42.69	36.37	21.82	
15	142.89	34.16	27.84	25.06	
20	119.95	28.68	22.36	26.83	
25	103.85	24.83	18.51	27.76	
30	91.87	21.96	15.64	28.16	
35	82.58	19.74	13.42	28.19	
40	75.15	17.97	11.65	27.95	
45	69.05	16.51	10.19	27.51	
50	63.95	15.29	8.97	26.91	
55	59.62	14.25	7.93	26.19	
60	55.89	13.36	7.04	25.36	
65	52.65	12.59	6.27	24.44	
70	49.79	11.90	5.58	23.45	
75	47.26	11.30	4.98	22.40	
90	41.11	9.83	3.51	18.95	
105	36.50	8.73	2.41	15.16	
120	32.89	7.86	1.54	11.12	

Zurn Clontrol-Flo Roof Drains:			Z-105 - 1 Notch (5 USGPM / inch of head / notch)		
Design Event	Flow/Drain (L/s)	Total Flow (L/s)	Ponding (cm)	Storage (m ³)	
				Required	Provided
1:5 Year	1.26	5.04	10	12.1	33.9
1:100 Year	1.58	6.32	13	28.2	33.9

Roof Drain Storage Table for Area A-2		
Elevation	Area RD's 7-10	Total Volume
m	m ²	m ³
0.00	0	0
0.05	73.56	1.8
0.10	317.24	11.6
0.15	573.16	33.9

**Stage Storage Curve: Area A-2
Controlled Roof Drains 7,8 ,9 & 10**

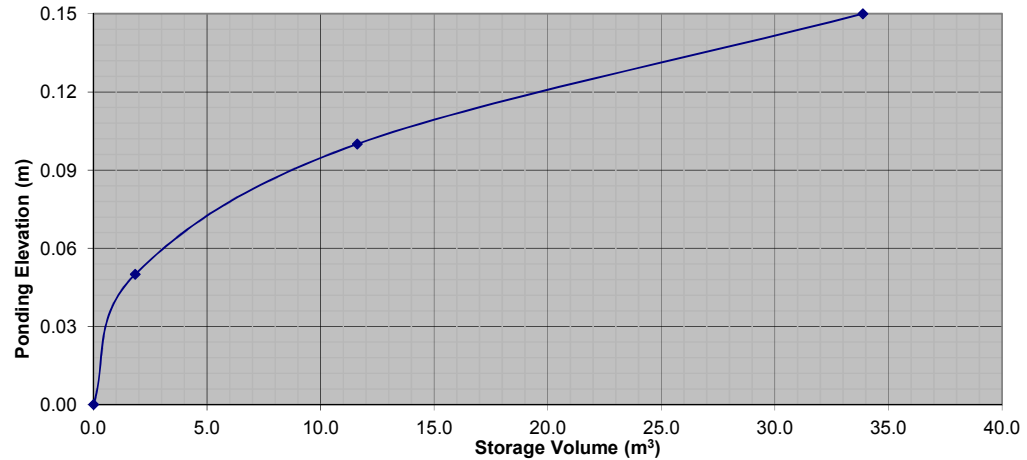

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:2 YEAR EVENT AREA A-3 Controlled Flow-Parking Lot Storage				
OTTAWA IDF CURVE				
Area =	0.41	ha	Qallow =	27.6 L/s
C =	0.56		Vol(max) =	12.8 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	103.57	65.94	38.34	11.50
10	76.81	48.90	21.30	12.78
15	61.77	39.32	11.72	10.55
20	52.03	33.12	5.52	6.63
25	45.17	28.75	1.15	1.73
30	40.04	25.49	-2.11	-3.79
35	36.06	22.96	-4.64	-9.75
40	32.86	20.92	-6.68	-16.03
45	30.24	19.25	-8.35	-22.54
50	28.04	17.85	-9.75	-29.25
55	26.17	16.66	-10.94	-36.10
60	24.56	15.63	-11.97	-43.08
65	23.15	14.74	-12.86	-50.16
70	21.91	13.95	-13.65	-57.33
75	20.81	13.25	-14.35	-64.57
90	18.14	11.55	-16.05	-86.67
105	16.13	10.27	-17.33	-109.17
120	14.56	9.27	-18.33	-131.97
135	13.30	8.46	-19.14	-155.00
150	12.25	7.80	-19.80	-178.20

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:5 YEAR EVENT AREA A-3 Controlled Flow-Parking Lot Storage				
OTTAWA IDF CURVE				
Area =	0.41	ha	Qallow =	28.1 L/s
C =	0.56		Vol(max) =	22.9 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	141.18	89.88	61.78	18.53
10	104.19	66.33	38.23	22.94
15	83.56	53.19	25.09	22.58
20	70.25	44.72	16.62	19.95
25	60.90	38.77	10.67	16.00
30	53.93	34.33	6.23	11.22
35	48.52	30.89	2.79	5.85
40	44.18	28.13	0.03	0.07
45	40.63	25.86	-2.24	-6.03
50	37.65	23.97	-4.13	-12.39
55	35.12	22.36	-5.74	-18.94
60	32.94	20.97	-7.13	-25.66
65	31.04	19.76	-8.34	-32.51
70	29.37	18.70	-9.40	-39.49
75	27.89	17.75	-10.35	-46.56
90	24.29	15.46	-12.64	-68.24
105	21.58	13.74	-14.36	-90.47
120	19.47	12.39	-15.71	-113.09
135	17.76	11.31	-16.79	-136.00
150	16.36	10.42	-17.68	-159.15

Camp Mart - 20 Frank Nighbor Place Project No. 117193 REQUIRED STORAGE - 1:100 YEAR EVENT AREA A-3 Controlled Flow-Parking Lot Storage				
OTTAWA IDF CURVE				
Area =	0.41	ha	Qallow =	29.1 L/s
C =	0.63		Vol(max) =	69.1 m3
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	242.70	175.43	146.33	43.90
10	178.56	129.06	99.96	59.98
15	142.89	103.28	74.18	66.77
20	119.95	86.70	57.60	69.12
25	103.85	75.06	45.96	68.94
30	91.87	66.40	37.30	67.14
35	82.58	59.69	30.59	64.23
40	75.15	54.32	25.22	60.52
45	69.05	49.91	20.81	56.19
50	63.95	46.23	17.13	51.38
55	59.62	43.10	14.00	46.19
60	55.89	40.40	11.30	40.68
65	52.65	38.05	8.95	34.92
70	49.79	35.99	6.89	28.93
75	47.26	34.16	5.06	22.75
90	41.11	29.71	0.61	3.32
105	36.50	26.38	-2.72	-17.13
120	32.89	23.78	-5.32	-38.33
135	30.00	21.68	-7.42	-60.09
150	27.61	19.96	-9.14	-82.29

Area A-3 Storage	Surface CBMH 12		Surface CBMH 13		Surface CBMH 14		Surface CB 6		Surface CB 7		Total Storage
Elevation (m)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Area (m²)	Volume (m³)	Total Volume (m³)
94.60	-	-	-	-	-	-	-	-	0	0.00	0
94.65	-	-	-	-	-	-	-	-	8.84	0.22	0.2
94.70	-	-	-	-	-	-	-	-	27.13	1.12	1.1
94.75	-	-	-	-	-	-	-	-	57.34	3.23	3.2
94.80	-	-	-	-	-	-	-	-	103.59	7.26	7.3
94.85	-	-	-	-	-	-	-	-	158.31	13.80	13.8
94.90	-	-	-	-	-	-	-	-	229.44	23.50	23.5
94.95	0	0.00	-	-	0	0.00	0	0.00	316.07	37.13	37.1
95.00	22.35	0.56	0	0.00	16.53	0.41	11.15	0.28	396.68	54.95	56.2
95.05	82.26	3.17	25.20	0.63	62.50	2.39	44.58	1.67	474.35	76.73	84.6
95.10	173.09	9.56	89.12	3.49	140.86	7.47	100.32	5.29	557.71	102.53	128.3
95.15	261.12	20.41	183.27	10.30	245.25	17.13	178.34	12.26	645.77	132.62	192.7


100mm dia. Circular Plug Type ICD	
1:100 Yr	
Flow (L/s) =	29.1
Head (m) =	1.82
Elevation (m) =	95.02
Outlet Pipe Dia.(mm) =	381
Volume (m3) =	69.1
1:5 Yr	
Flow (L/s) =	28.1
Head (m) =	1.70
Elevation (m) =	94.90
Outlet Pipe Dia.(mm) =	381
Volume (m3) =	22.9
1:2 Yr	
Flow (L/s) =	27.6
Head (m) =	1.64
Elevation (m) =	94.84
Outlet Pipe Dia.(mm) =	381
Volume (m3) =	12.8

Parking Lot Ponding Depth (cm)	
1:100 Yr	7
1:5 Yr	0

Orifice Size - 1:100 yr Flow Check		
Q=0.62xAx(2gh)^0.5		
	1:100 yr	Flow Check
Q (m³/s) =	0.0291	0.0291
g (m/s²) =	9.81	9.81
h (m) =	1.82	1.82
A (m²) =	0.007855535	0.00785
D (m) =	0.100009889	0.10000
D (mm) =	100	100.0

1:5 yr Flow Check	
	1:5 yr
Q (m³/s) =	0.0281
g (m/s²) =	9.81
h (m) =	1.70
A (m²) =	0.00785
D (m) =	0.1
D (mm) =	100

1:2 yr Flow Check	
	1:5 yr
Q (m³/s) =	0.0276
g (m/s²) =	9.81
h (m) =	1.64
A (m²) =	0.00785
D (m) =	0.1
D (mm) =	100

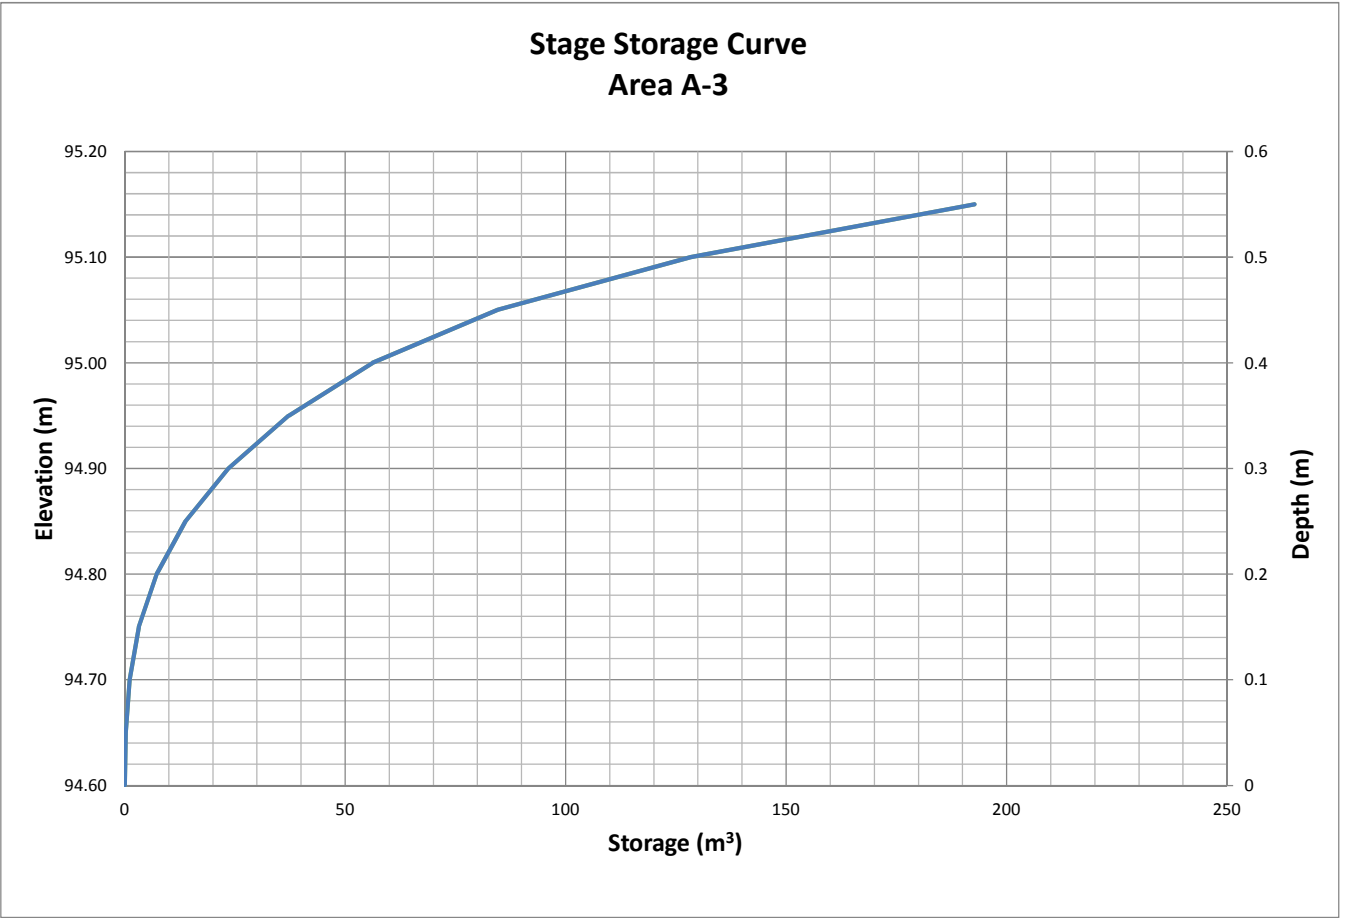

20 Frank Nighbor Place - Camp Mart Site
1:5 Year Storm Sewer Design Sheet

PROJECT : 117193
DESIGNED BY: SM
CHECKED BY: FST
DATE: May 23, 2018



AREA	FROM MH	TO MH	AREA (ha)			INDIV 2.78 AC	ACCUM 2.78 AC	TIME OF CONC. (min)	RAINFALL INTENSITY (mm/hr)	CONTROLLED FLOW* Q (L/s)	PEAK FLOW Q (L/s)	PROPOSED SEWER								
			C=	C =	C =							TYPE OF PIPE	PIPE SIZE (mm)	PIPE ID (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min)	PERCENTAGE OF CAPACITY
			0.20	0.60	0.90															
A-3 Controlled	CB 7	CBMH 14	0.124		0.007	0.09	0.09	10.00	104.19		9.0	PVC	250	254.0	0.50	14.7	43.9	0.87	0.28	21%
A-3 Controlled	CB 6	CBMH 14	0.007		0.063	0.16	0.25	10.00	104.19		25.8	PVC	300	304.8	0.35	38.0	59.7	0.82	0.77	43%
A-3 Controlled	CBMH 14	CBMH 13			0.053	0.13	0.38	10.77	100.27		38.2	PVC	375	381.0	0.25	28.0	91.5	0.80	0.58	42%
A-3 Controlled	CBMH 13	CBMH 12	0.016		0.060	0.16	0.54	11.36	97.54		52.6	PVC	375	381.0	0.25	29.9	91.5	0.80	0.62	58%
A-3 Controlled	CBMH 12	STM MH 2	0.041		0.035	0.11	0.65	11.98	94.79		61.6	PVC	375	381.0	0.25	8.9	91.5	0.80	0.18	67%
								12.16												
Controlled Flow From A-3			A-3 is controlled to 28.1 L/s by a circular plug type ICD in the outlet pipe of CBMH 12							28.1	28.1	PVC	375	381.0	0.25	8.9	91.5	0.80	0.18	31%
A-2 Controlled	Building	STM MH 2			0.280	0.70	0.70	10.00	104.19	24.7	24.7	PVC	200	203.2	1.00	8.2	34.2	1.06	0.13	72%
								10.13												
Controlled Flow From A-2			A-2 is controlled to 24.7 L/s by 10 Zurn Z-105 controlled flow roof drains							24.7	24.7	PVC	200	203.2	1.00	8.2	34.2	1.06	0.13	72%
A-1 Uncontrolled	STM MH 2	STM MH 1					1.35	12.16	94.01	37.1	127.0	PVC	375	381.0	0.25	100.0	91.5	0.80	2.08	41%
								14.24												
A-1 Controlled	CB 5	CBMH 11	0.010		0.032	0.09	0.09	10.00	104.19		8.9	PVC	250	254.0	0.50	22.0	43.9	0.87	0.42	20%
A-1 Controlled	CBMH 11	CBMH 10	0.011		0.035	0.09	0.18	10.42	102.01		18.3	PVC	300	304.8	0.35	34.1	59.7	0.82	0.69	31%
A-1 Controlled	CBMH 10	CBMH 9	0.003		0.049	0.12	0.30	11.12	98.63		29.9	PVC	375	381.0	0.25	26.2	91.5	0.80	0.54	33%
A-1 Controlled	CBMH 9	CBMH 8	0.006		0.077	0.20	0.50	11.66	96.16		48.0	PVC	375	381.0	0.25	24.9	91.5	0.80	0.52	53%
								12.18												
A-1 Controlled	CB 4	CBMH 8	0.037		0.099	0.27	0.27	10.00	104.19		28.0	PVC	250	254.0	0.50	22.4	43.9	0.87	0.43	64%
								10.43												
A-1 Controlled	CBMH 8	CBMH 4	0.009		0.091	0.23	1.00	12.18	93.93		94.0	PVC	375	381.0	0.25	36.1	91.5	0.80	0.75	103%
								12.93												
A-1 Controlled	CB 3	CBMH 7	0.112			0.06	0.06	10.00	104.19		6.5	PVC	250	254.0	0.50	4.4	43.9	0.87	0.08	15%
A-1 Controlled	CBMH 7	CBMH 6			0.044	0.11	0.17	10.08	103.75		17.9	PVC	300	304.8	0.35	14.6	59.7	0.82	0.30	30%
A-1 Controlled	CBMH 6	CBMH 5	0.041			0.02	0.20	10.38	102.22		19.9	PVC	300	304.8	0.35	11.6	59.7	0.82	0.24	33%
A-1 Controlled	CBMH 5	CBMH 4			0.067	0.17	0.36	10.62	101.04		36.7	PVC	300	304.8	0.35	24.9	59.7	0.82	0.51	61%
								11.13												
A-1 Controlled	CB 2	CBMH 4	0.041		0.080	0.22	0.22	10.00	104.19		23.2	PVC	250	254.0	0.50	23.1	43.9	0.87	0.44	53%
								10.44												
A-1 Controlled	CBMH 4	CBMH 2	0.002		0.095	0.24	1.83	12.93	90.90		165.9	PVC	375	381.0	0.25	31.6	91.5	0.80	0.66	181%
								13.59												

PROJECT : 117193
DESIGNED BY: SM
CHECKED BY: FST
DATE: May 23, 2018

20 Frank Nighbor Place - Camp Mart Site
1:5 Year Storm Sewer Design Sheet



AREA	FROM MH	TO MH	AREA (ha)			INDIV 2.78 AC	ACCUM 2.78 AC	TIME OF CONC. (min)	RAINFALL INTENSITY (mm/hr)	CONTROLLED FLOW* Q (L/s)	PEAK FLOW Q (L/s)	PROPOSED SEWER								
			C=	C =	C =							TYPE OF PIPE	PIPE SIZE (mm)	PIPE ID (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min)	PERCENTAGE OF CAPACITY
			0.20	0.60	0.90															
A-1 Controlled	CB 1	CBMH 3	0.007		0.039	0.10	0.10	10.00	104.19		10.6	PVC	250	254.0	0.50	26.1	43.9	0.87	0.50	24%
A-1 Controlled	CBMH 3	CBMH 2	0.048		0.042	0.13	0.23	10.50	101.61		23.7	PVC	300	304.8	0.35	25.3	59.7	0.82	0.52	40%
								11.02												
A-1 Controlled	CBMH 2	CBMH 1	0.031		0.044	0.13	2.19	13.59	88.42		193.3	PVC	375	381.0	0.25	23.6	91.5	0.80	0.49	211%
A-1 Uncontrolled	CBMH 1	STM MH 1	0.035		0.044	0.13	2.32	14.08	86.66		200.6	PVC	375	381.0	0.25	4.0	91.5	0.80	0.08	219%
								14.16												
Controlled Flow From A-1			A-1 is controlled to 23.5 L/s by a circular plug type ICD in the outlet pipe of CBMH 1							23.5	23.5	PVC	375	381.0	0.25	4.0	91.5	0.80	0.08	26%
A-1 Uncontrolled	STM MH 1	CDS Unit					3.67	14.16	86.37	76.3	316.6	PVC	450	457.2	0.20	5.0	133.0	0.81	0.10	57%
Site Outlet	CDS Unit	Outlet Pipe					3.67	14.26	86.02	76.3	315.3	PVC	450	457.2	0.20	8.4	133.0	0.81	0.17	57%
								14.44												

NOTES:
1) Refer to Novatech DSS & SWM Report (R-2018-011) for storm drainage and stormwater details
2) Refer to Novatech Drawings 117193-GP1 and 117193-GP2 for storm structure designations, storm pipe details and ICD tables.

Private Site Access Road 30 Frank Nighbor Place

Pre - Development Site Flows									
Description	A (ha)	A imp (ha) C=0.9	A grav (ha) C=0.6	A perv (ha) C=0.2	C ₅	C ₁₀₀	Pre-Development Flows		Allowable
							5 year (L/s)	100 year (L/s)	50 L/s/ha
Site Area	0.09	0.00	0.00	0.09	0.20	0.25	5.2	11.2	4.5
								t _c =10mins	t _c =10mins

Post - Development : Total Uncontrolled Site Flows									
Area	Description	A (ha)	A imp (ha) C=0.9	A pavers (ha) C=0.7	A perv (ha) C=0.2	C ₅	C ₁₀₀	Uncontrolled Flow (L/s)	
								5 year	100 year
A-4	Controlled Roadway Area (CB 1A)	0.09	0.06	0.00	0.03	0.67	0.75	17.4	33.5
Summed Area Check:		0.09						t _c =10mins	t _c =10mins

Post - Development : Total Flows for Controlled Site						
Area	Description	Flow (L/s)		Storage Required (m ³)		Provided (m ³)
		5 year	100 year	5 year	100 year	
A-4	Controlled Roadway Area (CB 1A)	4.3	4.4	8.9	23.3	38.9
Totals =		4.3	4.4	8.9	23.3	38.9
Over-Controlled by:		0.2	0.1			

Private Access Road - 30 Frank Nighbor Place				
Project No. 117193				
REQUIRED STORAGE - 1:5 YEAR EVENT				
AREA A-4 Controlled Flow-Parking Lot Storage				
OTTAWA IDF CURVE				
Area = 0.090 ha		Qallow = 4.3 L/s		
C = 0.67		Vol(max) = 8.9 m3		
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	141.18	23.55	19.25	5.77
10	104.19	17.38	13.08	7.85
15	83.56	13.94	9.64	8.67
20	70.25	11.72	7.42	8.90
25	60.90	10.16	5.86	8.79
30	53.93	9.00	4.70	8.45
35	48.52	8.09	3.79	7.96
40	44.18	7.37	3.07	7.37
45	40.63	6.78	2.48	6.69
50	37.65	6.28	1.98	5.94
55	35.12	5.86	1.56	5.14
60	32.94	5.49	1.19	4.30
65	31.04	5.18	0.88	3.42
70	29.37	4.90	0.60	2.52
75	27.89	4.65	0.35	1.58
90	24.29	4.05	-0.25	-1.34
105	21.58	3.60	-0.70	-4.41
120	19.47	3.25	-1.05	-7.58
135	17.76	2.96	-1.34	-10.83
150	16.36	2.73	-1.57	-14.14

Private Access Road - 30 Frank Nighbor Place				
Project No. 117193				
REQUIRED STORAGE - 1:100 YEAR EVENT				
AREA A-4 Controlled Flow-Parking Lot Storage				
OTTAWA IDF CURVE				
Area = 0.090 ha		Qallow = 4.4 L/s		
C = 0.75		Vol(max) = 23.3 m3		
Time (min)	Intensity (mm/hr)	Q (L/s)	Qnet (L/s)	Vol (m3)
5	242.70	45.54	41.14	12.34
10	178.56	33.51	29.11	17.46
15	142.89	26.81	22.41	20.17
20	119.95	22.51	18.11	21.73
25	103.85	19.49	15.09	22.63
30	91.87	17.24	12.84	23.11
35	82.58	15.50	11.10	23.30
40	75.15	14.10	9.70	23.28
45	69.05	12.96	8.56	23.10
50	63.95	12.00	7.60	22.80
55	59.62	11.19	6.79	22.40
60	55.89	10.49	6.09	21.92
65	52.65	9.88	5.48	21.37
70	49.79	9.34	4.94	20.76
75	47.26	8.87	4.47	20.10
90	41.11	7.71	3.31	17.90
105	36.50	6.85	2.45	15.43
120	32.89	6.17	1.77	12.76
135	30.00	5.63	1.23	9.95
150	27.61	5.18	0.78	7.03

Structures	Size (mm)	Area (m²)	T/G	Inv IN	Inv OUT
CB 1A	600 x 600	0.36	94.85	-	93.10
CB 1B	600 x 600	0.36	94.85	-	93.20


Area A-4: Storage Table				Underground Storage	Surface @ CB 1A		Surface @ CB 1B		Total Storage	
Elevation (m)	System Depth (m)	CB 1A Volume (m³)	CB 1B Volume (m³)	Total Volume (m³)	Ponding Area (m²)	Ponding Volume (m³)	Ponding Area (m²)	Ponding Volume (m³)	Ponding Volume (m³)	Total Volume (m³)
93.10	0.00	-	-	-	-	-	-	-	-	0
93.40	0.30	0.11	0.07	0.18	-	-	-	-	-	0.2
93.80	0.70	0.25	0.22	0.47	-	-	-	-	-	0.5
94.10	1.00	0.36	0.32	0.68	-	-	-	-	-	0.7
94.40	1.30	0.47	0.43	0.90	-	-	-	-	-	0.9
94.70	1.60	0.58	0.54	1.12	-	-	-	-	-	1.1
94.85	1.75	0.63	0.59	1.22	-	-	-	-	-	1.2
94.90	1.80				0.0	0.00	0.0	0.00	-	1.2
94.95	1.85				36.26	0.91	27.22	0.68	1.6	2.8
95.00	1.90				105.75	4.46	79.12	3.34	7.8	9.0
95.05	1.95				168.78	11.32	126.66	8.48	19.8	21.0
					234.54	21.40	186.19	16.30	37.7	38.9

Tempest LMF Model 60 Vortex ICD	
1:100 Yr	
Flow (L/s) = 4.4	
Head (m) = 1.81	
Elevation (m) = 95.01	
Outlet Pipe Dia.(mm) = 203	
Volume (m3) = 23.3	
1:5 Yr	
Flow (L/s) = 4.3	
Head (m) = 1.75	
Elevation (m) = 94.95	
Outlet Pipe Dia.(mm) = 203	
Volume (m3) = 8.9	

Maximum Ponding Depth (cm)	
1:100 Yr	16
1:5 Yr	10

Orifice Size - 1:100 yr Flow Check		
Q=0.62xAx(2gh) ^{0.5}		
	1:100 yr	Flow Check
Q (m³/s) =	0.0044	0.0044
g (m/s²) =	9.81	9.81
h (m) =	1.81	1.81
A (m²) =	0.001191385	0.00119
D (m) =	0.038947642	0.03900
D (mm) =	39	39.0

1:5 yr Flow Check		
	1:5 yr	
Q (m³/s) =	0.0043	
g (m/s²) =	9.81	
h (m) =	1.75	
A (m²) =	0.00119	
D (m) =	0.039	
D (mm) =	39	

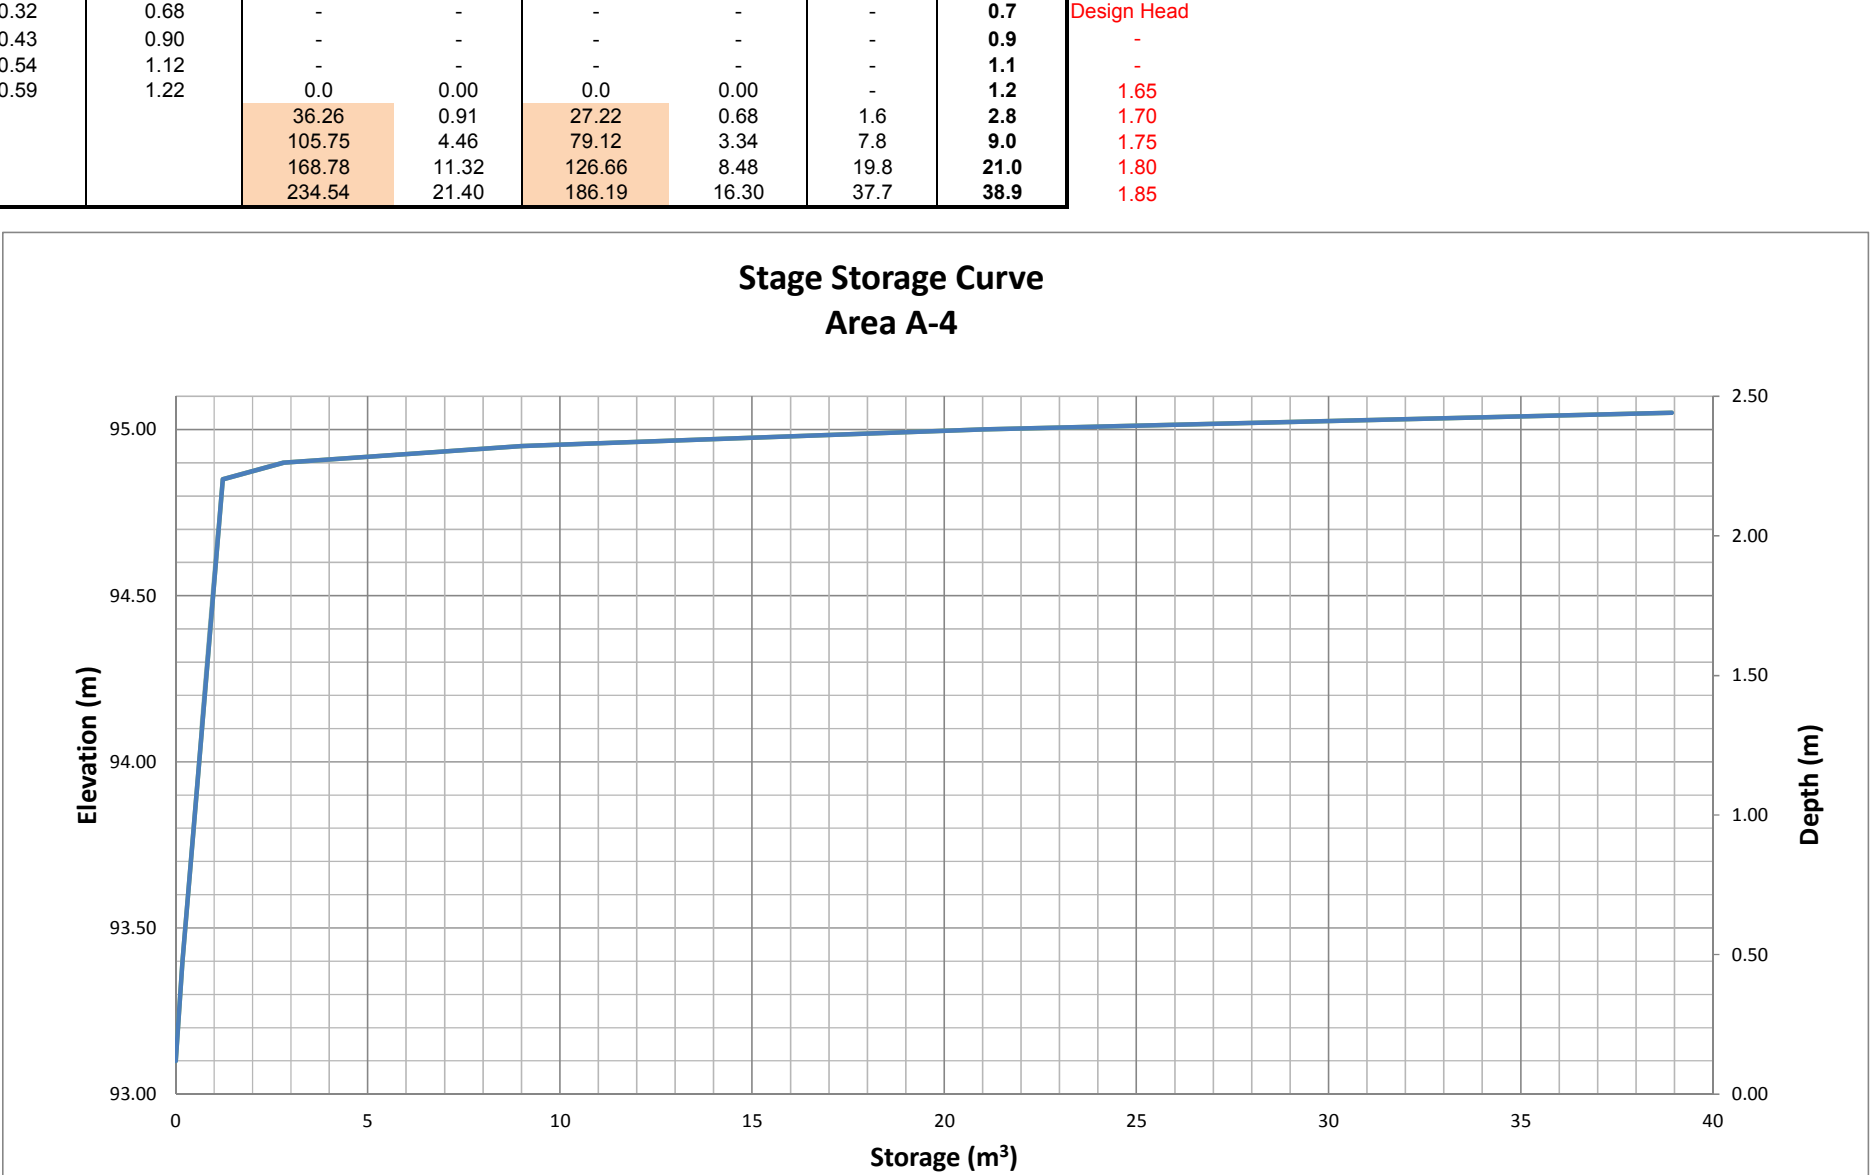

Design Head
-
-
1.65
1.70
1.75
1.80
1.85

**TERRY FOX BUSINESS PARK
STORMWATER DESIGN PLAN**

**RMOC FILE NO.: 15-90-18.07
MMA FILE NO.: 06T-90019**

**Prepared by:
NOVATECH ENGINEERING CONSULTANTS LTD.**

August 4, 1994


6.0 PROPOSED STORMWATER DESIGN CRITERIA

The storm drainage of the site will be consistent with a dual drainage concept whereby the minor drainage system relies on roadway gutters, catchbasins and storm sewers to convey 1:5 year return period flows to the Carp River outlet. On-site controls will restrict release rates to 50 L/s/ha for each developable lot which is slightly in excess of the pre-development rate. The other half of the dual drainage system is the major system drainage which will convey flows in excess of the 1:5 year flows overland via roadways and drainage swales to the Carp River or control it on-site and release it at the 5 year pre-development rate. The hydrologic analysis has indicated that neither option will increase Carp River peak flows.

The principal elements or guidelines for the stormwater design plan are as follows:

- On-site flow restricted to 50 L/s/ha maximum by a combination of roof top storage, inlet control or other devices. Individual lot developers will be required to provide on-lot grading and drainage control to attenuate site drainage to the stipulated maximum for the 5 year design event.
- Roadway catchbasins with inlet capacity for the 1:5 year design event.
- Storm sewer pipe designed to convey post-development right-of-way (R.O.W.) flows for the 1:5 year design event and the on-site flows restricted to 50 L/s/ha maximum.
- The developer will have the option of controlling the 5 year - 100 year event and releasing it through the storm sewer (at 50 L/s/ha max.) or, alternatively, releasing it uncontrolled via the major system drainage network. This shall be a site specific consideration.
- Catchbasins/manholes shall contain sumps and will require regular maintenance. Sumps may have to be cleaned out more often than a conventional parking lot drainage network.
- Future lot developers shall submit stormwater management calculations which should either be based on the modified rational method or an appropriate stormwater management model such as OTTSWMM. Calculations which should be submitted in support of the design should include:
 - i) Allowable run-off;
 - ii) Post-development run-off;
 - iii) Storage calculations (5 year);
 - iv) Method of providing storage, including volume calculations, and
 - v) Orifice and outlet weir calculations.





-
- Site grading should ensure that OSD's retain ponding without flooding buildings and maximum ponding depths in parking lots should be limited to between 0.25m and 0.30m.
 - Site developments should incorporate feasible BMP's for improved water quality such as:
 - infiltration trenches or basins
 - sumps in catchbasins and catchbasin manholes
 - grassed swales
 - If overland flow routes (major system) are incorporated in the design, then the overland major system slope should be 0.1% minimum as measured from summit to summit.
 - Existing Katimavik Road storm drainage outlet culvert will be relocated to the existing First Line Road ditch south of future Palladium Drive. Some minor re-ditching along First Line Road may be required.

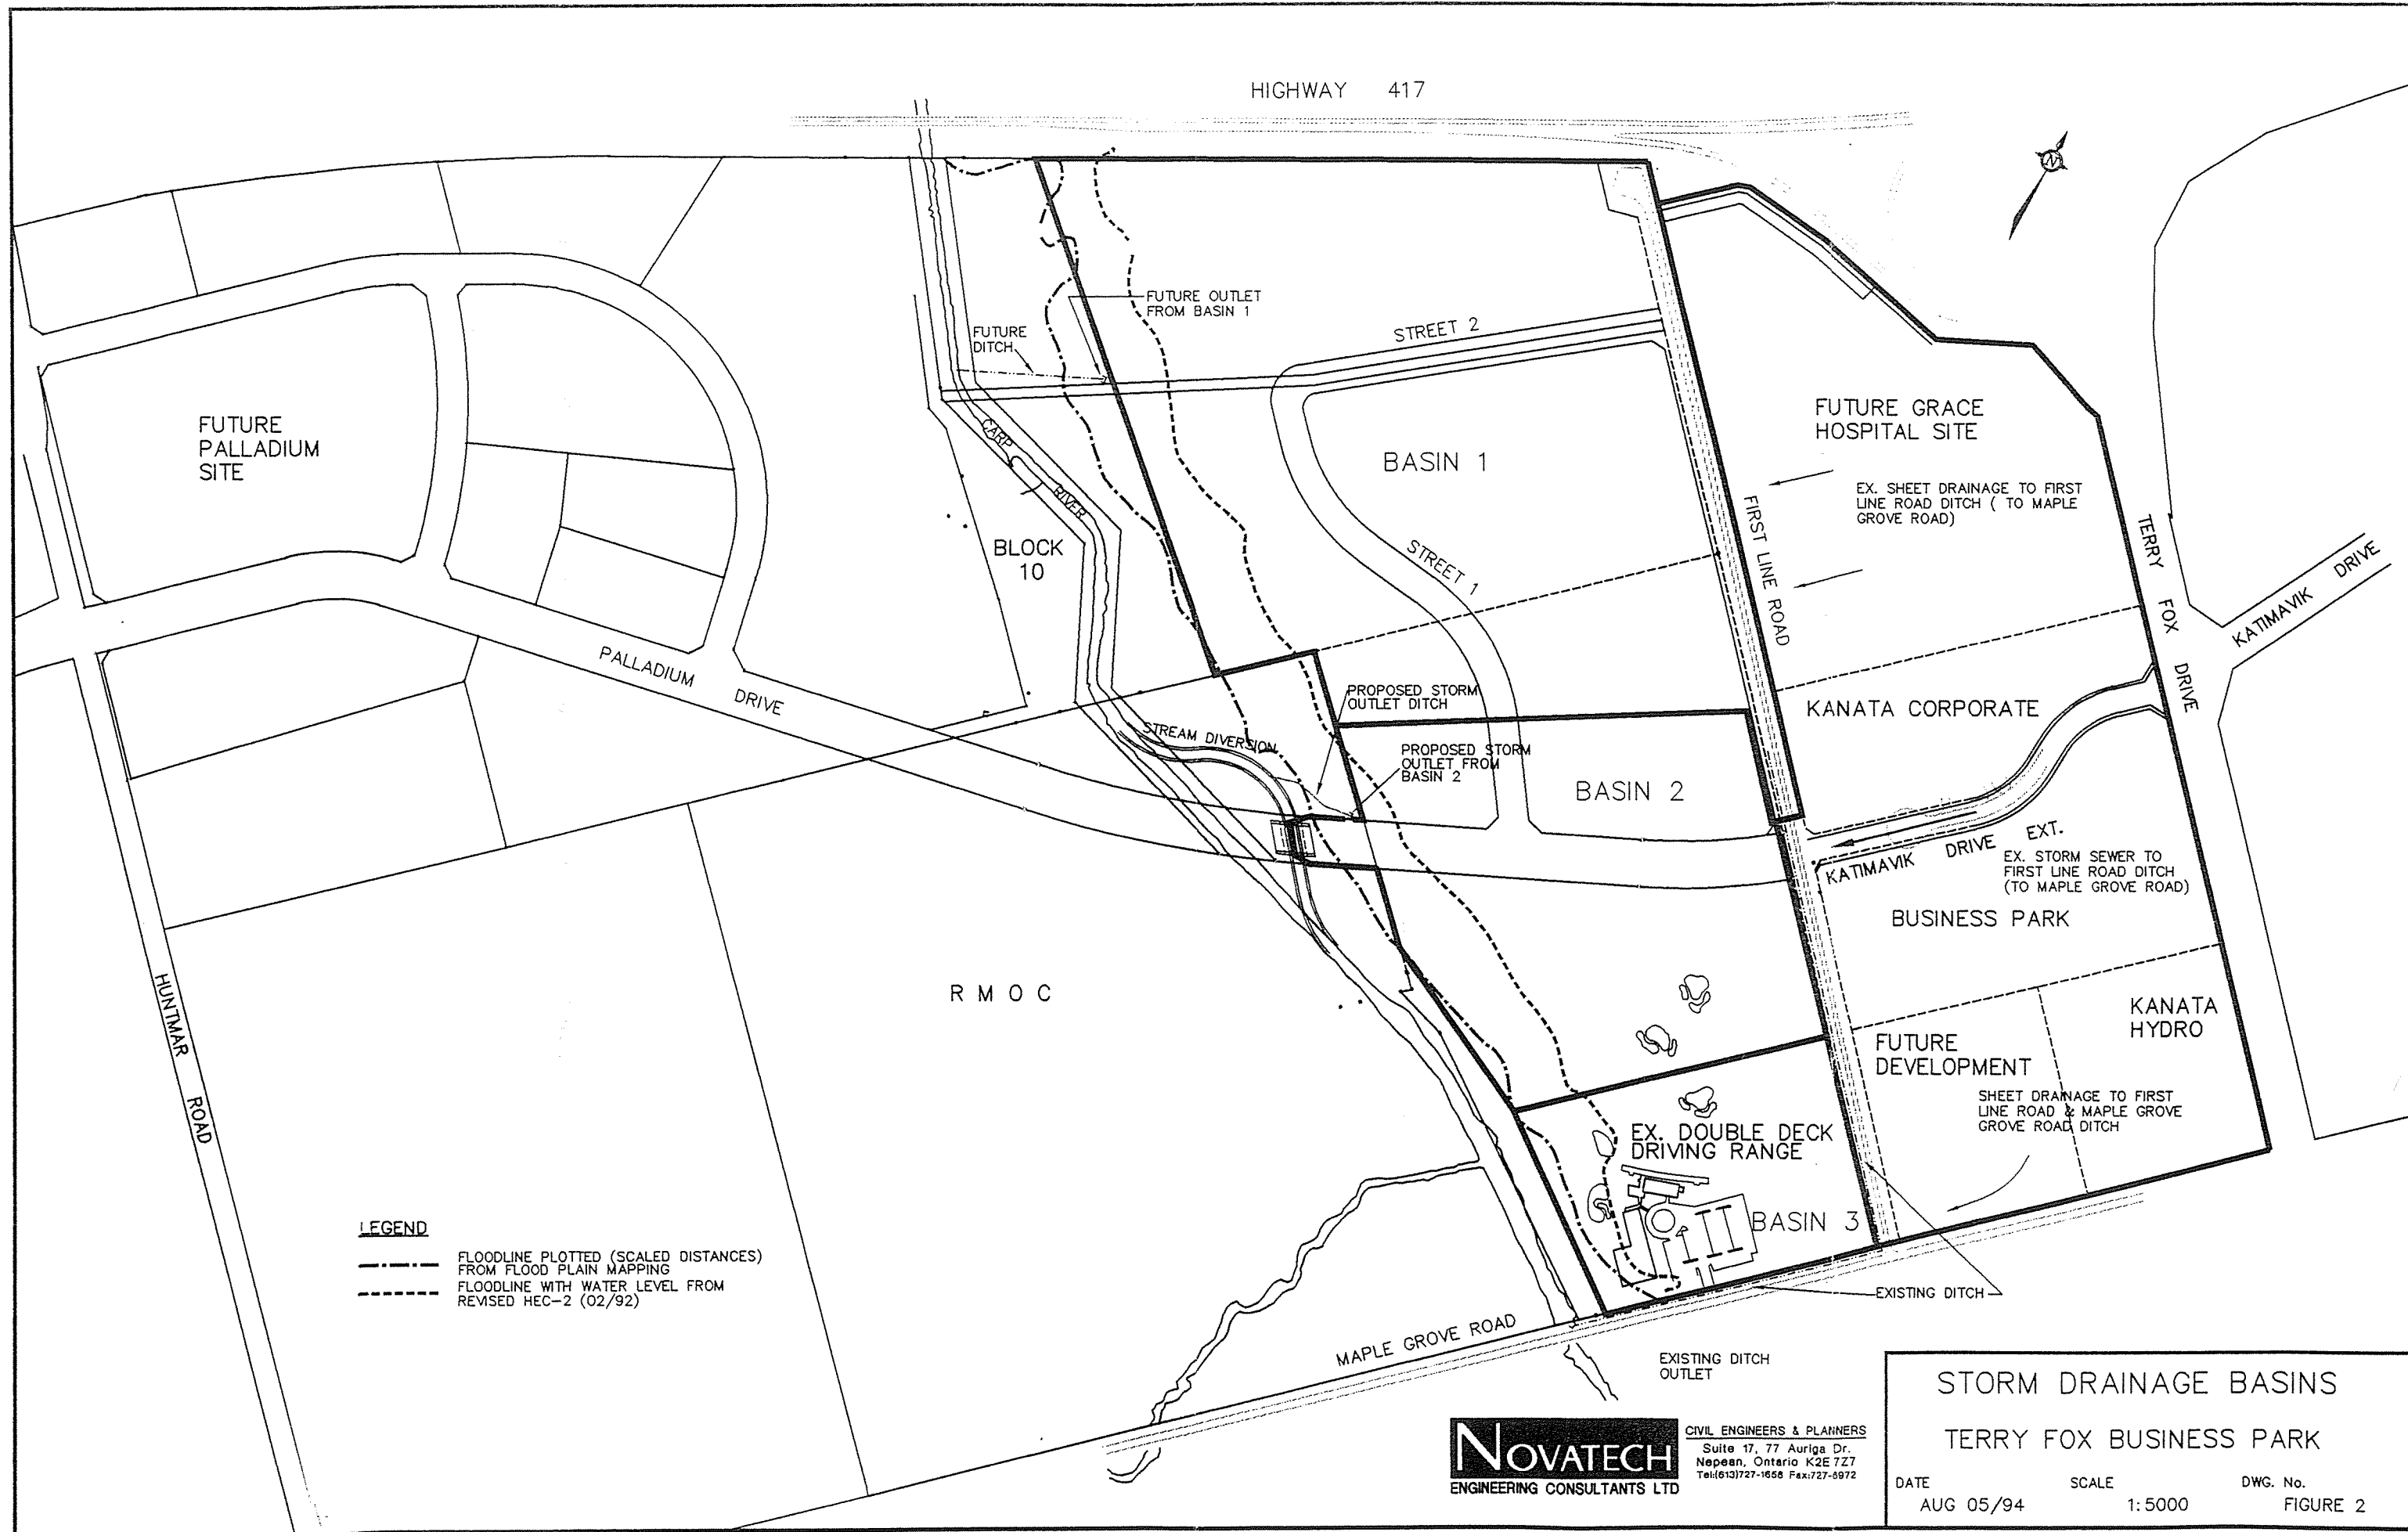


NOVATECH
ENGINEERING CONSULTANTS LTD

CIVIL ENGINEERS & PLANNERS
Suite 17, 77 Auriga Dr.
Nepean, Ontario K2E 7Z7
Tel: (613) 727-1658 Fax: 727-6972

APPENDIX E
INLET CONTROL DEVICE (ICD)
INFORMATION

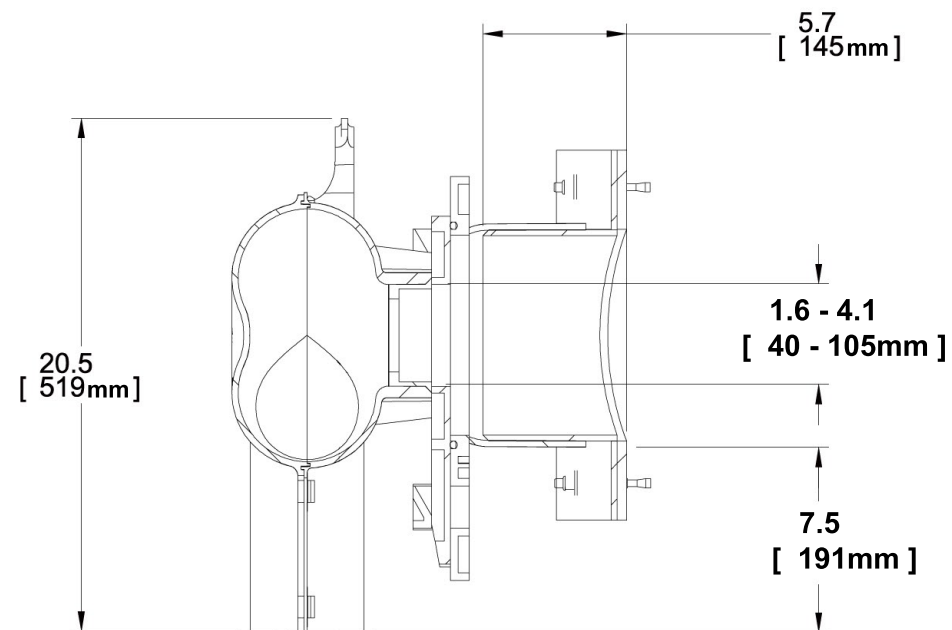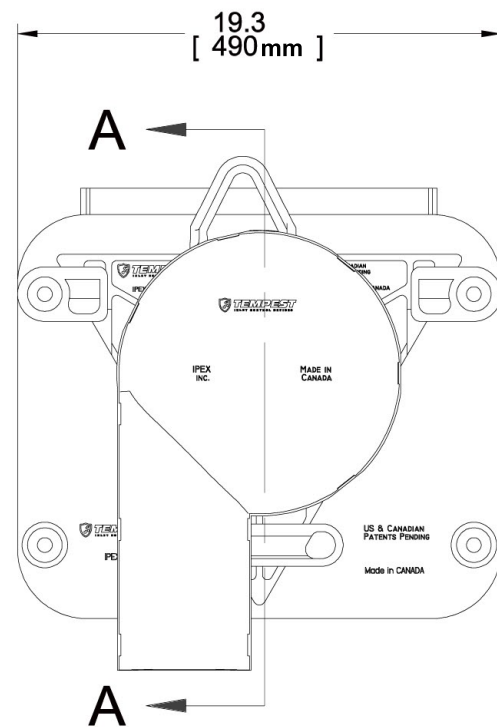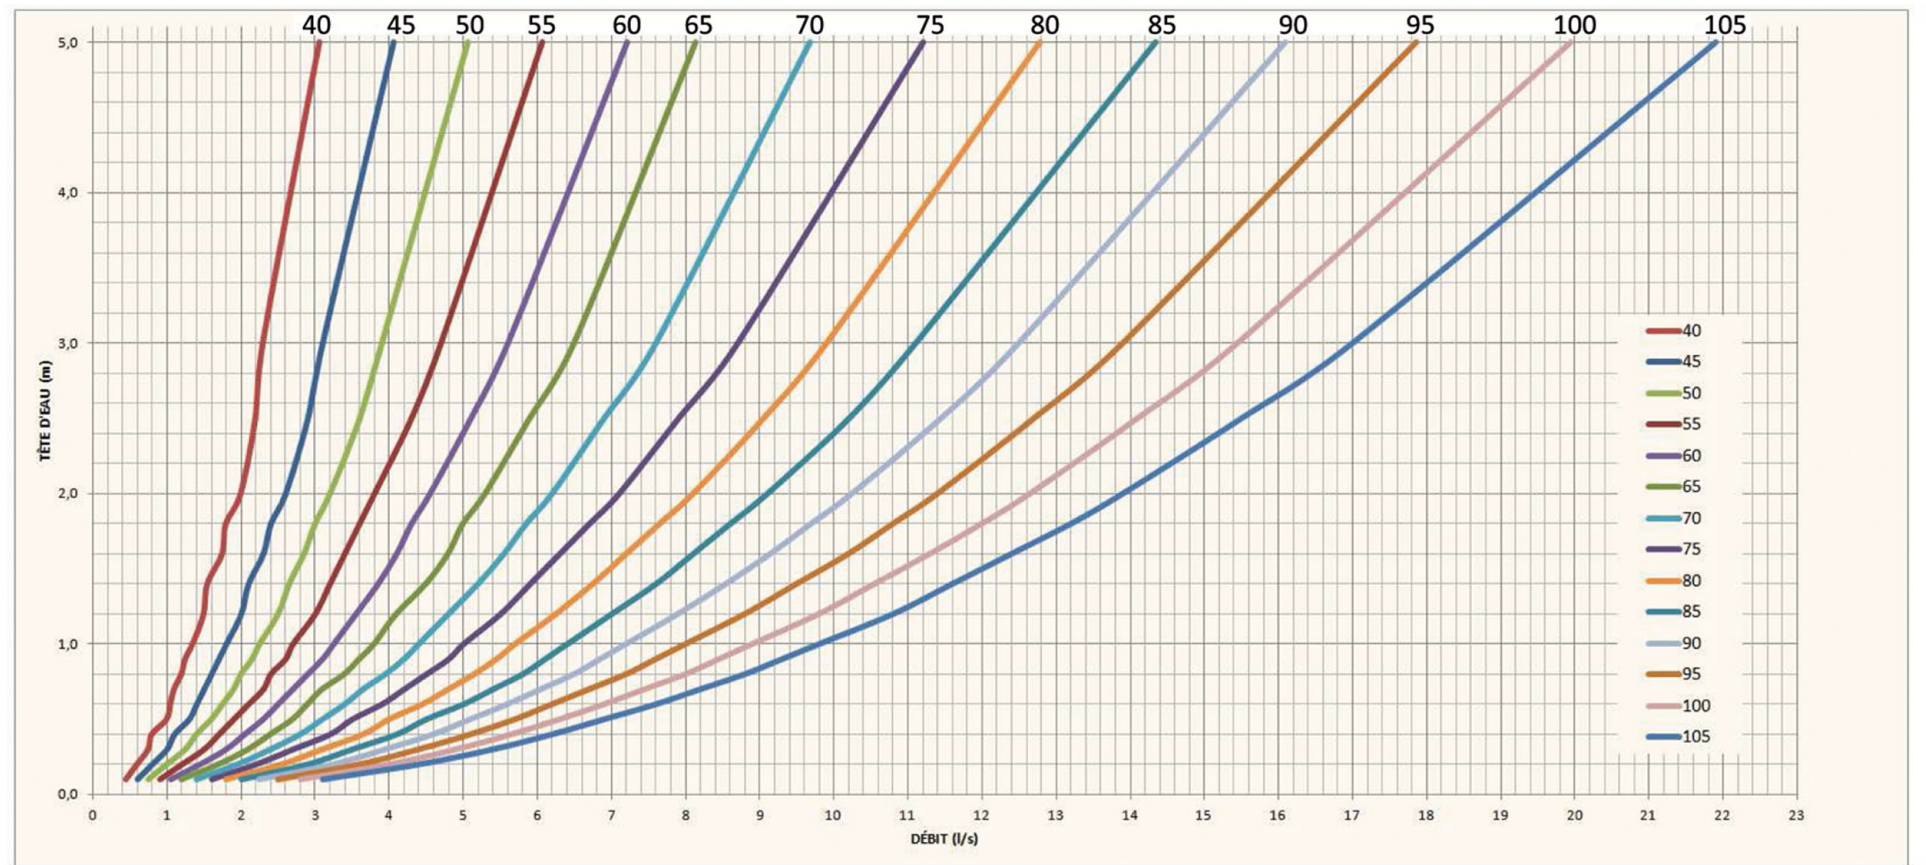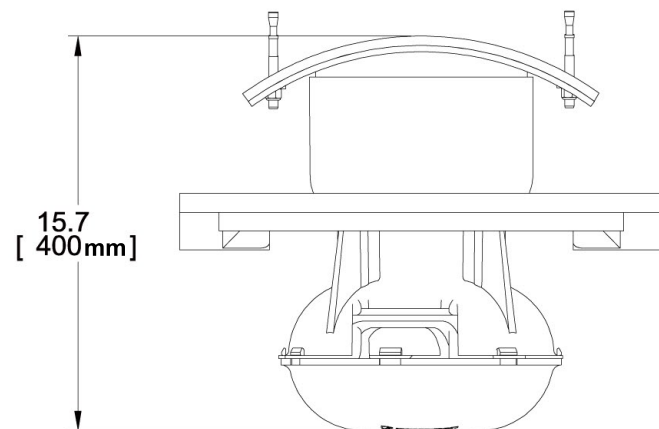

SECTION A-A

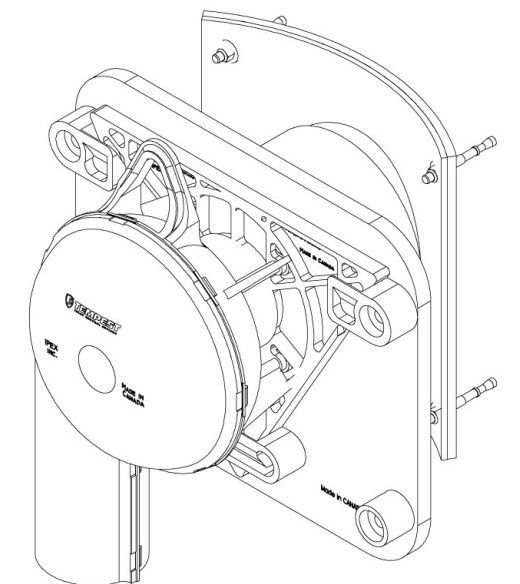

IPEX Tempest™ Inlet Control Devices

Municipal Technical Manual Series

Vol. I, 2nd Edition

© 2012 by IPEX. All rights reserved. No part of this book may be used or reproduced in any manner whatsoever without prior written permission. For information contact: IPEX, Marketing, 2441 Royal Windsor Drive, Mississauga, Ontario, Canada, L5J 4C7.

The information contained here within is based on current information and product design at the time of publication and is subject to change without notification. IPEX does not guarantee or warranty the accuracy, suitability for particular applications, or results to be obtained therefrom.

CONTENTS

TEMPEST INLET CONTROL DEVICES Technical Manual

About IPEX

Section One:	Product Information: TEMPEST Low, Medium Flow (LMF) ICD	
	Purpose	4
	Product Description	4
	Product Function	4
	Product Construction	4
	Product Applications	4
	Chart 1: LMF 14 Preset Flow Curves	5
	Chart 2: LMF Flow Vs. ICD Alternatives	5
	Product Installation	
	Instructions to assemble a TEMPEST LMF ICD into a square catch basin:	6
	Instructions to assemble a TEMPEST LMF ICD into a round catch basin:	6
	Product Technical Specification	
	General	7
	Materials	7
	Dimensioning	7
	Installation	7
Section Two:	Product Information: TEMPEST High Flow (HF) & Medium, High Flow (MHF) ICD	
	Product Description	8
	Product Function	8
	Product Construction	8
	Product Applications	8
	Chart 3: HF & MHF Preset Flow Curves	9
	Product Installation	
	Instructions to assemble a TEMPEST HF or MHF ICD into a square catch basin:	10
	Instructions to assemble a TEMPEST HF or MHF ICD into a round catch basin:	10
	Instructions to assemble a TEMPEST HF Sump into a square or round catch basin:	11
	Product Technical Specification	
	General	11
	Materials	11
	Dimensioning	11
	Installation	11

PRODUCT INFORMATION: TEMPEST LOW, MEDIUM FLOW (LMF) ICD

Purpose

To control the amount of storm water runoff entering a sewer system by allowing a specified flow volume out of a catch basin or manhole at a specified head. This approach conserves pipe capacity so that catch basins downstream do not become uncontrollably surcharged, which can lead to basement floods, flash floods and combined sewer overflows.

Product Description

Our LMF ICD is designed to accommodate catch basins or manholes with sewer outlet pipes 6" in diameter and larger. Any storm sewer larger than 12" may require custom modification. However, IPEX can custom build a TEMPEST device to accommodate virtually any storm sewer size.

Available in 14 preset flow curves, the LMF ICD has the ability to provide flow rates: 2lps – 17lps (31gpm – 270gpm)

Product Function

The LMF ICD vortex flow action allows the LMF ICD to provide a narrower flow curve using a larger orifice than a conventional orifice plate ICD, making it less likely to clog. When comparing flows at the same head level, the LMF ICD has the ability to restrict more flow than a conventional ICD during a rain event, preserving greater sewer capacity.

Product Construction

Constructed from durable PVC, the LMF ICD is light weight 8.9 Kg (19.7 lbs).

Product Applications

Will accommodate both square and round applications:

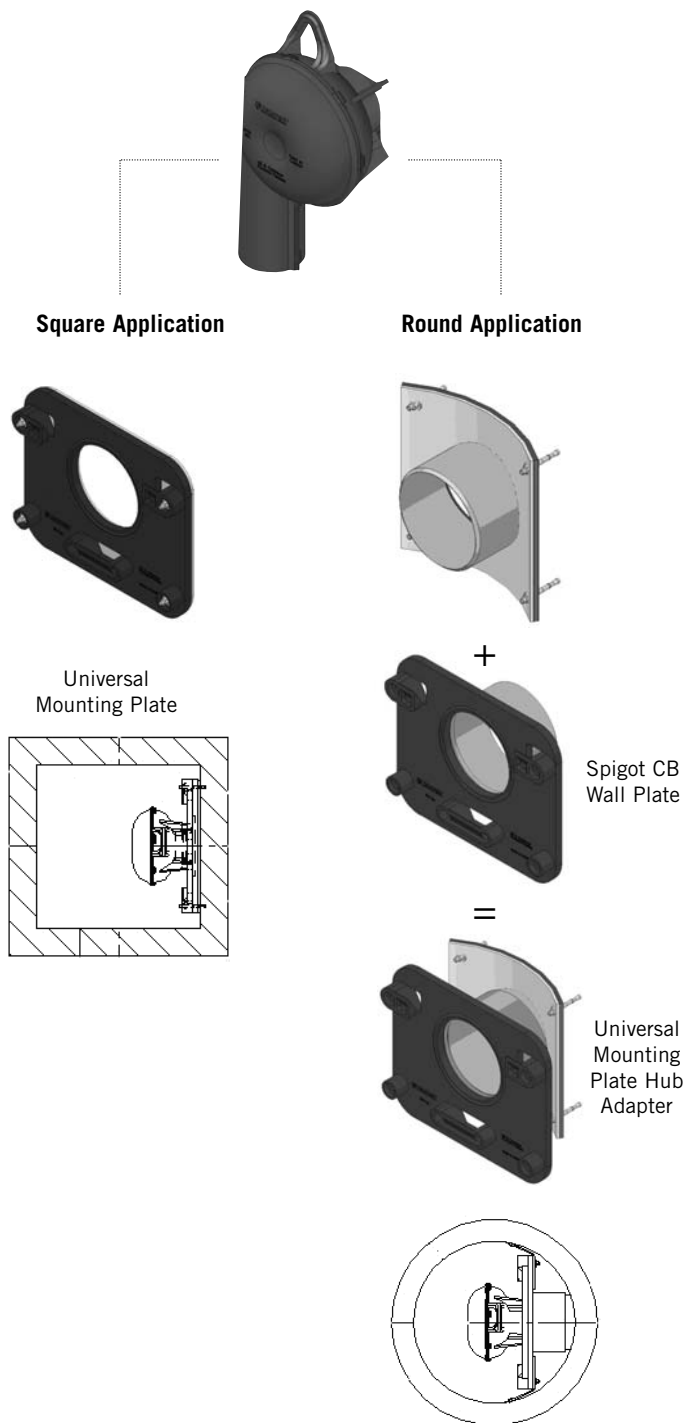


Chart 1: LMF 14 Preset Flow Curves


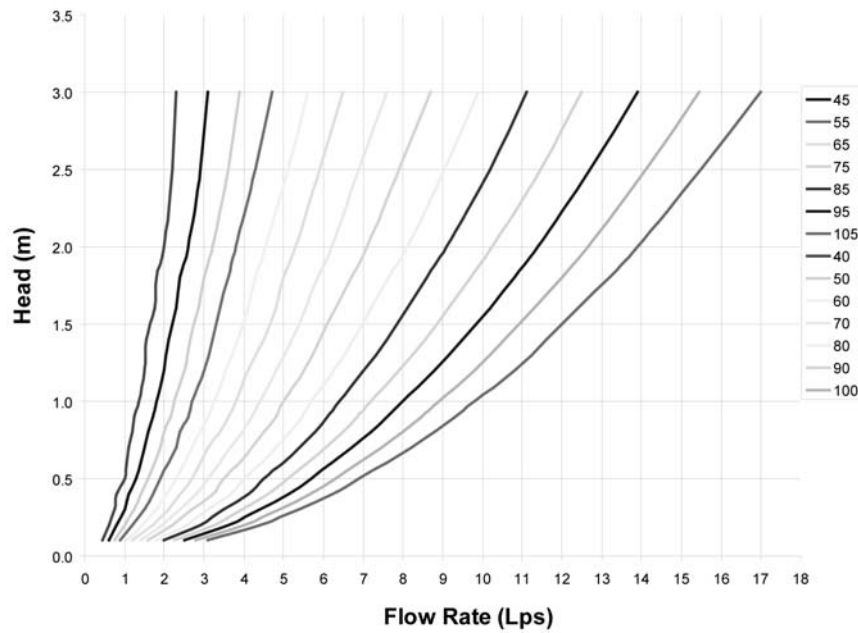


Chart 2: LMF Flow vs. ICD Alternatives

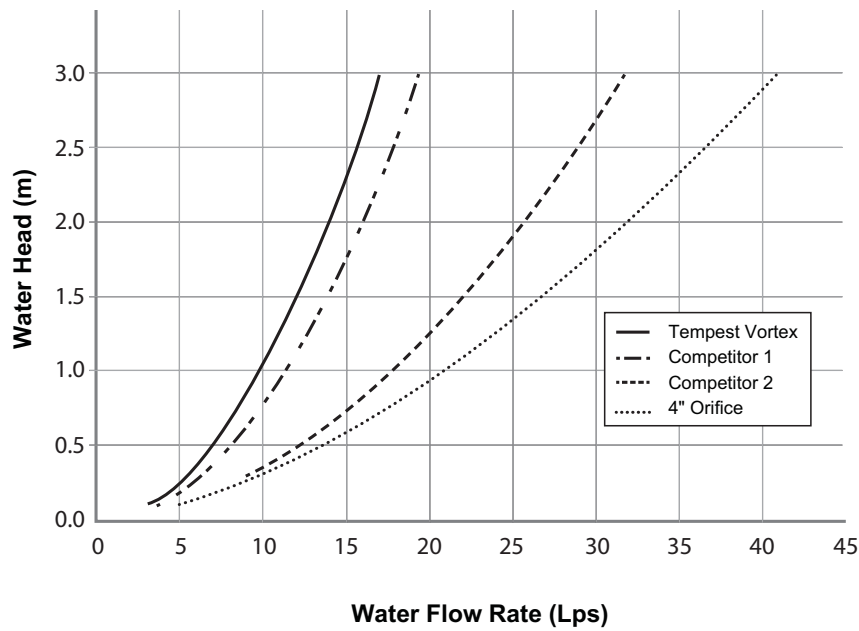

PRODUCT INSTALLATION

Instructions to assemble a TEMPEST LMF ICD into a Square Catch Basin:

STEPS:

1. Materials and tooling verification:
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, and marker.
 - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers, (4) nuts, universal mounting plate, ICD device.
2. Use the mounting wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a minimum of 1-1/2" depth up to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the universal mounting plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the wall mounting plate and the catch basin wall.
6. From the ground above using a reach bar, lower the ICD device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the universal mounting plate and has created a seal.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- Call your IPEX representative for more information or if you have any questions about our products.

Instructions to assemble a TEMPEST LMF ICD into a Round Catch Basin:

STEPS:

1. Materials and tooling verification.
 - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level and marker.
 - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers and (4) nuts, spigot CB wall plate, universal mounting plate hub adapter, ICD device.
2. Use the spigot catch basin wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a depth between 1-1/2" to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the CB spigot wall plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the spigot wall plate and the catch basin wall.
6. Apply solvent cement on the hub of the universal mounting plate, hub adapter and the spigot of the CB wall plate, then slide the hub over the spigot. Make sure the universal mounting plate is at the horizontal and its hub is completely inserted onto the spigot. Normally, the corners of the universal mounting plate hub adapter should touch the catch basin wall.
7. From ground above using a reach bar, lower the ICD device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the mounting plate and has created a seal.



WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut back the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at www.ipexinc.com.
- Call your IPEX representative for more information or if you have any questions about our products.

PRODUCT TECHNICAL SPECIFICATION

General

Inlet control devices (ICD's) are designed to provide flow control at a specified rate for a given water head level and also provide odour and floatable control. All ICD's will be IPEX Tempest or approved equal.

All devices shall be removable from a universal mounting plate. An operator from street level using only a T-bar with a hook will be able to retrieve the device while leaving the universal mounting plate secured to the catch basin wall face. The removal of the TEMPEST devices listed above must not require any unbolting or special manipulation or any special tools.

High Flow (HF) Sump devices will consist of a removable threaded cap which can be accessible from street level with out entry into the catchbasin (CB). The removal of the threaded cap shall not require any special tools other than the operator's hand.

ICD's shall have no moving parts.

Materials

ICD's are to be manufactured from Polyvinyl Chloride (PVC) or Polyurethane material, designed to be durable enough to withstand multiple freeze-thaw cycles and exposure to harsh elements.

The inner ring seal will be manufactured using a Buna or Nitrile material with hardness between Duro 50 and Duro 70.

The wall seal is to be comprised of a 3/8" thick Neoprene Closed Cell Sponge gasket which is attached to the back of the wall plate.

All hardware will be made from 304 stainless steel.

Dimensioning

The Low Medium Flow (LMF), High Flow (HF) and the High Flow (HF) Sump shall allow for a minimum outlet pipe diameter of 200mm with a 600mm deep Catch Basin sump.

Installation

Contractor shall be responsible for securing, supporting and connecting the ICD's to the existing influent pipe and catchbasin/manhole structure as specified and designed by the Engineer.

APPENDIX F

**CONTROLLED FLOW
ROOF DRAIN INFORMATION**




Z-105 CONTROL-FLOOR ROOF DRAIN w/ Parabolic Weir

SPECIFICATION SHEET

TAG _____



Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

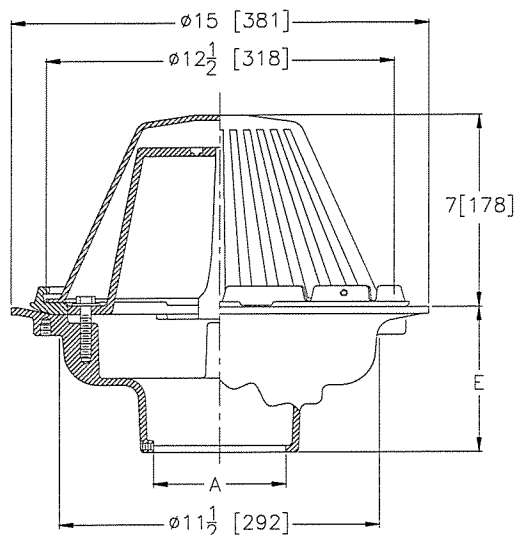

A Pipe Size Inches / [mm]	Approx. Wt. Lbs. / [kg]	Dome Open Area Sq. In. / [sq cm]
2 - 3 - 4 [51 - 76 - 102]	34 [15]	148 [955]

ENGINEERING SPECIFICATION: ZURN Z-105 "Control-Flo" roof drain for dead -level roof construction, Dura-Coated cast iron body. "Control-Flo" weir shall be linear functioning with integral membrane flashing clamp/gravel guard and Poly-Dome. All data shall be verified proportional to flow rates.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

2,3,4 [50,75,100]
2,3,4 [50,75,100]
2,3,4 [50,75,100]
2,3,4 [50,75,100]

(Specify size/type) OUTLET

_____ IC Inside Caulk
_____ IP Threaded
_____ NH No-Hub
_____ NL Neo-Loc

E BODY HT. DIM.

5 1/4 [133]
3 3/4 [95]
5 1/4 [133]
4 5/8 [117]

PREFIXES

_____ Z- D.C.C.I. Body with Poly-Dome*
_____ ZA- D.C.C.I. Body with Aluminum Dome

SUFFIXES

_____ -A Waterproof Flange
_____ -AR Acid Resistant Epoxy Coated Finish
_____ -C Underdeck Clamp
_____ -DP Top Set® Roof Deck Plate (Replaces both the -C and -R)
_____ -DR Adjustable Drain Riser Extension Assembly 3-5/8" [92] to 7-1/4" [184]
_____ -E Static Extension 1 [25] thru 4 [102] (Specify Ht.)
_____ -EA Adjustable Extension Assembly 1 3/4 [44] thru 3 1/2 [89]

_____ -EB Elevating Body Plate
_____ -G Galvanized Cast Iron
_____ -R Roof Sump Receiver
_____ -VP Vandal Proof Secured Top
_____ -90 90° Threaded Side Outlet Body

*REGULARLY FURNISHED UNLESS OTHERWISE SPECIFIED

REV. A DATE: 09/14/05 C.N. NO. 89837

DWG. NO. 63601 PRODUCT NO. Z-105

ZURN CONTROL-FLO

ROOF DRAINAGE SYSTEM



ZURN

a step ahead of tomorrow

THE ZURN "CONTROL-FLO CONCEPT"

Originally, Zurn introduced the scientifically-advanced "Control-Flo" drainage principle for dead-level roofs. Today, after thousands of successful applications in modern, large dead-level roof areas, Zurn engineers have adapted the comprehensive "Control-Flo" data to **sloped roof** areas.

WHAT IS "CONTROL-FLO"?

It is an advanced method of removing rain water off dead-level or sloped roofs. As contrasted with conventional drainage practices, which attempt to drain off storm water as quickly as it falls on the roof's surface, "Control-Flo" drains the roof at a controlled rate. Excess water accumulates on the roof under controlled conditions... then drains off at a lower rate after a storm abates.

CUTS DRAINAGE COSTS

Fewer roof drains, smaller diameter piping, smaller sewer sizes, and lower installation costs are possible with a "Control-Flo" drainage system because roof areas are utilized as temporary storage reservoirs.

REDUCES PROBABILITY OF STORM DAMAGE

Lightens load on combination sewers by reducing rate of water drained from roof tops during severe storms thereby reducing probability of flooded sewers, and consequent backflow into basements and other low areas.

THANKS TO EXCLUSIVE ZURN "AQUA-WEIR" ACTION

Key to successful "Control-Flo" drainage is a unique, scientifically-designed weir containing accurately calibrated notches with sides formed by parabolic curves which provide flow rates directly proportional to the head. Shape and size of notches are based on predetermined flow rates, and all factors involved in roof drainage to assure permanent regulation of drainage flow rates for specific geographic locations and rainfall intensities.




DEFINITION


DEAD LEVEL ROOFS

DIAGRAM "A"

A dead-level roof for purposes of applying the Zurn "Control-Flo" drainage principle is one which has been designed for zero slope across its entire surface. Measurements shown are for maximum distances.

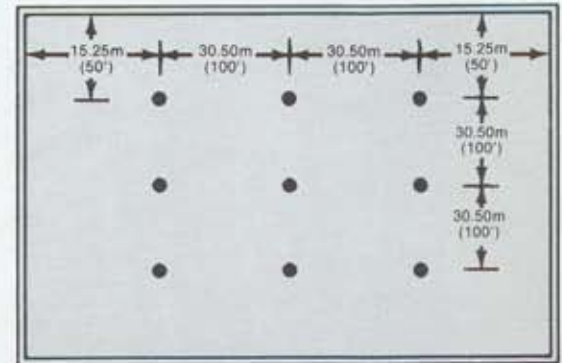

(Plan View)

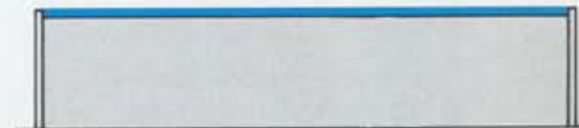

(Section View)


SLOPED ROOFS

DIAGRAM "B"


A sloped roof is one designed commonly with a shallow slope. The Zurn "Control-Flo" drainage system can be applied to any slope which results in a total rise up to 152mm (6").

The total rise of a roof as calculated for "Control-Flo" application is defined as the vertical increase in height in inches, from the low point or valley of a sloping roof (A) to the top of the sloping section (B). (Example: a roof that slopes 3mm (1/8") per foot having a 7.25m (24') span would have a rise of 7.25m x 3mm or 76mm (24' x 1/8" or 3").

Measurements shown are for maximum distances.

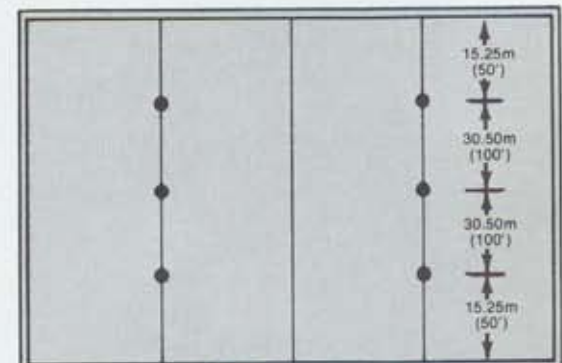

(Plan View)

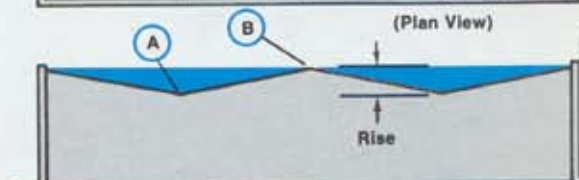


(Section View)

Dimensions and other measurements given in metric and imperial forms.

Economical Roof Drainage Installations

SPECIFICATION DATA

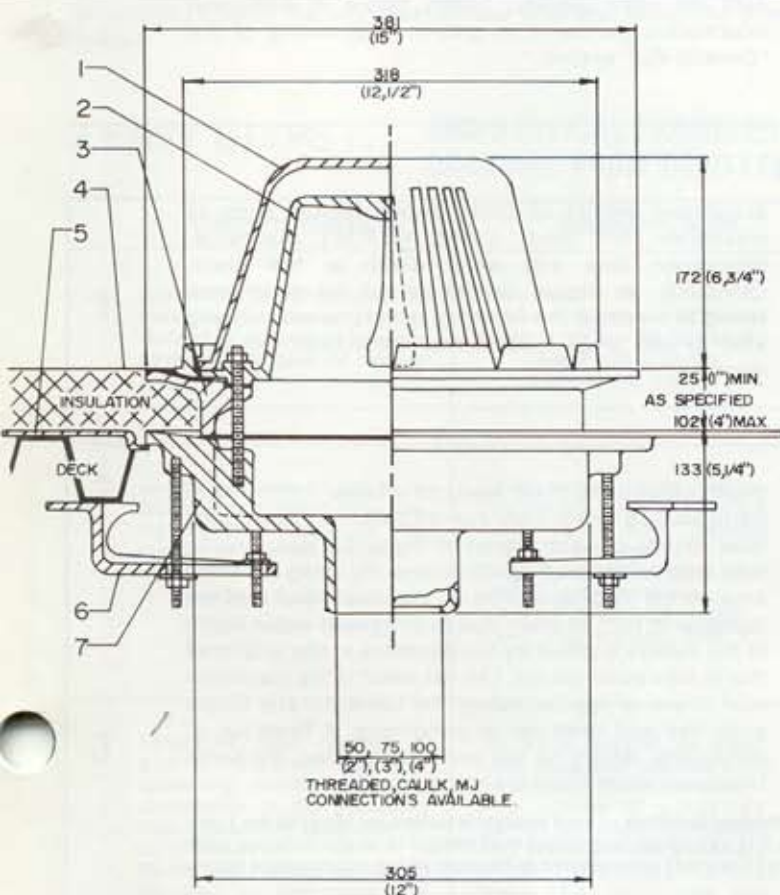

PART DESCRIPTION

- 1 — POLY-DOME
- 2 — CONTROL FLO WEIR WITH INTEGRAL CLAMP COLLAR AND GRAVEL GUARD
- 3 — E-EXTENSION WITH GASKET (WHEN SPECIFIED)
- 4 — ROOFING MEMBRANE (BY OTHERS)
- 5 — R-ROOF SUMP RECEIVER (WHEN SPECIFIED)
- 6 — C-UNDERDECK CLAMP (WHEN SPECIFIED)
- 7 — BODY

Z-105-5-ERC "Control-Flo" Dura-Coated Cast Iron Body, Aluminum Parabolic Weir With Integral Clamping Collar And Gravel Guard, Poly Dome, Extension, Roof Sump Receiver, Under Deck Clamp, Aluminum Dome Available When Specified.

ROOF DESIGN RECOMMENDATIONS

Basic roofing design should incorporate protection that will prevent roof overloading by installing adequate overflow scuppers in parapet walls.

GENERAL INFORMATION

The "Control-Flo" roof drainage data is tabulated for four areas (232.25m²(2500 sq. ft.), 464.50m²(5000 sq. ft.), 696.75m²(7500 sq. ft.), 929m²(10,000 sq. ft.) notch areas ratings) for each locality. For each notch area rating the maximum discharge in L.P.M. (G.P.M.) — draindown in hours, and maximum water depth at the drain in inches for a dead level roof — 51mm(2 inch) rise — 102mm(4 inch) rise and 152mm(6 inch) rise — are tabulated. The rise is the total change in elevation from the valley to the peak. Values for areas, rise or combination thereof other than those listed, can be arrived at by extrapolation. All data listed is based on the fifty-year return frequency storm. In other words the maximum conditions as listed will occur on the average of once every fifty years.

NOTE: The tabulated "Control-Flo" data enables the individual engineer to select his own design limiting condition. The limiting condition can be draindown time, roof load factor, or maximum water depth at the drain. If draindown time is the limiting factor because of possible freezing conditions, it must be recognized that the maximum time listed will occur on the average of once every 50 years and would most likely be during a heavy summer thunder storm. Average winter drain down times would be much shorter in duration than those listed.

GENERAL RECOMMENDATIONS

On sloping roofs, we recommend a design depth referred to as an equivalent depth. An equivalent depth is the depth of water attained at the drains that results in the same roof stresses as those realized on a dead-level roof. In all cases this equivalent depth is almost equal to that attained by using the same notch area rating for the different rises to 152mm(6"). With the same depth of water at the drain the roof stresses will decrease with increasing total rise. Therefore, it would be possible to have a depth in excess of 152mm(6") at the drain on a sloping roof without exceeding stresses normally encountered in a 152mm(6") depth on a dead-level roof. However, it is recommended that scuppers be placed to limit the maximum water depth on any roof to 152mm(6") to prevent the overflow of the weirs on the drains and consequent overloading of drain piping. In the few cases where the data shows a flow rate in excess of 136 L.P.M. (30 G.P.M.) if all drains and drain lines are sized according to recommendations, and the one storm in fifty years occurs, the only consequence will be a brief flow through the scuppers or over-flow drains.

NOTE: An equivalent depth is that depth of water attained at the drains at the lowest line or valley of the roof with all other conditions such as notch area and rainfall intensity being equal. For Toronto, Ontario a notch area rating of 464.50m²(5,000 square feet) results in a 74mm(2.9 inch) depth on a dead level roof for a 50-year storm. For the same notch area and conditions, equivalent depths for a 51mm(2"), 102mm(4") and 152mm(6") rise respectively on a sloped roof would be 86mm(3.4"), 104mm(4.1") and 124mm(4.9"). Roof stresses will be approximately equal in all cases.

The exclusive Zurn "Selecta-Drain" Chart (pages 8, 9, 10, 11) tabulates selection data for 34 localities in Canada. Proper use of this chart constitutes your best assurance of sure, safe, economical application of Zurn "Control-Flo" systems for your specific geographical area. If the "Selecta-Drain" Chart does not cover your

specific design criteria, contact Zurn Drainage and Control Systems Ltd., Weston, Ontario, for additional data for your locality. Listed below is additional information pertinent to proper engineering of the "Control-Flo" system.

ROOF USED AS TEMPORARY RETENTION

The key to economical "Control-Flo" is the utilization of large roof areas to temporarily store the maximum amount of water without overloading average roofs or creating excessive draindown time during periods of heavy rainfall. The data shown in the "Selecta-Drain" Chart enables the engineer to select notch area ratings from 232.25m²(2,500 ft.²) to 929m²(10,000 ft.²) and to

accurately predict all other design factors such as maximum roof load, L.P.M. (G.P.M.) discharge, draindown time and water depth at the drain. Obviously, as design factors permit the notch area rating to increase the resulting money saved in being able to use small leaders and drain lines will also increase.

ROOF LOADING AND RUN-OFF RATES

The four values listed in the "Selecta-Drain" Chart for notch area ratings for different localities will normally span the range of good design. If areas per notch below 232.25m²(2,500 ft.²) are used considerable economy of the "Control-Flo" concept is being lost. The area per notch is limited to 929m²(10,000 square feet) to keep the draindown time within reasonable limits. Extensive studies show that stresses due to water load on a sloping roof for any fixed set of conditions are very nearly the same as those on a dead-level roof. A sloping roof tends to concentrate more water in the valleys and increase the water depth at this point. The greater

depth around the drain leads to a faster run-off rate, particularly a faster early run-off rate. As a result, the total volume of water stored on the roof is less, and the total load on the sloping roof is less. By using the same area on the sloping roof as on the dead-level roof the increase in roof stresses due to increased water depth in the valleys is offset by the decrease in the total load due to less water stored. The net result is the maximum roof stress is approximately the same for any single span rise and fixed set of conditions. A fixed set of conditions, would be the same notch area, the same frequency storm, and the same locality.

SPECIAL CONSIDERATIONS FOR STRUCTURAL SAFETY: Normal practice of roof design is based on 18kg(40 lbs.) per 929cm²(square ft.) (subject to local codes and by-laws.) Thus it is extremely important that design is in accordance with normal load factors so deflection will be slight enough in any bay to prevent progressive deflection which could cause water depths to load the roof beyond its design limits.

ADDITIONAL NOTCH RATINGS

The "Selecta-Drain" Chart along with Tables I and II enables the engineer to select "Control-Flo" Drains and drain pipe sizes for most Canadian applications. These calculations are computed for a proportional flow weir that is sized to give a flow of 23 L.P.M. (5 G.P.M.) per inch of head. The 23 L.P.M. (5 G.P.M.) per inch of head, notch opening, is selected as the basis of design as it

offers the most economical installation as applied to actual rainfall experienced in Canada.

Should you require design criteria for locations outside of Canada, or for special project applications please contact Zurn Drainage and Control Systems Ltd., Weston, Ontario.

LEADER AND DRAIN PIPE SIZING

Since all data in the "Selecta-Drain" Chart is based on the 50-year storm it is possible to exceed the water depth listed in these charts if a 100-year or 1000-year storm would occur. Therefore, for good design it is recommended that scuppers or other methods be used to limit water depth to the design depth and tables I and II be used to size the leaders and drain pipes. If the roof

is capable of supporting more water than the design depth it is permissible to locate the scuppers or other overflow means at a height that will allow a greater water depth on the roof. However, in this case the leader and drain pipes should be sized to handle the higher flow rates possible based on a flow rate of 23 L.P.M. (5 G.P.M.) per inch of depth at the drain.

PROPER DRAIN LOCATION

The following good design practice is recommended for selecting the proper number of "Control-Flo" drains for a given area. **On dead-level roofs**, drains should be located no further than 15.25m(50 feet) from edge of roof and no further than 30.50m(100 feet) between drains. See diagram "A" page 2. **On sloping roofs**,

drains should be located in the valleys at a distance no greater than 15.25m(50 feet) from each end of the valleys and no further than 30.50m(100 feet) between drains. See diagram "B" page 2. Compliance with these recommendations will assure good run off regardless of wind direction.

Saves Specification Time, Assures Proper Application

QUICK, EASY SELECTION

Using the "Selecta-Drain" Chart (pages 8, 9, 10, 11) in combination with the steps and examples appearing below, should save you countless hours in engineering specification time. This vast compilation of data is related to the proper selection of drains for 34 cities. All cities in alphabetical order by Provinces. If a specific city does not appear in this tabulation, choose the city nearest your area and select the proper drain using these factors.



3 EASY STEPS ... AND 3 TYPICAL EXAMPLES FOR APPLICATION OF SURE, SCIENTIFIC CONTROL OF DRAINAGE FROM DEAD-LEVEL AND SLOPING ROOFS WITH THE ZURN CONCEPT

TORONTO, ONTARIO	DEAD-LEVEL ROOF	102mm(4 INCH) SLOPE	152mm(6 INCH) SLOPE
1 Determine total roof area or individual areas when roof is divided by expansion joints or peaks in the case of sloping roof.	Roof Area: $58.52\text{m} \times 152.40\text{m} = 8918.40\text{m}^2$ $(192\text{ft} \times 500\text{ft} = 96,000 \text{ sq. ft.})$ (See Z-105-5 layout bottom this page.)	3 Individual Roof Areas: $19.50\text{m} \times 152.40\text{m} = 2972.80\text{m}^2$ $(64\text{ft} \times 500\text{ft} = 32,000 \text{ sq. ft.})$ Valleys $152.40\text{m}(500 \text{ ft.})$ long $3 \times 2972.80 = 8918.40\text{m}^2$ $(3 \times 32,000 = 96,000 \text{ sq. ft.})$	2 Individual Roof Areas: $29.87\text{m} \times 152.40\text{m} = 4552\text{m}^2$ $(98 \text{ ft.} \times 500 \text{ ft.} = 49,000 \text{ sq. ft.})$ Valleys $152.40\text{m}(500 \text{ ft.})$ long $2 \times 4552 = 9104\text{m}^2$ $(2 \times 49,000 = 98,000 \text{ sq. ft.})$
2 Divide roof area or individual areas by Zurn Notch Area Rating selected to obtain the total number of notches required.	Zurn Notch Area Rating selected for Toronto= 464.50m^2 (5,000 sq.ft.) from "Selecta-Drain" Chart, page 11. Total Roof Area= 8918.40m^2 (96,000 sq.ft.) Entire roof. 464.50m^2 (5,000 sq.ft.) notch area = 19.2 notches - USE 20	Zurn Notch Area Rating selected for Toronto= 464.50m^2 (5,000 sq.ft.) from "Selecta-Drain" Chart, page 11. Total Roof Area= 2972.80m^2 (32,000 sq.ft.) Each area. 464.50m^2 (5,000 sq.ft.) notch area = 6.4 notches - USE 7 PER AREA	Zurn Notch Area Rating selected for Toronto= 464.50m^2 (5,000 sq.ft.) from "Selecta-Drain" Chart, page 11. Total Roof Area= 4552m^2 (49,000 sq.ft.) Each area. 464.50m^2 (5,000 sq.ft.) notch area = 9.8 notches - USE 10 PER AREA
3 Determine total number of drains required by not exceeding maximum spacing dimensions in the preceding instructions. See Diagrams "A" or "B", page 2. Divide total number of notches required to determine the number of notches per drain. Note maximum water depth at drain and use this dimension to determine scupper height. Maximum scupper height to be used is 152mm(6"). Use this flow rate to size leaders and drain lines.	*10 drains required. All drains must have two notches each for a total of 20 notches. Flow rate is 66 L.P.M. (14.5 G.P.M.) per notch. Size leaders for 2 notch weirs for a flow rate of 66 L.P.M. (14.5 G.P.M.) 50mm (Two inch) pipe size leaders required. Maximum water depth and scupper height is 74 mm (2.9 inches). Requires 19 hrs. draindown time max. For drain, vertical, and horizontal pipe sizing data see Tables I and II on pages 6 and 7.	**5 drains per area required located in the valleys 15.25m(50 ft.) from each end with 3 in the middle at 30.50m(100ft.) spacings. Two drains on ends with two notches—3 drains in middle one notch each for a total of 7 notches. Maximum flow rate 93 L.P.M. (20.5 G.P.M.) per notch. Leader size 50mm(2") for single notch weirs—75mm(3") notch weirs. Maximum water depth and scupper height is 104mm(4.1 inches). Requires 11 hrs. draindown time max. For drain, vertical, and horizontal pipe sizing data see Tables I and II on pages 6 and 7.	**5 drains per area required located in the valleys 15.25m(50 ft.) from each end with 3 at 30.50m(100 ft.) spacing in the middle. 10 notches are required therefore all drains must have two notches. Flow rate is 111 L.P.M. (24.5 G.P.M.) per notch. Size all leaders for 2 notch weirs. 75mm(3 inch) pipe size required. Maximum water depth and scupper height is 124mm (4.9 inches). Requires 9 hrs. draindown time max. For drain, vertical, and horizontal pipe sizing data see Tables I and II on pages 6 and 7.

*See Diagram "A" page 2 for recommended drain placement.

**See Diagram "B" page 2 for recommended drain placement.

DEAD LEVEL ROOF 6mm(1/4") PER FT. SLOPE STORM DRAIN

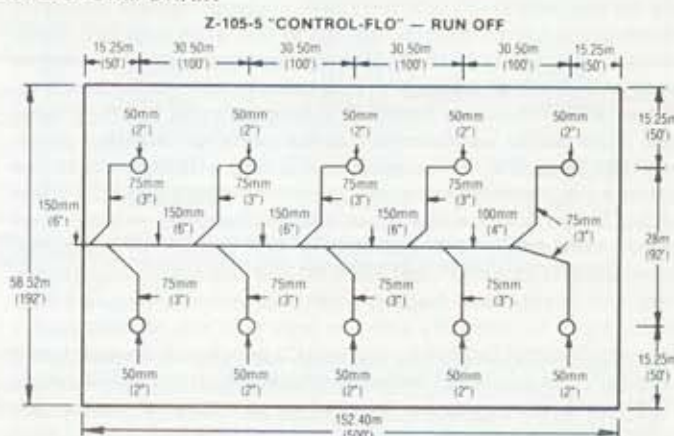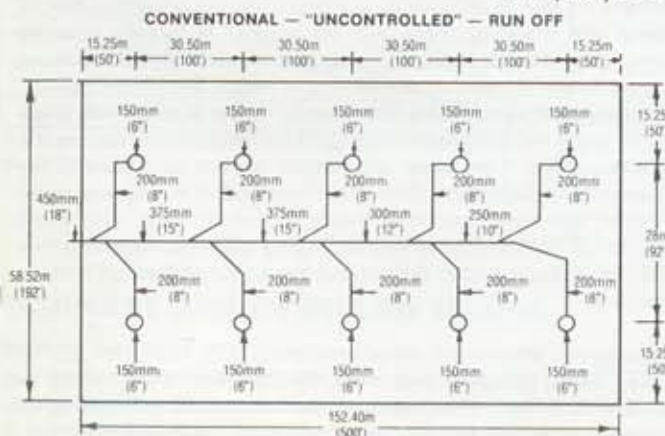

Saves Specification Time, Assures Proper Application

QUICK, EASY SELECTION

Using the "Selecta-Drain" Chart (pages 8, 9, 10, 11) in combination with the steps and examples appearing below, should save you countless hours in engineering specification time. This vast compilation of data is related to the proper selection of drains for 34 cities. All cities in alphabetical order by Provinces. If a specific city does not appear in this tabulation, choose the city nearest your area and select the proper drain using these factors.



3 EASY STEPS ... AND 3 TYPICAL EXAMPLES FOR APPLICATION OF SURE, SCIENTIFIC CONTROL OF DRAINAGE FROM DEAD-LEVEL AND SLOPING ROOFS WITH THE ZURN CONCEPT

TORONTO, ONTARIO	DEAD-LEVEL ROOF	102mm(4 INCH) SLOPE	152mm(6 INCH) SLOPE
1 Determine total roof area or individual areas when roof is divided by expansion joints or peaks in the case of sloping roof.	Roof Area: $58.52\text{m} \times 152.40\text{m} = 8918.40\text{m}^2$ $(192\text{ft} \times 500\text{ft} = 96,000 \text{ sq.ft.})$ (See Z-105-5 layout bottom this page.)	3 Individual Roof Areas: $19.50\text{m} \times 152.40\text{m} = 2972.80\text{m}^2$ $(64\text{ft} \times 500\text{ft} = 32,000 \text{ sq.ft.})$ Valleys $152.40\text{m}(500 \text{ ft.})$ long $3 \times 2972.80 = 8918.40\text{m}^2$ $(3 \times 32,000 = 96,000 \text{ sq.ft.})$	2 Individual Roof Areas: $29.87\text{m} \times 152.40\text{m} = 4552\text{m}^2$ $(98 \text{ ft.} \times 500 \text{ ft.} = 49,000 \text{ sq. ft.})$ Valleys $152.40\text{m}(500 \text{ ft.})$ long $2 \times 4552 = 9104\text{m}^2$ $(2 \times 49,000 = 98,000 \text{ sq.ft.})$
2 Divide roof area or individual areas by Zurn Notch Area Rating selected to obtain the total number of notches required.	Zurn Notch Area Rating selected for Toronto= 464.50m^2 (5,000 sq.ft.) from "Selecta-Drain" Chart, page 11. Total Roof Area= 8918.40m^2 (96,000 sq.ft.) Entire roof. 464.50m^2 (5,000 sq.ft.) notch area = 19.2 notches - USE 20	Zurn Notch Area Rating selected for Toronto= 464.50m^2 (5,000 sq.ft.) from "Selecta-Drain" Chart, page 11. Total Roof Area= 2972.80m^2 (32,000 sq.ft.) Each area. 464.50m^2 (5,000 sq.ft.) notch area = 6.4 notches - USE 7 PER AREA	Zurn Notch Area Rating selected for Toronto= 464.50m^2 (5,000 sq.ft.) from "Selecta-Drain" Chart, page 11. Total Roof Area= 4552m^2 (49,000 sq.ft.) Each area. 464.50m^2 (5,000 sq.ft.) notch area = 9.8 notches - USE 10 PER AREA
3 Determine total number of drains required by not exceeding maximum spacing dimensions in the preceding instructions. See Diagrams "A" or "B", page 2. Divide total number of notches required to determine the number of notches per drain. Note maximum water depth at drain and use this dimension to determine scupper height. Maximum scupper height to be used is 152mm(6"). Use this flow rate to size leaders and drain lines.	*10 drains required. All drains must have two notches each for a total of 20 notches. Flow rate is 66 L.P.M. (14.5 G.P.M.) per notch. Size leaders for 2 notch weirs for a flow rate of 66 L.P.M. (14.5 G.P.M.) 50mm (Two inch) pipe size leaders required. Maximum water depth and scupper height is 74 mm (2.9 inches). Requires 19 hrs. draindown time max. For drain, vertical, and horizontal pipe sizing data see Tables I and II on pages 6 and 7.	**5 drains per area required located in the valleys 15.25m(50 ft.) from each end with 3 in the middle at 30.50m(100ft.) spacings. Two drains on ends with two notches—3 drains in middle one notch each for a total of 7 notches. Maximum flow rate 93 L.P.M. (20.5 G.P.M.) per notch. Leader size 50mm(2") for single notch weirs—75mm(3") notch weirs. Maximum water depth and scupper height is 104mm(4.1 inches). Requires 11 hrs. draindown time max. For drain, vertical, and horizontal pipe sizing data see Tables I and II on pages 6 and 7.	**5 drains per area required located in the valleys 15.25m(50 ft.) from each end with 3 at 30.50m(100 ft.) spacing in the middle. 10 notches are required therefore all drains must have two notches. Flow rate is 111 L.P.M. (24.5 G.P.M.) per notch. Size all leaders for 2 notch weirs. 75mm(3 inch) pipe size required. Maximum water depth and scupper height is 124mm (4.9 inches). Requires 9 hrs. draindown time max. For drain, vertical, and horizontal pipe sizing data see Tables I and II on pages 6 and 7.

*See Diagram "A" page 2 for recommended drain placement.

**See Diagram "B" page 2 for recommended drain placement.

DEAD LEVEL ROOF 6mm(1/4") PER FT. SLOPE STORM DRAIN

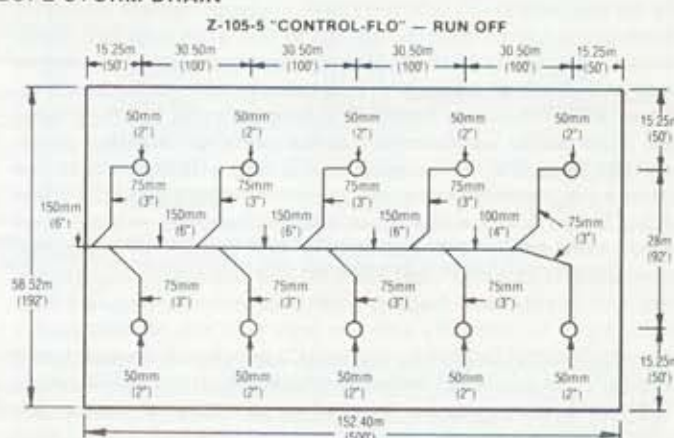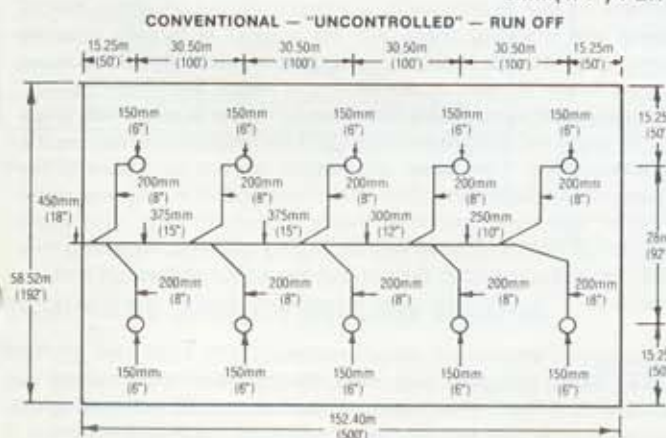

ROOF DRAINAGE DATA

The flow rate for any design condition can be easily read from the data contained on the following pages; the tabulations shown below (and on the opposite page) can be used to simplify selection of drain line sizes.

TABLE 1—SUGGESTED RELATION OF DRAIN OUTLET AND VERTICAL LEADER SIZE TO ZURN CONTROL-FLO ROOF DRAINS (BASED ON NATIONAL PLUMBING CODE ASA-A40.8 DATA ON VERTICAL LEADERS).

No. of Notches in Drain	Max. Flow per Notch in L.P.M. (G.P.M.)		
	Pipe Size		
	50mm (2")	75mm (3")	100mm (4")
1	136* (30")	—	—
2	68 (15)	136* (30")	—
3	45 (10)	136* (30")	—
4	—	105 (23)	136* (30")
5	—	82 (18)	136* (30")
6	—	68 (15)	136* (30")

*Maximum flow obtainable from 1 notch with 152mm(six inch) water depth at drain.

Table II should be used to select **horizontal** storm drain piping. Use the same flow rate 66 L.P.M. (14.5 G.P.M.) used to establish the vertical leaders to size the storm drainage system and main storm drain. Let us assume the ten drains each with two notch weirs were actually on the roof in two separate lines of five drains each and joined at a common point before leaving the building. Since Table II includes 3mm(1/8"), 6mm(1/4") and 13mm(1/2") per foot slope, **let us use 6mm(1/4") as our basis for selection** which will take us to the centre section. Starting with the first of five drains we enter the extreme left column in Table II and read down to the figure 2 since this drain has two notches in weir, read across horizontally and the size of first section of horizontal storm drain is 75mm(3") between 1st and 2nd drain, return to left hand column proceed reading down until you reach figure 4 then read across horizontally and the pipe size will be 100mm(4") between 2nd and 3rd drain, 100mm(4") between 3rd and 4th and 125mm(5") (if available) between 4th and 5th. If not available use 150mm(6"). (You may be tempted to use 100m(4") since the capacity is close. We recommend you go to the larger size.) Pipe

Table 1 should be used to select **vertical drain** leaders which at the same time establishes the drain outlet size. This table illustrates the maximum flow per notch in L.P.M. (G.P.M.) Since the Z-105-5 drain is available with a minimum of one and a maximum of six notches, calculations have already been made and are listed in this table for any quantity of weir notch openings established in your design. It was determined ten drains with two notches each weir would be required in Dead-Level Roof example on page 5. A 66 L.P.M. (14.5 G.P.M.) discharge per notch flow rate was also established.

Once this design criteria has been determined it will be the key to the proper selection of all drain outlet sizes, vertical and horizontal storm drain sizes in Table I and II. Enter the column "Number of Notches in Drain", Table I, read down the column to the figure 2 which indicates two notches in weir, then read across until you reach a figure equal to or closest figure in excess of 66 L.P.M. (14.5 G.P.M.) You will find fifteen in the column under 50mm(2") which represents the pipe size. Therefore all drain outlets and vertical leaders are 50mm(2") size.

Let us digress for a moment assuming a specific structure requires a total of six drains each containing a weir with a different number of notches. One with 1, one with 2, etc. Table 1 discloses the pipe size for one notch is 50mm(2"), two notch is 50mm(2"), three notch is 75mm(3"), four notch is 75mm(3"), five notch is 75mm(3") and six notch is 75mm(3") as they all equal or closely exceed the 66 L.P.M. (14.5 G.P.M.) design.

NOTE: Although pipe size calculations should be based on accumulated flow rate, local by-laws should be referred to for minimum pipe size requirements and roof drain spacing.

size leaving 5th drain would be 150mm(6"). The same sizing would hold true for the second line of five drains. Since both columns of five drains each are being joined together before leaving the building there will be a total of twenty notches discharging into the main building storm sewer. Enter left hand column Table II, read down until you reach the figure twenty, then read across horizontally to the 6mm(1/4") per 305mm(foot) slope column and you will see a 150mm(6") storm drain will handle the job adequately. The same procedure should be followed for sloped roof installations. The above method of sizing was done to better acquaint you with Table II and its use. The more economical and practical way of laying out and installing this same job is illustrated in the control-flo layout shown on bottom of page 5.

NOTE: Although pipe size calculations should be based on accumulated flow rates, local by-laws should be referred to for minimum pipe size requirements and roof drain spacing.

Select Proper Horizontal Storm Drain Piping

TABLE II —SUGGESTED RELATION OF HORIZONTAL STORM DRAIN SIZE TO ZURN CONTROL-FLO ROOF DRAINAGE

Total No. of Notches Discharging to Storm Drain	MAX. FLOW PER NOTCH IN L.P.M. (G.P.M.)									MAX. FLOW PER NOTCH IN L.P.M. (G.P.M.)									MAX. FLOW PER NOTCH IN L.P.M. (G.P.M.)								
	Storm Drain Size 3mm(1/8") per 305mm(12") slope									Storm Drain Size 6mm(1/4") per 305mm(12") slope									Storm Drain Size 13mm(1/2") per 305mm(12") slope								
	75 (3")	100 (4")	125 (5")	150 (6")	200 (8")	250 (10")	300 (12")	375 (15")		75 (3")	100 (4")	125 (5")	150 (6")	200 (8")	250 (10")	300 (12")			75 (3")	100 (4")	125 (5")	150 (6")	200 (8")	250 (10")	300 (12")		
1	136(30)	—	—	—	—	—	—	—	136(30)	—	—	—	—	—	—	—	136(30)	—	—	—	—	—	—	—	—	—	—
2	77(17)	136(30)	—	—	—	—	—	—	109(24)	136(30)	—	—	—	—	—	—	136(30)	—	—	—	—	—	—	—	—	—	—
3	50(11)	118(26)	136(30)	—	—	—	—	—	73(16)	136(30)	—	—	—	—	—	—	100(22)	136(30)	—	—	—	—	—	—	—	—	—
4	36(8)	86(19)	136(30)	—	—	—	—	—	55(12)	127(28)	136(30)	—	—	—	—	—	77(17)	136(30)	—	—	—	—	—	—	—	—	—
5	—	68(15)	127(28)	136(30)	—	—	—	—	—	100(22)	136(30)	—	—	—	—	—	59(13)	136(30)	—	—	—	—	—	—	—	—	—
6	—	59(13)	105(23)	136(30)	—	—	—	—	—	82(18)	136(30)	—	—	—	—	—	50(11)	118(26)	136(30)	—	—	—	—	—	—	—	—
7	—	50(11)	91(20)	136(30)	—	—	—	—	—	73(16)	127(28)	136(30)	—	—	—	—	—	100(22)	136(30)	—	—	—	—	—	—	—	—
8	—	—	77(17)	127(28)	136(30)	—	—	—	—	64(14)	114(25)	136(30)	—	—	—	—	—	86(19)	136(30)	—	—	—	—	—	—	—	—
9	—	—	68(15)	114(25)	136(30)	—	—	—	—	55(12)	100(22)	136(30)	—	—	—	—	—	77(17)	136(30)	—	—	—	—	—	—	—	—
10	—	—	64(14)	100(22)	136(30)	—	—	—	—	—	91(20)	136(30)	—	—	—	—	—	68(15)	123(27)	136(30)	—	—	—	—	—	—	—
11	—	—	55(12)	91(20)	136(30)	—	—	—	—	—	82(18)	132(29)	136(30)	—	—	—	—	64(14)	114(25)	136(30)	—	—	—	—	—	—	—
12	—	—	—	82(18)	136(30)	—	—	—	—	—	73(16)	118(26)	136(30)	—	—	—	—	59(13)	105(23)	136(30)	—	—	—	—	—	—	—
13	—	—	—	77(17)	136(30)	—	—	—	—	—	68(15)	109(24)	136(30)	—	—	—	—	55(12)	95(21)	136(30)	—	—	—	—	—	—	—
14	—	—	—	73(16)	136(30)	—	—	—	—	—	64(14)	100(22)	136(30)	—	—	—	—	—	86(19)	136(30)	—	—	—	—	—	—	—
15	—	—	—	68(15)	136(30)	—	—	—	—	—	59(13)	95(21)	136(30)	—	—	—	—	—	82(18)	132(29)	136(30)	—	—	—	—	—	—
16	—	—	—	64(14)	136(30)	—	—	—	—	—	—	91(20)	136(30)	—	—	—	—	—	77(17)	123(27)	136(30)	—	—	—	—	—	—
17	—	—	—	59(13)	127(28)	136(30)	—	—	—	—	—	82(18)	136(30)	—	—	—	—	—	73(16)	118(26)	136(30)	—	—	—	—	—	—
18	—	—	—	55(12)	118(26)	136(30)	—	—	—	—	—	77(17)	136(30)	—	—	—	—	—	68(15)	109(24)	136(30)	—	—	—	—	—	—
19	—	—	—	—	114(25)	136(30)	—	—	—	—	—	73(16)	136(30)	—	—	—	—	—	64(14)	105(23)	136(30)	—	—	—	—	—	—
20	—	—	—	—	109(24)	136(30)	—	—	—	—	—	68(15)	136(30)	—	—	—	—	—	59(13)	100(22)	136(30)	—	—	—	—	—	—
23	—	—	—	—	91(20)	136(30)	—	—	—	—	—	64(14)	132(29)	136(30)	—	—	—	—	55(12)	86(19)	136(30)	—	—	—	—	—	—
25	—	—	—	—	86(19)	136(30)	—	—	—	—	—	59(13)	123(27)	136(30)	—	—	—	—	—	77(17)	136(30)	—	—	—	—	—	—
30	—	—	—	—	73(16)	127(28)	136(30)	—	—	—	—	—	100(22)	136(30)	—	—	—	—	—	64(14)	136(30)	—	—	—	—	—	—
35	—	—	—	—	59(13)	109(24)	136(30)	—	—	—	—	—	86(19)	136(30)	—	—	—	—	—	55(12)	123(27)	136(30)	—	—	—	—	—
40	—	—	—	—	55(12)	95(21)	136(30)	—	—	—	—	—	77(17)	136(30)	—	—	—	—	—	—	105(23)	136(30)	—	—	—	—	—
45	—	—	—	—	—	86(19)	136(30)	—	—	—	—	—	68(15)	123(27)	136(30)	—	—	—	—	—	95(21)	136(30)	—	—	—	—	—
50	—	—	—	—	—	77(17)	123(27)	136(30)	—	—	—	—	59(13)	109(24)	136(30)	—	—	—	—	—	86(19)	136(30)	—	—	—	—	—
55	—	—	—	—	—	68(15)	114(25)	136(30)	—	—	—	—	—	100(22)	136(30)	—	—	—	—	—	77(17)	136(30)	—	—	—	—	—
60	—	—	—	—	—	64(14)	105(23)	136(30)	—	—	—	—	—	91(20)	136(30)	—	—	—	—	—	68(15)	127(28)	136(30)	—	—	—	—
65	—	—	—	—	—	59(13)	95(21)	136(30)	—	—	—	—	—	82(18)	136(30)	—	—	—	—	—	64(14)	118(26)	136(30)	—	—	—	—
70	—	—	—	—	—	55(12)	91(20)	136(30)	—	—	—	—	—	77(17)	127(28)	—	—	—	—	—	59(13)	109(24)	136(30)	—	—	—	—

*Maximum flow obtainable from 1 notch with 152mm(six inch) water depth at drain.

TABLE III —TO BE USED WHEN ROOF STORM WATER RUN OFF AND OTHER SURFACE WATER RUN OFF IS BEING CONSOLIDATED INTO ONE COMMON MAIN HORIZONTAL STORM SEWER.

Flow capacity of vertical leaders
litres per minute (gallons per minute)

Pipe Size	Maximum Capacity L.P.M.(G.P.M.)
50mm(2")	136(30)
75mm(3")	409(90)
100mm(4")	864(190)
†125mm(5")	1582(348)
150mm(6")	2550(561)

†In some areas 125mm(5") drainage pipe may not be available.

Flow capacity of horizontal storm sewers litres per minute (gallons per minute).

Pipe Size	Slope per 305mm(Per Foot)		
	3mm(1/8")	6mm(1/4")	13mm(1/2")
75mm(3")	163(36)	232(51)	327(72)
100mm(4")	355(78)	505(111)	714(157)
†125mm(5")	646(142)	914(201)	1291(284)
150mm(6")	1050(231)	1487(327)	2100(462)
200mm(8")	2264(498)	3205(705)	4528(996)
250mm(10")	4100(902)	5796(1275)	8201(1804)
300mm(12")	6669(1467)	9437(2076)	13338(2934)
375mm(15")	12120(2666)	17157(3774)	24239(5332)

Note: Although pipe size calculations should be based on accumulated flow rate, local by-laws should be referred to for minimum pipe size requirements and roof drain spacing.

SCUPPERS AND OVERFLOW DRAINS

Roofing members and understructures, weakened by seepage and rot resulting from improper drainage and roof construction can give away under the weight of rapidly accumulated water during flash storms. Thus, it is recommended, and often required by building codes, to install scuppers and overflow drains in parapet-type roofs. Properly selected and sized scuppers and overflow drains are vital to a well-engineered drainage system to prevent excessive loading, erosion, seepage and rotting.

LOCATION	SQUARE METRE (SQUARE FOOT)	ROOF LOAD FACTOR KGS (LBS.)	TOTAL ROOF SLOPE											
			DEAD-LEVEL			51mm (2'') RISE			102mm (4'') RISE			152mm (6'') RISE		
	NOTCH AREA RATING		L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth				
Calgary, Alberta	232 (2,500)	4.7 (10.4)	45.5 (10)	7	51 (2)	57 (12.5)	6	63.5 (2.5)	72.5 (16)	4	81.5 (3.2)	86.5 (19)	3.2	96.5 (3.8)
	465 (5,000)	5.9 (13)	57 (12.5)	17	63.5 (2.5)	66 (14.5)	14	73.5 (2.9)	82 (18)	9	91.5 (3.6)	97.5 (21.5)	7.5	109 (4.3)
	697 (7,500)	6.4 (14)	61.5 (13.5)	28	68.5 (2.7)	72.5 (16)	22	81.5 (3.2)	88.5 (19.5)	15	99 (3.9)	104.5 (23)	12	117 (4.6)
	929 (10,000)	6.8 (15.1)	66 (14.5)	38	73.5 (2.9)	77.5 (17)	31	86.5 (3.4)	93 (20.5)	22	104 (4.1)	109 (24)	17	122 (4.8)
Edmonton, Alberta	232 (2,500)	4.5 (9.9)	43 (9.5)	7	48.5 (1.9)	57 (12.5)	6	63.5 (2.5)	72.5 (16)	4	81.5 (3.2)	82 (18)	3	91.5 (3.6)
	465 (5,000)	5.9 (13)	57 (12.5)	17	63.5 (2.5)	68 (15)	14.5	76 (3)	84 (18.5)	9.5	94 (3.7)	97.5 (21.5)	7.5	109 (4.3)
	697 (7,500)	6.6 (14.5)	63.5 (14)	28	71 (2.8)	75 (16.5)	24	84 (3.3)	97.5 (21.5)	16	104 (4.1)	107 (23.5)	12	119.5 (4.7)
	929 (10,000)	7.1 (15.6)	68 (15)	38	76 (3.0)	79.5 (17.5)	32	89 (3.5)	100 (22)	22	112 (4.4)	113.5 (25)	18	127 (5.0)
Penticton, British Columbia	232 (2,500)	3.8 (8.3)	36.5 (8)	6	40.5 (1.6)	38.5 (8.5)	4	43 (1.7)	52.5 (11.5)	3	58.5 (2.3)	61.5 (13.5)	2.3	68.5 (2.7)
	465 (5,000)	4.0 (8.8)	38.5 (8.5)	13	43 (1.7)	41 (9)	9	45.5 (1.8)	57 (12.5)	6	63.5 (2.5)	68 (15)	5	76 (3.0)
	697 (7,500)	4.2 (9.3)	41 (9)	21	45.5 (1.8)	43 (9.5)	14.5	48.5 (1.9)	61.5 (13.5)	10.5	68.5 (2.7)	72.5 (16)	8	81.5 (3.2)
	929 (10,000)	4.2 (9.3)	41 (9)	27	45.5 (1.8)	45.5 (10)	20	51 (2.0)	63.5 (14)	14	71 (2.8)	75 (16.5)	11	84 (3.3)
Vancouver, British Columbia	232 (2,500)	3.3 (7.3)	32 (7)	5.5	35.5 (1.4)	38.5 (8.5)	4	43 (1.7)	47.5 (10.5)	2.8	53.5 (2.1)	57 (12.5)	2	63.5 (2.5)
	465 (5,000)	4.0 (8.8)	38.5 (8.5)	13	43 (1.7)	45.5 (10)	10	51 (2)	57 (12.5)	6	63.5 (2.5)	68 (15)	5	76 (3)
	697 (7,500)	4.5 (9.9)	43 (9.5)	22	48.5 (1.9)	50 (11)	17	56 (2.2)	63.5 (14)	11	71 (2.8)	75 (16.5)	8.5	84 (3.3)
	929 (10,000)	4.9 (10.9)	47.5 (10.5)	30	53.5 (2.1)	54.5 (12)	24	61 (2.4)	68 (15)	15	76 (3)	79.5 (17.5)	12	89 (3.5)
Victoria, British Columbia	232 (2,500)	3.3 (7.3)	32 (7)	5.5	35.5 (1.4)	38.5 (8.5)	4	43 (1.7)	43 (9.5)	2.5	48.5 (1.9)	54.5 (12)	2	61 (2.4)
	465 (5,000)	4.0 (8.8)	38.5 (8.5)	13	43 (1.7)	45.5 (10)	10	51 (2)	54.5 (12)	6	61 (2.4)	68 (15)	5	76 (3)
	697 (7,500)	4.5 (9.9)	43 (9.5)	22	48.5 (1.9)	50 (11)	16	56 (2.2)	59 (13)	10	66 (2.6)	75 (16.5)	8	84 (3.3)
	929 (10,000)	4.7 (10.4)	45.5 (10)	30	51 (2)	54.5 (12)	23	61 (2.4)	63.5 (14)	14	71 (2.8)	79.5 (17.5)	12	89 (3.5)
Brandon, Manitoba	232 (2,500)	5.9 (13)	57 (12.5)	8	63.5 (2.5)	68 (15)	7	76 (3)	82 (18)	4.5	91.5 (3.6)	95.5 (21)	3.5	106.5 (4.2)
	465 (5,000)	7.3 (16.1)	73 (16)	20	81.5 (3.2)	84 (18.5)	17	94 (3.7)	97.5 (21.5)	11	109 (4.3)	113.5 (25)	8.5	127 (5)
	697 (7,500)	8.3 (18.2)	79.5 (17.5)	32	89 (3.5)	93 (20.5)	27	104 (4.1)	107 (23.5)	19	119.5 (4.7)	125 (27.5)	15	139.5 (5.5)
	929 (10,000)	9.0 (19.8)	86.5 (19)	43	96.5 (3.8)	100 (22)	38	112 (4.4)	113.5 (25)	26	127 (5.0)	132 (29)	21	147.5 (5.8)
Winnipeg, Manitoba	232 (2,500)	4.7 (10.4)	45.5 (10)	7	51 (2)	57 (12.5)	6	63.5 (2.5)	75 (16.5)	4	84 (3.3)	86.5 (19)	3.2	96.5 (3.8)
	465 (5,000)	5.9 (13)	57 (12.5)	17	63.5 (2.5)	68 (15)	15	76 (3)	84 (18.5)	10	94 (3.7)	100 (22)	7.5	112 (4.4)
	697 (7,500)	6.6 (14.5)	63.5 (14)	28	71 (2.8)	75 (16.5)	24	84 (3.3)	93 (20.5)	16	104 (4.1)	107 (23.5)	12	119.5 (4.7)
	929 (10,000)	7.1 (15.6)	68 (15)	39	76 (3)	82 (18)	32	91.5 (3.6)	97.5 (21.5)	22	109 (4.3)	113.5 (25)	17	127 (5.0)
Campbellton, New Brunswick	232 (2,500)	6.4 (14)	62 (13.5)	9	68.5 (2.7)	70.5 (15.5)	7	78.5 (3.1)	79.5 (17.5)	4.5	89 (3.5)	91 (20)	3.5	101.5 (4.0)
	465 (5,000)	9.0 (19.8)	86.5 (19)	22	96.5 (3.8)	91 (20)	18	101.5 (4)	102.5 (22.5)	12	115 (4.5)	113.5 (25)	9	127 (5.0)
	697 (7,500)	10.4 (22.9)	100 (22)	35	112 (4.4)	102.5 (22.5)	28	114.5 (4.5)	118 (26)	20	132 (5.2)	132 (29)	15	147.5 (5.8)
	929 (10,000)	11.3 (25)	109 (24)	47	122 (4.8)	111.5 (24.5)	40	124.5 (4.9)	127.5 (28)	29	142 (5.6)	141 (31)	22	157.5 (6.2)

LOCATION	SQUARE METRE (SQUARE FOOT)	ROOF LOAD FACTOR KGS. (LBS.)	TOTAL ROOF SLOPE											
			DEAD-LEVEL		51mm (2'') RISE		102mm (4'') RISE		152mm (6'') RISE					
	NOTCH AREA RATING		Draindown Time Hrs.	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth	Draindown Time Hrs.	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth	Draindown Time Hrs.	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth	Draindown Time Hrs.	L.P.M. (G.P.M.) Discharge	mm (In.) Water Depth
Chatham, New Brunswick	232 (2,500)	4.5 (9.9)	43 (9.5)	7	48.5 (1.9)	52.5 (11.5)	5.5	58.5 (2.3)	63.5 (14)	3.5	71 (2.8)	77.5 (17)	2.9	86.5 (3.4)
	465 (5,000)	5.7 (12.5)	54.5 (12)	16	61 (2.4)	63.5 (14)	13	71 (2.8)	77.5 (17)	9	86.5 (3.4)	91 (20)	7	101.5 (4.0)
	697 (7,500)	6.4 (14)	61.5 (13.5)	27	68.5 (2.7)	68 (15)	22	76 (3)	84 (18.5)	14	94 (3.7)	102.5 (22.5)	12	114.5 (4.5)
	929 (10,000)	6.6 (14.6)	63.5 (14)	37	71 (2.8)	75 (16.5)	30	84 (3.3)	91 (20)	20	101.5 (4.0)	107 (23.5)	16	119.5 (4.7)
Moncton, New Brunswick	232 (2,500)	4.3 (9.4)	41 (9)	7	45.5 (1.8)	54.5 (12)	6	61 (2.4)	63.5 (14)	3.5	71 (2.8)	72.5 (16)	2.7	81.5 (3.2)
	465 (5,000)	5.9 (13)	57 (12.5)	17	63.5 (2.5)	68 (15)	14	76 (3)	82 (18)	9	91.5 (3.6)	93 (20.5)	7	104 (4.1)
	697 (7,500)	6.6 (14.6)	63.5 (14)	28	71 (2.8)	79.5 (17.5)	24	89 (3.5)	93 (20.5)	16	104 (4.1)	104.5 (23)	12	117 (4.6)
	929 (10,000)	7.5 (16.6)	72.5 (16)	39	81.5 (3.2)	84 (18.5)	34	94 (3.7)	100 (22)	23	112 (4.4)	113.5 (25)	17	127 (5.0)
Saint John, New Brunswick	232 (2,500)	5.7 (12.5)	54.5 (12)	8	61 (2.4)	57 (12.5)	6	63.5 (2.5)	75 (16.5)	4	84 (3.3)	86.5 (19)	3	96.5 (3.8)
	465 (5,000)	7.5 (16.6)	72.5 (16)	20	81.5 (3.2)	79.5 (17.5)	16	89 (3.5)	95.5 (21)	11	106.5 (4.2)	104.5 (23)	8	117 (4.6)
	697 (7,500)	8.7 (19.2)	84 (18.5)	32	94 (3.7)	93 (20.5)	27	104 (4.1)	107 (23.5)	19	119.5 (4.7)	118 (26)	13.5	132 (5.2)
	929 (10,000)	9.7 (21.3)	93 (20.5)	44	104 (4.1)	104.5 (23)	38	117 (4.6)	113.5 (25)	27	127 (5.0)	127.5 (28)	20	142 (5.6)
Gander, Newfoundland	232 (2,500)	3.5 (7.8)	34 (7.5)	5.5	38 (1.5)	45.5 (10)	5	51 (2.0)	57 (12.5)	3.5	63.5 (2.5)	68 (15)	2.5	76 (3.0)
	465 (5,000)	4.7 (10.4)	45.5 (10)	15	51 (2.0)	57 (12.5)	12	63.5 (2.5)	72.5 (16)	8	81.5 (3.2)	82 (18)	6.5	91.5 (3.6)
	697 (7,500)	5.7 (12.5)	54.5 (12)	25	61 (2.4)	63.5 (14)	21	71 (2.8)	79.5 (17.5)	13.5	89 (3.5)	93 (20.5)	11	104 (4.1)
	929 (10,000)	6.1 (13.5)	59 (13)	35	66 (2.6)	70.5 (15.5)	29	78.5 (3.1)	84 (18.5)	19	94 (3.7)	100 (22)	15	112 (4.4)
St. Andrews, Newfoundland	232 (2,500)	3.5 (7.8)	34 (7.5)	5.5	38 (1.5)	45.5 (10)	5	51 (2.0)	59 (13)	3.5	66 (2.6)	63.5 (14)	2.5	71 (2.8)
	465 (5,000)	5.2 (11.4)	47.5 (10.5)	15	53.5 (2.1)	59 (13)	13	66 (2.6)	72.5 (16)	8	81.5 (3.2)	79.5 (17.5)	6	89 (3.5)
	697 (7,500)	5.9 (13)	57 (12.5)	26	63.5 (2.5)	66 (14.5)	21	73.5 (2.9)	82 (18)	14	91.5 (3.6)	88.5 (19.5)	10	99 (3.9)
	929 (10,000)	6.6 (14.6)	63.5 (14)	36	71 (2.8)	72.5 (16)	30	81.5 (3.2)	86.5 (19)	20	96.5 (3.8)	95.5 (21)	14.5	106.5 (4.2)
St. John's, Newfoundland	232 (2,500)	5.9 (13)	57 (12.5)	8	63.5 (2.5)	68 (15)	7	76 (3.0)	77.5 (17)	4.5	86.5 (3.4)	86.5 (19)	3.2	96.5 (3.8)
	465 (5,000)	8.5 (18.7)	82 (18)	21	91.5 (3.6)	91 (20)	18	101 (4.0)	100 (22)	11	112 (4.4)	113.5 (25)	9	127 (5.0)
	697 (7,500)	10.6 (23.4)	102.5 (22.5)	34	114.5 (4.5)	109 (24)	29	122 (4.8)	122.5 (27)	21	137 (5.4)	132 (29)	15	147.5 (5.8)
	929 (10,000)	11.8 (26)	113.5 (25)	48	127 (5.0)	129.5 (28.5)	43	145 (5.7)	143 (31.5)	33	160 (6.3)	150 (33)	24	167.5 (6.6)
Torbay, Newfoundland	232 (2,500)	4.9 (10.9)	47.5 (10.5)	7.5	53.5 (2.1)	61.5 (13.5)	6.5	68.5 (2.7)	75 (16.5)	4	84 (3.3)	84 (18.5)	3	94 (3.7)
	465 (5,000)	6.4 (14)	61.5 (13.5)	18	68.5 (2.7)	75 (16.5)	15.5	84 (3.3)	88.5 (19.5)	10	99 (3.9)	102.5 (22.5)	8	114.5 (4.5)
	697 (7,500)	7.3 (16.1)	70.5 (15.5)	29	78.5 (3.1)	84 (18.5)	25	94 (3.7)	100 (22)	17.5	112 (4.4)	113.5 (25)	13	127 (5)
	929 (10,000)	8.0 (17.7)	77.5 (17)	40	86.5 (3.4)	88.5 (19.5)	34	99 (3.9)	107 (23.5)	24	119.5 (4.7)	122.5 (27)	19	137 (5.4)
Halifax, Nova Scotia	232 (2,500)	5.9 (13)	57 (12.5)	8	63.5 (2.5)	68 (15)	7	76 (3.0)	77.5 (17)	4.5	86.5 (3.4)	86.5 (19)	3.2	96.5 (3.8)
	465 (5,000)	8.5 (18.7)	82 (18)	21	91.5 (3.6)	91 (20)	18	101.5 (4.0)	100 (22)	11	112 (4.4)	113.5 (25)	9	127 (5.0)
	697 (7,500)	10.6 (23.4)	102.5 (22.5)	34	114.5 (4.5)	109 (24)	29	122 (4.8)	122.5 (27)	21	137 (5.4)	132 (29)	15	147.5 (5.8)
	929 (10,000)	11.8 (26)	113.5 (25)	48	127 (5.0)	129.5 (28.5)	43	145 (5.7)	143 (31.5)	33	160 (6.3)	150 (33)	24	167.5 (6.6)

LOCATION	SQUARE METRE (SQUARE FOOT)	ROOF LOAD FACTOR KGS (LBS.)	TOTAL ROOF SLOPE											
			DEAD-LEVEL			51mm (2") RISE			102mm (4") RISE			152mm (6") RISE		
	NOTCH AREA RATING		Draindown Time Hrs.	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge	Draindown Time Hrs.	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge	Draindown Time Hrs.	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge	Draindown Time Hrs.	mm (In.) Water Depth	L.P.M. (G.P.M.) Discharge
Sydney, Nova Scotia	232 (2,500)	4.3 (9.4)	41 (9)	6.5 (1.8)	45.5 (10)	5 (2.0)	51 (12.5)	57 (12.5)	3.5 (2.5)	63.5 (15)	68 (15)	2.5 (3.0)	76 (3.0)	
	465 (5,000)	5.7 (12.5)	54.5 (12)	16 (2.4)	61 (13)	13 (2.6)	66 (16.5)	75 (16.5)	8 (3.3)	84 (18.5)	84 (18.5)	6.5 (3.7)	94 (3.7)	
	697 (7,500)	6.4 (14)	61.5 (13.5)	28 (2.7)	68.5 (15)	22 (3.0)	76 (18.5)	84 (18.5)	14 (3.7)	94 (21.5)	97.5 (21.5)	11 (4.3)	109 (4.3)	
	929 (10,000)	7.1 (15.6)	68 (15)	38 (3.0)	76 (16.5)	30 (3.3)	84 (20)	91 (20)	20 (4.0)	101.5 (23)	104.5 (23)	16 (4.6)	117 (4.6)	
Yarmouth, Nova Scotia	232 (2,500)	6.4 (14)	61.5 (13.5)	9 (2.7)	68.5 (15.5)	7.5 (3.1)	78.5 (18)	82 (18)	4.5 (3.6)	91.5 (20)	91 (20)	3.5 (4.0)	101.5 (4.0)	
	465 (5,000)	8.3 (18.2)	79.5 (17.5)	21 (3.5)	89 (19.5)	18 (3.9)	99 (23)	104.5 (23)	12 (4.6)	117 (25.5)	116 (25.5)	9 (5.1)	129.5 (5.1)	
	697 (7,500)	9.4 (20.8)	91 (20)	34 (4.0)	101.5 (22.5)	29 (4.5)	114.5 (26)	118 (26)	21 (5.2)	132 (29)	132 (29)	15 (5.8)	147.5 (5.8)	
	929 (10,000)	10.4 (22.9)	100 (22)	45 (4.4)	109 (24)	41 (4.8)	122 (28.5)	129.5 (28.5)	29 (5.7)	145 (31)	141 (31)	22 (6.2)	157.5 (6.2)	
Thunder Bay, Ontario	232 (2,500)	4.9 (10.9)	47.5 (10.5)	7.5 (2.1)	61.5 (13.5)	6.5 (2.7)	68.5 (16.5)	75 (16.5)	4 (3.3)	84 (19.5)	88.5 (19.5)	3.5 (3.6)	91.5 (3.6)	
	465 (5,000)	6.1 (13.5)	59 (13)	18 (2.6)	72.5 (16)	15 (3.2)	81.5 (19)	86.5 (19)	9.5 (3.8)	96.5 (22.5)	102.5 (22.5)	7.5 (4.5)	114.5 (4.5)	
	697 (7,500)	6.6 (14.6)	63.5 (14)	28 (2.8)	71 (17)	24 (3.4)	86.5 (20.5)	93 (20.5)	16 (4.1)	104 (24)	109 (24)	13 (4.8)	122 (4.8)	
	929 (10,000)	7.1 (15.6)	68 (15)	38 (3.0)	84 (18.5)	33 (3.7)	94 (21.5)	97.5 (21.5)	22 (4.3)	109 (25.5)	116 (25.5)	18 (5.1)	129.5 (5.1)	
Guelph, Ontario	232 (2,500)	5.7 (12.5)	54.5 (12)	8 (2.4)	61 (14)	7 (2.8)	71 (16.5)	86.5 (19)	5 (3.8)	96.5 (22)	100 (22)	3.7 (4.4)	112 (4.4)	
	465 (5,000)	6.6 (14.6)	63.5 (14)	19 (2.8)	71 (16.5)	15.5 (3.3)	84 (21.5)	97.5 (21.5)	11 (4.3)	109 (25.5)	116 (25.5)	9 (5.1)	129.5 (5.1)	
	697 (7,500)	7.3 (16.1)	70.5 (15.5)	29 (3.1)	78.5 (18)	25 (3.6)	91.5 (23)	104.5 (23)	18 (4.6)	117 (27.5)	125 (27.5)	14 (5.5)	139.5 (5.5)	
	929 (10,000)	8.0 (17.7)	77.5 (17)	40 (3.4)	86.5 (18.5)	34 (3.7)	94 (24)	109 (24)	26 (4.8)	122 (29)	132 (29)	20 (5.8)	147.5 (5.8)	
Hamilton, Ontario	232 (2,500)	5.9 (13)	57 (12.5)	8.5 (2.5)	63.5 (16)	7.5 (3.2)	81.5 (20.5)	93 (20.5)	5 (4.1)	104 (24)	109 (24)	4 (4.8)	122 (4.8)	
	465 (5,000)	6.6 (14.6)	63.5 (14)	19 (2.8)	71 (17.5)	16 (3.5)	89 (23)	104.5 (23)	12 (4.6)	117 (27)	122.5 (27)	9 (5.4)	137 (5.4)	
	697 (7,500)	6.8 (15.1)	66 (14.5)	28 (2.9)	73.5 (18.5)	26 (3.7)	94 (24.5)	111.5 (24.5)	20 (4.9)	124.5 (28)	127.5 (28)	15 (5.6)	142 (5.6)	
	929 (10,000)	7.1 (15.6)	68 (15)	39 (3.0)	86.5 (19)	34 (3.8)	96.5 (25.5)	116 (25.5)	27 (5.1)	129.5 (29.5)	134 (29.5)	21 (5.9)	150 (5.9)	
Kingston, Ontario	232 (2,500)	6.4 (14)	61.5 (13.5)	9 (2.7)	68.5 (17)	8 (3.4)	86.5 (20)	91 (20)	5 (4.0)	101.5 (24)	109 (24)	4 (4.8)	122 (4.8)	
	465 (5,000)	7.5 (16.6)	72.5 (16)	20 (3.2)	81.5 (19)	18 (3.8)	96.5 (23)	104.5 (23)	12 (4.6)	117 (27)	122.5 (27)	9.5 (5.4)	137 (5.4)	
	697 (7,500)	8.5 (18.7)	82 (18)	31 (3.6)	91.5 (20.5)	28 (4.1)	104 (24.5)	111.5 (24.5)	20 (4.9)	124.5 (29)	132 (29)	15 (5.8)	147.5 (5.8)	
	929 (10,000)	8.7 (19.2)	86.5 (19)	42 (3.8)	96.5 (21.5)	38 (4.3)	109 (25.5)	116 (25.5)	27 (5.1)	129.5 (29.5)	134 (29.5)	21 (6.0)	152.5 (6.0)	
London, Ontario	232 (2,500)	6.1 (13.5)	59 (13)	8.5 (2.6)	72.5 (16)	7.5 (3.2)	81.5 (19.5)	88.5 (19.5)	5 (3.9)	99 (23.5)	107 (23.5)	4 (4.7)	119.5 (4.7)	
	465 (5,000)	7.1 (15.6)	68 (15)	20 (3.0)	76 (18.5)	17 (3.7)	94 (22.5)	102.5 (22.5)	12 (4.5)	114.5 (27)	122.5 (27)	9.5 (5.4)	137 (5.4)	
	697 (7,500)	8.0 (17.7)	77.5 (17)	30 (3.4)	86.5 (19.5)	27 (3.9)	99 (24)	109 (24)	19 (4.8)	122 (28.5)	129.5 (28.5)	15 (5.7)	145 (5.7)	
	929 (10,000)	8.5 (18.7)	82 (18)	41 (3.6)	91.5 (20)	36 (4.0)	101.5 (25)	113.5 (25)	27 (5.0)	127 (29.5)	134 (29.5)	21 (5.9)	150 (5.9)	
North Bay, Ontario	232 (2,500)	5.7 (12.5)	54.5 (12)	8 (2.4)	61 (15)	7 (3.0)	76 (19)	86.5 (19)	5 (3.8)	96.5 (22)	100 (22)	3.8 (4.4)	112 (4.4)	
	465 (5,000)	6.6 (14.6)	63.5 (14)	19 (2.8)	71 (17.5)	16 (3.5)	89 (21.5)	97.5 (21.5)	11 (4.3)	109 (25)	113.5 (25)	9 (5.0)	127 (5.0)	
	697 (7,500)	7.5 (16.6)	72.5 (16)	30 (3.2)	81.5 (19)	26 (3.8)	96.5 (23.5)	107 (23.5)	19 (4.7)	119.5 (27)	122.5 (27)	14 (5.4)	137 (5.4)	
	929 (10,000)	8.3 (18.2)	77.5 (17)	40 (3.4)	86.5 (20.5)	36 (4.1)	104 (24.5)	111.5 (24.5)	26 (4.9)	124.5 (28)	127.5 (28)	20 (5.6)	142 (5.6)	
Ottawa, Ontario	232 (2,500)	4.7 (10.4)	45.5 (10)	7 (2.0)	51 (13)	6.5 (2.6)	66 (17)	77.5 (17)	4.5 (3.4)	86.5 (19)	86.5 (19)	3.2 (3.8)	96.5 (3.8)	
	465 (5,000)	5.9 (13)	57 (12.5)	17 (2.5)	68 (15)	14 (3.0)	76 (19)	86.5 (19)	10 (3.8)	96.5 (22)	100 (22)	7.5 (4.4)	112 (4.4)	
	697 (7,500)	6.4 (14)	61.5 (13.5)	27 (2.7)	68.5 (16.5)	23 (3.3)	84 (20.5)	93 (20.5)	16 (4.1)	104 (23.5)	107 (23.5)	12 (4.7)	119.5 (4.7)	
	929 (10,000)	6.6 (14.6)	63.5 (14)	36 (2.8)	71 (17.5)	32 (3.5)	89 (21.5)	97.5 (21.5)	22 (4.3)	109 (25)	113.5 (25)	18 (5.0)	127 (5.0)	

LOCATION	SQUARE METRE (SQUARE FOOT)	ROOF LOAD FACTOR KGS (LBS.)	TOTAL ROOF SLOPE									
			DEAD-LEVEL		51mm (2'') RISE		102mm (4'') RISE		152mm (6'') RISE			
	NOTCH AREA RATING		Draindown Time Hrs.	mm (In.) Water Depth	Draindown Time Hrs.	mm (In.) Water Depth	Draindown Time Hrs.	mm (In.) Water Depth	Draindown Time Hrs.	mm (In.) Water Depth		
			L.P.M. (G.P.M.) Discharge		L.P.M. (G.P.M.) Discharge		L.P.M. (G.P.M.) Discharge		L.P.M. (G.P.M.) Discharge			
St. Thomas, Ontario	232 (2,500)	5.7 (12.5)	54.5 (12)	8 61 (2.4)	68 (15)	7 76 (3.0)	86.5 (19)	5 96.5 (3.8)	104.5 (23)	4 117 (4.6)		
	465 (5,000)	6.6 (14.6)	63.5 (14)	19 71 (2.8)	77.5 (17)	16 86.5 (3.4)	97.5 (21.5)	11 109 (4.3)	118 (26)	9 132 (5.2)		
	697 (7,500)	7.1 (15.6)	68 (15)	29 76 (3.0)	82 (18)	26 91.5 (3.6)	102.5 (22.5)	18 114.5 (4.5)	125 (27.5)	15 139.5 (5.5)		
	929 (10,000)	7.5 (16.6)	72.5 (16)	40 81.5 (3.2)	86.5 (19)	34 96.5 (3.8)	107 (23.5)	24 119.5 (4.7)	132 (29)	20 147.5 (5.8)		
Timmins, Ontario	232 (2,500)	4.3 (9.4)	41 (9)	7 45.5 (1.8)	57 (12.5)	6 63.5 (2.5)	72.5 (16)	4 81.5 (3.2)	86.5 (19)	3.3 96.5 (3.8)		
	465 (5,000)	5.7 (12.5)	54.5 (12)	16 61 (2.4)	63.5 (14)	14 71 (2.8)	82 (18)	9 91.5 (3.6)	97.5 (21.5)	7.5 109 (4.3)		
	697 (7,500)	6.4 (14)	61.5 (13.5)	27 68.5 (2.7)	70.5 (15.5)	22 78.5 (3.1)	86.5 (19)	15 96.5 (3.8)	104.5 (23)	12 117 (4.6)		
	929 (10,000)	6.6 (14.6)	63.5 (14)	36 71 (2.8)	72.5 (16)	30 81.5 (3.2)	91 (20)	21 101.5 (4.0)	109 (24)	17 122 (4.8)		
Toronto, Ontario	232 (2,500)	5.7 (12.5)	54.5 (12)	8 61 (2.4)	66 (14.5)	7 73.5 (2.9)	82 (18)	4.5 91.5 (3.6)	97.5 (21.5)	3.5 109 (4.3)		
	465 (5,000)	6.8 (15.1)	66 (14.5)	19 73.5 (2.9)	77.5 (17)	16 86.5 (3.4)	93 (20.5)	11 104 (4.1)	111.5 (24.5)	9 124.5 (4.9)		
	697 (7,500)	8.0 (17.7)	77.5 (17)	30 86.5 (3.4)	84 (18.5)	26 94 (3.7)	100 (22)	18 112 (4.4)	120.5 (26.5)	14 134.5 (5.3)		
	929 (10,000)	8.7 (19.2)	82 (18)	42 91.5 (3.6)	86.5 (19)	34 96.5 (3.8)	104.5 (23)	24 117 (4.6)	127.5 (28)	20 142 (5.6)		
Windsor, Ontario	232 (2,500)	6.1 (13.5)	59 (13)	8.5 66 (2.6)	70.5 (15.5)	7.5 78.5 (3.1)	84 (18.5)	4.5 94 (3.7)	107 (23.5)	4 119.5 (4.7)		
	465 (5,000)	7.1 (15.6)	68 (15)	20 76 (3.0)	79.5 (17.5)	16 89 (3.5)	97.5 (21.5)	11 109 (4.3)	118 (26)	9 132 (5.2)		
	697 (7,500)	8.0 (17.7)	77.5 (17)	30 86.5 (3.4)	86.5 (19)	26 96.5 (3.8)	107 (23.5)	18 119.5 (4.7)	125 (27.5)	15 139.5 (5.5)		
	929 (10,000)	8.7 (19.2)	82 (18)	42 91.5 (3.6)	91 (20)	36 101.5 (4.0)	113.5 (25)	26 127 (5.0)	129.5 (28.5)	20 145 (5.7)		
Charlottetown, P.E.I.	232 (2,500)	4.9 (10.9)	47.5 (10.5)	7.5 53.5 (2.1)	57 (12.5)	6 63.5 (2.5)	68 (15)	3.8 76 (3.0)	79.5 (17.5)	3 89 (3.5)		
	465 (5,000)	6.6 (14.6)	63.5 (14)	19 71 (2.8)	75 (16.5)	15.5 84 (3.3)	88.5 (19.5)	10 99 (3.9)	100 (22)	7.5 112 (4.4)		
	697 (7,500)	7.8 (17.2)	75 (16.5)	31 84 (3.3)	86.5 (19)	26 96.5 (3.8)	102.5 (22.5)	18 114.5 (4.5)	113.5 (25)	13 127 (5.0)		
	929 (10,000)	8.7 (19.2)	84 (18.5)	42 94 (3.7)	97.5 (21.5)	37 106.5 (4.2)	111.5 (24.5)	26 124.5 (4.9)	125 (27.5)	20 139.5 (5.5)		
Montreal, Quebec	232 (2,500)	5.2 (11.4)	50 (11)	7.5 56 (2.2)	61.5 (13.5)	7 68.5 (2.7)	79.5 (17.5)	4.5 89 (3.5)	97.5 (21.5)	3.5 109 (4.3)		
	465 (5,000)	5.9 (13)	57 (12.5)	17 63.5 (2.5)	70.5 (15.5)	15 78.5 (3.1)	88.5 (19.5)	10 99 (3.9)	109 (24)	8 122 (4.8)		
	697 (7,500)	6.1 (13.5)	59 (13)	27 66 (2.6)	72.5 (16)	23 81.5 (3.2)	93 (20.5)	16 104 (4.1)	113.5 (25)	13 127 (5.0)		
	929 (10,000)	6.4 (14)	61.5 (13.5)	36 68.5 (2.7)	77.5 (17)	31 86.5 (3.4)	95.5 (21)	22 106.5 (4.2)	120.5 (26.5)	19 134.5 (5.3)		
Quebec City, Quebec	232 (2,500)	5.4 (12)	52.5 (11.5)	8 58.5 (2.3)	63.5 (14)	7 71 (2.8)	79.5 (17.5)	4.5 89 (3.5)	97.5 (21.5)	3.5 109 (4.3)		
	465 (5,000)	6.4 (14)	61.5 (13.5)	18 68.5 (2.7)	70.5 (15.5)	15 78.5 (3.1)	84 (18.5)	10 94 (3.7)	104.5 (23)	8 117 (4.6)		
	697 (7,500)	6.6 (14.6)	63.5 (14)	28 71 (2.8)	72.5 (16)	23 81.5 (3.2)	86.5 (19)	15 96.5 (3.8)	107 (23.5)	12 119.5 (4.7)		
	929 (10,000)	7.1 (15.6)	68 (15)	37 76 (3.0)	77.5 (17)	31 86.5 (3.4)	88.5 (19.5)	20 99 (3.9)	109 (24)	17 122 (4.8)		
Regina, Saskatchewan	232 (2,500)	4.5 (9.9)	43 (9.5)	7 48.5 (1.9)	54.5 (12)	6 61 (2.4)	72.5 (16)	4 81.5 (3.2)	79.5 (17.5)	3 89 (3.5)		
	465 (5,000)	6.4 (14)	61.5 (13.5)	18 68.5 (2.7)	68 (15)	14 76 (3.0)	86.5 (19)	10 96.5 (3.8)	97.5 (21.5)	7.5 109 (4.3)		
	697 (7,500)	7.3 (16.1)	70.5 (15.5)	29 78.5 (3.1)	77.5 (17)	24 86.5 (3.4)	100 (22)	17 112 (4.4)	109 (24)	12 122 (4.8)		
	929 (10,000)	8.3 (18.2)	79.5 (17.5)	40 89 (3.5)	82 (18)	32 91.5 (3.6)	104.5 (23)	24 117 (4.6)	118 (26)	18 132 (5.2)		
Saskatoon, Saskatchewan	232 (2,500)	4.0 (8.8)	38.5 (8.5)	6 43 (1.7)	57 (12.5)	6 63.5 (2.5)	66 (14.5)	3.8 73.5 (2.9)	77.5 (17)	2.8 86.5 (3.4)		
	465 (5,000)	5.7 (12.5)	54.5 (12)	16 61 (2.4)	68 (15)	14.5 76 (3.0)	82 (18)	9 91.5 (3.6)	95.5 (21)	7 106.5 (4.2)		
	697 (7,500)	6.6 (14.6)	63.5 (14)	28 71 (2.8)	75 (16.5)	24 84 (3.3)	91 (20)	16 101.5 (4.0)	104.5 (23)	12 117 (4.6)		
	929 (10,000)	7.1 (15.6)	68 (15)	38 76 (3.0)	82 (18)	32 91.5 (3.6)	97.5 (21.5)	22 109 (4.3)	113.5 (25)	18 127 (5.0)		

ZURN

Control-Flo Roof Drains

the most advanced drainage control available,
lets you design roof drainage systems with confidence

Check These ZURN Engineered Features

Large 955cm² (148 Square-Inch) Open Area Dome permits unobstructed flow. Dome is made of lightweight, shock-resistant aluminum and is bayonet-locked to gravel guard on weir. Aluminum Dome supplied when specified. Poly-Dome supplied standard.

Multi-weir Barrier provides flow rates directly proportional to the head. Available with 1 to 6 inverted parabolic notches to meet varying requirements.

Gravel

Insulation

Waterproofing Membrane

Metal Roof Deck

Extension Sleeve Accommodates the Addition of Insulation to a roof deck. Height as required by thickness of insulation.

Integral Clamping-Collar at bottom of weir provides positive clamping action without puncturing roof or flashing. Also provides integral gravel guard.

Bayonet-type Locking Device on dome holds dome firmly in place with weir yet allows dome to be easily removed.

Broad Plane Surface combines with clamping collar to hold flashing and roofing felts in tight vise-like grip.

Roof Sump Receiver Distributes Weight of drain over 3716cm² (4 square feet). Supports the drain body and assures flush, roof-level placement.

Underdeck Clamp For Rigid Mounting stabilizes the entire assembly and renders it an integral part of the roof structure.

Threaded, caulk, M. J. connections available. (Z-105-5-ERC w/Aluminum dome illustrated.)

ZURN

ZURN DRAINAGE AND CONTROL SYSTEMS LTD.

Telephone: (416) 741-8260

Fax: (416) 741-7477

APPENDIX G

WATER QUALITY TREATMENT UNIT INFORMATION



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION
BASED ON THE RATIONAL RAINFALL METHOD
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



Project Name: 20 Frank Nighbor Place

Engineer: Novatech

Location: Kanata, ON

Contact: Stephen Matthews

OGS #: OGS

Report Date: 6-Feb-18

Area 1.91 ha

Rainfall Station # 215

Weighted C 0.72

Particle Size Distribution FINE

CDS Model 2020

CDS Treatment Capacity 31 l/s

<u>Rainfall Intensity¹</u> <u>(mm/hr)</u>	<u>Percent Rainfall</u> <u>Volume¹</u>	<u>Cumulative Rainfall</u> <u>Volume</u>	<u>Total Flowrate</u> <u>(l/s)</u>	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
1.0	10.6%	19.8%	3.8	3.8	12.3	95.3	10.1
1.5	9.9%	29.7%	5.8	5.8	18.5	93.5	9.3
2.0	8.4%	38.1%	7.7	7.7	24.7	91.8	7.7
2.5	7.7%	45.8%	9.6	9.6	30.9	90.0	6.9
3.0	5.9%	51.7%	11.5	11.5	37.0	88.2	5.2
3.5	4.4%	56.1%	13.5	13.5	43.2	86.5	3.8
4.0	4.7%	60.7%	15.4	15.4	49.4	84.7	4.0
4.5	3.3%	64.0%	17.3	17.3	55.6	82.9	2.8
5.0	3.0%	67.1%	19.2	19.2	61.7	81.2	2.5
6.0	5.4%	72.4%	23.1	23.1	74.1	77.6	4.2
7.0	4.4%	76.8%	26.9	26.9	86.4	74.1	3.2
8.0	3.5%	80.3%	30.8	30.8	98.8	70.5	2.5
9.0	2.8%	83.2%	34.6	31.2	100.0	63.2	1.8
10.0	2.2%	85.3%	38.5	31.2	100.0	56.8	1.2
15.0	7.0%	92.3%	57.7	31.2	100.0	37.9	2.6
20.0	4.5%	96.9%	76.9	31.2	100.0	28.4	1.3
25.0	1.4%	98.3%	96.2	31.2	100.0	22.7	0.3
30.0	0.7%	99.0%	115.4	31.2	100.0	18.9	0.1
35.0	0.5%	99.5%	134.6	31.2	100.0	16.2	0.1
40.0	0.5%	100.0%	153.9	31.2	100.0	14.2	0.1
45.0	0.0%	100.0%	173.1	31.2	100.0	12.6	0.0
50.0	0.0%	100.0%	192.3	31.2	100.0	11.4	0.0

78.5

Removal Efficiency Adjustment² = 6.5%


Predicted Net Annual Load Removal Efficiency = 72.0%

Predicted Annual Rainfall Treated = 90.9%

1 - Based on 42 years of hourly rainfall data from Canadian Station 6105976, Ottawa ON


2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

PLAN VIEW

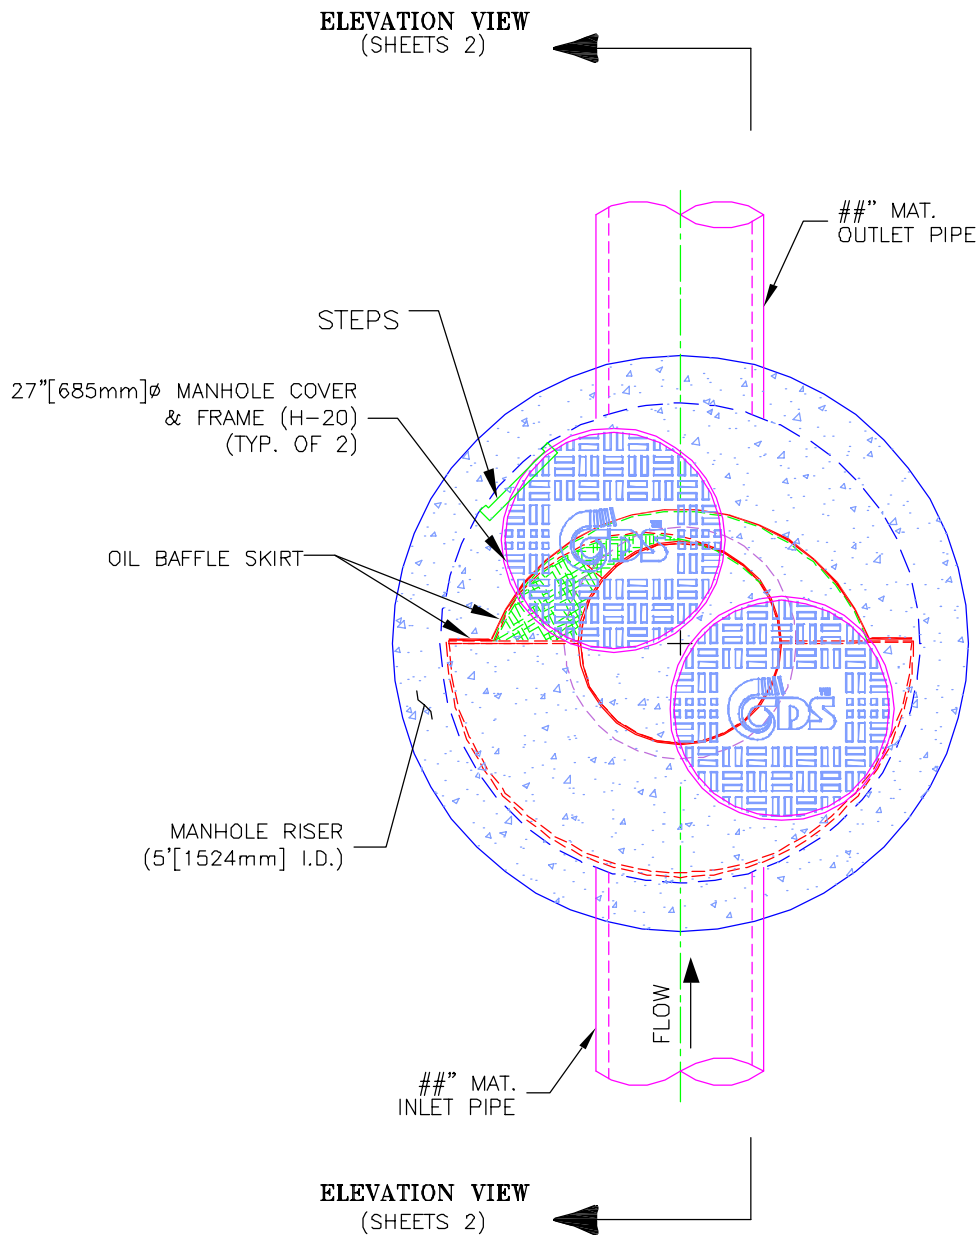

MODEL CDS20_20m, 31 L/s TREATMENT CAPACITY
STORM WATER TREATMENT UNIT

ELEVATION VIEW

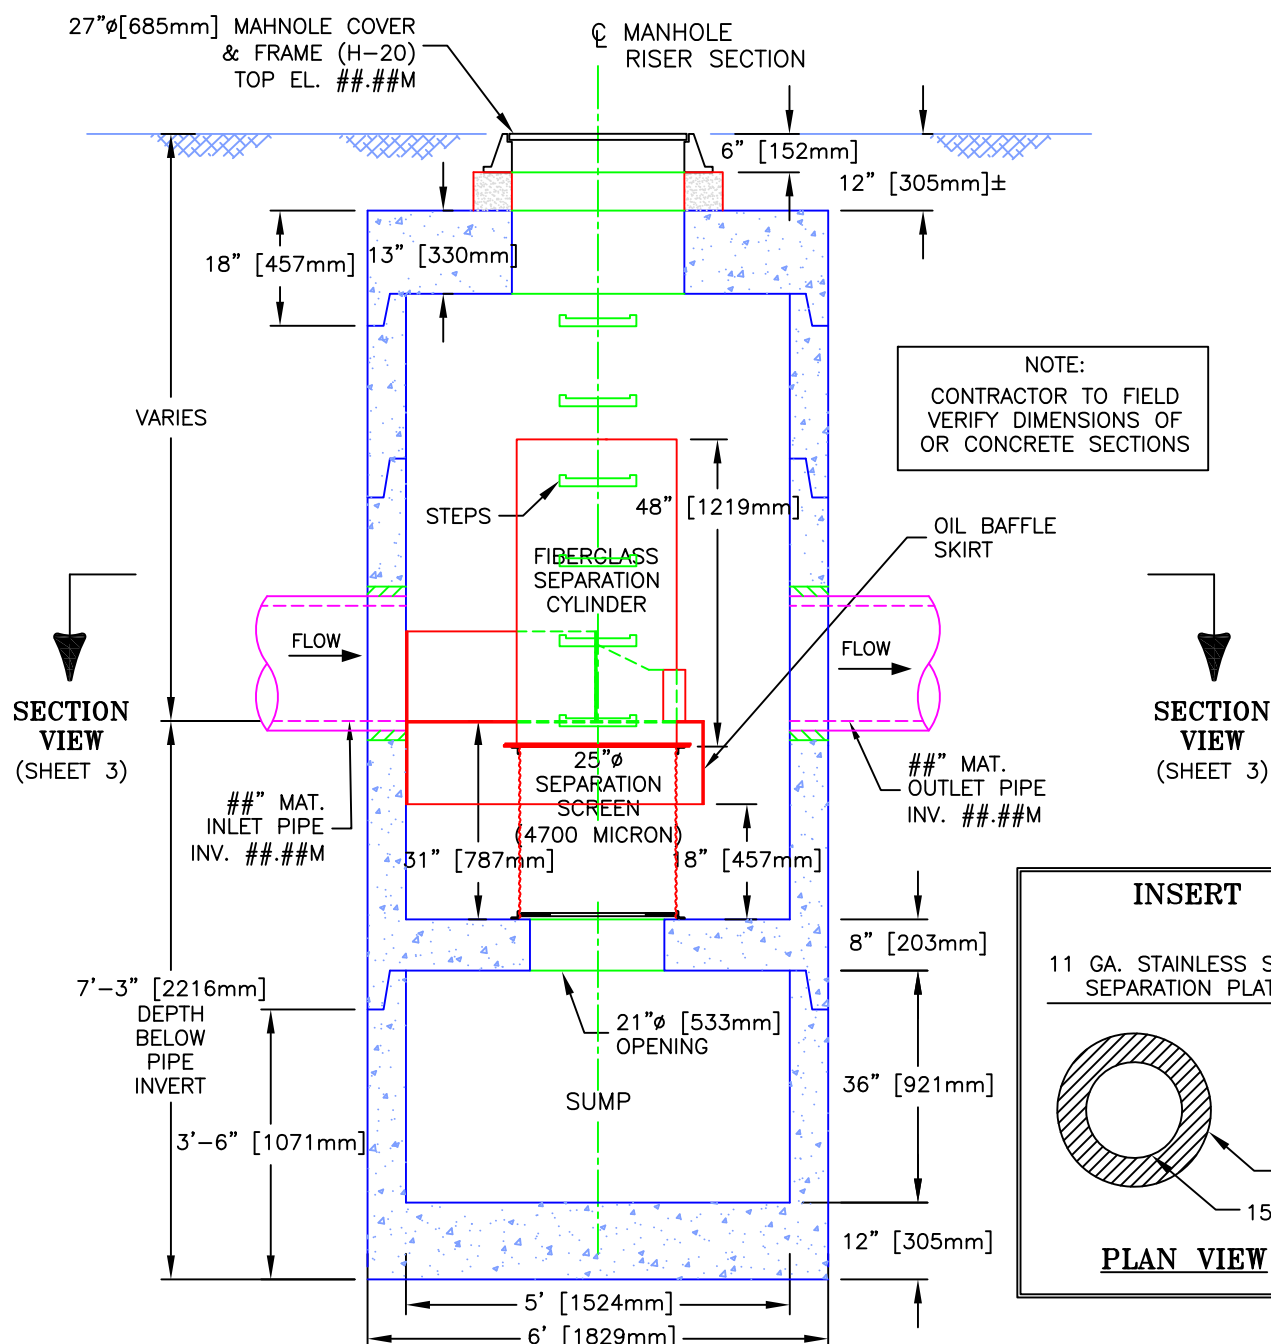

MODEL CDS20_20m, 31 L/s TREATMENT CAPACITY STORM WATER TREATMENT UNIT

CDS Guide Operation, Design, Performance and Maintenance



CDS®

Using patented continuous deflective separation technology, the CDS system screens, separates and traps debris, sediment, and oil and grease from stormwater runoff. The indirect screening capability of the system allows for 100% removal of floatables and neutrally buoyant material without blinding. Flow and screening controls physically separate captured solids, and minimize the re-suspension and release of previously trapped pollutants. Inline units can treat up to 6 cfs, and internally bypass flows in excess of 50 cfs. Available precast or cast-in-place, offline units can treat flows from 1 to 300 cfs. The pollutant removal capacity of the CDS system has been proven in lab and field testing.


Operation Overview

Stormwater enters the diversion chamber where the diversion weir guides the flow into the unit's separation chamber and pollutants are removed from the flow. All flows up to the system's treatment design capacity enter the separation chamber and are treated.

Swirl concentration and screen deflection force floatables and solids to the center of the separation chamber where 100% of floatables and neutrally buoyant debris larger than the screen apertures are trapped.

Stormwater then moves through the separation screen, under the oil baffle and exits the system. The separation screen remains clog free due to continuous deflection.

During the flow events exceeding the design capacity, the diversion weir bypasses excessive flows around the separation chamber, so captured pollutants are retained in the separation cylinder.

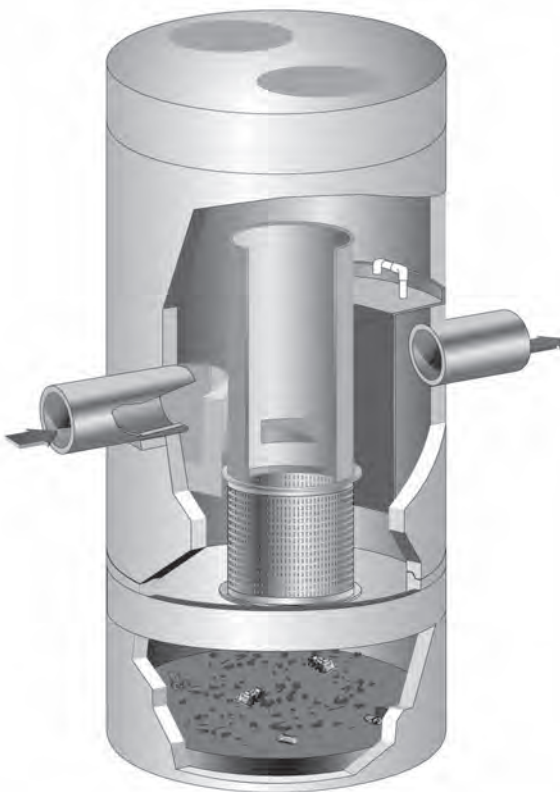

Design Basics

There are three primary methods of sizing a CDS system. The Water Quality Flow Rate Method determines which model size provides the desired removal efficiency at a given flow rate for a defined particle size. The Rational Rainfall Method™ and Probabalistic Method are used when a specific removal efficiency of the net annual sediment load is required.

Typically in the United States, CDS systems are designed to achieve an 80% annual solids load reduction based on lab generated performance curves for a gradation with an average particle size (d50) of 125-microns (μm). For some regulatory environments, CDS systems can also be designed to achieve an 80% annual solids load reduction based on an average particle size (d50) of 75-microns (μm).

Water Quality Flow Rate Method

In many cases, regulations require that a specific flow rate, often referred to as the water quality design flow (WQQ), be treated. This WQQ represents the peak flow rate from either an event with a specific recurrence interval (i.e. the six-month storm) or a water quality depth (i.e. 1/2-inch of rainfall).

The CDS is designed to treat all flows up to the WQQ. At influent rates higher than the WQQ, the diversion weir will direct most flow exceeding the treatment flow rate around the separation chamber. This allows removal efficiency to remain relatively constant in the separation chamber and reduces the risk of washout during bypass flows regardless of influent flow rates.

Treatment flow rates are defined as the rate at which the CDS will remove a specific gradation of sediment at a specific removal efficiency. Therefore they are variable based on the gradation and removal efficiency specified by the design engineer.

Rational Rainfall Method™

Differences in local climate, topography and scale make every site hydraulically unique. It is important to take these factors into consideration when estimating the long-term performance of any stormwater treatment system. The Rational Rainfall Method combines site-specific information with laboratory generated performance data, and local historical precipitation records to estimate removal efficiencies as accurately as possible.

Short duration rain gauge records from across the United States and Canada were analyzed to determine the percent of the total annual rainfall that fell at a range of intensities. US stations' depths were totaled every 15 minutes, or hourly, and recorded in 0.01-inch increments. Depths were recorded hourly with 1-mm resolution at Canadian stations. One trend was consistent at all sites; the vast majority of precipitation fell at low intensities and high intensity storms contributed relatively little to the total annual depth.

These intensities, along with the total drainage area and runoff coefficient for each specific site, are translated into flow rates using the Rational Rainfall Method. Since most sites are relatively small and highly impervious, the Rational Rainfall Method is appropriate. Based on the runoff flow rates calculated for each intensity, operating rates within a proposed CDS system are determined. Performance efficiency curve determined from full scale laboratory tests on defined sediment PSDs is applied to

calculate solids removal efficiency. The relative removal efficiency at each operating rate is added to produce a net annual pollutant removal efficiency estimate.

Probabilistic Rational Method

The Probabilistic Rational Method is a sizing program CONTECH developed to estimate a net annual sediment load reduction for a particular CDS model based on site size, site runoff coefficient, regional rainfall intensity distribution, and anticipated pollutant characteristics.

The Probabilistic rational method is an extension of the rational method used to estimate peak discharge rates generated by storm events of varying statistical return frequencies (i.e.: 2-year storm event). Under this method, an adjustment factor is used to adjust the runoff coefficient estimated for the 10-year event, correlating a known hydrologic parameter with the target storm event. The rainfall intensities vary depending on the return frequency of the storm event under consideration. In general, these two frequency dependent parameters increase as the return frequency increases while the drainage area remains constant.

These intensities, along with the total drainage area and runoff coefficient for each specific site, are translated into flow rates using the Rational Method. Since most sites are relatively small and highly impervious, the Rational Method is appropriate. Based on the runoff flow rates calculated for each intensity, operating rates within a proposed CDS are determined. Performance efficiency curve on defined sediment PSDs is applied to calculate solids removal efficiency. The relative removal efficiency at each operating rate is added to produce a net annual pollutant removal efficiency estimate.

Treatment Flow Rate

The inlet throat area is sized to ensure that the WQQ passes through the separation chamber at a water surface elevation equal to the crest of the diversion weir. The diversion weir bypasses excessive flows around the separation chamber, thus helping to prevent re-suspension or re-entrainment of previously captured particles.

Hydraulic Capacity

CDS hydraulic capacity is determined by the length and height of the diversion weir and by the maximum allowable head in the system. Typical configurations allow hydraulic capacities of up to ten times the treatment flow rate. As needed, the crest of the diversion weir may be lowered and the inlet throat may be widened to increase the capacity of the system at a given water surface elevation. The unit is designed to meet project specific hydraulics.

Performance

Full-Scale Laboratory Test Results

A full-scale CDS unit (Model CDS2020-5B) was tested at the facility of University of Florida, Gainesville, FL. This full-scale CDS unit was evaluated under controlled laboratory conditions of pumped influent and the controlled addition of sediment.

Two different gradations of silica sand material (UF Sediment & OK-110) were used in the CDS performance evaluation. The particle size distributions (PSD) of the test materials were

analyzed using standard method "Gradation ASTM D-422 with Hydrometer" by a certified laboratory. UF Sediment is a mixture of three different U.S. Silica Sand products referred as: "Sil-Co-Sil 106", "#1 DRY" and "20/40 Oil Frac". Particle size distribution analysis shows that the UF Sediment has a very fine gradation ($d_{50} = 20$ to $30 \mu\text{m}$) covering a wide size range (uniform coefficient C_u averaged at 10.6). In comparison with the hypothetical TSS gradation specified in the NJDEP (New Jersey Department of Environmental Protection) and NJCAT (New Jersey Corporation for Advanced Technology) protocol for lab testing, the UF Sediment covers a similar range of particle size but with a finer d_{50} (d_{50} for NJDEP is approximately $50 \mu\text{m}$) (NJDEP, 2003). The OK-110 silica sand is a commercial product of U.S. Silica Sand. The particle size distribution analysis of this material, also included in Figure 1, shows that 99.9% of the OK-110 sand is finer than 250 microns, with a mean particle size (d_{50}) of 106 microns. The PSDs for the test material are shown in Figure 1.

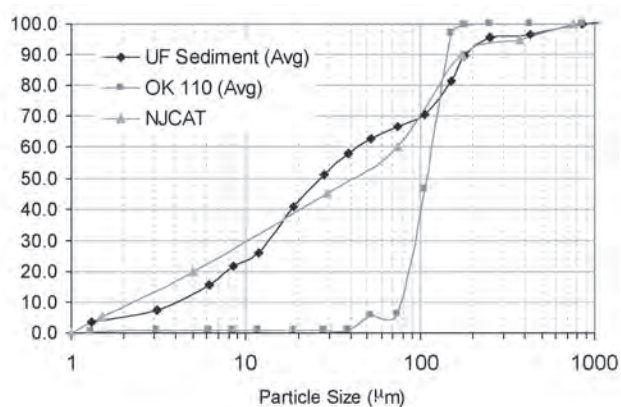


Figure 1. Particle size distributions for the test materials, as compared to the NJCAT/NJDEP theoretical distribution.

Tests were conducted to quantify the CDS unit (1.1 cfs (31.3-L/s) design capacity) performance at various flow rates, ranging from 1% up to 125% of the design capacity of the unit, using the 2400 micron screen. All tests were conducted with controlled influent concentrations approximately 200 mg/L. Effluent samples were taken at equal time intervals across the entire duration of each test run. These samples were then processed with a Dekaport Cone sample splitter to obtain representative sub-samples for Suspended Sediment Concentration (SSC – ASTM Standard Method D3977-97) and particle size distribution analysis.

Results and Modeling

Based on the testing data from the University of Florida, a performance model was developed for the CDS system. A regression analysis was used to develop a fitting curve for the scattered data points at various design flow rates. This model, which demonstrated good agreement with the laboratory data, can then be used to predict CDS system performance with respect to SSC removal for any particle size gradation assuming sandy-silt type of inorganic components of SSC. Figure 2 shows CDS predictive performance for two typical particle size gradations (NJCAT gradation and OK-110 sand).

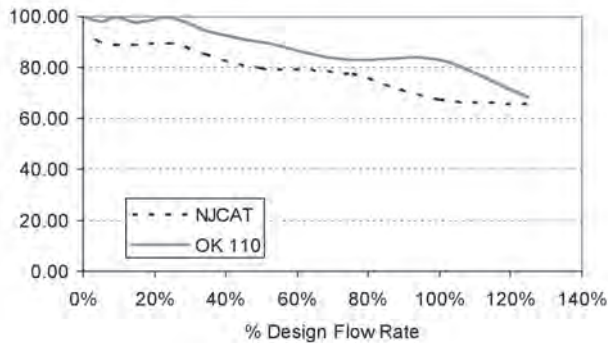


Figure 2. CDS stormwater treatment predictive performance for various particle gradations as a function of operating rate.

Many regulatory jurisdictions set a performance standard for hydrodynamic devices by stating that the devices shall be capable of achieving an 80% removal efficiency for particles having a mean particle size (d_{50}) of 125 microns (WADOE, 2008). The model can be used to calculate the expected performance of such a PSD (shown in Figure 3). Supported by the laboratory data, the model indicates (Figure 4) that the CDS system with 2400 micron screen achieves approximately 80% removal at 100% of design flow rate, for this particle size distribution ($d_{50} = 125 \mu\text{m}$).

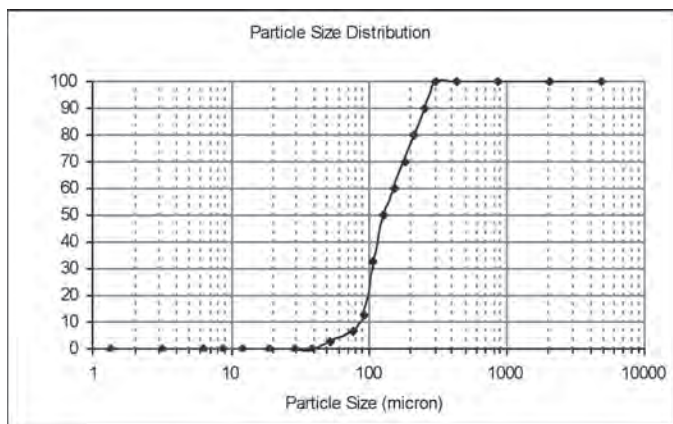


Figure 3. PSD with $d_{50} = 125$ microns, used to model performance for Ecology submittal.

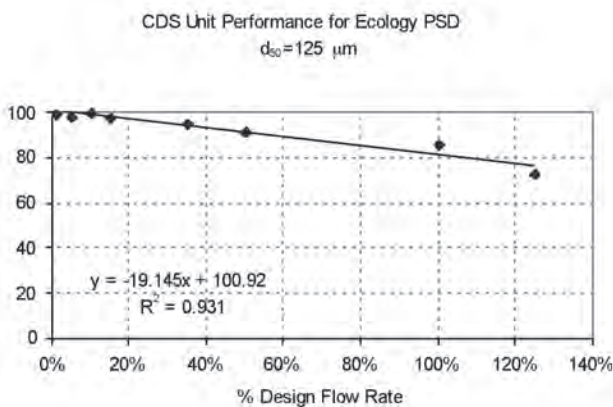


Figure 4. Modeled performance for CDS unit with 2400 microns screen, using Ecology PSD.

Maintenance

The CDS system should be inspected at regular intervals and maintained when necessary to ensure optimum performance. The rate at which the system collects pollutants will depend more heavily on site activities than the size of the unit, e.g., unstable soils or heavy winter sanding will cause the grit chamber to fill more quickly but regular sweeping of paved surfaces will slow accumulation.

Inspection

Inspection is the key to effective maintenance and is easily performed. Pollutant deposition and transport may vary from year to year and regular inspections will help insure that the system is cleaned out at the appropriate time. At a minimum, inspections should be performed twice per year (i.e. spring and fall) however more frequent inspections may be necessary in climates where winter sanding operations may lead to rapid accumulations, or in equipment washdown areas. Additionally, installations should be inspected more frequently where excessive amounts of trash are expected.

The visual inspection should ascertain that the system components are in working order and that there are no blockages or obstructions to inlet and/or separation screen. The inspection should also identify evidence of vector infestation and accumulations of hydrocarbons, trash, and sediment in the system. Measuring pollutant accumulation can be done with a calibrated dipstick, tape measure or other measuring instrument. If sorbent material is used for enhanced removal of hydrocarbons then the level of discoloration of the sorbent material should also



be identified during inspection. It is useful and often required as part of a permit to keep a record of each inspection. A simple form for doing so is provided.

Access to the CDS unit is typically achieved through two manhole access covers. One opening allows for inspection and cleanout of the separation chamber (screen/cylinder) and isolated sump. The other allows for inspection and cleanout of sediment captured and retained behind the screen. For units possessing a sizable depth below grade (depth to pipe), a single manhole access point would allow both sump cleanout and access behind the screen.

The CDS system should be cleaned when the level of sediment has reached 75% of capacity in the isolated sump and/or when an appreciable level of hydrocarbons and trash has accumulated. If sorbent material is used, it should be replaced when significant discoloration has occurred. Performance will not be impacted until 100% of the sump capacity is exceeded however it is recommended that the system be cleaned prior to that for easier removal of sediment. The level of sediment is easily determined by measuring from finished grade down to the top of the sediment pile. To avoid underestimating the level of sediment in the chamber, the measuring device must be lowered to the top of the sediment pile carefully. Finer, silty particles at the top of the pile typically offer less resistance to the end of the rod than larger particles toward the bottom of the pile. Once this measurement is recorded, it should be compared to the as-built drawing for the unit to determine if the height of the sediment pile off the bottom of the sump floor exceeds 75% of the total height of isolated sump.

Cleaning

Cleaning of the CDS systems should be done during dry weather conditions when no flow is entering the system. Cleanout of the CDS with a vacuum truck is generally the most effective and convenient method of excavating pollutants from the system. Simply remove the manhole covers and insert the vacuum hose into the sump. The system should be completely drained down and the sump fully evacuated of sediment. The area outside the screen should be pumped out also if pollutant build-up exists in this area.

In installations where the risk of petroleum spills is small, liquid contaminants may not accumulate as quickly as sediment. However, an oil or gasoline spill should be cleaned out immediately. Motor oil and other hydrocarbons that accumulate on a more routine basis should be removed when an appreciable layer has been captured. To remove these pollutants, it may be preferable to use adsorbent pads since they are usually less expensive to dispose than the oil/water emulsion that may be created by vacuuming the oily layer. Trash can be netted out if you wish to separate it from the other pollutants. The screen should be power washed to ensure it is free of trash and debris.


Manhole covers should be securely seated following cleaning activities to prevent leakage of runoff into the system from above and also to ensure proper safety precautions. Confined Space Entry procedures need to be followed. Disposal of all material removed from the CDS system should be done in accordance with local regulations. In many locations, disposal of evacuated sediments may be handled in the same manner as disposal of sediments removed from catch basins or deep sump manholes. Check your local regulations for specific requirements on disposal.



CDS Model	Diameter		Distance from Water Surface to Top of Sediment Pile		Sediment Storage Capacity	
	ft	m	ft	m	yd3	m3
CDS2015-4	4	1.2	3.0	0.9	0.5	0.4
CDS2015	5	1.5	3.0	0.9	1.3	1.0
CDS2020	5	1.5	3.5	1.1	1.3	1.0
CDS2025	5	1.5	4.0	1.2	1.3	1.0
CDS3020	6	1.8	4.0	1.2	2.1	1.6
CDS3030	6	1.8	4.6	1.4	2.1	1.6
CDS3035	6	1.8	5.0	1.5	2.1	1.6
CDS4030	8	2.4	4.6	1.4	5.6	4.3
CDS4040	8	2.4	5.7	1.7	5.6	4.3
CDS4045	8	2.4	6.2	1.9	5.6	4.3

Table 1: CDS Maintenance Indicators and Sediment Storage Capacities

Note: To avoid underestimating the volume of sediment in the chamber, carefully lower the measuring device to the top of the sediment pile. Finer silty particles at the top of the pile may be more difficult to feel with a measuring stick. These finer particles typically offer less resistance to the end of the rod than larger particles toward the bottom of the pile.

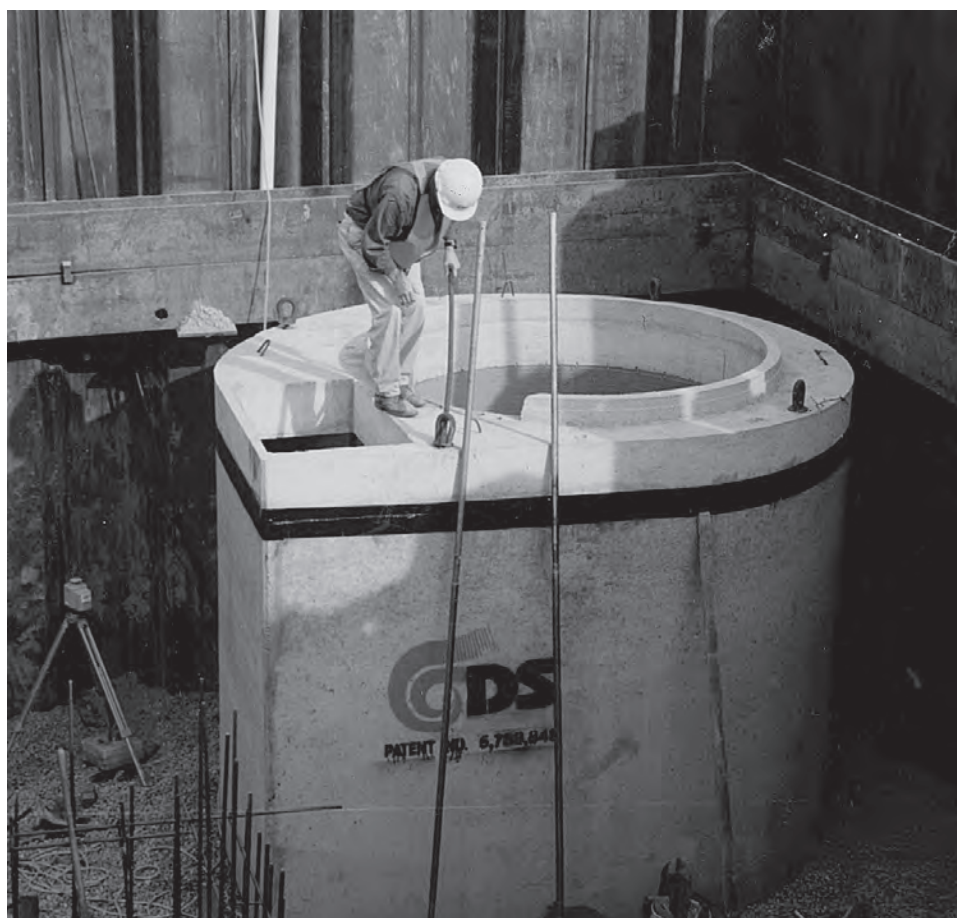

CDS Inspection & Maintenance Log

CDS Model: _____ Location: _____

[illegible]

1. The water depth to sediment is determined by taking two measurements with a stadia rod: one measurement from the manhole opening to the top of the sediment pile and the other from the manhole opening to the water surface. If the difference between these measurements is less than eighteen inches the system should be cleaned out. **Note: To avoid underestimating the volume of sediment in the chamber, the measuring device must be carefully lowered to the top of the sediment pile.**
2. For optimum performance, the system should be cleaned out when the floating hydrocarbon layer accumulates to an appreciable thickness. In the event of an oil spill, the system should be cleaned immediately.

Support

- Drawings and specifications are available at www.contechstormwater.com.
- Site-specific design support is available from our engineers.



800.925.5240

contechstormwater.com

©2008 CONTECH Stormwater Solutions

CONTECH Construction Products Inc. provides site solutions for the civil engineering industry. CONTECH's portfolio includes bridges, drainage, sanitary sewer, stormwater and earth stabilization products. For information on other CONTECH division offerings, visit contech-cpi.com or call 800.338.1122

Nothing in this catalog should be construed as an expressed warranty or an implied warranty of merchantability or fitness for any particular purpose. See the CONTECH standard quotation or acknowledgement for applicable warranties and other terms and conditions of sale.

The product(s) described may be protected by one or more of the following US patents: 5,322,629; 5,624,576; 5,707,527; 5,759,415; 5,788,848; 5,985,157; 6,027,639; 6,350,374; 6,406,218; 6,641,720; 6,511,595; 6,649,048; 6,991,114; 6,998,038; 7,186,058; 7,296,692; 7,297,266; related foreign patents or other patents pending.

PROPOSED WATER SERVICE TABLE			
STATION	SURFACE ELEVATION	T/W/M ELEVATION	COMMENTS
0+000	95.35	92.35±	TEE CONNECTION TO EX. 300mmØ WM
0+001	95.32	92.35±	200mmØ VALVE AND VALVE BOX
0+004.7	95.23	92.53	CROSS ABOVE EX. 4500 SAN (±0.85m CLEARANCE)
0+006	95.20	92.53	11.25° HORIZONTAL BEND
0+022	94.93	92.53	CROSS BELOW 250mmØ STM (±0.63m CLEARANCE)
0+025	95.00	92.53	-
0+050	94.98	92.53	-
0+058.2	94.93	92.53	CROSS BELOW 300mmØ STM (±0.75m CLEARANCE)
0+075	95.14	92.53	-
0+092.7	94.93	92.53	22.5° HORIZONTAL BEND
0+094.4	94.92	92.52	CROSS BELOW 375mmØ STM (±0.77m CLEARANCE)
0+098.1	94.90	92.50	22.5° HORIZONTAL BEND
0+100.9	94.97	92.57	200 x 200 x 150 HYDRANT TEE
0+102.9	94.98	92.58	200 x 150 REDUCER
0+103.9	94.99	92.59	45° HORIZONTAL BEND
0+106.0	95.01	92.61	150mmØ VALVE AND VALVE BOX
0+015.2	95.10	92.70	45° HORIZONTAL BEND
0+119.5	95.33	92.75	CAP 1.0m FROM BUILDING FACE
1+000	94.97	92.57	200 x 200 x 150 HYDRANT TEE
1+005	94.97	92.57	150mmØ VALVE AND VALVE BOX
1+007.5	95.15	92.57	FIRE HYDRANT

300mm x 300mm x 200mm TEE CONNECTION TO EXISTING 300mmØ WATERMAIN. EXACT ELEVATION TO BE FIELD DETERMINED.

WATERMAIN NOTES:

- SUPPLY AND CONSTRUCT ALL WATERMAINS AND APPURTENANCES IN ACCORDANCE WITH THE CITY OF OTTAWA STANDARDS AND SPECIFICATIONS. EXCAVATION, INSTALLATION, BACKFILL AND RESTORATION OF ALL WATERMAINS BY THE CONTRACTOR. CONNECTIONS AND SHUT-OFFS AT THE MAIN AND CHLORINATION OF THE WATER SYSTEM SHALL BE PERFORMED BY THE CONTRACTOR IN THE PRESENCE CITY OF OTTAWA FORCES.
- SPECIFICATIONS:

ITEM	SPEC. No.	REFERENCE
WATERMAIN TRENCHING	W17	CITY OF OTTAWA
THERMAL INSULATION IN SHALLOW TRENCHES	W22	CITY OF OTTAWA
WATERMAIN	PVC DR 18	
- WATERMAIN SHALL BE MINIMUM 2.4m DEPTH BELOW GRADE UNLESS OTHERWISE INDICATED.
- PROVIDE MINIMUM 0.5m CLEARANCE BETWEEN OUTSIDE OF PIPES AT ALL CROSSINGS.
- WATER SERVICE IS TO BE CONSTRUCTED TO WITHIN 1.0m OF FOUNDATION WALL AND CAPPED, UNLESS OTHERWISE INDICATED.

CAMP MART SITE FLOWS & STORMWATER MANAGEMENT TABLE						
DESIGN EVENT	PRE-DEVELOPMENT CONDITIONS		POST-DEVELOPMENT CONDITIONS			
	UNCONTROLLED FLOW (L/s)	ALLOWABLE RELEASE RATE (L/s)	A-0 FLOW (L/s)	A-1 FLOW (L/s)	A-2 FLOW (L/s)	TOTAL FLOW (L/s)
1:5 YR	115.3	99.5	6.1	23.5	24.7	28.1
1:100 YR	247.0	99.5	12.4	24.1	33.5	29.1

* REDUCED FLOW COMPARED TO PRE-DEVELOPMENT UNCONTROLLED CONDITIONS


ROOF DRAIN TABLE: AREA A-2 (ROOF DRAINS 1 TO 10)						
AREA ID*	ROOF DRAIN No. (ZURN MODEL)	NUMBER OF ROOF DRAIN NOTCHES	5-YEAR RELEASE RATE	APPROX. 5-YR PONDING DEPTH	100-YEAR RELEASE RATE	APPROX. 100-YR PONDING DEPTH
A-2	RD 1 (Z-105)	2 NOTCHES**	2.52 L/s	10 cm	3.16 L/s	13 cm
A-2	RD 2 (Z-105)	2 NOTCHES**	2.52 L/s	10 cm	3.16 L/s	13 cm
A-2	RD 3 (Z-105)	3 NOTCHES**	4.02 L/s	11 cm	5.67 L/s	14 cm
A-2	RD 4 (Z-105)	3 NOTCHES**	4.02 L/s	11 cm	5.67 L/s	14 cm
A-2	RD 5 (Z-105)	3 NOTCHES**	3.30 L/s	09 cm	4.74 L/s	13 cm
A-2	RD 6 (Z-105)	3 NOTCHES**	3.30 L/s	09 cm	4.74 L/s	13 cm
A-2	RD 7 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s	13 cm
A-2	RD 8 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s	13 cm
A-2	RD 9 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s	13 cm
A-2	RD 10 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s	13 cm

* REFER TO THE DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT (R-2018-011) PREPARED BY NOVATECH FOR DRAINAGE AREA IDENTIFIERS AND STORMWATER MANAGEMENT DETAILS.

**ALL CONTROLLED FLOW ROOF DRAINS FOR THE PROPOSED BUILDING TO BE ZURN CONTROL-FLO ROOF DRAINS WITH THE SPECIFIED NUMBER OF NOTCHES AS INDICATED ABOVE.

AREA A-1: INLET CONTROL DEVICE DATA - CBMH 1					
DESIGN EVENT	ICD TYPE (CIRCULAR PLUG)	DIAMETER OF OUTLET PIPE (mm)	DESIGN FLOW (L/s)	DESIGN HEAD (m)	VOLUME (m³)
1:5 YR	88mmØ ORIFCE	375	23.5	1.98	94.91
1:100 YR	88mmØ ORIFCE	375	24.1	2.08	95.01

AREA A-3: INLET CONTROL DEVICE DATA - CBMH 12					
DESIGN EVENT	ICD TYPE (CIRCULAR PLUG)	DIAMETER OF OUTLET PIPE (mm)	DESIGN FLOW (L/s)	DESIGN HEAD (m)	VOLUME (m³)
1:5 YR	100mmØ ORIFCE	375	28.1	1.70	94.90
1:100 YR	100mmØ ORIFCE	375	29.1	1.82	95.02

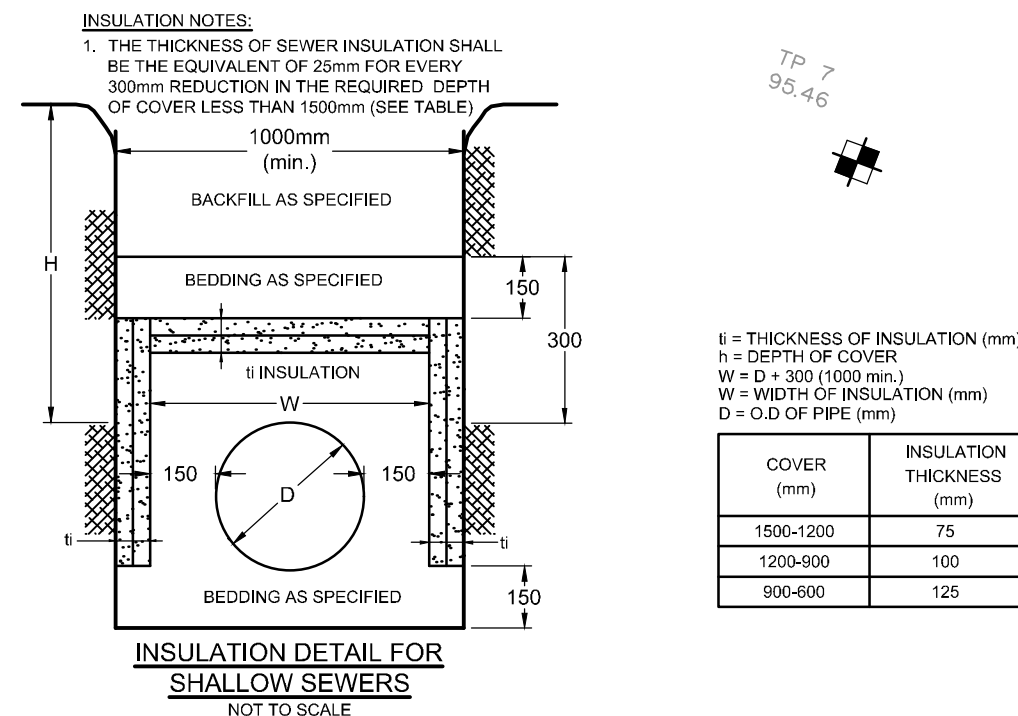

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

APPROVED ☐ REFUSED ☐

THIS ____ DAY OF _____, 20__

DERRICK MOODIE
MANAGER, DEVELOPMENT REVIEW - WEST
PLANNING, INFRASTRUCTURE & ECONOMIC
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

OWNER INFORMATION
20 FRANK NIGHBOR INC.
11266 FIFTH LINE
HALTON HILLS, ON, L7G 4S6
SUNNY BAINS
PHONE: 1-877-401-3423
sbains35@gmail.com


No.	REVISION	DATE	BY
3	REVISED PER CITY COMMENTS	MAY 24/18	FST
2	REVISED PER CITY COMMENTS	APR 23/18	FST
1	ISSUED FOR SITE PLAN APPROVAL	FEB 9/18	FST

SCALE

1:250

0 2 4 6 8 10

DESIGN	SM / FST
CHECKED	FST
DRAWN	SM
CHECKED	SM / FST
APPROVED	FST

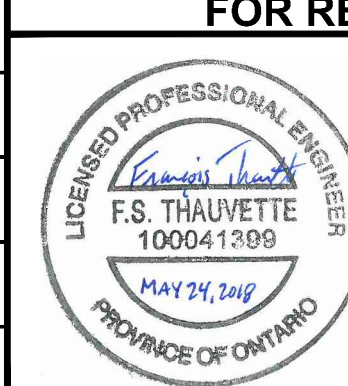

NOVATECH


Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowland Drive
Ottawa, Ontario, Canada K2M 1P6


Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

LOCATION
CITY OF OTTAWA
20 FRANK NIGHBOR PLACE - CAMP MART SITE

DRAWING NAME
GENERAL PLAN OF SERVICES

PROJECT No.	117193
REV	REV # 3
DRAWING No.	117193-GP1

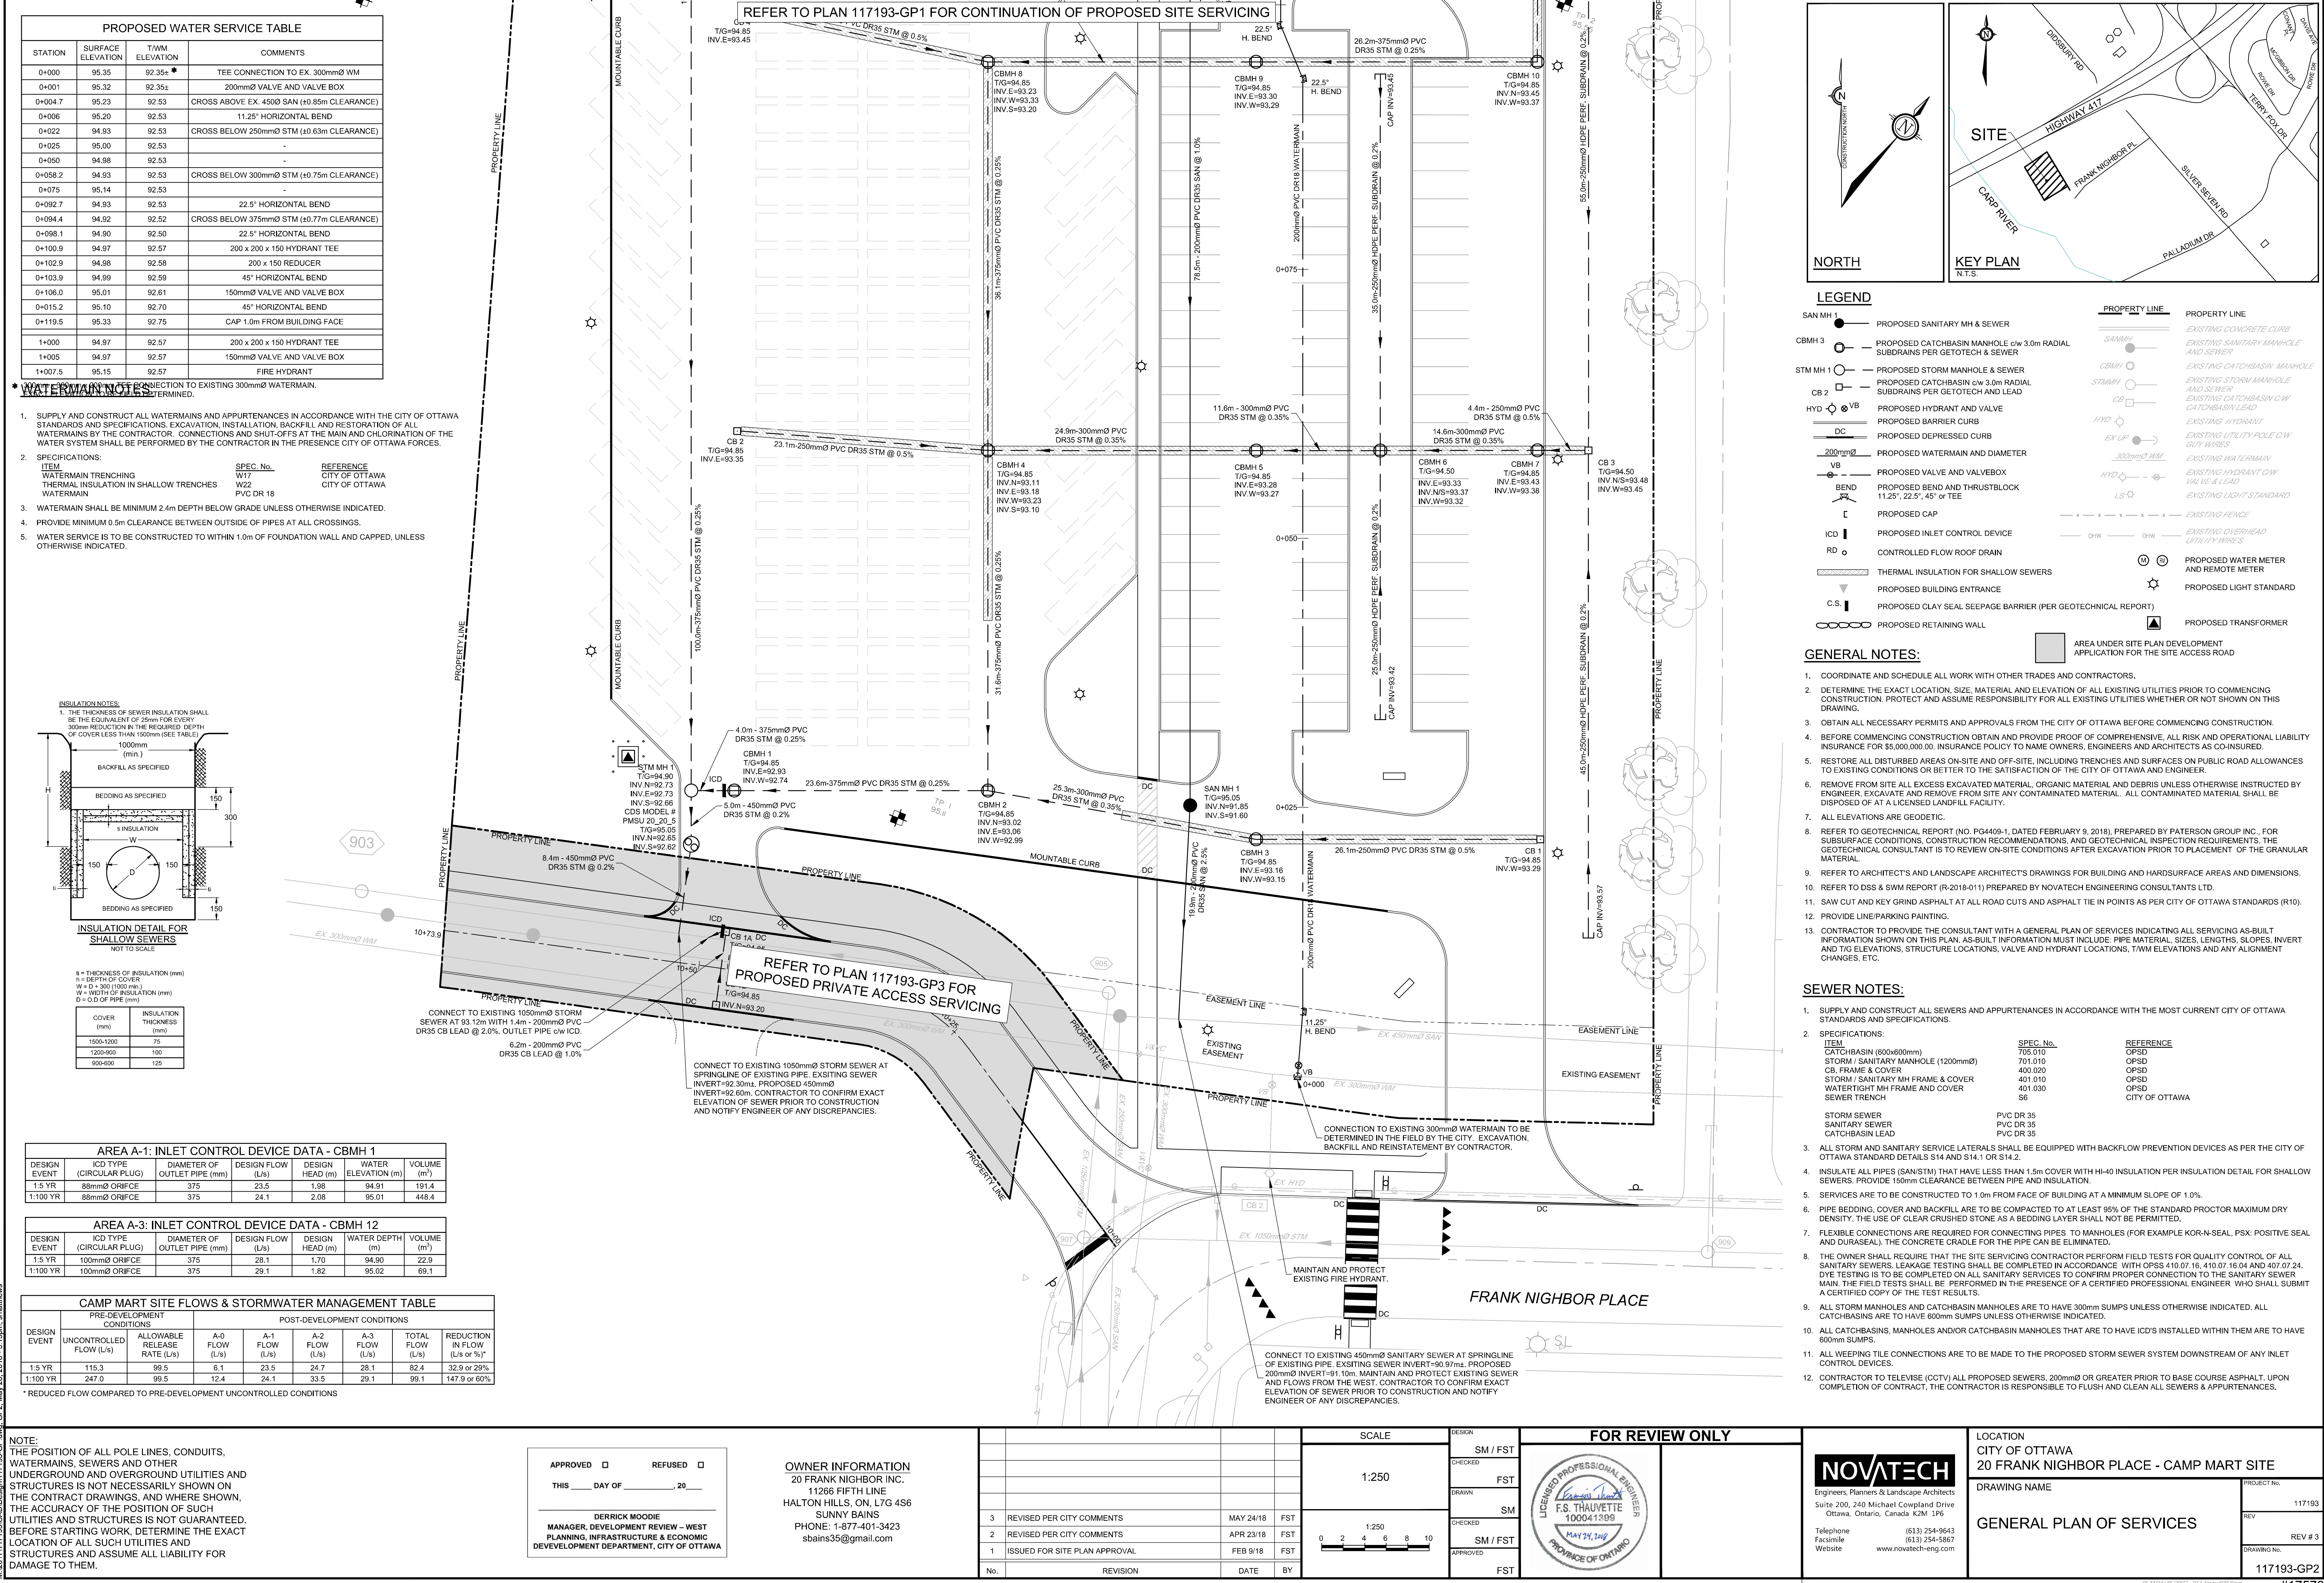

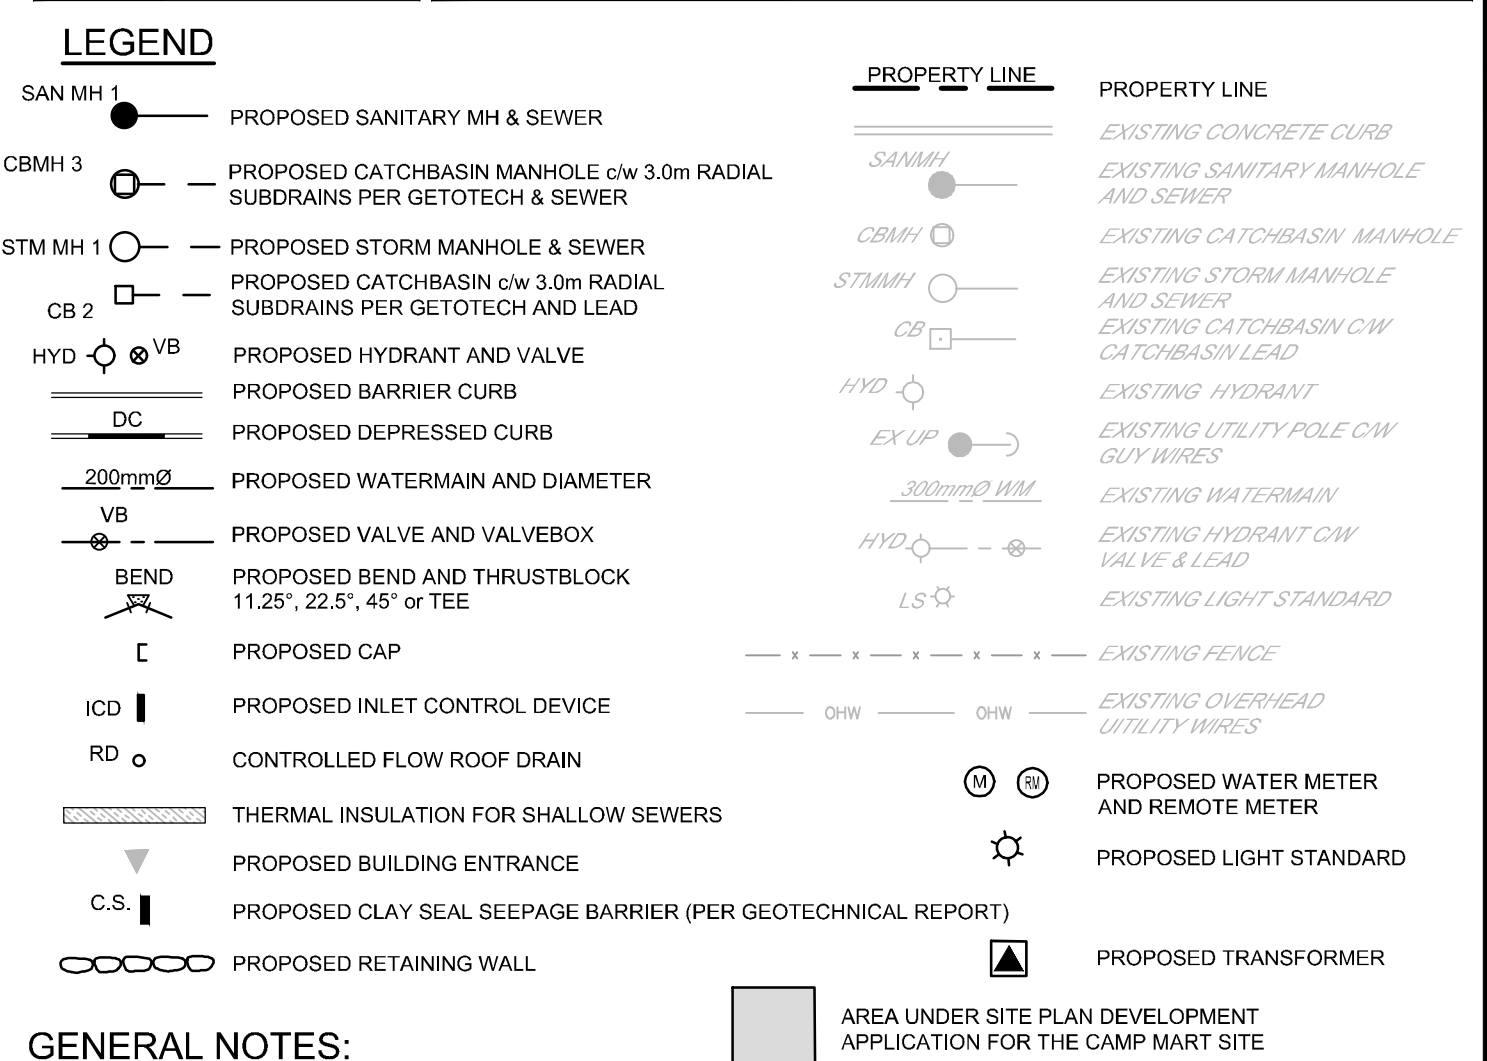


- ## GENERAL NOTES:
1. COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
 2. DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
 3. OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
 4. BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$500,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
 5. RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE CITY OF OTTAWA AND ENGINEER.
 6. REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
 7. ALL ELEVATIONS ARE GEODETIC.
 8. REFER TO GEOTECHNICAL REPORT (NO. P644094, DATED FEBRUARY 8, 2018), PREPARED BY PATERSON GROUP INC., FOR SUBSURFACE CONDITION, CONSTRUCTION RECOMMENDATIONS, AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
 9. REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARDSURFACE AREAS AND DIMENSIONS.
 10. REFER TO DSS & SWM REPORT (R-2018-011) PREPARED BY NOVATECH ENGINEERING CONSULTANTS LTD.
 11. SAW CUT AND KEY GRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).
 12. PROVIDE LINE/PARKING PAINTING.
 13. CONTRACTOR TO PROVIDE THE CONSULTANT WITH A GENERAL PLAN OF SERVICES INDICATING ALL SERVICES AS-BUILT INFORMATION SHOWN ON THIS PLAN. AS-BUILT INFORMATION MUST INCLUDE: PIPE MATERIAL, SIZES, LENGTHS, SLOPES, INVERT AND TO ELEVATIONS, STRUCTURE LOCATIONS, VALVE AND HYDRANT LOCATIONS, T/M/E ELEVATIONS AND ANY ALIGNMENT CHANGES, ETC.

1. SUPPLY AND CONSTRUCT ALL SEWERS AND APPURTENANCES IN ACCORDANCE WITH THE MOST CURRENT CITY OF OTTAWA STANDARDS AND SPECIFICATIONS.			
2. SPECIFICATIONS:			
ITEM	SPEC. No.	REFERENCE	
CATCHBASIN (600x600mm)	705.010	OPSD	
STORM / SANITARY MANHOLE (1200mmØ)	701.010	OPSD	
CB, FRAME & COVER	400.020	OPSD	
STORM / SANITARY MH FRAME & COVER	401.010	OPSD	
WATERTIGHT MH FRAME AND COVER	401.030	OPSD	
SEWER TRENCH	S6	CITY OF OTTAWA	
STORM SEWER	PVC DR 35		
SANITARY SEWER	PVC DR 35		
CATCHBASIN LEAD	PVC DR 35		
3. ALL STORM AND SANITARY SEWER LATERALS SHALL BE EQUIPPED WITH BACKFLOW PREVENTION DEVICES AS PER THE CITY OF OTTAWA STANDARD DETAILS S14 AND S14.1 OR S14.2.			
4. INSULATE ALL PIPES (SAN/STM) THAT HAVE LESS THAN 1.5m COVER WITH HI-40 INSULATION PER INSULATION DETAIL FOR SHALLOW SERVICES. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION.			
5. SERVICES ARE TO BE CONSTRUCTED TO 1.0m FROM FACE OF BUILDING AT A MINIMUM SLOPE OF 1.0%.			
6. PIPE BEDDING, COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY. THE USE OF CLEAR CRUSHED STONE AS A BEDDING LAYER SHALL NOT BE PERMITTED.			
7. FLEXIBLE CONNECTIONS ARE REQUIRED FOR CONNECTING PIPES TO MANHOLES (FOR EXAMPLE KORN-CAN SEAL, PSX POSITIVE SEAL AND QUANSAN ARE TO HAVE 600mm GULLIE FOR THIS CONNECTION). ALL GULLIES ARE TO BE ELIMINATED.			
8. THE OWNER SHALL REQUIRE THAT THE SITE SERVICING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSS 410.07.16, 410.07.16.04 AND 410.07.24. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER CONNECTION TO THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.			
9. ALL STORM MANHOLES AND CATCHBASIN MANHOLES ARE TO HAVE 300mm SUMPS UNLESS OTHERWISE INDICATED. ALL CATCHBASINS ARE TO HAVE 600mm SUMPS UNLESS OTHERWISE INDICATED.			
10. ALL CATCHBASINS, MANHOLES AND/OR CATCHBASIN MANHOLES ARE TO HAVE ICD'S INSTALLED WITHIN THEM ARE TO HAVE 600mm SUMPS.			
11. ALL WELDING TIE CONNECTIONS ARE TO BE MADE TO THE PROPOSED STORM SEWER SYSTEM DOWNSTREAM OF ANY INLET CONNECTION DEVICES.			
12. CONTRACTOR TO TELEVIEW (CCTV) ALL PROPOSED SEWERS, 200mmØ OR GREATER PRIOR TO BASE COURSE ASPHALT. UPON COMPLETION OF CONTRACT, THE CONTRACTOR IS RESPONSIBLE TO FLUSH AND CLEAN ALL SEWERS & APPURTENANCES.			


*REFER TO THE 'DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT' (R-2018-011) PREPARED BY NOVATECH FOR DRAINAGE AREA IDENTIFIERS AND STORMWATER MANAGEMENT DETAILS.

**REDUCED FLOW COMPARED TO PRE-DEVELOPMENT UNCONTROLLED CONDITIONS.


REFER TO PLANS 117193-GP1
AND 117193-GP2 FOR PROPOSED
SERVICING ON LOT # 1

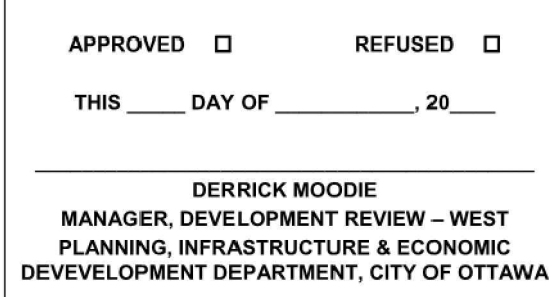

3	REVISED PER CITY COMMENTS	MAY 24/18	F5	
2	REVISED PER CITY COMMENTS	APR 23/18	F5	
1	ISSUED FOR SITE PLAN APPROVAL	FEB 9/18	F5	
No.	REVISION	DATE	B	

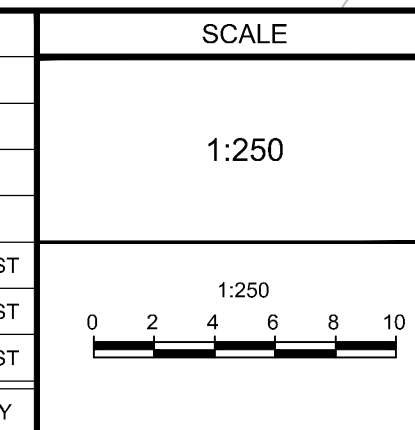

DESIGN	SM / FS
CHECKED	FS
DRAWN	SM
CHECKED	SM / FS
APPROVED	FS

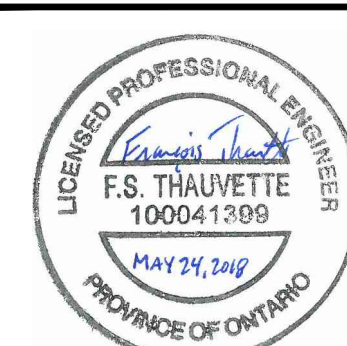


NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

GENERAL PLAN OF SERVICES

PROJECT No.	117193
REV	REV # 3
DRAWING No.	117193-GP3

D07-12-18-0017

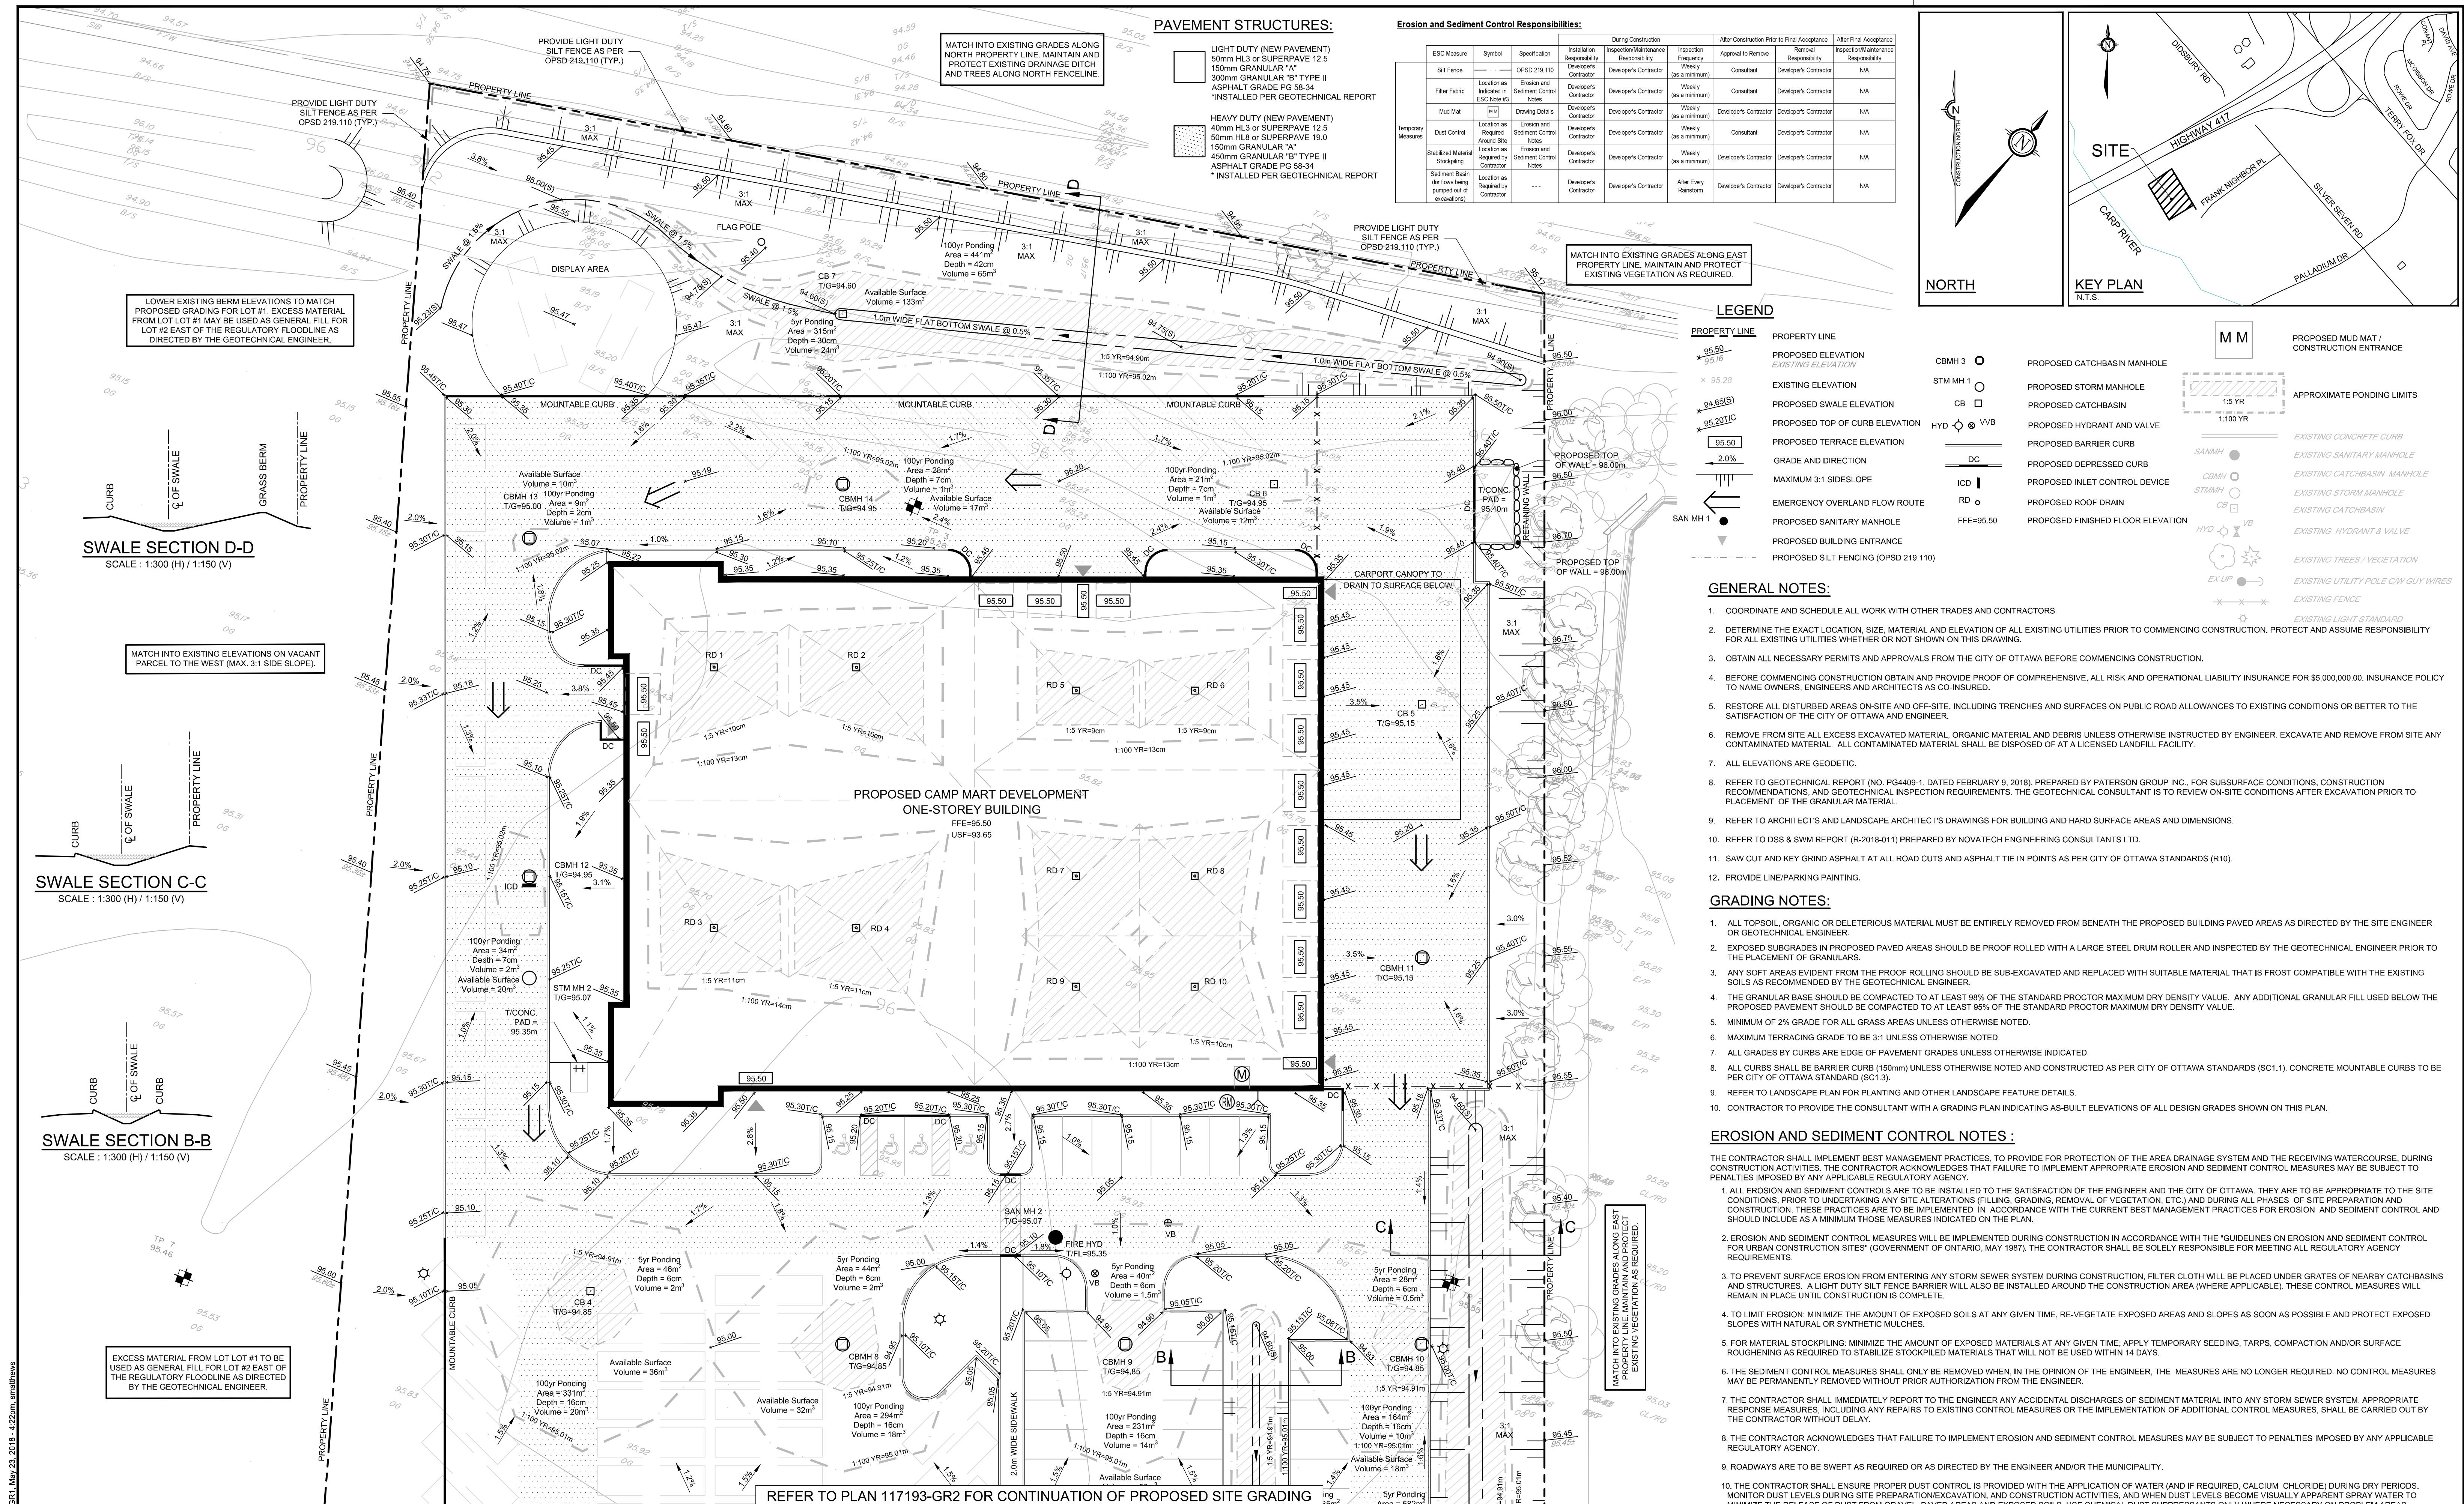

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

APPROVED ☐ REFUSED ☐
THIS ____ DAY OF _____, 20____

DERRICK MOODIE
MANAGER, DEVELOPMENT REVIEW - WEST
PLANNING, INFRASTRUCTURE & ECONOMIC
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

OWNER INFORMATION
20 FRANK NIGHBOR INC.
11266 FIFTH LINE
HALTON HILLS, ON, L7G 4S6
SUNNY BAINS
PHONE: 1-877-401-3423
sbains35@gmail.com

3 REVISED PER CITY COMMENTS MAY 24/18 FST
2 REVISED PER CITY COMMENTS APR 23/18 FST
1 ISSUED FOR SITE PLAN APPROVAL FEB 9/18 FST

No. REVISION DATE BY

SCALE
1:250
0 2 4 6 8 10

DESIGN
SM / FST
CHECKED
DRAWN
CHECKED
APPROVED
FST

FOR REVIEW ONLY
LICENSED PROFESSIONAL ENGINEER
F.S. THAUVEIT
1000413/09
MAY 24, 2018
PROVINCE OF ONTARIO

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
(613) 254-9643
(613) 254-5867
www.novatech-eng.com

LOCATION
CITY OF OTTAWA
20 FRANK NIGHBOR PLACE - CAMP MART SITE

DRAWING NAME
GRADING AND EROSION & SEDIMENT CONTROL PLAN

PROJECT No.
117193

REV
REV #3

DRAWING No.
117193-GR1

M:\2017\117193-GR1\Drawings\117193-GR1.dwg, GR1: May 23, 2018, 4:22pm, smathews

D07-12-18-0016

M:\2017\117193\117193-GR1-GR2.dwg, Q33, May 28, 2018, 3:25pm, smathews

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS,
WATERMAINS, SEWERS AND OTHER
UNDERGROUND AND OVERGROUND UTILITIES AND
STRUCTURES IS NOT NECESSARILY SHOWN ON
THE CONTRACT DRAWINGS, AND WHERE SHOWN,
THE ACCURACY OF THE POSITION OF SUCH
UTILITIES AND STRUCTURES IS NOT GUARANTEED.
BEFORE STARTING WORK, DETERMINE THE EXACT
LOCATION OF ALL SUCH UTILITIES AND
STRUCTURES AND ASSUME ALL LIABILITY FOR
DAMAGE TO THEM.

Erosion and Sediment Control Responsibilities:

ESC Measure	Symbol	Specification	Installation Responsibility	Inspection/Maintenance Responsibility	Inspection Frequency	Approval to Remove	Removal Responsibility	Inspection/Maintenance Responsibility
Silt Fence	---	OPSD 219.110	Developer's Contractor	Developer's Contractor	Weekly (as a minimum)	Consultant	Developer's Contractor	N/A
Filter Fabric	---	Location as Indicated in ESC Note #3	Developer's Contractor	Developer's Contractor	Weekly (as a minimum)	Consultant	Developer's Contractor	N/A
Mud Mat	---	Drawing Details	Developer's Contractor	Developer's Contractor	Weekly (as a minimum)	Developer's Contractor	Developer's Contractor	N/A
Dust Control	---	Location as Required Around Site	Developer's Contractor	Developer's Contractor	Weekly (as a minimum)	Consultant	Developer's Contractor	N/A
Stabilized Material Stockpiling	---	Location as Required by Contractor	Developer's Contractor	Developer's Contractor	Weekly (as a minimum)	Developer's Contractor	Developer's Contractor	N/A
Sediment Basin (for flows being pumped out of excavation)	---	Location as Required by Contractor	Developer's Contractor	Developer's Contractor	After Every Rainfall	Developer's Contractor	Developer's Contractor	N/A

APPROVED ☐ REFUSED ☐
THIS ____ DAY OF ____, 20__


DERRICK MOODIE
MANAGER, DEVELOPMENT REVIEW - WEST
PLANNING, INFRASTRUCTURE & ECONOMIC
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

OWNER INFORMATION
764703 ONTARIO INC.
16 CONCORSE GATE, SUITE 200
OTTAWA, ON K2E 7S8
CAL KIRKPATRICK
PHONE: 1-613-225-8118
ckirkpatrick@colonnade.ca

No.	REVISION	DATE	BY
3	REVISED PER CITY COMMENTS	MAY 24/18	FST
2	REVISED PER CITY COMMENTS	APR 23/18	FST
1	ISSUED FOR SITE PLAN APPROVAL	FEB 9/18	FST

SCALE	DESIGN
1:250	SM / FST
1:250	FST
1:250	SM
1:250	SM / FST
1:250	FST

DESIGN	CHECKED	DRAWN	CHECKED	APPROVED
SM / FST	FST	SM	SM / FST	FST

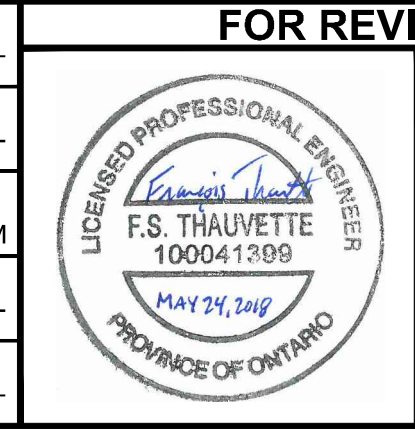

FOR REVIEW ONLY
CITY OF OTTAWA
30 FRANK NIGHBOR PLACE - PRIVATE ACCESS ROAD
DRAWING NAME
GRADING AND EROSION & SEDIMENT CONTROL PLAN
PROJECT No. 117193
REV #3
DRAWING No. 117193-GR3

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowland Drive
Ottawa, Ontario, Canada K2M 1P6
(613) 254-9643
(613) 254-5867
www.novatech-eng.com

LOCATION
CITY OF OTTAWA
30 FRANK NIGHBOR PLACE - PRIVATE ACCESS ROAD
DRAWING NAME
GRADING AND EROSION & SEDIMENT CONTROL PLAN
PROJECT No. 117193
REV #3
DRAWING No. 117193-GR3

MATCH INTO EXISTING ELEVATIONS ON VACANT PARCEL TO THE WEST (MAX. 3:1 SIDE SLOPE).

EXCESS MATERIAL FROM LOT #1 MAY BE USED AS GENERAL FILL FOR LOT #2 EAST OF THE REGULATORY FLOODLINE AS DIRECTED BY THE GEOTECHNICAL ENGINEER.

PROVIDE LIGHT DUTY SILT FENCE AS PER OPSD 219.110 (TYP.).

PROVIDE LIGHT DUTY SILT FENCE AS PER OPSD 219.110 (TYP.).

EXTEND VALVES AS REQUIRED AND PROVIDE THE NECESSARY IRON WORK ADJUSTMENTS ON THE EXISTING MANHOLES TO MATCH INTO THE PROPOSED ROADWAY AND LANDSCAPED AREA ELEVATIONS. PROTECT AND MAINTAIN ALL EXISTING INFRASTRUCTURE (TYPICAL).

MATCH INTO EXISTING ELEVATIONS ON VACANT PARCEL TO THE SOUTH (MAX. 3:1 SIDE SLOPE).

EXTEND VALVES AS REQUIRED AND PROVIDE THE NECESSARY IRON WORK ADJUSTMENTS ON THE EXISTING MANHOLES TO MATCH INTO THE PROPOSED ROADWAY AND LANDSCAPED AREA ELEVATIONS. PROTECT AND MAINTAIN ALL EXISTING INFRASTRUCTURE (TYPICAL).

PROVIDE NEW PRIVATE ACCESS ROAD AND SIDEWALK. MATCH INTO EXISTING PAVEMENT AND SIDEWALK ELEVATIONS. REFER TO 117193-PM SKETCH FOR ROADWAY PAVEMENT MARKINGS AND SIGNAGE DETAILS.

MATCH INTO EXISTING ROADWAY AND CURB ELEVATIONS ALONG FRANK NIGHBOR PLACE. MAINTAIN AND PROTECT EXISTING INFRASTRUCTURE AS REQUIRED.

REFER TO PLANS 117193-GR1 AND 117193-GR2 FOR PROPOSED GRADING ON LOT #1

PAVEMENT STRUCTURES:

- LIGHT DUTY (NEW PAVEMENT)
50mm HLB or SUPERPAVE 12.5
150mm GRANULAR "A"
300mm GRANULAR "B" TYPE II
ASPHALT GRADE PG 58-34
* INSTALLED PER GEOTECHNICAL REPORT
- HEAVY DUTY (NEW PAVEMENT)
40mm HLB or SUPERPAVE 12.5
50mm HLB or SUPERPAVE 19.0
150mm GRANULAR "A"
450mm GRANULAR "B" TYPE II
ASPHALT GRADE PG 58-34
* INSTALLED PER GEOTECHNICAL REPORT

LEGEND

- PROPERTY LINE
EXISTING ELEVATION
EXISTING SWALE ELEVATION
PROPOSED SWALE ELEVATION
PROPOSED TOP OF CURB ELEVATION
PROPOSED TERRACE ELEVATION
GRADE AND DIRECTION
MAXIMUM 3:1 SIDESLOPE
EMERGENCY OVERLAND FLOW ROUTE
PROPOSED SANITARY MANHOLE
PROPOSED BUILDING ENTRANCE
PROPOSED SILT FENCING (OPSD 219.110)

- PROPOSED ELEVATION
EXISTING ELEVATION
PROPOSED SWALE ELEVATION
PROPOSED TOP OF CURB ELEVATION
PROPOSED TERRACE ELEVATION
GRADE AND DIRECTION
MAXIMUM 3:1 SIDESLOPE
EMERGENCY OVERLAND FLOW ROUTE
PROPOSED SANITARY MANHOLE
PROPOSED BUILDING ENTRANCE
PROPOSED SILT FENCING (OPSD 219.110)

- PROPOSED CATCHBASIN MANHOLE
PROPOSED STORM MANHOLE
PROPOSED CATCHBASIN
PROPOSED HYDRANT AND VALVE
PROPOSED BARRIER CURB
PROPOSED DEPRESSED CURB
PROPOSED INLET CONTROL DEVICE
PROPOSED ROOF DRAIN
PROPOSED FINISHED FLOOR ELEVATION
AREA UNDER SITE PLAN DEVELOPMENT APPLICATION FOR THE CAMP MART SITE

- PROPOSED MUD MAT / CONSTRUCTION ENTRANCE
APPROXIMATE PONDING LIMITS
EXISTING CONCRETE CURB
EXISTING SANITARY MANHOLE
EXISTING CATCHBASIN MANHOLE
EXISTING STORM MANHOLE
EXISTING CATCHBASIN
EXISTING HYDRANT & VALVE
EXISTING TREES / VEGETATION
EXISTING UTILITY POLE C/W GUY WIRES
EXISTING FENCE
EXISTING LIGHT STANDARD

GENERAL NOTES:

- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION, PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
- OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
- BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$5,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
- RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE CITY OF OTTAWA AND ENGINEER.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
- ALL ELEVATIONS ARE GEODETIC.
- REFER TO GEOTECHNICAL REPORT (NO. PG4409-1, DATED FEBRUARY 9, 2018), PREPARED BY PATERSON GROUP INC., FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS, AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
- REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARD SURFACE AREAS AND DIMENSIONS.
- REFER TO DSS & SWM REPORT (R-2018-011) PREPARED BY NOVATECH ENGINEERING CONSULTANTS LTD.
- SAW CUT AND KEY GRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).
- PROVIDE LINE/PARKING PAINTING.

GRADING NOTES:

- ALL TOPSOIL, ORGANIC OR DELETERIOUS MATERIAL MUST BE ENTIRELY REMOVED FROM BENEATH THE PROPOSED BUILDING AND PAVED AREAS AS DIRECTED BY THE SITE ENGINEER OR GEOTECHNICAL ENGINEER.
- EXPOSED SUBGRADES IN PROPOSED PAVED AREAS SHOULD BE PROOF ROLLED WITH A LARGE STEEL DRUM ROLLER AND INSPECTED BY THE GEOTECHNICAL ENGINEER PRIOR TO THE PLACEMENT OF GRANULARS.
- ANY SOFT AREAS EVIDENT FROM THE PROOF ROLLING SHOULD BE SUB-EXCAVATED AND REPLACED WITH SUITABLE MATERIAL THAT IS FROST COMPATIBLE WITH THE EXISTING SOILS AS RECOMMENDED BY THE GEOTECHNICAL ENGINEER.
- THE GRANULAR BASE SHOULD BE COMPACTED TO AT LEAST 98% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY VALUE. ANY ADDITIONAL GRANULAR FILL USED BELOW THE PROPOSED PAVEMENT SHOULD BE COMPACTED TO AT LEAST 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY VALUE.
- MINIMUM OF 2% GRADE FOR ALL GRASS AREAS UNLESS OTHERWISE NOTED.
- MAXIMUM TERRACING GRADE TO BE 3:1 UNLESS OTHERWISE NOTED.
- ALL GRADES BY CURBS ARE EDGE OF PAVEMENT GRADES UNLESS OTHERWISE INDICATED.
- ALL CURBS SHALL BE BARRIER CURB (150mm) UNLESS OTHERWISE NOTED AND CONSTRUCTED AS PER CITY OF OTTAWA STANDARDS (SC1.1). CONCRETE MOUNTABLE CURBS TO BE PER CITY OF OTTAWA STANDARD (SC1.3).
- REFER TO LANDSCAPE PLAN FOR PLANTING AND OTHER LANDSCAPE FEATURE DETAILS.
- CONTRACTOR TO PROVIDE THE CONSULTANT WITH A GRADING PLAN INDICATING AS-BUILT ELEVATIONS OF ALL DESIGN GRADES SHOWN ON THIS PLAN.

EROSION AND SEDIMENT CONTROL NOTES:

- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- ALL EROSION AND SEDIMENT CONTROLS ARE TO BE INSTALLED TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF OTTAWA. THEY ARE TO BE APPROPRIATE TO THE SITE CONDITIONS. PRIOR TO UNDERTAKING ANY SITE ALTERATIONS (FILLING, GRADING, REMOVAL OF VEGETATION, ETC.) AND DURING ALL PHASES OF SITE PREPARATION AND CONSTRUCTION, THESE PRACTICES ARE TO BE IMPLEMENTED IN ACCORDANCE WITH THE CURRENT BEST MANAGEMENT PRACTICES FOR EROSION AND SEDIMENT CONTROL AND SHOULD INCLUDE AS A MINIMUM THOSE MEASURES INDICATED ON THE PLAN.
 - EROSION AND SEDIMENT CONTROL MEASURES WILL BE IMPLEMENTED DURING CONSTRUCTION IN ACCORDANCE WITH THE "GUIDELINES ON EROSION AND SEDIMENT CONTROL FOR URBAN CONSTRUCTION SITES" (GOVERNMENT OF ONTARIO, MAY 1987). THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR MEETING ALL REGULATORY AGENCY REQUIREMENTS.
 - TO PREVENT SURFACE EROSION FROM ENTERING ANY STORM SEWER SYSTEM DURING CONSTRUCTION, FILTER CLOTH WILL BE PLACED UNDER GRATES OF NEARBY CATCHBASINS AND STRUCTURES. A LIGHT DUTY SILT FENCE BARRIER WILL ALSO BE INSTALLED AROUND THE CONSTRUCTION AREA (WHERE APPLICABLE). THE CONTROL MEASURES WILL REMAIN IN PLACE UNTIL CONSTRUCTION IS COMPLETE.
 - TO LIMIT EROSION: MINIMIZE THE AMOUNT OF EXPOSED SOILS AT ANY GIVEN TIME, RE-VEGETATE EXPOSED AREAS AND SLOPES AS SOON AS POSSIBLE AND PROTECT EXPOSED SLOPES WITH NATURAL OR SYNTHETIC MULCHES.
 - FOR MATERIAL STOCKPILING: MINIMIZE THE AMOUNT OF EXPOSED MATERIALS AT ANY GIVEN TIME; APPLY TEMPORARY SEEDING, TARPS, COMPACTION AND/OR SURFACE ROUGHENING AS REQUIRED TO STABILIZE STOCKPILED MATERIALS THAT WILL NOT BE USED WITHIN 14 DAYS.
 - THE SEDIMENT CONTROL MEASURES SHALL ONLY BE REMOVED WHEN, IN THE OPINION OF THE ENGINEER, THE MEASURES ARE NO LONGER REQUIRED. NO CONTROL MEASURES MAY BE PERMANENTLY REMOVED WITHOUT PRIOR AUTHORIZATION FROM THE ENGINEER.
 - THE CONTRACTOR SHALL IMMEDIATELY REPORT TO THE ENGINEER ANY ACCIDENTAL DISCHARGES OF SEDIMENT MATERIAL INTO ANY STORM SEWER SYSTEM. APPROPRIATE RESPONSE MEASURES, INCLUDING ANY REPAIRS TO EXISTING CONTROL MEASURES OR THE IMPLEMENTATION OF ADDITIONAL CONTROL MEASURES, SHALL BE CARRIED OUT BY THE CONTRACTOR WITHOUT DELAY.
 - THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
 - ROADWAYS ARE TO BE SWEEP AS REQUIRED OR AS DIRECTED BY THE ENGINEER AND/OR THE MUNICIPALITY.
 - THE CONTRACTOR SHALL ENSURE PROPER DUST CONTROL IS PROVIDED WITH THE APPLICATION OF WATER (AND IF REQUIRED, CALCIUM CHLORIDE) DURING DRY PERIODS. MONITOR DUST LEVELS DURING SITE PREPARATION/EXCAVATION, AND CONSTRUCTION ACTIVITIES, AND WHEN DUST LEVELS BECOME VISUALLY APPARENT SPRAY WATER TO MINIMIZE THE RELEASE OF DUST FROM GRAVEL, PAVED AREAS AND EXPOSED SOILS. USE CHEMICAL DUST SUPPRESSANTS ONLY WHERE NECESSARY ON PROBLEM AREAS.


D07-12-18-0017

AREA A-1: INLET CONTROL DEVICE DATA - CBMH 1						
DESIGN EVENT	ICD TYPE (CIRCULAR PLUG)	DIAMETER OF OUTLET PIPE (mm)	DESIGN FLOW (L/s)	DESIGN HEAD (m)	WATER ELEVATION (m)	VOLUME (m³)
1:5 YR	88mmØ ORIFCE	375	23.5	1.98	94.91	191.4
1:100 YR	88mmØ ORIFCE	375	24.1	2.08	95.01	448.4

AREA A-3: INLET CONTROL DEVICE DATA - CBMH 12						
DESIGN EVENT	ICD TYPE (CIRCULAR PLUG)	DIAMETER OF OUTLET PIPE (mm)	DESIGN FLOW (L/s)	DESIGN HEAD (m)	WATER DEPTH (m)	VOLUME (m³)
1:5 YR	100mmØ ORIFCE	375	28.1	1.70	94.90	22.9
1:100 YR	100mmØ ORIFCE	375	29.1	1.82	95.02	69.1

CAMP MART SITE FLOWS & STORMWATER MANAGEMENT TABLE							
DESIGN EVENT	PRE-DEVELOPMENT CONDITIONS		POST-DEVELOPMENT CONDITIONS				
	UNCONTROLLED FLOW (L/s)	ALLOWABLE RELEASE RATE (L/s)	A-0 FLOW (L/s)	A-1 FLOW (L/s)	A-2 FLOW (L/s)	A-3 FLOW (L/s)	TOTAL FLOW (L/s)
1:5 YR	115.3	99.5	6.1	23.5	24.7	28.1	82.4
1:100 YR	247.0	99.5	12.4	24.1	33.5	29.1	99.1

* REDUCED FLOW COMPARED TO PRE-DEVELOPMENT UNCONTROLLED CONDITIONS

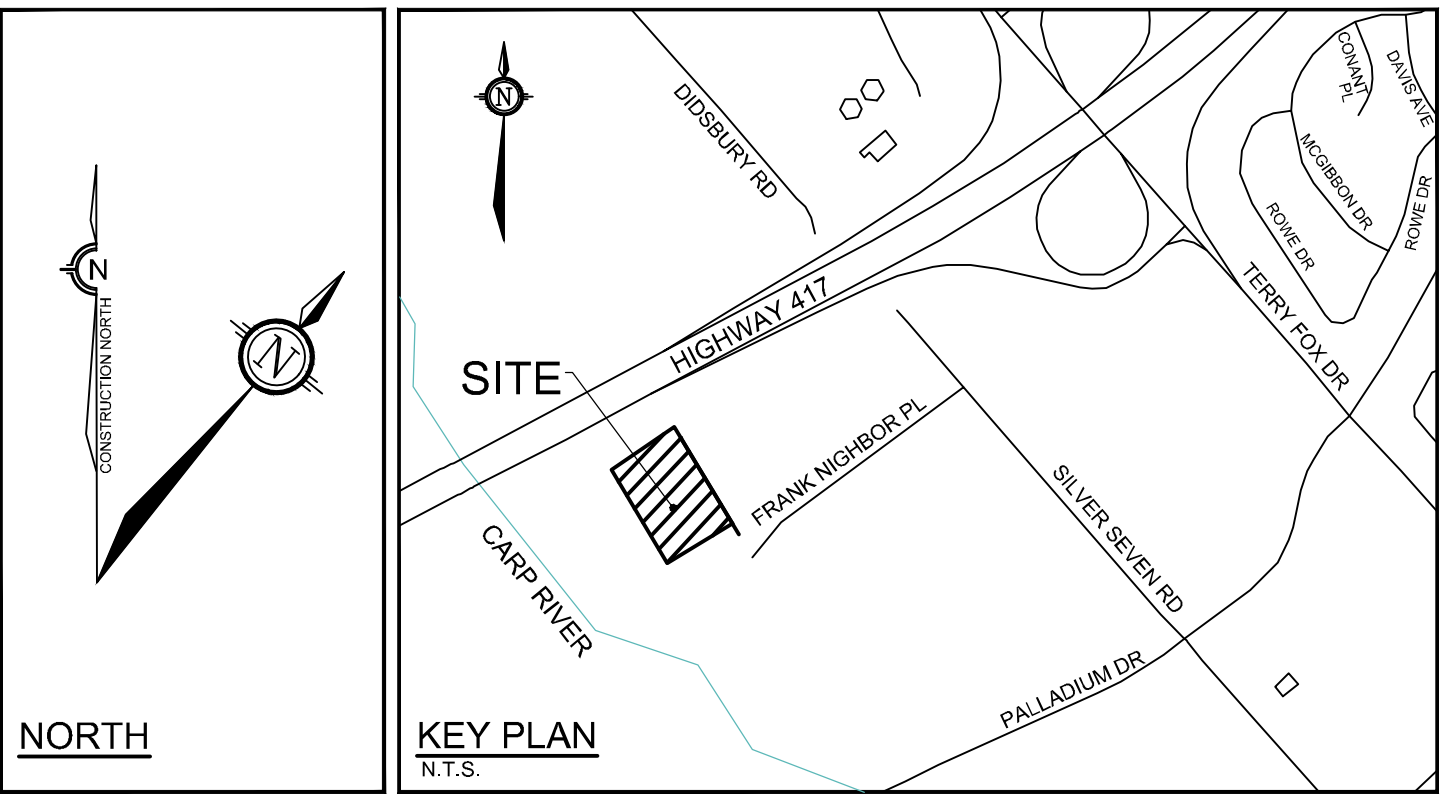

LEGEND

	PROPERTY LINE		PROPOSED CATCHBASIN MANHOLE c/w 3.0m RADIAL SUBDRAINS PER GETOTECH & SEWER
	POST-DEVELOPMENT AREA ID		PROPOSED STORM MANHOLE & SEWER
	POST-DEVELOPMENT DRAINAGE AREA (ha)		PROPOSED CATCHBASIN c/w 3.0m RADIAL SUBDRAINS PER GETOTECH AND LEAD
	1:5 YEAR WEIGHTED RUNOFF COEFFICIENT		PROPOSED HYDRANT AND VALVE
	DRAINAGE AREA LIMITS		PROPOSED BARRIER CURB
	MAXIMUM 3:1 SIDESLOPE		PROPOSED DEPRESSED CURB
	EMERGENCY OVERLAND FLOW ROUTE		PROPOSED INLET CONTROL DEVICE
	PROPOSED SANITARY MANHOLE		PROPOSED ROOF DRAIN
	PROPOSED BUILDING ENTRANCE		PROPOSED FINISHED FLOOR ELEVATION

GENERAL NOTES:

- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION, PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
- OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
- BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$5,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
- RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE CITY OF OTTAWA AND ENGINEER.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
- ALL ELEVATIONS ARE GEODETIC.
- REFER TO GEOTECHNICAL REPORT (NO. PG4409-1, DATED FEBRUARY 9, 2018), PREPARED BY PATERSON GROUP INC., FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS, AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
- REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARD SURFACE AREAS AND DIMENSIONS.
- REFER TO DSS & SWM REPORT (R-2018-011) PREPARED BY NOVATECH ENGINEERING CONSULTANTS LTD.
- SAW CUT AND KEY GRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).
- PROVIDE LINE/PARKING PAINTING.

EROSION AND SEDIMENT CONTROL NOTES:

- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- ALL EROSION AND SEDIMENT CONTROLS ARE TO BE INSTALLED TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF OTTAWA. THEY ARE TO BE APPROPRIATE TO THE SITE CONDITIONS, PRIOR TO UNDERTAKING ANY SITE ALTERATIONS (FILLING, GRADING, REMOVAL OF VEGETATION, ETC.) AND DURING ALL PHASES OF SITE PREPARATION AND CONSTRUCTION. THESE PRACTICES ARE TO BE IMPLEMENTED IN ACCORDANCE WITH THE CURRENT BEST MANAGEMENT PRACTICES FOR EROSION AND SEDIMENT CONTROL AND SHOULD INCLUDE AS A MINIMUM THOSE MEASURES INDICATED ON THE PLAN.
 - EROSION AND SEDIMENT CONTROL MEASURES WILL BE IMPLEMENTED DURING CONSTRUCTION IN ACCORDANCE WITH THE "GUIDELINES ON EROSION AND SEDIMENT CONTROL FOR URBAN CONSTRUCTION SITES" (GOVERNMENT OF ONTARIO, MAY 1987). THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR MEETING ALL REGULATORY AGENCY REQUIREMENTS.
 - TO PREVENT SURFACE EROSION FROM ENTERING ANY STORM SEWER SYSTEM DURING CONSTRUCTION, FILTER CLOTH WILL BE PLACED UNDER GRATES OF NEARBY CATCHBASINS AND STRUCTURES. A LIGHT DUTY SILT FENCE BARRIER WILL ALSO BE INSTALLED AROUND THE CONSTRUCTION AREA (WHERE APPLICABLE). THESE CONTROL MEASURES WILL REMAIN IN PLACE UNTIL CONSTRUCTION IS COMPLETE.
 - TO LIMIT EROSION: MINIMIZE THE AMOUNT OF EXPOSED SOILS AT ANY GIVEN TIME, RE-VEGETATE EXPOSED AREAS AND SLOPES AS SOON AS POSSIBLE AND PROTECT EXPOSED SLOPES WITH NATURAL OR SYNTHETIC MULCHES.
 - FOR MATERIAL STOCKPILING: MINIMIZE THE AMOUNT OF EXPOSED MATERIALS AT ANY GIVEN TIME; APPLY TEMPORARY SEEDING, TARPS, COMPACTION AND/OR SURFACE ROUGHENING AS REQUIRED TO STABILIZE STOCKPILED MATERIALS THAT WILL NOT BE USED WITHIN 14 DAYS.
 - THE SEDIMENT CONTROL MEASURES SHALL ONLY BE REMOVED WHEN, IN THE OPINION OF THE ENGINEER, THE MEASURES ARE NO LONGER REQUIRED. NO CONTROL MEASURES MAY BE PERMANENTLY REMOVED WITHOUT PRIOR AUTHORIZATION FROM THE ENGINEER.
 - THE CONTRACTOR SHALL IMMEDIATELY REPORT TO THE ENGINEER ANY ACCIDENTAL DISCHARGES OF SEDIMENT MATERIAL INTO ANY STORM SEWER SYSTEM. APPROPRIATE RESPONSE MEASURES, INCLUDING ANY REPAIRS TO EXISTING CONTROL MEASURES OR THE IMPLEMENTATION OF ADDITIONAL CONTROL MEASURES, SHALL BE CARRIED OUT BY THE CONTRACTOR WITHOUT DELAY.
 - THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
 - ROADWAYS ARE TO BE SWEEP AS REQUIRED OR AS DIRECTED BY THE ENGINEER AND/OR THE MUNICIPALITY.
 - THE CONTRACTOR SHALL ENSURE PROPER DUST CONTROL IS PROVIDED WITH THE APPLICATION OF WATER (AND IF REQUIRED, CALCIUM CHLORIDE) DURING DRY PERIODS. MONITOR DUST LEVELS DURING SITE PREPARATION/EXCAVATION, AND CONSTRUCTION ACTIVITIES, AND WHEN DUST LEVELS BECOME VISUALLY APPARENT SPRAY WATER TO MINIMIZE THE RELEASE OF DUST FROM GRAVEL, PAVED AREAS AND EXPOSED SOILS. USE CHEMICAL DUST SUPPRESSANTS ONLY WHERE NECESSARY ON PROBLEM AREAS.

ROOF DRAIN TABLE: AREA A-2 (ROOF DRAINS 1 to 10)					
AREA ID *	ROOF DRAIN NO. (ZURN MODEL)	NUMBER OF ROOF DRAIN NOTCHES	5-YEAR RELEASE RATE	APPROX. 5-YR PONDING DEPTH	APPROX. 100-YR PONDING DEPTH
A-2	RD 1 (Z-105)	2 NOTCHES**	2.52 L/s	10 cm	3.16 L/s
A-2	RD 2 (Z-105)	2 NOTCHES**	2.52 L/s	10 cm	3.16 L/s
A-2	RD 3 (Z-105)	3 NOTCHES**	4.02 L/s	11 cm	5.67 L/s
A-2	RD 4 (Z-105)	3 NOTCHES**	4.02 L/s	11 cm	5.67 L/s
A-2	RD 5 (Z-105)	3 NOTCHES**	3.30 L/s	09 cm	4.74 L/s
A-2	RD 6 (Z-105)	3 NOTCHES**	3.30 L/s	09 cm	4.74 L/s
A-2	RD 7 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s
A-2	RD 8 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s
A-2	RD 9 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s
A-2	RD 10 (Z-105)	1 NOTCH**	1.26 L/s	10 cm	1.58 L/s

* REFER TO THE 'DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT' (R-2018-011) PREPARED BY NOVATECH FOR DRAINAGE AREA IDENTIFIERS AND STORMWATER MANAGEMENT DETAILS.
 **ALL CONTROLLED FLOW ROOF DRAINS FOR THE PROPOSED BUILDING TO BE ZURN CONTROL-FLO ROOF DRAINS WITH THE SPECIFIED NUMBER OF NOTCHES AS INDICATED ABOVE.


NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

APPROVED <input type="checkbox"/>	REFUSED <input type="checkbox"/>
THIS ____ DAY OF _____, 20__	
DERRICK MOODIE MANAGER, DEVELOPMENT REVIEW – WEST PLANNING, INFRASTRUCTURE & ECONOMIC DEVELOPMENT DEPARTMENT, CITY OF OTTAWA	

OWNER INFORMATION
 20 FRANK NIGHBOR INC.
 11266 FIFTH LINE
 HALTON HILLS, ON, L7G 4S6
 SUNNY BAINS
 PHONE: 1-877-401-3423
 sbains35@gmail.com

No.	REVISION	DATE	BY
3	ISSUED WITH REVISED DSS & SWM REPORT	MAY 24/18	FST
2	ISSUED WITH REVISED DSS & SWM REPORT	APR 23/18	FST
1	ISSUED FOR SITE PLAN APPROVAL	FEB 9/18	FST

SCALE



DESIGN

SM / FST

CHECKED

FST

DRAWN


CHECKED

SM / FST

APPROVED

FST

FOR REVIEW ONLY

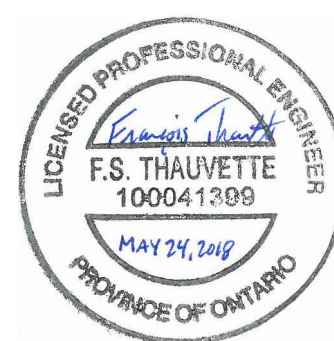

NOVATECH
 Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada K2M 1P6
 Telephone (613) 254-9643
 Facsimile (613) 254-5867
 Website www.novatech-eng.com

LOCATION
 CITY OF OTTAWA
 20 FRANK NIGHBOR PLACE - CAMP MART SITE

DRAWING NAME

STORMWATER
 MANAGEMENT PLAN

PROJECT No.

117193

REV


REV # 3

DRAWING No.

117193-SWM1




#17578

D07-12-18-0016

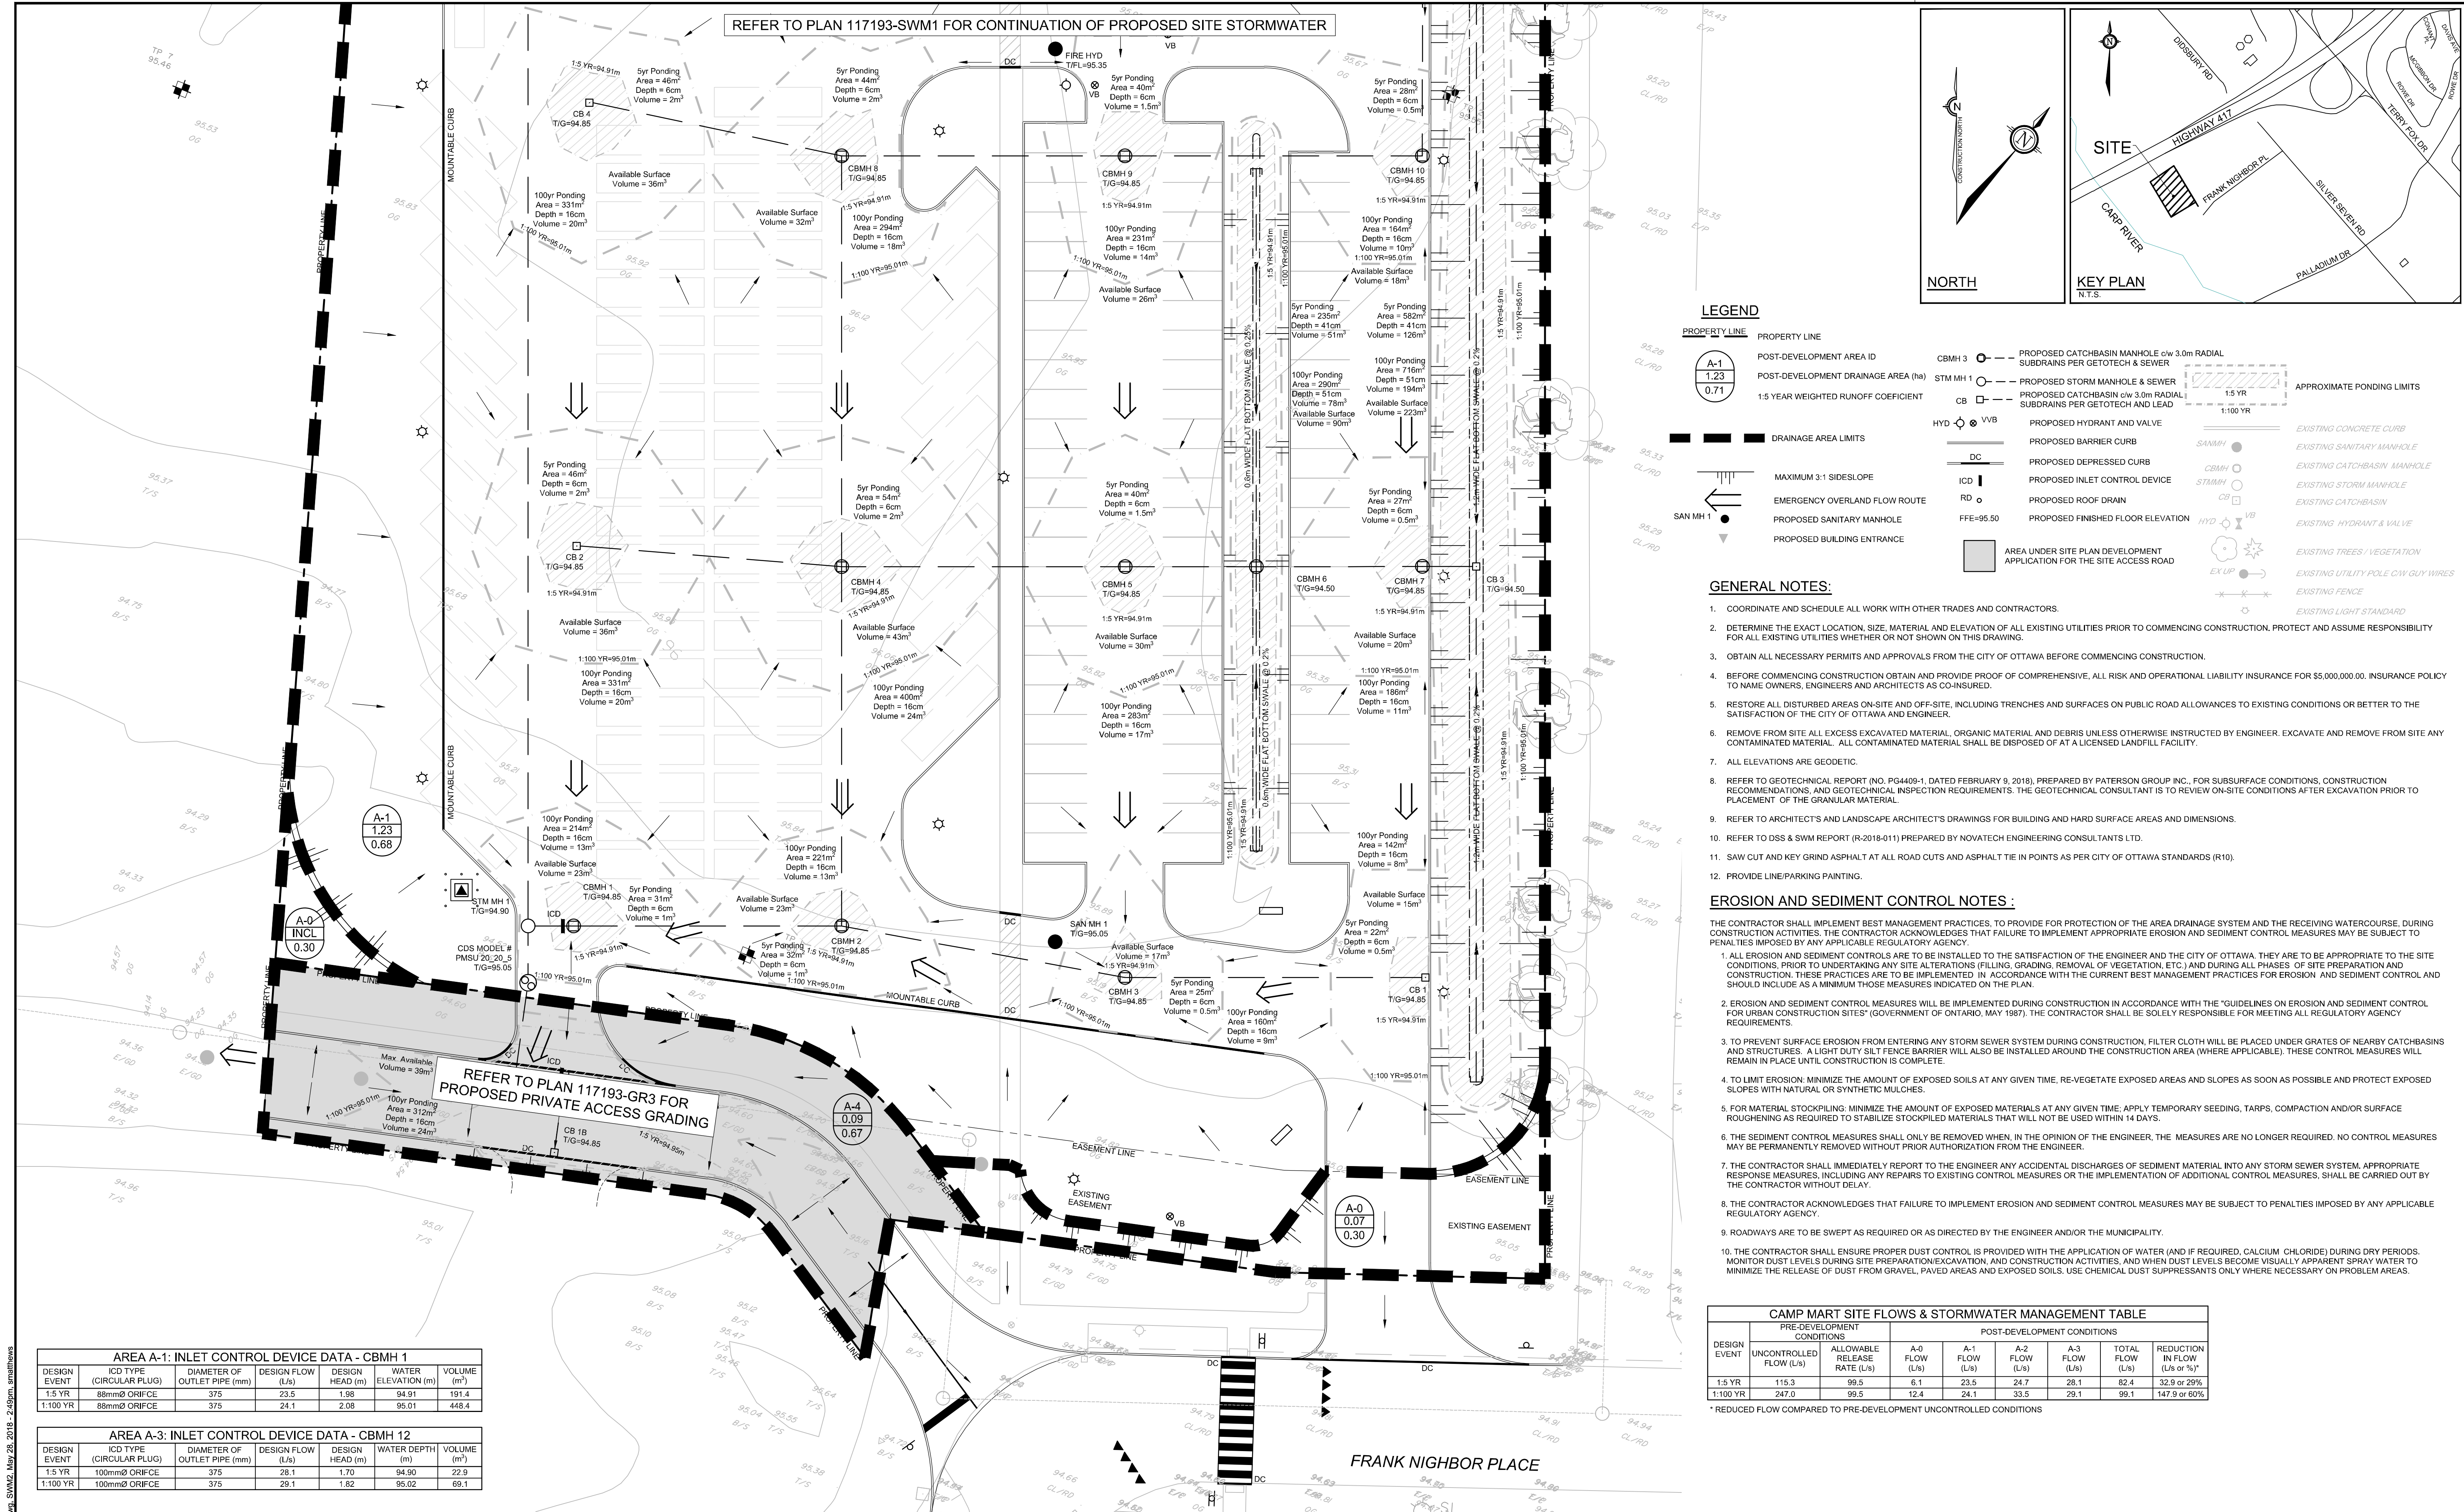

M:\2017\117193\CD\Design\117193-SWM.dwg, SWM2, May 28, 2018 - 2:45pm, smallhous

D07-12-18-0016

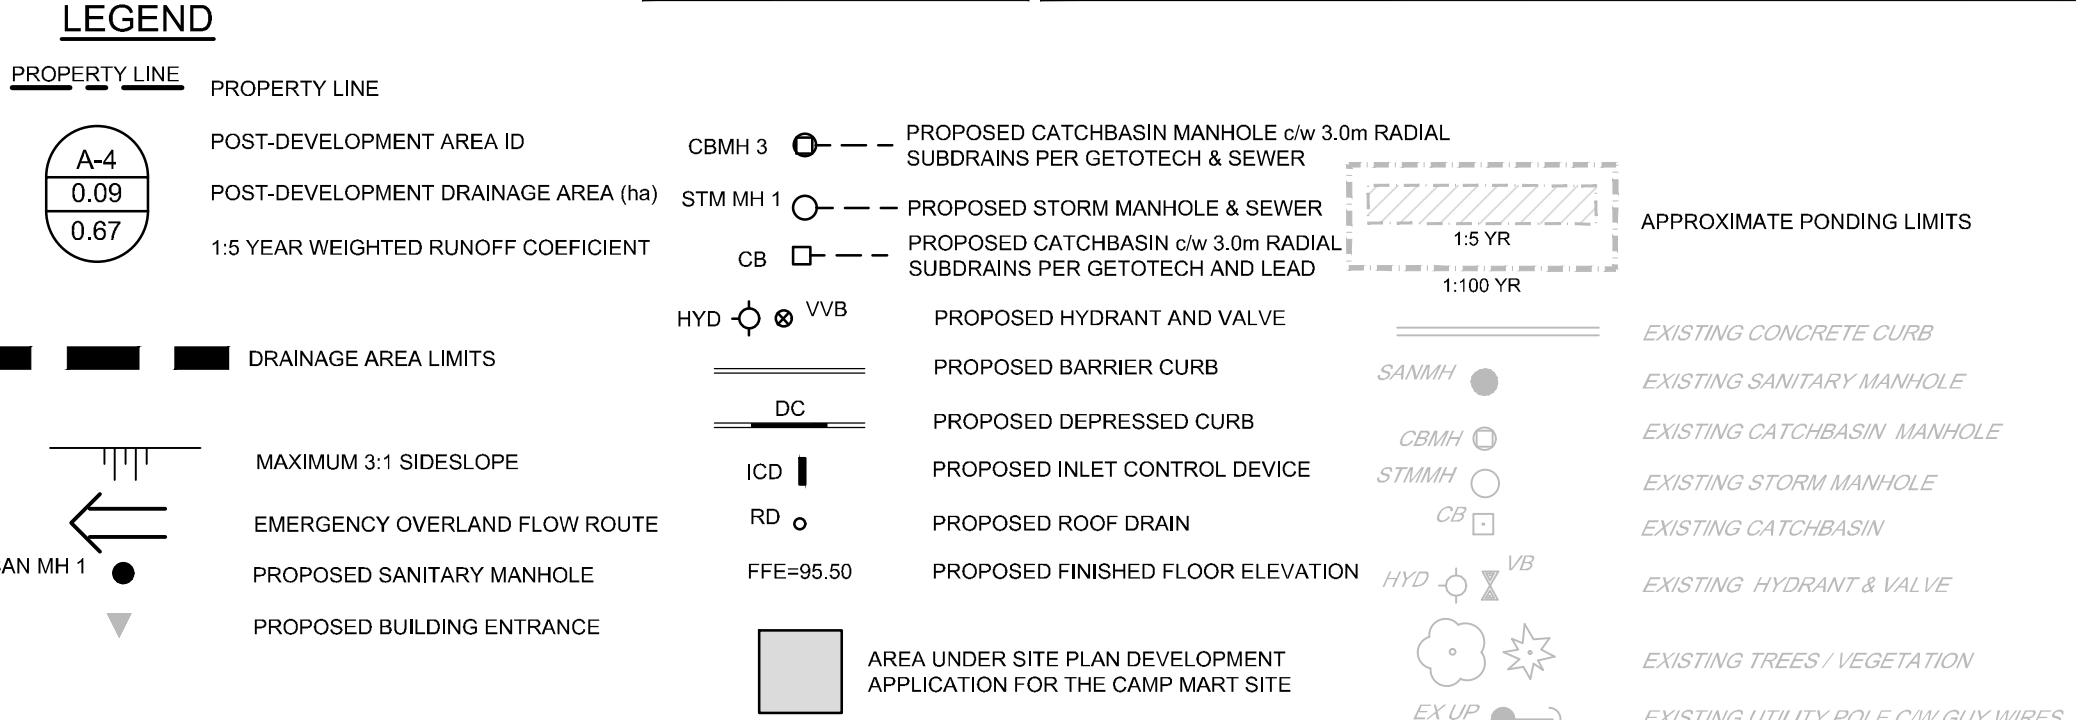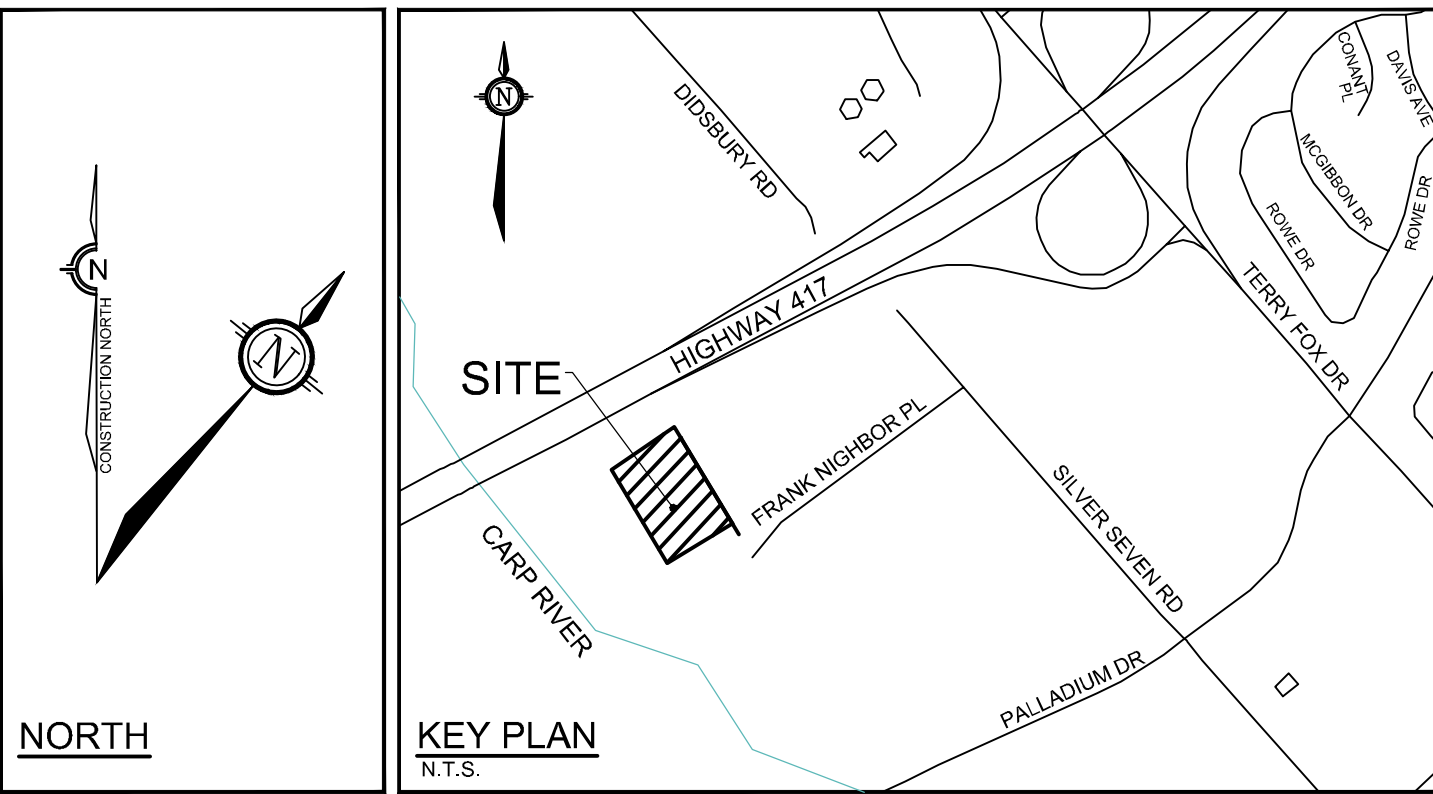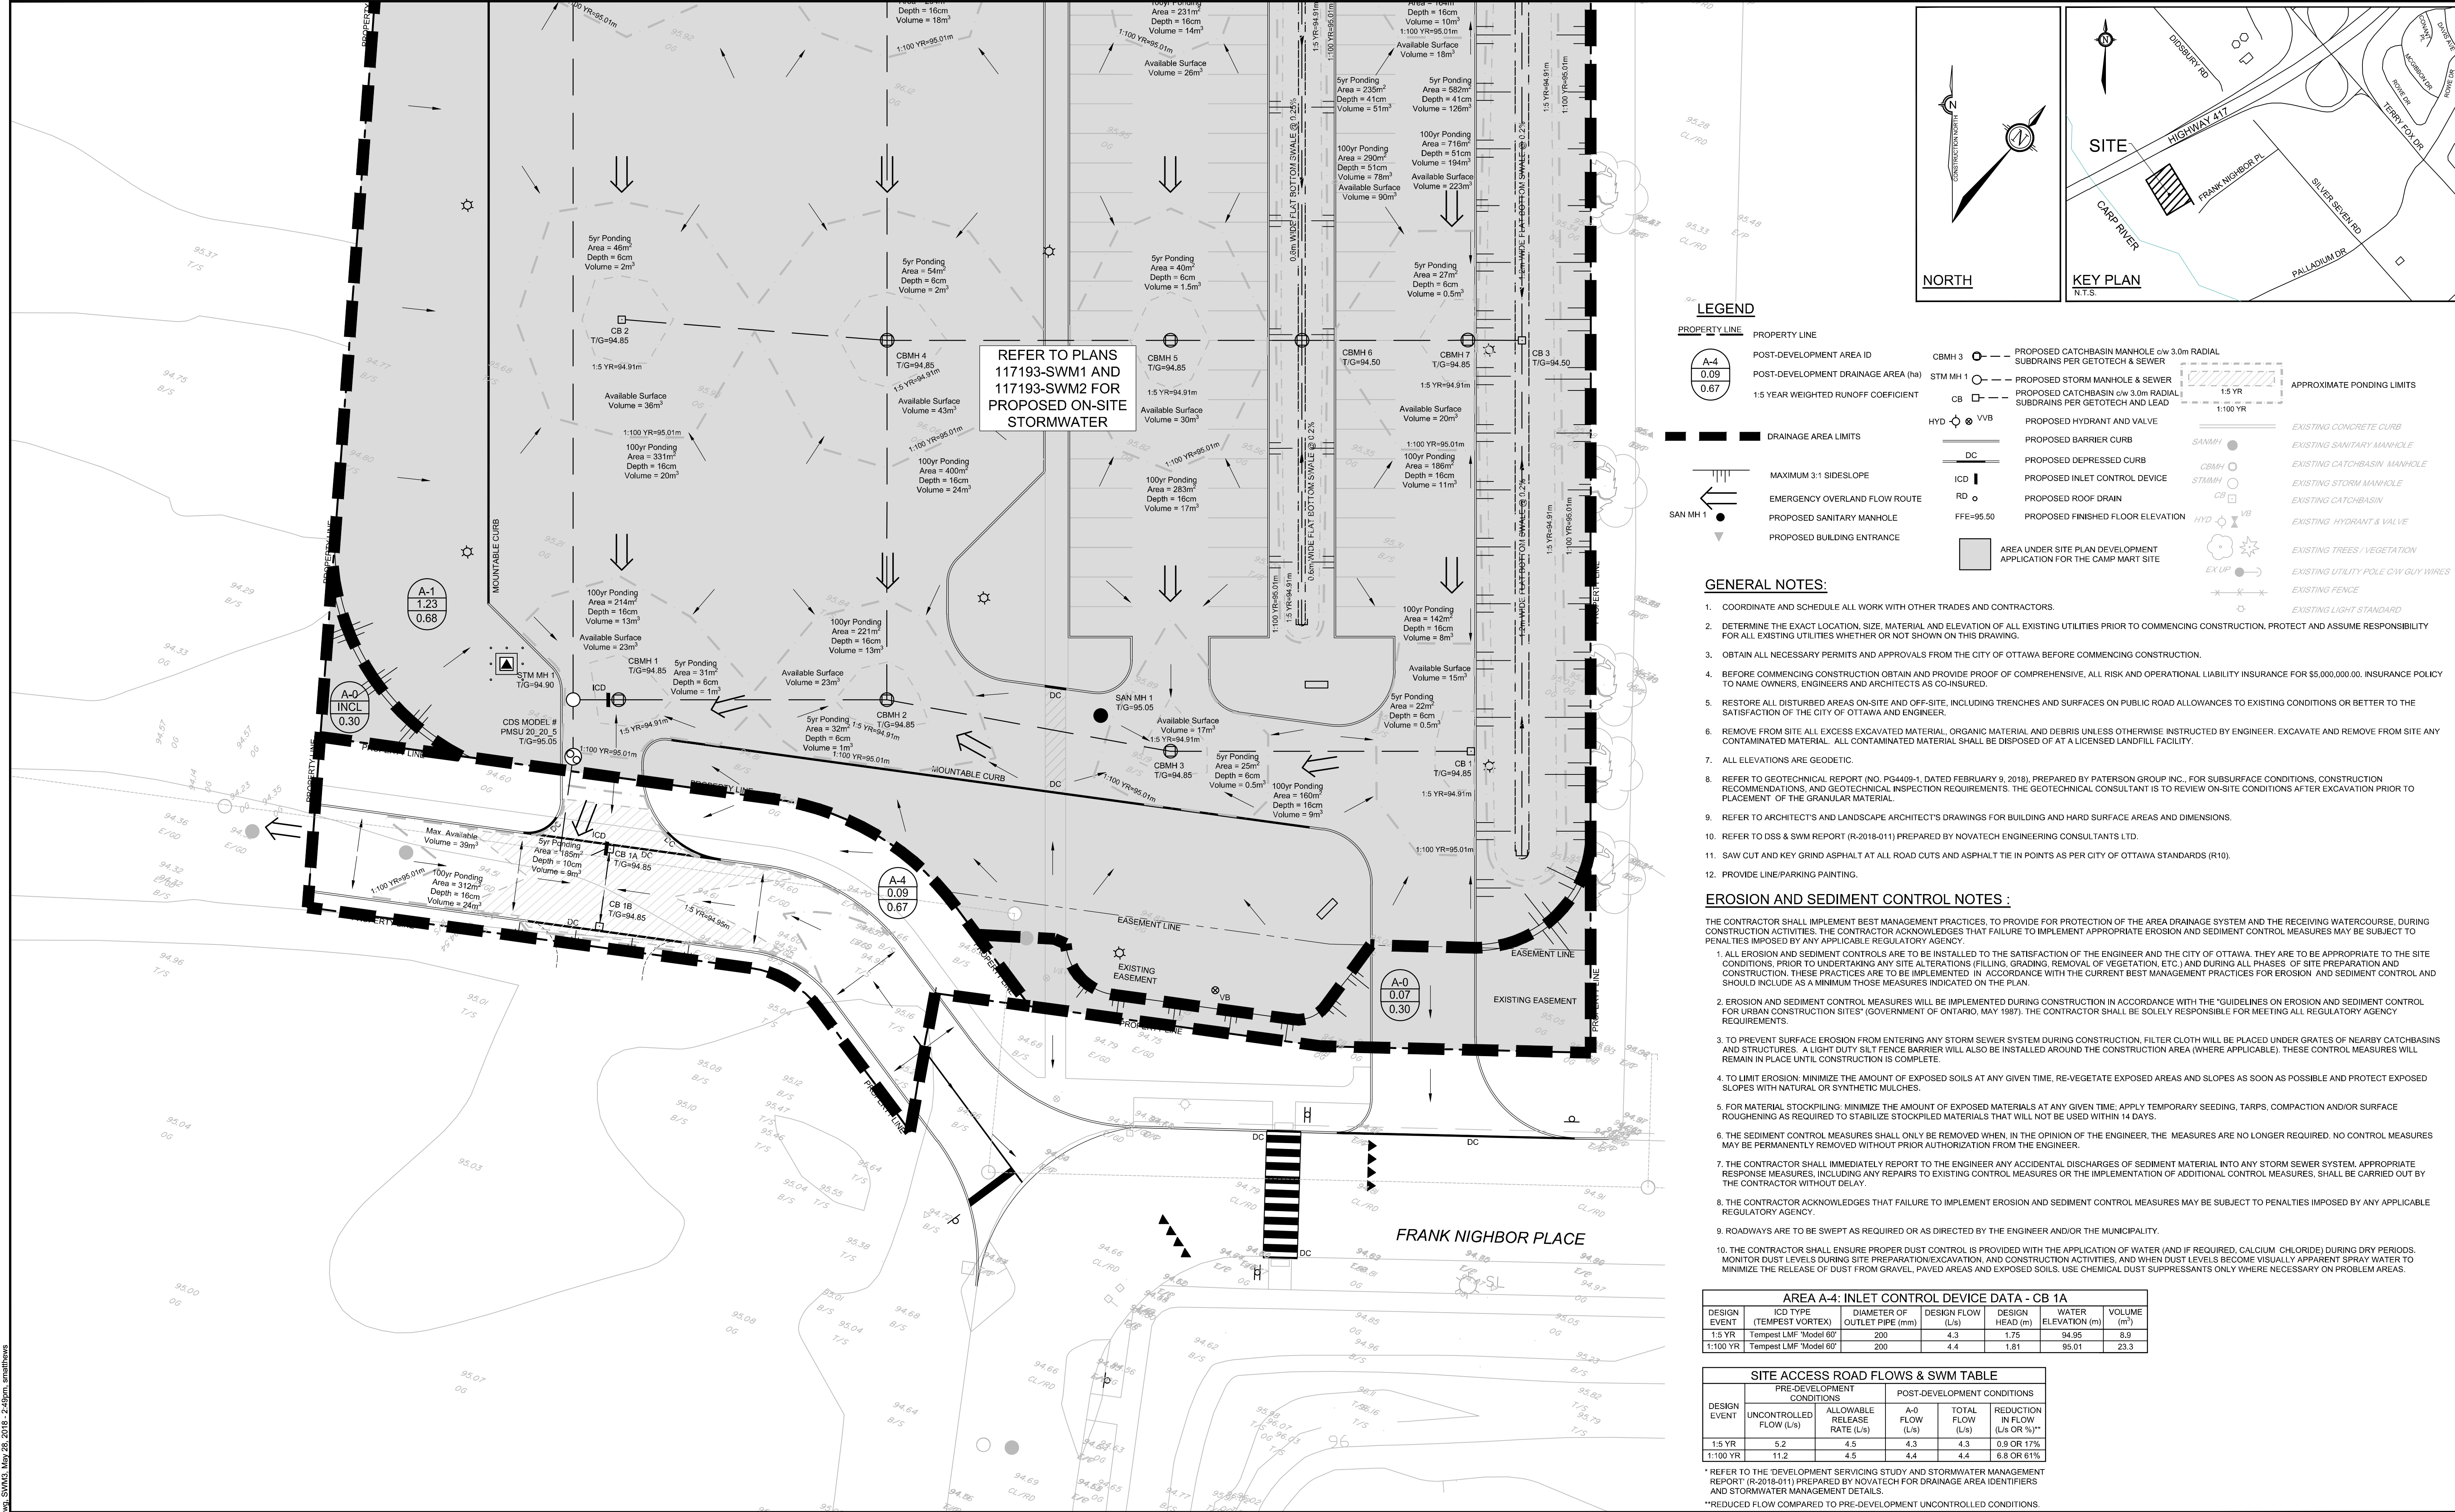

- GENERAL NOTES:**
- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
 - DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION, PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
 - OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
 - BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE, ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$5,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS CO-INSURED.
 - RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE CITY OF OTTAWA AND ENGINEER.
 - REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
 - ALL ELEVATIONS ARE GEODETIC.
 - REFER TO GEOTECHNICAL REPORT (NO. PG4409-1, DATED FEBRUARY 9, 2018), PREPARED BY PATERSON GROUP INC., FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS, AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRANULAR MATERIAL.
 - REFER TO ARCHITECT'S AND LANDSCAPE ARCHITECT'S DRAWINGS FOR BUILDING AND HARD SURFACE AREAS AND DIMENSIONS.
 - REFER TO DSS & SWM REPORT (R-2018-011) PREPARED BY NOVATECH ENGINEERING CONSULTANTS LTD.
 - SAW CUT AND KEY GRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT TIE IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).
 - PROVIDE LINE/PARKING PAINTING.

- EROSION AND SEDIMENT CONTROL NOTES:**
- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- ALL EROSION AND SEDIMENT CONTROLS ARE TO BE INSTALLED TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF OTTAWA. THEY ARE TO BE APPROPRIATE TO THE SITE CONDITIONS, PRIOR TO UNDERTAKING ANY SITE ALTERATIONS (FILLING, GRADING, REMOVAL OF VEGETATION, ETC.) AND DURING ALL PHASES OF SITE PREPARATION AND CONSTRUCTION. THESE PRACTICES ARE TO BE IMPLEMENTED IN ACCORDANCE WITH THE CURRENT BEST MANAGEMENT PRACTICES FOR EROSION AND SEDIMENT CONTROL AND SHOULD INCLUDE AS A MINIMUM THOSE MEASURES INDICATED ON THE PLAN.
 - EROSION AND SEDIMENT CONTROL MEASURES WILL BE IMPLEMENTED DURING CONSTRUCTION IN ACCORDANCE WITH THE "GUIDELINES ON EROSION AND SEDIMENT CONTROL FOR URBAN CONSTRUCTION SITES" (GOVERNMENT OF ONTARIO, MAY 1987). THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR MEETING ALL REGULATORY AGENCY REQUIREMENTS.
 - TO PREVENT SURFACE EROSION FROM ENTERING ANY STORM SEWER SYSTEM DURING CONSTRUCTION, FILTER CLOTH WILL BE PLACED UNDER GRATES OF NEARBY CATCHBASINS AND STRUCTURES. A LIGHT DUTY SILT FENCE BARRIER WILL ALSO BE INSTALLED AROUND THE CONSTRUCTION AREA (WHERE APPLICABLE). THESE CONTROL MEASURES WILL REMAIN IN PLACE UNTIL CONSTRUCTION IS COMPLETE.
 - TO LIMIT EROSION: MINIMIZE THE AMOUNT OF EXPOSED SOILS AT ANY GIVEN TIME. RE-VEGETATE EXPOSED AREAS AND SLOPES AS SOON AS POSSIBLE AND PROTECT EXPOSED SLOPES WITH NATURAL OR SYNTHETIC MULCHES.
 - FOR MATERIAL STOCKPILING: MINIMIZE THE AMOUNT OF EXPOSED MATERIALS AT ANY GIVEN TIME; APPLY TEMPORARY SEEDING, TARPS, COMPACTION AND/OR SURFACE ROUGHENING AS REQUIRED TO STABILIZE STOCKPILED MATERIALS THAT WILL NOT BE USED WITHIN 14 DAYS.
 - THE SEDIMENT CONTROL MEASURES SHALL ONLY BE REMOVED WHEN, IN THE OPINION OF THE ENGINEER, THE MEASURES ARE NO LONGER REQUIRED. NO CONTROL MEASURES MAY BE PERMANENTLY REMOVED WITHOUT PRIOR AUTHORIZATION FROM THE ENGINEER.
 - THE CONTRACTOR SHALL IMMEDIATELY REPORT TO THE ENGINEER ANY ACCIDENTAL DISCHARGES OF SEDIMENT MATERIAL INTO ANY STORM SEWER SYSTEM. APPROPRIATE RESPONSE MEASURES, INCLUDING ANY REPAIRS TO EXISTING CONTROL MEASURES OR THE IMPLEMENTATION OF ADDITIONAL CONTROL MEASURES, SHALL BE CARRIED OUT BY THE CONTRACTOR WITHOUT DELAY.
 - THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
 - ROADWAYS ARE TO BE SWEEPED AS REQUIRED OR AS DIRECTED BY THE ENGINEER AND/OR THE MUNICIPALITY.
 - THE CONTRACTOR SHALL ENSURE PROPER DUST CONTROL IS PROVIDED WITH THE APPLICATION OF WATER (AND IF REQUIRED, CALCIUM CHLORIDE) DURING DRY PERIODS. MONITOR DUST LEVELS DURING SITE PREPARATION/EXCAVATION, AND CONSTRUCTION ACTIVITIES, AND WHEN DUST LEVELS BECOME VISUALLY APPARENT SPRAY WATER TO MINIMIZE THE RELEASE OF DUST FROM GRAVEL, PAVED AREAS AND EXPOSED SOILS. USE CHEMICAL DUST SUPPRESSANTS ONLY WHERE NECESSARY ON PROBLEM AREAS.

AREA A-4: INLET CONTROL DEVICE DATA - CB 1A					
DESIGN EVENT	ICO TYPE (TEMPERATURE VORTEX)	DIAMETER OF OUTLET PIPE (mm)	DESIGN FLOW (L/s)	DESIGN HEAD (m)	WATER ELEVATION (m)
1.5 YR	Tempest LMF Model 60'	200	4.3	1.75	94.95
1:100 YR	Tempest LMF Model 60'	200	4.4	1.81	95.01

SITE ACCESS ROAD FLOWS & SWM TABLE					
PRE-DEVELOPMENT CONDITIONS			POST-DEVELOPMENT CONDITIONS		
DESIGN EVENT	UNCONTROLLED FLOW (L/s)	ALLOWABLE RELEASE RATE (L/s)	A-0 FLOW (L/s)	TOTAL FLOW (L/s)	REDUCTION IN FLOW (L/s OR %)
1.5 YR	5.2	4.5	4.3	4.3	0.9 OR 17%
1:100 YR	11.2	4.5	4.4	4.4	6.8 OR 61%

*REFER TO THE 'DEVELOPMENT SERVICING STUDY AND STORMWATER MANAGEMENT REPORT' (R-2018-011) PREPARED BY NOVATECH FOR DRAINAGE AREA IDENTIFIERS AND STORMWATER MANAGEMENT DETAILS.

**REDUCED FLOW COMPARED TO PRE-DEVELOPMENT UNCONTROLLED CONDITIONS

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

APPROVED ☐ REFUSED ☐

THIS ____ DAY OF _____, 20__

DERRICK MOODIE
MANAGER, DEVELOPMENT REVIEW - WEST
PLANNING, INFRASTRUCTURE & ECONOMIC
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

OWNER INFORMATION
764703 ONTARIO INC.
16 CONCOURSE GATE, SUITE 200
OTTAWA, ON, K2E 7S8
CAL KIRKPATRICK
PHONE: 1-613-225-8118
ckirkpatrick@colonnade.ca

3 ISSUED WITH REVISED DSS & SWM REPORT MAY 24/18 FST

2 ISSUED WITH REVISED DSS & SWM REPORT APR 23/18 FST

1 ISSUED FOR SITE PLAN APPROVAL FEB 9/18 FST

No.	REVISION	DATE	BY
-----	----------	------	----

SCALE

1:250

0 2 4 6 8 10

DESIGN

SM / FST

CHECKED

FST

DRAWN

SM

CHECKED

SM / FST

APPROVED

FST

FOR REVIEW ONLY

PROFESSIONAL ENGINEER

F.S. THAUVETTE

1000413/09

MAY 24, 2018

PROVINCE OF ONTARIO

NOVATECH

Engineers, Planners & Landscape Architects

Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

LOCATION
CITY OF OTTAWA
30 FRANK NIGHBOR PLACE - PRIVATE ACCESS ROAD

DRAWING NAME

STORMWATER
MANAGEMENT PLAN

PROJECT No. 117193

REV #3

DRAWING No. 117193-SWM3

M:\2017\117193\CAD\Design\117193-SWM.dwg, SWM3, May 28, 2018 - 2:45pm, smathews

D07-12-18-0017