


\* NOTE: NON-PERFORATED PIPES TO BE USED.



- ## WATERMAIN NOTES
1. CONSTRUCT ALL WATERMAINS AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS AS WELL AS CITY OR TOWNSHIP STANDARDS AS INDICATED.
  2. WATERMAINS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 2.4m. OTHERWISE THERMAL INSULATION IS REQUIRED AS PER CITY OF OTTAWA STANDARD DRAWING 'W22'.
  3. IF THE WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS EQUAL TO OR LESS THAN THAT WHICH IS RECOMMENDED BY THE MANUFACTURER.
  4. USE APPROVED SADDLE CONNECTION WITH MAIN (CORPORATION) STOP AS PER CITY OF OTTAWA STANDARD DRAWING 'W26'.
  5. CONNECTION TO EXISTING BY CITY OR TOWNSHIP FORCES, EXCAVATION, BACKFILLING AND REINSTATEMENT IS TO BE COMPLETED BY THE CONTRACTOR.
  6. THERMAL INSULATION OF WATERMAINS AT OPEN STRUCTURES AS PER CITY OF OTTAWA STANDARD DRAWING 'W22'.

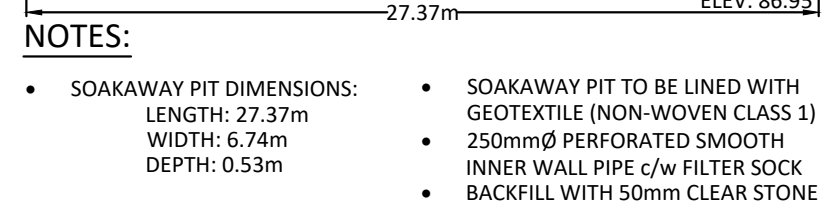

|                                                                 |                       |
|-----------------------------------------------------------------|-----------------------|
| Check and verify all dimensions before proceeding with the work | Do not scale drawings |
|-----------------------------------------------------------------|-----------------------|



www.internationaljournalofpsychiatry.com



Project:

745 MIKINAK ROAD  
MHI VETERAN'S HOUSE

OTTAWA ON

## SITE SERVICING PLAN

C102