



No.	PIPE	INVERT (m)	CLEARANCE (m)	OBVERT (m)	EX. PIPE
1	135mm DIA. SAN	77.80	0.50 OVER	77.30	EX. 203mm DIA. WM
2	135mm DIA. SAN	77.83	3.11 OVER	74.72	EX. 600mm DIA. SAN
3	135mm DIA. SAN	77.86	1.22 OVER	76.64	EX. 450mm DIA. STM
4	150mm DIA. WM	76.91	2.19 OVER	74.72	EX. 600mm DIA. SAN
5	150mm DIA. WM	76.94	0.30 OVER	76.64	EX. 450mm DIA. STM
6	135mm DIA. SAN	77.99	0.30 OVER	77.69	200mm CB LEAD
7	135mm DIA. SAN	78.00	0.73 OVER	77.27	200mm CB LEAD
8	150mm DIA. WM	76.80	0.58 UNDER	77.73	200mm CB LEAD
9	135mm DIA. SAN	78.07	0.79 OVER	77.28	100mm DIA. WM

CROSSING NUMBER	STATION	DESCRIPTION	FINISHED GRADE	TOP OF WATERMAIN	INSULATION REQUIRED	COVER
4	0+000	200 x 150mm TEE	79.43	77.30	YES	2.13
5	0+004	CROSSING OVER EX. SAN	79.46	77.09	YES	2.37
6	0+005.5	CROSSING OVER EX. STM	79.42	77.09	YES	2.33
7	0+013	150mm VALVE & BOX	79.44	77.04		2.40
8	0+014	HYDRANT TEE	79.37	76.97		2.40
9	0+014.5	CROSSING UNDER CB LEAD	79.42	76.95		2.47
10	0+016	150 x 100mm REDUCER	79.34	76.94		2.40
11	0+024.4	CROSSING UNDER SAN	79.68	77.28		2.40
12	0+048	BUILDING ENTRY	79.96	77.56		2.40

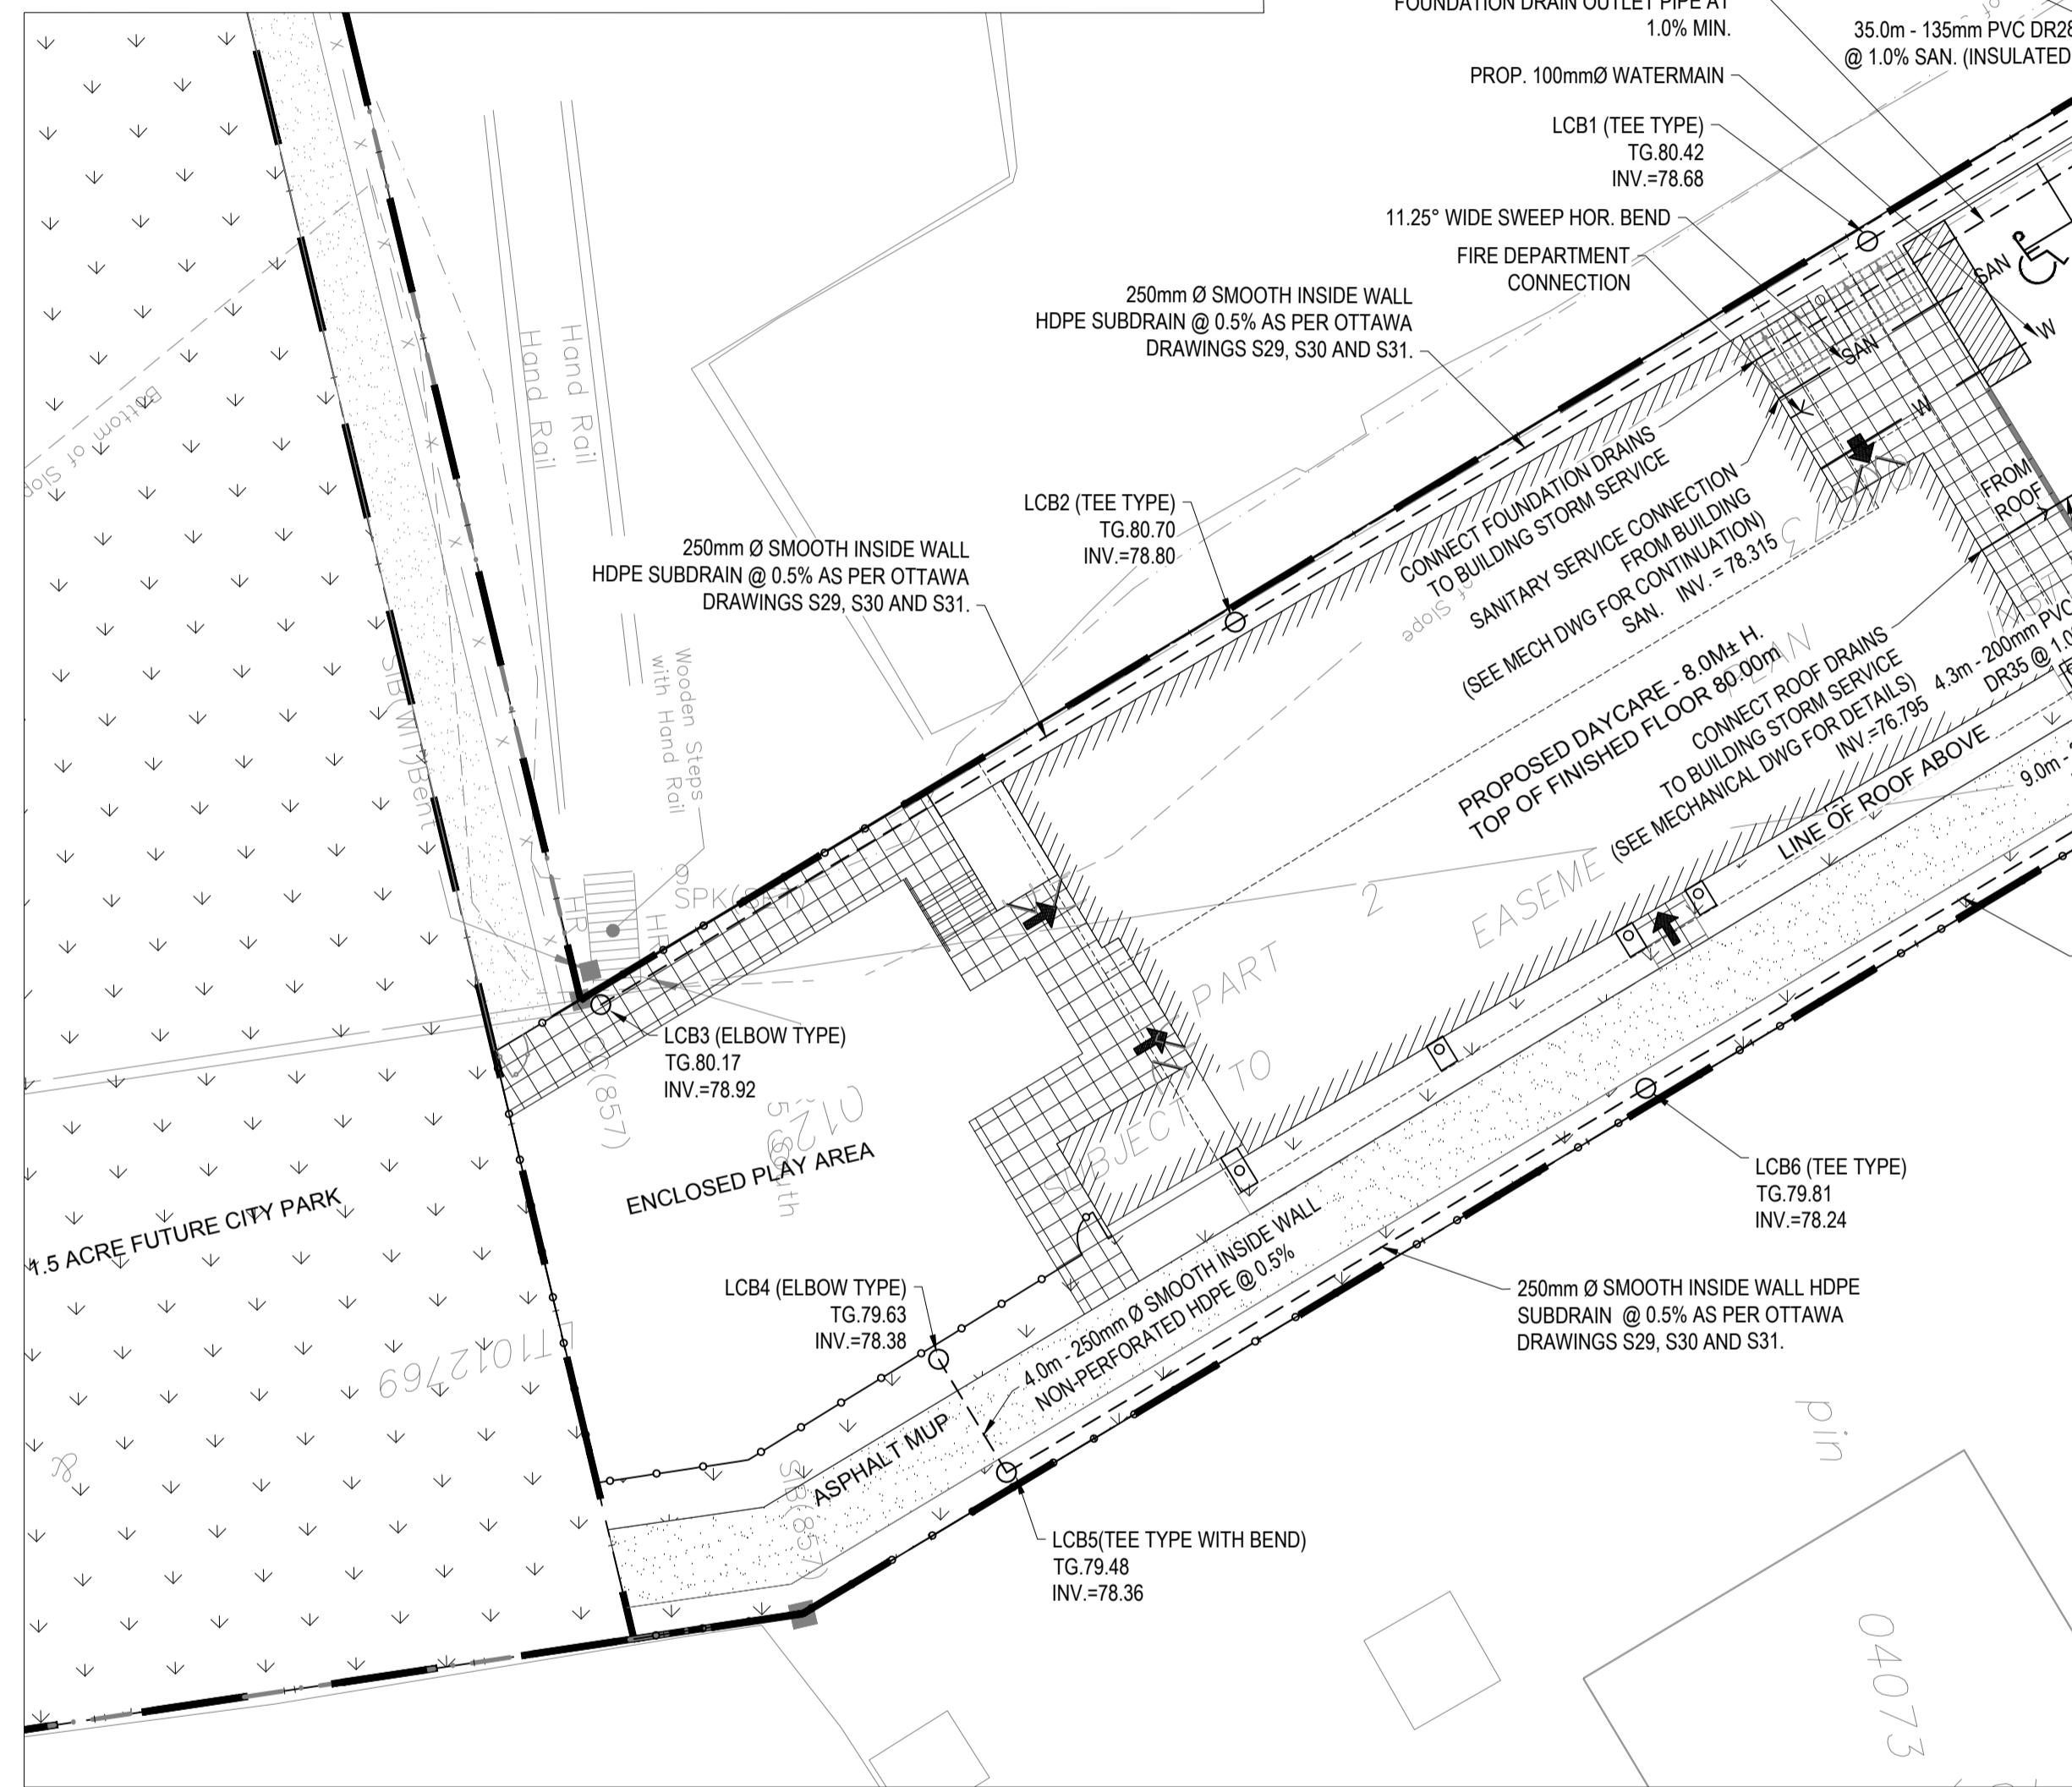

STRUCTURE ID	TOP OF GRATE ELEVATION	INVERT IN	INVERT IN	INVERT OUT	SIZE	DISCRIPTION	COVER
LCB1	80.42	78.680		78.680	300mm	S29 & S31	S30
LCB2	80.70	78.800		78.800	300mm	S29 & S31	S30
LCB3	80.17	78.920		78.920	300mm	S29 & S31	S31
LCB4	79.63	78.380		78.380	300mm	S29 & S31	S31
LCB5	79.81	78.240		78.240	300mm	S29 & S31	S30
LCB5	79.48	78.360		78.360	300mm	S29 & S31	S30
CB1	79.90	78.130		77.700	600x600mm	OPSD-705.010	S19.1
CB2	79.60	78.550		77.590	600x600mm	OPSD-705.010	S19.1
CB3	79.29	78.086		77.086	600x600mm	OPSD-705.010	S19.1
CBMH1	79.71	76.752	77.610	76.732	1200mm DIA.	OPSD-701.101	S28.1
CBMH2	79.38	77.050	76.671	76.651	1200mm DIA.	OPSD-701.010	S28.1
STMH3/OGS	79.45	76.588		76.588	1200mm DIA.	HYDRO INTERNATIONAL FD-4HC	S24.1
SAN MH1	79.44	77.965		77.935	1200mm DIA.	OPSD-701.010	S24
SAN MH2	79.36	77.78/76.78	76.55	76.54	1200mm DIA.	OPSD-701.010	S24

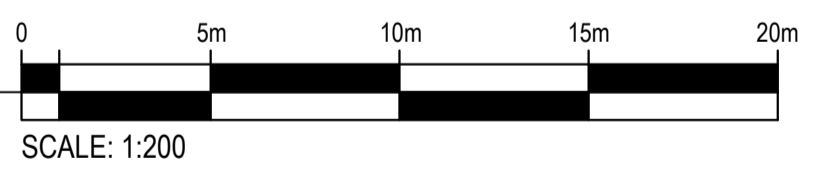

LEGEND

- + 79.81 EXISTING GRADE ELEVATION
- CB EXISTING STORM CATCHBASIN
- MH-ST EXISTING STORM MANHOLE
- MH-SO EXISTING SANITARY MANHOLE
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- 81.43 PROPOSED GRADE ELEVATION
- 79.98TC PROPOSED TOP & BOTTOM OF CURB
- 79.91 PROPOSED TOP OF GRATE
- TG80.42 PROPOSED TOP OF WALL
- 80.50TW PROPOSED SWALE ELEVATION
- 80.55(S) PROPOSED GRADE SLOPE
- 3% PROPOSED 3H:1V TERRACE SLOPE
- W PROPOSED WATER SERVICE
- SAN PROPOSED SANITARY SEWER
- STM PROPOSED STORM SEWER
- STM MH1 PROPOSED STORM SUBDRAIN
- STM MH1 PROPOSED STORM MANHOLE
- CB1 PROPOSED STORM CATCHBASIN
- LCB1 PROPOSED LANDSCAPE CATCHBASIN
- SAN MH1 PROPOSED SANITARY MANHOLE
- VB PROPOSED VALVE AND BOX
- FH PROPOSED FIRE HYDRANT
- PROPOSED FIRE DEPARTMENT CONNECTION

WATER NOTES

- ALL WATER SERVICE AND VALVE MATERIALS TO CONFORM WITH CITY OF OTTAWA STANDARDS. SITE WATER SERVICE AND MAIN TO BE PVC DR18.
- OBTAIN AND PAY FOR WATER PERMIT FROM CITY OF OTTAWA. HYDROSTATIC AND BACTERIOLOGICAL TESTING REQUIRED AS PER OTTAWA STANDARDS. ALL MATERIALS, EXCAVATION, BACKFILL, LABOUR AND REINSTATEMENT BY CONTRACTOR. CITY PROVIDED SERVICES WILL BE PAID UNDER THE WATER PERMIT.
- COMPLY WITH THE FOLLOWING OTTAWA STANDARD DRAWINGS:
 - W17 STANDARD TRENCH DETAIL
 - W18 HYDRANT LOCATION
 - W19 HYDRANT INSTALLATION
 - W22 THERMAL INSULATION FOR WATERMANS IN SHALLOW TRENCHES.
 - W23 THERMAL INSULATION OF WATERMANS AT OPEN STRUCTURES - APPLICABLE AT CB3.
 - W24 VALVE BOX ASSEMBLY
 - W25-3 CONCRETE THRUST BLOCKS
 - W25-4 THRUST BLOCK DIMENSION TABLES
 - W25-5 RESTRAINING AND RETAINING RINGS
 - W25-6 TABLES OF RESTRAINED LENGTHS
 - W25 WATERMAIN CROSSING BELOW SEWER - MIN. CLEARANCE
 - W36 TRACER WIRE INSTALLATION
 - W40 CATHODIC PROTECTION
 - W42 TYPICAL ANODE INSTALLATION
- PROVIDE MINIMUM 2.4m COVER, IF NOT ACHIEVABLE, PROVIDE THERMAL INSULATION TO THE SATISFACTION OF THE CITY, AND IN ACCORDANCE WITH OTTAWA DRAWINGS W22 AND W23.
- PROVIDE FLOW TESTING FOR NEW FIRE HYDRANT AND PAINT HYDRANT BASED ON FLOW RATING IN ACCORDANCE WITH CITY OF OTTAWA REQUIREMENTS FOR PRIVATE HYDRANTS.

wsp

300-2611 QUEENSWAY DRIVE
OTTAWA ONTARIO CANADA K2B 8K2
TEL: 1-613-829-2800 | FAX: 1-613-829-8299 | WWW.WSPGROUP.COM

CLIENT

CANOE BAY DEVELOPMENT INC.
51 CORTLEIGH DRIVE
OTTAWA, ONTARIO K2J 3Z8
613-447-0208

KEYPLAN

NORTH / **NORD** / **SEAL** / **SCEAU**

No.	ISSUE NOTES	DATE
1	ISSUED FOR SITE PLAN APPLICATION	2019-05-10
2		
3		
4		
5		
6		
7		
8		

This drawing is the sole property of GENIVAR. Reproduction is not permitted. Only stamped, signed and dated copies of this drawing can be used for construction. Drawings shall be read in conjunction with other project drawings.

This drawing is not to be scaled. Contractor shall check & verify any discrepancies with GENIVAR prior to proceeding with the work.

Contractor must comply with the requirements of applicable codes, bylaws and other authorities having jurisdiction.

Electronic versions of this drawing shall not be used without written permission.

PROJECT NAME / **NOM DU PROJET**

RIVERSIDE PARK NURSERY SCHOOL
2826 SPRINGLAND DRIVE
OTTAWA, ONTARIO

DRAWING TITLE / **TITRE DU DESSIN**

CIVIL SERVICES PLAN


INFORMATION / **SHEET No.** / **No. PAGE**

Designed by: JJ
Drawn by: BN
Reviewed by: JJ
Approved by: JJ
Scale: AS SHOWN
Date: 2019-03-22
Project No.: 191-03236-00
Client Plan#:

C2

1 SERVICES PLAN
C2 SCALE= 1:200

- SEWER NOTES**
- CONSTRUCT SEWERS AND APPURTENANCES AS PER OTTAWA AND MINISTRY OF THE ENVIRONMENT STANDARDS. CONFIRM EXISTING TIE IN ELEVATIONS PRIOR TO CONSTRUCTION. SEWER TRENCH SHALL INCLUDE CLASS 'B' BEDDING AS PER OTTAWA S6 AND S7. COMPACTION TO BE A MINIMUM OF 95% SPMD FOR PIPE AND DRAINAGE STRUCTURE BEDDING AND BACKFILL.
 - PVC STORM SEWERS AND CATCH BASIN LEADS TO BE PVC DR 35 CERTIFIED TO CAN/CSA-B182.2. PVC SANITARY SERVICE TO BE DR28 TO CAN/CSA B182.2.
 - PROVIDE FLEXIBLE BOOT CONNECTION FOR ALL PVC SEWER CONNECTIONS AT MANHOLES. PROVIDE RUBBER CONNECTORS IN ACCORDANCE WITH CSA A257-3-09 FOR CONCRETE PIPE CONNECTORS TO MANHOLES.
 - CATCHBASIN SUMP TO BE 600mm.
 - SEWERS AND SERVICES SHALL BE CONSTRUCTED WITH A MINIMUM CLEARANCE OF 2.0m FROM TREES.
 - STORM MANHOLES TO HAVE 300mm MINIMUM SUMP FOLLOWING LOW INVERT. SANITARY MANHOLES TO BE BENCHED AS PER OPSD 701.021.
 - PROVIDE CAMERA INSPECTION OF ALL SEWERS FOLLOWING COMPLETION OF CONSTRUCTION AND PROVIDE TO ENGINEER. MAINTAIN SEWERS IN CLEAN CONDITION UNTIL OWNER ACCEPTANCE.
 - TEMPORARY FLOW CONTROLS TO BE PLACED ON SEWER OUTLETS AS PER OTTAWA TECHNICAL BULLETIN ISD 2010-1. INLET CONTROL DEVICE PLACEMENT TO BE CERTIFIED BY QUALITY VERIFICATION ENGINEER RETAINED BY CONTRACTOR.
 - PROVIDE 50mm THICK HIGH DENSITY GRADE POLYSTYRENE INSULATION ACROSS WIDTH OF TRENCH (MINIMUM 1220mm) AT 150mm ABOVE SANITARY SEWER.
 - PERFORM LEAKAGE TESTING OF SANITARY SEWERS IN ACCORDANCE WITH OPSD 410.07.01.15 AND 407.07.25. TESTING SHALL BE OBSERVED BY AN ONTARIO REGISTERED PROFESSIONAL ENGINEER, RETAINED BY THE CONTRACTOR, WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.

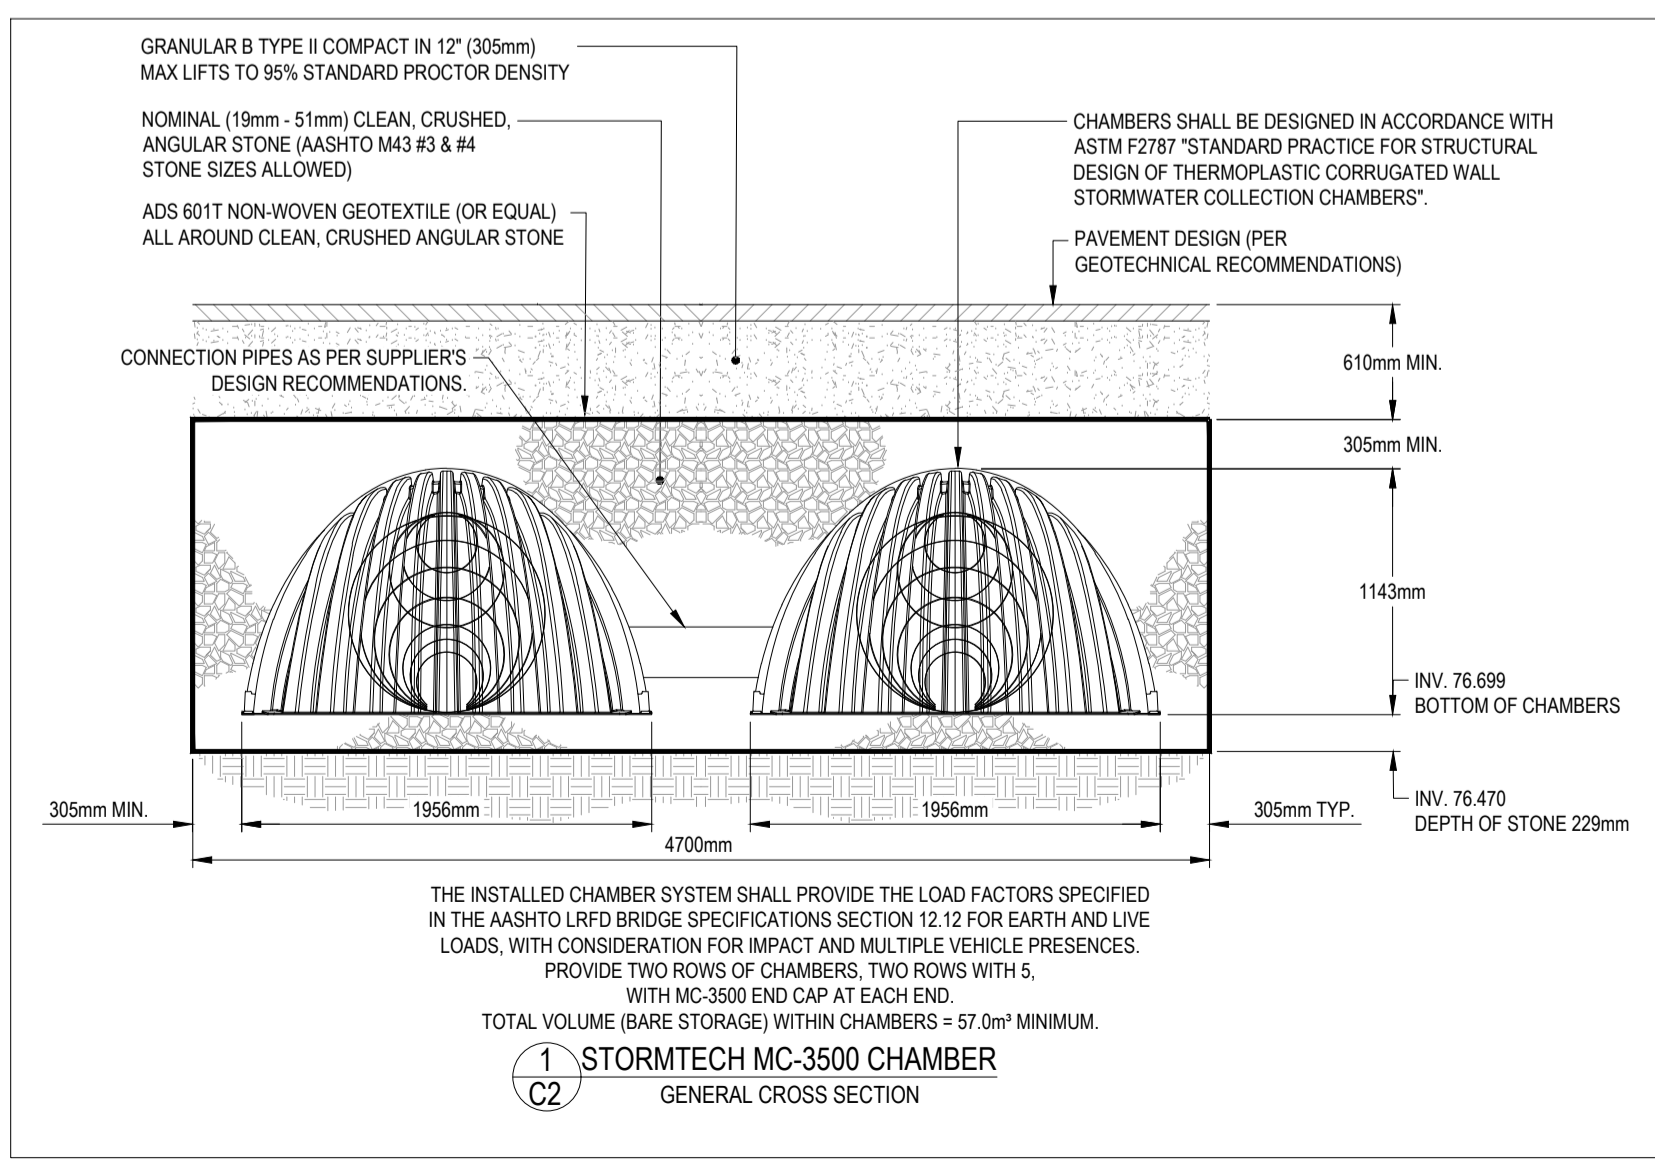

FILENAME: P:\2019 Projects\191-03236-00_Riverside Park NS, Ottawa - New Daycare Centre\CHS3_Drawing\Working drawings\Sheets\191-03236-00_C.dwg
PLOT DATE: May 09, 2019 - 11:10am, cmw050741