


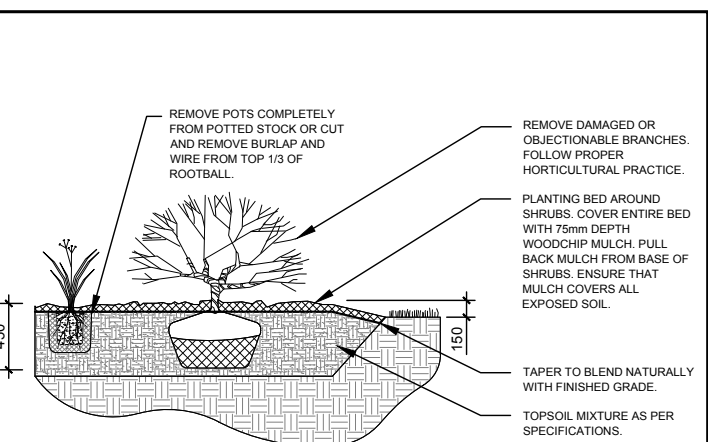
GENERAL NOTES:

1. It is the responsibility of the appropriate contractor or official to report any errors, omissions or discrepancies on this plan with actual site conditions to the Landscape Architect before proceeding with construction.
2. The contractor is to notify all utility companies and authorities prior to any excavation and ascertain locations of underground services.
3. The contractor is to reinstate all areas and items damaged as a result of construction activity.
4. The contractor is to comply with all pertinent codes and by-laws.
5. The contractor is to maintain a positive surface run-off throughout the entire construction period.
6. The Landscape Architect is not responsible for subsurface conditions.
7. The contractor is to identify all existing trees to remain on site with the Landscape Architect prior to construction.
8. The contractor is to stake the proposed location of all plant material.
9. Minimum distances for selected deciduous trees are as follows:
 - Building Foundations 7.5m
 - Sidewalks 1.5m
 - Public Streets 2.5m
 - Underground Infrastructure 2.0m
10. All trees within 1m of underground utility trenches are to be excavated.
11. Remove all protective wrapping from tree trunks after installation.
12. Staking of trees shall only be performed if necessary.
13. Ensure that mulch is pulled back a min. distance of 15mm from base of tree trunk.

APPROVED
By Jamesdo on 2:42 pm, Sep 13, 2019



DOUGLAS JAMES, MCIP, RPP
MANAGER, DEVELOPMENT REVIEW - CENTRAL
PLANNING, INFRASTRUCTURE & ECONOMIC
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA




REMOVE POTS COMPLETELY FROM POTTED STOCK OR CUT AND REMOVE BURLAP AND WIRE FROM TOP 1/3 OF ROOTBALL

REMOVE DAMAGED OR OBSCURABLE BRANCHES. FOLLOW PROPER HORIZONTAL, VERTICAL, PRUNING

PLANTING BED AROUND SHRUBS. COVER ENTIRE BED WITH 25mm DEPTH WOODCHIP MULCH. PULL BACK MULCH FOR BASE OF SHRUBS. ENSURE THAT MULCH COVERS ALL EXPOSED SOIL.

TAPER TO BLEND NATURALLY WITH EXISTING GRADE

TOPSOIL MATURE AS PER SPECIFICATIONS

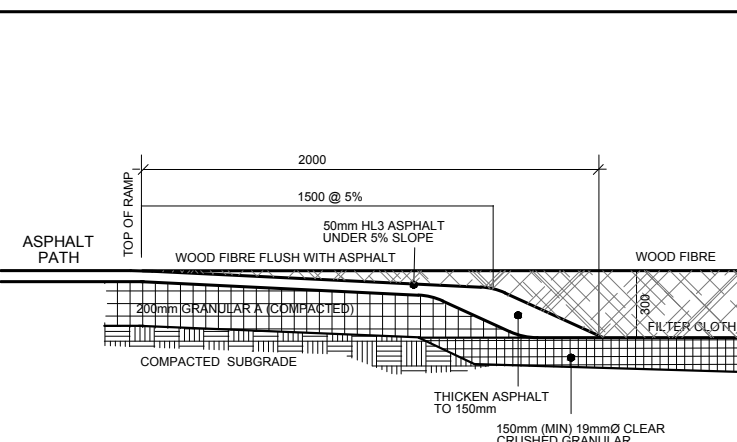

2000

1500 @ 2%

50mm H-3 ASPHALT UNDER 2% SLOPE

WOOD FIBRE FILLISH WITH ASPHALT

WOOD FIBRE

ASPHALT PATH

TOP OF RAMP

150mm H-2 ASPHALT

150mm H-1 ASPHALT

100mm H-4 ASPHALT

THICKEN ASPHALT TO 150mm

150mm H-1 WITH 10% CLEAR CRUSHED GRANULAR

COMPACTED SUBGRADE

• 2000mm WIDE RAMP


• 50mm WIDE ACCESS RAMP LINE AT TOP OF RAMP

2
L1

SHRUB / PERENNIAL PLANTING
SCALE: NTS

3
L1

ASPHALT ACCESS RAMP
SCALE: NTS

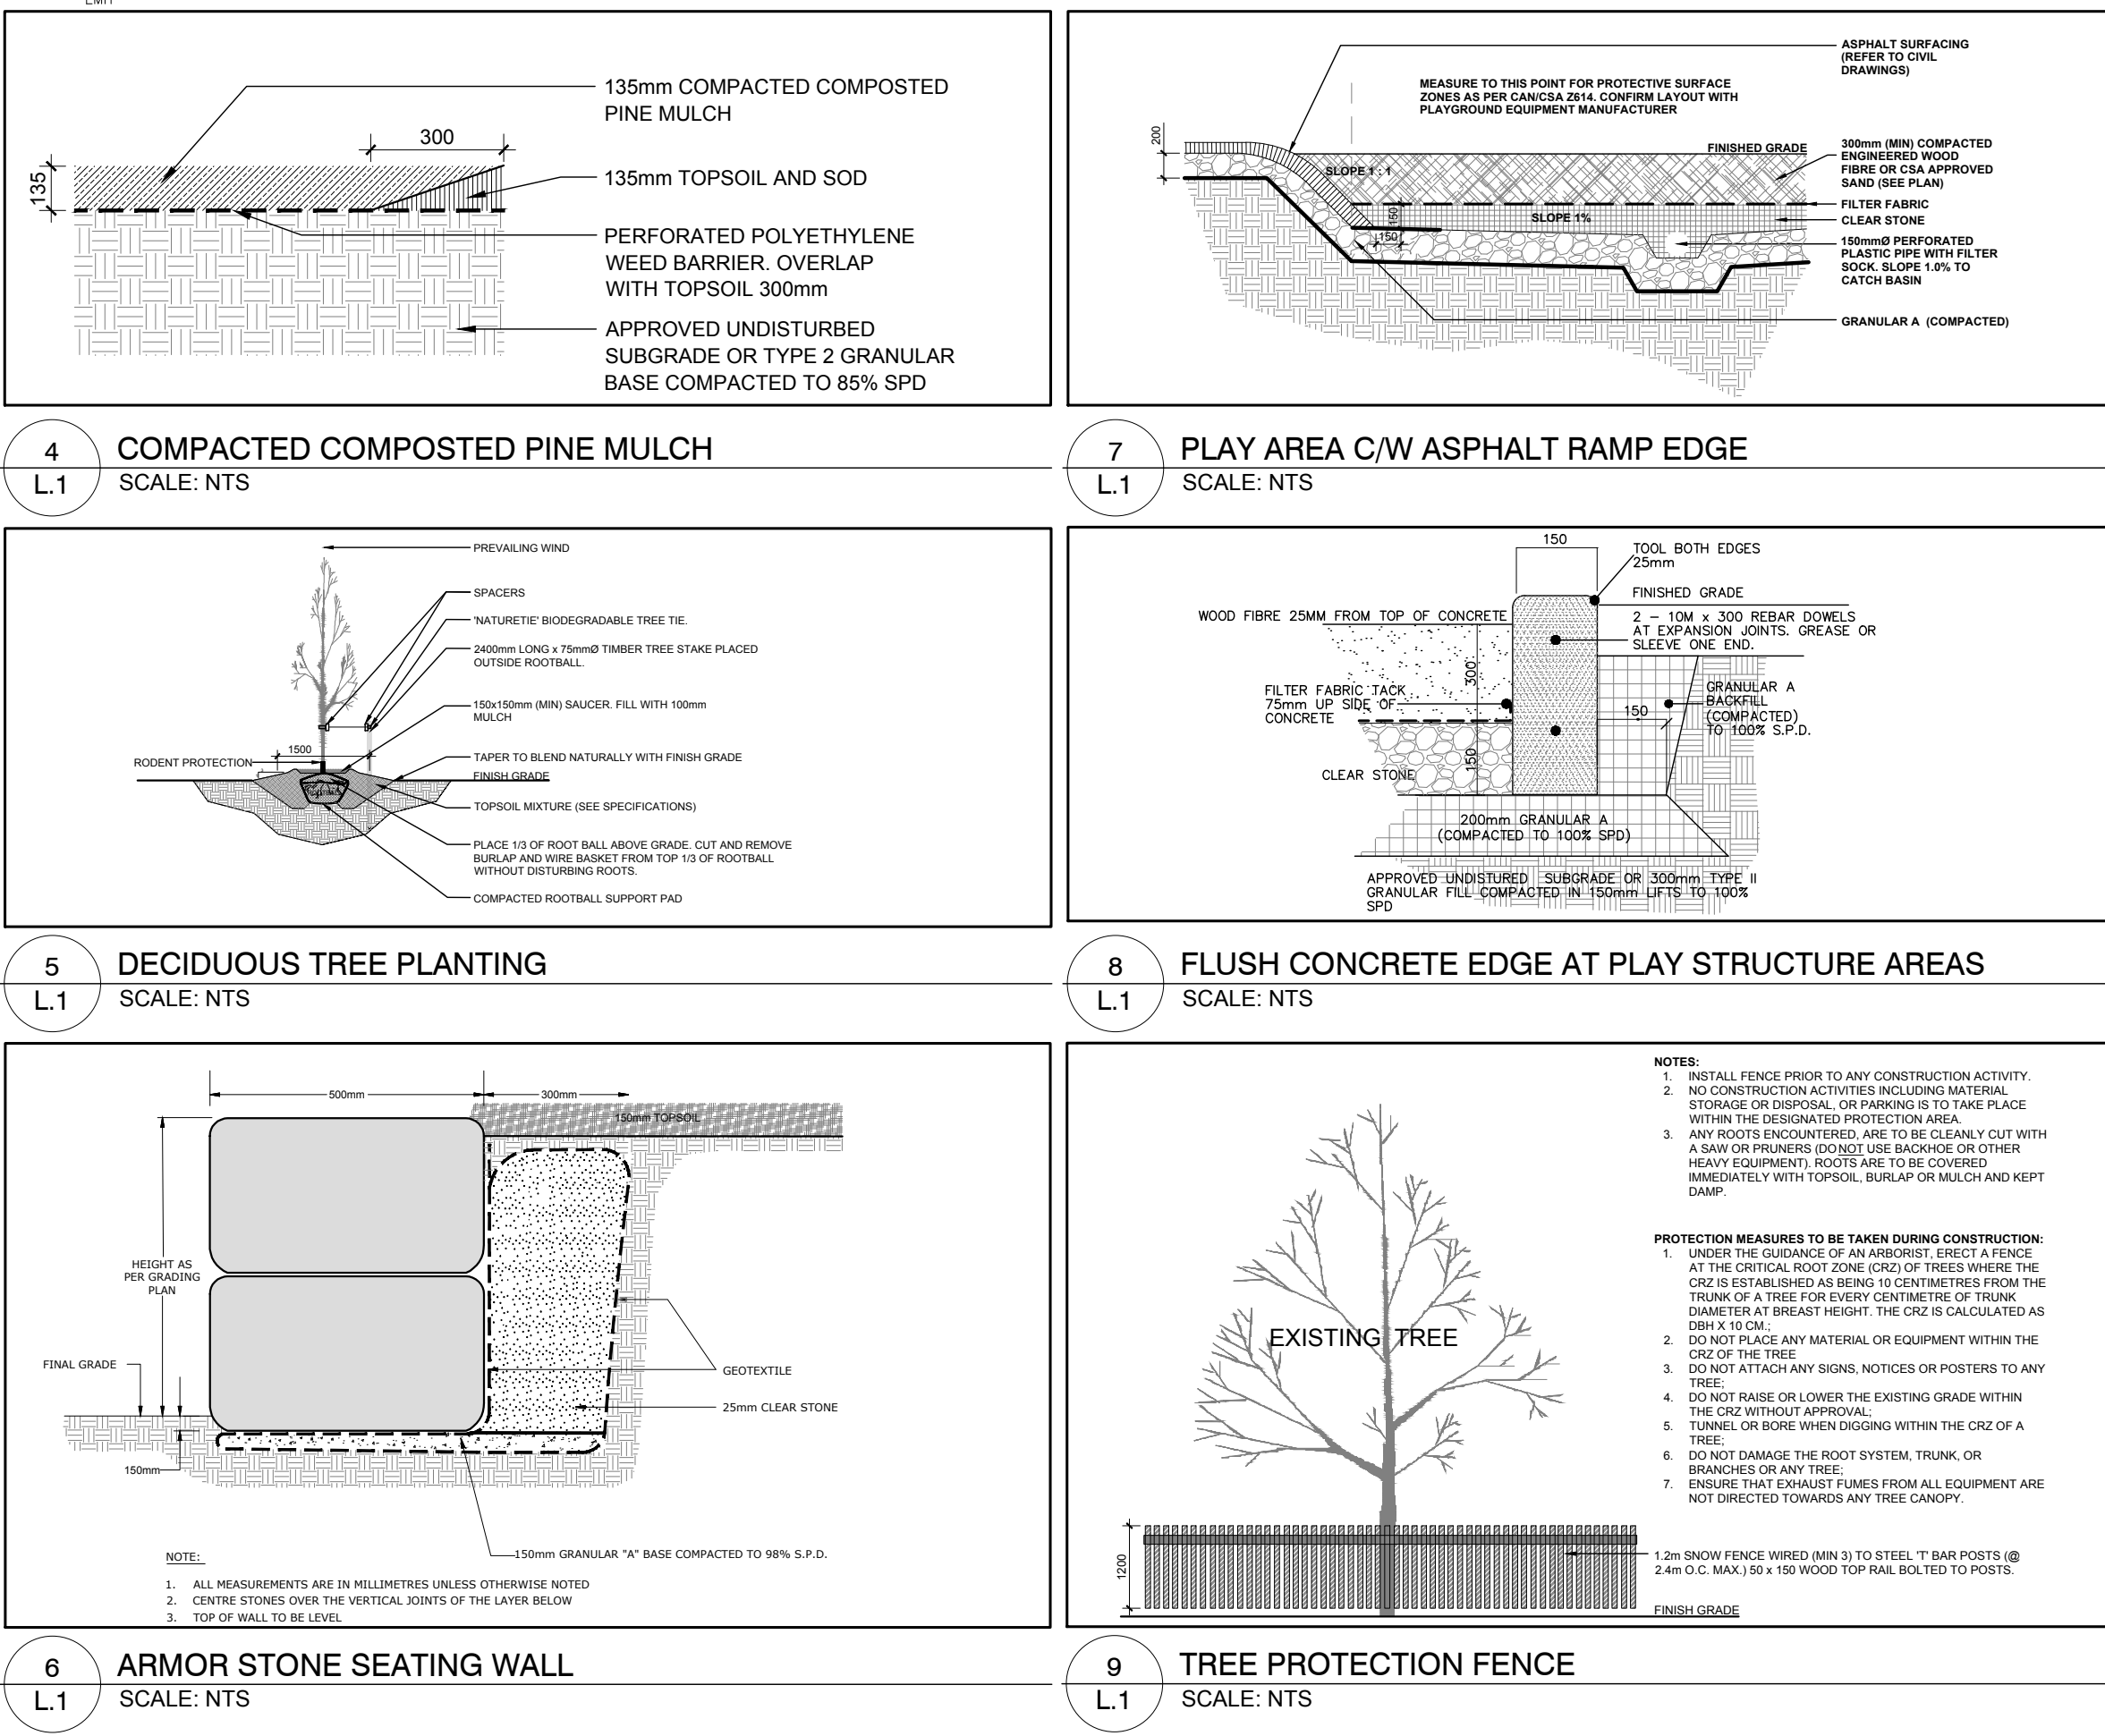

D007-12-18-0194