

**SERVICING AND STORMWATER
MANAGEMENT REPORT**

FOR

**GREATWISE DEVELOPMENTS
2795 BASELINE ROAD – PHASE 2**

CITY OF OTTAWA

PROJECT NO.: 18-1055
DEVELOPMENT FILE NO.: D07-12-19-0009

JUNE 2020 – REV. 5
© DSEL

**SERVICING AND STORMWATER MANAGEMENT REPORT
FOR
2795 BASELINE ROAD – PHASE 2
GREATWISE DEVELOPMENTS**

TABLE OF CONTENTS

1.0	INTRODUCTION	1
1.1	Existing Conditions	2
1.2	Required Permits / Approvals	3
1.3	Pre-consultation.....	3
2.0	GUIDELINES, PREVIOUS STUDIES, AND REPORTS.....	4
2.1	Existing Studies, Guidelines, and Reports.....	4
3.0	WATER SUPPLY SERVICING	6
3.1	Existing Water Supply Services	6
3.2	Water Supply Servicing Design	6
3.3	EPANet Water Modelling	8
3.4	Water Supply Conclusion	9
4.0	WASTEWATER SERVICING.....	10
4.1	Existing Wastewater Services	10
4.2	Wastewater Design	10
4.3	Morrison Drive Sanitary Sewer Hydraulic Grade Line Assessment.....	11
4.4	Wastewater Servicing Conclusions	12
5.0	STORMWATER MANAGEMENT	13
5.1	Existing Stormwater Services	13
5.2	Post-development Stormwater Management Target	13
5.3	Proposed Stormwater Management System	15
5.4	Proposed Major System Flow.....	17
5.5	Stormwater Servicing Conclusions	17
6.0	UTILITIES.....	18
7.0	EROSION AND SEDIMENT CONTROL	19
8.0	CONCLUSION AND RECOMMENDATIONS	20

FIGURES

Figure 1 Site Location

TABLES

Table 1	Water Supply Design Criteria
Table 2	Water Demand - Proposed Site Conditions
Table 3	FUS Estimated Fire Flow Summary
Table 4:	Model Simulation Output Summary
Table 5	Summary of Existing Wastewater Flow – 2781 Baseline Road
Table 6	Wastewater Design Criteria
Table 7	Summary of Estimated Peak Wastewater Flow - Ultimate
Table 8	Available Subcatchment Storage Volumes
Table 9	Drainage Area Summary
Table 10	Summary of Storm Structure ICD
Table 11	Drainage Area Storage Volume Analysis 100-Year 6- Hour Storm
Table 12	Summary of Storage and Peak Flow Rates for the 5 and 100-Year Storm Distribution
Table 13	Storm Sewer Design Criteria

APPENDICES

Appendix A	Pre-consultation Notes
Appendix B	Water Supply
Appendix C	Wastewater Collection
Appendix D	Stormwater Management
Drawings / Figures	Proposed Site Plan

**SERVICING AND STORMWATER MANAGEMENT REPORT
FOR
2795 BASELINE ROAD – PHASE 2
GREATWISE DEVELOPMENTS
JUNE 2020 – REV. 5**

**CITY OF OTTAWA
PROJECT NO.: 18-1055**

1.0 INTRODUCTION

David Schaeffer Engineering Limited (DSEL) has been retained by Greatwise Developments to prepare a Servicing and Stormwater Management report in support of the application for Part Lot Control (PLC) and for Site Plan Control (SPC) for the Fresh Towns III development at 2795 Baseline Road.

The subject property is located within the City of Ottawa urban boundary, in Ward 8 - College. As illustrated in **Figure 1**, below, the site is bound by Morrison Drive to the west, Baseline Road to the south, and an existing residential development is located to the east, and an existing residential development to the North. Comprised of a single parcel of land, the subject site measures approximately **0.42 ha** and is zoned High Density Residential [R5A].



Figure 1: Site Location

The existing SPC (***Previously Approved Brief***) for 2781 Baseline Road allowed for the Phase 1 and Phase 2 developments, Building E and Building F, respectively. Building E has been constructed and is now part of OC1791074. The ***Previously Approved Brief*** proposed **80** apartment units within Building E, and **80** apartment units and **598 m²** of commercial space within Building F.

The proposed PLC and SPC for Fresh Towns Phase III would allow for the development of **32** slab on grade townhome units. Minor revisions to the above-ground parking lot and site entrance within 2781 Baseline Road are proposed. A copy of the Site Plan is included in ***Drawings/Figures***.

The objective of this report is to provide sufficient detail to demonstrate that the existing municipal services provide sufficient capacity to support the PLC and SPC for the proposed Fresh Towns Phase III development at 2795 Baseline Road.

1.1 Existing Conditions

The existing site contains a temporary stormwater management pond to service the existing development at 2781 Baseline Road. The elevations range between 75.20 m and 77.57 m with a minimal grade change of approximately 2.37 m from the Northeast to the Southwest corner of the property.

An existing 200 mm diameter sanitary sewer and an existing 300 mm diameter storm sewer are located within both 2710 Draper Avenue and 2795 Baseline Road. The existing sewers were previously approved with the existing 2781 Baseline Road SPC and installed to support both the 2781 Baseline Road and 2795 Baseline Road developments.

Sewer and watermain mapping collected from the City of Ottawa indicate that the following services exist across the property frontages, within the adjacent municipal right-of-ways:

Morrison Drive:

- 203 mm diameter cast iron watermain;
- 300 mm diameter storm sewer, tributary to Ottawa Central sub-watershed; and
- 225 mm diameter concrete sanitary sewer, tributary to the Pinecrest Collector.

Baseline Road:

- 406 mm diameter cast iron watermain;
- 1200 mm diameter AWWA C301 watermain;
- 300 mm diameter storm sewer, tributary to the Graham Creek sub-watershed; and
- 375 mm diameter storm sewer, tributary to the Graham Creek sub-watershed.

2795 Baseline Road:

- 200 mm diameter PVC sanitary sewer, within 2795 Baseline Road and 2710 Draper Avenue, tributary to the Pinecrest Collector;
- 300 mm diameter PVC storm sewer, within the 2795 Baseline Road and 2710 Draper Avenue, tributary to the Ottawa Central sub-watershed.

1.2 Required Permits / Approvals

The proposed development is subject to the site plan control approval process. The City of Ottawa must approve the engineering design drawings and reports prior to the issuance of site plan control.

It is anticipated that an Environmental Compliance Application (ECA) will be required for the proposed development as the proposed sewers will service multiple parcels of land. The Ministry of the Environment, Conservation, and Parks (MECP) has been contacted to confirm the requirement for the ECA, however, no response was received at the time of publication. Correspondence with the MECP is included in **Appendix A**.

Flows that influence the watershed in which the subject property is located are further reviewed by the principal authority. The subject property is located within the Ottawa River watershed and is therefore, subject to review by the Rideau Valley Conservation Authority (RVCA). Correspondence with the RVCA is included in **Appendix A**.

1.3 Pre-consultation

Pre-consultation correspondence, along with the servicing guidelines checklist, is located in **Appendix A**.

2.0 GUIDELINES, PREVIOUS STUDIES, AND REPORTS

2.1 Existing Studies, Guidelines, and Reports

The following studies were utilized in the preparation of this report:

- **Ottawa Sewer Design Guidelines**
City of Ottawa, *SDG002*, October 2012.
(City Standards)
 - **Technical Bulletin ISTB-2018-01**
City of Ottawa, March 21, 2018.
(ISTB-2018-01)
 - **Technical Bulletin ISTB-2018-04**
City of Ottawa, June 27, 2018.
(ISTB-2018-04)
- **Ottawa Design Guidelines – Water Distribution**
City of Ottawa, July 2010.
(Water Supply Guidelines)
 - **Technical Bulletin ISD-2010-2**
City of Ottawa, December 15, 2010.
(ISD-2010-2)
 - **Technical Bulletin ISDTB-2014-02**
City of Ottawa, May 27, 2014.
(ISDTB-2014-02)
 - **Technical Bulletin ISDTB-2018-02**
City of Ottawa, March 21, 2018.
(ISDTB-2018-02)
- **Design Guidelines for Sewage Works**
Ministry of the Environment, 2008.
(MOE Design Guidelines)
- **Stormwater Planning and Design Manual**
Ministry of the Environment, March 2003.
(SWMP Design Manual)
- **Ontario Building Code Compendium**
Ministry of Municipal Affairs and Housing Building Development Branch,
January 1, 2010 Update.
(OBC)

-
- **Morrison Court Development Wastewater Servicing Study**
Novatech Engineering Consultants Ltd., January 2009.
(Existing Wastewater Study)

 - **Geotechnical Investigation, Proposed Residential Development – Phase 3-3**
Paterson Group, Inc., PG1630-5, January 14, 2019.
(Geotechnical Investigation)

 - **Functional Servicing and Stormwater Management Brief in support of Site Plan Amendment for 2781 Baseline Road**
David Schaeffer Engineering Ltd., April 2016.
(Previously Approved Brief)

 - **Geotechnical Response to City Comments**
Paterson Group, Inc., PG1630-MEMO.31, March 20, 2020.
(PG1630-MEMO.31)

 - **Geotechnical Response to City Comments**
Paterson Group, Inc., PG1630-MEMO.32, May 20, 2020.
(PG1630-MEMO.32)

3.0 WATER SUPPLY SERVICING

3.1 Existing Water Supply Services

The subject property lies within the City of Ottawa 1W pressure zone, as shown by the Pressure Zone Map located in **Appendix B**. Potable water is available to the development via an existing 203 mm diameter watermain within the Morrison Drive right-of-way and an existing 406 mm diameter watermain within the Baseline Road right-of-way.

3.2 Water Supply Servicing Design

It is proposed that the development will have an internal watermain network with two connections to the existing 203 mm diameter watermain within Morrison Drive. Townhomes will have independent connections to the internal watermain network via 19 mm diameter service laterals. Refer to drawing **SSP-1**, accompanying this report, for a detailed servicing layout.

Table 1, below, summarizes the **Water Supply Guidelines** employed in the preparation of the preliminary water demand estimate.

Table 1
Water Supply Design Criteria

Design Parameter	Value
Residential Townhome	2.7 P/unit
Residential Average Daily Demand	350 L/d/P
Residential Maximum Daily Demand	4.9 x Average Daily *
Residential Maximum Hourly	7.4 x Average Daily *
Minimum Watermain Size	150 mm diameter
Minimum Depth of Cover	2.4 m from top of watermain to finished grade
During normal operating conditions desired operating pressure is within	350 kPa and 480 kPa
During normal operating conditions pressure must not drop below	275 kPa
During normal operating conditions pressure must not exceed	552 kPa
During fire flow operating pressure must not drop below	140 kPa
<small>*Daily average based on Appendix 4-A from Water Supply Guidelines ** Residential Max. Daily and Max. Hourly peaking factors per MOE Guidelines for Drinking-Water Systems Table 3-3 for 0 to 500 persons. -Table updated to reflect ISD-2010-2</small>	

The City of Ottawa was contacted to obtain boundary conditions associated with the estimated water demand as indicated in **Table 2**. No response was received at the time of publication, and as a result boundary conditions received for the development at 2710 Draper Avenue were utilized. Correspondence with the City has been included in **Appendix B**.

Table 2, below, summarizes the water supply demand and boundary conditions for the proposed development based on the **Water Supply Guidelines**.

**Table 2
 Water Demand - Proposed Site Conditions**

Design Parameter	Estimated Demand ¹ (L/min)	Boundary Condition ² Connection 1 (Morrison Drive - Northern) (m H ₂ O / kPa)	Boundary Condition ² Connection 2 (Morrison Drive - Southern) (m H ₂ O / kPa)
Average Daily Demand	21.1	39.8 / 390.6	39.1 / 383.4
Max Day + Fire Flow	103.6 + 12,000 = 12,103.6	19.8 / 194.4	19.1 / 187.2
Peak Hour	156.5	30.2 / 296.5	29.5 / 289.2
1) Water demand calculation per Water Supply Guidelines . See Appendix B for detailed calculations. 2) Boundary conditions supplied by the City of Ottawa for the demands indicated in the correspondence; assumed ground elevation 75.7m and 76.4m for Connection 1 and 2, respectively. See Appendix B .			

As indicated in **Table 2**, above, the estimated average daily demand for the proposed development based on the site statistics provided by RLA Architecture is **21.1 L/min**.

Fire flow requirements are to be determined in accordance with City of Ottawa **Water Supply Guidelines**, and the Ontario Building Code.

Fire flow requirements were estimated per City of Ottawa Technical Bulletin **ISTB-2018-02**. The following parameters were established by Roderick Lahey Architects:

- Type of construction – Ordinary Construction;
- Occupancy type – Limited Combustible; and
- Sprinkler Protection – Non-Sprinkler System.

Table 3, below, summarizes the estimated fire flow demands based on the FUS method and summarizes the available fire hydrants within 75 and 150 meters from each block. Detailed calculations can be found in **Appendix B**.

Table 3
FUS Estimated Fire Flow Summary

Phase	Estimated Demand (L/min)	Fire Hydrant(s) within 75 Meters (5,700 L/min)	Fire Hydrant(s) within 150 Meters (3,800 L/min)	Combined Fire Flow Available (L/min)
Block 12 & Block 13	12,000	FH1, EX. FH2	EX. FH3	15,200
Block 14 & Block 15	12,000	FH1	EX. FH2, EX. FH3, EX. FH4	17,100

The above assumptions result in a maximum fire flow of approximately **12,000 L/min**, noting that actual building materials selected will affect the estimated flow. Based on **Table 3**, there are a sufficient number of fire hydrants, proposed and existing, to support the Phase 2 development. Hydrant locations are identified on drawing **SSP-1**, accompanying this report, and on the *Existing Fire Hydrants* figure included in **Appendix B**.

The City provided both the anticipated minimum and maximum water pressures, as well as, the estimated water pressure during fire flow demand as indicated by the correspondence in **Appendix B**. The minimum and maximum pressures fall within the required range identified in **Table 1**.

3.3 EPANet Water Modelling

EPANet was utilized to determine pipe sizing and the availability of pressures throughout the system during average day demand, max day plus fire flow, and peak hour demands. The static model determines pressures based on the available head obtained from the boundary conditions provided by the City of Ottawa for 2710 Draper Avenue, as indicated in **Table 2**.

The model utilizes the Hazen-Williams equation to determine pressure drop, while the pipe properties, including friction factors, have been selected in accordance with Table 4.4 of the **Water Supply Guidelines**. The model was prepared to assess the available pressure at the finished first floor of each building, as well as, the pressures the watermain provides to fire hydrants during fire flow conditions.

For the purposes of determining sufficient fire flow, **6,000 L/min** for a total of **12,000 L/min** was modelled at the proposed fire hydrant, FH1, and the existing fire hydrant, EX. FH2. Refer to the *Existing Fire Hydrants* figure, located in **Appendix B**, for the location of the existing fire hydrants, EX. FH2, EX. FH3, and EX. FH4.

Table 4, below, summarizes the model results. **Appendix B** contains output reports and model schematics for each scenario.

Table 4: Model Simulation Output Summary

Location	Average Day (kPa)	Max Day + Fire Flow (kPa)	Peak Hour (kPa)
EX.FH2	421.0	181.3	326.9
FH1	401.9	186.1	307.7
N1	414.7	216.1	320.5
N2	409.1	202.5	314.9
N3	403.4	187.6	309.2
N4	405.2	201.7	311.0
N5	411.7	213.0	317.0
N6	406.5	199.6	311.8
N8	401.8	197.9	306.6
N9	400.5	184.1	305.3

Based on the EPANET model, pressures during average day, max day + fire flow and peak hour, and peak hour respect the requirements of the **Water Supply Guidelines**. As demonstrated in **Table 4**, the local fire hydrants can provide each block with the required fire flows indicated in **Table 3**.

3.4 Water Supply Conclusion

The FUS assumptions result in an estimated fire flow of approximately **12,000 L/min**. The proposed average day water supply demand for the Phase 2 development based on the site plan is calculated to be **21.1 L/min**, as indicated in **Table 2**.

Based on the EPANET model, pressures during average day, max day + fire flow and peak hour, and peak hour respect the requirements of the **Water Supply Guidelines** and the proposed hydrants can provide each block with the require fire flows.

The proposed water supply design conforms to all relevant City Guidelines and Policies.

4.0 WASTEWATER SERVICING

4.1 Existing Wastewater Services

The subject site lies within the Pinecrest Collector Sewer catchment area, as shown by the City sewer mapping, included in **Appendix C**. An existing 225 mm diameter sanitary sewer within Morrison Drive and an existing 200 mm diameter sanitary sewer within the subject site are available to service the proposed development.

Currently, 2781 Baseline Road is serviced by the existing 200 mm diameter sanitary sewer located across the subject site. **Table 5**, below, demonstrates the estimated peak flow from the existing development based on the site statistics provided in the **Previously Approved Brief**. See **Appendix C** for associated calculations.

Table 5
Summary of Existing Wastewater Flow – 2781 Baseline Road

Design Parameter	Total Flow (L/s)
Estimated Average Dry Weather Flow	0.70
Estimated Peak Dry Weather Flow	2.52
Estimated Peak Wet Weather Flow	2.83

The sanitary sewer is tributary to the Pinecrest Collector sewer, which is located approximately 1.4 km downstream of the site.

An assessment of the existing Morrison Drive sanitary sewer capacity was conducted for the development at Fresh Towns - Phase 1 and Phase 2. As indicated by the **Previously Approved Brief**, the analysis identified that there is an available capacity within the Morrison Drive sanitary sewer, of **8.0 L/s**. Refer to Section 4.3 for further discussion.

4.2 Wastewater Design

It is proposed that the development will have an internal sanitary sewer network with a connection to the existing 200 mm diameter sanitary sewer within the subject site. Townhomes will have independent connections to the internal 200 mm diameter sanitary sewer network via 135 mm diameter service laterals.

The adjacent development, within the 2781 Baseline Road lands, will be serviced via a connection to the internal sanitary sewer network within the subject site. Existing sanitary structure, EX SAN 1, is proposed to be relocated to accommodate the site plan. Sanitary calculation sheet employed in the design of the internal network is included in **Appendix C**. Refer to drawing **SSP-1**, accompanying this report, for a detailed servicing layout.

Table 6, below, summarizes the **City Standards** employed in the design of the proposed wastewater sewer system.

Table 6
Wastewater Design Criteria

Design Parameter	Value
Residential Townhome	2.7 P/unit
Average Daily Demand	280 L/d/per
Peaking Factor	Harmon's Peaking Factor. Max 4.0, Min 2.0 Harmon's Correction Factor 0.8
Infiltration and Inflow Allowance	0.05 L/s/ha (Dry Weather) 0.28 L/s/ha (Wet Weather) 0.33 L/s/ha (Total)
Sanitary sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} AR^{2/3} S^{1/2}$
Minimum Sewer Size (Inside Greenbelt)	200 mm diameter
Minimum Manning's 'n'	0.013
Minimum Depth of Cover	2.5 m from crown of sewer to grade
Minimum Full Flowing Velocity	0.6 m/s
Maximum Full Flowing Velocity	3.0 m/s
<i>Extracted from Sections 4 and 6 of the City of Ottawa Sewer Design Guidelines, October 2012</i> *Please note that the residential average daily flow uses 280 L/person/d in line with proposed updates to City Design Guidelines.	

Table 7, below, demonstrates the estimated peak flow from the proposed development based on the site statistics provided by RLA Architecture. See **Appendix C** for associated calculations.

Table 7
Summary of Estimated Peak Wastewater Flow - Ultimate

Design Parameter	Total Flow (L/s)
Estimated Average Dry Weather Flow	1.46
Estimated Peak Dry Weather Flow	5.06
Estimated Peak Wet Weather Flow	5.67

DSEL estimated the peak wet weather flow based on the development statistics provided by RLA Architecture for the existing development at 2781 Baseline Road and the proposed developments at 2710 Draper Avenue (City File No. D07-12-17-0076) and 2795 Baseline Road. As indicated by **Table 7**, the subject sites propose a peak wet weather sanitary flow of **5.67 L/s**.

4.3 Morrison Drive Sanitary Sewer Hydraulic Grade Line Assessment

A preliminary assessment of the existing Morrison drive sanitary sewer capacity was conducted by Novatech. This analysis is provided in **Appendix C** in the report **Morrison Court Development Wastewater Servicing Study**, dated January 26, 2009. The Novatech study used GIS data provided by the City to model the existing sewer network. This study found that under existing conditions, the minimum freeboard between the

hydraulic grade line (HGL) and the lowest connected underside of footing (USF) elevation was **0.33 m**.

To support this study, J.F. Sabourin and Associates (JFSA) was retained by Greatwise to re-create the Novatech model of the Morrison Drive sanitary sewer under both existing and proposed Phase 1 and Phase 2 conditions. JFSA recreated the Novatech model using XPSWMM, while Novatech had previously used H2OMAP Sewer/Pro. It was, therefore, anticipated that JFSA would arrive at slightly different results than Novatech when modelling the same system. In the JFSA model it was found that the minimum freeboard was **0.37 m**.

To verify existing sanitary pipe inverts and sizes, Stantec Geomatics Ltd. (Stantec) was retained by Greatwise to conduct a field survey along the Morrison Drive sewer. Several differences were present between the existing conditions data provided by Novatech and the survey performed by Stantec. When the surveyed data was input into the model it was found that the minimum freeboard was **0.48 m**.

In proposed Phase 1 and Phase 2 scenarios, it was found that the minimum freeboard between the HGL and the lowest connected USF was **0.44 m**. This is greater than the City of Ottawa's minimum allowable value of 0.30 m. An email report from JFSA, as well as, detailed modeling information is provided in **Appendix C**.

Based on the previous HGL assessment and the email from JFSA dated January 21, 2013, included in the **Appendix C**, an available capacity of **8.0 L/s** was identified. As a result, no changes to the downstream sanitary network are required at this time. As indicated by **Table 6**, and the sanitary calculation sheet included in **Appendix C**, there is sufficient capacity to support both the proposed development at 2795 Baseline Road and the existing development at 2781 Baseline Road.

4.4 Wastewater Servicing Conclusions

The site is tributary to the Pinecrest Trunk Collector sewer; based on the sanitary analysis provided by JFSA, sufficient capacity is available to accommodate the estimated **5.67 L/s** peak wet weather flow from the proposed developments at 2710 Draper Avenue, the proposed development at 2795 Baseline Road, and the existing development at 2781 Baseline Road.

The proposed wastewater design conforms to all relevant **City Standards**.

5.0 STORMWATER MANAGEMENT

5.1 Existing Stormwater Services

Stormwater runoff from the subject property is tributary to the City of Ottawa sewer system and is located within the Ottawa Central sub-watershed. As such, approvals for proposed development within this area are under the approval authority of the City of Ottawa.

Flows that influence the watershed in which the subject property is located are further reviewed by the principal authority. The subject property is located within the Ottawa River watershed and is therefore subject to review by the Rideau Valley Conservation Authority (RVCA).

In the existing condition, stormwater runoff from the subject site and from the adjacent property (2781 Baseline Road) are collected by the temporary stormwater management pond within the subject site. Stormwater then outlets to the existing 300 mm diameter storm sewer located within the subject site, tributary to the existing 300 mm diameter storm sewer within the Morrison Drive right-of-way.

5.2 Post-development Stormwater Management Target

Stormwater management requirements for the proposed development were established using the City of Ottawa standards, where the proposed development is required to:

- Meet an allowable release rate based on a Rational Method Coefficient of 0.50, employing the City of Ottawa IDF parameters for a 2-year storm with a calculated time of concentration greater than or equal to 10 minutes;
- Attenuate all storms up to and including the City of Ottawa 100-year design event on site; and
- Provide quality controls to an enhanced level of treatment due to the site's distance from the outlet and the current Site Plan; correspondence with the RVCA is included in **Appendix A**.

Based on the above, the allowable release rate for the proposed development is **88.0 L/s**.

5.3 EPASWMM Stormwater Analysis

5.3.1 Model Selection

The hydrology and hydraulics of the proposed stormwater management system were analyzed in EPASWMM using the Dynamic Wave Routing Model. This method best analyzes stormwater systems with respect to pressure flow and backwater impacts.

A model schematic and output files are included in **Appendix D**.

5.3.2 Model Assumptions

The following assumptions were made in the preparation for the EPASWMM model:

- Hydrology
 - Initial abstraction parameters per City of Ottawa standards.
 - Horton’s infiltration for soil loss, per City guidelines.
 - Estimated % impervious area assuming limited vegetation / effective perviousness.
 - Sub-catchment width measured as perpendicular area to catch basins for longest distance of travel.
- Hydraulics
 - Storage Nodes represent both surface and subsurface components. Each node is assigned an invert elevation that corresponds with the tributary catch basin.
 - “Regular” Node represent either connections to the sewer main or strategic maintenance hole locations. Not all structures have been included in model.
 - All conduits have been assigned a Mannings n = 0.013.
 - Orifices are all side mounted circular and have a 0.61 discharge coefficient.

Table 13 summarizes the storage volumes within each subcatchment. Brentwood sizing calculation sheets included in **Appendix D**.

**Table 8
 Available Subcatchment Storage Volumes**

Catchment ID	Outlet	Above Ground Storage (m ³)	Underground Storage (m ³)
A1-2,EX-1	CICBMH105	-	256.0

Table 14 summarizes the assumptions made for the EPASWMM model.

**Table 9
 Drainage Area Summary**

Catchment ID	Outlet	Total Area (ha)	Percent Impervious (%)	Width (m)	Percent Slope (%)
A1-2,EX-1	UG1	0.755	89	76	1.5
U1	-	0.082	48	76	2.0

5.4 Proposed Minor Stormwater Management System

To meet the stormwater objectives the proposed development will utilize subsurface storage.

It is proposed that the stormwater outlet from the proposed development will be to the existing 300 mm diameter storm sewer within the subject site, tributary to the existing 300 mm diameter storm sewer within the Morrison Drive right-of-way.

The proposed stormwater management system will include private catch basins, an internal storm sewer network, and an underground storage unit to achieve the target release rates. Townhomes will have independent connections to the internal storm sewer network via 100 mm diameter service laterals.

Existing storm structures, EX STM 1 & EX STM 2, are proposed to be relocated to accommodate the site plan. Additionally, the existing SWM pond is to be removed and replaced by the proposed onsite stormwater management system. Required measures will be taken by the contractor to ensure the drainage of the 2781 Baseline Road development is maintained. Refer to drawing **SSP-1**, accompanying this report, for detailed servicing layout.

Areas A1, A2, and EX1, as shown by drawing **SWM-1**, accompanying this report, are tributary to the internal storm sewer network, tributary to the Morrison Drive storm sewer. Brentwood ST-36 storage systems or an approved equivalent will provide **256.0 m³** of underground storage which will be attenuated by a **146 mm Plug Style ICD** at the outlet side of storm maintenance structure **CBMH105**.

Based on coordination with the manufacturer, **four** observation ports will be required over the system in order to provide regular maintenance. Stormwater management system to be inspected every 6 months and cleaned annually. Cleaning to be performed by connecting a 10" riser pipe to an observation port allowing a vacuum truck to clean the bottom of the tank.

Table 10
Summary of Storm Structure ICD

Structure ID	ICD Size (mm)	Style	Design Head (m)	Design Flow (100-year) (L/s)
CICBMH105	146	PLUG	1.8	63.3

To meet stormwater quality criteria specified by the RVCA, an oil/grit separator will be installed downstream of all catch basins, as shown by drawing **SSP-1**, accompanying this report. Based on Aqua-Swirl sizing, an **Aqua-Swirl AS-3** will provide an enhanced level of quality control (80% TSS removal) in accordance with the RVCA requirement. Stormceptor sizing has been included in **Appendix D**.

Table 11, below, summarizes each sub-catchment. **Appendix D** contains a detailed outline of available storage and inlet controls.

Table 11
Drainage Area Storage Volume Analysis 100-Year 6-Hour Storm

Catchment ID	Structure ID	Required Volume (1000 m ³)	Available Percent Full (%)	Maximum Outflow (L/s)
A1-2, EX-1	UG1	0.256	100	60.73

Table 12, below, summarizes the results of the EPASWMM model at the outfall. Model input and output summary is included in **Appendix D**.

Table 12
Summary of Storage and Peak Flow Rates for the 5 and 100-Year Storm Distribution

Outfall Node	5-Year (L/s)	100-Year (L/s)
System (Uncontrolled & Attenuated)	15.32	88.0

A model schematic and output files are included in **Appendix D**.

Table 13 summarizes the relevant **City Standards** employed in the design of the proposed storm sewer system referred to as the minor system.

Table 13
Storm Sewer Design Criteria

Design Parameter	Value
Intensity Duration Frequency Curve (IDF) 5-year storm event. A = 998.071 B = 6.053 C = 0.814	$i = \frac{A}{(t_c + B)^C}$
Minimum Time of Concentration	10 minutes
Rational Method	$Q = CiA$
Runoff coefficient for paved and roof areas	0.9
Runoff coefficient for landscaped areas	0.2
Storm sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} AR^{2/3} S^{1/2}$
Minimum Sewer Size	250 mm diameter
Minimum Manning's 'n'	0.013
Service Lateral Size	100 mm dia PVC SDR 28 with a minimum slope of 1.0%
Minimum Depth of Cover	2.0 m from crown of sewer to grade
Minimum Full Flowing Velocity	0.8 m/s
Maximum Full Flowing Velocity	3.0 m/s
Additional Considerations	Storm sewer maintenance holes serving sewers 900 mm diameter and less shall be constructed with 300 mm deep sumps. Maintenance holes for storm sewers greater than 900 mm must be benched.
<i>Extracted from Sections 5 and 6 of the City of Ottawa Sewer Design Guidelines, November 2004.</i>	

5.5 Proposed Major System Flow

During storms in excess of the 100-year event or if catch basins/manholes become blocked, stormwater runoff will spill towards the private right-of-ways. Stormwater from private right-of-ways will flow overland towards the municipal infrastructure within the Morrison Drive right-of-way and ultimately to Graham Creek, approximately 1.5 km downstream.

5.6 Stormwater Servicing Conclusions

Post development stormwater runoff will be required to be restricted to the allowable target release rate for storm events up to and including the 100-year storm in accordance with City of Ottawa **City Standards**. The post-development allowable release rate was calculated as **88.0 L/s** based on consultation with the City of Ottawa; **256 m³** of underground storage will be provided to meet this release rate.

Based on consultation with the RVCA, stormwater quality controls to an enhanced level of treatment are required and will be provided by an **Aqua-Swirl AS-3** oil/grit separator or an approved equivalent.

During storms in excess of the 100-year event or if catch basins/manholes become blocked, stormwater runoff will spill towards the private right-of-ways. Stormwater from private right-of-ways will flow overland towards the municipal infrastructure within the Morrison Drive right-of-way and ultimately to Graham Creek, approximately 1.5 km downstream.

The proposed stormwater design conforms to all relevant **City Standards** and Policies for approval.

6.0 UTILITIES

Utility servicing will be coordinated with the individual utility companies prior to site development.

7.0 EROSION AND SEDIMENT CONTROL

Soil erosion occurs naturally and is a function of soil type, climate and topography. The extent of erosion losses is exaggerated during construction where vegetation has been removed and the top layer of soil becomes agitated.

Prior to topsoil stripping, earthworks or underground construction, erosion and sediment controls will be implemented and will be maintained throughout construction.

Silt fence will be installed around the perimeter of the site and will be cleaned and maintained throughout construction. Silt fence will remain in place until the working areas have been stabilized and re-vegetated.

Catch basins will have SILTSACKS or an approved equivalent installed under the grate during construction to protect from silt entering the storm sewer system.

A mud mat will be installed at the construction access in order to prevent mud tracking onto adjacent roads.

Erosion and sediment controls must be in place during construction. The following recommendations to the contractor will be included in contract documents:

- Limit extent of exposed soils at any given time;
- Re-vegetate exposed areas as soon as possible;
- Minimize the area to be cleared and grubbed;
- Protect exposed slopes with plastic or synthetic mulches;
- Install silt fence to prevent sediment from entering existing ditches;
- No refueling or cleaning of equipment near existing watercourses;
- Provide sediment traps and basins during dewatering;
- Install filter cloth between catch basins and frames;
- Plan construction at proper time to avoid flooding; and
- Establish material stockpiles away from watercourses, so that barriers and filters may be installed.

The contractor will, at every rainfall, complete inspections and guarantee proper performance. The inspection is to include:

- Verification that water is not flowing under silt barriers; and
- Clean and change filter cloth at catch basins.

8.0 CONCLUSION AND RECOMMENDATIONS

David Schaeffer Engineering Ltd. (DSEL) has been retained by Greatwise Developments to prepare a Servicing and Stormwater Management report in support of the application for a Part Lot Control (PLC) and a Site Plan Control (SPC) for the Fresh Towns Phase 2 development at 2795 Baseline Road. The preceding report outlines the following:

- The watermain boundary conditions have been requested from the City of Ottawa, however, they were unavailable at the time of this publication;
- Based on boundary conditions provided by the City for the development at 2710 Draper Avenue, the existing municipal water infrastructure is capable of providing the proposed development with water within the City's required pressure range;
- City of Ottawa Technical Bulletin ISTB-2018-02 indicated that the required fire flow for the development is **12,000 L/min**. Based on the hydraulic model, there are a sufficient number of local and proposed fire hydrants to service the development;
- The proposed ultimate development, within 2710 Draper Avenue and 2781 & 2795 Baseline Road, is estimated to have a peak wet weather flow of **5.67 L/s**; Based on the sanitary analysis prepared by JFSA, the existing municipal sewer infrastructure has sufficient capacity to support the development;
- Based on consultation with the City of Ottawa, the proposed development will be required to attenuate post development flows to an equivalent release rate of **88.0 L/s** for all storms up to and including the 100-year storm event;
- Stormwater objectives will be met through storm water retention via subsurface storage, **256.0 m³** of underground storage will be provided to attenuate flow to the established release rate above; and
- Based on consultation with the RVCA, stormwater quality controls to an enhanced level of treatment are required. An Aqua-Swirl AS-3 oil/grit separator will be installed downstream of the stormwater control in order to meet this requirement.

Prepared by,
David Schaeffer Engineering Ltd.

Reviewed by,
David Schaeffer Engineering Ltd.



Per: Alison J. Gosling, EIT.



Per: Adam D. Fobert, P. Eng.

APPENDIX A

Pre-Consultation

DEVELOPMENT SERVICING STUDY CHECKLIST

18-1055

15/01/2019

4.1 General Content		
<input type="checkbox"/>	Executive Summary (for larger reports only).	N/A
<input checked="" type="checkbox"/>	Date and revision number of the report.	Report Cover Sheet
<input checked="" type="checkbox"/>	Location map and plan showing municipal address, boundary, and layout of proposed development.	Drawings/Figures
<input checked="" type="checkbox"/>	Plan showing the site and location of all existing services.	Figure 1, EX-1
<input checked="" type="checkbox"/>	Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.	Section 1.0
<input checked="" type="checkbox"/>	Summary of Pre-consultation Meetings with City and other approval agencies.	Section 1.3
<input checked="" type="checkbox"/>	Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.	Section 2.1
<input checked="" type="checkbox"/>	Statement of objectives and servicing criteria.	Section 1.0
<input checked="" type="checkbox"/>	Identification of existing and proposed infrastructure available in the immediate area.	Sections 3.1, 4.1, 5.1, EX-1
<input type="checkbox"/>	Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).	N/A
<input checked="" type="checkbox"/>	Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.	GP-1
<input type="checkbox"/>	Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.	N/A
<input type="checkbox"/>	Proposed phasing of the development, if applicable.	N/A
<input checked="" type="checkbox"/>	Reference to geotechnical studies and recommendations concerning servicing.	Section 2.1
<input checked="" type="checkbox"/>	All preliminary and formal site plan submissions should have the following information: -Metric scale -North arrow (including construction North) -Key plan -Name and contact information of applicant and property owner -Property limits including bearings and dimensions -Existing and proposed structures and parking areas -Easements, road widening and rights-of-way -Adjacent street names	SP-1
4.2 Development Servicing Report: Water		
<input type="checkbox"/>	Confirm consistency with Master Servicing Study, if available	N/A
<input checked="" type="checkbox"/>	Availability of public infrastructure to service proposed development	Section 3.1
<input checked="" type="checkbox"/>	Identification of system constraints	Section 3.1
<input checked="" type="checkbox"/>	Identify boundary conditions	Section 3.1, 3.2
<input checked="" type="checkbox"/>	Confirmation of adequate domestic supply and pressure	Section 3.3, Appendix B

<input checked="" type="checkbox"/>	Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.	Section 3.2
<input type="checkbox"/>	Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	N/A
<input type="checkbox"/>	Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design	N/A
<input type="checkbox"/>	Address reliability requirements such as appropriate location of shut-off valves	N/A
<input type="checkbox"/>	Check on the necessity of a pressure zone boundary modification	N/A
<input checked="" type="checkbox"/>	Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range	Section 3.2, 3.3
<input checked="" type="checkbox"/>	Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.	SSP-1
<input type="checkbox"/>	Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	N/A
<input checked="" type="checkbox"/>	Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Section 3.2, Appendix B
<input type="checkbox"/>	Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	N/A

4.3 Development Servicing Report: Wastewater

<input checked="" type="checkbox"/>	Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	Section 4.2
<input type="checkbox"/>	Confirm consistency with Master Servicing Study and/or justifications for deviations.	N/A
<input type="checkbox"/>	Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	N/A
<input checked="" type="checkbox"/>	Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Section 4.1
<input checked="" type="checkbox"/>	Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)	Section 4.2
<input checked="" type="checkbox"/>	Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.	Section 4.2, Appendix C
<input checked="" type="checkbox"/>	Description of proposed sewer network including sewers, pumping stations, and forcemains.	Section 4.2
<input type="checkbox"/>	Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	N/A

<input type="checkbox"/>	Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	N/A
<input type="checkbox"/>	Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	N/A
<input type="checkbox"/>	Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	N/A
<input type="checkbox"/>	Special considerations such as contamination, corrosive environment etc.	N/A

4.4 Development Servicing Report: Stormwater Checklist

<input checked="" type="checkbox"/>	Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)	Section 5.1
<input checked="" type="checkbox"/>	Analysis of available capacity in existing public infrastructure.	Section 5.1, Appendix D
<input checked="" type="checkbox"/>	A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	Drawings/Figures
<input checked="" type="checkbox"/>	Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected sub-watersheds, taking into account long-term cumulative effects.	Section 5.2
<input checked="" type="checkbox"/>	Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Section 5.2, 5.3
<input checked="" type="checkbox"/>	Description of the stormwater management concept with facility locations and descriptions with references and supporting information	Section 5.3
<input type="checkbox"/>	Set-back from private sewage disposal systems.	N/A
<input type="checkbox"/>	Watercourse and hazard lands setbacks.	N/A
<input checked="" type="checkbox"/>	Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	Appendix A
<input type="checkbox"/>	Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.	N/A
<input checked="" type="checkbox"/>	Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).	Section 5.2, 5.3
<input type="checkbox"/>	Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	N/A
<input checked="" type="checkbox"/>	Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Section 5.1, 5.3
<input type="checkbox"/>	Any proposed diversion of drainage catchment areas from one outlet to another.	N/A
<input type="checkbox"/>	Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	N/A
<input type="checkbox"/>	If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.	N/A
<input type="checkbox"/>	Identification of potential impacts to receiving watercourses	N/A
<input type="checkbox"/>	Identification of municipal drains and related approval requirements.	N/A

<input checked="" type="checkbox"/>	Descriptions of how the conveyance and storage capacity will be achieved for the development.	Section 5.3
<input type="checkbox"/>	100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	N/A
<input type="checkbox"/>	Inclusion of hydraulic analysis including hydraulic grade line elevations.	N/A
<input checked="" type="checkbox"/>	Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	Section 7.0
<input type="checkbox"/>	Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	N/A
<input type="checkbox"/>	Identification of fill constraints related to floodplain and geotechnical investigation.	N/A

4.5 Approval and Permit Requirements: Checklist

<input checked="" type="checkbox"/>	Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement ct. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.	Section 1.2
<input type="checkbox"/>	Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.	N/A
<input type="checkbox"/>	Changes to Municipal Drains.	N/A
<input type="checkbox"/>	Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)	N/A

4.6 Conclusion Checklist

<input checked="" type="checkbox"/>	Clearly stated conclusions and recommendations	Section 8.0
<input type="checkbox"/>	Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.	
<input type="checkbox"/>	All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario	

Alison Gosling

From: Lloyd Phillips <lloyd@lloydphillips.com>
Sent: Monday, November 26, 2018 11:36 AM
To: Greatwise; Zaf Kelekvan; amatti@castleglenn.ca; Jessica@lloydphillips.com; Robert Freel; Alison Gosling; Rlevstek@Larocquelevstek. Com; Debbie.Bellinger@nelligan.ca
Subject: Fwd: Pre-Consultation Follow-up - 2795 Baseline

Follow Up Flag: Follow up
Flag Status: Flagged

FYI

Sent from my iPhone

Begin forwarded message:

From: "Marsh, Amanda" <Amanda.Marsh@ottawa.ca>
Date: November 23, 2018 at 4:16:20 PM EST
To: Lloyd Phillips <lloyd@lloydphillips.com>
Cc: Jessica D'Aoust <jessica@lloydphillips.com>, "Fraser, Mark" <Mark.Fraser@ottawa.ca>, "Baggs, Rosanna" <Rosanna.Baggs@ottawa.ca>, "Young, Mark" <Mark.Young@ottawa.ca>
Subject: RE: Pre-Consultation Follow-up - 2795 Baseline

Hi Lloyd,

Apologies for the delay in my email. As a follow-up to our meeting on November 14, please find below the comments discussed and additional information on the potential development at 2795 Baseline.

- With respect to the two entrance options, please review the intake for the garage and existing light standard. Both of these elements are located within the existing sidewalk with the light standard impeding the path of travel. Review options to remove these elements, that were not approved in the current location, from the sidewalk through this phase of development.
- Review the noise requirements early for the units proposed. The installation of a noise wall is not desired along the Baseline streetscape. This area should be well treated with landscaping and complement the existing condo development.
 - Landscaping that is low-maintenance is recommended as the units are intended to be freehold with Owners ultimately being responsible for the maintenance.
- Sign-off from the existing condominium will be required for any application for approval which includes any part of their lands. The existing built conditions did not form part of any past approvals and needs to be included/addressed within the application.
- Please review and confirm the visitor parking requirements.
- A new TIA and noise study are required for the site plan submission for this phase.
- This phase of development includes the requirement for a bus pad and shelter within the Morrison right of way. The depth of the shelter area is 2.2 metres with an additional offset of 0.5m from the property line. The width of the sidewalk may have to be reduced (1.8m min) in order to accommodate the shelter.
- Please ensure the details for the Morrison Drive right of way reflect the existing conditions unless modifications are required/proposed as part of this development phase. The plans provided show a proposed auxiliary left turn lane and the associated pavement markings for such.

- Information regarding the Baseline BRT project can be found [here](#). Jabbar Siddique as the contact person for this project and would be able to speak to any further details regarding the status/plans for the project.
- Mark Fraser met with Bobby from DSEL to discuss this project on November 15th. Mark further provided the comments/notes from the previous pre-consultation for Bobby.
- Emails were sent to Fire Services but no formal response has been received as of yet. The Fire Protection Engineer was reviewing the site plan details this week and any comments received will be forward. A follow-up email will be sent to Fire Services next week to try and get the comments.

If you have any questions, please let me know.

Best,
Amanda

Amanda Marsh

Planner
Development Review
Planning, Infrastructure and Economic Development
110 Laurier Ave West, Ottawa, ON K1P 1J1
Tel: 613-580-2424 ext. 13409
Fax: 613-560-6006

From: Marsh, Amanda
Sent: Tuesday, September 04, 2018 4:52 PM
To: Jessica@lloydphillips.com
Cc: 'Lloyd Phillips' <lloyd@lloydphillips.com>; Fraser, Mark <Mark.Fraser@ottawa.ca>; Baggs, Rosanna <Rosanna.Baggs@ottawa.ca>
Subject: Pre-Consultation Follow-up - 2795 Baseline

Hi Jessica,

Apologies for the delay in getting this to you. As a follow up to our pre-consultation meeting on August 21, 2018 for 2795 Baseline Road, please find attached the required plans and studies list for the revised development of townhomes. Please refer to the City's [guide](#) to preparing studies and plans. I have included below items that were discussed during this meeting and follow-up comments on the proposed development.

Policies/Designations of the Site

- Official Plan Designation – [General Urban Area](#) (Section 3.6.1)
- Zoning – R5A[1700] S247, S282 – Residential Fifth Density Subzone A, Exception 1700 and subject to schedules 247 and 282.
- Parking is to be provided at the rates specified for Area C per Schedule 1A.
- Baseline is a designated arterial road and Morrison Drive is designated a collector.
- Please refer to the City's Design and Planning [Guidelines](#)

Planning Comments

- As discussed, there is an existing site plan control application for the subject lands which sought, primarily, a revision to the height of the previously approved apartment building. This application has been on hold since January of 2016. The options for moving forward with the current revised plans are the below:
 - Keeping the current application open and submitting all new materials requested with an associated re-circulation fee of \$3,250.00.

- Cancelling the previous application and filing a new application which would be Revision – Manager Approval – Public Consultation. The cancelling of the current application would be eligible for a refund of 33.3% of the planning component of the application fee and 100% of the legal component of the application fee. It's tough to confirm the exact number based on the info I have access to but it appears the fees were around \$19,000 with \$1000-\$1100 being legal fees.
- Confirmation of as-built conditions and amendments to the existing 2785 Baseline lands is to be provided. It was unclear from a review of past applications how the current (temporary) condition of the access was created and, from our meeting, it was indicated there were ongoing discussions with the existing condominium.
- Please ensure the site plan clearly delineates the limits of the existing underground parking structure for the condominium at 2785 Baseline.
- Please refer to comments provided throughout the review of the 2710 Draper site plan as the proposed incorporates the same unit types and private streets.
- Parkland requirements will be confirmed through the site plan process.

Urban Design Comments (Mark Young)

- The baseline frontage needs further consideration.
- Alternatives to the glazing within the garages needs to be explored.
 - Are there opportunities with the grades to allow for, as a first example, raised yards/terraces with access to the second floor via a staircase? See attached image.
- At a minimum the landscaping must be well executed.

Infrastructure Comments (Mark Fraser)

General:

- Please note that the same level of detail and analysis requested for Site Plan Control application D07-12-17-0076_2710 Draper Ave. will be required for this development proposal. This is essentially a smaller version of the noted file. It is suggested to review comments made for the noted application as similar comments will apply for this proposal.
- A Direct Submission Private Sewage Works ECA application to the Ministry will be required as the proposal is not expected to meet the exceptions set out in O. Reg. 525-98: *Approval Exceptions* under the Ontario Water Resources Act (OWRA). Based on discussion with DSEL the stormwater management and servicing strategy will be designed to service more than one parcel of land and therefore the approval exemptions under O.Reg. 525/98 would not apply and an Environmental Compliance Approval (ECA) will be required to be obtained prior to the City issuing a Commence Work Notification authorizing any site works to commence.

Ontario Regulation 525/98:

3. Subsection 53(1) and (3) of the Act do not apply to the use, operation, establishment, alteration, extension or replacement of or a change in a storm water management facility that,

(a) is designed to service one lot or parcel of land;

(b) discharges into a storm sewer that is not a combined sewer;

(c) does not service industrial land or a structure located on industrial land; and

(d) is not located on industrial land.

- Any portion of the subject property which is intended to be used for permanent or temporary snow storage shall be as shown on the Site Plan and Grading Plan. Snow storage shall not interfere with approved grading and drainage patterns or servicing. Snow storage areas shall be setback from the property lines, foundations, fencing or landscaping a minimum of 1.5m. Snow storage areas shall not occupy driveways, aisles, required parking spaces or any portion of a road allowance.
- Morrison Drive was recently resurfaced by the City. A road cut moratorium will be in effect. The full width of the road and entire frontage of the property will need to be resurfaced by the developer.

- Please provide an **Existing Conditions and Removal Plan**.
- **Existing conditions shall be well documented** on a plan, in the body of the report and excerpts from the CCC 994 Lands [Building E] approval shall be included in the Appendix of the report as supporting documentation.
- Please provide a **Composite Utility Plan (CUP)**.
- **Plan and Profile drawings** are required.
- Provide a cross-section detail of the private road(s).
- Provide **Pre-Development and Post-Development Drainage Area Plans**.
- **Servicing shall be contained within the site and shall operate independent from the adjacent condominiums unless any previous approval demonstrated otherwise.**
- Servicing and site works shall be in accordance with the following documents:
 - Ottawa Sewer Design Guidelines (October 2012)
 - Technical Bulletin PIETB-2016-01
 - Technical Bulletins ISTB-2018-01, ISTB-2018-02 and ISTB-2018-03.
 - Ottawa Design Guidelines – Water Distribution (2010)
 - Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (2007)
 - City of Ottawa Accessibility Design Standards (2012)
 - Ottawa Standard Tender Documents (latest version)
 - Ontario Provincial Standards for Roads & Public Works (2013)

It is suggest to review these documents prior to submission to confirm compliance.



Disclaimer:

The City of Ottawa does not guarantee the accuracy or completeness of the data and information contained on the above image(s) and does not assume any responsibility or liability with respect to any damage or loss arising from the use or interpretation of the image(s) provided. This image is for schematic purposes only.

Stormwater Management Criteria:

- In the absence of area specific SWM criteria control post-development runoff from the subject site, up to and including the 100-year storm event, to a pre-development **2-year allowable release rate** calculated using an allowable runoff coefficient (C) determined using the smaller of a runoff coefficient of 0.5 or the actual pre-development existing site runoff coefficient (Cl.8.3.7.3) [If 0.5 applies it needs to be clearly documented in the report that the pre-development runoff coefficient is greater than 0.5], and a calculated time of concentration (T_c) using an appropriate method to justify the parameter selection (*T_c of 20 minutes should be used for all pre-development calculations without engineering justification; T_c of 10 minutes shall be used for all post-development calculations*). The existing site condition shall be documented (historical aerial photos) to justify the selection of a pre-development runoff coefficient.

- Based on the install year of **1962** the storm sewer on Morrison Drive was only designed to a 2-year level of service not a 5-year level of service
- Flows in excess of the 2-year release rate, up to and including the 100-year storm event are to be detained on site.
- In the design of this private subdivision consideration shall be given to future infrastructure maintenance requirements and the associated financial costs. Design solutions should recognize that the future owners will assume the costs.
- As stormwater treatment is not addressed offsite onsite water quality measures are required. An enhanced level of quality control (**80% TSS removal**) in accordance with RVCA requirements shall be achieved.
- As per *Technical Bulletin PIEDTB-2016-01 section 8.3.11.1 (p.12 of 14)* **there shall be no surface ponding on private parking areas during the 2-year storm rainfall event.** Depending on the SWM strategy proposed underground or additional underground storage may be required to satisfy this requirement. Underground storage shall be contained within a separate block of land and shall not encroach onto any freehold lots to be created through a future Part Lot Control application.
- When using the modified rational method to calculate the storage requirements for the site any underground storage (pipe storage etc.) should not be included in the overall available storage. The modified rational method assumes that the restricted flow rate is constant throughout the storm which underestimates the storage requirement prior to the 1:100 year head elevation being reached. Please note that if you wish to utilize any underground storage as available storage, the $Q_{(release)}$ must be modified to compensate for the lack of head on the orifice. An assumed average release rate equal to 50% of the peak allowable rate shall be applied. Otherwise, disregard the underground storage as available storage or provide modeling to support SWM strategy.
- Please note that the minimum orifice dia. for a plug style ICD is 83mm and the minimum flow rate from a vortex ICD is 6 L/s in order to reduce the likelihood of plugging.

Storm Sewer:

- The existing 300mm dia. private storm sewer shall be utilized as an outlet. This sewer will require an ECA if both the CCC 994 Lands [Building E] and the subject site are using this sewer as an outlet.

Sanitary Sewer:

- The existing 200mm dia. private sanitary sewer shall be utilized as an outlet. This sewer will require an ECA if both the CCC 994 Lands [Building E] and the subject site are using this sewer as an outlet.
- Analysis and demonstration that there is sufficient/adequate residual capacity to accommodate the wastewater flows in the receiving and downstream wastewater system is required to be provided.
- Please review the wastewater design flow parameters in *Technical Bulletin PIEDTB-2018-01*.

Water:

- A 200mm dia. watermain is located in Morrison Drive.
- A connection to the 1220mm dia. backbone watermain in Baseline Road is not permitted.
- A minimum of two services shall be provided to avoid a vulnerable serviced site. The private watermain shall be looped. A dead-end configuration will not be supported.
- Provide a cross-section showing any proposed water service crossing the 1220mm dia. backbone watermain. Any service shall cross over the backbone watermain and a minimum of 0.5m of clearance achieved. Any mechanical excavation within 3m of the centerline of the 1220mm dia. backbone watermain is prohibited until the exact location is identified in the field. This shall be noted on the plans.
- A District Metering Area (DMA) Chamber is required to be installed as per City of Ottawa standard drawing W3 (watermains up to 300mm dia.). As per *Ottawa Design Guidelines Water Distribution*

WDG001 July 2010, City of Ottawa, Clause 4.4.7.2. the proposed DMA Chamber(s) shall include a standard isolation valve and two 50mm dia. standard nozzles, one tapped on each side of the valve, and installed as close to the property line as possible so the isolation valve can serve as the curb stop for the property. The DMA chamber shall be installed on the larger connection.

- Please provide the following information to the City of Ottawa via email to request water distribution network boundary conditions for the subject site. Please note that once this information has been provided to the City of Ottawa it takes approximately 5-10 business days to receive boundary conditions.
 - Type of Development
 - Site Address
 - A plan showing the proposed water service connection location.
 - **Average Daily Demand** (L/s)
 - **Maximum Daily Demand** (L/s)
 - **Peak Hour Demand** (L/s)
 - **Fire Flow** (L/min)
[Fire flow demand requirements shall be based on Fire Underwriters Survey (FUS) Water Supply for Public Fire Protection 1999]

Exterior Site Lighting:

- Please note that any proposed light fixtures (both pole-mounted and wall mounted) must be part of the approved Site Plan. All external light fixtures must meet the criteria for Full Cut-off Classification as recognized by the Illuminating Engineering Society of North America (IESNA or IES), and must result in minimal light spillage onto adjacent properties (as a guideline, 0.5 fc is normally the maximum allowable spillage). In order to satisfy these criteria, the please provide the City with a **Site Lighting Plan, Photometric Plan and Certification (Statement) Letter** from an acceptable professional engineer stating that the design is compliant.

Permits and Approvals:

- The consultant shall determine if this project will be subject to an Environmental Compliance Approval (ECA) for Private Sewage Works. It shall be determined if the exemptions set out under Ontario Regulation 525/98: *Approval Exemptions* are satisfied.
- A **Private Sewage Works ECA** will be required to be obtained for the subject development prior to Part Lot Control being lifted **if it is determined that the current development proposal falls within the exemptions set out in O.Reg. 525/98 under the OWRA**. If not an ECA will be required to be obtained prior to the issuance of a Commence Work Notification. This shall be determined and documented by DSEL and presented to the City for concurrence.
Please note that any **ECA application** to the Ministry will be a Direct Submission as the ToR Agreement states that the City cannot approve works for infrastructure that will not be owned by the City (ToR Agreement: P.3 Item 1). Direct Submission applications are subject to longer Ministry approval timelines.

Phase One Environmental Site Assessment

- A Phase 1 ESA is required to be completed in accordance with Ontario Regulation 153/04 in support of a development application to determine the potential for site contamination.
- As per the *Ministry of the Environment, Guide for Completing Phase One Environmental Site Assessments under Ontario Regulation 153/04, dated June 2011* the date the last work was done on the records review, interviews and site reconnaissance for a **Phase I Environmental Site Assessment (ESA) can be no more than 18 months old or an update is required.**

Geotechnical Report

- An **updated Geotechnical Investigation** report shall be prepared and specific to this development proposal. Submission of any previous Geotechnical Investigations will not be accepted and the application will be deemed incomplete.
- The geotechnical engineer of record shall review any underground storage proposal and provide confirmation via a sealed memorandum that the established seasonally high groundwater table depth elevation is a minimum 1m below the bottom of the proposed system as per MOE requirements.
- The geotechnical engineer of record shall review the proximity of the proposed slab on grade foundations to the adjacent Building E underground parking garage and provide recommendations to ensure the units are setback an appropriate distance. There is concern that in the event the adjacent site is redeveloped the foundations of the units could be undermined and compromised.

Please note that these comments are considered preliminary based on the information available to date and therefore maybe amended as additional details become available and presented to the City.

Transportation and Noise Comments (Rosanna Baggs)

- Follow Traffic Impact Assessment Guidelines – Traffic Impact Assessment will be required.
 - Start this process asap.
 - Applicant advised that their application will not be deemed complete until the submission of the draft step 1-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable).
- ROW protection on Baseline between Greenbelt boundary and Prince of Wales is 44.5m even.
- Noise Impact Studies required for the following:
 - Road
- Clear throat requirements for apartments that is <100 units on an arterial is 15m, 100-200 units on an arterial is 25m, and >200 units on an arterial is 40m.
- On site plan:
 - Show all details of the roads abutting the site up to and including the opposite curb; include such items as pavement markings, accesses and/or sidewalks.
 - Turning templates will be required for all accesses showing the largest vehicle to access the site; required for internal movements and at all access (entering and exiting and going in both directions).
 - Show all curb radii measurements; ensure that all curb radii are reduced as much as possible
 - Show lane/aisle widths.
 - Sidewalk is to be continuous across access as per City Specification 7.1.
 - Bus stop on Morrison will need to be installed as part of this application.
 - Keep driveways as far away from corners as possible (flip current layout of the last units)
 - Grey out any work that will not be part of this application.
 - Consideration should be given to pedestrian connectivity from within the site to Baseline.

Please note that these pre-consultation comments are valid for one year. If you submit a development application after this time, you may be required to meet for another pre-consultation meeting and/or the submission requirements may change.

Finally, prior to making a complete submission, it is encouraged that you discuss the proposal with the area Councillor and local community associations.

If you have any questions regarding the above, please don't hesitate to contact me.

Best,
Amanda

Amanda Marsh

Planner
Development Review
Planning, Infrastructure and Economic Development
110 Laurier Ave West, Ottawa, ON K1P 1J1
Tel: 613-580-2424 ext. 13409
Fax: 613-560-6006
,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

,

Alison Gosling

From: Jamie Batchelor <jamie.batchelor@rvca.ca>
Sent: Wednesday, October 18, 2017 11:49 AM
To: Alison Gosling
Subject: RE: 2710 Draper Avenue - RVCA

Hi Alison,

Thanks for providing the information and for the clarification on the stages. While there is no surface parking proposed in the traditional sense of a large parking lot, there are several driveways proposed which would be utilized for parking and the construction of new streets. Therefore the Conservation Authority would still advise the proponent that onsite water quality treatment of 80% TSS removal should be the water quality target for this site.

From: Alison Gosling [mailto:AGosling@dse.ca]
Sent: Wednesday, October 18, 2017 10:35 AM
To: Jamie Batchelor <jamie.batchelor@rvca.ca>
Subject: RE: 2710 Draper Avenue - RVCA

Good morning Jamie,

As discussed, phase III of the development includes 91 townhome units and a community park post-development, with no proposed surface parking. The subject site contains 84 townhome pre-development, with surface parking.

Stormwater in the post-development will be runoff from rooftops and landscaped areas. It is not proposed to have surface ponding within the private streets.

Please note that Phase III will be independently serviced and not connected to the services within Phase I and Phase II.

Can you provide an updated recommendation regarding quality controls?

Thank you,

Alison Gosling, E.I.T.
Project Coordinator / Junior Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.542
fax: (613) 836-7183
email: agosling@dse.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

From: Jamie Batchelor [<mailto:jamie.batchelor@rvca.ca>]
Sent: Wednesday, June 21, 2017 2:19 PM
To: Alison Gosling <AGosling@dsel.ca>
Subject: RE: 2710 Draper Avenue - RVCA

Good Afternoon Alison,

Given that the site outlets to an existing storm sewer approximately 1.5 km to Graham Creek and there is no municipal facility which provides water quality treatment for the Stormwater entering the watercourse, we would advise the proponent that onsite water quality treatment of 80% TSS removal should be the water quality target for this site.

From: Alison Gosling [<mailto:AGosling@dsel.ca>]
Sent: Thursday, June 15, 2017 9:53 AM
To: Jamie Batchelor <jamie.batchelor@rvca.ca>
Subject: 2710 Draper Avenue - RVCA


Good morning Jamie,

We wanted to touch base with you regarding a development we are working on located at 2710 Draper Avenue.

The stormwater collected from the site travels approximately 1.5 km to Graham Creek tributary to the Ottawa River.

The development proposes to construct a thirteen townhome blocks and a community park. The development will discharge stormwater to the existing 450 mm diameter storm sewer within Draper Avenue.

Can you provide a comment regarding quality controls that maybe required for the site

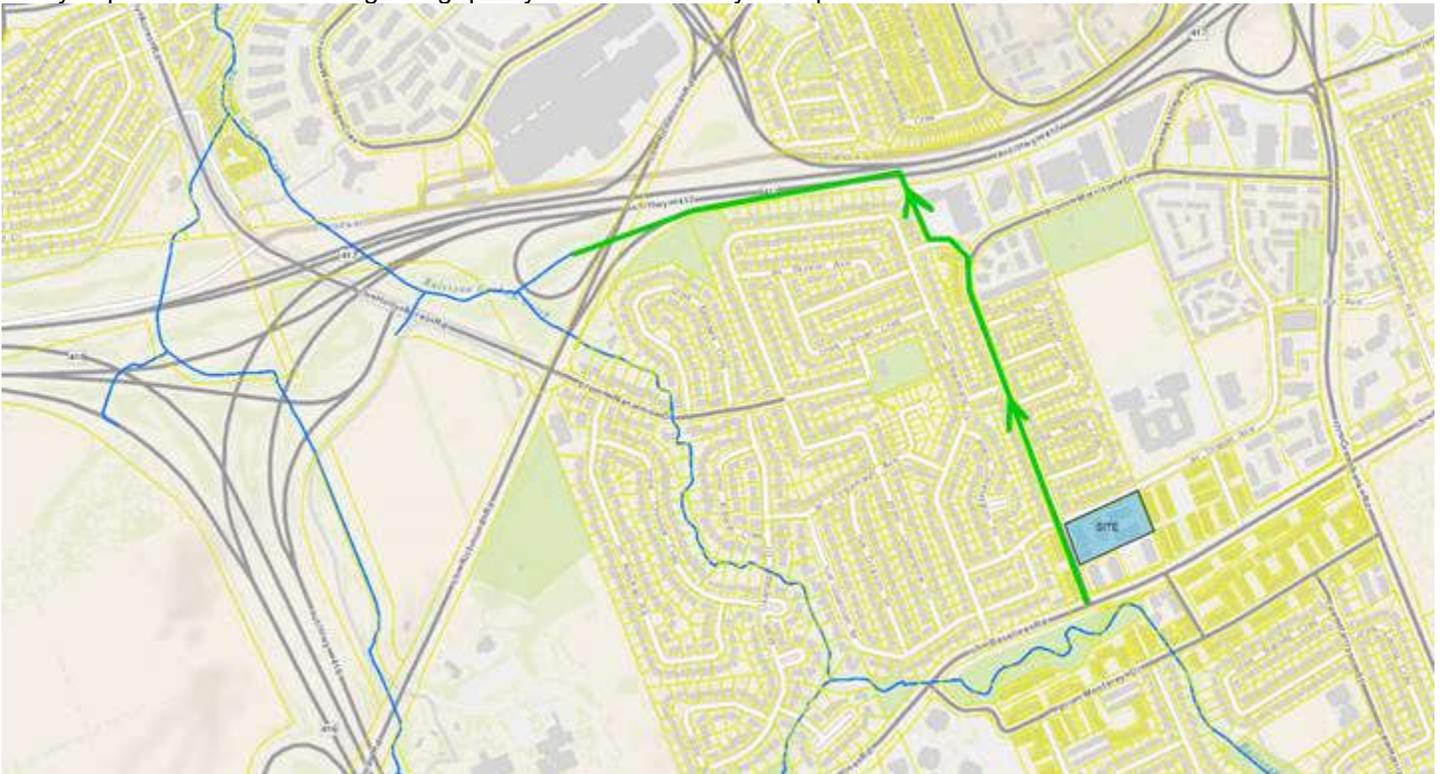

Thank you,

Alison Gosling, E.I.T.
Project Coordinator / Junior Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.542

fax: (613) 836-7183

email: agosling@DSEL.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

Alison Gosling

From: Alison Gosling
Sent: Tuesday, January 15, 2019 11:08 AM
To: 'MOECCOttawaSewage (MOECC)'
Cc: 'Diamond, Emily (MOECC)'
Subject: 18-1055 2795 Baseline Road

Good morning,

We wanted to touch base with you regarding a proposed development at 2795 Baseline Road.

The existing 0.42 ha site currently consists of a stormwater management pond, servicing the lands at 2781 Baseline Road and is zoned Residential. The development proposes to construct a 32 townhome units.

It appears that the existing stormwater management system currently directs flow towards the municipal infrastructure within Morrison Drive. Proposed stormwater controls will use subsurface storage to attenuate the release rate to City of Ottawa requirements and will service 2795 and 2781 Baseline Road. As the proposed sewage works will service multiple parcels of land, it is anticipated that the subject site does not qualify for an ECA exemption set out in Ontario Regulation 525/98 as part of the Ontario Water Resources Act.

I hope you could comment on our assumption that this property would be exempt from requiring an ECA. Please feel free to call to discuss further.

Thank you,

Alison Gosling, E.I.T.
Project Coordinator / Junior Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.542

fax: (613) 836-7183

email: agosling@dsel.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

APPENDIX B

Water Supply

Water Demand Design Flows per Unit Count
 City of Ottawa - Water Distribution Guidelines, July 2010



Domestic Demand

Type of Housing	Per / Unit	Units	Pop
Single Family	3.4		0
Semi-detached	2.7		0
Townhouse	2.7	32	87
Apartment			0
Bachelor	1.4		0
1 Bedroom	1.4		0
2 Bedroom	2.1		0
3 Bedroom	3.1		0
Average	1.8		0

	Pop	Avg. Daily		Max Day †		Peak Hour ††	
		m ³ /d	L/min	m ³ /d	L/min	m ³ /d	L/min
Total Domestic Demand	87	30.5	21.1	149.2	103.6	225.3	156.5

Total Demand	30.5	21.1	149.2	103.6	225.3	156.5
---------------------	-------------	-------------	--------------	--------------	--------------	--------------

Max Day Peaking Factor (Residential) † =

4.9

Peak Hour Peaking Factor (Residential)†† =

7.4



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min

Where **F** is the fire flow, **C** is the Type of construction and **A** is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 2039.7 m² Total floor area based on FUS Part II section 1

Fire Flow 9935.8 L/min
10000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 8500.0 L/min

3. Reduction for Sprinkler Protection

Non-Sprinklered 0%

Reduction 0 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Non-Combustible	20.1m-30m	62		3	186	10%
S Non-Combustible	10.1m-20m	62		3	186	15%
E Non-Combustible	20.1m-30m	15.5		3	47	8%
W Non-Combustible	30.1m-45m	15.5		1	16	5%
% Increase						38% value not to exceed 75%

Increase 3230.0 L/min

Lw = Length of the Exposed Wall (of the adjacent structure)
 Ha = number of storeys of the adjacent structure (maximum 5 stories)
 LH = Length-height factor of exposed wall. Value rounded up.
 EC = Exposure Charge

Total Fire Flow

Fire Flow 11730.0 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
12000.0 L/min rounded to the nearest 1,000 L/min

Notes:
 -Type of construction, Occupancy Type and Sprinkler Protection information provided by _____.
 -Calculations based on Fire Underwriters Survey - Part II



Fire Flow Estimation per Fire Underwriters Survey

Water Supply For Public Fire Protection - 1999

Fire Flow Required

1. Base Requirement

$$F = 220C\sqrt{A}$$

L/min

Where **F** is the fire flow, **C** is the Type of construction and **A** is the Total floor area

Type of Construction:

Ordinary Construction

C 1 Type of Construction Coefficient per FUS Part II, Section 1
A 1601.1 m² Total floor area based on FUS Part II section 1

Fire Flow 8802.9 L/min
9000.0 L/min rounded to the nearest 1,000 L/min

Adjustments

2. Reduction for Occupancy Type

Limited Combustible -15%

Fire Flow 7650.0 L/min

3. Reduction for Sprinkler Protection

Non-Sprinklered 0%

Reduction 0 L/min

4. Increase for Separation Distance

Cons. of Exposed Wall	S.D	Lw	Ha	LH	EC	
N Wood Frame	30.1m-45m	33.5		1	34	5%
S Non-Combustible	10.1m-20m	119		3	357	15%
E Non-Combustible	10.1m-20m	45		3	135	15%
W Non-Combustible	0m-3m	143		3	429	25%
% Increase						60% value not to exceed 75%

Increase 4590.0 L/min

Lw = Length of the Exposed Wall
 Ha = number of storeys of the adjacent structure (maximum 5 stories)
 LH = Length-height factor of exposed wall. Value rounded up.
 EC = Exposure Charge

Total Fire Flow

Fire Flow 12240.0 L/min fire flow not to exceed 45,000 L/min nor be less than 2,000 L/min per FUS Section 4
12000.0 L/min rounded to the nearest 1,000 L/min

Notes:
 -Type of construction, Occupancy Type and Sprinkler Protection information provided Roderick Lahey Architects.
 -Calculations based on Fire Underwriters Survey - Part II

Boundary Conditions Unit Conversion**Connection 1 (Morrison Drive - Northern Connection)**

	Height (m)	Elevation (m)	m H ₂ O	PSI	kPa
Avg. DD	115.5	75.7	39.8	56.7	390.6
Fire Flow	95.5	75.7	19.8	28.2	194.4
Peak Hour	105.9	75.7	30.2	43.0	296.5

Connection 2 (Morrison Drive - Southern Connection)

	Height (m)	Elevation (m)	m H ₂ O	PSI	kPa
Avg. DD	115.5	76.4	39.1	55.6	383.4
Fire Flow	95.5	76.4	19.1	27.2	187.2
Peak Hour	105.9	76.4	29.5	42.0	289.2

Minor Loss Coefficients

Fitting	Loss Coefficient
Globe valve, fully open	10
Angle valve, fully open	5
Swing check valve, fully open	2.5
Gate valve, fully open	0.2
Short-radius elbow	0.9
Medium-radius elbow	0.8
Long-radius elbow	0.6
45 degree elbow	0.4
Closed return bend	2.2
Standard tee - flow through run	0.6
Standard tee - flow through branch	1.8
Square Entrance	0.5
Exit	1

*Minor loss coefficients based on EPANET 2 USERS MANUAL, dated September 2000

Pipe Diameter vs. "C" Factor

Pipe Diameter (m)	C-Factor
150	100
200 to 250	110
300 to 600	120
Over 600	130


Node Pressures

Kpa	Pressure (kPa)	Pressure (m H2O)
Max	552	56.3
Rec Max	480	49.0
Rec Min	350	35.7
Min	275	28.1

Location	Average Day (L/min)	Max Day + Fire Flow (L/min)	Peak Hour (L/min)
EX.FH2	0.0	6000.0	0.0
FH1	0.0	6000.0	0.0
N1	2.6	13.0	19.6
N2	2.0	9.7	14.7
N3	7.3	35.6	53.8
N4	6.6	32.4	48.9
N5	0.7	3.2	4.9
N6	0.7	3.2	4.9
N8	0.7	3.2	4.9
N9	0.7	3.2	4.9

Location	Average Day (kPa)	Max Day + Fire Flow (kPa)	Peak Hour (kPa)
EX.FH2	421.0	181.3	326.9
FH1	401.9	186.1	307.7
N1	414.7	216.1	320.5
N2	409.1	202.5	314.9
N3	403.4	187.6	309.2
N4	405.2	201.7	311.0
N5	411.7	213.0	317.0
N6	406.5	199.6	311.8
N8	401.8	197.9	306.6
N9	400.5	184.1	305.3

**2795 Baseline Road - Phase 2
EXISTING FIRE HYDRANT FIGURE**

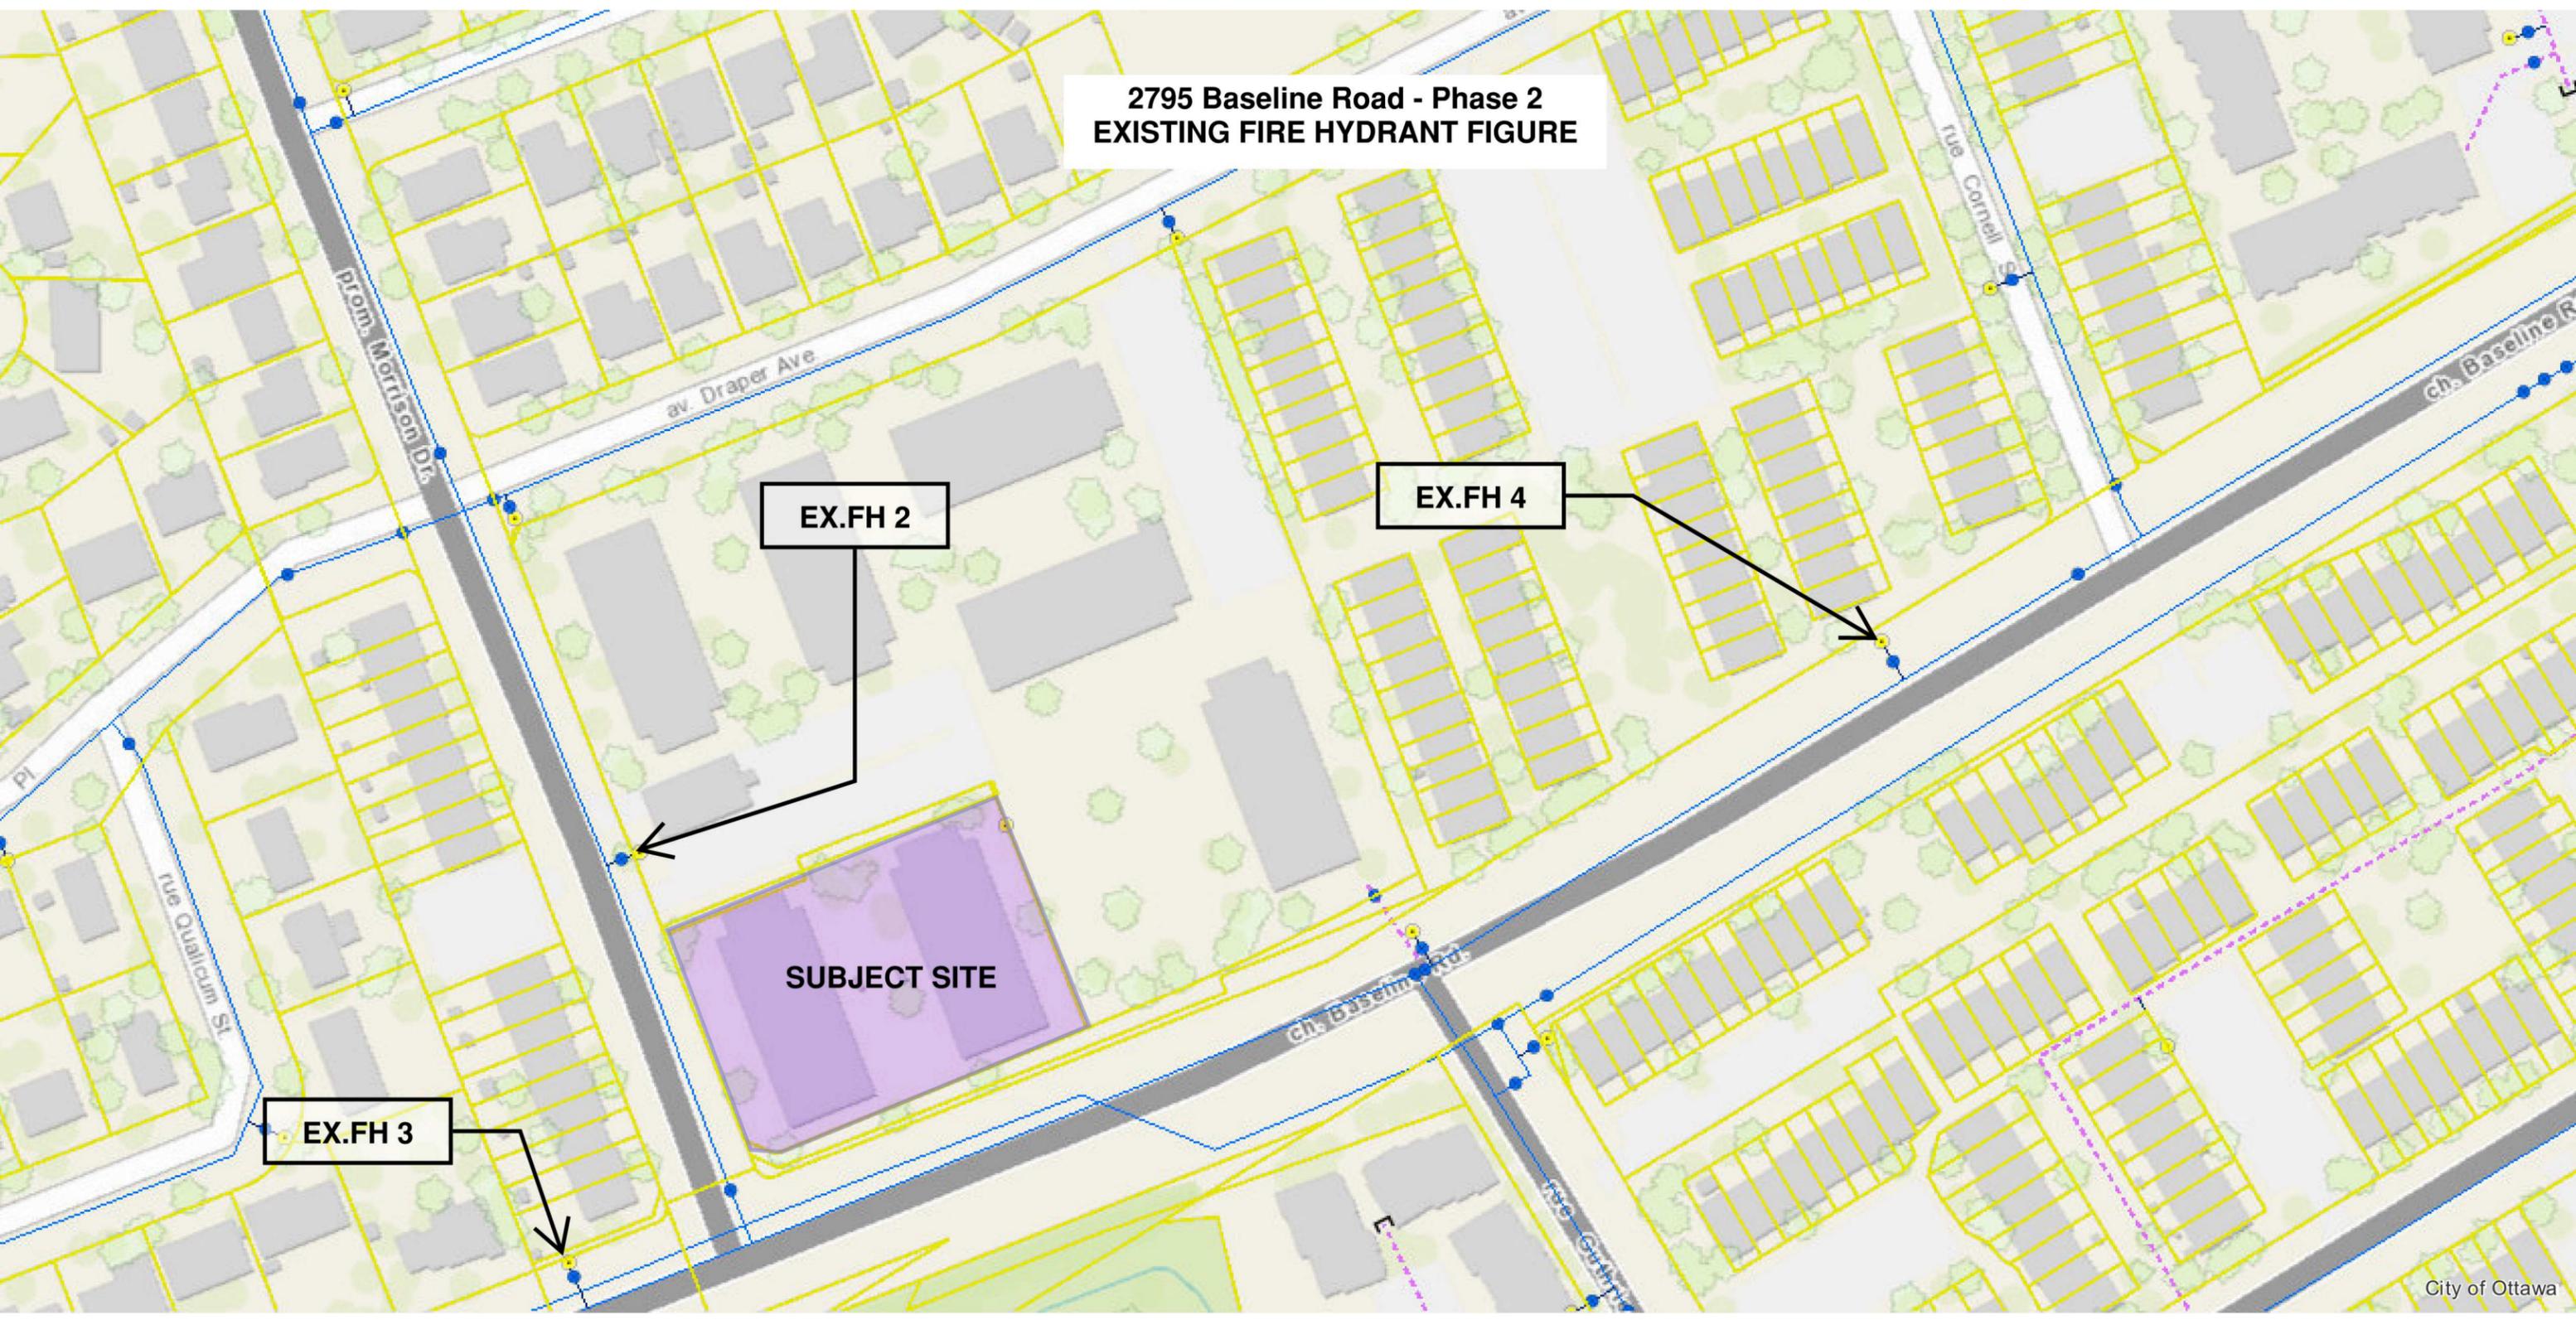

[TITLE]

[JUNCTIONS]

;ID	Elev	Demand	Pattern	
N4	74.20	6.6		;
N1	73.23	2.6		;
N3	74.38	7.3		;
FH1	74.53	0		;
N2	73.80	2		;
N5	73.53	0.7		;
N6	74.06	0.7		;
N9	74.67	0.7		;
N8	74.54	0.7		;
EX.FH2	72.58	0		;

[RESERVOIRS]

;ID	Head	Pattern	
R1	115.5		;
R2	115.5		;

[TANKS]

;ID	Elevation	InitLevel	MinLevel	MaxLevel
Diameter	MinVol	VolCurve		

[PIPES]

;ID	Node1	Node2	Length
Diameter	Roughness	MinorLoss	Status
P5	R2	N4	10.4
200	110	2	Open ;
P4	N4	N3	40.3
200	110	0.6	Open ;
P10	N3	FH1	2.7
150	100	5.9	Open ;
P1	R1	N1	10.4
200	110	2	Open ;
P2	N2	N1	82.1
200	110	0.6	Open ;
P3	N3	N2	82.4
200	110	2.4	Open ;
P6	N5	N1	3.7
19	100	2	Open ;
P7	N6	N2	3.7
19	100	2	Open ;
P9	N9	N3	7.7
19	100	2	Open ;
P8	N8	N4	7.7
19	100	2	Open ;

P11 EX.FH2 R1 18.5
 200 100 5.9 Open ;

[PUMPS]
 ;ID Node1 Node2 Parameters

[VALVES]
 ;ID Node1 Node2 Diameter
 Type Setting MinorLoss

[TAGS]

[DEMANDS]
 ;Junction Demand Pattern Category

[STATUS]
 ;ID Status/Setting

[PATTERNS]
 ;ID Multipliers

[CURVES]
 ;ID X-Value Y-Value

[CONTROLS]

[RULES]

[ENERGY]
 Global Efficiency 75
 Global Price 0
 Demand Charge 0

[EMITTERS]
 ;Junction Coefficient

[QUALITY]
 ;Node InitQual

[SOURCES]
 ;Node Type Quality Pattern

[REACTIONS]
 ;Type Pipe/Tank Coefficient

[REACTIONS]
 Order Bulk 1

2019-01-14_AVG.inp

Order Tank 1
Order Wall 1
Global Bulk 0
Global Wall 0
Limiting Potential 0
Roughness Correlation 0

[MIXING]

;Tank Model

[TIMES]

Duration 0
Hydraulic Timestep 1:00
Quality Timestep 0:05
Pattern Timestep 1:00
Pattern Start 0:00
Report Timestep 1:00
Report Start 0:00
Start ClockTime 12 am
Statistic None

[REPORT]

Status No
Summary No
Page 0

[OPTIONS]

Units LPM
Headloss H-W
Specific Gravity 1
Viscosity 1
Trials 40
Accuracy 0.001
CHECKFREQ 2
MAXCHECK 10
DAMPLIMIT 0
Unbalanced Continue 10
Pattern 1
Demand Multiplier 1
Emitter Exponent 0.5
Quality None mg/L
Diffusivity 1
Tolerance 0.01

[COORDINATES]

;Node	X-Coord	Y-Coord
N4	3194.44	3733.33
N1	3116.67	6322.22

2019-01-14_AVG.inp

N3	5816.67	3700.00
FH1	5807.58	4246.54
N2	5650.00	6366.67
N5	3105.56	5833.33
N6	5705.56	5822.22
N9	5850.00	3000.00
N8	3216.67	2988.89
EX.FH2	2346.21	7441.65
R1	1916.67	6333.33
R2	2005.56	3733.33

[VERTICES]

;Link	X-Coord	Y-Coord
P3	7350.00	3677.78
P3	7527.78	3888.89
P3	7483.33	6144.44
P3	7305.56	6344.44

[LABELS]

;X-Coord	Y-Coord	Label & Anchor Node
----------	---------	---------------------


[BACKDROP]

DIMENSIONS	0.00	0.00	10000.00
10000.00			
UNITS	None		
FILE			
OFFSET	0.00	0.00	

[END]

2795 BASELINE ROAD - AVERAGE DAY DEMAND

Day 1, 12:00 AM

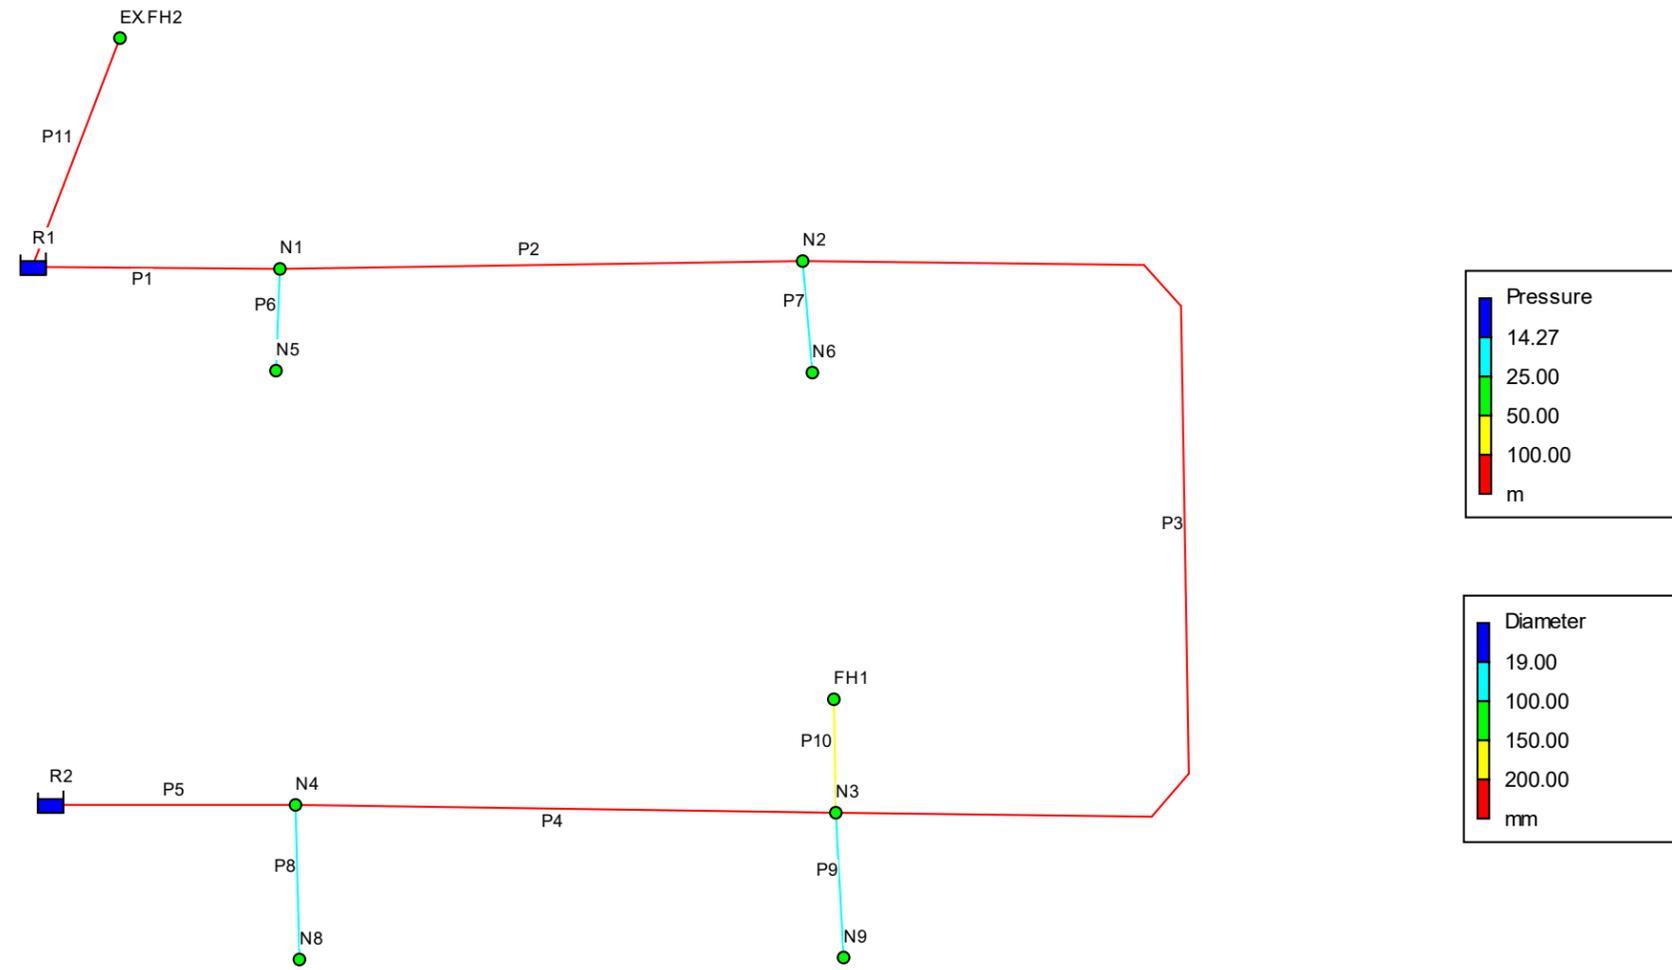


```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                *
*                               Analysis for Pipe Networks                 *
*                               Version 2.0                               *
*****
    
```

Input File: 2019-01-14_AVG.net

Link - Node Table:

Link ID	Start Node	End Node	Length m	Diameter mm
P5	R2	N4	10.4	200
P4	N4	N3	40.3	200
P10	N3	FH1	2.7	150
P1	R1	N1	10.4	200
P2	N2	N1	82.1	200
P3	N3	N2	82.4	200
P6	N5	N1	3.7	19
P7	N6	N2	3.7	19
P9	N9	N3	7.7	19
P8	N8	N4	7.7	19
P11	EX.FH2	R1	18.5	200

Node Results:

Node ID	Demand LPM	Head m	Pressure m	Quality
N4	6.60	115.50	41.30	0.00
N1	2.60	115.50	42.27	0.00
N3	7.30	115.50	41.12	0.00
FH1	0.00	115.50	40.97	0.00
N2	2.00	115.50	41.70	0.00
N5	0.70	115.50	41.97	0.00
N6	0.70	115.50	41.44	0.00
N9	0.70	115.50	40.83	0.00
N8	0.70	115.50	40.96	0.00
EX.FH2	0.00	115.50	42.92	0.00
R1	-8.37	115.50	0.00	0.00 Reservoir
R2	-12.93	115.50	0.00	0.00 Reservoir




Page 2

Link Results:

Link ID	Flow LPM	Velocity m/s	Unit Headloss m/km	Status
P5	12.93	0.01	0.00	Open
P4	5.63	0.00	0.00	Open
P10	0.00	0.00	0.00	Open
P1	8.37	0.00	0.00	Open
P2	-5.07	0.00	0.00	Open
P3	-2.37	0.00	0.00	Open
P6	-0.70	0.04	0.42	Open
P7	-0.70	0.04	0.42	Open
P9	-0.70	0.04	0.40	Open
P8	-0.70	0.04	0.40	Open
P11	0.00	0.00	0.00	Open

2795 BASELINE ROAD - MAX DAY + FIRE FLOW

Day 1, 12:00 AM

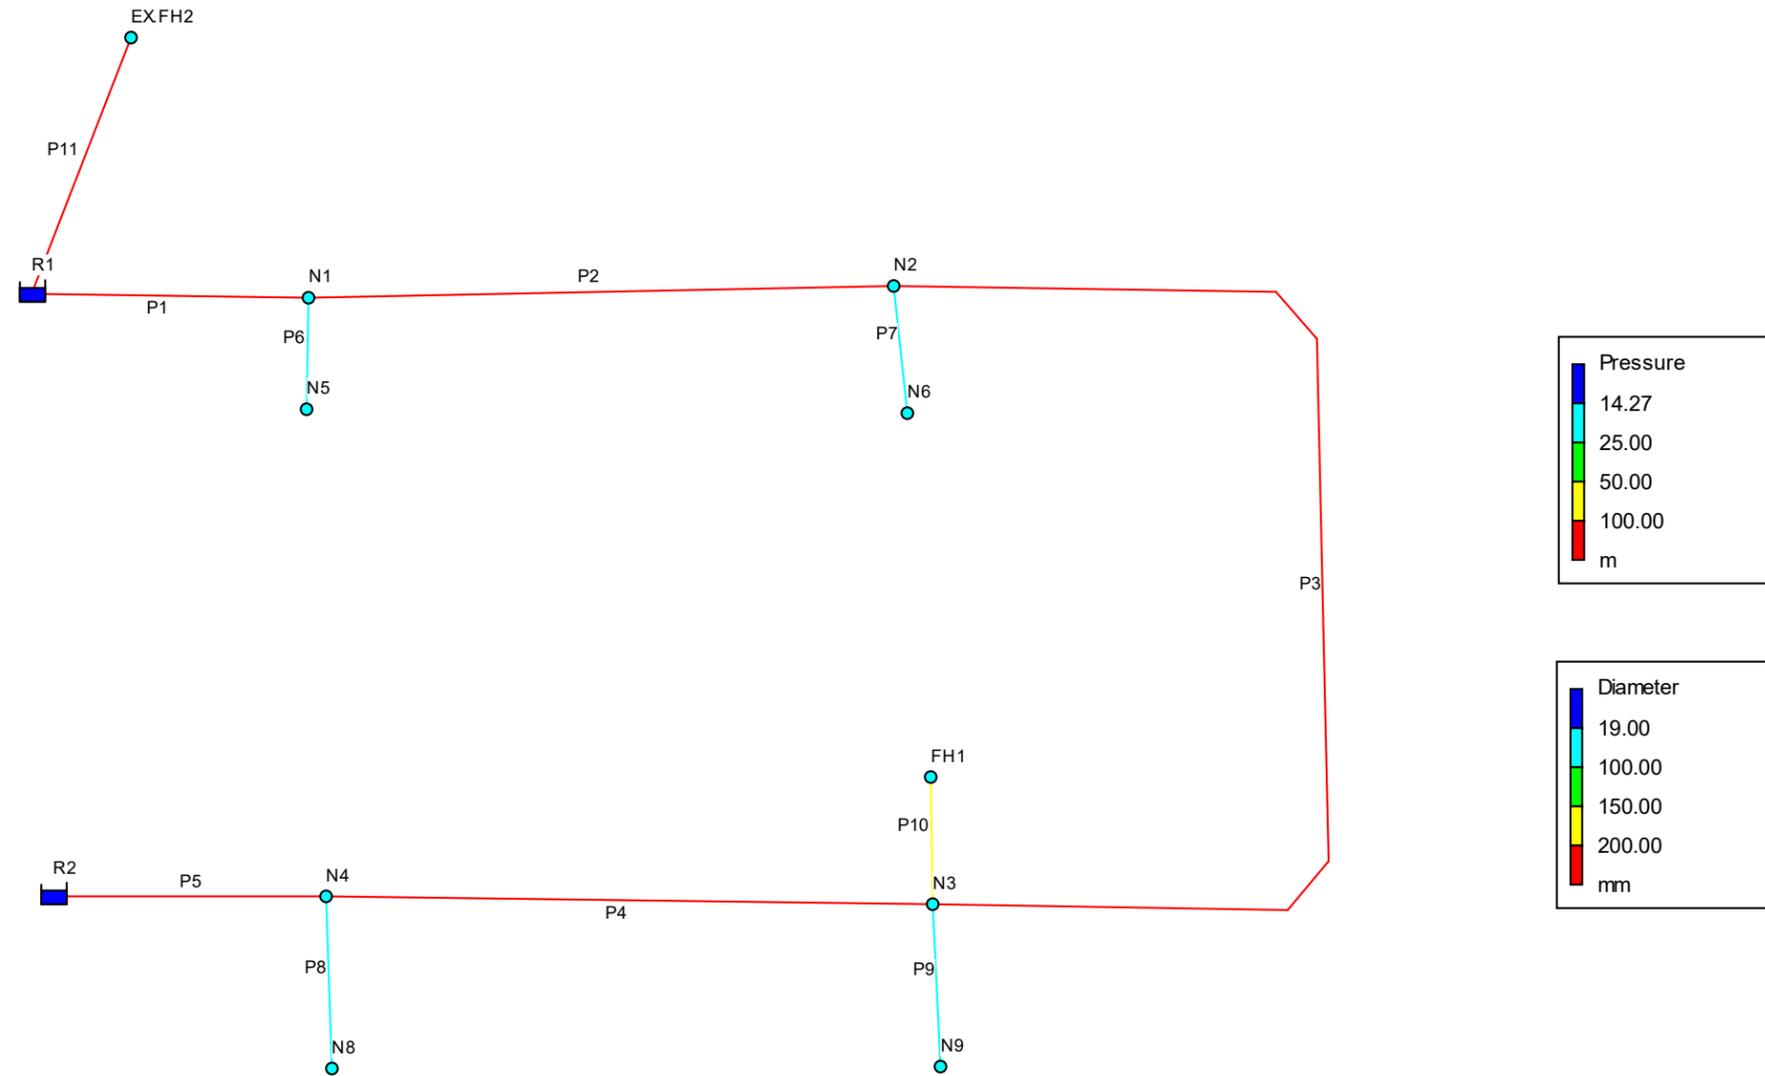


```
*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.0                                 *
*****
```

Input File: 2019-01-14_MAX.net

Link - Node Table:

Link ID	Start Node	End Node	Length m	Diameter mm
P5	R2	N4	10.4	200
P4	N4	N3	40.3	200
P10	N3	FH1	2.7	150
P1	R1	N1	10.4	200
P2	N2	N1	82.1	200
P3	N3	N2	82.4	200
P6	N5	N1	3.7	19
P7	N6	N2	3.7	19
P9	N9	N3	7.7	19
P8	N8	N4	7.7	19
P11	EX.FH2	R1	18.5	200

Node Results:

Node ID	Demand LPM	Head m	Pressure m	Quality
N4	32.40	94.76	20.56	0.00
N1	13.00	95.26	22.03	0.00
N3	6035.60	93.50	19.12	0.00
FH1	0.00	93.50	18.97	0.00
N2	9.70	94.44	20.64	0.00
N5	3.20	95.24	21.71	0.00
N6	3.20	94.41	20.35	0.00
N9	3.20	93.44	18.77	0.00
N8	3.20	94.71	20.17	0.00
EX.FH2	6000.00	91.06	18.48	0.00
R1	-8184.11	95.50	0.00	0.00 Reservoir
R2	-3919.40	95.50	0.00	0.00 Reservoir




Page 2

Link Results:

Link ID	Flow LPM	Velocity m/s	Unit Headloss m/km	Status
P5	3919.40	2.08	71.03	Open
P4	3883.80	2.06	31.42	Open
P10	0.00	0.00	0.00	Open
P1	2184.11	1.16	22.86	Open
P2	-2167.91	1.15	10.07	Open
P3	-2155.01	1.14	11.41	Open
P6	-3.20	0.19	7.21	Open
P7	-3.20	0.19	7.21	Open
P9	-3.20	0.19	6.70	Open
P8	-3.20	0.19	6.70	Open
P11	-6000.00	3.18	239.89	Open

2795 BASELINE ROAD - PEAK HOUR DEMAND

Day 1, 12:00 AM

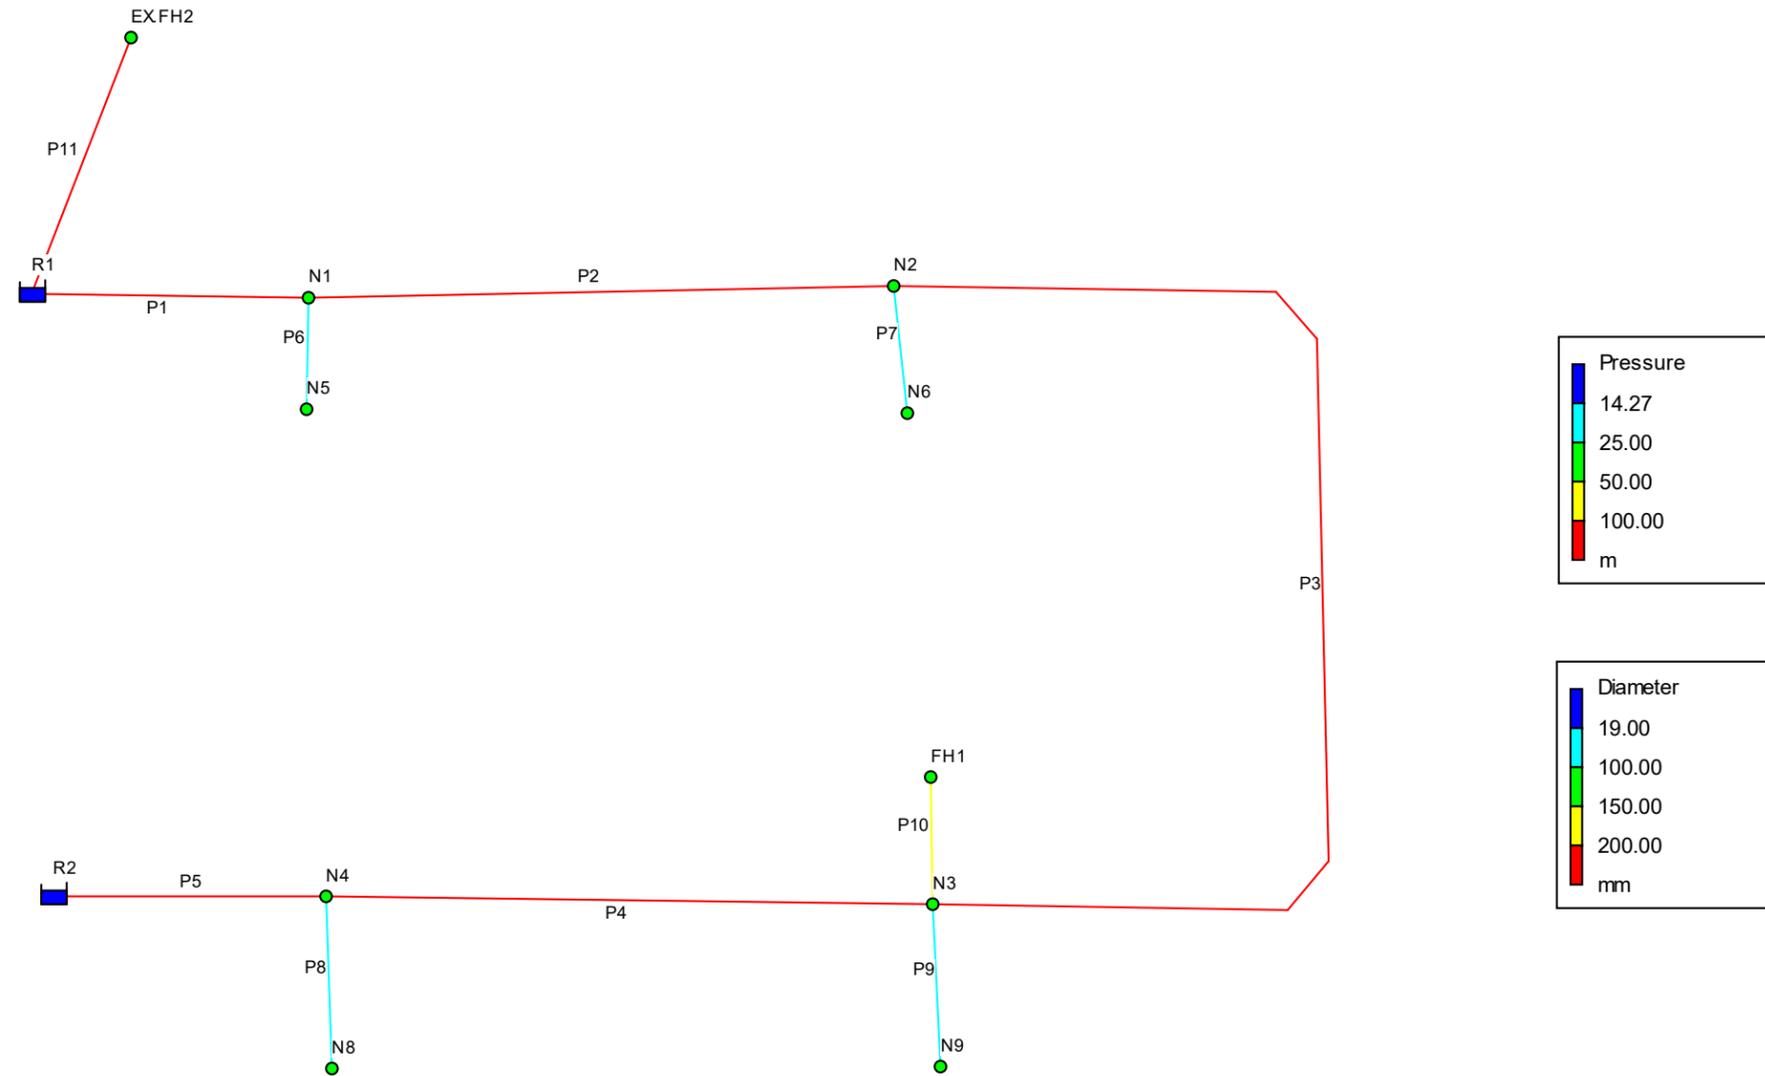


```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.0                                 *
*****
    
```

Input File: 2019-01-14_PEAK.net

Link - Node Table:

Link ID	Start Node	End Node	Length m	Diameter mm
P5	R2	N4	10.4	200
P4	N4	N3	40.3	200
P10	N3	FH1	2.7	150
P1	R1	N1	10.4	200
P2	N2	N1	82.1	200
P3	N3	N2	82.4	200
P6	N5	N1	3.7	19
P7	N6	N2	3.7	19
P9	N9	N3	7.7	19
P8	N8	N4	7.7	19
P11	EX.FH2	R1	18.5	200

Node Results:

Node ID	Demand LPM	Head m	Pressure m	Quality
N4	48.90	105.90	31.70	0.00
N1	19.60	105.90	32.67	0.00
N3	53.80	105.90	31.52	0.00
FH1	0.00	105.90	31.37	0.00
N2	14.70	105.90	32.10	0.00
N5	4.90	105.84	32.31	0.00
N6	4.90	105.84	31.78	0.00
N9	4.90	105.79	31.12	0.00
N8	4.90	105.79	31.25	0.00
EX.FH2	0.00	105.90	33.32	0.00
R1	-62.14	105.90	0.00	0.00 Reservoir
R2	-94.46	105.90	0.00	0.00 Reservoir



Page 2

Link Results:

Link ID	Flow LPM	Velocity m/s	Unit Headloss m/km	Status
P5	94.46	0.05	0.05	Open
P4	40.66	0.02	0.01	Open
P10	0.00	0.00	0.00	Open
P1	62.14	0.03	0.02	Open
P2	-37.64	0.02	0.01	Open
P3	-18.04	0.01	0.00	Open
P6	-4.90	0.29	16.00	Open
P7	-4.90	0.29	16.00	Open
P9	-4.90	0.29	14.82	Open
P8	-4.90	0.29	14.82	Open
P11	0.00	0.00	0.00	Open

Alison Gosling

From: Alison Gosling
Sent: Wednesday, January 9, 2019 12:55 PM
To: 'Fraser, Mark'
Subject: 18-1055 2795 Baseline Road - Boundary Condition Request
Attachments: wtr-2019-01-09_1055.pdf

Good afternoon Mark,

We would like to request updated water boundary conditions for Morrison Drive using the following proposed development demands:

1. Location of Service / Street Number: 2795 Baseline Road
2. Type of development and the amount of fire flow required for the proposed development:
 - The proposed Fresh Towns development consists of 32 townhomes.
 - It is proposed that the development will have a dual connection to be serviced from the existing 200 mm diameter watermain within Morrison Drive, as shown by the map below.
 - City of Ottawa Technical Bulletin ISTB-2018-02 has been used to calculate an estimated fire demand of **12,000 L/min** for the development. Refer to attached for the detailed calculations.
- 3.

	L/min	L/s
Avg. Daily	21.1	0.35
Max Day	103.6	1.73
Peak Hour	156.5	2.61



Thank you,

Alison Gosling, E.I.T.
Project Coordinator / Junior Designer

DSEL

david schaeffer engineering ltd.

120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

phone: (613) 836-0856 ext.542

fax: (613) 836-7183

email: agosling@dsel.ca

This email, including any attachments, is for the sole use of the intended recipient(s) and may contain private, confidential, and privileged information. Any unauthorized review, use, disclosure, or distribution is prohibited. If you are not the intended recipient, or if this information has been inappropriately forwarded to you, please contact the sender by reply email and destroy all copies of the original.

Please update the hydraulic analysis based on the below updated boundary conditions which are based on the proposed water demand requirements presented in Appendix B. **The boundary conditions have been provided in advance of a formal request to expedite to the update.**

Interim Site Conditions - Phase 3-1

Average Day Demand: 0.35 L/s (21.1 L/min)

Maximum Daily Demand: 1.26 L/s (76.1 L/min)

Maximum Hourly Demand: 1.90 L/s (114.2 L/min)

Fire Flow: 10,000 L/min

Minimum HGL = 106.2m, same at all connections

Maximum HGL = 115.5m, same at all connections

Max Day + Fire Flow (167L/s) = 97.8m, southern connection on Morrison

Max Day + Fire Flow (167L/s) = 97.0m, northern connection on Morrison

Max Day + Fire Flow (167L/s) = 96.5m, Draper connection

Ultimate Site Conditions - Phase 3-1 & Phase 3-2

Average Day Demand: 0.94 L/s (56.6 L/min)

Maximum Daily Demand: 3.40 L/s (203.9 L/min)

Maximum Hourly Demand: 5.09 L/s (305.8 L/min)

Fire Flow: 11,000 L/min

Minimum HGL = 105.9m, same at all connections


Maximum HGL = 115.5m, same at all connections

Max Day + Fire Flow (183L/s) = 95.5m, southern connection on Morrison

Max Day + Fire Flow (183L/s) = 94.5m, northern connection on Morrison

Max Day + Fire Flow (183L/s) = 94.0m, Draper connection

Boundary Condition for 2710 Draper

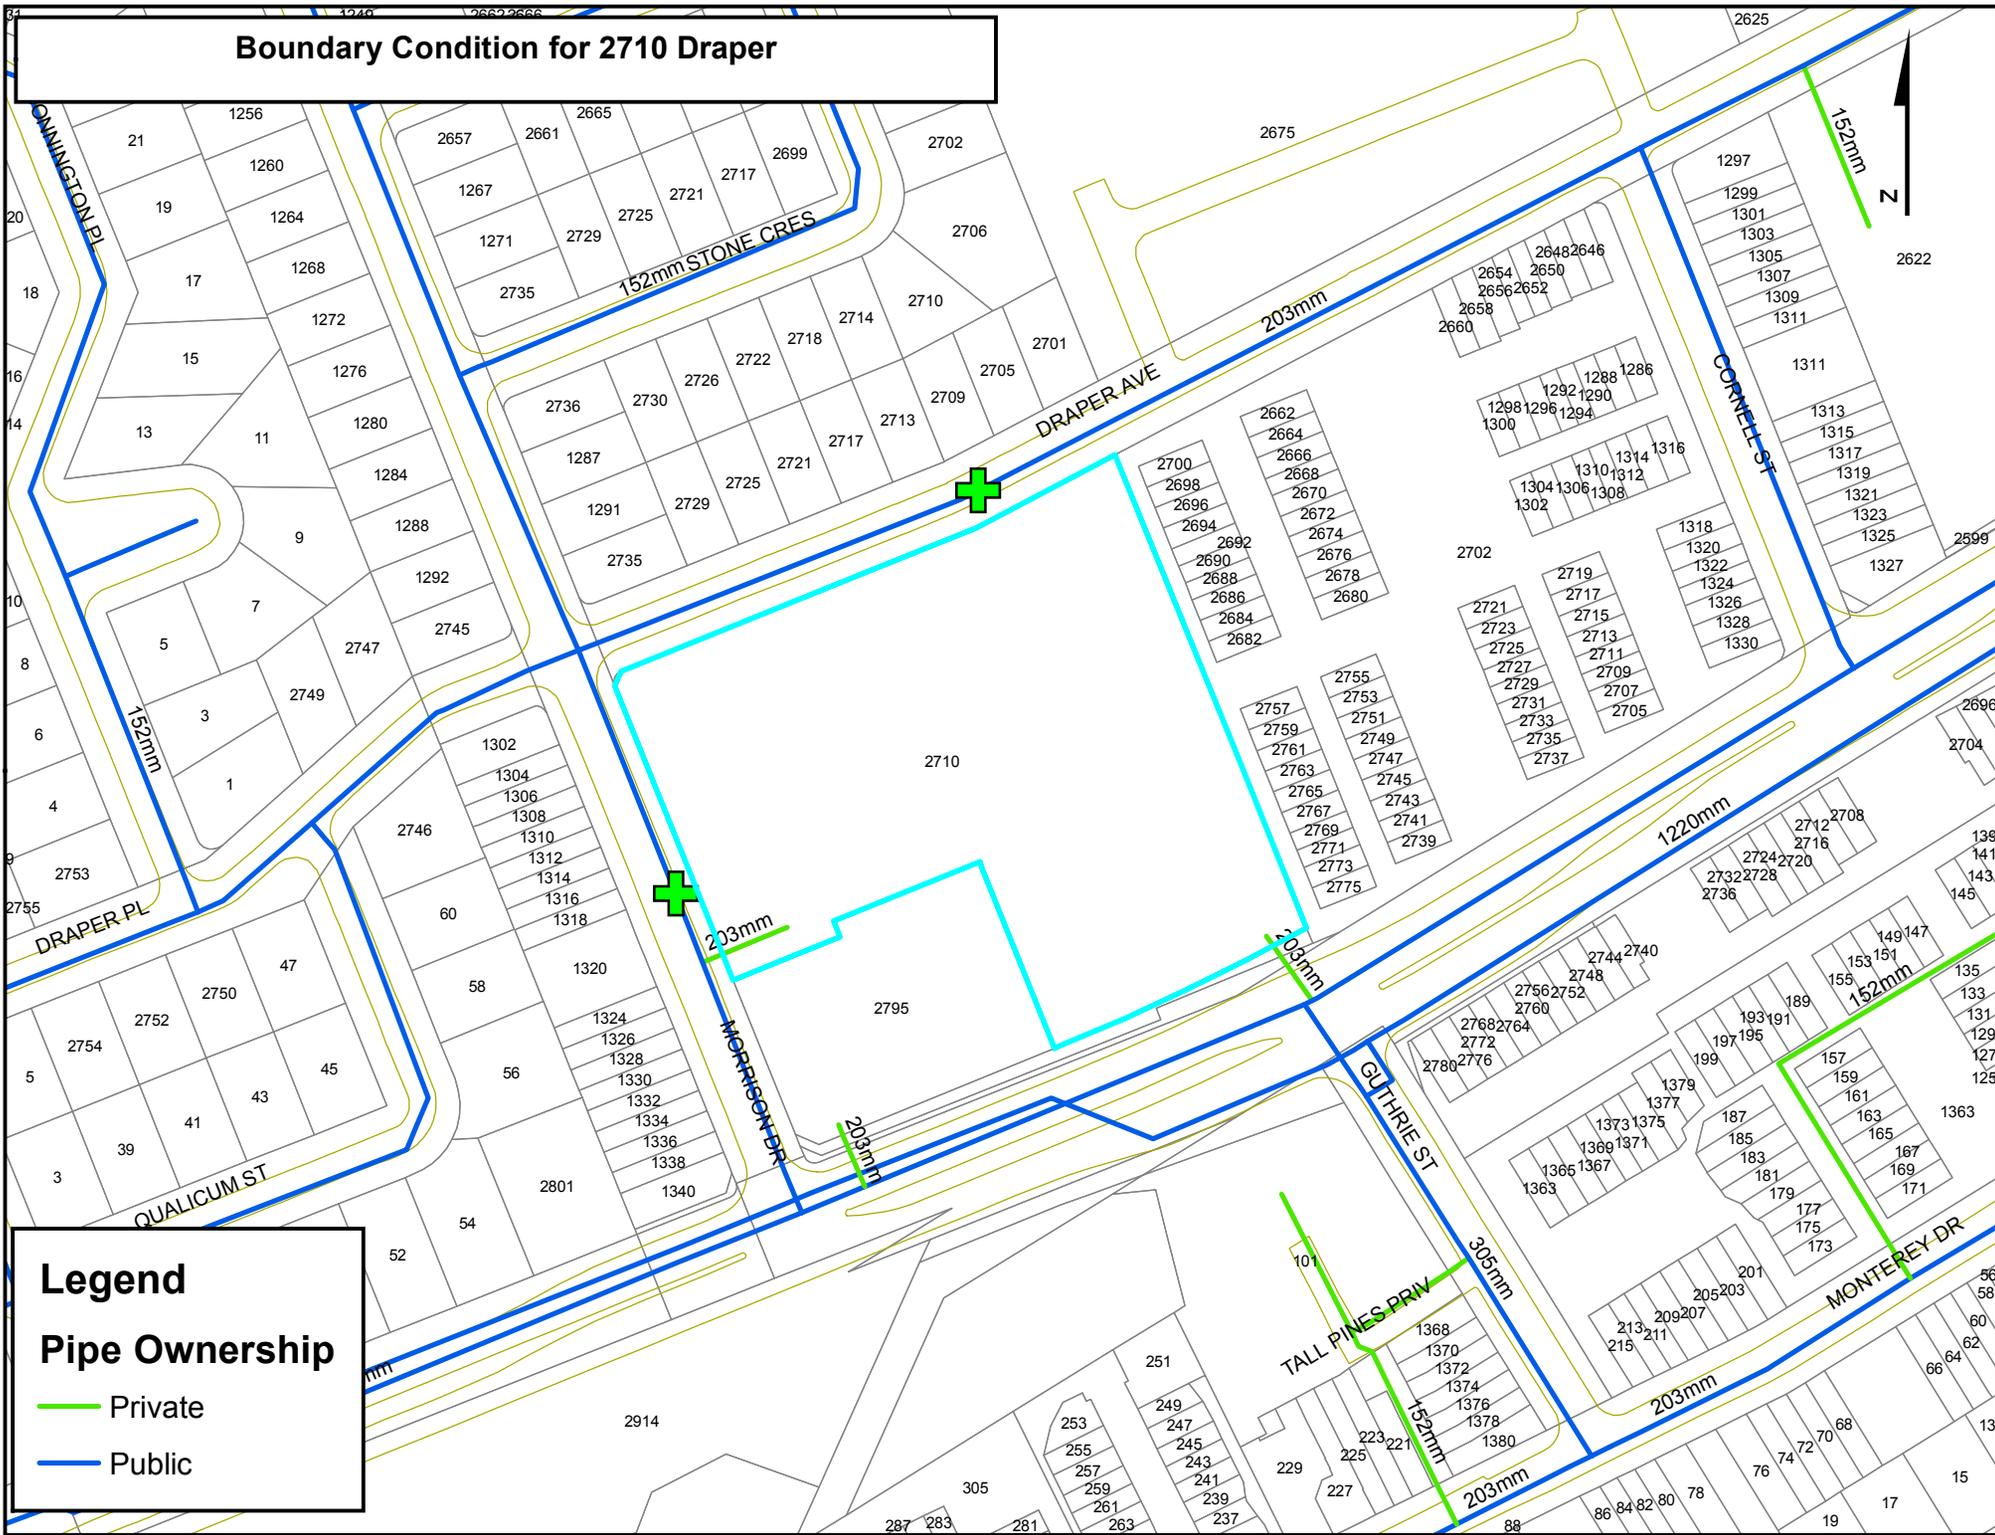

Legend

Pipe Ownership

- Private
- Public

EXISTING FIRE HYDRANTS



January 14, 2019

1:1,433

Property Parcels

Reducer / réducteur

Misc. Water Structures / Structures d'aqueduc - divers

0 0.0175 0.035 0.07 mi

Valves / Vannes

Hydrants / Bornes-fontaines

Pumping Station / Station de pompage des eaux

0 0.0275 0.055 0.11 km

Valve / Vanne

Hydrant Laterals / Branchements de borne-fontaine

Well Supply / Alimentation par puits

TVS, A, D

Water Mains / Conduites d'eau principales

Elevated Tank / Château d'eau

Water Fittings / Raccords de conduite d'eau

Private / Branchement privé

In Ground Tank / Réservoir souterrain

Cap / bouchon

Public / Branchement public

Water Treatment Plant / Usine d'épuration des eaux


City of Ottawa

CITY OF OTTAWA - WATER DISTRIBUTION SYSTEM
PRESSURE ZONE FIGURE

T & P.S. & RES.

MINES &
RESOURCES P.S.

SUBJECT
SITE

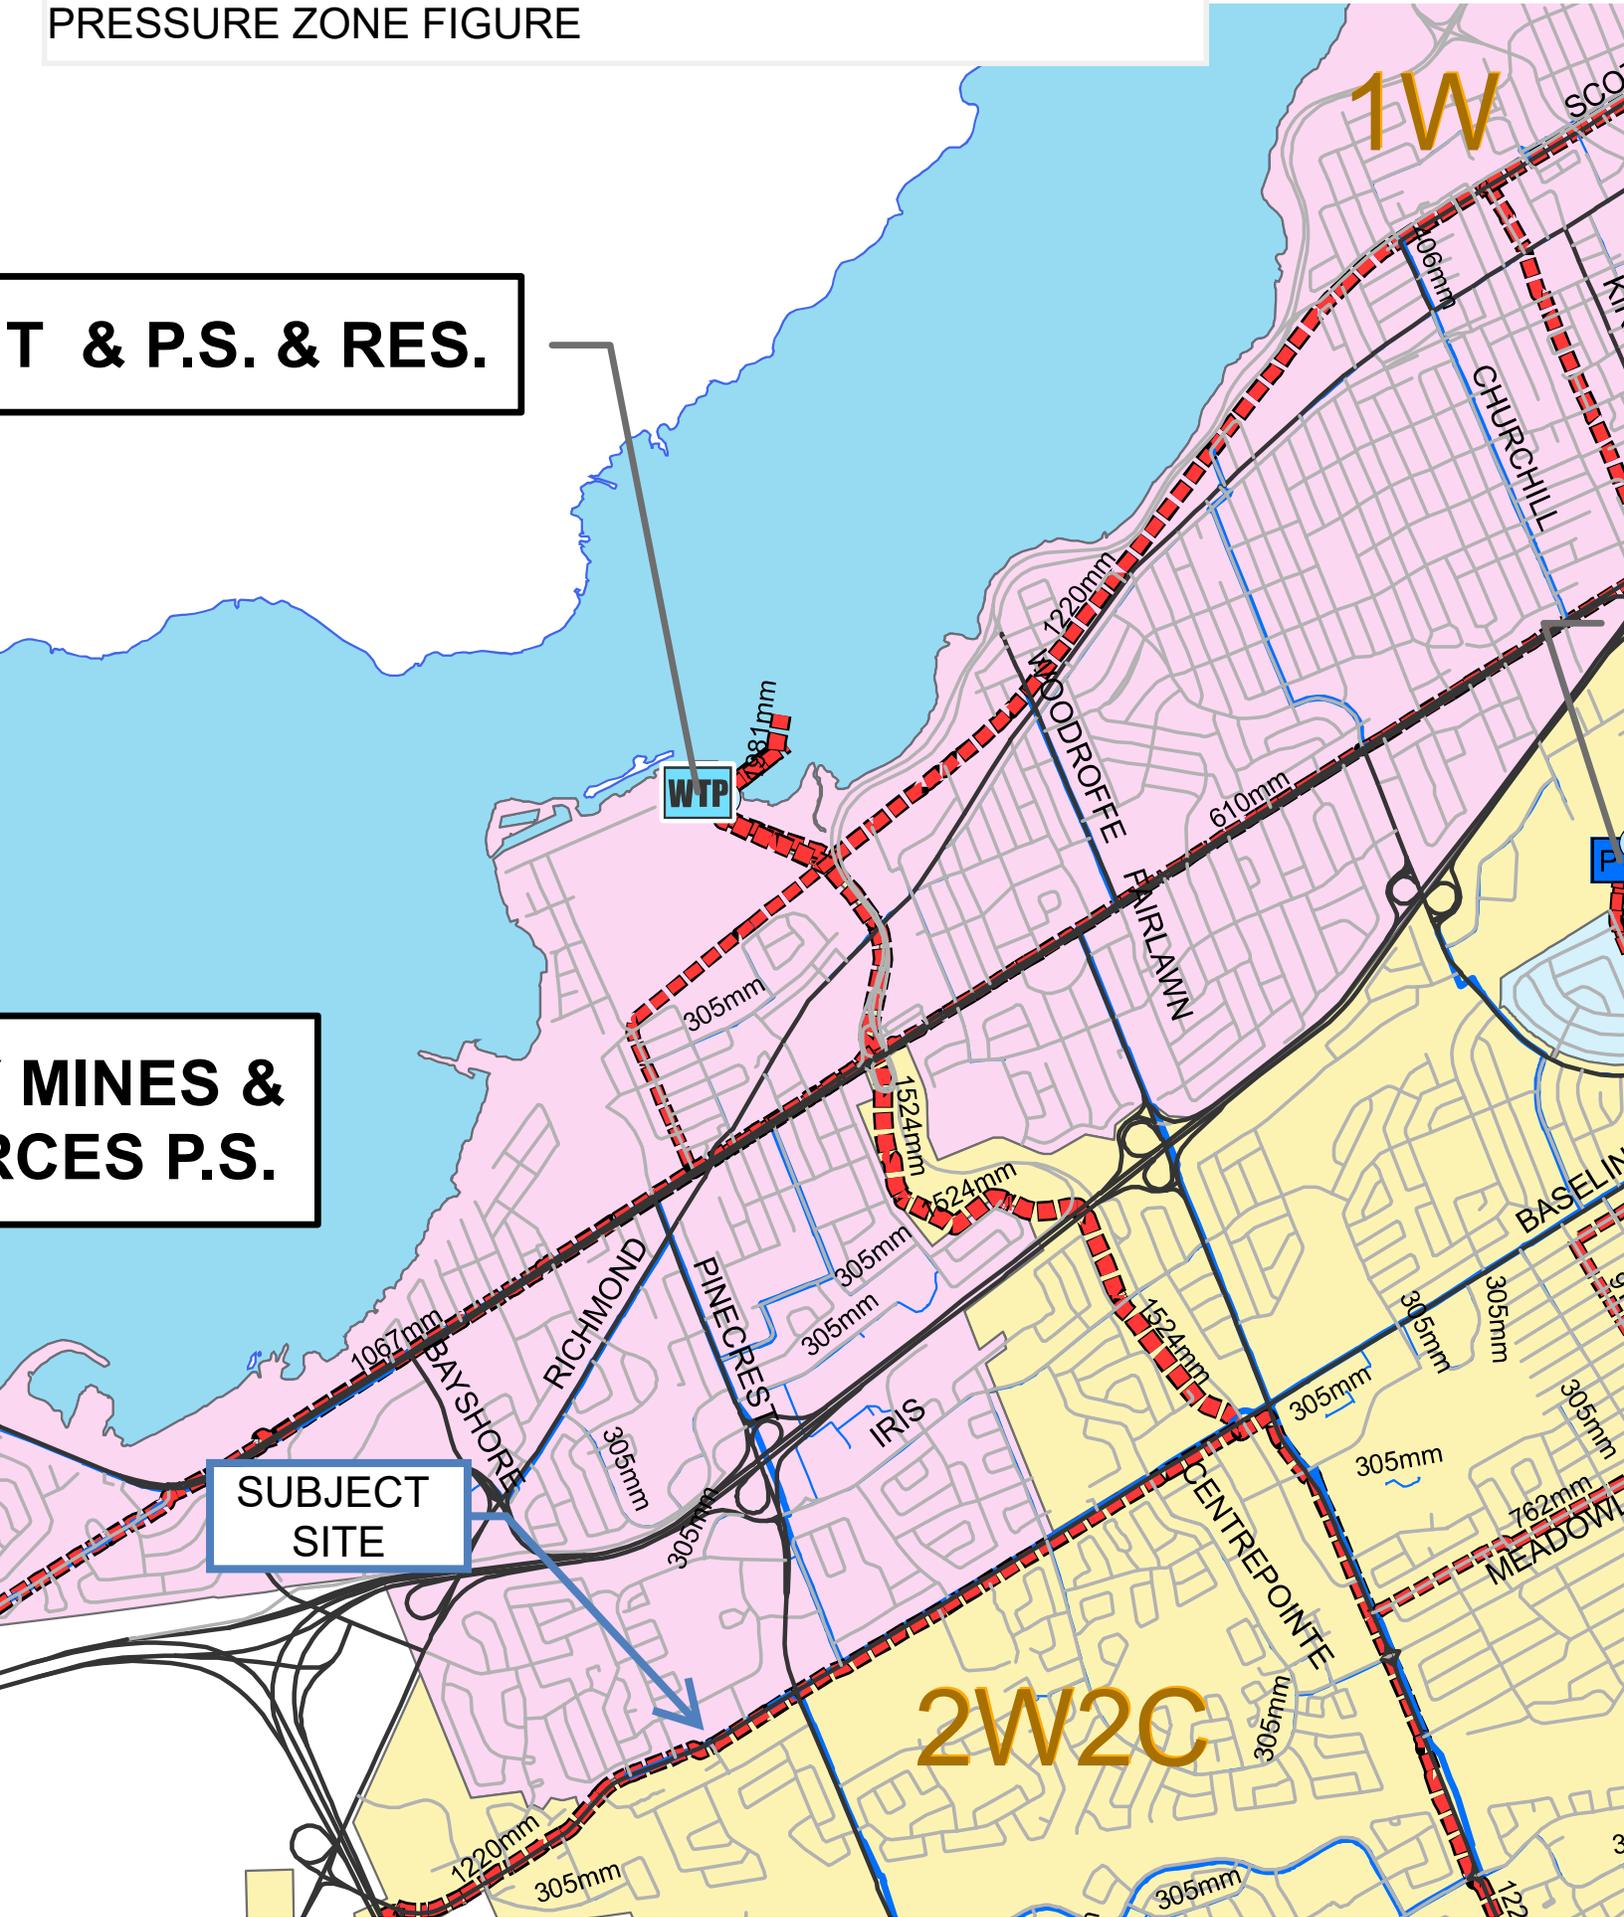

APPENDIX C

Wastewater Collection

**Greatwise Developments
Fresh Towns II - 2795 Baseline Road
Existing Sanitary Flow from 2781 Baseline Road**

**Wastewater Design Flows per Unit Count
City of Ottawa Sewer Design Guidelines, 2012**



Site Area 1.086 ha

Extraneous Flow Allowances

Infiltration / Inflow (Dry)	0.05 L/s
Infiltration / Inflow (Wet)	0.30 L/s
Infiltration / Inflow (Total)	0.36 L/s

Domestic Contributions

Unit Type	Unit Rate	Units	Pop
Single Family	3.4		0
Semi-detached and duplex	2.7		0
Townhouse	2.7		0
Stacked Townhouse	2.3		0
Apartment			
Existing CCC 994 Lands (Building E)			
1 Bedroom	1.4	56	79
2 Bedroom	2.1	24	51
Townhomes	2.7		
1 Bedroom	2.7	32	87
2 Bedroom			

Phase 3-1 & 3-2 Townhomes

Total Pop 217

Average Domestic Flow 0.70 L/s

Peaking Factor 3.51

Peak Domestic Flow 2.47 L/s

Total Estimated Average Dry Weather Flow Rate	0.70 L/s
Total Estimated Peak Dry Weather Flow Rate	2.52 L/s
Total Estimated Peak Wet Weather Flow Rate	2.83 L/s

Residential demands, Harmon's Correction Factor, Extraneous Flow Rates and Commercial Peaking Factor established by the City of Ottawa Technical Bulletin ISTB-2018-01. Commercial demands established by City of Ottawa Sewer Design Guidelines Appendix 4A.

Wastewater Design Flows per Unit Count
 City of Ottawa Sewer Design Guidelines, 2012



Site Area 2.172 ha

Extraneous Flow Allowances

Infiltration / Inflow (Dry)	0.11 L/s
Infiltration / Inflow (Wet)	0.61 L/s
Infiltration / Inflow (Total)	0.72 L/s

Domestic Contributions

Unit Type	Unit Rate	Units	Pop
Single Family	3.4		0
Semi-detached and duplex	2.7		0
Townhouse	2.7	86	233
Stacked Townhouse	2.3		0
Apartment			
Existing CCC 994 Lands (Building E)			
1 Bedroom	1.4	56	79
2 Bedroom	2.1	24	51
Townhomes	2.7		
1 Bedroom	2.7	32	87
2 Bedroom			

Phase 3-1 & 3-2 Townhomes

Total Pop 450

Average Domestic Flow 1.46 L/s

Peaking Factor 3.40

Peak Domestic Flow 4.96 L/s

Total Estimated Average Dry Weather Flow Rate	1.46 L/s
Total Estimated Peak Dry Weather Flow Rate	5.06 L/s
Total Estimated Peak Wet Weather Flow Rate	5.67 L/s

Residential demands, Harmon's Correction Factor, Extraneous Flow Rates and Commercial Peaking Factor established by the City of Ottawa Technical Bulletin ISTB-2018-01. Commercial demands established by City of Ottawa Sewer Design Guidelines Appendix 4A.

Existing Conditions (Reproduction of Novatech Table 2.2)

City MH ID	Pipe ID	Population		Local Area (ha)						Cumulative Area (ha)	Design Flow (L/S)
		Local	Cumulative	Res.	Com.	Com. Cumul.	Inst.	Inst. Cumul.	Total		
Morrison Drive Sewer (Upper Reach)											
25698	1	113	113	1.39		0		0	1.39	1.39	1.8
25699	2	592	705	7.91		0	8.21	8.21	16.12	17.51	16.4
25700	3	71	776	1.55		0		8.21	1.55	19.06	17.8
25701	4	85	861	1.7		0		8.21	1.7	20.76	19.4
25702	5	58	919	1.05		0		8.21	1.05	21.81	20.5
25703	6	27	946	0.59		0		8.21	0.59	22.4	21.0
25704	7	160	1106	3.22		0		8.21	3.22	25.62	24.0
25706	8	43	1149	0.57		0		8.21	0.57	26.19	24.6
43673	9	162	1311	2.17	2.38	2.38		8.21	4.55	30.74	28.8
25709	10		1311	0.76	0.39	2.77		8.21	1.15	31.89	29.4
25710	11		1311	0.71	1.05	3.82		8.21	1.76	33.65	30.5
25711	12		1311	1.29	0.8	4.62		8.21	2.09	35.74	31.7
25713	13	378	1689	3.19		4.62		8.21	3.19	38.93	36.5
25715	14	2294	3983	34.61	6.5	11.12	1.39	9.6	42.5	81.43	77.2
Draper Avenue Sewer System											
	15A	38	38	1.38		0	1.47	1.47	2.85	2.85	2.0
	15B	135	173	2.2		0		1.47	2.2	5.05	4.4
	15C	230	403	0.54		0		1.47	0.54	5.59	6.9
	15D	360	763	0.84		0		1.47	0.84	6.43	10.6
	15E	905	1668	4.13		0		1.47	4.13	10.56	20.4
	15F	251	1919	2.98		0	0.5	1.97	3.48	14.04	24.3
	15G	111	2030	0.94		0	0.25	2.22	1.19	15.23	25.8
Morrison Drive Sewer (Lower Reach)											
25723	15		6013			11.12		11.82	0	96.66	100.4
25722	16		6013	0.38	1.88	13		11.82	2.26	98.92	101.4
25720	17	154	6167	2.07	0.84	13.84		11.82	2.91	101.83	104.2

Domestic Flow	300 (L/per/day)
Correction Factor Dom (Harmon Equation)	0.6
Extraneous Flow	0.5 L/s/ha
Commercial	17000 L/ha/day
Institutional	10000
Industrial	10000
Peaking Factor non-res	1

Population density	
Single Family	3.4
Townhouse	2.7
Apartment Units	1.4

Phase 1 Conditions as per DSEL 2012

City MH ID	Pipe ID	Population		Local Area (ha)						Cumulative Area (ha)	Design Flow (L/S)
		Local	Cumulative	Res.	Com.	Com. Cumul.	Inst.	Inst. Cumul.	Total		
Morrison Drive Sewer (Upper Reach)											
25698	1	305	305	1.33	0.06	0.06		0	1.39	1.39	4.0
25699	2	592	897	7.91		0.06	8.21	8.21	16.12	17.51	20.3
25700	3	71	968	1.55		0.06		8.21	1.55	19.06	21.7
25701	4	85	1053	1.7		0.06		8.21	1.7	20.76	23.3
25702	5	58	1111	1.05		0.06		8.21	1.05	21.81	24.3
25703	6	27	1138	0.59		0.06		8.21	0.59	22.4	24.8
25704	7	160	1298	3.22		0.06		8.21	3.22	25.62	27.7
25706	8	43	1341	0.57		0.06		8.21	0.57	26.19	28.4
43673	9	162	1503	2.17	2.38	2.44		8.21	4.55	30.74	32.5
25709	10		1503	0.76	0.39	2.83		8.21	1.15	31.89	33.1
25710	11		1503	0.71	1.05	3.88		8.21	1.76	33.65	34.2
25711	12		1503	1.29	0.8	4.68		8.21	2.09	35.74	35.4
25713	13	378	1881	3.19		4.68		8.21	3.19	38.93	40.1
25715	14	2294	4175	34.61	6.5	11.18	1.39	9.6	42.5	81.43	80.5
Draper Avenue Sewer System											
	15A	38	38	1.38		0	1.47	1.47	2.85	2.85	4.5
	15B	135	173	2.2		0		1.47	2.2	5.05	6.9
	15C	230	403	0.54		0		1.47	0.54	5.59	9.2
	15D	360	763	0.84		0		1.47	0.84	6.43	12.8
	15E	905	1668	4.13		0		1.47	4.13	10.56	22.5
	15F	251	1919	2.98		0	0.5	1.97	3.48	14.04	26.3
	15G	111	2030	0.94		0	0.25	2.22	1.19	15.23	27.8
Morrison Drive Sewer (Lower Reach)											
25723	15		6205			11.18		11.82	0	96.66	103.0
25722	16		6205	0.38	1.88	13.06		11.82	2.26	98.92	104.5
25720	17	154	6359	2.07	0.84	13.9		11.82	2.91	101.83	107.2

Population increase based on Phase I proposed development, net population increase of 220.

Domestic Flow - Existing	300 (L/per/day)
Domestic Flow Proposed	350 (L/per/day)
Correction Factor Dom ¹ (Harmon Equation)	0.6
Extraneous Flow	0.5 L/s/ha
Commercial	17000 L/ha/day
Institutional	10000
Industrial	10000
Peaking Factor non-res	1

¹Correction factor for proposed buildings = 1.0

Population density	
Townhouse	2.7
Apartment 1 Bedroom	1.4
Apartment 2 Bedroom	2.1
Apartment 3 Bedroom	3.1

Total Population Increase

Existing Townhouses	5*12 units	162 persons
Proposed		354 persons
Difference		192
100 % will be added at Link 1		354 persons

Ultimate Proposed Conditions - as per DSEL 2012

City MH ID	Pipe ID	Population		Local Area (ha)						Cumulative Area (ha)	Design Flow (L/S)
		Local	Cumulative	Res.	Com.	Com. Cumul.	Inst.	Inst. Cumul.	Total		
Morrison Drive Sewer (Upper Reach)											
25698	1	347	347	1.33	0.06	0.06		0	1.39	1.39	4.6
25699	2	1060	1407	7.91		0.06	8.21	8.21	16.12	17.51	28.0
25700	3	71	1478	1.55		0.06		8.21	1.55	19.06	29.3
25701	4	85	1563	1.7		0.06		8.21	1.7	20.76	30.9
25702	5	58	1621	1.05		0.06		8.21	1.05	21.81	31.9
25703	6	27	1648	0.59		0.06		8.21	0.59	22.4	32.4
25704	7	160	1808	3.22		0.06		8.21	3.22	25.62	35.2
25706	8	43	1851	0.57		0.06		8.21	0.57	26.19	35.9
43673	9	162	2013	2.17	2.38	2.44		8.21	4.55	30.74	39.9
25709	10		2013	0.76	0.39	2.83		8.21	1.15	31.89	40.5
25710	11		2013	0.71	1.05	3.88		8.21	1.76	33.65	41.6
25711	12		2013	1.29	0.8	4.68		8.21	2.09	35.74	42.8
25713	13	378	2391	3.19		4.68		8.21	3.19	38.93	47.4
25715	14	2294	4685	34.61	6.5	11.18	1.39	9.6	42.5	81.43	87.1
Draper Avenue Sewer System											
	15A	38	38	1.38		0	1.47	1.47	2.85	2.85	8.6
	15B	135	173	2.2		0		1.47	2.2	5.05	10.8
	15C	230	403	0.54		0		1.47	0.54	5.59	13.0
	15D	360	763	0.84		0		1.47	0.84	6.43	16.4
	15E	905	1668	4.13		0		1.47	4.13	10.56	25.8
	15F	251	1919	2.98		0	0.5	1.97	3.48	14.04	29.6
	15G	111	2030	0.94		0	0.25	2.22	1.19	15.23	31.1
Morrison Drive Sewer (Lower Reach)											
25723	15		6715			11.18		11.82	0	96.66	109.3
25722	16		6715	0.38	1.88	13.06		11.82	2.26	98.92	110.8
25720	17	154	6869	2.07	0.84	13.9		11.82	2.91	101.83	113.5

Population increase based on proposed development, net population increase of 702, new pop = 929.

Domestic Flow - Existing	300 (L/per/day)
Domestic Flow Proposed	350 (L/per/day)
Correction Factor Dom ¹ (Harmon Equation)	0.6
Extraneous Flow	0.5 L/s/ha
Commercial	17000 L/ha/day
Institutional	10000
Industrial	10000
Peaking Factor non-res	1

¹Correction factor for proposed buildings = 1.0

Population density	
Townhouse	2.7
Apartment 1 Bedroom	1.4
Apartment 2 Bedroom	2.1
Apartment 3 Bedroom	3.1

Total Population Increase

Existing Townhouses 7*12 units	227 persons
Proposed	929 persons
Difference	702
1/3 will be added at Link 1	310 persons
2/3 will be added at Link 2	619 L/s

Phase X Conditions - Max Flow increase to not exceed 0.30 m freeboard

City MH ID	Pipe ID	Population		Local Area (ha)						Cumulative Area (ha)	Design Flow (L/S)
		Local	Cumulative	Res.	Com.	Com. Cumul.	Inst.	Inst. Cumul.	Total		
Morrison Drive Sewer (Upper Reach)											
25698	1	276	276	1.33	0.06	0.06		0	1.39	1.39	4.9
25699	2	917	1193	7.91		0.06	8.21	8.21	16.12	17.51	24.6
25700	3	71	1264	1.55		0.06		8.21	1.55	19.06	25.9
25701	4	85	1349	1.7		0.06		8.21	1.7	20.76	27.5
25702	5	58	1407	1.05		0.06		8.21	1.05	21.81	28.5
25703	6	27	1434	0.59		0.06		8.21	0.59	22.4	29.0
25704	7	160	1594	3.22		0.06		8.21	3.22	25.62	31.9
25706	8	43	1637	0.57		0.06		8.21	0.57	26.19	32.6
43673	9	162	1799	2.17	2.38	2.44		8.21	4.55	30.74	36.6
25709	10		1799	0.76	0.39	2.83		8.21	1.15	31.89	37.3
25710	11		1799	0.71	1.05	3.88		8.21	1.76	33.65	38.3
25711	12		1799	1.29	0.8	4.68		8.21	2.09	35.74	39.5
25713	13	378	2177	3.19		4.68		8.21	3.19	38.93	44.1
25715	14	2294	4471	34.61	6.5	11.18	1.39	9.6	42.5	81.43	84.2
Draper Avenue Sewer System											
	15A	38	38	1.38		0	1.47	1.47	2.85	2.85	6.6
	15B	135	173	2.2		0		1.47	2.2	5.05	8.9
	15C	230	403	0.54		0		1.47	0.54	5.59	11.1
	15D	360	763	0.84		0		1.47	0.84	6.43	14.7
	15E	905	1668	4.13		0		1.47	4.13	10.56	24.2
	15F	251	1919	2.98		0	0.5	1.97	3.48	14.04	28.0
	15G	111	2030	0.94		0	0.25	2.22	1.19	15.23	29.5
Morrison Drive Sewer (Lower Reach)											
25723	15		6501			11.18		11.82	0	96.66	106.5
25722	16		6501	0.38	1.88	13.06		11.82	2.26	98.92	108.0
25720	17	154	6655	2.07	0.84	13.9		11.82	2.91	101.83	110.7

Population increase based on JFSA XPSWMM Modelling - max allowable increase for freeboard >= 0.30 m.

Domestic Flow - Existing	300 (L/per/day)
Domestic Flow Proposed	350 (L/per/day)
Correction Factor Dom ¹ (Harmon Equation)	0.6
Extraneous Flow	0.5 L/s/ha
Commercial	17000 L/ha/day
Institutional	10000
Industrial	10000
Peaking Factor non-res	1

¹Correction factor for proposed buildings = 1.0

Population density	
Townhouse	2.7
Apartment 1 Bedroom	1.4
Apartment 2 Bedroom	2.1
Apartment 3 Bedroom	3.1

Total Population Increase

Existing Townhouses	5*12 units	162 persons
Proposed New		650 persons
Difference		488
1/3 will be added at Link 1		217 persons
2/3 will be added at Link 2		433 L/s

Table 1 - Comparison of Existing Conditions HGL results based on different Sanitary Sewer pipe layouts and Modelling Programs.

City MH ID	Underside of Footing Elevation (m) ¹	Novatech 2009 Existing Conditions ²		XPSWMM Replica of Novatech 2009 Model ²		XPSWMM Model with Stantec 2012 Survey data ³	
		HGL (m)	Freeboard (m)	HGL (m)	Freeboard (m)	HGL (m)	Freeboard (m)
25697	N/A	73.87	N/A	73.77	N/A	N/A	N/A
25698	N/A	71.28	N/A	71.20	N/A	71.30	N/A
25699	N/A	68.75	N/A	68.69	N/A	69.18	N/A
25700	N/A	67.88	N/A	67.81	N/A	68.99	N/A
25701	67.50	66.07	1.43	66.00	1.50	66.07	1.43
25702	66.65	65.68	0.97	65.61	1.04	65.69	0.96
25703	66.25	65.44	0.81	65.38	0.87	65.44	0.81
25704	66.50	65.12	1.38	65.12	1.39	65.20	1.30
25704i ⁴	N/A	N/A	N/A	N/A	N/A	64.95	N/A
25705	65.50	65.09	0.41	64.97	0.53	64.93	0.57
25706	65.40	65.07	0.33	64.94	0.46	64.92	0.48
25707	N/A	64.90	N/A	64.90	N/A	64.87	N/A
25708	N/A	64.85	N/A	64.82	N/A	64.74	N/A
43673	65.15	64.82	0.33	64.78	0.37	64.67	0.48
25709	67.08	64.77	2.31	64.74	2.34	64.63	2.45
25710	N/A	64.69	N/A	64.66	N/A	64.55	N/A
25711	N/A	64.59	N/A	64.57	N/A	64.46	N/A
25712	N/A	64.57	N/A	64.55	N/A	64.43	N/A
25713	N/A	64.55	N/A	64.53	N/A	64.41	N/A
25714	N/A	64.54	N/A	64.53	N/A	64.41	N/A
25715	N/A	64.54	N/A	64.52	N/A	64.40	N/A
25723	N/A	64.53	N/A	64.52	N/A	64.39	N/A
25722	N/A	64.51	N/A	64.51	N/A	64.37	N/A
25721	N/A	64.50	N/A	64.51	N/A	64.37	N/A
25720	N/A	64.49	N/A	64.50	N/A	64.36	N/A
25719	N/A	64.48	N/A	64.50	N/A	64.36	N/A

¹Underside of footing elevation as estimated by Novatech in their January 2009 report titled *Morrison Court Development Wastewater servicing Study*.

²Sanitary sewer layout as per Novatech 2009 survey

³Sanitary sewer layout as per a survey conducted by Stantec in August 2012.

⁴During the survey conducted by Stantec in August 2012, they identified a maintenance hole between City structures 25704 and 25705. This structure is referred to as 25704i for the purposes of this study.

Note 1: Freeboard distances have only been calculated at maintenance holes where Novatech calculated/reported an underside of footing elevation. N/A in the freeboard column denotes missing USF data.

Note 2: Hydraulic Gradeline elevations have not been calculated at all location in each model due to data gaps. N/A in the HGL column denotes missing pipe data for that particular model.

Table 2 - Existing Conditions, Phase 1 and Phase X Hydraulic Gradeline Results

City MH ID	Underside of Footing Elevation (m) ¹	Novatech 2009 Existing Conditions ²		XPSWMM Model Existing Condition ³		XPSWMM Proposed Phase I Condition ³		XPSWMM Proposed Phase X Condition ⁴	
		HGL (m)	Freeboard (m)	HGL (m)	Freeboard (m)	HGL (m)	Freeboard (m)	HGL (m)	Freeboard (m)
25697	N/A	73.87	N/A	N/A	N/A	N/A	N/A	N/A	N/A
25698	N/A	71.28	N/A	71.30	N/A	71.32	N/A	71.32	N/A
25699	N/A	68.75	N/A	69.18	N/A	69.27	N/A	69.38	N/A
25700	N/A	67.88	N/A	68.99	N/A	69.00	N/A	69.00	N/A
25701	67.50	66.07	1.43	66.07	1.43	66.09	1.41	66.11	1.39
25702	66.65	65.68	0.97	65.69	0.96	65.71	0.94	65.73	0.92
25703	66.25	65.44	0.81	65.44	0.81	65.47	0.78	65.49	0.76
25704	66.50	65.12	1.38	65.20	1.30	65.21	1.29	65.23	1.27
25704i ⁵	N/A	N/A	N/A	64.95	N/A	64.97	N/A	65.03	N/A
25705	65.50	65.09	0.41	64.93	0.57	64.96	0.54	65.04	0.47
25706	65.40	65.07	0.33	64.92	0.48	64.94	0.46	65.02	0.39
25707	N/A	64.9	N/A	64.87	N/A	64.89	N/A	64.96	N/A
25708	N/A	64.85	N/A	64.74	N/A	64.80	N/A	64.90	N/A
43673	65.15	64.82	0.33	64.67	0.48	64.75	0.40	64.84	0.31
25709	67.08	64.77	2.31	64.63	2.45	64.70	2.38	64.77	2.31
25710	N/A	64.69	N/A	64.55	N/A	64.59	N/A	64.64	N/A
25711	N/A	64.59	N/A	64.46	N/A	64.47	N/A	64.49	N/A
25712	N/A	64.57	N/A	64.43	N/A	64.44	N/A	64.46	N/A
25713	N/A	64.55	N/A	64.41	N/A	64.42	N/A	64.43	N/A
25714	N/A	64.54	N/A	64.41	N/A	64.41	N/A	64.42	N/A
25715	N/A	64.54	N/A	64.40	N/A	64.41	N/A	64.42	N/A
25723	N/A	64.53	N/A	64.39	N/A	64.39	N/A	64.40	N/A
25722	N/A	64.51	N/A	64.37	N/A	64.37	N/A	64.38	N/A
25721	N/A	64.50	N/A	64.37	N/A	64.37	N/A	64.37	N/A
25720	N/A	64.49	N/A	64.36	N/A	64.36	N/A	64.36	N/A
25719	N/A	64.48	N/A	64.36	N/A	64.36	N/A	64.36	N/A

¹Underside of footing elevation as estimated by Novatech in their January 2009 report titled *Morrison Court Development Wastewater servicing Study*.

²Sanitary sewer layout as per Novatech 2009 survey

³Sanitary sewer layout as per a survey conducted by Stantec in August 2012.

⁴Phase X condition is a test case to determine the maximum sanitary flow increase from the proposed development that will result in a minimum freeboard of no less than 0.30 m. Modelled flow increase = 8 L/s.

⁵During the survey conducted by Stantec in August 2012, they identified a maintenance hole between City structures 25704 and 25705. This structure is referred to as 25704i for the purposes of this study.

Note 1: Freeboard distances have only been calculated at maintenance holes where Novatech calculated/reported an underside of footing elevation. N/A in the freeboard column denotes missing USF data.

Note 2: Hydraulic Gradeline elevations have not been calculated at all location in each model due to data gaps. N/A in the HGL column denotes missing pipe data for that particular model.

Alison Gosling

From: C. Brennan <cbrennan@jfsa.com>
Sent: January-21-13 2:51 PM
To: 'natan'; 'Andrew Finnson'
Cc: 'J.F. Sabourin'; 'Lloyd Phillips'
Subject: RE: Morrison Drive MH's
Attachments: 20130114 - Hydraulic Gradeline Results + Sanitary Design.pdf

Follow Up Flag: Follow up
Flag Status: Flagged

Hello Andrew,

As requested by your office and Greatwise Developments Corporation (Greatwise), J.F. Sabourin and Associates Inc. (JFSA) have completed our hydraulic analysis of the existing Morrison Drive sanitary sewer system. This analysis is meant to augment the findings that JFSA provided to Greatwise in August 2012. During the previous analysis it was determined that the existing sanitary sewer along Morrison Drive had sufficient capacity to convey the sanitary flow increases from Phase I of the proposed Morrison Court development while maintaining a freeboard of greater than 0.30 m at the critical location, MHSA43673. The current analysis has been undertaken to determine the maximum peak sanitary flow increase from the proposed development that would still result in a freeboard of greater than 0.30 m along the existing Morrison Drive sanitary sewer.

JFSA updated the sanitary sewer design calculations and XPSWMM model of the existing sanitary sewer to determine the maximum flow increase that would meet the 0.30 m freeboard criterion. Based on that analysis it was determined that an overall peak sanitary flow increase of **8 L/s** will result in a freeboard of 0.31 m at the critical location, MHSA43673, along the existing sanitary sewer. Please refer to the Hydraulic Gradeline Results and Sanitary Design sheets attached, these results supersede the tables that were submitted in August 2012. As is illustrated in the sanitary design table for Phase X, the scenario that was used to arrive at the max allowable peak flow increase of 8 L/s is a new development with a population of 650 replacing five (5) of the existing townhouses (population of 162) for a net population increase of 488. Please note that the freeboard calculations are based on the hydraulic gradeline results from JFSA's XPSWMM model and the underside of footing determinations made by Novatech in their January 26, 2009 report titled *Morrison Court Development Wastewater Servicing Study*.

Please contact me if you have any questions or comments,
Kind Regards

Colin Brennan, B.A.Sc.
Water Resources EIT



J.F. Sabourin and Associates Inc.
52 Springbrook Drive , Ottawa , ON K2S 1B9
tel.: 613.836.3884 ext. 224, fax: 613.836.0332, www.jfsa.com

From: natan [mailto:natan@gsregalgroup.com]
Sent: Tuesday, January 08, 2013 3:21 PM
To: 'Andrew Finnson'

Cc: 'J.F. Sabourin'; 'Lloyd Phillips'; cbrennan@jfsa.com

Subject: RE: Morrison Drive MH's

Andrew

Can we start with a conference call on Thursday Jan 10th

I recommend for Colin, you, Lloyd and me to be there.

Do we need James!

If the time is acceptable to all I will send the conference access info to ALL

Regards

Natan

From: Andrew Finnson [mailto:afinnson@dsel.ca]

Sent: January-08-13 1:43 PM

To: cbrennan@jfsa.com; 'natan'

Cc: 'J.F. Sabourin'; 'Lloyd Phillips'

Subject: RE: Morrison Drive MH's

Hi Natan,

Colin's email below states that they would like to have a meeting to discuss the sanitary analysis and make sure that we're all on the same page. Can you suggest a time that would work for you so we can try to set something up?

Thanks,

Andrew Finnson, P.Eng.

DSEL

david schaeffer engineering ltd

phone: (613) 836-0856 ext 229

cell: (613) 222-4957

e-mail: afinnson@DSEL.ca

From: C. Brennan [mailto:cbrennan@jfsa.com]

Sent: Tuesday, December 18, 2012 7:00 PM

To: 'Andrew Finnson'

Cc: 'J.F. Sabourin'; 'natan'; 'Lloyd Phillips'

Subject: RE: Morrison Drive MH's

Hello Andrew,

We can perform such an analysis. It would involve additional work in comparison to the quote provided below and we would like to have a brief meeting with the team to confirm the conclusions that can be drawn from such an analysis and how the project could progress from there. To perform the aforementioned our fee would be \$1,250 + tax. A meeting with the City may be required to confirm that our approach will be acceptable to them, which would be charged at our standard hourly rates.

Kind Regards,

Colin

Colin Brennan, B.A.Sc.

Water Resources EIT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive , Ottawa , ON K2S 1B9
tel.: 613.836.3884 ext. 224, fax: 613.836.0332, www.jfsa.com

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Thursday, December 13, 2012 9:56 AM
To: cbrennan@jfsa.com
Cc: 'J.F. Sabourin'; 'natan'; 'Lloyd Phillips'
Subject: RE: Morrison Drive MH's

Hi Colin,

I've discussed this with Natan at Greatwise and what they'd like to see (since we're looking at this again) is a maximum number of units, or maximum population that could be accommodated without the need for a downstream upgrade. This analysis should show that the additional units can be accommodated, as well as give a bit of a buffer in the event that there are any site plan changes. Are you able to complete this analysis for the fee quoted below or would additional fees be required to complete this type of analysis?

Thanks,

Andrew Finnson, P.Eng.

DSEL
david schaeffer engineering ltd

phone: (613) 836-0856 ext 229
cell: (613) 222-4957
e-mail: afinnson@DSEL.ca

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Wednesday, December 12, 2012 3:14 PM
To: 'Andrew Finnson'
Cc: 'J.F. Sabourin'
Subject: RE: Morrison Drive MH's

Hi Andrew,

I can introduce that flow increase into our hydraulic model and confirm if Phase I can still go ahead without improving the existing sanitary sewer system. It will take about a half day to update everything and respond via email. To perform this check our fee would be \$ 500.

Let me know if you would like me to proceed.

Colin

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Monday, December 10, 2012 11:11 AM

To: cbrennan@jfsa.com

Subject: RE: Morrison Drive MH's

Hi Colin,

I've been told that they are making some minor adjustments to unit counts for the Greatwise - Morrison Drive development. Basically they are converting 5 - 2 bedroom units to 10 - 1 bedroom units. They have asked me to confirm that this will still work without upgrading the downstream sewer. Are you able to confirm that this should still work?

Give me a call if you have any questions.

Thanks,

Andrew Finnon, P.Eng.

DSEL
david schaeffer engineering ltd

phone: (613) 836-0856 ext 229

cell: (613) 222-4957

e-mail: afinnson@DSEL.ca

From: C. Brennan [<mailto:cbrennan@jfsa.com>]

Sent: Friday, August 24, 2012 11:07 AM

To: 'Andrew Finnon'

Cc: jfsabourin@jfsa.com

Subject: RE: Morrison Drive MH's

Hi Andrew,

As requested, we have assessed the HGL elevations along the Morrison Drive sanitary sewer under ultimate (Phase I and II) flow conditions. Sanitary flows are based on Novatech's 2009 design, with a peak flow of 112.4 L/s at the downstream end of the system. The minimum freeboard for this condition at MHSA43673 is 0.26 m, less than the City's minimum allowable freeboard of 0.30 m.

Regards,

Colin

From: Andrew Finnon [<mailto:afinnson@dsel.ca>]

Sent: Friday, August 24, 2012 9:19 AM

To: cbrennan@jfsa.com

Subject: RE: Morrison Drive MH's

Colin,

The latest sanitary design sheets are attached. The ultimate flow from the site is 12.08 L/s.

Thanks,

Andrew

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Wednesday, August 22, 2012 2:27 PM
To: 'Andrew Finnson'
Cc: 'J.F. Sabourin'
Subject: RE: Morrison Drive MH's

Hello Andrew,

As requested by your office, on behalf of Greatwise Developments Corporation, J.F. Sabourin and Associates Inc. (JFSA) have completed our modelling exercise along the Morrison Drive sanitary sewer line under both existing and proposed phase I development conditions. A preliminary assessment of the sanitary sewer capacity was previously undertaken by Novatech Engineering Consultants Ltd. (Novatech) as described in their January 26, 2009 report titled *Morrison Court Development Wastewater Servicing Study*. In that study, Novatech found that at the most critical location, MHSA43673, the existing freeboard between the Hydraulic Gradeline (HGL) in the sanitary sewer system and the lowest connected underside of footing (USF) elevation is 0.33 m. Novatech also assessed the HGL within the system under proposed development flows whereby seven (7) 12-unit townhomes (population of 223) would be replaced with a new development having a total population of 929 (representing a population increase of 702 persons). Novatech found that the peak flow at the Pinecrest Trunk confluence would increase from 104.2 L/s under existing conditions to 112.4 L/s under proposed conditions. They found that this flow increase resulted in increased HGL elevations such that, the minimum freeboard at MHSA43673 would be reduced to 0.12 m. Novatech therefore concluded that the existing system does not have adequate capacity for the entire proposed development and recommended increasing the diameter of 423 mm of pipe between MHSA25705 and MHSA25711 to 375 mm at 0.14% slope, which would provide a minimum freeboard of 0.41 m.

JFSA conducted our modelling of the sanitary sewer system using XPSWMM version 10.6, while Novatech had previously used H2OMAP Sewer/Pro. It is therefore anticipated that JFSA will arrive at slightly different results than Novatech when modelling the same system. Table 1, attached, indicates that at MHSA43673 where Novatech modelled a freeboard of 0.33 m, the JFSA XPSWMM model indicates that there is a 0.37 m freeboard. Previous modelling was based on a survey conducted by Novatech during the work for their January 2009 report. Pipe lengths and dimensions from the Novatech survey and As Built plans agree with one another and have been taken as correct in JFSA's work. The sanitary pipe inverts were verified/confirmed however, using the results from a field survey conducted by Stantec Consulting Ltd. in August 2012. It is important to note that Stantec located a maintenance hole between MHSA25704 and MHSA25705, this maintenance hole has been included in JFSA's models and labelled as 25704i for the purposes of this work. Furthermore, Stantec's structure SMH2 (correlates to city MHSA25697) was not included in the JFSA modelling as: 1) the measured invert does not agree well with the As Built data and 2) that pipe is upstream of the proposed site and lowest freeboard locations. Similarly, Stantec structures SMH38, SMH39 and SMH40 appear to be a parallel sanitary line to the Morrison sewer and do not appear to have City structure ID's, therefore, JFSA was instructed by DSEL to neglect these three (3) structures as noted in the correspondence below. A graph demonstrating the Morrison Drive sanitary sewer invert elevation as per the: Novatech 2009 survey, Stantec 2012 survey and As Built plans is attached for reference, note that the first node is MHSA25698 and the final node is MHSA25759. The final two columns of attached Table 1 provide JFSA's modelling results under existing flow conditions based on the Stantec surveyed inverts. In updating the XPSWMM model to reflect the Stantec 2012 survey rather than the Novatech 2009 survey the modelled HGL elevations were reduced, such that, the minimum freeboard at MHSA43673 based on JFSA's model is 0.49 m. This freeboard is above the minimum allowable freeboard of 0.30 m as per the *City of Ottawa Sewer Design Guidelines* (November 2004).

JFSA was retained to assess the HGL elevations under the currently proposed Phase I development conditions rather than ultimate development conditions. The proposed Phase I construction will result in the demolition of four (4) existing townhouse buildings and the construction of three (3) 4-storey buildings two of which are for residential use while one is to be mixed use commercial/residential. The net impact of the proposed Phase I development is a population increase of 220 persons (350 - 130) and 600 m² of Commercial floor space (equivalent to 10L/s of sanitary flow), which results in a peak flow at the confluence with the Pinecrest trunk sewer of 106.2 L/s. Sanitary flow sheets

are attached for both existing and Phase I development conditions. Table 2, attached, provides a comparison the HGL results from the Novatech 2009 existing modelling, the JFSA XPSWMM existing modelling and the JFSA XPSWMM modelling for proposed Phase I flow conditions. The minimum freeboard calculated along the existing Morrison Drive sanitary sewer under Phase I flows was 0.44 m, which occurs at MHSA43673. Therefore, based on the JFSA XPSWMM model, and the Novatech 2009 USF elevations, the minimum freeboard under Phase I development flows will be 0.44 m, which is greater than the City of Ottawa's minimum allowable value of 0.30 m.

Please contact myself if you have any questions or comments.

Kind Regards,

Colin Brennan, B.A.Sc.

Water Resources EIT



J.F. Sabourin and Associates Inc.

52 Springbrook Drive , Ottawa , ON K2S 1B9

tel.: 613.836.3884 ext. 224, fax: 613.836.0332, www.jfsa.com

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]

Sent: Wednesday, August 22, 2012 10:13 AM

To: cbrennan@jfsa.com

Subject: RE: Morrison Drive MH's

Colin,

Jamie at Stantec has confirmed that it is in fact a typo. It's 1 metre high. The actual invert is 64.53.

Andrew

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]

Sent: Wednesday, August 22, 2012 10:02 AM

To: 'cbrennan@jfsa.com'

Subject: RE: Morrison Drive MH's

Colin,

I've left a message with Jamie. Please proceed. I'll make sure we get confirmation from him asap.

Thanks,

Andrew

From: C. Brennan [<mailto:cbrennan@jfsa.com>]

Sent: Wednesday, August 22, 2012 8:32 AM

To: 'Andrew Finnson'

Subject: RE: Morrison Drive MH's

Thanks Andrew.

Colin

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Wednesday, August 22, 2012 8:29 AM
To: cbrennan@jfsa.com
Subject: RE: Morrison Drive MH's

Hi Colin,
Your assumptions below are correct. 3 townhouse buildings will remain in Phase I and 4 will be demolished.

Thanks,
Andrew

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Wednesday, August 22, 2012 8:25 AM
To: 'Andrew Finnson'
Subject: RE: Morrison Drive MH's

Hi Andrew,

No problem including the new Phase 1 population numbers. Just to confirm though, from the in-progress base plan I received from you it seems like Phase 1 construction will replace four (4) of the existing Townhouses ($4 * 12 \text{ units} * 2.7 = 130$ persons). Will the other three (3) existing townhouses remain during Phase 1 ($3 * 12 * 2.7 = 97$ persons), is this correct?

I am assuming that the proposed Phase 1 buildings will contribute flow from 350 persons which replaces flow from 130 persons, representing a net increase of 220 persons for Phase I.

Colin

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Tuesday, August 21, 2012 9:29 AM
To: cbrennan@jfsa.com
Subject: RE: Morrison Drive MH's

Hi Colin,
We've just received a new plan with minor revisions to the unit counts for phase 1, and therefore minor revisions to the sanitary flow. If it's possible to revise the flows to match the updated plan without causing you further delay please do so, otherwise please proceed with the previous numbers you have.

Thanks,
Andrew

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Tuesday, August 21, 2012 9:31 AM
To: 'Andrew Finnson'
Cc: jfsabourin@jfsa.com; spichette@dsel.ca
Subject: RE: Morrison Drive MH's

Hi Andrew,

I am currently running various modelling scenarios for Monahan to respond to the RVCA letter from Bruce Reid. Therefore, I will not be able to provide the Sanitary modelling results to you today. Sorry for the delay, I will plan to return to that file first thing tomorrow morning.

Regards,
Colin

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Tuesday, August 21, 2012 8:17 AM
To: cbrennan@jfsa.com
Subject: RE: Morrison Drive MH's

Hi Colin,
Do you have something you can send me today? I need to get this incorporated into a report which needs to be submitted to the client tomorrow.

Thanks,
Andrew

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Friday, August 17, 2012 1:09 PM
To: 'Andrew Finnson'
Cc: 'J.F. Sabourin'
Subject: RE: Morrison Drive MH's

Hi Andrew,

I've just come across another discrepancy. Where Stantec picks up three (3) sanitary manholes, SMH25, SMH26 and SMH27, the Novatech drawings and model only show two manholes (25705 and 25706). I'm inclined to trust the Stantec survey and add another manhole and pipe (approx. 17 m long) to the model.

Could you please check with Stantec and advise if the above assumption should be used or not.

Regards,
Colin

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Friday, August 17, 2012 11:20 AM
To: cbrennan@jfsa.com
Cc: 'J.F. Sabourin'
Subject: RE: Morrison Drive MH's

Hi Colin,
I will follow up with Stantec but according to the as-builts the below assumptions are correct. Please proceed on that basis.

Thanks,
Andrew

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Friday, August 17, 2012 11:21 AM
To: 'Andrew Finnson'
Cc: 'J.F. Sabourin'
Subject: RE: Morrison Drive MH's

Hi Andrew,

As a follow-up to our phone conversation I would like to confirm the assumptions that I am to make with respect to the sanitary survey data prepared by Stantec.

1. Due to a discrepancy between the new and old inverts at SMH2 (25697) and the second south invert at SMH4 (25698), JFSA will only model from SMH4 (25698) downstream pending clarification from DSEL/Stantec.
2. The following three (3) manholes seem to be a parallel line which are not noted on the As Built drawings in DSEL's possession, SMH 38, SMH 39 and SMH 40. Therefore these manholes will be neglected in our analysis. We are under the assumption that SMH37 corresponds to the City MH 25711 and SMH41 corresponds to City MH 25712 and that these two manholes are connected by a 63.5 m long 375 mm diameter concrete sanitary pipe.
3. There is a discrepancy from SMH37 to SMH49 with respect to pipe sizes. The sizes recorded by Stantec will be neglected in favour of the sizes included in DSEL's EPA SWMM model, which are based on the As Built Drawings. Pipe diameters to be used are as follows:
 - SMH37 (25711) to SMH44 (25715) - 375 mm concrete
 - SMH44 (25715) to SMH49 (25719) - 600 mm concrete
4. Except as noted above, the pipe inverts and top of grate elevations recorded by Stantec will be taken as correct and used in all subsequent hydraulic (XPSWMM) modelling.

Please advise if any of the preceding assumptions are incorrect, or if clarification is provided by Stantec.

Regards,
Colin

Colin Brennan, B.A.Sc.
Water Resources EIT



J.F. Sabourin and Associates Inc.
52 Springbrook Drive , Ottawa , ON K2S 1B9
tel.: 613.836.3884 ext. 224, fax: 613.836.0332, www.jfsa.com

From: C. Brennan [<mailto:cbrennan@jfsa.com>]
Sent: Friday, August 17, 2012 10:05 AM
To: 'Andrew Finnson'
Cc: 'J.F. Sabourin'
Subject: RE: Morrison Drive MH's

Hi Andrew,

I've been reviewing the Stantec Storm and Sanitary manhole survey and would like a few clarifications.

specifically:

1. there two (2) pipes coming into the South side of Structure 4. What is the second pipe, and which one represents the main sewer line.
2. There are more sanitary manholes in the NE portion of Morrison Road than recorded by Novatech. STM 38, 39 and 40 all seem like additions.
3. Several pipe size and invert comments are included on the attached drawing as well.

I have attached a CAD Drawing with City Structure labels included where I believe they may apply, I will call to discuss.

Colin

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]

Sent: Monday, August 13, 2012 2:30 PM

To: cbrennan@jfsa.com

Subject: FW: Morrison Drive MH's

Colin,

See the attached survey from Stantec.

If anything is unclear let me know.

Thanks,

Andrew

From: Leslie, Jamie [<mailto:Jamie.Leslie@stantec.com>]

Sent: Monday, August 13, 2012 2:24 PM

To: Andrew Finnson

Subject: RE: Morrison Drive MH's

Hi Andrew,

Sorry for the delay. Here is the CAD file for our MH pickup and invert measurements. Let me know if you have any questions. Thank you.

Jamie Leslie, OLS, OLIP, EIT

Project Manager

Stantec Geomatics Ltd.

1505 Laperriere Avenue

Ottawa ON K1Z 7T1

Ph: (613) 722-4420 Ext. 592

Fx: (613) 722-2799

Jamie.Leslie@stantec.com

stantec.com

The content of this email is the confidential property of Stantec and should not be copied, modified, retransmitted, or used for any purpose except with Stantec's written authorization. If you are not the intended recipient, please delete all copies and notify us immediately.

 Please consider the environment before printing this email.

From: Andrew Finnson [<mailto:afinnson@dsel.ca>]
Sent: Friday, August 10, 2012 11:08 AM
To: Leslie, Jamie
Subject: RE: Morrison Drive MH's

Monday morning is fine Jamie. Have a good weekend.

Thanks,
Andrew

From: Leslie, Jamie [<mailto:Jamie.Leslie@stantec.com>]
Sent: Friday, August 10, 2012 11:10 AM
To: Andrew Finnson (afinnson@dsel.ca)
Subject: Morrison Drive MH's

Hi Andrew,


I just wanted to update you on the status of the Morrison Drive MH pickup. We are finalizing the CAD file now. I do have to step out shortly for a meeting this afternoon. I'm not sure if I will return to the office this afternoon. Unless you require this information later this afternoon, I will forward you the drawing first thing Monday morning. If you do require it, I will have it sent to you by my CAD person when it is finished. Let me know your thoughts. Thank you.

Jamie Leslie, OLS, OLIP, EIT
Project Manager
Stantec Geomatics Ltd.
1505 Laperriere Avenue
Ottawa ON K1Z 7T1
Ph: (613) 722-4420 Ext. 592
Fx: (613) 722-2799
Jamie.Leslie@stantec.com
stantec.com

The content of this email is the confidential property of Stantec and should not be copied, modified, retransmitted, or used for any purpose except with Stantec's written authorization. If you are not the intended recipient, please delete all copies and notify us immediately.

 Please consider the environment before printing this email.

CITY OF OTTAWA - SANITARY TRUNK SEWERS AND COLLECTION AREAS

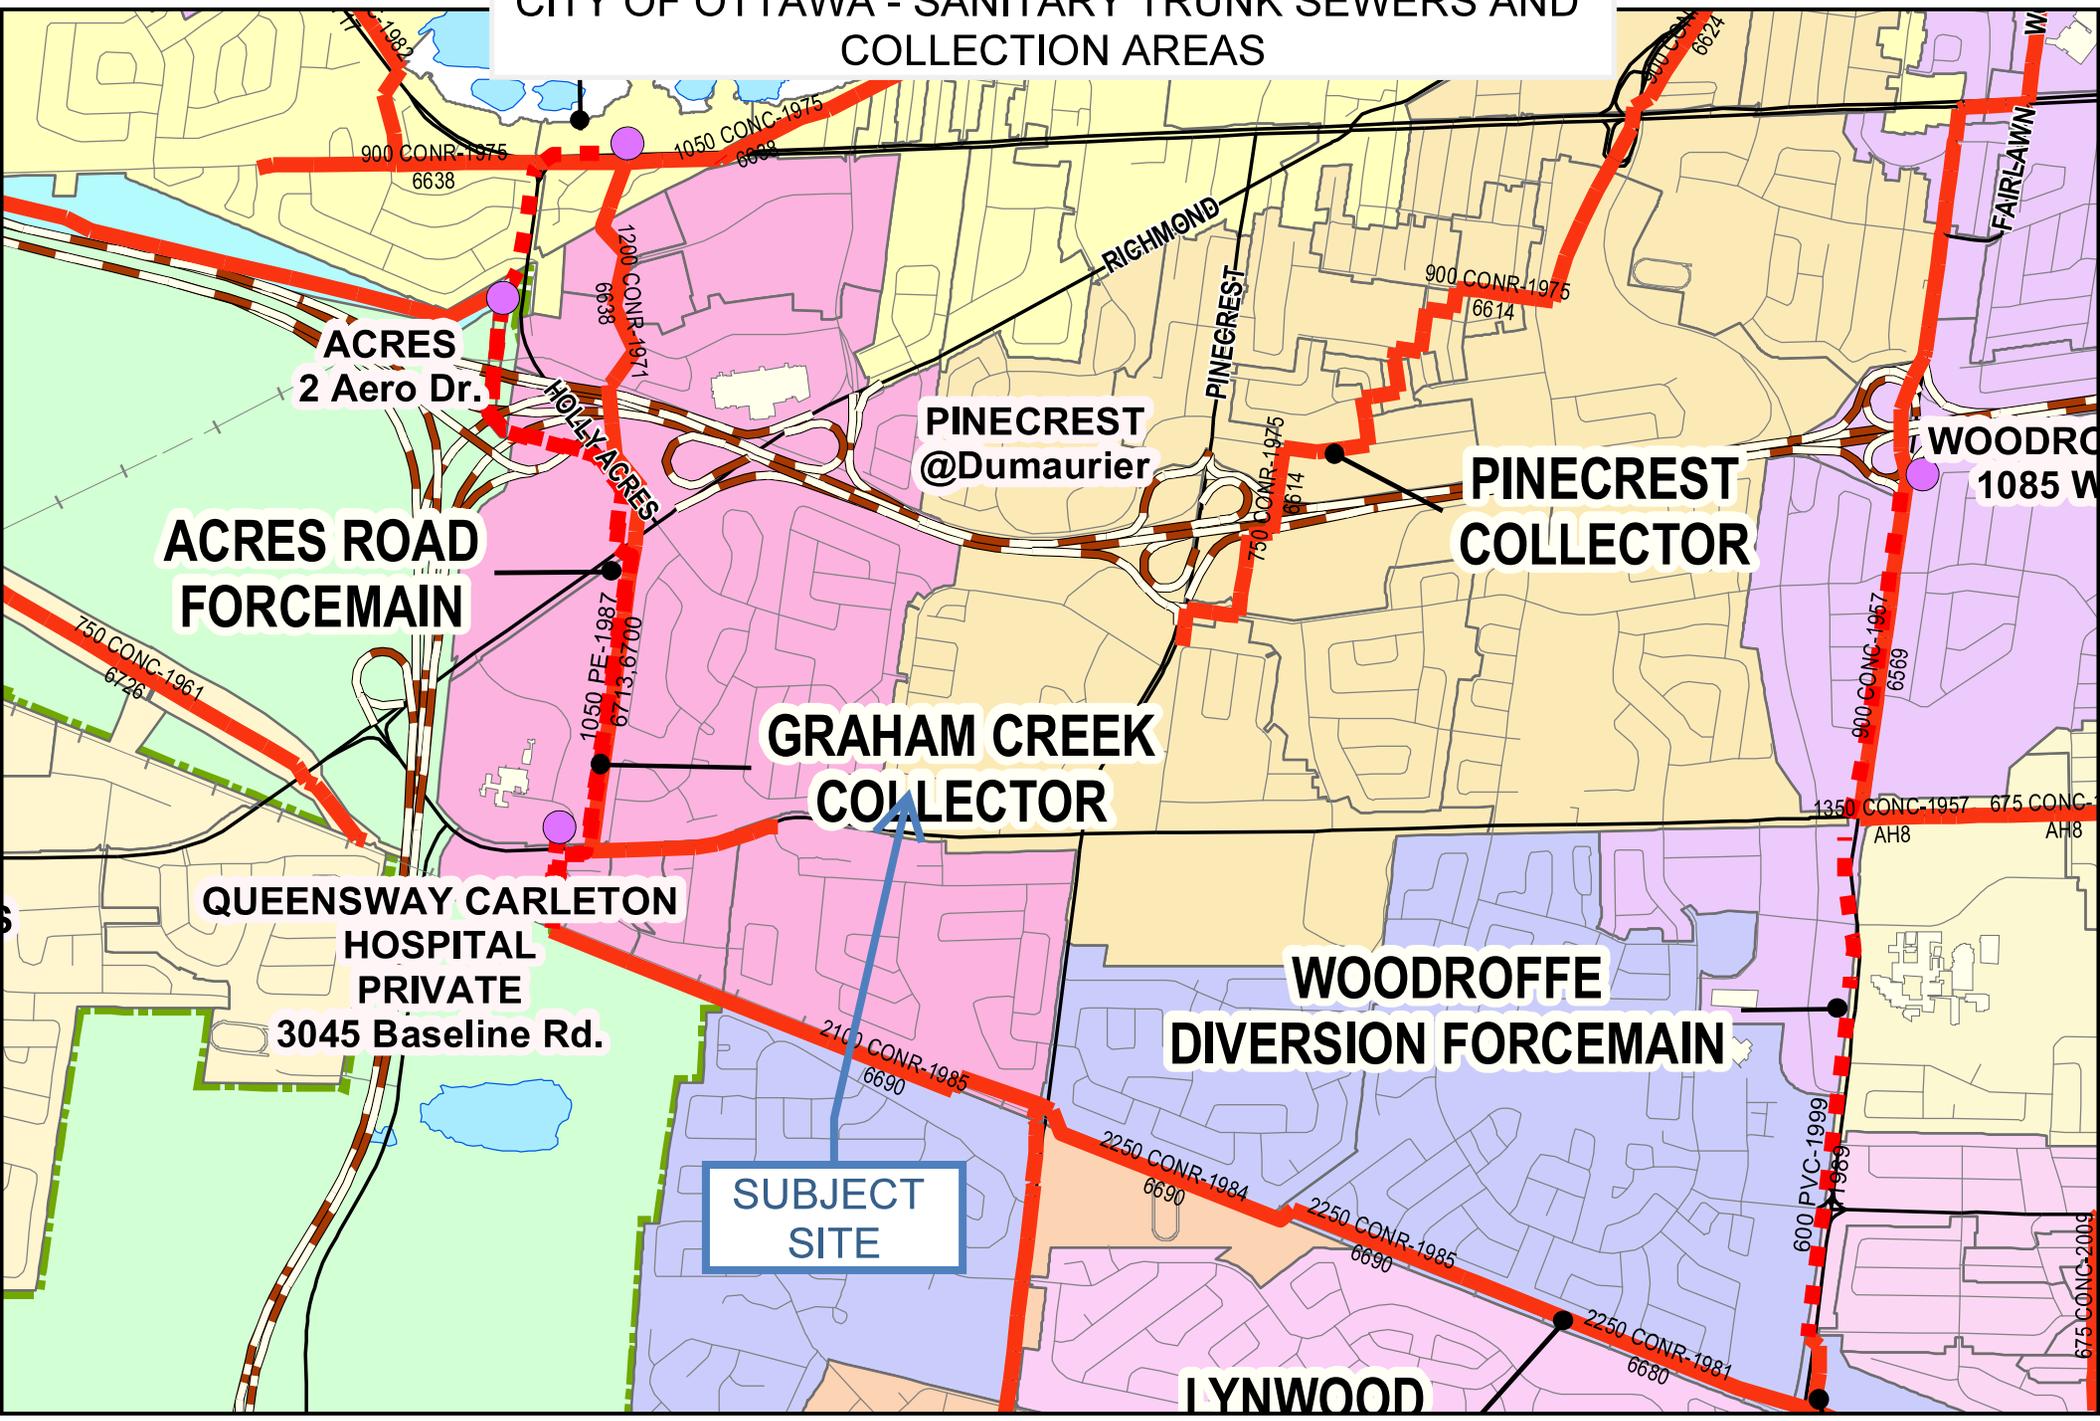

ACRES
2 Aero Dr.

**ACRES ROAD
FORCEMAIN**

**PINECREST
@Dumaurier**

**PINECREST
COLLECTOR**

WOODROFFE
1085 W

**GRAHAM CREEK
COLLECTOR**

**QUEENSWAY CARLETON
HOSPITAL
PRIVATE**
3045 Baseline Rd.

**WOODROFFE
DIVERSION FORCEMAIN**

**SUBJECT
SITE**

LYNWOOD



APPENDIX D

Stormwater Management

Greatwise Developments
 2785 2795 Baseline Road
 Storm Sewer Calculation Sheet

Area ID	Up	Down	Area (ha)	C (-)	Indiv AxC	Acc AxC	T _c (min)	I _{2-year} (mm/hr)	Q (L/s)	Sewer Data									
										DIA (mm)	Slope (%)	Length (m)	A _{hydraulic} (m ²)	R (m)	Velocity (m/s)	Qcap (L/s)	Time Flow (min)	Q / Q full (-)	
NYLABERRY PRIVATE																			
	100	101	0.227	0.80	0.18	0.18	10.0	76.8	38.7	375	0.30	68.2	0.110	0.094	0.87	96.0	1.3	0.40	
Sitr Entrance, Pipe 101 - 102																			
							11.3												
SITE ENTRANCE																			
	101	102			0.00	0.18	11.3	72.1	36.4	375	0.47	25.5	0.110	0.094	1.09	120.2	0.4	0.30	
Tillandsia Private, Pipe 103 - 104																			
							11.7												
TILLANDSIA PRIVATE																			
	102	104	0.343	0.85	0.29	0.47	11.7	70.8	93.1	450	0.30	33.4	0.159	0.113	0.98	156.2	0.6	0.60	
	104	105	0.185	0.81	0.15	0.62	12.3	69.1	119.5	450	0.30	35	0.159	0.113	0.98	156.2	0.6	0.77	
	105	AS-3			0.00	0.62	12.9	67.3	116.5	450	1.00	1.1	0.159	0.113	1.79	285.1	0.0	0.41	
	AS-3	107				0.62	12.9	67.3	116.5	450	1.00	5.5	0.159	0.113	1.79	285.1	0.1	0.41	
							12.9												

FIGURE 1 - HYDROLOGIC MODEL SCHEMATIC

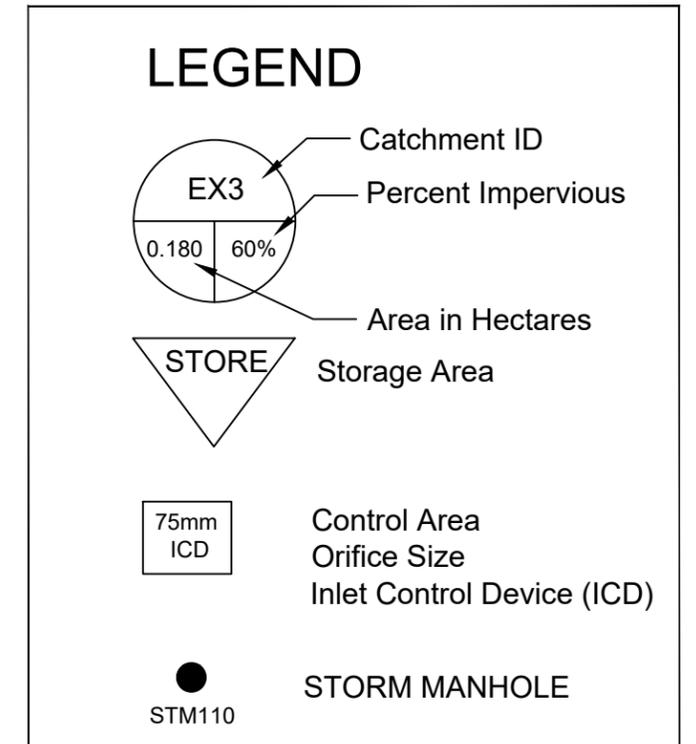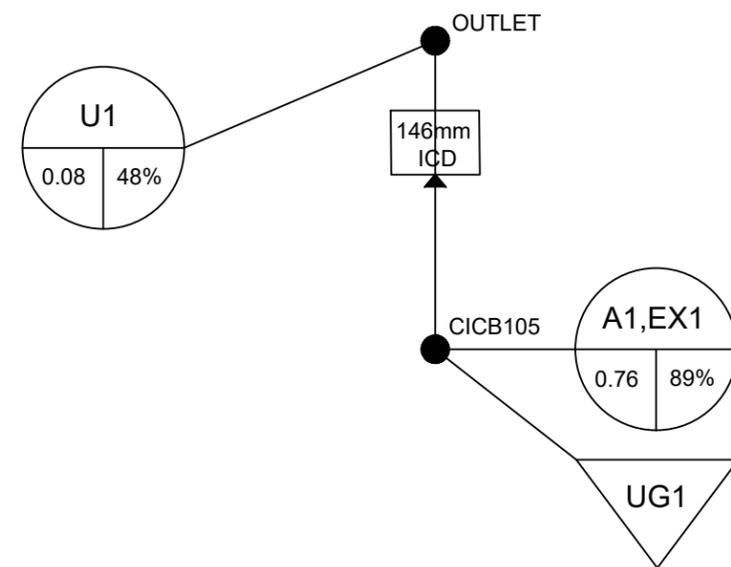

[TITLE]

;;Project Title/Notes

[OPTIONS]

;;Option	Value
FLOW_UNITS	LPS
INFILTRATION	HORTON
FLOW_ROUTING	DYNWAVE
LINK_OFFSETS	ELEVATION
MIN_SLOPE	0
ALLOW_PONDING	YES
SKIP_STEADY_STATE	NO

START_DATE	01/01/2000
START_TIME	00:01:00
REPORT_START_DATE	01/01/2000
REPORT_START_TIME	00:01:00
END_DATE	01/02/2000
END_TIME	00:00:00
SWEEP_START	01/01
SWEEP_END	12/31
DRY_DAYS	0
REPORT_STEP	00:01:00
WET_STEP	00:01:00
DRY_STEP	00:01:00
ROUTING_STEP	0:00:02

INERTIAL_DAMPING	PARTIAL
NORMAL_FLOW_LIMITED	BOTH
FORCE_MAIN_EQUATION	H-W
VARIABLE_STEP	0.75
LENGTHENING_STEP	0
MIN_SURFAREA	0
MAX_TRIALS	0
HEAD_TOLERANCE	0
SYS_FLOW_TOL	5
LAT_FLOW_TOL	5
MINIMUM_STEP	0.5
THREADS	1

[EVAPORATION]

;;Data Source	Parameters
;;-----	-----
CONSTANT	0.0
DRY_ONLY	NO

[RAINGAGES]

;;Name	Format	Interval	SCF	Source
;;-----	-----	-----	-----	-----
1	INTENSITY	0:10	1.0	TIMESERIES CH6H100

[SUBCATCHMENTS]

;;Name	Rain Gage	Outlet	Area	%Imperv	Width
%Slope	CurbLen	SnowPack			
A1-2,EX-1	1	UG1	0.755	89	76
0					1.5
U1	1	outlet	0.082	48	76
0					2

[SUBAREAS]

;;Subcatchment	N-Imperv	N-Perv	S-Imperv	S-Perv	PctZero	RouteTo
PctRouted						
A1-2,EX-1	0.013	0.25	1.57	4.67	0	OUTLET
U1	0.013	0.25	1.57	4.67	0	OUTLET

[INFILTRATION]

;;Subcatchment	MaxRate	MinRate	Decay	DryTime	MaxInfil
A1-2,EX-1	76.2	13.2	4.14	7	0
U1	76.2	13.2	4.14	7	0

[JUNCTIONS]

;;Name	Elevation	MaxDepth	InitDepth	SurDepth	Aponded
cicbmh105	72.97	1.9	0	0	0

[OUTFALLS]

;;Name	Elevation	Type	Stage	Data	Gated	Route To
outlet	72.96	FIXED	69.99		YES	

[STORAGE]

;;Name	Elev.	MaxDepth	InitDepth	Shape	Curve Name/Params
N/A	Fevap	Psi	Ksat	IMD	
UG1	73.05	1.85	0	TABULAR	cicbmh105capture
0	0				

[CONDUITS]

;;Name	From Node	To Node	Length	Roughness	InOffset
OutOffset	InitFlow	MaxFlow			
1	cicbmh105	UG1	1.1	0.013	*
*	0	0			

[ORIFICES]

;;Name	From Node	To Node	Type	Offset	Qcoeff
Gated	CloseTime				

icd	cicbmh105	outlet	BOTTOM	*	0.61
NO	0				

[XSECTIONS]

;;Link	Shape	Geom1	Geom2	Geom3	Geom4
Barrels	Culvert				

1	CIRCULAR	0.45	0	0	0
					1
icd	CIRCULAR	0.146	0	0	0

[LOSSES]

;;Link	Kentry	Kexit	Kavg	Flap Gate	Seepage

1	1.3	0	0	NO	0

[CURVES]

;;Name	Type	X-Value	Y-Value

cicbmh105capture	Storage	0	148
cicbmh105capture		0.457	148
cicbmh105capture		0.914	148
cicbmh105capture		1.371	148
cicbmh105capture		1.828	148
cicbmh105capture		1.83	0
100-YEAR	Tidal	0	94.81
100-YEAR		6	94.81
100-YEAR		12	0
100-YEAR		24	0

[TIMESERIES]

;;Name	Date	Time	Value

2yr12hrS			
2yr12hrS	FILE "P:\General Administrative\5 - DSEL Templates\Site Plan\EPASWMM Template\rainfall\2yr12hrS.dat"		
5yr12hrS			
5yr12hrS	FILE "P:\General Administrative\5 - DSEL Templates\Site Plan\EPASWMM Template\rainfall\5yr12hrS.dat"		

```

;10yr12hrS
10yr12hrS      FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\10yr12hrS.dat"
;
;25yr12hrS
25yr12hrS      FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\25yr12hrS.dat"
;
;50yr12hrS
50yr12hrS      FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\50yr12hrS.dat"
;
;100yr12hrS
100yr12hrS     FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\100yr12hrS.dat"
;
CH4H005        FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\CH4H005.dat"
;
;100-year Storm, 4 Hour Chicago Distribution
CH4H100        FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\CH4H100.dat"
;
CH6H100        FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\CH6H100.dat"
;
CH3H100        FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\CH3H100.dat"
;
;3 hour chicago storm + 20%
CH3H100x       FILE "P:\General Administrative\5 - DSEL Templates\Site
Plan\EPASWMM Template\rainfall\CH3H100x.dat"

```

```

[REPORT]
;;Reporting Options
INPUT          NO
CONTROLS       NO
SUBCATCHMENTS ALL
NODES          ALL
LINKS          ALL

```

```
[TAGS]
```

```

[MAP]
DIMENSIONS -2500.000 0.000 12500.000 10000.000
Units      None

```

```

[COORDINATES]
;;Node          X-Coord          Y-Coord
;;-----

```

cicbmh105	3373.702	6608.997
outlet	3373.702	8731.257
UG1	3362.168	5132.641

[VERTICES]

;;Link	X-Coord	Y-Coord
;;-----	-----	-----

[Polygons]

;;Subcatchment	X-Coord	Y-Coord
;;-----	-----	-----
A1-2,EX-1	4104.191	3733.179
A1-2,EX-1	3319.877	4598.231
A1-2,EX-1	2662.438	3640.907
U1	1611.880	8255.479
U1	2223.183	7574.971
U1	989.043	7563.437
U1	1658.016	8301.615

[SYMBOLS]

;;Gage	X-Coord	Y-Coord
;;-----	-----	-----
1	2301.038	9331.027

	hectare-m	10 ⁶ ltr
	-----	-----
Flow Routing Continuity		

Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.061	0.612
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	0.061	0.613
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.000	0.000
Continuity Error (%)	-0.273	

Time-Step Critical Elements

None

Highest Flow Instability Indexes

All links are stable.

Routing Time Step Summary

Minimum Time Step	:	0.50 sec
Average Time Step	:	2.00 sec
Maximum Time Step	:	2.00 sec
Percent in Steady State	:	0.00
Average Iterations per Step	:	2.01
Percent Not Converging	:	0.00

Subcatchment Runoff Summary

			Total	Total	Total	Total	Total
Total	Peak	Runoff	Precip	Runon	Evap	Infil	Runoff
Runoff	Runoff	Coeff					

Subcatchment			mm	mm	mm	mm	mm
10 ⁶ ltr	LPS						

A1-2, EX-1			82.29	0.00	0.00	5.84	75.10
0.57	358.61	0.913					
U1			82.29	0.00	0.00	27.24	54.39
0.04	37.10	0.661					

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
cicbmh105	JUNCTION	0.14	1.80	74.77	0 02:18	1.80
outlet	OUTFALL	0.00	0.00	72.96	0 00:00	0.00
UG1	STORAGE	0.13	1.73	74.78	0 02:18	1.73

Node Inflow Summary

Total Inflow Volume ltr	Flow Balance Error Percent	Type	Maximum Lateral Inflow LPS	Maximum Total Inflow LPS	Time of Max Occurrence days hr:min	Lateral Inflow Volume 10 ⁶ ltr
0.567	-0.346	JUNCTION	0.00	60.73	0 02:13	0
0.613	0.000	OUTFALL	37.10	88.04	0 01:59	0.0446
0.567	0.052	STORAGE	358.61	358.61	0 01:59	0.567

Node Surcharge Summary

Surcharging occurs when water rises above the top of the highest conduit.

Node	Type	Hours Surcharged	Max. Height Above Crown Meters	Min. Depth Below Rim Meters
cicbmh105	JUNCTION	2.41	1.347	0.103

Node Flooding Summary

No nodes were flooded.


Storage Volume Summary

of Max Occurrence	Maximum Outflow Storage Unit	Average Volume	Avg Pc	Evap Pc	Exfil Pc	Maximum Volume	Max Pc	Time
hr:min	LPS	1000 m3	Full	Loss	Loss	1000 m3	Full	days
UG1 02:18	60.73	0.019	7	0	0	0.256	100	0

Outfall Loading Summary

Outfall Node	Flow Freq Pc	Avg Flow LPS	Max Flow LPS	Total Volume 10^6 ltr
--------------	--------------	--------------	--------------	-----------------------

Analysis begun on: Tue Feb 11 09:41:33 2020
Analysis ended on: Tue Feb 11 09:41:33 2020
Total elapsed time: < 1 sec

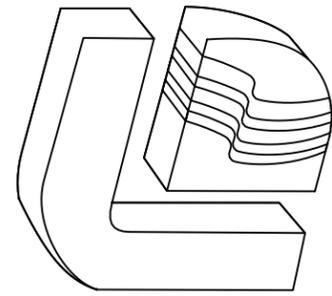


LAYFIELD

BRENTWOOD STORMTANK MODULE SHOP DRAWINGS

2795 BASELINE ROAD

Ottawa, ON

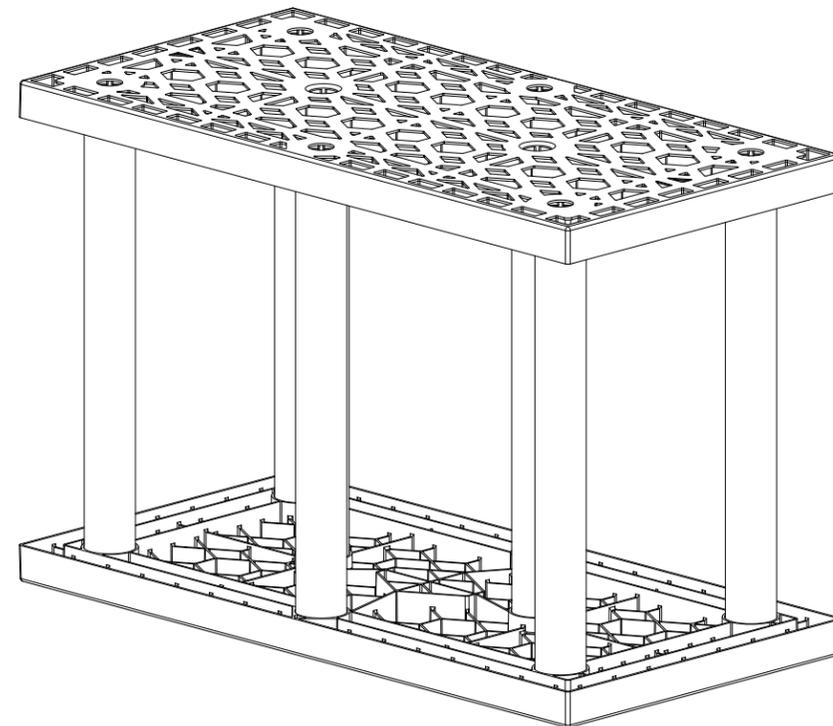

Pages:

Cover Page	01 OF 08
Module Layout	02 OF 08
Material Quantities and Notes	03 OF 08
TYP. Construction Details	04 OF 08
TYP. Pipe Penetration Details	05 OF 08
TYP. Debris Row Details	06 OF 08
Supplementary Notes	07 OF 08
Supplementary Notes	08 OF 08



117 Basaltic Rd.
Concord, ON L4K 1G4 Canada
Ph: (905) 761-9123
www.layfieldgroup.com

DOUBLE STACK MODULE SYSTEM

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25m ³
Excavation Required	393.18m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV. Record of Changes Date By

△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC

Page Name:

Cover Page

Drawn by: AC	Checked By: AW
Scale NTS	Date: 07FEB2020

Sheet:

01 OF 08






NOT INCLUDING BOTTOM STONE STORAGE



117 Basaltic Rd,
Concord, ON L4K 1G4 Canada
Ph: (905) 761-9123
www.layfieldgroup.com

TOP ROW SECTION 1

TOP ROW SECTION 2

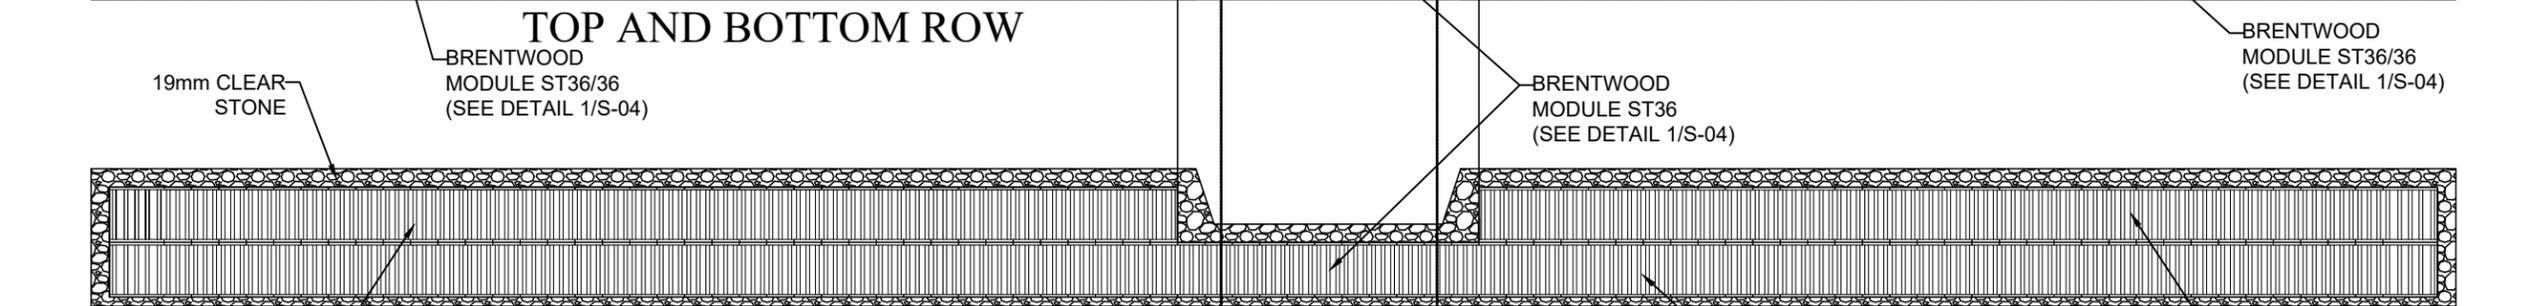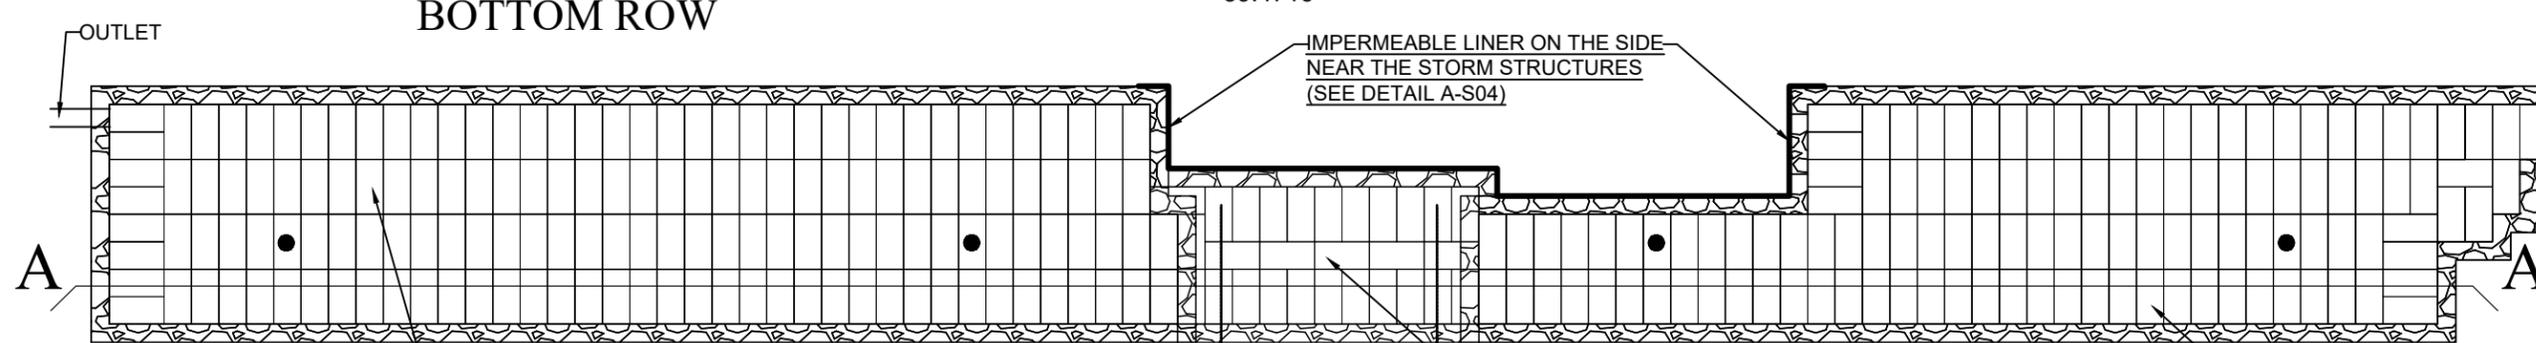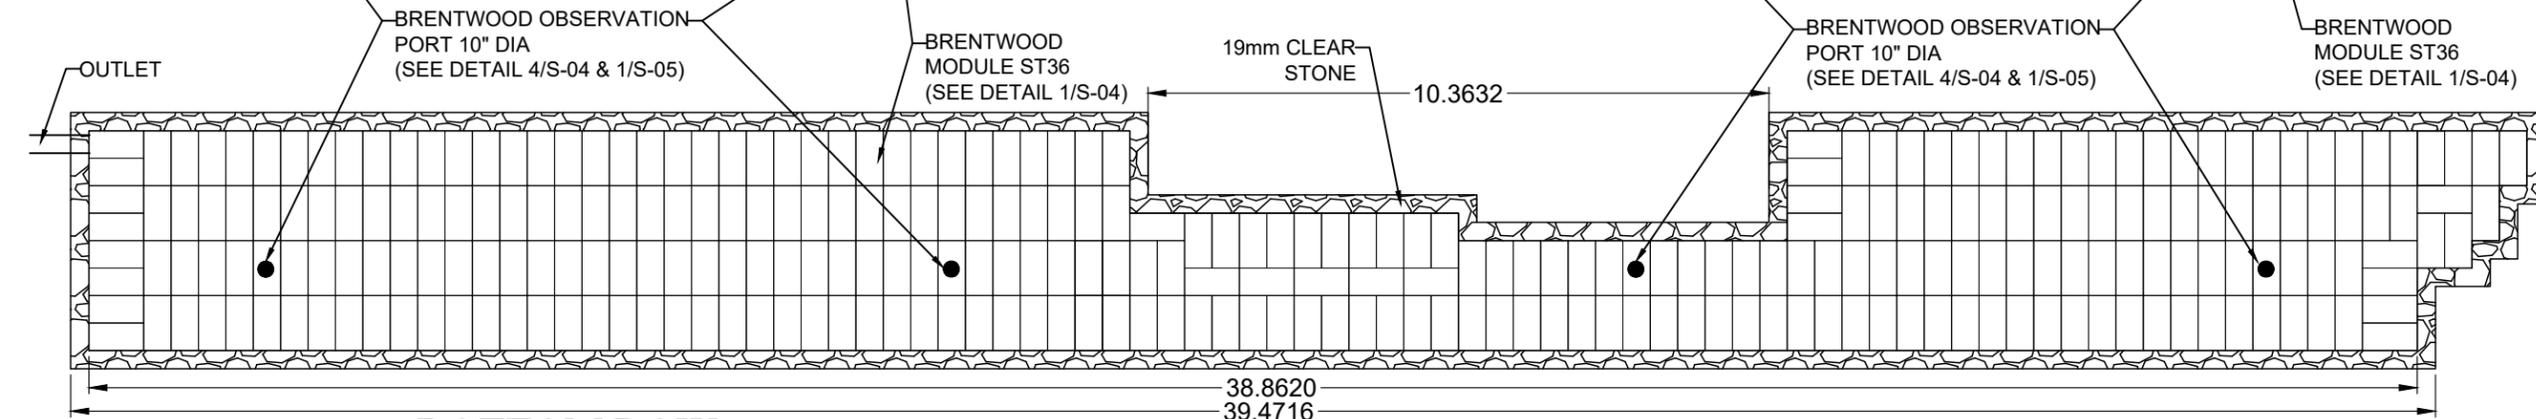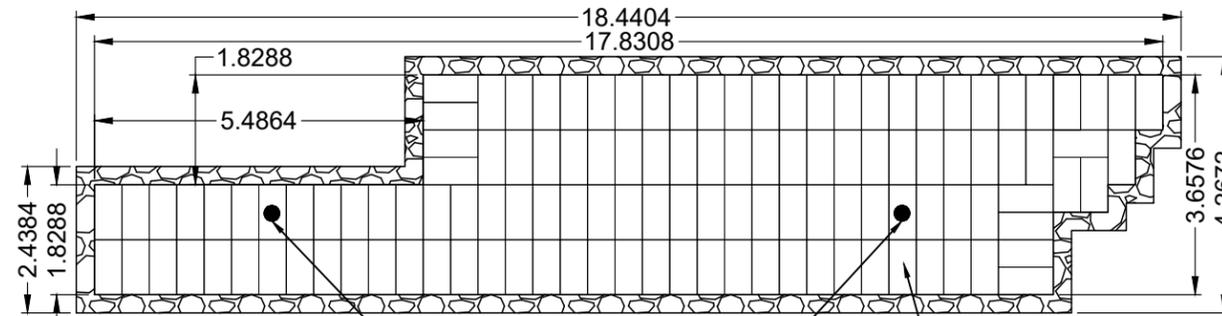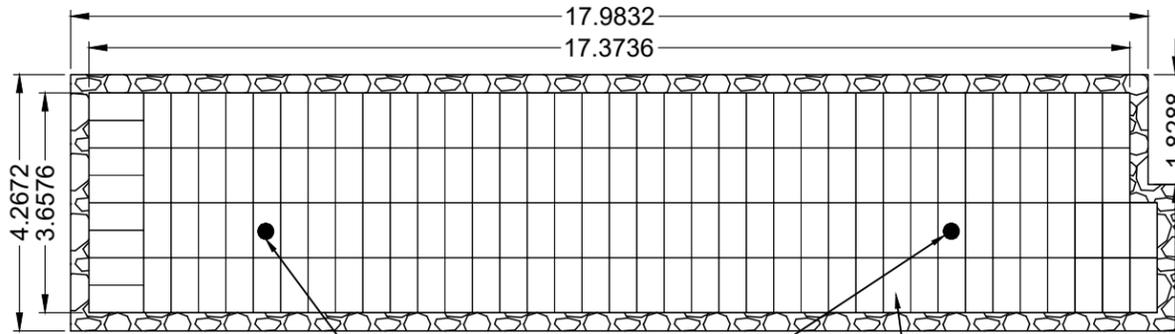

**DOUBLE STACK
MODULE SYSTEM**

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25 m ³
Excavation Required	393.18 m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV.	Record of Changes	Date	By
△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC

Page Name: **Module Layout**

Drawn by: AC	Checked By: AW
Scale: NTS	Date: 07FEB2020

Sheet:

02 OF 08

NOTE: LOCATION OF DEBRIS ROW AND OBSERVATION PORT IS TO BE CONFIRMED



117 Basaltic Rd,
 Concord, ON L4K 1G4 Canada
 Ph: (905) 761-9123
 www.layfieldgroup.com

DOUBLE STACK MODULE SYSTEM

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25m ³
Excavation Required	393.18m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV.	Record of Changes	Date	By
△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC

Page Name: Module Layout	
Drawn by: AC	Checked By: AW
Scale NTS	Date: 07FEB2020

Sheet:
03 OF 08

Material Quantity (ST-36)

ST-36	584
Platens	1168
36" Columns	4672
36" Side Panels	390
10" Observation Port	4
Stacking Pins	556

NOT INCLUDING BOTTOM STONE STORAGE

Elevations

Leveling Stone Invert	72.8976
Module Invert	73.0500
Top of Module	74.8788
Top of Stone Backfill	75.1836
Minimum Finished Grade	75.4884
Maximum Finished Grade	76.4028

Contractor to confirm that quantities shipped to site match those listed above. Please report any discrepancy or damage to Layfield immediately.

- All dimensions are measured in meters unless noted otherwise.
- Reference Brentwood Industries standard drawings and notes for detailed information.
- Reference current Brentwood Module installation instructions for proper installation practices.
[<http://www.brentwoodindustries.com/products/stormwater-management/stormtank/module.php#feature5>]
- Engineer of record to confirm conformance to manufacturer's allowable proximity to other structures and slopes.
- All inlet and pipe locations and designs by others.
- The sub-grade and side backfill needs to be compacted to 95%, unless noted otherwise.
- During and after installation, the Brentwood Module area should be clearly marked and roped off to prevent unauthorized construction and equipment trafficking over the modules.
- Top of Ground water is to be maintained 610 mm (2 ft) below the module to prevent buoyancy, unless otherwise noted by engineer.
- The quantities related to stone and geosynthetics are estimated values as the roll size, overlaps, waste, ect. may vary.

1 NOTES
S-03

DOUBLE STACK MODULE SYSTEM

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25 m ³
Excavation Required	393.18 m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV. Record of Changes Date By

△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC



Page Name:
TYP. Construction Details

Drawn by: AC Checked By: AW

Scale: NTS Date: 07FEB2020


Sheet:

04 OF 08

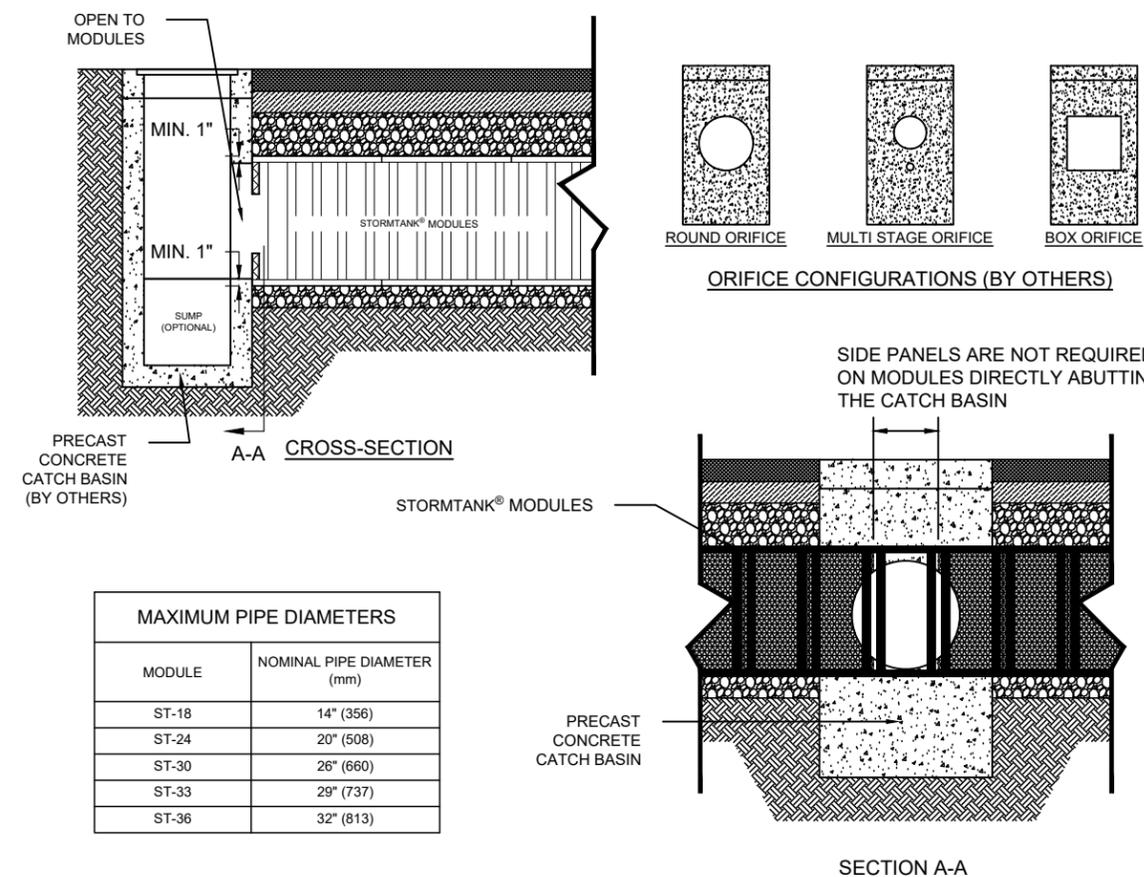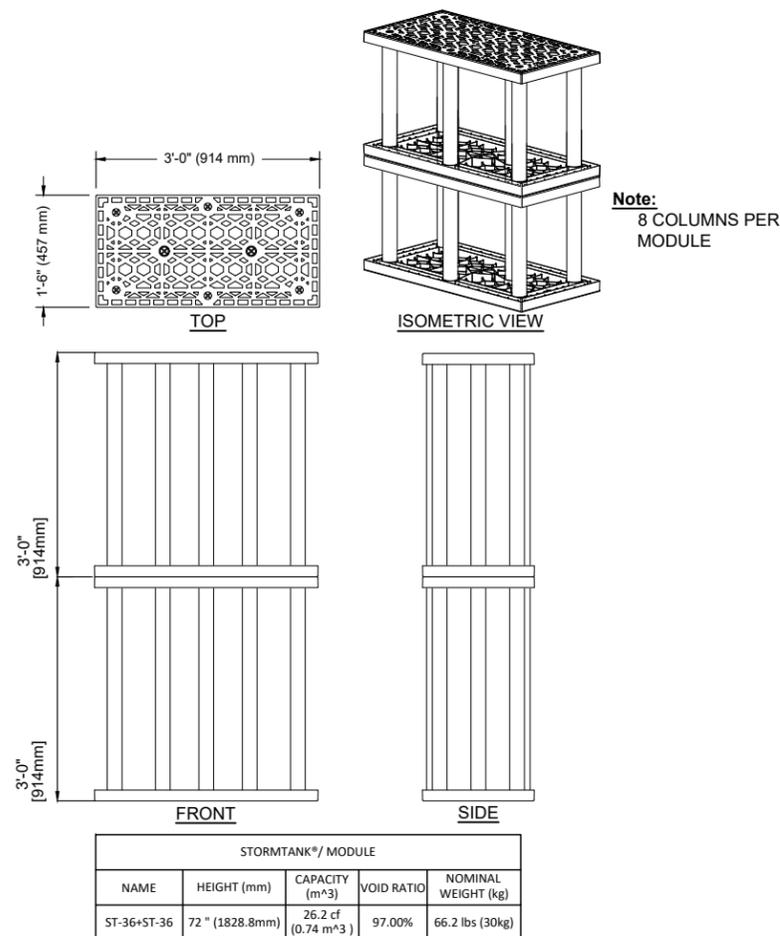


MAXIMUM PIPE DIAMETERS	
MODULE	NOMINAL PIPE DIAMETER (mm)
ST-18	14" (356)
ST-24	20" (508)
ST-30	26" (660)
ST-33	29" (737)
ST-36	32" (813)

1 36" (914mm) & 36" (914mm) S-04 DOUBLE STACKED MODULE DETAIL

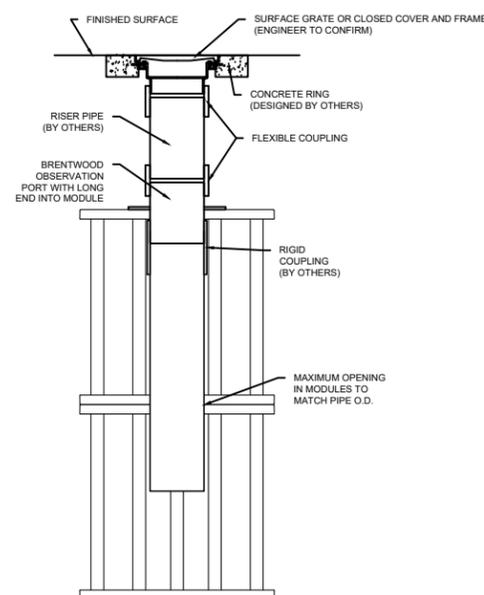


2 36" (914mm) & 36" (914mm) S-04 SIDE PANEL DETAIL

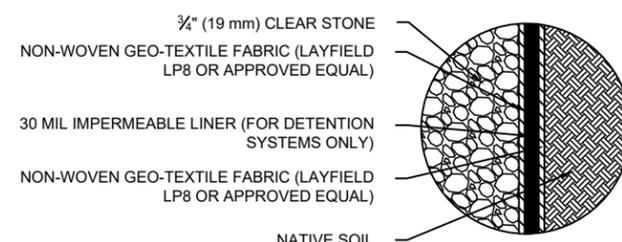

DETAIL "A" (IMPERMEABLE LINER ON THE SIDE NEAR THE STORM STRUCTURES)

3 TYP. CATCH BASIN ABUTMENT DETAIL S-04

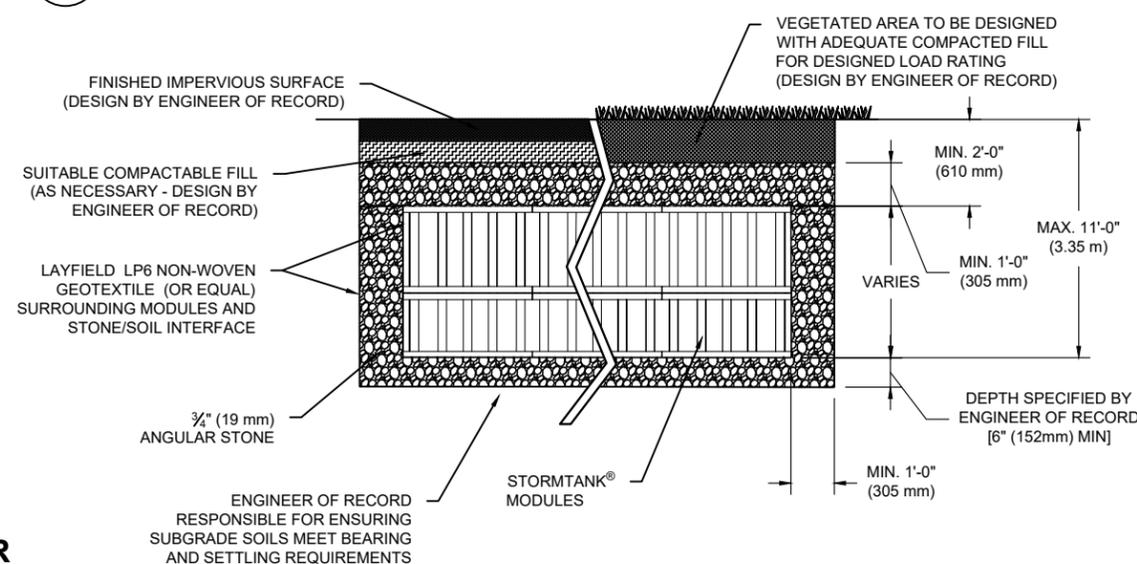

5 TYPICAL DOUBLE STACKED SYSTEM S-04 BASIC CROSS-SECTION

4 DOUBLE STACK S-04 OBSERVATION PORT DETAIL

DOUBLE STACK MODULE SYSTEM

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25m ³
Excavation Required	393.18m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV. Record of Changes Date By

△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC


Page Name:
TYP. Pipe Penetration Details

Drawn by: AC Checked By: AW

Scale: NTS Date: 07FEB2020


Sheet:

05 OF 08

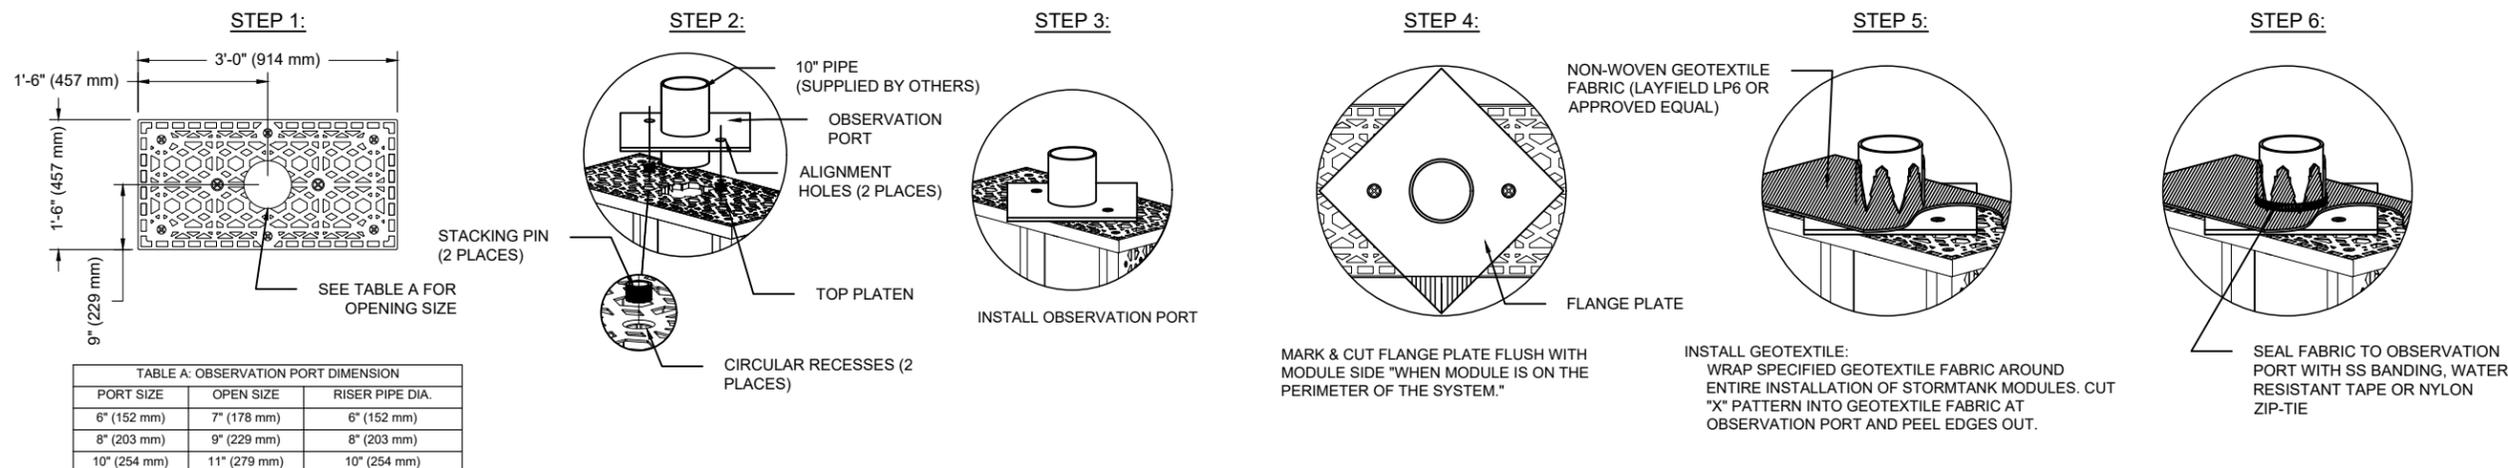


LAYOUT & CUT OPENING INTO THE CENTER OF THE TOP PLATEN FOR BRENTWOOD OBSERVATION PORT.

1 TYP. OBSERVATION PORT S-05 INSTALLATION DETAIL

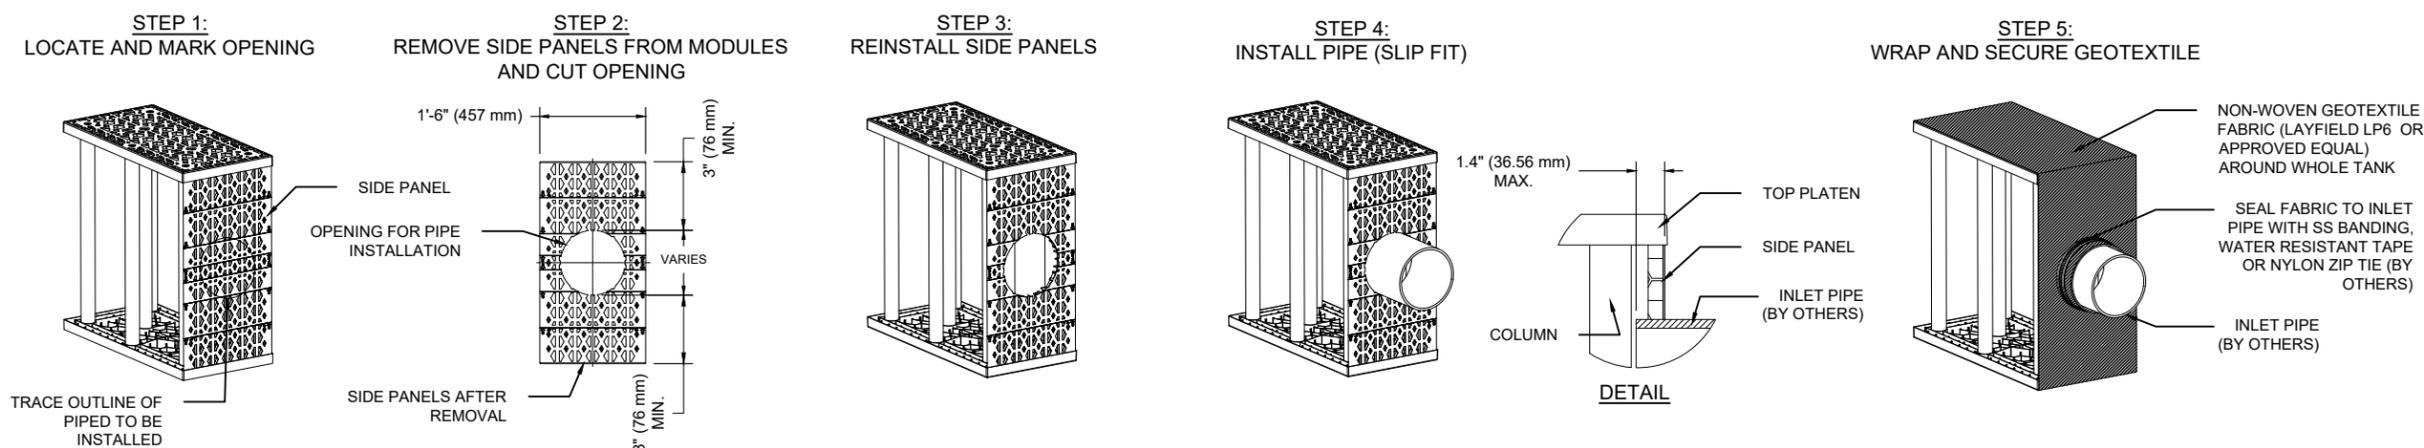

2 SMALL DIAMETER (14" [356 mm] AND SMALLER) S-05 PIPE CONNECTION DETAIL

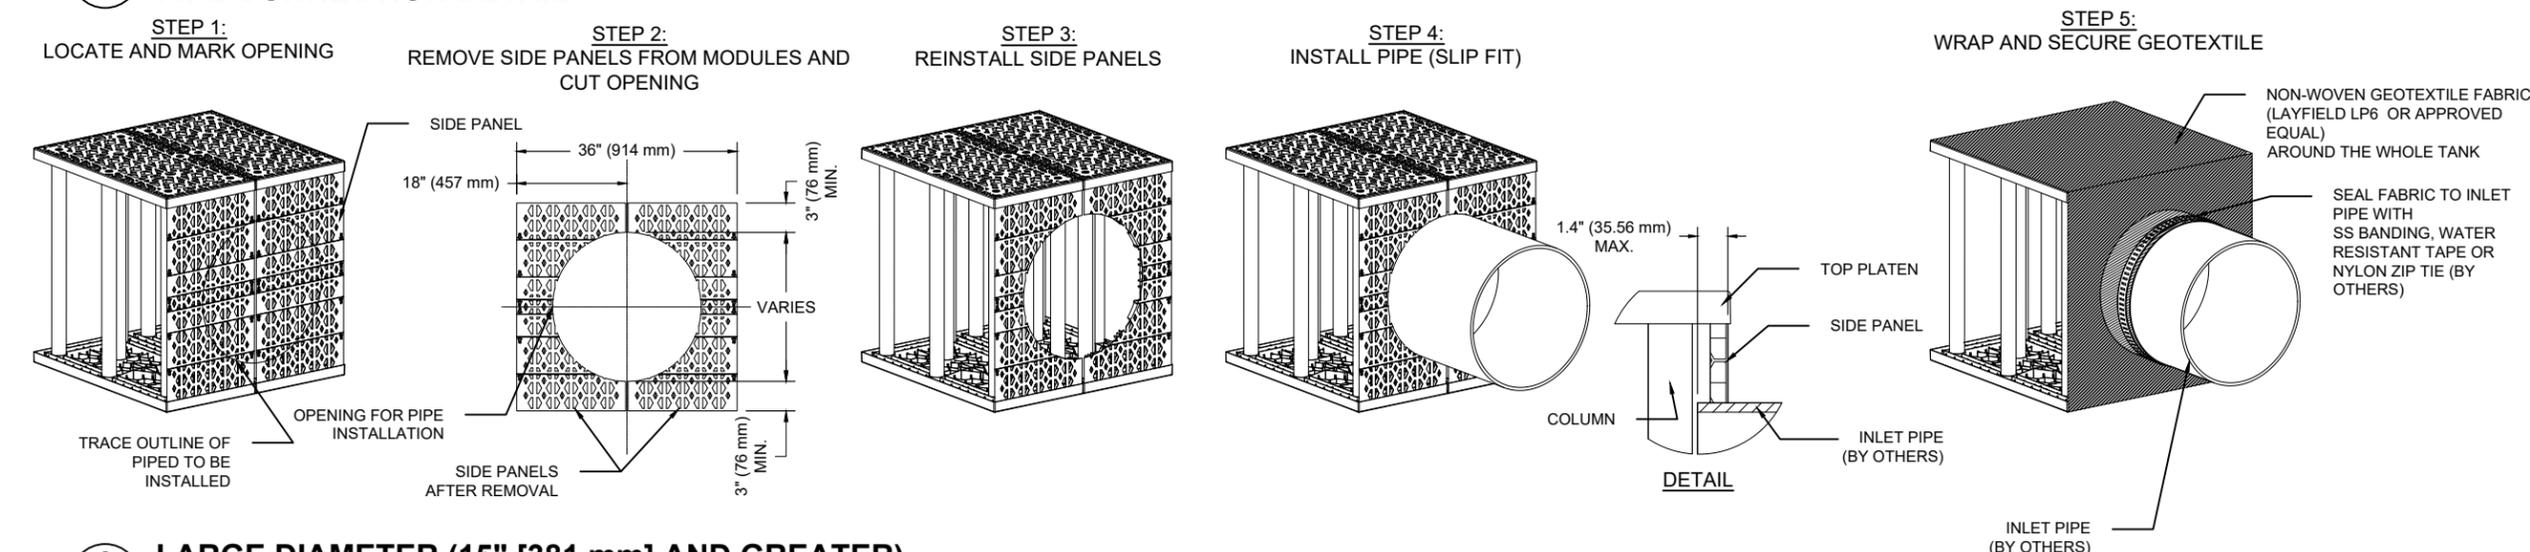

3 LARGE DIAMETER (15" [381 mm] AND GREATER) S-05 PIPE CONNECTION DETAIL

DOUBLE STACK MODULE SYSTEM

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25m ³
Excavation Required	393.18m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV. Record of Changes Date By

△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC


Page Name:
TYP. Debris Row Details

Drawn by: AC Checked By: AW

Scale: NTS Date: 07FEB2020

Sheet:

06 OF 08

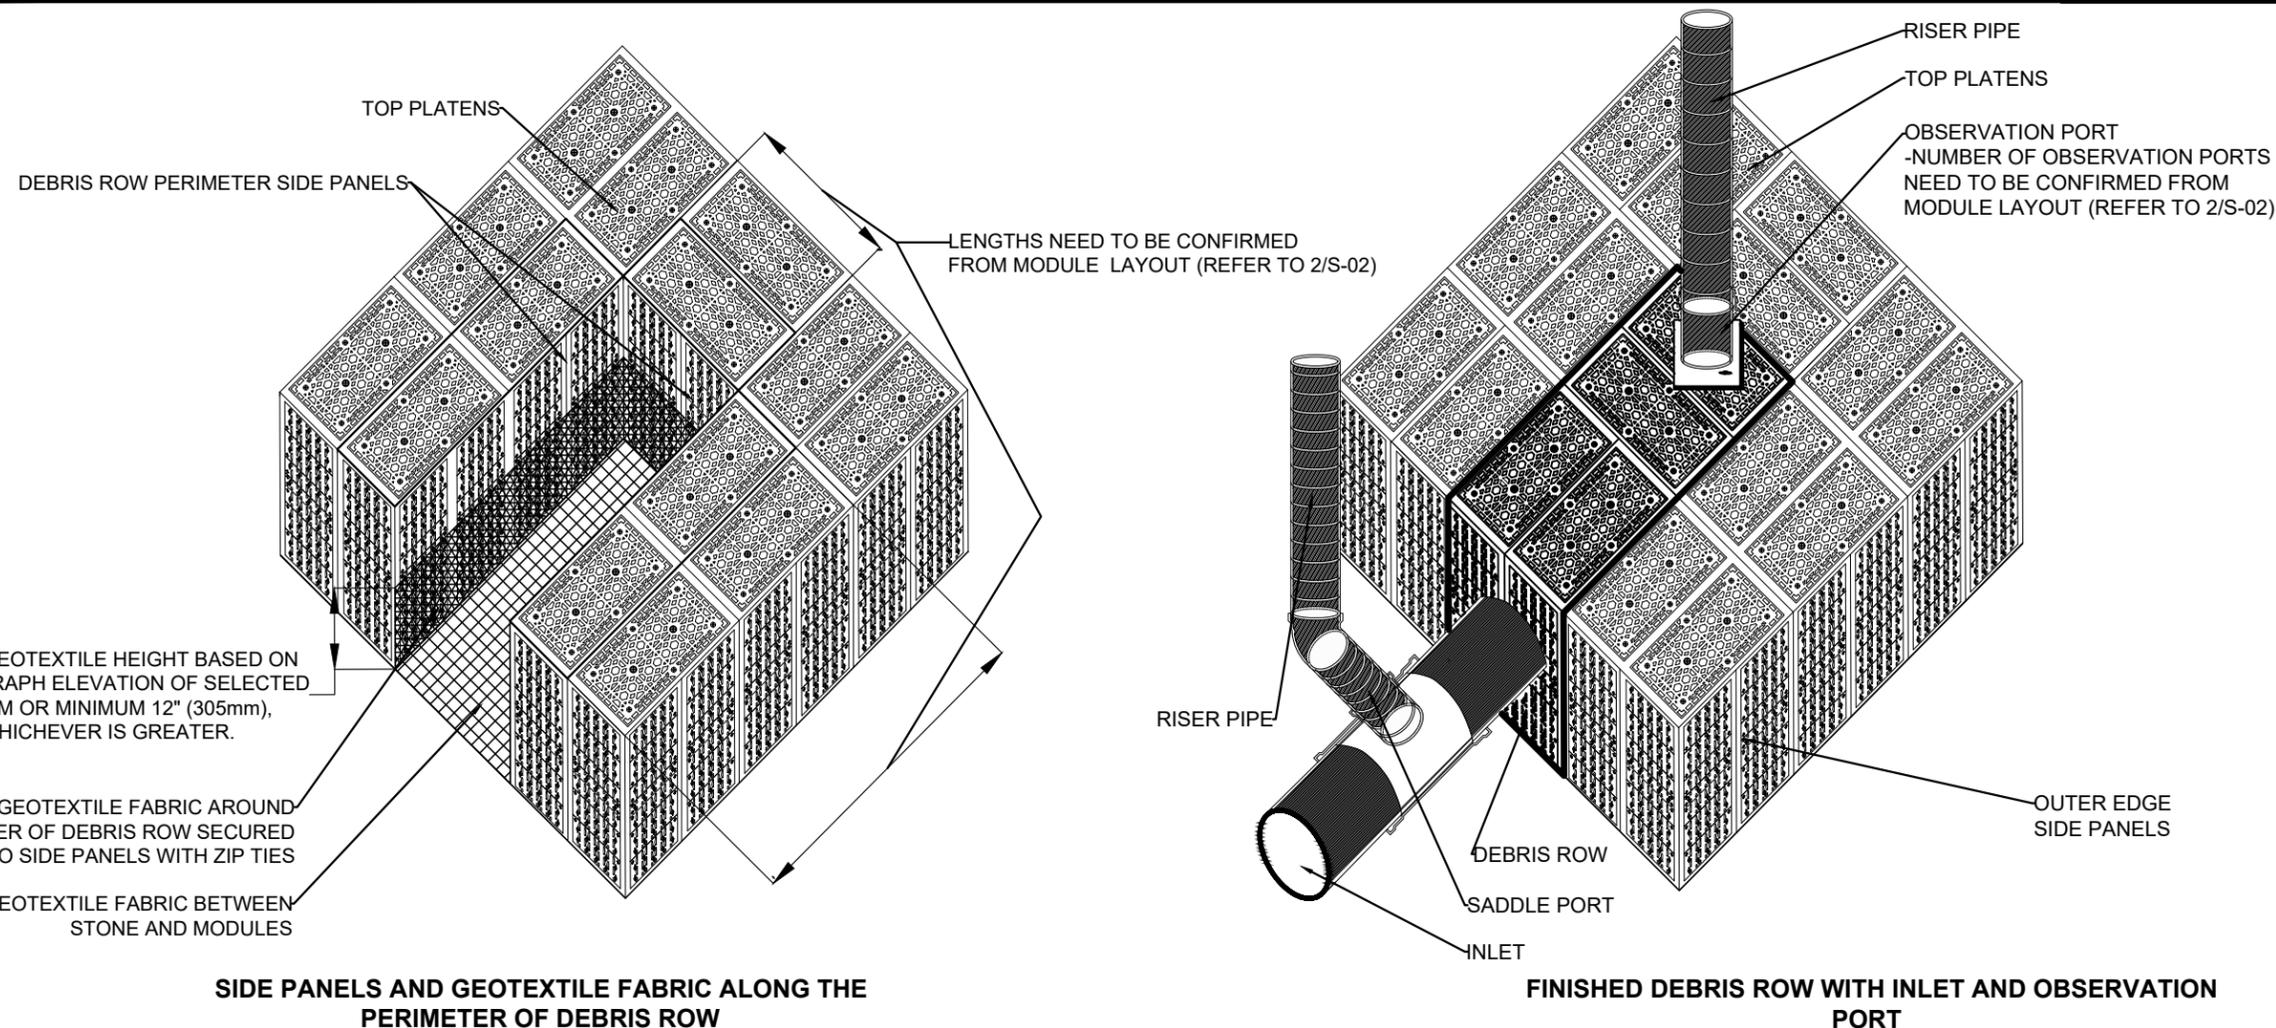


NOTE: GEOTEXTILE HEIGHT BASED ON HYDROGRAPH ELEVATION OF SELECTED STORM OR MINIMUM 12" (305mm), WHICHEVER IS GREATER.

GEOTEXTILE FABRIC AROUND PERIMETER OF DEBRIS ROW SECURED TO SIDE PANELS WITH ZIP TIES

GEOTEXTILE FABRIC BETWEEN STONE AND MODULES

SIDE PANELS AND GEOTEXTILE FABRIC ALONG THE PERIMETER OF DEBRIS ROW

FINISHED DEBRIS ROW WITH INLET AND OBSERVATION PORT

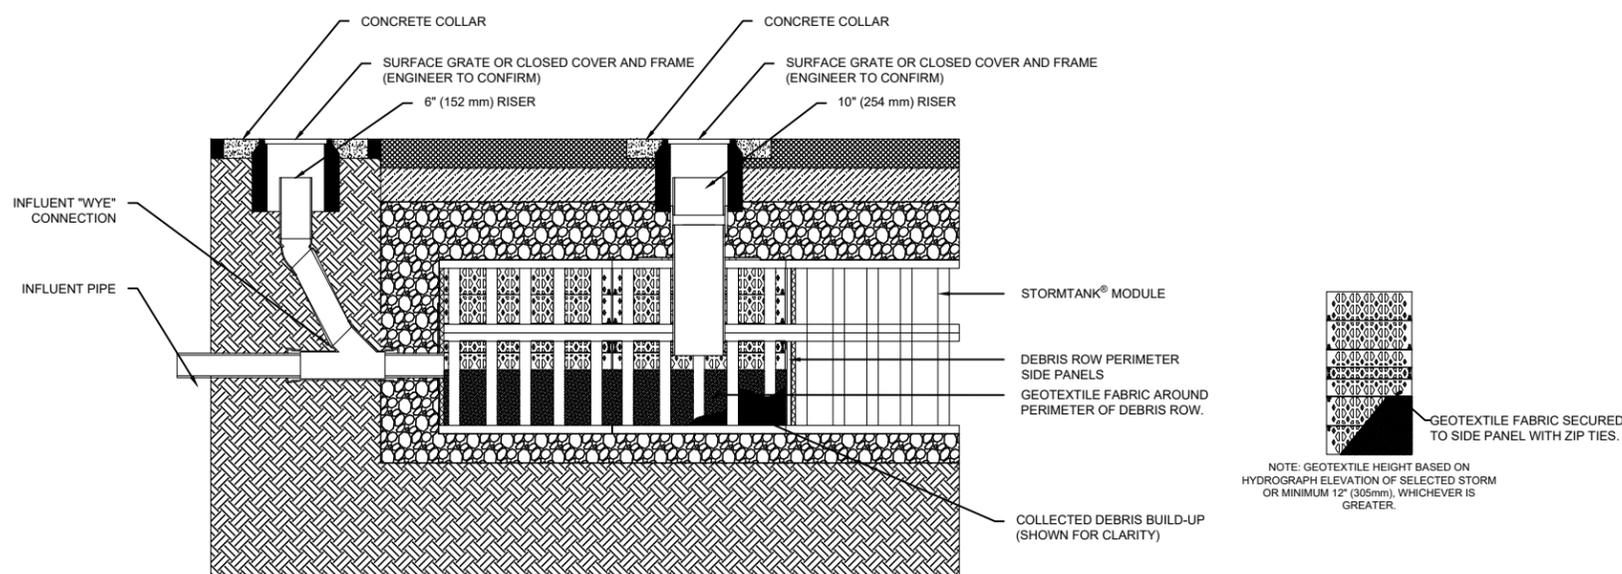

TYP. DEBRIS ROW CROSS SECTION

**1 TYP. DEBRIS ROW DETAIL
S-06 DOUBLE STACK**

NOTE: GEOTEXTILE HEIGHT BASED ON HYDROGRAPH ELEVATION OF SELECTED STORM OR MINIMUM 12" (305mm), WHICHEVER IS GREATER.

GEOTEXTILE FABRIC SECURED TO SIDE PANEL WITH ZIP TIES.

General Conditions

- Review installation procedures and coordinate the installation with other construction activities, such as grading, excavation, utilities, construction access, erosion control, etc.
 - Engineered Drawings supersede all provided documentation, as the information furnished in this document is based on a typical installation.
 - When installed based on Brentwood's Site Preparation and Installation Instructions or similar, a StormTank® system can support an HS-25 load.
 - Coordinate the installation with manufacturer's representative/distributor to be on-site to review start up procedures and installation instructions.
 - Components shall be unloaded, handled and stored in an area protected from traffic and in a manner to prevent damage.
 - Assembled modules may be walked on, but vehicular traffic is prohibited until backfilled per Manufacturer's requirements. Protect the installation against damage with highly visible construction tape, fencing, or other means until construction is complete.
- Ensure all construction occurs in accordance with Federal, Provincial and Local Laws, Ordinances, Regulations and Safety Requirements.
- Extra care and caution should be taken when temperatures are at or below 40° F (4.4° C).

1.0 StormTank® Assembly

StormTank® Modules:

StormTank® modules are delivered to the site as palletized components requiring simple assembly. No special equipment, tools or bonding agents are required; only a rubber mallet. A single worker can typically assemble a module in two minutes.

ASSEMBLY INSTRUCTIONS:

- Place a platen on a firm level surface and insert the eight (8) columns into the platen receiver cups. Firmly tap each column with a rubber mallet to ensure the column is seated.
- Place a second platen on a firm level surface. Flip the previously assembled components upside down onto the second platen, aligning the columns into the platen receiver cups.
- Once aligned, seat the top assembly by alternating taps, with a rubber mallet at each structural column until all columns are firmly seated.

SIDE PANEL

- If side panels are required, firmly tap the top platen upward to raise the top platen. Insert the side panel into the bottom platen.
- Align the top of the side panel with the top platen and firmly seat the top platen utilizing a rubber mallet.

GENERAL NOTES:

- Remove packaging material and check for any damage. Report any damaged components to a StormTank® Distributor or Brentwood personnel.
- StormTank® components are backed by a one year warranty, when installed per manufacturer's recommendations.

2.0 Basin Excavation

- Stake out and excavate to elevations per approved plans. Excavation Requirements:
 - Sub-grade excavation must be a minimum of 6" (152 mm) below designed StormTank® Module invert.
 - The excavation should extend a minimum of 12" (305 mm) beyond the StormTank® dimensions in each length and width (an additional 24" [610 mm] in total length and total width) to allow for adequate placement of side backfill material.
 - Remove objectionable material encountered within the excavation, including protruding material from the walls.
 - Furnish, install, monitor and maintain excavation support (e.g., shoring, bracing, trench boxes, etc.) as required by Federal, Provincial and Local Laws, Ordinances, Regulations and Safety Requirements.

3.0 Sub-Grade Requirements

- Sub-grade shall be unfrozen, level (plus or minus 1%), and free of lumps or debris with no standing water, mud or muck. Do not use materials nor mix with materials that are frozen and/or coated with ice or frost.
- Unstable, unsuitable and/or compromised areas should be brought to the Engineer's attention and mitigating efforts determined prior to compacting the sub-grade.
- Sub-grade must be compacted to 95% Standard Proctor Density or as approved by the Engineer of Record. If code requirements restrict subgrade compaction, it is the requirement of the geotechnical Engineer to verify that the bearing capacity and settlement criteria for support of the system are met. *

* The Engineer of Record shall reference Brentwood document Appendix A for minimum

soil bearing capacity required based on Load Rating and top cover depth. Minimum soil bearing capacity is required so that settlements are less than 1" through the entire sub-grade and do not exceed long-term 1/2" differential settlement between any two adjacent units within the system. Sub-grade must be designed to ensure soil bearing capacity is maintained throughout all soil saturation levels.

4.0 Leveling Bed Installation

- Install geotextile fabric and/or liner material, as specified.
 - Geotextile fabric shall be placed per manufacturer's recommendations.
 - Additional material to be utilized for wrapping above the system must be protected from damage until use.
- After the geotextile is secured, place a minimum 6" (152 mm) Leveling Bed.
 - Material should be a 3/4" (19 mm) angular stone meeting Appendix B – Acceptable Fill Material.
 - Material should be raked free of voids, lumps, debris, sharp objects and plate vibrated to a level with a maximum 1% slope.
- Correct any unsatisfactory conditions.

5.0 StormTank® Module Placement

- Install geotextile fabric and/or liner material, as specified.
 - Geotextile fabric shall be placed per manufacturer's recommendations.
 - Additional material to be utilized for wrapping above the system must be protected from damage until use.
- Mark the footprint of the modules for placement.
 - Ensure module perimeter outline is square or similar prior to Module placement.
 - Care should be taken to note any connections, ports or other irregular units to be placed.
- Install the individual modules by hand, as detailed below.
 - The modules should be installed as shown in the StormTank® submittal drawings with the short side of perimeter modules facing outward, except as otherwise required.
 - Make sure the top/bottom platens are in alignment in all directions to within a maximum 1/4" (6.4 mm).
 - For double stack configurations:
 - Install the bottom module first. **DO NOT INTERMIX VARIOUS MODULE HEIGHTS ACROSS LAYERS.** Backfilling prior to proceeding to second layer is optional.
 - Insert stacking pins (2 per module) into the top platen of the bottom module.
 - Place the upper module directly on top of the bottom module in the same direction, making sure to engage the pins.
- Install the modules to completion, taking care to avoid damage to the geotextile and/or liner material.
- Locate any ports or other penetration of the StormTank®.
 - Install ports/penetrations in accordance with the approved submittals, contract documents and manufacturer's recommendations.
- Upon completion of module installation, wrap the modules in geotextile fabric and/or liner.
 - Geotextile fabric shall be wrapped and secured per manufacturer's recommendations.
 - Seal any ports/penetrations per Manufacturer's requirements

Notes:

- If damage occurs to the geotextile fabric or impermeable liner, repair the material in accordance with the geotextile/liner Manufacturer's recommendations.

6.0 Side Backfill

- Inspect all geotextile, ensuring that no voids or damage exists; which will allow sediment into the StormTank® system.
- Adjust the stone/soil interface geotextile along the side of the native soil to ensure the geotextile is taught to the native soil.
- Once the geotextile is secured, begin to place the Side Backfill.
 - Material should be a 3/4" (19 mm) angular stone meeting Appendix B – Acceptable Fill Material.
 - Backfill sides "evenly" around the perimeter without exceeding single 12" (305 mm) lifts.
 - Place material utilizing an excavator, dozer or conveyor boom.
 - Utilize a plate vibrator to settle the stone and provide a uniform distribution.

Notes:

- Do not apply vehicular load to the modules during placement of side backfill. All material placement should occur with equipment located on the native soil surrounding the system.
- If damage occurs to the geotextile fabric or impermeable liner, repair the material in accordance with the geotextile/liner Manufacturer's recommendations.

7.0 Top Backfill (Stone)

- Begin to place the Top Backfill.
 - Material should be a 3/4" (19 mm) angular stone meeting Appendix B – Acceptable Fill Material.
 - Place material utilizing an excavator, dozer or conveyor boom (Appendix C – Material Placement) and use a walk-behind plate vibrator to settle the stone and provide an even distribution.

DO NOT DRIVE ON THE MODULES WITHOUT A MINIMUM 12" (305 mm) COVER.

- Upon completion of Top Backfilling, wrap the system in geotextile fabric and/or liner per manufacturer's recommendations.
- Install metallic tape around the perimeter of the system to mark the area for future utility detection.

Notes:

- If damage occurs to the geotextile fabric or impermeable liner, repair the material in accordance with the geotextile/liner Manufacturer's recommendations.

8.0 Suitable Compactable Fill

Following Top Backfill placement and geotextile fabric wrapping; complete the installation as noted below.

Vegetated Area

- Place fill onto the geotextile.
 - Maximum 12" (305 mm) lifts, compacted with a vibratory plate or walk behind roller to a minimum of 90% Standard Proctor Density.
 - The minimum top cover to finished grade should not be less than 24" (610 mm) and the maximum depth from final grade to the bottom of the lowest module should not exceed 11' (3.35 m).
- Finish to the surface and complete with vegetative cover.

Impervious Area

- Place fill onto the geotextile.
 - Maximum 12" (305 mm) lifts, compacted with a vibratory plate or walk behind roller to a minimum of 90% Standard Proctor Density.
 - The minimum top cover to finished grade should not be less than 24" (610 mm) and the maximum depth from final grade to the bottom of the lowest module should not exceed 11' (3.35 m).
- Finish to the surface and complete with asphalt, concrete, etc.

Notes:

- A vibratory roller may only be utilized after a minimum 24" (610 mm) of compacted material has been installed or for the installation of the asphalt wearing course.
- If damage occurs to the geotextile fabric, repair the material in accordance with the geotextile Manufacturer's recommendations.
- For most recent installation guidelines visit: <http://www.brentwoodindustries.com/products/stormwater-management/stormtank/module.php#feature5>

9.0 Inspection and Maintenance

If the following inspections and maintenance procedures are not followed as specified below then the end-user is responsible for the performance of the modules. These Maintenance procedure must be performed after a heavy rainfall, flooding or any incident that will vary the flow of water drastically.

Inspection

- Inspect all observation ports, inflow and outflow connection and the discharge area
- Identify and log any sediment and debris accumulation, system backup, or discharge rate changes.
- If there is a sufficient need for a cleanout, contact a local cleaning company for assistance.

Cleaning:

- If a pretreatment device is installed, follow manufacturer recommendations.
- Using vacuum pump truck, evacuate debris from the inflow and outflow points.
- Flush the system with clean water, forcing debris from the system.
- Repeat steps 2 and 3 until no debris is evident.



117 Basaltic Rd,
Concord, ON L4K 1G4 Canada
Ph: (905) 761-9123
www.layfieldgroup.com

**DOUBLE STACK
MODULE SYSTEM**

Total Storage Volume	256.25 m³
Module Storage Volume	216.90 m³
Stone Storage Volume	39.37 m³
System Footprint	156.45 m²
Estimated Geotextile Fabric	LP6 1650 m² LP8 100 m²
Estimated Liner	50 m²
Estimated Stone Volume	122.25m³
Excavation Required	393.18m³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV. Record of Changes Date By

△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC

Page Name: Supplementary Notes	
Drawn by: AC	Checked By: AW
Scale NTS	Date: 07FEB2020

Sheet:

07 OF 08



117 Basaltic Rd,
Concord, ON L4K 1G4 Canada
Ph: (905) 761-9123
www.layfieldgroup.com

DOUBLE STACK MODULE SYSTEM

Total Storage Volume	256.25 m ³
Module Storage Volume	216.90 m ³
Stone Storage Volume	39.37 m ³
System Footprint	156.45 m ²
Estimated Geotextile Fabric	LP6 1650 m ² LP8 100 m ²
Estimated Liner	50 m ²
Estimated Stone Volume	122.25 m ³
Excavation Required	393.18 m ³
Excavation Depth	2.59m
Stone Type	19mm clear
Stone Void Space	40%
Module Type (Bottom)	ST-36
Module Type (Top)	ST-36

2795 BASELINE ROAD
Ottawa, ON

REV. Record of Changes Date By

△	Preliminary Drawing	07FEB2020	AC
△	Revised Drawing	10FEB2020	AC
△	Revised Drawing	11FEB2020	AC

Page Name:
Supplementary Notes

Drawn by: AC Checked By: AW

Scale: NTS Date: 07FEB2020

Sheet:

08 OF 08

ANSI B Size Page (Horizontal)

Appendix A - Bearing Capacity Tables


Cover		HS-25 (Unfactored)		HS-25 (Factored)	
English	Metric	English	Metric	English	Metric
(in.)	(mm)	(ksf)	(kPa)	(ksf)	(kPa)
24	610	1.89	90.45	4.75	227.43
25	635	1.82	86.96	4.53	216.9
26	660	1.75	83.78	4.34	207.8
27	686	1.69	80.88	4.16	199.18
28	711	1.63	78.24	3.99	191.04
29	737	1.58	75.82	3.84	183.86
30	762	1.54	73.62	3.7	177.16
31	787	1.5	71.6	3.57	170.93
32	813	1.46	69.75	3.45	165.19
33	838	1.42	68.06	3.34	159.92
34	864	1.39	66.51	3.24	155.13
35	889	1.36	65.1	3.14	150.34
36	914	1.33	63.8	3.05	146.03
37	940	1.31	62.62	2.97	142.2
38	965	1.29	61.54	2.9	138.85
39	991	1.26	60.55	2.83	135.5
40	1,016	1.25	59.65	2.76	132.15
41	1,041	1.23	58.84	2.7	129.28
42	1,067	1.21	58.09	2.67	127.84
43	1,092	1.2	57.42	2.6	124.49
44	1,118	1.19	56.81	2.55	122.09
45	1,143	1.18	56.26	2.5	119.7
46	1,168	1.16	55.77	2.46	117.79
47	1,194	1.16	55.33	2.42	115.87
48	1,219	1.15	54.94	2.39	114.43
49	1,245	1.14	54.59	2.36	113
50	1,270	1.13	54.29	2.33	111.56
51	1,295	1.13	54.03	2.3	110.12
52	1,321	1.12	53.8	2.27	108.69
53	1,346	1.12	53.62	2.25	107.73
54	1,372	1.12	53.46	2.23	106.77
55	1,397	1.11	53.34	2.21	105.82
56	1,422	1.11	53.24	2.19	104.86
57	1,448	1.11	53.18	2.17	103.9
58	1,473	1.11	53.14	2.16	103.42
59	1,499	1.11	53.12	2.14	102.46
60	1,524	1.11	53.13	2.13	101.98
61	1,549	1.11	53.16	2.12	101.51
62	1,575	1.11	53.21	2.11	101.03
63	1,600	1.11	53.28	2.1	100.55
64	1,626	1.11	53.37	2.09	100.07
65	1,651	1.12	53.48	2.08	99.59
66	1,676	1.12	53.61	2.08	99.59
67	1,702	1.12	53.75	2.07	99.11
68	1,727	1.13	53.91	2.07	99.11
69	1,753	1.13	54.08	2.06	98.63
70	1,778	1.13	54.26	2.06	98.63
71	1,803	1.14	54.46	2.06	98.63

Notes: 1. Additional load ratings and associated bearing capacities may be applicable on a case by case basis. Please contact your local Brentwood Representative.
Revision Date: 8/20/15 Page 8 of 10

Appendix B - ACCEPTABLE FILL MATERIALS

Material Location	Description	AASHTO M-43 Designation	ASTM D2321 Class	Compaction/Density
Finished Surface	Topsoil, hardscape, stone, concrete or asphalt per engineer of record.	N/A	N/A	Prepare per engineered plans.
Suitable Compaction Fill	Granular well graded soil/aggregate, typically road base or earthen fill, maximum 4" particle size.	56, 57, 6, 67, 68 Earth	I & II III (Earth Only)	Place in max. 12" lifts to a min. 90% standard proctor density.
Top Backfill	Crushed angular stone placed between modules and road base or earthen fill.	56, 57, 6, 67, 68	I & II	Plate compacted to provide evenly distributed layers.
Side Backfill	Crushed angular stone placed between earthen walls and modules.	56, 57, 6, 67, 68	I & II	Place in uniform 12" lifts around the system.
Leveling Bed	Crushed angular stone placed to provide level surface for installation of modules.	56, 57, 6, 67, 68	I & II	Plate vibrated to achieve level surface.

* See Appendix C - Material Placement for limitations

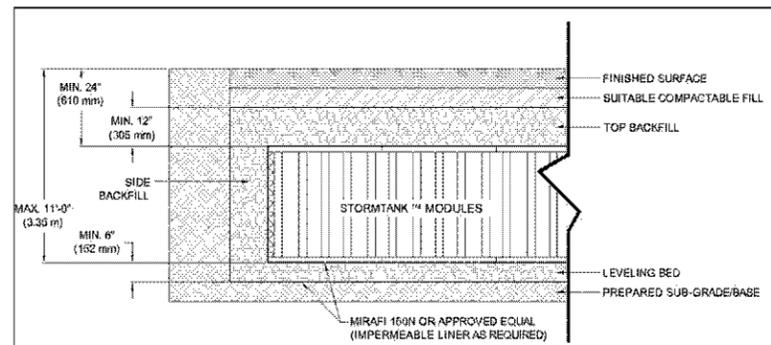

Notes:
2. All stone must be angular stone meeting ASTM D2321. Recycled concrete may be utilized when meeting acceptable gradation and ASTM standards.
3. The sub-grade is to be prepared to meet bearing and compaction requirements. Please see engineer of record's design.
4. Storage of materials such as construction materials, equipment, soils, etc. over the StormTank® system is strictly prohibited.
5. Please contact a Geotechnical Engineer and the Brentwood representative prior to utilization of any material not listed above.
Revision Date: 8/20/15 Page 9 of 12

Appendix C - MATERIAL PLACEMENT GUIDELINES

Material Location	Placement Methods	Tired Equipment Limitations	Tracked Equipment Limitations	Roller Limitations
Finished Surface	Numerous methods may be utilized. Material dumping on to system be limited unless otherwise noted.	Asphalt can be dumped into pavers.		Vibratory rollers may only be utilized if compacted cover exceeds 24" (610 mm) or for pavement installation.
Suitable Compaction Fill	Utilize an excavator, skid loader or dozer to place material. (Max. gross operating load of 6000 lbs. [2,721 kg] or less).	No DUMPING by dump trucks. No wheel loads until approved by Engineer of Record.	SMALL DOZERS ONLY (Max. gross operating load of 6,000 lbs. [2,721 kg] or less).	Static rollers ONLY are permitted until compacted cover exceeds 24" (610 mm).
Top Backfill	Utilize an excavator bucket or stone conveyor, positioned off of system, to uniformly backfill on the top of modules. No DUMPING directly onto modules by dump trucks.	No DUMPING by dump trucks. No wheel loads until approved by Engineer of Record.	Utilize an excavator or skid loader (Max. gross operating load of 6,000 lbs. [2,721 kg] once a min. 12" (305 mm) has been placed and compacted.	No rollers allowed at this time.
Side Backfill	Utilize an excavator bucket or stone conveyor, positioned off of system, to uniformly backfill on the top of modules. Stone to be placed in max. 12" (305mm) lifts until stone reaches the top of modules.	No equipment is permitted on the modules during the side backfilling progress.		
Leveling Bed				No limitations

Notes:
1. Storage of materials such as construction materials, equipment, soils, etc. over the StormTank® system is strictly prohibited.
2. Please contact a Brentwood representative/distributor prior to utilization of any equipment not listed above.
3. During paving operations, it may be necessary to utilize dump operations for paving equipment. Additional precautions should be utilized to limit the dump distance and prevent rutting of road base.
4. It is recommended that all backfilling operations be completed with low ground pressure vehicles such as mini excavators, skid steers, etc. All equipment is to access system by a level approach to the system.
Revision Date: 8/20/15 Page 10 of 12



Sizing Report

2733 Kanasita Drive • Suite 111 • Chattanooga, TN 37343 • Phone: (423) 870-8888 • Fax: (423) 826-2112 • www.aquashieldinc.com

Site Information

Project Name: New Development

Site Area (hectares): 0.753

Unit Label: AS

Runoff Coeff. : .82

Unit Location: Ottawa, ON

Target Removal Efficiency(%): 80% based on NJDEP

Product Recommendation

Aqua-Swirl™ Model	Net Annual TSS Removal Efficiency	Chamber Diameter	Maximum Inside Diameter (mm)		Oil/Debris Storage Capacity	Sediment Storage Capacity
			Offline	BYP ⁵		
AS-3	83.13 %	991 mm.	251 mm.	535 mm.	417 L	0.56 m ³

Rainfall Information

NCDC Station¹: OTTAWA MACDONALD-CARTIER INT'L A Data Range⁴: 261,759 readings taken hourly between 1967 to 2007 (~40 years)

Rainfall Event Range (mm/hre)	Rainfall Interval Point (mm/hre)	Operating Rate (Lps/m ²)	Total Rainfall (%)	Removal Efficiency (%) ²	Relative Efficiency (%)
02.00 - 03.00	02.50	04.80	44.18	92.43	40.84
03.00 - 04.00	03.50	06.72	21.52	89.05	19.16
04.00 - 05.00	04.50	08.64	11.68	85.03	09.93
05.00 - 06.00	05.50	10.56	06.68	80.40	05.37
06.00 - 07.00	06.50	12.47	04.03	75.14	03.03
07.00 - 08.00	07.50	14.39	01.99	69.26	01.38
08.00 - 09.00	08.50	16.31	01.84	62.75	01.15
09.00 - 10.00	09.50	18.23	01.81	55.62	01.01
10.00 - 15.00	12.50	23.99	04.12	30.49	01.26
Total Cumulative Rainfall %:			97.85³	Net Annual %:	83.13

Sales Agent Information

Agent Name: Kevin Dutrisac

Phone: 613-323-0364

Company Name: Soleno

Fax: _____

Address: _____

E-mail: kdutrisac@soleno.com

City, State Zip: , QC

Footnotes


- Recorded as hourly precipitation rainfall data (inches), National Climatic Data Center (NCDC)
- Based on Tennessee Tech University laboratory testing of the AquaSwirl™ Model AS-3 for OK-110 silica particles 50-125 microns (Neary, 2002)
- 90% Rainfall Event, calculated as a cumulative percentile of individual events, www.stormwatercenter.net, sizing criteria (Center for Watershed Protection)
- NCDC data may not be consecutive, skipping days, months and/or years in the range of dates.
- The Aqua-Swirl™ Internal Bypass (BYP) provides full treatment of the "first flush," while the peak design storm is diverted and channeled through the main conveyance pipe. Please refer to your local representative for more information.
- When applicable, the performance curve was adjusted via Peclet Scaling to provide estimated sizing per NJDEP PSD (d50 = 67 microns).

Aqua-Swirl High Density Polyethylene (HDPE)
Stormwater Treatment System



Projected View
SCALE 1:80

Please see accompanied Aqua-Swirl specification notes. See Site Plan for actual system orientation.
Approximate dry (pick) weight: 700 kg [1600 lbs].


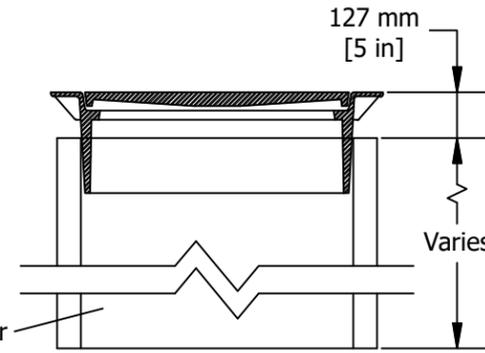


Smooth exterior
Riser Solflo Max
750 mm [30 in]

Adjustable Frame and Cover

System shall be designed for the following capacities:
Swirl Treatment Flow: 51 L/s [1.8 cfs]
Swirl Sediment Storage: 0.57 m³ [20 ft³]
Swirl Oil/Debris Storage: 416 L [110 gal]

- ① AS-3 BYP inlet/outlet pipe size ranges from 254 mm [10 in] to 533 mm [21 in].
- ② AS-3 chamber height may vary from 2286 mm [90 in] to 2642 mm [104 in], depending on inlet/outlet pipe size.
- ③ Orientation may vary from a minimum of 90° to a maximum of 180°.

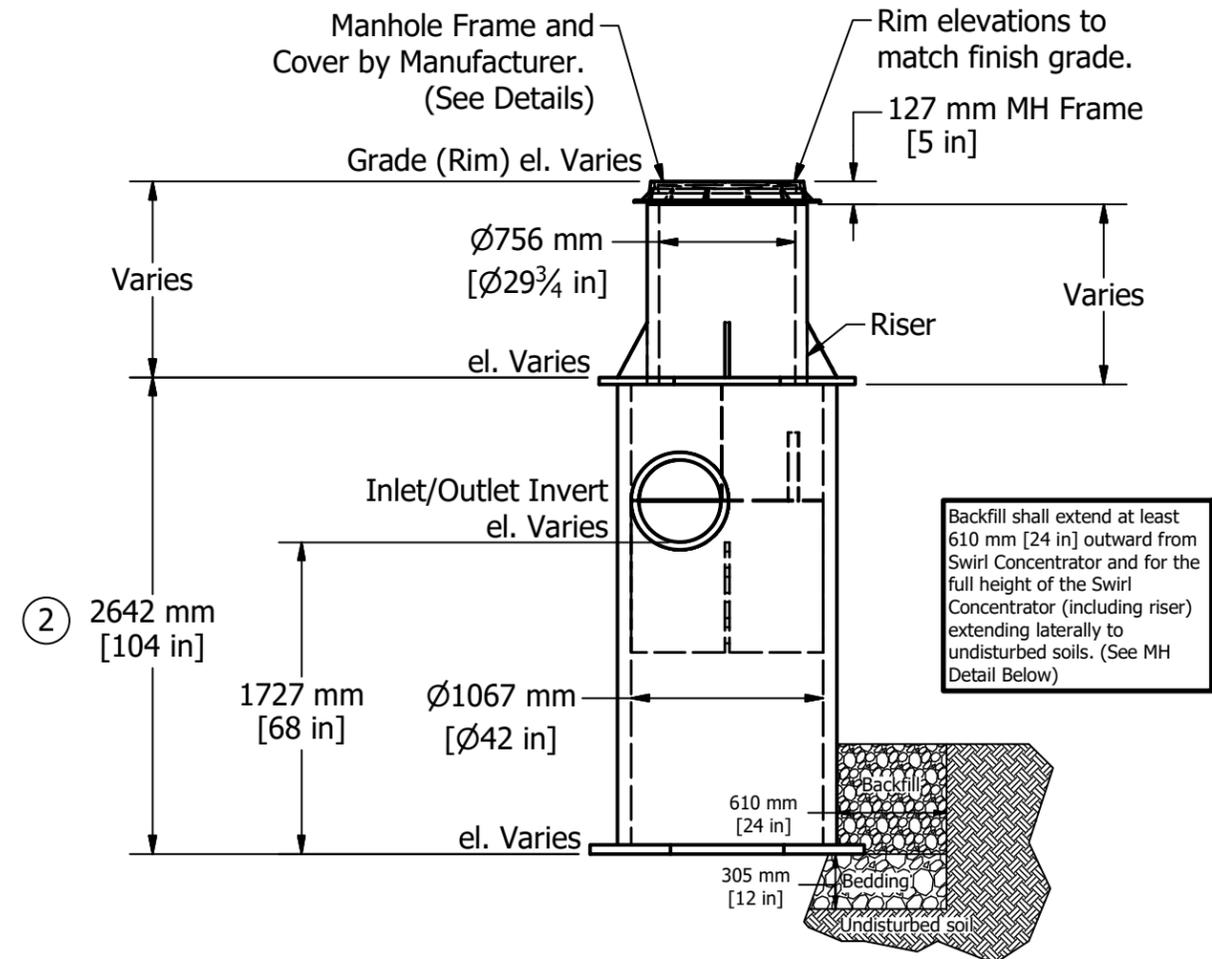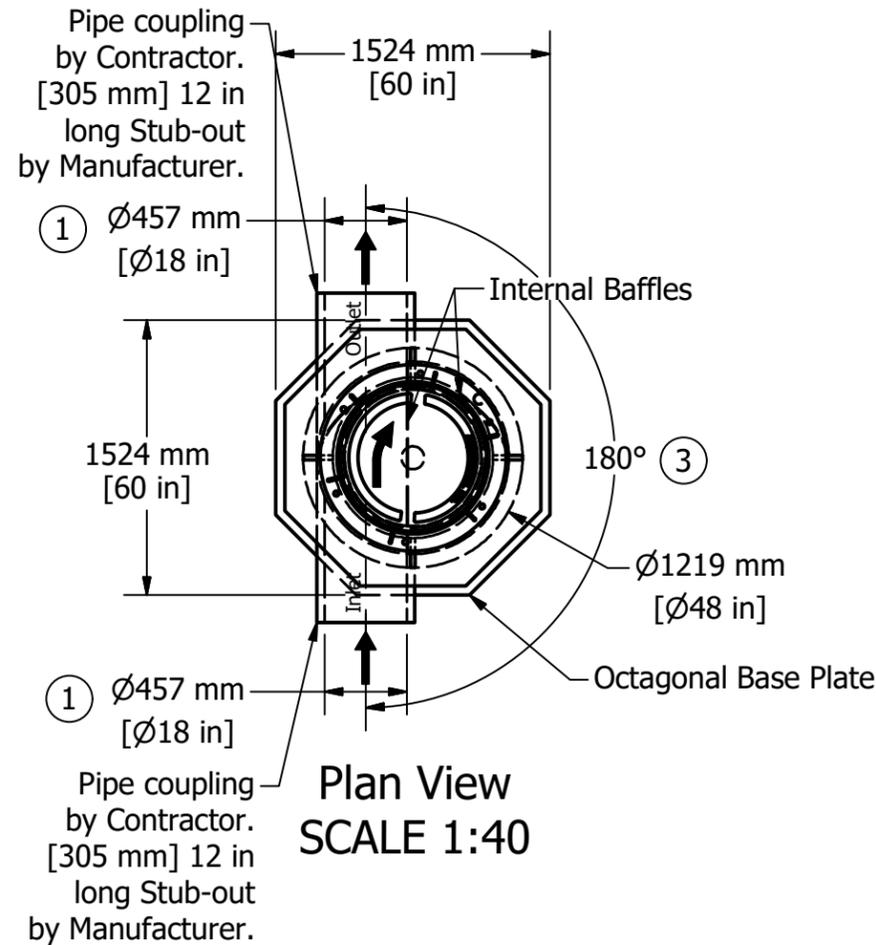

Aqua-Swirl Concentrator
AS-3 BYP CW STD

Standard Detail

Structure #:	AS-3 STD	Rvwed	Rvw. Date
Drawn By:	OFlores		
Scale:	As Shown		
Date:	3/8/2018		

U.S. Patent No. 6524473 and other Patent Pending

re: Response to City Comments
Proposed Residential Development
2795 Baseline Road - Ottawa

to: Greatwise Developments - **Mr. Natan Ary** - natan@greatwise.ca

cc: DSEL - **Ms. Alison Gosling** - AGosling@dsel.ca

date: March 20, 2020

file: PG1630-MEMO.31

Further to your request and authorization, Paterson Group (Paterson) prepared the following memorandum to respond to the current City of Ottawa engineering review comments for the aforementioned site. This memorandum should be read in conjunction with our geotechnical Report PG1630-5 Revision 1 dated December 11, 2019.

Geotechnical Comments

Item 2

Comment: Any sewers with cover less than 2 meters will require insulation, please make sure to verify all cover depth and provide insulation where needed.

Response: Based on our review of the latest site servicing plan prepared by DSEL (Drawing No. SSP-1, Sheet No. 3 of 8, Revision 4 dated March 13, 2020), the proposed storm sewer manhole structures are provided sufficient frost cover and will not require insulation. The storm sewer main alignments were also found to have sufficient frost cover and will not require any additional insulation. The exterior catch basins and the catch basin leads, however, have approximately 1.5 m of frost cover. From a geotechnical perspective, those catch basins and the associated leads do not require additional insulation due to the fact that minimal water infiltration is expected through these service lines during freezing temperatures. Therefore, based on our review, the site servicing is acceptable from a geotechnical perspective.

Item 3

Comment: UG storage detail no 03 of 08 mentions the Max. finished grade to be 76.4028, some grade on the grading plan shows up to 76.89, please make sure to coordinate the specification provided by supplier with the proposed design. Also this submission shows that the UG storage will extend under the proposed private road (fire), as per the Fire department's comments below, please avoid having any under ground storage under the fire route or provide information to satisfy the fire department requirements.

Response: Manufacturer/supplier to confirm if grading exceeding 76.4 m is tolerable above the storage structure. Based on our review of the available grading plans, the additional loading applied by the proposed finished grades of 76.89 will not negatively impact the structural integrity of the tank provided the fill material above the storage tank to consist of OPSS Granular B Type II. The granular fill should be placed in 300 mm loose lifts and compacted to a minimum of 98% of the material's SPMDD. The compacted granular layer will help distributing the excess load to a larger area, relieving the storage tank from any excessive load. This will also save the pavement structure from differential settlements caused by the proposed tank below the fire route.

For more information regarding pavement structure design recommendations, please refer Subsection 5.2 and 5.6 in our geotechnical Report PG1630-5 Revision 1, dated December 11, 2019.

Item 3 - Continued

Comment: Also, please provide a confirmation from a geotechnical engineer that the setback between the UG storage Block 12 & 14 is enough to ensure no influence on the Blocks foundation in case of any excavation for maintenance in the future, a section showing the line of influence for the UG storage vs the slabs for Block 12 & 14.

Response: Based on the close proximity of the underground storage structure to Blocks 12 and 14, the current lateral support zone for the residential dwelling footings will be negatively impacted due to the excavation depth for the underground storage tank. In order to ensure that the lateral support zone of the proposed footings (1.5H:1V from the face of footing) are not impacted by the storage structure, the lateral support zone for the footings should be dropped below the underside of excavation below the proposed storage tank which was measured to be at an elevation of 72.89 m.

In order to accomplish this, a lean-concrete (15 MPa, 28 day strength) in-filled trench extending to an elevation of 73.5 m is recommended to be placed below the footings of the west foundations walls for Blocks 12 and 14. Additionally, the trench should be extended below the north and south foundation walls by tapering the underside of the lean-concrete upward at a 3H:1V incline between an elevation of 72.89 m below the west foundation walls and up to match the founding levels of the adjacent blocks. The near vertical, zero entry trench should extend at least 300 mm beyond the footing footprint along the west side of the blocks and extend a minimum of 2 m horizontally beyond the footing face along the north and south foundation walls, parallel to the storage tank structure. The near vertical, zero entry trench should be reviewed and approved by Paterson at the time of construction.

Mr. Natan Ary
Page 3
File: PG1630-MEMO.31

We trust that this information satisfies your requirements.

Best Regards,

Paterson Group Inc.



Drew Petahtegoose, B.Eng.



Faisal I. Abou-Seido, P.Eng.

Paterson Group Inc.

Head Office and Laboratory
154 Colonnade Road South
Ottawa - Ontario - K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

Northern Office and Laboratory
63 Gibson Street
North Bay - Ontario - P1B 8Z4
Tel: (705) 472-5331 Fax: (705) 472-2334

St. Lawrence Office
993 Princess Street
Kingston - Ontario - K7L 1H3
Tel: (613) 542-7381

re: Response to City Comments
Proposed Residential Development
2795 Baseline Road - Ottawa

to: Greatwise Developments - **Mr. Natan Ary** - natan@greatwise.ca

cc: DSEL - **Ms. Alison Gosling** - AGosling@dsel.ca

date: May 20, 2020

file: PG1630-MEMO.32

Further to your request and authorization, Paterson Group (Paterson) prepared the following memorandum to respond to the current City of Ottawa engineering review comments for the aforementioned site. This memorandum should be read in conjunction with our geotechnical Report PG1630-5 Revision 1 dated December 11, 2019.

Geotechnical Comments

Item 2

Comment: Provide confirmation that the units can be excavated without impact to the adjacent unit.

Response: Provided that the lateral support zones for the proposed residential structures adjacent to the proposed stormwater retention system are extended vertically as per our response and recommendation for Item 3 of our previous response in PG1630-MEMO.31 dated March 20, 2020, it is not anticipated that the proposed residential dwellings will be negatively impacted by future excavation and maintenance work for the systems. It must be noted that excavations adjacent to the proposed residential structures cannot be extended below an elevation of 72.89 m when completed directly adjacent to the future blocks.

Item 4

Comment: Provide confirmation/additional detailed demonstrating that it is not the intent to infiltrate stormwater with the proposed units. Show clay seal or woven filter cloth as part of the installation details.

Response:

It is understood that the proposed stormwater retention system tank surfaces consist of open-cell walls which will be further covered by a non-woven geotextile fabric across the entire tank perimeter.

The proposed Layfield LP6 non-woven geotextile fabric is a permeable membrane and will not provide a barrier against infiltration of water perched within the backfill surrounding the tank.

In order to eliminate potential infiltration from fill surrounding the tank, it is recommended to substitute the proposed non-woven geotextile fabric with an impermeable geomembrane, such as Terrafix WPE12 or other approved equivalent impermeable liner product. The seams between individual liner sheets must be welded as per the manufacturers specifications to provide a sufficient layer against infiltration of water perched within the backfill soils. Alternative products and further installation should be reviewed by Paterson.

It should be noted that the long-term groundwater table is anticipated to be approximately 2 m below the founding depth of the proposed tank system, and is not anticipated to infiltrate the system should a permeable geotextile fabric, such as the Layfield LP6, be considered for surrounding the surface of the proposed stormwater tank.

We trust that this information satisfies your requirements.

Best Regards,

Paterson Group Inc.



Drew Petahtegoose, B.Eng.



Faisal I. Abou-Seido, P.Eng.


Paterson Group Inc.

Head Office and Laboratory
154 Colonnade Road South
Ottawa - Ontario - K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

Northern Office and Laboratory
63 Gibson Street
North Bay - Ontario - P1B 8Z4
Tel: (705) 472-5331 Fax: (705) 472-2334

St. Lawrence Office
993 Princess Street
Kingston - Ontario - K7L 1H3
Tel: (613) 542-7381

DRAWINGS / FIGURES

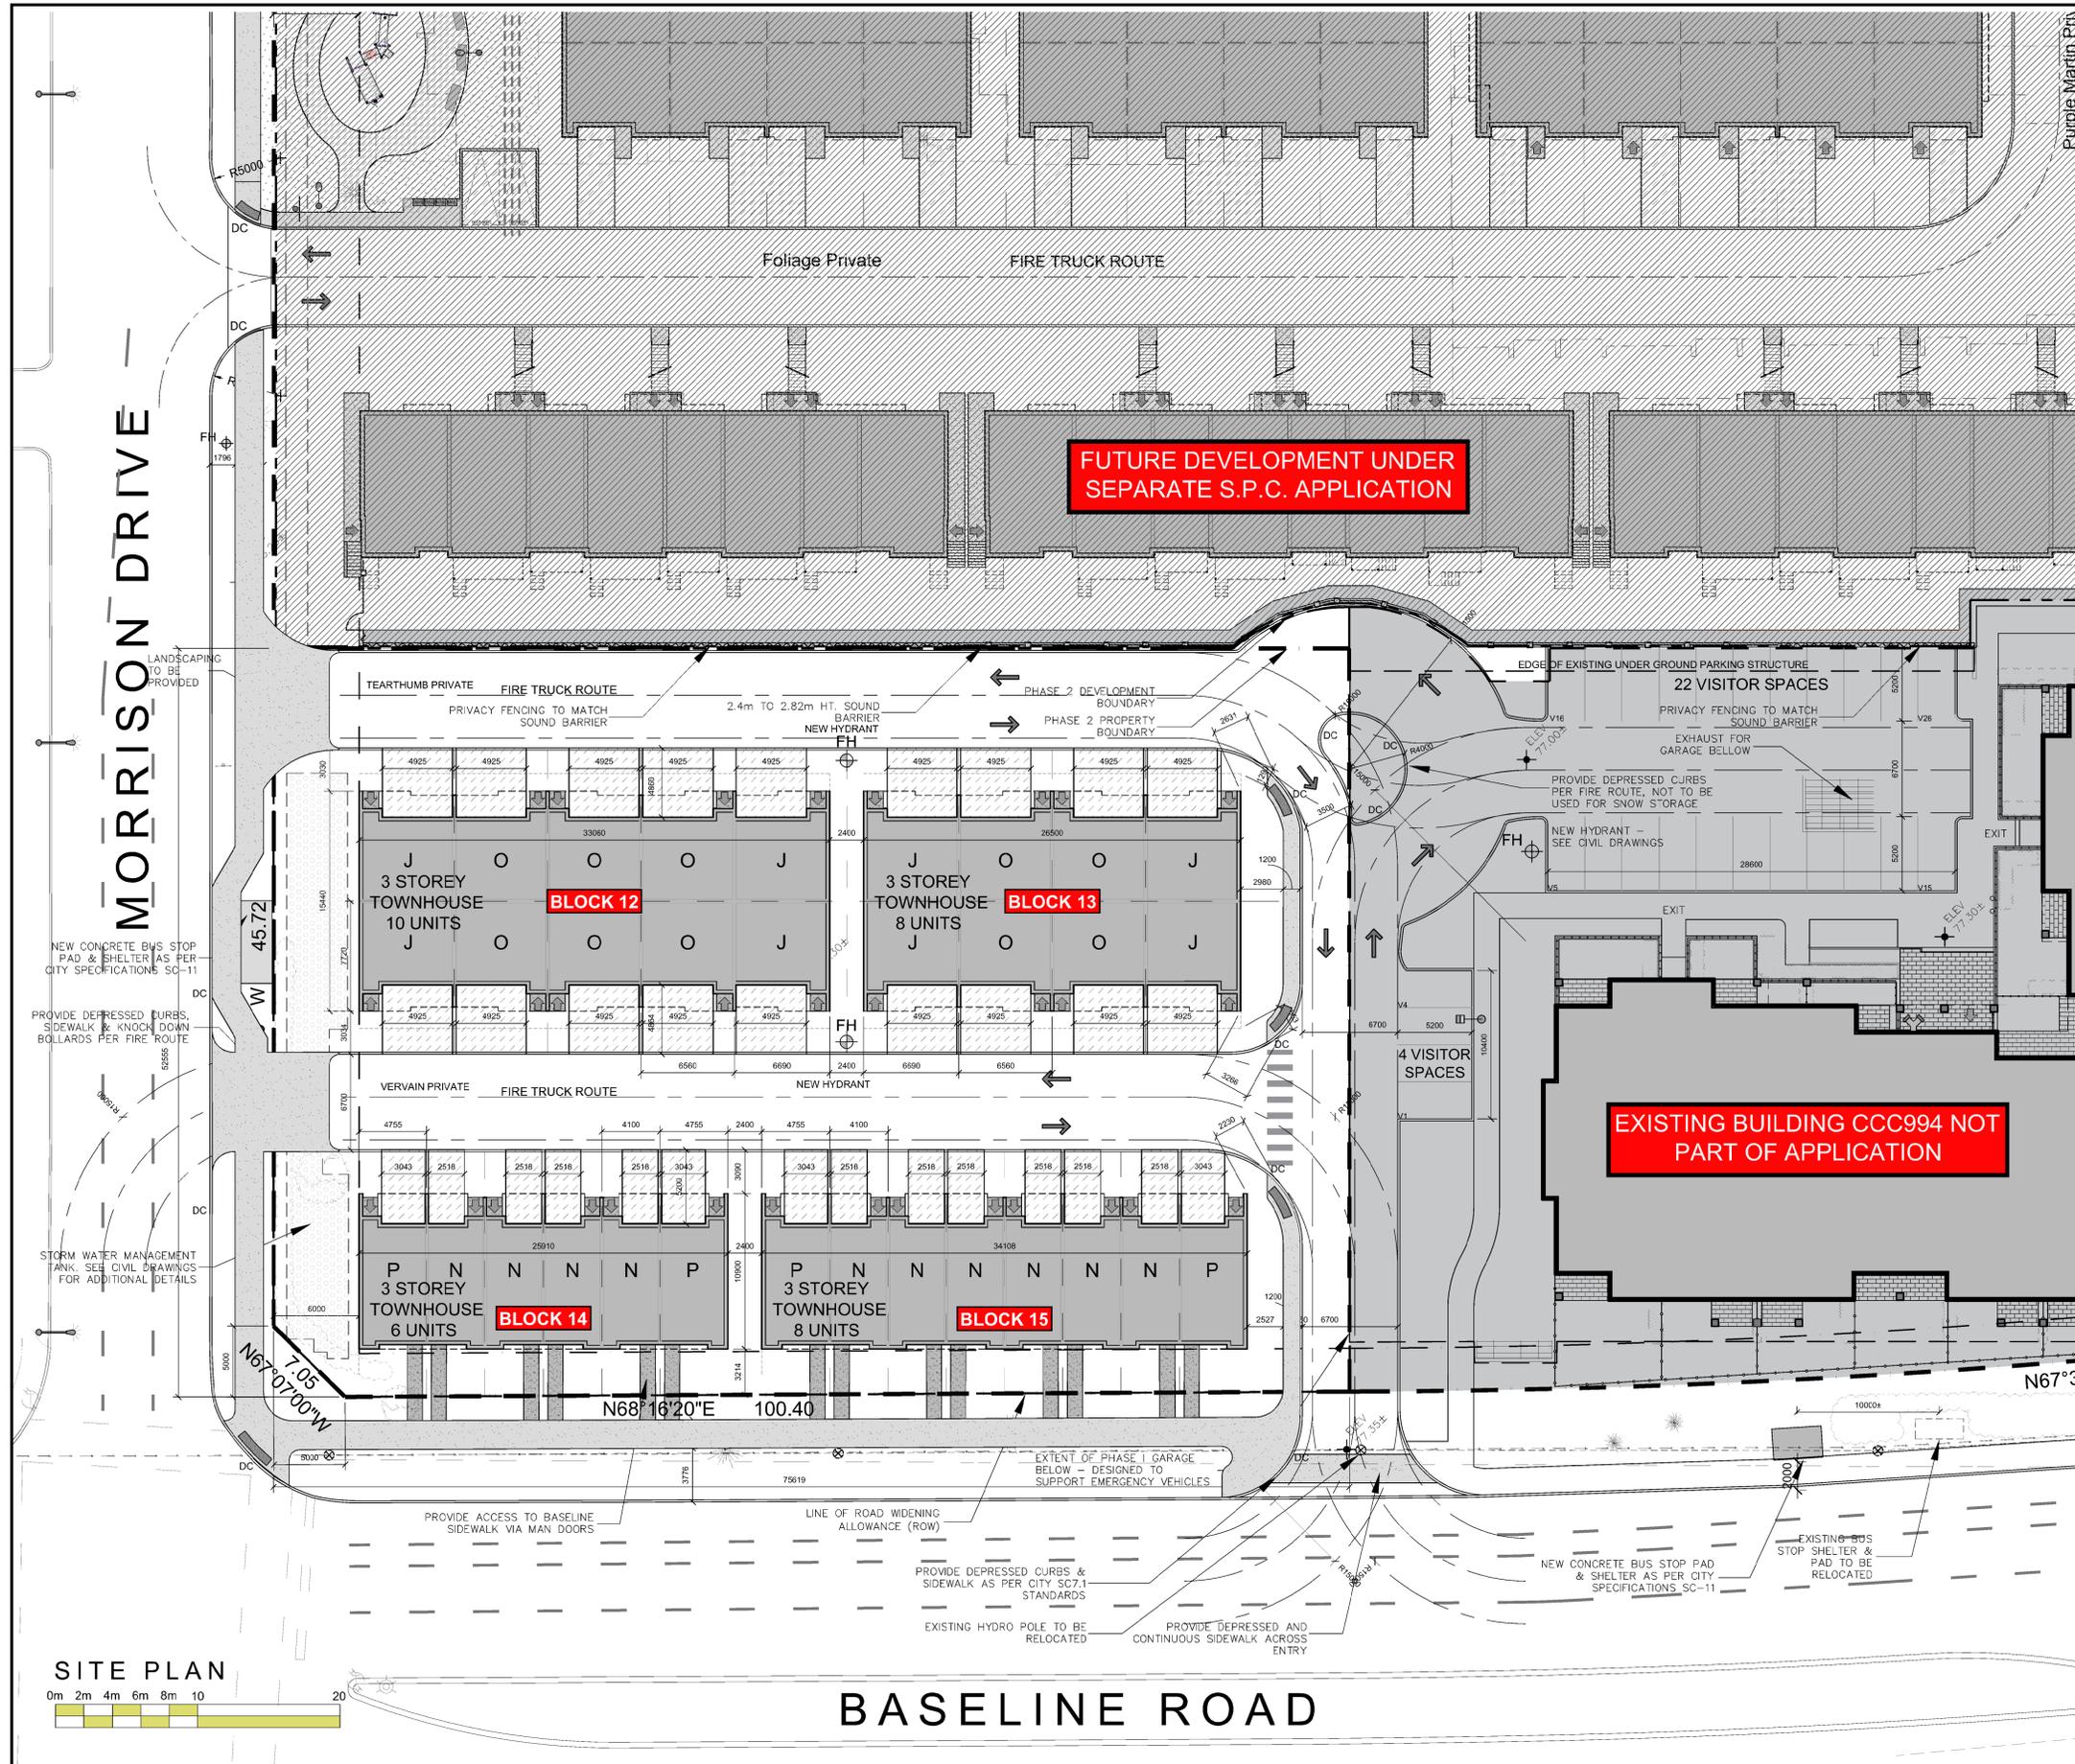

PROJECT INFORMATION

ZONING	Zoning By-Law 2008-250 R54(1703) S247, S282
SITE AREA	INCLUDING ORIGINAL PHASES 21,252.5 sq. m. (228,750) sq. ft.
BUILDING HEIGHT	5 STOREY 18.0 M
OVERALL SITE SETBACK (PHASE 1, 2 & 3)	PROVIDED REQUIRED
FRONT YARD SETBACK (BASELINE ROAD)	3.0 M 3.0 M
MORRISON DRIVE SETBACK	6.0 M 6.0 M
DRAPER AVENUE SETBACK	6.0 M 6.0 M
INTERIOR SIDE YARD SETBACK	6.0 M 6.0 M

PROJECT INFORMATION - PHASE 2 (TOWNHOUSE)

ZONING	Zoning By-Law 2008-250 R54(1703) S247, S282
SITE AREA - PHASE 2	3,947.5 sq. m. (42,491) sq. ft.
BUILDING HEIGHT	3 STOREY 9.0 M
FRONT YARD SETBACK (BASELINE ROAD)	3.0 M
FRONT YARD SETBACK (MORRISON DRIVE)	6.0 M
FRONT YARD SETBACK (DRAPER AVENUE)	6.0 M
INTERIOR SIDE YARD SETBACK	6.0 M

LOT COVERAGE

PAVED SURFACE (ROADS) =	1,094.8 sq. m.	27.7%
PAVED SURFACE (DRIVEWAYS) =	624.9 sq. m.	15.8%
BUILDING FOOTPRINT =	1,260.2 sq. m.	31.9%
LANDSCAPE OPEN SPACE =	967.8 sq. m.	24.6%
LANDSCAPE PARK =	0.0 sq. m.	0.0%
TOTAL =	3,947.5 sq. m.	100.0%

BUILDING STATISTICS

TOWNHOUSE TYPE	UNIT COUNT	TOTAL UNIT AREA
TOWNHOUSE TYPE 'J' (WITH GARAGE)	18	9,940 sq. ft. 923.5 m ²
TOWNHOUSE TYPE 'O' (WITH GARAGE)	10	11,890 sq. ft. 1,075.8 m ²
TOWNHOUSE TYPE 'P' (WITH GARAGE)	4	4,840 sq. ft. 458.9 m ²
TOWNHOUSE TYPE 'N' (WITH GARAGE)	10	10,810 sq. ft. 1,004.3 m ²
TOTAL UNITS	32	37,270 sq. ft. 3,462.5 m²

CAR PARKING

REQUIRED	RESIDENCE	VISITOR	TOTAL
REQUIRED	- 1.0 PER UNIT (32 UNITS)	32	32
REQUIRED	- NOT REQUIRED	0	0
TOTAL		32	32

PROVIDED	RESIDENCE	VISITOR	TOTAL
PROVIDED	- PRIVATE GARAGE	32	32
PROVIDED	- PRIVATE IN DRIVEWAY (BLOCKS 14 & 15 ONLY)	14	14
TOTAL		46	46

ENTRANCE DRIVEWAY TO PHASE 2 AND CONDO BECOMES SHARED PROPERTY

ALL WORKS ON CONDO LAND (CCC994) ARE TO BE DONE IN CONJUNCTION WITH THE PROPOSED DEVELOPMENT

LEGEND

- EXTENTS OF FUTURE DEVELOPMENT UNDER SEPARATE S.P.C. APPLICATION
- EXTENTS OF PHASE 1 PROPERTY BOUNDARY
- EXTENTS OF PHASE 2 DEVELOPMENT BOUNDARY
- PROPERTY LINE
- FOOTPRINT OF FUTURE BLOCKS OF TOWNHOUSES
- SIDEWALKS
- FOOTPRINT OF PRIVATE DRIVEWAY
- UNIT MAIN ENTRY
- PRIVATE ROAD DIRECTION OF TRAVEL

IT IS THE RESPONSIBILITY OF THE APPROPRIATE CONTRACTOR TO CHECK AND VERIFY ALL DIMENSIONS ON SITE AND TO REPORT ALL ERRORS AND/OR OMISSIONS TO THE ARCHITECT.

ALL CONTRACTORS MUST COMPLY WITH ALL PERTINENT CODES AND BY-LAWS.

THIS DRAWING MAY NOT BE USED FOR CONSTRUCTION UNTIL SIGNED BY THE ARCHITECT.

DO NOT SCALE DRAWINGS.

NOTATION SYMBOLS:

- (N) INDICATES DRAWING NOTES, LISTED ON EACH SHEET.
- (A) INDICATES ASSEMBLY TYPE, REFER TO TYPICAL ASSEMBLIES SCHEDULE.
- (W) INDICATES WINDOW TYPE, REFER TO WINDOW ELEVATIONS AND DETAILS ON A300 SERIES.
- (D) INDICATES DOOR TYPE, REFER TO DOOR SCHEDULE AND DETAILS ON A300 SERIES.
- (00) INDICATES DOOR TYPE, REFER TO DOOR SCHEDULE AND DETAILS ON A300 SERIES.
- (01) DETAIL NUMBER
- (02) TITLE
- (03) SCALE
- (04) DETAIL REFERENCE PAGE
- (05) DETAIL CROSS REFERENCE PAGE

GENERAL NOTES:

- REFER TO TYPICAL ASSEMBLIES SHEET FOR WALL, PARTITION, ROOF CEILING & FLOOR TYPES.
- FOR DOOR TYPES AND HARDWARE REQUIREMENTS REFER TO DOOR SCHEDULE ON A300 SERIES.
- ALL INTERIOR DIMENSIONS ARE TAKEN FROM THE FACE OF STUD.
- ALL EXTERIOR DIMENSIONS ARE TAKEN FROM THE FACE OF STUD.
- ALL EXTERIOR WALLS ARE TO BE TYPE 'W1' UNLESS NOTED OTHERWISE.
- ALL INTERIOR PARTITIONS ARE TO BE TYPE 'P1' UNLESS NOTED OTHERWISE.
- ALL REINFORCED CONCRETE SUSPENDED SLABS, COLUMNS & BEAMS HAVE A MIN. FRR OF 1.5 HRS (AS DETERMINED BY CBC S8-2) UNLESS OTHERWISE STATED.

No.	DESCRIPTION	DATE
1	ISSUED FOR SPA COMMENT RESPONSE	2-03-2020
2	ISSUED FOR SITE PLAN CONTROL PHASE 2	05-03-2020
3	ISSUED FOR SPA COMMENT RESPONSE	13-02-2020
4	ISSUED FOR ROAD NAMING APPLICATION	31-01-2020
5	ISSUED FOR SITE PLAN CONTROL PHASE 2	09-12-2019
6	ISSUED FOR COORDINATION	05-12-2019
7	ISSUED FOR COORDINATION	26-11-2019
8	ISSUED FOR SITE PLAN CONTROL PHASE 2	16-09-2019
9	ISSUED FOR SITE PLAN CONTROL PHASE 2	13-09-2019
10	ISSUED FOR COORDINATION	05-09-2019
11	ISSUED FOR USE AS BASE SITE PLAN	08-07-2019
12	ISSUED FOR USE IN T.I.A. REPORT	18-06-2019

REVISIONS:

ARCHITECT SEAL:

CLIENT:

ARCHITECT:

56 beach street, ottawa, ontario k1s 3j6
t. 613.724.9932 f. 613.724.1209 rlaarchitecture.ca

PROJECT TITLE:

FRESH TOWNS
MODERN URBAN LIVING
2710 DRAPER AVENUE
OTTAWA ONTARIO

SHEET TITLE: **SITE PLAN - FRESH TOWNS PHASE 2**

DRAWN: L.M.	CHECKED: RLA
SCALE: 1:200	SHEET No. SP-01
PROJECT No. 1733	

PROJECT DEVELOPER GreatWise Developments 333 Wilson Avenue Toronto, ON, M3H 1T2 Phone: (416) 630-6767 Fax: (416) 630-6304	SURVEYOR Annis O'Sullivan Vollebakk Ltd. 5871 Hugh Crescent 14 Concourse Gate, Suite 500, Nepean, Ontario K2E 7S6 Tel: (613) 727-0850 Fax: (613) 727-1079	LANDSCAPE ARCHITECT Larocque Levstek 5871 Hugh Crescent Ottawa, (Osgoode) ON K0A 2W0 Tel: (613) 826-0518	CIVIL ENGINEER David Schaeffer Engineering Ltd. 120 Iber Road, Unit 203 Stittsville, Ontario, Canada, K2S 1E9 Tel: (613) 836-0856 Fax: (613) 836-7183
---	--	---	---

SITE PLAN SYMBOLS

	HARD SURFACE WALKWAY		TWO WAY VEHICLE CIRCULATION
	NEW CITY CONCRETE SIDEWALK		ENTRANCE LOCATION
	EXISTING CITY STREET LIGHT		BOLLARD STYLE BIKE RACK
	LIGHT STANDARD		FIRE HYDRANT
			DEPRESSED CURB
			STOP SIGN


TOPOGRAPHICAL SKETCH OF:

MORRISON COURT & PART OF DRAPER COURT
(Closed by Judge's Order CR483411)
PART OF BLOCK G, REGISTERED PLAN 447761
OTTAWA-CARLETON STANDARD CONDOMINIUM PLAN No.
894, CITY OF OTTAWA
Prepared by Annis, O'Sullivan, Vollebakk Ltd.
Field Work Completed May 4, 2017



D07-12-19-0009

DRAPER AVENUE
REGISTERED PLAN 447761

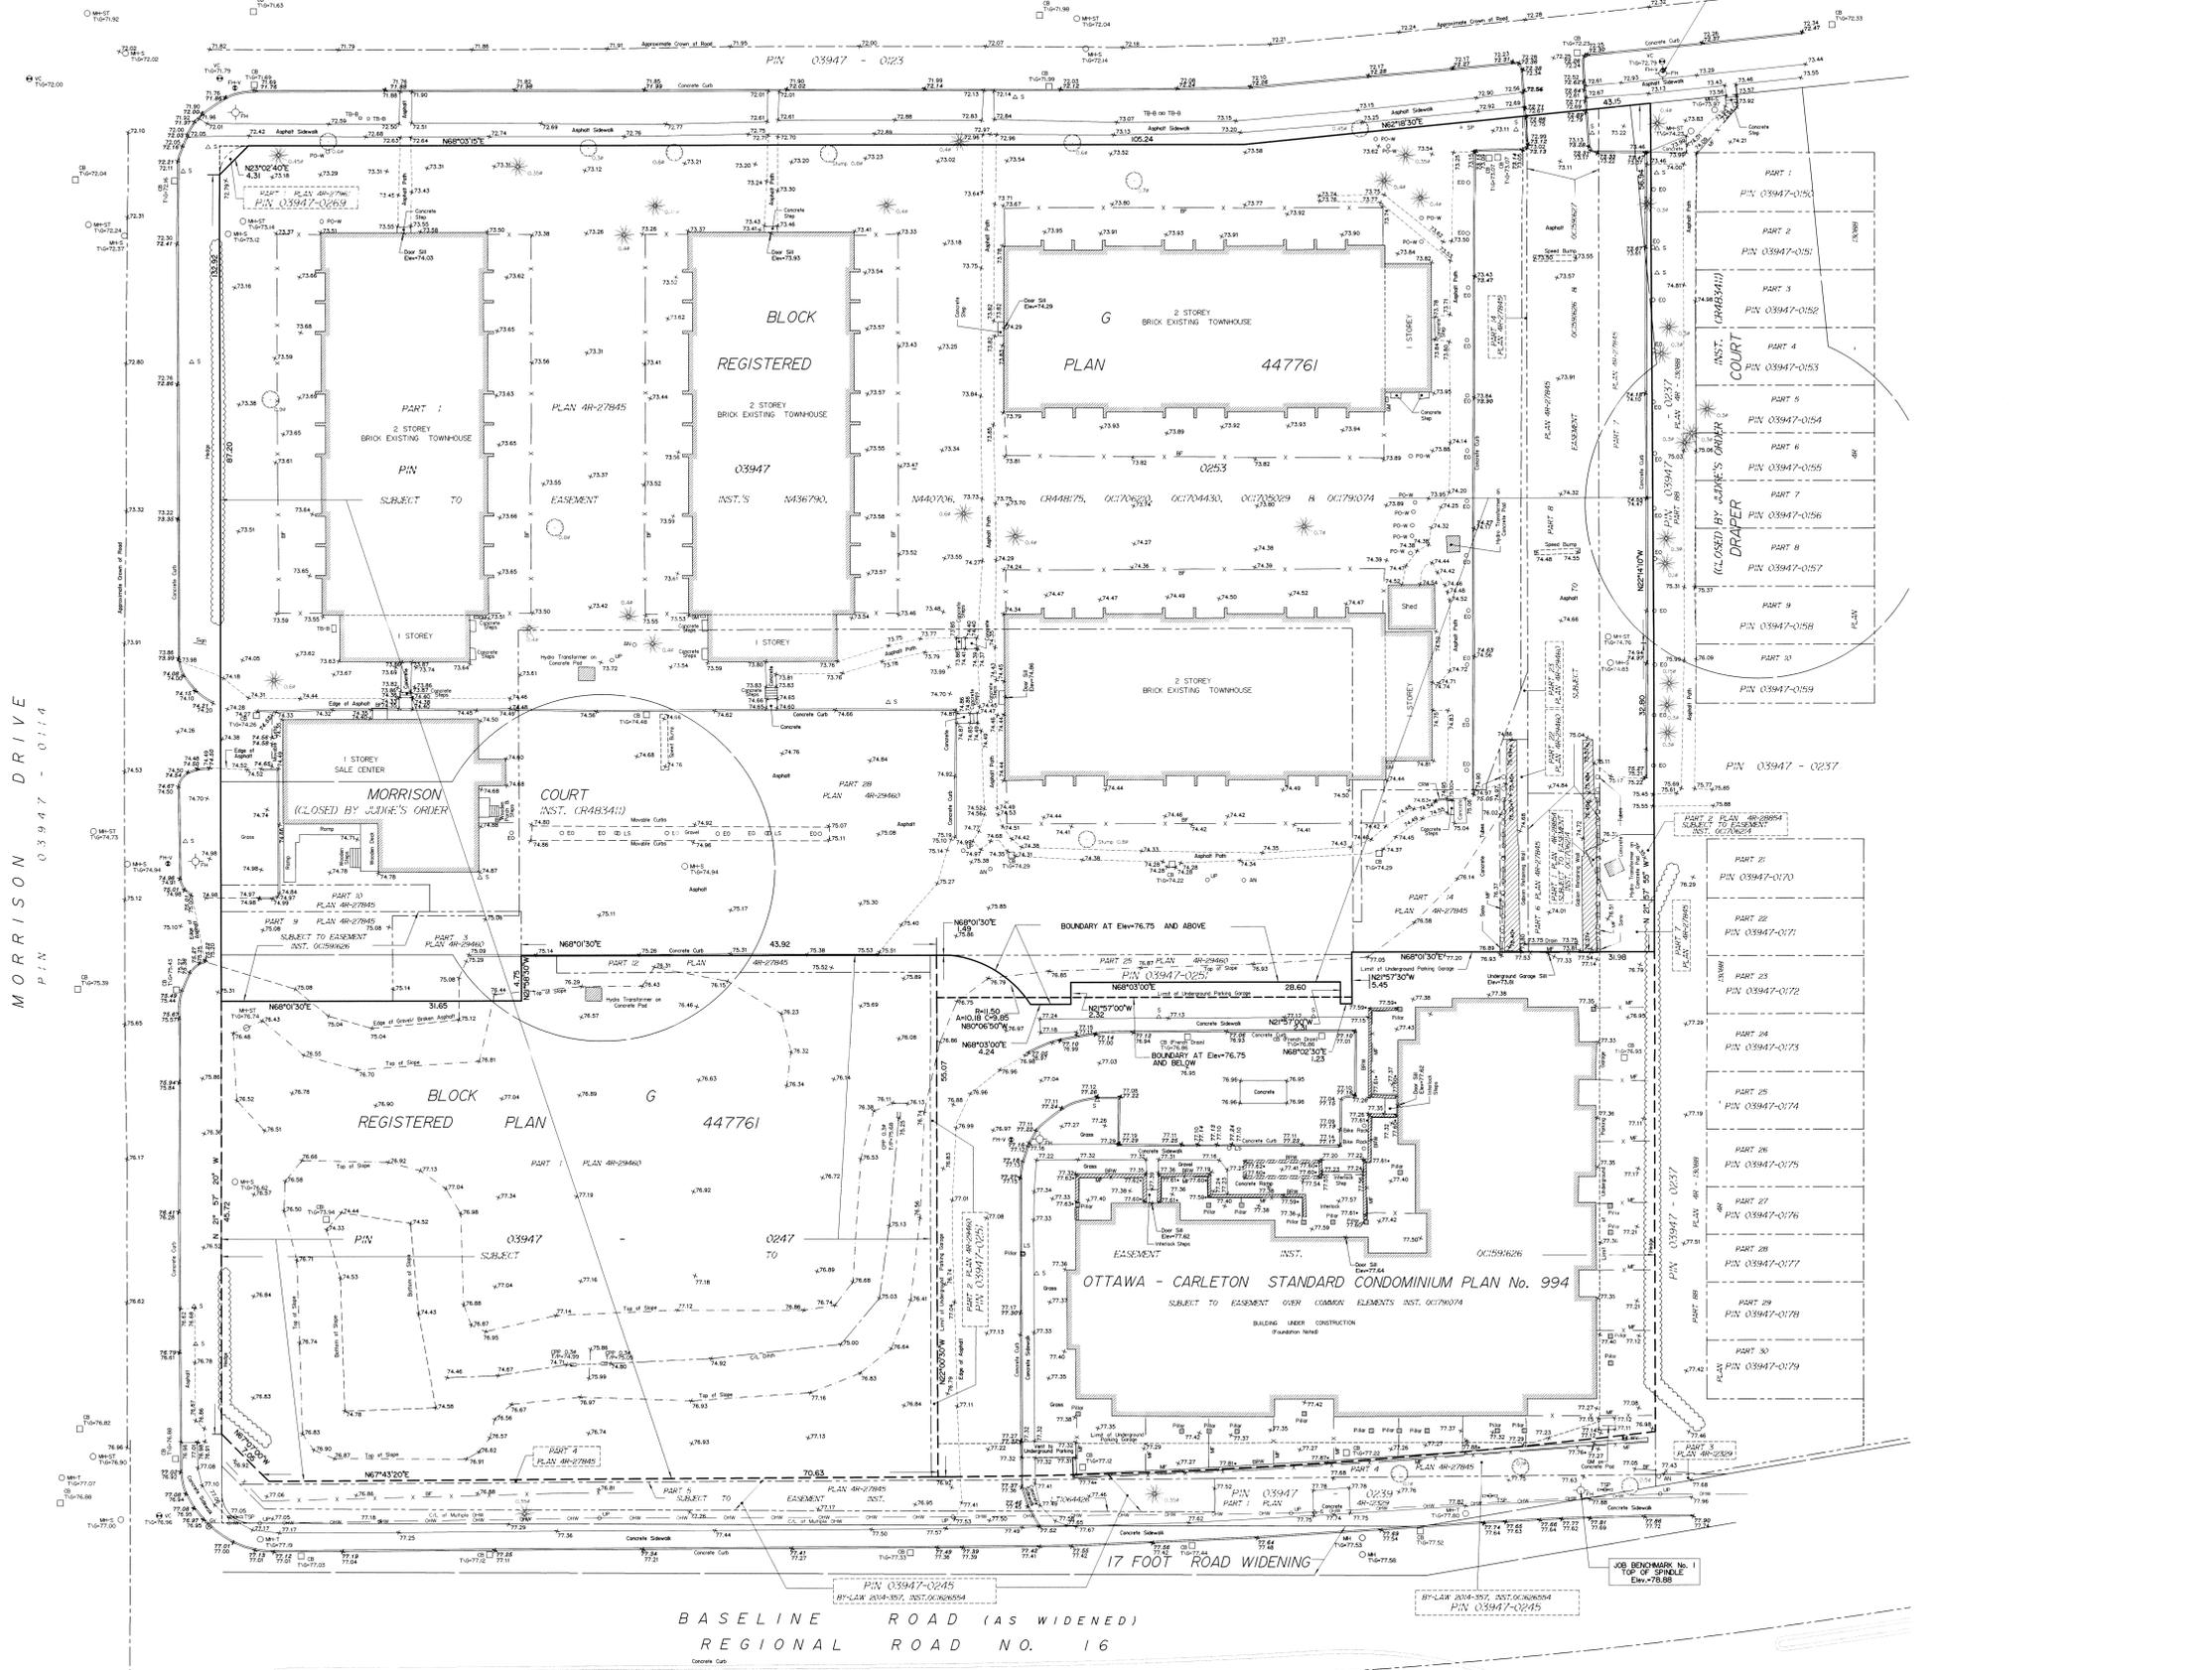

TOPOGRAPHICAL SKETCH OF
MORRISON COURT &
PART OF DRAPER COURT
(Closed by Judge's Order CR483411)
PART OF BLOCK G
REGISTERED PLAN 447761
AND
OTTAWA-CARLETON STANDARD
CONDOMINIUM PLAN No. 994
CITY OF OTTAWA

Prepared by Annis, O'Sullivan, Vollebek Ltd.
Field Work Completed May 4, 2017

Scale 1:250
0 5 10 15 20 25 30 35 40 45 50 Metres

Metric
DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND
CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

Notes & Legend

Denotes	
○ MH-S	Maintenance Hole (Storm Sewer)
○ MH-T	Maintenance Hole (Sanitary)
○ MH	Maintenance Hole (Undersized)
○ CB	Catch Basin
○ CB	Catch Basin Inlet
○ VC	Valve Chamber (Waterman)
○ FH	Fire Hydrant
○ WV	Water Valve
○ GV	Gas Valve
○ GM	Gas Meter
○ TP	Traffic Signal Post
○ S	Sign
○ CP	Corrugated Plastic Pipe
○ TP	Top of Pipe
○ TD	Top of Ditch
○ D	Deciduous Tree
○ C	Coniferous Tree
○ MF	Metal Fence
○ BF	Board Fence
○ UP	Utility Pole
○ AN	Anchor
○ LS	Light Standard
○ PO-W	Wood Pole
○ EO	Electrical Outlet
○ EB	Bell Terminal Box
○ D	Diameter
○ LE	Location of Elevations
○ LE	Top of Wall Elevations
○ LE	Top of Concrete Curb Elevation
○ CL	Centerline
○ PL	Property Line
○ BRW	Brick Retaining Wall
○ CRW	Concrete Retaining Wall

BOUNDARY INFORMATION SHOWN HEREON HAS BEEN
COMPILED FROM FIELD SURVEY AND EXISTING DOCUMENTS.

ELEVATION NOTES
1. Elevations shown are geoidic and are referred to the CGVD28 geoidic datum.
2. It is the responsibility of the user of this information to verify that the spot benchmark
has not been altered or disturbed and that its relative elevation and description
agrees with the information shown on this drawing.

UTILITY NOTES
1. This drawing cannot be accepted as acknowledging all of the utilities and it will
be the responsibility of the user to contact the respective utility authorities for
confirmation.
2. Only visible surface utilities were located.
3. A field location of underground plants by the pertinent utility authority is
mandatory before any work involving breaking ground, probing, excavating etc.

re: Response to City Comments
Proposed Residential Development
2795 Baseline Road - Ottawa

to: Greatwise Developments - **Mr. Zaf Kelekvan** - zaf@greatwise.ca

Cc: DSEL - **Ms. Alison Gosling** - AGosling@dsel.ca

date: February 6, 2020

file: PG1630-MEMO.30

Further to your request and authorization, Paterson Group (Paterson) prepared the following memorandum to respond to the current City of Ottawa engineering review comments for the aforementioned site. This memorandum should be read in conjunction with our retaining wall design drawing PG1630-4 Revision 5 dated February 6, 2020.

Geotechnical Comments

Item 25

Comment: It's not clear how the grading will tie with the existing retaining wall north the side between the property and the neighbour, please provide a x-section.

Response: Supplemental information has been provided on the design cross-section to show grading at the back and front of the wall. Blocks with finished ends and back sides are to be provided at the near the existing retaining wall on the east end. Those blocks will allow to match the existing grade above the garage entrance and provide a nice finished exposed face on all sides.

We trust that this information satisfies your requirements.

Best Regards,

Paterson Group Inc.



Joey R. Villeneuve, M.A.Sc., P.Eng.



Faisal I. Abou-Seido, P.Eng.

Paterson Group Inc.


Head Office and Laboratory
154 Colonnade Road South
Ottawa - Ontario - K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

Northern Office and Laboratory
63 Gibson Street
North Bay - Ontario - P1B 8Z4
Tel: (705) 472-5331 Fax: (705) 472-2334

St. Lawrence Office
993 Princess Street
Kingston - Ontario - K7L 1H3
Tel: (613) 542-7381

PROFILE VIEW


SCALE - 1:100

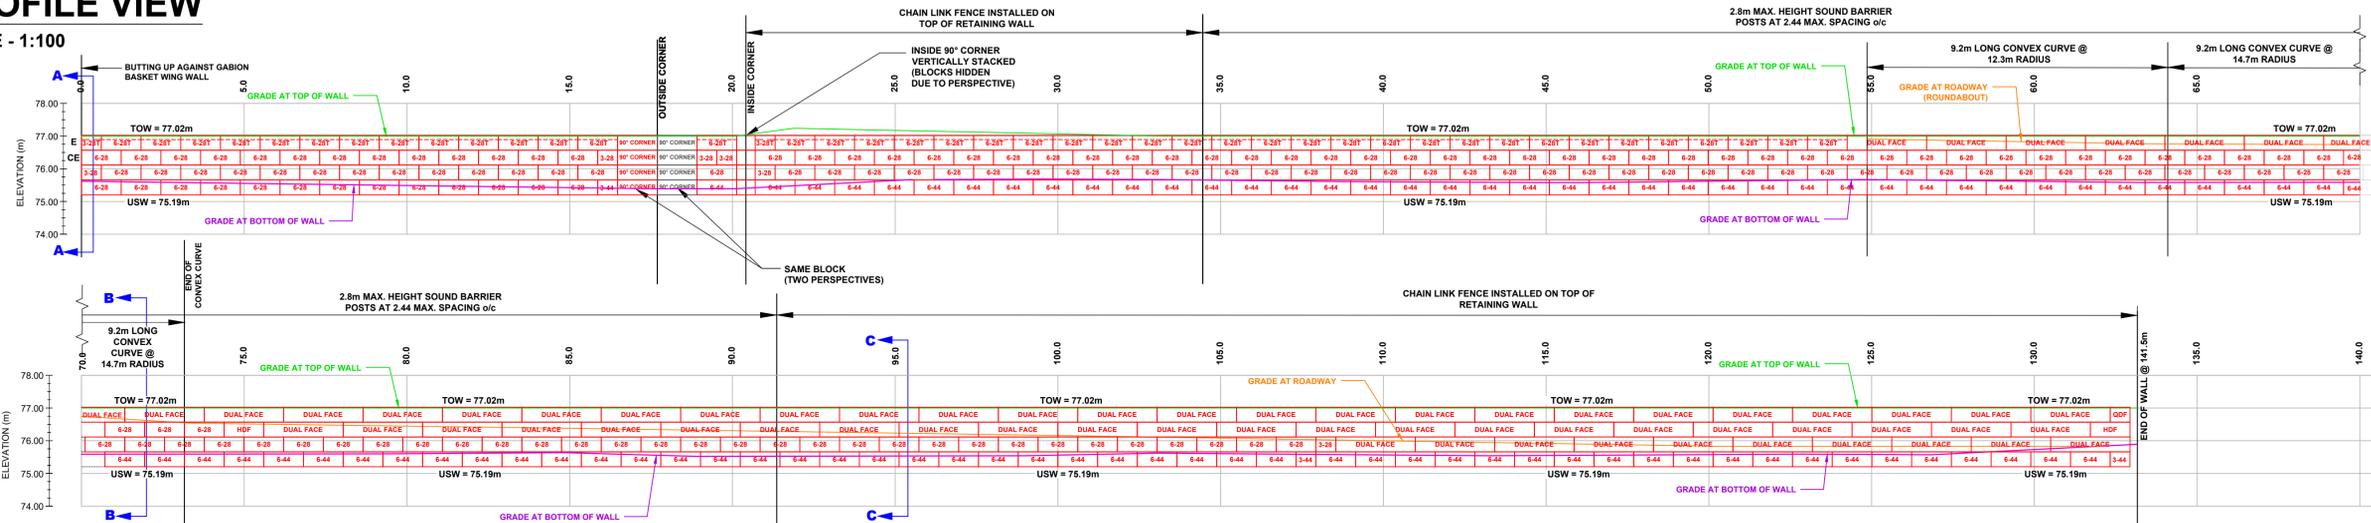


BLOCK LEGEND

6-44	6-44 UNIT (91 BLOCKS)
3-44	3-44 UNIT (3 BLOCKS)
6-28	6-28 UNIT (155 BLOCKS)
3-28	3-28 UNIT (5 BLOCKS)
3-28T	3-28 TOP UNIT (2 BLOCKS)
6-28T	6-28 TOP UNIT (41 BLOCKS)
E 3-28T	CORNER END UNIT (1 - 3/28 END BLOCKS)
CE 6-28T	CORNER END UNIT (1 BLOCK)
90° CORNER	90° CORNER UNIT (8 BLOCKS)
DUAL FACE	DUAL FACE UNIT (65 BLOCKS)
HDF	HALF DUAL FACE UNIT (3 BLOCKS)


GRADING PLAN

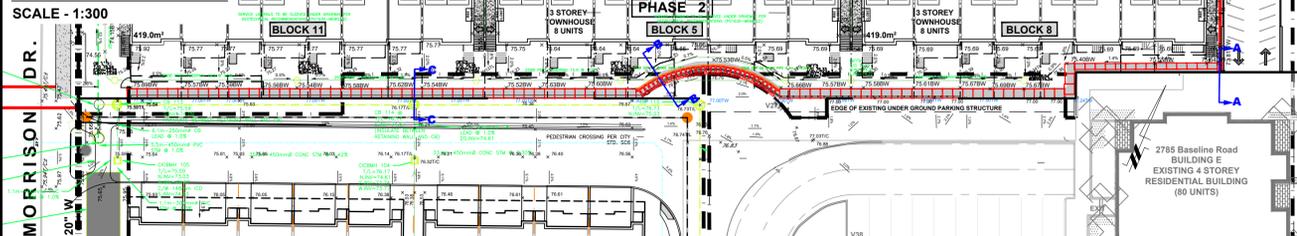

CROSS SECTION A-A

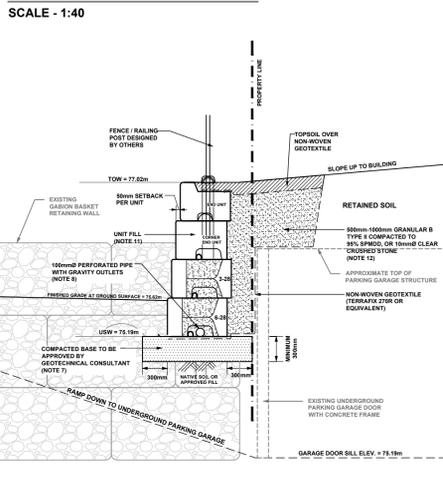

CROSS SECTION C-C

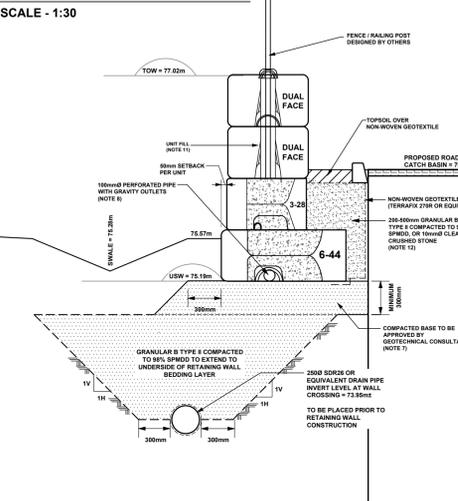

- NOTES:
- THE CONTRACTOR IS SOLELY RESPONSIBLE FOR UTILITY CLEARANCE AND CONSTRUCTION SITE SAFETY. MCON PRODUCTS INC. AND PATERSON GROUP SHALL NOT BE RESPONSIBLE FOR MEANS OR METHODS OF CONSTRUCTION OR FOR SAFETY OF WORKERS OR OF THE PUBLIC.
 - THIS DESIGN IS BASED ON THE FOLLOWING SOIL PROPERTIES:

PROPERTY	RETAINED FILL	FOUNDATION MEDIUM
FRICITION ANGLE - PH	33	33
UNIT WEIGHT -	21 KN/m ³	21 KN/m ³
COHESION - C	0	0
SOIL TYPE	GRANULAR B TYPE II & NATIVE FILL	GLACIAL TILL
 - MATERIAL PROPERTIES ARE BASED ON SITE EVALUATION BY THE PATERSON GROUP. SEISMIC LOADING WAS EVALUATED ACCORDING TO THE ONTARIO BUILDING CODE 2012 WITH A PEAK GROUND ACCELERATION VALUE OF 0.32. NO SURCHARGE LOAD IS APPLICABLE FOR THIS WALL.
 - THE WALL BASE DESIGN ASSUMES A BEARING RESISTANCE AT SLS OF 150 kPa. THE SITE GEOTECHNICAL ENGINEER SHOULD OBSERVE THE BEARING CONDITIONS AND ADJUST THE THICKNESS OF THE GRANULAR BASE OR RECOMMEND CONCRETE BEDDING TO ACCOMMODATE THE SITE CONDITIONS, IF NECESSARY.
 - THE DESIGN IS FOR STABILITY OF THE PRECAST MODULAR RETAINING WALL SYSTEM ONLY. SITE STABILITY (GLOBAL STABILITY) IS THE RESPONSIBILITY OF THE SITE GEOTECHNICAL ENGINEER. WALL GEOMETRY AND GRADE ELEVATIONS ABOVE AND BELOW THE WALL SHOULD CONFORM WITH THE GRADING PLAN PROVIDED HEREIN IF IN ACTUAL SITE. GRADES VARY SIGNIFICANTLY FROM THOSE SHOWN OR IF THE BACK SLOPE DOES NOT CONFORM WITH INSTALLATION, INSTALLATION SHALL NOT PROCEED UNTIL THE ALL DESIGN IS VERIFIED OR MODIFIED IN THE APPLICABLE AREA.
 - HORIZONTAL LAYOUT DIMENSIONS ARE MEASURED ALONG THE FACE OF THE WALL, CORRESPONDING TO A HORIZONTAL REFERENCE ESTABLISHED BY PATERSON GROUP BASED ON DRAWINGS BY DAVID SHAFFER ENGINEERING LIMITED, PROJECT NO. 17-027, REVISION B, GRADING PLAN - FRESH TOWNS #710 DRAPER AVENUE, PHASE 2, FEBRUARY 6TH 2020.
 - PRECAST UNITS SHALL BE STONE STRONG RETAINING WALL UNITS MANUFACTURED UNDER LICENSE FROM STONE STRONG SYSTEMS. UNITS SHALL HAVE A MOLDED GRANITE FACE. THE BLOCKS MAY BE STAINED IN PLACE TO ACHIEVE THE DESIRED COLOR.
 - THE WALL BASE SHALL CONSIST OF A GRANULAR BASE OF 300mm OF OPSS GRANULAR A OR GRANULAR B TYPE II. THE BASE SHALL BE COMPACTED AS TO PROVIDE A LEVEL AND HARD SURFACE ON WHICH TO PLACE THE FIRST COURSE OF UNITS. GRANULAR BASE MATERIAL SHALL BE COMPACTED TO A MINIMUM 95% OF STANDARD PROCTOR MAXIMUM DRY WEIGHT (SPMD). THE BASE SHALL BE SMOOTHED TO ENSURE COMPLETE CONTACT OF RETAINING WALL UNIT WITH BASE. SURFACE OF GRANULAR BASE MUST BE DRESSED WITH FINER AGGREGATE TO AID LEVELING. ENSURE GRADATION OF DRESSING MATERIAL IS SUCH AS TO PRECLUDE LOSS OF FINES INTO BASE. THE THICKNESS OF DRESSING LAYER SHOULD NOT EXCEED 3 TIMES THE MAXIMUM PARTICLE SIZE USED. THE CONTRACTOR MAY SUBSTITUTE CONCRETE WITH A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 20 MPa AND AIR ENTRAINMENT FOR THE GRANULAR BASE MATERIAL. FOR WALL SSSA, THE WALL BASE SHALL CONSIST THE 200mm CONCRETE CAP ABOVE THE PROPOSED HELIX PILES.
 - INSTALL 100 MM DIAMETER PERFORATED PIPE DRAIN UNDER LOWER COURSE OF WALL (OR ALTERNATIVELY BEHIND HEEL OF WALL). PROVIDE CLEAR STONE SURROUNDING THE DRAIN PIPE TO PROTECT PIPE FROM CLOGGING AND DAMAGE. PROVIDE OUTLETS THROUGH WALL BASE LAYER AT LOW AREAS. NO FURTHER APART THAN 15m CENTRES.
 - WALL IS DESIGNED FOR A MINIMUM OF 300 mm TOE EMBEDMENT WITH A MINIMUM HORIZONTAL LEDGE OF 300mm BEYOND THE FACE AND REAR OF BASE BLOCK. WHERE GRANULAR BEDDING WILL NOT BE SUFFICIENT, THE USE OF CONCRETE BEDDING MAY BE REQUIRED. EXTRA PRECAUTIONS MUST BE TAKEN TO PROVIDE TOE EMBEDMENT IN AREAS WHERE BASE OF WALL STEPS.
 - THE RETAINING WALLS ARE BATTERED WALLS. ALIGNMENT OF THE BOTTOM WALL UNIT COURSE SHOULD BE PLANNED TO CONSIDER THAT A NOMINAL 100 mm AUTOMATIC SETBACK WILL OCCUR WITH EACH 0.91 m HIGH UNIT. AS SUCH, THE LOWEST WALL BASE WITHIN A CONTINUOUS SECTION SHOULD BE WITHIN WALL CORRIDOR, INCLUDING REQUIREMENT FOR BASE EXTENT IN FRONT OF WALL. SIMILARLY, THE FACE OF THE HIGHEST WALL (T/W LEVEL) WITHIN THE SECTION SHOULD ALSO BE AT LEAST WITHIN 0.5 m WITHIN THE WALL CORRIDOR (OR AS REQUIRED BY OWNER).
 - UNIT FILL SHALL BE A CLEAN, COURSE GRANULAR MATERIAL. UNIT FILL SHALL BE 100mm CLEAR STONE MEETING THE SATISFACTION OF THE GEOTECHNICAL ENGINEER. UNIT FILL SHALL FILL CAVITIES WITHIN AND BETWEEN THE UNITS AND MAY EXTEND BEHIND THE FACING UNITS FOR THE CONTRACTOR'S CONVENIENCE.
 - BACKFILL MATERIAL SHALL BE APPROVED BY THE SITE GEOTECHNICAL ENGINEER PRIOR TO USE AND SHOULD CONSIST OF OPSS GRANULAR B TYPE II BUFFER OF 500mm TO 1000mm AS SHOWN WIDTH. ALL FILL WITHIN A 1H:1V ZONE UP AND BACK FROM THE HEEL SHOULD ALSO BE COMPACTED. BACKFILL SHALL BE PLACED IN MAXIMUM 300 mm LOOSE LIFTS AND COMPACTED TO A MINIMUM OF 95% OF THE MATERIAL'S SPMD. MOISTURE CONTENT SHOULD BE CONTROLLED AND MAINTAINED WITHIN 3 TO +4 PERCENT OF OPTIMUM.
 - ENSURE EACH COURSE IS COMPLETELY FILLED AND BACKFILL IS PLACED TO THE SAME LEVEL PRIOR TO PROCEEDING TO THE NEXT COURSE. ENSURE ADJACENT UNITS ARE IN CONTACT SO THAT UNIT FILL MAY NOT ESCAPE THROUGH THE JOINT BETWEEN UNITS. GAPS GREATER THAN 8 mm BETWEEN UNITS (AT THE FACE) SHALL NOT BE ALLOWED. AT THE INTERSECTIONS WITH STRUCTURES, CUT UNITS TO OBTAIN A NEAT FIN. FULL BLOCK UNITS FORWARD TO ENGAGE THE ALIGNMENT LOOPS ON THE UNIT BELOW BEFORE INFILLING IN ALL CASES.
 - MAINTAIN TEMPORARY GRADES TO DIVERT SURFACE WATER AWAY FROM THE RETAINING WALL EXCAVATION. SLOPE FINAL BACKFILL TO PROVIDE POSITIVE DRAINAGE AND TO ELIMINATE PONDING, WHERE APPLICABLE, THE UPPER COURSE FOR THE RETAINING WALL CONSISTS OF DUAL FACE (DF) BLOCKS WHICH ALLOW FOR THE GRADE BEHIND THE TOP OF THE WALL TO VARY, WHILE PRESENTING A FINISHED REAR WALL FACE.
 - IF WATER CONSTRUCTION IS CONSIDERED, HEAT MUST BE MAINTAINED WHEN THE BASE IS EXPOSED. THE WALL BASE MUST BE COVERED WITH INSULATION TAPPS TO MAINTAIN HEAT AND PROTECT THE BASE FROM POTENTIAL FROST HEAVE. ONCE THE BASE IS BACKFILLED, THE TOP OF WALL MUST BE COVERED WITH INSULATION TAPPS OVERHUNG UNIT THE WALL CONSTRUCTION IS COMPLETED.
 - THE GEOTECHNICAL CONSULTANT SHOULD BE NOTIFIED IN THE BEGINNING OF THE WALL CONSTRUCTION TO COMPLETE PERIODIC INSPECTIONS AND PROVIDE GEOTECHNICAL RECOMMENDATIONS AS THE WALL CONSTRUCTION PROGRESSES.
 - DURING THE CONSTRUCTION OF THE RETAINING WALL, THE CONTRACTOR MUST ENSURE THAT A SAFE SLOPE IS PROVIDED BEHIND THE RETAINING WALL. PATERSON GROUP SHOULD COMPLETE PERIODIC INSPECTIONS TO ENSURE A PROPER SLOPE IS PROVIDED AS PER THE SITE GEOTECHNICAL RECOMMENDATIONS.
 - ANY INADEQUATE PERFORMING SUBGRADE SHOULD BE SUB-EXCAVATED AND REPLACED WITH OPSS GRANULAR B TYPE II, COMPACTED TO 98% OF THE MATERIAL'S SPMD.
 - ANY RYCB AND PREPARED PIPE PROPOSED ALONG THE WALL ARE TO BE INSTALLED SIMULTANEOUSLY OR PRIOR TO PLACEMENT OF BASE BLOCKS TO AVOID UNDERMINING THE WALL.
 - ANY CUTTING OF BLOCKS TO SUIT SITE CONDITIONS OR WALL DESIGN WILL BE THE RESPONSIBILITY OF THE CONTRACTOR. REMOVAL/CUTTING OF LIFTING LOOPS ON THE FINAL ROW OF BLOCKS WILL BE THE RESPONSIBILITY OF THE CONTRACTOR.
 - WHEN THE PROPOSED RETAINING WALL BUTTS UP AGAINST THE EXISTING GABION BASKET WALL ALONG THE GARAGE ENTRANCE, CONSIDERATIONS SHOULD BE GIVEN TO CAUTIOUSLY PERFORM COMPACTION WITHIN 300mm OF THE EXISTING WALL TO AVOID PUSHING THE EXISTING BLOCKS FORWARD.
 - REAR YARD SUBDRAN AND CATCH BASIN IS TO BE INSTALLED PRIOR OR AT THE SAME TIME AS THE RETAINING WALL.
 - THE CONTRACTOR WILL BE RESPONSIBLE TO CORE DUAL FACE BLOCK TO INSTALL PROPOSED FENCING AND/OR SOUND BARRIER AS PER DESIGNED THROUGH ALL DUAL FACE BLOCKS. SEE TYPICAL SECTION FENCE POST TO BE GROUDED IN PLACE WITH MINIMUM 28MPa GROUT.


MIN. CONVEX CURVE RADIUS

Wall Height (m)	Total # of Courses	Reqd. Radius at Top Course
0.91	2	4.93m
1.37	3	4.98m
1.83	4	5.03m
2.29	5	5.08m
2.74	6	5.13m
3.20	7	5.18m
3.66	8	5.23m


Wall Height (m)	Total # of Courses	Reqd. Radius at First Course
0.91	2	4.93m
1.37	3	4.98m
1.83	4	5.03m
2.29	5	5.08m
2.74	6	5.13m
3.20	7	5.18m
3.66	8	5.23m

ISSUED FOR CONSTRUCTION


CORNER DETAILS

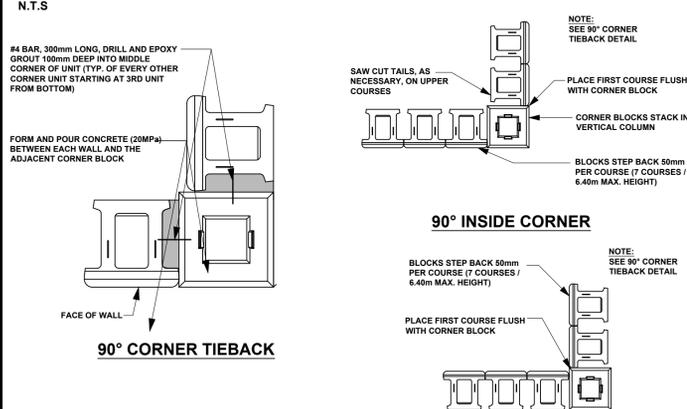


CONVEX CURVE PLAN VIEW

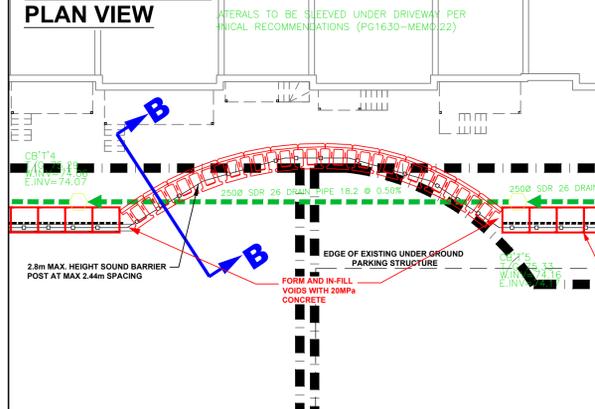

CROSS SECTION B-B

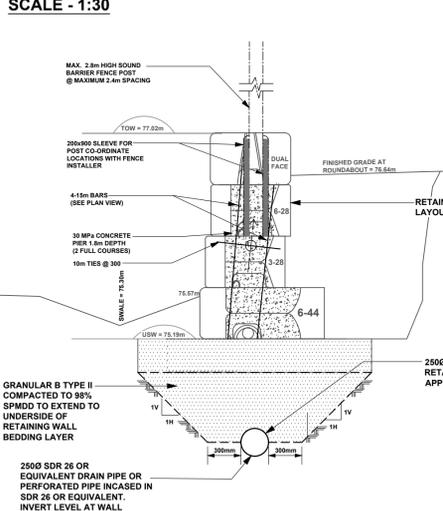

SOUND BARRIER DETAILS

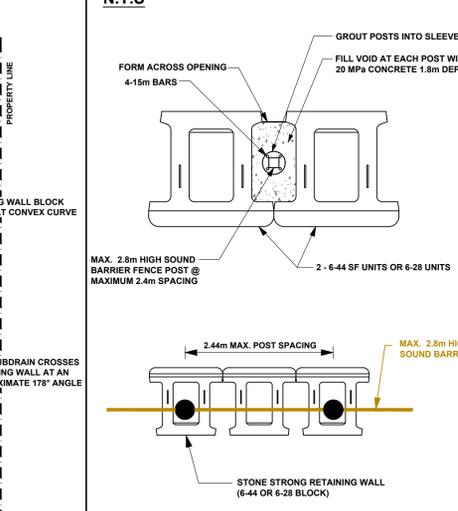

patersongroup
consulting engineers

154 Colonnade Road South
Ottawa, Ontario K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

NO.	REVISIONS	DATE	INITIAL
54	REVISED AS PER NEW GRADING PLAN	05/02/2020	FA
4	REVISED AS PER NEW BASE PLAN	12/08/2019	FA
3	REVISED CROSS SECTION A-A	28/07/2019	FA
2	REVISED AS PER NEW WALL LAYOUT	22/07/2019	FA
1	ISSUED FOR CONSTRUCTION	11/06/2019	FA

GREATWISE DEVELOPMENTS
PROPOSED RETAINING WALL
PROPOSED RESIDENTIAL DEVELOPMENT - PHASE 3-2- 2795 BASELINE ROAD
OTTAWA, ONTARIO

STONE STRONG RETAINING WALL DESIGN

Stamp:
LICENCED PROFESSIONAL ENGINEER
F. I. ABU-SAYED
100156/44
PROVINCE OF ONTARIO

Scale:	AS SHOWN	Report No.:	PG1630
Drawn by:	RCG	Drawing No.:	
Checked by:	FA		
Approved by:	FA		PG1630-4
Date:	03/2019	Revision No.:	5

PLAN NO. : #17529

D07-12-18-0184