

NOTES

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS BY NEUF ARCHITECTES SENCRL. REFER TO ARCHITECTURAL PLANS FOR DIMENSIONS.
- ALL WATERMAINS TO BE INSULATED IF LESS THAN 2.4 METERS COVER AS PER CITY OF OTTAWA STANDARD DETAIL W22. AT ANY PROXIMITY OF SEWER MANHOLES, INSULATE WATERMAIN AS PER CITY DETAIL W23.
- SEWERS ARE TO MAINTAIN 500mm BARREL TO BARREL CLEARANCE ABOVE AND 250mm BARREL TO BARREL CLEARANCE BELOW WATERMAINS AT ALL CROSSINGS (AS PER CITY DWGS W25 AND W25.2). IF 22" BENDS ARE USED ON THE WATER MAIN, THEY MUST BE ONE METER AWAY FROM THE SEWER.
- THRUST BLOCKS TO BE AS PER CITY OF OTTAWA STANDARD DRAWINGS W25.3 AND W25.4. RESTRAINING AND RETAINING RINGS TO BE INSTALLED IN ACCORDANCE WITH CITY STANDARD DETAILS W25.5 AND W25.6.
- TEMPORARY SUPPORT OF EXISTING UNDERGROUND UTILITIES IN ACCORDANCE WITH CITY STANDARD DETAIL W28.
- WATERMAIN TRENCH AND BEDDING TO BE INSTALLED AS PER CITY DETAIL W17.
- TAPPING VALVE SYSTEM CONNECTION TO CITY WATERMAIN BY CITY FORCES, EXCAVATION, BACKFILLING AND REINSTATEMENT BY CONTRACTOR.
- CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATION OF ALL EXISTING UG AND OVERHEAD UTILITIES. VARIOUS UTILITIES CONCERNED TO BE GIVEN REQUIRED ADVANCE NOTICE PRIOR TO ANY DIGGING FOR STAKE OUT. THE OWNER AND CONSULTANT ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THE LOCATION OF EXISTING UTILITIES AS INDICATED ON THIS DRAWING.
- UTILITY INFORMATION WAS VERIFIED IN THE FIELD WHERE POSSIBLE. INDIVIDUAL COMPANIES SHOULD BE CONTACTED BY THE CONTRACTOR PRIOR TO COMMENCEMENT FOR CONFIRMATION OF EXISTENCE AND LOCATION OF UTILITIES.
- WATER SERVICE, STORM SEWERS AND APPURTENANCE TO COMPLY WITH THE REQUIREMENTS OF THE LATEST REVISION OF THE ONTARIO PLUMBING CODE AND APPLICABLE CITY OF OTTAWA ENGINEERING STANDARDS.
- ALL SANITARY SEWERS TO BE INSULATED IF LESS THAN 2.0 METERS COVER. ALL STORM SEWERS TO BE INSULATED IF LESS THAN 2.0 METERS COVER. INSULATE AS PER CITY OF OTTAWA STANDARD DETAIL W22. ALL BUILDING CONNECTIONS TO HAVE SUFFICIENT COVER OR INSULATION IS REQUIRED.
- CONTRACTOR SHALL CONTACT THE CONSULTANT, R.V. ANDERSON PRIOR TO BACKFILLING OF THE WATER SERVICE CONNECTIONS FOR THE PROPOSED LINES AND TIE-INS TO EXISTING LINES FOR AS-BUILT LOCATION RECORDS AND INSPECTION.
- ANY ASPHALT CUT SHALL BE SAW CUT ON BOTH SIDES OF THE TRENCH FOR THE ENTIRE LENGTH OF THE EXCAVATION FOR PIPE INSTALLATIONS. REINSTATEMENT OF THE ROADS SHALL MATCH EXISTING OR MEET CITY STANDARD R10.
- ANY CONCRETE CUT SHALL BE REMOVED AT EXPANSION JOINTS. IF NO JOINTS EXIST, THE CONCRETE SHALL BE SAW CUT ON BOTH SIDES OF THE TRENCH FOR THE ENTIRE LENGTH OF THE EXCAVATION FOR PIPE INSTALLATIONS. REINSTATEMENT SHALL MATCH EXISTING OR MEET CITY REQUIREMENTS.
- PIPE BEDDING SHALL BE GRANULAR "A" AS PER CITY DETAIL S6. AND SHALL BE COMPACTED TO 95% SPD AND APPROVED SELECT NATIVE BACK FILL COMPACTED TO 95% SPD.
- DRAWINGS TO BE READ IN CONJUNCTION WITH CONTRACT SPECIFICATIONS.
- GRANULAR LAYERS BENEATH NEW ASPHALT SURFACES ON PROPERTY SHALL BE PLACED AT A THICKNESS NOT EXCEEDING 300mm. THE GRANULAR "A" AND GRANULAR "B" TYPE II IS TO BE COMPACTED TO A MINIMUM OF 100% SPMD USING SUITABLE VIBRATORY EQUIPMENT.
- THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE OWNER'S BONDED CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS NORMALLY REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS, BUT NOT LIMITED TO THE FOLLOWING: ROAD CUT PERMITS, APPROACH APPROVAL, PERMITS, RELOCATION OF SERVICES, COMMITTEE OF ADJUSTMENT, ENCROACHMENT AGREEMENTS, WATER PERMIT, ETC.
- THE OWNER SHALL REQUIRE THAT THE SITE SERVING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. SPECIFICALLY, THE LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSB 410.07.01.16 AND 407.07.26. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.
- REFER TO LANDSCAPE DRAWINGS FOR DETAILS ON LANDSCAPING TREATMENTS AND PLANTINGS.
- SEWERS TO BE CONSTRUCTED AS PER CITY OF OTTAWA SPECIFICATIONS - SPECIAL PROVISION F-4100. ALL SEWER STRUCTURES AS PER F-4070. ALL WATER MAINS AS PER F-4411 AND ALL ASSOCIATED SPECIFICATIONS. IRON ADJUSTMENTS PER F-4080.
- EROSION AND SEDIMENT CONTROL MEASURES IN ACCORDANCE WITH THE REQUIREMENTS OF OPSB 806 - NOVEMBER 2018 FOR TEMPORARY MEASURES) CONSISTING OF BOTH PERMANENT AND TEMPORARY MEASURES SHALL BE IMPLEMENTED PRIOR TO THE COMMENCEMENT OF CONSTRUCTION ACTIVITIES TO ENSURE THAT SEDIMENT IS CONTAINED WITHIN THE SITE. PERMANENT EROSION CONTROL MEASURES SHALL ENSURE THAT POTENTIAL LONG-TERM AND LOCALIZED EROSION PROBLEMS ARE DEALT WITH PRIOR TO THEIR OCCURRENCE. FILTER FABRIC SHALL BE INSTALLED UNDER THE FRAME OF ALL PROPOSED AND EXISTING CATCHBASINS AND STORM MANHOLES IMMEDIATELY ADJACENT TO ANY DISTURBED AREAS PRIOR TO CONSTRUCTION TO PREVENT SEDIMENT FROM ENTERING INTO THE STORM SEWER SYSTEM. THE FILTER FABRIC SHALL REMAIN IN PLACE FOR THE DURATION OF CONSTRUCTION ACTIVITIES AND SHALL NOT BE REMOVED UNTIL SUCH TIME AS THE LANDSCAPING HAS BEEN ESTABLISHED AND UPON AUTHORIZATION BY THE ENGINEER. LIGHT DUTY SEDIMENT FENCING SHALL ALSO BE PLACED AROUND THE PERIMETER OF THE SITE FOR THE DURATION OF THE CONSTRUCTION.
- THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- CONNECTION OF THE WATER SERVICES TO THE CITY WATERMAIN BY CITY FORCES, EXCAVATION, BACKFILLING AND REINSTATEMENT BY CONTRACTOR.
- REFER TO THE STORM WATER MANAGEMENT & SITE SERVING REPORTS FROM R.V. ANDERSON DATED FEBRUARY 19, 2020 FOR FURTHER DETAILS.
- REFER TO GEOTECHNICAL REPORT BY PINCHIN LTD. DATED APRIL 29, 2020 FOR SOILS INFO.
- SIDEWALK DEPRESSIONS PER CITY DETAIL S06.
- REFER TO MECHANICAL DRAWINGS FOR INTERNAL PLUMBING INCLUDING WATER METER, BACKFLOW PREVENTION, INTERNAL PIPING, FOUNDATION DRAINAGE CONNECTION ETC.

CONTAMINATED WATER / FOUNDATION DRAIN INFORMATION:

THE QUALITY OF WATER COLLECTED BY THE FOUNDATION DRAINAGE SYSTEM IS EXAMINED IN THE PHASE II ESA REPORT, DRAFT ISSUED NOVEMBER 30, 2020. THE REMEDIAL TECHNOLOGY EVALUATION - OVERVIEW LETTER, DATED NOVEMBER 30, 2020. THE WATER TAKING & DISCHARGE PLANS REPORT DATED APRIL 7, 2020. AND THE REMEDIAL PLAN FOR ADDRESSING GROUNDWATER IMPACTS MEMO DATED DECEMBER 4, 2020 (ATTACHED IN APPENDIX A.II). PREPARED BY PINCHIN. BASED ON THE FINDINGS OF THE ABOVE REPORTS, IT IS UNDERSTOOD THAT THE GROUNDWATER ON SITE WAS FOUND TO HAVE CONTAMINANTS EXCEEDING THE ALLOWABLE LEVELS ENTERING EITHER THE SANITARY OR STORM SEWER SYSTEMS AS SPECIFIED IN THE SEWER USE BYLAW. THE ABOVE NAMED REPORTS PROPOSE REMEDIAL MEASURES INCLUDING REMOVING THE IMPACTED SOIL FROM THE SITE AND PROVIDING GROUNDWATER MONITORING TO ASSESS RESIDUAL CONTAMINANT LEVELS. FOLLOWING REMEDIAL MEASURES, THREE SCENARIOS ARE PRESENTED WHICH ALL REQUIRE ULTIMATE DISCHARGE TO THE SANITARY SYSTEM.

- SCENARIO 1: REMEDIAL ACTIONS BRING GROUNDWATER QUALITY BELOW BOTH MECP TABLE 7 STANDARDS AND SANITARY SEWER DISCHARGE STANDARDS. IN THIS CASE FOUNDATION DRAINAGE WILL BE PUMPED TO THE SANITARY SYSTEM.
- SCENARIO 2: REMEDIAL ACTIONS FAIL TO BRING GROUNDWATER QUALITY BELOW MECP TABLE 7 STANDARDS BUT SUCCESSFULLY MEET SANITARY SEWER DISCHARGE STANDARDS. IN THIS CASE FOUNDATION DRAINAGE WILL BE PUMPED TO THE SANITARY SYSTEM.
- SCENARIO 3: REMEDIAL ACTIONS FAIL TO BRING GROUNDWATER QUALITY BELOW BOTH MECP TABLE 7 STANDARDS AND ALSO FAIL TO SUCCESSFULLY MEET SANITARY SEWER DISCHARGE STANDARDS. IN THIS CASE PINCHIN HAS RECOMMENDED TREATMENT OF THE GROUNDWATER BE COMPLETED BY PASSING IT THROUGH ACTIVATED CARBON CYLINDERS BEING PUMPED TO THE SANITARY SYSTEM.

REFER TO THE ENVIRONMENTAL AND WATER TAKING REPORTS FOR FURTHER INFORMATION.

ANY WATER TREATMENT SYSTEMS, IF REQUIRED, WILL BE DESIGNED BY OTHERS AS PART OF THE BUILDING SYSTEMS.

AS ALL REMEDIAL SCENARIOS PRESENTED REQUIRE DISCHARGE TO SANITARY SEWER, THE FOUNDATION DRAINAGE FLOW RATE OF 65,000 L/DAY (8.75 L/S) IS INCLUDED IN THE SITE FLOW RATES FOR THE SANITARY SEWER CAPACITY ANALYSIS IN THE SITE SERVING REPORT. IT IS UNDERSTOOD THAT THE WATER COLLECTED BY THE FOUNDATION DRAINAGE WILL BE COLLECTED IN A SUMP PIT(S) AND PUMPED VIA INTERNAL PLUMBING WITH THE CONNECTION TO THE SANITARY SYSTEM WITHIN THE BUILDING.

STORM INVERT SCHEDULE			
STRUCTURE	GROUND	INVERT	COMMENTS
RD#1	63.76	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#2	64.17	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#3	64.24	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#4	64.29	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#5	64.30	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#6	63.35	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#7	64.50	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#8	64.69	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#9	63.85	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#10	63.85	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#11	63.85	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
RD#12	63.85	SEE MECHANICAL	ROOF DRAIN SEE MECHANICAL
CB#1	62.92	EXISTING	REPLACE FRAME AND COVER WITH SURFACE STYLE PER CITY DETAIL S11.1
CB#2	63.17	EXISTING	REPLACE FRAME AND COVER WITH SURFACE STYLE PER CITY DETAIL S11.1
CAP AT PROPERTY LINE	63.91	62.41	CAP SERVICE AT PROPERTY LINE FOR FUTURE CONNECTION
WATERMAIN CROSSING	63.82	62.35	STIM LATERAL CROSSES OVER 200mm WATERMAIN. TOP OF WM = 61.10m. CLEARANCE = 1.70m.
SANITARY CROSSING	63.85	62.30	STIM LATERAL CROSSES OVER 200mm SANITARY SEWER. SEWER INVERT = 61.20m. CLEARANCE = 800mm.
CONNECTION TO CITY SEWER	63.87	62.32	CONNECT TO 800mm STORM SEWER AS PER CITY DWG S11. CITY SEWER INVERT 61.80m.
STORM CISTERN CONNECTION	63.90	59.58	CONNECT TO 800mm STORM MONITORING MANHOLE. FRAMES COVER PER S18.1 & S25.
WATERMAIN CROSSING	63.44	59.57	STIM LATERAL CROSSES UNDER 100mm WATERMAIN. BOTTOM OF WM = 60.75m. CLEARANCE = 190mm.
SANITARY CROSSING	63.16	59.48	STIM LATERAL CROSSES UNDER 375mm SANITARY SEWER. SEWER INVERT = 60.39m. CLEARANCE = 150mm.
CONNECTION TO CITY SEWER	63.12	59.40	CONNECT TO 1200mm STORM SEWER AS PER CITY DWG S11. CITY SEWER INVERT 59.70m.

PRIVATE WATERMAIN TABLE					
	STATION	DESCRIPTION	TOP OF PIPE ELEVATION	GROUND ELEVATION	COMMENTS
150mm PVC DR18 WATER SERVICE (NORTH SIDE)	1+00.0	BUILDING/PARKING GARAGE CONNECTION	SEE MECHANICAL	63.99	CONNECTION TO BUILDING SERVICES. SEE MECHANICAL
	1+02.3	VALVE & VALVE BOX	61.48	63.88	VALVE AND VALVE BOX PER W24
	1+04.7	STORM CROSSING	60.67	63.84	WATERMAIN CROSSES UNDER 1200mm STORM SEWER PER W25. STORM INVERT= 61.32m (BARREL TO BARREL CLEARANCE = 500mm)
	1+09.9	CONNECTION TO 203mm Ø WM.	61.01	63.66	CONNECT TO CITY WATERMAIN AS PER W33
150mm PVC DR18 WATER SERVICE (EAST SIDE)	2+00.0	BUILDING/PARKING GARAGE CONNECTION	SEE MECHANICAL	63.99	CONNECTION TO BUILDING SERVICES. SEE MECHANICAL
	2+02.6	VALVE & VALVE BOX	61.39	63.89	VALVE AND VALVE BOX PER W24
	2+04.9	CONNECTION TO 203mm Ø WM.	60.57	63.43	CONNECT TO CITY WATERMAIN AS PER W33
50mm PEX WATER MAIN (PARK)	3+00.0	PARK CONNECTION	SEE MECHANICAL LANDSCAPE	64.00	NEW PARK WATER METER CHAMBER PER W31.1
	3+00.8	VALVE & VALVE BOX	61.63	64.03	VALVE AND VALVE BOX PER W24
	3+06.1	CONNECTION TO 203mm Ø WM.	61.18	63.82	CONNECT TO CITY WATERMAIN AS PER W33

SANITARY INVERT SCHEDULE			
STRUCTURE	GROUND	INVERT	COMMENTS
BUILDING/PARKING GARAGE CONNECTION	63.46	61.19	CONNECTION TO BUILDING SERVICES. SEE MECHANICAL FOR MONITORING PORT IN PARKING GARAGE
MONITORING PORT	63.45	61.18	NEW 250mm DIAMETER MANHOLE PER CITY DETAIL S18.1. STEEL COVER PER S18.1.
WATERMAIN CROSSING	62.82	60.59	SAN LATERAL CROSSES OVER 200mm WATERMAIN. TOP OF WM = 60.42m. CLEARANCE = 190mm.
CONNECTION TO MAIN SEWER	62.88	60.92	CONNECT TO 250mm SANITARY SEWER AT NEW 1200mm DIAMETER MANHOLE. SEWER INVERT 61.00. NEW MANHOLE PER CITY DETAIL S18.1. FRAME IN CONCRETE PER S25.4 & S25.
CAP AT PROPERTY LINE	63.91	61.50	CAP NEW SERVICE AT PROPERTY LINE FOR FUTURE CONNECTION.
WATERMAIN CROSSING	63.72	61.40	SAN LATERAL CROSSES OVER 200mm WATERMAIN. TOP OF WM = 61.15m. CLEARANCE = 200mm. NOTE SEWER WATER CROSSING.
CONNECTION TO MAIN SEWER	63.76	61.36	CONNECT TO 250mm SANITARY SEWER PER S11.1. SEWER INVERT 61.00.


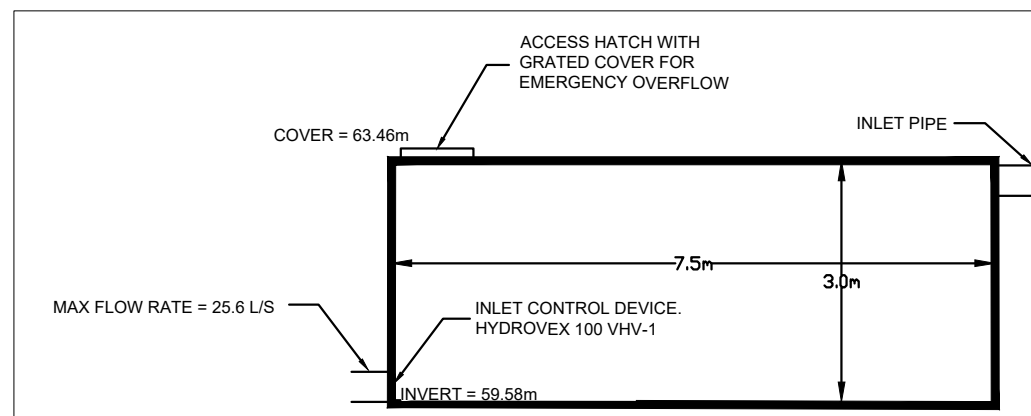


FIGURE 1: STORMWATER TANK SCHEMATIC DETAIL

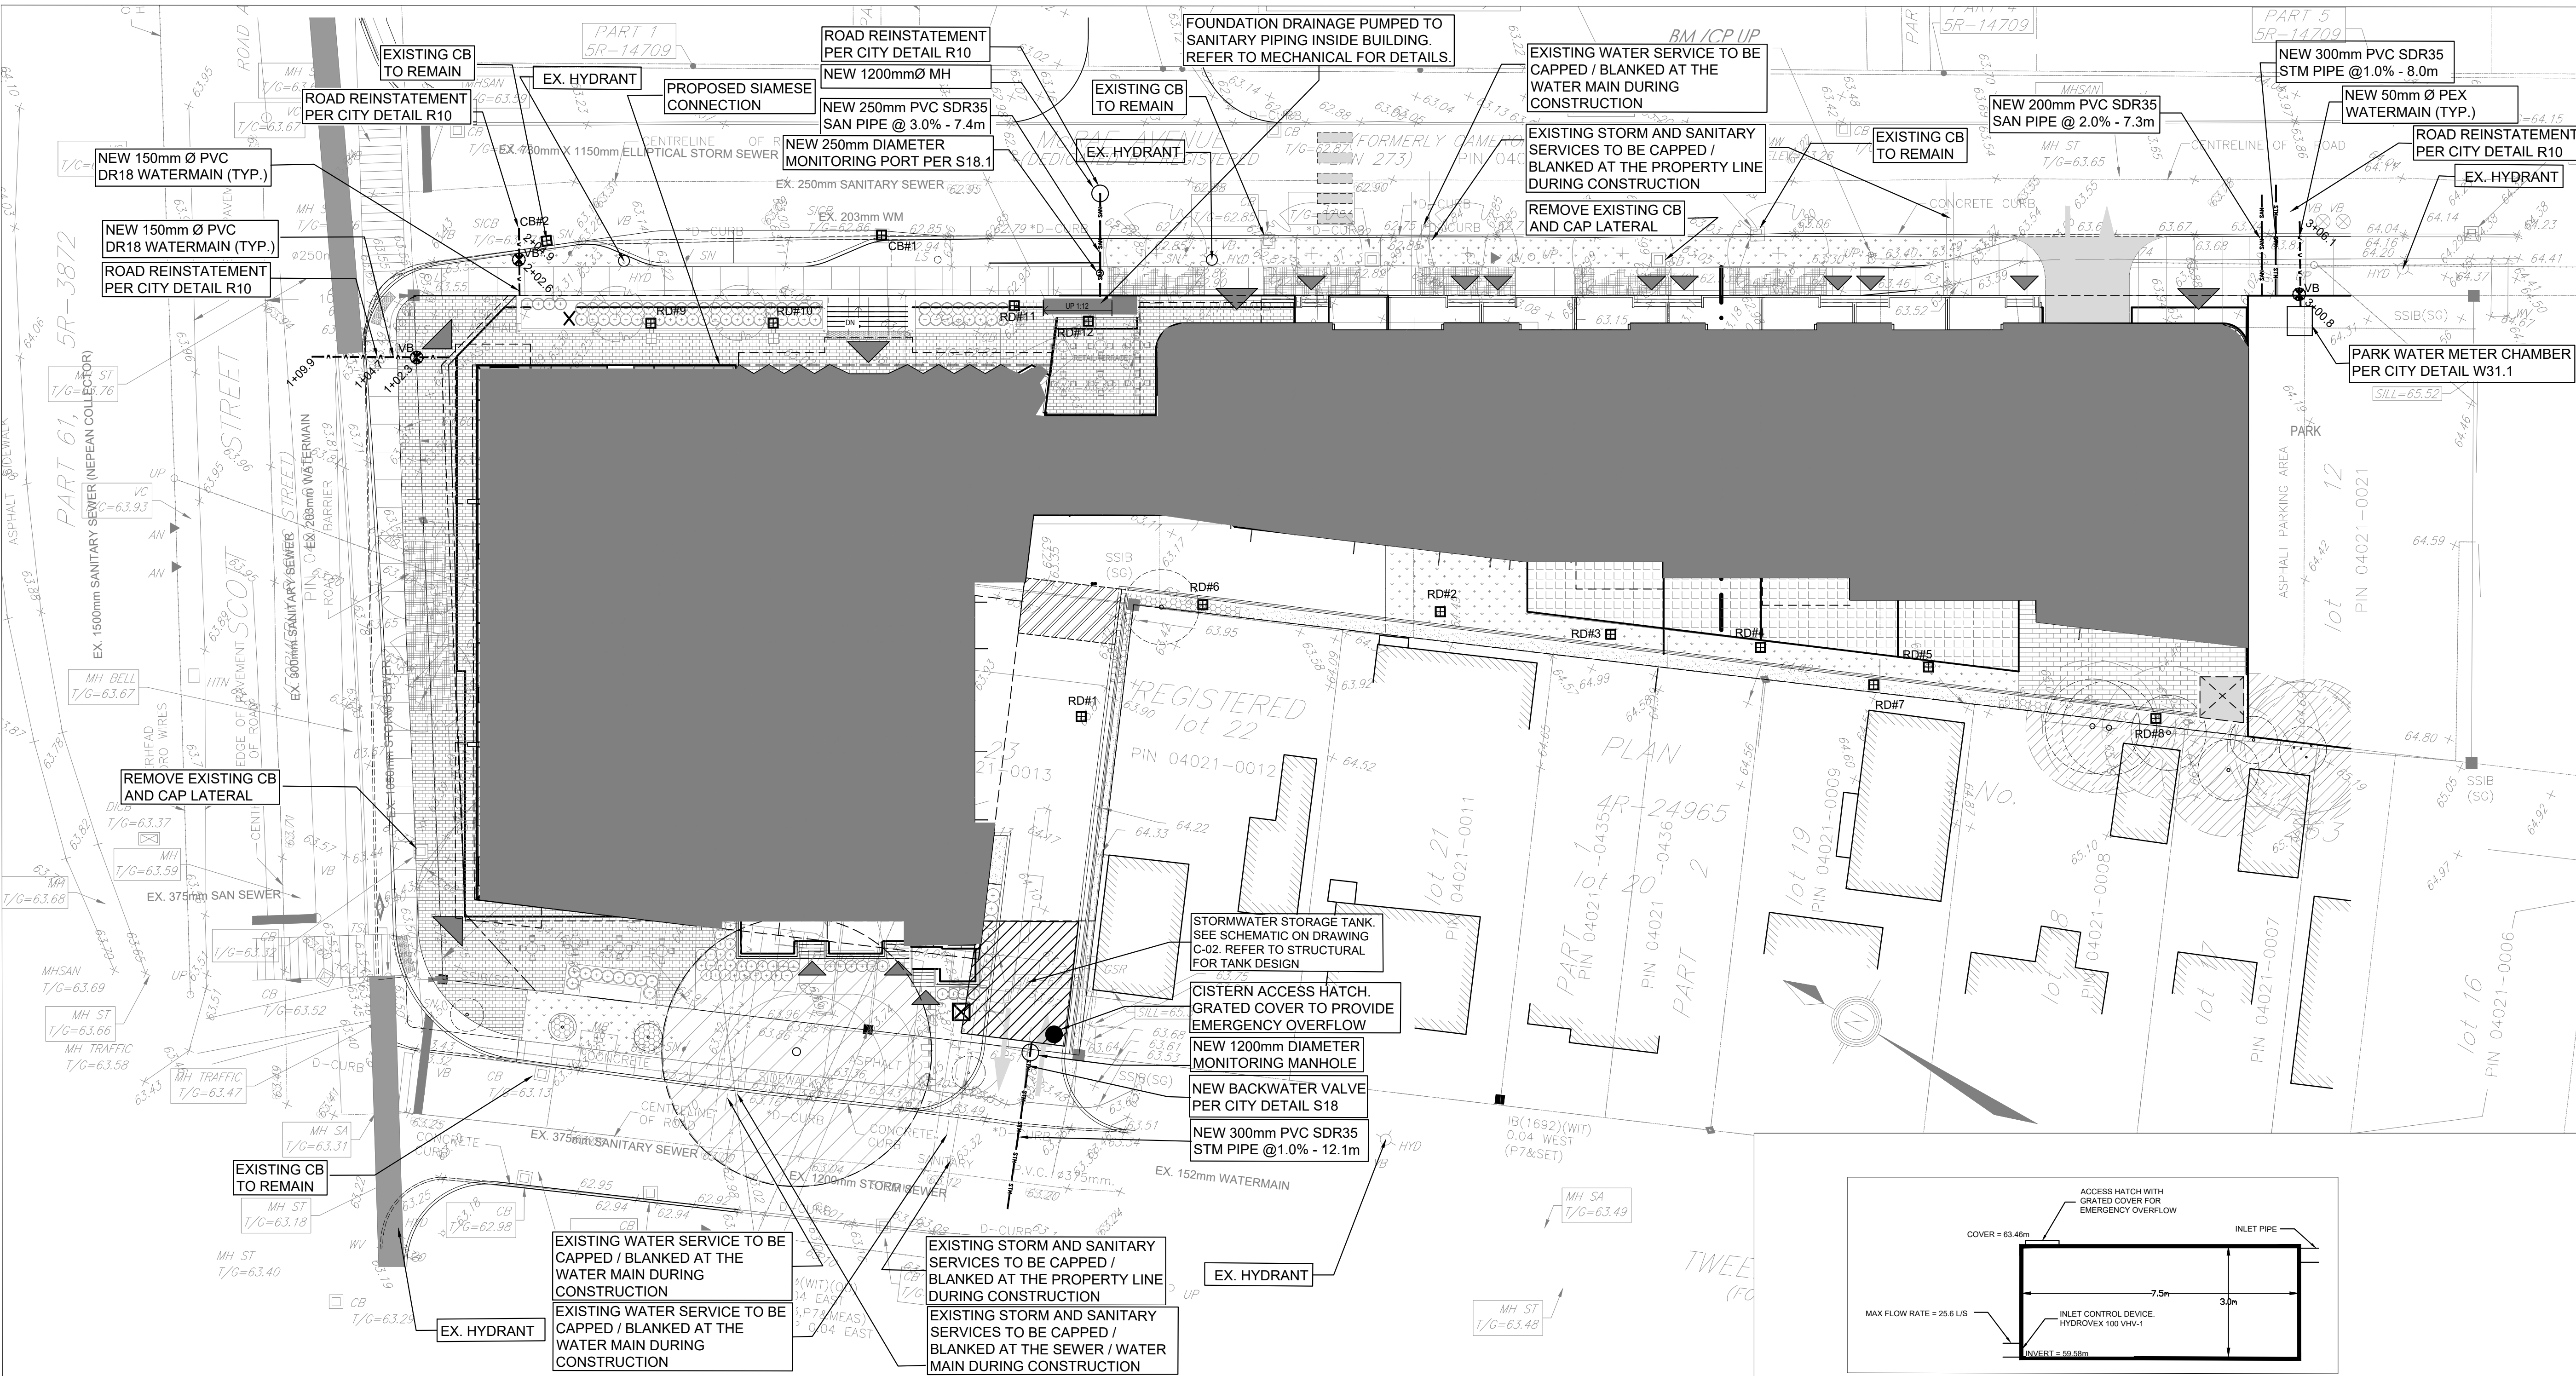

ARCHITECTURE DE PAYSAGE Landscape Architect
James B. Lennox & Associates Inc.
 3332 Carling Ave.
 Ottawa, Ontario K2H 5A8
 T 613 722 5168

CIVIL, CIVIL
R.V. Anderson Associates Limited
 1750 Courtwood Crescent, Suite 220
 Ottawa, ON K2C 2B5
 T 613 226-1544

ARPENTEUR Surveyor
Stantec Geomatics Ltd.
 400 - 1331 Clyde Avenue
 Ottawa, ON K2P 2S4
 T 613 722 4420

URBANISTE Urban Planner
Fotenn Planning + Design
 398 Cooper Street - Suite 300
 Ottawa, ON K2P 2H7
 T 613 750 5708

ARCHITECTES Architect
NEUF architect(e)s SENCRL
 690, boulevard René-Lévesque O. 3^{de} étages, Montréal QC H3B 1S6
 T 514 847 1117 NEUF architectes.com

SCÉAU / Seal

[Signature]
DOUGLAS JAMES, MCIP, RPP
 MANAGER, DEVELOPMENT REVIEW - CENTRAL
 PLANNING, INFRASTRUCTURE & ECONOMIC
 DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
 By Douglas James at 5:02 pm, Jun 24, 2021

arva

R.V. Anderson Associates Limited
 engineering • environment • infrastructure

CLIENT Client
GWL REALTY ADVISORS

OUR/AGE Project
320 MCRAE

EMPLACEMENT Location
320 MCRAE

NO PROJET No.
194453

NO	REVISION	DATE
1	QA SUBMISSION	02/24/2020
2	FOR COORDINATION	02/26/2020
3	SITE PLAN SUBMISSION	03/20/2020
4	SITE PLAN RESUBMISSION	09/23/2020
5	EXCAVATION PERMIT	09/25/2020
6	FOR COORDINATION	12/22/2020
7	BUILDING PERMIT	01/04/2021
8	SITE PLAN RESUBMISSION	04/30/2021
9	ISSUED FOR INFORMATION	05/10/2021
10	SITE PLAN RESUBMISSION	06/02/2021

DESSINE PAR Drawn by
NR

DATE
01/04/21

TITRE DU DESSIN Drawing Title

SITE SERVING PLAN

REVISION Revision
 NO. DESSIN Drawing Number
C01

VERIFIER PAR Checked by
TMK

ECHELLE Scale
1:250

NOT FOR CONSTRUCTION - SUBJECT TO CHANGE PENDING OUTSTANDING APPROVALS

007-12-20-0035
 #18143