


SLOPING OF TRENCH WALLS SHALL CONFORM TO REQUIREMENTS SPECIFIED IN THE OCCUPATIONAL HEALTH AND SAFFETY ACT. (4) x 5" (129mm) TYPE DB2 PVC DUCTS HYDRO OTTAWA APPROVED DUCT SPACERS. A MIN. CAP OF 25mm (1") BETWEEN DUCTS REQUIRED. - CONCRETE BASE SPACER (50mm MIN.) UNDISTURBED SOIL OR COMPACTED GRANULAR 'A' BASE 10M REINFOCING RODS POSITIONED AS SHOWN. NOTE: NUMBER OF RODS REQUIRED IS ONE MORE THAN NUMBER OF DUCTS IN THE WIDTH OF THE DUCTBANK. SLOPING OF TRENCH WALLS SHALL CONFORM TO REQUIREMENTS SPECIFIED IN THE OCCUPATIONAL HEALTH AND SAFFETY ACT. (3) x 4" (100mm) TYPE DB2 PVC DUCTS HYDRO OTTAWA APPROVED DUCT SPACERS. A MIN. CAP OF 25mm (1") BETWEEN DUCTS REQUIRED. - CONCRETE BASE SPACER (50mm MIN.) UNDISTURBED SOIL OR COMPACTED GRANULAR 'A' BASE 10M REINFOCING RODS POSITIONED AS SHOWN. <u>NOTE:</u> NUMBER OF RODS REQUIRED IS ONE MORE THAN NUMBER OF DUCTS IN THE WIDTH OF THE DUCTBANK.

HEDULE											
	LAMPS PER FIXTURE			VOLT	MOUNTING	REMARKS					
	TYPE	YPE WATTS COLOUR									
	LED	11	3000K	347	WALL	C/W ACCESSORIES					
	LED	35	3000K	374	POLE	C/W ACCESSORIES					
	LED	6	3000K	347	RECESSED	C/W ACCESSORIES					
	LED	22	3000K	347	RECESSED	C/W ACCESSORIES					
	LED	22	3000K	347	RECESSED	C/W ACCESSORIES					
	LED	70	3000K	347	POLE	C/W ACCESSORIES					
	LED	3	3000K	347	WALL	C/W ACCESSORIES					
	LED	163	3000K	347	POLE	C/W ACCESSORIES					
	LED	39	3000K	347	POLE	C/W ACCESSORIES					
	LED	40	3000K	347	POLE BEGA (98 508)	C/W ACCESSORIES					
	LED	37	3000K	347	POLE	C/W ACCESSORIES					
	LED	37	3000K	347							
					-						

GENERAL NOTES:

. COORDINATE BURIED SERVICES WITH ALL OTHER SERVICES (WATER, SEWER, GAS, HYDRO, TELEPHONE, CABLE, ETC.) REFER TO RELATED SITE SERVICES DRAWINGS. COORDINATE WITH UTILITY AND TELEPHONE/CATV SERVICES FOR LOCATION AND FINAL CONDUIT REQUIREMENTS. COORDINATE LOCATION OF LIGHTING FIXTURES WITH LANDSCAPE EXCAVATION, BACKFILL AND CONCRETE, REINFORCING ASSOCIATED WITH ELECTRICAL WORK TO BE BY GENERAL CONTRACTOR. USE PVC FOR UNDERGROUND ONLY. CHANGE TO EMT INSIDE BUILDING. PROVIDE PVC/EMT TRANSITION ADAPTORS AT EXTERIOR TO INTERIOR CONDUITS.

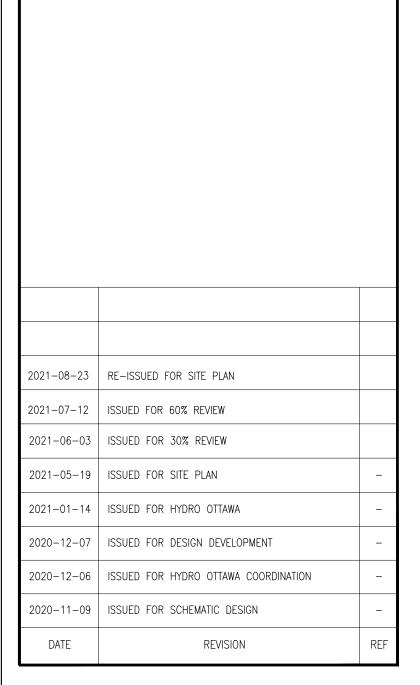

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHER FAILURE TO OBTAIN AND / OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED. THIS DRAWING IS THE PROPERTY OF GOODKEY WEEDMARK & ASSOCIATES LIMITED AND ALL COPYRIGHTS ARE RESERVED. NO USE OF THIS DRAWING MAY BE MADE WITHOUT EXPRESS WRITTEN CONSENT. DO NOT SCALE DRAWINGS

L'INGÉNIEUR DÉCLINE TOUTE RESPONSABILITÉ DÉCOULANT DE PROBLÈMES FAISANT SUITE AU NON RESPECT DES PLANS, DEVIS ET DE L'INTENTION DU CONCEPT QU'ILS INDIQUENT OU DE TOUS LES PROBLÈMES POUVANT RESULTER DU DÉFAUT D'OBTENIR ET / OU DE SUIVRE LES CONSEILS DE L'INGÉNIEUR EN CE QUI CONCERNE LES ERREURS, OMISSIONS, INCONSISTANCES, AMBIGUITÉS OU CONFLITS CE DESSIN EST LA PROPRIÉTÉ LITTÉRAIRE DE GOODKEY WEEDMARK & ASSOCIATES LIMITED ET TOUS LES DROITS SONT RÉSERVÉS. L'UTILISATION EST INTERDITE SANS LE CONSENTEMENT ÉCRIT DE L'AUTEUR. NE PAS MESURER LES DESSINS A L'ÉCHELLE





Aby Romon ; H. ROMANI 100508102 23 August, 202

Project/Projet OTTAWA COMMUNITY HOUSING MIKINAK REDEVELOPMENT 715 MIKINAK ROAD

Drawing title/Titre du dessin	LAYOUT
SITE PLAN	

Scale	AS NO	TED	Project no./No.	1 3	
Échelle			2020-297	7	
Design by	H.ROM	IANI	Drawing/Dessin		
Conçu par					
Drawn by	L	.ALI			
Dessiné par			EA0002		
Reviewed by	H.ROM	IANI			
Examiné par				OF	Ľ
Date	AUGUST 202	1	Revision no:	Acad file/Fichier:	
Date			_	_	