

JOINT FILLING MATERIAL

PERMEABLE PAVERS

BEDDING

PAVER

RESTRAINT

SUB-BASE

SUB-GRADE

GEOTEXTILE

MATERIAL


PERMEABL

JOINT FILLING MATERIAL: 2.5-10mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER BEDDING COURSE: 2.5-10mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER BASE COURSE: 5-28mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER SUB-BASE COURSE: 40-80mm AGGREGATE OR AS RECOMMENDED BY MANUFACTURER COMPACT EACH LAYER AS RECOMMENDED BY MANUFACTURER

PERMEABLE PAVERS BY UNILOCK LIMITED OR APPROVED EQUAL
PAVERS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS
WITH TIGHT BUTT JOINTS OF APPROXIMATELY 3mm, ON A SAND BASE. SAW CUT PAVERS AS REQUIRED.
USE AN APPROVED VIBRATORY COMPACTOR IN A CIRCULAR PATTERN.
ALL DAMAGED OR CHIPPED PAVERS MUST BE REPLACED AT THE CONTRACTOR'S COST

EXCAVATE AND REMOVE ALL TOPSOIL AND UNSTABLE MATERIALS OFF SITE. SUBGRADE TO BE GRADED TO SIMILAR CONTOURS AS FINISH GRADE. COMPACT SUBGRADE TO 95% S.P.D.

PERMEABLE PAVERS N.T.S

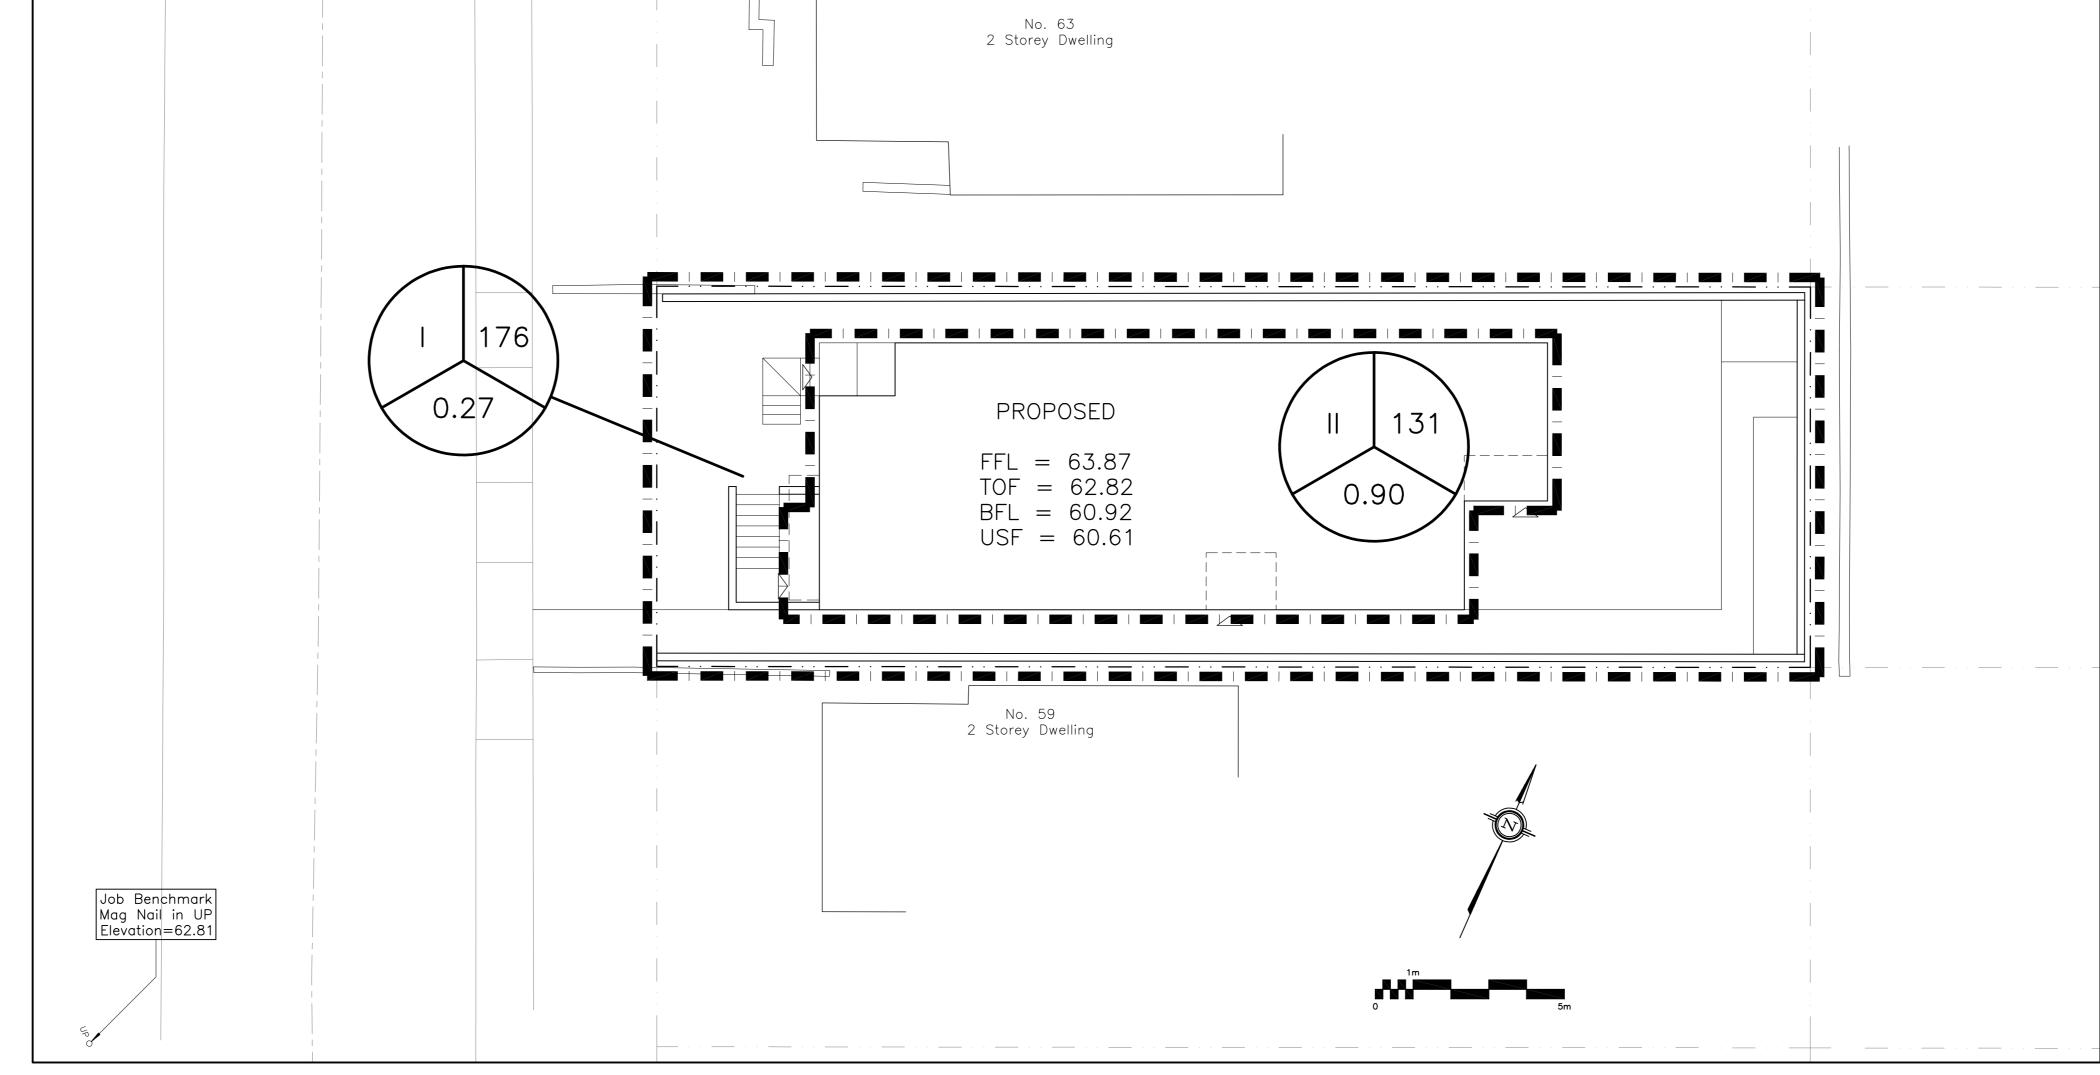

OWNER:
ALI KARIMI-SHIRAZIA &
SEYED FARAZ TABATABAE
1012, 120 HARRISON GARDEN BLVD,
NORTH YORK, ON M2N0H1
647-549-9940

REFER TO NOTES & DETAILS ON DRAWING C-3

5 YEAR RUNOFF COEFFICIENT


AREA

(sq.m)

<u>LEGEND</u>

DRAINAGE

KEY PLAN

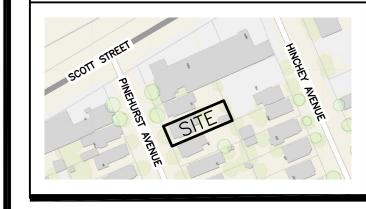

3	JAN 24-22	ISSUED FOR APPROVAL
2	AUG 20-21	ISSUED FOR APPROVAL
1	JUL 5-21	ISSUED FOR COORDINATION
No.	DATE	REVISION

D. B. GRAY ENGINEERING INC

Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain

700 Long Point Circle 613-425-8044
Ottawa, Ontario d.gray@dbgrayengineering.com

PROPOSED 3-STOREY

(4-LELVEL) 8-UNIT


APARTMENT BUILDING

61 PINEHURST AVENUE

OTTAWA, ONTARIO

Drawing Tit

DRAINAGE PLAN & DETAILS



Drawn D.B.G
H. Scale 1:100
V. Scale
Date JUN 15-21
Job No. 21047

Drawing No.
C-4
of 4

#18586