

2705460 ONTARIO INC.

1131-1151 Teron Road

Stormwater Management Report

February 22, 2022





1131-1151 Teron Road Stormwater Management Report

2705460 ONTARIO INC.

Confidential
Issue for City Review
Project No.: 20M-01534-00
Date: February 22, 2022

WSP
Suite 300
2611 Queensview Drive
Ottawa, ON, Canada K2B 8K2

T: +1 613 829-2800
F: +1 613 829-8299
wsp.com

Revision History

FIRST ISSUE

April 16, 2021	First Submission			
Prepared by	Reviewed by	Approved By		
Kathryn Kerker Water Resources E.I.T.	Michelle Hughes, P.Eng., MSc. Manager, Water Resources	Michelle Hughes, P.Eng., MSc. Manager, Water Resources		
REVISION 1				
October 14, 2021	Second Submission			
Prepared by	Reviewed by	Approved By		
Kathryn Kerker Water Resources E.I.T.	Michelle Hughes, P.Eng., MSc. Manager, Water Resources	Michelle Hughes, P.Eng., MSc. Manager, Water Resources		
REVISION 2				
February 22, 2022	Third Submission			
Prepared by	Reviewed by	Approved By		
Kathryn Kerker Water Resources E.I.T.	Jingwei Zhang, P.Eng., M.Eng. Senior Project Engineer	Jingwei Zhang, P.Eng., M.Eng. Senior Project Engineer		

Signatures

Prepared by




Kathryn Kerker
Water Resources E.I.T.

February 22, 2022

Date



APPROVED BY



Jingwei Zhang, P.Eng. M.Eng.
Senior Project Engineer

February 22, 2022

Date

WSP Canada Inc. prepared this report solely for the use of the intended recipient, 2705460 ONTARIO INC., in accordance with the professional services agreement. The intended recipient is solely responsible for the disclosure of any information contained in this report. The content and opinions contained in the present report are based on the observations and/or information available to WSP Canada Inc. at the time of preparation. If a third party makes use of, relies on, or makes decisions in accordance with this report, said third party is solely responsible for such use, reliance or decisions. WSP Canada Inc. does not accept responsibility for damages, if any, suffered by any third party as a result of decisions made or actions taken by said third party based on this report. This limitations statement is considered an integral part of this report.

The original of this digital file will be conserved by WSP Canada Inc. for a period of not less than 10 years. As the digital file transmitted to the intended recipient is no longer under the control of WSP Canada Inc., its integrity cannot be assured. As such, WSP Canada Inc. does not guarantee any modifications made to this digital file subsequent to its transmission to the intended recipient.

TABLE OF CONTENTS

1	INTRODUCTION.....	1
1.1	Scope	1
1.2	Site Location.....	1
1.3	Stormwater Management Plan Objectives	1
1.4	Design Criteria.....	2
2	PRE-DEVELOPMENT CONDITIONS	3
2.1	General	3
2.2	Rainfall Information.....	3
2.3	Allowable Flow Rates	3
3	POST-DEVELOPMENT CONDITIONS.....	5
3.1	General	5
3.2	Water Quantity	5
3.3	Water Quality.....	7
4	CONCLUSIONS.....	9

Tables

Table 2-1: Pre-Development Peak Flow Rate Calculations ($T_c=10$ min)	4
Table 3-1: Drainage Area Summary	5
Table 3-2: Summary of Modelling Results	6

Figures

Figure 1: Site Location	1
Figure 2: Bioswale cross-section	8

Appendices

- A** Pre-consultation meeting minutes (January 14, 2021) and email communication
- B** Pre-Development Stormwater Management Calculations
- C** HydroCAD Model Output
 - C-1 2-Year Analysis (Peak Discharge, $T_c = 10$ min)
 - C-2 100-Year Analysis (Peak Discharge, $T_c = 16$ min)
 - C-3 100-Year Analysis (Peak Storage Bioswale 1, $T_c = 72$ min)
 - C-4 100-Year Analysis (Peak Storage Bioswale 2, $T_c = 48$ min)
 - C-5 100-Year Analysis (Peak Storage Bioswale 3, $T_c = 36$ min)
 - C-6 100-Year Analysis (Peak Building 1 Rooftop Storage, $T_c = 36$ Min)
 - C-7 100-Year Analysis (Peak Building 2 Rooftop Storage, $T_c = 29$ Min)
- D** OGS Sizing
- E** Storage Calculations
- F** Product Specifications

1 INTRODUCTION

1.1 Scope

WSP Canada Inc. was retained by 2705460 Ontario inc. to conduct a stormwater management study in support of proposals to develop nine-storey and three-storey residential buildings with a connecting underground parking garage.

1.2 Site Location

The site is located at 1131-1151 Teron Road, Ottawa, Ontario. The location of the proposed development is illustrated in **Figure 1**.



Figure 1: Site Location

1.3 Stormwater Management Plan Objectives

The objectives of the stormwater management (SWM) study are as follows:

- Collect and review background information.
 - Confirm applicable SWM design criteria with City of Ottawa staff.
 - Evaluate various SWM practices that meet the stormwater management requirements and recommend a preferred strategy—specifically related to the applicable quantity and quality control criteria.
-

1.4 Design Criteria

Design criteria were confirmed through pre-consultation with the City of Ottawa held on January 14, 2021 (Meeting minutes included in **Appendix A**). Criteria amended through email correspondence on January 25, 2022. Revised criteria for 1131-1151 Teron Road are as follows:

Water Quantity Control and Discharge Criteria

- Stormwater directed to March Road ditch must be controlled to pre-development conditions up to the 100-year event.
- The entire site can be assumed to drain to March Road ditch under pre-development conditions to establish target release rates.
- No stormwater may be directed to the Teron Road storm sewer.
- Allowable Runoff coefficient (C): C = the lesser of the existing pre-development conditions to a maximum of 0.5
- Time of concentration (Tc): Tc = pre-development (Calculated); maximum Tc = 10 min

Water Quality Criteria

- MVCA requires enhanced water quality protection (80% TSS removal) be provided on-site

2 PRE-DEVELOPMENT CONDITIONS

2.1 General

Currently the land proposed for the new development is a greenfield site (1151 Teron Road) and contains a single-family home (1131 Teron Road). The site is primarily covered in grasses and small trees/bushes. The total site area is 1.48 ha. A large part of the site along March Road remains untouched in proposed conditions and has been excluded from the analysis, making the total study area 0.88 ha.

2.2 Rainfall Information

The rainfall intensity is calculated in accordance with Section 5.4.2 of the Ottawa Sewer Design Guidelines (October 2012):

$$i = \left[\frac{A}{(T_d + C)^B} \right]$$

Where;

- A, B, C = regression constants for each return period (defined in section 5.4.2)
 - i = rainfall intensity (mm/hour)
 - T_d = storm duration (minutes)
 - The IDF parameters/regression constants are included in **Appendix B**.
-

2.3 Allowable Flow Rates

As noted in **Section 1.4**, post-development drainage to the March Road ditch (0.88 ha), must not exceed the pre-development runoff up to the 100-year event, calculated using a runoff coefficient being the lesser of 0.50 or existing conditions. In this instance existing conditions are represented by a runoff coefficient of 0.23, therefore this value has been used to calculate the allowable release rate. The entire site is assumed to drain to the March Road ditch under pre-development conditions, as directed by the City.

The calculated peak flow rates for the site in the pre-development condition are summarized below in Table 2-1.

Table 2-1: Pre-Development Peak Flow Rate Calculations ($T_c=10$ min)

Return Period	Rainfall Intensity	March Rd Ditch Peak Flow Rate (L/s)	Target Release Rate (L/s)	
years	mm/hour	$C = 0.23, T_c = 10\text{min}$		
2	76.8	43	43	
5	104.2	58	58	
10	122.1	68	68	
25	144.7	89	89	
50	161.5	109	109	
100	178.6	125	125	

3 POST-DEVELOPMENT CONDITIONS

3.1 General

The site will be developed with a nine-storey residential building with a rear surface parking lot, as well as a three-storey residential building connected by an underground parking garage. Bioswales will be used to control the flow from the parking lot, and roof storage will be used to control the flow from the building.

Note that this report should be read in conjunction with the proposed site servicing drawing package—specifically drawings C02 (Grading Plan), C03 (Servicing Plan), and C04 (Drainage Area Plan).

3.2 Water Quantity

As noted in **Section 2.3**, the target allowable discharge rate discharging to the March Road ditch during the 100-year event is 125 L/s. This is equivalent to the peak runoff rate under pre-development conditions during a 100-year design storm event with a runoff coefficient of 0.23. Compliance with the 100-yr target offsite discharge rate will be achieved through use of bioswales in the central parking lot island, with inlet control prior to discharge into the proposed sewer to the March Road ditch, and roof storage on both buildings. Storage calculations are included in Appendix E.

It is noted that a portion of the developed area (gravel walkway within U-1, B-101, B-102) will not drain to the proposed bioswales or be controlled by roof storage. Post-development runoff calculations have accounted for uncontrolled runoff from these areas, and the following results report on the cumulative release rates from the study area (controlled plus uncontrolled). The pervious area along March Road remains untouched in proposed conditions, so is not included in the analysis. There are no external areas draining to the site.

Table 3-1: Drainage Area Summary

Area ID	Area (ha)	C	Storage	Treatment
A-101	0.19	0.75	Bioswale 1	Bioswale
A-102	0.12	0.78	Bioswale 2	Bioswale
A-103	0.18	0.74	Bioswale 3	Bioswale
B-BLDG1	0.15	0.90	BLDG1 Roof	OGS
B-BLDG2	0.05	0.90	BLDG2 Roof	OGS
B-101	0.16	0.65	Uncontrolled	OGS
B-102	0.01	0.90	Uncontrolled	OGS
Gravel Path	0.01	0.70	Uncontrolled	None

A HydroCAD model of the project was created and includes:

- Three bioswales (total storage volume 91 m³, 50 m³, 60 m³), with outlet controlled using HYDROVEX vortex valves to detain 0.49 ha of the new development (C = 0.75, 0.78, 0.74 +25% for 100-year as per OSDG 5.4.5)
- Rooftop flow control drains (WATTS Adjustable Accutrol Weir; See drawing C04A for details) to utilize roof storage on both buildings, to control 0.20 ha of new development. Roof drains on BLDG-1 ½ open, roof drains on BLDG-2 ¼ open.
- Uncontrolled runoff from gravel path area (0.01 ha, C = 0.70), B-101 (0.16 ha, C = 0.65), and B-102 (0.013 ha, C = 0.90), with C +25% for 100-year as per OSDG 5.4.5.

HydroCAD has been used for the modelling exercise, and the model has informed the maximum storage volume used in each bioswale and on each roof based on the proposed flow. The peak flow rate generated from the uncontrolled drainage area within the project site and controlled flow from the bioswales and roofs is 108 L/s which meets the allowable 100-year release rate of 125 L/s. Modelling results are summarized below in **Table 3-2** and shown in **Appendix D**.

Note that results provided below describe performance of the proposed system at several different storm durations, which have been solved iteratively within HydroCAD to represent critical conditions (i.e. maximum storage utilized within storage features, and peak release rate at the system discharge point). Peak flow rates at control points and peak uncontrolled flow have been reported, however these do not occur at the same time so do not sum to the overall peak flow leaving the system. The results demonstrate that the target allowable 100-year release rate is satisfied at all durations. The proposed system was also verified to meet target peak flow rates for all events from the 2-year through 100-year event.

Table 3-2: Summary of Modelling Results

Return Period (Years)	T _d (min)	Storage ID	Required Storage (m ³)	Available Storage (m ³)	Ponding Level / Depth ^a (m)	Peak Flow Rate at control (L/s)	Peak Uncontrolled Flow Rate (m ³ /s)	Peak Flow to Ditch (L/s)	Allowable Flow Rate (L/s)
2-Year Peak Discharge	10	B1	18	91	89.324	0	26	38	43
		B2	12.2	50	89.286	0			
		B3	16.7	60	89.254	0			
		Bldg1	9.9	47.1	0.089	9			
		Bldg2	2.5	20.4	0.085	4			
		<i>Sum</i>	59.3	268.5					
100-Year Peak Discharge	16	B1	59.6	91	89.772	9	59	108	125
		B2	37.9	50	89.808	10			
		B3	50.2	60	89.847	18			
		Bldg1	40.9	47.1	0.143	12			
		Bldg2	13.2	20.4	0.134	5			
		<i>Sum</i>	201.8	268.5					
100-Year Peak Storage Bioswale 1	72	B1	79.3	91	89.915	9	21	75	
		B2	43.9	50	89.902	10			
		B3	50.3	60	89.85	18			
		Bldg1	41.2	47.1	0.143	12			
		Bldg2	10.3	20.4	0.125	5			
		<i>Sum</i>	225	268.5					
100-Year Peak Storage Bioswale 2	48	B1	77.4	91	89.901	9	28	83	
		B2	45.7	50	89.931	10			
		B3	56	60	89.938	18			
		Bldg1	45.9	47.1	0.149	12			
		Bldg2	13.3	20.4	0.134	5			
		<i>Sum</i>	238.3	268.5					
100-Year Peak Storage Bioswale 3	36	B1	74.2	91	89.878	9	35	89	
		B2	45.1	50	89.922	10			
		B3	57	60	89.953	19			
		Bldg1	46.7	47.1	0.15	12			
		Bldg2	14.2	20.4	0.136	5			
		<i>Sum</i>	237.2	268.5					
100-Year Peak Storage Bldg1 Roof	36	B1	74.2	91	89.878	9	35	89	
		B2	45.1	50	89.922	10			
		B3	57	60	89.953	19			
		Bldg1	46.7	47.1	0.15	12			
		Bldg2	14.2	20.4	0.136	5			
		<i>Sum</i>	237.2	268.5					
100-Year Peak Storage Bldg2 Roof	29	B1	70.9	91	89.854	9	41	94	
		B2	43.8	50	89.902	10			
		B3	56.3	60	89.943	19			
		Bldg1	46.2	47.1	0.149	12			
		Bldg2	14.4	20.4	0.137	5			
		<i>Sum</i>	231.6	268.5					

*'Total Flow Leaving Site' includes all developed area draining to the March road ditch from the study area. ^aDepth indicated for roof ponding on Bldg1 and Bldg2.

3.3 Water Quality

As noted in section 1.4, quality control is required to provide enhanced water quality treatment of the site (80% TSS removal).

For the parking lot area, quality treatment is provided within the bioswale. The bioswale outlet catch basins are offset by 100 mm to promote flow through the bioswale media and enhance water quality. Due to high groundwater and low permeability soils, the bioswales are not designed to promote infiltration (see Geotechnical Investigation Report, April 1, 2020). However, as indicated in the City of Ottawa Low Impact Development Technical Guidance Report (February 2021), treatment can still be provided through evapotranspiration, LID filtration, and sedimentation. A subdrain wrapped in geotextile drains the bioswale once water has filtered through the media. The design guidance for filters has been used from section 4.6.7 of the MOE SWM Planning and Design Manual. The following equation calculates the required filter surface area. The surface area provided is 149 m², which meets the requirement.

$$A = \frac{1000Vd}{k(h + d)t} = \frac{1000(19m^3)(0.15m)}{0.45mm/hr(0.88m + 0.15m)48hr} = 128\text{ m}^2$$

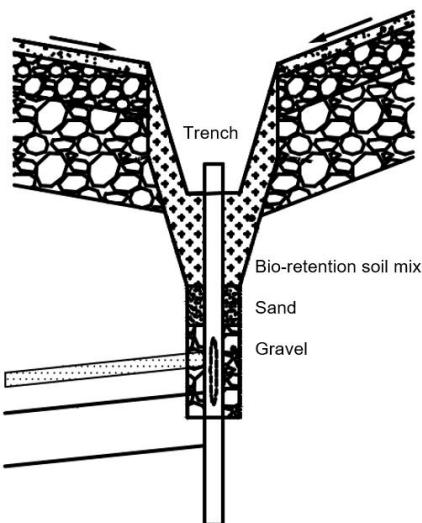


Figure 2: Bioswale cross-section

An OGS is also used to provide treatment downstream of the bioswales. This OGS treats the roof, B-101, and B-102, and well as water from the bioswales, to ensure an adequate level of quality treatment is reached prior to discharge into the March Road ditch. OGS sizing is provided in **Appendix D**.

4 CONCLUSIONS

A stormwater management plan has been prepared to support the site plan application for the 1131 – 1151 Teron Road development in the City of Ottawa. The key points are summarized below.

WATER QUANTITY

Runoff from the parking lot catchments will be directed to bioswales in the median of the parking area and will provide a storage volume of 200 m³. Roof runoff will be detained using rooftop flow control drains before joining runoff from areas B-101 and B-102. The peak 100-year discharge from the site is 108 L/s, which meets the allowable release rate of 125 L/s.

WATER QUALITY

Water treatment is provided by bioswales in the parking lot median, and by an OGS which treats roof and runoff from areas B-101 and B-102.

This report demonstrates that the proposed SWM strategy will address stormwater management related impacts from this project and meet the requirements of the City of Ottawa.

APPENDIX

A

Pre-consultation meeting minutes
(January 14, 2021) and email
communication

Kerker, Kathryn

From: Worth, Ben
Sent: January 14, 2021 4:28 PM
To: Kerker, Kathryn
Subject: FW: 1131 - 1151 Teron Road SPC Discussion

FYI

Ben Worth, P.Eng. C.Eng. MICE
Manager, Water Resources
T+ 1 613-690-3928
M+ 1 613-986-8997



From: Armstrong, Justin [mailto:justin.armstrong@ottawa.ca]
Sent: January 14, 2021 3:59 PM
To: Yang, Winston <Winston.Yang@wsp.com>; Worth, Ben <Ben.Worth@wsp.com>
Subject: 1131 - 1151 Teron Road SPC Discussion

Hi Winston and Ben,

See the following bullet-point summary of our discussion from earlier today.

- SWM quantity criteria to reflect previous requirements:
 - Areas discharging to March Road ditch - post-development flows up to the 100-yr controlled to corresponding pre-development flows.
 - Areas discharging to Teron Road storm sewer - post-development flows up to the 100-yr controlled to the pre-development 5-yr with a C-value of existing or 0.5, whichever is less, and a calculated time of concentration no less than 10 min).
- SWM quality criteria to be confirmed by the MVCA, however 80% TSS removal was previously required and should be assumed for the site unless MVCA indicates otherwise. MVCA to confirm if treatment is required for rooftop portion of site discharging to the Teron Road storm sewer. Matt Craig mraig@mvc.on.ca was included as an MVCA contact in previous comments letter.
- There is no sanitary sewer fronting the site in Teron Road or March Road. A connection to the private sanitary sewer within Weeping Willow Lane was previously proposed. A letter of agreement must be provided from the owner of the private sanitary sewer to allow for the connection / easement / works on private property. An easement & or a Joint Use & Maintenance Agreement with the owner of the sewer will be needed. An assessment of available capacity will also need to be performed.
- Water service connections to the 610mm feedermain within Teron Road are not permitted. As such, a local watermain extension must be made from Steacie Drive and extended along Teron Road to the development site in order to service the development. A **second** connection to the existing hydrant lateral (fed by the 610mm feedermain) would be accepted, assuming a **first** connection to the local watermain off Steacie Drive is provided. If the 610mm feedermain is taken offline, there must be another watermain feed to service the development.

Feel free to contact me should you have any more questions.

Justin

During this period of uncertainty surrounding COVID-19, we are following best practices recommended to minimize the risk of exposure, while ensuring that service to our clients remains as uninterrupted as possible. I am working from home and will respond to emails at my earliest opportunity. Should there be delays due to internet connectivity, I thank your understanding and patience.

Justin Armstrong, E.I.T.

Project Manager

Planning, Infrastructure and Economic Development Department - Services de la planification, de l'infrastructure et du développement économique

Development Review - West Branch

City of Ottawa | Ville d'Ottawa

110 Laurier Avenue West Ottawa, ON | 110, avenue Laurier Ouest. Ottawa (Ontario) K1P 1J1

613.580.2400 ext./poste 21746, justin.armstrong@ottawa.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

Kerker, Kathryn

From: Armstrong, Justin <justin.armstrong@ottawa.ca>
Sent: January 25, 2022 1:43 PM
To: Yang, Winston
Cc: Kerker, Kathryn
Subject: RE: Re: Teron Road SWM comments

Hi Winston,

Just spoke with our Senior SWM Engineer and can confirm that approach is acceptable.

Regards,

Justin

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: January 25, 2022 1:36 PM
To: Armstrong, Justin <justin.armstrong@ottawa.ca>
Cc: Kerker, Kathryn <kathryn.kerker@wsp.com>
Subject: RE: Re: Teron Road SWM comments

Hi Justin,

We would like to confirm if we are allowed to assume the entire site drains to the March Road ditch under existing conditions to revise our target release rate criteria?

Yours truly,



Ding Bang (Winston) Yang, P.Eng.

Project Engineer
Municipal Engineering - Ottawa

T+ 1 613-690-0538
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: Armstrong, Justin <justin.armstrong@ottawa.ca>
Sent: January 25, 2022 11:31 AM
To: Yang, Winston <Winston.Yang@wsp.com>

Cc: Kerker, Kathryn <Kathryn.Kerker@wsp.com>

Subject: Re: Re: Teron Road SWM comments

Hi Winston,

The City's Water Resource SWM group has now had a chance to look at this situation in more detail with the topographic information you had provided. Unfortunately, regardless of existing topography for this site, the 300mm sewer in Teron Road is at capacity during the 5-year storm event and cannot receive the flows proposed from this development. It was only designed to receive roadway drainage. The SWM group's Senior Engineer has confirmed this and has indicated that all post-development flows from this development should be sent to the March Road ditch.

Regards,

Justin

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: January 24, 2022 4:51 PM
To: Armstrong, Justin <justin.armstrong@ottawa.ca>
Cc: Kerker, Kathryn <kathryn.kerker@wsp.com>
Subject: RE: Re: Teron Road SWM comments

Hi Justin,

Any updates from the city SWM and Water group for SWM design criteria and Water mode since we have discussed back in Jan 11, 2022.

Client is looking to resubmit the SPA as soon as possible.

Yours truly,



Ding Bang (Winston) Yang, P.Eng.

Project Engineer
Municipal Engineering - Ottawa

T+ 1 613-690-0538

M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: Armstrong, Justin <justin.armstrong@ottawa.ca>
Sent: January 11, 2022 3:12 PM
To: Kerker, Kathryn <Kathryn.Kerker@wsp.com>; Yang, Winston <Winston.Yang@wsp.com>
Subject: RE: Re: Teron Road SWM comments

Hi Winston and Kathryn,

I had taken over this file from a previous City PM and was not involved in the review of the initial DSEL submission. The correspondence Winston has provided in his previous e-mail was the result of a meeting held prior to a WSP submission for this site, and therefore prior to my review of any detailed submission. In that e-mail I confirmed that the previous direction provided could still be considered valid (i.e., that pre-development drainage outlets could be maintained post-development). The drainage area split between the two outlets still needed proper justification at the time of actual site plan submission.

As noted in Comment B7 in our last comment response letter, the City's Water Resources Group has indicated that, following review of their Streambuilder model for the site area, the 300mm storm sewer in Teron Road does not receive any runoff from the site under current conditions. They also indicated that the 300mm Teron Road storm sewer was only designed to receive roadway runoff and is already at capacity and unable to receive any additional flows.

Based on the Water Resource Group's analysis of existing drainage boundaries, they have confirmed that the SWM approach for the entire site should be post-pre to the March Road ditch, however, as mentioned to Winston during our conversation earlier today, I will circulate them the topographic justification he provided in his previous e-mail for their review. I will follow up with you both once I receive a response.

Regards,

Justin

During this period of uncertainty surrounding COVID-19, we are following best practices recommended to minimize the risk of exposure, while ensuring that service to our clients remains as uninterrupted as possible. For the most part I am working from home and will respond to emails at my earliest opportunity. Should there be delays due to internet connectivity, I thank your understanding and patience.

Justin Armstrong, E.I.T.
Project Manager
Planning, Real Estate and Economic Development Department – Direction générale de la planification, des biens immobiliers et du développement économique
Development Review - West Branch
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 21746, justin.armstrong@ottawa.ca

From: Kerker, Kathryn <Kathryn.Kerker@wsp.com>
Sent: January 11, 2022 2:08 PM
To: Yang, Winston <winston.yang@wsp.com>; Armstrong, Justin <justin.armstrong@ottawa.ca>
Subject: RE: Re: Teron Road SWM comments

Hi Justin,

In addition to what Winston sent in the previous email, the attached report by David Schaeffer Engineering includes consultation with the city on the site discharge to the Teron Road sewer.

Regards,

Kathryn Kerker, M.A.Sc
Designer, Water Resources
T+ 1 613-690-1206



From: Yang, Winston <Winston.Yang@wsp.com>
Sent: January 11, 2022 1:54 PM
To: Armstrong, Justin <justin.armstrong@ottawa.ca>
Cc: Kerker, Kathryn <Kathryn.Kerker@wsp.com>
Subject: Re: Teron Road SWM comments

Hi Justin,

At the beginning of this project, we have already agreed for the SWM drainage areas split as per the existing survey topographic information.

Please see attached pre-consultation meeting minutes and the survey plan for your reference and coordination.

Yours truly,



Ding Bang (Winston) Yang, P.Eng.

Project Engineer
Municipal Engineering - Ottawa

T+ 1 613-690-0538
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

NOTICE: This communication and any attachments ("this message") may contain information which is privileged, confidential, proprietary or otherwise subject to restricted disclosure under applicable law. This message is for the sole use of the intended recipient(s). Any unauthorized use, disclosure, viewing, copying, alteration, dissemination or distribution of, or reliance on, this message is strictly prohibited. If you have received this message in error, or you are not an authorized or intended recipient, please notify the sender immediately by replying to this message, delete this message and all copies from your e-mail system and destroy any printed copies. You are receiving this communication because you are listed as a current WSP contact. Should you have any questions regarding WSP's electronic communications policy, please consult our Anti-Spam Commitment at www.wsp.com/casl. For any concern or if you believe you should not be receiving this message, please forward this message to caslcompliance@wsp.com so that we can promptly address your request. Note that not all messages sent

APPENDIX

B

**Pre-Development Stormwater
Management Calculations**



Project:	1151 Teron Road	No.:	20M-01534-00
By:	KK	Date:	2022-02-02
Checked:	MH	Checked:	2022-02-02

Subject: **SWM CALCULATIONS- Pre-Development Peak Flow March Rd Ditch**

Calculation of existing runoff rate is undertaken using the Rational Method:

$$Q = 2.78CiA$$

Where: Q = peak flow rate (litres/second)

C = runoff coefficient

i = rainfall intensity (mm/hour)

A = catchment area (hectares)

Site Area, A m²

Site Area, A hectares

Runoff Coefficient, C 0.23

Rainfall intensity calculated in accordance with City of Ottawa Sewer Design Guidelines (section 5.4.2):

$$i = \left[\frac{A}{(Td + C)^B} \right]$$

Where: A, B, C = regression constants for each return period (defined in section 5.4.2)

i = rainfall intensity (mm/hour)

Td = storm duration (minutes) 10 minutes

Return Period (Years)	2	5	10	25	50	100*
A	733.0	998.1	1,174.2	1,402.9	1,569.6	1,735.7
B	0.810	0.814	0.816	0.819	0.820	0.820
C	6.199	6.053	6.014	6.018	6.014	6.014
T (mins)	10	10	10	10	10	10
I (mm/hr)	76.8	104.2	122.1	144.7	161.5	178.6
Runoff Coefficient C	0.23	0.23	0.23	0.23	0.23	0.23
C Multiplier (OSDG Table 5.7)	1.00	1.00	1.00	1.10	1.20	1.25
Revised Runoff Coefficient C	0.23	0.23	0.23	0.25	0.28	0.29
Q (litres/sec)	43	58	68	89	109	125
Q (m³/sec)	0.04	0.06	0.07	0.09	0.11	0.13

APPENDIX

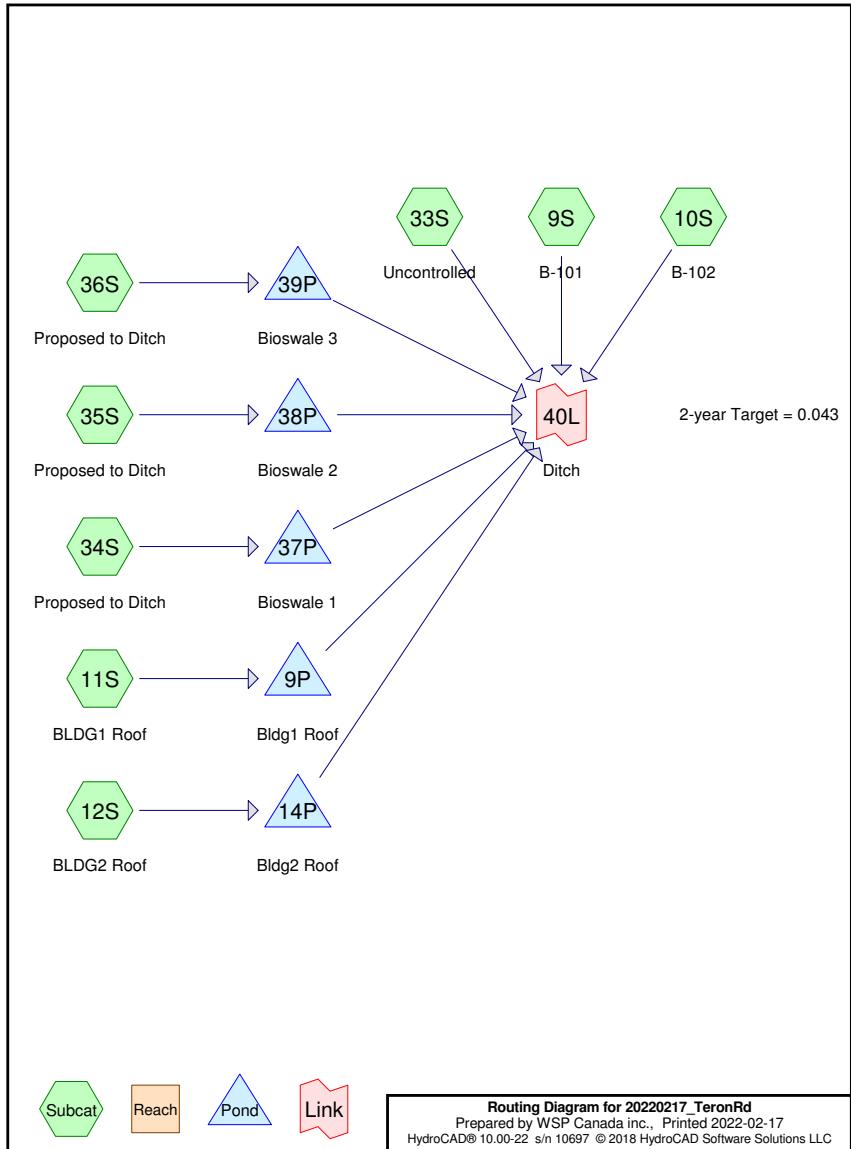
C

HydroCAD Model Output

APPENDIX

C-1

2-Year Analysis (Peak Discharge, $T_c = 10 \text{ min}$)



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
1,610.0	0.65	(9S)
2,160.0	0.90	(10S, 11S, 12S)
135.5	0.70	(33S)
1,880.0	0.75	(34S)
1,220.0	0.78	(35S)
1,760.0	0.74	(36S)
8,765.5	0.77	TOTAL AREA

20220217_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 3

Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 9S: B-101

Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=8 mm
Tc=10.0 min C=0.65 Runoff=0.02194 m³/s 13.4 m³

Subcatchment 10S: B-102

Runoff Area=130.0 m² 0.00% Impervious Runoff Depth=12 mm
Tc=10.0 min C=0.90 Runoff=0.00245 m³/s 1.5 m³

Subcatchment 11S: BLDG1 Roof

Runoff Area=1,490.0 m² 0.00% Impervious Runoff Depth=12 mm
Tc=10.0 min C=0.90 Runoff=0.02811 m³/s 17.2 m³

Subcatchment 12S: BLDG2 Roof

Runoff Area=540.0 m² 0.00% Impervious Runoff Depth=12 mm
Tc=10.0 min C=0.90 Runoff=0.01019 m³/s 6.2 m³

Subcatchment 33S: Uncontrolled

Runoff Area=135.5 m² 0.00% Impervious Runoff Depth=9 mm
Tc=10.0 min C=0.70 Runoff=0.00199 m³/s 1.2 m³

Subcatchment 34S: Proposed to Ditch

Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=10 mm
Tc=10.0 min C=0.75 Runoff=0.02956 m³/s 18.0 m³

Subcatchment 35S: Proposed to Ditch

Runoff Area=1,220.0 m² 0.00% Impervious Runoff Depth=10 mm
Tc=10.0 min C=0.78 Runoff=0.01995 m³/s 12.2 m³

Subcatchment 36S: Proposed to Ditch

Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=9 mm
Tc=10.0 min C=0.74 Runoff=0.02730 m³/s 16.7 m³

Pond 9P: Bldg1 Roof

Peak Elev=100.089 m Storage=9.9 m³ Inflow=0.02811 m³/s 17.2 m³
Outflow=0.00871 m³/s 17.2 m³

Pond 14P: Bldg2 Roof

Peak Elev=100.085 m Storage=2.5 m³ Inflow=0.01019 m³/s 6.2 m³
Outflow=0.00443 m³/s 6.2 m³

Pond 37P: Bioswale 1

Peak Elev=89.324 m Storage=18.0 m³ Inflow=0.02956 m³/s 18.0 m³
Outflow=0.00000 m³/s 0.0 m³

Pond 38P: Bioswale 2

Peak Elev=89.286 m Storage=12.2 m³ Inflow=0.01995 m³/s 12.2 m³
Outflow=0.00000 m³/s 0.0 m³

Pond 39P: Bioswale 3

Peak Elev=89.254 m Storage=16.7 m³ Inflow=0.02730 m³/s 16.7 m³
Outflow=0.00000 m³/s 0.0 m³

Link 40L: Ditch

Inflow=0.03837 m³/s 39.5 m³
Primary=0.03837 m³/s 39.5 m³

Total Runoff Area = 8,765.5 m² Runoff Volume = 86.4 m³ Average Runoff Depth = 10 mm
100.00% Pervious = 8,765.5 m² 0.00% Impervious = 0.0 m²

20220217_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

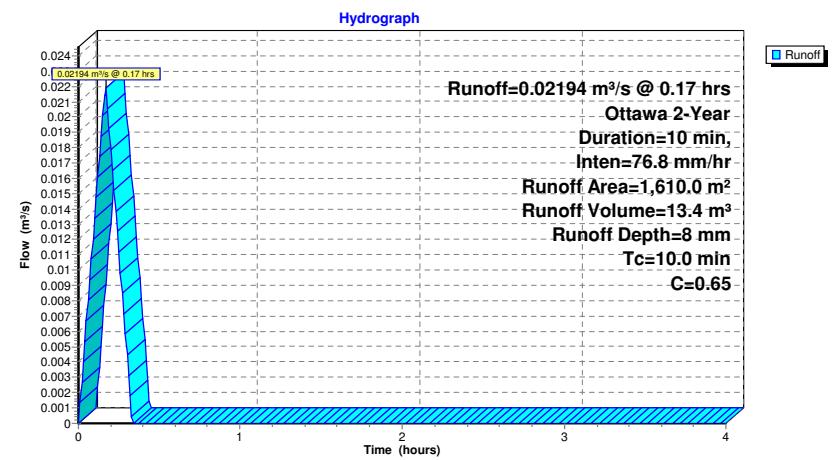
Page 4

Summary for Subcatchment 9S: B-101

Runoff = 0.02194 m³/s @ 0.17 hrs, Volume= 13.4 m³, Depth= 8 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description			
1,610.0	0.65				
1,610.0		100.00% Pervious Area			
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0 Direct Entry,					

Subcatchment 9S: B-101

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 5

Summary for Subcatchment 10S: B-102

Runoff = 0.00245 m³/s @ 0.17 hrs, Volume= 1.5 m³, Depth= 12 mm

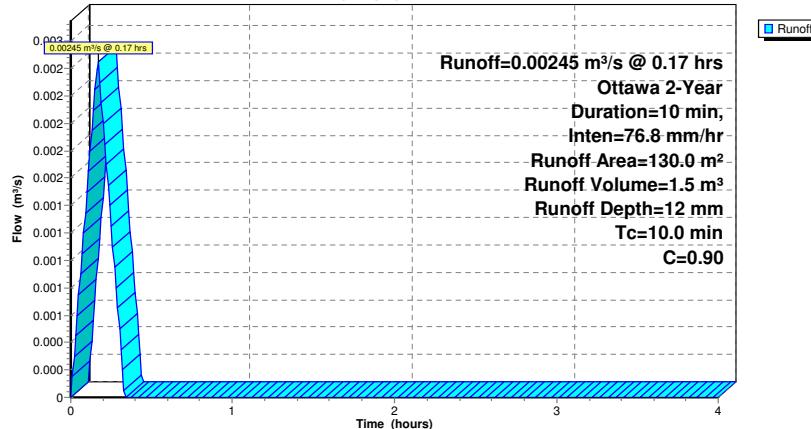
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description
130.0	0.90	
130.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 10S: B-102

Hydrograph



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 6

Summary for Subcatchment 11S: BLDG1 Roof

Runoff = 0.02811 m³/s @ 0.17 hrs, Volume= 17.2 m³, Depth= 12 mm

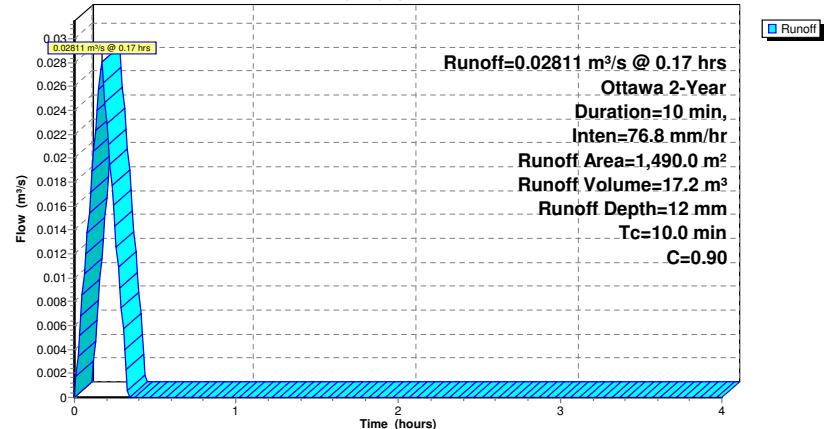
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description
1,490.0	0.90	
1,490.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 11S: BLDG1 Roof

Hydrograph



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 7

Summary for Subcatchment 12S: BLDG2 Roof

Runoff = 0.01019 m³ @ 0.17 hrs, Volume= 6.2 m³, Depth= 12 mm

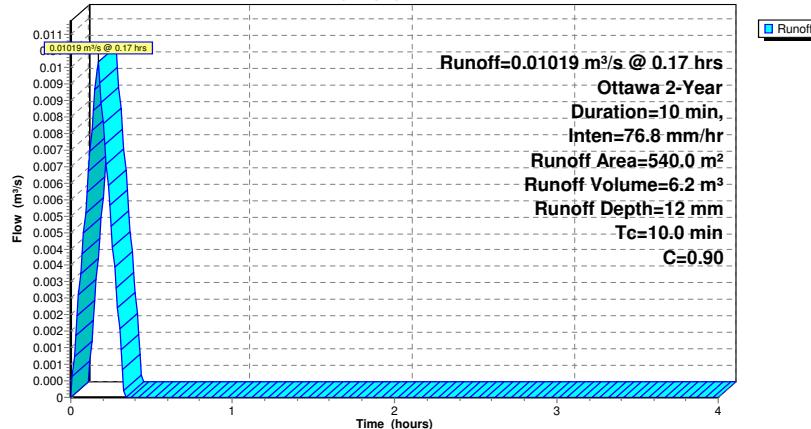
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description
540.0	0.90	
540.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 12S: BLDG2 Roof

Hydrograph



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 8

Summary for Subcatchment 33S: Uncontrolled

Runoff = 0.00199 m³ @ 0.17 hrs, Volume= 1.2 m³, Depth= 9 mm

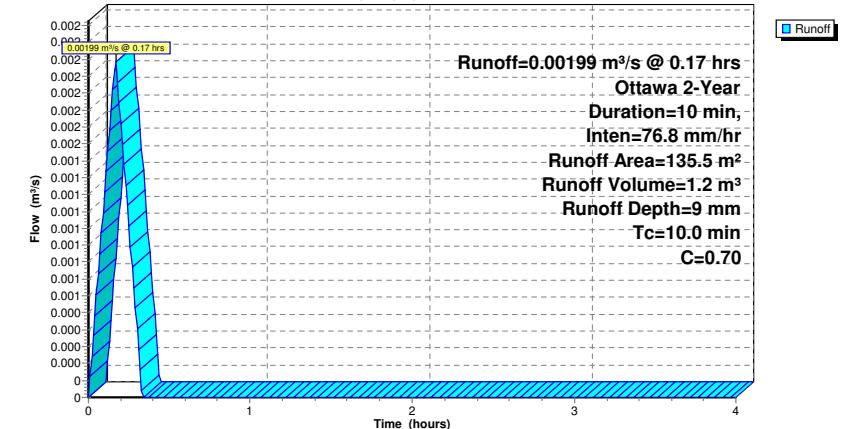
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description
135.5	0.70	
135.5	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 33S: Uncontrolled

Hydrograph



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 9

Summary for Subcatchment 34S: Proposed to Ditch

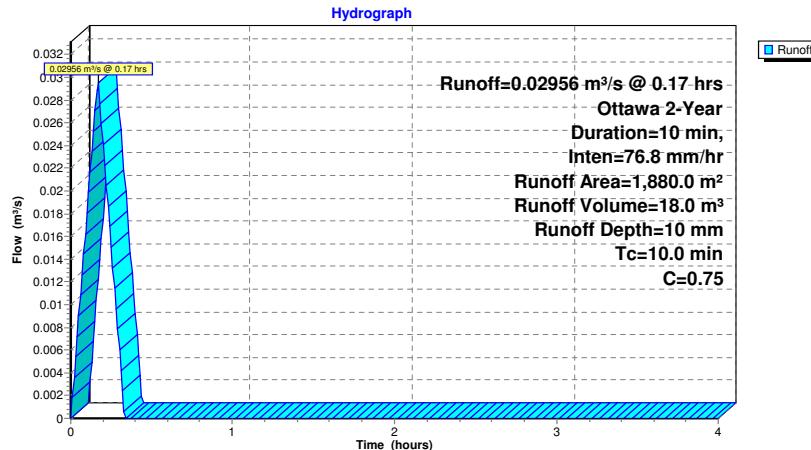
Runoff = 0.02956 m³/s @ 0.17 hrs, Volume= 18.0 m³, Depth= 10 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description
1,880.0	0.75	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 34S: Proposed to Ditch



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 10

Summary for Subcatchment 35S: Proposed to Ditch

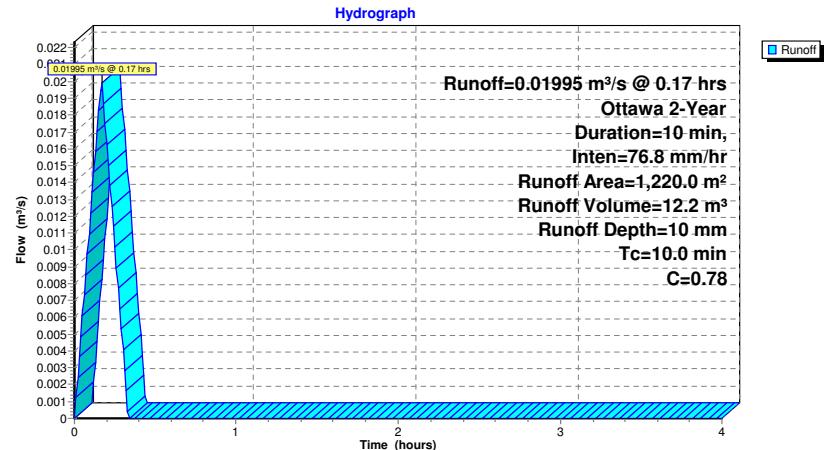
Runoff = 0.01995 m³/s @ 0.17 hrs, Volume= 12.2 m³, Depth= 10 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m ²)	C	Description
1,220.0	0.78	
1,220.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 35S: Proposed to Ditch



20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 11

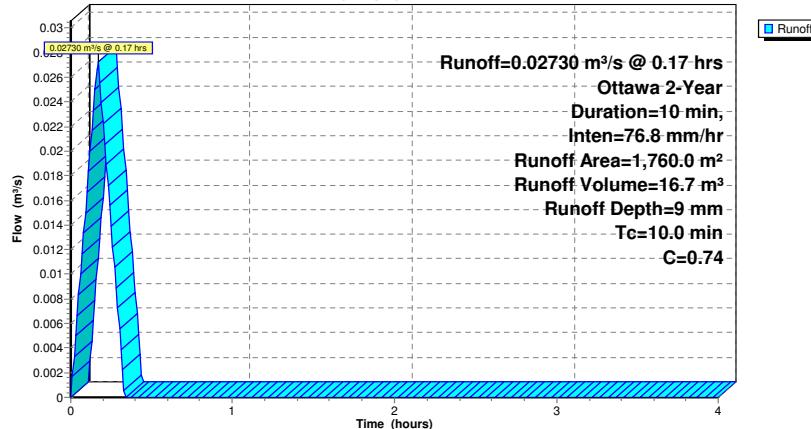
Summary for Subcatchment 36S: Proposed to Ditch

Runoff = 0.02730 m³/s @ 0.17 hrs, Volume= 16.7 m³, Depth= 9 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Area (m²)	C	Description
1,760.0	0.74	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment 36S: Proposed to Ditch**Hydrograph****20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 12

Summary for Pond 9P: Bldg1 Roof

Inflow Area = 1,490.0 m², 0.00% Impervious, Inflow Depth = 12 mm for 2-Year event

Inflow = 0.02811 m³/s @ 0.17 hrs, Volume= 17.2 m³

Outflow = 0.00871 m³/s @ 0.28 hrs, Volume= 17.2 m³, Atten= 69%, Lag= 6.9 min

Primary = 0.00871 m³/s @ 0.28 hrs, Volume= 17.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Peak Elev= 100.089 m @ 0.28 hrs Surf.Area= 332.3 m² Storage= 9.9 m³

Plug-Flow detention time= 11.4 min calculated for 17.1 m³ (100% of inflow)

Center-of-Mass det. time= 11.4 min (21.4 - 10.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152			
Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950			
0.001100 0.001260			

Primary OutFlow Max=0.00870 m³/s @ 0.28 hrs HW=100.089 m (Free Discharge)

↑=WATTS Accutrol_5-0.5 (Custom Controls 0.00870 m³/s)

20220217_TeronRd

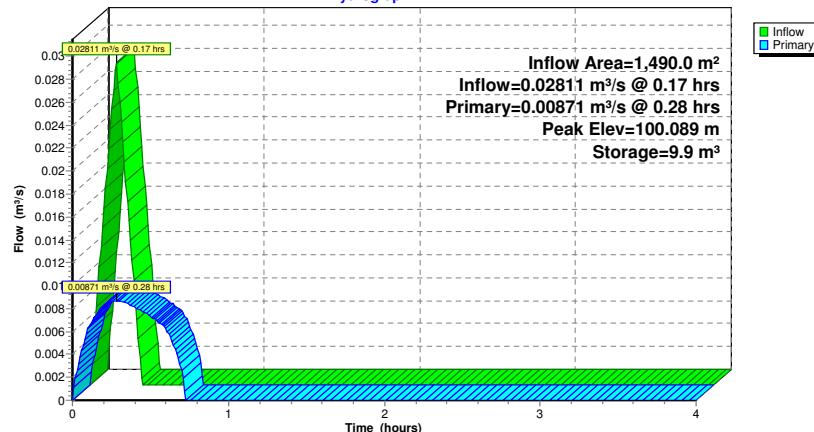
Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 14

Pond 9P: Bldg1 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17
Page 15**Summary for Pond 14P: Bldg2 Roof**

Inflow Area = 540.0 m², 0.00% Impervious, Inflow Depth = 12 mm for 2-Year event
 Inflow = 0.01019 m³/s @ 0.17 hrs, Volume= 6.2 m³
 Outflow = 0.00443 m³/s @ 0.26 hrs, Volume= 6.2 m³, Atten= 56%, Lag= 5.7 min
 Primary = 0.00443 m³/s @ 0.26 hrs, Volume= 6.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.085 m @ 0.26 hrs Surf.Area= 102.2 m² Storage= 2.5 m³

Plug-Flow detention time= 5.5 min calculated for 6.2 m³ (100% of inflow)
 Center-of-Mass det. time= 5.5 min (15.5 - 10.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

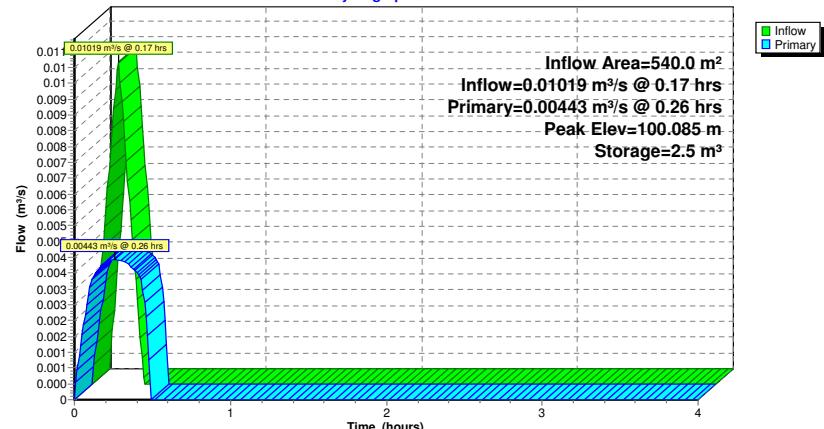
Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17
Page 16

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00
			Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152
			Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790
			0.000870 0.000950

Primary OutFlow Max=0.00443 m³/s @ 0.26 hrs HW=100.085 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00443 m³/s)

Pond 14P: Bldg2 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17
Page 17**Summary for Pond 37P: Bioswale 1**

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 10 mm for 2-Year event
 Inflow = 0.02956 m³/s @ 0.17 hrs, Volume= 18.0 m³
 Outflow = 0.00000 m³/s @ 0.00 hrs, Volume= 0.0 m³, Atten= 100%, Lag= 0.0 min
 Primary = 0.00000 m³/s @ 0.00 hrs, Volume= 0.0 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.324 m @ 0.34 hrs Surf.Area= 0.0 m² Storage= 18.0 m³

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.611 m	HYDROVEX 100-VHV-1 X 0.78 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

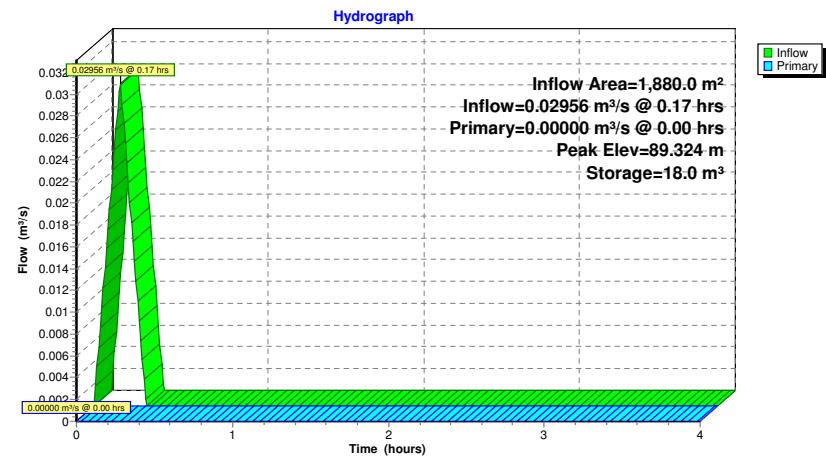
Primary OutFlow Max=0.00000 m³/s @ 0.00 hrs HW=88.700 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Passes 0.00000 m³/s of 0.00003 m³/s potential flow)

↑ 1=Single OPSD 400.01 (Controls 0.00000 m³/s)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17
Page 18**Pond 37P: Bioswale 1**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 19

Summary for Pond 38P: Bioswale 2

Inflow Area = 1,220.0 m², 0.00% Impervious, Inflow Depth = 10 mm for 2-Year event
 Inflow = 0.01995 m³/s @ 0.17 hrs, Volume= 12.2 m³
 Outflow = 0.00000 m³/s @ 0.00 hrs, Volume= 0.0 m³, Atten= 100%, Lag= 0.0 min
 Primary = 0.00000 m³/s @ 0.00 hrs, Volume= 0.0 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.286 m @ 0.34 hrs Surf.Area= 0.0 m² Storage= 12.2 m³

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000
#2	Primary	88.537 m	HYDROVEX 100-VHV-1 X 0.83 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00000 m³/s @ 0.00 hrs HW=88.641 m (Free Discharge)

↑=HYDROVEX 100-VHV-1 (Passes 0.00000 m³/s of 0.00004 m³/s potential flow)

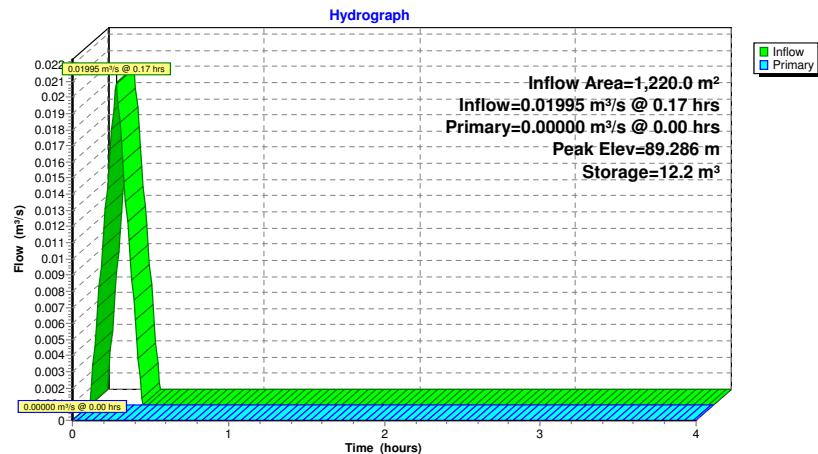
↑=Single OPSD 400.01 (Controls 0.00000 m³/s)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17

Page 20

Pond 38P: Bioswale 2

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17
Page 21**Summary for Pond 39P: Bioswale 3**

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 9 mm for 2-Year event
 Inflow = 0.02730 m³/s @ 0.17 hrs, Volume= 16.7 m³
 Outflow = 0.00000 m³/s @ 0.00 hrs, Volume= 0.0 m³, Atten= 100%, Lag= 0.0 min
 Primary = 0.00000 m³/s @ 0.00 hrs, Volume= 0.0 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.254 m @ 0.34 hrs Surf.Area= 0.0 m² Storage= 16.7 m³

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.489 m	HYDROVEX 125-VHV-2 X 0.83 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

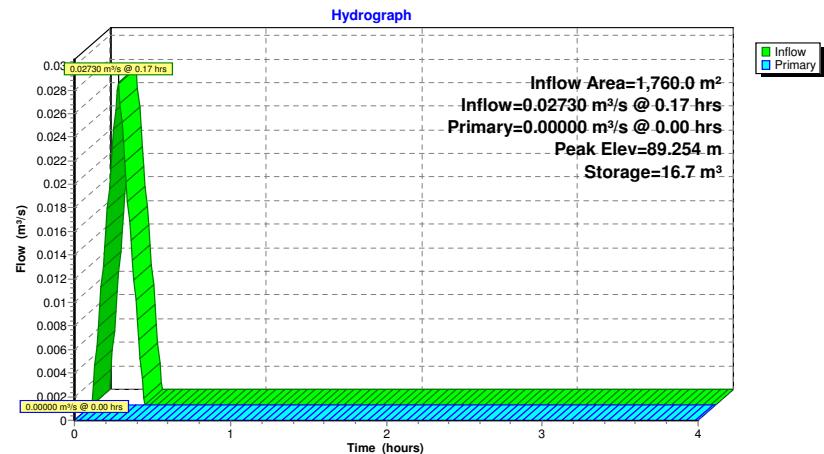
Primary OutFlow Max=0.00000 m³/s @ 0.00 hrs HW=88.555 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Passes 0.00000 m³/s of 0.00003 m³/s potential flow)

↑ 1=Single OPSD 400.01 (Controls 0.00000 m³/s)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr

Printed 2022-02-17
Page 22**Pond 39P: Bioswale 3**

20220217_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 2-Year Duration=10 min, Inten=76.8 mm/hr
Printed 2022-02-17
Page 23

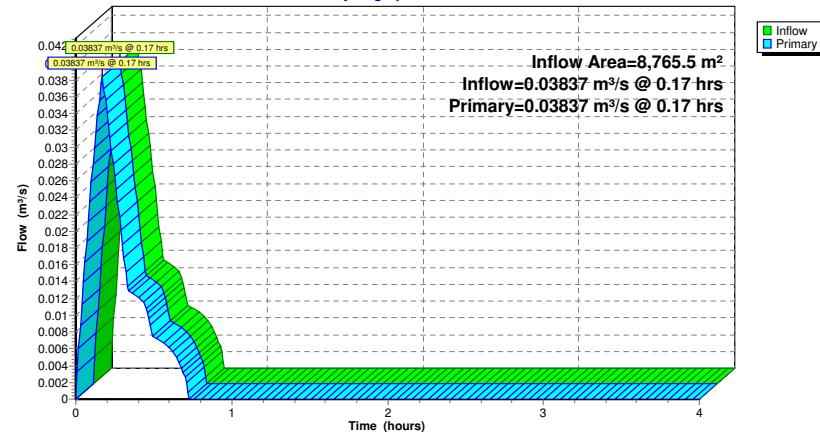
Summary for Link 40L: Ditch

Inflow Area = 8,765.5 m², 0.00% Impervious, Inflow Depth = 5 mm for 2-Year event
Inflow = 0.03837 m³/s @ 0.17 hrs, Volume= 39.5 m³
Primary = 0.03837 m³/s @ 0.17 hrs, Volume= 39.5 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 40L: Ditch

Hydrograph

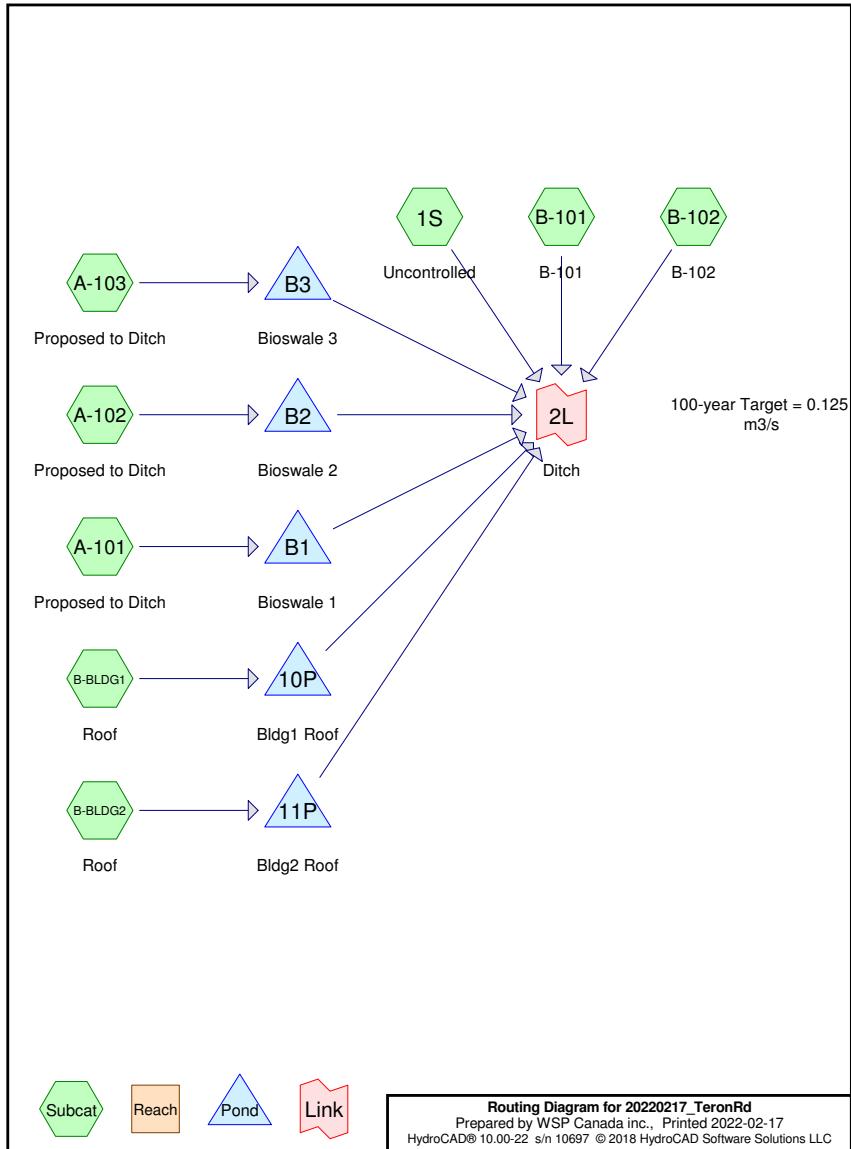


APPENDIX

C-2

100-Year Analysis (Peak Discharge, $T_c = 16 \text{ min}$)

The storm system for the site is governed by the 100-year storm. Peak storage in each storage unit and peak discharge may occur at separate times of concentration and are therefore reported separately



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
135.5	0.87	(1S)
1,880.0	0.94	(A-101)
1,220.0	0.97	(A-102)
1,760.0	0.93	(A-103)
1,610.0	0.81	(B-101)
2,160.0	1.00	(B-102, B-BLDG1, B-BLDG2)
8,765.5	0.93	TOTAL AREA

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 3

Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
 Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Uncontrolled

Runoff Area=135.5 m² 0.00% Impervious Runoff Depth=32 mm
 Tc=10.0 min C=0.87 Runoff=0.00450 m³/s 4.3 m³

Subcatchment A-101: Proposed to Ditch Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=34 mm
 Tc=10.0 min C=0.94 Runoff=0.06752 m³/s 64.8 m³

Subcatchment A-102: Proposed to Runoff Area=1,220.0 m² 100.00% Impervious Runoff Depth=36 mm
 Tc=10.0 min C=0.97 Runoff=0.04522 m³/s 43.4 m³

Subcatchment A-103: Proposed to Ditch Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=34 mm
 Tc=10.0 min C=0.93 Runoff=0.06254 m³/s 60.0 m³

Subcatchment B-101: B-101 Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=30 mm
 Tc=10.0 min C=0.81 Runoff=0.04983 m³/s 47.8 m³

Subcatchment B-102: B-102 Runoff Area=130.0 m² 100.00% Impervious Runoff Depth=37 mm
 Tc=10.0 min C=1.00 Runoff=0.00497 m³/s 4.8 m³

Subcatchment B-BLDG1: Roof Runoff Area=1,490.0 m² 100.00% Impervious Runoff Depth=37 mm
 Tc=10.0 min C=1.00 Runoff=0.05693 m³/s 54.6 m³

Subcatchment B-BLDG2: Roof Runoff Area=540.0 m² 100.00% Impervious Runoff Depth=37 mm
 Tc=10.0 min C=1.00 Runoff=0.02063 m³/s 19.8 m³

Pond 10P: Bldg1 Roof Peak Elev=100.143 m Storage=40.9 m³ Inflow=0.05693 m³/s 54.6 m³
 Outflow=0.01203 m³/s 54.6 m³

Pond 11P: Bldg2 Roof Peak Elev=100.134 m Storage=13.2 m³ Inflow=0.02063 m³/s 19.8 m³
 Outflow=0.00535 m³/s 19.8 m³

Pond B1: Bioswale 1 Peak Elev=89.772 m Storage=59.6 m³ Inflow=0.06752 m³/s 64.8 m³
 Outflow=0.00869 m³/s 26.2 m³

Pond B2: Bioswale 2 Peak Elev=89.808 m Storage=37.9 m³ Inflow=0.04522 m³/s 43.4 m³
 Outflow=0.00950 m³/s 17.2 m³

Pond B3: Bioswale 3 Peak Elev=89.847 m Storage=50.2 m³ Inflow=0.06254 m³/s 60.0 m³
 Outflow=0.01781 m³/s 24.5 m³

Link 2L: Ditch Inflow=0.10820 m³/s 199.3 m³
 Primary=0.10820 m³/s 199.3 m³

Total Runoff Area = 8,765.5 m² Runoff Volume = 299.6 m³ Average Runoff Depth = 34 mm
 61.44% Pervious = 5,385.5 m² 38.56% Impervious = 3,380.0 m²

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

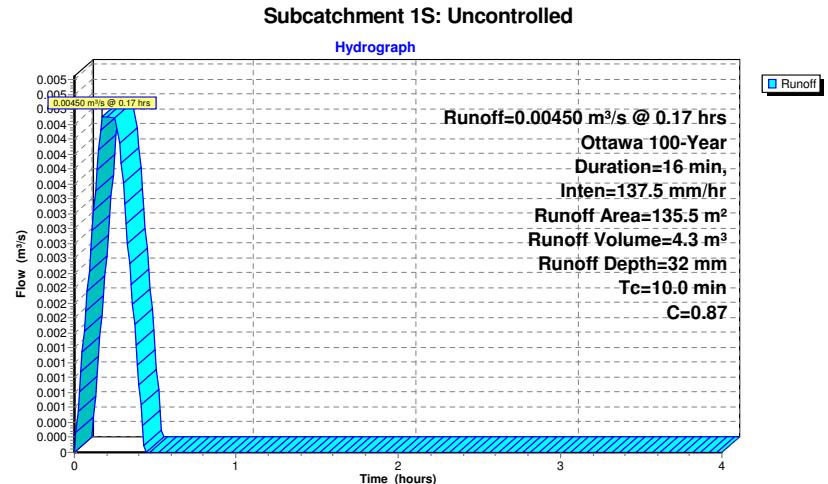
Page 4

Summary for Subcatchment 1S: Uncontrolled

Runoff = 0.00450 m³/s @ 0.17 hrs, Volume= 4.3 m³, Depth= 32 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m ²)	C	Description			
135.5	0.87				
135.5		100.00% Pervious Area			
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					
Direct Entry,					



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 5

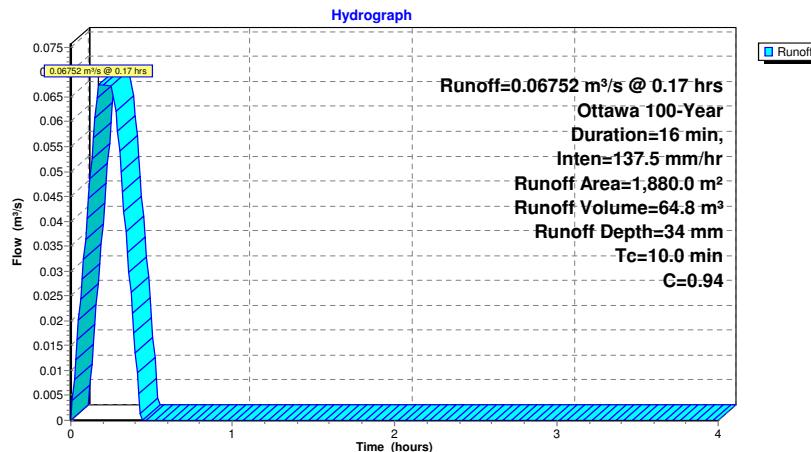
Summary for Subcatchment A-101: Proposed to Ditch

Runoff = 0.06752 m³/s @ 0.17 hrs, Volume= 64.8 m³, Depth= 34 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
1,880.0	0.94	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-101: Proposed to Ditch**20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 6

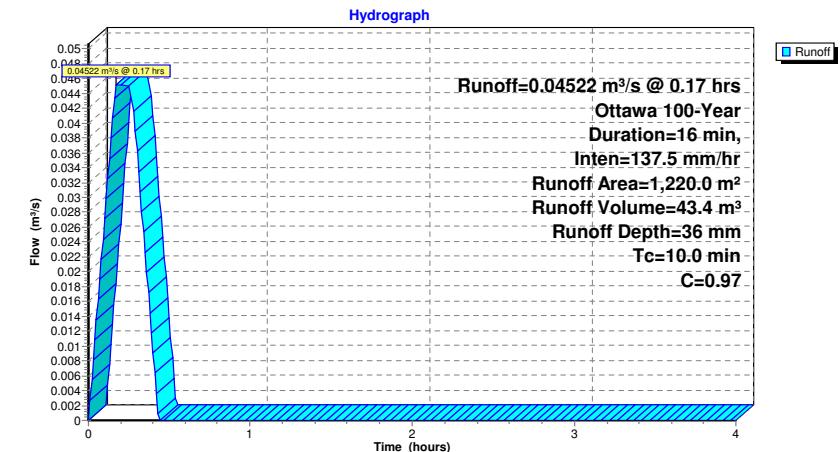
Summary for Subcatchment A-102: Proposed to Ditch

Runoff = 0.04522 m³/s @ 0.17 hrs, Volume= 43.4 m³, Depth= 36 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
1,220.0	0.97	
1,220.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-102: Proposed to Ditch

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 7

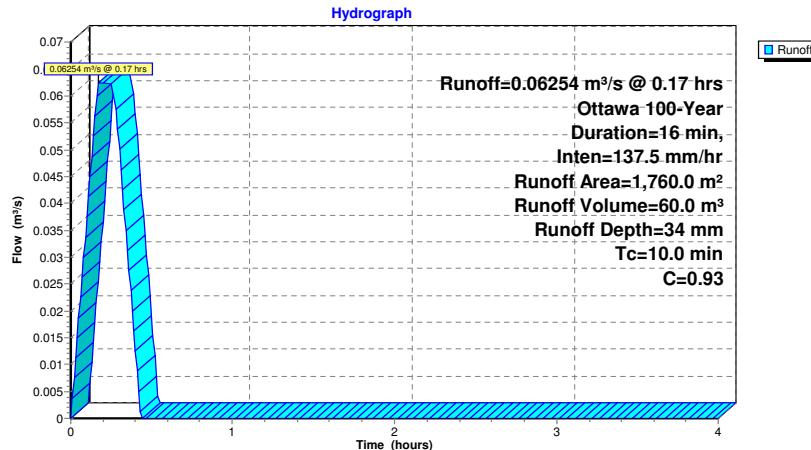
Summary for Subcatchment A-103: Proposed to Ditch

Runoff = 0.06254 m³/s @ 0.17 hrs, Volume= 60.0 m³, Depth= 34 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
1,760.0	0.93	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-103: Proposed to Ditch**20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 8

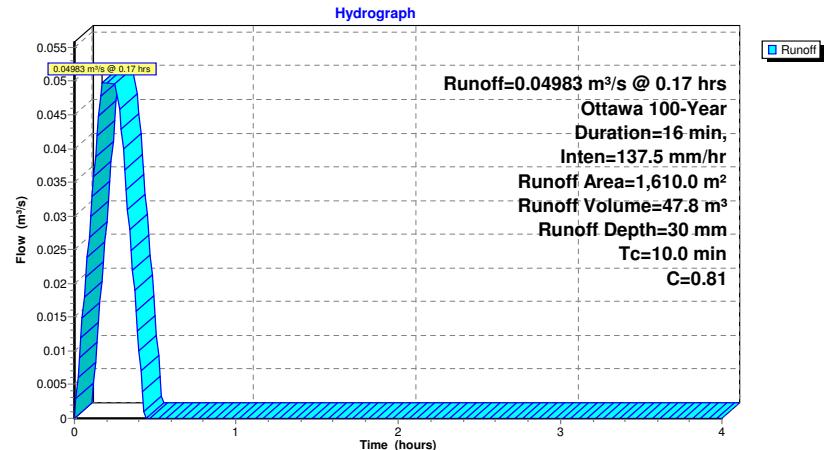
Summary for Subcatchment B-101: B-101

Runoff = 0.04983 m³/s @ 0.17 hrs, Volume= 47.8 m³, Depth= 30 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
1,610.0	0.81	
1,610.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-101: B-101

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 9

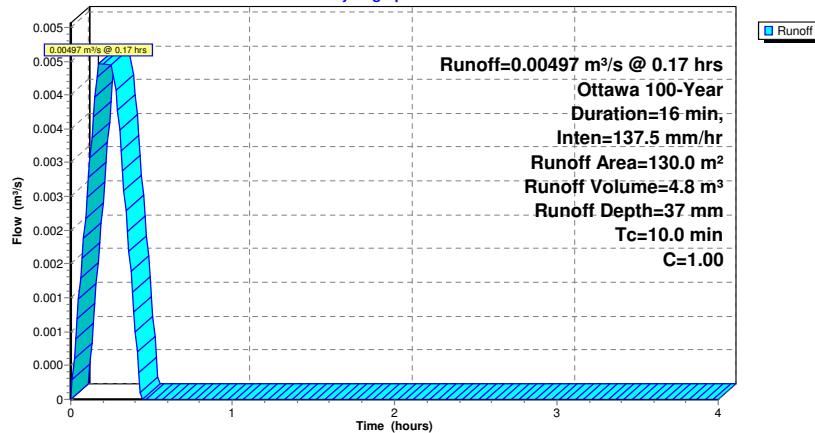
Summary for Subcatchment B-102: B-102

Runoff = 0.00497 m³/s @ 0.17 hrs, Volume= 4.8 m³, Depth= 37 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
130.0	1.00	
130.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-102: B-102**Hydrograph****20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 10

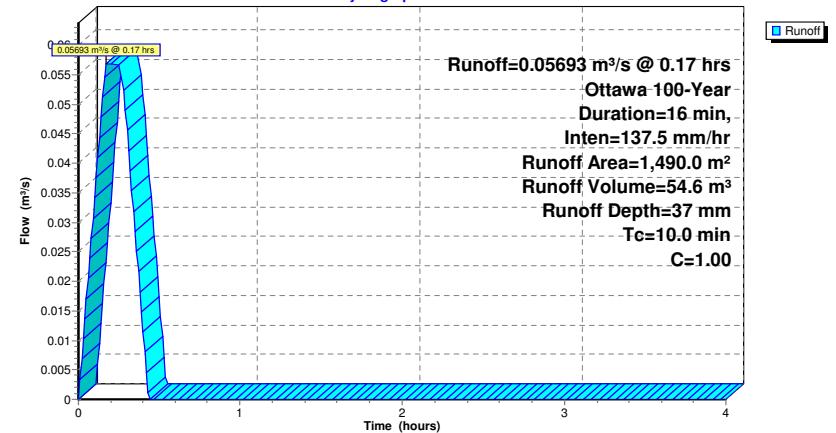
Summary for Subcatchment B-BLDG1: Roof

Runoff = 0.05693 m³/s @ 0.17 hrs, Volume= 54.6 m³, Depth= 37 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
1,490.0	1.00	
1,490.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG1: Roof**Hydrograph**

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 11

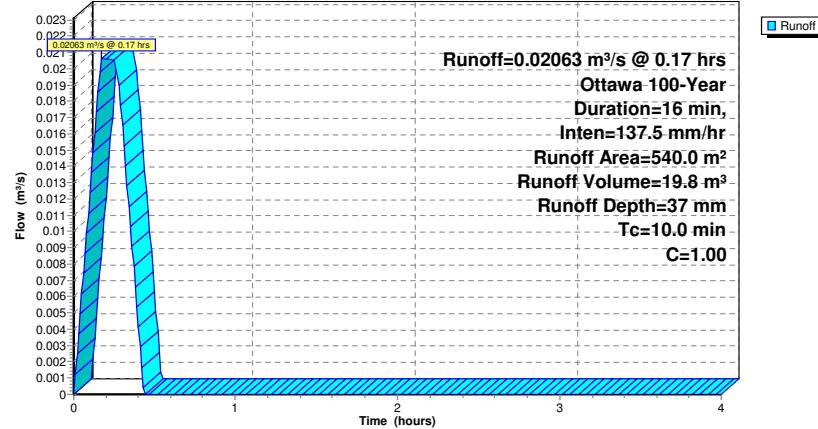
Summary for Subcatchment B-BLDG2: Roof

Runoff = 0.02063 m³/s @ 0.17 hrs, Volume= 19.8 m³, Depth= 37 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Area (m²)	C	Description
540.0	1.00	
540.0		100.00% Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG2: Roof**Hydrograph****20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 12

Summary for Pond 10P: Bldg1 Roof

Inflow Area = 1,490.0 m², 100.00% Impervious, Inflow Depth = 37 mm for 100-Year event

Inflow = 0.05693 m³/s @ 0.17 hrs, Volume= 54.6 m³

Outflow = 0.01203 m³/s @ 0.40 hrs, Volume= 54.6 m³, Atten= 79%, Lag= 13.7 min

Primary = 0.01203 m³/s @ 0.40 hrs, Volume= 54.6 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Peak Elev= 100.143 m @ 0.40 hrs Surf.Area= 857.2 m² Storage= 40.9 m³Plug-Flow detention time= 33.3 min calculated for 54.5 m³ (100% of inflow)
Center-of-Mass det. time= 33.4 min (46.4 - 13.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152			
Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950			
0.001100 0.001260			

Primary OutFlow Max=0.01203 m³/s @ 0.40 hrs HW=100.143 m (Free Discharge)

↑=WATTS Accutrol_5-0.5 (Custom Controls 0.01203 m³/s)

20220217_TeronRd

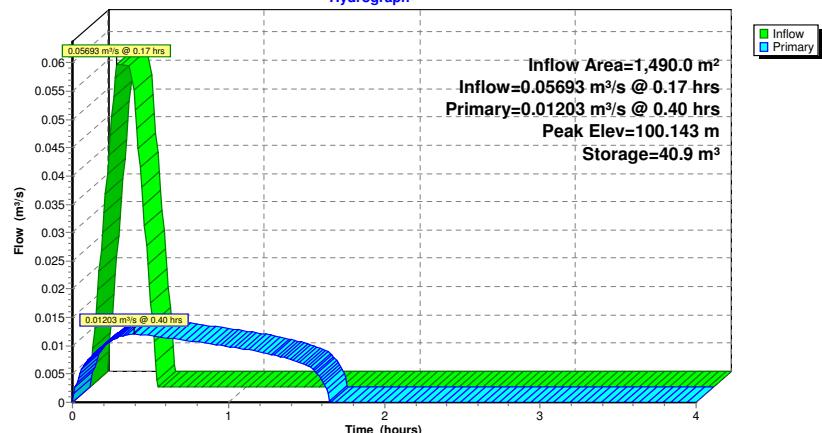
Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 14

Pond 10P: Bldg1 Roof**Hydrograph**

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 15

Summary for Pond 11P: Bldg2 Roof

Inflow Area = 540.0 m², 100.00% Impervious, Inflow Depth = 37 mm for 100-Year event
 Inflow = 0.02063 m³/s @ 0.17 hrs, Volume= 19.8 m³
 Outflow = 0.00535 m³/s @ 0.39 hrs, Volume= 19.8 m³, Atten= 74%, Lag= 13.2 min
 Primary = 0.00535 m³/s @ 0.39 hrs, Volume= 19.8 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.134 m @ 0.39 hrs Surf.Area= 375.2 m² Storage= 13.2 m³

Plug-Flow detention time= 22.7 min calculated for 19.8 m³ (100% of inflow)
 Center-of-Mass det. time= 22.7 min (35.7 - 13.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

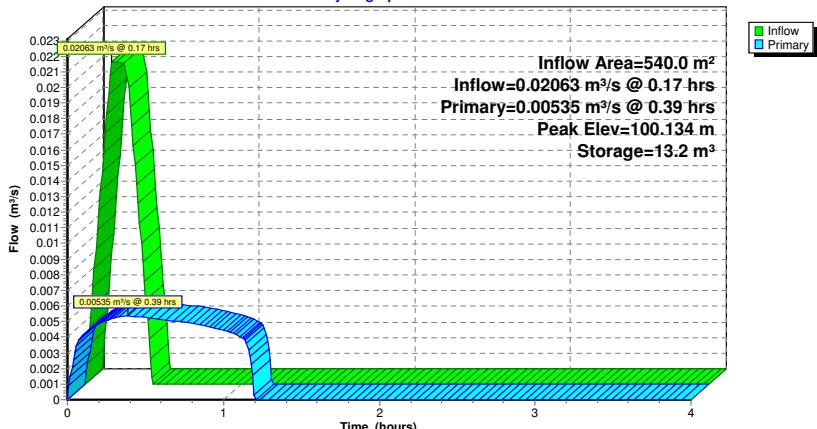
Printed 2022-02-17

Page 16

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00
			Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152
			Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790
			0.000870 0.000950

Primary OutFlow Max=0.00535 m³/s @ 0.39 hrs HW=100.134 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00535 m³/s)

Pond 11P: Bldg2 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 17

Summary for Pond B1: Bioswale 1

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 34 mm for 100-Year event
 Inflow = 0.06752 m³/s @ 0.17 hrs, Volume= 64.8 m³
 Outflow = 0.00869 m³/s @ 0.41 hrs, Volume= 26.2 m³, Atten= 87%, Lag= 14.5 min
 Primary = 0.00869 m³/s @ 0.41 hrs, Volume= 26.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.772 m @ 0.41 hrs Surf.Area= 0.0 m² Storage= 59.6 m³

Plug-Flow detention time= 34.8 min calculated for 26.2 m³ (40% of inflow)
 Center-of-Mass det. time= 29.2 min (42.2 - 13.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.611 m	HYDROVEX 100-VHV-1 X 0.78 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00869 m³/s @ 0.41 hrs HW=89.772 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00869 m³/s)

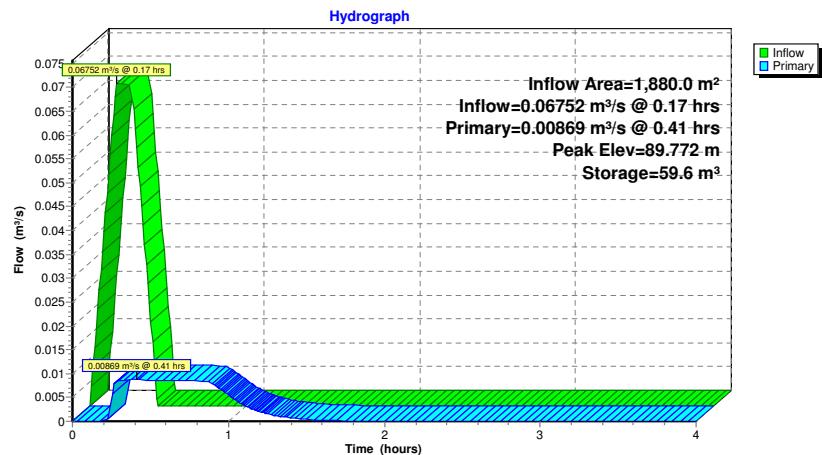
↑ 1=Single OPSD 400.01 (Passes 0.00869 m³/s of 0.12186 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 18

Pond B1: Bioswale 1

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 19

Summary for Pond B2: Bioswale 2

Inflow Area = 1,220.0 m², 100.00% Impervious, Inflow Depth = 36 mm for 100-Year event
 Inflow = 0.04522 m³/s @ 0.17 hrs, Volume= 43.4 m³
 Outflow = 0.00950 m³/s @ 0.40 hrs, Volume= 17.2 m³, Atten= 79%, Lag= 13.7 min
 Primary = 0.00950 m³/s @ 0.40 hrs, Volume= 17.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.808 m @ 0.40 hrs Surf.Area= 0.0 m² Storage= 37.9 m³

Plug-Flow detention time= 23.5 min calculated for 17.2 m³ (40% of inflow)
 Center-of-Mass det. time= 18.1 min (31.1 - 13.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000
#2	Primary	88.537 m	HYDROVEX 100-VHV-1 X 0.82 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00950 m³/s @ 0.40 hrs HW=89.808 m (Free Discharge)

↑=HYDROVEX 100-VHV-1 (Custom Controls 0.00950 m³/s)

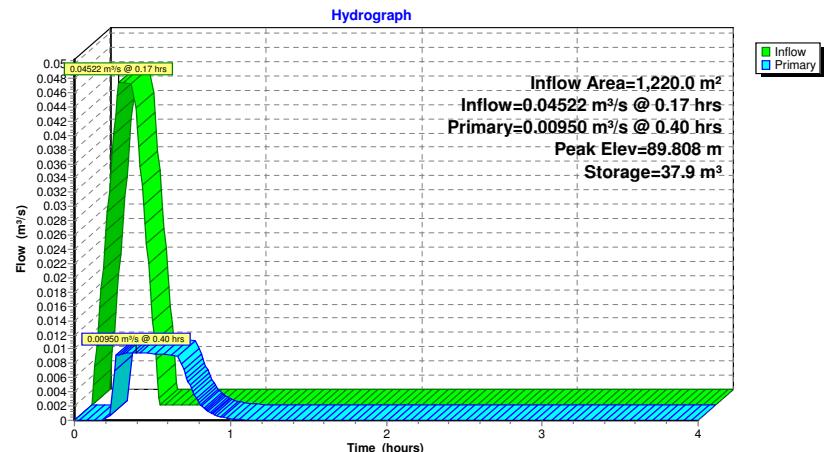
↑=Single OPSD 400.01 (Passes 0.00950 m³/s of 0.15020 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 20

Pond B2: Bioswale 2

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 21

Summary for Pond B3: Bioswale 3

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 34 mm for 100-Year event
 Inflow = 0.06254 m³/s @ 0.17 hrs, Volume= 60.0 m³
 Outflow = 0.01781 m³/s @ 0.39 hrs, Volume= 24.5 m³, Atten= 72%, Lag= 13.0 min
 Primary = 0.01781 m³/s @ 0.39 hrs, Volume= 24.5 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.847 m @ 0.39 hrs Surf.Area= 0.0 m² Storage= 50.2 m³

Plug-Flow detention time= 19.7 min calculated for 24.4 m³ (41% of inflow)
 Center-of-Mass det. time= 14.5 min (27.5 - 13.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.489 m	HYDROVEX 125-VHV-2 X 0.82 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

Primary OutFlow Max=0.01781 m³/s @ 0.39 hrs HW=89.847 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Custom Controls 0.01781 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.01781 m³/s of 0.17084 m³/s potential flow)

20220217_TeronRd

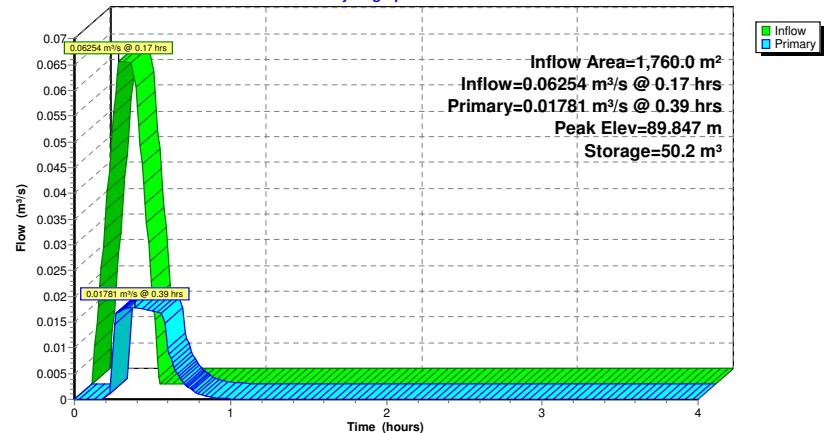
Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr

Printed 2022-02-17

Page 22

Pond B3: Bioswale 3**Hydrograph**

20220217_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=16 min, Inten=137.5 mm/hr
Printed 2022-02-17
Page 23

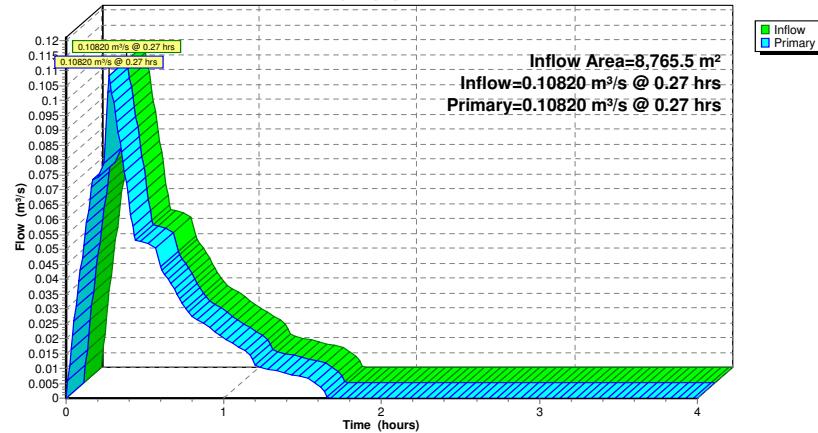
Summary for Link 2L: Ditch

Inflow Area = 8,765.5 m², 38.56% Impervious, Inflow Depth = 23 mm for 100-Year event
Inflow = 0.10820 m³/s @ 0.27 hrs, Volume= 199.3 m³
Primary = 0.10820 m³/s @ 0.27 hrs, Volume= 199.3 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 2L: Ditch

Hydrograph

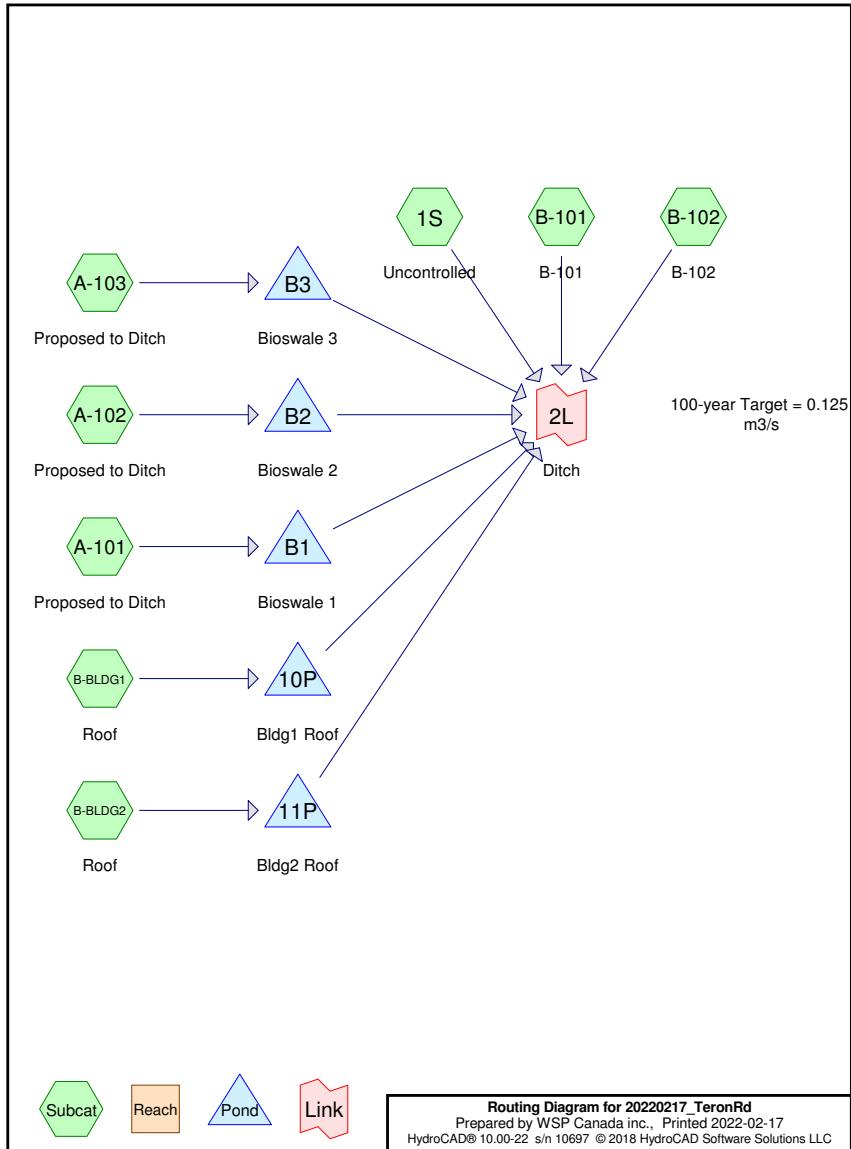


APPENDIX

C-3

100-Year Analysis (Peak Storage Bioswale 1, $T_c = 72$ min)

The storm system for the site is governed by the 100-year storm. Peak storage in each storage unit and peak discharge may occur at separate times of concentration and are therefore reported separately



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
135.5	0.87	(1S)
1,880.0	0.94	(A-101)
1,220.0	0.97	(A-102)
1,760.0	0.93	(A-103)
1,610.0	0.81	(B-101)
2,160.0	1.00	(B-102, B-BLDG1, B-BLDG2)
8,765.5	0.93	TOTAL AREA

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 3Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

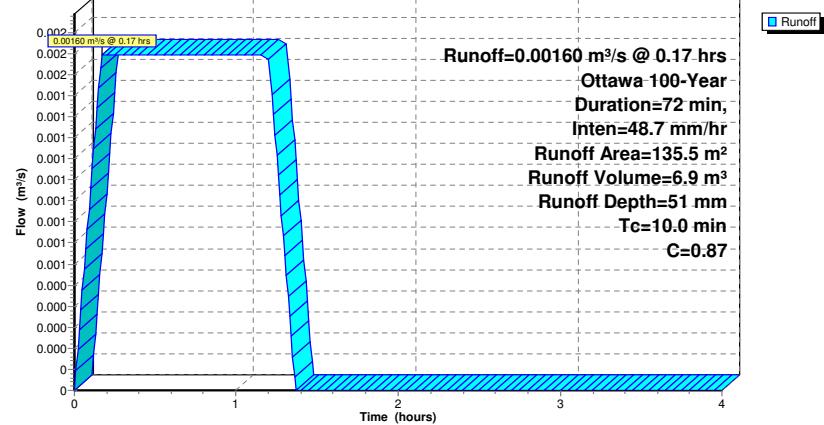
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: UncontrolledRunoff Area=135.5 m² 0.00% Impervious Runoff Depth=51 mm
Tc=10.0 min C=0.87 Runoff=0.00160 m³/s 6.9 m³**Subcatchment A-101: Proposed to Ditch** Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=55 mm
Tc=10.0 min C=0.94 Runoff=0.02393 m³/s 103.4 m³**Subcatchment A-102: Proposed to** Runoff Area=1,220.0 m² 100.00% Impervious Runoff Depth=57 mm
Tc=10.0 min C=0.97 Runoff=0.01602 m³/s 69.2 m³**Subcatchment A-103: Proposed to Ditch** Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=54 mm
Tc=10.0 min C=0.93 Runoff=0.02216 m³/s 95.7 m³**Subcatchment B-101: B-101** Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=47 mm
Tc=10.0 min C=0.81 Runoff=0.01766 m³/s 76.3 m³**Subcatchment B-102: B-102** Runoff Area=130.0 m² 100.00% Impervious Runoff Depth=58 mm
Tc=10.0 min C=1.00 Runoff=0.00176 m³/s 7.6 m³**Subcatchment B-BLDG1: Roof** Runoff Area=1,490.0 m² 100.00% Impervious Runoff Depth=58 mm
Tc=10.0 min C=1.00 Runoff=0.02017 m³/s 87.1 m³**Subcatchment B-BLDG2: Roof** Runoff Area=540.0 m² 100.00% Impervious Runoff Depth=58 mm
Tc=10.0 min C=1.00 Runoff=0.00731 m³/s 31.6 m³**Pond 10P: Bldg1 Roof** Peak Elev=100.143 m Storage=41.2 m³ Inflow=0.02017 m³/s 87.1 m³
Outflow=0.01205 m³/s 87.1 m³**Pond 11P: Bldg2 Roof** Peak Elev=100.125 m Storage=10.3 m³ Inflow=0.00731 m³/s 31.6 m³
Outflow=0.00519 m³/s 31.6 m³**Pond B1: Bioswale 1** Peak Elev=89.915 m Storage=79.3 m³ Inflow=0.02393 m³/s 103.4 m³
Outflow=0.00914 m³/s 64.7 m³**Pond B2: Bioswale 2** Peak Elev=89.902 m Storage=43.9 m³ Inflow=0.01602 m³/s 69.2 m³
Outflow=0.00981 m³/s 43.1 m³**Pond B3: Bioswale 3** Peak Elev=89.850 m Storage=50.3 m³ Inflow=0.02216 m³/s 95.7 m³
Outflow=0.01783 m³/s 60.2 m³**Link 2L: Ditch** Inflow=0.07495 m³/s 377.5 m³
Primary=0.07495 m³/s 377.5 m³Total Runoff Area = 8,765.5 m² Runoff Volume = 477.8 m³ Average Runoff Depth = 55 mm
61.44% Pervious = 5,385.5 m² 38.56% Impervious = 3,380.0 m²**20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 4**Summary for Subcatchment 1S: Uncontrolled**Runoff = 0.00160 m³/s @ 0.17 hrs, Volume= 6.9 m³, Depth= 51 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description			
135.5	0.87				
135.5		100.00% Pervious Area			
Direct Entry,					
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					

Subcatchment 1S: Uncontrolled**Hydrograph**

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 5

Summary for Subcatchment A-101: Proposed to Ditch

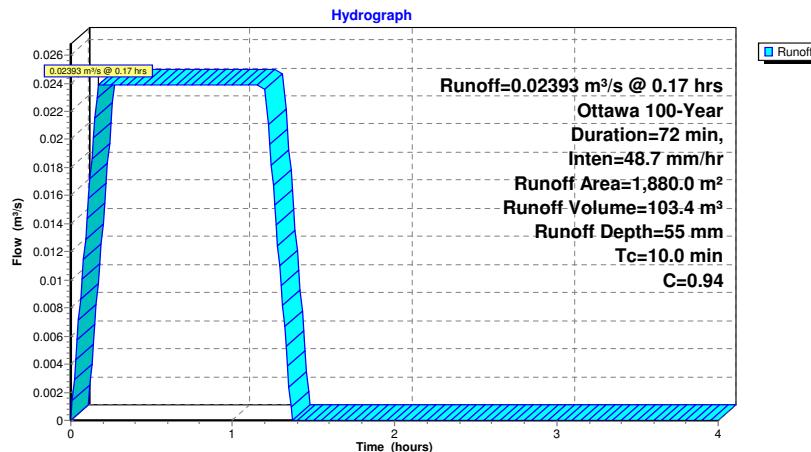
Runoff = 0.02393 m³/s @ 0.17 hrs, Volume= 103.4 m³, Depth= 55 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description
1,880.0	0.94	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-101: Proposed to Ditch



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 6

Summary for Subcatchment A-102: Proposed to Ditch

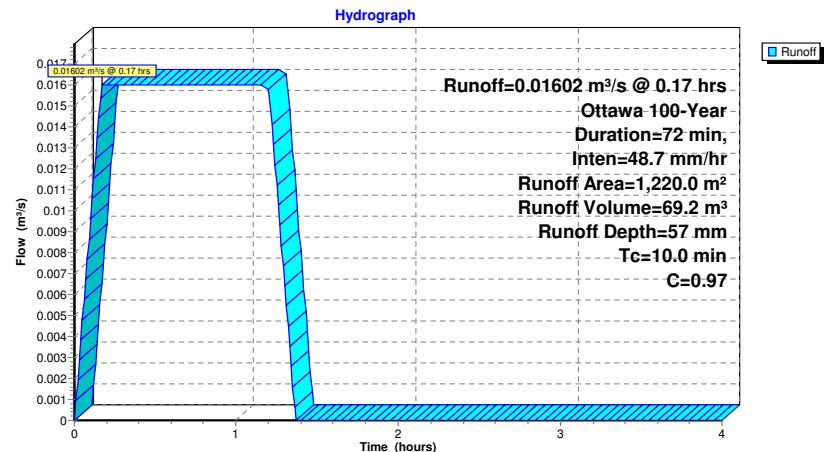
Runoff = 0.01602 m³/s @ 0.17 hrs, Volume= 69.2 m³, Depth= 57 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description
1,220.0	0.97	
1,220.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-102: Proposed to Ditch



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 7

Summary for Subcatchment A-103: Proposed to Ditch

Runoff = 0.02216 m³/s @ 0.17 hrs, Volume= 95.7 m³, Depth= 54 mm

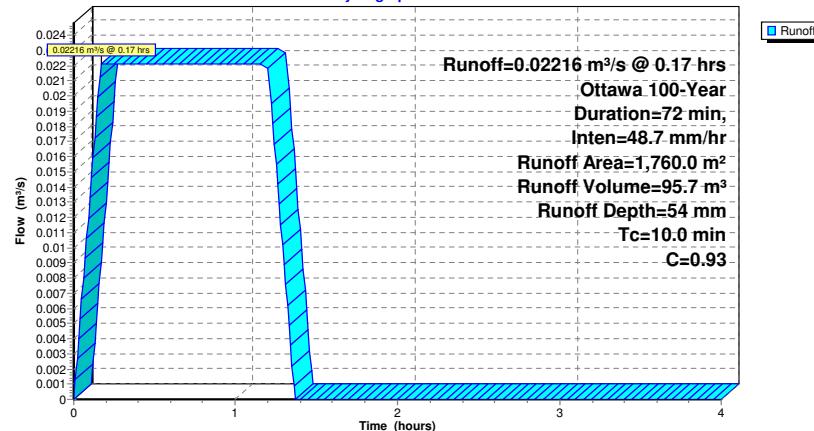
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description
1,760.0	0.93	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-103: Proposed to Ditch

Hydrograph



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 8

Summary for Subcatchment B-101: B-101

Runoff = 0.01766 m³/s @ 0.17 hrs, Volume= 76.3 m³, Depth= 47 mm

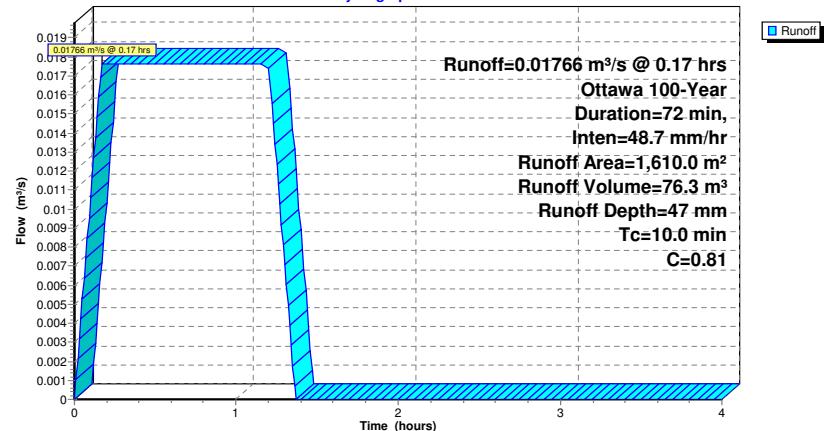
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description
1,610.0	0.81	
1,610.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-101: B-101

Hydrograph



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

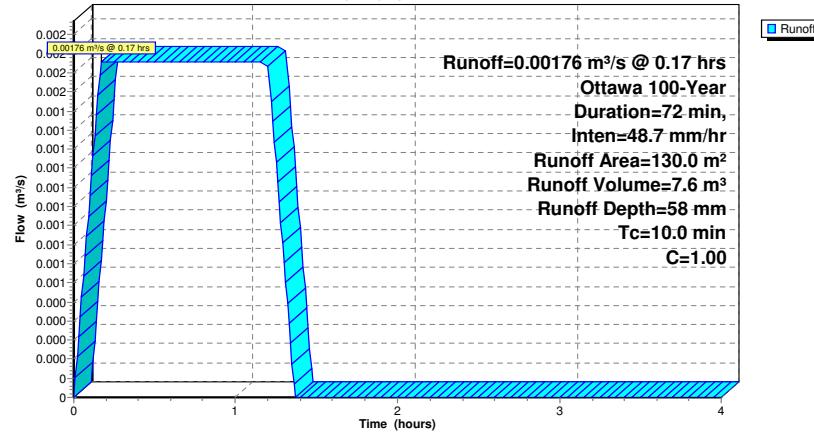
Printed 2022-02-17

Page 9

Summary for Subcatchment B-102: B-102Runoff = 0.00176 m³/s @ 0.17 hrs, Volume= 7.6 m³, Depth= 58 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description
130.0	1.00	
130.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-102: B-102**Hydrograph****20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

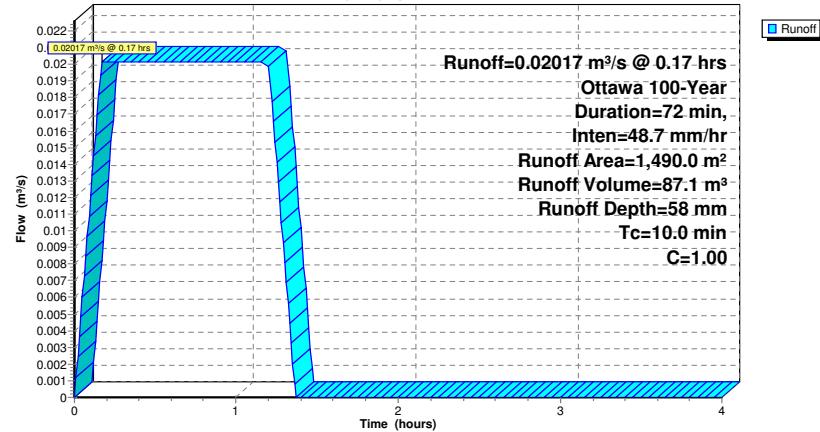
Printed 2022-02-17

Page 10

Summary for Subcatchment B-BLDG1: RoofRunoff = 0.02017 m³/s @ 0.17 hrs, Volume= 87.1 m³, Depth= 58 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m ²)	C	Description
1,490.0	1.00	
1,490.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG1: Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

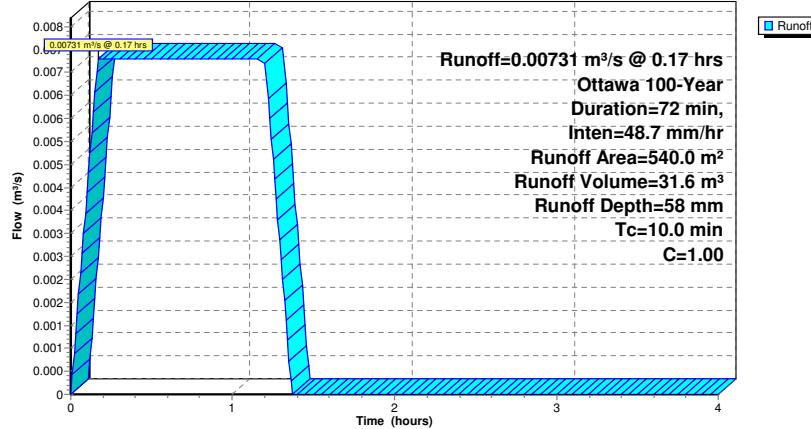
Printed 2022-02-17
Page 11**Summary for Subcatchment B-BLDG2: Roof**

Runoff = 0.00731 m³/s @ 0.17 hrs, Volume= 31.6 m³, Depth= 58 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Area (m²)	C	Description
540.0	1.00	
540.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG2: Roof**Hydrograph****20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 12**Summary for Pond 10P: Bldg1 Roof**

Inflow Area = 1,490.0 m², 100.00% Impervious, Inflow Depth = 58 mm for 100-Year event
 Inflow = 0.02017 m³/s @ 0.17 hrs, Volume= 87.1 m³
 Outflow = 0.01205 m³/s @ 1.27 hrs, Volume= 87.1 m³, Atten= 40%, Lag= 65.8 min
 Primary = 0.01205 m³/s @ 1.27 hrs, Volume= 87.1 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Peak Elev= 100.143 m @ 1.27 hrs Surf.Area= 861.9 m² Storage= 41.2 m³Plug-Flow detention time= 35.1 min calculated for 86.9 m³ (100% of inflow)
Center-of-Mass det. time= 35.2 min (76.2 - 41.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152			
Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950			
0.001100 0.001260			

Primary OutFlow Max=0.01205 m³/s @ 1.27 hrs HW=100.143 m (Free Discharge)

↑=WATTS Accutrol_5-0.5 (Custom Controls 0.01205 m³/s)

20220217_TeronRd

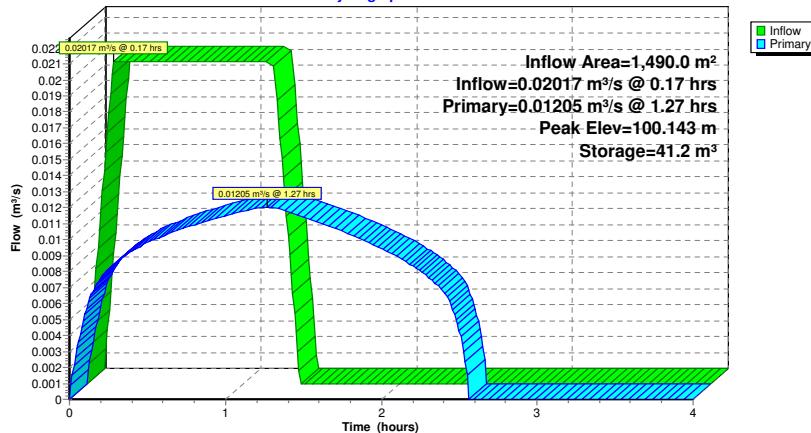
Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 14

Pond 10P: Bldg1 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 15

Summary for Pond 11P: Bldg2 Roof

Inflow Area = 540.0 m², 100.00% Impervious, Inflow Depth = 58 mm for 100-Year event
 Inflow = 0.00731 m³/s @ 0.17 hrs, Volume= 31.6 m³
 Outflow = 0.00519 m³/s @ 1.25 hrs, Volume= 31.6 m³, Atten= 29%, Lag= 64.7 min
 Primary = 0.00519 m³/s @ 1.25 hrs, Volume= 31.6 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.125 m @ 1.25 hrs Surf.Area= 313.6 m² Storage= 10.3 m³

Plug-Flow detention time= 19.2 min calculated for 31.5 m³ (100% of inflow)
 Center-of-Mass det. time= 19.3 min (60.3 - 41.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

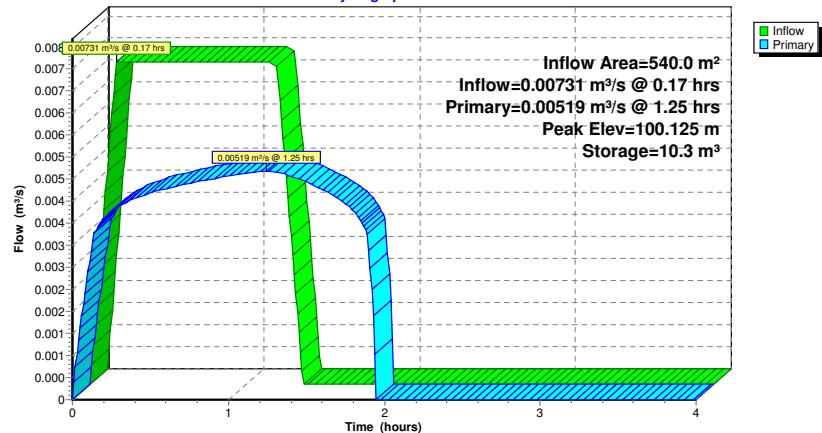
Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 16

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00
			Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152
			Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790
			0.000870 0.000950

Primary OutFlow Max=0.00519 m³/s @ 1.25 hrs HW=100.125 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00519 m³/s)

Pond 11P: Bldg2 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 17**Summary for Pond B1: Bioswale 1**

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 55 mm for 100-Year event
 Inflow = 0.02393 m³/s @ 0.17 hrs, Volume= 103.4 m³
 Outflow = 0.00914 m³/s @ 1.30 hrs, Volume= 64.7 m³, Atten= 62%, Lag= 68.0 min
 Primary = 0.00914 m³/s @ 1.30 hrs, Volume= 64.7 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.915 m @ 1.30 hrs Surf.Area= 0.0 m² Storage= 79.3 m³

Plug-Flow detention time= 68.8 min calculated for 64.6 m³ (62% of inflow)
 Center-of-Mass det. time= 55.4 min (96.4 - 41.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.611 m	HYDROVEX 100-VHV-1 X 0.78 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

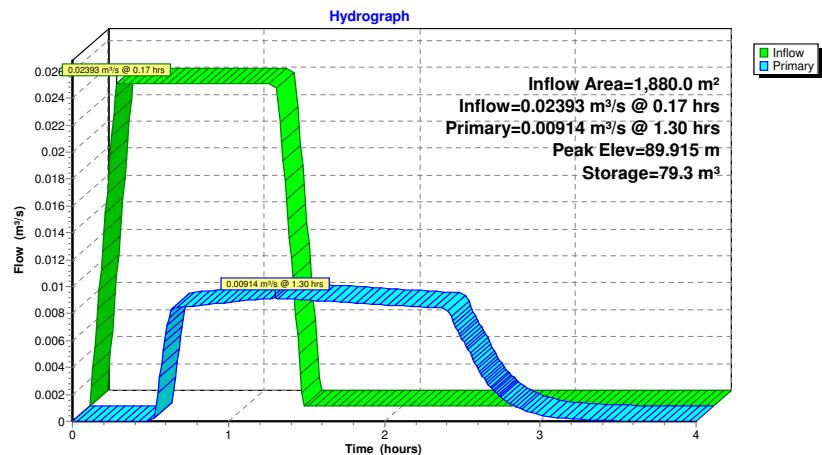
Primary OutFlow Max=0.00914 m³/s @ 1.30 hrs HW=89.915 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00914 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.00914 m³/s of 0.19809 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 18**Pond B1: Bioswale 1**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 19

Summary for Pond B2: Bioswale 2

Inflow Area = 1,220.0 m², 100.00% Impervious, Inflow Depth = 57 mm for 100-Year event
 Inflow = 0.01602 m³/s @ 0.17 hrs, Volume= 69.2 m³
 Outflow = 0.00981 m³/s @ 1.26 hrs, Volume= 43.1 m³, Atten= 39%, Lag= 65.7 min
 Primary = 0.00981 m³/s @ 1.26 hrs, Volume= 43.1 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.902 m @ 1.26 hrs Surf.Area= 0.0 m² Storage= 43.9 m³

Plug-Flow detention time= 45.3 min calculated for 43.1 m³ (62% of inflow)
 Center-of-Mass det. time= 31.5 min (72.5 - 41.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000
#2	Primary	88.537 m	HYDROVEX 100-VHV-1 X 0.82 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00981 m³/s @ 1.26 hrs HW=89.902 m (Free Discharge)

↑=HYDROVEX 100-VHV-1 (Custom Controls 0.00981 m³/s)

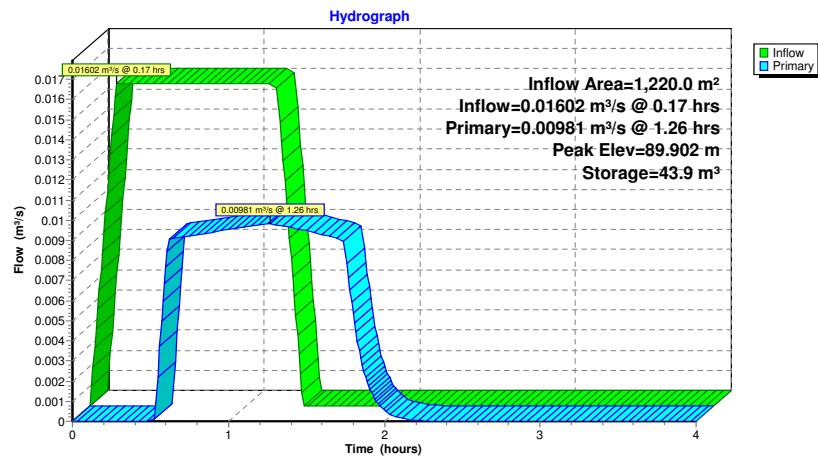
↑=Single OPSD 400.01 (Passes 0.00981 m³/s of 0.19278 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17

Page 20

Pond B2: Bioswale 2

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 21**Summary for Pond B3: Bioswale 3**

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 54 mm for 100-Year event
 Inflow = 0.02216 m³/s @ 0.17 hrs, Volume= 95.7 m³
 Outflow = 0.01783 m³/s @ 1.23 hrs, Volume= 60.2 m³, Atten= 20%, Lag= 63.8 min
 Primary = 0.01783 m³/s @ 1.23 hrs, Volume= 60.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.850 m @ 1.23 hrs Surf.Area= 0.0 m² Storage= 50.3 m³

Plug-Flow detention time= 36.2 min calculated for 60.2 m³ (63% of inflow)
 Center-of-Mass det. time= 22.6 min (63.6 - 41.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.489 m	HYDROVEX 125-VHV-2 X 0.82 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

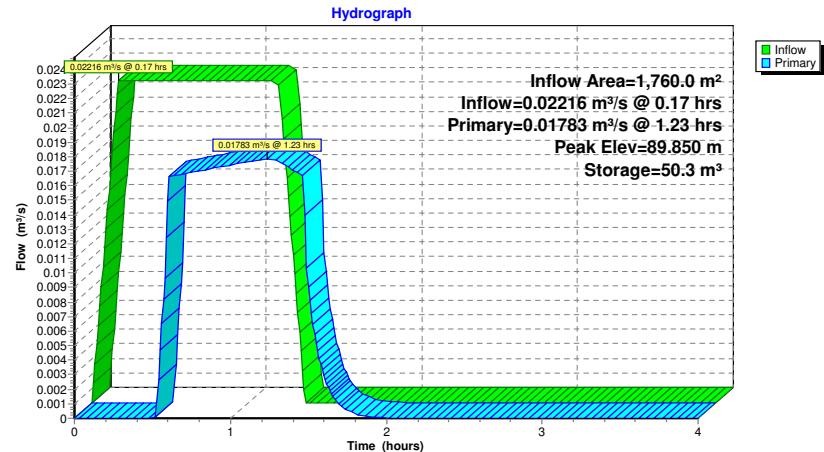
Primary OutFlow Max=0.01783 m³/s @ 1.23 hrs HW=89.850 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Custom Controls 0.01783 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.01783 m³/s of 0.17181 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Printed 2022-02-17
Page 22**Pond B3: Bioswale 3**

20220217_TeronRd

Ottawa 100-Year Duration=72 min, Inten=48.7 mm/hr

Prepared by WSP Canada inc.

Printed 2022-02-17

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Page 23

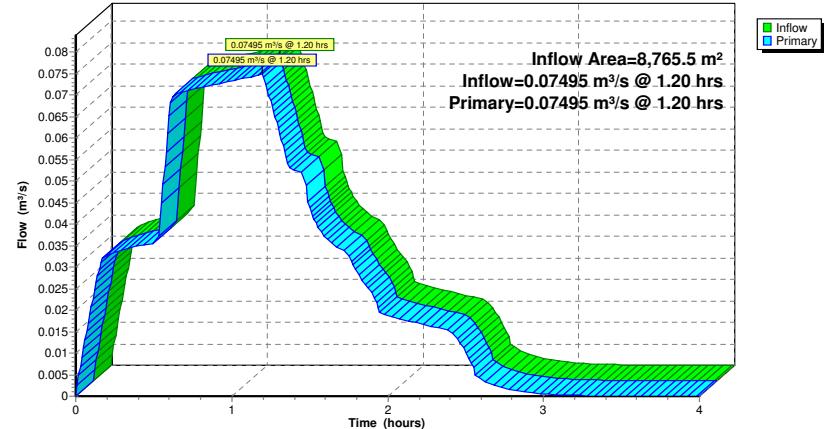
Summary for Link 2L: Ditch

Inflow Area = 8,765.5 m², 38.56% Impervious, Inflow Depth = 43 mm for 100-Year event
Inflow = 0.07495 m³/s @ 1.20 hrs, Volume= 377.5 m³
Primary = 0.07495 m³/s @ 1.20 hrs, Volume= 377.5 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 2L: Ditch

Hydrograph

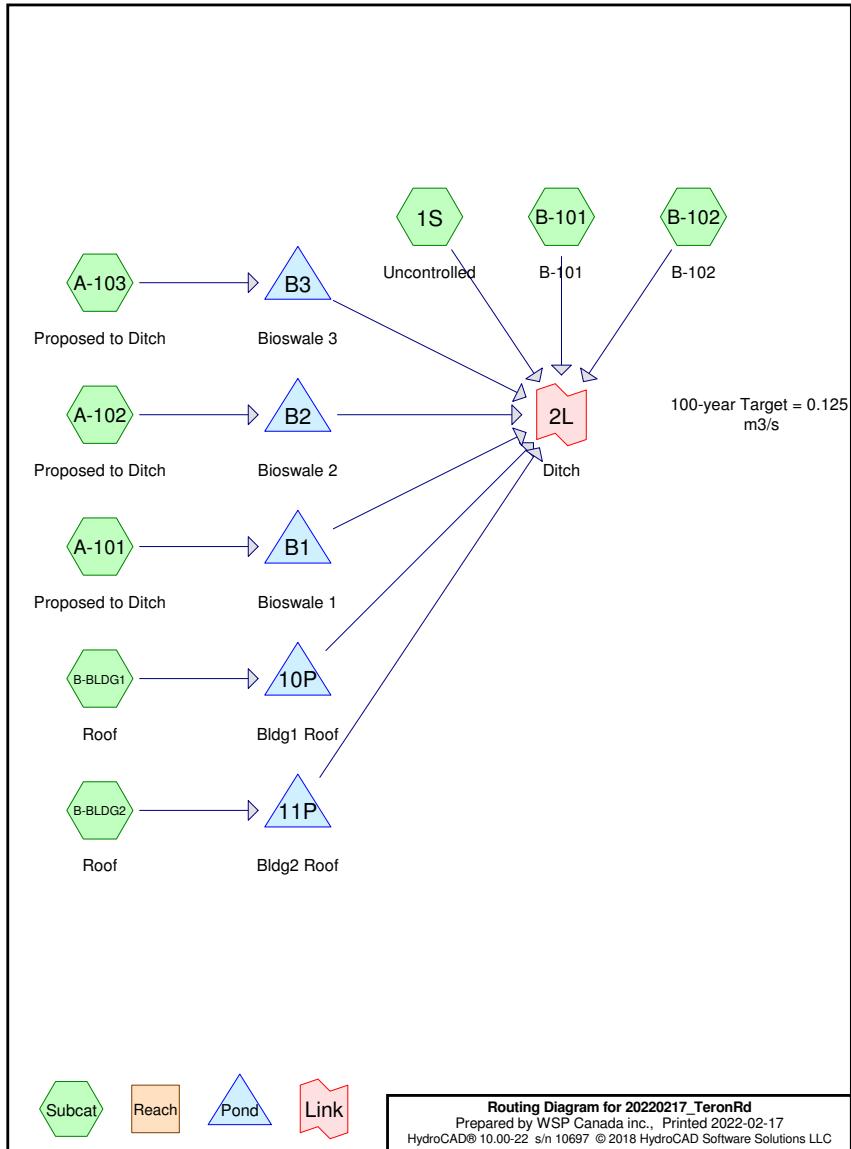


APPENDIX

C-4

100-Year Analysis (Peak Storage Bioswale 2, $T_c = 48$ min)

The storm system for the site is governed by the 100-year storm. Peak storage in each storage unit and peak discharge may occur at separate times of concentration and are therefore reported separately



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
135.5	0.87	(1S)
1,880.0	0.94	(A-101)
1,220.0	0.97	(A-102)
1,760.0	0.93	(A-103)
1,610.0	0.81	(B-101)
2,160.0	1.00	(B-102, B-BLDG1, B-BLDG2)
8,765.5	0.93	TOTAL AREA

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 3Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

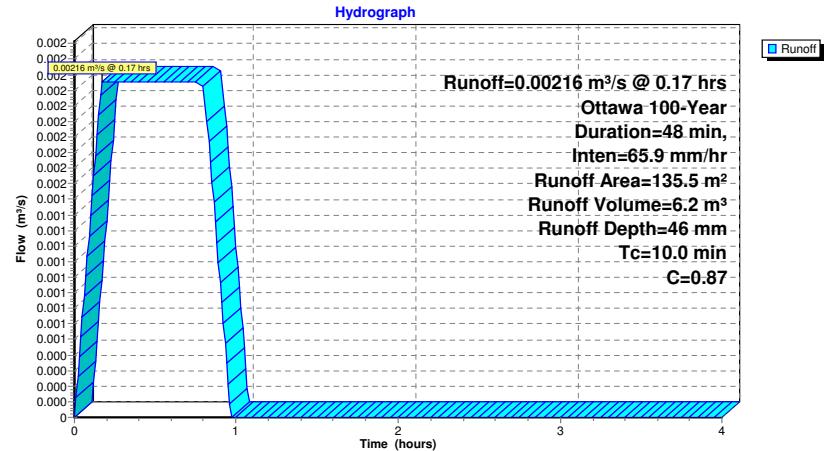
Subcatchment 1S: UncontrolledRunoff Area=135.5 m² 0.00% Impervious Runoff Depth=46 mm
Tc=10.0 min C=0.87 Runoff=0.00216 m³/s 6.2 m³**Subcatchment A-101: Proposed to Ditch** Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=50 mm
Tc=10.0 min C=0.94 Runoff=0.03234 m³/s 93.2 m³**Subcatchment A-102: Proposed to** Runoff Area=1,220.0 m² 100.00% Impervious Runoff Depth=51 mm
Tc=10.0 min C=0.97 Runoff=0.02166 m³/s 62.4 m³**Subcatchment A-103: Proposed to Ditch** Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=0.93 Runoff=0.02996 m³/s 86.3 m³**Subcatchment B-101: B-101** Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=43 mm
Tc=10.0 min C=0.81 Runoff=0.02387 m³/s 68.7 m³**Subcatchment B-102: B-102** Runoff Area=130.0 m² 100.00% Impervious Runoff Depth=53 mm
Tc=10.0 min C=1.00 Runoff=0.00238 m³/s 6.9 m³**Subcatchment B-BLDG1: Roof** Runoff Area=1,490.0 m² 100.00% Impervious Runoff Depth=53 mm
Tc=10.0 min C=1.00 Runoff=0.02727 m³/s 78.5 m³**Subcatchment B-BLDG2: Roof** Runoff Area=540.0 m² 100.00% Impervious Runoff Depth=53 mm
Tc=10.0 min C=1.00 Runoff=0.00988 m³/s 28.5 m³**Pond 10P: Bldg1 Roof** Peak Elev=100.149 m Storage=45.9 m³ Inflow=0.02727 m³/s 78.5 m³
Outflow=0.01239 m³/s 78.5 m³**Pond 11P: Bldg2 Roof** Peak Elev=100.134 m Storage=13.3 m³ Inflow=0.00988 m³/s 28.5 m³
Outflow=0.00535 m³/s 28.5 m³**Pond B1: Bioswale 1** Peak Elev=89.901 m Storage=77.4 m³ Inflow=0.03234 m³/s 93.2 m³
Outflow=0.00910 m³/s 54.5 m³**Pond B2: Bioswale 2** Peak Elev=89.931 m Storage=45.7 m³ Inflow=0.02166 m³/s 62.4 m³
Outflow=0.00990 m³/s 36.2 m³**Pond B3: Bioswale 3** Peak Elev=89.938 m Storage=56.0 m³ Inflow=0.02996 m³/s 86.3 m³
Outflow=0.01849 m³/s 50.8 m³**Link 2L: Ditch** Inflow=0.08321 m³/s 330.3 m³
Primary=0.08321 m³/s 330.3 m³Total Runoff Area = 8,765.5 m² Runoff Volume = 430.6 m³ Average Runoff Depth = 49 mm
61.44% Pervious = 5,385.5 m² 38.56% Impervious = 3,380.0 m²**20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 4**Summary for Subcatchment 1S: Uncontrolled**Runoff = 0.00216 m³/s @ 0.17 hrs, Volume= 6.2 m³, Depth= 46 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
135.5	0.87	
135.5		100.00% Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment 1S: Uncontrolled

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 5

Summary for Subcatchment A-101: Proposed to Ditch

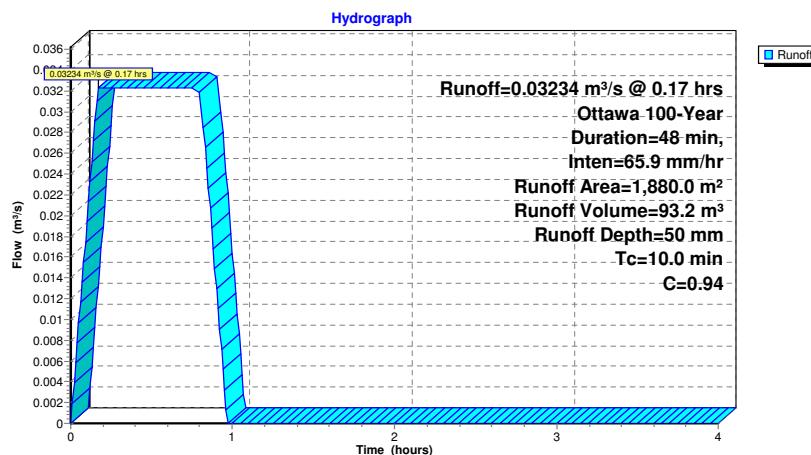
Runoff = 0.03234 m³/s @ 0.17 hrs, Volume= 93.2 m³, Depth= 50 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
1,880.0	0.94	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-101: Proposed to Ditch



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 6

Summary for Subcatchment A-102: Proposed to Ditch

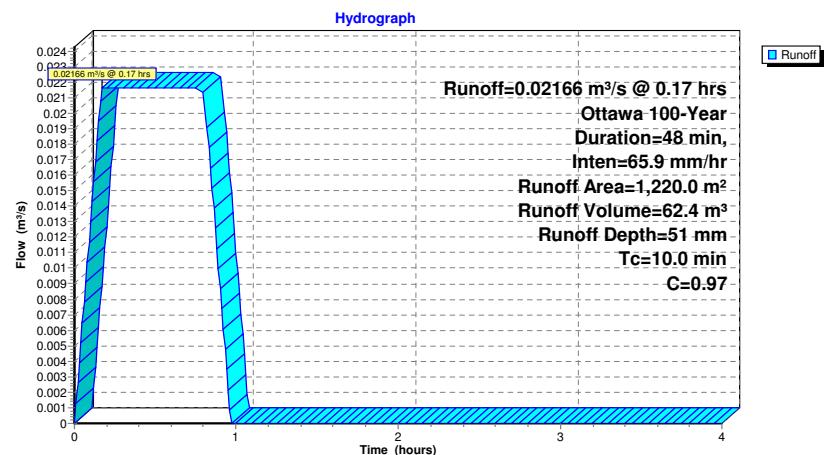
Runoff = 0.02166 m³/s @ 0.17 hrs, Volume= 62.4 m³, Depth= 51 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
1,220.0	0.97	
1,220.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-102: Proposed to Ditch



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

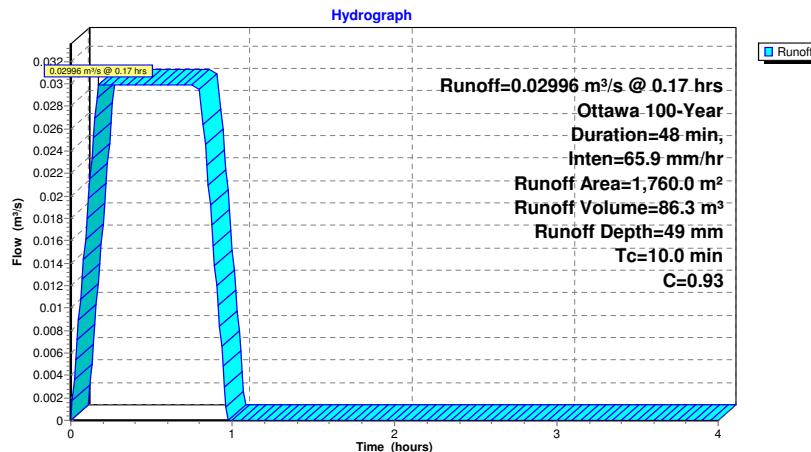
Printed 2022-02-17

Page 7

Summary for Subcatchment A-103: Proposed to DitchRunoff = 0.02996 m³/s @ 0.17 hrs, Volume= 86.3 m³, Depth= 49 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
1,760.0	0.93	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-103: Proposed to Ditch**20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

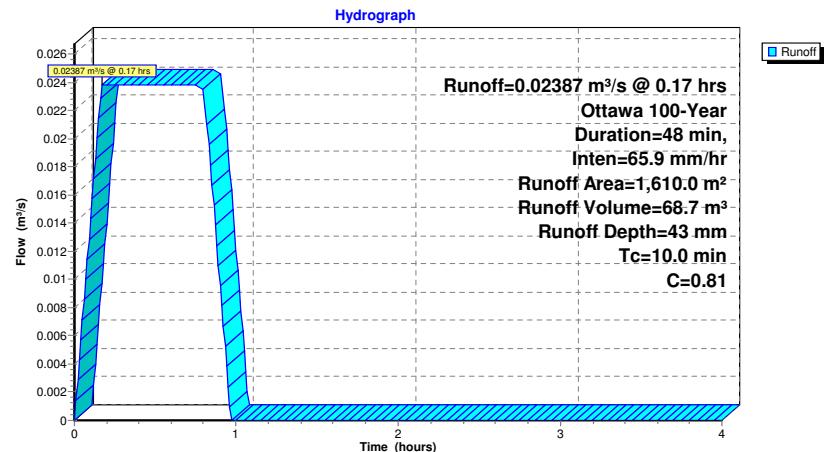
Printed 2022-02-17

Page 8

Summary for Subcatchment B-101: B-101Runoff = 0.02387 m³/s @ 0.17 hrs, Volume= 68.7 m³, Depth= 43 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
1,610.0	0.81	
1,610.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-101: B-101

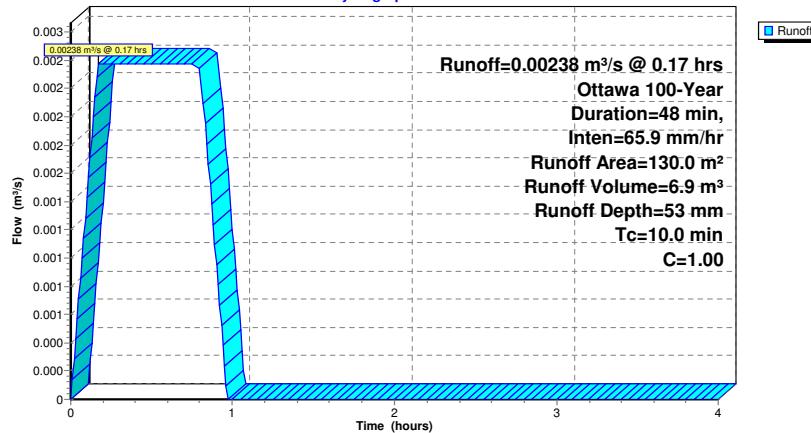
20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 9**Summary for Subcatchment B-102: B-102**Runoff = 0.00238 m³/s @ 0.17 hrs, Volume= 6.9 m³, Depth= 53 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
130.0	1.00	
130.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

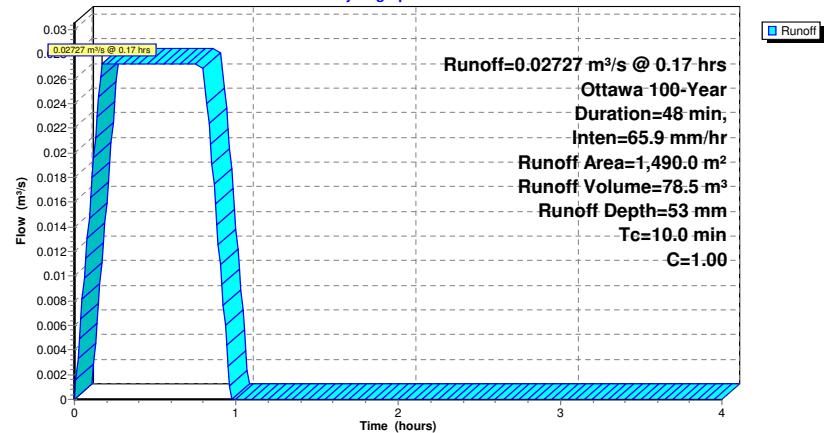
Subcatchment B-102: B-102**Hydrograph****20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 10**Summary for Subcatchment B-BLDG1: Roof**Runoff = 0.02727 m³/s @ 0.17 hrs, Volume= 78.5 m³, Depth= 53 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m ²)	C	Description
1,490.0	1.00	
1,490.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG1: Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

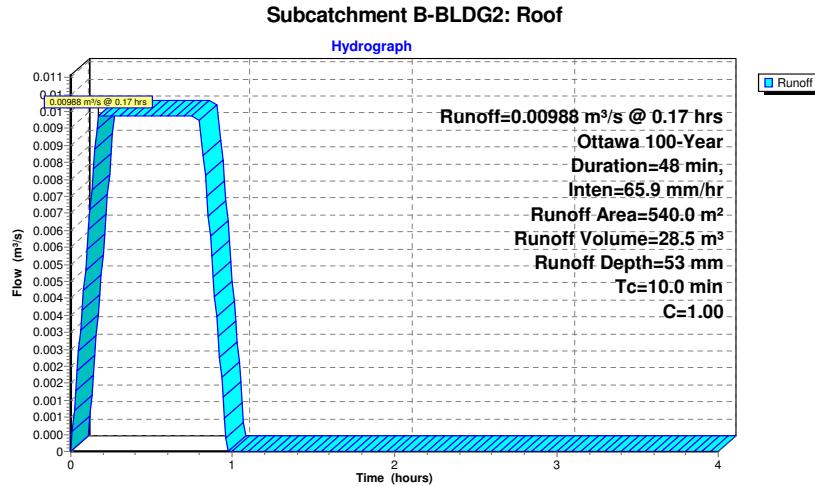
Page 11

Summary for Subcatchment B-BLDG2: Roof

Runoff = 0.00988 m³/s @ 0.17 hrs, Volume= 28.5 m³, Depth= 53 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Area (m²)	C	Description			
540.0	1.00				
540.0		100.00% Impervious Area			
<hr/>					
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

**20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 12

Summary for Pond 10P: Bldg1 Roof

Inflow Area = 1,490.0 m², 100.00% Impervious, Inflow Depth = 53 mm for 100-Year event

Inflow = 0.02727 m³/s @ 0.17 hrs, Volume= 78.5 m³

Outflow = 0.01239 m³/s @ 0.89 hrs, Volume= 78.5 m³, Atten= 55%, Lag= 43.3 min

Primary = 0.01239 m³/s @ 0.89 hrs, Volume= 78.5 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Peak Elev= 100.149 m @ 0.89 hrs Surf.Area= 926.3 m² Storage= 45.9 m³Plug-Flow detention time= 37.2 min calculated for 78.3 m³ (100% of inflow)
Center-of-Mass det. time= 37.3 min (66.4 - 29.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152			
Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950			
0.001100 0.001260			

Primary OutFlow Max=0.01239 m³/s @ 0.89 hrs HW=100.149 m (Free Discharge)

↑=WATTS Accutrol_5-0.5 (Custom Controls 0.01239 m³/s)

20220217_TeronRd

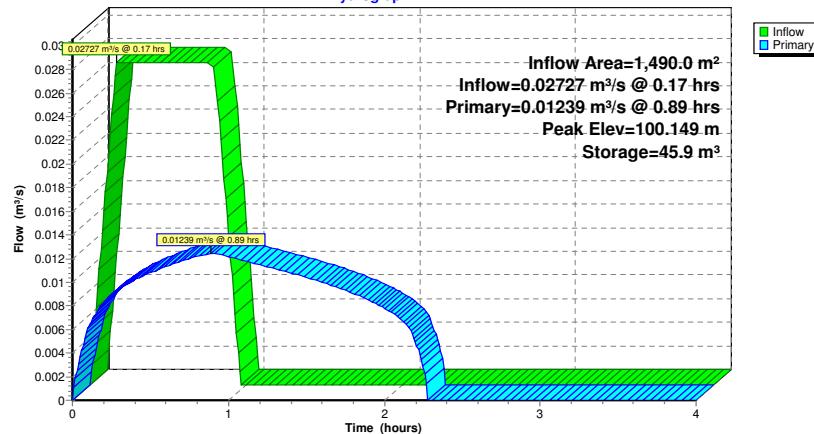
Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 14

Pond 10P: Bldg1 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 15

Summary for Pond 11P: Bldg2 Roof

Inflow Area = 540.0 m², 100.00% Impervious, Inflow Depth = 53 mm for 100-Year event
 Inflow = 0.00988 m³/s @ 0.17 hrs, Volume= 28.5 m³
 Outflow = 0.00535 m³/s @ 0.88 hrs, Volume= 28.5 m³, Atten= 46%, Lag= 42.4 min
 Primary = 0.00535 m³/s @ 0.88 hrs, Volume= 28.5 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.134 m @ 0.88 hrs Surf.Area= 376.9 m² Storage= 13.3 m³

Plug-Flow detention time= 23.3 min calculated for 28.4 m³ (100% of inflow)
 Center-of-Mass det. time= 23.4 min (52.4 - 29.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

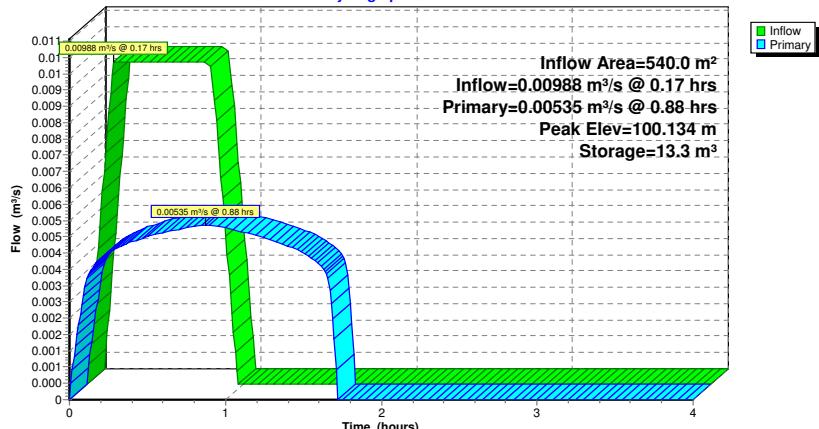
20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 16

Device	Routing	Invert	Outlet Devices
#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00 Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152 Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790 0.000870 0.000950

Primary OutFlow Max=0.00535 m³/s @ 0.88 hrs HW=100.134 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00535 m³/s)

Pond 11P: Bldg2 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLCOttawa 100-Year Duration=48 min, Inten=65.9 mm/hr
Printed 2022-02-17
Page 17**Summary for Pond B1: Bioswale 1**

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 50 mm for 100-Year event
 Inflow = 0.03234 m³/s @ 0.17 hrs, Volume= 93.2 m³
 Outflow = 0.00910 m³/s @ 0.92 hrs, Volume= 54.5 m³, Atten= 72%, Lag= 45.0 min
 Primary = 0.00910 m³/s @ 0.92 hrs, Volume= 54.5 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.901 m @ 0.92 hrs Surf.Area= 0.0 m² Storage= 77.4 m³

Plug-Flow detention time= 60.0 min calculated for 54.4 m³ (58% of inflow)
 Center-of-Mass det. time= 50.1 min (79.1 - 29.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.611 m	HYDROVEX 100-VHV-1 X 0.78 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00910 m³/s @ 0.92 hrs HW=89.901 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00910 m³/s)

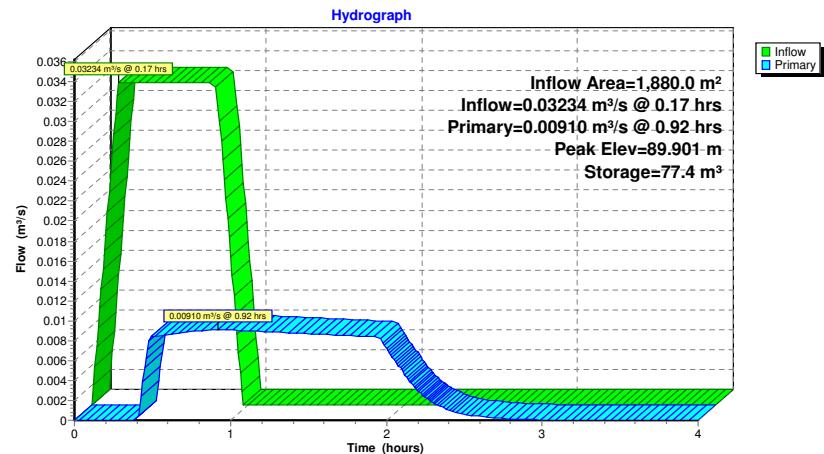
↑ 1=Single OPSD 400.01 (Passes 0.00910 m³/s of 0.19256 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17

Page 18

Pond B1: Bioswale 1

20220217_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 19

Summary for Pond B2: Bioswale 2

Inflow Area = 1,220.0 m², 100.00% Impervious, Inflow Depth = 51 mm for 100-Year event
 Inflow = 0.02166 m³/s @ 0.17 hrs, Volume= 62.4 m³
 Outflow = 0.00990 m³/s @ 0.89 hrs, Volume= 36.2 m³, Atten= 54%, Lag= 43.2 min
 Primary = 0.00990 m³/s @ 0.89 hrs, Volume= 36.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.931 m @ 0.89 hrs Surf.Area= 0.0 m² Storage= 45.7 m³

Plug-Flow detention time= 39.6 min calculated for 36.1 m³ (58% of inflow)
 Center-of-Mass det. time= 29.5 min (58.5 - 29.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000
#2	Primary	88.537 m	HYDROVEX 100-VHV-1 X 0.82 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00990 m³/s @ 0.89 hrs HW=89.931 m (Free Discharge)

↑=HYDROVEX 100-VHV-1 (Custom Controls 0.00990 m³/s)

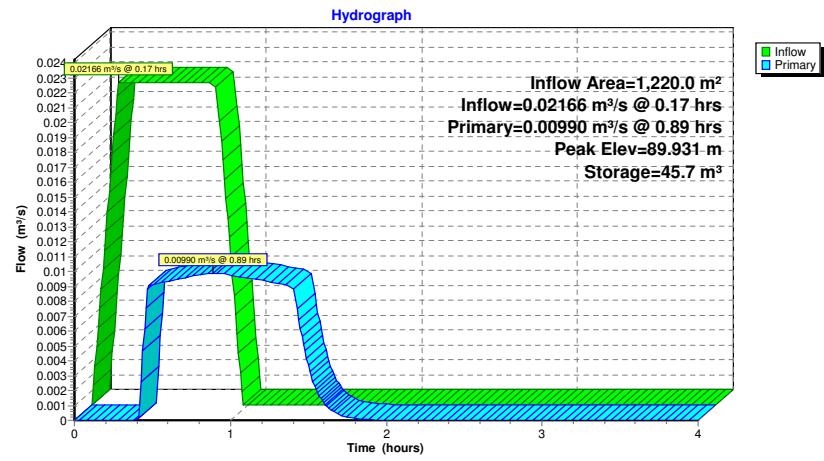
↑=Single OPSD 400.01 (Passes 0.00990 m³/s of 0.20000 m³/s potential flow)

20220217_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 20

Pond B2: Bioswale 2

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 21**Summary for Pond B3: Bioswale 3**

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 49 mm for 100-Year event
 Inflow = 0.02996 m³/s @ 0.17 hrs, Volume= 86.3 m³
 Outflow = 0.01849 m³/s @ 0.86 hrs, Volume= 50.8 m³, Atten= 38%, Lag= 41.6 min
 Primary = 0.01849 m³/s @ 0.86 hrs, Volume= 50.8 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.938 m @ 0.86 hrs Surf.Area= 0.0 m² Storage= 56.0 m³

Plug-Flow detention time= 31.7 min calculated for 50.6 m³ (59% of inflow)
 Center-of-Mass det. time= 21.7 min (50.8 - 29.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.489 m	HYDROVEX 125-VHV-2 X 0.82 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

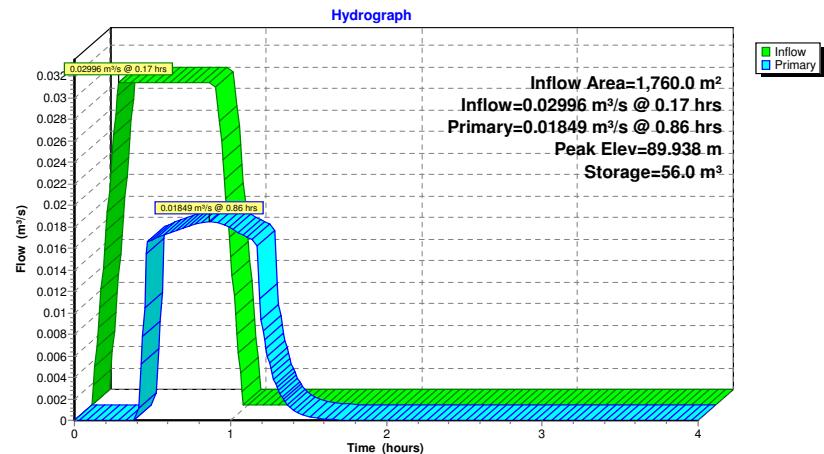
Primary OutFlow Max=0.01849 m³/s @ 0.86 hrs HW=89.938 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Custom Controls 0.01849 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.01849 m³/s of 0.20732 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Printed 2022-02-17
Page 22**Pond B3: Bioswale 3**

20220217_TeronRd

Ottawa 100-Year Duration=48 min, Inten=65.9 mm/hr

Prepared by WSP Canada inc.

Printed 2022-02-17

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Page 23

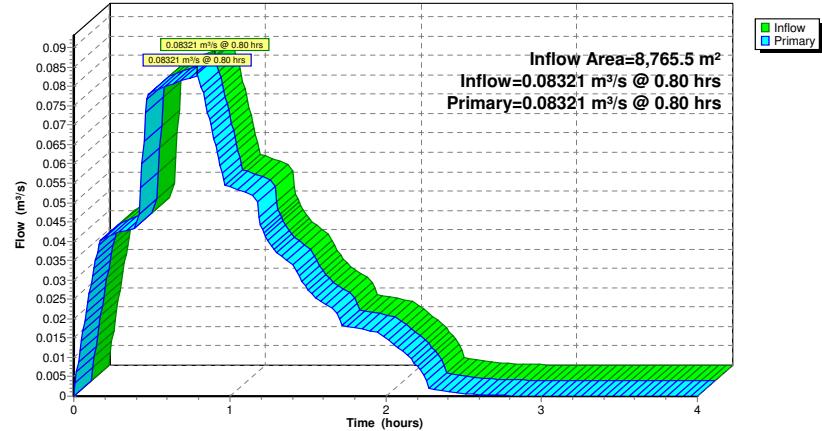
Summary for Link 2L: Ditch

Inflow Area = 8,765.5 m², 38.56% Impervious, Inflow Depth = 38 mm for 100-Year event
Inflow = 0.08321 m³/s @ 0.80 hrs, Volume= 330.3 m³
Primary = 0.08321 m³/s @ 0.80 hrs, Volume= 330.3 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 2L: Ditch

Hydrograph

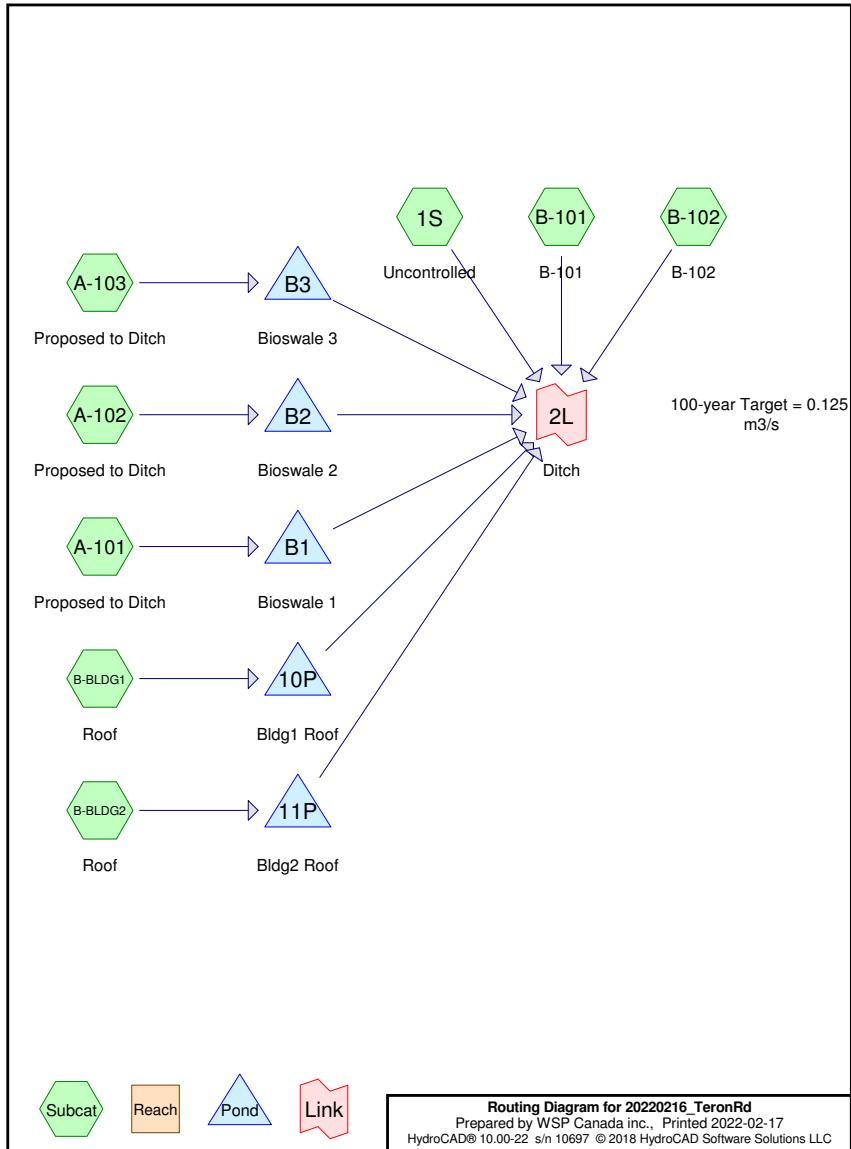


APPENDIX

C-5

100-Year Analysis (Peak Storage Bioswale 3, $T_c = 36$ min)

The storm system for the site is governed by the 100-year storm. Peak storage in each storage unit and peak discharge may occur at separate times of concentration and are therefore reported separately



20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
135.5	0.87	(1S)
1,880.0	0.94	(A-101)
1,220.0	0.97	(A-102)
1,760.0	0.93	(A-103)
1,610.0	0.81	(B-101)
2,160.0	1.00	(B-102, B-BLDG1, B-BLDG2)
8,765.5	0.93	TOTAL AREA

20220216_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 3

Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Uncontrolled

Runoff Area=135.5 m² 0.00% Impervious Runoff Depth=42 mm
Tc=10.0 min C=0.87 Runoff=0.00265 m³/s 5.7 m³

Subcatchment A-101: Proposed to Ditch Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=46 mm
Tc=10.0 min C=0.94 Runoff=0.03974 m³/s 85.8 m³

Subcatchment A-102: Proposed to Runoff Area=1,220.0 m² 100.00% Impervious Runoff Depth=47 mm
Tc=10.0 min C=0.97 Runoff=0.02661 m³/s 57.5 m³

Subcatchment A-103: Proposed to Ditch Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=45 mm
Tc=10.0 min C=0.93 Runoff=0.03681 m³/s 79.5 m³

Subcatchment B-101: B-101 Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=39 mm
Tc=10.0 min C=0.81 Runoff=0.02933 m³/s 63.4 m³

Subcatchment B-102: B-102 Runoff Area=130.0 m² 100.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=1.00 Runoff=0.00292 m³/s 6.3 m³

Subcatchment B-BLDG1: Roof Runoff Area=1,490.0 m² 100.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=1.00 Runoff=0.03351 m³/s 72.4 m³

Subcatchment B-BLDG2: Roof Runoff Area=540.0 m² 100.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=1.00 Runoff=0.01214 m³/s 26.2 m³

Pond 10P: Bldg1 Roof Peak Elev=100.150 m Storage=46.7 m³ Inflow=0.03351 m³/s 72.4 m³
Outflow=0.01245 m³/s 72.4 m³

Pond 11P: Bldg2 Roof Peak Elev=100.136 m Storage=14.2 m³ Inflow=0.01214 m³/s 26.2 m³
Outflow=0.00540 m³/s 26.2 m³

Pond B1: Bioswale 1 Peak Elev=89.878 m Storage=74.2 m³ Inflow=0.03974 m³/s 85.8 m³
Outflow=0.00897 m³/s 47.2 m³

Pond B2: Bioswale 2 Peak Elev=89.921 m Storage=45.1 m³ Inflow=0.02661 m³/s 57.5 m³
Outflow=0.00988 m³/s 31.3 m³

Pond B3: Bioswale 3 Peak Elev=89.952 m Storage=56.9 m³ Inflow=0.03681 m³/s 79.5 m³
Outflow=0.01876 m³/s 44.0 m³

Link 2L: Ditch Inflow=0.08953 m³/s 296.5 m³
Primary=0.08953 m³/s 296.5 m³

Total Runoff Area = 8,765.5 m² Runoff Volume = 396.9 m³ Average Runoff Depth = 45 mm
61.44% Pervious = 5,385.5 m² 38.56% Impervious = 3,380.0 m²

20220216_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

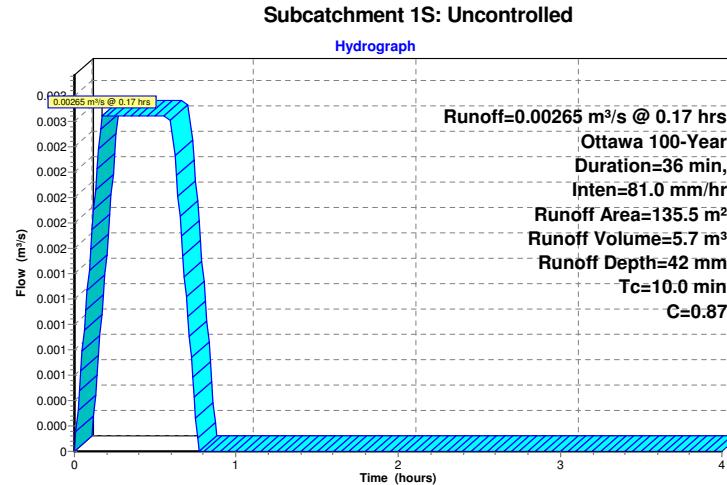
Printed 2022-02-17
Page 4

Summary for Subcatchment 1S: Uncontrolled

Runoff = 0.00265 m³/s @ 0.17 hrs, Volume= 5.7 m³, Depth= 42 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m ²)	C	Description			
135.5	0.87				
135.5		100.00% Pervious Area			
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,



20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 5

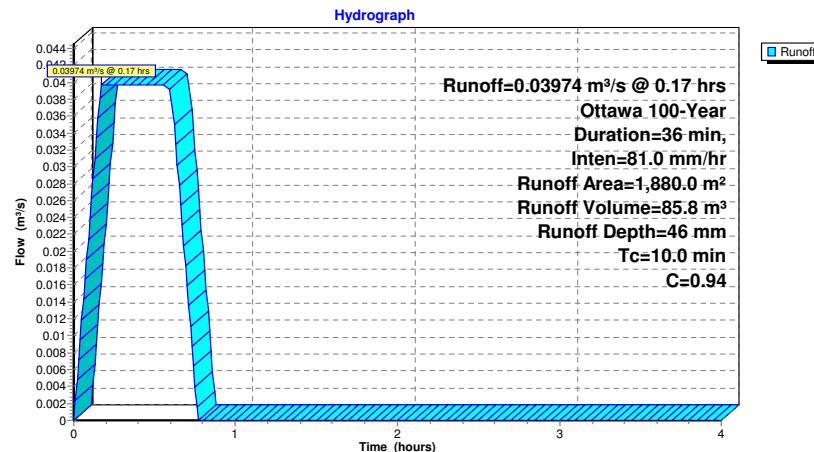
Summary for Subcatchment A-101: Proposed to Ditch

Runoff = 0.03974 m³/s @ 0.17 hrs, Volume= 85.8 m³, Depth= 46 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,880.0	0.94	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-101: Proposed to Ditch**20220216_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 6

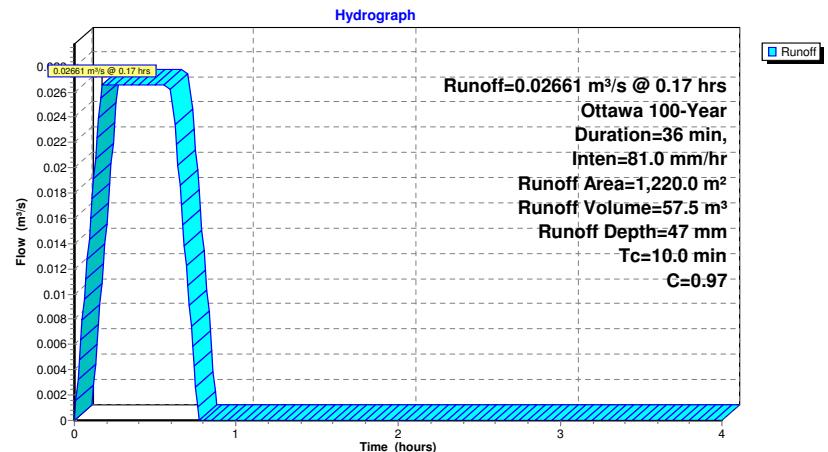
Summary for Subcatchment A-102: Proposed to Ditch

Runoff = 0.02661 m³/s @ 0.17 hrs, Volume= 57.5 m³, Depth= 47 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,220.0	0.97	
1,220.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-102: Proposed to Ditch

20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 7

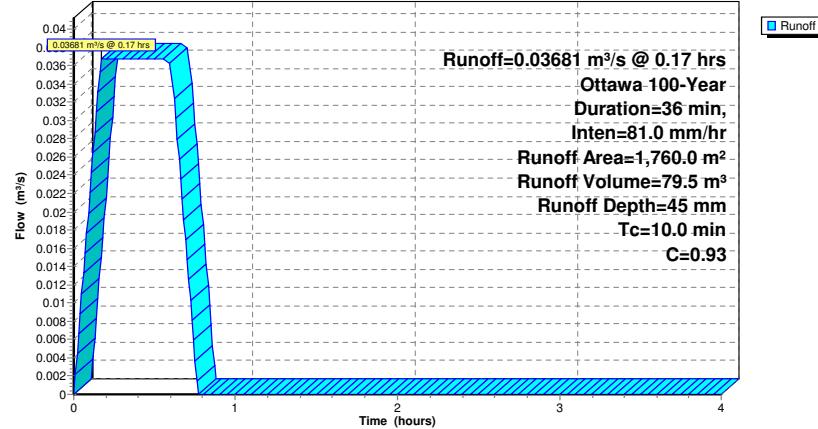
Summary for Subcatchment A-103: Proposed to Ditch

Runoff = 0.03681 m³/s @ 0.17 hrs, Volume= 79.5 m³, Depth= 45 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,760.0	0.93	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-103: Proposed to Ditch**Hydrograph****20220216_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 8

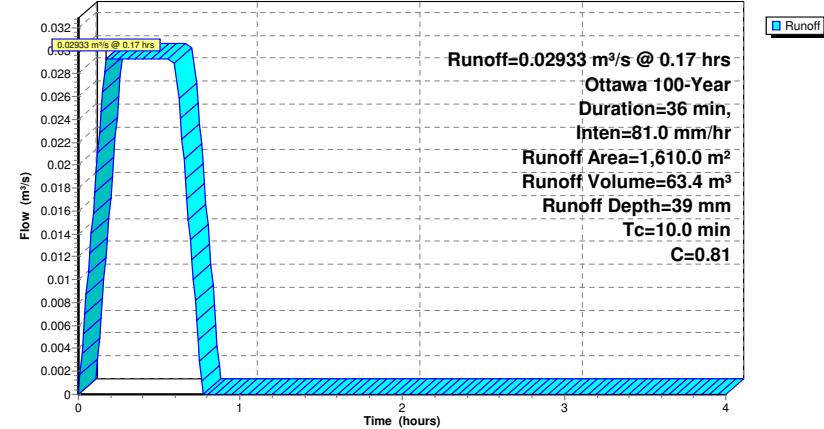
Summary for Subcatchment B-101: B-101

Runoff = 0.02933 m³/s @ 0.17 hrs, Volume= 63.4 m³, Depth= 39 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,610.0	0.81	
1,610.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-101: B-101**Hydrograph**

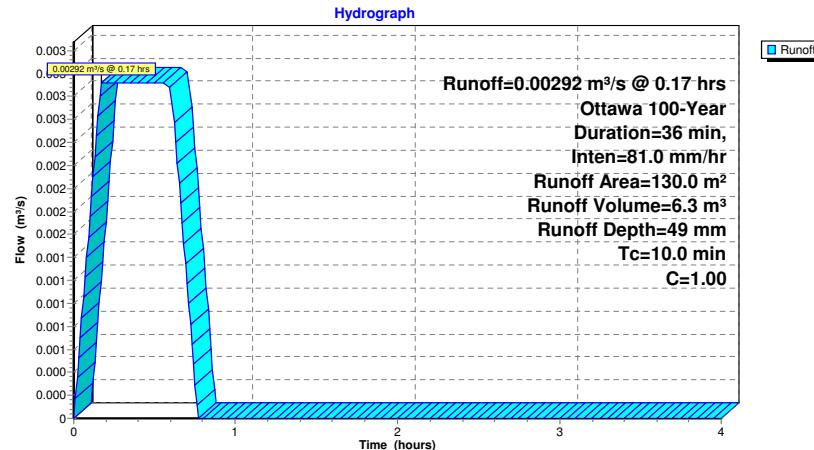
20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 9**Summary for Subcatchment B-102: B-102**Runoff = 0.00292 m³/s @ 0.17 hrs, Volume= 6.3 m³, Depth= 49 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m ²)	C	Description
130.0	1.00	
130.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

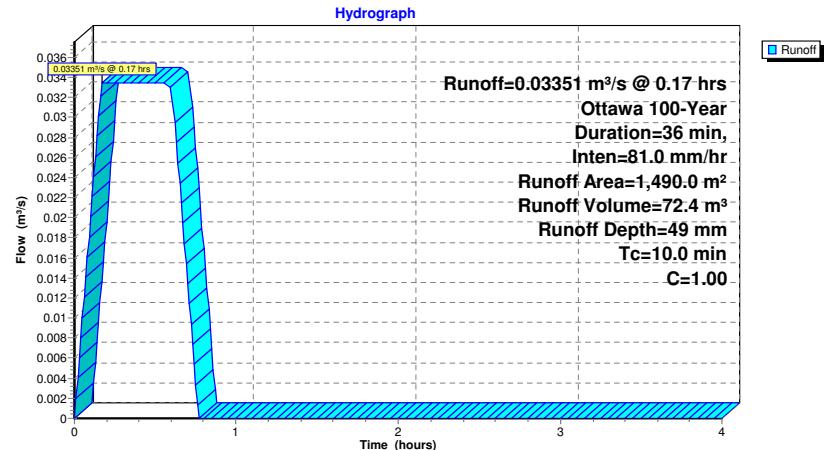
Subcatchment B-102: B-102**20220216_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 10**Summary for Subcatchment B-BLDG1: Roof**Runoff = 0.03351 m³/s @ 0.17 hrs, Volume= 72.4 m³, Depth= 49 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m ²)	C	Description
1,490.0	1.00	
1,490.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG1: Roof

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

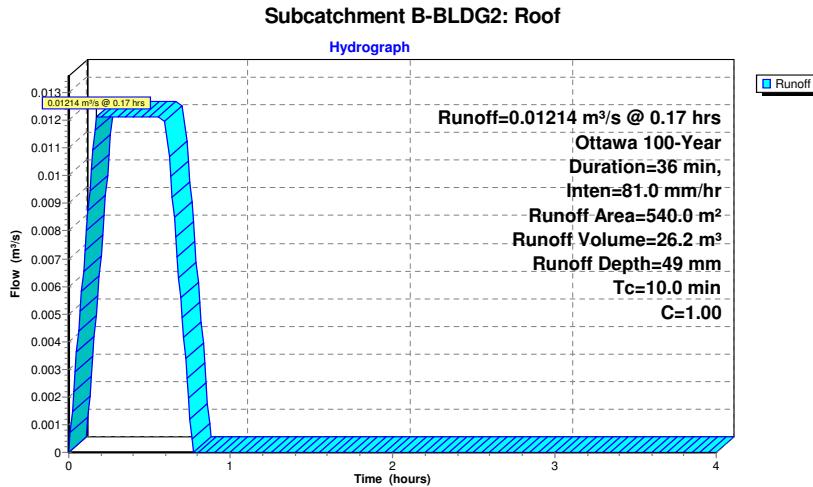
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 11**Summary for Subcatchment B-BLDG2: Roof**

Runoff = 0.01214 m³/s @ 0.17 hrs, Volume= 26.2 m³, Depth= 49 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description			
540.0	1.00				
540.0		100.00% Impervious Area			
<hr/>					
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

**20220216_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 12**Summary for Pond 10P: Bldg1 Roof**

Inflow Area = 1,490.0 m², 100.00% Impervious, Inflow Depth = 49 mm for 100-Year event

Inflow = 0.03351 m³/s @ 0.17 hrs, Volume= 72.4 m³

Outflow = 0.01245 m³/s @ 0.70 hrs, Volume= 72.4 m³, Atten= 63%, Lag= 32.1 min

Primary = 0.01245 m³/s @ 0.70 hrs, Volume= 72.4 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Peak Elev= 100.150 m @ 0.70 hrs Surf.Area= 937.0 m² Storage= 46.7 m³Plug-Flow detention time= 37.4 min calculated for 72.2 m³ (100% of inflow)
Center-of-Mass det. time= 37.5 min (60.5 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

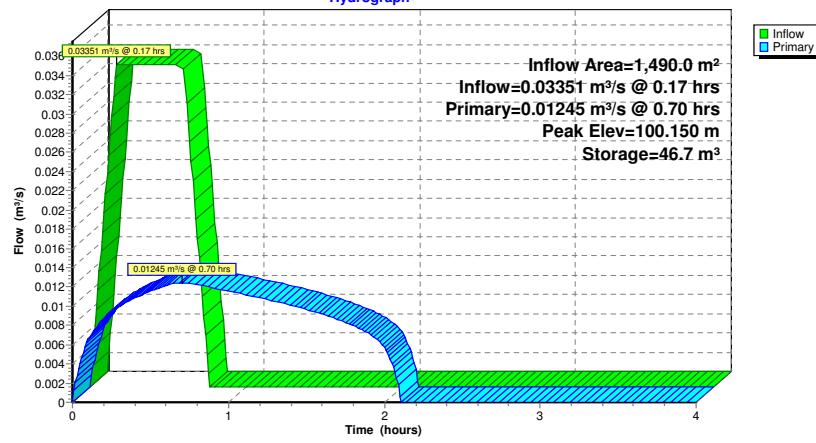
20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC*Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr*Printed 2022-02-17
Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152			
Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950			
0.001100 0.001260			

Primary OutFlow Max=0.01245 m³/s @ 0.70 hrs HW=100.150 m (Free Discharge)
 ↑=1=WATTS Accutrol_5-0.5 (Custom Controls 0.01245 m³/s)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC*Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr*Printed 2022-02-17
Page 14**Pond 10P: Bldg1 Roof****Hydrograph**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 15

Summary for Pond 11P: Bldg2 Roof

Inflow Area = 540.0 m², 100.00% Impervious, Inflow Depth = 49 mm for 100-Year event
 Inflow = 0.01214 m³/s @ 0.17 hrs, Volume= 26.2 m³
 Outflow = 0.00540 m³/s @ 0.69 hrs, Volume= 26.2 m³, Atten= 56%, Lag= 31.4 min
 Primary = 0.00540 m³/s @ 0.69 hrs, Volume= 26.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.136 m @ 0.69 hrs Surf.Area= 396.0 m² Storage= 14.2 m³

Plug-Flow detention time= 24.5 min calculated for 26.2 m³ (100% of inflow)
 Center-of-Mass det. time= 24.6 min (47.6 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

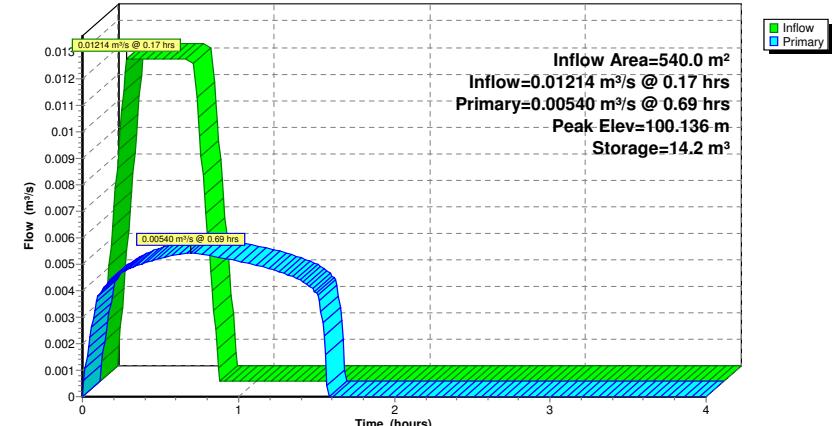
20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 16

Device	Routing	Invert	Outlet Devices
#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00 Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152 Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790 0.000870 0.000950

Primary OutFlow Max=0.00540 m³/s @ 0.69 hrs HW=100.136 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00540 m³/s)

Pond 11P: Bldg2 Roof
Hydrograph

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 17**Summary for Pond B1: Bioswale 1**

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 46 mm for 100-Year event
 Inflow = 0.03974 m³/s @ 0.17 hrs, Volume= 85.8 m³
 Outflow = 0.00897 m³/s @ 0.73 hrs, Volume= 47.2 m³, Atten= 77%, Lag= 33.5 min
 Primary = 0.00897 m³/s @ 0.73 hrs, Volume= 47.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.878 m @ 0.73 hrs Surf.Area= 0.0 m² Storage= 74.2 m³

Plug-Flow detention time= 53.9 min calculated for 47.2 m³ (55% of inflow)
 Center-of-Mass det. time= 45.6 min (68.6 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.700 m	HYDROVEX 100-VHV-1 X 0.80 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

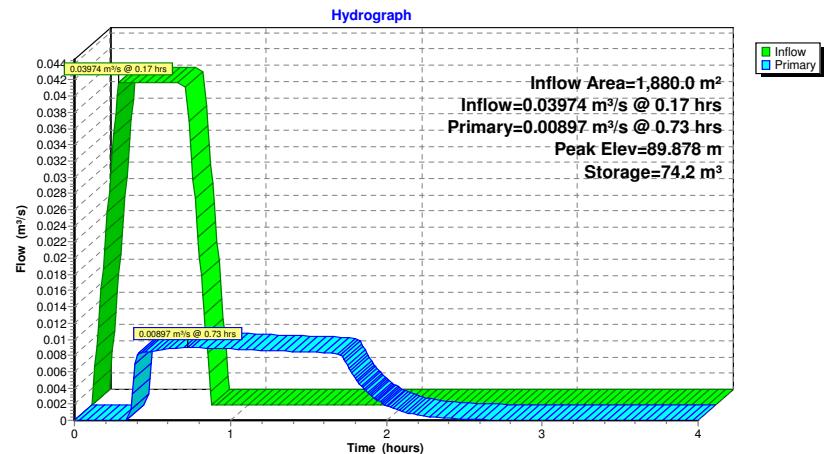
Primary OutFlow Max=0.00897 m³/s @ 0.73 hrs HW=89.878 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00897 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.00897 m³/s of 0.18323 m³/s potential flow)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 18**Pond B1: Bioswale 1**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 19**Summary for Pond B2: Bioswale 2**

Inflow Area = 1,220.0 m², 100.00% Impervious, Inflow Depth = 47 mm for 100-Year event
 Inflow = 0.02661 m³/s @ 0.17 hrs, Volume= 57.5 m³
 Outflow = 0.00988 m³/s @ 0.70 hrs, Volume= 31.3 m³, Atten= 63%, Lag= 32.1 min
 Primary = 0.00988 m³/s @ 0.70 hrs, Volume= 31.3 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.921 m @ 0.70 hrs Surf.Area= 0.0 m² Storage= 45.1 m³

Plug-Flow detention time= 35.4 min calculated for 31.3 m³ (54% of inflow)
 Center-of-Mass det. time= 27.1 min (50.1 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000 #2 Primary 88.641 m HYDROVEX 100-VHV-1 X 0.85 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

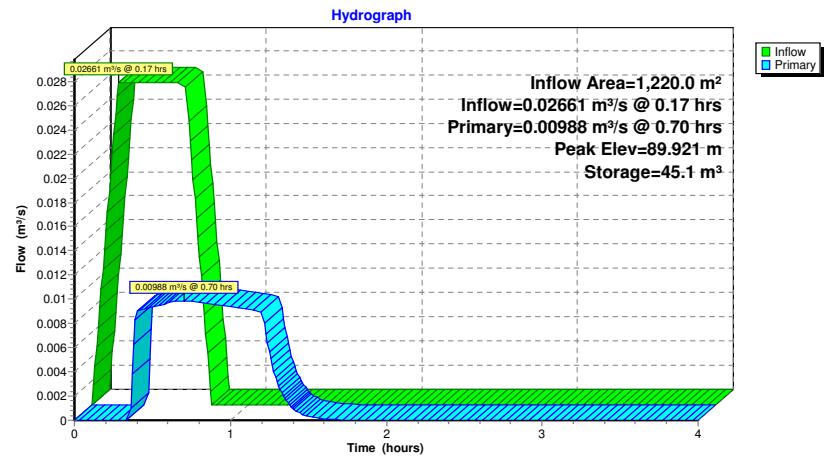
Primary OutFlow Max=0.00988 m³/s @ 0.70 hrs HW=89.921 m (Free Discharge)

↑=HYDROVEX 100-VHV-1 (Custom Controls 0.00988 m³/s)

↑=Single OPSD 400.01 (Passes 0.00988 m³/s of 0.20000 m³/s potential flow)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 20**Pond B2: Bioswale 2**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 21**Summary for Pond B3: Bioswale 3**

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 45 mm for 100-Year event
 Inflow = 0.03681 m³/s @ 0.17 hrs, Volume= 79.5 m³
 Outflow = 0.01876 m³/s @ 0.68 hrs, Volume= 44.0 m³, Atten= 49%, Lag= 30.7 min
 Primary = 0.01876 m³/s @ 0.68 hrs, Volume= 44.0 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.952 m @ 0.68 hrs Surf.Area= 0.0 m² Storage= 56.9 m³

Plug-Flow detention time= 28.5 min calculated for 43.9 m³ (55% of inflow)
 Center-of-Mass det. time= 20.3 min (43.3 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.555 m	HYDROVEX 125-VHV-2 X 0.85 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

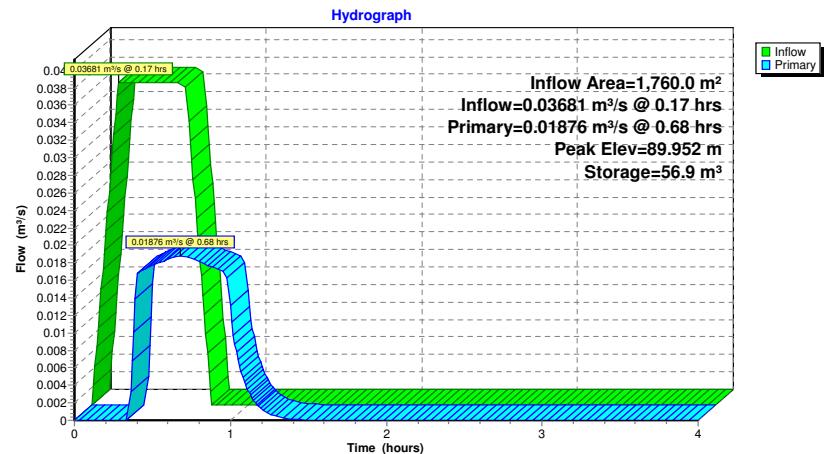
Primary OutFlow Max=0.01876 m³/s @ 0.68 hrs HW=89.952 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Custom Controls 0.01876 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.01876 m³/s of 0.21283 m³/s potential flow)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 22**Pond B3: Bioswale 3**

20220216_TeronRd

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Prepared by WSP Canada inc.

Printed 2022-02-17

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Page 23

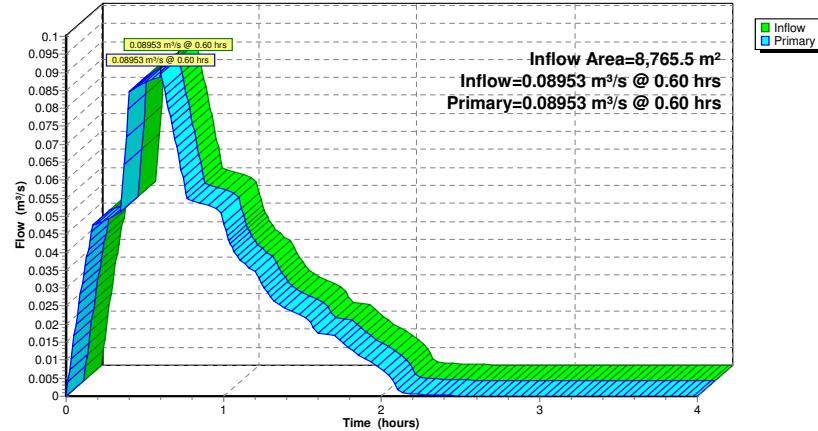
Summary for Link 2L: Ditch

Inflow Area = 8,765.5 m², 38.56% Impervious, Inflow Depth = 34 mm for 100-Year event
Inflow = 0.08953 m³/s @ 0.60 hrs, Volume= 296.5 m³
Primary = 0.08953 m³/s @ 0.60 hrs, Volume= 296.5 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 2L: Ditch

Hydrograph

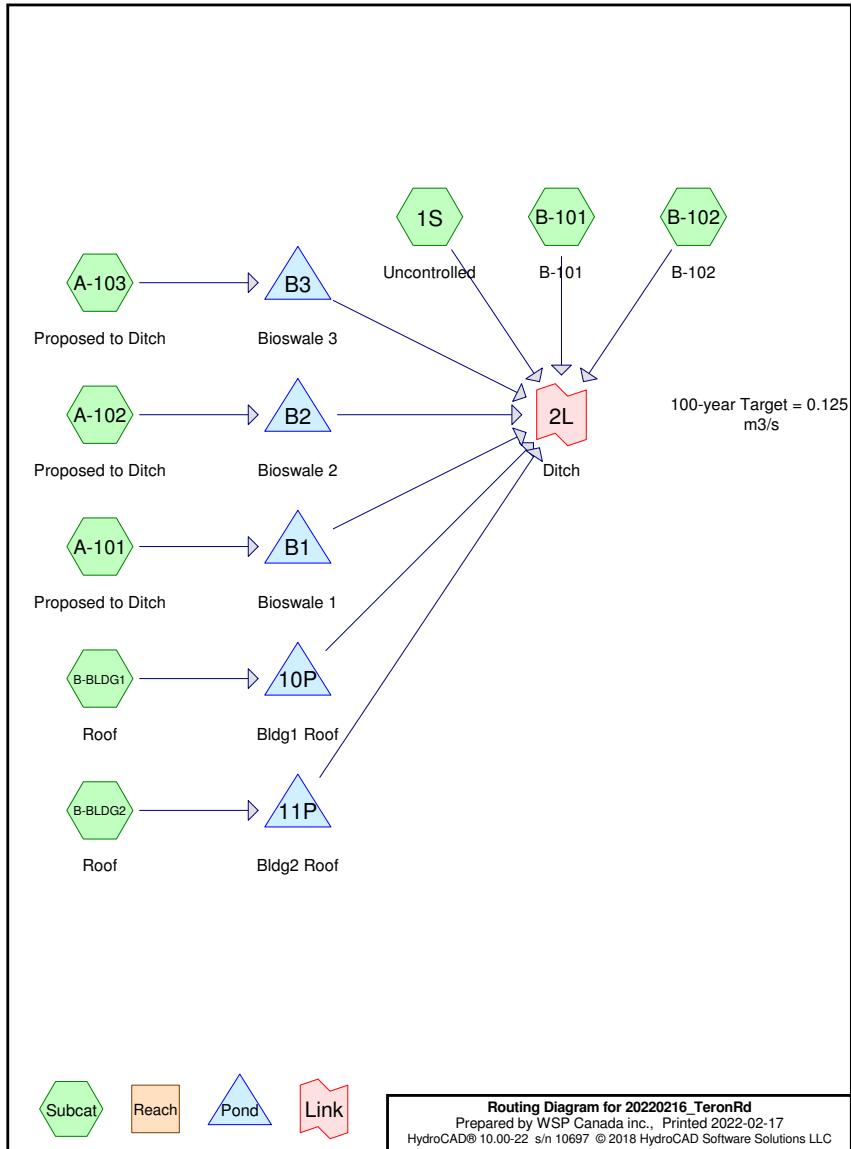


APPENDIX

C-6

100-Year Analysis (Peak Building 1 Rooftop Storage, $T_c = 36$ Min)

The storm system for the site is governed by the 100-year storm. Peak storage in each storage unit and peak discharge may occur at separate times of concentration and are therefore reported separately.



20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
135.5	0.87	(1S)
1,880.0	0.94	(A-101)
1,220.0	0.97	(A-102)
1,760.0	0.93	(A-103)
1,610.0	0.81	(B-101)
2,160.0	1.00	(B-102, B-BLDG1, B-BLDG2)
8,765.5	0.93	TOTAL AREA

20220216_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 3

Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Uncontrolled

Runoff Area=135.5 m² 0.00% Impervious Runoff Depth=42 mm
Tc=10.0 min C=0.87 Runoff=0.00265 m³/s 5.7 m³

Subcatchment A-101: Proposed to Ditch Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=46 mm
Tc=10.0 min C=0.94 Runoff=0.03974 m³/s 85.8 m³

Subcatchment A-102: Proposed to Runoff Area=1,220.0 m² 100.00% Impervious Runoff Depth=47 mm
Tc=10.0 min C=0.97 Runoff=0.02661 m³/s 57.5 m³

Subcatchment A-103: Proposed to Ditch Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=45 mm
Tc=10.0 min C=0.93 Runoff=0.03681 m³/s 79.5 m³

Subcatchment B-101: B-101 Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=39 mm
Tc=10.0 min C=0.81 Runoff=0.02933 m³/s 63.4 m³

Subcatchment B-102: B-102 Runoff Area=130.0 m² 100.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=1.00 Runoff=0.00292 m³/s 6.3 m³

Subcatchment B-BLDG1: Roof Runoff Area=1,490.0 m² 100.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=1.00 Runoff=0.03351 m³/s 72.4 m³

Subcatchment B-BLDG2: Roof Runoff Area=540.0 m² 100.00% Impervious Runoff Depth=49 mm
Tc=10.0 min C=1.00 Runoff=0.01214 m³/s 26.2 m³

Pond 10P: Bldg1 Roof Peak Elev=100.150 m Storage=46.7 m³ Inflow=0.03351 m³/s 72.4 m³
Outflow=0.01245 m³/s 72.4 m³

Pond 11P: Bldg2 Roof Peak Elev=100.136 m Storage=14.2 m³ Inflow=0.01214 m³/s 26.2 m³
Outflow=0.00540 m³/s 26.2 m³

Pond B1: Bioswale 1 Peak Elev=89.878 m Storage=74.2 m³ Inflow=0.03974 m³/s 85.8 m³
Outflow=0.00897 m³/s 47.2 m³

Pond B2: Bioswale 2 Peak Elev=89.921 m Storage=45.1 m³ Inflow=0.02661 m³/s 57.5 m³
Outflow=0.00988 m³/s 31.3 m³

Pond B3: Bioswale 3 Peak Elev=89.952 m Storage=56.9 m³ Inflow=0.03681 m³/s 79.5 m³
Outflow=0.01876 m³/s 44.0 m³

Link 2L: Ditch Inflow=0.08953 m³/s 296.5 m³
Primary=0.08953 m³/s 296.5 m³

Total Runoff Area = 8,765.5 m² Runoff Volume = 396.9 m³ Average Runoff Depth = 45 mm
61.44% Pervious = 5,385.5 m² 38.56% Impervious = 3,380.0 m²

20220216_TeronRd

Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

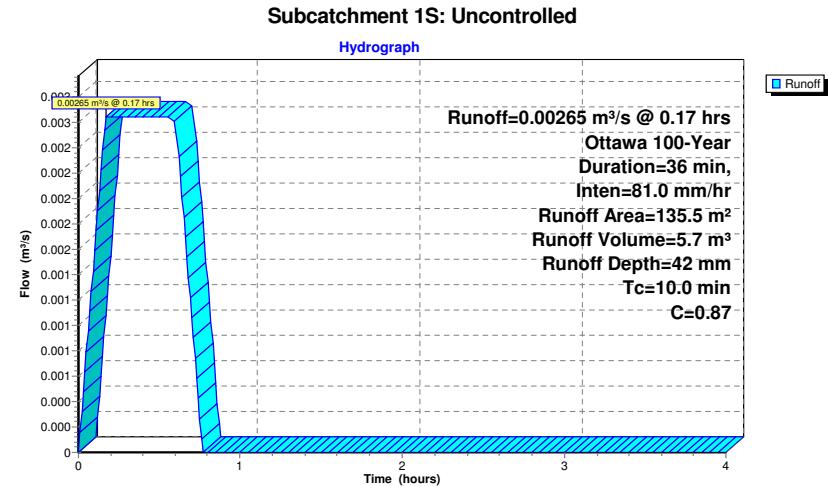
Printed 2022-02-17
Page 4

Summary for Subcatchment 1S: Uncontrolled

Runoff = 0.00265 m³/s @ 0.17 hrs, Volume= 5.7 m³, Depth= 42 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m ²)	C	Description			
135.5	0.87				
135.5		100.00% Pervious Area			
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,



20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 5

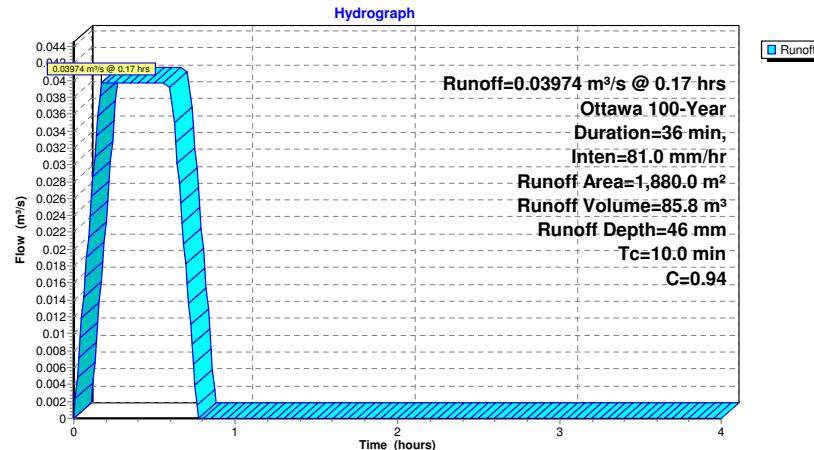
Summary for Subcatchment A-101: Proposed to Ditch

Runoff = 0.03974 m³/s @ 0.17 hrs, Volume= 85.8 m³, Depth= 46 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,880.0	0.94	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-101: Proposed to Ditch**20220216_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 6

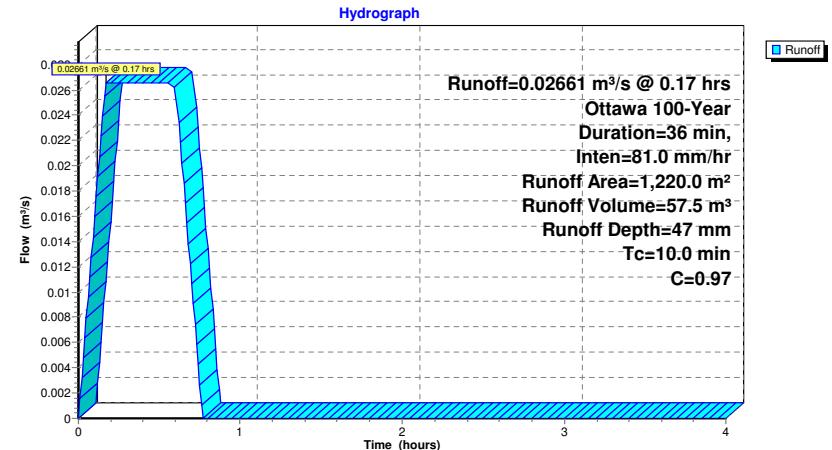
Summary for Subcatchment A-102: Proposed to Ditch

Runoff = 0.02661 m³/s @ 0.17 hrs, Volume= 57.5 m³, Depth= 47 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,220.0	0.97	
1,220.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-102: Proposed to Ditch

20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 7

Summary for Subcatchment A-103: Proposed to Ditch

Runoff = 0.03681 m³/s @ 0.17 hrs, Volume= 79.5 m³, Depth= 45 mm

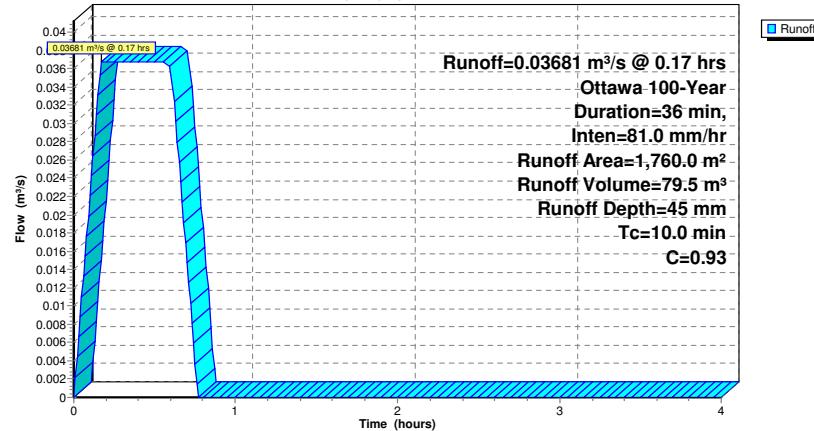
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m ²)	C	Description
1,760.0	0.93	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment A-103: Proposed to Ditch

Hydrograph



20220216_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17

Page 8

Summary for Subcatchment B-101: B-101

Runoff = 0.02933 m³/s @ 0.17 hrs, Volume= 63.4 m³, Depth= 39 mm

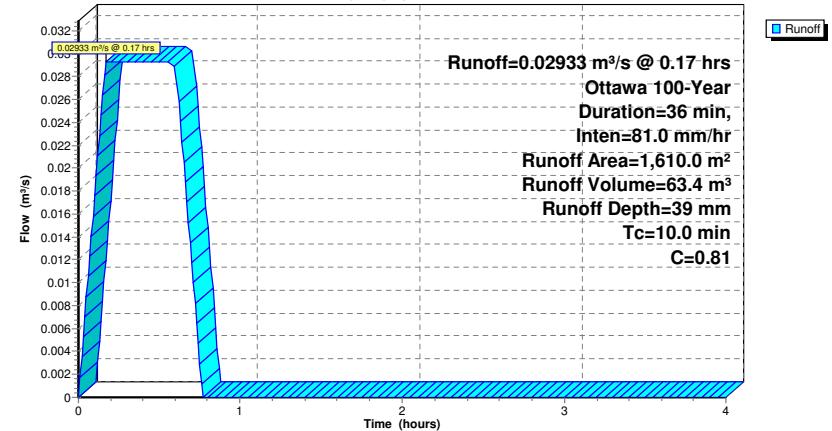
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m ²)	C	Description
1,610.0	0.81	
1,610.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					Direct Entry,

Subcatchment B-101: B-101

Hydrograph



20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

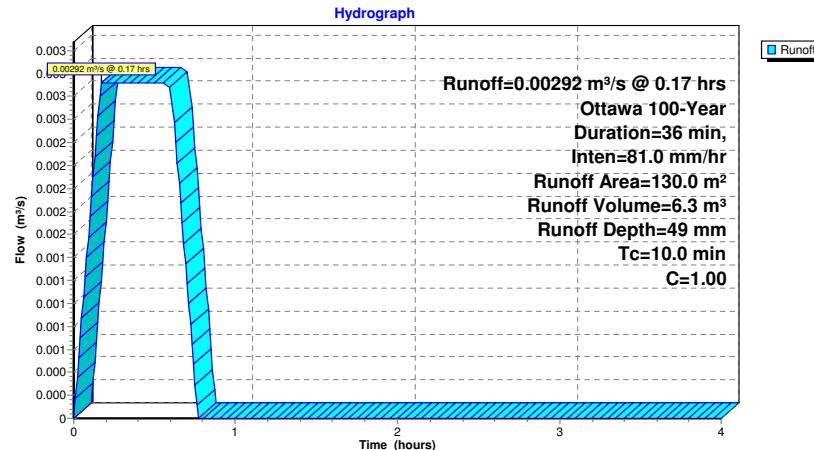
Printed 2022-02-17
Page 9**Summary for Subcatchment B-102: B-102**

Runoff = 0.00292 m³/s @ 0.17 hrs, Volume= 6.3 m³, Depth= 49 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
130.0	1.00	
130.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-102: B-102**20220216_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

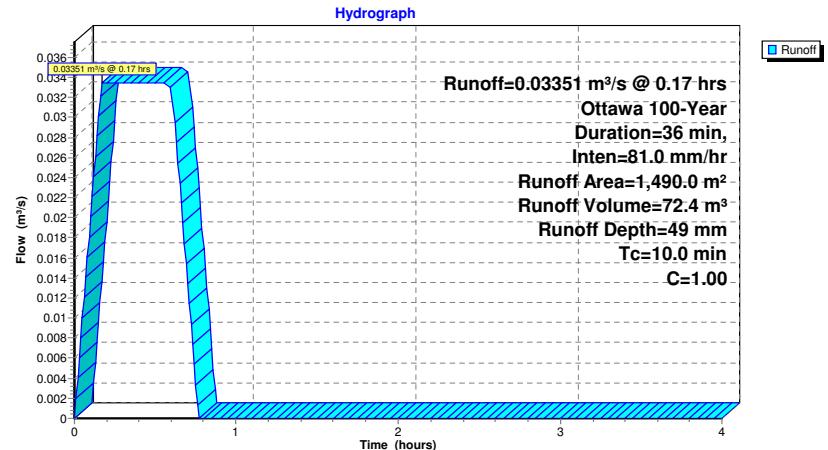
Printed 2022-02-17
Page 10**Summary for Subcatchment B-BLDG1: Roof**

Runoff = 0.03351 m³/s @ 0.17 hrs, Volume= 72.4 m³, Depth= 49 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description
1,490.0	1.00	
1,490.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG1: Roof

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

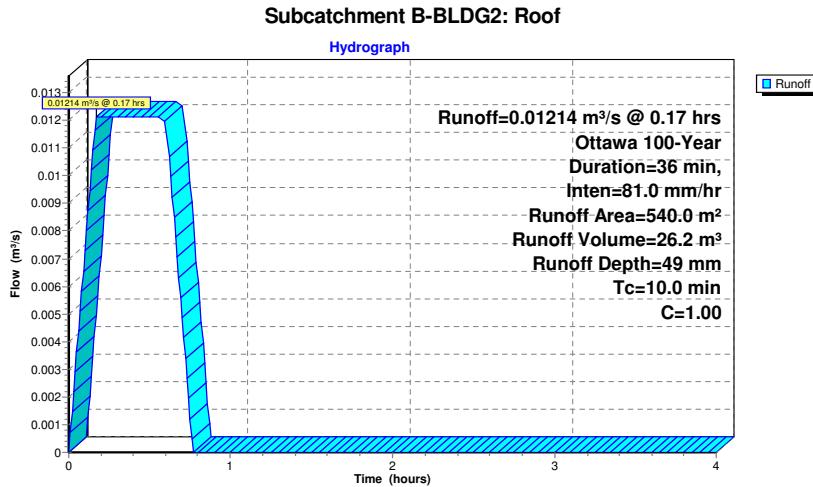
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 11**Summary for Subcatchment B-BLDG2: Roof**

Runoff = 0.01214 m³/s @ 0.17 hrs, Volume= 26.2 m³, Depth= 49 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Area (m²)	C	Description			
540.0	1.00				
540.0		100.00% Impervious Area			
<hr/>					
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

**20220216_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 12**Summary for Pond 10P: Bldg1 Roof**

Inflow Area = 1,490.0 m², 100.00% Impervious, Inflow Depth = 49 mm for 100-Year event

Inflow = 0.03351 m³/s @ 0.17 hrs, Volume= 72.4 m³

Outflow = 0.01245 m³/s @ 0.70 hrs, Volume= 72.4 m³, Atten= 63%, Lag= 32.1 min

Primary = 0.01245 m³/s @ 0.70 hrs, Volume= 72.4 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Peak Elev= 100.150 m @ 0.70 hrs Surf.Area= 937.0 m² Storage= 46.7 m³Plug-Flow detention time= 37.4 min calculated for 72.2 m³ (100% of inflow)
Center-of-Mass det. time= 37.5 min (60.5 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

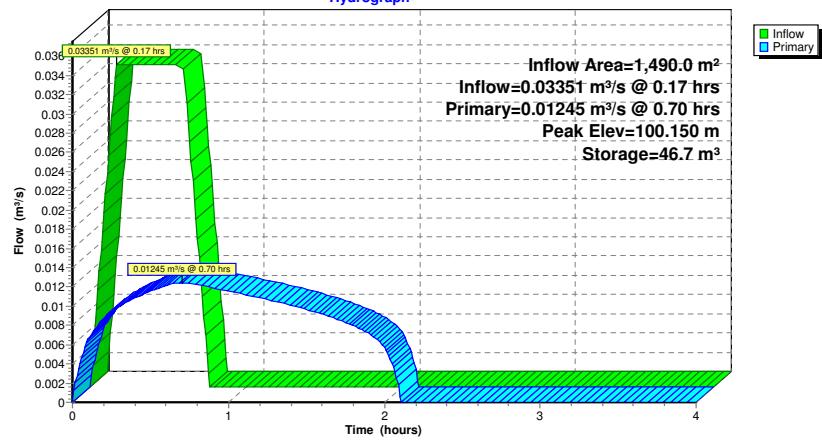
20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC*Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr*Printed 2022-02-17
Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
			Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152
			Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950
			0.001100 0.001260

Primary OutFlow Max=0.01245 m³/s @ 0.70 hrs HW=100.150 m (Free Discharge)
 ↑=1=WATTS Accutrol_5-0.5 (Custom Controls 0.01245 m³/s)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC*Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr*Printed 2022-02-17
Page 14**Pond 10P: Bldg1 Roof****Hydrograph**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 15**Summary for Pond 11P: Bldg2 Roof**

Inflow Area = 540.0 m², 100.00% Impervious, Inflow Depth = 49 mm for 100-Year event
 Inflow = 0.01214 m³/s @ 0.17 hrs, Volume= 26.2 m³
 Outflow = 0.00540 m³/s @ 0.69 hrs, Volume= 26.2 m³, Atten= 56%, Lag= 31.4 min
 Primary = 0.00540 m³/s @ 0.69 hrs, Volume= 26.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.136 m @ 0.69 hrs Surf.Area= 396.0 m² Storage= 14.2 m³

Plug-Flow detention time= 24.5 min calculated for 26.2 m³ (100% of inflow)
 Center-of-Mass det. time= 24.6 min (47.6 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

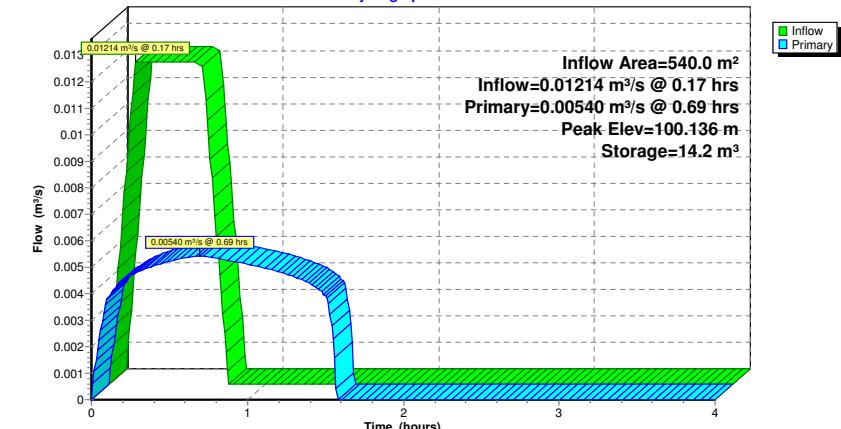
20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 16

Device	Routing	Invert	Outlet Devices
#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00 Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152 Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790 0.000870 0.000950

Primary OutFlow Max=0.00540 m³/s @ 0.69 hrs HW=100.136 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00540 m³/s)

Pond 11P: Bldg2 Roof**Hydrograph**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 17**Summary for Pond B1: Bioswale 1**

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 46 mm for 100-Year event
 Inflow = 0.03974 m³/s @ 0.17 hrs, Volume= 85.8 m³
 Outflow = 0.00897 m³/s @ 0.73 hrs, Volume= 47.2 m³, Atten= 77%, Lag= 33.5 min
 Primary = 0.00897 m³/s @ 0.73 hrs, Volume= 47.2 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.878 m @ 0.73 hrs Surf.Area= 0.0 m² Storage= 74.2 m³

Plug-Flow detention time= 53.9 min calculated for 47.2 m³ (55% of inflow)
 Center-of-Mass det. time= 45.6 min (68.6 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.700 m	HYDROVEX 100-VHV-1 X 0.80 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

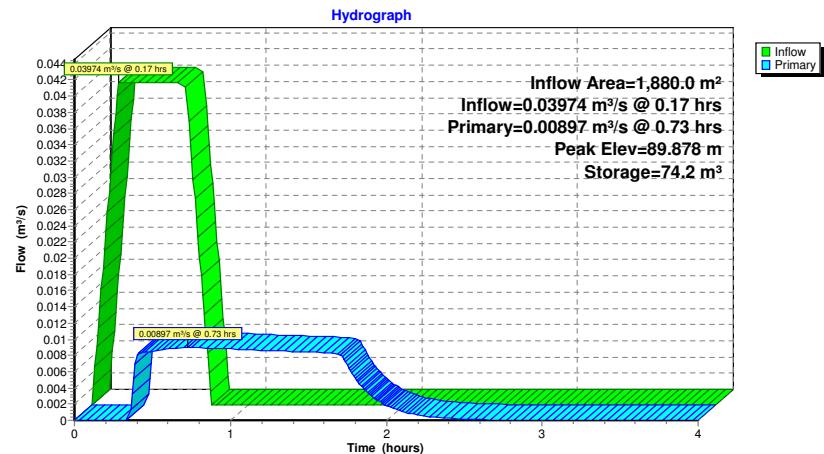
Primary OutFlow Max=0.00897 m³/s @ 0.73 hrs HW=89.878 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00897 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.00897 m³/s of 0.18323 m³/s potential flow)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 18**Pond B1: Bioswale 1**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 19**Summary for Pond B2: Bioswale 2**

Inflow Area = 1,220.0 m², 100.00% Impervious, Inflow Depth = 47 mm for 100-Year event
 Inflow = 0.02661 m³/s @ 0.17 hrs, Volume= 57.5 m³
 Outflow = 0.00988 m³/s @ 0.70 hrs, Volume= 31.3 m³, Atten= 63%, Lag= 32.1 min
 Primary = 0.00988 m³/s @ 0.70 hrs, Volume= 31.3 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.921 m @ 0.70 hrs Surf.Area= 0.0 m² Storage= 45.1 m³

Plug-Flow detention time= 35.4 min calculated for 31.3 m³ (54% of inflow)
 Center-of-Mass det. time= 27.1 min (50.1 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000 #2 Primary 88.641 m HYDROVEX 100-VHV-1 X 0.85 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

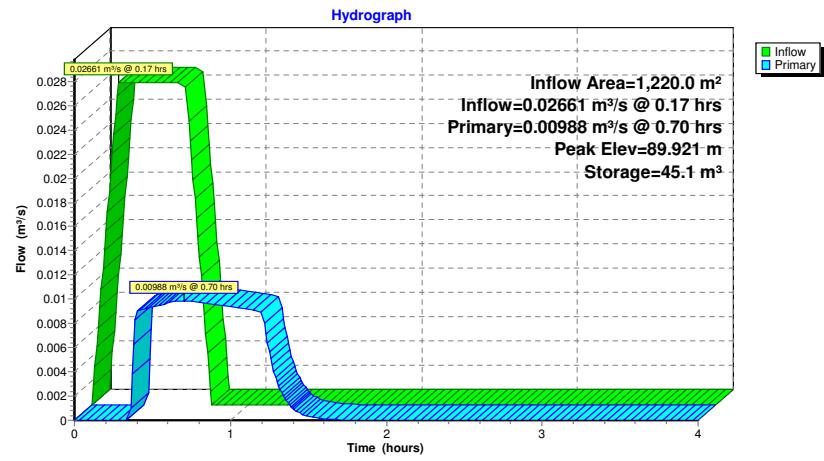
Primary OutFlow Max=0.00988 m³/s @ 0.70 hrs HW=89.921 m (Free Discharge)

↑=HYDROVEX 100-VHV-1 (Custom Controls 0.00988 m³/s)

↑=Single OPSD 400.01 (Passes 0.00988 m³/s of 0.20000 m³/s potential flow)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 20**Pond B2: Bioswale 2**

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 21**Summary for Pond B3: Bioswale 3**

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 45 mm for 100-Year event
 Inflow = 0.03681 m³/s @ 0.17 hrs, Volume= 79.5 m³
 Outflow = 0.01876 m³/s @ 0.68 hrs, Volume= 44.0 m³, Atten= 49%, Lag= 30.7 min
 Primary = 0.01876 m³/s @ 0.68 hrs, Volume= 44.0 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.952 m @ 0.68 hrs Surf.Area= 0.0 m² Storage= 56.9 m³

Plug-Flow detention time= 28.5 min calculated for 43.9 m³ (55% of inflow)
 Center-of-Mass det. time= 20.3 min (43.3 - 23.0)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.555 m	HYDROVEX 125-VHV-2 X 0.85 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

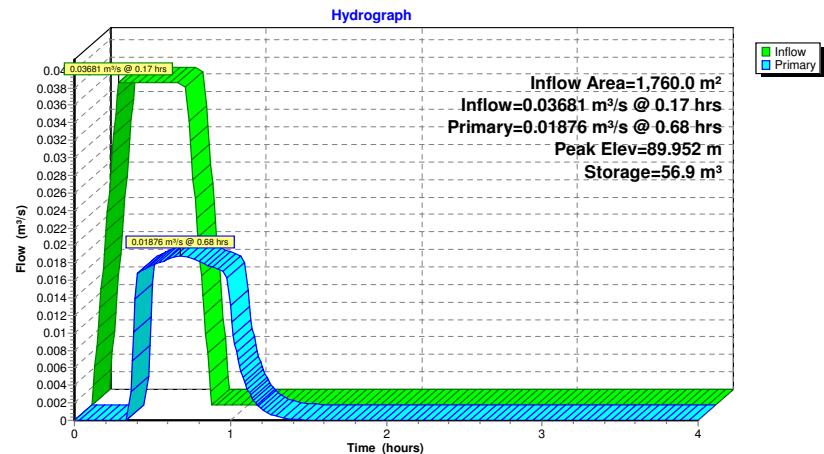
Primary OutFlow Max=0.01876 m³/s @ 0.68 hrs HW=89.952 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Custom Controls 0.01876 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.01876 m³/s of 0.21283 m³/s potential flow)

20220216_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Printed 2022-02-17
Page 22**Pond B3: Bioswale 3**

20220216_TeronRd

Ottawa 100-Year Duration=36 min, Inten=81.0 mm/hr

Prepared by WSP Canada inc.

Printed 2022-02-17

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Page 23

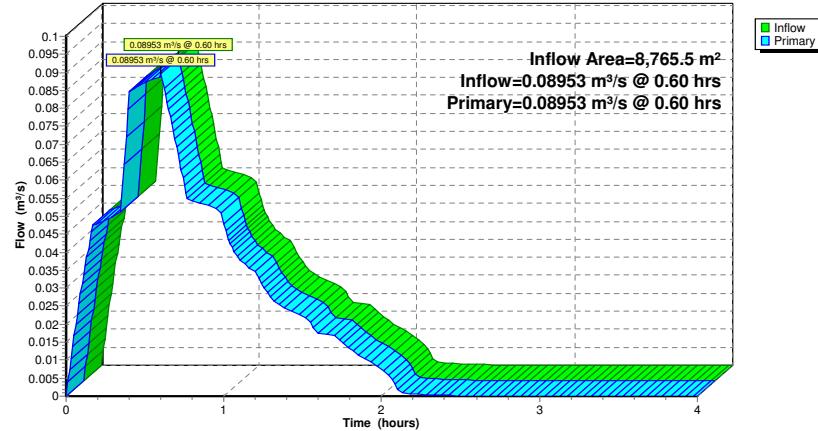
Summary for Link 2L: Ditch

Inflow Area = 8,765.5 m², 38.56% Impervious, Inflow Depth = 34 mm for 100-Year event
Inflow = 0.08953 m³/s @ 0.60 hrs, Volume= 296.5 m³
Primary = 0.08953 m³/s @ 0.60 hrs, Volume= 296.5 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 2L: Ditch

Hydrograph

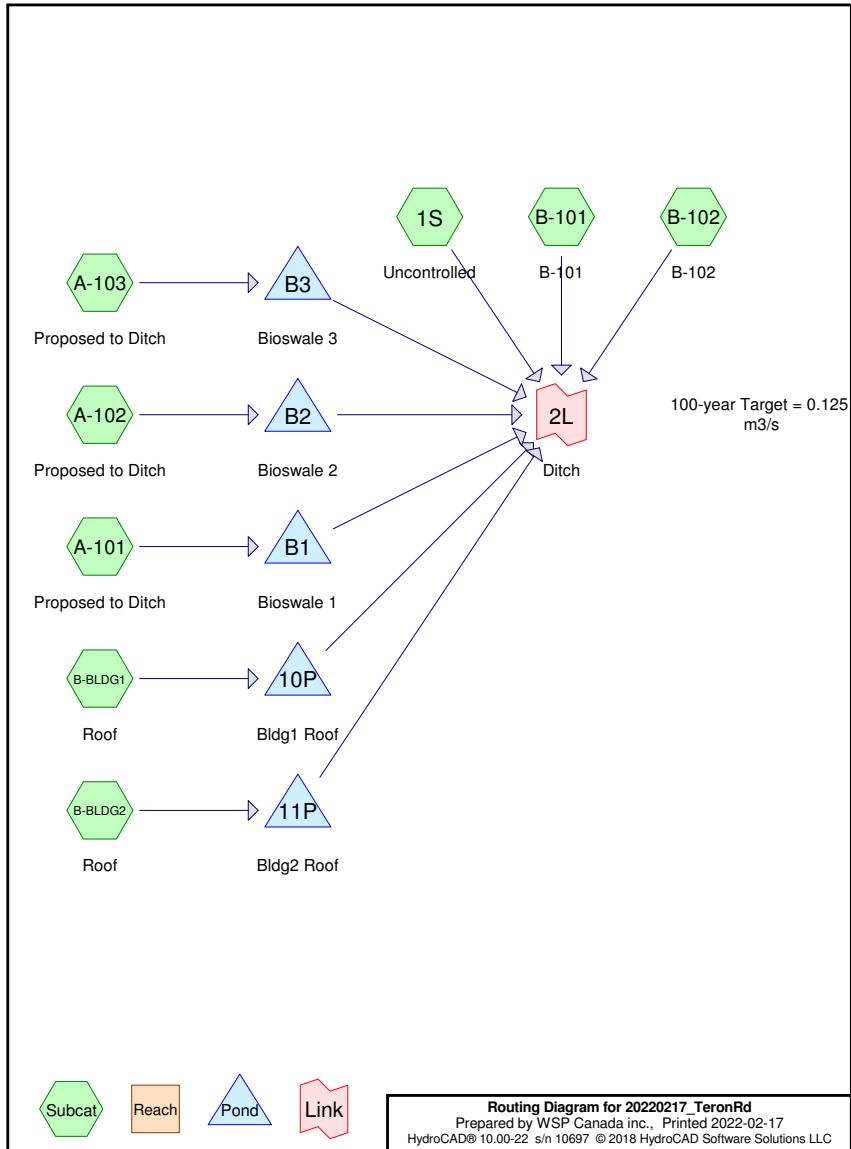


APPENDIX

C-7

100-Year Analysis (Peak Building 2 Rooftop Storage, $T_c = 29$ Min)

The storm system for the site is governed by the 100-year storm. Peak storage in each storage unit and peak discharge may occur at separate times of concentration and are therefore reported separately.



20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Printed 2022-02-17

Page 2

Area Listing (selected nodes)

Area (sq-meters)	C	Description (subcatchment-numbers)
135.5	0.87	(1S)
1,880.0	0.94	(A-101)
1,220.0	0.97	(A-102)
1,760.0	0.93	(A-103)
1,610.0	0.81	(B-101)
2,160.0	1.00	(B-102, B-BLDG1, B-BLDG2)
8,765.5	0.93	TOTAL AREA

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 3

Time span=0.00-4.00 hrs, dt=0.01 hrs, 401 points
Runoff by Rational method, Rise/Fall=1.0/1.0 xTc

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: UncontrolledRunoff Area=135.5 m² 0.00% Impervious Runoff Depth=40 mm
Tc=10.0 min C=0.87 Runoff=0.00308 m³/s 5.4 m³**Subcatchment A-101: Proposed to Ditch** Runoff Area=1,880.0 m² 0.00% Impervious Runoff Depth=43 mm
Tc=10.0 min C=0.94 Runoff=0.04615 m³/s 80.3 m³**Subcatchment A-102: Proposed to** Runoff Area=1,220.0 m² 100.00% Impervious Runoff Depth=44 mm
Tc=10.0 min C=0.97 Runoff=0.03090 m³/s 53.8 m³**Subcatchment A-103: Proposed to Ditch** Runoff Area=1,760.0 m² 0.00% Impervious Runoff Depth=42 mm
Tc=10.0 min C=0.93 Runoff=0.04275 m³/s 74.4 m³**Subcatchment B-101: B-101** Runoff Area=1,610.0 m² 0.00% Impervious Runoff Depth=37 mm
Tc=10.0 min C=0.81 Runoff=0.03406 m³/s 59.2 m³**Subcatchment B-102: B-102** Runoff Area=130.0 m² 100.00% Impervious Runoff Depth=45 mm
Tc=10.0 min C=1.00 Runoff=0.00339 m³/s 5.9 m³**Subcatchment B-BLDG1: Roof** Runoff Area=1,490.0 m² 100.00% Impervious Runoff Depth=45 mm
Tc=10.0 min C=1.00 Runoff=0.03891 m³/s 67.7 m³**Subcatchment B-BLDG2: Roof** Runoff Area=540.0 m² 100.00% Impervious Runoff Depth=45 mm
Tc=10.0 min C=1.00 Runoff=0.01410 m³/s 24.5 m³**Pond 10P: Bldg1 Roof** Peak Elev=100.149 m Storage=46.2 m³ Inflow=0.03891 m³/s 67.7 m³
Outflow=0.01241 m³/s 67.7 m³**Pond 11P: Bldg2 Roof** Peak Elev=100.137 m Storage=14.4 m³ Inflow=0.01410 m³/s 24.5 m³
Outflow=0.00541 m³/s 24.5 m³**Pond B1: Bioswale 1** Peak Elev=89.854 m Storage=70.9 m³ Inflow=0.04615 m³/s 80.3 m³
Outflow=0.00895 m³/s 41.6 m³**Pond B2: Bioswale 2** Peak Elev=89.902 m Storage=43.8 m³ Inflow=0.03090 m³/s 53.8 m³
Outflow=0.00981 m³/s 27.6 m³**Pond B3: Bioswale 3** Peak Elev=89.943 m Storage=56.3 m³ Inflow=0.04275 m³/s 74.4 m³
Outflow=0.01852 m³/s 38.8 m³**Link 2L: Ditch** Inflow=0.09425 m³/s 270.8 m³
Primary=0.09425 m³/s 270.8 m³Total Runoff Area = 8,765.5 m² Runoff Volume = 371.1 m³ Average Runoff Depth = 42 mm
61.44% Pervious = 5,385.5 m² 38.56% Impervious = 3,380.0 m²**20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

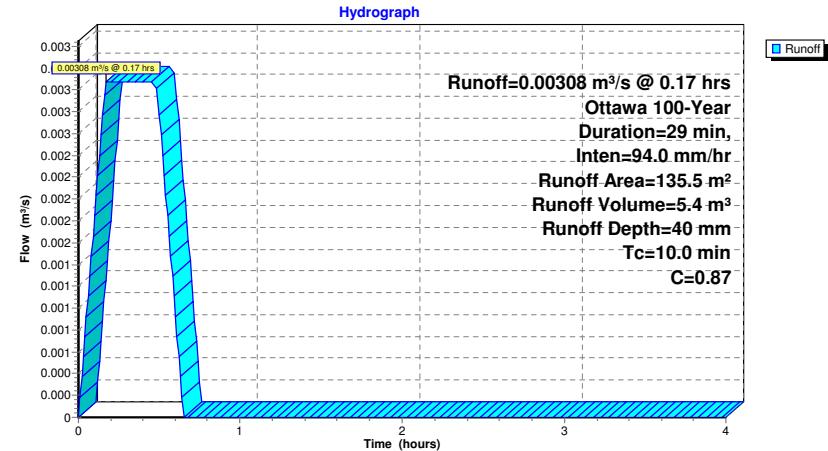
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 4

Summary for Subcatchment 1S: UncontrolledRunoff = 0.00308 m³/s @ 0.17 hrs, Volume= 5.4 m³, Depth= 40 mmRunoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m ²)	C	Description			
135.5	0.87				
135.5		100.00% Pervious Area			
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m ³ /s)	Description
10.0					
Direct Entry,					

Subcatchment 1S: Uncontrolled

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 5

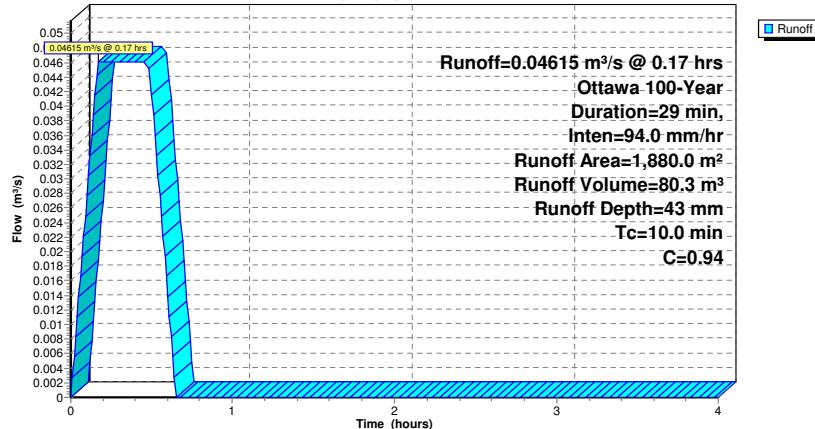
Summary for Subcatchment A-101: Proposed to Ditch

Runoff = 0.04615 m³/s @ 0.17 hrs, Volume= 80.3 m³, Depth= 43 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description
1,880.0	0.94	
1,880.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-101: Proposed to Ditch**Hydrograph****20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 6

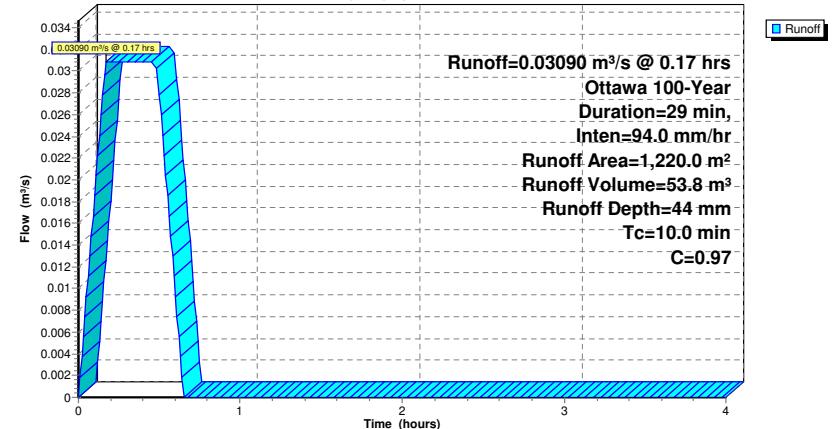
Summary for Subcatchment A-102: Proposed to Ditch

Runoff = 0.03090 m³/s @ 0.17 hrs, Volume= 53.8 m³, Depth= 44 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description
1,220.0	0.97	
1,220.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-102: Proposed to Ditch**Hydrograph**

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 7

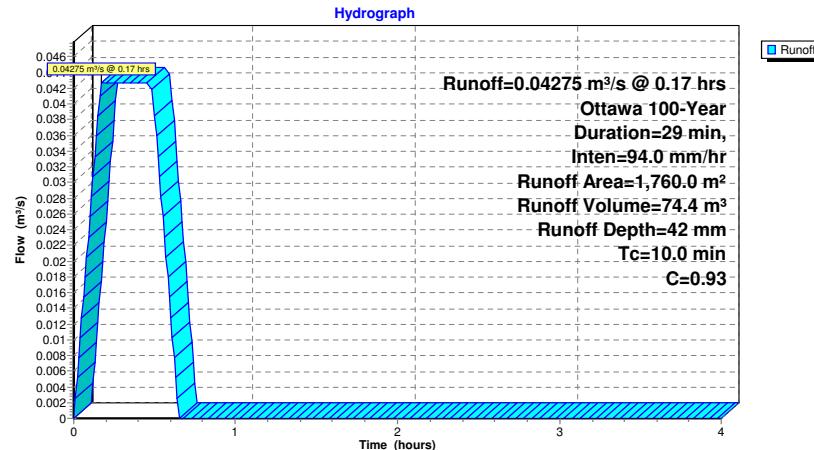
Summary for Subcatchment A-103: Proposed to Ditch

Runoff = 0.04275 m³/s @ 0.17 hrs, Volume= 74.4 m³, Depth= 42 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description
1,760.0	0.93	
1,760.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment A-103: Proposed to Ditch**20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 8

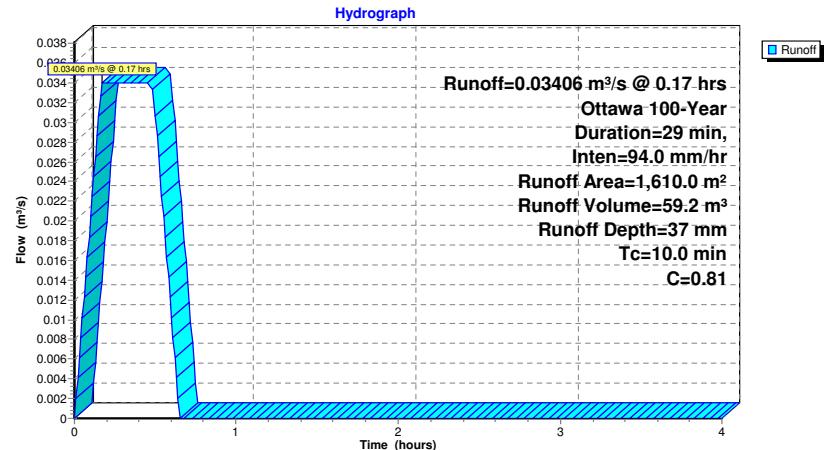
Summary for Subcatchment B-101: B-101

Runoff = 0.03406 m³/s @ 0.17 hrs, Volume= 59.2 m³, Depth= 37 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description
1,610.0	0.81	
1,610.0	100.00%	Pervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-101: B-101

20220217_TeronRd

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 9

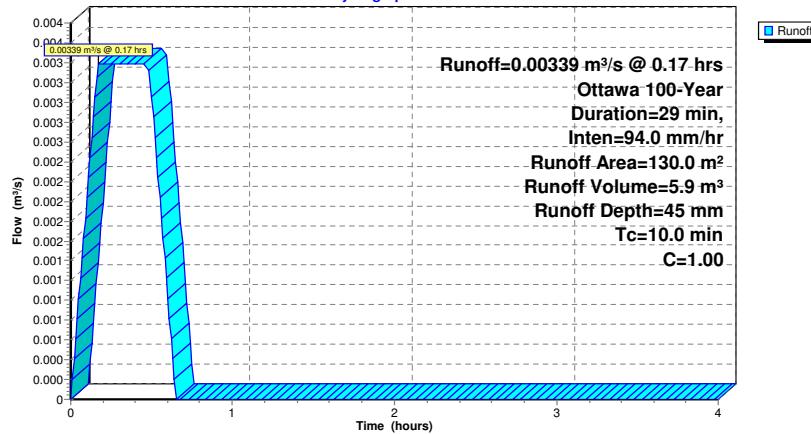
Summary for Subcatchment B-102: B-102

Runoff = 0.00339 m³/s @ 0.17 hrs, Volume= 5.9 m³, Depth= 45 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description
130.0	1.00	
130.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-102: B-102**Hydrograph****20220217_TeronRd**

Prepared by WSP Canada inc.

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 10

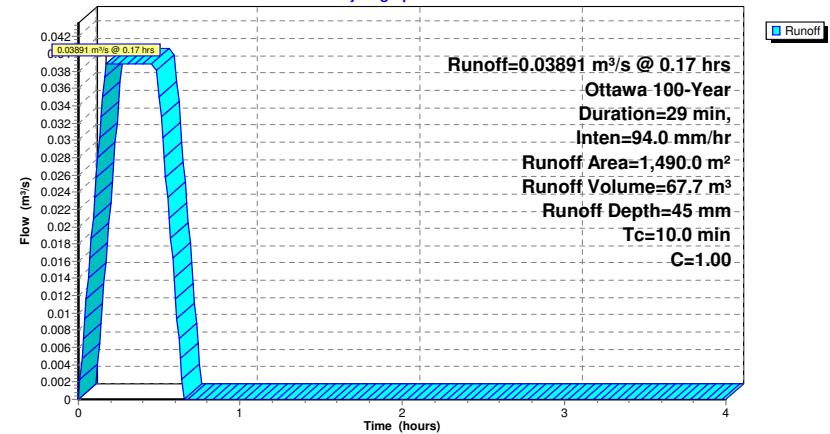
Summary for Subcatchment B-BLDG1: Roof

Runoff = 0.03891 m³/s @ 0.17 hrs, Volume= 67.7 m³, Depth= 45 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description
1,490.0	1.00	
1,490.0	100.00%	Impervious Area

Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

Subcatchment B-BLDG1: Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

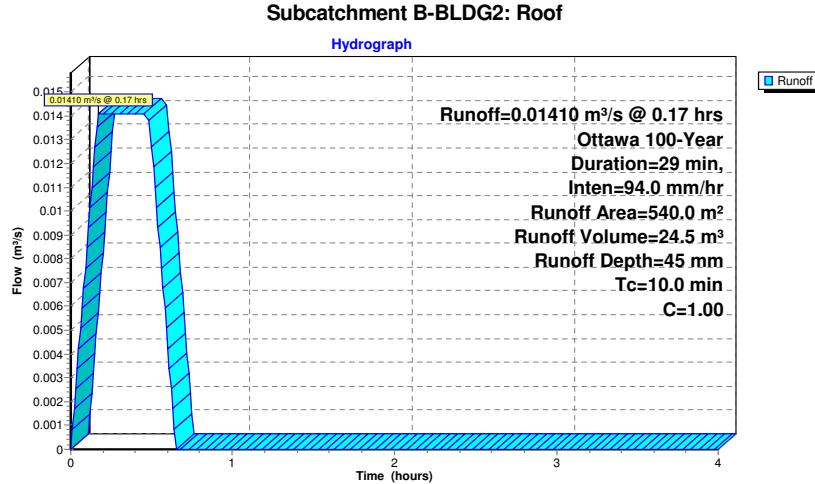
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 11**Summary for Subcatchment B-BLDG2: Roof**

Runoff = 0.01410 m³/s @ 0.17 hrs, Volume= 24.5 m³, Depth= 45 mm

Runoff by Rational method, Rise/Fall=1.0/1.0 xTc, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Area (m²)	C	Description			
540.0	1.00				
540.0		100.00% Impervious Area			
<hr/>					
Tc (min)	Length (meters)	Slope (m/m)	Velocity (m/sec)	Capacity (m³/s)	Description
10.0					Direct Entry,

**20220217_TeronRd**Prepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 12**Summary for Pond 10P: Bldg1 Roof**Inflow Area = 1,490.0 m², 100.00% Impervious, Inflow Depth = 45 mm for 100-Year event
Inflow = 0.03891 m³/s @ 0.17 hrs, Volume= 67.7 m³
Outflow = 0.01241 m³/s @ 0.60 hrs, Volume= 67.7 m³, Atten= 68%, Lag= 25.6 min
Primary = 0.01241 m³/s @ 0.60 hrs, Volume= 67.7 m³Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
Peak Elev= 100.149 m @ 0.60 hrs Surf.Area= 929.5 m² Storage= 46.2 m³Plug-Flow detention time= 36.8 min calculated for 67.5 m³ (100% of inflow)
Center-of-Mass det. time= 36.9 min (56.4 - 19.5)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	5.0 m³	Roof drain 1 (Pyramidal) Listed below (Recalc)
#2	100.000 m	8.2 m³	Roof drain 2 (Pyramidal) Listed below (Recalc)
#3	100.000 m	10.6 m³	Roof drain 3 (Pyramidal) Listed below (Recalc)
#4	100.000 m	4.0 m³	Roof drain 4 (Pyramidal) Listed below (Recalc)
#5	100.000 m	2.8 m³	Roof drain 5 (Pyramidal) Listed below (Recalc)
#6	100.000 m	2.9 m³	Roof drain 6 (Pyramidal) Listed below (Recalc)
#7	100.000 m	3.9 m³	Roof drain 7 (Pyramidal) Listed below (Recalc)
#8	100.000 m	3.6 m³	Roof drain 8 (Pyramidal) Listed below (Recalc)
#9	100.000 m	2.8 m³	Roof drain 9 (Pyramidal) Listed below (Recalc)
#10	100.000 m	3.5 m³	Roof drain 10 (Pyramidal) Listed below (Recalc)
			47.1 m³ Total Available Storage

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	99.0	5.0	5.0	99.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	164.0	8.2	8.2	164.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	212.0	10.6	10.6	212.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	80.0	4.0	4.0	80.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0

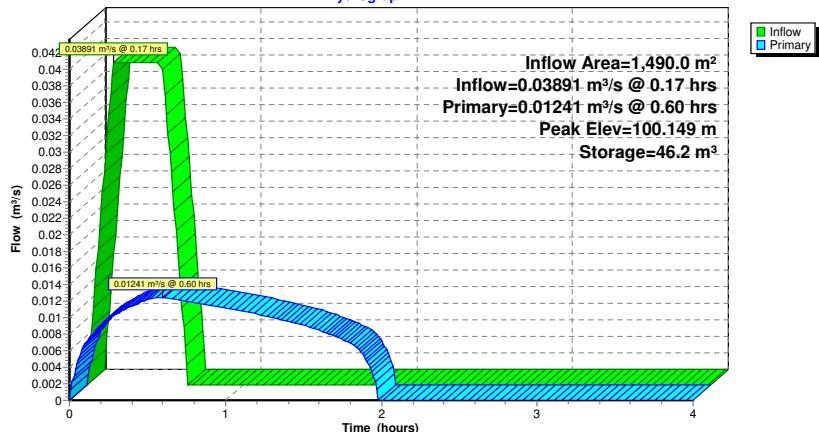
20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC*Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr*Printed 2022-02-17
Page 13

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	58.0	2.9	2.9	58.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	77.0	3.9	3.9	77.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	71.0	3.6	3.6	71.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	56.0	2.8	2.8	56.0
Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	69.0	3.5	3.5	69.0

Device Routing Invert Outlet Devices

#1	Primary	100.000 m	WATTS Accutrol_5-0.5 X 10.00
Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152			
Disch. (m³/s) 0.000000 0.000310 0.000630 0.000790 0.000950			
0.001100 0.001260			

Primary OutFlow Max=0.01241 m³/s @ 0.60 hrs HW=100.149 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.5 (Custom Controls 0.01241 m³/s)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC*Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr*Printed 2022-02-17
Page 14**Pond 10P: Bldg1 Roof****Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 15

Summary for Pond 11P: Bldg2 Roof

Inflow Area = 540.0 m², 100.00% Impervious, Inflow Depth = 45 mm for 100-Year event
 Inflow = 0.01410 m³/s @ 0.17 hrs, Volume= 24.5 m³
 Outflow = 0.00541 m³/s @ 0.59 hrs, Volume= 24.5 m³, Atten= 62%, Lag= 25.0 min
 Primary = 0.00541 m³/s @ 0.59 hrs, Volume= 24.5 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 100.137 m @ 0.59 hrs Surf.Area= 399.7 m² Storage= 14.4 m³

Plug-Flow detention time= 24.7 min calculated for 24.5 m³ (100% of inflow)
 Center-of-Mass det. time= 24.7 min (44.2 - 19.5)

Volume	Invert	Avail.Storage	Storage Description
#1	100.000 m	6.0 m ³	Roof drain 13 (Pyramidal) Listed below (Recalc)
#2	100.060 m	1.8 m ³	Roof drain 14 (Pyramidal) Listed below (Recalc)
#3	100.060 m	2.0 m ³	Roof drain 15 (Pyramidal) Listed below (Recalc)
#4	100.060 m	1.9 m ³	Roof drain 16 (Pyramidal) Listed below (Recalc)
#5	100.000 m	6.6 m ³	Roof drain 17 (Pyramidal) Listed below (Recalc)
#6	100.060 m	2.2 m ³	Roof drain 18 (Pyramidal) Listed below (Recalc)
20.4 m ³ Total Available Storage			

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	120.0	6.0	6.0	120.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	61.0	1.8	1.8	61.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	65.0	2.0	2.0	65.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	64.0	1.9	1.9	64.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.000	0.0	0.0	0.0	0.0
100.150	131.0	6.6	6.6	131.0

Elevation (meters)	Surf.Area (sq-meters)	Inc.Store (cubic-meters)	Cum.Store (cubic-meters)	Wet.Area (sq-meters)
100.060	0.0	0.0	0.0	0.0
100.150	72.0	2.2	2.2	72.0

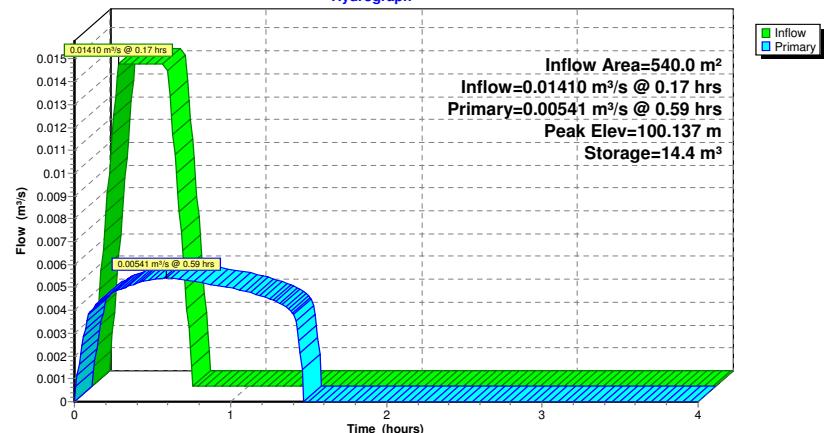
20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 16

Device	Routing	Invert	Outlet Devices
#1	Primary	100.000 m	WATTS Accutrol_5-0.25 X 6.00 Head (meters) 0.000 0.025 0.051 0.076 0.102 0.127 0.152 Disch. (m ³ /s) 0.000000 0.000310 0.000630 0.000710 0.000790 0.000870 0.000950

Primary OutFlow Max=0.00541 m³/s @ 0.59 hrs HW=100.137 m (Free Discharge)
 ↑=WATTS Accutrol_5-0.25 (Custom Controls 0.00541 m³/s)

Pond 11P: Bldg2 Roof**Hydrograph**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 17**Summary for Pond B1: Bioswale 1**

Inflow Area = 1,880.0 m², 0.00% Impervious, Inflow Depth = 43 mm for 100-Year event
 Inflow = 0.04615 m³/s @ 0.17 hrs, Volume= 80.3 m³
 Outflow = 0.00895 m³/s @ 0.62 hrs, Volume= 41.6 m³, Atten= 81%, Lag= 26.9 min
 Primary = 0.00895 m³/s @ 0.62 hrs, Volume= 41.6 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.854 m @ 0.62 hrs Surf.Area= 0.0 m² Storage= 70.9 m³

Plug-Flow detention time= 48.4 min calculated for 41.5 m³ (52% of inflow)
 Center-of-Mass det. time= 41.4 min (60.9 - 19.5)

Volume	Invert	Avail.Storage	Description
#1	88.700 m	182.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.700	0.0
89.050	8.0
89.200	12.0
89.550	29.0
90.000	91.0
91.000	182.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.611 m	HYDROVEX 100-VHV-1 X 0.78 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

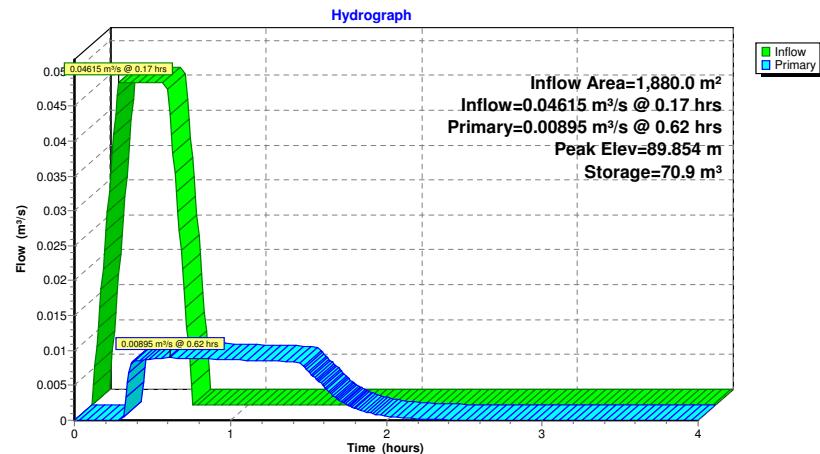
Primary OutFlow Max=0.00895 m³/s @ 0.62 hrs HW=89.854 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00895 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.00895 m³/s of 0.17373 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 18**Pond B1: Bioswale 1**

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 19

Summary for Pond B2: Bioswale 2

Inflow Area = 1,220.0 m², 100.00% Impervious, Inflow Depth = 44 mm for 100-Year event
 Inflow = 0.03090 m³/s @ 0.17 hrs, Volume= 53.8 m³
 Outflow = 0.00981 m³/s @ 0.60 hrs, Volume= 27.6 m³, Atten= 68%, Lag= 25.6 min
 Primary = 0.00981 m³/s @ 0.60 hrs, Volume= 27.6 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.902 m @ 0.60 hrs Surf.Area= 0.0 m² Storage= 43.8 m³

Plug-Flow detention time= 32.3 min calculated for 27.5 m³ (51% of inflow)
 Center-of-Mass det. time= 25.1 min (44.6 - 19.5)

Volume	Invert	Avail.Storage	Storage Description
#1	88.641 m	100.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.641	0.0
88.990	6.0
89.140	8.0
89.490	18.0
90.000	50.0
91.000	100.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 0.400 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000 0.200000
#2	Primary	88.537 m	HYDROVEX 100-VHV-1 X 0.82 Head (meters) 0.000 0.200 0.500 1.000 1.500 2.000 3.000 4.000 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.007000 0.010500 0.012500 0.014000 0.018000 0.021000 0.026000

Primary OutFlow Max=0.00981 m³/s @ 0.60 hrs HW=89.902 m (Free Discharge)

↑ 2=HYDROVEX 100-VHV-1 (Custom Controls 0.00981 m³/s)

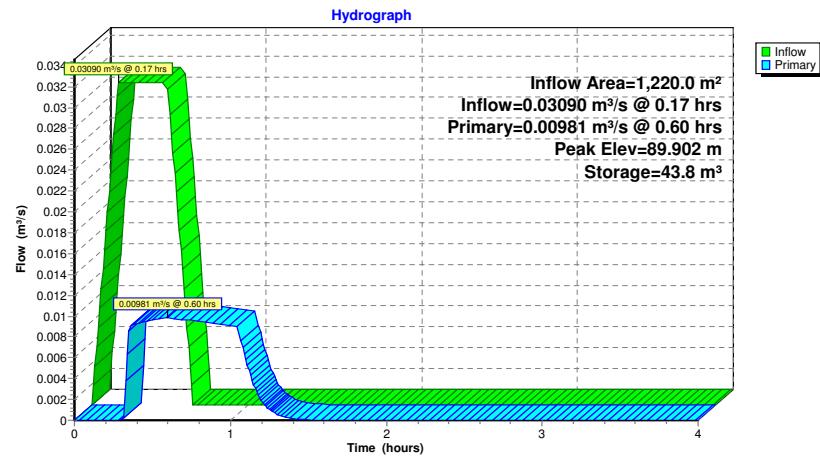
↑ 1=Single OPSD 400.01 (Passes 0.00981 m³/s of 0.19268 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17

Page 20

Pond B2: Bioswale 2

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 21**Summary for Pond B3: Bioswale 3**

Inflow Area = 1,760.0 m², 0.00% Impervious, Inflow Depth = 42 mm for 100-Year event
 Inflow = 0.04275 m³/s @ 0.17 hrs, Volume= 74.4 m³
 Outflow = 0.01852 m³/s @ 0.58 hrs, Volume= 38.8 m³, Atten= 57%, Lag= 24.5 min
 Primary = 0.01852 m³/s @ 0.58 hrs, Volume= 38.8 m³

Routing by Stor-Ind method, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs
 Peak Elev= 89.943 m @ 0.58 hrs Surf.Area= 0.0 m² Storage= 56.3 m³

Plug-Flow detention time= 26.2 min calculated for 38.7 m³ (52% of inflow)
 Center-of-Mass det. time= 19.1 min (38.6 - 19.5)

Volume	Invert	Avail.Storage	Storage Description
#1	88.555 m	120.0 m ³	Custom Stage Data Listed below

Elevation (meters)	Cum.Store (cubic-meters)
88.555	0.0
88.910	7.0
89.060	10.0
89.410	22.0
90.000	60.0
91.000	120.0

Device	Routing	Invert	Outlet Devices
#1	Device 2	89.620 m	Single OPSD 400.01 Head (meters) 0.000 0.050 0.100 0.150 0.200 0.250 0.300 Disch. (m ³ /s) 0.000000 0.010000 0.060000 0.120000 0.160000 0.180000 0.200000
#2	Primary	88.489 m	HYDROVEX 125-VHV-2 X 0.82 Head (meters) 0.000 0.200 0.600 1.000 1.500 2.000 2.500 3.500 4.500 6.000 Disch. (m ³ /s) 0.000000 0.000100 0.014000 0.018500 0.023000 0.027000 0.030000 0.035500 0.040000 0.046000

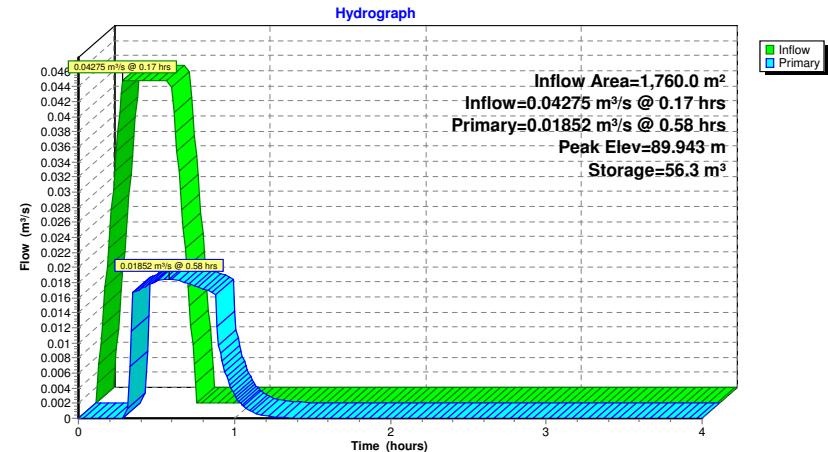
Primary OutFlow Max=0.01852 m³/s @ 0.58 hrs HW=89.943 m (Free Discharge)

↑ 2=HYDROVEX 125-VHV-2 (Custom Controls 0.01852 m³/s)

↑ 1=Single OPSD 400.01 (Passes 0.01852 m³/s of 0.20910 m³/s potential flow)

20220217_TeronRdPrepared by WSP Canada inc.
HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Printed 2022-02-17
Page 22**Pond B3: Bioswale 3**

20220217_TeronRd

Ottawa 100-Year Duration=29 min, Inten=94.0 mm/hr

Prepared by WSP Canada inc.

Printed 2022-02-17

HydroCAD® 10.00-22 s/n 10697 © 2018 HydroCAD Software Solutions LLC

Page 23

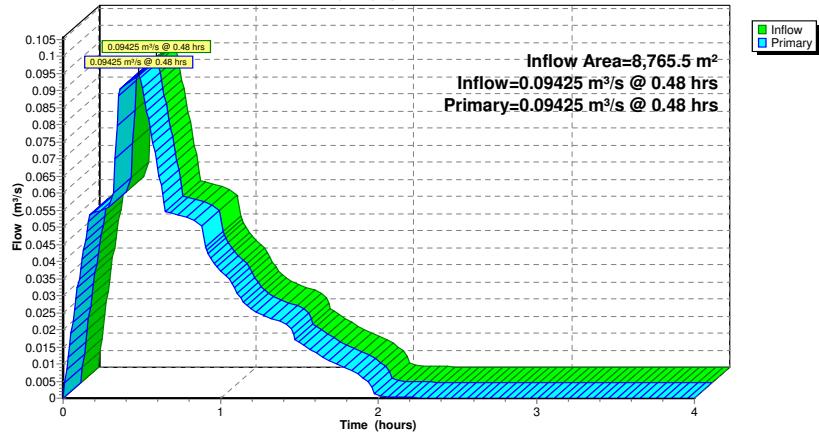
Summary for Link 2L: Ditch

Inflow Area = 8,765.5 m², 38.56% Impervious, Inflow Depth = 31 mm for 100-Year event
Inflow = 0.09425 m³/s @ 0.48 hrs, Volume= 270.8 m³
Primary = 0.09425 m³/s @ 0.48 hrs, Volume= 270.8 m³, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-4.00 hrs, dt= 0.01 hrs

Link 2L: Ditch

Hydrograph



APPENDIX

D OGS Sizing

STORMCEPTOR®
ESTIMATED NET ANNUAL SEDIMENT (TSS) LOAD REDUCTION

02/17/2022

Province:	Ontario
City:	Ottawa
Nearest Rainfall Station:	OTTAWA CDA RCS
Climate Station Id:	6105978
Years of Rainfall Data:	20

Site Name:	1151 - 1131 Teron Road
Drainage Area (ha):	0.88
Runoff Coefficient 'c':	0.77

Particle Size Distribution:	Fine
Target TSS Removal (%):	80.0

Required Water Quality Runoff Volume Capture (%):	90.00
Estimated Water Quality Flow Rate (L/s):	22.98
Oil / Fuel Spill Risk Site?	Yes
Upstream Flow Control?	Yes
Upstream Orifice Control Flow Rate to Stormceptor (L/s):	109.00
Peak Conveyance (maximum) Flow Rate (L/s):	
Site Sediment Transport Rate (kg/ha/yr):	

Project Name:	1151 - 1131 Teron Road
Project Number:	20M-01534-00
Designer Name:	Kathryn Kerker
Designer Company:	WSP
Designer Email:	kathryn.kerker@wsp.com
Designer Phone:	613-690-1206
EOR Name:	
EOR Company:	
EOR Email:	
EOR Phone:	

**Net Annual Sediment
(TSS) Load Reduction
Sizing Summary**

Stormceptor Model	TSS Removal Provided (%)
EFO4	71
EFO6	83
EFO8	90
EFO10	94
EFO12	97

Recommended Stormceptor EFO Model: **EFO6**

Estimated Net Annual Sediment (TSS) Load Reduction (%): **83**

Water Quality Runoff Volume Capture (%): **> 90**

THIRD-PARTY TESTING AND VERIFICATION

► Stormceptor® EF and Stormceptor® EFO are the latest evolutions in the Stormceptor® oil-grit separator (OGS) technology series, and are designed to remove a wide variety of pollutants from stormwater and snowmelt runoff. These technologies have been third-party tested in accordance with the Canadian ETV Procedure for Laboratory Testing of Oil-Grit Separators and performance has been third-party verified in accordance with the ISO 14034 Environmental Technology Verification (ETV) protocol.

PERFORMANCE

► Stormceptor® EF and EFO remove stormwater pollutants through gravity separation and floatation, and feature a patent-pending design that generates positive removal of total suspended solids (TSS) throughout each storm event, including high-intensity storms. Captured pollutants include sediment, free oils, and sediment-bound pollutants such as nutrients, heavy metals, and petroleum hydrocarbons. Stormceptor is sized to remove a high level of TSS from the frequent rainfall events that contribute the vast majority of annual runoff volume and pollutant load. The technology incorporates an internal bypass to convey excessive stormwater flows from high-intensity storms through the device without resuspension and washout (scour) of previously captured pollutants. Proper routine maintenance ensures high pollutant removal performance and protection of downstream waterways.

PARTICLE SIZE DISTRIBUTION (PSD)

► The Canadian ETV PSD shown in the table below was used, or in part, for this sizing. This is the identical PSD that is referenced in the Canadian ETV Procedure for Laboratory Testing of Oil-Grit Separators for both sediment removal testing and scour testing. The Canadian ETV PSD contains a wide range of particle sizes in the sand and silt fractions, and is considered reasonably representative of the particle size fractions found in typical urban stormwater runoff.

Particle Size (μm)	Percent Less Than	Particle Size Fraction (μm)	Percent
1000	100	500-1000	5
500	95	250-500	5
250	90	150-250	15
150	75	100-150	15
100	60	75-100	10
75	50	50-75	5
50	45	20-50	10
20	35	8-20	15
8	20	5-8	10
5	10	2-5	5
2	5	<2	5



Stormceptor® EF Sizing Report

Upstream Flow Controlled Results

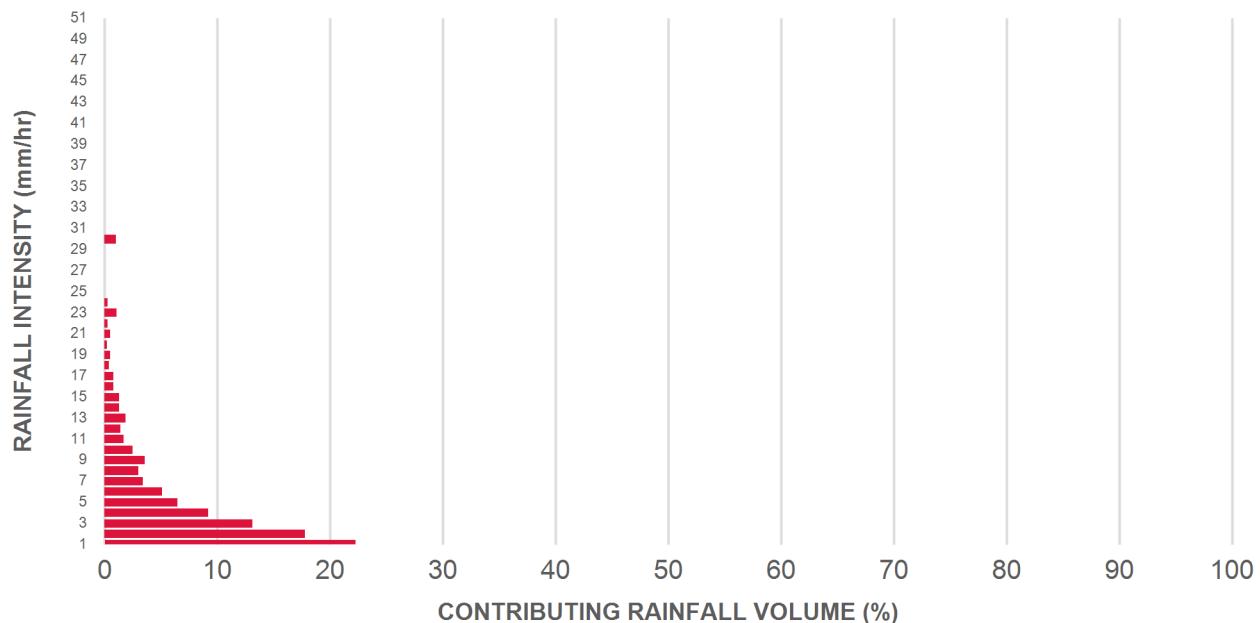
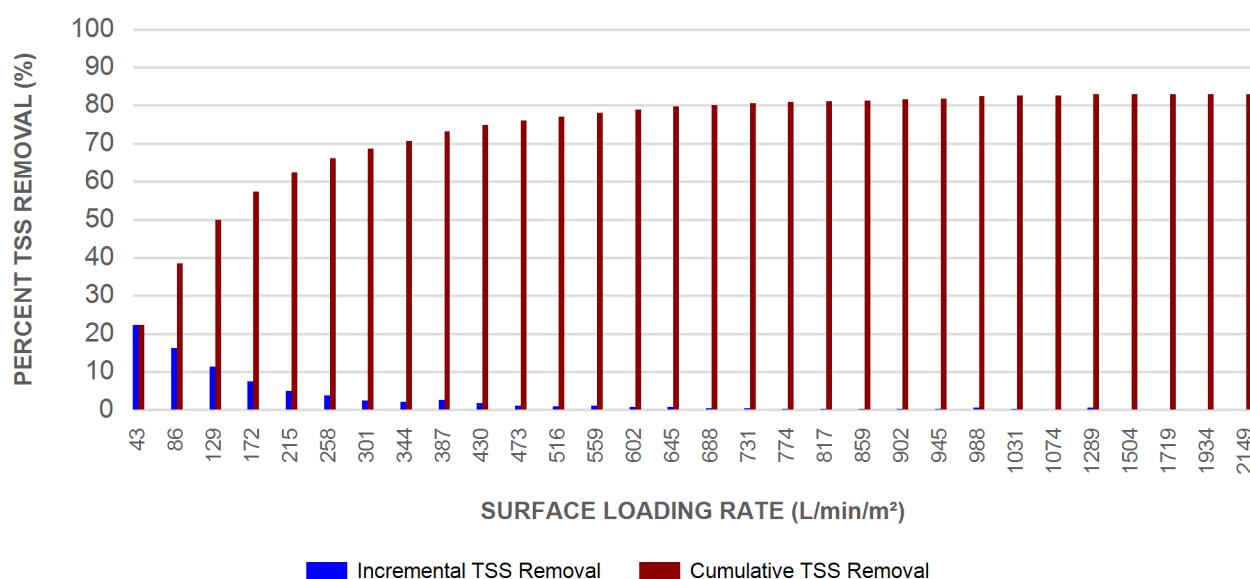
Rainfall Intensity (mm / hr)	Percent Rainfall Volume (%)	Cumulative Rainfall Volume (%)	Flow Rate (L/s)	Flow Rate (L/min)	Surface Loading Rate (L/min/m²)	Removal Efficiency (%)	Incremental Removal (%)	Cumulative Removal (%)
1	22.3	22.3	1.88	113.0	43.0	100	22.3	22.3
2	17.8	40.0	3.77	226.0	86.0	91	16.2	38.5
3	13.1	53.1	5.65	339.0	129.0	87	11.4	49.9
4	9.2	62.4	7.53	452.0	172.0	81	7.5	57.3
5	6.5	68.9	9.42	565.0	215.0	77	5.0	62.3
6	5.1	74.0	11.30	678.0	258.0	75	3.8	66.1
7	3.4	77.3	13.19	791.0	301.0	73	2.4	68.6
8	3.0	80.3	15.07	904.0	344.0	71	2.1	70.7
9	3.6	84.0	16.95	1017.0	387.0	69	2.5	73.2
10	2.5	86.5	18.84	1130.0	430.0	67	1.7	74.9
11	1.7	88.2	20.72	1243.0	473.0	66	1.1	76.0
12	1.4	89.6	22.60	1356.0	516.0	64	0.9	77.0
13	1.9	91.5	24.49	1469.0	559.0	62	1.2	78.1
14	1.3	92.8	26.37	1582.0	602.0	60	0.8	78.9
15	1.3	94.1	28.26	1695.0	645.0	60	0.8	79.7
16	0.8	94.9	30.14	1808.0	688.0	59	0.5	80.1
17	0.8	95.7	32.02	1921.0	731.0	59	0.5	80.6
18	0.4	96.1	33.91	2034.0	774.0	59	0.3	80.9
19	0.5	96.6	35.79	2147.0	817.0	59	0.3	81.1
20	0.2	96.8	37.67	2260.0	859.0	58	0.1	81.3
21	0.5	97.3	39.56	2373.0	902.0	58	0.3	81.6
22	0.3	97.6	41.44	2487.0	945.0	58	0.2	81.7
23	1.1	98.7	43.33	2600.0	988.0	57	0.6	82.4
24	0.3	99.0	45.21	2713.0	1031.0	57	0.2	82.5
25	1.0	100.0	47.09	2826.0	1074.0	56	0.6	83.1
30	1.0	101.0	56.51	3391.0	1289.0	51	0.5	83.6
35	-1.0	100.0	65.93	3956.0	1504.0	45	N/A	83.2
40	0.0	100.0	75.35	4521.0	1719.0	40	0.0	83.2
45	0.0	100.0	84.77	5086.0	1934.0	35	0.0	83.2
50	0.0	100.0	94.19	5651.0	2149.0	32	0.0	83.2
Estimated Net Annual Sediment (TSS) Load Reduction =							83 %	

Climate Station ID: 6105978 Years of Rainfall Data: 20



Stormceptor® EF Sizing Report

RAINFALL DATA FROM OTTAWA CDA RCS RAINFALL STATION

INCREMENTAL AND CUMULATIVE TSS REMOVAL
FOR THE RECOMMENDED STORMCEPTOR® MODEL

Stormceptor® EF Sizing Report

Maximum Pipe Diameter / Peak Conveyance

Stormceptor EF / EFO	Model Diameter		Min Angle Inlet / Outlet Pipes	Max Inlet Pipe Diameter		Max Outlet Pipe Diameter		Peak Conveyance Flow Rate	
	(m)	(ft)		(mm)	(in)	(mm)	(in)	(L/s)	(cfs)
EF4 / EFO4	1.2	4	90	609	24	609	24	425	15
EF6 / EFO6	1.8	6	90	914	36	914	36	990	35
EF8 / EFO8	2.4	8	90	1219	48	1219	48	1700	60
EF10 / EFO10	3.0	10	90	1828	72	1828	72	2830	100
EF12 / EFO12	3.6	12	90	1828	72	1828	72	2830	100

SCOUR PREVENTION AND ONLINE CONFIGURATION

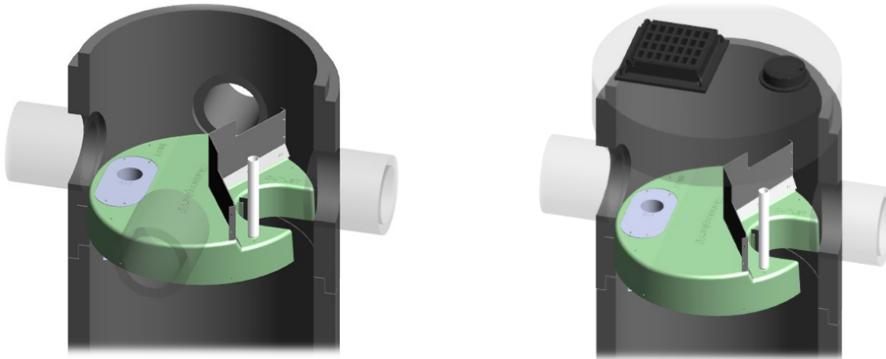
► Stormceptor® EF and EFO feature an internal bypass and superior scour prevention technology that have been demonstrated in third-party testing according to the scour testing provisions of the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators**, and the exceptional scour test performance has been third-party verified in accordance with the ISO 14034 ETV protocol. As a result, Stormceptor EF and EFO are approved for online installation, eliminating the need for costly additional bypass structures, piping, and installation expense.

DESIGN FLEXIBILITY

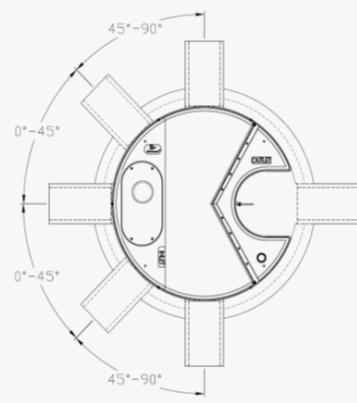
► Stormceptor® EF and EFO offers design flexibility in one simplified platform, accepting stormwater flow from a single inlet pipe or multiple inlet pipes, and/or surface runoff through an inlet grate. The device can also serve as a junction structure, accommodate a 90-degree inlet-to-outlet bend angle, and can be modified to ensure performance in submerged conditions.

OIL CAPTURE AND RETENTION

► While Stormceptor® EF will capture and retain oil from dry weather spills and low intensity runoff, Stormceptor® EFO has demonstrated superior oil capture and greater than 99% oil retention in third-party testing according to the light liquid re-entrainment testing provisions of the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators**. Stormceptor EFO is recommended for sites where oil capture and retention is a requirement.



Stormceptor® EF Sizing Report



INLET-TO-OUTLET DROP

Elevation differential between inlet and outlet pipe inverts is dictated by the angle at which the inlet pipe(s) enters the unit.

0° - 45° : The inlet pipe is 1-inch (25mm) higher than the outlet pipe.

45° - 90° : The inlet pipe is 2-inches (50mm) higher than the outlet pipe.

HEAD LOSS

The head loss through Stormceptor EF is similar to that of a 60-degree bend structure. The applicable K value for calculating minor losses through the unit is 1.1. For submerged conditions the applicable K value is 3.0.

Pollutant Capacity

Stormceptor EF / EFO	Model Diameter		Depth (Outlet Pipe Invert to Sump Floor)		Oil Volume		Recommended Sediment Maintenance Depth *		Maximum Sediment Volume * *		Maximum Sediment Mass **	
	(m)	(ft)	(m)	(ft)	(L)	(Gal)	(mm)	(in)	(L)	(ft³)	(kg)	(lb)
EF4 / EFO4	1.2	4	1.52	5.0	265	70	203	8	1190	42	1904	5250
EF6 / EFO6	1.8	6	1.93	6.3	610	160	305	12	3470	123	5552	15375
EF8 / EFO8	2.4	8	2.59	8.5	1070	280	610	24	8780	310	14048	38750
EF10 / EFO10	3.0	10	3.25	10.7	1670	440	610	24	17790	628	28464	78500
EF12 / EFO12	3.6	12	3.89	12.8	2475	655	610	24	31220	1103	49952	137875

*Increased sump depth may be added to increase sediment storage capacity

** Average density of wet packed sediment in sump = 1.6 kg/L (100 lb/ft³)

Feature	Benefit	Feature Appeals To
Patent-pending enhanced flow treatment and scour prevention technology	Superior, verified third-party performance	Regulator, Specifying & Design Engineer
Third-party verified light liquid capture and retention for EFO version	Proven performance for fuel/oil hotspot locations	Regulator, Specifying & Design Engineer, Site Owner
Functions as bend, junction or inlet structure	Design flexibility	Specifying & Design Engineer
Minimal drop between inlet and outlet	Site installation ease	Contractor
Large diameter outlet riser for inspection and maintenance	Easy maintenance access from grade	Maintenance Contractor & Site Owner

STANDARD STORMCEPTOR EF/EFO DRAWINGS

For standard details, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

STANDARD STORMCEPTOR EF/EFO SPECIFICATION

For specifications, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>



STANDARD PERFORMANCE SPECIFICATION FOR “OIL GRIT SEPARATOR” (OGS) STORMWATER QUALITY TREATMENT DEVICE

PART 1 – GENERAL

1.1 WORK INCLUDED

This section specifies requirements for selecting, sizing, and designing an underground Oil Grit Separator (OGS) device for stormwater quality treatment, with third-party testing results and a Statement of Verification in accordance with ISO 14034 Environmental Management – Environmental Technology Verification (ETV).

1.2 REFERENCE STANDARDS & PROCEDURES

ISO 14034:2016 Environmental management – Environmental technology verification (ETV)

Canadian Environmental Technology Verification (ETV) Program's **Procedure for Laboratory Testing of Oil-Grit Separators**

1.3 SUBMITTALS

1.3.1 All submittals, including sizing reports & shop drawings, shall be submitted upon request with each order to the contractor then forwarded to the Engineer of Record for review and acceptance. Shop drawings shall detail all OGS components, elevations, and sequence of construction.

1.3.2 Alternative devices shall have features identical to or greater than the specified device, including: treatment chamber diameter, treatment chamber wet volume, sediment storage volume, and oil storage volume.

1.3.3 Unless directed otherwise by the Engineer of Record, OGS stormwater quality treatment product substitutions or alternatives submitted within ten days prior to project bid shall not be accepted. All alternatives or substitutions submitted shall be signed and sealed by a local registered Professional Engineer, based on the exact same criteria detailed in Section 3, in entirety, subject to review and approval by the Engineer of Record.

PART 2 – PRODUCTS

2.1 OGS POLLUTANT STORAGE

The OGS device shall include a sump for sediment storage, and a protected volume for the capture and storage of petroleum hydrocarbons and buoyant gross pollutants. The minimum sediment & petroleum hydrocarbon storage capacity shall be as follows:

2.1.1	4 ft (1219 mm) Diameter OGS Units:	1.19 m ³ sediment / 265 L oil
	6 ft (1829 mm) Diameter OGS Units:	3.48 m ³ sediment / 609 L oil
	8 ft (2438 mm) Diameter OGS Units:	8.78 m ³ sediment / 1,071 L oil
	10 ft (3048 mm) Diameter OGS Units:	17.78 m ³ sediment / 1,673 L oil
	12 ft (3657 mm) Diameter OGS Units:	31.23 m ³ sediment / 2,476 L oil

PART 3 – PERFORMANCE & DESIGN

3.1 GENERAL

The OGS stormwater quality treatment device shall be verified in accordance with ISO 14034:2016 Environmental management – Environmental technology verification (ETV). The OGS stormwater quality treatment device shall



Stormceptor® EF Sizing Report

remove oil, sediment and gross pollutants from stormwater runoff during frequent wet weather events, and retain these pollutants during less frequent high flow wet weather events below the insert within the OGS for later removal during maintenance. The Manufacturer shall have at least ten (10) years of local experience, history and success in engineering design, manufacturing and production and supply of OGS stormwater quality treatment device systems, acceptable to the Engineer of Record.

3.2 SIZING METHODOLOGY

The OGS device shall be engineered, designed and sized to provide stormwater quality treatment based on treating a minimum of 90 percent of the average annual runoff volume and a minimum removal of an annual average 60% of the sediment (TSS) load based on the Particle Size Distribution (PSD) specified in the sizing report for the specified device. Sizing of the OGS shall be determined by use of a minimum ten (10) years of local historical rainfall data provided by Environment Canada, and only rainfall intensities greater than 0.5 mm/hr shall be included in sizing calculations. Sizing shall also be determined by use of the sediment removal performance data derived from the ISO 14034 ETV third-party verified laboratory testing data from testing conducted in accordance with the Canadian ETV protocol Procedure for Laboratory Testing of Oil-Grit Separators, as follows:

3.2.1 Sediment removal efficiency for a given surface loading rate and its associated flow rate shall be based on sediment removal efficiency demonstrated at the seven (7) tested surface loading rates specified in the protocol, ranging 40 L/min/m² to 1400 L/min/m², and as stated in the ISO 14034 ETV Verification Statement for the OGS device.

3.2.2 Sediment removal efficiency for surface loading rates between 40 L/min/m² and 1400 L/min/m² shall be based on linear interpolation of data between consecutive tested surface loading rates.

3.2.3 Sediment removal efficiency for surface loading rates less than the lowest tested surface loading rate of 40 L/min/m² shall be assumed to be identical to the sediment removal efficiency at 40 L/min/m². No extrapolation shall be allowed that results in a sediment removal efficiency that is greater than that demonstrated at 40 L/min/m².

3.2.4 Sediment removal efficiency for surface loading rates greater than the highest tested surface loading rate of 1400 L/min/m² shall assume zero sediment removal for the portion of flow that exceeds 1400 L/min/m², and shall be calculated using a simple proportioning formula, with 1400 L/min/m² in the numerator and the higher surface loading rate in the denominator, and multiplying the resulting fraction times the sediment removal efficiency at 1400 L/min/m².

The OGS device shall also have sufficient annual sediment storage capacity as specified and calculated in Section 2.1.

3.3 CANADIAN ETV or ISO 14034 ETV VERIFICATION OF SCOUR TESTING

The OGS device shall have Canadian ETV or ISO 14034 ETV Verification of third-party scour testing conducted in accordance with the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**.

3.3.1 To be acceptable for on-line installation, the OGS device must demonstrate an average scour test effluent concentration less than 10 mg/L at each surface loading rate tested, up to and including 2600 L/min/m².

3.4 LIGHT LIQUID RE-ENTRAINMENT SIMULATION TESTING

The OGS device shall have Canadian ETV or ISO 14034 ETV Verification of completed third-party Light Liquid Re-entrainment Simulation Testing in accordance with the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**, with results reported within the Canadian ETV or ISO 14034 ETV verification. This re-entrainment testing is conducted with the device pre-loaded with low density polyethylene (LDPE) plastic beads as a



Stormceptor® EF Sizing Report

surrogate for light liquids such as oil and fuel. Testing is conducted on the same OGS unit tested for sediment removal to assess whether light liquids captured after a spill are effectively retained at high flow rates.

3.4.1 For an OGS device to be an acceptable stormwater treatment device on a site where vehicular traffic occurs and the potential for an oil or fuel spill exists, the OGS device must have reported verified performance results of greater than 99% cumulative retention of LDPE plastic beads for the five specified surface loading rates (ranging 200 L/min/m² to 2600 L/min/m²) in accordance with the Light Liquid Re-entrainment Simulation Testing within the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**. However, an OGS device shall not be allowed if the Light Liquid Re-entrainment Simulation Testing was performed with screening components within the OGS device that are effective at retaining the LDPE plastic beads, but would not be expected to retain light liquids such as oil and fuel.



APPENDIX

E

Storage Calculations



Project:	1131-1151 Teron Road	No.:	20M 01534-00
By:	KK	Date:	2022-02-18
Checked:	JZ	Checked:	2022-02-18

Subject: **STORAGE CALCULATIONS**

Building Roofs

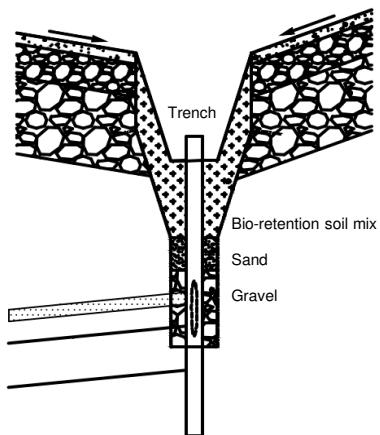
Building 1

Roof Drain #	Drainage Area (m2)	Total Volume (m3)
1	99	5.0
2	164	8.2
3	212	10.6
4	80	4.0
5	56	2.8
6	58	2.9
7	77	3.9
8	71	3.6
9	56	2.8
10	69	3.5
	Total	47.1

Building 2

Roof Drain #	Drainage Area (m2)	Total Volume (m3)
13	120	6.0
14	61	1.8
15	65	2.0
16	64	1.9
17	131	6.6
18	72	2.2
	Total	20.4

Subject: STORAGE CALCULATIONS

Bioswale Storage
Cross section

Bioretention soil mix (m) 0.35
 Sand (m) 0.15
 Gravel (m) 0.35
 Void ratio 0.4

	Bioswale 1	Bioswale 2	Bioswale 3
Top Width (m)	7.33	5.00	5.02
Bottom Width (m)	2.02	2.01	2.04
Top elevation (m)	90.00	90.00	90.00
Bottom elevation (m)	89.62	89.62	89.62
Trench depth (m)	0.38	0.38	0.38
Surface Area (m ²)	57.6	41.0	50.2
Gravel area (m ²)	0.3	0.3	0.3
Sand area (m ²)	0.1	0.1	0.1
Bioretention soil mix area (m ²)	1.0	0.7	0.7
Trench area (m ²)	1.8	1.3	1.3
Cross-sectional area (m ²)	3.2	2.4	2.5
Trench length (m)	28.5	20.4	24.6
Volume (m³)	91	50	60

Stage (m)	Storage (m ³)		
	Bioswale 1	Bioswale 2	Bioswale 3
0	0	0	0
0.35	8	6	7
0.50	12	8	10
0.85	29	18	22
1.23	91	50	60

APPENDIX

F

Product Specifications



Adjustable Accutrol Weir
Tag: _____

**Adjustable Flow Control
for Roof Drains**

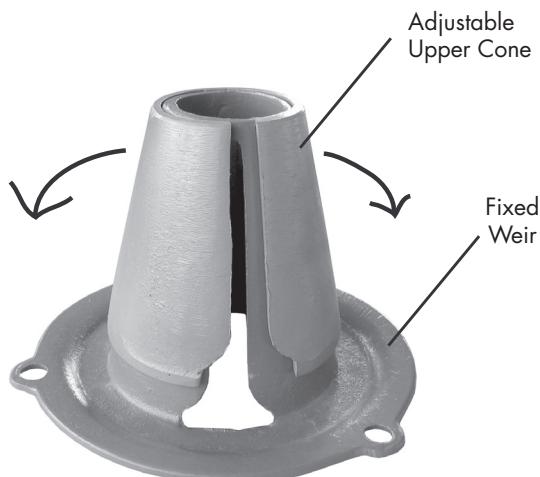
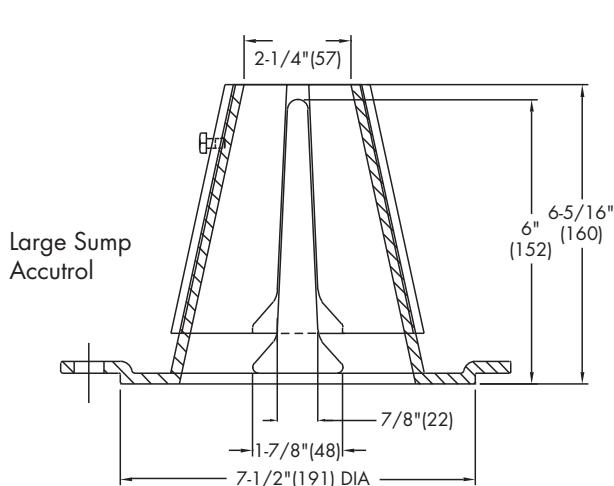
ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.
Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
[5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.



1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____

Contractor _____

Job Location _____

Contractor's P.O. No. _____

Engineer _____

Representative _____

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.



USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com

A Watts Water Technologies Company

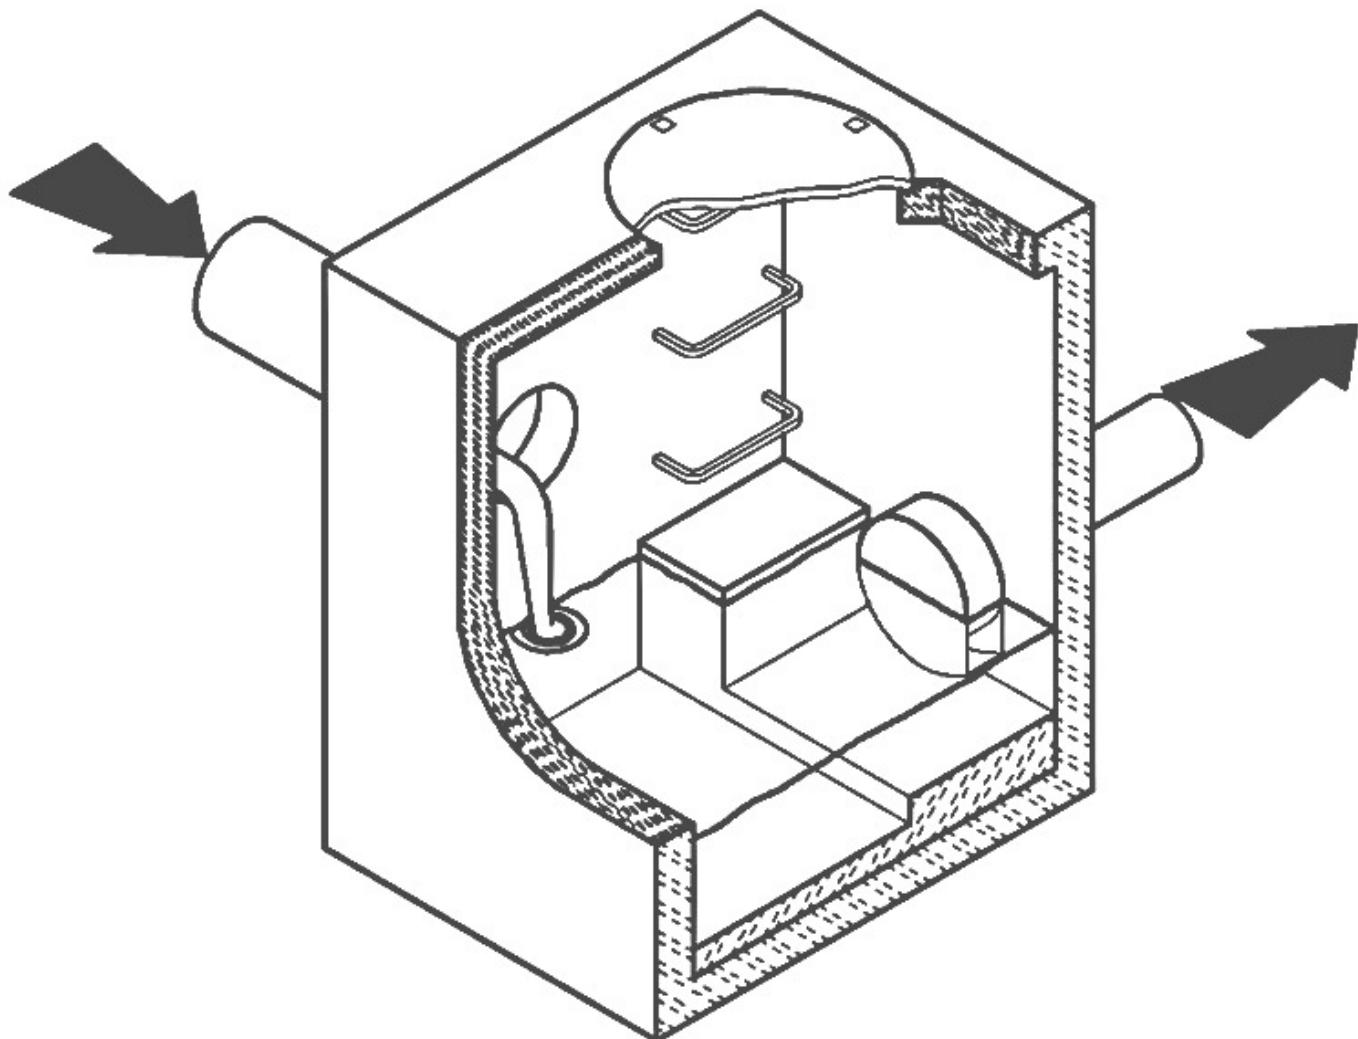
Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca

Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com

CSO/STORMWATER MANAGEMENT



HYDROVEX® VHV / SVHV
Vertical Vortex Flow Regulator



JOHN MEUNIER

HYDROVEX® VHV / SVHV VERTICAL VORTEX FLOW REGULATOR

APPLICATIONS

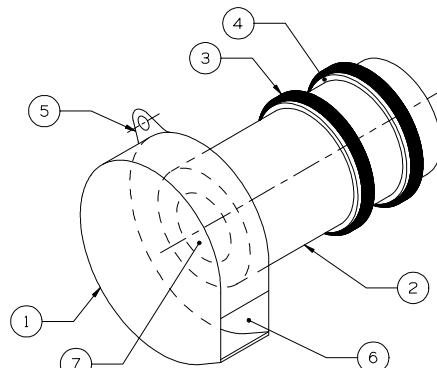
One of the major problems of urban wet weather flow management is the runoff generated after a heavy rainfall. During a storm, uncontrolled flows may overload the drainage system and cause flooding. Due to increased velocities, sewer pipe wear is increased dramatically and results in network deterioration. In a combined sewer system, the wastewater treatment plant may also experience significant increases in flows during storms, thereby losing its treatment efficiency.

A simple means of controlling excessive water runoff is by controlling excessive flows at their origin (manholes). **John Meunier Inc.** manufactures the **HYDROVEX® VHV / SVHV** line of vortex flow regulators to control stormwater flows in sewer networks, as well as manholes.

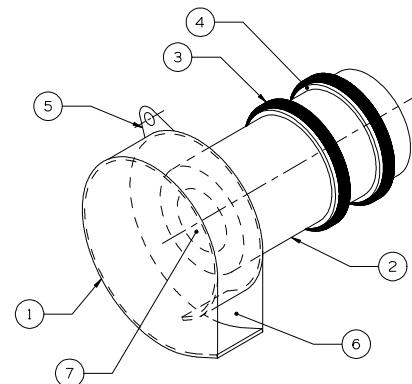
The vortex flow regulator design is based on the fluid mechanics principle of the forced vortex. This grants flow regulation without any moving parts, thus reducing maintenance. The operation of the regulator, depending on the upstream head and discharge, switches between orifice flow (gravity flow) and vortex flow. Although the concept is quite simple, over 12 years of research have been carried out in order to get a high performance.

The **HYDROVEX® VHV / SVHV** Vertical Vortex Flow Regulators (**refer to Figure 1**) are manufactured entirely of stainless steel, and consist of a hollow body (1) (in which flow control takes place) and an outlet orifice (7). Two rubber "O" rings (3) seal and retain the unit inside the outlet pipe. Two stainless steel retaining rings (4) are welded on the outlet sleeve to ensure that there is no shifting of the "O" rings during installation and use.

- 1. BODY
- 2. SLEEVE
- 3. O-RING
- 4. RETAINING RINGS
(SQUARE BAR)
- 5. ANCHOR PLATE
- 6. INLET
- 7. OUTLET ORIFICE



VHV



SVHV

FIGURE 1: HYDROVEX® VHV-SVHV VERTICAL VORTREX FLOW REGULATORS

ADVANTAGES

- The **HYDROVEX® VHV / SVHV** line of flow regulators are manufactured entirely of stainless steel, making them durable and corrosion resistant.
- Having no moving parts, they require minimal maintenance.
- The geometry of the **HYDROVEX® VHV / SVHV** flow regulators allows a control equal to an orifice plate, having a cross section area 4 to 6 times smaller. This decreases the chance of blockage of the regulator, due to sediments and debris found in stormwater flows. **Figure 2** illustrates the comparison between a regulator model 100 SVHV-2 and an equivalent orifice plate. One can see that for the same height of water, the regulator controls a flow approximately four times smaller than an equivalent orifice plate.
- Installation of the **HYDROVEX® VHV / SVHV** flow regulators is quick and straightforward and is performed after all civil works are completed.
- Installation requires no special tools or equipment and may be carried out by any contractor.
- Installation may be carried out in existing structures.

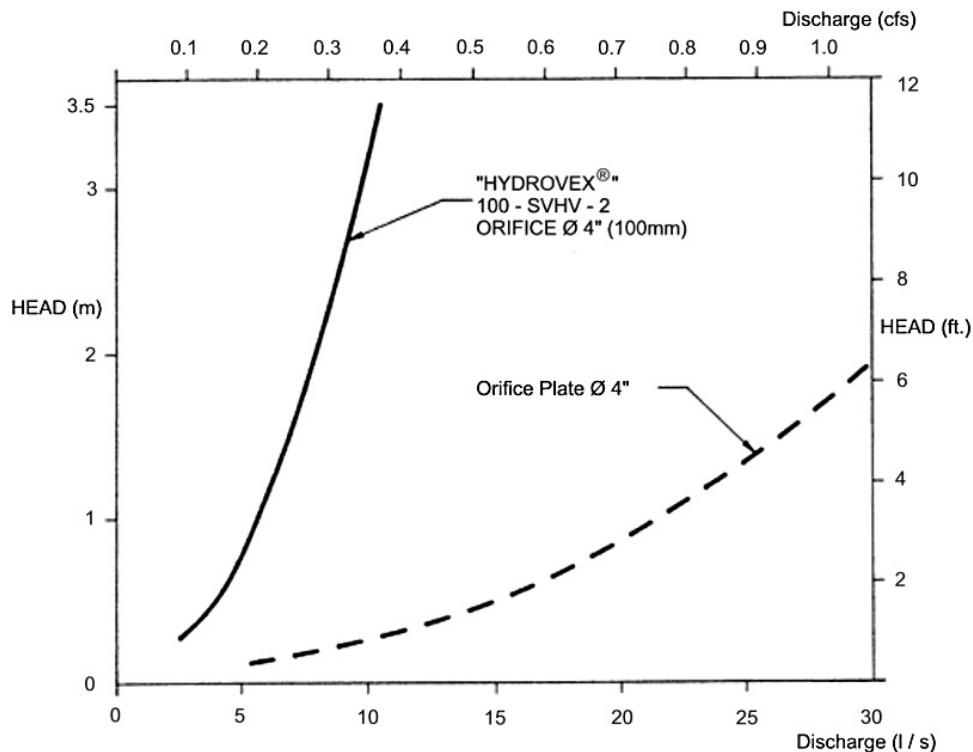


FIGURE 2: DISCHARGE CURVE SHOWING A HYDROVEX® FLOW REGULATOR VS AN ORIFICE PLATE

SELECTION

Selection of a **VHV** or **SVHV** regulator can be easily made using the selection charts found at the back of this brochure (see **Figure 3**). These charts are a graphical representation of the maximum upstream water pressure (head) and the maximum discharge at the manhole outlet. The maximum design head is the difference between the maximum upstream water level and the invert of the outlet pipe. All selections should be verified by John Meunier Inc. personnel prior to fabrication.

Example:

- ✓ Maximum design head 2m (6.56 ft.)
- ✓ Maximum discharge 6 L/s (0.2 cfs)
- ✓ Using **Figure 3 - VHV** model required is a **75 VHV-1**

INSTALLATION REQUIREMENTS

All **HYDROVEX® VHV / SVHV** flow regulators can be installed in circular or square manholes. **Figure 4** gives the various minimum dimensions required for a given regulator. ***It is imperative to respect the minimum clearances shown to ensure easy installation and proper functioning of the regulator.***

SPECIFICATIONS

In order to specify a **HYDROVEX®** regulator, the following parameters must be defined:

- The model number (ex: 75-VHV-1)
- The diameter and type of outlet pipe (ex: 6" diam. SDR 35)
- The desired discharge (ex: 6 l/s or 0.21 CFS)
- The upstream head (ex: 2 m or 6.56 ft.) *
- The manhole diameter (ex: 36" diam.)
- The minimum clearance "H" (ex: 10 inches)
- The material type (ex: 304 s/s, 11 Ga. standard)

* *Upstream head is defined as the difference in elevation between the maximum upstream water level and the invert of the outlet pipe where the HYDROVEX® flow regulator is to be installed.*

PLEASE NOTE THAT WHEN REQUESTING A PROPOSAL, WE SIMPLY REQUIRE THAT YOU PROVIDE US WITH THE FOLLOWING:

- *project design flow rate*
- *pressure head*
- *chamber's outlet pipe diameter and type*



Typical VHV model in factory

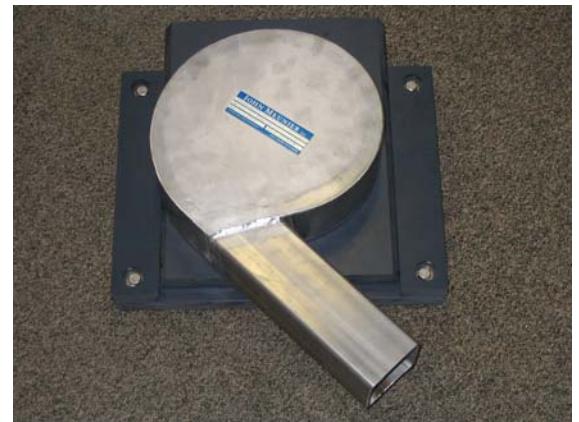
OPTIONS



VHV-1-O (standard model with odour control inlet)



FV – SVHV (mounted on sliding plate)



FV – VHV-O (mounted on sliding plate with odour control inlet)



VHV with Gooseneck assembly in existing chamber without minimum release at the bottom



VHV with air vent for minimal slopes



VHV Vertical Vortex Flow Regulator

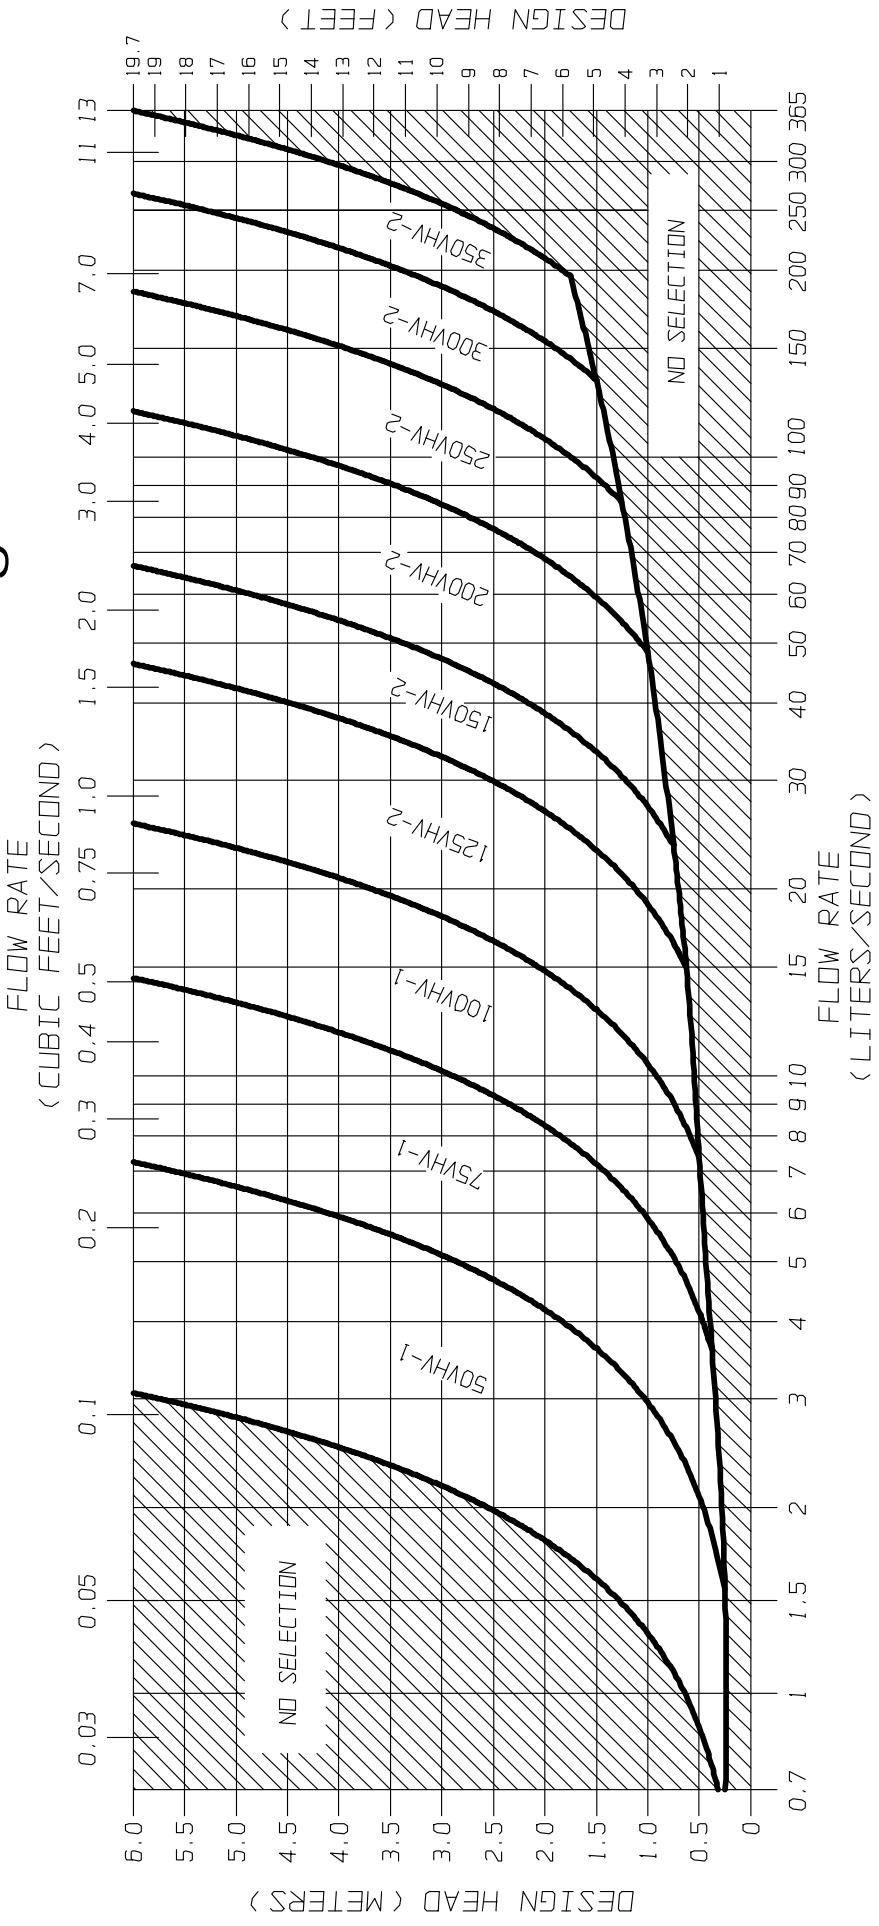


FIGURE 3 - VHV

JOHN MEUNIER



SVHV Vertical Vortex Flow Regulator

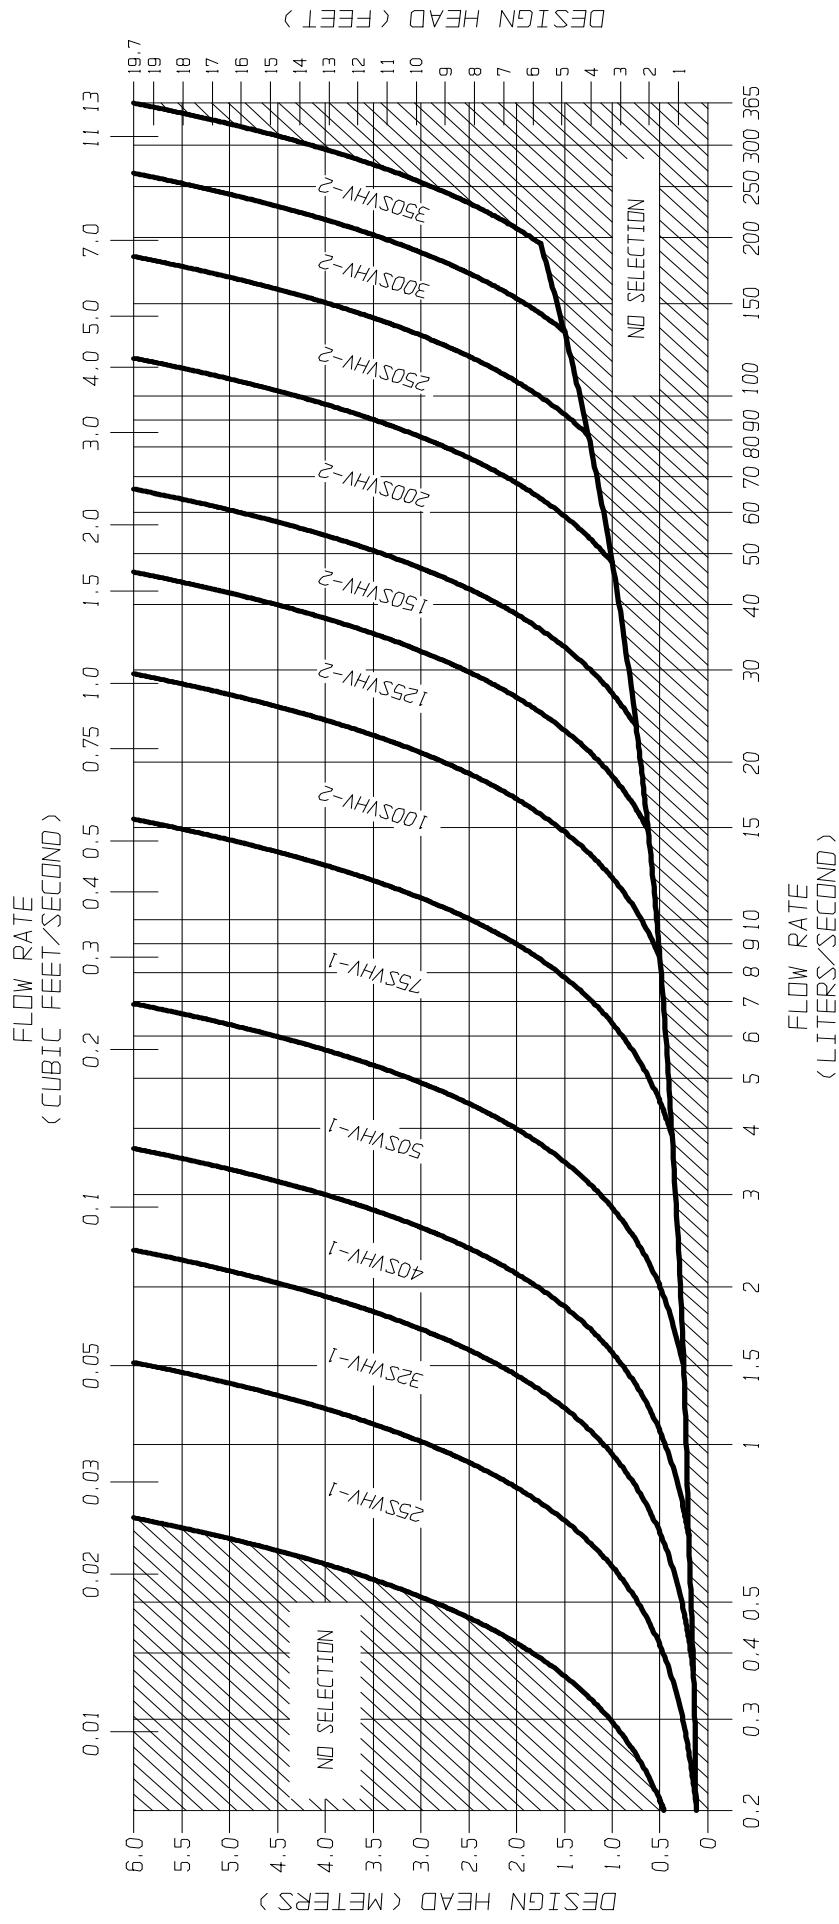
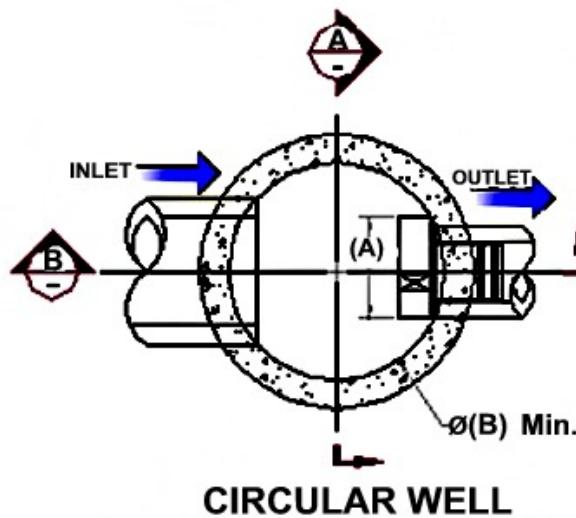


FIGURE 3 - SVHV

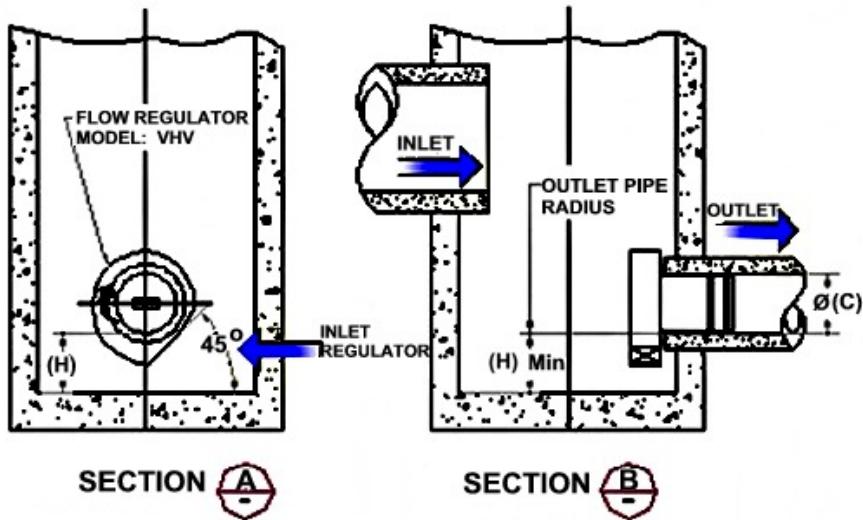
JOHN MEUNIER

FLOW REGULATOR TYPICAL INSTALLATION IN CIRCULAR MANHOLE
FIGURE 4 (MODEL VHV)

Model Number	Regulator Diameter		Minimum Manhole Diameter		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
50VHV-1	150	6	600	24	150	6	150	6
75VHV-1	250	10	600	24	150	6	150	6
100VHV-1	325	13	900	36	150	6	200	8
125VHV-2	275	11	900	36	150	6	200	8
150VHV-2	350	14	900	36	150	6	225	9
200VHV-2	450	18	1200	48	200	8	300	12
250VHV-2	575	23	1200	48	250	10	350	14
300VHV-2	675	27	1600	64	250	10	400	16
350VHV-2	800	32	1800	72	300	12	500	20

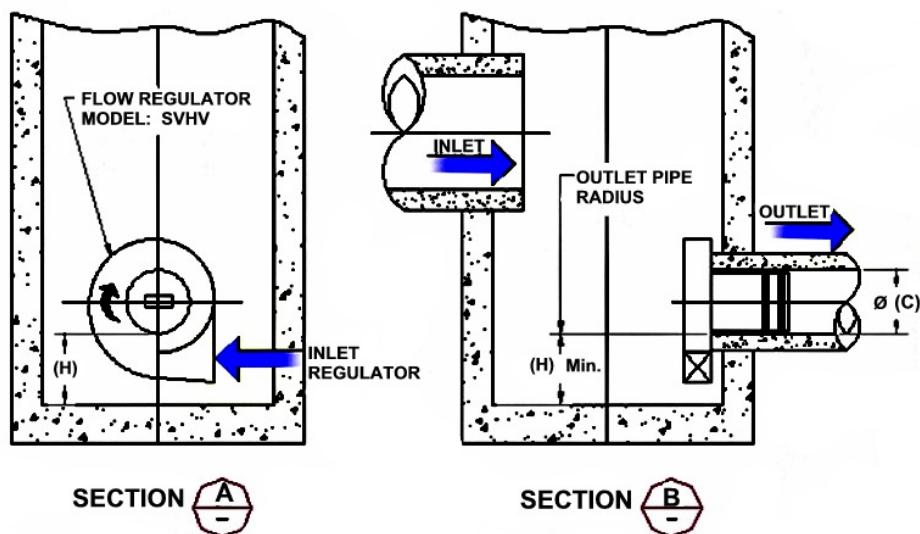
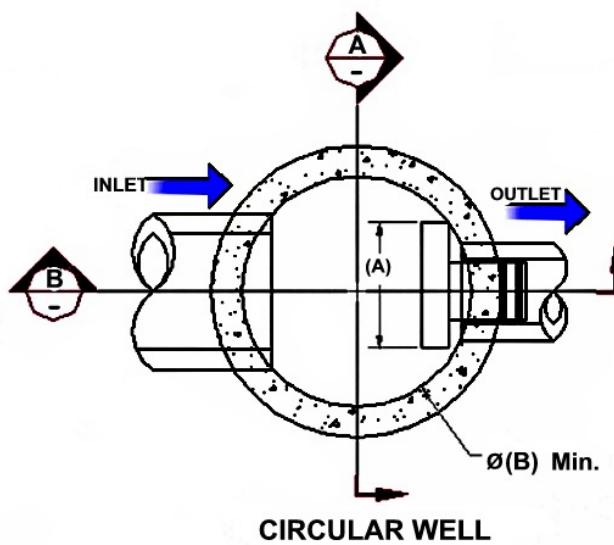


CIRCULAR WELL



FLOW REGULATOR TYPICAL INSTALLATION IN CIRCULAR MANHOLE
FIGURE 4 (MODEL SVHV)

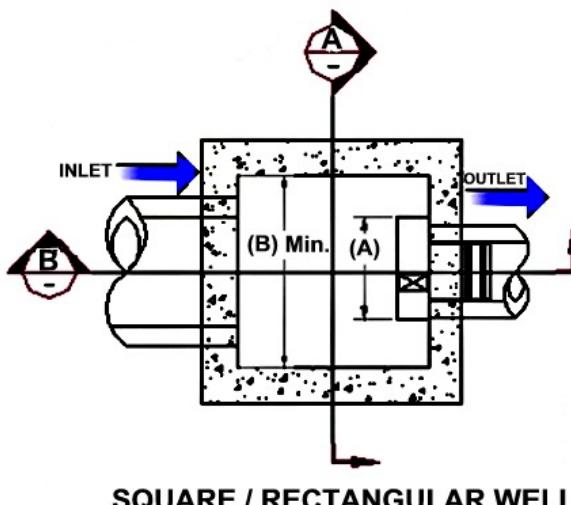
Model Number	Regulator Diameter		Minimum Manhole Diameter		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
25 SVHV-1	125	5	600	24	150	6	150	6
32 SVHV-1	150	6	600	24	150	6	150	6
40 SVHV-1	200	8	600	24	150	6	150	6
50 SVHV-1	250	10	600	24	150	6	150	6
75 SVHV-1	375	15	900	36	150	6	275	11
100 SVHV-2	275	11	900	36	150	6	250	10
125 SVHV-2	350	14	900	36	150	6	300	12
150 SVHV-2	425	17	1200	48	150	6	350	14
200 SVHV-2	575	23	1600	64	200	8	450	18
250 SVHV-2	700	28	1800	72	250	10	550	22
300 SVHV-2	850	34	2400	96	250	10	650	26
350 SVHV-2	1000	40	2400	96	250	10	700	28



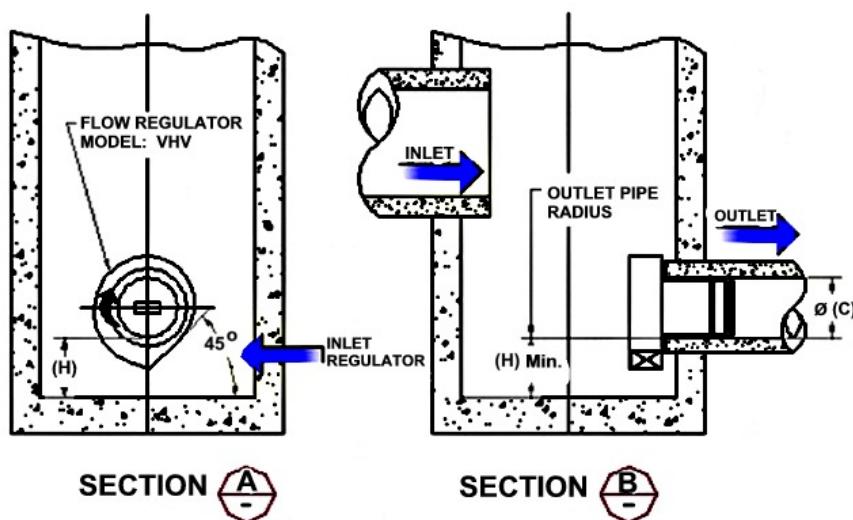
FLOW REGULATOR TYPICAL INSTALLATION IN SQUARE MANHOLE
FIGURE 4 (MODEL VHV)

Model Number	Regulator Diameter		Minimum Chamber Width		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
50VHV-1	150	6	600	24	150	6	150	6
75VHV-1	250	10	600	24	150	6	150	6
100VHV-1	325	13	600	24	150	6	200	8
125VHV-2	275	11	600	24	150	6	200	8
150VHV-2	350	14	600	24	150	6	225	9
200VHV-2	450	18	900	36	200	8	300	12
250VHV-2	575	23	900	36	250	10	350	14
300VHV-2	675	27	1200	48	250	10	400	16
350VHV-2	800	32	1200	48	300	12	500	20

NOTE: In the case of a square manhole, the outlet flow pipe must be centered on the wall to ensure enough clearance for the unit.



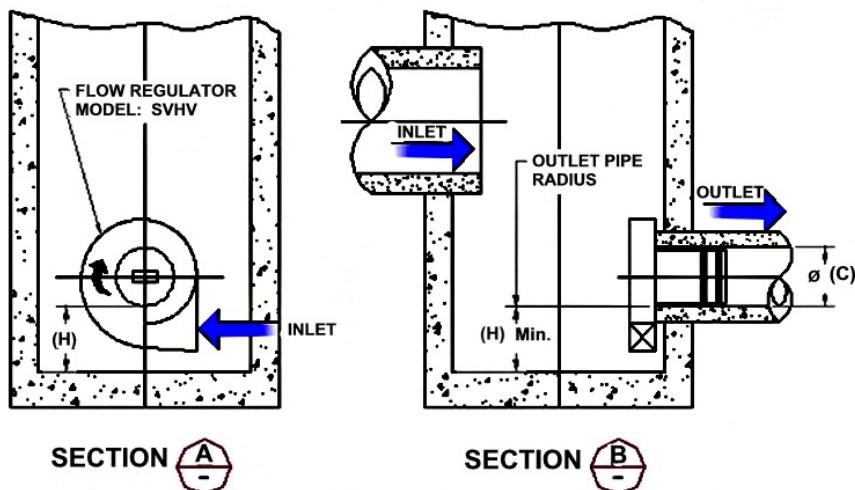
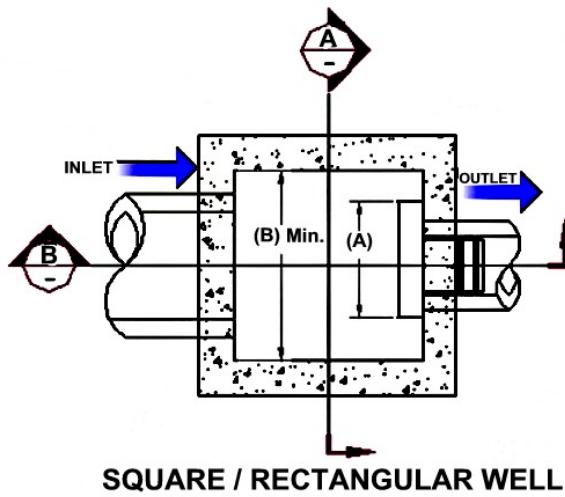
SQUARE / RECTANGULAR WELL



FLOW REGULATOR TYPICAL INSTALLATION IN SQUARE MANHOLE
FIGURE 4 (MODEL SVHV)

Model Number	Regulator Diameter		Minimum Chamber Width		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
25 SVHV-1	125	5	600	24	150	6	150	6
32 SVHV-1	150	6	600	24	150	6	150	6
40 SVHV-1	200	8	600	24	150	6	150	6
50 SVHV-1	250	10	600	24	150	6	150	6
75 SVHV-1	375	15	600	24	150	6	275	11
100 SVHV-2	275	11	600	24	150	6	250	10
125 SVHV-2	350	14	600	24	150	6	300	12
150 SVHV-2	425	17	600	24	150	6	350	14
200 SVHV-2	575	23	900	36	200	8	450	18
250 SVHV-2	700	28	900	36	250	10	550	22
300 SVHV-2	850	34	1200	48	250	10	650	26
350 SVHV-2	1000	40	1200	48	250	10	700	28

NOTE: *In the case of a square manhole, the outlet flow pipe must be centered on the wall to ensure enough clearance for the unit.*



INSTALLATION

The installation of a **HYDROVEX®** regulator may be undertaken once the manhole and piping is in place. Installation consists of simply fitting the regulator into the outlet pipe of the manhole. **John Meunier Inc.** recommends the use of a lubricant on the outlet pipe, in order to facilitate the insertion and orientation of the flow controller.

MAINTENANCE

HYDROVEX® regulators are manufactured in such a way as to be maintenance free; however, a periodic inspection (every 3-6 months) is suggested in order to ensure that neither the inlet nor the outlet has become blocked with debris. The manhole should undergo periodically, particularly after major storms, inspection and cleaning as established by the municipality

GUARANTY

The **HYDROVEX®** line of **VHV / SVHV** regulators are guaranteed against both design and manufacturing defects for a period of 5 years. Should a unit be defective, **John Meunier Inc.** is solely responsible for either modification or replacement of the unit.

John Meunier Inc.

ISO 9001 : 2008

Head Office

4105 Sartelon
Saint-Laurent (Quebec) Canada H4S 2B3
Tel.: 514-334-7230 www.johnmeunier.com
Fax: 514-334-5070 cso@johnmeunier.com

Ontario Office

2000 Argentia Road, Plaza 4, Unit 430
Mississauga (Ontario) Canada L5N 1W1
Tel.: 905-286-4846 www.johnmeunier.com
Fax: 905-286-0488 ontario@johnmeunier.com

USA Office

2209 Menlo Avenue
Glenside, PA USA 19038
Tel.: 412- 417-6614 www.johnmeunier.com
Fax: 215-885-4741 asteale@johnmeunier.com

