

GENERAL NOTES:

- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
- OBTAIN ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA BEFORE COMMENCING CONSTRUCTION.
- BEFORE COMMENCING CONSTRUCTION OBTAIN AND PROVIDE PROOF OF COMPREHENSIVE ALL RISK AND OPERATIONAL LIABILITY INSURANCE FOR \$5,000,000.00. INSURANCE POLICY TO NAME OWNERS, ENGINEERS AND ARCHITECTS AS COINSURED.
- RESTORE ALL DISTURBED AREAS ON-SITE AND OFF-SITE, INCLUDING TRENCHES AND SURFACES ON PUBLIC ROAD ALLOWANCES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE CITY OF OTTAWA AND ENGINEER.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL, ORGANIC MATERIAL AND DEBRIS UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ANY CONTAMINATED MATERIAL. ALL CONTAMINATED MATERIAL SHALL BE DISPOSED OF AT A LICENSED LANDFILL FACILITY.
- ALL ELEVATIONS ARE GEODETIC. THE SITE BENCHMARK IS AT THE TOP OF THE SPINDLE FIRE HYDRANT LOCATED IN THE SOUTH-WEST CORNER OF THE BREEZEHILL AVE. N AND SUMMERSET ST W INTERSECTION (ELEV.=63.68). REFER TO ANNS, OSULLIVAN VOLLEBEK LTD. TOPOGRAPHIC PLAN OF PART OF LOTS 1, 2 AND 3 EAST SIDE BREEZEHILL AVE NORTH PART OF BLOCK 1, REGISTERED PLAN 73, CITY OF OTTAWA.
- REFER TO ARCHITECTS AND LANDSCAPE ARCHITECTS DRAWINGS FOR BUILDING AND HARDSURFACE AREAS AND DIMENSIONS.
- REFER TO STORMWATER MANAGEMENT REPORT(R-2023-004, DATED MAR. 15, 2023) AND SERVICING DESIGN BRIEF (R-2013-003, DATED MAR. 15, 2023) PREPARED BY NOVATECH ENGINEERING CONSULTANTS LTD.
- SAW CUT AND KEY GRIND ASPHALT AT ALL ROAD CUTS AND ASPHALT IN POINTS AS PER CITY OF OTTAWA STANDARDS (R10).
- PROVIDE LINEPARKING PAINTING.
- CONTRACTOR TO PROVIDE THE CONSULTANT WITH A GENERAL PLAN OF SERVICES INDICATING ALL SERVICING AS-BUILT INFORMATION SHOWN ON THIS PLAN. AS-BUILT INFORMATION MUST INCLUDE: PIPE SERIAL SIZES, LENGTHS, SLOPES, INVERT AND TIG ELEVATIONS, STRUCTURE LOCATIONS, VALVE AND HYDRANT LOCATIONS, TWM ELEVATIONS AND ANY ALIGNMENT CHANGES, ETC.
- REFER TO GEOTECHNICAL REPORT (NO. GP-2874-2 REVISION 4, DATED OCTOBER 4, 2021) PREPARED BY PATTERSON GROUP FOR SUBSURFACE CONDITIONS, CONSTRUCTION RECOMMENDATIONS, AND GEOTECHNICAL INSPECTION REQUIREMENTS. THE GEOTECHNICAL CONSULTANT IS TO REVIEW ON-SITE CONDITIONS AFTER EXCAVATION PRIOR TO PLACEMENT OF THE GRAVEL AIR LAYER.
- ALL MATERIALS AND CONSTRUCTION METHODS SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STANDARDS AND SPECIFICATIONS AND ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS. ONTARIO PROVINCIAL STANDARDS WILL APPLY WHERE NO CITY STANDARDS ARE AVAILABLE.
- ALL PRIVATE APPROACHES MUST BE CONSTRUCTED AS PER CITY SPECIFICATION S13

SEWER NOTES:

- ITEM SPEC. No. REFERENCE
 - SEWER SERVICE CONNECTION - RIGID PIPE S 11 CITY OF OTTAWA
 - SEWER SERVICE ABANDONMENT S 11.4 CITY OF OTTAWA
 - SEWER TRENCH - BEDDING (GRANULAR A OR GRANULAR B TYPE 1, OPSD WITH MAXIMUM PARTICLE SIZE=25mm) CITY OF OTTAWA
 - STORM SERVICE PVC OR 35
 - SANITARY SERVICE PVC OR 35
- INSULATE ALL SEWER PIPES (SAN/STM) THAT HAVE LESS THAN 2.0m COVER WITH 50mm(200mm HI-40 INSULATION, PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION.
- SERVICES ARE TO BE CONSTRUCTED TO 1.0m FROM FACE OF BUILDING AT A MINIMUM SLOPE OF 1.0%.
- AT LEAST 150 mm OF OPSD GRANULAR A SHOULD BE USED FOR BEDDING FOR SEWER AND WATER PIPES WHEN PLACED ON SOIL SUBGRADE. THE BEDDING SHOULD EXTEND TO THE SPRING LINE OF THE PIPE. COVER MATERIAL, FROM THE SPRING LINE TO AT LEAST 300 mm ABOVE THE OVERTOP OF THE PIPE SHOULD CONSIST OF OPSD GRANULAR A (CONCRETE OR P-PIPE) OR SAND (CONCRETE PIPE). THE BEDDING AND COVER MATERIALS SHOULD BE PLACED IN MAXIMUM 225 mm THICK LIFTS COMPACTED TO A MINIMUM OF 95% OF THE MATERIAL'S SPMDD.
- WHERE HARD SURFACE AREAS ARE CONSIDERED ABOVE THE TRENCH BACKFILL, THE TRENCH BACKFILL MATERIAL WITH THE FROST ZONE (ABOUT 1.8 m BELOW FINISHED GRADE) SHOULD MATCH THE SOILS EXPOSED AT THE TRENCH WALLS TO REDUCE THE POTENTIAL DIFFERENTIAL FROST HEAVING. THE TRENCH BACKFILL SHOULD BE PLACED IN MAXIMUM 300 mm THICK LOOSE LIFTS AND COMPACTED TO A MINIMUM OF 95% OF THE MATERIAL'S SPMDD.
- FLEXIBLE CONNECTIONS ARE REQUIRED FOR CONNECTING PIPES TO MANHOLES (FOR EXAMPLE KORA-SEAL, P3K POSITIVE SEAL AND DURASEAL). THE CONCRETE GRADLE FOR THE PIPE CAN BE ELIMINATED.
- EXCAVATION SIDE SLOPES ABOVE THE GROUNDWATER LEVEL EXTENDING TO A MAXIMUM DEPTH OF 3 m SHOULD BE CUT BACK AT 1H:1V OR FLATTER. THE FLATTER SLOPE IS REQUIRED FOR EXCAVATION BELOW GROUNDWATER LEVEL. THE SUBSOIL AT THIS SITE IS CONSIDERED TO BE MAINLY A TYPE 2 AND 3 SOIL ACCORDING TO THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS. SLOPES IN EXCESS OF 3 m IN HEIGHT SHOULD BE PERIODICALLY INSPECTED BY THE GEOTECHNICAL CONSULTANT IN ORDER TO DETECT IF THE SLOPES ARE EXHIBITING SIGNS OF DISTRESS.
- THE OWNER SHALL REQUIRE THAT THE SITE SERVICING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH S14.07.15, S14.07.16 AND 407.07.24. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER CONNECTION TO THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED BY THE PROPRIETOR OR A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.
- FULL PORT BACKWATER VALVES ARE REQUIRED ON THE SANITARY SERVICES. INSTALLED AS PER THE MANUFACTURER'S RECOMMENDATIONS AND A BACKWATER VALVE IS REQUIRED ON THE STORM SERVICES / FOUNDATION DRAIN FOR EACH BUILDING, INSTALLED AS PER STD. DWG S14.
- CONTRACTOR TO TELEWISE (CCTV) ALL PROPOSED SEWERS.
- REINSTATE ALL EXISTING PAVEMENT, CURB AND BOULEVARDES AS PER CITY OF OTTAWA R10.
- ALL EXISTING SANITARY AND STORM SERVICES ARE TO BE CAPED AT THE PROPERTY LINE TO THE SATISFACTION OF THE CITY OF OTTAWA SEWER OPERATIONS.

WATERMAIN NOTES:

- SPECIFICATIONS:

ITEM	SPEC. No.	REFERENCE
WATERMAIN TRENCHING	W22	CITY OF OTTAWA
THERMAL INSULATION IN SHALLOW TRENCHES	W22	CITY OF OTTAWA
VALVE BOX ASSEMBLY	W24	CITY OF OTTAWA
WATERMAIN CROSSING BELOW SEWER	W25	CITY OF OTTAWA
CONNECTION DETAIL FROM EXISTING TO NEW WM	W25.1	CITY OF OTTAWA
WATERMAIN CROSSING OVER SEWER	W25.2	CITY OF OTTAWA
WATERMAIN (150mm)	PVC DR 18	CITY OF OTTAWA
THERMAL INSULATION AT OPEN STRUCTURE	W28	CITY OF OTTAWA
WATER SERVICE INSTALLATION AT SEWER CROSSING	W33	CITY OF OTTAWA
- SUPPLY AND CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH THE CITY OF OTTAWA STANDARD SPECIFICATIONS EXCAVATION, INSTALLATION, BACKFILL AND RESTORATION OF ALL WATERMANS BY THE CONTRACTOR. CONNECTIONS AND SHUT-OFFS AT THE MAIN AND CHLORINATION OF THE WATER SYSTEM SHALL BE PERFORMED BY CITY OFFICIALS.
- WATERMAIN SHALL BE MINIMUM 2.4m DEPTH BELOW GRADE UNLESS OTHERWISE INDICATED. OTHERWISE THERMAL INSULATION IS REQUIRED AS PER STD. DWG W22.
- PROVIDE MINIMUM 0.50m CLEARANCE BETWEEN OUTSIDE OF PIPES WHEN CROSSING BELOW, AND 0.25m MINIMUM WHEN CROSSING ABOVE.
- WATER SERVICE IS TO BE CONSTRUCTED TO WITHIN 1m OF FOUNDATION WALL AND CAPPED, UNLESS OTHERWISE INDICATED.
- ALL EXISTING WATER SERVICES TO BE BLANKED AT MAIN EXCAVATION AND REINSTATEMENT BY CONTRACTOR.
- AS AN EXTRA MEASURE, A MONITORING PROGRAM IS REQUIRED TO ENSURE THE LATERAL SUPPORT ZONE OF THE EX. 1372mm WATERMAIN HAS NOT BEEN IMPACTED. THE MONITORING PROGRAM WILL CONSIST OF INSTALLATION OF 2 UTILITY MONITORING POINTS INSTALLED DIRECTLY ON TOP OF THE 1.372 MM DIAMETER WATERMAIN. FURTHER, IT IS RECOMMENDED THAT TWO (2) INCLINOMETERS BE INSTALLED ADJACENT TO THE WATERMAIN AND THE WEST SHORING FACE FOR MONITORING LATERAL DEFLECTION. IN ADDITION, THE TEMPORARY SHORING SYSTEM SHOULD BE MONITORED BY ON A DAILY BASIS UNTIL THE BACKFILL ARE STRESSED AND WEEKLY UNTIL THE FOUNDATION EXTENDS ABOVE EXTERIOR FINISHED GRADE. AN ALERT LEVEL FOR SETTLEMENT OF THE WATERMAIN GREATER THAN 3 mm SHOULD BE ASSESSED IMMEDIATELY. AN ACTION LEVEL FOR MOVEMENT OF 6 mm WILL REQUIRE IMMEDIATE INVESTIGATION AND POSSIBLE MITIGATION MEASURES. WEEKLY REPORTING INCLUDING INSPECTION FINDINGS AND RECOMMENDATIONS SHOULD BE PROVIDED TO THE OWNER AND THE CITY BY THE GEOTECHNICAL CONSULTANT.

WATERMAIN TABLE (DUEL 100mm & 150mm)

STATION	SURFACE ELEVATION	TOP OF WM ELEVATION	DESCRIPTION
2/3-000.0	62.78	60.38	CONNECT TO EXISTING 150mm WATERMAIN
2/3-001.4	62.84	60.44	CROSS ABOVE EXISTING 150mm STORM
2/3-003.9	62.94	60.54	CROSS ABOVE EXISTING 300mm SANITARY AS PER CITY DETAIL W25.2 (40.25m CLEARANCE)
2/3-009.1	62.95	59.38	CROSS BELOW EXISTING 1350mm WATERMAIN
2/3-010.6	63.00	59.45	CROSS BELOW EXISTING 300mm SANITARY
2/3-013.1	63.15	60.75	STAND POST AT PROPERTY LINE
2/3-013.5	63.19	60.70	WATERMAIN CAP

WATERMAIN TABLE (150mm)



STATION	SURFACE ELEVATION	TOP OF WM ELEVATION	DESCRIPTION
1+000.0	62.78	60.38	CONNECT TO EXISTING 150mm WATERMAIN
1+001.1	62.81	60.41	CROSS ABOVE EXISTING 1350mm STORM
1+005.0	62.94	60.50	CROSS ABOVE EXISTING 300mm SANITARY AS PER CITY DETAIL W25.2 (40.25m CLEARANCE)
1+009.0	62.97	59.40	CROSS BELOW EXISTING 1350mm WATERMAIN
1+010.6	62.96	59.40	CROSS BELOW EXISTING 300mm SANITARY
1+012.8	63.25	60.75	STAND POST
1+013.5	63.26	60.70	WATERMAIN CAP

*EXACT DEPTH OF EXISTING WATERMAIN TO BE DETERMINED AT TIME OF EXCAVATION. CONTRACTOR TO CONFIRM TOP OF WATERMAIN. PROVIDE THERMAL INSULATION AS PER CITY OF OTTAWA DETAIL W23 WHERE COVER IS LESS THAN 2.4m

PIPE CROSSING TABLE

ID	LOWER PIPE	UPPER PIPE	CLEARANCE
1	150mm WM TWM = 59.40	300mm SAN INV = 59.88	±0.50m
2	250mm STM OBV = 59.40	300mm SAN INV = 60.00	±0.31m
3	250mm STM INV = 59.17	300mm SAN INV = 59.80	±0.25m
4	150mm WM TWM = 59.40	1350mm WM INV = ±59.90	±0.50m
5	300mm SAN OBV = 60.15	150mm WM INV = 60.45	±0.30m
6	250mm STM OBV = 59.03	150mm SAN INV = 59.22	±0.50m
7	1350mm STM OBV = 59.03	150mm WM INV = 60.26	±1.20m
8	100mm WM TWM = 59.45	300mm SAN INV = 59.95	±0.50m
9	150mm WM TWM = 59.45	300mm SAN INV = 59.95	±0.50m
10	100mm WM TWM = 59.38	1350mm WM INV = 59.98	±0.50m
11	150mm WM TWM = 59.38	1350mm WM INV = 59.98	±0.50m
12	300mm SAN OBV = 60.14	150mm SAN INV = 60.44	±0.30m
13	150mm WM TWM = 58.92	100mm WM INV = 60.34	±1.42m
14	1350mm STM OBV = 58.92	150mm WM INV = 60.29	±1.37m
15	250mm STM OBV = 59.02	300mm SAN INV = 59.92	±0.90m
16	250mm STM OBV = 59.14	1350mm WM INV = 60.03	±0.89m
17	250mm STM OBV = 58.77	300mm SAN INV = 59.77	±1.00m
18	100mm SAN OBV = 58.56	250mm STM INV = 58.84	±0.25m
19	100mm SAN OBV = 58.62	250mm STM INV = 58.87	±0.25m


* INV ONLY INDICATED FOR CONCRETE PIPES ARE OUTER DIAMETER

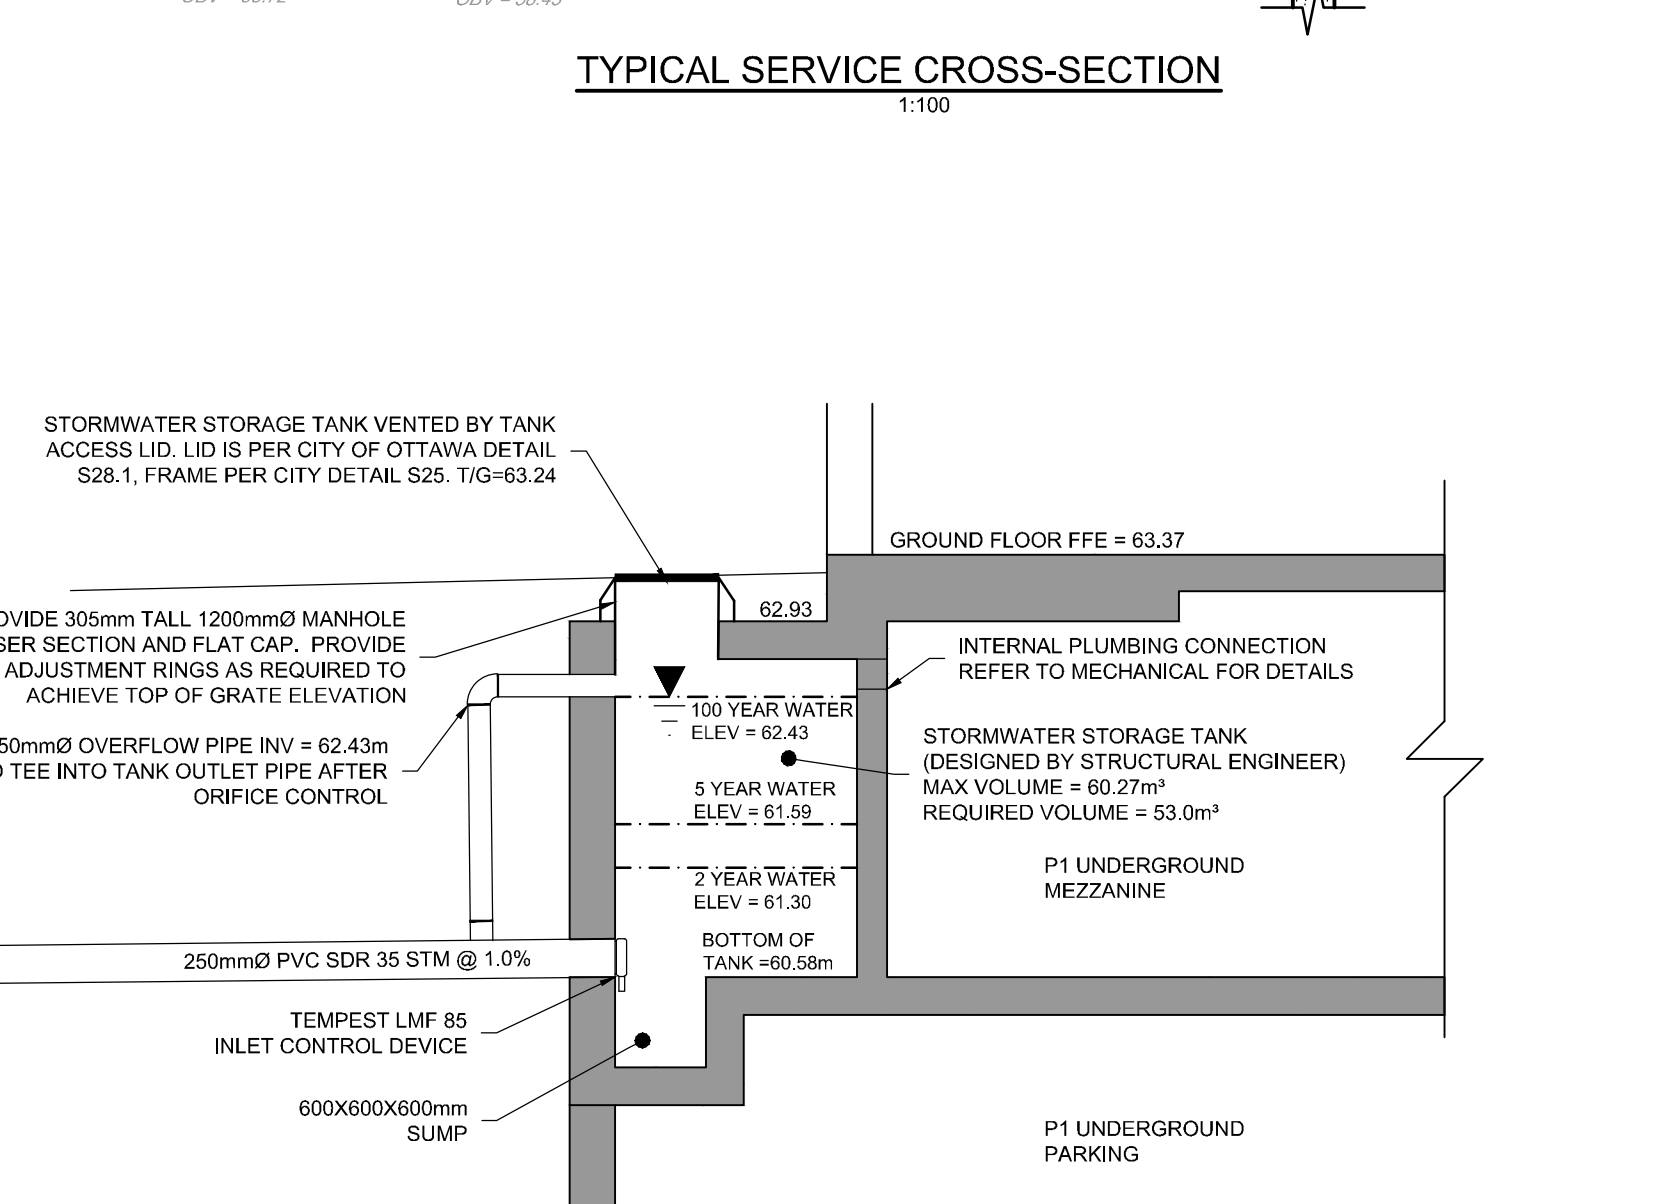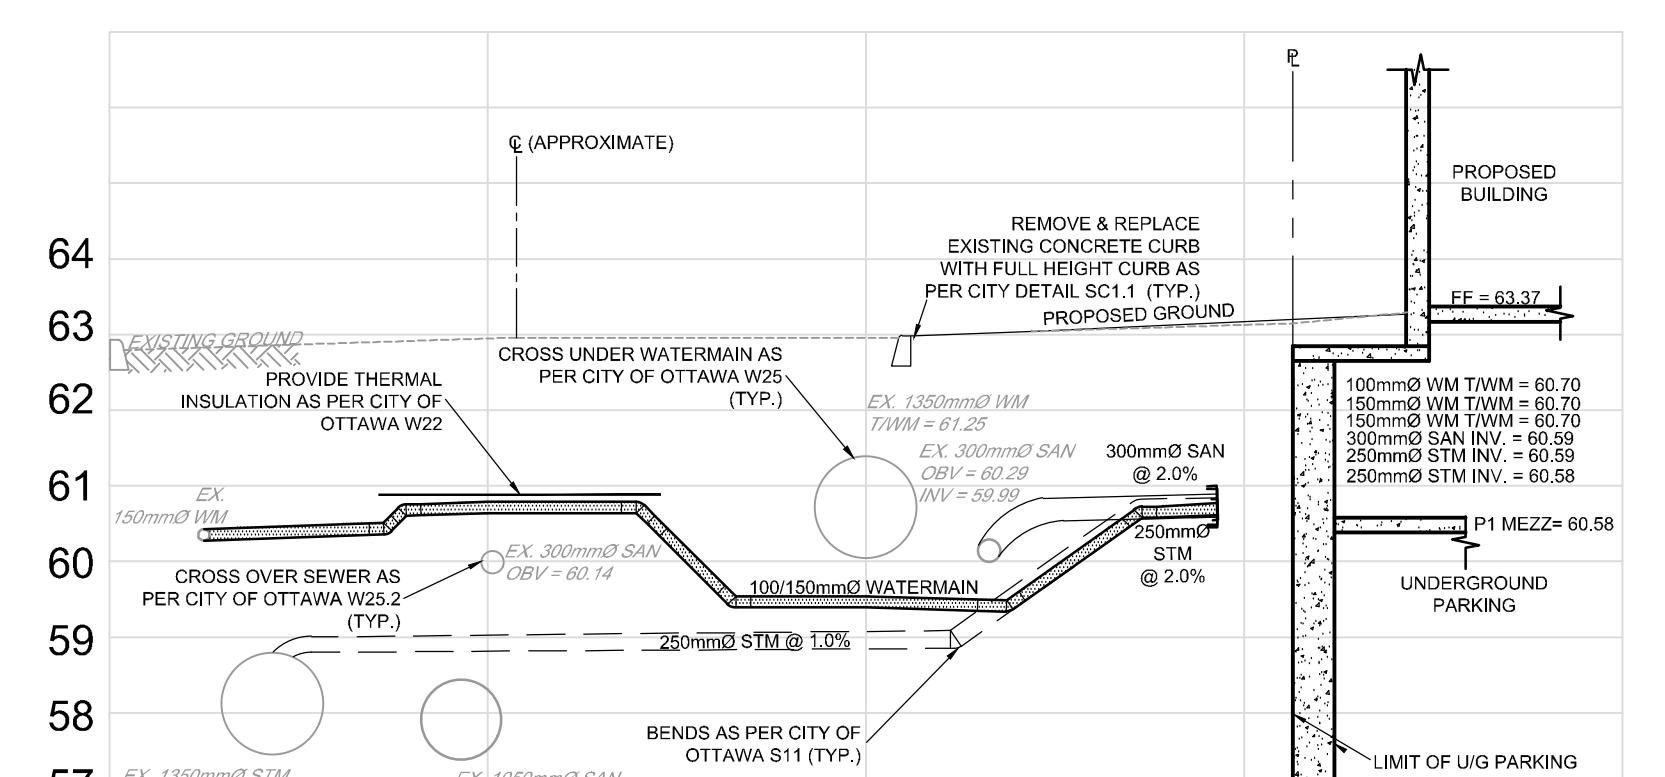



SEWER & WATERMAIN INSULATION NOTES:

- INSULATE ALL SEWER PIPES THAT HAVE LESS THAN 2.0m COVER AND ALL WATERMAIN WITH LESS THAN 2.4m OF COVER WITH EXPANDED POLYSTYRENE INSULATION AS PER OPSD 1109.030.
- THE THICKNESS OF INSULATION SHALL BE THE EQUIVALENT OF 25mm FOR EVERY 300mm REDUCTION IN THE REQUIRED DEPTH OF COVER WITH 50mm MINIMUM (SEE TABLE).
 W = WIDTH OF INSULATION (mm)
 W = D + 300 (1000 mm)
 D = O.D. OF PIPE (mm)

COVER SEWER / WATER (mm)	INSULATION THICKNESS (mm)
2000-1700 / 2400-2100	50
1700-1400 / 2100-1800	75
1400-1100 / 1800-1500	100

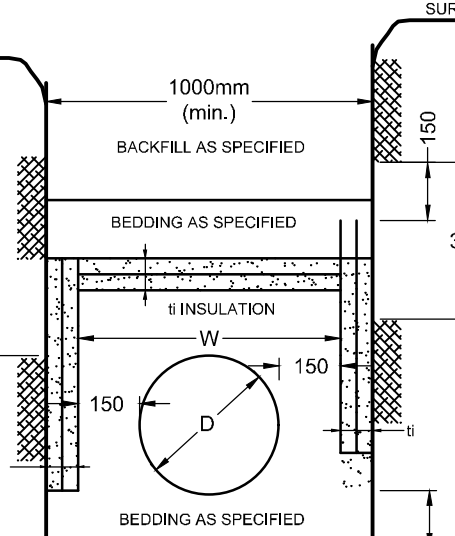

NOT FOR CONSTRUCTION

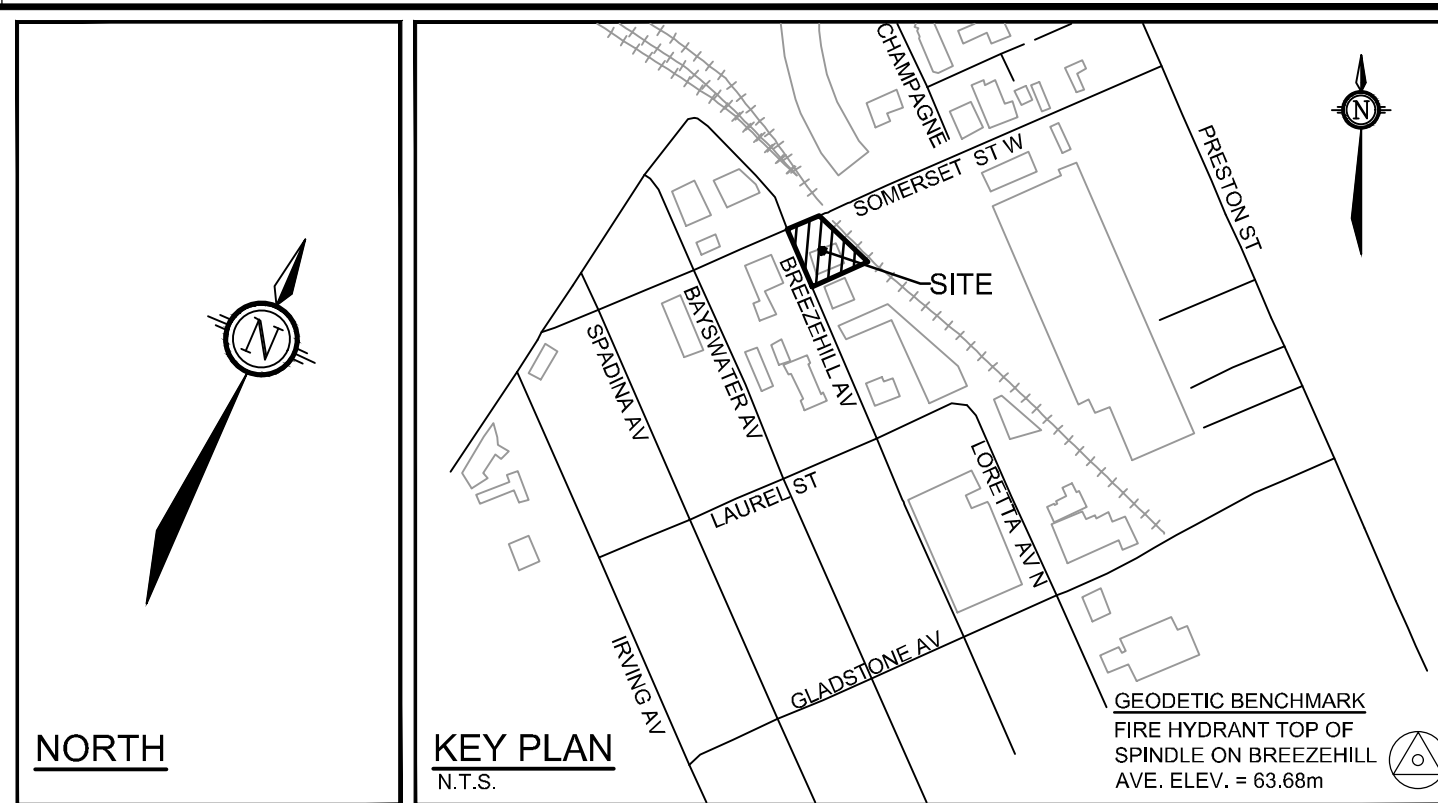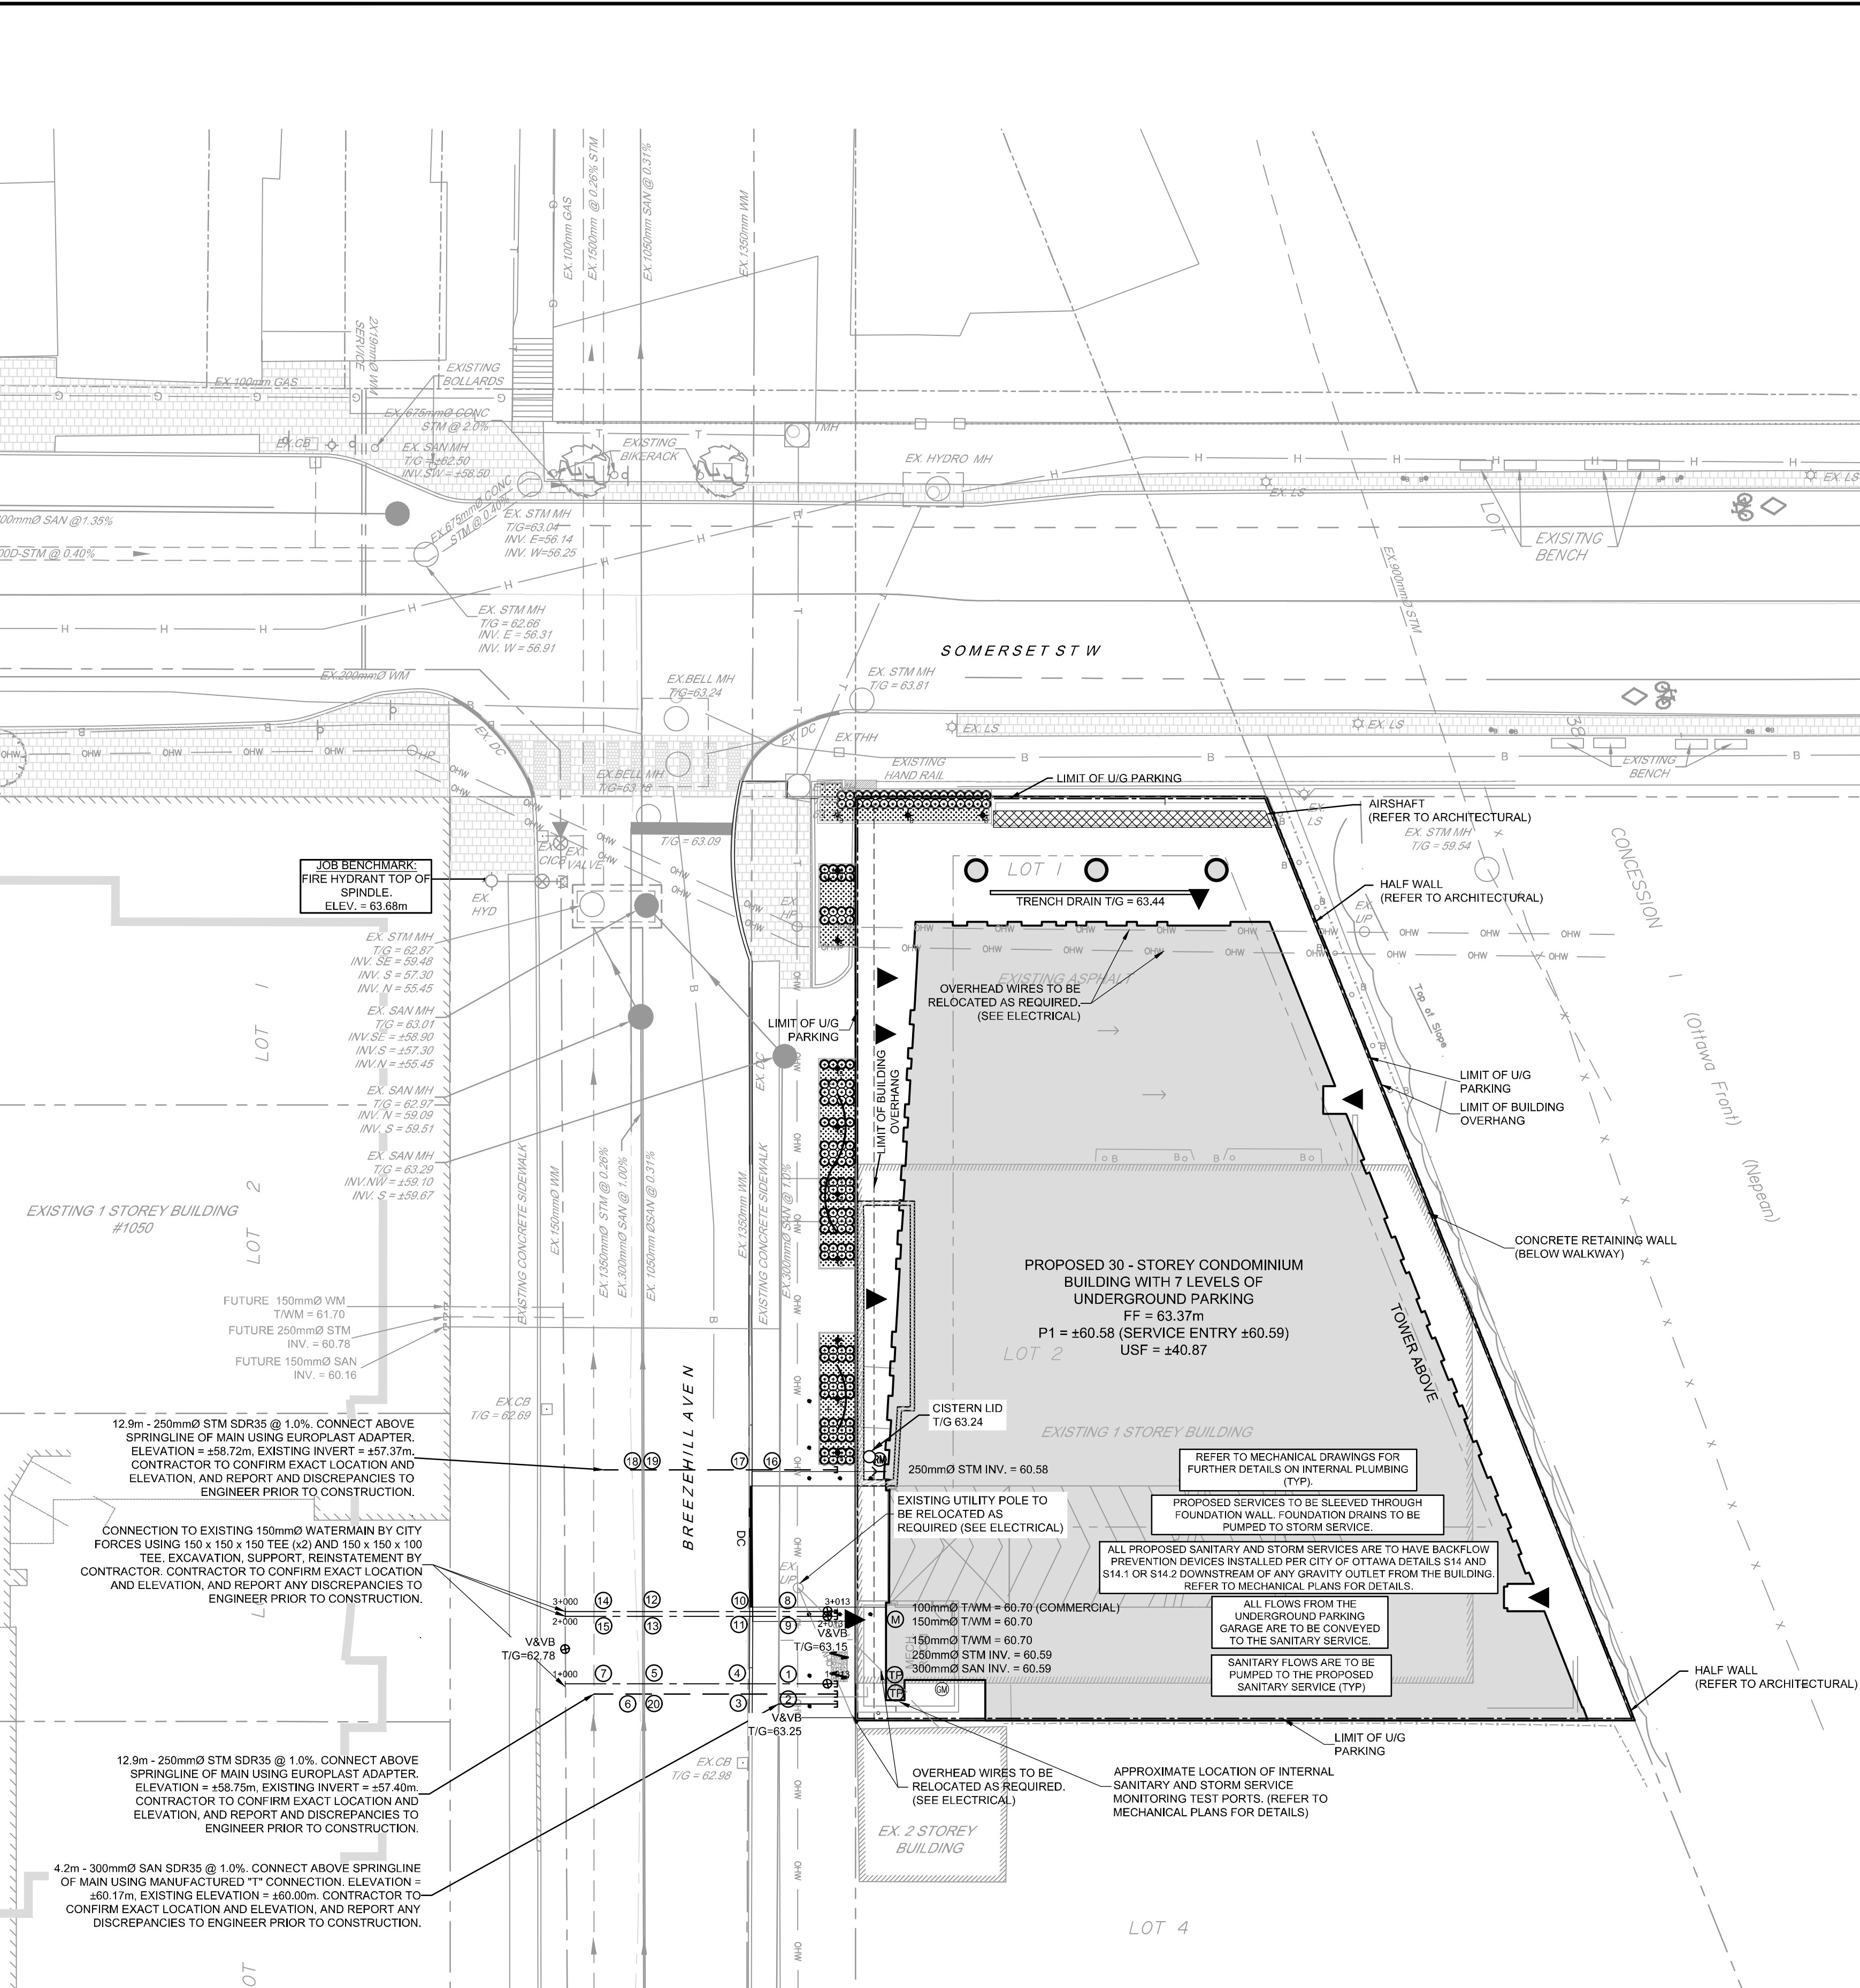

CLARIDGE HOMES
CLARIDGE HOMES SUITE 2001,
210 GLADSTONE AVENUE,
OTTAWA, ONTARIO K2P 0Y6.



NOTE:
CONTRACTOR TO CONFIRM ELEVATIONS OF INFRASTRUCTURE IN THE STREET PRIOR TO EXTENDING SERVICES INTO THE SITE AND SHALL NOTIFY ENGINEER OF ANY DISCREPANCIES IMMEDIATELY.

No.	REVISION	DATE	BY
01.	ISSUED FOR COORDINATION	MAY 4/21	JAG
02.	ISSUED FOR COORDINATION	APR 29/21	JAG
03.	REVISED PER CITY COMMENTS	FEB 18/21	JAG
04.	ISSUED FOR COORDINATION	DEC 01/20	JAG
05.	REVISED PER CITY COMMENTS	AUG 24/15	JAG
06.	REVISED PER CITY COMMENTS	OCT 31/13	JAG
07.	ISSUED WITH SITE PLAN APPLICATION	JAN 31/13	GJM
N/A.	REVISION		

SCALE	CHECKED	DRAWN	DESIGNED
1:200	JAG	GJM/JGR	
		MTM/BET	
	JAG		
	GJM/JGR		

NOVATECH Engineers, Planners & Landscape Architects Suite 200, 240 Michael Cowland Drive Ottawa, Ontario, Canada K2M 1P6 Telephone: (613) 254-9643 Facsimile: (613) 254-5867 Website: www.novatech-eng.com	FOR REVIEW ONLY LOCATION CITY OF OTTAWA 1040 SOMERSET STREET WEST DRAWING NAME GENERAL PLAN OF SERVICES PROJECT No. 112191-01 REV REV # 08 DRAWING No. 112191-GP
---	---

2024/07/12 15:10:26 - C:\p\112191-GP-08.dwg - GP_Apr 27, 2022 - 5:53pm - amw