
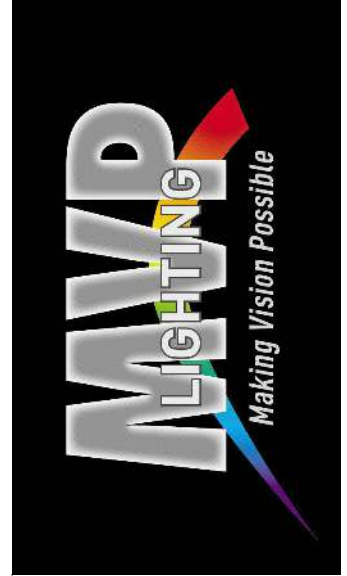
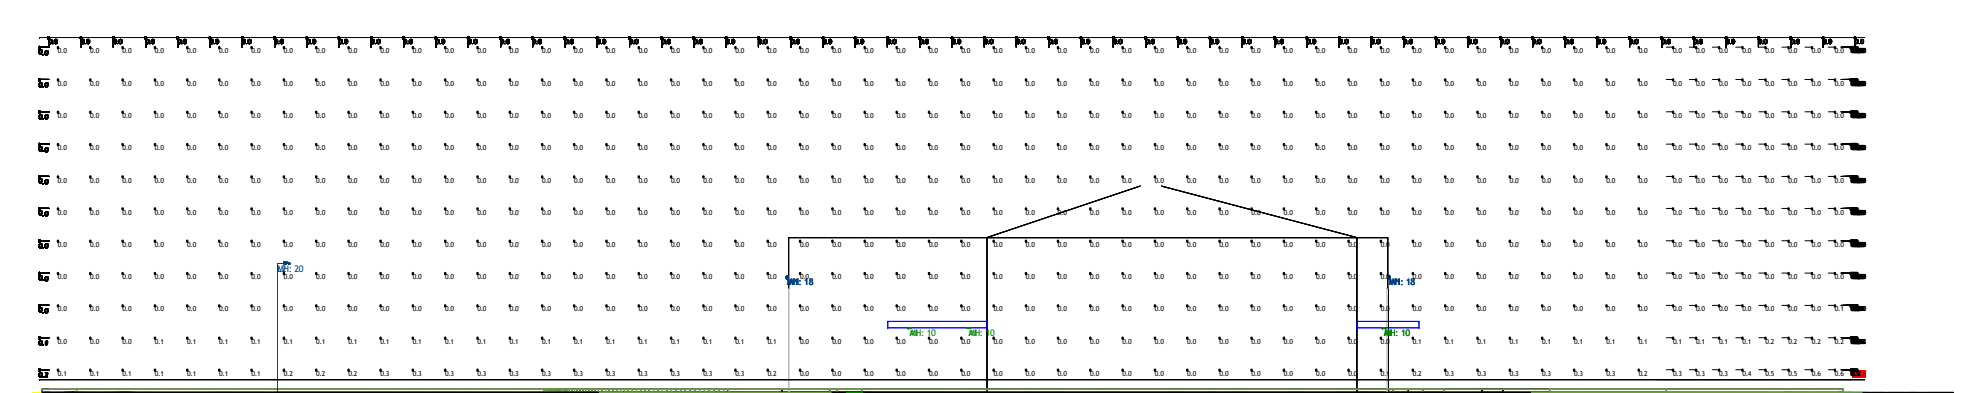
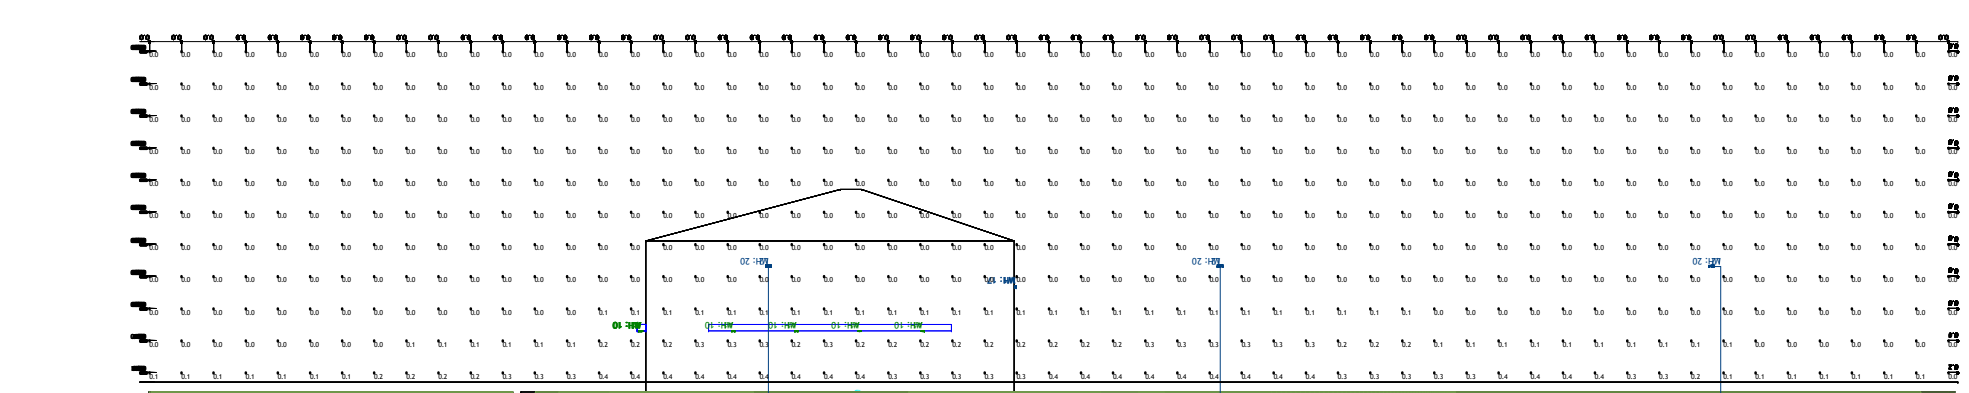
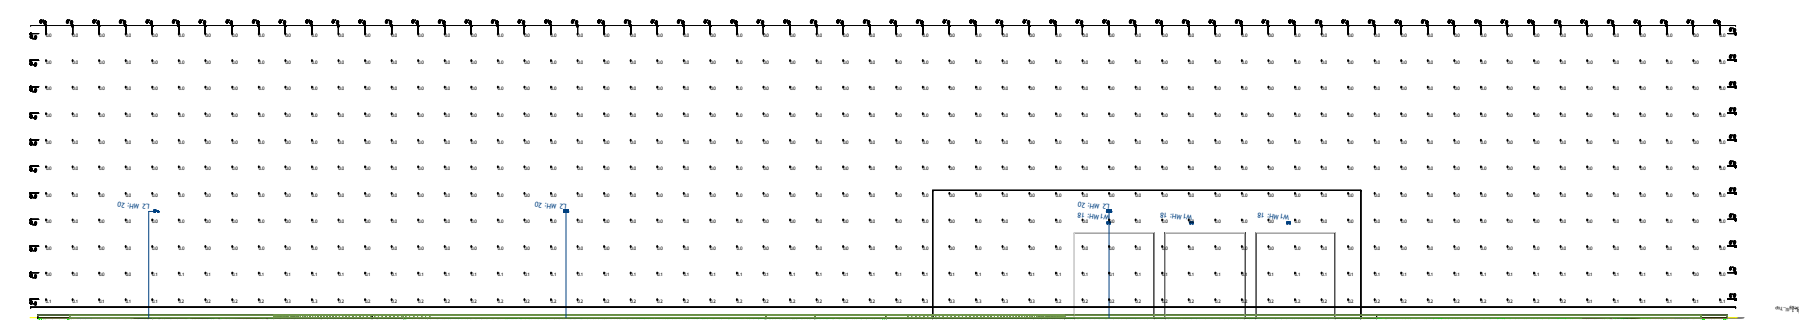
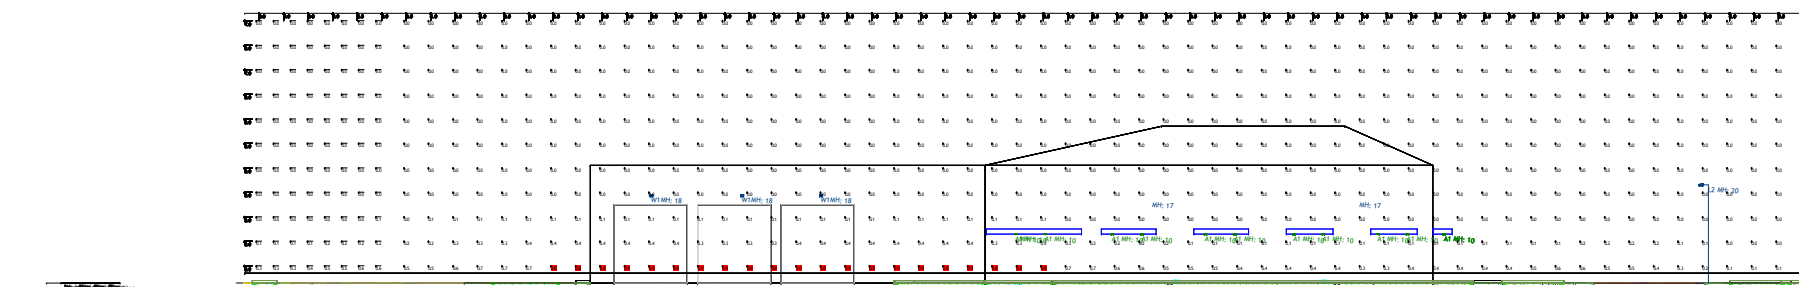


Label	Calc Type	Units	Avg	Max	Min	Avg/Min	Max/Min
ObservedLight_H_Seg1	Observed - H	Lux	0.04	0.4	0.0	N/A	N/A
ObservedLight_H_Seg2	Observed - H	Lux	0.03	0.3	0.0	N/A	N/A
ObservedLight_H_Seg3	Observed - H	Lux	0.02	0.3	0.0	N/A	N/A
ObservedLight_H_Seg4	Observed - H	Lux	0.05	0.4	0.0	N/A	N/A
ObservedLight_H_Seg5	Observed - H	Lux	0.08	1.0	0.0	N/A	N/A
ObservedLight_H_Tot	Observed - H	Lux	0.00	0.0	0.0	N/A	N/A

Symbol	Qty	Label	Arrangement	LF	Description	Lum. Lumens	Lum. Watts	B/C Rating
○	1	M1	Single	0.000	PROSCORE - REC 480-90-3200	1227	12.20	80-60-C1
□	8	M1	Single	0.945	HERBELL - RMJ-48-20-2847-04-U	2549	19.9	80-60-C1
□	4	L2	Single	0.945	BEACON - VP-1-16X-75-3847-3-6C	3848	27.1	80-60-C2

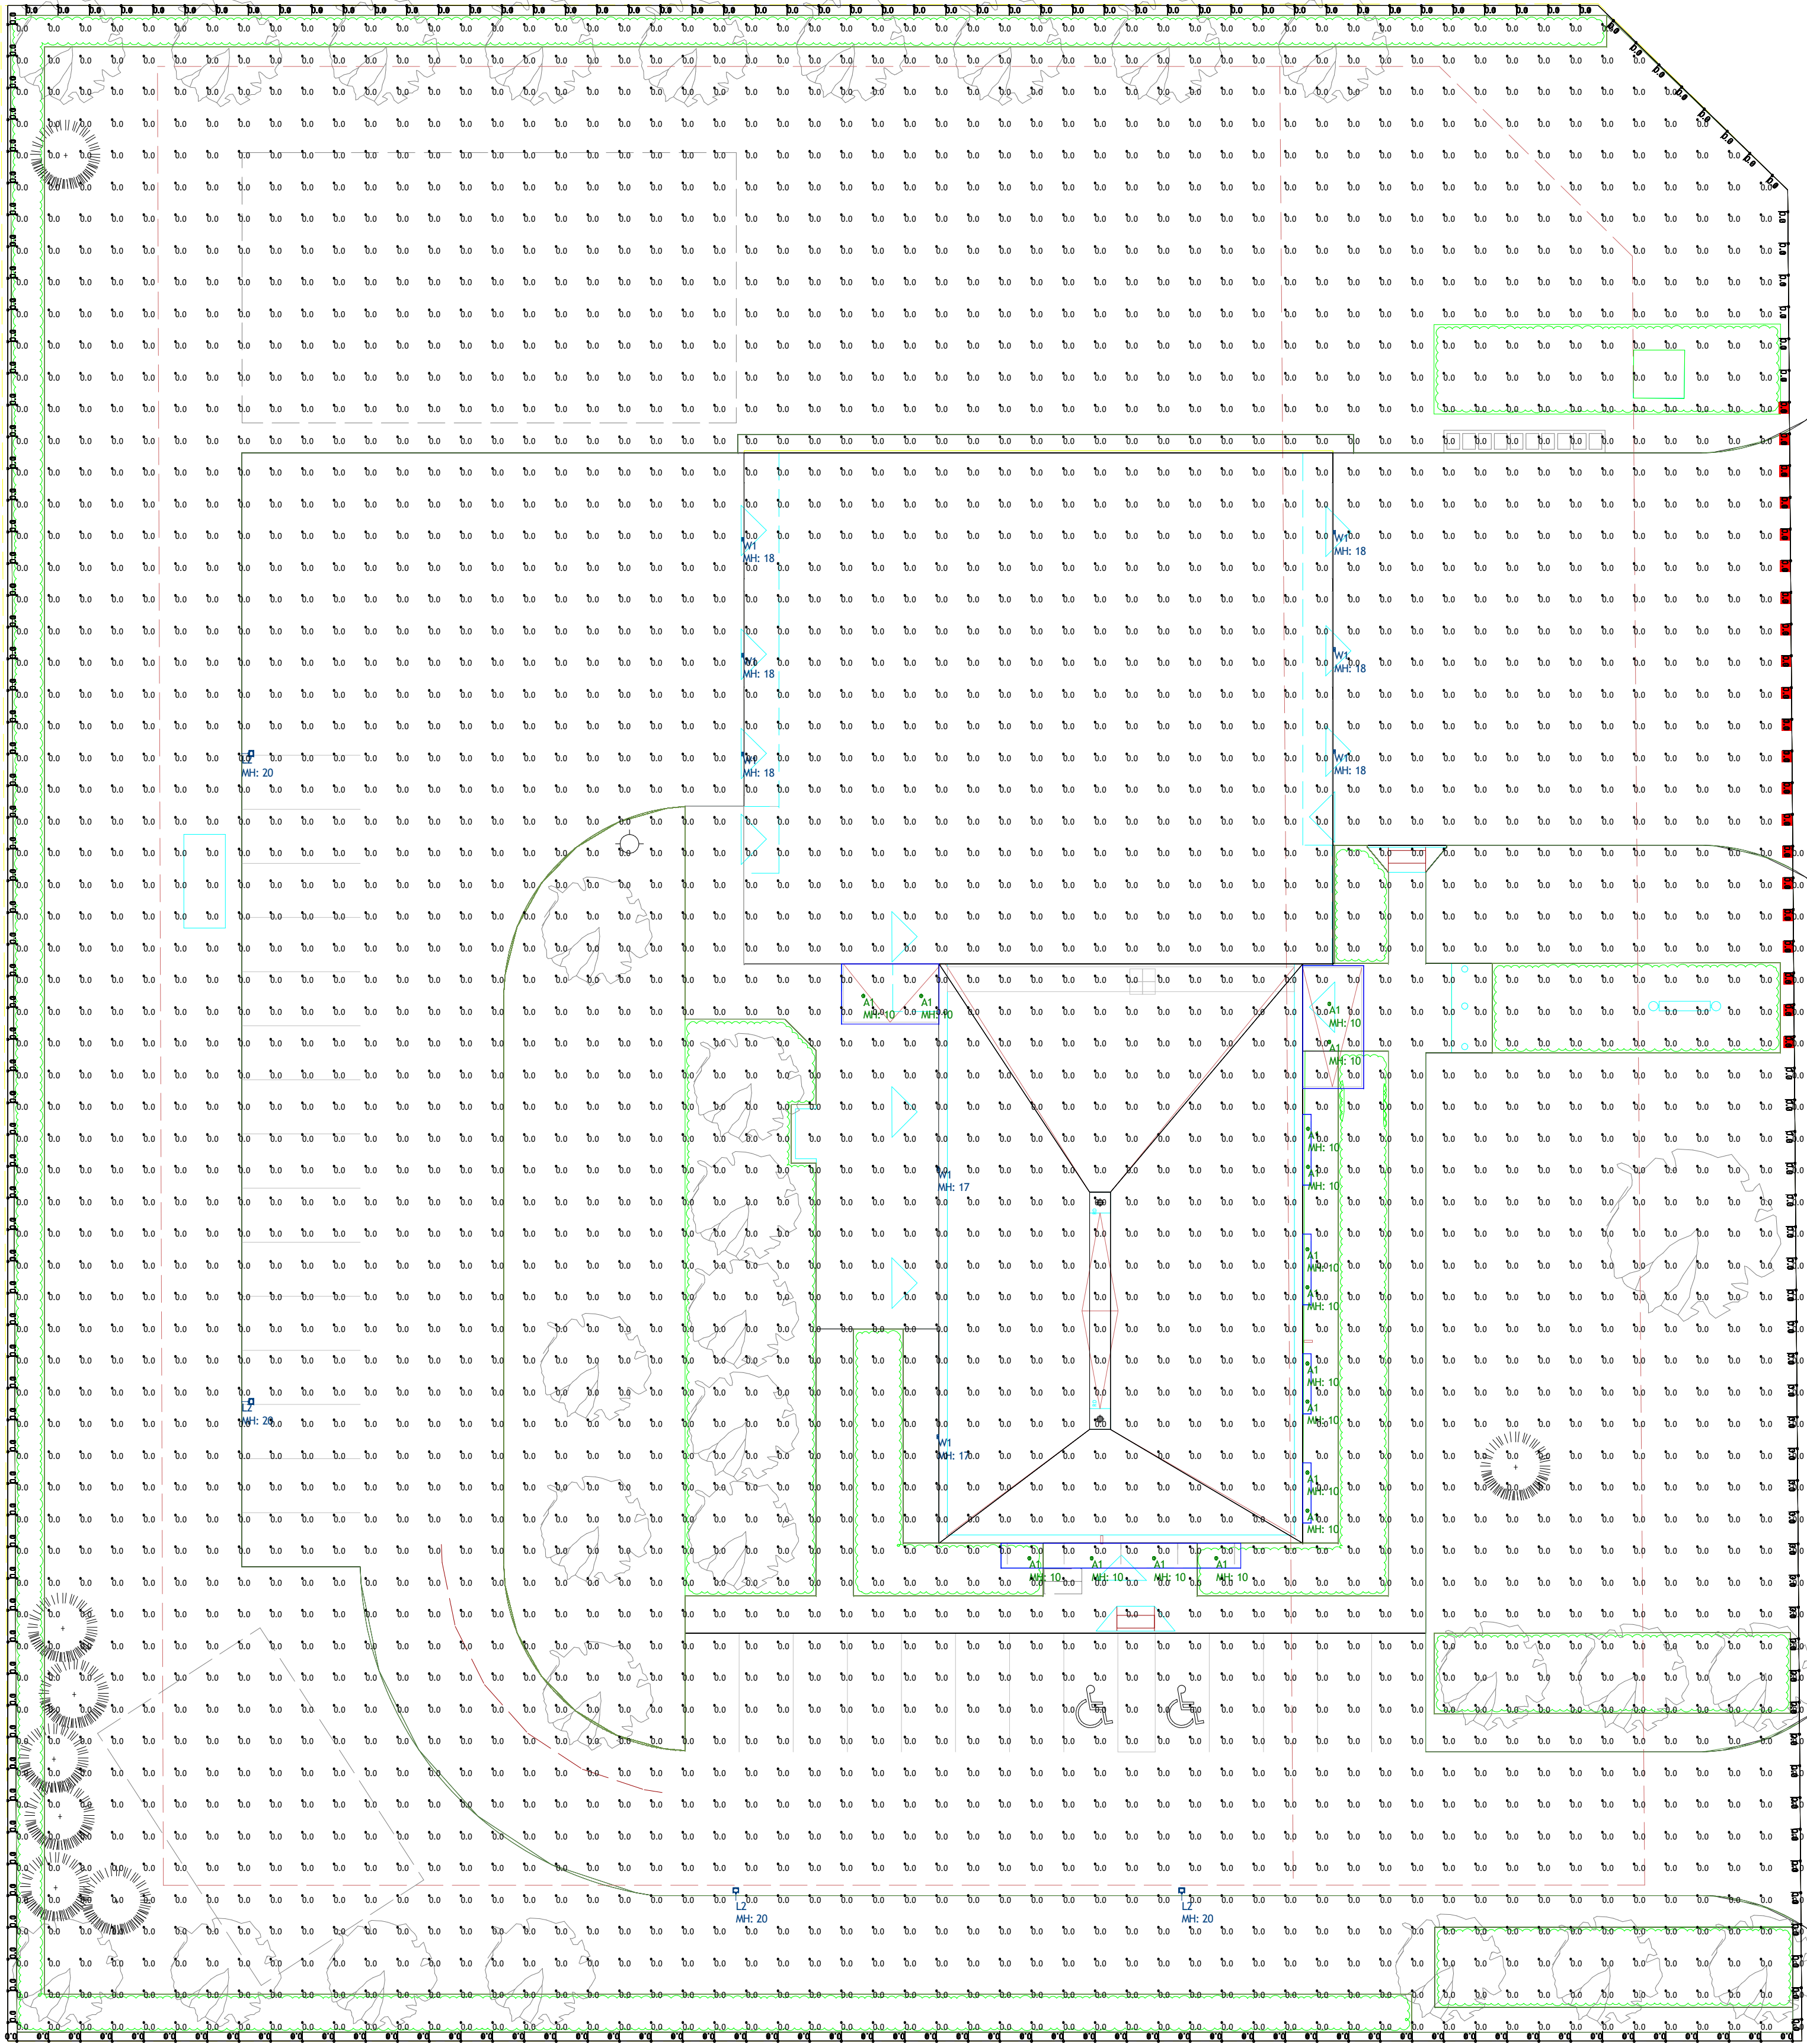

MVP LIGHTING
 Kent Mallovs | Principal
 o: 613-800-9909 ext #3
 c: 613-402-5368

Drawn By:
 Checked By:
 Date: 2022-05-18

Scale:

FIRE STATION 45 - OBTRUSSIVE
 REV 06