


NOTES:

1. THE STANDARDS INDICATE MINIMUM DIMENSIONS THAT ARE TO BE INCORPORATED INTO THE DESIGN OF ANY NEW DEVELOPMENT INVOLVING NEW AND EXISTING STREETS. ANY VARIATION TO THIS DESIGN WILL REQUIRE APPROVAL OF THE CITY OF OTTAWA.
2. ALL DRAWINGS TO BE READ IN CONJUNCTION WITH APPLICABLE CITY STANDARDS.
3. ALL COMPOSITE UTILITY PLANS MUST ADHERE TO THE CITY OF OTTAWA'S STANDARDS FOR UTILITY PLANT DRAWINGS IN ORDER TO RECEIVE APPROVAL THROUGH THE SITE PLAN CONTROL AND SUBDIVISION APPROVALS PROCESS.
4. TYPICAL CROSS SECTION BOLLEVAARD WITH SHALL BE MAINTAINED WITH CONTINUING 100% CLEARANCE AND CORNER LOTS REGARDLESS OF ROAD WAY GEOMETRY.
5. WATERMANS AND HYDRANTS TO BE INSTALLED ON SOUTH AND EAST SIDE OF ALRN WHEN POSSIBLE.
6. SANITARY AND STORM SEWERS MAY BE INSTALLED OFF THE STREET CONTINUING TO ACCOMMODATE LARGE SIZE SEWER PIPES AND STILL MAINTAIN THE CLEARANCES REQUIRED TO MAINTAINANCE.
7. THE USE IN-ROAD CATCH BASINS INSTEAD OF CURB INLET CATCH BASINS SHALL BE APPROVED BY AN AUTHORIZED CITY REPRESENTATIVE.
8. THE USE OF BARBER CURBS AND MOUNTABLE CURBS SHALL BE APPROVED BY AN AUTHORIZED CITY REPRESENTATIVE. MOUNTABLE CURBS SHALL BE SPECIFIED FOR TYPICAL TOWNHOUSE DEVELOPMENTS.
9. BUILDING SEWERS AND WATER SERVICES ARE TO BE CONSTRUCTED AT LOCATIONS IN ACCORDANCE WITH CITY STANDARDS. SANITARY AND STORM SERVICE CONNECTIONS WILL BE EXTENDED A MINIMUM OF 2.0m BEYOND THE PROPERTY LINE TO ALLOW FOR FUTURE CONNECTION. WATER SERVICE FIRE LATERALS SHALL BE LAD IN ONE CONTINUOUS PIPE LENGTH (LA SPLUNG AND JAVING SHALL NOT BE PERMITTED FROM INSIDE FACE OF THE BUILDING TO THE CURBSTOP AND FROM THE CURBSTOP TO THE MAIN / COMBINATION STOP.
10. 1.5m CLEARANCE TO BE MAINTAINED AROUND WATER SERVICE POST. REFER TO G-001 PROGRESSIVE MANUAL FOR UTILITY SPECIFICATION CONCERNING PLANT INSTALLATIONS.
11. TRANSFORMERS AND PEDESTALS SHALL BE LOCATED BETWEEN TOWNHOUSE BUILDING BLOCKS RATHER THAN ENCUMBERING AND/OR PREVENTING THE INSTALLATION OF ROAD ALLOWANCE TREES.
12. ALL PEDESTALS TO BE INSTALLED IN LINE WITH HYDRO TRANSFORMERS OR ON HOUSE SIDE OF TRENCH.
13. THE BASE OF A HYDRO TRANSFORMER MUST BE LOCATED A MINIMUM OF 2.0m FROM THE EDGE OF A DRIVEWAY.
14. REQUIREMENTS FOR PROTECTIVE BOLLARDS AT TRANSFORMERS SHALL BE DETERMINED BY HYDRO ON A CASE BY CASE BASIS.
15. SERVICE LATERALS MUST BE LOCATED A MINIMUM OF 3.0m FROM THE BASE OF A HYDRO TRANSFORMER.
16. STREET LIGHT CABLE SHALL BE PLACED IN JOINT USE TRENCH. STREET LIGHT CABLE SHALL BE AT SAME OFFSET AS STREET LIGHTS WHEN JOINT USE TRENCH NOT CONSTRUCTED.
17. TRAFFIC DUCT ALTERNATIVE PLACEMENT LOCATIONS ARE: 1) JOINT USE TRENCH (LEFT LOCATION OR 2) SAME OFFSET AS STREETLIGHT POLES IN A SEPARATE TRENCH.
18. OPTIMAL LOCATION FOR THE TRAFFIC COMMUNICATIONS DUCT IS A TRENCH LOCATED AT THE SAME OFFSET AS THE STREETLIGHT POLES.
19. TRAFFIC ELECTRICAL DUCTS SHALL BE PLACED IN JOINT USE DUCT BANKS. TRAFFIC HANDRAILS MAY BE LOCATED IN THE BOLLEVAARD AREA ADJACENT TO THE SIDEWALK.
20. USE OF THE FOUR PARTY-UTILITY TRENCH WILL BE CONSIDERED AS AN OPTION, BUT REQUIRES THE AGREEMENT OF ALL UTILITIES PRIOR TO THE DEVELOPMENT OF THE COMPOSITE UTILITY PLAN AND MUST BE IN CONFORMANCE WITH THE GUIDELINES ESTABLISHED BY THE OTTAWA UTILITY COORDINATING COMMITTEE.
21. THE DEVELOPER SHALL SUPPLY AND INSTALL DUCTS FOR UTILITY CROSSINGS AT INTERSECTIONS.
22. ONE TREE PER LOT TYPICAL, 3 TREES ON CORNER LOT WITH ONE OF THE TREES ON THE STREET SIDE OF THE LOT. SPECIFIC TREE SPECIES SHALL BE SELECTED FOR SOIL TYPES AND AVAILABLE SPACES FOR PLANTINGS.
23. TREE PLANTING LOCATION AND TREE SPECIES WILL REQUIRE THE APPROVAL OF THE CITY.
24. TREE PLANTING SHALL BE HAND EXCAVATED FOR THOSE LOCATIONS WITH LESS THAN 1 METRE CLEARANCE TO THE JCT.
25. PRESCRIBED ORDER OF INSTALLATION: SEWERS AND WATERMANS; HYDRANTS; WATER, STORM AND SANITARY SERVICE LATERALS; UTILITY STRUCTURES; BASE COURSE ASPHALT; JOINT USE UTILITY TRENCH; GAS MAINS; UTILITY LOT SERVICES; STREET LIGHTING; AND THEN TREES.
26. PRESCRIBED ORDER OF INSTALLATION MAY VARY DEPENDING UPON CIRCUMSTANCES AS APPROVED BY AN AUTHORIZED CITY REPRESENTATIVE.


 **STANDARD NOTES ROAD ALLOWANCE** DATE: -- REV: MARCH 2009 DATE: -- DWG. No.: ROW-NOTES

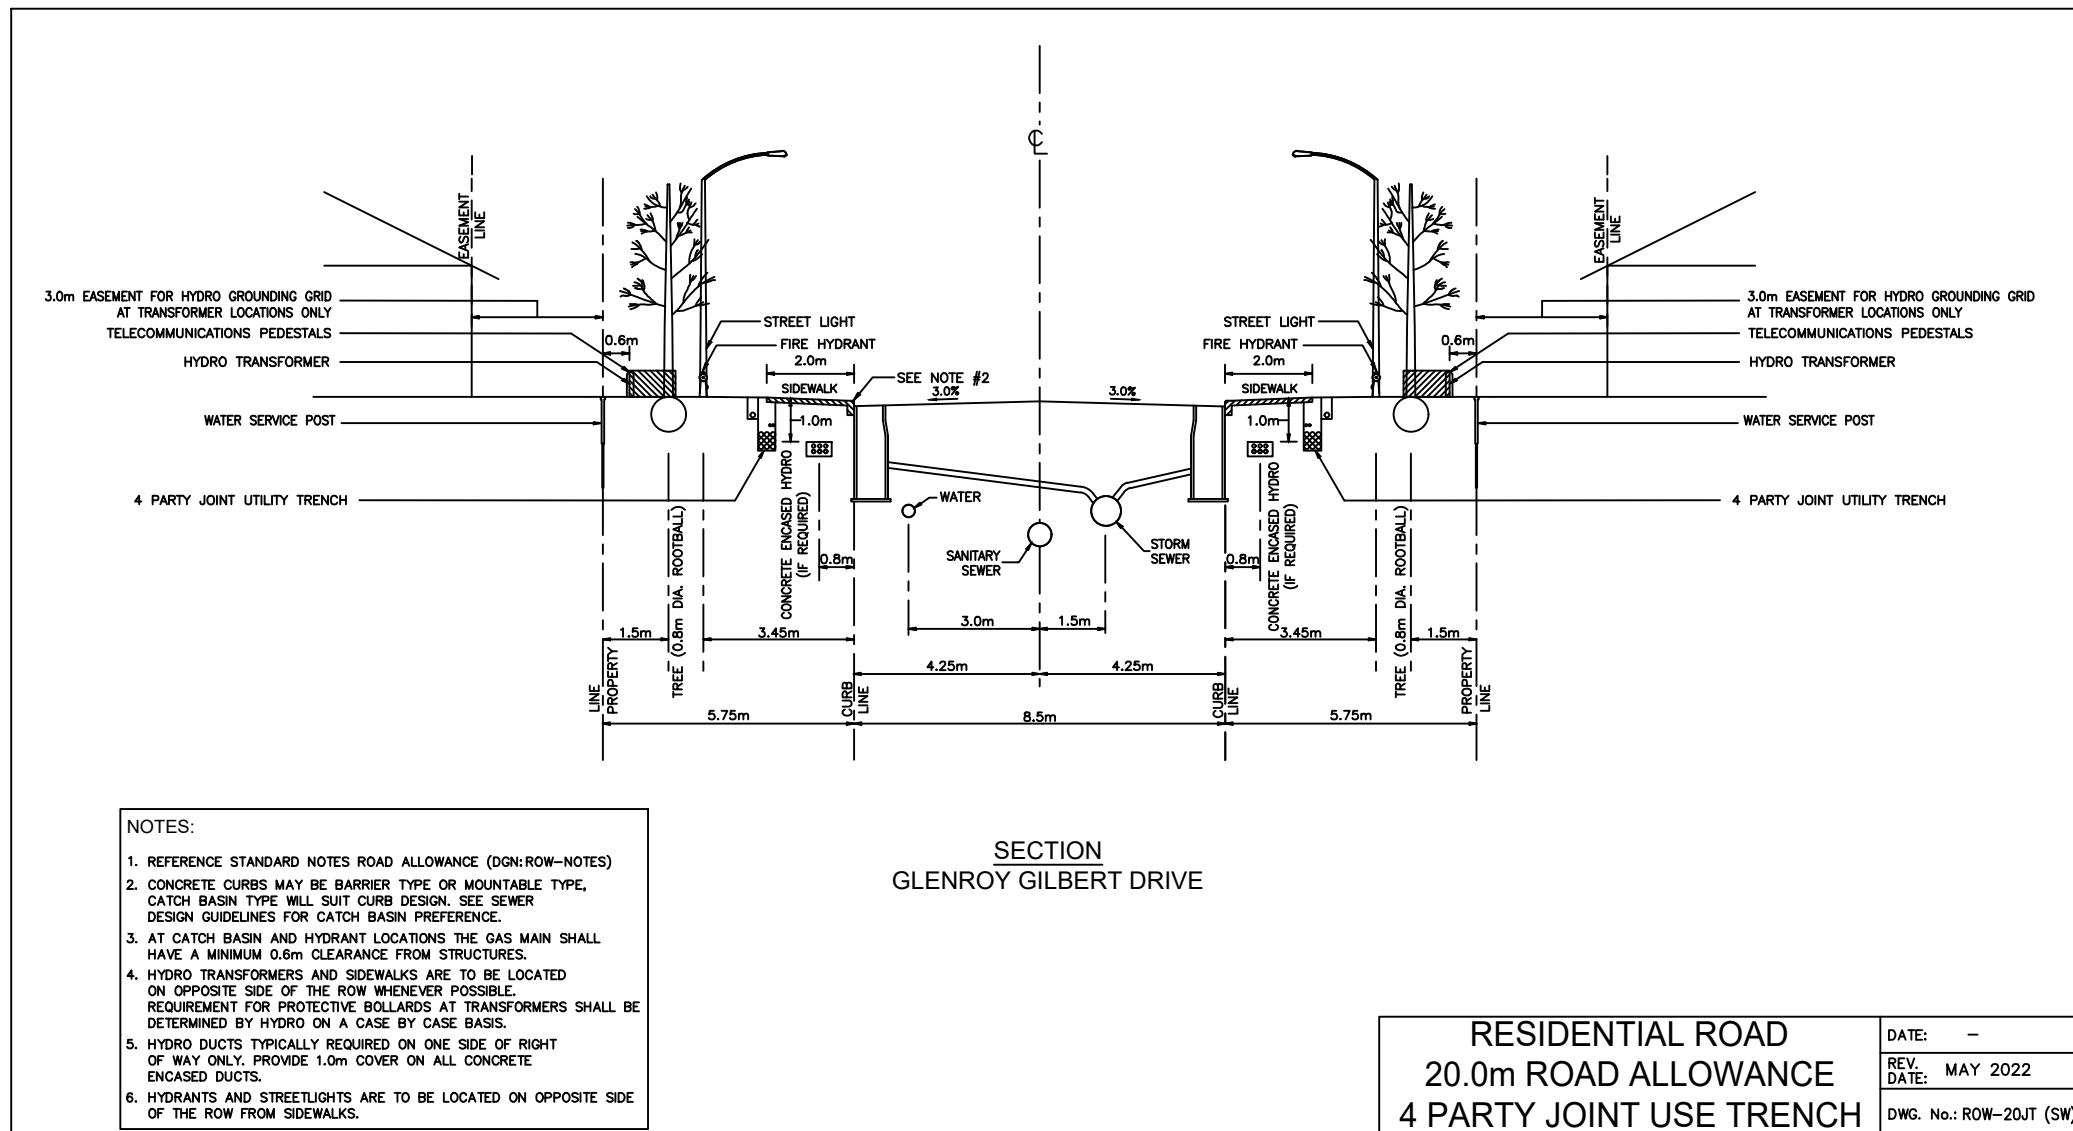

- NOTES:**
1. REFERENCE STANDARD NOTES ROAD ALLOWANCE (DOOR-ROW-NOTES)
 2. CONCRETE CURBS MAY BE BARBER TYPE OR MOUNTABLE TYPE. CATCH BASIN TYPE WILL BE DETERMINED BY HYDRO. REFER TO DESIGN GUIDELINES FOR CATCH BASIN PREFERENCE.
 3. AT CATCH BASIN AND HYDRANT LOCATIONS THE GAS MAIN SHALL HAVE A MINIMUM 0.5m CLEARANCE FROM STRUCTURES.
 4. HYDRO TRANSFORMERS AND BOLLARDS ARE TO BE LOCATED ON OPPOSITE SIDE OF THE ROAD WHENEVER POSSIBLE. REQUIREMENTS FOR PROTECTIVE BOLLARDS AT TRANSFORMERS SHALL BE DETERMINED BY HYDRO ON A CASE BY CASE BASIS.
 5. HYDRO DUCTS TYPICALLY REQUIRED ON ONE SIDE OF RIGHT OF WAY ONLY. PROVIDE 1.5m COVER ON ALL CONCRETE ENCASED DUCTS.
 6. HYDRANTS AND STREETLIGHTS ARE TO BE LOCATED ON OPPOSITE SIDE OF THE ROW FROM SIDEWALK.

RESIDENTIAL ROAD 20.0m ROAD ALLOWANCE 4 PARTY JOINT USE TRENCH DATE: -- REV: MAY 2022 DATE: -- DWG. No.: ROW-2027 (EW)

GLENROY GILBERT DRIVE

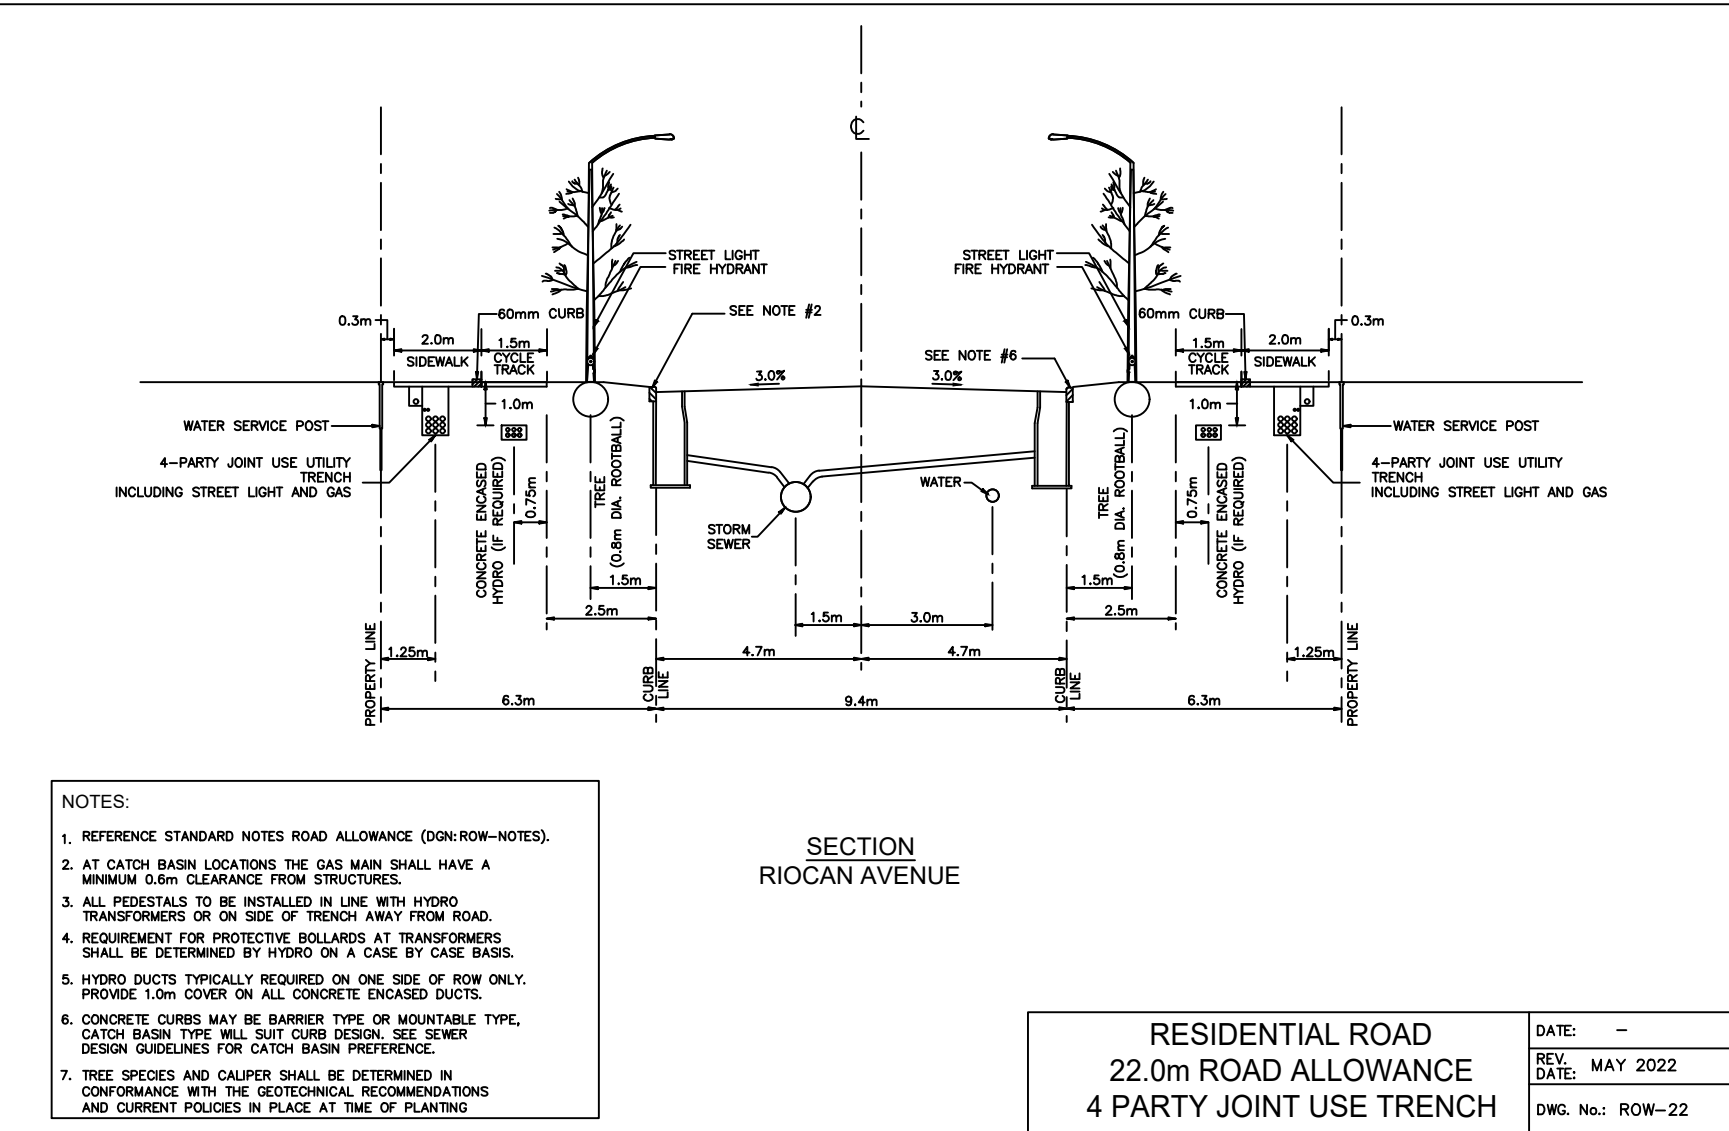

- NOTES:**
1. REFERENCE STANDARD NOTES ROAD ALLOWANCE (DOOR-ROW-NOTES)
 2. AT CATCH BASIN LOCATIONS THE GAS MAIN SHALL HAVE A MINIMUM 0.5m CLEARANCE FROM STRUCTURES.
 3. ALL PEDESTALS TO BE INSTALLED IN LINE WITH HYDRO TRANSFORMERS OR ON SIDE OF TRENCH AWAY FROM ROAD.
 4. REQUIREMENTS FOR PROTECTIVE BOLLARDS AT TRANSFORMERS SHALL BE DETERMINED BY HYDRO ON A CASE BY CASE BASIS.
 5. HYDRO DUCTS TYPICALLY REQUIRED ON ONE SIDE OF ROAD ONLY. PROVIDE 1.5m COVER ON ALL CONCRETE ENCASED DUCTS.
 6. CONCRETE CURBS MAY BE BARBER TYPE OR MOUNTABLE TYPE. CATCH BASIN TYPE WILL BE DETERMINED BY HYDRO. REFER TO DESIGN GUIDELINES FOR CATCH BASIN PREFERENCE.
 7. TREE SPECIES AND CALIBER SHALL BE DETERMINED IN CONFORMANCE WITH THE GEOTECHNICAL RECOMMENDATIONS AND CURRENT POLICES IN PLACE AT TIME OF PLANTING.

RESIDENTIAL ROAD 22.0m ROAD ALLOWANCE 4 PARTY JOINT USE TRENCH DATE: -- REV: MAY 2022 DATE: -- DWG. No.: ROW-22

RIOCAN AVENUE

NOT FOR CONSTRUCTION

| No. | BY | DATE | DESCRIPTION |
|-----|--------|----------|----------------|
| 1 | S.L.M. | 22-06-10 | 1ST SUBMISSION |

TOPOGRAPHIC INFORMATION
TOPOGRAPHIC INFORMATION PROVIDED BY STANTEC GEOMATICS LTD., PROJECT No. 161614291-111, DATED MARCH 1, 2022.

SITE PLAN INFORMATION
SITE PLAN PROVIDED BY SRN ARCHITECTS LTD., PROJECT No. S21001, DATED FEBRUARY 3, 2022.

LEGAL INFORMATION
CALCULATED M-PLAN PROVIDED BY STANTEC GEOMATICS LTD., PROJECT No. 161614291-111, DATED MARCH 1, 2022.

BENCH MARK
ELEVATIONS ARE REFERRED TO THE CANADIAN GEODETIC VERTICAL DATUM (CGVD-1928:1978) AND ARE DERIVED FROM BENCHMARK MONUMENT No. 196530071*, HAVING A PUBLISHED ELEVATION OF 99.742 METRES

MINTO COMMUNITIES INC. **BARRHAVEN TOWN CENTRE**
GLENROY GILBERT DRIVE & RIOCAN AVENUE ROADWAY EXTENSIONS

 **DSEL**
120 Iber Road Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca



 **Ottawa**
110 Laurier Ave W
Ottawa, Ontario, K1P 1J1
Tel. (613) 580-2400
www.Ottawa.ca

STANDARD ROADWAY CROSS SECTIONS

| | | |
|-----------------|----------------|--------------------|
| DRAWN BY: AM | CHECKED BY: BC | PROJECT No. 15-816 |
| DESIGNED BY: BC | CHECKED BY: SM | SHEET No. 2 |
| SCALE: AS SHOWN | | |

CITY PLAN No. XXXXX CITY FILE No. D07-XX-XX-XXXX