

Prepared for:

BGIS GLOBAL INTEGRATED SOLUTIONS CANADA LP
4175 14th Avenue
Markham, ON
L3R 0J2

Prepared by:

J.L. RICHARDS & ASSOCIATES LIMITED
343 Preston St,
Tower 2, Suite 1000, 10th Floor,
Ottawa, Ontario,
K1S 1N4

Site Servicing Report

Hydro One Operations Centre

3440 Frank Kenny Road, Orléans ON

Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON

Table of Contents

1.0	Introduction.....	1
1.1	General	1
1.2	Site Description and Proposed Development	1
2.0	Water Servicing.....	3
2.1	Domestic Water Demands.....	3
2.2	Supply Well Water Quality	3
2.3	Supply Well Water Quantity.....	3
2.4	Fire Protection Water Demand	4
3.0	Septic System & Raised Leach Bed (Design by Golder)	5
3.1	Sewage System Design Flows	5
3.2	Treatment Units	5
3.3	Leaching Bed.....	6
4.0	Summary of Servicing	7

List of Figures

Figure 1 – Key Location Plan.....	2
-----------------------------------	---

List of Appendices

- Appendix A: Plans
- Appendix B: Domestic Water Demand
- Appendix C: WSP Golder Technical Memorandum (September 2022) - Resampling Results, Well, PW11-1, and Updated Terrain Analysis
- Appendix D: Fire Protection Water Demand
- Appendix E: Dry Hydrant Storage Tanks and Dry Hydrant Specifications
- Appendix F: Consultation Record with Local Fire Chief
- Appendix G: WSP Golder Technical Memorandum (September 2022) - New Septic System
SUBMITTED UNDER SEPARATE COVER

Site Servicing Report

Hydro One Operations Centre

3440 Frank Kenny Road, Orléans ON

1.0 Introduction

1.1 General

This Site Servicing Report has been prepared by J.L. Richards and Associates Limited (JLR) on behalf of Brookfield Global Integrated Solutions Canada LP (BGIS) to support the Site Plan Control application of Hydro One Network Inc. (HONI) new Operations Centre (OC), at 3440 Frank Kenny Road, Ottawa, Ontario.

BGIS is a privately owned property management company acting as the design builder for HONI's proposed OC development. The new building will service HONI's Business Line Operations. The facility will meet today's safety, regulatory, and industry operation standards. As well as HONI's stakeholder requirements.

In 2012 an interim development (Phase 1) was constructed on part (1.08 ha) of the site. It consisted of: a modular office, gravel parking lot, storage building, maintenance yard, and a stormwater management facility (SWMF).

In 2021, BGIS retained JLR to provide professional planning, architectural, and engineering services for the development (Phase 2) of the remaining portion (1.56 ha) of the site. Works consisting of: a one-storey permanent office building with attached maintenance garage, asphalted employee parking lot, expanded operations yard and new SWMF.

This report summarizes the development's private servicing (well and septic system) needs for water and septic. Note, that WSP Golder (Golder) was subcontracted to analysis the existing onsite well (PW11-1); and were also tasked with the design of the proposed septic system. The proposed septic system design by Golder is submitted under separate cover.


1.2 Site Description and Proposed Development

The total site area of HONI's permanent operations center is 2.65 ha. The site at 3440 Frank Kenny Road is Part of Lot 10, Concession 8, located within the City of Ottawa. The land is bounded by Frank Kenny Road to the east, a school bus storage yard to the north and farmlands, zoned General Agricultural (AG), to the south and west. Per the City of Ottawa Comprehensive Zoning By-law 2008-250, the site is within a Rural Heavy Industrial, Rural Exception Zone 35, RH [35r] zone, which permits the operations center's proposed development. Refer to **Figure 1** (below).

The site's topography is relatively flat. The front yard slopes east towards the existing City's right-of-way (ROW) ditch that spans along Frank Kenny Road. The Phase I developed area slopes southwest towards an existing SWMF. The undeveloped (farmland) portion of the site surface drains southwest and outlets to an existing open ditch.

Per the Phase 1 works the site was partially developed with: an interim modular office, gravel parking lot, storage building (two-storey), and a maintenance yard. Per the proposed works the existing interim office, gravel lot, SWMF, and temporary septic holding tank will be removed. The proposed development to consist of: permanent building (one-story office with workshop and covered vehicle storage), asphalted employee parking lot, and an expanded gravel maintenance yard; also, including various outdoor surface storage areas and a new SWMF.

File Location: P:\31000\31500-000 - HONI Orleans OPC\3-Production\1-Civil\31500-000 C KEY LOCATION PLAN.dwg

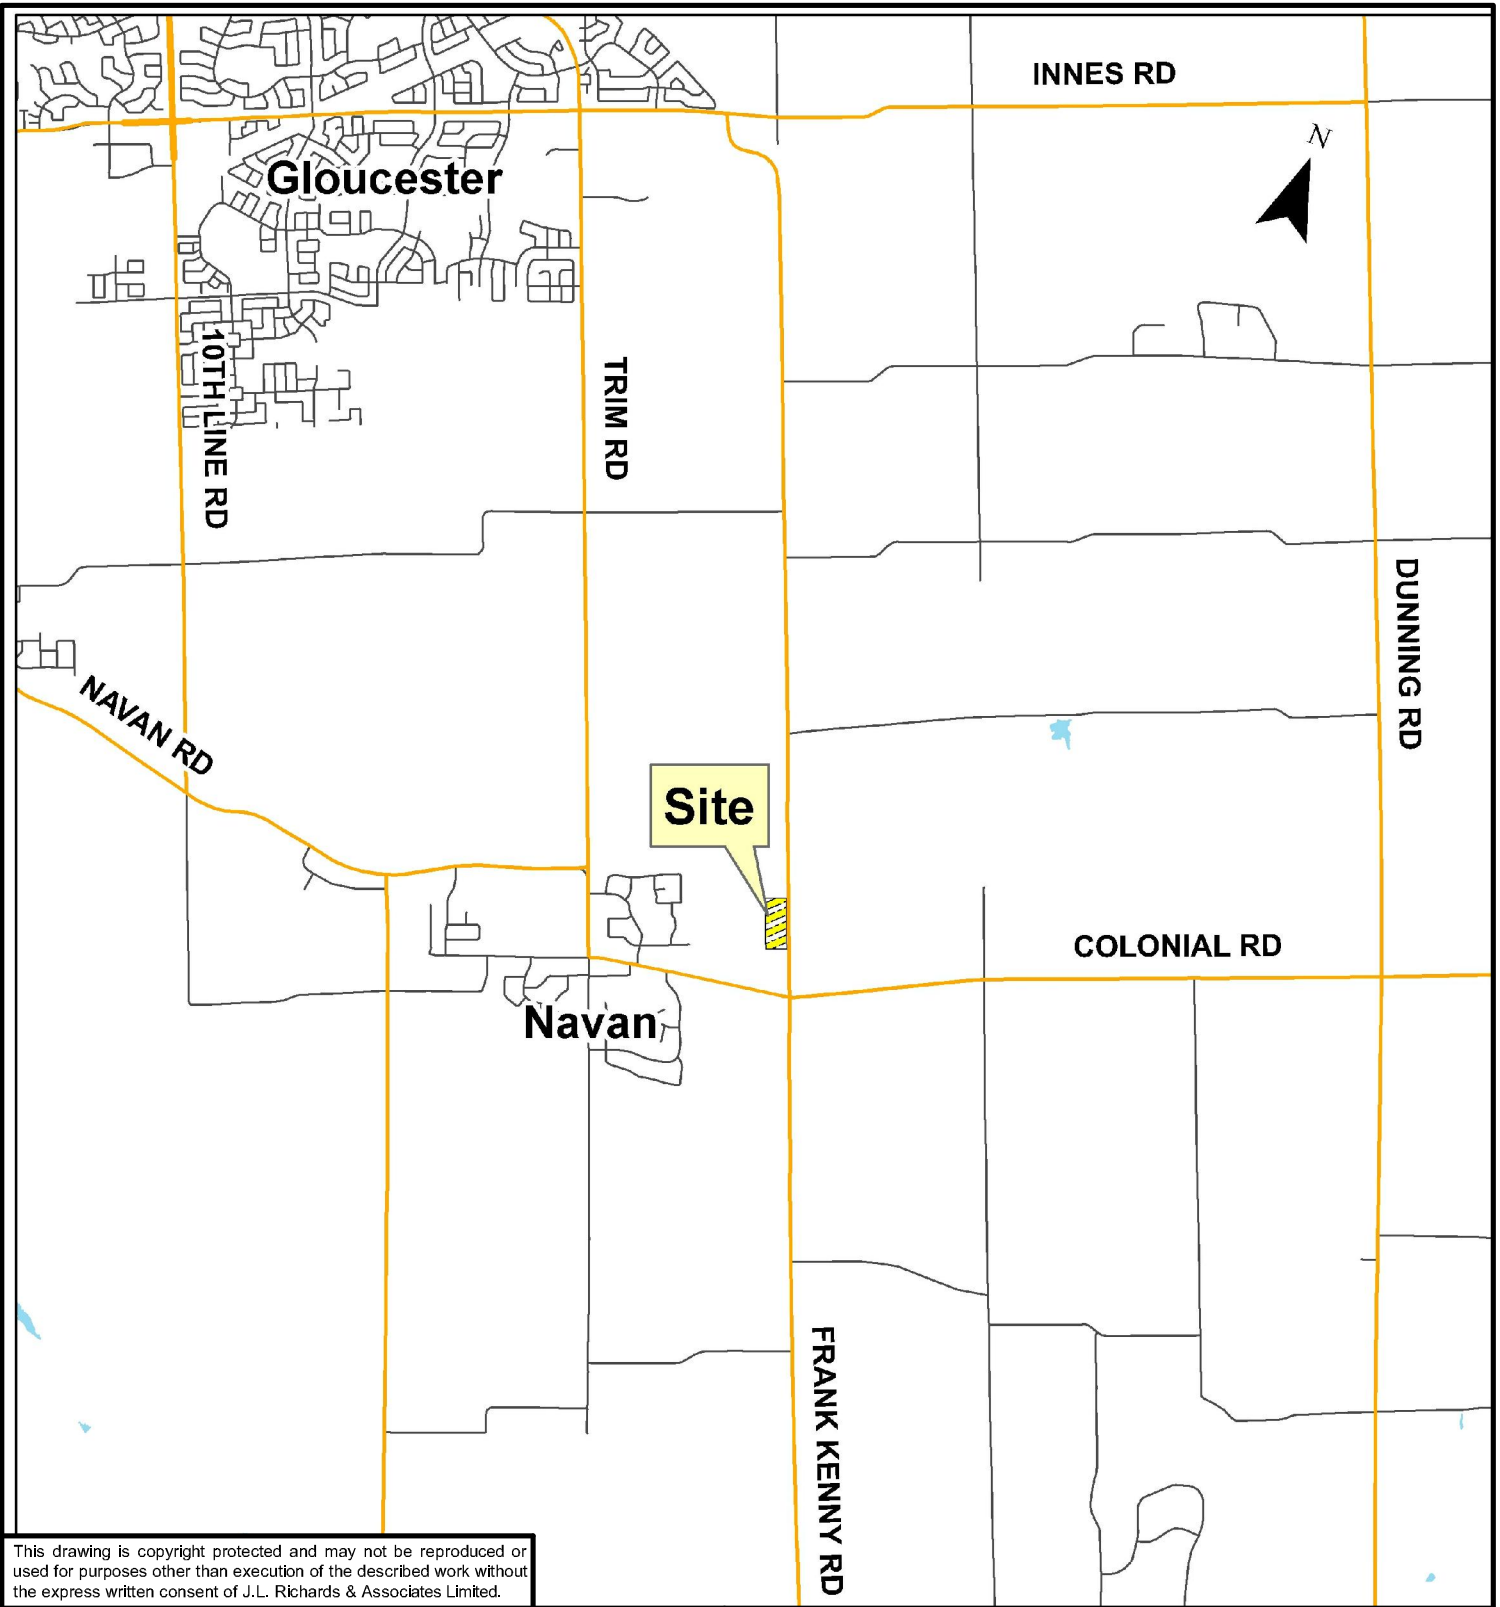

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.

PROJECT:
HYDRO ONE - ORLEANS OPERATIONS CENTER
 3440 FRANK KENNY ROAD

DRAWING:
KEY LOCATION PLAN



J.L. Richards
 ENGINEERS ARCHITECTS PLANNERS

J.L. Richards & Associates Limited
 864 Lady Ellen Place
 Ottawa, ON Canada
 K1Z 5M2
 Tel: 613 728 3571
 Fax: 613 728 6012

DESIGN: MD
 DRAWN: GC
 CHECKED: DU
 PLOTTED: Mar 29, 2022

DRAWING NO.:
FIGURE 1

JLR NO:
 31500-000

Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON

2.0 Water Servicing

2.1 Domestic Water Demands

Domestic water demand is to be met by the existing water supply well (currently servicing the interim office). The well will be disconnected from the temporary office and reconnected to the new building. The well will provide a water supply flow rate of 0.95 l/s (15 GPM), which will feed the pressure tank and supply the internal plumbing installation. The supply well pump will supply the building via a 40mm lateral. The pressure tank will provide a volume buffer between the incidental draw flow and well pumping rate.

The maximum domestic water flow rate for the building for distribution piping sizing has been calculated per OBC and based on the amount and type of plumbing fixtures in the building. This calculation has returned the value of 2.78 l/s (44 GPM). This flow rate is a maximum momentary (measured in seconds) value.

Based on the expected building operation profile, it has been estimated that the maximum coincidental flow rate will be 1.1 L/s (17.7 GPM) for 20 minutes (usage of two showers in succession for each stall in the building) once a day.

The size of the pressure tank allows for a 29-minute supply of water at the maximum coincidental flow rate while being supplied by the well (well pump operating).

Refer to Appendix A for the location of the existing well.

2.2 Supply Well Water Quality

As stated in Section 2.1, the existing onsite water supply well currently serves the domestic water needs of the interim office. The well will be disconnected from the current building and used to service the new building. WSP GOLDER (Golder) recently resampled the onsite well (PW11-1) and updated their terrain analysis from 2012 to today's City's standards.

Reference Appendix C for Golder's – Resampling Results, Well PW11-1, and Updated Terrain Analysis, Hydro One Orleans OC, Phase - Technical Memorandum (September 2022).

“The groundwater quality at well PW11-1 indicates that the water quality continues to meet acceptable standards or objectives for the analyzed parameters, with the exception of colour, hydrogen sulphide, turbidity, iron, and manganese”

A copy of the technical memo and the full well quality test results and recommendations can be found in Appendix C.

2.3 Supply Well Water Quantity

As stated in Golder's well resampling technical memo dated September 8, 2022,

“Golder's 2012 report concluded that well PW11-1 was capable of supplying at least 16,350 L/day (i.e., more than the current estimated daily water demand for Phase 2 of the site). This capacity remains sufficient to provide water supply to Phase 2 of the development.”

Site Servicing Report

Hydro One Operations Centre

3440 Frank Kenny Road, Orléans ON

For full well water quantities, refer to Golder's well resampling technical memorandum in Appendix C.

2.4 Fire Protection Water Demand

Fire water supply and storage on site is a requirement under Part 3 of the Ontario Building Code (OBC). Since the proposed building footprint is over 600 square meters and the building is a Part 9 Building with respect to the Ontario Building Code, onsite fire water supply and storage is required for this building. Fire protection for the proposed building was designed according to the OBC design methodology. The supply well and pressurized storage tanks stated in Section 2.1 will not be supplying any water for fire protection. The required fire flow will be provided solely from underground storage tanks and a dry hydrant. The mechanical engineer calculated the required fire flow rate to be 5,400 l/min (90 l/s). A total capacity of 183,110 L is required on site. Refer to Appendix A for the proposed locations and Appendix D for the fire protection design calculations prepared by JLR. Detailed specifications of the storage tanks and hydrants are provided in Appendix E. A total of three (3) fire storage tanks will be installed on site with a total working capacity of 260,256 L.

Consultation with the local fire chief was held to confirm fire flow requirements and a copy is provided in Appendix F.

Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON

3.0 Septic System & Raised Leach Bed (Design by Golder)

As no municipal sanitary services are available at this site, the sewage flows from the proposed development will be managed via a New Septic System, consisting of treatment units and a raised leaching bed. Refer to Golder's Technical Memorandum (P/N 21493887), Hydro One Operations Centre, Phase 2, dated September 2022 - SUBMITTED UNDER SEPARATE COVER.

The proposed footprint locations of the septic system's tanks and raised leach bed are shown on the Civil Site Plans, under Appendix A of this report.

3.1 Sewage System Design Flows

Per WSP Golder's Technical Memoranda

"The total daily design sanitary sewage flow has been calculated to be 6,329 L/d for both normal and emergency operations as the floor area of the office governs the calculations, and also since the staffing for field staff has not been included directly, but instead assessed based on the warehouse facilities."

Detail calculations are provided in Golder's Technical Memoranda which is submitted under separate cover.

3.2 Treatment Units

Per WSP Golder's Technical Memoranda

"A Class 4 Sewage System, as per Section 8.6 of the OBC, is proposed to service the new building and will consist of the Waterloo Biofilter basket tank system, model BT-15500. The system will also consist of an anaerobic digester (septic tank) with a volume of 13,625 L (model number 13625AD), followed by separate 6,000 L pump tank that will be used to dose the final 15,500 L Biofilter basket tank. Refer to Sewage System Plan" (WSP Golder, 2022)

"Due to the anticipated elevations of the tanks and leaching bed, a second alternating duplex pump system will be required to dose the leaching bed. Waterloo Biofilter has confirmed that these pumps can be installed with the Biofilter basket tank" (WSP Golder, 2022)

"... the treatment unit will be constructed as a double-pass system for denitrification, which requires recirculation to the anaerobic digester." (WSP Golder, 2022)

"The 32 mm diameter recirculation forcemain will provide approximately 50% recirculation of treated effluent back to the anaerobic digester..." (WSP Golder, 2022)

"The treatment units have been located on the site to confirm with the minimum clearance distance as set out in Table 8.2.1.6.A of the OBC." (WSP Golder, 2022)

Treatment unit details are provided in Golder's Technical Memoranda which is submitted under separate cover.

Site Servicing Report

Hydro One Operations Centre

3440 Frank Kenny Road, Orléans ON

3.3 Leaching Bed

As part of the new septic system a mounded leaching bed will be built. Detail design of the system was conducted by WSP Golder's. Reference the Technical Memoranda in Appendix G.

In summary per WSP Golder's Technical Memoranda

"... the system will require a contact area of 791 m². A contact area measuring 25.0 m x 31.7 m has been provided, which provides a contact area of 792.5 m². Refer to Sewage System Plan, Figure 1 in Appendix B." (WSP Golder, 2022)

"... the system will require a stone area of 127 m². A stone area measuring 6 m x 21.2 m has been provided, which provides a contact area of 127 m². Refer to Sewage System Plan, Figure 1 in Appendix B." (WSP Golder, 2022)

"The leaching bed is proposed over the existing gravel parking lot for the Phase 1 building. Therefore, the gravel for the parking lot is proposed to be removed down to the native soils." (WSP Golder, 2022)

For further details of the proposed leaching bed reference Golder's Technical Memoranda which is submitted under separate cover.

Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON

4.0 Summary of Servicing

This Site Servicing Report, associated site plans and technical memos describe the proposed servicing solutions for HONI's permanent operations center. A summary of the servicing details is described below:

- Domestic water demands for the New Facility to be supplied by the existing onsite supply well (which is currently servicing the interim office), including a new onsite pressurized storage tank.
- Fire protection will be provided by underground water storage tanks and a dry hydrant. Water supply for the tanks is anticipated to be trucked to the site.
- Sanitary sewage from the proposed building to be treated via a new septic system. The Septic System is designed by Golder, design calculations and plans are submitted under separate cover.
- Natural Gas is proposed to service the new OC Facility. Refer to Appendix A for proposed locations.
- The existing transformer servicing the interim office and existing storage shed will be relocated to provide electricity to the new OC Facility. Refer to Appendix A for proposed locations and Electrical Plans (under separate cover).

**Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON**

This report has been prepared for the exclusive use of BGIS, for the stated purpose, for the named facility. Its discussions and conclusions are summary in nature and cannot be properly used, interpreted or extended to other purposes without a detailed understanding and discussions with the client as to its mandated purpose, scope and limitations. This report was prepared for the sole benefit and use of BGIS and may not be used or relied on by any other party without the express written consent of J.L. Richards & Associates Limited.

This report is copyright protected and may not be reproduced or used, other than by BGIS for the stated purpose, without the express written consent of J.L. Richards & Associates Limited.

J.L. RICHARDS & ASSOCIATES LIMITED

Prepared by:


Reviewed by:

Marie-France Duthilleul, P. Eng.
Senior Civil Engineer

Kris Mierzejewski, M.Sc.,P.Eng.
Mechanical Engineer

Appendix A

Plans

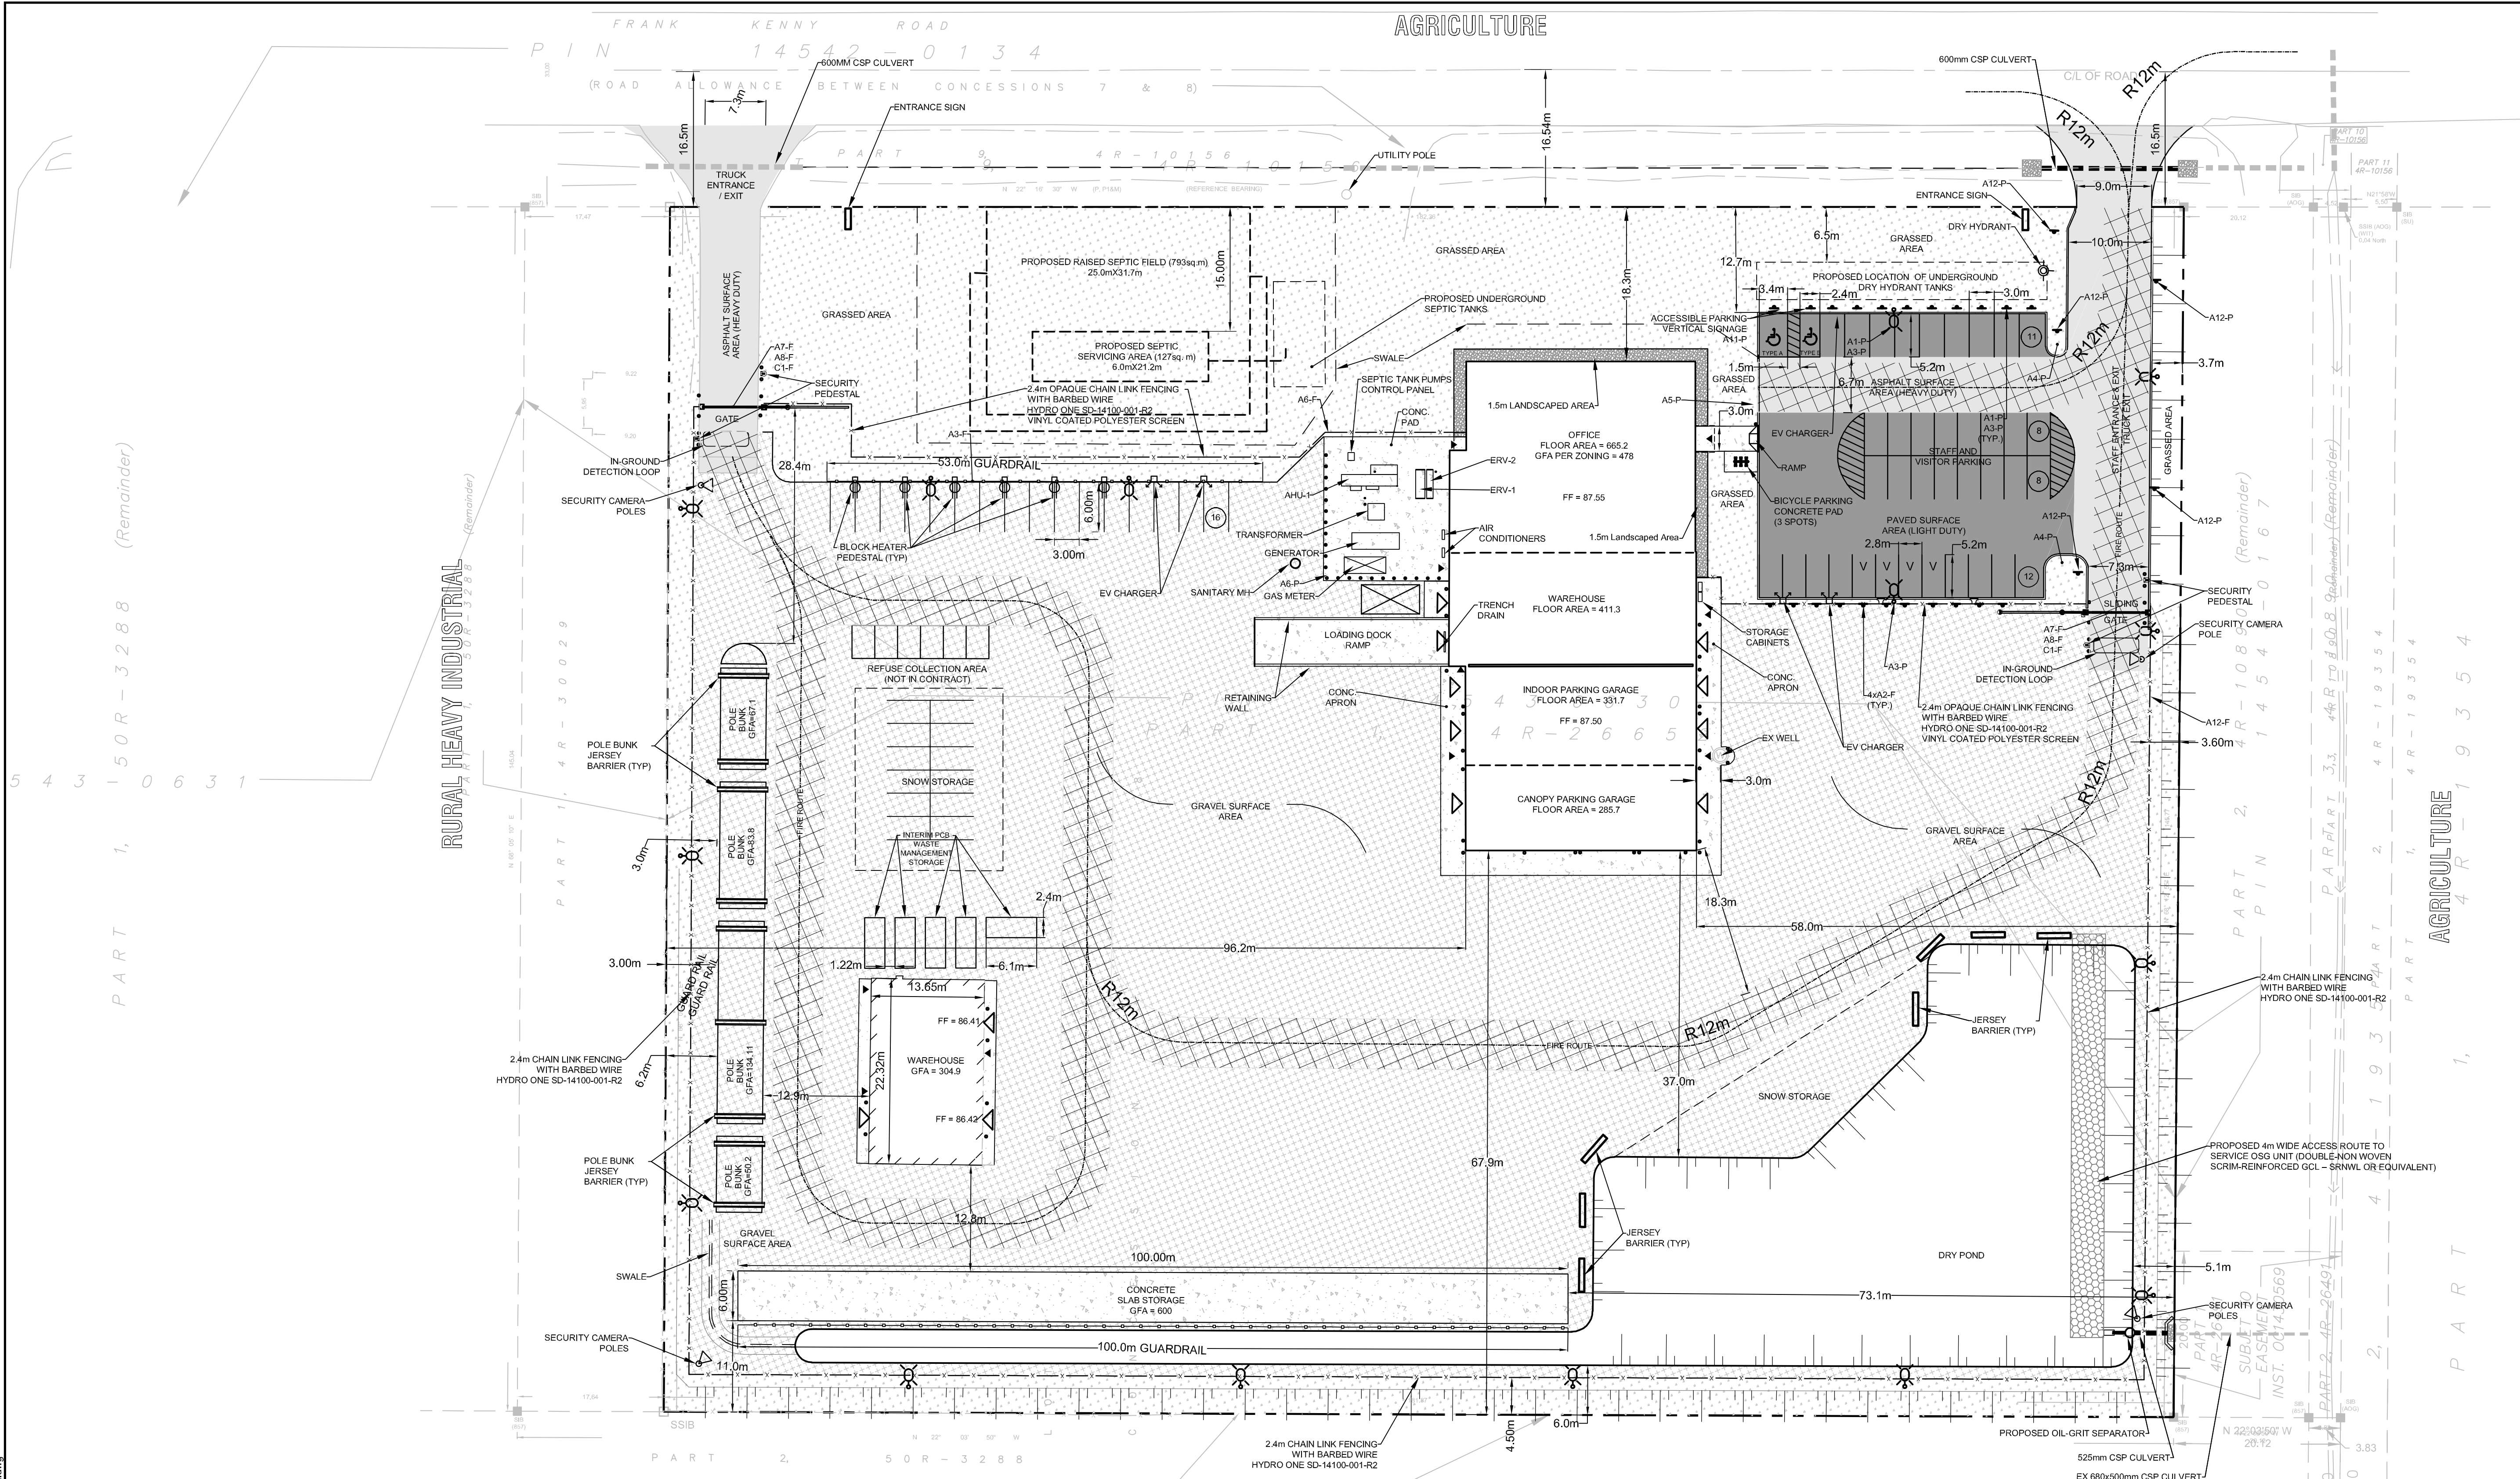

LEGEND

- PEDESTRIAN DOOR LOCATION (EXIT/ACCESS DOOR)
- OVERHEAD DOOR LOCATION
- LIGHTING FIXTURE
- BARRIER FREE PARKING SPACE
- BARRIER FREE RAMP COMPLETE WITH CURB DEPRESSION
- PARKING COUNT
- BOLLARDS TYP.
- JERSEY BARRIER
- PROPERTY LIMITS
- LOADING SPACE
- FIRE ROUTE
- HEAVY DUTY ASPHALT
- LIGHT DUTY ASPHALT
- GRASS
- CONCRETE
- GRAVEL
- LANDSCAPED AREA
- SAND

PRELIMINARY DESIGN

THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DD/MM/YY
02	RE-ISSUED FOR CITY SITE PLAN APPROVAL	12/09/22
01	ISSUED FOR CITY SITE PLAN APPROVAL	06/04/22
00	ISSUED FOR CLIENT REVIEW	04/04/22

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.

VERIFY SHEET SIZE AND SCALES. BAR TO THE RIGHT IS 25mm IF THIS IS A FULL SIZE DRAWING.

SCALE: 1:400

CLIENT:

hydro one BGIS

CONSULTANT:

JLR J.L. Richards
ENGINEERS - ARCHITECTS - PLANNERS

CONSULTANT:

PROFESSIONAL STAMP

ONARIO ASSOCIATION OF ARCHITECTS
JOHN MARSH FERRER
LICENCE 5445

PROJECT NORTH

PROJECT:

HYRO ONE OPERATIONS CENTRE, ORLEANS

3440 FRANK KENNY ROAD

DRAWING:

SITE PLAN

DESIGN: MR
DRAWN: KTK
CHECKED: MF
JLR #: 31500-000

DRAWING #: **C-001**

ADDRESS: 3440 FRANK KENNY ROAD
LEGAL DESCRIPTION: CON 8 PT LOT 10 RP-4R-30029 PART 2
ZONING PROVISION: CITY OF OTTAWA ZONING BYLAW 2008-250 R4(RSR); RURAL HEAVY INDUSTRIAL, EXCEPTION 35
PROPERTY AREA: 2.648 HA

1. PART 13 - RURAL ZONES - SECTIONS 221 AND 222 - RURAL HEAVY INDUSTRIAL ZONE

PERMITTED USES: HEAVY INDUSTRIAL USE, WAREHOUSE, STORAGE YARD, PARKING GARAGE

ZONE PROVISIONS

ZONING MECHANISMS	ZONE PROVISIONS	PROPOSED
A. MINIMUM LOT AREA (M ²)	8,000	26,480
B. MINIMUM LOT FRONTAGE (M)	50	182.36
C. FRONT YARD SETBACK (M)	15	18.3
D. INTERIOR SIDE YARD SETBACK (M)	10	58.0
E. CORNER SIDE YARD SETBACK (M)	15	
F. REAR YARD SETBACK (M)	15	67.9
G. HEIGHT (M)	15	8.1
F. LOT COVERAGE (%)	50	7

2. PARKING REQUIRED (SEC. 101-102) AREA D

USE	REQUIRED	PROPOSED (TOTAL ON-SITE)
OFFICE	2,410 sq m OF GFA / 478 sq m	38
STORAGE YARD	1,100 sq m GFA / 935.2 sq m	9
WAREHOUSE	0.8 PER 100 sq m OF GFA / 716.2 sq m	6
PARKING GARAGE	0 REQUIRED / 617.4 sq m	0
TOTAL		24

ACCESSIBLE PARKING

TYPE	REQUIRED	PROPOSED
TYPE A (3.4 M X 5.2 M MIN)	1	1
TYPE B (2.4 X 5.2 M MIN)	1	1


3. BICYCLE PARKING SPACE (SEC. 111)

USE	REQUIRED	PROVIDED
OFFICE: 1 PER 250 sq m / (865 sq m)	3	
STORAGE YARD: 1 PER 2000 sq m / (1,553 sq m)	0	3
WAREHOUSE: 1 PER 2000 sq m / (300 sq m)	0	

4. LOADING SPACE RATES AND PROVISIONS (SEC. 113)

TABLE 113A- MINIMUM NUMBER OF VEHICLE LOADING SPACES REQUIRED

LAND USE	REQUIRED	PROVIDED
OFFICE		
STORAGE YARD	1	1
WAREHOUSE		

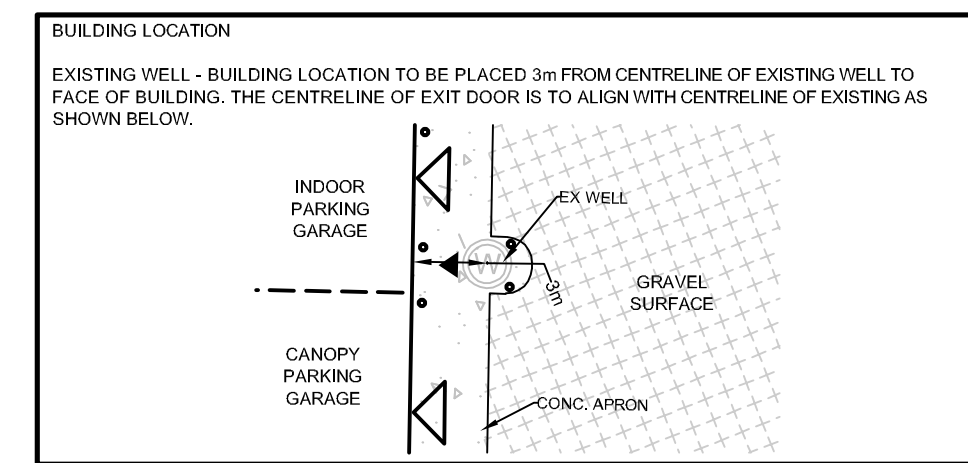

SIGN LEGEND

REFER TO SITE SIGNAGE GRAPHICS SPECIFICATIONS FOR ADDITIONAL INFORMATION

- XX-L MOUNTED ON LIGHT POLE
- XX-P MOUNTED ON U-L CHANNEL POST
- XX-F MOUNTED ON FENCE

PAVEMENT DESIGN

LIGHT-DUTY PAVEMENT STRUCTURE (CAR PARKING AREAS):
50 MM - H.L. 3 SURFACE COURSE OR 12.5 SUPERPAVE
150 MM - BASE - OPSS GRANULAR A
450 MM - SUBBASE - OPSS GRANULAR B TYPE II

HEAVY-DUTY PAVEMENT STRUCTURE (ACCESS LANES AND PAVED TRUCK TRAFFIC AREAS):
40 MM - H.L. 3 SURFACE COURSE OR 12.5 SUPERPAVE
50 MM - H.L. 8 BINDER COURSE OR 19.0 SUPERPAVE
150 MM BASE - OPSS GRANULAR A
450 MM SUBBASE - OPSS GRANULAR B TYPE II

GRANULAR TRAFFIC AREAS (UNPAVED ACCESS LANES AND TRUCK TRAFFIC AREAS):
250 MM BASE - OPSS GRANULAR A
450 MM SUBBASE - OPSS GRANULAR B TYPE II

NOTE:

BOUNDARY SURVEY
BOUNDARY INFORMATION DERIVED FROM REGISTERED SURVEY 4R-30029 PREPARED BY FARRHALL MOFFATT & WOODLAND LIMITED DATED JANUARY 3, 2017
VERIFIED BY FARRHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
HORIZONTAL DATUM: MTM ZONE 9, NAD 83 (ORIGINAL)

EASEMENT SURVEY
EASEMENT INFORMATION DERIVED FROM REGISTERED SURVEY 4R-26491 PREPARED BY FARRHALL MOFFATT & WOODLAND LIMITED DATED SEPTEMBER 18, 2012
VERIFIED BY FARRHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
HORIZONTAL DATUM: MTM ZONE 9, NAD 83 (ORIGINAL)

TOPOGRAPHIC SURVEY
TOPOGRAPHIC SURVEY PREPARED BY FARRHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
HORIZONTAL DATUM: MTM ZONE 9, NAD 83 (ORIGINAL)
VERTICAL DATUM: CANADIAN GEODETIC VERTICAL DATUM OF 1928 (CGVD28)


File Location: P:\31000\31500-000 - HONM Orleans OPCIS-Production\1-CH\31500-000 P_Site Plan.dwg

PLOT DATE: Tuesday, September 13, 2022 12:27:07 PM

NOTE:
 BOUNDARY SURVEY
 BOUNDARY INFORMATION DERIVED FROM REGISTERED SURVEY 49-2029 PREPARED BY
 FARHALL WOFFATT & WOODLAND LIMITED DATED JANUARY 3, 2017
 VERIFIED BY FARHALL WOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
 HORIZONTAL DATUM: MTN ZONE 8, NAD 83 (ORIGINAL)

BASIS SURVEY
 BASIS INFORMATION DERIVED FROM REGISTERED SURVEY 48-26491 PREPARED BY
 FARHALL WOFFATT & WOODLAND LIMITED DATED SEPTEMBER 8, 2012
 VERIFIED BY FARHALL WOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
 HORIZONTAL DATUM: MTN ZONE 8, NAD 83 (ORIGINAL)

TOPOGRAPHIC SURVEY
 TOPOGRAPHIC SURVEY PREPARED BY
 FARHALL WOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
 HORIZONTAL DATUM: MTN ZONE 8, NAD 83 (ORIGINAL)
 VERTICAL DATUM: CANADIAN GEODETIC VERTICAL DATUM (D 1985) (CGVD08)



PRELIMINARY DESIGN

THESE DOCUMENTS ARE NOT COMPLETE
 IN ALL DETAILS AND MAY BE SUBJECT TO
 CHANGE AS DESIGN DEVELOPMENT AND
 CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DATE
01	ISSUED FOR CITY SITE PLAN APPROVAL	06/04/22
02	ISSUED FOR CITY SITE PLAN APPROVAL	06/04/22
03	ISSUED FOR CLIENT REVIEW	06/04/22

No. _____ ISSUE / REVISION _____ DATE _____

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.

VERIFY SHEET ARE AND SCALES, BAR TO THE RIGHT IS CORRECT THIS IS A FULL SIZE DRAWING.

SCALE: 1:400

0 10 20 30m

CLIENT:

hydro one BGIS

CONSULTANT:

J.L. Richards
 ENGINEERS-ARCHITECTS-PLANNERS

REGISTERED PROFESSIONAL ENGINEER

M. DUFFILLEUIL
 10225184

PROVINCE OF ONTARIO

PROJECT NORTH


HYDRO ONE OPERATIONS CENTRE, ORLEANS

3440 FRANK KENNEY ROAD


EXISTING CONDITIONS & DEMO PLAN

DESIGN: M.D.	DRAWING: F
DRAWN: C.C.	CHECKED: D.U.
JUR: 31600-000	C-002

D07-12-22-0057

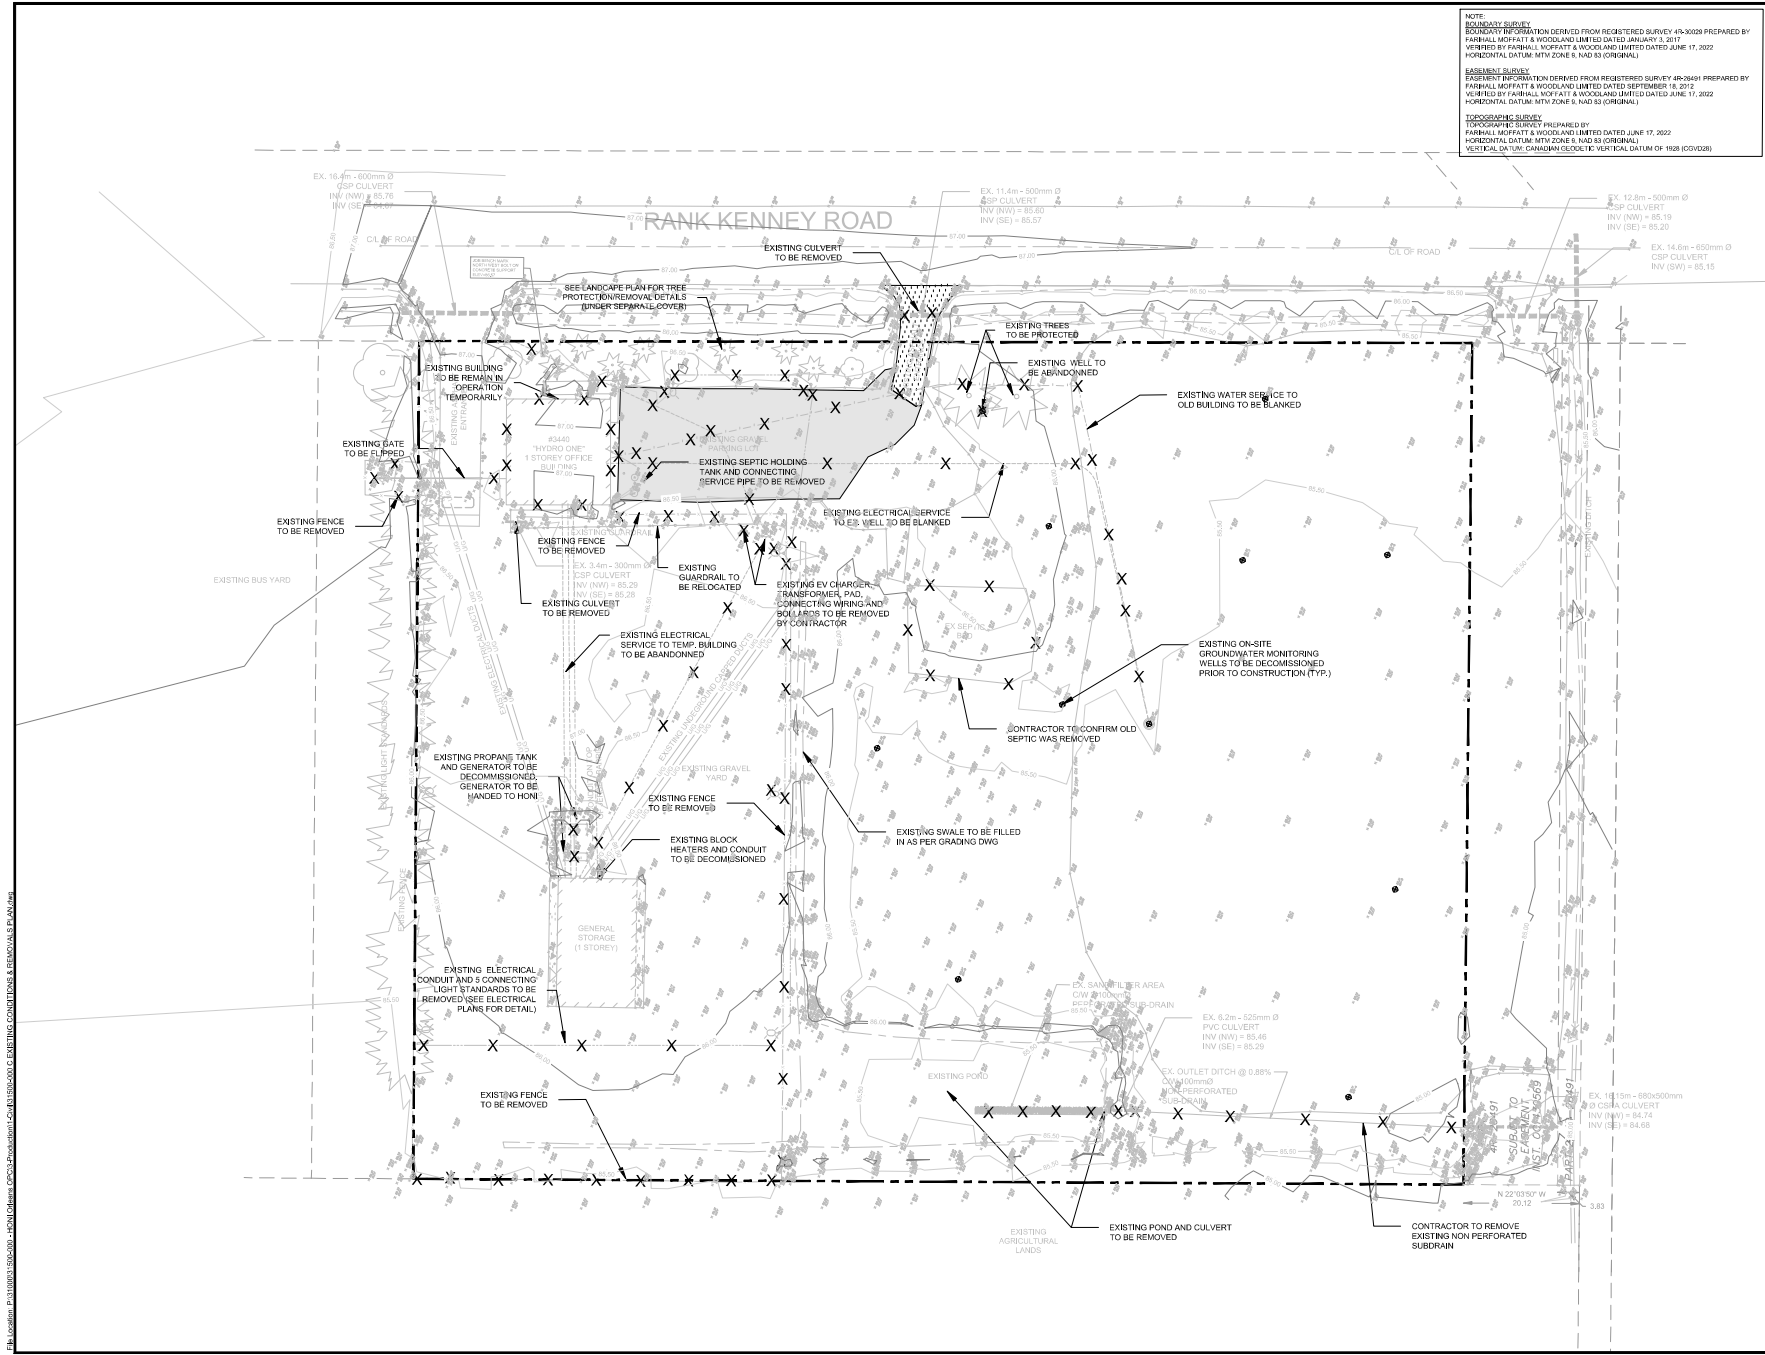


This location is not intended to be used for any other purpose than the one stated on the title block. All other uses are subject to the approval of the relevant authorities.

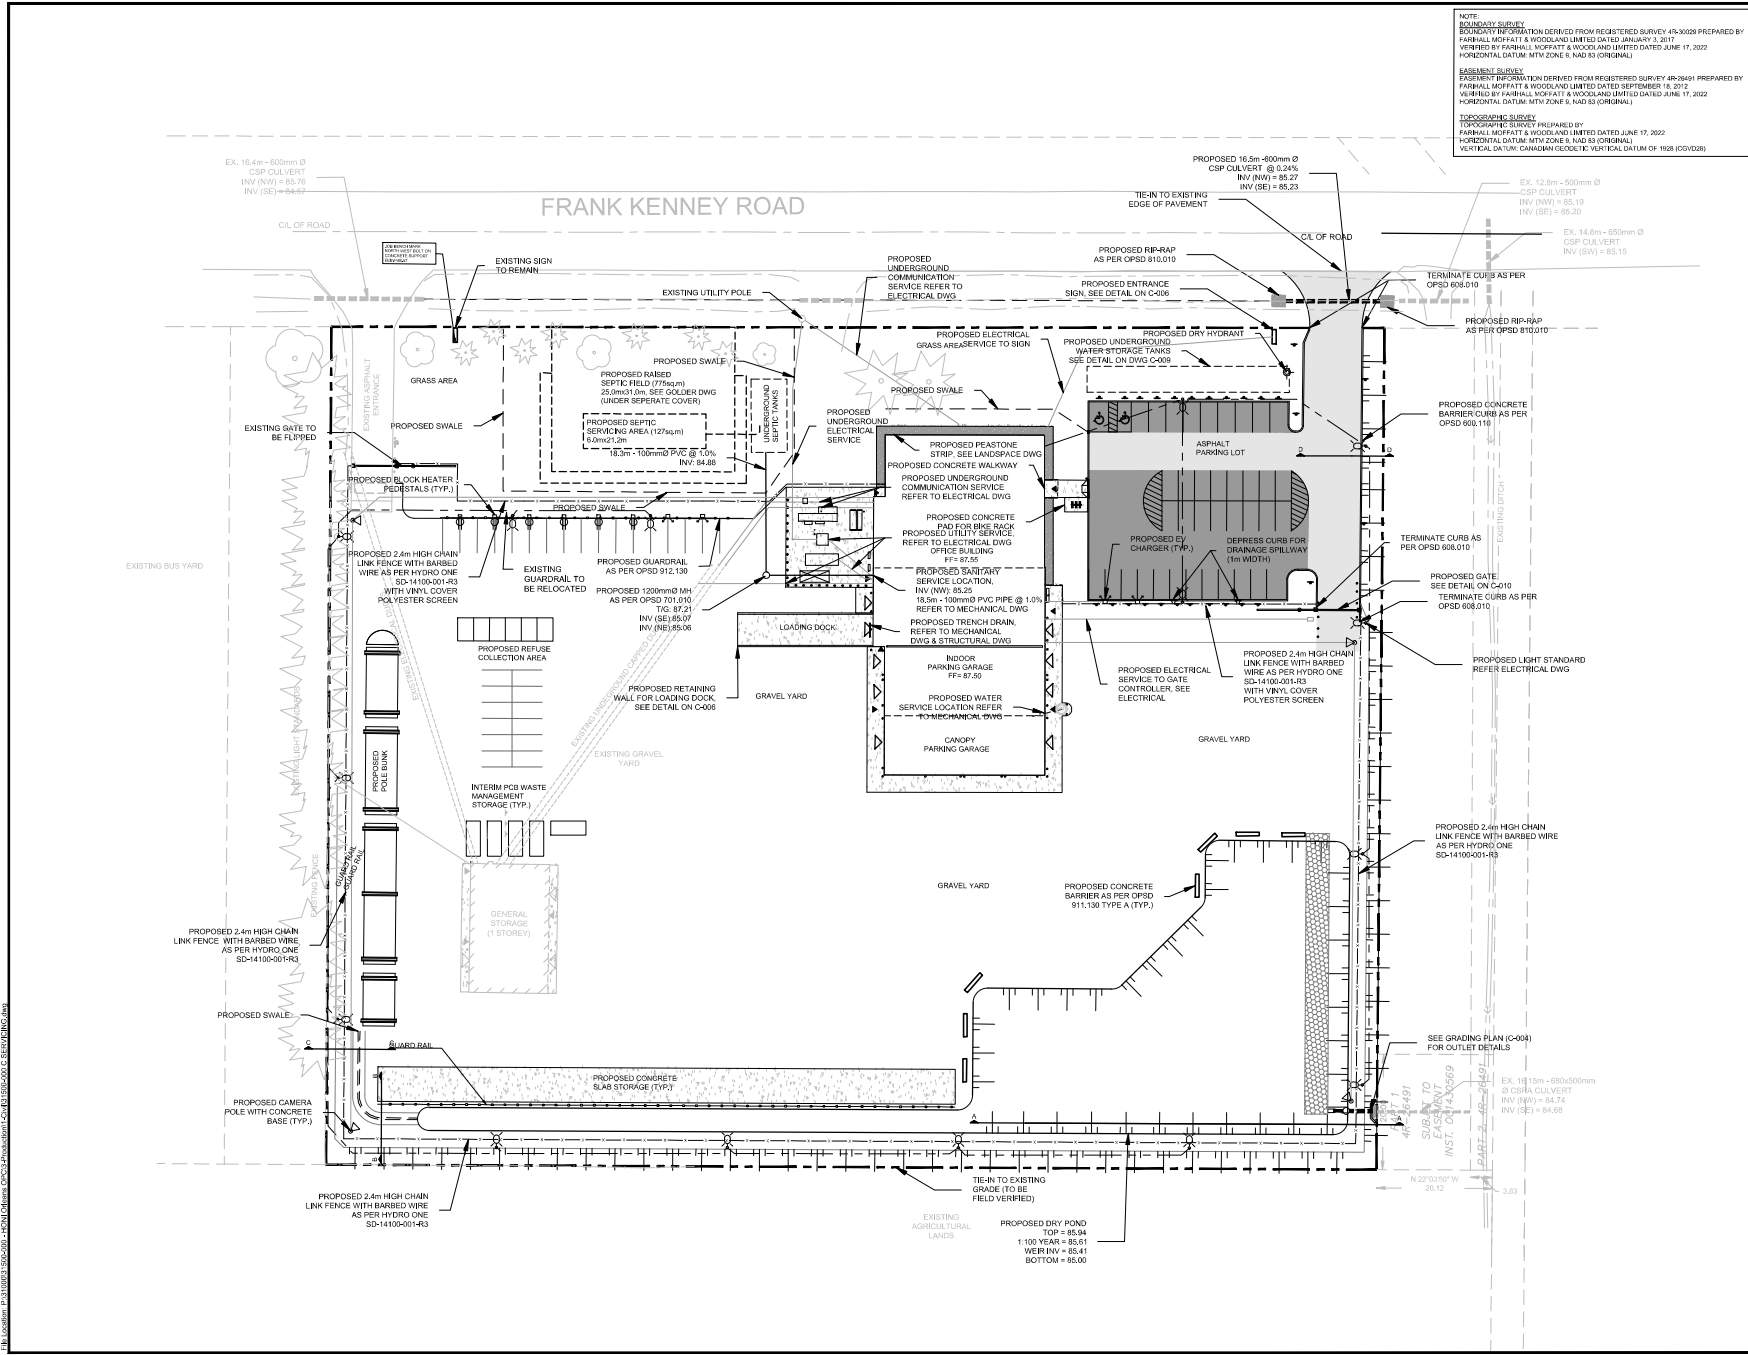

NOTE:
 BOUNDARY SURVEY
 BOUNDARY INFORMATION DERIVED FROM REGISTERED SURVEY 43-2029 PREPARED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JANUARY 3, 2017
 VERIFIED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
 HORIZONTAL DATUM: NAD 83 (ORIGINAL)

EASEMENT SURVEY
 EASEMENT INFORMATION DERIVED FROM REGISTERED SURVEY 48-26491 PREPARED BY FARHALL MOFFATT & WOODLAND LIMITED DATED SEPTEMBER 18, 2012
 VERIFIED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
 HORIZONTAL DATUM: NAD 83 (ORIGINAL)

TOPOGRAPHIC SURVEY
 TOPOGRAPHIC SURVEY PREPARED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022
 HORIZONTAL DATUM: NAD 83 (ORIGINAL)
 VERTICAL DATUM: CANADIAN GEODESIC VERTICAL DATUM OF 1985 (CGVD08)

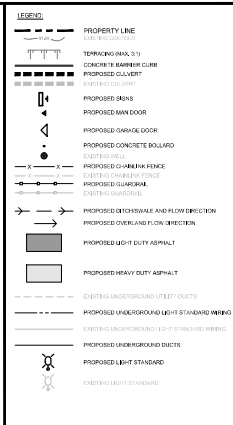

PRELIMINARY DESIGN

THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DATE
02	REBUILT FOR CITY SITE PLAN APPROVAL	12/09/22
01	ISSUED FOR CITY SITE PLAN APPROVAL	09/04/22
00	ISSUED FOR CLIENT REVIEW	04/04/22

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.
 VERIFY SHEET DIMS AND SCALES, BAR TO THE RIGHT IS 20mm/1" TO 1/8" FULL SIZE DRAWING.
 SCALE: 1:400
 CLIENT: hydro one BGIS
 CONSULTANT: J.L. Richards ENGINEERS-ARCHITECTS-PLANNERS
 PROJECT: HYDRO ONE OPERATIONS CENTRE, ORLEANS
 DRAWING: SERVICING PLAN
 DESIGNER: M.D.
 DRAWN: C.C.
 CHECKED: D.U.
 DATE: 31500-000


PROJECT: HYDRO ONE OPERATIONS CENTRE, ORLEANS

3440 FRANK KENNY ROAD

SERVICING PLAN

DESIGNER: M.D.
 DRAWN: C.C.
 CHECKED: D.U.
 DATE: 31500-000


D07-12-22-0057

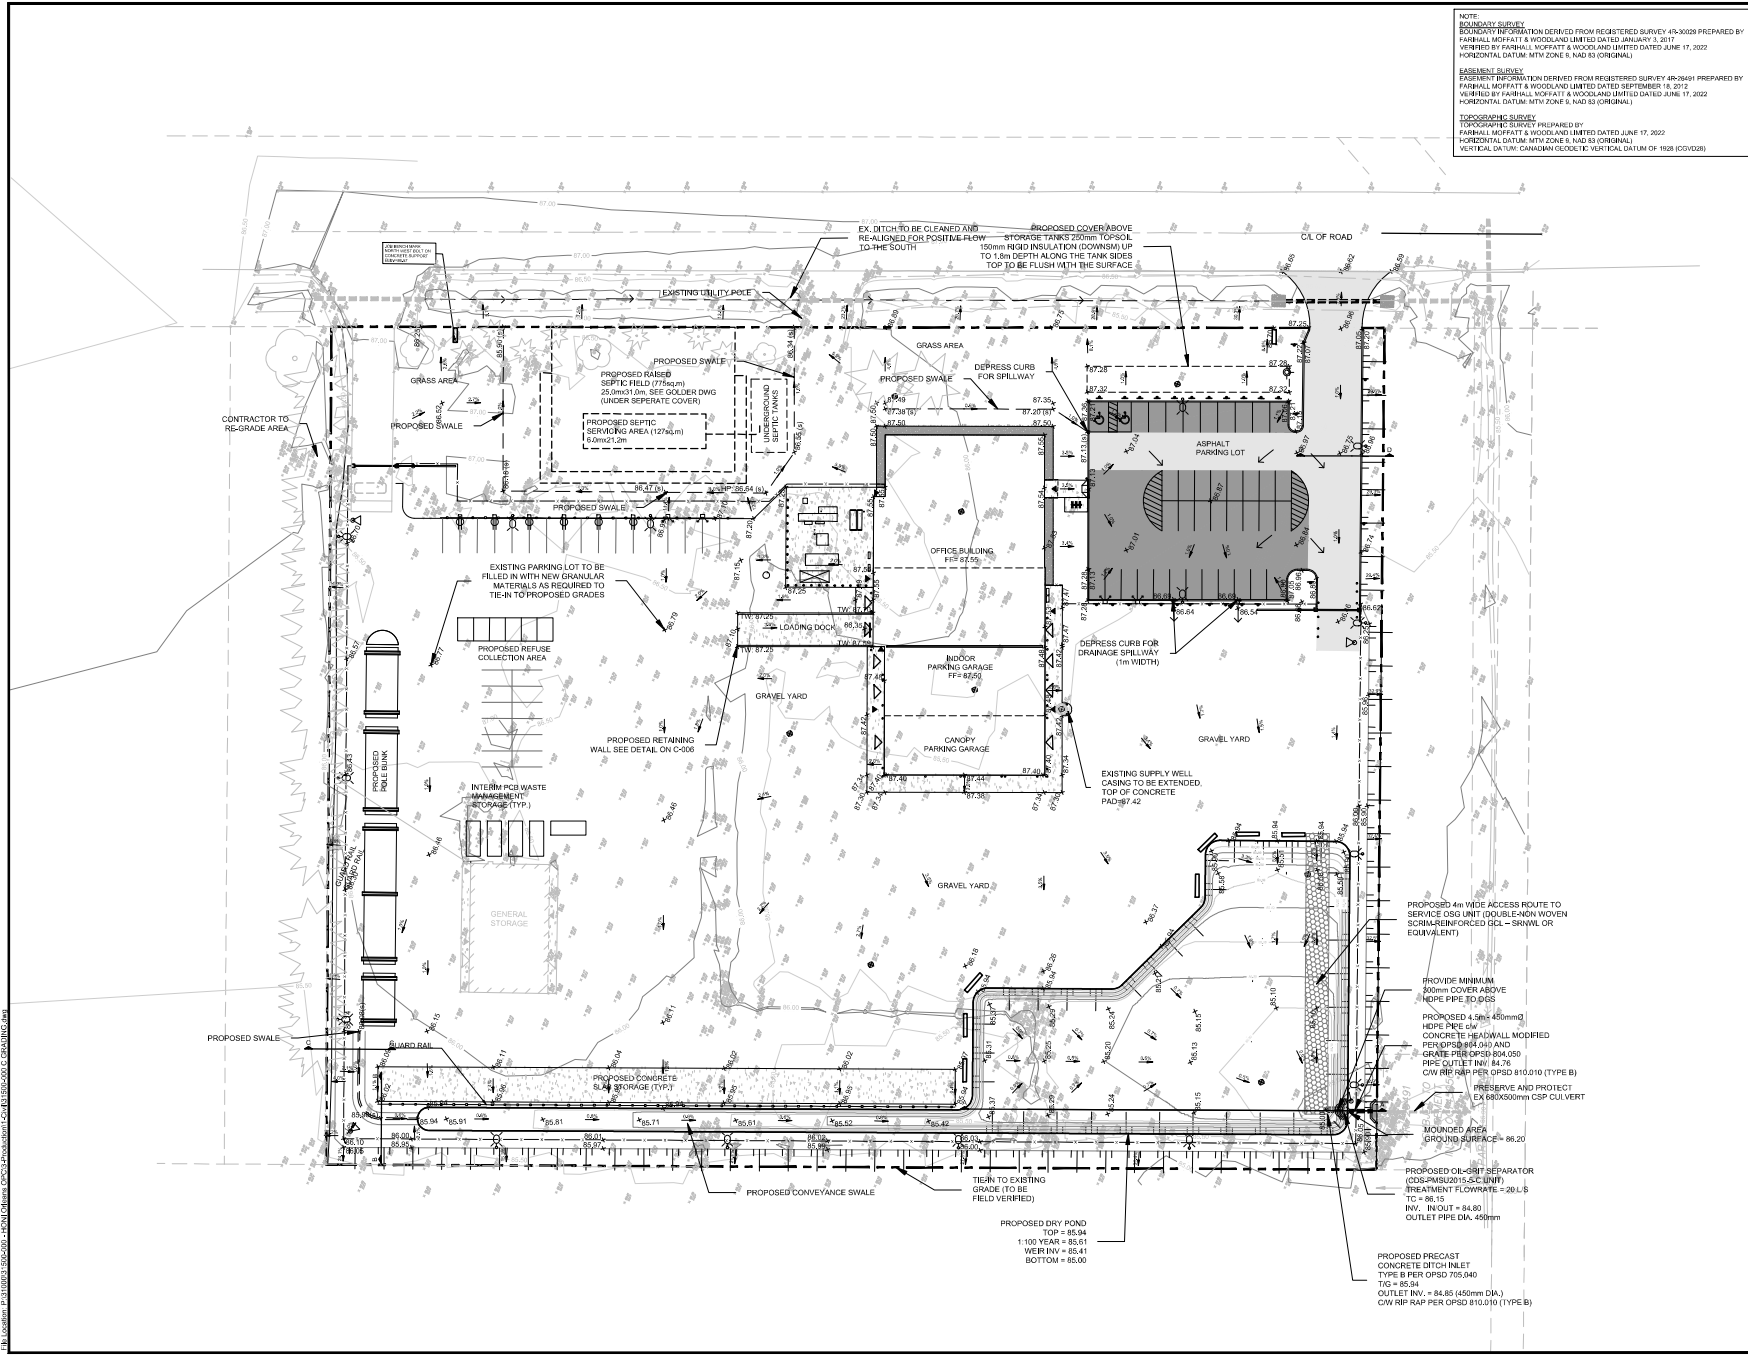

NOTE:
 BOUNDARY SURVEY
 BOUNDARY INFORMATION DERIVED FROM REGISTERED SURVEY 48-2009 PREPARED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JANUARY 3, 2017. VERIFIED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. HORIZONTAL DATUM: MTW ZONE 8, NAD 83 (ORIGINAL).

EASEMENT SURVEY
 EASEMENT INFORMATION DERIVED FROM REGISTERED SURVEY 48-20491 PREPARED BY FARHALL MOFFATT & WOODLAND LIMITED DATED SEPTEMBER 18, 2012. VERIFIED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. HORIZONTAL DATUM: MTW ZONE 8, NAD 83 (ORIGINAL).

TOPOGRAPHIC SURVEY
 TOPOGRAPHIC SURVEY PREPARED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. VERIFIED BY FARHALL MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. HORIZONTAL DATUM: MTW ZONE 8, NAD 83 (ORIGINAL). VERTICAL DATUM: CANADIAN GEODESIC VERTICAL DATUM OF 1985 (CGVD08).

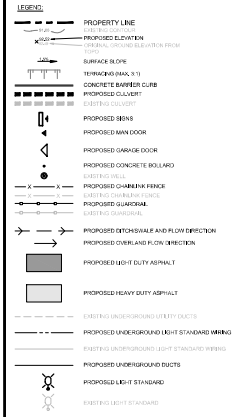

PRELIMINARY DESIGN
 THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DATE
02	RE48UBUD FOR CITY SITE PLAN APPROVAL	12/09/22
01	ISSUED FOR CITY SITE PLAN APPROVAL	06/04/22
00	ISSUED FOR CLIENT REVIEW	04/04/22

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.
 VERIFY SHEET ARE AND SCALES, BAR TO THE RIGHT IS SHOWN THIS IS A FULL SIZE DRAWING.
 SCALE: 1:400
 CLIENT: HYDRO ONE
 CONSULTANT: J.L. Richards
 PROJECT NORTH

hydro one BGIS

J.L. Richards
 ENGINEERS-ARCHITECTS-PLANNERS

PROFESSIONAL DESIGN
 LICENSED PROFESSIONAL ENGINEER
 M. DUTILLIEUL
 102205184
 PROVINCE OF ONTARIO

PROJECT NORTH


HYDRO ONE OPERATIONS CENTRE, ORLEANS

3440 FRANK KENNY ROAD

GRADING PLAN

DESIGN: M.D.
 DRAWN: G.C.
 CHECKED: D.U.
 DATE: 3/16/2020

DRAWING # C-004

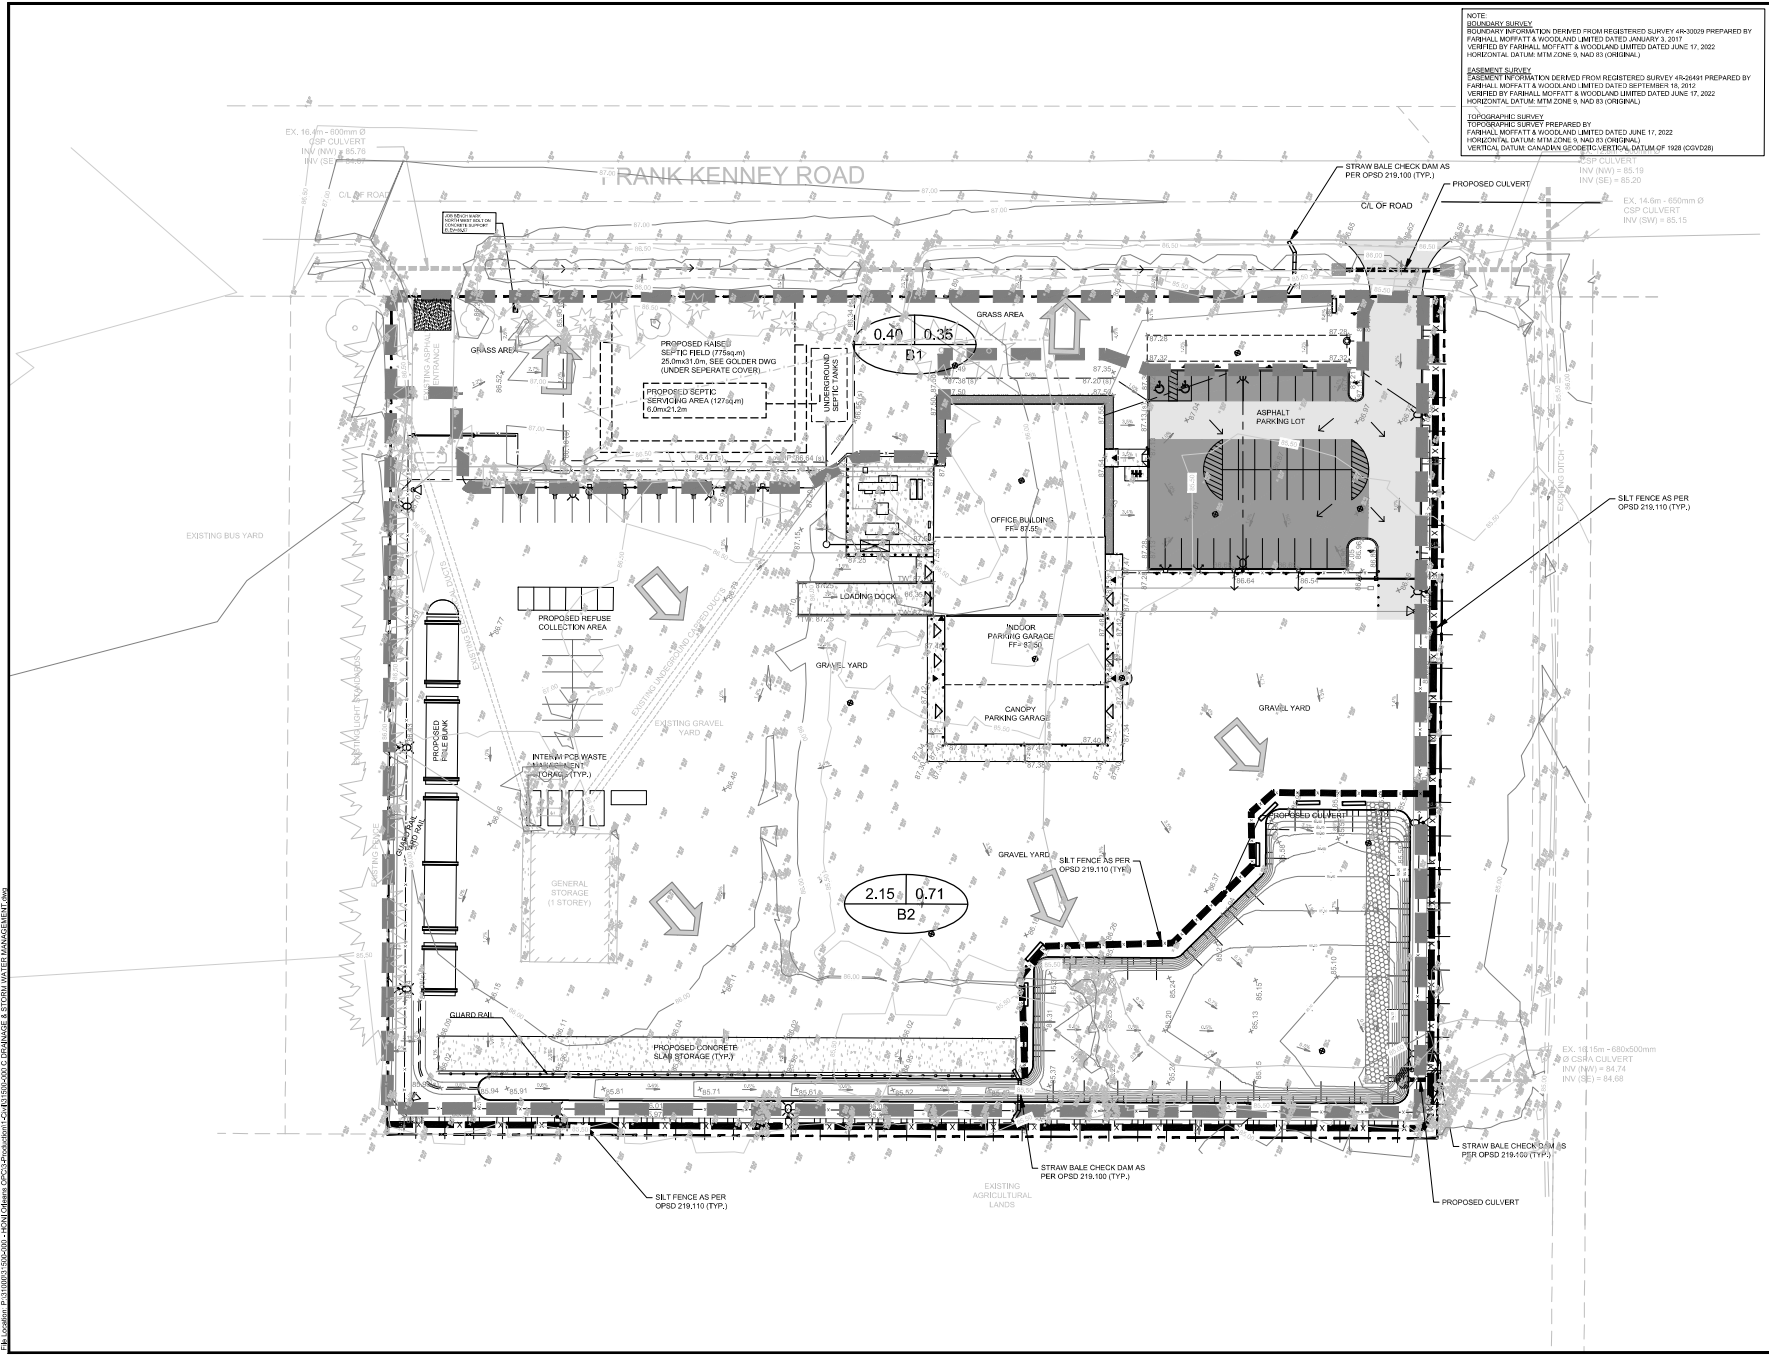


NOTE
 BOUNDARY SURVEY
 BOUNDARY INFORMATION DERIVED FROM REGISTERED SURVEY 4R-3029 PREPARED BY FARHALL, MOFFATT & WOODLAND LIMITED DATED JANUARY 3, 2011. VERIFIED BY FARHALL, MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. HORIZONTAL DATUM: MTR ZONE 9, NAD 83 (ORIGINAL).

EASEMENT SURVEY
 EASEMENT INFORMATION DERIVED FROM REGISTERED SURVEY 4R-2641 PREPARED BY FARHALL, MOFFATT & WOODLAND LIMITED DATED SEPTEMBER 18, 2012. VERIFIED BY FARHALL, MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. HORIZONTAL DATUM: MTR ZONE 9, NAD 83 (ORIGINAL).

TOPOGRAPHIC SURVEY
 TOPOGRAPHIC SURVEY PREPARED BY FARHALL, MOFFATT & WOODLAND LIMITED DATED JUNE 17, 2022. HORIZONTAL DATUM: MTR ZONE 9, NAD 83 (ORIGINAL). VERTICAL DATUM: CANADIAN GEODESIC VERTICAL DATUM OF 1929 (CGVD29).

SPOT ELEVATIONS
 INV (NOV) = 85.19
 INV (SE) = 85.20

EX. 18 150 - 600mm Ø CSP CULVERT
 INV (NOV) = 85.19
 INV (SE) = 85.15



PRELIMINARY DESIGN
 THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DDMMYY
01	ISSUED FOR CITY SITE PLAN APPROVAL	120922
02	ISSUED FOR CITY SITE PLAN APPROVAL	300422
03	ISSUED FOR CLIENT REVIEW	040422

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.
 VERIFY SHEET ARE AND SCALES, BAR TO THE RIGHT IS 20mm/1" THIS IS A FULL SITE DRAWING.



CLIENT: hydro one BGIS

CONSULTANT: J.L. Richards ENGINEERS-ARCHITECTS-PLANNERS

PROJECT PROFESSIONAL ENGINEER PROJECT NORTH

M. DUTHILLEUL
 102205184
 PROVINCE OF ONTARIO

PROJECT ADDRESS: 3440 FRANK KENNY ROAD

POST DEVELOPMENT DRAINAGE AND EROSION AND SEDIMENT CONTROL PLAN

DESIGN: M.D.	DRAWING: F
DRAWN: C.C.	CHECKED: D.U.
CHECKED: D.U.	JUR# 31500-000

C-005









D07-12-22-0057

GENERAL CONSTRUCTION NOTES

- CONTRACTOR TO CARRY OUT WORKS PER THE CURRENT CITY OF OTTAWA STANDARD DRAWINGS AND SPECIFICATIONS AND PER THE ONTARIO PROVINCIAL STANDARD DRAWINGS AND SPECIFICATIONS.
- CONTRACTOR TO READ THE SITE'S SERVING DESIGN PLAN IN CONJUNCTION WITH THE LATEST SITE SERVING REPORT PREPARED BY J.L. RICHARDS & ASSOCIATES LIMITED, FOR THE PROPOSED CONSTRUCTION WORKS.
- ALL SOIL DISPOSAL FROM SITE TO BE COORDINATED WITH THE HYDRO ONE ENVIRONMENTAL TEAM.
- THE NOMINAL DIAMETER OF PIPES ARE REFERRED TO IN PLAN VIEW.
- CONTRACTOR RESPONSIBLE FOR OBTAINING ALL SITE UTILITY LOCATES BEFORE CONSTRUCTION.
- CONTRACTOR RESPONSIBLE FOR ALL EXCAVATION, BACKFILL AND REINSTATEMENT OF ALL AREAS DISTURBED DURING CONSTRUCTION AND ANY ASSOCIATED WORKS TO THE SATISFACTION OF THE ENGINEER AND CITY OF OTTAWA.
- SEPTIC SYSTEM (TREATMENT TANKS & LEACHING BED) PER WSP GOLDERS' - NEW SEPTIC DESIGN - TECHNICAL MEMORANDUM (SEPT. 2022).
- ALL CONNECTIONS TO EXISTING WELL TO BE IN ACCORDANCE WITH THE CITY OF OTTAWA DESIGN GUIDELINES. CONTRACTOR TO PROVIDE EXCAVATION BACKFILLING, COMPACTION AND REINSTATEMENTS, IN ACCORDANCE WITH THE LATEST GEOTECHNICAL INVESTIGATION PREPARED BY GOLDER ASSOCIATES FOR THE SITE.
- CONTRACTOR RESPONSIBLE FOR DETERMINING, VIA EXCAVATION, THE EXACT LOCATION AND ELEVATION OF THE EXISTING UNDERGROUND UTILITIES AND STRUCTURES AS REQUIRED FOR ALL PROPOSED CONNECTIONS, RELOCATIONS, AND BLANKINGS.
- FOR ALL PROPOSED CONNECTION POINTS (IF ANY), THE CONTRACTOR IS RESPONSIBLE FOR THE REINSTATEMENT OF ALL SURFACES TO EXISTING CONDITIONS OR BETTER. PAVEMENT STRUCTURE RESTORATION (FRANK KENNEY ROAD) SHALL BE PER CITY OF OTTAWA STANDARDS. THE THICKNESS OF GRANULAR AND ASPHALT LAYERS SHALL MATCH EXISTING.
- CONTRACTOR RESPONSIBLE FOR VERIFYING THAT THE SITE BENCHMARK(S) HAVE NOT BEEN ALTERED OR DISTURBED AND THAT THEIR RELATIVE ELEVATION(S) AND DESCRIPTION(S) AGREE WITH THE INFORMATION DETICPED ON THE PLAN.
- CONTRACTOR TO MATCH EXISTING ELEVATIONS AT PROPERTY LIMITS AND ENSURE POSITIVE DRAINAGE TOWARDS A SUITABLE OUTLET, WHETHER INDICATED OR NOT ON THE PLANS.
- CONTRACTOR TO PROVIDE ALL PAVEMENT MARKINGS AS SHOWN, INCLUDING HANDICAPPED PARKING SYMBOLS.
- ALL GROUNDWATER PUMPED FROM THE SITE TO BE METERED AND A PERMIT TO TAKE WATER OBTAINED AS APPLICABLE.
- PAVEMENT DESIGN TO BE PER THE SITE'S GEOTECHNICAL INVESTIGATION REPORT (SEPT. 2022), PREPARED BY GOLDER ASSOCIATES LTD. (21493987).
- LIGHT DUTY PAVEMENT STRUCTURE (CAR PARKING AREAS):
50 MM - H.L. 5 SURFACE COURSE OR 12.5 SUPERPAVE
150 MM - BASE - OPSS GRANULAR A
450 MM - SUBBASE - OPSS GRANULAR B TYPE II
- HEAVY DUTY PAVEMENT STRUCTURE (ACCESS LANES AND PAVED TRUCK TRAFFIC AREAS):
40 MM - H.L. 3 SURFACE COURSE OR 12.5 SUPERPAVE
50 MM - H.L. 8 BINDER COURSE OR 19.0 SUPERPAVE
150 MM BASE - OPSS GRANULAR A
450 MM SUBBASE - OPSS GRANULAR B TYPE II
- GRANULAR TRAFFIC AREAS (UNPAVED ACCESS LANES AND TRUCK TRAFFIC AREAS):
250 MM BASE - OPSS GRANULAR A
450 MM SUBBASE - OPSS GRANULAR B TYPE II
- CONTRACTOR TO ENSURE ALL PROPOSED PAVEMENT AREAS ARE PREPARED PER THE SITE'S GEOTECHNICAL INVESTIGATION RECOMMENDATIONS AND ALL TOPSOIL AND OTHER UNSUITABLE FILL (FILLS CONTAINING ORGANIC MATTER) ARE EXCAVATED FROM THESE SURFACES.
- CONTRACTOR TO ENSURE PROPOSED PAVEMENT AREAS SUBGRADE HAS BEEN ACCEPTABLY PREPARED, WHERE THE TRENCH BACKFILL AND GRADE RAISE FILL HAVE BEEN ADEQUATELY COMPACTED TO THE REQUIRED DENSITY AND THE SUBGRADE SURFACE NOT DISTURBED BY CONSTRUCTION OPERATIONS OR PRECIPITATION. DEPENDING ON THE ACTUAL CONDITIONS OF THE PAVEMENT SUBGRADE AT THE TIME OF CONSTRUCTION, IT MAY BE NECESSARY TO INCREASE THE THICKNESS OF THE SUBBASE AND/OR TO PLACE A WOVEN GEOTEXTILE BENEATH THE GRANULAR MATERIALS.
- CONTRACTOR TO ENSURE GRANULAR BASE AND SUBBASE MATERIALS ARE UNIFORMLY COMPACTED TO AT LEAST 100% OF THE MATERIAL'S STANDARD PROCTOR MAXIMUM DRY DENSITY USING SUITABLE VIBRATORY COMPACTION EQUIPMENT. THE ASPHALTIC CONCRETE IS TO BE COMPACTED PER TABLE 9 OF OPSS 310.
- REQUIREMENT FOR ADDITIONAL GRANULAR 'B' AND/OR GEOTEXTILE IS TO BE CONFIRMED ON SITE BY GEOTECHNICAL ENGINEER.
- CURBS TO BE BARRIER TYPE PER CITY OF OTTAWA STANDARD SC1.1.
- THE EXISTING ON-SITE MODULAR OFFICE AND ASSOCIATED SERVICES (WELL, SEPTIC TANK, ETC.) TO REMAIN IN SERVICE UNTIL THE PROPOSED OFFICE IS COMPLETED. ONCE THE NEW OFFICE IS OPERATIONAL, THE CONTRACTOR SHALL COORDINATE THE MODULAR REMOVAL AND COMPLETE THE REMAINING PROPOSED WORKS (FENCE, LANDSCAPE, ETC.).
- CONTRACTOR RESPONSIBLE TO DEVELOP DEMOLITION AND TEMPORARY SERVING STAGING PLAN FOR APPROVAL BY HONI PRIOR TO CONSTRUCTION.
- LINE PAINTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSS 1710.
- ASPHALT LINE PAINTING FOR THE PARKING STALLS AS PER OPSS 1716.
- FENCE TO BE IN ACCORDANCE WITH HYDRO ONE STANDARD SD-14100-001-R3 DATED: OCTOBER 2017.
- WHERE POSSIBLE CONTRACTOR TO RE USE EXISTING ON SITE JERSEY BARRIER
- PROPOSE CONCRETE BARRIERS PER OPSS 911.14
- CONCRETE WALKWAY TO BE INSTALLED IN ACCORDANCE WITH OPSS 351.
- CONCRETE CURB SHALL BE INSTALLED IN ACCORDANCE WITH OPSS 353.
- SUBDRAINS SHALL BE COMPLETE WITH FILTER SOCK AND INSTALLED AS PER OPSS 405.
- CULVERTS SHALL BE INSTALLED IN ACCORDANCE WITH OPSS 421.

EROSION AND SEDIMENT CONTROL NOTES

- ALL SEDIMENTATION CONTROL MEASURES ARE TO BE IMPLEMENTED PER OPSS AND OPSS. SILT FENCE BARRIER PER OPSS 219.110.
- CONTRACTOR TO ENSURE ALL SEDIMENT AND EROSION CONTROL MEASURES ARE IMPLEMENTED BEFORE WORK AND MAINTAINED DURING THE WORK PHASE TO PREVENT ENTRY OF SEDIMENT INTO THE RECEIVING WATERCOURSES.
- CONTRACTOR TO ENSURE ALL SEDIMENT AND EROSION CONTROL MEASURES TO BE INSPECTED DAILY AND THEY ARE FUNCTIONING PROPERLY AND ARE BEING MAINTAINED AND/OR UPGRADED AS REQUIRED. IF THE SEDIMENT AND EROSION CONTROL MEASURES ARE NOT FUNCTIONING PROPERLY, NO FURTHER WORK SHALL OCCUR UNTIL THE PROBLEM HAS BEEN ADDRESSED AND RECTIFIED.
- HYDROSEEDING OF ALL DITCHES IS TO BE PROVIDED IMMEDIATELY FOLLOWING FINAL SHAPING/GRADING.
- CONTRACTOR TO SUPPLY AND INSTALL STRAW BALE BARRIER (PER OPSS 219.100) UPSTREAM OF ALL CULVERT INSTALLATIONS AND SHALL ONLY BE REMOVED ONCE UPSTREAM VEGETATION HAS BEEN ESTABLISHED.
- CONTRACTOR TO SUPPLY AND INSTALL SILT FENCE BARRIER (PER OPSS 219.110) TO ENCLOSE ALL BORROW AND STOCKPILE AREAS RESULTING FROM TOPSOIL STRIPPING ACTIVITIES OR ANY EXCAVATING ACTIVITIES.
- CONTRACTOR TO ENSURE ALL STOCKPILED MATERIALS ARE STORED ON A FLAT AREA ARE STABILIZED AND AWAY FROM ANY FLOW PATHS.
- IF A STOCKPILE IS PLACED IN AREAS WITH POTENTIAL WASH OFF TO A CONVEYANCE SYSTEM, SILT FENCE BARRIERS (PER OPSS 219.110) WILL NEED TO BE INSTALLED TO ENCLOSE THE MATERIALS AND PREVENT ANY WASH OFF.
- CONTRACTOR TO ENSURE ALL PUMPED STORMWATER/GROUNDWATER IS FILTERED THROUGH SEDIMENT DOWELING BAGS BEFORE ITS RELEASE TO THE RECEIVING STREAM.
- CONTRACTOR TO ENSURE THAT ALL MATERIALS AND EQUIPMENT USED FOR THE PURPOSE OF SITE PREPARATION AND PROJECT COMPLETION ARE OPERATED AND STORED IN A MANNER THAT PREVENTS ANY DELETERIOUS SUBSTANCES (I.E., PETROLEUM PRODUCTS, SILT, ETC) FROM ENTERING THE RECEIVING WATERCOURSE.
- CONTRACTOR TO ENSURE ANY VEHICLE AND EQUIPMENT RE-FUELLING AND MAINTENANCE TO BE CONDUCTED AWAY FROM DRAINAGE CHANNELS AND ANY PART OF EQUIPMENT ENTERING A CHANNEL TO BE FREE OF FLUID LEAKS AND EXTERNALLY CLEANED/DEGREASED TO PREVENT ANY DELETERIOUS SUBSTANCES FROM ENTERING THE RECEIVING WATERCOURSE.
- ALL SPILL PREVENTION AND CONTINGENCY PLANS SHALL BE MAINTAINED AND MONITORED/RECORDED ON A REGULAR BASIS AS REQUIRED TO ENSURE CONTAMINANTS DO NOT ENTER THE NATURAL ENVIRONMENT.
- CONTRACTOR TO ANTICIPATE THE USE OF CONSTRUCTION MAT (GEOTERRA OT EQUIVALENT) WITHIN THE PHASE 2 BUILDING SITE AREA.

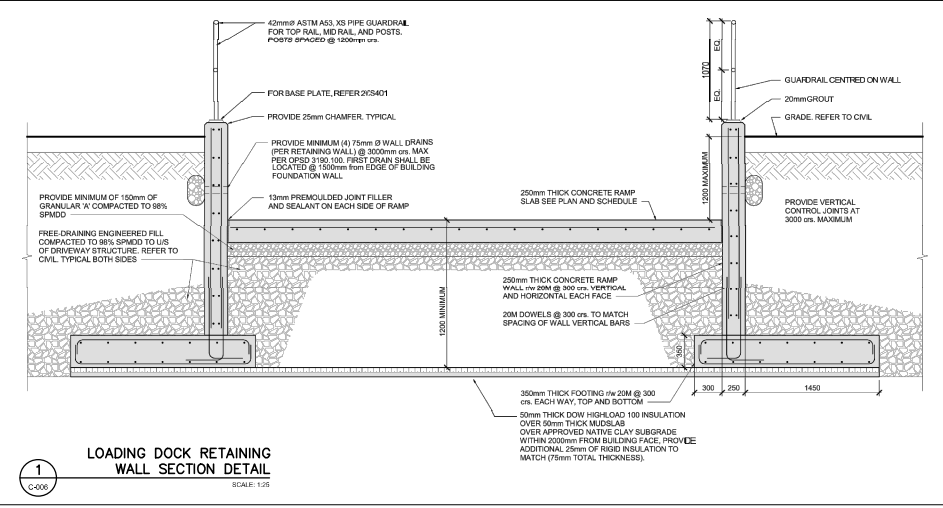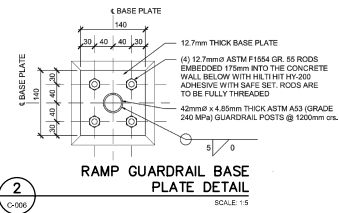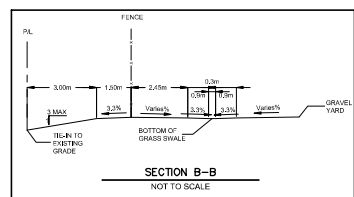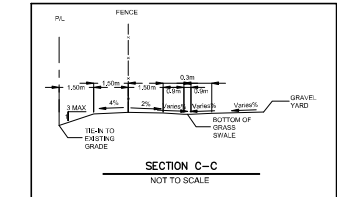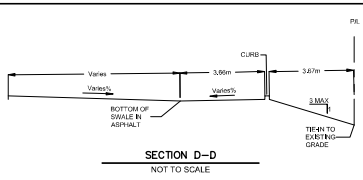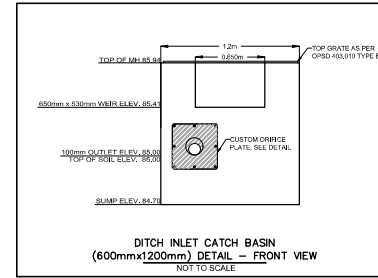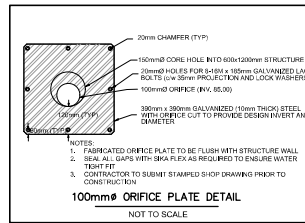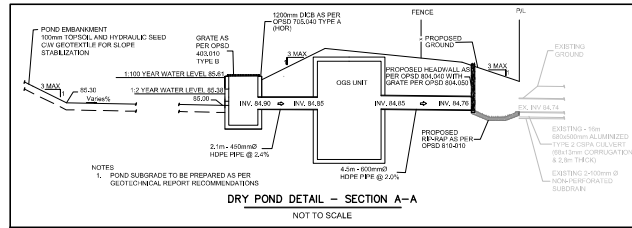

RETAINING WALL NOTES:

- DESIGN BASED ON CSA S8-19 AND OBC 2012 (AMENDED 2020). LOADING AS FOLLOWS:
 - BACKFILL PRESSURES IN ACCORDANCE WITH GOLDER/WSP GEOTECHNICAL REPORT.
 - LIVE LOAD SURCHARGE PRESSURE: 12 kPa
 - COMPACTION PRESSURES AS PER CSA S8-19.
 - DRAINED BACKFILL CONDITIONS
 - DESIGN FOR SEISMIC PRESSURES AS PER CSA S8-19 AND GOLDER/WSP GEOTECHNICAL REPORT.
 - GUARDRAIL HAS BEEN DESIGNED IN ACCORDANCE WITH OBC 2012, CLAUSE 4.1.5.14 FOR LOCATIONS WITH LIMITED OCCUPANCY WHERE GATHERING OF MANY PEOPLE IS IMPOSSIBLE.
- FOUNDATIONS SHALL BE FOUND ON NATIVE WEATHERED CLAY CRUST WITH A MINIMUM BEARING CAPACITY OF 165kPa (11.5) AND 125 kPa (9.0).
- CAST-IN-PLACE CONCRETE: CLASS 'C'; MINIMUM SPECIFIED COMPRESSIVE STRENGTH = 35 MPa @ 56 DAYS.
- ALL REINFORCING TO CSA G30.18, GRADE 400W.
- ALL LAP SPICES SHALL BE CLASS 'B' LAP SPICES IN ACCORDANCE WITH CSA A23.3-14.
- MINIMUM COVER IS 75mm CAST DIRECTLY AGAINST SOIL AND 60mm EXPOSED TO SALTS AND CHLORIDES.
- STEEL DESIGN IN ACCORDANCE WITH CSA S16-14.

PRELIMINARY DESIGN
 THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DATE
02	RE4850 FOR CITY SITE PLAN APPROVAL	12/09/22
01	ISSUED FOR CITY SITE PLAN APPROVAL	09/04/22
00	ISSUED FOR CLIENT REVIEW	08/04/22

hydro one BGIS

J.R. Richards
 ENGINEERS-ARCHITECTS-PLANNERS

PROFESSIONAL ENGINEER
 M. DUTELLE
 100151429
 PROVINCE OF ONTARIO

HYDRO ONE OPERATIONS CENTRE, ORLEANS

3440 FRANK KENNY ROAD

DETAILS 1
 DRAWN: C.C.
 CHECKED: D.L.
 DATE: 31/05/2020
 DRAWING #: C-006

D07-12-22-0057

CONCRETE BARRIER CURB

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2012 Rev 2
 OPSD 600.110

NOTES:
 1 When sidewalk is continuously adjacent, the dropped curb at entrances shall be reduced to 75mm.
 2 For slipforming procedure a 5% batter is acceptable.
 A Treatment at entrances shall be according to OPSD 351.010.
 B Outlet treatment shall be according to the OPSD 810 Series.
 C The transition from one curb type to another shall be a minimum length of 3.0m, except in conjunction with guide rail where it shall be according to the OPSD 600 Series.
 D All dimensions are in millimetres unless otherwise shown.

ELEVATION MOUNTABLE CURB WITH GUTTER

ELEVATION BARRIER AND SEMI-MOUNTABLE CURB WITH GUTTER

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2012 Rev 2
 OPSD 608.010

METHOD OF TERMINATION FOR CONCRETE CURB WITH GUTTER

NOTES:
 1 Slope shall match existing shoulder.
 A This drawing shall be read in conjunction with OPSD 600 series curb with gutter drawings.
 B All dimensions are in millimetres unless otherwise shown.

TYPE A-1 ASYMMETRIC SECTION

TYPE A

TYPE A-2

TYPE A-3

ONTARIO PROVINCIAL STANDARD DRAWING Apr 2021 Rev 2
 OPSD 911.130

GUIDE RAIL SYSTEM, CONCRETE BARRIER CAST-IN-PLACE, TYPE A INSTALLATION

NOTES:
 1 For slipforming procedure, a 1H:20V batter is acceptable.
 2 Hot mix not required when concrete fill is placed to the top of the concrete barrier.
 3 Embedment shall be 75mm into pavement at least 5m on both sides of barrier.
 4 Height may vary from 825 to 1425mm in an asymmetric cross section.
 5 Width may vary from 57.5 to 117.5mm in an asymmetric cross section.
 A All dimensions are in millimetres unless otherwise shown.

PRECAST CONCRETE MAINTENANCE HOLE 1200mm DIAMETER

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 5
 OPSD 701.010

SUMP DETAIL

ALTERNATIVES

A PRECAST SLAB BASE

B CAST-IN-PLACE BASE

C PRECAST FLAT CAP

NOTES:
 1 The sump is measured from the lowest invert.
 A Granular bedding shall be placed to a minimum thickness of 300mm all around the maintenance hole.
 B Precast concrete components shall be according to OPSD 701.030, 701.031, or 701.032.
 C Structure exceeding 5.0m in depth shall include safety platform according to OPSD 404.020.
 D Pipe support according to OPSD 708.020.
 E For benching and pipe opening details, see OPSD 704.010.
 F For adjustment unit and frame installation, see OPSD 704.010.
 G All dimensions are nominal.
 H All dimensions are in millimetres unless otherwise shown.

PRELIMINARY DESIGN

THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DDMMYY
01	ISSUED FOR CITY SITE PLAN APPROVAL	120922
02	ISSUED FOR CITY SITE PLAN APPROVAL	090422
03	ISSUED FOR CLIENT REVIEW	090422

LIGHT-DUTY SILT FENCE BARRIER

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
 OPSD 219.110

NOTE:
 A All dimensions are in millimetres unless otherwise shown.

LIGHT-DUTY STRAW BALE BARRIER

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2021 Rev 3
 OPSD 219.100

NOTES:
 1 Straw bales shall be butted tightly against adjoining bales to prevent sediment flow through barrier.
 2 Fill and compact gaps with loose straw.
 A All dimensions are in millimetres unless otherwise shown.

Facilities & Real Estate - Job Aid Pylon Sign Standard

255 Matheson Boulevard West

Advanced Metering Infrastructure Operations

SIGN DETAIL

SCALE: NTS

NOTES:
 1. SEE PROJECT SHEET OPERATIONS UNDER SIGNATURE COVER FOR PART 4.06.14.8
 2. SIGNIFICATION ON THE SIGNFACE TO BE EXAMINE ONLY - PROJECT WORKS TO BE PROVIDED

hydro one BGIS

J.R. Richards ENGINEERS-ARCHITECTS-PLANNERS

HYDRO ONE OPERATIONS CENTRE, ORLEANS



3440 FRANK KENNY ROAD

DETAILS 2

PERSON: M.D.
 DRAWN: G.C.
 CHECKED: D.U.
 DATE: 31600-000

DRAWING #: C-007

D07-12-22-0057

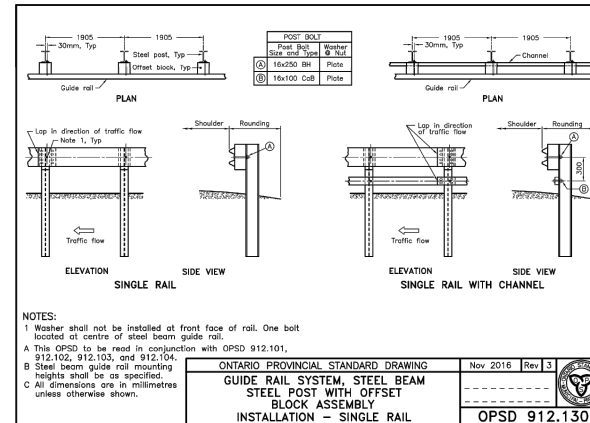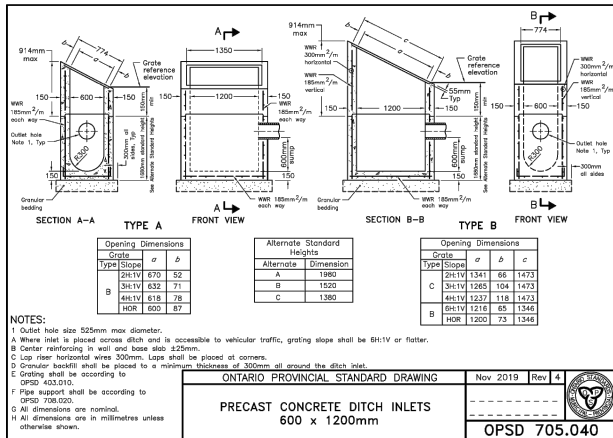

PRELIMINARY DESIGN
 THESE DOCUMENTS ARE NOT COMPLETE IN ALL DETAILS AND MAY BE SUBJECT TO CHANGE AS DESIGN DEVELOPMENT AND CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DDMMYY
02	RE458UD FOR CITY SITE PLAN APPROVAL	120922
01	ISSUED FOR CITY SITE PLAN APPROVAL	090422
00	ISSUED FOR CLIENT REVIEW	080422

SCALE: _____

CLIENT:
hydro one BGIS


CONSULTANT:
J.R. J.L. Richards
 ENGINEERS-ARCHITECTS-PLANNERS


PROFESSIONAL STAMP
 M. DUTHILLEUL
 102205184
 PROVINCE OF ONTARIO

HYDRO ONE OPERATIONS CENTRE, ORLEANS
 3440 FRANK KENNY ROAD

DETAILS 3
 DESIGN: M.D.
 DRAWN: G.C.
 CHECKED: D.U.
 DATE: 31060-000

D07-12-22-0057

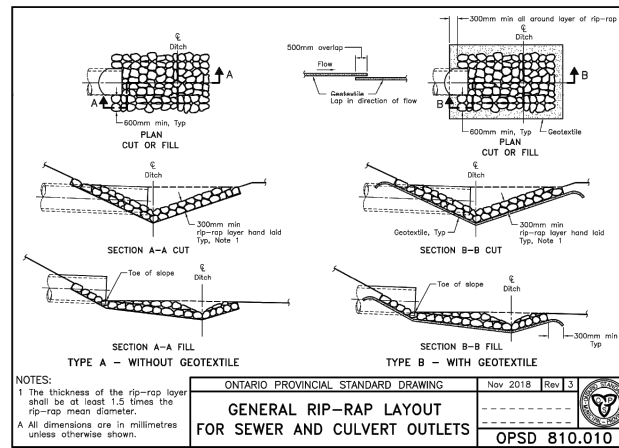

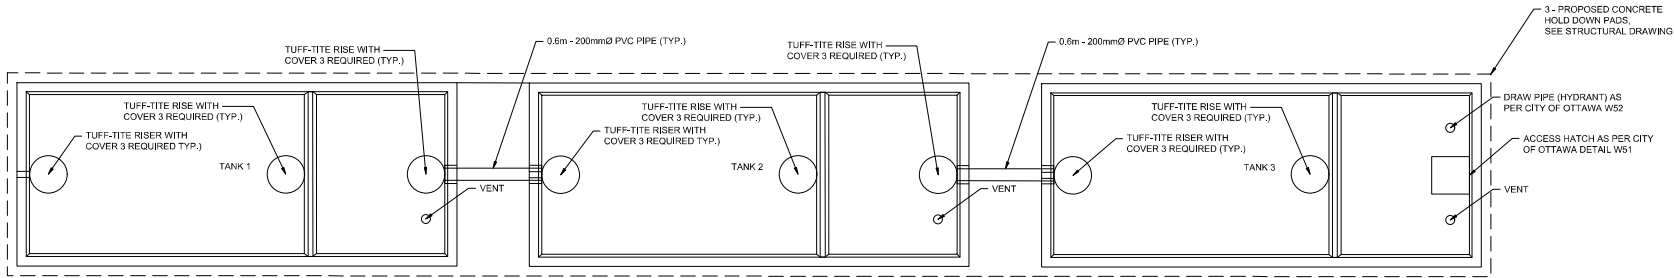

END TO END CONNECTION- 3 TANKS
NOT TO SCALE

PRELIMINARY DESIGN
THESE DOCUMENTS ARE NOT COMPLETE
IN ALL DETAILS AND MAY BE SUBJECT TO
CHANGE AS DESIGN DEVELOPMENT AND
CODE REVIEW IS ADVANCED.

No.	ISSUE / REVISION	DDMMYY
01	RE458UD FOR CITY SITE PLAN APPROVAL	120922
02	ISSUED FOR CITY SITE PLAN APPROVAL	060422
03	ISSUED FOR CLIENT REVIEW	030422

This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.
VERIFY SHEET ARE AND SCALES, BAR TO THE FRONT & TOP OF THIS IS A P.L.L. SITE DRAWING.

SCALE: _____

CLIENT:
hydro one BGIS
www.hydroone.ca

CONSULTANT:
JR J.L. Richards
ENGINEERS-ARCHITECTS-PLANNERS



PROFESSIONAL ENGINEER
PROFESSIONAL STAMP
LICENSED PROFESSIONAL ENGINEER
M. DUTHILLEUL
10228184
PROVINCE OF ONTARIO

PROJECT: 09-16
HYDRO ONE OPERATIONS CENTRE,
ORLEANS

3440 FRANK KENNY ROAD

DRAWING:
TANK DETAILS

DESIGN: M.D.
DRAWN: C.C.
CHECKED: D.J.
DATE: 310501-000
DRAWING #: C-009

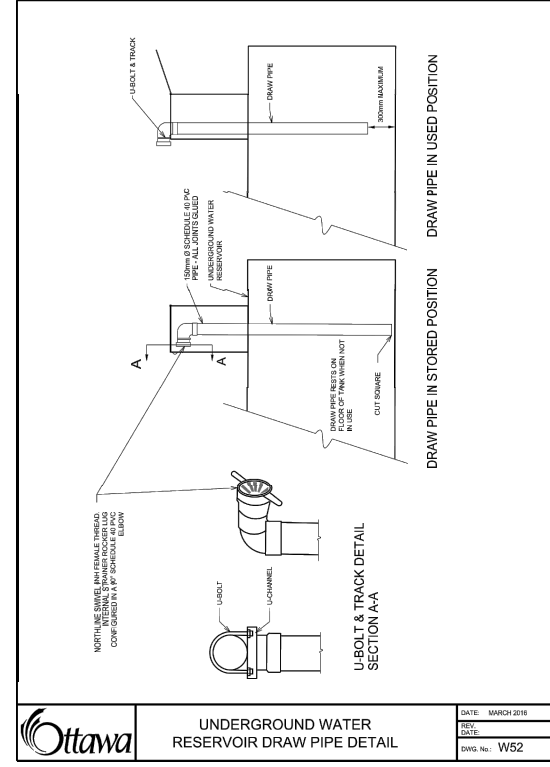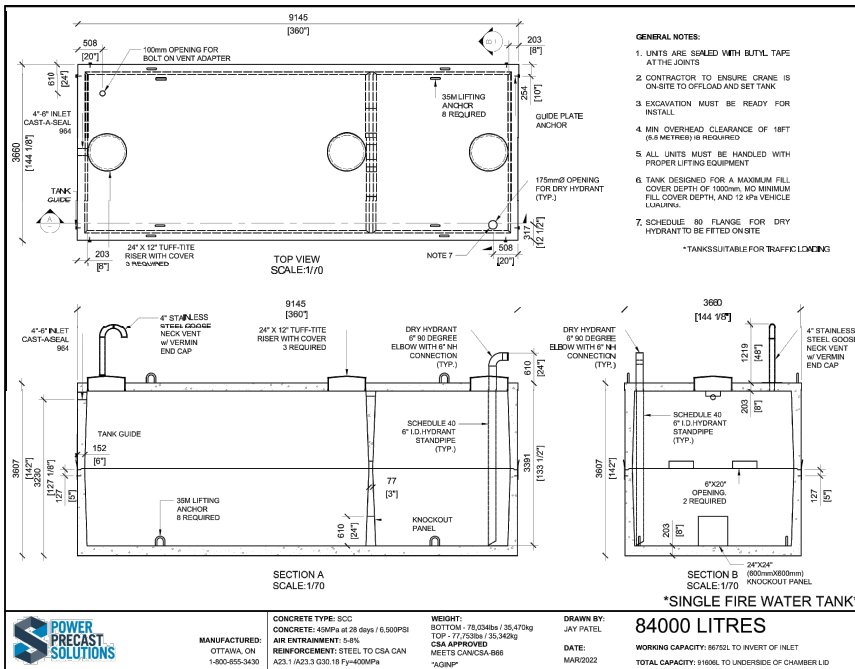

Ottawa UNDERGROUND WATER RESERVOIR DRAW PIPE DETAIL
DATE: MARCH 2019
REV: _____
DATE: _____
DWG No.: W52

This document is UNCLASSIFIED//FOR OFFICIAL USE ONLY (U//FOUO). It is the property of the Government of Canada and is loaned to you. It is not to be distributed outside the organization to which loaned. It is to be returned to the originator when no longer required. If you are not the intended recipient, you should not disseminate, distribute or take any action in reliance on the information in this document. If you have received this document in error, please notify the originator immediately by email at [redacted].

FILED DATE: 19/05/2022 10:00 AM

Appendix B

Domestic Water Demand

MEMORANDUM



**J.L. Richards
& Associates Limited**
864 Lady Ellen Place
Ottawa, ON Canada
K1Z 5M2
Tel: 613 728 3571
Fax: 613 728 6012

Page 1 of 2

To: City of Ottawa

Date: September 8, 2022

JLR No.: 31500-000

CC:

From: Kris Mierzejewski, P.Eng.

Re: HONI Orleans OPERATIONS CENTRE (OC) -
ONSITE AVAILABLE WATER SUPPLY &
ESTIMATED DESIGN FLOW_REV 04

This technical memorandum has been prepared by J.L.Richards and Associated Limited (JLR) on behalf of Brookfield Global Integrated Solutions Canada LP (BGIS) to support the site Plan Control application of Hydron One Network Inc. (JONI) new Operations Centre (OC), at 3440 Frank Kenny Road, Ottawa, Ontario.

We have calculated the expected total domestic water design flow per OBC.
The resultant required design flow is 44.0 gpm (2.78 l/s).

Type and quantities of fixtures:

Water closets (flush tanks):	4
Urinals (w/self closing, metering valve):	2
Kitchen sinks:	2
Lavatories:	6
Showers:	3
Clothes washers:	1
Hose bibs:	6
Drinking fountains:	1
Service sinks:	1
Eyewash stations:	1

The total maximum coincidental water flowrate has been estimated at 17.7 gpm (1.1 l/s), based on simultaneous use of: 3 showers, 1 service sink, 1 hose bib and 1 eyewash station.

It is expected this maximum flowrate will occur not more than once a day, for maximum of 20 minutes. (2 successive shower uses of each shower stall)

Existing (and proposed) well pump is rated at 15 gpm, as per well records (well tag:A116305)

Net flow required from tanks, at peak flow is therefore $17.7 - 15 = 2.7$ gpm

Storage required = $2.7 * 20 * 1.2 = 64.8$ gallons (245 litres)

Assuming a safety factor of 20%

Type of tank proposed: Well-x-trol from Amtrol, full acceptance bladder-type, ASME-rated tank
Those tanks can provide 30% of total water storage at 30/50psi drawdown.

Tank selected: WX-453C, with total tank volume of 264 gallons.

Drawdown at 30/50psi = $0.3 * 264 = 79.2$ gal (299 litres)

This tank provides 47% of storage safety factor, or 9 additional minutes of discharge at predicted maximum coincidental flowrate.

J.L. RICHARDS & ASSOCIATES LIMITED

Prepared by:

Kris Mierzejewski, P.Eng.
Mechanical Engineer

KM:km

Appendix C

WSP GOLDER Technical
Memorandum
(September 2022) –
Resampling Results, Well
PW11-1, and Updated
Terrain Analysis

TECHNICAL MEMORANDUM**DATE** September 8, 2022**Project No.** 21493887**TO** City of Ottawa
Public Works Department**FROM** Caitlin Cooke**EMAIL** ccooke@golder.com**RESAMPLING RESULTS, WELL PW11-1, AND UPDATED TERRAIN ANALYSIS
HYDRO ONE ORLEANS OC, PHASE 2
3440 FRANK KENNY ROAD, OTTAWA, ONTARIO**

Golder Associates Ltd. (Golder) was retained by J.L. Richards & Associates Ltd. (JLR) to collect a water sample from supply well PW11-1 at the proposed Hydro One Operations Centre (OC), Phase 2, located at 3440 Frank Kenny Road in Ottawa, Ontario. The purpose of the work was to evaluate the water quality at PW11-1, which is currently being used to supply the temporary building on the site. Well PW11-1 (well tag A116305) was constructed in 2011 by a licensed well contractor. A well inspection by a licensed geoscientist or engineer was not conducted at that time. The water quality at PW11-1 was previously reported in the February 2012 Golder report entitled “*Hydrogeology, Terrain Analysis and Impact Assessment Study, 3406-3450 Frank Kenny Road.*”

This memorandum is an addendum to the February 2012 Golder report (included as Attachment 1) and this current memorandum considers the City of Ottawa’s *Hydrogeological and Terrain Analysis Guidelines*, dated March 2021 and the Ontario Building Code.

Method

On March 9, 2022, a sample was collected from an untreated port (by bypassing the water softener and other treatment equipment) at the temporary building. Water was purged from the nearest tap (the kitchen sink) for approximately 10 minutes prior to the collection of the sample. The water sample was collected in laboratory supplied bottles and analyzed for the “subdivision suite” of parameters and filtered at the laboratory to be analysed for trace metals. Once collected, the sample was packed in a cooler with ice packs and was delivered to Eurofins Environment Testing (Eurofins) in Ottawa, Ontario for analysis.

On August 30, 2022 a second sample was collected from the same tap using the same sampling and purging methods. The water sample was collected in laboratory supplied bottles and analyzed for volatile organic compounds (VOC). Once collected, the sample was packed in a cooler with ice packs and was delivered to Eurofins in Ottawa, Ontario for analysis. The temperature, pH and conductivity of the water sample were measured in the field, and other sample observations, including colour, were noted.

Results

On the attached Table 1, the analytical results for the subdivision suite of parameters are compared to the Ontario Drinking-Water Quality Standards (ODWQS, Ontario Regulation 169/03) and to the standards (MAC), objectives

(AO) and guidelines (OG) of the “Technical Support Document for Ontario Drinking Water Standards, Objectives and Guidelines” (Ontario Ministry of the Environment, Conservation and Parks (MECP); Revised June, 2006). Table 1 also contains historic data collected during 2011 from PW11-1. The laboratory certificates of analysis (including the trace metals and VOC analyses) are also included (Attachment 2).

Analytical results of the groundwater sample collected from PW11-1 on March 9, 2022 indicate an AO exceedance for colour, which was measured to be 96 TCU, above the AO of 5 TCU (MECP, 2006). The sample was described as being clear and colourless when collected. The sample collected on August 30, 2022 was also described as clear and colourless. In accordance with Procedure D-5-5, the treatability limit for colour is 7 TCU; however, higher, iron-related colour may be removed by manganese greensand treatment.

As commonly found in this area of Ontario, the concentration of hardness was 305 mg/L, above the OG of 100 mg/L (MECP, 2006). Hardness in this concentration can be treated with conventional water softening equipment.

The laboratory-measured concentration of hydrogen sulphide was 0.21 mg/L, above the AO of 0.05 mg/L (MECP, 2006). Hydrogen sulphide is typically removed from water by aeration or by chemical oxidation.

The turbidity concentration measured in the sample was 13.2 NTU, greater than the AO of 5 mg/L (applicable at the point of consumption). In accordance with Procedure D-5-5, the treatability limit for turbidity is 5 NTU for non-disinfected water supplies.

The sodium concentration was 46 mg/L, which is below the aesthetic objective for sodium in drinking water of 200 mg/L. However, in accordance with Procedure D-5-5, the local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

The iron concentration was 1.63 mg/L, above the AO of 0.30 mg/L. In accordance with Procedure D-5-5, the treatability limit for iron is 10 mg/L. Iron in this concentration can be treated with conventional water softening equipment or manganese greensand filters.

The manganese concentration was 0.06 mg/L, slightly above the AO of 0.05 mg/L. In accordance with Procedure D-5-5, the treatability limit for manganese is 1.0 mg/L. Manganese in this concentration can be treated with conventional water softening equipment or manganese greensand filters.

All of the other results of chemical analysis for PW11-1 were below the respective MACs and AOs (see Table 1). The concentrations of trace metals were below the applicable MAC, AO or OG (see lab report 1976973 in Attachment 2).

No VOCs were detected above their respective detection limits.

Discussion

The groundwater quality at well PW11-1 indicates that the water quality continues to meet applicable standards or objectives for the analyzed parameters, with the exception of colour, hydrogen sulphide, turbidity, iron, and manganese. Treatment may be necessary to reduce the levels of colour, hydrogen sulphide, turbidity, iron and manganese below the AOs. Common techniques for treating hydrogen sulphide, iron and manganese include water softeners, manganese greensand filters or other oxidizing media. Field assessment of colour has consistently shown that the water from this well is clear and colourless upon sample collection. The elevated

colour level measured in the laboratory is assumed to be attributed to the elevated iron concentration, and treatment for iron is likely to be effective at reducing the colour level potentially to below the AO.

Turbidity was previously elevated in the samples collected in 2011 from PW11-1. Based on these elevated levels, a strategy was developed to reduce the turbidity of the groundwater at this well to below 1 NTU in order to meet the health-related objective under Table 2 of Procedure D-5-5. On December 22, 2011, the well was surged by the well driller and pumped at a rate of approximately 53 L/min (14 US GPM) for 6.5 hours. Just before pump shut-off, the field turbidity was measured to be 0.72 NTU, below the health-related objective under Procedure D-5-5. While repeating this approach could potentially reduce the 2022 turbidity levels to below 1 NTU, treatment using a carbon filtration system or reverse osmosis may be better suited to this site based on the reported low water use from this well.

Golder's 2012 report concluded that well PW11-1 was capable of supplying at least 16,350 L/day (i.e., more than the current estimated daily water demand for Phase 2 of the site). This capacity remains sufficient to provide water supply to Phase 2 of the development.

Updated Terrain Analysis

The February 2012 Golder report included a terrain analysis based on a preliminary design concept. The design has since progressed and the total daily design sanitary sewage flow has been refined from the assumptions in the February 2012 report to be up to 10,000 L/day. The following discussion presents an updated terrain analysis that incorporates the new total daily design sanitary sewage flow.

A nitrate dilution model was utilized to assess the potential impact of septic effluent on the properties adjoining 3440 Frank Kenny Road. The net potential infiltration was based on the regional climatic data for the Ottawa area provided by Environment Canada. A maximum of 35 employees was assumed based on information provided by Hydro One. The background nitrate concentration was assumed to be less than 0.1 mg/L based on the groundwater sample taken from borehole BH11-5 (Golder, 2012), and the nitrate concentration of the effluent was assumed to be 40 mg/L as per the guidance in MECP Guideline D-5-4. A nitrate pre-treatment system is being designed for the operations facility, and the treatment unit will be constructed as a double-pass system. As per literature from Waterloo Biofilter, a double-pass system can achieve between 50 to 65% nitrogen reduction. A 50% reduction in nitrogen concentrations is therefore assumed for the purposes of this impact assessment. The site area used in the assessment was 2.6 hectares. The nitrate dilution calculation is provided in Attachment 3.

With regard to treatment and dispersal of effluent from the leaching beds, the maximum nitrate concentration at the property boundary was calculated to be 8.7 mg/L, less than the ODWQS of 10 mg/L. It should be noted that this calculation is conservative because many of the 35 employees will spend the majority of their workday away from the operations facility, and the number of full-day equivalent employees at the facility will be less than 10. It is concluded that the impact of the proposed operations facility on groundwater at the downgradient property boundary is considered acceptable in accordance with MECP Guideline D-5-4.

The source protection mapping in the Source Protection Information Atlas¹ illustrates that the site does not fall within a significant groundwater recharge area. The site does fall within an area marked as a vulnerable aquifer.

¹ <https://www.lioapplications.lrc.gov.on.ca/SourceWaterProtection/index.html?viewer=SourceWaterProtection.SWPViewer&locale=en-CA>

Based on the results of the impact assessment, no potential impacts to nearby off-site groundwater users were identified.

Percolation/infiltration testing is not deemed to be required at this site. Based on the existing identified soils, a percolation rate (T) of 50 min/cm was estimated for the purposes of the septic design. Because this is the maximum value used in determining the size of the proposed leaching bed, it is considered a conservative estimate.

Conclusions

Apart from the updated information presented here, the remaining conclusions and recommendations in the February 2012 Golder report (included in Attachment 1) remain valid.

Closure

Should you have any questions or require further information, please do not hesitate to contact the undersigned.

Golder Associates Ltd.

Caitlin Cooke, M.Sc., P.Geo.
Lead Hydrogeologist

08/09/2022

Jaime Oxtobee, M.Sc., P.Geo.
Senior Hydrogeologist/Associate

CAMC/JPAO/rk

Attachments: Table 1 – Summary of Water Quality Results
Attachment 1 – February 2012 Golder Report
Attachment 2 – Water Quality Summary and Lab Reports 1973087, 1976973 and 1985044
Attachment 3 – Updated Nitrate Dilution Calculation

[https://golderassociates.sharepoint.com/sites/152302/project files/6 deliverables/well sampling/21493887-tm-rev2-well resampling_2022-09-08.docx](https://golderassociates.sharepoint.com/sites/152302/project%20files/6%20deliverables/well%20sampling/21493887-tm-rev2-well%20resampling_2022-09-08.docx)

References

Golder Associates Ltd., 2012. Hydrogeology, Terrain Analysis and Impact Assessment Study, 3406-3450 Frank Kenney Road. Report No. 11-1122-0129(3000), February 2012.

Ontario Ministry of the Environment, Conservation and Parks, 2006. *Technical Support Document for Ontario Drinking Water Standards, Objectives and Guidelines*, PIBS 4449e01.

TABLE 1

Summary of Water Quality Results

Table 1
Summary of Water Quality Results

Parameter	Unit	ODWQS (169/03)- Health ⁽¹⁾	ODWQS- AO ⁽²⁾	ODWQS- OG ⁽³⁾	PW11-1	PW11-1	PW11-1	PW11-1
					07-Nov-2011	07-Nov-2011	22-Dec-2011	09-Mar-2022
					S-1	S-4	PW11-1	HYDRO
Bacterial								
Escherichia coli	cfu/100ml	0	--	--	0	0	--	0
Fecal Coliform	cfu/100ml	--	--	--	0	0	--	0
Fecal Streptococci, Kf Agar	cfu/100ml	--	--	--	0	0	--	--
Heterotrophic Plate Count	cfu/ml	--	--	-- ⁽⁴⁾	12	12	--	0
Total Coliform	cfu/100ml	0	--	--	5	2	--	0
General Chemistry								
Alkalinity (Total as CaCO ₃)	mg/l	--	--	500	284	295	--	290
Ammonia Nitrogen	mg/l	--	--	--	0.76	0.70	--	0.502
Chloride	mg/l	--	250	--	89	90	--	61
Chlorine, Total (Field)	mg/l	--	--	--	0.01	0	--	--
Chlorine, Free (Field)	mg/l	--	--	--	0	0	--	--
Color	color unit	--	5	--	<2	<2	--	96
Conductivity	uS/cm	--	--	--	848	853	--	747
Conductivity (Field)	uS/cm	--	--	--	823	813	--	2848
Dissolved Organic Carbon	mg/l	--	5	--	1.5	1.2	--	1.6
Fluoride	mg/l	1.5	--	--	0.29	0.27	--	0.27
Hardness, Calcium Carbonate	mg/l	--	--	100	297	279	--	305
Hydrogen Sulfide	mg/l	--	0.05	--	2.88	<0.10	--	0.21
Hydrogen Sulfide (Field)	mg/l	--	0.05	--	2	2	--	--
Ion Balance	no units	--	--	--	1.04	0.94	--	1.00
Nitrate as N	mg/l	10.0	--	--	0.14	<0.10	--	<0.10
Nitrite as N	mg/l	1.0	--	--	<0.10	<0.10	--	<0.10
Nitrogen, Total Kjeldahl	mg/l	--	--	--	0.74	0.87	--	0.629
pH	-	--	--	8.5	7.96	8.03	--	7.82
pH (Field)	-	--	--	8.5	7.6	7.5	--	7.15
Sulphate	mg/l	--	500 ⁽⁵⁾	--	22	22	--	35
Tannin & Lignin	mg/l	--	--	--	<0.1	<0.1	--	<1.0
Temperature (Field)	deg c	--	15	--	11.4	11	--	11
Total Dissolved Solids	mg/l	--	500	--	551	554	--	486
Turbidity	ntu	--	5 ⁽⁶⁾	-- ⁽⁷⁾	102	37.1	--	13.2
Turbidity (Field)	ntu	--	5 ⁽⁶⁾	-- ⁽⁷⁾	91.9	26.9	0.72	--
Metals								
Calcium	mg/l	--	--	--	76	74	--	94
Iron	mg/l	--	0.3	--	1.48	0.35	--	1.63
Magnesium	mg/l	--	--	--	26	23	--	17
Manganese	mg/l	--	0.05	--	0.05	0.03	--	0.06
Potassium	mg/l	--	--	--	8	6	--	5
Sodium	mg/l	--	200 ⁽⁸⁾	--	66	60	--	46
Phenols								
Phenolics, Total Recoverable	mg/l	--	--	--	0.002	<0.001	--	<0.001

Created by:CAMC
Checked by:KAM

Golder Associates Ltd.

ATTACHMENT 1

February 2012 Golder Report



February 2012

REPORT ON

Hydrogeology, Terrain Analysis and Impact Assessment Study 3406-3450 Frank Kenny Road

Submitted to:

J.L. Richards & Associates Limited
864 Lady Ellen Place
Ottawa, Ontario
K1Z 5M2

REPORT



Report Number: 11-1122-0129 (3000)

Distribution:

- 1 copy - J.L. Richards & Associates Limited
- 1 e-copy - J.L. Richards & Associates Limited
- 1 copy - Hydro One Networks Inc.
- 5 copies - City of Ottawa
- 1 copy - Bradley Bus Lines
- 2 copies - Golder Associates Ltd.





Table of Contents

1.0 INTRODUCTION.....	1
1.1 Scope of Work	1
1.2 Impact Assessment	2
1.3 Applicable Environmental Criteria.....	2
2.0 BACKGROUND INFORMATION.....	3
2.1 Surficial Geology.....	3
2.2 Bedrock Geology	3
2.3 Hydrogeology.....	3
3.0 TERRAIN ANALYSIS	5
3.1 Field Investigation Program	5
3.2 Subsurface Conditions.....	5
3.3 Class IV Sewage Disposal Systems	5
4.0 HYDROGEOLOGY STUDY	7
4.1 Field Investigation Program	7
4.1.1 Health and Safety.....	7
4.1.2 Well Construction.....	7
4.1.3 Pumping Test.....	7
4.1.4 Groundwater Sampling	8
4.2 Field Investigation Results.....	8
4.2.1 Subsurface Conditions	8
4.2.2 Pumping Test and Observation Wells	8
4.2.3 Groundwater Analytical Results	9
4.2.3.1 PW11-1 (S-1 and S-4)	9
4.2.3.2 Residential Well (S-2)	10
4.2.3.3 Bradley Bus Well (S-3)	11
5.0 IMPACT ASSESSMENT.....	13
6.0 SUMMARY AND CONCLUSIONS	14
7.0 LIMITATIONS AND USE OF REPORT	15



8.0 CLOSURE..... 16
REFERENCES..... 17

TABLES

Table 1: Summary of Groundwater Analytical Results, 3406 and 3450 Frank Kenny Road

FIGURES

Figure 1: Key Plan

Figure 2: Site Plan

Figure 3: Surficial Geology

Figure 4: Trend in Depth to Bedrock

Figure 5: Bedrock Geology

Figure 6: Groundwater Level Drawdown, PW11-1

Figure 7: Groundwater Level Drawdown, Bradley Bus Well and Residential Well

APPENDICES

APPENDIX A

Water Well Record, Bradley Bus Well

APPENDIX B

Records of Boreholes BH11-3, BH11-4, BH11-5, BH11-6 and BH11-7 and Test Pits TP11-1, TP11-2, TP11-3 and TP11-4

APPENDIX C

Ontario Building Code Tables (Sewage Systems)

APPENDIX D

Water Well Record, PW11-1

APPENDIX E

Raw Pumping Test Data and Transmissivity Calculations

APPENDIX F

Laboratory Certificates of Analysis

APPENDIX G

Nitrate Dilution Calculation



1.0 INTRODUCTION

Golder Associates Ltd. (Golder) was retained by J.L. Richards & Associates Limited (JLR), on behalf of 743120 Ontario Inc., to conduct a hydrogeology, terrain analysis and impact assessment study in support of a proposed site of the future Hydro One Networks Inc. (HONI) Orleans Service Centre in Ottawa, Ontario (Figure 1). The property is comprised of two civic addresses, 3406 and 3450 Frank Kenny Road Site (see Figure 2), and is located in an industrial/agricultural area adjacent to the Village of Navan. The property is 5.32 hectares (13.16 acres) in area and is topographically flat. The northern part of the Site (3406 Frank Kenny Drive) is 2.53 hectares (6.26 acres) in area and is currently occupied by M. L. Bradley Bus Lines (Bradley), while the southern portion of the Site (3450 Frank Kenny Drive) is 2.79 hectares (6.9 acres) in area and is occupied by a residential bungalow and agricultural land (leased to a tenant by Bradley). HONI will initially lease a small portion of the south parcel of the Site (agricultural land). HONI will eventually lease to own 2.90 hectares south of the bus operation.

HONI proposes to build an operations facility on the south parcel. We understand that the proposed operations facility building will be approximately 30,000 square feet in size and will house up to 35 employees. It is proposed that water supply to the operations facility will be provided by a new water supply well. This study has been prepared based on estimates of the future staffing levels provided to Golder, with the estimated water demand equal to approximately 5,000 L/day.

The purpose of the hydrogeology and terrain analysis study is to determine the following:

- If adequate quantities of potable water are available for the proposed development;
- If the soils are suitable for the installation of an on-site sewage disposal system; and,
- If the impact from the sewage system on downgradient water resources is within acceptable limits.

1.1 Scope of Work

The scope of work for the hydrogeology and terrain analysis study was based on the work program outlined in the Golder proposal to JLR, dated June 17, 2011. The hydrogeology study consisted of the following:

- Collection of background information for the site and surrounding area;
- Drilling of one test well on the site to determine the quality and quantity of groundwater available for water supply;
- Conducting a pumping test on the test well consisting of a pumping phase (6 hours) followed by a recovery phase (up to 10 hours);
- Monitoring of groundwater levels during the pumping and recovery phases in the pumping well and in existing water wells located at the Bradley office and at the nearby residence;
- Collection of groundwater samples from the pumping well after one hour of pumping and just before pump shut-off;
- Collection of groundwater samples at the residence and at the Bradley office; and,



- Submission of these groundwater samples for the analysis of chemical, physical and bacteriological parameters standard to subdivision supply requirements.

The terrain analysis consisted of the following:

- The excavation of four test pits and an inspection of the materials encountered;
- A review of materials encountered during drilling of seven boreholes completed as a part of the geotechnical investigation for the site (Golder, 2012); and,
- Installation of a shallow monitoring well in the clay overburden, collection of a groundwater sample and submission of this sample for analysis of nitrate.

1.2 Impact Assessment

A groundwater impact assessment was conducted in accordance with MOE Procedure D-5-4 (MOE, 1996b). Although Procedure D-5-4 does not strictly apply to this type of development, the City of Ottawa requested, during the Pre-Application consultation meeting held October 18, 2011, that the hydrogeological report incorporate an impact assessment of groundwater resources with respect to hazardous materials storage at the site.

1.3 Applicable Environmental Criteria

The procedures for the assessment of potential groundwater impact generally followed the MOE Guideline entitled “Technical Guideline for Individual On-site Sewage Systems: Water Quality Impact Risk Assessment”, dated August 1996 (Guideline D-5-4). It is assumed that the sewage system will be designed to be a small sewage system (handling no more than 10,000 L/day of effluent). The terrain analysis was not intended to provide specific design of the on-site sewage disposal system, but provided general recommendations for the type of system that would be appropriate for the site.

The procedures for the assessment of water supply for the site generally followed the Ministry of the Environment (MOE) guideline entitled, “Technical Guideline for Private Wells: Water Supply Assessment,” dated August 1996 (MOE Procedure D-5-5).



2.0 BACKGROUND INFORMATION

2.1 Surficial Geology

Published geological mapping indicates that in the area of 3450 Frank Kenny Road, surficial materials consist of offshore marine deposits (clay, silty clay and silt) and glacial till (see Figure 3, Surficial Geology). In the wider area, organic deposits, deltaic and estuary deposits and exposed bedrock are also present. Published geological mapping also indicates that the depth to bedrock is expected to be approximately 2 to 15 metres (Figure 4).

The well record from the existing water supply well at the Bradley office described 5.8 metres of clay underlain by 3.7 metres of glacial till (hardpan) over shale bedrock (Appendix A). At PW11-1, based on the well record, 8.9 metres of silty clay was found to overlie shale bedrock.

2.2 Bedrock Geology

Two bedrock units are indicated to be exposed in the area of the site: the Lindsay Formation and the overlying Billings Formation which are both Upper Ordovician in age (see Figure 5, Bedrock Geology). The Lindsay Formation consists of fossiliferous limestone with shaley partings while the Billings Formation consists of non-calcareous shale with thin limestone interbeds (Williams, 1991). Aquifers in the Lindsay Formation are restricted to seams that are in the calcareous shale layers (GSC, 2004). In the Billings Formation, supply is generally sufficient for domestic use with thick sections with no water. The quality is generally poor with mineral content in excess of accepted levels; aquifers commonly yield saline and sulfurous water (GSC, 2004).

2.3 Hydrogeology

A hydrogeological investigation of the Navan area water supply was conducted by Golder (Golder, 2001). The geology was found to consist of up to 10 m of clay followed by a glacial till aquifer underlain by bedrock of the Billings Formation shale (and/or dark grey to black limestone of the Eastview formation), underlain by the Gull River Formation limestone. Background information indicated that the gravel till was the best source of water and that the shale and limestone were poor water quality producers.

Golder also conducted a desktop review to assess the potential for provision of public water and wastewater services to all privately serviced villages in the City of Ottawa, including the village of Navan (Golder, 2007). The assessment was conducted for the area within 1 kilometre of the village boundaries, and examined information sources such as City of Ottawa base mapping, Ministry of Environment (MOE) water well information system (WWIS) and available mapping of topography, surficial and bedrock geology, drift thickness and surface water bodies. Municipal water supply and waste water services are not available at the site.

Based on an analysis of the WWIS for wells located within 1 km of the village of Navan, 81 overburden wells and 216 bedrock wells were identified. The well depths were reported to be up to 100 metres, with 88% of wells being 30 metres deep or less. Of the overburden wells, 90% reported well yields of 20 L/min/m or less; 36% of wells were reported as having fresh water and 64% of wells had salty water. Of the bedrock wells, 91% reported well yields of 20 L/min/m or less; 54% of wells were reported as having fresh water and 46% of wells had salty water.

Groundwater use within the vicinity of the site is limited to private water supply wells for residences and small businesses. Four groundwater users were identified within 500 metres of the site:

- 1) The Bradley Bus office well (3406 Frank Kenny Road);



- 2) On-site residential well (3450 Frank Kenny Road);
- 3) Private well at the property immediately north of the site (3372 Frank Kenny Road); and,
- 4) Private well located south of the site (1533 Colonial Road).



3.0 TERRAIN ANALYSIS

3.1 Field Investigation Program

Test pits TP11-1, TP11-2, TP11-3 and TP11-4 and boreholes BH11-4 and BH11-5 were advanced in the area of the proposed on-site sewage disposal system. Details of the subsurface conditions at each location are presented on the Record of Test Pits in Appendix B. The locations of the test pits are shown on Figure 2.

A groundwater sample was collected from the standpipe installed in borehole BH11-5 and submitted for analysis of nitrate in order to determine the background nitrate concentration.

3.2 Subsurface Conditions

This section provides a summarized account of the subsurface soils and groundwater conditions on the site based on the information obtained from the test pits completed on October 31, 2011. It is noted that in some cases the stratigraphic boundaries within the overburden represent a transition between soil types rather than an exact plane of geologic change.

Brown topsoil with a thickness of 0.15 metres was encountered at ground surface at all four test pit locations. Grey brown silty clay was found below the topsoil at all test pit locations. At test pit TP11-2, 1.40 metres of grey brown silty sand with some gravel and clay, with cobbles, and boulders (glacial till) was encountered below the silty clay; however, the sample taken from this layer was found to have a high clay content and was too fine for grain size analysis. The test pits were all terminated in the silty clay at depths of 1.60 to 2.00 mbgs, with the exception of test pit TP11-2 which was terminated in the glacial till at 2.40 mbgs. Groundwater seepage was observed in the test pits at depths of 1.50 to 2.00 mbgs.

Shale was encountered at depths of 3.1 to 4.3 mbgs in boreholes BH11-4, BH11-5, BH11-6 and BH11-7.

A nitrate concentration of less than 0.1 mg/L was measured in the groundwater sample collected from borehole BH11-5.

3.3 Class IV Sewage Disposal Systems

The following sewage system recommendations are based on a conventional Class IV Sewage System comprised of a septic tank and an absorption trench leaching bed. Design parameters contained in this section are derived from the 2006 Ontario Building Code (OBC), and are intended as guidelines only with respect to the feasibility of constructing a system at the proposed operations building. Prior to construction of a sewage system, the system will be designed for the proposed operations building.

For the purpose of demonstrating that this site has adequate land area for sewage disposal, the most conservative soil conditions and largest treatment and disposal area requirements were assumed. It is our understanding that total sewage flows are estimated to be in the range of 3,000 L/day to 5,000 L/day, based on estimates of future staffing levels of 35 employees.

The shallow soil profile in the majority of the site is characterized by a topsoil layer followed by a silty clay unit to at least 1.40 mbgs. Groundwater was encountered below the topsoil layer in the test pits at depths of 1.50 to 2.00 mbgs.



Due to the low permeability native soils present at the site a raised to partially raised leaching bed will be required. Imported sand is required for the construction of raised leaching beds. A minimum of 500 metres of distribution piping is required for conventional leaching bed construction based on the following formula:

$$L = \frac{QT}{200}$$

where:

- L = total length of the distribution pipe in metres;
- Q = the total daily design sanitary sewage flow in litres (5,000 L/day, assuming that the sewage system will be designed to be a small sewage system; and,
- T = the design percolation time imported sand (assumed to be 10 minutes (OBC Table 2)).

The clearances around the distribution piping are to be a minimum of those shown in the OBC Table 8.2.1.6 B. The leaching bed area should be chosen such that the bed is at no steeper grade than 1V:4H, and not in an area prone to flooding. The bed area should be backfilled so as not to settle and create any depressions. The bed should be shaped to shed water, and should be protected from erosion and any compaction, stress or pressure that could negatively impact the bed.

The percolation time of the silty clay encountered below the topsoil across most of the site will exceed 50 minutes per centimetre (see OBC Table 3). The loading rate corresponding to this percolation time is equal to 4 L/m²/day (see OBC Table 8.7.4.1.A). Therefore, the leaching bed area required for a total daily design sanitary sewage flow of 5,000 L/day is 1,250 m².

The grassed area east of the proposed building footprint, adjacent to Frank Kenny Road is approximately 4,900 m². The 1,250 m² sewage disposal footprint can be accommodated on this area of the site.



4.0 HYDROGEOLOGY STUDY

It should be noted that the hydrogeology study was completed in conjunction with a Phase I ESA and geotechnical program. Results of these investigations are provided under separate cover (Golder 2011 and 2012).

4.1 Field Investigation Program

4.1.1 Health and Safety

Prior to initiating the fieldwork, Golder developed and implemented site-specific protocols to protect the health and safety of its employees and subcontractors through the preparation of a site-specific Health and Safety Plan.

Underground Services Locators Ltd. (a private service utility locator) was retained to coordinate utility clearances with the local utility companies, and to clear the proposed borehole location prior to the initiation of the fieldwork.

4.1.2 Well Construction

A new well, PW11-1, shown on Figure 2, was drilled on November 4, 2011 by Bourgeois Well Drilling Ltd. of St. Albert, Ontario. The installation of the well casing was monitored by Golder field staff to ensure that appropriate grouting procedures were followed.

4.1.3 Pumping Test

A pumping test of approximately 360 minutes in duration was conducted on PW11-1 from approximately 9:30 am until 4 pm on November 7, 2011. The well was pumped at a rate of approximately 15.1 L/min (4 US GPM) for the first 32 minutes of the test, after which the rate was reduced to approximately 9.5 L/min (2.5 US GPM) due to the large amount of drawdown observed in the pumping well. At the 40-minute mark, the rate was increased to 10.2 L/min (2.7 US GPM) and at 66 minutes, increased again to 11.3 L/min (3 US GPM) for the remainder of the test. The pumping rates used in the test are summarized in the following table.

Time Period of Pumping Test	Approximate Pumping Rate
0 to 32 minutes	15.1 L/min
32 to 40 minutes	9.5 L/min
40 to 66 minutes	10.2 L/min
66 minutes to end of test	11.3 L/min

During the test, a total of 4,328 L of water was extracted from the aquifer.

The water levels were measured in PW11-1 and at two observation wells (the nearby residential well and the Bradley Bus well) manually, using an electric water level tape, and electronically, using pressure transducer loggers which took measurements at appropriate intervals. The residential well and the Bradley Bus well are located approximately 60 metres and 220 metres from PW11-1, respectively. A barometric pressure logger was used on-site for post-processing barometric compensation. Following the cessation of pumping, groundwater levels in PW11-1 and the observation wells were measured until water levels had recovered to pre-pumping levels.

Pumped water was discharged to the roadside ditch located approximately 90 metres southeast of PW11-1.



4.1.4 Groundwater Sampling

Two samples of the pumped groundwater were collected from PW11-1 (labelled S-1 and S-4) and submitted to Exova Laboratories of Ottawa for analysis of chemical, physical and microbiological analyses of parameters commonly used to evaluate water quality for residential subdivision developments. The first sample was collected 70 minutes after the start of pumping on November 11, 2011, and the second sample was collected just prior to the end of pumping.

The two existing water supply wells at the site (at the residence (labelled S-2), and at the bus company (labelled S-3)) were sampled after approximately 3.5 hours and 4 hours into the pumping test, respectively, and submitted to Exova Laboratories for chemical, physical and microbiological analyses of parameters standard to subdivision supply requirements.

The turbidity of the discharge water was monitored periodically in the field during the pumping test. Field measurements of temperature, pH, conductivity, chlorine residual, turbidity and hydrogen sulphide were taken at PW11-1 and the observation wells at the time of sampling. All analyses were compared to the applicable maximum acceptable concentrations (MAC), interim maximum acceptable concentrations (IMAC), or aesthetic objectives (AO) found in the Technical Support Document for Ontario Drinking Water Quality Standards, Objectives and Guidelines (ODWQS) (MOE, 2006).

4.2 Field Investigation Results

4.2.1 Subsurface Conditions

Based on the water well record, the 152 millimetre diameter well was completed at a depth of 24.3 metres. During drilling, silty clay overburden was encountered to a depth of 8.9 metres where shale bedrock was encountered. PW11-1 was cased to a depth of 10.9 metres using steel casing. At the end of drilling, the groundwater level in PW11-1 was 9.5 metres below the top of the steel casing. The groundwater level on November 7, 2011, prior to the start of the pumping test, was 1.72 metres below the top of the steel casing. The water well record for PW11-1 is located in Appendix D.

4.2.2 Pumping Test and Observation Wells

The drawdown observed at PW11-1 during the November 2011 pumping test is illustrated on Figure 6, and the drawdown observed at the observation wells is illustrated on Figure 7. The two observation wells were in use during the pumping test on PW11-1 and the abrupt changes in the amount of drawdown measured in these wells were attributed to coincidental pumping from these wells during the pumping test. The general downward trend in measured water levels in the observation wells were assumed to represent the response from pumping PW11-1.

The water level recovery in PW11-1 achieved 95% recovery approximately 26 minutes following the cessation of pumping. The drawdown in the observation wells was small relative to the precision of the pressure transducer loggers and the manual water level tape, and relative to the drawdown caused by coincidental water usage at these wells during the pumping test. As a result, it was difficult to calculate the percent recovery at these wells following the cessation of the pumping test. The residual drawdown measured at the residential well 23 minutes after the end of pumping was 0.04 metres, and at the Bradley Bus well 53 minutes after the end of pumping was 0.02 metres.



Aquifer transmissivity was estimated using the Cooper and Jacob drawdown method (Cooper and Jacob, 1946) and the Theis recovery method (Theis, 1935) to interpret drawdown data collected during the pumping test at PW11-1 (see Appendix E). The water levels at the residential well and at the Bradley Bus well exhibited a decrease of approximately 0.06 metres and 0.03 metres, respectively, in response to pumping at PW11-1. Based on pumping well and observation well data, the aquifer transmissivity is indicated to range from approximately 0.5 to 99 m²/day, and the storativity is indicated to range from approximately 1.1x10⁻⁴ to 2.6x10⁻⁴.

The wide range in transmissivity calculated from the data can be attributed to an imperfect hydraulic connection between the pumping well and the observation wells.

Based on the data obtained during the pumping test, it can be concluded that PW11-1 is capable of supplying at least 11.3 L/min (16,350 L/day). During the course of the six hour pumping test period, about 31 percent of the available drawdown was utilized while pumping at an average rate of 11.3 L/min. As such, the yield of PW11-1 considerably exceeds the assumed water usage for the new operations facility of 5,000 L/day.

Additional surging followed by pumping was performed on PW11-1 to reduce turbidity (Section 4.2.3.1). This additional well development not only reduced the turbidity, it substantially increased the yield of the well. The well maintained a pumping rate of 53 L/min for 6.5 hours and the water level measured at the end of pumping was 1.86 metres below the top of the well casing. A total of 20,700 L of water were extracted during this operation.

4.2.3 Groundwater Analytical Results

The field observations and the results of the laboratory microbiological, chemical and physical analyses for the groundwater samples collected from PW11-1, the Bradley Bus well and the residential well are summarized in Table 1 following the text of this report. The certificates of laboratory analyses are included in Appendix F.

All laboratory results were compared to the applicable maximum acceptable concentrations (MAC), interim maximum acceptable concentrations (IMAC), aesthetic objectives (AO) found in the Technical Support Document for Ontario Drinking Water Quality Standards (MOE, 2006).

4.2.3.1 PW11-1 (S-1 and S-4)

Analytical results of the groundwater samples collected from PW11-1 on November 7, 2011 indicate an AO exceedance for the total dissolved solids (TDS) concentration, which was measured to be 551 mg/L after 70 minutes of pumping and 554 mg/L after 6.3 hours of pumping, just before pump shut-off. The AO for TDS is 500 mg/L (MOE, 2006). The potential for corrosion or encrustation problems associated with elevated TDS was assessed by calculating the Langelier Saturation Indices (LSI) for the 70-minute and 6.3-hour samples, which were 0.1 and 0, respectively. These LSI values are within the range generally considered stable (between -0.5 and +0.5) and indicate that corrosion or encrustation problems are unlikely.

The field hydrogen sulphide concentrations measured in the samples collected after 70 minutes and 6.3 hours of pumping were 2 mg/L and 2 mg/L, respectively, greater than the AO of 0.05 mg/L. Laboratory measured concentrations of hydrogen sulphide were 2.88 mg/L (initial) and non-detectable at the end of the test. Hydrogen sulphide in these concentrations can be treated with conventional water treatment equipment.

The field turbidity concentrations measured in the samples collected after 70 minutes and 6.3 hours of pumping were 91.9 NTU and 26.9 NTU, respectively, greater than the AO of 5 mg/L (applicable at the point of



consumption). In accordance with Procedure D-5-5, the treatability limit for turbidity is 5 NTU for non-disinfected water supplies.

Based on the elevated levels of turbidity measured in the samples taken from PW11-1, a strategy was developed to reduce the turbidity of the groundwater at this well to below 1 NTU in order to meet the health-related objective under Table 2 of Procedure D-5-5. On December 22, 2011, the well was surged by the well driller and pumped at a rate of approximately 53 L/min (14 US GPM) for 6.5 hours. Just before pump shut-off, the field turbidity was measured to be 0.72 NTU, below the health-related objective under Procedure D-5-5.

The sodium concentration measured in the samples collected after 70 minutes and 6.3 hours of pumping, was 66 mg/L and 60 mg/L, respectively, which is below the aesthetic objective for sodium in drinking water of 200 mg/L. However, in accordance with Procedure D-5-5, the local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

The iron concentrations measured in the samples collected after 70 minutes and 6.3 hours of pumping were 1.48 mg/L and 0.35 mg/L, respectively, slightly greater than the AO of 0.30 mg/L. In accordance with Procedure D-5-5, the treatability limit for iron is 10 mg/L. Iron in these concentrations can be treated with conventional water treatment equipment.

All of the bacteriological parameters with the exception of the heterotrophic plate count and total coliforms were measured below the laboratory method detection limits for the samples collected after 70 minutes and 6.3 hours of pumping. Heterotrophic plate counts of 12 and 12 cfu/mL were measured in the samples collected after 70 minutes and 6.3 hours of pumping, respectively. The presence of heterotrophic bacteria is not considered a health concern.

Total coliforms of 5 and 2 cfu/100mL were measured in the samples collected after 70 minutes and 6.3 hours of pumping, respectively, above the health-related ODWQS of 0 cfu/100mL established for water systems that are disinfected. In accordance with Procedure D-5-5, a total coliform count of less than 6 cfu/100mL is considered as indicative of acceptable water quality for a raw groundwater supply. However, despite acceptable raw water bacteriological quality, Hydro One has a policy that all groundwater supplies that service their facilities are equipped with disinfection equipment. This policy will apply to both the permanent facility and any temporary facility used by Hydro One.

All of the other results of chemical analysis for PW11-1 were below the respective MACs and AOs (see Table 1).

4.2.3.2 Residential Well (S-2)

Analytical results of the groundwater sample collected from the residential well on November 7, 2011 indicate an AO exceedance for the total dissolved solids (TDS) concentration, which was measured to be 645 mg/L. The AO for TDS is 500 mg/L (MOE, 2006). The potential for corrosion or encrustation problems associated with elevated TDS was assessed by calculating the Langelier Saturation Index (LSI), which was 0.3. This LSI value is within the range generally considered stable (between -0.5 and +0.5) and indicates that corrosion or encrustation problems are unlikely.

The field hydrogen sulphide concentration measured in the sample was 0.1 mg/L, greater than the AO of 0.05 mg/L, but within treatable limits.



The field turbidity concentration measured in the sample was 14.1 NTU, greater than the AO of 5 NTU. In accordance with Procedure D-5-5, the treatability limit for turbidity is 5 NTU. Elevated turbidity is frequently a function of insufficient well development.

The sodium concentration measured in the sample was 41 mg/L, which is below the aesthetic objective for sodium in drinking water of 200 mg/L. However, in accordance with Procedure D-5-5, the local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

The iron concentration measured in the sample collected was 1.86 mg/L, respectively, greater than the AO of 0.30 mg/L. In accordance with Procedure D-5-5, the treatability limit for iron is 10 mg/L.

The manganese concentration measured in the sample collected was 0.08 mg/L, respectively, greater than the AO of 0.05 mg/L. In accordance with Procedure D-5-5, the treatability limit for manganese is 1.0 mg/L.

All of the other results of chemical analysis for the residential well were below the respective MACs and AOs (see Table 1).

All of the bacteriological parameters with the exception of the total coliforms and heterotrophic plate count were measured below the laboratory method detection limits for the sample collected. Total coliforms of 12 cfu/100mL were measured, above the health-related ODWQS of 0 cfu/100mL established for water systems that are disinfected. A total coliforms count of less than 6 cfu/100mL is generally considered acceptable for untreated supplies. A heterotrophic plate count of 5 cfu/mL was measured. The presence of heterotrophic bacteria is not considered a health concern. The owner of the well was notified of the coliform result. It is also noted that when the site is developed, the residence will be demolished and the residential well will be abandoned in accordance with O. Reg. 903.

The presence of elevated bacterial levels in groundwater is usually specific to a particular well, as opposed to a wider problem within a water supply aquifer. Although a determination of the reason for elevated bacterial levels at the residential well is outside the scope of this study, bacteria may be present in a well due to reasons such as improper well construction, deteriorating well casing, contamination during pump maintenance, etc. No information was provided on the construction of the residential well. The slightly elevated bacterial levels detected in the residential well would not be expected to affect the water quality at PW11-1, as demonstrated by the excellent bacteriological results obtained from this well.

4.2.3.3 Bradley Bus Well (S-3)

Analytical results of the groundwater sample collected from the Bradley Bus well on November 7, 2011 indicate an AO exceedance for the total dissolved solids (TDS) concentration, which was measured to be 650 mg/L. The AO for TDS is 500 mg/L (MOE, 2006). The potential for corrosion or encrustation problems associated with elevated TDS was assessed by calculating the Langelier Saturation Index (LSI), which was 0.1. This LSI value is within the range generally considered stable (between -0.5 and +0.5) and indicates that corrosion or encrustation problems are unlikely.

The laboratory-measured turbidity concentration measured in the sample was 7.6 NTU, greater than the AO of 5 NTU; however, the field turbidity concentration measured at the time of sampling was 3.77 NTU. In accordance with Procedure D-5-5, the treatability limit for turbidity is 5 NTU.



The sodium concentration measured in the sample was 51 mg/L, which is below the aesthetic objective for sodium in drinking water of 200 mg/L. However, in accordance with Procedure D-5-5, the local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

The iron concentration measured in the sample collected was 0.82 mg/L, respectively, greater than the AO of 0.30 mg/L. In accordance with Procedure D-5-5, the treatability limit for iron is 10 mg/L.

All of the bacteriological parameters with the exception of the heterotrophic plate count were measured below the laboratory method detection limits for the sample collected. A heterotrophic plate count of 18 cfu/mL was measured. The presence of heterotrophic bacteria is not considered a health concern.

All of the other results of chemical analysis for the Bradley Bus well were below the respective MACs and AOs (see Table 1).



5.0 IMPACT ASSESSMENT

A nitrate dilution model was utilized to assess the potential impact of septic effluent on the properties adjoining 3450 Frank Kenny Road, The net potential infiltration was based on the regional climatic data for the Ottawa area provided by Environment Canada. The daily effluent loading was based on 125 L/day per employee, assuming that showers would be built in the operations centre. A maximum of 35 employees was assumed based on information provided by HONI. The background nitrate concentration was assumed to be less than 0.1 mg/L based on the groundwater sample taken from borehole BH11-5, and the nitrate concentration of the effluent was assumed to be 40 mg/L. The site area was assumed to be 2.90 hectares. The nitrate dilution calculation is provided in Appendix G.

With regard to treatment and dispersal of effluent from the leaching beds, the maximum nitrate concentration at the property boundary was calculated to be 9.4 mg/L, less than the ODWQS of 10 mg/L. It should be noted that this calculation is conservative since many of the 35 employees will spend the majority of their work day away from the operations facility, and the number of full-day equivalent employees at the facility will be less than 10. Nevertheless, a nitrate pre-treatment system may be considered for the operations facility, if required. It is concluded that the impact of the proposed operations facility on groundwater at the downgradient property boundary is considered acceptable in accordance with MOE Guideline D-5-4.

It is understood that the operations facility will include limited hazardous materials storage (e.g. PCBs). HONI has established procedures and guidelines for storage of hazardous materials that meet applicable provincial environmental requirements.



6.0 SUMMARY AND CONCLUSIONS

Based on the terrain evaluation and groundwater supply investigation carried out by Golder Associates at the site, the following summary and conclusions are provided:

- a) A septic system at the site must be constructed in accordance with the 2006 Ontario Building Code (OBC). Section 3.3 provides general septic leaching bed design considerations. Based on these considerations, the site can accommodate a septic field for the proposed operations centre. Prior to construction of a septic system, detailed design will be required;
- b) According to the nitrate dilution calculation, maximum nitrate concentration at the property boundary was calculated to be 9.4 mg/L, less than the maximum of 10 mg/L under Procedure D-5-4. It is concluded that the impact of the proposed operations facility on groundwater at the downgradient property boundary is considered acceptable;
- c) It is understood that the operations facility will include limited hazardous materials storage (e.g. PCBs). It is recommended that any hazardous materials storage on the site incorporate measures to prevent release of these materials to the environment, to prevent contamination of the aquifer from sources located at ground surface. HONI has established procedures and guidelines for storage of hazardous materials that meet applicable provincial environmental requirements;
- d) The pumping test conducted at well PW11-1 suggests that a sufficient quantity of water is available in the bedrock to satisfy a daily water consumption of 16,350 L/day, above the assumed water usage for the new operations facility of 5,000 L/day or less based on 35 employees at the proposed operations centre;
- e) The groundwater quality at well PW11-1 indicates that the water quality meets applicable standards or objectives for the analyzed parameters, with the exception of TDS, iron, hydrogen sulphide and total coliforms. Treatment may be necessary to reduce the iron and hydrogen sulphide concentrations below the AOs. Common techniques for iron include water softeners, manganese greensand filters or other oxidizing media. Corrosion or encrustation problems associated with TDS are considered unlikely. Total coliforms were measured to be 5 and 2 cfu/100mL in raw samples from the well, slightly above the health-related ODWQS of 0 cfu/100mL established for water systems that are disinfected; however, in accordance with Procedure D-5-5, a total coliform count of less than 6 cfu/100mL is considered as indicative of acceptable water quality; and,
- f) Based on the small amount of drawdown measured at the observation wells, located approximately 61 and 220 metres from PW11-1, it is not expected that the proposed use of PW11-1 would adversely affect other nearby groundwater users, including the nearby residence and the Bradley Bus office.



7.0 LIMITATIONS AND USE OF REPORT

This letter report was prepared for the exclusive use of the J.L. Richards & Associates, 743120 Ontario Inc. and Hydro One Networks Inc. Should additional parties require reliance on this report, written authorization from Golder Associates Ltd. would be required. The report, which specifically includes all tables, figures and attachments is based on data and information collected during the hydrogeology assessment conducted by Golder Associates Ltd. and is based solely on the conditions of the property at the time of the field investigation, supplemented by historical information and data obtained by Golder Associates Ltd. as described in this report.

The services performed as described in this letter report were conducted in a manner consistent with that level of care and skill normally exercised by other members of the engineering and science professions currently practicing under similar conditions, subject to the time limits and financial and physical constraints applicable to the services.

Any use which a third party makes of this letter report, or any reliance on, or decisions to be made based on it, are the responsibilities of such third parties. Golder Associates Ltd. accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this letter.

The content of this letter report is based on information collected during our investigation, our present understanding of the site conditions, and our professional judgement in light of such information at the time of this letter report. This letter report provides a professional opinion and therefore no warranty is either expressed, implied, or made as to the conclusions, advice and recommendations offered in this letter report. This letter report does not provide a legal opinion regarding compliance with applicable Canadian laws. With respect to regulatory compliance issues, it should be noted that regulatory statutes and the interpretation of regulatory statutes are subject to change.

The findings and conclusions of this letter report are valid only as of the date of this report. If new information is discovered in future work, including excavations, borings, or other studies, Golder Associates Ltd. should be requested to re-evaluate the conclusions of this letter report, and to provide amendments as required. The groundwater supply well installed during the course of this investigation has been left in place. This well is the property of the owner/client and not Golder Associates Ltd.



8.0 CLOSURE

We trust this report satisfies your current needs. If you have any questions regarding this report, please contact the undersigned.

GOLDER ASSOCIATES LTD.

Caitlin Cooke, M.Sc., P.Geol.
Hydrogeologist



Stephen R. Wilson, P.Geol.
Senior Hydrogeologist/Associate

CAMC/SRW/sg

n:\active\2011\1122 - contaminated lands\11-1122-0129 hydro one frank kenny road\hydrogeology\report - final\rpt frank kenny rd hydrogeology study 2012-02-07 final.docx

Golder, Golder Associates and the GA globe design are trademarks of Golder Associates Corporation.



REFERENCES

- Cooper, H.H. and C.E. Jacob, 1946. A generalized graphical method for evaluating formation constants and summarizing well field history, Am. Geophys. Union Trans., vol. 27, pp. 526-534.
- Geological Survey of Canada. 2004. Urban Geology of the National Capital Area, Online Data, http://gsc.nrcan.gc.ca/urbgeo/natcap/index_e.php. Last accessed November 8, 2011.
- Golder Associates Ltd., 2001. Hydrogeological Investigation, Navan Area, Water Supply, City of Ottawa, Ontario, Report No. 011-2912. September 2001.
- Golder Associates Ltd., 2007. Draft Report on Assessment of Potential for Provision of Public Water and Wastewater Services to Privately Serviced Villages, City Of Ottawa, Ontario. Report No. 07-1122-0029. April 2007.
- Golder Associates Ltd., 2011. Phase I Environmental Site Assessment, 3406/3450 Frank Kenny Road, Ottawa (Orleans), Ontario. Report No. 11-1122-0129(1000). September 2011.
- Golder Associates Ltd., 2012. Geotechnical Investigation, Proposed Hydro One Operations Facility, 3406-3450 Frank Kenny Road, Ottawa, Ontario. Report No. 11-1122-0129-2000. January 2012.
- Ministry of the Environment, 1996a. Procedure D-5-5, Technical Guideline for Private Wells: Water Supply Assessment, Revised August 1996. Ontario Ministry of the Environment.
- Ministry of the Environment, 1996b. Procedure D-5-4, Technical Guideline for Individual On-site Sewage Systems: Water Quality Impact Risk Assessment, Revised August 1996. Ontario Ministry of the Environment.
- Ministry of the Environment, 2006. Ontario Drinking Water Quality Standards, Objectives and Guidelines, June 2003, Revised June 2006. Ontario Ministry of the Environment.
- Ministry of Municipal Affairs and Housing. 2006. 2006 Building Code Compendium.
- Theis, C.V. 1935. The relation between the lowering of the piezometric surface and the rate and duration of discharge of a well using groundwater storage, Trans. Amer. Geophys. Union, Vol. 16, pp. 519-524.
- Williams, D.A., 1991. Paleozoic Geology of the Ottawa-St Lawrence Lowland, Southern Ontario; Ontario Geological Survey, Open File Report 5770, 292p.

Table 1
Summary of Groundwater Analytical Results
3406 and 3450 Frank Kenny Road

Parameter	Unit	(2) (1)	(4) (3)	(6) (5)	PW11-1	PW11-1	PW11-1
		ODWQS(169/03)-	ODWQS-	MOE	11/7/2011	11/7/2011	12/22/2011
		Health	AO	D-5-5	S-1	S-4	PW11-1
Bacterial							
Coliform	cfu/100ml	0	--	--	5	2	--
Escherichia coli	cfu/100ml	0	--	--	0	0	--
Fecal Coliform	cfu/100ml	--	--	--	0	0	--
Fecal Streptococci, Kf Agar	cfu/100ml	--	--	--	0	0	--
Heterotrophic Plate Count	cfu/ml	--	--	--	12	12	--
General Chemistry							
Alkalinity as CaCO ₃	mg/l	--	--	--	284	295	--
Ammonia Nitrogen	mg/l	--	--	--	0.76	0.70	--
Chloride	mg/l	--	250	250	89	90	--
Chlorine, Total (Field)	mg/l	--	--	--	0.01	0	--
Chlorine, Free (Field)	mg/l	--	--	--	0	0	--
Color	color unit	--	5	7	<2	<2	--
Conductivity	uS/cm	--	--	--	848	853	--
Conductivity (Field)	uS/cm	--	--	--	823	813	--
Dissolved Organic Carbon	mg/l	--	5	10	1.5	1.2	--
Fluoride	mg/l	1.5	--	--	0.29	0.27	--
Hardness, Calcium Carbonate	mg/l	--	--	--	297	279	--
Hydrogen Sulfide	mg/l	--	0.05	--	<u>2.88</u>	<u><0.10</u>	--
Hydrogen Sulfide (Field)	mg/l	--	0.05	--	<u>2</u>	<u>2</u>	--
Ion Balance	-	--	--	--	1.04	0.94	--
Nitrate as N	mg/l	10	--	--	0.14	<0.10	--
Nitrite as N	mg/l	1	--	--	<0.10	<0.10	--
Nitrogen, Total Kjeldahl	mg/l	--	--	--	0.74	0.87	--
pH	-	--	--	--	7.96	8.03	--
pH (Field)	-	--	--	--	7.6	7.5	--
Sulfate	mg/l	--	500 ⁽⁸⁾	500	22	22	--
Tannin & Lignin	mg/l	--	--	--	<0.1	<0.1	--
Temperature (Field)	deg c	--	15	--	11.4	11	--
Total Dissolved Solids	mg/l	--	500	-- ⁽¹³⁾	<u>551</u>	<u>554</u>	--
Turbidity	ntu	--	5 ⁽⁹⁾	5	<u>102</u>	<u>37.1</u>	--
Turbidity (Field)	ntu	--	5 ⁽⁹⁾	5	<u>91.9</u>	<u>26.9</u>	0.72
Metals							
Calcium	mg/l	--	--	--	76	74	--
Iron	mg/l	--	0.3	5 ⁽¹²⁾	<u>1.48</u>	<u>0.35</u>	--
Magnesium	mg/l	--	--	--	26	23	--
Manganese	mg/l	--	0.05	1	0.05	0.03	--
Potassium	mg/l	--	--	--	8	6	--
Sodium	mg/l	--	200 ⁽¹¹⁾	200	66	60	--
Phenols							
Phenolics, Total Recoverable	mg/l	--	--	--	0.002	<0.001	--

Created by:CAMC
Checked by:SRW
Page 1 of 4

Table 1
Summary of Groundwater Analytical Results
3406 and 3450 Frank Kenny Road

Parameter	Unit	(2) (1)	(4) (3)	DOMESTIC WELL
		ODWQS(169/03)- Health	ODWQS- AO	11/7/2011
				S-2
Bacterial				
Coliform	cfu/100ml	0	--	12
Escherichia coli	cfu/100ml	0	--	0
Fecal Coliform	cfu/100ml	--	--	0
Fecal Streptococci, Kf Agar	cfu/100ml	--	--	0
Heterotrophic Plate Count	cfu/ml	--	--	5
General Chemistry				
Alkalinity as CaCO ₃	mg/l	--	--	312
Ammonia Nitrogen	mg/l	--	--	0.14
Chloride	mg/l	--	250	80
Chlorine, Total (Field)	mg/l	--	--	0
Chlorine, Free (Field)	mg/l	--	--	0
Color	color unit	--	5	<2
Conductivity	uS/cm	--	--	992
Conductivity (Field)	uS/cm	--	--	940
Dissolved Organic Carbon	mg/l	--	5	1.3
Fluoride	mg/l	1.5	--	0.11
Hardness, Calcium Carbonate	mg/l	--	--	471
Hydrogen Sulfide	mg/l	--	0.05	<u>0.14</u>
Hydrogen Sulfide (Field)	mg/l	--	0.05	<u>0.1</u>
Ion Balance	-	--	--	1.08
Nitrate as N	mg/l	10	--	<0.10
Nitrite as N	mg/l	1	--	<0.10
Nitrogen, Total Kjeldahl	mg/l	--	--	0.26
pH	-	--	--	7.91
pH (Field)	-	--	--	7.41
Sulfate	mg/l	--	500 ⁽⁸⁾	95
Tannin & Lignin	mg/l	--	--	<0.1
Temperature (Field)	deg c	--	15	11.4
Total Dissolved Solids	mg/l	--	500	<u>645</u>
Turbidity	ntu	--	5 ⁽⁹⁾	<u>28.4</u>
Turbidity (Field)	ntu	--	5 ⁽⁹⁾	<u>14.1</u>
Metals				
Calcium	mg/l	--	--	169
Iron	mg/l	--	0.3	<u>1.86</u>
Magnesium	mg/l	--	--	12
Manganese	mg/l	--	0.05	<u>0.08</u>
Potassium	mg/l	--	--	3
Sodium	mg/l	--	200 ⁽¹¹⁾	41
Phenols				
Phenolics, Total Recoverable	mg/l	--	--	<0.001

Table 1
Summary of Groundwater Analytical Results
3406 and 3450 Frank Kenny Road

Parameter	Unit	(2) (1)	(4) (3)	BUS DEPOT WELL
		ODWQS(169/03)- Health	ODWQS- AO	11/7/2011
				S-3
Bacterial				
Coliform	cfu/100ml	0	--	0
Escherichia coli	cfu/100ml	0	--	0
Fecal Coliform	cfu/100ml	--	--	0
Fecal Streptococci, Kf Agar	cfu/100ml	--	--	0
Heterotrophic Plate Count	cfu/ml	--	--	18
General Chemistry				
Alkalinity as CaCO ₃	mg/l	--	--	332
Ammonia Nitrogen	mg/l	--	--	0.07
Chloride	mg/l	--	250	104
Chlorine, Total (Field)	mg/l	--	--	0.02
Chlorine, Free (Field)	mg/l	--	--	0.01
Color	color unit	--	5	2
Conductivity	uS/cm	--	--	1000
Conductivity (Field)	uS/cm	--	--	964
Dissolved Organic Carbon	mg/l	--	5	1.6
Fluoride	mg/l	1.5	--	<0.10
Hardness, Calcium Carbonate	mg/l	--	--	439
Hydrogen Sulfide	mg/l	--	0.05	<0.01
Hydrogen Sulfide (Field)	mg/l	--	0.05	0
Ion Balance	-	--	--	1.06
Nitrate as N	mg/l	10	--	<0.10
Nitrite as N	mg/l	1	--	<0.10
Nitrogen, Total Kjeldahl	mg/l	--	--	<0.10
pH	-	--	--	7.90
pH (Field)	-	--	--	7.23
Sulfate	mg/l	--	500 ⁽⁸⁾	43
Tannin & Lignin	mg/l	--	--	<0.1
Temperature (Field)	deg c	--	15	13.2
Total Dissolved Solids	mg/l	--	500	<u>650</u>
Turbidity	ntu	--	5 ⁽⁹⁾	<u>7.6</u>
Turbidity (Field)	ntu	--	5 ⁽⁹⁾	3.77
Metals				
Calcium	mg/l	--	--	156
Iron	mg/l	--	0.3	<u>0.82</u>
Magnesium	mg/l	--	--	12
Manganese	mg/l	--	0.05	0.05
Potassium	mg/l	--	--	2
Sodium	mg/l	--	200 ⁽¹¹⁾	51
Phenols				
Phenolics, Total Recoverable	mg/l	--	--	<0.001

Footnotes:

Tables should be read in conjunction with the accompanying document.

< value = Indicates parameter not detected above laboratory method detection limit

> value = Indicates parameter detected above equipment analytical range

-- Chemical not analyzed or criteria not defined

(01) Ontario Drinking Water Quality Standards - Health Based Standards

(02) Bold = Parameter concentration greater than ODWQS(169/03)-Health

(03) Ontario Drinking Water Quality Standards - Aesthetic Objectives. Aesthetic Objectives are established for parameters that may impair the taste, odour or colour of water or which may interfere with good water quality control practices. For certain parameters, both aesthetic objectives and health-related MACs have been derived.

(04) Underline = Parameter concentration greater than ODWQS-AO

(05) Maximum concentration considered reasonably treatable for several aesthetic parameters as found in MOE Procedure D-5-5, Technical Guideline for Private Wells: Water Supply Assessment, Last Revision August 1996.

(06) Italic = Parameter concentration greater than MOE D-5-5

(07) Increases in HPC concentrations above baseline levels are considered undesirable.

(08) There may be a laxative effect in some individuals when sulphate levels exceed 500 mg/L.

(09) Applicable for all waters at the point of consumption.

(10) The Operational Guidelines for filtration processes are provided as performance criteria in the Procedure for Disinfection of Drinking Water in Ontario.

(11) The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

(12) iron concentrations up to up to 5.0 mg/L treatable with water softeners or manganese greensand filters; iron concentrations between 5.0 to 10.0 mg/L treatable by oxidation with filtration through proprietary filter media or chlorination followed by sand or multimedia filtration

(13) requires written rationale that corrosion, encrustation or taste problems will not occur





NOTE


THIS FIGURE IS TO BE READ IN CONJUNCTION WITH THE ACCOMPANYING GOLDER ASSOCIATES LTD. REPORT NO. 10-1122-0129/3000

REFERENCE

DIGITAL BASE MAP DATA SUPPLIED BY DMTI SPATIAL INC. CANMAP, 2008
 PROJECTION: TRANSVERSE MERCATOR DATUM: NAD 83 COORDINATE SYSTEM: MTM ZONE 9



 Ottawa, Ontario	DATE	Nov. 2011	TITLE	<h1 style="text-align: center;">KEY PLAN</h1>
	DESIGN	CAMC		
	GIS	BJ		
PROJECT No.	11-1122-0129	CHECK	CAMC	PROJECT TERRAIN ANALYSIS AND HYDROGEOLOGICAL STUDY 3406-3450 FRANK KENNY ROAD, OTTAWA, ONTARIO
SCALE	AS SHOWN	REV.	0	

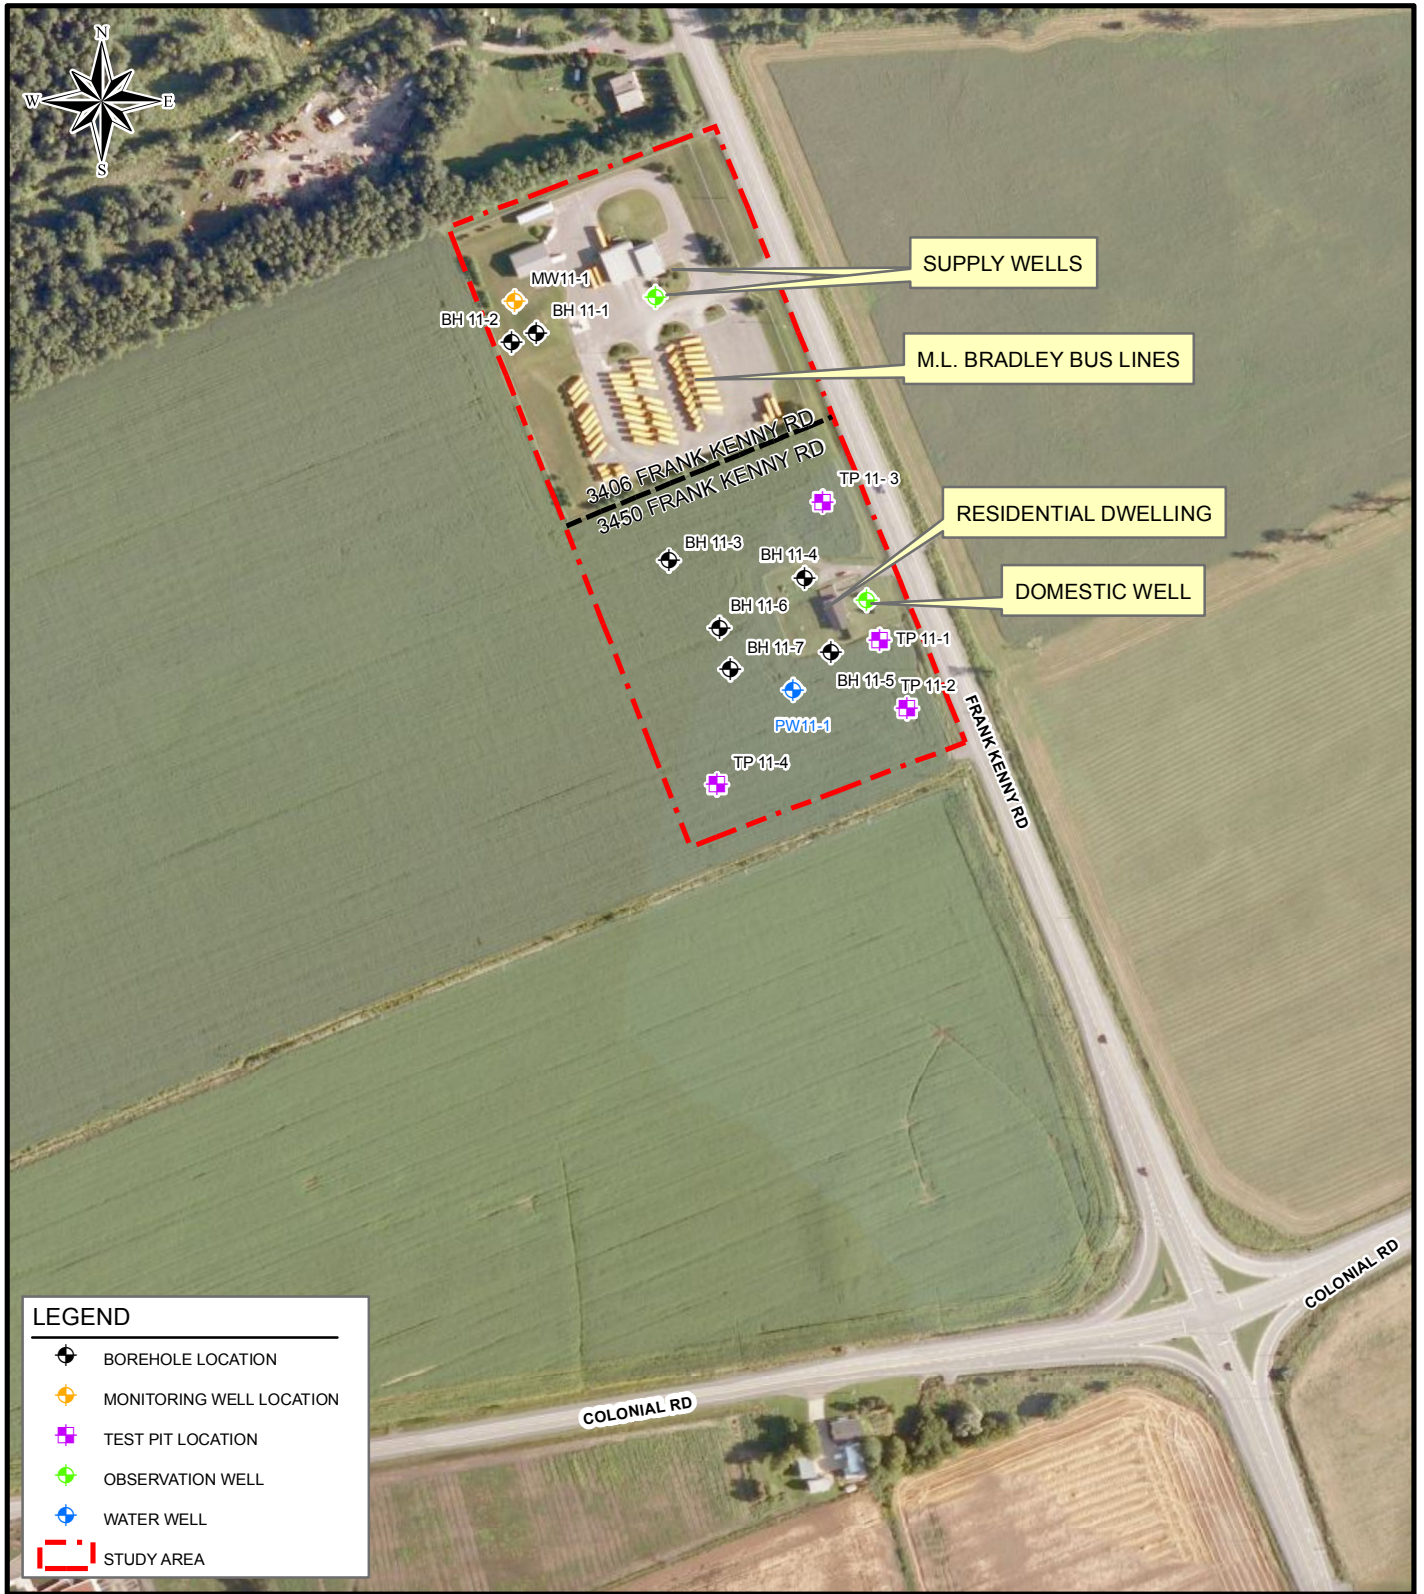

LEGEND


- BOREHOLE LOCATION
- MONITORING WELL LOCATION
- TEST PIT LOCATION
- OBSERVATION WELL
- WATER WELL
- STUDY AREA

NOTE


THIS FIGURE IS TO BE READ IN CONJUNCTION WITH THE ACCOMPANYING GOLDER ASSOCIATES LTD.' REPORT NO. 11-1122-0129/3000

REFERENCE

DIGITAL BASE MAP DATA SUPPLIED BY ESRI CANADA 2011.
 PROJECTION: TRANSVERSE MERCATOR DATUM: NAD 83 COORDINATE SYSTEM: UTM ZONE 18



<p>Golder Associates Ottawa, Ontario</p>	DATE	Nov. 2011	<p>SITE PLAN</p>	
	DESIGN	CAMC		
	GIS	BJ		
PROJECT No.	11-1122-0129	CHECK	CAMC	<p>PROJECT TERRAIN ANALYSIS AND HYDROGEOLOGICAL STUDY 3406-3450 FRANK KENNY ROAD, OTTAWA, ONTARIO</p>
SCALE	AS SHOWN	REV.	0	
		REVIEW	SRW	

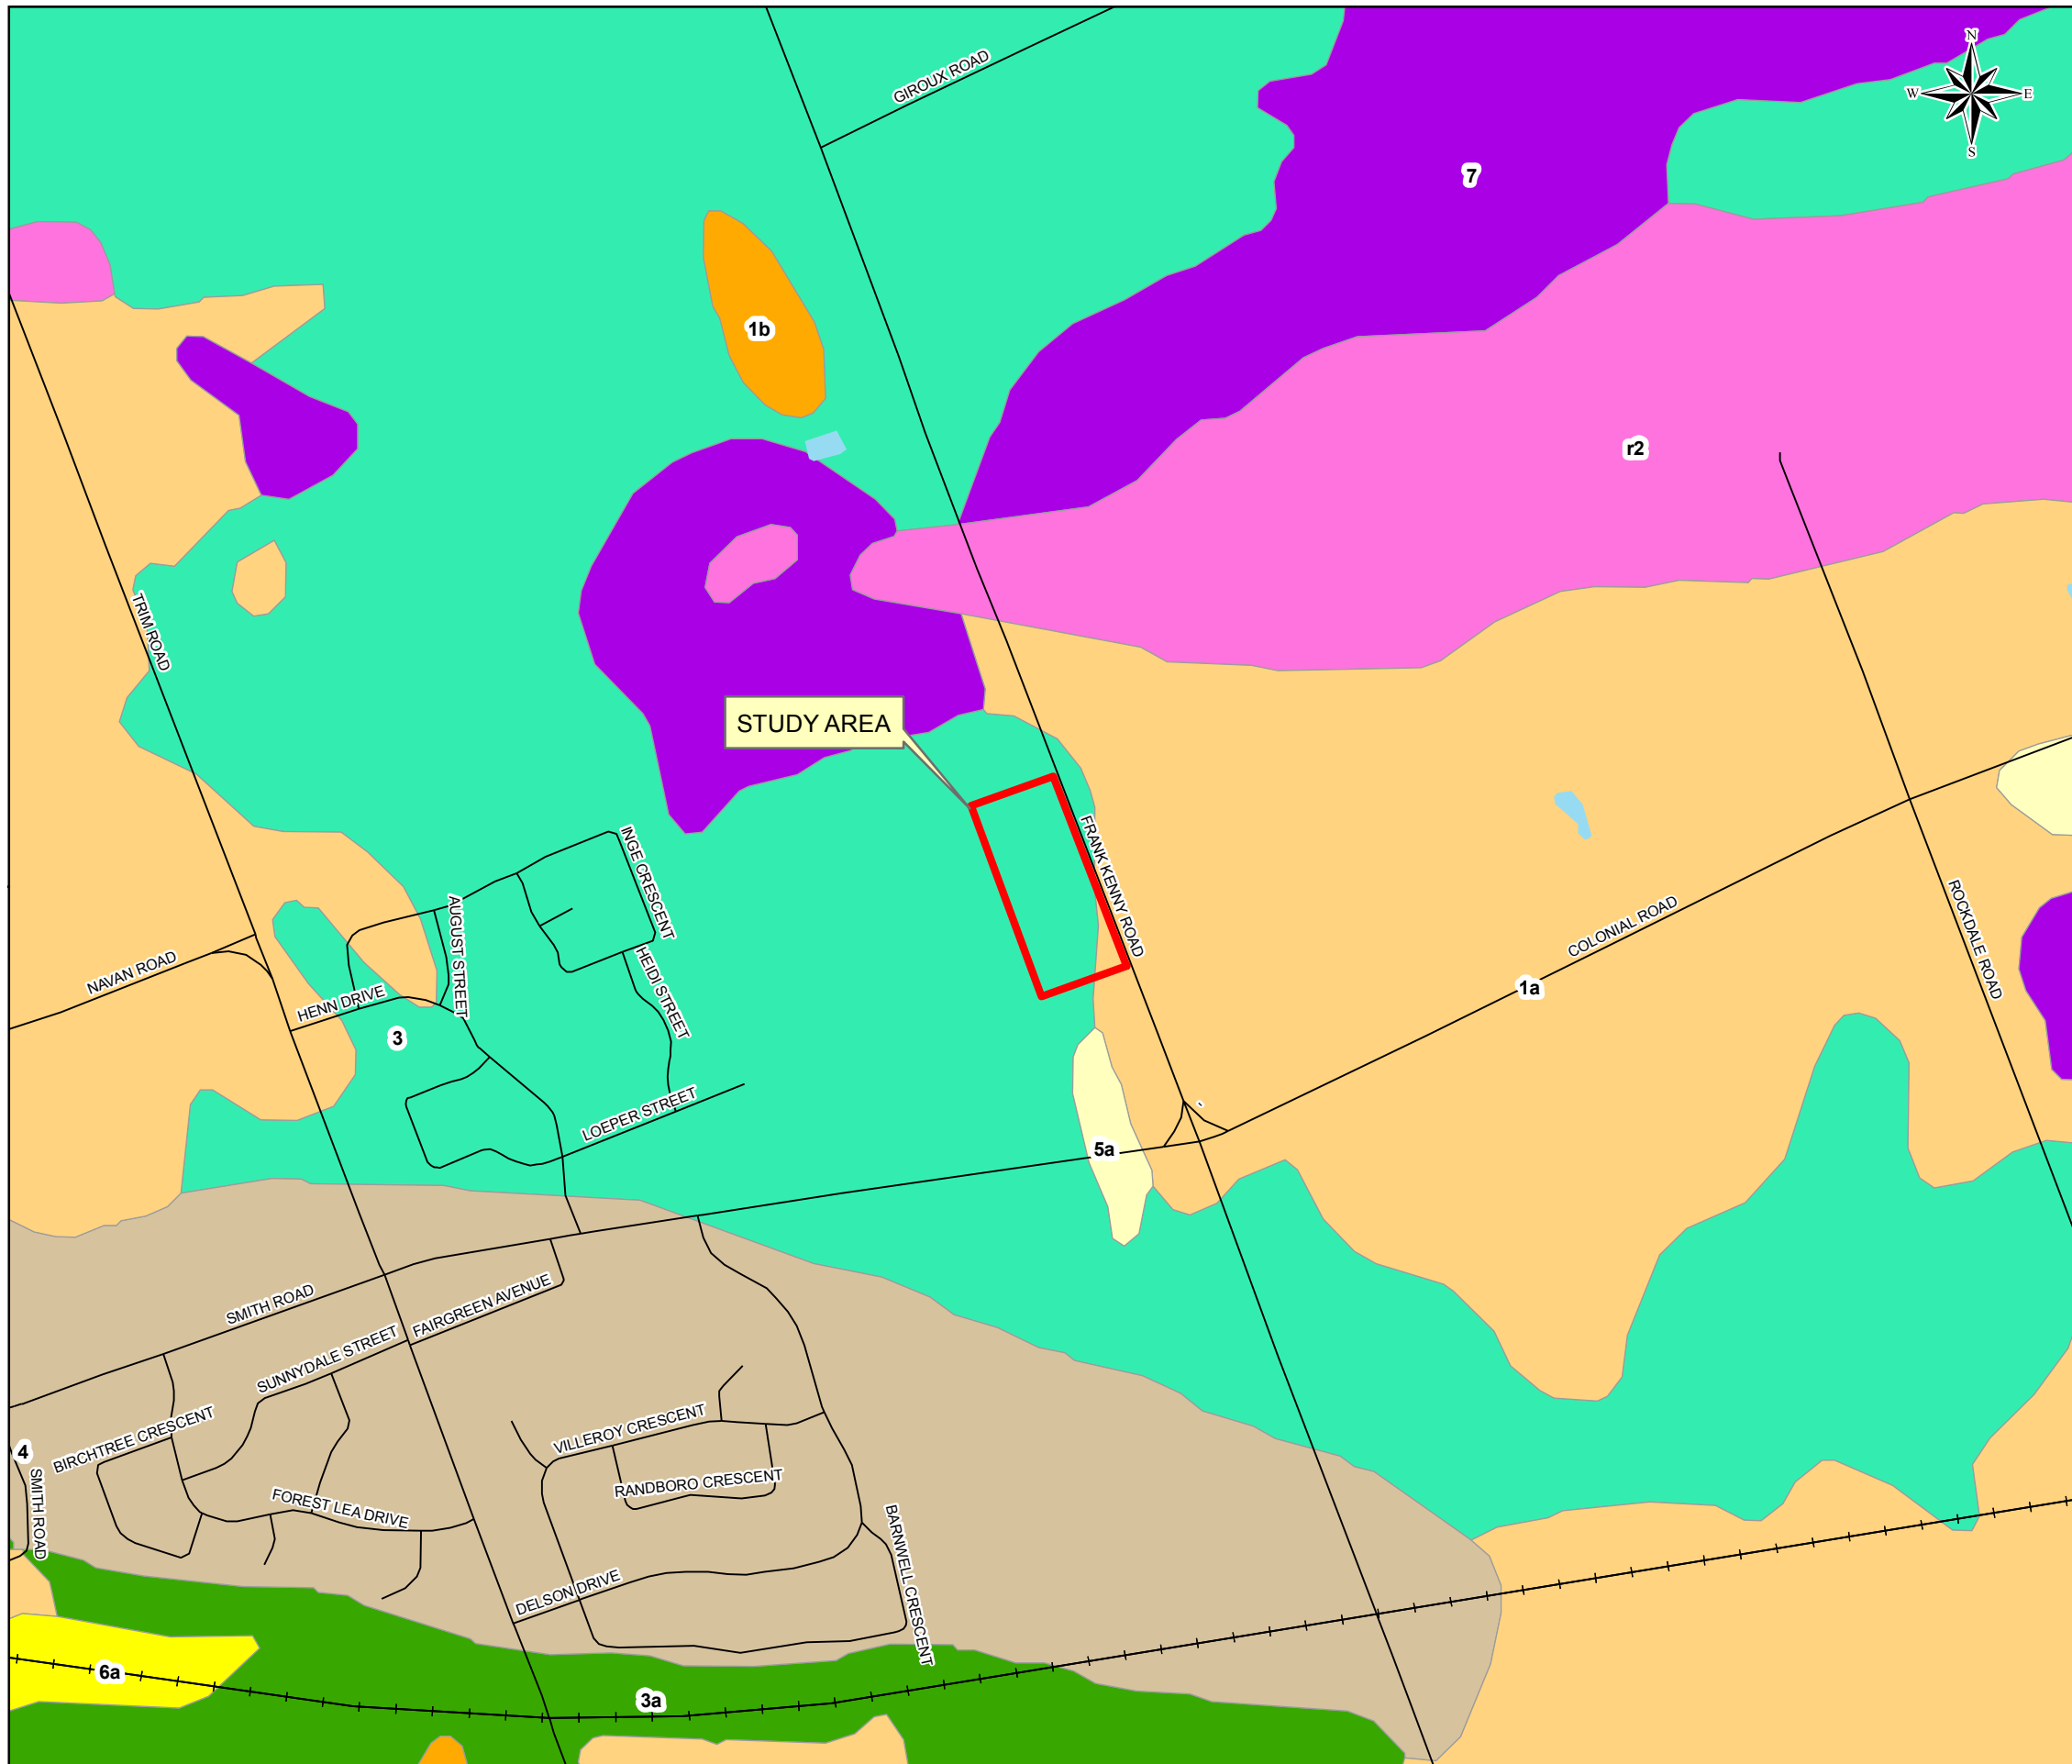


LEGEND

SURFICIAL GEOLOGY

- 1a TILL, PLAIN WITH LOCAL RELIEF <5m
- 1b TILL, DRUMLINIZED
- 1c TILL, HUMMOCKY TO ROLLING WITH LOCAL RELIEF 5 TO 10 m
- 2 ICE CONTACT STRATIFIED DRIFT: GRAVEL & SAND
- 3 OFFSHORE MARINE DEPOSITS: CLAY, SILTY CLAY & SILT
- 3_g OFFSHORE MARINE DEPOSITS: CLAY, SILTY CLAY & SILT (GULLIES & RAVINES)
- 3a OFFSHORE MARINE DEPOSITS: CLAY & SILT UNDERLYING EROSIONAL TERRACES
- 3a_g OFFSHORE MARINE DEPOSITS: CLAY & SILT UNDERLYING EROSIONAL TERRACES (GULLIES & RAVINES)
- 4 DELTAIC AND ESTUARY DEPOSITS: MEDIUM TO FINE GRAINED SAND
- 4_g DELTAIC AND ESTUARY DEPOSITS: MEDIUM TO FINE GRAINED SAND (GULLIES & RAVINES)
- 5a NEARSHORE SEDIMENTS: GRAVEL, SAND & BOULDERS
- 5b NEARSHORE SEDIMENTS: FINE TO MEDIUM GRAINED SAND
- 6a ALLUVIAL DEPOSITS: SILTY SAND, SILT, SAND & CLAY
- 6a_g ALLUVIAL DEPOSITS: SILTY SAND, SILT, SAND & CLAY (GULLIES & RAVINES)
- 6b ALLUVIAL DEPOSITS: MEDIUM GRAINED STRATIFIED SAND WITH SOME SILT
- 6b_g ALLUVIAL DEPOSITS: MEDIUM GRAINED STRATIFIED SAND WITH SOME SILT (GULLIES & RAVINES)
- 7 ORGANIC DEPOSITS: MUCK & PEAT
- d DUNE
- d_g DUNE (GULLIES & RAVINES)
- l LANDSLIDE AREA
- l_g LANDSLIDE AREA (GULLIES & RAVINES)
- r1 BEDROCK: INTRUSIVE & METAMORPHIC
- r2 BEDROCK: LIMESTONE, DOLOMITE, SANDSTONE & LOCAL SHALE
- r2_g BEDROCK: LIMESTONE, DOLOMITE, SANDSTONE & LOCAL SHALE (GULLIES & RAVINES)
- zz WATER


NOTE
 THIS FIGURE IS TO BE READ IN CONJUNCTION WITH THE ACCOMPANYING GOLDER ASSOCIATES LTD. REPORT No. 11-1122-0129/3000

REFERENCE
 BÉLANGER, J. R., URBAN GEOLOGY OF THE NATIONAL CAPITAL AREA, GEOLOGICAL SURVEY OF CANADA, OPEN FILE D3256, 2001
 PROJECTION: TRANSVERSE MERCATOR DATUM: NAD 83
 COORDINATE SYSTEM: UTM ZONE 18



PROJECT			
TERRAIN ANALYSIS AND HYDROGEOLOGICAL STUDY 3406-3450 FRANK KENNY ROAD, OTTAWA, ONTARIO			
TITLE			
SURFICIAL GEOLOGY			
	PROJECT No.	11-122-0129	SCALE AS SHOWN
	DESIGN	CAMC	Nov. 2011
	GIS	BJ	Nov. 2011
	CHECK	CAMC	Nov. 2011
	REVIEW	SRW	Nov. 2011
FIGURE 3			REV. 0

Path: N:\Active\2011\1122-0129 Hydro One Frank Kenny Road\Spatial_11-1122-0129 Hydro One Frank Kenny Road\Spatial_11-1122-0129-3000-04.mxd

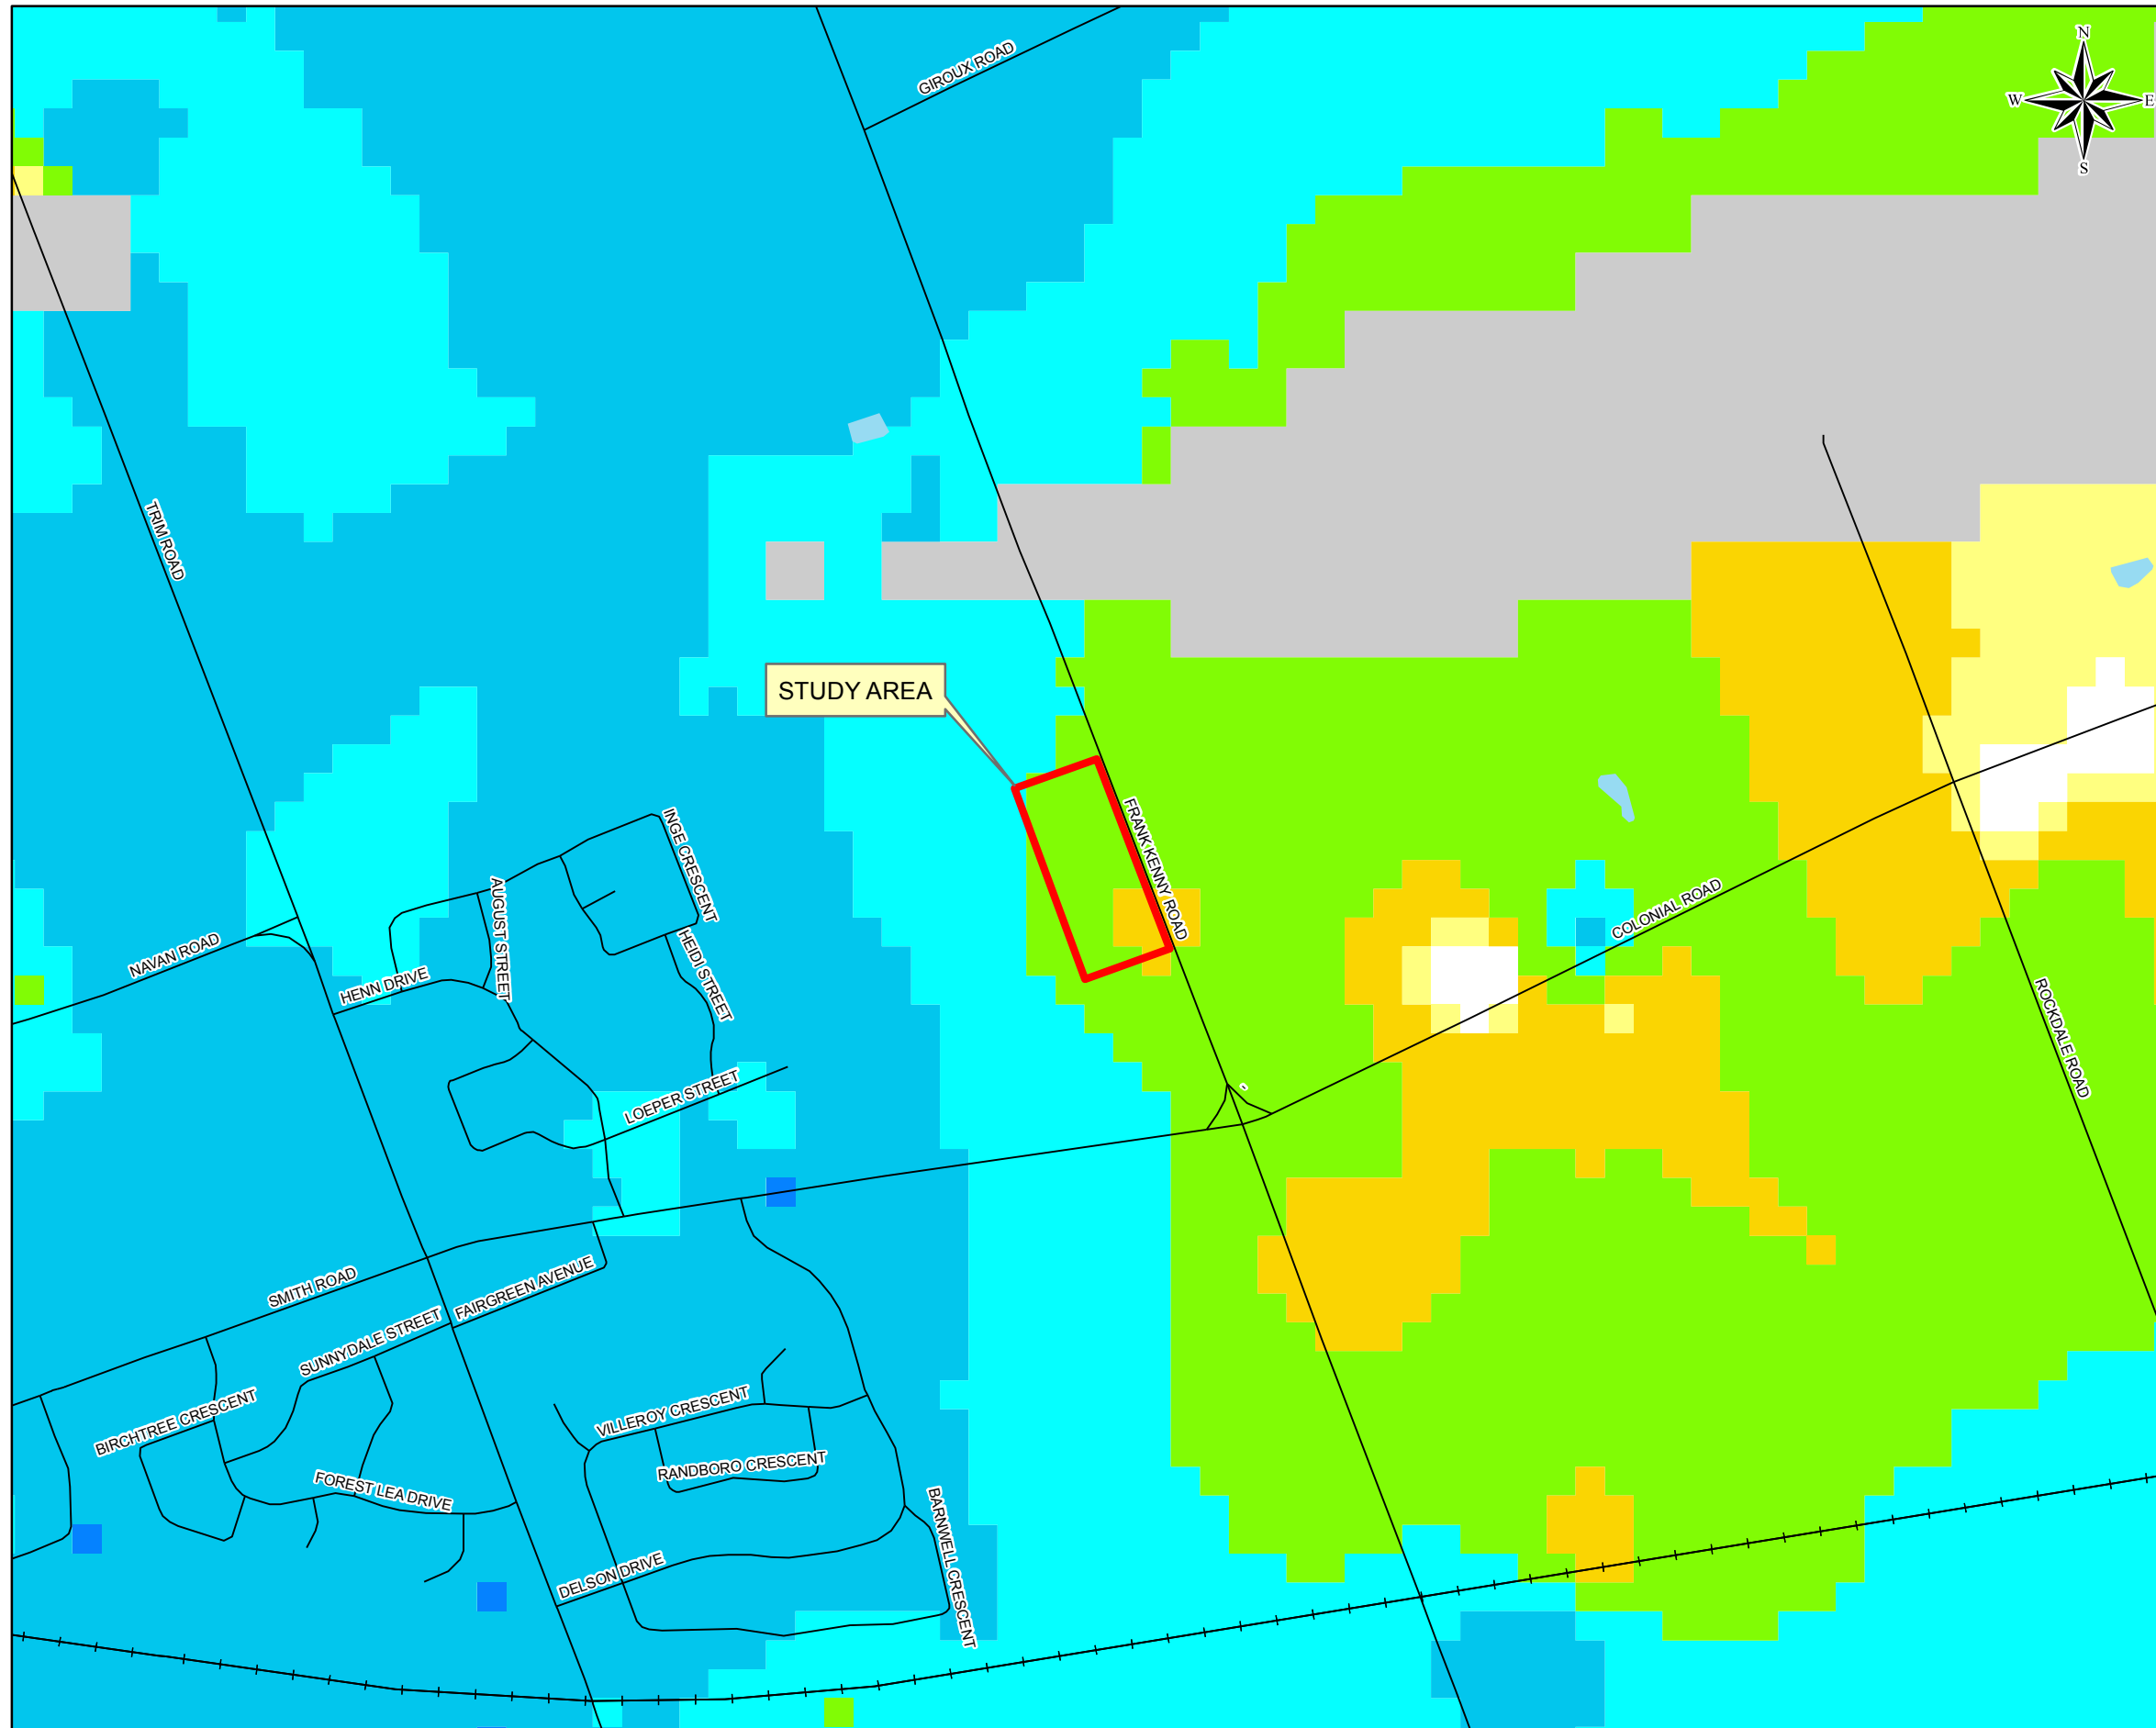

LEGEND

- STUDY AREA
- RAILWAY
- ROAD
- WATERBODY

TREND IN DEPTH TO BEDROCK (METRES)


- 0 to 1
- 1 to 2
- 2 to 3
- 3 to 5
- 5 to 10
- 10 to 15
- 15 to 25
- 25 to 50
- 50 to 100
- 100 to 200

NOTE

THIS FIGURE IS TO BE READ IN CONJUNCTION WITH THE ACCOMPANYING GOLDER ASSOCIATED LIMITED REPORT No. 11-1122-0129/3000

REFERENCE


BASE DATA - CANVEC PROVIDED BY HER MAJESTY THE QUEEN IN RIGHT OF CANADA, DEPARTMENT OF NATURAL RESOURCES, 2010
 BÉLANGER, J. R., URBAN GEOLOGY OF THE NATIONAL CAPITAL AREA, GEOLOGICAL SURVEY OF CANADA, OPEN FILE D3256, 2001
 PROJECTION: TRANSVERSE MERCATOR DATUM: NAD 83 COORDINATE SYSTEM: UTM ZONE 18



PROJECT			
TERRAIN ANALYSIS AND HYDROGEOLOGICAL STUDY 3406-3450 FRANK KENNY ROAD, OTTAWA, ONTARIO			
TITLE			
TREND IN DEPTH TO BEDROCK			
PROJECT No. 11-1122-0129		SCALE AS SHOWN	REV. 0.0
DESIGN	CAMC	Nov. 2011	FIGURE 4
GIS	BJ	Nov. 2011	
CHECK	CAMC	Nov. 2011	
REVIEW	SRW	Nov. 2011	



Path: N:\Active\2011\1122 - Contaminated Lands\11-1122-0129 Hydro One Frank Kenny Road\Spatial\IMMXD\Phase 3000\111220129-3000-05.mxd

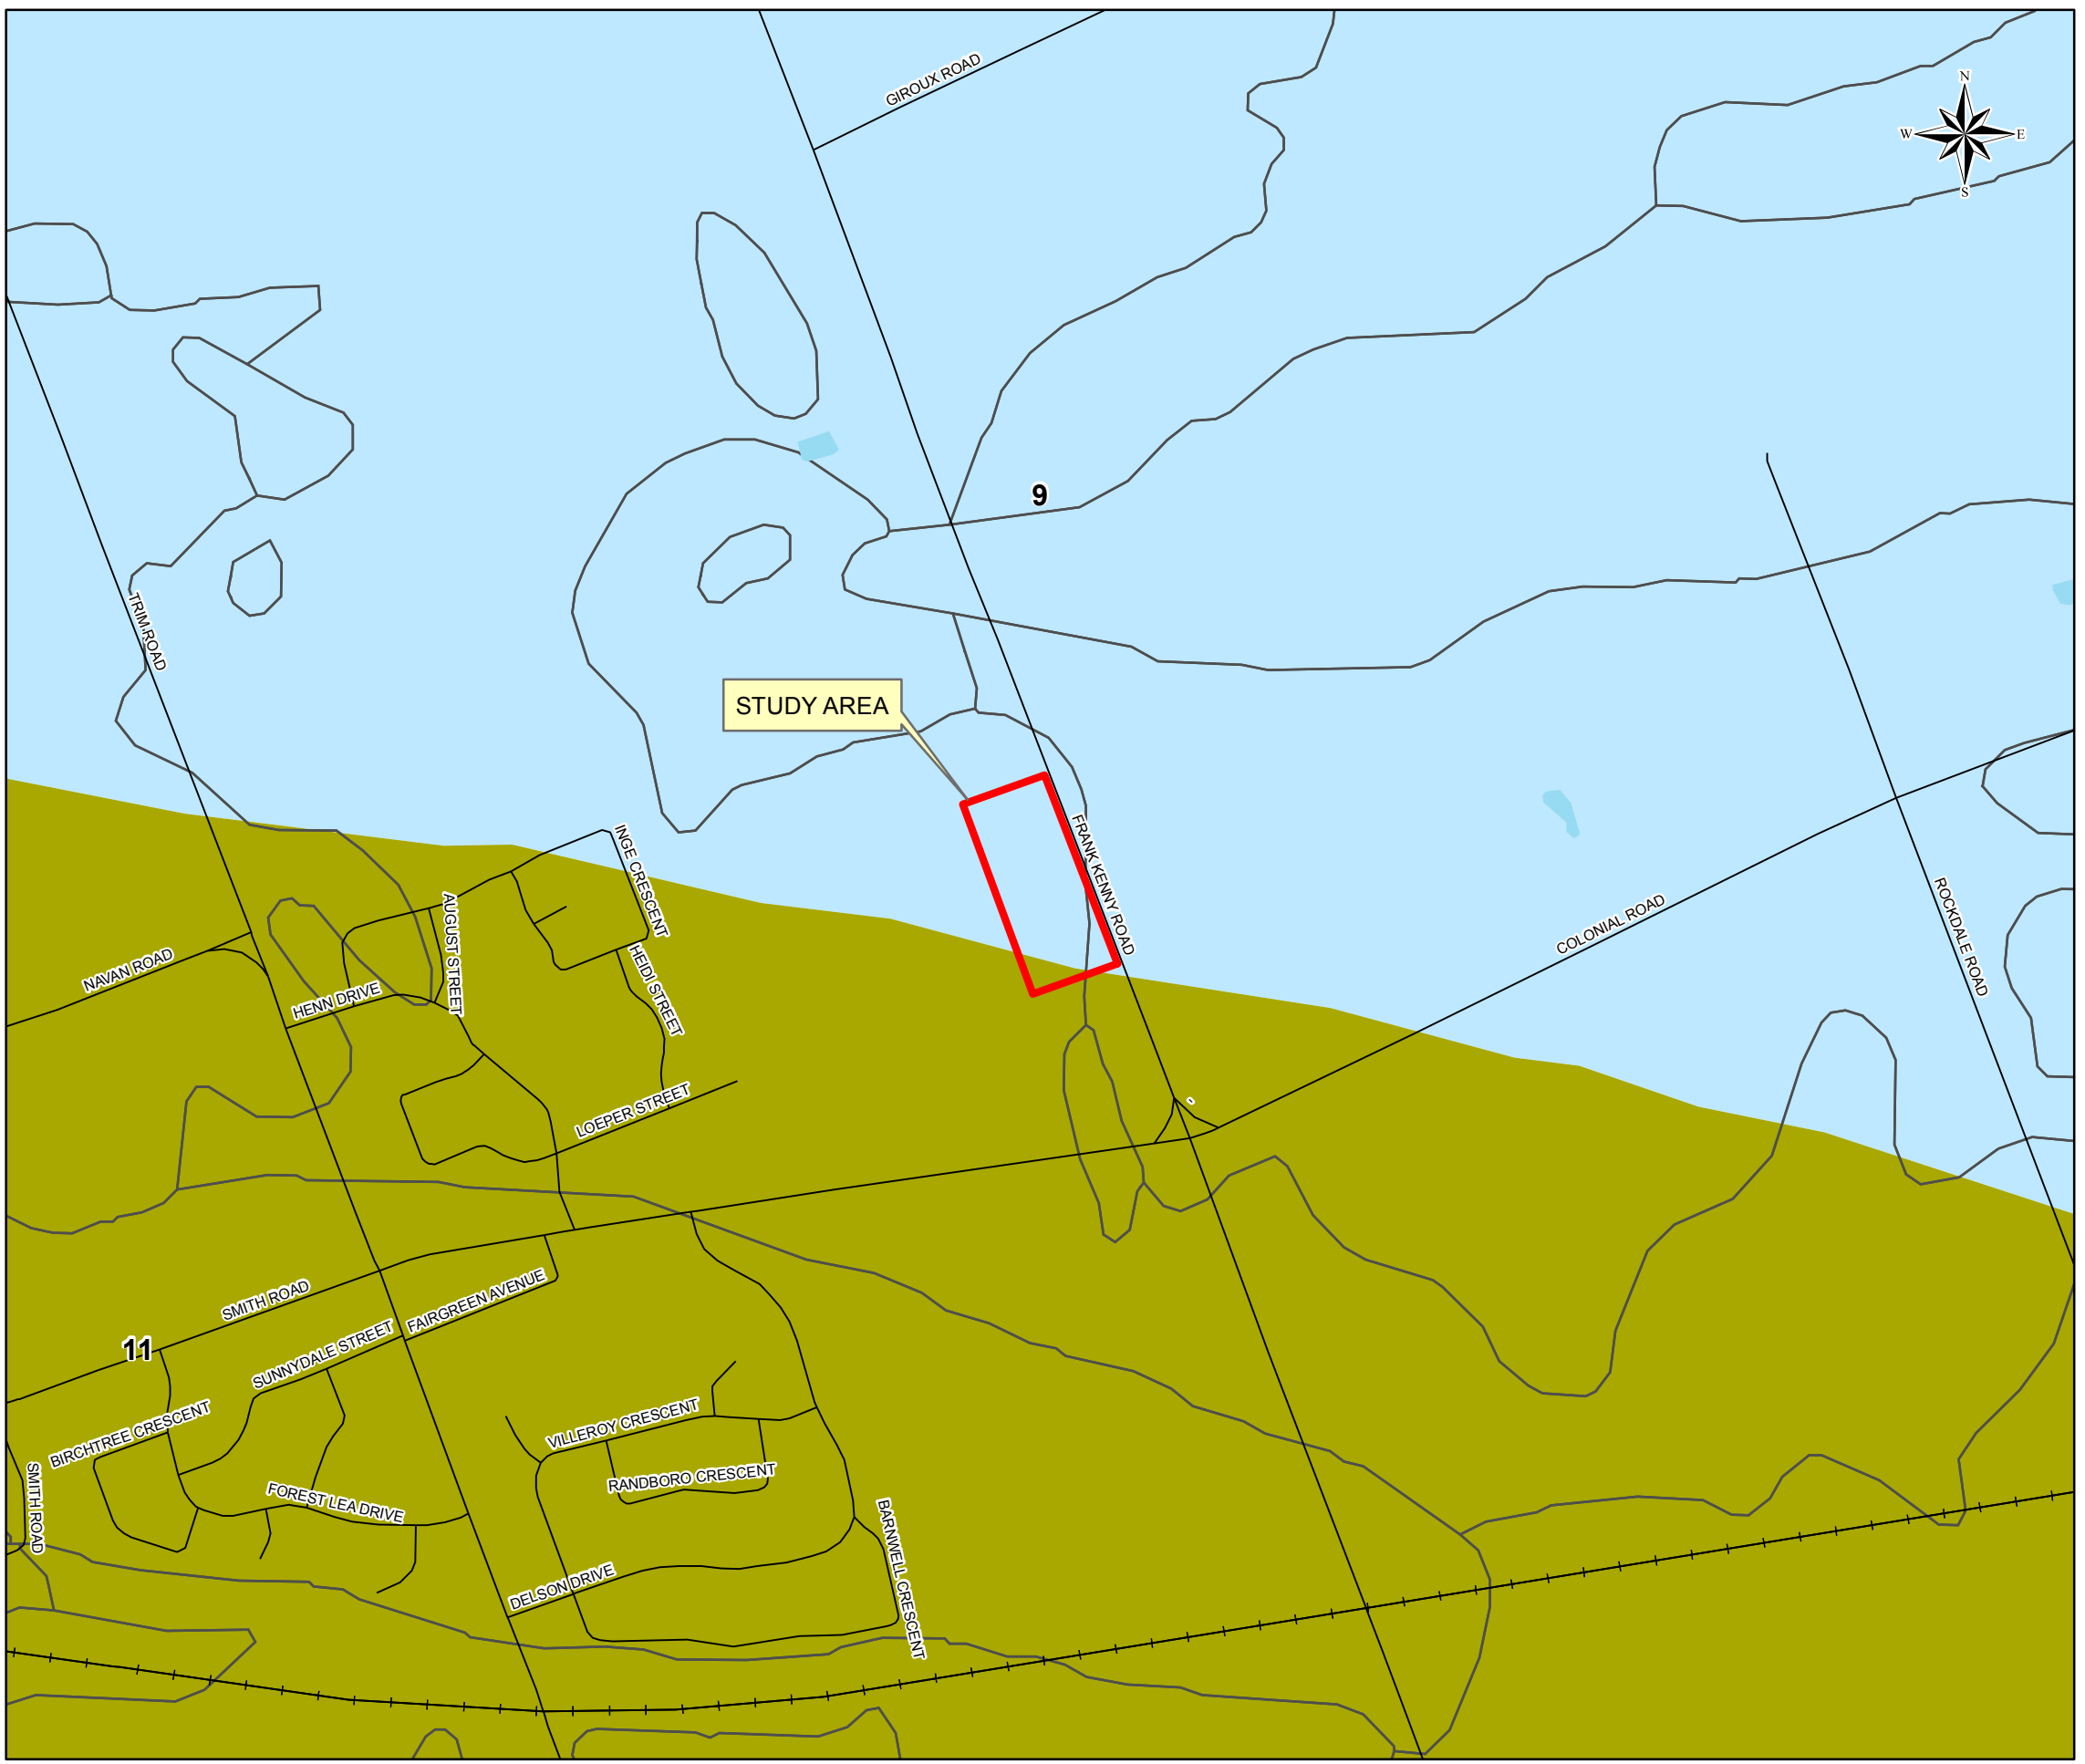

LEGEND


- 13 QUEENSTON FORMATION: RED TO LIGHT GREENISH GRAY SILTSTONE AND SHALE, WITH INTERBEDS OF SILTY BIOCLASTIC LIMESTONE IN LOWER PART
- 12 CARLSBAD FORMATION: INTERBEDDED DARK GRAY SHALE, FOSSILIFEROUS CALCAREOUS SILTSTONE, AND SILTY BIOCLASTIC LIMESTONE
- 11 BILLINGS FORMATION: DARK BROWN TO BLACK SHALE, WITH LAMINATIONS OF CALCAREOUS SILTSTONE
- 10 EASTVIEW FORMATION: INTERBEDDED SUBLITHOGRAPHIC TO FINE CRYSTALLINE LIMESTONE AND DARK BROWN TO DARK GREY SHALE
- MIDDLE TO UPPER ORDOVICIAN**
- 9 LINDSAY FORMATION: SUBLITHOGRAPHIC TO FINE CRYSTALLINE LIMESTONE, NODULAR IN PART, WITH INTERBEDS OF CALCARENITE AND SHALE
- 8 VERULAM FORMATION: INTERBEDDED BIOCLASTIC LIMESTONE, SUBLITHOGRAPHIC TO FINE CRYSTALLINE LIMESTONE
- 7 BOBCAYGEON FORMATION: INTERBEDDED SILTY DOLOMITE, LITHOGRAPHIC TO FINE CRYSTALLINE LIMESTONE, OOLITIC LIMESTONE, SHALE, AND FINE-GRAINED CALCAREOUS QUARTZ SANDSTONE
- 6 GULL RIVER FORMATION: INTERBEDDED SILTY DOLOMITE, LITHOGRAPHIC TO FINE CRYSTALLINE LIMESTONE, OOLITIC LIMESTONE, SHALE, AND FINE-GRAINED CALCAREOUS QUARTZ SANDSTONE
- 5 ROCKCLIFFE FORMATION: INTERBEDDED FINE-GRAINED LIGHT GREENISH GREY QUARTZ SANDSTONE, SHALEY LIMESTONE AND SHALE. LOCALLY CONGLOMERATE AT BASE, INTERBEDS OF CALCARENITE (ST. MARTIN MEMBER, 5A) AND SILTY DOLOSTONE IN UPPER PART
- LOWER ORDOVICIAN**
- 4 OXFORD FORMATION: SUBLITHOGRAPHIC TO FINE CRYSTALLINE DOLOSTONE
- 4* ALTERED FROM PUBLISHED MAPPING
- 3 MARCH FORMATION: INTERBEDDED QUARTZ SANDSTONE, SANDY DOLOSTONE, AND DOLOSTONE
- CAMBRIO ORDOVICIAN**
- 2 NEPEAN FORMATION: FINE TO COARSE GRAINED QUARTZ SANDSTONE, PARTIALLY CALCAREOUS IN UPPER PART
- 1 COVEY HILL FORMATION: NONCALCAREOUS FELDSPATHIC, FINE TO COARSE GRAINED QUARTZ SANDSTONE AND QUARTZ PEBBLE CONGLOMERATE
- UNCONFORMITY**
- PRECAMBRIAN**
- PC UNDIFFERENTIATED METAMORPHIC AND IGNEOUS ROCKS

NOTE

THIS FIGURE IS TO BE READ IN CONJUNCTION WITH THE ACCOMPANYING GOLDER ASSOCIATES LTD. REPORT No. 11-1122-0129/3000

REFERENCE

BÉLANGER, J. R., URBAN GEOLOGY OF THE NATIONAL CAPITAL AREA, GEOLOGICAL SURVEY OF CANADA, OPEN FILE D3256, 2001
 PROJECTION: TRANSVERSE MERCATOR DATUM: NAD 83
 COORDINATE SYSTEM: UTM ZONE 18




PROJECT
 TERRAIN ANALYSIS AND HYDROGEOLOGICAL STUDY
 3406-3450 FRANK KENNY ROAD, OTTAWA, ONTARIO

TITLE
BEDROCK GEOLOGY

 Golder Associates Ottawa, Ontario	PROJECT No. 11-1122-0129	SCALE AS SHOWN	REV. 0
	DESIGN CAMC Nov. 2011		
	CIS BJ Nov. 2011		
	CHECK CAMC Nov. 2011		
	REVIEW SRW Nov. 2011		


FIGURE 5

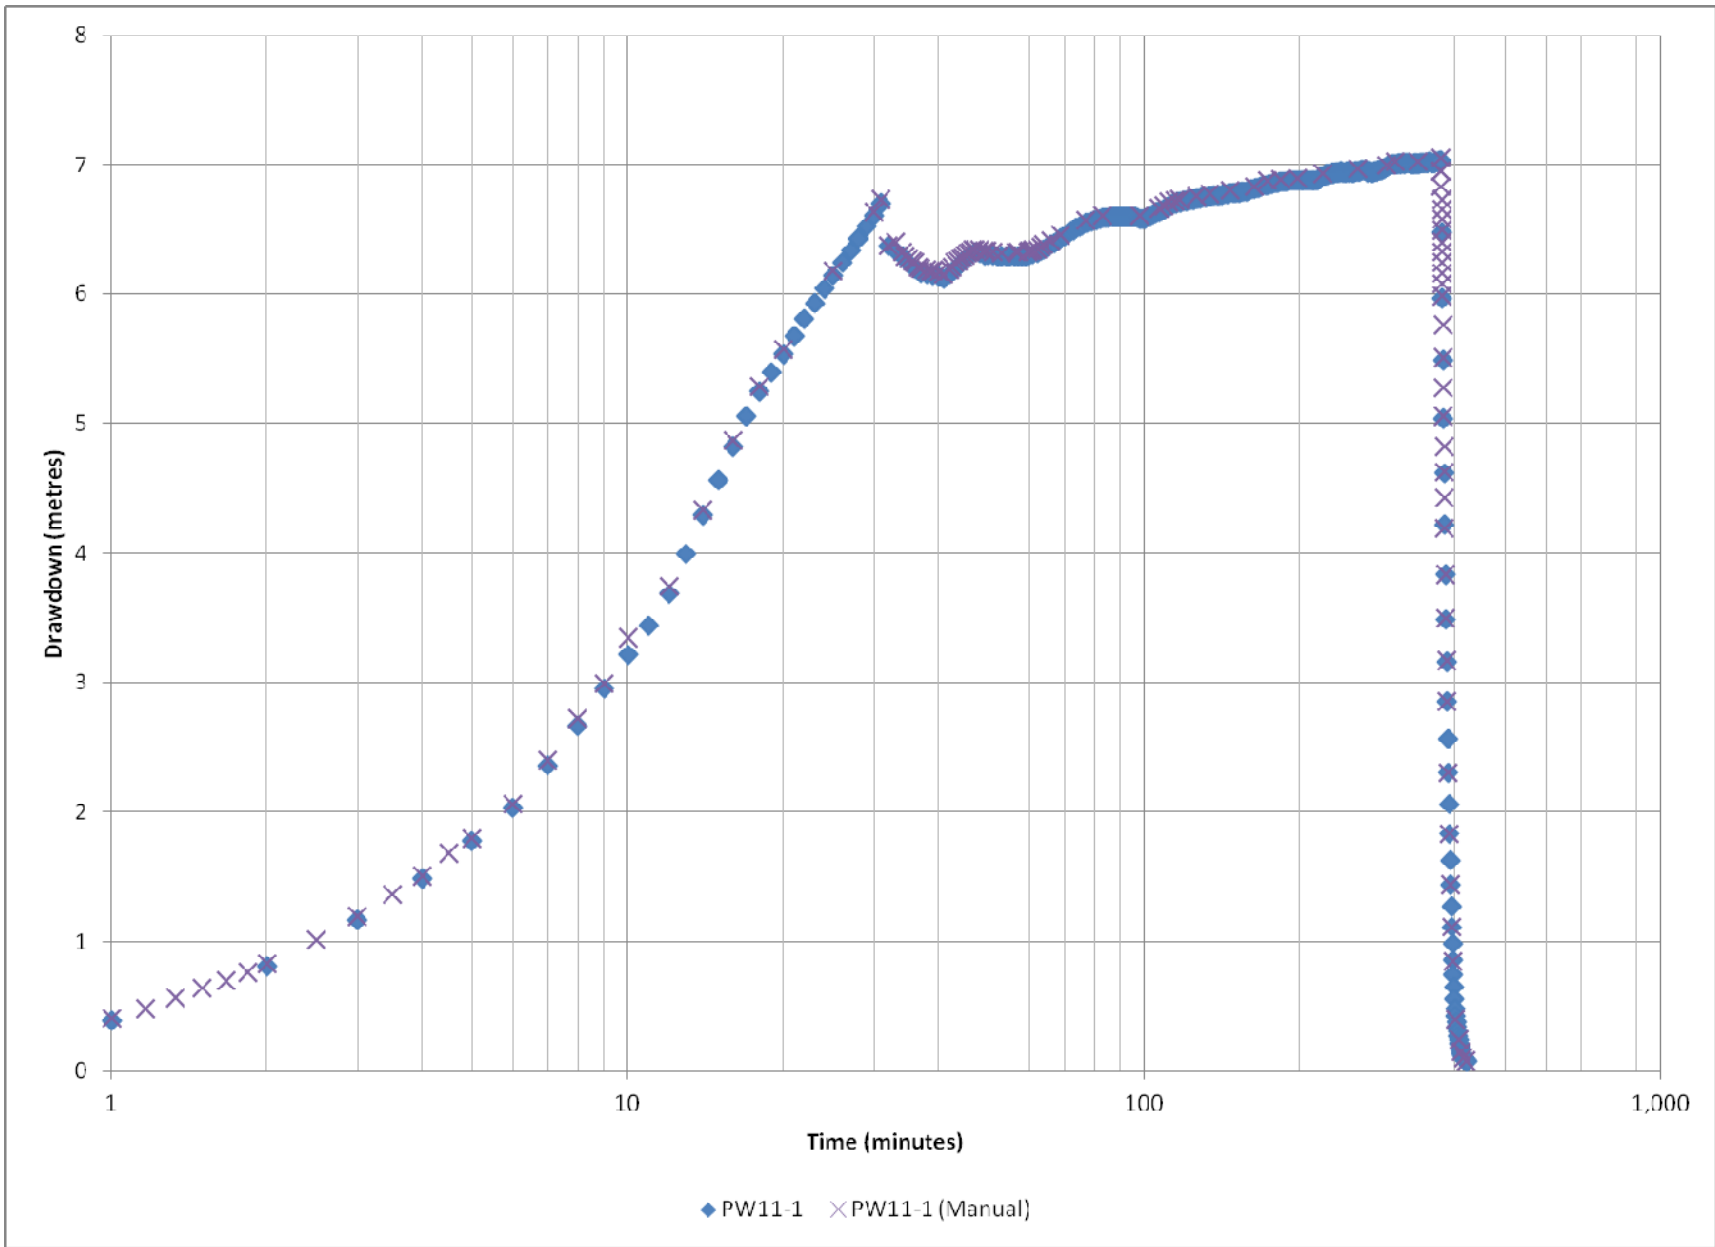

Date: November 2011 Drawn: DH
 Project: 11-1122-0129 Chkd: CAMC

GROUNDWATER LEVEL DRAWDOWN
 PW11-1

FIGURE 6

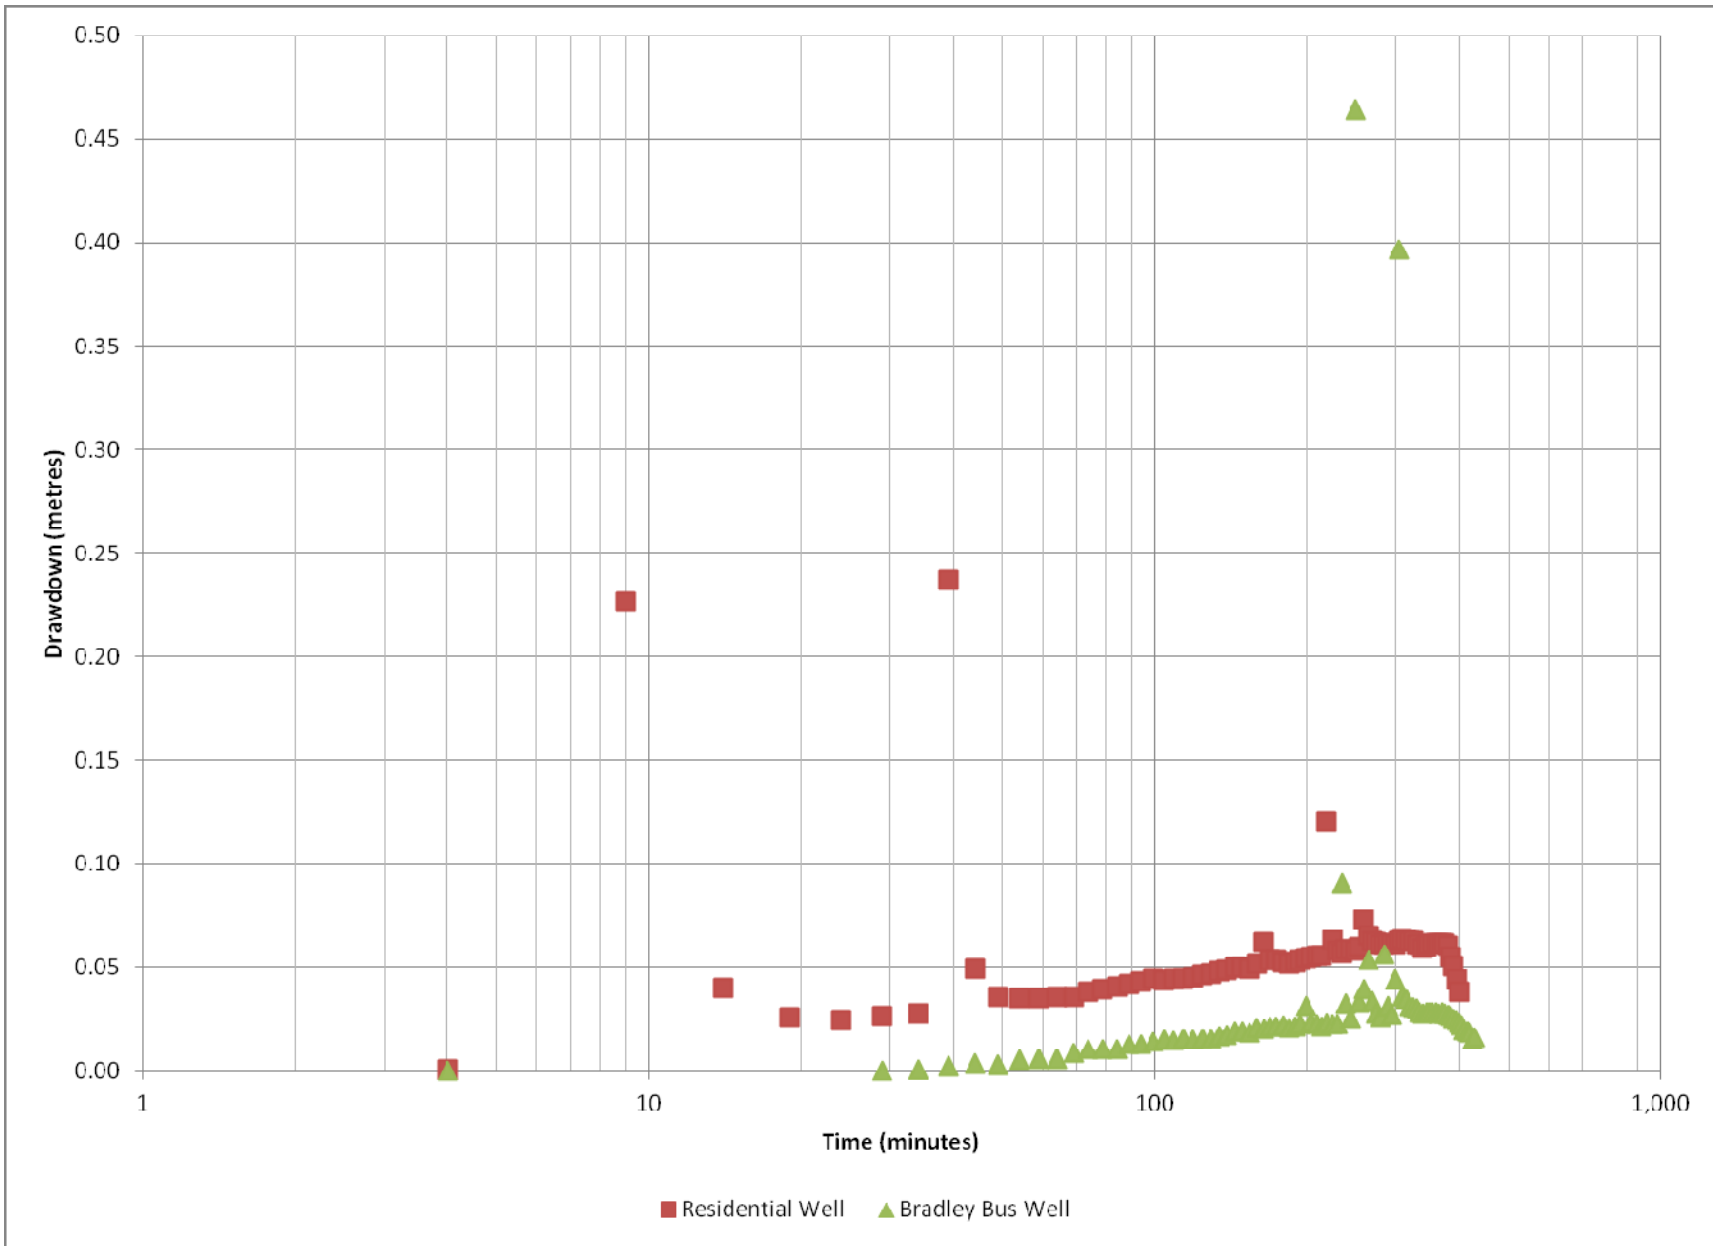

Date: November 2011 Drawn: DH
 Project: 11-1122-0129 Chkd: CAMC

GROUNDWATER LEVEL DRAWDOWN
 BRADLEY BUS WELL AND RESIDENTIAL WELL

FIGURE 7



APPENDIX A

Water Well Record, Bradley Bus Well



The Ontario Water Resources Act
WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED
2. CHECK CORRECT BOX WHERE APPLICABLE

COUNTY OR DISTRICT OTTAWA-CARLETON	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE CUMBERLAND	CON. BLOCK, TRACT, SURVEY ETC. PART 9 + 10 CON. 2	DATE COMPLETED DAY 9 MO 1 YR 91
OWNER (SURNAME FIRST) BRADLEY BUS LINE	ADDRESS		

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)					
GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
BROWN	CLAY			0	19
BLACK	HARD PAN	BOULDERS		19	31
BLACK	SILT			31	41


WATER RECORD	
WATER FOUND AT - FEET	KIND OF WATER
39	<input checked="" type="checkbox"/> FRESH <input type="checkbox"/> SALTY <input type="checkbox"/> SULPHUR <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SALTY <input type="checkbox"/> SULPHUR <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SALTY <input type="checkbox"/> SULPHUR <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SALTY <input type="checkbox"/> SULPHUR <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS

CASING & OPEN HOLE RECORD				
INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	<input checked="" type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC	1.85	0	31
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			

SCREEN	SIZE(S) OF OPENING (SLOT NO.)	DIAMETER	LENGTH
		INCHES	FEET
	MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN
			FEET

PLUGGING & SEALING RECORD			
DEPTH SET AT - FEET		MATERIAL AND TYPE	CEMENT GROUT LEAD PACKED ETC.
FROM	TO		
4	20	CEMENT GROUT	

PUMPING TEST	PUMPING TEST METHOD <input type="checkbox"/> PUMP <input checked="" type="checkbox"/> BAILER	PUMPING RATE 19 GPM	DURATION OF PUMPING 1 HOURS 20 MIN
	STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING
	7 FEET	28 FEET	<input checked="" type="checkbox"/> PUMPING <input type="checkbox"/> RECOVERY
			15 MINUTES: 25 FEET 30 MINUTES: 28 FEET 45 MINUTES: 28 FEET 60 MINUTES: 28 FEET
	IF FLOWING, GIVE RATE	PUMP INTAKE SET AT	WATER AT END OF TEST
		35 FEET	<input type="checkbox"/> CLEAR <input checked="" type="checkbox"/> CLOUDY
RECOMMENDED PUMP TYPE <input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP	RECOMMENDED PUMP SETTING 35 FEET	RECOMMENDED PUMPING RATE 10 GPM	

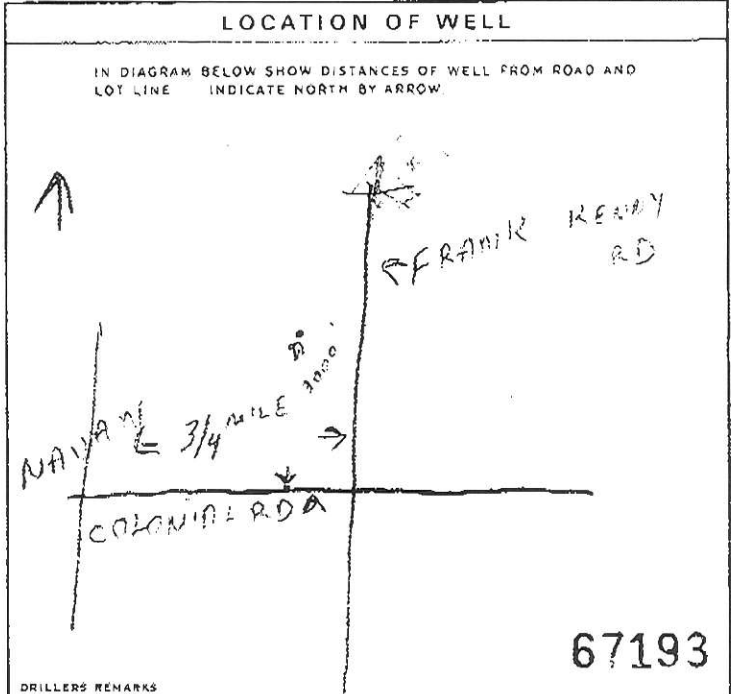

FINAL STATUS OF WELL	<input checked="" type="checkbox"/> WATER SUPPLY <input type="checkbox"/> OBSERVATION WELL <input type="checkbox"/> TEST HOLE <input type="checkbox"/> RECHARGE WELL <input type="checkbox"/> ABANDONED - INSUFFICIENT SUPPLY <input type="checkbox"/> ABANDONED - POOR QUALITY <input type="checkbox"/> UNFINISHED <input type="checkbox"/> DEWATERING
WATER USE	<input type="checkbox"/> DOMESTIC <input type="checkbox"/> STOCK <input type="checkbox"/> IRRIGATION <input type="checkbox"/> INDUSTRIAL <input type="checkbox"/> OTHER <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> MUNICIPAL <input type="checkbox"/> PUBLIC SUPPLY <input type="checkbox"/> COOLING OR AIR CONDITIONING <input type="checkbox"/> NOT USED
METHOD OF CONSTRUCTION	<input checked="" type="checkbox"/> CABLE TOOL <input type="checkbox"/> ROTARY (CONVENTIONAL) <input type="checkbox"/> ROTARY (REVERSE) <input type="checkbox"/> ROTARY (AIR) <input type="checkbox"/> AIR PERCUSSION <input type="checkbox"/> BORING <input type="checkbox"/> DIAMOND <input type="checkbox"/> JETTING <input type="checkbox"/> DRIVING <input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER

CONTRACTOR	NAME OF WELL CONTRACTOR FRANKER WELL DRILLING	WELL CONTRACTOR'S LICENCE NUMBER 2351
	ADDRESS	
	NAME OF WELL TECHNICIAN BOY A.T. CASSELLMAN	WELL TECHNICIAN'S LICENCE NUMBER 7-0389
	SIGNATURE OF TECHNICIAN/CONTRACTOR <i>[Signature]</i>	ISSUANCE DATE DAY 9 MO 1 YR 91

OFFICE USE ONLY	

OWNER'S COPY **764-5710**



APPENDIX B

Records of Boreholes BH11-3, BH11-4, BH11-5, BH11-6 and
BH11-7 and Test Pits TP11-1, TP11-2, TP11-3 and TP11-4

LIST OF ABBREVIATIONS

The abbreviations commonly employed on Records of Boreholes, on figures and in the text of the report are as follows:

I. SAMPLE TYPE		III. SOIL DESCRIPTION	
AS Auger sample		(a)	Cohesionless Soils
BS Block sample			
CS Chunk sample		Density Index	N
DO Drive open		(Relative Density)	<u>Blows/300 mm</u>
DS Denison type sample			<u>Or Blows/ft.</u>
FS Foil sample		Very loose	0 to 4
RC Rock core		Loose	4 to 10
SC Soil core		Compact	10 to 30
ST Slotted tube		Dense	30 to 50
TO Thin-walled, open		Very dense	over 50
TP Thin-walled, piston			
WS Wash sample		(b)	Cohesive Soils
DT Dual Tube sample		Consistency	C_u or S_u
II. PENETRATION RESISTANCE			
Standard Penetration Resistance (SPT), N:		<u>Kpa</u>	<u>Psf</u>
The number of blows by a 63.5 kg. (140 lb.)	Very soft	0 to 12	0 to 250
hammer dropped 760 mm (30 in.) required	Soft	12 to 25	250 to 500
to drive a 50 mm (2 in.) drive open	Firm	25 to 50	500 to 1,000
Sampler for a distance of 300 mm (12 in.)	Stiff	50 to 100	1,000 to 2,000
DD- Diamond Drilling	Very stiff	100 to 200	2,000 to 4,000
	Hard	Over 200	Over 4,000
Dynamic Penetration Resistance; N_d:	IV. SOIL TESTS		
The number of blows by a 63.5 kg (140 lb.)	w	water content	
hammer dropped 760 mm (30 in.) to drive	w _p	plastic limited	
Uncased a 50 mm (2 in.) diameter, 60° cone	w _l	liquid limit	
attached to "A" size drill rods for a distance	C	consolidation (oedometer) test	
of 300 mm (12 in.).	CHEM	chemical analysis (refer to text)	
	CID	consolidated isotropically drained triaxial test ¹	
PH: Sampler advanced by hydraulic pressure	CIU	consolidated isotropically undrained triaxial test	
PM: Sampler advanced by manual pressure		with porewater pressure measurement ¹	
WH: Sampler advanced by static weight of hammer	D _R	relative density (specific gravity, G _s)	
WR: Sampler advanced by weight of sampler and rod	DS	direct shear test	
	M	sieve analysis for particle size	
Peizo-Cone Penetration Test (CPT):	MH	combined sieve and hydrometer (H) analysis	
An electronic cone penetrometer with	MPC	modified Proctor compaction test	
a 60° conical tip and a projected end area	SPC	standard Proctor compaction test	
of 10 cm ² pushed through ground	OC	organic content test	
at a penetration rate of 2 cm/s. Measurements	SO ₄	concentration of water-soluble sulphates	
of tip resistance (Q _t), porewater pressure	UC	unconfined compression test	
(PWP) and friction along a sleeve are recorded	UU	unconsolidated undrained triaxial test	
Electronically at 25 mm penetration intervals.	V	field vane test (LV-laboratory vane test)	
	γ	unit weight	

Note:

1. Tests which are anisotropically consolidated prior shear are shown as CAD, CAU.

LIST OF SYMBOLS

Unless otherwise stated, the symbols employed in the report are as follows:

I. GENERAL

π	= 3.1416
$\ln x$	natural logarithm of x
$\log_{10} x$ or $\log x$	logarithm of x to base 10
g	Acceleration due to gravity
t	time
F	factor of safety
V	volume
W	weight

II. STRESS AND STRAIN

γ	shear strain
Δ	change in, e.g. in stress: $\Delta \sigma'$
ε	linear strain
ε_v	volumetric strain
η	coefficient of viscosity
ν	Poisson's ratio
σ	total stress
σ'	effective stress ($\sigma' = \sigma - u$)
σ'_{vo}	initial effective overburden stress
$\sigma_1 \sigma_2 \sigma_3$	principal stresses (major, intermediate, minor)
σ_{oct}	mean stress or octahedral stress = $(\sigma_1 + \sigma_2 + \sigma_3)/3$
τ	shear stress
u	porewater pressure
E	modulus of deformation
G	shear modulus of deformation
K	bulk modulus of compressibility

III. SOIL PROPERTIES

(a) Index Properties

$\rho(\gamma)$	bulk density (bulk unit weight*)
$\rho_d(\gamma_d)$	dry density (dry unit weight)
$\rho_w(\gamma_w)$	density (unit weight) of water
$\rho_s(\gamma_s)$	density (unit weight) of solid particles
γ'	unit weight of submerged soil ($\gamma' = \gamma - \gamma_w$)
D_R	relative density (specific gravity) of solid particles ($D_R = \rho_s / \rho_w$) formerly (G_s)
e	void ratio
n	porosity
S	degree of saturation
*	Density symbol is ρ . Unit weight symbol is γ where $\gamma = \rho g$ (i.e. mass density x acceleration due to gravity)

(a) Index Properties (cont'd.)

w	water content
w_L	liquid limit
w_p	plastic limit
I_p	plasticity Index = $(w_L - w_p)$
w_s	shrinkage limit
I_L	liquidity index = $(w - w_p) / I_p$
I_c	consistency index = $(w - w) / I_p$
e_{max}	void ratio in loosest state
e_{min}	void ratio in densest state
I_D	density index = $(e_{max} - e) / (e_{max} - e_{min})$ (formerly relative density)

(b) Hydraulic Properties

h	hydraulic head or potential
q	rate of flow
v	velocity of flow
i	hydraulic gradient
k	hydraulic conductivity (coefficient of permeability)
j	seepage force per unit volume

(c) Consolidation (one-dimensional)

C_c	compression index (normally consolidated range)
C_r	recompression index (overconsolidated range)
C_s	swelling index
C_a	coefficient of secondary consolidation
m_v	coefficient of volume change
c_v	coefficient of consolidation
T_v	time factor (vertical direction)
U	degree of consolidation
σ'_p	pre-consolidation pressure
OCR	Overconsolidation ratio = σ'_p / σ'_{vo}

(d) Shear Strength

τ_p, τ_r	peak and residual shear strength
ϕ'	effective angle of internal friction
δ	angle of interface friction
μ	coefficient of friction = $\tan \delta$
c'	effective cohesion
c_u, s_u	undrained shear strength ($\phi=0$ analysis)
p	mean total stress $(\sigma_1 + \sigma_3) / 2$
p'	mean effective stress $(\sigma'_1 + \sigma'_3) / 2$
q	$(\sigma_1 - \sigma_3) / 2$ or $(\sigma'_1 - \sigma'_3) / 2$
q_u	compressive strength $(\sigma_1 - \sigma_3)$
S_t	sensitivity

Notes: 1. $\tau = c' \sigma' \tan \phi'$
2. Shear strength = (Compressive strength) / 2

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-1

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: October 31, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80	nat V. +	rem V. ⊕	Q - ●			U - ○
0		GROUND SURFACE		86.36													
		Dark brown silty fine sand, trace organic matter (FILL)		0.00													
		Loose brown fine sand (FILL)		0.08													
		Very stiff to stiff brown to grey brown SILTY CLAY (Weathered Crust)		86.05	1	50 DO	6										
				0.31													
1					2	50 DO	12										
2					3	50 DO	5										
					4	50 DO	3										
3		Firm grey SILTY CLAY		83.31													
				3.05	5	50 DO	1										
4	Power Auger 200 mm Diam. (Hollow Stem)							⊕	+								
								⊕	+								
5					6	50 DO	WH										
								⊕	+								
6								⊕	+								
					7	50 DO	WH										
7		End of Borehole		79.40													
				6.96													

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-2

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: October 31, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. rem V.		+				Q - U	
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		85.78													
		TOPSOIL		0.00													
		Very stiff to stiff grey brown SILTY CLAY (Weathered Crust)		0.08	1	50 DO	12										
1					2	50 DO	7										
2					3	50 DO	4										
2		End of Borehole		83.80													
				1.98													
3																	
4																	
5																	
6																	
7																	
8																	
9																	
10																	

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-3

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 1, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80	nat V. +	rem V. ⊕	Q - ●			U - ○
0		GROUND SURFACE		85.48													
		TOPSOIL		0.00													
		Very stiff to stiff grey brown SILTY CLAY (Weathered Crust)		0.15													
1	Power Auger 200 mm Diam. (Hollow Stem)				1	50 DO	5										
2					2	50 DO	2										
						3	50 DO	1									
3			Firm grey SILTY CLAY		82.58 2.90												
4					4	50 DO	WH										
4		Compact to dense dark grey to black SILTY SAND, some gravel, with shale fragments, cobbles, and boulders (GLACIAL TILL)		81.42 4.06													
5					5	50 DO	17										
5					6	50 DO	38										
6		End of Borehole		79.84 5.64													

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-3A

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 2, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. rem V.		+				Q - U	
0		GROUND SURFACE		85.48													
		TOPSOIL		0.00													
		Very stiff to stiff grey brown SILTY CLAY (Weathered Crust)		0.15													
1																	
2																	
3	Power Auger 200 mm Diam. (Hollow Stem)	Firm grey SILTY CLAY		82.74	1	73 TP											
				2.74	2	73 TP											
						3	50 DO										
						4	50 DO										
4																	
5		Compact dark grey to black SILTY SAND, with shale fragments (GLACIAL TILL)		80.73													
				4.75													
				80.43													
				5.05													
5		End of Borehole															
6		Note: Shallow portion of stratigraphy inferred from BH 11-3															
7																	
8																	
9																	
10																	

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-4

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 2, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								20 40 60 80		nat V. + rem V. ⊕ - ⊙		10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³				Wp ----- W ----- WI	
0		GROUND SURFACE		85.90													
		Dark brown clayey topsoil (FILL)		0.00													
		Grey crushed stone (FILL)		0.15													
		Grey brown SILTY CLAY (Disturbed)															
1	Power Auger 200 mm Diam. (Hollow Stem)			84.68	1	50 DO	6										
		Stiff grey brown SILTY CLAY (Weathered Crust)		1.22													
2					2	50 DO	3	⊕	+				○				
3					3	50 DO	16	⊕		+				○			
			Compact dark grey to black SILTY SAND, with shale fragments, cobbles, and boulders (GLACIAL TILL)		83.36												
4				2.54													
5				81.63													
		Highly weathered black SHALE BEDROCK		4.27													
		End of Borehole Sampler Refusal		81.38													
				4.52													

MIS-BHS 001 11-11220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-5

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 1, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. rem V.		+ \ominus				Q - U	
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		85.64													
		TOPSOIL		0.00													
		Very stiff to stiff grey brown SILTY CLAY (Weathered Crust)		0.15	1	50 DO	9										
1																	
2		Compact dark grey to black SILTY SAND, some gravel, with cobbles, boulders, and shale fragments (GLACIAL TILL)		83.51													
				2.13													
3																	
4		Highly weathered black SHALE BEDROCK		81.83													
				3.81													
				81.58													
		End of Borehole		4.06													

W.L. in Standpipe at Elev. 84.37 m on Nov. 14, 2011

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-6

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 1, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. + rem V. ⊕ ⊙		10 ⁻⁶ 10 ⁻⁵ 10 ⁻⁴ 10 ⁻³				Wp	
0	Power Auger 200 mm Diam. (Hollow Stem)	GROUND SURFACE		85.44													
		TOPSOIL		0.00													
		Very stiff to stiff brown SILTY CLAY (Weathered Crust)		0.15													
1						1	50 DO	4									
2					2	50 DO	2										
3		Compact dark grey to black SILTY SAND, with shale fragments (GLACIAL TILL)		82.70 2.74		3	50 DO	7									
		Highly weathered black SHALE BEDROCK		82.39 3.05		4	50 DO	21									
4		End of Borehole		81.78 3.66													

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: 11-7

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: November 1, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80	nat V. +	Q - ●	rem V. ⊕			U - ○
0		GROUND SURFACE		85.42													
		TOPSOIL		0.00													
		Very stiff to stiff grey brown SILTY CLAY (Weathered Crust)		0.15													
1				1	50 DO	5											
		Compact dark grey to black SILTY SAND, with shale fragments, cobbles, and boulders (GLACIAL TILL)		83.44													
				2	50 DO	2											
2				3	50 DO	16											
		Highly weathered SHALE BEDROCK		81.91													
				4	50 DO	17											
3				5	50 DO	20											
		End of Borehole		80.70													
4				6	50 DO	>50											
5				4.72													

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

MIS-BHS 001_1111220129.GPJ GAL-MIS.GDT_1/12/12_JEM

PROJECT: 11-1122-0129-2000

RECORD OF BOREHOLE: MW11-1

SHEET 1 OF 1

LOCATION: See Site Plan

BORING DATE: October 31, 2011

DATUM: Geodetic

SAMPLER HAMMER, 64kg; DROP, 760mm

PENETRATION TEST HAMMER, 64kg; DROP, 760mm

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								Cu, kPa		nat V. rem V.	+ ⊕	- ⊙	Wp	W			Wi
0		GROUND SURFACE		85.96													
		Grey crushed stone (FILL)		0.00	1	50 DO	22									Gravel	
		Very stiff to stiff grey brown SILTY CLAY (Weathered Crust)		85.35	2	50 DO	8									Bentonite Seal	
1				0.61													
					3	50 DO	5									Silica Sand	
2	Power Auger 200 mm Diam. (Hollow Stem)				4	50 DO	4										
		Firm grey SILTY CLAY		83.52	5	50 DO	1									51 mm Diam. PVC #10 Slot Screen	
3				2.44													
					6	50 DO	1										
4		End of Borehole		82.30												W.L. in Screen at Elev. 84.77 m on November 4, 2011	
				3.66													

MIS-BHS 001 1111220129.GPJ GAL-MIS.GDT 1/12/12 JEM

DEPTH SCALE

1 : 50



LOGGED: HEC

CHECKED: SD

TABLE 1
RECORD OF TEST PITS

<u>Test Pit Number</u> <u>(Elevation)</u>	<u>Depth</u> <u>(metres)</u>	<u>Description</u>		
11-1 (85.74 metres)	0.00 – 0.15	TOPSOIL		
	0.15 – 2.00	Grey brown SILTY CLAY (Weathered Crust)		
	2.00	END OF TEST PIT		
		Note: Groundwater seepage at 2.00 metres depth		
			<u>Sample</u>	<u>Depth (m)</u>
			1	1.00
11-2 (85.72 metres)	0.00 – 0.15	TOPSOIL		
	0.15 – 1.00	Grey brown SILTY CLAY (Weathered Crust)		
	1.00 – 2.40	Grey brown SILTY SAND, some gravel and clay, with cobbles and boulders (GLACIAL TILL)		
	2.40	END OF TEST PIT		
		Note: Groundwater seepage at 2.00 metres depth		
			<u>Sample</u>	<u>Depth (m)</u>
			1	2.00
11-3 (85.90 metres)	0.00 – 0.15	TOPSOIL		
	0.15 – 2.00	Grey brown SILTY CLAY (Weathered Crust)		
	2.00	END OF TEST PIT		
		Note: Groundwater seepage at 2.00 metres depth		
11-4 (85.08 metres)	0.00 – 0.15	TOPSOIL		
	0.15 – 1.60	Grey brown SILTY CLAY (Weathered Crust)		
	1.60	END OF TEST PIT		
		Note: Groundwater seepage at 1.50 metres depth		
			<u>Sample</u>	<u>Depth (m)</u>
			1	0.50
			2	1.00



APPENDIX C

Ontario Building Code Tables (Sewage Systems)

(4) Where an *occupancy* is not listed in Table 8.2.1.3.B., the highest of metered flow data from at least 3 similar establishments shall be acceptable for determining total daily design *sanitary sewage* flow.

Table 8.2.1.3.A.
Residential Occupancy
Forming Part of Sentence 8.2.1.3.(1)

<i>Residential Occupancy</i>	Volume, litres
Apartments, Condominiums, Other Multi-family Dwellings - per person ⁽¹⁾	275
Boarding Houses	
(a) Per person,	
i) with meals and laundry facilities, or,	200
ii) without meal or laundry facilities, and	150
(b) Per non-resident staff per 8 hour shift	40
Boarding School - per person	300
Dwellings	
(a) 1 bedroom dwelling	750
(b) 2 bedroom dwelling	1100
(c) 3 bedroom dwelling	1600
(d) 4 bedroom dwelling	2000
(e) 5 bedroom dwelling	2500
(f) Additional flow for ⁽²⁾	
i) each bedroom over 5,	500
ii) A) each 10 m ² (or part of it) over 200 m ² up to 400 m ² ⁽³⁾ ,	100
B) each 10 m ² (or part of it) over 400 m ² up to 600 m ² ⁽³⁾ , and	75
C) each 10 m ² (or part of it) over 600 m ² ⁽³⁾ , or	50
iii) each fixture unit over 20 fixture units	50
Hotels and Motels (excluding bars and restaurants)	
(a) Regular, per room	250
(b) Resort hotel, cottage, per person	500
(c) Self service laundry, add per machine	2500
Work Camp/Construction Camp, semi-permanent per worker	250
Column 1	2

Notes to Table 8.2.1.3.A.:

- (1) The *occupant load* shall be calculated using Subsection 3.1.17.
- (2) Where multiple calculations of sewage volume is permitted the calculation resulting the highest flow shall be used in determining the design *daily sanitary sewage* flow.
- (3) Total finished area, excluding the area of the finished *basement*.

Table 8.2.1.3.B.
Other Occupancies
Forming Part of Sentence 8.2.1.3.(2)

Establishments ⁽¹⁾	Volume, litres
Airports, Bus Terminals, Train Stations, Dock/Port Facilities (Food Services excluded)	
(a) Per passenger, and	20
(b) Per employee per 8 hour shift	40
Assembly Hall - per seat	
(a) No food service, or	8
(b) Food service provided	36
Barber Shop/Beauty Salon - per service chair	650
Bowling Alleys (Food Service not included) - per lane	400
Churches and Similar Places of Worship - per seat	
(a) No kitchen facilities, or	8
(b) Kitchen facilities provided	36
Country Club (excluding Food Service)	
(a) Per resident,	375
(b) Per employee per 8 hour shift, and	50
(c) Per member or patron	40
Day Care Facility per person (staff and children)	75
Dentist Office	
(a) Per wet service chair, and	275
(b) Per dry service chair	190
Doctors Office	
(a) Per practitioner, and	275
(b) Per employee per 8 hour shift	75
Factory (excluding process or cleaning waters) - per employee per 8 hour shift	
(a) No showers, or	75
(b) Including showers	125
Flea Markets ⁽²⁾ (open not more than 3 days per week)	
(a) Per non-food service vendor space,	60
(b) Per food service establishment / 9.25 m ² of floor space, and	190
(c) Per limited food service outlet	95
Column 1	2

Table 8.2.1.3.B. (Cont'd)
Other Occupancies
Forming Part of Sentence 8.2.1.3.(2)

Establishments ⁽¹⁾	Volume, litres
Food Service Operations	
(a) Restaurant (not 24 hour), per seat	125
(b) Restaurant (24 hour), per seat	200
(c) Restaurant on controlled access highway, per seat	400
(d) Paper service restaurant, per seat	60
(e) Donut shop, per seat	400
(f) Bar and cocktail lounge, per seat	125
(g) Drive-in restaurant per parking space	60
(h) Take-out restaurant (no seating area)	
i) per 9.25 m ² of floor area, and	190
ii) per employee per 8 hour shift	75
(i) Cafeteria - per meal	12
(j) Food outlet	
i) excluding delicatessen, bakery and meat department, per 9.25 m ² of floor space,	40
ii) per 9.25 m ² of delicatessen floor space	190
iii) per 9.25 m ² of bakery floor space	190
iv) per 9.25 m ² of meat department floor space, and	380
v) per water closet	950
Hospitals - per bed	
(a) Including laundry facilities, or	750
(b) Excluding laundry facilities	550
Nursing Homes, Rest Homes, etc. - per bed	450
Office Building ⁽³⁾	
(a) Per employee per 8 hour shift, or	75
(b) Per each 9.3 m ² of floor space	75
Public Parks	
(a) With toilets only per person, or	20
(b) With bathhouse, showers, and toilets per person	50
Recreational Vehicle or Campground Park	
(a) Per site without water or sewer hook-up, or	275
(b) Per site with water and sewer hook-up	425
Column 1	2

Table 8.2.1.3.B. (Cont'd)
Other Occupancies
Forming Part of Sentence 8.2.1.3.(2)

Establishments ⁽¹⁾	Volume, litres
Schools - per student	
(a) Day school,	30
(b) With showers,	30
(c) With cafeteria, and	30
(d) Per non-teaching employee per 8 hour shift	50
Service Stations (no vehicle washing) ⁽³⁾	
(a) Per water closet, and	950
i) per fuel outlet ⁽⁴⁾ , or	560
ii) per vehicle served	20
Shopping Centre (excluding food and laundry) - per 1.0 m ² of floor space	5
Stadiums, Race Tracks, Ball Parks - per seat	20
Stores ⁽³⁾	
(a) Per 1.0 m ² of floor area, or	5
(b) Per water closet	1230
Swimming and Bathing Facilities (Public) - per person	40
Theatres	
(a) Indoor, auditoriums per seat,	20
(b) Outdoor, drive-ins per space, or	40
(c) Movie theatres per seat	15
Veterinary Clinics	
(a) Per practitioner,	275
(b) Per employee per 8 hour shift, and	75
(c) Per stall, kennel, or cage if floor drain connected	75
Warehouse	
(a) Per water closet, and	950
(b) Per loading bay	150
Column 1	2

Notes to Table 8.2.1.3.B.:

- (1) The *occupant load* shall be calculated using Subsection 3.1.17.
- (2) Flea markets open more than 3 days per week shall be assessed using the volumes stated under the heading "Stores".
- (3) Where multiple calculations of *sanitary sewage* volume is permitted the calculation resulting in the highest flow shall be used in determining the design daily *sanitary sewage* flow.
- (4) The number of fuel outlets is considered the maximum number of gas nozzles that could be in use at the same time.

Table 8.2.1.6.A.
Minimum Clearances for Treatment Units
 Forming Part of Sentence 8.2.1.6.(1)

Object	Minimum Clearance, m
Structure	1.5
Well	15
Lake	15
Pond	15
Reservoir	15
River	15
Spring	15
Stream	15
Property Line	3
Column 1	2

(2) Except as provided in Sentences 8.2.1.4.(1) and (2), a *distribution pipe* shall not be located closer than the minimum horizontal distances set out in Table 8.2.1.6.B. and these distances shall be increased when required by Sentence 8.7.4.2.(9).

Table 8.2.1.6.B.
Minimum Clearances for Distribution Piping
 Forming Part of Sentence 8.2.1.6.(2)

Object	Minimum Clearance, m
Structure	5
Well with a watertight casing to a depth of 6 m	15
Any other well	30
Lake	15
Pond	15
Reservoir	15
River	15
Spring not used as a source of <i>potable</i> water	15
Stream	15
Property Line	3
Column 1	2

(3) Except as provided in Sentences 8.2.1.4.(1) and (2), a *holding tank* shall not be located closer than the minimum horizontal distances set out in Table 8.2.1.6.C.

Table 8.7.3.3.A.
Septic Stone
Forming Part Of Sentence 8.7.3.3.(5)

Gradation of Septic Stone	
Particle Size	Percent Passing
53 mm	100
19 mm	0-5
75 µm	0-1
Column 1	2

8.7.4. Fill Based Absorption Trenches

8.7.4.1. Loading Requirements

(1) The area described in Sentence 8.7.4.2.(1) shall be designed such that the *loading rate* does not exceed, for *soil* having a *percolation time* set out in Column 1 of Table 8.7.4.1.A., the maximum value set out opposite it in Column 2 of Table 8.7.4.1.A.

Table 8.7.4.1.A.
Loading Rates for Fill Based Absorption Trenches and Filter Beds
Forming Part of Sentences 8.7.4.1.(1) and 8.7.5.2.(2)

Percolation Time (T) of Soil, min/cm	Loading Rates, (L/m ²)/day
1 < T ≤ 20	10
20 < T ≤ 35	8
35 < T ≤ 50	6
T > 50	4
Column 1	2

8.7.4.2. Construction Requirements (See Appendix A.)

- (1) A *leaching bed* comprised of *absorption trenches* may be *constructed* in *leaching bed fill* if *unsaturated soil* or *leaching bed fill* complying with Clause 8.7.2.1.(1)(b) extends,
 - (a) to a depth of at least 250 mm over the area covered by the *leaching bed fill*, and
 - (b) for at least 15 m beyond the outer *distribution pipes* in any direction in which the *effluent* entering the *soil* or *leaching bed fill* will move horizontally.
- (2) If the *unsaturated soil* or *leaching bed fill* described in Sentence (1) has a *percolation time* greater than 15 minutes, any *leaching bed fill* added to form the *leaching bed* shall have a *percolation time* not less than 75% of the *percolation time* of the *unsaturated soil* or *leaching bed fill*.
- (3) *Leaching bed fill* that does not meet the requirements of Sentence (2) may be used to form the *leaching bed* if,
 - (a) the distance from the bottom of the *absorption trench* to *native soil* is not less than 900 mm, or
 - (b) where the distance from the bottom of the *absorption trench* to *native soil* is less than 900 mm, the *percolation time* of the least permeable *soil* or *leaching bed fill* within 900 mm from the bottom of the *absorption trench* is used to calculate the length of the *distribution pipe* under Article 8.7.3.1.

SB-6 Percolation Time and Soil Descriptions

ESTIMATION OF PERCOLATION TIME

- (a) The purpose of this Section and the associated Tables and Charts is to provide assistance to those who must decide on the percolation time(s) to be used in design. Suggested relationships between percolation time, coefficient of permeability and soils of various types are given. **IT MUST BE EMPHASIZED THAT, PARTICULARLY FOR FINE GRAINED SOILS, THERE IS NO CONSISTENT RELATIONSHIP DUE TO THE MANY FACTORS INVOLVED.** The following guidance is presented for the soil types outlined in the Unified Soil Classification System (Table 1). In order to assess a particular soil.
- (i) Table 2 and Table 3 - Approximate relationship of soil types to permeability and percolation time.
 - (ii) Charts 1 to 14 - Typical grain size distribution curves for soil types in the Unified Soil Classification System.
- (b) In Table 2 and Table 3, a range of values of "K" and of "T" are given for various soil descriptions. The principal modifiers which will influence selection of a "T" value within the range given are:
- (i) The structure - "massive" fine-grained soils have high values of "T".
 - (ii) The density - For a given soil higher density produces a higher value of "T".
 - (iii) The percentage of clay - the higher the percentage the higher the value of "T".
 - (iv) The mineralogy of the clay portion - The more it "swells" the higher the value of "T".
 - (v) The plasticity of the soil - The higher the plasticity index the higher the value of "T".
 - (vi) Liquid Limit - the higher the liquid limit the higher the value of "T".
 - (vii) Organic content - The presence of fine organic particles, detectable by colouration and odour, can significantly reduce the permeability and raise the value of "T".

Table 1
Unified Soil Classification

Coarse - Grained Soils		Fine - Grained Soils	
Group Symbols	Typical Names	Group Symbols	Typical Names
GW	Well-graded gravels, gravel-sand mixtures, little or no fines	ML	Inorganic silts and very fine sands, rock flour, silty or clayey fine sands or clayey silts with slight plasticity
GP	Poorly-graded gravels, gravel-sand mixtures, little or no fines	CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays
GM	Silty gravels, gravel-sand-silt mixtures	OL	Organic silts and organic silty clays of low plasticity
GC	Clayey gravels, gravel-sand-clay mixtures	MH	Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts
SW	Well-graded sands, gravelly sands, little or no fines	CH	Inorganic clays of high plasticity, fat clays
SP	Poorly-graded sands, gravelly sands, little or no fines	OH	Organic clays of medium to high plasticity, organic silts
SM	Silty sands, sand-silt mixtures		
SC	Clayey sands, sand-clay mixtures	PT (highly organic soils)	Peat and other highly organic soils
Column 1	2	3	4

Table 2
Approximate Relationship of Coarse Grained Soil Types to Permeability and Percolation Time

Soil Type (Unified Soil Classification)	Coefficient of Permeability, K - cm/sec	Percolation Time, T - mins/cm	Comment
Coarse Grained More than 50% Larger than #200			
G.W. - Well graded gravels, gravel-sand mixtures, little or no fines.	10^{-1}	<1	very permeable unacceptable
G.P. - Poorly graded gravels, gravel-sand mixtures, little or no fines.	10^{-1}	<1	very permeable unacceptable
G.M. - Silty gravels, gravel-sand-silt mixtures.	$10^{-2} - 10^{-4}$	4 - 12	Permeable to medium permeable depending on amount of silt.
G.C. - Clayey gravels, gravel-sand-clay mixtures.	$10^{-4} - 10^{-6}$	12 - 50	Important to estimate amount of silt and clay
S.W. - Well graded sands, gravelly sands little or no fines.	$10^{-1} - 10^{-4}$	2 - 12	medium permeability
S.P. - Poorly graded sands, gravelly sand, little or no fines.	$10^{-1} - 10^{-3}$	2 - 8	medium permeability
S.M. - Silty sands, sand-silt mixtures.	$10^{-3} - 10^{-5}$	8 - 20	medium to low permeability
S.C. - Clayey sands, sand-clay mixtures.	$10^{-4} - 10^{-6}$	12 - 50	medium to low permeability depending on amount of clay
Column 1	2	3	4

Table 3
Approximate Relationship of Fine Grained Soil Types to Permeability and Percolation Time

Soil Type (Unified Soil Classification)	Coefficient of Permeability, K - cm/sec	Percolation Time, T - mins/cm	Comment
Fine Grained More than 50% Passing #200			
M.L. - Inorganic silts and very fine sands, rock flour, silty or clayey fine sands, clayey silts with slight plasticity	$10^{-5} - 10^{-6}$	20 - 50	medium to low permeability
C.L. - Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays	10^{-6} and less	over 50	unacceptable
O.L. - Organic silts, organic silty clays of low plasticity; liquid limit less than 50	10^{-5} and less	20 - over 50	acceptable depends on clay content
M.H. - Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts	10^{-6} and less	over 50	unacceptable
C.H. - Inorganic clays of medium to high plasticity, organic silts	10^{-7} and less	over 50	unacceptable
O.H. - Organic clays of medium to high plasticity organic silt; liquid limit over 50	10^{-6} and less	over 50	unacceptable
Column 1	2	3	4

SELECTION OF "T" TIME FROM THE ABOVE TABULATION

A range of "T" times for each soil type is shown above. Select from within this range by determining if the soil is within the low, middle or high part of the range considering the soil identifiers and soil characteristics. Consider structure, density, colour, prevalence of organics, the clay content and mineralogy, the plasticity index and liquid limit and the functioning of existing systems in similar soils in the area.

Notes:

The following Ministry of the Environment Reports provide further information on the relationship between grain size, coefficient of permeability and percolation time.

1. "Study on the Feasibility of Correlating Percolation Time with Laboratory Permeability" - 1975 - Research Report No. S56 by H. T. Chan, PhD., P.Eng.
2. "Study of Conventional Tile Fields in Fine-Grained Soils" - 1979 Research Report 74 by H. T. Chan, PhD., P.Eng.



APPENDIX D

Water Well Record, PW11-1



Ministry of the Environment

Well Tag No. (Place Stic

A116305

Well Record

Regulation 903 Ontario Water Resources Act

Measurements recorded in: Metric Imperial

Page of

A 116305

Well Owner Information

First Name: **ML Bradley Ltd** Last Name / Organization: **ML** E-mail Address: **N/A** Well Constructed by Well Owner

Mailing Address (Street Number/Name): **PO BOX 70 Napan** Municipality: **Napan** Province: **ON** Postal Code: **K0B1G3** Telephone No. (inc. area code): **613-835-2488**

Well Location

Address of Well Location (Street Number/Name): **3450 Frank Kenny St** Township: **Cumberland** Lot: **10** Concession: **8**

County/District/Municipality: **Ottawa** City/Town/Village: **Ottawa** Province: **Ontario** Postal Code:

UTM Coordinates: Zone: **18** Easting: **10410** Northing: **8275030372** Municipal Plan and Sublot Number: Other:

General Colour	Most Common Material	Other Materials	General Description	Depth (mft) From	Depth (mft) To
Brown	clay	Silt	Hard	0	3.1
Grey	clay	Silt	Hard	3.1	8.9
Grey	limestone		Layered	8.9	24.3

Depth Set at (mft) From	Depth Set at (mft) To	Type of Sealant Used (Material and Type)	Volume Placed (m ³)
0	10.9	cement grout	0.4 m ³

Method of Construction

<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input checked="" type="checkbox"/> Commercial	<input type="checkbox"/> Not used
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input type="checkbox"/> Domestic	<input type="checkbox"/> Municipal	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole	<input type="checkbox"/> Monitoring
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning	
<input type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial		
<input checked="" type="checkbox"/> Other, specify Air Rotary		<input type="checkbox"/> Other, specify		

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Well Thickness (cm/in)	Depth (mft) From	Depth (mft) To	Water Supply
15.55	Steel	0.48	4.6	10.9	<input checked="" type="checkbox"/> Water Supply
15.55	Open Hole		10.9	23.4	<input type="checkbox"/> Replacement Well

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (mft) From	Depth (mft) To

Water found at Depth (mft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (mft) From	Depth (mft) To	Diameter (cm/in)
1.9	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0	10.9	24.67
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	10.9	24.3	15.55

Business Name of Well Contractor: **Bourgeois Well Drilling Ltd** Well Contractor's License No.: **741117**


Business Address (Street Number/Name): **151 Montee D'Arrest** Municipality: **Napan**

Province: **ON** Postal Code: **K0B1G3** Business E-mail Address: **N/A**

Bus. Telephone No. (inc. area code): **613-835-2488** Name of Well Technician (Last Name, First Name): **GENIER, MICHAEL**

Well Technician License No.: **31413** Signature of Technician and/or Contractor: *[Signature]* Date Submitted: **2011/11/23**

After test of well yield, water was:		Draw Down		Recovery	
<input checked="" type="checkbox"/> Clear and sand free	<input type="checkbox"/> Other, specify	Time (min)	Water Level (mft)	Time (min)	Water Level (mft)
If pumping discontinued, give reason:		Static Level	1.04		1.87
Pump intake set at (mft): 20		1		1	1.17
Pumping rate (l/min / GPM): 56		2		2	1.10
Duration of pumping: 1 hrs + min		3		3	1.08
Final water level end of pumping (mft): 1.87		4		4	1.08
If flowing give rate (l/min / GPM):		5	1.59	5	1.06
Recommended pump depth (mft):		10	1.85	10	1.05
Recommended pump rate (l/min / GPM):		15	1.85	15	1.04
Well production (l/min / GPM):		20	1.85	20	1.04
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		25	1.87	25	1.04
		30	1.87	30	1.04
		40	1.88	40	1.04
		50	1.88	50	1.04
		60	1.87	60	

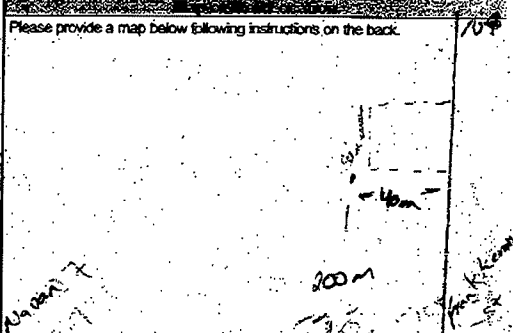

Comments: **Colonial**

Well owner's information: package delivered Yes No

Date Package Delivered: **2011/11/23** Date Work Completed: **2011/11/23**

2140701



APPENDIX E

Raw Pumping Test Data and Transmissivity Calculations

PW11-1

Notes:

Datalogger installed at 10.7 m below top of casing

Static WL

1.715 m below top of casing

Start of Test

11/7/2011 9:36

End of Test

11/7/2011 15:52

<u>Date/Time</u>	<u>Time</u> (min)	<u>Pumping Rate</u> (L/min)	<u>Datalogger</u> Level (m)	<u>Temperature</u> (deg C)	<u>Datalogger</u> Drawdown (m)	<u>Water Level</u> (m btoc)
11/7/2011 9:36	0	15.14	9.2122	8.385	0.00	1.71
11/7/2011 9:37	1	15.14	8.825	8.361	0.39	2.10
11/7/2011 9:38	2	15.14	8.4062	8.349	0.81	2.52
11/7/2011 9:39	3	15.14	8.038	8.343	1.17	2.88
11/7/2011 9:40	4	15.14	7.7232	8.345	1.49	3.20
11/7/2011 9:41	5	15.14	7.4403	8.354	1.77	3.48
11/7/2011 9:42	6	15.14	7.1782	8.361	2.03	3.74
11/7/2011 9:43	7	15.14	6.8541	8.386	2.36	4.07
11/7/2011 9:44	8	15.14	6.5403	8.423	2.67	4.38
11/7/2011 9:45	9	15.14	6.2556	8.474	2.96	4.67
11/7/2011 9:46	10	15.14	6.0008	8.531	3.21	4.92
11/7/2011 9:47	11	15.14	5.7696	8.592	3.44	5.15
11/7/2011 9:48	12	15.14	5.5226	8.69	3.69	5.40
11/7/2011 9:49	13	15.14	5.2192	8.764	3.99	5.70
11/7/2011 9:50	14	15.14	4.9205	8.857	4.29	6.00
11/7/2011 9:51	15	15.14	4.6517	8.956	4.56	6.27
11/7/2011 9:52	16	15.14	4.388	9.042	4.82	6.53
11/7/2011 9:53	17	15.14	4.1523	9.144	5.06	6.77
11/7/2011 9:54	18	15.14	3.9616	9.237	5.25	6.96
11/7/2011 9:55	19	15.14	3.8107	9.27	5.40	7.11
11/7/2011 9:56	20	15.14	3.6776	9.286	5.53	7.24
11/7/2011 9:57	21	15.14	3.5343	9.275	5.68	7.39
11/7/2011 9:58	22	15.14	3.4041	9.288	5.81	7.52
11/7/2011 9:59	23	15.14	3.2832	9.282	5.93	7.64
11/7/2011 10:00	24	15.14	3.1722	9.254	6.04	7.75
11/7/2011 10:01	25	15.14	3.0663	9.217	6.15	7.86
11/7/2011 10:02	26	15.14	2.9659	9.239	6.25	7.96
11/7/2011 10:03	27	15.14	2.8715	9.234	6.34	8.05
11/7/2011 10:04	28	15.14	2.7769	9.199	6.44	8.15
11/7/2011 10:05	29	15.14	2.691	9.21	6.52	8.23
11/7/2011 10:06	30	15.14	2.605	9.171	6.61	8.32
11/7/2011 10:07	31	15.14	2.5161	9.135	6.70	8.41
11/7/2011 10:08	32	9.46	2.8412	9.053	6.37	8.08
11/7/2011 10:09	33	9.46	2.874	8.893	6.34	8.05
11/7/2011 10:10	34	9.46	2.9246	8.804	6.29	8.00
11/7/2011 10:11	35	9.46	2.9747	8.733	6.24	7.95
11/7/2011 10:12	36	9.46	3.0168	8.682	6.20	7.91
11/7/2011 10:13	37	9.46	3.0534	8.637	6.16	7.87
11/7/2011 10:14	38	9.46	3.0633	8.62	6.15	7.86
11/7/2011 10:15	39	9.46	3.0708	8.596	6.14	7.85
11/7/2011 10:16	40	10.22	3.0804	8.583	6.13	7.84
11/7/2011 10:17	41	10.22	3.0944	8.564	6.12	7.83
11/7/2011 10:18	42	10.22	3.0621	8.547	6.15	7.86
11/7/2011 10:19	43	10.22	3.0213	8.557	6.19	7.90
11/7/2011 10:20	44	10.22	2.9779	8.563	6.23	7.94
11/7/2011 10:21	45	10.22	2.944	8.573	6.27	7.98
11/7/2011 10:22	46	10.22	2.9133	8.579	6.30	8.01
11/7/2011 10:23	47	10.22	2.8856	8.587	6.33	8.04
11/7/2011 10:24	48	10.22	2.8952	8.59	6.32	8.03
11/7/2011 10:25	49	10.22	2.9073	8.58	6.30	8.02
11/7/2011 10:26	50	10.22	2.9118	8.57	6.30	8.01
11/7/2011 10:27	51	10.22	2.9147	8.571	6.30	8.01
11/7/2011 10:28	52	10.22	2.919	8.565	6.29	8.00

Golder Associates

PW11-1

Notes:**Datalogger installed at 10.7 m below top of casing****Static WL**

1.715 m below top of casing

Start of Test

11/7/2011 9:36

End of Test

11/7/2011 15:52

<u>Date/Time</u>	<u>Time</u> <u>(min)</u>	<u>Pumping Rate</u> <u>(L/min)</u>	<u>Datalogger</u> <u>Level (m)</u>	<u>Temperature</u> <u>(deg C)</u>	<u>Datalogger</u> <u>Drawdown (m)</u>	<u>Water Level</u> <u>(m btoc)</u>
11/7/2011 10:29	53	10.22	2.9244	8.55	6.29	8.00
11/7/2011 10:30	54	10.22	2.9233	8.535	6.29	8.00
11/7/2011 10:31	55	10.22	2.921	8.522	6.29	8.00
11/7/2011 10:32	56	10.22	2.9235	8.531	6.29	8.00
11/7/2011 10:33	57	10.22	2.9196	8.518	6.29	8.00
11/7/2011 10:34	58	10.22	2.9219	8.507	6.29	8.00
11/7/2011 10:35	59	10.22	2.9219	8.503	6.29	8.00
11/7/2011 10:36	60	10.22	2.9125	8.505	6.30	8.01
11/7/2011 10:37	61	10.22	2.9014	8.505	6.31	8.02
11/7/2011 10:38	62	10.22	2.8938	8.498	6.32	8.03
11/7/2011 10:39	63	10.22	2.8759	8.508	6.34	8.05
11/7/2011 10:40	64	10.22	2.8628	8.5	6.35	8.06
11/7/2011 10:41	65	10.22	2.8467	8.495	6.37	8.08
11/7/2011 10:42	66	11.32	2.8316	8.498	6.38	8.09
11/7/2011 10:43	67	11.32	2.8181	8.495	6.39	8.10
11/7/2011 10:44	68	11.32	2.8026	8.495	6.41	8.12
11/7/2011 10:45	69	11.32	2.7805	8.497	6.43	8.14
11/7/2011 10:46	70	11.32	2.763	8.488	6.45	8.16
11/7/2011 10:47	71	11.32	2.7455	8.485	6.47	8.18
11/7/2011 10:48	72	11.32	2.7271	8.483	6.49	8.20
11/7/2011 10:49	73	11.32	2.7123	8.486	6.50	8.21
11/7/2011 10:50	74	11.32	2.7018	8.482	6.51	8.22
11/7/2011 10:51	75	11.32	2.6864	8.476	6.53	8.24
11/7/2011 10:52	76	11.32	2.6755	8.471	6.54	8.25
11/7/2011 10:53	77	11.32	2.6649	8.465	6.55	8.26
11/7/2011 10:54	78	11.32	2.6577	8.456	6.55	8.26
11/7/2011 10:55	79	11.32	2.6506	8.453	6.56	8.27
11/7/2011 10:56	80	11.32	2.6418	8.454	6.57	8.28
11/7/2011 10:57	81	11.32	2.6378	8.451	6.57	8.28
11/7/2011 10:58	82	11.32	2.6312	8.454	6.58	8.29
11/7/2011 10:59	83	11.32	2.6267	8.451	6.59	8.30
11/7/2011 11:00	84	11.32	2.6219	8.447	6.59	8.30
11/7/2011 11:01	85	11.32	2.6195	8.441	6.59	8.30
11/7/2011 11:02	86	11.32	2.6158	8.432	6.60	8.31
11/7/2011 11:03	87	11.32	2.6135	8.429	6.60	8.31
11/7/2011 11:04	88	11.32	2.6147	8.426	6.60	8.31
11/7/2011 11:05	89	11.32	2.6145	8.426	6.60	8.31
11/7/2011 11:06	90	11.32	2.6135	8.422	6.60	8.31
11/7/2011 11:07	91	11.32	2.6138	8.42	6.60	8.31
11/7/2011 11:08	92	11.32	2.6138	8.416	6.60	8.31
11/7/2011 11:09	93	11.32	2.6107	8.408	6.60	8.31
11/7/2011 11:10	94	11.32	2.6116	8.408	6.60	8.31
11/7/2011 11:11	95	11.32	2.6144	8.408	6.60	8.31
11/7/2011 11:12	96	11.32	2.6177	8.407	6.59	8.30
11/7/2011 11:13	97	11.32	2.621	8.402	6.59	8.30
11/7/2011 11:14	98	11.32	2.6294	8.405	6.58	8.29
11/7/2011 11:15	99	11.32	2.6337	8.407	6.58	8.29
11/7/2011 11:16	100	11.32	2.6302	8.404	6.58	8.29
11/7/2011 11:17	101	11.32	2.6215	8.396	6.59	8.30
11/7/2011 11:18	102	11.32	2.6144	8.394	6.60	8.31
11/7/2011 11:19	103	11.32	2.6041	8.391	6.61	8.32
11/7/2011 11:20	104	11.32	2.5953	8.393	6.62	8.33
11/7/2011 11:21	105	11.32	2.588	8.39	6.62	8.33

Golder Associates

PW11-1

Notes:**Datalogger installed at 10.7 m below top of casing****Static WL** 1.715 m below top of casing**Start of Test** 11/7/2011 9:36**End of Test** 11/7/2011 15:52

<u>Date/Time</u>	<u>Time</u> (min)	<u>Pumping Rate</u> (L/min)	<u>Datalogger</u> Level (m)	<u>Temperature</u> (deg C)	<u>Datalogger</u> Drawdown (m)	<u>Water Level</u> (m btoc)
11/7/2011 11:22	106	11.32	2.5795	8.395	6.63	8.34
11/7/2011 11:23	107	11.32	2.5741	8.398	6.64	8.35
11/7/2011 11:24	108	11.32	2.5647	8.4	6.65	8.36
11/7/2011 11:25	109	11.32	2.5589	8.401	6.65	8.36
11/7/2011 11:26	110	11.32	2.5465	8.398	6.67	8.38
11/7/2011 11:27	111	11.32	2.5375	8.395	6.67	8.38
11/7/2011 11:28	112	11.32	2.5297	8.392	6.68	8.39
11/7/2011 11:29	113	11.32	2.5207	8.392	6.69	8.40
11/7/2011 11:30	114	11.32	2.5141	8.388	6.70	8.41
11/7/2011 11:31	115	11.32	2.508	8.385	6.70	8.41
11/7/2011 11:32	116	11.32	2.5053	8.383	6.71	8.42
11/7/2011 11:33	117	11.32	2.5022	8.386	6.71	8.42
11/7/2011 11:34	118	11.32	2.5001	8.386	6.71	8.42
11/7/2011 11:35	119	11.32	2.496	8.385	6.72	8.43
11/7/2011 11:36	120	11.32	2.4945	8.381	6.72	8.43
11/7/2011 11:37	121	11.32	2.4903	8.38	6.72	8.43
11/7/2011 11:38	122	11.32	2.4871	8.382	6.73	8.44
11/7/2011 11:39	123	11.32	2.4833	8.38	6.73	8.44
11/7/2011 11:40	124	11.32	2.4826	8.371	6.73	8.44
11/7/2011 11:41	125	11.32	2.4801	8.372	6.73	8.44
11/7/2011 11:42	126	11.32	2.4777	8.37	6.73	8.44
11/7/2011 11:43	127	11.32	2.4724	8.371	6.74	8.45
11/7/2011 11:44	128	11.32	2.4707	8.366	6.74	8.45
11/7/2011 11:45	129	11.32	2.4699	8.367	6.74	8.45
11/7/2011 11:46	130	11.32	2.4663	8.365	6.75	8.46
11/7/2011 11:47	131	11.32	2.4636	8.365	6.75	8.46
11/7/2011 11:48	132	11.32	2.4615	8.365	6.75	8.46
11/7/2011 11:49	133	11.32	2.4589	8.364	6.75	8.46
11/7/2011 11:50	134	11.32	2.4568	8.364	6.76	8.47
11/7/2011 11:51	135	11.32	2.4543	8.365	6.76	8.47
11/7/2011 11:52	136	11.32	2.4514	8.369	6.76	8.47
11/7/2011 11:53	137	11.32	2.4505	8.369	6.76	8.47
11/7/2011 11:54	138	11.32	2.4486	8.365	6.76	8.47
11/7/2011 11:55	139	11.32	2.4464	8.364	6.77	8.48
11/7/2011 11:56	140	11.32	2.4459	8.364	6.77	8.48
11/7/2011 11:57	141	11.32	2.4434	8.361	6.77	8.48
11/7/2011 11:58	142	11.32	2.4408	8.36	6.77	8.48
11/7/2011 11:59	143	11.32	2.4394	8.357	6.77	8.48
11/7/2011 12:00	144	11.32	2.4381	8.356	6.77	8.48
11/7/2011 12:01	145	11.32	2.4335	8.356	6.78	8.49
11/7/2011 12:02	146	11.32	2.4313	8.356	6.78	8.49
11/7/2011 12:03	147	11.32	2.4272	8.354	6.79	8.50
11/7/2011 12:04	148	11.32	2.4275	8.352	6.78	8.49
11/7/2011 12:05	149	11.32	2.4313	8.351	6.78	8.49
11/7/2011 12:06	150	11.32	2.4291	8.349	6.78	8.49
11/7/2011 12:07	151	11.32	2.4296	8.349	6.78	8.49
11/7/2011 12:08	152	11.32	2.4254	8.35	6.79	8.50
11/7/2011 12:09	153	11.32	2.4261	8.351	6.79	8.50
11/7/2011 12:10	154	11.32	2.4226	8.349	6.79	8.50
11/7/2011 12:11	155	11.32	2.4227	8.347	6.79	8.50
11/7/2011 12:12	156	11.32	2.4222	8.351	6.79	8.50
11/7/2011 12:13	157	11.32	2.4205	8.351	6.79	8.50
11/7/2011 12:14	158	11.32	2.4156	8.348	6.80	8.51

Golder Associates

PW11-1

Notes:**Datalogger installed at 10.7 m below top of casing****Static WL**

1.715 m below top of casing

Start of Test

11/7/2011 9:36

End of Test

11/7/2011 15:52

<u>Date/Time</u>	<u>Time (min)</u>	<u>Pumping Rate (L/min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 12:15	159	11.32	2.4137	8.345	6.80	8.51
11/7/2011 12:16	160	11.32	2.4123	8.346	6.80	8.51
11/7/2011 12:17	161	11.32	2.404	8.346	6.81	8.52
11/7/2011 12:18	162	11.32	2.4001	8.346	6.81	8.52
11/7/2011 12:19	163	11.32	2.3962	8.344	6.82	8.53
11/7/2011 12:20	164	11.32	2.3941	8.346	6.82	8.53
11/7/2011 12:21	165	11.32	2.3886	8.345	6.82	8.53
11/7/2011 12:22	166	11.32	2.3887	8.346	6.82	8.53
11/7/2011 12:23	167	11.32	2.3884	8.348	6.82	8.53
11/7/2011 12:24	168	11.32	2.3841	8.348	6.83	8.54
11/7/2011 12:25	169	11.32	2.3796	8.346	6.83	8.54
11/7/2011 12:26	170	11.32	2.375	8.343	6.84	8.55
11/7/2011 12:27	171	11.32	2.3738	8.342	6.84	8.55
11/7/2011 12:28	172	11.32	2.3689	8.344	6.84	8.55
11/7/2011 12:29	173	11.32	2.3687	8.341	6.84	8.55
11/7/2011 12:30	174	11.32	2.3671	8.341	6.85	8.56
11/7/2011 12:31	175	11.32	2.3655	8.343	6.85	8.56
11/7/2011 12:32	176	11.32	2.3631	8.342	6.85	8.56
11/7/2011 12:33	177	11.32	2.3607	8.34	6.85	8.56
11/7/2011 12:34	178	11.32	2.3581	8.342	6.85	8.56
11/7/2011 12:35	179	11.32	2.3561	8.343	6.86	8.57
11/7/2011 12:36	180	11.32	2.3544	8.342	6.86	8.57
11/7/2011 12:37	181	11.32	2.3533	8.343	6.86	8.57
11/7/2011 12:38	182	11.32	2.3501	8.343	6.86	8.57
11/7/2011 12:39	183	11.32	2.346	8.343	6.87	8.58
11/7/2011 12:40	184	11.32	2.3442	8.343	6.87	8.58
11/7/2011 12:41	185	11.32	2.3429	8.343	6.87	8.58
11/7/2011 12:42	186	11.32	2.3434	8.342	6.87	8.58
11/7/2011 12:43	187	11.32	2.3439	8.342	6.87	8.58
11/7/2011 12:44	188	11.32	2.3435	8.341	6.87	8.58
11/7/2011 12:45	189	11.32	2.3418	8.338	6.87	8.58
11/7/2011 12:46	190	11.32	2.3373	8.339	6.87	8.59
11/7/2011 12:47	191	11.32	2.3369	8.339	6.88	8.59
11/7/2011 12:48	192	11.32	2.3375	8.337	6.87	8.58
11/7/2011 12:49	193	11.32	2.3372	8.339	6.88	8.59
11/7/2011 12:50	194	11.32	2.3359	8.336	6.88	8.59
11/7/2011 12:51	195	11.32	2.3395	8.333	6.87	8.58
11/7/2011 12:52	196	11.32	2.3396	8.333	6.87	8.58
11/7/2011 12:53	197	11.32	2.3365	8.334	6.88	8.59
11/7/2011 12:54	198	11.32	2.3384	8.333	6.87	8.58
11/7/2011 12:55	199	11.32	2.3364	8.334	6.88	8.59
11/7/2011 12:56	200	11.32	2.3381	8.333	6.87	8.58
11/7/2011 12:57	201	11.32	2.3369	8.333	6.88	8.59
11/7/2011 12:58	202	11.32	2.3312	8.335	6.88	8.59
11/7/2011 12:59	203	11.32	2.3344	8.333	6.88	8.59
11/7/2011 13:00	204	11.32	2.3354	8.331	6.88	8.59
11/7/2011 13:01	205	11.32	2.3317	8.331	6.88	8.59
11/7/2011 13:02	206	11.32	2.3341	8.334	6.88	8.59
11/7/2011 13:03	207	11.32	2.3361	8.333	6.88	8.59
11/7/2011 13:04	208	11.32	2.3319	8.335	6.88	8.59
11/7/2011 13:05	209	11.32	2.3357	8.334	6.88	8.59
11/7/2011 13:06	210	11.32	2.3344	8.332	6.88	8.59
11/7/2011 13:07	211	11.32	2.3375	8.331	6.87	8.58

Golder Associates

Notes:
Datalogger installed at 10.7 m below top of casing
Static WL 1.715 m below top of casing
Start of Test 11/7/2011 9:36
End of Test 11/7/2011 15:52

<u>Date/Time</u>	<u>Time (min)</u>	<u>Pumping Rate (L/min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 13:08	212	11.32	2.3355	8.333	6.88	8.59
11/7/2011 13:09	213	11.32	2.3373	8.332	6.87	8.59
11/7/2011 13:10	214	11.32	2.337	8.331	6.88	8.59
11/7/2011 13:11	215	11.32	2.3345	8.333	6.88	8.59
11/7/2011 13:12	216	11.32	2.3326	8.332	6.88	8.59
11/7/2011 13:13	217	11.32	2.3312	8.333	6.88	8.59
11/7/2011 13:14	218	11.32	2.3236	8.332	6.89	8.60
11/7/2011 13:15	219	11.32	2.3159	8.331	6.90	8.61
11/7/2011 13:16	220	11.32	2.3103	8.331	6.90	8.61
11/7/2011 13:17	221	11.32	2.3044	8.33	6.91	8.62
11/7/2011 13:18	222	11.32	2.2939	8.331	6.92	8.63
11/7/2011 13:19	223	11.32	2.2973	8.33	6.91	8.63
11/7/2011 13:20	224	11.32	2.2892	8.331	6.92	8.63
11/7/2011 13:21	225	11.32	2.2834	8.332	6.93	8.64
11/7/2011 13:22	226	11.32	2.2845	8.328	6.93	8.64
11/7/2011 13:23	227	11.32	2.2885	8.329	6.92	8.63
11/7/2011 13:24	228	11.32	2.2808	8.329	6.93	8.64
11/7/2011 13:25	229	11.32	2.2759	8.332	6.94	8.65
11/7/2011 13:26	230	11.32	2.2772	8.333	6.94	8.65
11/7/2011 13:27	231	11.32	2.2762	8.333	6.94	8.65
11/7/2011 13:28	232	11.32	2.273	8.331	6.94	8.65
11/7/2011 13:29	233	11.32	2.2765	8.331	6.94	8.65
11/7/2011 13:30	234	11.32	2.2733	8.331	6.94	8.65
11/7/2011 13:31	235	11.32	2.2689	8.332	6.94	8.65
11/7/2011 13:32	236	11.32	2.2666	8.331	6.95	8.66
11/7/2011 13:33	237	11.32	2.269	8.33	6.94	8.65
11/7/2011 13:34	238	11.32	2.2676	8.328	6.94	8.65
11/7/2011 13:35	239	11.32	2.2665	8.33	6.95	8.66
11/7/2011 13:36	240	11.32	2.2645	8.33	6.95	8.66
11/7/2011 13:37	241	11.32	2.2623	8.329	6.95	8.66
11/7/2011 13:38	242	11.32	2.2667	8.328	6.95	8.66
11/7/2011 13:39	243	11.32	2.2706	8.329	6.94	8.65
11/7/2011 13:40	244	11.32	2.2683	8.327	6.94	8.65
11/7/2011 13:41	245	11.32	2.2669	8.329	6.95	8.66
11/7/2011 13:42	246	11.32	2.2685	8.328	6.94	8.65
11/7/2011 13:43	247	11.32	2.2656	8.327	6.95	8.66
11/7/2011 13:44	248	11.32	2.2666	8.325	6.95	8.66
11/7/2011 13:45	249	11.32	2.2674	8.328	6.94	8.66
11/7/2011 13:46	250	11.32	2.2648	8.326	6.95	8.66
11/7/2011 13:47	251	11.32	2.2614	8.324	6.95	8.66
11/7/2011 13:48	252	11.32	2.268	8.325	6.94	8.65
11/7/2011 13:49	253	11.32	2.2671	8.325	6.95	8.66
11/7/2011 13:50	254	11.32	2.267	8.324	6.95	8.66
11/7/2011 13:51	255	11.32	2.2672	8.325	6.95	8.66
11/7/2011 13:52	256	11.32	2.2641	8.325	6.95	8.66
11/7/2011 13:53	257	11.32	2.2627	8.322	6.95	8.66
11/7/2011 13:54	258	11.32	2.2626	8.323	6.95	8.66
11/7/2011 13:55	259	11.32	2.2619	8.323	6.95	8.66
11/7/2011 13:56	260	11.32	2.2592	8.323	6.95	8.66
11/7/2011 13:57	261	11.32	2.2574	8.323	6.95	8.67
11/7/2011 13:58	262	11.32	2.2569	8.324	6.96	8.67
11/7/2011 13:59	263	11.32	2.2554	8.325	6.96	8.67
11/7/2011 14:00	264	11.32	2.2563	8.325	6.96	8.67

Notes:
Datalogger installed at 10.7 m below top of casing
Static WL 1.715 m below top of casing
Start of Test 11/7/2011 9:36
End of Test 11/7/2011 15:52

<u>Date/Time</u>	<u>Time (min)</u>	<u>Pumping Rate (L/min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 14:01	265	11.32	2.254	8.325	6.96	8.67
11/7/2011 14:02	266	11.32	2.2532	8.325	6.96	8.67
11/7/2011 14:03	267	11.32	2.2524	8.326	6.96	8.67
11/7/2011 14:04	268	11.32	2.2527	8.323	6.96	8.67
11/7/2011 14:05	269	11.32	2.255	8.324	6.96	8.67
11/7/2011 14:06	270	11.32	2.2603	8.324	6.95	8.66
11/7/2011 14:07	271	11.32	2.2666	8.323	6.95	8.66
11/7/2011 14:08	272	11.32	2.2644	8.323	6.95	8.66
11/7/2011 14:09	273	11.32	2.2591	8.324	6.95	8.66
11/7/2011 14:10	274	11.32	2.2597	8.323	6.95	8.66
11/7/2011 14:11	275	11.32	2.2673	8.323	6.94	8.66
11/7/2011 14:12	276	11.32	2.2688	8.323	6.94	8.65
11/7/2011 14:13	277	11.32	2.2683	8.323	6.94	8.65
11/7/2011 14:14	278	11.32	2.2668	8.326	6.95	8.66
11/7/2011 14:15	279	11.32	2.2637	8.326	6.95	8.66
11/7/2011 14:16	280	11.32	2.2614	8.327	6.95	8.66
11/7/2011 14:17	281	11.32	2.2614	8.326	6.95	8.66
11/7/2011 14:18	282	11.32	2.2593	8.326	6.95	8.66
11/7/2011 14:19	283	11.32	2.2574	8.326	6.95	8.67
11/7/2011 14:20	284	11.32	2.2561	8.327	6.96	8.67
11/7/2011 14:21	285	11.32	2.2521	8.328	6.96	8.67
11/7/2011 14:22	286	11.32	2.251	8.328	6.96	8.67
11/7/2011 14:23	287	11.32	2.2496	8.328	6.96	8.67
11/7/2011 14:24	288	11.32	2.2495	8.328	6.96	8.67
11/7/2011 14:25	289	11.32	2.2451	8.326	6.97	8.68
11/7/2011 14:26	290	11.32	2.2456	8.324	6.97	8.68
11/7/2011 14:27	291	11.32	2.2409	8.324	6.97	8.68
11/7/2011 14:28	292	11.32	2.2357	8.324	6.98	8.69
11/7/2011 14:29	293	11.32	2.2326	8.323	6.98	8.69
11/7/2011 14:30	294	11.32	2.2279	8.324	6.98	8.69
11/7/2011 14:31	295	11.32	2.2234	8.323	6.99	8.70
11/7/2011 14:32	296	11.32	2.22	8.323	6.99	8.70
11/7/2011 14:33	297	11.32	2.2181	8.324	6.99	8.70
11/7/2011 14:34	298	11.32	2.2158	8.325	7.00	8.71
11/7/2011 14:35	299	11.32	2.2142	8.325	7.00	8.71
11/7/2011 14:36	300	11.32	2.21	8.323	7.00	8.71
11/7/2011 14:37	301	11.32	2.2086	8.321	7.00	8.71
11/7/2011 14:38	302	11.32	2.2082	8.32	7.00	8.71
11/7/2011 14:39	303	11.32	2.2061	8.319	7.01	8.72
11/7/2011 14:40	304	11.32	2.2045	8.319	7.01	8.72
11/7/2011 14:41	305	11.32	2.2053	8.321	7.01	8.72
11/7/2011 14:42	306	11.32	2.2047	8.321	7.01	8.72
11/7/2011 14:43	307	11.32	2.2041	8.32	7.01	8.72
11/7/2011 14:44	308	11.32	2.204	8.32	7.01	8.72
11/7/2011 14:45	309	11.32	2.2036	8.32	7.01	8.72
11/7/2011 14:46	310	11.32	2.2015	8.321	7.01	8.72
11/7/2011 14:47	311	11.32	2.2003	8.322	7.01	8.72
11/7/2011 14:48	312	11.32	2.2016	8.321	7.01	8.72
11/7/2011 14:49	313	11.32	2.2012	8.323	7.01	8.72
11/7/2011 14:50	314	11.32	2.2013	8.322	7.01	8.72
11/7/2011 14:51	315	11.32	2.1999	8.322	7.01	8.72
11/7/2011 14:52	316	11.32	2.1992	8.323	7.01	8.72
11/7/2011 14:53	317	11.32	2.1982	8.324	7.01	8.72

PW11-1

Notes:**Datalogger installed at 10.7 m below top of casing****Static WL** 1.715 m below top of casing**Start of Test** 11/7/2011 9:36**End of Test** 11/7/2011 15:52

<u>Date/Time</u>	<u>Time</u> (min)	<u>Pumping Rate</u> (L/min)	<u>Datalogger</u> Level (m)	<u>Temperature</u> (deg C)	<u>Datalogger</u> Drawdown (m)	<u>Water Level</u> (m btoc)
11/7/2011 14:54	318	11.32	2.2016	8.324	7.01	8.72
11/7/2011 14:55	319	11.32	2.2002	8.323	7.01	8.72
11/7/2011 14:56	320	11.32	2.2016	8.323	7.01	8.72
11/7/2011 14:57	321	11.32	2.1995	8.322	7.01	8.72
11/7/2011 14:58	322	11.32	2.1982	8.322	7.01	8.72
11/7/2011 14:59	323	11.32	2.197	8.32	7.02	8.73
11/7/2011 15:00	324	11.32	2.197	8.322	7.02	8.73
11/7/2011 15:01	325	11.32	2.1965	8.323	7.02	8.73
11/7/2011 15:02	326	11.32	2.1951	8.322	7.02	8.73
11/7/2011 15:03	327	11.32	2.1948	8.322	7.02	8.73
11/7/2011 15:04	328	11.32	2.2016	8.322	7.01	8.72
11/7/2011 15:05	329	11.32	2.2025	8.322	7.01	8.72
11/7/2011 15:06	330	11.32	2.2011	8.32	7.01	8.72
11/7/2011 15:07	331	11.32	2.2023	8.32	7.01	8.72
11/7/2011 15:08	332	11.32	2.2028	8.321	7.01	8.72
11/7/2011 15:09	333	11.32	2.2007	8.321	7.01	8.72
11/7/2011 15:10	334	11.32	2.2002	8.32	7.01	8.72
11/7/2011 15:11	335	11.32	2.2009	8.321	7.01	8.72
11/7/2011 15:12	336	11.32	2.1996	8.321	7.01	8.72
11/7/2011 15:13	337	11.32	2.2004	8.323	7.01	8.72
11/7/2011 15:14	338	11.32	2.2012	8.323	7.01	8.72
11/7/2011 15:15	339	11.32	2.2026	8.322	7.01	8.72
11/7/2011 15:16	340	11.32	2.1998	8.323	7.01	8.72
11/7/2011 15:17	341	11.32	2.201	8.323	7.01	8.72
11/7/2011 15:18	342	11.32	2.1959	8.321	7.02	8.73
11/7/2011 15:19	343	11.32	2.1975	8.322	7.01	8.72
11/7/2011 15:20	344	11.32	2.1974	8.322	7.01	8.73
11/7/2011 15:21	345	11.32	2.1978	8.321	7.01	8.72
11/7/2011 15:22	346	11.32	2.1979	8.319	7.01	8.72
11/7/2011 15:23	347	11.32	2.1953	8.319	7.02	8.73
11/7/2011 15:24	348	11.32	2.1944	8.32	7.02	8.73
11/7/2011 15:25	349	11.32	2.195	8.319	7.02	8.73
11/7/2011 15:26	350	11.32	2.1934	8.319	7.02	8.73
11/7/2011 15:27	351	11.32	2.1941	8.32	7.02	8.73
11/7/2011 15:28	352	11.32	2.1922	8.321	7.02	8.73
11/7/2011 15:29	353	11.32	2.1914	8.322	7.02	8.73
11/7/2011 15:30	354	11.32	2.1921	8.32	7.02	8.73
11/7/2011 15:31	355	11.32	2.1904	8.32	7.02	8.73
11/7/2011 15:32	356	11.32	2.1891	8.319	7.02	8.73
11/7/2011 15:33	357	11.32	2.1903	8.32	7.02	8.73
11/7/2011 15:34	358	11.32	2.1905	8.32	7.02	8.73
11/7/2011 15:35	359	11.32	2.1936	8.32	7.02	8.73
11/7/2011 15:36	360	11.32	2.192	8.32	7.02	8.73
11/7/2011 15:37	361	11.32	2.1935	8.319	7.02	8.51
11/7/2011 15:38	362	11.32	2.1935	8.319	7.02	8.73
11/7/2011 15:39	363	11.32	2.1939	8.32	7.02	8.73
11/7/2011 15:40	364	11.32	2.1944	8.321	7.02	8.73
11/7/2011 15:41	365	11.32	2.1927	8.319	7.02	8.73
11/7/2011 15:42	366	11.32	2.192	8.319	7.02	8.73
11/7/2011 15:43	367	11.32	2.1906	8.319	7.02	8.73
11/7/2011 15:44	368	11.32	2.1884	8.321	7.02	8.73
11/7/2011 15:45	369	11.32	2.1874	8.321	7.02	8.74
11/7/2011 15:46	370	11.32	2.1888	8.32	7.02	8.73

Golder Associates

PW11-1

Notes:**Datalogger installed at 10.7 m below top of casing****Static WL**

1.715 m below top of casing

Start of Test

11/7/2011 9:36

End of Test

11/7/2011 15:52

<u>Date/Time</u>	<u>Time (min)</u>	<u>Pumping Rate (L/min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 15:47	371	11.32	2.1896	8.317	7.02	8.73
11/7/2011 15:48	372	11.32	2.186	8.319	7.03	8.74
11/7/2011 15:49	373	11.32	2.1858	8.319	7.03	8.74
11/7/2011 15:50	374	11.32	2.182	8.318	7.03	8.74
11/7/2011 15:51	375	11.32	2.1814	8.318	7.03	8.74
11/7/2011 15:52	376	0	2.1782	8.317	7.03	8.74
11/7/2011 15:53	377	0	2.7355	8.308	6.48	8.19
11/7/2011 15:54	378	0	3.2417	8.293	5.97	7.68
11/7/2011 15:55	379	0	3.7198	8.28	5.49	7.20
11/7/2011 15:56	380	0	4.1715	8.272	5.04	6.75
11/7/2011 15:57	381	0	4.5965	8.268	4.62	6.33
11/7/2011 15:58	382	0	4.9962	8.263	4.22	5.93
11/7/2011 15:59	383	0	5.374	8.261	3.84	5.55
11/7/2011 16:00	384	0	5.7259	8.258	3.49	5.20
11/7/2011 16:01	385	0	6.0546	8.256	3.16	4.87
11/7/2011 16:02	386	0	6.3606	8.255	2.85	4.56
11/7/2011 16:03	387	0	6.6445	8.255	2.57	4.28
11/7/2011 16:04	388	0	6.9091	8.254	2.30	4.01
11/7/2011 16:05	389	0	7.1517	8.252	2.06	3.77
11/7/2011 16:06	390	0	7.3772	8.253	1.84	3.55
11/7/2011 16:07	391	0	7.5812	8.251	1.63	3.34
11/7/2011 16:08	392	0	7.7687	8.25	1.44	3.15
11/7/2011 16:09	393	0	7.9376	8.251	1.27	2.98
11/7/2011 16:10	394	0	8.0927	8.25	1.12	2.83
11/7/2011 16:11	395	0	8.2311	8.25	0.98	2.69
11/7/2011 16:12	396	0	8.355	8.25	0.86	2.57
11/7/2011 16:13	397	0	8.4663	8.249	0.75	2.46
11/7/2011 16:14	398	0	8.5647	8.249	0.65	2.36
11/7/2011 16:15	399	0	8.65	8.25	0.56	2.27
11/7/2011 16:16	400	0	8.7241	8.249	0.49	2.20
11/7/2011 16:17	401	0	8.787	8.249	0.43	2.14
11/7/2011 16:18	402	0	8.8317	8.249	0.38	2.09
11/7/2011 16:19	403	0	8.8712	8.25	0.34	2.05
11/7/2011 16:20	404	0	8.9085	8.25	0.30	2.01
11/7/2011 16:21	405	0	8.9433	8.25	0.27	1.98
11/7/2011 16:22	406	0	8.9724	8.25	0.24	1.95
11/7/2011 16:23	407	0	8.9973	8.25	0.21	1.93
11/7/2011 16:24	408	0	9.0187	8.25	0.19	1.90
11/7/2011 16:25	409	0	9.0368	8.25	0.18	1.89
11/7/2011 16:26	410	0	9.0535	8.25	0.16	1.87
11/7/2011 16:27	411	0	9.0682	8.25	0.14	1.85
11/7/2011 16:28	412	0	9.0801	8.252	0.13	1.84
11/7/2011 16:29	413	0	9.0906	8.252	0.12	1.83
11/7/2011 16:30	414	0	9.0998	8.252	0.11	1.82
11/7/2011 16:31	415	0	9.1077	8.252	0.10	1.81
11/7/2011 16:32	416	0	9.1148	8.253	0.10	1.81
11/7/2011 16:33	417	0	9.1208	8.254	0.09	1.80
11/7/2011 16:34	418	0	9.1258	8.258	0.09	1.80
11/7/2011 16:35	419	0	9.1298	8.258	0.08	1.79
11/7/2011 16:36	420	0	9.134	8.261	0.08	1.79
11/7/2011 16:37	421	0	9.1381	8.262	0.07	1.78
11/7/2011 16:38	422	0	9.1406	8.263	0.07	1.78

Residential Well

Notes
Datalogger installed at 10 m below top of casing
Static WL 2.39 m below top of casing

<u>Date/Time</u>	<u>Time (min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 9:35		8.8294	9.528	0	2.390
11/7/2011 9:40	4	8.8286	9.54	0.001	2.391
11/7/2011 9:45	9	8.6027	9.568	0.227	2.617
11/7/2011 9:50	14	8.7893	9.659	0.040	2.430
11/7/2011 9:55	19	8.8033	9.683	0.026	2.416
11/7/2011 10:00	24	8.805	9.667	0.024	2.414
11/7/2011 10:05	29	8.8025	9.625	0.027	2.417
11/7/2011 10:10	34	8.8014	9.611	0.028	2.418
11/7/2011 10:15	39	8.5922	9.647	0.237	2.627
11/7/2011 10:20	44	8.78	9.69	0.049	2.439
11/7/2011 10:25	49	8.7933	9.689	0.036	2.426
11/7/2011 10:30	54	8.7939	9.682	0.035	2.426
11/7/2011 10:35	59	8.7939	9.665	0.035	2.426
11/7/2011 10:40	64	8.7933	9.65	0.036	2.426
11/7/2011 10:45	69	8.7932	9.629	0.036	2.426
11/7/2011 10:50	74	8.7908	9.611	0.039	2.429
11/7/2011 10:55	79	8.7901	9.588	0.039	2.429
11/7/2011 11:00	84	8.7889	9.585	0.040	2.431
11/7/2011 11:05	89	8.7875	9.574	0.042	2.432
11/7/2011 11:10	94	8.7865	9.562	0.043	2.433
11/7/2011 11:15	99	8.7849	9.55	0.044	2.435
11/7/2011 11:20	104	8.7856	9.54	0.044	2.434
11/7/2011 11:25	109	8.7846	9.527	0.045	2.435
11/7/2011 11:30	114	8.7844	9.513	0.045	2.435
11/7/2011 11:35	119	8.7841	9.5	0.045	2.435
11/7/2011 11:40	124	8.7827	9.491	0.047	2.437
11/7/2011 11:45	129	8.7821	9.478	0.047	2.437
11/7/2011 11:50	134	8.7811	9.472	0.048	2.438
11/7/2011 11:55	139	8.7805	9.468	0.049	2.439
11/7/2011 12:00	144	8.7797	9.462	0.050	2.440
11/7/2011 12:05	149	8.7796	9.453	0.050	2.440
11/7/2011 12:10	154	8.78	9.443	0.049	2.439
11/7/2011 12:15	159	8.7779	9.434	0.051	2.442
11/7/2011 12:20	164	8.7672	9.459	0.062	2.452
11/7/2011 12:25	169	8.7761	9.471	0.053	2.443
11/7/2011 12:30	174	8.7762	9.476	0.053	2.443
11/7/2011 12:35	179	8.777	9.478	0.052	2.442
11/7/2011 12:40	184	8.7776	9.48	0.052	2.442
11/7/2011 12:45	189	8.7769	9.477	0.053	2.443
11/7/2011 12:50	194	8.7761	9.471	0.053	2.443
11/7/2011 12:55	199	8.775	9.465	0.054	2.444
11/7/2011 13:00	204	8.774	9.458	0.055	2.445
11/7/2011 13:05	209	8.7739	9.453	0.056	2.446
11/7/2011 13:10	214	8.7738	9.448	0.056	2.446
11/7/2011 13:15	219	8.7091	9.556	0.120	2.510
11/7/2011 13:20	224	8.7661	9.634	0.063	2.453
11/7/2011 13:25	229	8.7713	9.621	0.058	2.448
11/7/2011 13:30	234	8.7723	9.603	0.057	2.447
11/7/2011 13:35	239	8.7708	9.598	0.059	2.449
11/7/2011 13:40	244	8.7707	9.586	0.059	2.449
11/7/2011 13:45	249	8.7713	9.572	0.058	2.448
11/7/2011 13:50	254	8.7696	9.56	0.060	2.450
11/7/2011 13:55	259	8.756	9.598	0.073	2.463
11/7/2011 14:00	264	8.7638	9.623	0.066	2.456

Golder Associates

Notes
Datalogger installed at 10 m below top of casing
Static WL 2.39 m below top of casing

<u>Date/Time</u>	<u>Time (min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 14:05	269	8.7665	9.637	0.063	2.453
11/7/2011 14:10	274	8.7675	9.609	0.062	2.452
11/7/2011 14:15	279	8.7683	9.603	0.061	2.451
11/7/2011 14:20	284	8.7683	9.589	0.061	2.451
11/7/2011 14:25	289	8.7681	9.576	0.061	2.451
11/7/2011 14:30	294	8.7681	9.563	0.061	2.451
11/7/2011 14:35	299	8.7683	9.554	0.061	2.451
11/7/2011 14:40	304	8.7667	9.544	0.063	2.453
11/7/2011 14:45	309	8.7652	9.533	0.064	2.454
11/7/2011 14:50	314	8.7658	9.519	0.064	2.454
11/7/2011 14:55	319	8.7667	9.51	0.063	2.453
11/7/2011 15:00	324	8.7665	9.501	0.063	2.453
11/7/2011 15:05	329	8.7683	9.49	0.061	2.451
11/7/2011 15:10	334	8.7686	9.483	0.061	2.451
11/7/2011 15:15	339	8.7699	9.475	0.059	2.450
11/7/2011 15:20	344	8.7694	9.467	0.060	2.450
11/7/2011 15:25	349	8.7686	9.459	0.061	2.451
11/7/2011 15:30	354	8.7679	9.451	0.062	2.452
11/7/2011 15:35	359	8.7676	9.445	0.062	2.452
11/7/2011 15:40	364	8.7679	9.438	0.062	2.452
11/7/2011 15:45	369	8.7679	9.431	0.062	2.452
11/7/2011 15:50	374	8.7679	9.425	0.062	2.452
11/7/2011 15:55	379	8.7687	9.419	0.061	2.451
11/7/2011 16:00	384	8.7741	9.412	0.055	2.445
11/7/2011 16:05	389	8.7791	9.406	0.050	2.440
11/7/2011 16:10	394	8.7851	9.4	0.044	2.434
11/7/2011 16:15	399	8.7909	9.394	0.038	2.429

Bradley Bus Well

Notes
Datalogger installed at 11 m below top of casing
Static WL 2.204 m below top of casing


<u>Date/Time</u>	<u>Time (min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 9:25		7.9923	12.015		2.20
11/7/2011 9:30		7.9903	12.003		2.20
11/7/2011 9:35		7.5706	11.959	0	2.62
11/7/2011 9:40	4	7.9793	12.093	0.000	2.22
11/7/2011 9:45	9	7.9825	12.062	-0.003	2.21
11/7/2011 9:50	14	7.9816	12.049	-0.002	2.21
11/7/2011 9:55	19	7.9815	12.077	-0.002	2.21
11/7/2011 10:00	24	7.9807	12.066	-0.001	2.21
11/7/2011 10:05	29	7.979	11.995	0.000	2.22
11/7/2011 10:10	34	7.9786	11.966	0.001	2.22
11/7/2011 10:15	39	7.9768	11.945	0.003	2.22
11/7/2011 10:20	44	7.976	11.929	0.003	2.22
11/7/2011 10:25	49	7.9765	11.924	0.003	2.22
11/7/2011 10:30	54	7.9743	11.908	0.005	2.22
11/7/2011 10:35	59	7.9734	11.899	0.006	2.22
11/7/2011 10:40	64	7.9737	11.879	0.006	2.22
11/7/2011 10:45	69	7.9704	11.869	0.009	2.22
11/7/2011 10:50	74	7.969	11.862	0.010	2.23
11/7/2011 10:55	79	7.9689	11.855	0.010	2.23
11/7/2011 11:00	84	7.9687	11.847	0.011	2.23
11/7/2011 11:05	89	7.9665	11.841	0.013	2.23
11/7/2011 11:10	94	7.9664	11.83	0.013	2.23
11/7/2011 11:15	99	7.9653	11.822	0.014	2.23
11/7/2011 11:20	104	7.9644	11.818	0.015	2.23
11/7/2011 11:25	109	7.9647	11.814	0.015	2.23
11/7/2011 11:30	114	7.9637	11.806	0.016	2.23
11/7/2011 11:35	119	7.9641	11.804	0.015	2.23
11/7/2011 11:40	124	7.9636	11.799	0.016	2.23
11/7/2011 11:45	129	7.9635	11.795	0.016	2.23
11/7/2011 11:50	134	7.9624	11.788	0.017	2.23
11/7/2011 11:55	139	7.962	11.783	0.017	2.23
11/7/2011 12:00	144	7.96	11.78	0.019	2.23
11/7/2011 12:05	149	7.9599	11.774	0.019	2.23
11/7/2011 12:10	154	7.9604	11.769	0.019	2.23
11/7/2011 12:15	159	7.9582	11.764	0.021	2.24
11/7/2011 12:20	164	7.9591	11.757	0.020	2.24
11/7/2011 12:25	169	7.9578	11.749	0.022	2.24
11/7/2011 12:30	174	7.958	11.748	0.021	2.24
11/7/2011 12:35	179	7.9573	11.741	0.022	2.24
11/7/2011 12:40	184	7.9583	11.732	0.021	2.24
11/7/2011 12:45	189	7.9579	11.729	0.021	2.24
11/7/2011 12:50	194	7.9568	11.725	0.023	2.24
11/7/2011 12:55	199	7.948	11.783	0.031	2.25
11/7/2011 13:00	204	7.9555	11.838	0.024	2.24
11/7/2011 13:05	209	7.9567	11.803	0.023	2.24
11/7/2011 13:10	214	7.9579	11.801	0.021	2.24
11/7/2011 13:15	219	7.9558	11.813	0.024	2.24
11/7/2011 13:20	224	7.9564	11.798	0.023	2.24
11/7/2011 13:25	229	7.9566	11.794	0.023	2.24
11/7/2011 13:30	234	7.8888	11.788	0.091	2.31
11/7/2011 13:35	239	7.9467	11.849	0.033	2.25
11/7/2011 13:40	244	7.954	11.959	0.025	2.24
11/7/2011 13:45	249	7.5155	11.926	0.464	2.68
11/7/2011 13:50	254	7.9462	12.151	0.033	2.25

Golder Associates


Notes Datalogger installed at 11 m below top of casing Static WL 2.204 m below top of casing

<u>Date/Time</u>	<u>Time (min)</u>	<u>Datalogger Level (m)</u>	<u>Temperature (deg C)</u>	<u>Datalogger Drawdown (m)</u>	<u>Water Level (m btoc)</u>
11/7/2011 13:55	259	7.9399	11.935	0.039	2.25
11/7/2011 14:00	264	7.9261	11.884	0.053	2.27
11/7/2011 14:05	269	7.9455	11.953	0.034	2.25
11/7/2011 14:10	274	7.9513	11.976	0.028	2.24
11/7/2011 14:15	279	7.9529	12.056	0.026	2.24
11/7/2011 14:20	284	7.9232	11.893	0.056	2.27
11/7/2011 14:25	289	7.9477	11.936	0.032	2.25
11/7/2011 14:30	294	7.9521	12.006	0.027	2.24
11/7/2011 14:35	299	7.9354	11.868	0.044	2.26
11/7/2011 14:40	304	7.5824	11.899	0.397	2.61
11/7/2011 14:45	309	7.9433	12.073	0.036	2.25
11/7/2011 14:50	314	7.9445	12.18	0.035	2.25
11/7/2011 14:55	319	7.9478	12.144	0.032	2.25
11/7/2011 15:00	324	7.9486	12.076	0.031	2.25
11/7/2011 15:05	329	7.9488	12.046	0.031	2.25
11/7/2011 15:10	334	7.9508	12.013	0.029	2.24
11/7/2011 15:15	339	7.9513	12.002	0.028	2.24
11/7/2011 15:20	344	7.9509	11.961	0.028	2.24
11/7/2011 15:25	349	7.9511	11.947	0.028	2.24
11/7/2011 15:30	354	7.9507	11.925	0.029	2.24
11/7/2011 15:35	359	7.9509	11.912	0.028	2.24
11/7/2011 15:40	364	7.9512	11.902	0.028	2.24
11/7/2011 15:45	369	7.9509	11.89	0.028	2.24
11/7/2011 15:50	374	7.9514	11.878	0.028	2.24
11/7/2011 15:55	379	7.9517	11.865	0.028	2.24
11/7/2011 16:00	384	7.9525	11.857	0.027	2.24
11/7/2011 16:05	389	7.9537	11.857	0.026	2.24
11/7/2011 16:10	394	7.9547	11.846	0.025	2.24
11/7/2011 16:15	399	7.9561	11.837	0.023	2.24
11/7/2011 16:20	404	7.9573	11.826	0.022	2.24
11/7/2011 16:25	409	7.9596	11.818	0.020	2.23
11/7/2011 16:30	414	7.9603	11.81	0.019	2.23
11/7/2011 16:35	419	7.9609	11.801	0.018	2.23
11/7/2011 16:40	424	7.9641	11.792	0.015	2.23
11/7/2011 16:45	429	7.963	11.79	0.016	2.23


PW11-1 Cooper and Jacob

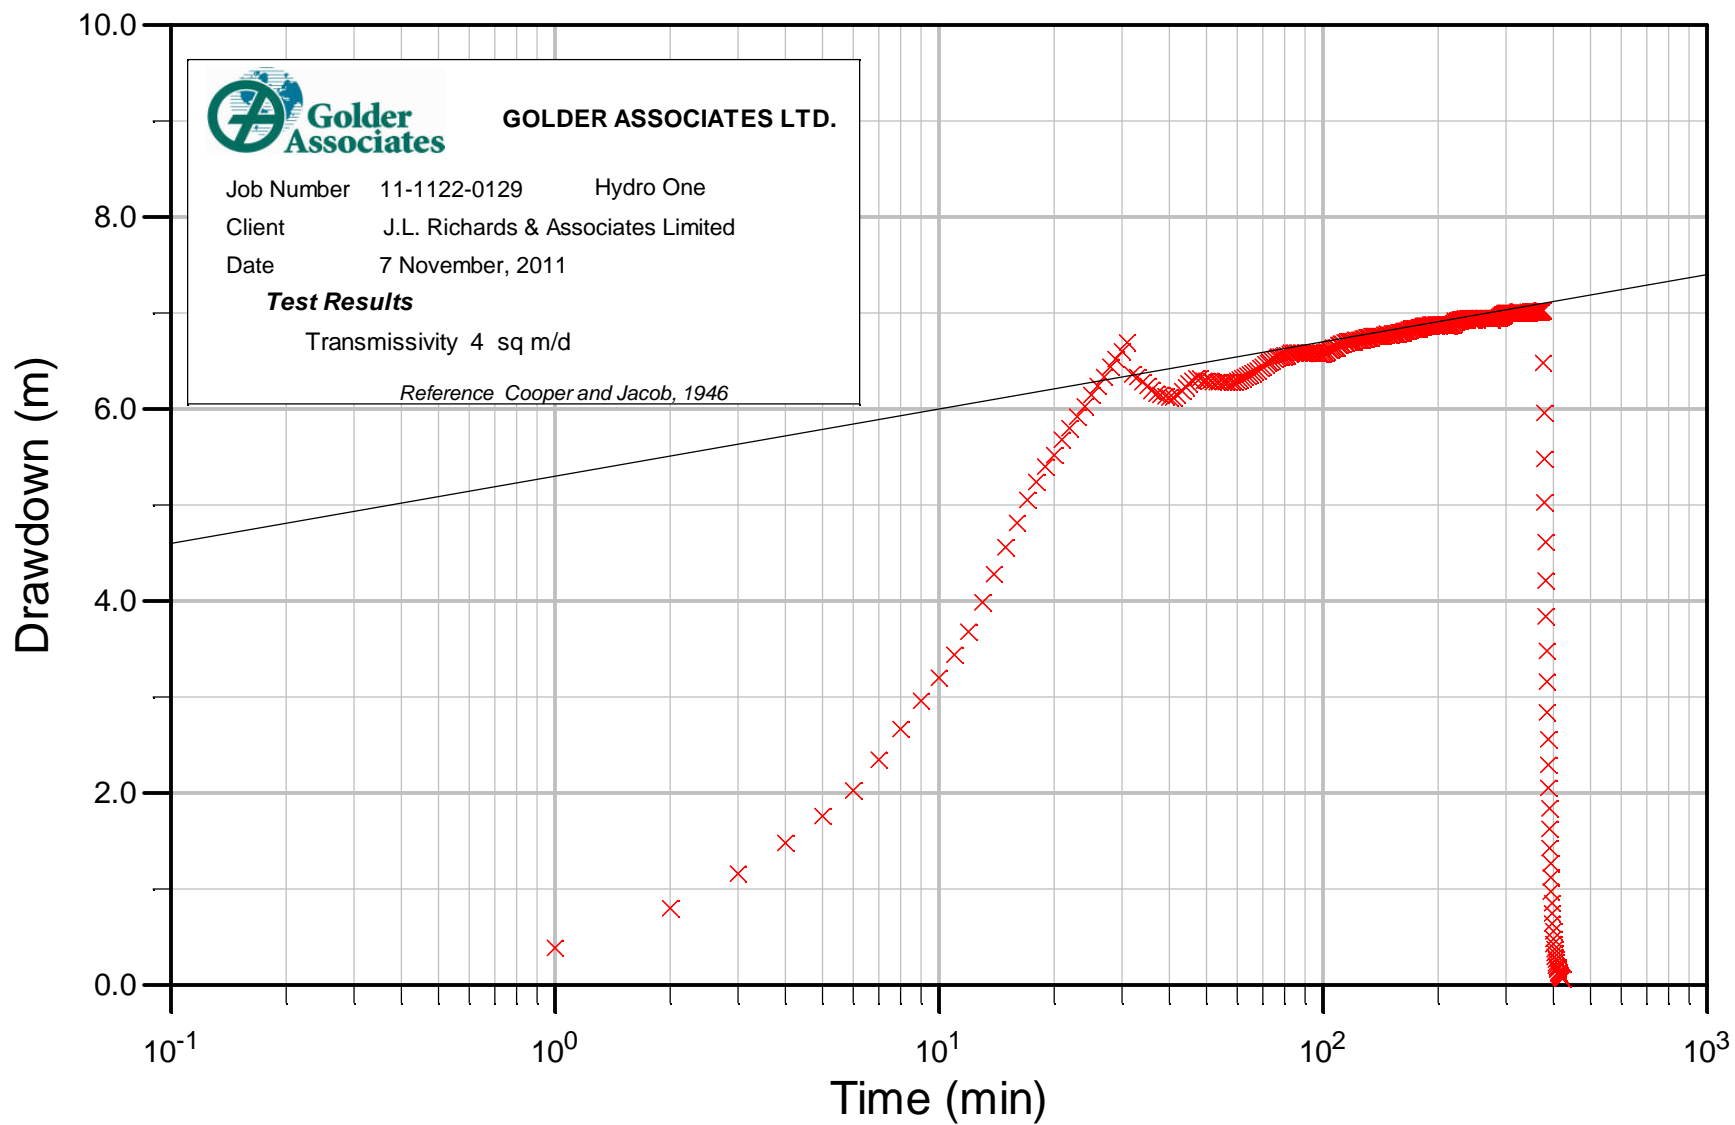


PW11-1 Theis Recovery

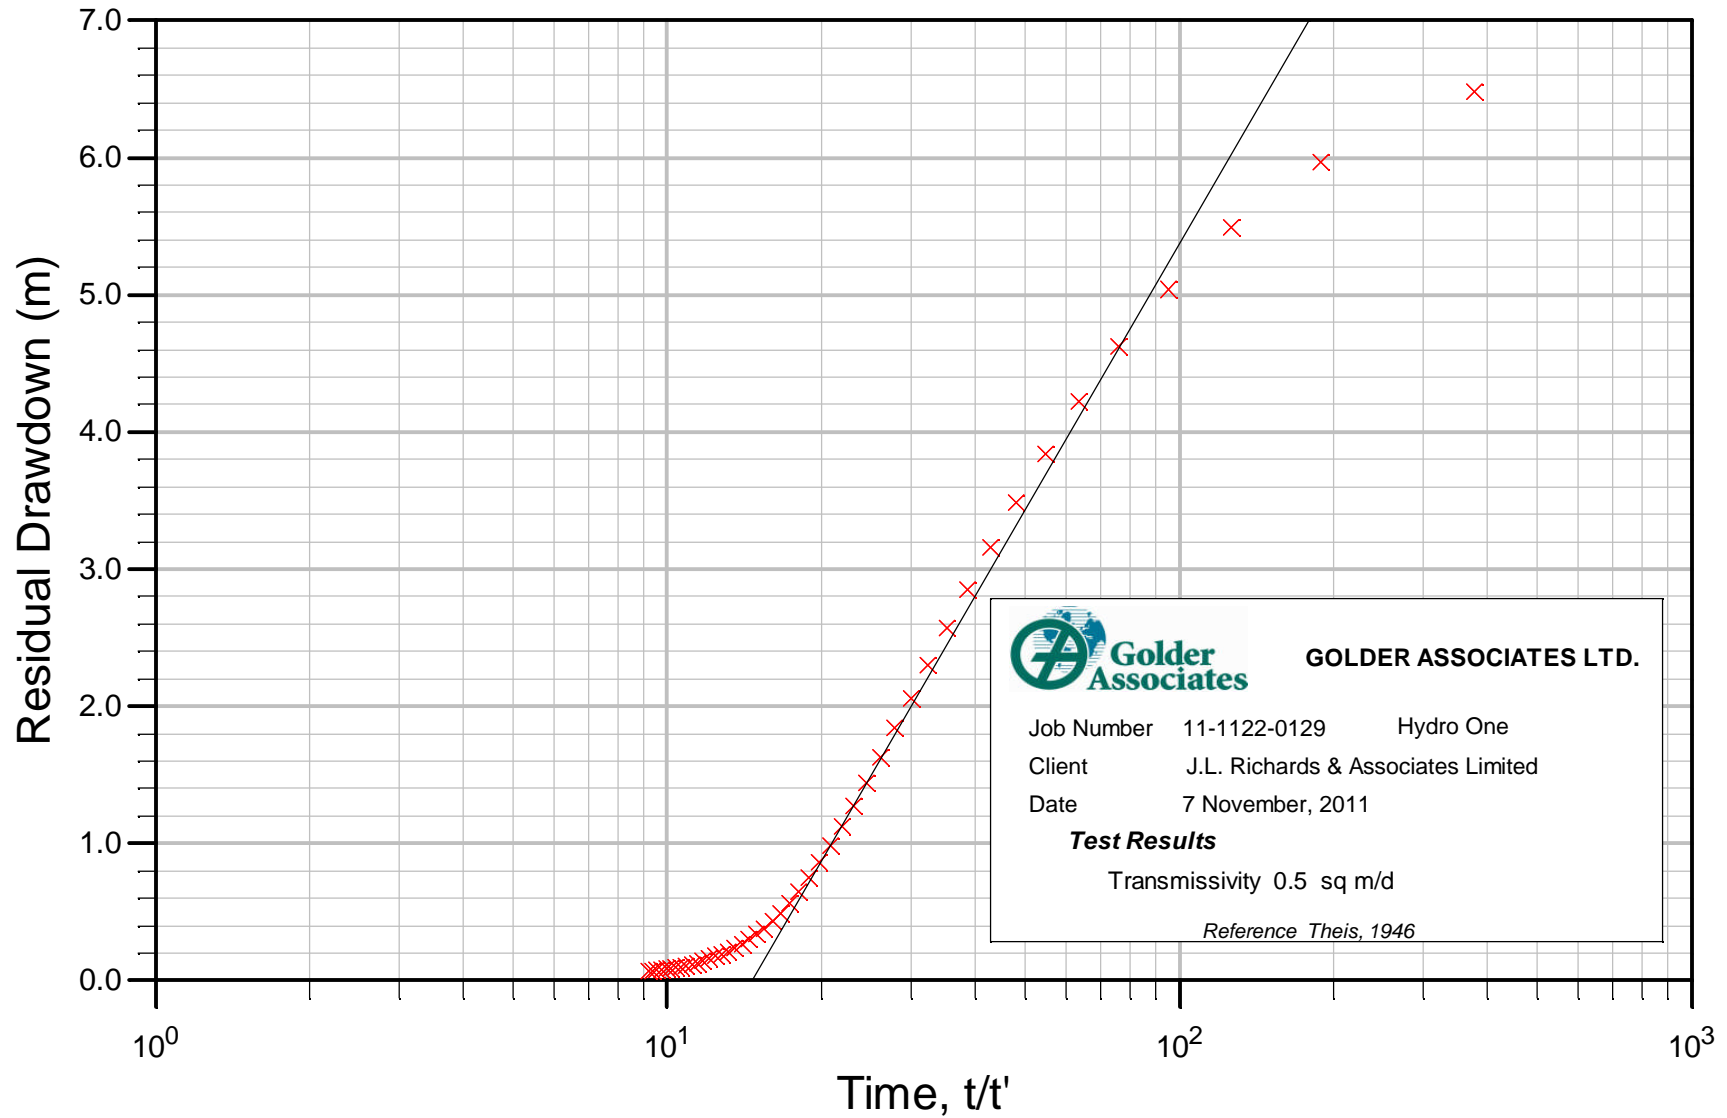

Bus Depot - Cooper and Jacob

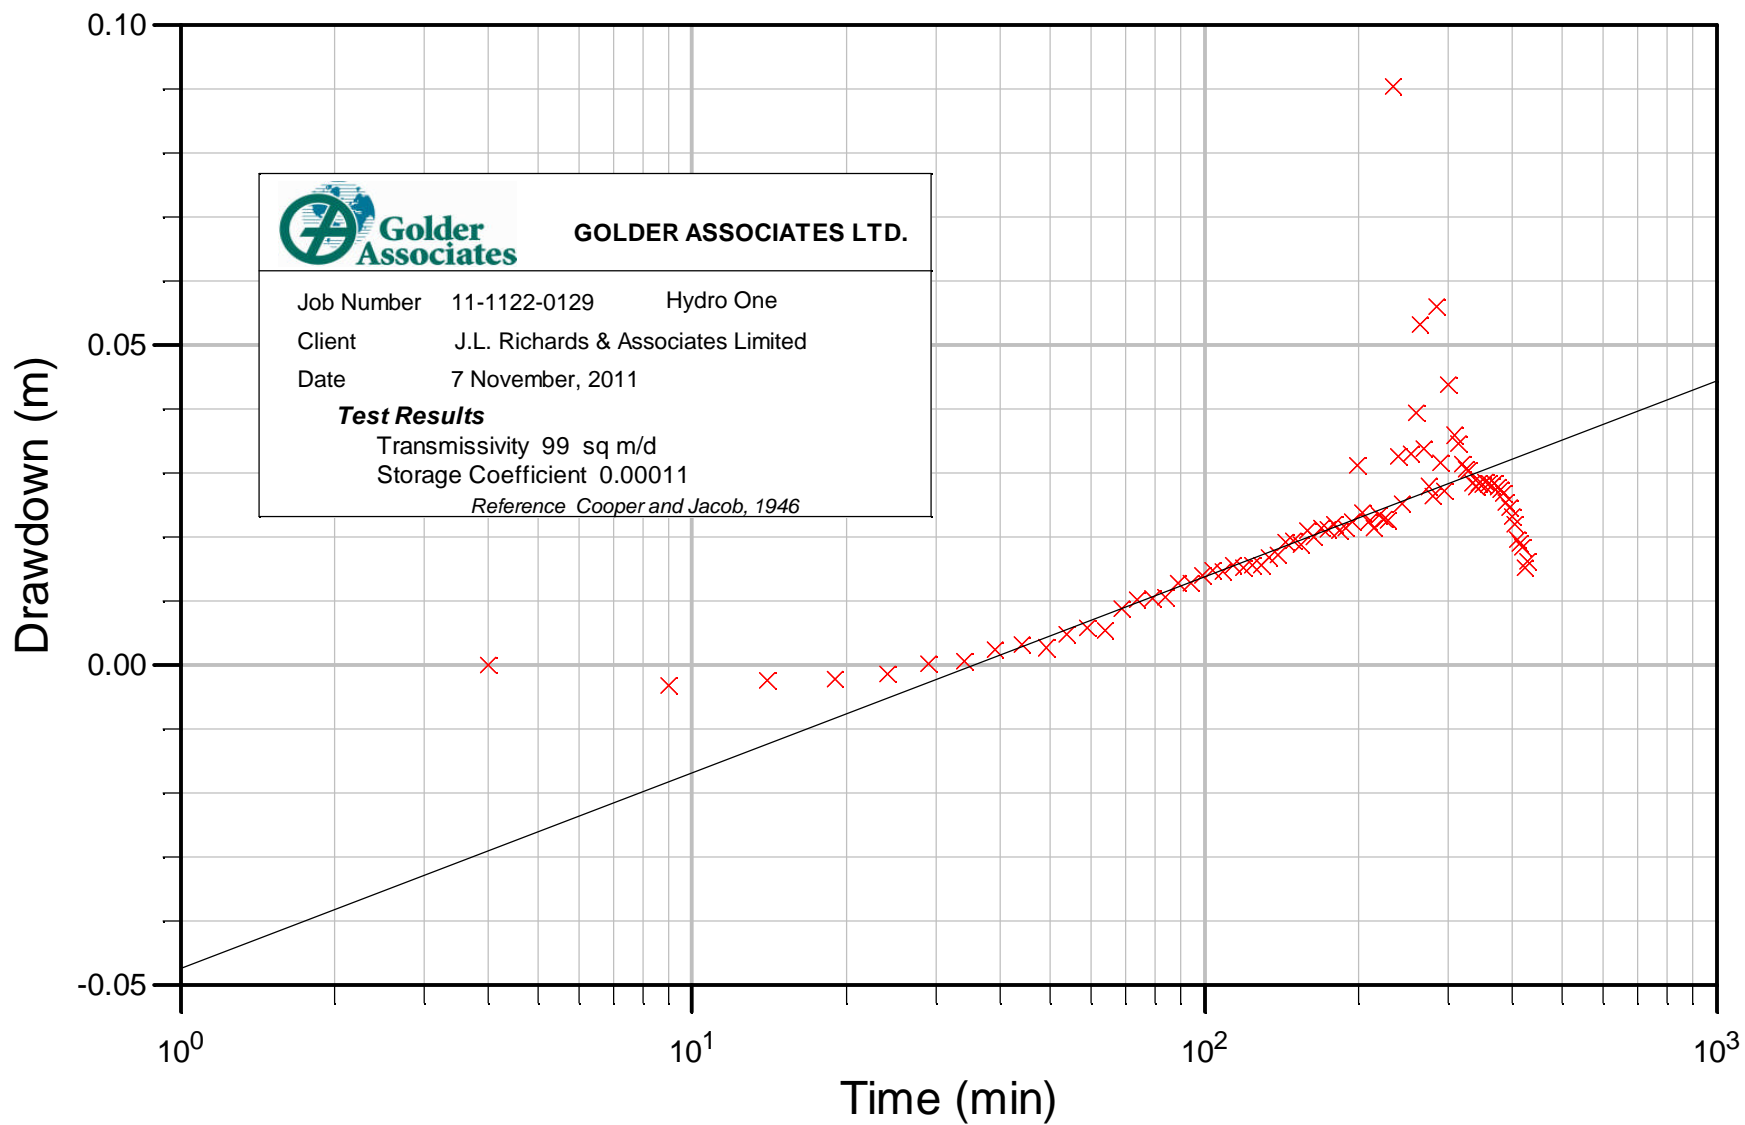

Residential Well - Cooper and Jacob

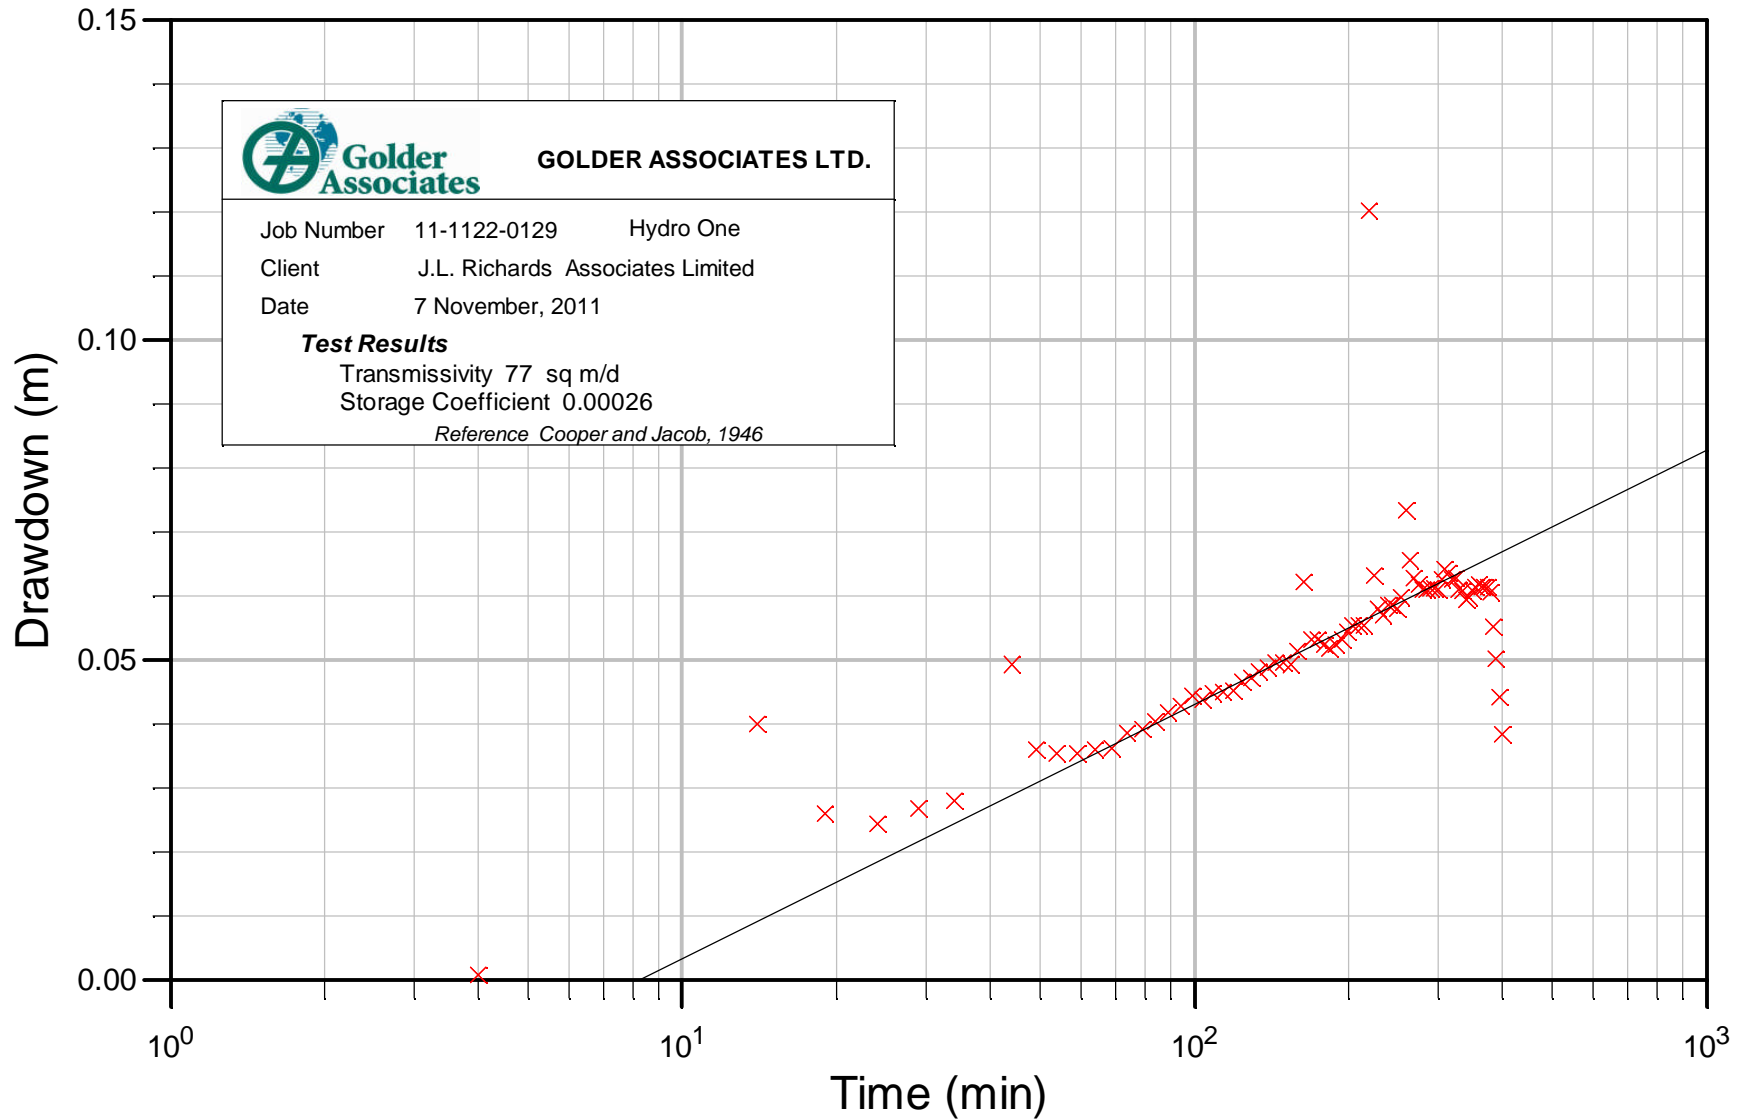



APPENDIX F

Laboratory Certificates of Analysis

Client: Golder Associates Ltd. (Ottawa)
32 Steacie Drive

Kanata, ON
K2K 2A9

Attention: Ms. Caitlin Cooke

Report Number: 1126039
Date: 2011-11-10
Date Submitted: 2011-11-07

Project: 11-1122-0129

P.O. Number:
Matrix: Water

Chain of Custody Number: 155926

PARAMETER	UNITS	MRL	LAB ID:	923194	923195	923196	923197	GUIDELINE		
			Sample Date:	2011-11-07	2011-11-07	2011-11-07	2011-11-07	ODWSOG		
			Sample ID:	S-1	S-2	S-3	S-4			
Total Coliforms	CFU/100mL			5	12	0	2	MAC	0	CFU/100mL
Escherichia Coli	CFU/100mL			0	0	0	0	MAC	0	CFU/100mL
Heterotrophic Plate Count	CFU/1mL			12	5	18	12			
Faecal Coliforms	CFU/100mL			0	0	0	0			
Faecal Streptococcus	CFU/100mL			0	0	0	0			

MRL = Method Reporting Limit INC = Incomplete AO = Aesthetic Objective OG = Operational Guideline MAC = Maximum Allowable Concentration IMAC = Interim Maximum Allowable Concentration

Comment:

Methods references and/or additional QA/QC information available on request.

APPROVAL:
Krsta Quantrill
Microbiology Lab Supervisor

Client: Golder Associates Ltd. (Ottawa)
32 Steacie Drive

Kanata, ON
K2K 2A9

Attention: Ms. Caitlin Cooke

Report Number: 1126052
Date: 2011-11-14
Date Submitted: 2011-11-07

Project: 11-1122-0129

P.O. Number:
Matrix: Water


Chain of Custody Number: 155926

PARAMETER	UNITS	MRL	LAB ID:	923239	923240	923241	923242	GUIDELINE	TYPE	LIMIT	UNITS
			Sample Date:	2011-11-07	2011-11-07	2011-11-07	2011-11-07				
								ODWSOG			
Alkalinity as CaCO3	mg/L	5		284	312	332	295		OG	500	mg/L
Chloride	mg/L	1		89	80	104	90		AO	250	mg/L
Colour	TCU	2		<2	<2	2	<2		AO	5	TCU
Conductivity	uS/cm	5		848	992	1000	853				
Dissolved Organic Carbon	mg/L	0.5		1.5	1.3	1.6	1.2		AO	5	mg/L
Fluoride	mg/L	0.1		0.29	0.11	<0.10	0.27		MAC	1.5	mg/L
Hydrogen Sulphide	mg/L	0.01		2.88	0.14	<0.01	<0.10		AO	0.05	mg/L
N-NH3 (Ammonia)	mg/L	0.02		0.76	0.14	0.07	0.70				
N-NO2 (Nitrite)	mg/L	0.1		<0.10	<0.10	<0.10	<0.10		MAC	1.0	mg/L
N-NO3 (Nitrate)	mg/L	0.1		0.14	<0.10	<0.10	<0.10		MAC	10.0	mg/L
pH				7.96	7.91	7.90	8.03			6.5-8.5	
Phenols	mg/L	0.001		0.002	<0.001	<0.001	<0.001				
Sulphate	mg/L	1		22	95	43	22		AO	500	mg/L
Tannin & Lignin	mg/L	0.1		<0.1	<0.1	<0.1	<0.1				
Total Dissolved Solids (COND - CALC)	mg/L	1		551	645	650	554		AO	500	mg/L
Total Kjeldahl Nitrogen	mg/L	0.1		0.74	0.26	<0.10	0.87				
Turbidity	NTU	0.1		102	28.4	7.6	37.1		MAC	1.0	NTU
Hardness as CaCO3	mg/L	1		297	471	439	279		OG	100	mg/L
Ion Balance		0.01		1.04	1.08	1.06	0.94				
Calcium	mg/L	1		76	169	156	74				
Magnesium	mg/L	1		26	12	12	23				
Potassium	mg/L	1		8	3	2	6				
Sodium	mg/L	2		66	41	51	60		AO	200	mg/L
Iron	mg/L	0.03		1.48	1.86	0.82	0.35		AO	0.3	mg/L
Manganese	mg/L	0.01		0.05	0.08	0.05	0.03		AO	0.05	mg/L

MRL = Method Reporting Limit INC = incomplete AO = Aesthetic Objective OG = Operational Guideline MAC = Maximum Allowable Concentration IMAC = Interim Maximum Allowable Concentration

Comment:

923242: H2S MRL elevated due to sample turbidity.

APPROVAL: 
Lorna Wilson
Inorganic Lab Supervisor

Methods references and/or additional QA/QC information available on request.

Client: Golder Associates Ltd. (Ottawa)
32 Steacie Drive

Kanata, ON
K2K 2A9

Attention: Ms. Caitlin Cooke

Report Number: 1126052
Date: 2011-11-14
Date Submitted: 2011-11-07


Project: 11-1122-0129

P.O. Number:
Matrix: Water

Chain of Custody Number: 155926

PARAMETER	UNITS	MRL	LAB ID:				GUIDELINE		
			LAB BLANK	LAB QC % RECOVERY	QC RECOVERY RANGE	DATE ANALYSED	ODWSOG		
							TYPE	LIMIT	UNITS
Alkalinity as CaCO3	mg/L	5	<5	101	95-105	2011-11-09	OG	500	mg/L
Chloride	mg/L	1	<1	99	90-112	2011-11-10	AO	250	mg/L
Colour	TCU	2	<2	100	80-120	2011-11-09	AO	5	TCU
Conductivity	uS/cm	5	<5	99	95-105	2011-11-09			
Dissolved Organic Carbon	mg/L	0.5	<0.5	90	84-116	2011-11-10	AO	5	mg/L
Fluoride	mg/L	0.1	<0.10	100	90-110	2011-11-09	MAC	1.5	mg/L
Hydrogen Sulphide	mg/L	0.01	<0.01	84	33-166	2011-11-14	AO	0.05	mg/L
N-NH3 (Ammonia)	mg/L	0.02	<0.02	95	85-115	2011-11-08			
N-NO2 (Nitrite)	mg/L	0.1	<0.10	93	80-120	2011-11-10	MAC	1.0	mg/L
N-NO3 (Nitrate)	mg/L	0.1	<0.10	108	80-120	2011-11-10	MAC	10.0	mg/L
pH			5.78	99	90-110	2011-11-09		6.5-8.5	
Phenols	mg/L	0.001	<0.001	112	73-127	2011-11-11			
Sulphate	mg/L	1	<1	98	90-110	2011-11-10	AO	500	mg/L
Tannin & Lignin	mg/L	0.1	<0.1	94	80-120	2011-11-10			
Total Dissolved Solids (COND - CALC)	mg/L	1	<1		-	2011-11-14	AO	500	mg/L
Total Kjeldahl Nitrogen	mg/L	0.1	<0.10	97	77-123	2011-11-11			
Turbidity	NTU	0.1	<0.1	100	73-127	2011-11-08	MAC	1.0	NTU
Hardness as CaCO3	mg/L	1	<1		-	2011-11-14	OG	100	mg/L
Ion Balance		0.01	<0.01		-	2011-11-14			
Calcium	mg/L	1	<1	100	80-120	2011-11-09			
Magnesium	mg/L	1	<1	98	80-120	2011-11-09			
Potassium	mg/L	1	<1	100	80-120	2011-11-09			
Sodium	mg/L	2	<2	100	80-120	2011-11-09	AO	200	mg/L
Iron	mg/L	0.03	<0.03	108	88-112	2011-11-08	AO	0.3	mg/L
Manganese	mg/L	0.01	<0.01	100	91-109	2011-11-08	AO	0.05	mg/L

MRL = Method Reporting Limit INC = Incomplete AO = Aesthetic Objective OG = Operational Guideline MAC = Maximum Allowable Concentration IMAC = Interim Maximum Allowable Concentration
Comment:

APPROVAL: 
Lorna Wilson
Inorganic Lab Supervisor

Methods references and/or additional QA/QC information available on request.

Client: Golder Associates Ltd. (Ottawa)
32 Steacie Drive

Kanata, ON
K2K 2A9

Attention: Ms. Caitlin Cooke

Report Number: 1126582
Date: 2011-11-16
Date Submitted: 2011-11-14


Project: 11-1122-0124

P.O. Number:
Matrix: Groundwater

Chain of Custody Number: 156190

PARAMETER			UNITS	MRL	GUIDELINE			TYPE	LIMIT	UNITS	
N-NO3 (Nitrate)			mg/L	0.1	<0.10	ODWSOG			MAC	10.0	mg/L

MRL = Method Reporting Limit INC = Incomplete AO = Aesthetic Objective OG = Operational Guideline MAC = Maximum Allowable Concentration IMAC = Interim Maximum Allowable Concentration
Comment:

APPROVAL: 
Lorna Wilson
Inorganic Lab Supervisor

Methods references and/or additional QA/QC information available on request.

Client: **Golder Associates Ltd. (Ottawa)**
32 Steacie Drive

Kanata, ON
K2K 2A9

Attention: **Ms. Caitlin Cooke**

Report Number: 1126582
Date: 2011-11-16
Date Submitted: 2011-11-14


Project: 11-1122-0124

P.O. Number:
Matrix: Groundwater

Chain of Custody Number: 156190

PARAMETER	UNITS	MRL	LAB ID:					GUIDELINE			
			Sample Date:	Sample ID:	LAB BLANK	LAB QC % RECOVERY	QC RECOVERY RANGE	DATE ANALYSED	ODWSOG		
								TYPE	LIMIT	UNITS	
N-NO3 (Nitrate)	mg/L	0.1			<0.10	97	80-120	2011-11-15	MAC	10.0	mg/L

MRL = Method Reporting Limit INC = Incomplete AO = Aesthetic Objective OG = Operational Guideline MAC = Maximum Allowable Concentration IMAC = Interim Maximum Allowable Concentration
Comment:

APPROVAL: 
Lorna Wilson
Inorganic Lab Supervisor



APPENDIX G

Nitrate Dilution Calculation

Input Parameters

Site Area	29,000 m ²	(approximately 2.90 hectares)
Net Potential Infiltration (NPI)	180 mm/yr	
Nitrate strength in effluent	40 mg/L	
Water usage per employee	125 L/day	
Maximum number of employees	35	

Dilution Calculation

Annual infiltration across site	5.22E+06 L/yr	= NPI * site area
Septic Loading for 35 employees	1.60E+06 L/yr	= water usage * number of employees
Nitrate loading	6.39E+07 mg/L/yr	= septic loading * nitrate strength
Nitrate concentration at property boundary	9.37 mg/L	= (nitrate loading)/(annual infiltration + septic loading)

At Golder Associates we strive to be the most respected global company providing consulting, design, and construction services in earth, environment, and related areas of energy. Employee owned since our formation in 1960, our focus, unique culture and operating environment offer opportunities and the freedom to excel, which attracts the leading specialists in our fields. Golder professionals take the time to build an understanding of client needs and of the specific environments in which they operate. We continue to expand our technical capabilities and have experienced steady growth with employees who operate from offices located throughout Africa, Asia, Australasia, Europe, North America, and South America.

Africa	+ 27 11 254 4800
Asia	+ 86 21 6258 5522
Australasia	+ 61 3 8862 3500
Europe	+ 356 21 42 30 20
North America	+ 1 800 275 3281
South America	+ 55 21 3095 9500

solutions@golder.com
www.golder.com

Golder Associates Ltd.
32 Steacie Drive
Kanata, Ontario, K2K 2A9
Canada
T: +1 (613) 592 9600



ATTACHMENT 2

Lab Reports 1973087 and 1976973

Client: Golder Associates Ltd. (Ottawa)
1931 Robertson Road
Ottawa, ON
K2H 5B7
Attention: Ms. Caitlin Cooke
PO#:
Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
Date Submitted: 2022-03-09
Date Reported: 2022-03-16
Project: 21493887
COC #: 216712

Page 1 of 7

Dear Caitlin Cooke:

Please find attached the analytical results for your samples. If you have any questions regarding this report, please do not hesitate to call (613-727-5692).

Report Comments:

APPROVAL: _____

Addrine Thomas, Inorganics Supervisor

All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise indicated.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at: <http://www.cala.ca/scopes/2602.pdf>.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is licensed by the Ontario Ministry of the Environment, Conservation, and Parks (MECP) for specific tests in drinking water (license #2318). A copy of the license is available upon request.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by the Ontario Ministry of Agriculture, Food, and Rural Affairs for specific tests in agricultural soils.

Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline values listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official provincial or federal guideline as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
 Date Submitted: 2022-03-09
 Date Reported: 2022-03-16
 Project: 21493887
 COC #: 216712

Group	Analyte	MRL	Units	Guideline	Result
				Lab I.D. Sample Matrix Sample Type Sampling Date Sample I.D.	1613861 Water 2022-03-09 Hydro
Anions	Cl	1	mg/L	AO 250	61
	F	0.10	mg/L	MAC 1.5	0.27
	N-NO2	0.10	mg/L	MAC 1.0	<0.10
	N-NO3	0.10	mg/L	MAC 10.0	<0.10
	SO4	1	mg/L	AO 500	35
General Chemistry	Alkalinity as CaCO3	5	mg/L	OG 30-500	290
	Colour (Apparent)	2	TCU	AO 5	96*
	Conductivity	5	uS/cm		747
	DOC	0.5	mg/L	AO 5	1.6
	pH	1.00		6.5-8.5	7.82
	Phenols	0.001	mg/L		<0.001
	S2-	0.01	mg/L	AO 0.05	0.21*
	TDS (COND - CALC)	1	mg/L	AO 500	486
Turbidity	0.1	NTU	AO 5	13.2*	
Hardness	Hardness as CaCO3	1	mg/L	OG 80-100	305*
Indices/Calc	Ion Balance	0.01			1.00
Metals	Ca	1	mg/L		94
	Fe	0.03	mg/L	AO 0.3	1.63*
	K	1	mg/L		5
	Mg	1	mg/L		17
	Mn	0.01	mg/L	AO 0.05	0.06*
	Na	1	mg/L	AO 200	46
Microbiology	Escherichia Coli	0	ct/100mL	MAC 0	0
	Faecal Coliforms	0	ct/100mL		0
	Heterotrophic Plate Count	0	ct/1mL		0

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
 Date Submitted: 2022-03-09
 Date Reported: 2022-03-16
 Project: 21493887
 COC #: 216712

Lab I.D. 1613861
 Sample Matrix Water
 Sample Type
 Sampling Date 2022-03-09
 Sample I.D. Hydro

Group	Analyte	MRL	Units	Guideline	
Microbiology	Total Coliforms	0	ct/100mL	MAC 0	0
Nutrients	N-NH3	0.010	mg/L		0.502
	Total Kjeldahl Nitrogen	0.100	mg/L		0.629
Subcontract	Tannin & Lignin	1	mg/L		<1.0

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
 Date Submitted: 2022-03-09
 Date Reported: 2022-03-16
 Project: 21493887
 COC #: 216712

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Run No 418290 Analysis/Extraction Date 2022-03-10 Analyst DRA Method AMBCOLM1			
Escherichia Coli			
Faecal Coliforms			
Heterotrophic Plate Count			
Total Coliforms			
Run No 418310 Analysis/Extraction Date 2022-03-10 Analyst AsA Method C SM4500-S2-D			
S2-	<0.01 mg/L	84	80-120
Run No 418351 Analysis/Extraction Date 2022-03-10 Analyst IP Method SM5530D/EPA420.2			
Phenols	<0.001 mg/L	53	50-120
Run No 418367 Analysis/Extraction Date 2022-03-10 Analyst SKH Method EPA 351.2			
Total Kjeldahl Nitrogen	<0.100 mg/L	106	70-130
Run No 418375 Analysis/Extraction Date 2022-03-11 Analyst AsA Method SM 5310B			
DOC	<0.5 mg/L	93	80-120

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
 Date Submitted: 2022-03-09
 Date Reported: 2022-03-16
 Project: 21493887
 COC #: 216712

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Run No 418376 Analysis/Extraction Date 2022-03-11 Analyst AsA Method C SM2120C			
Colour (Apparent)	<2 TCU	106	90-110
Run No 418403 Analysis/Extraction Date 2022-03-11 Analyst AaN Method C SM2130B			
Turbidity	<0.1 NTU	100	70-130
Run No 418413 Analysis/Extraction Date 2022-03-11 Analyst SKH Method EPA 350.1			
N-NH3	<0.010 mg/L	100	80-120
Run No 418426 Analysis/Extraction Date 2022-03-14 Analyst AaN Method SM 4110			
Chloride	<1 mg/L	100	90-110
N-NO2	<0.10 mg/L	104	90-110
N-NO3	<0.10 mg/L	105	90-110
SO4	<1 mg/L	105	90-110
Run No 418447 Analysis/Extraction Date 2022-03-14 Analyst Z S Method M SM3120B-3500C			
Calcium	<1 mg/L	100	90-110
Potassium	<1 mg/L	100	87-113

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
 Date Submitted: 2022-03-09
 Date Reported: 2022-03-16
 Project: 21493887
 COC #: 216712

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Magnesium	<1 mg/L	100	76-124
Sodium	<1 mg/L	106	82-118
Run No 418474 Analysis/Extraction Date 2022-03-14 Analyst SD Method EPA 200.8			
Iron	<0.03 mg/L	104	80-120
Manganese	<0.01 mg/L	103	80-120
Run No 418491 Analysis/Extraction Date 2022-03-14 Analyst AET Method SUBCONTRACT-A			
Tannin & Lignin	<1.0 mg/L	106	
Run No 418559 Analysis/Extraction Date 2022-03-15 Analyst AsA Method SM2320,2510,4500H/F			
Alkalinity (CaCO ₃)	<5 mg/L	98	90-110
Conductivity	<5 uS/cm	99	90-110
F	<0.10 mg/L	95	90-110
pH		98	90-110
Run No 418578 Analysis/Extraction Date 2022-03-16 Analyst AET Method C SM2340B			
Hardness as CaCO ₃			
Ion Balance			

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1973087
 Date Submitted: 2022-03-09
 Date Reported: 2022-03-16
 Project: 21493887
 COC #: 216712

QC Summary

Analyte	Blank	QC % Rec	QC Limits
TDS (COND - CALC)			

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range



Certificate of Analysis

Client: Golder Associates Ltd. (Ottawa)
1931 Robertson Road
Ottawa, ON
K2H 5B7
Attention: Ms. Caitlin Cooke
PO#:
Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1976973
Date Submitted: 2022-05-09
Date Reported: 2022-05-16
Project: 21493887
COC #: 216712

Dear Caitlin Cooke:

Please find attached the analytical results for your samples. If you have any questions regarding this report, please do not hesitate to call (613-727-5692).

Report Comments:

APPROVAL: _____
Rebecca Koshy, Project Manager

All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise indicated.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at: <http://www.cala.ca/scopes/2602.pdf>.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is licensed by the Ontario Ministry of the Environment, Conservation, and Parks (MECP) for specific tests in drinking water (license #2318). A copy of the license is available upon request.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by the Ontario Ministry of Agriculture, Food, and Rural Affairs for specific tests in agricultural soils.

Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline values listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official provincial or federal guideline as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Certificate of Analysis

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1976973
 Date Submitted: 2022-05-09
 Date Reported: 2022-05-16
 Project: 21493887
 COC #: 216712

Lab I.D.
 Sample Matrix
 Sample Type
 Sampling Date
 Sample I.D.
 1625012
 GW
 2022-03-09
 Hydro - Dissolved

Group	Analyte	MRL	Units	Guideline		
Metals	Ag	0.0001	mg/L		<0.0001	
	Al	0.01	mg/L	OG 0.1	<0.01	
	As	0.001	mg/L	IMAC 0.01	<0.001	
	B	0.01	mg/L	IMAC 5.0	0.15	
	Ba	0.01	mg/L	MAC 1.0	0.16	
	Be	0.0005	mg/L		<0.0005	
	Cd	0.0001	mg/L	MAC 0.005	<0.0001	
	Co	0.0002	mg/L		<0.0002	
	Cr	0.001	mg/L	MAC 0.05	<0.001	
	Cu	0.001	mg/L	AO 1	0.004	
	Filtration			mg/L		y
	Mo	0.005	mg/L		<0.005	
	Ni	0.005	mg/L		<0.005	
	Pb	0.001	mg/L	MAC 0.010	<0.001	
	Sb	0.0005	mg/L	IMAC 0.006	<0.0005	
	Se	0.001	mg/L	MAC 0.05	<0.001	
	Sr	0.001	mg/L		1.59	
	Tl	0.0001	mg/L		<0.0001	
	U	0.001	mg/L	MAC 0.02	0.001	
	V	0.001	mg/L		<0.001	
Zn	0.01	mg/L	AO 5	<0.01		

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1976973
 Date Submitted: 2022-05-09
 Date Reported: 2022-05-16
 Project: 21493887
 COC #: 216712

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Run No 421951 Analysis/Extraction Date 2022-05-13 Analyst SD Method EPA 200.8			
Silver	<0.0001 mg/L	91	80-120
Aluminum	<0.01 mg/L	116	80-120
Arsenic	<0.001 mg/L	100	80-120
Boron (total)	<0.01 mg/L	117	80-120
Barium	<0.01 mg/L	110	80-120
Beryllium	<0.0005 mg/L	113	80-120
Cadmium	<0.0001 mg/L	109	80-120
Cobalt	<0.0002 mg/L	103	80-120
Chromium Total	<0.001 mg/L	106	80-120
Copper	<0.001 mg/L	107	80-120
Filtration			
Molybdenum	<0.005 mg/L	99	80-120
Nickel	<0.005 mg/L	107	80-120
Lead	<0.001 mg/L	111	80-120
Antimony	<0.0005 mg/L	90	80-120
Selenium	<0.001 mg/L	109	80-120

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1976973
 Date Submitted: 2022-05-09
 Date Reported: 2022-05-16
 Project: 21493887
 COC #: 216712

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Strontium	<0.001 mg/L	104	80-120
Thallium	<0.0001 mg/L	110	80-120
Uranium	<0.001 mg/L	103	80-120
Vanadium	<0.001 mg/L	104	80-120
Zinc	<0.01 mg/L	110	80-120

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
1931 Robertson Road
Ottawa, ON
K2H 5B7
Attention: Ms. Caitlin Cooke
PO#:
Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1985044
Date Submitted: 2022-08-30
Date Reported: 2022-08-31
Project:
COC #: 899423

Page 1 of 4

Dear Caitlin Cooke:

Please find attached the analytical results for your samples. If you have any questions regarding this report, please do not hesitate to call (613-727-5692).

Report Comments:

APPROVAL: _____

Emma-Dawn Ferguson, Chemist

All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise indicated.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at: <https://directory.cala.ca/>.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is licensed by the Ontario Ministry of the Environment, Conservation, and Parks (MECP) for specific tests in drinking water (license #2318). A copy of the license is available upon request.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by the Ontario Ministry of Agriculture, Food, and Rural Affairs for specific tests in agricultural soils.

Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline values listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official provincial or federal guideline as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1985044
 Date Submitted: 2022-08-30
 Date Reported: 2022-08-31
 Project:
 COC #: 899423

Group	Analyte	MRL	Units	Guideline	Lab I.D. Sample Matrix Sample Type Sampling Date Sample I.D.
VOCs Surrogates	1,2-dichloroethane-d4	0	%		1648217 Water
	4-bromofluorobenzene	0	%		2022-08-30 SA1
	Toluene-d8	0	%		
Volatiles	1,1-dichloroethylene	0.5	ug/L	MAC 14	<0.5
	1,2-dichlorobenzene	0.4	ug/L	MAC 200	<0.4
	1,2-dichloroethane	0.5	ug/L	IMAC 5	<0.5
	1,4-dichlorobenzene	0.4	ug/L	MAC 5	<0.4
	Benzene	0.5	ug/L	MAC 1	<0.5
	Bromodichloromethane	0.3	ug/L		<0.3
	Bromoform	0.4	ug/L		<0.4
	Carbon Tetrachloride	0.2	ug/L	MAC 2	<0.2
	Chloroform	0.5	ug/L		<0.5
	Dibromochloromethane	0.3	ug/L		<0.3
	Dichloromethane	4.0	ug/L	MAC 50	<4.0
	Ethylbenzene	0.5	ug/L	MAC 140	<0.5
	m/p-xylene	0.4	ug/L		<0.4
	Monochlorobenzene	0.5	ug/L	MAC 80	<0.5
	o-xylene	0.4	ug/L		<0.4
	Tetrachloroethylene	0.3	ug/L	MAC 10	<0.3
	Toluene	0.4	ug/L	MAC 60	<0.4
	Trichloroethylene	0.3	ug/L	MAC 5	<0.3
Trihalomethanes (total)	1.5	ug/L		<1.5	
Vinyl Chloride	0.2	ug/L	MAC 1	<0.2	
Xylene; total	0.5	ug/L	MAC 90	<0.5	

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1985044
 Date Submitted: 2022-08-30
 Date Reported: 2022-08-31
 Project:
 COC #: 899423

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Run No 428649 Analysis/Extraction Date 2022-08-31 Analyst PJ			
Method EPA 8260			
Dichloroethylene, 1,1-	<0.5 ug/L	85	60-130
Dichlorobenzene, 1,2-	<0.4 ug/L	104	60-130
Dichloroethane, 1,2-	<0.5 ug/L	117	60-130
Dichlorobenzene, 1,4-	<0.4 ug/L	91	60-130
Benzene	<0.5 ug/L	106	60-130
Bromodichloromethane	<0.3 ug/L	104	60-130
Bromoform	<0.4 ug/L	100	60-130
Carbon Tetrachloride	<0.2 ug/L	102	60-130
Chloroform	<0.5 ug/L	112	60-130
Dibromochloromethane	<0.3 ug/L	102	60-130
Methylene Chloride	<4.0 ug/L	112	60-130
Ethylbenzene	<0.5 ug/L	117	60-130
m/p-xylene	<0.4 ug/L	120	60-130
Chlorobenzene	<0.5 ug/L	115	60-130
o-xylene	<0.4 ug/L	111	60-130
Tetrachloroethylene	<0.3 ug/L	102	60-130

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Golder Associates Ltd. (Ottawa)
 1931 Robertson Road
 Ottawa, ON
 K2H 5B7
 Attention: Ms. Caitlin Cooke
 PO#:
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1985044
 Date Submitted: 2022-08-30
 Date Reported: 2022-08-31
 Project:
 COC #: 899423

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Toluene	<0.4 ug/L	108	60-130
Trichloroethylene	<0.3 ug/L	98	60-130
Vinyl Chloride	<0.2 ug/L	86	60-130
Run No 428665 Analysis/Extraction Date 2022-08-31 Analyst PJ Method EPA 8260			
Xylene Mixture			
Run No 428667 Analysis/Extraction Date 2022-08-31 Analyst PJ Method EPA 8260			
Trihalomethanes (total)			80-120

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

ATTACHMENT 3

Updated Nitrate Dilution Calculation

Input Parameters

Site Area	26,480 m ²	(approximately 2.6 hectares)
Net Potential Infiltration (NPI)	180 mm/yr	
Daily effluent volume	10000 L/day	
Nitrate strength in effluent	40 mg/L	
Nitrate reduction via pre-treatment	50%	

Dilution Calculation

Annual infiltration across site	4.77E+06 L/yr	= NPI * site area
Septic Loading	3.65E+06 L/yr	= daily effluent volume * 365 days
Nitrate loading	7.30E+07 mg/L/yr	= septic loading * nitrate strength * nitrate reduction
Nitrate concentration at property boundary	8.7 mg/L	= (nitrate loading)/(annual infiltration + septic loading)

wsp **GOLDER**

golder.com

Appendix D

Fire Protection Water
Demand

MEMORANDUM



**J.L. Richards
& Associates Limited**
864 Lady Ellen Place
Ottawa, ON Canada
K1Z 5M2
Tel: 613 728 3571
Fax: 613 728 6012

Page 1 of 2

To: City of Ottawa

Date: September 8, 2022

JLR No.: 31500-000

CC:

From: Kris Mierzejewski, P.Eng.

Re: HONI Orleans OPERATIONS CENTRE (OC) – FIRE
PROTECTION WATER REQUIREMENTS_REV 03

This technical memorandum has been prepared by J.L.Richards and Associated Limited (JLR) on behalf of Brookfield Global Integrated Solutions Canada LP (BGIS) to support the site Plan Control application of Hydron One Network Inc. (JONI) new Operations Centre (OC), at 3440 Frank Kenny Road, Ottawa, Ontario.

We have calculated the size of the required fire protection water, based on the current building size (1683 m sq.)

- 1) According to the OBC Section A.3.2.5.7. the required fire protection water supply would be:

$$Q = K \times V \times S \text{ (litres)}$$

Where:

K = 17 for F2 occupancy, where building is of noncombustible construction with fire separations and fire resistance ratings provided in accordance with Subsection 3.2.2., including loadbearing walls, columns, and arches.

V = total building volume in cubic meters (mean assumed building height at 6.4 m) = 10,771 m cubed.

S = Spatial Coefficient = 1.0

$$Q = 17 \times 10,771 \times 1.0 = \mathbf{183,110 \text{ litres.}}$$

From table 2 the required flow would be 5,400 l/min (1429 gpm)

- 2) According to Fire Underwriters Survey (FUS, 1999) design methodology, the fire flow required is determined by the formula:

$$F = 220 \times C \times (A^{(1/2)})$$

Where:

F = The required fire flow in litres per minute

C = coefficient related to the type of construction (0.8 for non-combustible construction – unprotected metal structural components, masonry or metal walls)

A = The total floor area in square metres in the building being considered.

Following assumptions have been applied:

- "Rapid Burning" occupancy – based on F2 category
- No sprinkler system
- Non-combustible construction (as above)
- 45m of separation to the nearest building on each side.

$$F = 9025 \text{ l/min (2388 gpm)}$$

Based on the required flow rate, the required duration of fire flow is approx. 2 hrs.
This results in the total required fire protection water supply of **1,083,000 litres**.

The discrepancy between methods is significant.

We base our design on OBC figures, taking into account the opinion of fire department official, recorded in Due Diligence Report, October 7 2016, deeming the OBC calculation method acceptable.

J.L. RICHARDS & ASSOCIATES LIMITED

Prepared by:




Kris Mierzejewski, P.Eng.
Mechanical Engineer

KM:km

Appendix E



Dry Hydrant Storage
Tanks and Dry Hydrant
Specifications

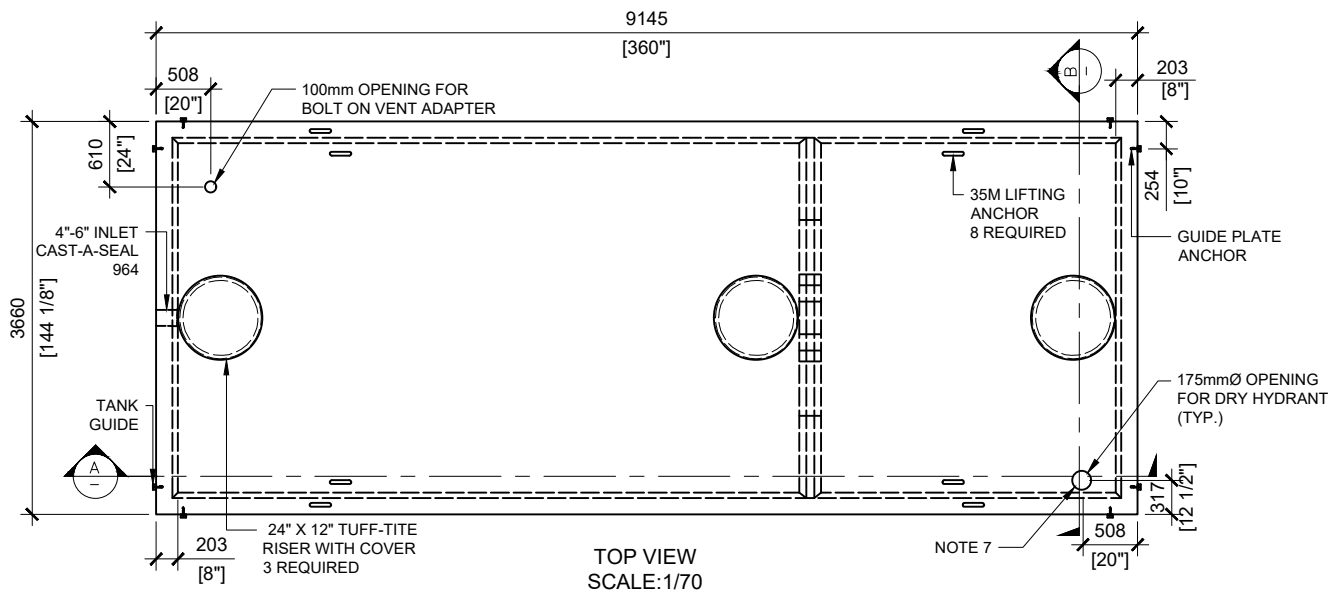

GENERAL NOTES:

1. UNITS ARE SEALED WITH BUTYL TAPE AT THE JOINTS
2. CONTRACTOR TO ENSURE CRANE IS ON-SITE TO OFFLOAD AND SET TANK
3. EXCAVATION MUST BE READY FOR INSTALL
4. MIN OVERHEAD CLEARANCE OF 18FT (5.5 METRES) IS REQUIRED
5. ALL UNITS MUST BE HANDLED WITH PROPER LIFTING EQUIPMENT
6. TANK DESIGNED FOR A MAXIMUM FILL COVER DEPTH OF 1000mm, MO MINIMUM FILL COVER DEPTH, AND 12 kPa VEHICLE LOADING.
7. SCHEDULE 80 FLANGE FOR DRY HYDRANT TO BE FITTED ON SITE

* TANKS SUITABLE FOR TRAFFIC LOADING

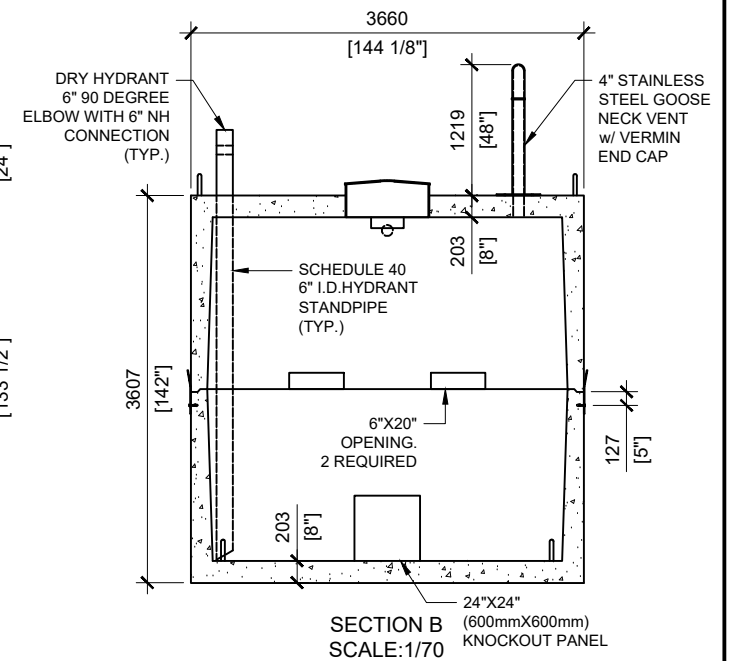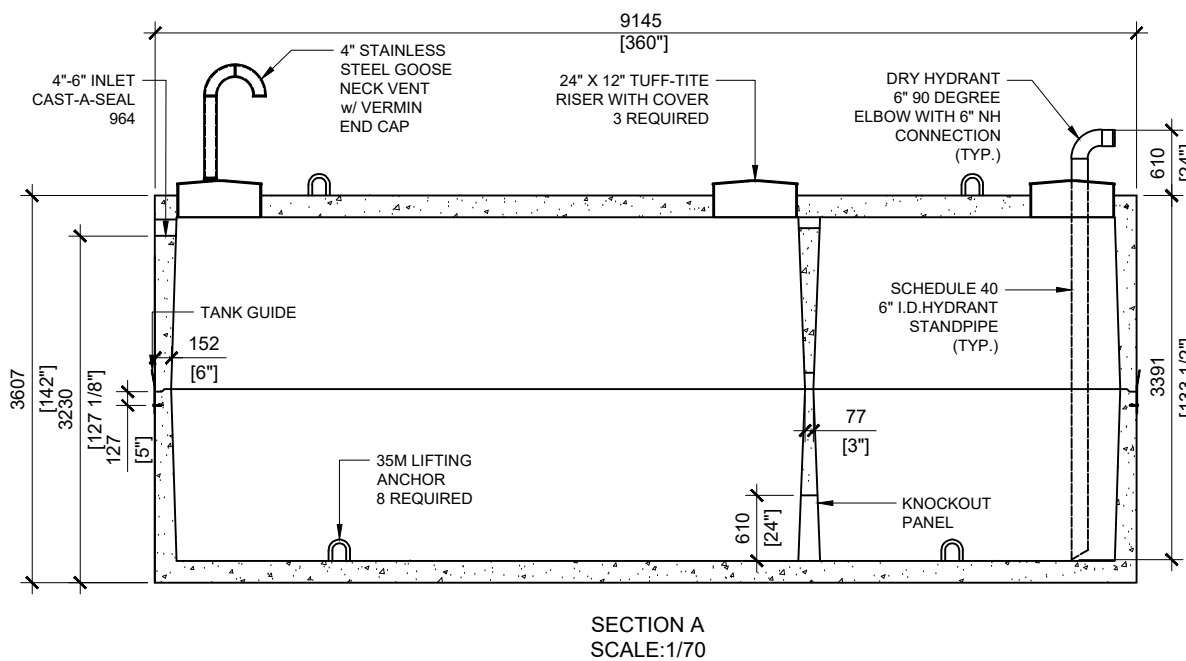

SINGLE FIRE WATER TANK



MANUFACTURED:
OTTAWA, ON
1-800-655-3430

CONCRETE TYPE: SCC
CONCRETE: 45MPa at 28 days / 6,500PSI
AIR ENTRAINMENT: 5-8%
REINFORCEMENT: STEEL TO CSA CAN
A23.1 /A23.3 G30.18 Fy=400MPa

WEIGHT:
BOTTOM - 78,034lbs / 35,470kg
TOP - 77,753lbs / 35,342kg
CSA APPROVED
MEETS CAN/CSA-B66
"AGINP"

DRAWN BY:
JAY PATEL

DATE:
MAR/2022

84000 LITRES

WORKING CAPACITY: 86752L TO INVERT OF INLET
TOTAL CAPACITY: 91606L TO UNDERSIDE OF CHAMBER LID




UNDERGROUND WATER RESERVOIR DRAW PIPE DETAIL

DATE: MARCH 2016

REV.
DATE:

DWG. No.: W52

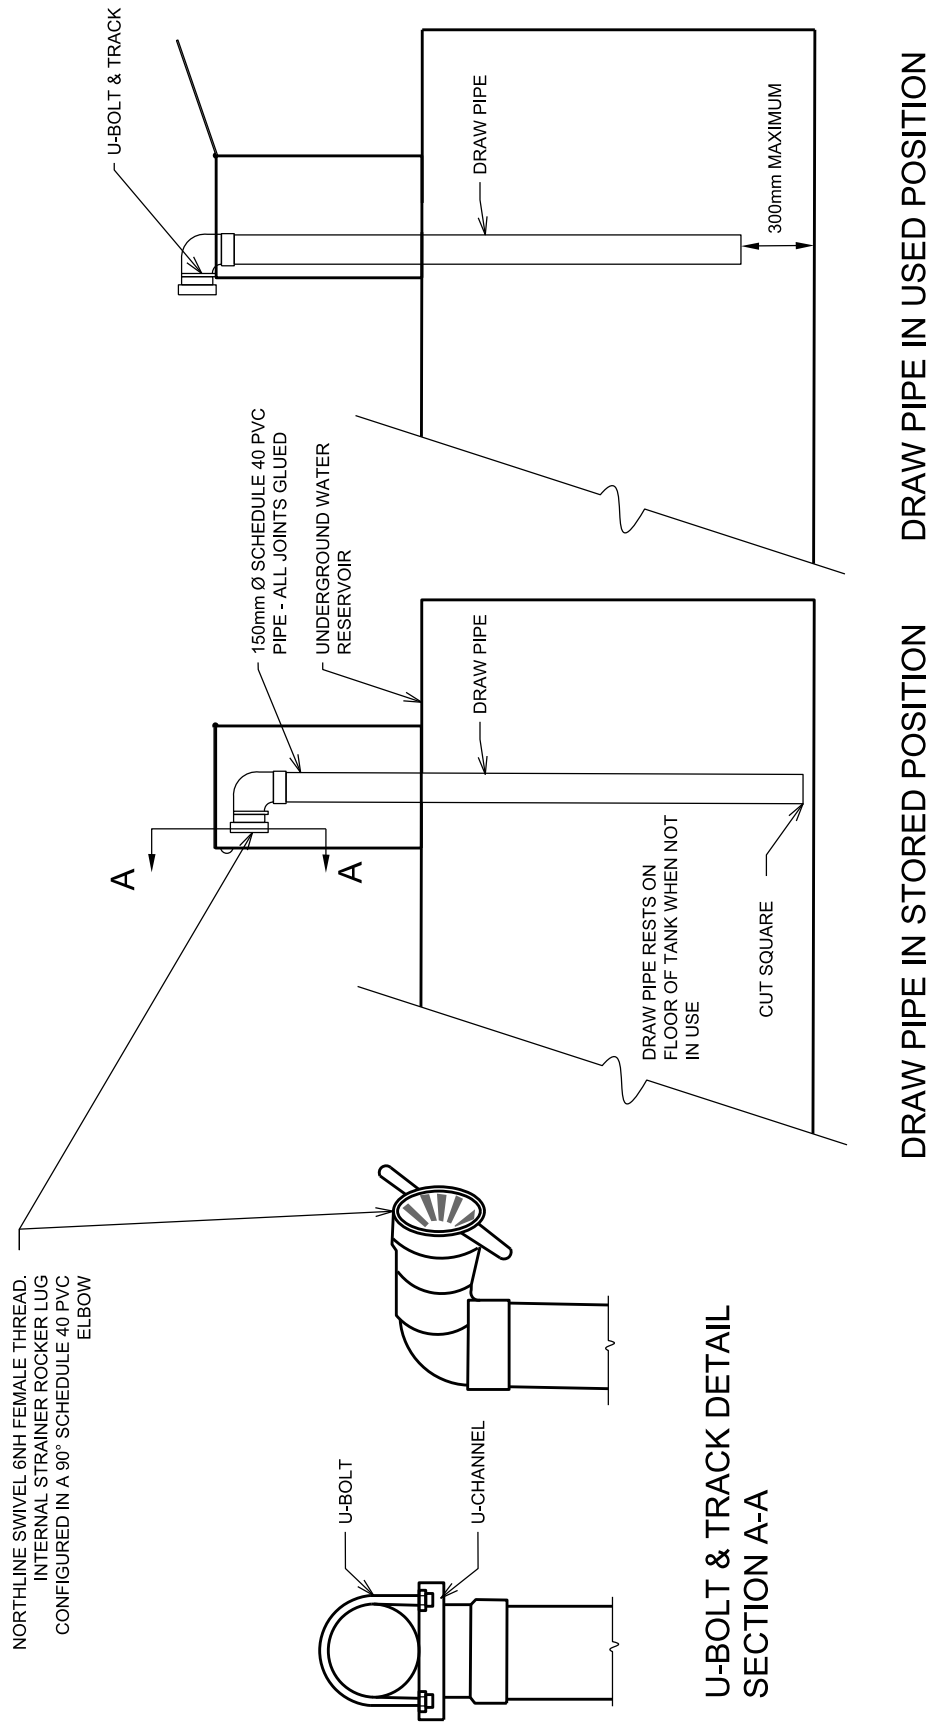

Appendix F

Consultation Record with
Local Fire Chief

Gideon Hui

From: Marc Rivet
Sent: March 31, 2022 4:26 PM
To: Marie-France Duthilleul
Cc: Gideon Hui
Subject: FW: 31500-000_HONI Orleans - Fire Tanks

From: Evans, Allan <Allan.Evans@ottawa.ca>
Sent: March 10, 2022 11:26 AM
To: Kris Mierzejewski <kmierzejewski@jlrichards.ca>; Marc Rivet <mrivet@jlrichards.ca>
Cc: Marsh Frère <mfrere@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Apologies, yes – I meant the OBC amount of 275kL

Allan Evans

Fire Protection Engineer / Ingénieur de Protection d'Incendies

Prevention Division / Prévention des Incendies

Ottawa Fire Services / Service des Incendies d'Ottawa

1445 Carling Avenue / 1445 Avenue Carling

Ottawa, ON K1Z 7L9

Allan.Evans@Ottawa.ca

☎ (613) 913-2747 | 📠 (613) 580-2424 x24119 | 📠 (613) 580-2866 | 📧 Mail Code: 25-102 | @OFSFPE



OTTAWA FIRE SERVICES
SERVICE DES INCENDIES D'OTTAWA
Protecting Our Nation's Capital With Pride
Protéger notre capitale nationale avec fierté



An internationally accredited agency 2014-2019

From: Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Sent: March 10, 2022 11:00 AM
To: Evans, Allan <Allan.Evans@ottawa.ca>; Marc Rivet <mrivet@jlrichards.ca>
Cc: Marsh Frère <mfrere@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Allan,

Thank you for your email. Just for clarification:

You said: "OFS supports using the storage volume required by FUS vs OBC for the reasons listed above"

I hope you meant "OFS supports using the storage volume required by OBC vs FUS. The FUS storage requirement is much greater.

Thank you and please let us know if you have any further comments.

Regards,

Kris Mierzejewski, M.Sc., P.Eng.
Mechanical Engineer

J.L. Richards & Associates Limited
864 Lady Ellen Place, Ottawa, ON K1Z 5M2
Direct: 343-804-4453 Cell: 613-857-1679



*J.L. Richards & Associates Limited is proactively doing our part to protect the wellbeing of our staff and communities while improving our communication technology. **We are pleased to announce that we have implemented direct phone lines for all of our staff, allowing you to connect with us regardless of whether we are working remotely or in the office.** We are dedicated to delivering quality services to you through value and commitment, as always. Please reach out to us if you have any questions about your project.*

From: Evans, Allan <Allan.Evans@ottawa.ca>
Sent: Thursday, March 10, 2022 10:48 AM
To: Marc Rivet <mrivet@jlrichards.ca>
Cc: Marsh Frère <mfrere@jlrichards.ca>; Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Hi Marc – let me summarize my thoughts in an email (easier for future reference).

- Occupancy is not a residential occupancy (especially retirement home, vulnerable occupancy, or similar)
- Firefighting capability (physics/fire truck limitation) is limited to approximately 1000 gpm (4000 L/min) from a draft water source
- Proposal is for 275000L on site which is approximately 69 minutes at full flow rate
- Nearest fire station – Station 71 – 1246 Colonial Road (1.7 km)
- Nearest unlimited water source – 2048 Giroux Road (~ 3.2 km)
- With over an hour of our max capacity flow, we would have more than sufficient time to establish a tanker shuttle for external additional water supply to the site

OFS supports using the storage volume required by FUS vs OBC for the reasons listed above, but ultimately this will be up to building code officials to approve/deny as they are the AHJ. If a formal alternative solutions process is required by the AHJ, I would recommend a quick online meeting to discuss options.

Allan Evans

Fire Protection Engineer / Ingénieur de Protection d'Incendies
Prevention Division / Prévention des Incendies
Ottawa Fire Services / Service des Incendies d'Ottawa
1445 Carling Avenue / 1445 Avenue Carling
Ottawa, ON K1Z 7L9
Allan.Evans@Ottawa.ca
☎ (613) 913-2747 | 📠 (613) 580-2424 x24119 | 📠 (613) 580-2866 | 📧 Mail Code: 25-102 | @OFSFPE



An internationally accredited agency 2014-2019

From: Marc Rivet <mrivet@jlrichards.ca>
Sent: March 07, 2022 1:27 PM
To: Evans, Allan <Allan.Evans@ottawa.ca>
Cc: Marsh Frère <mfrere@jlrichards.ca>; Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Subject: FW: 31500-000_HONI Orleans - Fire Tanks

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Allan,

This is the most up to date info.

Thanks.

Marc

Marc Rivet, RPP, MCIP
Associate
Senior Planner

J.L. Richards & Associates Limited
700 - 1565 Carling Avenue, Ottawa, ON K1Z 8R1
Direct: 343-803-4533 Cell: 613-867-8528



*J.L. Richards & Associates Limited is proactively doing our part to protect the wellbeing of our staff and communities while improving our communication technology. **We are pleased to announce that we have implemented direct phone lines for all of our staff, allowing you to connect with us regardless of whether we are working remotely or in the office.** We are dedicated to delivering quality services to you through value and commitment, as always. Please reach out to us if you have any questions about your project.*

From: Anjuma Ekanayake <aekanayake@jlrichards.ca>
Sent: Monday, March 7, 2022 1:23 PM
To: Marc Rivet <mrivet@jlrichards.ca>
Cc: Marsh Frère <mfrere@jlrichards.ca>; Kris Mierzejewski <kmierzejewski@jlrichards.ca>; Justin Gauthier <jgauthier@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Hi Marc,

Please see attached Site plan and up to date Building Floor plan. The client is yet to sign off on the current floor plan. This foot print of the floor plan is not reflected on the site plan. Once we have the client sign off this can be updated on the site plan. The current building area is 1,961sqm which has been reduced from the earlier footprint of 2165 sqm. (which is on the attached site plan option B)

OBC classification: Group F, Division 2, up to 4 Storeys, [\[3.2.2.70\]](#)
Occupancy Classification

- Major occupancies: Group F, Division 2 – Medium Hazard Industrial Occupancy
- Minor occupancy: Group D – Business and personal services occupancies
- Building area: 1,961 sqm (21,100.36 sq. ft.)
- Building height: One (1) Storey – Approx. Garage Area height 8.1m (high roof)

The scope of this project involves the construction of a new Operations center which includes a vehicle repair garage, drive through vehicle garage and warehouse, complete with an administration and accommodations area, for Hydro One. Below noted are the distinct areas of the Operations center

- Drive through vehicle garage – between gridline 1 & 3

- Vehicle Repair garage – between gridlines 3 & 5
- Warehouse – between gridlines 5 & 7
- Accommodations area w/ washrooms/ locker room etc - between gridlines 7 & 9
- Administration/ offices - between gridlines 9 & 11

Thank you,
Anjuma

From: Marc Rivet <mrivet@jlrichards.ca>
Sent: Monday, March 7, 2022 11:04 AM
To: Anjuma Ekanayake <aekanayake@jlrichards.ca>
Cc: Marsh Frère <mfrere@jlrichards.ca>; Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Subject: FW: 31500-000_HONI Orleans - Fire Tanks

Hi Anjuma,

Can you provide me with the requested info (Site Plan, Floor Plan, Size of Building / Use, Occupancy classification).

Thanks.

Marc

From: Evans, Allan <Allan.Evans@ottawa.ca>
Sent: Monday, March 7, 2022 10:18 AM
To: Marc Rivet <mrivet@jlrichards.ca>
Cc: Kris Mierzejewski <kmierzejewski@jlrichards.ca>; Derrick Upton <dupton@jlrichards.ca>; Marsh Frère <mfrere@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

[CAUTION] This email originated from outside JLR. Do not click links or open attachments unless you recognize the sender and know the content is safe. If in doubt, please forward suspicious emails to Helpdesk.

Can you please provide a site plan as well as a description of what the occupancy will be (beyond the F-2 classification) and an address.

Thanks

Allan Evans

Fire Protection Engineer / Ingénieur de Protection d'Incendies

Prevention Division / Prévention des Incendies

Ottawa Fire Services / Service des Incendies d'Ottawa

1445 Carling Avenue / 1445 Avenue Carling

Ottawa, ON K1Z 7L9

Allan.Evans@Ottawa.ca

☎ (613) 913-2747 | 📠 (613) 580-2424 x24119 | 📠 (613) 580-2866 | 📧 Mail Code: 25-102 | @OFSFPE



OTTAWA FIRE SERVICES
SERVICE DES INCENDIES D'OTTAWA
Protecting Our Nation's Capital With Pride
Protéger notre capitale nationale avec fierté



An internationally accredited agency 2014-2019

From: Marc Rivet <mrivet@jlrichards.ca>
Sent: March 03, 2022 1:16 PM
To: Evans, Allan <Allan.Evans@ottawa.ca>
Cc: Kris Mierzejewski <kmierzejewski@jlrichards.ca>; Derrick Upton <dupton@jlrichards.ca>; Marsh Frère <mfrere@jlrichards.ca>
Subject: FW: 31500-000_HONI Orleans - Fire Tanks

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Allan,

Per our last meeting it was indicated that the Building Official might request we approach the Rural Fire Department to seek approval on 'alternate measures' being OBC rather than FUS.

Expecting this might come up we have prepared a memo comparing size of fire tanks (FUS vs OBC) and would appreciate a letter from your department confirming support of the OBC calculations as part of the Site Plan and subsequent permit.

Thanks.

Marc

Marc Rivet, RPP, MCIP
Associate
Senior Planner

J.L. Richards & Associates Limited
700 - 1565 Carling Avenue, Ottawa, ON K1Z 8R1
Direct: 343-803-4533 Cell: 613-867-8528



*J.L. Richards & Associates Limited is proactively doing our part to protect the wellbeing of our staff and communities while improving our communication technology. **We are pleased to announce that we have implemented direct phone lines for all of our staff, allowing you to connect with us regardless of whether we are working remotely or in the office.** We are dedicated to delivering quality services to you through value and commitment, as always. Please reach out to us if you have any questions about your project.*

From: Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Sent: Thursday, March 3, 2022 10:54 AM
To: Marc Rivet <mrivet@jlrichards.ca>; Derrick Upton <dupton@jlrichards.ca>; Marsh Frère <mfrere@jlrichards.ca>; Harminder Matharu <hmatharu@jlrichards.ca>
Cc: Anjuma Ekanayake <aekanyake@jlrichards.ca>; JLR Projects East <projectseast@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Hi All,

Please see the attached Memo on Fire tanks (FUS vs. OBC).

Please let me know if you have any questions or comments.

Regards,

From: Derrick Upton <dupton@jlrichards.ca>
Sent: Friday, February 25, 2022 1:52 PM
To: Kris Mierzejewski <kmierzejewski@jlrichards.ca>; Marsh Frère <mfrere@jlrichards.ca>; Harminder Matharu <hmatharu@jlrichards.ca>
Cc: Anjuma Ekanayake <aekanyake@jlrichards.ca>; JLR Projects East <projectseast@jlrichards.ca>; Marc Rivet <mrivet@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Thanks Kris.

Please sum up in a design memo so we can approach the fire chief with your results. Similar to Quadrant sample I provide you with.

Regards,

From: Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Sent: Friday, February 25, 2022 12:04 PM
To: Derrick Upton <dupton@jlrichards.ca>; Marsh Frère <mfrere@jlrichards.ca>; Harminder Matharu <hmatharu@jlrichards.ca>
Cc: Anjuma Ekanayake <aekanayake@jlrichards.ca>; JLR Projects East <projectseast@jlrichards.ca>; Marc Rivet <mrivet@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Hi Derrick and Marc,

FUS calculation returns a flowrate of 8189 l/min, assuming 2hr duration (per FUS requirements) this means the storage capacity of 982,680 litres, which is more than 3.5 times the OBC requirement.

Thanks,

From: Derrick Upton <dupton@jlrichards.ca>
Sent: Friday, February 25, 2022 12:01 PM
To: Kris Mierzejewski <kmierzejewski@jlrichards.ca>; Marsh Frère <mfrere@jlrichards.ca>; Harminder Matharu <hmatharu@jlrichards.ca>
Cc: Anjuma Ekanayake <aekanayake@jlrichards.ca>; JLR Projects East <projectseast@jlrichards.ca>; Marc Rivet <mrivet@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Kris,

I believe new fire chief also wanted a calculation based on FUS to come up with an overall compromise on what the site requirements would be for fire storage.

Regards,

From: Kris Mierzejewski <kmierzejewski@jlrichards.ca>
Sent: Friday, February 25, 2022 11:40 AM
To: Marsh Frère <mfrere@jlrichards.ca>; Harminder Matharu <hmatharu@jlrichards.ca>
Cc: Anjuma Ekanayake <aekanayake@jlrichards.ca>; JLR Projects East <projectseast@jlrichards.ca>; Derrick Upton <dupton@jlrichards.ca>; Marc Rivet <mrivet@jlrichards.ca>
Subject: RE: 31500-000_HONI Orleans - Fire Tanks

Hi All,

Further to our recent discussion on the subject, based on existing (DD) assumptions, and new floor and site plans, it appears the OBC required fire fighting water storage has now increased to 275,000 litres. Meaning, instead of two 100,000 tanks that we have planned for, three tanks of the same size will be required.

Fire Flow requirement is now 9000 l/min, Total water supply: 275,000 litres.

Assumptions:

- 1) As discussed and agreed with Mr. Duncan McNaughton, City of Ottawa Acting Division Chief, Fire Prevention Division, FUS water volume calculation method can be ignored and OBC calculation method used instead. This has been recorded in the Due Diligence Study, October 7, 2016
- 2) Per current site plan: New building will be more than 10m away from any other building.
- 3) Building classification is F-2
- 4) Height of ceilings estimated at DD stage (7.4m) were left unchanged

Please let me know if you have any comments or questions to the above.

Thanks,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

**Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON**

Appendix G

WSP Golder Technical
Memorandum –
New Septic System

SUBMITTED UNDER SEPARATE COVER

**Site Servicing Report
Hydro One Operations Centre
3440 Frank Kenny Road, Orléans ON**

SUBMITTED UNDER SEPARATE COVER



www.jlrichards.ca

Ottawa

864 Lady Ellen Place
Ottawa ON Canada
K1Z 5M2
Tel: 613 728-3571

ottawa@jlrichards.ca

Kingston

203-863 Princess Street
Kingston ON Canada
K7L 5N4
Tel: 613 544-1424

kingston@jlrichards.ca

Sudbury

314 Countryside Drive
Sudbury ON Canada
P3E 6G2
Tel: 705 522-8174

sudbury@jlrichards.ca

Timmins

201-150 Algonquin Blvd.
East
Timmins ON Canada
P4N 1A7
Tel: 705 360-1899

timmins@jlrichards.ca

North Bay

200-175 Progress Road
North Bay ON Canada
P1A 0B8
Tel: 705 495-7597

northbay@jlrichards.ca

Hawkesbury

326 Bertha Street
Hawkesbury ON Canada
K6A 2A8
Tel: 613 632-0287

hawkesbury@jlrichards.ca

Guelph

107-450 Speedvale Ave.
West Guelph ON Canada
N1H 7Y6
Tel: 519 763-0713

guelph@jlrichards.ca

