


LEGEND

○ MHH	CONCRETE BARRIER CURB	--- LIMIT OF CONSTRUCTION
○ T/G	STORM SEWER MANHOLE	--- DRAINAGE SWALE
○ C/B	LANDSCAPE CATCHBASIN PER CITY S30 & S31	--- DRAINAGE DITCH
○ C/B	CATCHBASIN PER OPSD 701.010	--- SLOPING AT 3:1 UNLESS SPECIFIED
○ ADR	AREA DRAIN TO BE SPECIFIED BY MECHANICAL	--- SURFACE ELEVATION
○ MHH/A	SANITARY SEWER MANHOLE	--- SWALE ELEVATION
○ HYD	FIRE HYDRANT	--- TOP OF WALL ELEVATION
○ W/V	WATER VALVE	--- BOTTOM OF WALL ELEVATION
○ M	WATER METER	--- OVERLAND FLOW ROUTE
○ RM	REMOTE WATER METER	--- SILT FENCE BARRIER
○ RD	ROOF DRAIN	--- PROPOSED WALL
○	SIAMESE CONNECTION	---
---	SUBDRAIN	---

FOR REVIEW ONLY
NOT FOR CONSTRUCTION

9	ISSUED FOR REVIEW	AUG 30, 2022
8	ISSUED FOR REVIEW	AUG 08, 2022
7	ISSUED FOR REVIEW	JULY 21, 2022
6	ISSUED FOR REVIEW	MAY 06, 2022
5	ISSUED FOR REVIEW	MAR 10, 2022
4	ISSUED FOR REVIEW	DEC 10, 2021
3	ISSUED FOR REVIEW	NOV 29, 2021
2	ISSUED FOR TENDER	NOV 10, 2021
1	ISSUED FOR REVIEW	JUNE 30, 2021
No.	Revisions	Date

Check and verify all dimensions before proceeding with the work. Do not scale drawings.

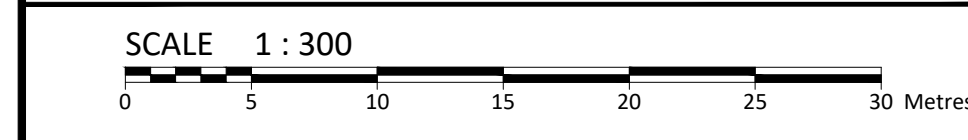

ALLISON HAMLIN
MANAGER (A), DEVELOPMENT REVIEW WEST PLANNING, REAL ESTATE & ECONOMIC DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Allison Hamlin at 9:17 am, Nov 18, 2022

- GENERAL NOTES**
- THE ORIGINAL TOPOGRAPHY, GROUND ELEVATION AND SURVEY DATA SHOWN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY, AND IMPLY NO GUARANTEE OF ACCURACY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION SHOWN.
 - THIS PLAN IS NOT A CADASTRAL SURVEY SHOWING LEGAL PROPERTY BOUNDARIES AND EASEMENTS. THE PROPERTY BOUNDARIES SHOWN HEREON HAVE BEEN DERIVED FROM INFORMATION SUPPLIED BY (OR SHOWN ON) FARLEY, SMITH & DENIS SURVEYING LTD FILE # 139-21 AND CANNOT BE RELIED UPON TO BE ACCURATE OR COMPLETE. THE PRECISE LOCATION OF THE CURRENT PROPERTY BOUNDARIES AND EASEMENTS CAN ONLY BE DETERMINED BY AN UP-TO-DATE LAND TITLES SEARCH AND A SUBSEQUENT CADASTRAL SURVEY PERFORMED AND CERTIFIED BY AN ONTARIO LAND SURVEYOR.
 - THE CONTRACTOR IS TO OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY BEFORE COMMENCING CONSTRUCTION.
 - THE CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT.
 - THE CONTRACTOR IS TO DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROJECT AND ASSUME ALL RESPONSIBILITY FOR EXISTING UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS. IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
 - RESTORE ALL TRENCHES AND SURFACES OF PUBLIC ROAD ALLOWANCES TO CONDITION EQUAL OR BETTER THAN ORIGINAL CONDITION AND TO THE SATISFACTION OF THE CITY AUTHORITIES.
 - EXCAVATE AND DISPOSE OF ALL EXCESS EXCAVATED MATERIAL, SUCH AS ASPHALT, CURBING AND DEBRIS, OFF SITE AS DIRECTED BY THE ENGINEER AND THE CITY.
 - TOPSOIL TO BE STRIPPED AND STOCKPILED FOR REHABILITATION. CLEAN FILL TO BE PLACED IN FILL AREAS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
 - ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE SPECIFIED.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC CONTROL AND SAFETY MEASURES DURING THE CONSTRUCTION PERIOD, INCLUDING THE SUPPLY, INSTALLATION, AND REMOVAL OF ALL NECESSARY SIGNAGE, DELINEATORS, MARKERS AND BARRIERS.
 - DO NOT ALTER GRADING OF THE SITE WITHOUT PRIOR APPROVAL OF THE ENGINEER/CITY.

- SEWER NOTES:**
- CONSTRUCT ALL SEWERS, CATCH BASINS, MANHOLES AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY.
 - SEWER TRENCHING AND BEDDING SHALL CONFORM TO OPSD 802.010 AND 802.013 UNLESS NOTED OTHERWISE.
 - BEDDING SHALL BE A MINIMUM 150mm OF GRANULAR "A", COMPACTED TO MINIMUM 95% STANDARD PROCTOR DRY DENSITY. CLEAR STONE BEDDING SHALL NOT BE PERMITTED.
 - SUB-BEDDING, IF REQUIRED SHALL CONSIST OF 450mm OF COMPACTED GRANULAR "B" TYPE 3.
 - BACKFILL TO AT LEAST 300mm ABOVE TOP OF PIPE WITH GRANULAR "A" OR GRANULAR "B" TYPE 1.
 - TO MINIMIZE DIFFERENTIAL FROST HEAVING, TRENCH BACKFILL (FROM PAVEMENT SUBGRADE TO 2.0 METRES BELOW FINISHED GRADE) SHALL MATCH EXISTING SOIL CONDITIONS.
 - SANITARY SEWERS AND CONNECTIONS 150mmØ AND SMALLER TO BE PVC SDR-28.
 - SEWERS AND CONNECTIONS 200mmØ AND LARGER TO BE PVC SDR-35. BEDDINGS TO BE TYPE "B" EXCEPT AT RISERS, UNLESS NOTED OTHERWISE.
 - INSULATE ALL STORM AND SANITARY SEWERS/SERVICES THAT HAVE LESS THAN 1.5m OF COVER WITH THERMAL INSULATION AS PER OPSD 1109.030.
 - SEWER CONNECTIONS ARE TO BE MADE ABOVE THE SPRINGLINE OF THE SEWERMAIN AS PER CITY OF OTTAWA STANDARD DRAWING S11.1 & S11.2.
 - SUPPLY AND INSTALL ALL PIPING AND APPURTENANCES AS SHOWN AND DETAILED TO WITHIN 1.0m OF BUILDING. ALL ENDS OF SERVICES TO BE PROPERLY CAPPED AND LOCATED WITH 2"x4"x8" LONG MARKER.
 - DYE TESTING IS TO BE COMPLETED ON SANITARY SERVICE TO CONFIRM PROPER CONNECTION TO SANITARY SEWER MAIN.

- WATERMAIN NOTES**
- CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY.
 - INDUSTRIAL/COMMERCIAL SERVICE CONNECTIONS TO BE 50mm COPPER PIPING AND SHALL CONFORM TO ASTM 888 TYPE "K" SOFT.
 - WATERMANS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 2.0m. OTHERWISE THERMAL INSULATION IS REQUIRED AS PER CITY STANDARDS (IF AVAILABLE) OR OPSD 1109.030.
 - IF THE WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS EQUAL TO OR LESS THAN THAT WHICH IS RECOMMENDED BY THE MANUFACTURER.
 - THERMAL INSULATION OF WATERMANS AT OPEN STRUCTURES AS PER CITY STANDARDS (IF AVAILABLE) OR OPSD 1109.030.
 - VALVES TO BE OPERATED BY CITY STAFF ONLY.
 - NO CONNECTION TO EXISTING WATER NETWORK SHALL BE COMPLETED UNTIL A WATER PERMIT IS OBTAINED FROM THE CITY. CITY TO BE PRESENT FOR WATERMAIN CONNECTION, CONNECTION, EXCAVATION, BACKFILLING AND REINSTATEMENT TO BE COMPLETED BY CONTRACTOR.
 - IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PERFORM ANY WATERMAIN CONNECTION(S) REQUIRED. THIS SHALL BE COMPLETED IN THE PRESENCE OF A DESIGNATED MUNICIPAL WATER OPERATOR AND THE SELECTED CONTRACTOR SHALL PROVE TO THE SATISFACTION OF THE CITY THAT THEY ARE COMPETENT TO PERFORM THE WORKS PRIOR TO INITIATING CONSTRUCTION.
 - ALL WATERMANS SHALL BE EQUIPPED WITH BUTTERFLY AND GATE VALVES AS PER OPSD 1100.011.
 - ALL FIRE HYDRANTS, VALVE AND VALVE BOX SHALL CONFORM TO OPSD 1103.020.
 - CONCRETE THRUST BLOCKS TO CONFORM TO OPSD 1103.010 AND OPSD 1103.020.
 - ALL WATERMAIN TO BE CLASS 150 DR-18 OR APPROVED EQUIVALENT.
 - ALL WATERMAIN TO BE EQUIPPED WITH TRACER WIRE.
 - CONTRACTOR TO TELETYPE (CCTV) ALL PROPOSED SEWERS ON SITE, OUTLET CONNECTION TO THE MAIN AND PIPES 150mmØ OR GREATER PRIOR TO BASE COURSE ASPHALT. UPON COMPLETION OF CONTRACT, THE CONTRACTOR IS RESPONSIBLE TO FLUSH AND CLEAN ALL SEWERS & APPURTENANCES.
 - DYE TESTING IS TO BE COMPLETED ON SANITARY SERVICE TO CONFIRM PROPER CONNECTION TO SANITARY SEWER MAIN.

SAN STRUCTURE TABLE

NAME	RIM ELEV.	INVERT IN	INVERT OUT	DESCRIPTION
MH1A	99.66	N96.681	S92.180	COVER CITY STD S34 FRAME CITY STD S25 STRUC. OPSD 701.010 1200mm DIAMETER
MH2A	100.56	N97.950	S97.920	COVER CITY STD S34 FRAME CITY STD S25 STRUC. OPSD 701.010 1200mm DIAMETER

WATER COVER TABLE

LOCATION	STATION	FINISHED GRADE	TOP OF PIPE	COVER
A - 200 X 300 TEE	0+100.00	99.85	97.450	2.40
BUILDING	0+113.35	100.000	97.660	2.40
B - 250 X 150 TEE	0+200.00	100.65	98.14	2.40
VALVE	0+200.74	100.64	98.21	2.40
HYDRANT	0+201.66	100.63	98.59	2.40
C - 200 X 300 TEE	0+300.00	99.84	97.440	2.40
VALVE	0+313.70	100.050	97.650	2.40
BUILDING	0+319.26	100.13	97.73	2.40

CROSSING CONFLICT TABLE

LOCATION	DESCRIPTION	SEPARATION
1	200mmØ WTR SERVICE INV 97.25	0.87
2	375mmØ STM SEWER OBY 96.38	0.30
3	200mmØ WTR SERVICE INV 97.37	0.89
4	200mmØ WTR SERVICE INV 97.33	0.30
5	600mmØ WATERMAIN INV 97.14	4.20
6	300mmØ SAN SERVICE OBY 92.94	4.81

Storm STRUCTURE TABLE

NAME	RIM ELEV.	INVERT IN	INVERT OUT	DESCRIPTION
AD1	100.32			C/W 82mm PLUG ICD ICD TO BE PERMANENTLY AFFIXED TO OUTLET PIPE
AD2	100.23			C/W 75mm PLUG ICD ICD TO BE PERMANENTLY AFFIXED TO OUTLET PIPE
AD3	100.28			C/W 90mm PLUG ICD ICD TO BE PERMANENTLY AFFIXED TO OUTLET PIPE
AD9	100.32			
AD11	100.21			PER CITY S30 C/W RODENT GRATE AND FILTER SOCK
CB4	100.30	N97.897	E97.880	OPSD 701.010
CB10	100.54	N97.765	E97.750	PER OPSD 705.010
MH1	100.52	N96.420	S96.396	COVER CITY STD S24.1 FRAME CITY STD S25 STRUC. OPSD 701.012 1200mm DIAMETER
MH2	101.21	N98.100		COVER CITY STD S24.1 FRAME CITY STD S25 STRUC. OPSD 701.012 1200mm DIAMETER
TCB5	100.30	SW98.150	E98.110	PER CITY S30 C/W RODENT GRATE AND FILTER SOCK
TCB6	100.46	NE98.230	W98.121	PER CITY S30 C/W RODENT GRATE AND FILTER SOCK
TCB7	100.30	E98.040	S97.980	PER CITY S30 C/W RODENT GRATE AND FILTER SOCK
TCB8	100.45	N97.827	S97.810	PER CITY S31 C/W RODENT GRATE AND FILTER SOCK

McINTOSH PERRY
115 Walgreen Road, RR3, Carp, ON K0A 1L0
Tel: 613-836-2184 Fax: 613-836-3742
www.mcintoshperry.com

Client: **KANATA WOODS INC**
205 - 1600 LAPERRIERE AVE
OTTAWA, ON K1Z 8P5

Project: **THE WOODS**
180 KANATA AVE

Drawing Title: **SITE SERVICING PLAN**

Scale: 1:300 Project Number: CCO-21-3764

Drawn By: R.R.R. Checked By: C.J.M. Designed By: C.J.M.

Drawing Number: C102

FILENAME: U:\City\01\Projects - Proposed\2021\06\CCO-21-3764\The Woods - OPSD Commercial Draw\12 - Drainage\CCO-21-3764_Presentation.dwg
LAST SAVED: Tuesday, August 30, 2022 1:45:54 PM
LAST PLOTTED: Tuesday, August 30, 2022 2:02:12 PM

D07-12-21-0098