



Site Servicing Report & Stormwater Management Study

The Hindu Heritage Center of Ottawa-Carleton
4835 Bank Street
Ottawa, Ontario K1X 1G6

Prepared for:
The Hindu Heritage Center of Ottawa-Carleton
c/o Lloyd Philips & Associates Ltd.
1827 Woodward Drive, Suite 109
Ottawa, Ontario K2C 0P9

Attention: Mr. Harish Gupta

EXECUTIVE SUMMARY

LRL Associates Ltd. has been mandated by Harish Gupta, of the Hindu Heritage Centre, to prepare a Site Servicing Report and SWM Study for the new assembly hall development at the Hindu Heritage Center of Ottawa-Carleton located at 4835 Bank Street, Ottawa, Ontario.

The analysis concluded that the 1/5 and 1/100-year post development runoff discharge can be controlled to the 1/5-year pre-development levels or less. We also demonstrated that an enhanced water quality protection level of 80% TSS removal can be achieved for the controlled runoff using a Stormwater Treatment Unit (Jellyfish Filter) prior to discharging stormwater into the existing watercourse.

Furthermore, the proposed water distribution network will be adequate to service the new assembly hall building. The maximum hourly demand is calculated at 8.18 L/s, and the corresponding minimum residual pressure is 61.14 psi. The maximum day demand including total fire flow (for both proposed and existing building) is 174.18 L/s, and the resulting residual minimum pressure is 24.73 psi.

TABLE OF CONTENTS

1	INTRODUCTION	1
2	FIELDWORK.....	2
3	STORMWATER MANAGEMENT	2
3.1	Existing Stormwater Conditions.....	2
3.2	Proposed Post-development Watersheds.....	2
3.3	Design Criteria	3
4	QUANTITY CONTROL.....	3
5	STORM RUNOFF QUALITY REQUIREMENTS	4
6	LOW IMPACT DEVELOPMENT.....	5
7	WATER SERVICE.....	5
7.1	Domestic Water Demand.....	5
7.2	Fire Flow Requirements	6
7.3	Boundary Conditions	7
7.4	Water Distribution Network Hydraulic Modeling	7
7.5	Expected Water Service Pressure	7
8	SANITARY SERVICE.....	8
9	MAINTENANCE	8
10	SEDIMENT AND EROSION CONTROL	8
11	CONCLUSIONS.....	9
12	REPORT CONDITIONS AND LIMITATIONS.....	9

APPENDICES

- Appendix A Key Plan**
- Appendix B Pre & Post Watershed Plans**
- Appendix C Flow Restrictor Information**
- Appendix D Volume Table Generated by AutoCAD Civil 3D**
- Appendix E Stormwater Treatment Devices**
- Appendix F Stormwater Management Plan**
- Appendix G Architectural Drawings**
- Appendix H Servicing Plan**
- Appendix I Erosion and Sediment Control Plan**
- Appendix J Domestic Water Demand Calculations**
- Appendix K Pipe Pressure Loss Calculation Details**
- Appendix L FUS Fire Flow Calculations**
- Appendix M City of Ottawa Boundary Conditions**
- Appendix N 1/5 Year & 1/100 Year SWM Storage Tables**
- Appendix O Civil Engineering Plans**
- Appendix P Septic Design**

1 INTRODUCTION

LRL Associates Ltd. has been mandated by Lloyd Philips & Associates Ltd. to prepare a Site Servicing Report and Stormwater Management Study for the development of a new assembly hall at the Hindu Heritage Center of Ottawa-Carleton, located at 4835 Bank Street, Ottawa, Ontario. The property is legally described as Part of Lot 22, Concession 5 (Rideau Front), Geographic Township of Gloucester, City of Ottawa. The Key Plan for the proposed site has been included in Appendix A.

The subject property is rectangular in shape, with a frontage of 101.92 m and depth of 401.53 m. The property's total surface area is 4.06 ha. The West portion of the site is currently composed of an existing single storey temple (combined gross floor area of 1062 m², with basement) with landscaped area bordering its North, West and South ends. An existing asphalt parking lot is located adjacent to the East end of the temple. An asphalt roadway (Temple Road) follows the South property line below the landscape area & existing temple, providing access to the existing parking lot. At roughly the center of the property lies an existing creek, running South to North. All property located East of the creek is wooded area.

The proposed addition, the assembly hall, will be a single-story building (with full basement). The proposed development will have a total gross main floor area of approximately 1400 m². The assembly hall will be located East of the existing temple and parking lot, and West of the creek.

Currently, the existing building is serviced by a 150 mmØ water service running West to East along Temple Road. In order to provide water to the proposed development, the service will need to be extended roughly 131m Easterly. The new water service will be designed in order to supply the new domestic and fire flow building demands, as well as the proposed fire hydrant.

As there are no sanitary mains located along Bank Street, the proposed building will have to be serviced by a septic system. The proposed septic system will be located directly South of the proposed assembly hall. It will be designed to suit the new building sanitary needs as per the Ontario Building Code - Part 8. The Ottawa Septic System Office (OSSO) will be issuing the permit for the new septic system.

As per the City of Ottawa's requirements, all storm runoff will be controlled to pre-development levels for a 5-year storm event. All surplus runoff will be conveyed to, and controlled in a detention area before being treated and discharged to the existing water course. Stormwater quality control will meet the 80% minimum TSS removal requirements, as per the South Nation Conservation Authority (SNCA) requirements.

This report has been prepared in consideration of the terms and conditions noted above. Should there be any changes in the design features, which may relate to the water or sanitary considerations, LRL Associates Ltd. should be advised in order to review the report's recommendations.

2 FIELDWORK

The topographic survey of the property was conducted on April 27th, 2017 by Annis, Sullivan Vollebeckk Ltd. (Ontario Land Surveyors). A site benchmark was established during the survey for future construction use. The benchmark provided is the top of spindle (elevation 100.17 m) of the existing fire hydrant found between the existing temple and existing access roadway, at the South-West corner of the existing parking lot.

3 STORMWATER MANAGEMENT

3.1 Existing Stormwater Conditions

In pre-development conditions, all stormwater flows off-site uncontrolled.

The site follows a few overland flow patterns, which will be broken down below.

First, there is the front (West) section of the property, which encompasses the existing Hindu Temple, and surrounding North, West and South landscape. The site was graded down from the Temple building, so naturally, stormwater will flow from the temple to the nearest property line. Stormwater in the North and West landscape areas will flow North / North-West / West to the respective property lines. Stormwater south of the building will flow to the South, and captured & conveyed East by the existing ditch (running along the North end of the existing asphalt driveway)

The second section of the property, the rear (East) end, encompasses the existing parking lot, and surrounding North, East and South landscape. The existing parking lot was developed with a high point running along the center (West to East), with a slight slope towards the East. All stormwater on the North end of the parking lot is conveyed North-West to the North property line. All stormwater on the South end of the parking lot is conveyed South / South-West to the South property line. All stormwater accumulated at the rear end of the property would continue to flow East, until ultimately should reach the existing creek.

The final section of the property is the driveway running along the South property line. All stormwater from this asphalt surface will be conveyed North / North-east to the ditch running along the driveways North end.

Please refer to civil plan C701 – Pre-Development Watershed Plan for greater detail.

3.2 Proposed Post-development Watersheds

For stormwater management design purposes, the site was divided into four watershed areas;

WS-01 – Existing building, grass area, ditch & driveway South of the existing building, South existing parking lot & proposed ditch, proposed building and grass area & detention area South of the proposed building

WS-02 – North section of the existing parking lot, including North grass area

WS-03 – Grass area North and South of the existing Temple

WS-04 – Grass area at the South-East corner of the property

The watershed delineations can be seen in Civil Plan C702 – Post-development Watershed Plan.

As per the EIS (Environmental Impact Statement) developed for this site, we could not perform any works, or include any stormwater management structures, within a 20m setback from the existing creek. This 20m setback was delineated as the East boundary of our scope of work.

Watershed 01 is proposed as a control area, where stormwater will be controlled and treated prior to being released at the 20m setback line (and ultimately flowing overland to the existing creek).

Watershed 02 is proposed as an uncontrolled area, where stormwater will flow off the site uncontrolled, as it did in previous conditions. Though no means of flow control will be implemented here, the stormwater in this area will be collected and treated prior to being released.

Watersheds 03 and 04 are proposed as uncontrolled areas. No flow control or treatment are proposed for these areas, stormwater will flow off the site uncontrolled, as it did in previous conditions. As large majority of these watersheds are landscaped/grassed areas, additional treatment isn't an absolute necessity.

3.3 Design Criteria

The stormwater management criteria for this development are based on pre-consultation with City of Ottawa officials (which occurred on June 5th, 2019), the City of Ottawa Sewer Design Guidelines including City of Ottawa Stormwater Management Design Guidelines, 2012 (City standards), as well as the Ministry of the Environment's Stormwater Management Planning and Design Manual, 2003 (SWMPD Manual).

As discussed during the pre-consultation meeting, all storm events up to and including the 100-year event would be controlled to the 5-year pre-development level, using a smaller runoff coefficient (C) of 0.5 or the actual site C, and time of concentration of 10 minutes. The runoff generated from the existing site was calculated using the Rational Method, as follows:

$$Q = 2.78 \times C \times I \times A$$

Where,

C = the runoff coefficient (*C* = 0.49)

I = the rainfall intensity (mm/hr) (*I*₅ = 104.2 mm/hr at a *T*_c = 10 min)

A = Area (2.223 ha)

$$Q_{\text{allowable 1/5yr (pre-dev)}} = 2.78 \times 0.49 \times 104.2 \text{ mm/hr} \times 2.223 \text{ ha} = 316.44 \text{ L/s}$$

As per the watershed delineation provided in section 3.2, in the 100-year storm event, the maximum uncontrolled runoff was calculated to be 249.38 L/s. With an allowable release rate of 316.44 L/s, this would leave us to have to control the balance of the site to a controlled release rate of 67.06 L/s.

4 QUANTITY CONTROL

The area at the South of proposed building is large enough to accommodate a substantial detention area. This proposed detention area, equipped with an inlet control device (ICD) at the outlet, would serve as a primary means of flow control for all controlled stormwater on-site.

To achieve the aforementioned, it was determined that the release rate would have to be controlled to approximately 67.00 L/s for the 100yr storm event, and 48.00 L/s for the 5yr storm

event. The release rate will be controlled by installing an ICD in the outlet maintenance hole (MH01) whereas the excess runoff will be conveyed to and stored in the proposed detention area, upstream of MH01. Please refer to Appendix C for greater details regarding the proposed ICD.

The maximum storage volumes required to contain the 5- and 100-year post-development storm events were calculated to be **173.80 m³** and **427.85 m³**, respectively. For storage volume calculations, the controlled release rate was taken as half of the discharge rate.

The detailed storage calculations can be found in Appendix N.

All controlled overland flow will be conveyed to the proposed detention area, located near the South-East corner of the proposed assembly hall, by means of the existing grading, as well as the extension of the existing ditch (running West to East along the South property line). The excess runoff will ultimately be stored above ground in the proposed detention area. No ponding will occur on the existing landscaped area, parking lot or pathways during high-level storm events. However, during the 5- and 100-year storm events, some ponding will occur in ditch South-West of the detention area, due to the proposed grading of these elements. The Stormwater Management plan (Civil Plan C601), provided in Appendix F, demonstrates the extent of storage and high-water levels for both the 100- and 5-year storm events.

AutoCAD Civil 3D was used to determine the maximum storage volume and high-water level of the proposed detention area. A Cut/Fill table was generated by the program, which can be seen in Appendix D of the report. The maximum storage volume generated by Civil 3D (428.14 m³) was found to be greater than the required storage previously calculated (427.85 m³). Therefore, the detention area & ditch will be enough to retain the excess runoff generated by a 100-year major storm event.

5 STORM RUNOFF QUALITY REQUIREMENTS

As previously mentioned, the site will be developed so that the post-development controlled runoff will ultimately be discharged at the 20m setback line. As discussed in the pre-consultation meeting with the City of Ottawa, in order to meet the water quality objective, it is required to achieve an enhanced level of protection of 80% total suspended solid (TSS) removal. This can be achieved using a water quality treatment unit.

Considering the post-development watershed area that requires water quality treatment (1.316 ha), (as seen in Appendix B – Post-Development Watershed Plan), it is proposed to install a Jellyfish JF6-4-1 stormwater treatment unit (or approved equivalent). The Jellyfish JF6-4-1 will serve to remove a minimum 80% of the TSS while treating 90% off the annual runoff. Please refer to Appendix E for the selection, type and additional information on the treatment unit.

Stormwater treatment has also been proposed in Watershed WS-02 (consisting of the North half of the existing parking lot). Stormwater in this area will be conveyed to a catchbasin proposed at the North-East corner of the parking lot. The catchbasin will be equipped with a FlexStorm Pure inlet filter. The inlet filter will not provide the full 80% TSS removal, however, it will provide substantial treatment of runoff from the North parking lot. The treated flow from the catchbasin and inlet filter will then be conveyed to a proposed infiltration gallery.

Greater details for the inlet filter can be found in Appendix E and infiltration gallery can be found on Civil Plan C902.

6 LOW IMPACT DEVELOPMENT

As per the EIS performed for this site, the proposed development should occur with large focus towards Low Impact Development (LID).

At the rear of the property is located an existing creek. A 20m setback was proposed from the creek as a means of protecting the sensitive resource. This setback was respected in the stormwater management design for the site.

The initial design focused on maintaining as much of the existing grass area and landscape elements (trees) as possible. Any addition to the parking lot was offset by incorporating landscape within the parking lot. The roof drains will also lead flows to either the ditch or detention area, in order to maximize the potential for captured water infiltration.

All controlled runoff is ultimately being treated by the Jellyfish stormwater treatment unit (or approved equivalent). Prior to this, the stormwater will succumb to other means of stormwater treatment. The ditches are low-sloping, and equipped with a subdrain & clear stone, to promote filtration and infiltration. Ditch culvert inverts have been slightly raised at the inlets in order to promote additional ponding and infiltration. The proposed detention area spans a large area; this works increases ground infiltration and treatment of the detained stormwater. The detention area is low sloping, encouraging additional infiltration and decreasing sediment conveyance.

The uncontrolled runoff, specifically the runoff from the North half of the parking lot, will progress through two forms of treatment prior to being released. The stormwater will be captured by a catchbasin installed at the North-East end of the parking lot. The captured runoff will first be treated with a Flexstorm Pure inlet filter. This inlet filter will not provide the full 80% TSS removal, however, it will provide substantial treatment of runoff from the North parking lot, targeting contaminants such as trash, litter, leaves, smaller particles, oil and grease. This treated stormwater will then be conveyed to a proposed infiltration gallery. The infiltration gallery, equipped with a perforated subdrain and clear stone trench, will provide further treatment, and greatly encourage infiltration. The infiltration gallery was designed to retain a volume of stormwater from the first 5mm rainfall over the watershed WS-02. This translates to a storage volume of 20.55 m³.

In addition, additional landscaping elements will be incorporated to the site to improve site aesthetic. The detention area will serve to improve the open land use and site development aesthetic.

7 WATER SERVICE

7.1 Domestic Water Demand

The average domestic water demand, the maximum daily domestic water demand and the maximum hourly domestic water demand were calculated using the number of equivalent plumbing fixtures (as per the OBC) for the proposed new assembly hall building. The plumbing fixtures were determined based on the Architectural Drawings, as seen in Appendix G.

Table 1 included below demonstrates the type, quantity and equivalent number of fixtures units proposed in the new development.

Table 1 - Number of Equivalent Plumbing Fixtures for Proposed Building

Fixture Description	Quantity	Hydraulic Load (Public Use)	Fixture Units
Toilet	23	2.2	50.6
Sink	23	1.5	34.5
Shower	2	3	6
Mop service sink	2	2.25	4.5
Urinal	8	3	24
Total			120

The domestic water demand was determined based on the calculated total fixture units for the proposed building. To summarize, a total equivalent fixture unit count of 120 resulted an average daily water demand of 3.03 L/s (261,648 L/day), a maximum daily demand of 4.54 L/s (392,471 L/day), and a maximum hourly demand of 8.18 L/s (706,448 L/day).

With reference to OBC Table 7.6.3.2.A, calculated total fixture unit for the existing building was calculated to be 55, resulting in an average daily water demand of 1.96 L/s (168,980 L/day), a maximum daily demand of 2.93 L/s (253,471 L/day), and a maximum hourly demand of 5.28 L/s (456,248 L/day).

Detailed calculations can be found in Appendix J.

A new watermain, with dual connection, was proposed on site to service both the existing building, new building, and fire hydrants. The water service connection to the new building was designed and sized to obtain a desired residual pressure range as per Section 4.2.2 of City of Ottawa Design Guidelines – Water Distribution. The new water service layout can be found in the Servicing Plan, included in Appendix H.

7.2 Fire Flow Requirements

The minimum fire flow rate required has been calculated using the Fire Underwriters Survey (FUS) method. The fire flow is derived from the proposed building surface area, the type of construction, the combustibility and the separation distances to other adjacent buildings.

Fire flow for both the existing and proposed buildings have been considered for the extent of this report.

The effective building area of the proposed assembly hall building is 1560 square meters, it is to be of non-combustible construction and sprinklered. The required fire flow rate was determined to be 4,000 L/min (66.7 L/s). The effective building area of the existing building on-site assembly hall building is 1062 square meters, of non-combustible construction, and non-sprinklered. The required fire flow rate was determined to be 6,000 L/min (100.0 L/s).

Detailed calculations can be found in Appendix L.

To ensure that the proposed watermain can supply the required fire flow via the proposed new fire hydrant on-site, additional hydraulic analysis have been performed using EPANET (Version 2.2). The modeling results show that the proposed water distribution network is able to meet the required fire flow while the residual pressure, at any point in the distribution network, is greater than 20 psi.

7.3 Boundary Conditions

The boundary conditions for this development were obtained from the City of Ottawa on June 16th, 2022, based on the calculated water demands and fire flow. Two sets of boundary conditions were provided for the development: the first for the existing water distribution system and the second for the future SUC zone reconfiguration. Both have been considered for the purposes of this report.

The maximum and minimum water pressure provided for Bank Street for the existing water distribution system are 79.3 psi and 62.7 psi, respectively, and the pressure corresponding to the Max. Day + Fire is 37.4 psi.

The maximum and minimum water pressure provided for Bank Street for the SUC zone reconfiguration water distribution system are 71.2 psi and 65.0 psi, respectively, and the pressure corresponding to the Max. Day + Fire Flow is 59.0 psi.

Refer to Appendix M (City of Ottawa Boundary Conditions) and Appendix K (EPANET Modelling) for additional information.

7.4 Water Distribution Network Hydraulic Modeling

To decrease vulnerability of the water distribution system, the subject site is proposed to have two (2) service connections which will be looped inside the property line, refer to Site Servicing Plan C401 for a proposed layout. To study the behavior of the network and obtain operating pressure under different flow scenarios, the proposed network was modeled and analyzed using EPANET software (Version 2.2). The hydraulic model uses two supply reservoirs with HGL provided by City Boundary Conditions at different flow scenarios. The first connection is represented by Reservoir R1 and the second connection is represented by Reservoir R2 at Bank St. Six (6) different flow scenarios were analyzed. The summary of modeling results is summarized in Table 2 below and greater details can be found in Appendix K.

7.5 Expected Water Service Pressure

For Scenario 1, the anticipated average day demands are applied to node J14 for the proposed new building and node J16 for the existing building. The residual pressures calculated using EPANET hydraulic analysis are summarized in Table 2. The procedure is repeated for Scenario 2 (Peak Hour). For scenario 3, the calculated fire flow demands are applied to the fire hydrant connection nodes with maximum day domestic demand simultaneously applied to building service entry nodes. For modeling results including pipe pressure, refer to Appendix K.

According to City Guidelines-Water Distribution, the maximum pressure at any point in the distribution system shall not exceed 80 psi. However, for Scenario 1, the calculated pressures of 80.94 and 82.65 psi are greater than 80 psi, therefore a pressure reducing valve is required for both existing building and the proposed new building. Scenario 2 (Peak Hour) and Scenario 3 (Max Day+ Fire Flow) residual pressure exceeds required minimum of 40 and 20 psi respectively, thus appears acceptable.

Table 2 - Summary of Residual Pressures (psi)

Scenario	Existing Building		Proposed New Building	
	Existing Conditions	SUC Zone Reconfiguration	Existing Conditions	SUC Zone Reconfiguration
Scenario 1: Avg Day	80.94	72.83	82..65	74.55
Scenario 2: Peak Hour	61.14	63.41	65.81	68.08
Scenario 3: Max Day + Fire Flow	24.73	31.23	27.31	33.81

Note: The residual pressures correspond to service entry nodes J14 (proposed new building) & J16 (existing building).

8 SANITARY SERVICE

Based on the existing plans and City of Ottawa resources (geoOttawa), it was apparent that there was no existing municipal sanitary sewer located along Bank Street. Therefore, the development of the new assembly hall will necessitate the design & installation of a new septic system.

The new septic system has been designed under Part 8 (Sewage System) of the OBC, which has been reviewed and approved by the Ottawa Septic System Office (OSSO). The proposed septic system will be constructed on the South side of the proposed building, North of the proposed ditch.

Refer to the Site Servicing Plan in Appendix H for the proposed location of the new septic system. Refer to Appendix P for the septic design.

Greater detail can be found in with reference to the LRL Terrain Analysis and Private Sewage Disposal System Impact Assessment (dated May 2022).

9 MAINTENANCE

Monitoring and maintenance are an important component for all types of stormwater management practices. It ensures performance efficiency of the facilities and prevents undesirable consequences such as flooding or contamination to the neighboring properties.

The maintenance of the proposed stormwater treatment unit (Jellyfish Filter) would consist of inspecting the structure (inlet, outlet, cover etc.) on a periodic basis and cleaning them as deemed necessary. The structure should be cleaned (pumped) of its sediments and hydrocarbons content at least once a year, as per the manufacturer recommendations. It is the responsibility of the owner to maintain and clean the treatment unit and keep a log of all the maintenance activities.

10 SEDIMENT AND EROSION CONTROL

Sediment and erosion control measures will be implemented before and during the construction of this project. Typical control measures such as silt fences and sediment straw bail fences are mandatory. For this project, a silt fence will be erected along the perimeter of the development area. A sediment straw bail fence will be constructed downstream of the proposed new ditch, upstream of the proposed detention area. In addition, a mud mat will be installed at the entrance

of the proposed development unit. Refer to drawing C101 – Erosion and Sediment Control Plan (Appendix I) for additional details.

11 CONCLUSIONS

The analysis concluded that the 5- and 100-year post-development runoff discharge can be controlled to the 5-year pre-development level. We also demonstrated that an enhanced water quality protection level (80% TSS removal) can be achieved with a stormwater treatment unit prior to discharging controlled treated stormwater into the existing watercourse.

Furthermore, the proposed water distribution network will be adequate to service the new assembly hall building, as well as existing building and fire hydrants.

The sanitary servicing will consist of the construction of a new septic system.

12 REPORT CONDITIONS AND LIMITATIONS

The report conclusions are applicable only to this specific project described in the preceding pages. Any changes, modifications or additions will require a subsequent review by LRL Associates Ltd. to ensure the compatibility with the recommendations contained in this document.

If you have any questions or comments, please contact the undersigned.

Yours truly,
LRL Associates Ltd.



Prepared by:

Kyle Herold



Approved by:

M. Basnet, P. Eng.

APPENDIX A
Key Plan



LRJ

ENGINEERING | INGÉNIERIE

5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrf.ca | (613) 842-3434

PROJECT

PROPOSED ASSEMBLY HALL
4835 BANK STREET, OTTAWA

DRAWING TITLE

KEY PLAN

CLIENT

THE HINDU HERITAGE CENTRE OF OTTAWA-CARLETON


DATE

20FEB2020

PROJECT

170132

KP

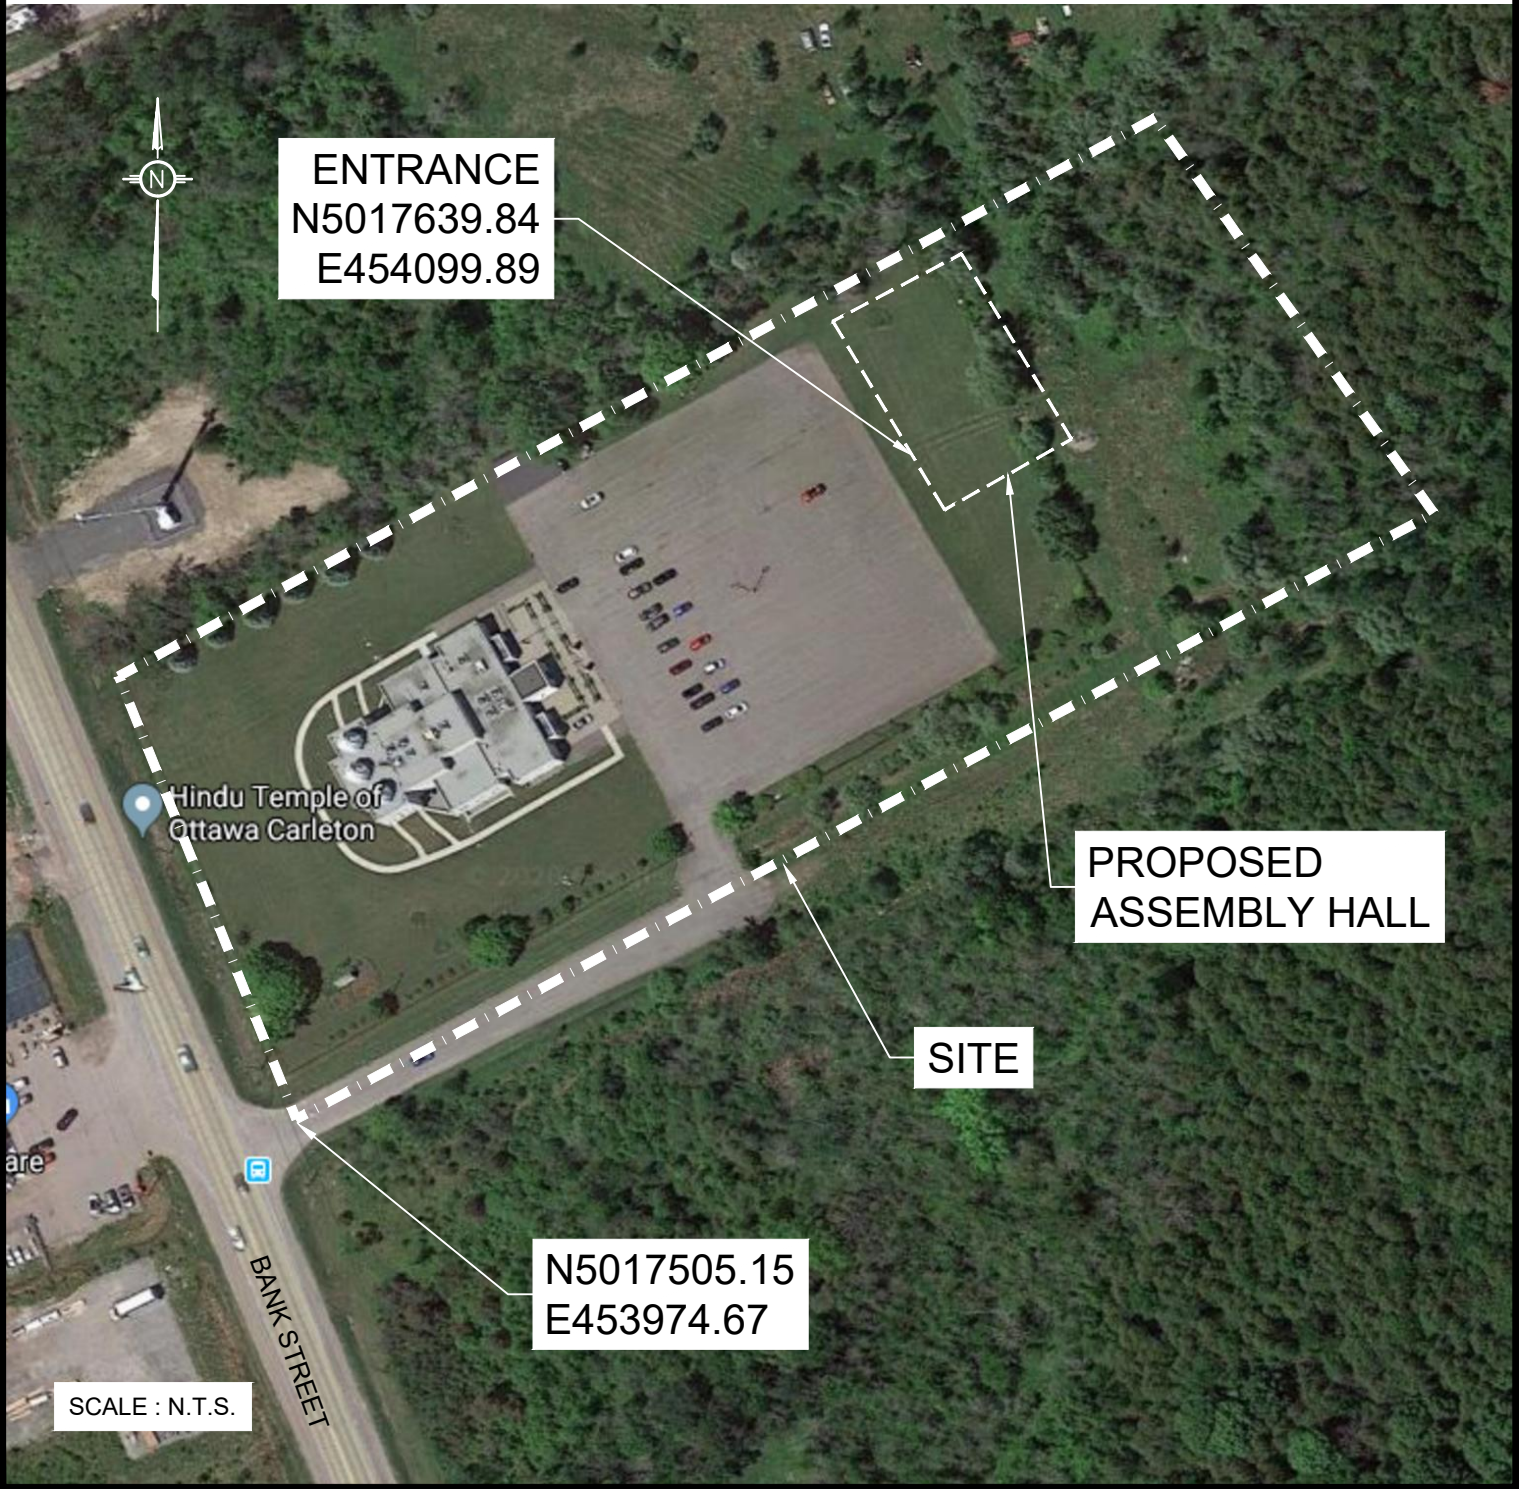

ENTRANCE
N5017639.84
E454099.89

PROPOSED
ASSEMBLY HALL

SITE

N5017505.15
E453974.67

SCALE : N.T.S.

BANK STREET

Hindu Temple of
Ottawa Carleton

APPENDIX B
Pre & Post Watershed Plans

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEKK LTD.
 PROJECT NO. 19614-17 HINDU TEMPLE
 DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES
 1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
 3. Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Only visible surface utilities were located.
 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
 For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
 SITE AREA = 4.048 Hectares.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- SUB PROPOSED 100mmØ PERFORATED SUBDRAIN
- STM PROPOSED STORM SEWER
- SAN PROPOSED SANITARY SEWER
- WTR PROPOSED WATERMAIN
- STM EXISTING STORM SEWER
- SAN EXISTING SANITARY SEWER
- WTR EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY IRL ASSOCIATES LTD. (IRL) WITHOUT OBTAINING IRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST IRL AND TO RELEASE IRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS IRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACT FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO IRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF IRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH IRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.


GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DRAWINGS, WHETHER THEY CONVEY OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

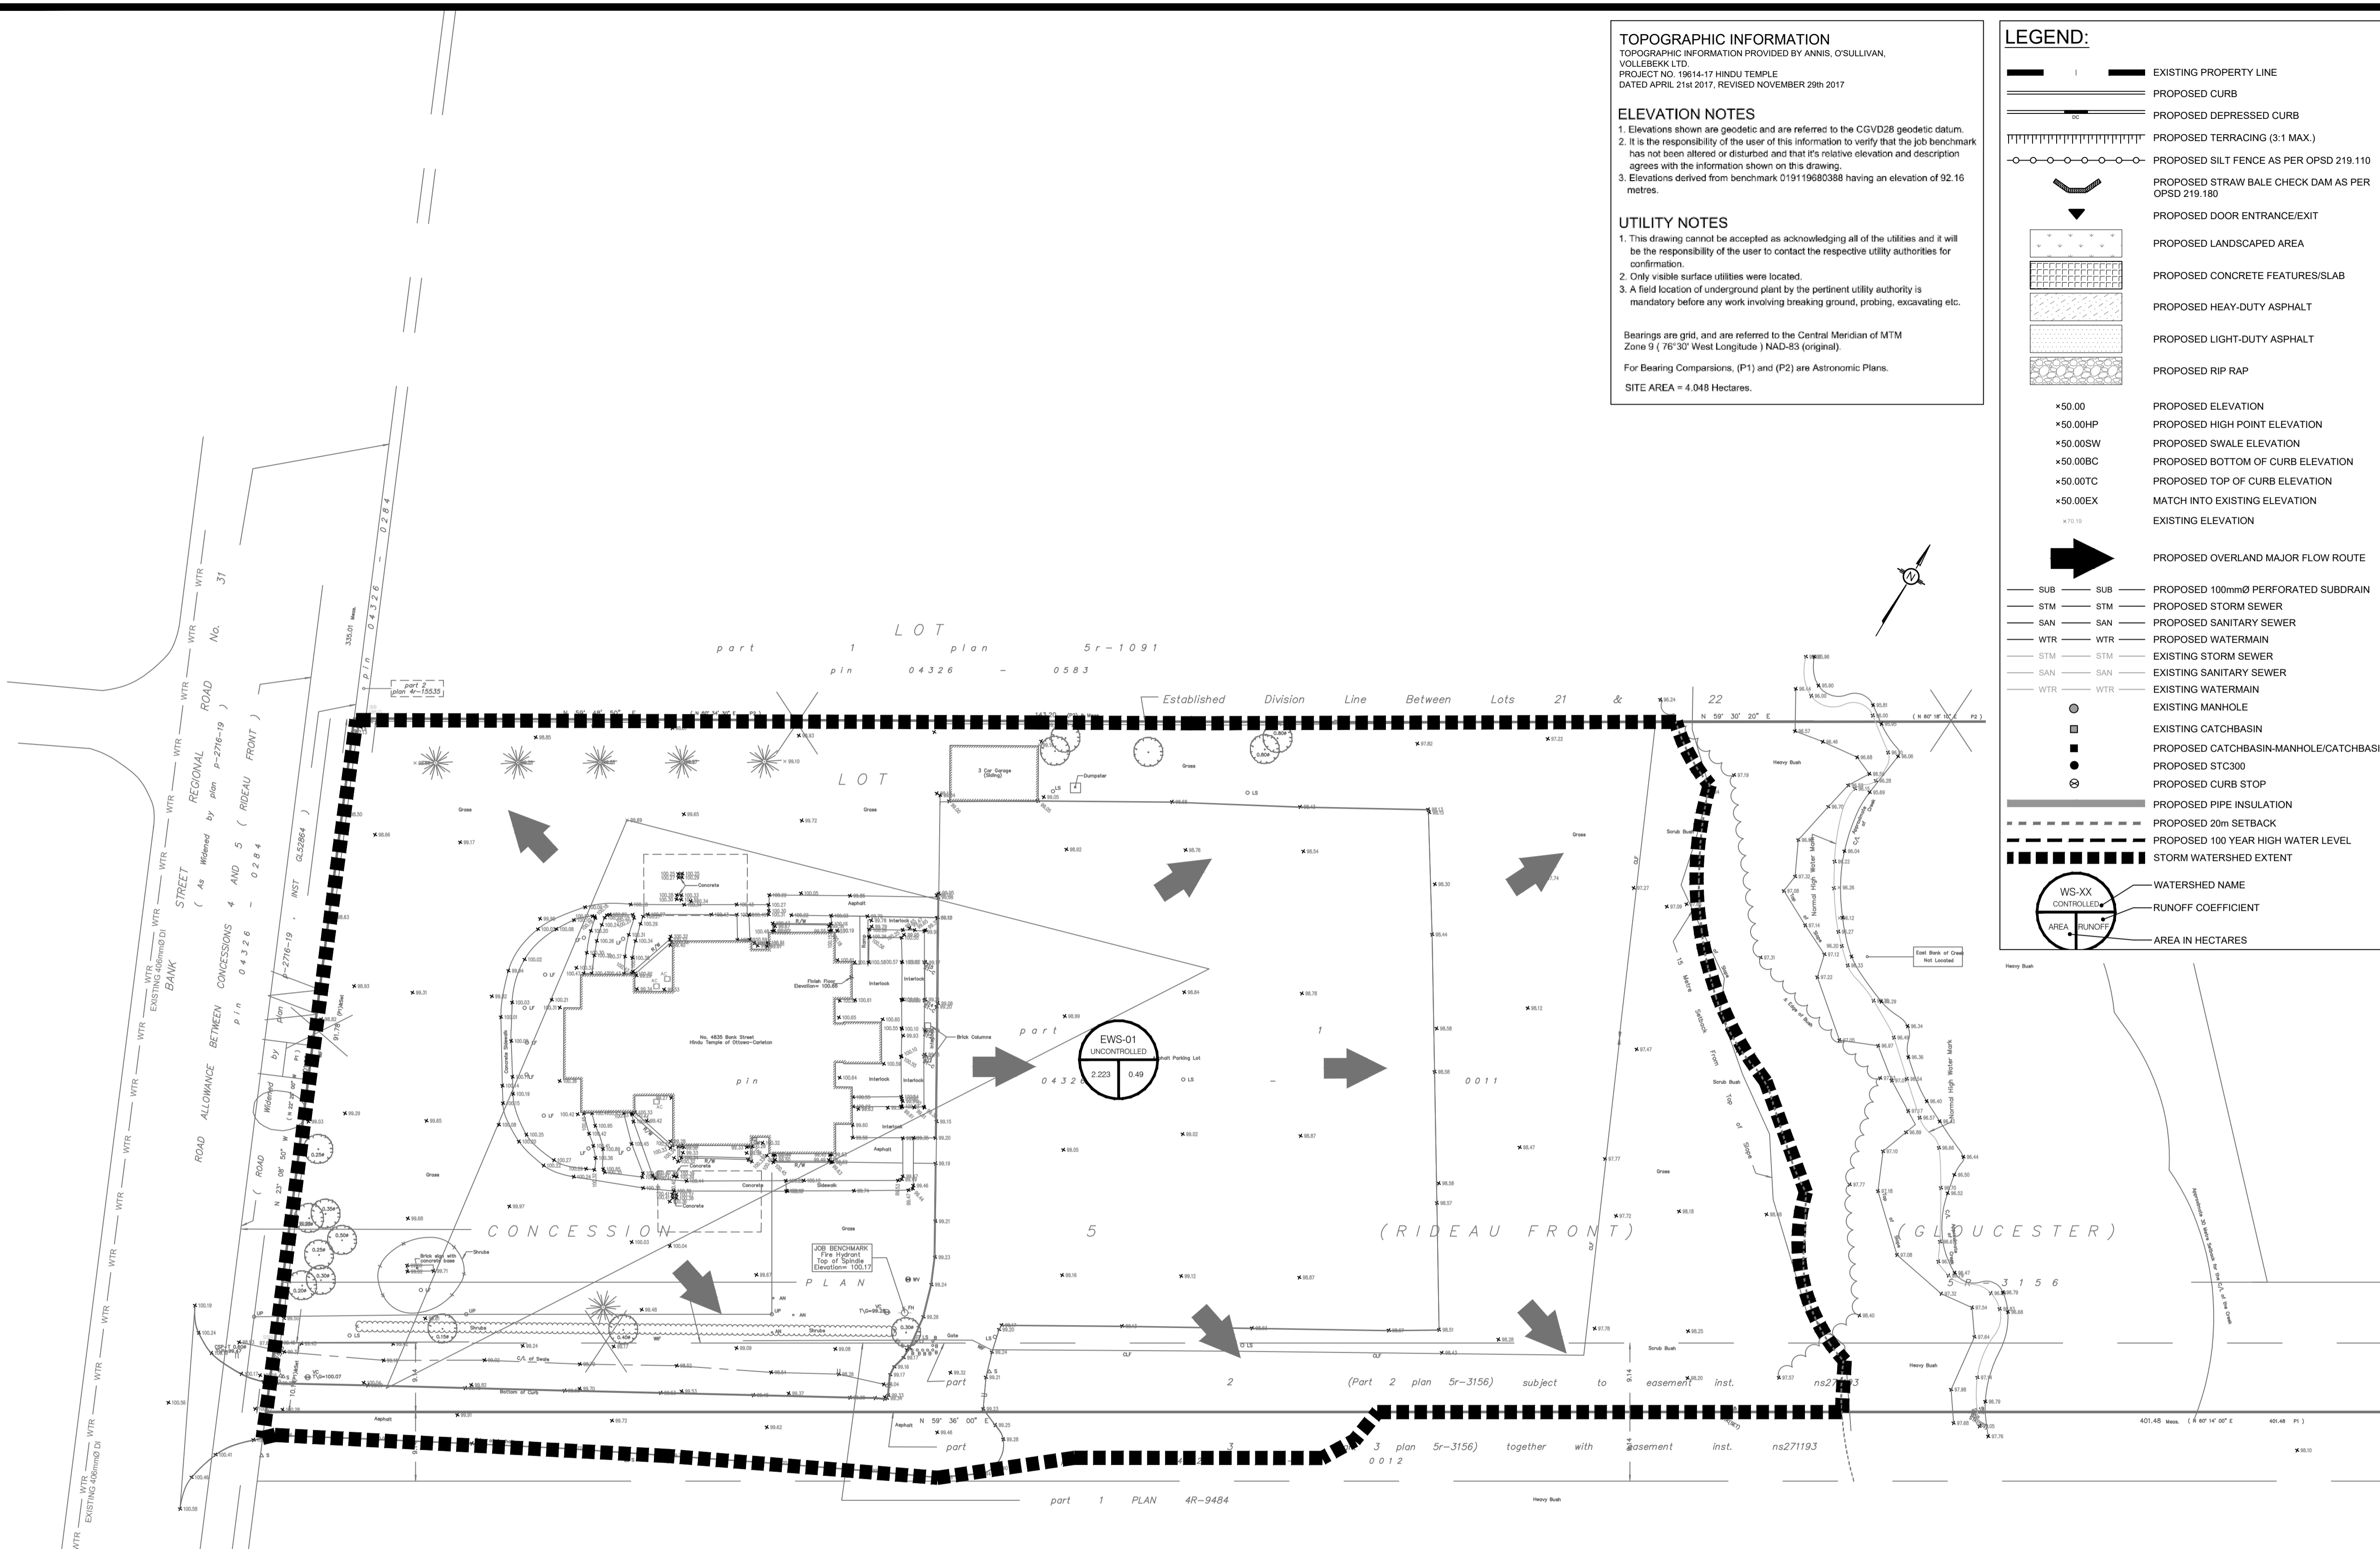

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
 ENGINEERING | INGENIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON

DESIGNED BY:	DRAWN BY:	APPROVED BY:
P.P.	K.H.	M.B.

PROJECT: PROPOSED ASSEMBLY HALL
 4835 BANK STREET, OTTAWA

DRAWING TITLE: PRE-DEVELOPMENT WATERSHED PLAN

PROJECT NO: 170132
 DATE: JAN2020

C701

File no.: D017-12-20-0059

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEK LTD.
 PROJECT NO. 19614-17 HINDU TEMPLE
 DATED APRIL 21st 2017, REVISED NOVEMBER 20th 2017

ELEVATION NOTES
 1. Elevations shown are geoidic and are referred to the CGVD28 geoidic datum.
 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
 3. Elevations derived from benchmark D19119680388 having an elevation of 92.16 metres.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Only visible surface utilities were located.
 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
 For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
 SITE AREA = 4.048 Hectares.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- ×50.00 PROPOSED ELEVATION
- ×50.00HP PROPOSED HIGH POINT ELEVATION
- ×50.00SW PROPOSED SWALE ELEVATION
- ×50.00BC PROPOSED BOTTOM OF CURB ELEVATION
- ×50.00TC PROPOSED TOP OF CURB ELEVATION
- ×50.00EX MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- SUB PROPOSED 100mmØ PERFORATED SUBDRAIN
- STM PROPOSED STORM SEWER
- SAN PROPOSED SANITARY SEWER
- WTR PROPOSED WATERMAIN
- STM EXISTING STORM SEWER
- SAN EXISTING SANITARY SEWER
- WTR EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WS-XX WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA PLUNOFF
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS
 GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:
 IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES, TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:
 EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DRAWINGS, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
 ENGINEERING | INGÉNIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrl.ca | (613) 842-3434


CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON
 DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: POST-DEVELOPMENT WATERSHED PLAN

PROJECT NO: 170132
 DATE: JAN2020

C702

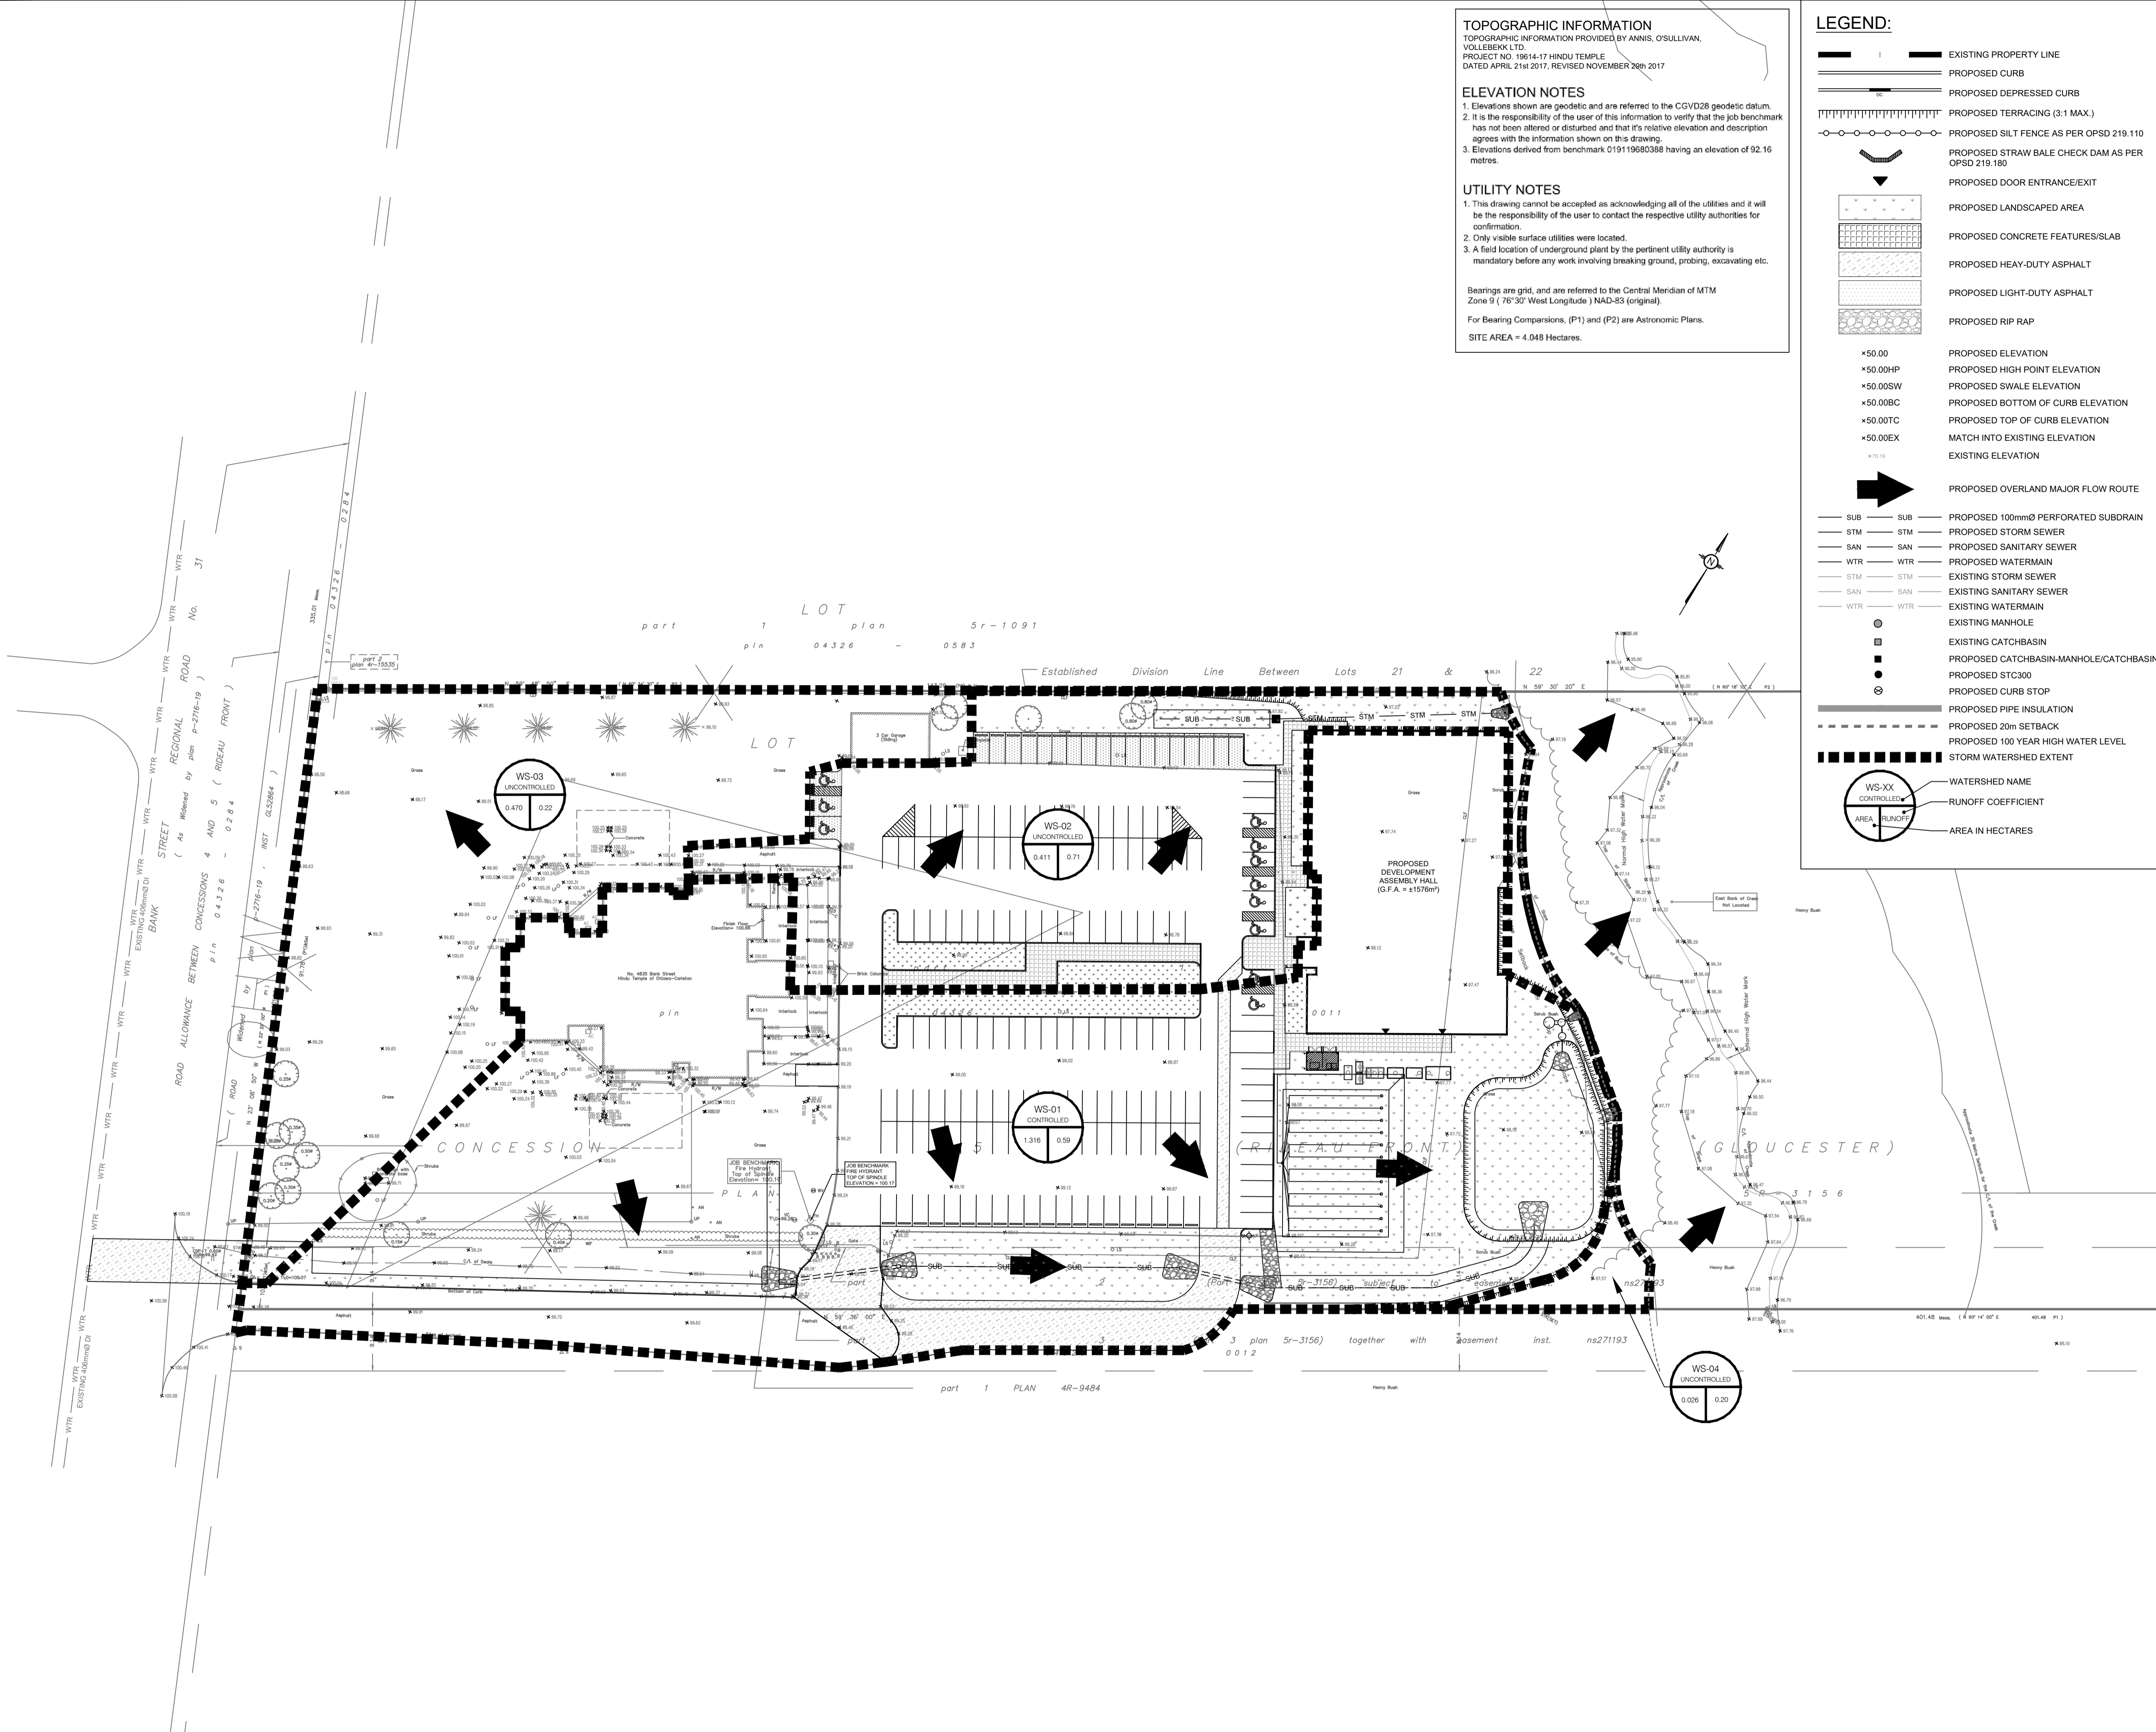

File no.: D017-12-20-0059

APPENDIX C
Flow Restrictor Information



LRL File No. 170132
Project: Hindu Heritage Center
Location: 4835 Bank Street, Ottawa
Date: 31-Oct-22
Designed: K. Herold
Checked: M. Basnet
Drawing Ref.: C.401

**Stormwater Management
Design Sheet**

Orifice Equation

$$Q = 0.61 * A * \text{sqrt} (2 * g * H)$$


Where; Q = release rate (in m3/s)
 0.61 = coefficient
 A = area of the orifice (m2)
 g = gravitational constant (9.81 m/s2)
 H = head (above CL of orifice (m))

ICD Diameter (based on 5yr design reqt's)

Q (m3/s) = 0.048
 g (9.81m/s2) = 9.81
 H (m) = 0.33

A (m2) =	0.03073
D (m) =	0.198

Orifice Diameter Required = 198 mm

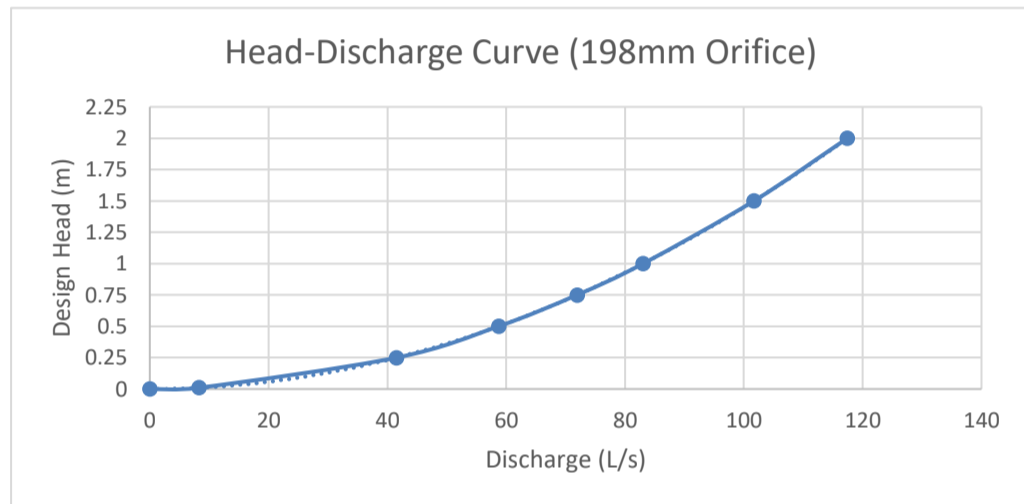

Storm - 100 year

Allowable Release Rate = 316.44L/s
 Controlled Release Rate = 67.00L/s

Q (m3/s) = 0.067
 g (9.81m/s2) = 9.81
 A (m2) = 0.03073

H (m) =	0.65
---------	------

100yr STM Design Head = 0.65 m

Storm - 5 year

Allowable Release Rate = 316.44L/s
 Controlled Release Rate = 48.00L/s

Q (m3/s) = 0.048
 g (9.81m/s2) = 9.81
 A (m2) = 0.03073

H (m) =	0.33
---------	------

5yr STM Design Head = 0.33 m

Inlet Control Device Parameters

ICD at MH01

Product Orifice Plate

Design Head = 0.65m
 Max. Pond Depth = 0.82m (100y)
 100y High Water Level = 98.47
 5y High Water Level = 98.15
 Outlet Pipe & ICD Inv = 97.72
 ICD Dia = 198mm
 ICD Head above CL Orifice Inv = 97.82

APPENDIX D

Volume Table Generated by AutoCAD Civil 3D

Cut/Fill Report

Generated: 2022-10-31 09:11:55
By user: KHerold
Drawing: W:\FILES 2017\170132\06 CivilDesign\02 Drawings\07
 FinalProductionDrawings\W:\FILES 2017\170132\06 CivilDesign\02
 Drawings\07 FinalProductionDrawings\170132-05.dwg

Volume Summary 5yr							
Name	Type	Cut Factor	Fill Factor	2d Area (hectares)	Cut (Cu. M.)	Fill (Cu. M.)	Net (Cu. M.)
VOL DITCH WEST	full	0.00	1.00	0.05	0.00*	0.00	0.00*
VOL DET AREA	full	0.00	1.00	0.06	0.00*	210.79	210.79*
VOL DITCH EAST	full	0.00	1.00	0.02	0.00*	0.13	0.13*

Totals						
			2d Area (hectares)	Cut (Cu. M.)	Fill (Cu. M.)	Net (Cu. M.)
Total			0.14	0.00*	210.92	210.92*

* Value adjusted by cut or fill factor other than 1.0

Cut/Fill Report

Generated: 2022-10-31 09:15:12
By user: KHerold
Drawing: W:\FILES 2017\170132\06 CivilDesign\02 Drawings\07
 FinalProductionDrawings\W:\FILES 2017\170132\06 CivilDesign\02
 Drawings\07 FinalProductionDrawings\170132-05.dwg

Volume Summary 100yr							
Name	Type	Cut Factor	Fill Factor	2d Area (hectares)	Cut (Cu. M.)	Fill (Cu. M.)	Net (Cu. M.)
VOL DITCH WEST	full	0.00	1.00	0.05	0.00*	7.85	7.85*
VOL DET AREA	full	0.00	1.00	0.06	0.00*	396.35	396.35*
VOL DITCH EAST	full	0.00	1.00	0.02	0.00*	23.94	23.94*

Totals						
			2d Area (hectares)	Cut (Cu. M.)	Fill (Cu. M.)	Net (Cu. M.)
Total			0.14	0.00*	428.14	428.14*

* Value adjusted by cut or fill factor other than 1.0

APPENDIX E
Stormwater Treatment Devices

DRAWING NOT TO BE USED FOR CONSTRUCTION

GENERAL NOTES:

- ALL DIMENSIONS INDICATED ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SPECIFIED.
- JELLYFISH STRUCTURE INLET AND OUTLET PIPE SIZE AND ORIENTATION SHOWN FOR INFORMATIONAL PURPOSES ONLY.
- UNLESS OTHERWISE NOTED, BYPASS INFRASTRUCTURE, SUCH AS ALL UPSTREAM DIVERSION STRUCTURES, CONNECTING STRUCTURES, OR PIPE CONDUITS CONNECTING TO COMPLETE THE JELLYFISH SYSTEM SHALL BE PROVIDED AND ADDRESSED SEPARATELY.
- DRAWING FOR INFORMATIONAL PURPOSES ONLY. REFER TO ENGINEER'S SITE/UTILITY PLAN FOR STRUCTURE ORIENTATION.
- NO PRODUCT SUBSTITUTIONS SHALL BE ACCEPTED UNLESS SUBMITTED 10 DAYS PRIOR TO PROJECTS BID DATE, OR AS DIRECTED BY THE ENGINEER OF RECORD.

JELLYFISH STRUCTURE & DESIGN NOTES:

- 762 MM Ø (30") MAINTENANCE ACCESS WALL TO BE USED FOR CLEANOUT AND ACCESS BELOW CARTRIDGE DECK.
- CASTINGS OR DOORS OF THE JELLYFISH MANHOLE STRUCTURE TO EXTEND TO DESIGN FINISH GRADE. DEPTHS IN EXCESS OF 3.65 M (12') MAY REQUIRE THE DESIGN AND INSTALLATION OF INTERMEDIATE SAFETY GRATES OR OTHER STRUCTURAL ELEMENTS.
- CASTINGS AND GRADE RINGS, OR DOORS AND DOOR RISERS, OR BOTH, SHALL BE GROUTED FOR WATERTIGHTNESS. STRUCTURE SHALL MEET AASHTO HS-20, ASSUMING EARTH COVER OF 0' - 3', AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET AASHTO M306 LOAD RATING AND BE CAST WITH THE IMBRIUM LOGO.
- ALL STRUCTURAL SECTIONS AND PARTS TO MEET OR EXCEED ASTM C-478, ASTM C-443, AND ASTM D-4097 CORRESPONDING TO AASHTO SPECIFICATIONS, AND ANY OTHER SITE OR LOCAL STANDARDS.
- CONCRETE RISER SECTIONS FROM BOTTOM TO TOP WILL BE ADDED AS REQUIRED INCLUDING TRANSITION PIECES TO SMALLER DIAMETER RISERS FOR SURFACE ACCESSES WHERE WARRANTED BY SERVICING DEPTH.
- IF MINIMUM DEPTH FROM TOP OF CARTRIDGE DECK TO BOTTOM OF STRUCTURAL TOP SLAB CANNOT BE ACHIEVED DUE TO PIPING INVERT ELEVATIONS OR OTHER SITE CONSTRAINTS. ALTERNATIVE HATCH CONFIGURATIONS MAY BE AVAILABLE. HATCH DOORS SHOULD BE SIZED TO PROVIDE FULL ACCESS ABOVE THE CARTRIDGES TO ACCOMMODATE MAINTENANCE.
- STEPS TO BE APPROXIMATELY 330 MM (13") APART AND DIMENSIONS MUST MEET LOCAL STANDARDS. STEPS MUST BE INSTALLED AFTER CARTRIDGE DECK IS IN PLACE.
- CONFIGURATION OF INLET AND OUTLET PIPE CAN VARY TO MEET SITE'S NEEDS.
- IT IS THE RESPONSIBILITY OF OTHERS TO PROPERLY PROTECT THE TREATMENT DEVICE, AND KEEP THE DEVICE OFFLINE DURING CONSTRUCTION. FILTER CARTRIDGES SHALL NOT BE INSTALLED UNTIL THE PROJECT SITE IS CLEAN AND FREE OF DEBRIS, BY OTHERS. THE PROJECT SITE INCLUDES ANY SURFACE THAT CONTRIBUTES STORM DRAINAGE TO THE TREATMENT DEVICE. CARTRIDGES SHALL BE FURNISHED NEW, AT THE TIME OF FINAL ACCEPTANCE.
- THIS DRAWING MUST BE VIEWED IN CONJUNCTION WITH THE STANDARD JELLYFISH SPECIFICATION, AND STORMWATER QUALITY FILTER TREATMENT JELLYFISH DOCUMENTS.



INSTALLATION NOTES

- ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STRUCTURE (LIFTING CLUTCHES PROVIDED)
- CONTRACTOR WILL INSTALL AND LEVEL THE STRUCTURE, SEALING THE JOINTS, LINE ENTRY AND EXIT POINTS (NON-SHRINK GROUT WITH APPROVED WATERSTOP OR FLEXIBLE BOOT)
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.
- CARTRIDGE INSTALLATION, BY IMBRIUM, SHALL OCCUR ONLY AFTER SITE HAS BEEN STABILIZED AND THE JELLYFISH UNIT IS CLEAN AND FREE OF DEBRIS. CONTACT IMBRIUM TO COORDINATE CARTRIDGE INSTALLATION WITH SITE STABILIZATION.

STANDARD OFFLINE JELLYFISH RECOMMENDED PIPE DIAMETERS			
MODEL DIAMETER (m)	MINIMUM ANGLE INLET/OUTLET PIPES	MINIMUM INLET PIPE DIAMETER (mm)	MINIMUM OUTLET PIPE DIAMETER (mm)
1.2	62	150	200
1.8	59	200	250
2.4	52	250	300
3.0	48	300	450
3.6	40	300	450

CONTACT IMBRIUM SYSTEMS FOR ALTERNATE PIPE DIAMETERS

FOR SITE SPECIFIC DRAWINGS PLEASE CONTACT YOUR LOCAL JELLYFISH FILTER REPRESENTATIVE. SITE SPECIFIC DRAWINGS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME. SOME FIELD REVISIONS TO THE SYSTEM LOCATION OR CONNECTION PIPING MAY BE NECESSARY BASED ON AVAILABLE SPACE OR SITE CONFIGURATION REVISIONS. ELEVATIONS SHOULD BE MAINTAINED EXCEPT WHERE NOTED ON BYPASS STRUCTURE.

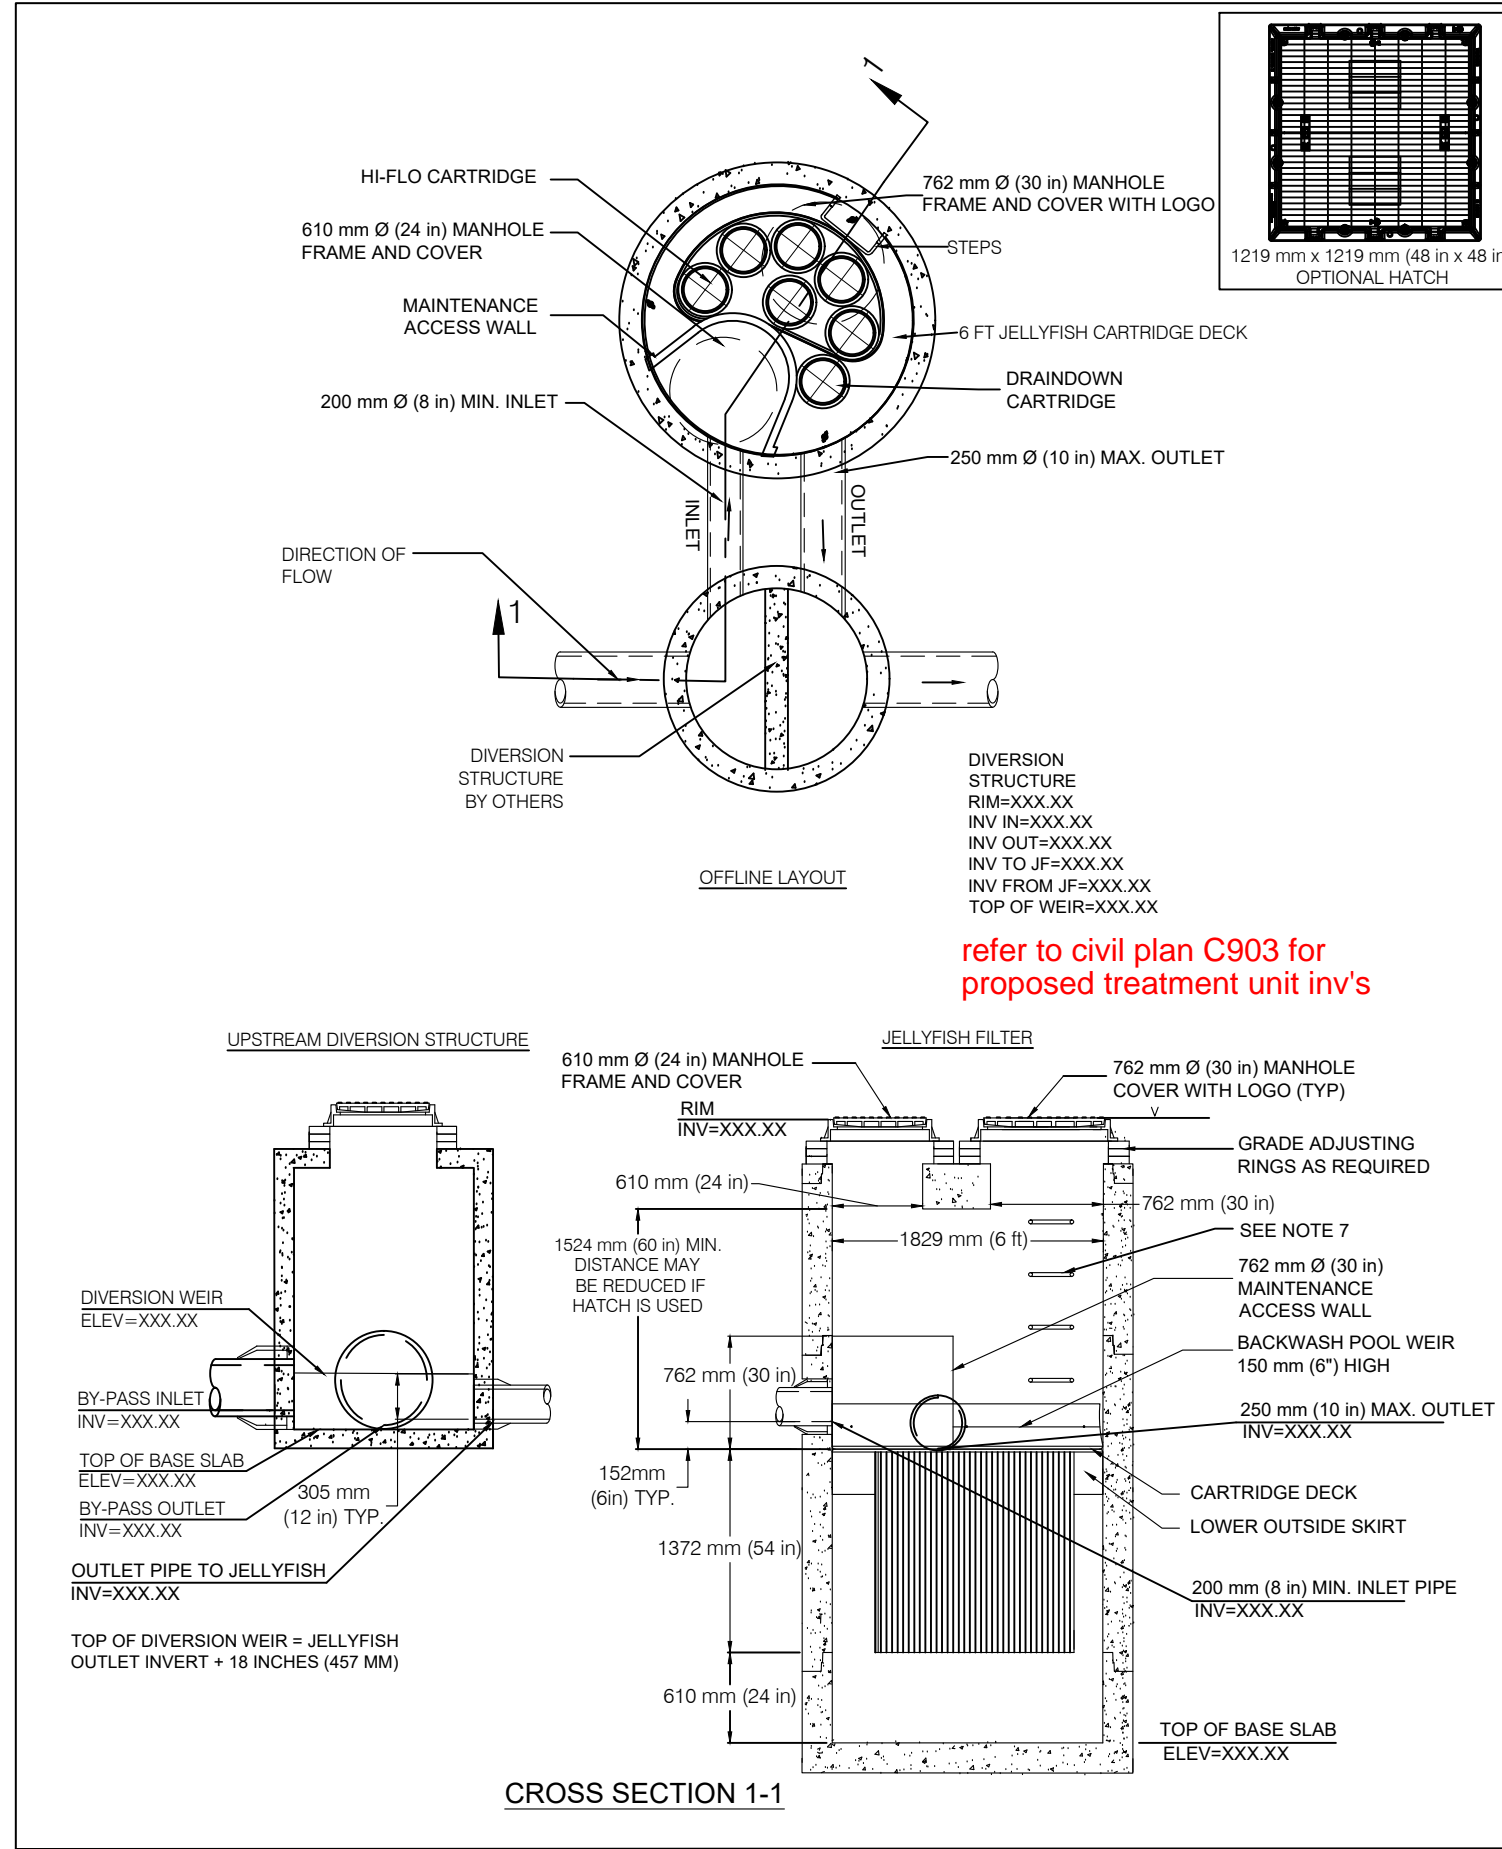

refer to civil plan C903 for proposed treatment unit inv's

JELLYFISH DESIGN NOTES					
JELLYFISH TREATMENT CAPACITY IS A FUNCTION OF THE CARTRIDGE SELECTION AND THE NUMBER OF CARTRIDGES. THE STANDARD MANHOLE STYLE IS SHOWN. Ø1829 mm (72") MANHOLE JELLYFISH PEAK TREATMENT CAPACITY IS 32.8 L/s (1.16 CFS). TREATMENT FLOW RATE IS BASED ON 457 MM (18") OF HEAD PRESSURE.					
CARTRIDGE SELECTION	54"	40"	27"	15"	
CARTRIDGE DEPTH	90"	76"	63"	51"	
OUTLET INVERT TO STRUCTURE BASE SLAB	5.09 / 2.55	3.68 / 1.84	2.55 / 1.27	1.41 / 0.71	
FLOW RATE HIGH-FLO / DRAINDOWN (L/s) (per cart)	57 / 28	42 / 21	28 / 14	16 / 8	
SEDIMENT CAPACITY HIGH-FLO / DRAINDOWN (kg) (per cart)	370	273	182	104	
MAX. CARTS HIGH-FLO/DRAINDOWN	32.8	24.6	16.4	9.06	
MAX. SEDIMENT CAPACITY (kg)					
MAX. TREATMENT (L/s)					

SITE SPECIFIC DATA REQUIREMENTS					
JELLYFISH MODEL	*				
STRUCTURE ID	*				
WATER QUALITY FLOW RATE (L/s)	*				
PEAK FLOW RATE (L/s)	*				
RETURN PERIOD OF PEAK FLOW (yrs)	*				
# OF CARTRIDGES REQUIRED (HF / DD)	*				
CARTRIDGE SIZE (inches)	*				
PIPE DATA:	I.E.	MAT'L	DIA	SLOPE %	HGL
INLET #1	*	*	*	*	*
INLET #2	*	*	*	*	*
OUTLET	*	*	*	*	*

* PER ENGINEER OF RECORD

JF6 STANDARD
Scale = 1:50

7037 Ridge Road, Suite 350, Hervey, MD 21076
USA 888-279-9826 CA 800-952-4801 INTL +1-410-960-9900

Jellyfish @ Filter

IMBRIUM SYSTEMS, INC. 10000 W. 14TH AVE. SUITE 100 DENVER, CO 80202 USA
IMBRIUM SYSTEMS, INC. 10000 W. 14TH AVE. SUITE 100 DENVER, CO 80202 USA
IMBRIUM SYSTEMS, INC. 10000 W. 14TH AVE. SUITE 100 DENVER, CO 80202 USA

DATE:	#####
DESIGNED:	BSF
DRAWN:	BSF
CHECKED:	BSF
APPROVED:	SP
PROJECT #:	#####
PROJECT NAME:	#####
SHEET:	1 OF 2

I:\MBRUM\PRODUCTS\JELLYFISH FILTER\40 DRAWINGS & DETAILS\SISTANDARD DETAILS\JELLYFISH FILTER.JF6 - OFFLINE DIVERSION MANHOLE.DWG 9/17/2017 1:49 PM

JELLYFISH® FILTER - SPECIFICATIONS

GENERAL

- A. **WORK INCLUDED:** SPECIFIES REQUIREMENTS FOR CONSTRUCTION AND PERFORMANCE OF AN UNDERGROUND STORMWATER QUALITY, MEMBRANE FILTRATION, AND TREATMENT DEVICE THAT REMOVES POLLUTANTS FROM STORMWATER RUNOFF THROUGH THE UNIT OPERATIONS OF SEDIMENTATION, FLOATATION, AND MEMBRANE FILTRATION.
- B. **REFERENCE STANDARDS:**
 - ASTM C 891: SPECIFICATION FOR INSTALLATION OF UNDERGROUND PRECAST CONCRETE UTILITY STRUCTURES
 - ASTM C 478: SPECIFICATION FOR PRECAST REINFORCED CONCRETE MANHOLE SECTIONS
 - ASTM C 990: SPECIFICATION FOR JOINTS FOR CONCRETE MANHOLES USING PREFORMED FLEXIBLE JOINT SEALANTS
 - ASTM D 4101: SPECIFICATION FOR COPOLYMER STEPS CONSTRUCTION
- C. **SHOP DRAWINGS:** SHOP DRAWINGS FOR THE STRUCTURE AND PERFORMANCE ARE TO BE SUBMITTED WITH EACH ORDER TO THE CONTRACTOR. CONTRACTOR SHALL FORWARD SHOP DRAWING SUBMITTAL TO THE CONSULTING ENGINEER FOR APPROVAL. SHOP DRAWINGS ARE TO DETAIL THE STRUCTURE PRECAST CONCRETE AND CALL OUT OR NOTE THE FIBERGLASS (FRP) INTERNALS/COMPONENTS.
- D. **PRODUCT SUBSTITUTIONS:** NO PRODUCT SUBSTITUTIONS SHALL BE ACCEPTED UNLESS SUBMITTED 10 DAYS PRIOR TO PROJECT BID DATE, OR AS DIRECTED BY THE ENGINEER OF RECORD. SUBMISSIONS FOR SUBSTITUTIONS REQUIRE REVIEW AND APPROVAL BY THE ENGINEER OF RECORD, FOR HYDRAULIC PERFORMANCE, IMPACT TO PROJECT DESIGNS, EQUIVALENT TREATMENT PERFORMANCE, AND ANY REQUIRED PROJECT PLAN AND REPORT (HYDROLOGY/HYDRAULIC, WATER QUALITY, STORMWATER POLLUTION) MODIFICATIONS THAT WOULD BE REQUIRED BY THE APPROVING JURISDICTIONS/AGENCIES. CONTRACTOR TO COORDINATE WITH THE ENGINEER OF RECORD ANY APPLICABLE MODIFICATIONS TO THE PROJECT ESTIMATES OF COST, BONDING AMOUNT DETERMINATIONS, PLAN CHECK FEES FOR CHANGES TO APPROVED DOCUMENTS, AND/OR ANY OTHER REGULATORY REQUIREMENTS RESULTING FROM THE PRODUCT SUBSTITUTION.
- E. **HANDLING AND STORAGE:** PREVENT DAMAGE TO MATERIALS DURING STORAGE AND HANDLING.

PRODUCTS

- A. THE DEVICE SHALL BE A CYLINDRICAL OR RECTANGULAR, ALL CONCRETE STRUCTURE (INCLUDING RISERS), CONSTRUCTED FROM PRECAST CONCRETE RISER AND SLAB COMPONENTS OR MONOLITHIC PRECAST STRUCTURE(S), INSTALLED TO CONFORM TO ASTM C 891 AND TO ANY REQUIRED STATE HIGHWAY, MUNICIPAL OR LOCAL SPECIFICATIONS, WHICHEVER IS MORE STRINGENT. THE DEVICE SHALL BE WATERTIGHT.
- B. THE CYLINDRICAL CONCRETE DEVICE SHALL INCLUDE A FIBERGLASS CARTRIDGE DECK INSERT. THE RECTANGULAR CONCRETE DEVICE SHALL INCLUDE A COATED ALUMINUM INSERT. IN EITHER INSTANCE, THE INSERT SHALL BE BOLTED AND SEALED WATERTIGHT INSIDE THE PRECAST CONCRETE CHAMBER. THE INSERT SHALL SERVE AS: (A) A HORIZONTAL DIVIDER BETWEEN THE LOWER TREATMENT ZONE AND THE UPPER TREATED EFFLUENT ZONE; (B) A DECK FOR ATTACHMENT OF FILTER CARTRIDGES SUCH THAT THE MEMBRANE FILTER ELEMENTS OF EACH CARTRIDGE EXTEND INTO THE LOWER TREATMENT ZONE; (C) A PLATFORM FOR MAINTENANCE WORKERS TO SERVICE THE FILTER CARTRIDGES (MAXIMUM MANNED WEIGHT = 450 POUNDS); (D) A CONDUIT FOR CONVEYANCE OF TREATED WATER TO THE EFFLUENT PIPE.
- C. MEMBRANE FILTER CARTRIDGES SHALL BE COMPRISED OF REUSABLE CYLINDRICAL MEMBRANE FILTER ELEMENTS CONNECTED TO A PERFORATED HEAD PLATE. THE NUMBER OF MEMBRANE FILTER ELEMENTS PER CARTRIDGE SHALL BE A MINIMUM OF ELEVEN 2.75-INCH (70-MM) OR GREATER DIAMETER ELEMENTS. THE LENGTH OF EACH FILTER ELEMENT SHALL BE A MINIMUM 15 INCHES (381 MM). EACH CARTRIDGE SHALL BE FITTED INTO THE CARTRIDGE DECK BY INSERTION INTO A CARTRIDGE RECEPTACLE THAT IS PERMANENTLY MOUNTED INTO THE CARTRIDGE DECK. EACH CARTRIDGE SHALL BE SECURED BY A CARTRIDGE LID THAT IS THREADED ONTO THE RECEPTACLE, OR SIMILAR MECHANISM TO SECURE THE CARTRIDGE INTO THE DECK. THE MAXIMUM TREATMENT FLOW RATE OF A FILTER CARTRIDGE SHALL BE CONTROLLED BY AN ORIFICE IN THE CARTRIDGE LID, OR ON THE INDIVIDUAL CARTRIDGE ITSELF, AND BASED ON A DESIGN FLUX RATE (SURFACE LOADING RATE) DETERMINED BY THE MAXIMUM TREATMENT FLOW RATE PER UNIT OF FILTRATION MEMBRANE SURFACE AREA. THE MAXIMUM FLUX RATE SHALL BE 0.21 GPM/FT2 (0.142 LPS/M2). EACH MEMBRANE FILTER CARTRIDGE SHALL ALLOW FOR MANUAL INSTALLATION AND REMOVAL.
- D. ALL FILTER CARTRIDGES AND MEMBRANES SHALL BE REUSABLE AND ALLOW FOR THE USE OF FILTRATION MEMBRANE RINSING PROCEDURES TO RESTORE FLOW CAPACITY AND SEDIMENT CAPACITY, EXTENDING CARTRIDGE SERVICE LIFE.
- E. ACCESS SHALL HAVE A MINIMUM CLEAR HEIGHT OF 60" OVER ALL OF THE FILTER CARTRIDGES, OR BE ACCESSIBLE BY A HATCH OR OTHER MECHANISM THAT PROVIDES MINIMUM 60" VERTICAL CLEAR SPACE OVER ALL OF THE FILTER CARTRIDGES. FILTER CARTRIDGES SHALL BE ABLE TO BE LIFTED STRAIGHT VERTICALLY OUT OF THE RECEPTACLES AND DECK FOR THE ENTIRE LENGTH OF THE CARTRIDGE.
- F. THE DEVICE SHALL INCLUDE A MINIMUM 24 INCHES (610 MM) OF SUMP BELOW THE BOTTOM OF THE CARTRIDGES FOR SEDIMENT ACCUMULATION, UNLESS OTHERWISE SPECIFIED BY THE DESIGN ENGINEER. DEPTHS LESS THAN 24" MAY HAVE AN IMPACT ON THE TOTAL PERFORMANCE AND/OR LONGEVITY BETWEEN CARTRIDGE MAINTENANCE/REPLACEMENT OF THE DEVICE.
- G. ALL PRECAST CONCRETE COMPONENTS SHALL BE MANUFACTURED TO A MINIMUM LIVE LOAD OF HS-20 TRUCK LOADING OR GREATER BASED ON LOCAL REGULATORY SPECIFICATIONS, UNLESS OTHERWISE MODIFIED OR SPECIFIED BY THE DESIGN ENGINEER, AND SHALL BE WATERTIGHT.
- H. GASKETS AND/OR SEALANTS TO PROVIDE WATER TIGHT SEAL BETWEEN CONCRETE JOINTS. JOINTS SHALL BE SEALED WITH PREFORMED JOINT SEALING COMPOUND CONFORMING TO ASTM C 990.
- I. FRAME AND COVERS MUST BE MANUFACTURED FROM CAST-IRON OR OTHER COMPOSITE MATERIAL TESTED TO WITHSTAND H-20 OR GREATER DESIGN LOADS, AND AS APPROVED BY THE LOCAL REGULATORY BODY. FRAMES AND COVERS MUST BE EMBOSSED WITH THE NAME OF THE DEVICE MANUFACTURER OR THE DEVICE BRAND NAME.
- J. DOOR AND HATCHES, IF PROVIDED SHALL MEET DESIGNATED LOADING REQUIREMENTS OR AT A MINIMUM FOR INCIDENTAL VEHICULAR TRAFFIC.
- K. ALL CONCRETE COMPONENTS SHALL BE MANUFACTURED ACCORDING TO LOCAL SPECIFICATIONS AND SHALL MEET THE REQUIREMENTS OF ASTM C 478.
- L. THE FIBERGLASS PORTION OF THE FILTER DEVICE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE FOLLOWING STANDARD: ASTM D-4097: CONTACT MOLDED GLASS FIBER REINFORCED CHEMICAL RESISTANT TANKS.
- M. STEPS SHALL BE CONSTRUCTED ACCORDING TO ASTM D4101 OF COPOLYMER POLYPROPYLENE, AND BE DRIVEN INTO PREFORMED OR PRE-DRILLED HOLES AFTER THE CONCRETE HAS CURED, INSTALLED TO CONFORM TO APPLICABLE SECTIONS OF STATE, PROVINCIAL AND MUNICIPAL BUILDING CODES, HIGHWAY, MUNICIPAL OR LOCAL SPECIFICATIONS FOR THE CONSTRUCTION OF SUCH DEVICES.
- N. ALL PRECAST CONCRETE SECTIONS SHALL BE INSPECTED TO ENSURE THAT DIMENSIONS, APPEARANCE AND QUALITY OF THE PRODUCT MEET LOCAL MUNICIPAL SPECIFICATIONS AND ASTM C 478.

PERFORMANCE

- A. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL FUNCTION TO REMOVE POLLUTANTS BY THE FOLLOWING UNIT TREATMENT PROCESSES; SEDIMENTATION, FLOATATION, AND MEMBRANE FILTRATION.
- B. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL REMOVE OIL, DEBRIS, TRASH, COARSE AND FINE PARTICULATES, PARTICULATE-BOUND POLLUTANTS, METALS AND NUTRIENTS FROM STORMWATER DURING RUNOFF EVENTS.
- C. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL TYPICALLY UTILIZE AN EXTERNAL BYPASS TO DIVERT EXCESSIVE FLOWS. INTERNAL BYPASS SYSTEMS SHALL BE EQUIPPED WITH A FLOATABLES BAFFLE, AND MUST PASS WATER OVER THE CARTRIDGE DECK, AND AVOID PASSAGE THROUGH THE SUMP AND/OR CARTRIDGE FILTRATION ZONE.
- D. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL TREAT 100% OF THE REQUIRED WATER QUALITY TREATMENT FLOW BASED ON A MAXIMUM TREATMENT FLUX RATE (SURFACE LOADING RATE) ACROSS THE MEMBRANE FILTER CARTRIDGES NOT TO EXCEED 0.21 GPM/FT2 (0.142 LPS/M2).
- E. AT A MINIMUM, THE STORMWATER QUALITY FILTER DEVICE SHALL HAVE BEEN FIELD TESTED AND VERIFIED WITH A MINIMUM 25 QUALIFYING STORM EVENTS AND FIELD MONITORING CONDUCTED ACCORDING TO THE TARP TIER II OR TAPE FIELD TEST PROTOCOL, AND HAVE RECEIVED NJCAT VERIFICATION.
- F. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL HAVE DEMONSTRATED A MINIMUM MEDIAN TSS REMOVAL EFFICIENCY OF 85% AND A MINIMUM MEDIAN SSC REMOVAL EFFICIENCY OF 95%.
- G. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL HAVE DEMONSTRATED THE ABILITY TO CAPTURE FINE PARTICLES AS INDICATED BY A MINIMUM MEDIAN REMOVAL EFFICIENCY OF 75% FOR THE PARTICLE FRACTION LESS THAN 25 MICRONS, AN EFFLUENT D50 OF 15 MICRONS OR LOWER FOR ALL MONITORED STORM EVENTS, AND AN EFFLUENT TURBIDITY OF 15 NTUS OR LOWER.
- H. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL HAVE DEMONSTRATED A MINIMUM MEDIAN TOTAL PHOSPHORUS REMOVAL OF 55%, AND A MINIMUM MEDIAN TOTAL NITROGEN REMOVAL OF 50%.
- I. THE STORMWATER QUALITY FILTER TREATMENT DEVICE SHALL HAVE DEMONSTRATED A MINIMUM MEDIAN TOTAL ZINC REMOVAL OF 50%, AND A MINIMUM MEDIAN TOTAL COPPER REMOVAL OF 75%.

INSPECTION AND MAINTENANCE

- A. DURABILITY OF MEMBRANES ARE SUBJECT TO GOOD HANDLING PRACTICES DURING INSPECTION AND MAINTENANCE (REMOVAL, RINSING, AND REINSERTION) EVENTS, AND SITE SPECIFIC CONDITIONS THAT MAY HAVE HEAVIER OR LIGHTER LOADING ONTO THE CARTRIDGES, AND POLLUTANT VARIABILITY THAT MAY IMPACT THE MEMBRANE STRUCTURAL INTEGRITY. MEMBRANE MAINTENANCE AND REPLACEMENT SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- B. INSPECTION WHICH INCLUDES TRASH AND FLOATABLES COLLECTION, SEDIMENT DEPTH DETERMINATION, AND VISIBLE DETERMINATION OF BACKWASH POOL DEPTH SHALL BE EASILY CONDUCTED FROM GRADE (OUTSIDE THE STRUCTURE).
- C. MANUAL RINSING OF THE REUSABLE FILTER CARTRIDGES SHALL PROMOTE RESTORATION OF THE FLOW CAPACITY AND SEDIMENT CAPACITY OF THE FILTER CARTRIDGES, EXTENDING CARTRIDGE SERVICE LIFE.
- D. SEDIMENT REMOVAL FROM THE FILTER TREATMENT DEVICE SHALL BE ABLE TO BE CONDUCTED USING A STANDARD MAINTENANCE TRUCK AND VACUUM APPARATUS, AND A MINIMUM ONE POINT OF ENTRY TO THE SUMP THAT IS UNOBSTRUCTED BY FILTER CARTRIDGES.
- E. MAINTENANCE ACCESS SHALL HAVE A MINIMUM CLEAR HEIGHT OF 60" OVER ALL OF THE FILTER CARTRIDGES, OR BE ACCESSIBLE BY A HATCH OR OTHER MECHANISM THAT PROVIDES MINIMUM 60" VERTICAL CLEAR SPACE OVER ALL OF THE FILTER CARTRIDGES. FILTER CARTRIDGES SHALL BE ABLE TO BE LIFTED STRAIGHT VERTICALLY OUT OF THE RECEPTACLES AND DECK FOR THE ENTIRE LENGTH OF THE CARTRIDGE.
- F. FILTER CARTRIDGES SHALL BE ABLE TO BE MAINTAINED WITHOUT THE USE OF ADDITIONAL LIFTING EQUIPMENT.

EXECUTION

- A. THE INSTALLATION OF A WATERTIGHT PRECAST CONCRETE DEVICE SHOULD CONFORM TO ASTM C 891 AND TO ANY STATE HIGHWAY, MUNICIPAL OR LOCAL SPECIFICATIONS FOR THE CONSTRUCTION OF MANHOLES, WHICHEVER IS MORE STRINGENT. SELECTED SECTIONS OF A GENERAL SPECIFICATION THAT ARE APPLICABLE ARE SUMMARIZED BELOW.
- B. THE WATERTIGHT PRECAST CONCRETE DEVICE IS INSTALLED IN SECTIONS IN THE FOLLOWING SEQUENCE:
 - AGGREGATE BASE
 - BASE SLAB
 - TREATMENT CHAMBER AND CARTRIDGE DECK RISER SECTION(S)
 - BYPASS SECTION
 - CONNECT INLET AND OUTLET PIPES
 - CONCRETE RISER SECTION(S) AND/OR TRANSITION SLAB (IF REQUIRED)
 - MAINTENANCE RISER SECTION(S) (IF REQUIRED)
 - FRAME AND ACCESS COVER
- C. INLET AND OUTLET PIPES SHOULD BE SECURELY SET INTO THE DEVICE USING APPROVED PIPE SEALS (FLEXIBLE BOOT CONNECTIONS, WHERE APPLICABLE) SO THAT THE STRUCTURE IS WATERTIGHT, AND SUCH THAT ANY PIPE INTRUSION INTO THE DEVICE DOES NOT IMPACT THE DEVICE FUNCTIONALITY.
- D. ADJUSTMENT UNITS (E.G. GRADE RINGS) SHOULD BE INSTALLED TO SET THE FRAME AND COVER AT THE REQUIRED ELEVATION. THE ADJUSTMENT UNITS SHOULD BE LAID IN A FULL BED OF MORTAR WITH SUCCESSIVE UNITS BEING JOINED USING SEALANT RECOMMENDED BY THE MANUFACTURER. FRAMES FOR THE COVER SHOULD BE SET IN A FULL BED OF MORTAR AT THE ELEVATION SPECIFIED.
- E. IN SOME INSTANCES THE MAINTENANCE ACCESS WALL, IF PROVIDED, SHALL REQUIRE AN EXTENSION ATTACHMENT AND SEALING TO THE PRECAST WALL AND CARTRIDGE DECK AT THE JOB SITE, RATHER THAN AT THE PRECAST FACILITY. IN THIS INSTANCE, INSTALLATION OF THESE COMPONENTS SHALL BE PERFORMED ACCORDING TO INSTRUCTIONS PROVIDED BY THE MANUFACTURER.
- F. FILTER CARTRIDGES SHALL BE INSTALLED IN THE CARTRIDGE DECK AFTER THE CONSTRUCTION SITE IS FULLY STABILIZED AND IN ACCORDANCE WITH THE MANUFACTURERS GUIDELINES AND RECOMMENDATIONS. CONTRACTOR TO CONTACT THE MANUFACTURER TO SCHEDULE CARTRIDGE DELIVERY AND REVIEW PROCEDURES/REQUIREMENTS TO BE COMPLETED TO THE DEVICE PRIOR TO INSTALLATION OF THE CARTRIDGES AND ACTIVATION OF THE SYSTEM.
- G. MANUFACTURER SHALL COORDINATE DELIVERY OF FILTER CARTRIDGES AND OTHER INTERNAL COMPONENTS WITH CONTRACTOR. FILTER CARTRIDGES SHALL BE DELIVERED AND INSTALLED COMPLETE AFTER SITE IS STABILIZED AND UNIT IS READY TO ACCEPT CARTRIDGES. UNIT IS READY TO ACCEPT CARTRIDGES AFTER IS HAS BEEN CLEANED OUT AND ANY STANDING WATER, DEBRIS, AND OTHER MATERIALS HAVE BEEN REMOVED. CONTRACTOR SHALL TAKE APPROPRIATE ACTION TO PROTECT THE FILTER CARTRIDGE RECEPTACLES AND FILTER CARTRIDGES FROM DAMAGE DURING CONSTRUCTION, AND IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND GUIDANCE. FOR SYSTEMS WITH CARTRIDGES INSTALLED PRIOR TO FULL SITE STABILIZATION AND PRIOR TO SYSTEM ACTIVATION, THE CONTRACTOR CAN PLUG INLET AND OUTLET PIPES TO PREVENT STORMWATER AND OTHER INFLUENT FROM ENTERING THE DEVICE. PLUGS MUST BE REMOVED DURING THE ACTIVATION PROCESS.
- H. THE MANUFACTURER SHALL PROVIDE AN OWNER'S MANUAL UPON REQUEST.
- I. AFTER CONSTRUCTION AND INSTALLATION, AND DURING OPERATION, THE DEVICE SHALL BE INSPECTED AND CLEANED AS NECESSARY BASED ON THE MANUFACTURER'S RECOMMENDED INSPECTION AND MAINTENANCE GUIDELINES AND THE LOCAL REGULATORY AGENCY/BODY.
- J. WHEN REPLACEMENT MEMBRANE FILTER ELEMENTS AND/OR OTHER PARTS ARE REQUIRED, ONLY MEMBRANE FILTER ELEMENTS AND PARTS APPROVED BY THE MANUFACTURER FOR USE WITH THE STORMWATER QUALITY FILTER DEVICE SHALL BE INSTALLED.

END OF SECTION

The design and information shown on this drawing is provided as a service to the project owner, engineer, contractor, and others. It is not to be used, copied, reproduced, or modified in any manner without the prior written consent of Imbrum. Failure to comply with the terms of this agreement may result in Imbrum disclaiming any liability or responsibility for such use. If discrepancies between the supplied information upon which this design was based and the actual conditions are encountered as the work progresses, these discrepancies must be reported to Imbrum immediately for re-evaluation of the design. Imbrum accepts no responsibility for any errors or omissions or for any inaccurate information supplied by others.

#	#	#	#
#	#	#	#
#	#	#	#
#	#	#	#
0	10/01/2014	INITIAL RELEASE	BSF
MARK	DATE	REVISION DESCRIPTION	
BY	BY		

JELLYFISH FILTER SPECIFICATIONS

JF6 STANDARD

Scale = 1:50

www.imbrumsystems.com

7037 Ridge Road, Suite 350, Hanover, MD 21076
 USA 888-279-9826 CA 800-952-4801 INTL +1-415-960-9900
Jellyfish® Filter
 10000 Greenway Blvd, Suite 100, San Diego, CA 92123
 619-594-8888 FAX 619-594-8889
 10000 Greenway Blvd, Suite 100, San Diego, CA 92123
 619-594-8888 FAX 619-594-8889

DATE: #####

DESIGNED: BSF	DRAWN: BSF
CHECKED: BSF	APPROVED: SP
PROJECT #: #####	PROJECT NAME: #####
SHEET: 2 OF 2	



STANDARD OFFLINE Jellyfish Filter Sizing Report

Project Information

Date	Tuesday, November 24, 2020
Project Name	Hindu Heritage Center
Project Number	
Location	Ottawa

Jellyfish Filter Design Overview

This report provides information for the sizing and specification of the Jellyfish Filter. When designed properly in accordance to the guidelines detailed in the Jellyfish Filter Technical Manual, the Jellyfish Filter will exceed the performance and longevity of conventional horizontal bed and granular media filters.

Please see www.ImbriumSystems.com for more information.

Jellyfish Filter System Recommendation

The Jellyfish Filter model JF6-4-1 is recommended to meet the water quality objective by treating a flow of 22.7 L/s, which meets or exceeds 90% of the average annual rainfall runoff volume based on 36 years of OTTAWA MACDONALD-CARTIER INT'L A rainfall data for this site. This model has a sediment capacity of 256 kg, which meets or exceeds the estimated average annual sediment load.

Jellyfish Model	Number of High-Flo Cartridges	Number of Draindown Cartridges	Manhole Diameter (m)	Treatment Flow Rate (L/s)	Sediment Capacity (kg)
JF6-4-1	4	1	1.8	22.7	256

The Jellyfish Filter System

The patented Jellyfish Filter is an engineered stormwater quality treatment technology featuring unique membrane filtration in a compact stand-alone treatment system that removes a high level and wide variety of stormwater pollutants. Exceptional pollutant removal is achieved at high treatment flow rates with minimal head loss and low maintenance costs. Each lightweight Jellyfish Filter cartridge contains an extraordinarily large amount of membrane surface area, resulting in superior flow capacity and pollutant removal capacity.

Maintenance

Regular scheduled inspections and maintenance is necessary to assure proper functioning of the Jellyfish Filter. The maintenance interval is designed to be a minimum of 12 months, but this will vary depending on site loading conditions and upstream pretreatment measures. Quarterly inspections and inspections after all storms beyond the 5-year event are recommended until enough historical performance data has been logged to comfortably initiate an alternative inspection interval.

Please see www.ImbriumSystems.com for more information.

Thank you for the opportunity to present this information to you and your client.

Performance

Jellyfish efficiently captures a high level of Stormwater pollutants, including:


- ☑ 89% of the total suspended solids (TSS) load, including particles less than 5 microns
- ☑ 59% TP removal & 51% TN removal
- ☑ 90% Total Copper, 81% Total Lead, 70% Total Zinc
- ☑ Particulate-bound pollutants such as nutrients, toxic metals, hydrocarbons and bacteria
- ☑ Free oil, Floatable trash and debris

Field Proven Performance

The Jellyfish filter has been field-tested on an urban site with 25 TARP qualifying rain events and field monitored according to the TARP field test protocol, demonstrating:

- A median TSS removal efficiency of 89%, and a median SSC removal of 99%;
- The ability to capture fine particles as indicated by an effluent d50 median of 3 microns for all monitored storm events, and a median effluent turbidity of 5 NTUs;
- A median Total Phosphorus removal of 59%, and a median Total Nitrogen removal of 51%.

Jellyfish Filter Treatment Functions

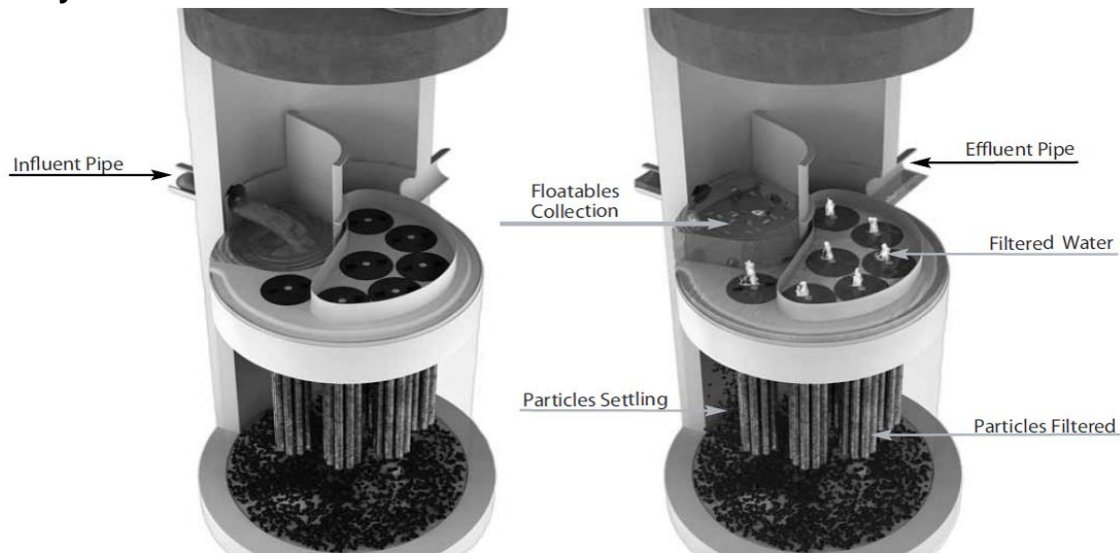

Pre-treatment and Membrane Filtration

Project Information

Date:	Tuesday, November 24, 2020
Project Name:	Hindu Heritage Center
Project Number:	
Location:	Ottawa

Designer Information

Company:	LRL Associates Ltd.
Contact:	Kyle Herold
Phone #:	

Notes

--

Design System Requirements

Flow Loading	90% of the Average Annual Runoff based on 36 years of OTTAWA MACDONALD-CARTIER INT'L A rainfall	17.5 L/s
Sediment Loading	Treating 90% of the average annual runoff volume, 3541 m ³ , with a suspended sediment concentration of 60 mg/L.	212 kg*

* Indicates that sediment loading is the limiting parameter in the sizing of this Jellyfish system

Recommendation

The Jellyfish Filter model JF6-4-1 is recommended to meet the water quality objective by treating a flow of 22.7 L/s, which meets or exceeds 90% of the average annual rainfall runoff volume based on 36 years of OTTAWA MACDONALD-CARTIER INT'L A rainfall data for this site. This model has a sediment capacity of 256 kg, which meets or exceeds the estimated average annual sediment load.

Jellyfish Model	Number of High-Flow Cartridges	Number of Draindown Cartridges	Manhole Diameter (m)	Wet Vol Below Deck (L)	Sump Storage (m ³)	Oil Capacity (L)	Treatment Flow Rate (L/s)	Sediment Capacity (kg)
JF4-1-1	1	1	1.2	2313	0.34	379	7.6	85
JF4-2-1	2	1	1.2	2313	0.34	379	12.6	142
JF6-3-1	3	1	1.8	5205	0.79	848	17.7	199
JF6-4-1	4	1	1.8	5205	0.79	848	22.7	256
JF6-5-1	5	1	1.8	5205	0.79	848	27.8	313
JF6-6-1	6	1	1.8	5205	0.79	848	28.6	370
JF8-6-2	6	2	2.4	9252	1.42	1469	35.3	398
JF8-7-2	7	2	2.4	9252	1.42	1469	40.4	455
JF8-8-2	8	2	2.4	9252	1.42	1469	45.4	512
JF8-9-2	9	2	2.4	9252	1.42	1469	50.5	569
JF8-10-2	10	2	2.4	9252	1.42	1469	50.5	626
JF10-11-3	11	3	3.0	14456	2.21	2302	63.1	711
JF10-12-3	12	3	3.0	14456	2.21	2302	68.2	768
JF10-12-4	12	4	3.0	14456	2.21	2302	70.7	796
JF10-13-4	13	4	3.0	14456	2.21	2302	75.7	853
JF10-14-4	14	4	3.0	14456	2.21	2302	78.9	910
JF10-15-4	15	4	3.0	14456	2.21	2302	78.9	967
JF10-16-4	16	4	3.0	14456	2.21	2302	78.9	1024
JF10-17-4	17	4	3.0	14456	2.21	2302	78.9	1081
JF10-18-4	18	4	3.0	14456	2.21	2302	78.9	1138
JF10-19-4	19	4	3.0	14456	2.21	2302	78.9	1195
JF12-20-5	20	5	3.6	20820	3.2	2771	113.6	1280
JF12-21-5	21	5	3.6	20820	3.2	2771	113.7	1337
JF12-22-5	22	5	3.6	20820	3.2	2771	113.7	1394
JF12-23-5	23	5	3.6	20820	3.2	2771	113.7	1451
JF12-24-5	24	5	3.6	20820	3.2	2771	113.7	1508
JF12-25-5	25	5	3.6	20820	3.2	2771	113.7	1565
JF12-26-5	26	5	3.6	20820	3.2	2771	113.7	1622
JF12-27-5	27	5	3.6	20820	3.2	2771	113.7	1679

Rainfall

Name:	OTTAWA MACDONALD-CARTIER INT'L A
State:	ON
ID:	6000
Record:	1967 to 2003
Co-ords:	45°19'N, 75°40'W

Drainage Area


Total Area:	1.316 ha
Runoff Coefficient:	0.59

Upstream Detention

Peak Release Rate:	n/a
Pretreatment Credit:	n/a

Jellyfish Filter Design Notes

- Typically the Jellyfish Filter is designed in an offline configuration, as all stormwater filter systems will perform for a longer duration between required maintenance services when designed and applied in off-line configurations. Depending on the design parameters, an optional internal bypass may be incorporated into the Jellyfish Filter, however note the inspection and maintenance frequency should be expected to increase above that of an off-line system. Speak to your local representative for more information.

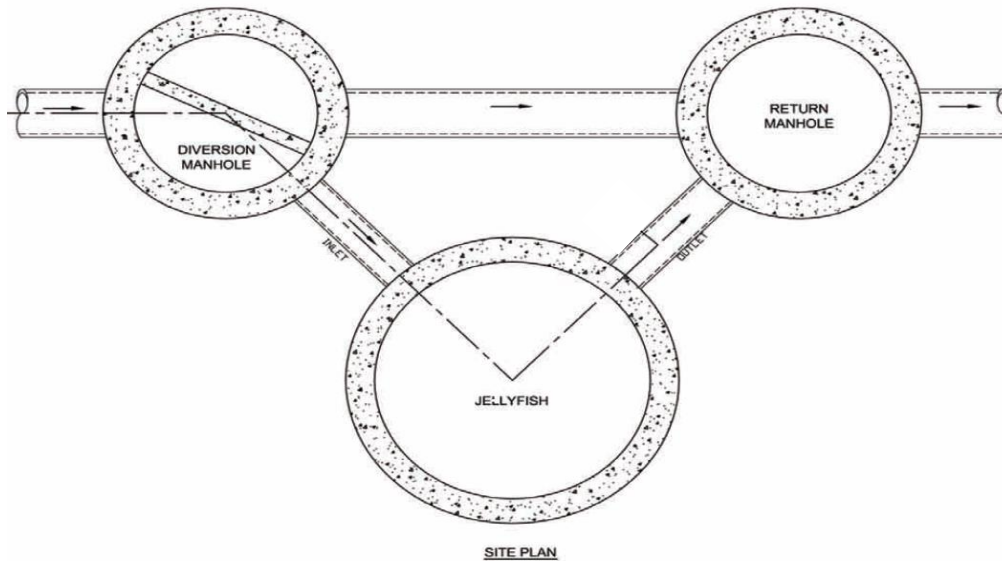

Jellyfish Filter Typical Layout

- Typically, 18 inches (457 mm) of driving head is designed into the system, calculated as the difference in elevation between the top of the diversion structure weir and the invert of the Jellyfish Filter outlet pipe. Alternative driving head values can be designed as 12 to 24 inches (305 to 610mm) depending on specific site requirements, requiring additional sizing and design assistance.
- Typically, the Jellyfish Filter is designed with the inlet pipe configured 6 inches (150 mm) above the outlet invert elevation. However, depending on site parameters this can vary to an optional configuration of the inlet pipe entering the unit below the outlet invert elevation.
- The Jellyfish Filter can accommodate multiple inlet pipes within certain restrictions.
- While the optional inlet below deck configuration offers 0 to 360 degree flexibility between the inlet and outlet pipe, typical systems conform to the following:

Model Diameter (m)	Minimum Angle Inlet / Outlet Pipes	Minimum Inlet Pipe Diameter (mm)	Minimum Outlet Pipe Diameter (mm)
1.2	62°	150	200
1.8	59°	200	250
2.4	52°	250	300
3.0	48°	300	450
3.6	40°	300	450

- The Jellyfish Filter can be built at all depths of cover generally associated with conventional stormwater conveyance systems. For sites that require minimal depth of cover for the stormwater infrastructure, the Jellyfish Filter can be applied in a shallow application using a hatch cover. The general minimum depth of cover is 36 inches (915 mm) from top of the underslab to outlet invert.
- If driving head calculations account for water elevation during submerged conditions the Jellyfish Filter will function effectively under submerged conditions.
- Jellyfish Filter systems may incorporate grated inlets depending on system configuration.
- For sites with water quality treatment flow rates or mass loadings that exceed the design flow rate of the largest standard Jellyfish Filter manhole models, systems can be designed that hydraulically connect multiple Jellyfish Filters in series or alternatively Jellyfish Vault units can be designed.

STANDARD SPECIFICATION STORMWATER QUALITY – MEMBRANE FILTRATION TREATMENT DEVICE

PART 1 – GENERAL

1.1 WORK INCLUDED

Specifies requirements for construction and performance of an underground stormwater quality membrane filtration treatment device that removes pollutants from stormwater runoff through the unit operations of sedimentation, floatation, and membrane filtration.

1.2 REFERENCE STANDARDS

ASTM C 891: Specification for Installation of Underground Precast Concrete Utility Structures
ASTM C 478: Specification for Precast Reinforced Concrete Manhole Sections
ASTM C 443: Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets
ASTM D 4101: Specification for Copolymer steps construction

CAN/CSA-A257.4-M92

Joints for Circular Concrete Sewer and Culvert Pipe, Manhole Sections and Fittings Using Rubber Gaskets

CAN/CSA-A257.4-M92

Precast Reinforced Circular Concrete Manhole Sections, Catch Basins and Fittings

Canadian Highway Bridge Design Code

1.3 SHOP DRAWINGS

Shop drawings for the structure and performance are to be submitted with each order to the contractor. Contractor shall forward shop drawing submittal to the consulting engineer for approval. Shop drawings are to detail the structure's precast concrete and call out or note the fiberglass (FRP) internals/components.

1.4 PRODUCT SUBSTITUTIONS

No product substitutions shall be accepted unless submitted 10 days prior to project bid date, or as directed by the engineer of record. Submissions for substitutions require review and approval by the Engineer of Record, for hydraulic performance, impact to project designs, equivalent treatment performance, and any required project plan and report (hydrology/hydraulic, water quality, stormwater pollution) modifications that would be required by the approving jurisdictions/agencies. Contractor to coordinate with the Engineer of Record any applicable modifications to the project estimates of cost, bonding amount determinations, plan check fees for changes to approved documents, and/or any other regulatory requirements resulting from the product substitution.

1.5 HANDLING AND STORAGE

Prevent damage to materials during storage and handling.

PART 2 – PRODUCTS

2.1 GENERAL

- 2.1.1 The device shall be a cylindrical or rectangular, all concrete structure (including risers), constructed from precast concrete riser and slab components or monolithic precast structure(s), installed to conform to ASTM C 891 and to any required state highway, municipal or local specifications; whichever is more stringent. The device shall be watertight.
- 2.1.2 Cartridge Deck The cylindrical concrete device shall include a fiberglass deck. The rectangular concrete device shall include a coated aluminum deck. In either instance, the insert shall be bolted and sealed watertight inside the precast concrete chamber. The deck shall serve as: (a) a horizontal divider between the lower treatment zone and the upper treated effluent zone; (b) a deck for attachment of filter cartridges such that the membrane filter elements of each cartridge extend into the lower treatment zone; (c) a platform for maintenance workers to service the filter cartridges (maximum manned weight = 450 pounds (204 kg)); (d) a conduit for conveyance of treated water to the effluent pipe.
- 2.1.3 Membrane Filter Cartridges Filter cartridges shall be comprised of reusable cylindrical membrane filter elements connected to a perforated head plate. The number of membrane filter elements per cartridge shall be a minimum of eleven 2.75-inch (70-mm) diameter elements. The length of each filter element shall be a minimum 15 inches (381 mm). Each cartridge shall be fitted into the cartridge deck by insertion into a cartridge receptacle that is permanently mounted into the cartridge deck. Each cartridge shall be secured by a cartridge lid that is threaded onto the receptacle, or similar mechanism to secure the cartridge into the deck. The maximum treatment flow rate of a filter cartridge shall be controlled by an orifice in the cartridge lid, or on the individual cartridge itself, and based on a design flux rate (surface loading rate) determined by the maximum treatment flow rate per unit of filtration membrane surface area. The maximum design flux rate shall be 0.21 gpm/ft² (0.142 lps/m²).

Each membrane filter cartridge shall allow for manual installation and removal. Each filter cartridge shall have filtration membrane surface area and dry installation weight as follows (if length of filter cartridge is between those listed below, the surface area and weight shall be proportionate to the next length shorter and next length longer as shown below):

Filter Cartridge Length (in / mm)	Minimum Filtration Membrane Surface Area (ft ² / m ²)	Maximum Filter Cartridge Dry Weight (lbs / kg)
15	106 / 9.8	10.5 / 4.8
27	190 / 17.7	15.0 / 6.8
40	282 / 26.2	20.5 / 9.3
54	381 / 35.4	25.5 / 11.6

- 2.1.4 Backwashing Cartridges The filter device shall have a weir extending above the cartridge deck, or other mechanism, that encloses the high flow rate filter cartridges when placed in their respective cartridge receptacles within the cartridge deck. The weir, or other mechanism, shall collect a pool of filtered water during inflow events that backwashes the high flow rate cartridges when the inflow

event subsides. All filter cartridges and membranes shall be reusable and allow for the use of filtration membrane rinsing procedures to restore flow capacity and sediment capacity; extending cartridge service life.

- 2.1.5 Maintenance Access to Captured Pollutants The filter device shall contain an opening(s) that provides maintenance access for removal of accumulated floatable pollutants and sediment, removal of and replacement of filter cartridges, cleaning of the sump, and rinsing of the deck. Access shall have a minimum clear vertical clear space over all of the filter cartridges. Filter cartridges shall be able to be lifted straight vertically out of the receptacles and deck for the entire length of the cartridge.
- 2.1.6 Bend Structure The device shall be able to be used as a bend structure with minimum angles between inlet and outlet pipes of 90-degrees or less in the stormwater conveyance system.
- 2.1.7 Double-Wall Containment of Hydrocarbons The cylindrical precast concrete device shall provide double-wall containment for hydrocarbon spill capture by a combined means of an inner wall of fiberglass, to a minimum depth of 12 inches (305 mm) below the cartridge deck, and the precast vessel wall.
- 2.1.8 Baffle The filter device shall provide a baffle that extends from the underside of the cartridge deck to a minimum length equal to the length of the membrane filter elements. The baffle shall serve to protect the membrane filter elements from contamination by floatables and coarse sediment. The baffle shall be flexible and continuous in cylindrical configurations, and shall be a straight concrete or aluminum wall in rectangular configurations.
- 2.1.9 Sump The device shall include a minimum 24 inches (610 mm) of sump below the bottom of the cartridges for sediment accumulation, unless otherwise specified by the design engineer. Depths less than 24 inches may have an impact on the total performance and/or longevity between cartridge maintenance/replacement of the device.

2.2 PRECAST CONCRETE SECTIONS

All precast concrete components shall be manufactured to a minimum live load of HS-20 truck loading or greater based on local regulatory specifications, unless otherwise modified or specified by the design engineer, and shall be watertight.

2.3 JOINTS All precast concrete manhole configuration joints shall use nitrile rubber gaskets and shall meet the requirements of ASTM C443, Specification C1619, Class D or engineer approved equal to ensure oil resistance. Mastic sealants or butyl tape are not an acceptable alternative.

2.4 GASKETS Only profile neoprene or nitrile rubber gaskets in accordance to CSA A257.3-M92 will be accepted. Mastic sealants, butyl tape or Conseal CS-101 are not acceptable gasket materials.

2.5 FRAME AND COVER Frame and covers must be manufactured from cast-iron or other composite material tested to withstand H-20 or greater design loads, and as approved by the

local regulatory body. Frames and covers must be embossed with the name of the device manufacturer or the device brand name.

- 2.6 DOORS AND HATCHES If provided shall meet designated loading requirements or at a minimum for incidental vehicular traffic.
- 2.7 CONCRETE All concrete components shall be manufactured according to local specifications and shall meet the requirements of ASTM C 478.
- 2.8 FIBERGLASS The fiberglass portion of the filter device shall be constructed in accordance with the following standard: ASTM D-4097: Contact Molded Glass Fiber Reinforced Chemical Resistant Tanks.
- 2.9 STEPS Steps shall be constructed according to ASTM D4101 of copolymer polypropylene, and be driven into preformed or pre-drilled holes after the concrete has cured, installed to conform to applicable sections of state, provincial and municipal building codes, highway, municipal or local specifications for the construction of such devices.
- 2.10 INSPECTION All precast concrete sections shall be inspected to ensure that dimensions, appearance and quality of the product meet local municipal specifications and ASTM C 478.

PART 3 – PERFORMANCE

3.1 GENERAL

- 3.1.1 Verification – The stormwater quality filter must be verified in accordance with ISO 14034:2016 Environmental management – Environmental technology verification (ETV).
- 3.1.2 Function - The stormwater quality filter treatment device shall function to remove pollutants by the following unit treatment processes; sedimentation, floatation, and membrane filtration.
- 3.1.3 Pollutants - The stormwater quality filter treatment device shall remove oil, debris, trash, coarse and fine particulates, particulate-bound pollutants, metals and nutrients from stormwater during runoff events.
- 3.1.4 Bypass - The stormwater quality filter treatment device shall typically utilize an external bypass to divert excessive flows. Internal bypass systems shall be equipped with a floatables baffle, and must avoid passage through the sump and/or cartridge filtration zone.
- 3.1.5 Treatment Flux Rate (Surface Loading Rate) – The stormwater quality filter treatment device shall treat 100% of the required water quality treatment flow based on a maximum design treatment flux rate (surface loading rate) across the membrane filter cartridges of 0.21 gpm/ft² (0.142 lps/m²).

3.2 FIELD TEST PERFORMANCE

At a minimum, the stormwater quality filter device shall have been field tested and verified with a minimum 25 TARP qualifying storm events and field monitoring shall have been conducted according to the TARP 2009 NJDEP TARP field test protocol, and have received NJCAT verification.

- 3.2.1 Suspended Solids Removal - The stormwater quality filter treatment device shall have demonstrated a minimum median TSS removal efficiency of 85% and a minimum median SSC removal efficiency of 95%.
- 3.2.2 Runoff Volume – The stormwater quality filter treatment device shall be engineered, designed, and sized to treat a minimum of 90 percent of the annual runoff volume determined from use of a minimum 15-year rainfall data set.
- 3.2.3 Fine Particle Removal - The stormwater quality filter treatment device shall have demonstrated the ability to capture fine particles as indicated by a minimum median removal efficiency of 75% for the particle fraction less than 25 microns, an effluent d_{50} of 15 microns or lower for all monitored storm events.
- 3.2.4 Turbidity Reduction - The stormwater quality filter treatment device shall have demonstrated the ability to reduce the turbidity from influent from a range of 5 to 171 NTU to an effluent turbidity of 15 NTU or lower.
- 3.2.5 Nutrient (Total Phosphorus & Total Nitrogen) Removal - The stormwater quality filter treatment device shall have demonstrated a minimum median Total Phosphorus removal of 55%, and a minimum median Total Nitrogen removal of 50%.
- 3.2.6 Metals (Total Zinc & Total Copper) Removal - The stormwater quality filter treatment device shall have demonstrated a minimum median Total Zinc removal of 55%, and a minimum median Total Copper removal of 85%.

3.3 INSPECTION and MAINTENANCE

The stormwater quality filter device shall have the following features:

- 3.3.1 Durability of membranes are subject to good handling practices during inspection and maintenance (removal, rinsing, and reinsertion) events, and site specific conditions that may have heavier or lighter loading onto the cartridges, and pollutant variability that may impact the membrane structural integrity. Membrane maintenance and replacement shall be in accordance with manufacturer's recommendations.
- 3.3.2 Inspection which includes trash and floatables collection, sediment depth determination, and visible determination of backwash pool depth shall be easily conducted from grade (outside the structure).
- 3.3.3 Manual rinsing of the reusable filter cartridges shall promote restoration of the flow capacity and sediment capacity of the filter cartridges, extending cartridge service life.

- 3.3.4 The filter device shall have a minimum 12 inches (305 mm) of sediment storage depth, and a minimum of 12 inches between the top of the sediment storage and bottom of the filter cartridge tentacles, unless otherwise specified by the design engineer. Variances may have an impact on the total performance and/or longevity between cartridge maintenance/replacement of the device.
- 3.3.5 Sediment removal from the filter treatment device shall be able to be conducted using a standard maintenance truck and vacuum apparatus, and a minimum one point of entry to the sump that is unobstructed by filter cartridges.
- 3.3.6 Maintenance access shall have a minimum clear height that provides suitable vertical clear space over all of the filter cartridges. Filter cartridges shall be able to be lifted straight vertically out of the receptacles and deck for the entire length of the cartridge.
- 3.3.7 Filter cartridges shall be able to be maintained without the requirement of additional lifting equipment.

PART 4 – EXECUTION

4.1 INSTALLATION

4.1.1 PRECAST DEVICE CONSTRUCTION SEQUENCE

The installation of a watertight precast concrete device should conform to ASTM C 891 and to any state highway, municipal or local specifications for the construction of manholes, whichever is more stringent. Selected sections of a general specification that are applicable are summarized below.

- 4.1.1.1 The watertight precast concrete device is installed in sections in the following sequence:
 - aggregate base
 - base slab
 - treatment chamber and cartridge deck riser section(s)
 - bypass section
 - connect inlet and outlet pipes
 - concrete riser section(s) and/or transition slab (if required)
 - maintenance riser section(s) (if required)
 - frame and access cover

4.1.2 The precast base should be placed level at the specified grade. The entire base should be in contact with the underlying compacted granular material. Subsequent sections, complete with joint seals, should be installed in accordance with the precast concrete manufacturer's recommendations.

4.1.3 Adjustment of the stormwater quality treatment device can be performed by lifting the upper sections free of the excavated area, re-leveling the base, and re-installing the sections. Damaged sections and gaskets should be repaired or replaced as necessary to restore original condition and watertight seals. Once the stormwater quality treatment device has been constructed, any/all lift holes must be plugged watertight with mortar or non-shrink grout.

4.1.4 Inlet and Outlet Pipes Inlet and outlet pipes should be securely set into the device using approved pipe seals (flexible boot connections, where applicable) so that the structure is watertight, and such that any pipe intrusion into the device does not impact the device functionality.

4.1.5 Frame and Cover Installation Adjustment units (e.g. grade rings) should be installed to set the frame and cover at the required elevation. The adjustment units should be laid in a full bed of mortar with successive units being joined using sealant recommended by the manufacturer. Frames for the cover should be set in a full bed of mortar at the elevation specified.

4.2 MAINTENANCE ACCESS WALL

In some instances the Maintenance Access Wall, if provided, shall require an extension attachment and sealing to the precast wall and cartridge deck at the job site, rather than at the precast facility. In this instance, installation of these components shall be performed according to instructions provided by the manufacturer.

4.3 FILTER CARTRIDGE INSTALLATION Filter cartridges shall be installed in the cartridge deck only after the construction site is fully stabilized and in accordance with the manufacturer's guidelines and recommendations. Contractor to contact the manufacturer to schedule cartridge delivery and review procedures/requirements to be completed to the device prior to installation of the cartridges and activation of the system.

PART 5 – QUALITY ASSURANCE

5.1 FILTER CARTRIDGE INSTALLATION Manufacturer shall coordinate delivery of filter cartridges and other internal components with contractor. Filter cartridges shall be delivered and installed complete after site is stabilized and unit is ready to accept cartridges. Unit is ready to accept cartridges after it has been cleaned out and any standing water, debris, and other materials have been removed. Contractor shall take appropriate action to protect the filter cartridge receptacles and filter cartridges from damage during construction, and in accordance with the manufacturer's recommendations and guidance. For systems with cartridges installed prior to full site stabilization and prior to system activation, the contractor can plug inlet and outlet pipes to prevent stormwater and other influent from entering the device. Plugs must be removed during the activation process.

5.2 INSPECTION AND MAINTENANCE


5.2.1 The manufacturer shall provide an Owner's Manual upon request.

5.2.2 After construction and installation, and during operation, the device shall be inspected and cleaned as necessary based on the manufacturer's recommended inspection and maintenance guidelines and the local regulatory agency/body.


5.3 REPLACEMENT FILTER CARTRIDGES When replacement membrane filter elements and/or other parts are required, only membrane filter elements and parts approved by the manufacturer for use with the stormwater quality filter device shall be installed.

END OF SECTION

FLEXSTORM INLET FILTER: 62MHDFX FOR ODSPD 400. __ Std.

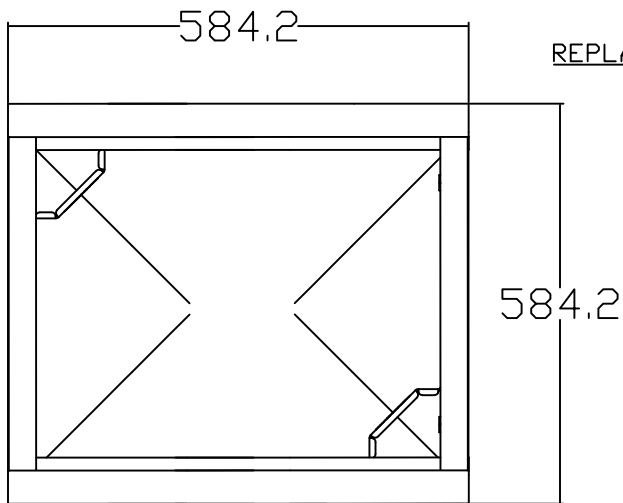

REPLACEABLE ACTIVATED CARBON POUCH
(CLIPPED TO BOTTOM OF THE BAG)

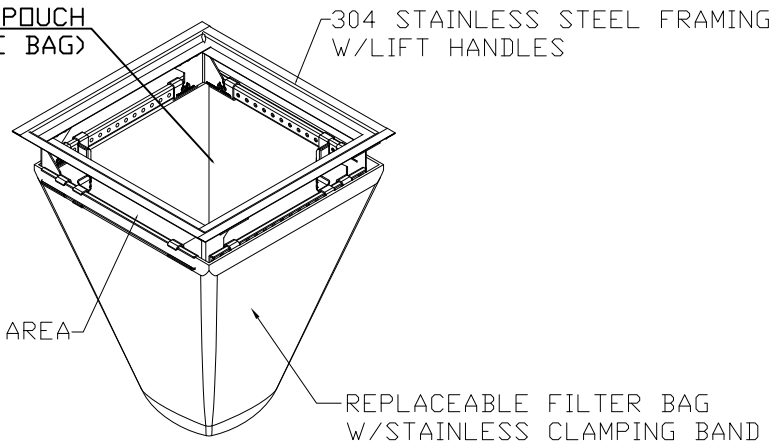


FLEXSTORM PURE INLET FILTERS FOR
RECTANGULAR OPENINGS WITH GRATES

Product selection for FLEXSTORM PURE Filters (Permanent Inlet Protection)

Standard	Inlet Type	Grate Size	Opening Size	Bag Cap (liters ³)	Flow Ratings (liters/second)			FX	FX+	PC	PC+
					FX/FX+	PC/PC+	Bypass				
ODSP 400. __	Square/Rect (SQ) tab supports	604 X 604	508 x 508	67.8	53.8	33.9	124.6	62MHDONTFX	62MHDONTFXP	62MHDONTFX	62MHDONTPCP

*Ratings shown at 50% capacity to accommodate filter bag midway through service life.

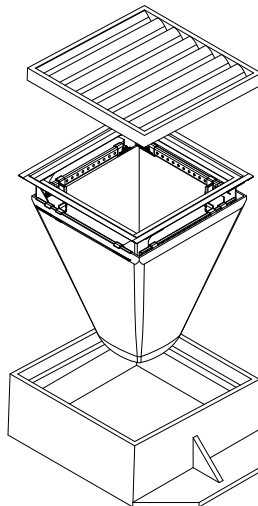

	ALL PRODUCTS MANUFACTURED FLEXSTORM A DIVISION OF ADS, INC. WWW.INLETFILTERS.COM (866) 287-8655 PH (630) 355-3477 FX INFO@INLETFILTERS.COM			REV
	SIZE C	FRAME TYPE	DWG NO	A
SCALE Drawn			SHEET 1 OF 1	

THIS PRINT DISCLOSES SUBJECT MATTER IN WHICH FLEXSTORM HAS PROPRIETARY RIGHTS. THE RECEIPT OR POSSESSION OF THIS PRINT DOES NOT CONFER, TRANSFER, OR LICENSE THE USE OF THE DESIGN OR TECHNICAL INFORMATION SHOWN HEREIN, REPRODUCTION OF THIS PRINT OR ANY INFORMATION CONTAINED HEREIN, OR MANUFACTURE OF ANY ARTICLE HEREFROM, FOR THE DISCLOSURE TO OTHERS IS FORBIDDEN, EXCEPT BY WRITTEN PERMISSION FROM FLEXSTORM. ©2013 ADS, INC.



FLEXSTORM™ Inlet Filter Specifications and Work Instructions

Product: FLEXSTORM Inlet Filters

Manufacturer: Inlet & Pipe Protection, Inc www.inletfilters.com

A subsidiary of Advanced Drainage Systems (ADS) www.ads-pipe.com

1.0 Description of Work:


- 1.1 The work covered shall consist of supplying, installing, and maintaining/cleaning of the FLEXSTORM Inlet Filter assembly. The purpose of the FLEXSTORM Inlet Filter system is to collect silt and sediment from surface storm water runoff at drainage locations shown on the plans or as directed by the Engineer. FLEXSTORM PURE, permanent filters, are capable of removing small particles, hydrocarbons, and other contaminants from drainage “hot spots”.

2.0 Material:

- 2.1 The FLEXSTORM Inlet Filter system is comprised of a corrosion resistant steel frame and a replaceable geotextile sediment bag attached to the frame with a stainless steel locking band. The sediment bag hangs suspended from the rigid frame at a distance below the grate that shall allow full water flow into the drainage structure if the bag is completely filled with sediment.



- 2.2 The FLEXSTORM Inlet Filter frame includes lifting handles in addition to the standard overflow feature. A FLEXSTORM Removal Tool engages the lifting bars or handles to allow manual removal of the assembly without machine assistance. The frame suspension system on most rectangular designs is adjustable in 1/2” increments up to 5” per side should the casting or drainage structure have imperfections.

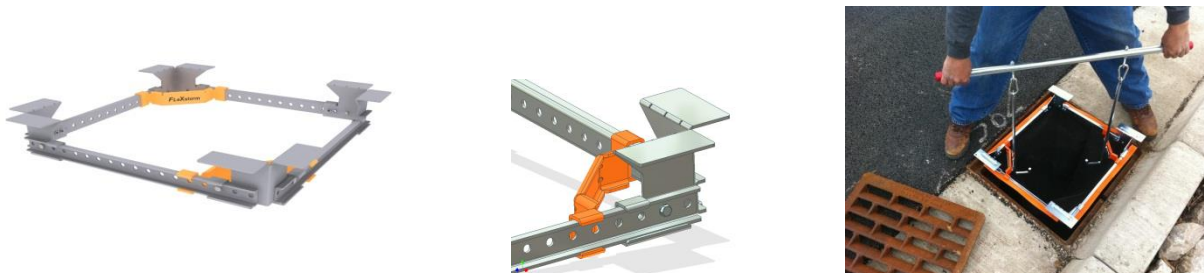




2.3 **FLEXSTORM CATCH-IT** Inlet Filters for temporary inlet protection: The FLEXSTORM CATCH-IT framing is galvanized or zinc plated for corrosion resistance. The “**FX**” Woven Polypropylene filter bag is the design standard, although the “**IL**” Nonwoven geotextile is also available if preferred by the engineer. These products are typically used for temporary inlet protection lasting 3 months (short term road work) to 5 years (residential developments).



2.4 **FLEXSTORM PURE** Inlet Filters for permanent inlet protection: The FLEXSTORM PURE framing is comprised of 304 stainless steel with a 25 year life rating. Multiple filter bags are available: **FX**, **FX+**, **PC**, **PC+**, **LL** and others. The Post Construction “**PC+**” is the design standard consisting of the “**FX**” Woven Polypropylene sediment bag lined with Adsorb-it filter fabric, which is made from recycled polyester fibers. The “**PC+**” includes a replaceable hydrocarbon skimmer pouch strapped to the bottom of the bag for advanced TPH removal.

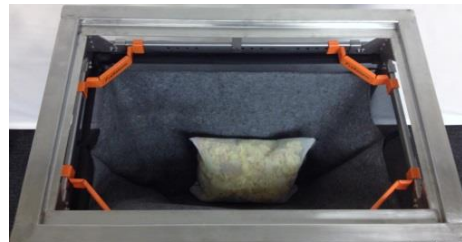

3.0 Filter Bag Specifications and Capabilities:

3.1 Material Properties (taken from manufacturers average roll value):

FLEXSTORM FILTER BAGS	(22" depth)	(12" depth)	Clean Water Flow Rate (GPM/SqFt)	Min A.O.S. (US Sieve)
	STD Bag P/N	Short Bag P/N		
FX: Standard Woven Bag	FX	FX-S	200	40
FX+: Woven w/ Oil Skimmer	FXP	FXP-S	200	40
FXO: Woven w/ Oil Boom	FXO	FXO-S	200	40
PC: Post Construction Bag	PC	PC-S	137	140
PC+: PC w/ Oil Skimmer	PCP	PCP-S	137	140
LL: Litter and Leaf Bag	LL	LL-S	High	3.5
IL: IDOT Non-Woven Bag	IL	IL-S	145	70



3.2 Standard Bag Sizes and Capabilities: Bag Sizes are determined by clear opening dimensions of the drainage structure. Once frame design size is confirmed, Small - XL bag ratings can be confirmed to meet design criteria. Ratings below are for standard 22” deep bags.

Standard Bag Size ⁶	Solids Storage Capacity (CuFt)	Filtered Flow Rate at 50% Max (CFS)			Oil Retention (Oz)	
		FX	PC	IL	PC*	PCP**
Small	1.6	1.2	0.8	0.9	66	155
Medium	2.1	1.8	1.2	1.3	96	185
Large	3.8	2.2	1.5	1.6	120	209
XL	4.2	3.6	2.4	2.6	192	370

4.0 **Tested Filtration Efficiency and Removal Rates:** Filtration Efficiency, TSS, and TPH testing performed under large scale, real world conditions at accredited third party erosion and sediment control testing laboratory. (See Full Test Reports at www.inletfilters.com)



Inside View of Hopper Agitator



Hopper With Outlet Pipe Leading To Area Inlet



Area Inlet Simulated Showing Influent Discharge From Pipe

4.1 **FLEXSTORM “FX” Filtration Efficiency Test Results:** All testing performed in general accordance with the ASTM D 7351, *Standard Test Method For Determination of Sediment Retention Device Effectiveness in Sheet Flow Application*, with flow diverted into an area inlet. Test Soil used as sediment had the following characteristics with a nominal 7% sediment to water concentration mix. This is representative of a heavy sediment load running off of a construction site.

Soil Characteristics	Test Method	Value	Filtration Efficiency of “FX” FLEXSTORM Bag 82%
% Gravel	ASTM D 422	2	
% Sand		60	
% Silt		24	
% Clay		14	
Liquid Limit, %	ASTM D 4318	34	
Plasticity Index, %		9	
Soil Classification	USDA	Sandy Loam	
Soil Classification	USCS	Silty Sand (SM)	



4.2 FLEXSTORM “PC” and “PC+” Test Results: TSS measured on effluent samples in accordance with SM 2540D and TPH in accordance with EPA 1664A.

Product Tested	110 micron Sediment Load	Ave Flow Rate GPM	% TSS Removal	Soil Retention Efficiency
FLEXSTORM PC Sediment Bag	1750 mg/L using OK-110 Silica Sand and Clean Water	23	99.28%	98.96%
		48	99.32%	99.25%
		70	98.89%	98.80%

Product Tested	Street Sweep Sediment Load	Particle Size of Sediment Load	% TSS Removal	Soil Retention Efficiency
FLEXSTORM PC Sediment Bag	2.5% = 100 lbs Sed / 4000 lbs water	.001 mm – 10.0 mm (median 200 micron)	99.68%	95.61%

Product Tested	Hydrocarbon Load	Ave Flow Rate GPM	% TPH Removal	Oil Retention Efficiency
FLEXSTORM PC+	243 mg/L using 750 mL (1.45 lb) used motor oil + lube oil and clean water	19	99.04%	97.22%
FLEXSTORM PC		20	97.67%	91.61%
FLEXSTORM PC+		92	96.88%	99.11%

5.0 Identification of Drainage Structures to Determine FLEXSTORM Item Codes:

5.1 The Installer (Contractor) shall inspect the plans and/or worksite to determine the quantity of each drainage structure casting type. The foundry casting number or the exact grate size and clear opening size will provide the information necessary to identify the required FLEXSTORM Inlet Filter part number. Inlet Filters are supplied to the field pre-configured to fit the specified drainage structure. Item Codes can be built using the FLEXSTORM Product Configurator at www.inletfilters.com. Detailed Submittal / Specification drawings are linked to each Item Code and available for download by engineers and contractors to include on plans and/or verify field inlet requirements. An example of a typical drawing is shown below.

FLEXSTORM P/Ns 62SHDFX & 62SHDFXP
HD4 INLET TYPE: SQUARE/RECT PRECAST OPENING WITH 4 SEAT GRATE SUPPORT

A: GRATE SIZE (LEFT TO RIGHT)
B: CLEAR OPENING (FRONT TO BACK)
C: GRATE SIZE (LEFT TO RIGHT)
D: CLEAR OPENING (FRONT TO BACK)

Pure Frame with FX Bag		Field Inlet Dimensions		Flexstorm Framing Dims				Flexstorm Ratings (Flow at 50% Max)			Pure Frame with FX Bag	
ADS P/N	Flexstorm Item Code	Grate Size (A x C)	Clear Opening (B x D)	B1	D1	A1	C1	Bag Capacity (ft³)	PC/PC+ Flow Rate (CFR)	Bypass (CFR)	ADS P/N	Flexstorm Item Code
62SHDFX	PHD4-95-95-90-90-FX	9 1/2 X 9 1/2	8 X 8	6.0	5.0	9.5	9.3	0.2	0.5	1.2	62SHDFXP	PHD4-95-95-90-90-FXP
62SHDFX	PHD4-115-115-105-105-FX	11.5 X 11.5	10.5 X 10.5	8.0	7.5	11.5	11.3	0.4	0.7	1.7	62SHDFXP	PHD4-115-115-105-105-FXP
62SHDFX	PHD4-118-118-105-105-FX	11.75 X 11.75	10.5 X 10.5	8.0	7.5	11.5	11.5	0.4	0.7	1.7	62SHDFXP	PHD4-118-118-105-105-FXP
62SHDFX	PHD4-120-120-105-105-FX	12 X 12	10.5 X 10.5	8.5	7.5	12.0	11.8	0.4	0.7	1.7	62SHDFXP	PHD4-120-120-105-105-FXP
62SHDFX	PHD4-134-134-110-110-FX	13.375 X 13.375	11.50 X 11.50	9.5	8.5	13.0	13.1	0.5	0.8	1.9	62SHDFXP	PHD4-134-134-110-110-FXP
62SHDFX	PHD4-130-130-120-120-FX	13 X 13	12 X 12	9.5	9.0	13.0	12.8	0.5	0.8	2.0	62SHDFXP	PHD4-130-130-120-120-FXP
62SHDFX	PHD4-144-144-133-133-FX	14.375 X 14.375	13.25 X 13.25	10.5	10.5	14.0	14.1	0.7	0.9	2.3	62SHDFXP	PHD4-144-144-133-133-FXP
62SHDFX	PHD4-145-145-133-133-FX	14.5 X 14.5	13.25 X 13.25	11.0	10.5	14.5	14.3	0.7	0.9	2.3	62SHDFXP	PHD4-145-145-133-133-FXP
62SHDFX	PHD4-159-159-143-143-FX	15.87 X 15.87	14.25 X 14.25	12.0	11.5	15.5	15.6	0.9	1.0	2.5	62SHDFXP	PHD4-159-159-143-143-FXP
62SHDFX	PHD4-176-176-160-160-FX	17.75 X 17.75	16 X 16	14.0	13.0	17.5	17.5	1.2	1.1	2.9	62SHDFXP	PHD4-176-176-160-160-FXP

NOTES:

- RATINGS SHOWN ARE FOR STANDARD 22" BAG DEPTH; "SHORT" 12" DEPTH BAGS ARE AVAILABLE WITH -S SUFFIX; RATINGS REDUCED BY ~50%.
- THE FOLLOWING REQUIRES ADDITIONAL REVIEW
 - GRATES WITH EXTENDED BOTTOMS
 - ANY OBSTRUCTED INLET OPENINGS

ALL PRODUCTS MANUFACTURED BY INLET & PIPE PROTECTION, INC. A DIVISION OF ADS, INC. WWW.INLETFILTERS.COM (866) 287-8655 PH (630) 355-3477 FX INFO@INLETFILTERS.COM

DATE: 11/15/2017 11:00 AM
SCALE: 1/8"=1'-0" HD4 HD4-62SHD-FX SHEET 1 OF 1

6.0 Installation Into Standard Grated Drainage Structures:

- 6.1 Remove the grate from the casting or concrete drainage structure. Clean the ledge (lip) of the casting frame or drainage structure to ensure it is free of stone and dirt. Drop in the FLEXSTORM Inlet Filter through the clear opening and be sure the suspension hangers rest firmly on the inside ledge (lip) of the casting. Replace the grate and confirm it is elevated no more than 1/8", which is the thickness of the steel hangers. For Curb Box Inlet Filters: Insert FLEXSTORM CATCH IT Inlet Filter as described above, pull the rear curb guard flap up and over the open curb box until tight, align magnets to ensure firm attachment to the top portion of the curb box casting. If the curb back opening is not magnetic, slide a typical rock sack or 2 x 4 through the 2-ply rear curb box flap to create a dam which will direct runoff into the sediment bag.





7.0 Maintenance Guidelines: The frequency of maintenance will vary depending on the application (during construction, post construction, or industrial use), the area of installation (relative to grade and runoff exposure), and the time of year relative to the geographic location (infrequent rain, year round rain, rain and snow conditions). The FLEXSTORM Operation & Maintenance Plan (as shown in 7.5) or other maintenance log should be kept on file.

- 7.1 Frequency of Inspections: Construction site inspection should occur following each ½” or more rain event. Post Construction inspections should occur three times per year (every four months) in areas with year round rainfall and three times per year (every three months) in areas with rainy seasons before and after snowfall season. Industrial application site inspections (loading ramps, wash racks, maintenance facilities) should occur on a regularly scheduled basis no less than three times per year.
- 7.2 General Maintenance for standard sediment bags: Upon inspection, the FLEXSTORM Inlet Filter should be emptied if the sediment bag is more than half filled with sediment and debris, or as directed by the Engineer. Remove the grate, engage the lifting bars or handles with the FLEXSTORM Removal Tool, and lift the FLEXSTORM Inlet Filter from the drainage structure. Machine assistance is not required. Dispose of the sediment or debris as directed by the Engineer. As an alternative, an industrial vacuum may be used to collect the accumulated sediment if available. Remove any caked on silt from the sediment bag and reverse flush the bag for optimal filtration. Replace the bag if the geotextile is torn or punctured to ½” diameter or greater on the lower half of the bag. If properly maintained, the Woven sediment bag will last a minimum of 4 years in the field.
- 7.3 Inspection and Handling of the FLEXSTORM PC / PC+ post construction sediment bag: The PC+ sediment bags will collect oil until saturated. Both the Adsorb-it filter liner and the skimmer pouch will retain oil. The volume of oils retained will depend on sediment bag size. Unlike other passive oil sorbent products, Adsorb-it filter fabric has the ability to remove hydrocarbons at high flow rates while retaining 10- 20 times its weight in oil (weight of fabric is 12.8 oz / sq yd). The average 2’ x 2’ PC Bag contains approx .8 sq yds, or 10 oz of fabric. At 50% saturation, the average Adsorb-it lined PC filter will retain approximately 75 oz (4.2 lbs) of oil. Once the bag has become saturated with oils, it can be centrifuged or passed through a wringer to recover the oils, and the fabric reused with 85% to 90% efficacy. If it is determined, per Maintenance Contracts or Engineering Instructions, that the saturated PC sediment bags will be completely replaced, it is the responsibility of the service technician to place the filter medium and associated debris in an approved container and dispose of in accordance with EPA regulations. Spent Adsorb-it can be recycled for its fuel value through waste to energy incineration with a higher BTU per pound value than coal. The oil skimmers start white in color and will gradually turn brown/black as they become saturated, indicating time for replacement. The average skimmer pouch will absorb approximately 62 oz (4 lbs) of oil before requiring replacement. To remove the pouch simply unclip it from the swivel strap sewn to the bottom of the bag. Dispose of all oil contaminated products in accordance to EPA guidelines. The ClearTec Rubberizer media used in the pouch, since a solidifier, will not leach under pressure and can be disposed of in most landfills, recycled for industrial applications, or burned as fuel.



- 7.4 Sediment Bag Replacement: When replacing a Sediment Bag, remove the bag by loosening or cutting off the clamping band. Take the new sediment bag, which is equipped with a stainless steel worm drive clamping band, and use a drill or screw driver to tighten the bag around the frame channel. Ensure the bag is secure and that there is no slack around the perimeter of the band. For Oil absorbent boom bags, simply replace the oil boom or pouch when saturated by sliding it through the mesh support sleeve.





FLEXSTORM® PURE PERMANENT INLET PROTECTION

SPECIFY WITH CONFIDENCE

State DOTs and municipalities across the country now have a universal structural BMP to address the issue of storm sewer inlet protection: FLEXSTORM PURE Inlet Filters.

The FLEXSTORM PURE system is the preferred choice for permanent inlet protection and storm water runoff control. Constructed of versatile stainless steel, FLEXSTORM PURE Inlet Filters will fit any drainage structure and are available with site-specific filter bags providing various levels of filtration. Whether you're the specifier or the user, it's clear to see how FLEXSTORM PURE Inlet Filters outperform the competition.


APPLICATIONS:

Car Washes	Gas Stations
Commercial	Parking Lots
Loading Ramps	Dock Drains
Industrial	Maintenance

FEATURES:

- Stainless Steel filter framing is custom configured to fit perfectly into any drainage structure, whether a standard design or obstructed inlet opening
- Filtered Flow Rates and Ultimate Bypass Rates are designed to meet your specific inlet requirements
- Multiple Filter Bags are available targeting site specific removal of trash, litter, leaves, or small particles, oil and grease
- Filters work below grade with an ultimate bypass allowing inlet area to drain with a full bag
- Units install in seconds and are easily maintained with the FLEXSTORM Universal Removal Tool (no heavy machinery required)

ADS Service: ADS representatives are committed to providing you with the answers to all your questions, including selecting the proper filter, specifications, installation and more. Also try the **ADS FLEXSTORM Online Product Configurator** at www.inletfilters.com

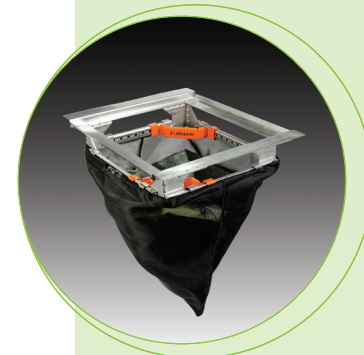

FEATURES:

- Receive payback on your investment: durable stainless steel framing provides extended service life while replaceable filter bags handle loads with a safety factor of 5
- Meets stringent removal requirements:
 - FX filter bags are rated for >80% removal efficiency of street sweep-size particles
 - PC/PC+ filter bags have been tested to 99% TSS removal of OK-110 US Silica Sand and 97% TPH (total petroleum hydrocarbon) removal
- Help prevent fines: FLEXSTORM Inlet Filters comply with EPA NPDES initiatives as a temporary or permanent BMP
- If not in stock, orders up to 100 pieces can ship within 48 hours



FLEXSTORM PURE INLET FILTERS SPECIFICATION

IDENTIFICATION

The installer shall inspect the plans and/or worksite to determine the quantity of each drainage structure casting type. The foundry casting number, exact grate size and clear opening size, or other information will be necessary to finalize the FLEXSTORM part number and dimensions. The units are shipped to the field configured precisely to fit the identified drainage structure.

MATERIAL AND PERFORMANCE

The FLEXSTORM Inlet Filter system is comprised of a corrosion resistant steel frame and a replaceable geotextile filter bag attached to the frame with a stainless steel locking band. The filter bag hangs suspended at a distance below the grate that shall allow full water flow into the drainage structure if the bag is completely filled with sediment. The standard Woven Polypropylene FX filter bags are rated for 200 gpm/sqft with a removal efficiency of 82% when filtering a USDA Sandy Loam sediment load. The Post Construction PC filter bags are rated for 137 gpm/sqft and have been 3rd party tested at 99% TSS removal to 110 micron and 97% TPH removal of used motor oil hydrocarbon mix.

INSTALLATION

Remove the grate from the casting or concrete drainage structure. Clean the ledge (lip) of the casting frame or drainage structure to ensure it is free of stone and dirt. Drop in the FLEXSTORM Inlet Filter through the clear opening and be sure the suspension hangers rest firmly on the inside ledge (lip) of the casting. Replace the grate and confirm it is elevated no more than 1/8", which is the thickness of the steel hangers. For wall mount units, follow instructions for attaching the stainless steel mounting brackets using the provided concrete fasteners.

INSPECTION FREQUENCY

Construction site inspection should occur following each 1/2" or more rain event. Post Construction inspections should occur three times per year (every four months) in areas with mild year round rainfall and four times per year (every three months Feb–Nov) in areas with summer rains and before and after the winter snowfall season. Industrial application site inspections (loading ramps, wash racks, maintenance facilities) should occur on a regularly scheduled basis no less than three times per year.

MAINTENANCE GUIDELINES

Empty the filter bag if more than half filled with sediment and debris, or as directed by the engineer. Remove the grate, engage the lifting bars or handles with the FLEXSTORM Removal Tool, and lift from the drainage structure. Dispose of the sediment or debris as directed by the engineer or maintenance contract in accordance with EPA guidelines.

As an alternative, an industrial vacuum may be used to collect the accumulated sediment. Remove any caked-on silt from the sediment bag and reverse flush the bag with medium spray for optimal filtration. Replace the bag if torn or punctured to 1/2" diameter or greater on the lower half of the bag. Post Construction PC/PC+ Bags should be maintained prior to 50% oil saturation. The average 2' x 2' PC filter bag will retain approx. 96 oz (5.4 lbs) of oil at which time it should be serviced or replaced. It can be centrifuged or passed through a wringer to recover the oils, and the fabric reused with 85% to 90% efficacy. It may also be recycled for its fuel value through waste to energy incineration. When utilizing the Cleartec Rubberizer Pouches in the + bags, note that these oil skimmers will gradually turn brown and solidify as they become saturated, indicating time for replacement. Each pouch will absorb approximately 62 oz (4 lbs) of oil before requiring replacement. The spent media may also be recycled for its fuel value through waste to energy incineration. Dispose of all oil contaminated products in accordance with EPA guidelines.

FILTER BAG REPLACEMENT

Remove the bag by loosening or cutting off the clamping band. Take the new filter bag, which is equipped with a stainless steel worm drive clamping band, and use a screw driver to tighten the bag around the frame channel. Ensure the bag is secure and that there is no slack around the perimeter of the band.

For more information on FLEXSTORM Inlet Filters and other ADS products, please contact our Customer Service Representatives at 1-800-821-6710 Try the **ADS FLEXSTORM Online Product Configurator** at www.inletfilters.com.

ADS "Terms and Conditions of Sale" are available on the ADS website, www.ads-pipe.com

The ADS logo and the Green Stripe are registered trademarks of Advanced Drainage Systems, Inc. FLEXSTORM is a registered trademark of Inlet & Pipe Protection, Inc. © 2019 Advanced Drainage Systems, Inc. BRO 10892 06/19 MH

Lift Handles ease installation and maintenance




Replaceable Sediment Bag

1/8" thick steel hangers & channels; precision stampings **configured to fit each individual casting**



CAD drawings, work instructions and test reports on website: www.inletfilters.com

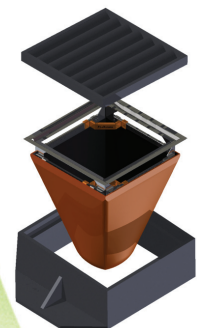

APPENDIX F
Stormwater Management Plan

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN,
 VOLLEBECK LTD.
 PROJECT NO. 19614-17 HINDU TEMPLE
 DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES
 1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
 3. Elevations derived from benchmark D19119680388 having an elevation of 92.16 metres.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Only visible surface utilities were located.
 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
 For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
 SITE AREA = 4.048 Hectares.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- *50.00 PROPOSED ELEVATION
- *50.00HP PROPOSED HIGH POINT ELEVATION
- *50.00SW PROPOSED SWALE ELEVATION
- *50.00BC PROPOSED BOTTOM OF CURB ELEVATION
- *50.00TC PROPOSED TOP OF CURB ELEVATION
- *50.00EX MATCH INTO EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- SUB PROPOSED 100mmØ PERFORATED SUBDRAIN
- STM PROPOSED STORM SEWER
- SAN PROPOSED SANITARY SEWER
- WTR PROPOSED WATERMAIN
- STM EXISTING STORM SEWER
- SAN EXISTING SANITARY SEWER
- WTR EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WS-XX WATERSHED NAME
- AREA RUNOFF RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS
 GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.
 BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.
 AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CADD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.
 UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.
 THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.
 UNAUTHORIZED CHANGES:
 IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.
 IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.
 IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.
 GENERAL NOTES:
 EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.
 CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.
 THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.
 CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED


LRJ
 ENGINEERING | INGENIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON
 DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL
 4835 BANK STREET, OTTAWA


DRAWING TITLE: STORMWATER MANAGEMENT PLAN

PROJECT NO. 170132
 DATE: JAN2020
C601

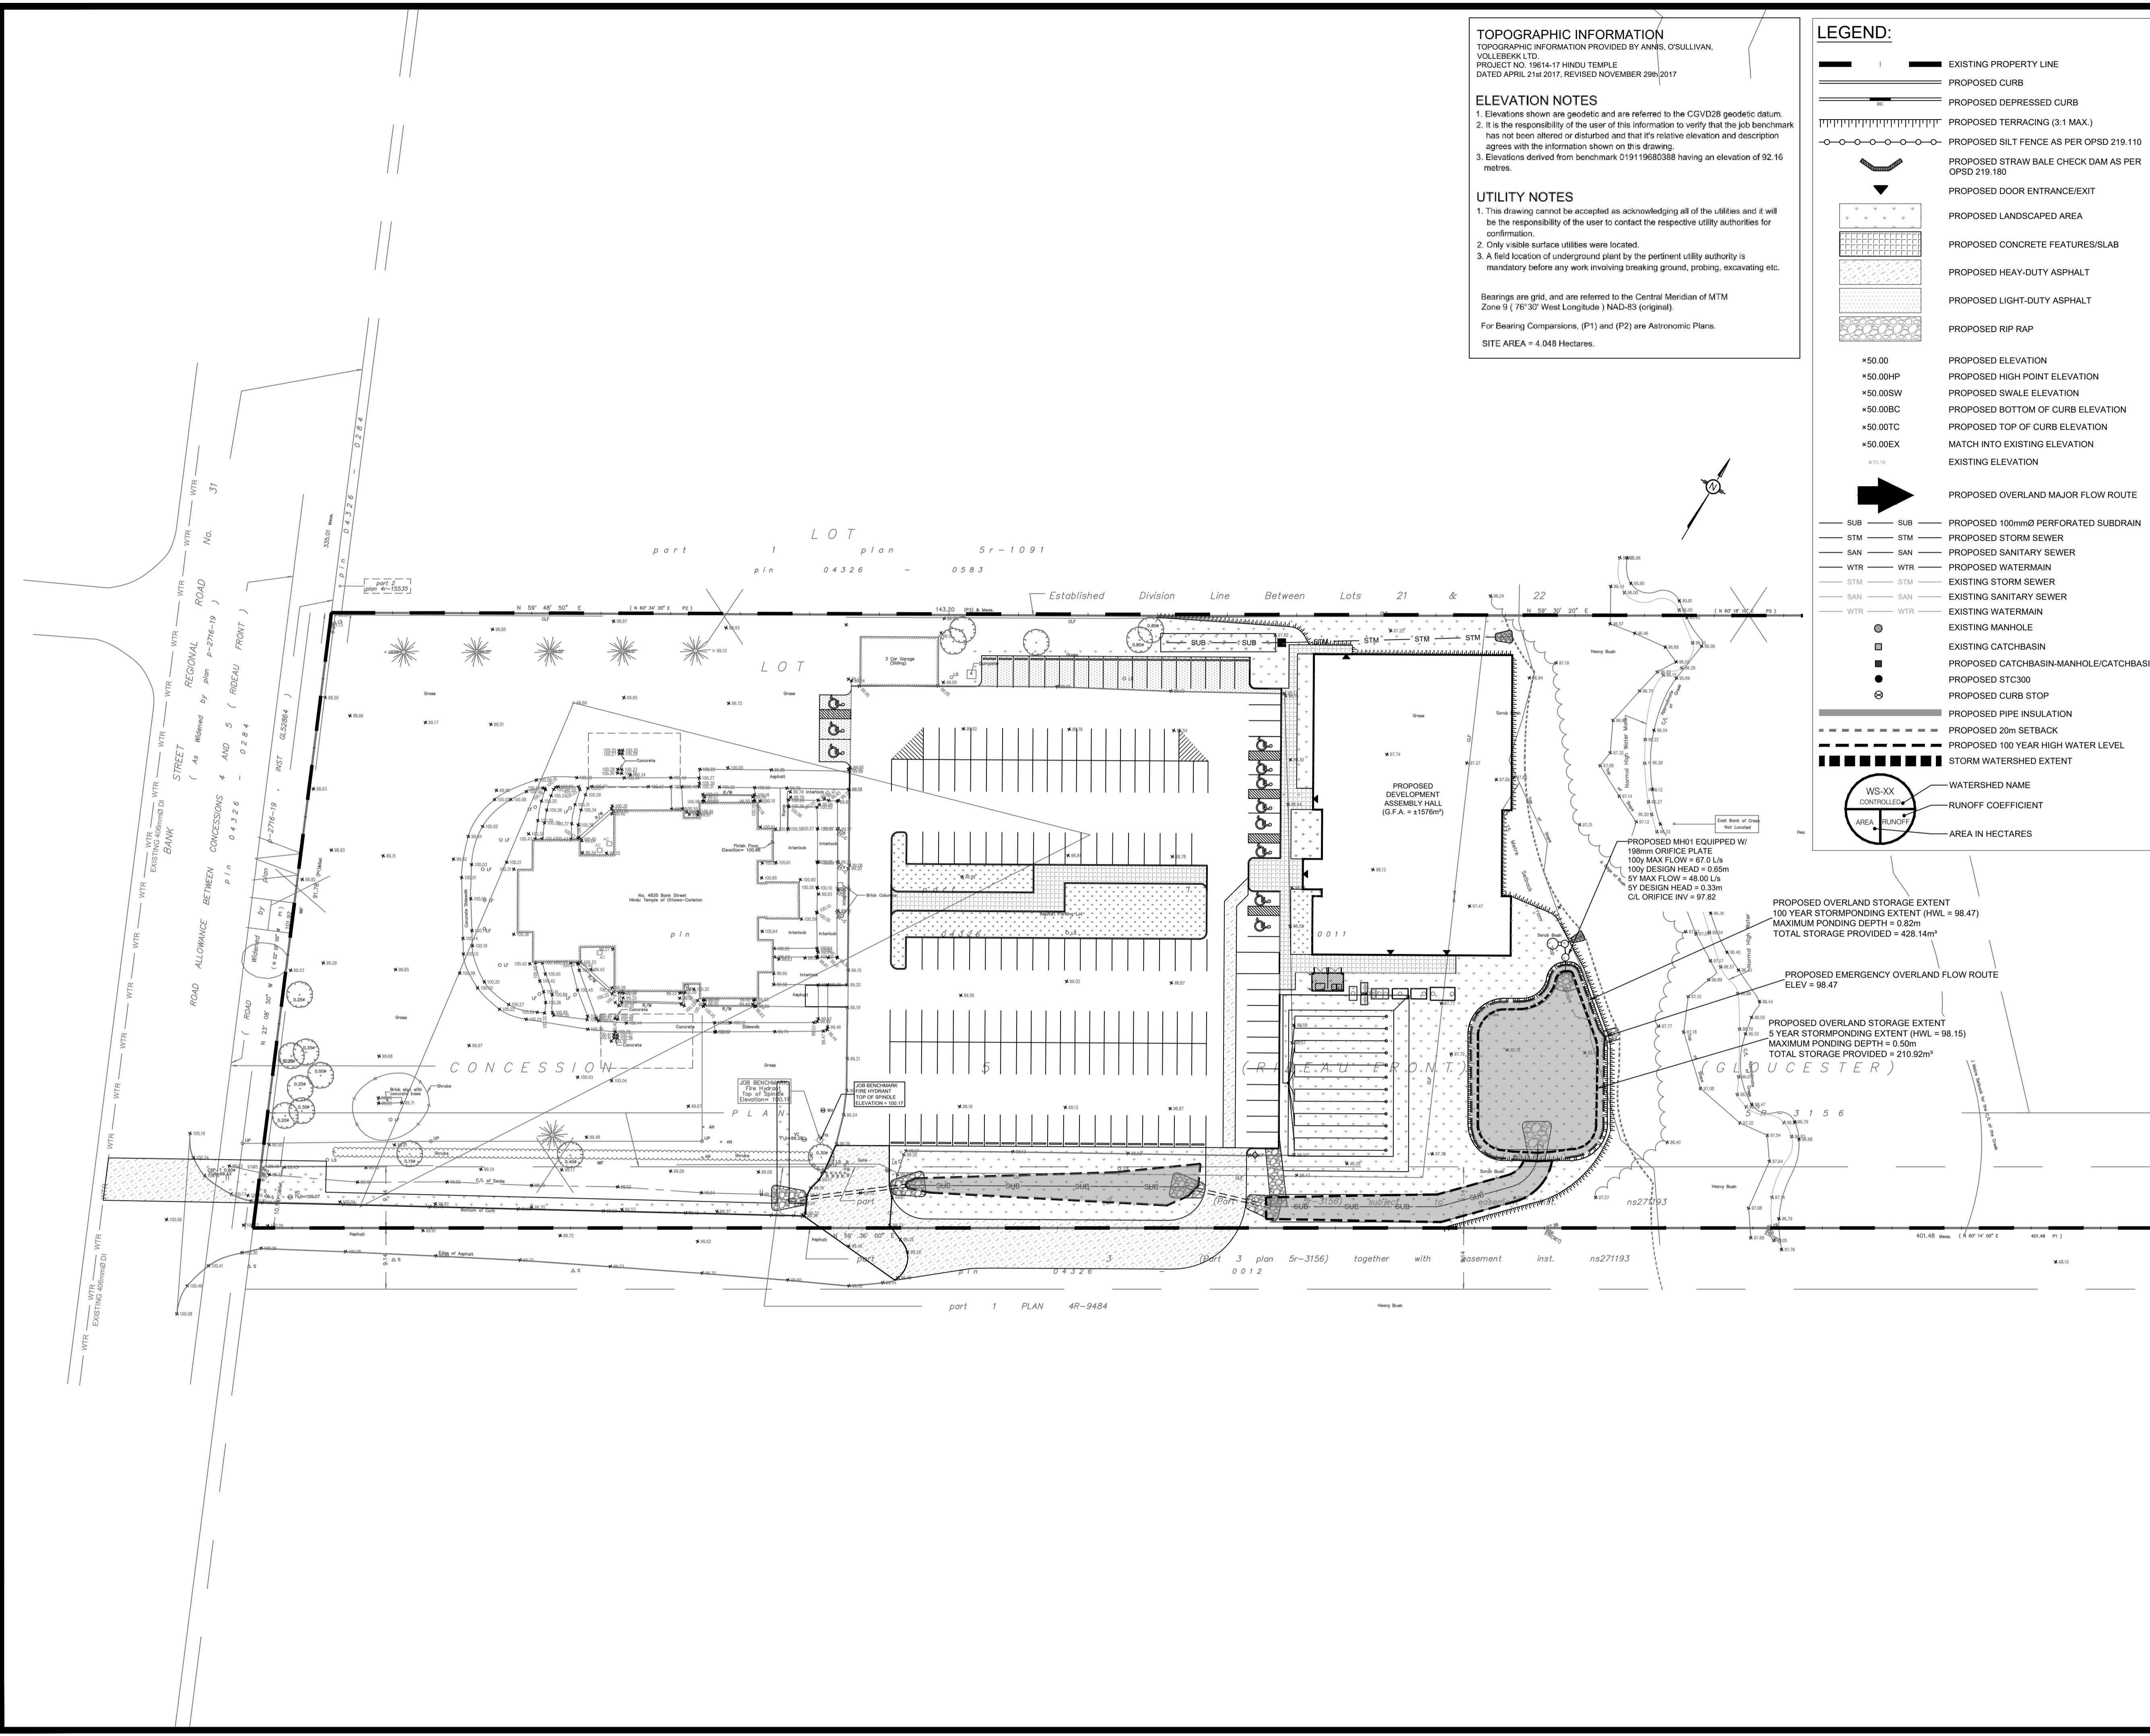

File no.: D017-12-20-0059

APPENDIX G
Architectural Drawings

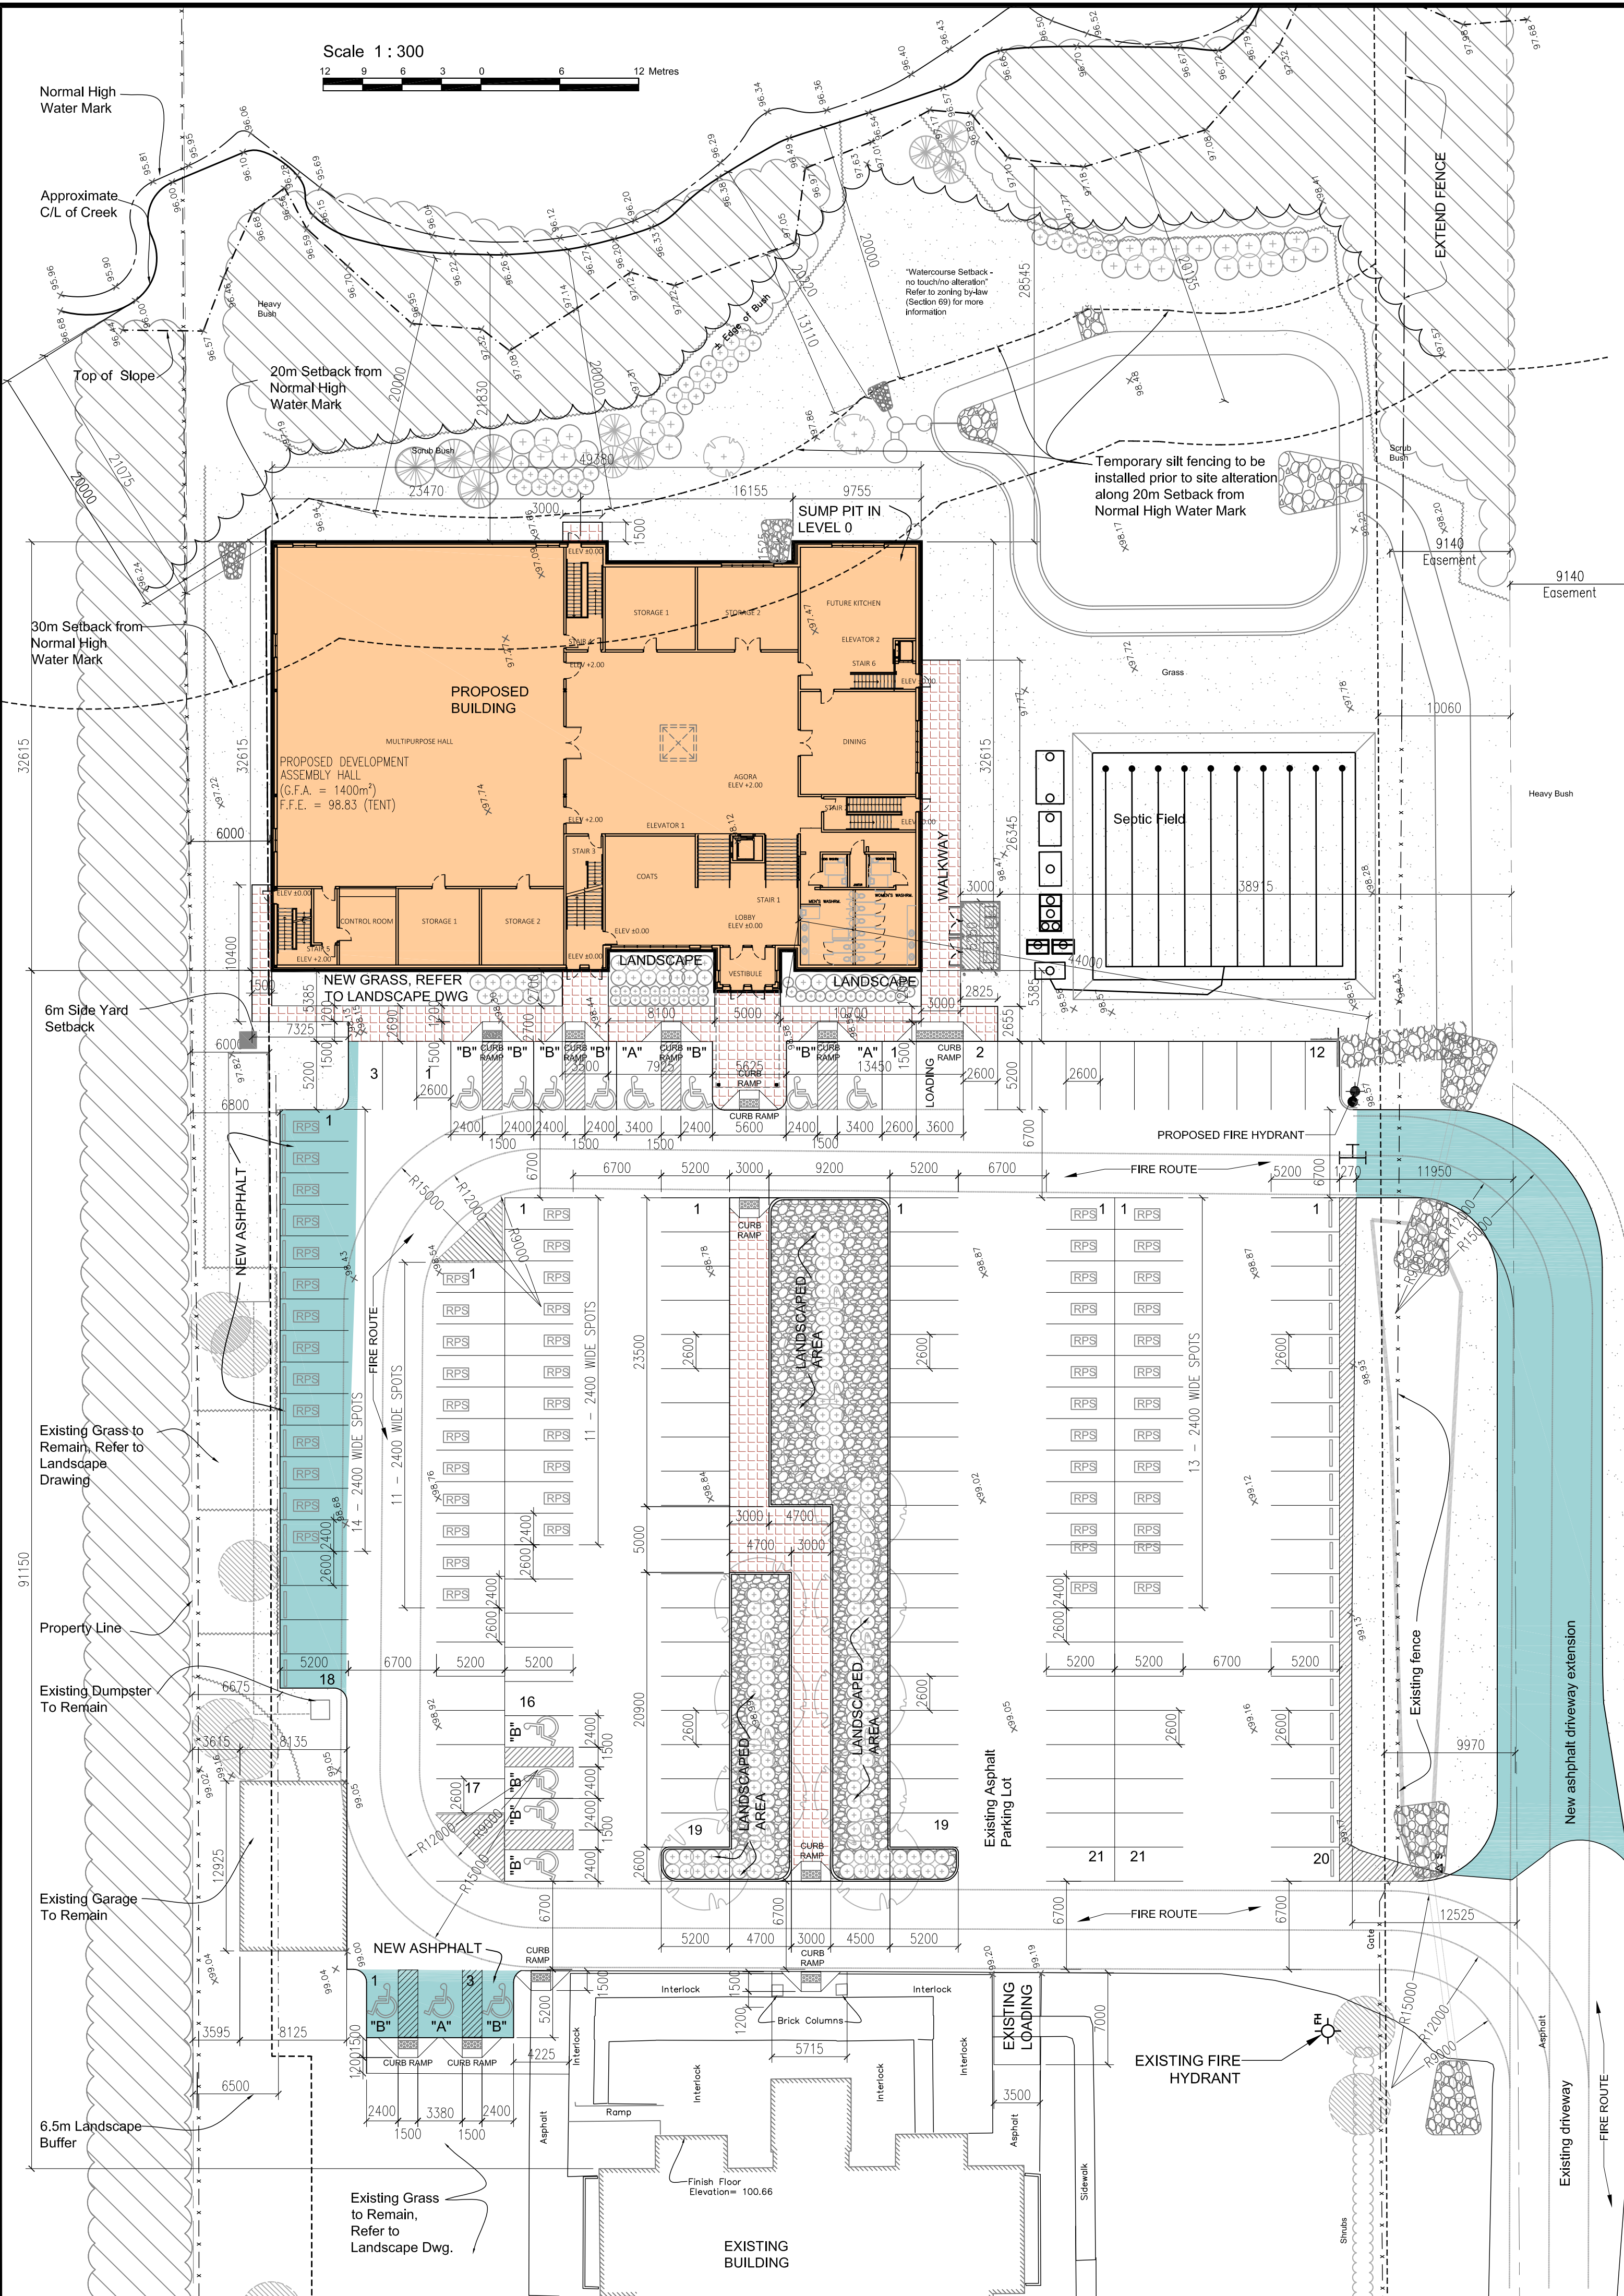

SITE INFORMATION
 Address: 4835 Bank Street-Ottawa
 Legal Description: Part of Lot 22, Con 5 (Rideau Front), Ottawa, ON
 Owner: Hindu Temple of Ottawa-Carleton
 Existing Zoning: R15 Rural Institutional
 Amended Zoning: R15[865r] within the Area of Development & R15[866r] on the remainder of the property east of the watercourse centreline

Zoning Mechanisms Provisions - R15	Required	Provided
(a) Minimum lot area	10,000m ²	40,480 m ² (4.048 ha)
(b) Minimum lot width	75m	101.095m
(c) Minimum front yard setback	9m	27.975m (Existing Building)
(d) Minimum rear yard setback		
(i) abutting a residential use or zone	10m	Not Applicable
(ii) all other cases	10m	Not Applicable
(iii) from normal high water mark	20m	21m
(e) Minimum interior side yard setback	9m	Not Applicable
(f) Approved side yard setback	6m	6m
per application ACS2018-PIE-TS-0060 Approved on July 12, 2018		
(f) Minimum corner side yard setback	9m	Not Applicable
(g) Maximum principal building height	12m	12m
(h) Maximum lot coverage	30%	11.70%
(i) Minimum landscaped area	20%	65.50%

AREA OF DEVELOPMENT (Same as R15[865R] zone boundary): 23,598m² (2,359 ha)
 Existing Temple Place of Assembly GFA: 630 m²
 Proposed Hall GFA: 1,400 m²

Within Area of Development	Existing (Temple)	Proposed (Temple + Hall)
Lot Coverage	1,168 m ² (4.95 %)	2,761 m ² (11.70 %)
Landscaped Area	17,353 m ² (73.53%)	15,457 m ² (65.50 %)
Parking Lot (Paved Area)	5,077 m ² (21.52%)	5,380 m ² (22.80 %)

LANDSCAPING BUFFER AT PARKING LOT:

Perimeter or interior landscaped area	Required	Provided
Minimum of 15% of the area of any parking lot		Total landscaped Area = 2839.28m ² (52.57%) (> required 15%) Interior landscaped area = 2197.65m ² Perimeter landscaped area = 641.63m ²

Minimum Required Width and Location of a Landscaped Buffer of a Parking Lot	Required	Provided
Abutting a street	3 metres	Not applicable
Not abutting a street	3 metres	6.5metre in location closest to property Line

OUTDOOR REFUSE COLLECTION AND REFUSE LOADING AREAS:
 are accessed via the parking lot and
 • do not abut a public street;
 • are located at least 3.0 metres from any other lot line; and
 • are screened from view by an opaque screen with a minimum height of 2.0 metres.
 • Refuse collecting area is located at >38m away from the side property line
 • Size of Waste Enclosure 3.0m x 5.25m, refer to architectural drawing A040 for details
 • Size of Garbage Bins will be determined by private collector, bins will be placed in garbage enclosure

PARKING


Parking type	Required	Provided
Spaces (8.4 spaces /100 m ² of GFA)	171 spots	181 spots
Regular size spots	- 93 spots	- 104 spots
Reduced size - 40% of 167 spaces	- 67 spots	- 62 spots
Barrier-Free Type "A" 3400 wide	- 3 spots	- 3 spots
Barrier-Free Type "B" 2400 wide	- 4 spots	- 12 spots
Loading spaces	2 spots (1 Existing spot)	2 spots (1 Existing + 1 new spot)
Bicycle	0 spots	0 spots
TOTAL SPACES	171 spots	181 spots

PROPOSED STORMWATER MANAGEMENT:
 (a) Ponding volume achieved via stormwater detention area
 (b) Flow control provided via inlet control device installed at detention area outlet
 (Refer to civil documents)

SNOW CLEARING: Snow will be cleared by private contractor and taken away to be dumped off the site

NOTE:
 • See Landscape Drawings for tree protection fences
 • The property boundary information was derived from documents prepared by ANNIS, O'SULLIVAN, VOLLEBEKK

LEGEND:
 [Dotted Line] DOTTED LINE DELINEATES AREA OF DEVELOPMENT (SAME AS R15[865R] ZONE BOUNDARY)
 [Hatched Area] HATCHED AREA SHOWS EXTENT OF EXISTING PAVING
 [Hatched Area] HATCHED AREA SHOWS EXTENT OF NEW BUILDING
 [Hatched Area] HATCHED AREA SHOWS EXTENT OF ASPHALT REMOVAL
 [Hatched Area] HATCHED AREA SHOWS EXTENT OF NEW ASPHALT
 [Hatched Area] HATCHED AREA SHOWS EXTENT OF NEW PAVING (Refer to landscape drawing for material)
 [Pattern] PROPOSED RIP RAP (Refer to civil drawing)
 [Pattern] REDUCED PARKING SPOT
 [Group of Trees] GROUP OF EXISTING TREES TO REMAIN (Refer to landscape drawing)
 [Single Tree] EXISTING TREE TO REMAIN (Refer to landscape drawing)
 [Tree Symbol] PROPOSED DECIDUOUS TREE (Refer to landscape drawing)
 [Tree Symbol] PROPOSED CONIFEROUS TREE (Refer to landscape drawing)
 [Plant Symbol] PROPOSED SHRUBS/ PERENNIALS/ ORNAMENTAL GRASSES (Refer to landscape drawing)
 [Pattern] PROPOSED NON-IRRIGATED SPORTS FIELD SEED MIXTURE (Refer to landscape drawing)
 [Pattern] PROPOSED ONTARIO SEED COMPANY LTD. GREEK BANK SEED MIXTURE (Refer to landscape drawing)
 [Pattern] PROPOSED RIVERSTONE MULCH (Refer to landscape drawing)

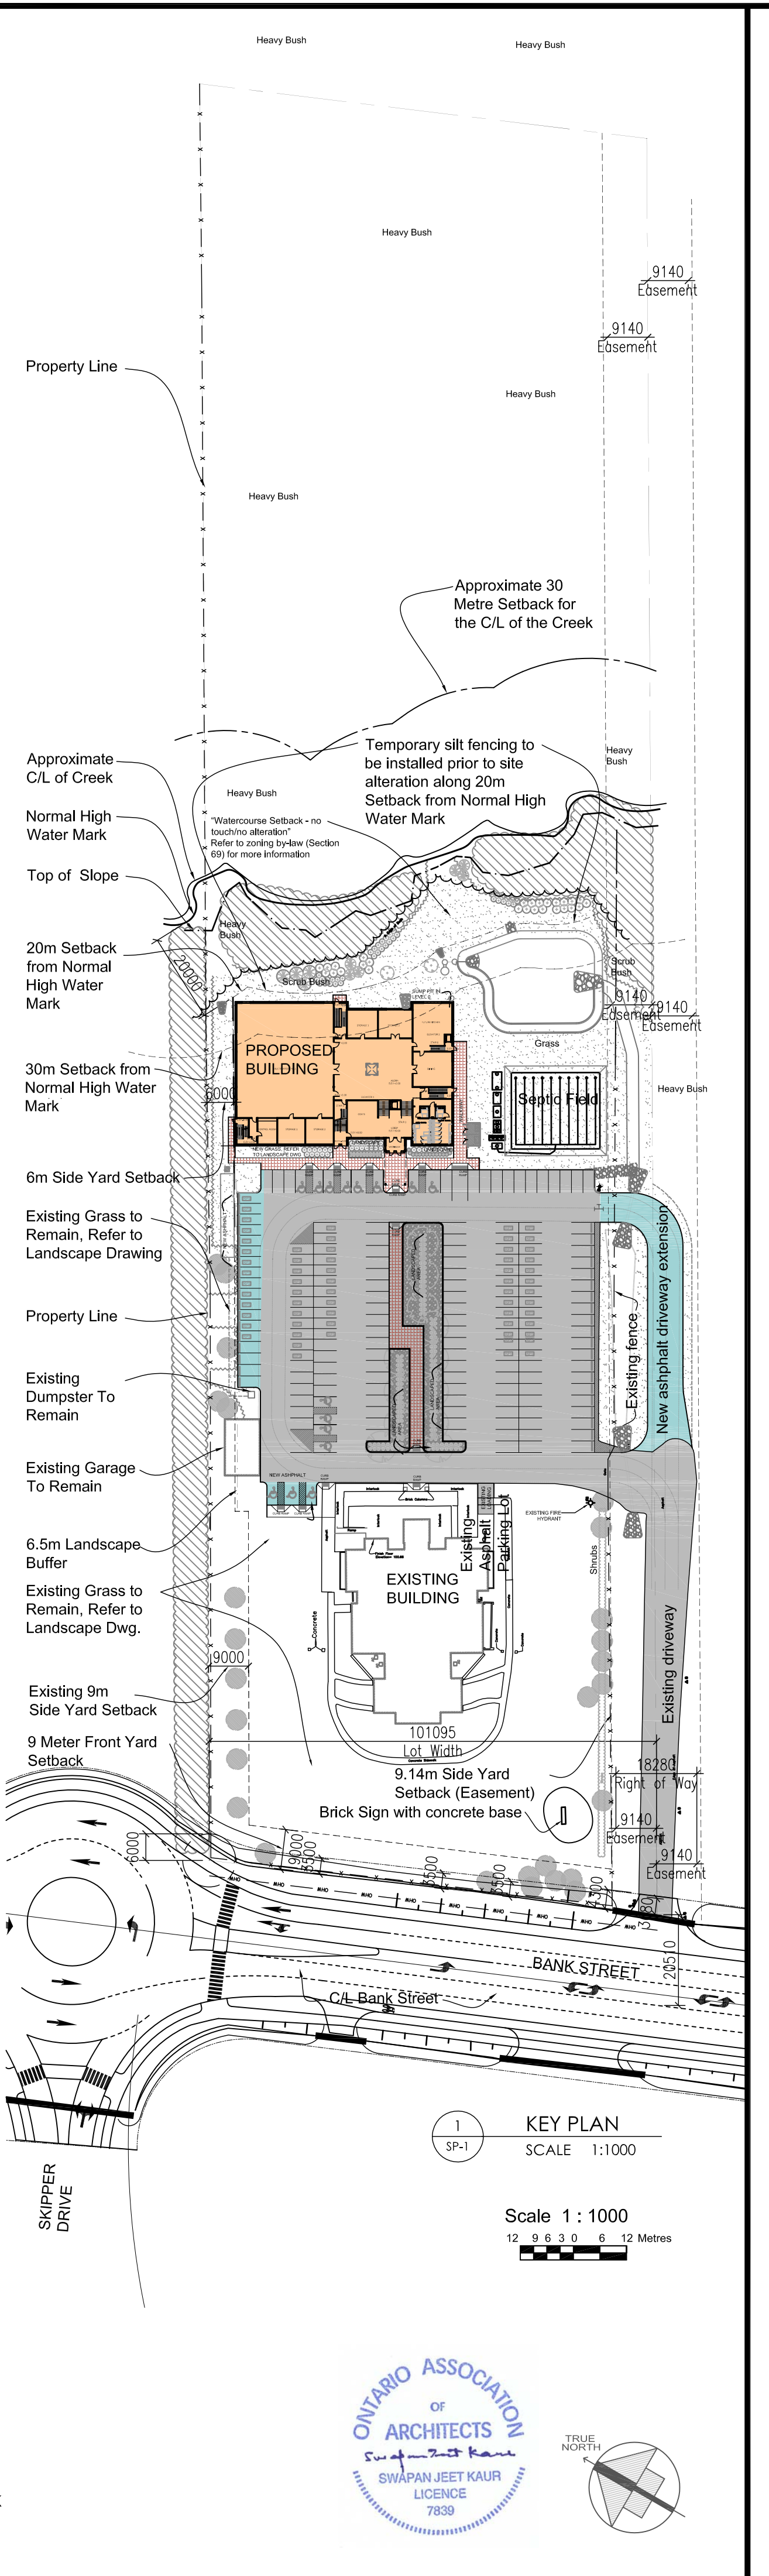



GENERAL NOTES

- CONTRACTOR MUST VERIFY ALL JOB DIMENSIONS, DRAWINGS, DETAILS, SPECIFICATIONS & REPORT ANY DISCREPANCIES TO OWNERS BEFORE PROCEEDING WITH WORK.
- ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE & THE PROPERTY OF THE ARCHITECT WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK, & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
11	ISSUED FOR SITE PLAN	2022SEP27
10	ISSUED FOR SITE PLAN	2022JULY22
9	ISSUED FOR SITE PLAN	2022APR25
8	ISSUED FOR SITE PLAN	2021NOV03
7	ISSUED FOR SITE PLAN	2021OCT22
6	ISSUED FOR SITE PLAN	MAR 16

PROJECT MANAGER	PLANNER
HARISH GUPTA B. ARCH	jd planning Project Management

1066 PLANTE DRIVE, OTTAWA ON K1V 9E6
 T: 613-737-5939
 C: 613-866-2984

41 Rideau Ferry Road, Lombardy ON K0G 1L0
 t 613 812 1726
 e jessica@jplan.ca

SURVEYOR	TRANSPORTATION ENGINEER
ANNIS, O'SULLIVAN, VOLLEBEKK LTD. Suite 500 Nepean, ON K2E 7S6 Phone: (613) 727-0850 Fax: (613) 727-1079 Email: Nepean@aovld.com	D. J. Halpeny & Associates Ltd. P. O. Box 774, Moncton, ON K4M 1A7 Tel (613) 692-8662 Fax (613) 692-1945 dovoi@djhalpeny.com

STRUCTURAL CONSULTANT	LANDSCAPE CONSULTANT
DESIGN & SYSTEMS STRUCTURAL & WELDING ENGINEERS SUITE 251, 2378 HOLLY LANE, OTTAWA, ON K1V 7P1 Ph: 613 739 9500 email: khoral@designsystems.ca	James B. Lennox & Associates Inc. 3332 Corling Ave. Ottawa, ON K2H 5A8 Phone: (613) 722.5168 Email: j@jlo.ca

CIVIL CONSULTANT	MECHANICAL & ELECTRICAL CONSULTANT
LRJ ENGINEERING INC. 5430 Carleton Road Ottawa, ON K1J 9J2 www.lrc.ca (613) 842-3434	CHIARELLI KORBEL ENGINEERING LTD. DICKCKELTD@GMAIL.COM, 613-986-4643 NICKCKELTD@GMAIL.COM, 613-277-0119 1857 DUNDAS RD., KANATA, ON K2K 1X7

ARCHITECT
VECTOR DESIGN ARCHITECTS
 14 STRATHBURY STREET,
 OTTAWA, ONTARIO K2G 5N8
 TELEPHONE: (613) 421-9806
 EMAIL: vecarch@gmail.com

PROJECT AND LOCATION
 HERITAGE CENTRE -
 HINDU TEMPLE - PHASE 2,
 4835 BANK ST., OTTAWA, ON
 P I N 0 4 3 2 6 - 0 0 1 1


TITLE OF DRAWING
SITE PLAN

JOB NUMBER
 17033

DATE	DWG NUMBER
2019 05	SP-1


SCALE
 AS NOTED

DRAWN BY
 SJK

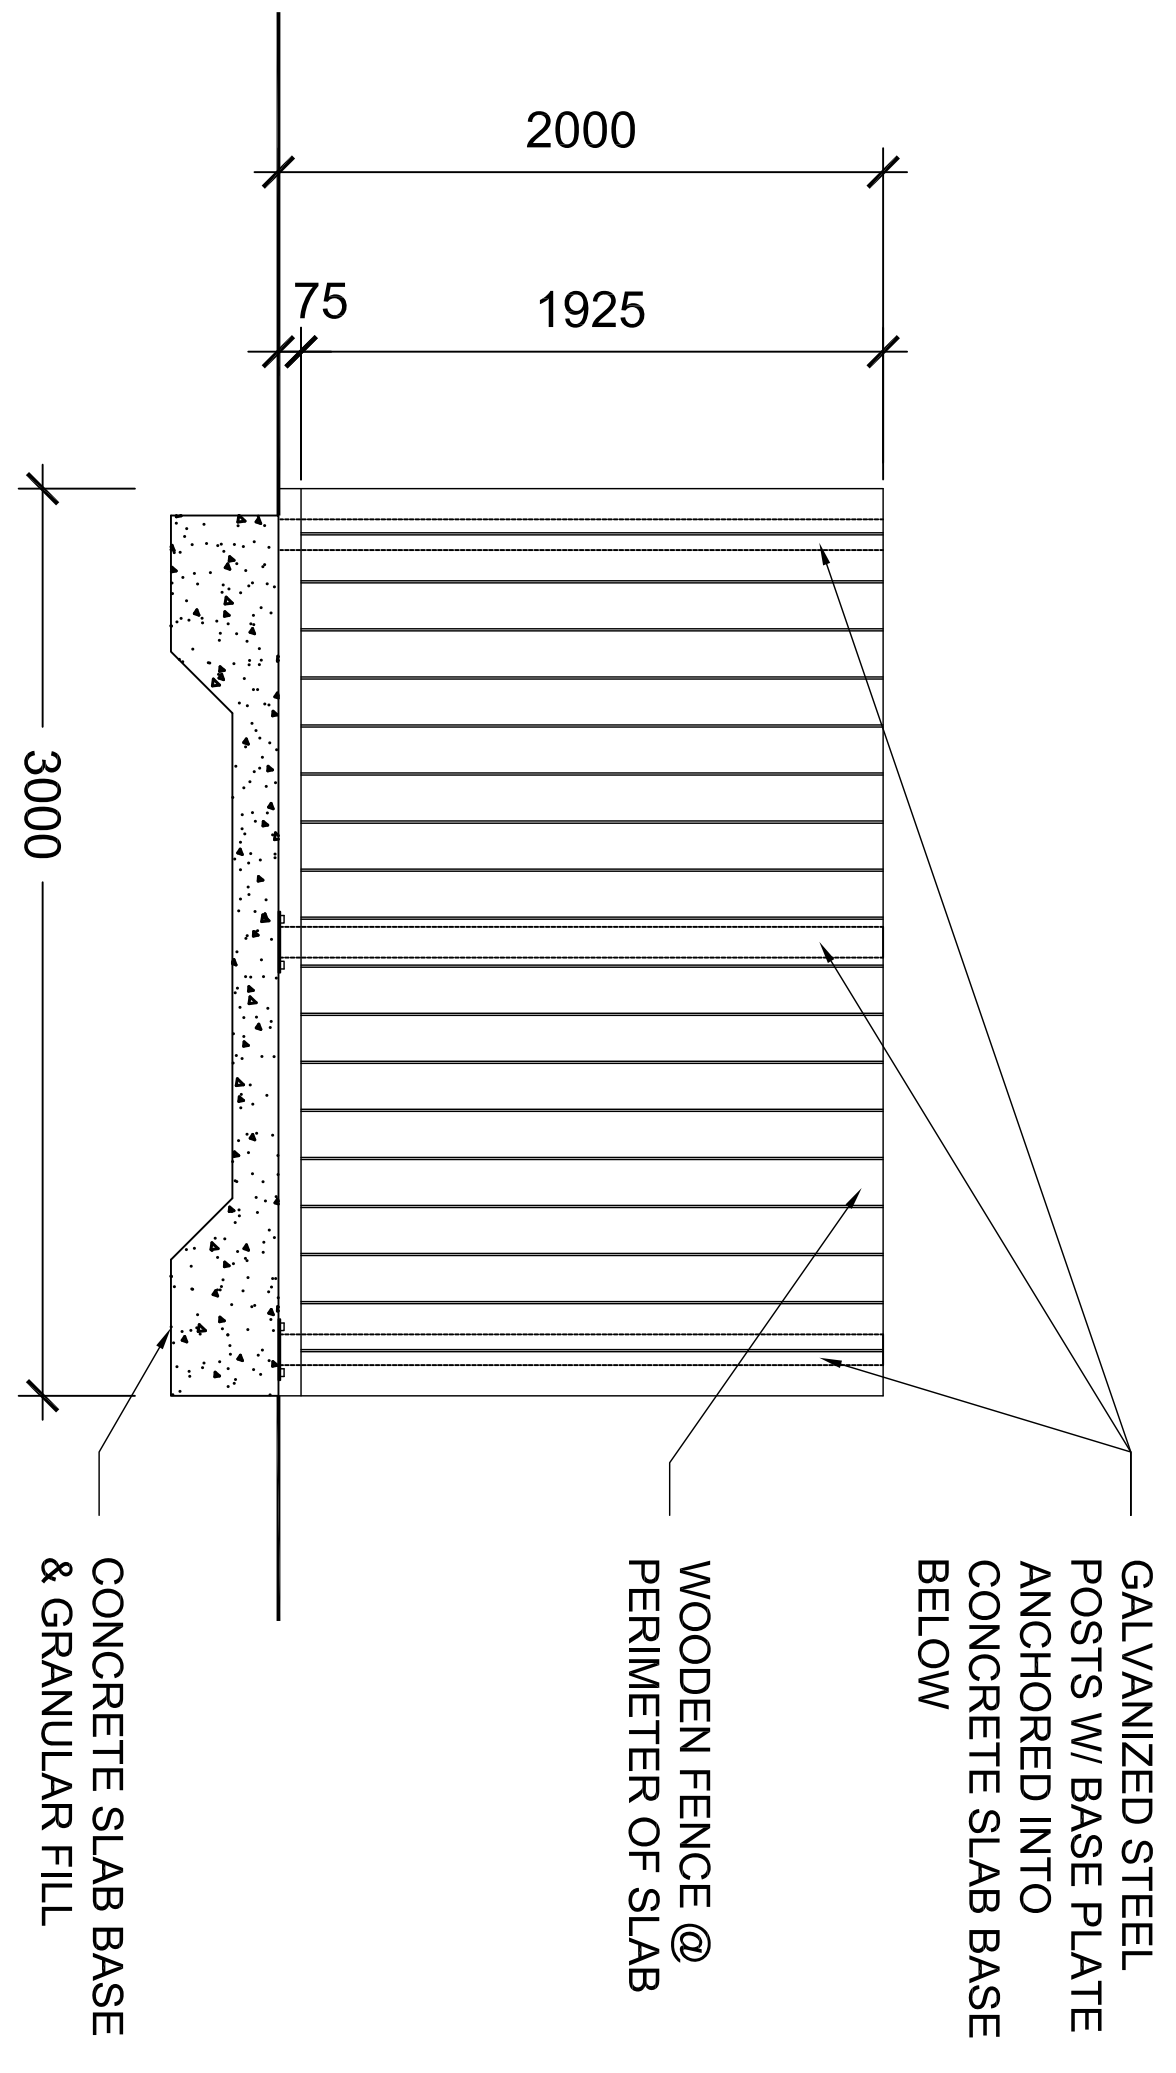


DOORS CW 38mm x 89mm WELDED GALVANIZED STEEL ANGLE W/ WOOD BRACE FRAME OVER 38mm x 89mm PRESSURE TREATED WOOD BUCK. CONCEAL FRAME W/ 19mm x 138mm PRESSURE TREATED WOOD BOARDS C/W 6.9mm GAP BETWEEN BOARDS

2 ELEVATION SCALE 1:25

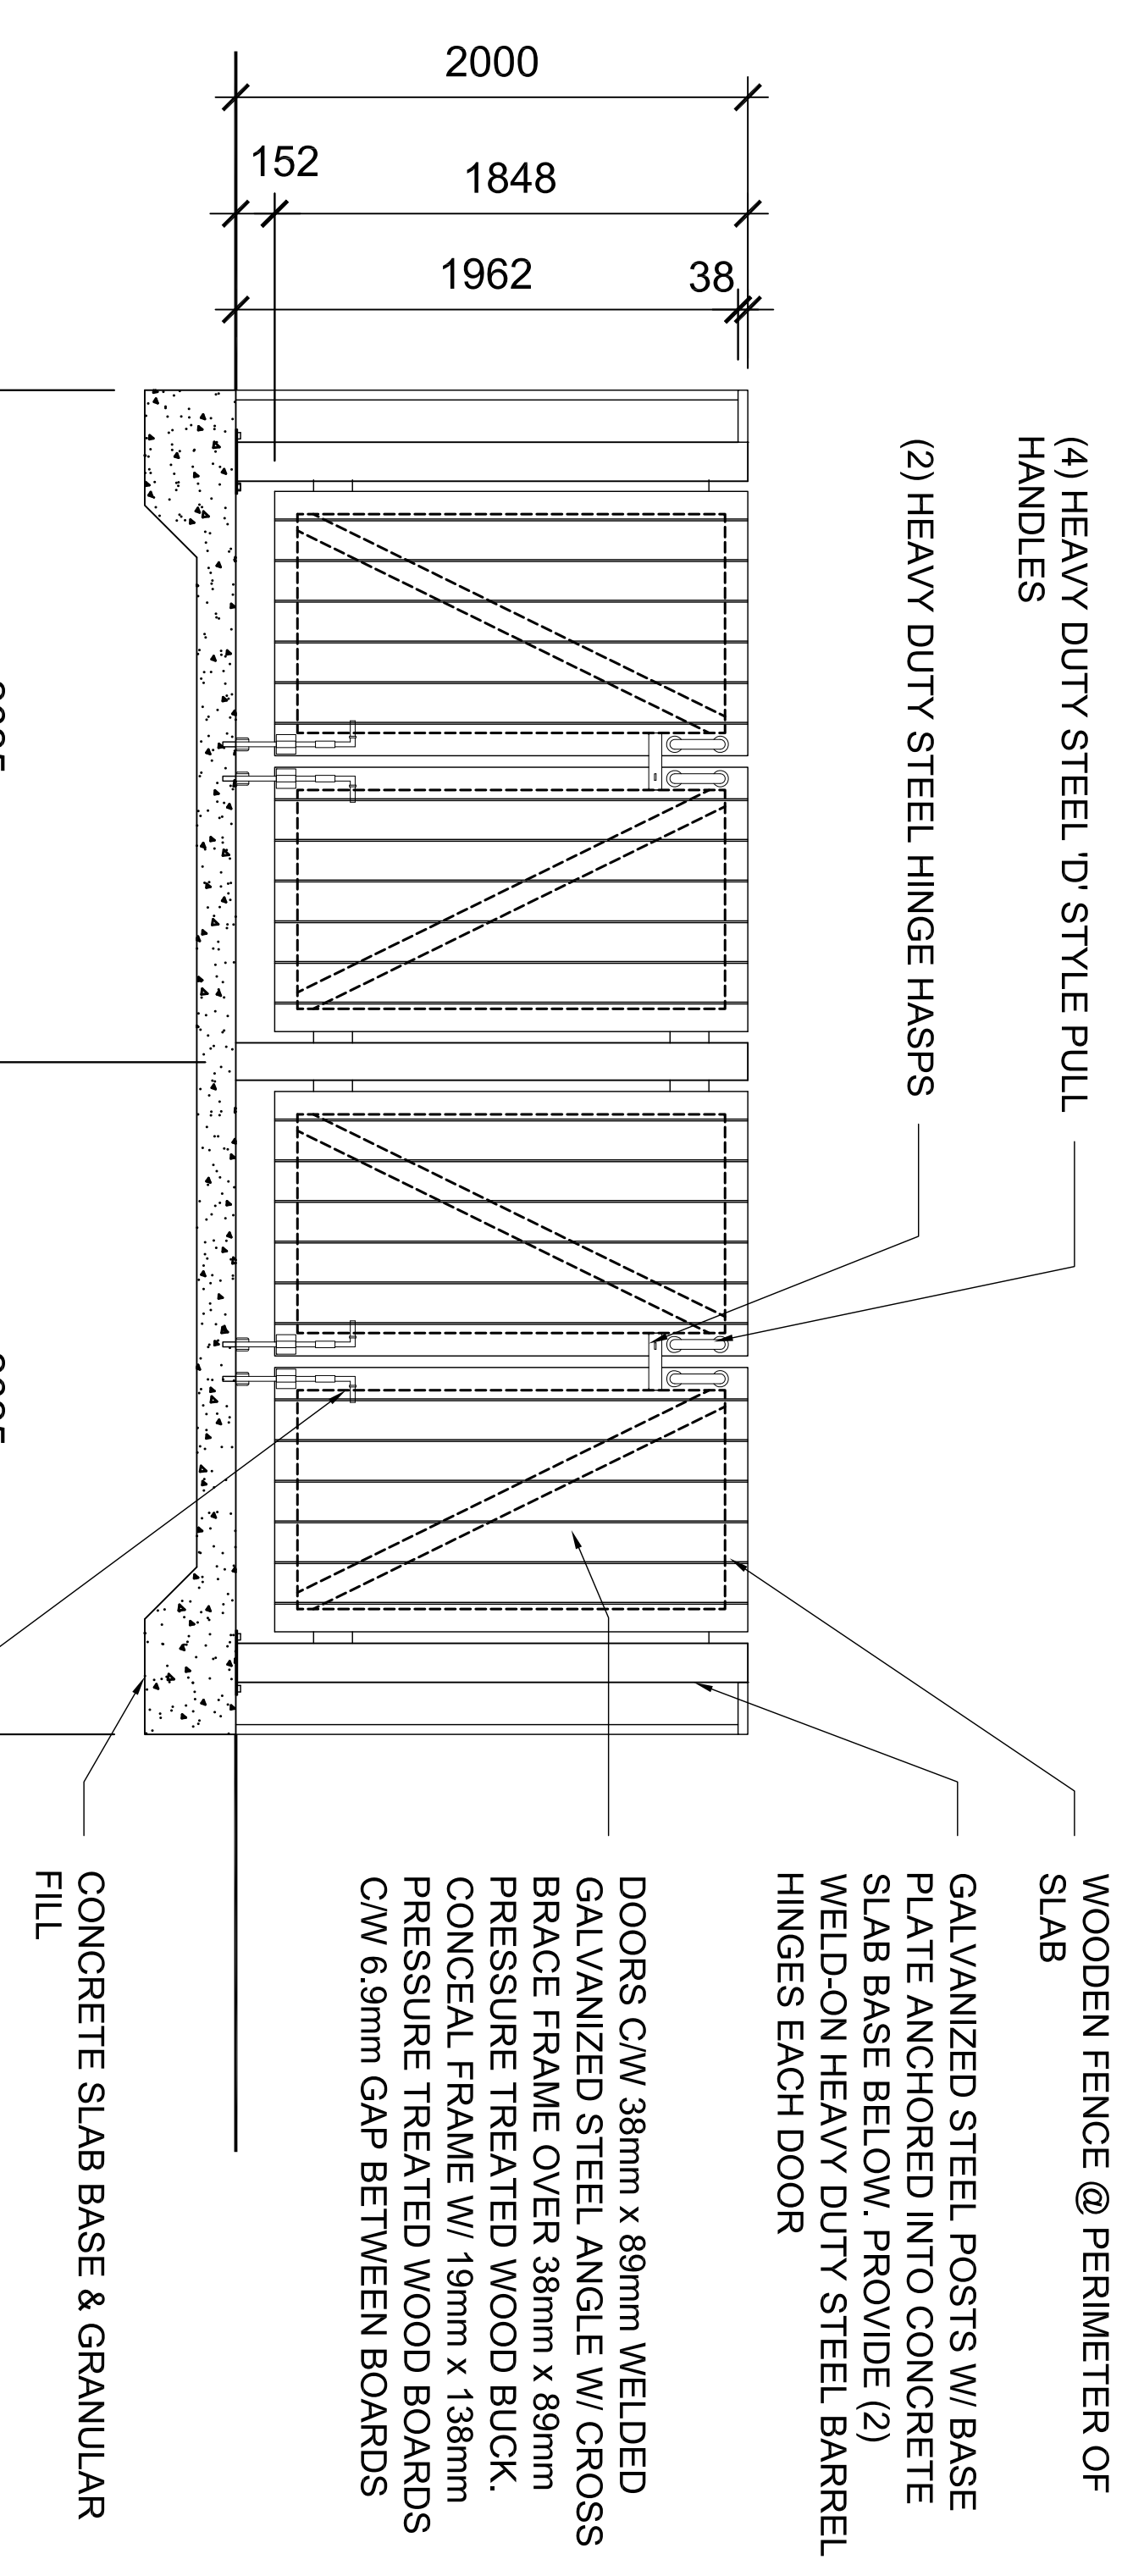


(4) HEAVY DUTY CASTORS C/W 63mm WIDE STEEL SADDLE & 450mm HIGH HEAVY DUTY STEEL CANE BOLTS

3 ELEVATION SCALE 1:25

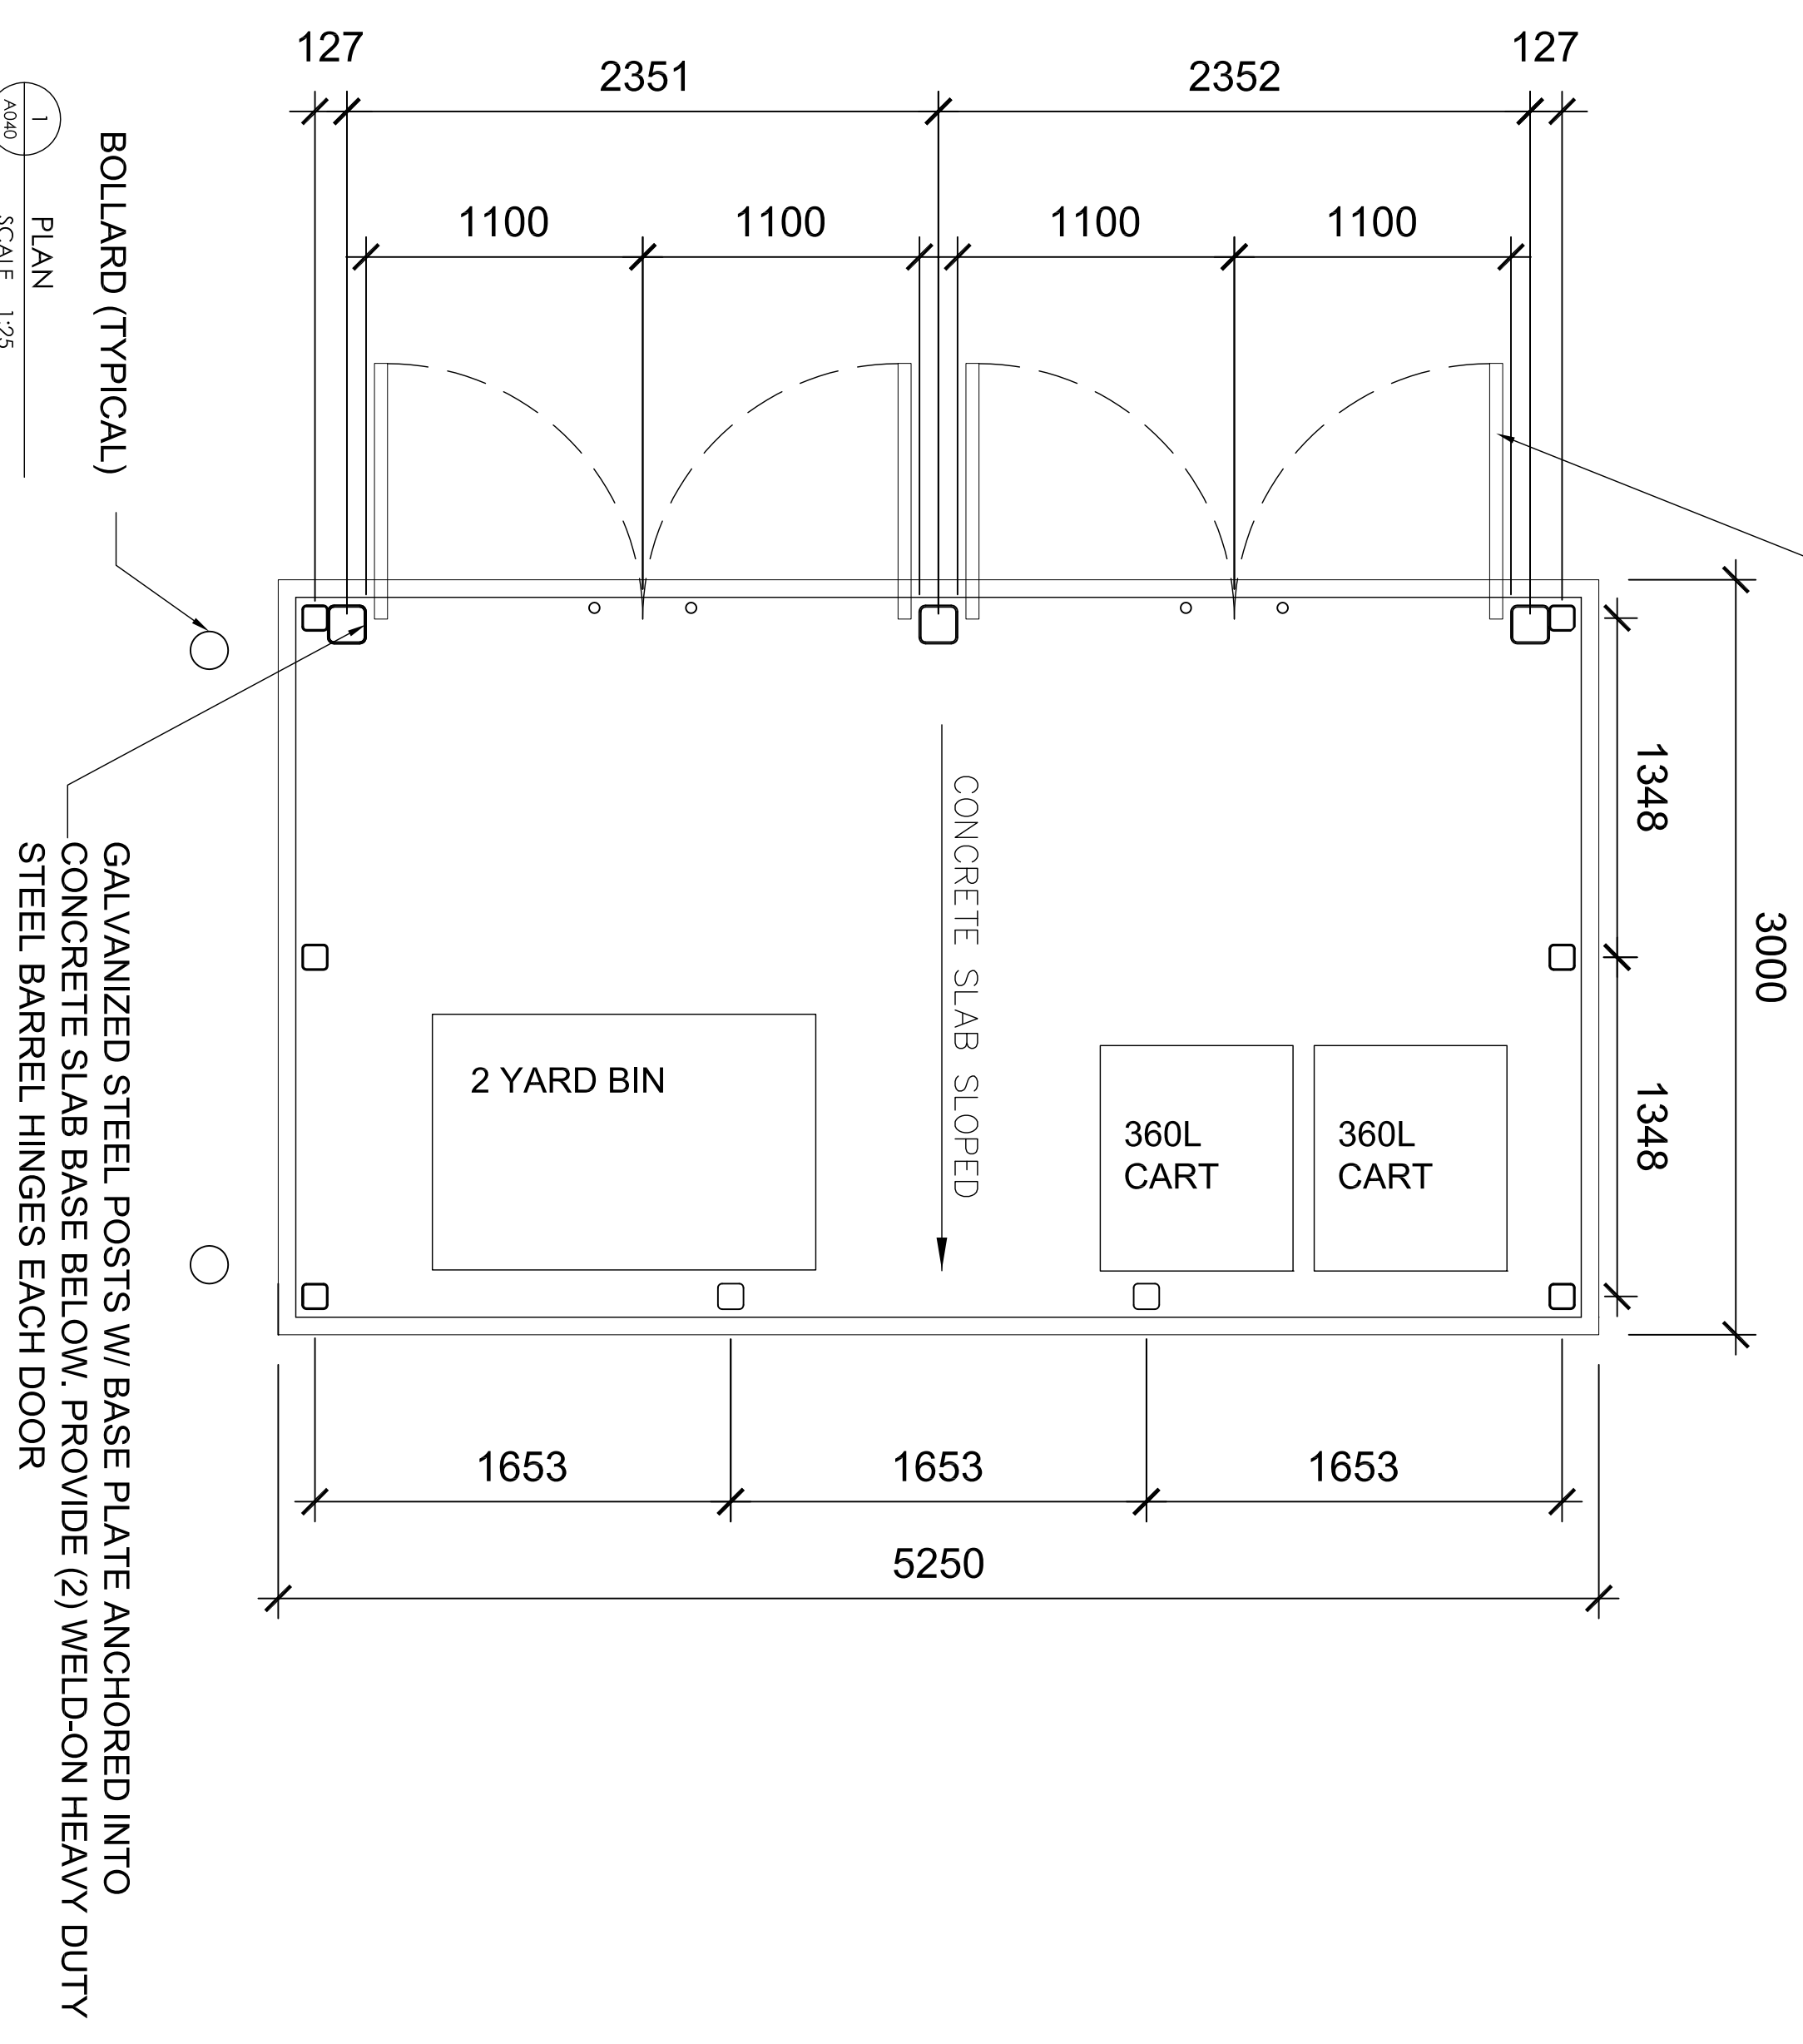

1 PLAN SCALE 1:25

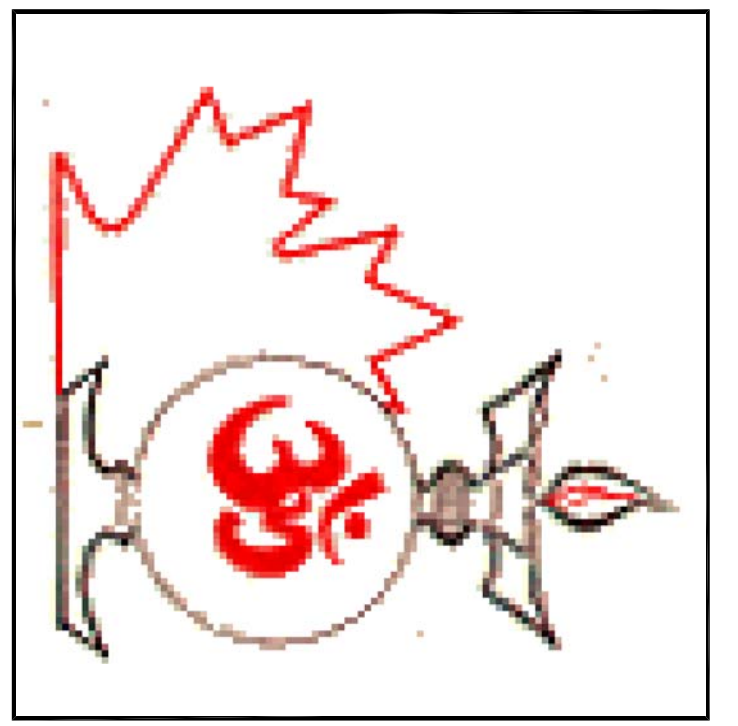

GENERAL NOTES

1. CONSULTING ENGINEERING DIMENSIONS, DIMENSIONS OWNERS BEFORE PROCEEDING WITH WORK.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND MUST BE RETURNED AT THE COMPLETION OF THE WORK. & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
7	ISSUED FOR SITE PLAN	2021SEP14
6	ISSUED FOR SITE PLAN	MAR 16

PROJECT MANAGER
HARISH GUPTA
B.ARCH

PLANNER
jd planning
+ project management
1066 PLANTIE DRIVE
OTTAWA, ON K1V 9T6
T: 613-737-5939
F: 613 812 1726
C: 613-866-2984
E: jessica@jdpn.com

SPONSOR
ANNIS, OSULLIVAN,
VOLLEBERG LTD.
14 Concourse Gate,
P. O. Box 774,
Mississauga, ON L4V 1A7
Tel: (613) 692-8662
Fax: (613) 692-1945
Email: hsepp@volleberg.com

STRUCTURAL CONSULTANT
DESIGN & SYSTEMS
STRUCTURAL & MECHANICAL ENGINEERS
SUITE 251, 2379 HOLLY LAKE
OTTAWA, ON K1V 7P1
Ph: 613 729 9500
Email: hmond@designsystems.ca

MECHANICAL CONSULTANT
Linton B. Linton & Associates Inc.
3332 Conroy Ave.
Ottawa, ON K2H 5A9
Phone: (613) 722,5168
Email: jlp@lba.ca

CIVIL CONSULTANT
LRJ
1400 Wellington Street West
Suite 1100
K1M 1X7
K1M 1X7
613-277-0119
NICK@LRJENGINEERING.COM
KARLA, ON K2K 1X7

MECHANICAL & ELECTRICAL CONSULTANT
CHARELLI KORRELL ENGINEERING LTD.
NICK@CELENG.COM
KARLA, ON K2K 1X7

ARCHITECT
VECTOR DESIGN ARCHITECTS
14 STRATHBURY STREET,
OTTAWA, ONTARIO K2G 5N8
TELEPHONE: (613) 421-9806
EMAIL: vecordc@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P1N 043 26-0011

TITLE OF DRAWING
GARBAGE ENCLOSURE DETAILS


JOB NUMBER
17033


DATE
2019 05

SCALE
1:25

DWG NUMBER
A040

DESIGNED BY
SJK



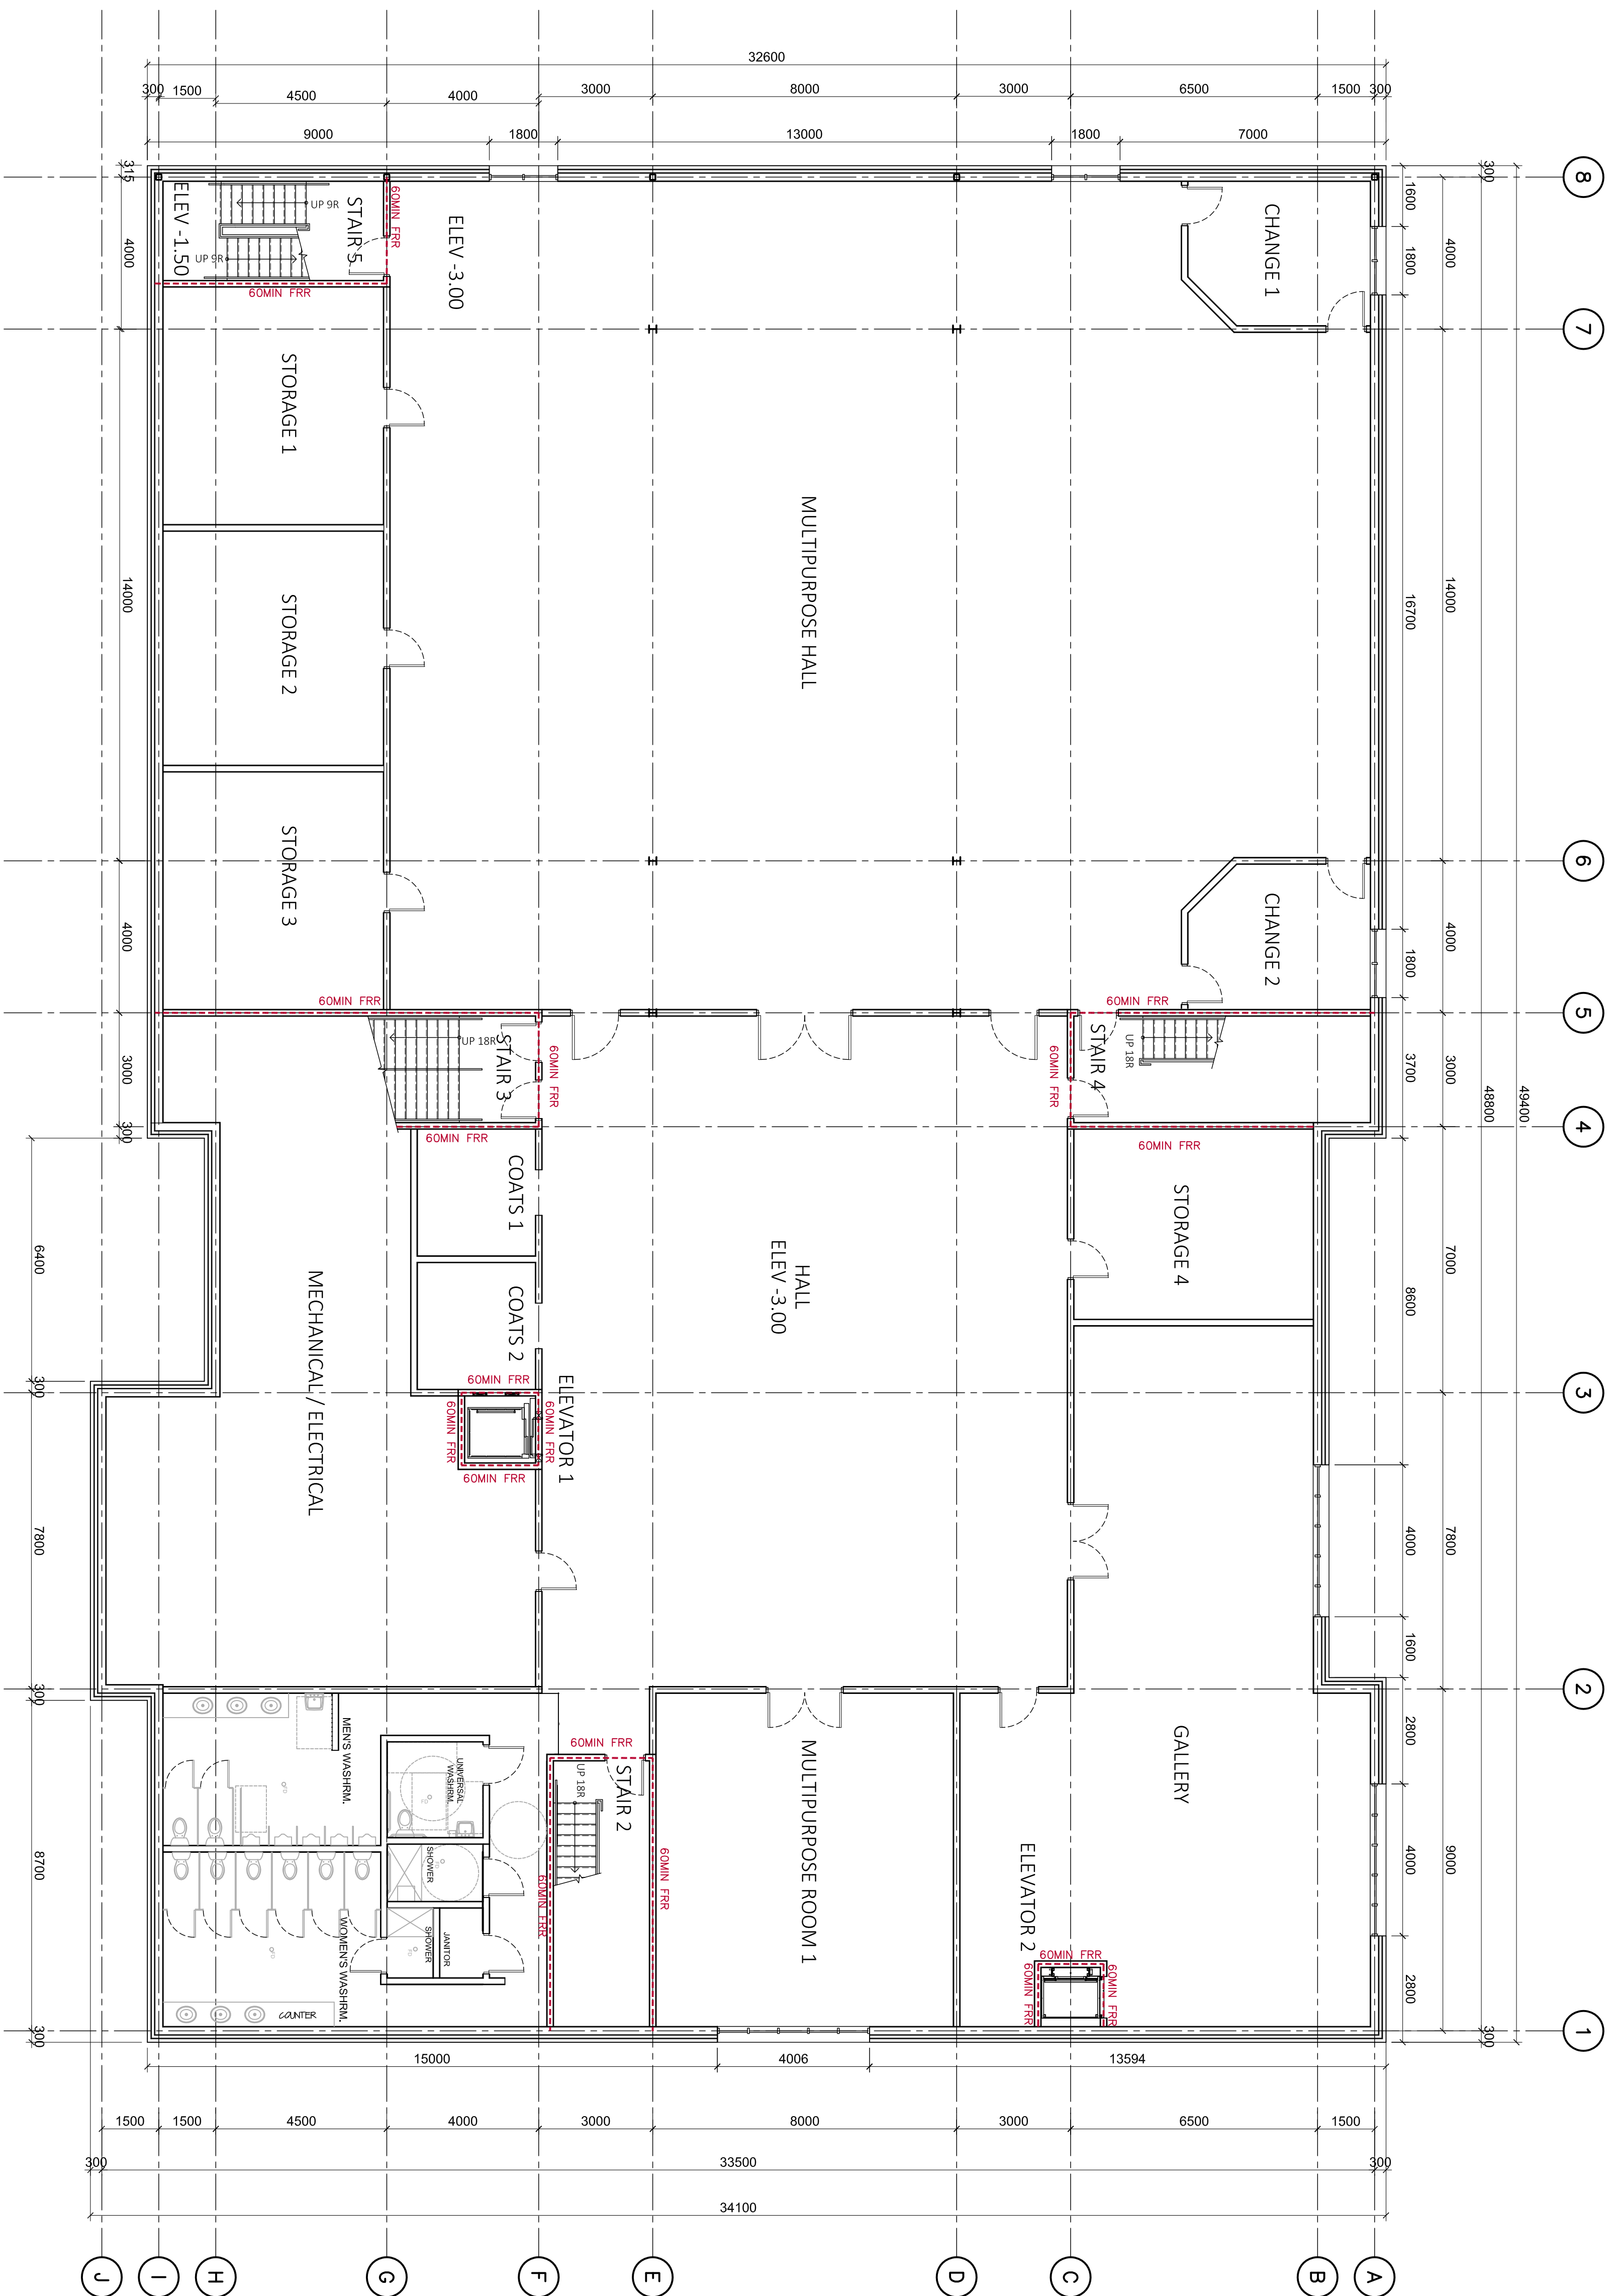

GENERAL NOTES

1. CONTRACTOR MUST VERIFY ALL JOB DIMENSIONS, DIMENSIONS, OWNERS BEFORE PROCEEDING WITH WORK.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND MUST BE RETURNED AT THE COMPLETION OF THE WORK. & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
9	ISSUED FOR SITE PLAN	2022/09/25
8	ISSUED FOR SITE PLAN	2021/10/03
7	ISSUED FOR SITE PLAN	2021/07/22
6	ISSUED FOR SITE PLAN	MAR 16

PROJECT MANAGER
HARSH GUPTA
B. ARCH

PLANNER
jd planning
+ project management
1066 PLANT DRIVE
OTTAWA, ON K1V 9E6
T: 613-737-5939
F: 613 812 1726
C: 613-866-2984
E: jessica@jdpn.ca

SPONSOR
ANNIS, OSULLIVAN,
VOLLEBERG LTD.
14 Concourse Gate,
P. O. Box 774,
Mississauga, ON L4V 1A7
Tel: (613) 692-8662
Fax: (613) 727-1079
Email: hapepp@annos.com

STRUCTURAL CONSULTANT
DESIGN & SYSTEMS
STRUCTURAL & MECHANICAL ENGINEERS
SUITE 251, 2279 HOLLY LAKE,
OTTAWA, ON K1V 7P1
Ph: 613 729 9500
Email: hannah@designsystems.ca

Mechanical & Electrical CONSULTANT
Larios B. Larios & Associates Inc.
3332 Conroy Ave. S48
OTTAWA, ON K2H 5A9
Phone: (613) 722-5168
Email: jbl@larios.ca

MECHANICAL & ELECTRICAL CONSULTANT
CHIARELLI KORBEL
ENGINEERING LTD.
NICKOCH@CORBEL.COM
613-277-0119
1100
KANSAS, ON K2K 1X7

ARCHITECT
VECTOR DESIGN ARCHITECTS
14 STRATHBURY STREET,
OTTAWA, ONTARIO K2G 5N8
TELEPHONE: (613) 421-9806
EMAIL: vecordc@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P I N 0 4 3 2 6 - 0 0 1 1


TITLE OF DRAWING
FLOOR PLAN -
LEVEL 0


JOB NUMBER
17033

DATE
2019 05

SCALE
AS SHOWN BY SJK


DWG NUMBER
A100



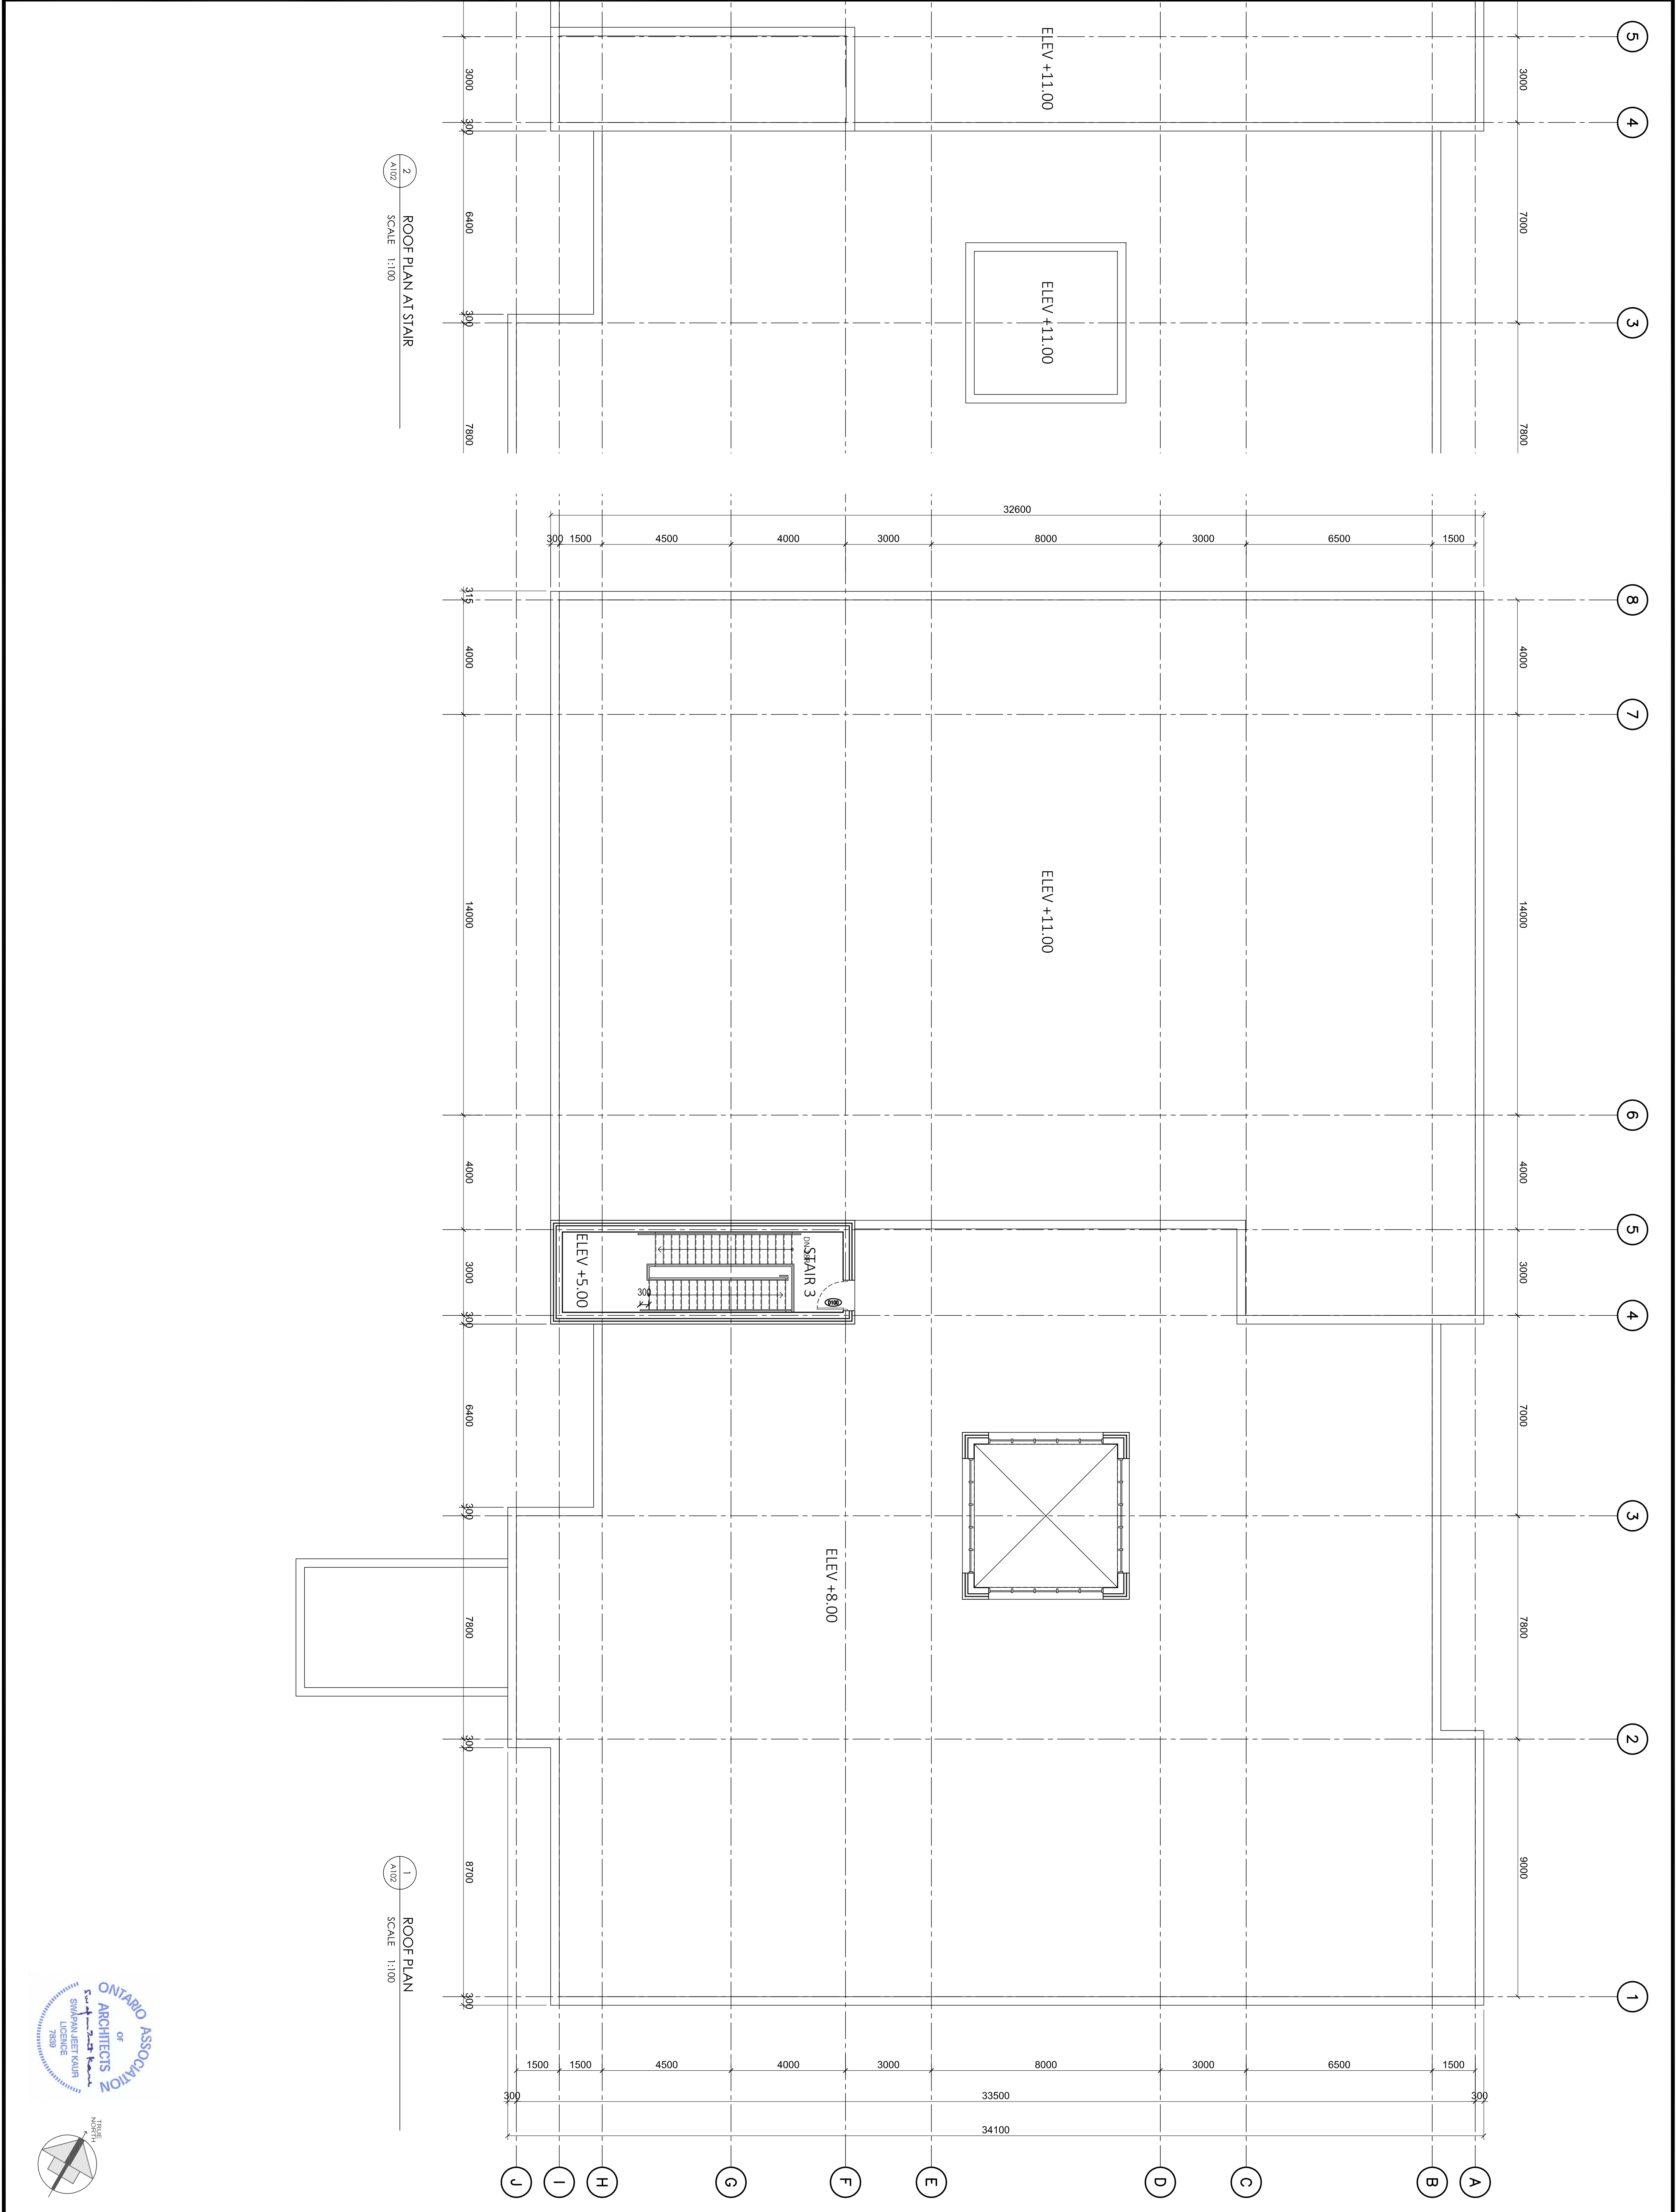

2 ROOF PLAN AT STAIR
SCALE 1:100

1 ROOF PLAN
SCALE 1:100

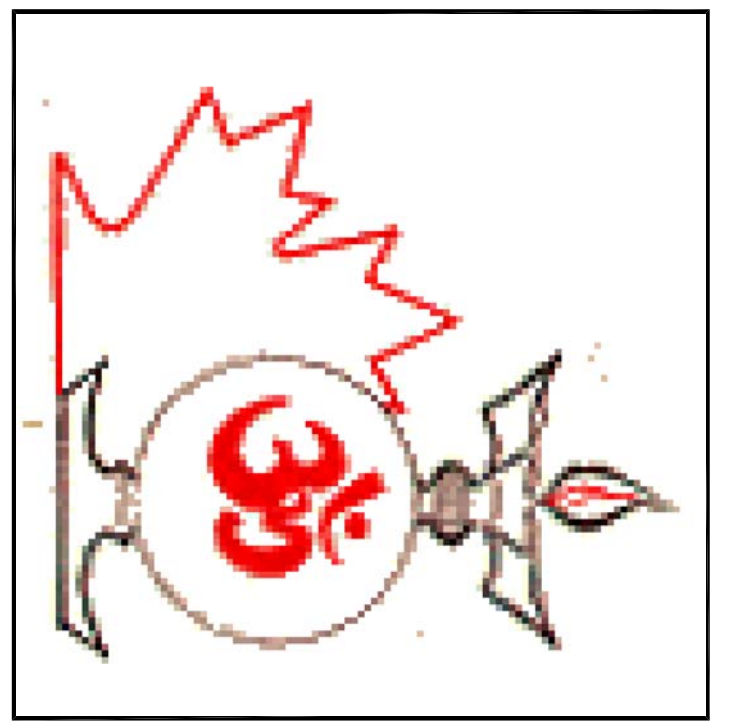

GENERAL NOTES

1. CONSULTING ENGINEER, CONTRACTOR AND DIMENSIONS, DRAWINGS OWNERS BEFORE PROCEEDING WITH WORK.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND MUST BE RETURNED AT THE COMPLETION OF THE WORK. & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
7	ISSUED FOR SITE PLAN	2021SEP14
6	ISSUED FOR SITE PLAN	MAR 16

PROJECT MANAGER
HARISH GUPTA
B.ARCH

PLANNER
jd planning
+ project management
41 Rideau Ferry Road,
Lombury ON K0G 1L0
T: 613-737-5939
F: 613-812-1726
E: jessica@jdpnrc.co

SPONSOR
ANNIS, OSULLIVAN,
VOLLEBECK LTD.
14 Concourse Gate,
P. O. Box 774,
Merridale, ON K4M 1A7
Tel (613) 692-8662
Fax (613) 692-1945
Email: haper@annid.com

TRANSPORTATION ENGINEER
D. J. Halpeny &
Associates Ltd.
P. O. Box 774,
Merridale, ON K4M 1A7
Tel (613) 692-8662
Fax (613) 692-1945
Email: dhalpeny@annid.com

STRUCTURAL CONSULTANT
DESIGN & SYSTEMS
ASSOCIATES INC.
SUITE 251, 2279 HOLLY LAKE,
OTTAWA, ON K1V 7P1
Ph: 613 729 9500
Email: hannah@designsystems.ca

INSURANCE CONSULTANT
Lionel B. Lemox &
Associates Inc.
3332 Conroy Ave,
Ottawa, ON K2H 5A9
Phone: (613) 722,5168
Email: jbl@lba.ca

CIVIL CONSULTANT
LRJ
DESIGN ENGINEERING INC.
5400 Woodbine Ave. Unit 1100
Markham, ON L3R 9X3
Tel: 905-477-0119
Fax: 905-477-0119
www.lroj.com

MECHANICAL & ELECTRICAL CONSULTANT
CHARELLI KORBEL
ENGINEERING LTD.
NICKEL TERRACE
KAMIA, ON K2K 1X7

ARCHITECT
VECTOR DESIGN ARCHITECTS
14 STRATHBURY STREET,
OTTAWA, ONTARIO K2G 5N8
TELEPHONE: (613) 421-9806
EMAIL: vecordesign@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P1N 043 26-0011


TITLE OF DRAWING
FLOOR PLAN -
ROOF

JOB NUMBER
17033

DATE
2019 05

SCALE
AS SHOWN BY SJK

DWG NUMBER
A102





GENERAL NOTES

1. CONTRACTOR MUST VERIFY ALL JOB DIMENSIONS, DRAWINGS, DETAILS, SPECIFICATIONS & REPORT ANY DISCREPANCIES TO OWNERS BEFORE PROCEEDING WITH WORK.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE & THE PROPERTY OF THE ARCHITECTS WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK, & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
7	ISSUED FOR SITE PLAN	2021SEPT14
6	ISSUED FOR SITE PLAN	MAR 16

<p>PROJECT MANAGER HARISH GUPTA B. ARCH</p> <p>1066 PLANTE DRIVE, OTTAWA ON K1V 9E6 T: 613-737-5939 C: 613-866-2984</p>	<p>PLANNER jd planning + project management</p> <p>41 Rideau Ferry Road, Lombardy ON K0G 1L0 t 613 812 1726 e jessica@jdplan.ca</p>
--	--

<p>SURVEYOR ANNIS, O'SULLIVAN, VOLLEBEKK LTD. 14 Concourse Gate, Suite 500 Nepean, ON K2E 7S6 Phone: (613) 727-0850 Fax: (613) 727-1079 Email: Nepeon@aovltd.com</p>	<p>TRANSPORTATION ENGINEER D. J. Halpenny & Associates Ltd. P. O. Box 774, Manotick, ON K4M 1A7 Tel (613) 692-8662 Fax (613) 692-1945 david@djhalpenny.com</p>
---	--

<p>STRUCTURAL CONSULTANT DESIGN & SYSTEMS STRUCTURAL & WELDING ENGINEERS SUITE 251, 2378 HOLLY LANE, OTTAWA, ON K1V 7P1 Ph: 613 739 9500 email: khoral@designsystems.ca</p>	<p>LANDSCAPE CONSULTANT James B. Lennox & Associates Inc. 3332 Corling Ave. Ottawa, ON K2H 5A8 Phone: (613) 722.5168 Email: jj@jba.ca</p>
---	--

<p>CIVIL CONSULTANT LRJ ENGINEERING & DESIGN 5430 Carleton Road Ottawa, ON K1J 0J2 www.lrc.ca (613) 842-3434</p>	<p>MECHANICAL & ELECTRICAL CONSULTANT CHIARELLI KORBEL ENGINEERING LTD. DICKCKELTD@GMAIL.COM, 613-986-4643 NICKCKELTD@GMAIL.COM, 613-277-0119 1857 DUNDAS RD., KANATA, ON K2K 1X7</p>
--	--




ARCHITECT
VECTOR DESIGN ARCHITECTS
 14 STRATHBURY STREET,
 OTTAWA, ONTARIO K2G 5N8
 TELEPHONE: (613) 421-9806
 EMAIL: vecarch@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P I N 0 4 3 2 6 - 0 0 1 1

TITLE OF DRAWING
BUILDING SECTION

JOB NUMBER
 17033

DATE 2019 05	DWG NUMBER
SCALE	A200
DRAWN BY SJK	

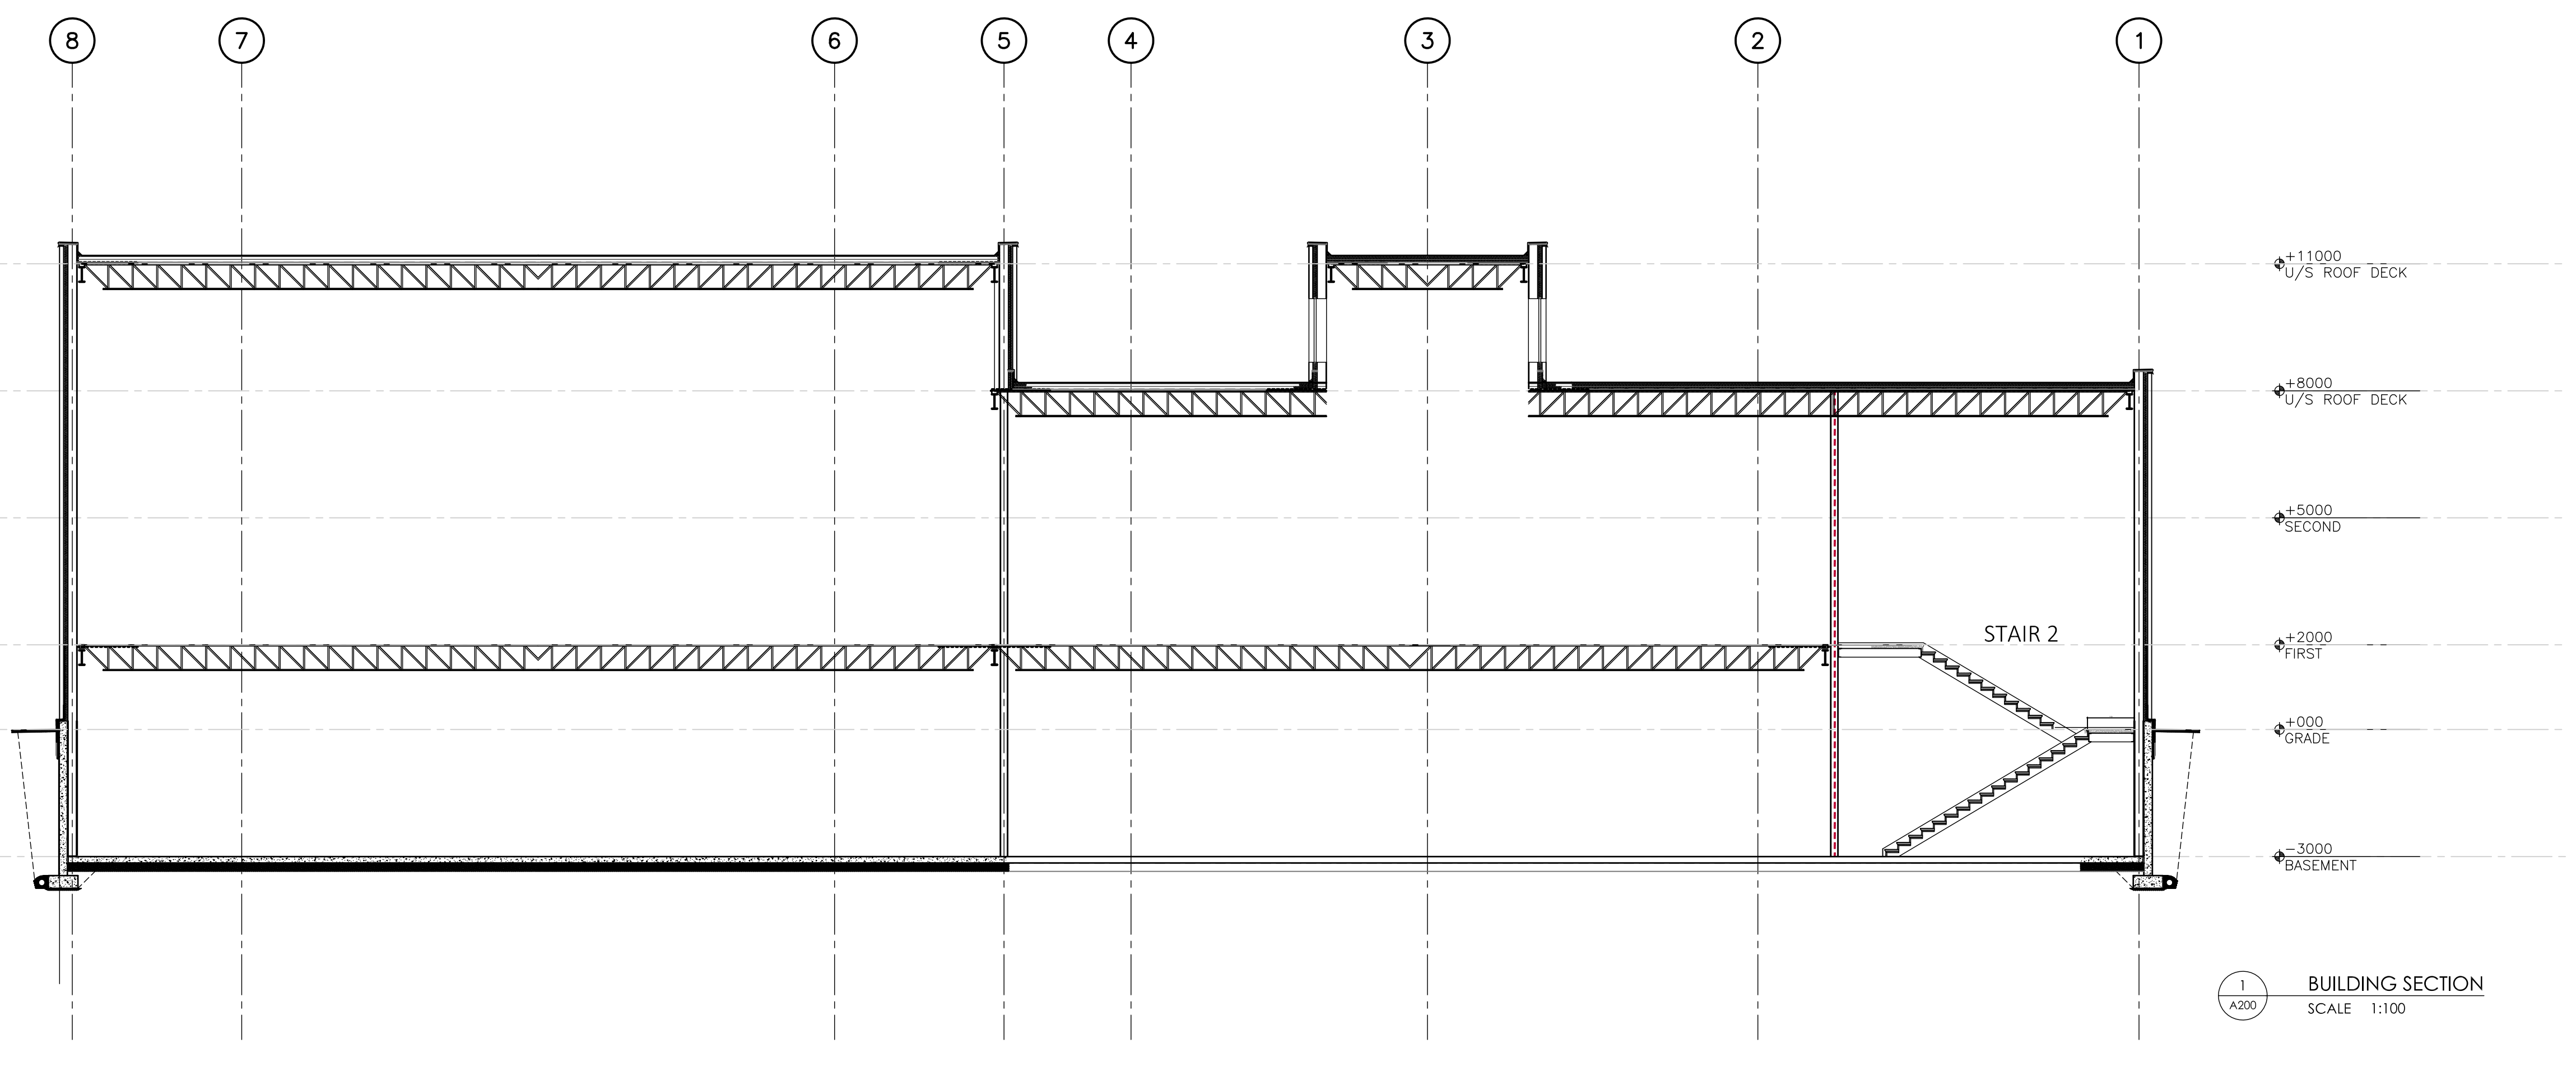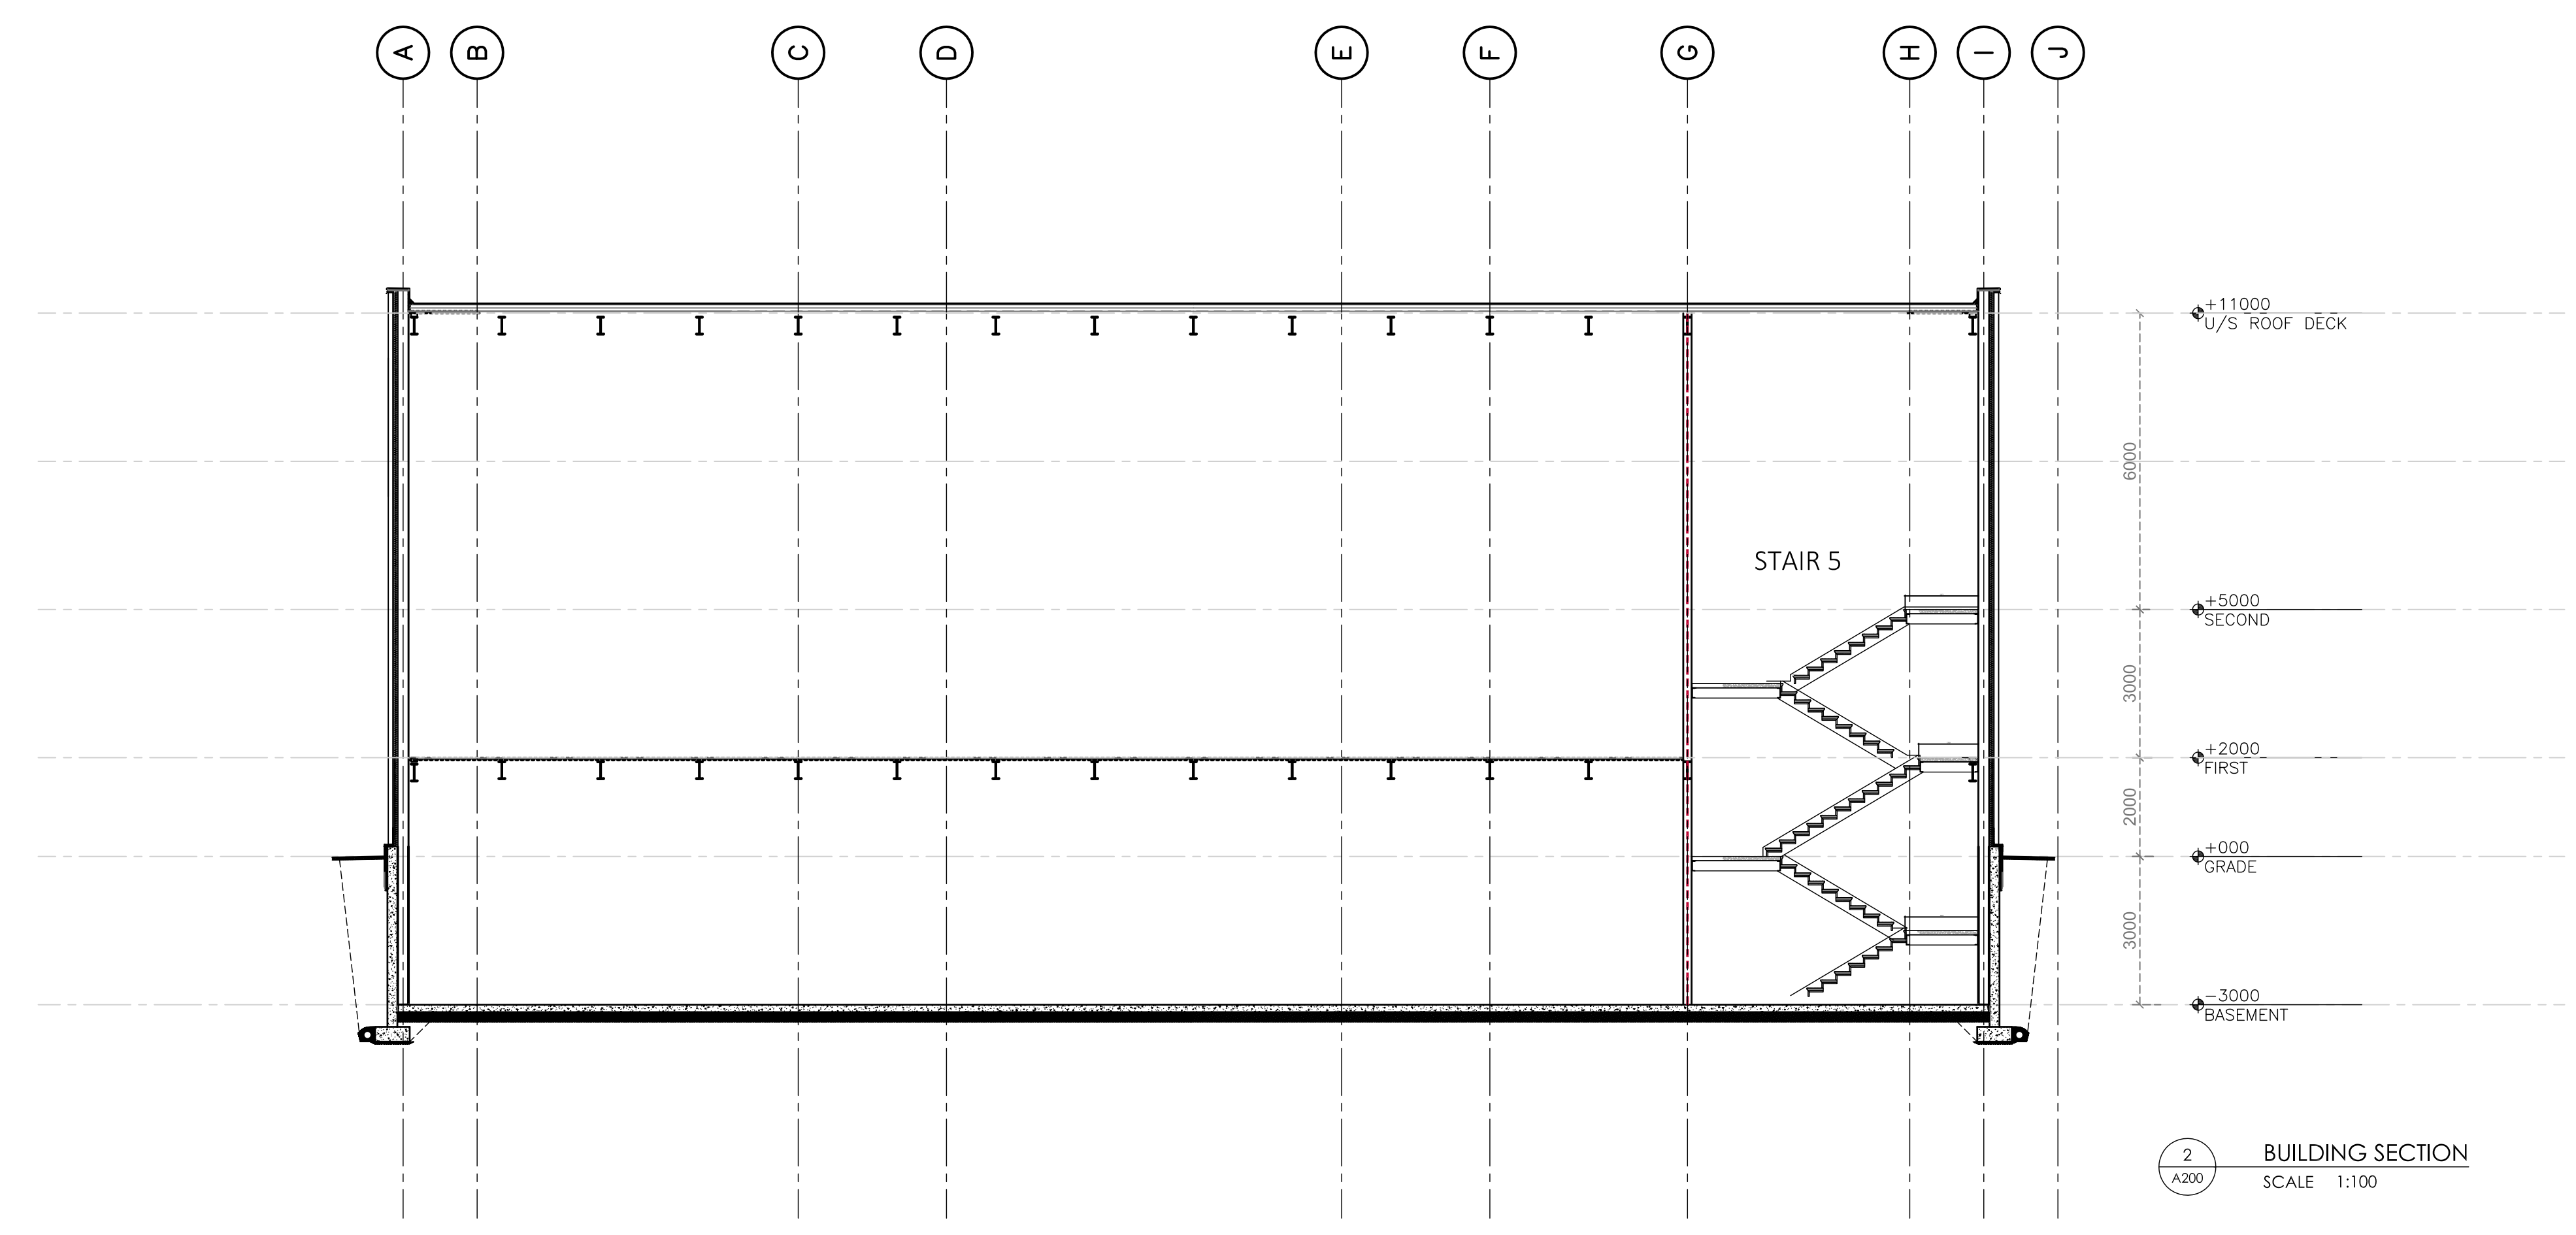



GENERAL NOTES

1. CONTRACTOR MUST VERIFY ALL JOB DIMENSIONS, DRAWINGS, DETAILS, SPECIFICATIONS & REPORT ANY DISCREPANCIES TO OWNERS BEFORE PROCEEDING WITH WORK.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE & THE PROPERTY OF THE ARCHITECTS WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK, & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
7	ISSUED FOR SITE PLAN	2021SEPT14
6	ISSUED FOR SITE PLAN	MAR 16

<p>PROJECT MANAGER HARISH GUPTA B. ARCH</p> <p>1066 PLANTE DRIVE, OTTAWA ON K1V 9E6 T: 613-737-5939 C: 613-866-2984</p>	<p>PLANNER jd planning + project management</p> <p>41 Rideau Ferry Road, Lombardy ON K0G 1L0 t 613 812 1726 e jessica@jdplan.ca</p>
--	--

<p>SURVEYOR ANNIS, O'SULLIVAN, VOLLEBEKK LTD. 14 Concourse Gate, Suite 500 Nepean, ON K2E 7S6 Phone: (613) 727-0850 Fax: (613) 727-1079 Email: Nepean@aovltd.com</p>	<p>TRANSPORTATION ENGINEER D. J. Halpenny & Associates Ltd. P. O. Box 774, Manotick, ON K4M 1A7 Tel (613) 692-8662 Fax (613) 692-1945 david@djhalpenny.com</p>
---	--

<p>STRUCTURAL CONSULTANT DESIGN & SYSTEMS STRUCTURAL & WELDING ENGINEERS SUITE 251, 2378 HOLLY LANE, OTTAWA, ON K1V 7P1 Ph: 613 739 9500 email: khoral@designsystems.ca</p>	<p>LANDSCAPE CONSULTANT James B. Lennox & Associates Inc. 3332 Corling Ave, Ottawa, ON K2H 5A8 Phone: (613) 722.5168 Email: jj@jbia.ca</p>
---	---

<p>CIVIL CONSULTANT LRJ ENGINEERING CONSULTANTS 5430 Connaught Road Ottawa, ON K1J 9G2 www.lrc.ca (613) 842-3434</p>	<p>MECHANICAL & ELECTRICAL CONSULTANT CHIARELLI KORBEL ENGINEERING LTD. DICKKELTD@GMAIL.COM, 613-286-4643 NICKKELTD@GMAIL.COM, 613-277-0119 1857 DUNROBIN RD., KANATA, ON K2K 1X7</p>
--	--


ARCHITECT
VECTOR DESIGN ARCHITECTS
 14 STRATHBURY STREET,
 OTTAWA, ONTARIO K2G 5N8
 TELEPHONE: (613) 421-9806
 EMAIL: vecarch@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P I N 0 4 3 2 6 - 0 0 1 1


TITLE OF DRAWING
BUILDING SECTION

JOB NUMBER
 17033


DATE 2019 05	DWG NUMBER A201
SCALE	
DRAWN BY SJK	

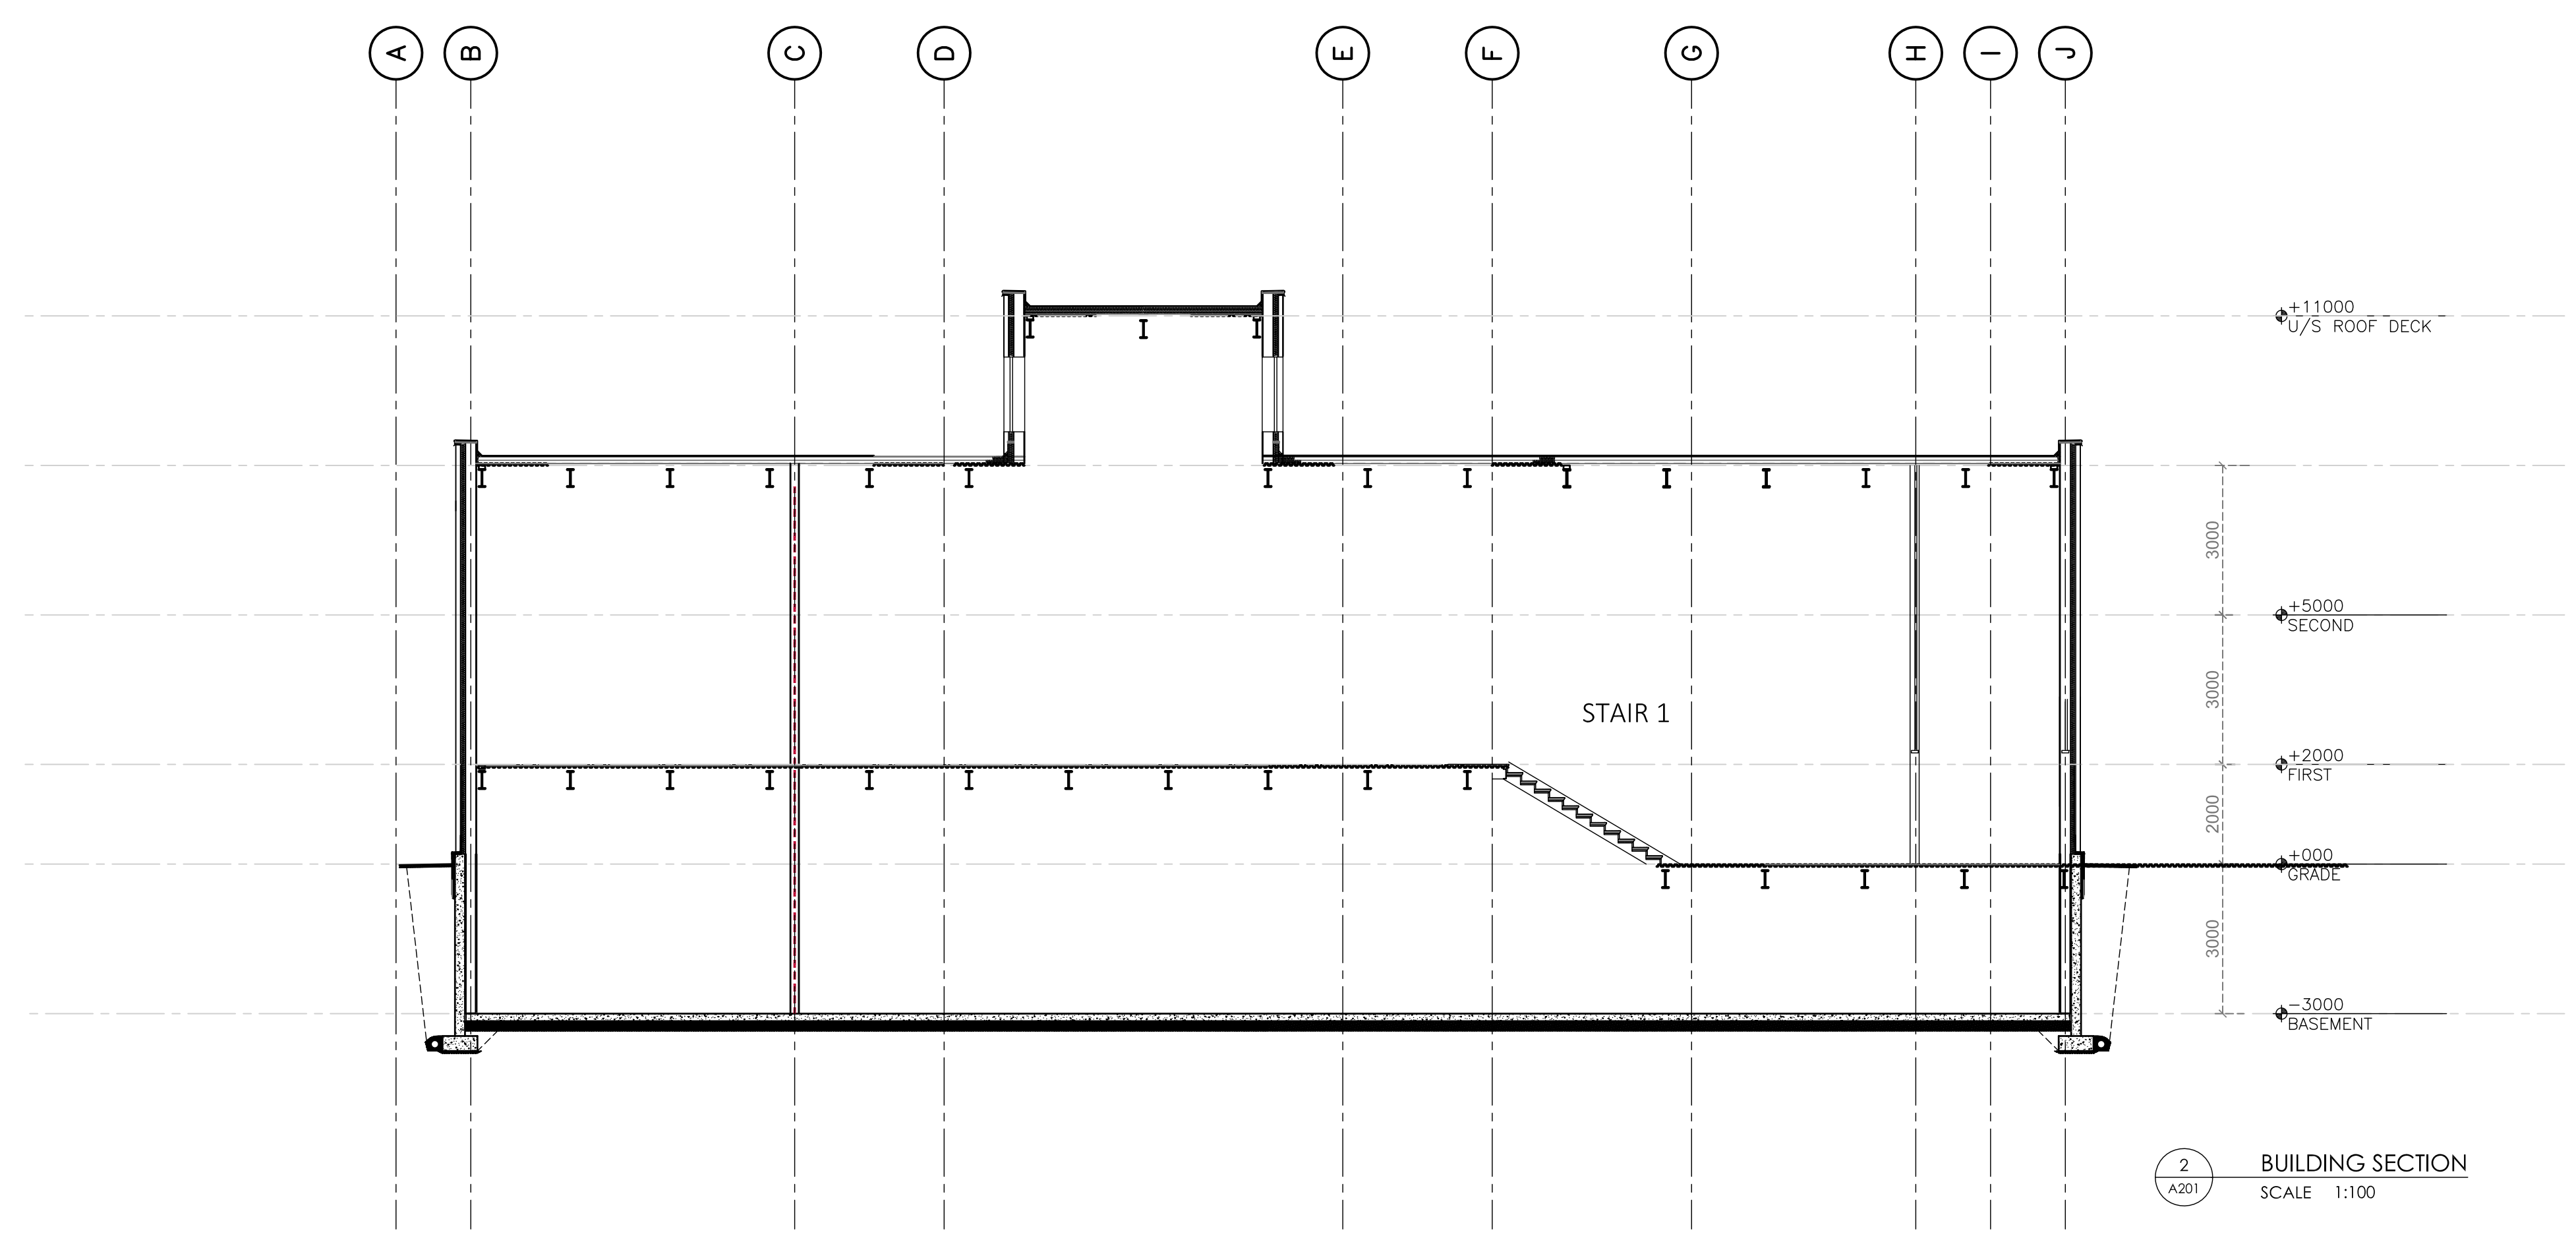


2
A201
BUILDING SECTION
SCALE 1:100

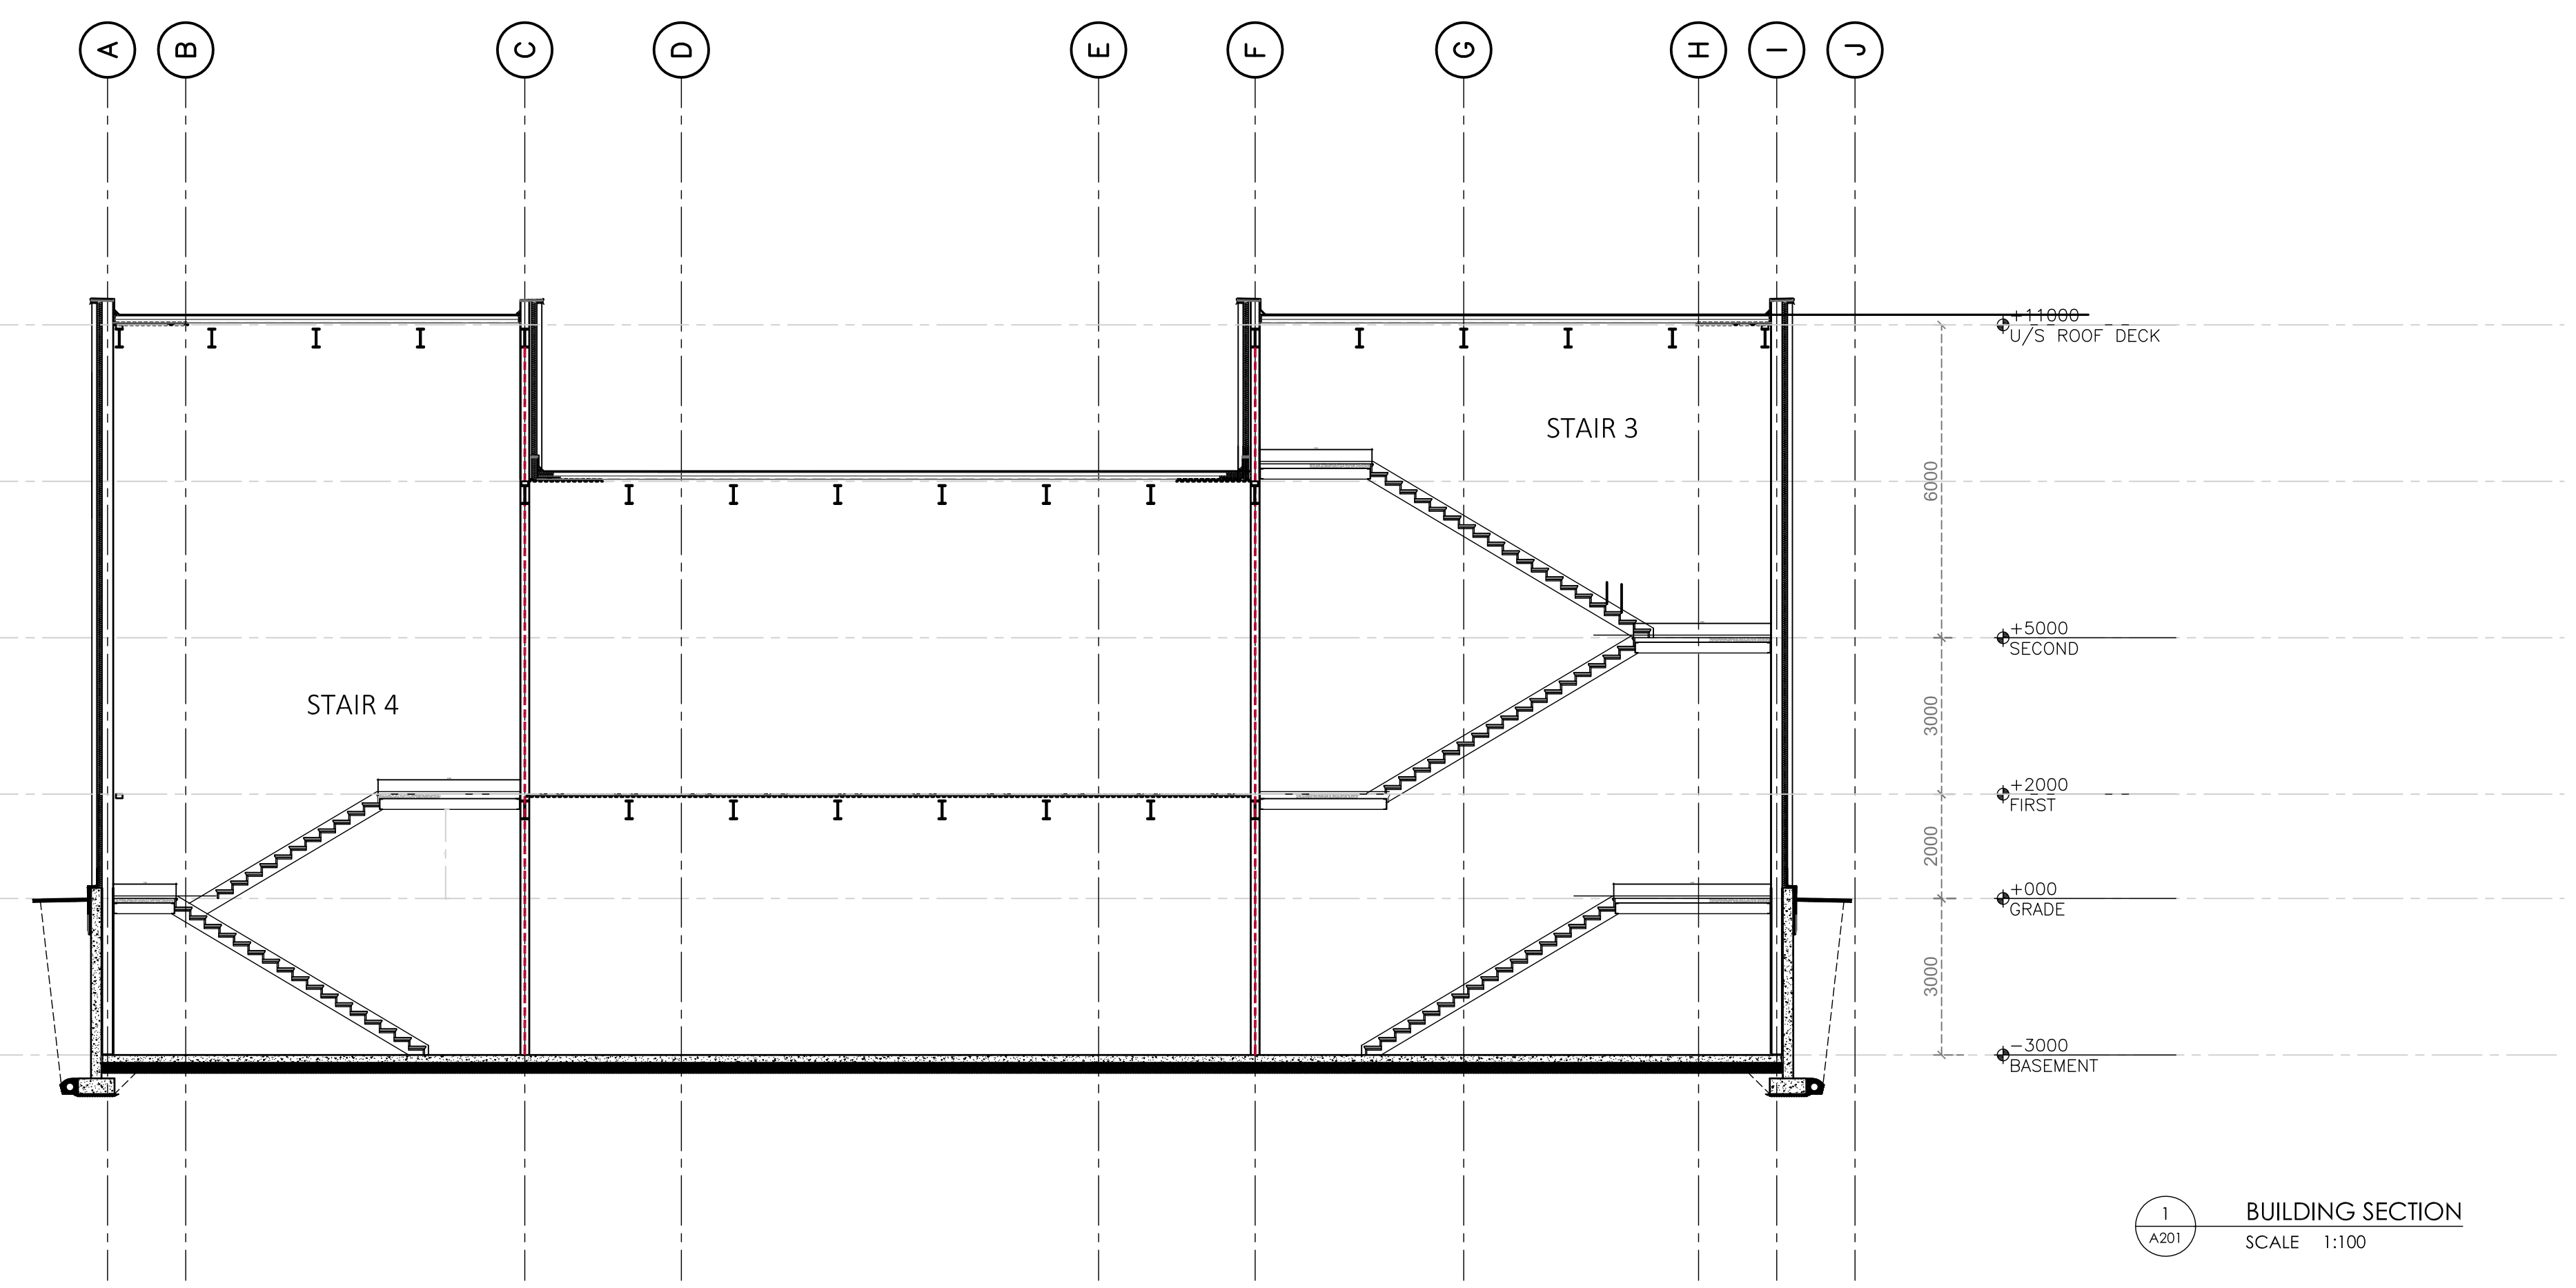


1
A201
BUILDING SECTION
SCALE 1:100




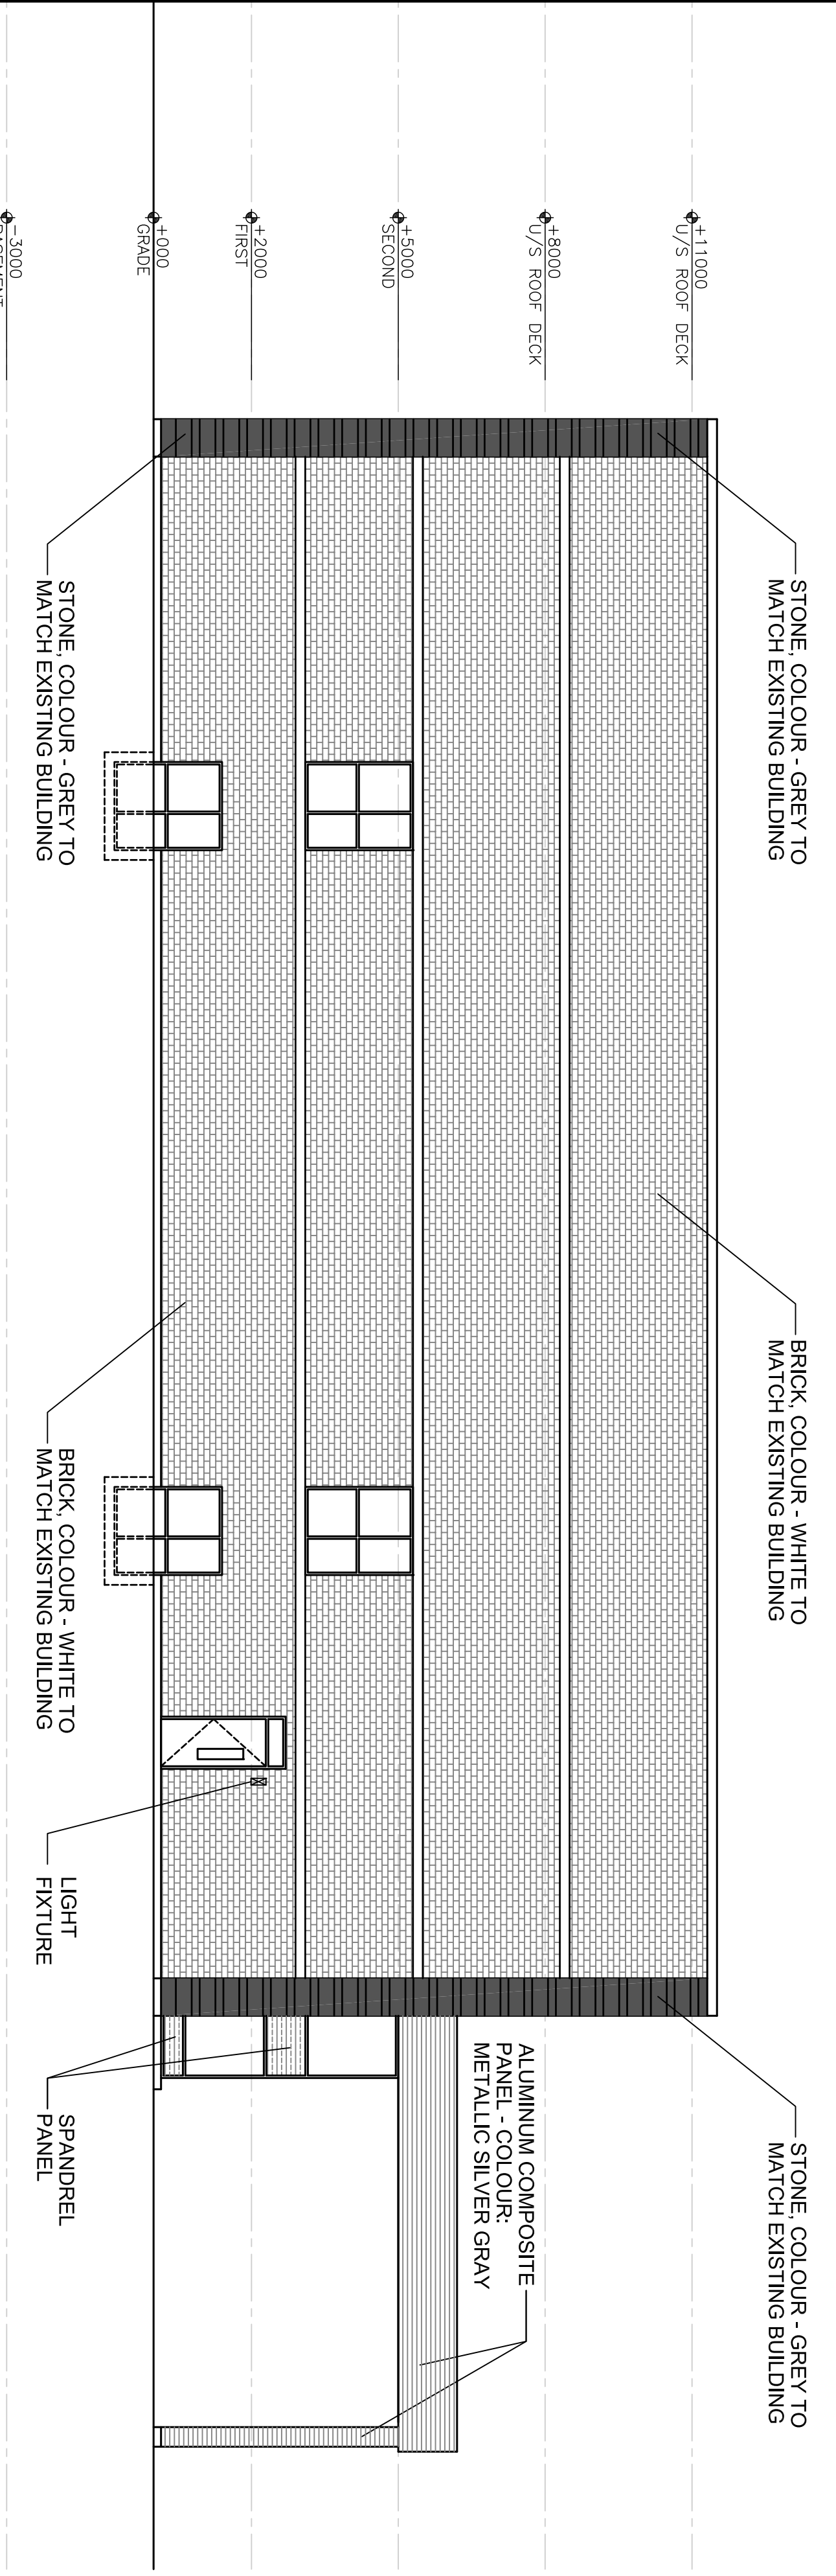

2 NORTH ELEVATION
SCALE 1:100

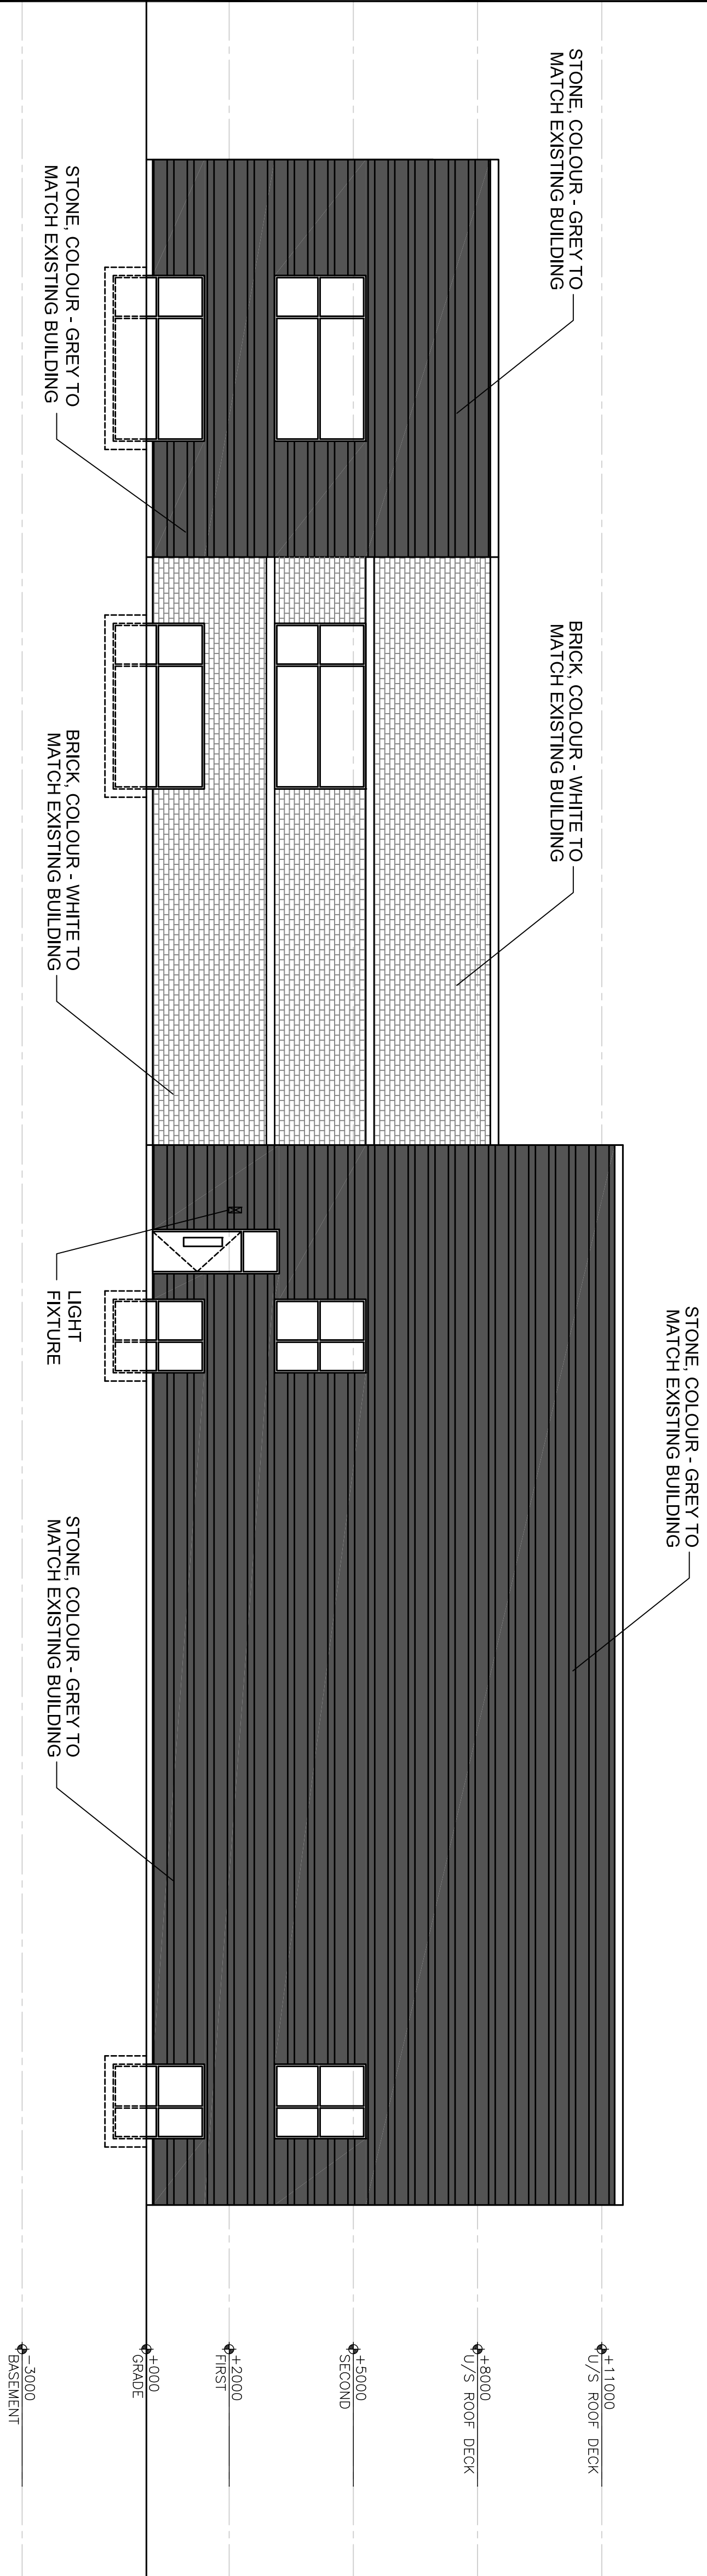

1 EAST ELEVATION
SCALE 1:100

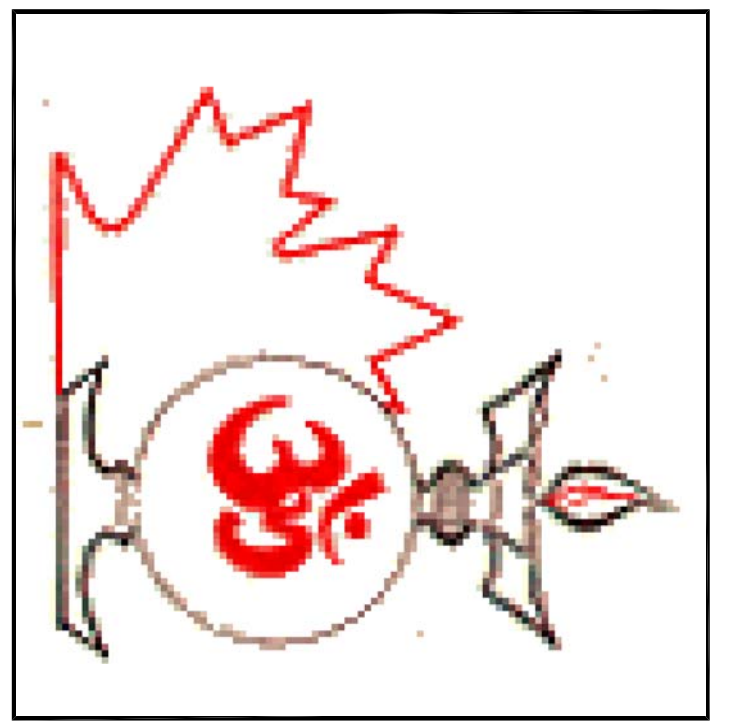

GENERAL NOTES

1. CONSULTING ENGINEER'S DIMENSIONS, DRAWINGS, SPECIFICATIONS AND INSTRUMENTS OF WORK SHALL BE USED AS SHOWN ON THESE DRAWINGS.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF WORK. INSTRUMENTS OF WORK MUST BE RETURNED AT THE COMPLETION OF THE WORK, & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
10	ISSUED FOR SITE PLAN	2022AUG22
9	ISSUED FOR SITE PLAN	2022APR25
8	ISSUED FOR SITE PLAN	2021NOV03
7	ISSUED FOR SITE PLAN	2021OCT22
6	ISSUED FOR SITE PLAN	MAR 16

PROJECT MANAGER
HARISH GUPTA
B. ARCH
1066 PLANTIE DRIVE,
OTTAWA, ON K1V 9T6
T: 613-737-5939
F: 613-812-1726
C: 613-866-2984

PLANNER
jd planning
+ project management
41 Rideau Ferry Road,
Lombardy, ON K0G 1L0
T: 613 812 1726
E: jessica@jdpn.ca

SPONSOR
ANNIS, OSULLIVAN,
VOLLEBECK LTD.
14 Concourse Gate,
Suite 500, K2E 7S6
Mississauga, ON L4V 1A7
Phone: (613) 692-8662
Fax: (613) 727-1079
Email: haper@ovltd.com

TRANSPORTATION ENGINEER
D. J. Hapenny &
Associates Ltd.
P. O. Box 774,
Monrovia, ON K4M 1A7
Tel: (613) 692-8662
Fax: (613) 692-1945
Email: dh@jhapenny.com

STRUCTURAL CONSULTANT
Linton B. Linton &
Associates Inc.
Structural & Marine Engineers
3332 Conroy Ave,
Mississauga, ON K2H 5A9
OTTAWA, ON K1V 7P1
Phone: (613) 722-5168
Fp: 613 729 9500
Email: linton@designsystems.ca

Mechanical & Electrical Consultant
Charelli Korbel
Engineering Ltd.
3332 Conroy Ave,
Mississauga, ON K2H 5A9
Phone: (613) 722-5168
Email: jk@chkel.com

CIVIL CONSULTANT
LRJ
Engineering Inc.
548 Woodbine Avenue, Unit 1100
Markham, ON L3R 1X7
613-277-0119
NICK@LRJENGINEERING.COM,
KARLA@LRJENGINEERING.COM

Mechanical & Electrical Consultant
Charelli Korbel
Engineering Ltd.
3332 Conroy Ave,
Mississauga, ON K2H 5A9
Phone: (613) 722-5168
Email: jk@chkel.com

ARCHITECT
VECTOR DESIGN ARCHITECTS
14 STRATHBURY STREET,
OTTAWA, ONTARIO K2G 5N8
TELEPHONE: (613) 421-9806
EMAIL: vecord@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P1N 043 26-0011

TITLE OF DRAWING
ELEVATIONS

JOB NUMBER
17033

DATE
2019 05

SCALE
1:100

SCALE NUMBER
A300

DATE
2019 05


SCALE
1:100

SCALE NUMBER
A300

DATE
2019 05

SCALE
1:100

SCALE NUMBER
A300





GENERAL NOTES

1. CONSULTING ENGINEER, ARCHITECT AND DIMENSIONS, DRAWINGS OWNERS BEFORE PROCEEDING WITH WORK.
2. ALL DRAWINGS & SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND MUST BE RETURNED AT THE COMPLETION OF THE WORK. & MAY NOT BE REPRODUCED WITHOUT THEIR WRITTEN PERMISSION.

No.	Revision/Issue	Date
10	ISSUED FOR SITE PLAN	2022/JUL/22
9	ISSUED FOR SITE PLAN	2022/APR/25
8	ISSUED FOR SITE PLAN	2021/NOV/03
7	ISSUED FOR SITE PLAN	2021/OCT/22
6	ISSUED FOR SITE PLAN	MAR 16

PROJECT MANAGER
HARISH GUPTA
B. ARCH

PLANNER
jd planning
+ project management
41 Rideau Ferry Road,
Lombardy ON K0G 1L0
T: 613-737-5939
F: 613-812-1726
E: jessica@jdpn.ca

SPONSOR
ANNIS, OSULLIVAN,
VOLLEBECK LTD.
14 Concourse Gate,
P. O. Box 774,
Merrivale, ON K4M 1A7
Tel: (613) 692-8662
Fax: (613) 692-1945
Email: haper@ovltd.com

STRUCTURAL CONSULTANT
Linton B. Linton &
Associates Inc.
3532 Corling Ave,
Ottawa, ON K2H 5A9
Phone: (613) 722-5168
Ft: 613 729 9500
Email: linton@designsystems.ca

CIVIL CONSULTANT
LRJ
Engineering Inc.
5480 Woodbine Ave. Unit 1100
Markham, ON L3R 1X7
613-277-0119
nick@lrbj.com
KARMA, ON K2K 1X7

MECHANICAL & ELECTRICAL CONSULTANT
CHARELLI KORBEL
ENGINEERING LTD.
NICK@KORBEL.COM
613-277-0119
KARMA, ON K2K 1X7

ARCHITECT
VECTOR DESIGN ARCHITECTS
14 STRATHBURY STREET,
OTTAWA, ONTARIO K2G 5N8
TELEPHONE: (613) 421-9806
EMAIL: vecordc@gmail.com

PROJECT AND LOCATION
HERITAGE CENTRE -
HINDU TEMPLE - PHASE 2,
4835 BANK ST., OTTAWA, ON
P1N 043 26-0011

TITLE OF DRAWING
ELEVATIONS


JOB NUMBER
17033

DATE
2019 05


SCALE
1:100

DWG NUMBER
A301


DESIGNED BY
SJK

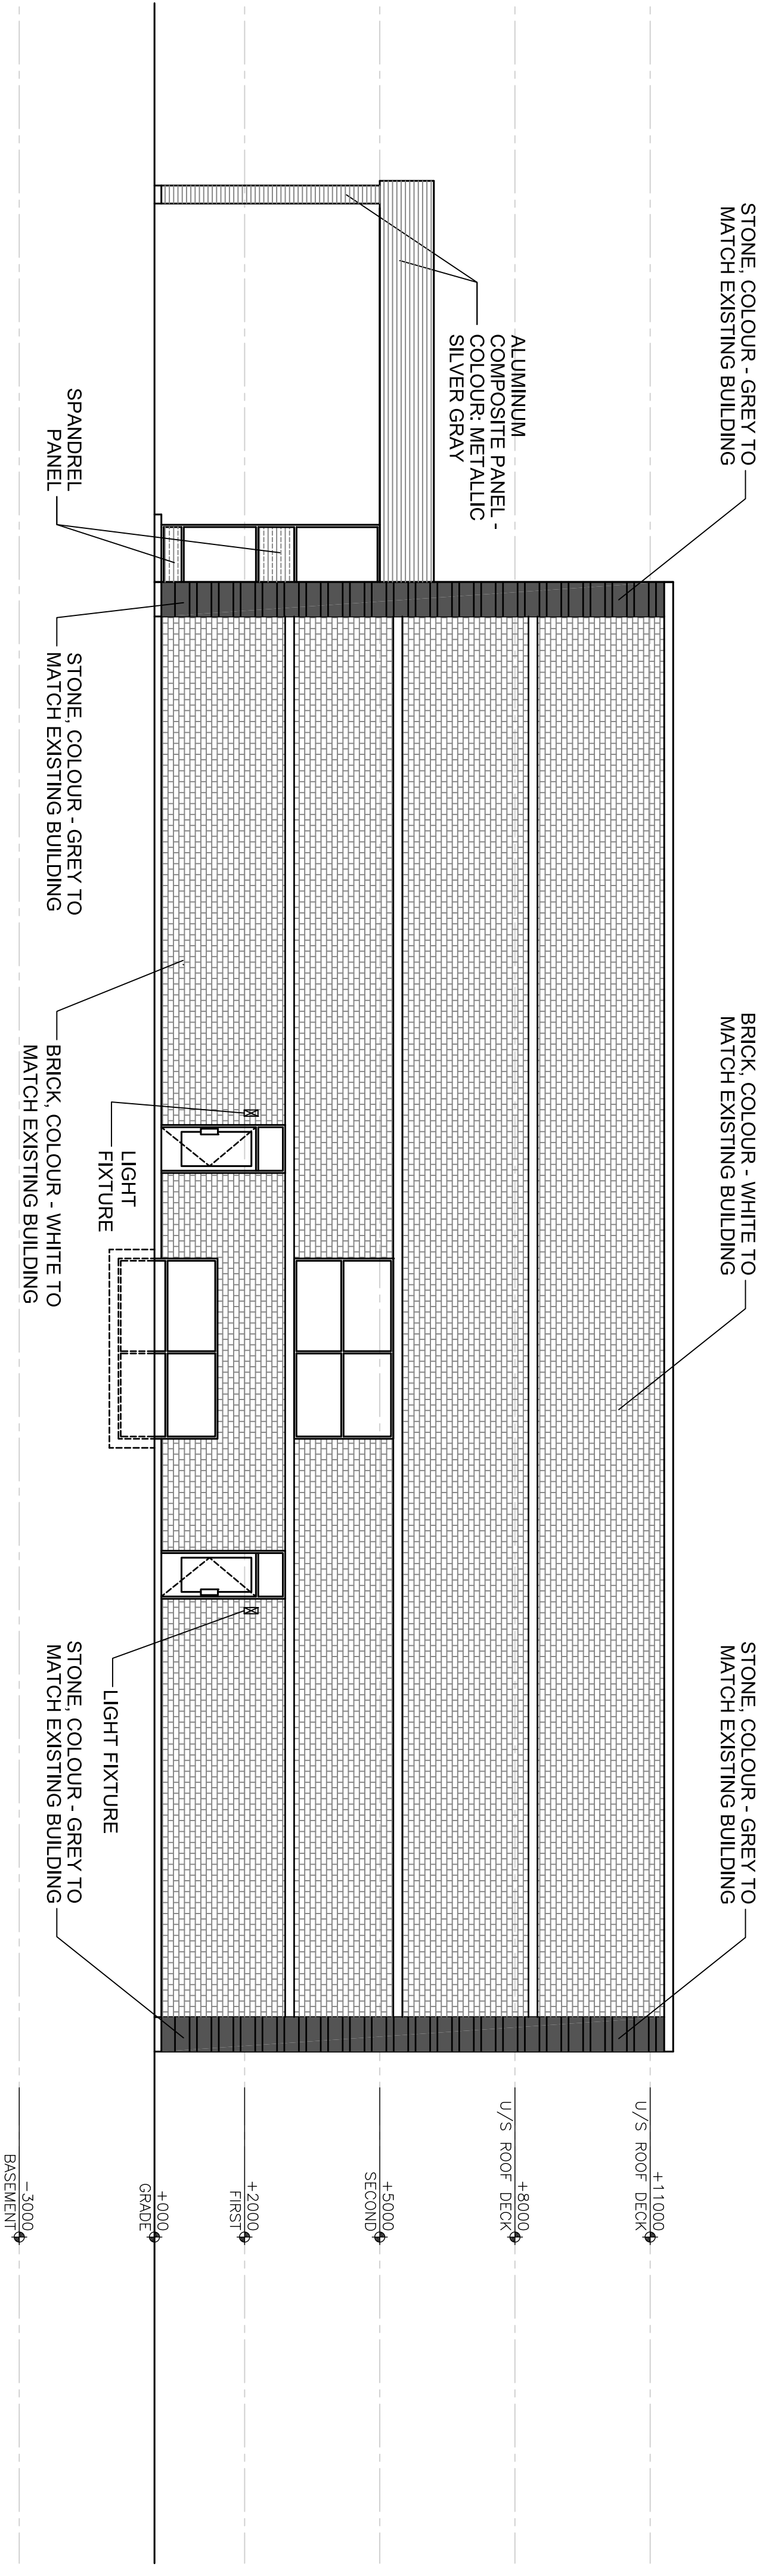

2 SOUTH ELEVATION
SCALE 1:100

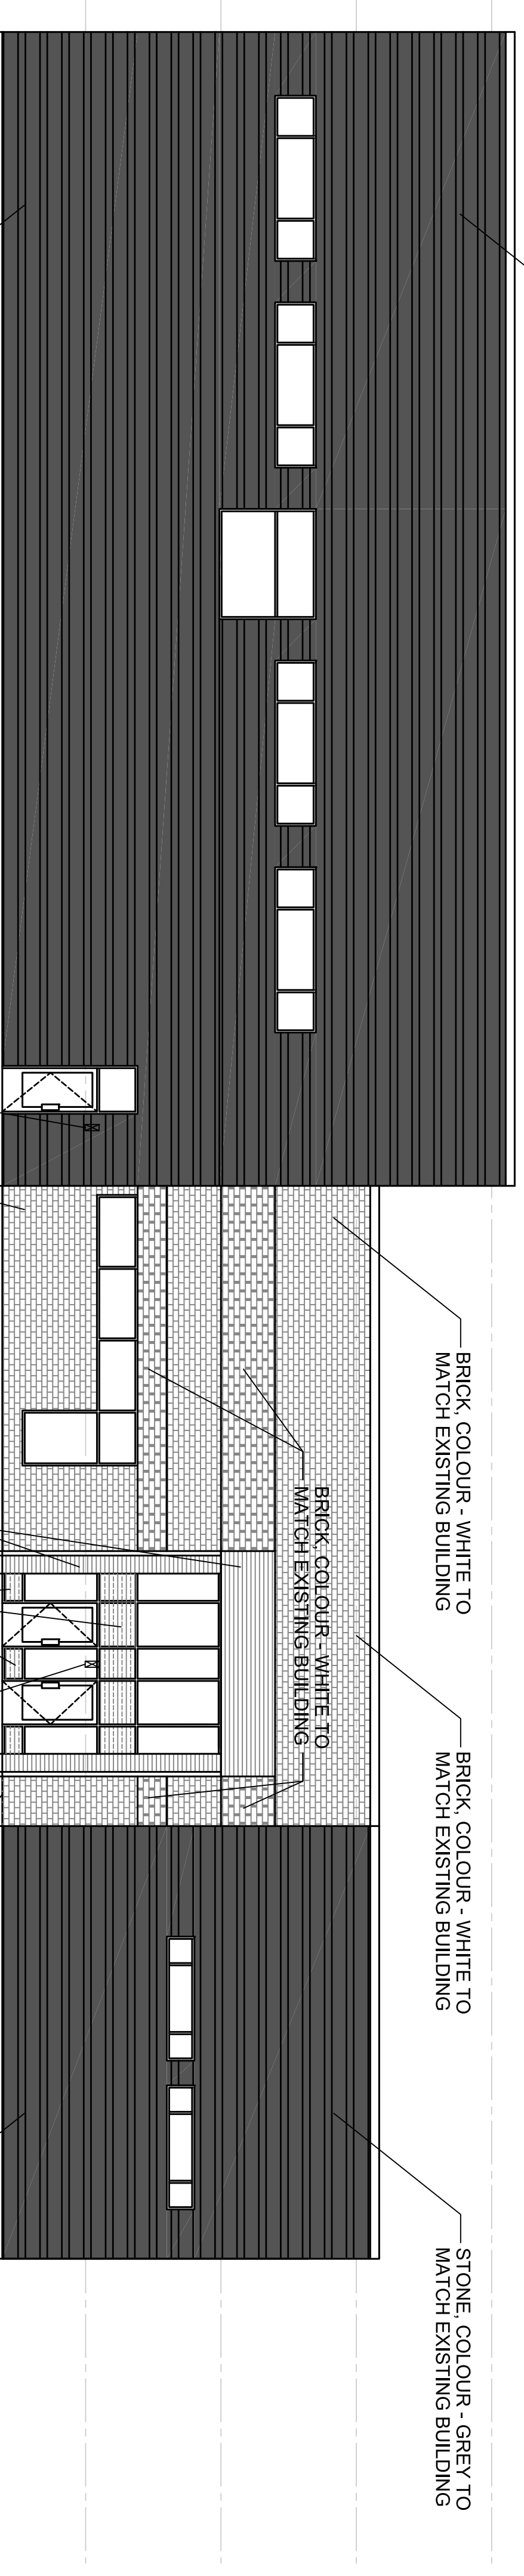

1 WEST ELEVATION
SCALE 1:100



APPENDIX H
Servicing Plan

NOTES: GENERAL

- CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT FOR CONSTRUCTION PURPOSES.
- ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS.
- JOB BENCH MARK - CONFIRM WITH LRL PRIOR TO UTILIZATION.
- ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALE, CATCH BASIN OUTLETS AND/OR STORM DETENTION AREAS ARE PROVIDED.
- STRIP AND REMOVE ALL TOPSOIL FROM IMPROVED AREAS.
- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A CLEAN STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. PAVEMENT REINSTATEMENT SHALL BE WITH STEP JOINTS OF 500mm WIDTH MINIMUM.
- CURBS TO BE BARRIER, CONSTRUCTED AS PER OPSD 600.110.
- ALL MATERIAL SUPPLIED AND PLACED FOR PARKING LOT AND ACCESS ROAD CONSTRUCTION SHALL BE TO OPSD STANDARDS AND SPECIFICATIONS UNLESS OTHERWISE NOTED. CONSTRUCTION TO OPSD 206, 310 & 314. MATERIALS TO OPSD 1001, 1003 & 1010.
- ABUTTING PROPERTY GRADE TO BE MATCHED.
- OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE MUNICIPAL AUTHORITIES PRIOR TO COMMENCING CONSTRUCTION.
- MINIMIZE DISTURBANCE TO EXISTING VEGETATION DURING THE EXECUTION OF ALL WORKS.
- FILTER FABRIC TO BE INSTALLED AND MAINTAINED BETWEEN THE FRAME AND COVER OF ALL CATCHBASINS, CATCHBASIN MANHOLES AND MANHOLES DURING THE CONSTRUCTION PERIOD TO MINIMIZE SEDIMENTS ENTERING THE STORM SEWER SYSTEM. ALL GRASSED AREAS MUST BE COMPLETED PRIOR TO THE REMOVAL OF THE FILTER FABRIC IN THE DRAINAGE STRUCTURES.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE DIRECTED FROM THE ENGINEER. EXCAVATE AND REMOVE ALL ORGANIC MATERIAL AND DEBRIS, IF ANY, LOCATED WITHIN THE PROPOSED BUILDING, PARKING AND ROADWAY LOCATIONS.
- THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS BUT NOT LIMITED TO: ROAD CUT PERMITS, SEWER PERMITS, WATER PERMIT, ETC.
- AT PROPOSED UTILITY CONNECTION POINTS AND CROSSINGS (I.E. STORM SEWER, SANITARY SEWER, WATER, ETC.) THE CONTRACTOR SHALL DETERMINE THE PRECISE LOCATION AND DEPTH OF EXISTING UTILITIES AND REPORT ANY DISCREPANCIES OR CONFLICTS TO THE ENGINEER BEFORE COMMENCING WORK.
- ALL SIDEWALK CONSTRUCTION TO BE AS PER OPSD 310.010 & OPSD 310.050.

NOTES: SEWERS

- SEWER BEDDING AS PER PIPE TRENCH DETAIL WITH GRANULAR 'A' BEDDING COMPACTED TO 95% OF ITS SPMD.
- ALL WORK SHALL BE PERFORMED, AS APPLICABLE IN ACCORDANCE WITH OPSD 407, AND 410.
- CONTRACTOR TO CONFIRM ELEVATION OF EXISTING SEWERS AT PROPOSED CONNECTION POINTS AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE COMMENCING ANY WORK.
- ALL SEWERS WITH LESS THAN 2.0m OF COVER ARE SUBJECT TO INSULATION DETAIL.

NOTES: WATER SERVICE

- PROPOSED WATER SERVICE TO BE INSULATED WHEN COVER IS LESS THAN 2.4m AS PER DETAIL PROVIDED IN C901.

TOPOGRAPHIC INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBECK LTD.
PROJECT NO. 19814-17 HINDU TEMPLE
DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES

- Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
- Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES

- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating, etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).

For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.

SITE AREA = 4.048 Hectares.

Existing Watermain Table				
Location	Station	Min. Obv	Grade	Notes
Connection to Existing Water Service	0+130.5	97.40	99.80	
Connection to Proposed Building	0+151.5	EX	99.63	

Proposed Watermain Table				
Main Line				
Location	Station	Min. Obv	Grade	Notes
Connection to City WM	0+000.0	Match Ex WM OBV	100.24	
Tee Fitting 1	0+034.4	97.65	100.05	
Tee Fitting 2	0+111.5	96.92	99.32	
45° Elbow Fitting 1	0+180.5	96.60	99.00	
45° Elbow Fitting 2	0+186.5	96.75	99.15	
Tee Fitting 3	0+191.2	96.40	98.80	
Fire Hydrant 1	0+195.5*	96.16	98.56	*diverges at Tee Fitting 3
45° Elbow Fitting 3	0+232.5	96.30	98.70	
45° Elbow Fitting 4	0+237.2	96.25	98.65	
Connection to Proposed Building	0+245.7	96.42	98.82	

Branch NW off Tee Fitting 1 @ 0+034.4				
Location	Station	Min. Obv	Grade	Notes
Tee Fitting 1	0+034.4	96.92	99.32	
Elbow Fitting 5	0+037.6	96.86	99.26	
Elbow Fitting 6	0+040.4	97.03	99.43	
Connection to City WM	0+072.5	Match Ex WM OBV	100.28	

Branch NW off Tee Fitting 2 @ 0+111.5				
Location	Station	Min. Obv	Grade	Notes
Tee Fitting 2	0+111.5	96.92	99.32	
Tee Fitting 4	0+122.9	96.9	99.30	
Existing Fire Hydrant	0+129.0*	96.88	99.28	**diverges at Tee Fitting 4
Connection to Existing Water Service	0+130.5	Match EX WTR OBV	99.46	

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/ISLAND
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mm PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SHOWING WORK SHALL BE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS AN ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE, NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROVALS IN LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.


CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

SCALE: 1:500

10m 0 5 10 20m

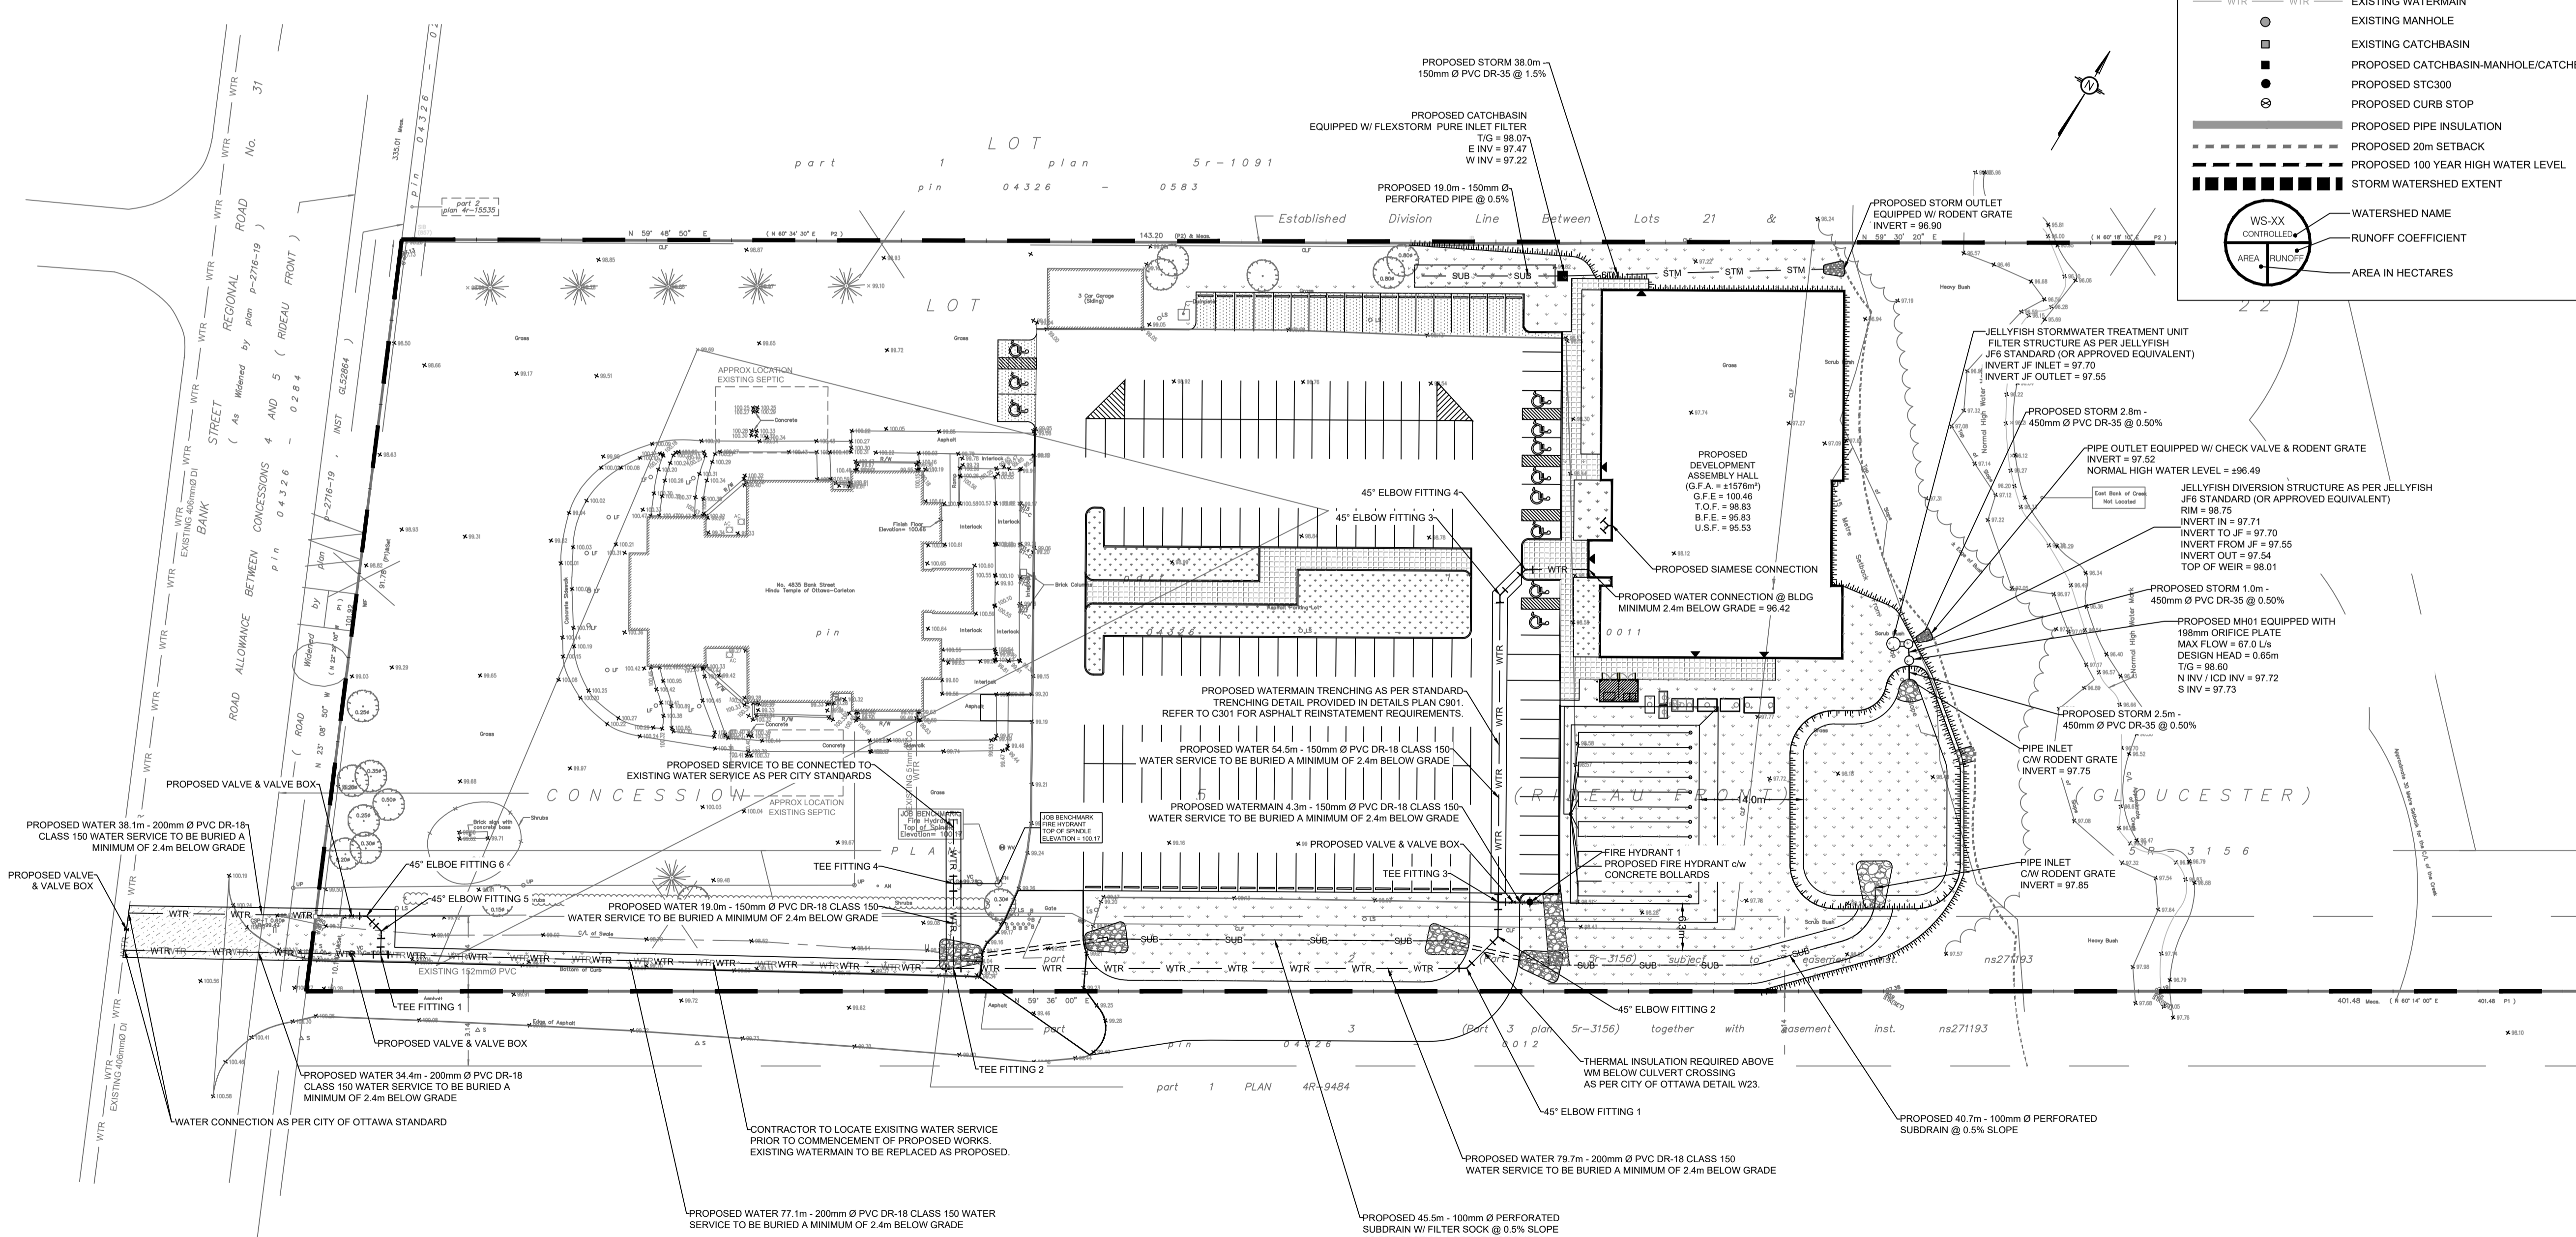

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRL
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON
DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: SERVICING PLAN

PROJECT NO: 170132
DATE: JAN2020



APPENDIX I
Erosion and Sediment Control Plan

EROSION AND SEDIMENT CONTROL MEASURES:

**** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES ****

*****THE SEDIMENT AND EROSION CONTROL MEASURES MAY BE MODIFIED IN THE FIELD AT THE DISCRETION OF THE CITY OF OTTAWA SITE INSPECTOR OR CONSERVATION AUTHORITY*****

1. PRIOR TO START OF CONSTRUCTION:




- PRIOR TO THE REMOVAL OF ANY VEGETATIVE COVER, MOVING OF SOIL AND CONSTRUCTION:
- INSTALL SILT FENCE IMMEDIATELY DOWNSTREAM FROM AREAS TO BE DISTURBED (SEE PLAN FOR LOCATION).
- INSTALL GEOSOCK INSERTS WITH AN OVERFLOW IN ALL THE DOWNSTREAM CATCHBASINS AND MANHOLES
- INSTALL SILT TRAP FILTERS IN ALL CONCRETE CATCH BASIN STRUCTURES
- INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.

2. DURING CONSTRUCTION:

- WORK TO BE DONE IN THE VICINITY OF MAJOR WATERWAYS TO BE CARRIED OUT FROM JULY TO SEPTEMBER ONLY.
- MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE.
- PROTECT DISTURBED AREAS FROM RUNOFF.
- PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
- INSPECT SILT FENCES, FILTER CLOTHS AND CATCH BASIN SUMPS WEEKLY AND AFTER EVERY MAJOR STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
- CONSTRUCT SWALES AS PER DETAIL.
- PLAN TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION
- EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES.
- DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE THE FILL IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS).
- CONTROL WIND-BLOWN DUST OFF SITE TO ACCEPTABLE LEVELS BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED).
- ALL EROSION CONTROL STRUCTURES TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
- NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THIS CONSULTING ENGINEER AND THE CITY DEPARTMENT OF PUBLIC WORKS.
- CONTRACTOR RESPONSIBLE FOR CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING ETC. AT THE END OF EACH WORK DAY.
- PROVIDE GRAVEL ENTRANCE WHEREVER EQUIPMENT LEAVES THE SITE TO PREVENT MUD TRACKING ONTO PAVED SURFACES. GRAVEL BED SHALL BE A MINIMUM OF 15m LONG, 4M WIDE AND 0.3m DEEP AND SHALL CONSIST OF COARSE (50mm CRUSHER-RUN LIMESTONE) MATERIAL. MAINTAIN GRAVEL ENTRANCE IN CLEAN CONDITION.
- DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
- ANY MUD/MATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
- TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ADJUTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.

3. AFTER CONSTRUCTION:

- PROVIDE PERMANENT COVER CONSISTING OF TOPSOIL AND SEED TO DISTURBED AREAS.
- REMOVE STRAW BALE FLOW CHECK DAMS, SILT FENCES AND FILTER CLOTHS ON CATCH BASINS AND MANHOLE COVERS AFTER DISTURBED AREAS HAVE BEEN REHABILITATED AND STABILIZED.
- INSPECT AND CLEAN CATCH BASIN SUMPS AND STORM SEWERS.

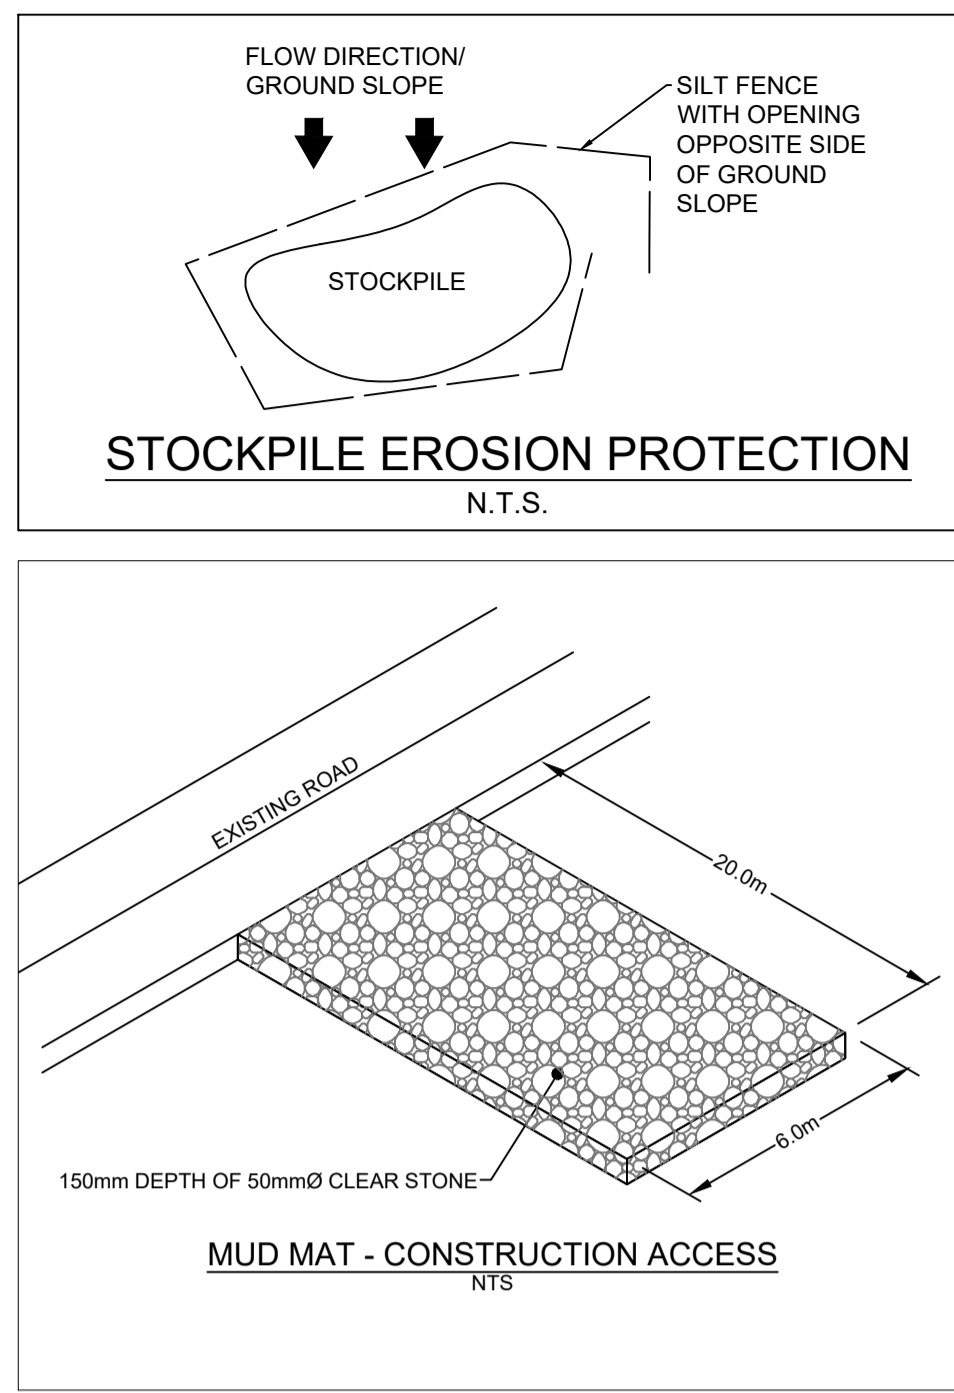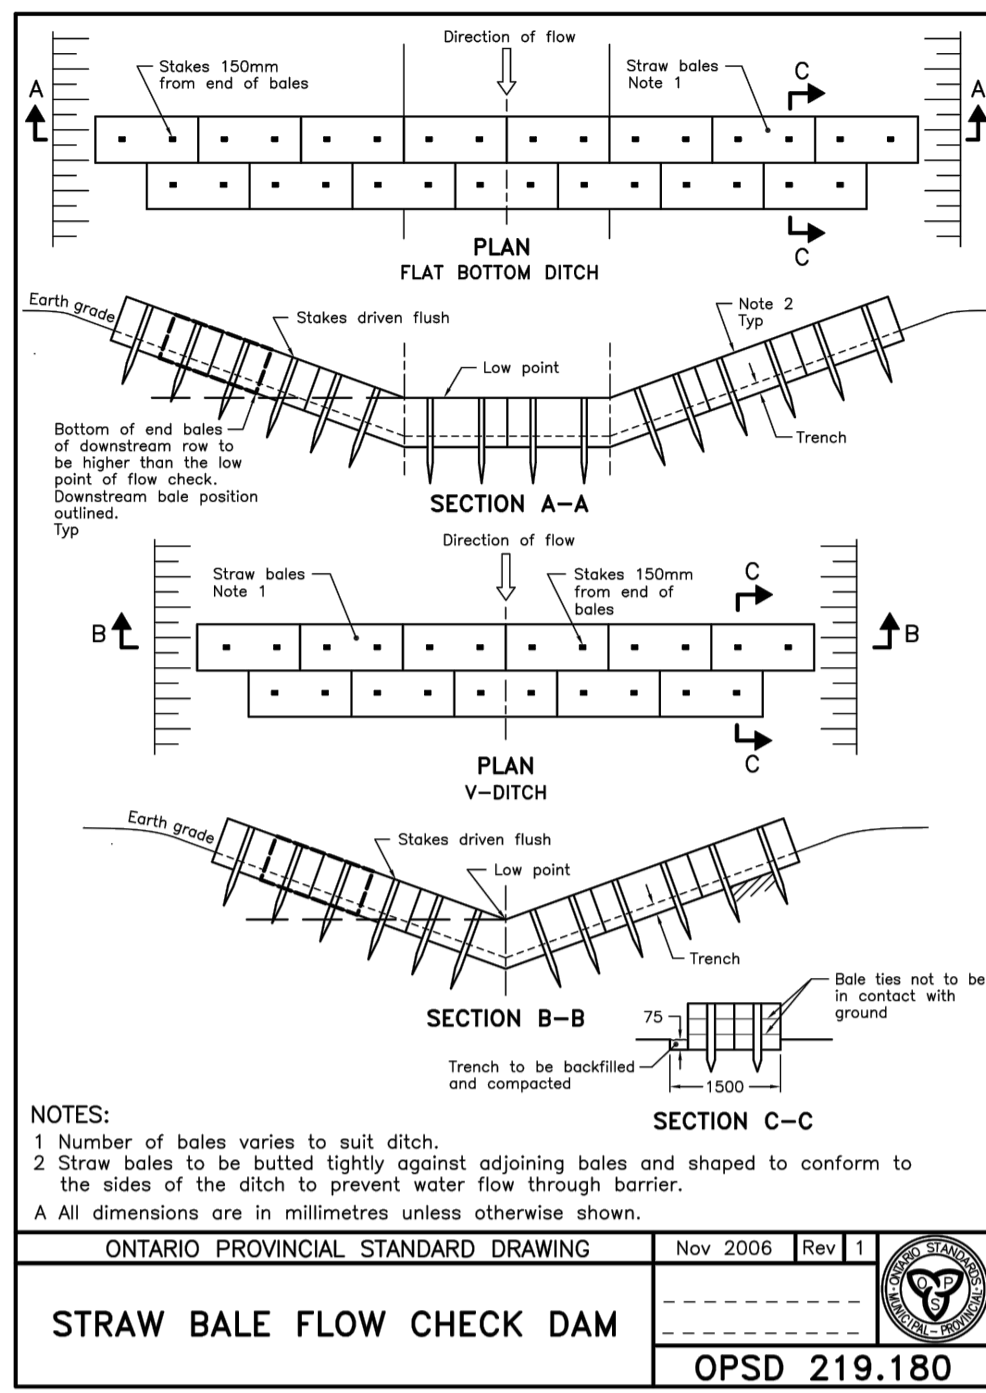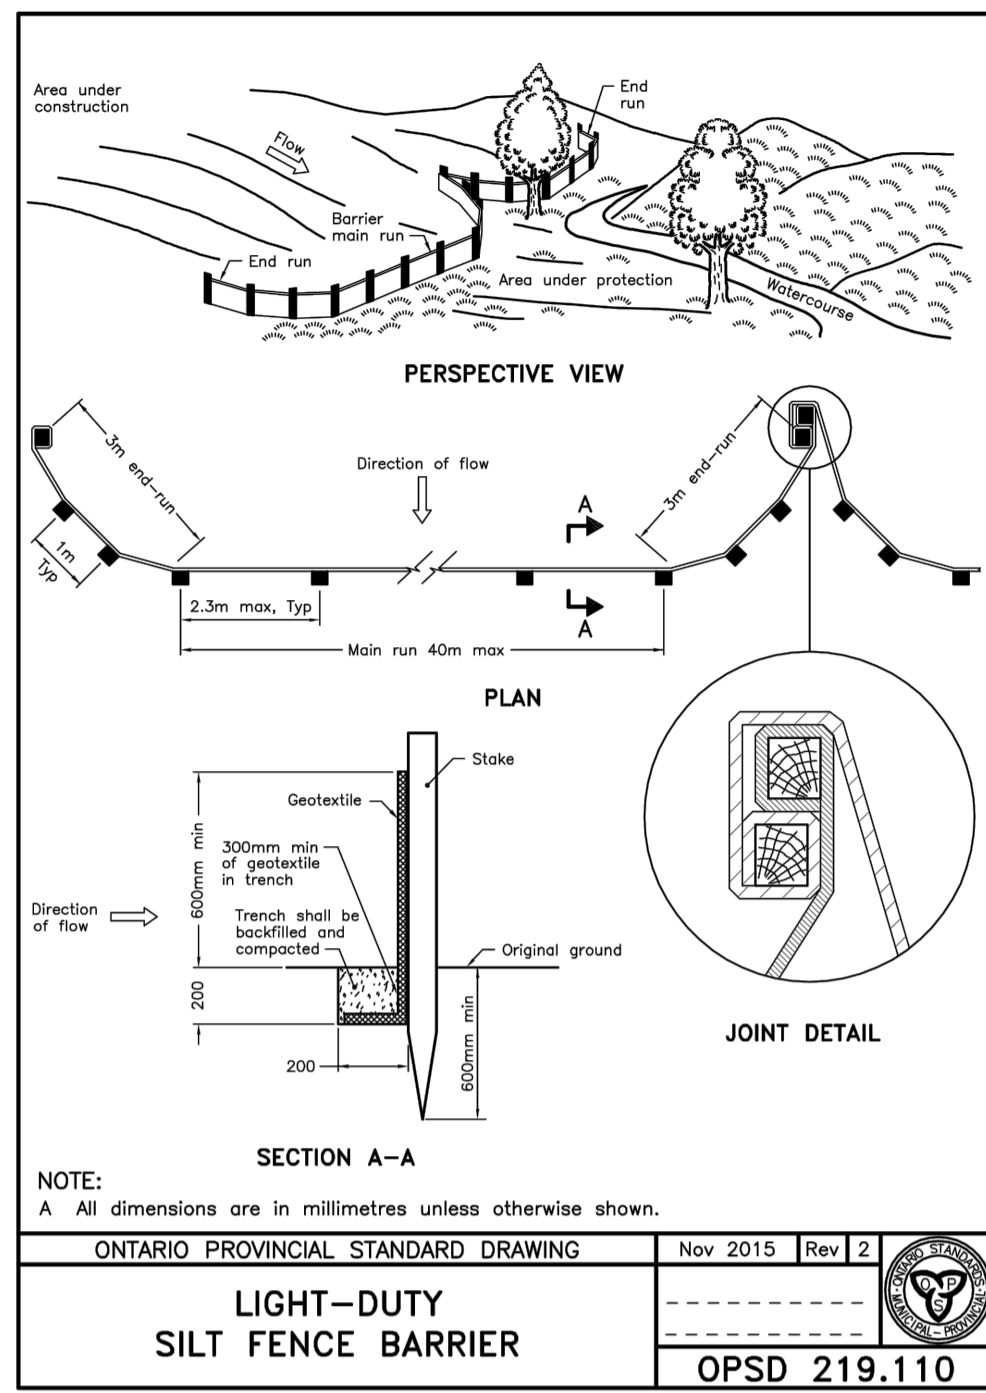

LEGEND:

	EXISTING PROPERTY LINE
	PROPOSED CURB
	PROPOSED DEPRESSED CURB
	PROPOSED TERRACING (3:1 MAX.)
	PROPOSED SILT FENCE AS PER OPSD 219.110
	PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
	PROPOSED DOOR ENTRANCE/EXIT
	PROPOSED LANDSCAPED AREA
	PROPOSED CONCRETE FEATURES/SLAB
	PROPOSED HEAVY-DUTY ASPHALT
	PROPOSED LIGHT-DUTY ASPHALT
	PROPOSED RIP RAP
	PROPOSED ELEVATION
	PROPOSED STORM SEWER
	PROPOSED SANITARY SEWER
	PROPOSED WATERMAIN
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING WATERMAIN
	EXISTING MANHOLE
	EXISTING CATCHBASIN
	PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
	PROPOSED STC300
	PROPOSED CURB STOP
	PROPOSED PIPE INSULATION
	PROPOSED 20m SETBACK
	PROPOSED 100 YEAR HIGH WATER LEVEL
	STORM WATERSHED EXTENT
	WATERSHED NAME
	RUNOFF COEFFICIENT
	AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE WORK AND INTENT OF THE DRAWINGS. THE CONTRACTOR SHALL VERIFY THE LOCATION AND INTENT OF THE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA AND THE PROVINCE OF ONTARIO. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA AND THE PROVINCE OF ONTARIO. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA AND THE PROVINCE OF ONTARIO.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THE PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE, NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRI ASSOCIATES LTD. (LRI) WITHOUT OBTAINING LRI'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRI AND TO RELEASE LRI FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRI FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRI'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRI AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRI AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:


EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND DEPTH OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

10m 5 0 10 20m
SCALE: 1:500

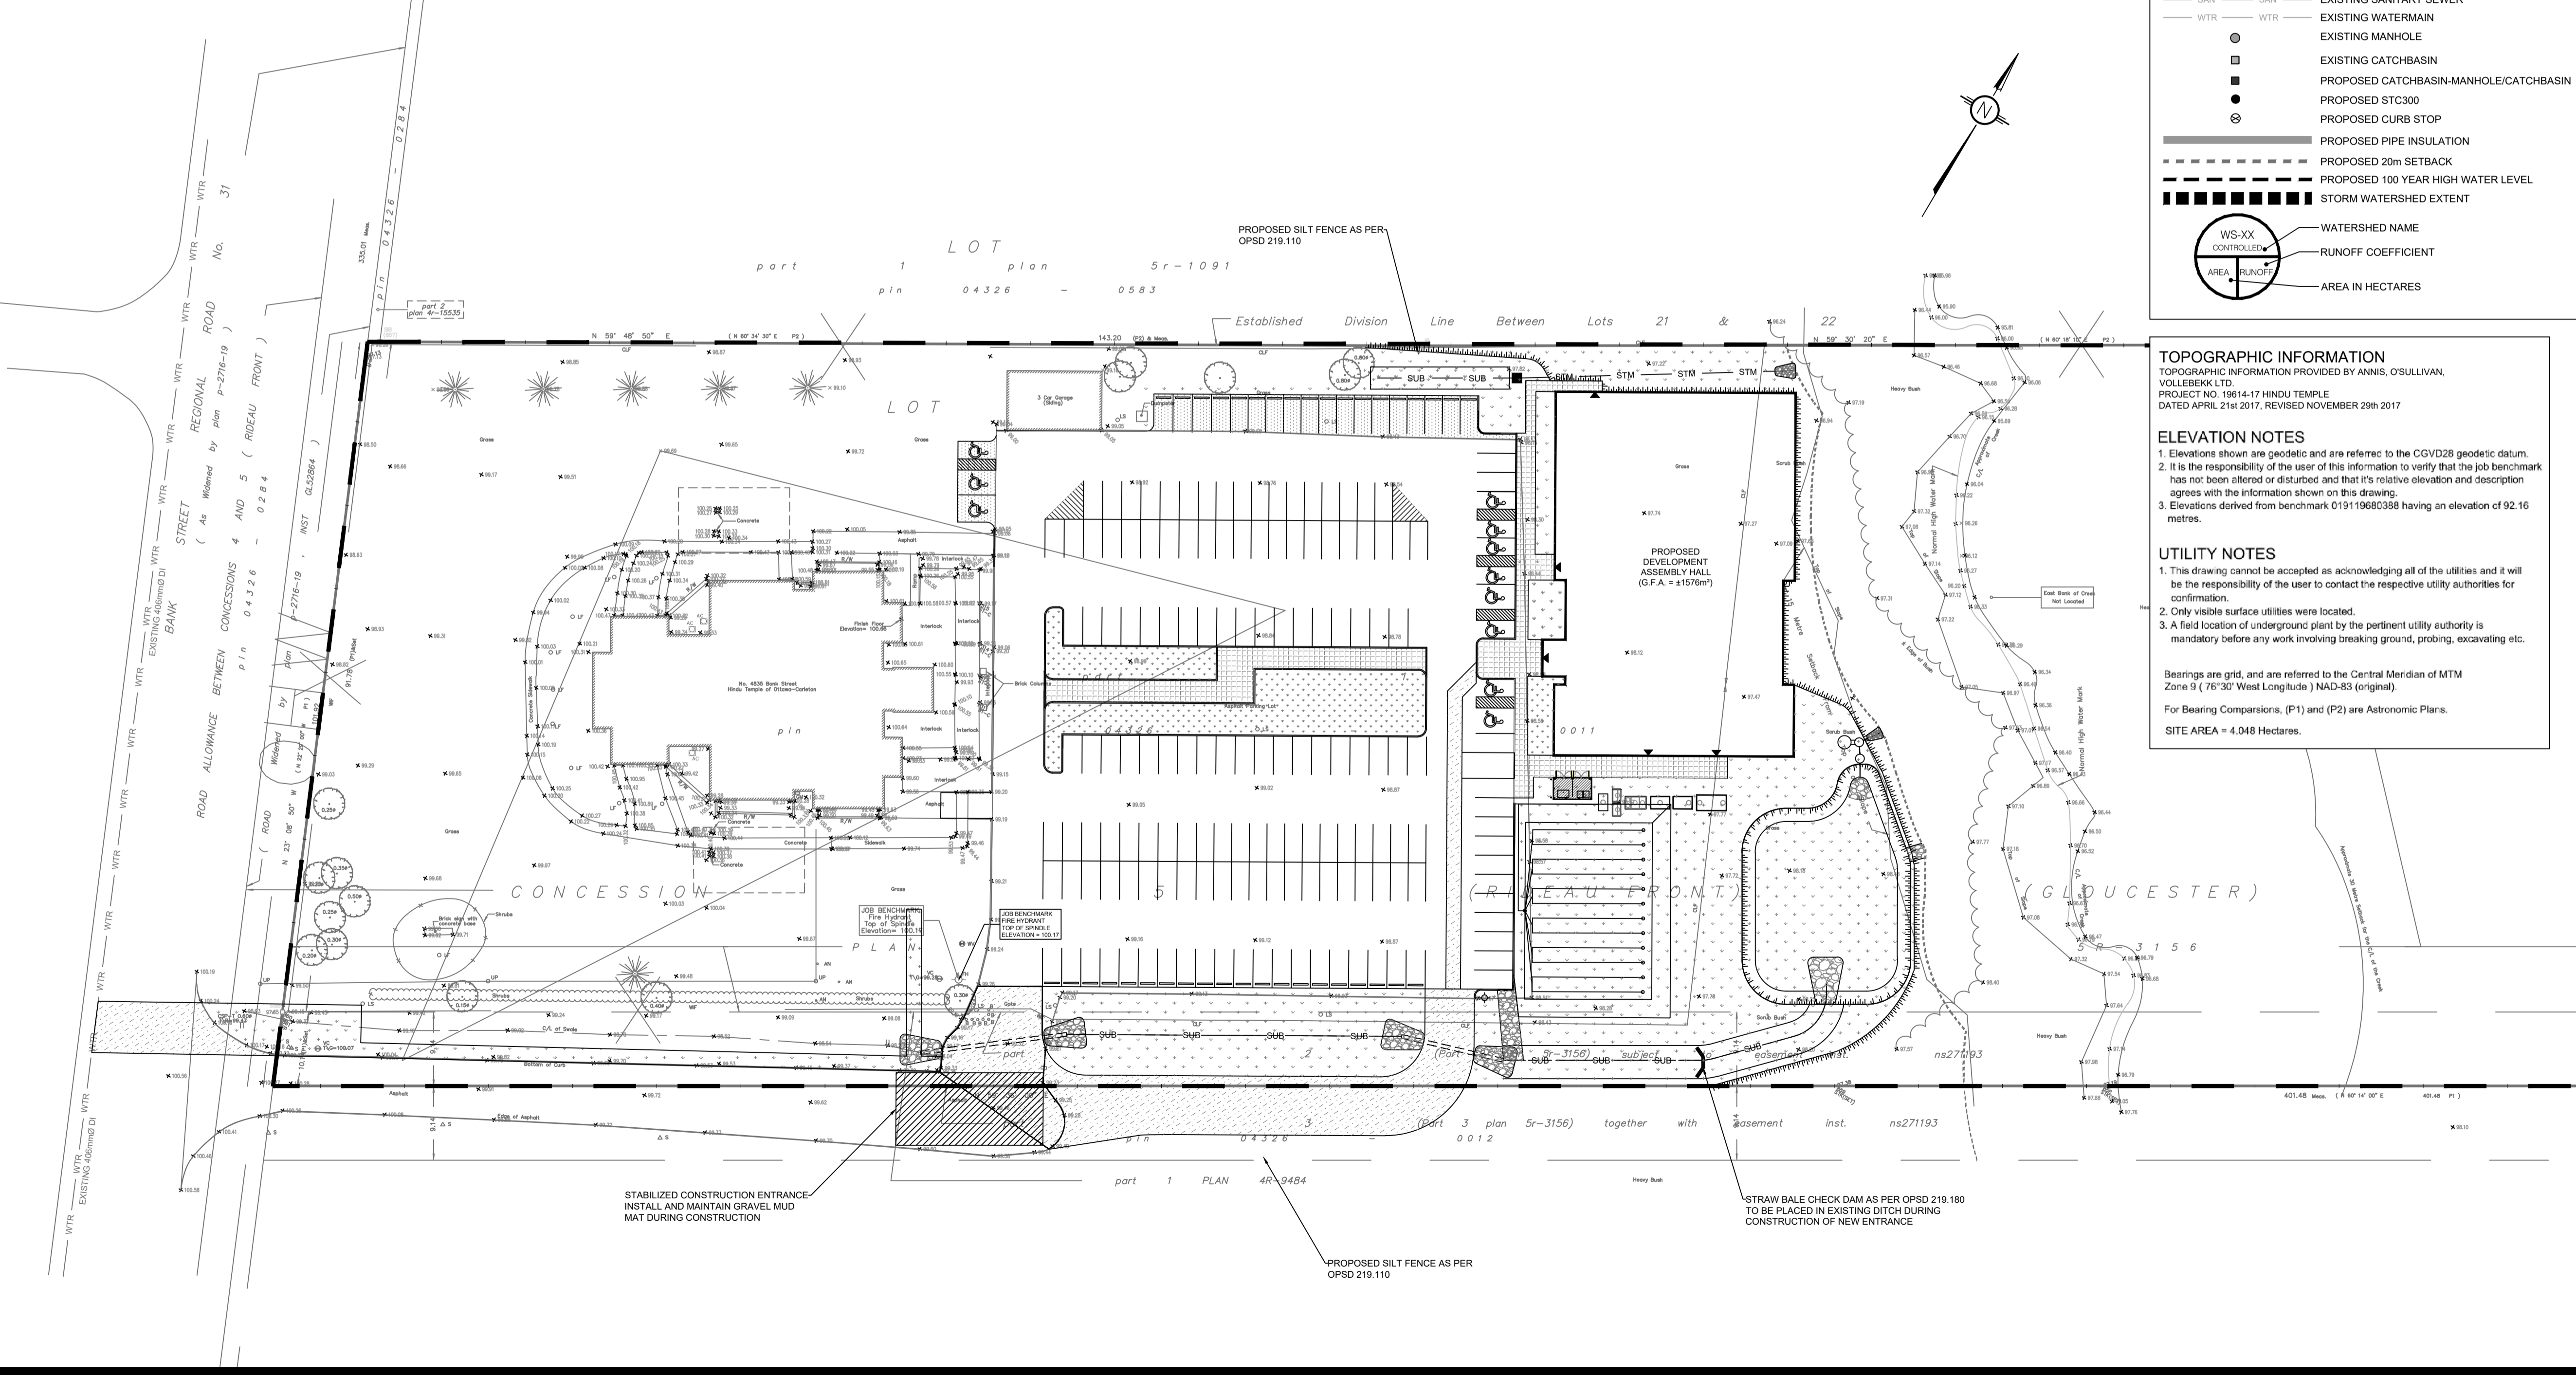

TOPOGRAPHIC INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY ANNS, O'SULLIVAN, VOLLEBECK LTD.
PROJECT NO. 19814-17 HINDU TEMPLE
DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES

1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that it's relative elevation and description agrees with the information shown on this drawing.
3. Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES

1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
2. Only visible surface utilities were located.
3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).

For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.

SITE AREA = 4.048 Hectares.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRI
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

CLIENT: **THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON**

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: **PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA**

DRAWING TITLE: **EROSION AND SEDIMENT CONTROL PLAN**

PROJECT NO. 170132
DATE: JAN2020

C101

File no.: D017-12-20-0059

APPENDIX J
Domestic Water Demand Calculations



Water Service Calculations

LRL File No. : 170132
Project : Hindu Heritage Centre
Date : October 31, 2022
Designed by : Kyle Herold

Water Demand - Proposed Development

Total fixture units: (as per OBC Table 7.6.3.2.A)
Conversion of fixture units to equivalent gpm: gpm (as per PS&D)

Average water demand = 261647.52 L / day
= 3.03 L/s

Maximum daily peak factor: 1.5
Maximum daily demand = 392471 L / day
= 4.54 L / s

Maximum hour peak factor: 1.8
Maximum hour demand = 706448 L / day
= 8.18 L / s

Water Demand - Existing Building

Total fixture units: (as per OBC Table 7.6.3.2.A)
Conversion of fixture units to equivalent gpm: gpm (as per PS&D)

Average water demand = 168980.69 L / day
= 1.96 L/s

Maximum daily peak factor: 1.5
Maximum daily demand = 253471 L / day
= 2.93 L / s

Maximum hour peak factor: 1.8
Maximum hour demand = 456248 L / day
= 5.28 L / s

Total Water Demand




Avg water demand = 430628.21 L / day
= 4.98 L / s

Max daily demand = 645942.3 L / day

	=	7.48	L / s
Max hour demand	=	1162696.2	L / day
	=	13.46	L / s

APPENDIX K

Pipe Pressure Loss Calculations Details

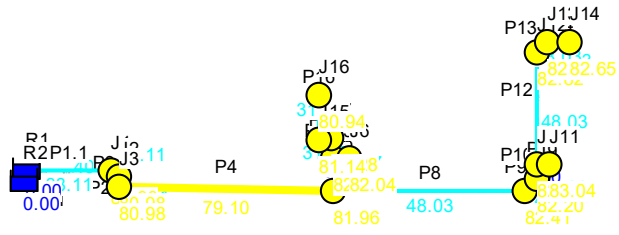

Scenario 1: Avg Day (Existing Conditions)

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality              *
*                               Analysis for Pipe Networks                *
*                               Version 2.2                              *
*****
    
```

Input File: Scenario 1-Avg Day.net

Link - Node Table:

Link ID	Start Node	End Node	Length ft	Diameter in
P1	R2	J3	113.16	8
P2	J1	J2	8.2	8
P3	J2	J3	8.2	8
P4	J3	J4	252.6	8
P5	J4	J5	37.06	6
P6	J5	J6	16.4	6
P7	J5	J7	24.93	6
P8	J4	J8	227.96	8
P9	J8	J9	18.04	8
P10	J9	J10	20.34	8
P11	J10	J11	14.1	6
P12	J10	J12	155.47	6
P13	J12	J13	16.07	6
P14	J13	J14	28.21	6
P1.1	R1	J1	113.16	8
P15	J7	J15	16.73	2
P16	J15	J16	52.81	2

Node Results:




Node ID	Demand GPM	Head ft	Pressure psi	Quality
J1	0.00	507.08	80.98	0.00
J2	0.00	507.08	80.98	0.00
J3	0.00	507.08	80.98	0.00
J4	0.00	507.05	81.96	0.00
J5	0.00	507.05	82.04	0.00
J6	0.00	507.05	82.04	0.00
J7	0.00	507.05	81.28	0.00
J8	0.00	507.04	82.41	0.00
J9	0.00	507.04	82.20	0.00
J10	0.00	507.04	82.69	0.00
J11	0.00	507.04	83.04	0.00
J12	0.00	507.01	82.82	0.00
J13	0.00	507.00	82.89	0.00
J14	48.03	507.00	82.65	0.00

Node Results: (continued)

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J15	0.00	506.72	81.14	0.00
J16	31.07	505.70	80.94	0.00
R1	-38.11	507.09	0.00	0.00 Reservoir
R2	-40.99	507.09	0.00	0.00 Reservoir

Link Results:

Link ID	Flow GPM	Velocity fps	Unit Headloss ft/Kft	Status
P1	40.99	0.26	0.04	Open
P2	38.11	0.24	0.03	Open
P3	38.11	0.24	0.03	Open
P4	79.10	0.50	0.13	Open
P5	31.07	0.35	0.09	Open
P6	0.00	0.00	0.00	Open
P7	31.07	0.35	0.09	Open
P8	48.03	0.31	0.05	Open
P9	48.03	0.31	0.05	Open
P10	48.03	0.31	0.05	Open
P11	0.00	0.00	0.00	Open
P12	48.03	0.55	0.21	Open
P13	48.03	0.55	0.21	Open
P14	48.03	0.55	0.21	Open
P1.1	38.11	0.24	0.03	Open
P15	31.07	3.17	19.36	Open
P16	31.07	3.17	19.36	Open

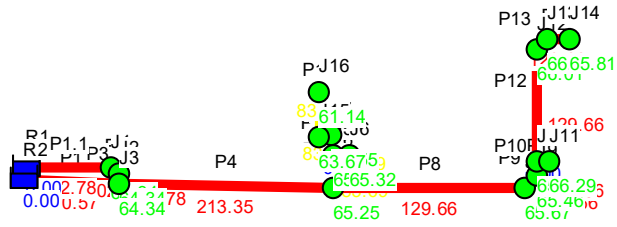

Scenario 2: Peak Hour (Existing Conditions)

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                *
*****
    
```

Input File: Scenario 2-Peak Hour.net

Link - Node Table:

Link ID	Start Node	End Node	Length ft	Diameter in
P1	R2	J3	113.16	8
P2	J1	J2	8.2	8
P3	J2	J3	8.2	8
P4	J3	J4	252.6	8
P5	J4	J5	37.06	6
P6	J5	J6	16.4	6
P7	J5	J7	24.93	6
P8	J4	J8	227.96	8
P9	J8	J9	18.04	8
P10	J9	J10	20.34	8
P11	J10	J11	14.1	6
P12	J10	J12	155.47	6
P13	J12	J13	16.07	6
P14	J13	J14	28.21	6
P1.1	R1	J1	113.16	8
P15	J7	J15	16.73	2
P16	J15	J16	52.81	2

Node Results:




Node ID	Demand GPM	Head ft	Pressure psi	Quality
J1	0.00	468.69	64.34	0.00
J2	0.00	468.69	64.34	0.00
J3	0.00	468.69	64.34	0.00
J4	0.00	468.48	65.25	0.00
J5	0.00	468.46	65.32	0.00
J6	0.00	468.46	65.32	0.00
J7	0.00	468.45	64.55	0.00
J8	0.00	468.41	65.67	0.00
J9	0.00	468.40	65.46	0.00
J10	0.00	468.40	65.95	0.00
J11	0.00	468.40	66.29	0.00
J12	0.00	468.20	66.01	0.00
J13	0.00	468.18	66.07	0.00
J14	129.66	468.14	65.81	0.00

Node Results: (continued)

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J15	0.00	466.42	63.67	0.00
J16	83.69	460.01	61.14	0.00
R1	-102.78	468.71	0.00	0.00 Reservoir
R2	-110.57	468.71	0.00	0.00 Reservoir

Link Results:

Link ID	Flow GPM	Velocity fps	Unit Headloss ft/Kft	Status
P1	110.57	0.71	0.24	Open
P2	102.78	0.66	0.21	Open
P3	102.78	0.66	0.20	Open
P4	213.35	1.36	0.80	Open
P5	83.69	0.95	0.58	Open
P6	0.00	0.00	0.00	Open
P7	83.69	0.95	0.58	Open
P8	129.66	0.83	0.32	Open
P9	129.66	0.83	0.32	Open
P10	129.66	0.83	0.32	Open
P11	0.00	0.00	0.00	Open
P12	129.66	1.47	1.29	Open
P13	129.66	1.47	1.30	Open
P14	129.66	1.47	1.29	Open
P1.1	102.78	0.66	0.21	Open
P15	83.69	8.55	121.33	Open
P16	83.69	8.55	121.33	Open

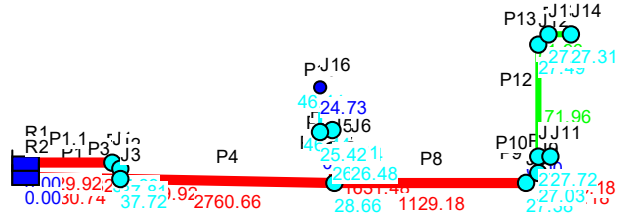

Scenario 3: Max Day + Fire Flow (Existing Conditions)

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****
    
```

Input File: Scenario 3-Avg Day+Fire.net

Link - Node Table:

Link ID	Start Node	End Node	Length ft	Diameter in
P1	R2	J3	113.16	8
P2	J1	J2	8.2	8
P3	J2	J3	8.2	8
P4	J3	J4	252.6	8
P5	J4	J5	37.06	6
P6	J5	J6	16.4	6
P7	J5	J7	24.93	6
P8	J4	J8	227.96	8
P9	J8	J9	18.04	8
P10	J9	J10	20.34	8
P11	J10	J11	14.1	6
P12	J10	J12	155.47	6
P13	J12	J13	16.07	6
P14	J13	J14	28.21	6
P1.1	R1	J1	113.16	8
P15	J7	J15	16.73	2
P16	J15	J16	52.81	2

Node Results:




Node ID	Demand GPM	Head ft	Pressure psi	Quality
J1	0.00	407.64	37.89	0.00
J2	0.00	407.45	37.81	0.00
J3	0.00	407.25	37.72	0.00
J4	0.00	384.04	28.66	0.00
J5	1585.04	378.82	26.48	0.00
J6	0.00	378.82	26.48	0.00
J7	0.00	378.81	25.71	0.00
J8	0.00	380.04	27.38	0.00
J9	0.00	379.72	27.03	0.00
J10	1057.22	379.36	27.37	0.00
J11	0.00	379.36	27.72	0.00
J12	0.00	379.30	27.49	0.00
J13	0.00	379.29	27.55	0.00
J14	71.96	379.28	27.31	0.00

Node Results: (continued)

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J15	0.00	378.13	25.42	0.00
J16	46.44	375.98	24.73	0.00
R1	-1329.92	410.33	0.00	0.00 Reservoir
R2	-1430.74	410.33	0.00	0.00 Reservoir

Link Results:

Link ID	Flow GPM	Velocity fps	Unit Headloss ft/Kft	Status
P1	1430.74	9.13	27.20	Open
P2	1329.92	8.49	23.76	Open
P3	1329.92	8.49	23.76	Open
P4	2760.66	17.62	91.90	Open
P5	1631.48	18.51	140.87	Open
P6	0.00	0.00	0.00	Open
P7	46.44	0.53	0.19	Open
P8	1129.18	7.21	17.55	Open
P9	1129.18	7.21	17.55	Open
P10	1129.18	7.21	17.55	Open
P11	0.00	0.00	0.00	Open
P12	71.96	0.82	0.43	Open
P13	71.96	0.82	0.43	Open
P14	71.96	0.82	0.43	Open
P1.1	1329.92	8.49	23.76	Open
P15	46.44	4.74	40.76	Open
P16	46.44	4.74	40.76	Open

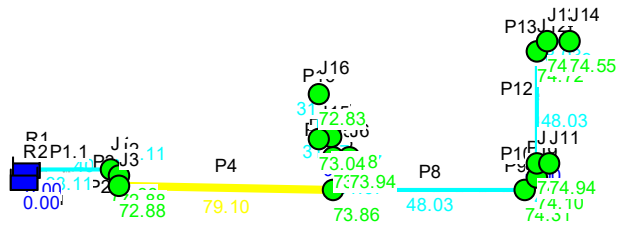

Scenario 1: Avg Day (SUC Zone Reconfiguration)

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                *
*                               Analysis for Pipe Networks                  *
*                               Version 2.2                                *
*****
    
```

Input File: Scenario 1-Avg Day_SUC.net

Link - Node Table:

Link ID	Start Node	End Node	Length ft	Diameter in
P1	R2	J3	113.16	8
P2	J1	J2	8.2	8
P3	J2	J3	8.2	8
P4	J3	J4	252.6	8
P5	J4	J5	37.06	6
P6	J5	J6	16.4	6
P7	J5	J7	24.93	6
P8	J4	J8	227.96	8
P9	J8	J9	18.04	8
P10	J9	J10	20.34	8
P11	J10	J11	14.1	6
P12	J10	J12	155.47	6
P13	J12	J13	16.07	6
P14	J13	J14	28.21	6
P1.1	R1	J1	113.16	8
P15	J7	J15	16.73	2
P16	J15	J16	52.81	2

Node Results:




Node ID	Demand GPM	Head ft	Pressure psi	Quality
J1	0.00	488.39	72.88	0.00
J2	0.00	488.39	72.88	0.00
J3	0.00	488.39	72.88	0.00
J4	0.00	488.36	73.86	0.00
J5	0.00	488.35	73.94	0.00
J6	0.00	488.35	73.94	0.00
J7	0.00	488.35	73.18	0.00
J8	0.00	488.34	74.31	0.00
J9	0.00	488.34	74.10	0.00
J10	0.00	488.34	74.59	0.00
J11	0.00	488.34	74.94	0.00
J12	0.00	488.31	74.72	0.00
J13	0.00	488.31	74.79	0.00
J14	48.03	488.30	74.55	0.00

Node Results: (continued)

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J15	0.00	488.03	73.04	0.00
J16	31.07	487.00	72.83	0.00
R1	-38.11	488.39	0.00	0.00 Reservoir
R2	-40.99	488.39	0.00	0.00 Reservoir

Link Results:

Link ID	Flow GPM	Velocity fps	Unit Headloss ft/Kft	Status
P1	40.99	0.26	0.04	Open
P2	38.11	0.24	0.03	Open
P3	38.11	0.24	0.03	Open
P4	79.10	0.50	0.13	Open
P5	31.07	0.35	0.09	Open
P6	0.00	0.00	0.00	Open
P7	31.07	0.35	0.09	Open
P8	48.03	0.31	0.05	Open
P9	48.03	0.31	0.05	Open
P10	48.03	0.31	0.05	Open
P11	0.00	0.00	0.00	Open
P12	48.03	0.55	0.21	Open
P13	48.03	0.55	0.21	Open
P14	48.03	0.55	0.21	Open
P1.1	38.11	0.24	0.03	Open
P15	31.07	3.17	19.36	Open
P16	31.07	3.17	19.36	Open

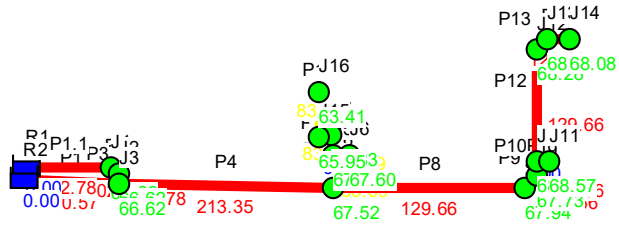

Scenario 2: Peak Hour (SUC Zone Reconfiguration)

```
*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                   *
*                               Version 2.2                                 *
*****
```

Input File: Scenario 2-Peak Hour_SUC.net

Link - Node Table:

Link ID	Start Node	End Node	Length ft	Diameter in
P1	R2	J3	113.16	8
P2	J1	J2	8.2	8
P3	J2	J3	8.2	8
P4	J3	J4	252.6	8
P5	J4	J5	37.06	6
P6	J5	J6	16.4	6
P7	J5	J7	24.93	6
P8	J4	J8	227.96	8
P9	J8	J9	18.04	8
P10	J9	J10	20.34	8
P11	J10	J11	14.1	6
P12	J10	J12	155.47	6
P13	J12	J13	16.07	6
P14	J13	J14	28.21	6
P1.1	R1	J1	113.16	8
P15	J7	J15	16.73	2
P16	J15	J16	52.81	2

Node Results:




Node ID	Demand GPM	Head ft	Pressure psi	Quality
J1	0.00	473.94	66.62	0.00
J2	0.00	473.93	66.62	0.00
J3	0.00	473.93	66.62	0.00
J4	0.00	473.73	67.52	0.00
J5	0.00	473.71	67.60	0.00
J6	0.00	473.71	67.60	0.00
J7	0.00	473.69	66.83	0.00
J8	0.00	473.66	67.94	0.00
J9	0.00	473.65	67.73	0.00
J10	0.00	473.65	68.23	0.00
J11	0.00	473.65	68.57	0.00
J12	0.00	473.44	68.28	0.00
J13	0.00	473.42	68.34	0.00
J14	129.66	473.39	68.08	0.00

Node Results: (continued)

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J15	0.00	471.67	65.95	0.00
J16	83.69	465.26	63.41	0.00
R1	-102.78	473.96	0.00	0.00 Reservoir
R2	-110.57	473.96	0.00	0.00 Reservoir

Link Results:

Link ID	Flow GPM	Velocity fps	Unit Headloss ft/Kft	Status
P1	110.57	0.71	0.24	Open
P2	102.78	0.66	0.21	Open
P3	102.78	0.66	0.21	Open
P4	213.35	1.36	0.80	Open
P5	83.69	0.95	0.58	Open
P6	0.00	0.00	0.00	Open
P7	83.69	0.95	0.58	Open
P8	129.66	0.83	0.32	Open
P9	129.66	0.83	0.32	Open
P10	129.66	0.83	0.32	Open
P11	0.00	0.00	0.00	Open
P12	129.66	1.47	1.29	Open
P13	129.66	1.47	1.29	Open
P14	129.66	1.47	1.29	Open
P1.1	102.78	0.66	0.21	Open
P15	83.69	8.55	121.33	Open
P16	83.69	8.55	121.33	Open

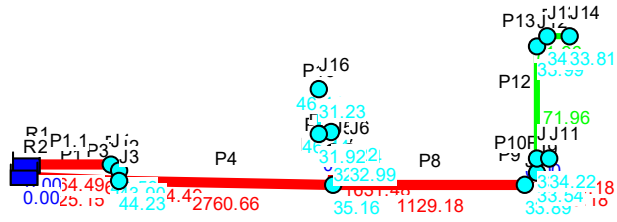

Scenario 3: Max Day + Fire Flow (SUC Zone Reconfiguration)

```

*****
*                               E P A N E T                               *
*                               Hydraulic and Water Quality                 *
*                               Analysis for Pipe Networks                 *
*                               Version 2.2                               *
*****
    
```

Input File: Scenario 3-Max Day+Fire_SUC Zone.net

Link - Node Table:

Link ID	Start Node	End Node	Length ft	Diameter in
P1	R2	J3	113.16	8
P2	J1	J2	8.2	8
P3	J2	J3	8.2	8
P4	J3	J4	252.6	8
P5	J4	J5	37.06	6
P6	J5	J6	16.4	6
P7	J5	J7	24.93	6
P8	J4	J8	227.96	8
P9	J8	J9	18.04	8
P10	J9	J10	20.34	8
P11	J10	J11	14.1	6
P12	J10	J12	155.47	6
P13	J12	J13	16.07	6
P14	J13	J14	28.21	6
P1.1	R1	J1	113.16	8
P15	J7	J15	16.73	2
P16	J15	J16	52.81	2

Node Results:

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J1	0.00	420.76	43.58	0.00
J2	0.00	421.51	43.90	0.00
J3	0.00	422.27	44.23	0.00
J4	0.00	399.05	35.16	0.00
J5	1585.04	393.83	32.99	0.00
J6	0.00	393.83	32.99	0.00
J7	0.00	393.83	32.22	0.00
J8	0.00	395.05	33.89	0.00
J9	0.00	394.74	33.54	0.00
J10	1057.22	394.38	33.88	0.00
J11	0.00	394.38	34.22	0.00
J12	0.00	394.31	33.99	0.00
J13	0.00	394.30	34.06	0.00
J14	71.96	394.29	33.81	0.00

Node Results: (continued)

Node ID	Demand GPM	Head ft	Pressure psi	Quality
J15	0.00	393.15	31.92	0.00
J16	46.44	390.99	31.23	0.00
R1	2764.49	410.33	0.00	0.00 Reservoir
R2	-5525.15	459.86	0.00	0.00 Reservoir

Link Results:

Link ID	Flow GPM	Velocity fps	Unit Headloss ft/Kft	Status
P1	5525.15	35.27	332.18	Open
P2	-2764.49	17.65	92.14	Open
P3	-2764.49	17.65	92.13	Open
P4	2760.66	17.62	91.90	Open
P5	1631.48	18.51	140.87	Open
P6	0.00	0.00	0.00	Open
P7	46.44	0.53	0.19	Open
P8	1129.18	7.21	17.55	Open
P9	1129.18	7.21	17.55	Open
P10	1129.18	7.21	17.55	Open
P11	0.00	0.00	0.00	Open
P12	71.96	0.82	0.43	Open
P13	71.96	0.82	0.43	Open
P14	71.96	0.82	0.43	Open
P1.1	-2764.49	17.65	92.13	Open
P15	46.44	4.74	40.76	Open
P16	46.44	4.74	40.76	Open

APPENDIX L
FUS Fire Flow Calculations



Fire Flow Calculations - Proposed Building

LRL File No. 170132
 Project Hindu Heritage Centre
 Date October 31, 2022
 Method Fire Underwriters Survey (FUS)
 Designed by Philippe Paquette, C.E.T.

Step	Task	Term	Options	Multiplier	Choose:	Value	unit	Fire Flow	
Structural Framing Material									
1	Choose frame used for building	Coefficient C related to the type of construction	Wood Frame	1.5	Non-combustible construction	0.8			
			Ordinary Construction	1.0					
			Non-combustible construction	0.8					
			Fire resistive construction <2 hrs	0.7					
			Fire resistive construction >2 hrs	0.6					
Floor Space Area									
2	Choose type of housing	Type of housing	Single family dwelling	0	Building - no. of units per floor	1	unit(s)		
			Townhouse - no. of units	0					
			Building - no. of units per floor	1					
3	Enter area of a unit	Enter floor space area of one unit (excluding basement)		1	1576.0		sq.m.		
4	Obtain fire flow before reductions	Required fire flow	Fire Flow = 220 x C x Area^{0.5}					L/min	7,000
								L/s	116.7
Reductions or surcharge due to factors affecting burning									
5	Choose combustibility of contents	Occupancy hazard reduction or surcharge	Non-combustible	-0.25	Combustible	0			
			Limited combustible	-0.15					
			Combustible	0					
			Free burning	0.15					
			Rapid burning	0.25					
6	Choose reduction for sprinklers	Sprinkler reduction	Sprinklers (NFPA13)	-0.30	True	-0.3			
			Water supply is standard for both the system and fire department hose lines	-0.10	True	-0.1	L/min	3,500	
			Fully supervised system	-0.10	True	-0.1	L/s	58.3	
7	Choose separation	Exposure distance between units	North side	Over 45m	0				
			East side	Over 45m	0				
			South side	Over 45m	0		L/min	4,000	
			West side	Over 45m	0	0	L/s	66.7	
Net required fire flow									
8	Obtain fire flow, duration, and volume	Minimum required fire flow rate (rounded to nearest 1000)					L/min	4,000	
		Minimum required fire flow rate					L/s	66.7	
		Required duration of fire flow					hr	1.5	



Fire Flow Calculations - Existing Building

LRL File No. 170132
 Project Hindu Heritage Centre
 Date October 31, 2022
 Method Fire Underwriters Survey (FUS)
 Designed by Philippe Paquette, C.E.T.

Step	Task	Term	Options	Multiplier	Choose:	Value	unit	Fire Flow	
Structural Framing Material									
1	Choose frame used for building	Coefficient C related to the type of construction	Wood Frame	1.5	Non-combustible construction	0.8			
			Ordinary Construction	1.0					
			Non-combustible construction	0.8					
			Fire resistive construction <2 hrs	0.7					
			Fire resistive construction >2 hrs	0.6					
Floor Space Area									
2	Choose type of housing	Type of housing	Single family dwelling	0	Building - no. of units per floor	1	unit(s)		
			Townhouse - no. of units	0					
			Building - no. of units per floor	1					
3	Enter area of a unit	Enter floor space area of one unit (excluding basement)		1	1062.0		sq.m.		
4	Obtain fire flow before reductions	Required fire flow	Fire Flow = 220 x C x Area^{0.5}					L/min	6,000
								L/s	100.0
Reductions or surcharge due to factors affecting burning									
5	Choose combustibility of contents	Occupancy hazard reduction or surcharge	Non-combustible	-0.25	Limited combustible	-0.15			
			Limited combustible	-0.15					
			Combustible	0					
			Free burning	0.15					
			Rapid burning	0.25					
6	Choose reduction for sprinklers	Sprinkler reduction	Sprinklers (NFPA13)	-0.30	False	0			
			Water supply is standard for both the system and fire department hose lines	-0.10	False	0	L/min	6,000	
			Fully supervised system	-0.10	False	0	L/s	100.0	
7	Choose separation	Exposure distance between units	North side	Over 45m	0				
			East side	Over 45m	0				
			South side	Over 45m	0		L/min	6,000	
			West side	Over 45m	0	0	L/s	100.0	
Net required fire flow									
8	Obtain fire flow, duration, and volume					Minimum required fire flow rate (rounded to nearest 1000)	L/min	6,000	
						Minimum required fire flow rate	L/s	100.0	
						Required duration of fire flow	hr	2.0	

APPENDIX M
City of Ottawa Boundary Calculations

Boundary Conditions 4835 Bank Street

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	299	4.98
Maximum Daily Demand	449	7.48
Peak Hour	808	13.46
Fire Flow Demand #1	10,000	166.67

Location



Results – Existing Conditions

Connection 1 – Bank St.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	154.6	79.3
Peak Hour	142.9	62.7
Max Day plus Fire 1	125.1	37.4

Ground Elevation = 98.8 m

Results – SUC Zone Reconfiguration

Connection 1 – Bank St.

Demand Scenario	Head (m)	Pressure¹ (psi)
Maximum HGL	148.9	71.2
Peak Hour	144.5	65.0
Max Day plus Fire 1	140.2	59.0

Ground Elevation = 98.8 m

Notes

1. A second connection to the watermain, separated by an isolation valve, is required to decrease vulnerability of the water system in case of breaks.

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

APPENDIX N

1/5 Year & 1/100 Year SWM Storage Tables



LRL File No. 170132
Project: Hindu Heritage Centre
Location: 4835 Bank Street, Ottawa
Date: October 31, 2022
Designed: K. Herold
Checked: M. Basnet
Drawing Ref.: C.401

**Stormwater Management
Design Sheet**

STORM - 100 YEAR

Runoff Equation

Q = 2.78CIA (L/s)
 C = Runoff coefficient
 I = Rainfall intensity (mm/hr) = $A / (Td + C)^B$
 A = Area (ha)
 T_c = Time of concentration (min)

Pre-Development Catchments within Development Area

	Total Area =	2.223	ha	ΣR=	0.49
Un-Controlled	EWS-01	2.223	ha	R=	0.49
	Total Uncontrolled =	2.223	ha	ΣR=	0.49

Allowable Release Rate (Max C=0.5, 5-year Pre-Dev FR)

5 Year Pre-Development Flow Rate

$I_5 = 998.071 / (Td + 6.053)^{0.814}$
a = 998.071
b = 0.814
C = 6.053

C = 0.49 the smaller of 0.5 or the actual existing as per the City of Ottawa
 I = 104.2 mm/hr
 T_c = 10 min
 Total = 2.223 ha
Allowable Release Rate= 316.44 L/s
Controlled Release Rate= 67.00 L/s

Post-development Stormwater Management

	Total Site Area =	2.223	ha	ΣR=	0.53	ΣR₁₀₀	0.67
Controlled	Total Controlled =	1.316	ha	ΣR=	0.59	ΣR₁₀₀	0.74
Un-controlled	Total Un-Controlled =	0.907	ha	ΣR=	0.44	ΣR₁₀₀	0.55

Post-development Stormwater Management

$I_{100} = 1735.688 / (Td + 6.014)^{0.820}$
a = 1735.688
b = 0.82
C = 6.014

* for volume calculation, controlled release rate taken as half of the discharge rate of 67.00L/s

Time (min)	Intensity (mm/hr)	Controlled Runoff** (L/s)	Storage Volume (m ³)	Controlled Release Rate (L/s)	Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
10	178.6	485.47	271.18	33.50	249.38	282.88
15	142.9	388.51	319.51	33.50	199.57	233.07
20	120.0	326.13	351.15	33.50	167.52	201.02
25	103.8	282.34	373.27	33.50	145.03	178.53
30	91.9	249.77	389.29	33.50	128.30	161.80
35	82.6	224.52	401.14	33.50	115.33	148.83
40	75.1	204.31	409.94	33.50	104.95	138.45
45	69.1	187.74	416.44	33.50	96.44	129.94
50	64.0	173.88	421.14	33.50	89.32	122.82
55	59.6	162.11	424.40	33.50	83.27	116.77
60	55.9	151.97	426.49	33.50	78.06	111.56
65	52.6	143.14	427.59	33.50	73.53	107.03
70	49.8	135.37	427.85	33.50	69.54	103.04
75	47.3	128.48	427.41	33.50	66.00	99.50
80	45.0	122.32	426.35	33.50	62.83	96.33
160	26.2	71.34	363.27	33.50	36.65	70.15



LRL File No. 170132
Project: Hindu Heritage Centre
Location: 4835 Bank Street, Ottawa
Date: October 31, 2022
Designed: K. Herold
Checked: M. Basnet
Drawing Ref.: C.401

Stormwater Management
Design Sheet

STORM - 100 YEAR

Onsite Stormwater Retention

Total Storage Required =	427.85 m³	
Pipe Storage =	0.00 m ³	
CB/MH Storage =	0.00 m ³	
Underground Storage =	0.00 m ³	
Surface/Detention Area Storage =	428.14 m ³	refer to LRL Plans C301 & C601
Total Available Storage =	428.14 m³	



LRL File No. 170132
Project: Hindu Heritage Centre
Location: 4835 Bank Street, Ottawa
Date: October 31, 2022
Designed: K. Herold
Checked: M. Basnet
Drawing Ref.: C.401

**Stormwater Management
Design Sheet**

STORM - 5 YEAR

Runoff Equation

$Q = 2.78CIA \text{ (L/s)}$
 C = Runoff coefficient
 $I = \text{Rainfall intensity (mm/hr)} = A / (T_d + C)^B$
 A = Area (ha)
 $T_c = \text{Time of concentration (min)}$

Pre-Development Catchments within Development Area

	Total Area =	2.223	ha	$\Sigma R =$	0.49
Un-Controlled	EWS-01	2.223	ha	R =	0.49
	Total Uncontrolled =	2.223	ha	$\Sigma R =$	0.49

Allowable Release Rate (Max C=0.5, 5-year Pre-Dev FR)

5 Year Pre-Development Flow Rate

$I_5 = 998.071 / (T_d + 6.053)^{0.814}$
 $a = 998.071$
 $b = 0.814$
 $C = 6.053$

C = 0.49 the smaller of 0.5 or the actual existing as per the City of Ottawa
 I = 104.2 mm/hr
 $T_c = 10$ min
 Total = 2.223 ha
Allowable Release Rate = 316.44 L/s
Controlled Release Rate = 48.00 L/s

Post-Development Stormwater Management (Storage Calculations)

	Total Site Area =	2.223	ha	$\Sigma R =$	0.53	ΣR_{100}	0.67
Controlled	Total Controlled =	1.316	ha	$\Sigma R =$	0.59		0.74
Un-controlled	Total Un-Controlled =	0.907	ha	$\Sigma R =$	0.44		0.55

Post-development Stormwater Management

$I_5 = 998.071 / (T_d + 6.053)^{0.814}$
 $a = 998.071$
 $b = 0.814$
 $C = 6.053$

* for volume calculation, controlled release rate taken as half of the discharge rate of 48.00L/s

Time (min)	Intensity (mm/hr)	Controlled			Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
		Controlled Runoff** (L/s)	Storage Volume (m ³)	Release Rate (L/s)		
5	141.2	307.07	84.92	24.00	157.74	181.74
10	104.2	226.63	121.58	24.00	116.41	140.41
15	83.6	181.74	141.97	24.00	93.36	117.36
20	70.3	152.80	154.56	24.00	78.49	102.49
30	53.9	117.30	167.93	24.00	60.25	84.25
35	48.5	105.53	171.21	24.00	54.21	78.21
40	44.2	96.10	173.05	24.00	49.37	73.37
45	40.6	88.37	173.80	24.00	45.39	69.39
50	37.7	81.90	173.70	24.00	42.07	66.07
60	32.9	71.65	171.56	24.00	36.81	60.81
70	29.4	63.89	167.52	24.00	32.82	56.82
80	26.6	57.77	162.12	24.00	29.68	53.68
90	24.3	52.83	155.68	24.00	27.14	51.14



LRL File No. 170132
Project: Hindu Heritage Centre
Location: 4835 Bank Street, Ottawa
Date: October 31, 2022
Designed: K. Herold
Checked: M. Basnet
Drawing Ref.: C.401

**Stormwater Management
Design Sheet**

STORM - 5 YEAR

Onsite Stormwater Retention

Total Storage Required =	173.80 m³	
Pipe Storage =	0.00 m ³	
CB/MH Storage =	0.00 m ³	
Underground Storage =	0.00 m ³	
Surface/Detention Area Storage =	210.92 m ³	refer to LRL Plans C301 & C601
Total Available Storage =	210.92 m³	

LRL Associates Ltd.
Storm Watershed Summary



LRL

ENGINEERING | INGÉNIERIE

LRL File No.	170132
Project:	Hindu Heritage Centre
Location:	4835 Bank Street, Ottawa
Date:	October 31, 2022
Designed:	K. Herold
Checked:	M. Basnet
Drawing Reference:	C.701, C.702

Pre-Development Catchments

WATERSHED	C = 0.20	C = 0.8	C = 0.90	Total Area (ha)	Combined C
EWS-01	1.298	0.000	0.926	2.223	0.49
TOTAL	1.298	0.000	0.926	2.223	0.49

Post-Development Catchments

WATERSHED	C = 0.20	C = 0.8	C = 0.90	Total Area (ha)	Combined C
WS-01 (CONTROLLED)	0.571	0.023	0.722	1.316	0.59
TOTAL CONTROL	0.571	0.023	0.722	1.316	0.59
WS-02 (UNCONTROLLED)	0.112	0.000	0.299	0.411	0.71
WS-03 (UNCONTROLLED)	0.454	0.000	0.016	0.470	0.22
WS-04 (UNCONTROLLED)	0.026	0.000	0.000	0.026	0.20
TOTAL UNCONTROLLED	0.592	0.000	0.315	0.907	0.44
TOTAL	1.163	0.023	1.037	2.223	0.53

APPENDIX O
Civil Engineering Plans

EROSION AND SEDIMENT CONTROL MEASURES:

**** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES ****

*****THE SEDIMENT AND EROSION CONTROL MEASURES MAY BE MODIFIED IN THE FIELD AT THE DISCRETION OF THE CITY OF OTTAWA SITE INSPECTOR OR CONSERVATION AUTHORITY*****

1. PRIOR TO START OF CONSTRUCTION:




- PRIOR TO THE REMOVAL OF ANY VEGETATIVE COVER, MOVING OF SOIL AND CONSTRUCTION:
- INSTALL SILT FENCE IMMEDIATELY DOWNSTREAM FROM AREAS TO BE DISTURBED (SEE PLAN FOR LOCATION).
- INSTALL GEOSOCK INSERTS WITH AN OVERFLOW IN ALL THE DOWNSTREAM CATCHBASINS AND MANHOLES
- INSTALL SILT TRAP FILTERS IN ALL CONCRETE CATCH BASIN STRUCTURES
- INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.

2. DURING CONSTRUCTION:

- WORK TO BE DONE IN THE VICINITY OF MAJOR WATERWAYS TO BE CARRIED OUT FROM JULY TO SEPTEMBER ONLY.
- MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE.
- PROTECT DISTURBED AREAS FROM RUNOFF.
- PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
- INSPECT SILT FENCES, FILTER CLOTHS AND CATCH BASIN SUMPS WEEKLY AND AFTER EVERY MAJOR STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
- CONSTRUCT SWALES AS PER DETAIL.
- PLAN TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION
- EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES.
- DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE THE PILE IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS).
- CONTROL WIND-BLOWN DUST OFF SITE TO ACCEPTABLE LEVELS BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED).
- ALL EROSION CONTROL STRUCTURES TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
- NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THIS CONSULTING ENGINEER AND THE CITY DEPARTMENT OF PUBLIC WORKS.
- CONTRACTOR RESPONSIBLE FOR CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING ETC. AT THE END OF EACH WORK DAY.
- PROVIDE GRAVEL ENTRANCE WHEREVER EQUIPMENT LEAVES THE SITE TO PREVENT MUD TRACKING ONTO PAVED SURFACES. GRAVEL BED SHALL BE A MINIMUM OF 15m LONG, 4M WIDE AND 0.3m DEEP AND SHALL CONSIST OF COARSE (50mm CRUSHER-RUN LIMESTONE) MATERIAL. MAINTAIN GRAVEL ENTRANCE IN CLEAN CONDITION.
- DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
- ANY MUD/MATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
- TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ADJUTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.

3. AFTER CONSTRUCTION:

- PROVIDE PERMANENT COVER CONSISTING OF TOPSOIL AND SEED TO DISTURBED AREAS.
- REMOVE STRAW BALE FLOW CHECK DAMS, SILT FENCES AND FILTER CLOTHS ON CATCH BASINS AND MANHOLE COVERS AFTER DISTURBED AREAS HAVE BEEN REHABILITATED AND STABILIZED.
- INSPECT AND CLEAN CATCH BASIN SUMPS AND STORM SEWERS.

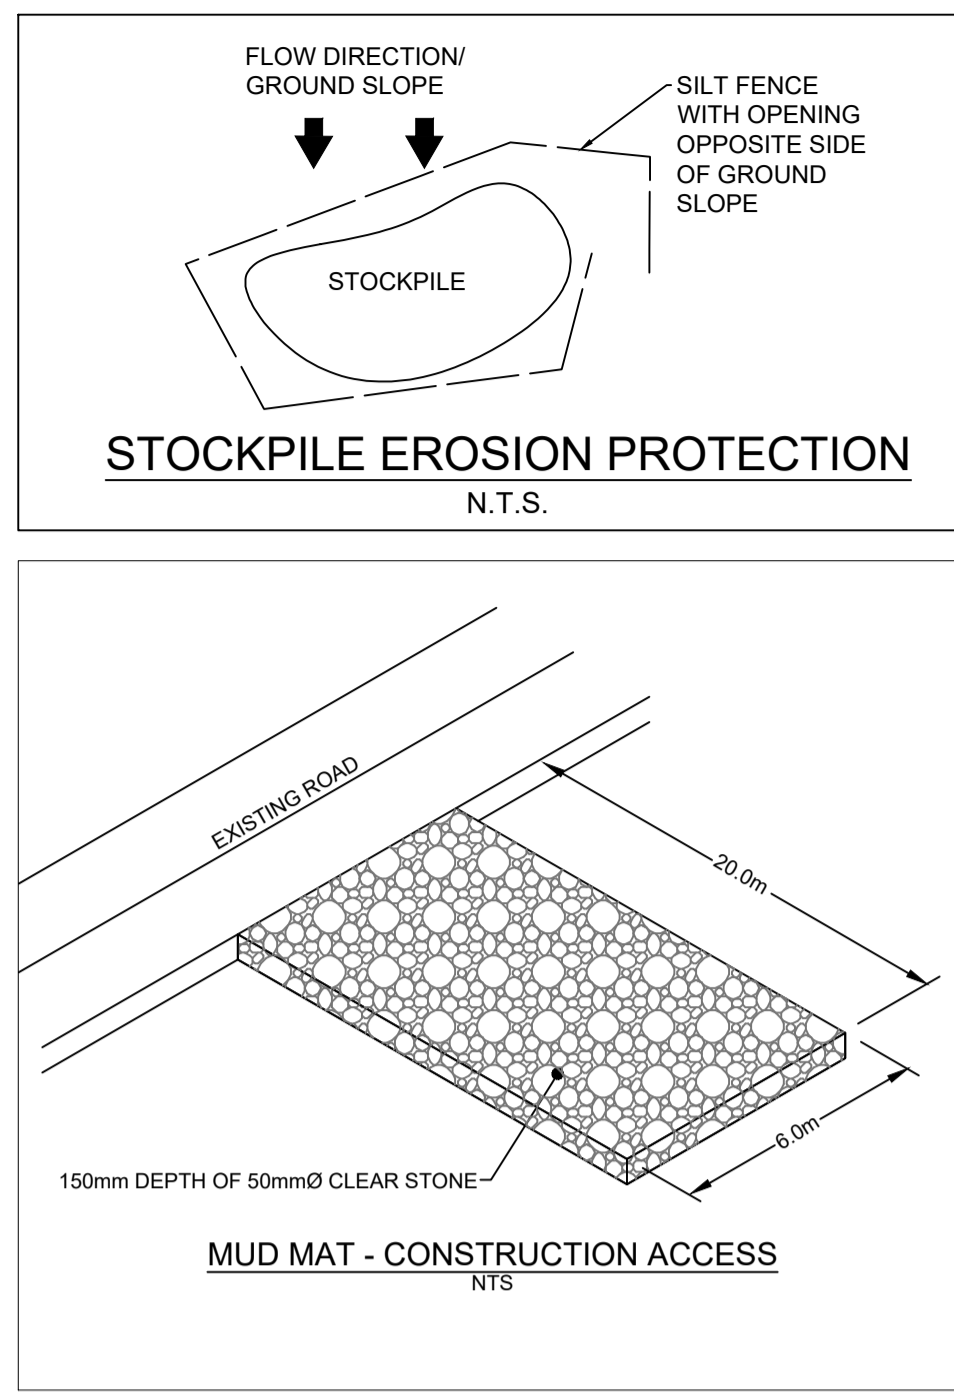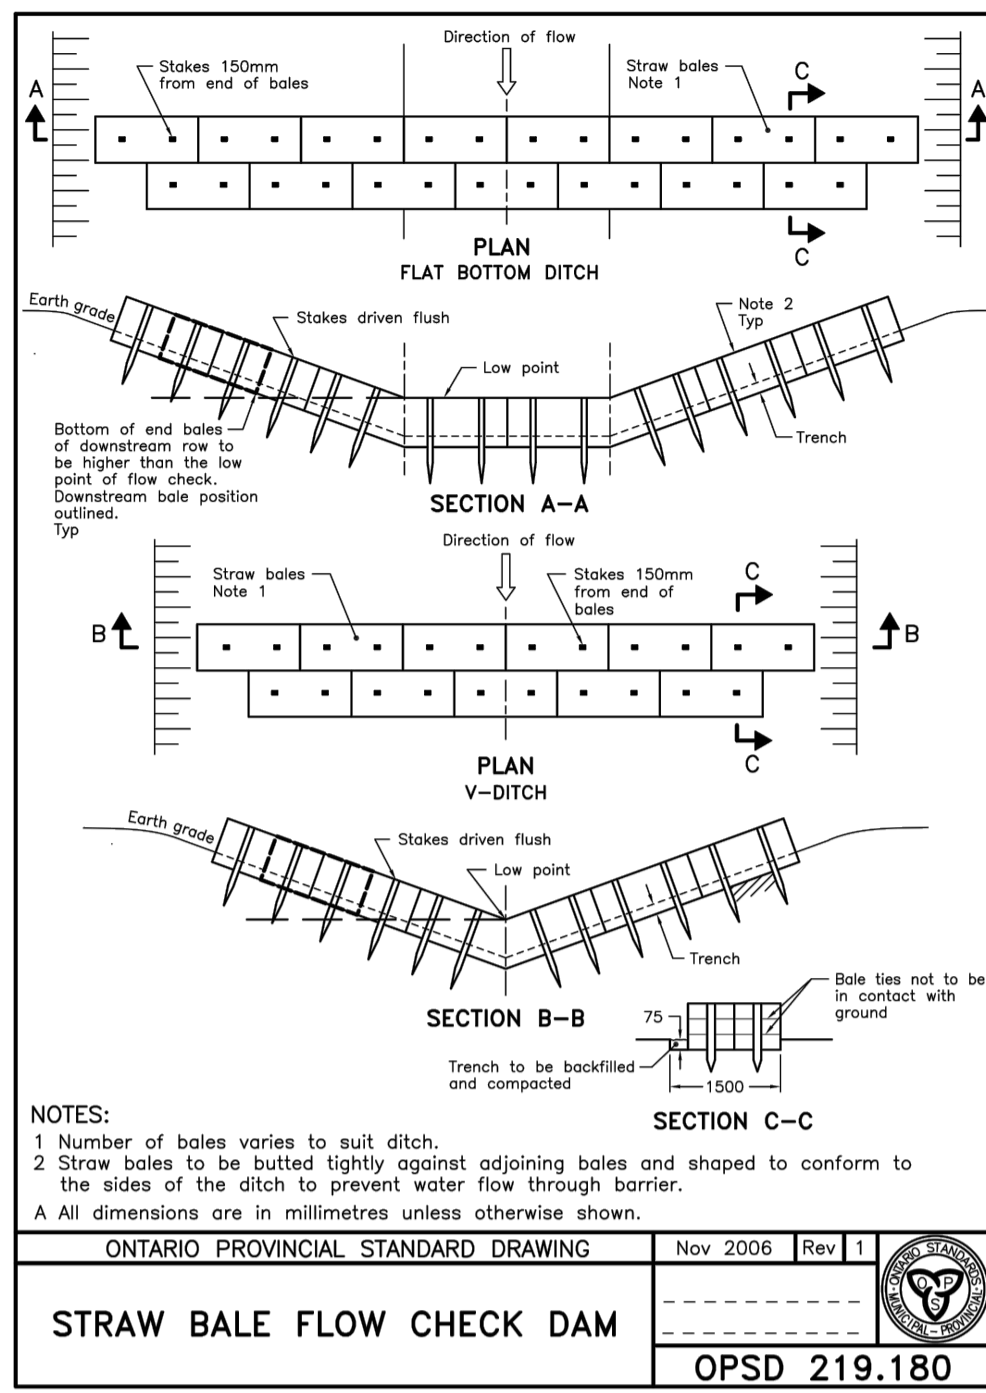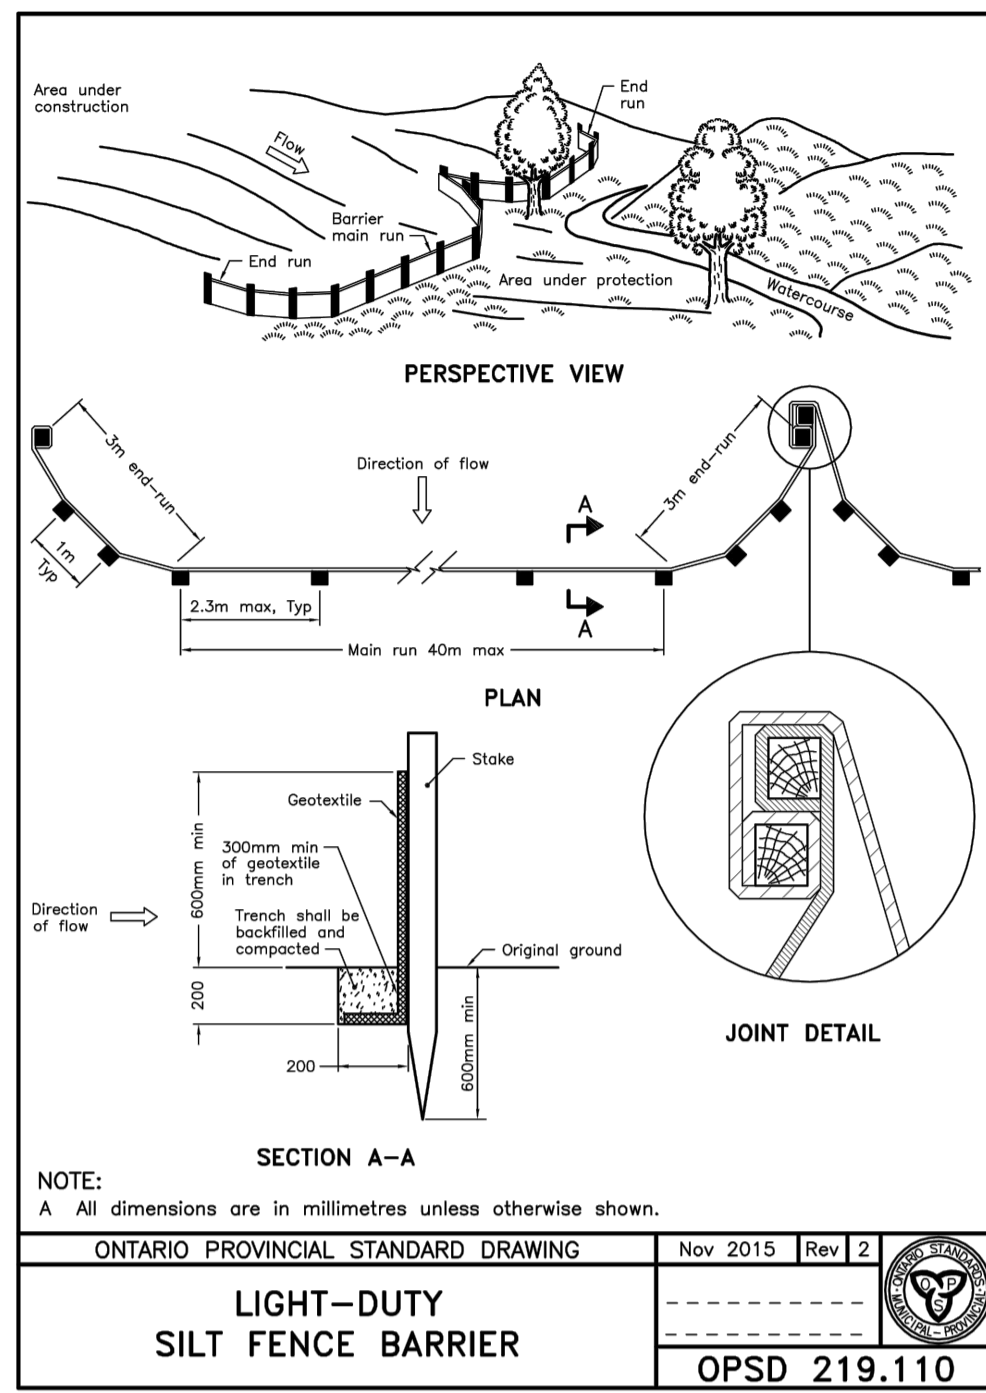

LEGEND:

	EXISTING PROPERTY LINE
	PROPOSED CURB
	PROPOSED DEPRESSED CURB
	PROPOSED TERRACING (3:1 MAX.)
	PROPOSED SILT FENCE AS PER OPSD 219.110
	PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
	PROPOSED DOOR ENTRANCE/EXIT
	PROPOSED LANDSCAPED AREA
	PROPOSED CONCRETE FEATURES/SLAB
	PROPOSED HEAVY-DUTY ASPHALT
	PROPOSED LIGHT-DUTY ASPHALT
	PROPOSED RIP RAP
	PROPOSED ELEVATION
	PROPOSED HIGH POINT ELEVATION
	PROPOSED SWALE ELEVATION
	PROPOSED BOTTOM OF CURB ELEVATION
	PROPOSED TOP OF CURB ELEVATION
	MATCH INTO EXISTING ELEVATION
	EXISTING ELEVATION
	PROPOSED OVERLAND MAJOR FLOW ROUTE
	PROPOSED 100mm PERFORATED SUBDRAIN
	PROPOSED STORM SEWER
	PROPOSED SANITARY SEWER
	PROPOSED WATERMAIN
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING WATERMAIN
	EXISTING MANHOLE
	EXISTING CATCHBASIN
	PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
	PROPOSED STC300
	PROPOSED CURB STOP
	PROPOSED PIPE INSULATION
	PROPOSED 20m SETBACK
	PROPOSED 100 YEAR HIGH WATER LEVEL
	STORM WATERSHED EXTENT
	WATERSHED NAME
	RUNOFF COEFFICIENT
	AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE WORK AND INTENT OF THE DRAWINGS. THE CONTRACTOR SHALL REVIEW AND UNDERSTAND THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY NOT BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE, NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES, TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

GENERAL NOTES:

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

10m 5m 0 5m 10m 20m
SCALE: 1:500

TOPOGRAPHIC INFORMATION
TOPOGRAPHIC INFORMATION PROVIDED BY ANNS, O'SULLIVAN, VOLLEBECK LTD.
PROJECT NO. 19814-17 HINDU TEMPLE
DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017


ELEVATION NOTES

1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that it's relative elevation and description agrees with the information shown on this drawing.
3. Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES

1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
2. Only visible surface utilities were located.
3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
SITE AREA = 4.048 Hectares.

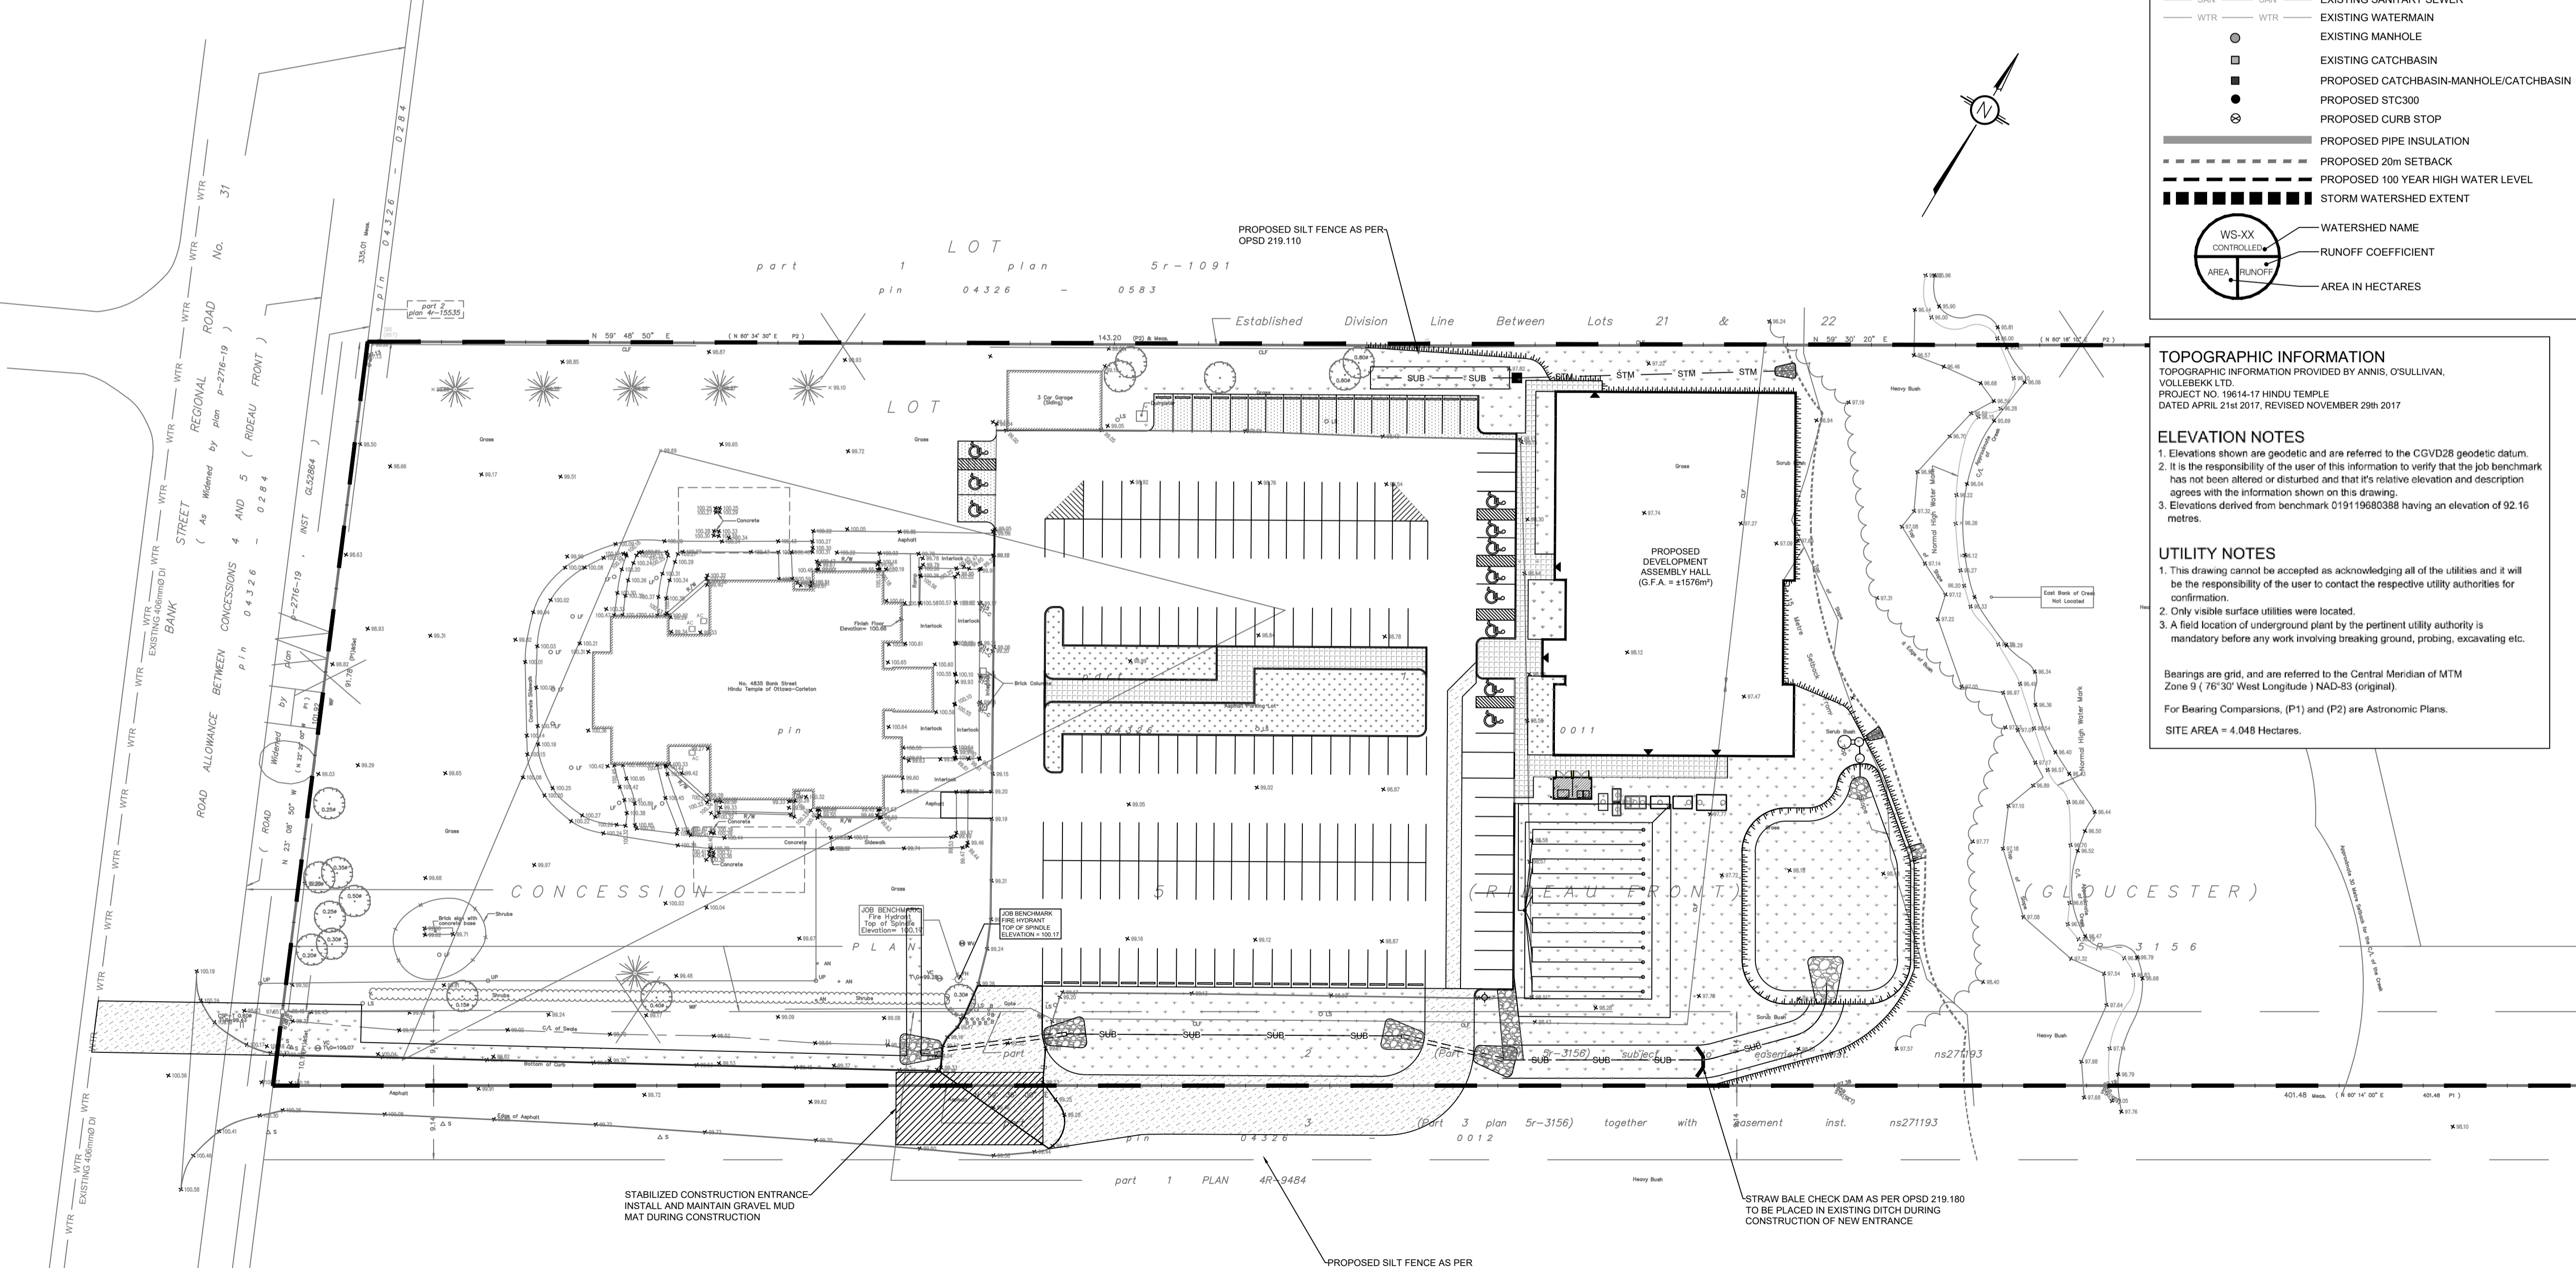

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRL
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON**

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: **PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA**

DRAWING TITLE: **EROSION AND SEDIMENT CONTROL PLAN**

PROJECT NO. 170132
DATE: JAN2020

C101

File no.: D017-12-20-0059



KEY PLAN
N.T.S.

TOPOGRAPHIC INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEK LTD.
PROJECT NO. 19614-17 HINDU TEMPLE
DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES

- Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
- Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES

- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.


Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
SITE AREA = 4.048 Hectares.

LEGEND:

	EXISTING PROPERTY LINE
	PROPOSED CURB
	PROPOSED DEPRESSED CURB
	PROPOSED TERRACING (3:1 MAX.)
	PROPOSED SILT FENCE AS PER OPSD 219.110
	PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
	PROPOSED DOOR ENTRANCE/EXIT
	PROPOSED LANDSCAPED AREA
	PROPOSED CONCRETE FEATURES/SLAB
	PROPOSED HEAVY-DUTY ASPHALT
	PROPOSED LIGHT-DUTY ASPHALT
	PROPOSED RIP RAP
	PROPOSED ELEVATION
	PROPOSED HIGH POINT ELEVATION
	PROPOSED SWALE ELEVATION
	PROPOSED BOTTOM OF CURB ELEVATION
	PROPOSED TOP OF CURB ELEVATION
	MATCH INTO EXISTING ELEVATION
	EXISTING ELEVATION
	PROPOSED OVERLAND MAJOR FLOW ROUTE
	PROPOSED 100mmØ PERFORATED SUBDRAIN
	PROPOSED STORM SEWER
	PROPOSED SANITARY SEWER
	PROPOSED WATERMAIN
	EXISTING STORM SEWER
	EXISTING SANITARY SEWER
	EXISTING WATERMAIN
	EXISTING MANHOLE
	EXISTING CATCHBASIN
	PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
	PROPOSED STC300
	PROPOSED CURB STOP
	PROPOSED PIPE INSULATION
	PROPOSED 20m SETBACK
	PROPOSED 100 YEAR HIGH WATER LEVEL
	STORM WATERSHED EXTENT
	WATERSHED NAME
	RUNOFF COEFFICIENT
	AREA IN HECTARES

SITE PLAN NOTES:

- PROPOSED DEVELOPMENT
- PROPOSED GARBAGE / WASTE CONTAINERS LOCATION (REFER TO ARCH SITE PLAN)
- PROPOSED NO PARKING AREA FOR GARBAGE & LOADING AREA (WITH NO PARKING SIGNS/PAVEMENT MARKINGS)
- PROPOSED PAVEMENT MARKINGS FOR FIRE ROUTE
- PROPOSED CONCRETE BARRIER CURB AS PER OPSD 600.110
- PROPOSED ACCESSIBLE SPACES C/W LINE PAINTING
- EXISTING ASPHALT TO REMAIN
- EXISTING ASPHALT PARKING LOT TO BE REMOVED & REPLACED WITH 100mm TOPSOIL & SOD
- PROPOSED LIGHT DUTY PAVEMENT STRUCTURE
- PROPOSED HEAVY TRAFFIC PAVEMENT STRUCTURE
- PROPOSED LANDSCAPING (AS PER LANDSCAPING PLAN)
- PROPOSED FIRE ROUTE
- PROPOSED FIRE ROUTE SIGNAGE
- PROPOSED ROOF DRAINAGE OUTLET
- 30 x 45 cm "DISABLED PARKING PERMIT" SIGN (Rb-03) AS PER MTO BOOK 5 AND AS PER SECTION 11 OF THE ONTARIO REGULATION 581/90. SIGN TO BE MOUNTED ON BUILDING WALL OR POST
- PROPOSED CONCRETE WALKWAY, AND VEHICULAR ACCESS ROUTE TO REAR SITE
- PROPOSED PRECAST CONCRETE BUMPER CURBS
- PROPOSED SEPTIC TANKS & LEACHING BED (REFER TO SEPTIC DESIGN BY GREEN VALLEY ENVIRONMENTAL)
- PROPOSED CATCHBASIN & INFILTRATION GALLERY
- PROPOSED STORMWATER DETENTION AREA
- EXISTING CULVERT TO BE REMOVED AND REPLACED
- PROP RIP-RAP FOR DEPRESSED CURBS & PIPE OUTLET
- PROPOSED FIRE HYDRANT
- PROPOSED TACTILE WALKING SURFACE INDICATOR AS PER CITY OF OTTAWA ACCESSIBILITY DESIGN STANDARDS SECTIONS 2.7 & 3.4.6.
- EXISTING LIGHT STANDARD TO REMAIN
- PROPOSED STORMWATER QUANTITY CONTROL AND TREATMENT UNITS
- PROPOSED DITCH W/ SUBDRAIN

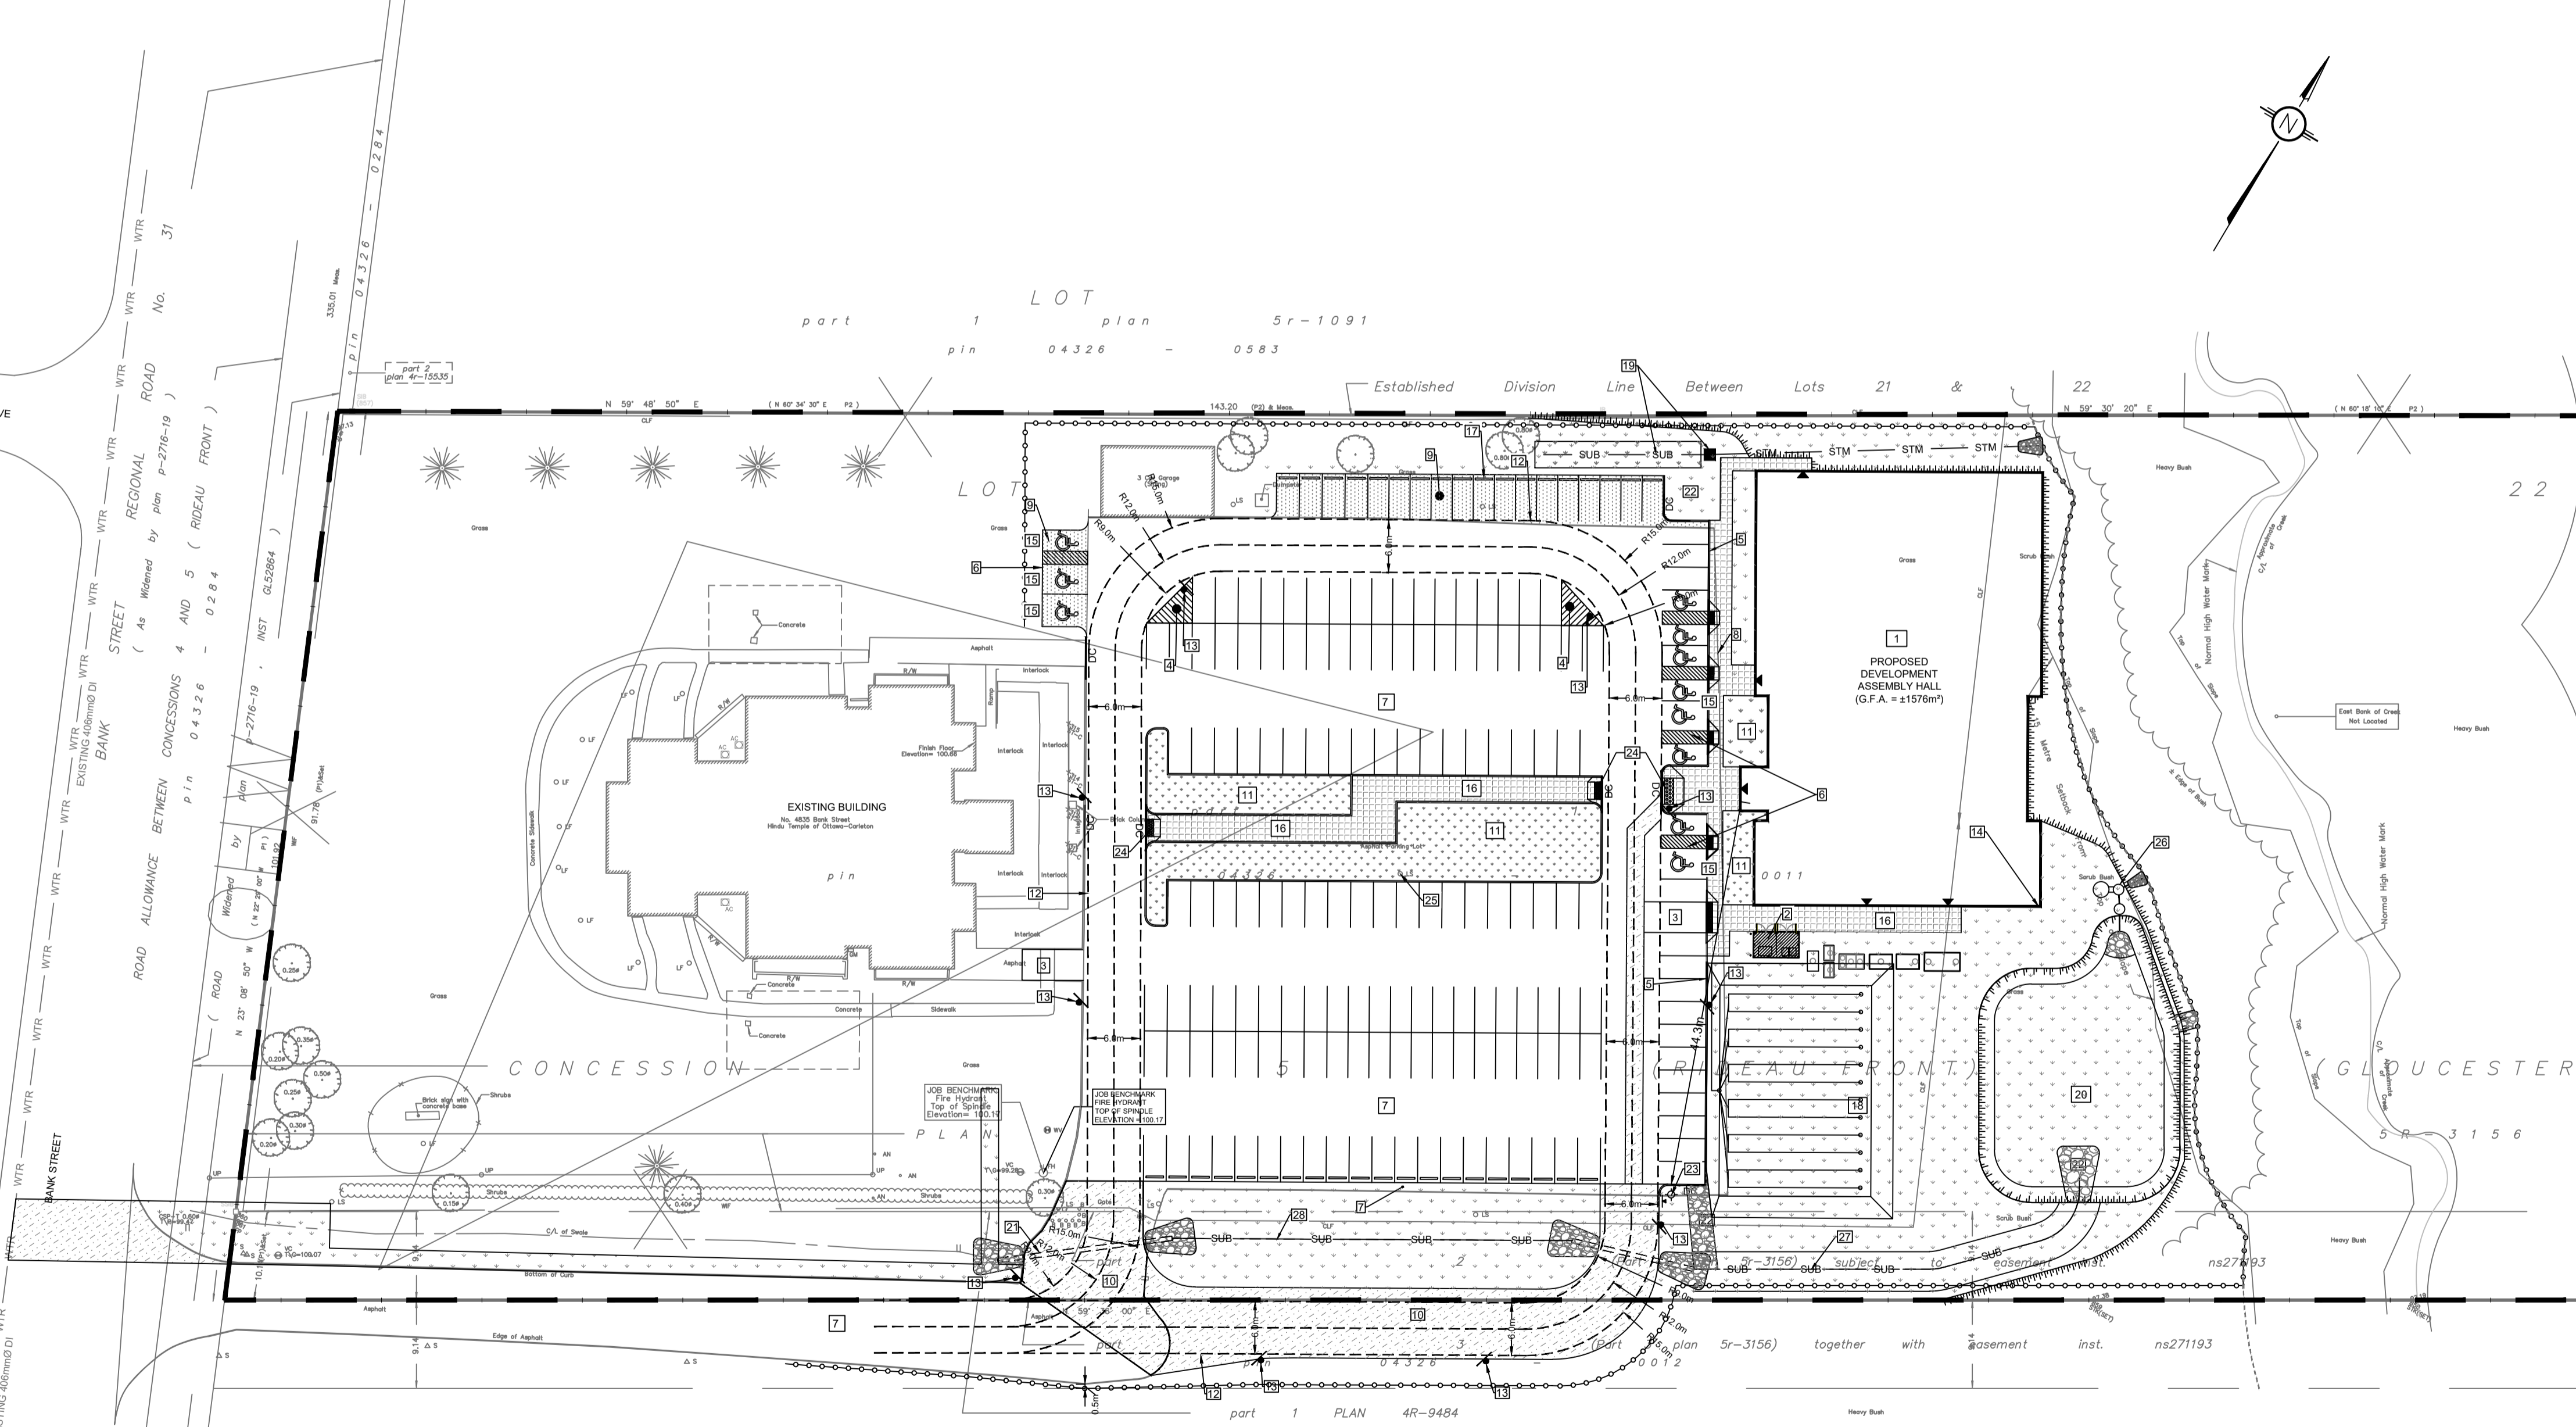

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE SCOPE AND INTENT OF THE DRAWINGS. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS A KNOWLEDGEABLE ACCEPTANCE OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRI ASSOCIATES LTD. (LRI) WITHOUT OBTAINING LRI'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRI AND TO RELEASE LRI FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRI FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRI'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRI AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRI AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lri.ca | (613) 842-3434

CLIENT: **THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON**




DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: **PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA**

DRAWING TITLE: **SITE DEVELOPMENT PLAN**

PROJECT NO. 170132
DATE: JAN 2020

C201

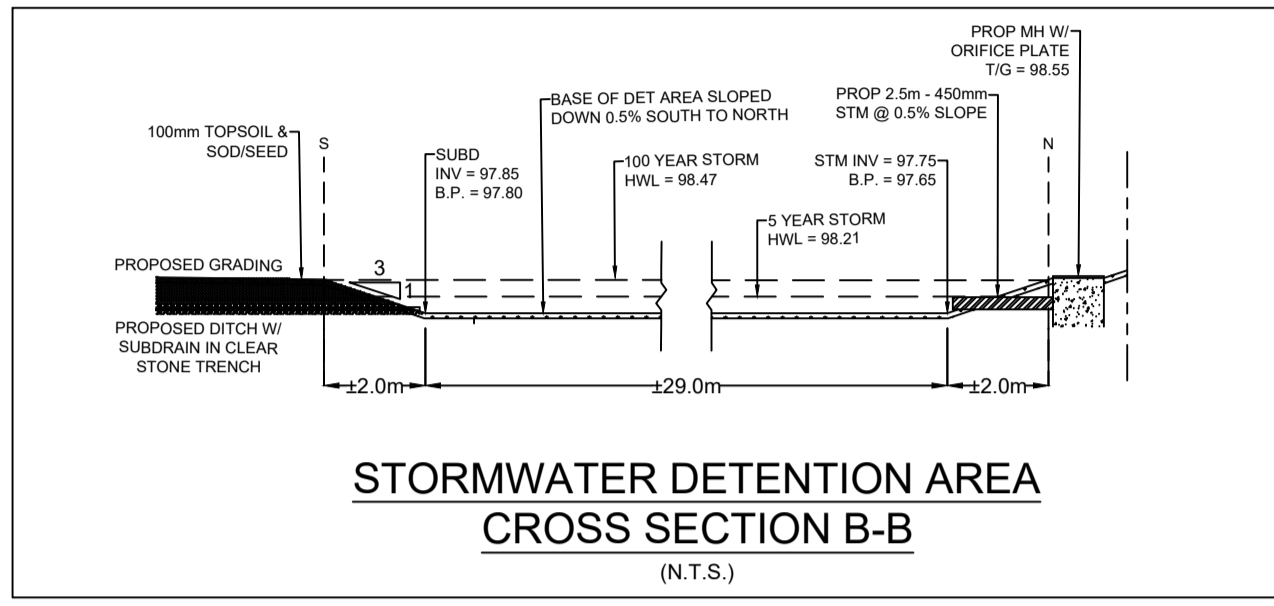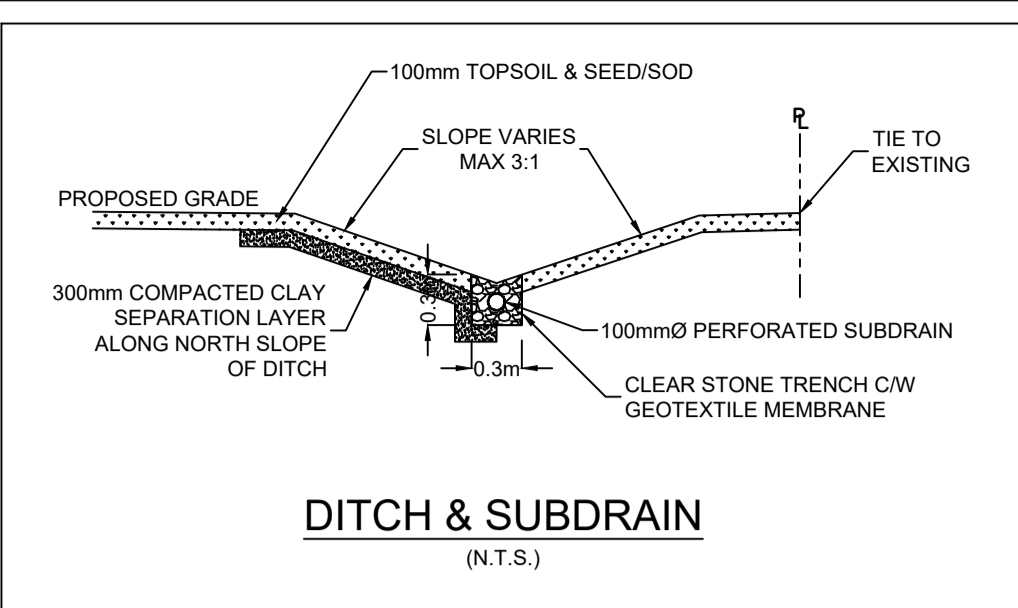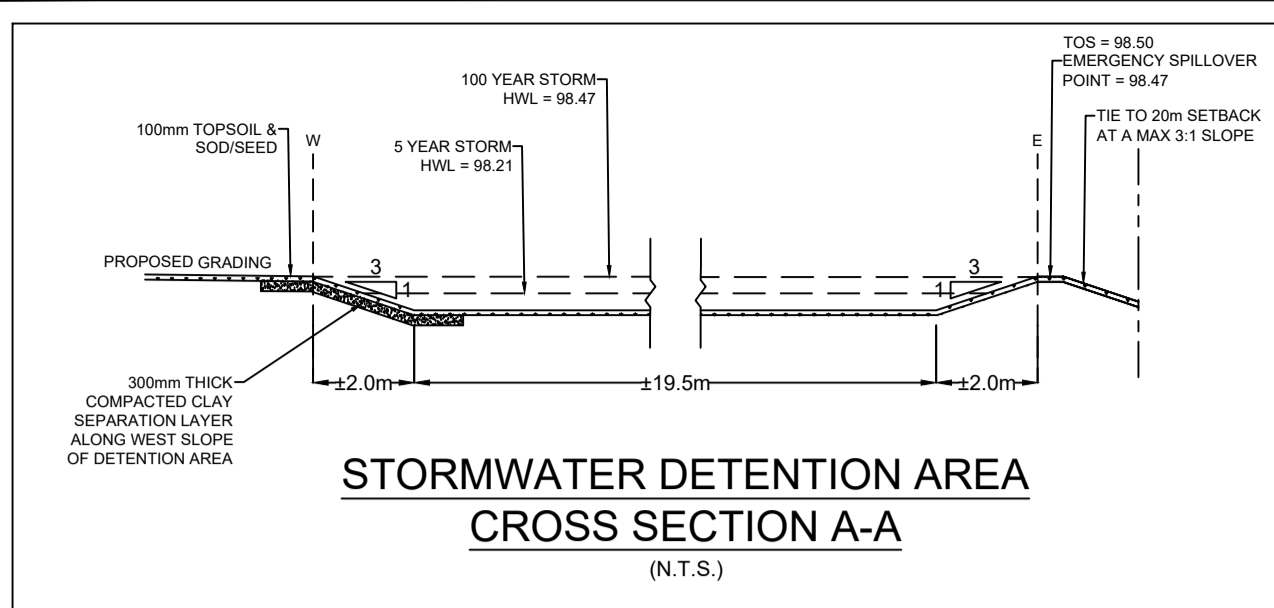


PAVEMENT STRUCTURE

COURSE	MATERIAL	THICKNESS (mm)	
		AUTOMOBILE PARKING	TRUCK ROUTE (HEAVY TRAFFIC)
SURFACE	HL.3 A/C (PG 58-34)	50	40
BINDER	HL.8 A/C (PG 58-34)	--	50
BASECOURSE	GRANULAR "A"	150	150
SUBBASE	GRANULAR "B" TYPE II	350	450

NOTE: IN PREPARATION FOR PAVEMENT CONSTRUCTION AT THIS SITE, ANY SURFICIAL OR NEAR SURFACE/SUBGRADE LEVEL TOPSOIL AND ANY SOFT, WET OR DELETERIOUS MATERIALS SHOULD BE REMOVED FROM THE PROPOSED PAVED AREAS. THE EXPOSED SUBGRADE SHOULD BE INSPECTED AND APPROVED BY GEOTECHNICAL PERSONNEL AND ANY SOFT AREAS EVIDENT SHOULD BE SUBCAVATED AND REPLACED WITH SUITABLE EARTH BORROW APPROVED BY THE GEOTECHNICAL ENGINEER. THE SUBGRADE SHOULD BE SHAPED AND CROWNED TO PROMOTE DRAINAGE OF THE SITE DRAINAGE STRUCTURES. FOLLOWING APPROVAL OF THE PREPARATION OF THE SUBGRADE, THE PAVEMENT GRANULARS MAY BE PLACED. PAVEMENT STRUCTURE AS PER THE GEOTECHNICAL REPORT PREPARED BY LRL ASSOCIATES DATED NOVEMBER 2019.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mm PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STREET STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

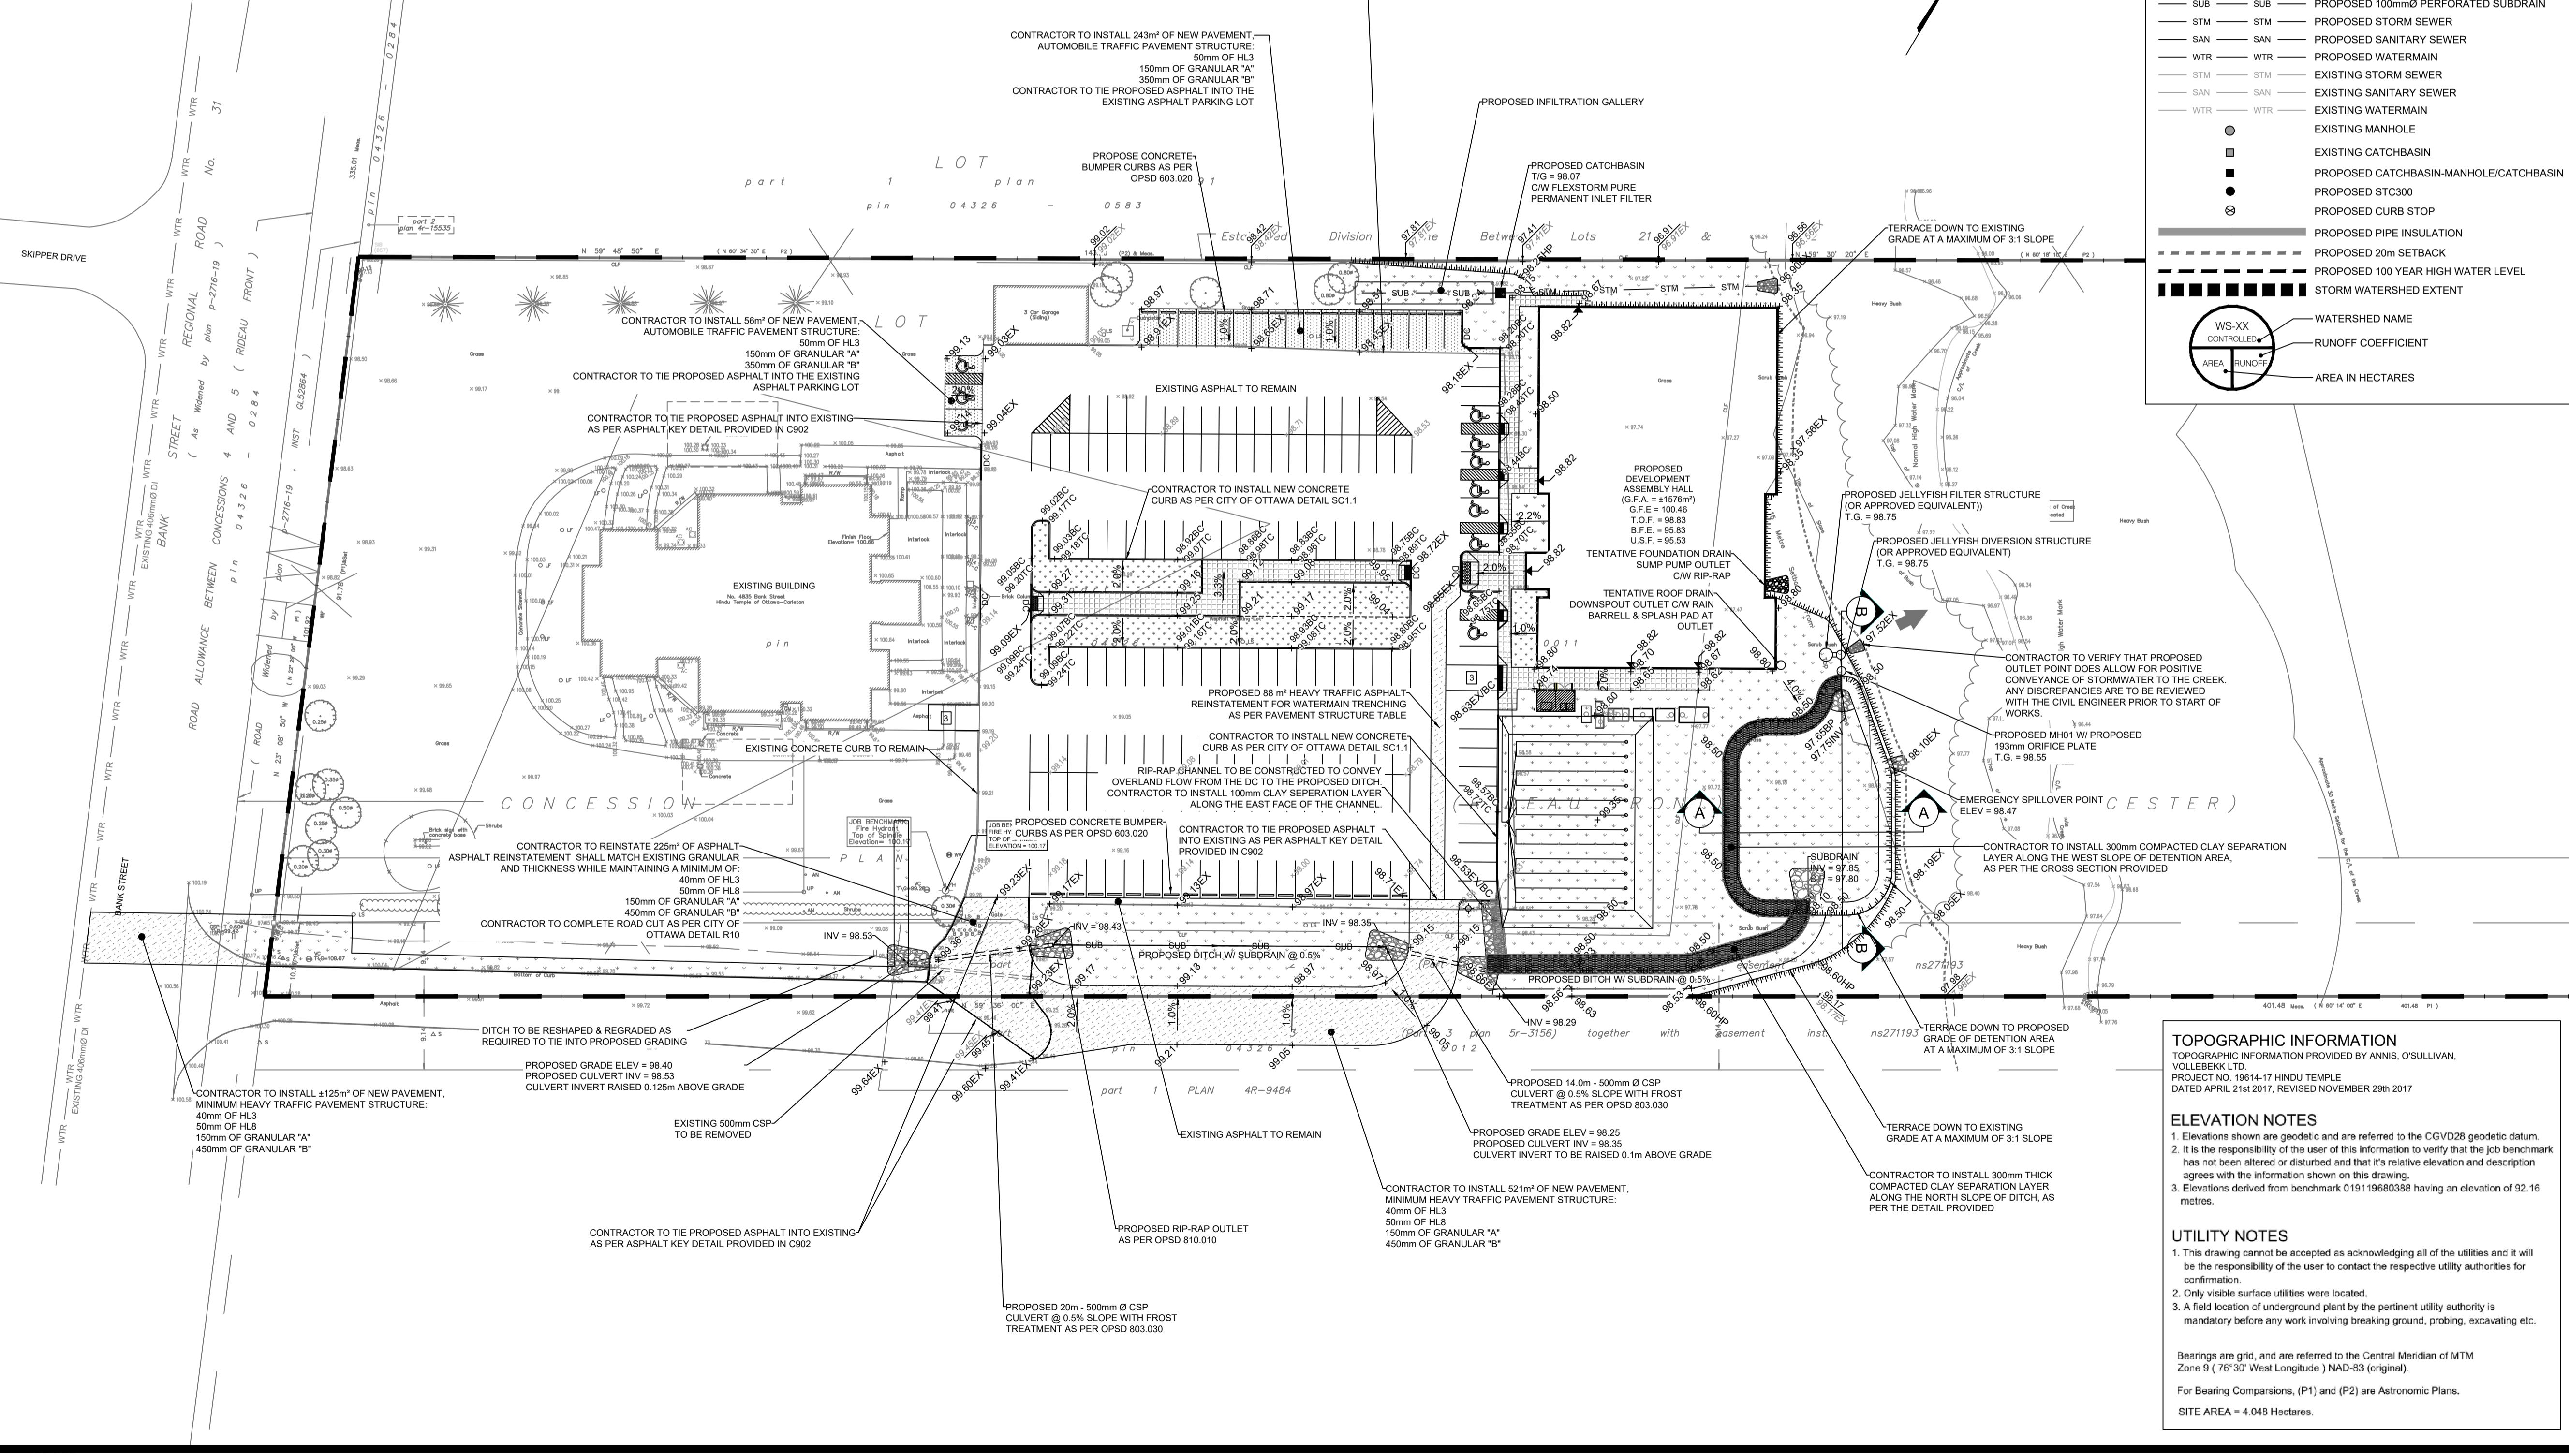

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROVAL LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DRAWINGS INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



LRL
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: **THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON**

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: **PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA**

DRAWING TITLE: **GRADING AND DRAINAGE PLAN**

PROJECT NO: 170132
DATE: JAN2020
SHEET NO: **C301**

TOPOGRAPHIC INFORMATION
TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEKK LTD.
PROJECT NO. 19614-17 HINDU TEMPLE
DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES

- Elevations shown are geoidic and are referred to the CGVD28 geoidic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
- Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES

- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground utility by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
SITE AREA = 4.048 Hectares.

NOTES: GENERAL

- CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT FOR CONSTRUCTION PURPOSES.
- ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS.
- JOB BENCH MARK - CONFIRM WITH LRL PRIOR TO UTILIZATION.
- ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALE, CATCH BASIN OUTLETS AND/OR STORM DETENTION AREAS ARE PROVIDED.
- STRIP AND REMOVE ALL TOPSOIL FROM IMPROVED AREAS.
- COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A CLEAN STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. PAVEMENT REINSTATEMENT SHALL BE WITH STEP JOINTS OF 500mm WIDTH MINIMUM.
- CURBS TO BE BARRIER, CONSTRUCTED AS PER OPSD 600.110.
- ALL MATERIAL SUPPLIED AND PLACED FOR PARKING LOT AND ACCESS ROAD CONSTRUCTION SHALL BE TO OPSD STANDARDS AND SPECIFICATIONS UNLESS OTHERWISE NOTED. CONSTRUCTION TO OPSD 206, 310 & 314. MATERIALS TO OPSD 1001, 1003 & 1010.
- ABUTTING PROPERTY GRADE TO BE MATCHED.
- OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE MUNICIPAL AUTHORITIES PRIOR TO COMMENCING CONSTRUCTION.
- MINIMIZE DISTURBANCE TO EXISTING VEGETATION DURING THE EXECUTION OF ALL WORKS.
- FILTER FABRIC TO BE INSTALLED AND MAINTAINED BETWEEN THE FRAME AND COVER OF ALL CATCHBASINS, CATCHBASIN MANHOLES AND MANHOLES DURING THE CONSTRUCTION PERIOD TO MINIMIZE SEDIMENTS ENTERING THE STORM SEWER SYSTEM. ALL GRASSED AREAS MUST BE COMPLETED PRIOR TO THE REMOVAL OF THE FILTER FABRIC IN THE DRAINAGE STRUCTURES.
- REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE DIRECTED FROM THE ENGINEER. EXCAVATE AND REMOVE ALL ORGANIC MATERIAL AND DEBRIS, IF ANY, LOCATED WITHIN THE PROPOSED BUILDING, PARKING AND ROADWAY LOCATIONS.
- THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS BUT NOT LIMITED TO: ROAD CUT PERMITS, SEWER PERMITS, WATER PERMIT, ETC.
- AT PROPOSED UTILITY CONNECTION POINTS AND CROSSINGS (I.E. STORM SEWER, SANITARY SEWER, WATER, ETC.) THE CONTRACTOR SHALL DETERMINE THE PRECISE LOCATION AND DEPTH OF EXISTING UTILITIES AND REPORT ANY DISCREPANCIES OR CONFLICTS TO THE ENGINEER BEFORE COMMENCING WORK.
- ALL SIDEWALK CONSTRUCTION TO BE AS PER OPSD 310.010 & OPSD 310.050.

NOTES: SEWERS

- SEWER BEDDING AS PER PIPE TRENCH DETAIL WITH GRANULAR 'A' BEDDING COMPACTED TO 95% OF ITS SPMD.
- ALL WORK SHALL BE PERFORMED, AS APPLICABLE IN ACCORDANCE WITH OPSD 407, AND 410.
- CONTRACTOR TO CONFIRM ELEVATION OF EXISTING SEWERS AT PROPOSED CONNECTION POINTS AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE COMMENCING ANY WORK.
- ALL SEWERS WITH LESS THAN 2.0m OF COVER ARE SUBJECT TO INSULATION DETAIL.

NOTES: WATER SERVICE

- PROPOSED WATER SERVICE TO BE INSULATED WHEN COVER IS LESS THAN 2.4m AS PER DETAIL PROVIDED IN C901.

TOPOGRAPHIC INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBECK LTD.
PROJECT NO. 19814-17 HINDU TEMPLE
DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES

- Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
- It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
- Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES

- This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
- Only visible surface utilities were located.
- A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating, etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
SITE AREA = 4.048 Hectares.

Existing Watermain Table				
Location	Station	Min. Obv	Grade	Notes
Connection to Existing Water Service	0+130.5	97.40	99.80	
Connection to Proposed Building	0+151.5	EX	99.63	

Proposed Watermain Table				
Main Line				
Location	Station	Min. Obv	Grade	Notes
Connection to City WM	0+000.0	Match Ex WM OBV	100.24	
Tee Fitting 1	0+034.4	97.65	100.05	
Tee Fitting 2	0+111.5	96.92	99.32	
45° Elbow Fitting 1	0+180.5	96.60	99.00	
45° Elbow Fitting 2	0+186.5	96.75	99.15	
Tee Fitting 3	0+191.2	96.40	98.80	
Fire Hydrant 1	0+195.5*	96.16	98.56	*diverges at Tee Fitting 3
45° Elbow Fitting 3	0+232.5	96.30	98.70	
45° Elbow Fitting 4	0+237.2	96.25	98.65	
Connection to Proposed Building	0+245.7	96.42	98.82	

Branch NW off Tee Fitting 1 @ 0+034.4				
Location	Station	Min. Obv	Grade	Notes
Tee Fitting 1	0+034.4	96.92	99.32	
Elbow Fitting 5	0+037.6	96.86	99.26	
Elbow Fitting 6	0+040.4	97.03	99.43	
Connection to City WM	0+072.5	Match Ex WM OBV	100.28	

Branch NW off Tee Fitting 2 @ 0+111.5				
Location	Station	Min. Obv	Grade	Notes
Tee Fitting 2	0+111.5	96.92	99.32	
Tee Fitting 4	0+122.9	96.9	99.30	
Existing Fire Hydrant	0+129.0*	96.88	99.28	**diverges at Tee Fitting 4
Connection to Existing Water Service	0+130.5	Match EX WTR OBV	99.46	

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SLOPE ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER CONTRACTOR AGREEMENTS, CONDITIONS OF CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SHOWING WORK SHALL BE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS AN ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE, NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.


CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

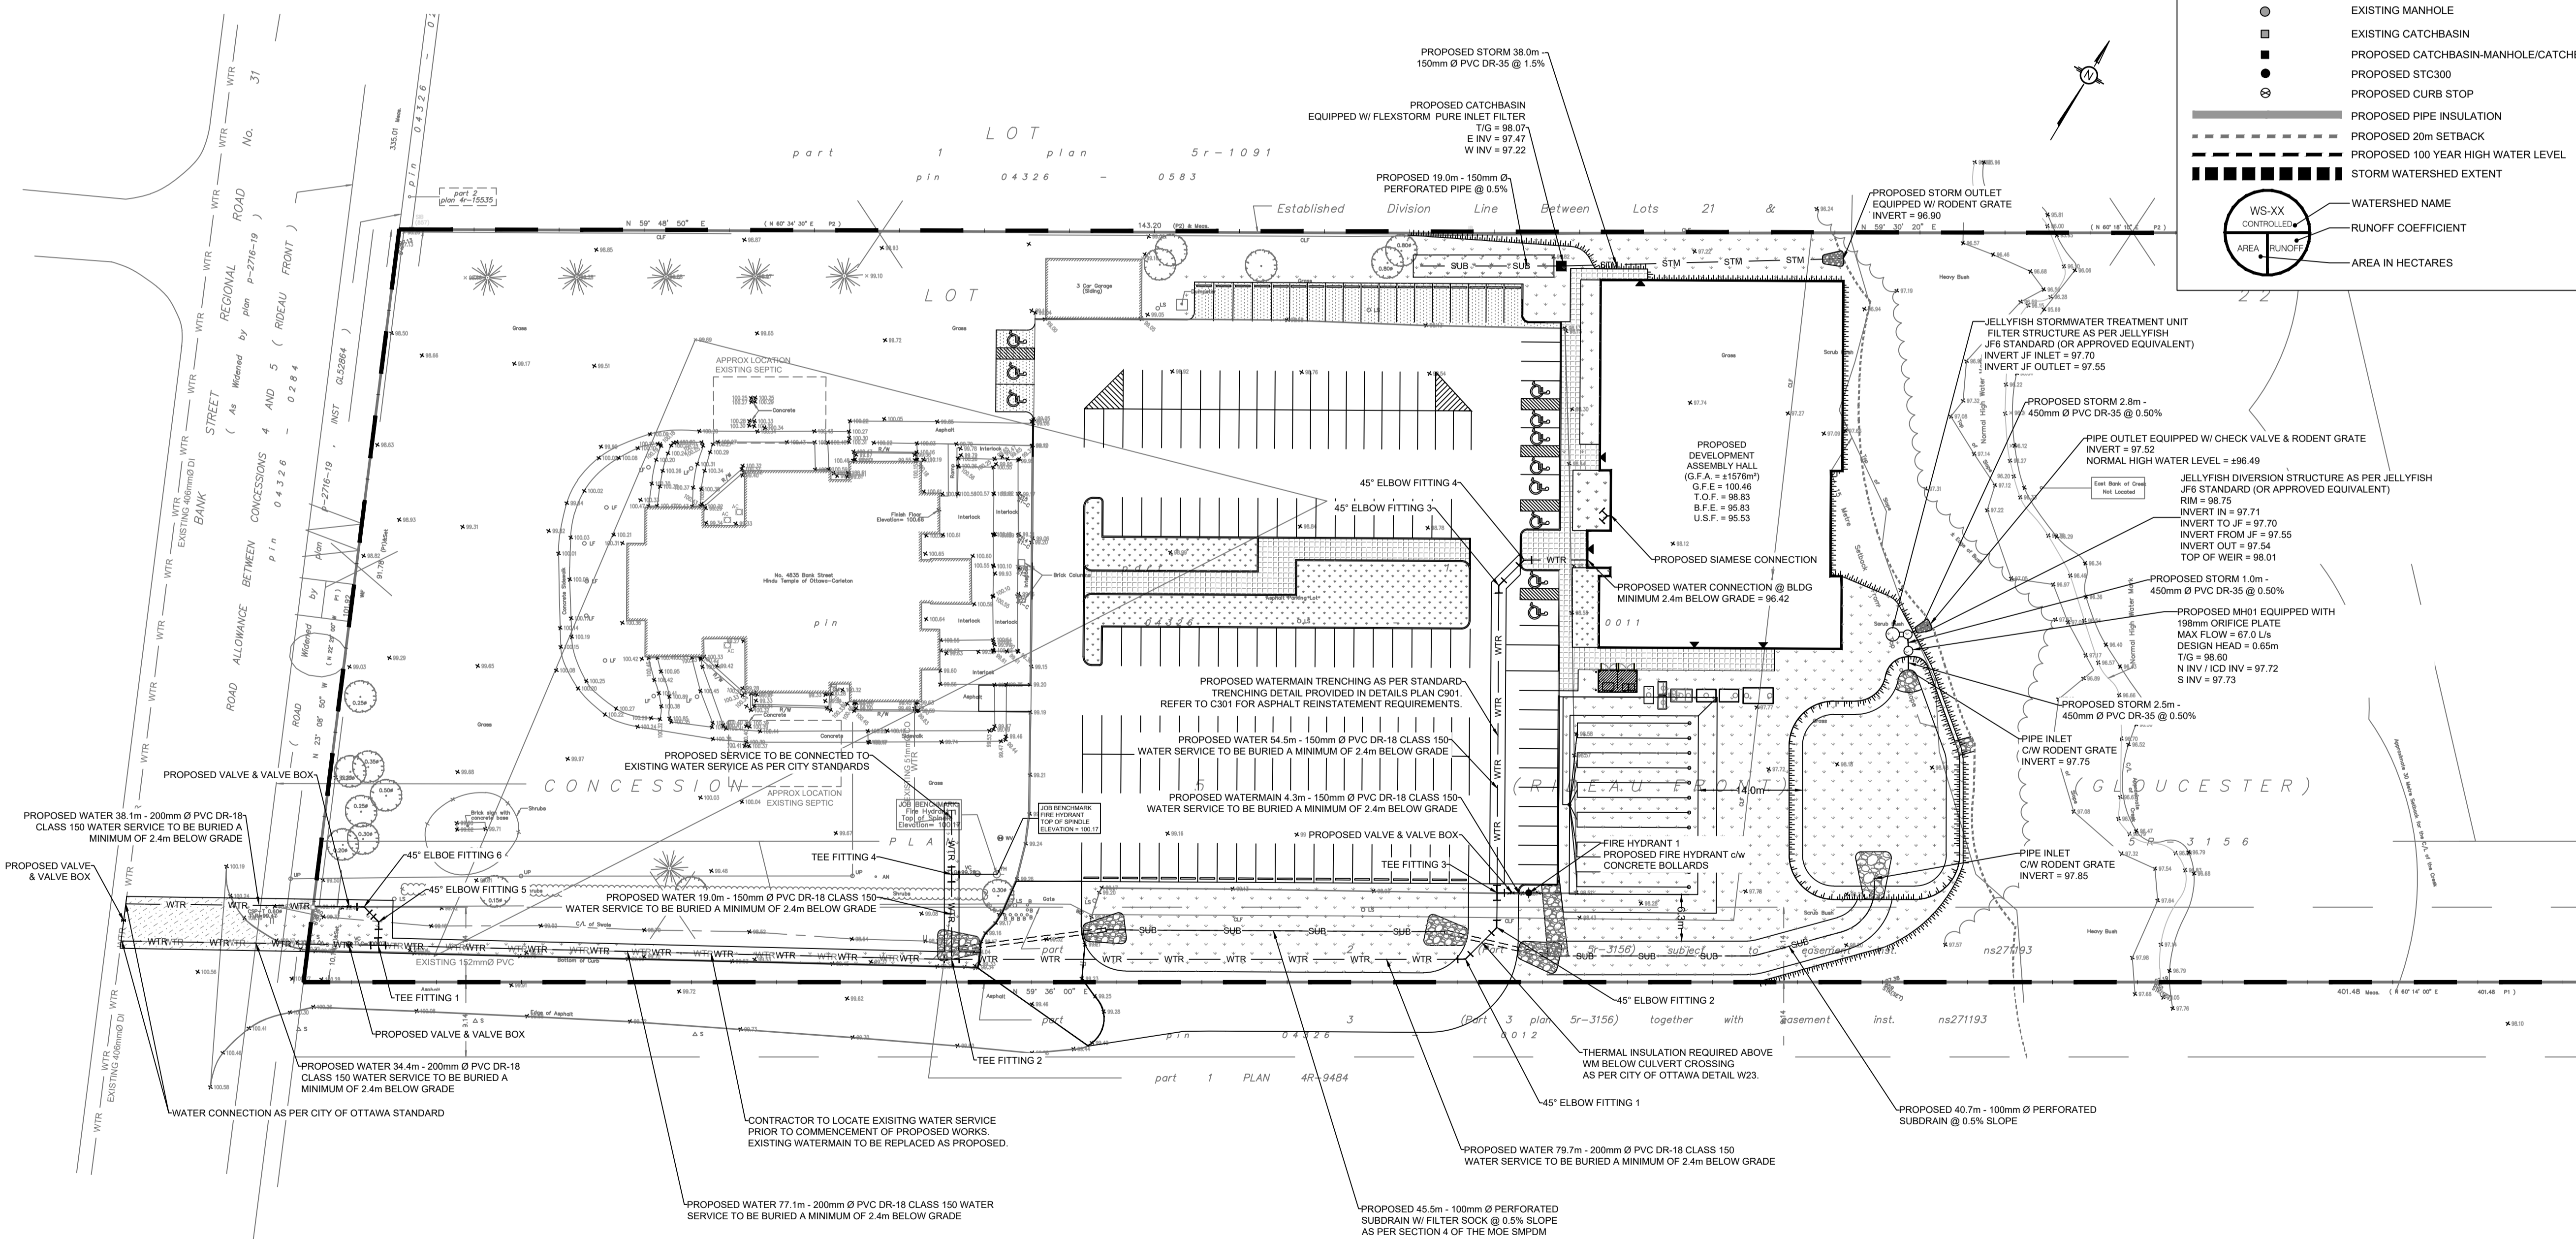

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRL
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: SERVICING PLAN

PROJECT NO: 170132
DATE: JAN2020



TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN,
 VOLLEBECK LTD.
 PROJECT NO. 19614-17 HINDU TEMPLE
 DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES
 1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
 3. Elevations derived from benchmark D19119680388 having an elevation of 92.16 metres.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Only visible surface utilities were located.
 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
 For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
 SITE AREA = 4.048 Hectares.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- *50.00 PROPOSED ELEVATION
- *50.00HP PROPOSED HIGH POINT ELEVATION
- *50.00SW PROPOSED SWALE ELEVATION
- *50.00BC PROPOSED BOTTOM OF CURB ELEVATION
- *50.00TC PROPOSED TOP OF CURB ELEVATION
- *50.00EX MATCH INTO EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- SUB PROPOSED 100mmØ PERFORATED SUBDRAIN
- STM PROPOSED STORM SEWER
- SAN PROPOSED SANITARY SEWER
- WTR PROPOSED WATERMAIN
- STM EXISTING STORM SEWER
- SAN EXISTING SANITARY SEWER
- WTR EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
 ENGINEERING | INGÉNIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrl.ca | (613) 842-3434


CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: STORMWATER MANAGEMENT PLAN

PROJECT NO. 170132
 DATE: JAN2020
 C601

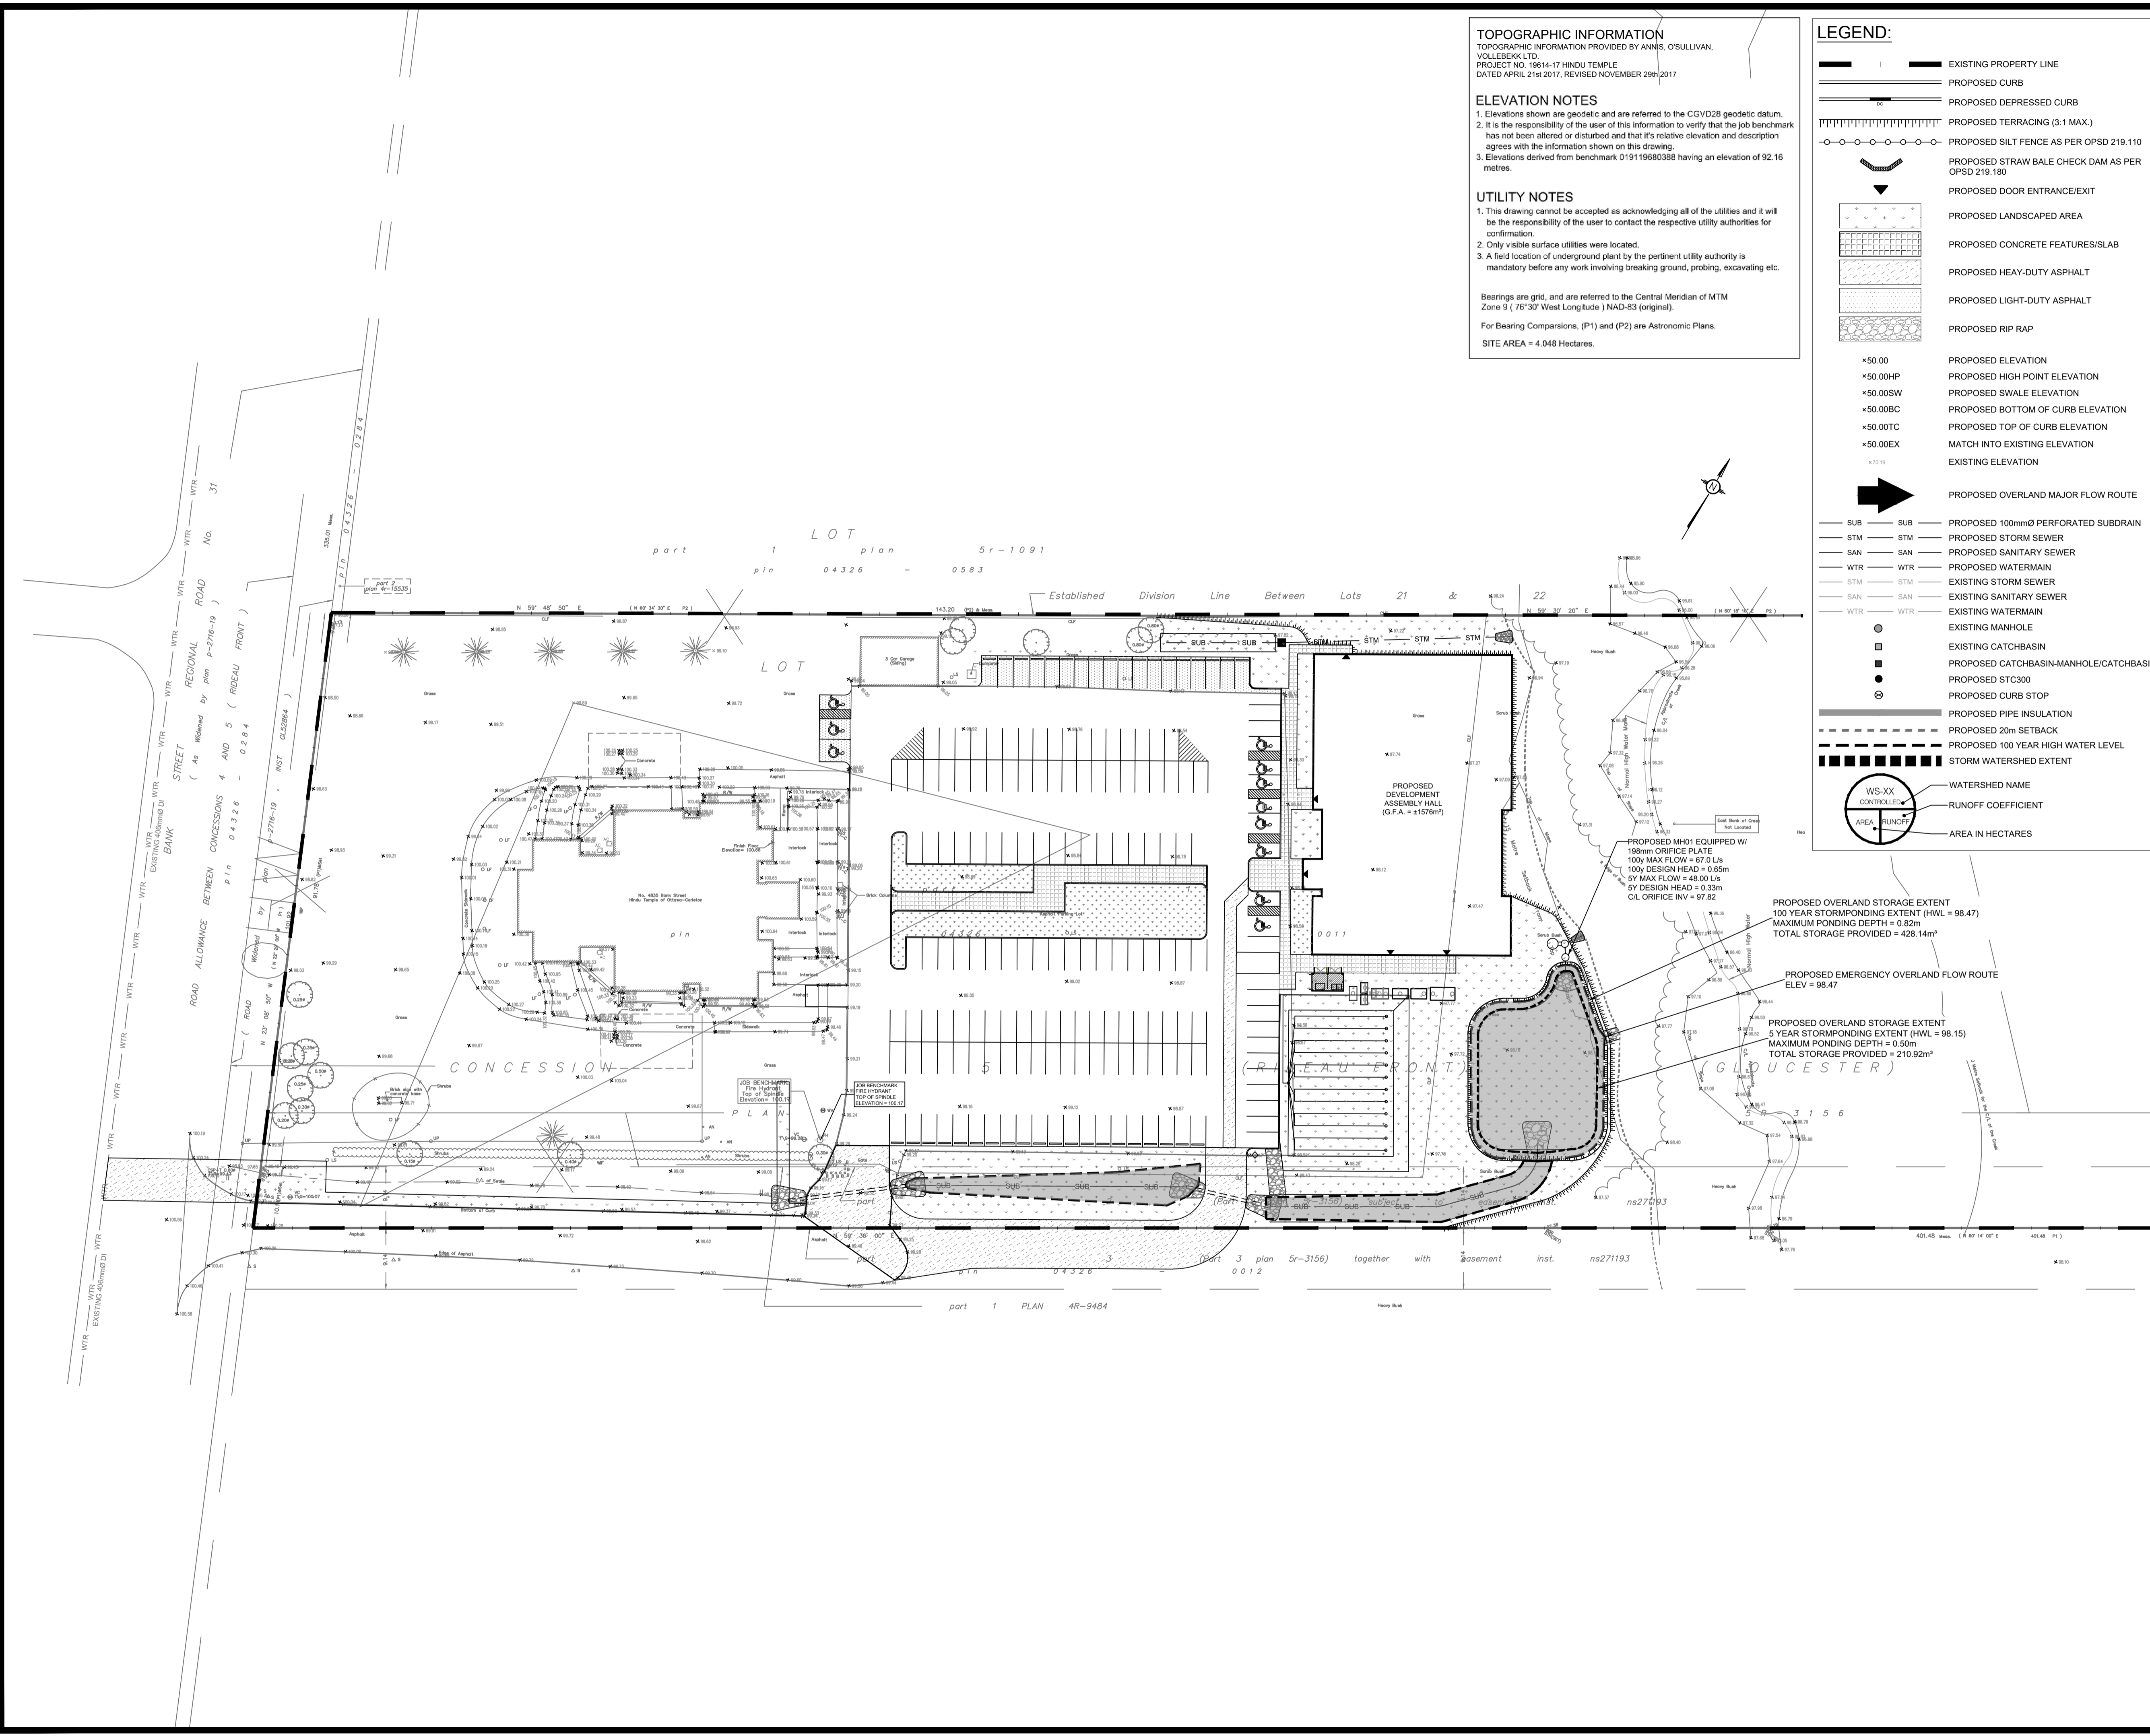

File no.: D017-12-20-0059

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEKK LTD.
 PROJECT NO. 19614-17 HINDU TEMPLE
 DATED APRIL 21st 2017, REVISED NOVEMBER 29th 2017

ELEVATION NOTES
 1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
 3. Elevations derived from benchmark 019119680388 having an elevation of 92.16 metres.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Only visible surface utilities were located.
 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
 For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
 SITE AREA = 4.048 Hectares.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- *50.00P PROPOSED ELEVATION
- *50.00HP PROPOSED HIGH POINT ELEVATION
- *50.00SW PROPOSED SWALE ELEVATION
- *50.00BC PROPOSED BOTTOM OF CURB ELEVATION
- *50.00TC PROPOSED TOP OF CURB ELEVATION
- *50.00EX MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- SUB PROPOSED 100mmØ PERFORATED SUBDRAIN
- STM PROPOSED STORM SEWER
- SAN PROPOSED SANITARY SEWER
- WTR PROPOSED WATERMAIN
- STM EXISTING STORM SEWER
- SAN EXISTING SANITARY SEWER
- WTR EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WS-XX WATERSHED NAME
- AREA RUNOFF RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS AN ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY IRL ASSOCIATES LTD. (IRL) WITHOUT OBTAINING IRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST IRL AND TO RELEASE IRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS IRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO IRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF IRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH IRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.


GENERAL NOTES:

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DRAWINGS, WHETHER THEY CONVEY OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

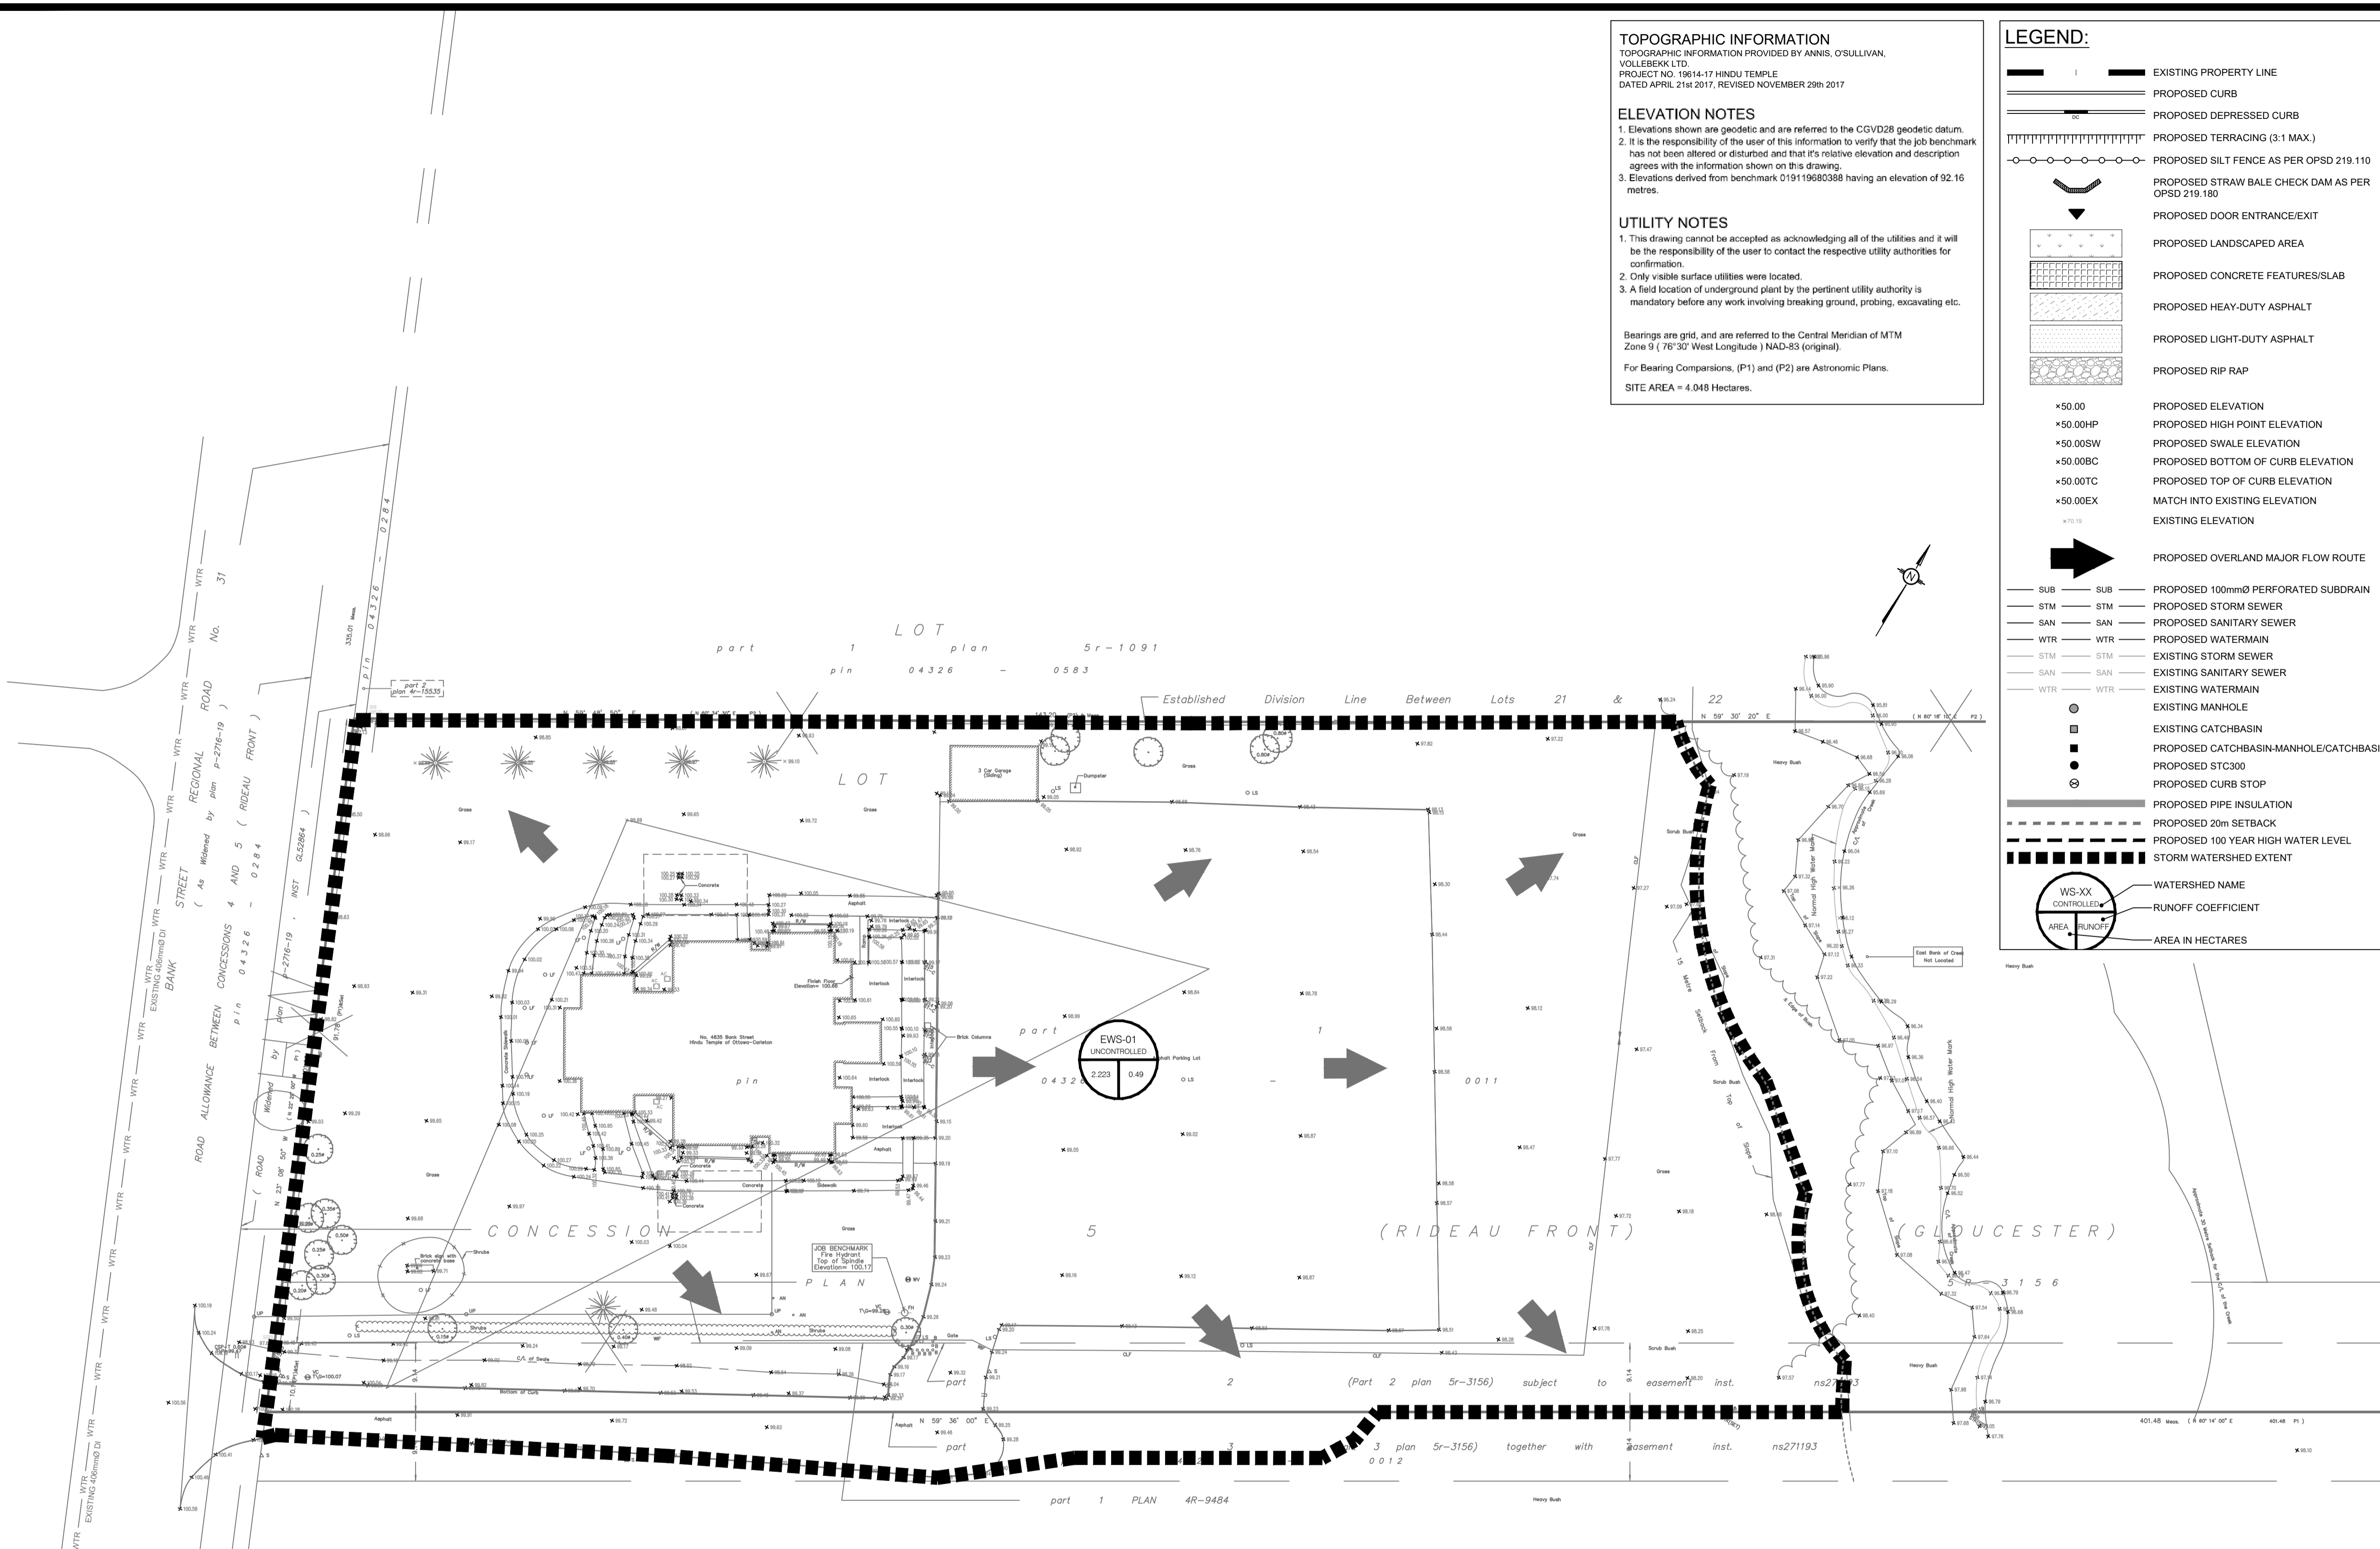

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
 ENGINEERING | INGENIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: PRE-DEVELOPMENT WATERSHED PLAN

PROJECT NO: 170132
 DATE: JAN2020



File no.: D017-12-20-0059

TOPOGRAPHIC INFORMATION
 TOPOGRAPHIC INFORMATION PROVIDED BY ANNIS, O'SULLIVAN, VOLLEBEK LTD.
 PROJECT NO. 19614-17 HINDU TEMPLE
 DATED APRIL 21st 2017, REVISED NOVEMBER 20th 2017

ELEVATION NOTES
 1. Elevations shown are geodetic and are referred to the CGVD28 geodetic datum.
 2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.
 3. Elevations derived from benchmark D19119680388 having an elevation of 92.16 metres.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Only visible surface utilities were located.
 3. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Bearings are grid, and are referred to the Central Meridian of MTM Zone 9 (76°30' West Longitude) NAD-83 (original).
 For Bearing Comparisons, (P1) and (P2) are Astronomic Plans.
 SITE AREA = 4.048 Hectares.

LEGEND:

- EXISTING PROPERTY LINE
- PROPOSED CURB
- PROPOSED DEPRESSED CURB
- PROPOSED TERRACING (3:1 MAX.)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED STRAW BALE CHECK DAM AS PER OPSD 219.180
- PROPOSED DOOR ENTRANCE/EXIT
- PROPOSED LANDSCAPED AREA
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY-DUTY ASPHALT
- PROPOSED LIGHT-DUTY ASPHALT
- PROPOSED RIP RAP
- PROPOSED ELEVATION
- PROPOSED HIGH POINT ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED OVERLAND MAJOR FLOW ROUTE
- PROPOSED 100mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING STORM SEWER
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- EXISTING MANHOLE
- EXISTING CATCHBASIN
- PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
- PROPOSED STC300
- PROPOSED CURB STOP
- PROPOSED PIPE INSULATION
- PROPOSED 20m SETBACK
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES

USE AND INTERPRETATION OF DRAWINGS
 GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE THE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAILED SIMILARLY AS WORK SHOWN MORE COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THEREOF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:
 IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES, TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

IN ADDITION, THE CLIENT AGREES TO INCLUDE IN ANY CONTRACTS FOR CONSTRUCTION APPROPRIATE LANGUAGE THAT PROHIBITS THE CONTRACTOR OR ANY SUBCONTRACTORS OF ANY TIER FROM MAKING ANY CHANGES OR MODIFICATIONS TO LRL'S CONSTRUCTION DOCUMENTS WITHOUT THE PRIOR WRITTEN APPROVAL OF LRL AND THAT FURTHER REQUIRES THE CONTRACTOR TO INDEMNIFY BOTH LRL AND THE CLIENT FROM ANY LIABILITY OR COST ARISING FROM SUCH CHANGES MADE WITHOUT SUCH PROPER AUTHORIZATION.

GENERAL NOTES:
 EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DRAWINGS, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020



NOT AUTHENTIC UNLESS SIGNED AND DATED

LRJ
 ENGINEERING | INGÉNIERIE
 5430 Canotek Road | Ottawa, ON, K1J 9G2
 www.lrl.ca | (613) 842-3434



CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: POST-DEVELOPMENT WATERSHED PLAN

PROJECT NO: 170132
 DATE: JAN2020

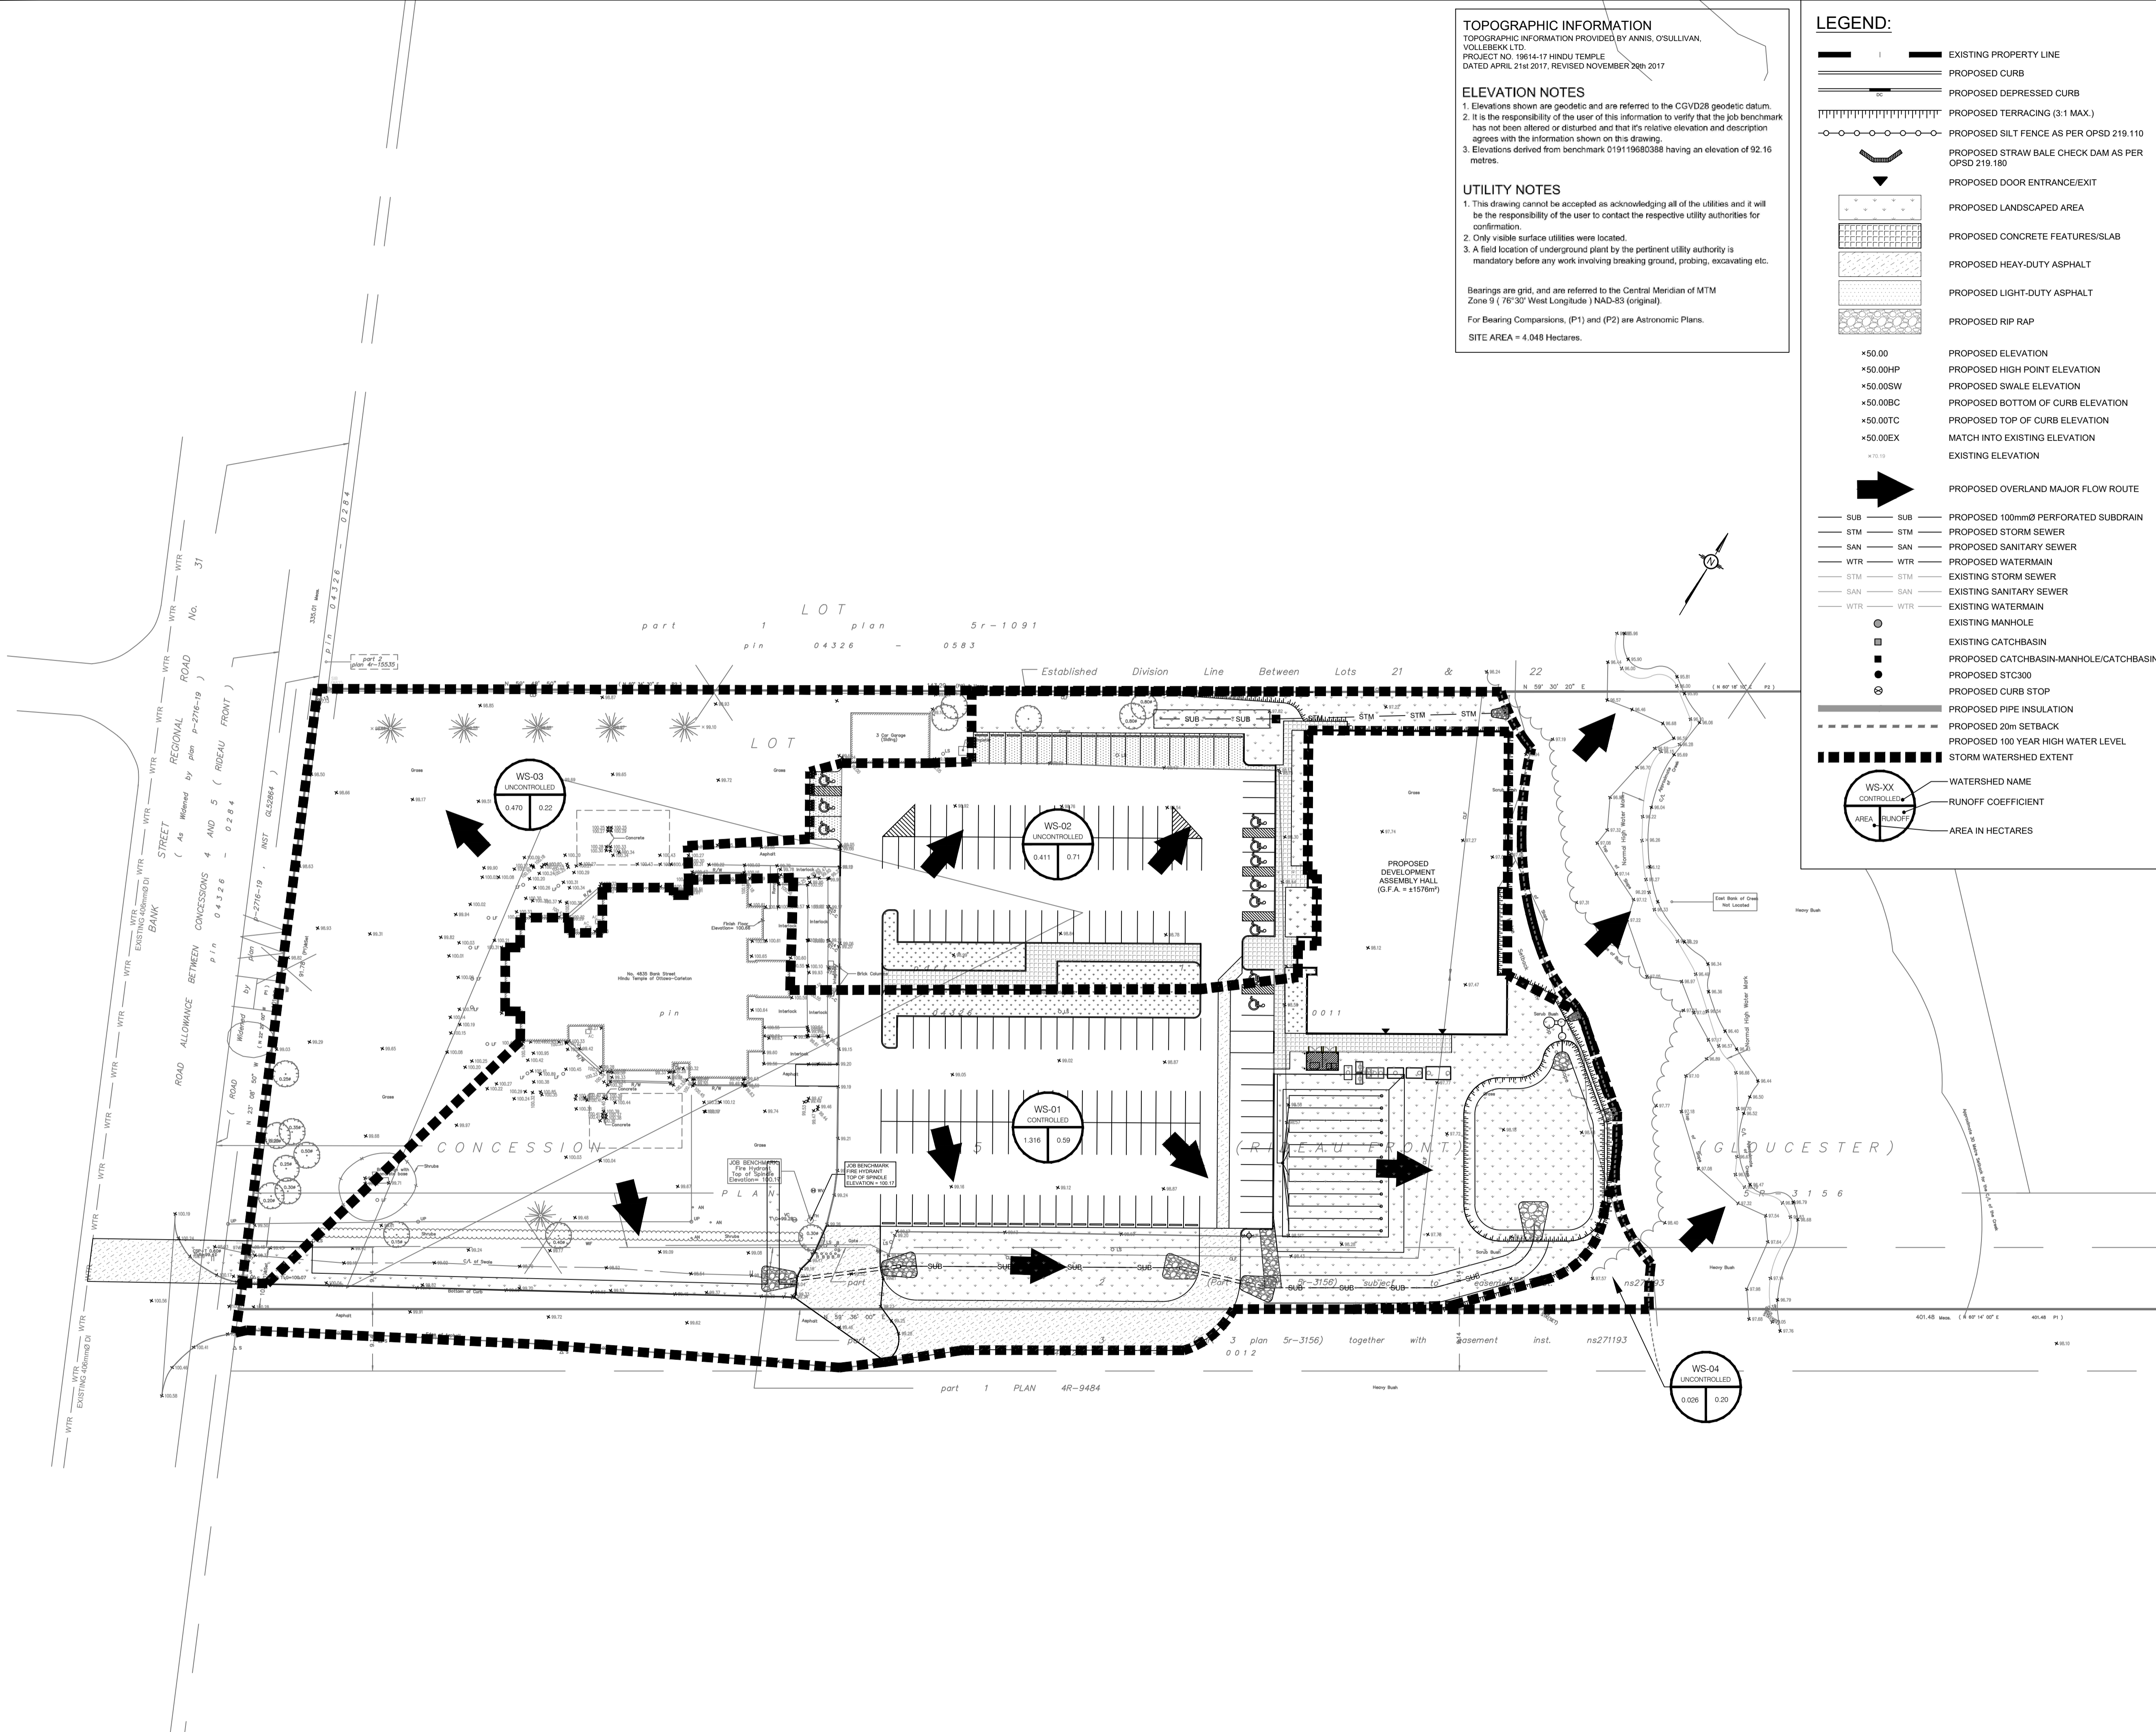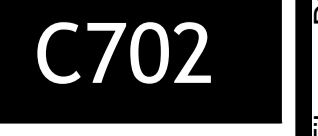

File no.: D017-12-20-0059

NOTES:

- FOR 100 - 400mm DIAMETER WATERMAINS, WHERE THE DEPTH OF COVER IS LESS THAN 250mm.
1. DIMENSIONS OF THICKNESS SHALL BE ADJUSTED TO 25mm.
2. THE PROXIMITY OF MAINTENANCE HOLES, CLAVETS, CARTRIDGES, ETC. INSULATION SHALL BE PLACED PER DETAIL W22.
3. DEPTH OF COVER LESS THAN 150mm REQUIRES SPECIAL DESIGN.
4. STAGGER JOINTS OF INSULATION SHEETS.
5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

DATE: MAY 2001
REV: NONE
REV: MARCH 2006
DWG. NO.: W22

NOTES:

1. ALL EXISTING ASPHALT TO BE SHIM OUT.
2. ALL EXISTING PATCHES TO BE REINFORCED.
3. ALL EXISTING PATCHES TO BE REINFORCED.
4. ALL EXISTING PATCHES TO BE REINFORCED.
5. ALL EXISTING PATCHES TO BE REINFORCED.
6. ALL EXISTING PATCHES TO BE REINFORCED.
7. ALL EXISTING PATCHES TO BE REINFORCED.
8. ALL EXISTING PATCHES TO BE REINFORCED.
9. ALL EXISTING PATCHES TO BE REINFORCED.
10. ALL EXISTING PATCHES TO BE REINFORCED.

DATE: MAY 2001
REV: NONE
REV: MARCH 2006
DWG. NO.: R10

NOTES:

1. The sump is measured from the lowest invert.
2. Granular backfill shall be placed to a minimum thickness of 300mm all around the maintenance hole.
3. Precast concrete components shall be according to OPSD 701.030, 701.031, or 701.032.
4. Structure exceeding 5.0m in depth shall include safety platform according to OPSD 404.020.
5. Pipe support according to OPSD 708.020.
6. For benching and pipe opening details, see OPSD 701.021.
7. For adjustment unit and frame installation, see OPSD 704.010.
8. All dimensions are nominal.
9. All dimensions are in millimetres unless otherwise shown.

DATE: MAY 2001
REV: NONE
REV: MARCH 2007
DWG. NO.: W24

NOTES:

1. Sidewalk thickness at residential driveways and adjacent to curb shall be 150mm.
2. Sidewalk width shall be wider than specified.
3. This OPSD shall be read in conjunction with OPSD 310.030, 310.031, 310.032, 310.033 and 310.039.
4. All dimensions are in millimetres unless otherwise shown.

DATE: MAY 2001
REV: NONE
REV: MARCH 2009
DWG. NO.: W17

NOTES:

1. THE FULL CURB DEPTH SHALL BE CARRIED THROUGH THE DEPRESSION CROSSING.
2. A CONCRETE SUPPORT IS REQUIRED WHEN BUILT ADJACENT TO THE SIDEWALK.
3. IF AN EXTENSION CURBING MACHINE IS USED, THE EXPANSION JOINTS SHALL BE PLACED AT THE END OF THE EXTRUSION.
4. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
5. DUMMY JOINTS SHALL BE 20mm DEEP FROM FRONT, BACK AND TOP OF SECTION AT 2m SPACING.
6. FOR DEPRESSION CURB AT ENTRANCES USE 250.
7. DEPRESSION CURB HEIGHT - FOR PEDESTRIAN CURB RAMP IS 0 TO 6mm AND FOR PRIVATE ENTRANCES IS 25mm.

DATE: JANUARY 2003
REV: NONE
REV: MARCH 2014
DWG. NO.: SC1.1

USE AND INTERPRETATION OF DRAWINGS

GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITY AND FOR OBTAINING ALL NECESSARY INFORMATION FROM THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS NOTICED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.

AS INSTRUMENTS OF SERVICE, ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIED THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.

UNLESS THE REVISION TITLE IS ISSUED FOR CONSTRUCTION, THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.

THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.

UNAUTHORIZED CHANGES:

IN THE EVENT THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY IRL ASSOCIATES LTD. (IRL) WITHOUT OBTAINING IRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST IRL AND TO RELEASE IRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.

IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS IRL FROM ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

EXISTING SERVICES AND UTILITIES SHOWN ON THESE DRAWINGS ARE TAKEN FROM THE BEST AVAILABLE RECORDS, BUT MAY NOT BE COMPLETE OR TO DATE. CONTRACTOR SHALL VERIFY IN FIELD FOR LOCATION AND ELEVATION OF PIPES AND CHECK WITH THE UTILITY COMPANIES BEFORE DIGGING OR PERFORMING WORK.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.

THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

NOTES:

1. REFER TO CONSTRUCTION SPECIFICATION F-703.

DATE: MAY 2001
REV: NONE
REV: MARCH 2006
DWG. NO.: W19

NOTES:

1. FOR ALL WATERMAINS.
2. SEE DETAIL W20 FOR HYDRANTS IN DITCH AREAS.
3. FOR WATERMAINS ABOVE AND UNDER, LOCATE VALVE WITH 10% OF CENTRELINE. RETAINING/RESTRAINING DEVICES TO BE UTILIZED. FOR WATERMAINS ABOVE AND UNDER, LOCATE VALVE WITH 10% OF CENTRELINE TO FLANGED TEES.
4. RETAINING/RESTRAINING DEVICES TO BE UTILIZED.
5. SEE W19.1 FOR BACKFILL REQUIREMENTS IN THIS AREA.
6. SEE W19 FOR HYDRANT LOCATION REQUIREMENTS.
7. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

DATE: MAY 2001
REV: NONE
REV: MARCH 2006
DWG. NO.: W19

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
2. FOR 200 AND 250mm VALVES AND BEDDING BELOW THE CONCRETE BLOCKS AS REQUIRED TO RAISE BELL HIGH ENOUGH TO PREVENT CONTACT WITH THE VALVE BOWNET.

DATE: MAY 2001
REV: NONE
REV: MARCH 2007
DWG. NO.: W24

NOTES:

1. PIPE EMBEDMENT MATERIAL - GRANULAR 'A'.
2. FINAL BACKFILL - APPROVED NATIVE MATERIAL OR SELECT SUBGRADE IN ACCORDANCE WITH F-700.
3. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
4. REFER TO W25.1 FOR RESTRAINED LENGTH REQUIREMENTS.
5. REFER TO W25.2 AND W25.3 FOR THURST BLOCK REQUIREMENTS.
6. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

DATE: MAY 2001
REV: NONE
REV: MARCH 2009
DWG. NO.: W17

NOTES:

1. FOR 300mm OR GREATER DIAMETER WATERMAIN BENDS SHALL BE MAXIMUM 225°.
2. INSULATION PER W22 AT EXISTING WATERMAIN.
3. REFER TO W25.4 FOR RESTRAINED LENGTH REQUIREMENTS.
4. REFER TO W25.5 AND W25.6 FOR THURST BLOCK REQUIREMENTS.
5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

DATE: MAY 2001
REV: NONE
REV: MARCH 2009
DWG. NO.: W25.1

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED

NOTES:

1. Pipe embedment or bedding, cover, and backfill shall be according to:
 - a) Flexible OPSD 802.010, 802.013, 802.014, 802.020, 802.023, and 802.024.
 - b) Rigid - OPSD 802.030, 802.031, 802.032, 802.033, 802.034, 802.050, 802.051, 802.052, 802.053, and 802.054.
 - 2. Frost tapers shall start at bedding grade.
2. Frost tapers shall start at bedding grade.

DATE: MAY 2001
REV: NONE
REV: MARCH 2006
DWG. NO.: W23

NOTES:

1. A Covers shall be Type A or Type B, as specified.
2. All dimensions are in millimetres unless otherwise shown.

DATE: NOV 2018
REV: 4
DWG. NO.: OPSD 401.010

NOTES:

1. The thickness of the rip-rap layer shall be at least 1.5 times the rip-rap mean diameter.
2. All dimensions are in millimetres unless otherwise shown.

DATE: NOV 2018
REV: 3
DWG. NO.: OPSD 810.010

NOTES:

1. INSULATION SHALL EXTEND 300mm EACH WAY FROM THE ENDS OF THE STRUCTURE, PARALLEL TO THE WATERMAIN.
2. STAGGER JOINTS OF WALKING SHEETS.
3. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
4. INSULATION CAN BE AT EITHER LOCATION OR BOTH.

DATE: MAY 2001
REV: NONE
REV: FEB 2004
DWG. NO.: W23

LRJ
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON


DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA


DRAWING TITLE: CONSTRUCTION DETAIL PLAN

PROJECT NO.: 170132
DATE: JAN2020

C901

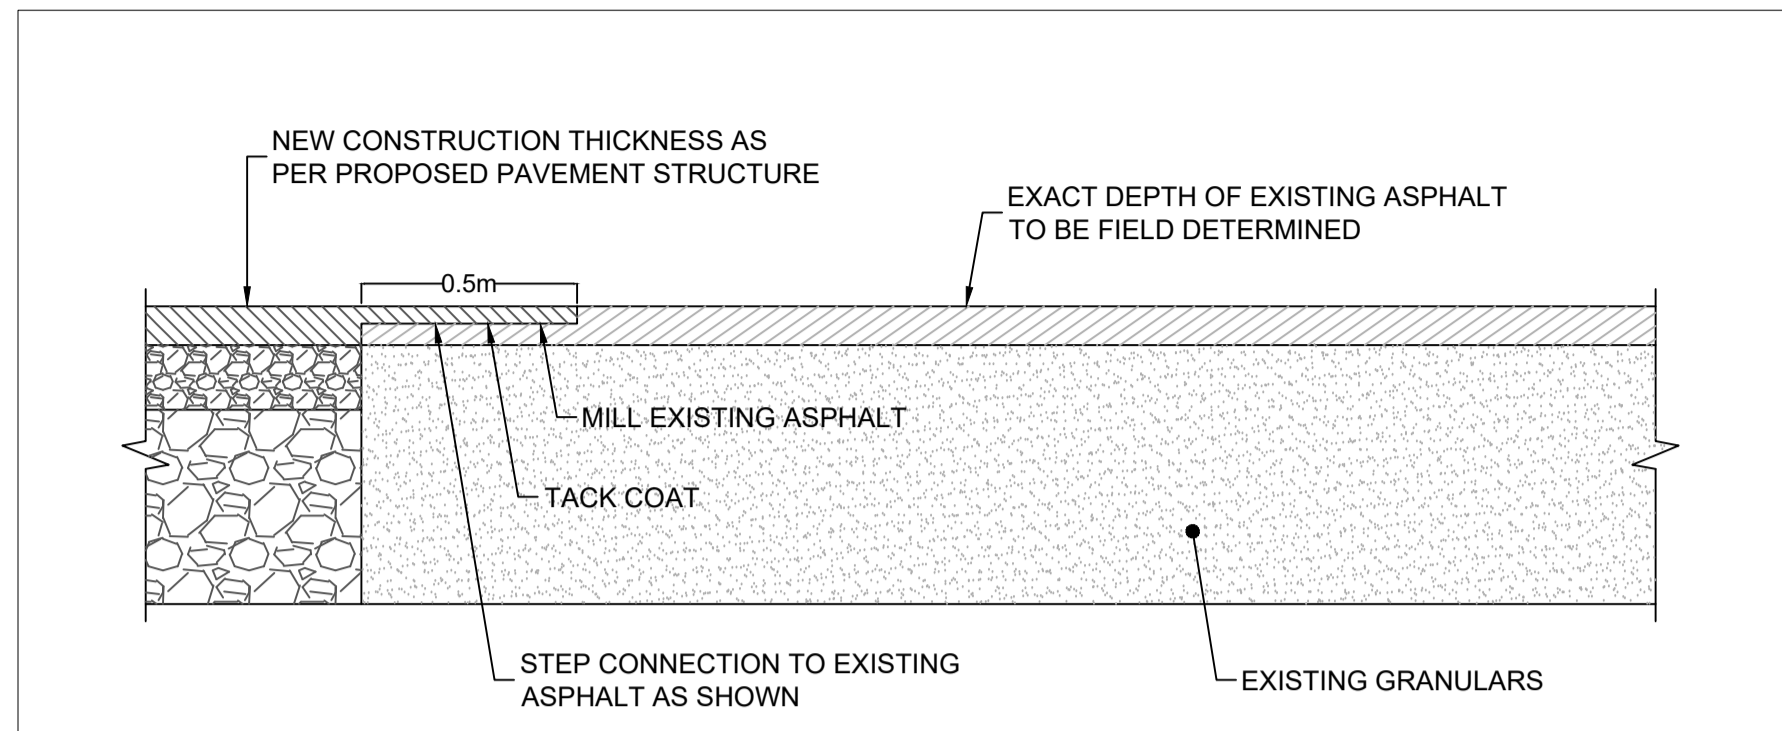


TYPICAL KEY CONNECTION TO EXISTING ASPHALT (N.T.S.)

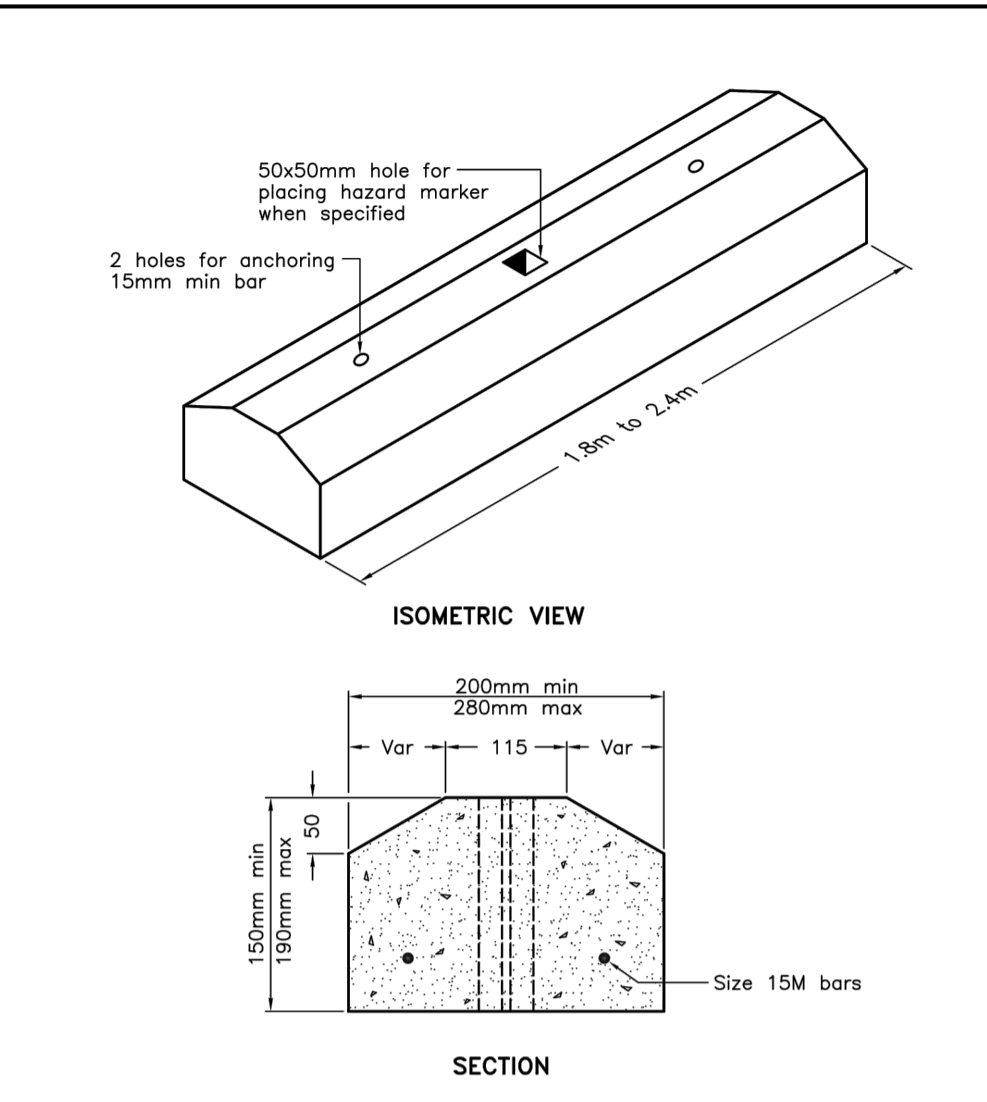


NOTES:
A Class of concrete shall be C2 according to CSA A23.1.
B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2006 Rev 1
PRECAST CONCRETE CURB
OPSD 603.020

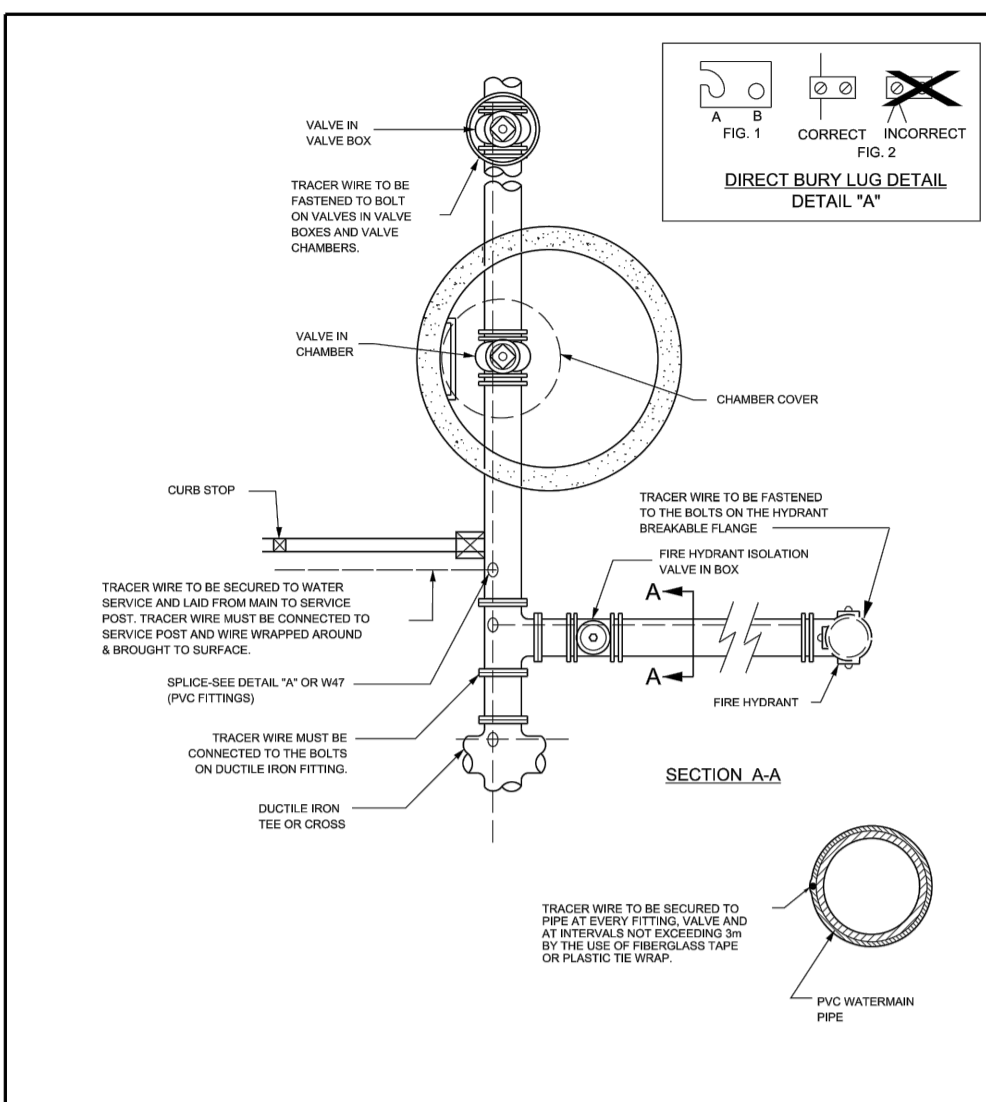


NOTES:
1. ALL CONNECTIONS MUST BE WATERPROOFED.
2. SPRINGS OF MAIN TRACER WIRE IS NOT ALLOWED UNLESS SPECIFIED OR APPROVED.
3. TRACER WIRE CONTINUITY OF CURRENT MUST BE TESTED AND VERIFIED.
4. FOR PIPES TO DUCTILE IRON CONNECTIONS, THE TRACER WIRE MUST BE ATTACHED TO THE ELECTRIC IRON PIPE BY GALVANIZED IRON ANODE.
5. FOR SPILLOWS WITH DIRECT BURRY LUGS, STEP BOTH LUGS AND CUT TAP WIRE TO WIDTH OF LUG WELD. PLACE TRACER WIRE INTO LUG AND SECURE WITH WIRE. TRACER WIRE MUST BE ATTACHED TO LUG. MAKE SURE SEALANT COVER AND DISCARD. CLOSE HOUSING, ALLOWING WIRE UNTIL HOUSING LID IS FULLY LATCHED.
6. TRACER WIRE MUST BE SECURED TO THE SIDE OF THE HYDRANT BREAKABLE FLANGE.
7. TRACER WIRE MUST BE SECURED TO THE VALVE IN BOX.
8. TRACER WIRE MUST BE SECURED TO THE SIDE OF THE HYDRANT BREAKABLE FLANGE.
9. TRACER WIRE MUST BE SECURED TO THE SIDE OF THE HYDRANT BREAKABLE FLANGE.
10. TRACER WIRE MUST BE SECURED TO THE SIDE OF THE HYDRANT BREAKABLE FLANGE.

DATE: MAY 2001
REV: MARCH 2011
DWG No.: W36

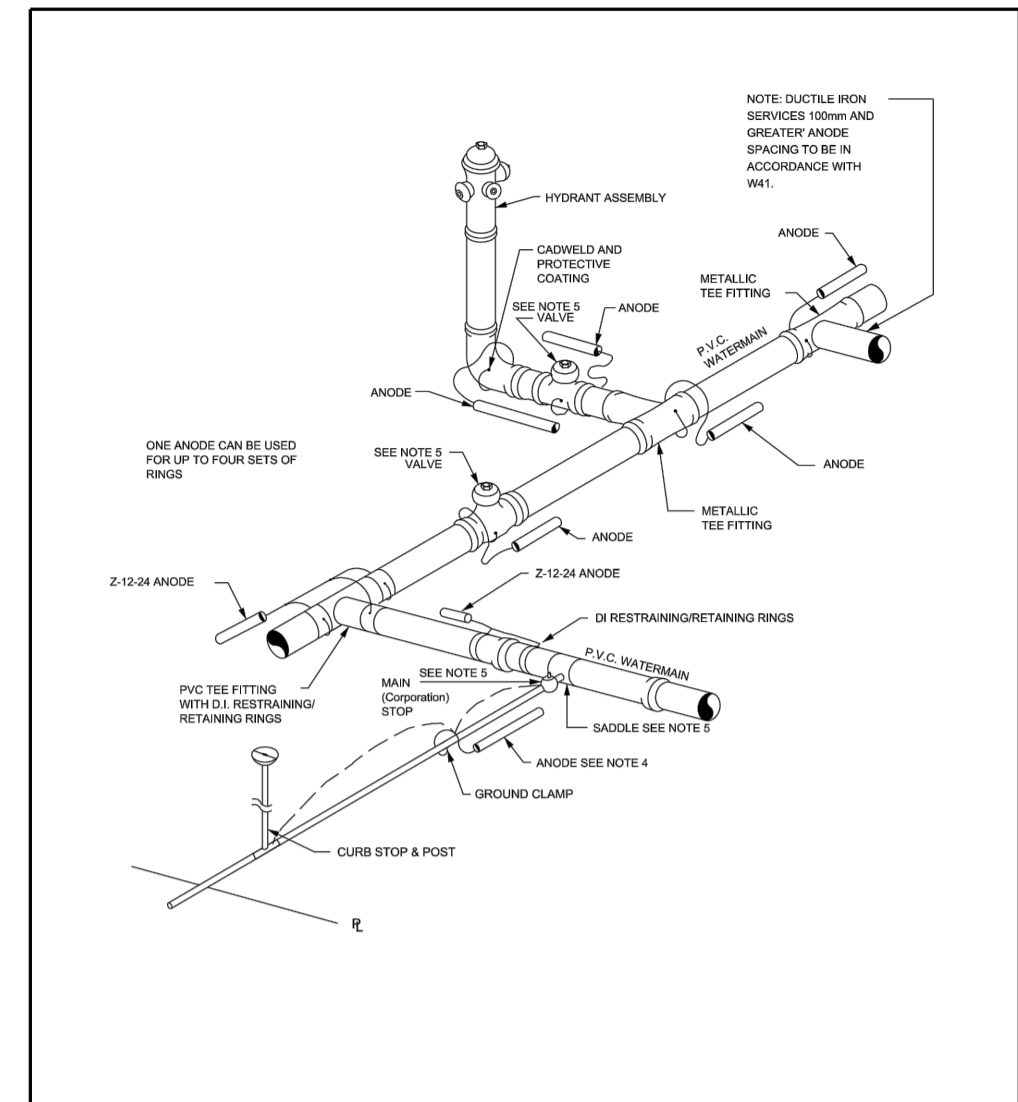


NOTES:
1. ANODE CONNECTIONS WIRE TO BE LAPPED AND WELDED BY FITTINGS AND ANGHTED.
2. PROTECTIVE COATING TO BE APPLIED TO ALL ANODES.
3. ANODE TYPE IS SPECIFIED IN THE NOTES.
4. ANODE TYPE IS SPECIFIED IN THE NOTES.
5. ANODE TYPE IS SPECIFIED IN THE NOTES.
6. ANODE TYPE IS SPECIFIED IN THE NOTES.
7. ANODE TYPE IS SPECIFIED IN THE NOTES.
8. ANODE TYPE IS SPECIFIED IN THE NOTES.
9. ANODE TYPE IS SPECIFIED IN THE NOTES.
10. ANODE TYPE IS SPECIFIED IN THE NOTES.

DATE: MAY 2001
REV: MARCH 2011
DWG No.: W40

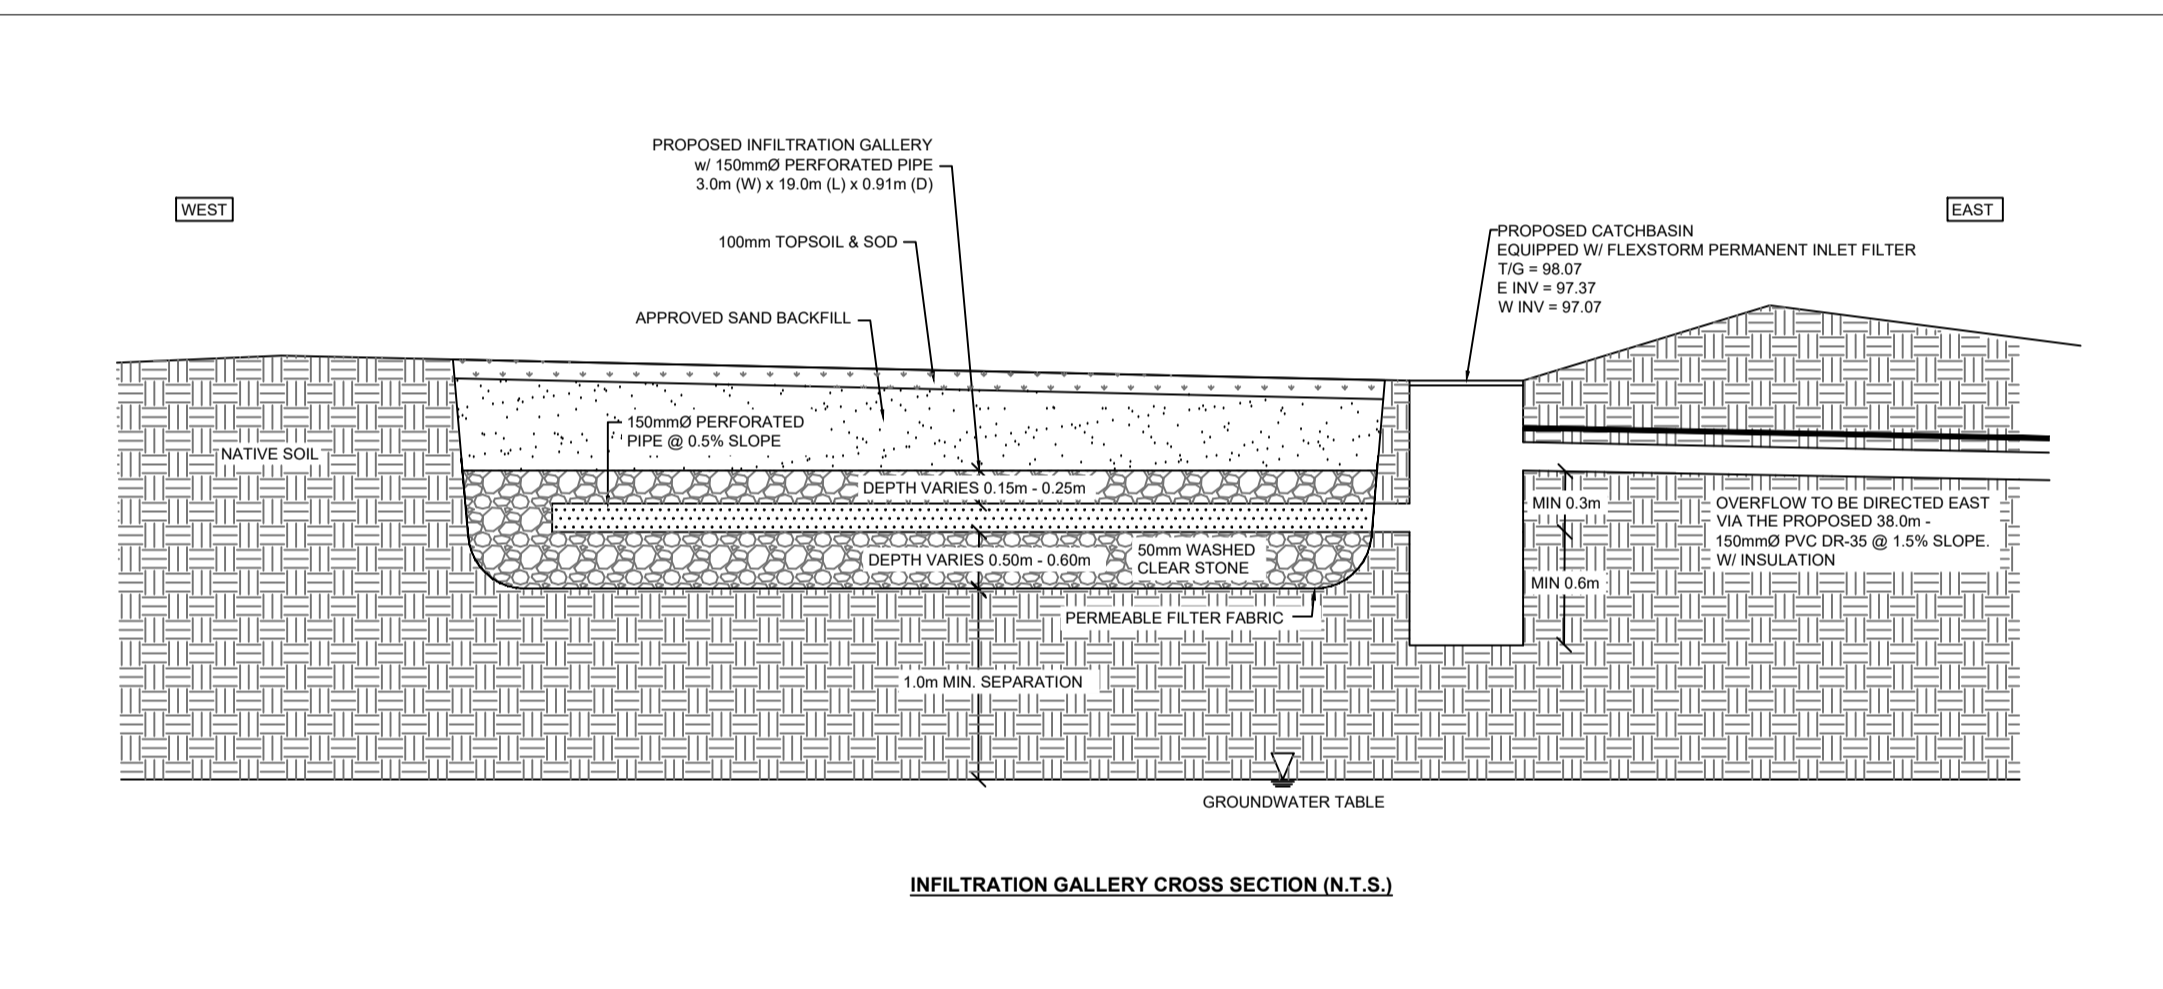


INFILTRATION GALLERY CROSS SECTION (N.T.S.)

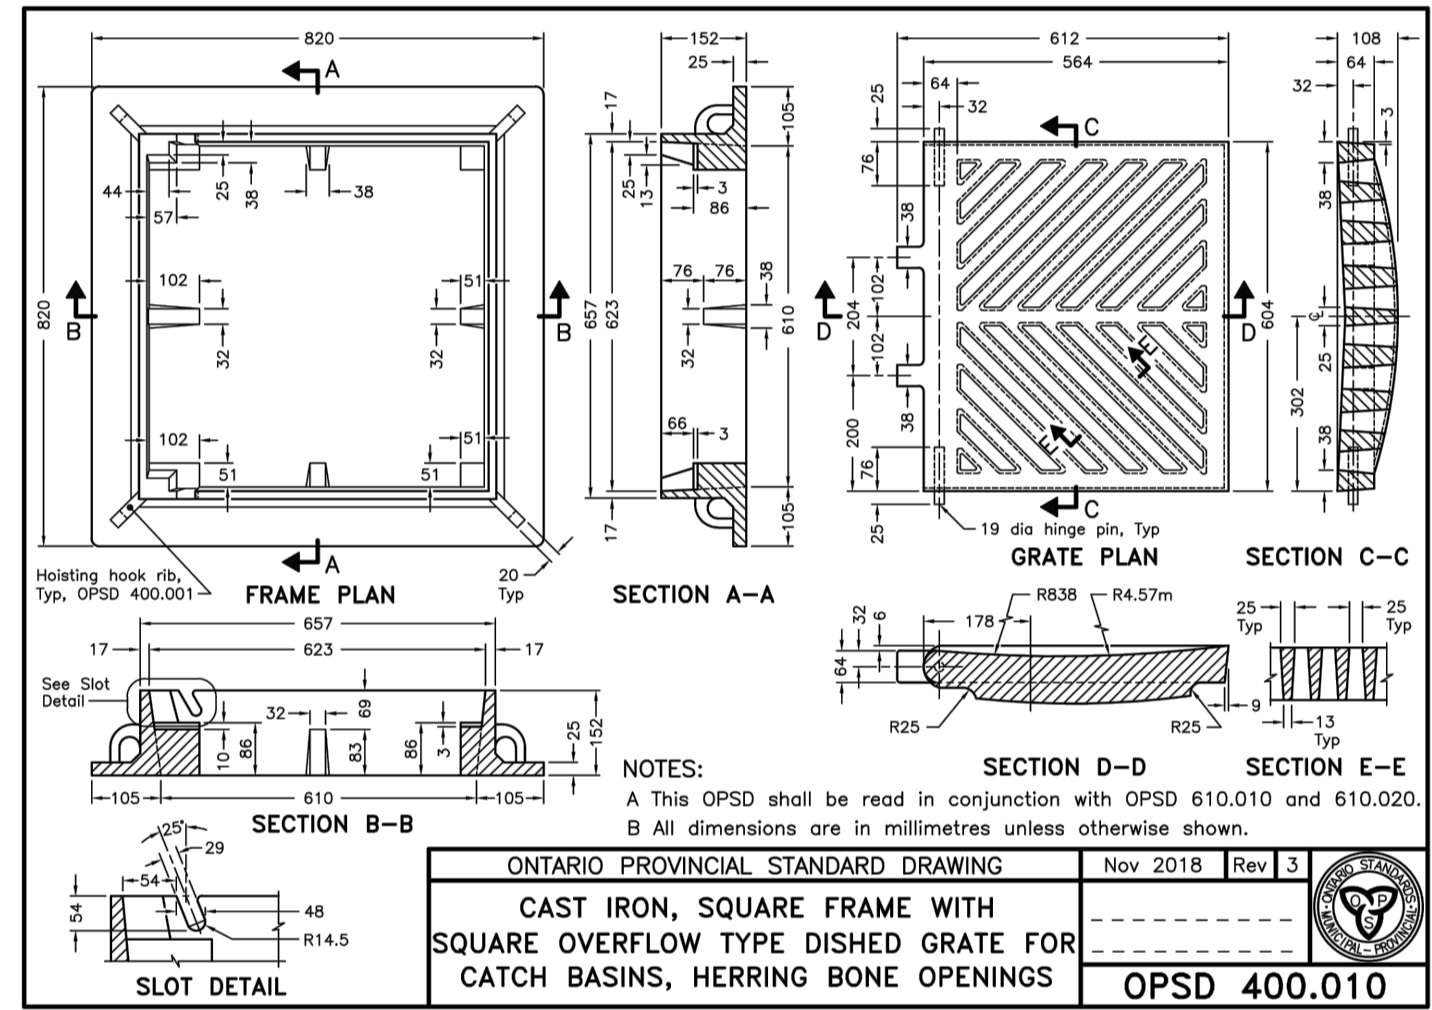



NOTES:
A This OPSD shall be read in conjunction with OPSD 610.010 and 610.020.
B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 3
CAST IRON, SQUARE FRAME WITH SQUARE OVERFLOW TYPE DISHED GRATE FOR CATCH BASINS, HERRING BONE OPENINGS
OPSD 400.010

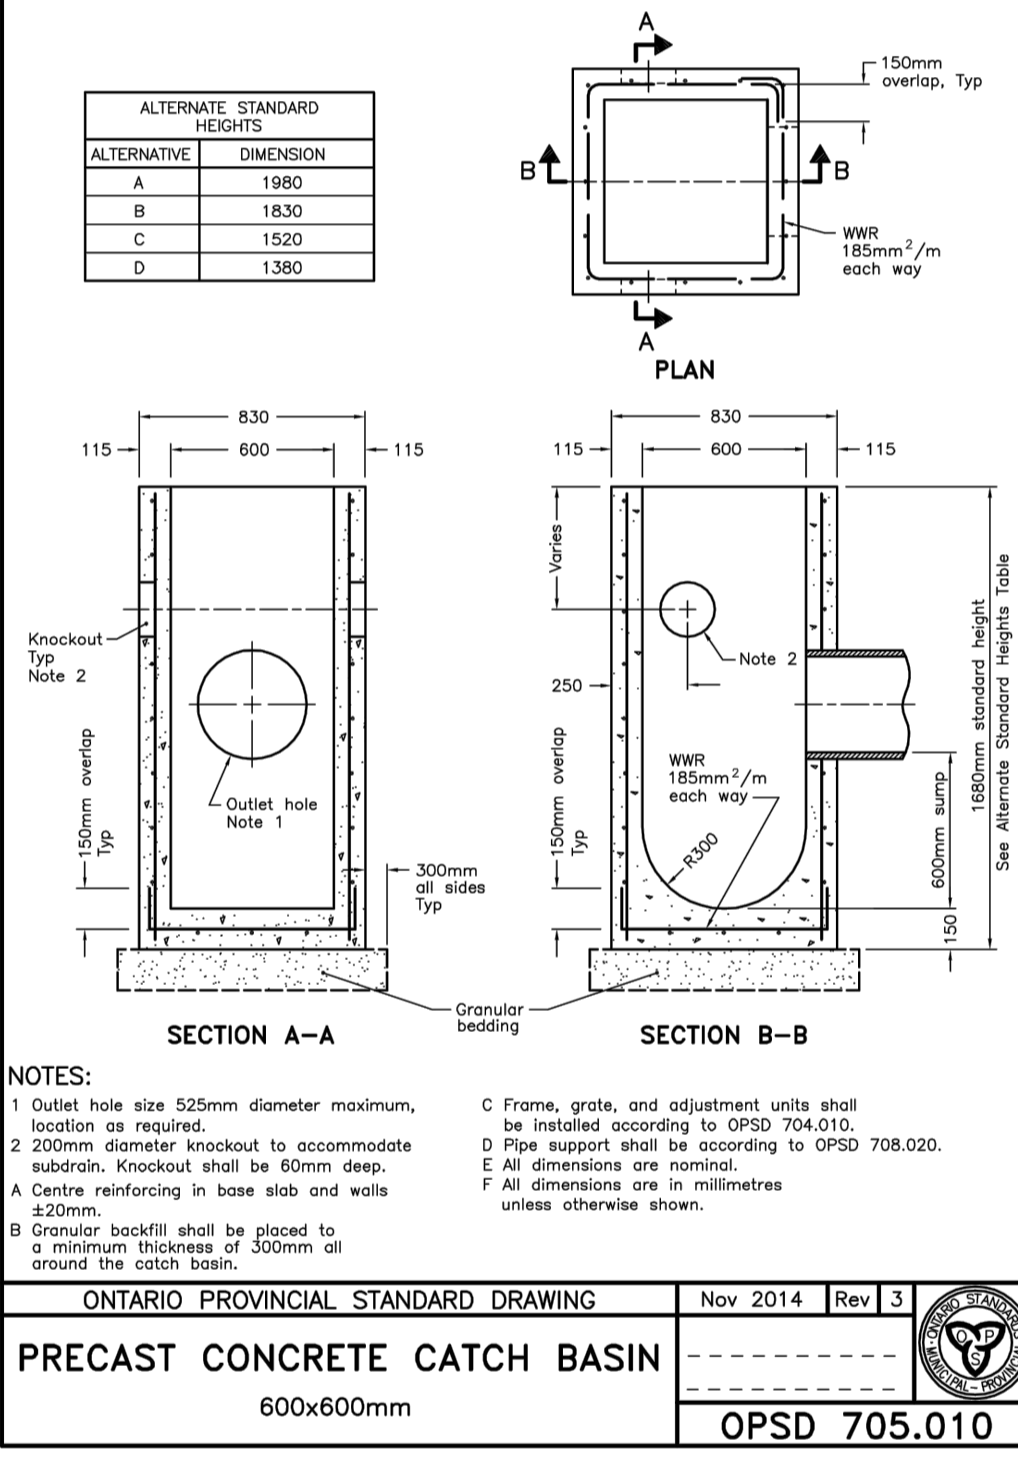

NOTES:
1. Outlet hole size 525mm diameter maximum, location as required.
2. 200mm diameter knockout to accommodate substrate. Knockout shall be 60mm deep.
A Centre reinforcing in base slab and walls 20mm.
B Granular backfill shall be placed to a minimum thickness of 300mm all around the catch basin.
C Frame, grate, and adjustment units shall be installed according to OPSD 704.010.
D Pipe support shall be according to OPSD 708.020.
E All dimensions are nominal.
F All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3
PRECAST CONCRETE CATCH BASIN
600x600mm
OPSD 705.010

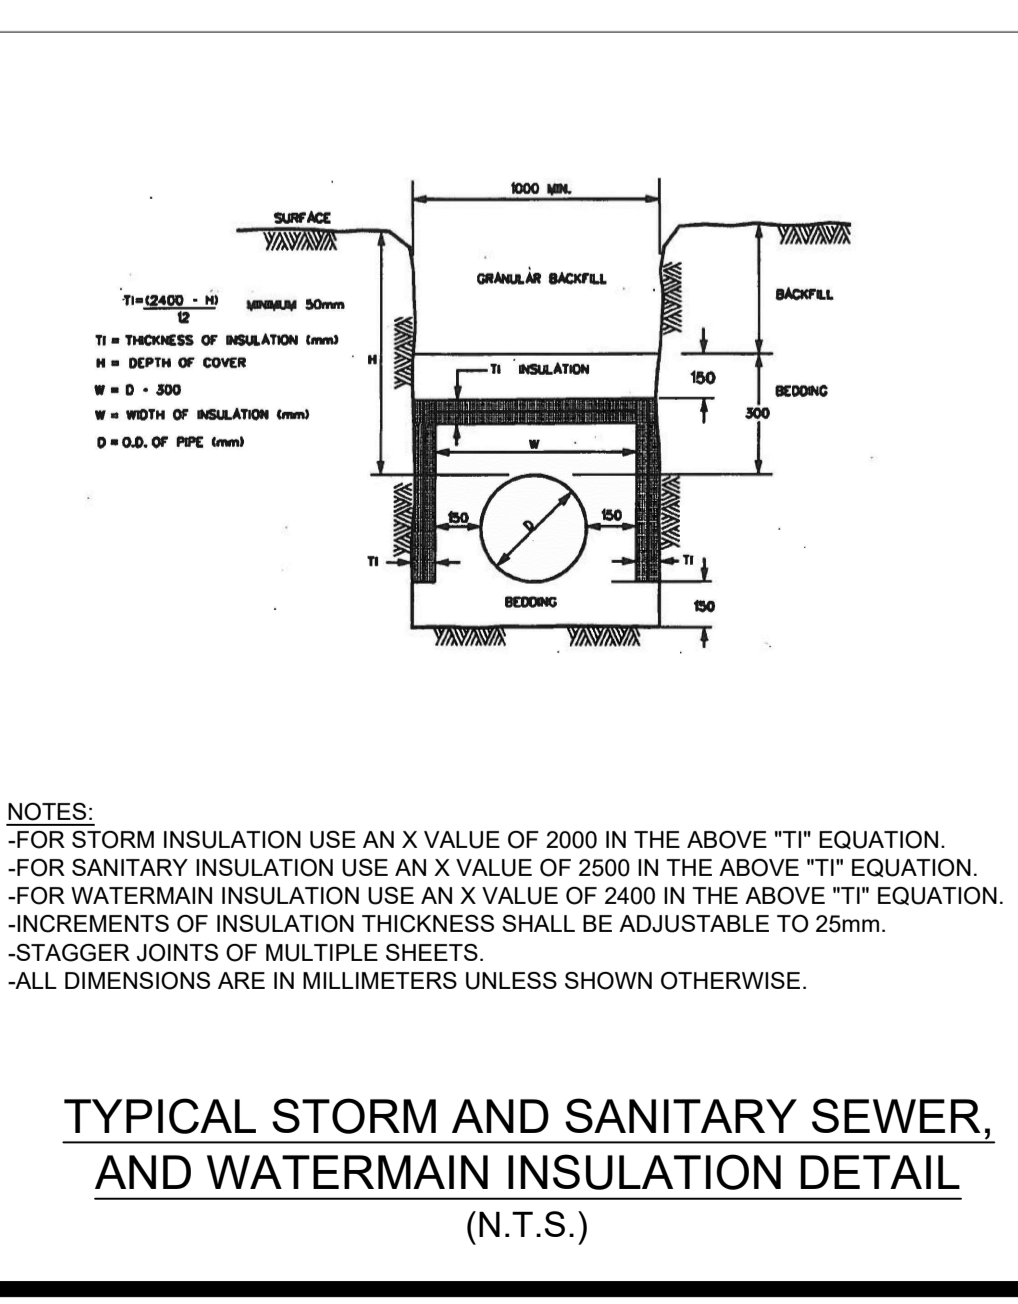

NOTES:
-FOR STORM INSULATION USE AN X VALUE OF 2000 IN THE ABOVE "TI" EQUATION.
-FOR SANITARY INSULATION USE AN X VALUE OF 2500 IN THE ABOVE "TI" EQUATION.
-FOR WATERMAIN INSULATION USE AN X VALUE OF 2400 IN THE ABOVE "TI" EQUATION.
-INCREMENTS OF INSULATION THICKNESS SHALL BE ADJUSTABLE TO 25mm.
-STAGGER JOINTS OF MULTIPLE SHEETS.
-ALL DIMENSIONS ARE IN MILLIMETERS UNLESS SHOWN OTHERWISE.

TYPICAL STORM AND SANITARY SEWER, AND WATERMAIN INSULATION DETAIL (N.T.S.)

USE AND INTERPRETATION OF DRAWINGS
GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION ARE PART OF THE CONTRACT DOCUMENTS AND DESCRIBE USE AND INTENT OF THE DRAWING. THE CONTRACT DOCUMENTS INCLUDE NOT ONLY THE DRAWINGS, BUT ALSO THE OWNER-CONTRACTOR AGREEMENTS, CONDITIONS OF THE CONTRACT, THE SPECIFICATIONS, ADDENDA, AND MODIFICATIONS ISSUED AFTER EXECUTION OF THE CONTRACT. THESE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ANY ONE SHALL BE BINDING AS REQUIRED BY ALL. WORK NOT COMPLETELY DELINEATED HEREON SHALL BE CONSTRUCTED OF THE SAME MATERIALS AND DETAIL AS SHOWN UNLESS OTHERWISE SHOWN COMPLETELY ELSEWHERE IN THE CONTRACT DOCUMENTS.
BY USE OF THE DRAWINGS FOR CONSTRUCTION OF THE PROJECT, THE OWNER CONFIRMS THAT HE HAS REVIEWED AND APPROVED THE DRAWINGS. THE CONTRACTOR CONFIRMS THAT HE HAS VISITED THE SITE, FAMILIARIZED HIMSELF WITH THE LOCAL CONDITIONS, VERIFIED FIELD DIMENSIONS AND CORRELATED HIS OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.
AS INSTRUMENTS OF SERVICE ALL DRAWINGS, SPECIFICATIONS, CAD FILES OR OTHER ELECTRONIC MEDIA AND COPIES THERE OF FURNISHED BY THE ENGINEER ARE HIS PROPERTY. THEY ARE TO BE USED ONLY FOR THIS PROJECT AND ARE NOT TO BE USED ON ANY OTHER PROJECT, INCLUDING REPEATS OF THE PROJECT. CHANGES TO THE DRAWINGS MAY ONLY BE MADE BY THE ENGINEER.
UNLESS THE REVISION TITLE IS "ISSUED FOR CONSTRUCTION", THESE DRAWINGS SHALL BE CONSIDERED PRELIMINARY AND SHALL NOT BE USED AS A CONSTRUCTION DOCUMENT.
THESE DRAWINGS ILLUSTRATE THE WORK TO BE DONE. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTION, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. CONTRACTOR SHALL DETERMINE ALL CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SUBMITTAL OF A BID TO PERFORM THIS WORK IS ACKNOWLEDGEMENT OF THE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK AND THE BID PRICE. NO CLAIMS FOR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.
UNAUTHORIZED CHANGES:
IN THE EVENT OF THE CLIENT, THE CLIENT'S CONTRACTORS OR SUBCONTRACTORS, OR ANYONE FOR WHOM THE CLIENT IS LEGALLY LIABLE MAKES OR PERMITS TO BE MADE ANY CHANGES TO ANY REPORTS, PLANS, SPECIFICATIONS OR OTHER CONSTRUCTION DOCUMENTS PREPARED BY LRL ASSOCIATES LTD. (LRL) WITHOUT OBTAINING LRL'S PRIOR WRITTEN CONSENT, THE CLIENT SHALL ASSUME FULL RESPONSIBILITY FOR THE RESULTS OF SUCH CHANGES. THEREFORE THE CLIENT AGREES TO WAIVE ANY CLAIM AGAINST LRL AND TO RELEASE LRL FROM ANY LIABILITY ARISING DIRECTLY OR INDIRECTLY FROM SUCH UNAUTHORIZED CHANGES.
IN ADDITION, THE CLIENT AGREES TO THE FULLEST EXTENT PERMITTED BY LAW, TO INDEMNIFY AND HOLD HARMLESS LRL FROM ANY DAMAGES, LIABILITIES OR COST, INCLUDING REASONABLE ATTORNEY'S FEES AND COST OF DEFENSE, ARISING FROM SUCH CHANGES.

CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS BEFORE START OF CONSTRUCTION.
THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHERS' FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.
CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES BEFORE WORK COMMENCES. DO NOT SCALE DRAWINGS.

No.	REVISIONS	BY	DATE
05	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	31 OCT 2022
04	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	22 SEPT 2021
03	RE-ISSUED FOR SITE PLAN APPLICATION	K.H.	23 DEC 2020
02	ISSUED FOR CLIENT REVIEW	K.H.	11 DEC 2020
01	ISSUED FOR CLIENT APPROVAL	K.H.	11 MAR 2020

NOT AUTHENTIC UNLESS SIGNED AND DATED

LRL
ENGINEERING | INGENIERIE
5430 Canotek Road | Ottawa, ON, K1J 9G2
www.lrl.ca | (613) 842-3434

CLIENT: THE HINDU HERITAGE CENTRE OF OTTAWA CARLETON

DESIGNED BY: P.P. DRAWN BY: K.H. APPROVED BY: M.B.

PROJECT: PROPOSED ASSEMBLY HALL 4835 BANK STREET, OTTAWA

DRAWING TITLE: CONSTRUCTION DETAIL PLAN

PROJECT NO: 170132
DATE: JAN2020

C902

File no.: D017-12-20-0069

DRAWING NOT TO BE USED FOR CONSTRUCTION

GENERAL NOTES

1. ALL DIMENSIONS INDICATED ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SPECIFIED.
2. JELLYFISH STRUCTURE INLET AND OUTLET PIPE SIZE AND ORIENTATION SHOWN FOR INFORMATIONAL PURPOSES ONLY.
3. UNLESS OTHERWISE NOTED, INFRASTRUCTURE SUCH AS ALL UPSTREAM DIVERSION STRUCTURES, CONNECTING STRUCTURES, OR PIPE CONDUITS CONNECTING TO COMPLETE THE JELLYFISH SYSTEM SHALL BE PROVIDED AND ADDRESSED SEPARATELY.
4. DRAWING FOR INFORMATION PURPOSES ONLY. REFER TO ENGINEERS SITEABILITY PLAN FOR STRUCTURE ORIENTATION.
5. NO PRODUCT SUBSTITUTIONS SHALL BE ACCEPTED UNLESS SUBMITTED TO DARS PRIOR TO PROJECTS 90 DATE, OR AS DIRECTED BY THE ENGINEER OF RECORD.

JELLYFISH STRUCTURE & DESIGN NOTES


1. THE MAXIMUM MAINTENANCE ACCESS WALL TO BE USED FOR CLEANOUT AND ACCESS BELOW CARTRIDGE DECK.
2. CARTRIDGES OR DOORS OF THE JELLYFISH MANHOLE STRUCTURE TO EXTEND TO DESIGN FINISH GRADE. DEPTHS IN EXCESS OF 3.81 M (12') MAY REQUIRE THE DESIGN AND INSTALLATION OF INTERMEDIATE SAFETY GRATES OR OTHER STRUCTURAL ELEMENTS.
3. CASTINGS AND GRADE INGS, OR DOORS AND DOOR RISERS, OR BOTH SHALL BE GROUTED FOR WATER TIGHTNESS.
4. STRUCTURE SHALL MEET ASHTO M30.2 ASSUMING EARTH COVER OF 0.7', J. AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET ASHTO M30.2 LOAD RATING AND BE CAST WITH THE MANHOLE LOG.
5. ALL STRUCTURAL SECTIONS AND PARTS TO MEET OR EXCEED ASTM C-476, ASTM C-448, AND ASTM A-902 CORRESPONDING TO ASHTO SPECIFICATIONS, AND ANY OTHER SITE OR LOCAL STANDARDS.
6. CONCRETE RISER SECTIONS FROM BOTTOM TO TOP SHALL BE ADDED AS REQUIRED INCLUDING TRANSITION PIECES TO SMALLER DIAMETER RISERS FOR CONTRACT ACCESSING THE STRUCTURE TO PERFORM MAINTENANCE.
7. IF MINIMUM DEPTH FROM TOP OF CARTRIDGE DECK TO BOTTOM OF STRUCTURE TOP SLAB NOT AVAILABLE, HATCH DOORS SHOULD BE SIZED TO PROVIDE FULL ACCESS ABOVE THE CARTRIDGES TO ACCOMMODATE MAINTENANCE.
8. STEPS TO BE APPROXIMATELY 300 MM (12") APART AND DIMENSIONS MUST MEET LOCAL STANDARDS. STEPS MUST BE INSTALLED AFTER CARTRIDGE DECK IS IN PLACE.
9. COMPARISON OF INLET AND OUTLET PIPE CAPACITY TO MEET SITE'S NEEDS. IT IS THE RESPONSIBILITY OF OTHERS TO PROPERLY PROTECT THE TREATMENT DEVICE AND KEEP THE DEVICE OPERATIONAL DURING CONSTRUCTION. FILTER CARTRIDGES SHALL NOT BE INSTALLED UNTIL THE PROJECT SITE IS CLEAN AND FREE OF DEBRIS. BY OTHERS, THE PROJECT SITE INCLUDES ANY SURFACE THAT CONTRIBUTES TO RUNOFF TO THE TREATMENT DEVICE. CARTRIDGES SHALL BE FURNISHED NEW, AT THE TIME OF FINAL ACCEPTANCE. THIS DRAWING MUST BE VIEWED IN CONJUNCTION WITH THE STANDING JELLYFISH SPECIFICATION, AND STORMWATER QUALITY FILTER TREATMENT JELLYFISH DOCUMENTS.

INSTALLATION NOTES

- A. ALL EXISTING HATCH, DEPTH, AND/OR ANTI-FILTRATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STRUCTURE LIFTING CLUTCHES PROVIDED.
- C. CONSTRUCTION WILL INSTALL AND LEVEL THE STRUCTURE, SEALING THE JOINTS, LINE ENTRY AND EXIT POINTS NON-SHIPPING GROUT WITH APPROVED WATERPROOF OR FLEXIBLE BOOT).
- D. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.
- E. CARTRIDGE INSTALLATION BY AIRLIFT SHALL OCCUR ONLY AFTER SITE HAS BEEN STABILIZED AND THE JELLYFISH UNIT IS CLEAN AND FREE OF DEBRIS. CONTACT MANUFACTURER TO COORDINATE CARTRIDGE INSTALLATION WITH SITE STABILIZATION.

NO.	DESCRIPTION	DATE	BY
1	REVISION		
2	REVISION		
3	REVISION		
4	REVISION		
5	REVISION		
6	REVISION		
7	REVISION		
8	REVISION		
9	REVISION		
10	REVISION		

FOR SITE SPECIFIC DRAWINGS PLEASE CONTACT YOUR LOCAL JELLYFISH FILTER REPRESENTATIVE. SITE SPECIFIC DRAWINGS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME. SOME FIELD REVISIONS TO THE SYSTEM LOCATION OR CONNECTIONS MAY BE NECESSARY BASED ON AVAILABLE SPACE OR SITE CONFIGURATION REVISIONS. ELEVATIONS SHOULD BE MAINTAINED EXCEPT WHERE NOTED ON BYPASS STRUCTURE.

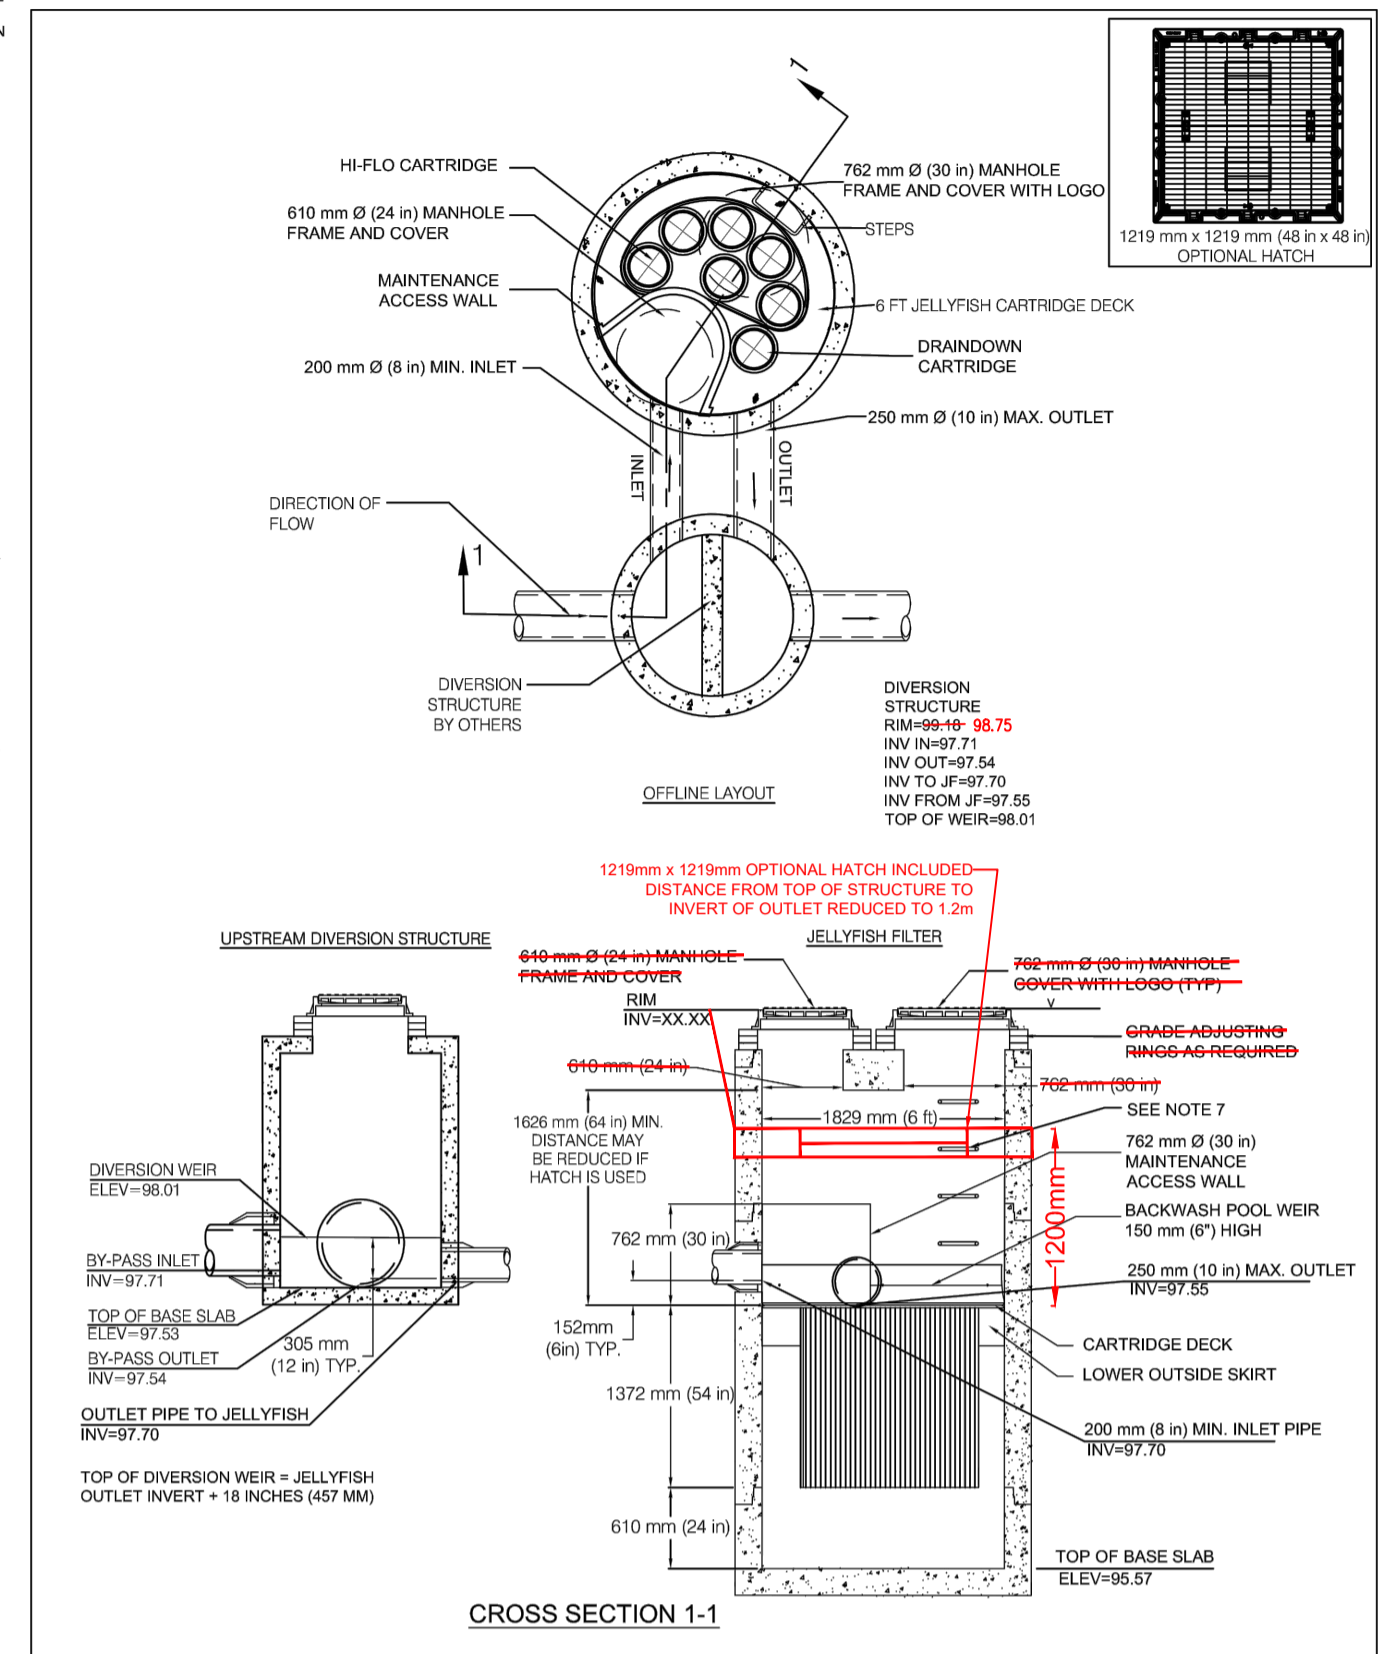

JELLYFISH DESIGN NOTES	
JELLYFISH TREATMENT CAPACITY AS A FUNCTION OF THE CARTRIDGE SELECTION AND THE NUMBER OF CARTRIDGES. THE STANDING MANHOLE STYLE IS SHOWN. (800 mm (31.5") MANHOLE JELLYFISH PEAK TREATMENT CAPACITY IS 2.8 L/s (1.16 CFS). TREATMENT FLOW RATE IS BASED ON 40% CARTRIDGE DEPTH.	
CARTRIDGE SELECTION	
INLET INVERT TO STRUCTURE BASE SLAB (mm)	15'
OUTLET INVERT TO STRUCTURE BASE SLAB (mm)	40'
MAX. CARTRIDGE HEIGHT (mm)	67'
MAX. CARTRIDGE HEIGHT (mm)	97'
MAX. CARTRIDGE HEIGHT (mm)	127'
MAX. CARTRIDGE HEIGHT (mm)	157'
MAX. CARTRIDGE HEIGHT (mm)	187'
MAX. CARTRIDGE HEIGHT (mm)	217'
MAX. CARTRIDGE HEIGHT (mm)	247'
MAX. CARTRIDGE HEIGHT (mm)	277'
MAX. CARTRIDGE HEIGHT (mm)	307'
MAX. CARTRIDGE HEIGHT (mm)	337'
MAX. CARTRIDGE HEIGHT (mm)	367'
MAX. CARTRIDGE HEIGHT (mm)	397'
MAX. CARTRIDGE HEIGHT (mm)	427'
MAX. CARTRIDGE HEIGHT (mm)	457'
MAX. CARTRIDGE HEIGHT (mm)	487'
MAX. CARTRIDGE HEIGHT (mm)	517'
MAX. CARTRIDGE HEIGHT (mm)	547'
MAX. CARTRIDGE HEIGHT (mm)	577'
MAX. CARTRIDGE HEIGHT (mm)	607'
MAX. CARTRIDGE HEIGHT (mm)	637'
MAX. CARTRIDGE HEIGHT (mm)	667'
MAX. CARTRIDGE HEIGHT (mm)	697'
MAX. CARTRIDGE HEIGHT (mm)	727'
MAX. CARTRIDGE HEIGHT (mm)	757'
MAX. CARTRIDGE HEIGHT (mm)	787'
MAX. CARTRIDGE HEIGHT (mm)	817'
MAX. CARTRIDGE HEIGHT (mm)	847'
MAX. CARTRIDGE HEIGHT (mm)	877'
MAX. CARTRIDGE HEIGHT (mm)	907'
MAX. CARTRIDGE HEIGHT (mm)	937'
MAX. CARTRIDGE HEIGHT (mm)	967'
MAX. CARTRIDGE HEIGHT (mm)	997'
MAX. CARTRIDGE HEIGHT (mm)	1027'
MAX. CARTRIDGE HEIGHT (mm)	1057'
MAX. CARTRIDGE HEIGHT (mm)	1087'
MAX. CARTRIDGE HEIGHT (mm)	1117'
MAX. CARTRIDGE HEIGHT (mm)	1147'
MAX. CARTRIDGE HEIGHT (mm)	1177'
MAX. CARTRIDGE HEIGHT (mm)	1207'
MAX. CARTRIDGE HEIGHT (mm)	1237'
MAX. CARTRIDGE HEIGHT (mm)	1267'
MAX. CARTRIDGE HEIGHT (mm)	1297'
MAX. CARTRIDGE HEIGHT (mm)	1327'
MAX. CARTRIDGE HEIGHT (mm)	1357'
MAX. CARTRIDGE HEIGHT (mm)	1387'
MAX. CARTRIDGE HEIGHT (mm)	1417'
MAX. CARTRIDGE HEIGHT (mm)	1447'
MAX. CARTRIDGE HEIGHT (mm)	1477'
MAX. CARTRIDGE HEIGHT (mm)	1507'
MAX. CARTRIDGE HEIGHT (mm)	1537'
MAX. CARTRIDGE HEIGHT (mm)	1567'
MAX. CARTRIDGE HEIGHT (mm)	1597'
MAX. CARTRIDGE HEIGHT (mm)	1627'
MAX. CARTRIDGE HEIGHT (mm)	1657'
MAX. CARTRIDGE HEIGHT (mm)	1687'
MAX. CARTRIDGE HEIGHT (mm)	1717'
MAX. CARTRIDGE HEIGHT (mm)	1747'
MAX. CARTRIDGE HEIGHT (mm)	1777'
MAX. CARTRIDGE HEIGHT (mm)	1807'
MAX. CARTRIDGE HEIGHT (mm)	1837'
MAX. CARTRIDGE HEIGHT (mm)	1867'
MAX. CARTRIDGE HEIGHT (mm)	1897'
MAX. CARTRIDGE HEIGHT (mm)	1927'
MAX. CARTRIDGE HEIGHT (mm)	1957'
MAX. CARTRIDGE HEIGHT (mm)	1987'
MAX. CARTRIDGE HEIGHT (mm)	2017'
MAX. CARTRIDGE HEIGHT (mm)	2047'
MAX. CARTRIDGE HEIGHT (mm)	2077'
MAX. CARTRIDGE HEIGHT (mm)	2107'
MAX. CARTRIDGE HEIGHT (mm)	2137'
MAX. CARTRIDGE HEIGHT (mm)	2167'
MAX. CARTRIDGE HEIGHT (mm)	2197'
MAX. CARTRIDGE HEIGHT (mm)	2227'
MAX. CARTRIDGE HEIGHT (mm)	2257'
MAX. CARTRIDGE HEIGHT (mm)	2287'
MAX. CARTRIDGE HEIGHT (mm)	2317'
MAX. CARTRIDGE HEIGHT (mm)	2347'
MAX. CARTRIDGE HEIGHT (mm)	2377'
MAX. CARTRIDGE HEIGHT (mm)	2407'
MAX. CARTRIDGE HEIGHT (mm)	2437'
MAX. CARTRIDGE HEIGHT (mm)	2467'
MAX. CARTRIDGE HEIGHT (mm)	2497'
MAX. CARTRIDGE HEIGHT (mm)	2527'
MAX. CARTRIDGE HEIGHT (mm)	2557'
MAX. CARTRIDGE HEIGHT (mm)	2587'
MAX. CARTRIDGE HEIGHT (mm)	2617'
MAX. CARTRIDGE HEIGHT (mm)	2647'
MAX. CARTRIDGE HEIGHT (mm)	2677'
MAX. CARTRIDGE HEIGHT (mm)	2707'
MAX. CARTRIDGE HEIGHT (mm)	2737'
MAX. CARTRIDGE HEIGHT (mm)	2767'
MAX. CARTRIDGE HEIGHT (mm)	2797'
MAX. CARTRIDGE HEIGHT (mm)	2827'
MAX. CARTRIDGE HEIGHT (mm)	2857'
MAX. CARTRIDGE HEIGHT (mm)	2887'
MAX. CARTRIDGE HEIGHT (mm)	2917'
MAX. CARTRIDGE HEIGHT (mm)	2947'
MAX. CARTRIDGE HEIGHT (mm)	2977'
MAX. CARTRIDGE HEIGHT (mm)	3007'
MAX. CARTRIDGE HEIGHT (mm)	3037'
MAX. CARTRIDGE HEIGHT (mm)	3067'
MAX. CARTRIDGE HEIGHT (mm)	3097'
MAX. CARTRIDGE HEIGHT (mm)	3127'
MAX. CARTRIDGE HEIGHT (mm)	3157'
MAX. CARTRIDGE HEIGHT (mm)	3187'
MAX. CARTRIDGE HEIGHT (mm)	3217'
MAX. CARTRIDGE HEIGHT (mm)	3247'
MAX. CARTRIDGE HEIGHT (mm)	3277'
MAX. CARTRIDGE HEIGHT (mm)	3307'
MAX. CARTRIDGE HEIGHT (mm)	3337'
MAX. CARTRIDGE HEIGHT (mm)	3367'
MAX. CARTRIDGE HEIGHT (mm)	3397'
MAX. CARTRIDGE HEIGHT (mm)	3427'
MAX. CARTRIDGE HEIGHT (mm)	3457'
MAX. CARTRIDGE HEIGHT (mm)	3487'
MAX. CARTRIDGE HEIGHT (mm)	3517'
MAX. CARTRIDGE HEIGHT (mm)	3547'
MAX. CARTRIDGE HEIGHT (mm)	3577'
MAX. CARTRIDGE HEIGHT (mm)	3607'
MAX. CARTRIDGE HEIGHT (mm)	3637'
MAX. CARTRIDGE HEIGHT (mm)	3667'
MAX. CARTRIDGE HEIGHT (mm)	3697'
MAX. CARTRIDGE HEIGHT (mm)	3727'
MAX. CARTRIDGE HEIGHT (mm)	3757'
MAX. CARTRIDGE HEIGHT (mm)	3787'
MAX. CARTRIDGE HEIGHT (mm)	3817'
MAX. CARTRIDGE HEIGHT (mm)	3847'
MAX. CARTRIDGE HEIGHT (mm)	3877'
MAX. CARTRIDGE HEIGHT (mm)	3907'
MAX. CARTRIDGE HEIGHT (mm)	3937'
MAX. CARTRIDGE HEIGHT (mm)	3967'
MAX. CARTRIDGE HEIGHT (mm)	3997'
MAX. CARTRIDGE HEIGHT (mm)	4027'
MAX. CARTRIDGE HEIGHT (mm)	4057'
MAX. CARTRIDGE HEIGHT (mm)	4087'
MAX. CARTRIDGE HEIGHT (mm)	4117'
MAX. CARTRIDGE HEIGHT (mm)	4147'
MAX. CARTRIDGE HEIGHT (mm)	4177'
MAX. CARTRIDGE HEIGHT (mm)	4207'
MAX. CARTRIDGE HEIGHT (mm)	4237'
MAX. CARTRIDGE HEIGHT (mm)	4267'
MAX. CARTRIDGE HEIGHT (mm)	4297'
MAX. CARTRIDGE HEIGHT (mm)	4327'
MAX. CARTRIDGE HEIGHT (mm)	4357'
MAX. CARTRIDGE HEIGHT (mm)	4387'
MAX. CARTRIDGE HEIGHT (mm)	4417'
MAX. CARTRIDGE HEIGHT (mm)	4447'
MAX. CARTRIDGE HEIGHT (mm)	4477'
MAX. CARTRIDGE HEIGHT (mm)	4507'
MAX. CARTRIDGE HEIGHT (mm)	4537'
MAX. CARTRIDGE HEIGHT (mm)	4567'
MAX. CARTRIDGE HEIGHT (mm)	4597'
MAX. CARTRIDGE HEIGHT (mm)	4627'
MAX. CARTRIDGE HEIGHT (mm)	4657'
MAX. CARTRIDGE HEIGHT (mm)	4687'
MAX. CARTRIDGE HEIGHT (mm)	4717'
MAX. CARTRIDGE HEIGHT (mm)	4747'
MAX. CARTRIDGE HEIGHT (mm)	4777'
MAX. CARTRIDGE HEIGHT (mm)	4807'
MAX. CARTRIDGE HEIGHT (mm)	4837'
MAX. CARTRIDGE HEIGHT (mm)	4867'
MAX. CARTRIDGE HEIGHT (mm)	4897'
MAX. CARTRIDGE HEIGHT (mm)	4927'
MAX. CARTRIDGE HEIGHT (mm)	4957'
MAX. CARTRIDGE HEIGHT (mm)	4987'
MAX. CARTRIDGE HEIGHT (mm)	5017'
MAX. CARTRIDGE HEIGHT (mm)	5047'
MAX. CARTRIDGE HEIGHT (mm)	5077'
MAX. CARTRIDGE HEIGHT (mm)	5107'
MAX. CARTRIDGE HEIGHT (mm)	5137'
MAX. CARTRIDGE HEIGHT (mm)	5167'
MAX. CARTRIDGE HEIGHT (mm)	5197'
MAX. CARTRIDGE HEIGHT (mm)	5227'
MAX. CARTRIDGE HEIGHT (mm)	5257'
MAX. CARTRIDGE HEIGHT (mm)	5287'
MAX. CARTRIDGE HEIGHT (mm)	5317'
MAX. CARTRIDGE HEIGHT (mm)	5347'
MAX. CARTRIDGE HEIGHT (mm)	5377'
MAX. CARTRIDGE HEIGHT (mm)	5407'
MAX. CARTRIDGE HEIGHT (mm)	5437'
MAX. CARTRIDGE HEIGHT (mm)	5467'
MAX. CARTRIDGE HEIGHT (mm)	5497'
MAX. CARTRIDGE HEIGHT (mm)	5527'
MAX. CARTRIDGE HEIGHT (mm)	5557'
MAX. CARTRIDGE HEIGHT (mm)	5587'
MAX. CARTRIDGE HEIGHT (mm)	5617'
MAX. CARTRIDGE HEIGHT (mm)	5647'
MAX. CARTRIDGE HEIGHT (mm)	5677'
MAX. CARTRIDGE HEIGHT (mm)	5707'
MAX. CARTRIDGE HEIGHT (mm)	5737'
MAX. CARTRIDGE HEIGHT (mm)	5767'
MAX. CARTRIDGE HEIGHT (mm)	5797'
MAX. CARTRIDGE HEIGHT (mm)	5827'
MAX. CARTRIDGE HEIGHT (mm)	5857'
MAX. CARTRIDGE HEIGHT (mm)	5887'
MAX. CARTRIDGE HEIGHT (mm)	5917'
MAX. CARTRIDGE HEIGHT (mm)	5947'
MAX. CARTRIDGE HEIGHT (mm)	5977'
MAX. CARTRIDGE HEIGHT (mm)	6007'
MAX. CARTRIDGE HEIGHT (mm)	6037'
MAX. CARTRIDGE HEIGHT (mm)	6067'
MAX. CARTRIDGE HEIGHT (mm)	6097'
MAX. CARTRIDGE HEIGHT (mm)	6127'
MAX. CARTRIDGE HEIGHT (mm)	6157'
MAX. CARTRIDGE HEIGHT (mm)	6187'
MAX. CARTRIDGE HEIGHT (mm)	6217'
MAX. CARTRIDGE HEIGHT (mm)	6247'
MAX. CARTRIDGE HEIGHT (mm)	6277'
MAX. CARTRIDGE HEIGHT (mm)	6307'
MAX. CARTRIDGE HEIGHT (mm)	6337'
MAX. CARTRIDGE HEIGHT (mm)	6367'
MAX. CARTRIDGE HEIGHT (mm)	6397'
MAX. CARTRIDGE HEIGHT (mm)	6427'
MAX. CARTRIDGE HEIGHT (mm)	6457'
MAX. CARTRIDGE HEIGHT (mm)	6487'
MAX. CARTRIDGE HEIGHT (mm)	6517'
MAX. CARTRIDGE HEIGHT (mm)	6547'
MAX. CARTRIDGE HEIGHT (mm)	6577'
MAX. CARTRIDGE HEIGHT (mm)	6607'
MAX. CARTRIDGE HEIGHT (mm)	6637'
MAX. CARTRIDGE HEIGHT (mm)	6667'
MAX. CARTRIDGE HEIGHT (mm)	6697'
MAX. CARTRIDGE HEIGHT (mm)	6727'
MAX. CARTRIDGE HEIGHT (mm)	6757'
MAX. CARTRIDGE HEIGHT (mm)	6787'
MAX. CARTRIDGE HEIGHT (mm)	6817'
MAX. CARTRIDGE HEIGHT (mm)	6847'
MAX. CARTRIDGE HEIGHT (mm)	6877'
MAX. CARTRIDGE HEIGHT (mm)	6907'
MAX. CARTRIDGE HEIGHT (mm)	6937'
MAX. CARTRIDGE HEIGHT (mm)	6967'
MAX. CARTRIDGE HEIGHT (mm)	6997'
MAX. CARTRIDGE HEIGHT (mm)	7027'
MAX. CARTRIDGE HEIGHT (mm)	7057'
MAX. CARTRIDGE HEIGHT (mm)	7087'
MAX. CARTRIDGE HEIGHT (mm)	7117'
MAX. CARTRIDGE HEIGHT (mm)	7147'
MAX. CARTRIDGE HEIGHT (mm)	7177'
MAX. CARTRIDGE HEIGHT (mm)	7207'
MAX. CARTRIDGE HEIGHT (mm)	7237'
MAX. CARTRIDGE HEIGHT (mm)	7267'
MAX. CARTRIDGE HEIGHT (mm)	7297'
MAX. CARTRIDGE HEIGHT (mm)	7327'
MAX. CARTRIDGE HEIGHT (mm)	7357'
MAX. CARTRIDGE HEIGHT (mm)	7387'
MAX. CARTRIDGE HEIGHT (mm)	7417'
MAX. CARTRIDGE HEIGHT (mm)	7447'
MAX. CARTRIDGE HEIGHT (mm)	7477'
MAX. CARTRIDGE HEIGHT (mm)	7507'
MAX. CARTRIDGE HEIGHT (mm)	7537'
MAX. CARTRIDGE HEIGHT (mm)	7567'
MAX. CARTRIDGE HEIGHT (mm)	7597'
MAX. CARTRIDGE HEIGHT (mm)	7627'
MAX. CARTRIDGE HEIGHT (mm)	7657'
MAX. CARTRIDGE HEIGHT (mm)	7687'
MAX. CARTRIDGE HEIGHT (mm)	7717'
MAX. CARTRIDGE HEIGHT (mm)	7747'
MAX. CARTRIDGE HEIGHT (mm)	7777'
MAX. CARTRIDGE HEIGHT (mm)	7807'
MAX. CARTRIDGE HEIGHT (mm)	7837'
MAX. CARTRIDGE HEIGHT (mm)	7867'
MAX. CARTRIDGE HEIGHT (mm)	7897'
MAX. CARTRIDGE HEIGHT (mm)	7927'
MAX. CARTRIDGE HEIGHT (mm)	7957'
MAX. CARTRIDGE HEIGHT (mm)	7987'
MAX. CARTRIDGE HEIGHT (mm)	8017'
MAX. CARTRIDGE HEIGHT (mm)	8047'
MAX. CARTRIDGE HEIGHT (mm)	8077'
MAX. CARTRIDGE HEIGHT (mm)	8107'
MAX. CARTRIDGE HEIGHT (mm)	8137'
MAX. CARTRIDGE HEIGHT (mm)	8167'
MAX. CARTRIDGE HEIGHT (mm)	8197'
MAX. CARTRIDGE HEIGHT (mm)	8227'
MAX. CARTRIDGE HEIGHT (mm)	8257'
MAX. CARTRIDGE HEIGHT (mm)	8287'
MAX. CARTRIDGE HEIGHT (mm)	8317'
MAX. CARTRIDGE HEIGHT (mm)	8347'
MAX. CARTRIDGE HEIGHT (mm)	8377'
MAX. CARTRIDGE HEIGHT (mm)	8407'
MAX. CARTRIDGE HEIGHT (mm)	8437'
MAX. CARTRIDGE HEIGHT (mm)	8467'
MAX. CARTRIDGE HEIGHT (mm)	8497'
MAX. CARTRIDGE HEIGHT (mm)	8527'
MAX. CARTRIDGE HEIGHT (mm)	8557'
MAX. CARTRIDGE HEIGHT (mm)	8587'
MAX. CARTRIDGE HEIGHT (mm)	8617'
MAX. CARTRIDGE HEIGHT (mm)	8647'
MAX. CARTRIDGE HEIGHT (mm)	8677'
MAX. CARTRIDGE HEIGHT (mm)	8707'
MAX. CARTRIDGE HEIGHT (mm)	8737'
MAX. CARTRIDGE HEIGHT (mm)	8767'
MAX. CARTRIDGE HEIGHT (mm)	8797'
MAX. CARTRIDGE HEIGHT (mm)	8827'
MAX. CARTRIDGE HEIGHT (mm)	8857'
MAX. CARTRIDGE HEIGHT (mm)	8887'
MAX. CARTRIDGE HEIGHT (mm)	8917'
MAX. CARTRIDGE HEIGHT (mm)	8947'
MAX. CARTRIDGE HEIGHT (mm)	8977'
MAX. CARTRIDGE HEIGHT (mm)	9007'
MAX. CARTRIDGE HEIGHT (mm)	9037'
MAX. CARTRIDGE HEIGHT (mm)	9067'
MAX. CARTRIDGE HEIGHT (mm)	9097'
MAX. CARTRIDGE HEIGHT (mm)	9127'
MAX. CARTRIDGE HEIGHT (mm)	9157'
MAX. CARTRIDGE HEIGHT (mm)	9187'
MAX. CARTRIDGE HEIGHT (mm)	9217'
MAX. CARTRIDGE HEIGHT (mm)	9247'
MAX. CARTRIDGE HEIGHT (mm)	9277'
MAX. CARTRIDGE HEIGHT (mm)	9307'
MAX. CARTRIDGE HEIGHT (mm)	9337'
MAX. CARTRIDGE HEIGHT (mm)	9367'
MAX. CARTRIDGE HEIGHT (mm)	9397'
MAX. CARTRIDGE HEIGHT (mm)	9427'
MAX. CARTRIDGE HEIGHT (mm)	9457'
MAX. CARTRIDGE HEIGHT (mm)	9487'
MAX. CARTRIDGE HEIGHT (mm)	9517'
MAX. CARTRIDGE HEIGHT (mm)	9547'
MAX. CARTRIDGE HEIGHT (mm)	9577'
MAX. CARTRIDGE HEIGHT (mm)	9607'
MAX. CARTRIDGE HEIGHT (mm)	9637'
MAX. CARTRIDGE HEIGHT (mm)	9667'
MAX. CARTRIDGE HEIGHT (mm)	9697'
MAX. CARTRIDGE HEIGHT (mm)	9727'
MAX. CARTRIDGE HEIGHT (mm)	9757'

APPENDIX P
Septic Design



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

3889 Rideau Valley Drive Box 599 Manotick, ON K4M 1A5

Septic File
21-344

STREET/CIVIC INITIAL
EMAIL ONLY

Phone: 613-692-3571 **PRESS "4" for septic office** 1-800-267-3504 Fax: 613-692-1507 Email: septic@rvca.ca

SITE ADDRESS: 4835 BANK (HALL) Township: OSG-HUN-GLO-FIT-CUM-NEP-GOU-RID-KAN-TOR

CONTACT: 1. GVE 2. 3.

INFORMATION FOR OWNER/APPLICANT

Attached is your Sewage System Permit. A minimum of two inspections are required before your proposed sewage system can be approved for use (additional inspections may be required for clay soils/bedrock and/or re-inspections). Inspections must be requested in writing. Please see attached:

- Inspection fax request form (all inspections MUST be requested in writing)
- As-built components and drawing form
- Copy of the approved application and schedule pages
- Approved Part 8 permit: ***Electronic copy only** - Be sure to **INCLUDE** in Building Application Package for Plans Examiner at **CITY of OTTAWA** client services, if **NEW or RENO** construction project.

Special Note

- A permit is **valid for 12 months** from the original date of issuance noted in "permit date". If lapsed, it **may be renewed only once** for a period of 12 months from the date of expiry.

- No person shall make a material change or cause a material change to be made to a plan, specification, document or other information on the basis of which a permit was issued without notifying, filing details with and obtaining the authorization of the Chief Building Official. (*Building Code Act 1992, c.23, s.8(12)*)

Sewage System Permit Construction Requirements

1. Clay Soils/Bedrock only (if required per issued Approval)

In clay soils/bedrock, a site preparation inspection is required. The total contact area must be properly prepared. Scarification must be done under dry conditions prior to importing leaching bed fill.

2. Installation Inspection - 2nd inspection

When the sewage system is substantially completed (i.e., before the final fill is placed over the septic tank and leaching bed system) an installation inspection is required. Prior to any inspection request, the following must be submitted:

- "as-built components" and "as-built drawings" — see attached form
- "engineer letter" — if the system is engineered
- grain size analysis and weight bills for all Filter Media types of septic systems
- Weight bills for washed septic stone, where applicable
- Maintenance/service contract for treatment unit installed

3. Final Grading Inspection - 3rd inspection

When construction of the sewage system is complete, a final grading inspection is required. Before a Certificate of Completion can be issued, the following must be complete:

- The leaching bed and septic tank must be covered with sand fill and topsoil and graded accordingly
- All conditions of the Sewage System Permit & comments on the installation inspection report must be met
- The depth of cover & material type must be identified by inspection pipes or holes placed over trenches at 4 corners of bed
- The 4 corners of the bed must be staked

JULY 2020

Location: 2:Administration templates\CoverPart8page



FEB 18 2022

21-344

REFER TO:
LETTER OF AUTHORIZATION
PITTAWA

Owner: Harish Gupta The Hindu Temple of Ottawa Carleton
Address: 4835 Bank St
Gloucester ON K1X 1G6

Phone No.: (613) 737-5939 Cell No.: (613) 866-2984
Work No.: _____ Fax No.: _____

LOCATION OF PROPERTY:

Lot No.: 22
Concession No.: 5RF
Sub lot/Part No.: _____
R. Plan No.: 5R3156
Civic Address: 4835 Bank St
Municipality: Gloucester
Roll No.: _____

Commercial: (provide description of building and intended use)
Proposed Building

I, the above – mentioned authorize Green Valley Environmental Services to act as my agent to apply for and obtain a sewage system permit from the responsible Approval Agency.

Signature:  _____ Date: 7.06.2021

RVCA RECEIVED

FEB 18 2022

Application for a Permit to Construct or Demolish

This form is authorized under subsection 8(1.1) of the Building Code Act, 1992

PERMIT TO:

For use by Principal Authority

Application number:

Permit number (if different):

Date received:

Roll number:

OTTAWA SEPTIC SYSTEM OFFICE

Application submitted to: _____
(Name of municipality, upper-tier municipality, board of health or conservation authority)

A. Project information

Building number, street name

4835 Bank St.

Unit number

Lot/con.

Municipality

Gloucester

Postal code

K1X 1G6

Plan number/other description

5R3156

Project value est. \$

Area of work (m²)

B. Purpose of application

New construction

Addition to an existing building

Alteration/repair

Demolition

Conditional Permit

Proposed use of building

Commercial Assembly.

Current use of building

Description of proposed work

Install new septic system for Proposed Assembly building (Revision)
Existing Permit: 21-344

C. Applicant

Applicant is:

Owner or

Authorized agent of owner

Last name

First name

Corporation or partnership

Street address

6107 First Line Rd.

Green Valley Environmental

Unit number

Lot/con.

Municipality

North Gower

Postal code

K4M 1A7

Province

ON

Telephone number

(613) 692-2616

Fax

(613) 692-1802

E-mail

eng.ince.ring@gyregrp.ca

Cell number

()

D. Owner (if different from applicant)

Last name

Gupta

First name

Harsh

Corporation or partnership

The Hindu Temple of Ottawa Carleton

Street address

4835 Bank St.

Unit number

Lot/con.

Municipality

Gloucester

Postal code

K1X 1G6

Province

ON

Telephone number

(613) 737-5939

Fax

()

E-mail

eng.ince.ring@gyregrp.ca

Cell number

(613) 866-2984

Application for a Permit to Construct or Demolish - Effective January 1, 2014

RVCA RECEIVED
FEB 18 2022

E. Builder (optional)		OTTAWA	
Last name	First name	Corporation or partnership (if applicable)	
Street address	Postal code	Province	Unit number
Municipality	Telephone number ()	Fax ()	E-mail
F. Tarion Warranty Corporation (Ontario New Home Warranty Program)			
i. Is proposed construction for a new home as defined in the <i>Ontario New Home Warranties Plan Act</i> ? If no, go to section G.		Yes	No
ii. Is registration required under the <i>Ontario New Home Warranties Plan Act</i> ?		Yes	No

iii. If yes to (ii) provide registration number(s): _____

G. Required Schedules

- i) Attach Schedule 1 for each individual who reviews and takes responsibility for design activities.
- ii) Attach Schedule 2 where application is to construct on-site, install or repair a sewage system.


H. Completeness and compliance with applicable law

i) This application meets all the requirements of clauses 1.3.1.3 (5) (a) to (d) of Division C of the Building Code (the application is made in the correct form and by the owner or authorized agent, all applicable fields have been completed on the application and required schedules, and all required schedules are submitted). Payment has been made of all fees that are required, under the applicable by-law, resolution or regulation made under clause 7(1)(c) of the <i>Building Code Act, 1992</i> , to be paid when the application is made.	Yes	No
ii) This application is accompanied by the plans and specifications prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> .	Yes	No
iii) This application is accompanied by the information and documents prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> which enable the chief building official to determine whether the proposed building, construction or demolition will contravene any applicable law.	Yes	No
iv) The proposed building, construction or demolition will not contravene any applicable law.	Yes	No

I. Declaration of applicant

I, Jacob Purer (print name) declare that:

1. The information contained in this application, attached schedules, attached plans and specifications, and other attached documentation is true to the best of my knowledge.
2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.

Date February 7 2022 Signature of applicant 

Personal information contained in this form and schedules is collected under the authority of subsection 8(1.1) of the *Building Code Act, 1992*, and will be used in the administration and enforcement of the *Building Code Act, 1992*. Questions about the collection of personal information may be addressed to: a) the Chief Building Official of the municipality or upper-tier municipality to which this application is being made, or, b) the inspector having the powers and duties of a chief building official in relation to sewage systems or plumbing for an upper-tier municipality, board of health or conservation authority to whom this application is made, or, c) Director, Building and Development Branch, Ministry of Municipal Affairs and Housing 777 Bay St., 2nd Floor, Toronto, M5G 2E5 (416) 585-6666.

FEB 18 2022

Schedule 1: Designer Information

Use one form for each individual who ~~reviews and takes responsibility~~ ^{reviews and takes responsibility} for design activities with respect to the project.

A. Project Information		Building number, street name		4835 Bank St	Unit no.	Lot/con.	22/5	
Municipality	Gloucester	Postal code	K1X 1G6	Plan number/ other description				5R 3156
B. Individual who reviews and takes responsibility for design activities								
Name	Jacob Prner	Firm	Green Valley Environmental					Lot/con.
Street address	6107 First Line Rd.							Unit no.
Municipality	North Gower	Postal code	K4M 1A7	Province	ON			E-mail
Telephone number	(613) 692-2616	Fax number	(613) 692-1802					Cell number
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.2.1.1. of Division C]								
House		HVAC - House		Building Structural				
Small Buildings		Building Services		Plumbing - House				
Large Buildings		Detection, Lighting and Power		Plumbing - All Buildings				
Complex Buildings		Fire Protection		On-site Sewage Systems				
Description of designer's work	Design a septic system for proposed assembly building. Revision to Permit 21-344							
D. Declaration of Designer								
I, <u>Jacob Prner</u>	(print name)							
declare that (choose one as appropriate):								
I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4 of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories.								
Individual BCIN:	<u>113751</u>							
Firm BCIN:	<u>16035</u>							
I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5 of Division C, of the Building Code.								
Individual BCIN:	_____							
Basis for exemption from registration: _____								
The design work is exempt from the registration and qualification requirements of the Building Code.								
Basis for exemption from registration and qualification: _____								
I certify that:								
1. The information contained in this schedule is true to the best of my knowledge.								
2. I have submitted this application with the knowledge and consent of the firm.								
Date	<u>February 7 2022</u>	Signature of Designer <u>Jacob Prner</u>						

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) (c) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of practice, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

FILE #
21-344
OTTAWA

RVCA
FEB 18 2022

REFER TO: **Schedule 2: Sewage System Installer Information**

A. Project information			
Building number, street name	4835 Bank St.	Unit number	Lot/con. 24/5
Municipality	Gloversville	Plan number/ other description	5R3156
B. Sewage system installer			
Is the installer of the sewage system engaged in the business of constructing on-site, installing, repairing, servicing, cleaning or emptying sewage systems, in accordance with Building Code Article 3.3.1.1, Division C? <input checked="" type="checkbox"/> Yes (Continue to Section C) <input type="checkbox"/> No (Continue to Section E) Installer unknown at time of application (Continue to Section E)			
C. Registered installer information (where answer to B is "Yes")			
Name	Green Valley Environmental		
Street address	6107 First Line Rd.	BCIN	11234
Municipality	North Gower	Unit number	Lot/con.
Telephone number	(613) 692-2616	E-mail	
Fax	(613) 692-1802	Cell number	(613) 229-3900
D. Qualified supervisor information (where answer to section B is "Yes")			
Name of qualified supervisor(s)	Bill Seabrook		
	Building Code Identification Number (BCIN) 11234		
E. Declaration of Applicant:			

I, Jacob Prue (print name) _____ declare that:


I am the applicant for the permit to construct the sewage system. If the installer is unknown at time of application, I shall submit a new Schedule 2 prior to construction when the installer is known;

OR

I am the holder of the permit to construct the sewage system, and am submitting a new Schedule 2, now that the installer is known.

I certify that:

1. The information contained in this schedule is true to the best of my knowledge.
2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.

Date February 7 2022 Signature of applicant 



RVCA RECEIVED
FEB 18 2022
REFER TO:

DISPERSED FILE #
Permit # _____
Revision # 344
Date OTTAWA

Schedule 4
Proposed Services
Complete Sections 1 thru 7

1. Engineered

- Yes
 No

2. Water supply

- Proposed
 Existing

3. Type of work proposed

- New Installation
 Replacement
 Alteration

4. Type of Well

- Dug/bored/Sandpoint well
 Drilled well
 Municipal
 Other

5. Residential Sewage Design Flow Info.

Bedrooms _____
House (floor area) _____ **m²**
People _____
Total Fixture Units _____ **(Schedule 8)**
Residential Flow _____ **L/day**

6. Sewage Design Flow Other Occupancies

Design Flow 4420 **L/day**
Detailed sewage flow calculations:
No local population (Assembly bldg.)
500 x B = 4000 L/day
(500 people)

7. Type of System

- Treatment Unit Norweco 4730-3M
 Class 2 – Leaching Pit
 Class 3 – Cesspool
 Class 4 – Shallow Buried Trench

Class 4 – BMEC Area Bed (Schedule 11)

- Fully raised
 Partially raised
 In-ground
- Class 4 – “Type A” Dispersal (Schedule 13)
 Fully raised
 Partially raised
 In-ground
- Class 4 – “Type B” Dispersal (Schedule 14)
 Fully raised
 Partially raised
 In-ground

- Class 4 – Trench (Schedule 9)
 Fully raised
 Partially raised
 In-ground

- Class 4 – Filter Media (Schedule 10)
 Fully raised
 Partially raised
 In-ground

- Class 5 – Holding Tank (9000L min)
 Tank/Treatment Unit/Pump Chamber ONLY
 Effluent Filter/Risers ONLY



RVCA RECEIVED
FEB 18 2022
REFER TO:

SEPTIC FILE #
Do Not Complete
Permit # 21-344
Revision #
Date OTTAWA

Schedule 5 Sewage System Details

Type of System Class 4 Shallow Buried Trench Bed (Schedule 4)
Septic/Holding Tank Size: _____ Litres Make: _____
Septic Tank Effluent Filter Make: _____ Model: _____

Treatment Unit - Make & Model Norweco Hydro Kinetic 4730-3M

Number of Units: 1 Other: _____

Refer to Typical Drawing # Pi-5-1174 Pump(s) required _____

Mantle Information: Pump Rate L/15min

Native or imported = 15m in _____ direction(s) **Note: Alarm required for all**

pumping systems

Slope subgrade _____ % slope

_____ direction(s)

Site to be Scarified (If clay) YES / NO
Clay Seal Required (If bedrock) YES / NO

Trench

Distribution Pipe Length _____ m **Shallow Buried Trench**

Loading Area _____ m² Pipe Length 139.52 m

Type of Chamber _____

Length of Chamber _____ m **Filter Media Bed**

BMEC Area Bed Stone _____ m²

Type A Extended Base _____ m²

Type B Pipe _____ m

Stone _____ m² Weight of Filter Media _____ Kg

Sand _____ m² Loading Area _____ m²

Pipe _____ m

Linear Loading _____ L/m²

Tank/Treatment Unit/Pump Chamber Replacement ONLY

Effluent Filter & Riser ONLY

Construction Notes:



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

RVCA RECEIVED
FEB 18 2022
REFER TO:

SEPTIC FILE #
Do Not Complete
Permit # 21-344
Revision # _____
Date OTTAWA

Schedule 6
Soil and Water Table Information
(Minimum depth of test pit: 2 metres)

Name of Applicant/Agent: LRL Inspector: _____
Date: May 8 2017 Time: 10:00 am Date: _____
Applicant/Agent Signature: [Signature] Inspector Signature: [Signature] Time: _____

EG (.....)	Soil Description	EG (.....)	Soil Description
.5m	T <i>See Attached Test Pit logs</i>	.5m	EG (.....) Soil Description
1.0m		1.0m	
1.5m		1.5m	
2.0m		2.0m	
.5m	T	.5m	EG (.....) Soil Description
1.0m		1.0m	
1.5m		1.5m	
2.0m		2.0m	

Test pits not available for inspection.
Engineer assumes all liability for soil
and HGWT info/s

LEGEND
BR = Bedrock
GWT = Ground water table

HGWT = High ground water table
M = metres

EG = Existing grade
T = percolation rate

RVCA RECEIVED


FEB 18 2022

Do Not Coordinate
Permit # _____
Revision # 21-346
Date _____
OTTAWA

Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

Scale: 1Block = NTS

Schedule 7
Layout Section

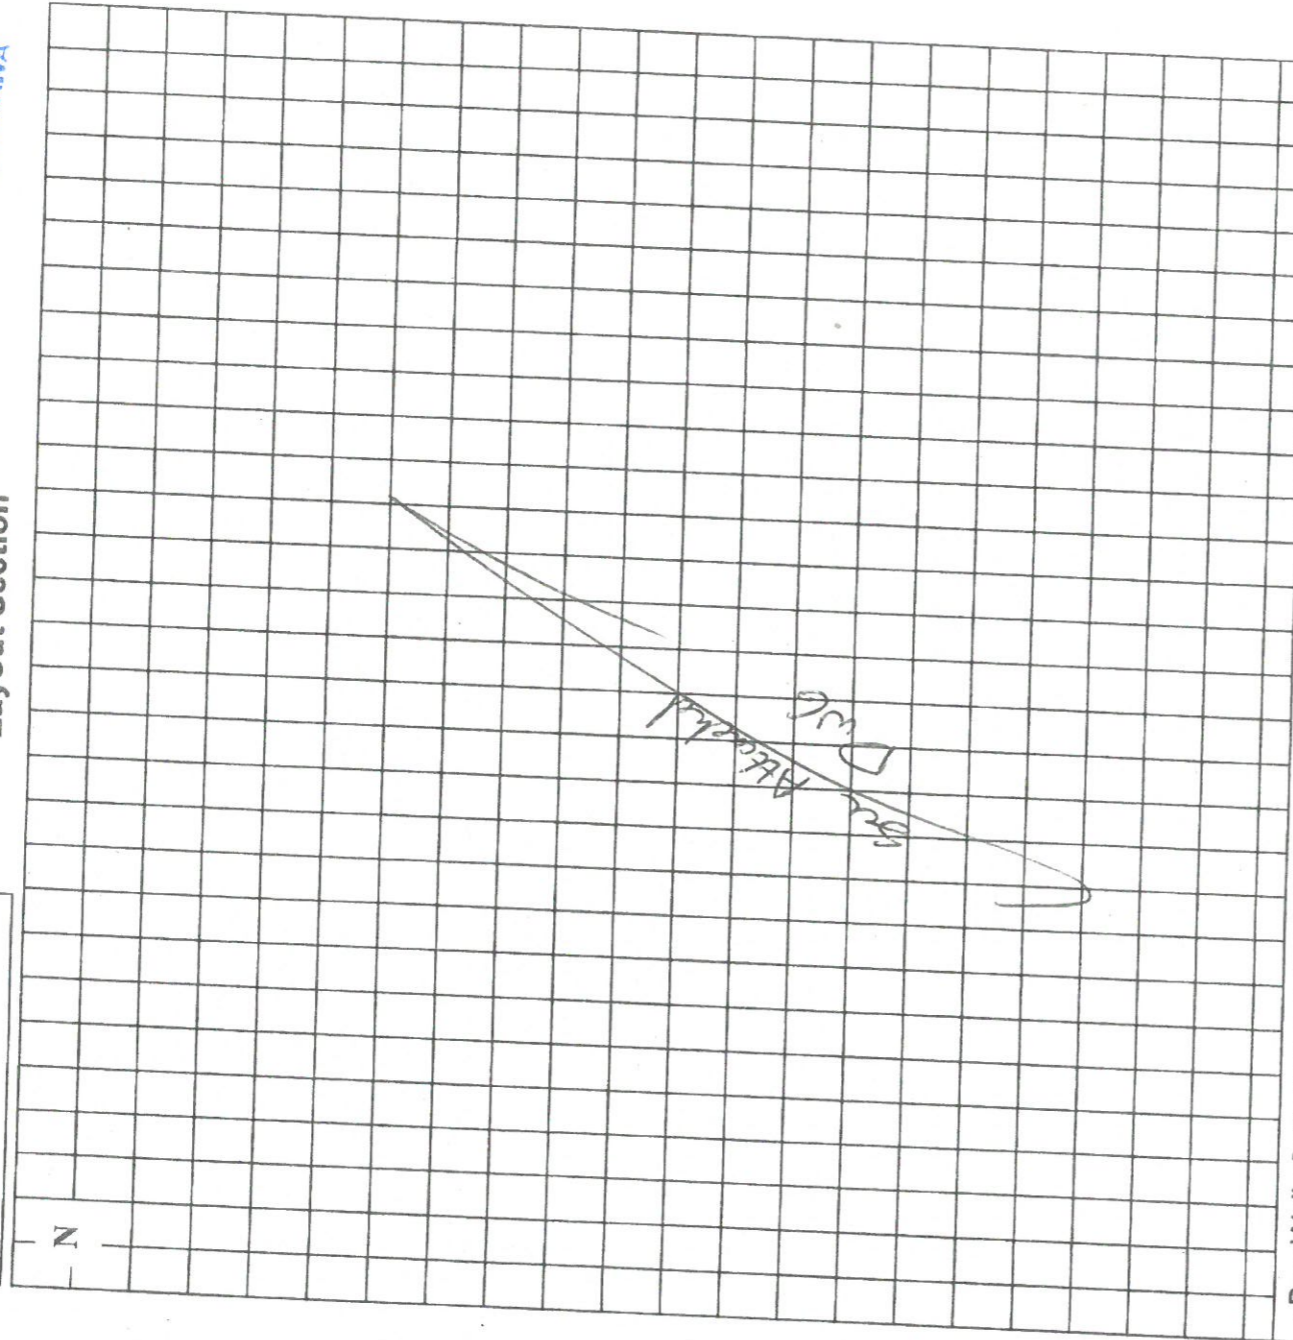

o Dug Well • Drilled Well ▲ Neighbouring Homes ◊ Benchmark --- Tile Drainage --- Property Line

Elevations (metric only)
B.M. 100.17 m

B.M. Description East arm of hydrant
located west of Southern entrance to site

Exact Location _____

Min. of 5 elevations in proposed system
area (in X pattern)

X ₁	X ₂
X ₃	X ₄
X ₅	X ₆ (toe)
X ₇	X ₈



RVCA RECEIVED

FEB 18 2022

REFER TO:

Do Not Complete
Permit # _____
Revision # 21-344
Date _____
OTTAWA

**Schedule 8
Fixture unit count**

Fixtures	# Existing	+ # Proposed	X	unit count =	Fixture Count
Bathroom					
Bathroom group (toilet, sink and tub or shower) installed in the <u>same</u> room	+		X	6	=
<i>Urinal Wall Mounted Washout Type</i>	+	10	X	1.5	= 15
Shower stall	+	2	X	1.5	= 3
Wash basin (SINK) (1 1/2 inch trap)	+	19	X	1.5	= 28.5
Watercloset (TOILET) tank operated	+	22	X	4	= 88
Bidet	+		X	1	=
Kitchen					
Dishwasher	+		X	1	=
Sink with/without garbage grinder(s), domestic and other small type single, double or 2 single with a common trap	+		X	1.5	=
Other					
Domestic washing machine	+		X	1.5	=
Combination sink and laundry tray single or double (Installed on 1 1/2 trap)	+		X	1.5	=
				*Total:	134.5

*Insert the TOTAL in section 5 of Schedule 4 (O.Reg 151/13 Table 7.4.9.3)

1. Sump pumps and floor drains are not to be connected to the sewage system. Connection of such fixtures to a sewage system may lead to a hydraulic failure of the said system. The above mentioned fixtures should be discharged separately to an approved Class 2 (leaching pit) sewage system.
2. Where laundry waste is not more than 20% of the total daily design sanitary sewage flow, it may discharge to a sewage system (Part 8, OBC, 8.1.3.1(2)).

[Signature]
Agent/Owner signature

June 7 2021
Date

REFER TO:

- GENERAL NOTES:
- FALL THROUGH THE HYDRO-KINETIC PLANT FROM INLET INVERT TO OUTLET INVERT IS SEVEN INCHES. INLET INVERT IS TWELVE INCHES BELOW TANK TOP.
 - ON DEEPER INSTALLATIONS, PRECAST RISERS MUST BE USED TO EXTEND CASTINGS TO GRADE. INSPECTION COVERS MUST BE DEVELOPED TO WITHIN TWELVE INCHES OF GRADE.
 - TANK REINFORCED PER ACI STD. 318.
 - REMOVABLE COVERS ON RISERS WEIGH IN EXCESS OF SEVENTY-FIVE POUNDS EACH TO PREVENT UNAUTHORIZED ACCESS.
 - AIR PUMPS MAY BE MOUNTED INSIDE THE RISERS ABOVE THE AERATION FLANGE ASSEMBLY. CHAMBERS OR MAY BE REMOTE MOUNTED UP TO 100 FEET FROM TANK.
 - SOTTOM LAYER CONTAINS 3 OF 3/4" TO 1" BASE MATERIAL. MIDDLE LAYER CONTAINS 2 OF 3/8" TO 1/2" BASE MATERIAL. TOP LAYER CONTAINS 2" OF PHOS-4-FADE ADSORPTIVE MEDIA.

CANBNO 3690-600 TREATMENT LEVEL CLASS B - IV, D - I, N - I, P - II

PROJECT ENGINEER'S APPROVAL
DATE: _____
NAME: _____
CONTRACTOR'S CERTIFICATION
(I/WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED.

DATE: _____
NAME: _____
APPROVED
(I/WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED.

CRITICAL DIMENSIONS


A	1'-0"
B	2'-9"
C	2'-8"
D	3'-7"
E	2'-3"
F	9'-3"
G	1'-0"
H	1'-1"
I	3'-7 1/2"
J	7'-0"
K	0'-3"
L	0'-3"
M	0'-2"
N	0'-2 1/2"
O	1'-4"
P	5'-8"
Q	7'-0"
R	5'-8"
S	1'-5"
T	4'-7"
U	3'-7 1/2"
V	7'-0"
W	7'-0"
X	0'-3"
Y	5'-8"
Z	0'-2"
AA	1'-7"

U.S. AND FOREIGN PATENTS PENDING

NORWECO

MODEL # 3690-600
MANUFACTURED BY NORWECO
MAY 2018

PC-5-1174
NTS
05-27-2018
JMM
MFD
01-10-2017 A

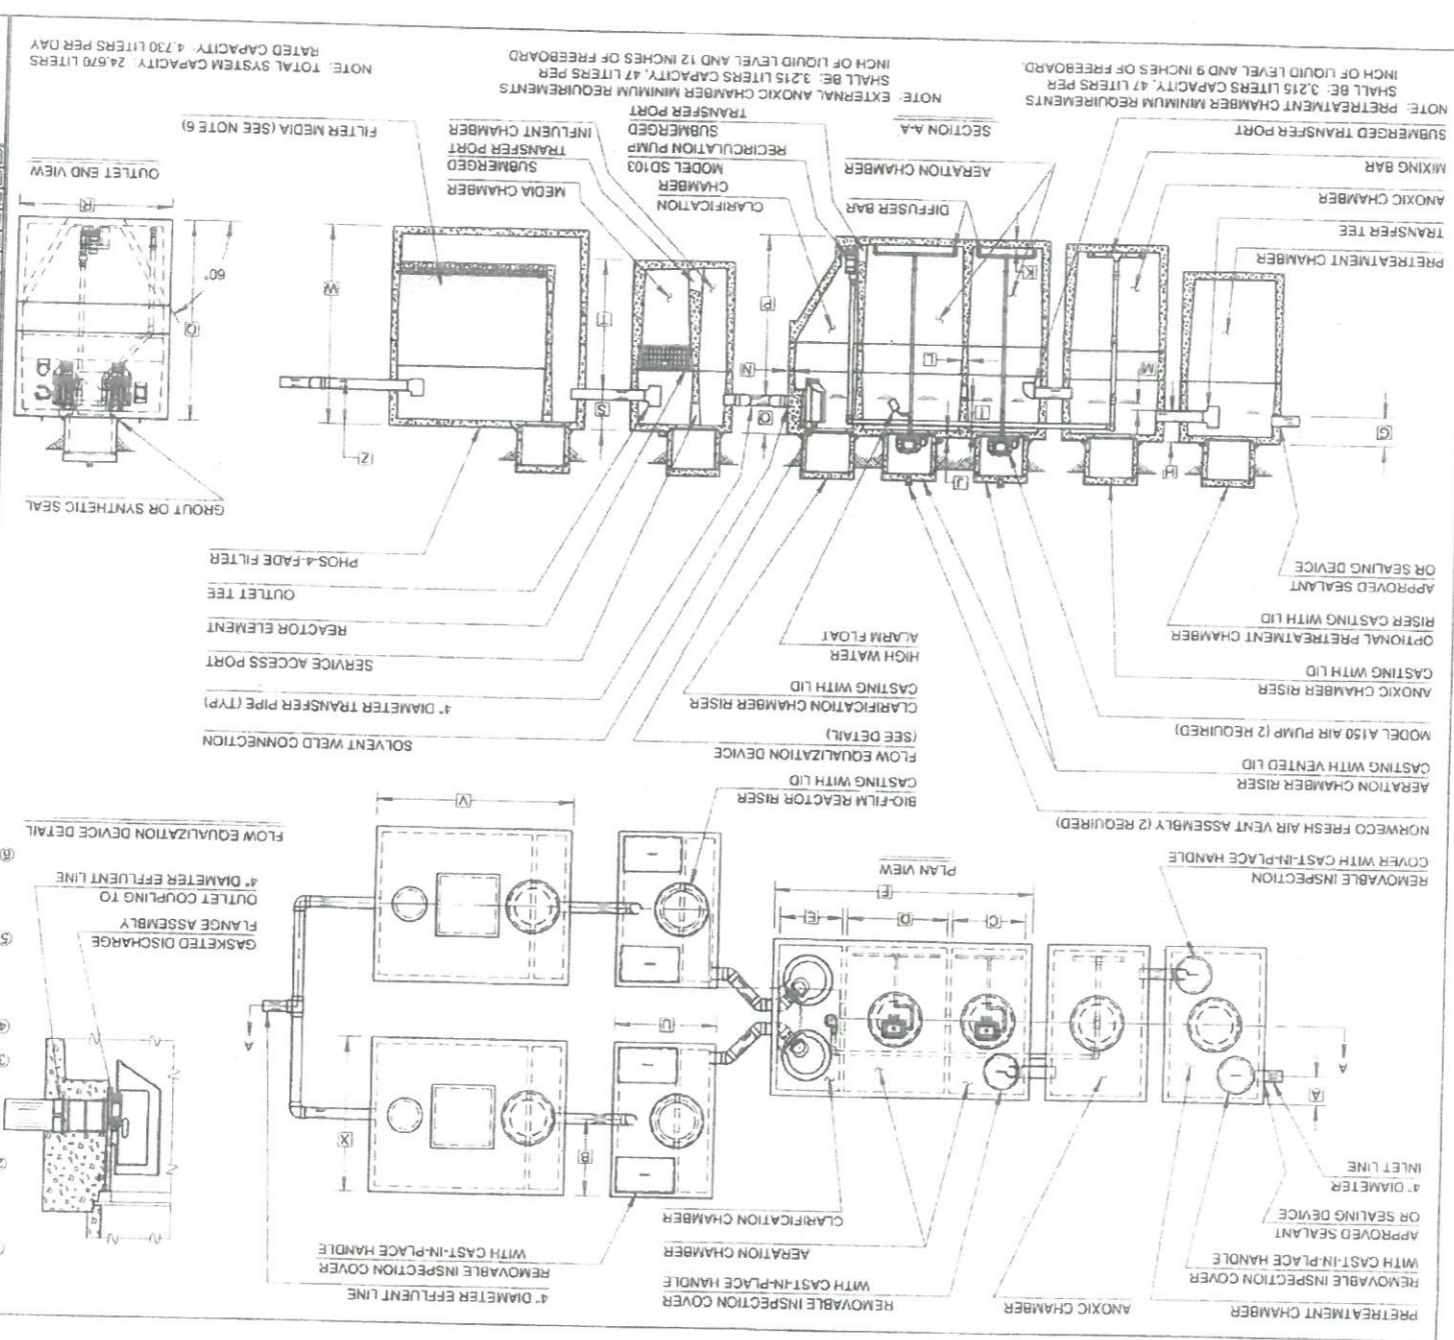

GREEN VALLEY ENVIRONMENTAL SERVICES

RVCA RECEIVED
FEB 18 2022
REFER TO:

SEPTIC FILE #
21-344
OTTAWA

6107 First Line Road, Manotick, Ontario, K4M 1A7
Box 882, Tel. (613) 692-2616, Fax: (613) 693-1802

input	Length of a Lateral (m):	13.08	13.08	13.08	13.08	13.08	13.08	13.08	13.08	40.00
input	Number of Laterals:	2.00	2.00	2.00	2.00	2.00	2.00	2.00	2.00	2.00
input	Input spacing of orifices(m):	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.60
← input	Number of orifices(calculated):	20.80	20.80	20.80	20.80	20.80	20.80	20.80	20.80	20.80
input	chosen number of orifices:	20.00	20.00	20.00	20.00	20.00	20.00	20.00	20.00	20.00
output	space of orifice to edge (m)	0.84	0.84	0.84	0.84	0.84	0.84	0.84	0.84	0.84
output	total number of orifices:	40.00	40.00	40.00	40.00	40.00	40.00	40.00	40.00	40.00

0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12
diameter of orifice(inch):	Squirt height (feet):	2.00	5.00	6.00	7.00	8.00	8.00	9.00	20.00	0.77
Discharge of orifice (US gal/orifice x min)	Flow in a lateral (US gal/min x lateral)	4.88	7.71	8.45	9.13	9.76	10.35	10.35	15.43	0.77
Total discharge (US gal/min)	Total discharge (L/min)	36.93	58.39	63.97	69.09	73.86	78.35	78.35	116.79	25.69
Total discharge (Imp. gal/min)		8.12	12.85	14.07	15.20	16.25	17.23	17.23	25.69	25.69

input	Length of force main(m)	82.02	82.02	82.02	82.02	82.02	82.02	82.02	82.02	82.02
input	Diameter of force main (in/cm)	3.81	1.50	1.50	1.50	1.50	1.50	1.50	1.50	1.50
input	Length of manifold (m)	2.00	6.55	6.55	6.55	6.55	6.55	6.55	6.55	6.55
input	Diameter of manifold (in/cm)	3.81	1.50	1.50	1.50	1.50	1.50	1.50	1.50	1.50
input	Length of lateral (m)	13.08	42.91	42.91	42.91	42.91	42.91	42.91	42.91	42.91
input	Diameter of lateral (in)	3.81	1.50	1.50	1.50	1.50	1.50	1.50	1.50	1.50
output	Friction loss in forcemain (m/ft)	0.23	0.76	1.78	2.11	2.43	2.75	3.06	3.41	6.41
output	Friction loss in manifold (m/ft)	0.01	0.02	0.05	0.06	0.06	0.07	0.08	0.17	0.17
output	Friction loss in lateral (m/ft)	0.01	0.04	0.09	0.10	0.12	0.13	0.15	0.31	0.31
estimated	Fittings' loss (estimated) (m/ft)	3.05	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00
input	Residual head on orifice (ft)	0.61	2.00	5.00	6.00	7.00	8.00	9.00	20.00	20.00
input	Elevation difference(assumed, from low water level in pump tank to manifold) (m)	4.00	13.12	13.12	13.12	13.12	13.12	13.12	13.12	13.12
output	TDH (estimated) (m/ft)	7.91	25.94	30.04	31.39	32.73	34.08	35.42	50.02	50.02
	Q (gpm)		9.76	15.43	16.90	18.25	19.51	20.70	30.85	30.85

In/Output

RVCA RECEIVED

FEB 18 2022

REFER TO:


SEPTIC FILE #
21-344

OTTAWA

Liberty Pumps®

Effluent Pumps

Performance Curve Data 60 hz.

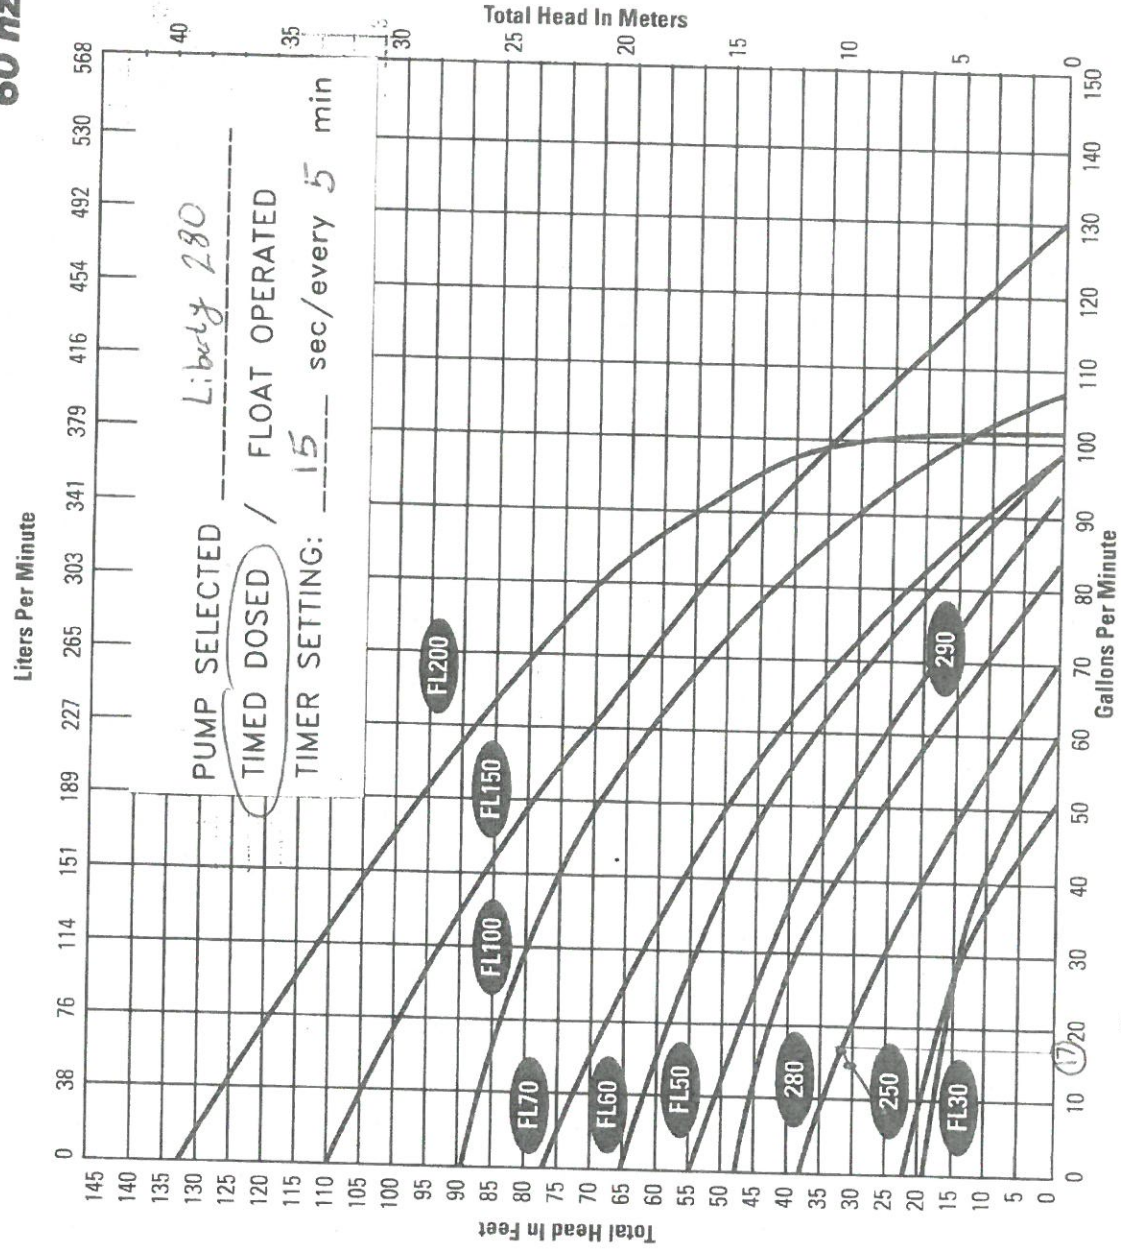

innovate. evolve.

Liberty Pumps • 7000 Apple Tree Avenue • Bergen, NY 14416
 Phone 800-543-2550 Fax (585) 494-1839
 www.libertypumps.com

Specifications subject to change without notice.
 Copyright © Liberty Pumps, Inc. 2013
 All rights reserved. LL16625 R01/13

APPENDIX A
Test Pit Logs

RVCA RECEIVED

FEB 18 2017

SEPTIC FILE #
21-344



LRJ

Project No.: 170132

Client: Hindu Temple of Ottawa Carleton

Date: May 08, 2017

Excavation Method: Backhoe

Project: Terrain Analysis

Location: 4835 Bank Street, Ottawa, ON

Field Personnel: JA

Excavation Contractor: Maurice Yelle Excavation Ltd.

Test Pit Log: TP170132

SUBSURFACE PROFILE

SAMPLE DATA

Depth ft m	Soil Description	Elev./Depth (m)	Lithology	Sample Number	Shear Strength (kPa)	Water Content (%)	Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
0	Ground Surface	98.21						
0.00	TOPSOIL Sandy, dark brown, dry.	0.00						
0.20	FILL Sandy clay, dark brown, dry.	98.01						
1.7	Silty Sand Trace clay, with clay seam from 1.7 to 1.8 m bgs, brown, dry. Sieve analysis completed.	97.31		1				
2.10	End of Test Pit Refusal over inferred bedrock.	96.11		3				
2.10		2.10						



Easting: N/M

Northing: N/M

NOTES:

Site Datum: Top east arm of hydrant at south entrance (100.00 m)

Groundsurface Elevation: 98.21

Top of Riser Elev.: 99.15

Excavation Width: 1.2 m

Excavation Length: 1.5 m

BGS- Below Ground Surface

RVCA RECEIVED
FEB 18 2022

SEPTIC FILE #
21-344


REFER TO:



LRJ

Project No.: 170132
Client: Hindu Temple of Ottawa Carleton
Date: May 08, 2017
Excavation Method: Backhoe
Project: Terrain Analysis
Location: 4835 Bank Street, Ottawa, ON
Field Personnel: JA
Excavation Contractor: Maurice Yelle Excavation Ltd.

OTTAWA Test Pit Log: TP2

SUBSURFACE PROFILE		SAMPLE DATA		Water Content (%)	Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
Depth (m)	Soil Description	Elev./Depth (m)	Lithology			
0	Ground Surface	97.09		25	75	
0.00	FILL Silty sand with some clay, brown, saturated with water infiltration at 0.4 m bgs. Buried metal structure/waste at approximately 0.9 m bgs.	0.00		25	75	
3	End of Test Pit	96.19		25	75	
0.90		0.90				
4						
5						
6						
7						
8						

Eastings: N/M

Northings: N/M

Site Datum: Top east arm of hydrant at south entrance (100.00 m)

Groundsurface Elevation: 97.09

Top of Riser Elev.: --

Excavation Width: 1.2 m

Excavation Length: 1.5 m

NOTES:

Test pit terminated at 0.9 meters due to volume of water in pit.
 BGS- Below Ground Surface

SEPTIC FILE #
21-344

RVCA RECEIVED
FEB 10 2022

Test Pit Log: TP3
OTTAWA

Project No.: 170132
Client: Hindu Temple of Ottawa Carleton
Date: May 08, 2017

Project: Terrain Analysis
Location: 4835 Bank Street, Ottawa, ON
Field Personnel: JA

LRJ

Excavation Contractor: Maurice Yelle Excavation Ltd.

SUBSURFACE PROFILE

SAMPLE DATA

Depth ft. m	Soil Description	Elev./Depth (m)		Lithology	Sample Number	Shear Strength (kPa)	Water Content (%) Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
		97.75 0.00	97.55 0.20					
0	Ground Surface TOPSOIL Sandy loam, dark brown, dry.							
1	Brick debris found in top 0.2 m bgs. FILL Sandy silt, trace boulders, brown, dry. Tire debris found at approximately 0.8 m bgs.				5			
3	TILL Silty sand, trace gravel, cobbles and boulders, brown, dry. Sieve analysis completed.	96.95 0.80						
6	End of Test Pit Refusal at 1.7 m bgs over inferred bedrock.	96.05 1.70			6			



Eastings: 0454091

Northings: 5017670

NOTES:

BGS- Below Ground Surface

Site Datum: Top east arm of hydrant at south entrance (100.00 m)

Groundsurface Elevation: 97.75

Top of Riser Elev.: 98.98

Excavation Width: 1.2 m

Excavation Length: 1.5 m

RVCA RECEIVED
FEB 18 2022



LRJ

Project No.: 170132
 Client: Hindu Temple of Ottawa Carleton
 Date: May 08, 2017
 Excavation Method: Backhoe

Project: Terrain Analysis
 Location: 4835 Bank Street, Ottawa, ON
 Field Personnel: JA
 Excavation Contractor: Maurice Yelle Excavation

Test Pit Log: TPA
SEPTIC FILE #
21-344
OTTAWA

Depth	SUBSURFACE PROFILE		SAMPLE DATA		Shear Strength (kPa)	Water Content (%)	Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
	Soil Description	Elev./Depth (m)	Lithology	Sample Number				
0	Ground Surface	99.54						
0.00	TOPSOIL Silty loam, trace clay, dark brown, dry.	0.00				25	50	75
0.50	FILL Silty sand, trace cobbles and gravel, light brown, dry.	99.04						
0.8	Changing to dark brown sandy fill with trace boulders at approximately 0.8 m bgs.	0.50		7				
1.40	End of Test Pit Refusal at 1.4 m bgs over inferred bedrock or large concrete structure.	98.14		8				

Eastings: 0454005 Northing: 5017628 **NOTES:**

Site Datum: Top east arm of hydrant at south entrance (100.00 m) BGS- Below Ground Surface

Groundsurface Elevation: 99.54 Top of Riser Elev.: --

Excavation Width: N/M Excavation Length: N/M

RVCA RECEIVED
FEB 18 2022

SEPTIC FILE #
21-344
OTTAWA




Project No.: 170132
Client: Hindu Temple of Ottawa Carleton
Date: May 08, 2017
Excavation Method: Backhoe

Project: Terrain Analysis
Location: 4835 Bank Street, Ottawa, ON
Field Personnel: JA
Excavation Contractor: Maurice Yelle Excavation Ltd.

Test Pit Log: T15

REFER TO:

SUBSURFACE PROFILE		SAMPLE DATA		Shear Strength (kPa)	Water Content (%)	Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
Depth	Soil Description	Elev./Depth (m)	Lithology				
0	Ground Surface	98.78					
	TOPSOIL Silty loam some sand, dark brown, dry.	0.00			25	75	
	FILL Sand, some silt, trace cobbles, brown, dry.	98.63			25	75	
	Waste debris of metal and asphalt pieces at approximately 0.9 m bgs.	0.15					
1							
2							
3							
4							
5							
5	End of Test Pit	97.28					
	Refusal at 1.5 m bgs over inferred bedrock.	1.50					
6							
7							
8							



Easting: 0453945

Northing: 5017595

NOTES

BGS- Below Ground Surface

Site Datum: Top east arm of hydrant at south entrance (100.00 m)

Groundsurface Elevation: 98.78

Top of Riser Elev.: 99.02

Excavation Width: N/M

Excavation Length: N/M



LRJ

Project No.: 170130
 Client: Hindu Temple of Ottawa Carleton
 Date: May 08, 2017

Excavation Method: Backhoe

Project: Terrain Analysis
 Location: 4835 Bank Street, Ottawa, ON

Field Personnel: JA

Excavation Contractor: Maurice Yelle Excavation Ltd.

Test Pit Log: TP6

RVCA RECEIVED

FEB 18 2022

SEPTIC FILE # 21-344

OTTAWA

SUBSURFACE PROFILE

SAMPLE DATA

Depth ft. m	Soil Description	Elev./Depth (m)	Lithology	Sample Number	Shear Strength (kPa)	Water Content (%)	Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
0	Ground Surface	99.38						
	TOPSOIL Sandy loam, dark brown, dry.	0.00						
	FILL Sand, some gravel, cobbles, boulders, silty seam at 0.7 m bgs, brown, dry.	99.23						
		0.15						
	Refusal at 0.8 m bgs over inferred bedrock.							
				12				
				13				
	End of Test Pit	98.58						
		0.80						

Eastings: 0454003

Northings: 5017542

Site Datum: Top east arm of hydrant at south entrance (100.00 m)

Groundsurface Elevation: 99.38

Top of Riser Elev.: --

Excavation Width: N/M

Excavation Length: N/M

NOTES:

BGS- Below Ground Surface

RVCA RECEIVED
FEB 18 2022

SEPTIC FILE #
21-344
OTTAWA



LRJ

Project No.: 170132
Client: Hindu Temple of Ottawa Carleton
Date: May 08, 2017
Excavation Method: Backhoe
Project: Terrain Analysis
Location: 4835 Bank Street, Ottawa, ON
Field Personnel: JA
Excavation Contractor: Maurice Yelle Excavation Ltd.

Test Pit Log: TPT10

SUBSURFACE PROFILE

SAMPLE DATA

Depth ft m	Soil Description	Elev./Depth (m)	Lithology	Sample Number	Shear Strength (kPa)	Water Content (%) Liquid Limit (%)	Water Level (Standpipe or Open Excavation)
0	Ground Surface	99.60					
0	TOPSOIL Sandy loam, dark brown, dry.	0.00					
1	FILL Sand, brown, trace metal debris, dry.	99.40					
2		0.20					
3	TILL Silty sand, trace clay, boulders, grey, organics including tree stump, roots, etc. Refusal due to obstruction (tree bg stump).	98.90					
4		0.70					
5							
6	End of Test Pit	97.80					
7		1.80					
8							

1.33 m bgs (08/05/17)

Easting: 0454051

Northing: 5017564

Site Datum: Top east arm of hydrant at south entrance (100.00 m)

Groundsurface Elevation: 99.60

Top of Riser Elev.: 100.79

Excavation Width: N/M

Excavation Length: N/M

NOTES:

BGS- Below Ground Surface

SEPTIC FILE #

21-344
OTTAWA

REVISION
FEB 18 2022
O.S.S.O. #:
RVCA RECEIVED
FEB 18 2022
REFER TO:

2000 GAL BALANCING TANK WITH LE40-SERIES SEWAGE PUMP TO BE INSTALLED WITH TIMER SETTING TO PREVENT PEAK LOADING IN THE NORWECO TREATMENT UNIT.

PROPOSED OVERLAND STORAGE EXTENT
100 YEAR STORMPONDING EXTENT
(HWL = 98.47)
MAXIMUM PONDING DEPTH = 0.82m
TOTAL STORAGE PROVIDED = 428.14m³

CLAY SEPARATION LAYER TO BE INSTALLED ON SIDES FACING THE SEPTIC BED. SEE DETAIL ON LRL DRAWING C301.

PROPOSED OVERLAND STORAGE EXTENT
5 YEAR STORMPONDING EXTENT
(HWL = 98.15)
MAXIMUM PONDING DEPTH = 0.50m
TOTAL STORAGE PROVIDED = 210.92m³

TP #01
TOP 99.36
PRESSURIZED SHALLOW BURIED TRENCH BED WITH 12 RUNS OF 13.08m AT 2.0m O/C

EXISTING FENCE TO BE REMOVED

PROPOSED STORM WATER DRAINAGE SYSTEM

PROPOSED ASSEMBLY BUILDING

EXISTING PARKING AREA

INSTALL NORWECO HK 4730L-3M TREATMENT UNIT. SYSTEM COMPONENTS TO MEET MINIMUM REQUIREMENTS AS PER ATTACHED SCHEMATIC.
INSTALL 300 GAL PUMP CHAMBER WITH 0.5 hp LIBERTY 280 EFFLUENT PUMP, TIMER DOSED @ 15 SECS./5 MINS.

FORCEMAIN, POLYETHYLENE PIPE, 1.5" Ø, BURIED 1.5m DEEP, OR SELF DRAINING, OR INSULATED.

K-RAIN MULTIZONE VALVE MODEL 6000 CAMMED FOR 6 ZONE OPERATION TO BE PROTECTED WITH RISER AND LID.

NOTES:

1. ALL TREATMENT UNITS AND LEACHING BED ARE TO BE INSTALLED IN ACCORDANCE WITH MINIMUM OBC CLEARANCE DISTANCES. ANY OMISSIONS OR INACCURACIES SHALL BE BROUGHT TO THE ATTENTION OF GVE AND OSSO.
2. CARE IS TO BE EXERCISED DURING CONSTRUCTION ACTIVITIES NEAR OVERHEAD HYDRO WIRES.
3. EXISTING ELEVATIONS ARE APPROXIMATE. CONTRACTOR MUST VERIFY ALL ELEVATIONS AND DIMENSIONS PRIOR TO CONSTRUCTION.
4. SOIL CONDITIONS ARE ACCURATE FOR THE LOCATIONS SHOWN. CONTRACTOR MUST CONTACT THE DESIGN ENGINEER OR REGULATORY AUTHORITY SHOULD SOIL CONDITIONS DIFFER.
5. ALL DIMENSIONS AND CONDITIONS TO BE VERIFIED ON SITE. FIGURED DIMENSIONS TAKE PRECEDENCE OVER SCALE.
6. UTILITY LOCATES SHALL BE COMPLETED PRIOR TO ANY EXCAVATION.
7. THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.
8. THIS DOCUMENT IS COPYRIGHT PROTECTED AND IS THE SOLE PROPERTY OF GVE GROUP. THIS DRAWING SHALL NOT BE ALTERED IN ANY MANNER.
9. EXISTING LOT SERVICED WITH MUNICIPAL WATER.

METRIC:

DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METERS AND MAY BE CONVERTED TO FEET BY DIVIDING BY 0.3048.

LEGEND:

- PROPOSED ELEVATION
- EXISTING ELEVATION
- EXISTING WORKS
- PROPOSED SEWAGE WORKS
- FENCE LINE
- PROPERTY LINE
- TBM
- TEMPORARY BENCH MARK (DESCRIPTION: TOP OF EAST ARM OF HYDRANT)
- TEST PIT LOCATION

SEPARATION DISTANCES:

1. MINIMUM CLEARANCE FROM SEPTIC PIPE TO:
LOT LINE = 5.0m
HOUSE = 7.0m
DRILLED WELL = 17.0m
2. MINIMUM CLEARANCE FROM TREATMENT UNITS TO:
LOT LINE = 3.0m
HOUSE = 1.5m
DRILLED WELL = 15.0m

Drawn by: JP	Drawn by: JP	Checked by: WS	
Rev.	Description	Date	Approved
Township	Plan#	Lot	Sublot
			Con
Draw No. SP695 1-22-PRB			
Country	Civic Address: 4835 BANK ST.	Date: 25/01/22	Scale: 1:200
GREEN VALLEY ENVIRONMENTAL			
On-Site Sewage Treatment Plan for the Residence of: THE HINDU TEMPLE OF OTTAWA CARLETON			


SEPTIC FILE #

21-344

OTTAWA

*Jason H...
APR 28/22*

RVCA RECEIVED
FEB 18 2022
REFER TO: _____

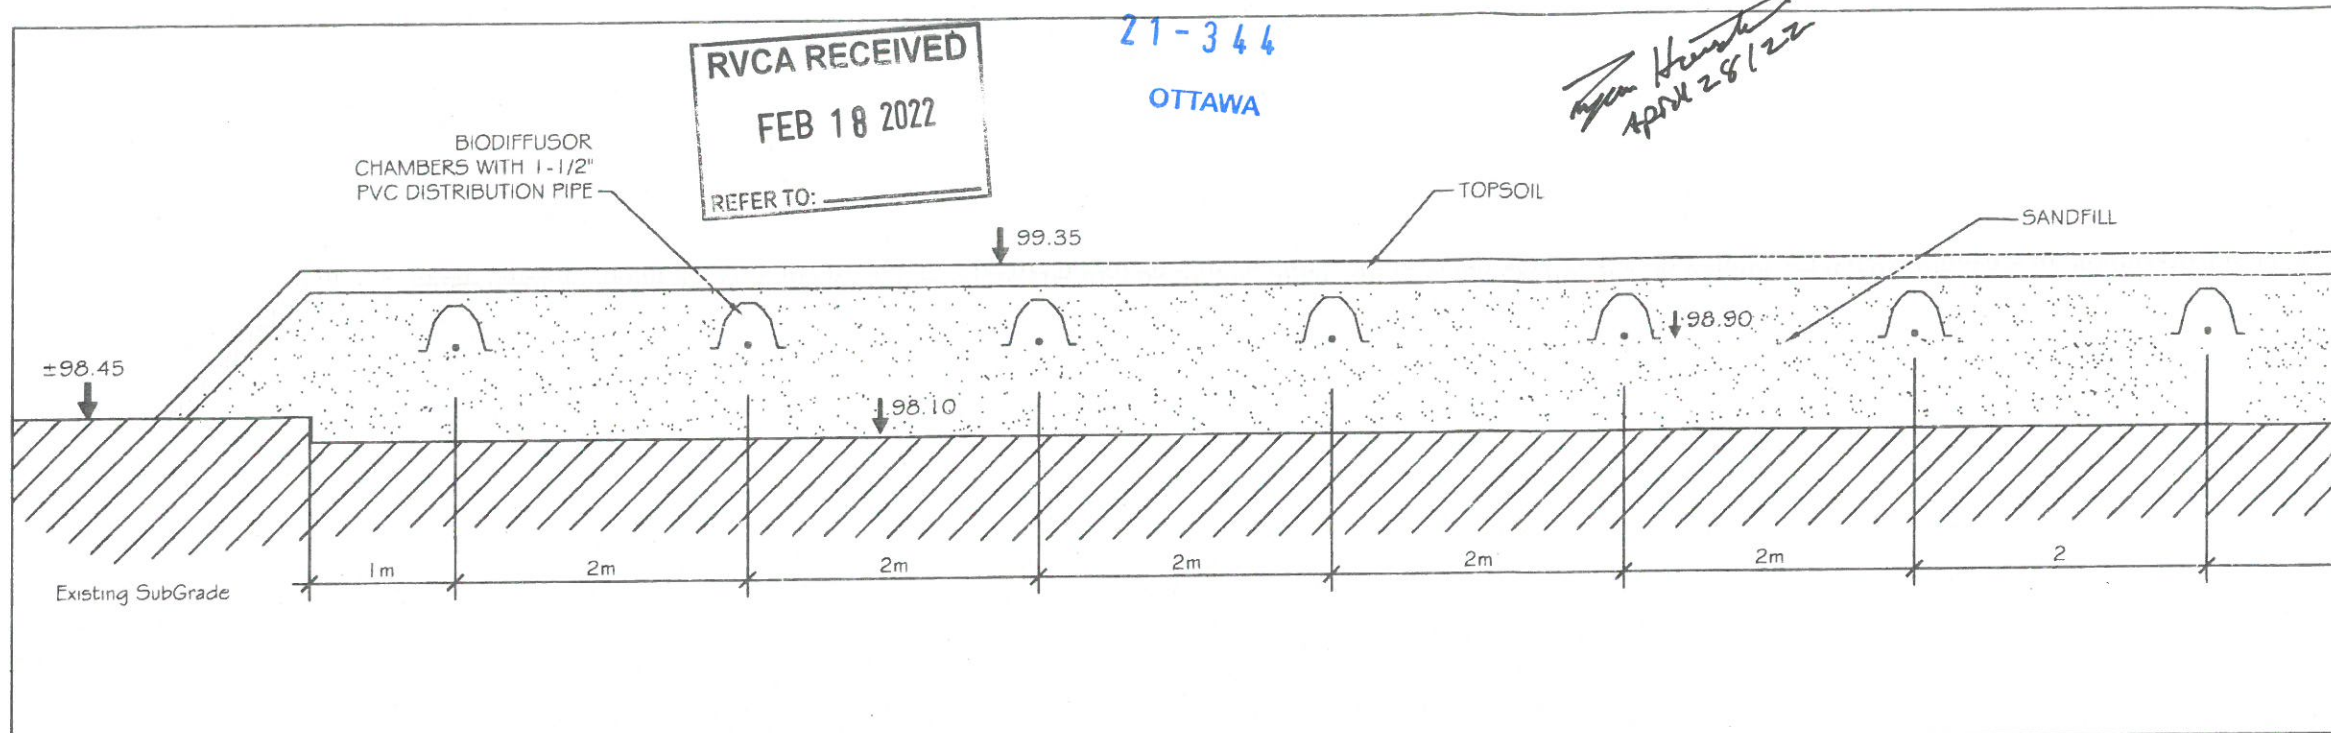

1. THIS CROSS SECTION IS NOT TO SCALE, ALL FIGURED DIMENSIONS TAKE PRECEDENCE OVER SCALE
2. THIS DOCUMENT IS COPYRIGHT PROTECTED AND IS THE SOLE PROPERTY OF GREEN VALLEY ENVIRONMENTAL INC. THIS DRAWING SHALL NOT BE ALTERED IN ANY MANNER.

PRETREATMENT TANK

- INSTALL MIN. 3215L PRETREATMENT TANK.
- A MAXIMUM OF 300mm OF SOIL SHALL COVER THE PRETREATMENT TANK.
- RISERS AND LIDS SHALL BE INSTALLED FOR EASE OF ACCESS

NORWECO TREATMENT UNIT

- THE TREATMENT UNIT SHALL CONSIST OF A NORWECO HYDRO-KENETIC 4730L-3M TREATMENT UNIT.
- THE TREATMENT UNIT SHALL BE INSTALLED IN SERIES AND DOWN STREAM FROM THE PRETREATMENT TANK.
- THE TREATMENT UNIT SHALL PRODUCE A TERTIARY TREATMENT EFFLUENT QUALITY IN ACCORDANCE WITH COLUMN 2 AND 3 OPPOSITE A LEVEL IV TREATMENT UNIT OF TABLE 8.6.2.2. OF THE ONTARIO BUILDING CODE.
- THE TREATMENT UNIT SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS BY A CERTIFIED INSTALLER.
- THE OWNER OF THE TREATMENT UNIT MUST ENTER INTO A MAINTENANCE AGREEMENT WITH THE MANUFACTURER'S REPRESENTATIVE.
- THE TREATMENT UNIT SHALL BE BACKFILLED AND COMPACTED, IN LIFTS, WITH SELECT GRANULAR FILL, SUCH AS SAND OR CLEAR STONE
- THE TOP OF THE TREATMENT UNIT SHALL BE ACCESSIBLE TO THE SURFACE. INSTALL RISERS AND LIDS TO SUIT.

NORWECO FILTER VAULT(S)

- FILTER VAULT(S) SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS
- FILTER VAULT(S) SHALL BE INSTALLED IN SERIES AND DOWN STREAM FROM THE TREATMENT UNIT
- FILTER VAULT(S) SHALL BE ACCESSIBLE TO THE SURFACE. INSTALL RISERS AND LIDS TO SUIT.

SHALLOW BURIED TRENCH BED

- THE DISPERSAL BED SHALL CONSIST OF A TOTAL LENGTH EQUAL TO $Q/30 = 4000/30 = 133.3$
- TOTAL LENGTH USED = 156.9m
- SAND FILL SHALL EXTEND 1.0m ON ALL SIDES.
- REMOVE LAYER OF TOP SOIL TO APPROXIMATE FOOT PRINT OF SEPTIC BED AND SIDE SLOPES
- THE PRESSURIZED DISTRIBUTION SYSTEM SHALL HAVE A PRESSURE HEAD OF NOT LESS THAN 600mm WHEN MEASURED AT THE MOST DISTANT POINT FROM THE PUMP.
- DISPERSAL BED SHALL BE BACKFILLED SO AS TO ENSURE THAT THE SURFACE WILL NOT FORM ANY DEPRESSIONS
- ALL SIDE SLOPES SHALL BE AT 1:3
- AT NO POINT DURING OR AFTER CONSTRUCTION SHALL A WHEELED VEHICLE DRIVE OVER THE SEPTIC BED AREA.
- EACH RUN SHALL CONSIST OF ONLY FULL CHAMBERS.
- SEPTIC DESIGN BASED ON ADS BIO3 CHAMBERS.
- EACH RUN SHALL CONSIST OF 6 FULL ADS BIO3 CHAMBERS WITH A TOTAL OF 72 FULL BIO3 CHAMBERS FOR THE ENTIRE SEPTIC BED.

MINIMUM CLEARANCE DISTANCE FROM LEACHING BED

- 6.0m FROM ANY PROPERTY LINE
- 8.0m FROM ANY STRUCTURE
- 18.0m FROM ANY DRILLED WELL

MINIMUM CLEARANCE DISTANCE FROM TANKS

- 3.0m FROM ANY PROPERTY LINE
- 1.5m FROM ANY STRUCTURE
- 15.0m FROM ANY DRILLED WELL

GENERAL

- THE BACKWASH WATERS FROM ANY HOUSEHOLD TREATMENT SUCH AS WATER SOFTENER SHALL NOT DISCHARGE INTO THE SEWAGE SYSTEM
- CONTRACTOR SHALL BE QUALIFIED AND REGISTERED UNDER PART 8 OF THE ONTARIO BUILDING CODE.
- CONTRACTOR SHALL VISIT THE SITE AND REVIEW ALL DOCUMENTATION TO DETERMINE SUITABLE METHODS OF CONSTRUCTION.
- INSPECTION BY THE REGULATING AUTHORITIES IS A REQUIREMENT BY SOME REGULATING AUTHORITIES AND IS STRONGLY RECOMMENDED BY GREEN VALLEY ENVIRONMENTAL INC.
- IT IS RECOMMENDED THAT ALL TREES WITHIN 5m OF THE BED AREA BE REMOVED TO PREVENT ROOTS FROM INFILTRATING THE SYSTEM.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO LOCATE AND PROTECT ALL EXISTING UNDERGROUND SERVICES.
- SHOULD THE CONTRACTOR AT ANY TIME DURING CONSTRUCTION ENCOUNTER CONDITIONS THAT DIFFER FROM THE DESIGN CRITERIA IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE DESIGNER AND THE REGULATING AUTHORITY.
- GREEN VALLEY ENVIRONMENTAL INC. HAS PROVIDED DESIGNS BASED ON OUR INTERPRETATION OF THE ONTARIO BUILDING CODE AND THE TEST HOLES DUG ON THE PROPERTY.

Drawn by: JP	Drawn by: JP	Checked by: WS		
Rev.	Description	Date	Approved	
Township	Plan#	Lot	Sublot	Con
Country	Civic Address: 4835 BANK ST.	Drawn No: 156987-22	Date: 07/06/21	Scale: NTS
GREEN VALLEY ENVIRONMENTAL				
On-Site Sewage Treatment Plan for the Residence of: THE HINDU TEMPLE OF OTTAWA CARLETON				



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

Permit

Part 8 – Sewage System

Ontario Building Code

Do Not Complete
Permit No 21-344
Revision No 1
Date April 28, 2022
Related Application _____

A copy of this permit must be posted on the property at all time during construction. OBC, Division C — Part 1, Section 1.3.2.1
This permit verifies that the on-site sewage system was reviewed and approved for construction under the Ontario Building Code and O.Reg. 323/12 as amended by O.Reg. 151/13.

Inspected & Recommended by: Ryan Hiemstra Owner: Harish Gupta
Inspection Date & Time: April 28, 2022 Weather: _____
Civic Address: 4835 Bank Street (Assembly Building) Legal: Lot 22, Con 5RF, Plan 5R3156
Osgoode: Cumberland: Gloucester:
number of bedrooms: _____ **NON-RESIDENTIAL** units: _____
finished floor area: _____ Commercial 4000 L/day
 Industrial
 Institutional
pretreatment tank 3215 minimum _____ L
effluent filter _____ YES
pump rate _____ Timer Dosed _____ L/15 min
treatment unit Norweco HK 4730L-3M
number of units 1

ELEVATION In Ground Partially Raised Fully Raised

TYPE OF SYSTEM

Trench
 Pipe and Stone or Chambers
type of chamber _____ m
loading area _____ m²
total trench length _____ m
trench configuration _____
 Dispersal Bed
 BMEC Type A Type B
stone _____ m²
sand _____ m²
pipe _____
weight of sand _____ kg
 Shallow Buried Trench
pipe length _____ m 156.96
orifice spacing _____ m 0.6
 Filter Media Bed
stone _____ m²
extended base _____ m²
pipe _____
weight of filter media _____ kg
loading area _____ m²
 Class 5 Holding Tank
 Septic Tank Only

Manager, Septic System Approvals: [Signature] Permit Date: May 2, 2022
Comments: 1. No food preparation or food service within the assembly building
 maintenance/pumping required ESA permit # required engineer to verify
 Class 5 Holding Tank approval only valid for three years from date of issue subgrade squirt height
Manager, Septic System Approvals: _____ Revision Date: _____
Comments: _____

NOTE: For further details, refer to corresponding application.