



**REPORT**

**Geotechnical Investigation**

*2700 Swansea Crescent  
Ottawa, ON K1G 6R8*

Submitted to:

**IST Properties Inc**

2700 Swansea Crescent  
Ottawa, ON  
K1G 6R8

Submitted by:


**Golder Associates Ltd.**

1931 Robertson Road  
Ottawa, Ontario  
K2H 5B7

+1 613 592 9600

22514086EX

December 16, 2022

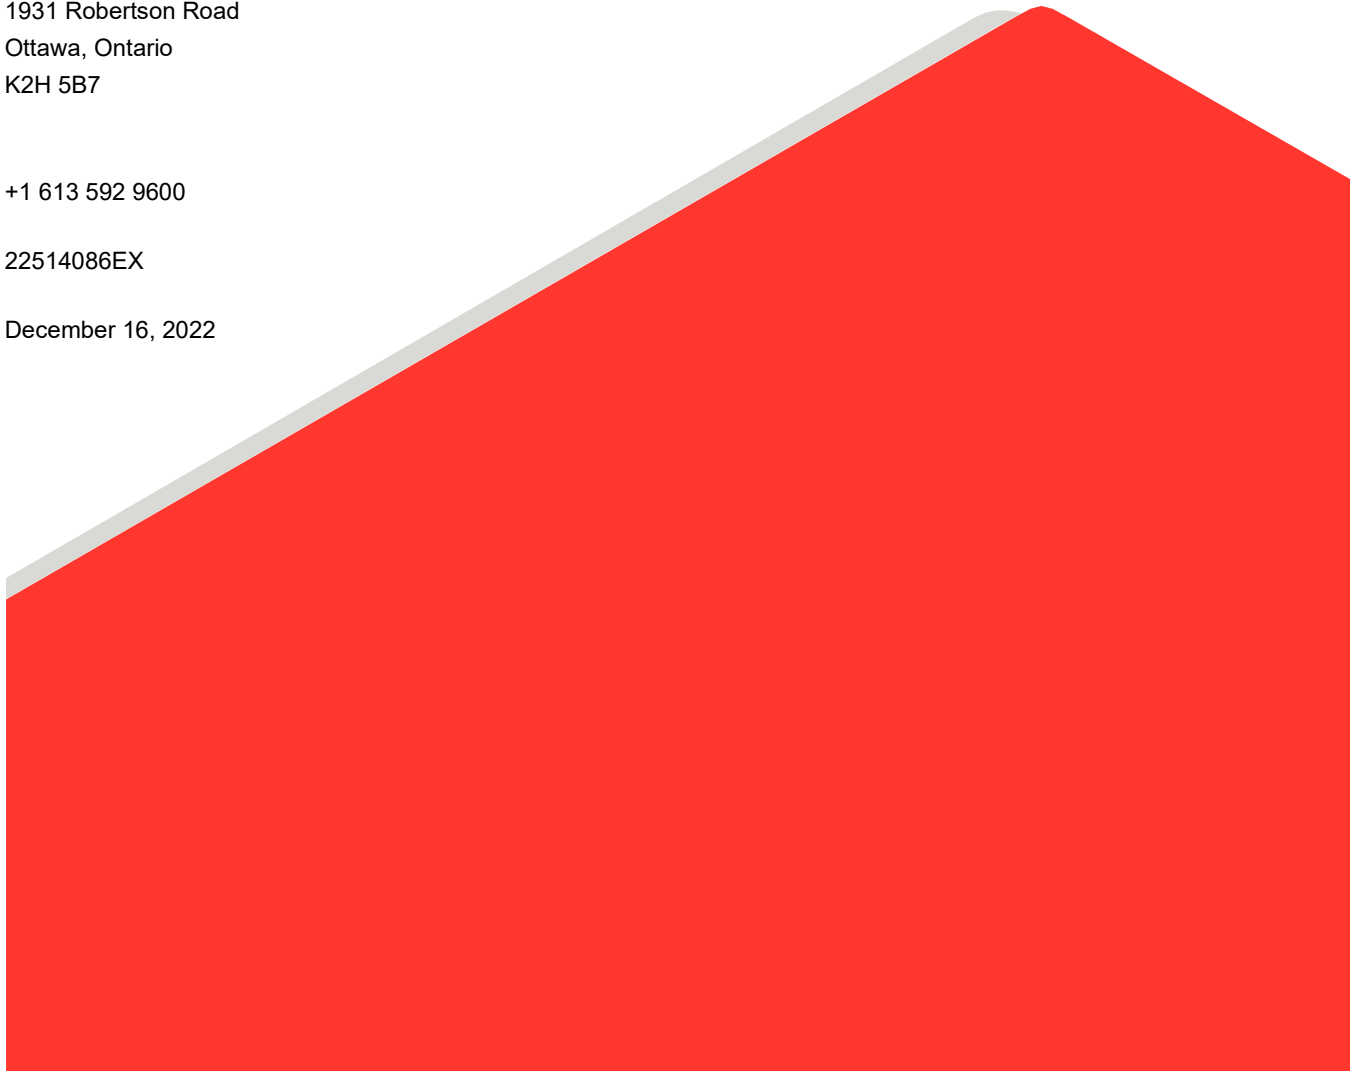

## Distribution List

1 e-copy: IST Properties Inc

1 e-copy: Golder Associates Ltd.

# Table of Contents

**1.0 INTRODUCTION ..... 1**

**2.0 PROJECT DESCRIPTION ..... 1**

**3.0 PROCEDURE ..... 1**

**4.0 SUBSURFACE CONDITIONS ..... 2**

    4.1 General ..... 2

    4.2 Overview of Subsurface Conditions ..... 2

        4.2.1 Pavement Structure ..... 2

        4.2.2 Silty Clay to Clay ..... 3

        4.2.3 Glacial Till ..... 3

        4.2.4 Highly Weathered Bedrock and Refusal ..... 3

    4.3 Groundwater ..... 4

    4.4 Corrosion Testing ..... 4

**5.0 DESIGN AND CONSTRUCTION CONSIDERATIONS ..... 4**

    5.1 General ..... 4

    5.2 Excavation and Groundwater Control ..... 4

    5.3 Foundations ..... 5

    5.4 Foundation Wall Backfill ..... 6

    5.5 Site Class ..... 6

    5.6 Frost Protection ..... 6

    5.7 Trees ..... 6

    5.8 Site Servicing ..... 6

    5.9 Pavement Design ..... 7

    5.10 Corrosion and Cement Type ..... 8

**6.0 ADDITIONAL CONSIDERATIONS ..... 9**

**FIGURES**

Figure 1 – Site Plan

## **APPENDICES**

Appendix A – Records of Borehole Logs

Appendix B – Results of Laboratory Testing

Appendix C – Results of Chemical Analysis

Appendix D – Golder Associate Technical Memorandum No. 07-1121-0135

## 1.0 INTRODUCTION

Golder Associates Ltd. (Golder) was retained by IST properties Inc. to carry out a geotechnical investigation to support the proposed design of the Phase 1 (south side) expansion of the building located at 2700 Swansea Crescent in Ottawa, Ontario. The approximate location of the site is shown on the Key Map inset on the attached Site Plan (Figure 1). The investigation and reporting were carried out in general accordance with the scope of work provided in our proposal dated February 15, 2022, as well as subsequent correspondence.

The purpose of this investigation was to assess the general subsurface and groundwater conditions within the study area by means of two boreholes and associated laboratory testing. Based on an interpretation of the factual information obtained during the current investigation, a general description of the soil and groundwater conditions is presented. These interpreted subsurface conditions and available project details were used to prepare engineering guidelines on the geotechnical design aspects of the project, including construction considerations which could influence design decisions.

The reader is referred to the 'Important Information and Limitations of This Report' which follows the text but forms an integral part of this document.

## 2.0 PROJECT DESCRIPTION

Plans are being prepared for the Phase 1 expansion of an existing two-storey light manufacturing building located at 2700 Swansea Crescent in Ottawa, Ontario (see Figure 1 – Site Plan).

The site is bordered to the north and east by commercial buildings, and to the south and west by Swansea Crescent. There is a two-storey light manufacturing building located within the northern portion of the site. As a part of the Phase I building expansion, a structure will be constructed above the existing parking lot as an addition to the south side of second storey of the existing building. The phase I expansion will have an approximately 1,420 sq. m footprint.

In addition to the building expansion, it is understood that an approximately 2 m thick layer of clean (no fine particles) gravel will be placed in the area, replacing the in-situ native soil beneath the pavement structure for the purpose of mass thermal storage. The proposed area of the thermal storage includes the hard landscaping areas extending to the east and west sides of the parking area, including the parking area under the proposed building expansion. Based on the information provided to Golder, geothermal ground loops will also be placed within the thermal storage layer at depths of 1.8 m (6') and 2.7 m (9') below the final grade.

Based on the results of previous investigations carried out near the site, as well as a review of the available published geological mapping, the subsurface conditions at the site are indicated to consist of a layer of surficial fill overlying a deposit of silty clay to clay which is underlain by glacial till above bedrock. The bedrock at this site is indicated to be about 10 m below the ground surface and consists of interbedded shale and limestone of the Carlsbad formation.

## 3.0 PROCEDURE

The fieldwork for this geotechnical investigation was carried out on July 5, 2022. A total of two boreholes (numbered 22-01 and 22-01A) were advanced at the approximate locations shown on the Site Plan.

The boreholes were advanced using a truck-mounted drill rig supplied and operated by CCC Group of Ottawa, Ontario. Borehole 22-01 was advanced to 6.9 m (elevation of 75.8 m) below the existing ground surface. Standard Penetration Tests (SPTs) were carried out in the boreholes within the overburden at regular intervals of depth

where possible. Samples of the soils encountered were recovered using 35 mm inside diameter split-spoon sampling equipment in general accordance with ASTM D1586-18. In-situ vane testing was carried out, where possible, in the silty clay to clay deposit to measure the undrained shear strength of this soil. Borehole 22-01A was augered to 1.9 m below ground surface without recovering the soil samples and then in-situ vane testing was carried out in the inferred silty clay to clay deposit to 4.0 m below the ground surface.

One monitoring well was sealed into borehole 22-01 to allow for measurement of the stabilised groundwater levels. The groundwater level measurement in this well was carried out by Golder personnel on August 12, 2022.

The fieldwork was supervised by personnel from our engineering staff who located the boreholes, directed the drilling and in-situ testing operations, logged the borehole logs and samples, and took custody of the soil samples retrieved. On completion of the drilling operations, the soil samples were transported to our laboratory for further examination and for laboratory testing, which included determination of natural water content, grain size distribution and Atterberg limits on selected soil samples. One sample of soil was submitted to Eurofins Environment Testing for basic chemical analyses related to potential sulphate attack on buried concrete elements and potential corrosion of buried ferrous elements.

The borehole locations were selected in consultation with IST properties Inc., marked in the field, and subsequently surveyed by Golder Associates personnel.

## **4.0 SUBSURFACE CONDITIONS**

### **4.1 General**

Information on the subsurface conditions is provided as follows:

- The Record of borehole logs are provided in Appendix A.
- Laboratory test results are provided in Appendix B.
- Results of the basic chemical analyses are provided in Appendix C.
- Golder Associates Technical Memorandum No. 07-1121-0135 is provided in Appendix D

The Record of Borehole sheets describe the subsurface conditions at the particular borehole locations only. The stratigraphic boundaries shown on the borehole records are inferred from non-continuous sampling in some cases, observations of drilling progress as well as results of SPT tests and, therefore, represent transitions between soil types rather than exact planes of geological change. Furthermore, subsurface soil, and groundwater conditions will vary between and beyond the borehole locations.

### **4.2 Overview of Subsurface Conditions**

In general, the subsurface stratigraphy at the borehole locations consists of pavement structure, underlain by deposits of silty clay to clay, underlain by glacial till and weathered bedrock. The following sections present a detailed overview of the subsurface conditions encountered in the boreholes advanced during the current investigation.

#### **4.2.1 Pavement Structure**

The pavement structure at the location of borehole 22-01 consists of an approximately 80 mm thick layer of asphaltic concrete overlying 530 mm of granular base/subbase.

### 4.2.2 Silty Clay to Clay

At the location of borehole 22-01, the pavement structure is underlain by a silty clay to clay deposit. The upper portion of the silty clay to clay is weathered to a grey-brown crust. At this location, the weathered silty clay to clay crust extends to a depth of approximately 2.1 m below the existing ground surface (elevation of 80.6 m).

Standard Penetration Testing within the weathered crust yielded 'N' values of 4 and 5 blows per 0.3 m of penetration. The results of in-situ vane testing carried out within the upper portion of inferred weathered silty clay to clay in borehole 22-01A gave undrained shear strength of more than 96 kPa, indicating a very stiff consistency.

The measured natural water content of two samples of the weathered silty clay to clay was 51 and 58%. The result of Atterberg limit testing carried out on a single sample from the weathered silty clay to clay deposit gave a plasticity index value of 56 and liquid limit value of 79, indicating a high plasticity soil. The results of the Atterberg limit testing are provided on Figure B-1 in Appendix B.

Beneath the weathered zone, the clay is grey in colour. The unweathered grey silty clay to clay extends to a depth of 3.7 m (elevation of 79.0 m) below the existing ground surface.

The results of in-situ vane testing carried out within the unweathered portion of silty clay to clay in borehole 22-01 and inferred silty clay to clay in borehole 22-01A gave undrained shear strengths in the range of 67 to 81 kPa, indicating a stiff consistency.

The measured natural water content of a single sample of the unweathered silty clay to clay was 48%. The results of Atterberg limit testing carried out on a single sample from the unweathered silty clay gave a plasticity index value of 46 and a liquid limit value of 67, indicating a high plasticity soil. The results of the Atterberg limit testing are provided on Figure B-2 in Appendix B.

### 4.2.3 Glacial Till

A deposit of glacial till exists beneath the grey silty clay to clay at the location of borehole 22-01.

The glacial till typically consists of a heterogeneous mixture of gravel, cobbles, and boulders in a matrix of sandy silt to silty sand. The glacial till extends to a depth of 5.2 m (elevation of 77.5 m) beneath the existing ground surface.

The SPT "N" values within the glacial till layer ranged from 8 to 21 blows per 0.3 m of penetration, indicating a loose to compact state of packing.

The measured natural water content of two samples of glacial till were 8 and 9%. The results of grain size distribution testing carried out on two samples of the glacial till are provided on Figure B-3 in Appendix B. The results of Atterberg limit testing carried out on the fine portions of two samples from glacial deposits gave a plasticity index value of 5, and liquid limit values of 17 and 19, indicating low plasticity fines. The results of the Atterberg limit testing are provided on Figure B-4 in Appendix B.

### 4.2.4 Highly Weathered Bedrock and Refusal

Highly weathered bedrock was encountered below the glacial till at the location of borehole 22-01. The bedrock was encountered at a depth of 5.2 m (77.5 m elevation) and penetrated to a depth of 1.7 m by augering. Sampler refusal was encountered at a depth of 6.9 m (elevation of 75.8 m) below the existing ground surface.

### 4.3 Groundwater

The groundwater level in the monitoring well installed at this site was measured on August 12, 2022. During that time, the water level was observed at a depth of 6.4 m below existing ground surface. The measured water levels are summarized as follows:

Monitoring Well Number	Geologic Unit screened	Groundwater Level Depth (m)	Ground Surface Elevation (m)	Groundwater Level Elevation (m)
22-01	Glacial Till & Weathered Bedrock	6.4	82.7	76.3

It should be noted that groundwater levels are expected to fluctuate seasonally. Higher groundwater levels are expected during wet periods of the year, such as spring and fall.

### 4.4 Corrosion Testing

One sample of soil from borehole 22-01 was submitted to Eurofins Environment Testing for basic chemical analysis related to potential sulphate attack on buried concrete elements and corrosion of buried ferrous elements. The results of this testing is provided in Appendix C and is summarized below:

Borehole Number	Sample Number	Depth Interval (m)	Chlorides (%)	Sulphates (%)	pH	Resistivity (Ohm-cm)
22-01	3	1.5 - 2.1	0.043	0.05	7.88	1920

## 5.0 DESIGN AND CONSTRUCTION CONSIDERATIONS

### 5.1 General

This section of the report provides engineering guidelines on the geotechnical design aspects of the proposed building expansion based on our interpretation of the borehole information and project requirements.

The information in this portion of the report is provided for planning and design purposes for the guidance of the design engineers and architects. Where comments are made on construction, they are provided only to highlight aspects of construction which could affect the design of the project. Contractors bidding on or undertaking the works should examine the factual results of the investigation, satisfy themselves as to the adequacy of the factual information for construction, and make their own interpretation of the factual data as it affects their proposed construction techniques, schedule, safety, and equipment capabilities, costs, sequencing and the like.

Pursuant to the following recommendations, the subsurface conditions encountered during the investigations indicate that there are no concerns from a geotechnical standpoint for the site development that cannot be managed using routine and accepted design and construction approaches for commercial development.

### 5.2 Excavation and Groundwater Control

Based on the information provided to Golder, it is anticipated that excavations will be required for the foundations, the thermal storage pad and possibly for site services. It is assumed that the foundations will extend to typical frost depth and excavations for the thermal storage pad will be to approximately 3 m depth. At these depths the



excavations will be in the silty clay, or possibly into the upper portions of the till in some locations. Deeper excavations (if required) for site services may also be in glacial till or the underlying bedrock.

Measurements taken during the current investigation suggest that the groundwater level was at about 6.4 m below the existing ground surface, and within the upper portion of the bedrock (but likely below the depth of excavation for foundations, the granular pad and typical site services).

No unusual problems are anticipated in excavating the overburden using conventional hydraulic excavating equipment, recognizing that cobbles and boulders could be present in the glacial till.

In accordance with the Occupational Health and Safety Act (OHSA) of Ontario, the soils that will be encountered within the excavations would be generally classified as Type 3 soils. The side slopes in the overburden above the water table, which is the case for this site, could be sloped no steeper than 1 horizontal to 1 vertical. Boulders larger than 0.3 m in diameter should be removed from the excavation side slopes for worker safety.

Where site conditions (such as presence of soft or weak soils, proximity of existing structure and utilities, or space restriction) do not allow for the above noted side slopes, then suitable safety and support measures must be undertaken according to the requirement of OSHA. These measures include installation of a suitable shoring system to create and maintain positive supports to the side walls of the excavation. Guidelines on excavation shoring are provided in section 6.8.3 and design parameters are provided in section 6.6.1.

The groundwater levels at the site were measured to be below the anticipated general excavation depth. However, some groundwater infiltration into the excavation (such as perched water) should still be expected. Also, there may be instances where significant volumes of precipitation, surface runoff, and/or groundwater collects in an open excavation must be pumped out. Water in the open excavations should feasibly be handled by pumping from sumps within the excavations. Assuming the excavations are predominantly in silty clay, and are above the groundwater level, a PTTW is not expected to be required.

The silty clay and glacial till will be easily disturbed during construction. Any disturbed soil will need to be removed prior to placing the geotextile and 2 m thick gravel layer. This gravel layer should be placed immediately following inspection and approval of the subgrade. The period of time between exposure of the subgrade and covering with the gravel layer should be limited to as brief as possible and, in the interim, construction traffic on the subgrade should be minimized. In addition to this, this thermal gravel layer should be wrapped (top, bottom and sides) with a non-woven geotextile material to limit the migration of fine particles from pavement structure into voids of clean gravel.

### **5.3 Foundations**

Shallow foundations may be used to support the new addition. It is assumed that the foundation to support the proposed building expansion will be on footings up to 3 m in width, placed at a depth of around 1.8 m below the existing ground surface. Based on our understanding of the current design intent, the footings will be resting on the lower portions of the layer of gravel placed for mass thermal storage, underlain by grey silty clay to clay.

Pad footings up to 3 m in width, may be assumed to have a bearing resistance of 150 kPa at Serviceability Limit States (SLS) and a factored bearing resistance at ultimate limit state (ULS) of 200 kPa. It would be possible to accommodate larger foundations, but the bearing resistance values would need to be re-assessed.

The post-construction total and differential settlements of footings supported on soil and sized using the above maximum allowable bearing pressures would be expected to be less than 25 and 10 mm, respectively, assuming the foundations were properly constructed.

#### **5.4 Foundation Wall Backfill**

The soils at this site are frost susceptible and should not be used as backfill directly against foundation elements. To avoid problems with frost adhesion and heaving, foundation elements should be backfilled with non-frost susceptible sand and gravel conforming to the requirements for OPSS Granular B Type I or, alternatively a bond break such as the Platon system sheeting could be placed against the foundation walls. The 2 m thick gravel layer for mass thermal storage will fulfill this function.

#### **5.5 Site Class**

The seismic design provisions of the 2012 Ontario Building Code (OBC) depend, in part, on the shear wave velocity of the upper 30 m of soil and/or rock below founding level. The results of the shear wave velocity testing at the site are provided in Golder Associates previous memo titled “Seismic Study – Site Classification, MASW Data Processing and Results, 2700 Swansea Crescent, Ottawa, Ontario”. This memo is provided in Appendix D.

The results of the testing indicate an average shear wave velocity for the upper 30 m of soil and bedrock of 470 m per second which, according to the 2012 Ontario Building Code site classification for seismic site response, classifies this site as Site Class C.

#### **5.6 Frost Protection**

The soils at this site are frost susceptible. All isolated, unheated footings adjacent to surfaces which are cleared of snow cover during winter months should be provided with a minimum of 1.8 m of earth cover.

Consideration could be given to insulating the bearing surface with high density insulation as an alternative to earth cover. Further geotechnical input can be provided in this regard, if required.

#### **5.7 Trees**

Silty clay to clay soils in some areas in Ottawa are highly sensitive to water depletion by trees of high water demand during periods of dry weather. When trees draw water from the silty clay or clay, the soil can undergo a significant amount of volume change (i.e., shrinkage) which can result in settlement of adjacent structures.

Based on the results of Atterberg limit testing, silty clay to clay layers has high plasticity. Therefore, these materials are likely to undergo significant volume changes as a result of variation in water content.

Tree planting setback restrictions are required at this site as per City guideline, “*Tree Planting in Sensitive Marine Clay Soils – 2017 Guidelines*” draft version 2.0 (dated January 7, 2019).

#### **5.8 Site Servicing**

At least 150 mm of OPSS Granular A should be used as pipe bedding for sewer and water pipes. Where unavoidable disturbance to the subgrade surface occurs below the invert of the pipe, it will be necessary to remove the disturbed material, and place a sub-bedding layer consisting of compacted OPSS Granular B Type II beneath the Granular A. The bedding material should in all cases extend to the spring line of the pipe and should be compacted to at least 95% of the material's Standard Proctor Maximum Dry Density (SPMDD). The use of clear crushed stone as a bedding layer should not be permitted anywhere on this project since fine particles from

the sandy backfill materials or surrounding soil could potentially migrate into the voids in the clear crushed stone and cause loss of lateral pipe support.

Cover material, from spring line of the pipe to at least 300 mm above the top of pipe, should consist of OPSS Granular A or Granular B Type I with a maximum particle size of 25 mm. The cover material should be compacted to at least 95% of SPMDD.

It should generally be possible to re-use the existing native in-organic soil, silty clay and glacial till as trench backfill, provided that they are not too wet to handle, place, and compact. Where the trench will be covered with hard surfaced areas, the type of material placed in the frost zone (between subgrade level and 1.8 m depth) should match the soil exposed on the trench walls for frost heave compatibility. Trench backfill should be placed in maximum 300 mm thick lifts and should be compacted to at least 95% of the material's SPMDD using suitable vibratory compaction equipment.

## 5.9 Pavement Design

In preparation for pavement construction, all topsoil, fill, disturbed, or otherwise deleterious materials (i.e., those materials containing organic material) should be removed from the roadway areas.

Pavement areas requiring grade raising to proposed subgrade level should be filled using acceptable (compactable and inorganic) earth borrow or OPSS Select Subgrade Material (SSM). These materials should be placed in maximum 300 mm thick lifts and should be compacted to at least 95% of SPMDD using suitable compaction equipment.

The surface of the pavement subgrade should be crowned to promote drainage of the roadway granular structure. Perforated pipe sub-drains should be provided at subgrade level extending from the catch basins for a distance of at least 3 m longitudinally, parallel to the curb in two directions.

The pavement structure for new car parking areas may consist of:

Pavement Component	Thickness (mm)
Asphaltic Concrete	50
OPSS Granular A Base	150
OPSS Granular B Type II Subbase	300

The pavement structure for new access roadways and truck traffic areas should consist of:

Pavement Component	Thickness (mm)
Asphaltic Concrete	90
OPSS Granular A Base	150
OPSS Granular B Type II Subbase	400

The granular base and subbase used on this site should consist of Granular A and B Type II, respectively, in conformance with OPSS.MUNI 1010 or City of Ottawa specification F-3147. The granular base and subbase materials should be uniformly compacted to 100 percent of the material's SPMDD using suitable vibratory

compaction equipment. The asphaltic concrete should be compacted in accordance with Table 10 of OPSS.MUNI 310.

The composition of the asphaltic concrete pavement in car parking areas should be as follows:

- Superpave 12.5 Surface Course – 50 mm.

The composition of the asphaltic concrete pavement in access roadways and truck traffic areas should be as follows:

- Superpave 12.5 Surface Course – 40 mm.
- Superpave 19.0 Binder Course – 50 mm.

The pavement design should be based on a Traffic Category of Level B. The asphalt cement used on this project should be made with PG 58-34 asphalt cement on all lifts.

The above pavement designs are based on the assumption that the pavement subgrade has been acceptably prepared (i.e., where the trench backfill, and grade raise fill have been adequately compacted to the required density and the subgrade surface not disturbed by construction operations or precipitation). In this case, the pavement subgrade will be a compacted gravel layer placed for mass thermal storage. It could be necessary to place a gravel layer wrapped with woven geotextile to limit the migration of fine particles from pavement structure or surrounding soil into the voids in the gravel layer.

At the limits of construction or the end of the curb “return” (i.e., the start of the constant width portion of the access road, the asphaltic concrete should be milled back an additional 300 mm to a depth of 40 or 50 mm to accept the surface course asphaltic concrete.

The granular courses and subbase level should be tapered between the new and existing pavements by using 10 horizontal to 1 vertical tapers up or down as required, starting from beyond the limits of construction. Butt joints can be used along joints of new and existing parking areas.

## 5.10 Corrosion and Cement Type

One sample of soil from borehole 22-01 was submitted to Eurofins Environment Testing for basic chemical analysis related to potential sulphate attack on buried concrete elements and corrosion of buried ferrous elements. The results of this testing are provided in Appendix C and are summarized in Section 4.4.

The concentration of soluble sulphate provides an indication of the degree of sulphate attack that is expected for concrete in contact with soil and groundwater at the site. The sulphate results were compared with Table 3 of Canadian Standards Association Standards A23.1-14 (CSA A23.1) and generally indicate a low degree of sulphate attack potential on concrete structures at this site. Accordingly, Type GU Portland cement should be acceptable for buried concrete substructures.

The pH, resistivity and chloride concentration provide an indication of the degree of corrosiveness of the sub-surface environment. Generally, the test results indicate an elevated potential for corrosion of exposed ferrous metal at the site which should be considered in the design of substructures.

## 6.0 ADDITIONAL CONSIDERATIONS

The soils at this site are sensitive to disturbance construction traffic, and frost when wet (i.e., saturated). Cobbles and boulders are present in the glacial till.

All footing and subgrade areas should be inspected by experienced geotechnical personnel of Golder Associates prior to filling or concreting to document that the correct/expected strata exist and that the bearing surfaces have been properly prepared. The placing and compaction of any engineered fill, pipe bedding, and pavement base and subbase materials should be inspected to ensure that the materials used conform to the specifications from both a grading and compaction point of view.

The monitoring well installed at the site will require decommissioning at the time of construction in accordance with Ontario Regulation 903. It is therefore suggested that decommissioning of this device be made part of the construction contract. The monitoring well may be useful during the initial stages of dewatering, if required, for monitoring the progress of the groundwater level lowering.

At the time of the writing of this report, only preliminary details for the proposed development were available. Golder Associates should review the final drawings and specifications for this project prior to tendering to confirm that the guidelines in this report have been adequately interpreted and to review some of our preliminary recommendations.

# Signature Page

**Golder Associates Ltd.**



Kinjal Gajjar  
*Geotechnical Consultant*

KG/CH/ljv



Chris Hendry, P.Eng.  
*Senior Geotechnical Engineer*



**Standard of Care:** Golder Associates Ltd. (Golder) has prepared this report in a manner consistent with that level of care and skill ordinarily exercised by members of the engineering and science professions currently practising under similar conditions in the jurisdiction in which the services are provided, subject to the time limits and physical constraints applicable to this report. No other warranty, expressed or implied is made.

**Basis and Use of the Report:** This report has been prepared for the specific site, design objective, development and purpose described to Golder by the Client. The factual data, interpretations and recommendations pertain to a specific project as described in this report and are not applicable to any other project or site location. Any change of site conditions, purpose, development plans or if the project is not initiated within eighteen months of the date of the report may alter the validity of the report. Golder cannot be responsible for use of this report, or portions thereof, unless Golder is requested to review and, if necessary, revise the report.

The information, recommendations and opinions expressed in this report are for the sole benefit of the Client. No other party may use or rely on this report or any portion thereof without Golder's express written consent. If the report was prepared to be included for a specific permit application process, then upon the reasonable request of the client, Golder may authorize in writing the use of this report by the regulatory agency as an Approved User for the specific and identified purpose of the applicable permit review process. Any other use of this report by others is prohibited and is without responsibility to Golder. The report, all plans, data, drawings and other documents as well as all electronic media prepared by Golder are considered its professional work product and shall remain the copyright property of Golder, who authorizes only the Client and Approved Users to make copies of the report, but only in such quantities as are reasonably necessary for the use of the report by those parties. The Client and Approved Users may not give, lend, sell, or otherwise make available the report or any portion thereof to any other party without the express written permission of Golder. The Client acknowledges that electronic media is susceptible to unauthorized modification, deterioration and incompatibility and therefore the Client can not rely upon the electronic media versions of Golder's report or other work products.

The report is of a summary nature and is not intended to stand alone without reference to the instructions given to Golder by the Client, communications between Golder and the Client, and to any other reports prepared by Golder for the Client relative to the specific site described in the report. In order to properly understand the suggestions, recommendations and opinions expressed in this report, reference must be made to the whole of the report. Golder can not be responsible for use of portions of the report without reference to the entire report.

Unless otherwise stated, the suggestions, recommendations and opinions given in this report are intended only for the guidance of the Client in the design of the specific project. The extent and detail of investigations, including the number of test holes, necessary to determine all of the relevant conditions which may affect construction costs would normally be greater than has been carried out for design purposes. Contractors bidding on, or undertaking the work, should rely on their own investigations, as well as their own interpretations of the factual data presented in the report, as to how subsurface conditions may affect their work, including but not limited to proposed construction techniques, schedule, safety and equipment capabilities.

**Soil, Rock and Ground Water Conditions:** Classification and identification of soils, rocks, and geologic units have been based on commonly accepted methods employed in the practice of geotechnical engineering and related disciplines. Classification and identification of the type and condition of these materials or units involves judgment, and boundaries between different soil, rock or geologic types or units may be transitional rather than abrupt. Accordingly, Golder does not warrant or guarantee the exactness of the descriptions.

Special risks occur whenever engineering or related disciplines are applied to identify subsurface conditions and even a comprehensive investigation, sampling and testing program may fail to detect all or certain subsurface conditions. The environmental, geologic, geotechnical, geochemical and hydrogeologic conditions that Golder interprets to exist between and beyond sampling points may differ from those that actually exist. In addition to soil variability, fill of variable physical and chemical composition can be present over portions of the site or on adjacent properties. The professional services retained for this project include only the geotechnical aspects of the subsurface conditions at the site, unless otherwise specifically stated and identified in the report. The presence or implication(s) of possible surface and/or subsurface contamination resulting from previous activities or uses of the site and/or resulting from the introduction onto the site of materials from off-site sources are outside the terms of reference for this project and have not been investigated or addressed.

Soil and groundwater conditions shown in the factual data and described in the report are the observed conditions at the time of their determination or measurement. Unless otherwise noted, those conditions form the basis of the recommendations in the report. Groundwater conditions may vary between and beyond reported locations and can be affected by annual, seasonal and meteorological conditions. The condition of the soil, rock and groundwater may be significantly altered by construction activities (traffic, excavation, groundwater level lowering, pile driving, blasting, etc.) on the site or on adjacent sites. Excavation may expose the soils to changes due to wetting, drying or frost. Unless otherwise indicated the soil must be protected from these changes during construction.

**Sample Disposal:** Golder will dispose of all uncontaminated soil and/or rock samples 90 days following issue of this report or, upon written request of the Client, will store uncontaminated samples and materials at the Client's expense. In the event that actual contaminated soils, fills or groundwater are encountered or are inferred to be present, all contaminated samples shall remain the property and responsibility of the Client for proper disposal.

**Follow-Up and Construction Services:** All details of the design were not known at the time of submission of Golder's report. Golder should be retained to review the final design, project plans and documents prior to construction, to confirm that they are consistent with the intent of Golder's report.


During construction, Golder should be retained to perform sufficient and timely observations of encountered conditions to confirm and document that the subsurface conditions do not materially differ from those interpreted conditions considered in the preparation of Golder's report and to confirm and document that construction activities do not adversely affect the suggestions, recommendations and opinions contained in Golder's report. Adequate field review, observation and testing during construction are necessary for Golder to be able to provide letters of assurance, in accordance with the requirements of many regulatory authorities. In cases where this recommendation is not followed, Golder's responsibility is limited to interpreting accurately the information encountered at the borehole locations, at the time of their initial determination or measurement during the preparation of the Report.



**Changed Conditions and Drainage:** Where conditions encountered at the site differ significantly from those anticipated in this report, either due to natural variability of subsurface conditions or construction activities, it is a condition of this report that Golder be notified of any changes and be provided with an opportunity to review or revise the recommendations within this report. Recognition of changed soil and rock conditions requires experience and it is recommended that Golder be employed to visit the site with sufficient frequency to detect if conditions have changed significantly.

Drainage of subsurface water is commonly required either for temporary or permanent installations for the project. Improper design or construction of drainage or dewatering can have serious consequences. Golder takes no responsibility for the effects of drainage unless specifically involved in the detailed design and construction monitoring of the system.

Path: \\golder.com\projects\clients\IST\_Properties\Ottawa\_Swansea\_C\_2700989\_PROJ\22514086EX\_Geotechnical\SitePlan.dwg | Last Edited By: amachado Date: 2022-12-15 Time: 4:58:55 PM

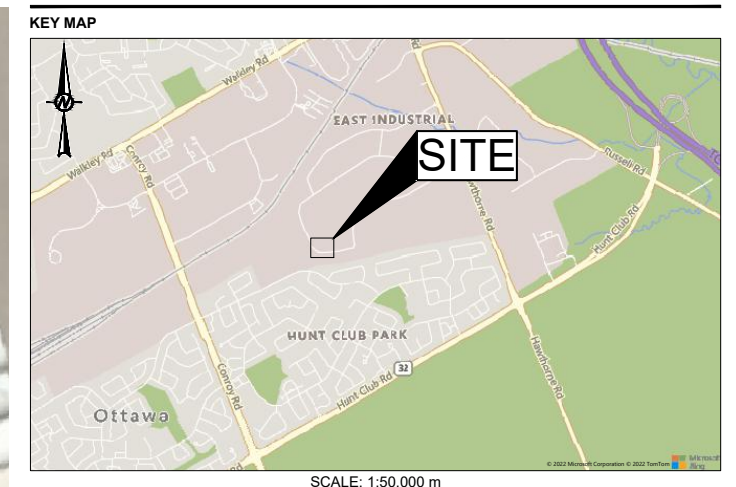


**LEGEND**

APPROXIMATE BOREHOLE LOCATION, CURRENT INVESTIGATION

**REFERENCE(S)**

1. PROJECTION: TRANSVERSE MERCATOR, DATUM NAD 83,  
COORDINATE SYSTEM: MTM ZONE 9, VERTICAL DATUM CGVD28



**CLIENT**  
IST PROPERTIES INC.

**PROJECT**  
GEOTECHNICAL INVESTIGATION, 2700 SWANSEA CRESCENT,  
OTTAWA, ONTARIO

**TITLE**  
SITE PLAN

CONSULTANT	YYYY-MM-DD	2022-12-15
	DESIGNED	---
	PREPARED	ZS
	REVIEWED	KG
	APPROVED	CH

PROJECT NO.	CONTROL	REV.	FIGURE
22514086EX	0002	A	1

IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM A3/B


**APPENDIX A**

**Record of Borehole Logs**

# METHOD OF SOIL CLASSIFICATION

The Golder Associates Ltd. Soil Classification System is based on the Unified Soil Classification System (USCS)

Organic or Inorganic	Soil Group	Type of Soil	Gradation or Plasticity	$C_u = \frac{D_{60}}{D_{10}}$	$C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}$	Organic Content	USCS Group Symbol	Group Name							
INORGANIC (Organic Content ≤30% by mass)	COARSE-GRAINED SOILS (>50% by mass is larger than 0.075 mm)	GRAVELS (>50% by mass of coarse fraction is larger than 4.75 mm)	Poorly Graded	<4	≤1 or ≥3	≤30%	GP	GRAVEL							
			Well Graded	≥4	1 to 3		GW	GRAVEL							
		GRAVELS with >12% fines (by mass)	Below A Line	n/a			GM	SILTY GRAVEL							
			Above A Line	n/a			GC	CLAYEY GRAVEL							
		SANDS (≥50% by mass of coarse fraction is smaller than 4.75 mm)	SANDS with ≤12% fines (by mass)	Poorly Graded	<6		≤1 or ≥3	SP	SAND						
				Well Graded	≥6		1 to 3	SW	SAND						
			SANDS with >12% fines (by mass)	Below A Line	n/a		SM	SILTY SAND							
				Above A Line	n/a		SC	CLAYEY SAND							
			Organic or Inorganic	Soil Group	Type of Soil		Laboratory Tests	Field Indicators					Organic Content	USCS Group Symbol	Primary Name
								Dilatancy	Dry Strength	Shine Test	Thread Diameter	Toughness (of 3 mm thread)			
INORGANIC (Organic Content ≤30% by mass)	FINE-GRAINED SOILS (≥50% by mass is smaller than 0.075 mm)	SILTS (Non-Plastic or PI and LL plot below A-Line on Plasticity Chart below)	Liquid Limit <50	Rapid	None	None	>6 mm	N/A (can't roll 3 mm thread)	<5%	ML	SILT				
				Slow	None to Low	Dull	3mm to 6 mm	None to low	<5%	ML	CLAYEY SILT				
			Liquid Limit ≥50	Slow to very slow	Low to medium	Dull to slight	3mm to 6 mm	Low	5% to 30%	OL	ORGANIC SILT				
				Slow to very slow	Low to medium	Slight	3mm to 6 mm	Low to medium	<5%	MH	CLAYEY SILT				
		CLAYS (PI and LL plot above A-Line on Plasticity Chart below)	Liquid Limit <30	None	Low to medium	Slight to shiny	~ 3 mm	Low to medium	0% to 30%  (see Note 2)	CL	SILTY CLAY				
				None	Medium to high	Slight to shiny	1 mm to 3 mm	Medium		CI	SILTY CLAY				
				None	High	Shiny	<1 mm	High		CH	CLAY				
			Liquid Limit ≥30	None	Low to medium	Slight to shiny	~ 3 mm	Low to medium	0% to 30%  (see Note 2)	CL	SILTY CLAY				
				None	Medium to high	Slight to shiny	1 mm to 3 mm	Medium		CI	SILTY CLAY				
				None	High	Shiny	<1 mm	High		CH	CLAY				
HIGHLY ORGANIC SOILS (Organic Content >30% by mass)	Peat and mineral soil mixtures						30% to 75%	PT	SILTY PEAT, SANDY PEAT						
		Predominantly peat, may contain some mineral soil, fibrous or amorphous peat					75% to 100%		PEAT						

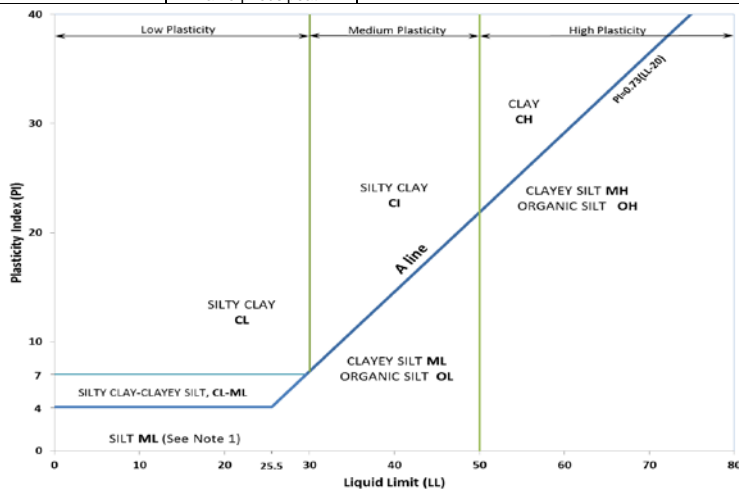

Note 1 – Fine grained materials with PI and LL that plot in this area are named (ML) SILT with slight plasticity. Fine-grained materials which are non-plastic (i.e. a PL cannot be measured) are named SILT.  
 Note 2 – For soils with <5% organic content, include the descriptor “trace organics” for soils with between 5% and 30% organic content include the prefix “organic” before the Primary name.

**Dual Symbol** — A dual symbol is two symbols separated by a hyphen, for example, GP-GM, SW-SC and CL-ML. For non-cohesive soils, the dual symbols must be used when the soil has between 5% and 12% fines (i.e. to identify transitional material between “clean” and “dirty” sand or gravel. For cohesive soils, the dual symbol must be used when the liquid limit and plasticity index values plot in the CL-ML area of the plasticity chart (see Plasticity Chart at left).

**Borderline Symbol** — A borderline symbol is two symbols separated by a slash, for example, CL/CI, GM/SM, CL/ML. A borderline symbol should be used to indicate that the soil has been identified as having properties that are on the transition between similar materials. In addition, a borderline symbol may be used to indicate a range of similar soil types within a stratum.

# ABBREVIATIONS AND TERMS USED ON RECORDS OF BOREHOLES AND TEST PITS

## PARTICLE SIZES OF CONSTITUENTS

Soil Constituent	Particle Size Description	Millimetres	Inches (US Std. Sieve Size)
BOULDERS	Not Applicable	>300	>12
COBBLES	Not Applicable	75 to 300	3 to 12
GRAVEL	Coarse	19 to 75	0.75 to 3
	Fine	4.75 to 19	(4) to 0.75
SAND	Coarse	2.00 to 4.75	(10) to (4)
	Medium	0.425 to 2.00	(40) to (10)
	Fine	0.075 to 0.425	(200) to (40)
SILT/CLAY	Classified by plasticity	<0.075	< (200)

## MODIFIERS FOR SECONDARY AND MINOR CONSTITUENTS

Percentage by Mass	Modifier
>35	Use 'and' to combine major constituents (i.e., SAND and GRAVEL)
> 12 to 35	Primary soil name prefixed with "gravelly, sandy, SILTY, CLAYEY" as applicable
> 5 to 12	some
≤ 5	trace

## PENETRATION RESISTANCE

### Standard Penetration Resistance (SPT), N:

The number of blows by a 63.5 kg (140 lb) hammer dropped 760 mm (30 in.) required to drive a 50 mm (2 in.) split-spoon sampler for a distance of 300 mm (12 in.). Values reported are as recorded in the field and are uncorrected.

### Cone Penetration Test (CPT)

An electronic cone penetrometer with a 60° conical tip and a project end area of 10 cm<sup>2</sup> pushed through ground at a penetration rate of 2 cm/s. Measurements of tip resistance (q<sub>t</sub>), porewater pressure (u) and sleeve frictions are recorded electronically at 25 mm penetration intervals.

### Dynamic Cone Penetration Resistance (DCPT); N<sub>d</sub>:

The number of blows by a 63.5 kg (140 lb) hammer dropped 760 mm (30 in.) to drive uncased a 50 mm (2 in.) diameter, 60° cone attached to "A" size drill rods for a distance of 300 mm (12 in.).

**PH:** Sampler advanced by hydraulic pressure

**PM:** Sampler advanced by manual pressure

**WH:** Sampler advanced by static weight of hammer

**WR:** Sampler advanced by weight of sampler and rod

## SAMPLES

AS	Auger sample
BS	Block sample
CS	Chunk sample
DD	Diamond Drilling
DO or DP	Seamless open ended, driven or pushed tube sampler – note size
DS	Denison type sample
GS	Grab Sample
MC	Modified California Samples
MS	Modified Shelby (for frozen soil)
RC	Rock core
SC	Soil core
SS	Split spoon sampler – note size
ST	Slotted tube
TO	Thin-walled, open – note size (Shelby tube)
TP	Thin-walled, piston – note size (Shelby tube)
WS	Wash sample

## SOIL TESTS

w	water content
PL , w <sub>p</sub>	plastic limit
LL , w <sub>L</sub>	liquid limit
C	consolidation (oedometer) test
CHEM	chemical analysis (refer to text)
CID	consolidated isotropically drained triaxial test <sup>1</sup>
CIU	consolidated isotropically undrained triaxial test with porewater pressure measurement <sup>1</sup>
D <sub>R</sub>	relative density (specific gravity, G <sub>s</sub> )
DS	direct shear test
GS	specific gravity
M	sieve analysis for particle size
MH	combined sieve and hydrometer (H) analysis
MPC	Modified Proctor compaction test
SPC	Standard Proctor compaction test
OC	organic content test
SO <sub>4</sub>	concentration of water-soluble sulphates
UC	unconfined compression test
UU	unconsolidated undrained triaxial test
V (FV)	field vane (LV-laboratory vane test)
γ	unit weight

1. Tests anisotropically consolidated prior to shear are shown as CAD, CAU.

## NON-COHESIVE (COHESIONLESS) SOILS

### Compactness<sup>2</sup>

Term	SPT 'N' (blows/0.3m) <sup>1</sup>
Very Loose	0 to 4
Loose	4 to 10
Compact	10 to 30
Dense	30 to 50
Very Dense	>50

1. SPT 'N' in accordance with ASTM D1586, uncorrected for the effects of overburden pressure.

2. Definition of compactness terms are based on SPT 'N' ranges as provided in Terzaghi, Peck and Mesri (1996). Many factors affect the recorded SPT 'N' value, including hammer efficiency (which may be greater than 60% in automatic trip hammers), overburden pressure, groundwater conditions, and grain size. As such, the recorded SPT 'N' value(s) should be considered only an approximate guide to the soil compactness. These factors need to be considered when evaluating the results, and the stated compactness terms should not be relied upon for design or construction.

### Field Moisture Condition

Term	Description
Dry	Soil flows freely through fingers.
Moist	Soils are darker than in the dry condition and may feel cool.
Wet	As moist, but with free water forming on hands when handled.

## COHESIVE SOILS

### Consistency

Term	Undrained Shear Strength (kPa)	SPT 'N' <sup>1,2</sup> (blows/0.3m)
Very Soft	<12	0 to 2
Soft	12 to 25	2 to 4
Firm	25 to 50	4 to 8
Stiff	50 to 100	8 to 15
Very Stiff	100 to 200	15 to 30
Hard	>200	>30

1. SPT 'N' in accordance with ASTM D1586, uncorrected for overburden pressure effects; approximate only.

2. SPT 'N' values should be considered ONLY an approximate guide to consistency; for sensitive clays (e.g., Champlain Sea clays), the N-value approximation for consistency terms does NOT apply. Rely on direct measurement of undrained shear strength or other manual observations.

### Water Content

Term	Description
w < PL	Material is estimated to be drier than the Plastic Limit.
w ~ PL	Material is estimated to be close to the Plastic Limit.
w > PL	Material is estimated to be wetter than the Plastic Limit.

## LIST OF SYMBOLS

Unless otherwise stated, the symbols employed in the report are as follows:

### I. GENERAL

$\pi$	3.1416
$\ln x$	natural logarithm of x
$\log_{10} x$	x or log x, logarithm of x to base 10
g	acceleration due to gravity
t	time

### II. STRESS AND STRAIN

$\gamma$	shear strain
$\Delta$	change in, e.g. in stress: $\Delta \sigma$
$\varepsilon$	linear strain
$\varepsilon_v$	volumetric strain
$\eta$	coefficient of viscosity
$\nu$	Poisson's ratio
$\sigma$	total stress
$\sigma'$	effective stress ( $\sigma' = \sigma - u$ )
$\sigma'_{vo}$	initial effective overburden stress
$\sigma_1, \sigma_2, \sigma_3$	principal stress (major, intermediate, minor)
$\sigma_{oct}$	mean stress or octahedral stress $= (\sigma_1 + \sigma_2 + \sigma_3)/3$
$\tau$	shear stress
u	porewater pressure
E	modulus of deformation
G	shear modulus of deformation
K	bulk modulus of compressibility

### III. SOIL PROPERTIES

#### (a) Index Properties

$\rho(\gamma)$	bulk density (bulk unit weight)*
$\rho_d(\gamma_d)$	dry density (dry unit weight)
$\rho_w(\gamma_w)$	density (unit weight) of water
$\rho_s(\gamma_s)$	density (unit weight) of solid particles
$\gamma'$	unit weight of submerged soil ( $\gamma' = \gamma - \gamma_w$ )
$D_R$	relative density (specific gravity) of solid particles ( $D_R = \rho_s / \rho_w$ ) (formerly $G_s$ )
e	void ratio
n	porosity
S	degree of saturation

#### (a) Index Properties (continued)

w	water content
$w_l$ or LL	liquid limit
$w_p$ or PL	plastic limit
$I_p$ or PI	plasticity index = $(w_l - w_p)$
NP	non-plastic
$w_s$	shrinkage limit
$I_L$	liquidity index = $(w - w_p) / I_p$
$I_C$	consistency index = $(w_l - w) / I_p$
$e_{max}$	void ratio in loosest state
$e_{min}$	void ratio in densest state
$I_D$	density index = $(e_{max} - e) / (e_{max} - e_{min})$ (formerly relative density)

#### (b) Hydraulic Properties

h	hydraulic head or potential
q	rate of flow
v	velocity of flow
i	hydraulic gradient
k	hydraulic conductivity (coefficient of permeability)
j	seepage force per unit volume

#### (c) Consolidation (one-dimensional)

$C_c$	compression index (normally consolidated range)
$C_r$	recompression index (over-consolidated range)
$C_s$	swelling index
$C_\alpha$	secondary compression index
$m_v$	coefficient of volume change
$C_v$	coefficient of consolidation (vertical direction)
$C_h$	coefficient of consolidation (horizontal direction)
$T_v$	time factor (vertical direction)
U	degree of consolidation
$\sigma'_p$	pre-consolidation stress
OCR	over-consolidation ratio = $\sigma'_p / \sigma'_{vo}$

#### (d) Shear Strength

$\tau_p, \tau_r$	peak and residual shear strength
$\phi'$	effective angle of internal friction
$\delta$	angle of interface friction
$\mu$	coefficient of friction = $\tan \delta$
$c'$	effective cohesion
$c_u, s_u$	undrained shear strength ( $\phi = 0$ analysis)
p	mean total stress $(\sigma_1 + \sigma_3)/2$
$p'$	mean effective stress $(\sigma'_1 + \sigma'_3)/2$
q	$(\sigma_1 - \sigma_3)/2$ or $(\sigma'_1 - \sigma'_3)/2$
$q_u$	compressive strength $(\sigma_1 - \sigma_3)$
$S_t$	sensitivity

\* Density symbol is  $\rho$ . Unit weight symbol is  $\gamma$  where  $\gamma = \rho g$  (i.e. mass density multiplied by acceleration due to gravity)

Notes: 1  
2

$$\tau = c' + \sigma' \tan \phi'$$

$$\text{shear strength} = (\text{compressive strength})/2$$

PROJECT: 22514086EX  
 LOCATION: N 5026760.78; E 374229.05

# RECORD OF BOREHOLE: 22-01

SHEET 1 OF 1  
 DATUM: Geodetic

BORING DATE: July 5, 2021

SPT/DCPT HAMMER: MASS, 64kg; DROP, 760mm

HAMMER TYPE: AUTOMATIC

GTA-BHS 001 \\GOLDER.GDS\COMPLEXDATA\OFFICE\ONTARIO\SIMILIANTS\IST\_PROPERTIES\OTTAWA\_SWANSEA\_CR\_2700\02\_DATA\GINT\2700\_SWANSEA\_CRESCENT.GPJ GAL-MIS.GDT 12/16/22

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES			DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION	
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH				WATER CONTENT PERCENT					
								20 40 60 80		nat V. + Q - rem V. ⊕ U - ○		10 <sup>-6</sup> 10 <sup>-5</sup> 10 <sup>-4</sup> 10 <sup>-3</sup>		Wp         W         Wi			
0		GROUND SURFACE		82.69													
		ASPHALTIC CONCRETE		0.00													
		FILL - (SP) GRAVELLY SAND, some silt; brown to black (PAVEMENT STRUCTURE); non-cohesive, moist		0.08	1	AS	-										
		(Cl/CH) SILTY CLAY, trace to some gravel; grey brown (WEATHERED CRUST); cohesive, w>PL, stiff to very stiff		82.08	2	SS	5										
1				0.61													
					3	SS	4										
2		(Cl/CH) SILTY CLAY, some gravel; grey; cohesive, w>PL, stiff		80.56	4	SS	WR										
				2.13													
3																	
4	Power Auger 200 mm Diam. (Hollow Stem)	(SM/ML) gravelly SILTY SAND to sandy SILT, some low plastic fines; grey, possible cobbles and boulders (GLACIAL TILL); slightly cohesive, moist, loose to compact		79.03	5	SS	21										
				3.66													
5					6	SS	8										
6		Weathered BEDROCK		77.51	7	SS	33										
				5.18													
7					8	SS	37										
7		End of Borehole		75.77	9	SS	>50										
				6.92													
8		Note(s): 1. Water level measured at a depth of 6.39 m (Elev. 76.3 m) on August 12, 2022															
9																	
10																	

PROJECT: 22514086EX  
 LOCATION: N 5026771.85; E 374221.65

# RECORD OF BOREHOLE: 22-01A

SHEET 1 OF 1  
 DATUM: Geodetic

BORING DATE: July 5, 2021

SPT/DCPT HAMMER: MASS, 64kg; DROP, 760mm

HAMMER TYPE: AUTOMATIC

DEPTH SCALE METRES	BORING METHOD	SOIL PROFILE		SAMPLES		DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m				HYDRAULIC CONDUCTIVITY, k, cm/s				ADDITIONAL LAB. TESTING	PIEZOMETER OR STANDPIPE INSTALLATION		
		DESCRIPTION	STRATA PLOT	ELEV. DEPTH (m)	NUMBER	TYPE	BLOWS/0.3m	SHEAR STRENGTH Cu, kPa				WATER CONTENT PERCENT					
								20	40	60	80	nat V. +	rem V. ⊕			Q - ●	U - ○
0		GROUND SURFACE		82.65													
		For Soil Stratigraphy refer to Record of Borehole 22-01		0.00													
2				80.77													
				1.88													
3																	
4		End of Borehole		78.69													
				3.96													

GTA-BHS 001 \\GOLDER.GDS\COMPLEXDATA\OFFICE\ONTARIO\SIMILIENS\IST\_PROPERTIES\OTTAWA\_SWANSEA\_CR\_2700\02\_DATA\GINT\2700\_SWANSEA\_CRESCENT.GPJ\_GAL-MIS.GDT\_12/16/22

DEPTH SCALE  
 1 : 50




LOGGED: PAK  
 CHECKED: KG




**APPENDIX B**

**Results of Laboratory Testing**

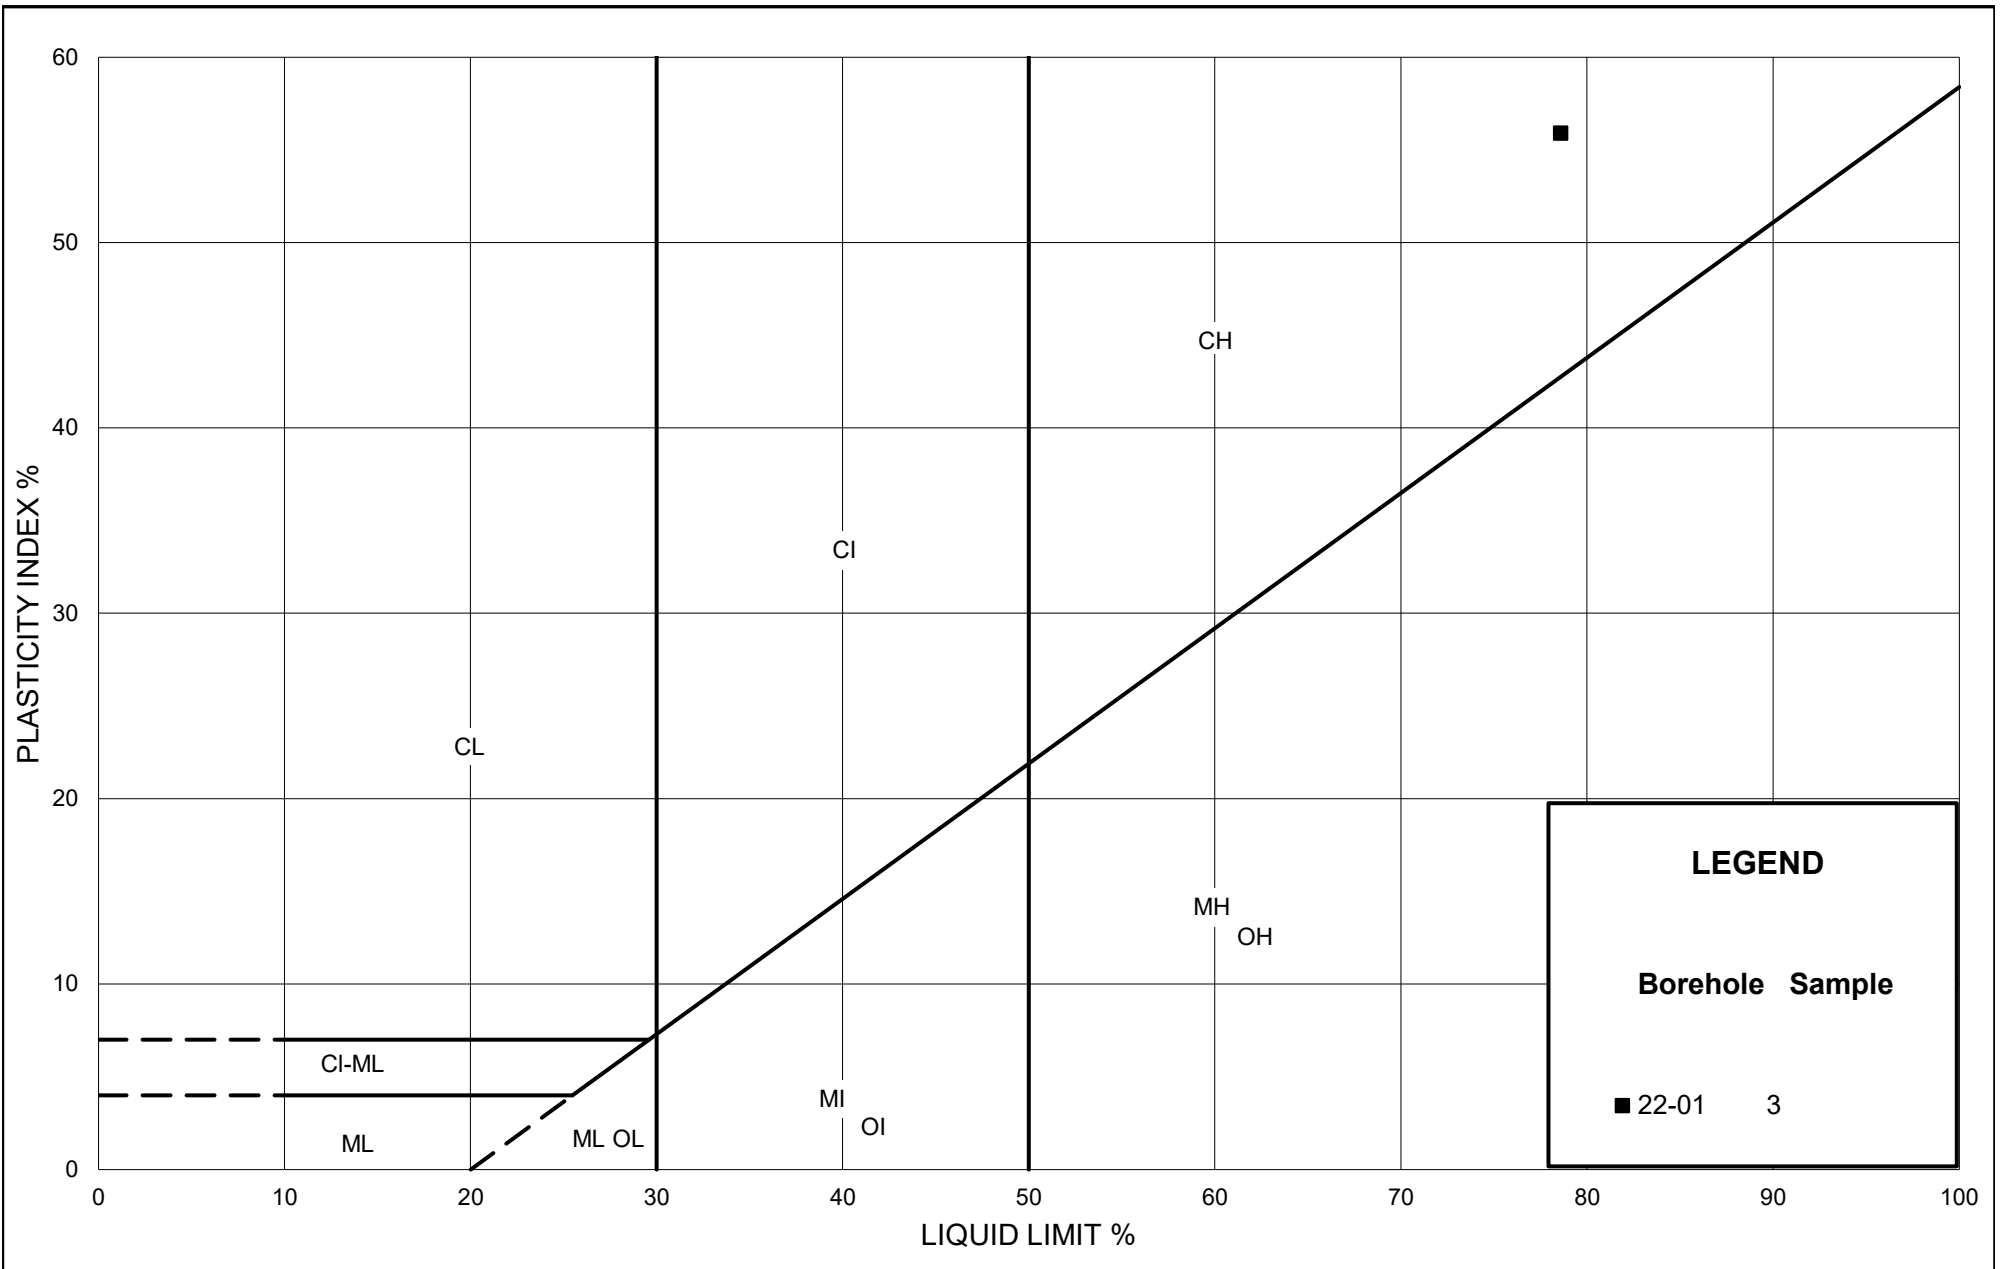

**PLASTICITY CHART**  
**SILTY CLAY TO CLAY (WEATHERED CRUST)**

Figure:	B-1
Project:	22514086EX
Created By:	MI
Checked By:	JB

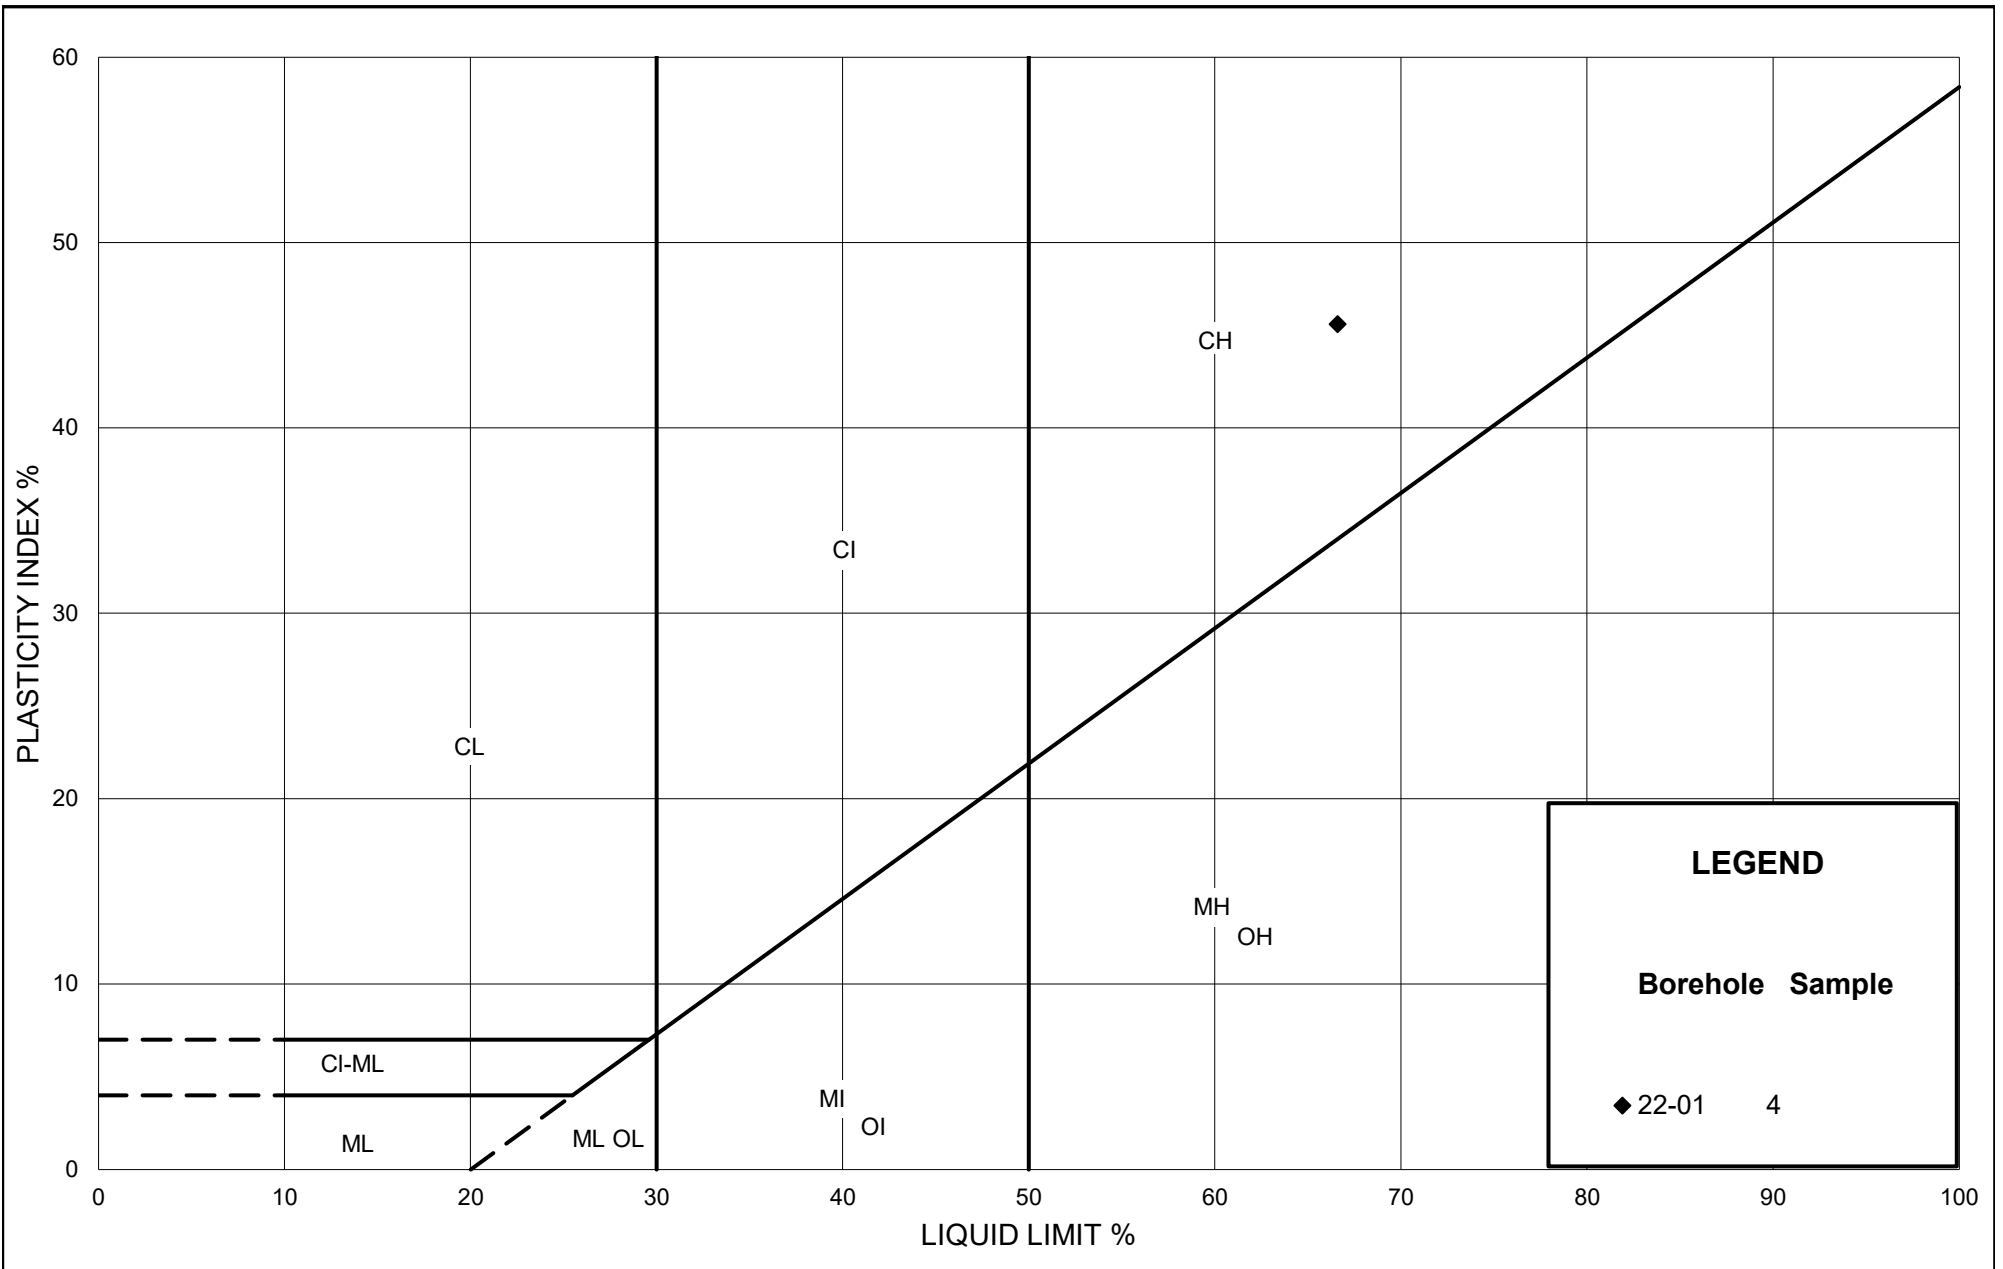

# PLASTICITY CHART


## SILTY CLAY TO CLAY

Figure: B-2  
 Project: 22514086EX  
 Created By: MI Checked By: JB

# GRAIN SIZE DISTRIBUTION

FIGURE B-3

## GLACIAL TILL

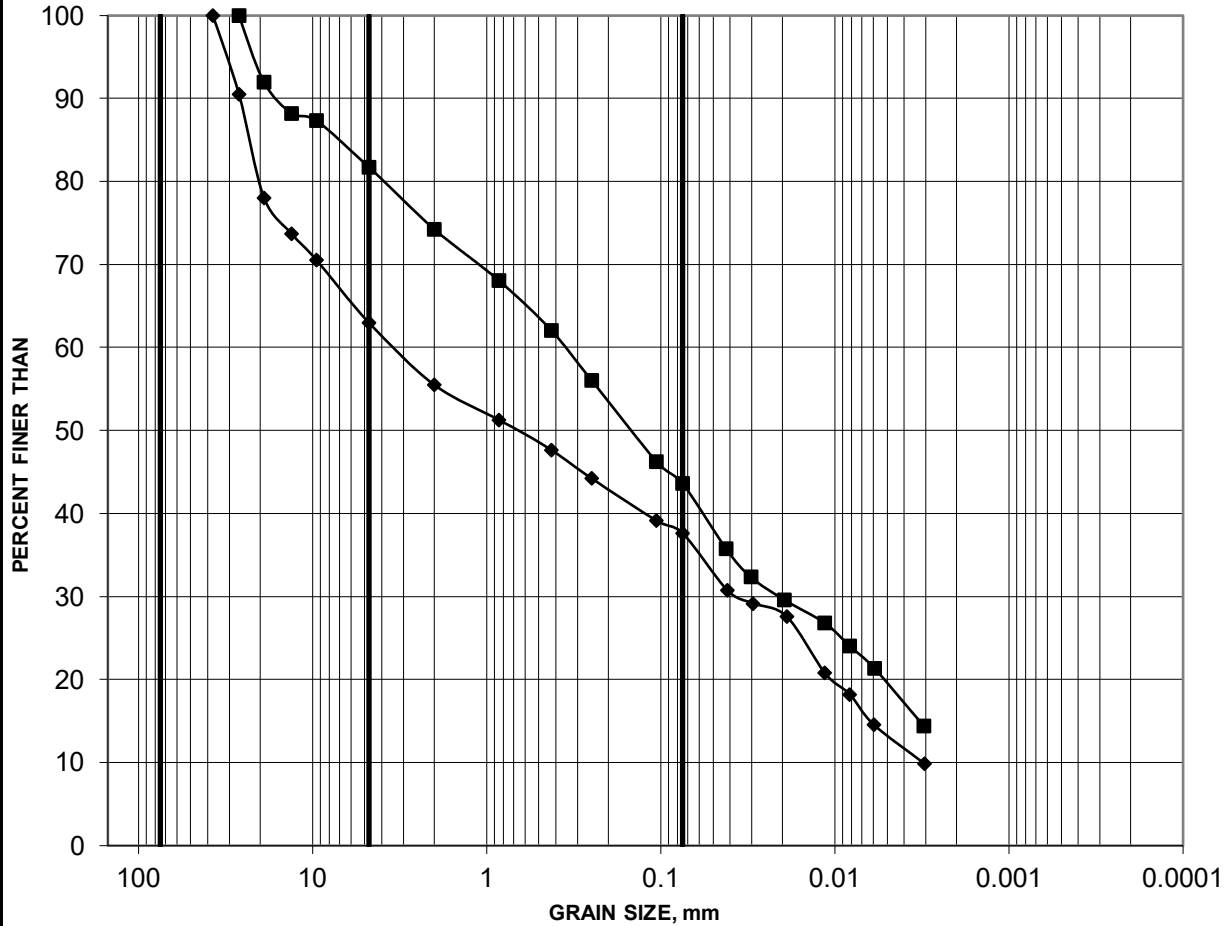


COBBLE SIZE	COARSE	FINE	COARSE	MEDIUM	FINE	SILT AND CLAY
	GRAVEL SIZE		SAND SIZE			

Borehole	Sample	Depth (m)	Constituents (%)				
			Gravel	Sand	Silt	Clay	
—■—	22-01	5	3.81-4.42	18	38	32	12
—◆—	22-01	6	4.57-5.18	37	25	30	8

Project: 22514086EX



Created by: MI  
Checked by: JB

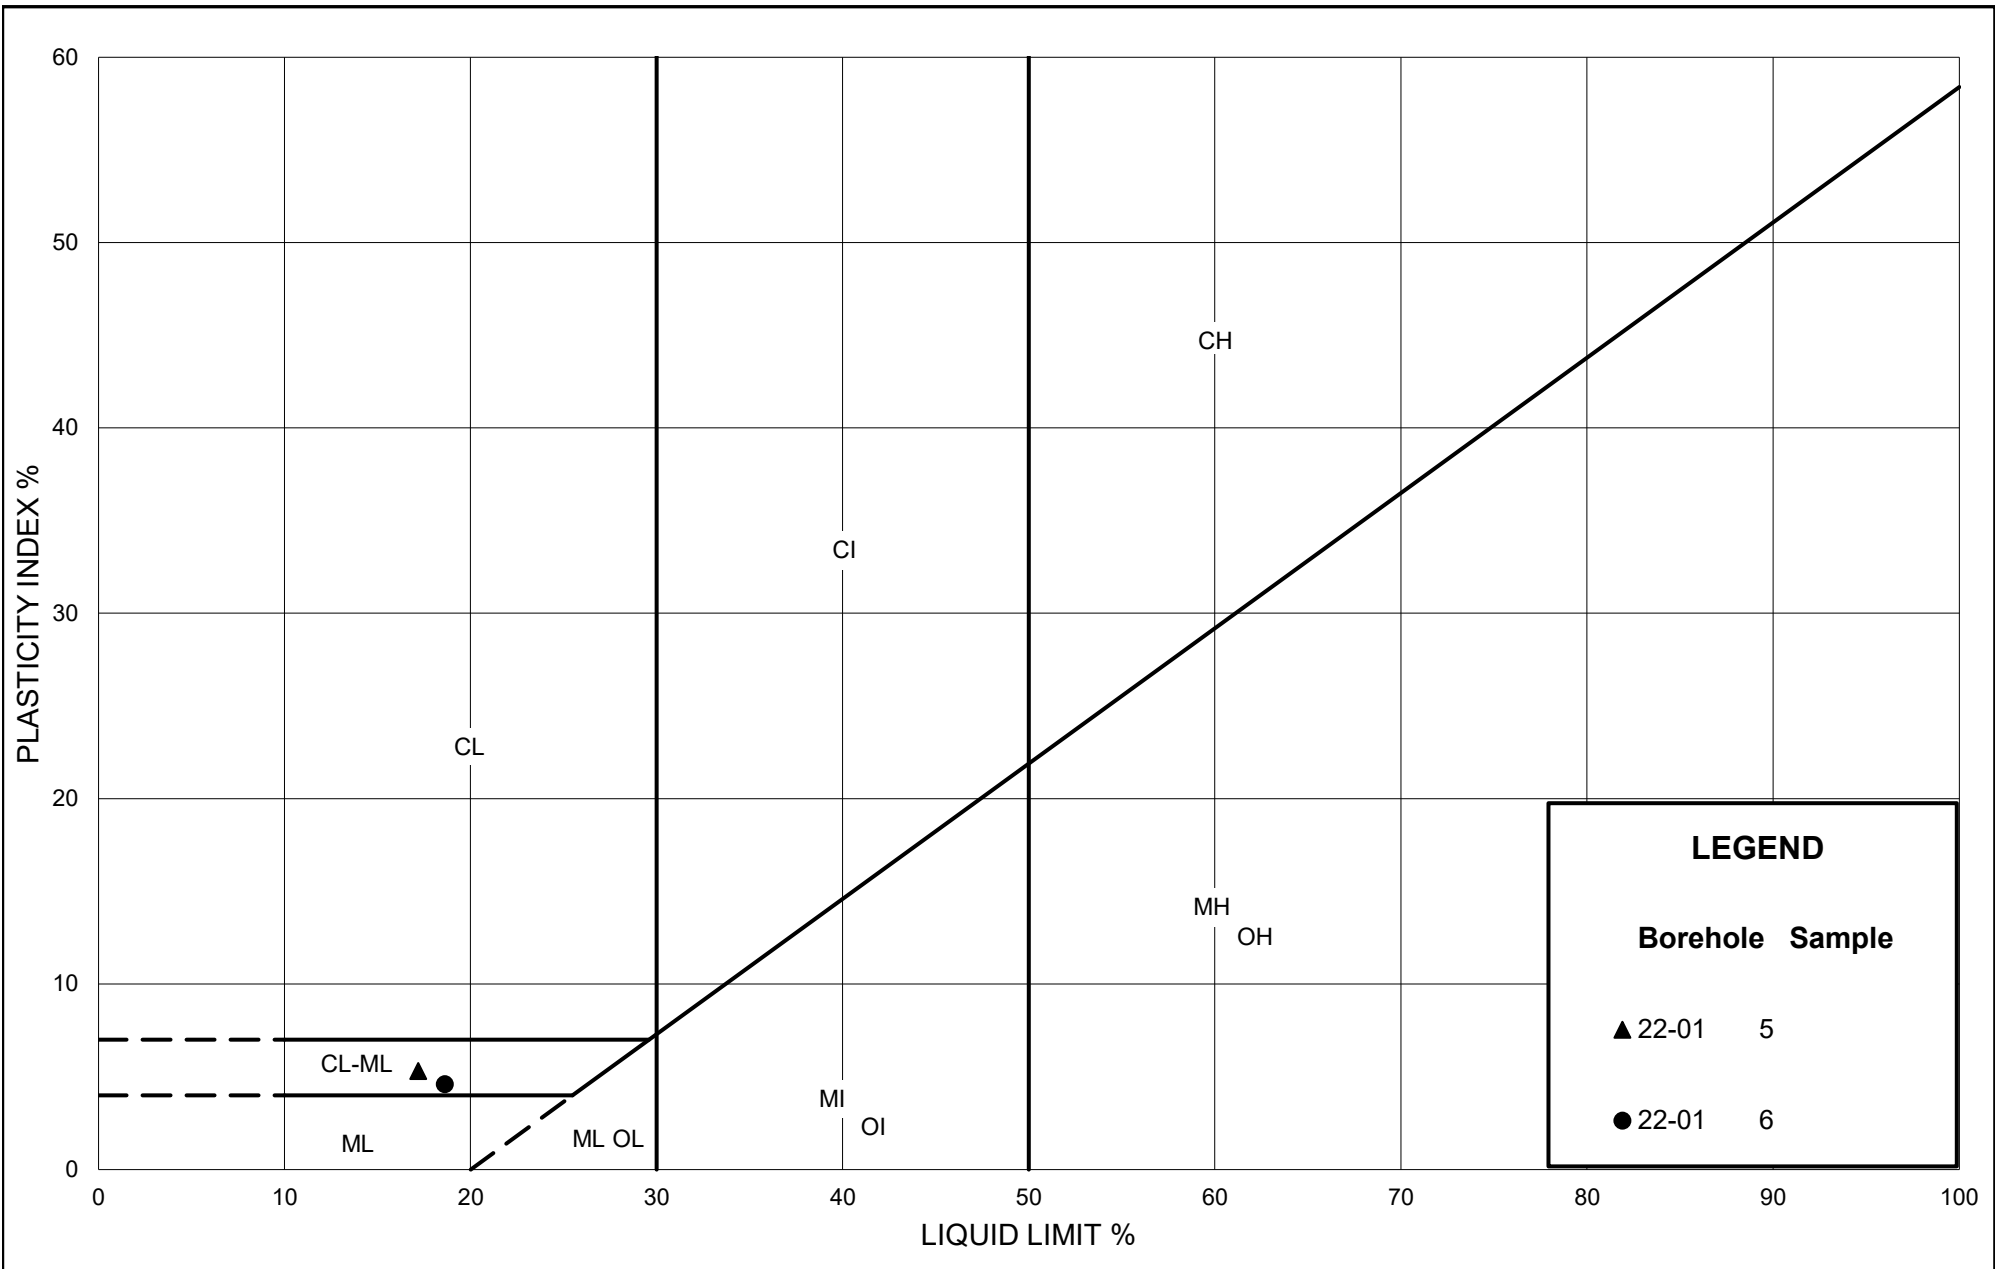

# PLASTICITY CHART GLACIAL TILL

Figure: B-4  
 Project: 22514086EX  
 Created By: MI Checked By: JB

**APPENDIX C**

**Results of Chemical Analysis**



Client: Golder Associates Ltd. (Ottawa)  
1931 Robertson Road  
Ottawa, ON  
K2H 5B7  
Attention: Chaitanya Raj Goyal  
PO#:  
Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1981832  
Date Submitted: 2022-07-18  
Date Reported: 2022-07-26  
Project: 22514086EX  
COC #: 893464

---

**Dear Chaitanya Raj Goyal:**

**Please find attached the analytical results for your samples. If you have any questions regarding this report, please do not hesitate to call (613-727-5692).**

Report Comments:

APPROVAL: \_\_\_\_\_  
Addrine Thomas, Inorganics Supervisor

All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise indicated.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at: <https://directory.cala.ca/>.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is licensed by the Ontario Ministry of the Environment, Conservation, and Parks (MECP) for specific tests in drinking water (license #2318). A copy of the license is available upon request.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by the Ontario Ministry of Agriculture, Food, and Rural Affairs for specific tests in agricultural soils.

Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline values listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official provincial or federal guideline as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

**Certificate of Analysis**

Client: Golder Associates Ltd. (Ottawa)  
 1931 Robertson Road  
 Ottawa, ON  
 K2H 5B7  
 Attention: Chaitanya Raj Goyal  
 PO#:   
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1981832  
 Date Submitted: 2022-07-18  
 Date Reported: 2022-07-26  
 Project: 22514086EX  
 COC #: 893464

Lab I.D. 1638137  
 Sample Matrix Soil  
 Sample Type  
 Sampling Date 2022-07-05  
 Sample I.D. 22-01 Sa3 / 5-7'

Group	Analyte	MRL	Units	Guideline	
Anions	Cl	0.002	%		0.043
	SO4	0.01	%		0.05
General Chemistry	Electrical Conductivity	0.05	mS/cm		0.52
	pH	2.00			7.88
	Resistivity	1	ohm-cm		1920

**Guideline =**                      \* = **Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range



Client: Golder Associates Ltd. (Ottawa)  
 1931 Robertson Road  
 Ottawa, ON  
 K2H 5B7  
 Attention: Chaitanya Raj Goyal  
 PO#:  
 Invoice to: Golder Associates Ltd. (Ottawa)

Report Number: 1981832  
 Date Submitted: 2022-07-18  
 Date Reported: 2022-07-26  
 Project: 22514086EX  
 COC #: 893464

**QC Summary**

Analyte	Blank	QC % Rec	QC Limits
<b>Run No</b> 425856 <b>Analysis/Extraction Date</b> 2022-07-19 <b>Analyst</b> IP <b>Method</b> Cond-Soil			
Electrical Conductivity	<0.05 mS/cm	81	90-110
pH	6.27	101	90-110
Resistivity			
<b>Run No</b> 426022 <b>Analysis/Extraction Date</b> 2022-07-21 <b>Analyst</b> AsA <b>Method</b> C CSA A23.2-4B			
Chloride	<0.002 %		90-110
<b>Run No</b> 426257 <b>Analysis/Extraction Date</b> 2022-07-26 <b>Analyst</b> IP <b>Method</b> AG SOIL			
SO4	<0.01 %	97	70-130

**Guideline =**

**\* = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.  
 Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

**APPENDIX D**

**Golder Associates Technical Memorandum No. 07-1121-0135**

# TECHNICAL MEMORANDUM



Golder Associates Ltd.  
32 Steacie Drive  
Kanata, ON, Canada K2K 2A9

Telephone: 613-592-9600  
Fax Access: 613-592-9601

---

**TO:** Mr. Sean Montgomery  
Project Manager  
Canderel Stoneridge Equity Group Inc.

**DATE:** August 28, 2007

**FROM:** Christopher Phillips, GAL - Mississauga  
Michel St-Louis, GAL - Ottawa  
Michael Snow, GAL - Ottawa

**JOB NO:** 07-1121-0135

**EMAIL:** cphillips@golder.com

**RE:** **SEISMIC STUDY – SITE CLASSIFICATION  
MASW DATA PROCESSING AND RESULTS –  
2700 SWANSEA CRESCENT, OTTAWA, ONTARIO**

---

This memorandum presents the processing and results of the MASW test performed for the proposed warehouse building located at 2700 Swansea Crescent, Ottawa, Ontario for Canderel Management Inc. The MASW survey was performed as part of the geotechnical investigation for the site.

A geotechnical investigation was carried out by Golder Associates in 2002 at 2700 Swansea Crescent.

The information gathered to date on this property (2700 Swansea Crescent) and adjacent lands, suggests that sensitive silty clays extend to depths greater than four (4) metres from the present ground surface. Regional geologic maps indicate bedrock to be of the order of 10 metres deep.

## 1.0 METHODOLOGY

The Multichannel Analysis of Surface Waves (MASW) method measures variations in surface wave velocity with increasing distance and wavelength and can be used to infer the rock/soil types, stratigraphy and soil conditions. A typical MASW survey requires a seismic source, to generate surface-waves, and a minimum of two geophone receivers, to measure the ground response at some distance from the source. Surface waves are a special type of seismic wave



whose propagation is confined to the near surface medium. The depth of penetration of a surface-wave into a medium is directly proportional to its wavelength. In a non-homogeneous medium surface-waves are dispersive, i.e. each wavelength has a characteristic velocity owing to the subsurface heterogeneities within the depth interval that particular wavelength of surface-wave propagates through. The relationship between surface-wave velocity and wavelength is used to obtain the shear-wave velocity and attenuation profile of the medium with increasing depth.

The seismic source used can be either active or passive, depending on the application and location of the survey. Examples of active sources include explosives, weight-drops, and vibrating pads. Examples of passive sources are road traffic, micro-tremors, and water-wave action (in near-shore environments). The geophone receivers measure the wave-train associated with the surface wave travelling from a seismic source at different distances from the source.

The participation of surface-waves with different wavelengths can be determined from the wave-train by transforming the wave-train results into the frequency domain. The surface-wave velocity profile with respect to wavelength (called the 'dispersion curve') is determined by the delay in wave propagation measured between the geophone receivers. The dispersion curve is then matched to a theoretical dispersion curve using an iterative forward-modelling procedure. The result is a shear-wave velocity profile of the tested medium with depth, which can be used to estimate the dynamic shear modulus of the medium as a function of depth.

## **2.0 FIELD WORK**

The MASW field work was conducted on July 19<sup>th</sup>, 2007, by Golder personnel. The approximate location of the MASW test line was approximately 44 meters east of Swansea Crescent, along a line approximately parallel to the road. The MASW test line was oriented in a North-South direction along the approximate centre line of the proposed building footprint.

A series of 22 low frequency (4.5 Hz) geophones were laid out at 2 metre intervals. A seismic gun was used as the seismic source for this investigation. The seismic source location was offset a distance of 30 m from the end and collinear with the geophone array. A total of 3 shots were collected for the MASW line.

## **3.0 DATA PROCESSING**

Processing of the MASW test results consisted of the following main steps:

1. Transformation of the time domain data into the frequency domain using a fast-Fourier transform (FFT) for each source location;
2. Calculation of the phase for each frequency component;

3. Linear regression to calculate phase velocity for each frequency component;
4. Filtering of the calculated phase velocities based on the Pearson correlation coefficient ( $r^2$ ) between the data and the linear regression best fit line used to calculate phase velocity;
5. Generation of the dispersion curve by combining calculated phase velocities for each shot location of a single MASW test; and
6. Generation of the stiffness profile, through forward iterative modelling and matching of model data to the field collected dispersion curve.

Processing of the MASW data was completed using the SeisImager/SW software package (Geometrics Inc.). The calculated phase velocities for each shot point for a given test were combined and the dispersion curve generated by choosing the minimum phase velocity calculated for each frequency component. Shear wave velocity profiles were generated through inverse modelling to best fit the calculated dispersion curves.

The minimum measured surface wave frequency with sufficient signal-to-noise ratio to accurately measure phase velocity was in the range of 9 Hz for the MASW test location.

#### **4.0 RESULTS**

The MASW test results are presented in Table 1, which presents the calculated shear wave velocity profile measured from the field testing, and on Figure 1, which present a graphical representation of the shear wave velocity profile with depth.

The MASW results indicate a near surface layer with a shear wave velocity in the range of 280 meters per second, present to a depth of approximately 7.0 meters below ground surface (mbgs). Velocity increases quickly at a depth of 8.9 mbgs, to approximately 650 m/s, and is relatively consistent to a depth of 30 mbgs.

The field collected dispersion curves are compared with the model generated dispersion curves in Figure 2. There is excellent correlation between the field collected and model calculated dispersion curves, with a root mean squared error of 3.99%.

The MASW results report an average shear wave velocity, calculated from the time taken for the shear wave to travel from surface to a depth of 30 meters, of 470 m/s, which according to the National Building Code of Canada, 2005 (NBCC2005) site classification for seismic site response classifies this site as Site Class C (Very Dense Soil and Soft Rock), which would be appropriate.

## **5.0 CLOSURE**

We trust that these results meet your current needs. If you have any questions or require clarification, please contact Michael Snow at your convenience.

CRP/MSTL/MSS/crp/lb

n:\active\2007\1121 - geotechnical\07-1121-0135 canderel stoneridge\07-1121-0135 tech memo masw results.doc

### **Attachments:**

Table 1 – Shear Wave Velocity Profile


Figure 1 – MASW Shear Wave Velocity Profile

Figure 2 – MASW Field Data and Model Dispersion Curve Comparison

**TABLE 1**  
**Shear Wave Velocity Profile - MASW Test Results**  
**2700 Swansea Crescent**  
**Ottawa, Ontario**


Model Layer (mbgs)		Layer Thickness (m)	Shear Wave Velocity (m/s)	Shear Wave Travel Time Through Layer (s)
Top	Bottom			
0.0	1.1	1.1	253	0.00423
1.1	2.3	1.2	273	0.00452
2.3	3.7	1.4	286	0.00490
3.7	5.3	1.6	280	0.00558
5.3	7.0	1.7	283	0.00613
7.0	8.9	1.9	328	0.00577
8.9	11.0	2.1	530	0.00389
11.0	13.2	2.2	648	0.00343
13.2	15.6	2.4	701	0.00341
15.6	18.1	2.6	734	0.00348
18.1	20.9	2.7	710	0.00383
20.9	23.7	2.9	656	0.00440
23.7	26.8	3.0	602	0.00506
26.8	30.0	3.2	622	0.00517
<b>Vs Average to 30 mbgs (m/s)</b>			<b>470</b>	

**FIGURE 1**  
**Shear Wave Velocity Profile - MASW Test Results**  
**2700 Swansea Crescent**  
**Ottawa, Ontario**

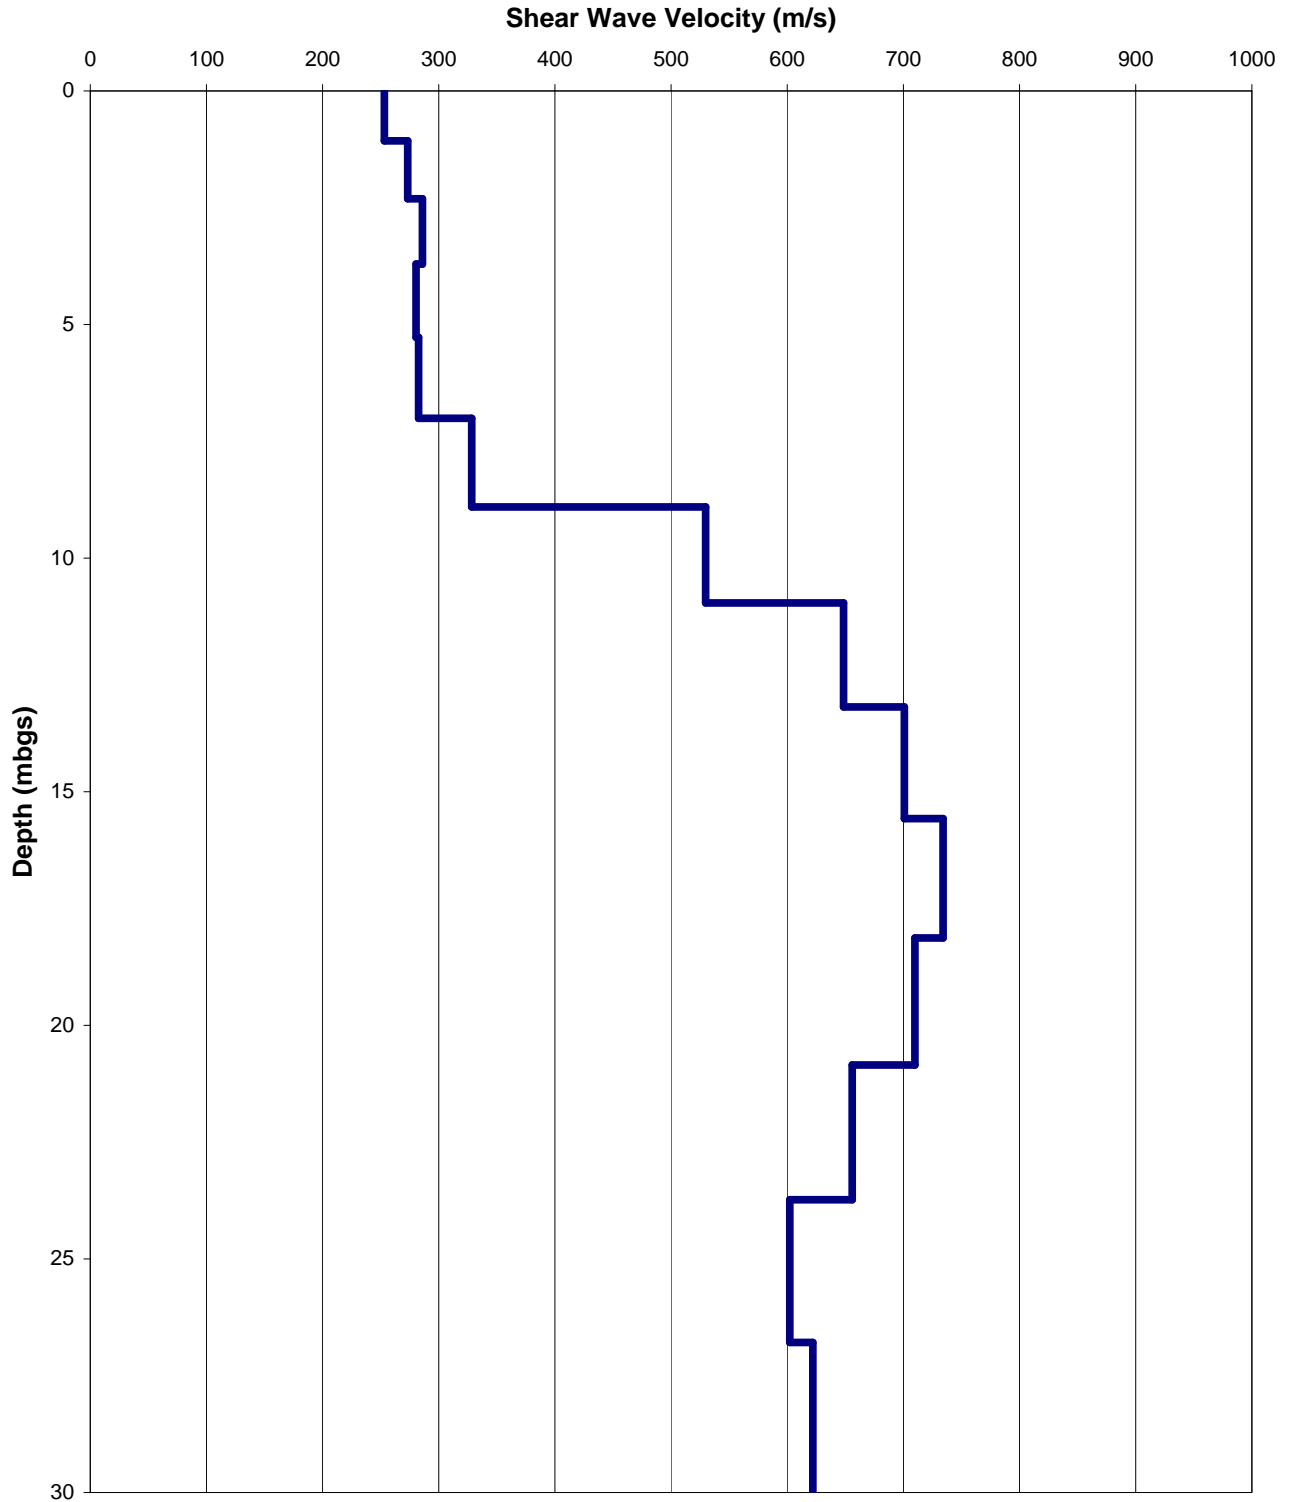



**FIGURE 2**  
**Dispersion Curve Comparison**  
**Field Measured vs. Modelled Results**  
**2700 Swansea Crescent**  
**Ottawa, Ontario**

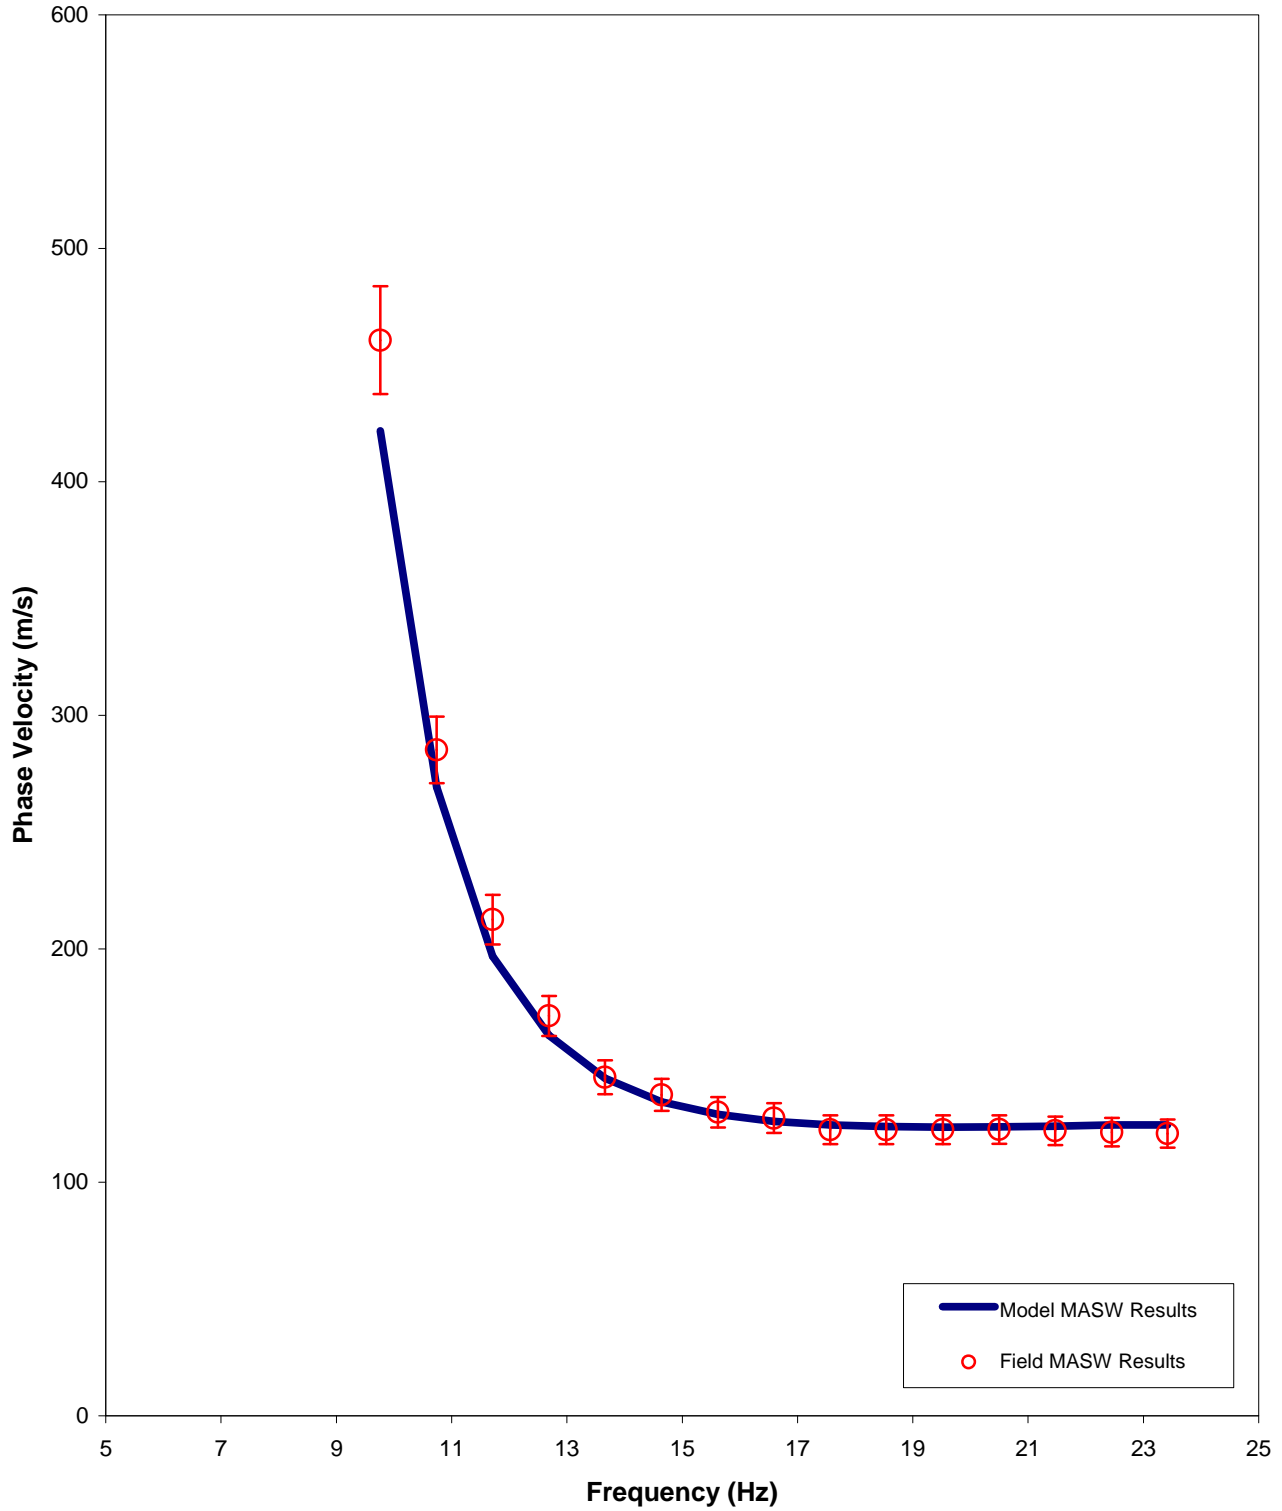



[golder.com](http://golder.com)