



Enhancing our communities



1592 Tenth Line Road, City of Ottawa

SITE SERVICING AND STORMWATER MANAGEMENT REPORT

Bridor Developments

Document Control

File:

522677

Date:

December
21, 2022

Prepared by:

Tatham Engineering Limited
5335 Canotek Road, Unit 103
Ottawa, Ontario K1J 9L4
T 613-747-3636
tathameng.com

Prepared for:

Bridor Developments
996 St-Augustin Road, Unit B
Embrun, Ontario K0A 1W0

Authored by:	Reviewed by:
	
Guillaume M. Courtois, C.E.T. Senior Technologist, Project Manager	Jeremy Ash, B.Sc.Eng., P.Eng. Director, Manager - Ottawa Office

Disclaimer	Copyright
The information contained in this document is solely for the use of the Client identified on the cover sheet for the purpose for which it has been prepared and Tatham Engineering Limited undertakes no duty to or accepts any responsibility to any third party who may rely upon this document.	This document may not be used for any purpose other than that provided in the contract between the Owner/Client and the Engineer nor may any section or element of this document be removed, reproduced, electronically stored or transmitted in any form without the express written consent of Tatham Engineering Limited.

Issue	Date	Description
1	December 19, 2022	Final Report
2	December 21, 2022	Revised Final Report

Document Contents

1	Introduction	1
2	Site Plan.....	2
3	Stormwater Management	3
3.1	Existing Site Condition	3
3.2	Allowable Release Rate	3
3.3	Proposed Stormwater Management	3
3.4	Stormwater Quantity Control.....	4
3.5	Stormwater Quality Control	5
4	Sanitary Service	6
4.1	Existing Site Condition	6
4.2	Proposed Sanitary Service	6
5	Water Supply and Fire Protection	7
5.1	Existing Site Condition	7
5.2	Proposed Domestic Water Service	7
5.3	Fire Protection	7
6	Erosion and Sediment Control.....	9
7	Summary.....	10
7.1	Stormwater Management.....	10
7.2	Sanitary Service	10
7.3	Water Service	10



Tables

Table 1: Domestic Water Demands	7
Table 2: Hydrants Required for Fire Flow	8

Figures

Figure 1: Existing Site Location	2
--	---

Appendices

Appendix A: Stormwater Management Calculations
Appendix B: Sanitary Service Calculations
Appendix C: Water Supply and Fire Protection Calculations
Appendix D: Stormwater Treatment Unit
Appendix E: Boundary Conditions
Appendix F: Engineering Drawings
Appendix G: BL Engineering Site Servicing and SWM Report (June 14, 2022)



1 Introduction

Blanchard Letendre Engineering Ltd. (BL Engineering) was originally retained by Bridor Developments (Bridor) to complete site servicing and stormwater management designs for the proposed site development located at 1592 Tenth Line Road in Ottawa. In November 2022, Tatham Engineering Limited (Tatham) was retained by Bridor to replace BL Engineering as the Engineer of Record for the project moving forward. The revisions made to this report, and the enclosed detailed engineering design drawings, have been completed to address the City's engineering comments dated September 26, 2022.

We note that the underground storage chambers that were previously proposed have been replaced with an oversized storm pipe system to minimize the risk of water damage to the underground parking garage foundation and/or flooding of the underground parking garage. BL Engineering's original Site Servicing and SWM Report, dated June 14, 2022, is provided in Appendix G for reference.


This report and detailed engineering drawings have been prepared based on the Site Plan prepared by P-Square Concepts and the site survey completed by Arpentage Dutrisac Surveying Inc.



2 Site Plan

The site is located at 1592 Tenth Line Road in Ottawa and is bounded by residential properties to the north and south, Phoenix Crescent to the west, and Tenth Line Road to the east. As per the aerial photo in Figure 1 below, the existing 0.15 ha site consists of an existing residential dwelling, green space, a paved driveway access onto Tenth Line Road and a gravel driveway access onto Phoenix Crescent. The existing dwelling is proposed to be demolished prior to construction. The land will be developed with two new residential apartment buildings and a shared underground parking garage.

Figure 1: Existing Site Location

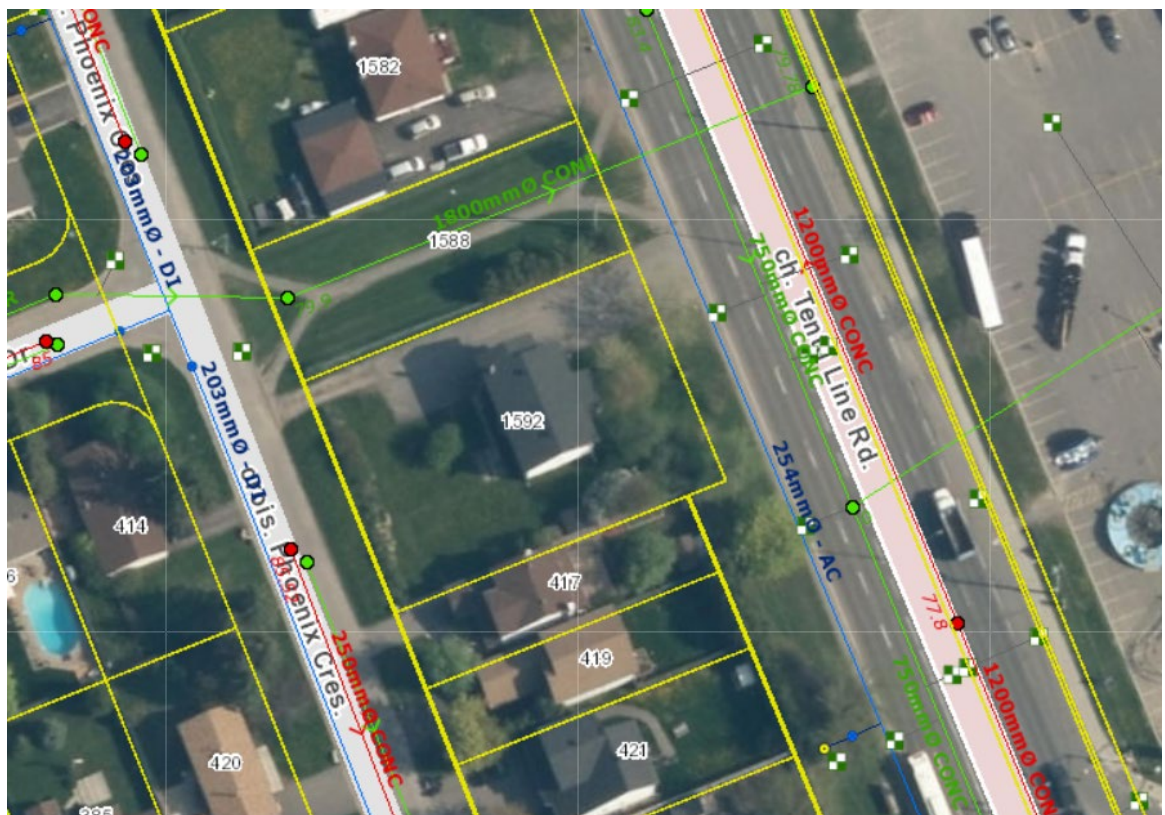

3 Stormwater Management

3.1 EXISTING SITE CONDITION

In the existing condition, the site is generally flat with the majority of runoff draining from east to west to Phoenix Crescent eventually being captured by the existing roadside catchbasins. Refer to Drawing C400 for the pre-development drainage plan.

3.2 ALLOWABLE RELEASE RATE

The allowable release rate for the site, which is based on the 5-year storm pre-development peak flow rate, was calculated using the Rational Method. In accordance with City of Ottawa guidelines, a runoff coefficient (C) of 0.5, a minimum time of concentration of 10 minutes, and a rainfall intensity of 104.2 mm/hr were used. The allowable release rate was calculated to be 21.5 L/s. See below and refer to stormwater management calculations in Appendix A.

Allowable Release Rate (Q)= 2.78CIA (L/s)

$$I_s = 998.071 / (T_c + 6.053)^{0.814}$$

$$C = 0.50$$

$$I = 104.2 \text{ mm/hr}$$

$$A = 0.15 \text{ ha}$$

$$T_c = 10 \text{ min}$$

Allowable Release Rate (Q)= 21.5 L/s

3.3 PROPOSED STORMWATER MANAGEMENT

The proposed development consists of two new residential apartment buildings (Block A, 314 m² comprising 15 units and Block B, 250 m² comprising of 12 units), and hard and softscape areas. One underground parking garage, with access to Tenth Line Road, will be shared by both apartment buildings. Since the runoff coefficient will increase in the proposed condition, due to an increase in imperviousness, post-development stormwater quantity control will be implemented. Water quality control is also required.

The stormwater management design has been developed with consideration for the existing site topography and the proposed underground parking garage. The proposed stormwater



management plan will discharge site runoff to the existing 300 mm diameter concrete storm sewer on Phoenix Crescent. The proposed site grading has been designed to convey emergency overland flows toward the existing catchbasins located within the City rights-of-way on Tenth Line Road and Phoenix Crescent.

Runoff generated within the proposed development will be directed to and captured by a series of on-site drainage structures and will be conveyed to the existing municipal system via a proposed internal storm sewer system. The post-development catchment areas have been delineated according to the proposed grading plan. In order to attenuate post-development peak flow rates to the allowable release rate, runoff will be controlled by an orifice plate flow control installed in STM MHCB01, which will restrict the flow rate that is discharged into the municipal storm sewer on Phoenix Crescent. By restricting flow, onsite stormwater detention will be provided via underground pipe/structure storage which has been designed to attenuate the post-development peak flow rate from the 100-year storm event to the allowable release rate.

3.4 STORMWATER QUANTITY CONTROL

Stormwater quantity control for the proposed development will be achieved via underground pipe/structure storage. Since the underground parking garage will occupy a major portion of the site area, a section of the proposed storm pipe will pass through the underground parking garage along the inside of the north underground parking garage foundation wall and between the residential buildings. The storm sewer within the building structure will be coordinated with the mechanical engineer at the building permit stage.

The proposed grading for the site has been designed to capture surface runoff in a series of drainage structures connected to storm sewer pipes and a control structure. Runoff is proposed to discharge from the control structure into the 300mm diameter municipal storm sewer on Phoenix Crescent. The proposed grading and storm servicing designs are shown on the attached drawings in Appendix F.

Runoff generated from the site will be controlled within the internal storm sewers and storm structures via a 64 mm diameter steel orifice plate bolted to the outlet of STM MHCB01, which will restrict flow directed to the municipal storm sewer on Phoenix Crescent. The proposed orifice plate will release a total of 15.0 L/s with a maximum head of 1.67 m (HWL = 87.04) during the 100-year storm event. Approximately 26 m³ of stormwater storage is required for the site whereas the proposed internal storm sewer system provides 27 m³ of storage.

Uncontrolled runoff from the underground parking ramp (Catchment WS-07) will be captured by a trench drain located at the bottom of the ramp and conveyed to the foundation drain of the building which discharges directly into the water quality treatment unit (downstream of the



orifice plate flow control). Details related to the underground parking garage and ramp drainage will be coordinated with the mechanical engineer and submitted with the building permit application.

Detailed stormwater management calculations are attached in Appendix A.

3.4.1 Roof Drainage

The proposed building roofs are flat. Roof drains (one for each building) are proposed to be directly connected to the internal storm sewer system as shown on Drawing C300. Scuppers to provide emergency spill outs from the roof areas, are proposed to discharge runoff onto grass areas. All runoff from the roofs will be controlled by the orifice plate in STM CBMH01.

3.5 STORMWATER QUALITY CONTROL

A water quality control requirement of 80% TSS removal is required by the City of Ottawa. To meet this requirement, a stormwater treatment unit will be installed at the downstream end of the internal storm system. Using the Stormceptor sizing software, the EFO4 was selected. The software generated report has been attached in Appendix D.



4 Sanitary Service

4.1 EXISTING SITE CONDITION

The existing site is serviced by an existing 135mm diameter service that is connected to the existing 1200 mm diameter concrete sanitary sewer on Tenth Line Road. The existing 135mm diameter service to Tenth Line Road will be abandoned.

4.2 PROPOSED SANITARY SERVICE

One new 200 mm diameter PVC sanitary service, located west of Block A, will discharge sewage flows from the proposed development into an existing sanitary maintenance hole on Phoenix Crescent, which will convey flows southward via an existing 250 mm diameter concrete sanitary sewer. The proposed 200mm diameter service will have a minimum slope of 1.0% in accordance with City guidelines. A monitoring maintenance hole (SAN MHA) is proposed for the new connection and will be installed approximately on the property line. Refer to Drawing C300 for the proposed sanitary service details.

The combined sanitary peak flow was calculated to be approximately 1.3 L/s, based on the following City of Ottawa sanitary design parameters:

- Domestic sewage flow of 350 L/c/day;
- Peak extraneous flow of 0.28 L/s/ha;
- Peaking factor (Harmon) of 4.0; and

Refer to Appendix B for the detailed sanitary flow calculations.



5 Water Supply and Fire Protection

5.1 EXISTING SITE CONDITION

The existing dwelling is serviced by a 19 mm diameter water service connected to the existing 254 mm diameter watermain on Tenth Line Road. The existing connection will be abandoned and capped at the watermain.

There are three existing municipal fire hydrants within 90 metres of the proposed buildings; one on the west side of Tenth Line Road (southeast of the site), one on the west side of Phoenix Crescent (northwest of the site), and one on Vince Drive (southwest of the site).

5.2 PROPOSED DOMESTIC WATER SERVICE

One new water connection is proposed to service the new buildings and will be connected to the existing 203 mm diameter ductile iron on Phoenix Crescent. Refer to Drawing C300 - Site Servicing Plan for the proposed water service details.

The new water service was sized based on the City of Ottawa Design Guidelines. The average water demand per person of 350 L/c/d was applied to the estimated population of each building. The daily and hourly peaking factors of 2.5 and 2.2 respectively were applied as stated in the City of Ottawa guidelines. The combined water demands for the new buildings are summarized in Table 1.

Table 1: Domestic Water Demands

	BLOCK A + B	UNITS
Average Water Demand	13,230	L/d
Maximum Daily	33,075	L/d
Maximum Hourly	72,765	L/d

Based on the above, the proposed development will be serviced with a 75 mm diameter PE water service, connected to the 203 mm diameter ductile iron watermain on Phoenix Crescent. Refer to Appendix C for the water demand and water service sizing calculations.

5.3 FIRE PROTECTION

The required fire flow rate was calculated in accordance with the 1999 Fire Underwriters Survey (FUS). This method is based on the floor area of the building to be protected, type and



combustibility of the structural frame and the separation distances with adjoining buildings. The required fire flow rate is 7,000 L/min. Refer to Appendix C for the fire flow calculations.

Each building is located within 90 m of a hydrant and therefore are compliant with OBC requirements. Fire flow protection will be provided by the following three hydrants, which are within 150 m (uninterrupted path) of the proposed buildings:

- One existing Class AA blue bonnet hydrant located no further than 70 m from the proposed buildings (70 m southeast of Block A and 55 m southeast of Block B) on the west side of Tenth Line Road;
- One existing Class AA blue bonnet hydrant located no further than 80 m from the proposed buildings (65 m northwest of Block A and 80 m northwest of Block B) on the west side of Phoenix Crescent; and
- One proposed Class AA blue bonnet hydrant located no further than 85 m from the proposed buildings (15 m southwest of Block A and 85 m southwest of Block B) on the south side of Vince Drive.

All fire hydrant bonnets are color coded to indicate the available flow at a residual pressure of 150 kPa (20 psi), in accordance with the NFPA 291 Fire Flow Testing and Marking of Hydrants Code. The three existing hydrants near the site consist of blue bonnet hydrants, and as such are Class AA-rated hydrants. As is summarized in Table 2, the required 7,000 L/min fire flow to the proposed buildings is available from the three existing hydrants.

Table 2: Hydrants Required for Fire Flow

HYDRANT CLASS	DISTANCE TO BUILDING (m) ¹	CONTRIBUTION TO REQUIRED FIRE FLOW (L/min)	NUMBER OF USABLE NEARBY HYDRANTS	MAXIMUM FLOW TO BE CONSIDERED (L/min)	CUMULATIVE MAXIMUM FLOW TO BE CONSIDERED (L/min)
AA	≤ 75	5,700	1	5,700	13,300
AA	> 75 & ≤ 150	3,800	2	7,600	

Notes: 1. Distance of contributing hydrant from the structure, measured in accordance with NFPA 1.

A hydrant flow test is recommended to verify the available fire flow, pressure and overall fire protection.



6 Erosion and Sediment Control

During construction, sediment and erosion controls will be implemented around the site to reduce the potential for any sediment mobilizing off site. The construction and maintenance of erosion and sediment controls must comply with the Ontario Provision Standard Specification OPSS 577. Refer to Drawing C100 – Erosion and Sediment Control for additional details.



7 Summary

7.1 STORMWATER MANAGEMENT

The stormwater management design for the site will reduce the 100-year post-development peak flow from the site to the allowable 5-year pre-development peak flow rate, thereby meeting the City's requirements. The post-development release rate from the controlled portion of the site will be restricted by an orifice plate flow control located in STM CBMH01. The combined 100-year post-development controlled, and uncontrolled peak flow will be reduced below the allowable 5-year pre-development peak flow rate prior to discharging into the existing 300 mm diameter concrete storm sewer on Phoenix Crescent. Stormwater quantity control will be achieved with 27.0 m³ of underground pipe/structure storage. The stormwater quality control will be met through the use of a Stormceptor EFO4 stormwater quality treatment unit.

7.2 SANITARY SERVICE

The estimated combined sanitary peak flow for the site is approximately 1.3 L/s. The proposed development will be serviced via a new 200 mm diameter PVC sanitary service connecting into an existing sanitary maintenance hole on Phoenix Crescent, which will convey flows southward via an existing 250 mm diameter concrete sanitary sewer.

7.3 WATER SERVICE

The proposed development will be serviced via a new 75 mm diameter PE water service to be connected to the existing 203 mm diameter ductile iron watermain on Phoenix Crescent. The combined Block A and B water demands resulted in an average water demand of 13,230 L/d, a maximum daily demand of 33,075 L/d, and a peak hourly demand of 72,765 L/d. The required fire flow rate is 7,000 L/min. A sprinkler system is not proposed for the site. There are three fire hydrants surrounding the site that will provide adequate fire protection.



Appendix A: Stormwater Management Calculations

File No.	522677	Date:	December 19, 2022
Project:	1592 Tenth Line Road, Ottawa	Designed:	HY
Project Address:	1592 Tenth Line Road, Ottawa	Checked:	GC
Client:	Bridor Development	Drawing Reference:	C300

PRE-DEVELOPMENT DRAINAGE AREA

Catchment Area	Runoff Coefficient			Total Area (ha)	Combined C
	C = 0.30	C = 0.80	C = 0.90		
ES-01	0.092	0.000	0.056	0.149	0.53
TOTAL	0.092	0.000	0.056	0.149	0.53

POST-DEVELOPMENT DRAINAGE AREA

Catchment Area	Runoff Coefficient			Total Area (ha)	Combined C
	C = 0.20	C = 0.80	C = 0.90		
WS-01 - ROOF A	0.000	0.000	0.034	0.034	0.90
WS-02 - ROOF B	0.000	0.000	0.028	0.028	0.90
WS-03	0.009	0.000	0.007	0.016	0.51
WS-04	0.006	0.000	0.003	0.009	0.43
WS-05	0.008	0.000	0.015	0.023	0.66
WS-06	0.008	0.000	0.006	0.014	0.50
WS-07	0.001	0.000	0.012	0.013	0.85
WS-08	0.008	0.000	0.005	0.013	0.47
TOTAL	0.040	0.000	0.109	0.149	0.71

RUNOFF COEFFICIENT (C)

Grass	0.20
Gravel	0.80
Asphalt / rooftop	0.90

File No.	522677	Date:	December 19, 2022
Project:	1592 Tenth Line Road, Ottawa	Designed:	HY
Project Address:	1592 Tenth Line Road, Ottawa	Checked:	GC
Client:	Bridor Development	Drawing Reference:	C300

STORM WATER MANAGEMENT DESIGN SHEET
5 YEAR STORM EVENT

PRE-DEVELOPMENT STORMATER MANAGEMENT

Runoff	Catchment Area	Area			ΣR ₅
Un-Controlled	ES-01	0.149	ha	R=	0.53
	Total Uncontrolled =	0.149	ha	ΣR=	0.53

PRE-DEVELOPMENT ALLOWABLE RELEASE RATE

$$Q = 2.78CIA \text{ (L/s)}$$

$$I_5 = 998.071 / (T_c + 6.053)^{0.814}$$

C =	0.50	up to a maximum of 0.5 as per City of Ottawa Sewer Design Guidelines
I =	104.2	mm/hr
T _c =	10	min
Total =	0.149	ha
Allowable Release Rate=	21.52	L/s

POST-DEVELOPMENT STORMATER MANAGEMENT

Runoff	Catchment Area	Area			ΣR ₅	ΣR ₁₀₀
Controlled	WS-01	0.034	ha	R=	0.90	1.00
	WS-02	0.028	ha	R=	0.90	1.00
	WS-03	0.016	ha	R=	0.51	0.63
	WS-04	0.009	ha	R=	0.43	0.54
	WS-05	0.023	ha	R=	0.66	0.82
	WS-06	0.014	ha	R=	0.50	0.63
	WS-08	0.013	ha	R=	0.47	0.59
	Total Contolled =	0.136	ha	ΣR=	0.70	0.82
	WS-07	0.013	ha	R=	0.85	1.00
	Total Un-Controlled =	0.013	ha	ΣR=	0.85	1.00

$$I_5 = 998.071 / (T_d + 6.053)^{0.814}$$

		REQUIRED STORAGE				
Time (min)	Intensity (mm/hr)	Controlled Runoff (L/s)	Storage Volume (m3)	Controlled Release Rate (L/s)	Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
10	104.2	27.55	7.49	15.07	3.19	18.25
15	83.6	22.09	6.32	15.07	2.56	17.62
20	70.3	18.57	4.21	15.07	2.15	17.22
25	60.9	16.10	1.55	15.07	1.86	16.93
30	53.9	14.26	0.00	15.07	1.65	16.72
35	48.5	12.83	0.00	15.07	1.48	16.55
40	44.2	11.68	0.00	15.07	1.35	16.42
50	37.7	9.95	0.00	15.07	1.15	16.22
60	32.9	8.71	0.00	15.07	1.01	16.08
80	26.6	7.02	0.00	15.07	0.81	15.88
90	24.3	6.42	0.00	15.07	0.74	15.81

STORMATER STORAGE REQUIREMENTS

Total Storage Required =	7.49 m³	
Pipe Storage =	16.98 m ³	Refer to Storm Sewer Design Sheet
CB/MH Storage =	10.00 m ³	Refer to Storm Sewer Design Sheet
Total Available Storage =	26.98 m³	

STORM WATER MANAGEMENT DESIGN SHEET
100 YEAR STORM EVENT

Runoff	Catchment Area	Area		ΣR_s
Un-Controlled	EWS-01	0.149	ha	R= 0.53
	Total Uncontrolled =	0.149	ha	$\Sigma R= 0.53$

$$Q = 2.78CIA \text{ (L/s)}$$

$$I_s = 998.071 / (T_c + 6.053)^{0.814}$$

C =	0.50	up to a maximum of 0.5 as per City of Ottawa Sewer Design Guidelines
I =	104.2	mm/hr
Tc =	10	min
total =	0.149	ha
Rate =	21.52	L/s

Runoff	Catchment Area	Area			ΣR_5	ΣR_{100}
Controlled	WS-01	0.034	ha	R=	0.90	1.00
	WS-02	0.028	ha	R=	0.90	1.00
	WS-03	0.016	ha	R=	0.51	0.63
	WS-04	0.009	ha	R=	0.43	0.54
	WS-05	0.023	ha	R=	0.66	0.82
	WS-06	0.014	ha	R=	0.50	0.63
	WS-08	0.013	ha	R=	0.47	0.59
	Total Controlled =	0.136	ha	ΣR=	0.70	0.82
UN-Controlled	WS-07	0.013	ha	R=	0.85	1.00
	Total Un-Controlled =	0.013	ha	ΣR=	0.85	1.00

$$I_{100} = 1735.688 / (Td + 6.014)^{0.820}$$

Time (min)	Intensity (mm/hr)	REQUIRED STORAGE			Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
		Controlled Runoff** (L/s)	Storage Volume (m ³)	Controlled Release Rate (L/s)		
10	178.6	55.22	24.09	15.07	6.45	21.52
15	142.9	44.19	26.21	15.07	5.16	20.23
20	120.0	37.10	26.44	15.07	4.34	19.40
25	103.8	32.12	25.57	15.07	3.75	18.82
30	91.9	28.41	24.02	15.07	3.32	18.39
35	82.6	25.54	21.99	15.07	2.98	18.05
40	75.1	23.24	19.61	15.07	2.72	17.78
50	64.0	19.78	14.13	15.07	2.31	17.38
60	55.9	17.29	7.99	15.07	2.02	17.09
70	49.8	15.40	1.39	15.07	1.80	16.87
90	41.1	12.71	0.00	15.07	1.49	16.55
100	37.9	11.72	0.00	15.07	1.37	16.44
110	35.2	10.89	0.00	15.07	1.27	16.34
120	32.9	10.17	0.00	15.07	1.19	16.26

Total Storage Required =	26.44 m³	
Pipe Storage =	16.98 m ³	Refer to Storm Sewer Design Sheet
CB/MH Storage =	10.00 m ³	Refer to Storm Sewer Design Sheet
Total Available Storage =	26.98 m³	

Product: Orifice Plate		at MHCB 01	
Invert Level =	85.37	masl.	
HWL =	1.67	m	from inv.
HWL =	87.04	masl.	
Orifice Dia. =	64	mm	
Orifice Invert =	85.37	masl.	
Orifice Area =	0.0032	m2	
Flow Control Centerline =	85.40	masl.	
HWL Head =	1.67	m	from centerline
C =	0.82		
Controlled Release =	15.05	L/s	

STORM WATER MANAGEMENT DESIGN SHEET

SEWER DESIGN

LOCATION			AREA (ha)			FLOW					STORM SEWER DATA							
WATERSHED / STREET	From	To	C = 0.20	C = 0.80	C = 0.90	Indiv. 2.78AC	Accum. 2.78AC	Time of Conc. (min.)	Rainfall Intensity (mm/hr)	Peak Flow Q (l/s)	Pipe Diameter (mm)	Type	Slope (%)	Length (m)	Capacity Full (L/s)	Velocity Full (m/s)	Time of Flow (min.)	Ratio (Q/Q _{FULL})
WS-02	Roof B	CBMH04	0.000	0.000	0.028	0.07	0.07	10.00	104.19	7.17	250	PVC	0.50%	3.3	42.0	0.86	0.06	0.17
WS-06	CBMH04	CBMH03	0.008	0.000	0.006	0.02	0.09	10.00	104.19	9.20	750	PVC	0.50%	19.0	787.2	1.78	0.18	0.01
WS-04	AD01	AD02	0.006	0.000	0.003	0.01	0.01	10.00	104.19	1.13	250	PVC	0.50%	14.2	42.0	0.86	0.28	0.03
WS-08	AD02	AD03	0.008	0.000	0.005	0.02	0.03	10.28	102.76	2.86	250	PVC	0.50%	14.0	42.0	0.86	0.27	0.07
WS-03	AD03	CBMH03	0.009	0.000	0.007	0.02	0.05	10.55	101.38	5.10	250	PVC	0.50%	2.5	42.0	0.86	0.05	0.12
	CBMH03	CBMH02	0.000	0.000	0.000	0.00	0.14	10.60	101.14	14.02	250	PVC	0.50%	44.4	42.0	0.86	0.86	0.33
WS-01	Roof A	CBMH01	0.000	0.000	0.034	0.08	0.08	10.00	104.19	8.73	250	PVC	5.00%	1.5	133.0	2.71	0.01	0.07
WS-05	CBMH02	CBMH01	0.008	0.000	0.015	0.04	0.18	11.46	97.06	17.53	750	PVC	0.50%	14.5	787.2	1.78	0.14	0.02
	CBMH01	OGS	0.000	0.000	0.000	0.00	0.26	11.60	96.45	25.50	250	PVC	0.50%	6.3	42.0	0.86	0.12	0.61
WS-07	Foundation Drain	OGS	0.000	0.000	0.013	0.03	0.03	10.00	104.19	3.39	150	PVC	5.00%	1.0	34.1	1.93	0.01	0.10
	OGS	Ex. STM MH	0.000	0.000	0.000	0.00	0.30	11.72	95.91	28.48	250	PVC	0.50%	9.3	42.0	0.86	0.18	0.68

DESIGN PARAMETERS NOTES

Runoff Coefficient (C)		Q = 2.78 AIC, where Q = Peak flow in Litres per second (L/s)	Ottawa Macdonald-Cartier International Airport IDF curve
Grass	0.2	A = Area in hectares (ha)	$I_5 = 998.071 / (T_c + 6.053)^{0.814}$
Gravel	0.80	I = Rainfall Intensity (mm/hr)	Min. velocity = 0.76 m/s
Asphalt / rooftop	0.90	C = Runoff Coefficient	Manning's "n" = 0.013

LOCATION		MANHOLE INFORMATION							AVAILABLE STORAGE				
From MH	To MH	U/S Invert (m)	D/S Invert (m)	T/G U/S (m)	T/G D/S	U/S Depth @ Obv. (m)	D/S Depth @ Obv. (m)	U/S Depth @ Inv. (m)	Pipe Storage 100-year (m ³)	U/S MH Dia. (m)	Water Depth 100 year (m)	MH Storage 100 year (m ³)	
CBMH04	CBMH03	85.88	85.78	88.10	88.10	1.47	1.57	2.22	8.39	1.50	1.16	2.05	
CBMH03	CBMH02	85.75	85.53	88.10	88.00	2.10	2.22	2.35	2.18	1.50	1.29	2.28	
CBMH02	CBMH01	85.47	85.40	88.00	88.10	1.78	1.95	2.53	6.41	1.50	1.57	2.77	
CBMH01										1.50	1.64	2.90	
									16.98				10.00
										HWL (100 Year)		87.04	
										TOTAL STORAGE - 100 YEAR		26.98	

Appendix B: Sanitary Service Calculations

SANITARY DESIGN SHEET

SEWER DESIGN

LOCATION			RESIDENTIAL AREA AND POPULATION						COMMERCIAL		INDUSTRIAL			INSTITUTIONAL		C+I+I	INFILTRATION			TOTAL FLOW (l/s)	PIPE						MANHOLE	
STREET	FROM MH	TO MH	AREA (Ha)	POP.	CUMMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (Ha)	ACCU. AREA (Ha)	AREA (Ha)	ACCU. AREA (Ha)	PEAK FACT.	AREA (Ha)	ACCU. AREA (Ha)	PEAK FLOW (l/s)	TOTAL AREA (Ha)	ACCU. AREA (Ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	LENGTH (m)	DIA. (mm)	MATERAIL	SLOPE (%)	CAP. (FULL) (l/s)	VEL. (FULL) (m/s)	UP INVERT (m)	DOWN INVERT (m)
SITE	BLOCK A & B	SAN MHA	0.149	37.8	0.15	37.8	4.0	0.61	0.000	0.000	0.00	0.00	7.0	0.0	0.0	0.61	0.149	0.149	0.04	1.27	2.5	200	PVC	0.8%	29.34	0.93	86.11	86.09
	SAN MHA	Ex. San MH	0.000	37.8	0.00	0.0	0.0	0.00	0.000	0.000	0.00	0.00	7.0	0.0	0.0	0.00	0.000	0.149	0.04	1.27	9.8	200	PVC	3.7%	62.86	2.00	86.03	85.67

DESIGN PARAMETERS NOTES

Average Daily Flow =

Commercial and Institutional Flow =

Industrial Flow =

Maximum Residential Peak Factor =

Commercial and Intitutional Peak Factor =

350 L/c/day

50000 L/ha/da

35000 L/ha/da

4

1.5

Industrial Peak Factor =

Extraneous Flow =

Minimum Velocity =

Mannings n =

7 as per City Appendix 4-B

0.28 L/s/ha

0.76 m/s

0.013

Appartments:	Person Per Unit	Appartment	Total
Bachelor =	1.4	0	0
1 Bedroom =	1.4	27	37.8
2 Bedroom =	2.1	0	0
3 Bedroom =	3.1	0	0

Appendix C: Water Supply and Fire Protection Calculations

File No.	522677	Date:	December 5, 2022
Project:	1592 Tenth Line Road, Ottawa	Designed:	GC
Project Address:	1592 Tenth Line Road, Ottawa	Checked:	JA
Client:	Bridor Development	Drawing Reference:	

WATER DEMAND CALCULATION

Total Population =	37.8	ea.
Average Demand Per People =	350	L/c/d
Average Water Demand =	13230.00	L/d
Maximum Daily Peak Factor =	2.5	* As per City of Ottawa
Maximum Daily =	33075.00	L/d
Maximum Hourly Peak Factor =	2.2	* As per City of Ottawa
Maximum Hourly =	72765.00	L/d

	Unit Counts	WSFU	Total
Unrinal Flush Tank	27	2	54
Sinks	54	1	54
Bathub	27	4	108
Diswasher	27	1.5	40.5
Washing Machine	27	2	54
Total			310.5

Appartments:	Person Per Unit	Appartment	Total
Bachelor =	1.4	0	0
1 Bedroom =	1.4	27	37.8
2 Bedroom =	2.1	0	0
3 Bedroom =	3.1	0	0
Total			37.8



Water Service Sizing Calculations

Tatham File No. : 522677
Project : 1592 Tenth Line Road
Date : December 14, 2022
Designed by : GC
Reviewed by : JA

Required Water Service Capacity (OBC Fixture Method)

Total fixture units: 311 (as per OBC Table 7.6.3.2.A)
Conversion of fixture units to equivalent gpm (peak flow): 87.20 gpm (as per PS&D Table 13-4)
Peak hour demand = 475,326 L/d (assumes all fixtures are 'ON' at the same time)
= 5.50 L/s

Water Service Sizing

$Q = VA$ Where: V = Design velocity of 1.5m/s x 3600 = 5400m/h (as per OBC guidelines)
 A = area of pipe = $(\pi/4) \times D^2$
 Q = water supply flow rate to be accounted for in m^3/h (peak hour demand)

Minimum pipe diameter: $d = (4Q/\pi V)^{1/2}$ (derived from $Q = VA$ formula)
 $d = 0.068$ m
 $d = 68$ mm

Proposed pipe diameter: 75 mm

Water Pressure Calculations

Tatham File No. : 522677
Project : 1592 Tenth Line Road
Date : December 14, 2022
Designed by : GC
Reviewed by : JA

Piezometric Head Equation (Derived from Bernoulli's Equation)

$$h = \frac{p}{\gamma} + z$$

Where:

h = HGL (m)

p = Pressure (Pa)

γ = Specific weight (N/m³) =

9810

z = Elevation of centreline of pipe (m) =

85.19

Water Pressure at Phoenix Crescent Connection			
HGL (m)		Pressure	
		kPa	psi
Max Day	130.2	441.55	64.04
Peak Hour	125.7	397.40	57.64
Max. Day + Fire =	115.9	301.27	43.69

Hazen Williams Equation

$$h_f = \frac{10.67 \times Q^{1.85} \times L}{C^{1.85} \times d^{4.87}}$$

Where:

h_f = Head loss over the length of pipe (m)

Q = Volumetric flow rate (m³/s)

L = Length of pipe (m)

C = Pipe roughness coefficient

d = Pipe diameter (m)

Scenario 1: maximum daily demand

Q (L/s)	0.38	
C	150	
L (m.)	16.5	
I.D. (mm)	75	
V (m/s)	0.09	
h_f (m)	0.00	
Head Loss (psi)	0.00	
Pressure (psi)	64.04	
Service Obv. @ Street Connection (m)	85.29	
Service Obv. @ Building Connection (m)	86.70	
Pressure Adjustment (psi)	-2.00	(due to service elevation difference from street to building)
Adjusted Min. Pressure (psi)	62.03	(must not be less than 50 psi; must not be more than 80 psi)

Scenario 2: maximum hourly demand

Q (L/s)	0.84	
C	150	
L (m.)	16.5	
I.D. (mm)	75	
V (m/s)	0.19	
h_f (m)	0.01	
Head Loss (psi)	0.01	
Pressure (psi)	57.62	
Service Obv. @ Street Connection (m)	85.29	
Service Obv. @ Building Connection (m)	86.70	
Pressure Adjustment (psi)	-2.00	(due to service elevation difference from street to building)
Adjusted Min. Pressure (psi)	55.62	(must not be less than 40 psi; must not be more than 80 psi)

FUS Fire Flow Calculations

Tatham File No. : 522677
Project : 1592 Tenth Line Road
Date : December 5, 2022
Designed by : GC
Reviewed by : JA

Step	Task	Term	Options	Multiplier	Choose:	Value	unit	Fire Flow
Structural Framing Material								
1	Choose frame used for building	Coefficient C related to the type of construction	Wood Frame	1.5	Non-combustible construction	0.8		
			Ordinary Construction	1.0				
			Non-combustible construction	0.8				
			Fire resistive construction <2 hrs	0.7				
			Fire resistive construction >2 hrs	0.6				
Floor Space Area								
2	Choose type of housing	Type of housing	Single family dwelling	0	Building	1	unit(s)	
			Townhouse	0				
			Building	1				
3	Enter area of livable space	Enter total floor space area		1	942.0		sq.m.	
4	Obtain fire flow before reductions	Required fire flow	Fire Flow = 220 x C x Area^{0.5}				L/min	5,000
							L/s	83.3
Reductions or surcharge due to factors affecting burning								
5	Choose combustibility of contents	Occupancy hazard reduction or surcharge	Non-combustible	-0.25	Combustible	0		
			Limited combustible	-0.15				
			Combustible	0				
			Free burning	0.15			L/min	5,000
			Rapid burning	0.25			L/s	83.3
6	Choose reduction for sprinklers	Sprinkler reduction	Sprinklers conforming to NFPA13 (wet or dry system)	-0.30	False	0		
			Water supply is standard for both the system and fire department hose lines (siamese connection)	-0.10	False	0	L/min	5,000
			Fully supervised system (electronic monitoring system on at all times)	-0.10	False	0	L/s	83.3
7	Choose separation	Exposure distance between units	North side	20.1 to 30m	0.1			
			East side	Over 45m	0			
			South side	3.1 to 10m	0.2		L/min	7,000
			West side	20.1 to 30m	0.1	0.4	L/s	116.7
Net required fire flow								
8	Obtain fire flow, duration, and volume	Minimum required fire flow rate (rounded to nearest 1000)					L/min	7,000
		Minimum required fire flow rate					L/s	116.7
		Required duration of fire flow					hr	2

Appendix D: Stormwater Treatment Unit

Stormceptor®EF Sizing Report

STORMCEPTOR®

ESTIMATED NET ANNUAL SEDIMENT (TSS) LOAD REDUCTION

11/17/2020

Province:	Ontario	Project Name:	Tenth Line
City:	Ottawa	Project Number:	20-363
Nearest Rainfall Station:	OTTAWA MACDONALD-CARTIER INT'L AP	Designer Name:	GUILLAUME BRUNET
NCDC Rainfall Station Id:	6000	Designer Company:	BL ENGINEERING
Years of Rainfall Data:	37	Designer Email:	guillaume@blengineering.ca
Site Name:	1592 Tenth Line	Designer Phone:	613-693-0700
Drainage Area (ha):	0.15	EOR Name:	
Runoff Coefficient 'c':	0.84	EOR Company:	
Particle Size Distribution:	Fine	EOR Email:	
Target TSS Removal (%):	80.0	EOR Phone:	

Net Annual Sediment (TSS) Load Reduction Sizing Summary

Stormceptor Model	TSS Removal Provided (%)
EF4	88
EF6	91
EF8	92
EF10	93
EF12	93

Recommended Stormceptor EF Model: **EF4**

Estimated Net Annual Sediment (TSS) Load Reduction (%): **88**

Water Quality Runoff Volume Capture (%): **> 90**

Stormceptor® **EF** Sizing Report**THIRD-PARTY TESTING AND VERIFICATION**

► **Stormceptor® EF and Stormceptor® EFO** are the latest evolutions in the Stormceptor® oil-grit separator (OGS) technology series, and are designed to remove a wide variety of pollutants from stormwater and snowmelt runoff. These technologies have been third-party tested in accordance with the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators** and performance has been third-party verified in accordance with the **ISO 14034 Environmental Technology Verification (ETV)** protocol.

PERFORMANCE

► **Stormceptor® EF and EFO** remove stormwater pollutants through gravity separation and floatation, and feature a patent-pending design that generates positive removal of total suspended solids (TSS) throughout each storm event, including high-intensity storms. Captured pollutants include sediment, free oils, and sediment-bound pollutants such as nutrients, heavy metals, and petroleum hydrocarbons. Stormceptor is sized to remove a high level of TSS from the frequent rainfall events that contribute the vast majority of annual runoff volume and pollutant load. The technology incorporates an internal bypass to convey excessive stormwater flows from high-intensity storms through the device without resuspension and washout (scour) of previously captured pollutants. Proper routine maintenance ensures high pollutant removal performance and protection of downstream waterways.

PARTICLE SIZE DISTRIBUTION (PSD)

► The **Canadian ETV PSD** shown in the table below was used, or in part, for this sizing. This is the identical PSD that is referenced in the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators** for both sediment removal testing and scour testing. The Canadian ETV PSD contains a wide range of particle sizes in the sand and silt fractions, and is considered reasonably representative of the particle size fractions found in typical urban stormwater runoff.

Particle Size (µm)	Percent Less Than	Particle Size Fraction (µm)	Percent
1000	100	500-1000	5
500	95	250-500	5
250	90	150-250	15
150	75	100-150	15
100	60	75-100	10
75	50	50-75	5
50	45	20-50	10
20	35	8-20	15
8	20	5-8	10
5	10	2-5	5
2	5	<2	5

Stormceptor®EF Sizing Report

Upstream Flow Controlled Results

Rainfall Intensity (mm / hr)	Percent Rainfall Volume (%)	Cumulative Rainfall Volume (%)	Flow Rate (L/s)	Flow Rate (L/min)	Surface Loading Rate (L/min/m²)	Removal Efficiency (%)	Incremental Removal (%)	Cumulative Removal (%)
1	51.3	51.3	0.35	21.0	18.0	93	47.7	47.7
2	8.7	60.0	0.70	42.0	35.0	93	8.1	55.8
3	5.8	65.8	1.05	63.0	53.0	92	5.3	61.1
4	4.6	70.4	1.40	84.0	70.0	90	4.1	65.3
5	4.2	74.6	1.75	105.0	88.0	89	3.7	69.0
6	3.2	77.8	2.10	126.0	105.0	87	2.8	71.8
7	2.6	80.4	2.45	147.0	123.0	85	2.2	74.0
8	2.4	82.8	2.80	168.0	140.0	83	2.0	76.0
9	1.9	84.7	3.15	189.0	158.0	81	1.5	77.5
10	1.6	86.3	3.50	210.0	175.0	79	1.3	78.8
11	1.3	87.6	3.85	231.0	193.0	77	1.0	79.8
12	1.1	88.7	4.20	252.0	210.0	75	0.8	80.6
13	1.3	90.0	4.55	273.0	228.0	74	1.0	81.6
14	1.1	91.1	4.90	294.0	245.0	72	0.8	82.4
15	0.6	91.7	5.25	315.0	263.0	71	0.4	82.8
16	0.8	92.5	5.60	336.0	280.0	69	0.6	83.4
17	0.7	93.2	5.95	357.0	298.0	68	0.5	83.8
18	0.5	93.7	6.31	378.0	315.0	66	0.3	84.2
19	0.6	94.3	6.66	399.0	333.0	64	0.4	84.5
20	0.5	94.8	7.01	420.0	350.0	63	0.3	84.9
21	0.2	95.0	7.36	441.0	368.0	62	0.1	85.0
22	0.4	95.4	7.71	462.0	385.0	60	0.2	85.2
23	0.5	95.9	8.06	483.0	403.0	58	0.3	85.5
24	0.4	96.3	8.41	504.0	420.0	58	0.2	85.7
25	0.1	96.4	8.76	525.0	438.0	58	0.1	85.8


Stormceptor®EF Sizing Report

Rainfall Intensity (mm / hr)	Percent Rainfall Volume (%)	Cumulative Rainfall Volume (%)	Flow Rate (L/s)	Flow Rate (L/min)	Surface Loading Rate (L/min/m²)	Removal Efficiency (%)	Incremental Removal (%)	Cumulative Removal (%)
26	0.3	96.7	9.11	546.0	455.0	58	0.2	86.0
27	0.4	97.1	9.46	567.0	473.0	57	0.2	86.2
28	0.2	97.3	9.81	588.0	490.0	57	0.1	86.3
29	0.2	97.5	10.16	609.0	508.0	57	0.1	86.4
30	0.2	97.7	10.51	631.0	525.0	57	0.1	86.5
31	0.1	97.8	10.86	652.0	543.0	57	0.1	86.6
32	0.2	98.0	11.21	673.0	560.0	56	0.1	86.7
33	0.1	98.1	11.56	694.0	578.0	56	0.1	86.8
34	0.1	98.2	11.91	715.0	595.0	56	0.1	86.8
35	0.1	98.3	12.26	736.0	613.0	56	0.1	86.9
36	0.2	98.5	12.61	757.0	631.0	56	0.1	87.0
37	1.5	100.0	12.96	778.0	648.0	56	0.8	87.8
38	0.1	100.1	13.31	799.0	666.0	56	0.1	87.9
39	0.1	100.2	13.66	820.0	683.0	56	0.1	87.9
40	0.1	100.3	14.01	841.0	701.0	56	0.1	88.0
41	0.1	100.4	14.36	862.0	718.0	55	0.1	88.0
42	0.1	100.5	14.71	883.0	736.0	55	0.1	88.1
43	0.2	100.7	15.06	904.0	753.0	55	0.1	88.2
44	0.1	100.8	15.41	925.0	771.0	55	0.1	88.3
45	0.1	100.9	15.76	946.0	788.0	55	0.1	88.3
46	-0.9	100.0	16.11	967.0	806.0	55	N/A	87.8
47	0.1	100.1	16.46	988.0	823.0	55	0.1	87.9
48	-0.1	100.0	16.81	1009.0	841.0	55	N/A	87.8
49	0.0	100.0	17.16	1030.0	858.0	55	0.0	87.8
50	0.0	100.0	17.51	1051.0	876.0	55	0.0	87.8
Estimated Net Annual Sediment (TSS) Load Reduction =								88 %




Stormceptor®EF Sizing Report

RAINFALL DATA FROM OTTAWA MACDONALD-CARTIER INT'L AP RAINFALL STATION

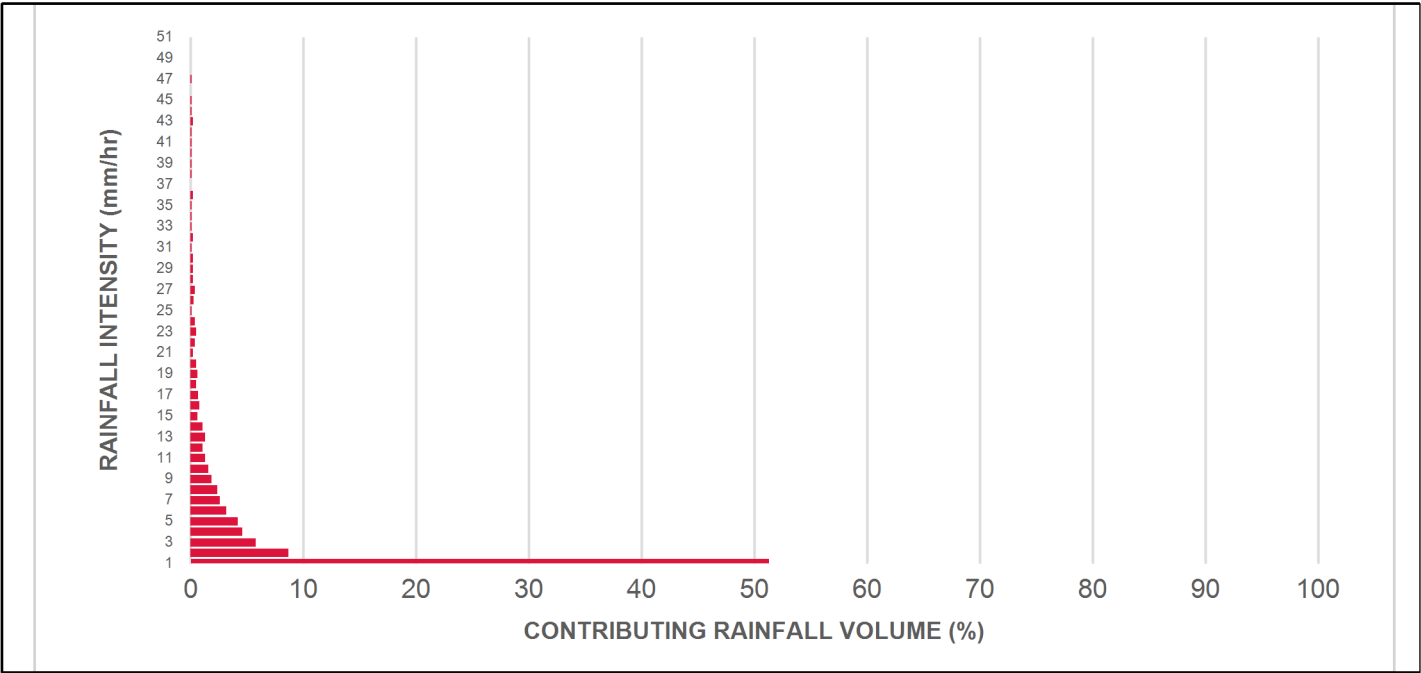

INCREMENTAL AND CUMULATIVE TSS REMOVAL FOR THE RECOMMENDED STORMCEPTOR® MODEL

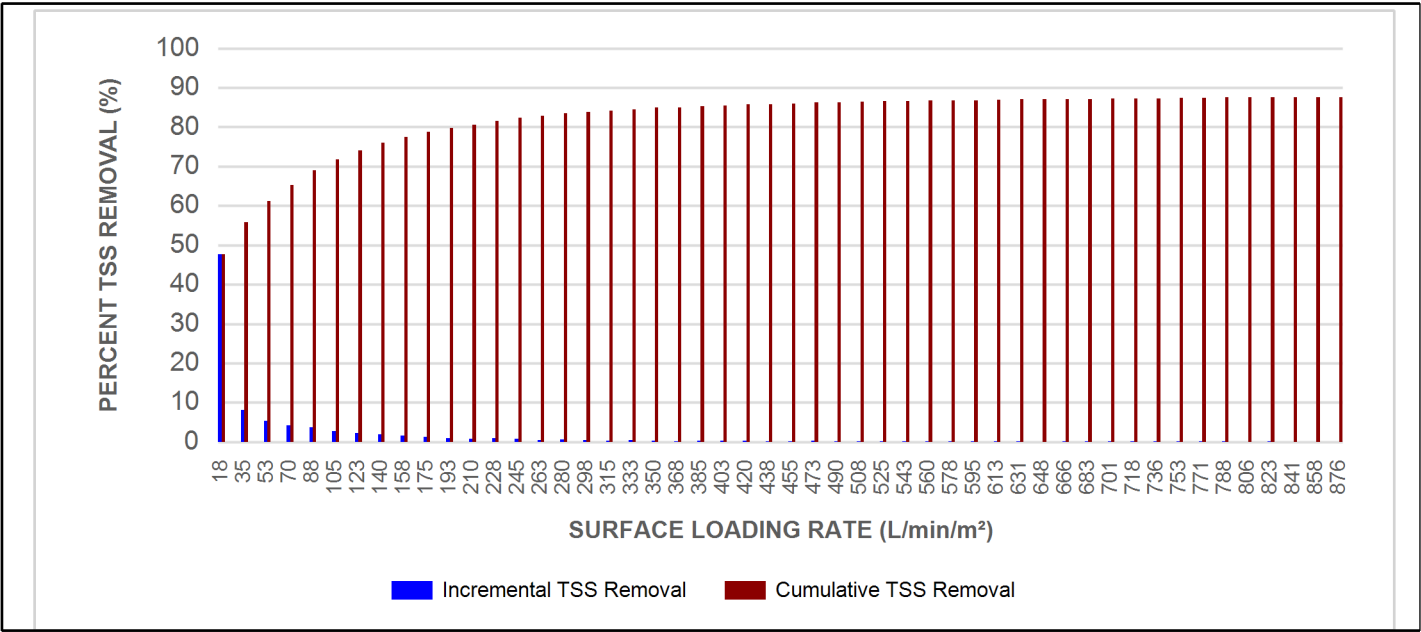

Stormceptor® EF Sizing Report

Maximum Pipe Diameter / Peak Conveyance

Stormceptor EF / EFO	Model Diameter		Min Angle Inlet / Outlet Pipes	Max Inlet Pipe Diameter		Max Outlet Pipe Diameter		Peak Conveyance Flow Rate	
	(m)	(ft)		(mm)	(in)	(mm)	(in)	(L/s)	(cfs)
EF4 / EFO4	1.2	4	90	609	24	609	24	425	15
EF6 / EFO6	1.8	6	90	914	36	914	36	990	35
EF8 / EFO8	2.4	8	90	1219	48	1219	48	1700	60
EF10 / EFO10	3.0	10	90	1828	72	1828	72	2830	100
EF12 / EFO12	3.6	12	90	1828	72	1828	72	2830	100

SCOUR PREVENTION AND ONLINE CONFIGURATION


► **Stormceptor® EF and EFO** feature an internal bypass and superior scour prevention technology that have been demonstrated in third-party testing according to the scour testing provisions of the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators**, and the exceptional scour test performance has been third-party verified in accordance with the ISO 14034 ETV protocol. As a result, Stormceptor EF and EFO are approved for online installation, eliminating the need for costly additional bypass structures, piping, and installation expense.

DESIGN FLEXIBILITY


► **Stormceptor® EF and EFO** offers design flexibility in one simplified platform, accepting stormwater flow from a single inlet pipe or multiple inlet pipes, and/or surface runoff through an inlet grate. The device can also serve as a junction structure, accommodate a 90-degree inlet-to-outlet bend angle, and can be modified to ensure performance in submerged conditions.

OIL CAPTURE AND RETENTION

► While Stormceptor® EF will capture and retain oil from dry weather spills and low intensity runoff, **Stormceptor® EFO** has demonstrated superior oil capture and greater than 99% oil retention in third-party testing according to the light liquid re-entrainment testing provisions of the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators**. Stormceptor EFO is recommended for sites where oil capture and retention is a requirement.

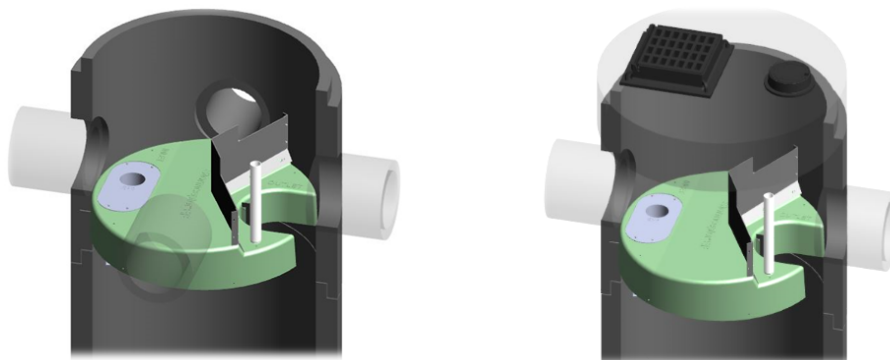

Stormceptor® EF Sizing Report

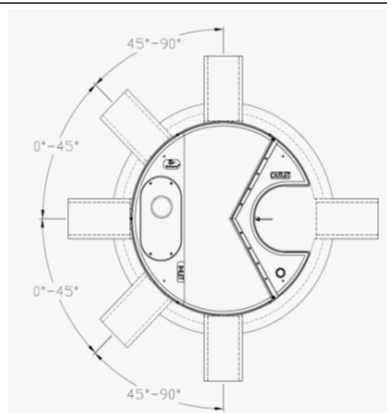

INLET-TO-OUTLET DROP

Elevation differential between inlet and outlet pipe inverts is dictated by the angle at which the inlet pipe(s) enters the unit.

0° - 45° : The inlet pipe is 1-inch (25mm) higher than the outlet pipe.

45° - 90° : The inlet pipe is 2-inches (50mm) higher than the outlet pipe.

HEAD LOSS

The head loss through Stormceptor EF is similar to that of a 60-degree bend structure. The applicable K value for calculating minor losses through the unit is 1.1.

For submerged conditions the applicable K value is 3.0.

Pollutant Capacity

Stormceptor EF / EFO	Model Diameter		Depth (Outlet Pipe Invert to Sump Floor)		Oil Volume		Recommended Sediment Maintenance Depth *		Maximum Sediment Volume *		Maximum Sediment Mass **	
	(m)	(ft)	(m)	(ft)	(L)	(Gal)	(mm)	(in)	(L)	(ft³)	(kg)	(lb)
EF4 / EFO4	1.2	4	1.52	5.0	265	70	203	8	1190	42	1904	5250
EF6 / EFO6	1.8	6	1.93	6.3	610	160	305	12	3470	123	5552	15375
EF8 / EFO8	2.4	8	2.59	8.5	1070	280	610	24	8780	310	14048	38750
EF10 / EFO10	3.0	10	3.25	10.7	1670	440	610	24	17790	628	28464	78500
EF12 / EFO12	3.6	12	3.89	12.8	2475	655	610	24	31220	1103	49952	137875

*Increased sump depth may be added to increase sediment storage capacity

** Average density of wet packed sediment in sump = 1.6 kg/L (100 lb/ft³)

Feature	Benefit	Feature Appeals To
Patent-pending enhanced flow treatment and scour prevention technology	Superior, verified third-party performance	Regulator, Specifying & Design Engineer
Third-party verified light liquid capture and retention for EFO version	Proven performance for fuel/oil hotspot locations	Regulator, Specifying & Design Engineer, Site Owner
Functions as bend, junction or inlet structure	Design flexibility	Specifying & Design Engineer
Minimal drop between inlet and outlet	Site installation ease	Contractor
Large diameter outlet riser for inspection and maintenance	Easy maintenance access from grade	Maintenance Contractor & Site Owner

STANDARD STORMCEPTOR EF/EFO DRAWINGS

For standard details, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

STANDARD STORMCEPTOR EF/EFO SPECIFICATION

For specifications, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

STANDARD PERFORMANCE SPECIFICATION FOR “OIL GRIT SEPARATOR” (OGS) STORMWATER QUALITY TREATMENT DEVICE

PART 1 – GENERAL

1.1 WORK INCLUDED

This section specifies requirements for selecting, sizing, and designing an underground Oil Grit Separator (OGS) device for stormwater quality treatment, with third-party testing results and a Statement of Verification in accordance with ISO 14034 Environmental Management – Environmental Technology Verification (ETV).

1.2 REFERENCE STANDARDS & PROCEDURES

ISO 14034:2016 Environmental management – Environmental technology verification (ETV)

Canadian Environmental Technology Verification (ETV) Program's **Procedure for Laboratory Testing of Oil-Grit Separators**.

1.3 SUBMITTALS

1.3.1 All submittals, including sizing reports & shop drawings, shall be submitted upon request with each order to the contractor then forwarded to the Engineer of Record for review and acceptance. Shop drawings shall detail all OGS components, elevations, and sequence of construction.

1.3.2 Alternative devices shall have features identical to or greater than the specified device, including: treatment chamber diameter, treatment chamber wet volume, sediment storage volume, and oil storage volume.

1.3.3 Unless directed otherwise by the Engineer of Record, OGS stormwater quality treatment product substitutions or alternatives submitted within ten days prior to project bid shall not be accepted. All alternatives or substitutions submitted shall be signed and sealed by a local registered Professional Engineer, based on the exact same criteria detailed in Section 3, in entirety, subject to review and approval by the Engineer of Record.

PART 2 – PRODUCTS

2.1 OGS POLLUTANT STORAGE

The OGS device shall include a sump for sediment storage, and a protected volume for the capture and storage of petroleum hydrocarbons and buoyant gross pollutants. The **minimum** sediment & petroleum hydrocarbon storage capacity shall be as follows:

2.1.1	4 ft (1219 mm) Diameter OGS Units:	1.19 m ³ sediment / 265 L oil
	6 ft (1829 mm) Diameter OGS Units:	3.48 m ³ sediment / 609 L oil
	8 ft (2438 mm) Diameter OGS Units:	8.78 m ³ sediment / 1,071 L oil
	10 ft (3048 mm) Diameter OGS Units:	17.78 m ³ sediment / 1,673 L oil
	12 ft (3657 mm) Diameter OGS Units:	31.23 m ³ sediment / 2,476 L oil

PART 3 – PERFORMANCE & DESIGN

3.1 GENERAL

Stormceptor®EF Sizing Report

The OGS stormwater quality treatment device shall be verified in accordance with ISO 14034:2016 Environmental management – Environmental technology verification (ETV). The OGS stormwater quality treatment device shall remove oil, sediment and gross pollutants from stormwater runoff during frequent wet weather events, and retain these pollutants during less frequent high flow wet weather events below the insert within the OGS for later removal during maintenance. The Manufacturer shall have at least ten (10) years of local experience, history and success in engineering design, manufacturing and production and supply of OGS stormwater quality treatment device systems, acceptable to the Engineer of Record.

3.2 SIZING METHODOLOGY

The OGS device shall be engineered, designed and sized to provide stormwater quality treatment based on treating a minimum of 90 percent of the average annual runoff volume and a minimum removal of an annual average 60% of the sediment (TSS) load based on the Particle Size Distribution (PSD) specified in the sizing report for the specified device. Sizing shall be determined using historical rainfall data and a sediment removal performance curve derived from the actual third-party verified laboratory testing data. The OGS device shall also have sufficient annual sediment storage capacity as specified and calculated in Section 2.1.

3.3 CANADIAN ETV or ISO 14034 ETV VERIFICATION OF SCOUR TESTING

The OGS device shall have Canadian ETV or ISO 14034 ETV Verification of third-party scour testing conducted in accordance with the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**.

3.3.1 To be acceptable for on-line installation, the OGS device must demonstrate an average scour test effluent concentration less than 10 mg/L at each surface loading rate tested, up to and including 2600 L/min/m².

Appendix E: Boundary Conditions

Boundary Conditions 1592 Tenth Line

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	10	0.17
Maximum Daily Demand	26	0.43
Peak Hour	56	0.94
Fire Flow Demand #1	8,200	136.67

Location



Results

Connection 1 – Phoenix Cres.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	130.2	60.4
Peak Hour	125.7	54.1
Max Day plus Fire 1	115.9	40.2

¹ Ground Elevation = 87.69 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

Appendix F: Engineering Drawings

**** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION,
MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND
SEDIMENT CONTROL FEATURES ****

**** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION,
MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND
SEDIMENT CONTROL FEATURES ****





- 1.1. PRIOR TO THE REMOVAL OF ANY VEGETATIVE COVER, MOVING OF ANY SOIL, AND CONSTRUCTION:
 - 1.1.1. INSTALL SILT FENCE IMMEDIATELY DOWNSTREAM FROM AREAS TO BE DISTURBED (SEE PLAN FOR LOCATION).
 - 1.1.2. INSTALL GEOSOCK INSERTS WITH AN OVERFLOW IN ALL THE DOWNSTREAM CATCH BASINS AND MANHOLES.
 - 1.1.3. INSTALL SILTSACK FILTERS IN ALL CONCRETE CATCH BASIN STRUCTURES.
 - 1.1.4. INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.

- 2.1. WORK TO BE DONE IN THE VICINITY OF MAJOR WATERWAYS TO BE CARRIED OUT FROM JULY TO SEPTEMBER ONLY.
- 2.2. MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE.
- 2.3. PROTECT DISTURBED AREAS FROM RUNOFF.
- 2.4. PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
- 2.5. INSPECT SILT FENCE, FILTER CLOTHS, AND CATCH BASINS WEEKLY AND AFTER EVERY MAJOR STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY
- 2.6. PLAN TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION.
- 2.7. EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES.
- 2.8. LOCATE TORSION PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE PILE IS REMOVED. ALL TORSION PILES ARE TO BE SEEDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (30 DAYS).

3. **AFTER CONSTRUCTION:**
 - 3.1. PROVIDE PERMANENT COVER CONSISTING OF TOPSOIL AND SEED TO DISTURBED AREA.
 - 3.2. REMOVE STRAW BALE FLOW CHECK DAMS, SILT FENCES AND FILTER CLOTHS ON CATCH BASINS AND MANHOLE COVERS AFTER DISTURBED AREAS HAVE BEEN REHABILITATED AND STABILIZED.
 - 3.3. INSPECT AND CLEAN CATCH BASIN SUMPS AND STORM SEWERS.

=50.00 PROPOSED ELEVATION
 =50.00 (SW) SWALE ELEVATION
 =50.00 (BW) PROPOSED BOTTOM OF WALL ELEVATION
 =50.00 (TW) PROPOSED TOP OF CURB ELEVATION
 =50.00 (BC) PROPOSED BOTTOM OF CURB ELEVATION
 =50.00 (TC) PROPOSED TOP OF CURB ELEVATION
 =50.00 (ME) PROPOSED ELEVATION MATCH INTO EXISTING ELEVATION
 =70.19 EXISTING ELEVATION

=50.00 PROPOSED 200mm Ø PERFORATED SUBDRAIN
 =57M STW STW STW PROPOSED STORM SEWER
 =5M SAN SAN SAN PROPOSED SANITARY SEWER

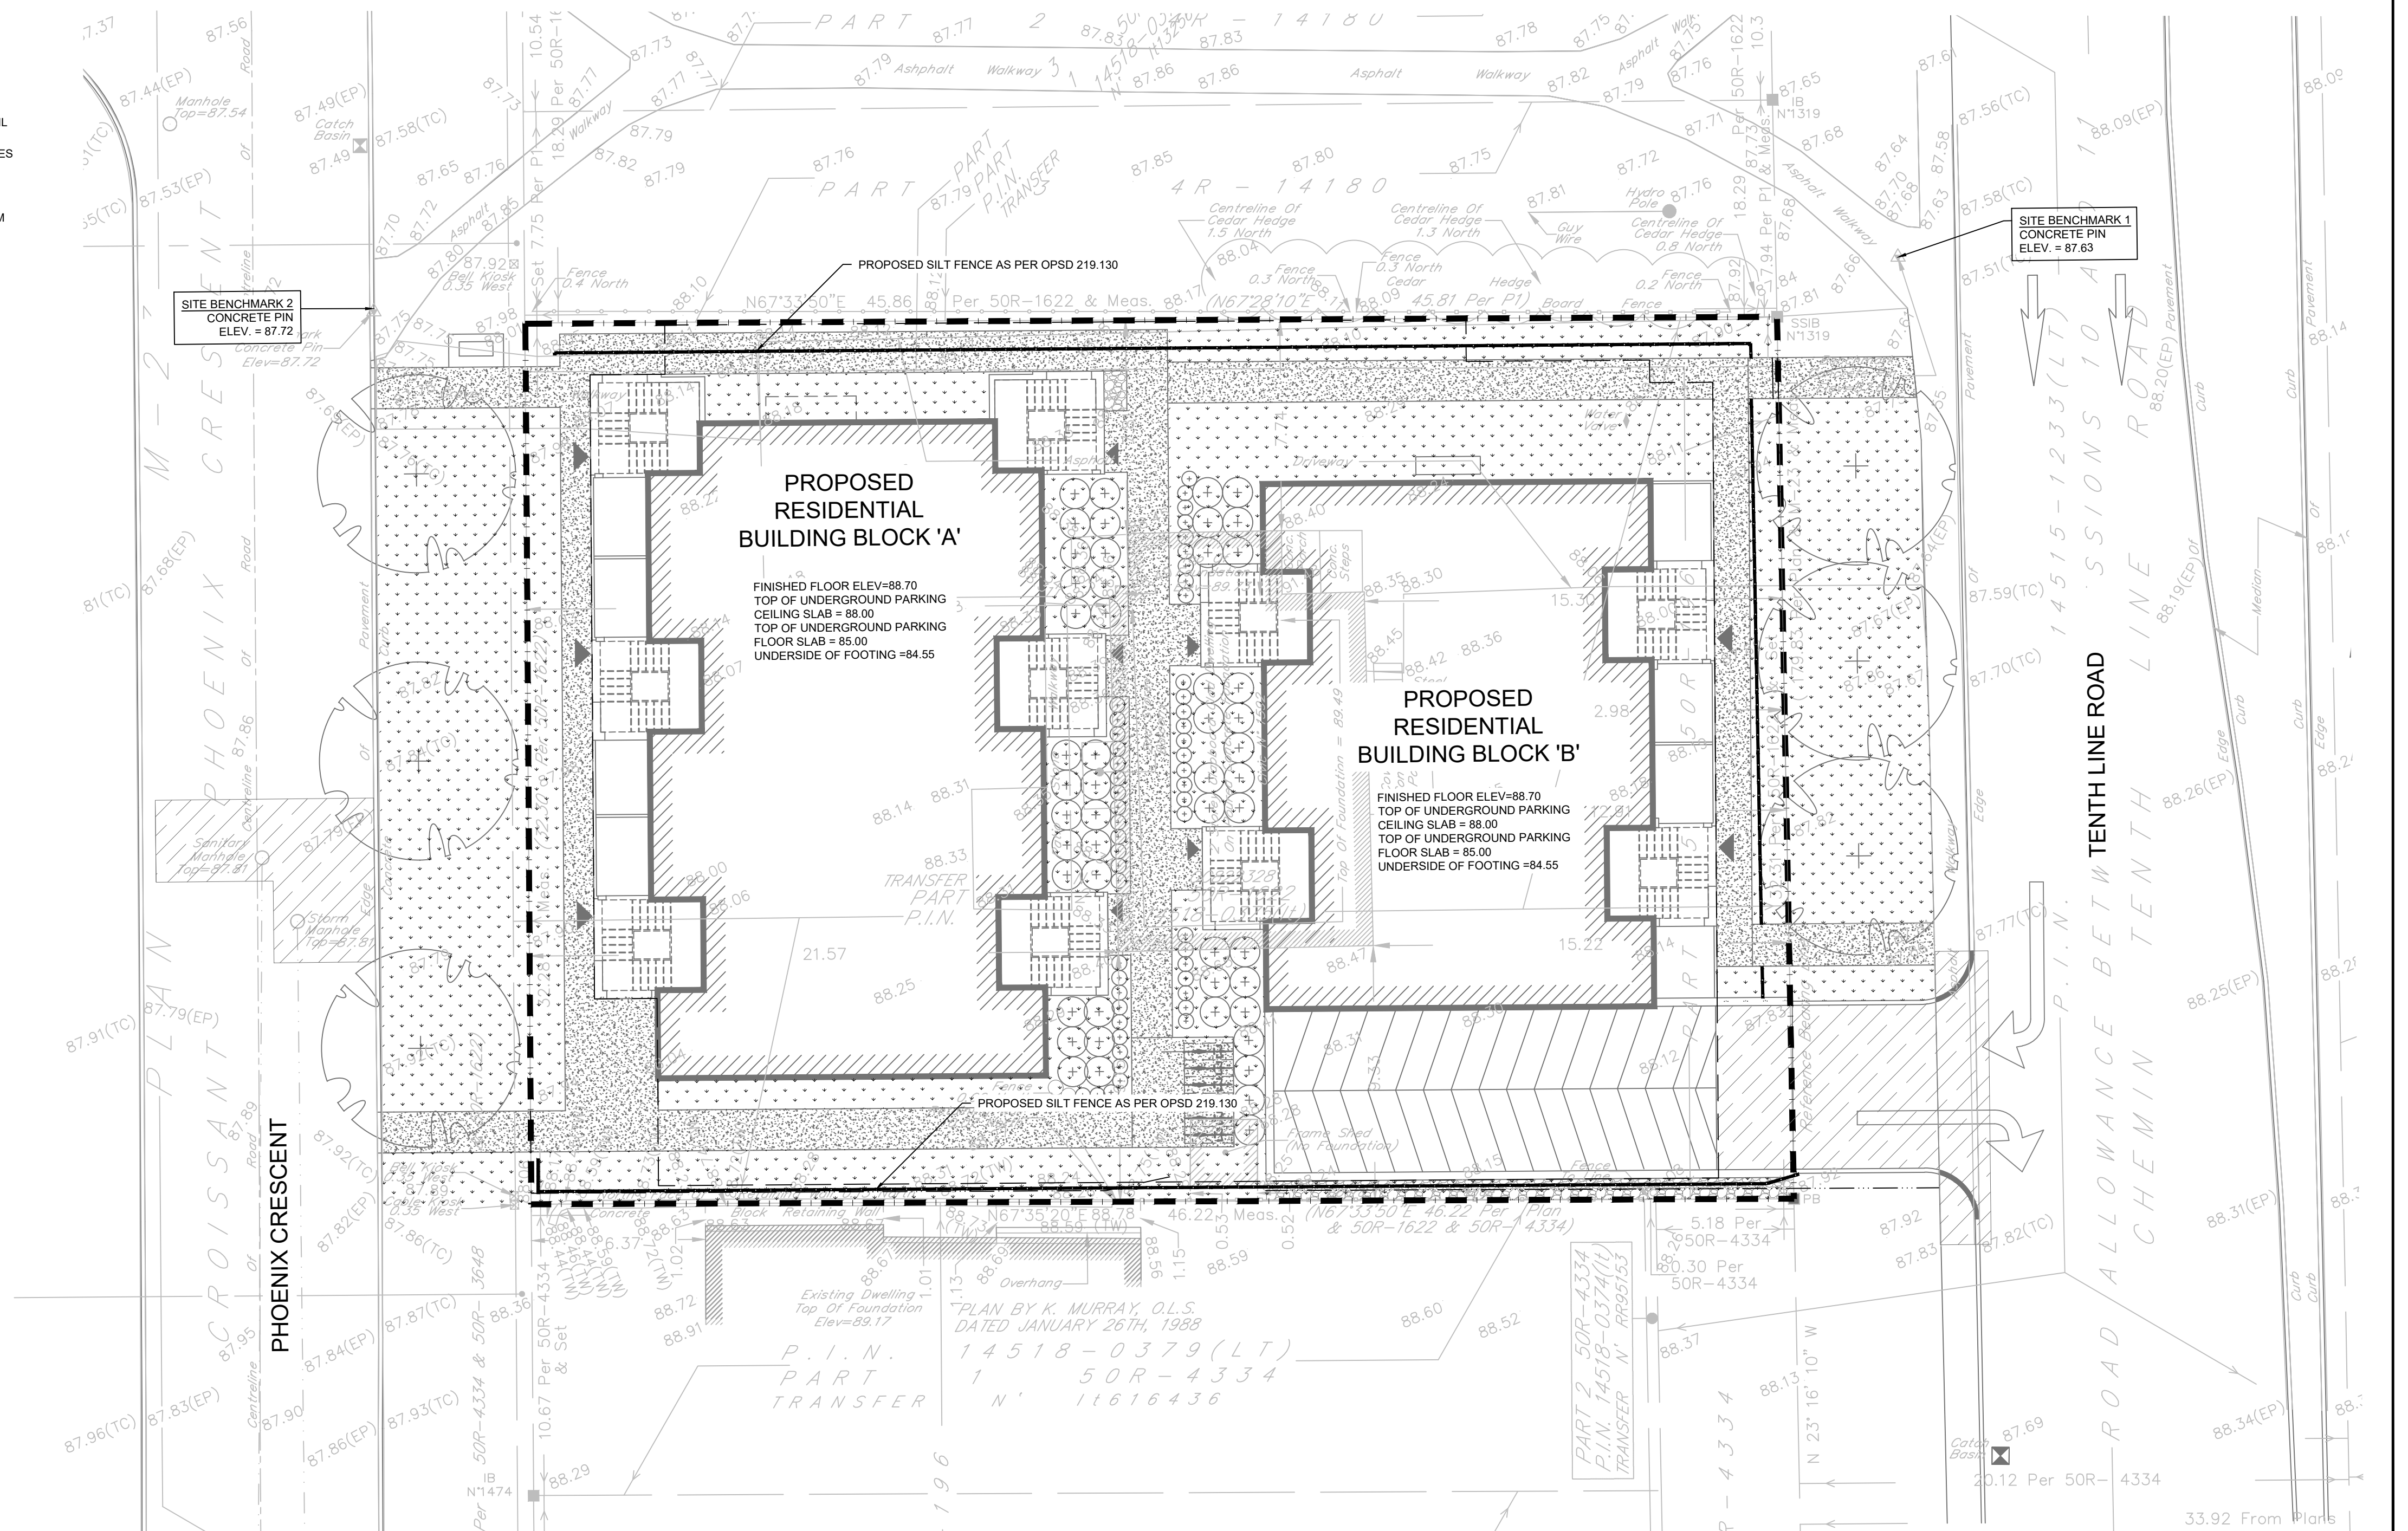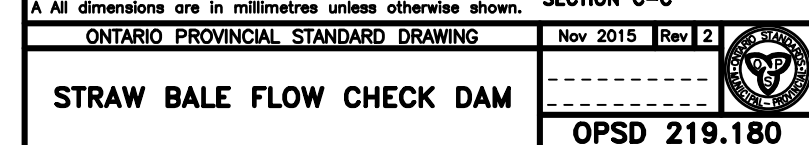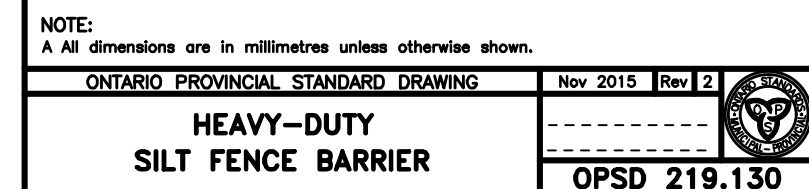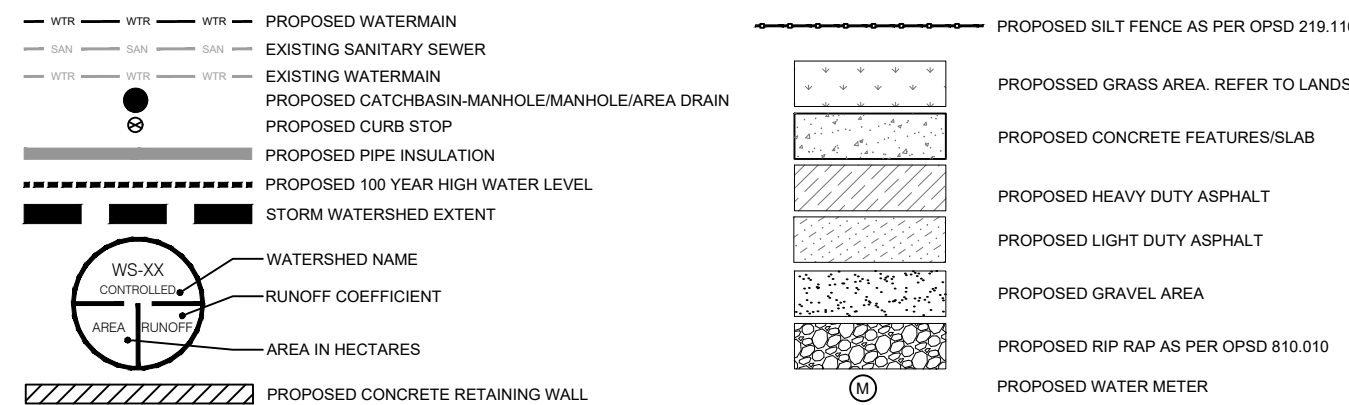

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

BENCHMARK1: CONCRETE PIN LOCATED ON NORTH
EAST CORNER OF THE SITE, ELEVATION: 87.63

BENCHMARK2: CONCRETE PIN LOCATED ON NORTH
WEST CORNER OF THE SITE. ELEVATION: 87.72


No.	REVISION DESCRIPTION	DATE	ENGINEER STAMP
1.	ISSUED FOR SPA	DEC. 2022	
2.	AS PER ARCHITECT'S COMMENTS	DEC. 2022	



SEDIMENT & EROSION CONTROL PLAN



DESIGN: HY/GC	FILE: 522677	DWG: C100
DRAWN: HY	DATE: NOV 2022	
CHECK: GC	SCALE: 1:150	

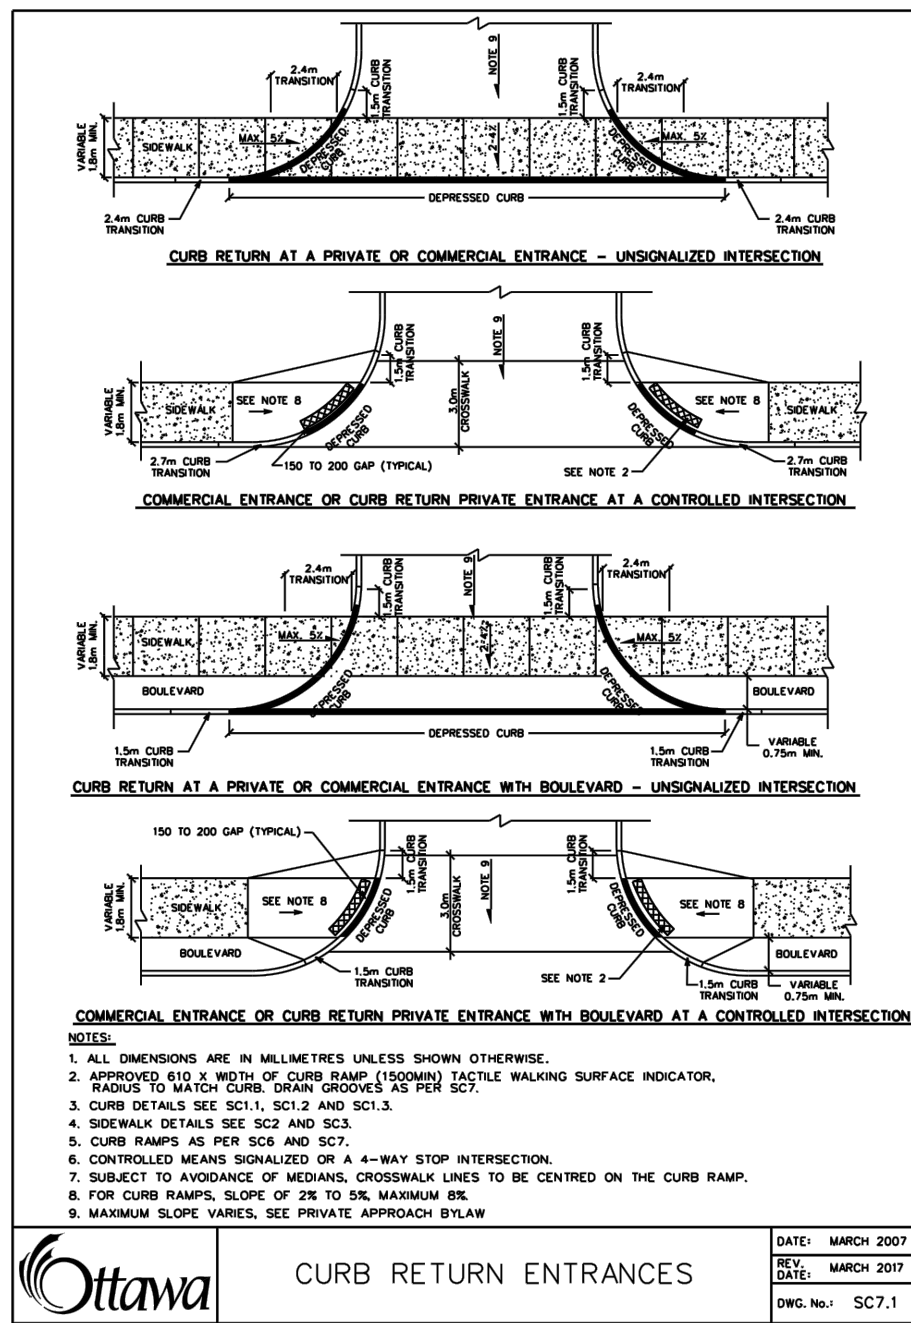

CURB RETURN ENTRANCES



LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED ELEVATION
- PROPOSED BOTTOM OF WALL ELEVATION
- PROPOSED TOP OF WALL ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- PROPOSED ELEVATION MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED RETAINING WALL (DESIGN BY OTHERS)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED 200mm(8") PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- PROPOSED CATCH BASIN-MANHOLE/AREA DRAIN
- PROPOSED WATER VALVE
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES
- PROPOSED GRASS AREA, REFER TO LANDSCAPING
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED GRAVEL AREA
- PROPOSED RIP RAP AS PER OPSD 810.010
- PROPOSED WATER METER


PAVEMENT STRUCTURE

COURSE	MATERIAL	THICKNESS (mm)	
		AUTOMOBILE PARKING	TRUCK ROUTE (HEAVY TRAFFIC)
SURFACE	HL.3 A/C (PG 58-28)	50	40
BINDER	HL.8 A/C (PG 58-28)	--	50
BASECOURSE	GRANULAR "A"	150	150
SUBBASE	GRANULAR "B" TYPE II	350	450

NOTE:
IN PREPARATION FOR PAVEMENT CONSTRUCTION AT THIS SITE, ANY SURFICIAL OR NEAR SURFACE/SUBGRADE LEVEL TOPSOIL AND ANY SOFT, WET OR DELETERIOUS MATERIALS SHOULD BE REMOVED FROM THE PROPOSED PAVED AREAS. THE EXPOSED SUBGRADE SHOULD BE INSPECTED AND APPROVED BY GEOTECHNICAL ENGINEER AND ANY SOFT AREAS EVIDENT SHOULD BE SUBEXCAVATED AND REPLACED WITH SUITABLE EARTH BORROW APPROVED BY THE GEOTECHNICAL ENGINEER. FOLLOWING APPROVAL OF THE PREPARATION OF THE SUBGRADE, THE PAVEMENT GRANULARS MAY BE PLACED.

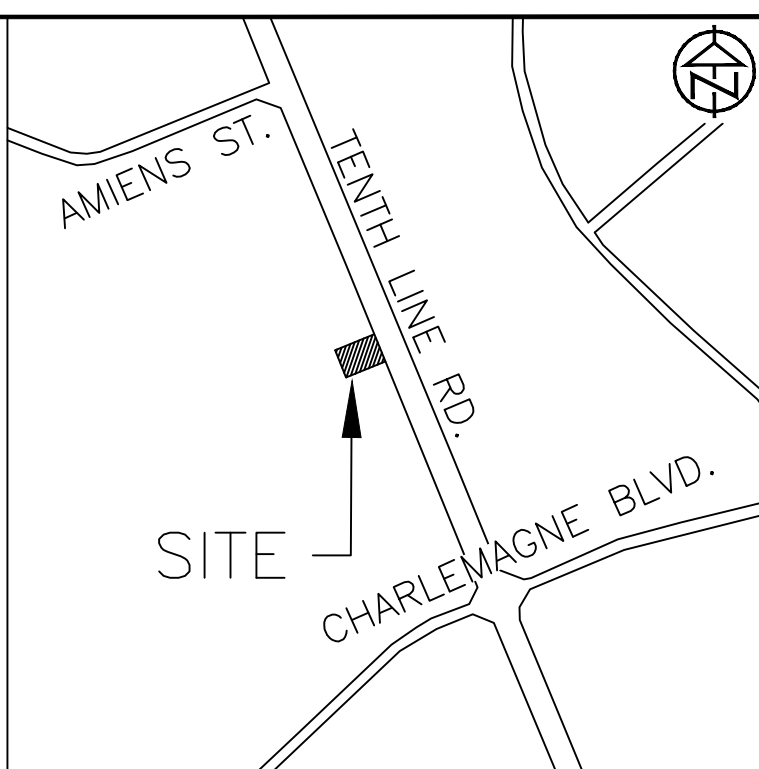

KEY PLAN - N.T.S.

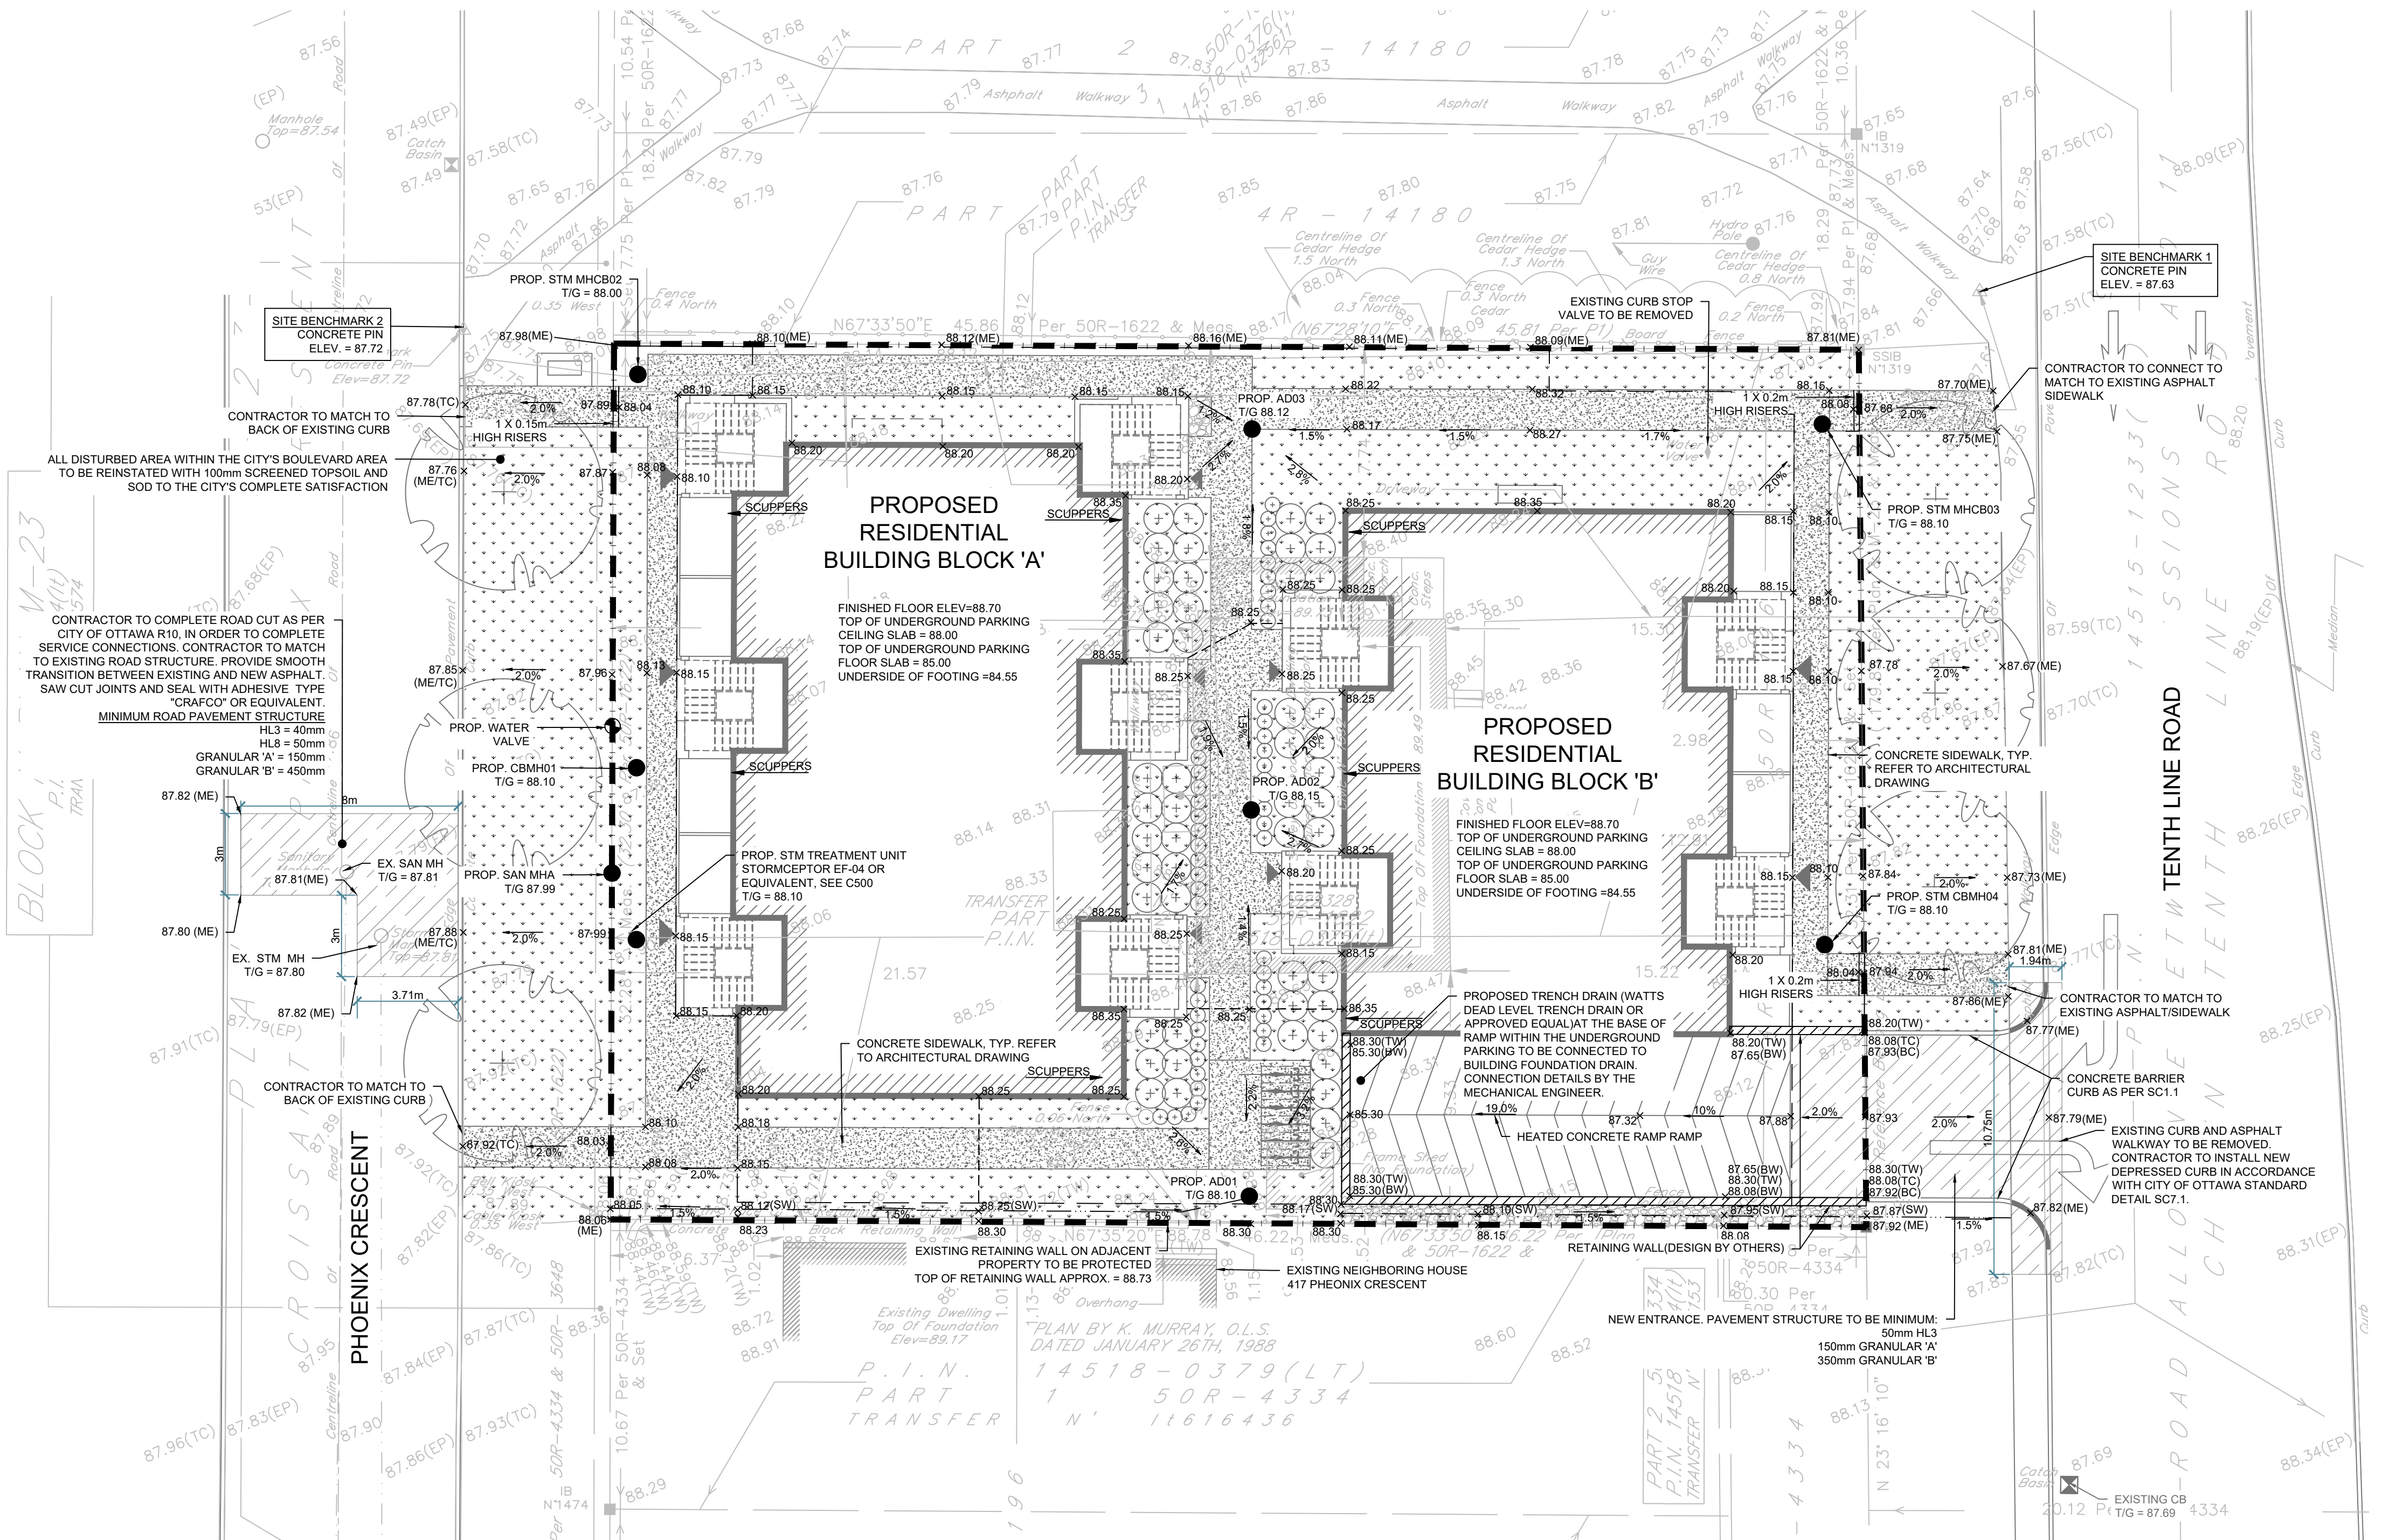

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

LEGAL AND TOPOGRAPHIC SURVEY COMPLETED BY ARPENITAGE DUTRISAC SURVEYING INC.

BENCHMARK1: CONCRETE PIN LOCATED ON NORTH EAST CORNER OF THE SITE, ELEVATION: 87.63

BENCHMARK2: CONCRETE PIN LOCATED ON NORTH WEST CORNER OF THE SITE, ELEVATION: 87.72

No.	REVISION DESCRIPTION	DATE
1.	ISSUED FOR SPA	DEC. 2022
2.	AS PER ARCHITECT'S COMMENTS	DEC. 2022

ENGINEER STAMP






BRIDOR DEVELOPMENTS
1592 TENTH LINE ROAD
CITY OF OTTAWA

SITE GRADING PLAN



DESIGN: HY/GC	FILE: 522677	DWG:
DRAWN: HY	DATE: NOV 2022	C200
CHECK: GC	SCALE: 1:150	

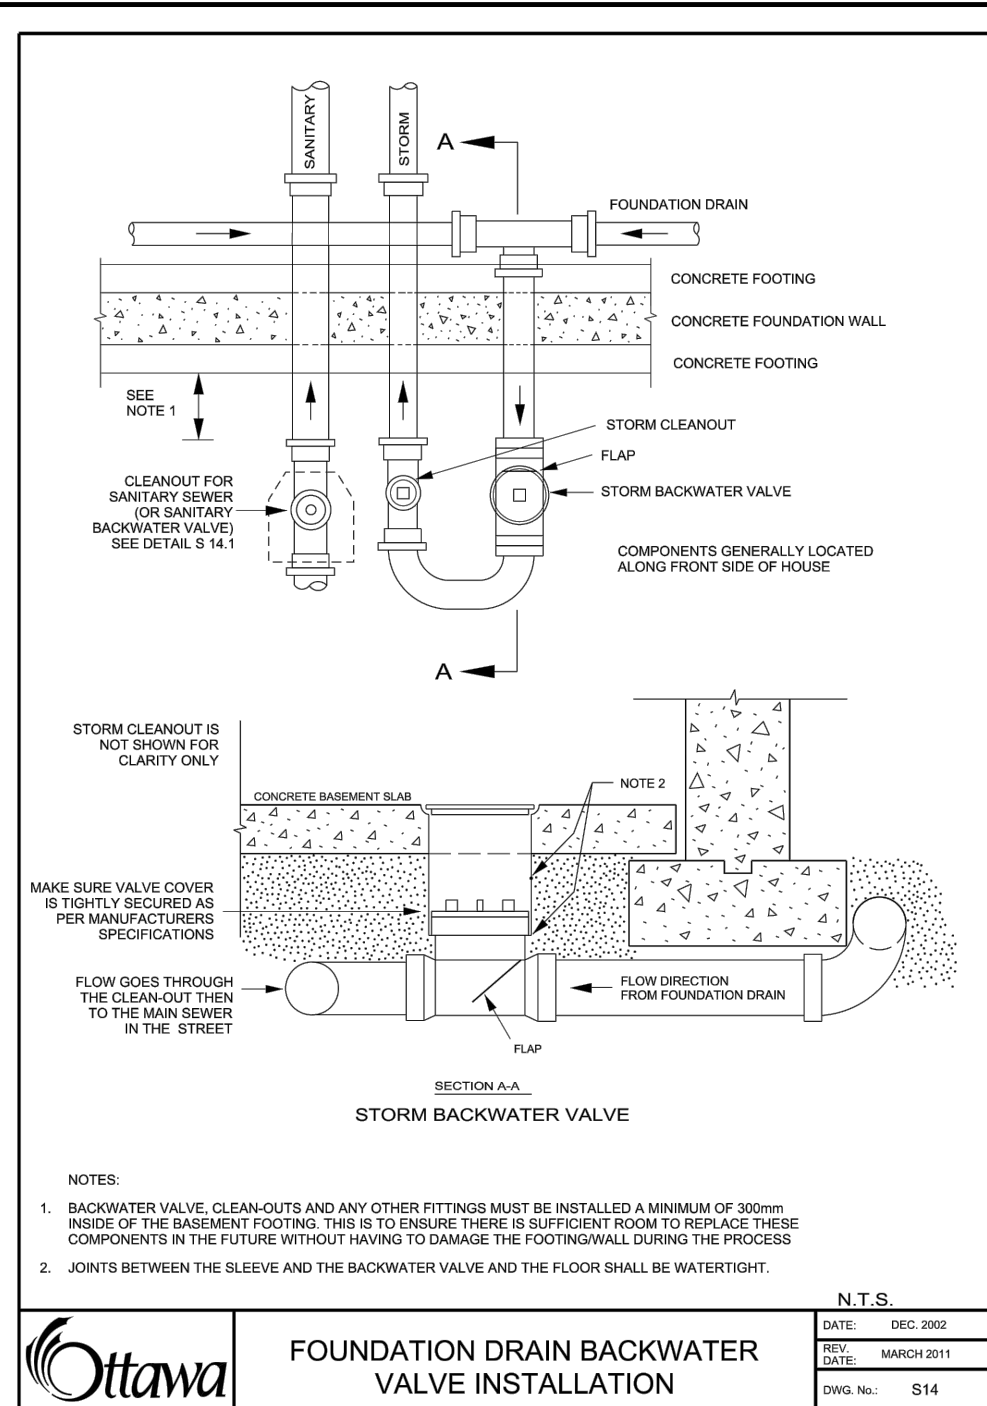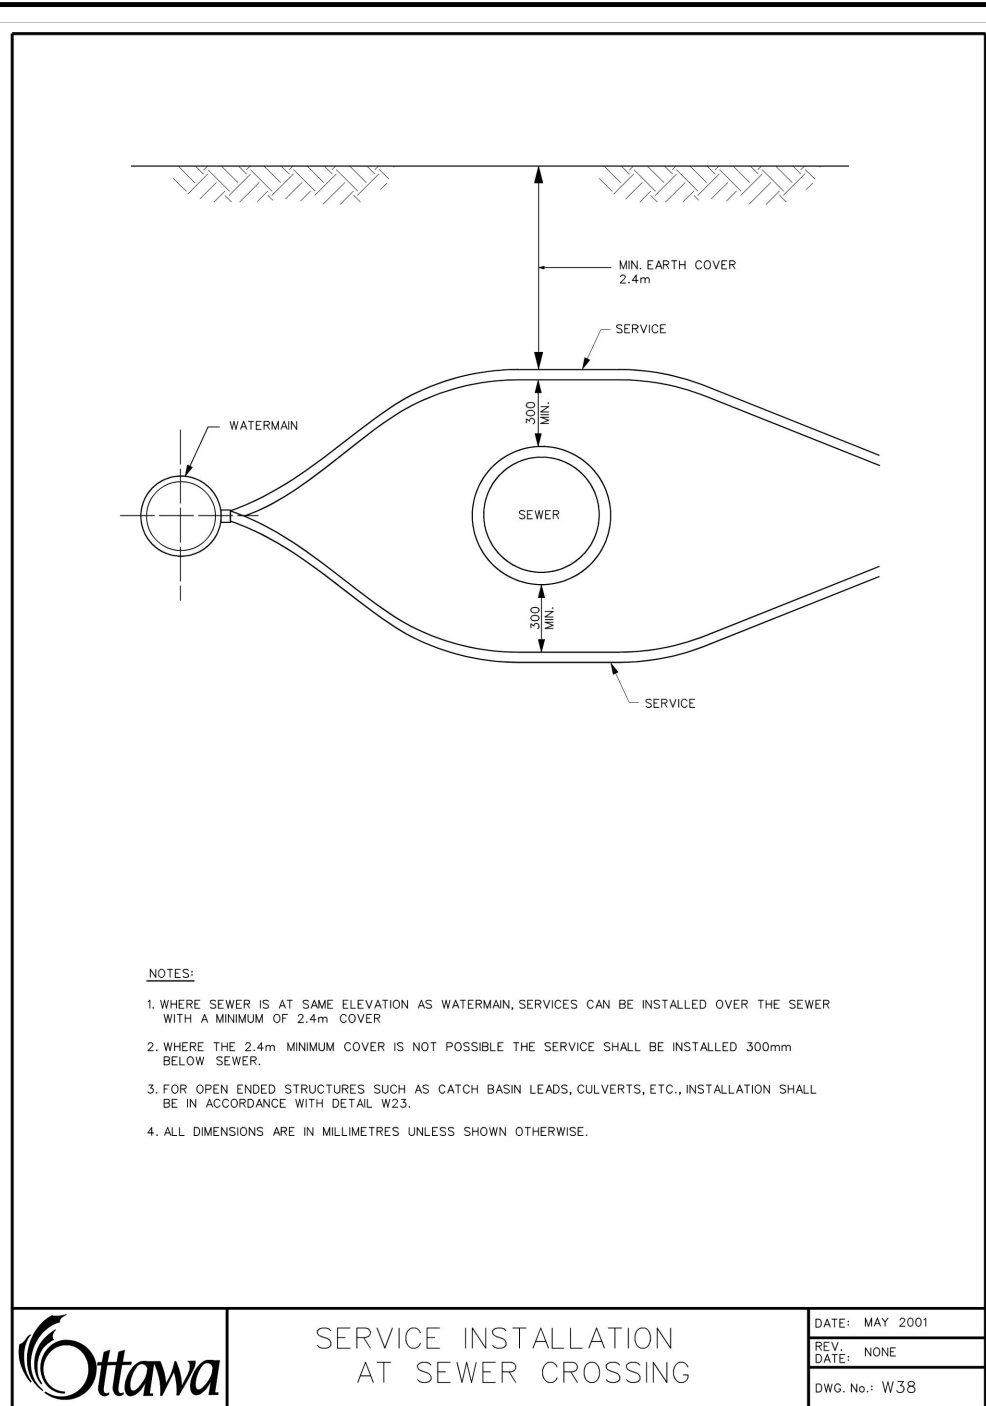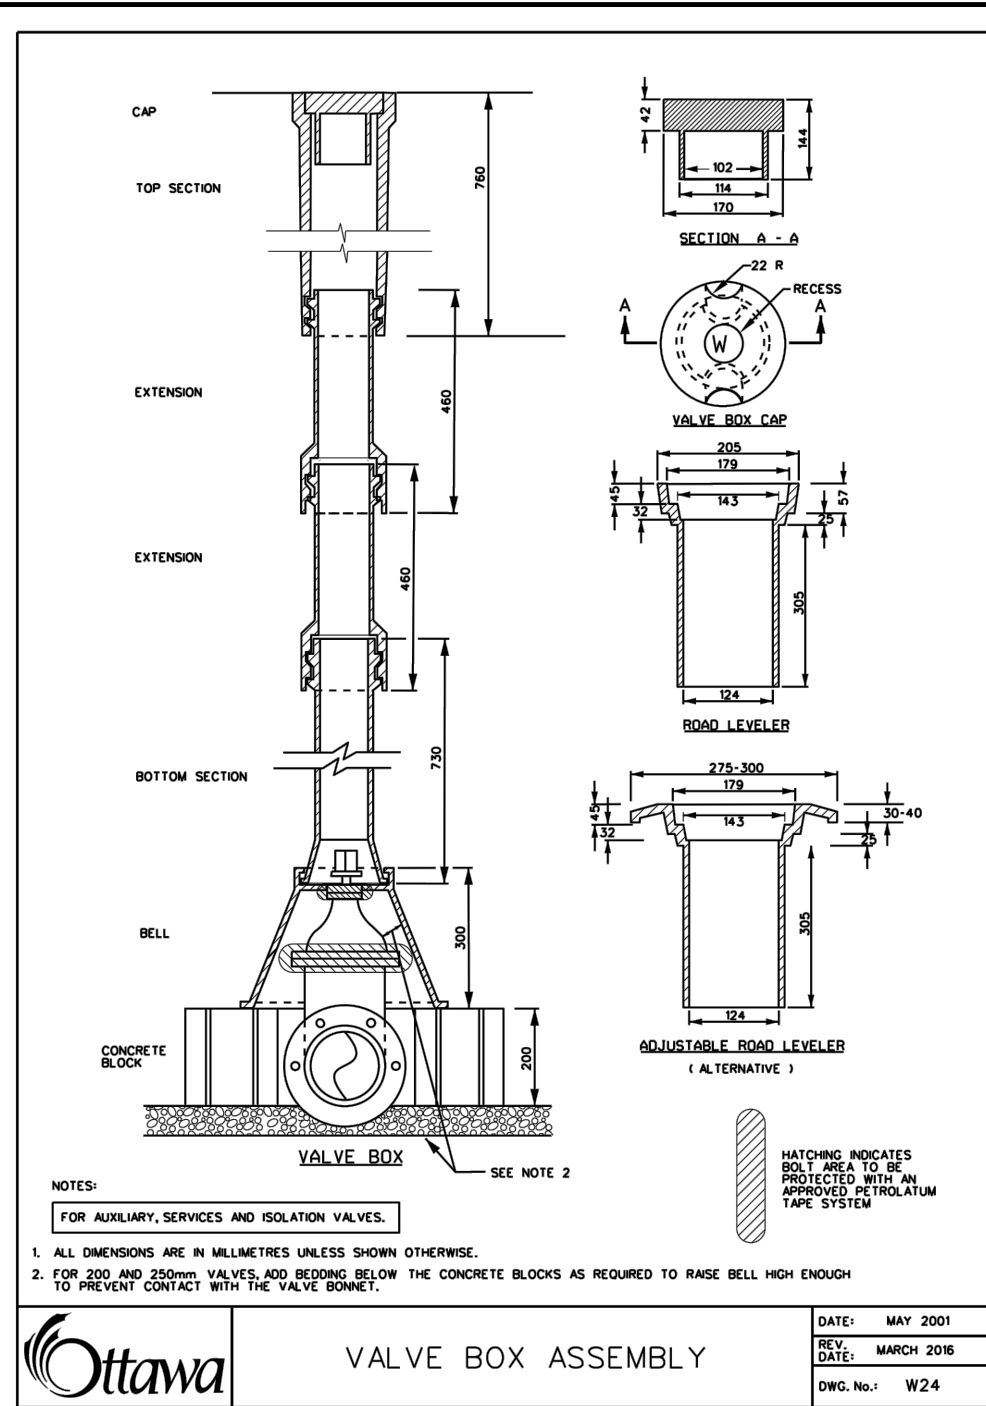

ORIFICE FLOW CONTROL PLATE DETAIL

NTS





250mm Ø PVC STORM PIPE
INV. 85.37
50mm

64mm Ø ORIFICE
INVERT 85.37

WATERTIGHT SEAL BETWEEN PLATE AND STM CBMH02

MANHOLE TABLE

STORM		
MH Number	Size	Cover
STM CBMH01	1500mm	\$28.1
STM CBMH02	1500mm	\$28.1
STM CBMH03	1500mm	\$28.1
STM CBMH04	1500mm	\$28.1
AD01	SEE MECHANICAL DRAWINGS	
AD02	SEE MECHANICAL DRAWINGS	
AD03	SEE MECHANICAL DRAWINGS	
SANITARY		
MH Number	Size	Cover
MHA	1200mm	\$24

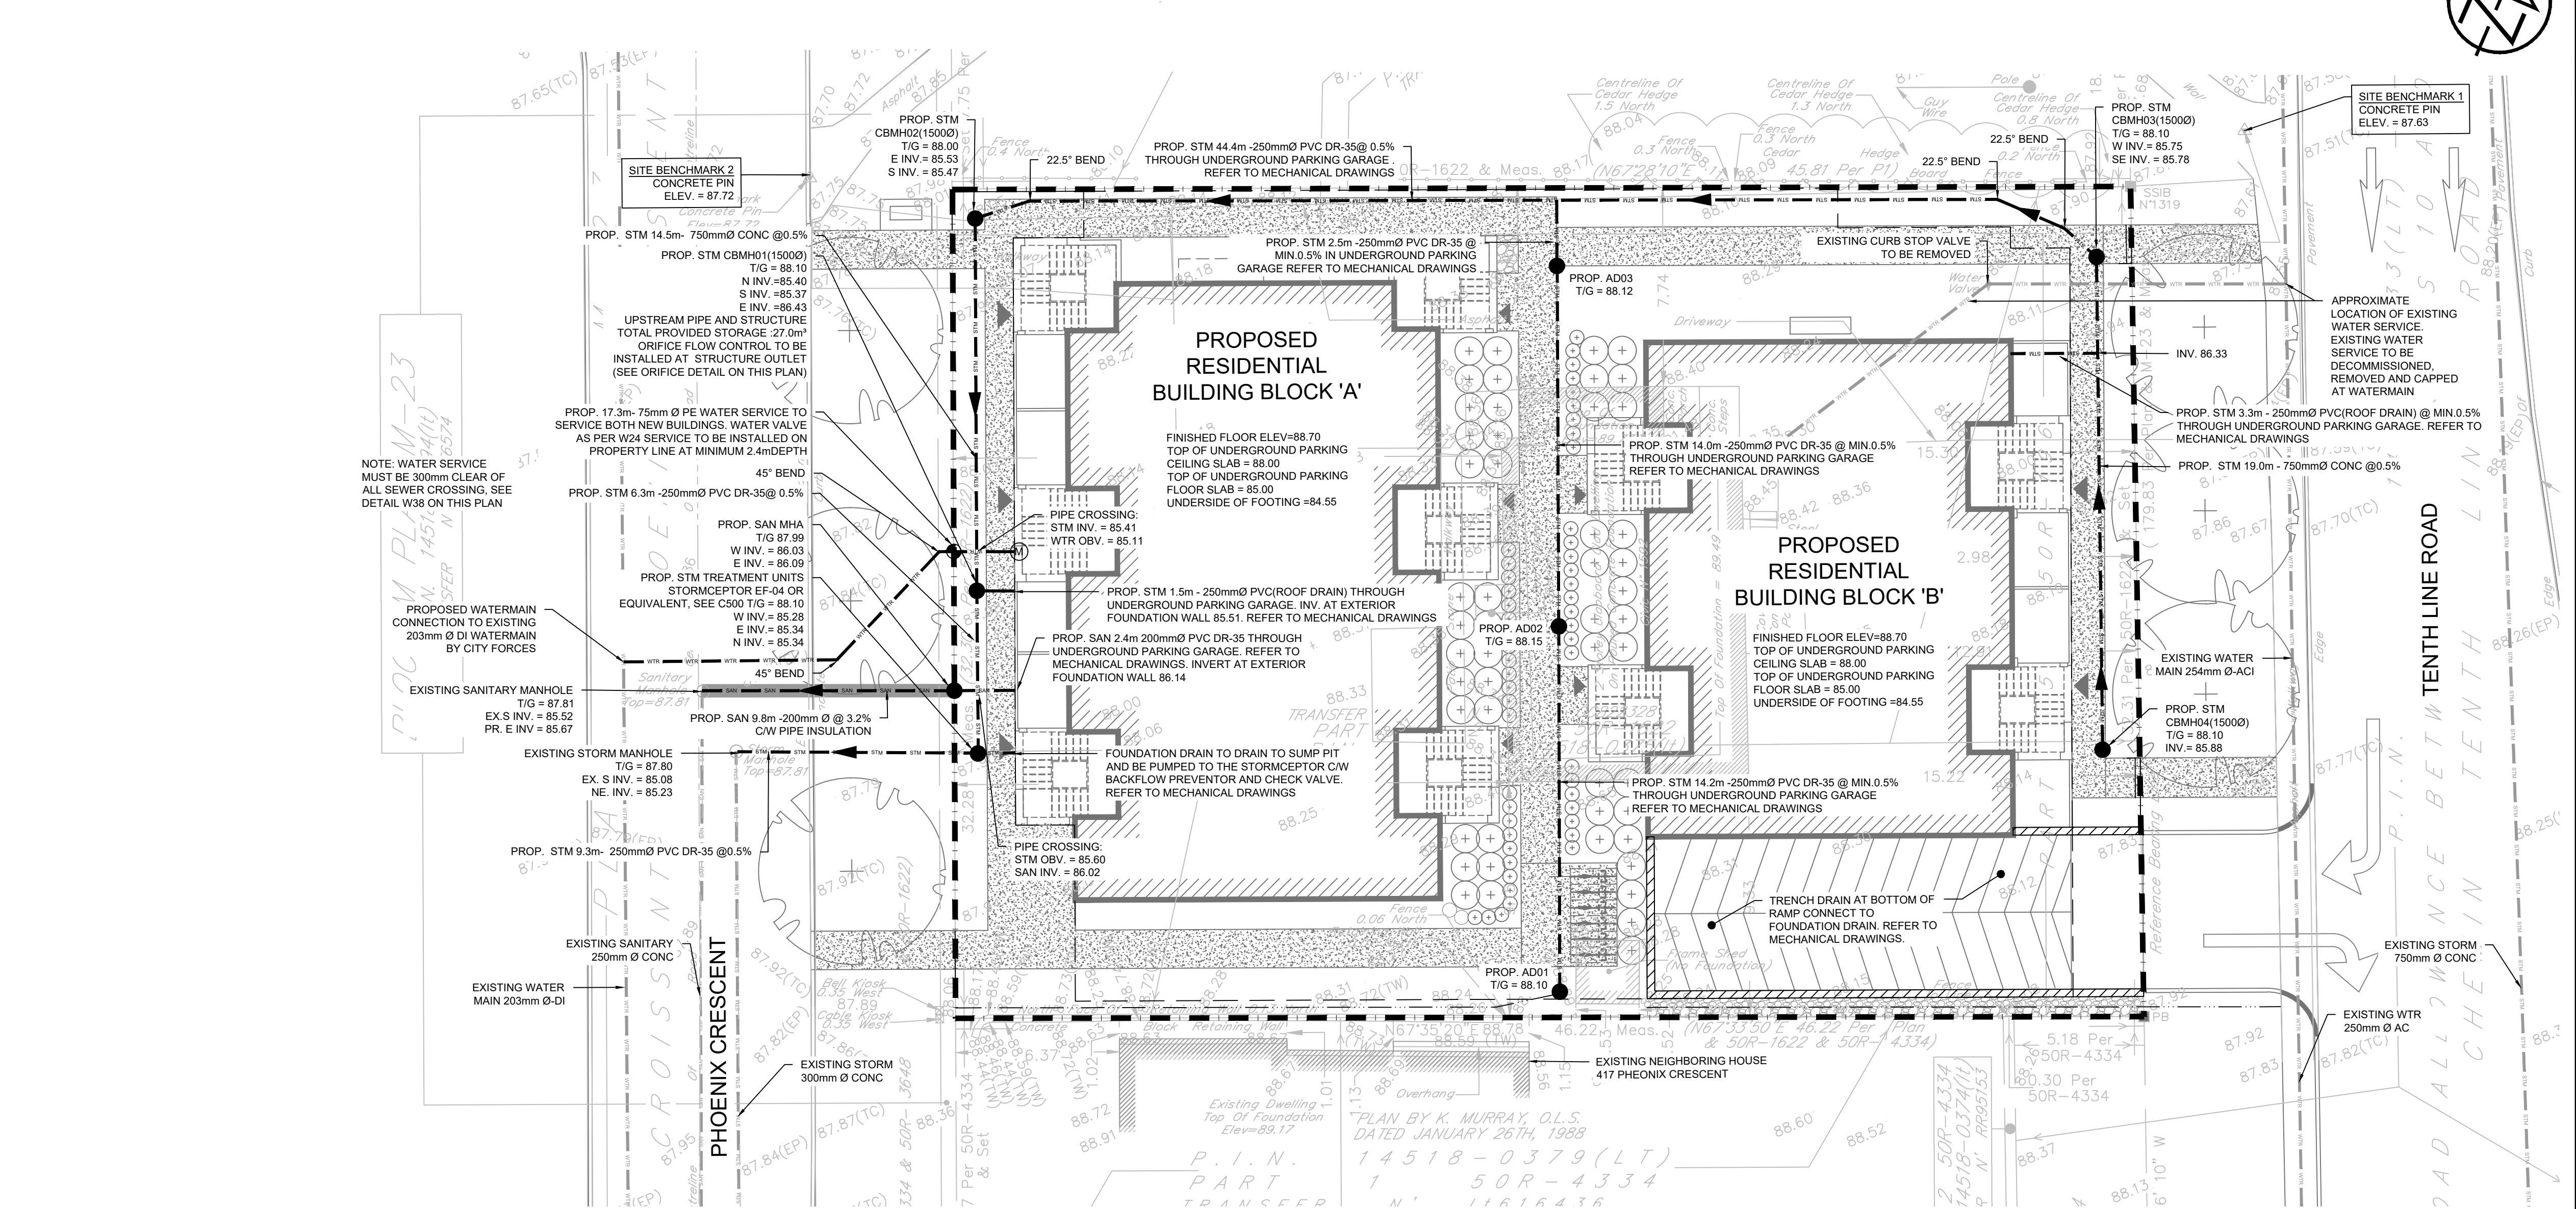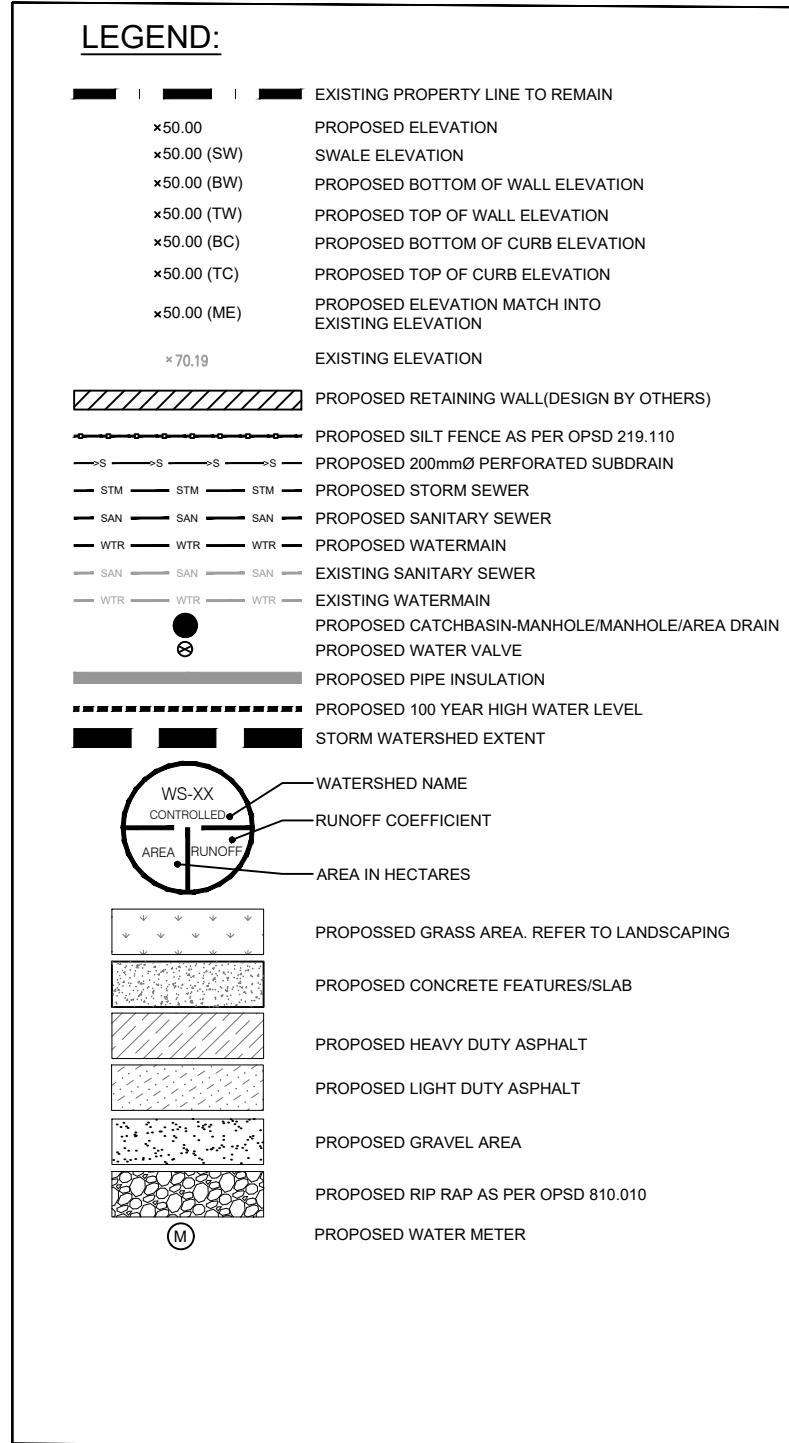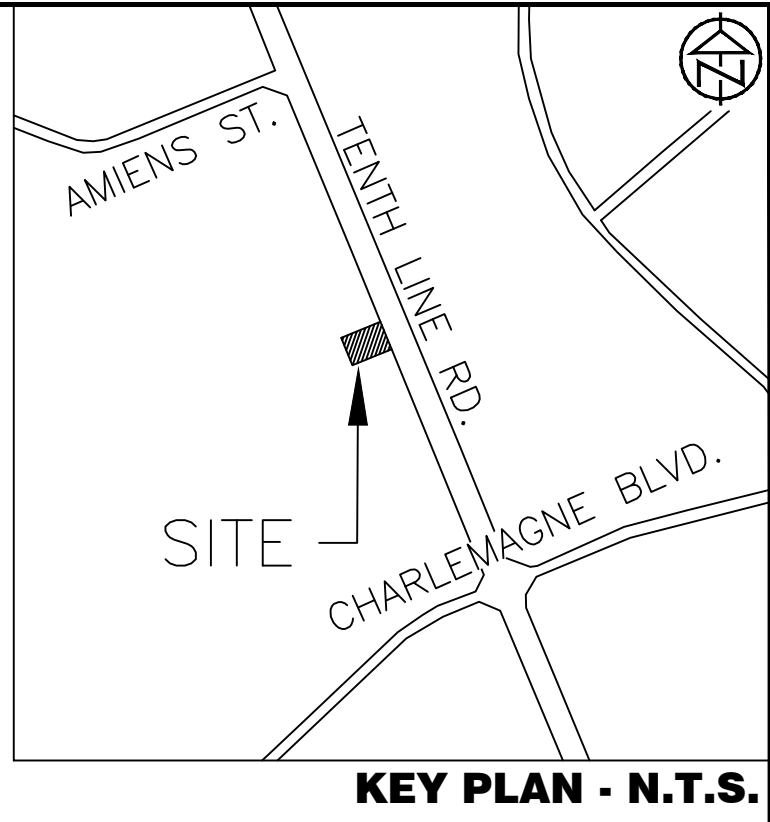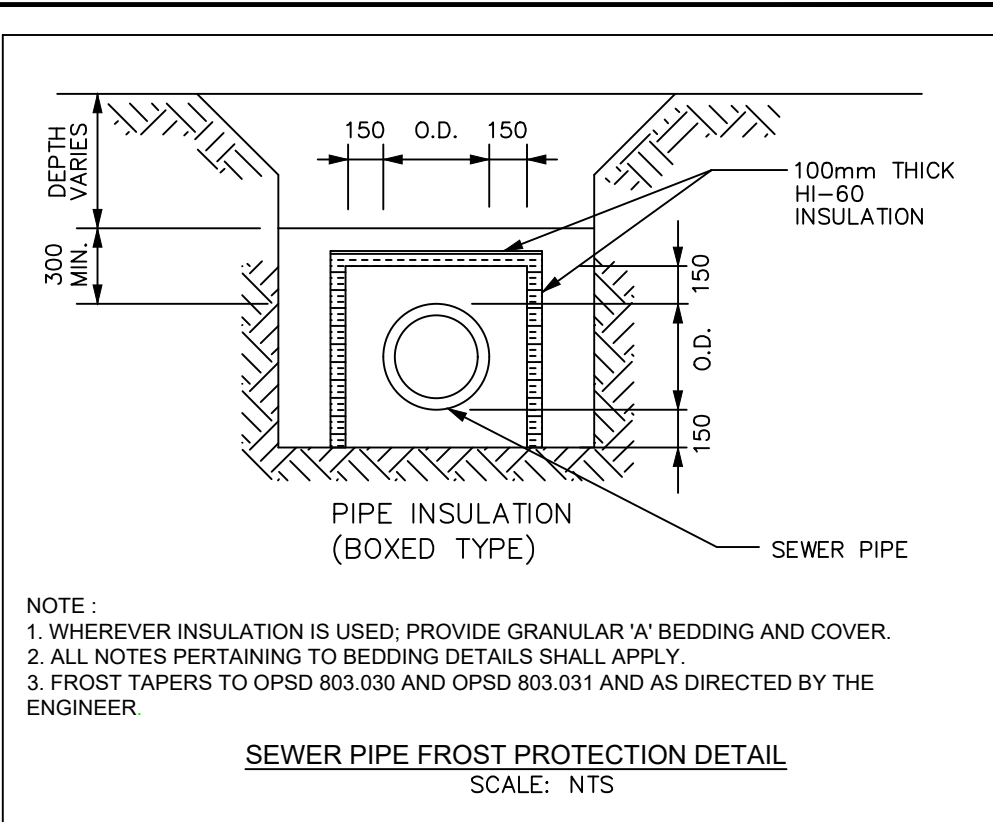

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

LEGAL AND TOPOGRAPHIC SURVEY COMPLETED BY
ARPENTAGE DUTRISAC SURVEYING INC.

BENCHMARK1: CONCRETE PIN LOCATED ON NORTH EAST CORNER OF THE SITE, ELEVATION: 87.63

BENCHMARK2: CONCRETE PIN LOCATED ON NORTH WEST CORNER OF THE SITE, ELEVATION: 87.72

No.	REVISION DESCRIPTION	DATE
1.	ISSUED FOR SPA	DEC. 2022
2.	AS PER ARCHITECT'S COMMENTS	DEC. 2022

ENGINEER STAMP



BRIDOR DEVELOPMENTS
1592 TENTH LINE ROAD
CITY OF OTTAWA



SITE SERVICING PLAN

TATHAM
ENGINEERING

DESIGN: HY/GC	FILE: 522677	DWG:
DRAWN: HY	DATE: NOV 2022	C300
CHECK: GC	SCALE: 1:150	

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED ELEVATION
- SWALE ELEVATION
- PROPOSED BOTTOM OF WALL ELEVATION
- PROPOSED TOP OF WALL ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- PROPOSED ELEVATION MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED RETAINING WALL (DESIGN BY OTHERS)
- PROPOSED SILT FENCE AS PER OPSD 219.110
- PROPOSED 200mm PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- PROPOSED CATCH BASIN-MANHOLE/AREA DRAIN
- PROPOSED WATER VALVE
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES
- PROPOSED GRASS AREA, REFER TO LANDSCAPING
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED GRAVEL AREA
- PROPOSED RIP RAP AS PER OPSD §10.010
- PROPOSED WATER METER

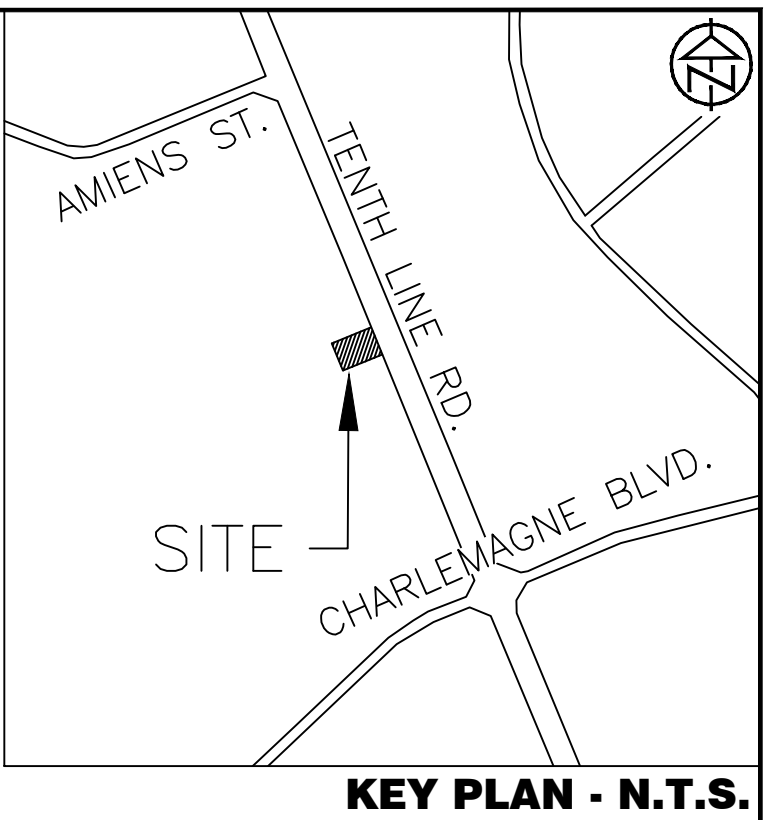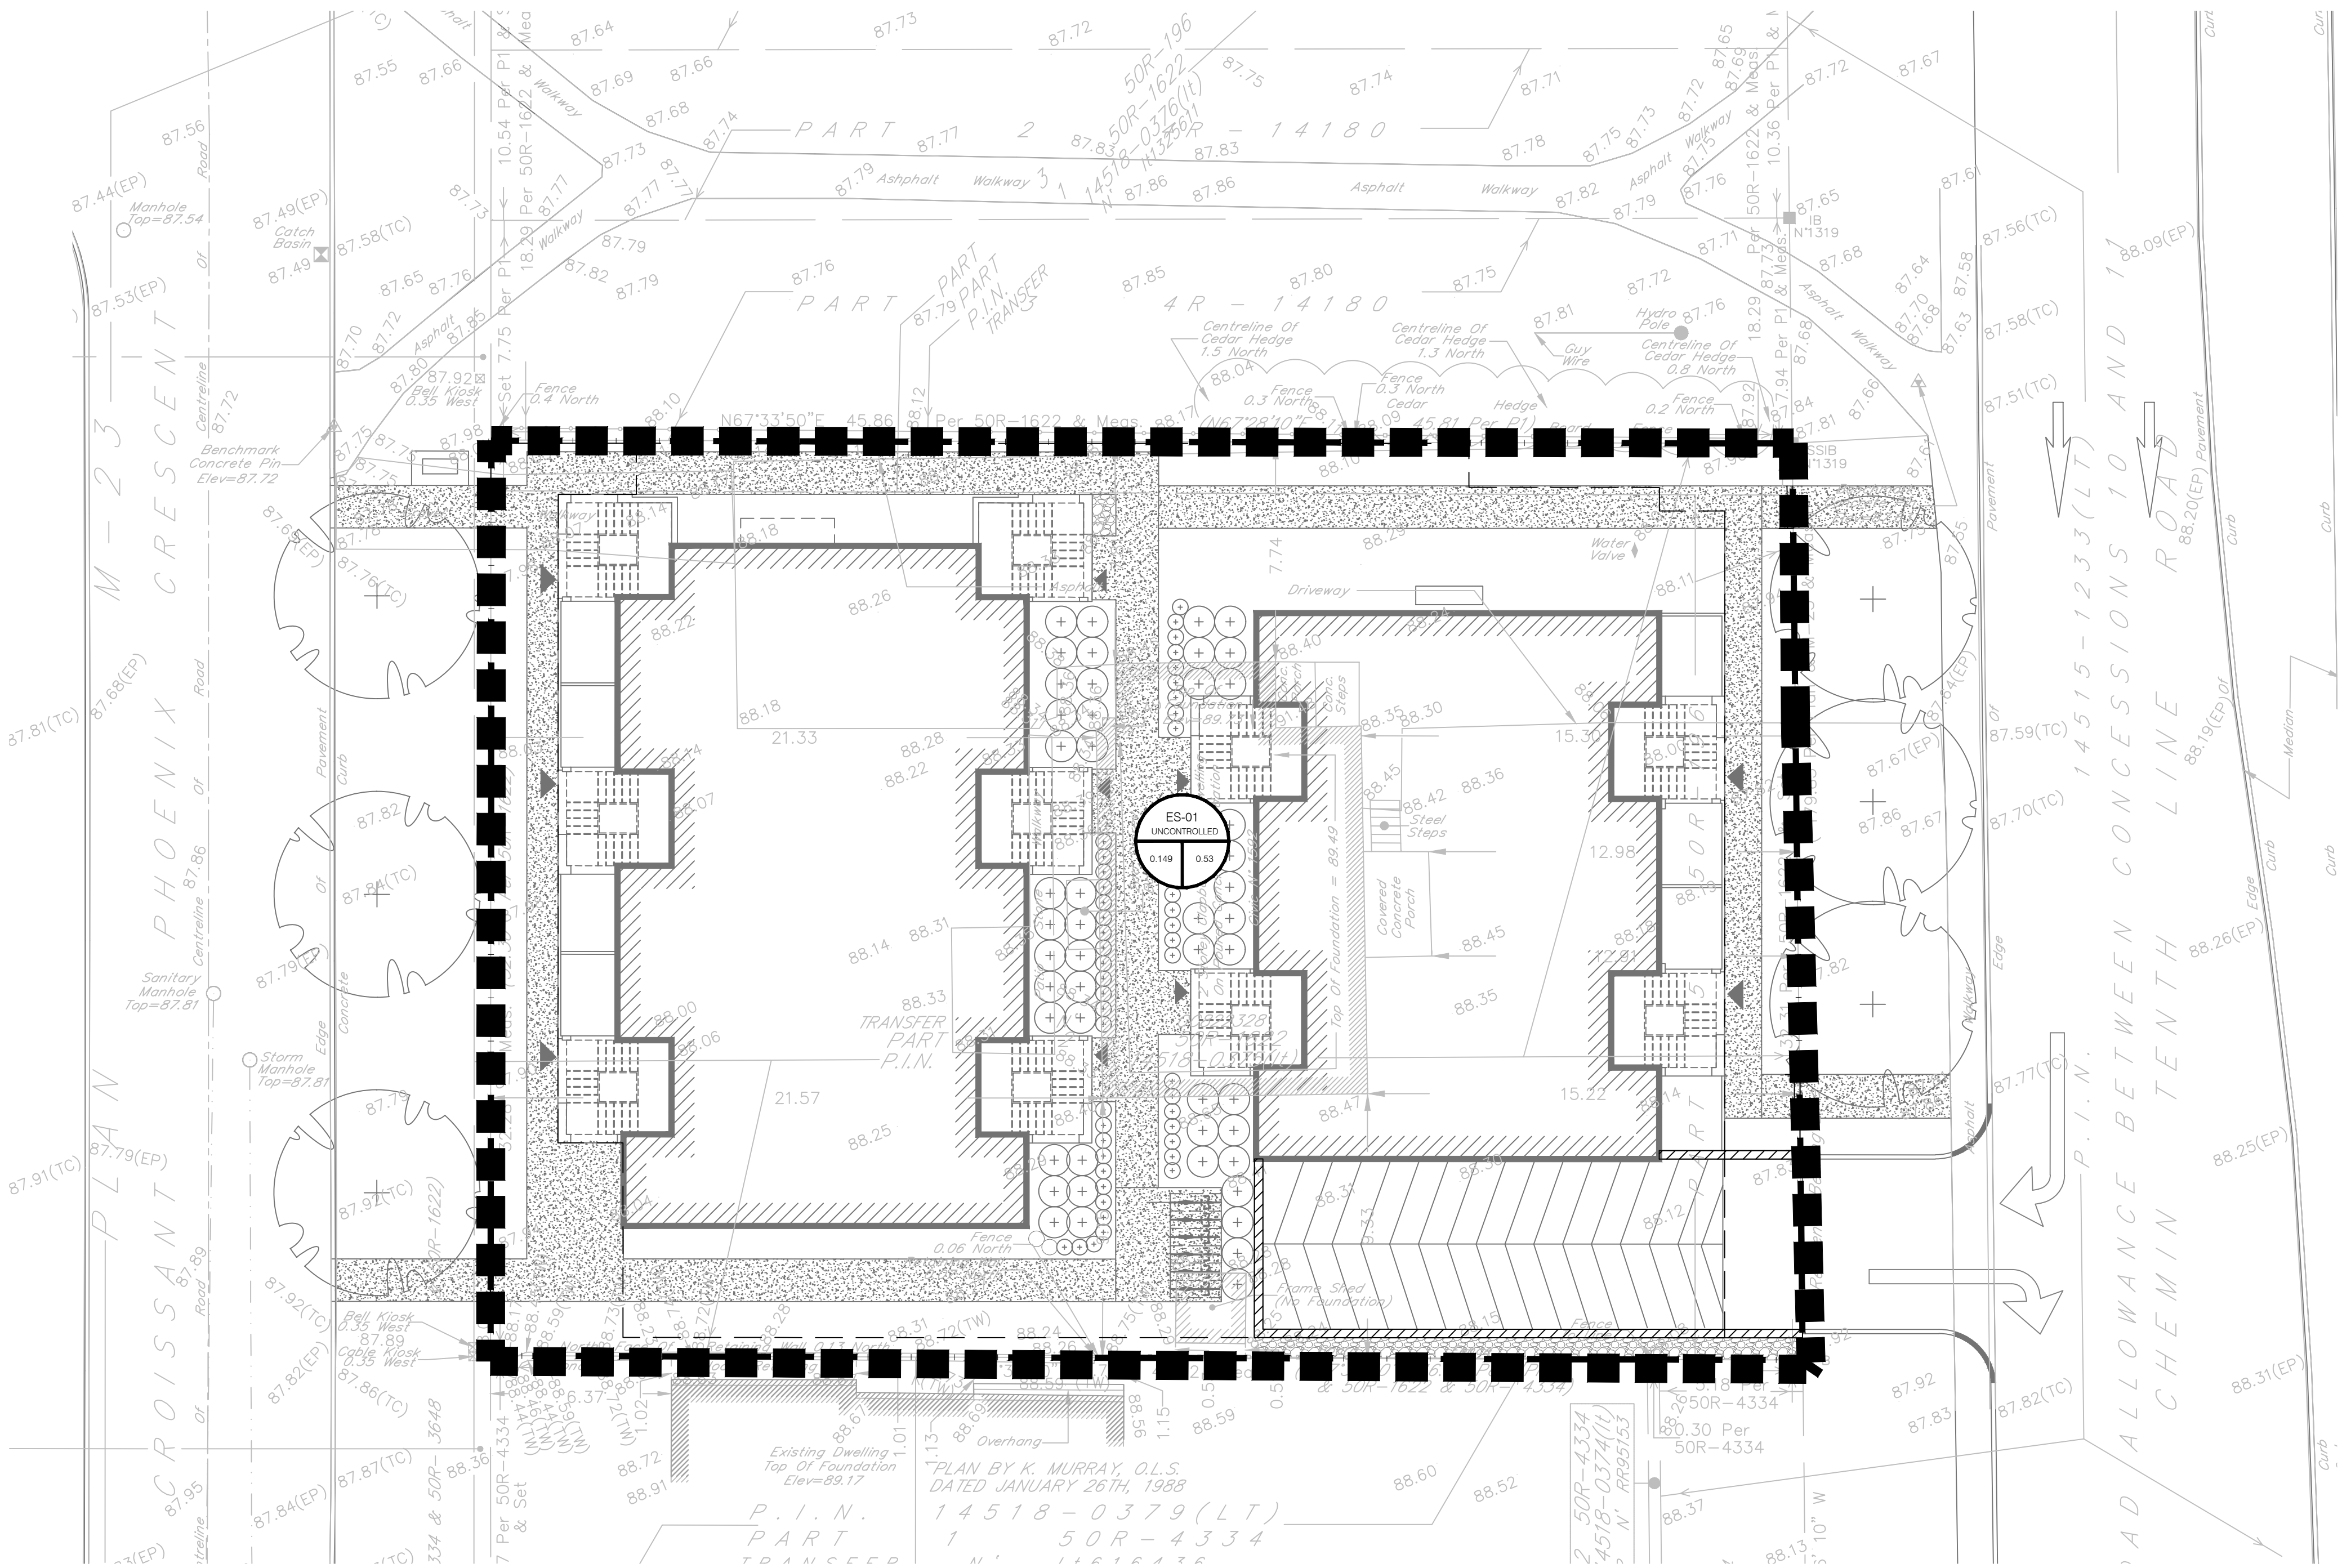

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

LEGAL AND TOPOGRAPHIC SURVEY COMPLETED BY ARPENTAGE DUTRISAC SURVEYING INC.

BENCHMARK1: CONCRETE PIN LOCATED ON NORTH EAST CORNER OF THE SITE, ELEVATION: 87.63

BENCHMARK2: CONCRETE PIN LOCATED ON NORTH WEST CORNER OF THE SITE, ELEVATION: 87.72

No.	REVISION DESCRIPTION	DATE
1.	ISSUED FOR SPA	DEC. 2022
2.	AS PER ARCHITECT'S COMMENTS	DEC. 2022

ENGINEER STAMP

LICENSED PROFESSIONAL ENGINEER

J. R. ASH

100123062

PROVINCE OF ONTARIO

BRIDOR DEVELOPMENTS

1592 TENTH LINE ROAD

CITY OF OTTAWA

PRE-DEVELOPMENT DRAINAGE PLAN

TATHAM ENGINEERING

DESIGN: HY/GC

FILE: 522677

DWG: C400

DRAWN: HY



DATE: NOV 2022

CHECK: GC

SCALE: 1:150

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
- PROPOSED ELEVATION
- PROPOSED SWALE ELEVATION
- PROPOSED BOTTOM OF WALL ELEVATION
- PROPOSED TOP OF WALL ELEVATION
- PROPOSED BOTTOM OF CURB ELEVATION
- PROPOSED TOP OF CURB ELEVATION
- PROPOSED ELEVATION MATCH INTO EXISTING ELEVATION
- EXISTING ELEVATION
- PROPOSED RETAINING WALL (DESIGN BY OTHERS)
- PROPOSED SILT FENCE AS PER OPSD 218.110
- PROPOSED 200mmØ PERFORATED SUBDRAIN
- PROPOSED STORM SEWER
- PROPOSED SANITARY SEWER
- PROPOSED WATERMAIN
- EXISTING SANITARY SEWER
- EXISTING WATERMAIN
- PROPOSED CATCHBASIN-MANHOLE/AREA DR
- PROPOSED WATER VALVE
- PROPOSED PIPE INSULATION
- PROPOSED 100 YEAR HIGH WATER LEVEL
- STORM WATERSHED EXTENT
- WATERSHED NAME
- RUNOFF COEFFICIENT
- AREA IN HECTARES
- PROPOSED GRASS AREA, REFER TO LANDSCAPING
- PROPOSED CONCRETE FEATURES/SLAB
- PROPOSED HEAVY DUTY ASPHALT
- PROPOSED LIGHT DUTY ASPHALT
- PROPOSED GRAVEL AREA
- PROPOSED RIP RAP AS PER OPSD 810.010
- PROPOSED WATER METER

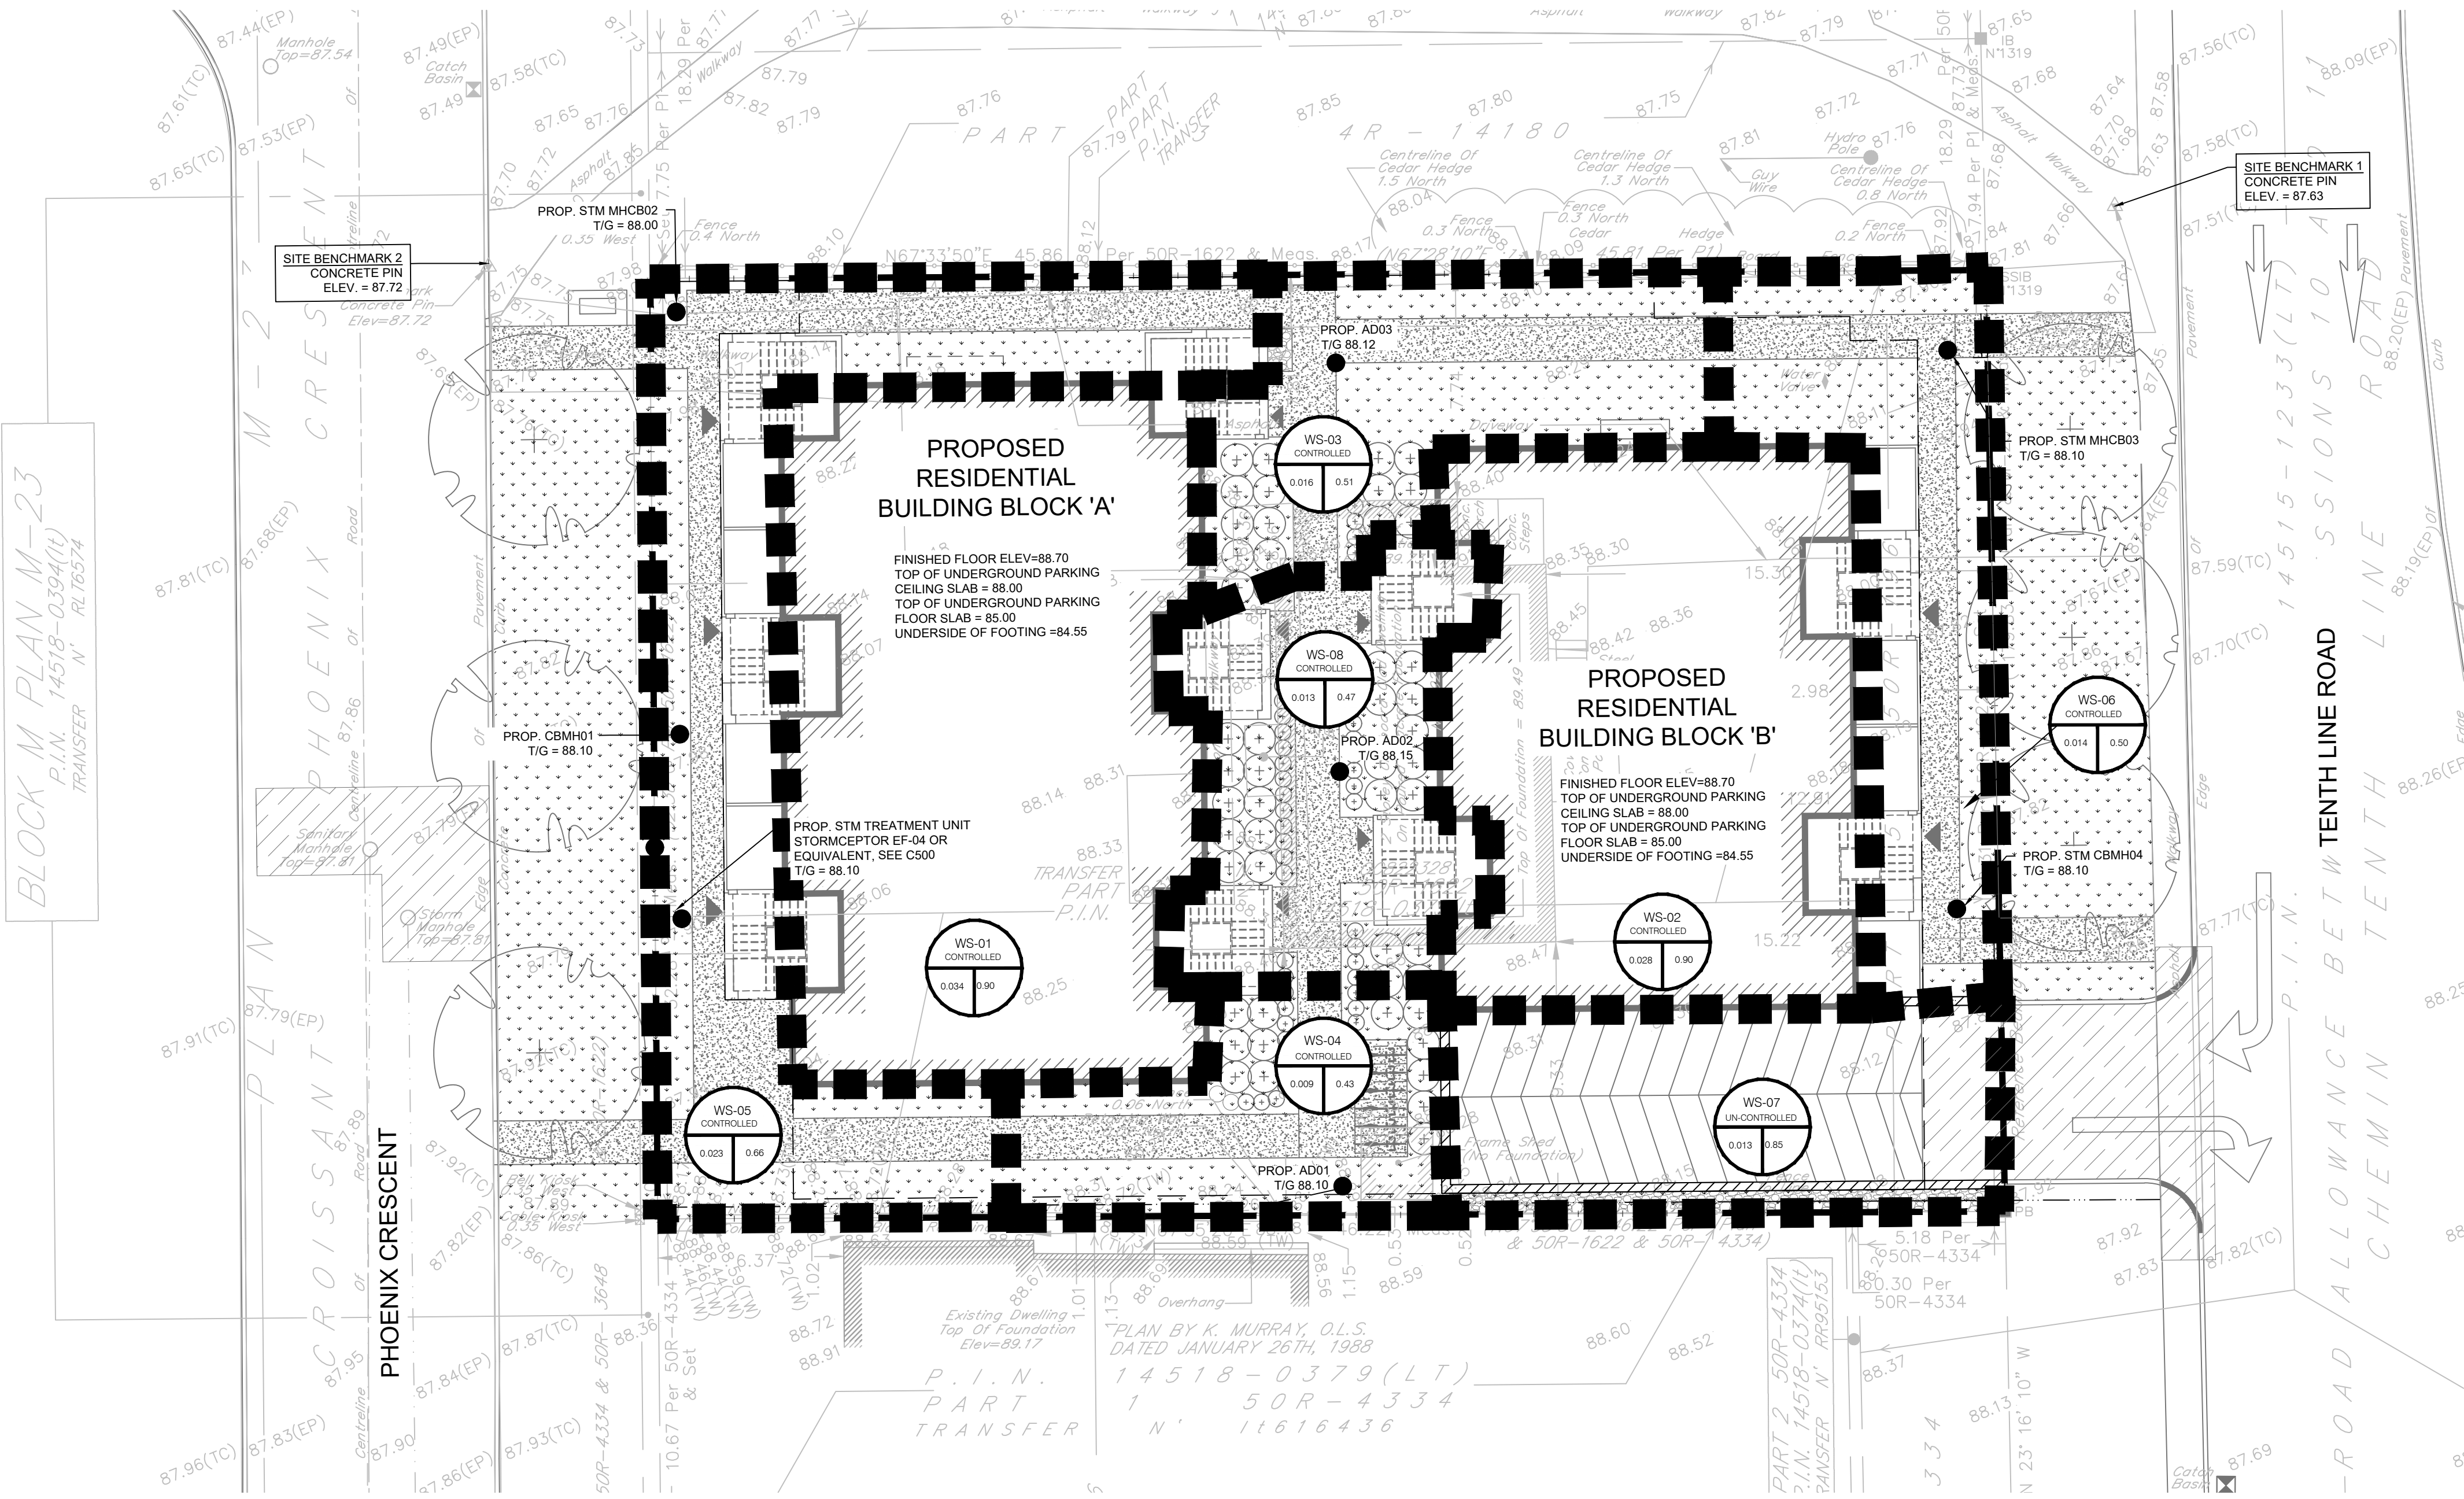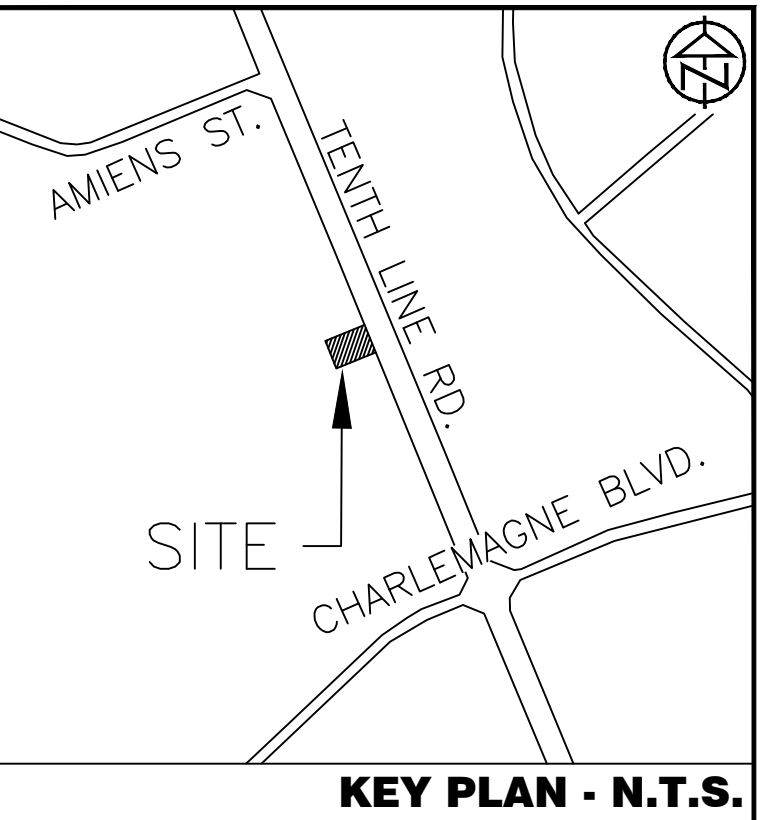

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

LEGAL AND TOPOGRAPHIC SURVEY COMPLETED BY ARPEPAGE DUTRISAC SURVEYING INC.

BENCHMARK1: CONCRETE PIN LOCATED ON NORTH EAST CORNER OF THE SITE, ELEVATION: 87.63

BENCHMARK2: CONCRETE PIN LOCATED ON NORTH WEST CORNER OF THE SITE, ELEVATION: 87.72


No.	REVISION DESCRIPTION	DATE	ENGINEER STAMP
1.	ISSUED FOR SPA	DEC. 2022	
2.	AS PER ARCHITECT'S COMMENTS	DEC. 2022	

BRIDOR DEVELOPMENTS
1592 TENTH LINE ROAD
CITY OF OTTAWA


POST DEVELOPMENT
DRAINAGE PLAN

TATHAM
ENGINEERING

DESIGN: HY/GC	FILE: 522677	DWG:
DRAWN: HY	DATE: NOV 2022	C401
CHECK: GC	SCALE: 1:150	

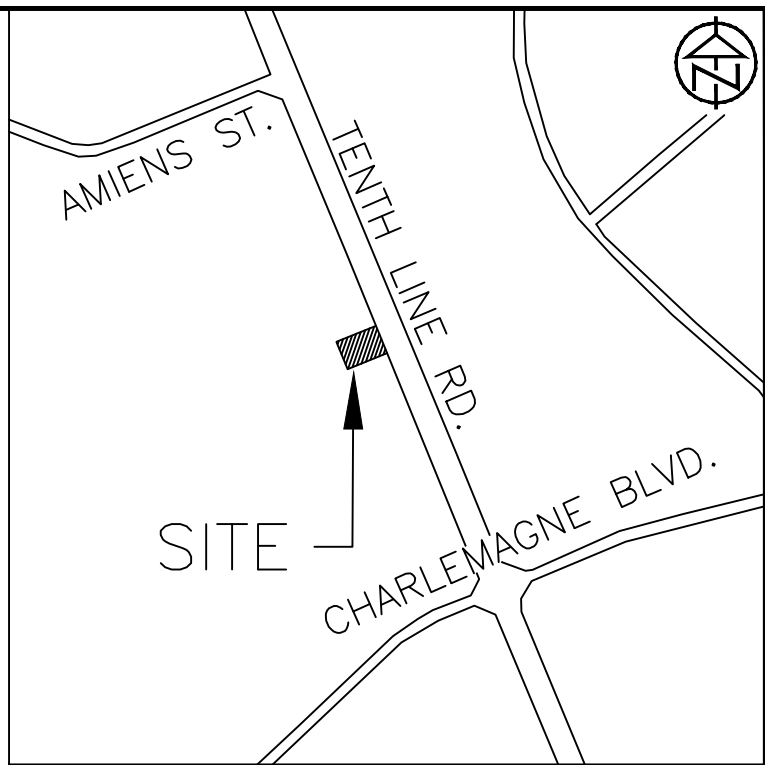

KEY PLAN - N.T.S.

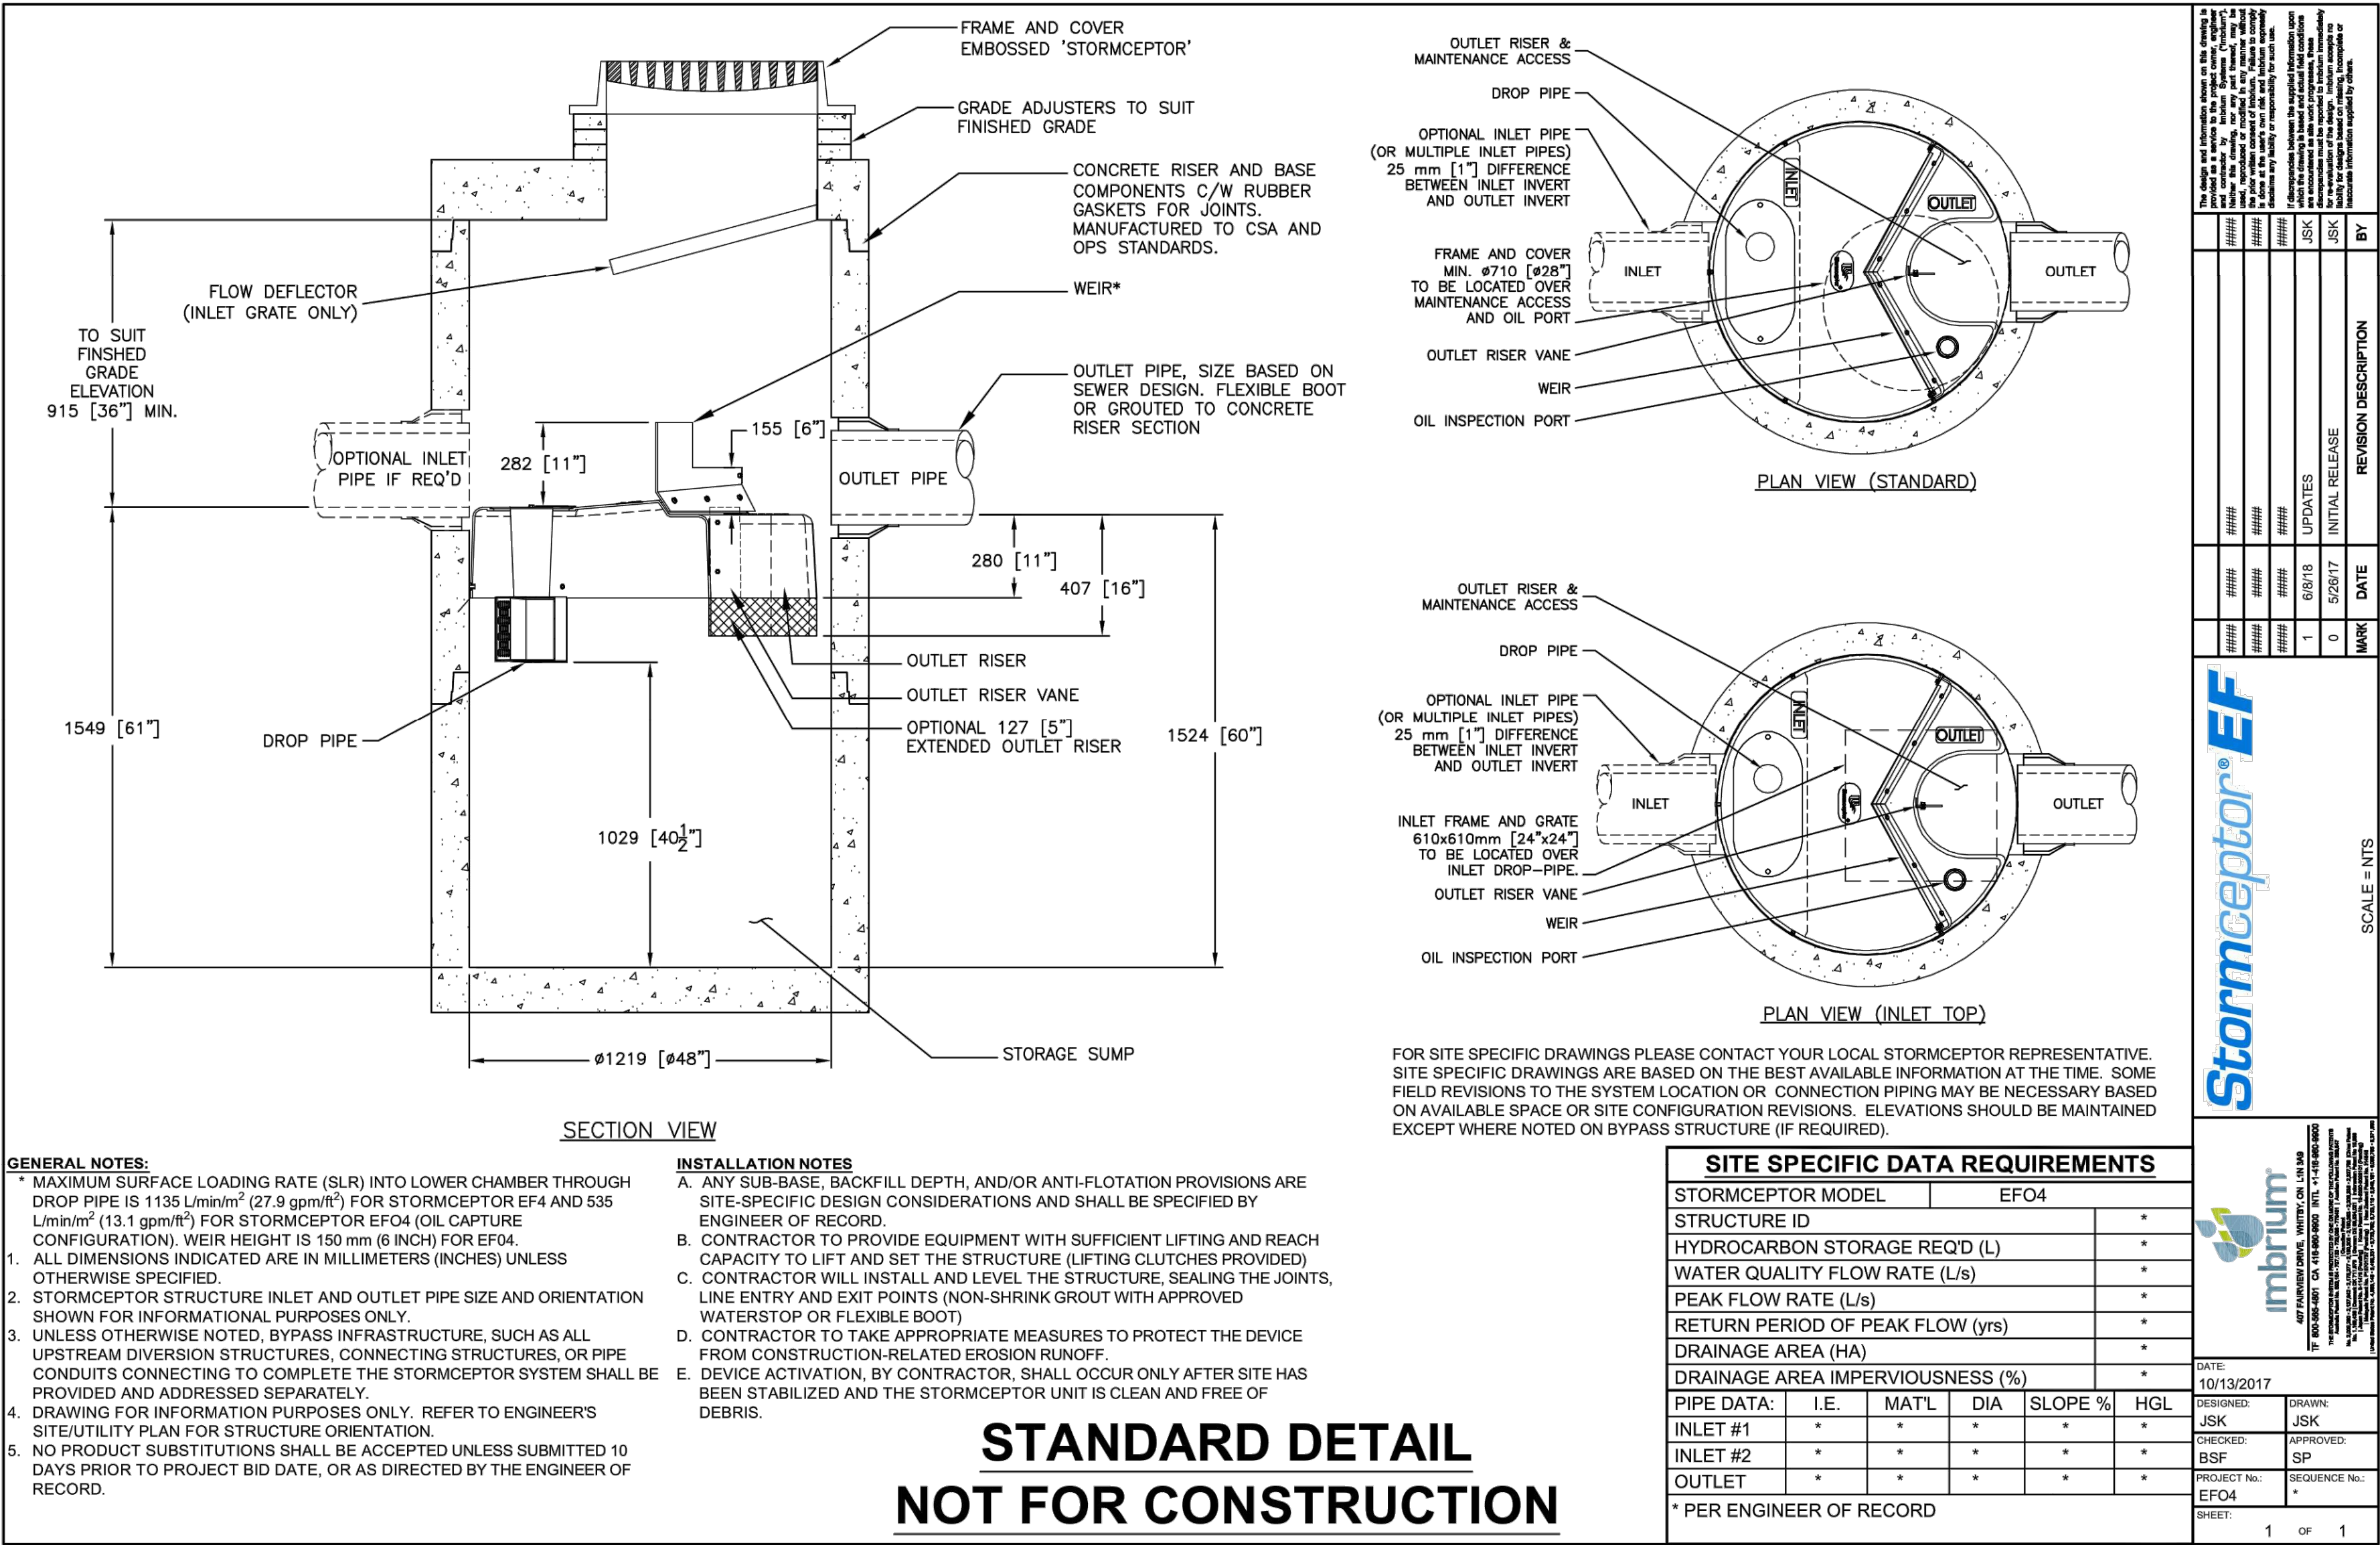

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

LEGAL AND TOPOGRAPHIC SURVEY COMPLETED BY ARPENTAGE DUTRISAC SURVEYING INC.

BENCHMARK1: CONCRETE PIN LOCATED ON NORTH EAST CORNER OF THE SITE, ELEVATION: 87.83

BENCHMARK2: CONCRETE PIN LOCATED ON NORTH WEST CORNER OF THE SITE, ELEVATION: 87.72

No.	REVISION DESCRIPTION	DATE
1.	ISSUED FOR SPA	DEC. 2022
2.	AS PER ARCHITECT'S COMMENTS	DEC. 2022

ENGINEER STAMP



BRIDOR DEVELOPMENTS
1592 TENTH LINE ROAD
CITY OF OTTAWA

DETAILS



DESIGN: HY/GC	FILE: 522677	DWG: C500
DRAWN: HY	DATE: NOV 2022	
CHECK: GC	SCALE: 1:150	

**Appendix G:
BL Engineering Site Servicing and
SWM Report
(June 14, 2022)**

SITE SERVICING AND STORMWATER MANAGEMENT REPORT

Project Address – 1592 Tenth Line Road, Orleans On

Owner/Client: Bridor Developments
Address: 996-B St-Augustin Rd, Embrun ON
City file Number:

By Blanchard Letendre Engineering Ltd.
Revision Date – June 14, 2022
Our File Reference: 20-261

First Submission
November 19, 2020

TABLE OF CONTENTS

Table of Contents.....	2
Appendix Table.....	3
1.0 Introduction.....	4
2.0 Site Plan	4
3.0 STORM WATER MANAGEMENT.....	5
3.1 Existing Site Condition	5
3.2 Proposed Storm Water Management.....	5
3.3 Proposed Storm Water Management.....	5
3.4 Proposed Stormwater Quantity Control	6
3.4.1 Roof Drainage	7
3.4.1 Underground Parking Garage	7
3.5 Proposed Stormwater Quality Control.....	7
4.0 SANITARY SEWER DESIGN	7
4.1 Existing Site Conditions	7
4.2 Existing Site Conditions	7
5.0 WATER CONNECTION DESIGN.....	8
5.1 Existing Site Conditions	8
5.2 Proposed Domestic Water Service.....	8
5.3 Proposed Fire Demand.....	8
5.4 Water Capacity Comments	9
6.0 EROSION AND SEDIMENT CONTROL	9
7.0 CONCLUSION AND LIMITATION OF REPORT	9
7.1 Stormwater Management.....	9
7.2 Sanitary Service	9
7.3 Water Service.....	9
8.0 Limitation.....	10

APPENDIX TABLE

Appendix A – Stormwater Design

Appendix B – Sanitary Design

Appendix C – Watermain Design

Appendix D – Stormwater Underground Chamber & Stormwater Treatment Unit

Appendix E – Boundary Conditions

Appendix F – Engineering Drawings

1.0 INTRODUCTION

Blanchard Letendre Engineering Ltd. (BLEL) was retained by Bridor Developments. to complete their site servicing and stormwater management for the new proposed site located at 1592 Tenth Line in Orleans. This report summarized proposed site servicing and stormwater management and should be read in conjunction with the engineering drawings prepare by BLEL.

This report and site servicing plan have been prepared based on the site plan proposed by P-Square Concepts and the site survey completed by ADSI Arpentage Dutrisac Surveying Inc. The information contained herein is based on the provided drawings and if there is any discrepancy with the survey or site plan, BLEL should be informed in order to verify the information and complete the changes if required.

2.0 SITE PLAN

The proposed site is to be located at 1592 Tenth Line in Orleans, Ontario. As per the aerial picture in figure 1, the existing site (0.149ha) consist of an existing house with a paved entrance to Tenth Line and some green space area. The existing building will be demolished prior to construction. The land will be developed with a new apartment building with a new underground parking garage.



Figure 1- Existing site at 1592 Tenth Line, Orleans, Ontario

3.0 STORM WATER MANAGEMENT

3.1 Existing Site Condition

The existing site currently has an existing residential home with an access driveway off Tenth Line. The existing property has a split drainage where half the property drains towards Tenth Line and the other portion towards Phoenix Crescent. The property is bounded by residential homes and a commercial development east of Tenth Line. Refer to BL Engineering drawing C400 for the pre-development drainage area and existing grading showing the current drainage of the site.

3.2 Proposed Storm Water Management

The development of the site will consist of adding two residential apartment building which will combine a total of thirty (27) residential units with a connecting underground parking garage. The site will be modified by adding a total of 566 square meter building, asphalt area and amenities. As the runoff coefficient will increase due to addition of hard surfaces, post-development stormwater quantity and quality will be implemented.

The site stormwater management has been prepared in correlation with the existing site grading and proposed underground parking garage. The property has a split drainage where a portion drains east towards Tenth Line whereas the west portion drains west towards Phoenix Crescent. The affected area stormwater management will outlet to City storm sewer on Phoenix Crescent and the overland flow route was designed to convey the storm runoff towards the city right away.

The stormwater generated by the new hard surfaces will be directed to a series of catchbasins which will capture and convey the water runoff to the existing city storm sewer on Phoenix Crescent. The catchment areas have been delineated as per the proposed grading plan. Refer to Appendix 'A', for the catchment area and runoff coefficient. In order to respect the 5 year pre-development allowable release rate, the outlets will be controlled by an orifice plate installed in the downstream storm pipe in CBMH03 and limit the flow outletting to City storm sewer on Phoenix. By throttling the flow, stormwater retention will be completed with the use of underground pipe storage which was designed to hold the 100 year storm event. Refer to Appendix 'A' for the stormwater flow and storage calculations.

3.3 Proposed Storm Water Management

The pre-development flow of the 5-year storm was calculated using a 5-year storm and a 10-minute time of concentration for the affected area. The pre-development flow of the 100-year storm was calculated using a 5-year storm and a 10-minute time of concentration for the affected area. From the intensity duration curves established for the Ottawa area, the intensity was evaluated at of 104.2 mm/hr for the 5yr predevelopment flow and 178.6mm/hr for the 100-year predevelopment flow.

A run-off coefficient of 0.50 was used as per the city of Ottawa design Guidelines, see Appendix 'A' – Pre-Development Drainage Area table.

Using the Rational Method and considering the tributary areas of the affected area by the proposed (see Appendix 'A'), the pre-development allowable release rate for the site was evaluated at **21.52 L/s**. See also the Storm Sewer Design Sheet in Appendix 'A'.

$$\begin{aligned}\text{Allowable Release Rate (Q)} &= 2.78CIA \text{ (L/s)} \\ I_s &= 998.071 / (T_c + 6.053)^{0.814} \\ C &= 0.50 \\ I &= 104.2 \text{ mm/hr} \\ T_c &= 10 \text{ min} \\ \text{Total} &= 0.149 \text{ ha} \\ \text{Allowable Release Rate} &= 21.52 \text{ L/s}\end{aligned}$$

3.4 Proposed Stormwater Quantity Control

The proposed stormwater management for the site will be achieved primarily through the use of underground chambers storage. As most of the site will be covered with the underground parking area that will connect both buildings, a portion of the stormwater will be in the underground parking and the balance will be around the building foundation footprint. The grading of the site has been designed to direct the stormwater towards the series of catchbasins connected to the underground stormwater sewers before outleting west into the 300mm diameter storm city sewer on Phoenix Crescent. The proposed underground stormwater sewers and catchbasins are shown on the attached drawings in Appendix 'E'.

The proposed site affected area has been graded to outlet overland onto Tenth Line and Phoenix Crescent. As the site has a split drainage and that the front and rear of the property are facing city right of ways, the grades have been adjusted to suit this profile to minimize the grade raise of the site. All catchment areas were designed to direct the stormwater overland to the nearest city right of way and will be captured through a series of catchbasins.

The stormwater generated from site affected area will be discharged to the existing storm sewer on Phoenix Crescent and be controlled using an orifice plate of 64mm diameter which will throttle the flow direct to the municipal sewer. The proposed 250mm diameter pipe will release a total of **15.05 L/s** with a maximum head of 1.70m (HWL = 87.40) during the 100 year event. As the flow will be restricted, 26.62m³ of stormwater storage will be required for this area. This storage will be provided with underground stormwater chambers. The underground chamber, model MC-3500 chambers designed by ADS Pipe were designed to hold up to 37.10 m³ with a HWL of 87.40.

The ramp to the underground parking will drain into the underground parking (WS-07) catchbasins and will therefore drain uncontrolled. This uncontrolled area will generate a total flow of **6.45L/s** under the 100 year event conditions. Therefore with the outlet restriction and the provided

stormwater storage, the post-development will meet the pre-development flow to the city main storm sewer on Phoenix Crescent.

3.4.1 Roof Drainage

The proposed roofs are flat roof with roof drains. Drain and scuppers will be installed to drain the water into the storm pipes located in the underground garage.

3.4.1 Underground Parking Garage

The proposed underground parking will be drain using a series of catchbasin that will be connected to the sanitary pipe of the building. The flow that will be generated from the underground parking will consist of the ramps area hard surface and the snow/water accumulation on the cars. This flow will be direct to the sewers using and sump pump.

3.5 Proposed Stormwater Quality Control

A water quality control requirement of 80% TSS removal was set by the City of Ottawa. In order to meet the requirements, a storm treatment unit will be installed and the downstream end of the system. Using the Stormceptor sizing software, the EF04 was selected. The software generated report has been attached (See Appendix "D").

4.0 SANITARY SEWER DESIGN

4.1 Existing Site Conditions

The existing site is currently being service by an existing 135mm diameter service that is connected to the existing sanitary main on Tenth Line. The existing connection will be abandoned whereas the new connection will be completed off Phoenix Crescent that will service the new building.

4.2 Existing Site Conditions

The new apartment building, will discharge to the city via a new 150mm diameter sanitary service. The service will be located on the west side of the buildings and will discharge to the existing 250mm diameter city sewer running along Phoenix Crescent. The proposed 150mm diameter service will be installed at a minimum of 1.00% slope directly to the city sewer. A monitoring manhole is proposed for the new connections which will be installed at the property line. Refer to drawing C300 – Site Servicing Plan for the proposed sanitary service.

Based on the City of Ottawa Sanitary Design Guidelines, the sanitary peak loads were evaluated at **1.27 L/s**. As per the City specific design parameters, the sanitary flow was evaluated based on

the residential unit counts, new building footprint and the total site area. Refer to Appendix 'B' for the sanitary sewer design calculation and design parameters set by the City of Ottawa.

5.0 WATER CONNECTION DESIGN

5.1 Existing Site Conditions

The existing site is currently being service by a 19mm diameter home service which services the existing house and is connected to the existing 254mm diameter watermain on Tenth Line. The existing connection will be abandoned and capped at main, whereas the new connection will be completed off Phoenix Crescent which will service the new building. There is currently one (1) city fire hydrant on the west side of Tenth Line and two (2) fire hydrants on the west side of Phoenix that are all within the 90m radius from the building main entrance. Refer to drawing C300 – Site Servicing Plan for the existing and proposed water services and city existing infrastructure.

5.2 Proposed Domestic Water Service

The new residential apartment buildings water services were sized based on the City of Ottawa Design Guidelines and the AWWA Standards. Based on the number of fixtures proposed and on the average water demand for residential developments, the daily water consumption was evaluated for the proposed building. As per the city guidelines, the average water demand per person of **350L/p/d** was applied to the population of the new building. The daily and hourly peak factor of **2.5** and **2.2** respectively were applied to the water demand as stated in the City of Ottawa guideline. By using the average demand and peaking factors, the daily water demand for the new buildings were evaluated as follow:

		UNITS
Average Water Demand =	9.19	L/min
Maximum Daily =	22.96	L/min
Maximum Hourly =	50.53	L/min
Total Domestic Flow =	0.84	L/s
Total Fire Flow =	130.00	L/s

Refer to Appendix 'C' for the water flow calculation sheet.

5.3 Proposed Fire Demand

As the residential apartment buildings will not have a fire suppression sprinkler system, the new service was sized to supply the daily water demand. Based on the Ontario building code

calculations, the water flow was evaluated at **130.00L/s**. Refer to Appendix 'C' for the fire flow calculation sheet.

The proposed buildings will be serviced with a new 50mm water service which will connect to the existing 250mm diameter watermain on Phoenix Crescent. The new services will be installed at the west side of the new buildings and be placed in the same trench as the sanitary service.

5.4 Water Capacity Comments

The boundary conditions and HGL for hydraulic analysis for 1592 Tenth Line were obtained from the city, see attached copy in Appendix 'E'. From the boundary conditions, there is a maximum HGL of 130.2 m for the water main elevation at 87.69 m and a maximum pressure estimate of 60.4 psi.

6.0 EROSION AND SEDIMENT CONTROL

During the construction, sediment and erosion protect will be implemented around the property to prevent any sediments from leaching off site. The construction and maintenance of the sediment controls must comply with the Ontario Provision Standard Specification OPSS 577. Refer to drawing C100 – Erosion and Sediment Control for the perimeter fence proposed.

7.0 CONCLUSION AND LIMITATION OF REPORT

7.1 Stormwater Management

The stormwater management proposed for the site will maintain the site to its pre-development release rate conditions and meet the requirements from the City of Ottawa. The post development release rate of the site will be maintained to its pre-development rate of **21.52 L/s** through an orifice plate before outletting to the sewer main on Phoenix Crescent. Stormwater quantity control will be achieved with 37.10m³ underground pipes/structures. The stormwater quality control will be met through the use of a stormwater treatment unit.

7.2 Sanitary Service

The current site will be serviced with a new 150mm sanitary connection onto Phoenix Crescent. The estimated sanitary flow of **1.27 L/s** will be directed to the existing 250mm sanitary sewer along Phoenix Crescent.

7.3 Water Service

Currently the existing building on site is serviced with an existing 19mm diameter water service that will be replaced with a new 50mm diameter water service to be connected to the existing 252mm diameter main on Phoenix Crescent. The existing connection will be replaced with a new 50mm water service. The water demand for the building was evaluated at **0.94 L/s** and the fire

flow demand **130.00L/s**. Sprinkler system is not proposed for the site. There is also one (3) fire located around the property within 90m from every entrance doors.

8.0 LIMITATION

This report was prepared for **Bridor Developement.**, and is only applicable for the property at 1592 Tenth Line, Ottawa.

Any changes to the existing site may require a review by Blanchard Letendre engineering Ltd. to ensure all information is consistent with the proposed design.

Should you have any questions, please do not hesitate to contact the undersigned.

Sincerely Yours,



Guillaume Brunet, P. Eng.
Civil Engineer

APPENDIX “A”

Stormwater Management Design

File No. 20-363
Project: New Residential Development
Project Address: 1592 Tenth Line Road - Orleans
Client: Bridor Development

Date: June 14, 2022
Designed: Guillaume Brunet
Checked: Guillaume Brunet
Drawing Reference: C300

STORM WATER MANAGEMENT DESIGN SHEET
SEWER DESIGN

LOCATION			AREA (ha)			FLOW					STORM SEWER DATA							
WATERSHED / STREET	From MH	To MH	C = 0.20	C = 0.80	C = 0.90	Indiv. 2.78AC	Accum. 2.78AC	Time of Conc. (min.)	Rainfall Intensity (mm/hr)	Peak Flow Q (l/s)	Pipe Diameter (mm)	Type	Slope (%)	Length (m)	Capacity Full (L/s)	Velocity Full (m/s)	Time of Flow (min.)	Ratio (Q/Q _{FULL})
WS-02	LCB08	LCB06	0.000	0.000	0.028	0.07	0.07	10.00	104.19	7.17	250	PVC	0.25%	7.5	29.7	0.61	0.21	0.24
WS-06	LCB06	CB05	0.005	0.000	0.006	0.02	0.09	10.00	104.19	9.02	250	PVC	0.25%	18.0	29.7	0.61	0.50	0.30
WS-03	CB05	CBMH04	0.015	0.000	0.013	0.04	0.13	10.50	101.65	13.06	250	PVC	0.25%	25.0	29.7	0.61	0.69	0.44
WS-05	CBMH04	CBMH03	0.006	0.000	0.010	0.03	0.16	11.18	98.33	15.42	250	PVC	0.25%	11.0	29.7	0.61	0.30	0.52
WS-01 and WS-04	CB09	CBMH03	0.013	0.000	0.041	0.11	0.11	10.00	104.19	11.31	250	PVC	0.25%	20.0	29.7	0.61	0.55	0.38
	CBMH03	CBMH02	0.000	0.000	0.000	0.00	0.27	11.49	96.95	25.73	250	PVC	0.30%	2.0	32.6	0.66	0.05	0.79
	CBMH02	MH01	0.000	0.000	0.000	0.00	0.27	11.49	96.95	25.73	250	PVC	0.30%	8.2	32.6	0.66	0.21	0.79
	MH01	CITY	0.000	0.000	0.000	0.00	0.27	11.54	96.72	25.67	250	PVC	0.30%	9.2	32.6	0.66	0.23	0.79

DESIGN PARAMETERS NOTES

Runoff Coefficient (C)
Grass 0.2
Gravel 0.80
Asphalt / rooftop 0.90

Q = 2.78 AIC, where
Q = Peak flow in Litres per second (L/s)
A = Area in hectares (ha)
I = Rainfall Intensity (mm/hr)
C = Runoff Coefficient

Ottawa Macdonald-Cartier International Airport IDF curve
 $I_p = 998.071 / (T_c + 6.053)^{0.814}$
Min. velocity = 0.76 m/s
Manning's "n" = 0.013

File No. 20-363
Project: New Residential Development
Project Address: 1592 Tenth Line Road - Orleans
Client: Bridor Development

Date: June 14, 2022
Designed: Guillaume Brunet
Checked: Guillaume Brunet
Drawing Reference: C300

STORM WATER MANAGEMENT DESIGN SHEET
SEWER DESIGN

LOCATION		MANHOLE INFORMATION							AVAILABLE STORAGE						
From MH	To MH	Up Invert (m)	Down Invert (m)	T/G Up Stream (m)	T/G Down Stream	Up Depth obv (m)	Down Depth obv (m)	Up Depth inv (m)	Pipe Storage 5 Year (m ³)	Pipe Storage 100 year (m ³)	Upstream CB/MH Size (m)	Water Depth 5 year (m)	Water Depth 100 year (m)	CB/MH Storage 5 year (m ³)	CB/MH Storage 100 year (m ³)
LCB08	LCB05	87.90	87.60	88.50	88.08	0.35	0.23	0.35	-	-	-	-	-	-	-
LCB06	CB05	85.67	85.63	87.90	88.15	1.98	2.27	1.98	-	-	1.20	1.88	1.98	-	-
CB05	CBMH04	85.57	85.51	88.15	88.15	2.33	2.39	2.33	1.23	1.23	1.20	1.98	2.23	2.85	3.21
CBMH04	CBMH03	85.45	85.42	88.15	88.10	2.45	2.43	2.45	0.88	0.88	0.60	2.10	2.35	0.76	0.85
CB09	CBMH03	85.50	85.45	88.25	88.10	2.50	2.40	2.50	-	-	1.20	2.05	2.30	-	-
CBMH03	CBMH02	85.39	85.38	88.10	88.10	2.46	2.47	2.46	-	-	1.20	2.16	2.41	-	-
CBMH02	MH01	85.32	85.30	88.10	88.05	2.53	2.50	2.53	-	-	2.20	2.23	2.48	-	-
MH01	CITY	85.24	85.21	88.05	87.80	2.81	2.34	2.56	-	-	3.20	2.31	2.56	-	-
									0.88	0.88					

HWL (5 Year)	87.55
HWL (100 Year)	87.80
TOTAL STORAGE - 5 YEAR	1.64
TOTAL STORAGE - 100 YEAR	1.73

File No.	20-363	Date:	June 14, 2022
Project:	New Residential Development	Designed:	Guillaume Brunet
Project Address:	1592 Tenth Line Road - Orleans	Checked:	Guillaume Brunet
Client:	Bridor Development	Drawing Reference:	C300

PRE-DEVELOPMENT DRAINAGE AREA

Catchment Area	Runoff Coefficient			Total Area (ha)	Combined C
	C = 0.30	C = 0.80	C = 0.90		
E-01	0.092	0.000	0.056	0.149	0.53
TOTAL	0.092	0.000	0.056	0.149	0.53

POST-DEVELOPMENT DRAINAGE AREA

Catchment Area	Runoff Coefficient			Total Area (ha)	Combined C
	C = 0.20	C = 0.80	C = 0.90		
WS-01 - ROOF	0.000	0.000	0.034	0.034	0.90
WS-02 - ROOF	0.000	0.000	0.028	0.028	0.90
WS-03	0.015	0.000	0.013	0.028	0.53
WS-04	0.013	0.000	0.007	0.020	0.45
WS-05	0.006	0.000	0.010	0.016	0.64
WS-06	0.005	0.000	0.006	0.011	0.58
WS-07	0.001	0.000	0.012	0.013	0.85
TOTAL	0.040	0.000	0.109	0.149	0.71

RUNOFF COEFFICIENT (C)

Grass	0.20
Gravel	0.80
Asphalt / rooftop	0.90

File No.	20-363	Date:	June 14, 2022
Project:	New Residential Development	Designed:	Guillaume Brunet
Project Address:	1592 Tenth Line Road - Orleans	Checked:	Guillaume Brunet
Client:	Bridor Development	Drawing Reference:	C300

STORM WATER MANAGEMENT DESIGN SHEET
5 YEAR STORM EVENT

PRE-DEVELOPMENT STORMATER MANAGEMENT

Runoff	Catchment Area	Area			ΣR ₅
Un-Controlled	EWS-01	0.149	ha	R=	0.53
	Total Uncontrolled =	0.149	ha	ΣR=	0.53

PRE-DEVELOPMENT ALLOWABLE RELEASE RATE

$$Q = 2.78CIA \text{ (L/s)}$$

$$I_5 = 998.071 / (T_c + 6.053)^{0.814}$$

C =	0.50	up to a maximum of 0.5 as per City of Ottawa Sewer Design Guidelines
I =	104.2	mm/hr
T _c =	10	min
Total =	0.149	ha
Allowable Release Rate=	21.52	L/s

POST-DEVELOPMENT STORMATER MANAGEMENT

Runoff	Catchment Area	Area			ΣR ₅	ΣR ₁₀₀
Controlled	WS-01	0.034	ha	R=	0.90	1.00
	WS-02	0.028	ha	R=	0.90	1.00
	WS-03	0.028	ha	R=	0.53	0.66
	WS-04	0.020	ha	R=	0.45	0.56
	WS-05	0.016	ha	R=	0.64	0.80
	WS-06	0.011	ha	R=	0.58	0.73
	Total Controlled =	0.136	ha	ΣR=	0.70	0.82
	WS-07	0.013	ha	R=	0.85	1.00
	Total Un-Controlled =	0.013	ha	ΣR=	0.85	1.00

$$I_5 = 998.071 / (T_d + 6.053)^{0.814}$$

		REQUIRED STORAGE				
Time (min)	Intensity (mm/hr)	Controlled Runoff (L/s)	Storage Volume (m3)	Controlled Release Rate (L/s)	Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
10	104.2	27.65	7.55	15.07	3.19	18.25
15	83.6	22.17	6.40	15.07	2.56	17.62
20	70.3	18.64	4.29	15.07	2.15	17.22
25	60.9	16.16	1.64	15.07	1.86	16.93
30	53.9	14.31	0.00	15.07	1.65	16.72
35	48.5	12.88	0.00	15.07	1.48	16.55
40	44.2	11.73	0.00	15.07	1.35	16.42
50	37.7	9.99	0.00	15.07	1.15	16.22
60	32.9	8.74	0.00	15.07	1.01	16.08
80	26.6	7.05	0.00	15.07	0.81	15.88
90	24.3	6.45	0.00	15.07	0.74	15.81

STORMATER STORAGE REQUIREMENTS

Total Storage Required =	7.55 m³	
Pipe Storage =	0.00 m ³	refer to Storm Sewer Design Sheet
CB/MH Storage =	0.00 m ³	refer to Storm Sewer Design Sheet
Underground Chambers	37.10 m ³	
Total Available Storage =	37.10 m³	

File No.	20-363	Date:	June 14, 2022
Project:	New Residential Development	Designed:	Guillaume Brunet
Project Address:	1592 Tenth Line Road - Orleans	Checked:	Guillaume Brunet
Client:	Bridor Development	Drawing Reference:	C300

STORM WATER MANAGEMENT DESIGN SHEET
100 YEAR STORM EVENT

PRE-DEVELOPMENT STORMWATER MANAGEMENT

Runoff	Catchment Area	Area			ΣR ₅
Un-Controlled	EWS-01	0.149	ha	R=	0.53
	Total Uncontrolled =	0.149	ha	ΣR=	0.53

PRE-DEVELOPMENT ALLOWABLE RELEASE RATE

$$Q = 2.78CIA \text{ (L/s)} \qquad I_5 = 998.071 / (T_c + 6.053)^{0.814}$$

C = 0.50 up to a maximum of 0.5 as per City of Ottawa Sewer Design Guidelines
 I = 104.2 mm/hr
 T_c = 10 min
 Total = 0.149 ha
Allowable Release Rate = 21.52 L/s

POST-DEVELOPMENT STORMWATER MANAGEMENT

Runoff	Catchment Area	Area			ΣR ₅	ΣR ₁₀₀
Controlled	WS-01	0.034	ha	R=	0.90	1.00
	WS-02	0.028	ha	R=	0.90	1.00
	WS-03	0.028	ha	R=	0.53	0.66
	WS-04	0.020	ha	R=	0.45	0.56
	WS-05	0.016	ha	R=	0.64	0.80
	WS-06	0.011	ha	R=	0.58	0.73
	Total Controlled =	0.136	ha	ΣR=	0.70	0.82
UN-Controlled	WS-07	0.013	ha	R=	0.85	1.00
	Total Un-Controlled =	0.013	ha	ΣR=	0.85	1.00

$$I_{100} = 1735.688 / (T_d + 6.014)^{0.820}$$

REQUIRED STORAGE						
Time (min)	Intensity (mm/hr)	Controlled Runoff** (L/s)	Storage Volume (m ³)	Controlled Release Rate (L/s)	Uncontrolled Runoff (L/s)	Total Release Rate (L/s)
10	178.6	55.45	24.23	15.07	6.45	21.52
15	142.9	44.37	26.37	15.07	5.16	20.23
20	120.0	37.25	26.62	15.07	4.34	19.40
25	103.8	32.25	25.77	15.07	3.75	18.82
30	91.9	28.53	24.23	15.07	3.32	18.39
35	82.6	25.64	22.21	15.07	2.98	18.05
40	75.1	23.33	19.84	15.07	2.72	17.78
50	64.0	19.86	14.37	15.07	2.31	17.38
60	55.9	17.36	8.24	15.07	2.02	17.09
70	49.8	15.46	1.65	15.07	1.80	16.87
90	41.1	12.77	0.00	15.07	1.49	16.55
100	37.9	11.77	0.00	15.07	1.37	16.44
110	35.2	10.93	0.00	15.07	1.27	16.34
120	32.9	10.21	0.00	15.07	1.19	16.26

STORMWATER STORAGE REQUIREMENTS

Total Storage Required =	26.62 m³	
Pipe Storage =	0.88 m ³	refer to Storm Sewer Design Sheet
CB/MH Storage =	0.85 m ³	refer to Storm Sewer Design Sheet
Underground Chambers	37.10 m ³	
Total Available Storage =	38.83 m³	

Inlet Control Device Parameters

Product	Orifice Plate	at MHCB 02
Invert Level =	85.70	masl.
HWL =	1.70	m
HWL =	87.40	masl.
Orifice Dia. =	64	mm
Orifice Invert =	85.70	masl.
Orifice Area =	0.0032	m ²
ICD Centerline =	85.85	masl.
HWL Head =	1.70	m
C =	0.82	
Controlled Release =	15.07	L/s

from inv.

from centerline

APPENDIX “B”

Sanitary Design

File No.

Project:

Project Address:

Client:

20-363

New Residential Development

1592 Tenth Line Road - Orleans

Bridor Development

Date:

Designed:

Checked:

Drawing Reference:

June 14, 2022

Guillaume Brunet

Guillaume Brunet

C300

SANITARY DESIGN SHEET

SEWER DESIGN

LOCATION			RESIDENTIAL AREA AND POPULATION						COMMERCIAL		INDUSTRIAL			INSTITUTIONAL		C+I+I	INFILTRATION			TOTAL FLOW (l/s)	PIPE						MANHOLE	
STREET	FROM MH	TO MH	AREA (Ha)	POP.	CUMMULATIVE		PEAK FACT.	PEAK FLOW (l/s)	AREA (Ha)	ACCU. AREA (Ha)	AREA (Ha)	ACCU. AREA (Ha)	PEAK FACT.	AREA (Ha)	ACCU. AREA (Ha)	PEAK FLOW (l/s)	TOTAL AREA (Ha)	ACCU. AREA (Ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	LENGTH (m)	DIA. (mm)	MATERAIL	SLOPE (%)	CAP. (FULL) (l/s)	VEL. (FULL) (m/s)	UP INVERT (m)	DOWN INVERT (m)
					AREA (Ha)	POP.																						
SITE	PROP. BLDG	PROPERTY LINE	0.149	37.8	0.15	37.8	4.0	0.61	0.000	0.000	0.00	0.00	7.0	0.0	0.0	0.61	0.149	0.149	0.04	1.27	3.4	150	PVC	1.00%	15.23	0.86	85.85	85.82
	PROPERTY LINE	CITY	0.000	37.8	0.00	0.0	0.0	0.00	0.000	0.000	0.00	0.00	7.0	0.0	0.0	0.00	0.000	0.149	0.04	1.27	10.8	150	PVC	1.00%	15.23	0.86	85.82	85.71

DESIGN PARAMETERS NOTES

Average Daily Flow =	350 L/p/day	Industrial Peak Factor =	7 as per Appendix 4-B	Appartments:	Person Per Unit	Appartment	Total
Commercial and Institutional Flow =	50000 L/ha/da	Extraneous Flow =	0.28 L/s/ha	Bachelor =	1.4	0	0
Industrial Flow =	35000.00 L/ha/da	Minimum Velocity =	0.76 m/s	1 Bedroom =	1.4	27	37.8
Maximum Resedential Peak Flow =	4	Mannings n =	0.013	2 Bedroom =	2.1	0	0
Commection and Intitutional Peak Factor =	1.5			3 Bedroom =	3.1	0	0

APPENDIX “C”

Watermain Design

File No.	20-363	Date:	June 14, 2022
Project:	New Residential Development	Designed:	Guillaume Brunet
Project Address:	1592 Tenth Line Road - Orleans	Checked:	Guillaume Brunet
Client:	Bridor Development	Drawing Reference:	

WATER CONSUMPTION CALCULATION

Total Building Floor Area =	566	m ²	
Site Total Area =	0.214	ha	
Total Population =	37.8	ea.	
Average Demand Per People =	350	L/c/d	
Average Water Demand =	13230.00	L/d	0.15
Maximum Daily Peak Factor =	2.5	* As per City of Ottawa	
Maximum Daily =	33075.00	L/d	0.38
Maximum Hourly Peak Factor =	2.2	* As per City of Ottawa	
Maximum Hourly =	72765.00	L/d	0.84
Total Domestic Flow =	0.84	L/s	
Total Fire Flow =	130.00	L/s	

	Unit Counts	WSFU	Total
Unrinal Flush Tank	27	2	54
Sinks	54	1	54
Bathub	27	4	108
Diswasher	27	1.5	40.5
Washing Machine	27	2	54
Total			310.5

Appartments:	Person Per Unit	Appartment	Total
Bachelor =	1.4	0	0
1 Bedroom =	1.4	27	37.8
2 Bedroom =	2.1	0	0
3 Bedroom =	3.1	0	0
Total			37.8

File No. 20-363
Project: New Residential Development
Project Address: 1592 Tenth Line Road - Orleans
Client: Bridor Development

Date: June 14, 2022
Designed: Guillaume Brunet
Checked: Guillaume Brunet
Drawing Reference:

FIRE FLOW FOR BOTH BUILDING COMBINED

Term	Options	Multiplier	Choose:	Value	unit	Fire Flow
Coefficient C related to the type of construction	Wood Frame	1.5	Non-combustible construction	0.8		
	Ordinary Construction	1.0				
	Non-combustible construction	0.8				
	Fire resistive construction <2 hrs	0.7				
	Fire resistive construction >2 hrs	0.6				
Type of housing	Single family dwelling	0	Building - no. of units per floor	10	unit	
	Townhouse - no. of units	0				
	Building - no. of units per floor	10				
	Number of floors excluding the basement	3		3	floor	
	Floor space per unit	varies	566	566	sq.m.	
Required fire flow	Fire Flow = 220 x C x Area^{0.5}				L/min	7,252
					L/s	121
Occupancy hazard reduction or surcharge	Non-combustible	-0.25	Limited combustible	-0.15		
	Limited combustible	-0.15				
	Combustible	0				
	Free burning	0.15			L/min	6,165
	Rapid burning	0.25			L/s	103
Sprinkler reduction	Sprinklers (NFPA13)	-0.30	False	0		
	Water supply is standard for both the system and fire department hose lines	-0.10	False	0	L/min	5,548
	Fully supervised system	-0.10	True	-0.1	L/s	92
Exposure distance between units	North side	20.1 to 30m	0.1			
	East side	Over 45m	0			
	South side	3.1 to 10m	0.2		L/min	7,767
	West side	20.1 to 30m	0.1	0.4	L/s	129
Minimum required fire flow rate (rounded to nearest 100)					L/min	7,800
Minimum required fire flow rate					L/s	130.00
Required duration of fire flow					min	30

File No. 20-363
Project: New Residential Development
Project Address: 1592 Tenth Line Road - Orleans
Client: Bridor Development

Date: June 14- 2022
Designed: Guillaume Brunet
Checked: Guillaume Brunet
Drawing Reference:

FIRE FLOW BUILDING A ISOLATED. Note 2hrs fire separation wall between underground shared parking

Term	Options	Multiplier	Choose:	Value	unit	Fire Flow
Coefficient C related to the type of construction	Wood Frame	1.5	Non-combustible construction	0.8		
	Ordinary Construction	1.0				
	Non-combustible construction	0.8				
	Fire resistive construction <2 hrs	0.7				
	Fire resistive construction >2 hrs	0.6				
Type of housing	Single family dwelling	0	Building - no. of units per floor	10	unit	
	Townhouse - no. of units	0				
	Building - no. of units per floor	10				
	Number of floors excluding the basement	3		3	floor	
	Floor space per unit	varies	275	275	sq.m.	
Required fire flow	Fire Flow = 220 x C x Area^{0.5}				L/min	5,055
					L/s	84
Occupancy hazard reduction or surcharge	Non-combustible	-0.25	Limited combustible	-0.15		
	Limited combustible	-0.15				
	Combustible	0				
	Free burning	0.15			L/min	4,297
	Rapid burning	0.25			L/s	72
Sprinkler reduction	Sprinklers (NFPA13)	-0.30	False	0		
	Water supply is standard for both the system and fire department hose lines	-0.10	False	0	L/min	3,867
	Fully supervised system	-0.10	True	-0.1	L/s	64
Exposure distance between units	North side	20.1 to 30m	0.1			
	East side	Over 45m	0			
	South side	3.1 to 10m	0.2		L/min	5,414
	West side	20.1 to 30m	0.1	0.4	L/s	90
Minimum required fire flow rate (rounded to nearest 100)					L/min	5,400
Minimum required fire flow rate					L/s	90.00
Required duration of fire flow					min	30

File No. 20-363
Project: New Residential Development
Project Address: 1592 Tenth Line Road - Orleans
Client: Bridor Development

Date: June 14, 2022
Designed: Guillaume Brunet
Checked: Guillaume Brunet
Drawing Reference:

FIRE FLOW BUILDING B ISOLATED. Note 2hrs fire separation wall between underground shared parking

Term	Options	Multiplier	Choose:	Value	unit	Fire Flow
Coefficient C related to the type of construction	Wood Frame	1.5	Non-combustible construction	0.8		
	Ordinary Construction	1.0				
	Non-combustible construction	0.8				
	Fire resistive construction <2 hrs	0.7				
	Fire resistive construction >2 hrs	0.6				
Type of housing	Single family dwelling	0	Building - no. of units per floor	10	unit	
	Townhouse - no. of units	0				
	Building - no. of units per floor	10				
	Number of floors excluding the basement	3		3	floor	
	Floor space per unit	varies	291	291	sq.m.	
Required fire flow	Fire Flow = 220 x C x Area^{0.5}				L/min	5,200
					L/s	87
Occupancy hazard reduction or surcharge	Non-combustible	-0.25	Limited combustible	-0.15		
	Limited combustible	-0.15				
	Combustible	0				
	Free burning	0.15			L/min	4,420
	Rapid burning	0.25			L/s	74
Sprinkler reduction	Sprinklers (NFPA13)	-0.30	False	0		
	Water supply is standard for both the system and fire department hose lines	-0.10	False	0	L/min	3,978
	Fully supervised system	-0.10	True	-0.1	L/s	66
Exposure distance between units	North side	20.1 to 30m	0.1			
	East side	Over 45m	0			
	South side	3.1 to 10m	0.2		L/min	5,569
	West side	20.1 to 30m	0.1	0.4	L/s	93
Minimum required fire flow rate (rounded to nearest 100)					L/min	5,600
Minimum required fire flow rate					L/s	93.33
Required duration of fire flow					min	30

APPENDIX “D”

Underground Chambers & Stormwater Treatment Unit

Project: 1592 Tenth Line Road



Chamber Model -	MC-3500	
Units -	Metric	Click Here for Imperial
Number of Chambers -	7	
Number of End Caps -	2	
Voids in the stone (porosity) -	40	%
Base of Stone Elevation -	85.72	m
Amount of Stone Above Chambers -	305	mm
Amount of Stone Below Chambers -	229	mm
Amount of Stone Between Chambers -	152	mm
	43.7	sq.meters
Min. Area -	35.246 sq.meters	

☒ Include Perimeter Stone in Calculations

Height of System (mm)	Incremental Single Chamber (cubic meters)	Incremental Single End Cap (cubic meters)	Incremental Chambers (cubic meters)	Incremental End Cap (cubic meters)	Incremental Stone (cubic meters)	Incremental Chamber, End (cubic meters)	Cumulative System (cubic meters)	Elevation (meters)
1676	0.00	0.00	0.00	0.00	0.444	0.44	42.87	87.40
1651	0.00	0.00	0.00	0.00	0.444	0.44	42.43	87.37
1626	0.00	0.00	0.00	0.00	0.444	0.44	41.99	87.34
1600	0.00	0.00	0.00	0.00	0.444	0.44	41.54	87.32
1575	0.00	0.00	0.00	0.00	0.444	0.44	41.10	87.29
1549	0.00	0.00	0.00	0.00	0.444	0.44	40.65	87.27
1524	0.00	0.00	0.00	0.00	0.444	0.44	40.21	87.24
1499	0.00	0.00	0.00	0.00	0.444	0.44	39.77	87.22
1473	0.00	0.00	0.00	0.00	0.444	0.44	39.32	87.19
1448	0.00	0.00	0.00	0.00	0.444	0.44	38.88	87.17
1422	0.00	0.00	0.00	0.00	0.444	0.44	38.44	87.14
1397	0.00	0.00	0.00	0.00	0.444	0.44	37.99	87.12
1372	0.00	0.00	0.01	0.00	0.439	0.45	37.55	87.09
1346	0.01	0.00	0.04	0.00	0.428	0.47	37.10	87.07
1321	0.01	0.00	0.06	0.00	0.420	0.48	36.63	87.04
1295	0.01	0.00	0.08	0.00	0.411	0.49	36.15	87.01
1270	0.02	0.00	0.14	0.00	0.388	0.53	35.66	86.99
1245	0.03	0.00	0.20	0.00	0.360	0.57	35.13	86.96
1219	0.04	0.00	0.25	0.01	0.342	0.60	34.56	86.94
1194	0.04	0.00	0.28	0.01	0.328	0.62	33.96	86.91
1168	0.04	0.00	0.31	0.01	0.316	0.64	33.35	86.89
1143	0.05	0.00	0.34	0.01	0.305	0.65	32.71	86.86
1118	0.05	0.01	0.36	0.01	0.295	0.67	32.06	86.84
1092	0.05	0.01	0.38	0.01	0.286	0.68	31.39	86.81
1067	0.06	0.01	0.40	0.01	0.277	0.69	30.71	86.79
1041	0.06	0.01	0.42	0.01	0.269	0.71	30.02	86.76
1016	0.06	0.01	0.44	0.01	0.262	0.72	29.31	86.74
991	0.07	0.01	0.46	0.02	0.255	0.73	28.59	86.71
965	0.07	0.01	0.47	0.02	0.248	0.74	27.87	86.68
940	0.07	0.01	0.49	0.02	0.242	0.75	27.13	86.66
914	0.07	0.01	0.50	0.02	0.236	0.75	26.38	86.63
889	0.07	0.01	0.51	0.02	0.231	0.76	25.63	86.61
864	0.08	0.01	0.53	0.02	0.226	0.77	24.86	86.58
838	0.08	0.01	0.54	0.02	0.221	0.78	24.09	86.56
813	0.08	0.01	0.55	0.02	0.216	0.79	23.32	86.53
787	0.08	0.01	0.56	0.02	0.211	0.79	22.53	86.51
762	0.08	0.01	0.57	0.02	0.207	0.80	21.74	86.48
737	0.08	0.01	0.58	0.02	0.203	0.80	20.94	86.46
711	0.08	0.01	0.59	0.02	0.199	0.81	20.13	86.43
686	0.09	0.01	0.60	0.02	0.195	0.82	19.32	86.40
660	0.09	0.01	0.61	0.02	0.192	0.82	18.51	86.38
635	0.09	0.01	0.61	0.02	0.188	0.83	17.68	86.35
610	0.09	0.01	0.62	0.03	0.185	0.83	16.86	86.33
584	0.09	0.01	0.63	0.03	0.182	0.84	16.03	86.30
559	0.09	0.01	0.63	0.03	0.179	0.84	15.19	86.28
533	0.09	0.01	0.64	0.03	0.177	0.84	14.35	86.25
508	0.09	0.01	0.65	0.03	0.174	0.85	13.51	86.23
483	0.09	0.01	0.65	0.03	0.172	0.85	12.66	86.20
457	0.09	0.01	0.66	0.03	0.169	0.86	11.81	86.18
432	0.09	0.01	0.66	0.03	0.167	0.86	10.95	86.15
406	0.10	0.01	0.67	0.03	0.165	0.86	10.09	86.13
381	0.10	0.01	0.67	0.03	0.163	0.87	9.23	86.10
356	0.10	0.02	0.68	0.03	0.161	0.87	8.36	86.07
330	0.10	0.02	0.68	0.03	0.159	0.87	7.50	86.05
305	0.10	0.02	0.69	0.03	0.157	0.87	6.62	86.02
279	0.10	0.02	0.69	0.03	0.155	0.88	5.75	86.00
254	0.10	0.02	0.69	0.03	0.152	0.88	4.87	85.97
229	0.00	0.00	0.00	0.00	0.444	0.44	3.99	85.95
203	0.00	0.00	0.00	0.00	0.444	0.44	3.55	85.92
178	0.00	0.00	0.00	0.00	0.444	0.44	3.11	85.90
152	0.00	0.00	0.00	0.00	0.444	0.44	2.66	85.87
127	0.00	0.00	0.00	0.00	0.444	0.44	2.22	85.85
102	0.00	0.00	0.00	0.00	0.444	0.44	1.78	85.82
76	0.00	0.00	0.00	0.00	0.444	0.44	1.33	85.80
51	0.00	0.00	0.00	0.00	0.444	0.44	0.89	85.77
25	0.00	0.00	0.00	0.00	0.444	0.44	0.44	85.74

PROJECT INFORMATION	
ENGINEERED PRODUCT MANAGER:	HAIDER NASRULLAH 647-850-9417 HAIDER.NASRULLAH@ADS-PIPE.COM
ADS SALES REP:	MICHAEL REID 613-882-4186 MICHAEL.REID@ADS-PIPE.COM
PROJECT NO:	S209349
ADS SITE COORDINATOR:	MATTHEW BEGHIN 519-710-3687 MATTHEW.BEGHIN@ADS-PIPE.COM



ADVANCED DRAINAGE SYSTEMS, INC.



1592 TENTH LINE ROAD

ORLEANS, ON.

MC-3500 STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH MC-3500.
- CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBERS SHALL BE CERTIFIED TO CSA B184, "POLYMERIC SUB-SURFACE STORMWATER MANAGEMENT STRUCTURES", AND MEET THE REQUIREMENTS OF ASTM F2418-16a, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE CSA S6 CL-625 TRUCK AND THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
- CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOUS (<1 MIN) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT (75-YR) COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK) AASHTO DESIGN TRUCK.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 75 mm (3").
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/IN/IN. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 23° C / 73° F), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:
 - THE STRUCTURAL EVALUATION SHALL BE SEALED BY A REGISTERED PROFESSIONAL ENGINEER.
 - THE STRUCTURAL EVALUATION SHALL DEMONSTRATE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY SECTIONS 3 AND 12.12 OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS FOR THERMOPLASTIC PIPE.
 - THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF MC-3500 CHAMBER SYSTEM

- STORMTECH MC-3500 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM - 150 mm (6") SPACING BETWEEN THE CHAMBER ROWS.
- INLET AND OUTLET MANIFOLDS MUST BE INSERTED A MINIMUM OF 300 mm (12") INTO CHAMBER END CAPS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE WELL GRADED BETWEEN ¾" AND 2" (20-50 mm).
- STONE MUST BE PLACED ON THE TOP CENTER OF THE CHAMBER TO ANCHOR THE CHAMBERS IN PLACE AND PRESERVE ROW SPACING.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.

NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- THE USE OF EQUIPMENT OVER MC-3500 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER TIRED LOADER, DUMP TRUCK, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- FULL 900 mm (36") OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.

USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY USING THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-888-892-2694 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT


7	STORMTECH MC-3500 CHAMBERS
2	STORMTECH MC-C-3500 END CAPS
305	STONE ABOVE (mm)
229	STONE BELOW (mm)
40	% STONE VOID
37.1	INSTALLED SYSTEM VOLUME (m³) ABOVE ELEVATION 86.00 (PERIMETER STONE INCLUDED)
43.7	SYSTEM AREA (m²)
39.2	SYSTEM PERIMETER (m)

PROPOSED ELEVATIONS

89.529	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):
87.701	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):
87.548	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):
87.548	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):
87.548	MINIMUM ALLOWABLE GRADE (TOP OF RIGID PAVEMENT):
87.396	TOP OF STONE:
87.091	TOP OF MC-3500 CHAMBER:
86.000	600 mm ISOLATOR ROW PLUS INVERT:
85.948	BOTTOM OF MC-3500 CHAMBER:
85.719	BOTTOM OF STONE:

NOTES

- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECHNICAL NOTE 6.32 FOR MANIFOLD SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- THIS CHAMBER SYSTEM WAS DESIGNED WITHOUT SITE-SPECIFIC INFORMATION ON SOIL CONDITIONS OR BEARING CAPACITY. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL AND PROVIDING THE BEARING CAPACITY OF THE INSITU SOILS. THE BASE STONE DEPTH MAY BE INCREASED OR DECREASED ONCE THIS INFORMATION IS PROVIDED.

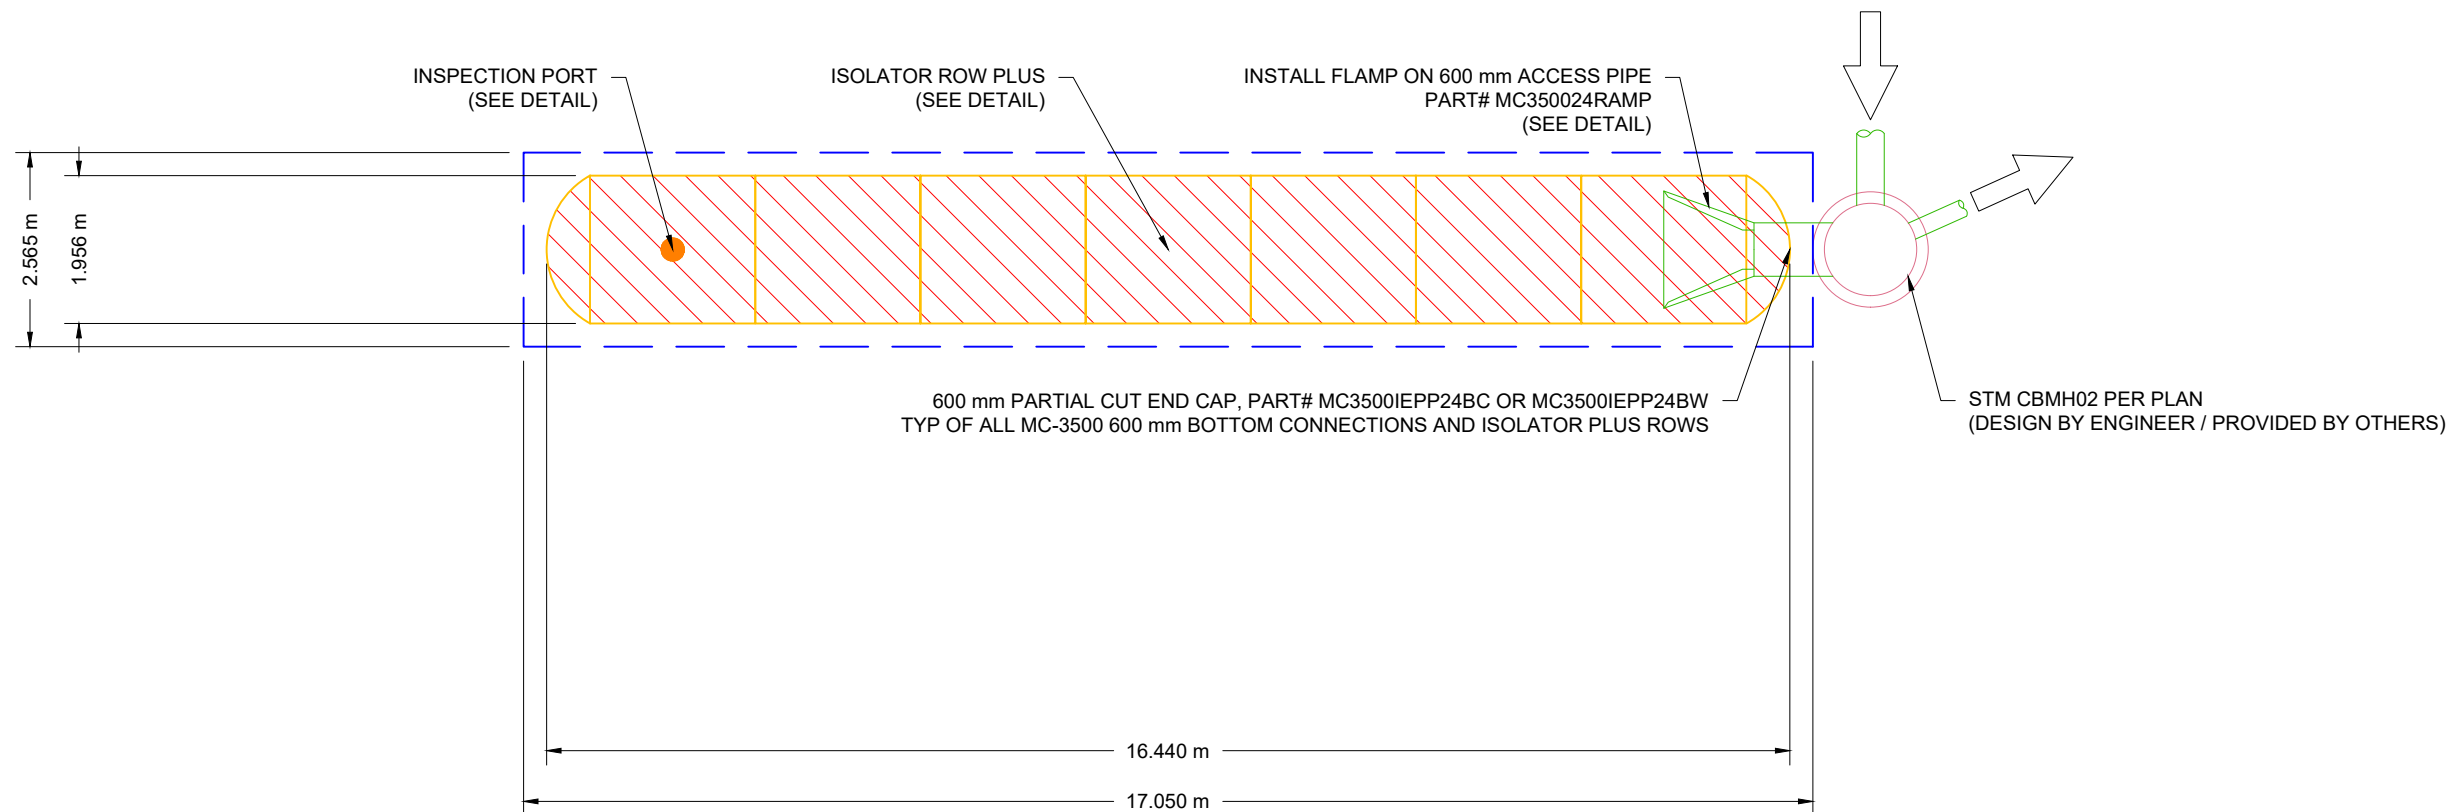

 **StormTech®**
Detention • Retention • Water Quality

520 CROMWELL AVENUE | ROCKY HILL, CT | 06067
860-529-8188 | 888-892-2694 | WWW.STORMTECH.COM

ADS[®]
ADVANCED DRAINAGE SYSTEMS, INC.

4640 TRUEMAN BLVD
HILLIARD, OH 43026

SCALE = 1 : 100

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

ORLEANS, ON.

DATE:	11/04/20	DRAWN:	RCT
-------	----------	--------	-----

PROJECT #:	S209349	CHECKED:	NPB
------------	---------	----------	-----

DATE	DRWN	CHKD	DESCRIPTION

StormTech®
Detention • Retention • Water Quality

520 CROMWELL AVENUE | ROCKY HILL, CT | 06067
860-529-8168 | 888-892-2694 | WWW.STORMTECH.COM

ADDS[®]
HILLIARD, OH 43026
ADVANCED DRAINAGE SYSTEMS, INC.


SCALE = 1 : 100

2 SHEET OF 5

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION		DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	ANY SOIL/ROCK MATERIALS, NATIVE SOILS, OR PER ENGINEER'S PLANS. CHECK PLANS FOR PAVEMENT SUBGRADE REQUIREMENTS.	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	AASHTO M145 ¹ A-1, A-2-4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 24" (600 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 12" (300 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS.
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43 ¹ 3, 4	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43 ¹ 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

- PLEASE NOTE:
- THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
 - STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR.
 - WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
 - ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.

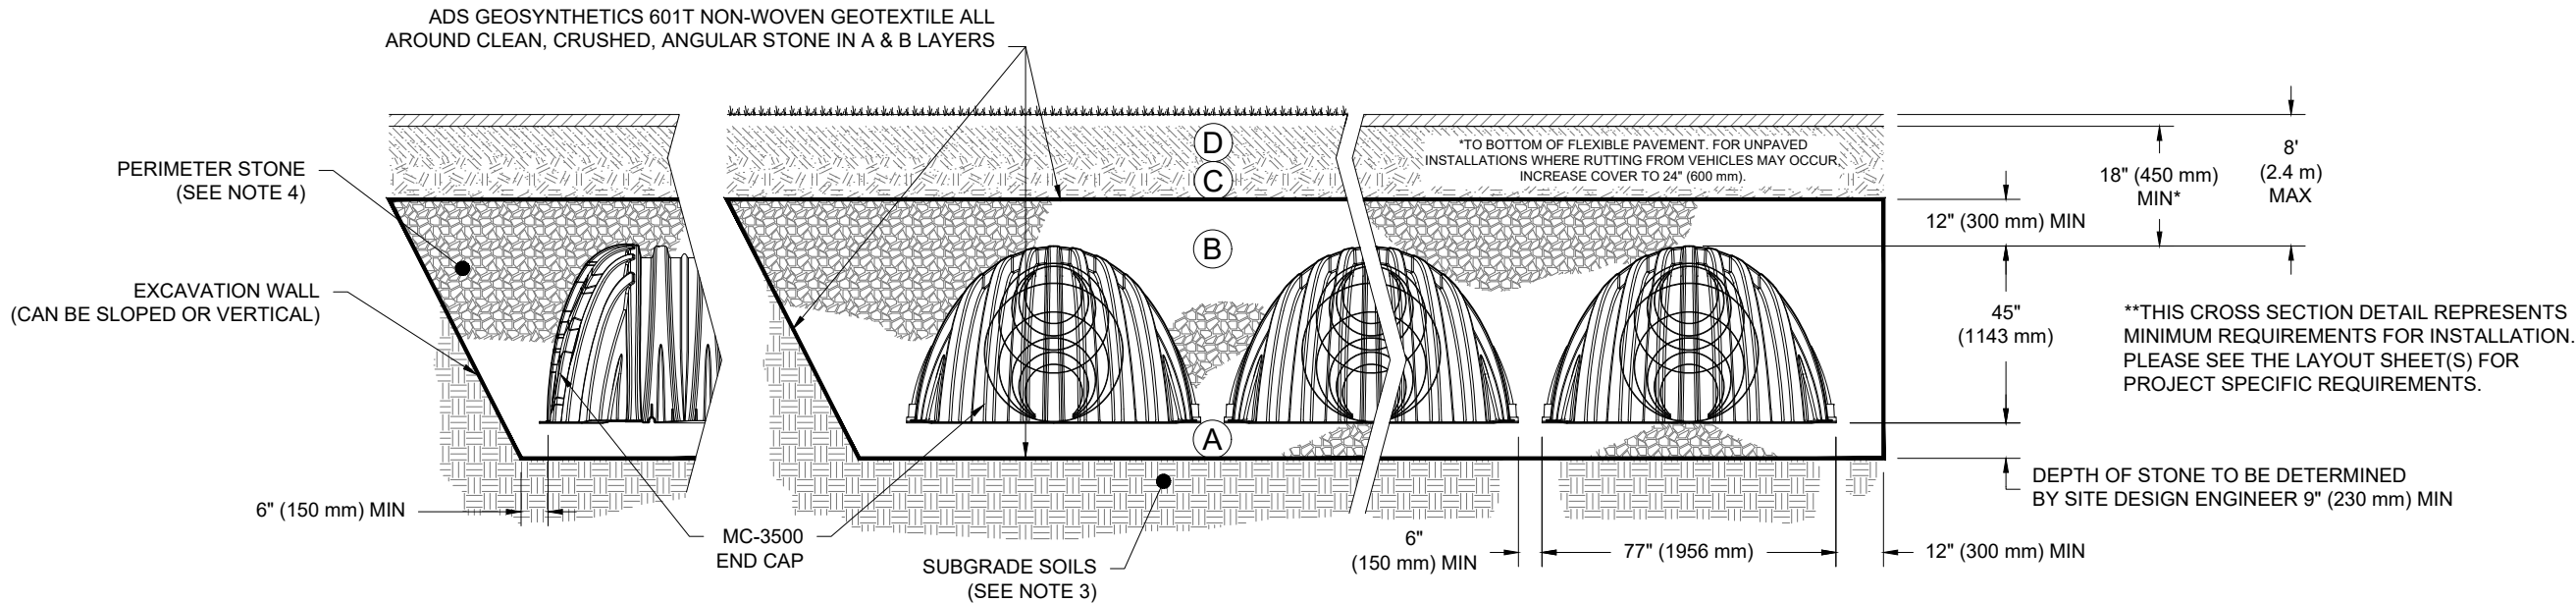

NOTES:

- CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418-16a, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
- MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
- PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3".
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/IN/IN. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

1592 TENTH LINE ROAD
ORLEANS, ON.

DATE: 11/04/20
DRAWN: RCT
PROJECT #: S209349
CHECKED: NPB

DESCRIPTION

DATE

DRWN

CHKD

StormTech
Detention • Retention • Water Quality
520 CROMWELL AVENUE | ROCKY HILL | CT | 06067
860-529-8188 | 888-892-2894 | WWW.STORMTECH.COM

4640 TRUEMAN BLVD
HILLIARD, OH 43026


ADVANCED DRAINAGE SYSTEMS, INC.

3

SHEET
OF

5

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

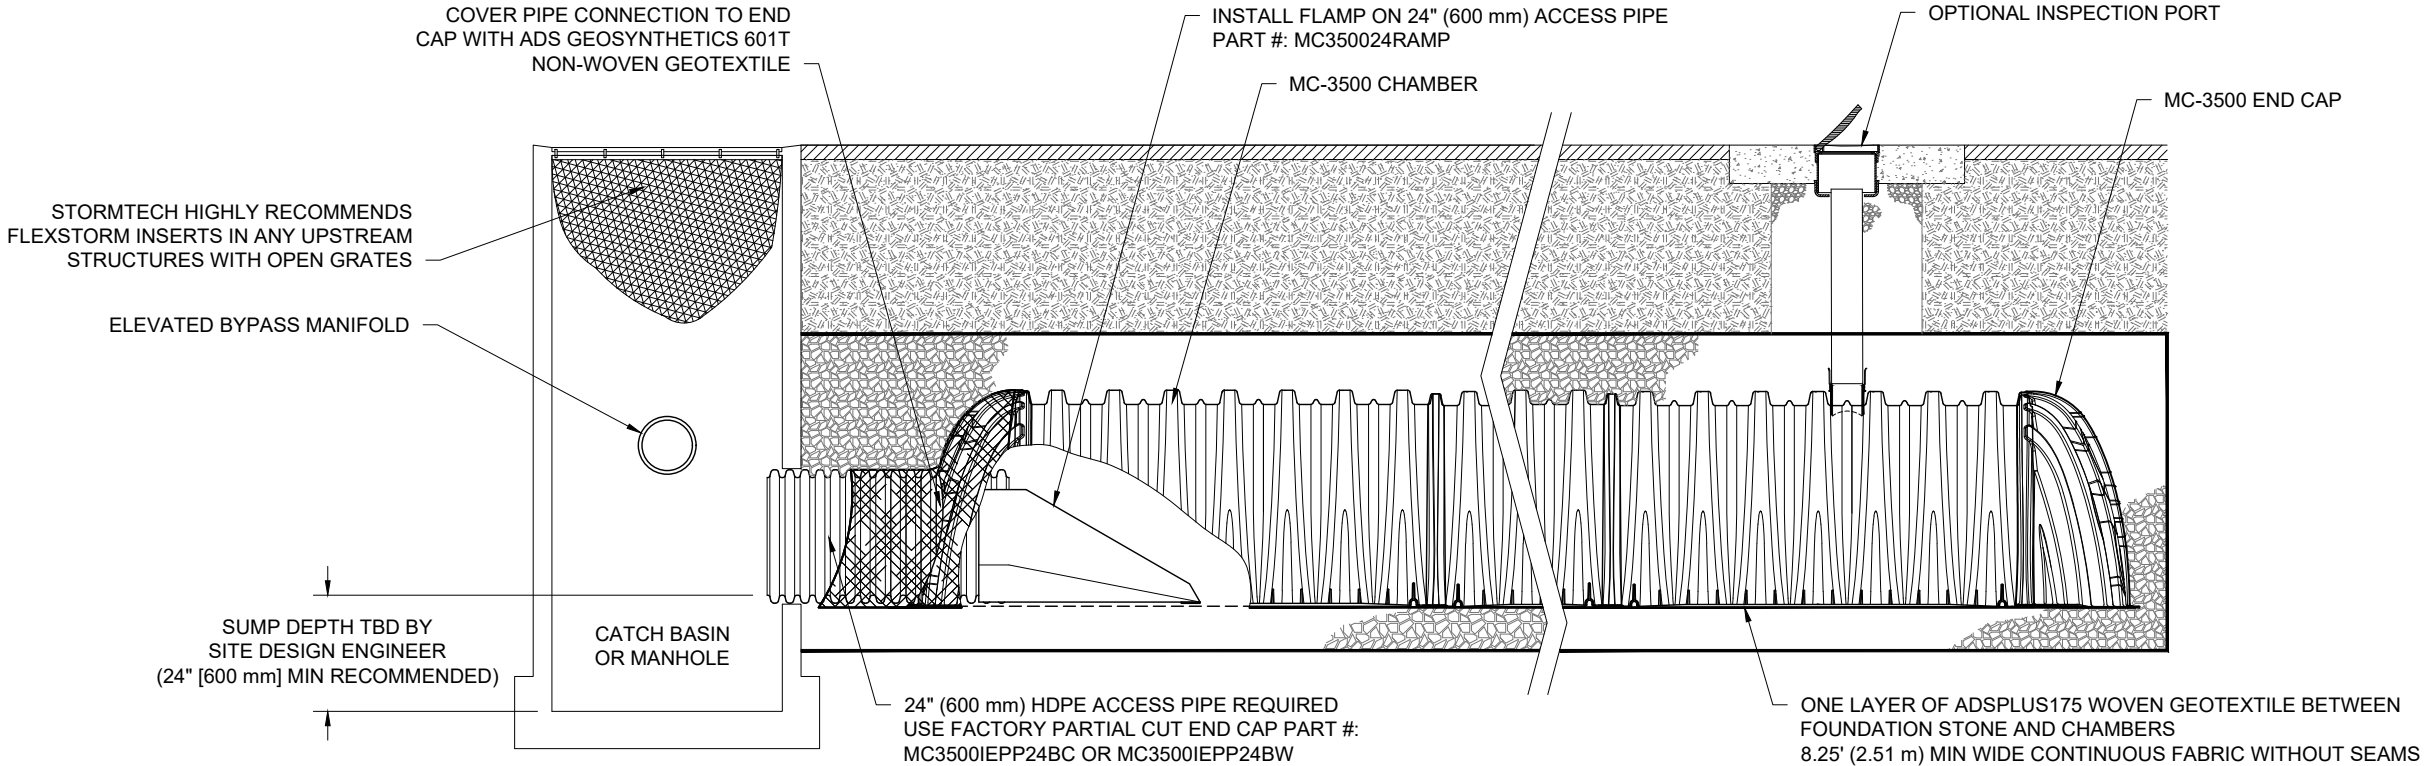


MC-3500 ISOLATOR ROW PLUS DETAIL
NTS

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT
- A. INSPECTION PORTS (IF PRESENT)
- A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
- A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
- A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
- A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
- A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- B. ALL ISOLATOR PLUS ROWS
- B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS
- B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW PLUS THROUGH OUTLET PIPE
- i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
- ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
- B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS
- A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
- B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
- C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES


1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
2. CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

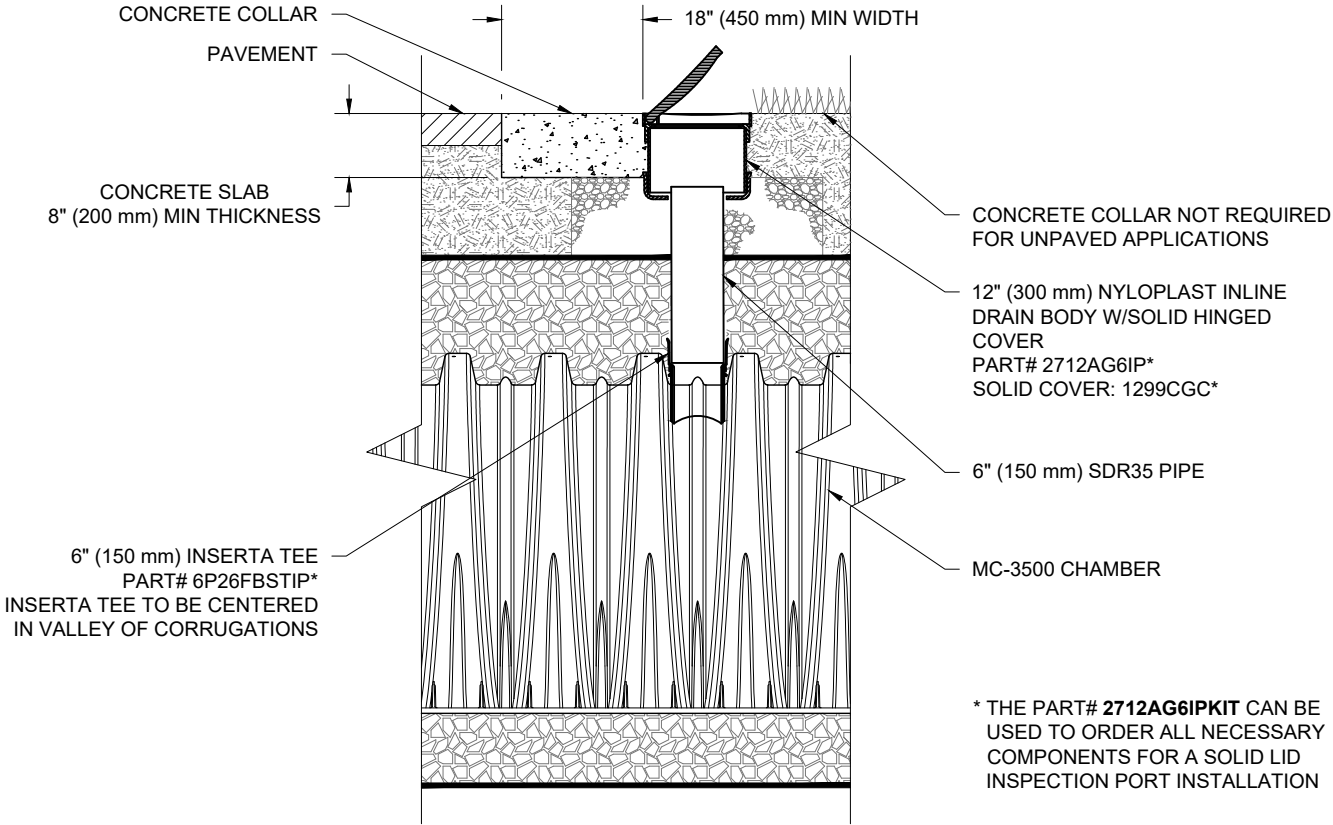

MC-3500 6" (150 mm) INSPECTION PORT DETAIL
NTS


1592 TENTH LINE ROAD ORLEANS, ON.	
DATE: 11/04/20	DRAWN: RCT
PROJECT #: S209349	CHECKED: NPB
DESCRIPTION	DATE
DRWN	CHKD
StormTech Retention • Retention • Water Quality 520 CROMWELL AVENUE ROCKY HILL CT 06067 860-529-8188 888-892-2694 WWW.STORMTECH.COM	
4640 TRUEMAN BLVD HILLIARD, OH 43026	
ADVANCED DRAINAGE SYSTEMS, INC.	
THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.	
4	5

MC-SERIES END CAP INSERTION DETAIL

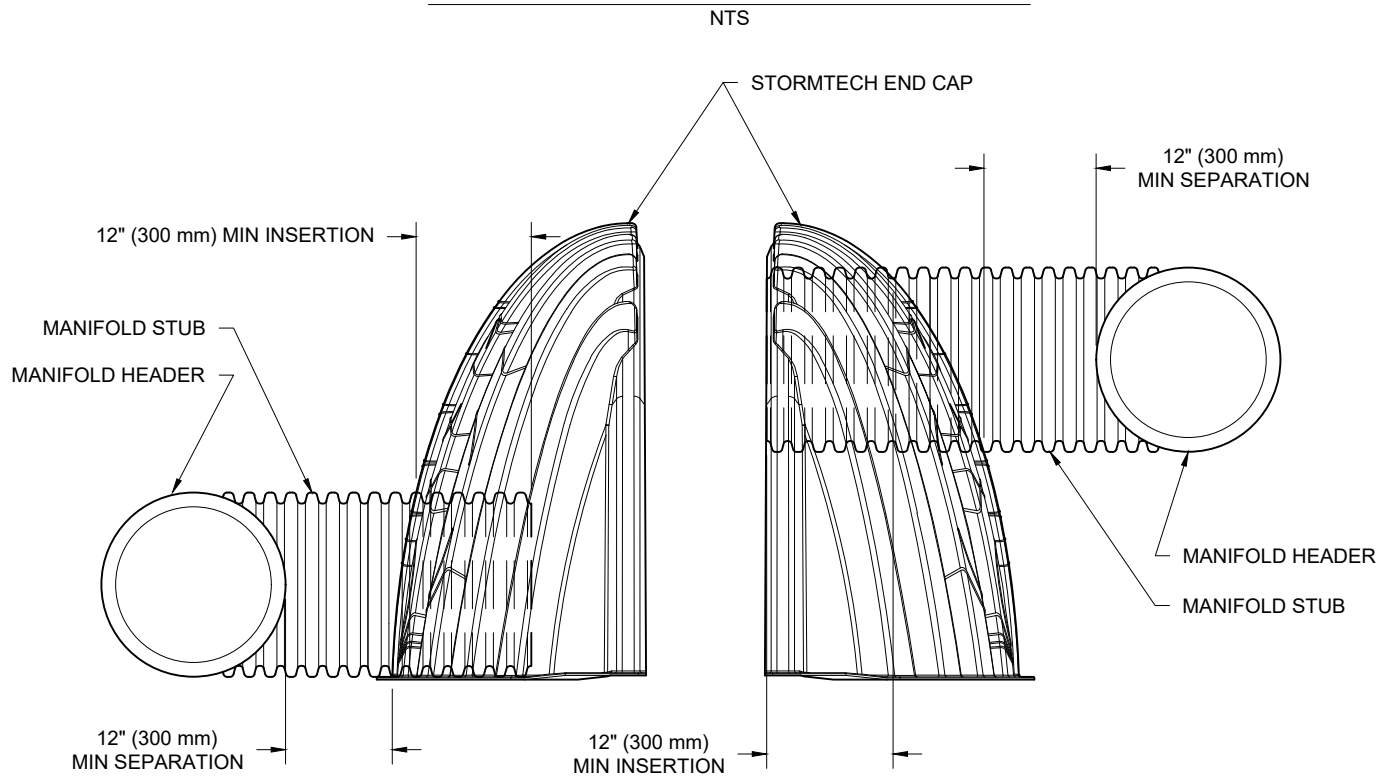

NOTE: MANIFOLD STUB MUST BE LAID HORIZONTAL FOR A PROPER FIT IN END CAP OPENING.

MC-3500 TECHNICAL SPECIFICATION

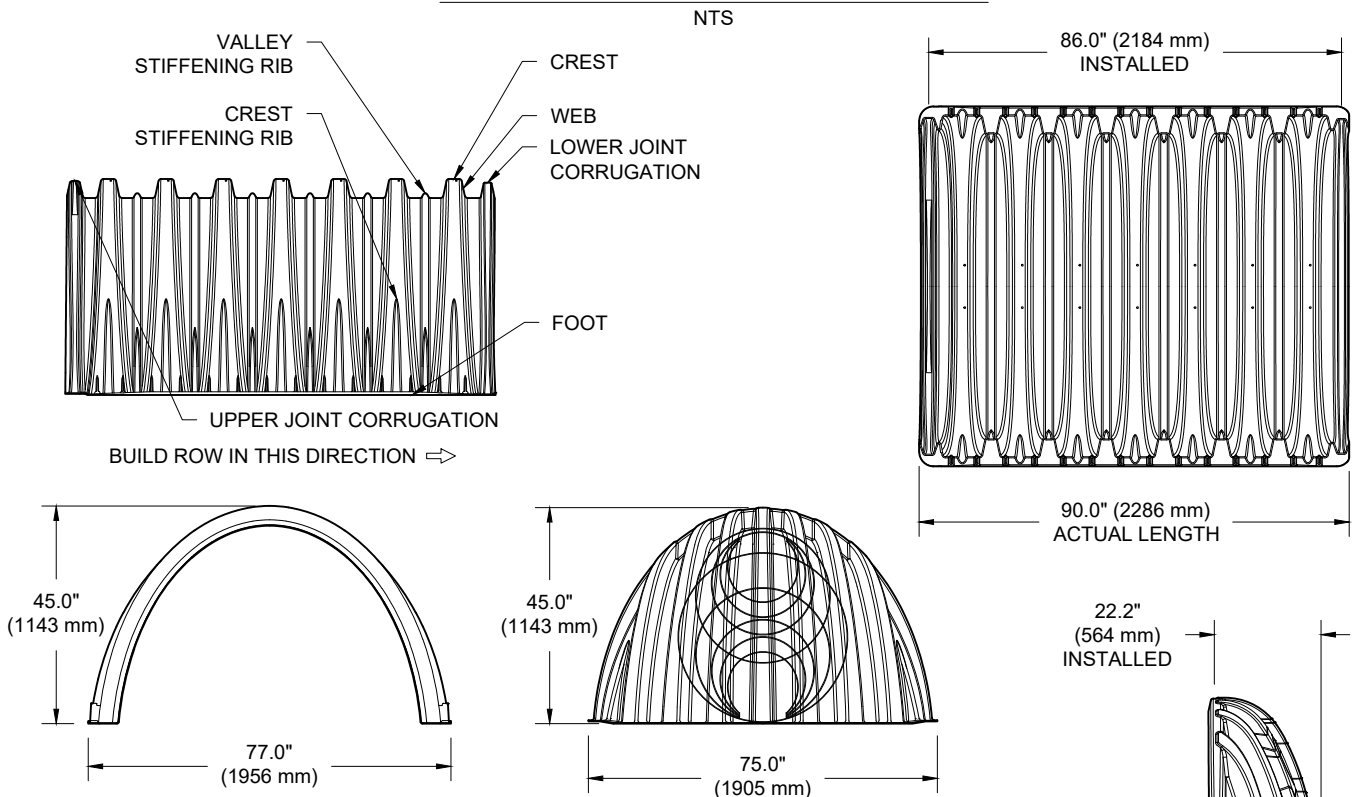

NOMINAL CHAMBER SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	77.0" X 45.0" X 86.0"	(1956 mm X 1143 mm X 2184 mm)
CHAMBER STORAGE	109.9 CUBIC FEET	(3.11 m³)
MINIMUM INSTALLED STORAGE*	175.0 CUBIC FEET	(4.96 m³)
WEIGHT	134 lbs.	(60.8 kg)

NOMINAL END CAP SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	75.0" X 45.0" X 22.2"	(1905 mm X 1143 mm X 564 mm)
END CAP STORAGE	14.9 CUBIC FEET	(0.42 m³)
MINIMUM INSTALLED STORAGE*	45.1 CUBIC FEET	(1.28 m³)
WEIGHT	49 lbs.	(22.2 kg)

*ASSUMES 12" (305 mm) STONE ABOVE, 9" (229 mm) STONE FOUNDATION, 6" (152 mm) STONE BETWEEN CHAMBERS, 6" (152 mm) STONE PERIMETER IN FRONT OF END CAPS AND 40% STONE POROSITY.

PARTIAL CUT HOLES AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH "B"
PARTIAL CUT HOLES AT TOP OF END CAP FOR PART NUMBERS ENDING WITH "T"
END CAPS WITH A PREFABRICATED WELDED STUB END WITH "W"
END CAPS WITH A WELDED CROWN PLATE END WITH "C"

PART #	STUB	B	C
MC3500IEPP06T	6" (150 mm)	33.21" (844 mm)	---
MC3500IEPP06B		---	0.66" (17 mm)
MC3500IEPP08T	8" (200 mm)	31.16" (791 mm)	---
MC3500IEPP08B		---	0.81" (21 mm)
MC3500IEPP10T	10" (250 mm)	29.04" (738 mm)	---
MC3500IEPP10B		---	0.93" (24 mm)
MC3500IEPP12T	12" (300 mm)	26.36" (670 mm)	---
MC3500IEPP12B		---	1.35" (34 mm)
MC3500IEPP15T	15" (375 mm)	23.39" (594 mm)	---
MC3500IEPP15B		---	1.50" (38 mm)
MC3500IEPP18TC	18" (450 mm)	20.03" (509 mm)	---
MC3500IEPP18TW		---	1.77" (45 mm)
MC3500IEPP18BC			
MC3500IEPP18BW			
MC3500IEPP24TC	24" (600 mm)	14.48" (368 mm)	---
MC3500IEPP24TW		---	2.06" (52 mm)
MC3500IEPP24BC			
MC3500IEPP24BW			
MC3500IEPP30BC	30" (750 mm)	---	2.75" (70 mm)

NOTE: ALL DIMENSIONS ARE NOMINAL

CUSTOM PARTIAL CUT INVERTS ARE AVAILABLE UPON REQUEST. INVENTORIED MANIFOLDS INCLUDE 12-24" (300-600 mm) SIZE ON SIZE AND 15-48" (375-1200 mm) ECCENTRIC MANIFOLDS. CUSTOM INVERT LOCATIONS ON THE MC-3500 END CAP CUT IN THE FIELD ARE NOT RECOMMENDED FOR PIPE SIZES GREATER THAN 10" (250 mm). THE INVERT LOCATION IN COLUMN 'B' ARE THE HIGHEST POSSIBLE FOR THE PIPE SIZE.



4640 TRUEMAN BLVD
HILLIARD, OH 43026



1592 TENTH LINE ROAD

ORLEANS, ON.

DATE: 11/04/20 DRAWN: RCT

PROJECT #: S209349 CHECKED: NPB

DESCRIPTION


DATE

DRWN

CHKD

520 CROMWELL AVENUE | ROCKY HILL | CT | 06067
860-529-8188 | 860-892-2694 | WWW.STORMTECH.COM

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

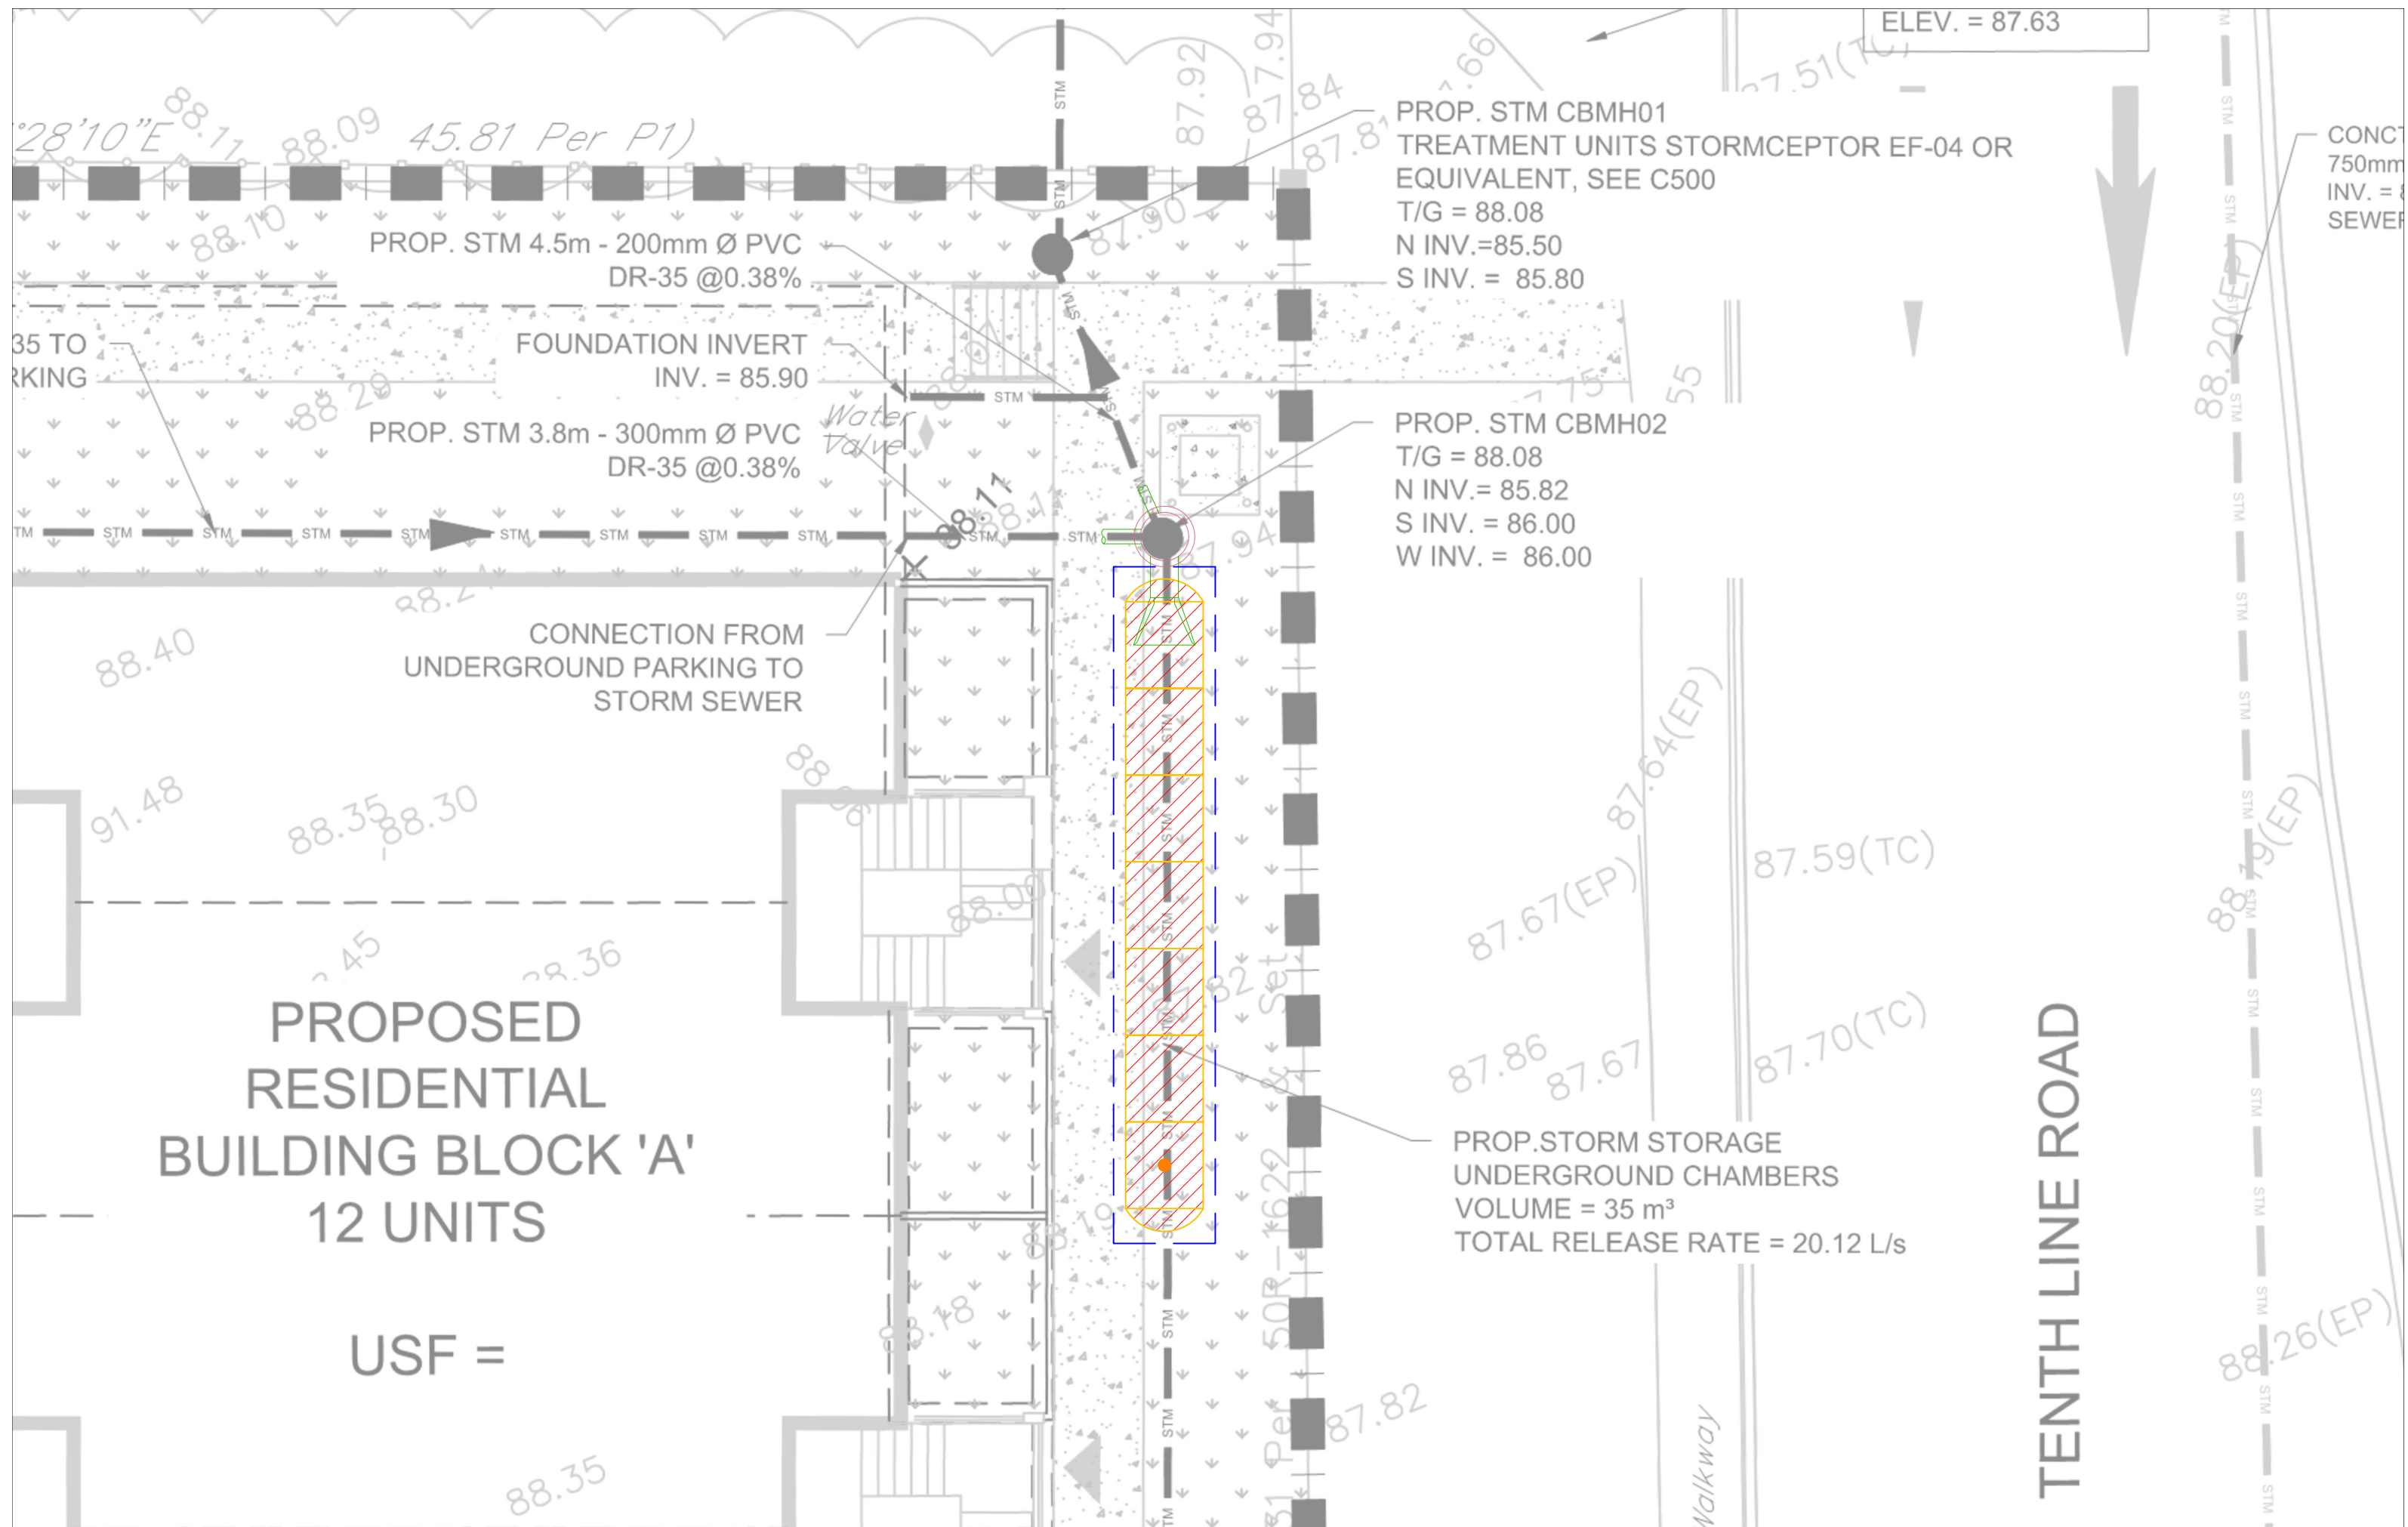

Stormceptor® EF Sizing Report

STORMCEPTOR®

ESTIMATED NET ANNUAL SEDIMENT (TSS) LOAD REDUCTION

11/17/2020

Province:	Ontario	Project Name:	Tenth Line
City:	Ottawa	Project Number:	20-363
Nearest Rainfall Station:	OTTAWA MACDONALD-CARTIER INT'L AP	Designer Name:	GUILLAUME BRUNET
NCDC Rainfall Station Id:	6000	Designer Company:	BL ENGINEERING
Years of Rainfall Data:	37	Designer Email:	guillaume@blengineering.ca
Site Name:	1592 Tenth Line	Designer Phone:	613-693-0700
Drainage Area (ha):	0.15	EOR Name:	
Runoff Coefficient 'c':	0.84	EOR Company:	
Particle Size Distribution:	Fine	EOR Email:	
Target TSS Removal (%):	80.0	EOR Phone:	

Net Annual Sediment (TSS) Load Reduction Sizing Summary

Stormceptor Model	TSS Removal Provided (%)
EF4	88
EF6	91
EF8	92
EF10	93
EF12	93

Recommended Stormceptor EF Model: **EF4**

Estimated Net Annual Sediment (TSS) Load Reduction (%): **88**

Water Quality Runoff Volume Capture (%): **> 90**

Stormceptor® **EF** Sizing Report**THIRD-PARTY TESTING AND VERIFICATION**

► **Stormceptor® EF and Stormceptor® EFO** are the latest evolutions in the Stormceptor® oil-grit separator (OGS) technology series, and are designed to remove a wide variety of pollutants from stormwater and snowmelt runoff. These technologies have been third-party tested in accordance with the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators** and performance has been third-party verified in accordance with the **ISO 14034 Environmental Technology Verification (ETV)** protocol.

PERFORMANCE

► **Stormceptor® EF and EFO** remove stormwater pollutants through gravity separation and floatation, and feature a patent-pending design that generates positive removal of total suspended solids (TSS) throughout each storm event, including high-intensity storms. Captured pollutants include sediment, free oils, and sediment-bound pollutants such as nutrients, heavy metals, and petroleum hydrocarbons. Stormceptor is sized to remove a high level of TSS from the frequent rainfall events that contribute the vast majority of annual runoff volume and pollutant load. The technology incorporates an internal bypass to convey excessive stormwater flows from high-intensity storms through the device without resuspension and washout (scour) of previously captured pollutants. Proper routine maintenance ensures high pollutant removal performance and protection of downstream waterways.

PARTICLE SIZE DISTRIBUTION (PSD)

► The **Canadian ETV PSD** shown in the table below was used, or in part, for this sizing. This is the identical PSD that is referenced in the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators** for both sediment removal testing and scour testing. The Canadian ETV PSD contains a wide range of particle sizes in the sand and silt fractions, and is considered reasonably representative of the particle size fractions found in typical urban stormwater runoff.

Particle Size (µm)	Percent Less Than	Particle Size Fraction (µm)	Percent
1000	100	500-1000	5
500	95	250-500	5
250	90	150-250	15
150	75	100-150	15
100	60	75-100	10
75	50	50-75	5
50	45	20-50	10
20	35	8-20	15
8	20	5-8	10
5	10	2-5	5
2	5	<2	5

Stormceptor®EF Sizing Report

Upstream Flow Controlled Results

Rainfall Intensity (mm / hr)	Percent Rainfall Volume (%)	Cumulative Rainfall Volume (%)	Flow Rate (L/s)	Flow Rate (L/min)	Surface Loading Rate (L/min/m²)	Removal Efficiency (%)	Incremental Removal (%)	Cumulative Removal (%)
1	51.3	51.3	0.35	21.0	18.0	93	47.7	47.7
2	8.7	60.0	0.70	42.0	35.0	93	8.1	55.8
3	5.8	65.8	1.05	63.0	53.0	92	5.3	61.1
4	4.6	70.4	1.40	84.0	70.0	90	4.1	65.3
5	4.2	74.6	1.75	105.0	88.0	89	3.7	69.0
6	3.2	77.8	2.10	126.0	105.0	87	2.8	71.8
7	2.6	80.4	2.45	147.0	123.0	85	2.2	74.0
8	2.4	82.8	2.80	168.0	140.0	83	2.0	76.0
9	1.9	84.7	3.15	189.0	158.0	81	1.5	77.5
10	1.6	86.3	3.50	210.0	175.0	79	1.3	78.8
11	1.3	87.6	3.85	231.0	193.0	77	1.0	79.8
12	1.1	88.7	4.20	252.0	210.0	75	0.8	80.6
13	1.3	90.0	4.55	273.0	228.0	74	1.0	81.6
14	1.1	91.1	4.90	294.0	245.0	72	0.8	82.4
15	0.6	91.7	5.25	315.0	263.0	71	0.4	82.8
16	0.8	92.5	5.60	336.0	280.0	69	0.6	83.4
17	0.7	93.2	5.95	357.0	298.0	68	0.5	83.8
18	0.5	93.7	6.31	378.0	315.0	66	0.3	84.2
19	0.6	94.3	6.66	399.0	333.0	64	0.4	84.5
20	0.5	94.8	7.01	420.0	350.0	63	0.3	84.9
21	0.2	95.0	7.36	441.0	368.0	62	0.1	85.0
22	0.4	95.4	7.71	462.0	385.0	60	0.2	85.2
23	0.5	95.9	8.06	483.0	403.0	58	0.3	85.5
24	0.4	96.3	8.41	504.0	420.0	58	0.2	85.7
25	0.1	96.4	8.76	525.0	438.0	58	0.1	85.8


Stormceptor®EF Sizing Report

Rainfall Intensity (mm / hr)	Percent Rainfall Volume (%)	Cumulative Rainfall Volume (%)	Flow Rate (L/s)	Flow Rate (L/min)	Surface Loading Rate (L/min/m²)	Removal Efficiency (%)	Incremental Removal (%)	Cumulative Removal (%)
26	0.3	96.7	9.11	546.0	455.0	58	0.2	86.0
27	0.4	97.1	9.46	567.0	473.0	57	0.2	86.2
28	0.2	97.3	9.81	588.0	490.0	57	0.1	86.3
29	0.2	97.5	10.16	609.0	508.0	57	0.1	86.4
30	0.2	97.7	10.51	631.0	525.0	57	0.1	86.5
31	0.1	97.8	10.86	652.0	543.0	57	0.1	86.6
32	0.2	98.0	11.21	673.0	560.0	56	0.1	86.7
33	0.1	98.1	11.56	694.0	578.0	56	0.1	86.8
34	0.1	98.2	11.91	715.0	595.0	56	0.1	86.8
35	0.1	98.3	12.26	736.0	613.0	56	0.1	86.9
36	0.2	98.5	12.61	757.0	631.0	56	0.1	87.0
37	1.5	100.0	12.96	778.0	648.0	56	0.8	87.8
38	0.1	100.1	13.31	799.0	666.0	56	0.1	87.9
39	0.1	100.2	13.66	820.0	683.0	56	0.1	87.9
40	0.1	100.3	14.01	841.0	701.0	56	0.1	88.0
41	0.1	100.4	14.36	862.0	718.0	55	0.1	88.0
42	0.1	100.5	14.71	883.0	736.0	55	0.1	88.1
43	0.2	100.7	15.06	904.0	753.0	55	0.1	88.2
44	0.1	100.8	15.41	925.0	771.0	55	0.1	88.3
45	0.1	100.9	15.76	946.0	788.0	55	0.1	88.3
46	-0.9	100.0	16.11	967.0	806.0	55	N/A	87.8
47	0.1	100.1	16.46	988.0	823.0	55	0.1	87.9
48	-0.1	100.0	16.81	1009.0	841.0	55	N/A	87.8
49	0.0	100.0	17.16	1030.0	858.0	55	0.0	87.8
50	0.0	100.0	17.51	1051.0	876.0	55	0.0	87.8
Estimated Net Annual Sediment (TSS) Load Reduction =								88 %




Stormceptor®EF Sizing Report

RAINFALL DATA FROM OTTAWA MACDONALD-CARTIER INT'L AP RAINFALL STATION

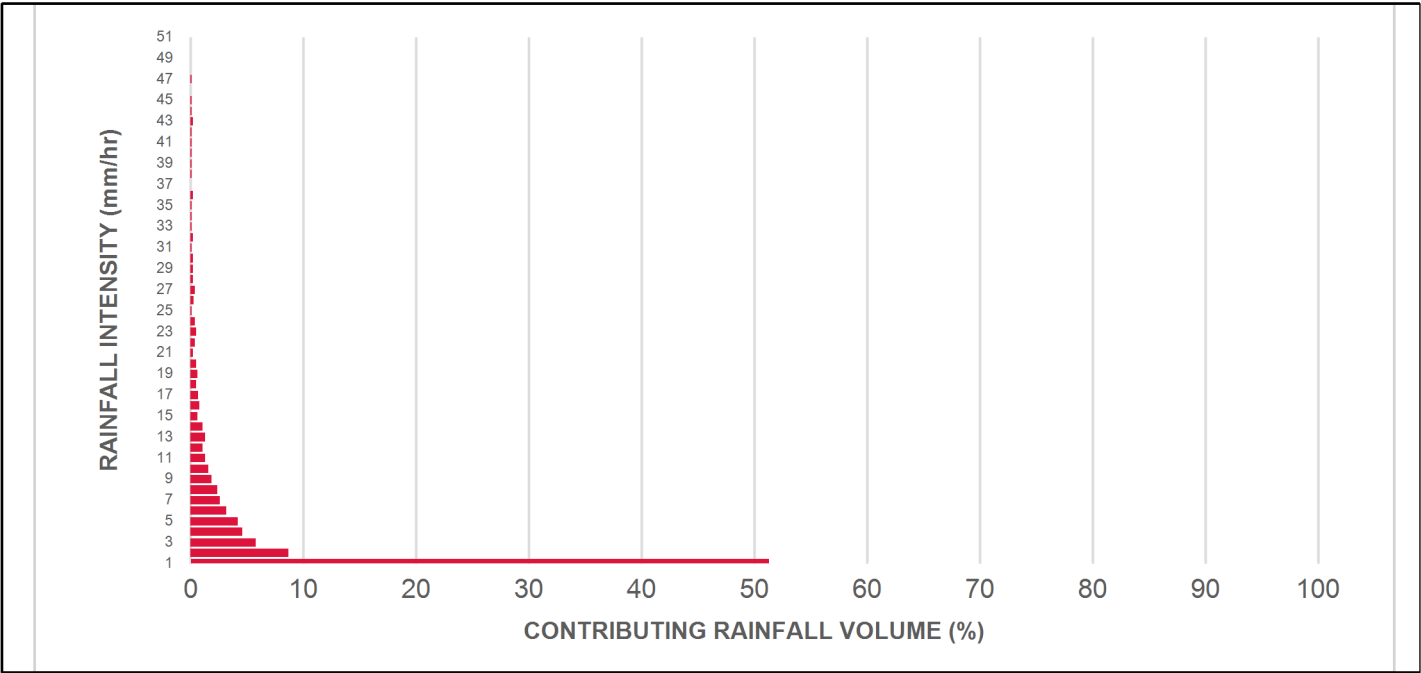

INCREMENTAL AND CUMULATIVE TSS REMOVAL FOR THE RECOMMENDED STORMCEPTOR® MODEL

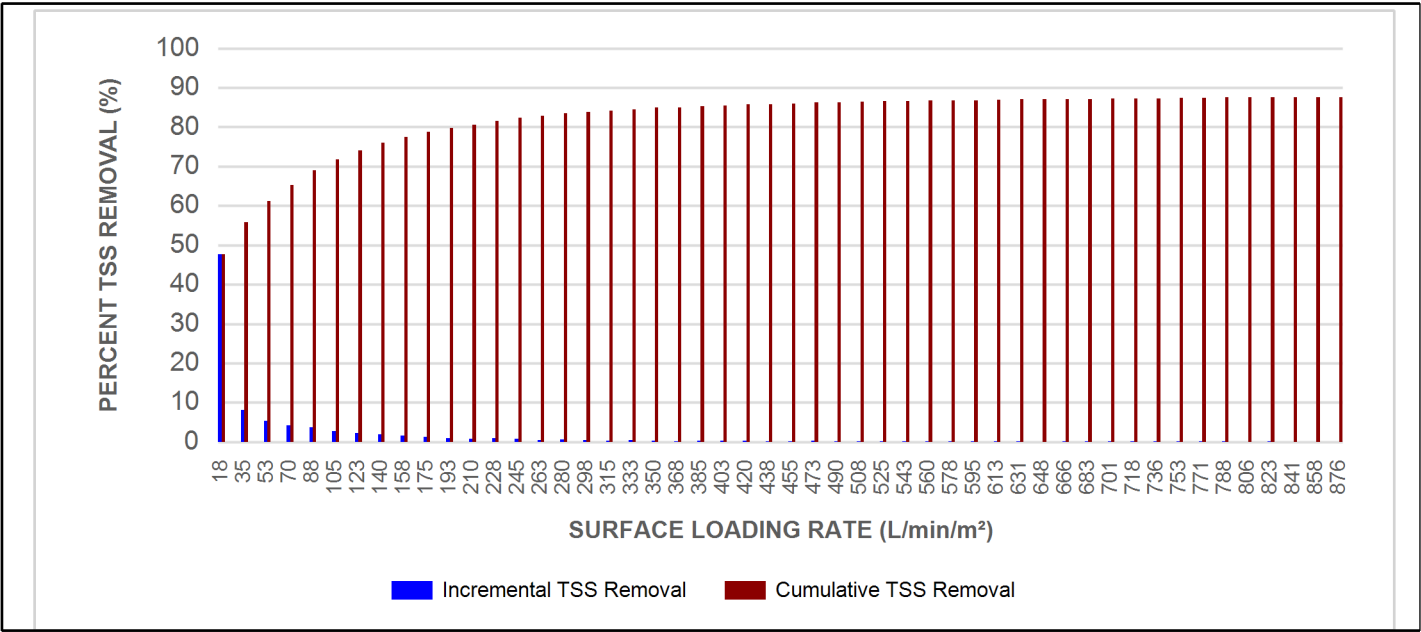

Stormceptor® EF Sizing Report

Maximum Pipe Diameter / Peak Conveyance

Stormceptor EF / EFO	Model Diameter		Min Angle Inlet / Outlet Pipes	Max Inlet Pipe Diameter		Max Outlet Pipe Diameter		Peak Conveyance Flow Rate	
	(m)	(ft)		(mm)	(in)	(mm)	(in)	(L/s)	(cfs)
EF4 / EFO4	1.2	4	90	609	24	609	24	425	15
EF6 / EFO6	1.8	6	90	914	36	914	36	990	35
EF8 / EFO8	2.4	8	90	1219	48	1219	48	1700	60
EF10 / EFO10	3.0	10	90	1828	72	1828	72	2830	100
EF12 / EFO12	3.6	12	90	1828	72	1828	72	2830	100

SCOUR PREVENTION AND ONLINE CONFIGURATION


► **Stormceptor® EF and EFO** feature an internal bypass and superior scour prevention technology that have been demonstrated in third-party testing according to the scour testing provisions of the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators**, and the exceptional scour test performance has been third-party verified in accordance with the ISO 14034 ETV protocol. As a result, Stormceptor EF and EFO are approved for online installation, eliminating the need for costly additional bypass structures, piping, and installation expense.

DESIGN FLEXIBILITY


► **Stormceptor® EF and EFO** offers design flexibility in one simplified platform, accepting stormwater flow from a single inlet pipe or multiple inlet pipes, and/or surface runoff through an inlet grate. The device can also serve as a junction structure, accommodate a 90-degree inlet-to-outlet bend angle, and can be modified to ensure performance in submerged conditions.

OIL CAPTURE AND RETENTION

► While Stormceptor® EF will capture and retain oil from dry weather spills and low intensity runoff, **Stormceptor® EFO** has demonstrated superior oil capture and greater than 99% oil retention in third-party testing according to the light liquid re-entrainment testing provisions of the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators**. Stormceptor EFO is recommended for sites where oil capture and retention is a requirement.

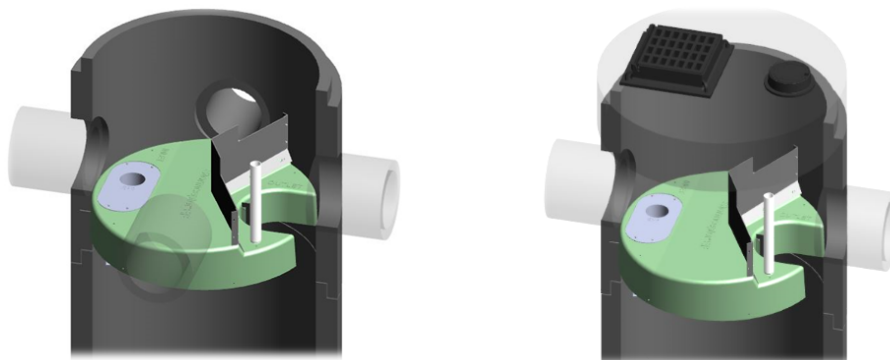

Stormceptor® EF Sizing Report

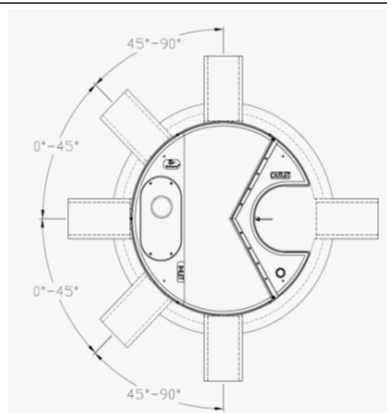

INLET-TO-OUTLET DROP

Elevation differential between inlet and outlet pipe inverts is dictated by the angle at which the inlet pipe(s) enters the unit.

0° - 45° : The inlet pipe is 1-inch (25mm) higher than the outlet pipe.

45° - 90° : The inlet pipe is 2-inches (50mm) higher than the outlet pipe.

HEAD LOSS

The head loss through Stormceptor EF is similar to that of a 60-degree bend structure. The applicable K value for calculating minor losses through the unit is 1.1.

For submerged conditions the applicable K value is 3.0.

Pollutant Capacity

Stormceptor EF / EFO	Model Diameter		Depth (Outlet Pipe Invert to Sump Floor)		Oil Volume		Recommended Sediment Maintenance Depth *		Maximum Sediment Volume *		Maximum Sediment Mass **	
	(m)	(ft)	(m)	(ft)	(L)	(Gal)	(mm)	(in)	(L)	(ft³)	(kg)	(lb)
EF4 / EFO4	1.2	4	1.52	5.0	265	70	203	8	1190	42	1904	5250
EF6 / EFO6	1.8	6	1.93	6.3	610	160	305	12	3470	123	5552	15375
EF8 / EFO8	2.4	8	2.59	8.5	1070	280	610	24	8780	310	14048	38750
EF10 / EFO10	3.0	10	3.25	10.7	1670	440	610	24	17790	628	28464	78500
EF12 / EFO12	3.6	12	3.89	12.8	2475	655	610	24	31220	1103	49952	137875

*Increased sump depth may be added to increase sediment storage capacity

** Average density of wet packed sediment in sump = 1.6 kg/L (100 lb/ft³)

Feature	Benefit	Feature Appeals To
Patent-pending enhanced flow treatment and scour prevention technology	Superior, verified third-party performance	Regulator, Specifying & Design Engineer
Third-party verified light liquid capture and retention for EFO version	Proven performance for fuel/oil hotspot locations	Regulator, Specifying & Design Engineer, Site Owner
Functions as bend, junction or inlet structure	Design flexibility	Specifying & Design Engineer
Minimal drop between inlet and outlet	Site installation ease	Contractor
Large diameter outlet riser for inspection and maintenance	Easy maintenance access from grade	Maintenance Contractor & Site Owner

STANDARD STORMCEPTOR EF/EFO DRAWINGS

For standard details, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

STANDARD STORMCEPTOR EF/EFO SPECIFICATION

For specifications, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

STANDARD PERFORMANCE SPECIFICATION FOR “OIL GRIT SEPARATOR” (OGS) STORMWATER QUALITY TREATMENT DEVICE

PART 1 – GENERAL

1.1 WORK INCLUDED

This section specifies requirements for selecting, sizing, and designing an underground Oil Grit Separator (OGS) device for stormwater quality treatment, with third-party testing results and a Statement of Verification in accordance with ISO 14034 Environmental Management – Environmental Technology Verification (ETV).

1.2 REFERENCE STANDARDS & PROCEDURES

ISO 14034:2016 Environmental management – Environmental technology verification (ETV)

Canadian Environmental Technology Verification (ETV) Program's **Procedure for Laboratory Testing of Oil-Grit Separators**.

1.3 SUBMITTALS

1.3.1 All submittals, including sizing reports & shop drawings, shall be submitted upon request with each order to the contractor then forwarded to the Engineer of Record for review and acceptance. Shop drawings shall detail all OGS components, elevations, and sequence of construction.

1.3.2 Alternative devices shall have features identical to or greater than the specified device, including: treatment chamber diameter, treatment chamber wet volume, sediment storage volume, and oil storage volume.

1.3.3 Unless directed otherwise by the Engineer of Record, OGS stormwater quality treatment product substitutions or alternatives submitted within ten days prior to project bid shall not be accepted. All alternatives or substitutions submitted shall be signed and sealed by a local registered Professional Engineer, based on the exact same criteria detailed in Section 3, in entirety, subject to review and approval by the Engineer of Record.

PART 2 – PRODUCTS

2.1 OGS POLLUTANT STORAGE

The OGS device shall include a sump for sediment storage, and a protected volume for the capture and storage of petroleum hydrocarbons and buoyant gross pollutants. The **minimum** sediment & petroleum hydrocarbon storage capacity shall be as follows:

2.1.1	4 ft (1219 mm) Diameter OGS Units:	1.19 m ³ sediment / 265 L oil
	6 ft (1829 mm) Diameter OGS Units:	3.48 m ³ sediment / 609 L oil
	8 ft (2438 mm) Diameter OGS Units:	8.78 m ³ sediment / 1,071 L oil
	10 ft (3048 mm) Diameter OGS Units:	17.78 m ³ sediment / 1,673 L oil
	12 ft (3657 mm) Diameter OGS Units:	31.23 m ³ sediment / 2,476 L oil

PART 3 – PERFORMANCE & DESIGN

3.1 GENERAL

Stormceptor®EF Sizing Report

The OGS stormwater quality treatment device shall be verified in accordance with ISO 14034:2016 Environmental management – Environmental technology verification (ETV). The OGS stormwater quality treatment device shall remove oil, sediment and gross pollutants from stormwater runoff during frequent wet weather events, and retain these pollutants during less frequent high flow wet weather events below the insert within the OGS for later removal during maintenance. The Manufacturer shall have at least ten (10) years of local experience, history and success in engineering design, manufacturing and production and supply of OGS stormwater quality treatment device systems, acceptable to the Engineer of Record.

3.2 SIZING METHODOLOGY

The OGS device shall be engineered, designed and sized to provide stormwater quality treatment based on treating a minimum of 90 percent of the average annual runoff volume and a minimum removal of an annual average 60% of the sediment (TSS) load based on the Particle Size Distribution (PSD) specified in the sizing report for the specified device. Sizing shall be determined using historical rainfall data and a sediment removal performance curve derived from the actual third-party verified laboratory testing data. The OGS device shall also have sufficient annual sediment storage capacity as specified and calculated in Section 2.1.

3.3 CANADIAN ETV or ISO 14034 ETV VERIFICATION OF SCOUR TESTING

The OGS device shall have Canadian ETV or ISO 14034 ETV Verification of third-party scour testing conducted in accordance with the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**.

3.3.1 To be acceptable for on-line installation, the OGS device must demonstrate an average scour test effluent concentration less than 10 mg/L at each surface loading rate tested, up to and including 2600 L/min/m².

APPENDIX “E”

Boundary Conditions

Boundary Conditions 1592 Tenth Line

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	10	0.17
Maximum Daily Demand	26	0.43
Peak Hour	56	0.94
Fire Flow Demand #1	8,200	136.67

Location



Results

Connection 1 – Phoenix Cres.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	130.2	60.4
Peak Hour	125.7	54.1
Max Day plus Fire 1	115.9	40.2

¹ Ground Elevation = 87.69 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

APPENDIX “F”

Engineering Drawings

EROSION AND SEDIMENT CONTROL MEASURES:

** CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES **

1. PRIOR TO START OF CONSTRUCTION:

- 1.1. PRIOR TO THE REMOVAL OF ANY VEGETATIVE COVER, MOVING OF ANY SOIL, AND CONSTRUCTION:
 - 1.1.1. INSTALL SILT FENCE IMMEDIATELY DOWNSTREAM FROM AREAS TO BE DISTURBED (SEE PLAN FOR LOCATION).
 - 1.1.2. INSTALL GEOSOCK INSERTS WITH AN OVERFLOW IN ALL THE DOWNSTREAM CATCH BASINS AND MANHOLES.
 - 1.1.3. INSTALL SILTSACK FILTERS IN ALL CONCRETE CATCH BASIN STRUCTURES.
 - 1.1.4. INSPECT MEASUREMENTS IMMEDIATELY AFTER INSTALLATION.





2. DURING CONSTRUCTION:

- 2.1. WORK TO BE DONE IN THE VICINITY OF MAJOR WATERWAYS TO BE CARRIED OUT FROM JULY TO SEPTEMBER ONLY.
- 2.2. MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE.
- 2.3. PROTECT DISTURBED AREAS FROM RUNOFF.
- 2.4. PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED WITHIN 30 DAYS.
- 2.5. INSPECT SILT FENCE, FILTER CLOTHS, AND CATCH BASIN SUMPS WEEKLY AND AFTER EVERY MAJOR OR STORM EVENT. CLEAN AND REPAIR WHEN NECESSARY.
- 2.6. PLAN TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION.
- 2.7. EROSION CONTROL FENCING TO BE ALSO INSTALLED AROUND THE BASE OF ALL STOCKPILES.
- 2.8. DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 2.5m FROM ANY PAVED SURFACE, OR ONE WHICH IS TO BE PAVED BEFORE PILE IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDING IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (30 DAYS).

- 2.9. CONTROL WIND-BLOWN DUST OFF SITE TO ACCEPTABLE LEVELS BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY (PROVIDE WATERING AS REQUIRED).
 - 2.10. ALL EROSION CONTROL STRUCTURE TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE GROUND COVER.
 - 2.11. NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THIS CONSULTING ENGINEER AND THE CITY DEPARTMENT OF PUBLIC WORKS. TO PREVENT UNNECESSARY SEDIMENT DISCHARGE, THE CONTRACTOR IS PERMITTED TO PLACE ADDITIONAL SEDIMENT AND EROSION CONTROL MEASURES IN A TIMELY MANNER, IF REQUIRED, THE CONTRACTOR TO ADVISE CONSULTANT ONCE INSTALLED FOR INSPECTION.
 - 2.12. CONTRACTOR RESPONSIBLE FOR CITY ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEDIMENT FROM VEHICULAR TRACKING ETC, AT THE END OF EACH WORK DAY.
 - 2.13. PROVIDE GRAVEL ENTRANCE WHEREVER EQUIPMENT LEAVES THE SITE TO PREVENT MUD TRACKING ONTO PAVED SURFACES. GRAVEL BED SHALL BE A MINIMUM OF 15m LONG, 4m WIDE AND 0.3m DEEP AND SHALL CONSIST OF COARSE (50mm CRUSHER-RUN LIMESTONE). MAINTAIN GRAVEL ENTRANCE IN CLEAN CONDITION.
 - 2.14. DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAPPED.
 - 2.15. ANY MUD/MATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE LOADER.
 - 2.16. TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE BEING SPILLED OR TRACKED ONTO ADJUTING PROPERTIES OR PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.
3. AFTER CONSTRUCTION:
- 3.1. PROVIDE PERMANENT COVER CONSISTING OF TOPSOIL AND SEED TO DISTURBED AREA.
 - 3.2. REMOVE STRAW BALE FLOW CHECK DAMS, SILT FENCES AND FILTER CLOTHS ON CATCH BASINS AND MANHOLE COVERS AFTER DISTURBED AREAS HAVE BEEN REHABILITATED AND STABILIZED.
 - 3.3. INSPECT AND CLEAN CATCH BASIN SUMPS AND STORM SEWERS.

LEGEND:

- EXISTING PROPERTY LINE TO REMAIN
PROPOSED EASEMENT
PROPOSED TERRACING (3:1 MIN.)
PROPOSED DOOR ENTRANCE/EXIT
PROPOSED ELEVATION
PROPOSED BOTTOM OF WALL ELEVATION
PROPOSED TOP OF SIDEWALK ELEVATION
MATCH INTO EXISTING ELEVATION
EXISTING ELEVATION
PROPOSED OVERLAND MAJOR FLOW ROUTE
PROPOSED SILT FENCE AS PER OPSD 219.110
PROPOSED 200mmØ PERFORATED SUBDRAIN
PROPOSED STORM SEWER
PROPOSED SANITARY SEWER
PROPOSED WATERMAIN
EXISTING SANITARY SEWER
EXISTING WATERMAIN
PROPOSED CATCH BASIN/MANHOLE/CATCH BASIN
PROPOSED CURB STOP
PROPOSED 100 YEAR HIGH WATER LEVEL
STORM WATERSHED EXTENT
WATERSHED NAME
RUNOFF COEFFICIENT
AREA IN HECTARES
PROPOSED GRASS AREA, REFER TO LANDSCAPE
PROPOSED CONCRETE FEATURES/SLAB
PROPOSED HEAVY DUTY ASPHALT
PROPOSED LIGHT DUTY ASPHALT
PROPOSED GRAVEL AREA
PROPOSED RIP RAP AS PER OPSD 810.010
PROPOSED WATER METER

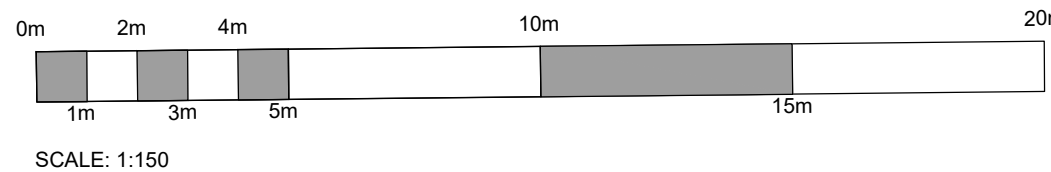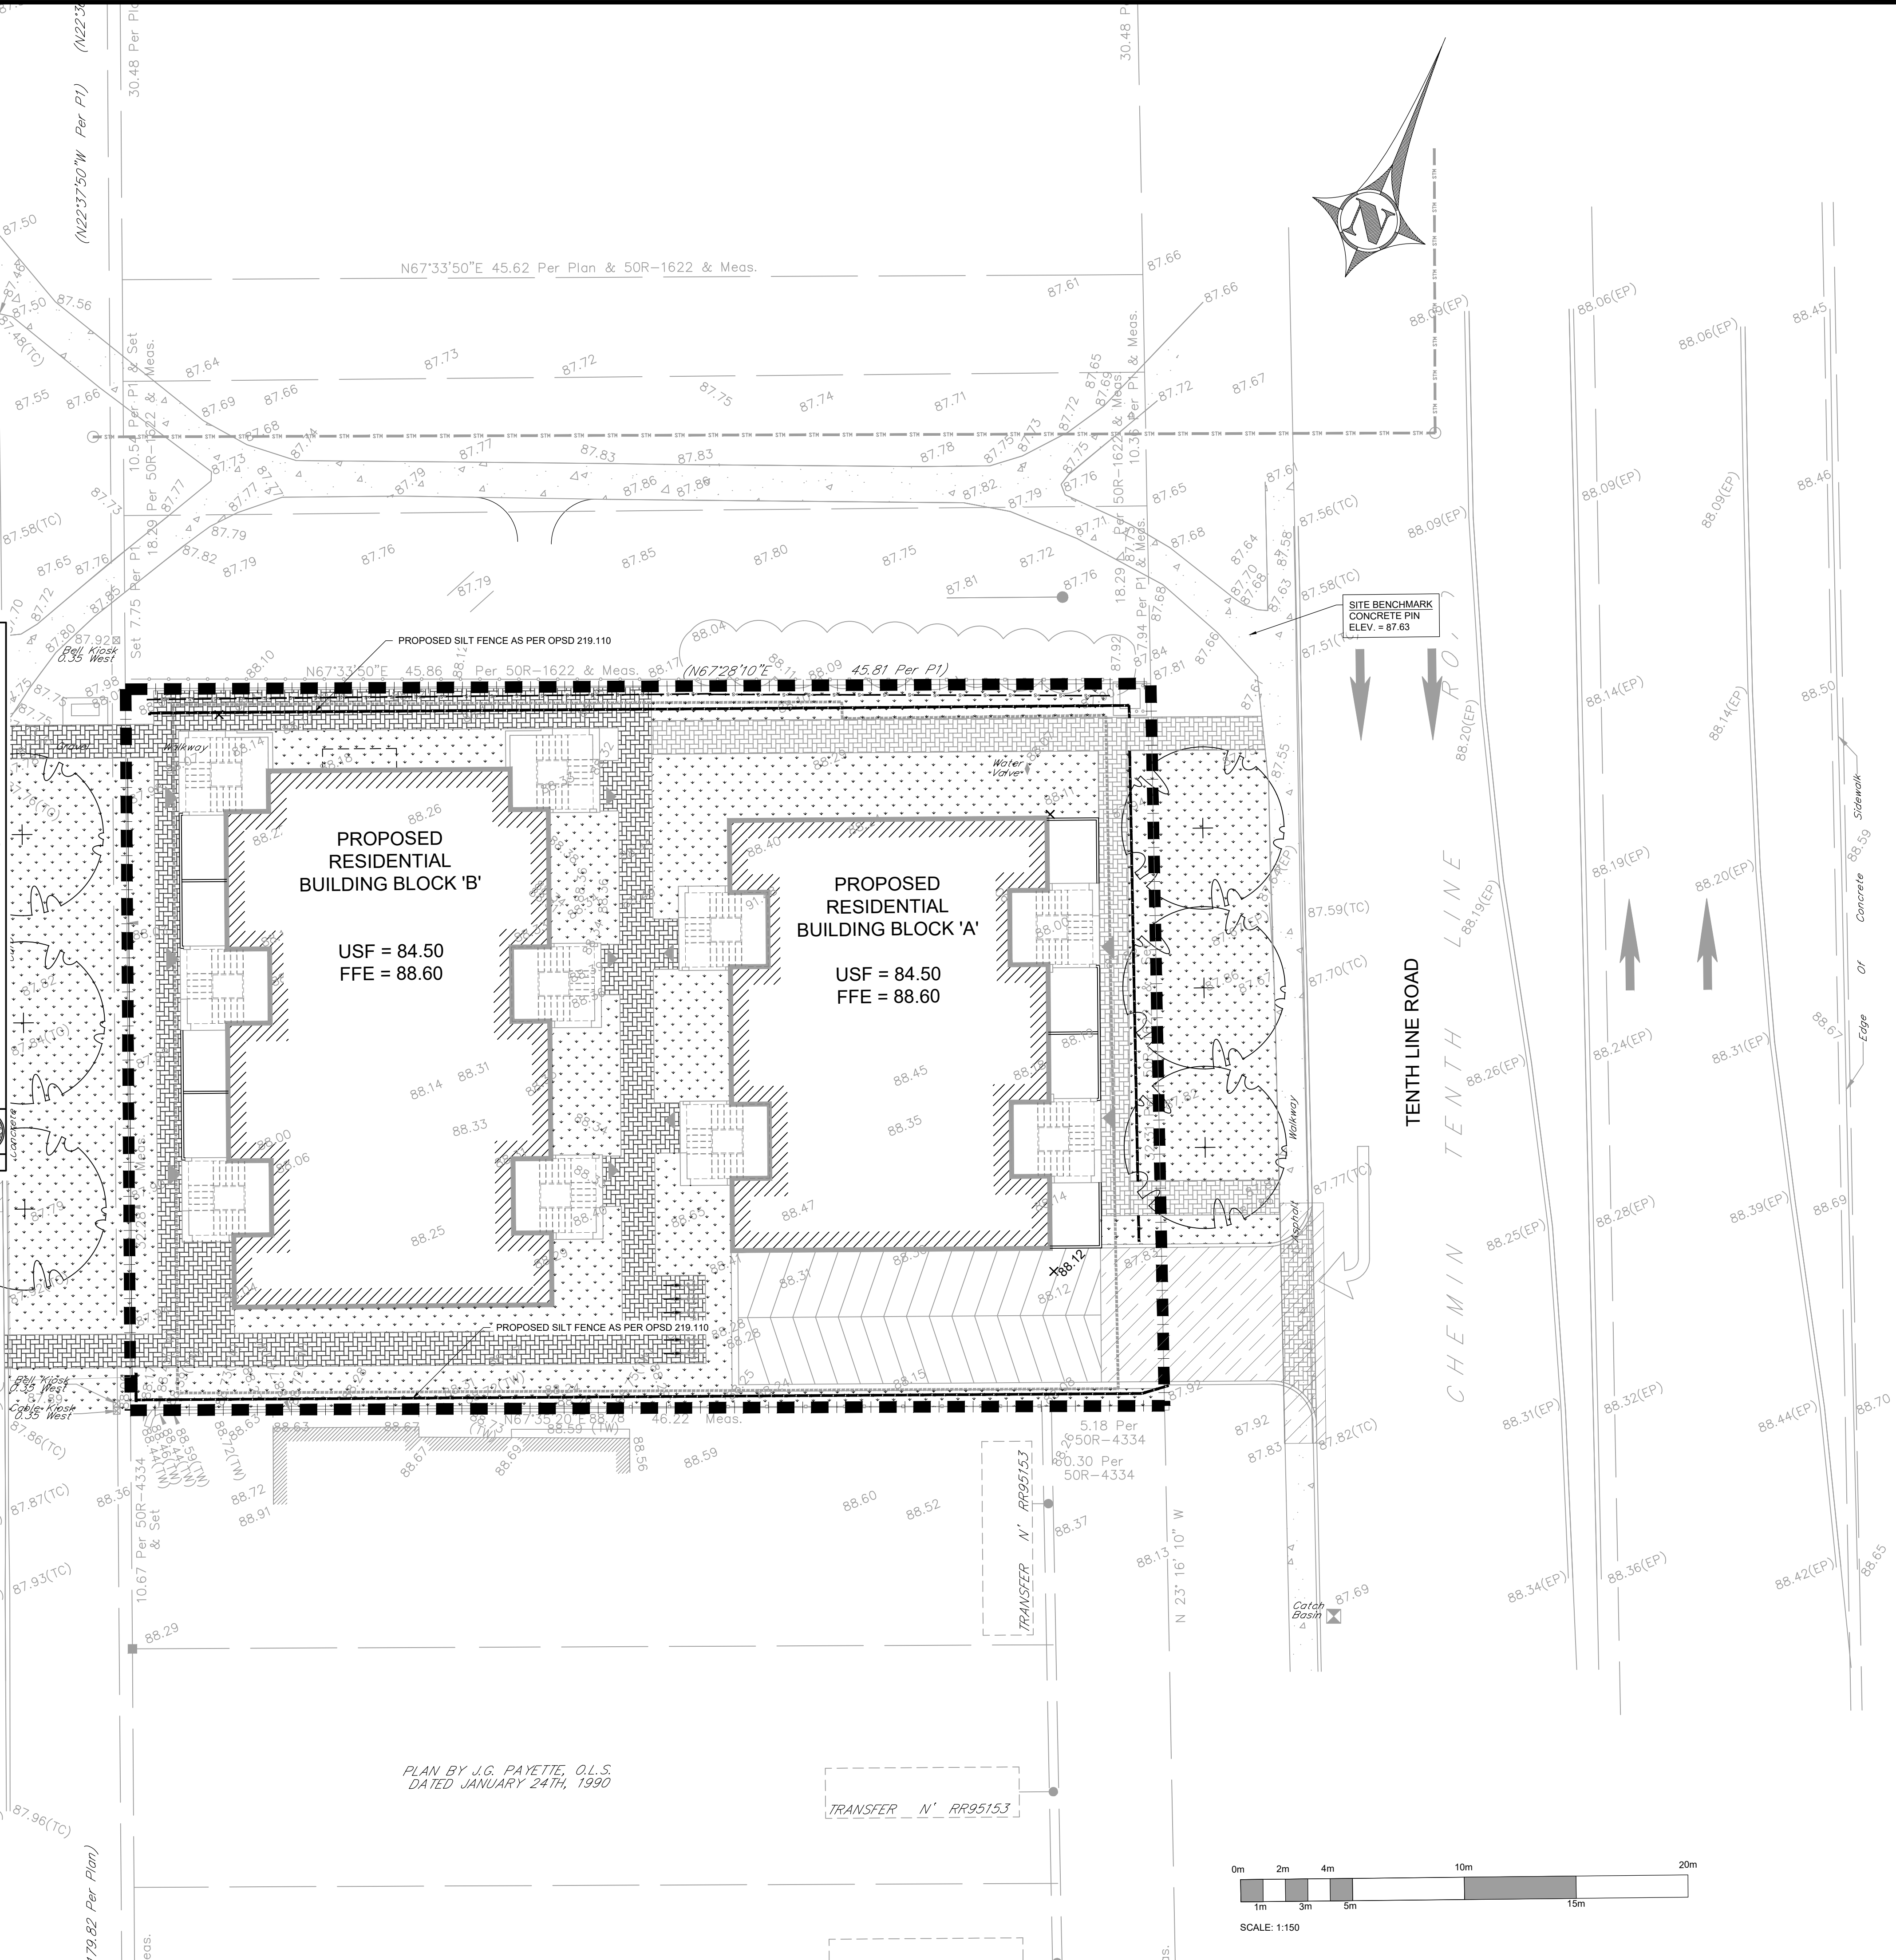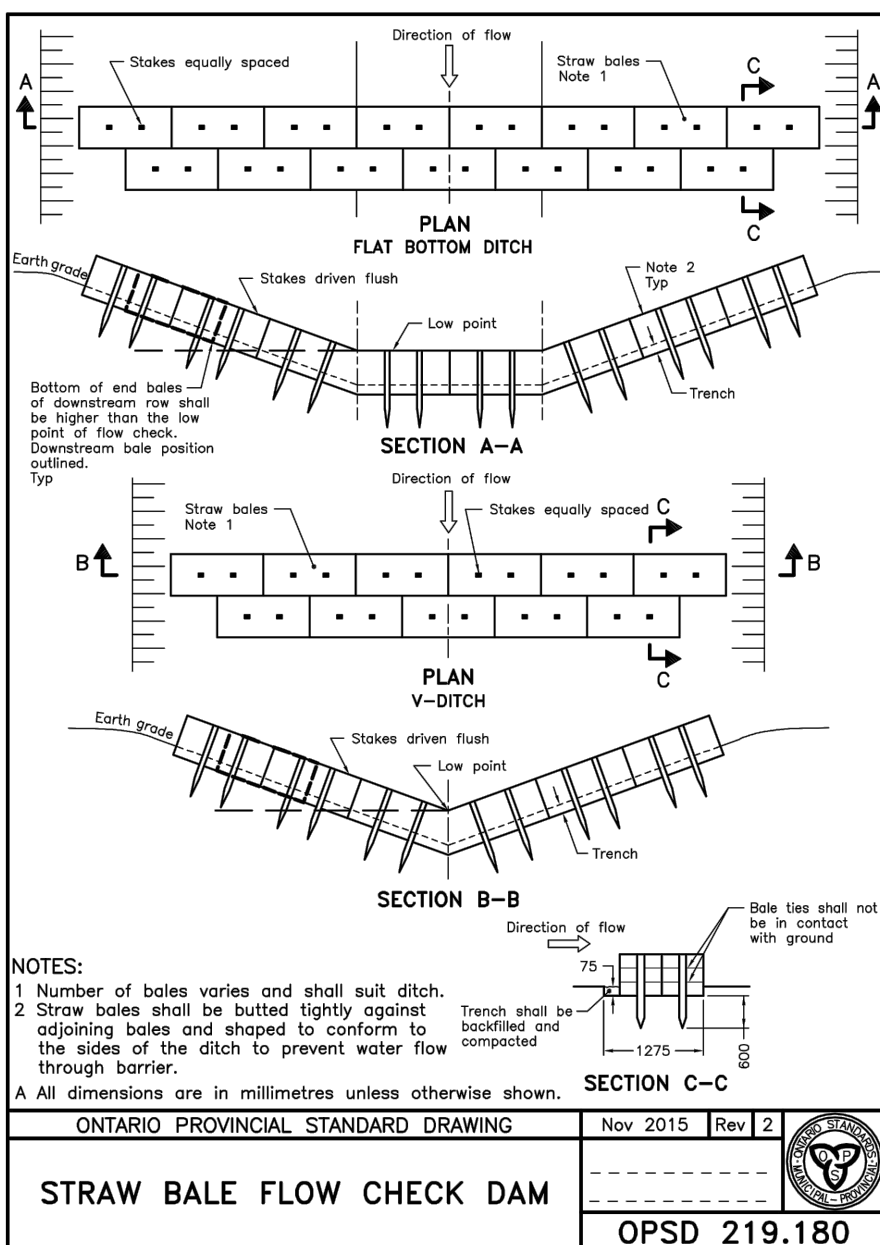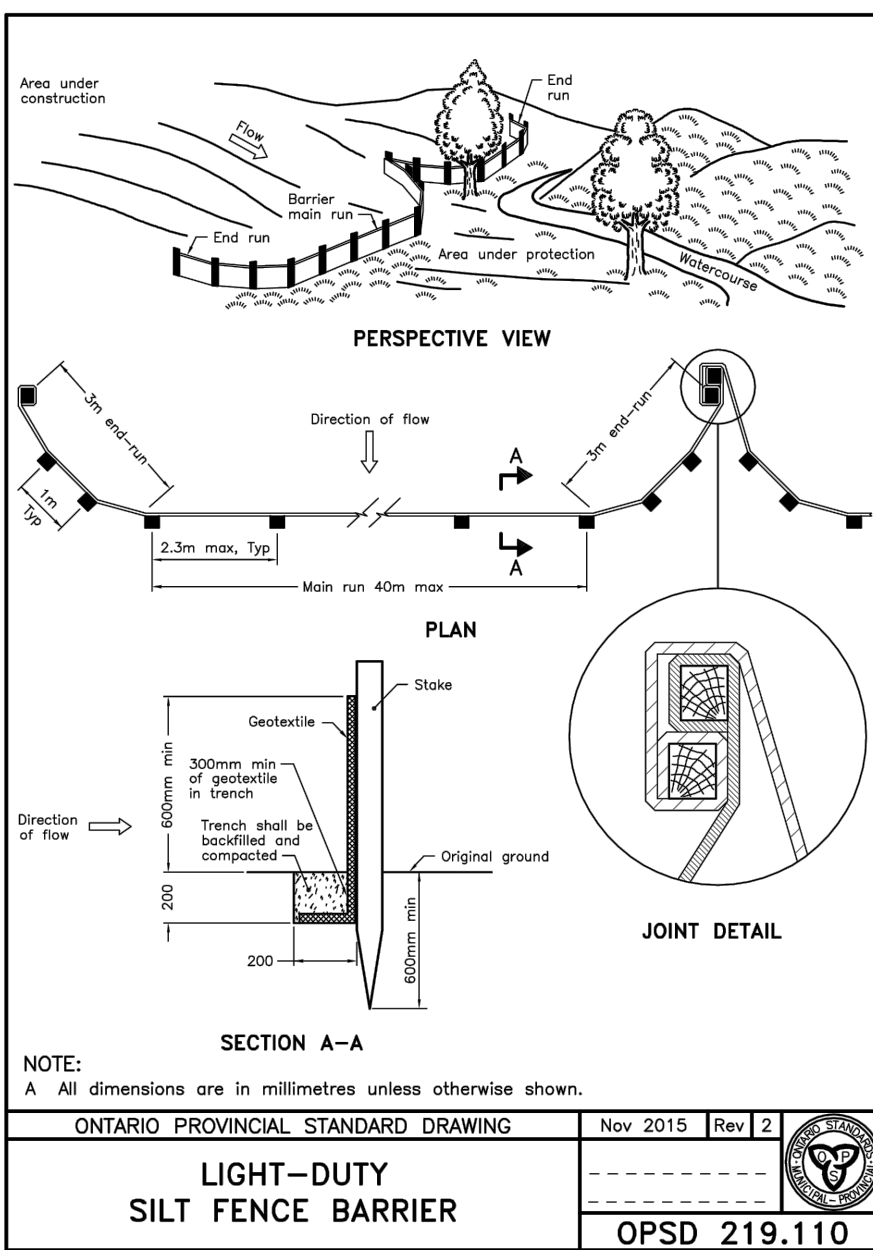

COPYRIGHT RESERVED
THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE OF ALL DIMENSIONS. DO NOT SCALE THE DRAWING. ANY DISCREPANCY OR OMISSIONS SHALL BE REPORTED TO BLANCHARD LETENDRE ENGINEERING LTD. WITHOUT DELAY. THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF BLANCHARD LETENDRE ENGINEERING LTD. REPRODUCTION OR USE FOR ANY PURPOSE OTHER THAN THAT AUTHORIZED BY BLANCHARD LETENDRE ENGINEERING LTD. IS STRICTLY PROHIBITED.

ENGINEERING STAMP



#8	
#7	
#6	
#5	
#4	
#3	
#2	ISSUED FOR CITY COMMENTS
#1	ISSUED FOR SPA
NO. / REVISION	DATE (DD/MM/YYYY)

BLANCHARD LETENDRE ENGINEERING

767, Notre Dame, Local 42, Embrun, Ontario,
(613) 693-0700 K0A 1M1 blngengineering.ca

CLIENT:
BRIDOR DEVELOPMENT
996-B ST. AUGUSTIN RD.
EMBRUN, ON



PROJECT:
NEW RESIDENTIAL DEVELOPMENT
1592 TENTH LINE RD,
ORLEANS, ON

DRAWING:
SEDIMENT & EROSION CONTROL PLAN

PAPER FORMAT:	24x36
DRAWN BY:	BF + GB
CHECKED BY:	GB
DATE:	07-2022
SCALE:	1:150
PROJECT NUMBER:	20-363


PAGE:
C100

LEGEND:

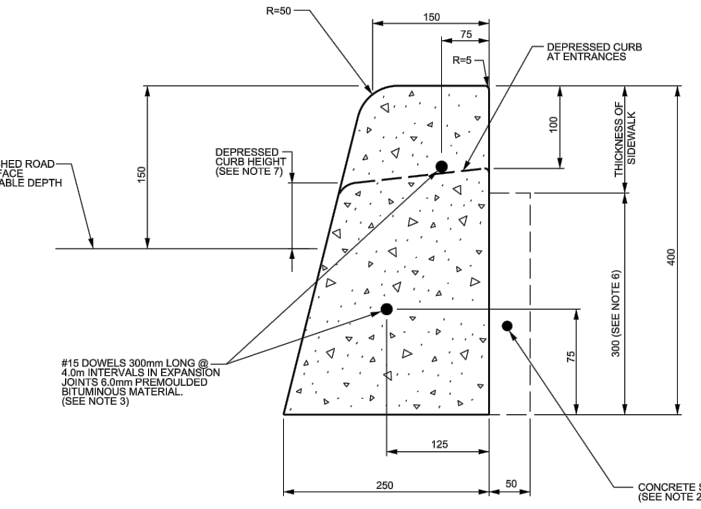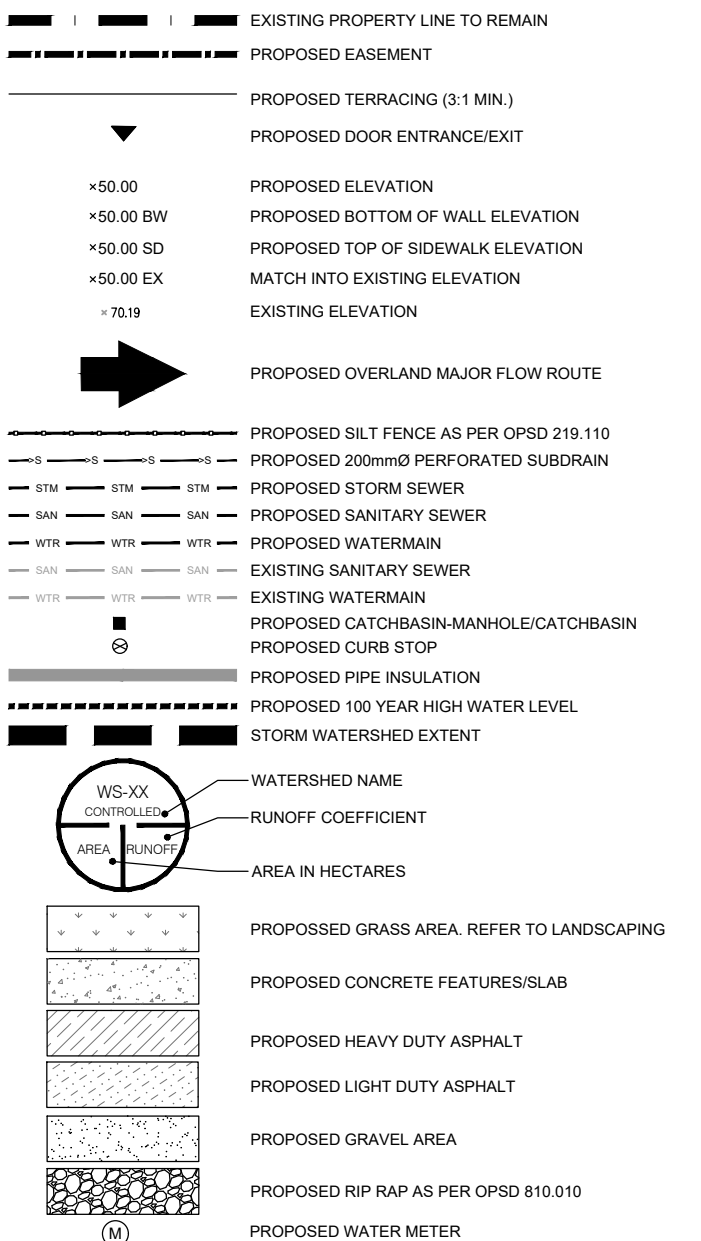

NOTES:
 1. THE FULL CURB DEPTH SHALL BE CARRIED THROUGH THE DEPRESSED ACCESS CROSSING.
 2. A CONCRETE SUPPORT IS REQUIRED WHEN BUILT ADJACENT TO THE SIDEWALK.
 3. ALL DIMENSIONS SHOWN UNLESS OTHERWISE NOTED.
 4. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
 5. DRAINAGE JOINTS SHALL BE 30mm DEEP, FRONT BACK AND TOP OF SECTION AT 3m SPACING.
 6. FOR DEPRESSED CURB AT ENTRANCES USE 200mm.
 7. DEPRESSED CURB HEIGHT: FOR PEDESTRIAN CURB RAMP 0 to 6mm AND FOR PRIVATE ENTRANCES 0 to 20mm.

	CONCRETE BARRIER CURB FOR GRANULAR BASE PAVEMENT (MODIFIED OPSD-600.110)	DATE: JANUARY 2007 REVISION: MARCH 2014 DWG. NO.: SC1.1
--	---	---

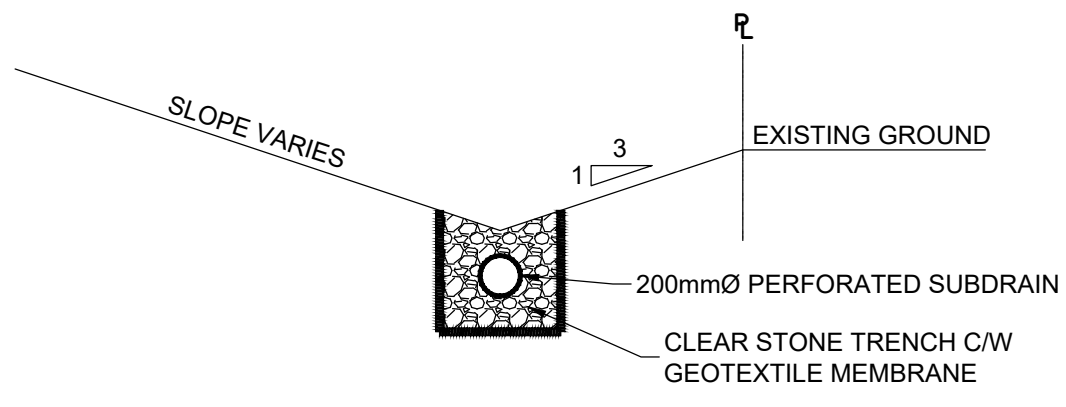

PAVEMENT STRUCTURE

COURSE	MATERIAL	THICKNESS (mm)	
		AUTOMOBILE PARKING	TRUCK ROUTE (HEAVY TRAFFIC)
SURFACE	HL.3 A/C (PG 58-28)	50	40
BINDER	HL.8 A/C (PG 58-28)	--	50
BASECOURSE	GRANULAR "A"	150	150
SUBBASE	GRANULAR "B" TYPE II	350	450

NOTE:
 IN PREPARATION FOR PAVEMENT CONSTRUCTION AT THIS SITE, ANY SURFICIAL OR NEAR SURFACE/SUBGRADE LEVEL TOPSOIL AND ANY SOFT, WET OR DELETERIOUS MATERIALS SHOULD BE REMOVED FROM THE PROPOSED PAVED AREAS. THE EXPOSED SUBGRADE SHOULD BE INSPECTED AND APPROVED BY GEOTECHNICAL PERSONNEL AND ANY SOFT AREAS EVIDENT SHOULD BE SUBEXCAVATED AND REPLACED WITH SUITABLE EARTH BORROW APPROVED BY THE GEOTECHNICAL ENGINEER. THE SUBGRADE SHOULD BE SHAPED AND CROWNED TO PROMOTE DRAINAGE OF THE SITE DRAINAGE STRUCTURES. FOLLOWING APPROVAL OF THE PREPARATION OF THE SUBGRADE, THE PAVEMENT GRANULARS MAY BE PLACED.

CONTRACTOR TO COMPLETE ROAD CUT AS PER CITY OF OTTAWA R10. IN ORDER TO COMPLETE SERVICE CONNECTION, CONTRACTOR TO MATCH EXISTING ROAD STRUCTURE. PROVIDE SMOOTH TRANSITION BETWEEN EXISTING AND NEW ASPHALT. SAW CUT JOINTS AND SEAL WITH ADHESIVE TYPE "CRAFCO" OR EQUIVALENT. MINIMUM ROAD PAVEMENT STRUCTURE

HL.3 = 50mm
 HL.8 = 50mm
 GRANULAR "A" = 150mm
 GRANULAR "B" = 450mm

PROPOSED RESIDENTIAL BUILDING BLOCK 'B'

USF = 84.50
 FFE = 88.60

PROPOSED RESIDENTIAL BUILDING BLOCK 'A'

USF = 84.50
 FFE = 88.60

COPYRIGHT RESERVED
 THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE OF ALL DIMENSIONS. DO NOT SCALE THE DRAWING. ANY ERRORS OR OMISSIONS SHALL BE REPORTED TO BLANCHARD LETENDRE ENGINEERING LTD. WITHOUT DELAY. THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF BLANCHARD LETENDRE ENGINEERING LTD. REPRODUCTION OR USE FOR ANY PURPOSE OTHER THAN THAT AUTHORIZED BY BLANCHARD LETENDRE ENGINEERING LTD. IS STRICTLY PROHIBITED.

ENGINEERING STAMP



#5		
#6		
#7		
#8		
#9		
#2	ISSUED FOR CITY COMMENTS	14/06/2022
#1	ISSUED FOR SPA	19/11/2020
NO.	REVISION	DATE (DDMMYYYY)

BLANCHARD LETENDRE
 ENGINEERING
 767, Notre Dame, Local 42, Embrun, Ontario,
 (613) 693-0700 K0A 1W1 blngengineering.ca

CLIENT:

BRIDOR DEVELOPMENT
 996-B ST. AUGUSTIN RD.
 EMBRUN, ON

PROJECT:

NEW RESIDENTIAL DEVELOPMENT
 1592 TENTH LINE RD,
 ORLEANS, ON


DRAWING:

SITE GRADING PLAN

PAPER FORMAT: 24x36
 DRAWN BY: BF + GB
 CHECKED BY: GB
 DATE: 07-2022
 SCALE: 1:150
 PROJECT NUMBER: 20-363

PAGE:

C200

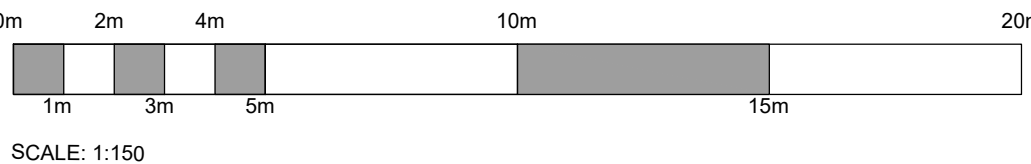

EXISTING PROPERTY LINE TO REMAIN

PROPOSED EASEMENT

PROPOSED TERRACING (3:1 MIN.)

PROPOSED DOOR ENTRANCE/EXIT

PROPOSED ELEVATION

PROPOSED BOTTOM OF WALL ELEVATION

PROPOSED TOP OF SIDEWALK ELEVATION

MATCH INTO EXISTING ELEVATION

EXISTING ELEVATION

PROPOSED OVERLAND MAJOR FLOW ROUTE

PROPOSED SLOTTED FENCE AS PER OSD 219.110

PROPOSED 200mmd PERFORATED SUBDRAIN

PROPOSED STORM SEWER

PROPOSED SANITARY SEWER

PROPOSED WATERMAIN

EXISTING SANITARY SEWER

EXISTING WATERMAIN

PROPOSED CATCH-BASIN/MAN-HOLE/CATCH-BASIN

PROPOSED CURB STOP

PROPOSED PIPE INSULATION

PROPOSED 100 YEAR HIGH WATER LEVEL

STORM WATERWATER EXTENT

WATERSHED NAME

RUNOFF COEFFICIENT

AREA IN HECTARES

PROPOSED GRASS AREA. REFER TO LANDSCAPING

PROPOSED CONCRETE FEATURES/SLAB



PROPOSED HEAVY DUTY ASPHALT

PROPOSED LIGHT DUTY ASPHALT

PROPOSED GRAVEL AREA

PROPOSED R/R RAP AS PER OPSD 810.010



PROPOSED WATER METER

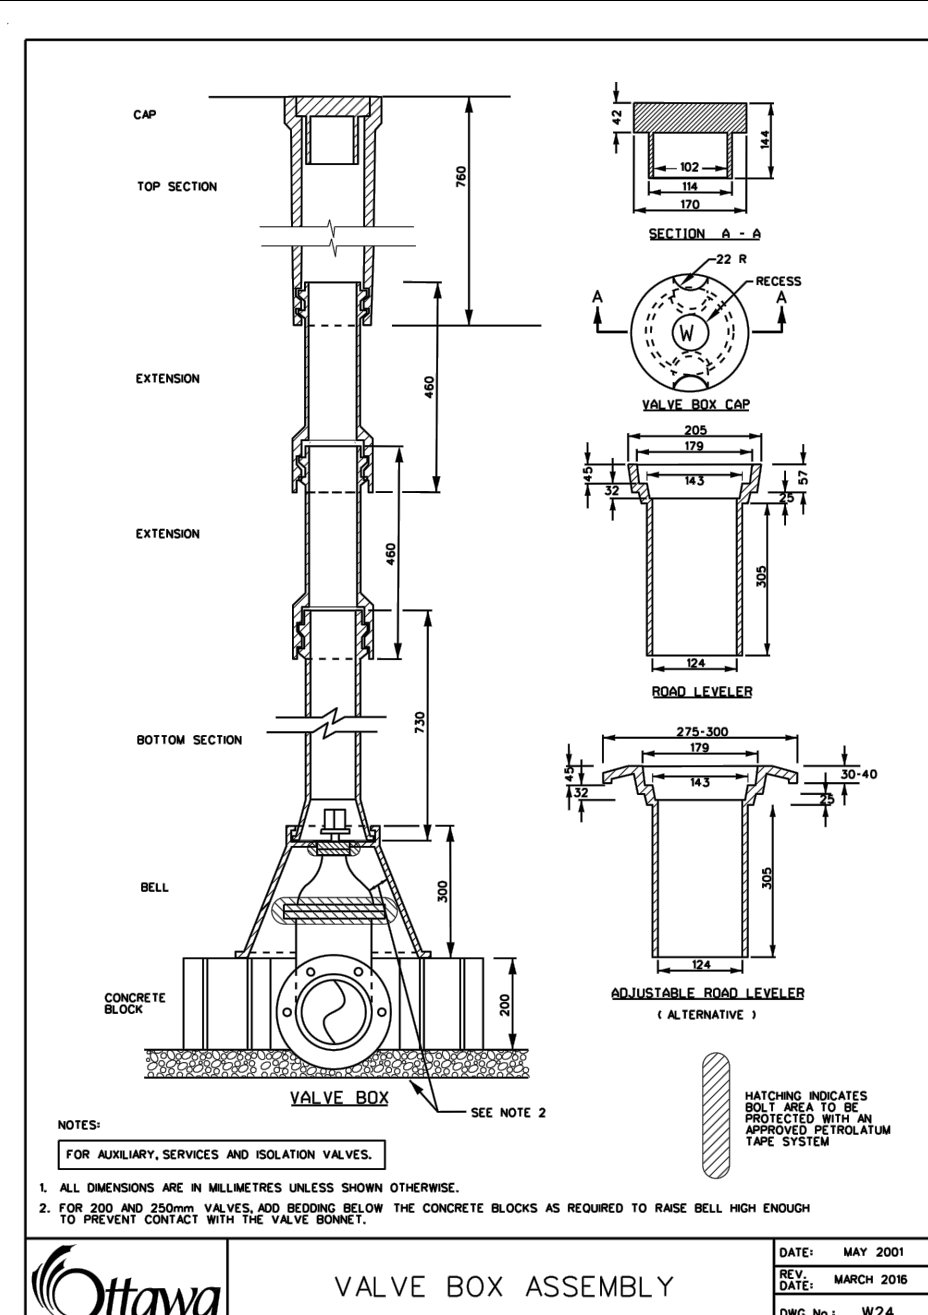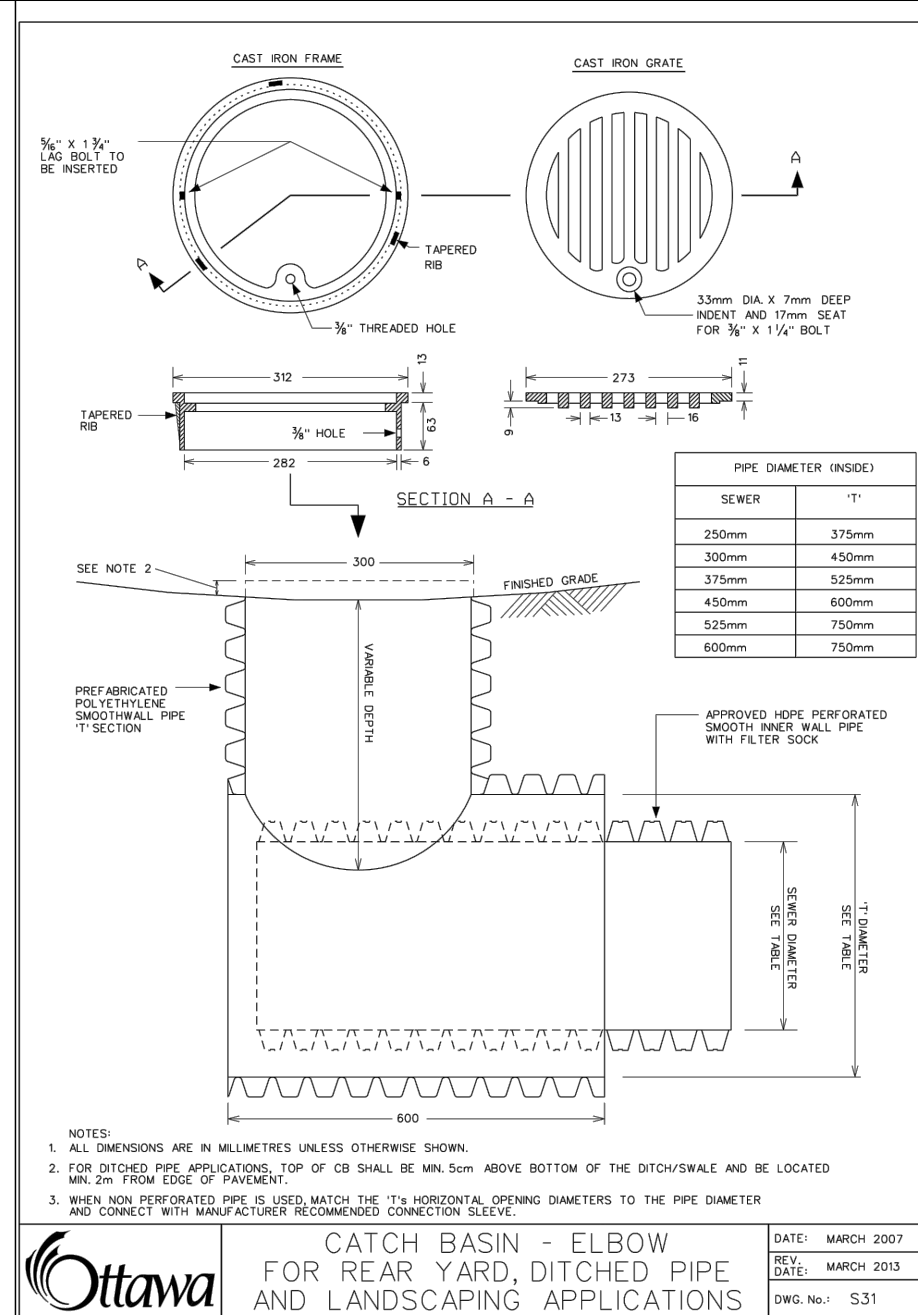

COPYRIGHT RESERVED
THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE OF ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS OR OMISSIONS SHALL BE REPORTED TO BLANCHARD LETENDRE ENGINEERING LTD. WITHOUT DELAY. THE COPYRIGHT TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF BLANCHARD LETENDRE ENGINEERING LTD. REPRODUCTION OR USE FOR ANY PURPOSE OTHER THAN THAT AUTHORIZED BY BLANCHARD LETENDRE ENGINEERING LTD. IS STRICTLY PROHIBITED.

PLAN BY J.G. PAYETTE, O.L.S.
DATED JANUARY 24TH, 1990

TRANSFER N' RR95153

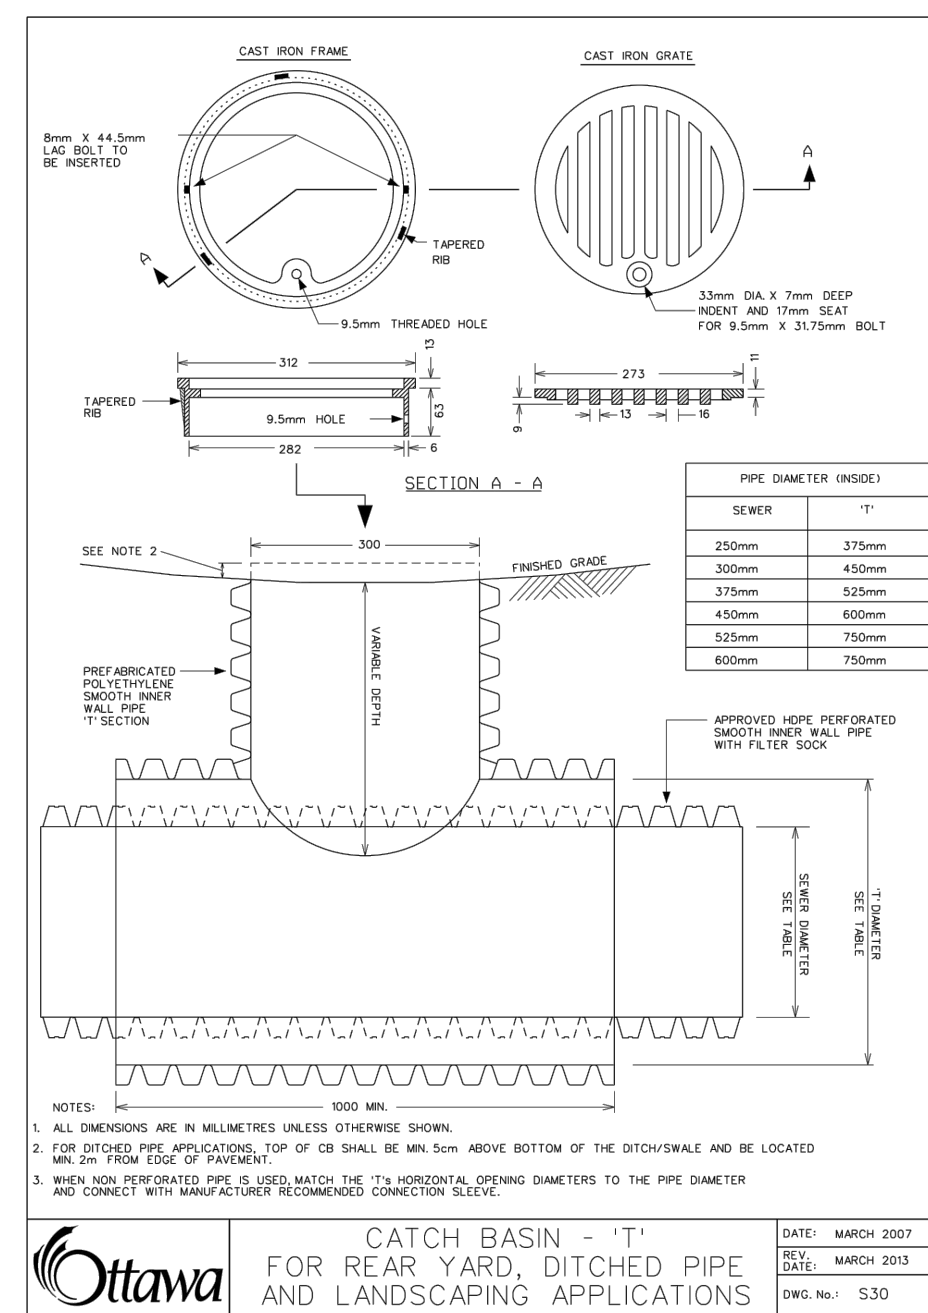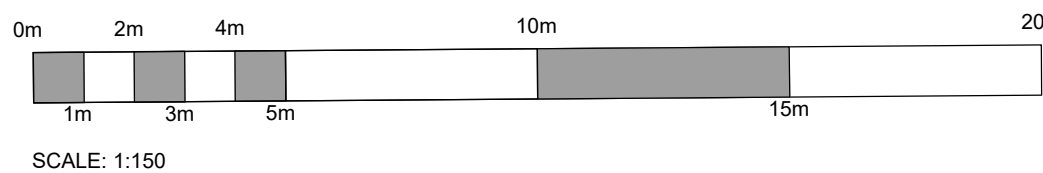

ENGINEERING STAMP



#8		
#7		
#6		
#5		
#4		
#3		
#2	ISSUED FOR CITY COMMENTS	14 / 06 / 2022
#1	ISSUED FOR SPA	19 / 11 / 2020
NO.	REVISION	DATE (DD/MM/YYYY)

B
BLANCHARD LETENDRE
ENGINEERING

767, Notre Dame, Local 42, Embrun, Ontario,
513) 693-0700 K0A 1W1 blengineering.ca

CLIENT:

BRIDOR DEVELOPMENT
996-B ST. AUGUSTIN RD.
EMBRUN, ON

PROJECT:

**NEW RESIDENTIAL
DEVELOPMENT**
1592 TENTH LINE RD,
ORLEANS, ON


DRAWING:

SITE SERVICING PLAN

PAPER FORMAT:	24x36
DRAWN BY:	BF + GB
CHECKED BY:	GB
DATE:	07-2022
SCALE:	1:150
PROJECT NUMBER:	20-363

PAGE:
C300

- LEGEND:**
- EXISTING PROPERTY LINE TO REMAIN
 - PROPOSED EASEMENT
 - PROPOSED TERRACING (3:1 MIN)
 - PROPOSED DOOR ENTRANCE/EXIT
 - +50.00 PROPOSED ELEVATION
 - +50.00 BW PROPOSED BOTTOM OF WALL ELEVATION
 - +50.00 SD PROPOSED TOP OF SIDEWALK ELEVATION
 - +50.00 EX MATCH INTO EXISTING ELEVATION
 - +70.18 EXISTING ELEVATION
 - PROPOSED OVERLAND MAJOR FLOW ROUTE
 - PROPOSED SILT FENCE AS PER OPSD 219.110
 - PROPOSED 200mmHD PERFORATED SUBDRAIN
 - PROPOSED STORM SEWER
 - PROPOSED SANITARY SEWER
 - PROPOSED WATERMAIN
 - EXISTING SANITARY SEWER
 - EXISTING WATERMAIN
 - PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
 - PROPOSED CURB STOP
 - PROPOSED PIPE INSULATION
 - PROPOSED 100 YEAR HIGH WATER LEVEL
 - STORM WATERSHED EXTENT
 - WATERSHED NAME
 - RUNOFF COEFFICIENT
 - AREA IN HECTARES
 - PROPOSED GRASS AREA. REFER TO LANDSCAPING
 - PROPOSED CONCRETE FEATURES:SLAB
 - PROPOSED HEAVY DUTY ASPHALT
 - PROPOSED LIGHT DUTY ASPHALT
 - PROPOSED GRAVEL AREA
 - PROPOSED RIP RAP AS PER OPSD B10.010
 - PROPOSED WATER METER

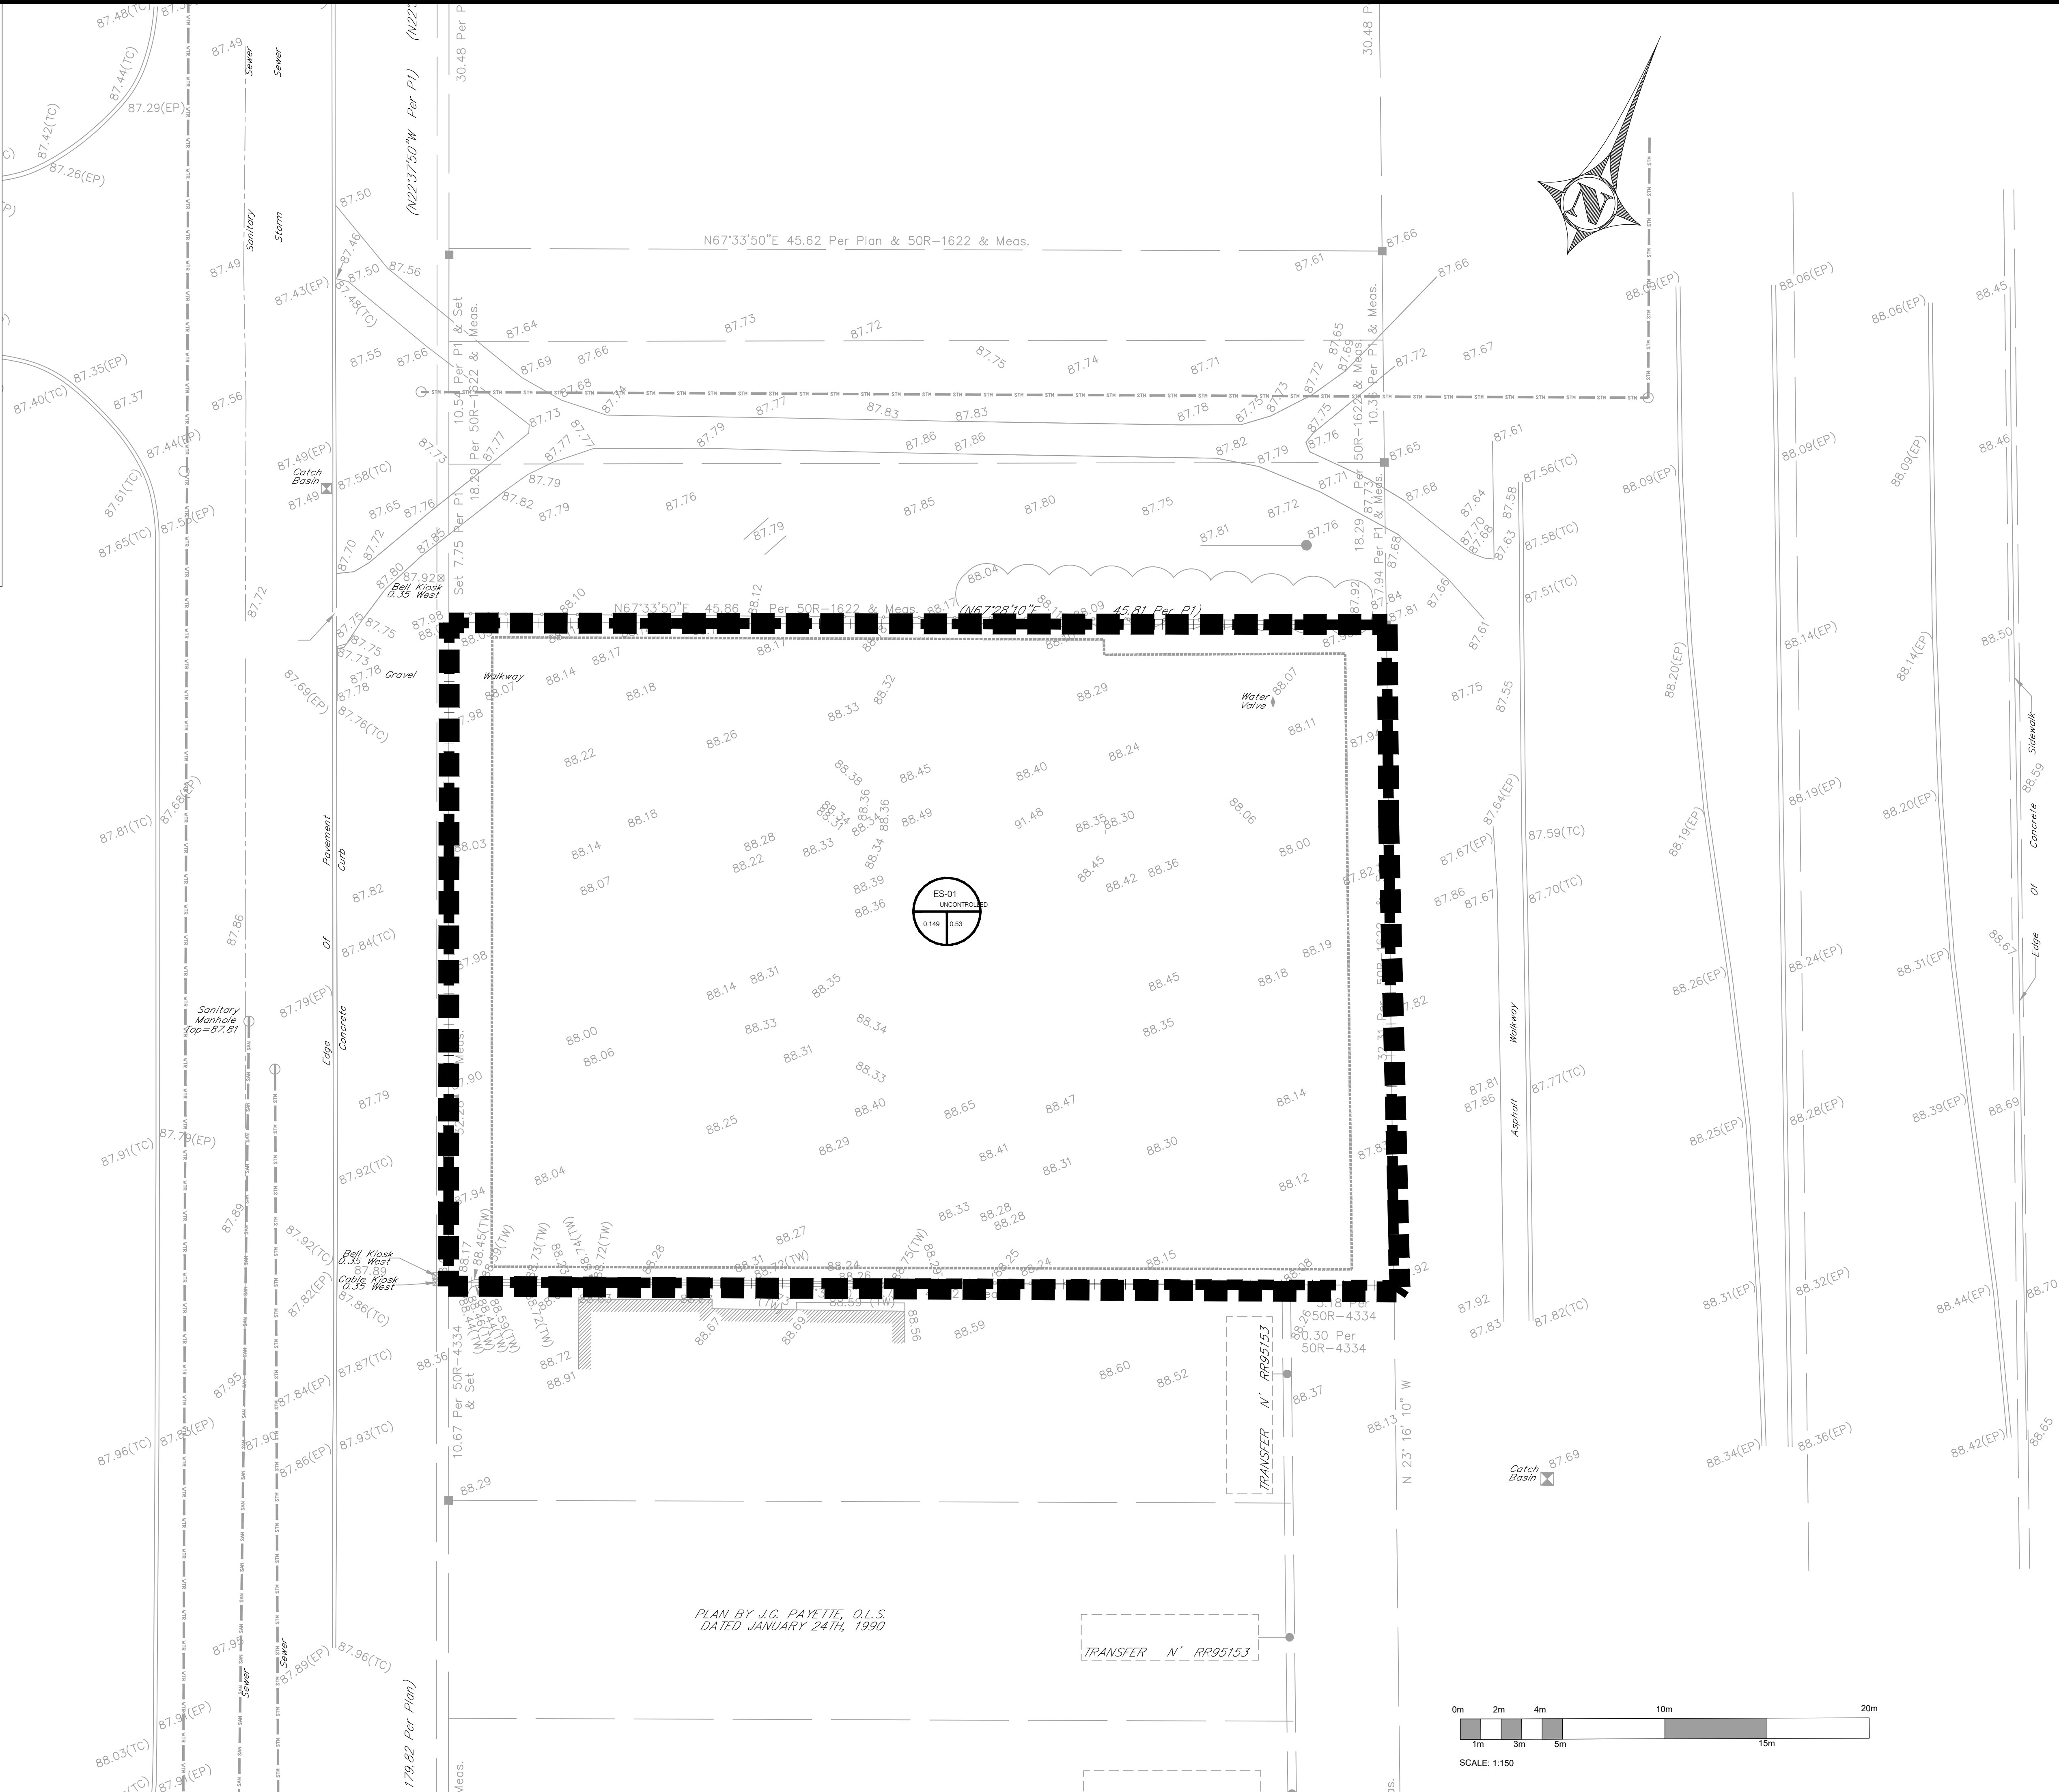

COPYRIGHT RESERVED
THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE OF ALL
DIMENSIONS. DO NOT SCALE THE DRAWING. ANY ERRORS OR
OMISSIONS SHALL BE REPORTED TO BLANCHARD LETENDRE
ENGINEERING LTD. WITHOUT DELAY. THE COPYRIGHTS TO ALL DESIGNS
AND DRAWINGS ARE THE PROPERTY OF BLANCHARD LETENDRE
ENGINEERING LTD. REPRODUCTION OR USE FOR ANY PURPOSE OTHER
THAN THAT AUTHORIZED BY BLANCHARD LETENDRE ENGINEERING LTD.
IS STRICTLY PROHIBITED.

ENGINEERING STAMP



#5		
#7		
#6		
#5		
#4		
#3		
#2	ISSUED FOR CITY COMMENTS	14/06/2022
#1	ISSUED FOR SPA	19/11/2020
NO.	REVISION	DATE (DDMMYYYY)

BLANCHARD LETENDRE
ENGINEERING
767, Notre Dame, Local 42, Embrun, Ontario,
(613) 693-0700 K0A 1W1 blengineering.ca

CLIENT:

BRIDOR DEVELOPMENT
996-B ST. AUGUSTIN RD.
EMBRUN, ON

PROJECT:

**NEW RESIDENTIAL
DEVELOPMENT**
1592 TENTH LINE RD,
ORLEANS, ON

DRAWING:


**PRE-DEVELOPMENT
DRAINAGE**

PAPER FORMAT: 24x36
DRAWN BY: BF + GB
CHECKED BY: GB
DATE: 07-2022
SCALE: 1:250
PROJECT NUMBER: 20-363

PAGE:

C400

- LEGEND:**
- EXISTING PROPERTY LINE TO REMAIN
 - PROPOSED EASEMENT
 - PROPOSED TERRACING (3:1 MIN)
 - PROPOSED DOOR ENTRANCE/EXIT
 - +50.00 PROPOSED ELEVATION
 - +50.00 BW PROPOSED BOTTOM OF WALL ELEVATION
 - +50.00 SD PROPOSED TOP OF SIDEWALK ELEVATION
 - +50.00 EX MATCH INTO EXISTING ELEVATION
 - +70.18 EXISTING ELEVATION
 - PROPOSED OVERLAND MAJOR FLOW ROUTE
 - PROPOSED SILT FENCE AS PER OPSD 219.110
 - PROPOSED 200mmHD PERFORATED SUBDRAIN
 - PROPOSED STORM SEWER
 - PROPOSED SANITARY SEWER
 - PROPOSED WATERMAIN
 - EXISTING SANITARY SEWER
 - EXISTING WATERMAIN
 - PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
 - PROPOSED CURB STOP
 - PROPOSED PIPE INSULATION
 - PROPOSED 100 YEAR HIGH WATER LEVEL
 - STORM WATERSHED EXTENT
 - WATERSHED NAME
 - RUNOFF COEFFICIENT
 - AREA IN HECTARES
 - PROPOSED GRASS AREA. REFER TO LANDSCAPING
 - PROPOSED CONCRETE FEATURES/SLAB
 - PROPOSED HEAVY DUTY ASPHALT
 - PROPOSED LIGHT DUTY ASPHALT
 - PROPOSED GRAVEL AREA
 - PROPOSED RIP RAP AS PER OPSD B10.010
 - PROPOSED WATER METER

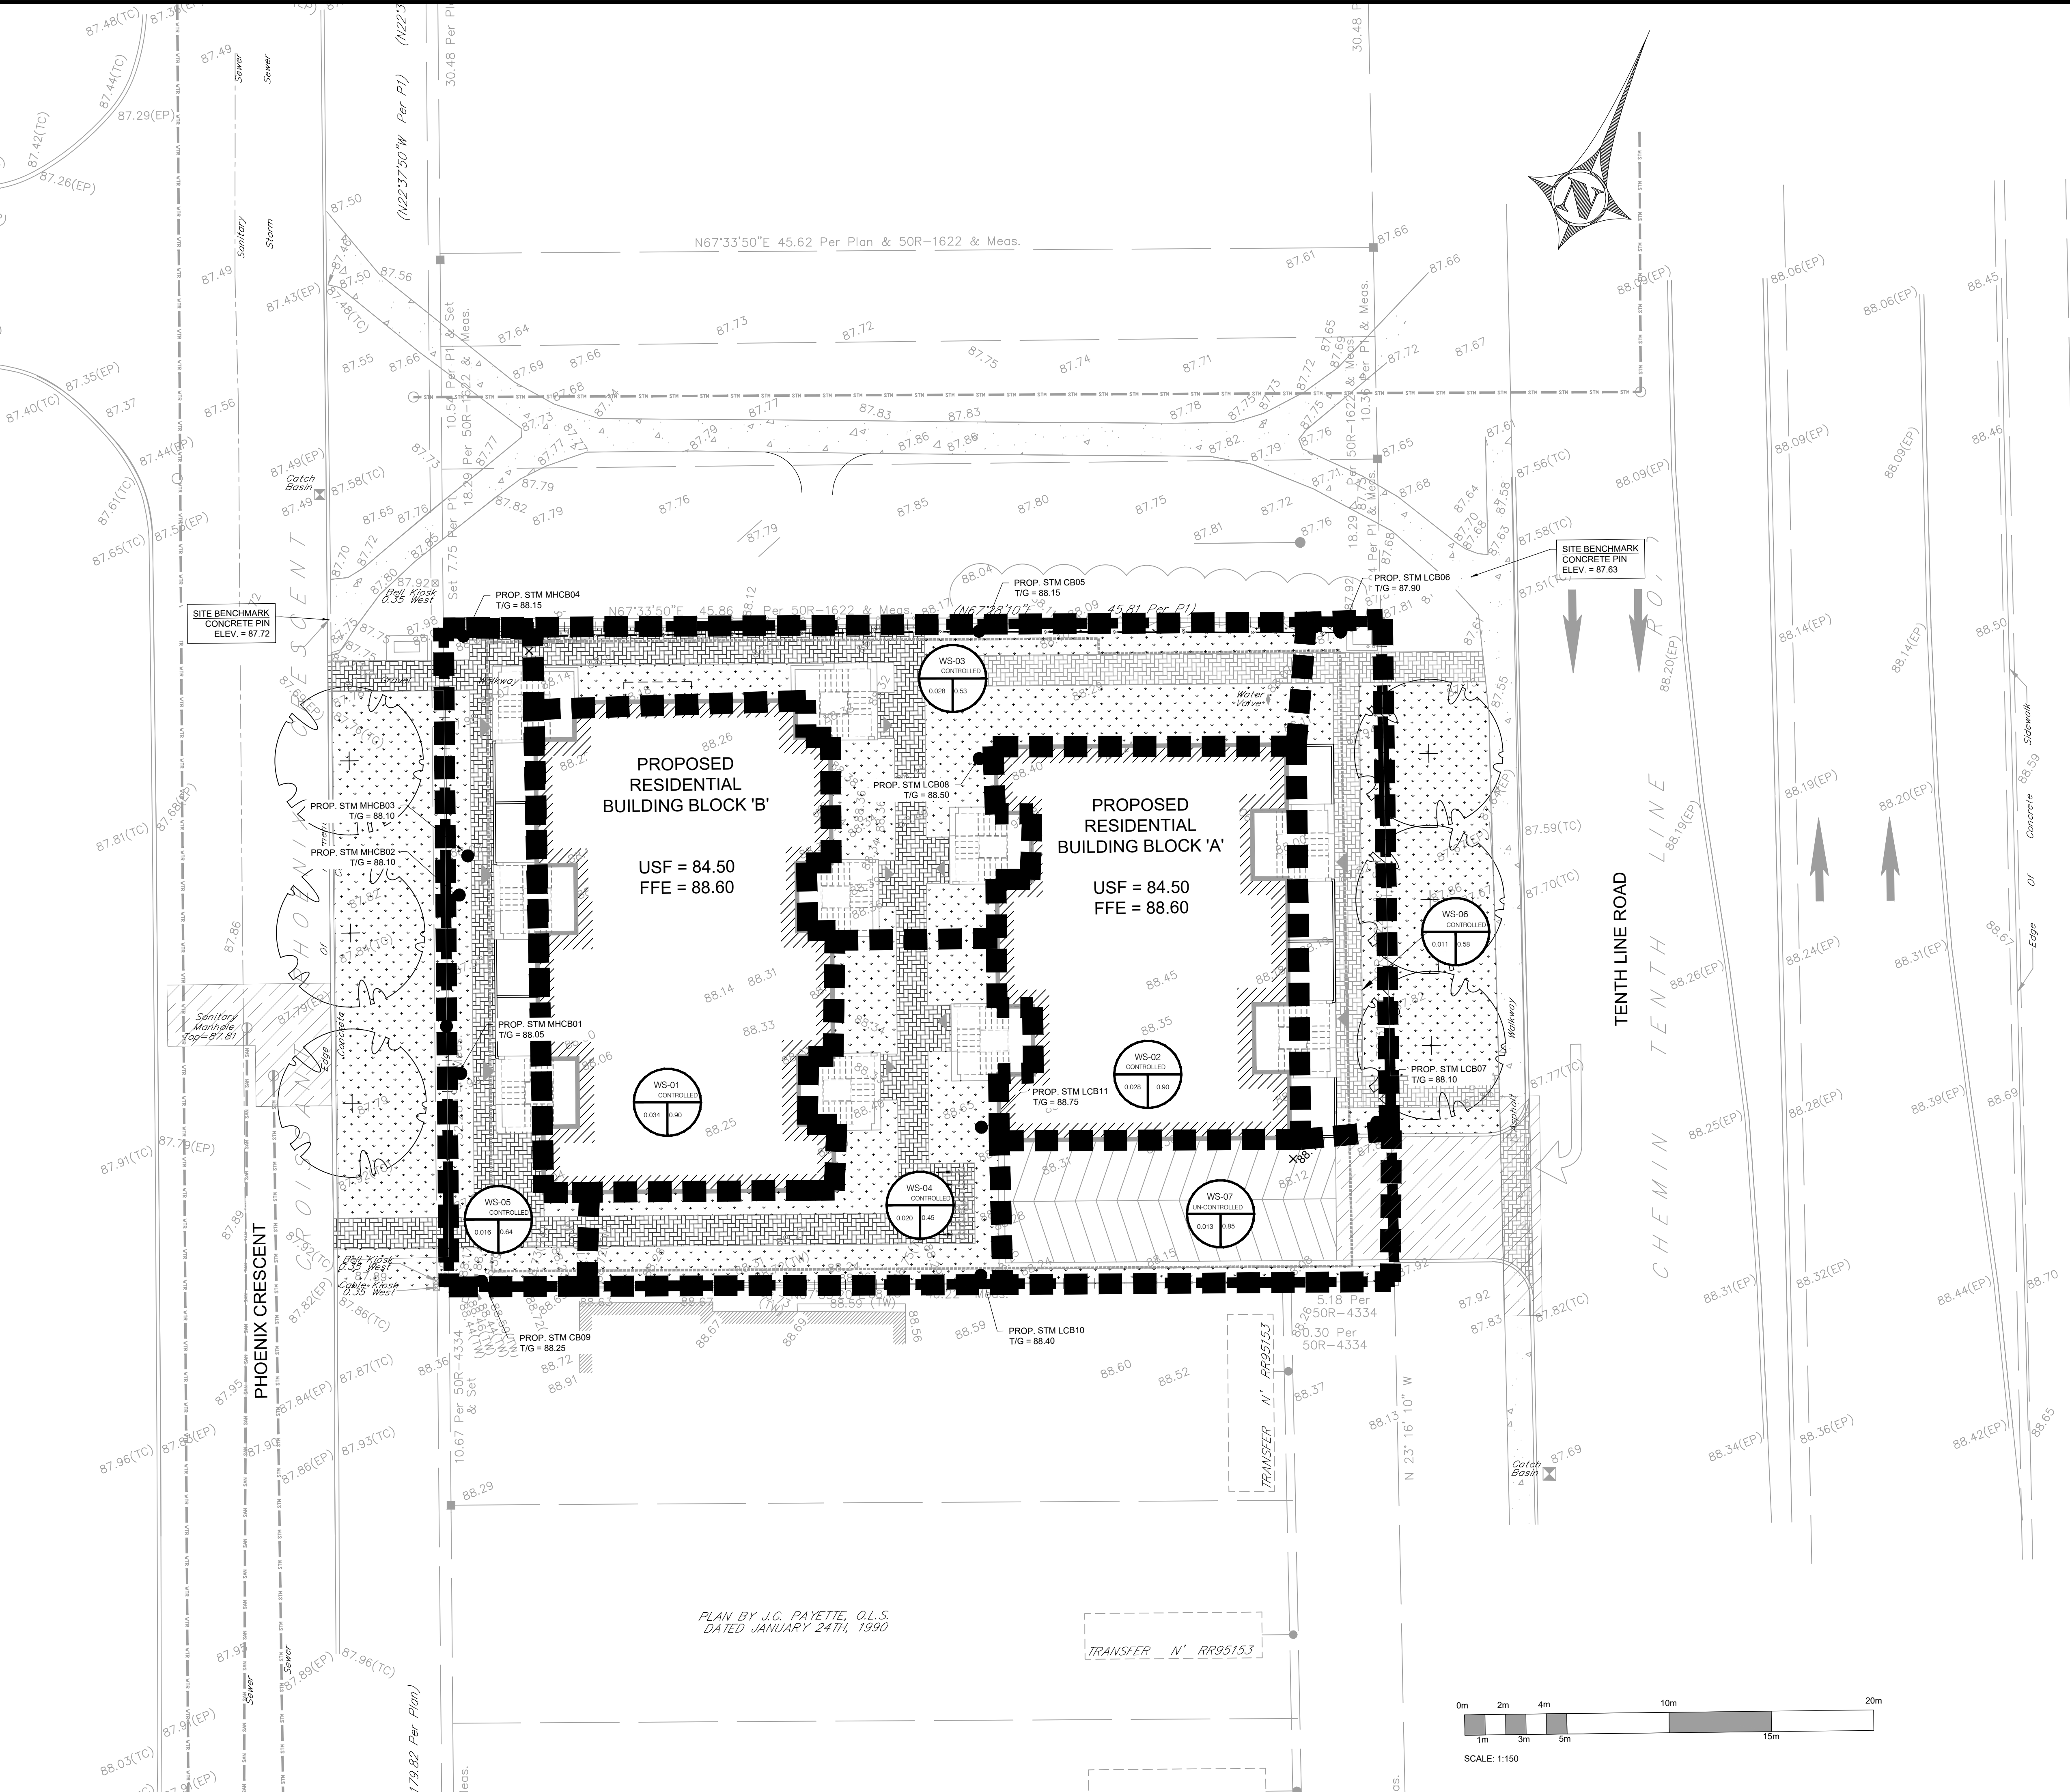

COPYRIGHT RESERVED
THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE OF ALL
DIMENSIONS. DO NOT SCALE THE DRAWING. ANY ERRORS OR
OMISSIONS SHALL BE REPORTED TO BLANCHARD LETENDRE
ENGINEERING LTD. WITHOUT DELAY. THE COPYRIGHTS TO ALL DESIGNS
AND DRAWINGS ARE THE PROPERTY OF BLANCHARD LETENDRE
ENGINEERING LTD. REPRODUCTION OR USE FOR ANY PURPOSE OTHER
THAN THAT AUTHORIZED BY BLANCHARD LETENDRE ENGINEERING LTD.
IS STRICTLY PROHIBITED.

ENGINEERING STAMP



#5		
#7		
#6		
#4		
#3		
#2	ISSUED FOR CITY COMMENTS	14/06/2022
#1	ISSUED FOR SPA	19/11/2020
NO.	REVISION	DATE (DDMMYYYY)

BLANCHARD LETENDRE
ENGINEERING
767, Notre Dame, Local 42, Embrun, Ontario,
(613) 693-0700 K0A 1W1 blengineering.ca

CLIENT:

BRIDOR DEVELOPMENT
996-B ST. AUGUSTIN RD.
EMBRUN, ON

PROJECT:

**NEW RESIDENTIAL
DEVELOPMENT**
1592 TENTH LINE RD,
ORLEANS, ON

DRAWING:

**POST DEVELOPMENT
STORAGE AREA**

PAPER FORMAT: 24x36
DRAWN BY: BF + GB
CHECKED BY: GB
DATE: 07-2022
SCALE: 1:250
PROJECT NUMBER: 20-363

PAGE:

C401



#8		
#7		
#6		
#5		
#4		
#3		
#2	ISSUED FOR CITY COMMENTS	14 / 06 / 2022
#1	ISSUED FOR SPA	19 / 11 / 2020
NO. / REVISION		DATE (DD/MM/YYYY)

PROJECT INFORMATION

ENGINEERED PRODUCT MANAGER: NADEER NASRULLAH
647-850-8417
NADEER.NASRULLAH@ADS-PIPE.COM

ADS SALES REP: MICHAEL REID
613-862-1416
MICHAEL.REID@ADS-PIPE.COM

PROJECT NO: S200949

ADS SITE COORDINATOR: MATTHEW BEGHIN
619-710-3687
MATTHEW.BEGHIN@ADS-PIPE.COM

ADVANCED DRAINAGE SYSTEMS, INC.

1592 TENTH LINE ROAD
ORLEANS, ON.

SiteASSIST

FOR STORMTECH INSTRUCTIONS, DOWNLOAD THE INSTALLATION APP

MC-3500 STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH MC-3500.
- CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBERS SHALL BE CERTIFIED TO CSA B184, "POLYMERIC SUB-SURFACE STORMWATER MANAGEMENT STRUCTURES" AND MEET THE REQUIREMENTS OF ASTM F2418-16a, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45/76 DESIGNATION IS.
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION (DEAD) LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE CSA S6-05 TRUCK AND THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
- CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOUS (<1 MIN) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT 75-YR COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK), AASHTO DESIGN TRUCK.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 75 mm (3").
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 8.2.3 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/IN², AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73 °F / 23 °C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:
 - THE STRUCTURAL EVALUATION SHALL BE SEALED BY A REGISTERED PROFESSIONAL ENGINEER.
 - THE STRUCTURAL EVALUATION SHALL DEMONSTRATE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY SECTIONS 3 AND 12.12 OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS FOR THERMOPLASTIC PIPE.
 - THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF MC-3500 CHAMBER SYSTEM

- STORMTECH MC-3500 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS.
 - STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM -150 mm (6") SPACING BETWEEN THE CHAMBER ROWS.
- INLET AND OUTLET MANIFOLDS MUST BE INSERTED A MINIMUM OF 300 mm (12") INTO CHAMBER END CAPS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE WELL GRADED BETWEEN 3/4" AND 2" (20-50 mm).
- STONE MUST BE PLACED ON THE TOP CENTER OF THE CHAMBER TO ANCHOR THE CHAMBERS IN PLACE AND PRESERVE ROW SPACING.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.

NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- THE USE OF EQUIPMENT OVER MC-3500 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER TIED LOADERS, DUMP TRUCK, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- FULL 900 mm (36") OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL, OR DUMPING.

USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY USING THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-888-892-2894 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT

7	STORMTECH MC-3500 CHAMBERS
2	STORMTECH MC-3500 END CAPS
305	STONE ABOVE (mm)
229	STONE BELOW (mm)
40	STONE VOID
37.1	INSTALLED SYSTEM VOLUME (m ³) ABOVE ELEVATION 86.00
43.7	PERIMETER STONE INCLUDED
39.2	SYSTEM AREA (m ²)
39.2	PERIMETER PERIMETER (m)

PROPOSED ELEVATIONS

86.00	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):
87.701	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):
87.548	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):
87.548	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):
87.548	MINIMUM ALLOWABLE GRADE (TOP OF RIGID PAVEMENT):
87.386	TOP OF STONE
87.091	TOP OF MC-3500 CHAMBER
86.000	600 mm ISOLATOR ROW PLUS INVERT:
85.948	BOTTOM OF MC-3500 CHAMBER
85.719	BOTTOM OF STONE

NOTES

- MANFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECHNICAL NOTE 8.32 FOR MANFOLD SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANFOLD COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- THIS CHAMBER SYSTEM WAS DESIGNED WITHOUT SITE-SPECIFIC INFORMATION ON SOIL CONDITIONS OR BEARING CAPACITY. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL AND PROVIDING THE BEARING CAPACITY OF THE INSTALLED SOILS. THE BASE STONE DEPTH MAY BE INCREASED OR DECREASED ONCE THIS INFORMATION IS PROVIDED.

1592 TENTH LINE ROAD
ORLEANS, ON.

DATE: 11/04/2020
DRAWN: RCT
CHECKED: NRB
PROJECT #.: S200949

DATE: 06/06/2022
DRAWN: NRB
CHECKED: NRB
PROJECT #.: S200949

4600 TRUHAN BLVD
HILLIARD, OH 43026

SCALE = 1 : 100

2 SHEET OF 5

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	AASHTO M145 ¹ A-1, A-2.4, A-3 OR AASHTO M43 ¹ 3, 307, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 24" (600 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 12" (300 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 90% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS.
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	AASHTO M43 ¹ 3, 4	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	AASHTO M43 ¹ 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

PLEASE NOTE:

- THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
- STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) MAX LIFTS USING TWO FULL COVERS WITH A VIBRATORY COMPACTOR.
- WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
- ONCE LAYER 'C' IS PLACED, ANY SOLIMATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.

ADS GEOSYNTHETICS 601T NON-WOVEN GEOTEXTILE ALL AROUND CLEAN, CRUSHED, ANGULAR STONE IN A & B LAYERS

TO BOTTOM OF FLEXIBLE PAVEMENT FOR SLOPED INSTALLATIONS: WATER SUFFICIENT PAVEMENT THICKNESS MAY VARY. RAKING SLOPE OF 1:1 (H:V) MIN.

12" (300 mm) MIN

18" (450 mm) MIN

24" (600 mm) MAX

45° (1143 mm)

77" (1956 mm)

12" (300 mm) MIN

DEPTH OF STONE TO BE DETERMINED BY SITE DESIGN ENGINEER 'B' (230 mm) MIN

**THIS CROSS SECTION DETAIL REPRESENTS MINIMUM REQUIREMENTS FOR INSTALLATION. PLEASE SEE THE LAYOUT SHEETS FOR PROJECT SPECIFIC REQUIREMENTS.

NOTES:

- CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418-16a, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45/76 DESIGNATION IS.
- MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
- PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 75 mm (3").
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 8.2.3 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/IN², AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73 °F / 23 °C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

COVER PIPE CONNECTION TO END CAP WITH ADS GEOSYNTHETICS 601T NON-WOVEN GEOTEXTILE

INSTALL FLAM ON 24" (600 mm) ACCESS PIPE PART # MC350024RAMP

OPTIONAL INSPECTION PORT

MC-3500 CHAMBER

MC-3500 END CAP

STORMTECH HIGHLY RECOMMENDS FLEXSTORM INSERTS IN ANY UPSTREAM STRUCTURES WITH OPEN GRATES

ELEVATED BYPASS MANFOLD

24" (600 mm) HDPE ACCESS PIPE REQUIRED USE FACTORY PARTIAL CUT END CAP PART # MC3500EPP24BC OR MC3500EPP24BV

ONE LAYER OF ADS PLUS175 WOVEN GEOTEXTILE BETWEEN FOUNDATION STONE AND CHAMBERS 6.25" (2.01 m) MIN WIDE CONTINUOUS FABRIC WITHOUT SEAMS

12" (300 mm) MIN

18" (450 mm) MIN WIDTH

CONCRETE COLLAR

PAVEMENT

CONCRETE SLAB 8" (200 mm) MIN THICKNESS

CONCRETE COLLAR NOT REQUIRED FOR UNPAVED APPLICATIONS

12" (300 mm) NYLOPLAST INLINE DRAIN BODY W/ SOLID HINGED COVER PART # 2712AGSP* SOLID COVER: 1299GCG*

6" (150 mm) SDR35 PIPE

MC-3500 CHAMBER

6" (150 mm) INSERTA TEE PART # 6P68FBSTIP INSERTA TEE TO BE CENTERED IN VALLEY OF CORRUGATIONS

* THE PART # 2712AGSPKIT CAN BE USED TO ORDER ALL NECESSARY COMPONENTS FOR A SOLID INSPECTION PORT INSTALLATION

INSPECTION & MAINTENANCE

STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT

A. INSPECTION PORTS (IF PRESENT)

A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN

A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED

A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG

A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)

A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.

B. ALL ISOLATOR PLUS ROWS

B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS

B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW PLUS THROUGH OUTLET PIPE

i) MIRRORS OR POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY

ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE

B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.

STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS

A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45° (1.1 m) OR MORE IS PREFERRED

B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKLASH WATER IS CLEAN



C. VACUUM STRUCTURE SUMP AS REQUIRED

STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.

STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES

- INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
- CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

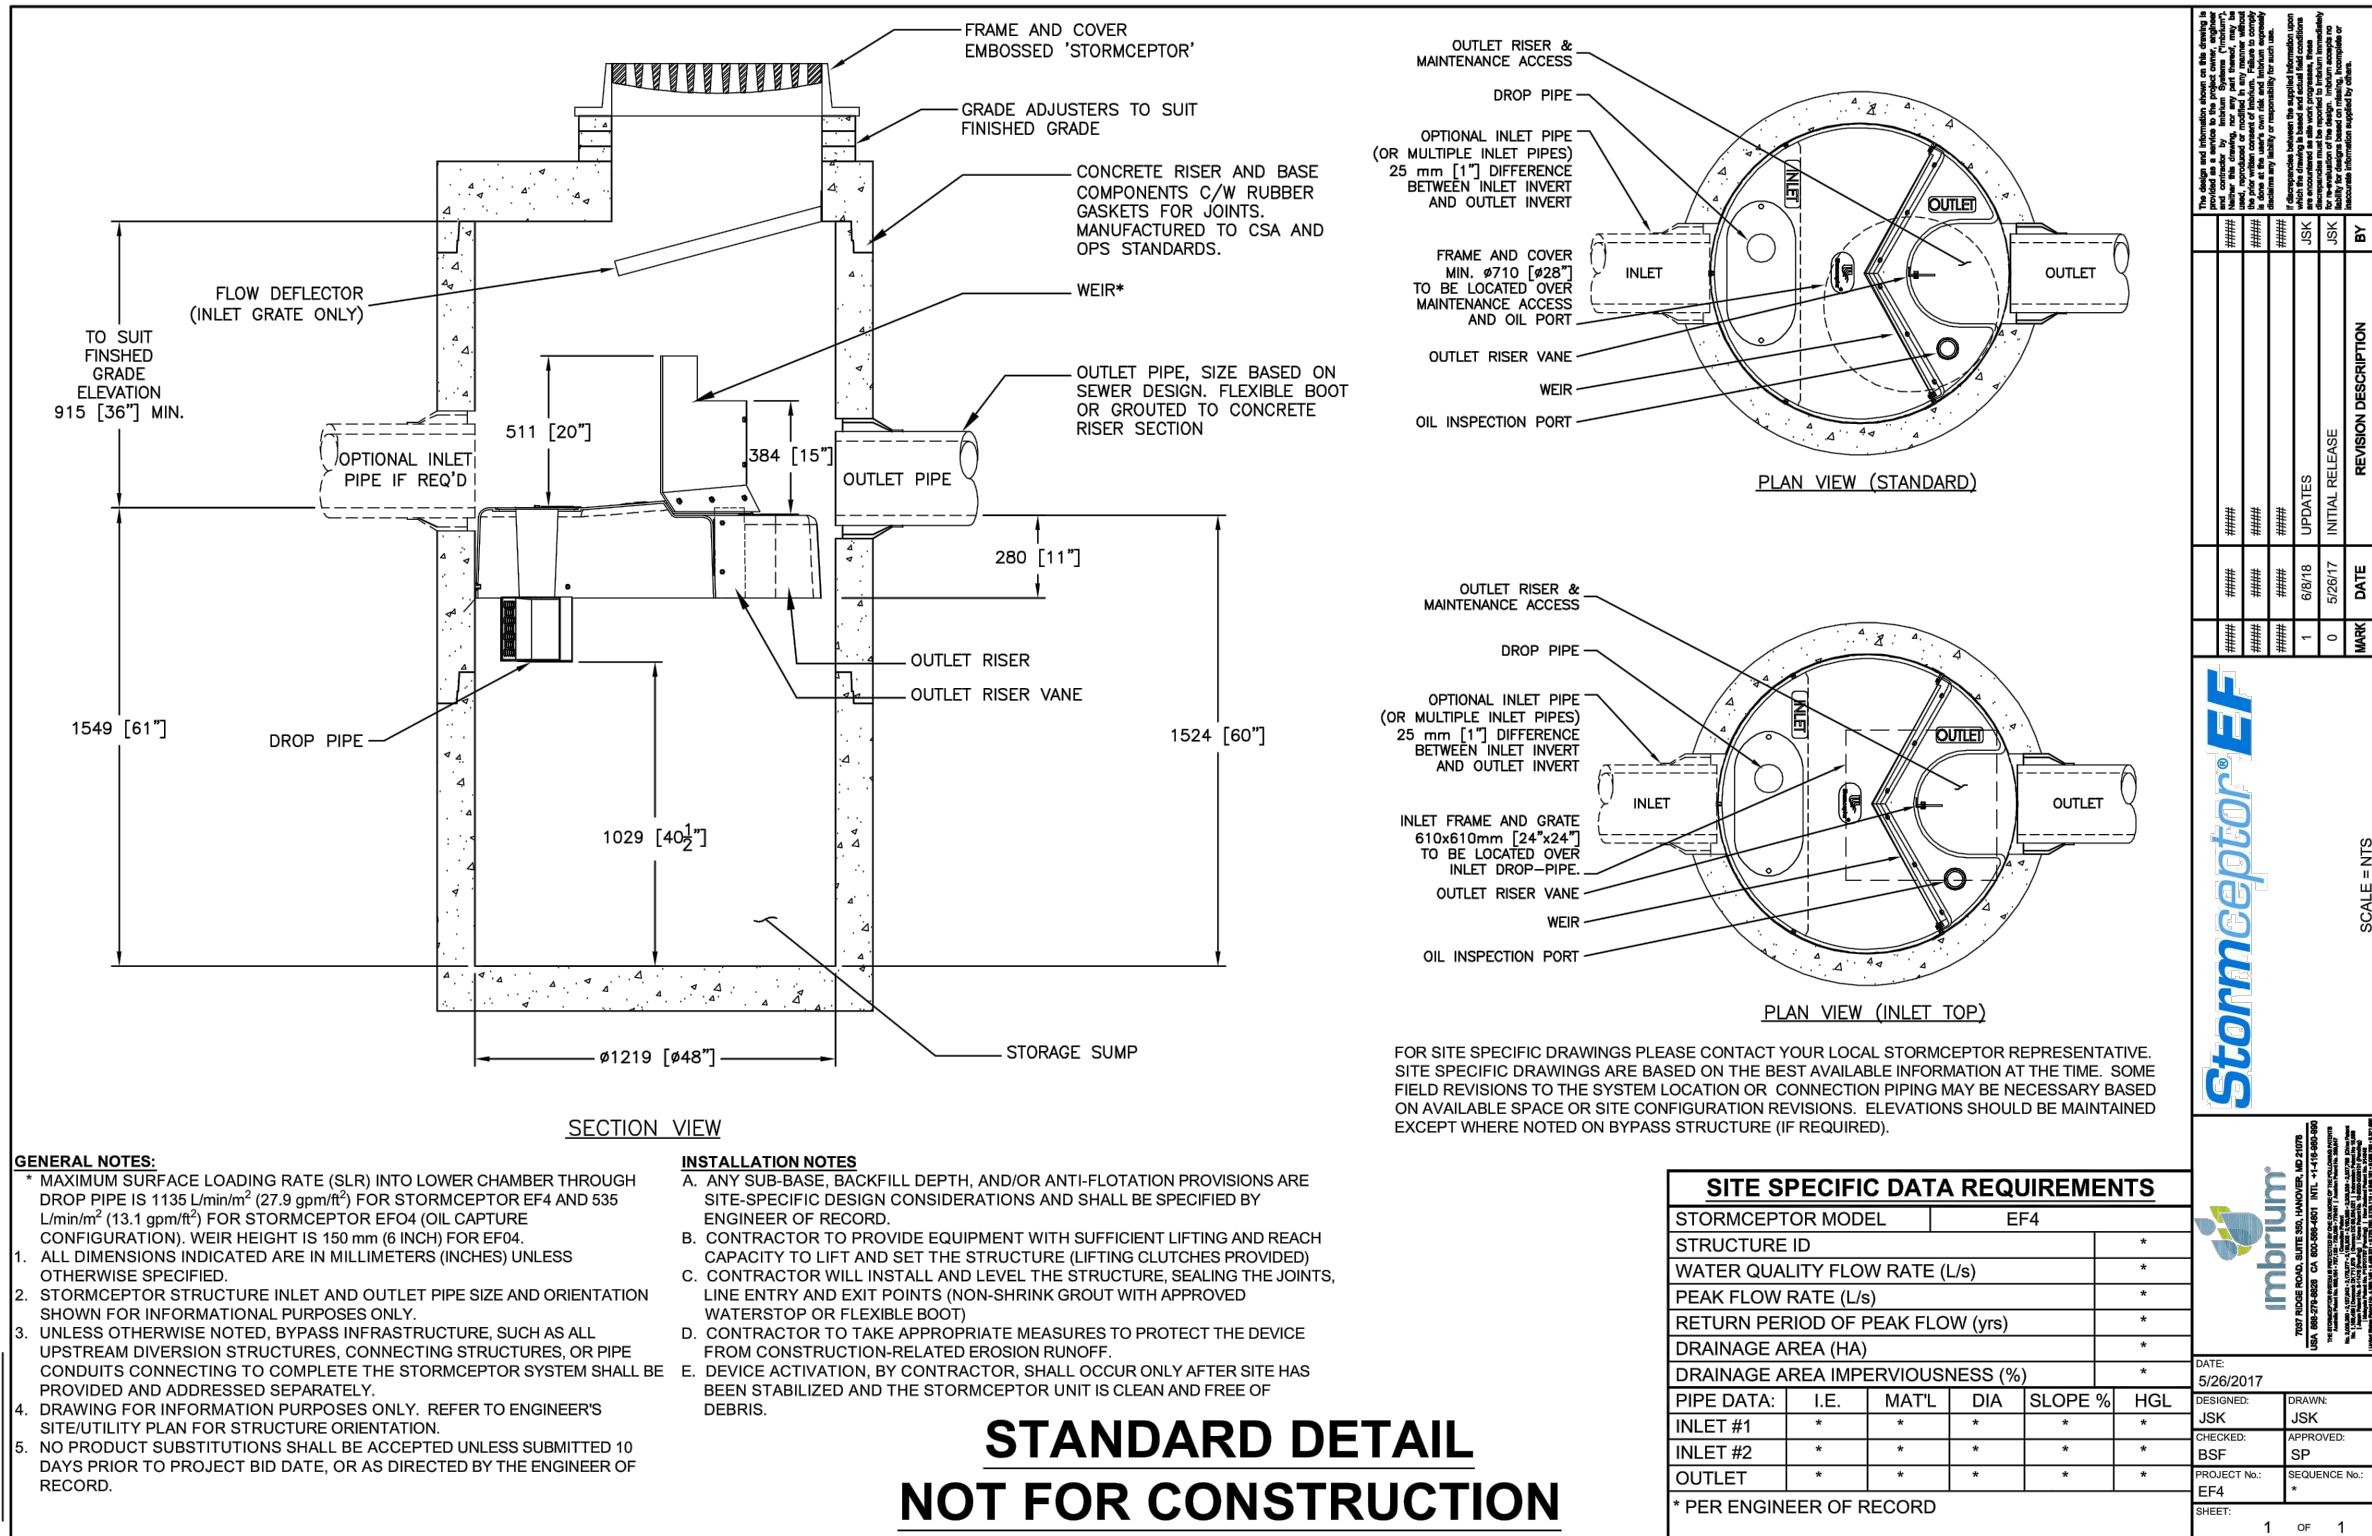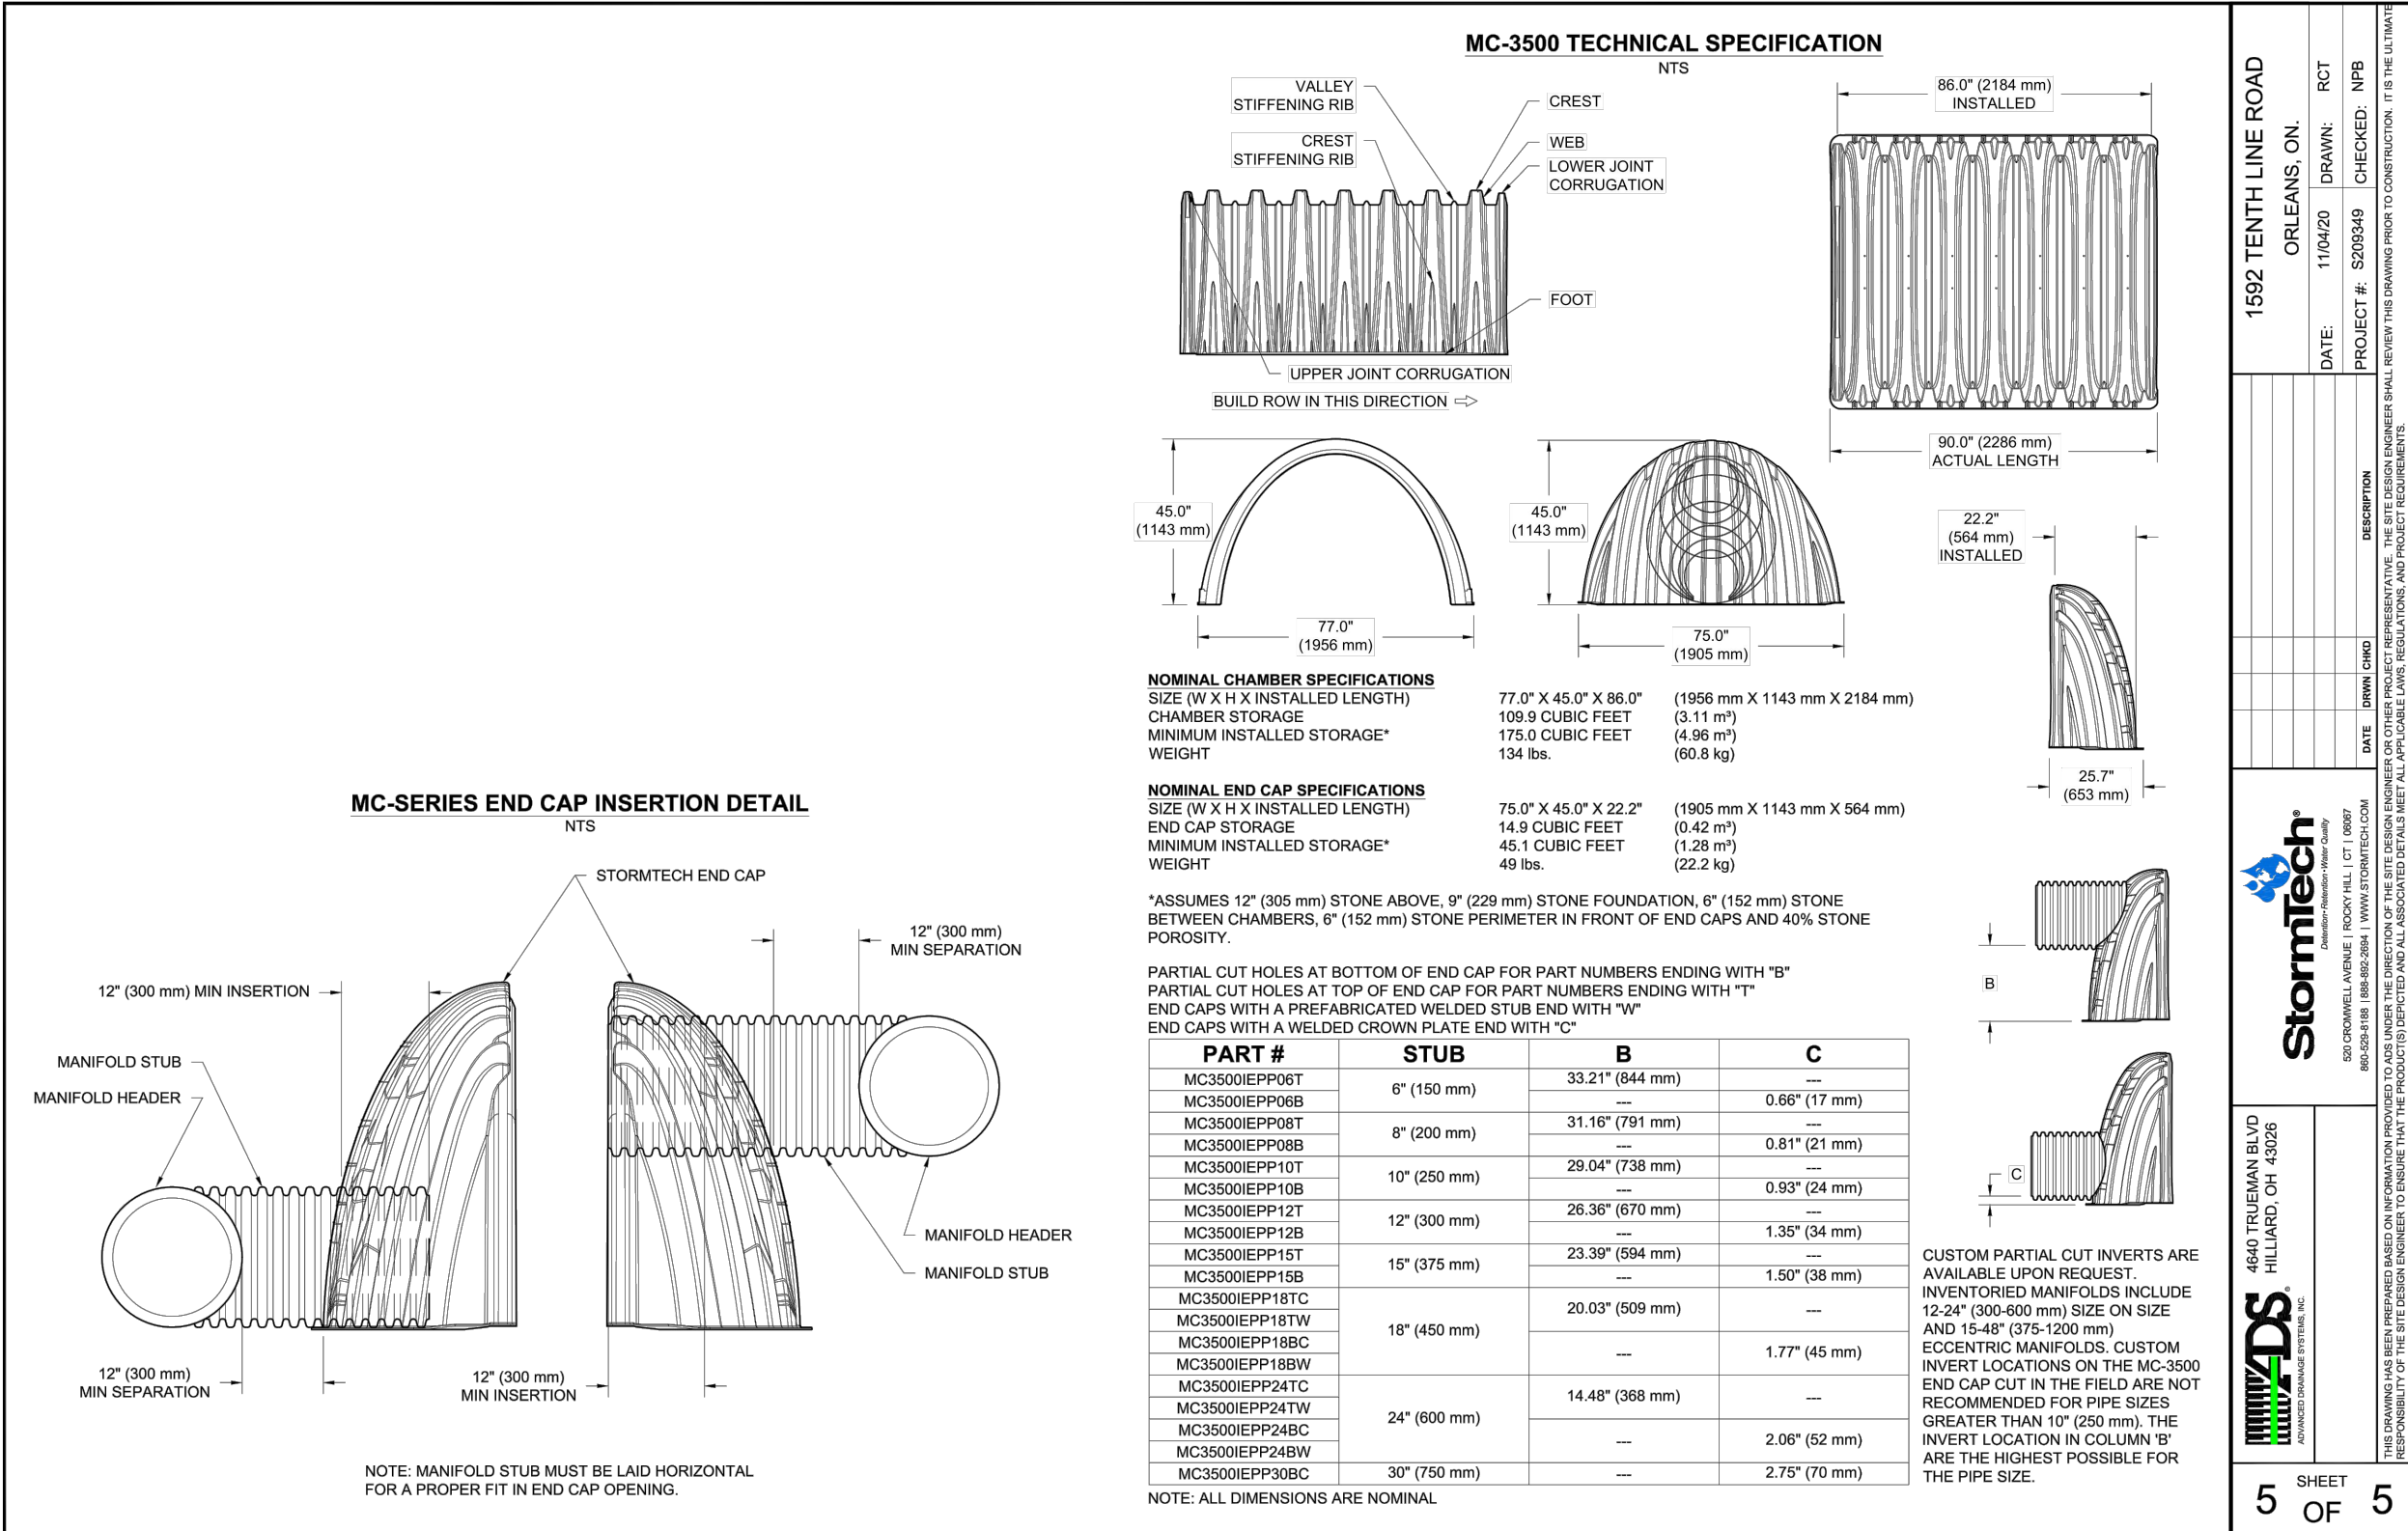

ENGINEERING STAMP



#8		
#7		
#6		
#5		
#4		
#3		
#2	ISSUED FOR CITY COMMENTS	14/06/2022
#1	ISSUED FOR SPA	19/11/2020
NO.	REVISION	DATE (DDMMYYYY)

BLANCHARD LETENDRE ENGINEERING

767, Notre Dame, Local 42, Embrun, Ontario,
(613) 693-0700 K0A 1W1 blngengineering.ca

CLIENT:

BRIDOR DEVELOPMENT
996-B ST. AUGUSTIN RD.
EMBRUN, ON

PROJECT:

NEW RESIDENTIAL DEVELOPMENT
1592 TENTH LINE RD,
ORLEANS, ON

DRAWING:

DETAILS - 2

PAPER FORMAT: 24x36
DRAWN BY: BF + GB
CHECKED BY: GB
DATE: 07-2022
SCALE:
PROJECT NUMBER: 20-363

PAGE:

C501