

SERVICING & STORMWATER MANAGEMENT REPORT– 273-275 RUSS BRADLEY ROAD



Project No.: CCO-22-1643-01

City File No.: D0-XX-XX-XXXX

Prepared for:

Trevor Watkins
273 & 275 Russ Bradley Road
Carp, Ontario K0A 1L0

Prepared by:

McIntosh Perry Consulting Engineers Ltd.
115 Walgreen Road
Carp, ON K0A 1L0

December 23rd, 2022

TABLE OF CONTENTS

1.0	PROJECT DESCRIPTION	1
1.1	<i>Purpose</i>	1
1.2	<i>Site Description</i>	1
2.0	BACKGROUND STUDIES	2
3.0	PRE-CONSULTATION SUMMARY	3
4.0	WATERMAIN	4
4.1	<i>Existing Watermain</i>	4
4.2	<i>Proposed Watermain</i>	4
5.0	SANITARY DESIGN	6
5.1	<i>Existing Sanitary Sewer</i>	6
5.2	<i>Proposed Sanitary Sewer</i>	6
6.0	PROPOSED STORMWATER MANAGEMENT	7
6.1	<i>Design Criteria and Methodology</i>	7
6.2	<i>Runoff Calculations</i>	7
6.3	<i>Pre-Development Drainage</i>	8
6.4	<i>Post-Development Drainage</i>	8
6.5	<i>Quantity Control</i>	9
6.6	<i>Quality Control</i>	10
6.6.1	<i>Infiltration</i>	11
7.0	EROSION AND SEDIMENT CONTROL.....	13
7.1	<i>Temporary Measures</i>	13
7.2	<i>Permanent Measures</i>	13
8.0	SUMMARY	14
9.0	RECOMMENDATION.....	15
10.0	STATEMENT OF LIMITATIONS.....	16

LIST OF TABLES

Table 1: Water Demands.....	4
Table 2: Fire Protection Confirmation.....	5
Table 3: Pre-Development Runoff Summary.....	8
Table 4: Post-Development Runoff Summary	8
Table 5: Allowable Release Rate Summary	9
Table 6: Post-Development Restricted Runoff Summary	9
Table 7: Storage Summary	10
Table 8: Enhanced Grassed Swale Requirements.....	10
Table 9: Infiltration Area - MECP Requirements.....	11
Table 10: Infiltration Summary	12

APPENDICES

Appendix A: Site Location Plan

Appendix B: City of Ottawa Pre-Consultation Notes

Appendix C: Watermain Calculations

Appendix D: Pre-Development Drainage Plan

Appendix E: Post-Development Drainage Plan

Appendix F: Stormwater Management Calculations

Appendix G: City of Ottawa Design Checklist

1.0 PROJECT DESCRIPTION

1.1 Purpose

McIntosh Perry (MP) has been retained by Trevor Watkins to prepare this Servicing and Stormwater Management Report in support of the Site Plan Control process for the proposed self storage facility, located on Russ Bradley Road within the City of Ottawa.

The main purpose of this report is to present a servicing design for the development in accordance with the recommendations and guidelines provided by the City of Ottawa (City), the Mississippi Conservation Authority (MVCA) and the Ministry of the Environment, Conservation and Parks (MECP). This report will address the water, sanitary and storm sewer servicing for the development, ensuring that existing and available services will adequately service the proposed development.

This report should be read in conjunction with the following drawings:

- CCO-22-1643-01, C101 – Site Grading, Drainage, Erosion & Sediment Control Plan
- CCO-22-1643-01, C102 – Site Servicing Plan
- CCO-22-1643-01, PRE – Pre-Development Drainage Area Plan
- CCO-22-1643-01, PRE – Post-Development Drainage Area Plan

1.2 Site Description

The property is located at Russ Bradley Road within Ward 5. It is described as Plan 4R33191, Part of Lot 13, Concession 3 (Huntley), Geographic Township of Carp, City of Ottawa. The land in question covers approximately 2.43 ha and is located at the south corner of Carp Road and Russ Bradley Road.

See Site Location Plan in Appendix 'A' for more details.

The existing site is currently undeveloped with two gravel entrances from Russ Bradley Road. There are no sanitary, storm or water services on site however there is one fire hydrant in the right of way to the west of the site along Russ Bradley Road.

The proposed development consists of eleven storage buildings and one office/storage building. Parking and drive aisles will be provided throughout the site along with landscaping around the site perimeter. One existing site access will be maintained along Russ Bradley Road and one existing site access will be removed.

2.0 BACKGROUND STUDIES

Background studies that have been completed for the proposed site include a topographical survey, geotechnical report and a hydrogeological investigation and terrain analysis.

Design drawings of the existing services on Russ Bradley Road were reviewed in order to determine accurate servicing and stormwater management schemes for the site.

A Sketch to Illustrate Topography of the site (22-2317) was completed by McIntosh Perry Surveying Inc. (MPSI) and the Site Plan (SP-A01) was prepared by Deimling (latest dated December 16th, 2022).

The following reports have previously been completed and are available under separate cover:

- Geotechnical Report completed by McIntosh Perry, dated December 23rd, 2022
- Hydrogeological Assessment & Terrain Analysis completed by McIntosh Perry, dated December 23rd, 2022
- Carp River Watershed/Subwatershed Study completed by Robinson Consultants, dated December 2004 (Report #00056)

3.0 PRE-CONSULTATION SUMMARY

A pre-consultation meeting was conducted on June 3, 2021 regarding the proposed site. Specific design parameters to be incorporated within this design include the following:

- Control 5 and 100-year post-development flows to the 5 and 100-year pre-development flows, respectively, with a combined C value to a maximum of 0.50.
- Provide 300mm freeboard from the 100-year storage elevation
- Quality control is required to be provided for the site (80% TSS Removal)
- Infiltration as per sub-watershed study for the Carp Road Corridor.

The notes from the City of Ottawa can be found in Appendix 'B'.

4.0 WATERMAIN

4.1 Existing Watermain

There is an existing 300mm diameter PVC watermain within Russ Bradley Road. The existing watermain is intended for exclusive use for the purposes of fire protection and not for servicing. There is an existing hydrant directly adjacent to the existing site entrance along Russ Bradley Road.

4.2 Proposed Watermain

A new well will be drilled within the parking lot north of building A to provide the proposed development with domestic water supply.

The Fire Underwriters Survey 2020 (FUS) method was utilized to determine the required fire flow for the site. FIUS calculations were based upon Building F, which had the highest fire demand. The 'C' factor (type of construction) for the FUS calculation was assumed to be 0.8 (Non-Combustible Construction). The total floor area ('A' value) for the FUS calculation was determined to be 743.2 m². The results of the calculations yielded a required fire flow of 6,000 L/min. The detailed calculations for the FUS and can be found in Appendix 'C'.

The water demands for the proposed buildings have been calculated to adhere to the *Ottawa Design Guidelines – Water Distribution* manual and can be found in Appendix 'C'. The results have been summarized below:

Table 1: Water Demands

Site Area	2.43 ha
Commercial	28,000 L/ha/day
Average Day Demand (L/s)	0.20
Maximum Daily Demand (L/s)	0.31
Peak Hourly Demand (L/s)	0.55
FUS Fire Flow Requirement (L/s)	100

Boundary conditions have been requested from the City however were not available at the time of submission. Once boundary conditions are provided by the City, the minimum and maximum water pressures will be compared to those proposed to ensure they fall within the required range identified in the City of Ottawa Water Supply Guidelines and to confirm the system has adequate capacity for the proposed development.

As per the Novatech's Hydraulic Network Analysis (R-2013-172) dated November 2014, there is approximately 63 L/s (3,780 L/min) @79.1 PSI of available fire flow from the existing hydrants within Russ Bradley Road. Based on the flow (3,780 L/min) from the Novatech report it would appear the hydrants within Russ Bradley Road are class B hydrants.

To confirm the adequacy of fire flow to protect the proposed development, public and private fire hydrants within 150 m of the proposed building were analysed per City of Ottawa ISTB 2018-02 Appendix I Table 1. The results are demonstrated below.

Table 2: Fire Protection Confirmation

Building	Fire Flow Demand (L/min.)	Fire Hydrant(s) within 75m	Fire Hydrant(s) within 150m	Combined Fire Flow (L/min.)
273-275 Russ Bradley Road	6,000	2 Proposed (Private)	1 Existing (Public) 1 Proposed (Private)	19,000

Based on City guidelines (*ISTB-2018-02*), the existing and proposed hydrants provide adequate protection for the proposed development.

5.0 SANITARY DESIGN

5.1 Existing Sanitary Sewer

There is no existing sanitary sewer within Russ Bradley Road.

5.2 Proposed Sanitary Sewer

The subject site is a proposed self storage with a small office. A new septic bed located southeast of the proposed office building will be installed and sized to accommodate the development. The septic design will be included under drawing C104 and submitted to the Ottawa Septic System Office (OSSO) for the required permits and approvals in spring 2023.

6.0 PROPOSED STORMWATER MANAGEMENT

6.1 Design Criteria and Methodology

Stormwater management for the proposed site will be maintained through positive drainage away from the proposed buildings and directed to a proposed storage and infiltration area. Both parking lot and roof runoff will be directed to the proposed storage and infiltration area located along the northeast property line before being discharged to the existing roadside ditch. The emergency overland flow route for the proposed site will also be directed northeast toward the existing roadside ditch. Quantity and quality controls for the storm runoff for both the pre & post development conditions are further detailed below. Stormwater Best Management Practices (SWM BMP's) will be implemented at the "Lot level", "Conveyance" and "End of Pipe" locations. These concepts will be explained further in Section 6.6.

In summary, the following design criteria have been employed in developing the stormwater management design for the site as directed by the MVCA and City:

Quality Control

- The site has been designed to achieve 80% total suspended solids removal as per the MVCA.

Quantity Control

- Post-development flow 5/100-year is to be restricted to match the 5/100-year pre-development flows respectively, with a maximum C value of 0.50.

6.2 Runoff Calculations

Runoff calculations presented in this report are derived using the Rational Method, given as:

$$Q = 2.78CIA \text{ (L/s)}$$

Where	C	= Runoff coefficient
	I	= Rainfall intensity in mm/hr (City of Ottawa IDF curves)
	A	= Drainage area in hectares

It is recognized that the Rational Method tends to overestimate runoff rates. As a result, the conservative calculation of runoff ensures that any SWM facility sized using this method is expected to function as intended.

The following coefficients were used to develop an average C for each area:

Roofs/Concrete/Asphalt	0.90
Gravel	0.60
Undeveloped and Grass	0.20

As per the *City of Ottawa - Sewer Design Guidelines*, the 5-year balanced ‘C’ value must be increased by 25% for a 100-year storm event to a maximum of 1.0.

As per the pre-consultation meeting with the City of Ottawa the time of concentration (Tc) used for pre- and post-development flows shall be calculated and no less than 10 minutes.

6.3 Pre-Development Drainage

The subject property currently surface drains to the northwest. The existing site drainage limits are demonstrated on the Pre-Development Drainage Area Plan. A summary of the Pre-Development Runoff Calculations can be found below.

Table 3: Pre-Development Runoff Summary

Drainage Area	Area (ha)	Runoff Coefficient (2/5-Year)	Runoff Coefficient (100-Year)	5-year Peak Flow (L/s)	100-year Peak Flow (L/s)
A1	2.43	0.21	0.27	149.79	320.88
Total	2.43			149.79	320.88

See CCO-22-1643-01 - *PRE* in Appendix ‘E’ and Appendix ‘G’ for calculations.

6.4 Post-Development Drainage

The proposed site drainage limits are demonstrated on the Post-Development Drainage Area Plan. See CCO-22-1643-01 - *POST* in Appendix ‘F’ of this report for more details. A summary of the Post-Development Runoff Calculations can be found below.

Table 4: Post-Development Runoff Summary

Drainage Area	Area (ha)	Runoff Coefficient (5-Year)	Runoff Coefficient (100-Year)	5-year Peak Flow (L/s)	100-year Peak Flow (L/s)
B1	1.458	0.65	0.78	276.24	564.65
B2	0.966	0.47	0.56	130.37	266.59
Total	2.425			406.61	831.25

See Appendix ‘G’ for calculations. Runoff for area B1 will be restricted prior to outlet to the enhanced swale northeast of the infiltration and storage area. The flow will be controlled by a 150mm diameter culvert outlet and a 0.95m wide earth weir. Area B1 will be over-controlled to account for the unrestricted flow leaving the site from Area B2. Quantity and quality controls will be further detailed in Sections 6.5 and 6.6.

6.5 Quantity Control

The 5 -and 100-year post-development runoff for this site has been restricted to match the 5- and 100-year pre-development flow rate with a maximum combined C value of 0.50. (See Appendix 'B' for pre-consultation notes). These values create the following allowable release rate and required storage volumes for the site.

Table 5: Allowable Release Rate Summary

Drainage Area	Area (ha)	Runoff Coefficient (5yr/100yr)	Required Restricted Flow 5-Year (L/s)	Required Restricted Flow 100-Year (L/s)
A1	2.425	0.21/0.27	149.79	320.88

See Appendix 'G' for calculations.

Reducing site flows will be achieved through the use of flow restrictions which will create the need for on-site storage. Runoff from drainage areas will be restricted as shown in the table below.

Table 6: Post-Development Restricted Runoff Summary

Drainage Area	Post Development Unrestricted Flow (L/s)		Post Development Restricted Flow (L/s)	
	5-Year	100-Year	5-Year	100-Year
B1	276.24	564.65	13.69	53.11
B2	130.37	266.59	130.37	266.59
Total	406.61	831.25	144.06	319.70

See Appendix 'G' for calculations.

Runoff from Area B2 will be unrestricted and maintain existing drainage patterns. Runoff from Area B1 will be captured and restricted in a depressed storage area. A weir and pipe combination will be used to restrict flow from Area B1 to the allowable release rate.

In the event that there is a rainfall which exceeds the 100-year storm event or there is a blockage within the storm sewer system, stored runoff will overtop the berm at an elevation of 113.56, providing 300mm of freeboard to the highest WSEL. Runoff will outlet to the existing municipal ditch NW of site in an emergency situation. A storage summary can be found in *Table 7*, below.

Table 7: Storage Summary

Drainage Area	Depth of Ponding (m)	Storage Required (m ³)	Storage Available (m ³)	Depth of Ponding (m)	Storage Required (m ³)	Storage Available (m ³)
	5-Year			100-Year		
B1	0.25	274.28	289.73	0.36	447.39	451.13

The depressed storage area will have a maximum release rate of 53.11 L/s and provide up to 451.13 m³ of storage during the 100-year event. The water level (WSEL) during the 100-year event will be 114.26, corresponding to a ponding depth of 0.36m. The maximum release rate during the 5-year event will be 13.69 L/s. The water level (WSEL) will be 114.15 during the 5-year event, corresponding to a ponding depth of 0.25m.

See Appendix ‘G’ for calculations.

6.6 Quality Control

The development of this lot will employ Best Management Practices (BMP’s) wherever possible. The intent of implementing stormwater BMP’s is to ensure that water quality and quantity concerns are addressed at all stages of development. Lot level BMP’s typically include temporary retention of the parking lot runoff, minimizing ground slopes and maximizing landscaped areas. Some of these BMP’s cannot be provided for this site due to site constraints and development requirements.

The enhanced grassed swales have a variant cross-slope and a drainage conveyance slope of 0.5% to slow down the stormwater which creates an opportunity for infiltration and removal of total suspended solids. It is suggested that the grassed swale be evaluated yearly to determine if the amount of suspended solid accumulation requires removal. The minimum travel path of water through the swale is approximately 73 m providing sufficient total suspended solid removal to satisfy the requirement of 80%. Table 8 provides the criteria and proposed conditions the enhanced grassed swale will be subjected to.

Table 8: Enhanced Grassed Swale Requirements

No.	Design Element	Criteria	Proposed Works
1	Drainage Areas	Less than 2 hectares	Each swale receives flows from less than 2 hectares or area.
2	Soils Type	Soil percolation rate should be greater than 15mm/hr	Native soil within the swale will be replaced with topsoil meeting percolation rate requirements
3	Water Table Depth	The seasonally high-water depth should be greater than 1m below the bottom of the enhanced swales	The site has been raised to provide as much clearance as feasible above the groundwater table.
4	Bedrock Depth	The depth to bedrock should be greater than 1m below the bottom of the enhanced swales	As per the Geotechnical Report, bedrock is greater than 1m below enhanced grass swale.

5	Cross-Section	Bottom width: >0.75m Side slopes: 2.5:1 (Typical) Maximum Depth of Flow: <0.5m (Typical) Channel Slope: <4%	Bottom width: 4.0m Side slopes: 3:1 Max Depth of Flow: <0.5m Channel Slope: 0.50%
6	Flow Velocity	Convey the peak flow from a 4 hour 25mm Chicago storm with a velocity <0.5m/s	Channel slopes will be limited to 0.5% and the resultant flow velocity will be less the 0.5 m/s.
7	Swale Length	>5m	The swale is greater than 5m in length.
8	Permanent Check Dams	To promote infiltration of stormwater and the settling of pollutants, permanent check dams can be constructed at intervals along the swale systems	The outlet functions as a check dam. The length of the swales does not warrant intermediary check dams. However, a check dam has been added just upstream of the dry retention area to demonstrate quality storage requirements as per Table 3.2.
9	Major System Events	Grassed swales must be evaluated under major system and minor system events to ensure that swales can convey these storms effectively	The major storm events are anticipated to crest the banks. Detailed calculations will be provided

6.6.1 Infiltration

In addition to providing quality control for stormwater runoff, the proposed development is within the Carp Road Corridor Community Design Plan which identifies the subject property as a high groundwater recharge area. The Carp River Watershed/Subwatershed Study sets a target for high groundwater recharge areas of 230mm/year of infiltration.

In order to meet the required infiltration target, an infiltration area has been designed for the site as per the *Credit Valley Conservation Authority (CVC) and Toronto Region Conservation's (TRCA) Low Impact Development Stormwater Management Planning and Design Guide (2010)*, Section 4.4.2. The infiltration area will be constructed at the north side below the proposed storage area outlet. Storm runoff from the site will be directed to the infiltration area. The area has been designed to meet the MECP criteria noted in the following table:

Table 9: Infiltration Area - MECP Requirements

No.	Design Element	Criteria	Proposed Works
1	Water Table Depth	The seasonally high water depth should be greater than 1m below the bottom of the soakaway pit	The site has been raised to provide as much clearance as feasible above the groundwater table.
2	Depth to Bedrock	The depth to bedrock should be greater than 1m below the bottom of the soakaway pit	Depth of bedrock is greater than 1m below the bottom of the infiltration area.

3	Soils	Soil percolation rate should be greater than 15mm/hr	Native soils will be replaced with topsoil having a percolation rate greater than 15mm/hr.
4	Storage Volume	A minimum storage volume of 5mm over the rooftop area should be accommodated in the soakaway pit without overflowing. The maximum target storage volume should be 20 mm over the rooftop area.	The infiltration is proposed to infiltrate 6mm of runoff from the entirety area B1
5	Location	>4m from the building	Infiltration Area is >4m from the building

To promote infiltration, the storage area outlet is designed to be 0.09m above the bottom of the infiltration area. The infiltration area will be capable of storing the first 6mm of rainfall per event below the outlet, allowing an extended opportunity for the runoff to infiltrate. It is estimated that 87.50 m³ will be stored during an average 5mm<x>25mm event, of which 51 are expected to happen per year. The drawdown time, based on the lowest measured infiltration rate from percolation testing, is anticipated to be 1.07 days, and there will be on average 7.1 days between events. An infiltration summary has been included in Table 10, below.

Table 10: Infiltration Summary

Site Area	2.42 ha	
Infiltration Requirement	230 mm/year	5577 m ³ / year
Average Event 5mm<x<25mm	11.88 mm/event	51 events / year
Infiltration In Pervious Area	6mm per event	1399 m ³ / year
Infiltration within Infiltration Area	6mm / 87.50m ³ per event	4462.70 m ³ / year
Total Infiltration Per Year	5577 m ³ / year Required	5861 m ³ / year Provided

Refer to Appendix 'G' for detailed calculations.

7.0 EROSION AND SEDIMENT CONTROL

7.1 Temporary Measures

Before construction begins, temporary silt fence, straw bale or rock flow check dams will be installed at all natural runoff outlets from the property. It is crucial that these controls be maintained throughout construction and inspection of sediment and erosion control will be facilitated by the Contractor or Contract Administration staff throughout the construction period.

Silt fences will be installed where shown on the final engineering plans, specifically along the downstream property limits. The Contractor, at their discretion or at the instruction of the City, Conservation Authority or the Contract Administrator shall increase the quantity of sediment and erosion controls on-site to ensure that the site is operating as intended and no additional sediment finds its way off site. The rock flow, straw bale & silt fence check dams and barriers shall be inspected weekly and after rainfall events. Care shall be taken to properly remove sediment from the fences and check dams as required. Removal of silt fences without prior removal of the sediments shall not be permitted.

Although not anticipated, work through winter months shall be closely monitored for erosion along sloped areas. Should erosion be noted, the Contractor shall be alerted and shall take all necessary steps to rectify the situation. Should the Contractor's efforts fail at remediating the eroded areas, the Contractor shall contact the City and/or Conservation Authority to review the site conditions and determine the appropriate course of action. As the ground begins to thaw, the Contractor shall place silt fencing at all required locations as soon as ground conditions warrant. Please see the *Site Grading, Drainage and Sediment & Erosion Control Plan* for additional details regarding the temporary measures to be installed and their appropriate OPSD references.

7.2 Permanent Measures

Rip-rap will be placed at all locations that have the potential for concentrated flow. It is crucial that the Contractor ensure that the geotextile is keyed in properly to ensure runoff does not undermine the rip rapped area. Additional rip-rap is to be placed at erosion prone locations as identified by the Contractor / Contract Administrator / City or Conservation Authority.

It is expected that the Contractor will promptly ensure that all disturbed areas receive topsoil and seed/sod and that grass be established as soon as possible. Any areas of excess fill shall be removed or levelled as soon as possible and must be located a sufficient distance from any watercourse to ensure that no sediment is washed out into the watercourse. As the vegetation growth within the site provides a key component to the control of sediment for the site, it must be properly maintained once established. Once the construction is complete, it will be up to the landowner to maintain the vegetation and ensure that the vegetation is not overgrown or impeded by foreign objects.

8.0 SUMMARY

- New self-storage buildings are proposed to be constructed at 273-275 Russ Bradley Road;
- A new well will be drilled on the site including a 50mm diameter service lateral to the proposed office building;
- A new 200mm diameter water service will be extended from the existing 305 mm diameter watermain within Russ Bradley Road. The water service will provide the required fire flow to three proposed private hydrants;
- A new septic system will be installed to service the site;
- The majority of the site will sheet flow to a depressed storage and infiltration area before being restricted at the outlet;
- Storage for the 5- through 100-year storm events will be provided within the depressed storage area;
- Infiltration will be promoted by raising the storage area outlet 0.09m above the bottom of the infiltration area; and
- An enhanced grass swale will be constructed to promote infiltration and removal of total suspended solids.

9.0 RECOMMENDATION

Based on the information presented in this report, we recommend that City of Ottawa approve this Servicing and Stormwater Management Report in support of the proposed development at 273-275 Russ Bradley Road.

This report is respectfully being submitted for approval.

Regards,

McIntosh Perry Consulting Engineers Ltd.



Brent Cuming, P.Eng.
Project Engineer, Land Development
McIntosh Perry Consulting Engineers
T: 343.764.2012
E: b.cuming@mcintoshperry.com



Nicholas Vachon, EIT
Engineering Intern, Land Development
McIntosh Perry Consulting Engineers
T: 613.875.1334
E: n.vachon@mcintoshperry.com



10.0 STATEMENT OF LIMITATIONS

This report was produced for the exclusive use of Trevor Watkins. The purpose of the report is to assess the existing stormwater management system and provide recommendations and designs for the post-construction scenario that are in compliance with the guidelines and standards from the Ministry of the Environment, Conservation and Parks, City of Ottawa and local approval agencies. McIntosh Perry reviewed the site information and background documents listed in Section 2.0 of this report. While the previous data was reviewed by McIntosh Perry and site visits were performed, no field verification/measures of any information were conducted.

Any use of this review by a third party, or any reliance on decisions made based on it, without a reliance report is the responsibility of such third parties. McIntosh Perry accepts no responsibility for damages, if any, suffered by any third party as a result of decisions or actions made based on this review.

The findings, conclusions and/or recommendations of this report are only valid as of the date of this report. No assurance is made regarding any changes in conditions subsequent to this date. If additional information is discovered or becomes available at a future date, McIntosh Perry should be requested to re-evaluate the conclusions presented in this report, and provide amendments, if required.

APPENDIX A
KEY PLAN

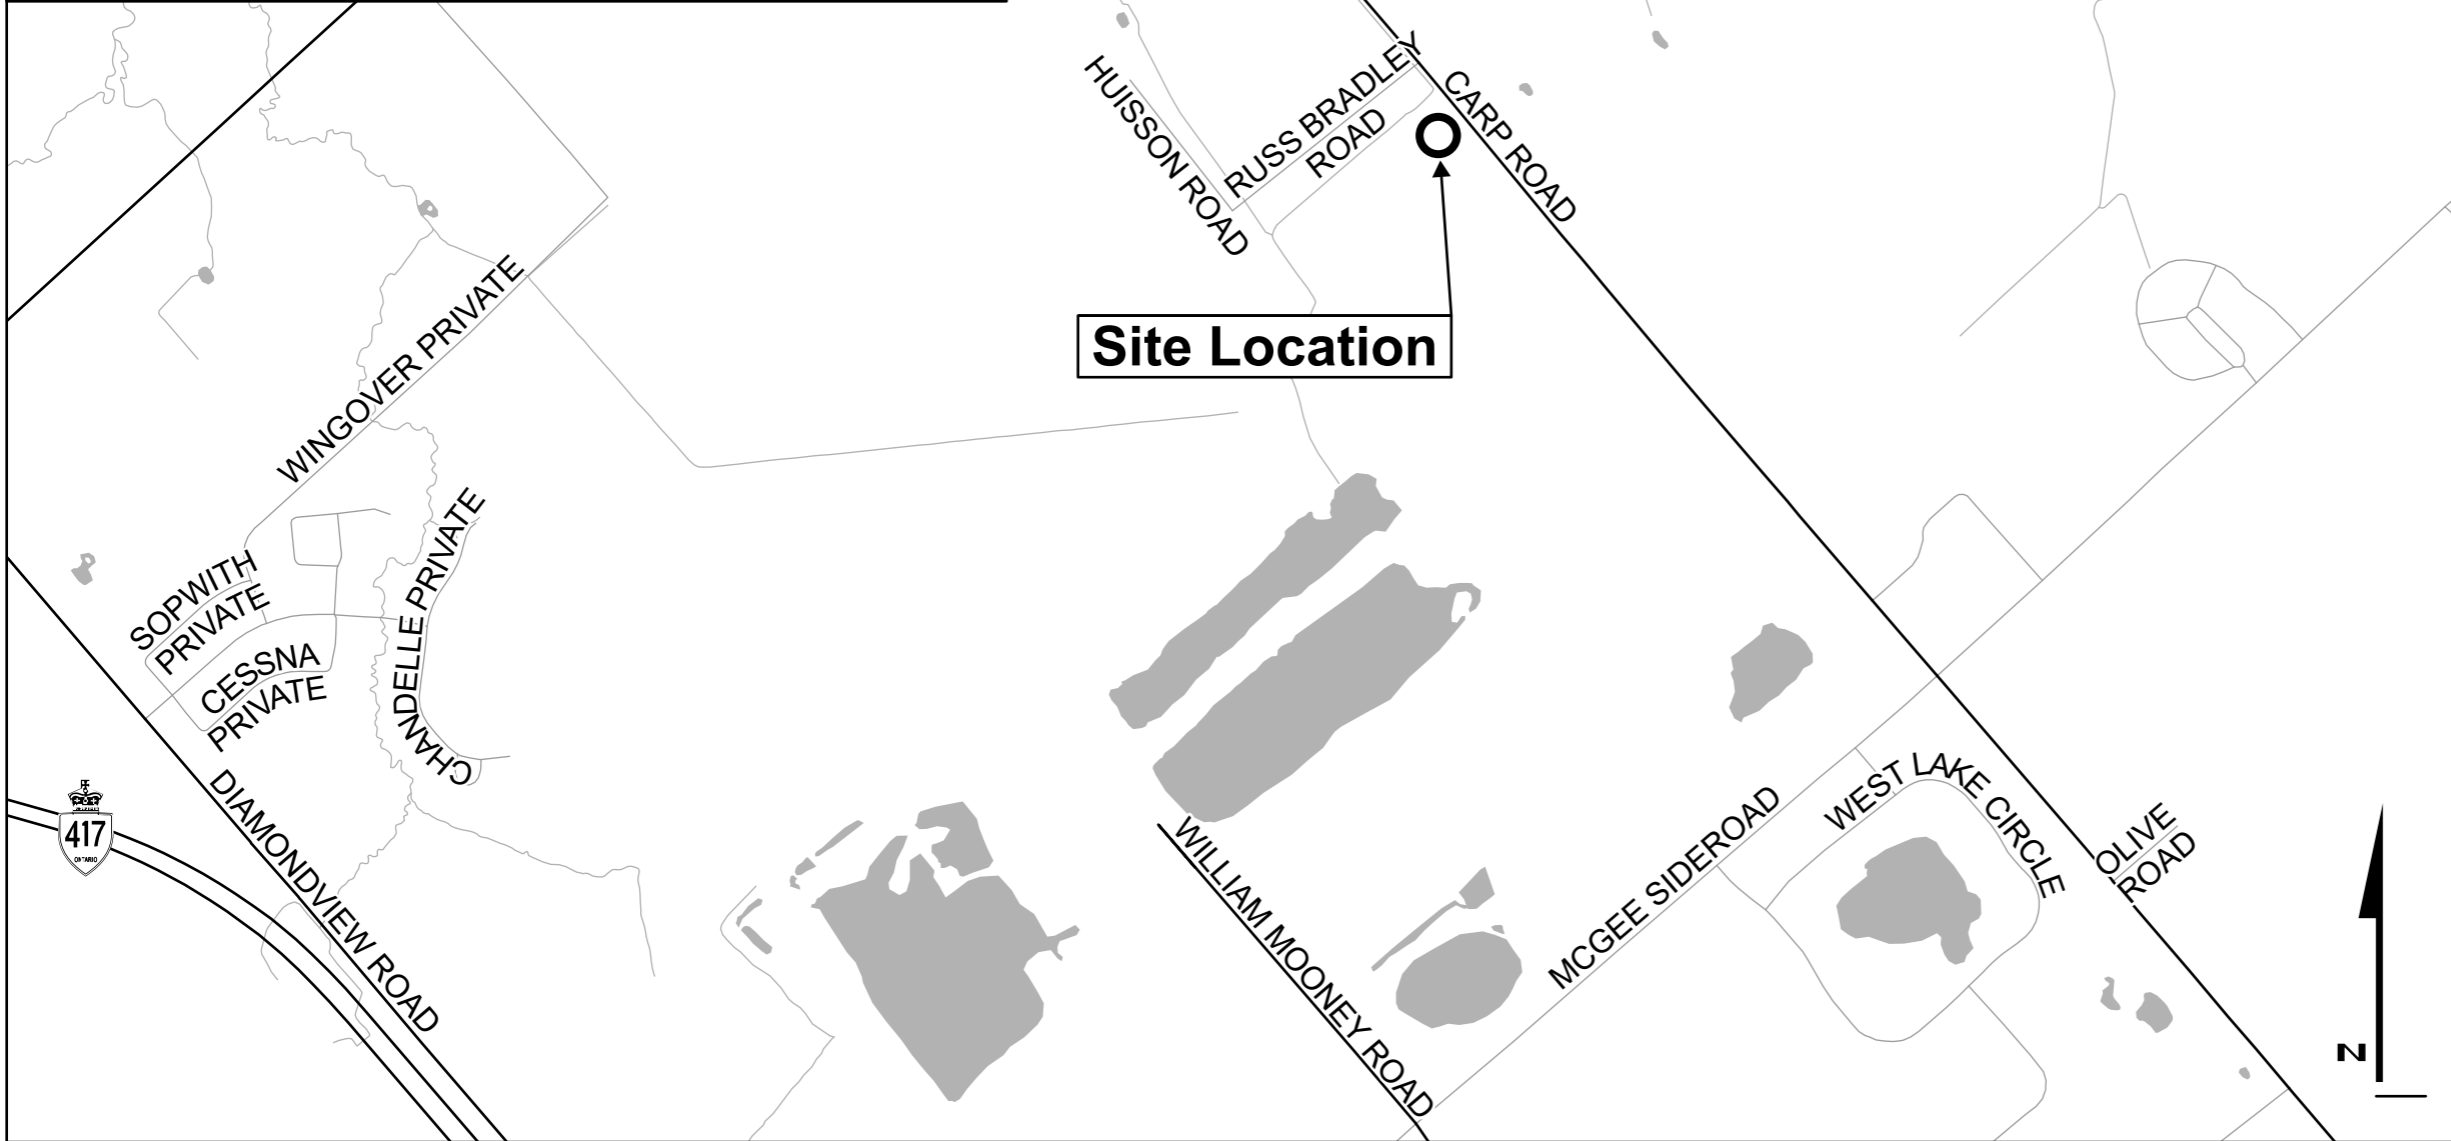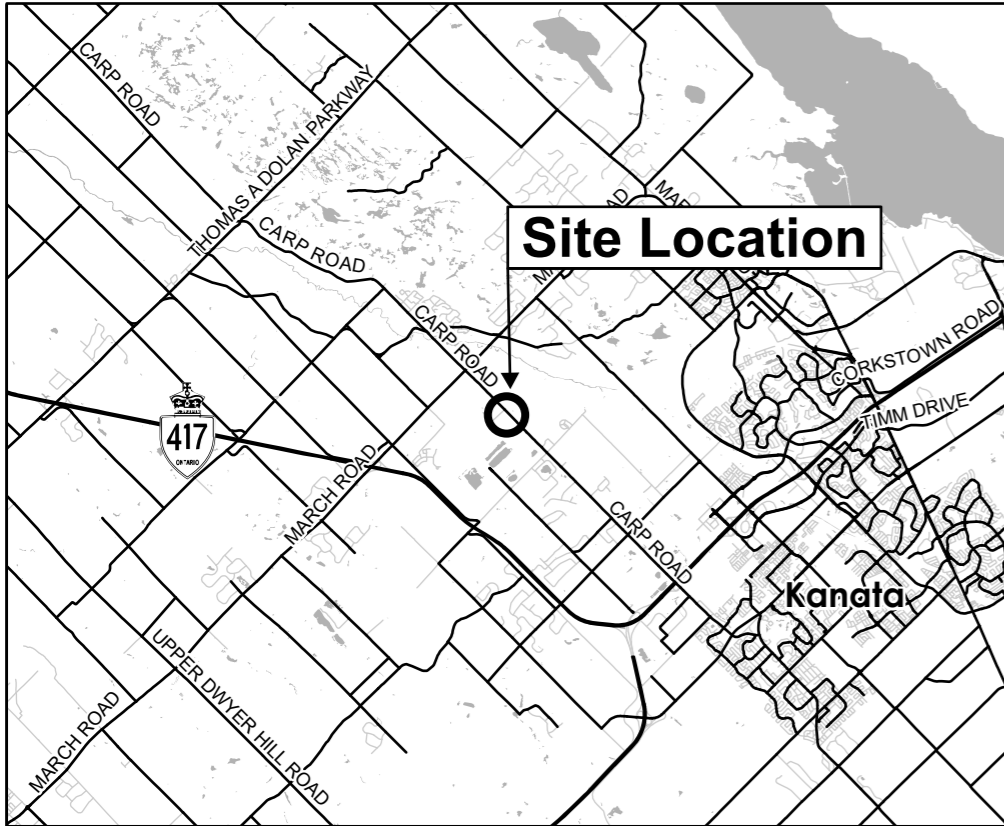

LEGEND

○ Site Location

REFERENCE

GIS data provided by the Ontario Ministry of Natural Resources and Forestry, 2022.



CLIENT:	TREVOR WATKINS	
PROJECT:	1500 THOMAS ARGUE ROAD EIS	
TITLE:	KEY MAP	
McINTOSH PERRY <small>115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com</small>	PROJECT NO: CCO-22-2620	FIGURE:
	Date	Jul., 15, 2022
	GIS	MG
	Checked By	EP
		1



APPENDIX B
BACKGROUND DOCUMENTS

Site Plan Pre-consultation

Meeting Date: June 3, 2021

1500 Thomas Argue Road

Applicant: Trevor Watkins

Consultant: N/A

Ward 5

Councillor Eli El-Chantiry

Proposal Summary: The applicant proposes to build in phases and operate a fully automated indoor/outdoor self-storage facility.

Attendees: Trevor Watkins, Applicant/Owner
Harry Alvey, Project Manager, PIEDD, City of Ottawa
Seana Turkington, Planner, PIEDD, City of Ottawa
Mark Gordon, Planner, PIEDD, City of Ottawa
Sean Harrigan, Planner, PIEDD, City of Ottawa
Sami Rehman, Environmental Planner, PIEDD, City of Ottawa
Alexandra Labuda, Planning Assistant, PIEDD, City of Ottawa
Erica Ogden, Environmental Planner, MVCA

Comments and Meeting Notes

Proposal Details

- Proposed site plan control application to construct a fully automated indoor/outdoor self-storage facility for vehicles, boats, recreational vehicles, and other personal items. The outdoor storage will also include a section for a boat lift/dock inventory. The property will be fenced with chain-link and barbed wire for increased security. There will also be an electronic vehicle control gate and the property will have 24-hour video security. The buildings will not be heated and will be sized to eliminate the need for fire suppression. No staff are expected to be on site. Access will be provided off Russ Bradley Road.

Technical Comments - City Staff

Planning (Provided by Seana Turkington)

Official Plan and Zoning By-law

- As per Schedule A of the Official Plan, the site is designated 'Carp Airport' and is Zoned 'Air Transportation Facility Zone' (T1B) as per the City's Zoning By-law.

3.10.2 – Carp Airport

- The Carp Airport is designated on Schedule A with the intent of providing airport facilities that serve the general aviation needs in Ottawa.
- The land uses permitted in the designation are aviation and other land uses associated with an airport including an aerospace business park and an accessory residential fly-in community consistent with the Carp Airport master land use and servicing plan.
- The purpose of the T1-Air Transportation Facility Zone is to:
 - permit air transportation facilities and aviation-related uses in areas designated as **Ottawa Macdonald-Cartier International Airport** and **Carp Airport** in the Official Plan, and
 - permit a range of employment uses and airport-related commercial and industrial uses at the Ottawa Macdonald-Cartier International Airport.

Air Transportation Facility Zone (T1B)

- The following uses are permitted in the general T1 Zone: airport and related facilities, light industrial uses, parking garage, parking lot, truck transport terminal, warehouse.
- In the T1B Subzone, the following uses are also permitted: convenience store, heavy equipment and vehicle sales (rental and servicing), hotel, instructional facility, office, one dwelling unit for a caretaker or security guard, park, personal service business, place of assembly, post secondary educational institution, research and development centre, restaurant (full service), restaurant (take-out), retail store (limited to a factory outlet store), service and repair shop, storage yard.

In the T1B Subzone, the provisions of the table below apply:

Zoning Mechanisms	Zone Provisions
Minimum setback from a lot line for a dwelling unit (m)	12
Minimum setback from a lot line for an accessory building (m)	12
Minimum setback for buildings other than a dwelling unit or an accessory building	(i) Rear Yard 7.5 (ii) Front Yard 12 (iii) Corner Side Yard 12 (iv) Interior Side Yard 4.5
Maximum lot coverage (%)	50
Minimum Distance Between Buildings on the same lot (m)	10
Minimum Landscaped Buffer abutting Carp Road, an RR zone or any other non-industrial or non-transportation zone (m)	10
Minimum setback for a gasoline pump island or storage tank from an RR zone (m)	150

Site Plan

- The final site plan must show parking, storage, and fire routes as well as watercourse setbacks (regulated under Section 69 of the Zoning By-law). For additional information on preparing studies and plans, please click on the following hyperlink: [Guide to Preparing Studies and Plans](#).
- Landscaping should be provided on site, in accordance with the Carp Road Community Design Plan (to act as a screening measure) and also to provide some vegetation on site. It is recommended that vegetation on site be species native to the Ottawa area. Take a look at: <https://ottawa.ca/en/living-ottawa/environment-conservation-and-climate/wildlife-and-plants/plants>

Parking

- As per the City’s Zoning by-law, isles to reach self-storage units are not permitted to be used as parking spaces. The applicant should refer to the layout of other self-storage centres in the city to see the site operation and determine the site configuration required. Parking requirements are detailed in Part 4 of the Zoning By-law.
- The drive aisle proposed on site must also meet the Private Approach By-law: <https://ottawa.ca/en/living-ottawa/laws-licences-and-permits/laws/law-z/private-approach-law-no-2003-447>

Carp Road Corridor Rural Employment Area

- The Carp Road Corridor Rural Employment Area plays an important role in the development and well-being of the local economy. The diversity and the ability to attract a range of traditional and high technology industries

as well as environmental services, some value-added processing, wood and metal fabrication and commercial uses has been one of the strengths of the Corridor. The vision for this area is contained in the Carp Road Corridor Community Design Plan. New development applications will conform to the policies in the approved community design plan.

- The community design plan for the Carp Road Corridor shall provide direction to the Zoning By-law for future land uses. [Amendment #180, November 8, 2017]
- The subject property falls within the [Carp Road Corridor Community Design Plan](#), which provides and action plan for future development in the corridor. It considers land use, environmental protection, and servicing, visual appearance and land use compatibility amongst other strategies for achieving community objectives.
- The CDP provides design guidelines for industrial and business parks (see section 7.3). Please identify how these guidelines have been met in your planning rationale and site plan.
 - Locate parking at the rear or side of buildings. Where this is not possible and parking is required at the front or side of the building a greater setback from the property line should be required to permit planting to mitigate the effects of the parking area (e.g. parking screened from view).
 - Locate storage and service areas at the rear of buildings except on sites where the property backs onto Carp Road or the main entry road.
 - Preserve as many trees as possible on the site. Compensate for removal of existing trees by extensive planting in the open space corridor, entry features “gateways” and on-site landscape areas. Plant trees along the corridor – an informal mix of trees and shrubs is preferable, with more coniferous than deciduous species.
 - Provide landscaping at the front of buildings. Use landscaping, decorative fences to screen unsightly uses.
 - Create entry feature (“gateways”) for new subdivisions/parks. This should include a sign and landscaping with the name of the development and the park occupants and enhanced lighting for visibility at night.
 - Provide for turning lanes where warranted.

Development Submission & Additional Info

- This site is within the Carp Airport subdivision. For further information on the subdivision as a whole, as well as any pertinent agreements, please speak with the Owner of the subdivision.
- Prior to submitting a site plan control application, the applicant should speak with the ward Councillor about the proposal and contact Building Code Services. Development Charges associated with Building Permits may also apply.
- It is advised that the applicant contact the Carp Airport Authority.
- Given the studies and plans this proposal will require, it is recommended that a Consultant for Engineering and Planning be hired.
- Please note that a draft of the New Official Plan was released publicly in November 2020. The New Official Plan is scheduled to go to Council this Fall for a decision. If a formal application is submitted, depending on timing, the policy regime may change. If a formal application is submitted prior to September 2021, the required planning rationale should speak to compliance with policies in the New Official Plan.

Engineering (Provided by Harry Alvey)

- The applicant will need to provide SWM management for this site. Given that this is a commercial site, it will probably need an ECA for the SWM. The MECP is taking approximately 9 to 11 months to process these permits. Design is to be based on Post- to Pre- storm events. If the airport will allow a SWM Pond the SWM ponds are required to have 300mm freeboard above the 100-yr storage elevation. If an OGS is proposed for Quality Control a ETV Protocol is required.
- SWM discharge is required to have an enhanced level of water quality of 80% TSS removal.
- There is a stormwater course which provide stormwater runoff from the airport to the Carp river located along the south side of Russ Bradley Rd. that should have capacity for the SWM discharge from your site. This should be confirmed by your engineer at time of engineering submission. The water course(s) must be

maintained at or better than the current level of flow & service. In addition, this might be fish habitat. It is suggested you contact MVCA regarding any proposed work with these water courses.

- The applicant should contact Allen Even at OFD regarding fire protection requirements and possible need for storage tanks for fire fighting.
- The applicant should contact the Carp Airport Authority regarding any flight operations restrictions on the site.
- If in the future it is decided to create an onsite office space, then a Hydro-G will be required prior to a building permit. Note: there are a number of issues with the ground water quality in the area.
- Please provide 'flattened' *.pdf versions of documents that include no 'comments' or 'edits' and represent what final printed version will look like.
- Contacts for the following are: OFD: Allan Evans, P.Eng Fire Services engineer - allen.evans@ottawa.ca

Environmental Planning (Provided by Sami Rehman)

- The proposal triggers an Environmental Impact Statement (EIS), which should cover the following:
 - a. Potential significant wildlife habitat, as part of the natural heritage system (OP 2.4.2)
 - b. Potential significant habitat for threatened or endangered species (OP 4.7.4)
 - c. The appropriate setbacks from the watercourse (OP 4.7.3)
 - d. Potential impacts of short and long-term outdoor vehicle and machinery storage on the natural features, and surface and groundwater features
 - e. Opportunities for energy conservation and shading with the site's design and landscaping (OP 4.9)
- Further details of the EIS requirement can be found in OP section 4.7.8 or the EIS guidelines: https://documents.ottawa.ca/sites/documents/files/documents/eis_guidelines2015_en.pdf
- Furthermore, the subject property has been identified as a high recharge area according to the Carp Road Community Design Plan. As such, the environmental policies of the CDP require a groundwater impact study to be completed. <https://documents.ottawa.ca/sites/documents/files/documents/con021202.pdf>
- A tree conservation report (TCR) will also be required for this submission (OP 4.7.2). The City encourages as much tree retention as possible and tree compensation for trees removed. The TCR can be combined with the EIS to avoid duplications. Further details of the TCR requirements can be found in the TCR guidelines. <https://ottawa.ca/en/living-ottawa/laws-licences-and-permits/laws/law-z/tree-protection-law-no-2020-340#schedule-tree-conservation-report-guidelines>
- I would also encourage the applicant to consult with the MVCA to determine if any permits or approvals are required under their regulations.

Conservation Authority (MCVA)

Environmental Planning (Provided by Erica Ogden)

- The watercourse on the property is regulated by the Mississippi Valley Conservation Authority (MVCA) under Ontario Regulation 153/06, *Development, Interference with Wetlands and Alterations to Shorelines and Watercourses*. Under Ontario Regulation 153/06, written permission is required from the MVCA prior to the initiation of development (which includes construction, site grading and the placement or removal of fill) within an area regulated by the Conservation Authority as well as straightening, changing, diverting or interfering in any way with the existing channel or the shoreline of a watercourse.
- MVCA has issued a permit (W19/283, expiry February 5, 2022) for the watercourse realignment along Russ Bradley Road. With the permit a development setback was established from the realigned watercourse. The crossing location for access to Russ Bradley Road was also established. Should any further alteration to the watercourse be required (e.g. culvert installation, stormwater outlet), an additional permit from the Conservation Authority would be required.
- The development setbacks from the watercourse must be met and the plantings required through the watercourse realignment maintained.
- A stormwater management report will be required with the site plan submission:
 - The water quality requirement is an enhanced level of protection, 80 % total suspended solids removal

- The property is within the Carp River Watershed Subwatershed Study area which has annual infiltration targets as outlined below. Existing infiltration rates on site should be assessed and maintained post development.
 - High groundwater recharge area 262mm/year infiltration

Application Submission Information

Application Type: **Site Plan Control, (type of application to be confirmed prior application submission)**

For more information on the Official Plan designation, please visit: <https://ottawa.ca/en/city-hall/planning-and-development/official-plan-and-master-plans/official-plan/volume-1-official-plan/section-3-designations-and-land-use#3-7-5-rural-employment-area>

For more information and related Zoning By-law provisions, please visit: <https://ottawa.ca/en/zoning-law-no-2008-250/zoning-law-2008-250-consolidation#pdf-version>

For information on Site Plan Control Applications, including fees, please visit: <https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/fees-and-funding-programs/development-application-fees>

The application processing timeline generally depends on the quality of the submission. For more information on standard processing timelines, please visit: <https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/development-application-forms#site-plan-control>

[Prior to submitting a formal application, it is recommended that you pre-consult with the Ward Councillor.](#)

Application Submission Requirements


For information on the preparation of Studies and Plans and the City's requirements, please visit: <https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans>

Please provide electronic copy (PDF) of all plans and studies required.

All plans and drawings must be produced on A1-sized paper and folded to 21.6 cm x 27.9 cm (8½" x 11").


Note that many of the plans and studies collected with this application must be signed, sealed and dated by a qualified engineer, architect, surveyor, planner or designated specialist.

THIS SITE PLAN HAS BEEN BASED ON THE SURVEYOR'S TOPOGRAPHY SKETCH PREPARED BY MCINTOSH PERRY SURVEYING INC. DATED OCTOBER 26th, 2021.


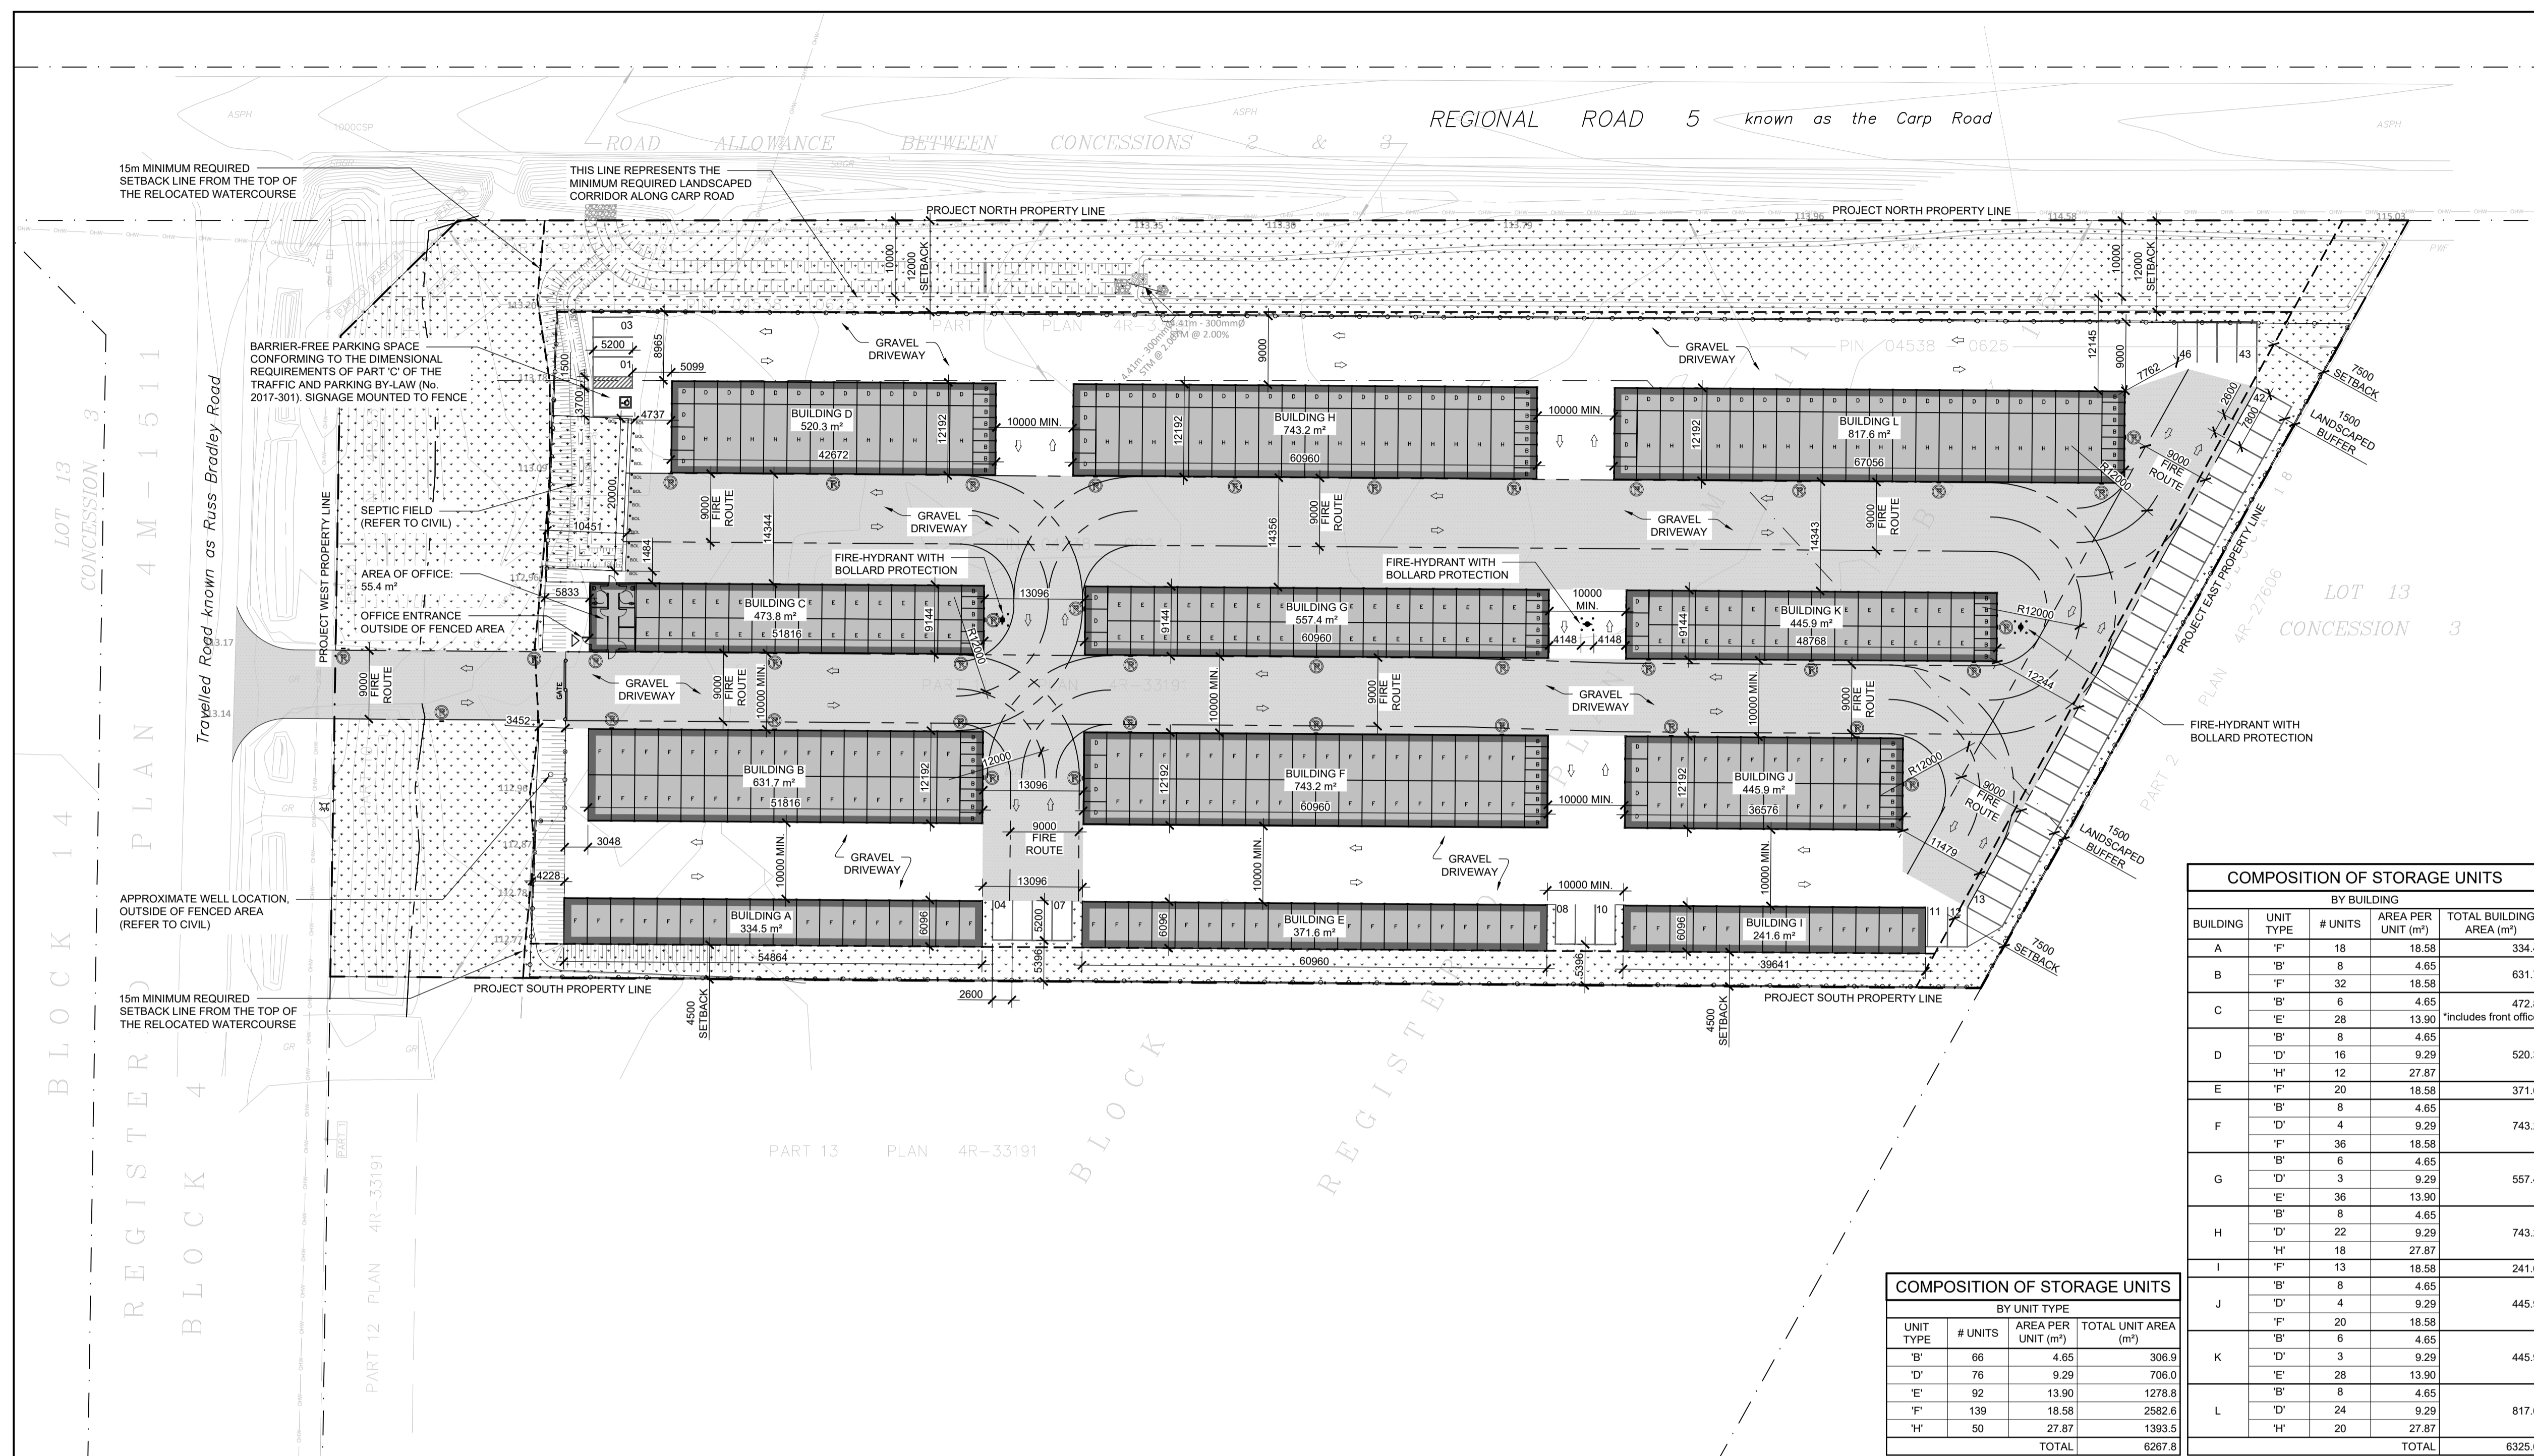


COMPOSITION OF STORAGE UNITS				
BY BUILDING				
BUILDING	UNIT TYPE	# UNITS	AREA PER UNIT (m²)	TOTAL BUILDING AREA (m²)
A	'F'	18	18.58	334.4
B	'B'	8	4.65	631.7
	'F'	32	18.58	
C	'B'	6	4.65	472.8
	'E'	28	13.90	*includes front office
D	'B'	8	4.65	520.3
	'D'	16	9.29	
E	'B'	8	4.65	371.6
	'D'	4	9.29	
F	'B'	6	4.65	743.2
	'D'	36	18.58	
G	'B'	6	4.65	557.4
	'D'	3	9.29	
H	'B'	8	4.65	743.2
	'D'	22	9.29	
I	'B'	8	4.65	241.6
	'D'	13	18.58	
J	'B'	8	4.65	445.9
	'D'	4	9.29	
K	'B'	6	4.65	445.9
	'D'	3	9.29	
L	'B'	8	4.65	817.6
	'D'	24	9.29	
TOTAL				6325.6

COMPOSITION OF STORAGE UNITS			
BY UNIT TYPE			
UNIT TYPE	# UNITS	AREA PER UNIT (m²)	TOTAL UNIT AREA (m²)
'B'	66	4.65	306.9
'D'	76	9.29	706.0
'E'	92	13.90	1278.8
'F'	139	18.58	2582.6
'H'	50	27.87	1393.5
TOTAL			6267.8

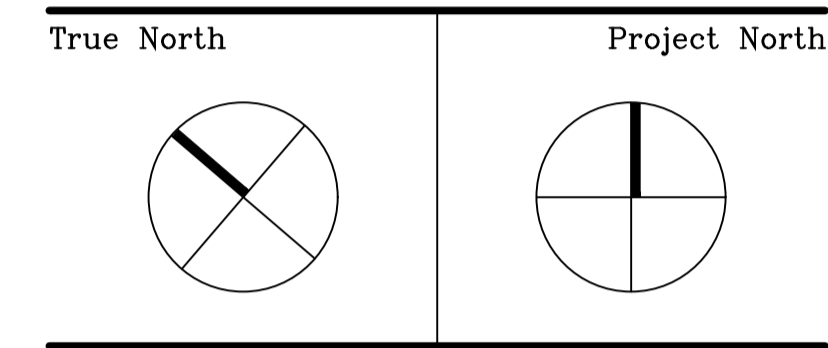

Revisions			
No.	By	Description	Date
05	JF	ISSUED FOR SITE PLAN CONTROL	16 DEC 2022
04	JF	ISSUED FOR COORDINATION	13 DEC 2022
03	JF	ISSUED FOR COORDINATION	27 SEP 2022
02	JF	ISSUED FOR REVIEW	17 JUN 2022
01	JF	ISSUED FOR CLIENT REVIEW	11 JAN 2022

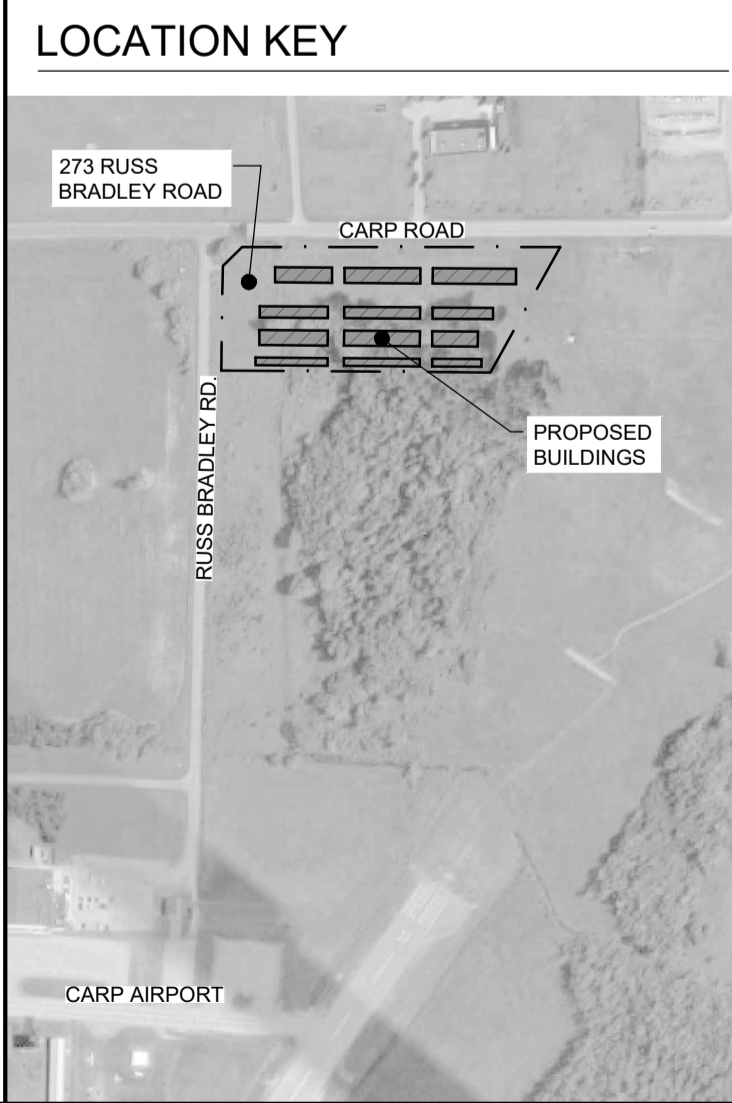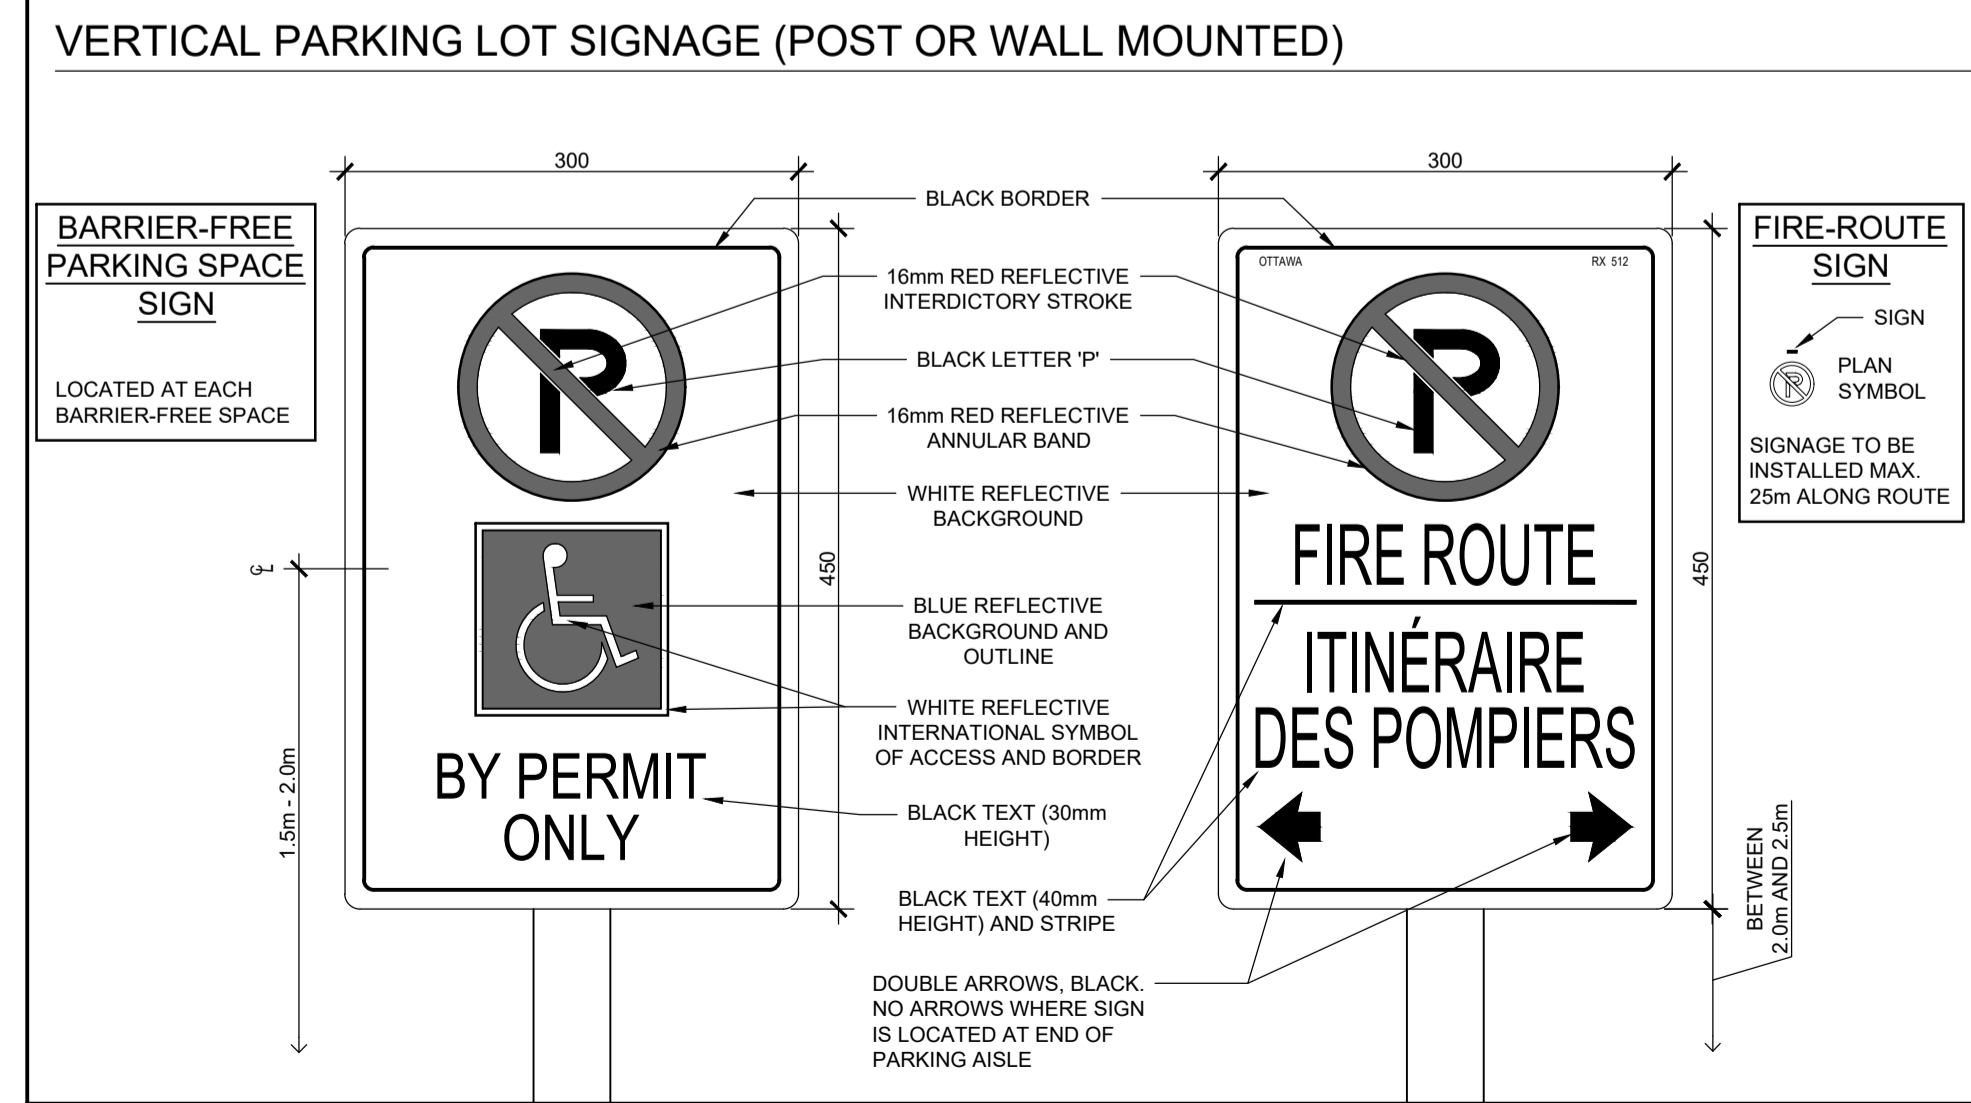

ZONING INFORMATION

PER THE CITY OF OTTAWA ZONING BY-LAW 2008-250 CONSOLIDATION

LEGAL DESCRIPTION:
PORTIONS OF PARCEL 04538-0625, PARCEL 04538-0924 AND ABUTTING LANDS. PARTS 8 THROUGH 11, PLAN 4R-33191 BEING PART OF BLOCKS 15 AND 16, REGISTERED PLAN 4M-1511, CITY OF OTTAWA

PROPOSAL:
NEW GROSS 6,328 m² [68,093 ft²] SINGLE STOREY SELF STORAGE UNITS OVER 12 BUILDINGS. AN OFFICE, UTILITIES ROOM, AND WASHROOMS WILL BE PROVIDED IN THE BUILDING NEAREST THE MAIN DRIVEWAY ACCESS.

ZONING:
DESIGNATION: (T1B) AIR TRANSPORTATION FACILITY SUBZONE (PART 12)


ZONING PROVISIONS (PER TABLES 207 & 208):

- LOT AREA (MIN.) = NO MINIMUM
- ACTUAL LOT AREA = 24,247 m²
- LOT FRONTAGE (MIN.) = NO MINIMUM
- ACTUAL FRONTAGE = 99.1 m
- SETBACKS (MIN.):
 - FRONT = 12.0 m
 - CORNER SIDE = 12.0 m
 - INTERIOR SIDE = 4.5 m
 - REAR = 7.5 m
- MINIMUM SETBACK FROM WATERCOURSE: 15.0 m FROM THE TOP OF BANK, PER SCHEDULE H OF SUBDIVISION AGREEMENT
- MINIMUM LANDSCAPED BUFFER ABUTTING CARP ROAD = 10.0 m
- MIN. % OF PARKING PROVIDED AS LANDSCAPED AREA = 15% MIN.
 - REQUIRED: = 93.15 m²
 - ACTUAL: = 6,140.4 m²

LOADING REQUIREMENTS:
(PER TABLE 113A UNDER PART 4)
BASED ON THE GROSS FLOOR AREA OF THE BUILDING, A MINIMUM OF 1 STANDARD PLUS 1 OVERSIZED LOADING SPACES ARE REQUIRED.

PARKING:
(PER TABLE 101 UNDER PART 4)
REQUIRED: 46 SPACES
PROVIDED: 46 SPACES

RESERVED BARRIER-FREE PARKING SPACES:
REQUIRED: 1 SPACES
PROVIDED: 1 SPACES

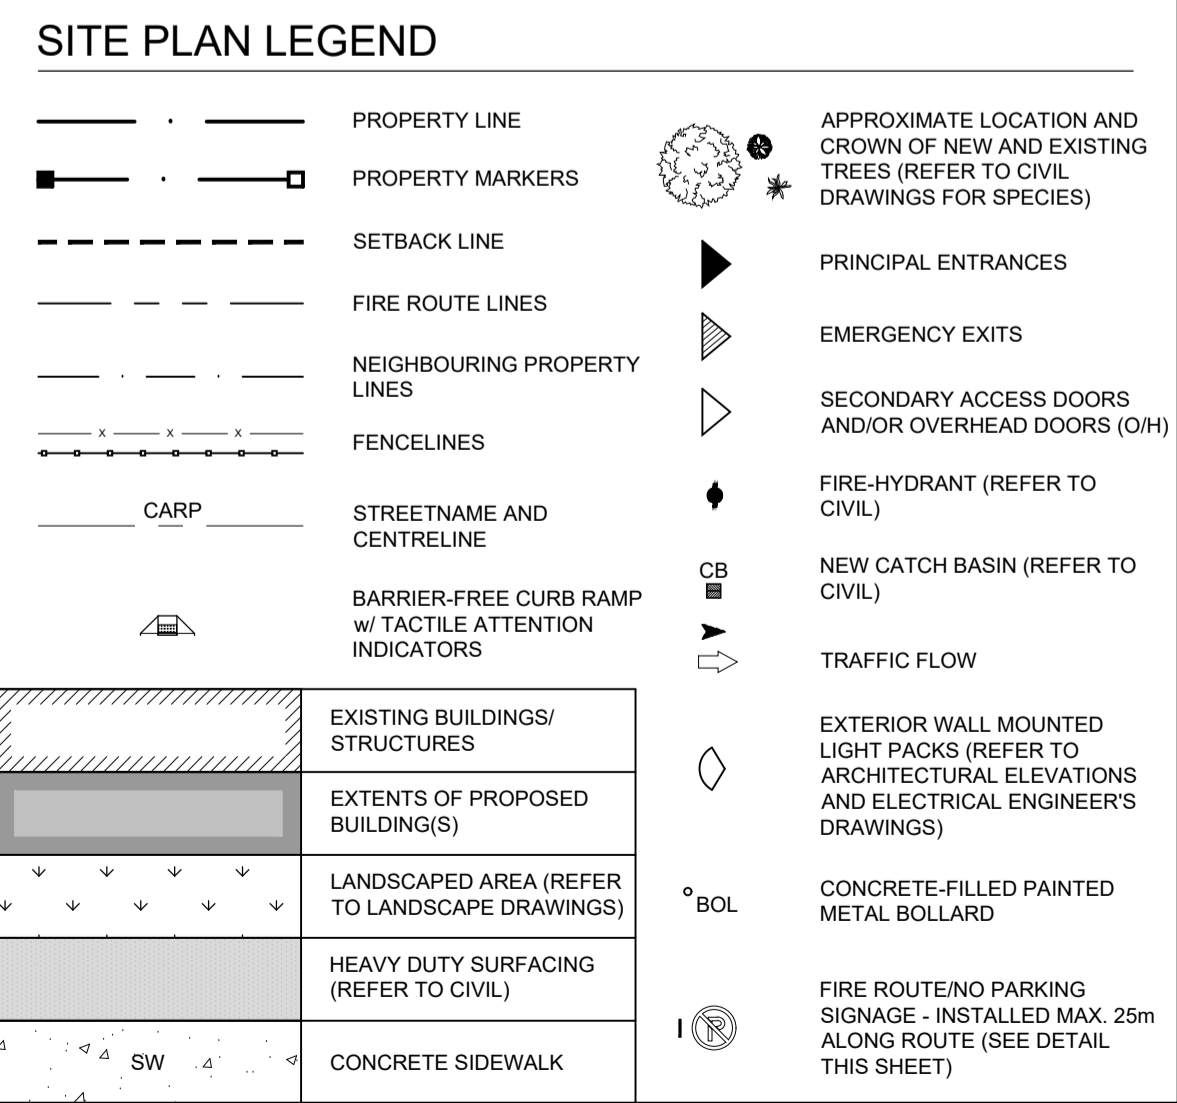

Project
SELF STORAGE SITE PLAN REVIEW

273 & 275 RUSS BRADLEY RD., CARP, ON

Drawing
PROPOSED SITE PLAN

Scale AS NOTED

Drawn J.F.

Checked J.F. / C.D.

Project No. 21-170

Date DECEMBER 2021

Drawing No. SP-A01

Stamp
ONTARIO ASSOCIATION OF ARCHITECTS
CHRISTOPHER LEE DEIMLING
LICENCE 6239

**WEST CAPITAL AIRPARK
(Carp Airport)
1500 Thomas Argue Road
City of Ottawa**

HYDRAULIC NETWORK ANALYSIS

Prepared By:

NOVATECH

Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6

November 2011

Revised: May 28, 2013

Revised: September 26, 2013

Revised: November 5, 2014

Novatech File: 102085

Ref: R-2014-172

November 5, 2014

City of Ottawa
Planning & Growth Management Department
110 Laurier Avenue West
4th Floor Infrastructure Approvals Division
Ottawa, ON K1P 1J1

Attention: Kevin Hall, C.E.T., Project Manager

Dear Sir:

**Re: West Capital Airpark
Hydraulic Network Analysis
Novatech File No.: 102085
City of Ottawa File No.: D07-16-10-0016**

Please find enclosed four (4) copies of the report entitled, "West Capital Airpark - Hydraulic Network Analysis" revised November 2014. This report has been revised with additional Modelling Scenarios 6 & 7 to confirm adequate capacity of standalone Phase 1 Residential Hydraulic Network.

If you have any questions, please contact the undersigned.

Yours truly,



Carl Sciuk, P. Eng.
Senior Project Manager

cc: City of Ottawa – Fire Services
West Capital Developments

TABLE OF CONTENTS

1.0 INTRODUCTION	1
2.0 BACKGROUND	1
3.0 DOMESTIC WATER SUPPLY	2
4.0 FIRE FLOWS	4
5.0 HYDRAULIC MODELLING	4
5.1 EPANET MODELLING SCENARIOS	5
5.1.1 <i>Water Storage Facility Reservoir Filling</i>	5
5.1.2 <i>Maximum Day Plus Fire Flow to Residential</i>	5
5.1.3 <i>Fire Flow to Business Park</i>	5
5.1.4 <i>Peak Hour Flow to Residential and Business Park Area</i>	5
5.1.5 <i>Phase 1 Water Age</i>	6
5.1.6 <i>Residential Phase 1 - Peak Hour</i>	6
5.1.7 <i>Residential Phase 1 - Maximum Day plus Fire</i>	6
5.2 RESULTS	6
5.2.1 <i>Water Storage Reservoir Filling</i>	6
5.2.2 <i>Maximum Day + Fire Flow</i>	8
5.2.3 <i>Fire Flow to Business Park Area</i>	8
5.2.4 <i>Peak Hour Flow to Residential and Business Park Area</i>	8
5.2.5 <i>Phase 1 Water Age</i>	8
5.2.6 <i>Residential Phase 1 - Peak Hour</i>	9
5.2.7 <i>Residential Phase 1 - Maximum Day plus Fire</i>	9
5.3 WATER STORAGE FACILITY	10
6.0 METER CHAMBER AT CARP	10
7.0 CONCLUSIONS	11

LIST OF FIGURES

Figure 1:	Key Plan
Figure 2:	Land Use Plan
Figure 3:	Reservoir Fill Rate vs Residual Pressure
Figure 4:	Watermain Age vs. Flow

LIST OF TABLES

Table 1:	Phased Water Demand
Table 2:	Water Storage Requirements

APPENDICES

Appendix A:	Draft Conditions
Appendix B:	Correspondence
Appendix C:	EPANET
Appendix D:	Miscellaneous Information

DRAWINGS

Overall Watermain Layout Plan	102085-WMOL, revision 8
Plan & Profile Drawings Carp Road	102085-P65 to 102085-P68, all revision 6
Watermain Details Plan	102085-D7, revision 6
Water Storage Facility Process (Schematic)	102085-W1, revision 3
Water Storage Facility Pump Room (Sections)	102085-W1.1, revision 3

1.0 INTRODUCTION

The proposed West Capital Airpark is located approximately 2km south of the Village of Carp as shown on **Figure 1** (Key Plan). A private communal water distribution network is proposed which will be connected to the existing Village of Carp municipal water distribution network. The proposed private communal water distribution network will form part of a common elements condominium that will be established for this development. The common elements condominium will own, operate and maintain the water system which will service a mixture of single family homes, townhomes, communal hangers and Aerospace Business Park as shown on **Figure 2** (Land Use Plan).

The subdivision has been draft approved. Draft conditions are included in **Appendix A** for reference.

The proposed private communal water distribution includes a feeder main from Carp, a water storage facility and water distribution network. The existing Village of Carp distribution system will supply the water storage facility with maximum day demand. The City of Ottawa has committed to supplying Phase 1 Maximum Day water demand to the West Capital Airpark by utilizing existing reserve capacity. The City of Ottawa has stated that future phase water supply requirements will be provided by expanding reserve capacity through upgrades of the existing water supply system as per the Village of Carp Class Environmental Assessment (May 2008).



The proposed West Capital Airpark Water Storage Facility will monitor water quality parameters and boost chlorine levels if required to ensure drinking water is potable prior to local distribution. Domestic peak hour water requirements and fire flow will be provided to the Airpark via the water storage facility. This report has been produced to provide the basis for detailed design of the proposed private communal water distribution network, and addresses questions received from the City of Ottawa.

2.0 BACKGROUND

The West Capital Airpark completed an Environmental Assessment Report¹ for the proposed project in 2007 which determined that water supply from the Village of Carp was the preferred alternative. Subsequently, the Carp Environmental Assessment² for water upgrades within Carp incorporated the maximum day allocation of 1.46ML/day for the airport. The City has agreed that a Phase 1 maximum day allocation of 0.52ML/d will be provided to the airport without triggering any upgrades within Carp. The water supply beyond Phase 1 maximum day allocation will require upgrades of the Carp water supply system, as described in the Carp EA. The maximum day allocation for Phase 1 has not increased, but the mix of development has been modified as follows:

¹ Carp Airport Water & Sanitary Alternatives Evaluation Report, Novatech, April 2007

² Village of Carp Class EA for Water and Wastewater Infrastructure Upgrade/Expansion, Stantec, May 2008

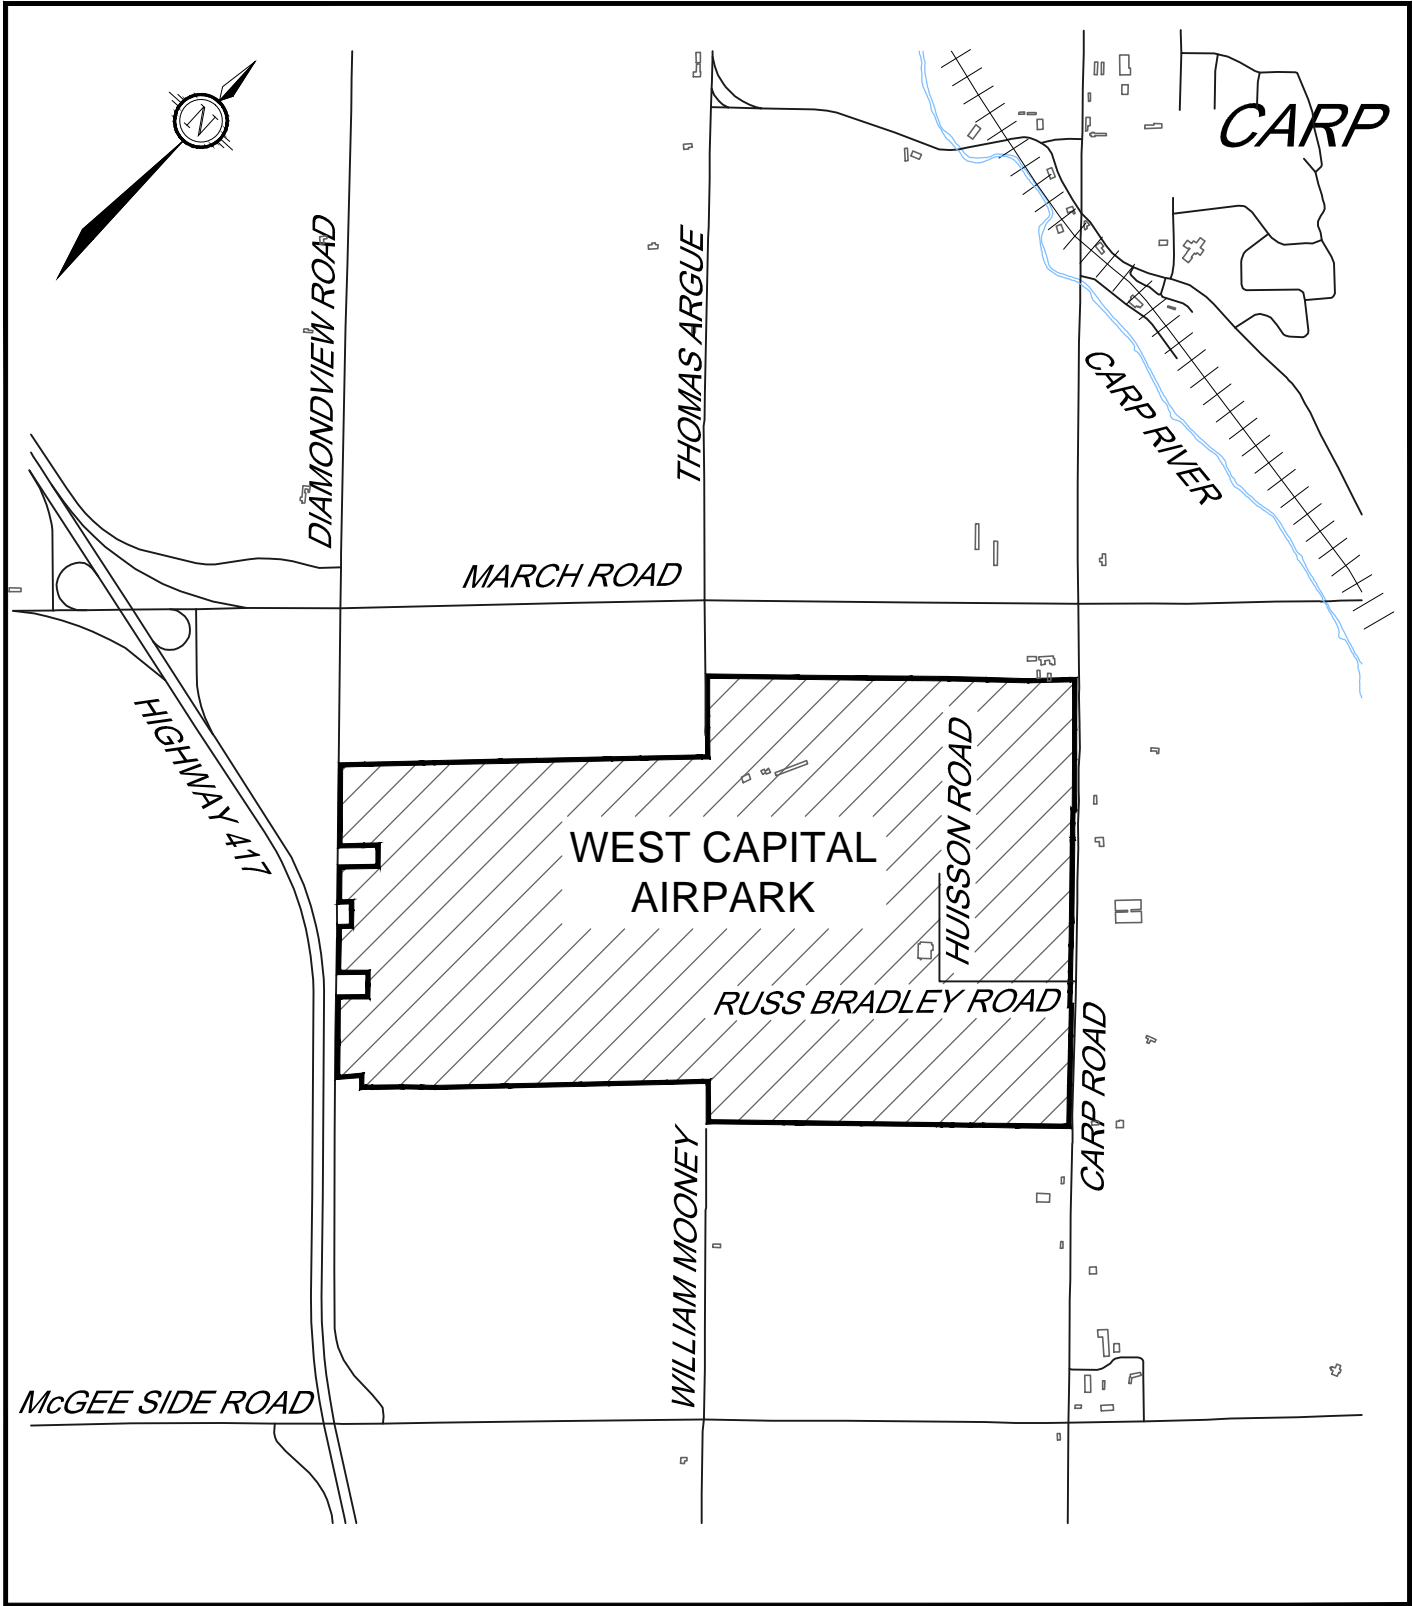

M:\20021102085\CAD\figure\2014 REPORTS\20141103Figure 1.dwg, FIG 1- KEY PLAN, Nov.03, 2014 - 11:59am, dcoffey



Engineers, Planners & Landscape Architects

Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com


CITY OF OTTAWA

WEST CAPITAL AIRPARK

KEY PLAN


NOV 2014 102085 FIGURE 1

M:\2021\102085\CAD\102085-1\CAD\figure20141103\Figure 2.dwg, FIG 2, Nov 05, 2014 - 3:34pm, dcoffey

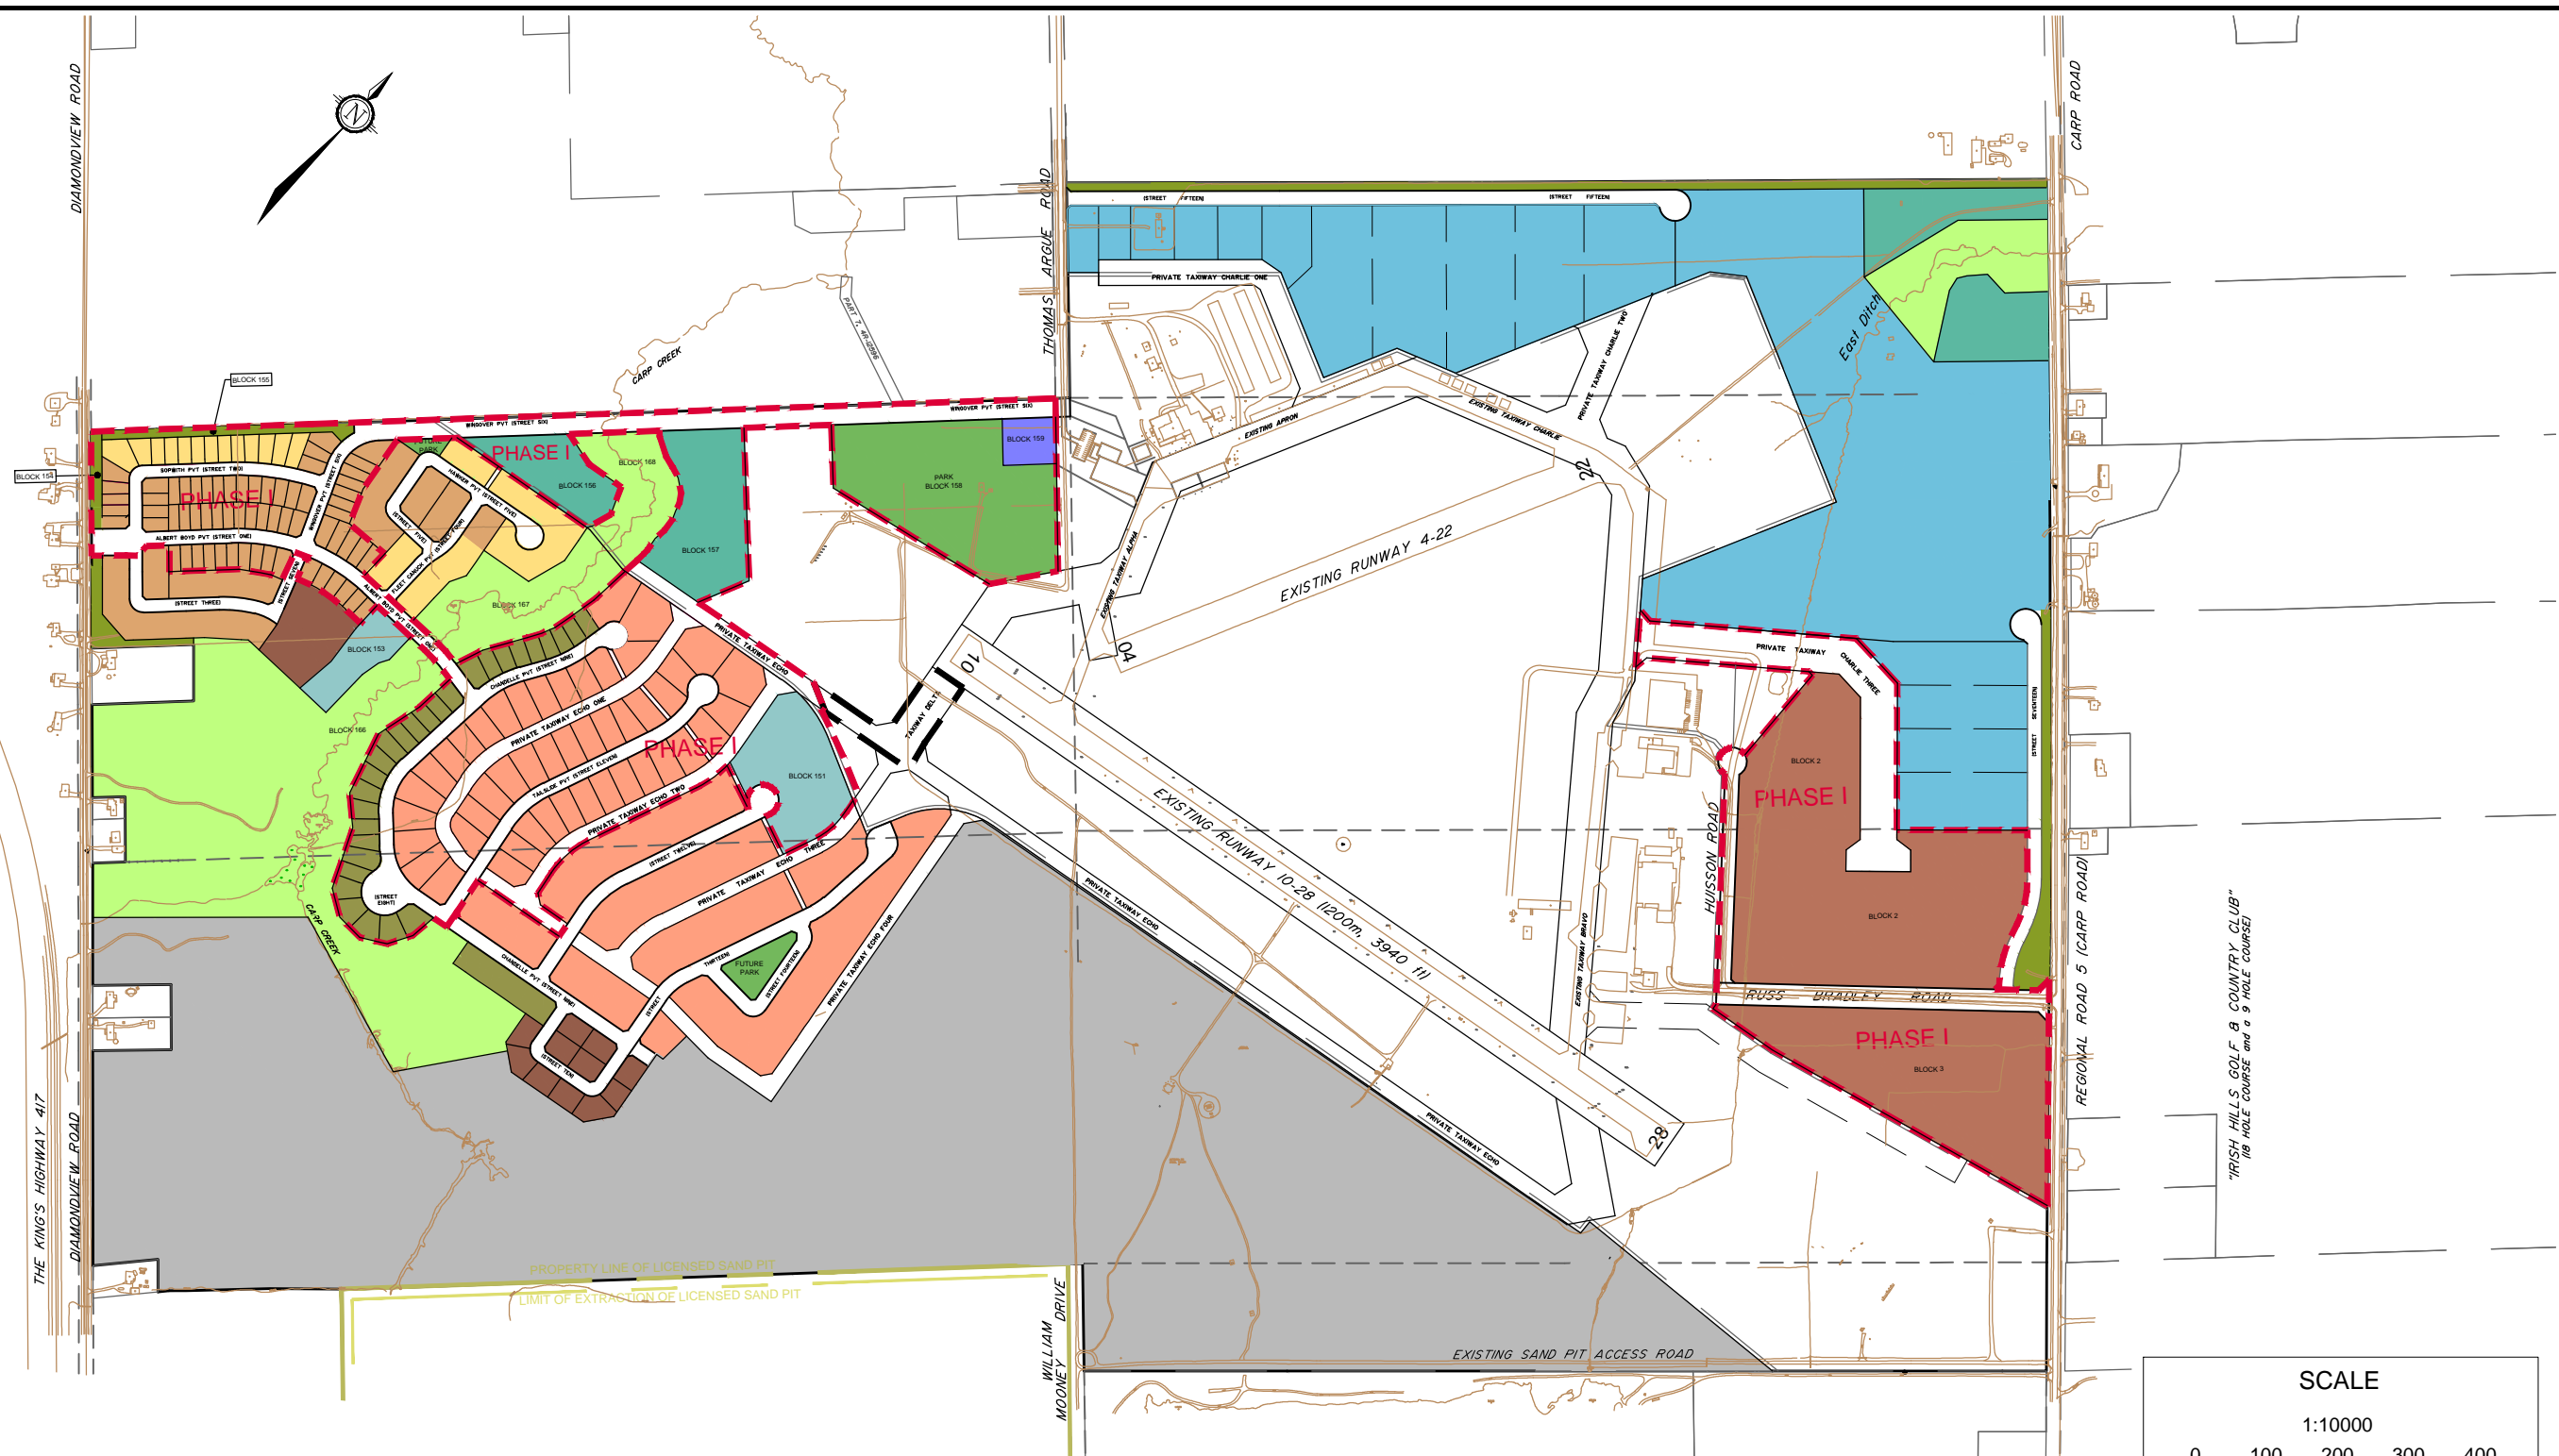

LEGEND

	LIMITS OF PHASE 1 (DEVELOPMENT)		LIMITS OF PHASE 1 (AIRPORT)		SWM FACILITY AREA		OPEN SPACE (TO BE DEDICATED TO CITY)
	SINGLES 50' (15.2m) WIDE PHASE 1 LOTS: 64		HANGAR ESTATE LOTS 30m PHASE 1 LOTS: 46		AEROSPACE BUSINESS PARK - PHASE 1		AEROSPACE BUSINESS PARK - FUTURE PHASE
	SINGLES 60' (18.3m) WIDE PHASE 1 LOTS: 13		TOWN HOMES (9.0m WIDTH) PHASE 1 UNITS: 0		COMMUNAL HANGARS / CLUBHOUSE		CORE AIRPORT AREA
	SINGLES 70' (21.3m) WIDE PHASE 1 LOTS: 28	PHASE 1 LOTS / UNITS: 151 TOTAL LOTS / UNITS: 329			ADDITIONAL LANDS OWNED BY WEST CAPITAL DEVELOPMENTS		LANDSCAPE BUFFER

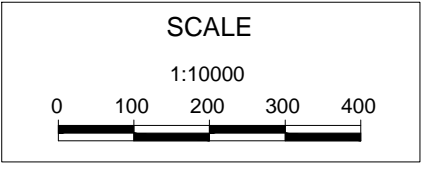

NOVATECH
 Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada K2M 1P6
 Telephone (613) 254-9643
 Facsimile (613) 254-5867
 Website www.novatech-eng.com

WEST CAPITAL AIRPARK
LAND USE PLAN
 NOV 2014 102085 FIGURE 2

Original Initial Phase

110 Residential Units
200,000ft² serviced business park
Max Day = 0.52ML/day

Revised Initial Phase

151 Residential Units
0 ft² serviced business park [private wells]
Max Day = 0.47ML/day

The water distribution network will be a private, condominium owned communal system under the jurisdiction of the SDWA. Correspondence to the City³ (October 28, 2011 and March 8, 2012) summarizing the design standards being used and the responsibility for review is included in **Appendix B**.

3.0 DOMESTIC WATER SUPPLY

The West Capital Airpark will be proactive in water conservation measures and anticipate that maximum day water demand will be considerably less than City of Ottawa Design Guidelines demand estimates. However, the City of Ottawa Design Guidelines have been used in this EPANET analysis in order to conservatively validate the operation of the water distribution network. **Table 1** indicates the phased demand.

The City of Ottawa has stated that the water supply in the private distribution network must be deemed non potable until it is tested for residuals at the water storage facility. The watermain from Carp will fill reservoirs at the water storage facility prior to distribution to any potable water users.

A 150mm watermain will supply potable water from the water storage facility back to the business park area. The 150mm watermain will be constructed in Phase 1, but not commissioned until later phases when the business park is developed. The area serviced by this 150mm watermain is indicated on **the Overall Watermain Layout Plan (102085-WMOL)** and **Table 1**.

³ Novatech letter dated October 28, 2011, Appendix B

³ Novatech memo dated March 8, 2012, Appendix B

**TABLE 1:
PHASED WATER DEMAND**

Proposed Use	Phase 1	Future	Ultimate
Residential			
Single Units	151	138	289
Capita/Single Unit	3.4	3.4	3.4
Townhome Units	0	41	41
Capita/Townhome Unit	2.7	2.7	2.7
Population	510	580	1090
Average Flow/Capita	350 L/d	350 L/d	350 L/d
Average Day Flow	179,690 L/d	202,965 L/d	382,655 L/d
Maximum Day Flow	449,225 L/d	507,413 L/d	956,638 L/d 2.5 x Avg Day
Peak Hour Flow	11.4 L/s	12.9 L/s	24.4 L/s 2.2 x Max Day
Non Residential			
Community Center		11,615 L/d	11,615 L/d
Communal Hanger	900 L/d		900 L/d
City Park	1,200 L/d		1,200 L/d
Sewage Treat. Plant	200 L/d		200 L/d
Average Day Flow	2,300 L/d	11,615 L/d	13,915 L/d
Maximum Day Flow	3,450 L/d	17,423 L/d	20,873 L/d 1.5 x Avg Day
Peak Hour Flow	0.1 L/s	0.4 L/s	0.4 L/s 1.8 x Max Day
Business Park			
Cumulative Land Area		18.6 Ha	18.6 Ha
Building Floor Area		800,000 sq.ft	800,000 sq.ft
Average Flow/ha		35,000 L/d	35,000 L/d
Average Day Flow		651,000 L/d	651,000 L/d
Max Day Flow		976,500 L/d	976,500 L/d 1.5 x Avg Day
Peak Hour Flow		20.3 L/s	20.3 L/s 1.8 x Max Day
Total Average Flow	189,990 L/d	865,580 L/d	1,047,570 L/d
Total Max Day Flow	452,675 L/d	1,501,335 L/d	1,954,010 L/d
Total Max Day Flow	5.2 L/s	17.4 L/s	22.6 L/s
Total Max Day + Fire	68.3 L/s	80.5 L/s	85.7 L/s Fire Flow=63.08L/s
Total Peak Hour	11.5 L/s	33.6 L/s	45.1 L/s

4.0 FIRE FLOWS

Novatech met with the City of Ottawa Fire Services on April 20, 2011⁴ to discuss the West Capital Airport fire protection requirements. Fire flow will be provided to the residential area, service business park and unserviced business park. Novatech presented the concept plan and discussed the tradeoffs between higher fire flows and water quality due to the extensive water distribution network compared with modest water demand. The City of Ottawa Fire Services reviewed the site plan and suggested the following:

- 1) A fire flow of 63.08L/s for 30 minutes was acceptable for all areas of the development. This reflects the standard for rural fire fighting in the area and the city can supplement flows with rural fire shuttle capabilities.
- 2) All fire hydrants should be fully charged so that when fire fighters arrive they can hook up and start fighting the fire without the need to open valves etc. This necessitates a backflow preventer chamber for unserviced Business Park area because there is no domestic consumption and lines may stagnate.
- 3) Fire hydrants are not required on hanger lot taxiways.

The occupancy and nature of buildings within the business park is unknown at this time. Should a future occupancy require additional fire fighting capability, it can be provided by installation of onsite fire tanks and dry hydrants by the future occupant.

5.0 HYDRAULIC MODELLING

EPANET 2.0 was used to model the hydraulic network using the following design parameters:

System Requirements:

- Maximum Pressure Unserviced 690 Kpa (100 psi)
- Maximum Pressure Serviced Areas 552 Kpa (80psi)
- Minimum Pressure 275 Kpa (40 psi)
- Minimum Pressure (fire) 140 Kpa (20 psi)

Friction Factors:

- | Watermain Size | | C-Factor |
|----------------|---------------------|----------|
| ▪ | 100/150 mm diameter | 100 |
| ▪ | 200/250 mm diameter | 110 |
| ▪ | 300 mm diameter | 120 |

Water Supply Pressure

Peak Hour total hydraulic head is 156m at corner of Rivington St. and Carp Road⁵. Actual pressure under lower flows will be between 161m & 156m, however 156m was modelled as a conservative assumption. (No high pressure condition will exist with 161m pressure supply).

⁴ Email dated April 20, 2011, Appendix B

⁵ Email from City of Ottawa, Appendix B

5.1 EPANET Modelling Scenarios

5.1.1 Water Storage Facility Reservoir Filling

The existing Village of Carp Water Distribution Network will provide the potable water to fill the reservoir at the West Capital Airpark Water Storage Facility. The watermain from Carp to the reservoir needs to be capable of supplying maximum day flow for the all phases of the development. The distribution network from Carp to the storage facility was modelled at various flow rates in order to develop a system curve and validate that the reservoir can be filled at maximum day demand rate. Refer to Plan & Profile Drawings Carp Road (**102085-65 to 102085-68**) for location of watermain along Carp Road.

5.1.2 Maximum Day Plus Fire Flow to Residential

The West Capital Airpark Water Storage Facility will supply, peak hour, maximum day domestic demand and fire flow to the downstream residential area. Maximum day plus fire was determined to be the critical criteria for watermain sizing. The distribution network from the water storage facility to the residential area was modelled with Phase 2 maximum day demand plus fire flow [63.1L/s] at various nodes to validate the sizing of the distribution network.

5.1.3 Fire Flow to Business Park

The water distribution network between Carp and the water storage facility will provide fire flow to Business Park area. During a fire, the water pressure in the Business Park area upstream of the water storage facility will drop. The water storage facility will detect this pressure drop, close the reservoir fill valve and provide fire flows as required. The furthest hydrant in the Business Park area was modelled to validate capability of the water storage facility to meet fire demands [63.1L/s].

5.1.4 Peak Hour Flow to Residential and Business Park Area.

The water supply from Carp will be deemed non potable until tested at the water storage facility. The residential area and northern Business Park area domestic demand will therefore need to be supplied from the water storage facility. A 150mm watermain between the water storage facility and the northern Business Park area will be required to convey potable water. The 150mm watermain will only need to convey domestic demand and therefore will be sized to meet peak hour flows. Peak hour flows were modelled to determine the required watermain sizing and assist with pump selection criteria.

5.1.5 Phase 1 Water Age

The water distribution network was modelled simulating demand during the early stages of the Airpark to determine water age throughout the distribution network. Water age simulations were performed separately for:

- a) Water supply from Carp to the storage facility. Water supply from Carp to the facility was be modelled for various flow rates to approximate the age of potable water as it enters the water storage facility. The water storage facility will test, rechlorinate and recirculate potable water within the storage facility if necessary prior to distribution.
- b) Water supply from the storage facility to Phase 1 residential area. Early stages of Phase 1 were modelled to approximate minimum flow rates which will be required to maintain water quality.

5.1.6 Residential Phase 1 - Peak Hour

The water distribution network was modelled simulating demand during Phase 1 of the Airpark to determine if Phase 1 piping alone has adequate capacity to deliver peak hour flows.

5.1.7 Residential Phase 1 - Maximum Day plus Fire


The water distribution network was modelled simulating fire flow when only Phase 1 infrastructure is in place to determine if there is adequate fire flow capacity within Phase 1.

5.2 Results

5.2.1 Water Storage Reservoir Filling

A 200mm watermain is required on Carp Road to allow the storage reservoir to be filled at a maximum day flow rate of 22.6L/s while maintaining a minimum pressure of 27.5m in the distribution system. Ultimately, the reservoir can be filled at a rate of up to 35L/s with a minimum pressure of 14m. **Figure 3** shows the results of EPANET simulations for various fill rates and resultant residual pressure.

**FIGURE 3:
RESERVOIR FILL RATE vs RESIDUAL PRESSURE**

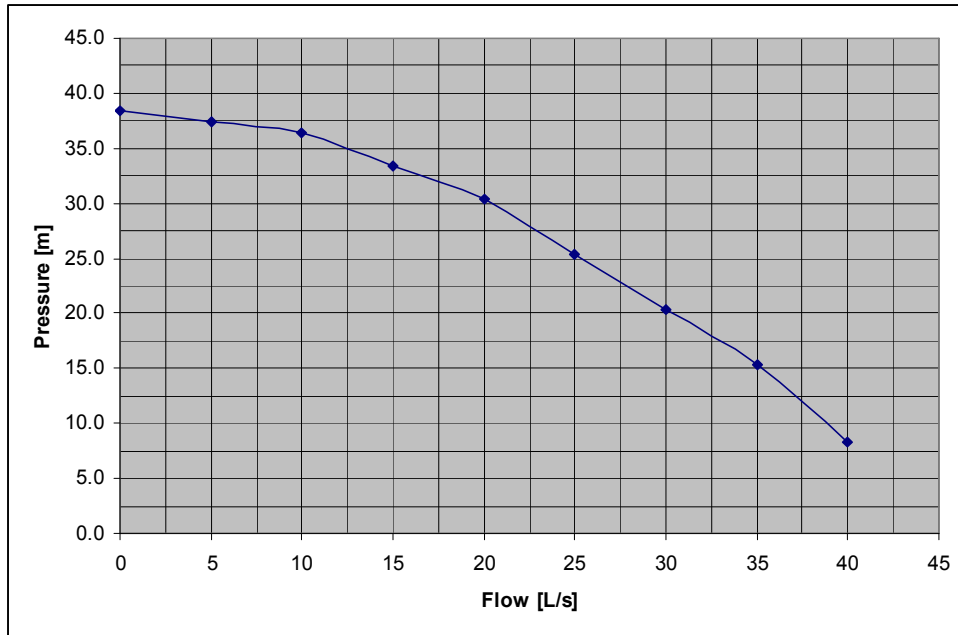

5.2.2 Maximum Day + Fire Flow

Watermain sizes downstream of the water storage facility were developed through several iterations with fire demand simulated at different node locations throughout the residential area. The following summarizes the results of these modelling iterations:

- A 300mm Watermain is required to convey fire flows from the water storage facility to the residential distribution grid.
- Watermains conveying fire flows within residential area are 200/150mm diameter.
- 50mm watermains are adequate at cul de sacs which do not convey fire flows.
- The HGL at water pump station needs to be 159m to provide the required fire flow

The Overall Watermain Layout Plan, 102085-WMOL, reflects the required watermain sizing. Details of the EPANET modelling run results can be found in **Appendix C**.

5.2.3 Fire Flow to Business Park Area

The proposed 300mm watermain network will be adequate to provide 63.09L/s to the Business Park area. Modelling results can be found in **Appendix C**.


5.2.4 Peak Hour Flow to Residential and Business Park Area

Table A-5 from **Appendix C** shows the calculated peak hour pressures at each node. The maximum pressure difference in serviced areas is 4.62psi [Nodes KK & UU]. The pump station will need to operate between a HGL of 148m & 165m. This translates to a pump head of approximately 36m [peak hour flow with 3m tank head] and 53m [zero flow with 9m tank head]. The private system can therefore operate within requirements specified in Section 5.0 and no pressure reducing valves (PRV) will be required.

5.2.5 Phase 1 Water Age

- a) **Figure 4** shows the results of modelling water age in the watermain from the meter chamber in Carp to the storage facility during various average day flow demands. A minimum daily consumption of ~0.3L/s is estimated to be required in order to meet a target age of 7 days [168hours]. This translates to the average consumption of 22 homes. Once the water supply reaches the water storage facility, it will be tested for turbidity and chlorine levels and chlorine levels will be elevated if required.

**FIGURE 4:
WATERMAIN AGE vs FLOW**

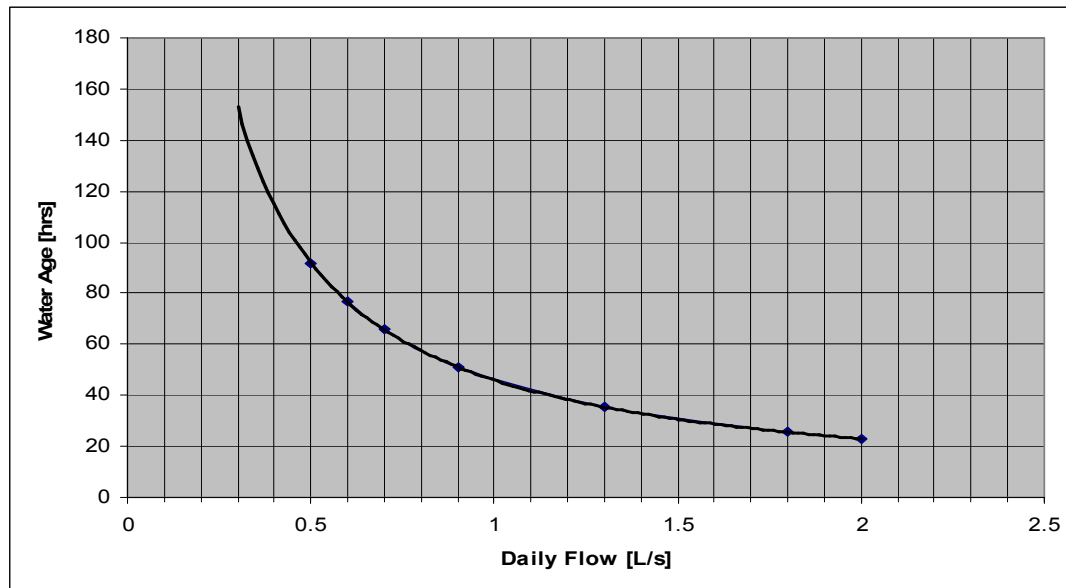

- b) The modelling results indicate that some water flushing will be required at remote sections of the water distribution network in the early stages of Phase 1. The flushing rate required will depend on the number of homes in service, but when 20 homes are in service [1,1666L/day/home] a bleed rate of 0.1L/s [8.6m³/day] will be required to keep water age below 4 days. A bleed rate of approximately 0.3L/s will be required if consumption per home is 540L/day. The actual flushing rate is expected to be lower than 0.1L/s should a water age of up to 7 days be acceptable. The water bleeding will be installed near Node Z and will consist of an external flushing unit with air gap to sanitary drain. The bleed rate can be tested at any time by inserting a 1L container in the flowpath and recording the amount of time it takes to fill. Please refer to **Appendix C** for EPANET modelling details.

5.2.6 Residential Phase 1 - Peak Hour

Table A-7 from **Appendix C** shows the calculated peak hour pressures at each node. The minimum pressure in serviced areas is above 40psi.

5.2.7 Residential Phase 1 - Maximum Day plus Fire

Table A-8 from **Appendix C** shows the calculated maximum day plus fire pressures at each node. The minimum pressure in serviced are above 20psi.

5.3 Water Storage Facility

The proposed water storage facility will include two at grade reservoirs, water quality monitoring, chlorine boosting station and high lift pumps as indicated on Water Storage Facility Process drawing (**102085-W1**). The proposed water reservoir will be phased with Reservoir #1 commissioned in Phase 1 and Reservoir #2, which will be commissioned when maximum day demands exceed 446m³/day. High lift pumps will be sized to meet peak hour and fire flow demands. Drawings of the water storage facility and typical above grade tank are included in this report.

Table 2 shows the required storage volumes based on a fire flow of 63.08L/s for 30minutes and M.O.E. criteria:

TABLE 2:

WATER STORAGE REQUIREMENTS

Item	Phase 1		Total All Phases	
Fire Flow	63.09	L/s	63.09	L/s
Fire Duration	0.5	Hrs	0.5	Hrs
Fire Storage	113,562	L	113,562	L
Equalization Storage[25%MaxDay]	108,075	L	360,700	L
Emergency Storage = 25% x [Fire Storage + Max Day storage]	55,409	L	118,566	L
Total Storage	277,046	L	592,828	L

6.0 METER CHAMBER AT CARP

The transition from City of Ottawa watermain to private communal distribution network will occur just downstream of the isolation valve near the connection point in Carp as shown on Drawings **102085-P65** and **102085-D7**. The metering chamber will include a flow meter and backflow preventer to protect the City of Ottawa distribution network from any potential downstream contamination. The proposed meter and backflow preventers are sized for maximum day demand. The City of Ottawa flow meter, will include an above grade remote panel to allow downloading of meter readings. The meter chamber includes a bypass which allows circumvention of the flow meter and is normally closed. Details of the proposed meter, backflow preventer and metering chamber can be found in the water distribution drawings (**102085-W1, 102085-W1.1**) and product data sheets (**Appendix D**) included in this report.

7.0 CONCLUSIONS

The proposed private communal water distribution infrastructure for the West Capital Airpark has been designed to meet domestic demand and fire flow conditions. The private communal water distribution system will form part of a common elements condominium that will be established for this development. The common elements condominium will own, operate and maintain the water system. The meter chamber near the connection point at Carp will monitor water consumption for billing purposes. All downstream components will be operated and maintained by common elements condominium. The proposed private communal water distribution infrastructure includes:

- A meter chamber and backflow preventer at the connection point in Carp to meter water usage.
- A 200mm private communal watermain from existing distribution network at Carp Road and Rivington Street running along the shoulder of Carp Road.
- A private communal Water Storage Facility with rechlorination and high lift pumping, and two at grade Storage Reservoirs.
- A private communal watermain network to service residential and Business Park areas.
- A private communal water flushing station located at Phase 1 residential area to ensure water quality during early stage of the development when there may be low potable water consumption.
- Phase 1 infrastructure is adequate to meet peak hour and fire flow requirements with no further infrastructure in place.

Prepared by:

NOVATECH



Carl Sciuk, P. Eng.
Senior Project Manager

Appendix A

Draft Conditions

RECEIVED MAY 29 2014



File No.: D07-16-13-0012

May 26, 2014

Adam Thompson
Novatech Engineering Consultants Ltd.
240 Michael Cowpland Dr. Suite 200
Ottawa ON K2M 1P6

Dear Mr. Thompson:

**RE: 1500 Thomas Argue Road
West Capital Developments
Draft Plan of Subdivision (Parent File # D07-16-05-0035)
City of Ottawa**

Further to our letter dated November 1, 2013, please be advised that the City's draft approval for the West Capital Developments, Carp Airport Subdivision at 1500 Thomas Argue Road, which would have lapsed on May 31, 2014, has been extended to November 16, 2016.

If a further extension to the City's draft approval is required, it is your responsibility to advise the Planning and Growth Management Department of your interest, complete the City's application form and satisfy all of the submission requirements for a further extension. **Please note that the City cannot extend draft approval if the draft approval period has lapsed.**

A copy of the conditions is attached for your information.

By copy of this letter and the draft approval conditions, the City is notifying those public bodies and agencies who requested draft approval conditions that the draft approval conditions associated with Draft Plan of Subdivision (File No. D07-16-13-0012) have been revised. You should contact the relevant agencies to secure the clearance letters that will allow City staff to register one or more phases of the Draft Plan of Subdivision

When you are preparing to have the Draft 4-M Plan approved for registration, please provide me with electronic copies of the Draft 4-M Plan – PDF and AutoCAD versions, along with five white paper prints, which include the approved street names for all new roadways. Please also provide a completed "Proposed Land Use" table (attached) for the phases to be registered and a request to prepare a subdivision agreement. A copy of the document "Estimate of Costs" has also been provided for your review. Owners are required to pay engineering design, review and inspection fees, and submit securities, which are based upon the cost estimates of the hard and soft services related to their development. The "Estimate of Costs" provides information on how to submit the quantity estimates online and provides a list of the City's current costing. Quantity estimates are required to be submitted prior to the preparation of a subdivision agreement.

*Shaping our future together
Ensemble, formons notre avenir*

City of Ottawa
Planning Growth Management Department
110 Laurier Avenue West
Ottawa ON K1P 1J1
Tel : (613) 580-2400
Fax : (613) 580-2576
www.ottawa.ca

Ville d'Ottawa
Service de l'urbanisme et de la gestion de la croissance
110, avenue Laurier Ouest
Ottawa ON K1P 1J1
Tél : (613) 580-2400
Fac : (613) 580-2576
www.ottawa.ca


Attached for your information is a one-page summary of the information required to facilitate the completion of the subdivision agreement. If you would like to meet with representatives of either this Department or Legal Services to review or clarify these requirements, please contact the undersigned at 613-580-2424, extension 31329.

When the Final (4-M) Plan is being submitted for registration, please forward to me, the original mylar of this plan, three duplicates mylars and one white paper print with the surveyor's embossed decal. If the final plan complies with the draft approval conditions and the City of Ottawa has received assurances from the interested agencies that the necessary arrangements have been made to clear all the draft approval conditions, the Planning and Growth Management Department, General Manager's signature will be endorsed on the above-noted plans which will then be sent to the local Land Titles Registry for registration, along with the necessary copies required under the *Land Titles Act*. (Please note that it is the Owner's responsibility to secure the required clearances).

If you wish to make a major revision to this plan prior to registration, please submit a revised full size mylar, an 8.5" x 14" cronaflex reduction of same and twenty-five folded paper prints, the fee (if required) and a revised "Proposed Land Use Table" (attached).

Should Draft Plan **D07-16-13-0012** not receive final approval within three years of the date on which draft approval came into effect, the draft approval will lapse pursuant to Section 51(32) of the *Planning Act*. Draft approval may be extended by the City in accordance with Section 51(33) of the *Planning Act, 1990*, provided that the applicant applies for a further extension, as previously stated, prior to the lapsing date.

Yours truly,

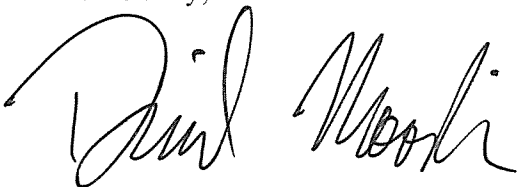A handwritten signature in black ink, appearing to read "Derrick Moodie". The signature is fluid and cursive, with the first name being more prominent.

Derrick Moodie
Manager, Development Review (Rural)
Planning and Growth Management

c.c.: Norma McConnell, City of Ottawa Legal Services Branch
Councillor Eli El Chantiry Ward Councillor
Gordon MacNair REPDO

CONDITIONS FOR FINAL APPROVAL
WEST CAPITAL DEVELOPMENTS
CARP AIRPORT SUBDIVISION

DRAFT APPROVED AUG 16, 2007

DRAFT APPROVAL EXTENDED FROM AUG. 16, 2010 TO NOV. 16, 2010

DRAFT APPROVAL EXTENDED FROM NOV. 16, 2010 TO NOV.16, 2013

DRAFT APPROVAL EXTENDED FROM NOV. 16, 2013 TO MAY 31, 2014

DRAFT APPROVAL EXTENDED FROM MAY 31, 2014 TO NOV. 16, 2016

The City of Ottawa's conditions applying to the approval of the final plan for registration of West Capital Developments Carp Airport Subdivision (File No. D07-16-13-0012) are as follows:

Agency
to Clear

General

1. This approval applies to the draft plan certified by, David W. Woodland, Ontario Land Surveyor, dated December, 2005, revised March 2007 (Sheet 1 and 2) showing 270 single detached lots, 4 townhouse blocks, 3 park blocks, 4 stormwater pond blocks, 9 industrial blocks, 3 conservation blocks, walkways blocks, taxiway blocks, street blocks and blocks for general aviation airport.
2. The Owner agrees, by entering into subdivision agreements, to satisfy all requirements, financial and otherwise, of the City of Ottawa, including but not limited to, the provision of roads, installation of services and utilities, and drainage in accordance with City or Ministry of Environment Standards and Specifications all to the satisfaction of the City. **OTTAWA (Planning)**
3. Any residential blocks on the final plan shall be configured to ensure that there will generally be no more than 25 units per block. **OTTAWA (Planning)**
4. That the Owner acknowledges and agrees that all reports and/or studies required as a result of the approval of the Plan of Subdivision shall be implemented to the satisfaction of the City at the sole expense of the Owner. Further, that the City may require certification by the Owner's Professional consultants that the works have been designed and **OTTAWA (Planning)**

constructed in accordance with the approved reports, studies, standards, specifications and plans to the satisfaction of the City.

5. Upon approval of the Draft Plan of Subdivision by the City, municipal and private services within the Plan of Subdivision may be installed provided appropriate approvals have been provided financial security, insurance, and a letter of indemnity are posted to the satisfaction of the City. **OTTAWA (Planning)**
6. Prior to any further division of lots or blocks, the City of Ottawa may require an additional agreement to address any new or amended conditions. **OTTAWA (Planning)**
7. The Owner acknowledges and agrees that materials used for marketing purposes shall identify the locations of all applicable collector roads, collector roads designed to transit standards, walkways, parkland, and postal lay-bys. The owner further agrees to inform all prospective purchasers of the locations identified for potential community mailboxes and any associated lay-bys. **OTTAWA (Planning)**
8. The Owner must demonstrate through a detailed phasing plan that the ratio of four (4) units per Communal Hangar will be met. The development of the communal hangars are subject to Site Plan Approval. **OTTAWA (Planning)**
9. The Owner agrees that the final design of the communal hangar blocks may require more land in order to meet the 4:1 unit/hangar ratio. If the lands for the communal hangars need to be expanded the Owner agrees that additional lands will be provided within the development area as identified in the plan of subdivision to the satisfaction of the General Manager, Planning and Growth Management. **OTTAWA (Planning)**
10. The development of Block 278 (Clubhouse) and Blocks 271-274 (Townhouse Blocks) are subject to Site Plan Approval. **OTTAWA (Planning)**
11. The Owner shall install, to the Satisfaction of the General Manager, Planning and Growth Management, appropriate signage that will discourage the public from utilising pathways which are meant for the purpose of accessing the communal hangars. **OTTAWA (Planning)**
12. The Owner acknowledges that development of Block 273 will be subject to the completion of an aggregate impact study, demonstrating to the satisfaction of the Director of Planning and Infrastructure Approvals, that development of the proposed townhouses will not have any detrimental effect on the ability to remove the sand and gravel resource from the licensed pit located adjacent to the development south **OTTAWA (Planning)**

of Block 293.

13. The Owner acknowledges that prior to registration of the plan of subdivision, the City of Ottawa shall be satisfied that the Municipal Capital Facilities Agreement (MCFA), for both the Residential and Business Park components of the development, has been signed and the development is proceeding in accordance with MCFA to the satisfaction of the director of REPDO. **OTTAWA (Planning) (REPDO)**
14. Prior to registration the Owner agrees to prepare a fire protection plan to the satisfaction of Fire Protection Services. **Ottawa (Fire Services)**

Zoning

15. Prior to registration of the plan of subdivision, the City of Ottawa shall be satisfied that the proposed plan of subdivision conforms with the applicable official plan and complies with the applicable zoning by-law approved under the requirements of the Planning Act, with all possibility of appeal to the Ontario Municipal Board exhausted. **OTTAWA (Planning)**

Schools

16. The Owner is required to inform prospective purchasers that school accommodation problems exist in the Ottawa-Carleton District School Board schools designated to serve this development and that at the present time this problem is being addressed by the utilization of portable classrooms and/or by directing students to schools outside their community. **OCDSB**

Highways/Roads

17. The design of all road cross sections, road intersections, including geometric, intersection spacing, grades, the conveyance of the necessary sight triangles and required 0.3 m reserves necessary for lot access control, shall be to the satisfaction of the City of Ottawa. The northern boulevard of Streets 6 and 15, where they abut lands owned by others, will be 12m in width, protecting existing vegetation. **OTTAWA (Planning)**
18. The Owner shall undertake any additional Traffic and Transportation studies subsequent to the Transportation Impact Study submitted with the Draft Plan of Subdivision application as required by the City in order to provide approval for future phases of development within the draft plan of subdivision. **OTTAWA (Planning)**

19. Any additional Traffic and Transportation studies shall be undertaken by a Professional Engineer with expertise in traffic analysis and shall comply with the City of Ottawa's Transportation Impact Assessment Guidelines (2006) in identifying TDM measures and analyzing traffic impacts, transit impacts, and implications for pedestrian and cyclist movements. The methodology and analysis principals shall be to the satisfaction of the City. **OTTAWA (Planning)**
20. All streets shall be named to the satisfaction of the City of Ottawa. **OTTAWA (Planning)**
21. The Owner agrees that it shall construct streets in accordance with the approved construction phasing plan. This phasing plan shall include a portion of the hangar lots, communal hangars, non hangar residential lots, and business park properties. **OTTAWA (Planning)**
22. The Owner agrees that it shall upgrade Diamondview Road at his sole cost, from the entrance to the subdivision north to March Road as part of the first phase of development to the satisfaction of the City of Ottawa. **OTTAWA (Planning)**
23. The Owner shall pay all expenses including but not limited to land acquisition, contract drawings preparation, utility relocations, advertising, road work, construction supervision, as built drawings preparation, and other engineering and administrative costs for the construction of any intersections as recommended by the approved study(s). **OTTAWA (Planning)**
24. The Owner agrees to provide access for emergency vehicles at all times by way of providing two (2) separate and distinct accesses to the Subdivision(s); one access may be temporary during construction. **OTTAWA (Planning)**
25. The Owner acknowledges and agrees that all construction traffic shall enter the site primarily from Carp Road and where required Thomas Argue Road. Diamondview Road will not be used as a construction access. The Owner further agrees to post signs at appropriate locations on Diamondview Road to indicate that the road is not a construction access route and that all construction traffic should access the subdivision lands from Carp Road (or Thomas Argue as appropriate). The Owner further acknowledges and agrees that he will repair any damage caused to Thomas Argue Road as a result of construction traffic associated with this development. **OTTAWA (Planning)**
26. The Owner shall provide temporary turnarounds for all streets terminating at the edge of any construction phase of development, prior to registration, **OTTAWA (Planning)**

to the satisfaction of the City of Ottawa.

27. The Owner shall be responsible for 100% of the cost and installation of all permanent and temporary street name signs, caution signs and traffic signs that may be required in accordance with City specifications. All signs shall be installed and located to the satisfaction of the City and installed prior to the City's acceptance of the roads within the subdivision. **OTTAWA (Planning)**
28. Prior to registration the Owner shall submit to the Ministry of Transportation for review and approval a copy of a stormwater management plan indicating the intended treatment of the calculated run off. **(MTO)**
29. Prior to registration, the Owner shall submit a copy of a traffic study addressing the impact of traffic from this development upon the Highway 417 interchange and if necessary, provide recommendations to mitigate any adverse effects. Any improvements to the interchange facility required as a result of the development will be the responsibility, financial and otherwise of the owner and will be covered by an agreement between the owner and the Ministry of Transportation. **(MTO)**

Sidewalks, Walkways, and Fencing

30. The Owner shall construct a sidewalk on one side of Street 1, Street 9, and Street 6 and provide a pedestrian link along the south side of Street 6 to connect to the park block subject to the provisions of the MCFA. **OTTAWA (Planning)**
31. The Owner shall provide a 1.5 metre high black vinyl coated chain link fence along the rear and side property lines of all lots adjacent to the conservation lands (Blocks 283 and 284) to clearly indicate property limits while minimizing vegetation damage and/or loss. The fence shall be situated within the private lots, 0.3 metres from the property line. **OTTAWA (Planning)**
32. The Owner shall submit a Streetscape Planting Plan to the satisfaction of the Director of Planning and Infrastructure Approvals, prior to registration. Such plan shall include as a minimum the provision of one tree per interior lot and two trees per exterior lot. Non-native invasive species shall not be included in the planting plan. Locally appropriate native species are preferred. The Streetscape Planting Plan approval will be subject to Transport Canada regulations. **OTTAWA (Planning)**
33. The Owner(s) agree to construct a 1.8 m wide paved pathway on all pathway blocks and to install a fence and a cedar hedge within the pathway block 0.3 metres from the property line. **OTTAWA (Planning)**
34. The Owner(s) agree to construct a 1.8 m wide paved pathway through **OTTAWA**

- Block 279 to connect Street Five and Street Six. (Planning)
35. A pathway block will be introduced between Lots 96 and 97 to connect the pathway within Block 284 (Carp Creek corridor) to Street Eight if appropriate. OTTAWA (Planning)
36. A pathway will be incorporated into the landscape design of the stormwater management block, Block 330 to connect Block 292 to the pedestrian link to one side of Street Six.. OTTAWA (Planning)
37. Appropriate security fencing (example 2.4M chain link) shall be installed by the Owner as per the MCFA. OTTAWA (Planning) (REPDO)
38. The owner shall provide environmentally appropriate pathways along the periphery of the Carp Creek corridor adjacent to residential lots. The alignment and design will be determined in consultation with Environmental Sustainability and Parks and Recreation Planning staff, confirmed in the field and be shown on the final landscaping/streetscaping plan. OTTAWA (Planning)

Land/Streetscaping

39. The Owner shall provide 15 metre landscape buffer and fencing to provide screening of the subdivision from Diamondview Road. A landscaped buffer strip with a minimum width of 7 metres and fencing shall be provided behind Lots 151 to 155 to screen the subdivision from the adjacent residence. A landscaped buffer strip with a minimum width of 12 metres and fencing shall be provided behind Lots 5 to 20 and lot 23 and along the northern boundary of the Airport Business Park from the east limit of Street 15 to the west limit of the storm water pond to screen the subdivision from the adjacent agricultural lands. OTTAWA (Planning)
40. The Owner shall provide a 12 metre landscape buffer in Block 305 to provide screening of the subdivision from Carp Road. OTTAWA (Planning)
41. The Owner acknowledges and agrees to have prepared by a qualified landscape architect such streetscaping and landscaping plans as are necessary to provide locations and details of the following; (All streetscaping and landscaping plans will be subject to Transport Canada regulations. OTTAWA (Planning)
1. Perimeter security fencing requirements
 2. Fencing and buffer landscaping along Diamondview and Carp Road
 3. Fencing along rear and side lots abutting conservation lands
 4. All asphalt pathways and associated fencing and hedging requirements

5. One tree per interior lot and two trees per exterior lot on private property (native species preferred, no non-native invasive species allowed).
6. Landscaping of entrance/gatehouse at street one and Diamondview Road
7. Trees/shrubs proposed to be preserved and/or planted to fulfill the requirement for a Final Tree Preservation and Planting Plan (only locally appropriate native species will be accepted in or adjacent to natural areas).
8. Landscaping of the stormwater management block
9. Streetscape lighting design and location.
10. Location of pathways along the periphery of the Carp Creek corridor.
11. Landscaping, buffering and signage on Blocks 309-315 to provide separation between vehicular and air traffic.
12. Fencing and buffer landscaping between lots 5 to 20, and lot 23 and the adjacent lands to the north, owned by others and will consist of native conifer tree species such as White Spruce or Norway Spruce, and will be planted with appropriate spacing to provide reasonable buffering/screening as required - but will generally be 3 rows staggered in the order of 7 feet on centre.
13. Tree preservation and screening of the boulevard of the north side of street six in the area north of Block 332. Planting will consist of native conifer tree species such as White Spruce, Norway Spruce and Sumac, and will be planted with appropriate spacing to provide reasonable buffering/screening as required.
14. Tree preservation and landscaping of the boulevard on the north side of Street 15 and in the buffer strip along the northern boundary of the Airport Business Park from the east limit of Street 15 to the west limit of the storm water pond adjacent to lands owned by others. Planting will consist of existing trees and planting of native tree and bush species such as White Spruce or Norway Spruce, Ash, Maple, Sumac, Lilac and will be planted with appropriate spacing to provide reasonable buffering/screening as required - but will generally be 3 rows staggered in the order of 7 feet on centre.
15. Conifer trees used to landscape the buffer areas adjacent to lots 5 to 20, and lot 23 and in the boulevard areas adjacent to the soccer fields will generally be nursery stock a minimum of 5ft. tall.
16. Additional landscaped screening will be provided in the 12m wide boulevard in the area of the proposed soccer fields and will consist of native conifer tree species such as White Spruce or Norway Spruce, and will be planted with appropriate spacing to provide reasonable buffering/screening as required - but will generally be 3 rows staggered in the order of 7 feet on centre.

42. The Owner agrees to have prepared by a qualified landscape architect a landscape plan for the Stormwater Management block. Proposed plantings will be subject to Transport Canada regulations and should consist of locally appropriate native species only. **OTTAWA (Planning)**

Parks

43. Blocks 285 & 332 shall be dedicated to the City for parkland purposes as per the MCFA and to the satisfaction of Parks and the Real Estate Partnership and Development Office (REPDO). The Owners shall grade areas of parkland, where necessary, to match approved adjacent grades, so as to provide a uniform, surface free of debris with sufficient topsoil and grass seed necessary to establish a clean and maintainable surface. No storage of building materials, including granular and topsoil, will be permitted on the park block. A 1.5 metre high black vinyl coated chain link fence shall be constructed along the boundary lines to the satisfaction of the Parks and Recreation Branch. **OTTAWA (REPDO) (Planning) (Parks)**
44. That the Owner acknowledges and agrees that should the dedication of Blocks 285 & 332 not fulfill the requirements of the Planning Act for the dedication of parkland, cash-in-lieu for the balance of parkland dedication will be required at the time of registration. **OTTAWA (Planning) (Parks)**
45. The Owner shall, as part of the required works, and at no cost to the City, provide storm, water, and sanitary services and hydro service to the property line of all park blocks. **OTTAWA (Planning) (Parks)**
46. That the Owner shall provide, at no cost to the City, a complete MDS I and MDS II study prior to the acceptance of Block 332 for parkland purposes. The Owner further acknowledges and agrees that should the MDS I and MDS II study conclude Block 332 is not suitable for parkland development purposes (sports fields), the Owner must re-design the draft plan of subdivision, at no Cost to the City, to provided a minimum 5.0 hectare parcel of land suitable for parkland development (sports fields). **OTTAWA (Planning) (Parks)**

Environmental Constraints

47. The Owner acknowledges and agrees that the implementation of the subdivision shall be in accordance with the recommendations found in the report “Integrated Environmental Review”, (Muncaster Environmental Planning, as Revised January, 2007). **OTTAWA (Planning)**

48. The Owner(s) shall implement the mitigation and monitoring measures stated in the report “Integrated Environmental Review”, (Muncaster Environmental Planning Inc., as Revised January, 2007) and any addendums to this report to the satisfaction of the City which include but are not limited to:
- The limits of the natural areas and buffers will be clearly delineated with silt and construction fencing prior to any grading or other site alterations;
 - Removal of woody vegetation will not occur between April 1st and August 15th to protect breeding birds (unless otherwise directed in writing by Environment Canada, Transport Canada, OR unless a breeding bird survey, conducted within 5 days of removal, indicates no breeding birds are present);
 - No in-stream works within the watercourse will occur between March 15th and June 30th;
 - Protection of trees and root system during blasting.
 - Monitoring of mitigation measures for the construction and the post-construction operation periods.
49. The Owner(s) shall prepare to the satisfaction of the City, a Conservation Handbook describing the natural attributes of the subdivision and the importance of good stewardship practices to ensure the long-term health and sustainability of Carp Creek and the retained woodlands. Topics to be discussed include but are not limited to reducing environmental impacts from common household activities, (e.g., water conservation, merits of minimizing impervious surfaces, yard waste disposal, chemical use and storage, etc.), activities specific to this subdivision (ie airplane storage) avoiding human-wildlife conflicts, and recommendations of locally appropriate native species for landscaping. The Handbook shall be distributed to all new homeowners.
50. The Owner shall provide interpretative signs for the trails within the “Carp Creek corridor” to indicate the sensitive nature of the creek and woodlands in the subdivision. The signage will indicate that motorized vehicles will not be permitted in the natural areas or passive parklands. Content and locations of signs will be to the approval of the City.
51. The Owner shall dedicate at no cost to the City Blocks 283, 284 and 333 in healthy and restored condition to the City as “conservation lands”. The Owner shall pay the land transfer tax associated with the dedication of these lands if applicable.

**OTTAWA
(Planning)**

**OTTAWA
(Planning)**

**OTTAWA
(Planning)**

**OTTAWA
(Planning)**

52. The Owner(s) shall undertake to protect all existing vegetation on site; subject to the provisions of Transport Canada; until such time as a “Detailed Tree Planting and Conservation Plan” is approved by the City and the vegetation communities and specimen trees which are to be conserved are appropriately marked with snow fencing on-site. Particular attention shall be paid to the preservation of the hedgerow within business park development blocks 300, 301 and 302. The “Detailed Tree Planting and Conservation Plan” shall be prepared by a qualified landscape architect and shall be integrated with the “Grading and Drainage Plan”, the “Integrated Environmental Review”, and the “Stormwater Site Management Plan and Erosion and Sediment Control Plan”. **OTTAWA (Planning)**
53. All proposed landscape plantings for the site shall consist of locally appropriate native species where possible. Only native species shall be planted in or adjacent to natural areas. Non-native invasive species (including but not limited to Norway Maple, Amur Maple, Black Locust, Scots Pine and all non-native Honeysuckles) shall not be included in the planting plan. **OTTAWA (Planning)**
54. At the completion of each construction phase of the development, and prior to the commencement of each subsequent construction phase, the Owner shall ensure that these conditions of approval and associated mitigation measures as described in the IER have been implemented to the satisfaction of the City of Ottawa. Any necessary amendments to these conditions or mitigation measures, based on observed effectiveness or opportunities for improvement, shall be documented and approved by the City of Ottawa. **OTTAWA (Planning)**
55. The developer acknowledges that development within any watercourse or stream valley may require a Development, Interference with Wetlands, and Alteration to Shorelines and Watercourses permit (O.Reg.153/06) from Mississippi Valley Conservation prior to construction. **MVC**
56. For Carp Creek, the minimum setback to development shall be the greater of: 15m from top of bank; 30m from normal high water; a 3:1 slope up from a 15m erosion allowance from the edge of the main channel of the watercourse. These setbacks shall be shown on a Grading Plan, and can not extend into the lot limits. **OTTAWA (Planning) MVC**

57. For watercourses where fish habitat is present as described in the Integrated Environmental Review, dated January 2007, with the exception of Carp Creek, the setback to development shall be 15m from the existing top of bank. The final plan for registration shall show a block comprised of the tributary in the north-east corner and the above noted 15 m setback to be dedicated to the City for conservation purposes.

**OTTAWA
(Planning)
MVC**

58. Subject to Transport Canada rules and regulations, the non-vegetated riparian corridors are to be restored to a vegetated state per the Carp River Watershed - Subwatershed Study, Section 8.2.3.1. Within the required Tree Preservation and Planting Plan provide a planting plan for each phase of work, showing the plantings that are to be undertaken adjacent to or within each phase of development of the site.

**OTTAWA
(Planning)
MVC**

Archaeology

59. The Owner shall adhere to the procedures of the “Contingency Plan for the Protection of Archaeological Resources in Urgent Situations” as approved by the Ministry of Citizenship, Culture and Recreation in the Archaeological Resource Potential Mapping Study of the City of Ottawa.

**OTTAWA
(Planning)**

Geotechnical

60. The Owner shall submit a geotechnical report prepared by a qualified Geotechnical Engineer, licensed in the Province of Ontario, containing detailed information on Geotechnical matters and recommendations pertaining to, but not limited to the following:

**OTTAWA
(Planning)**

- the existing sub-surface soils and groundwater conditions,
- slope stability and erosion protection, in addition to any building construction requirements adjacent to unstable slopes,
- design and construction of underground services,
- design and construction of internal roadways,
- design and construction of any retaining walls or slope protection,
- design and construction of engineered fill,
- design and construction of building foundations, and
- site dewatering

61. The Owner shall retain the services of the previously referred to Geotechnical Engineer to ensure that the recommendations of the report are fully implemented. The owner shall provide the Director, Infrastructure Services, with certificates of compliance issued by the engineer with respect to each of the matters referred to in the preceding condition. **OTTAWA (Planning)**

Stormwater Management

62. Prior to the commencement of any construction phase of this subdivision (roads, utilities, any off site work, etc.) the owner shall: **OTTAWA (Planning)**
- have an Erosion and Sediment Control Plan prepared by a Professional Engineer in accordance with Current Best Management Practices,
 - have such a plan approved by the City of Ottawa, and
 - provide certification to the City of Ottawa through a Professional Engineer that the plan has been implemented.
63. Prior to registration, or prior to an application for a Certificate of Approval for any stormwater works (whichever comes first), the Owner shall prepare a Stormwater Site Management Plan in accordance with the details of the report Conceptual Stormwater Management Plan (revised February 2007, Novatech Engineering) and any addendums to this report to the satisfaction of the City. The Stormwater Site Management Plan shall identify the sequence of its implementation in relation to the construction of the subdivision and shall be to the satisfaction of the City of Ottawa and the Mississippi Valley Conservation Authority. **OTTAWA (Planning) MVC**
64. On completion of all stormwater works, the Owner agrees to provide certification to the City of Ottawa through a Professional Engineer that all measures have been implemented in conformity with the Stormwater Site Management Plan. **OTTAWA (Planning)**
65. That the Owner acknowledges and agrees that no work shall commence within any construction phase of the Plan of Subdivision until such time as the storm water management measures and plan to implement the measures has been approved by the City and any other approval agency. **OTTAWA (Planning)**
66. The owner shall monitor water quality (including temperature) of the stormwater facility per the Ministry of Environment Certificate of Approval requirements and as outlined in the Stormwater Site Management Plan to the satisfaction of the City of Ottawa and the Mississippi Valley Conservation Authority as required. The monitoring **OTTAWA (Planning) MVC**

strategy should incorporate details of location of the sampling, type of sampling, frequency and a parameter list consistent with the needs of the receiving aquatic environment. Tests shall be completed by an independent and approved laboratory and the results shall be made available in an approved format and timing acceptable to the City of Ottawa and Mississippi Valley Conservation Authority as required.

67. The Owner shall design, and construct the stormwater management facility(s) at its sole cost. The Owner agrees that the stormwater management ponds will be, maintained and operated by the city per the Municipal Capital Facilities Agreement. The storm sewer system will be maintained and operated by the city per the Municipal Capital Facilities Agreement. Private underground services and other utilities will be located outside the travelled portion of the road. The cross-section for the roadways will be designed to the satisfaction of the Director of Planning and Infrastructure Approvals. **OTTAWA (Planning)**
68. The Owner agrees to undertake testing of all existing wells in an area of influence from the development to establish a baseline for existing water quality and quantity for each well. The testing and recommendations will be provided by a professional engineer with expertise in this area. Testing will take place before, during and after the completion of each phase of development. The Owner also agrees that if results indicate a negative impact on the well due this development , then the Owner agrees to take required steps to provide the impacted landowner with water quality and quantity of equal or greater quality and quantity. Copies of the results of all testing will be provided to the City. **OTTAWA (Planning)**
69. That the Owner agrees to grade, landscape and install erosion control measures on any portion of the proposed lots or adjacent lands in the possession of the Owner which have been filled or where the natural vegetation has been disturbed which, in the opinion of the City, is creating a nuisance, hazard and/or eyesore. **OTTAWA (Planning) MVC**
70. The stormwater outlet(s) shall be designed and constructed to ensure minimal amount of disturbance to Carp Creek. The mitigation measures should be clearly documented in the Stormwater Site Management Plan to be prepared for the subdivision. **OTTAWA (Planning) MVC**
71. The targets set in the Carp River Watershed - Subwatershed Study for Aquatic Habitat (Table 8.2.2) for Type 2 Fish Communities shall be met for Carp Creek and the south-east tributary of the Carp River (up stream of the Carp Road ditch), including 25C maximum water temperature. The targets for Type 3 Fish Communities shall be met for the north-east tributary of the Carp River, including 30C maximum water temperature. In addition, discharge to any of the stream corridors **OTTAWA (Planning) MVC**

requires 70% TSS removal, per MOE Stormwater Management Planning and Design Manual. Pre-development flow rates off of the site shall not be exceeded by post-development flow rates. A detailed Stormwater Management Plan, including the design and expected performance of all required stormwater management facilities, shall be provided for approval.

Fisheries

72. Wording shall be included in the subdivision agreement and in all offers of purchase and sale for Lots adjacent to watercourses informing the owners that the purpose of the setbacks is to protect fish habitat and that the natural vegetation within the setback be retained. **OTTAWA (Planning)**
73. The developer acknowledges that Carp Creek and the tributary to the Carp River in the north east of the property and the tributary to the Carp River in the south west corner of the property are fish habitat. As such, any Harmful Alteration, Disturbance, or Destruction of Fish Habitat will require an Authorization from the Department of Fisheries and Oceans. This would include, but is not limited to, culvert placement, open cut service crossings, and channel realignment. **MVC**
74. Any modifications required to the subdivision design and/or layout will be at the sole expense of the proponent. **OTTAWA (Planning) MVC**

Urban Servicing

75. The Owner shall prepare a development phasing and a construction phasing plan to the satisfaction of the General Manager, Planning and Growth Management. These phasing plans shall also set out appropriate phasing for water, sanitary and stormwater facilities. **OTTAWA (Planning)**
76. The Owner shall be responsible for the provisions of the following private services, at its cost, to the satisfaction of the City, and/or the Province; **OTTAWA (Planning)**
1. Watermains
 2. Sanitary Sewers
 3. Storm Sewers
 4. Roads
 5. Street Lights
 6. Sidewalks
 7. Landscaping
 8. Street name, traffic and caution signs
 9. Stormwater management facilities
 10. Pump Station (water servicing)
 11. Sanitary Treatment Facility

77. The Owner shall, prior to connecting additional businesses to the existing low volume non-residential water supply, submit an Existing Conditions Assessment Report to the satisfaction of the General Manager, Planning and Growth Management. **OTTAWA (Planning)**
78. The Owner shall, prior to providing new services to businesses on the Airport Lands currently using existing privately-owned sanitary services and/or the low volume non-residential water supply, submit a Decommissioning Plan for the existing services of that business to the satisfaction of the General Manager, Planning and Growth Management. **OTTAWA (Planning)**
79. The Owner shall submit detailed servicing plans, prepared by a Civil Engineer licensed in the Province of Ontario, to the Director of Planning and Infrastructure Approvals. All servicing designs will be to the satisfaction of the Director of Planning and Infrastructure Approvals. **OTTAWA (Planning)**
80. The Owner shall submit detailed grading and drainage plans for this subdivision, prepared by a Civil Engineer licensed in the Province of Ontario, to the Director of Planning and Infrastructure Approvals. **OTTAWA (Planning)**
81. The Owner shall have competent professional engineering inspection personnel on site at all times during the period of construction to supervise the Works and the Director, Infrastructure Services shall have the right at all times to inspect the installation of the Works. Should it be found in the sole opinion of the Director, Infrastructure Services that such personnel are not on site or are incompetent in the performance of their duties, or that the said Works are not being carried out in accordance with approved plans or specifications and in accordance with good engineering practice, then the Director, Infrastructure Services may order all work in the project to be stopped. **OTTAWA (Planning)**
82. The Owner shall obtain such permits as may be required from Municipal, or Provincial authorities and shall file copies thereof with the Director of Planning and Infrastructure Approvals. **OTTAWA (Planning)**
83. The Owner shall prepare, entirely at his cost, a hydraulic network analysis of the proposed water plant within the plan of subdivision and as it relates to the existing infrastructure. Said report shall be submitted to the City of Ottawa for review and approval as part of the water plant design submission. **OTTAWA (Planning)**
84. The Owner shall prepare a design report that reflects the phasing of water needs and the impact on the Carp Village Water Plant. The design **OTTAWA (Planning)**

of the water service along Carp Road must be consistent with this design report. This design must be prepared to the satisfaction of the Director of Planning and Infrastructure Approvals. Capacity beyond Phase 1 is subject to the approval of the Director of Planning and Infrastructure Approvals and the Director of Planning, Environment and Infrastructure Policy Branch.

85. The Owner acknowledges and agrees If the Carp Airport development is to be served by a communal water system utilizing the water supply system in the Village of Carp as a source, then the communal water system will include the watermain from the Village to the limit of the Carp Airport as part of the MCFA for the Airport or under such other agreement as the City may require. **OTTAWA (Planning)**
86. The Owner shall enter into a Responsibility Agreement for operation and maintenance of the Sanitary Treatment Facility, and Water treatment and/or Pump Station. **OTTAWA (Planning)**
87. The plan shall be revised to include a block for the sanitary treatment facility once the land requirements are known. **OTTAWA (Planning)**

Building Permits

88. The Owner shall not demand of the City to issue, nor shall anyone claiming title from it or under its authority, demand of the City to issue, one or more building permits to construct any building or other structure on any lot or block on the Site until: **OTTAWA (Planning)**
- applicable roads in the Subdivision have been connected to a public street;
 - the Municipal Capital Facilities Agreement (MCFA) and a Responsibility Agreement for both the Residential and Business Park components of the Development has been signed and the Development is proceeding in accordance with the MCFA and Responsibility Agreement;
 - a fire protection plan has been approved by Fire Protection Services and access for fire fighting equipment has been provided to each building by means of a street or private roadway, which shall be designated and posted to the satisfaction of the General Manager, Planning and Growth Management and the Emergency and Protective Services Department;
 - the access route has been surfaced with concrete, asphalt, or Granular "A" base capable of permitting accessibility under all climatic conditions and is continuously maintained so as to be immediately ready for use by the Emergency and

Protective Services Department vehicles or any other vehicles in the event of an emergency;

- the City has approved, where applicable, a site plan, a grading plan and a design plan for the proposed building or structure and;
- the water distribution system has received all applicable Certificates of Approval from MOE;
- the Sanitary Waste Treatment Facility has received all applicable Certificates of Approval from MOE;
- Storm Water Management Pond has received all applicable Certificates of Approval from MOE;
- a development phasing plan and a construction phasing plan have been approved by the Director of Planning and Infrastructure approvals and securities consistent with the phasing plan have been posted with the City of Ottawa to the satisfaction of the Director of Planning and Infrastructure approvals.

Utilities

89. Such easements and maintenance agreements which may be required for electrical, gas, water, sewer, telephone and cablevision facilities, shall be provided and agreed to by the Owner, to the satisfaction of the appropriate authority; and that the Owner shall ensure that these easement documents are registered on title immediately following registration of the final plan; and the affected agencies are duly notified.
- Rogers Cable
TV, Bell
Canada,
Enbridge
Consumers
Gas, Hydro
One Networks**
90. Where the relocation or removal of any existing on-site/adjacent utility facility, including water, sewer, electrical, gas, telephone and cablevision, is required as a direct result of the development, the Owner shall pay the actual cost associated therewith to the satisfaction of the appropriate utility authority.
- Rogers Cable
TV, Bell
Canada,
Enbridge
Consumers
Gas, Hydro
One Networks**
91. The Owner shall coordinate the preparation of an overall utility distribution plan showing the location (shared or otherwise) and installation, timing and phasing of all required utilities (on-grade, below-grade or above-grade), including on-site drainage facilities and streetscaping)--such location plan shall be to the satisfaction of all affected authorities and shall consider their respective standards and specification manuals, where applicable.
- Rogers Cable
TV, Bell
Canada,
Enbridge
Consumers
Gas, Hydro
One Networks**

Purchase and Sale Agreements and Covenants on Title

92. A warning clause will be inserted into the subdivision agreement and in all offer of purchase and sale agreement, to read as follows: **OTTAWA (Planning)**
- The Purchaser acknowledges the sensitive environmental nature of Carp Creek, and adjacent woodlands , the importance of good stewardship practices to ensure the health and sustainability of these natural features and that it is the City's intent to protect the Carp Creek corridor and woodlots and leave them in a natural state for the long term.
 - The Purchaser undertakes and agrees that composters, garden plots, yard waste pile or other disturbances will not occur on City owned land.
 - The Purchaser undertakes and agrees that all roof leaders will be directed to pervious areas such as lawns to enhance ground water recharge.
 - The Purchaser acknowledges that occupancy cannot be permitted until sanitary water and storm services are in operation to the satisfaction of the City
 - The Purchasers acknowledge that the lots are located in an agricultural area and may therefore be subjected to noise, dust, odours and other activities associated with an agricultural area.
 - The Purchasers acknowledge that they are purchasing land that is part of an active airport and as owners of land in an active airport they are subject to Transport Canada rules and regulations established for the operation of the Airport and will develop, and operate and contribute to the life cycle and operational costs of the Airport as per the terms of the MCF Agreement.
 - The Purchasers acknowledge that they must enter into a Common Elements Agreement for all commonly owned components of the subdivision as described in the Common Elements Condominium Agreement. The City, through the Municipal Capital Facilities Agreement, will maintain surface facilities within the Right Of Way including and limited to the pavement, curbs, sidewalks, signage and street lights.

93. Any person who, prior to draft approval, entered into a purchase and sale agreement with respect to lots or blocks created by this subdivision, shall be permitted to withdraw from such agreement without penalty and with full refund of any deposit paid, up until the acknowledgment noted below. The owner shall provide the City of Ottawa Legal Services Branch an acknowledgment from those purchasers who signed before the plan was draft approved, that the plan had not received draft approval by the City of Ottawa. The owner agrees that the purchase and sale agreements signed prior to draft approval shall be amended to contain a clause to notify purchasers of this fact.

**OTTAWA
(Planning)
OTTAWA
(Legal)**

Financial Requirements

94. The Owner acknowledges that some of the works of the Subdivision are eligible for financial contributions from the City's Development Charge Reserve Fund pursuant to the Development Charge Bylaw. Such contributions are to be determined and agreed to by the City, prior to the commencement of the associated works or as agreed to by the City. The Owner agrees to enter into any agreements that may be required pursuant to the Development Charge Bylaw.
95. The Owner shall pay all expenses including but not limited to land acquisition, contract drawings preparation, utility relocations, advertising, road work, traffic signal lights installation, construction supervision, as built drawings preparation, and other engineering and administrative costs for the modification of the intersection(s) and installation of an additional traffic lane(s) along the affected roads as per the updated Transportation Impact Study and shall provide financial security in the amount of 100% of the cost of implementing the required works.
96. Prior to registration of the plan of subdivision, the City of Ottawa shall be satisfied that the processing fee has been paid in full.
97. Prior to registration, the Owner acknowledges and agrees that a charge to recover a contribution towards that portion of the water system in the Village of Carp that would serve the Carp Airport and not greater than the cost to service lands in the village will apply, to the satisfaction of the Director of Planning and Infrastructure Approvals.

**OTTAWA
(Planning)**

**OTTAWA
(Planning)**

**OTTAWA
(Planning)**

**OTTAWA
(Planning)**

Survey Requirements

98. The plan of subdivision shall be referenced, where possible, to the Horizontal Control Network, in accordance with the City requirements

**OTTAWA
(Surveys)**

and guidelines for referencing legal surveys.

Closing Conditions

99. The owner shall inform the purchaser after registration of each lot or block of the development charges that have been paid or which are still applicable to the lot or block. The applicable development charges shall be as stated as of the time of the conveyance of the relevant lot or block and the statement shall be provided at the time of the conveyance. The statement of the owner of the applicable development charges shall also contain the statement that the development charges are subject to changes in accordance with the *Development Charges Act, 1997* and the *Education Development Charges Act*. **OTTAWA (Legal)**
100. At any time prior to final approval of this plan for registration, the City of Ottawa may, in accordance with Section 51 (44) of the Planning Act, R.S.O. 1990, amend, delete or add to the conditions and this may include the need for amended or new studies. **OTTAWA (Legal)**
101. The City of Ottawa Subdivision Agreement shall state that the conditions run with the land and are binding on the owner's, heirs, successors and assigns. **OTTAWA (Legal)**
102. Prior to registration of the plan of subdivision, the City of Ottawa is to be satisfied that Conditions 1 to 102 have been fulfilled. **OTTAWA (Planning)**
103. If the plan of subdivision has not been registered by November 16, 2016 the draft approval shall lapse pursuant to Section 51 (32) of the Planning Act, 1990. Extensions may only be granted under the provisions of Section 51 (33) of said Planning Act prior to the lapsing date. **OTTAWA (Planning)**

Appendix B

Correspondence

Lisa Bowley

From: Hall, Kevin [Kevin.Hall@ottawa.ca]
Sent: August-07-13 11:28 AM
To: Susan Gordon
Cc: Lisa Bowley
Subject: FW: Carp Airport

Susan

Below are the comments I received on the Hydraulic Analysis. If you have any questions please give me a call.

- Provide further clarity on the extent (interim and ultimate) of the Northern Industrial Area (NIA) to be supplied with domestic water via a 100 mm watermain
- Provide consistent nomenclature and labelling of meter chambers and backflow prevention chambers on all drawings
- Figure 5 is not consistent with Drawing 102085-W1
- Pump house plan and section process plans are missing information.
- Report should clarify that maximum pressure limit is 100 psi in unserved areas, and 80 psi in served areas, as per OBC.
- The residential max day peaking factor, and the business park peaking factors in Table 1 are not in accordance with City guidelines (unless I am unaware of a recent change). Furthermore, based on the peaking factor provided in the report, the max day and peak hour rates for Phase 1 do not appear to be correct. The numbers in Table 1 should be verified and corrected where required.
- The boundary conditions provided in the report do not appear to match the City boundary conditions as provided in Appendix B.
- The water age assessment should consider "typical" per dwelling unit demand, rather than design demands. A per dwelling unit rate of 540 L/day should be considered. This implies significantly higher bleed rates than what is projected in the report.
- Provide information in main body of the report on the high lift pump sizing, design HGL, and operation under the full range of expected conditions, considering interim and ultimate conditions.
- Provide discussion in the main body of the report on the network modelling and expected levels of service as presented in Appendix C.

Kevin Hall C.E.T.

Project Manager, Infrastructure Approvals
Development Review (Rural Services)
Planning and Growth Management
Planning and Infrastructure
City of Ottawa
4th Floor, 110 Laurier Ave.
MC. 01-14

(613) 580-2424 x27824
Kevin.Hall@ottawa.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. If you are not the intended recipient, please notify me at the telephone number shown above or by return e-mail and delete this communication and any copy immediately. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Si vous avez reçu le message par erreur, veuillez m'en aviser par téléphone (au numéro précité) ou par courriel, puis supprimer sans délai la version originale de la communication ainsi que toutes ses copies. Je vous remercie de votre collaboration.

Lisa Bowley

From: Hall, Kevin [Kevin.Hall@ottawa.ca]
Sent: July-12-13 11:11 AM
To: Susan Gordon
Cc: Pete Van Grootheest; Ostafichuk, Jeffrey
Subject: Carp Airport 3rd revision
Attachments: 3rd submission July 10, 2013.doc

Susan

Attached are the engineering comments on the 3rd submission for the redevelopment of the Carp Airport. As mentioned in my voicemail Comments on the Hydraulic Analysis will still be a couple of weeks away due to vacation of the reviewer. However here are all the comments from other City departments.

If you have any questions please give me a call.

Kevin Hall C.E.T.

Project Manager, Infrastructure Approvals
Development Review (Rural Services)
Planning and Growth Management
Planning and Infrastructure
City of Ottawa
4th Floor, 110 Laurier Ave.
MC. 01-14
(613) 580-2424 x27824
Kevin.Hall@ottawa.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. If you are not the intended recipient, please notify me at the telephone number shown above or by return e-mail and delete this communication and any copy immediately. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Si vous avez reçu le message par erreur, veuillez m'en aviser par téléphone (au numéro précité) ou par courriel, puis supprimer sans délai la version originale de la communication ainsi que toutes ses copies. Je vous remercie de votre collaboration.

MEMO / NOTE DE SERVICE



To / Destinataire	Susan Gordon P.Eng. Novatech Engineering	File/N° de fichier: D07-16-10-0016
From / Expéditeur	Kevin Hall C.E.T.	
Subject / Objet	1500 Thomas Argue Road Carp Airport	Date: July 10, 2013

Susan

Below are comments on the third submission of the engineering design for the Carp Airport.

General:

1. Have the utility companies approve the non-standard cross section?
2. The street names need to be added to the drawing layout plan.

GP1:

3. The rear yard cbs that connect to the street should be cb manholes when rear yard subdrains are connected to the system. Ex cb 69 & 81.

GP2:

4. Please provide a blow up or a site plan of the sewage and water storage site.

GP7:

5. Remove hydrants fronting onto Thomas Argue Drive. They are not required.

GP9:

6. Ditch layout at Carp Road will not work well with two 90 degree bends in the ditch. Please revise the layout.

P6:

7. Provide a culvert in Wingover Private for the pathway crossing the ditch.

P8:

8. P8 and GP4 does not match for the layout of pipes and the treatment plant.
9. Sanitary forcemain is not shown on this plan.

P18:

10. There are too many alignment changes of the watermain crossing taxiway 2. Please straighten.

P19:

11. Why is there a 300mm subdrain under the ditches? What is the capture area of this drain? Subdrain doesn't continue on other drawings upstream?

P50:

12. The proposed culvert on Russ Bradley at station 50+270 needs to be 2.8mm thick if it is one that the City will be responsible for.

P52:

13. If Huisson Road is to be maintained by the City, then the two abandoned culverts need to be removed.

Servicing Report:

14. Update the sewer design sheets with the new street names.
15. Storm Pipe from MH229-237 is too close to capacity. Please increase the size.

Stormwater Report:

16. Where did the 5 and 100 year release rates come from for the business park. The 26L/s/ha is below the pre-development release rate and well below a release rate calculated using $c=0.5$ in a suburban development. Please revise or explain.
17. The stormwater reports is not clear as to if a storm pond is required in the north east corner of the business park. The report says "if require" When will that decision be known? If one will be required then it should be required in Phase one since phase one sites drain to that area.

Hydraulic Network Analysis:

18. What units need PRVs?
19. In section 6.0 it needs to be stated that the watermain is private from the connection to the City main down to the site. Not after the meter and backflow chambers.

Geotech Report:

20. Page 11 & 12 speak to permissible grade raise at the buildings, but the minimum permissible grade raise is yet to be determined. We need to know the grade raise restrictions for the roads also.
21. Show the grade raise restrictions on a plan. We need to know the areas that are restricted.
22. There are a number of areas of road that may be above the permissible grade raise. How will this be dealt with? We discourage the use of styraform blocks.

Comments on Stormwater Facilities

1. Islands or significantly raised areas are not recommended in dry ponds as they present potential areas of entrapment, please remove.
2. Place cooling trench under swale.
3. Stop log gains are not needed on inlet structures, please remove.
4. Post and rail fences are to be three rail.
5. West Facility
 - a. Please provide cross-section through pond.

- b. The access route to the vortech unit should be asphalt and extend to the maintenance holes. The remaining reinforced grassed access routes, as illustrated, are sufficient.
 - i. Is there to be access from Hawker Pvt?
 - c. Major flow route from Hawker Pvt into facility should be through a reinforced swale, in the same manner as illustrated from Wingover Pvt.
 - d. Install a second DIBC at the end of the facility over the stone drain or lower the invert of the outlet CSP to the bottom of the pond
 - e. Fully embed outlet weir into side slopes
 - i. Reinforce shoulder and fall areas with blast rock and geotextile
6. East Facility
 - a. Please provide cross-section through pond.
 - b. The access route to the vortech unit should be asphalt. The remaining reinforced grassed access routes, as illustrated, are sufficient.
 - c. Install a second DIBC at the end of the facility over the stone drain or lower the invert of the outlet CSP to the bottom of the pond
 - d. Fully embed outlet weir into side slopes
 - i. Reinforce shoulder and fall areas with blast rock and geotextile
7. Landscaping drawings were not provided
8. Clarification of administrative issues, as per previous submission, remain outstanding

Comments on Modelling:

- Overall I don't have an issue with the approach and modelling. Additional information, however, is required in the report.
- Page 19, section 4.4.4. More information on how the Major system was modelled is required. Has both static and dynamic depths been considered? Also, the report states that the 5 year flow is fully captured and that ponding occurs only during the 100 year event. Has this additional head on the ICD been considered in the 100 year event simulation? (i.e. HGL). The extent of ponding in the ROW should be shown on one of the drawings. (perhaps it is shown on a drawing, but it is not referenced in the report).
- A summary table of the depth of flow for each road segment should be provided in the report (if too large, the table can be in the appendix but referenced in the report).
- Page 20, section 4.4.5, As noted above, the capture rate should be greater during the 100 year event. Has this been accounted for in the HGL analysis. Also a summary table of the HGL vs USF should be provided. If the table is too large, then it should be included in the appendix. We should not have to hunt this information down in design spreadsheets.
- Page 24, section 5.3.3. How was the IA in SWMHYMO estimated. The City often recommends the use of the CN* method. What was used in this analysis?
- The above comments also apply to the East area and the business park area.
- Is the business park an Industrial area? If so, it will require a separate MOE approval for SWM.

If you have any questions, please call me at 580-2424 (Ext. 27824)

Sincerely,

Kevin Hall C.E.T.
Project Manager, Infrastructure Approvals
Development Review (Rural Services West)
Planning and Growth Management
Planning and Infrastructure
580-2424 ext. 27824

cc

Lisa Bowley

From: Hall, Kevin [Kevin.Hall@ottawa.ca]
Sent: Wednesday, August 22, 2012 9:47 AM
To: Susan Gordon
Subject: FW: 1500 Thomas Argue Road - Carp Airport Community - D07-16-10-0016

FYI

From: Tanner, Malcolm
Sent: July 24, 2012 12:13 PM
To: Hall, Kevin
Cc: Lecompte, Justine
Subject: 1500 Thomas Argue Road - Carp Airport Community - D07-16-10-0016

Kevin,

Comments regarding the plan/profile drawings provided for Carp Road with the proposed 200mm water main installation as follows:

1. Are the 2 chambers to be located on Rivington Street in Private or Public ownership ?
2. Where is the Remote Electronic Display mounting post to be located if the chambers are in the asphalt roadway ?
3. The deflection angles of the water main are not stated and the connection to the chamber is not acceptable at such a sharp angle and in conflict with the hydrant.
4. Municipal Approval circulation will be required once the water main design has been approved.
5. The final design should be reviewed/approved by Drinking Water Services.

A complete set of the revised drawing should be provided to me for reference.

I have cc'd Justine my comments to assist her in the preparation of the Licence of Occupation.

Malcolm

Malcolm Tanner, C.E.T.
Approvals Officer
Infrastructure Services Department
Business & Technical Services Branch
580-2424 ext. 27606
malcolm.tanner@ottawa.ca

Lisa Bowley

From: Hall, Kevin [Kevin.Hall@ottawa.ca]
Sent: Wednesday, August 22, 2012 9:48 AM
To: Susan Gordon
Subject: FW: Carp Airport - Licence of Occupation

FYI

From: Dover, Steve
Sent: August 16, 2012 12:15 PM
To: Hall, Kevin; McDonald, Shelley
Cc: Page, Danny; Tanner, Malcolm; Lecompte, Justine; Roy, Christopher; Surtees, Mark
Subject: RE: Carp Airport - Licence of Occupation

Hi Kevin,

We have reviewed the plans and provide the following:

1. The Badger turbine meter is not approved, consequently, cannot be installed. The water meter will be supplied and installed by the City at the developers expense complete with an ITRON RF Endpoint on a 6X6 post outside the meter chamber.
2. Complete a water card for this property so that we may properly size the water meter for both phase 1 & 2, Preliminary calculations indicate a 50 mm pd meter for phase 1 (0.45ML/Day) and a 75 mm turbine for phase 2 (1.46ML/Day).
3. Provide dimension for all items within the chambers.
4. The bypass valve in the meter chamber is to be sealed by City staff.
5. The throttle valve (flow control valve) is to have a valve on either side to allow for servicing/replacement. The valving must permit the servicing/replacement of the throttle valve and maintain flow and metering.
6. The delineation from City ownership to private ownership is to be the valve on the branch immediately south of the connection from the Rivington Street watermain.
7. Provide the horizontal clearance from the Rivington Street watermain and the proposed chambers. Provide the horizontal clearance from hydrant on Rivington Street to be removed and replaced from the proposed 200 mm private watermain.

Upon receipt of the completed water cards we can provide the meter sizing as well as template lengths.

Regards,

Steve Dover
Project Manager, Water Distribution
Environmental Engineering, City of Ottawa
951 Clyde Avenue, Ottawa, ON K1Z 5A6
Tel: (613) 580-2424 Ext.13613
Cell: (613) 266-3809
Fax: (613) 728-4183
e-mail: steve.dover@ottawa.ca

From: Hall, Kevin
Sent: July 25, 2012 2:19 PM
To: McDonald, Shelley
Cc: Page, Danny; Tanner, Malcolm; Lecompte, Justine; Dover, Steve
Subject: FW: Carp Airport - Licence of Occupation

Shelley

Development review has a subdivision application for the Carp Airport that is currently under review for construction. One of the unique features of the subdivision is that the site will be serviced by a private watermain connected to the Carp distribution system.

DRP needs input from the Drinking Water Services Branch regarding the layout of the pipes, valves, meter, and backflow prevention all enclosed in the two proposed chambers. Also DRP requires confirmation that the City requires that the watermain will be private from the connection point in Rivington Street down to the subdivision. I believe that there is a valve at Carp Road and Rivington Street. Would the City require another valve on Rivington Street east of the connection point.

I would appreciate a response as soon as you can since there is some pressure to move this file to completion.

Thanks

Kevin Hall C.E.T.

Project Manager, Infrastructure Approvals
Development Review (Rural Services West)
Planning and Growth Management
Planning and Infrastructure
City of Ottawa
4th Floor, 110 Laurier Ave.
MC. 01-14
(613) 580-2424 x27824
Kevin.Hall@ottawa.ca

From: Susan Gordon [mailto:s.gordon@novatech-eng.com]
Sent: July 17, 2012 10:46 AM
To: Hall, Kevin
Cc: Page, Danny; Ostafichuk, Jeffrey; Lecompte, Justine; 'jep@wcd.ca'; 'Jim McDermott'; John Riddell
Subject: Carp Airport - Licence of Occupation

Kevin,

Attached for your discussions with the legal department are a Memo (July 17, 2102) summarizing the watermain connection at Rivington and the drawings referenced in the memo, including connection details and the plan and profile drawings for the watermain on Carp Road.

Please let us know if you require prints of the drawings.

Susan M. Gordon, P.Eng.

Novatech Engineering Consultants Ltd.

Suite 200, 240 Michael Cowpland Drive

Kanata . Ontario . Canada . K2M 1P6

Tel: (613) 254-9643 x269

Fax: (613) 254-5867

Email: s.gordon@novatech-eng.com

Web: <http://www.novatech-eng.com>

'The information contained in this e-mail message is confidential and is for exclusive use of the addressee.'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. If you are not the intended recipient, please notify me at the telephone number shown above or by return e-mail and delete this communication and any copy immediately. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Si vous avez reçu le message par erreur, veuillez m'en aviser par téléphone (au numéro précité) ou par courriel, puis supprimer sans délai la version originale de la communication ainsi que toutes ses copies. Je vous remercie de votre collaboration.

Lisa Bowley

From: Hall, Kevin [Kevin.Hall@ottawa.ca]
Sent: Wednesday, April 04, 2012 11:41 AM
To: Susan Gordon
Cc: Ostafichuk, Jeffrey
Subject: Carp Airport Second Submission

Susan

Here are comments on the second submission.

Working from the original list of comments

30. Since the City will be responsible for maintain the culverts we need the thickness indicated on the table. Also all the road crossing and City maintained culverts need to be indicated on the table. Some are missing or not labelled on the drawings. The culverts need to be labelled on the GP and GR plans. It takes too long to leaf through all the plan and profile drawings to find them.

38. I still need clarification on this item. are the water pipes going to run through the sewage treatment property to get to the Water treatment site. Also the pump station/lift station has been removed from the plans?

39. If the outlet from the sewage treatment plant is the roadside ditch then the effluent will cross in the neighbours property before ending up in Carp Creek. I think this goes back to the Legal outlet questions again.

40. I still don't think it is a good idea for the water to run to the end of the taxiway and turn right and turn right again to enter the storm pond. I think it would be a good idea to put this water in the storm pipe crossing under the ditch.

46. Not labelled

50. remove the "if required" for the abandoned ditch. I think since the ditch will not be in use any more, the developer should fill it in and not leave that for a site plan issue.

56. Comment applies to the taxiway cul-de-sac also.

58. Are both watermians installed in phase 1

66. Not addressed

67. More detailed grading to be provided. Pathway cross-section?

70. Label the new ditch and provide ditch slopes. Also a note should be added that the ditch is to be filled in.

87. Not addressed

98. Not addressed. We want a blown up area of the road and how the chamber fits into it.

Additional:

1. I appreciate addressing the comments on the reports in a response letter, but we need to see the updated reports.
2. Has a release rate been established from the Hanger lots. This is needed for the future site plan design of the lots.
3. The memo addressing the stormwater management comments provided a breakdown of the C-values but on the storm drainage area plan all the areas have a c-value of 0.5. Not all areas will be the same.
4. The SWM memo does not include the driveways in the hard surface calculations. This could bump the c-value to above 0.6.
5. I have not received full comments from MVC on the first submission. I have spoken to them and I expect to receive those comments by next week.
6. The proposed pump station should be identified in the servicing report. I am not looking to do an approval on it, but there should be some technical information provided for it.

The plans have been circulated to the SWM group and I expect comments from them in a week or so.

Please give me call if there are any points that need to be discussed.

Kevin Hall C.E.T.

Project Manager, Infrastructure Approvals
Development Review (Rural Services West)
Planning and Growth Management
Planning and Infrastructure
City of Ottawa
4th Floor, 110 Laurier Ave.
MC. 01-14
(613) 580-2424 x27824
Kevin.Hall@ottawa.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. If you are not the intended recipient, please notify me at the telephone number shown above or by return e-mail and delete this communication and any copy immediately. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Si vous avez reçu le message par erreur, veuillez m'en aviser par téléphone (au numéro précité) ou par courriel, puis supprimer sans délai la version originale de la communication ainsi que toutes ses copies. Je vous remercie de votre collaboration.

M E M O R A N D U M

DATE: MARCH 8, 2012 **BY HAND**

TO: KEVIN HALL

FROM: BEN HOULE

RE: CARP AIRPORT: SERVICING DESIGN BRIEF REPORT REVISIONS

CC: JOHN PHILLIPS, JIM MCDERMOTT
NOVATECH FILE #102085
CITY OF OTTAWA FILE #D07-16-10-0016

Kevin,

Further to your comments dated January 26, 2012, the following is submitted in response to comment #6 regarding the Servicing Design Brief (dated November 24, 2011).

The following chart summarizes the components of the proposed water system, the proposed design standard, jurisdiction and whether City review will be required:

Item	Description	Proposed Design Standard	Jurisdiction	City Review Required
1.	Materials – watermain, valves, hydrants	City of Ottawa	SDWA	Yes
2.	Cover	City of Ottawa	SDWA	Yes
3.	Valve spacing	City of Ottawa	SDWA	Yes
4.	Connection at Carp, including metering	City of Ottawa	City of Ottawa SDWA	Yes
5.	Water storage and pumping facility	MOE Guidelines	SDWA	No
6.	Fire protection/Fire Storage	Per discussion w. City of Ottawa Fire Department	City of Ottawa	Yes, by Fire Dept
7.	Fire hydrant spacing	City of Ottawa	SDWA	Yes, by Fire Dept

Based on your comments, this chart replaces the chart found in the Novatech letter dated October 28, 2011, which is attached in Appendix C of the Servicing Design Brief.

NOVATECH
ENGINEERING
CONSULTANTS LTD.

Please be advised that the body of the Servicing Design Brief report dated November 24, 2011 will remain unchanged. A revised copy of the Servicing Design Brief will be submitted after the revised drawings have been approved.

Regards,



Ben Houle, E.I.T.

MEMO / NOTE DE SERVICE



To / Destinataire	Susan Gordon P.Eng. Novatech Engineering	File/N° de fichier: D07-16-10-0016
From / Expéditeur	Kevin Hall C.E.T.	
Subject / Objet	Carp Airport Comments First Submission	Date: January 26, 2012

Susan

Here are City comments on the first submission of the engineering design for the Carp Airport.

General

1. Condition 28 requires that the stormwater report be circulated to the MTO. Has this been done and have comments been received?
2. What is happening to the existing ditch running through the park?
3. Site plan approval will be required for the sewage treatment and water storage buildings.
4. The clubhouse block is continually referred to as a Park block on the engineering drawings. This needs to be revised.
5. City will need a landscaping/street scraping plan to complete the review of the engineering drawings.

Servicing Report:

6. Change section 1.6. The City will be reviewing the water design to ensure conformance with City standards.
7. Confirm the spelling of Huisson Road. Spelled different in the report (1.6 and 2.5) and in the drawings.
8. Section 3.1.2. speaks to the proposed water system. It states that the watermain ranges in size from 50mm to 200mm. I think it should read 50mm to 300mm dia.
9. Provide information on the watercourse setbacks. Any water course setback should be indicated on the engineering drawings.

Hydraulic Network Analysis:

10. Provide the water pressures in the tables in KPa and PSI for ease of review.
11. Provide a drawing of the water system with the junctions, nodes and pipe numbers shown on it. Without this the tables can't be followed and reviewed.

Geotechnical Investigation:

12. Report needs to be updated with the final grade raise restrictions. This is stated in the report.
13. The geotech engineer must sign off on the grading plan. There may not be a need for this until we are closer to approval.

14. There is no mention of slope stability in the report. There are areas beside Carp Creek that the creek is 4-5m deep.

Storm Report:

15. Section 4.2.1 Please remove or revise. These lots are small enough that the whole lot will be disturbed during construction. I don't think this statement applies to these lots. Also this statement is made for the hanger lots and should be revisited
16. Update the descriptions of the east and west community's # of houses, hanger lot and towns due to the discussions of moving the townhouse block
17. Section 4.2.5 needs to be indicated/labelled better on the engineering drawings
18. Section 5 continually refers to street eight. From what I can see street eight is in the west community
19. Section 5.2.5 will there be infiltration trenches under the ditches of all taxiways or just Echo?
20. I can't review the storm sewer design sheets since the c - values are not on the post development plan. Also as per 5.4.5.2 calculate the runoff coefficient for a typical lot in the subdivision to justify the use of 0.5 in the design sheets.

Engineering Drawings

Phasing Plan:

21. The phasing plan indicates that only the storm sewers will be installed in street 4. Other engineering drawings don't reflect this. By looking at the general plans of service and grading plans it is difficult to decipher what portions of phase 2 will be constructed in phase 1.

Layout Plan:

22. How do people get to the Communal Hanger until Phase 2 is constructed?

GP1:

23. What is the purpose of the 200mm rear yard perforated pipes? The swale is steep enough that a subdrain is not required.
24. I don't see the need for a sewer in the rear of lots 8-20. Is the ditch in Street 6 deep enough for a pipe to outlet. A swale should work here.
25. The City does not want storm sewer running through their parks as proposed from street 6 through Block 279
26. How will access be granted and constructed for the City to access SWM pond 1 in the first phase?

GP2:

27. Label the watermain servicing lots 80-95
28. Would the Condo Group like to maintain the island in front of Lots 89-95? If not then the surface treatment will be hard surfacing with possibly riverstone and maybe some small shrubs. If the condo group maintains this feature they will have more flexibility on the design.
29. Typically Cul-de-sacs have a 50mm water loop and not a dead end water stub.
30. Label the culverts with size, length, type and thickness. A road crossing culvert table may be helpful.
31. Provide % slopes on all ditches.

32. Changes to the driveway layout will be required for some of the lots in the area of lots 89-95. Driveways should not cross a projected property line into the boulevard to the curb.
33. Due to the proposed driveway the house on lot 89 may need to be flipped.

GP3:

34. What is easement 1 for? Who is the easement in favour of? Better define the limits of the easement and any other proposed easements in the subdivision.
35. Is the sanitary sewer to be installed in both phases, or just phase 1.
36. Are the taxiways connected to the residential street? If not what kind of barrier will be installed.
37. How is the hanger lot to be accessed by residents in phase 1?

GP4:

38. Water and sewer pipes going to the treatment plant and water facility are reversed.
39. Where is the proposed outlet from the sewage treatment plant?
40. Improve the ditch layout at the end of taxiway E. Maybe a ditch inlet CB should be installed where the ditch crosses the 825mm dia storm sewer.
41. Clean up the cluttered sewer information between lots 119 and 120.
42. 50mm watermain loop in cul-de-sac
43. If required by Parks provide servicing water, storm, sanitary and electrical services to the park.
44. Identify all easements of the plans

GP5:

45. Who maintains the McGee Pit ditch?
46. Label the McGee Pit ditch on the plan
47. Locate the 300mm watermain closer to the ditch to reduce any encumbrances' on future development.
48. Label Block 306
49. Remove possible future property lines from block 301 and 306
50. Label ditches to be abandoned.
51. Provide ditch slopes.
52. The proposed ditch diversions and relocation seem quite convoluted. Is it possible to merge the ditches into one?

GP6:

53. Ditch slopes
54. Improve the layout of the ditch crossing Taxiway Charlie Three.
55. Why is there only a ditch on one side of Taxiway Charlie Three?
56. Improve the layout of the ditching at the bend of Taxiway Charlie Three.
57. Would the proposed watermain be better situated in Huisson Road instead of the Taxiway? How will fire services have access to those hydrants?

GP7:

58. Shouldn't the 100mm dia watermain be 200mm? This is indicated on the plan and profile drawings also. Please confirm.

GP8:

59. It appears that the 300mm watermain along street 15 will service the future business lots and provide fire protection. Will there not be water quality concerns due to the length of time the water will be sitting in the main?
60. I know it is for a future phase but what is block 303 SWM pond supposed to service? Should block 303 be constructed as part of phase 1

Grading Plans

GR1:

61. Street 4 will need to be constructed to a certain standard to provide access to the swm pond.
62. I don't think block 278 is a park block. Please label correctly.
63. If Block 278 is not a park then I have issues with the overland flow route passing through it.
64. There is no grading information for the entrance off of Diamond view Road.

GR2:

65. Provide a more realistic house foot print and a hanger on the hanger lots.
66. Show the hanger driveways.
67. Provide grading on the pathways connecting the streets and taxiways.
68. Provide conceptual grading information on the hanger lots.

GR4:

69. Provide grading and drainage information for the park. This grading needs to tie into the elevations for Street 6.
70. What happens to the existing ditches and existing drainage in the area around the park.

GR5:

71. Remove conceptual building and non-existing property lines on blocks 306 and 301.
72. Remove the future road on block 306

GR6:

73. There appears to be two chainages on Taxiway Charlie 3. Very confusing.
74. Confirm the entrance to Helicopter Transport Services at the end of Huisson Road. There are two proposed culverts. Which one will be used.

GR9:

75. Is the proposed ditch to be constructed in Phase 1? Either way the alignment needs to be straightened.

Plan and Profile Drawings

P1:

76. Check the HGL at Lot 56. It appears to be a little close. Please confirm.

P2:

77. Indicate on the drawing what the type of fill will be used in areas where additional fill will be required over and above what is indicated in the cross-section for the road construction.
78. Also indicate the amount and type of fill over the arch culverts in relation to the recommendations of the Geotech engineer.

P7:

79. Grade raise concerns over the culvert installation.

P9:

80. Label the watermain size in street 8

P10:

81. 300mm cap is proposed for the end of the 200mm watermain.

P11:

82. I think adding a ditch inlet cb to the 825mm dia sewer would be the best for drainage in this area.

P17:

83. Label the two side streets to help orientate myself on the drawing.

P19:

84. Label the 825mm sewer in the plan view.
85. Show the 825mm sewer in the profile.
86. Is the perforated pipe in the taxiway part of the infiltration system as discussed in the stormwater report.

P20

87. Where do the ditches on Taxiway "D" outlet to?

P40

88. What is the shaded area? I assume it is the pulverized asphalt and new granular for shaping the road. Please add a note on the plan.

P50

89. Remove future road allowance. No approvals given for that in this draft plan approval.

P51:

90. Confirm the height of the hydrant. It appears to be lower than the road. I assume the back slope of the ditch is lower also.

P52:

91. Don't bend the ditch around the utility poles. Either relocate the poles or the ditch.

P53

92. Straighten the ditch to reduce future blockages or troubles.

P54

93. Ditch alignment
94. No ditch on one side of the taxiway.

P60:

95. Move the private watermain out of Thomas Argue Road and onto private property.

P63:

96. Label the back flow preventer

P65-68:

97. Label the watermain material on the drawings.
98. I may have to confirm with other City departments, but I don't think there is enough room for the connection, water meter and backflow chamber all on the north side of Carp River. I think it may be a good idea to move the chambers to the south side of the Carp River.

Notes and Tables:

99. Detail the separation distances between the water service and the septic tank. Are there any MOE requirements for this?
100. Are there any zoning setbacks for the septic tank in the front yard?

Details

D1:

101. The sanitary lateral is label as 175mm. I believe the diameter is 75mm.
102. Label the watermain in the urban x-section
103. Have these cross-section been circulated to the utilities? I want to make sure that the utilities and hydrants and street lights can all work together.
104. If this subdivision is in the Hydro Ottawa service area then the service trench and transformers will be located on private property in an easement. Will there be a need for greater setbacks for the house to ensure there is enough room for the septic tank.

D2:

105. If Taxiway C is not being constructed in phase one then I don't see the need for a cross-section on these drawings.

D5-6:

106. The creek crossing culverts on these drawings don't match with the Servicing, Grading and Plan and Profile drawings. The creek crossing drawings show one culvert where twin culverts are indicated elsewhere.

Comments from ROW Group:

1. A Municipal Approval circulation will be required for the reconstruction of Diamondview Road. (profiles P40, 41, 42)
2. A Municipal Approval circulation will be required for the water main installation in Carp Road. (profiles P65, 66, 67, 68)

3. Justification for the proposed east-to-west crossing point on Carp Road is requested.
4. A detailed drawing (possible scale of 1:100) of the water meter chambers located at Rivington Street is needed so as to determine possible impact on existing infrastructure/utilities.
5. The water main proposed to be in Thomas Argue Road should be relocated into the private property of the airport.

Comments on the Stormwater modelling review:

The report is very thorough and well presented. The modelling parameters are all in line with our guidelines, the methodology is very good and the results make sense. On page 24, table 5.5. Where do they get their allowable peak flow? It does not seem to correspond to table 5.3.

Stormwater Operations comments:

comments have been limited to perceived operation and maintenance aspect of the stormwater treatment facilities. Most comments relate to both facilities (east and west) since they are very similar in design. Comments related an aspect of a specific facility have been indicated as such.

East & West SWF:

1. Inlet(s)
 - a. Storm Sewer Inlets:
 - i. It appears standard headwall arrangements will be required
 - o OPSD railings and debris grates as required
 - ii. Additional energy dissipation of inlet flows may be required, please assess.
 - b. Inlet Swales:
 - i. Confirm swale slopes at facility
 - ii. Specify construction details
 - iii. Ensure adequate energy dissipation of inlet flows, if required
 - c. Vortech Units:
 - i. Please reduce the length of offset (5 m) from trunk SS if possible
 - ii. Ensure adequate access and suitable work area for maintenance vehicles
 - d. Major Flows
 - i. Will all major flows to facilities be through the swale inlets?
2. Outlets
 - a. Outlet Structures
 - i. Ensure weirs are fully embedded within slopes
 - ii. Reinforce slopes adjacent to weirs up to the top of grade
 - iii. Ensure adequate fall protection (railings - post & rail will suffice) where required
 - b. West Facility Outlet:
 - i. Height of the top sill of outlet weir (113.25 m) is above 1:100 year level (112.54 m).
Over-control?
 - c. East Facility Outlet :
 - i. Height of the top sill of outlet weir (112.15 m) is below 1:100 year level (112.69 m).
Under-control?
 - d. Outlet Swales
 - i. General lack of details
 - ii. Reinforce plunge area at facility outlet

- e. Outlet Swale at Creek
 - i. Ensure that swale entering the creek at a 90° angle will not cause erosion and/or modify
 - ii. Verify slope of swale at creek
 - o Reinforce swale slope at creek as required
- 3. Access
 - a. General
 - i. City will require unfettered vehicular access to vortech units and outlets
 - ii. Unsure of potential issues regarding access adjacent to runway and/or taxiway – please clarify
 - iii. Preferred access route should be dedicated to facility and away from any potential air traffic/taxiway routes
 - iv. Reinforced grassed access road will suffice
 - v. Suitable access controls may be required depending on nature of placement
- 4. Landscaping
 - a. The report references plantings within the facilities to help mitigate temperature increases. We have concerns that plantings within the facility may reduce the lifespan of the infiltration trench, require maintenance and provide a source of debris that may foul the outlets.
 - i. Please clarify
- 5. Administrative
 - a. Please advise of any issues related to City assumption of facility
 - i. Clarify timing of assumption – unclear within Subdivision Agreement (C68)
 - ii. Clarify conditions regarding assumption
 - iii. Please copy Stormwater & Municipal Drainage Unit upon receipt of Draft and Final MOE CofA documents.

Business Park:

- 1. While it is not envisioned that additional SWM facilities will be required for this stage of the development, please confirm operation/assumption status (City vs. private) of any potential SWM facilities.

If you have any questions, please call me at 580-2424 (Ext. 27824)

Sincerely,

Kevin Hall C.E.T.
Project Manager, Infrastructure Approvals
Development Review (Rural Services West)
Planning and Growth Management
Infrastructure Services and Community Sustainability

Ben Houle

From: McNaughton, Duncan [Duncan.McNaughton@ottawa.ca]
Sent: April 20, 2011 4:33 PM
To: c.sciuk@novatech-eng.com; Hutt, Paul
Cc: Susan Gordon
Subject: RE: Carp Airport Fire Flows

That is my take away from the meeting also.

*Duncan McNaughton, P.Eng
Fire Protection Engineer
Ottawa Fire Services
613-580-2424 ext. 29603
613-978-0647 (cell)*

From: Carl Sciuk [mailto:c.sciuk@novatech-eng.com]
Sent: April 20, 2011 16:06
To: Hutt, Paul; McNaughton, Duncan
Cc: 'Susan Gordon'
Subject: Carp Airport Fire Flows

Hi Paul/Duncan

Thanks again for meeting with us today. To summarize: We will utilize the 1,000usgpm for 30 minute fire flow for all buildings [residential and business/commercial], with the understanding that we will try to provide a charged non potable hydrant system [capable of delivering 1,000usgpm for 30min flow] to the business area. Our next step will be to discuss with city staff involved with water distribution approval to ensure we can put in appropriate backflow preventers to make this work & involve Paul/Duncan in discussions if we run into a roadblock.

Regards,

Carl Sciuk, P. Eng.
Senior Project Manager
.....
Novatech Engineering Consultants Ltd.
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6
Tel: (613) 254-9643
Fax: (613) 254-5867
<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

From: Carl Sciuk [mailto:c.sciuk@novatech-eng.com]
Sent: Wednesday, April 13, 2011 10:58 AM
To: 'Hutt, Paul'
Subject: RE: Carp Airport Fire Flows

Hi Paul, Great see you then. I would be happy to answer any questions beforehand.

Thanks

**Carl Sciuk, P. Eng.
Senior Project Manager**

.....
Novatech Engineering Consultants Ltd.
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6
Tel: (613) 254-9643
Fax: (613) 254-5867
<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

.....
From: Hutt, Paul [mailto:Paul.Hutt@ottawa.ca]
Sent: Wednesday, April 13, 2011 10:49 AM
To: c.sciuk@novatech-eng.com
Subject: Re: Carp Airport Fire Flows

Yes, Wednesday is the earliest. 9:00 am would work.
Thanks
Paul

From: Carl Sciuk <c.sciuk@novatech-eng.com>
To: Hutt, Paul
Sent: Wed Apr 13 10:39:17 2011
Subject: RE: Carp Airport Fire Flows

Hi Paul,
I am pretty open Mon, Tues & Wedn next week right now, so if Wednesday is earliest that works for you, it is good for me, please let me know your preferred time and I will book a room here,

Thanks,

**Carl Sciuk, P. Eng.
Senior Project Manager**

.....
Novatech Engineering Consultants Ltd.
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6
Tel: (613) 254-9643
Fax: (613) 254-5867
<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

From: Hutt, Paul [mailto:Paul.Hutt@ottawa.ca]
Sent: Wednesday, April 13, 2011 10:21 AM
To: c.sciuk@novatech-eng.com
Subject: Re: Carp Airport Fire Flows

Hi Carl

Thanks I have received your information. I was planning on inviting our Fire Engineer, but he isn't available on Friday. Would next week work? Wednesday? Please advise
Paul

----- Original Message -----

From: Carl Sciuk <c.sciuk@novatech-eng.com>
To: Hutt, Paul
Cc: 'Susan Gordon' <s.gordon@novatech-eng.com>
Sent: Wed Apr 13 09:18:19 2011
Subject: FW: Carp Airport Fire Flows

Hi Paul,

Another last minute job meeting came up Fri morning, would it be possible to move our meeting to either Fri afternoon or Thurs afternoon?

Please let me know,

Thanks,

Carl Sciuk, P. Eng.
Senior Project Manager
.....
Novatech Engineering Consultants Ltd.
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6
Tel: (613) 254-9643
Fax: (613) 254-5867

<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

-----Original Message-----

From: Carl Sciuk [mailto:c.sciuk@novatech-eng.com]
Sent: Tuesday, April 12, 2011 4:19 PM
To: 'Hutt, Paul'
Subject: RE: Carp Airport Fire Flows

Hi Paul

I have attached some information as discussed. Please feel free to give me a call as you are going through this information, I know it is a bit piecemeal and may lack info you need to provide feedback.

Thankyou,

Carl Sciuk, P. Eng.
Senior Project Manager
.....
Novatech Engineering Consultants Ltd.
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6
Tel: (613) 254-9643
Fax: (613) 254-5867

<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

-----Original Message-----
From: Hutt, Paul [<mailto:Paul.Hutt@ottawa.ca>]
Sent: Monday, April 11, 2011 11:23 AM
To: c.sciuk@novatech-eng.com
Subject: RE: Carp Airport Fire Flows

I'll see you on Friday at 9:00.
Thanks
Paul

-----Original Message-----
From: Carl Sciuk [<mailto:c.sciuk@novatech-eng.com>]
Sent: April 11, 2011 11:19
To: Hutt, Paul
Cc: 'Susan Gordon'
Subject: RE: Carp Airport Fire Flows

Thanks Paul, I will send you some information tomorrow, could we meet at our office Friday at 9am?

Carl Sciuk, P. Eng.
Senior Project Manager
.....
Novatech Engineering Consultants Ltd.
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6
Tel: (613) 254-9643
Fax: (613) 254-5867

<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

-----Original Message-----
From: Hutt, Paul [<mailto:Paul.Hutt@ottawa.ca>]
Sent: Monday, April 11, 2011 11:11 AM
To: c.sciuk@novatech-eng.com
Cc: Susan Gordon
Subject: RE: Carp Airport Fire Flows

Hi Carl
Currently I'm available on Thursday or Friday all day. If you could sent me

what you have, that would give me time to review. Thanks

-----Original Message-----

From: Carl Sciuk [mailto:c.sciuk@novatech-eng.com]

Sent: April 11, 2011 11:08

To: Hutt, Paul

Cc: 'Susan Gordon'

Subject: Carp Airport Fire Flows

Hi Paul

I am hoping to meet with you later in the week regarding fire fighting at Carp Airport as discussed last week. I could send you some preliminary information beforehand if you would like,

Please let me know what works for you,

Thanks,

Carl Sciuk, P. Eng.

Senior Project Manager

.....

Novatech Engineering Consultants Ltd.

Suite 200, 240 Michael Cowpland Drive

Ottawa, Ontario

K2M 1P6

Tel: (613) 254-9643

Fax: (613) 254-5867

<http://www.novatech-eng.com>

The information contained in this email message is confidential and is for exclusive use of the addressee.

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized.

If you are not the intended recipient, please notify me at the telephone number shown above or by return e-mail and delete this communication and any copy immediately. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite.

Si vous avez reçu le message par erreur, veuillez m'en aviser par téléphone (au numéro précité) ou par courriel, puis supprimer sans délai la version originale de la communication ainsi que toutes ses copies. Je vous remercie de votre collaboration.

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized.

If you are not the intended recipient, please notify me at the telephone

October 28, 2011

City of Ottawa
Planning and Growth Management Department
110 Laurier Avenue West
4th Floor
K1P 1J1

By E-mail

Attention: Danny Page

Dear Sir:

**Re: Carp Airport Development – Proposed Water System
City of Ottawa
Our File: 102085**

A meeting was held with the City of Ottawa on June 30, 2011 to discuss the proposed water system for the Carp Airport Development. The following provides the project background, a description of the proposed water system, a summary of the June meeting, the design standards being used and the responsibility for review.

The following drawings, presented and discussed at the meeting, are attached.

- Concept Plan 3
- Overall Watermain Layout Plan (102085-WMOL, rev.3)
- Meter and Connection Detail (102085-MC, Jun 2011)

Background

West Capital Developments, the owners of the Carp Airport lands, are proceeding towards registration of a subdivision and a common elements condominium for the property. Approval of the Draft Plan of Subdivision and Draft Plan of Condominium were granted by the City in August 2007 and were extended in November 2010.

The common elements include a communal water system which will bring water from the Village of Carp to the residential and business park areas within the development site. This City has agreed to provide maximum day flows, and has confirmed that there is currently sufficient capacity in the system to provide water for Phase 1 of the development (110 residential units and 200,000sq.ft. building area, or equivalent). Upgrades to the Carp water system proposed in the Village of Carp Class Environmental Assessment for Water and Wastewater Infrastructure Upgrade/Expansion (Stantec, May 2008) will provide sufficient water for the remainder of the development. Peak hour, fire flows and rechlorination will be provided by means of a water storage and pumping facility on site.

Under the Municipal Capital Facilities Agreement (MCFA) between the developer and the City of Ottawa, signed as a condition of purchase and sale, the common elements condominium will own, operate, monitor and maintain the following communal systems:

- sewage collection system
- sewage treatment plant
- watermain from Carp Village to site
- water storage facility and pumping facility
- water distribution system

M: 2002 102085 DATA LETTERS 2011 OCT 28 SDP-CITY REVIEW.DOC

Under the MCFA, the condominium will own but the City will maintain all other components within the right of way (road surfaces, sidewalks, curbs, streetlights, storm sewers, ditches, etc.) as well as the stormwater management ponds.

Description of the Communal Water System

The communal water system will consist of the following, as illustrated on the Overall Watermain Layout Plan:

- 200mm watermain from Rivington Street in Carp to the site, carrying maximum day flow
- Storage to provide peak hour and a fire flow of 1000gal/min for 30 minutes
- Rechlorination as required
- Distribution to the residential areas and the serviced business park via 50 to 300mm diameter watermain
- Watermain to the unserviced business park to provide fire protection with backflow preventor
- Fire hydrants

Meeting with City of Ottawa (June 30, 2011)

The following is a summary of the meeting held to discuss the preliminary water system design. Representatives from the City of Ottawa Environmental Services Department, the City of Ottawa Planning and Growth Management Department, Novatech Engineering Consultants Ltd. and the developer attended.

- Concept Plan 3 was presented to provide an overview of the development project.
- The Overall Watermain Layout Plan and the Meter and Connection Detail were discussed. The City provided suggestions on the layout plan and technical comments on the detail.
- The system will be considered a private communal facility, starting with and including the meter/connection at Carp.
- The City will provide potable water to the connection, but will take no responsibility for the potability of the water after the connection. The City stated that the MOE would consider water downstream of the metering and connection chamber non-potable until it has been tested/monitored at the proposed water storage facility.
- The City attendees had no comments on the location of the watermain along the Carp Road, as the watermain is private, however they indicated that circulation with the City Right of Ways department will be required.
- The City will not provide future locates.
- The water system will be owned, operated, monitored and maintained by the condominium, who will in turn contract operation and maintenance to IDM, a licensed operator.
- The City will review and approve the metering/connection detail.
- The system will require its own Drinking Water Works permit number under the Safe Drinking Water Act (SDWA).

Proposed Standards and Responsibility for Review

The chart below summarizes the components of the proposed water system, the proposed design standard, jurisdiction and whether City review would be required.

Item	Description	Proposed Design Standard	Jurisdiction	City Review Required
1.	Materials – watermain, valves, hydrants	City of Ottawa	SDWA	No
2.	Cover	City of Ottawa	SDWA	No
3.	Valve spacing	City of Ottawa	SDWA	No
4.	Connection at Carp, including metering	City of Ottawa	City of Ottawa SDWA	Yes
5.	Water storage and pumping facility	MOE Guidelines	SDWA	No
6.	Fire protection/Fire Storage	Per discussion w. City of Ottawa Fire Department	City of Ottawa	Yes, by Fire Dept
7.	Fire hydrant spacing	City of Ottawa	SDWA	Yes, by Fire Dept

Meter and Connection Detail:

The meter and connection detail will be forwarded to the City for review and approval to ensure that the metering system is designed to their satisfaction. Downstream of the connection will be a private system.

Fire Protection:

We met with the City of Ottawa fire department to discuss their requirements for fire protection, and they are satisfied with the proposal. The detailed design will be circulated to them for review and approval.

Safe Drinking Water Act:

The water system would be considered a regulated non-municipal drinking water system under the jurisdiction of the SDWA and would be designed in accordance with City of Ottawa or MOE standards as indicated in the chart above. Under the SDWA, the system will require written consent from the City of Ottawa and the condominium capital reserve fund would provide the financial assurance required by the SDWA. References from the SDWA are attached.

The MOE have confirmed that a Municipal Responsibility Agreement (MRA) for the communal sanitary sewage system will not be required, provided the system is owned by the Condominium Corporation and a properly funded reserve fund is established (see Minutes attached). Based on this approach, the City will be under no obligation to assume any responsibility for the sewage system, and therefore no financial assurance will be provided to the City and detailed review of the sanitary sewage system will not be completed by the City. By the same reasoning, financial assurance and detailed design review should not be required for the water system, as the Condominium Corporation, as owner, along with its reserve fund would satisfy the financial conditions that the City could impose under the SDWA.

NOVATECH
ENGINEERING
CONSULTANTS LTD.


City Review:

The City has agreed that they will not be reviewing the sanitary collection and treatment system given that it is a private, condominium owned communal system under the jurisdiction of the MOE. The same reasoning would apply with respect to review of the water system which is a private, condominium owned communal system under the jurisdiction of the SDWA

We would appreciate your concurrence of the above, and please call to discuss should you have any questions.

Yours truly,

NOVATECH ENGINEERING CONSULTANTS LTD.



Susan M. Gordon, P.Eng.
Encl.

Cc: West Capital Developments Inc.

Ben Houle

From: Leblanc, Patrick [Patrick.Leblanc@ottawa.ca]
Sent: October 19, 2007 1:36 PM
To: h.idstam@novatech-eng.com
Subject: Carp Rd. Boundary Conditions

Henrik: The following are revised boundary conditions, HGL, for hydraulic analysis at the corner of Carp and Rivington. The fireflow value applied was 6,000 lpm.

- o Max_Day + FF = 156.0 m
- o Peak_Hour = 160.0 m
- o High Pressure Check = 161.0 m

These are for current conditions and are based on computer model simulation. *Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.*

Pat Leblanc, P.Eng.

Senior Water Resources Engineer
Infrastructure Services Branch
Transportation, Utilities & Public Works
City of Ottawa
(613) 580-2424 ext. 26708
(613) 560-6068 (fax)
patrick.leblanc@ottawa.ca

-----Original Message-----

From: Crowder, Murray
Sent: October 19, 2007 12:39 PM
To: Leblanc, Patrick
Subject: FW: Carp Village Watermain

Hi Pat,

We do not conduct full flow tests on hydrants in Carp. Would you be able to provide **Henrik Idstam** with flow/pressure data for Carp Rd at rivington.

Thanks,

Murray Crowder
City of Ottawa, Water Distribution
Technical Support, Drinking Water Services
951 Clyde Avenue, Ottawa, On K1Z 5A6
Mail Code 06-65
Tel: (613) 580-2424 x 22231
Fax: (613) 728-4183
e-mail: murray.crowder@ottawa.ca

-----Original Message-----

From: Hannewyk, Joseph B
Sent: October 16,2007 8:14 PM
To: Crowder, Murray
Subject: FW: Carp Village Watermain

fyi -----Original Message-----

From: Henrik Idstam [<mailto:h.idstam@novatech-eng.com>]
Sent: 2007/10/16 10:27
To: Hannewyk, Joseph B
Subject: Carp Village Watermain

Hi Joe,

Can you please provide flow information for the following hydrants in Carp Village:

- o H064 (on Carp Road)
- o H065 (on Rivington Street)

Together with the system pressure at these locations.

Thanks,

Henrik Idstam
Senior Designer

***** <blocked::http://www.novatech-eng.com/>

Novatech Engineering Consultants Ltd.

Suite 200, 240 Michael Cowpland Drive

Kanata . Ontario . Canada . K2M 1P6

Tel: (613) 254-9643 x205

Fax: (613) 254-5867

Email: h.idstam@novatech-eng.com <blocked::mailto:h.idstam@h.idstam@novatech-eng.com>

Web: [www.novatech-eng.com](#)

[www.novatech-eng.com](#)

'This email and any files transmitted with it are confidential and intended solely for the use of the individual or entity to whom they are addressed. This email is not be copied, modified, retransmitted, or used for any other purpose except with Novatech's written authorization. If you have received this email in error please delete all copies and notify the sender. The recipient should check his email and any attachments for the presence of viruses. The company accepts no liability for any damage caused by any virus transmitted by this email.'

Pat Leblanc, P.Eng.

Senior Water Resources Engineer

Infrastructure Services Branch

Transportation, Utilities & Public Works

City of Ottawa

(613) 580-2424 ext. 26708

(613) 560-6068 (fax)

patrick.leblanc@ottawa.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. If you are not the intended recipient, please notify me at the telephone number shown

Appendix C

EPANET

- EPANET Modelling Results
- EPANET Nodes
- EPANET Network Nodes Links

MEMORANDUM

DATE: FEBRUARY 21, 2012 **BY EMAIL**

TO: KEVIN HALL

FROM: BEN HOULE

RE: CARP AIRPORT: HYDRAULIC NETWORK ANALYSIS REPORT REVISIONS

CC: JOHN PHILLIPS, JIM MCDERMOTT, SUSAN GORDON,
CARL SCIUK, ANDREW VITATERNA, RICHARD PELLERIN
NOVATECH FILE #102085
CITY OF OTTAWA FILE #D07-16-10-0016

Kevin,

Further to your comments dated January 26, 2012, the following is submitted in response to comments #10 and #11 regarding the Hydraulic Network Analysis.

Please find attached the following revised tables from Appendix A of the Hydraulic Network Analysis (dated November 21, 2011):

- Table A-2 – Scenario 1 – Supply main pressure from Carp
- Table A-3 – Scenario 2 – EPANET Results Max Day + Fire Residential
- Table A-4 – Scenario 3 – EPANET Results Fire Flow to Industrial
- Table A-5 – Scenario 4 – EPANET Results Peak Hour Flow to Industrial
- Table A-6 – Scenario 5 – Water Age

Also, please find attached the following figure from Appendix A:

- Figure A-1 – EPANET Nodes and Pipes

Please be advised that the body of the Hydraulic Network Analysis report dated November 21, 2011 remains unchanged.

Please provide your review and any changes that may be required.

Regards,



Ben Houle, E.I.T.

M:\2002\102085\DATA\MEMOS\20120221-HYDRAULIC REVISIONS.DOC

FIGURE A-1 EPANET NODES & PIPES

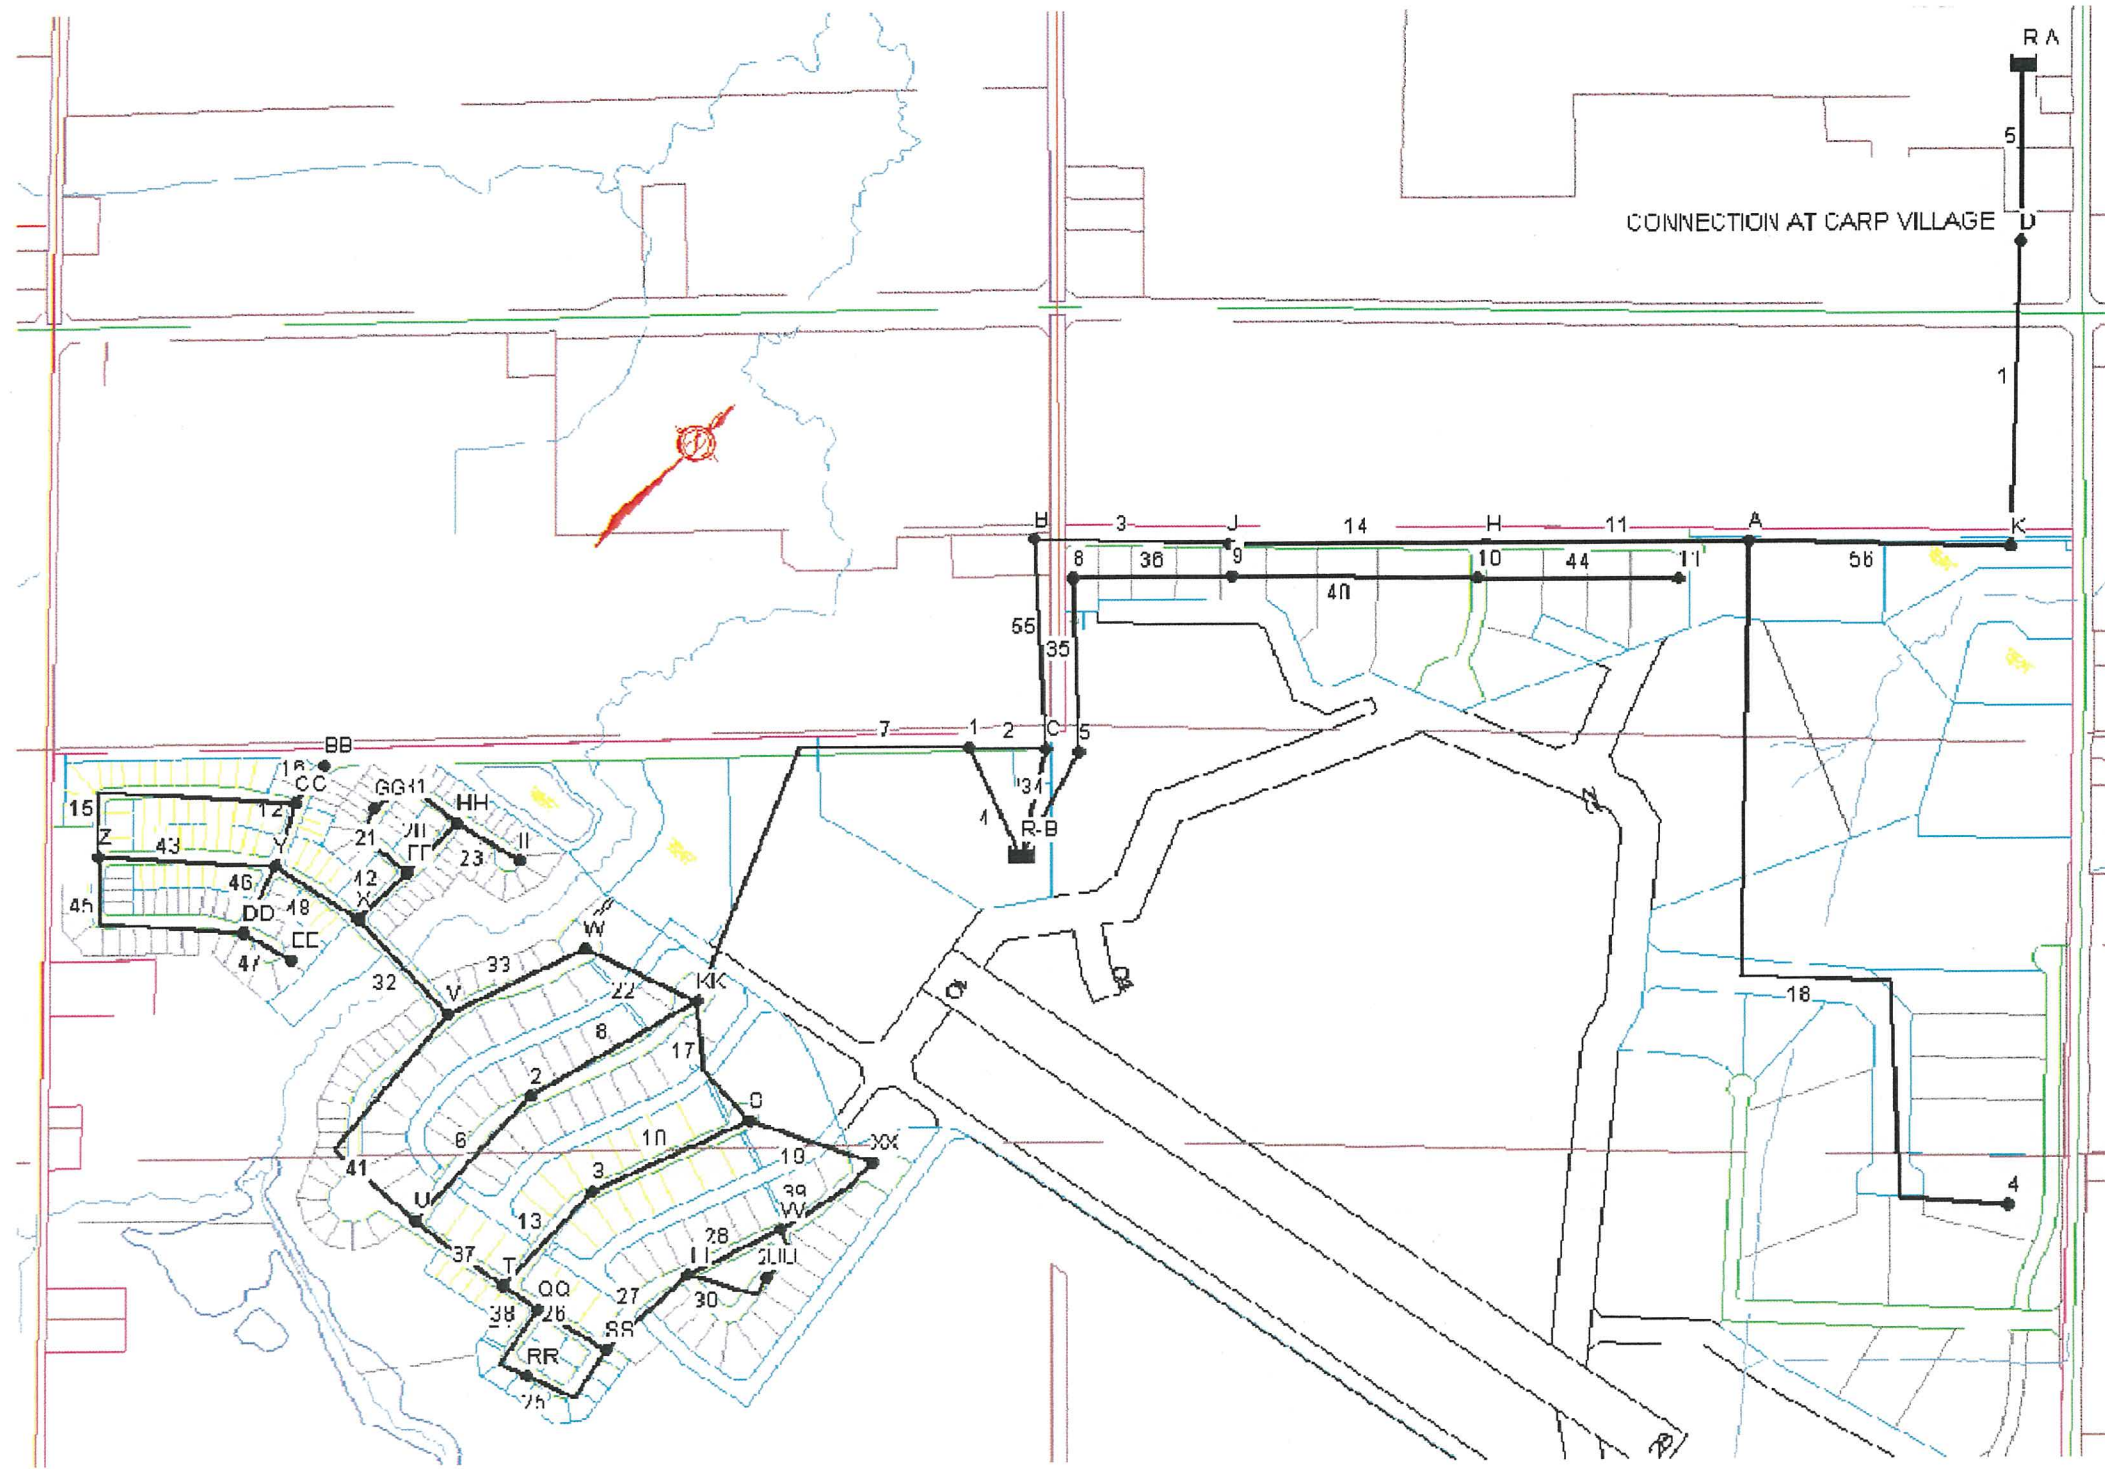


TABLE A -2
SCENARIO 1
SUPPLY MAIN PRESSURE FROM CARP

HEAD AT CARP VILLAGE CONNECTION= 156m
GRND ELEVATION AT WATER STORAGE= 112m

Epanet Flow [lps]	Epanet Elevation m	Epanet Total Head [m]	Epanet Pressure [m]	Losses at Meter Chamber ¹ [m]	Net Pressure@ Storage Facility [m]	Net Pressure@ Storage Facility [KPa]	Net Pressure@ Storage Facility [psi]
0	112	156	44	5.6	38.4	375.8	54.5
5	112	155	43	5.6	37.4	366.0	53.1
10	112	154	42	5.6	36.4	356.2	51.7
15	112	151	39	5.6	33.4	326.9	47.4
20	112	148	36	5.6	30.4	297.5	43.2
25	112	143	31	5.6	25.4	248.5	36.1
30	112	138	26	5.6	20.4	199.5	29.0
35	112	133	21	5.6	15.4	150.6	21.9
40	112	126	14	5.6	8.4	82.0	11.9

Note ¹ Includes head losses of meter and backflow preventer.

EPANET NODE OUTPUT FOR 40L/s

Node ID	Elevation [m]	Demand [lps]	Head [m]	Pressure [m]	Pressure [KPa]	Pressure [psi]
Junc D	94	0	156	62	607.2	88.1
Junc K	102	0	132.89	30.89	302.5	43.9
Junc A	106.5	0	127.69	21.19	207.5	30.1
Junc B	113	0	126.43	13.43	131.5	19.1
Junc J	110	0	126.71	16.71	163.7	23.8
Junc H	109	0	127.18	18.18	178.1	25.8
Junc C	112	40	125.98	13.98	136.9	19.9
Junc 4	106	0	127.69	21.69	212.4	30.8
Junc 5	112	0	150.32	38.32	375.3	54.5
Junc 8	113	0	150.32	37.32	365.5	53.1
Junc 9	110	0	150.32	40.32	394.9	57.3
Junc 10	109	0	150.32	41.32	404.7	58.7
Junc 11	109	0	150.32	41.32	404.7	58.7
Resvr R-A	156	-40	156	0	0.0	0.0
Resvr R-B	168	0	168	0	0.0	0.0

EPANET LINK OUTPUT FOR 40L/s

Link ID	Length [m]	Diameter [mm]	Roughness	Flow LPS	Velocity m/s	Unit Headloss m/km
Pipe 1	1998.27	200	110	40	1.27	11.56
Pipe 3	200	300	120	40	0.57	1.37
Pipe 14	350	300	120	-40	0.57	1.37
Pipe 49	450	200	110	-40	1.27	11.56
Pipe 5	1	300	150	40	0.57	0.9
Pipe 50	330	300	120	-40	0.57	1.37
Pipe 11	370	300	120	-40	0.57	1.37

**TABLE A -3
EPANET RESULTS SCENARIO 2
MAX DAY + FIRE RESIDENTIAL**

Node ID	Elevation m	Demand LPS	Head m	Pressure m	Pressure Kpa	Pressure psi
Junc S	118	0.43	153.75	35.75	350.1	50.8
Junc T	118	0.43	153.01	35.01	342.9	49.8
Junc QQ	118.5	0.43	153.04	34.54	338.3	49.1
Junc SS	118.5	0.43	153.06	34.56	338.5	49.1
Junc RR	118.5	0.43	153.05	34.55	338.4	49.1
Junc TT	118.5	0.43	153.21	34.71	340.0	49.3
Junc VV	118.5	0.43	153.26	34.76	340.4	49.4
Junc UU	118.5	0.43	153.23	34.73	340.2	49.4
Junc XX	118	0.43	153.43	35.43	347.0	50.4
Junc U	118	0.43	152.56	34.56	338.5	49.1
Junc V	116	0.43	148.1	32.1	314.4	45.6
Junc W	116	0.43	150.8	34.8	340.8	49.5
Junc X	116	0.43	141.95	25.95	254.2	36.9
Junc FF	115	0.43	141.93	26.93	263.8	38.3
Junc HH	115	0.43	141.93	26.93	263.8	38.3
Junc II	115	0.43	141.93	26.93	263.8	38.3
Junc GG	115	0.43	141.93	26.93	263.8	38.3
Junc Y	116	0.43	137.6	21.6	211.6	30.7
Junc Z	117	63.51	131.17	14.17	138.8	20.1
Junc DD	116	0.43	136.22	20.22	198.0	28.7
Junc EE	116	0.43	136.22	20.22	198.0	28.7
Junc KK	116	0.43	155.73	39.73	389.1	56.5
Junc CC	115	0.43	136.26	21.26	208.2	30.2
Junc BB	114	0.43	136.26	22.26	218.0	31.6
Junc C	112	0	159	47	460.3	66.8
Junc 1	112	0	158.96	46.96	459.9	66.8
Junc 2	118	0.43	154.02	36.02	352.8	51.2
Junc 3	118	0.43	153.58	35.58	348.5	50.6
Resvr R-B	159	-74.29	159	47	460.3	66.8

Link ID	Length m	Diameter mm	Roughnes	Flow LPS	Velocity m/s	Unit Headloss m/km
Pipe 7	750	300	120	74.29	1.05	4.3
Pipe 20	100	150	100	0.65	0.04	0.03
Pipe 21	90	150	100	0.64	0.04	0.03
Pipe 23	60	150	100	0.43	0.02	0.01
Pipe 24	100	150	100	-1.22	0.07	0.09
Pipe 25	100	150	100	-1.65	0.09	0.15
Pipe 26	110	150	100	2	0.11	0.22
Pipe 27	180	150	100	4.07	0.23	0.82
Pipe 28	130	150	100	-2.64	0.15	0.36
Pipe 29	100	150	100	2.3	0.13	0.28
Pipe 30	100	150	100	-1.87	0.11	0.19
Pipe 31	90	150	100	-0.21	0.01	0
Pipe 32	200	200	110	-67.82	2.16	30.74
Pipe 33	150	200	110	-50.8	1.62	18
Pipe 37	150	150	100	8.32	0.47	3.06
Pipe 38	60	150	100	-2.78	0.16	0.4
Pipe 39	130	150	100	-5.37	0.3	1.36
Pipe 41	370	150	100	17.45	0.99	12.05
Pipe 42	100	150	100	1.72	0.1	0.17
Pipe 43	240	150	100	26.87	1.52	26.81
Pipe 45	400	150	100	-17.9	1.01	12.64
Pipe 46	100	150	100	-18.77	1.06	13.79
Pipe 47	40	150	100	0.43	0.02	0.01
Pipe 48	150	200	110	-65.67	2.09	28.96
Pipe 12	90	150	100	-19.6	1.11	14.95
Pipe 15	370	150	100	-18.74	1.06	13.75
Pipe 16	50	150	100	0.43	0.02	0.01
Pipe 4	10	300	120	-74.29	1.05	4.3
Pipe 6	370	150	100	-9.56	0.54	3.95
Pipe 8	400	150	100	-9.99	0.57	4.29
Pipe 10	90	150	100	6.4	0.36	1.88
Pipe 13	340	150	100	-5.97	0.34	1.65
Pipe 17	300	150	100	12.63	0.71	6.63
Pipe 19	200	150	100	5.8	0.33	1.57
Pipe 22	270	200	110	-51.23	1.63	18.29

TABLE A -4
EPANET RESULTS SCENARIO 3
FIRE FLOW TO INDUSTRIAL

Node ID	Elevation m	Demand LPS	Head m	Pressure m	Pressure Kpa	Pressure psi
Junc A	106.5	0	164.01	57.51	563.3	81.8
Junc B	113	0	166.94	53.94	528.3	76.7
Junc J	110	0	166.3	56.3	551.4	80.0
Junc H	109	0	165.19	56.19	550.3	79.9
Junc C	112	0	167.98	55.98	548.3	79.6
Junc 4	106	63.1	161.66	55.66	545.1	79.1
Junc 5	112	0	150.32	38.32	375.3	54.5
Junc 8	113	0	150.32	37.32	365.5	53.1
Junc 9	110	0	150.32	40.32	394.9	57.3
Junc 10	109	0	150.32	41.32	404.7	58.7
Junc 11	109	0	150.32	41.32	404.7	58.7
Resvr R-B	168	-63.1	168	0	0.0	0.0

Link ID	Length m	Diameter mm	Roughness	Flow LPS
Pipe 3	200	300	120	-63.1
Pipe 14	350	300	120	63.1
Pipe 50	330	300	120	63.1
Pipe 9	5	300	120	-63.1
Pipe 11	370	300	120	63.1
Pipe 18	740	300	120	63.1

**TABLE A -5
EPANET RESULTS SCENARIO 4
PEAK HOUR FLOW**

Link ID	Length m	Diameter mm	Roughness	Flow LPS	Unit Headloss m/km	Status	Node ID	Elevation m	Demand LPS	Head m	Pressure m	Pressure psi
Pipe 7	750	300	120	25.74	0.6	Open	Junc S	118	0.03	146.93	28.93	41.1
Pipe 20	100	150	100	1.68	0.16	Open	Junc T	118	1.12	146.82	28.82	41.0
Pipe 21	90	150	100	1.67	0.16	Open	Junc QQ	118.5	1.12	146.77	28.27	40.2
Pipe 23	60	150	100	1.12	0.07	Open	Junc SS	118.5	1.12	146.76	28.26	40.2
Pipe 24	100	150	100	1.53	0.13	Open	Junc RR	118.5	1.12	146.76	28.26	40.2
Pipe 25	100	150	100	0.41	0.01	Open	Junc TT	118.5	1.12	146.75	28.25	40.1
Pipe 26	110	150	100	-1.52	0.13	Open	Junc VV	118.5	1.12	146.76	28.26	40.2
Pipe 27	180	150	100	-0.81	0.04	Open	Junc UU	118.5	1.12	146.75	28.25	40.1
Pipe 28	130	150	100	-0.62	0.02	Open	Junc XX	118	1.12	146.8	28.8	40.9
Pipe 29	100	150	100	0.8	0.04	Open	Junc U	118	1.12	146.91	28.91	41.1
Pipe 30	100	150	100	0.32	0.01	Open	Junc V	116	1.12	146.94	30.94	44.0
Pipe 31	90	150	100	-0.55	0.02	Open	Junc W	116	1.12	147.13	31.13	44.2
Pipe 32	200	200	110	-10.09	0.9	Open	Junc X	116	0.04	146.76	30.76	43.7
Pipe 33	150	200	110	-12.26	1.29	Open	Junc FF	115	1.12	146.66	31.66	45.0
Pipe 37	150	150	100	-3.4	0.58	Open	Junc HH	115	1.12	146.64	31.64	45.0
Pipe 38	60	150	100	4.16	0.85	Open	Junc II	115	1.12	146.64	31.64	45.0
Pipe 39	130	150	100	-2.53	0.34	Open	Junc GG	115	1.12	146.65	31.65	45.0
Pipe 41	370	150	100	-1.05	0.07	Open	Junc Y	116	1.12	146.71	30.71	43.6
Pipe 42	100	150	100	4.46	0.97	Open	Junc Z	117	0.01	146.7	29.7	42.2
Pipe 43	240	150	100	0.89	0.05	Open	Junc DD	116	1.12	146.69	30.69	43.6
Pipe 45	400	150	100	0.46	0.01	Open	Junc EE	116	1.12	146.69	30.69	43.6
Pipe 46	100	150	100	-1.77	0.17	Open	Junc KK	116	1.12	147.54	31.54	44.8
Pipe 47	40	150	100	1.12	0.07	Open	Junc CC	115	1.12	146.7	31.7	45.0
Pipe 48	150	200	110	-5.59	0.3	Open	Junc BB	114	1.12	146.69	32.69	46.5
Pipe 12	90	150	100	-1.81	0.18	Open	Junc 1	112	0	147.99	35.99	51.1
Pipe 15	370	150	100	0.42	0.01	Open	Junc 2	118	1.12	147.14	29.14	41.4
Pipe 16	50	150	100	1.12	0.07	Open	Junc 3	118	1.12	146.89	28.89	41.1
Pipe 2	1	300	120	0	0	Closed	Junc 5	112	0	147.68	35.68	50.7
Pipe 4	10	300	120	-25.74	0.6	Open	Junc 8	113	1	142.85	29.85	42.4
Pipe 6	370	150	100	-3.47	0.6	Open	Junc 9	110	9.2	139.92	29.92	42.5
Pipe 8	400	150	100	-4.58	1.01	Open	Junc 10	109	9.2	138.58	29.58	42.0
Pipe 10	90	150	100	2.99	0.46	Open	Junc 11	109	1	138.56	29.56	42.0
Pipe 13	340	150	100	-1.88	0.19	Open	Resvr R-B	112	-46.14	148	36	51.2
Pipe 17	300	150	100	6.67	2.03	Open	[Minimum Peak operating pressure is 148m]					
Pipe 19	200	150	100	3.65	0.66	Open	Maximum Operating Pressure [zero flow]					
Pipe 22	270	200	110	-13.37	1.52	Open	Resr R-B water level 121 m					
Pipe 34	20	150	100	20.4	16.1	Open	Junc 11 109 m					
Pipe 35	300	150	100	20.4	16.1	Open	Max Press Junc 11 56 m					
Pipe 36	200	150	100	19.4	14.67	Open	Max Supply Pressure 165 m [zero flow]					
Pipe 40	300	150	100	10.2	4.46	Open						
Pipe 44	300	150	100	1	0.06	Open						

**TABLE A -6
EPANET RESULTS SCENARIO 5
WATER AGE**

Reservoir Daily Fill Rate [L/s]	Water Age from Carp [hrs]
0.5	91.9
0.6	76.6
0.7	65.7
0.9	51.1
1.3	35.4
1.8	25.6
2	23

Phase 1: 20 homes @ 1,166L/day, bleeding 0.1L/s at Node Z						
Node ID	Demand LPS	Head m	Pressure m	Pressure Kpa	Pressure psi	Age hours
Junc U	0.03	168	50	489.7	71.1	94.71
Junc V	0.03	168	52	509.3	73.9	59.12
Junc W	0.03	168	52	509.3	73.9	48.88
Junc X	0	168	52	509.3	73.9	66.17
Junc Y	0.03	168	52	509.3	73.9	71.47
Junc Z	0.13	168	51	499.5	72.5	93.93
Junc DD	0	168	52	509.3	73.9	81.95
Junc KK	0.03	168	52	509.3	73.9	39.75
Junc CC	0.03	168	53	519.1	75.3	76.02
Junc BB	0.03	168	54	528.9	76.8	83.23
Junc 1	0	168	56	548.5	79.6	0.52
Junc 2	0.03	168	50	489.7	71.1	62.38

Phase 1: 20 homes @ 540L/day, bleeding 0.3L/s at Node Z						
Node ID	Demand LPS	Head m	Pressure m	Pressure Kpa	Pressure psi	Age hours
Junc U	0.01	168	50	489.7	71.1	80.12
Junc V	0.01	168	52	509.3	73.9	55.71
Junc W	0.01	168	52	509.3	73.9	42.47
Junc X	0	168	52	509.3	73.9	59.78
Junc Y	0.01	168	52	509.3	73.9	62.82
Junc Z	0.31	168	51	499.5	72.5	78.09
Junc DD	0	168	52	509.3	73.9	67.31
Junc KK	0.01	168	52	509.3	73.9	35.1
Junc CC	0.01	168	53	519.1	75.3	65.97
Junc BB	0.01	168	54	528.9	76.8	80.59
Junc 1	0	168	56	548.5	79.6	0.46
Junc 2	0.01	168	50	489.7	71.1	56.63

**TABLE A -7
EPANET RESULTS SCENARIO 6
PHASE 1 PEAK HOUR**

Node ID	Elevation m	Demand LPS	Head m	Pressure m
Junc D	94	0	156	62
Junc K	102	0	156	54
Junc A	106.5	0	156	49.5
Junc B	113	0	156	43
Junc J	110	0	156	46
Junc H	109	0	156	47
Junc S	118	0.34	167.89	49.89
Junc T	118	0	153.45	35.45
Junc QQ	118.5	0	156.55	38.05
Junc SS	118.5	0	156.55	38.05
Junc RR	118.5	0	156.55	38.05
Junc TT	118.5	0	159.64	41.14
Junc VV	118.5	0	161.71	43.21
Junc UU	118.5	0	160.68	42.18
Junc XX	118	0	164.8	46.8
Junc U	118	1.69	167.7	49.7
Junc V	116	1.69	167.71	51.71
Junc W	116	1.35	167.76	51.76
Junc X	116	0	167.68	51.68
Junc FF	115	0	167.68	52.68
Junc HH	115	0	167.68	52.68
Junc II	115	0	167.68	52.68
Junc GG	115	0	167.68	52.68
Junc Y	116	1.01	167.66	51.66
Junc Z	117	1.01	167.65	50.65
Junc DD	116	0	167.65	51.65
Junc EE	116	0	167.65	51.65
Junc KK	116	1.01	167.9	51.9
Junc CC	115	1.01	167.65	52.65
Junc BB	114	0.68	167.65	53.65
Junc C	112	0	156	44
Junc 1	112	0	168	56
Junc 2	118	1.69	167.73	49.73
Junc 3	118	0	153.45	35.45
Junc 4	106	0	156	50
Junc 5	112	0	150.32	38.32
Junc 8	113	0	150.32	37.32
Junc 9	110	0	150.32	40.32
Junc 10	109	0	150.32	41.32
Junc 11	109	0	150.32	41.32
Resvr R-A	156	0	156	0
Resvr R-B	168	-11.5	168	0

Link ID	Length m	Diameter mm	Roughness	Flow LPS	Status
Pipe 1	1998.27	200	110	0	Open
Pipe 3	200	300	120	0	Open
Pipe 14	350	300	120	0	Open
Pipe 7	750	300	120	11.5	Open
Pipe 20	100	150	100	0	Closed
Pipe 21	90	150	100	0	Closed
Pipe 23	60	150	100	0	Closed
Pipe 24	100	150	100	0	Closed
Pipe 25	100	150	100	0	Closed
Pipe 26	110	150	100	0	Open
Pipe 27	180	150	100	0	Closed
Pipe 28	130	150	100	0	Closed
Pipe 29	100	150	100	0	Closed
Pipe 30	100	150	100	0	Closed
Pipe 31	90	150	100	0	Closed
Pipe 32	200	200	110	-3.72	Open
Pipe 33	150	200	110	-5.97	Open
Pipe 37	150	150	100	0	Closed
Pipe 38	60	150	100	0	Closed
Pipe 39	130	150	100	0	Closed
Pipe 41	370	150	100	-0.56	Open
Pipe 42	100	150	100	0	Closed
Pipe 43	240	150	100	1	Open
Pipe 45	400	150	100	0	Closed
Pipe 46	100	150	100	0	Closed
Pipe 47	40	150	100	0	Closed
Pipe 48	150	200	110	-3.72	Open
Pipe 49	450	200	110	0	Open
Pipe 5	1	300	150	0	Open
Pipe 12	90	150	100	-1.7	Open
Pipe 15	370	150	100	-0.01	Open
Pipe 16	50	150	100	0.68	Open
Pipe 50	330	300	120	0	Open
Pipe 2	1	300	120	0	Closed
Pipe 4	10	300	120	-11.5	Open
Pipe 6	370	150	100	-1.13	Open
Pipe 8	400	150	100	-2.82	Open
Pipe 9	5	300	120	0	Closed
Pipe 10	90	150	100	0	Closed
Pipe 13	340	150	100	0	Open
Pipe 17	300	150	100	0.34	Open
Pipe 19	200	150	100	0	Closed
Pipe 22	270	200	110	-7.32	Open
Pipe 11	370	300	120	0	Open
Pipe 18	740	300	120	0	Open
Pipe 34	20	150	100	0	Closed
Pipe 35	300	150	100	0	Open
Pipe 36	200	150	100	0	Open
Pipe 40	300	150	100	0	Open
Pipe 44	300	150	100	0	Open

**TABLE A -8
EPANET RESULTS SCENARIO 7
PHASE 1 MAX DAY + FIRE**


Node ID	Elevation m	Demand LPS	Head m	Pressure m
Junc S	118	0.15	165.21	47.21
Junc U	118	0.77	159.32	41.32
Junc V	116	0.77	156.92	40.92
Junc W	116	0.61	159.84	43.84
Junc Y	116	0.46	147.05	31.05
Junc Z	117	63.49	135.21	18.21
Junc KK	116	0.46	165.21	49.21
Junc CC	115	0.46	144.63	29.63
Junc BB	114	0.31	144.63	30.63
Junc 2	118	0.77	162	44
Resvr R-A	156	0	156	0
Resvr R-B	168	-68.3	168	0

Link ID	Length m	Diameter mm	Roughness	Flow LPS	Status
Pipe 1	1998.27	200	110	0	Open
Pipe 3	200	300	120	0	Open
Pipe 14	350	300	120	0	Open
Pipe 7	750	300	120	68.3	Open
Pipe 20	100	150	100	0	Closed
Pipe 21	90	150	100	0	Closed
Pipe 23	60	150	100	0	Closed
Pipe 24	100	150	100	0	Closed
Pipe 25	100	150	100	0	Closed
Pipe 26	110	150	100	0	Open
Pipe 27	180	150	100	0	Closed
Pipe 28	130	150	100	0	Closed
Pipe 29	100	150	100	0	Closed
Pipe 30	100	150	100	0	Closed
Pipe 31	90	150	100	0	Closed
Pipe 32	200	200	110	-64.72	Open
Pipe 33	150	200	110	-53	Open
Pipe 37	150	150	100	0	Closed
Pipe 38	60	150	100	0	Closed
Pipe 39	130	150	100	0	Closed
Pipe 41	370	150	100	12.49	Open
Pipe 42	100	150	100	0	Closed
Pipe 43	240	150	100	37.36	Open
Pipe 45	400	150	100	0	Closed
Pipe 46	100	150	100	0	Closed
Pipe 47	40	150	100	0	Closed
Pipe 48	150	200	110	-64.72	Open
Pipe 49	450	200	110	0	Open
Pipe 5	1	300	150	0	Open
Pipe 12	90	150	100	-26.9	Open
Pipe 15	370	150	100	-26.14	Open
Pipe 16	50	150	100	0.31	Open
Pipe 50	330	300	120	0	Open
Pipe 2	1	300	120	0	Closed
Pipe 4	10	300	120	-68.3	Open
Pipe 6	370	150	100	-13.25	Open
Pipe 8	400	150	100	-14.02	Open
Pipe 9	5	300	120	0	Closed
Pipe 10	90	150	100	0	Closed
Pipe 13	340	150	100	0	Open
Pipe 17	300	150	100	0.15	Open
Pipe 19	200	150	100	0	Closed
Pipe 22	270	200	110	-53.61	Open
Pipe 11	370	300	120	0	Open
Pipe 18	740	300	120	0	Open
Pipe 34	20	150	100	0	Closed
Pipe 35	300	150	100	0	Open
Pipe 36	200	150	100	0	Open
Pipe 40	300	150	100	0	Open
Pipe 44	300	150	100	0	Open

Appendix D

Miscellaneous Information

- Typical Water Storage Tank Details
- 6" Watts Series 709 Backflow Preventer
- Data Sheet

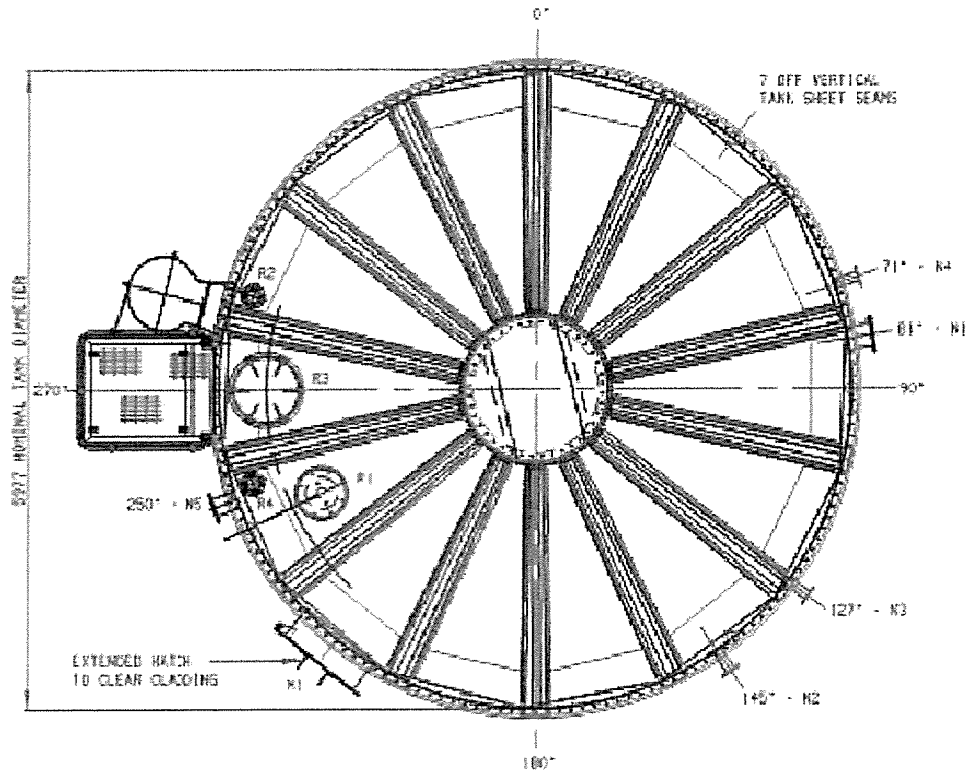

PLAN VIEW OF TANK


- NOTES:
- TANK AND ROOF EXTERNAL GLASS COLOUR MURRELL SP8 2/4 BLUE. TANK AND ROOF INTERNAL GLASS COLOUR MURRELL SG 2/2 BLUE/GREEN TRI-FUSION GRADE.
 - HOT-DIPPED GALVANISED SPECIFICATION (GMS) TO BS EN 150 1461 - 1999
 - TANK CONNECTIONS FLANGED TO ANSI ASA150 (BOLT HOLES OFF-CENTRE) UNLESS STATED OTHERWISE.
 - CLADDING SUPPLIED BY OTHERS
 - TANK DESIGN SUITABLE FOR NBC SEISMIC ZONE 3
 - CUSTOMER TO CONFIRM SUITABILITY OF ROOF CONNECTOR LENGTH TO ALLOW PROTRUSION THROUGH ROOF CLADDING.

PLATFORM DETAILS TO BS 5395 HANDRAIL SPECIFICATION TO BS 6180 : 1985 BUILDING USE CATEGORY BA (0.38 BR/m² max.) WITH SAFETY GATE. ALL STANCHION UPRIGHTS ARE 32mm x 2.25mm THICK MILD MILD STEEL TUBE TO BS 1387 WITH A 75mm O/D BALL. 25mm x 2.25mm THICK MILD MILD STEEL TUBE TO BS 1387 HANDRAILING. 100mm THICK MILD STEEL KICKSTRIP. OPEN STEEL FLOORING 40/100 TYPE. ALL FIXINGS ARE FINISHED SAUN GALVANISED. LADDER TO BS 4211: 1994 CLASS A.


ITEM	TYPE	SIZE	DESCRIPTION	ORIENTATION	ELEVATION	FINISH
R1	SINGLE	8"NB (200mm)	OUTLET	81°	450	G.R.S
R2	SINGLE	4"NB (100mm)	RECTRODECTION LINE	145°	5536	G.R.S
R3	SINGLE	3"NB (80mm)	DOWN	127°	222	G.R.S
R4	SINGLE	3"NB (80mm)	INLET	71°	5536	G.R.S
R5	SINGLE	6"NB (150mm)	OVERFLOW	250°	5503	G.R.S
R1	--	#01 (1000mm)	HANDRAIL	219°	7864	G.R.S

ITEM	TYPE	SIZE	DESCRIPTION	ORIENTATION	RADIUS	FINISH
R1	--	12"NB (300mm)	VENT	244°	R 2232	G.R.P
R2	SINGLE	4"NB (100mm)	FLANGE	280°	R 2800	G.R.S
R3	--	#24" (610mm)	INSP. HATCH	270°	R 2532	G.R.S
R4	SINGLE	4"NB (100mm)	FLANGE	252°	R 2800	G.R.S


CONNECTION R5 REQUESTED AT 145 BELOW TOP OF TANK MOVED TO 222 BELOW TOP OF TANK 5503 ABOVE BASE GIVING 500 FREEBOARD.
 CONNECTIONS R2 AND R4 REQUESTED AT 360 BELOW TOP OF TANK MOVED TO 190 BELOW TOP OF TANK 5536 ABOVE BASE TO BE ABOVE TOP WATER LEVEL
 CONNECTION R3 REQUESTED AT 145 ABOVE BASE MOVED TO 222 ABOVE BASE TO AVOID HORIZONTAL SEAM




CONNECTOR R1 DETAIL (MATERIAL - GRP, COLOUR - OYSTER)

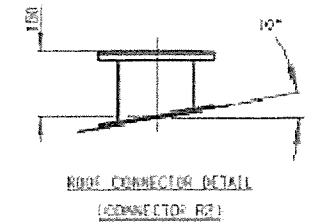

ROOF CONNECTOR DETAIL (CONNECTOR R2)

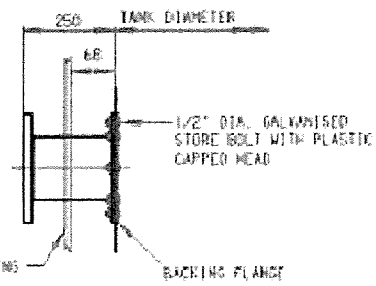


SINGLE FLANGED CONNECTOR DETAIL (TYPE)

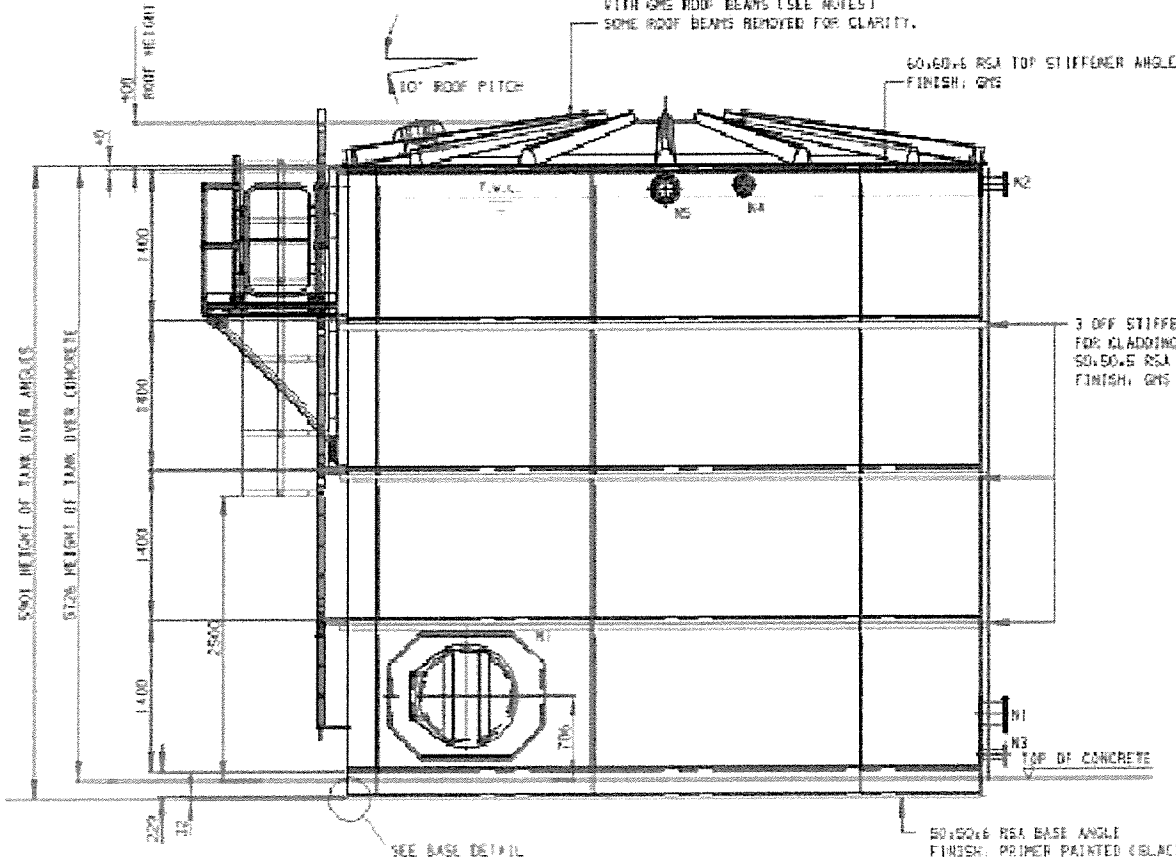


SIDE ELEVATION OF TANK - FOR TRUE ANGULAR ORIENTATIONS SEE PLAN VIEW

CLADDING (BY OTHERS) TO BE FIXED TO THIS FACE BY SELF-TAPPING SCREWS (BY OTHERS)

3 OFF STIFFENER ANGLES FOR CLADDING (BY OTHERS) 50x50x6 RSA FINISH: GMS

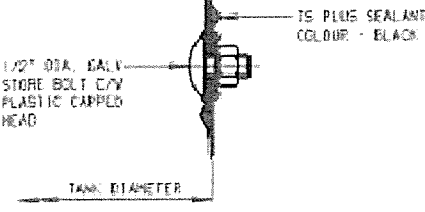

ENLARGED SECTION THROUGH HORIZONTAL & VERTICAL SHEET JOINT

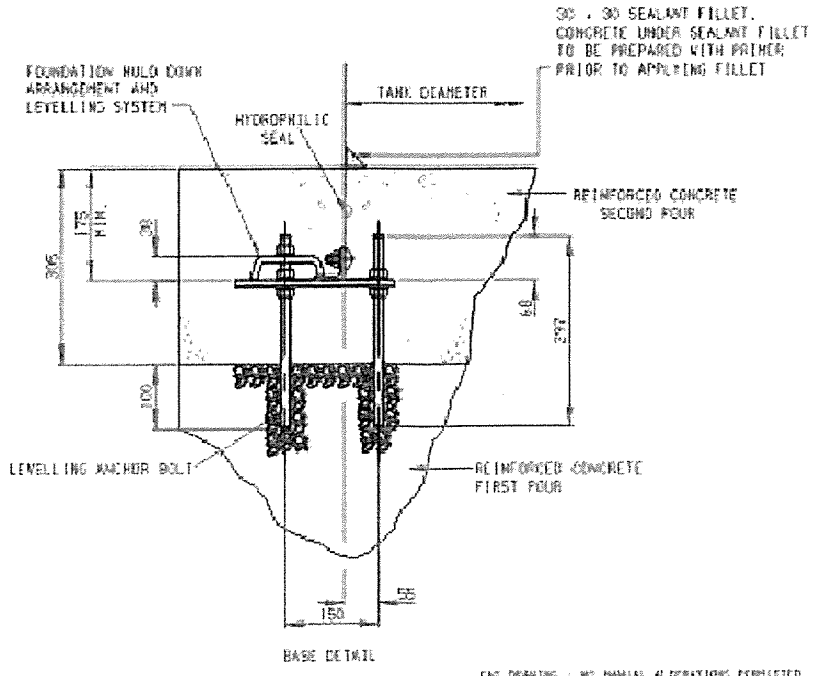

BASE DETAIL

FOUNDATION HOLD DOWN ARRANGEMENT AND LEVELLING SYSTEM

RELEASED - PLEASE GENERATE DRAWING - LINE 1 (EXCEPT TRACK) 5126 x 5126 x 5126	DRWING	N. R.	DATE	MATERIAL
1 RECTANGULAR	03	03	07/05/2006	---
2 RECTANGULAR	---	---	---	---
3 RECTANGULAR	---	---	---	---
4 RECTANGULAR	---	---	---	---
5 RECTANGULAR	---	---	---	---
6 RECTANGULAR	---	---	---	---
7 RECTANGULAR	---	---	---	---
8 RECTANGULAR	---	---	---	---
9 RECTANGULAR	---	---	---	---
10 RECTANGULAR	---	---	---	---
11 RECTANGULAR	---	---	---	---
12 RECTANGULAR	---	---	---	---
13 RECTANGULAR	---	---	---	---
14 RECTANGULAR	---	---	---	---
15 RECTANGULAR	---	---	---	---
16 RECTANGULAR	---	---	---	---
17 RECTANGULAR	---	---	---	---
18 RECTANGULAR	---	---	---	---
19 RECTANGULAR	---	---	---	---
20 RECTANGULAR	---	---	---	---
21 RECTANGULAR	---	---	---	---
22 RECTANGULAR	---	---	---	---
23 RECTANGULAR	---	---	---	---
24 RECTANGULAR	---	---	---	---
25 RECTANGULAR	---	---	---	---
26 RECTANGULAR	---	---	---	---
27 RECTANGULAR	---	---	---	---
28 RECTANGULAR	---	---	---	---
29 RECTANGULAR	---	---	---	---
30 RECTANGULAR	---	---	---	---
31 RECTANGULAR	---	---	---	---
32 RECTANGULAR	---	---	---	---
33 RECTANGULAR	---	---	---	---
34 RECTANGULAR	---	---	---	---
35 RECTANGULAR	---	---	---	---
36 RECTANGULAR	---	---	---	---
37 RECTANGULAR	---	---	---	---
38 RECTANGULAR	---	---	---	---
39 RECTANGULAR	---	---	---	---
40 RECTANGULAR	---	---	---	---
41 RECTANGULAR	---	---	---	---
42 RECTANGULAR	---	---	---	---
43 RECTANGULAR	---	---	---	---
44 RECTANGULAR	---	---	---	---
45 RECTANGULAR	---	---	---	---
46 RECTANGULAR	---	---	---	---
47 RECTANGULAR	---	---	---	---
48 RECTANGULAR	---	---	---	---
49 RECTANGULAR	---	---	---	---
50 RECTANGULAR	---	---	---	---
51 RECTANGULAR	---	---	---	---
52 RECTANGULAR	---	---	---	---
53 RECTANGULAR	---	---	---	---
54 RECTANGULAR	---	---	---	---
55 RECTANGULAR	---	---	---	---
56 RECTANGULAR	---	---	---	---
57 RECTANGULAR	---	---	---	---
58 RECTANGULAR	---	---	---	---
59 RECTANGULAR	---	---	---	---
60 RECTANGULAR	---	---	---	---
61 RECTANGULAR	---	---	---	---
62 RECTANGULAR	---	---	---	---
63 RECTANGULAR	---	---	---	---
64 RECTANGULAR	---	---	---	---
65 RECTANGULAR	---	---	---	---
66 RECTANGULAR	---	---	---	---
67 RECTANGULAR	---	---	---	---
68 RECTANGULAR	---	---	---	---
69 RECTANGULAR	---	---	---	---
70 RECTANGULAR	---	---	---	---
71 RECTANGULAR	---	---	---	---
72 RECTANGULAR	---	---	---	---
73 RECTANGULAR	---	---	---	---
74 RECTANGULAR	---	---	---	---
75 RECTANGULAR	---	---	---	---
76 RECTANGULAR	---	---	---	---
77 RECTANGULAR	---	---	---	---
78 RECTANGULAR	---	---	---	---
79 RECTANGULAR	---	---	---	---
80 RECTANGULAR	---	---	---	---
81 RECTANGULAR	---	---	---	---
82 RECTANGULAR	---	---	---	---
83 RECTANGULAR	---	---	---	---
84 RECTANGULAR	---	---	---	---
85 RECTANGULAR	---	---	---	---
86 RECTANGULAR	---	---	---	---
87 RECTANGULAR	---	---	---	---
88 RECTANGULAR	---	---	---	---
89 RECTANGULAR	---	---	---	---
90 RECTANGULAR	---	---	---	---
91 RECTANGULAR	---	---	---	---
92 RECTANGULAR	---	---	---	---
93 RECTANGULAR	---	---	---	---
94 RECTANGULAR	---	---	---	---
95 RECTANGULAR	---	---	---	---
96 RECTANGULAR	---	---	---	---
97 RECTANGULAR	---	---	---	---
98 RECTANGULAR	---	---	---	---
99 RECTANGULAR	---	---	---	---
100 RECTANGULAR	---	---	---	---

TYPICAL WATER STORAGE TANK DETAILS

FIGURE D-1

For Non-Health Hazard Applications

Job Name _____ Contractor _____
 Job Location _____ Approval _____
 Engineer _____ Contractor's P.O. No. _____
 Approval _____ Representative _____

Series 709 Double Check Valve Assemblies

Sizes: 2½" – 10" (65 – 250mm)

Series 709 Double Check Valve Assemblies are designed to prevent the reverse flow of polluted water from entering into the potable water system. This series can be applied, where approved by the local authority having jurisdiction, on non-health hazard installations. Series 709 features a modular check design concept to facilitate easy maintenance. Check with local jurisdictional authority as to installation requirements.

Features

- Replaceable bronze seats
- Maximum flow at low pressure drop
- Design simplicity for easy maintenance
- No special tools required for servicing
- Captured spring assemblies for safety
- Approved for vertical flow up installation

Models

Suffix:

NRS – non-rising stem resilient seated gate valves

OSY – UL/FM outside stem and yoke resilient seated gate valves

S-FDA – FDA epoxy coated strainer

BB – bronze body - 2½" – 3" (64 – 76mm)


QT – quarter-turn ball valves

QT-FDA – FDA epoxy coated ball valve shutoffs


LF – without shutoff valves

Specifications

A Double Check Valve Assembly shall be installed at referenced cross-connections to prevent the backflow of polluted water into the potable water supply. The cross-connections shall be determined by local inspection authority for use where a high hazard situation does not exist. Valve shall feature modular check assemblies with center stem guiding. Each check module shall have a captured spring and be accessible through a bolted cover plate. Seats shall be replaceable without special tools. It shall be a complete assembly including tight-closing resilient seated shutoff valves, test cocks, and a strainer is recommended. The assembly shall meet the requirements of ASSE No. 1015; AWWA C510-92; CSA B64.5 and UL Classified File No. EX3185. Approved by the Foundation for Cross-Connection Control and Hydraulic Research at the University of Southern California. Assembly shall be a Watts Regulator Company Series 709.

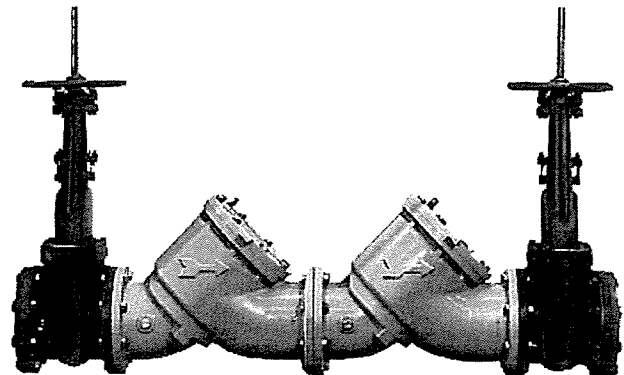

709 OSY

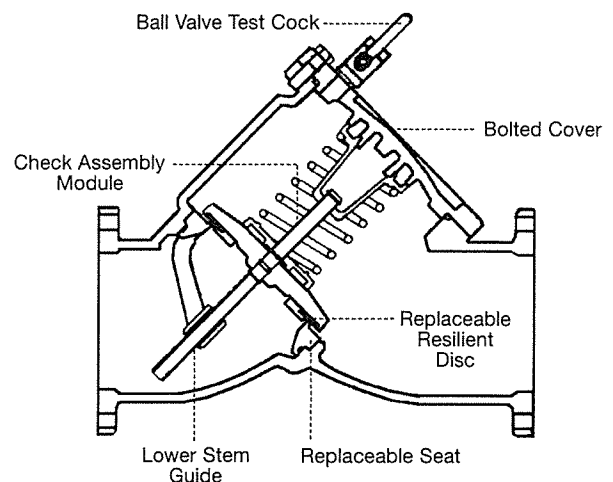

Check Assembly Module

Series 709 features a modular design concept which facilitates complete maintenance and assembly by retaining the spring load. Also, the first and second check module are identical and can be interchanged.

**IMPORTANT: INQUIRE WITH GOVERNING AUTHORITIES
FOR LOCAL INSTALLATION REQUIREMENTS**

Now Available
WattsBox Insulated Enclosures.
 For more information, send for literature ES-WB.

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

WATTS®

Materials

Check Valve Bodies: Epoxy coated cast iron

Seats: Bronze

Pressure – Temperature

Temperatures Range: 33°F – 110°F (0.5°C – 43°C) continuous,
140°F (60°C) intermittent

Maximum Working Pressure: 175psi (12.1 bar)

Standards

AWWA C510-92

IAPMO PA 31

USC Manual for Cross-Connection Control, 8th Edition

Approvals




Approved by the Foundation for Cross-Connection Control and Hydraulic Research at the University of Southern California. Sizes 4" – 10" (100 – 250mm) approved horizontal and vertical "flow up". Size 2½" and 3" (65 – 80mm) approved horizontal only.

Factory Mutual approved 4" – 10" (80 – 250mm) vertical "flow up" with OSY gate valves only.

Note: Model "S" not listed

Dimensions – Weights

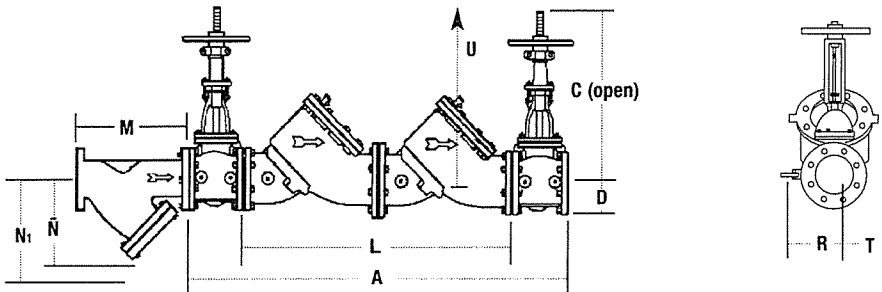

SIZE (DN)		DIMENSIONS															
in.	mm	A		C (OSY)		C (NRS)		D		L		U*		M		N	
		in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
2½	65	39¾	1000	16¾	416	9¾	238	3½	89	24½	613	11	279	10	254	6½	165
3	80	40¾	1025	18¾	479	10¼	260	3¾	95	24½	613	14	356	10½	257	7	178
4	100	52¾	1330	22¾	578	12¾	310	4½	114	34½	867	14	356	12½	308	8¼	210
6	150	62¾	1597	30¾	765	16	406	5½	140	41½	1057	16	406	18½	470	13½	343
8	200	75	1905	37¾	959	19½	506	6½	165	52	1321	21	533	21½	549	15½	394
10	250	90	2286	45¾	1162	23¾	605	8	203	64	1626	25	635	26	660	18½	470







SIZE (DN)		DIMENSIONS							WEIGHT				STRAINER				
in.	mm	N1†		R		R❖		T		NRS		OSY		QT		Weight	
		in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.	lbs.	kgs.	lbs.	kgs.	lbs.	kgs.
2½	65	10	254	4	102	16	406	3	76	167	76	170	77	154	70	28	13
3	80	10	254	5	127	16	406	3	76	167	76	170	77	162	73	34	15
4	100	12	305	6	152	19¾	502	6	152	368	167	383	174	275	125	60	27
6	150	20	508	11	279	26	660	7½	191	627	284	707	321	611	277	122	55
8	200	22¾	578	11¼	286	11¼	286	9	229	1201	545	1307	593	1419	644	247	112
10	250	28	711	12½	318	12½	318	10¼	260	2003	909	2073	940	2466	1119	370	168




† - Dimension required for screen removal. ❖ Quarter-turn (QT) valve dimensions.

*Service clearance for check assembly from center.

Capacity

*Typical maximum system flow rate (7.5 feet/sec.) **UL rated flow

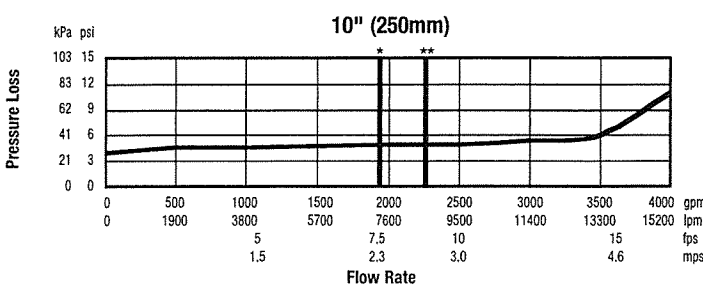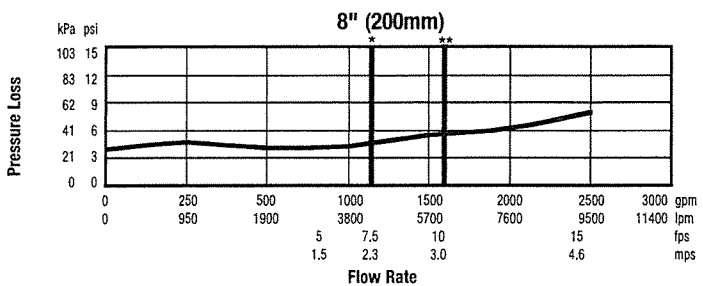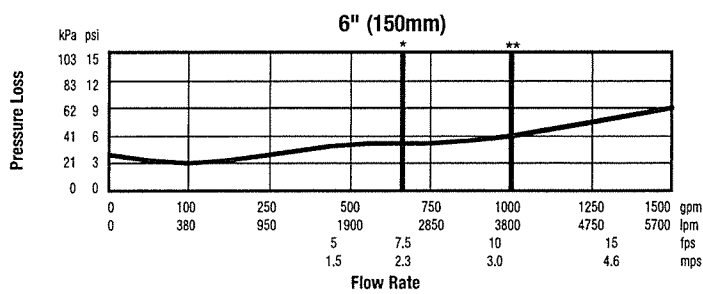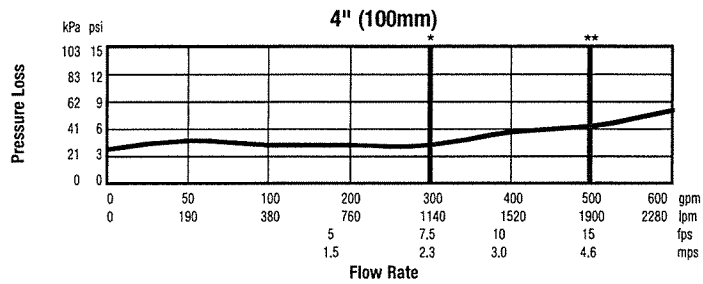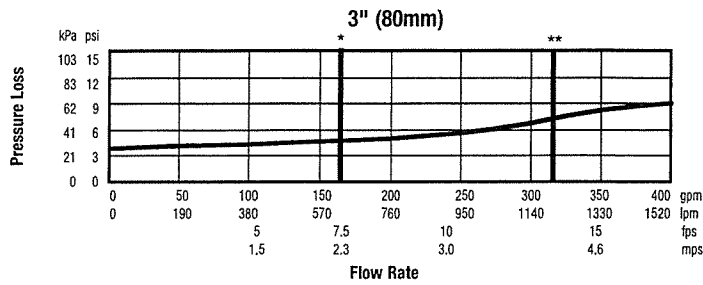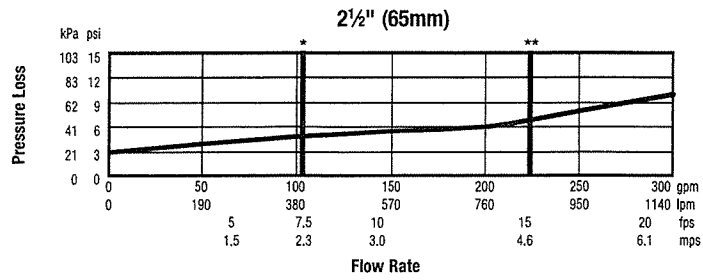

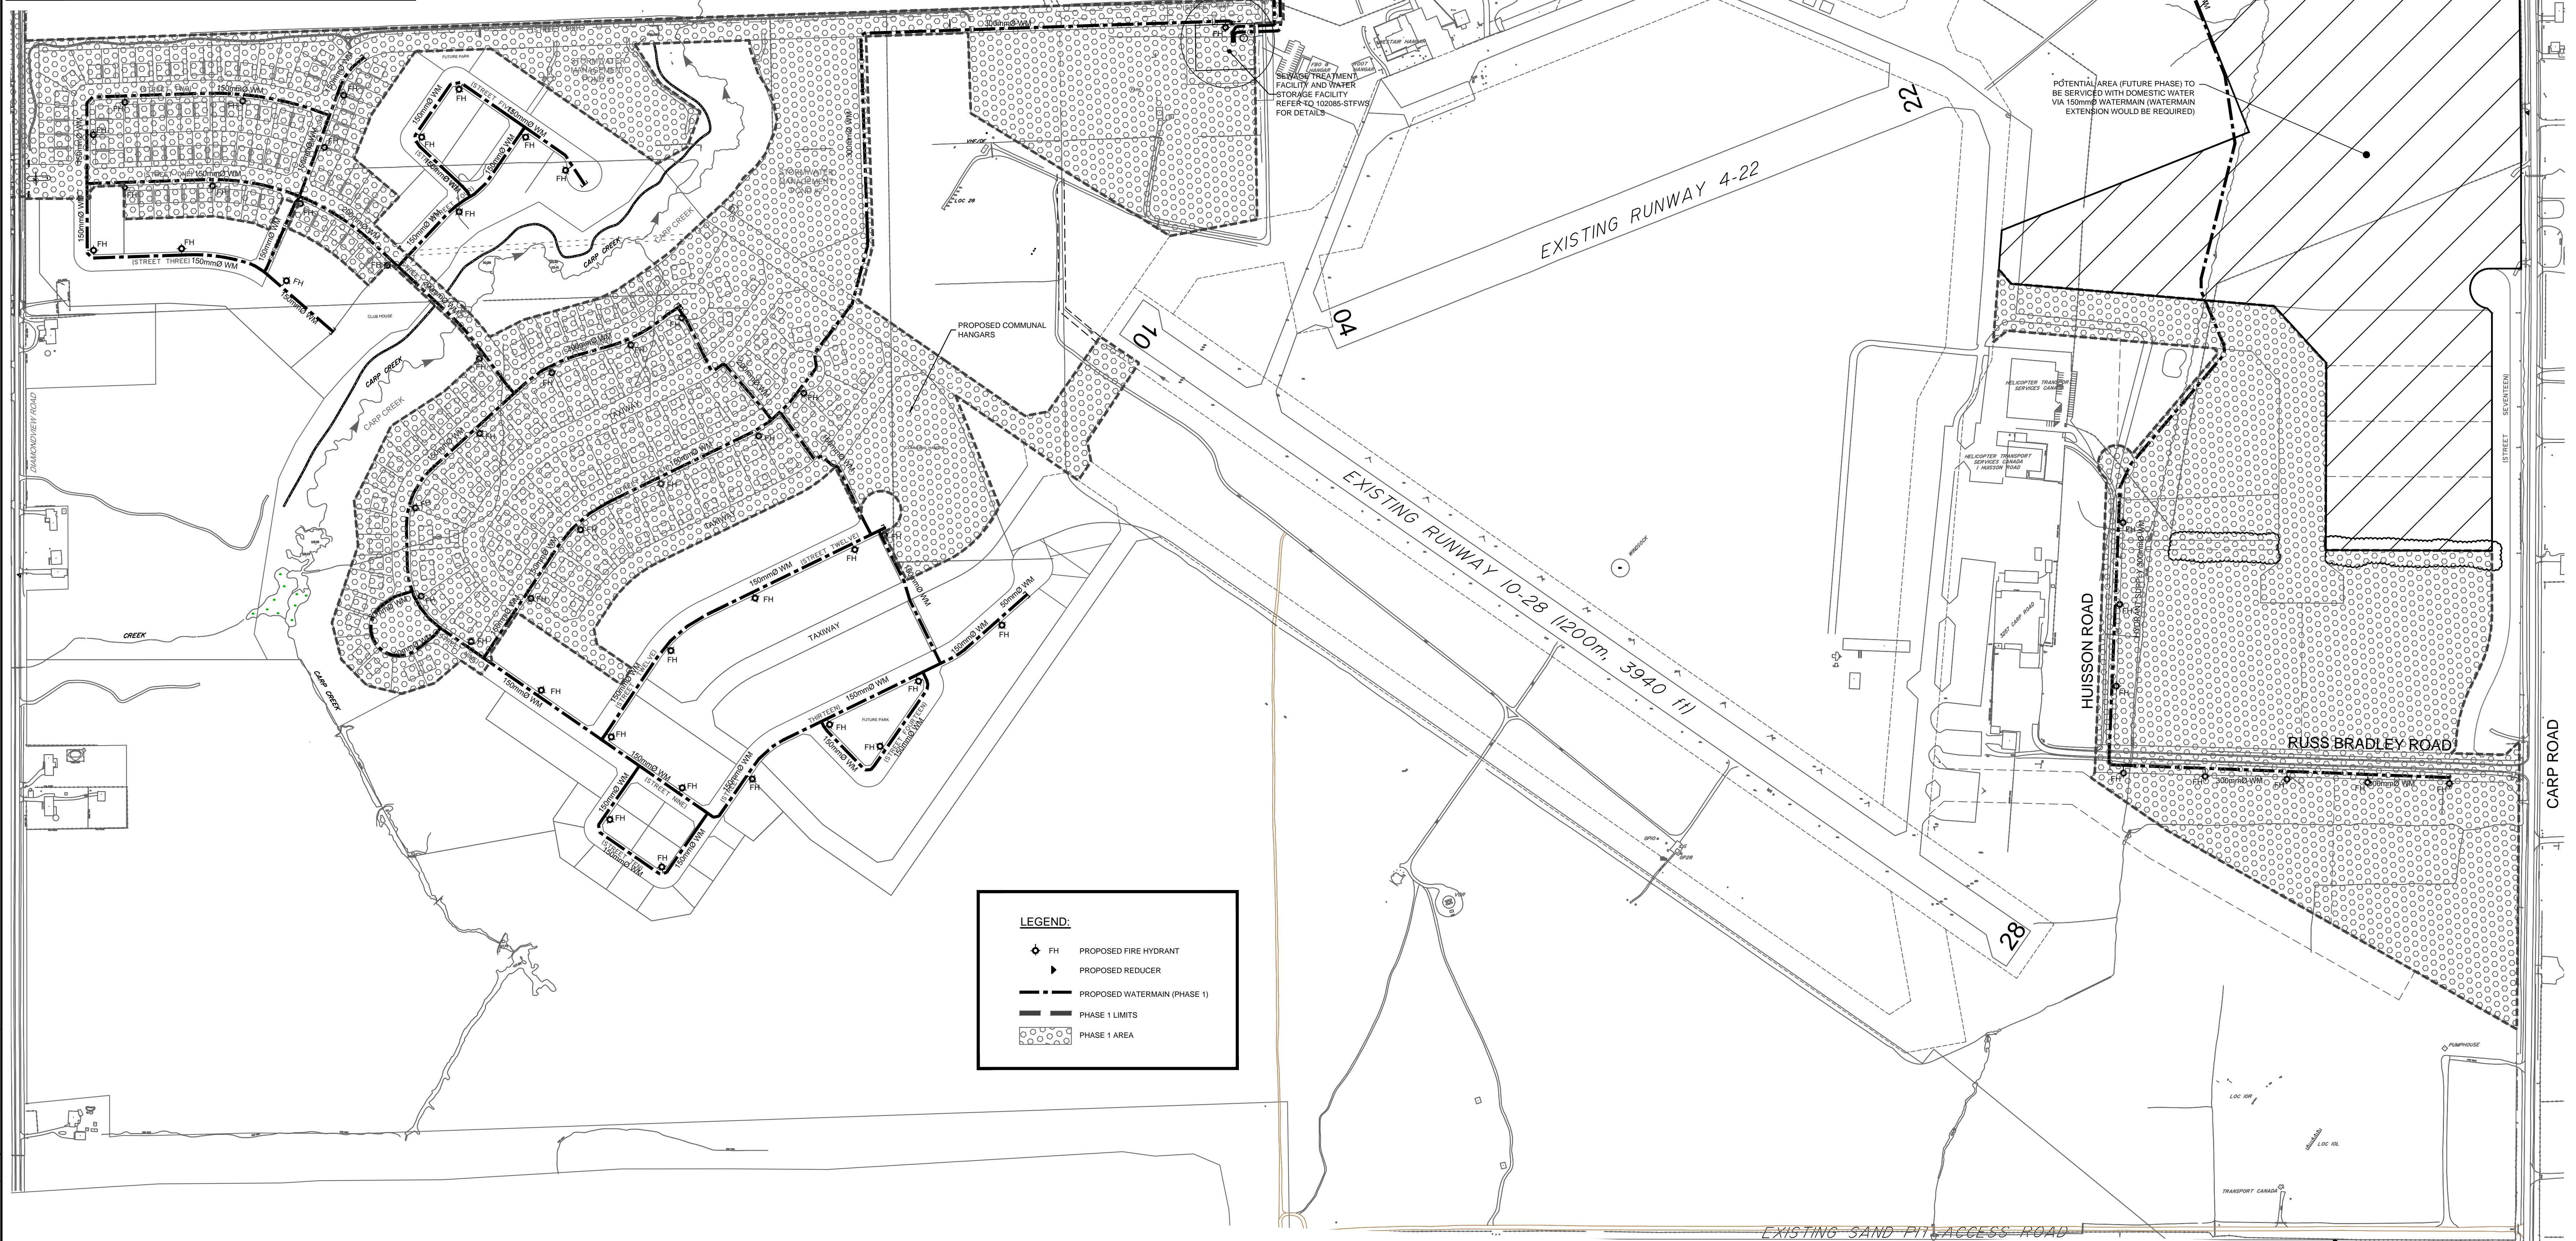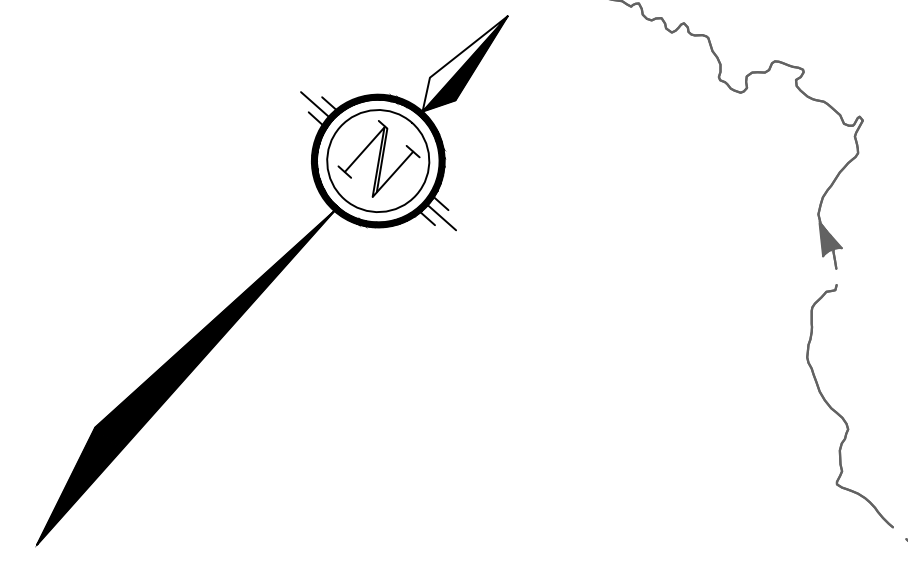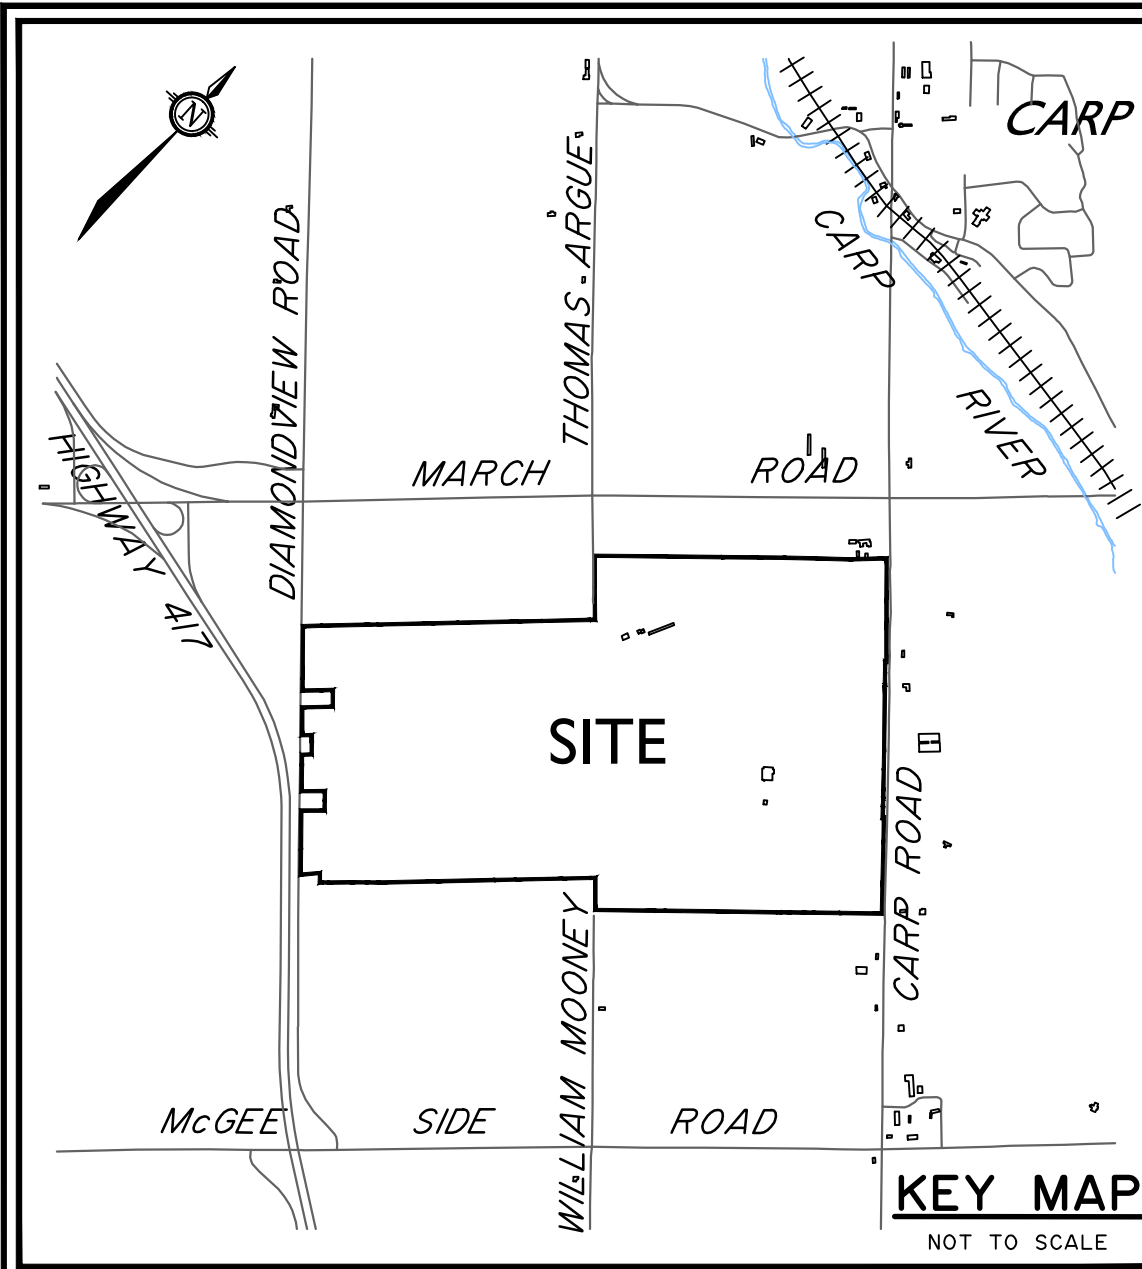

LEGEND:

- PROPOSED FIRE HYDRANT
- PROPOSED REDUCER
- PROPOSED WATERMAIN (PHASE 1)
- PHASE 1 LIMITS
- PHASE 1 AREA

C:\Users\102085\OneDrive\102085-WM Overall Layout.dwg, WM, Nov 05, 2014, 4:07pm, dcahwy

NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS,
 WATERMANS, SEWERS AND OTHER
 UNDERGROUND AND OVERGROUND UTILITIES AND
 STRUCTURES IS NOT NECESSARILY SHOWN ON
 THE CONTRACT DRAWINGS, AND WHERE SHOWN,
 THE ACCURACY OF THE POSITION OF SUCH
 UTILITIES AND STRUCTURES IS NOT GUARANTEED.
 BEFORE STARTING WORK, DETERMINE THE EXACT
 LOCATION OF ALL SUCH UTILITIES AND
 STRUCTURES AND ASSUME ALL LIABILITY FOR
 DAMAGE TO THEM.

No.	REVISION	DATE	BY
7.	REVISED PER CITY / MVC COMMENTS	SEPT 26 / 13	DJC
6.	ISSUED WITH HYDRAULIC ANALYSIS REPORT	MAY 28/13	DJC
5.	ISSUED FOR DISCUSSION	JUN 14/12	DJC
4.	ISSUED WITH HYDRAULIC ANALYSIS REPORT	NOV 21/11	DJC
3.	ISSUED TO CITY OF OTTAWA FOR DISCUSSION	JUN 28/11	DJC
2.	ISSUED FOR DISCUSSION	MAY 31/11	LW
2.	ISSUED FOR DISCUSSION	APR 12/11	DJC
1.	ISSUED FOR DISCUSSION	APR 7/11	DJC
8.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	NOV 5/14	DJC

No.	REVISION	DATE	BY
7.	REVISED PER CITY / MVC COMMENTS	SEPT 26 / 13	DJC
6.	ISSUED WITH HYDRAULIC ANALYSIS REPORT	MAY 28/13	DJC
5.	ISSUED FOR DISCUSSION	JUN 14/12	DJC
4.	ISSUED WITH HYDRAULIC ANALYSIS REPORT	NOV 21/11	DJC
3.	ISSUED TO CITY OF OTTAWA FOR DISCUSSION	JUN 28/11	DJC
2.	ISSUED FOR DISCUSSION	MAY 31/11	LW
2.	ISSUED FOR DISCUSSION	APR 12/11	DJC
1.	ISSUED FOR DISCUSSION	APR 7/11	DJC
8.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	NOV 5/14	DJC

SCALE

1:3000

FOR REVIEW ONLY

DESIGN: CJS

CHECKED: SMG

DRAWN: DJC

CHECKED: SMG

APPROVED: SMG

NOVATECH



Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada K2M 3P6

Telephone: (613) 254-9643
 Facsimile: (613) 254-5867
 Website: www.novatech-eng.com


CITY OF OTTAWA
 WEST CAPITAL AIRPARK

**OVERALL WATERMAIN
 LAYOUT PLAN**


PROJECT No.: 102085-01
 REV # 8
 DRAWING No.: 102085-WMOL

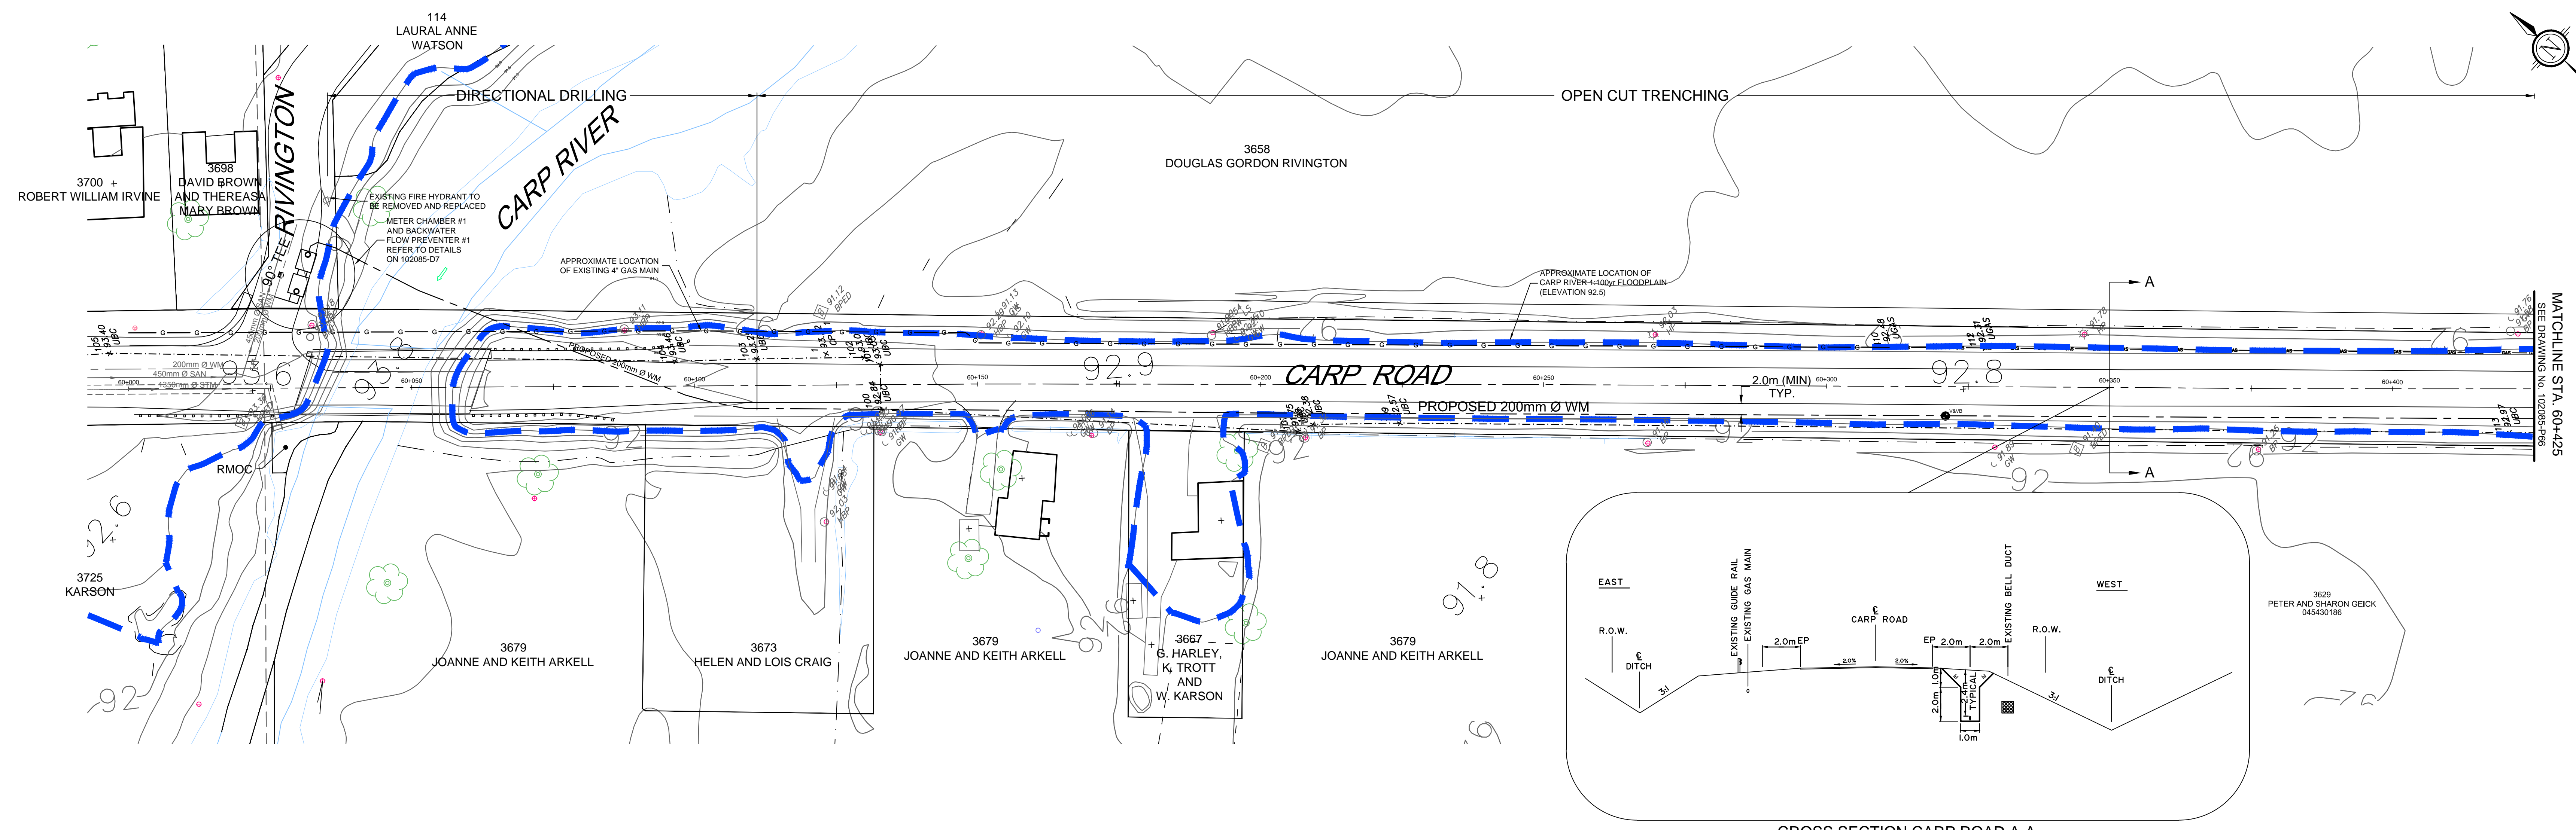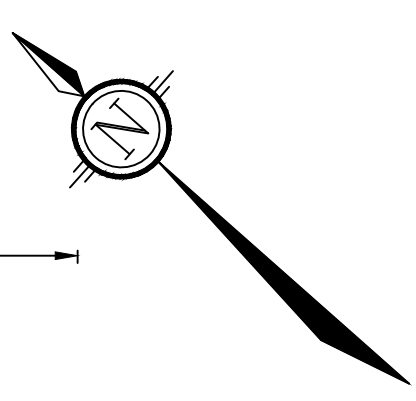

MATCHLINE STA. 60+425
SEE DRAWING NO. 102085-P66

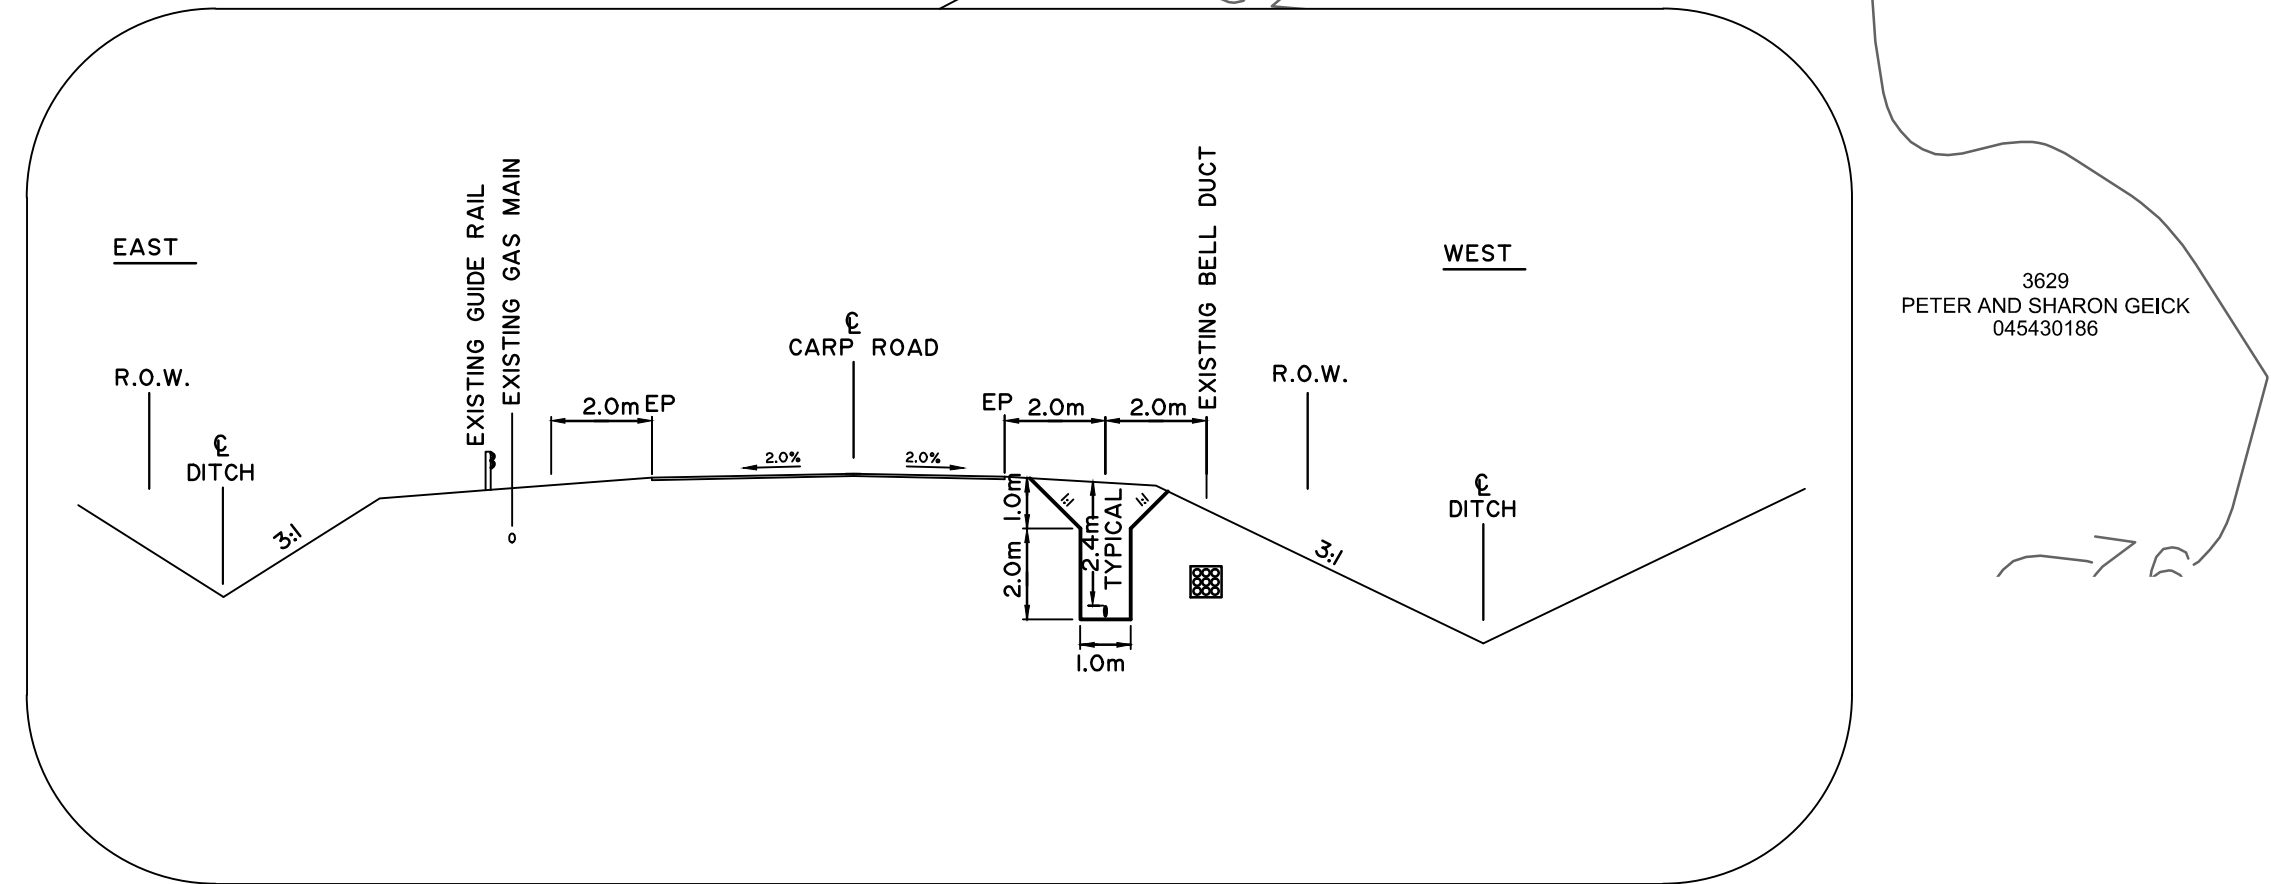

CROSS SECTION CARP ROAD A-A
10+350
N.T.S.

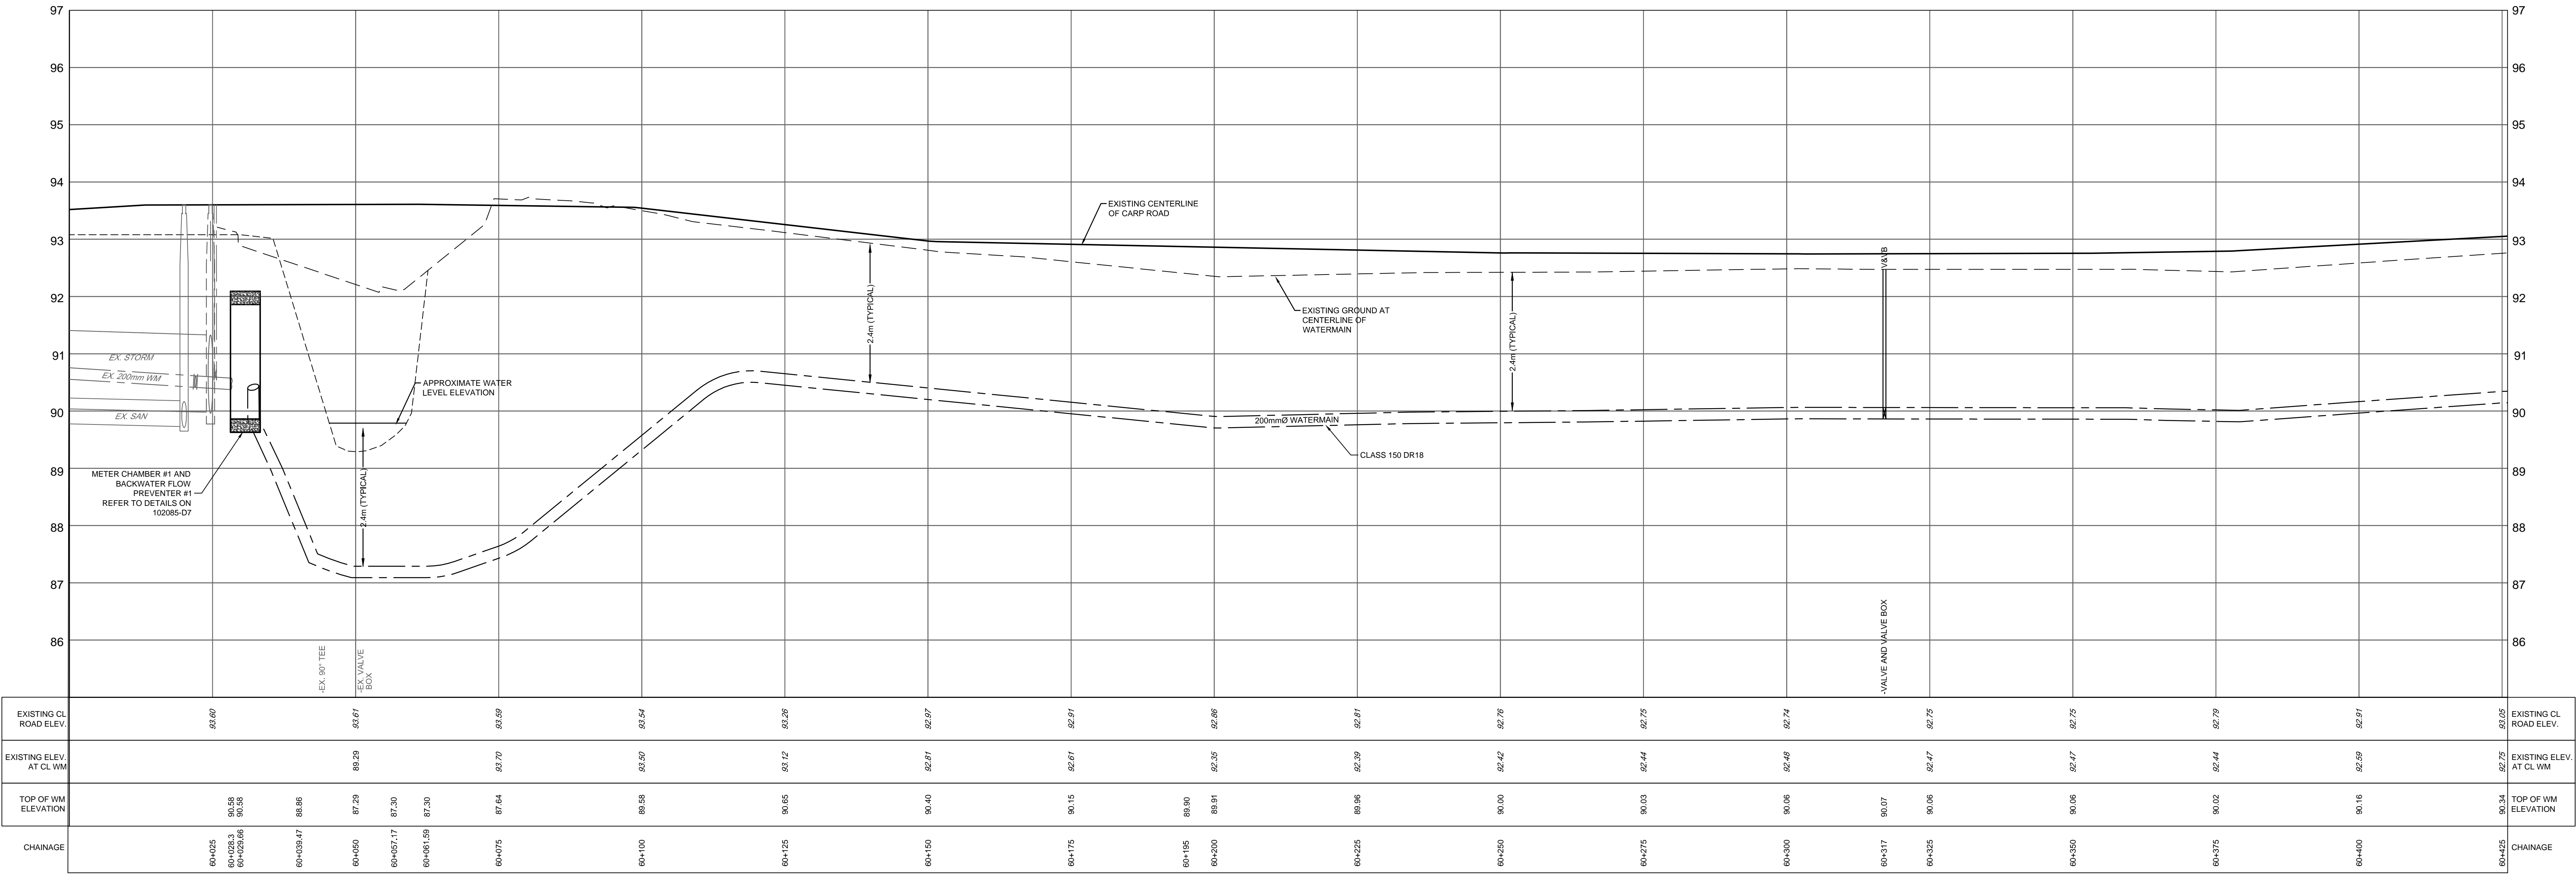


C:\Users\jgibson\OneDrive\Desktop\102085-1-CAD\Drawings\102085-CR2.dwg, Pkg, Nov. 19, 2014, 3:27pm, acuity

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.



No.	REVISION	DATE	BY
6.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	OCT 15/14	DJC
5.	REVISED PER CITY/MVC COMMENTS	SEPT 26/13	DJC
4.	REVISED PER CITY/MVC COMMENTS	MAY 28/13	DJC
3.	ISSUED TO THE CITY OF OTTAWA	JUL 17/12	DJC
2.	REVISED AS PER CITY COMMENTS	MAR 8/12	DJC
1.	ISSUED FOR REVIEW	NOV 21/11	DJC

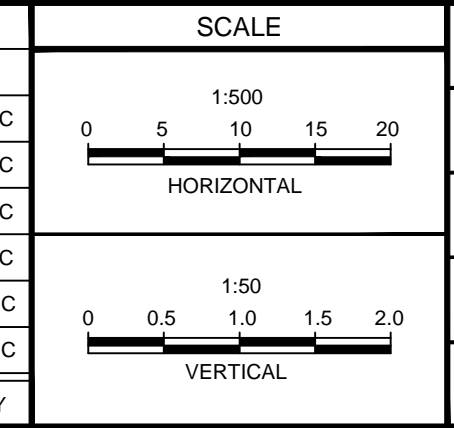

FOR REVIEW ONLY

DESIGN: CJS
CHECKED: SMG
DRAWN: DJC
CHECKED: LAB
APPROVED: JGR



REGISTERED PROFESSIONAL ENGINEER
J.G. RIDDELL
PROVINCE OF ONTARIO



CITY OF OTTAWA
WEST CAPITAL AIRPARK

PLAN AND PROFILE OF
CARP ROAD
STATION 60+000 TO 60+425

PROJECT NO.	102085-01
REV	REV # 6
DRAWING NO.	102085-P65

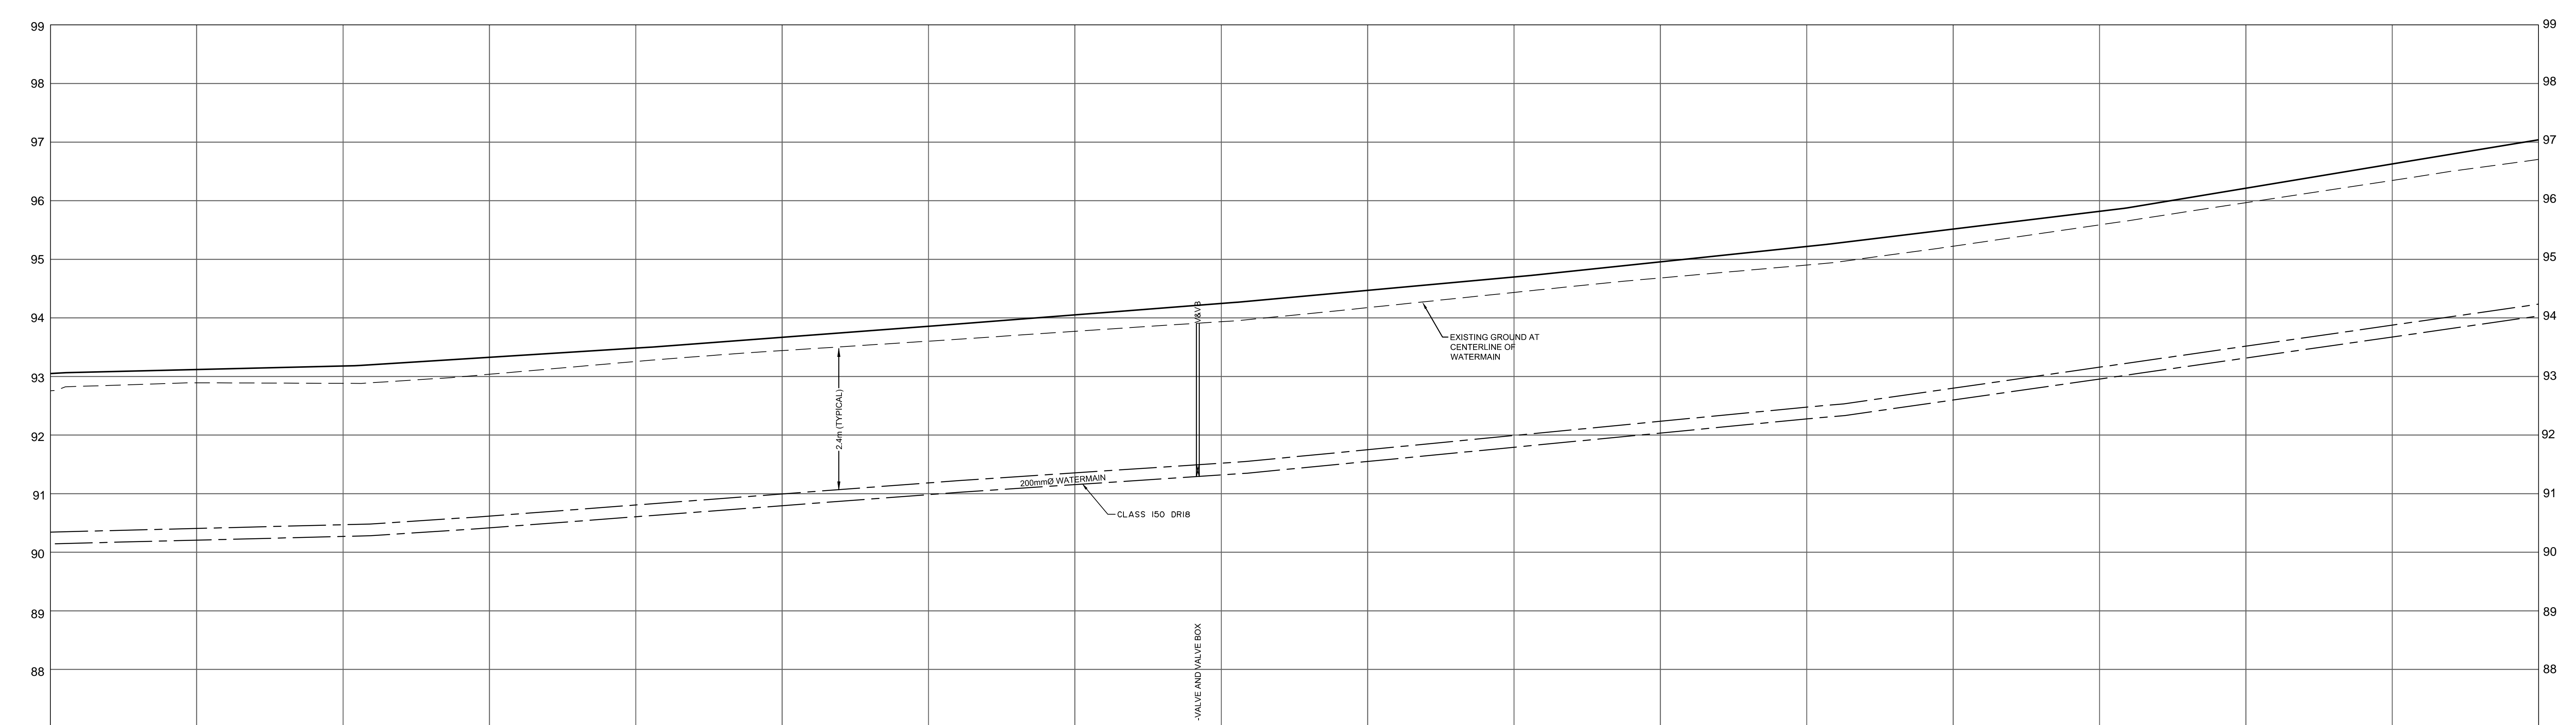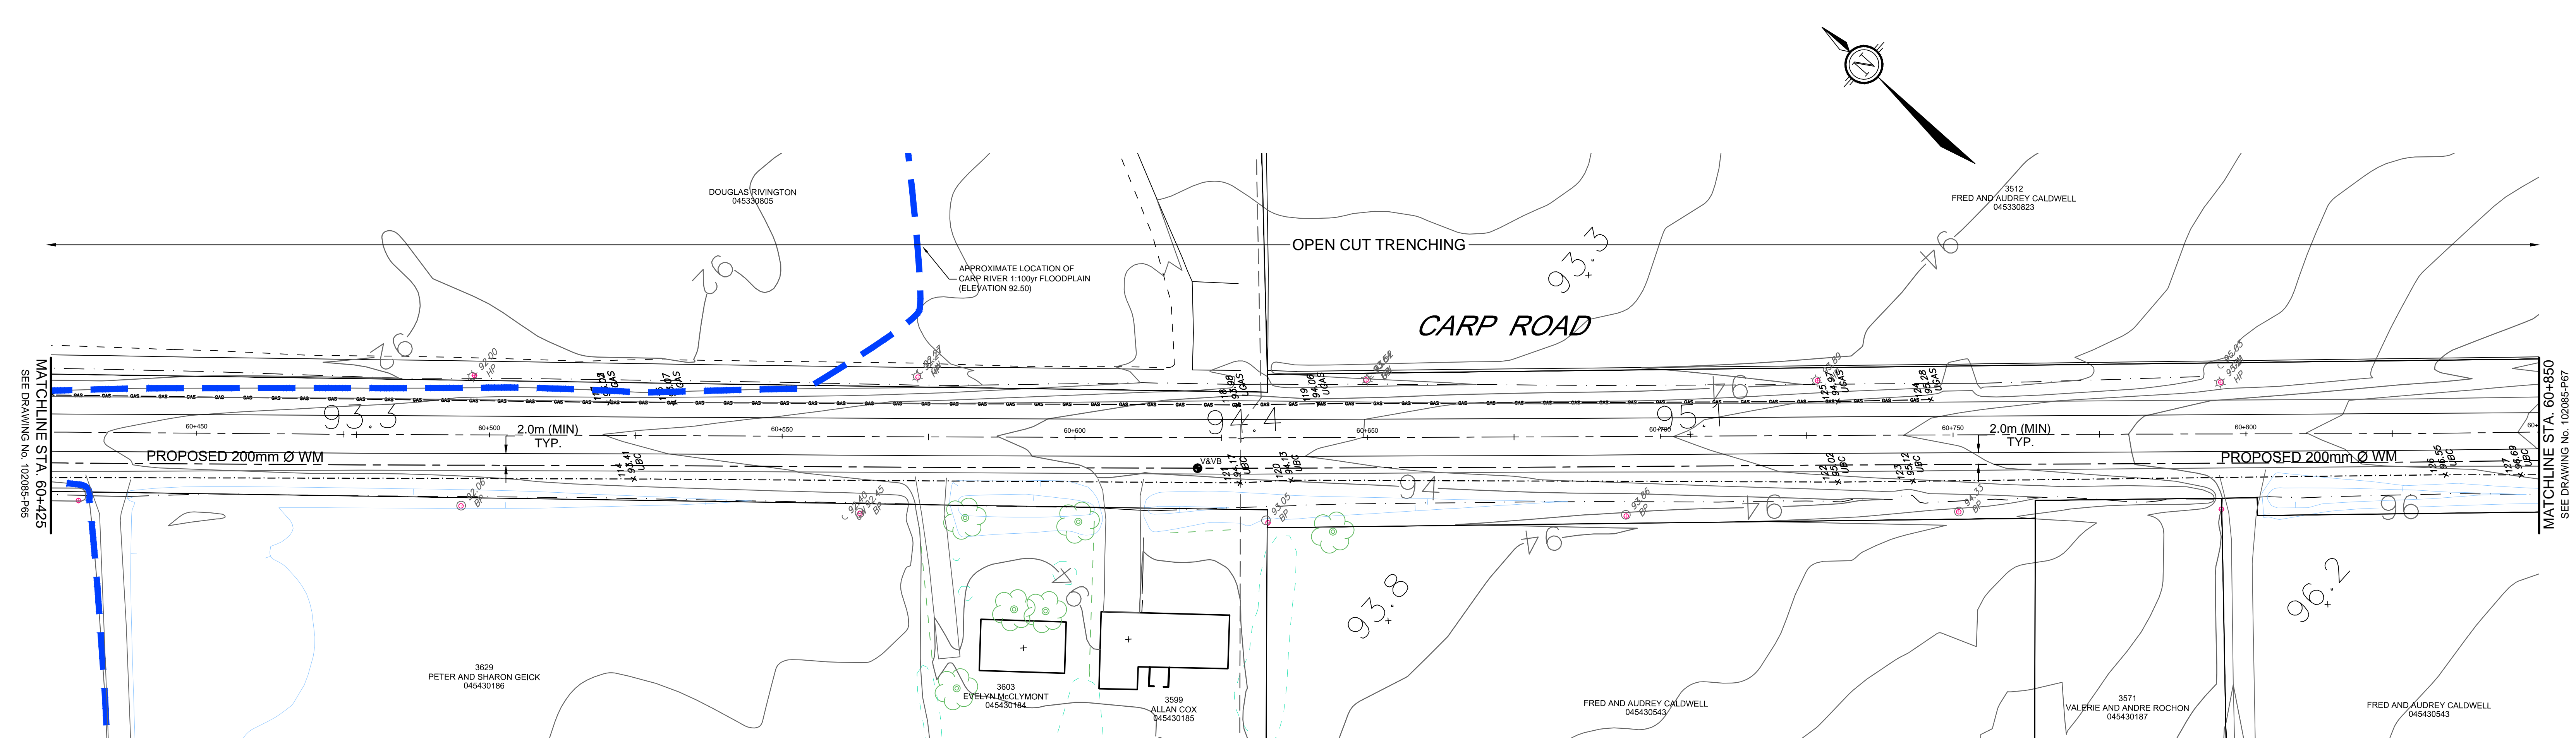


EXISTING CL ROAD ELEV.	95.05	95.12	95.18	95.23	95.28	95.34	95.38	95.45	95.50	95.56	95.62	95.67	95.71	95.75	95.80	95.86	95.92	95.97	96.02	96.07	96.12	96.18	96.23	96.29	96.34	96.40	96.45	96.50	96.56	96.61	96.67	96.72	EXISTING CL ROAD ELEV.		
EXISTING ELEV. AT CL WM	93.29	93.29	93.28	93.27	93.26	93.25	93.24	93.23	93.22	93.21	93.20	93.19	93.18	93.17	93.16	93.15	93.14	93.13	93.12	93.11	93.10	93.09	93.08	93.07	93.06	93.05	93.04	93.03	93.02	93.01	93.00	92.99	92.98	92.97	EXISTING ELEV. AT CL WM
TOP OF WM ELEVATION	90.34	90.41	90.47	90.52	90.57	90.62	90.67	90.72	90.77	90.82	90.87	90.92	90.97	91.02	91.07	91.12	91.17	91.22	91.27	91.32	91.37	91.42	91.47	91.52	91.57	91.62	91.67	91.72	91.77	91.82	91.87	91.92	91.97	92.02	TOP OF WM ELEVATION
CHAINAGE	60+425	60+450	60+475	60+500	60+525	60+550	60+575	60+600	60+625	60+650	60+675	60+700	60+725	60+750	60+775	60+800	60+825	60+850	CHAINAGE																

C:\0207\102085\P66\102085-1\CAD\dwg\mxd\102085_P66.dwg, Nov 19, 2014, 3:57pm, smg

NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.



NO.	REVISION	DATE	BY
6.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	OCT 15/14	DJC
5.	REVISED PER CITY/MVC COMMENTS	SEPT 26/13	DJC
4.	REVISED PER CITY/MVC COMMENTS	MAY 28/13	DJC
3.	ISSUED TO THE CITY OF OTTAWA	JUL 17/12	DJC
2.	REVISED AS PER CITY COMMENTS	MAR 8/12	DJC
1.	ISSUED FOR REVIEW	NOV 21/11	DJC

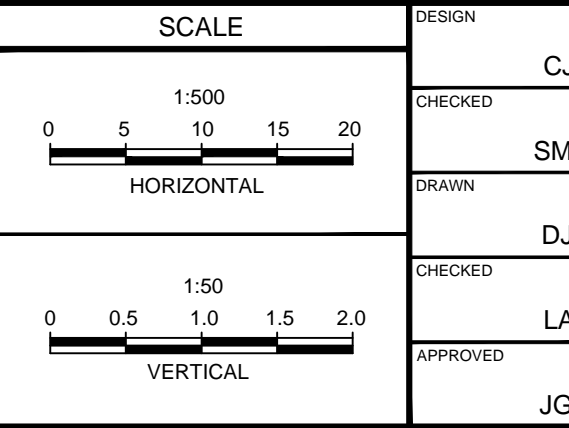

FOR REVIEW ONLY



CHECKED: CJS
 DRAWN: SMG
 CHECKED: DJC
 APPROVED: LAB
 JGR



CITY OF OTTAWA
 WEST CAPITAL AIRPARK

PLAN AND PROFILE OF
 CARP ROAD
 STATION 60+425 TO 60+850

PROJECT NO.	102085-01
REV	REV # 6
DRAWING NO.	102085-P66

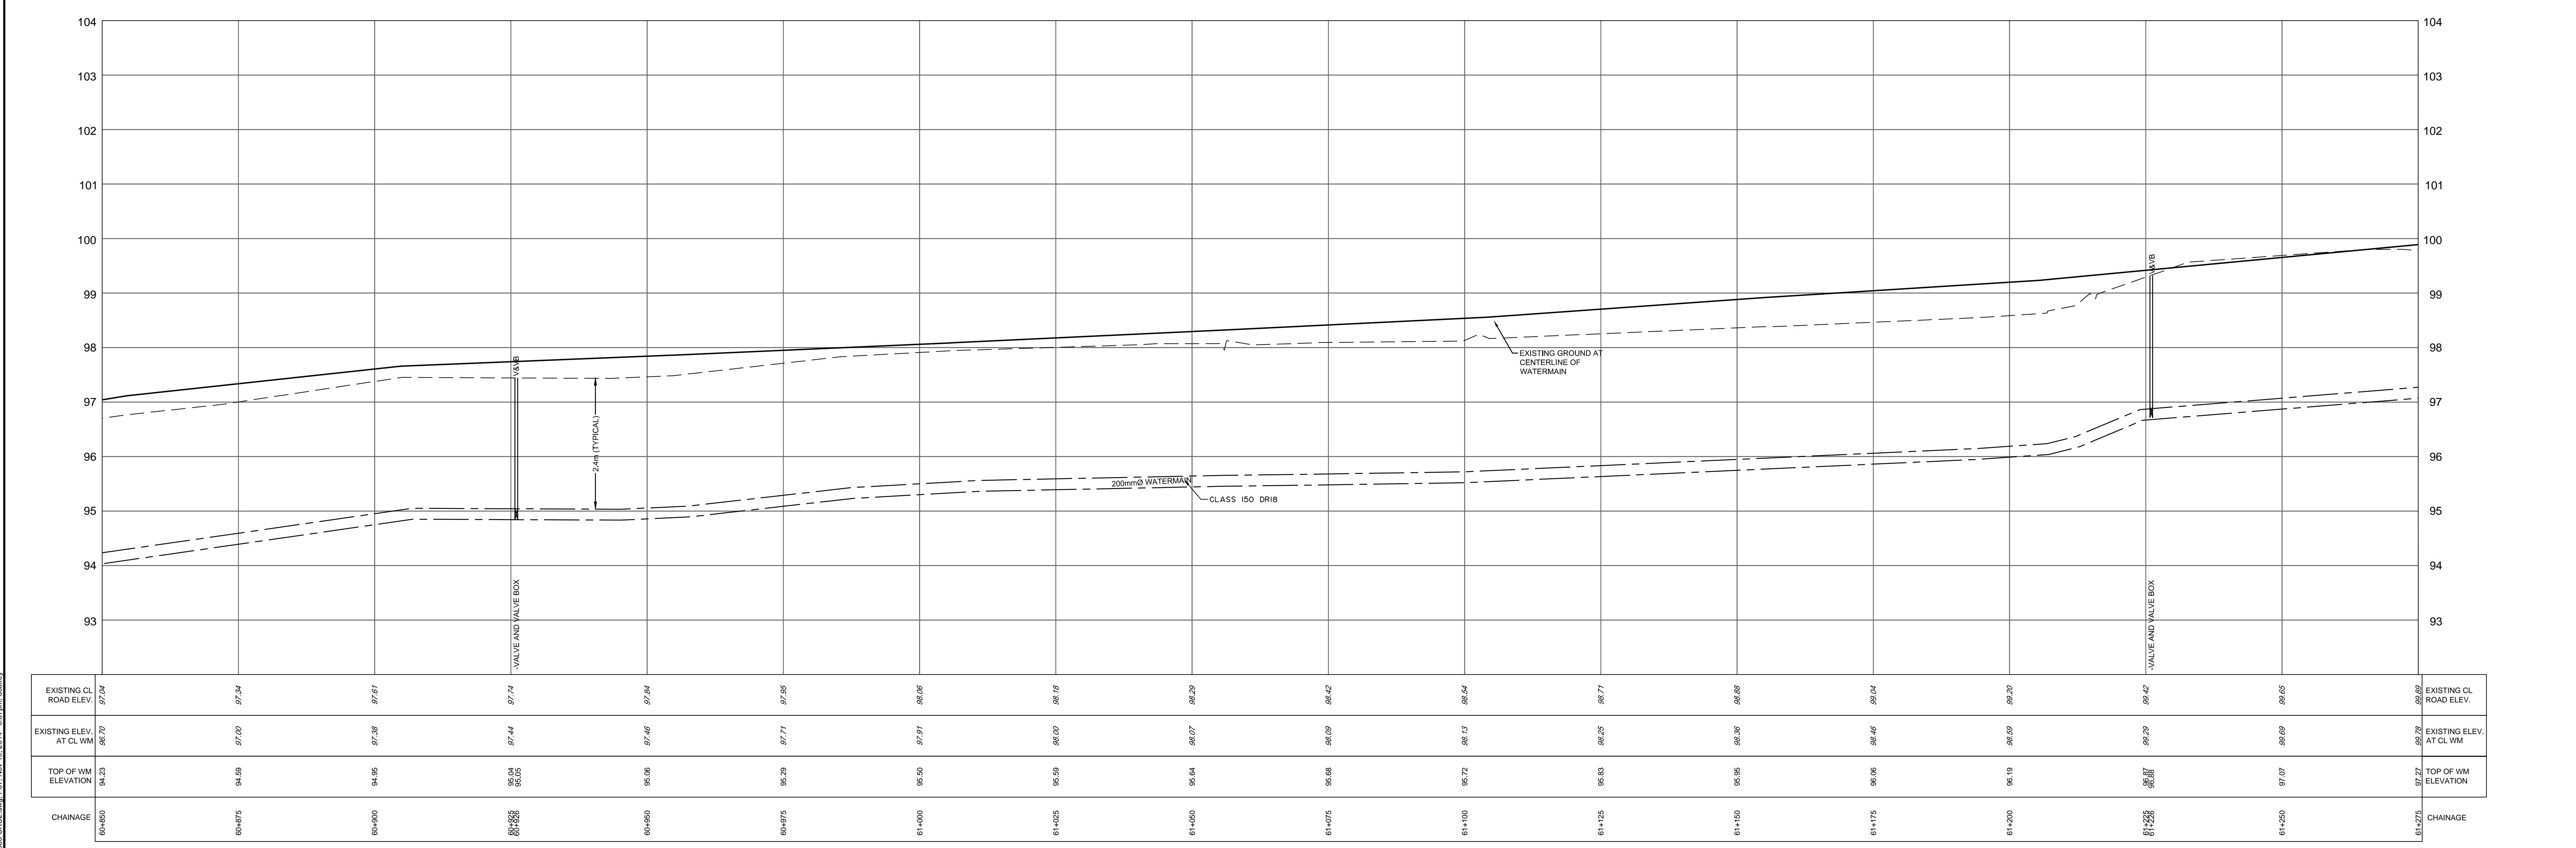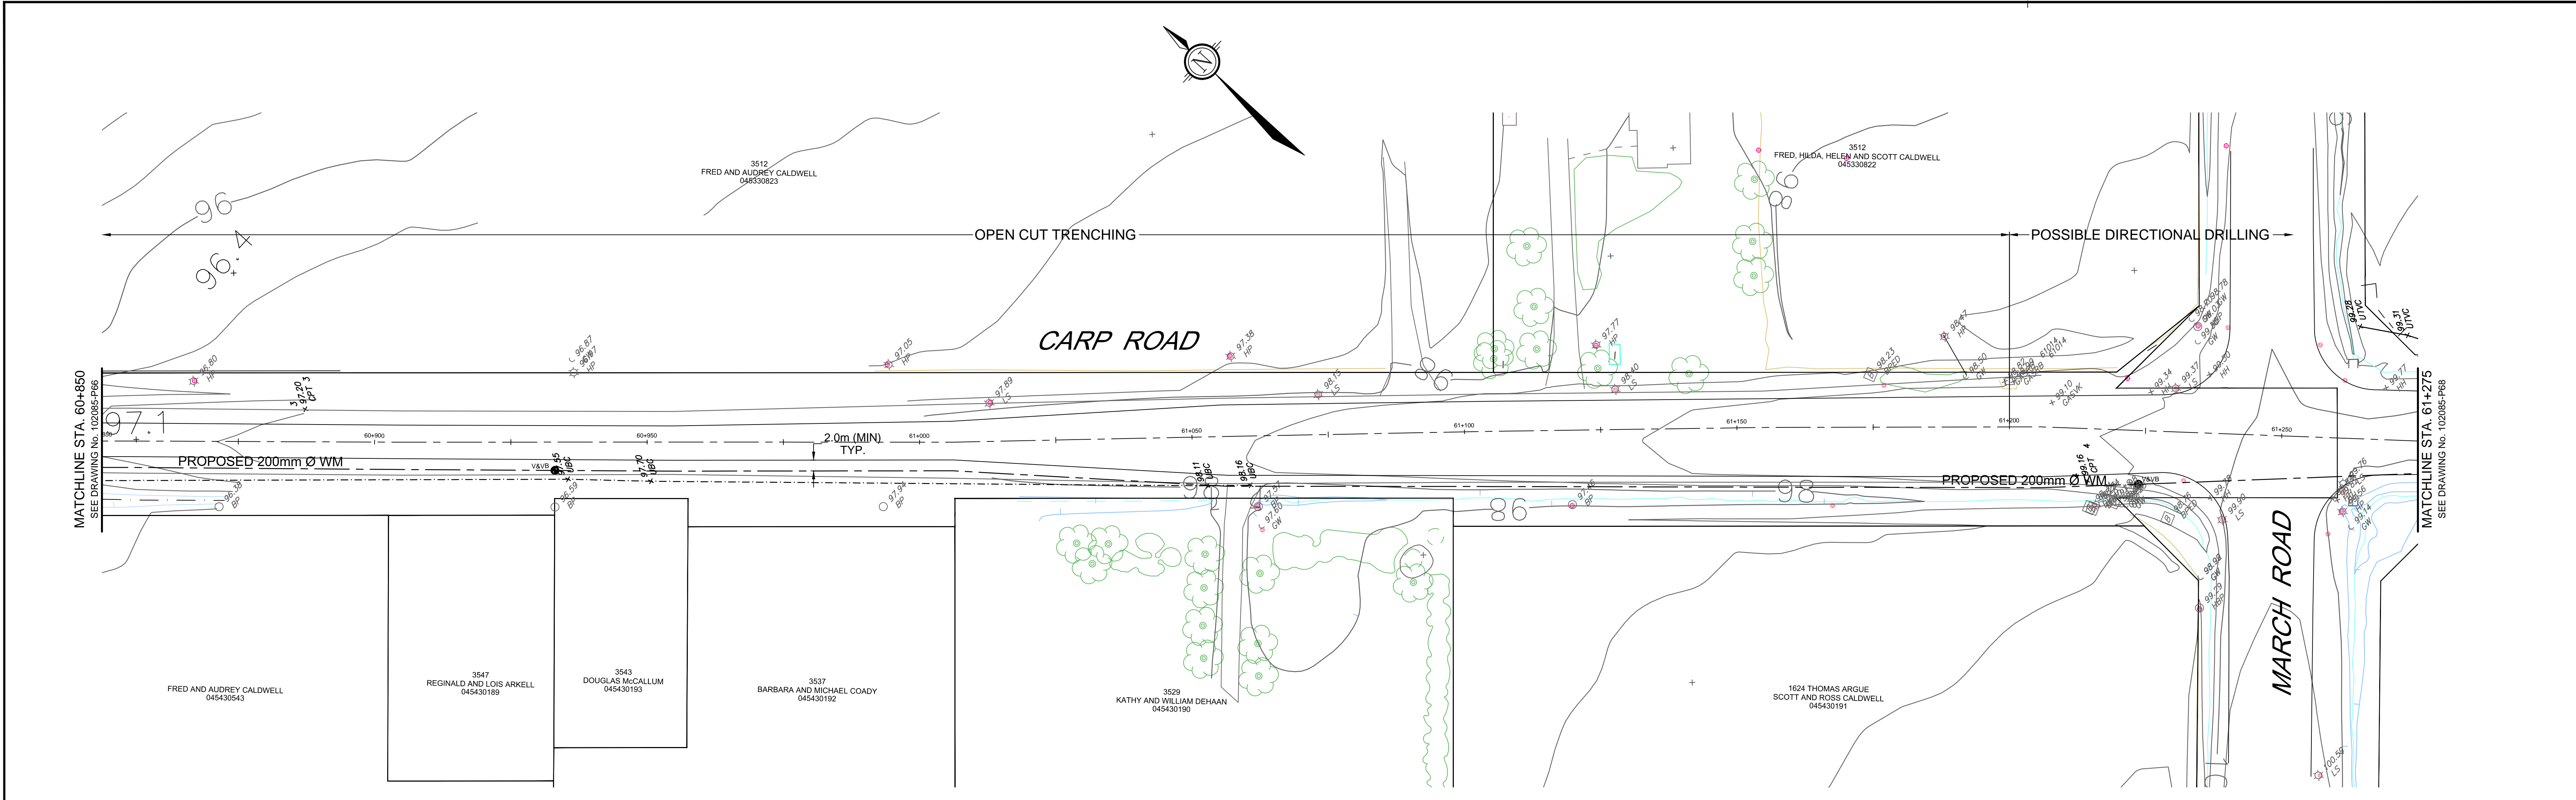

NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
6.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	OCT 15/14	DJC
5.	REVISED PER CITY/MVC COMMENTS	SEPT 26/13	DJC
4.	REVISED PER CITY/MVC COMMENTS	MAY 28/13	DJC
3.	ISSUED TO THE CITY OF OTTAWA	JUL 17/12	DJC
2.	REVISED AS PER CITY COMMENTS	MAR 8/12	DJC
1.	ISSUED FOR REVIEW	NOV 21/11	DJC

SCALE

HORIZONTAL
 0 5 10 15 20

VERTICAL
 0 0.5 1.0 1.5 2.0



DESIGN: HI
 CHECKED: SMG
 DRAWN: DJC
 CHECKED: LAB
 APPROVED: JR

FOR REVIEW ONLY


NOVATECH
 Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowland Drive
 Ottawa, Ontario, Canada K2M 3P6
 Telephone: (613) 254-9643
 Facsimile: (613) 254-5867
 Website: www.novatech-eng.com

CITY OF OTTAWA
 WEST CAPITAL AIRPARK
 PLAN AND PROFILE OF
 CARP ROAD
 STATION 60+850 TO 61+275

PROJECT No.: 102085-01
 REV # 6
 DRAWING No.: 102085-P67

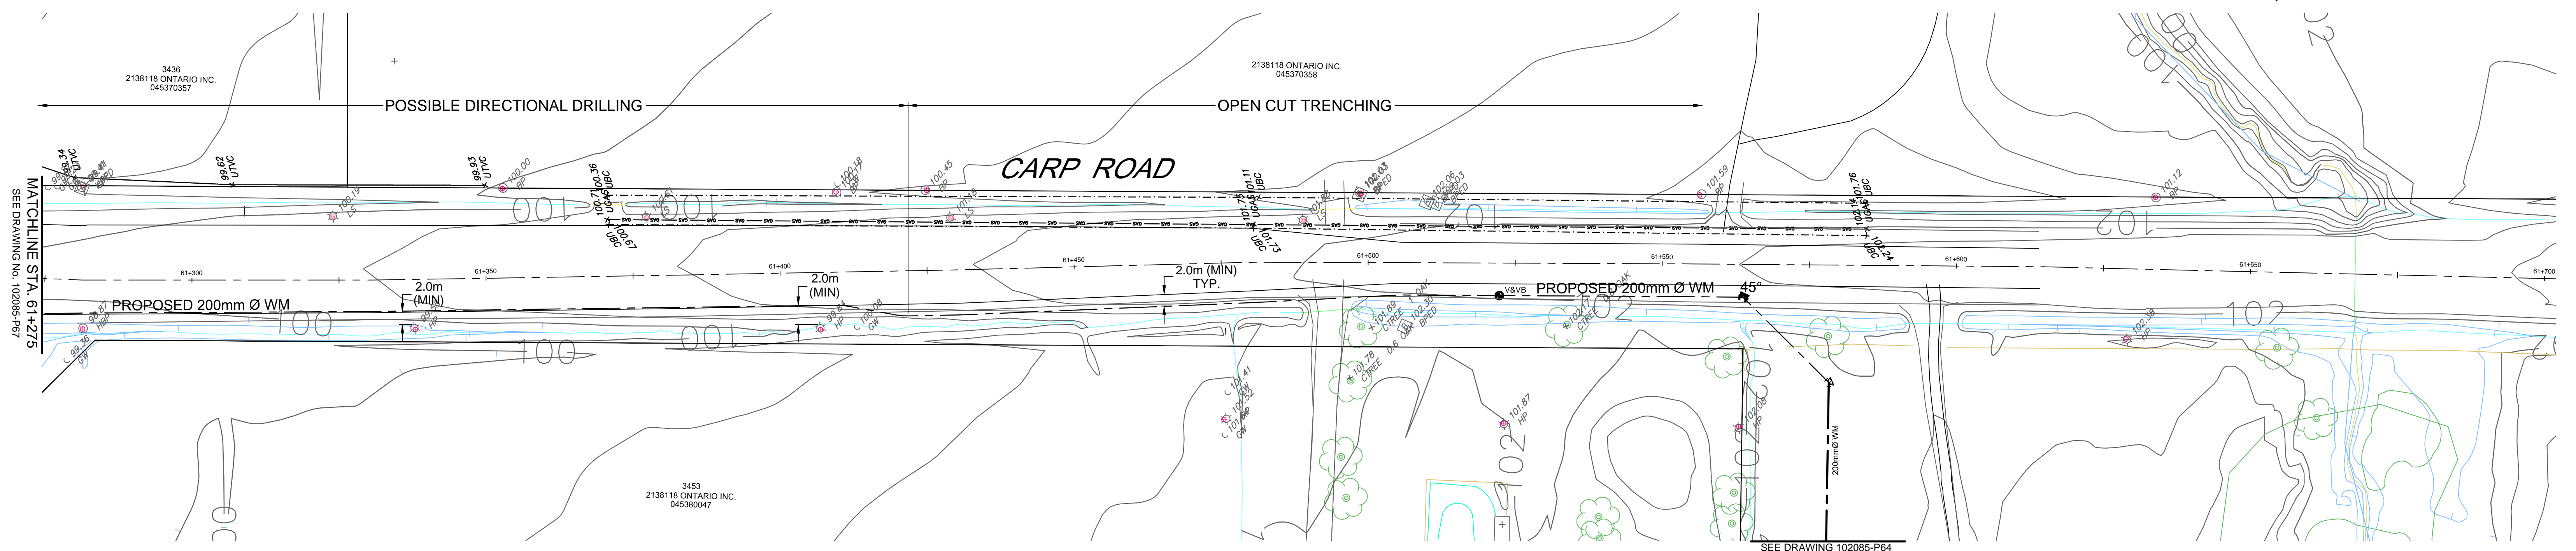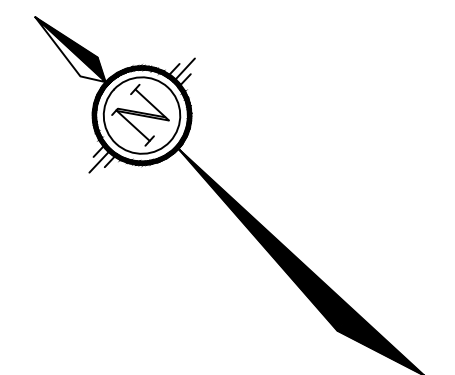

WEST CAPITAL AIRPARK

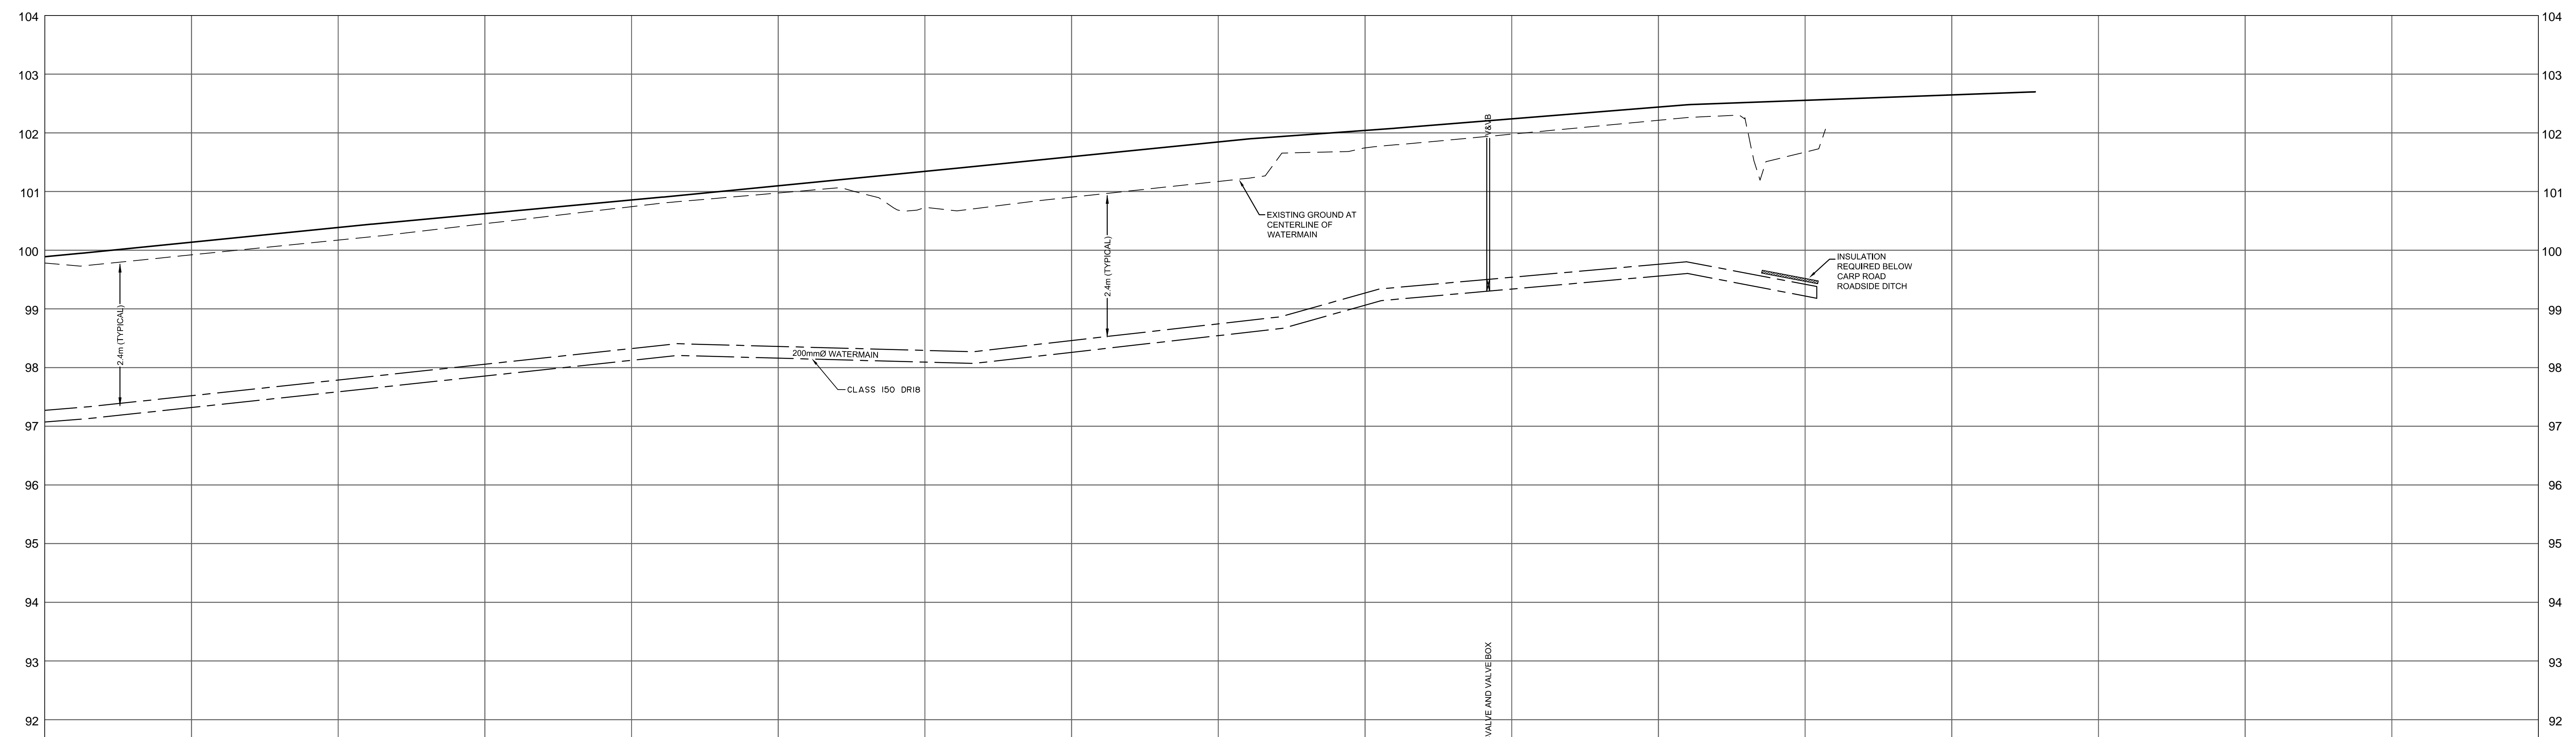


EXISTING CL ROAD ELEV.	99.89	100.14	100.39	100.62	100.86	101.10	101.34	101.59	101.84	102.04	102.24	102.44	102.65	102.85	103.05	103.25	103.45	103.65	103.85	104.05	EXISTING CL ROAD ELEV.
EXISTING ELEV. AT CL WM	99.79	99.52	100.17	100.45	100.74	100.97	101.21	101.39	101.17	101.74	101.69	102.21	101.67								EXISTING ELEV. AT CL WM
TOP OF WM ELEVATION	97.27	97.52	97.79	98.06	98.32	98.36	98.29	98.46	98.74	99.27	98.50	98.54	98.42								TOP OF WM ELEVATION
CHAINAGE	61+275	61+300	61+325	61+350	61+375	61+400	61+425	61+450	61+475	61+500	61+521	61+525	61+550	61+575	61+600	61+625	61+650	61+675	61+700		CHAINAGE

C:\Users\jgri\OneDrive\Documents\102085-1\CD\Drawings\102085_P68.dwg, Plot Date: Nov 19, 2014, 3:57pm, eacody


NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.



No.	REVISION	DATE	BY
6.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	OCT 15/14	DJC
5.	REVISED PER CITY/MVC COMMENTS	SEPT 26/13	DJC
4.	REVISED PER CITY/MVC COMMENTS	MAY 28/13	DJC
3.	ISSUED TO THE CITY OF OTTAWA	JUL 17/12	DJC
2.	REVISED AS PER CITY COMMENTS	MAR 8/12	DJC
1.	ISSUED FOR REVIEW	NOV 21/11	DJC

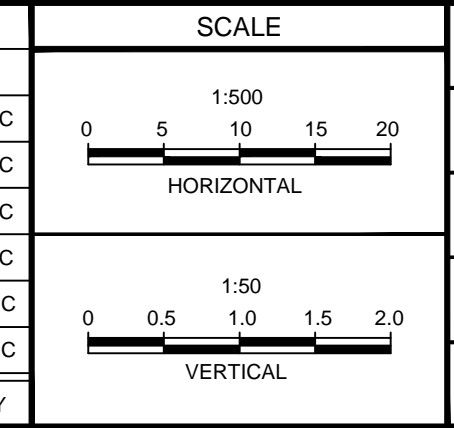






DESIGN	HI
CHECKED	SMG
DRAWN	DJC
CHECKED	LAB
APPROVED	JGR

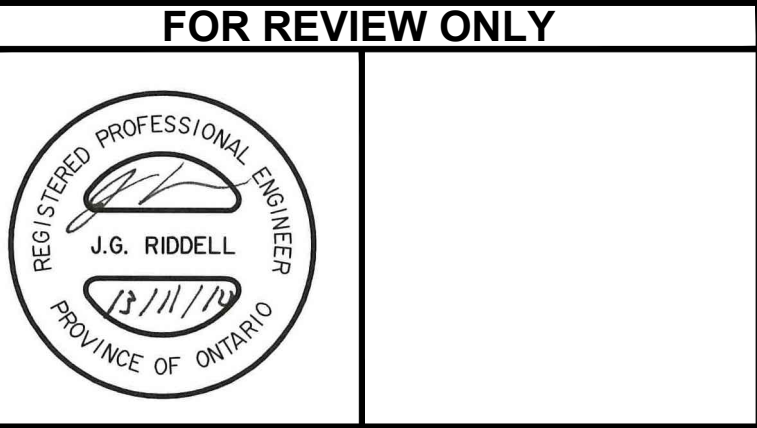

CITY OF OTTAWA
 WEST CAPITAL AIRPARK
 PLAN AND PROFILE OF
 CARP ROAD
 STATION 61+275 TO 61+700



PROJECT No.	102085-01
REV	REV # 6
DRAWING No.	102085-P68

NOTES:
 1) N.O. = NORMALLY OPEN N.C. = NORMALLY CLOSE
 2) PROVIDE 500 BALL VALVES AT HIGH & LOW POINTS OF EACH SECTION OF WATERMAIN WHICH CAN BE ISOLATED.

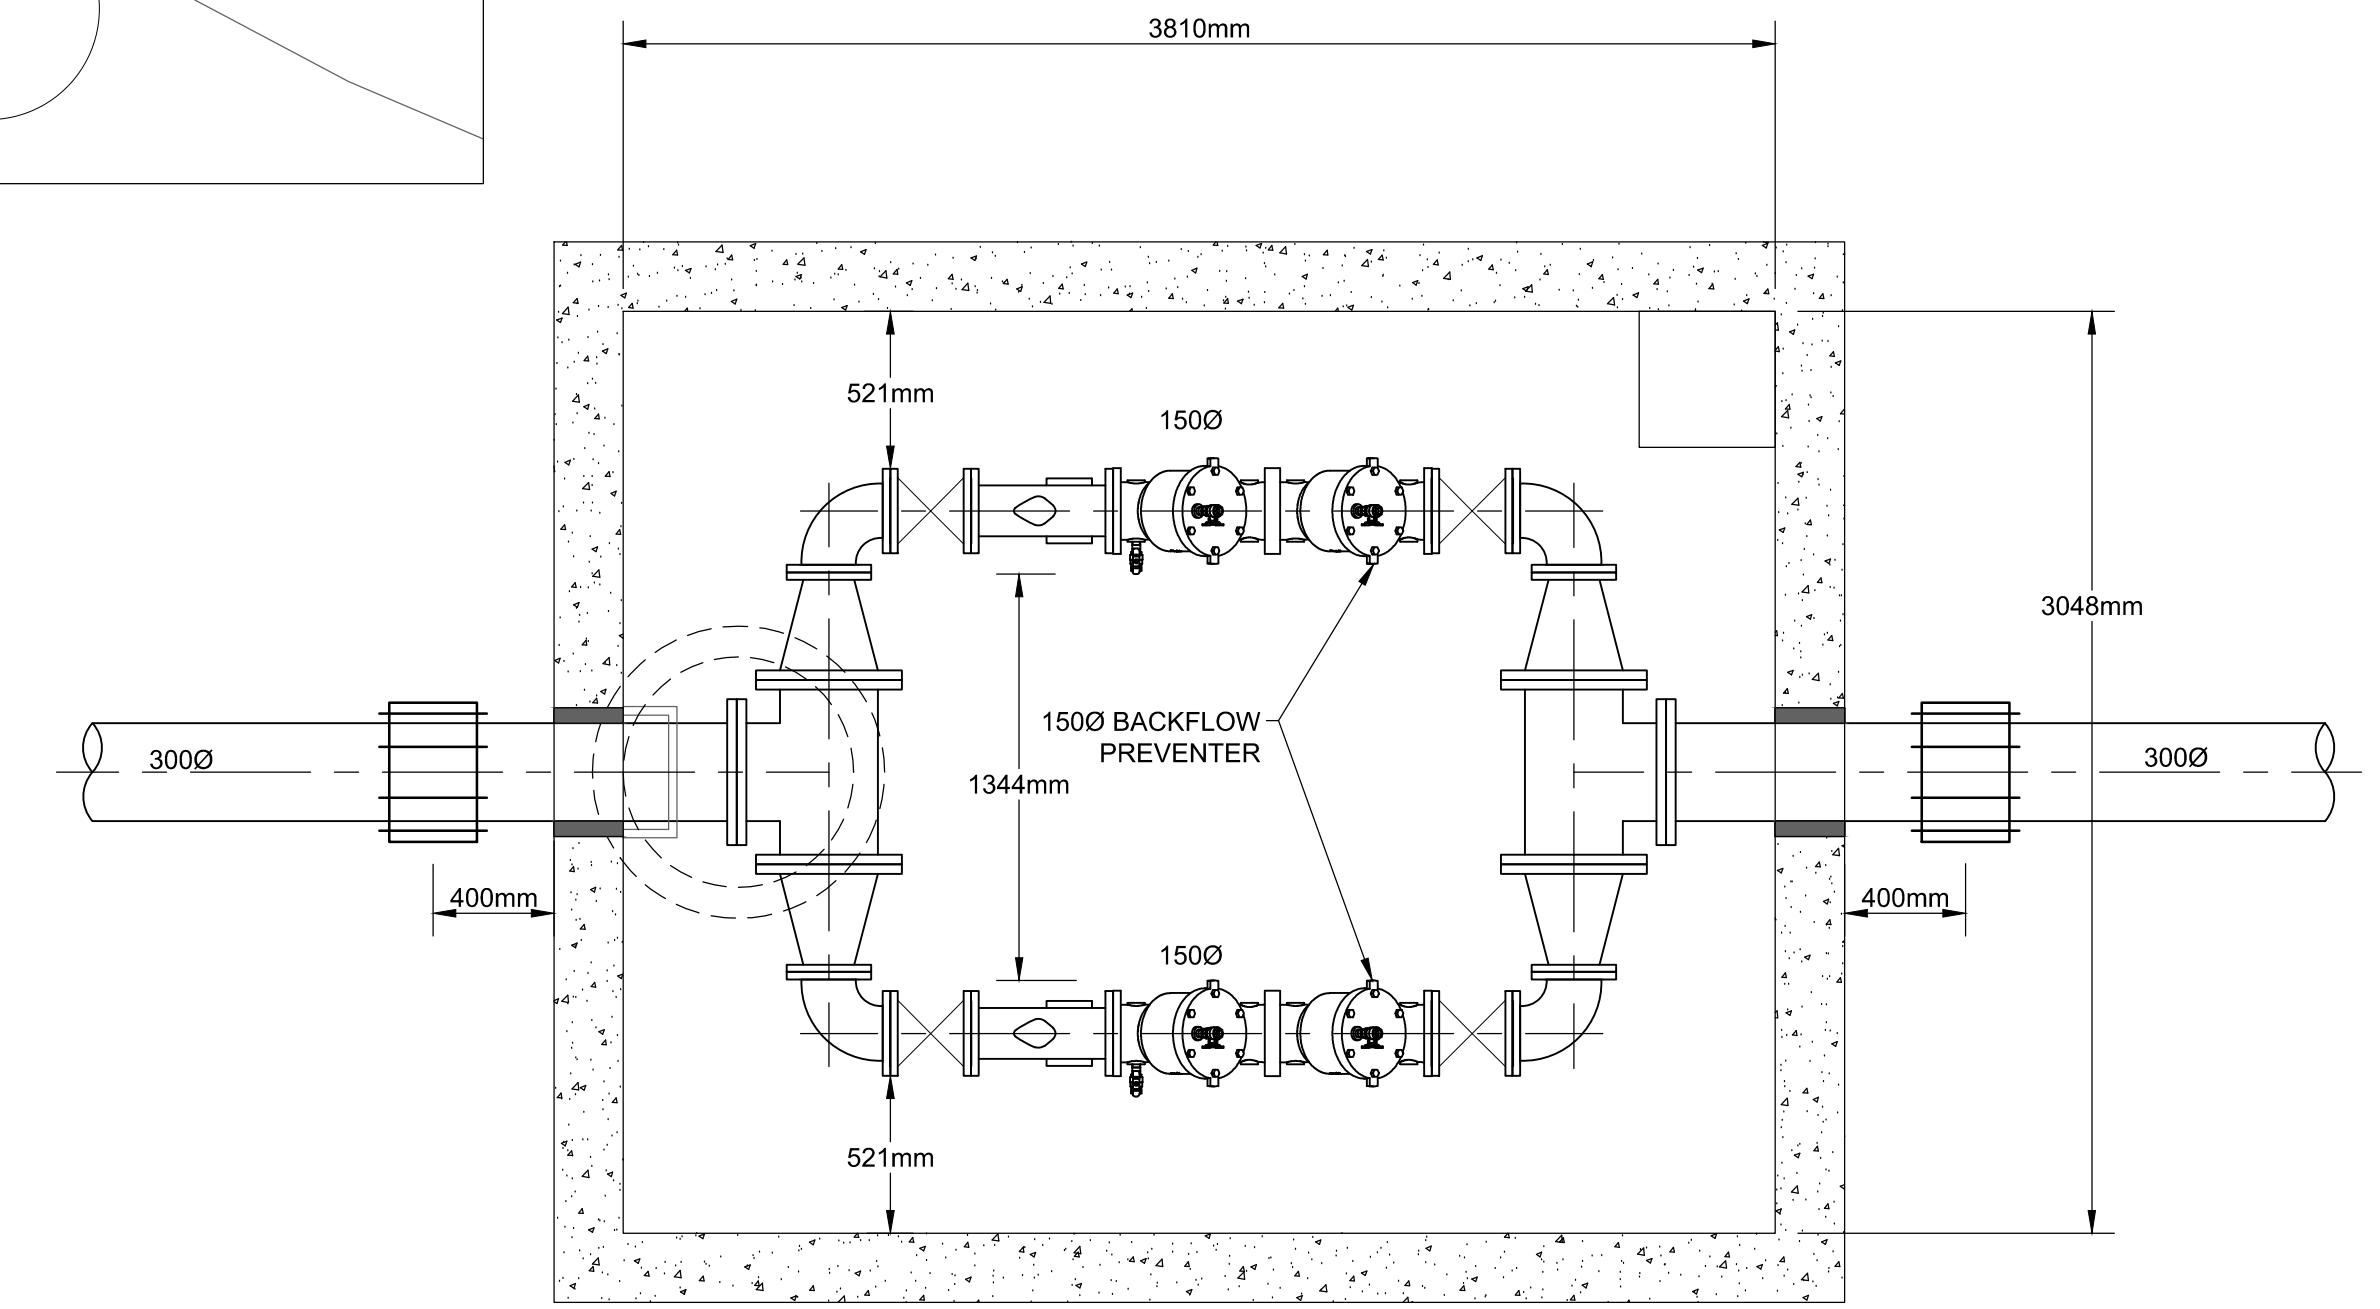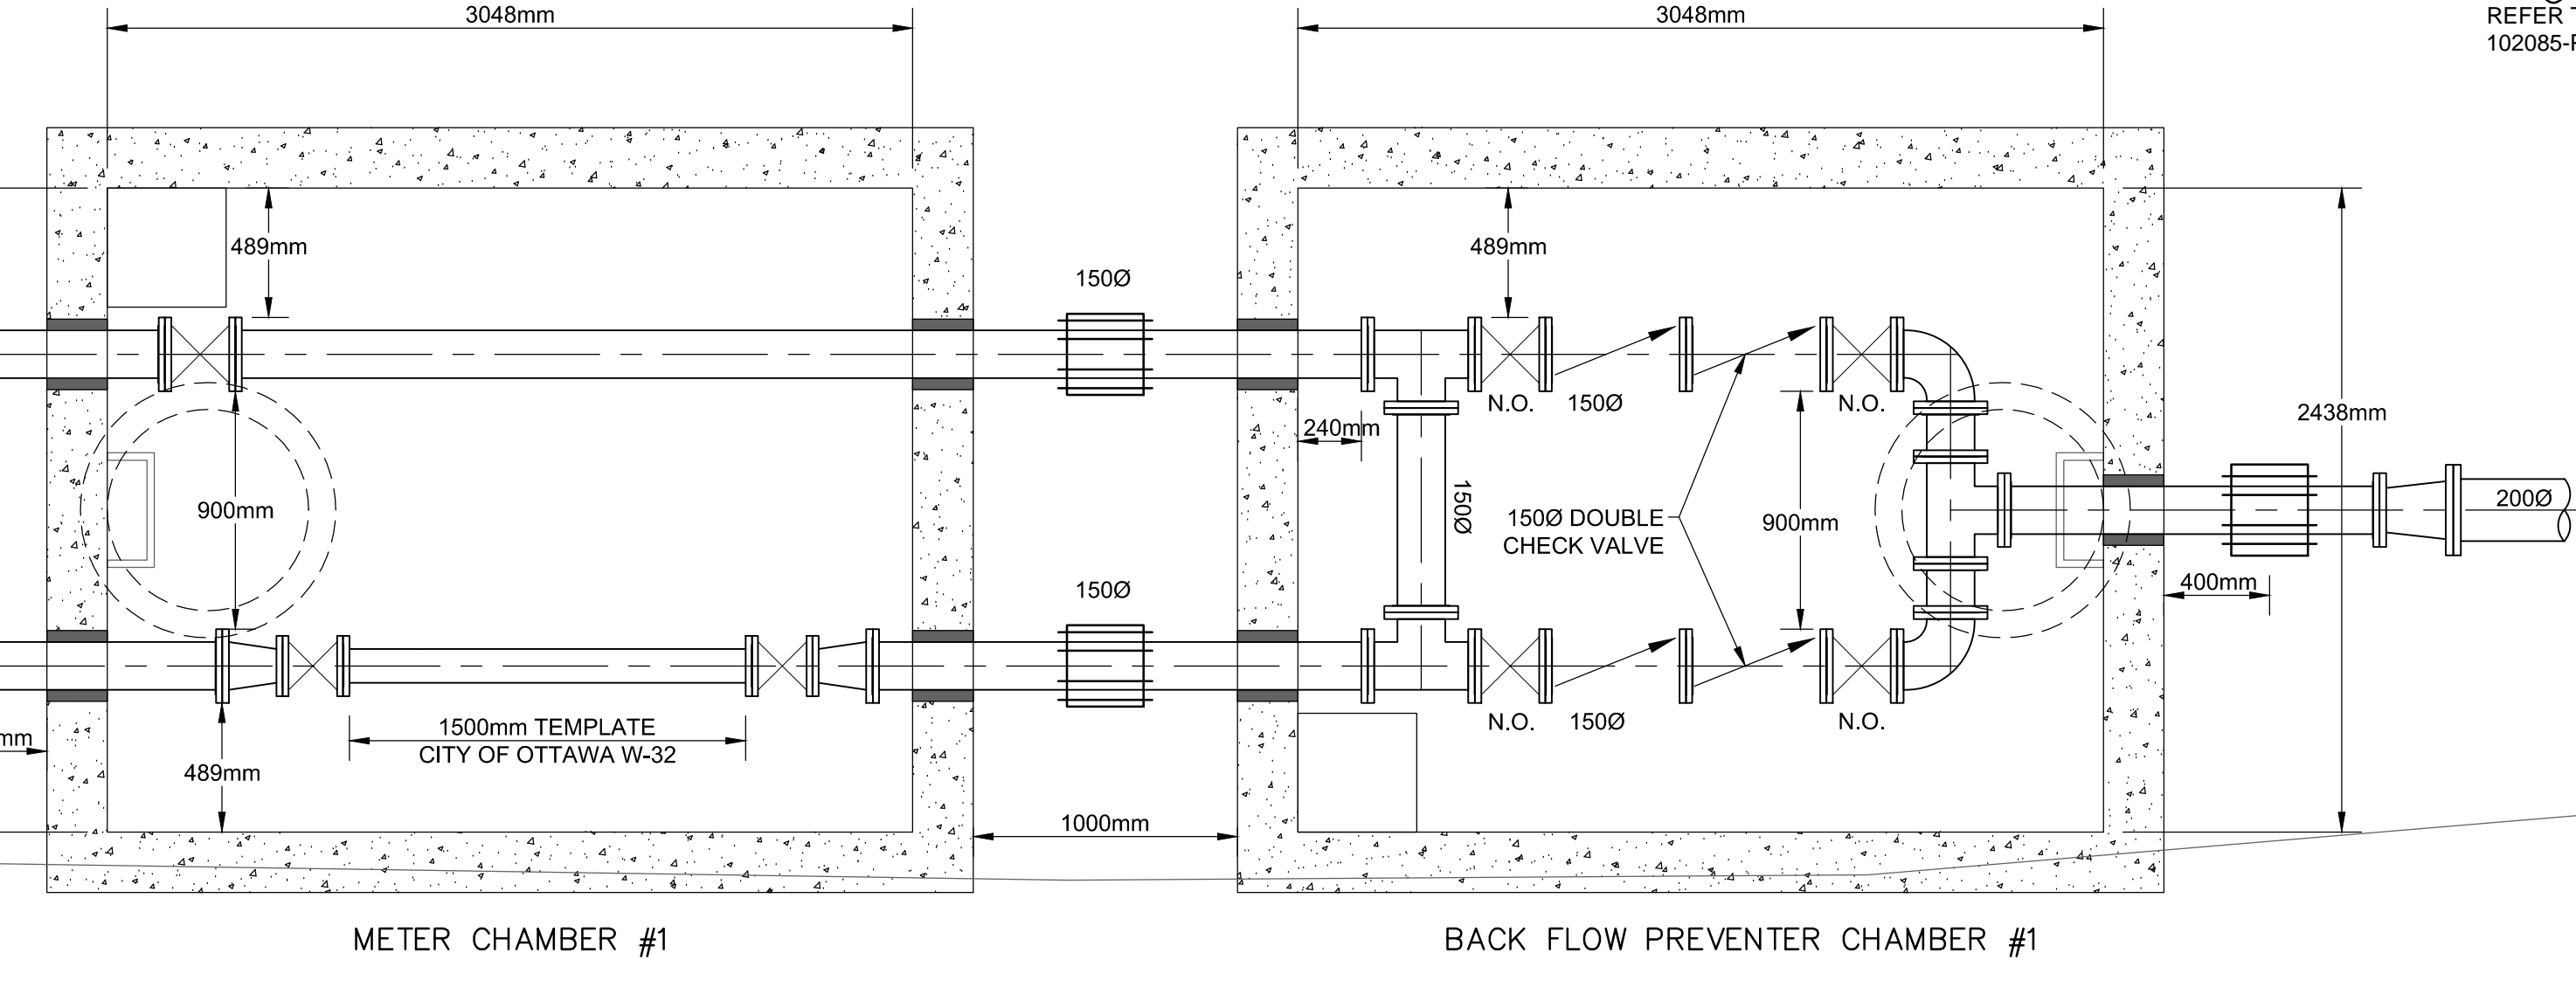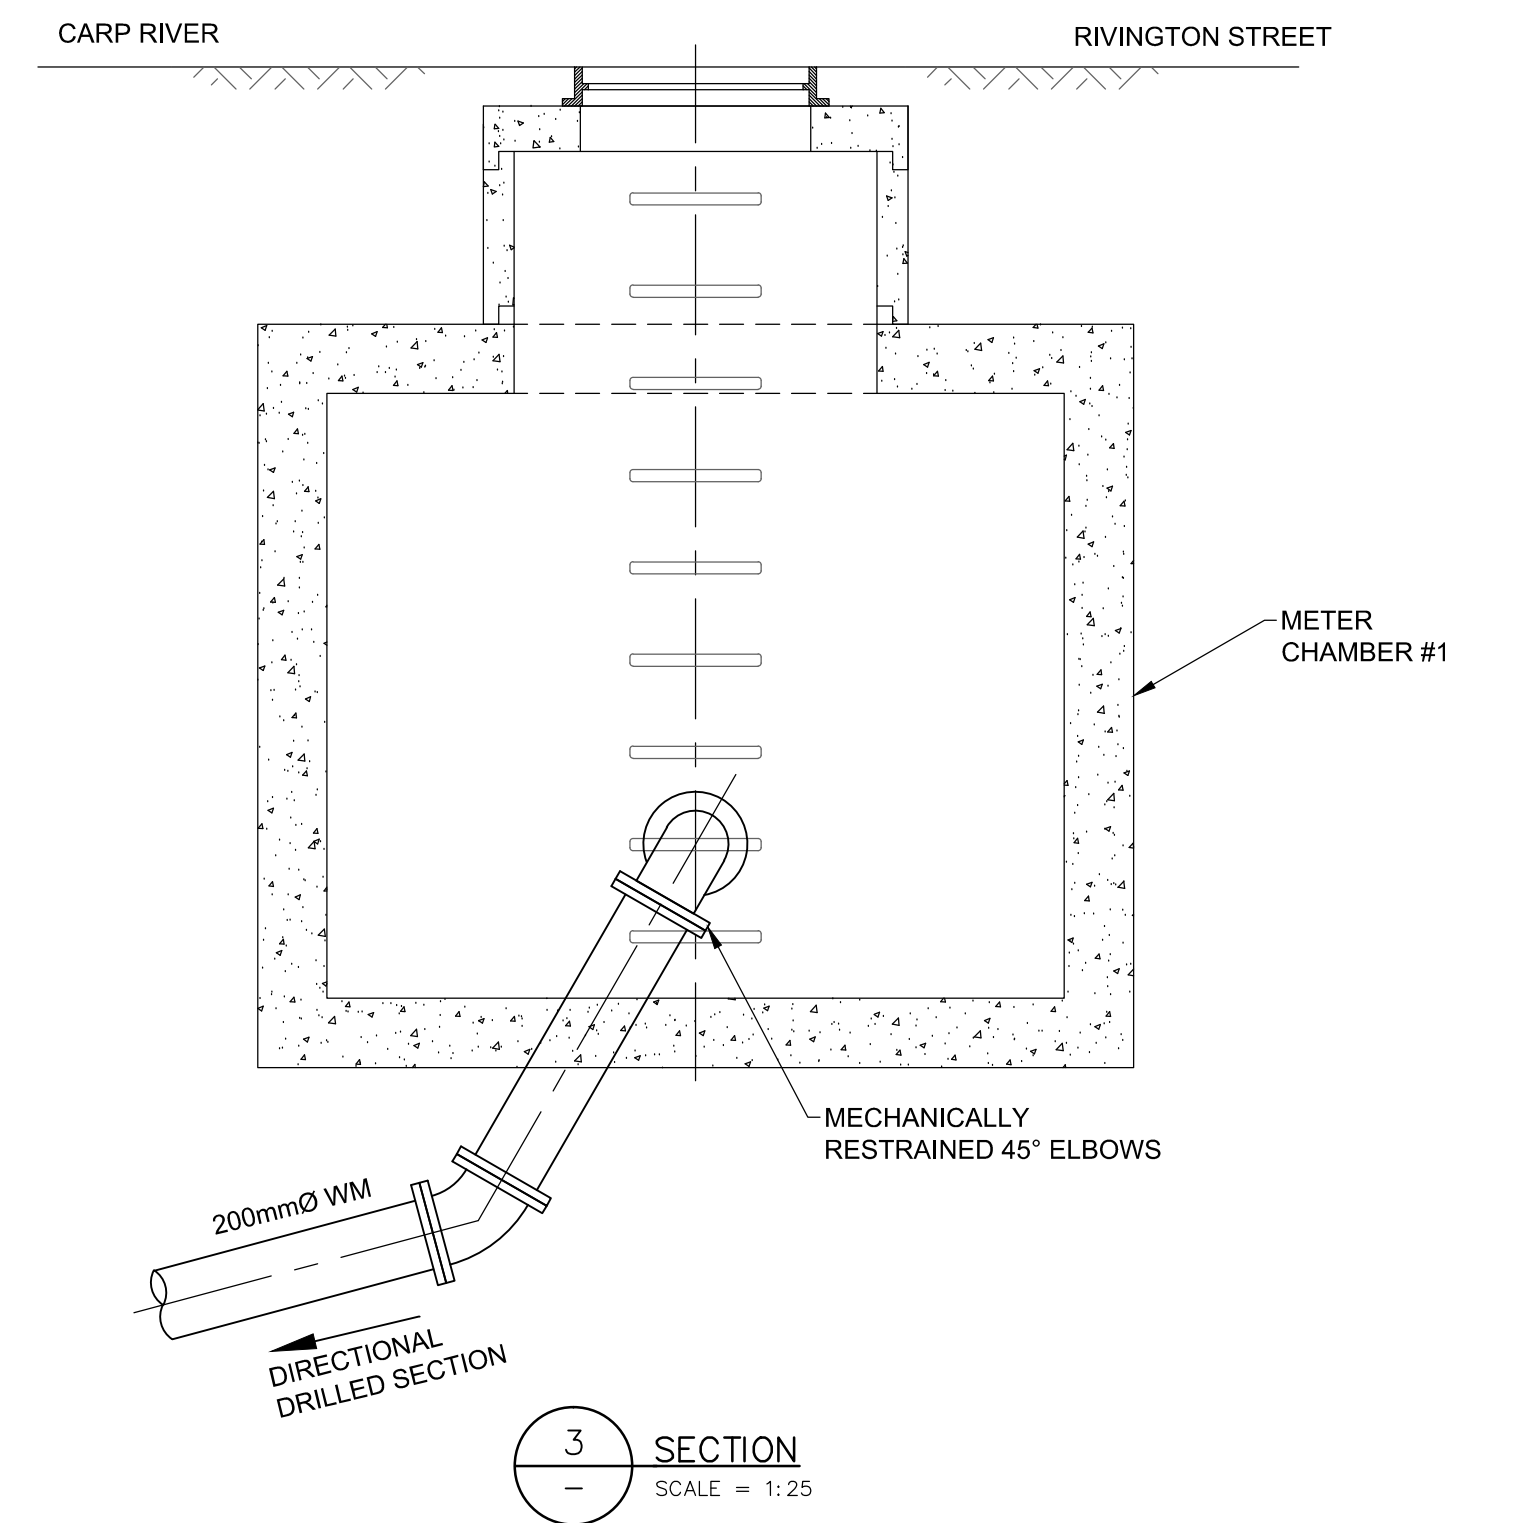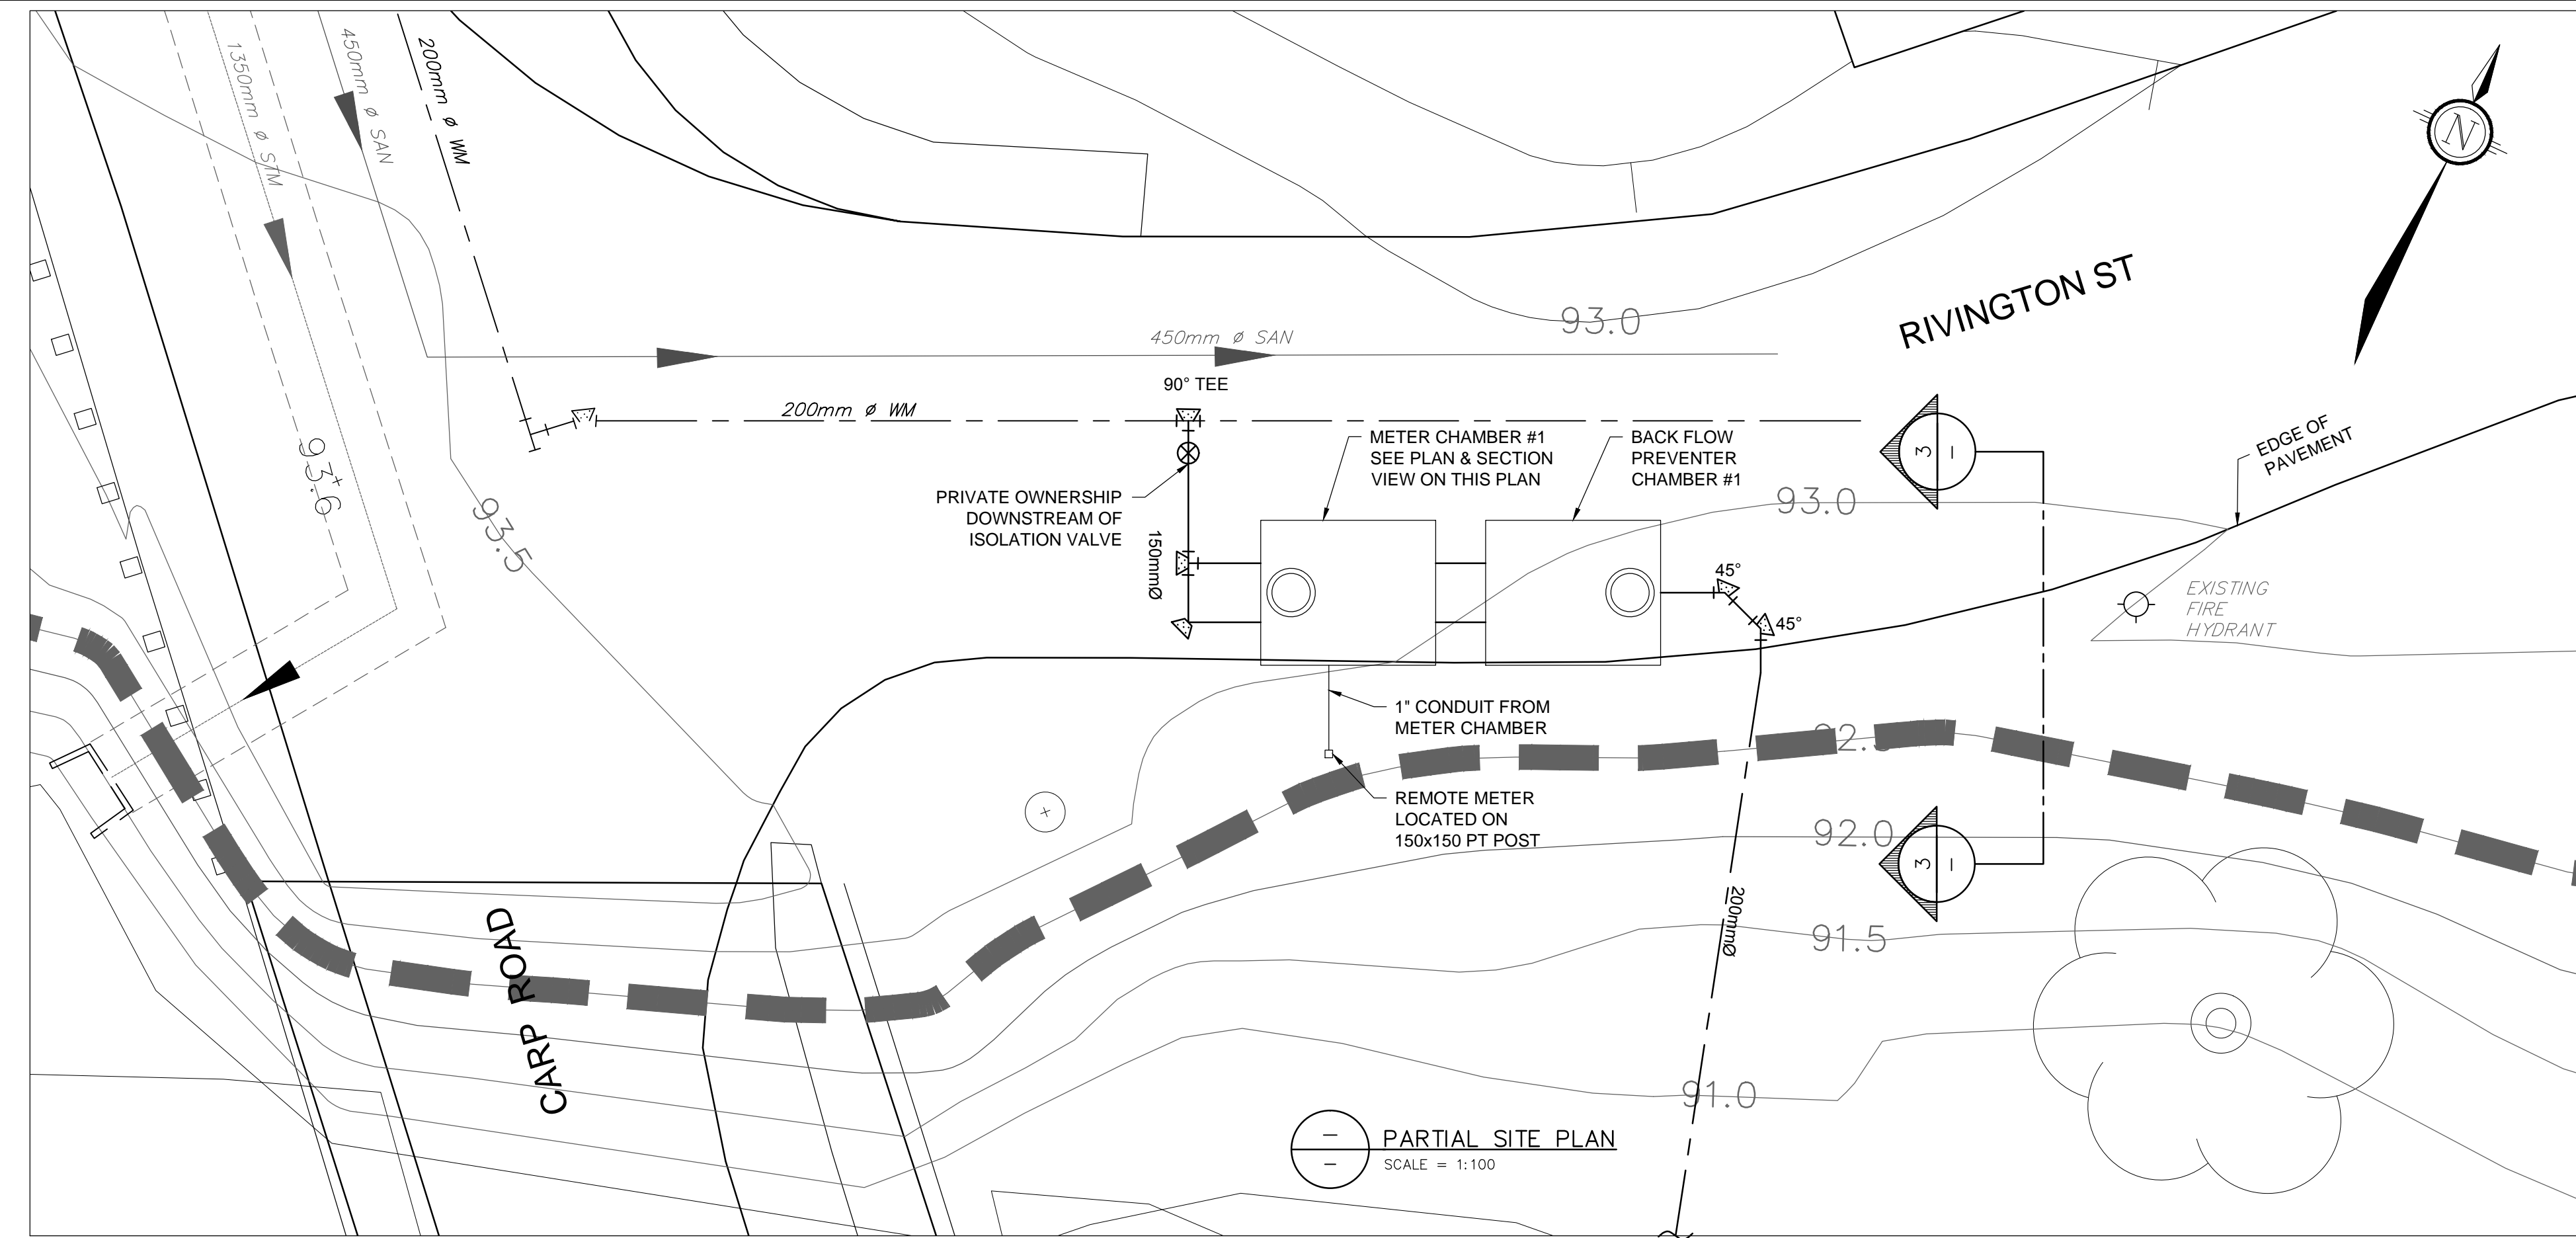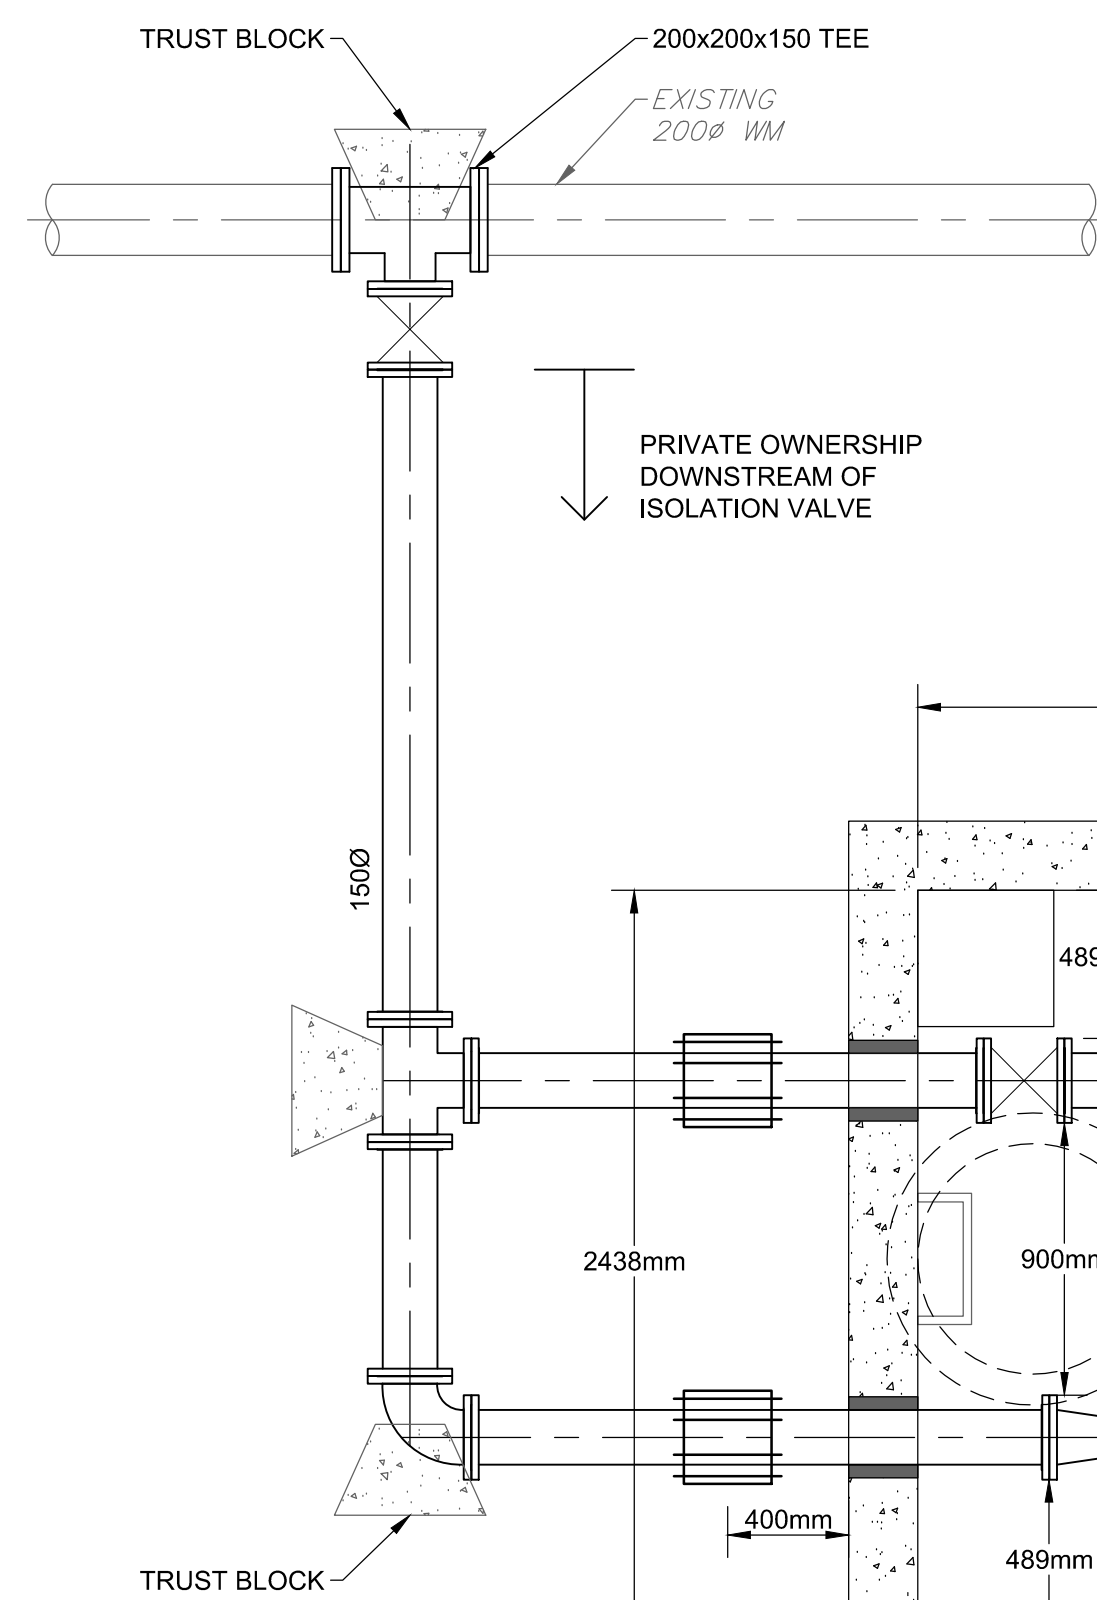

1 CHAMBERS - PLAN VIEW
 SCALE = 1:25

4 BACKFLOW PREVENTER CHAMBER #2 - PLAN VIEW
 SCALE = 1:25 REFER TO DRAWING 102085-P63 FOR LOCATION

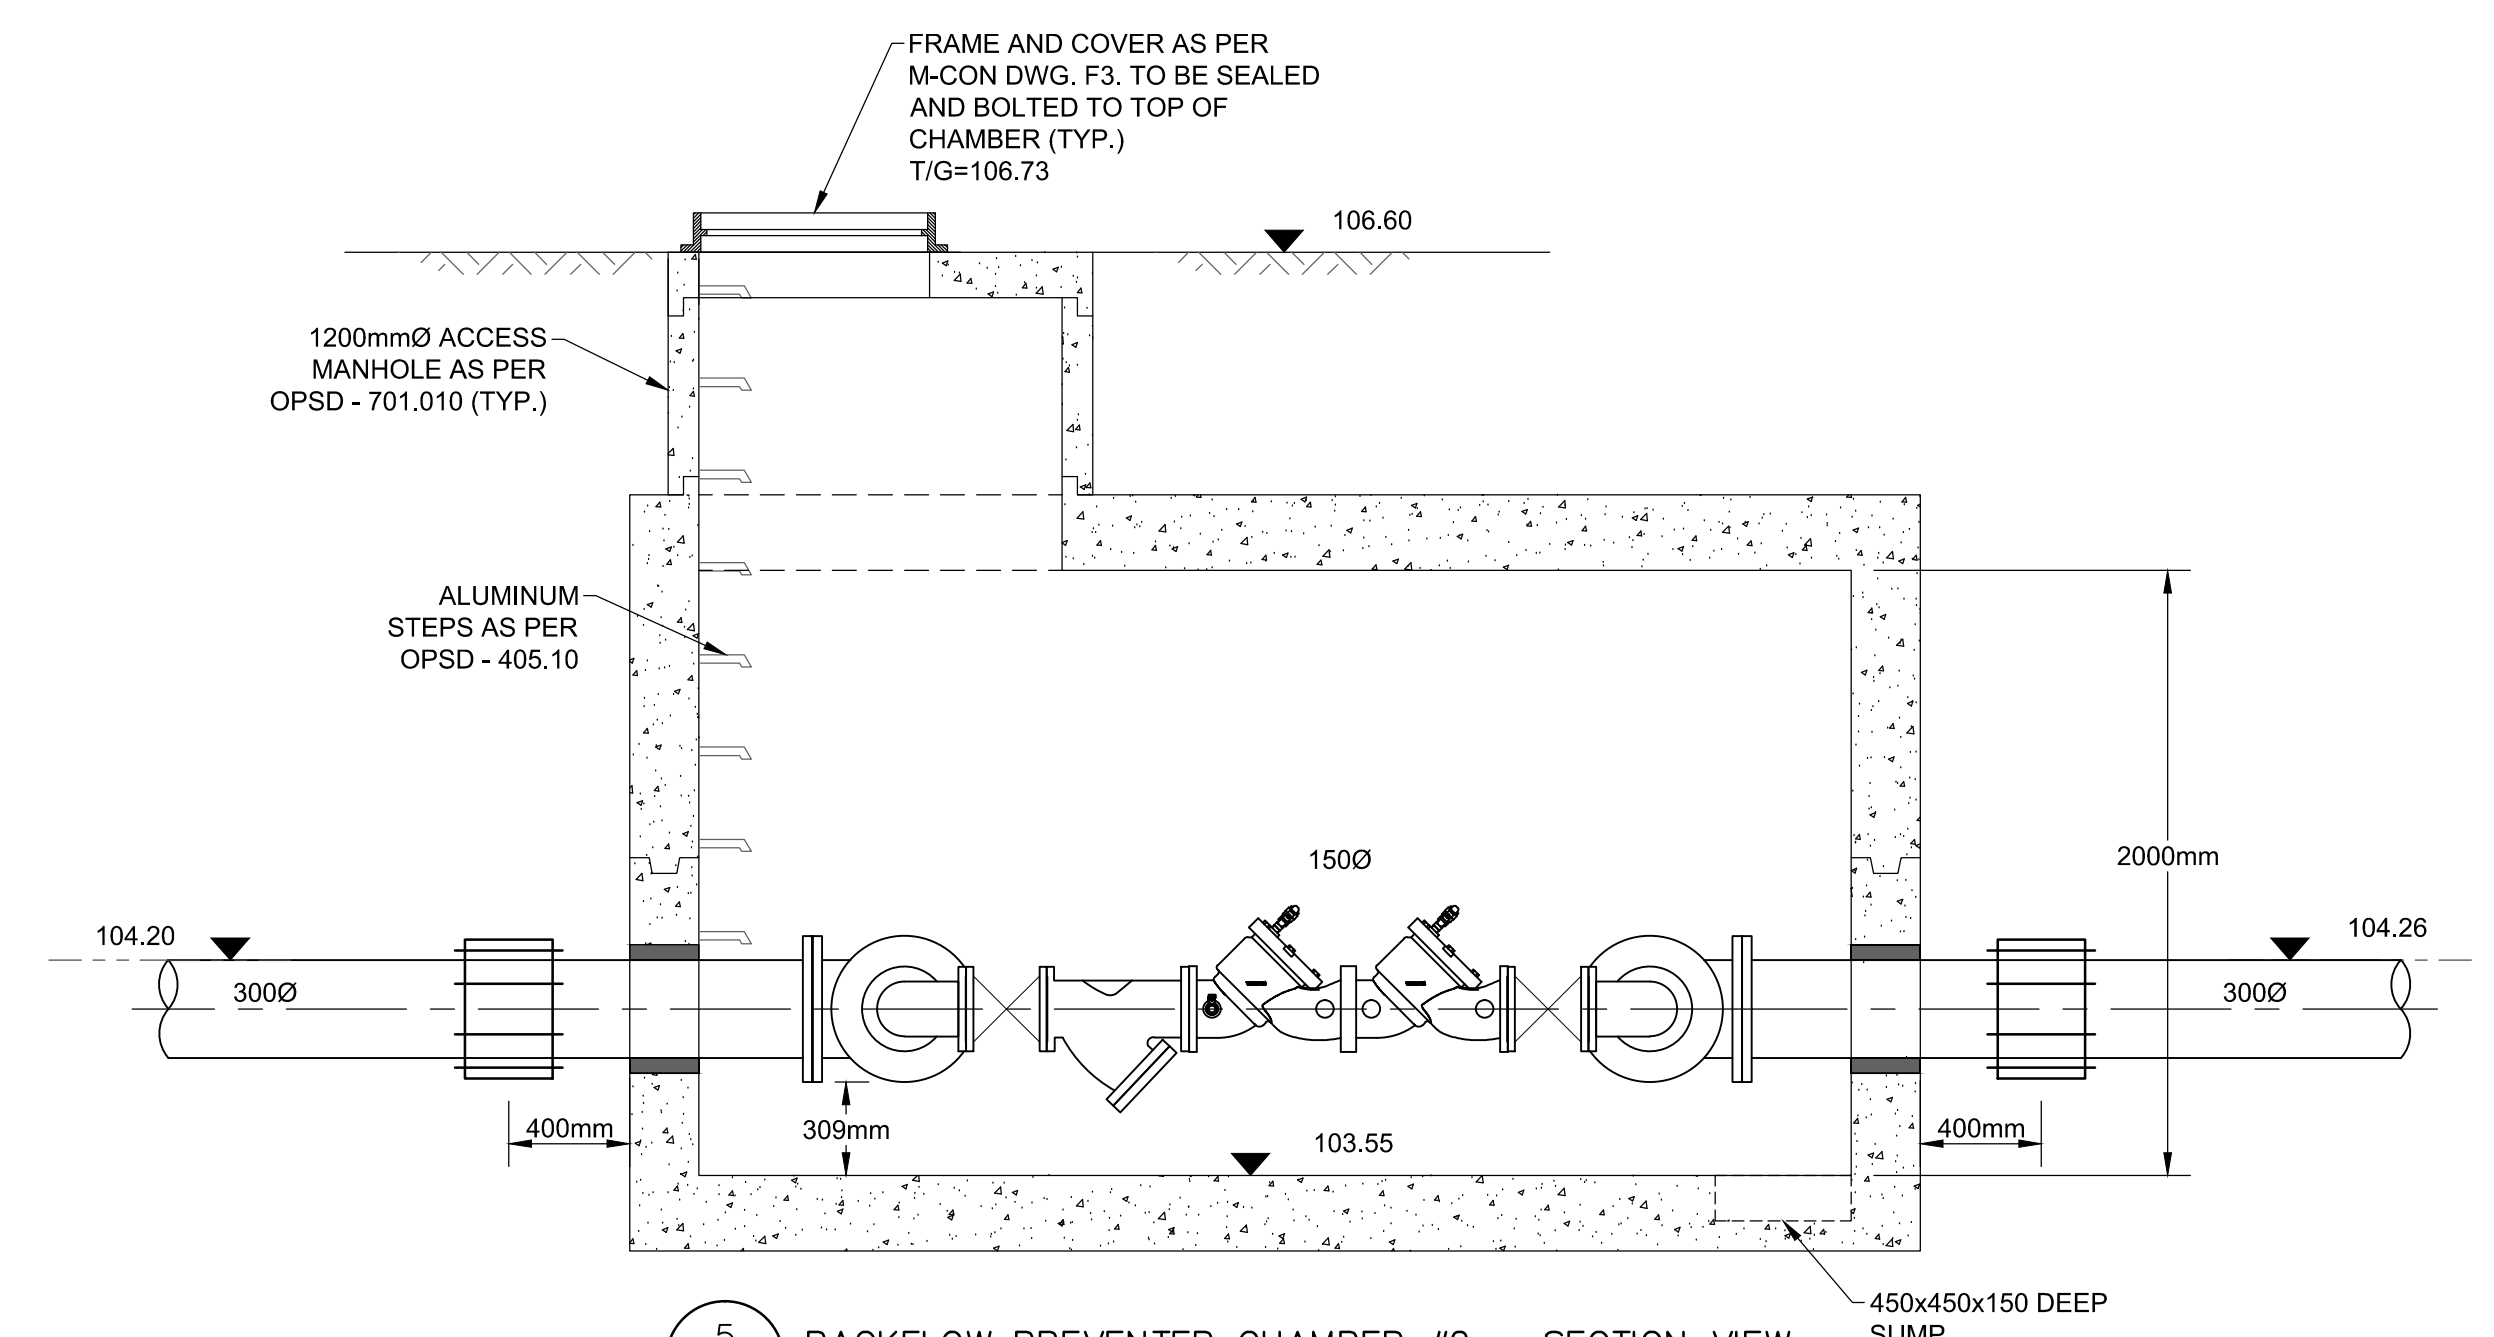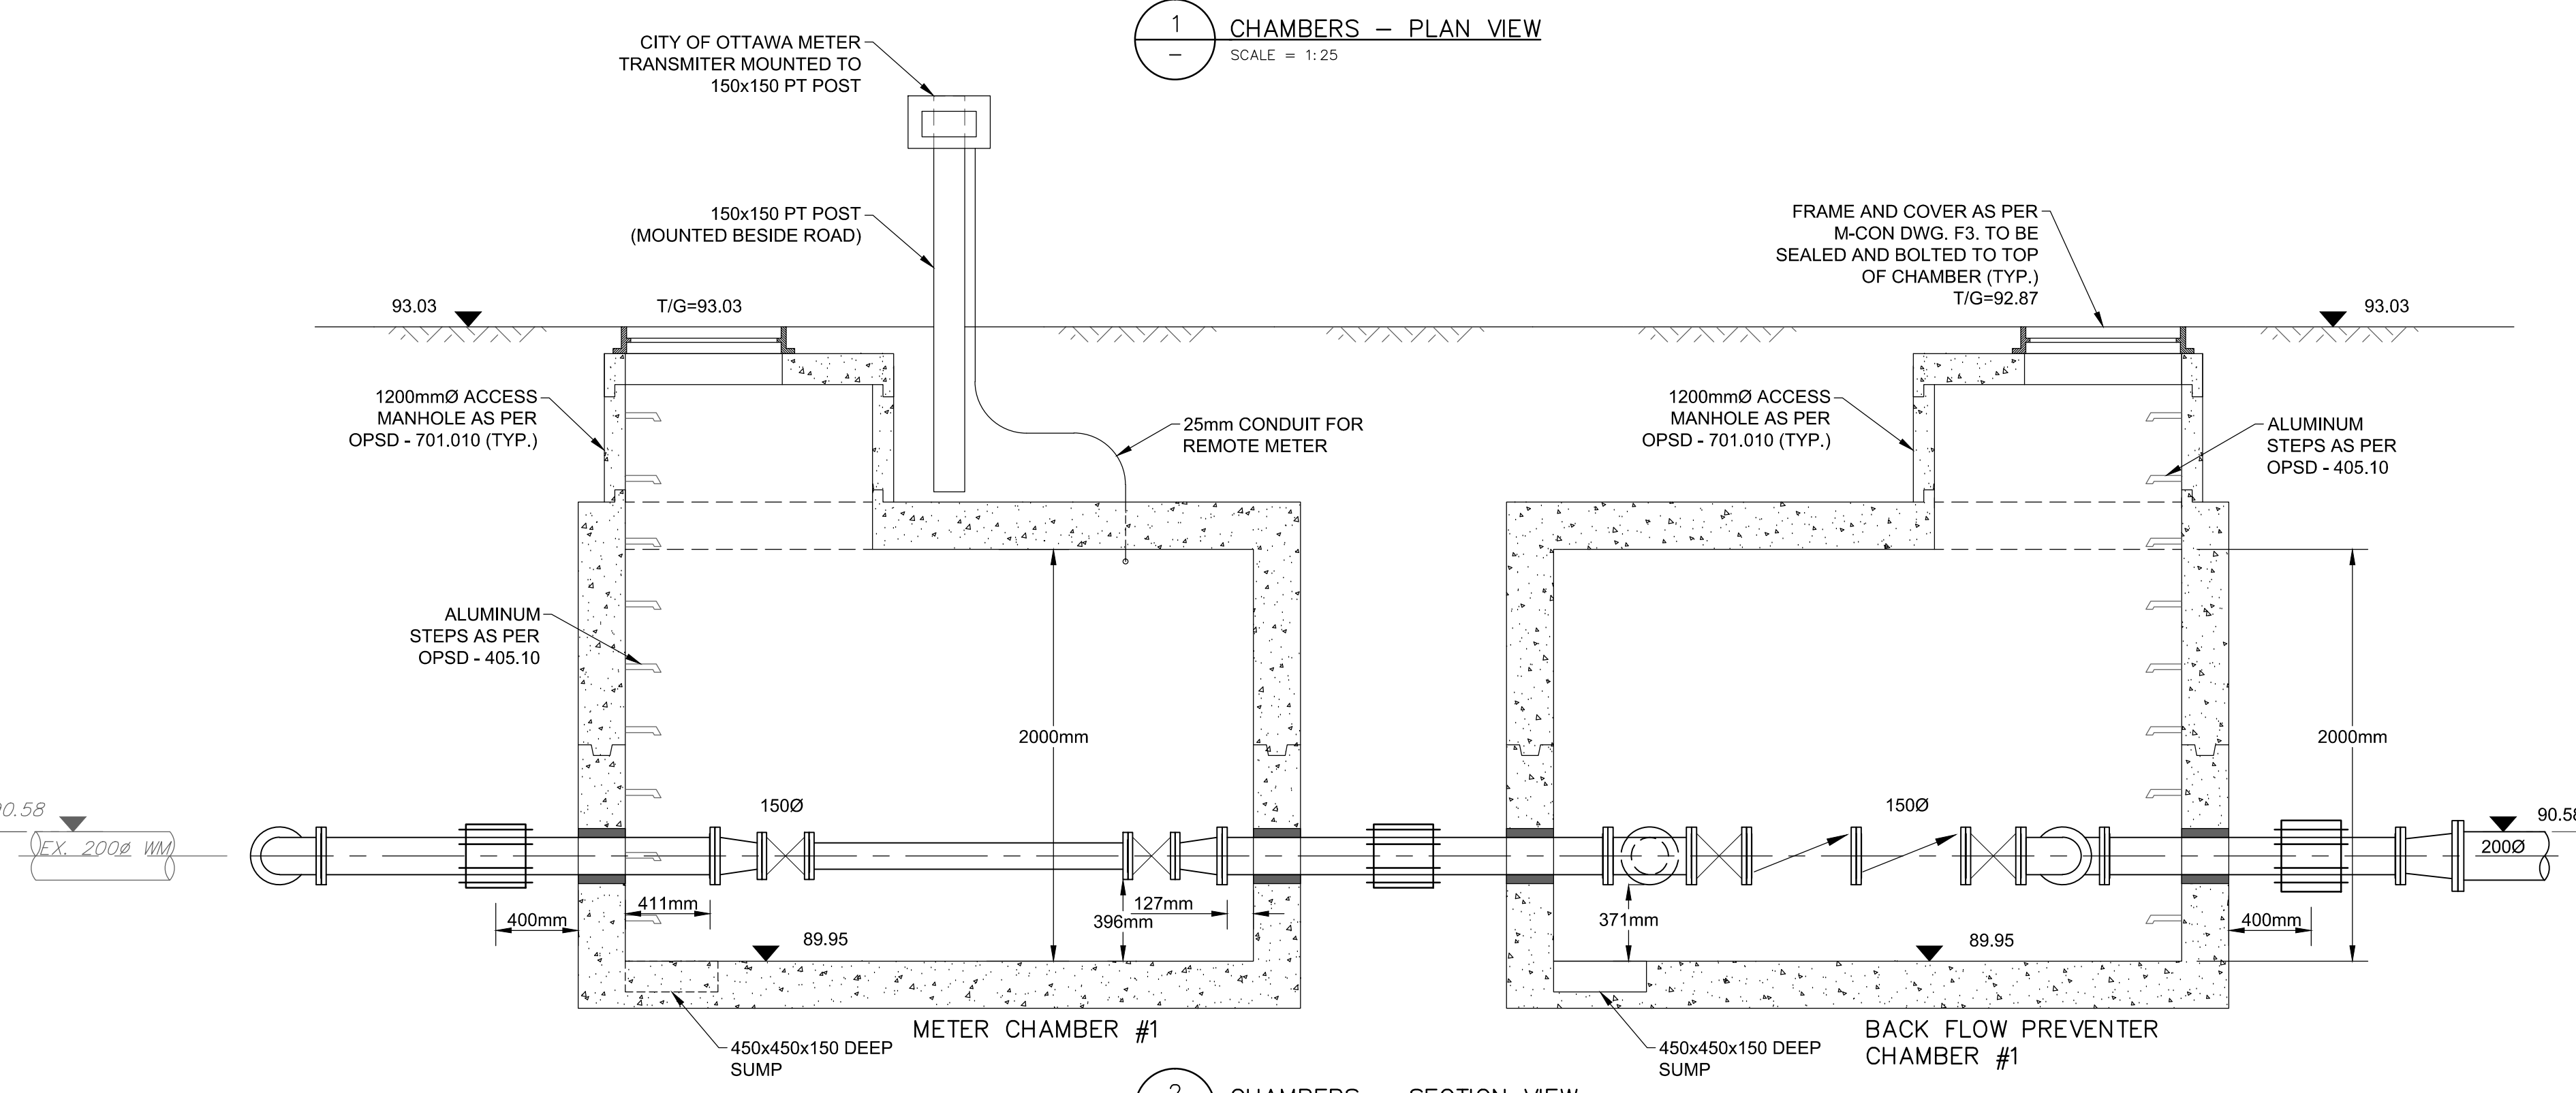


2 CHAMBERS - SECTION VIEW
 SCALE = 1:25

5 BACKFLOW PREVENTER CHAMBER #2 - SECTION VIEW
 SCALE = 1:25 REFER TO DRAWING 102085-P63 FOR LOCATION

NOTE:
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
6.	ISSUED FOR PHASE 1 RESIDENTIAL REGISTRATION	OCT 15/14	DJC
5.	REVISED PER CITY COMMENTS	SEPT 26/13	CJS
4.	REVISED PER CITY/MVC COMMENTS	MAY 28/13	CJS
3.	ISSUED TO THE CITY OF OTTAWA	JUL 17/12	CJS
2.	REVISED AS PER CITY COMMENTS	MAR. 8/12	BBH
1.	ISSUED FOR REVIEW	NOV. 21/2011	CJS

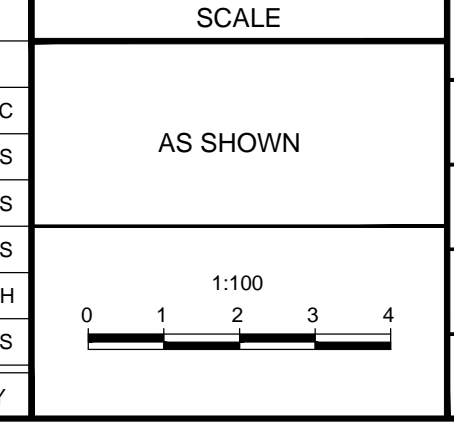


DESIGN: CJS
 CHECKED: CJS
 DRAWN: LLW
 CHECKED: CJS
 APPROVED: CJS

FOR REVIEW ONLY



CITY OF OTTAWA
 WEST CAPITAL AIRPARK
 WATERMAIN DETAILS PLAN

PROJECT No.	102085-01
REV	REV # 6
DRAWING No.	102085-D7

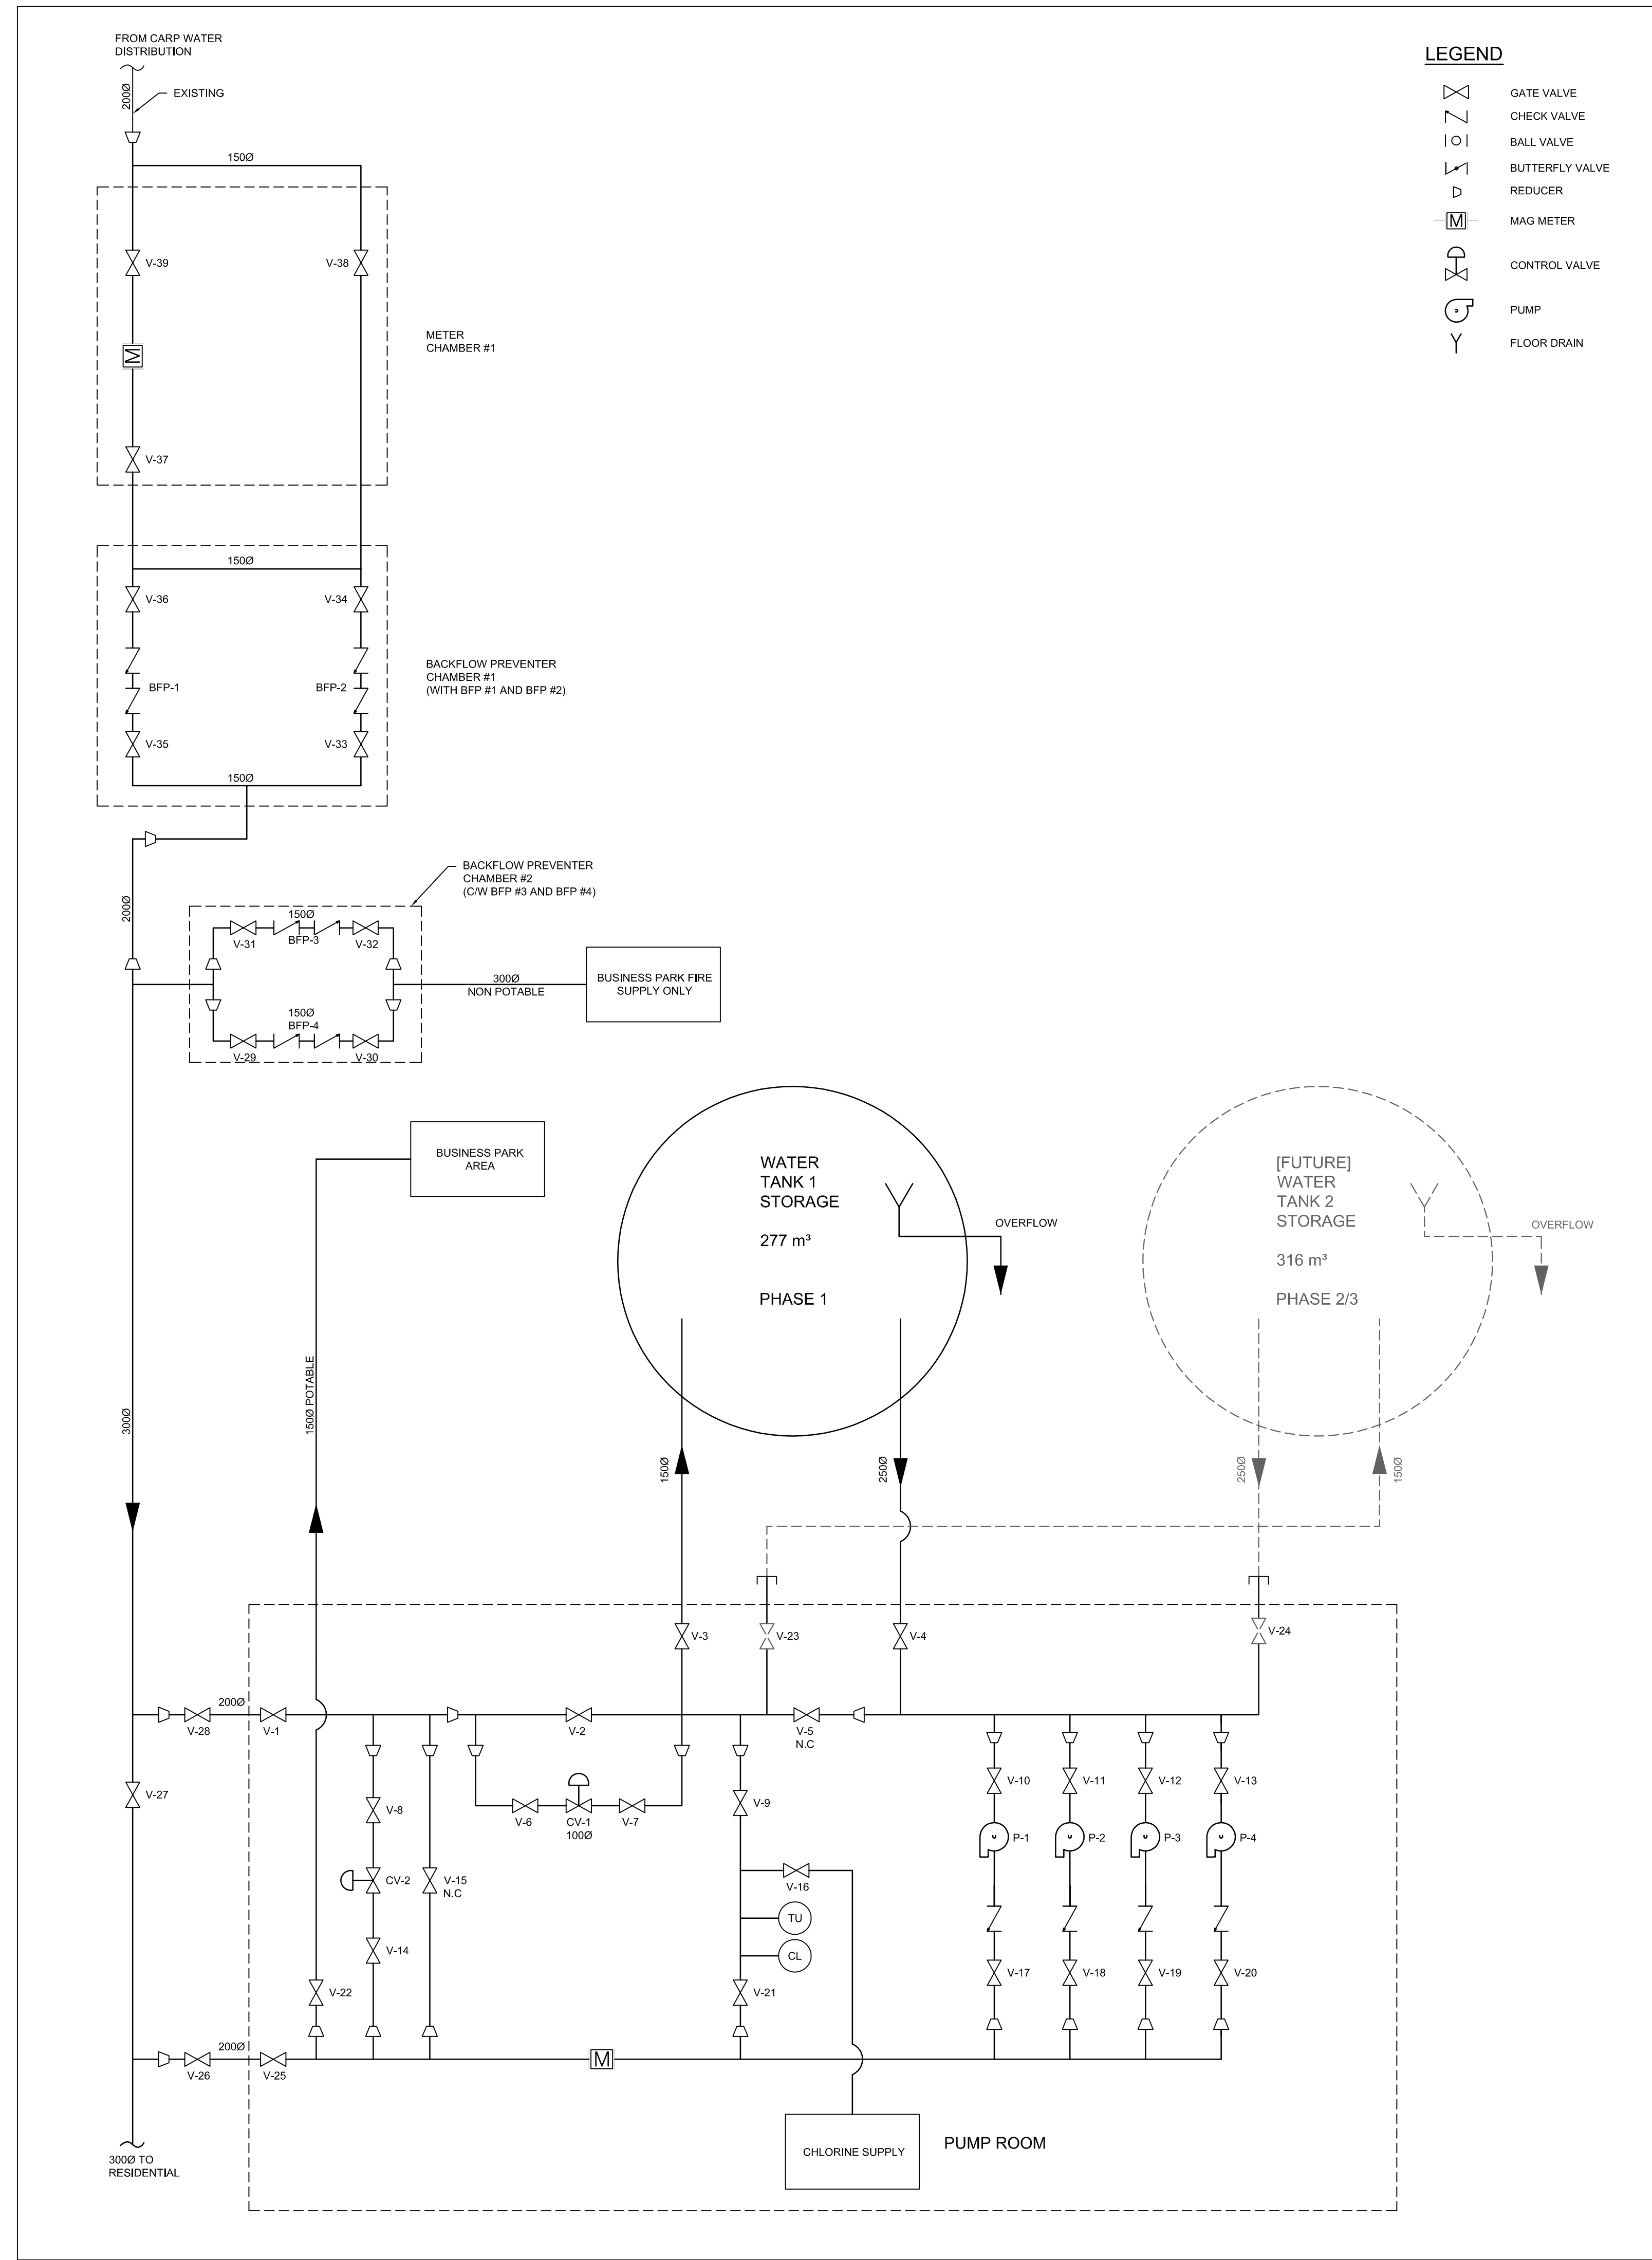

- LEGEND**
- GATE VALVE
 - CHECK VALVE
 - BALL VALVE
 - BUTTERFLY VALVE
 - REDUCER
 - MAG METER
 - CONTROL VALVE
 - PUMP
 - FLOOR DRAIN

1 WATER STORAGE FACILITY PROCESS SCHEMATIC
W1 N.T.S.

PRELIMINARY

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS,
WATERMANS, SEWERS AND OTHER
UNDERGROUND AND OVERGROUND UTILITIES AND
STRUCTURES IS NOT NECESSARILY SHOWN ON
THE CONTRACT DRAWINGS, AND WHERE SHOWN,
THE ACCURACY OF THE POSITION OF SUCH
UTILITIES AND STRUCTURES IS NOT GUARANTEED.
BEFORE STARTING WORK, DETERMINE THE EXACT
LOCATION OF ALL SUCH UTILITIES AND
STRUCTURES AND ASSUME ALL LIABILITY FOR
DAMAGE TO THEM.



No.	REVISION	DATE	BY
3.	REVISED PER CITY / MVC COMMENTS	SEPT 26/13	CJS
2.	ISSUED WITH REVISED HYDRAULIC NETWORK REPORT	MAY 28/13	CJS
1.	ISSUED FOR REVIEW	MAY 18/2012	CJS

SCALE
AS SHOWN


DESIGN
CJS

CHECKED
CJS

DRAWN
LLW

APPROVED
CJS

SMG
SMG

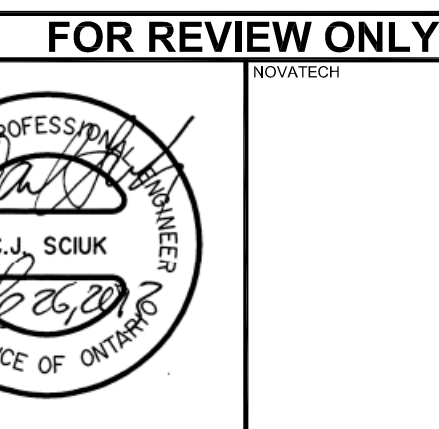


NOVATECH
ENGINEERING
CONSULTANTS LTD.
ENGINEERS & PLANNERS
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada
K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-9867
Email novatech@novatech-eng.com


LOCATION	DRAWING NAME	PROJECT NO.
CITY OF OTTAWA WEST CAPITAL AIRPARK	WATER STORAGE FACILITY PROCESS - SCHEMATIC	102085-01
		REV #3
		DRAWING NO. 102085-W1

C:\Users\102085\OneDrive\102085-01\102085-W1.dwg, W1, Sep 24, 2013, 10:08am, lbrway


PL-487-0102 - 03/08/2013

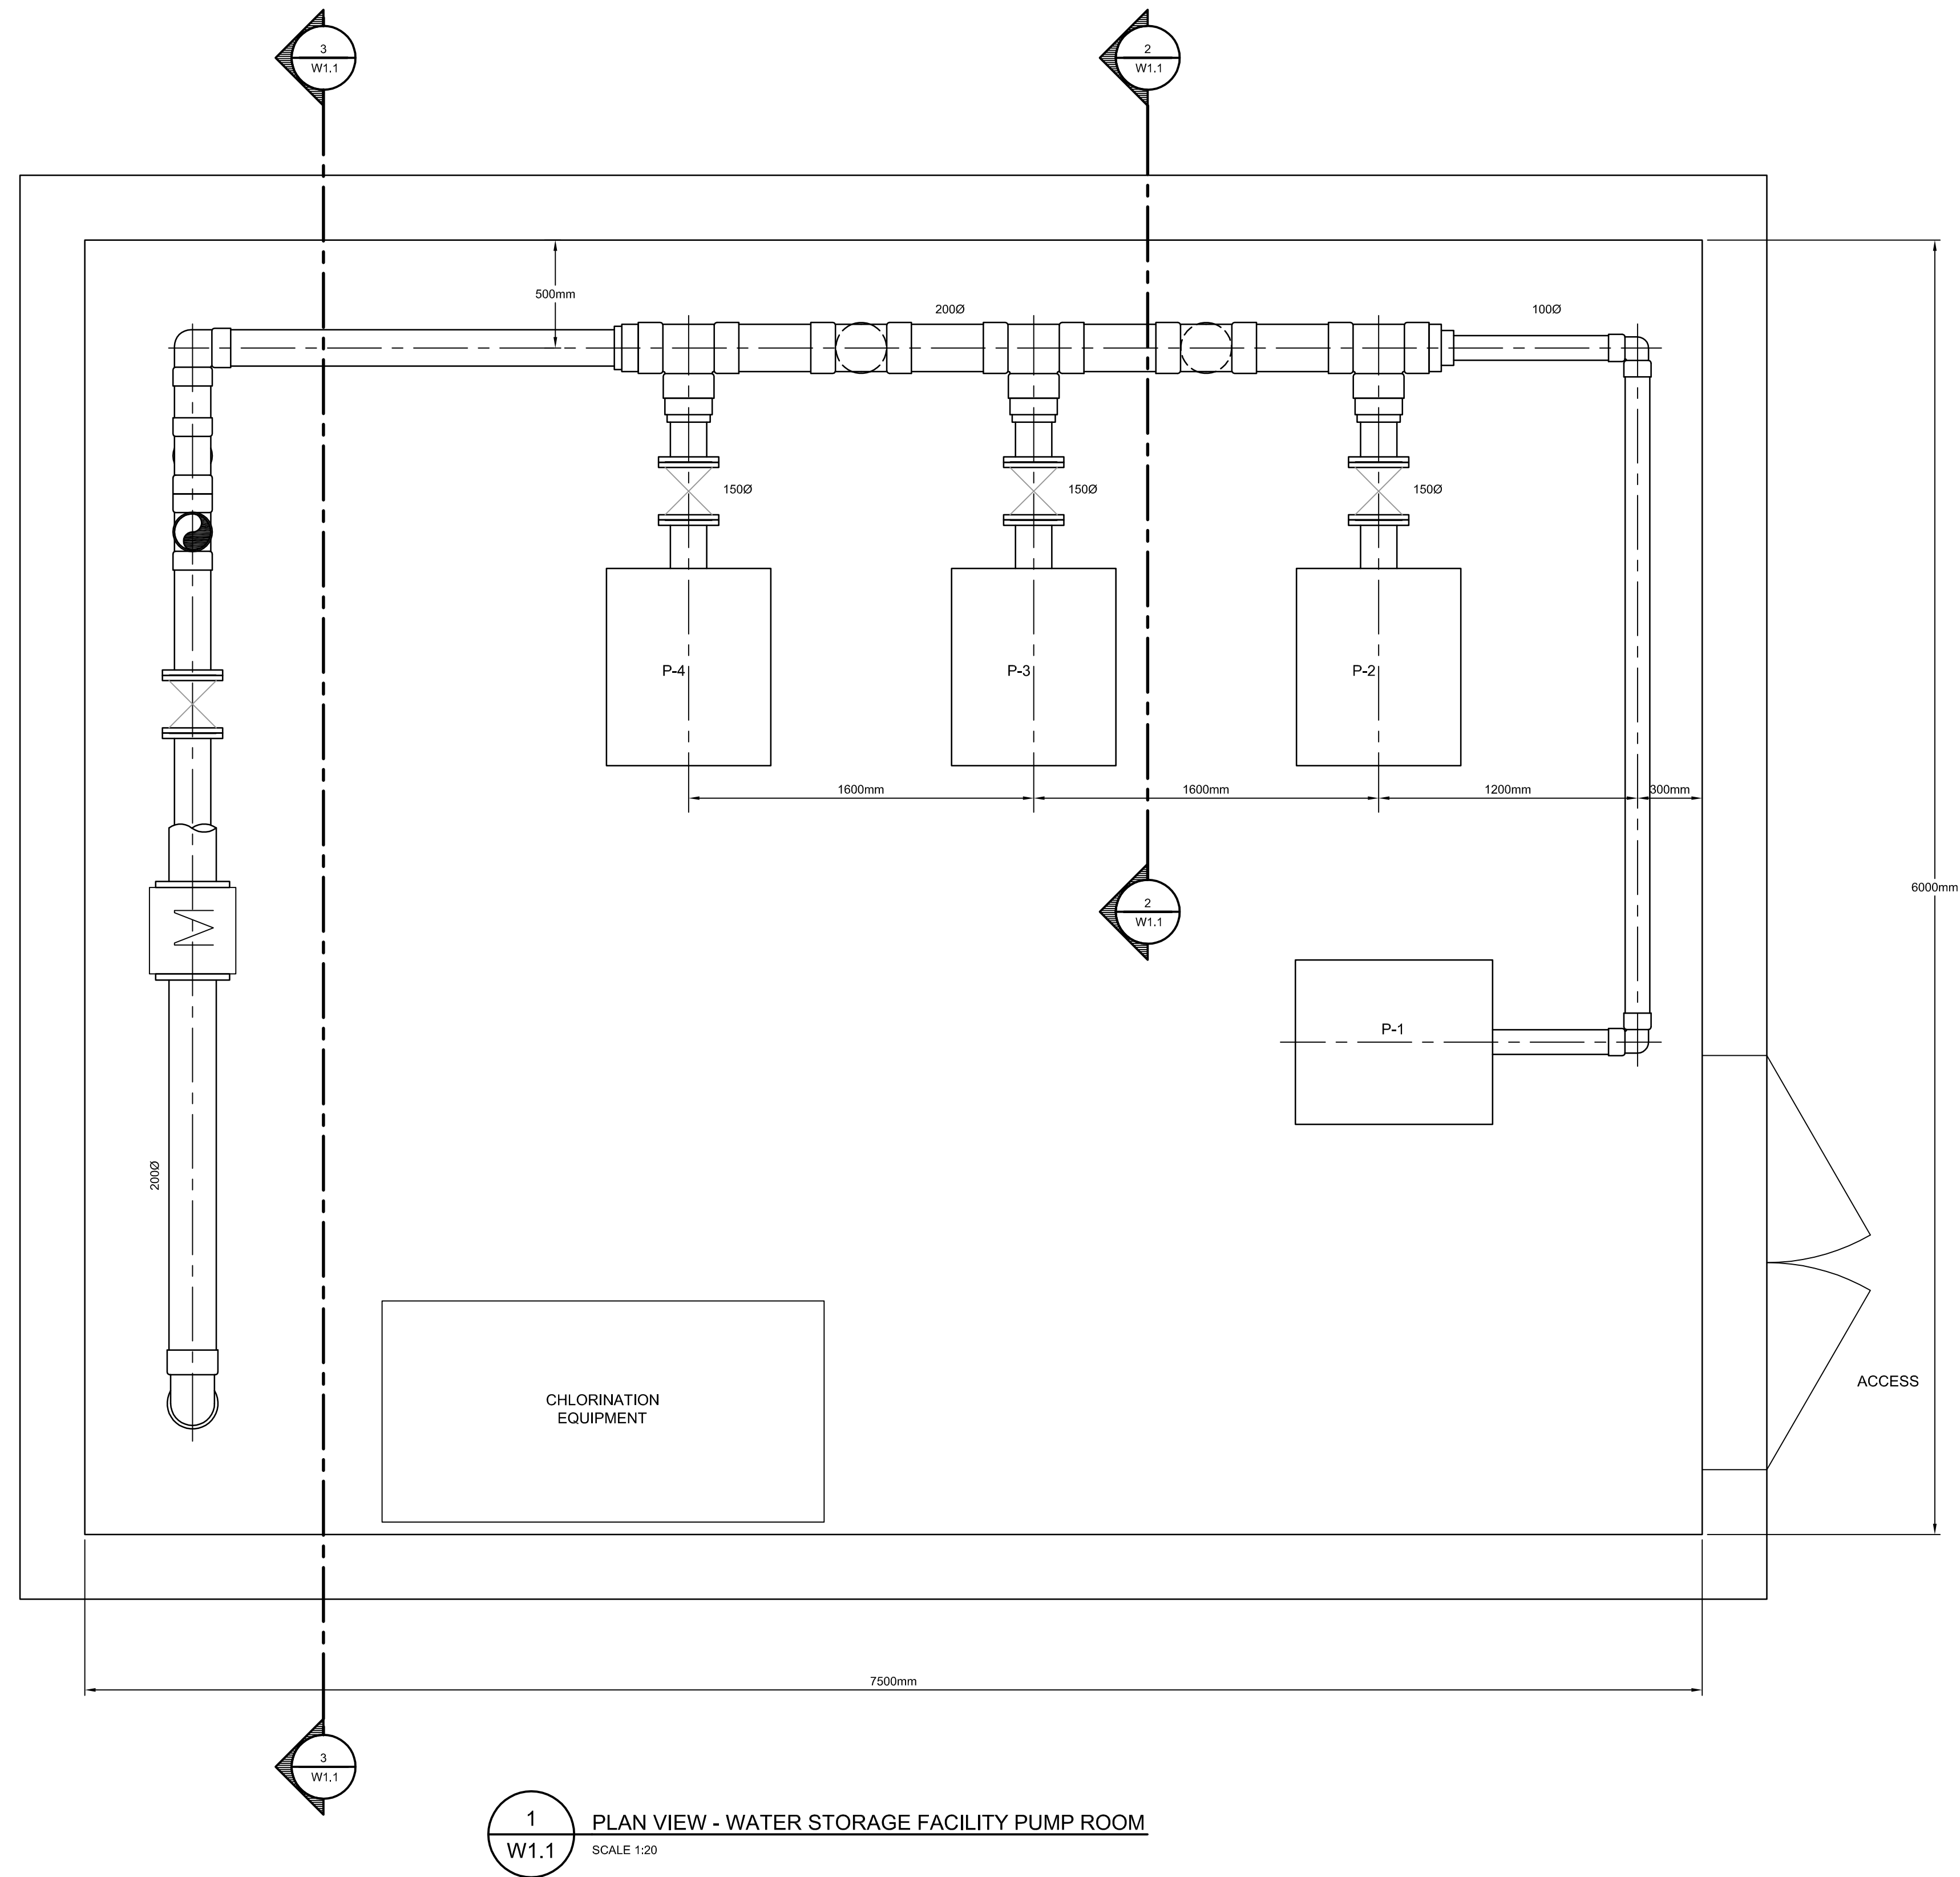

1 PLAN VIEW - WATER STORAGE FACILITY PUMP ROOM
SCALE 1:20

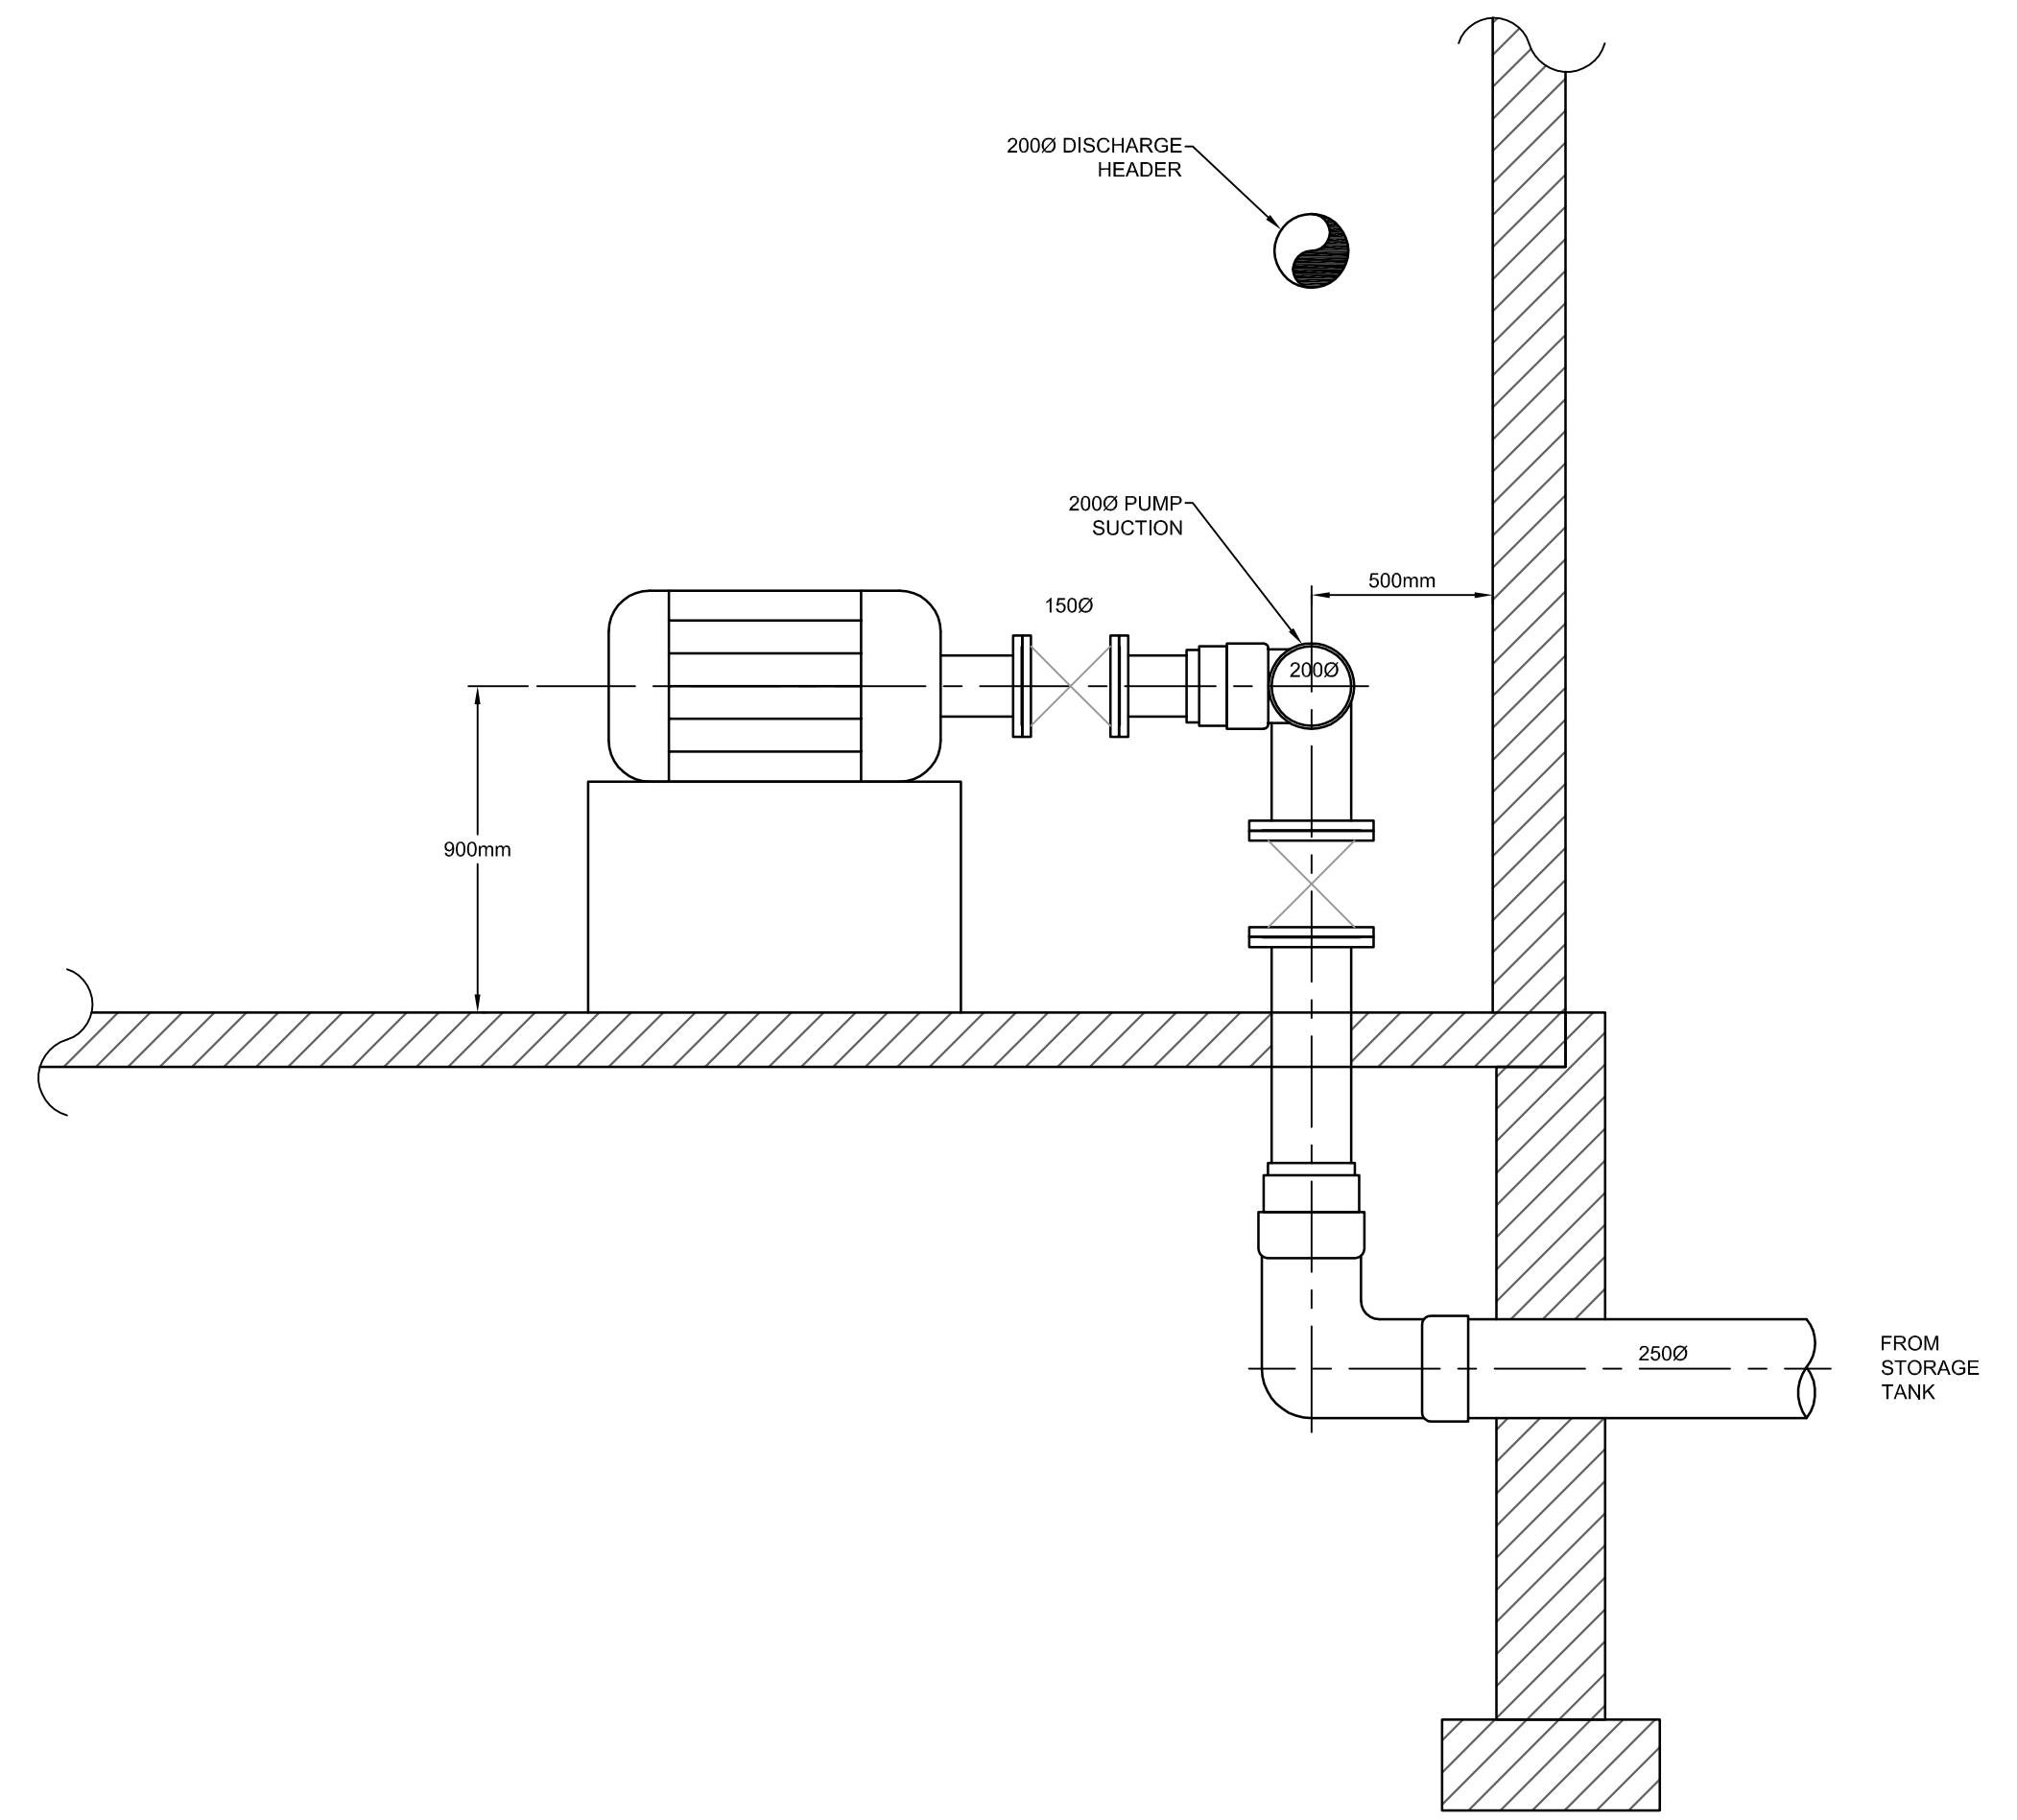

2 SECTION - WATER STORAGE FACILITY PROCESS PIPING
SCALE 1:20

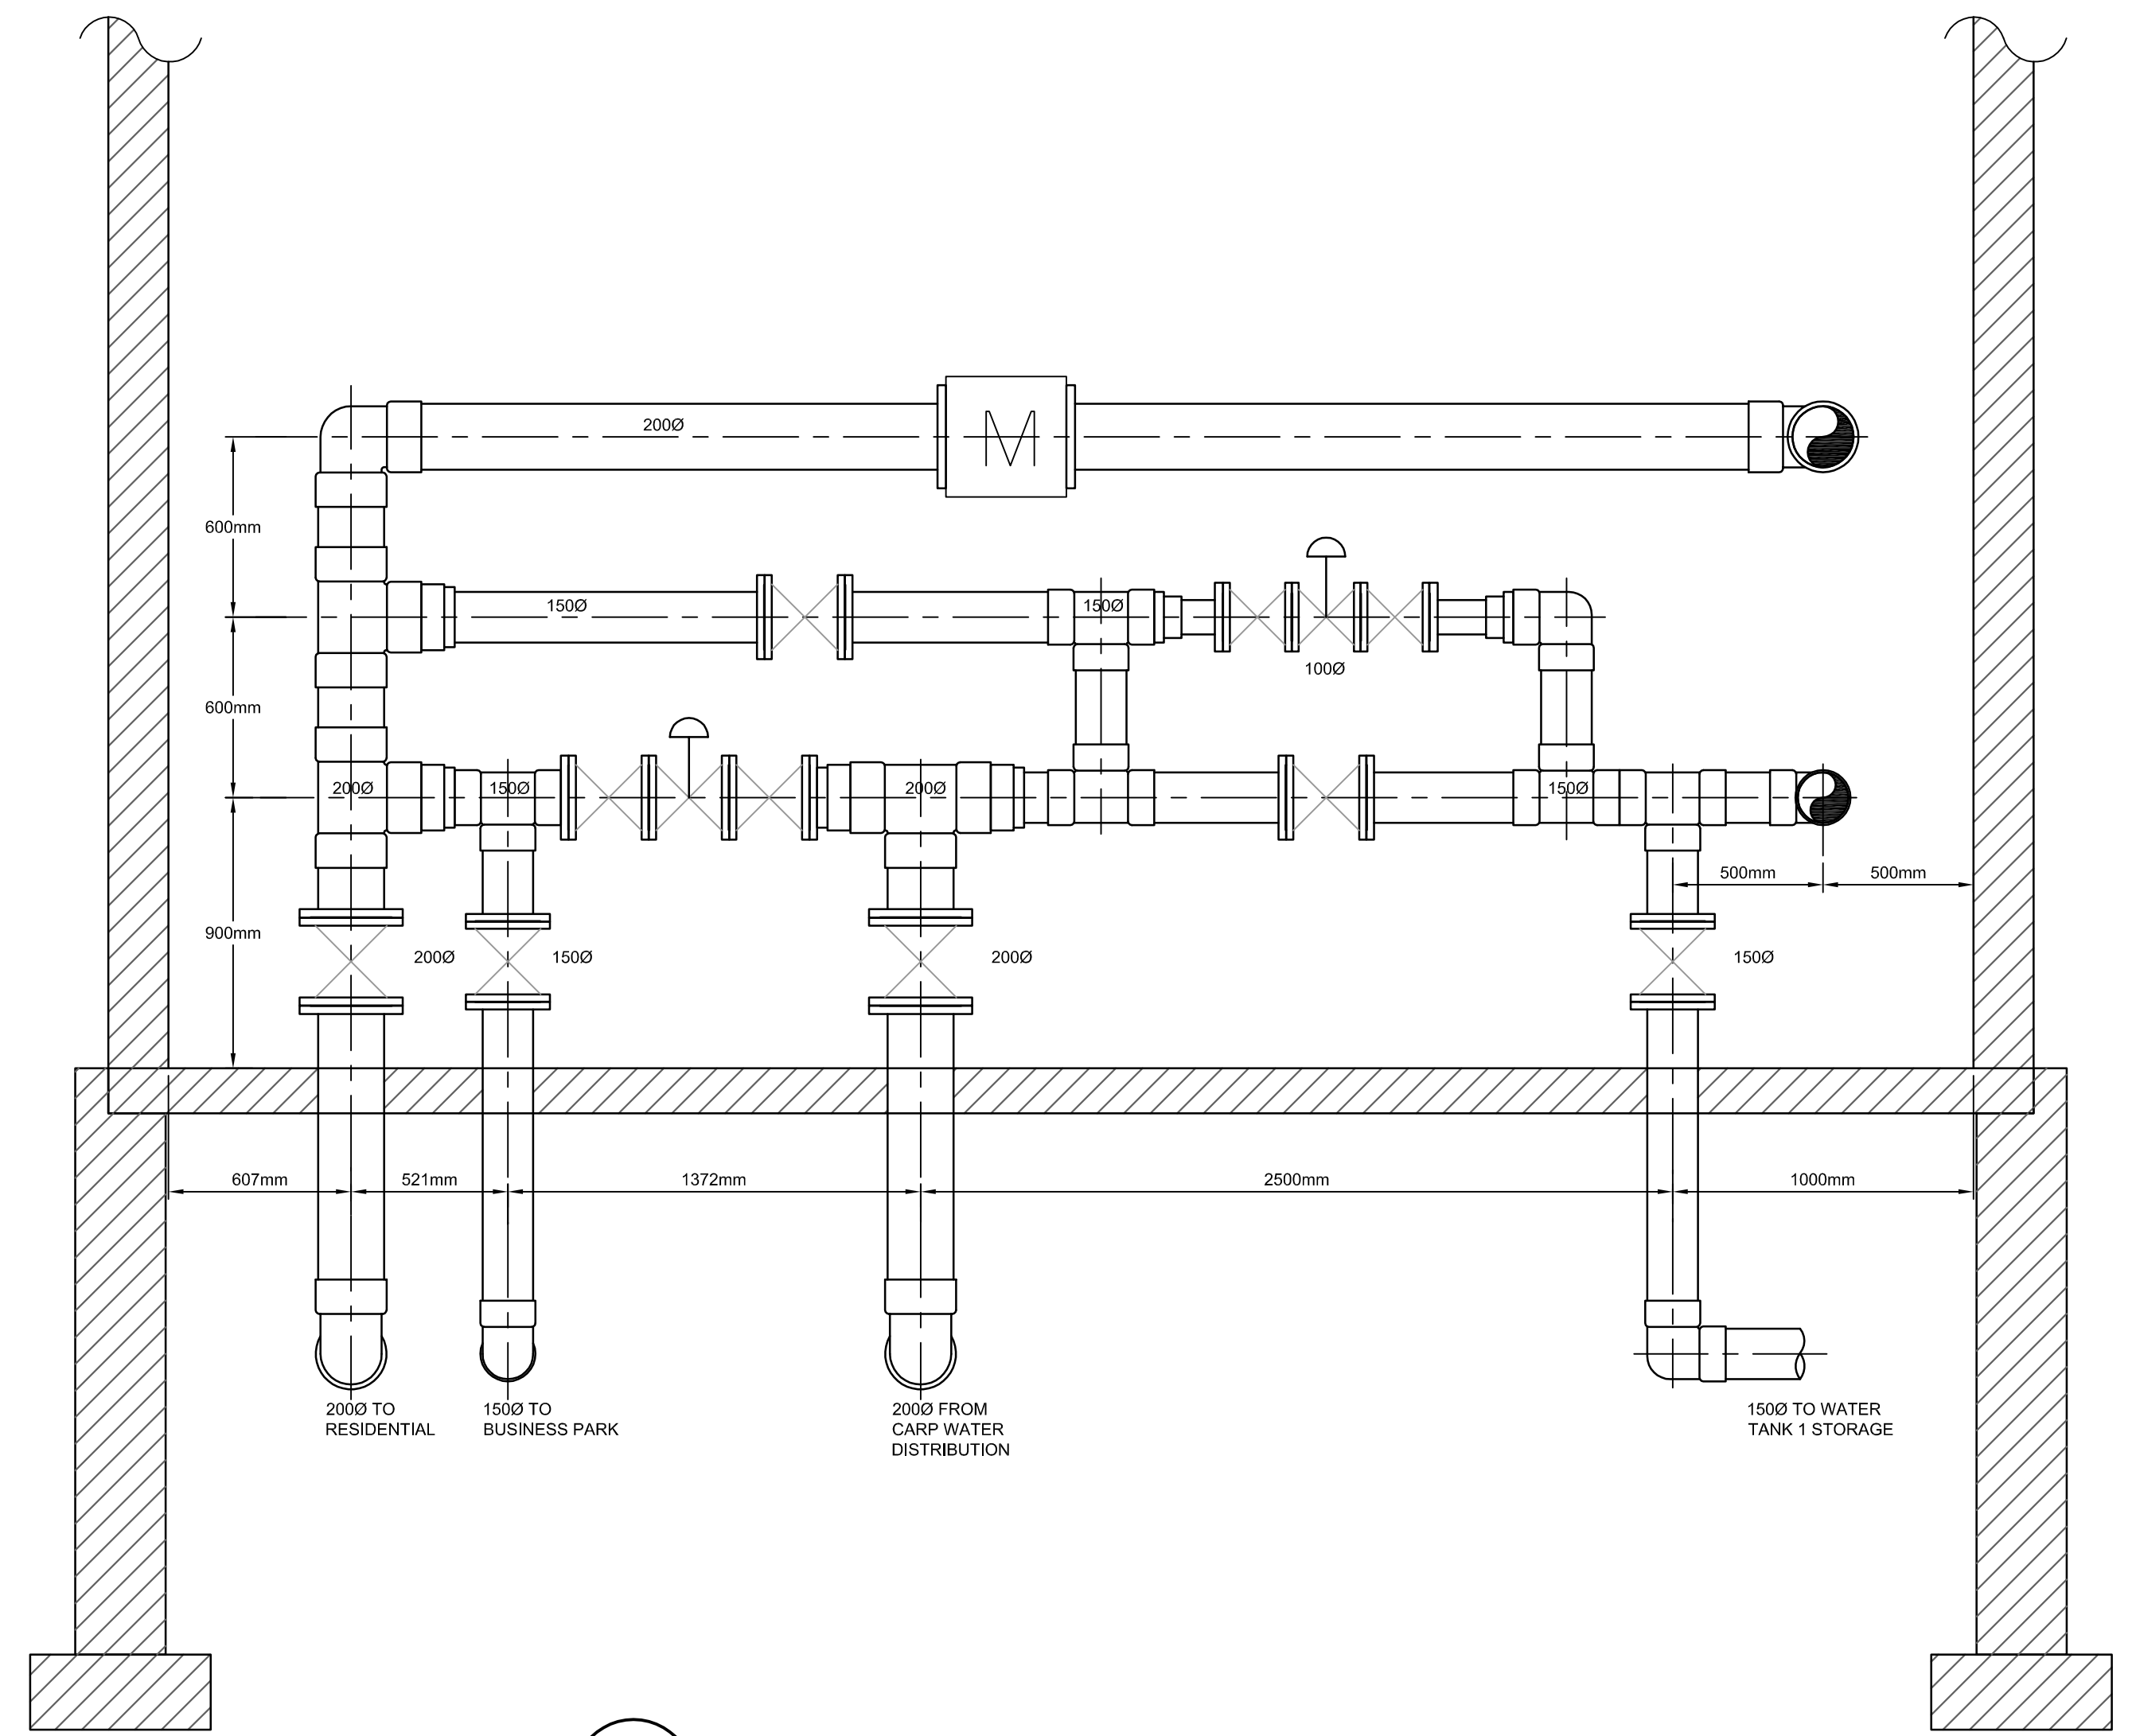

3 SECTION - WATER STORAGE FACILITY PROCESS PIPING
SCALE 1:20

PRELIMINARY

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS,
WATERMANS, SEWERS AND OTHER
UNDERGROUND AND OVERGROUND UTILITIES AND
STRUCTURES IS NOT NECESSARILY SHOWN ON
THE CONTRACT DRAWINGS, AND WHERE SHOWN,
THE ACCURACY OF THE POSITION OF SUCH
UTILITIES AND STRUCTURES IS NOT GUARANTEED.
BEFORE STARTING WORK, DETERMINE THE EXACT
LOCATION OF ALL SUCH UTILITIES AND
STRUCTURES AND ASSUME ALL LIABILITY FOR
DAMAGE TO THEM.



No.	REVISION	DATE	BY
3.	REVISED PER CITY / MVC COMMENTS	SEPT 26/13	CJS
2.	ISSUED WITH REVISED HYDRAULIC NETWORK REPORT	MAY 28/13	CJS
1.	ISSUED FOR REVIEW	MAY 18/2012	CJS

SCALE	DESIGN	CHECKED	DRAWN	APPROVED
AS SHOWN	CJS	CJS	LLW	CJS
				SMG

FOR REVIEW ONLY

DESIGN: CJS
CHECKED: CJS
DRAWN: LLW
APPROVED: CJS
SMG

NOVATECH PROFESSIONAL ENGINEERING
C.J. SCUK
PROVINCE OF ONTARIO

NOVATECH
ENGINEERING
CONSULTANTS LTD.
ENGINEERS & PLANNERS
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada
K2M 0P6
Telephone: (613) 254-9643
Facsimile: (613) 254-9867
Email: novatech@novatech-eng.com

LOCATION CITY OF OTTAWA WEST CAPITAL AIRPARK	PROJECT NO. 102085-01
DRAWING NAME WATER STORAGE FACILITY PROCESS - PUMP ROOM (SECTIONS)	REV #3 DRAWING NO. 102085-W1.1

APPENDIX C
WATERMAIN CALCULATIONS

McINTOSH PERRY

CCO-22-1643-01 - 273-275 Russ Bradley - Water Demands

Project:	273-275 Russ Bradley
Project No.:	CCO-22-1643-01
Designed By:	FV
Checked By:	NV
Date:	December 23, 2022
Site Area:	2.43 gross ha

Commercial

6326 m2

AVERAGE DAILY DEMAND

DEMAND TYPE	AMOUNT	UNITS	
Residential	280	L/c/d	
Industrial - Light	35,000	L/gross ha/d	
Industrial - Heavy	55,000	L/gross ha/d	
Shopping Centres	2,500	L/(1000m ² /d)	
Hospital	900	L/(bed/day)	
Schools	70	L/(Student/d)	
Trailer Park with no Hook-Ups	340	L/(space/d)	
Trailer Park with Hook-Ups	800	L/(space/d)	
Campgrounds	225	L/(campsite/d)	
Mobile Home Parks	1,000	L/(Space/d)	
Motels	150	L/(bed-space/d)	
Hotels	225	L/(bed-space/d)	
Tourist Commercial	28,000	L/gross ha/d	
Other Commercial	28,000	L/gross ha/d	
AVERAGE DAILY DEMAND	Residential	0.00	L/s
	Commercial/Industrial/ Institutional	0.20	L/s

MAXIMUM DAILY DEMAND

DEMAND TYPE	AMOUNT	UNITS	
Residential	9.5	x avg. day	
Industrial	1.5	x avg. day	
Commercial	1.5	x avg. day	
Institutional	1.5	x avg. day	
MAXIMUM DAILY DEMAND	Residential	0.00	L/s
	Commercial/Industrial/ Institutional	0.31	L/s

MAXIMUM HOUR DEMAND

DEMAND TYPE	AMOUNT	UNITS	
Residential	14.3	x avg. day	
Industrial	1.8	x max. day	
Commercial	1.8	x max. day	
Institutional	1.8	x max. day	
MAXIMUM HOUR DEMAND	Residential	0.00	L/s
	Commercial/Industrial/ Institutional	0.55	L/s

WATER DEMAND DESIGN FLOWS PER UNIT COUNT
CITY OF OTTAWA - WATER DISTRIBUTION GUIDELINES, JULY 2010

AVERAGE DAILY DEMAND	0.20	L/s
MAXIMUM DAILY DEMAND	0.31	L/s
MAXIMUM HOUR DEMAND	0.55	L/s

McINTOSH PERRY

CCO-22-1643-01 - 273-275 Russ Bradley - Fire Underwriters Survey -Building F

Project: 273-275 Russ Bradley
 Project No.: CCO-22-1643-01
 Designed By: FV
 Checked By: NV
 Date: December 23, 2022

From the Fire Underwriters Survey (2020)

From Part II – Guide for Determination of Required Fire Flow Copyright I.S.O.:
 City of Ottawa Technical Bulletin ISTB-2018-02 Applied Where Applicable

A. BASE REQUIREMENT (Rounded to the nearest 1000 L/min)

F = 220 x C x √A Where: F = Required fire flow in liters per minute
 C = Coefficient related to the type of construction.
 A = The total floor area in square meters (including all storey's, but excluding basements at least 50 percent below grade) in the building being considered.

Construction Type Non-Combustible Construction

C 0.8 A 743.2 m²
 Total Floor Area (per the 2020 FUS Page 20 - Total Effective Area) 743.2 m²

Calculated Fire Flow 4,798.1 L/min
 5,000.0 L/min

B. REDUCTION FOR OCCUPANCY TYPE (No Rounding)

From Page 24 of the Fire Underwriters Survey:
 Combustible 0%

Fire Flow 5,000.0 L/min

C. REDUCTION FOR SPRINKLER TYPE (No Rounding)

Non-Sprinklered 0%

Reduction 0.0 L/min

D. INCREASE FOR EXPOSURE (No Rounding)

	Separation Distance (m)	Cons.of Exposed Wall	Length Exposed Adjacent Wall (m)	Height (Stories)	Length-Height Factor	
Exposure 1	3.1 to 10	Fire Resistive - Non Combustible (Unprotected Openings)	60.96	1	61.0	8%
Exposure 2	3.1 to 10	Fire Resistive - Non Combustible (Unprotected Openings)	12.19	1	12.2	6%
Exposure 3	3.1 to 10	Fire Resistive - Non Combustible (Unprotected Openings)	60.96	1	61.0	8%
Exposure 4	10.1 to 20	Fire Resistive - Non Combustible (Unprotected Openings)	12.19	1	12.2	3%
% Increase*						25%

Increase* 1,250.0 L/min

E. Total Fire Flow (Rounded to the Nearest 1000 L/min)

Fire Flow 6,250.0 L/min
 Fire Flow Required** 6,000.0 L/min

*In accordance with Part II, Section 4, the Increase for separation distance is not to exceed 75%

**In accordance with Section 4 the Fire flow is not to exceed 45,000 L/min or be less than 2,000 L/min

APPENDIX D
SANITARY CALCULATIONS

McINTOSH PERRY

CCO-22-1643-01 - 273-275 Russ Bradley Road - Sanitary Demands

Project:	273-275 Russ Bradley Road
Project No.:	CCO-22-1643-01
Designed By:	FV
Checked By:	BC
Date:	Dec-22
Site Area	2.43 Gross ha
Office Space	55.40 m ²

DESIGN PARAMETERS

Institutional/Commercial Peaking Factor	1.5	
Residential Peaking Factor	3.80	* Using Harmon Formula = $1+(14/(4+P^{0.5}))^{*0.8}$ where P = population in thousands, Harmon's Correction Factor = 0.8
Mannings coefficient (n)	0.013	
Demand (per capita)	280	L/day
Infiltration allowance	0.33	L/s/Ha

EXTRANEEOUS FLOW ALLOWANCES

Infiltration / Inflow	Flow (L/s)
Dry	0.12
Wet	0.68
Total	0.80

AVERAGE DAILY DEMAND



DEMAND TYPE	AMOUNT	UNITS	POPULATION / AREA	Flow (L/s)
Residential	280	L/c/d		0
Industrial - Light**	35,000	L/gross ha/d		0
Industrial - Heavy**	55,000	L/gross ha/d		0
Commercial / Amenity	2,800	L/(1000m ² /d)		0
Hospital	900	L/(bed/day)		0
Schools	70	L/(Student/d)		0
Trailer Parks no Hook-Ups	340	L/(space/d)		0
Trailer Park with Hook-Ups	800	L/(space/d)		0
Campgrounds	225	L/(campsite/d)		0
Mobile Home Parks	1,000	L/(Space/d)		0
Motels	150	L/(bed-space/d)		0
Hotels	225	L/(bed-space/d)		0
Office	75	L/7.0m ² /d	55.7	0.01
Tourist Commercial	28,000	L/gross ha/d		0
Other Commercial	28,000	L/gross ha/d		0

AVERAGE RESIDENTIAL FLOW	0.00	L/s
PEAK RESIDENTIAL FLOW	0.00	L/s
AVERAGE ICI FLOW	0.01	L/s
PEAK INSTITUTIONAL/COMMERCIAL FLOW	0.01	L/s
PEAK INDUSTRIAL FLOW	0.00	L/s
TOTAL PEAK ICI FLOW	0.01	L/s

TOTAL SANITARY DEMAND

TOTAL ESTIMATED AVERAGE DRY WEATHER FLOW	0.13	L/s
TOTAL ESTIMATED PEAK DRY WEATHER FLOW	0.13	L/s
TOTAL ESTIMATED PEAK WET WEATHER FLOW	0.81	L/s

APPENDIX E
PRE-DEVELOPMENT DRAINAGE PLAN

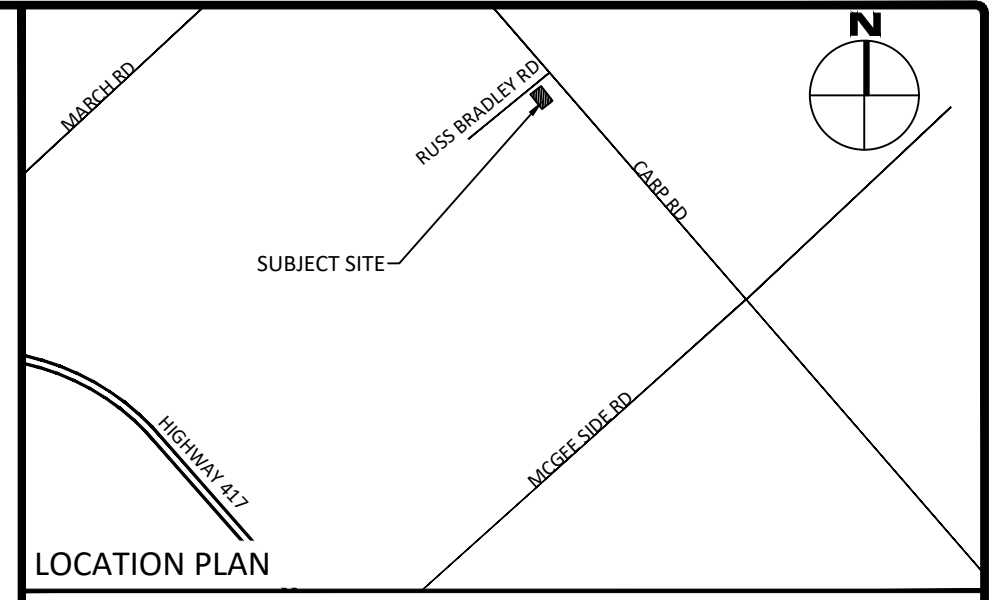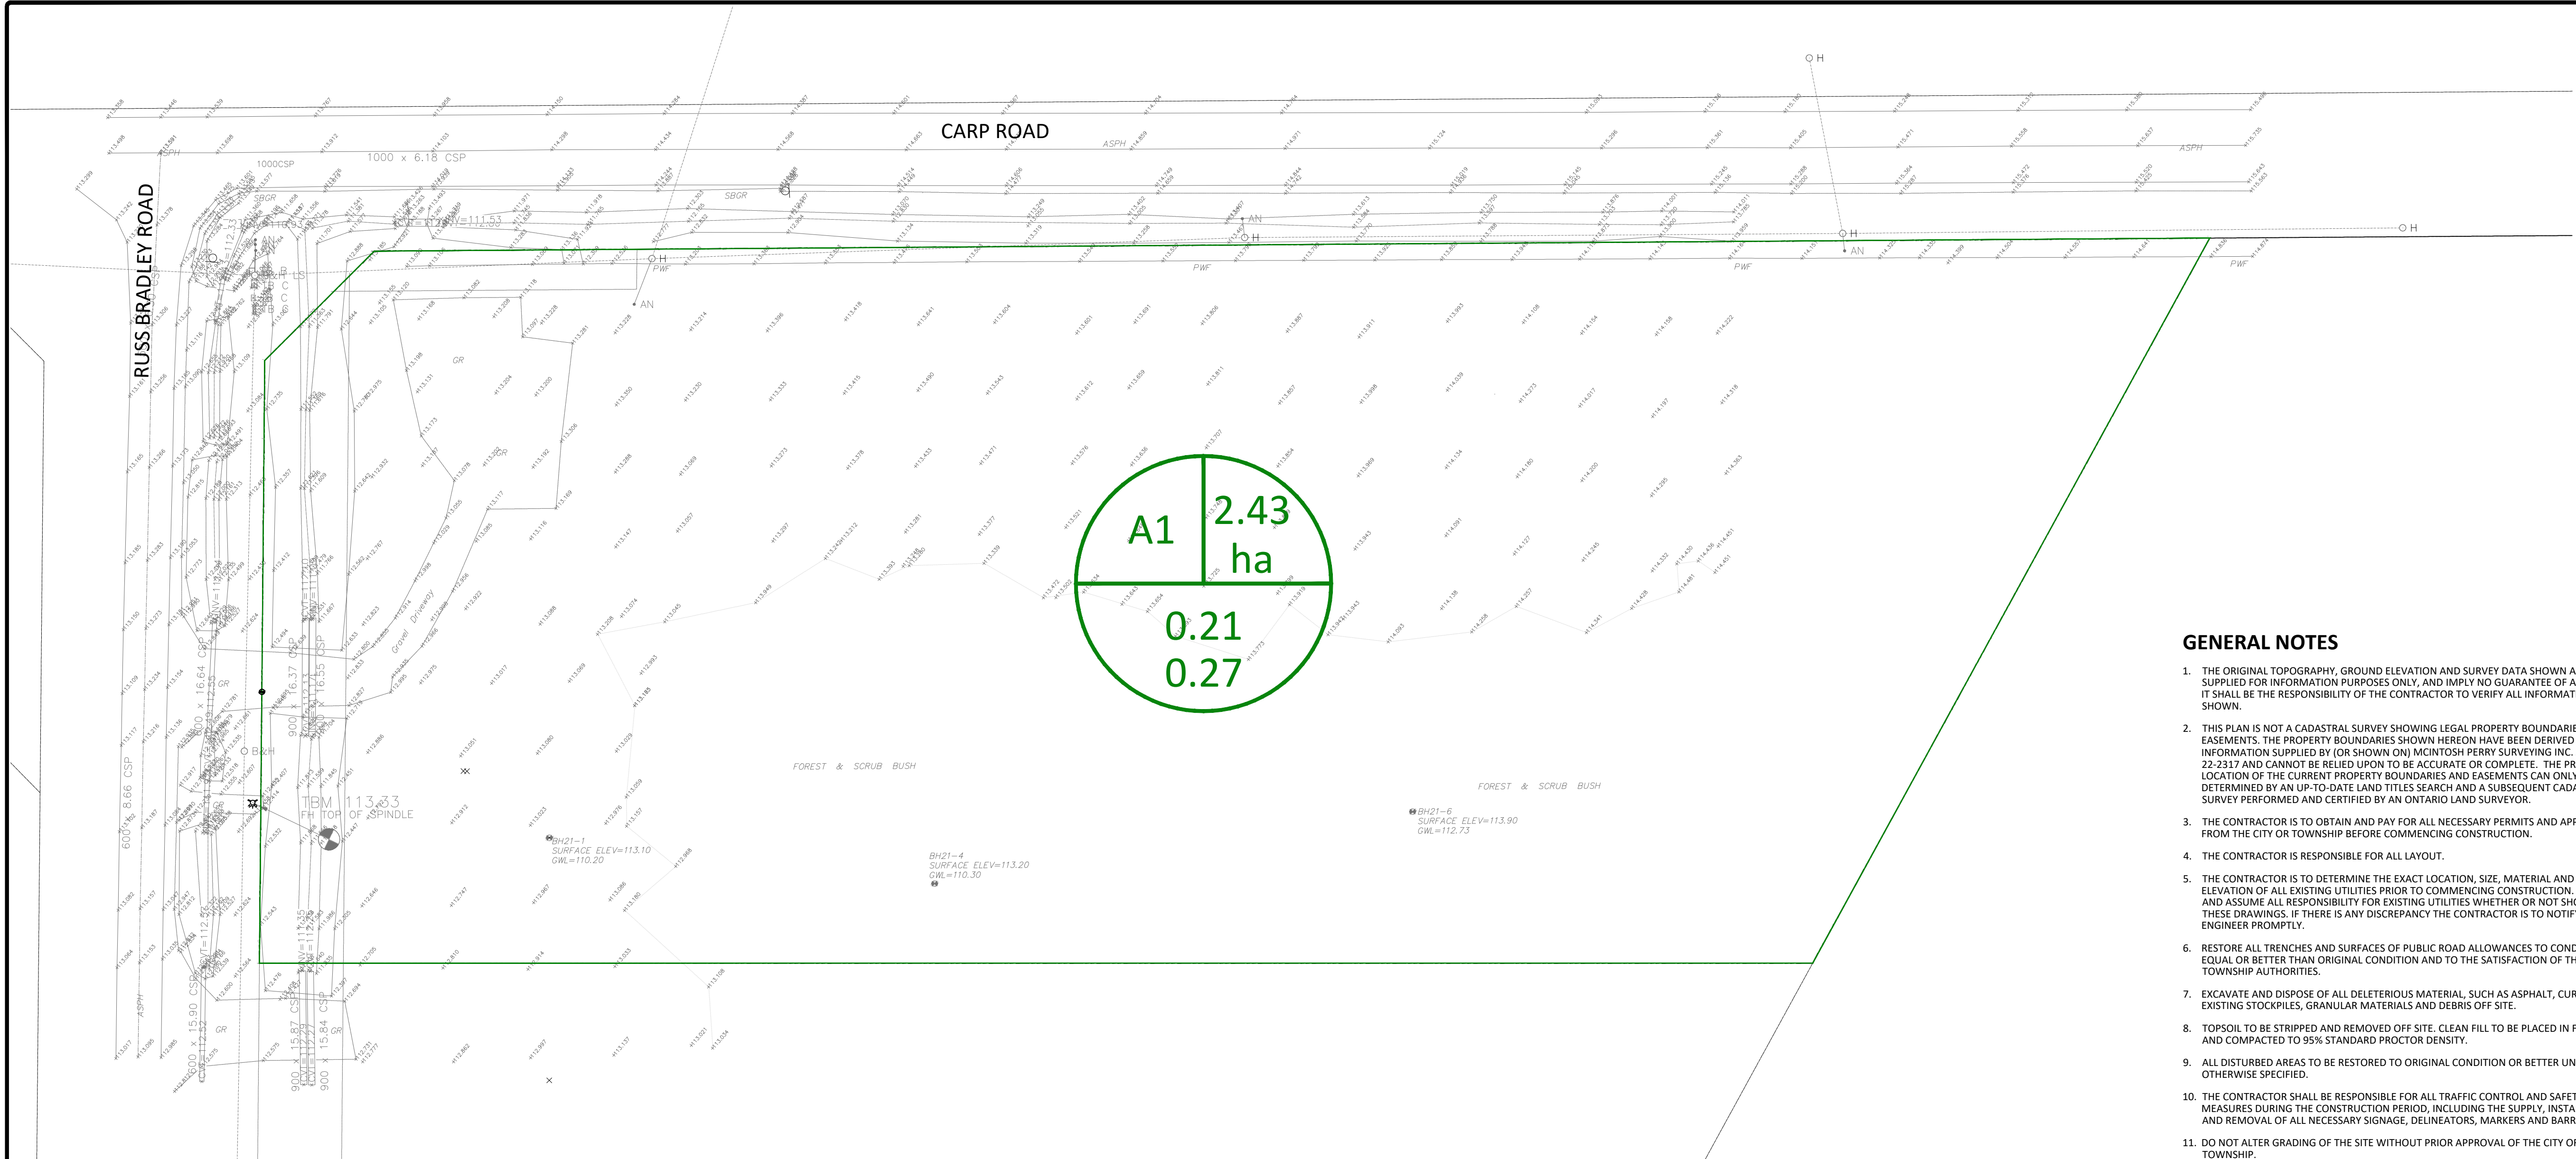

LEGEND


GENERAL NOTES

1. THE ORIGINAL TOPOGRAPHY, GROUND ELEVATION AND SURVEY DATA SHOWN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY, AND IMPLY NO GUARANTEE OF ACCURACY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION SHOWN.
2. THIS PLAN IS NOT A CADASTRAL SURVEY SHOWING LEGAL PROPERTY BOUNDARIES AND EASEMENTS. THE PROPERTY BOUNDARIES SHOWN HEREON HAVE BEEN DERIVED FROM INFORMATION SUPPLIED BY (OR SHOWN ON) MCINTOSH PERRY SURVEYING INC. JOB # 22-2317 AND CANNOT BE RELIED UPON TO BE ACCURATE OR COMPLETE. THE PRECISE LOCATION OF THE CURRENT PROPERTY BOUNDARIES AND EASEMENTS CAN ONLY BE DETERMINED BY AN UP-TO-DATE LAND TITLES SEARCH AND A SUBSEQUENT CADASTRAL SURVEY PERFORMED AND CERTIFIED BY AN ONTARIO LAND SURVEYOR.
3. THE CONTRACTOR IS TO OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OR TOWNSHIP BEFORE COMMENCING CONSTRUCTION.
4. THE CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT.
5. THE CONTRACTOR IS TO DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME ALL RESPONSIBILITY FOR EXISTING UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS. IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
6. RESTORE ALL TRENCHES AND SURFACES OF PUBLIC ROAD ALLOWANCES TO CONDITION EQUAL OR BETTER THAN ORIGINAL CONDITION AND TO THE SATISFACTION OF THE CITY OR TOWNSHIP AUTHORITIES.
7. EXCAVATE AND DISPOSE OF ALL DELETERIOUS MATERIAL, SUCH AS ASPHALT, CURBING, EXISTING STOCKPILES, GRANULAR MATERIALS AND DEBRIS OFF SITE.
8. TOPSOIL TO BE STRIPPED AND REMOVED OFF SITE. CLEAN FILL TO BE PLACED IN FILL AREAS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
9. ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE SPECIFIED.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC CONTROL AND SAFETY MEASURES DURING THE CONSTRUCTION PERIOD, INCLUDING THE SUPPLY, INSTALLATION, AND REMOVAL OF ALL NECESSARY SIGNAGE, DELINEATORS, MARKERS AND BARRIERS.
11. DO NOT ALTER GRADING OF THE SITE WITHOUT PRIOR APPROVAL OF THE CITY OR TOWNSHIP.
12. ALL ROADWAY, PARKING LOT, AND GRADING WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH CITY OR TOWNSHIP STANDARDS AND SPECIFICATIONS. THE CONTRACTOR IS TO PROVIDE POSITIVE DRAINAGE AWAY FROM THE BUILDING.
13. CONTACT THE CITY OR TOWNSHIP FOR INSPECTION OF ROUGH GRADING OF PARKING LOTS, ROADWAYS AND LANDSCAPED AREAS PRIOR TO PLACEMENT OF ASPHALT AND TOPSOIL. ALL DEFICIENCIES NOTED SHALL BE RECTIFIED TO THE CITY OR TOWNSHIP SATISFACTION PRIOR TO PLACEMENT OF ANY ASPHALT, TOPSOIL, SEED & MULCH AND/OR SOD.
14. ALL DIMENSIONS AND INVERTS MUST BE VERIFIED PRIOR TO CONSTRUCTION, IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
15. ELECTRICAL, GAS, TELEPHONE AND TELEVISION SERVICE LOCATIONS ARE SUBJECT TO THE INDIVIDUAL AGENCY:
 - ELECTRICAL SERVICE - HYDRO OTTAWA,
 - GAS SERVICE - ENBRIDGE,
 - TELEPHONE SERVICE - BELL CANADA,
 - TELEVISION SERVICE - ROGERS.
17. INSTALLATION TO BE IN ACCORDANCE WITH CURRENT CODES AND STANDARDS OF APPROVAL AGENCIES HYDRO OTTAWA, BELL AND THE CITY OR TOWNSHIP.
18. ALL PROPOSED CURB SHALL BE CONCRETE BARRIER CURB UNLESS SPECIFIED.
19. ALL EXISTING REDUNDANT PRIVATE APPROACHES FRONTING THIS DEVELOPMENT MUST BE REMOVED TO THE SATISFACTION OF THE CITY OR TOWNSHIP.

FOR REVIEW ONLY
NOT FOR CONSTRUCTION

No.	Revisions	Date
1	ISSUED FOR REVIEW	DEC. 23, 2022

Check and verify all dimensions before proceeding with the work. Do not scale drawings.

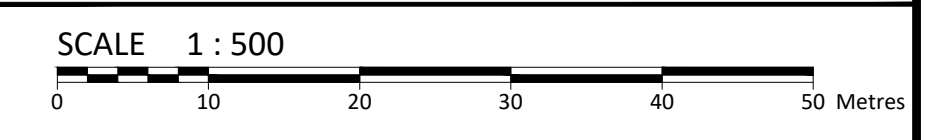

McINTOSH PERRY
115 Walgreen Road, RR3, Carp, ON K0A 1L0
Tel: 613-836-2184 Fax: 613-836-3742
www.mcintoshperry.com

Stamp:

Client: **TREVOR WATKINS**
273 & 275 RUSS BRADLEY ROAD
CARP, ON K0A 1L0


Project: **WAREHOUSE/STORAGE FACILITY**
273 & 275 RUSS BRADLEY ROAD

CARP ON

Drawing Title: **PRE-DEVELOPMENT DRAINAGE AREA PLAN**

Scale: 1:500	Project Number: CCO-22-1643-01
Drawn By: NV	Checked By: BC
Designed By: NV	Drawing Number: PRE

LEGEND:

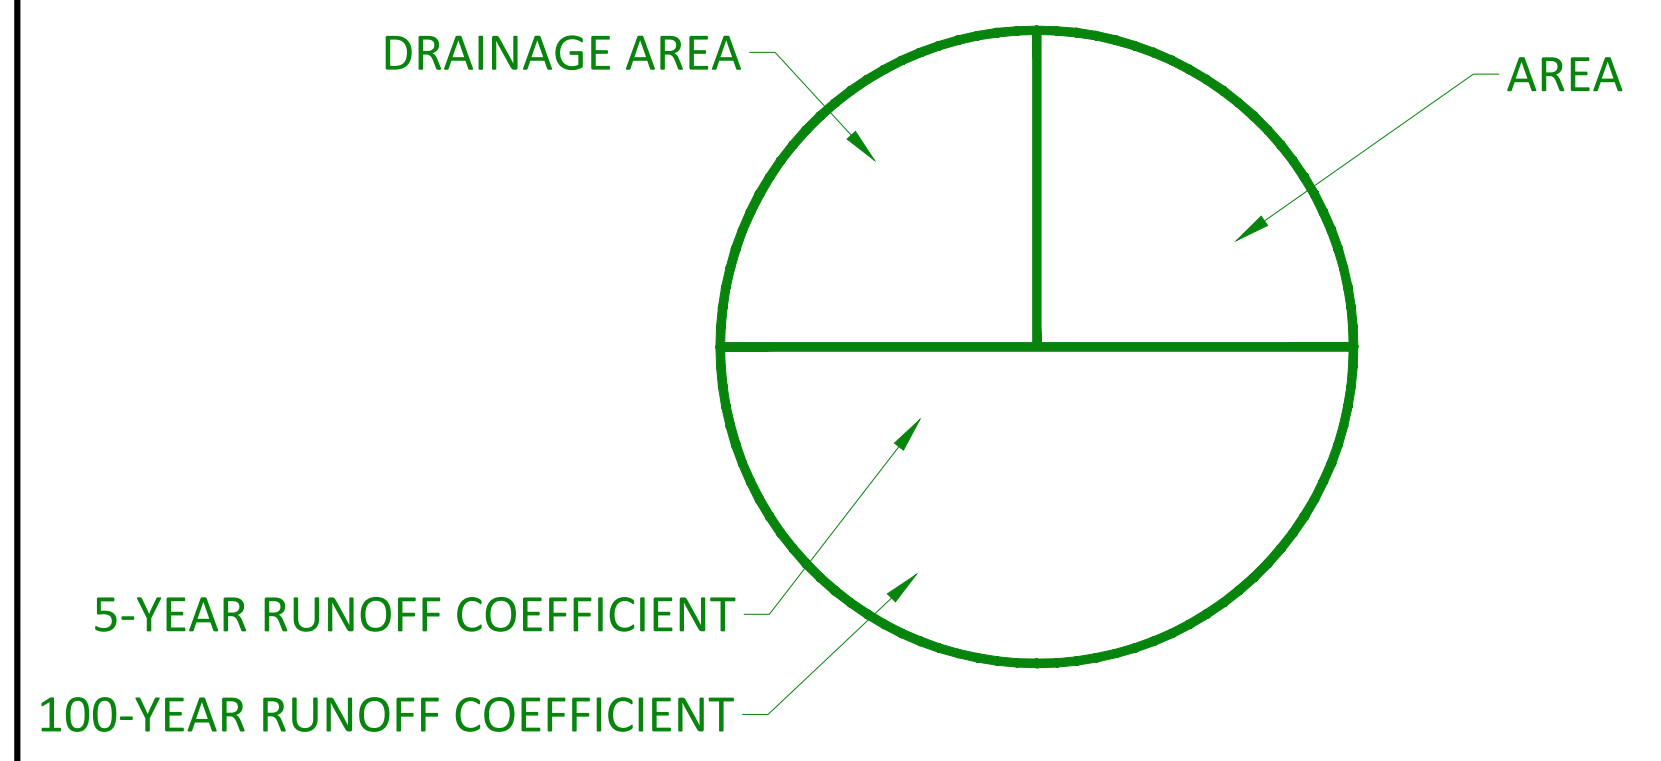


FILENAME: (U:\C:\Users\jperkins\OneDrive\Documents\2022\1643-01\Drawings\CCO-22-1643-01_Presentation.dwg
 LAST SAVED: Friday, December 23, 2022 1:51:45 PM BY: jperkins
 LAST PLOTTED: Friday, December 23, 2022 1:51:45 PM

D07-12-XX-XXXX

#XXXXX

APPENDIX F
POST-DEVELOPMENT DRAINAGE PLAN

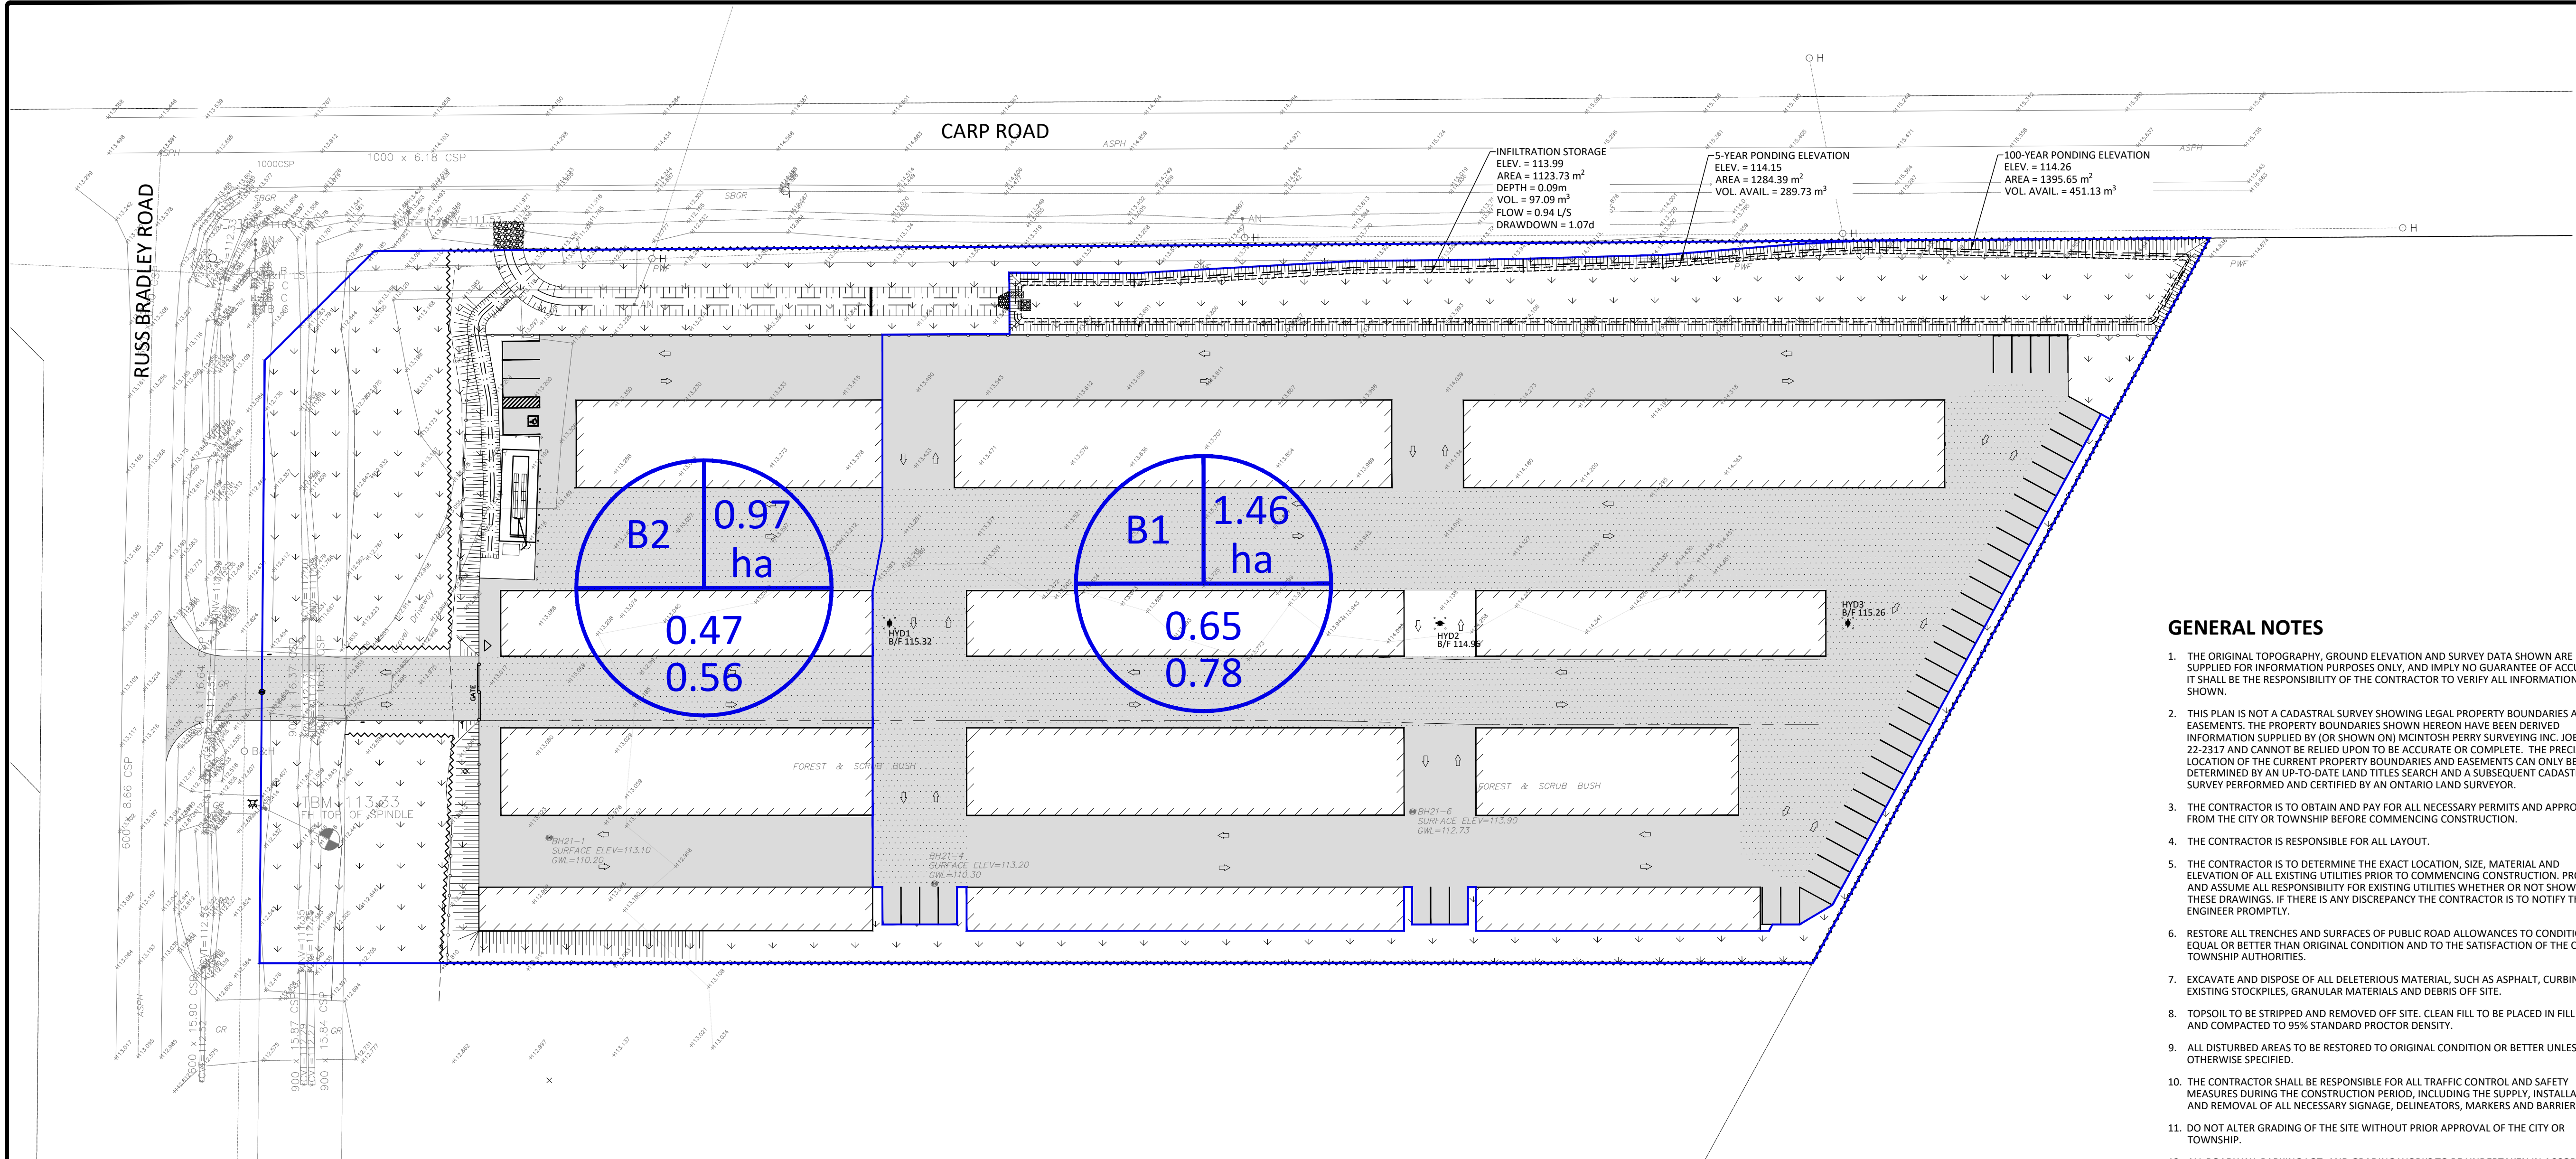


INfiltration STORAGE
 ELEV. = 113.99
 AREA = 1123.73 m²
 DEPTH = 0.09m
 VOL. = 97.09 m³
 FLOW = 0.04 L/S
 DRAWDOWN = 1.07d

5-YEAR PONDING ELEVATION
 ELEV. = 114.15
 AREA = 1284.39 m²
 VOL. AVAIL. = 289.73 m³

100-YEAR PONDING ELEVATION
 ELEV. = 114.26
 AREA = 1395.65 m²
 VOL. AVAIL. = 451.13 m³

GENERAL NOTES

1. THE ORIGINAL TOPOGRAPHY, GROUND ELEVATION AND SURVEY DATA SHOWN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY, AND IMPLY NO GUARANTEE OF ACCURACY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION SHOWN.
2. THIS PLAN IS NOT A CADASTRAL SURVEY SHOWING LEGAL PROPERTY BOUNDARIES AND EASEMENTS. THE PROPERTY BOUNDARIES SHOWN HEREON HAVE BEEN DERIVED FROM INFORMATION SUPPLIED BY (OR SHOWN ON) MCINTOSH PERRY SURVEYING INC. JOB # 22-2317 AND CANNOT BE RELIED UPON TO BE ACCURATE OR COMPLETE. THE PRECISE LOCATION OF THE CURRENT PROPERTY BOUNDARIES AND EASEMENTS CAN ONLY BE DETERMINED BY AN UP-TO-DATE LAND TITLES SEARCH AND A SUBSEQUENT CADASTRAL SURVEY PERFORMED AND CERTIFIED BY AN ONTARIO LAND SURVEYOR.
3. THE CONTRACTOR IS TO OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OR TOWNSHIP BEFORE COMMENCING CONSTRUCTION.
4. THE CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT.
5. THE CONTRACTOR IS TO DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME ALL RESPONSIBILITY FOR EXISTING UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS. IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
6. RESTORE ALL TRENCHES AND SURFACES OF PUBLIC ROAD ALLOWANCES TO CONDITION EQUAL OR BETTER THAN ORIGINAL CONDITION AND TO THE SATISFACTION OF THE CITY OR TOWNSHIP AUTHORITIES.
7. EXCAVATE AND DISPOSE OF ALL DELETERIOUS MATERIAL, SUCH AS ASPHALT, CURBING, EXISTING STOCKPILES, GRANULAR MATERIALS AND DEBRIS OFF SITE.
8. TOPSOIL TO BE STRIPPED AND REMOVED OFF SITE. CLEAN FILL TO BE PLACED IN FILL AREAS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
9. ALL DISTURBED AREAS TO BE RESTORED TO ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE SPECIFIED.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC CONTROL AND SAFETY MEASURES DURING THE CONSTRUCTION PERIOD, INCLUDING THE SUPPLY, INSTALLATION, AND REMOVAL OF ALL NECESSARY SIGNAGE, DELINEATORS, MARKERS AND BARRIERS.
11. DO NOT ALTER GRADING OF THE SITE WITHOUT PRIOR APPROVAL OF THE CITY OR TOWNSHIP.
12. ALL ROADWAY, PARKING LOT, AND GRADING WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH CITY OR TOWNSHIP STANDARDS AND SPECIFICATIONS. THE CONTRACTOR IS TO PROVIDE POSITIVE DRAINAGE AWAY FROM THE BUILDING.
13. CONTACT THE CITY OR TOWNSHIP FOR INSPECTION OF ROUGH GRADING OF PARKING LOTS, ROADWAYS AND LANDSCAPED AREAS PRIOR TO PLACEMENT OF ASPHALT AND TOPSOIL. ALL DEFICIENCIES NOTED SHALL BE RECTIFIED TO THE CITY OR TOWNSHIP SATISFACTION PRIOR TO PLACEMENT OF ANY ASPHALT, TOPSOIL, SEED & MULCH AND/OR SOD.
14. ALL DIMENSIONS AND INVERTS MUST BE VERIFIED PRIOR TO CONSTRUCTION, IF THERE IS ANY DISCREPANCY THE CONTRACTOR IS TO NOTIFY THE ENGINEER PROMPTLY.
15. ELECTRICAL, GAS, TELEPHONE AND TELEVISION SERVICE LOCATIONS ARE SUBJECT TO THE INDIVIDUAL AGENCY:
 - ELECTRICAL SERVICE - HYDRO OTTAWA,
 - GAS SERVICE - ENBRIDGE,
 - TELEPHONE SERVICE - BELL CANADA,
 - TELEVISION SERVICE - ROGERS.
17. INSTALLATION TO BE IN ACCORDANCE WITH CURRENT CODES AND STANDARDS OF APPROVAL AGENCIES HYDRO OTTAWA, BELL AND THE CITY OR TOWNSHIP.
18. ALL PROPOSED CURB SHALL BE CONCRETE BARRIER CURB UNLESS SPECIFIED.
19. ALL EXISTING REDUNDANT PRIVATE APPROACHES FRONTING THIS DEVELOPMENT MUST BE REMOVED TO THE SATISFACTION OF THE CITY OR TOWNSHIP.

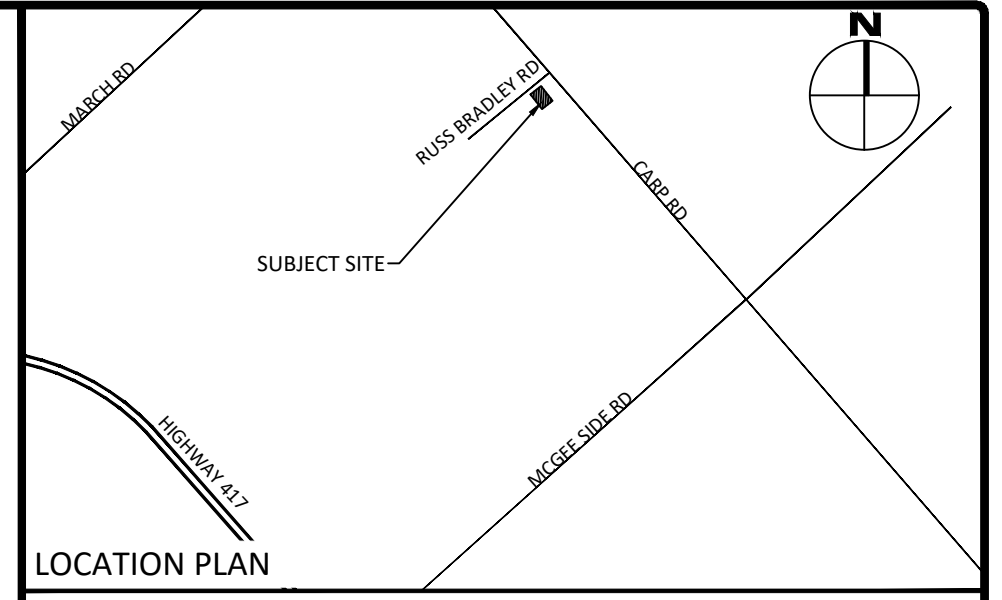


LEGEND

FOR REVIEW ONLY
 NOT FOR CONSTRUCTION

1	ISSUED FOR REVIEW	DEC. 23, 2022
No.	Revisions	Date

Check and verify all dimensions before proceeding with the work. Do not scale drawings.

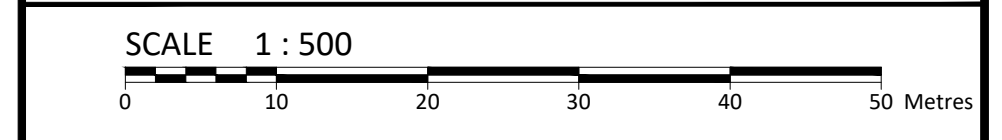

McINTOSH PERRY
 115 Walgreen Road, RR3, Carp, ON K0A 1L0
 Tel: 613-836-2184 Fax: 613-836-3742
 www.mcintoshperry.com


Stamp:
 Client: **TREVOR WATKINS**
 273 & 275 RUSS BRADLEY ROAD
 CARP, ON K0A 1L0

Project: **WAREHOUSE/STORAGE FACILITY**
 273 & 275 RUSS BRADLEY ROAD

CARP ON
 Drawing Title: **POST-DEVELOPMENT DRAINAGE AREA PLAN**

Scale: 1:500	Project Number: CCO-22-1643-01
Drawn By: NV	Checked By: BC
Designed By: NV	Project Number: CCO-22-1643-01
	Drawing Number: POST

LEGEND:

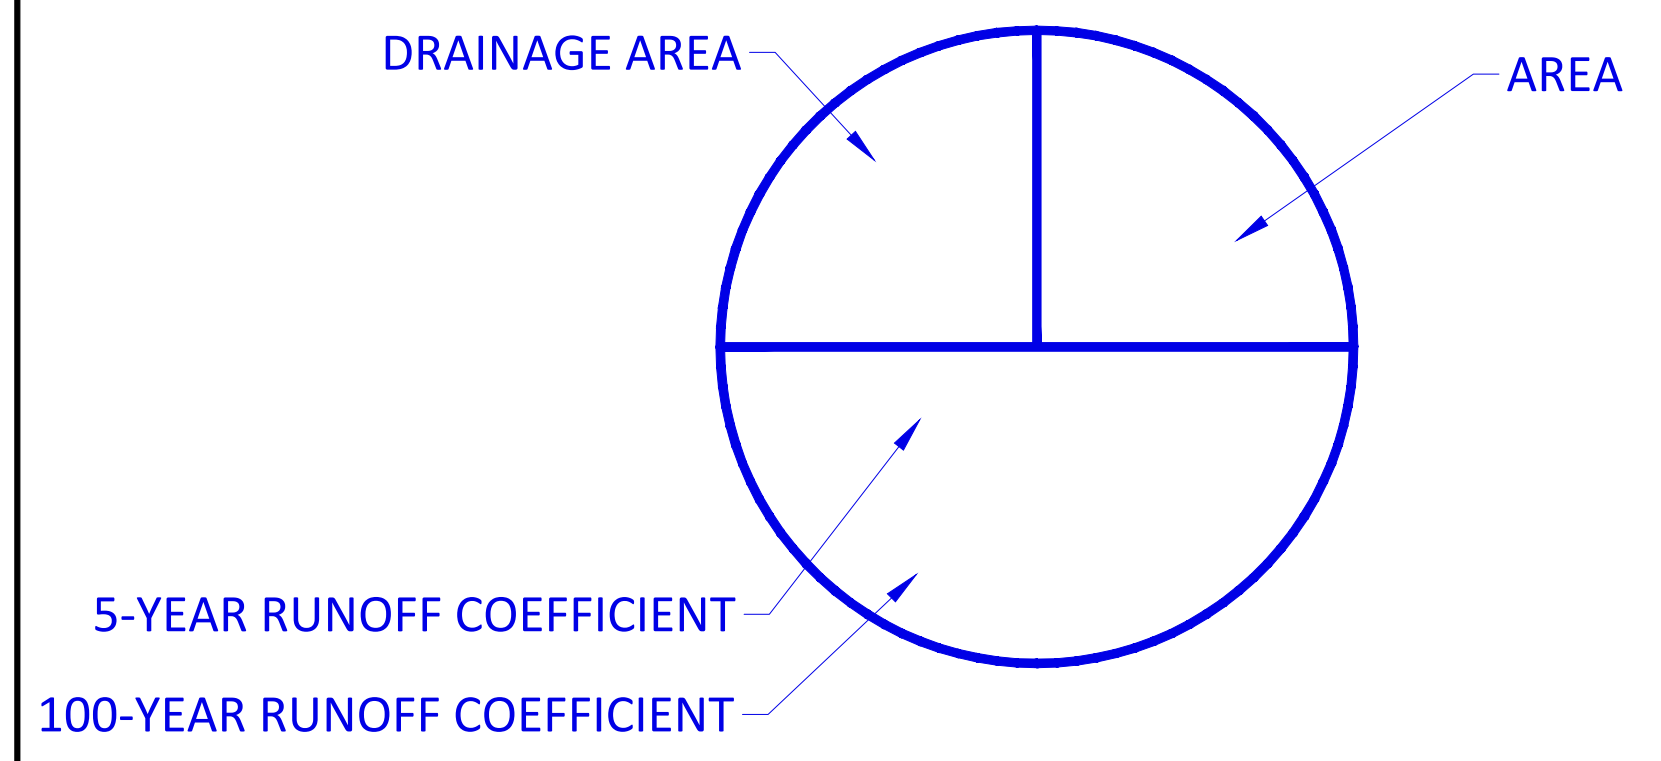

FILENAME: \\C:\Users\jperkins\OneDrive\Documents\2022\1643-01\Drawings\CCO-22-1643-01_Presentation.dwg
 LAST SAVED: Friday, December 23, 2022 1:51:45 PM BY: J. Perkins
 LAST PLOTTED: Friday, December 23, 2022 1:51:45 PM

D07-12-XX-XXXX

#XXXX

APPENDIX G
STORMWATER MANAGEMENT CALCULATIONS

McINTOSH PERRY

Pre-Development Runoff Coefficient

Drainage Area	Area (ha)	Impervious Area (m ²)	C	Gravel Area (m ²)	C	Pervious Area (m ²)	C	C _{AVG} 5-Year	C _{AVG} 100-Year
A1	2.425	0.00	0.90	805.20	0.60	23,441.53	0.20	0.21	0.27

Pre-Development Runoff Calculations

Drainage Area	Area (ha)	C 5-Year	C 100-Year	Tc (min)	I (mm/hr)		Q (L/s)	
					5-Year	100-Year	5-Year	100-Year
A1	2.425	0.21	0.27	10	104.2	178.6	149.79	320.88
Total	2.425						149.79	320.88

Post-Development Runoff Coefficient

Drainage Area	Area (ha)	Impervious Area (m ²)	C	Gravel Area (m ²)	C	Pervious Area (m ²)	C	C _{AVG} 5-Year	C _{AVG} 100-Year
B1	1.458	4,367.09	0.90	8,907.63	0.60	1,309.27	0.20	0.65	0.78
B2	0.966	2,043.32	0.90	2,844.74	0.60	4,774.68	0.20	0.47	0.56

Post-Development Runoff Calculations

Drainage Area	Area (ha)	C 5-Year	C 100-Year	Tc (min)	I (mm/hr)		Q (L/s)	
					5-Year	100-Year	5-Year	100-Year
B1	1.458	0.65	0.78	10	104.2	178.6	276.24	564.65
B2	0.966	0.47	0.56	10	104.2	178.6	130.37	266.59
Total	2.425						406.61	831.25

Required Restricted Flow

Drainage Area	Area (ha)	C 5-Year	C 100-Year	Tc (min)	I (mm/hr)		Q (L/s)	
					5-Year	100-Year	5-Year	100-Year
A1	2.425	0.21	0.27	10	104.2	178.6	149.79	320.88
Total	2.425						149.79	320.88

Post-Development Restricted Runoff Calculations

Drainage Area	Unrestricted Flow (L/s)		Restricted Flow (L/s)		Storage Required (m ³)		Storage Provided (m ³)		
	5-Year	100-Year	5-Year	100-Year	5-Year	100-Year	5-Year	100-Year	
B1	276.24	564.65	13.69	53.11	274.28	447.39	289.73	451.13	<i>Restricted Unrestricted</i>
B2	130.37	266.59	130.37	266.59					
Total	406.61	831.25	144.06	319.70	274.28	447.39	289.73	451.13	

McINTOSH PERRY

Storage Requirements for Area B1

5-Year Storm Event

Tc (min)	I (mm/hr)	B1 Runoff (L/s)	Allowable Outflow (L/s)	Runoff to be Stored (L/s)	Storage Required (m ³)
100	22.4	59.41	13.69	45.71	274.28
110	20.8	55.21	13.69	41.51	273.98
120	19.5	51.61	13.69	37.92	273.03
130	18.3	48.50	13.69	34.81	271.52
140	17.3	45.78	13.69	32.09	269.55
150	16.4	43.38	13.69	29.69	267.18
160	15.6	41.24	13.69	27.55	264.46
170	14.8	39.32	13.69	25.63	261.44
180	14.2	37.59	13.69	23.90	258.14
190	13.6	36.03	13.69	22.33	254.60

Maximum Storage Required 5-Year (m ³) =	274.28
---	--------

100-Year Storm Event

Tc (min)	I (mm/hr)	B1 Runoff (L/s)	Allowable Outflow (L/s)	Runoff to be Stored (L/s)	Storage Required (m ³)
30	91.9	290.51	53.11	237.40	427.32
35	82.6	261.14	53.11	208.02	436.85
40	75.1	237.63	53.11	184.52	442.84
45	69.1	218.36	53.11	165.24	446.16
50	64.0	202.24	53.11	149.13	447.39
55	59.6	188.55	53.11	135.43	446.94
60	55.9	176.75	53.11	123.64	445.11
65	52.6	166.48	53.11	113.37	442.15

Maximum Storage Required 100-Year (m ³) =	447.39
---	--------

Storage Occupied In Area B1

5-Year Storm Event

Water Elev. (m) =			114.15	
Structure	INV. (out)	Depth (m)	Head (m)	Volume (m ³)
SWM Area	113.99	0.25	0.09	289.73 *
				Total

Storage Available (m ³) =	289.73
Storage Required (m ³) =	274.28

100-Year Storm Event

Water Elev. (m) =			114.26	
Structure	INV. (out)	Depth (m)	Head (m)	Volume (m ³)
SWM Area	113.99	0.36	0.20	451.13 *
				Total

Storage Available (m ³) =	451.13
Storage Required (m ³) =	447.39

*Storage Calculated in AutoCAD

McINTOSH PERRY

For Orifice Flow, C= 0.60
 For Weir Flow, C= 1.84

	Orifice 1	Orifice 2	Weir 1
invert elevation	113.99		114.19
center of crest elevation	114.07		
orifice width / weir length	150 mm		0.95 m
orifice height			
orifice area (m ²)	0.018	0.000	

Elevation	Orifice 1		Orifice 2		Weir 1		Weir 2		Total Q [l/s]
	H [m]	Q [m ³]	H [m]	Q [m ³]	H [m]	Q [m ³]	H [m]	Q [m ³]	
114.06	x	x			x	x			0.00
114.07	0.01	0.003			x	x			3.32
114.08	0.02	0.006			x	x			5.75
114.09	0.03	0.007			x	x			7.43
114.10	0.04	0.009			x	x			8.79
114.11	0.05	0.010			x	x			9.96
114.12	0.06	0.011			x	x			11.01
114.13	0.07	0.012			x	x			11.97
114.14	0.08	0.013			x	x			12.86
114.15	0.09	0.014			x	x			13.69
114.16	0.10	0.014			x	x			14.48
114.17	0.11	0.015			x	x			15.22
114.18	0.12	0.016			x	x			15.93
114.19	0.13	0.017			x	x			16.60
114.20	0.14	0.017			0.01	0.00			19.00
114.21	0.15	0.018			0.02	0.00			22.83
114.22	0.16	0.018			0.03	0.01			27.57
114.23	0.17	0.019			0.04	0.01			33.06
114.24	0.18	0.020			0.05	0.02			39.19
114.25	0.19	0.020			0.06	0.03			45.89
114.26	0.20	0.021			0.07	0.03			53.11
114.27	0.21	0.021			0.08	0.04			60.82
114.28	0.22	0.022			0.09	0.05			68.97
114.29	0.23	0.022			0.10	0.06			77.55
114.30	0.24	0.023			0.11	0.06			86.54
114.31	0.25	0.023			0.12	0.07			95.91
114.32	0.26	0.024			0.13	0.08			105.65
114.33	0.27	0.024			0.14	0.09			115.74
114.34	0.28	0.025			0.15	0.10			126.18
114.35	0.29	0.025			0.16	0.11			136.94
114.36	0.30	0.026			0.17	0.12			148.03
114.37	0.31	0.026			0.18	0.13			159.43
114.38	0.32	0.026			0.19	0.14			171.13
114.39	0.33	0.027			0.20	0.16			183.12

- Notes:
1. For Orifice Flow, User is to Input an Elevation Higher than Crown of Orifice.
 2. Orifice Equation: $Q = cA(2gh)^{1/2}$
 3. Weir flow calculated in Bentley's FlowMaster - Trapezoidal Channel at 0.8%, 3:1 side slopes, roughness coeff. Of 0.035
 4. These Computations Do Not Account for Submergence Effects Within the Pond Riser.
 5. H for orifice equations is depth of water above the centroid of the orifice.
 6. H for weir equations is depth of water above the weir crest.

SOAKAWAY PIT INFILTRATION CALCULATION

Volume Required to be Infiltrated

Required Infiltration Rate:	230 mm/yr	(Moderate Recharge Area per Figure 9.3 - Carp River Watershed / Subwatershed Study)
Site Area:	2.42 ha	
Required Infiltration Volume:	5577 m ³ /yr	(Required Infiltration X Site Area)
Post-Dev Pervious Area:	0.61 ha	
Infiltration in Pervious Area:	1,399 m ³ /yr	
Infiltration needed in Basin:	4,177 m ³ /yr	

Annual Rainfall Data (Up to 25mm Storm Event)

Number of events/yr 5mm<x<25mm:	51	
Average Days Between Events:	7.1	
Average Depth 5mm<x<25mm:	11.88 mm	
Site Area being collected	14583.99 m ²	
Cummulative Rainfall Depth 5mm<x<25mm:	605.88 mm/yr	(Number of Events X Average Depth)
Maximum Volume of Runoff per year to Infiltrate:	8836.15 m ³ /yr	(Area X Cummulative Rainfall Depth)

Required Storage Volume (6mm)

Required Storage Volume:	87.50 m ³	(Area x 6mm)
Assumed Porosity (n):	100%	(Surface Storage at Bottom of Pond)
Clearstone Volume:	87.50 m ³	(Storage Volume/n)
Total Volume Infiltrated :	4462.70 m ³ /yr	(5mm Event Volume X Number of Events Per Year)

Ponding Area Sizing

Depth of Pond Area:	0.09 m	
Area:	1123.73 m ²	*calculated from AutoCAD
Volume:	97.09 m ³	*calculated from AutoCAD

Infiltration Rate Through Soil

Percolation Rate:	21.2 mm/hr	(Lowest measured rate from percolation testing)
Percolation Rate:	3.0 mm/hr	(Factor of safety built of 7 applied per Geotech)
Infiltration Rate:	0.94 L/s	(Percolation Rate X Area of Ponding)

Retention Time (6 mm)

Volume of Water during the 5mm event:	87.50 m ³	
Depth of Ponding Area:	0.16 m	
Time:	25.7 hr	(Volume / Infiltration Rate)
	1.07 days	

APPENDIX H
CITY OF OTTAWA DESIGN CHECKLIST

City of Ottawa

4. Development Servicing Study Checklist

The following section describes the checklist of the required content of servicing studies. It is expected that the proponent will address each one of the following items for the study to be deemed complete and ready for review by City of Ottawa Infrastructure Approvals staff.

The level of required detail in the Servicing Study will increase depending on the type of application. For example, for Official Plan amendments and re-zoning applications, the main issues will be to determine the capacity requirements for the proposed change in land use and confirm this against the existing capacity constraint, and to define the solutions, phasing of works and the financing of works to address the capacity constraint. For subdivisions and site plans, the above will be required with additional detailed information supporting the servicing within the development boundary.

4.1 General Content

Criteria	Location (if applicable)
<input type="checkbox"/> Executive Summary (for larger reports only).	N/A
<input type="checkbox"/> Date and revision number of the report.	On Cover
<input type="checkbox"/> Location map and plan showing municipal address, boundary, and layout of proposed development.	Appendix A
<input type="checkbox"/> Plan showing the site and location of all existing services.	Site Servicing Plan (C102)
<input type="checkbox"/> Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.	1.1 Purpose 1.2 Site Description 6.0 Stormwater Management
<input type="checkbox"/> Summary of pre-consultation meetings with City and other approval agencies.	Appendix B
<input type="checkbox"/> Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.	1.1 Purpose 1.2 Site Description 6.0 Stormwater Management
<input type="checkbox"/> Statement of objectives and servicing criteria.	3.0 Pre-Consultation Summary

<input type="checkbox"/> Identification of existing and proposed infrastructure available in the immediate area.	N/A
<input type="checkbox"/> Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).	Site Grading Plan (C101)
<input type="checkbox"/> Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.	Site Grading Plan (C101)
<input type="checkbox"/> Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.	N/A
<input type="checkbox"/> Proposed phasing of the development, if applicable.	N/A
<input type="checkbox"/> Reference to geotechnical studies and recommendations concerning servicing.	Section 2.0 Background Studies, Standards and References
<input type="checkbox"/> All preliminary and formal site plan submissions should have the following information: <ul style="list-style-type: none"> ○ Metric scale ○ North arrow (including construction North) ○ Key plan ○ Name and contact information of applicant and property owner ○ Property limits including bearings and dimensions ○ Existing and proposed structures and parking areas ○ Easements, road widening and rights-of-way ○ Adjacent street names 	Site Grading Plan (C101)

4.2 Development Servicing Report: Water

Criteria	Location (if applicable)
<input type="checkbox"/> Confirm consistency with Master Servicing Study, if available	N/A
<input type="checkbox"/> Availability of public infrastructure to service proposed development	N/A
<input type="checkbox"/> Identification of system constraints	N/A
<input type="checkbox"/> Identify boundary conditions	Appendix C
<input type="checkbox"/> Confirmation of adequate domestic supply and pressure	N/A
<input type="checkbox"/> Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.	Appendix C
<input type="checkbox"/> Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	N/A
<input type="checkbox"/> Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design	N/A
<input type="checkbox"/> Address reliability requirements such as appropriate location of shut-off valves	N/A
<input type="checkbox"/> Check on the necessity of a pressure zone boundary modification.	N/A
<input type="checkbox"/> Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range	Appendix C, Section 4.2

<input type="checkbox"/> Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.	Site Servicing Plan (C101)
<input type="checkbox"/> Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	N/A
<input type="checkbox"/> Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Appendix C
<input type="checkbox"/> Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	N/A

4.3 Development Servicing Report: Wastewater

Criteria	Location (if applicable)
<input type="checkbox"/> Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	N/A
<input type="checkbox"/> Confirm consistency with Master Servicing Study and/or justifications for deviations.	N/A
<input type="checkbox"/> Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	N/A
<input type="checkbox"/> Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Section 5.2 Proposed Sanitary Sewer

<input type="checkbox"/> Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)	Section 5.3 Proposed Sanitary Design
<input type="checkbox"/> Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.	N/A
<input type="checkbox"/> Description of proposed sewer network including sewers, pumping stations, and forcemains.	Section 5.2 Proposed Sanitary Sewer
<input type="checkbox"/> Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	N/A
<input type="checkbox"/> Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	N/A
<input type="checkbox"/> Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	N/A
<input type="checkbox"/> Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	N/A
<input type="checkbox"/> Special considerations such as contamination, corrosive environment etc.	N/A

4.4 Development Servicing Report: Stormwater Checklist

Criteria	Location (if applicable)
<input type="checkbox"/> Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> Analysis of available capacity in existing public infrastructure.	N/A
<input type="checkbox"/> A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	Pre & Post-Development Plans
<input type="checkbox"/> Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5-year event (dependent on the receiving sewer design) to 100-year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> Description of the stormwater management concept with facility locations and descriptions with references and supporting information.	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> Set-back from private sewage disposal systems.	N/A
<input type="checkbox"/> Watercourse and hazard lands setbacks.	N/A
<input type="checkbox"/> Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	N/A
<input type="checkbox"/> Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.	N/A
<input type="checkbox"/> Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5-year return period) and major events (1:100-year return period).	Appendix G

<input type="checkbox"/> Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	Site Grading Plan
<input type="checkbox"/> Calculate pre-and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Section 7.0 Proposed Stormwater Management Appendix G
<input type="checkbox"/> Any proposed diversion of drainage catchment areas from one outlet to another.	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.	N/A
<input type="checkbox"/> Identification of potential impacts to receiving watercourses	N/A
<input type="checkbox"/> Identification of municipal drains and related approval requirements.	N/A
<input type="checkbox"/> Descriptions of how the conveyance and storage capacity will be achieved for the development.	Section 6.0 Stormwater Sewer Design & Section 7.0 Proposed Stormwater Management
<input type="checkbox"/> 100-year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	Site Grading Plan (C101)
<input type="checkbox"/> Inclusion of hydraulic analysis including hydraulic grade line elevations.	N/A

<input type="checkbox"/> Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	Section 8.0 Sediment & Erosion Control
<input type="checkbox"/> Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	N/A
<input type="checkbox"/> Identification of fill constraints related to floodplain and geotechnical investigation.	N/A

4.5 Approval and Permit Requirements: Checklist

The Servicing Study shall provide a list of applicable permits and regulatory approvals necessary for the proposed development as well as the relevant issues affecting each approval. The approval and permitting shall include but not be limited to the following:

Criteria	Location (if applicable)
<input type="checkbox"/> Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.	N/A
<input type="checkbox"/> Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.	N/A
<input type="checkbox"/> Changes to Municipal Drains.	N/A
<input type="checkbox"/> Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)	N/A

4.6 Conclusion Checklist

Criteria	Location (if applicable)
<input type="checkbox"/> Clearly stated conclusions and recommendations	Section 9.0 Summary Section 10.0 Recommendations
<input type="checkbox"/> Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.	All are stamped
<input type="checkbox"/> All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario	All are stamped