

STRUCTURAL ENGINEERING

110-333 Preston Street, Ottawa, ON, K1S 5N4

NOTES


- REFER TO CIVIL DRAWINGS FOR GRADING DETAILS INCLUDING ALL FINISHED ELEVATIONS, DRAINS ETC.
- REFER TO LANDSCAPE DRAWINGS FOR ALL LANDSCAPING REQUIREMENTS.
- 3. REFER TO GEOTECHNICAL REPORT FOR SLOPE STABILITY REQUIREMENTS.
- 4. SEE SECTIONS FOR RETAINING WALL DETAILS.
- 5. REFER TO ARCHITECTURAL/ LANDSCAPE DRAWINGS FOR GUARDRAIL DETAILS REQUIRED WHERE RETAINED HEIGHT EXCEEDS 600mm


D+M Structural Ltd. 110-333 Preston Street, Ottawa, ON, K1S 5N4 Phone: (613) 651-9490

THIS DRAWING IS PROVIDED BY AND IS THE PROPERTY OF D+M STRUCTURAL LTD. COPYRIGHT RESERVED. NOT TO BE USED FOR CONSTRUCTION UNLESS STAMPED AND SIGNED BY ENGINEER. CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE PROCEEDING. ALL WORK TO BE COMPLETED IN COMPLIANCE WITH APPLICABLE BUILDING CODES, REGULATIONS, AND BY-LAWS. DO NOT SCALE DRAWINGS

CONCRETE NOTES:


- 1. ALL CONCRETE WORK TO COMPLY WITH CSA A23.1/A23.2
- 2. REINFORCING STEEL SHALL BE DEFORMED STEEL BARS IN ACCORDANCE WITH CSA G30.18, GRADE 400R
- 3. CONCRETE PERFORMANCE CHARACTERISTICS
 28-DAY STRENGTH: 25mPa
 EXPOSURE CLASS: F-2
 AIR ENTRAINMENT: 4-7%
- 4. ALL REINFORCING STEEL TO BE DETAILED, FABRICATED, PLACED, & SUPPORTED IN ACCORDANCE WITH THE REINFORCING STEEL INSTITUTE OF CANADA MANUAL OF STANDARD PRACTICE
- 5. CONCRETE COVER TO REINFORCING BARS
 FOUNDATION BOTTOM BARS: 75mm
 REMAINDER: 40mm
- 6. ALL EXPOSED CORNERS TO HAVE 19mm CHAMFER (TYP.)

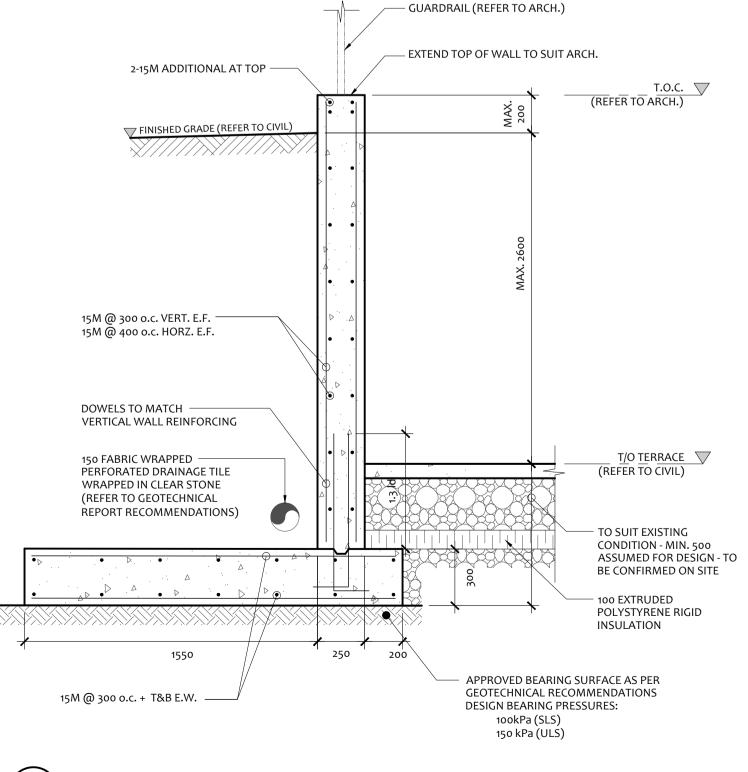

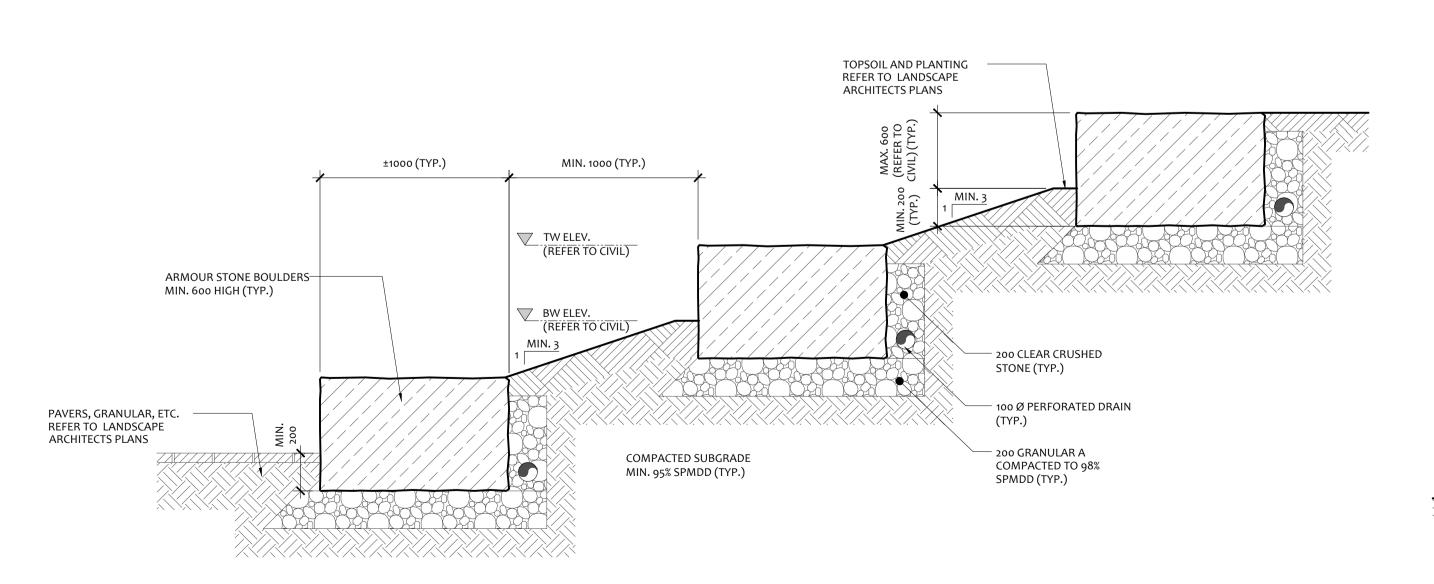

SECTION: TYPICAL ARMOUR STONE TERRACED WALL
S-200 SCALE: 1:20

SECTION: TYPICAL CAST-IN-PLACE CONCRETE RETAINING WALL
S-200 SCALE: 1:20

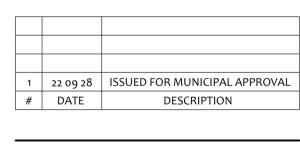

NORTH ARROW:



PROJECT NAME AND ADDRESS:

8 STOREY APARTMENT
BUILDING CONVERSION
1600 JAMES NAISMITH DRIVE
OTTAWA, ON

DRAWING NAME:
SECTIONS

DESIGNED BY: C. DAVIES

DRAWN BY: A. WITTICH

START DATE: 2022 09 26

D+M PROJECT #: 22-110

° | S-2