

*Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermains*

700 Long Point Circle  
Ottawa, Ontario K1T 4E9

613-425-8044  
d.gray@dbgrayengineering.com

## SITE SERVICING STUDY & STORMWATER MANAGEMENT REPORT

3130 WOODROFFE AVENUE  
OTTAWA, ONTARIO

REPORT NO. 20055

MARCH 17, 2022  
REVISED SEPTEMBER 8, 2022  
REVISED OCTOBER 31, 2022

# CONTENTS

- 1.0 INTRODUCTION**
- 2.0 WATER SERVICING**
  - 2.1 WATER SUPPLY FOR FIREFIGHTING
  - 2.2 DOMESTIC WATER SUPPLY
- 3.0 SANITARY SERVICING**
- 4.0 STORMWATER MANAGEMENT**
  - 4.1 QUALITY CONTROL
  - 4.2 QUANTITY CONTROL
  - 4.3 STORM SERVICING
- 5.0 CONCLUSIONS**

# LIST OF APPENDICES

- A WATER SERVICING
- B SANITARY SERVICING
- C STORMWATER MANAGEMENT & STORM SERVICING
- D CITY OF OTTAWA SERVICING STUDY CHECKLIST

## **1.0 INTRODUCTION**

This report describes the servicing and stormwater management requirements for a proposed dental clinic and four semi-detached dwellings located on a 3,829 sq.m. property at 3130 Woodroffe Avenue in Ottawa, Ontario. This report has been prepared in support of the Site Plan Control application for the proposed development. The property is currently occupied by an existing single family dwelling to be demolished.

This report forms part of the servicing and stormwater management design for the proposed development. Also refer to drawings C-1 to C-7 prepared by D.B. Gray Engineering Inc.

## **2.0 WATER SERVICING**

### **2.1 WATER SUPPLY FOR FIREFIGHTING**

The proposed dental clinic will have a sprinkler system with the fire department connection (FDC) located at the southwest corner of the dental clinic building. There is an existing municipal Class AA fire hydrant located at the northwest of the Woodroffe Avenue / Deerfox Drive intersection. It is 41 m unobstructed distance to the proposed FDC, which is less than the maximum 45 m required by the Ontario Building Code (OBC); therefore, a private fire hydrant is not required for dental clinic building. The existing municipal fire hydrant is also 85 m unobstructed distance to the far side of the front façade of the north semi-detached dwelling, which is less than the maximum 90 m required by the OBC; therefore, a private fire hydrant is not required for the residential buildings.

As per City of Ottawa Technical Bulletin ISTB-2021-03, when calculating the required fire flow where pipe sizing is affected, the Fire Underwriters Survey (FUS) method is to be used. Using the FUS method the required fire flow was calculated to be 3,000 L/min (50 L/s) for the dental clinic, and 9,000 L/min (150 L/s) for one block of semi-detached dwellings. Refer to calculations in Appendix A.

The boundary conditions in the 200 mm Deerfox Drive watermain provided by the City of Ottawa for the 150 L/s fire flow at the subject property indicate a hydraulic grade line (HGL) of 117.8 m prior to the SUC zone reconfiguration and 144.0 m following the SUC zone reconfiguration. Refer to Appendix A. These HGLs calculate to 232 kPa (34 psi) prior to the SUC zone reconfiguration and 489 kPa (71 psi) following the SUC zone reconfiguration. Since the pressures are above the required minimum pressure of 140 kPa (20 psi), there is an adequate water supply for firefighting from the existing municipal water distribution system.

As per City of Ottawa Technical Bulletin ISTB-2018-02, the aggregate flow of all contributing fire hydrants within 150 m of the building shall not be less than the required fire flow. There are three existing municipal Class AA fire hydrants within between 75 m and 150 m of the proposed semi-detached dwellings. As indicated above, one is located northwest of the intersection of Woodroffe Avenue and Deerfox Drive. Another is located in front of 15 Deerfox Drive and the third is located in front of 3112 Woodroffe Avenue. As per Table 1 of ISTB-2018-02 each can contribute 3800 L/min (63.3 L/s). Therefore, the aggregate flow of the three contributing fire hydrants is 11,400 L/min (190 L/s), which is greater than the required fire flow of 9,000 L/min (150 L/s).

## **2.2 DOMESTIC WATER SUPPLY**

A proposed 150 mm private water main connecting to the 200 mm municipal watermain in Deerfox Drive will service the development. A 50 mm private water main connecting to the 150 mm private water main will service the proposed residential buildings. Each semi-detached unit will have a 19 mm water service connecting to the proposed 50 mm private watermain. A 150 mm water service connecting to the proposed 150 mm private watermain is proposed to service the sprinkler system of the dental clinic; which is adequate for the domestic water demand.

As per;

- i. the City of Ottawa Water Design Guidelines for the residential population, commercial consumption rate and commercial peaking factors;
- ii. City of Ottawa Technical Bulletin ISTB-2021-03 for the residential consumption rate; and
- iii. the Ministry of the Environment Water Design Guidelines for residential peaking factors;

the average daily demand was calculated to be 0.2 L/s, the maximum daily demand was calculated to be 0.6 L/s and the maximum hourly demand was calculated to be 1.0 L/s. Refer to calculations in Appendix A.

The boundary conditions in the 200 mm Deerfox Drive watermain provided by the City of Ottawa at the subject property indicate a minimum HGL of 141.6 m and a maximum HGL of 157.4 m prior to the SUC zone reconfiguration, and a minimum HGL of 145.5 m and a maximum HGL of 147.7 m following the SUC zone reconfiguration. Refer to Appendix A. Based on these boundary conditions the pressure at the water meter is calculated to vary between 446 kPa (65 psi) and 601 kPa (87 psi) prior to the SUC zone reconfiguration and 484 kPa (70 psi) and 506 kPa (73 psi) following to the SUC zone reconfiguration. This is an acceptable range for the proposed development. Since the water pressure is expected to be above 80 psi at times a pressure reducing valve (PRV) is to be installed immediately after the water meter.

## **3.0 SANITARY SERVICING**

As per;

- i. the City of Ottawa Sewer Design Guidelines for the residential population and commercial peaking factor;
- ii. City of Ottawa Technical Bulletin ISTB-2018-01 for the consumption rates, Harmon Formula correction factor and infiltration allowance; and
- iii. the Harmon Formula for the residential peaking factor;

the post-development sanitary flow rate was calculated to be 0.52 L/s.

A 200 mm private sanitary sewer at 0.65% slope (26.80 L/s capacity) is proposed to connect to the proposed 250 mm municipal sanitary sewer in Deerfox Drive, which at 0.60% slope will have a capacity of 46.56 L/s (reference Stoneway Drive / Woodroffe Avenue / Deerfox Drive Municipal Sanitary Sewer Extension Report and drawings prepared by D. B. Gray Engineering Inc.). At the design flow rate the 200 mm sanitary sewer will only be at 2% of its capacity. The post development flow is expected to have an acceptable impact on the 250 mm Deerfox Drive sanitary sewer. Refer to calculations in Appendix B.

A 135 mm sanitary sewer service at 2% slope (15.63 L/s capacity) is proposed to service each semi-detached dwelling unit. A 150 mm building sanitary sewer service at 1% slope (14.43 L/s capacity) is

proposed to service the dental clinic building. The proposed building sanitary sewer services will connect to the proposed 200 mm private sanitary sewer system.

#### **4.0 STORMWATER MANAGEMENT**

##### **4.1 QUALITY CONTROL**

Drainage from 3130 Woodroffe Avenue is conveyed to the Longfields Davidson Heights Stormwater Management Facility (SWMF) which provides quality control. On-site quality control measures are not required and none are proposed.

An Erosion & Sediment Control Plan has been developed to be implemented during construction. Refer to drawing C-3 and notes 2.1 to 2.6 on drawing C-5. In summary, to filter out construction sediment: a silt fence barrier is to be installed at the perimeter of the site where runoff will drain off the site; sediment capture filter sock inserts are to be installed in all existing catch-basins adjacent to the site and in all new catch basins as they are installed; and any material deposited on a public road is to be removed as required.

##### **4.2 QUANTITY CONTROL**

It was calculated that the pre-development conditions reflect a 5-year composite runoff coefficient of 0.35. The individual runoff coefficients were each increased by 25% to a maximum of 1.00 to calculate the pre-development conditions during the 100-year event. Using the Bransby-Williams Formula the pre-development time of concentration was calculated to be 5 minutes. Using the Rational Method with a time of concentration of 10 minutes, the pre-development flow rates were calculated to be 78.98 L/s during the 100-year event and 39.32 L/s during the 5-year event

As per the Longfields Davidson Heights Serviceability Study (Update Report (1998) (Report # R-0135)), the stormwater quantity control criterion for the subject development is to control the post-development flow rate to 64 L/s/ha, up to and including the 100-year storm event. Therefore, the maximum allowable release rate for the 3,829 sq.m. property was calculated to be 24.51 L/s

The Modified Rational Method was used to calculate the post development flow rates and corresponding storage volumes. The runoff coefficients for the 100-year event are increased by 25% to maximum 1.00. Refer to calculations in Appendix C.

##### **Drainage Area I (Dental Clinic Roof – 532 sq.m.)**

The two roof drains are to be flow control type roof drains which will restrict the flow of stormwater and cause it to pond on the roof. Each roof drain is to be installed with a single-slotted weir with the slot having a parabolic shape releasing 0.0124 L/s/mm (5 USgpm/in). Roof drains are to be Watts with an Accutrol Weir RD-100-A1 or approved equal. The opening at the top of the flow control weir is to be a minimum 50 mm in diameter. A minimum of four scuppers each a minimum 400 mm wide are to be installed 150 mm above the roof drains. Refer to architectural for exact locations and details. The roof will be designed to carry the load of water having a 50 mm depth at the scuppers or 200 mm depth at the roof drains (refer to structural).

|                              | 100-Year Event | 5-Year Event |
|------------------------------|----------------|--------------|
| Maximum Release Rate         | 3.35 L/s       | 2.56 L/s     |
| Maximum Depth at Roof Drains | 135 mm         | 103 mm       |
| Maximum Volume Stored        | 18.64 cu.m.    | 8.32 cu.m.   |

**Drainage Area II (2,002 sq.m.)**

An inlet control device (ICD) located in the outlet pipe of catch-basin / manhole CB/MH-2 will restrict the flow of stormwater and cause it to backup into the upstream infrastructure into oversized pipes and pond in the rear and side yards of the residential buildings above ditch-inlet CB/MH-1 and pond in the asphalted area above CB/MH-0. The ICD will be a vortex style ICD manufactured by Hydrovex or approved equal and shall be sized by the manufacturer of 6.00 L/s at 2.07 m. (The City of Ottawa's minimum recommended release rate is 6.00 L/s.) It was calculated that an orifice area of 4,418 sq.mm (75 mm diam.) with a discharge coefficient of 0.213 will achieve the release rate of 6.00 L/s at 2.07 m. Based on this orifice the maximum release rate for the 5-year storm event is calculated to be 5.89 L/s at 2.00 m. Since there is underground storage, a release rate equal to 50% of the maximum release rate was used to calculate the required storage volumes.

|                           | 100-Year Event | 5-Year Event |
|---------------------------|----------------|--------------|
| Maximum Release Rate      | 6.00 L/s       | 5.89 L/s     |
| Maximum Ponding Elevation | 94.14 m        | 94.06 m      |
| Maximum Volume Stored     | 65.50 cu.m.    | 27.83 cu.m.  |

**Drainage Area III (1,295 sq.m.)**

An inlet control device (ICD) located in the outlet pipe of catch-basin / manhole CB/MH-11 will restrict the flow of stormwater and cause it to backup into the upstream infrastructure and into oversized pipes. The ICD will be a plug style with a round orifice located at the bottom of the plug with a trash basket manufactured by Pedro Plastics (or approved equal) and shall be sized by the manufacturer for a release rate of 15.17 L/s at 1.05 m. It was calculated that an orifice area of 5,486 sq.mm (84 mm diam.) with a discharge coefficient of 0.61 will achieve the release rate of 15.17 L/s at 1.05 m. Based on this orifice the maximum release rate for the 5-year storm event is calculated to be 9.313 L/s at 0.39 m. Since there is underground storage, a release rate equal to 50% of the maximum release rate was used to calculate the required storage volumes.

|                           | 100-Year Event | 5-Year Event |
|---------------------------|----------------|--------------|
| Maximum Release Rate      | 15.17 L/s      | 9.31 L/s     |
| Maximum Ponding Elevation | 93.20 m        | 92.55 m      |
| Maximum Volume Stored     | 31.71 cu.m.    | 15.31 cu.m.  |

## Entire Site

|                                  | 100-Year Event | 5-Year Event |
|----------------------------------|----------------|--------------|
| Pre-Development Flow Rate        | 78.98 L/s      | 39.32 L/s    |
| Maximum Allowable Release Rate   | 24.51 L/s      | 24.51 L/s    |
| Maximum Release Rate             | 24.51 L/s      | 17.76 L/s    |
| Maximum Volume Required & Stored | 115.85 cu.m.   | 51.47 cu.m.  |

The maximum post-development release rate during the 100-year event was calculated to be 24.51 L/s, which is 69% less than the pre-development flow rate and equal to the maximum allowable release rate. To achieve the maximum allowable release rate, a maximum storage volume of 115.85 cu.m. is required and provided. The maximum post-development release rate during the 5-year event was calculated to be 17.76 L/s, which is 55% less than the pre-development flow rate and 28% less than the maximum allowable release rate.

### 4.3 STORM SERVICING

The private storms sewer system proposed for the development has a branch that is free flowing and serves the foundation drains of each building and the flow control roof drains of the dental clinic building. ICDs restrict the flow in the other branches of the private storm sewer system. Backwater valves are not required for the residential units because they do not have basements. With the previous City approved site plan, the storm sewer service connected to a 1200 mm municipal storm sewer Woodroffe Avenue. However, the City no longer permits a connection to the Woodroffe sewers; the City only permits a connection to the 375 mm Deerfox Drive municipal storm sewer. However, the Deerfox Drive storm sewer is about 1.3 m higher than the Woodroffe Avenue storm sewer; it is only about 0.5 m below existing grade elevations at the northeast corner of the subject site; and it is only 1.0 m below lowest proposed grade elevations; therefore, significant and extensive insulation is required over all of the proposed private storm sewers. The proposed Dental Clinic will have a basement and the Deerfox Drive storm is not sufficiently deep to drain the foundation drains by gravity; therefore the foundation drains will drain to a sump and be pumped to storm drain in the basement. As per the ISTB 2018-04 (Section 5.7.5 OSDG), a backwater valve is required for all pumped storm systems; therefore a backwater valve is proposed for the Dental Clinic.

A 200 mm storm sewer connection at 2% slope (47.01 L/s capacity) is proposed to service the dental clinic building. At the 5-year unrestricted roof flow rate of 13.87 L/s the storm sewer connection would be at 42% of its capacity. However, the 5-year restricted roof flow rate (through the flow control roof drains) was calculated to be 2.56 L/s; therefore, the storm sewer will only be at about 5% of its capacity. Refer to calculations in Appendix D. The proposed 200 mm storm service will connect to the proposed free flowing branch of the private storm sewer system.

Each semi-detached unit will have 100 mm storm service at 1% slope connecting to the proposed free flowing branch of the private storm sewer system. The roof drains on the residential buildings will discharge to grade.

As previously mentioned; the private storm sewer system is proposed to connect to the existing 375 mm municipal storm sewer in Deerfox Drive. The unrestricted 5-year flow rate in each pipe segment varies from 2% to 90% capacity, with the last pipe segment (375 mm at 0.26% slope – 83.79 L/s capacity) at

90%. However, at the 5-year restricted flow rate of 17.69 L/s (through the ICDs) the last pipe segment will only be at 21% capacity.


The post-development flow is expected to have an acceptable impact on the 375 mm Deerfox Drive storm sewer; which at a 0.8% slope has a capacity of 146.98 L/s. Refer to calculations in Appendix D.

## **5.0 CONCLUSIONS**

1. A private fire hydrant is not required.
2. There is an adequate water supply for firefighting from the existing municipal water distribution system.
3. The aggregate flow of the three contributing fire hydrants is greater than the required fire flow.
4. The proposed private watermains and water service connections are adequate for the domestic demand.
5. The range of water pressures is acceptable for the proposed development.
6. Since the water pressure may be above 80 psi at times, it is recommended a pressure test be conducted at the completion of construction to determine if a pressure reducing valve is required.
7. The post-development sanitary flow rate will be adequately handled by the proposed sanitary sewer service connections and private sanitary sewer system.
8. The post development sanitary flow is expected to have an acceptable impact on the proposed 250 mm municipal sanitary sewer in Deerfox Drive.
9. Stormwater drainage from 3130 Woodroffe Avenue is conveyed to the Longfields Davidson Heights SWMF which provides quality control. On-site quality control measures are not required and none are proposed.
10. An Erosion & Sediment Control Plan has been developed to be implemented during construction.
11. The maximum post-development stormwater release rate during the 100-year event is 69% less than the pre-development flow rate and equal to the maximum allowable release rate. The maximum post-development release rate during the 5-year event is 55% less than the pre-development flow rate during the 5-year event and 28% less than the maximum allowable release rate.
12. The post-development storm flow rates will be adequately handled by the proposed storm service connections and private storm sewer system.
13. The post-development stormwater flows is expected to have an acceptable impact on the existing municipal storm sewer in Deerfox Drive.




Prepared by D.B. Gray Engineering Inc.

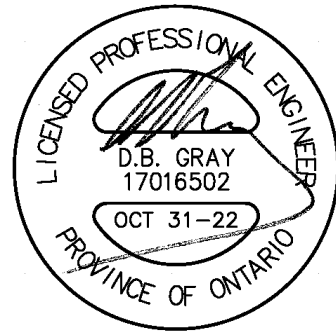

NOT VALID UNLESS  
SIGNED & DATED

## **APPENDIX A**

### WATER SERVICING

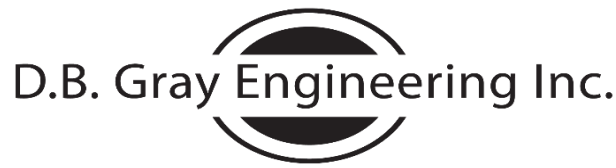

Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermains  
 700 Long Point Circle  
 Ottawa, Ontario K1T 4E9  
 613-425-8044  
 d.gray@dbgrayengineering.com

03-Dec-21

## Dental Clinic Building 3130 Woodroffe Avenue Ottawa, Ontario

### Fire Flow Requirements

Fire flow requirement as calculated as per Fire Underwriters Survey "Water Supply For Fire Protection".

$F = 220 C A^{0.5}$  = the required fire flow in litres per minute

C = coefficient related to the type of construction  
 = 0.8 Non-combustible Construction (unprotected structural components)

A = total floor area (all storeys excluding basements at least 50% below grade)

TOTAL FIRE AREA: 532 sq.m.

F = 4,059 L/min  
 = 4,000 L/min (rounded off to the nearest 1,000 L/min)

-15% Charge for Limited-combustible Occupancy

= 3,400 L/min

40% Reduction for Sprinkler System

= 1,360 L/min

Increase for Separation Exposed Buildings

|   |                    | Adjacent Building |             |         | Length-<br>Height<br>Factor |   |    |
|---|--------------------|-------------------|-------------|---------|-----------------------------|---|----|
|   |                    | Construction      | Length m    | Storeys |                             |   |    |
| 8%  | North              |                   | 20.1 to 30m | W-F     | 13                          | 2 | 26 |
| 0%  | East               |                   | >45m        |         |                             |   | 0  |
| 0%  | South              |                   | >45m        |         |                             |   | 0  |
| 9%  | West               |                   | 20.1 to 30m | W-F     | 25                          | 3 | 75 |
| 17% Total Increase for Exposure (maximum 75%) |                    |                   |             |         |                             |   |    |
| =   | 578 L/min Increase |                   |             |         |                             |   |    |

= 2,618 L/min

F = 3,000 L/min (rounded off to the nearest 1,000 L/min)

= 50.0 L/s



Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermains  
 700 Long Point Circle  
 Ottawa, Ontario K1T 4E9  
 613-425-8044  
 d.gray@dbgrayengineering.com

Revised 03-Dec-21  
 22-Feb-22

## Semi-Detached Residential Building 3130 Woodroffe Avenue Ottawa, Ontario

### Fire Flow Requirements

Fire flow requirement as calculated as per Fire Underwriters Survey "Water Supply For Fire Protection".

$$F = 220 C A^{0.5} = \text{the required fire flow in litres per minute}$$

C = coefficient related to the type of construction  
 = 1.5 Wood Frame Construction

A = total floor area (all storeys excluding basements at least 50% below grade)

|              |           |
|--------------|-----------|
| 2nd Floor    | 196 sq.m. |
| Ground Floor | 196 sq.m. |
| Basement     | 196 sq.m. |

TOTAL FIRE AREA: 588 sq.m.

$$F = 8,002 \text{ L/min}$$

$$= 8,000 \text{ L/min (rounded off to the nearest 1,000 L/min)}$$

-15% Charge for Limited-combustible Occupancy

$$= 6,800 \text{ L/min}$$

0% Reduction: No Sprinkler System

$$= - \text{ L/min}$$

Increase for Separation Exposed Buildings

|           |   | Adjacent Building |          |         | Length-Height Factor |
|-----------|---|-------------------|----------|---------|----------------------|
|           |   | Construction      | Length m | Storeys |                      |
| 0% North  | >45m                                      |                   |          |         | 0                    |
| 8% East   | 20.1 to 30m                               | Non-C             | 15       | 1       | 15                   |
| 18% South | 3.1 to 10m                                | Ordinary          | 18       | 3       | 54                   |
| 13% West  | 10.1 to 20m                               | W-F               | 15       | 3       | 45                   |
| 39%       | Total Increase for Exposure (maximum 75%) |                   |          |         |                      |
| =         | 2,652                                     | L/min Increase    |          |         |                      |

$$= 9,452 \text{ L/min}$$

$$F = 9,000 \text{ L/min (rounded off to the nearest 1,000 L/min)}$$

$$= 150.0 \text{ L/s}$$

Elevation at Fire Hydrant 94.1 m ASL

Existing Conditions

150 L/s FIRE FLOW: 117.8 m ASL  
 Static Pressure at Fire Hydrant  
 34 psi 232 kPa

SUC Zone Reconfiguration

150 L/s FIRE FLOW: 144.0 m ASL  
 Static Pressure at Fire Hydrant  
 71 psi 489 kPa

## Dental Clinic Building + Two Semi-Detached Residential Buildings 3130 Woodroffe Avenue Ottawa, Ontario

### Water Demand

| UNIT TYPE:     | Number of<br>Units | Persons<br>Per Unit | Population |
|----------------|--------------------|---------------------|------------|
| Single Family: | 0                  | 3.4                 | 0          |
| Semi-detached: | 4                  | 2.7                 | 11         |
| Duplex:        | 0                  | 2.3                 | 0          |
| Townhouse:     | 0                  | 2.7                 | 0          |
| <b>TOTAL:</b>  | <b>4</b>           |                     | <b>11</b>  |

**APARTMENTS:**

|                               |      |   |      |     |           |
|-------------------------------|------|---|------|-----|-----------|
| <b>DAILY AVERAGE:</b>         | 280  | litres / person / day   |      |     |           |
|                               | 2.1  | L/min   | 0.04 | L/s | 0.6 USgpm |
| <b>MAXIMUM DAILY DEMAND:</b>  | 9.5  | (Peaking Factor for a equivalent population of <30:<br>Table 3-3 MOE Design Guidelines for Drinking-Water<br>Systems) |      |     |           |
|                               | 20.0 | L/min   | 0.3  | L/s | 5 USgpm   |
| <b>MAXIMUM HOURLY DEMAND:</b> | 14.3 | (Peaking Factor for a equivalent population of <30:<br>Table 3-3 MOE Design Guidelines for Drinking-Water<br>Systems) |      |     |           |
|                               | 30.0 | L/min   | 0.5  | L/s | 8 USgpm   |

**COMMERCIAL (Dental Clinic):**

|                                     |        |  |     |     |            |
|-------------------------------------|--------|--|-----|-----|------------|
| <b>DAILY AVERAGE:</b>               | 28,000 | L / gross ha / day (as per Ottawa Design Guidelines) |     |     |            |
|                                     | 0.1915 | ha (approximately 1/2 of land area)                  |     |     |            |
|                                     | 5361   | L/day  |     |     |            |
|                                     | 8      | hour day   |     |     |            |
|                                     | 11.2   | L/min  | 0.2 | L/s | 3.0 USgpm  |
| <b>MAXIMUM DAILY DEMAND:</b>        | 1.5    | (Peaking Factor as per Ottawa Design Guidelines)     |     |     |            |
|                                     | 16.8   | L/min  | 0.3 | L/s | 4.4 USgpm  |
| <b>MAXIMUM HOURLY DEMAND:</b>       | 1.8    | (Peaking Factor as per Ottawa Design Guidelines)     |     |     |            |
|                                     | 30.2   | L/min  | 0.5 | L/s | 8.0 USgpm  |
| <b>TOTAL DAILY AVERAGE:</b>         | 13.3   | L/min  | 0.2 | L/s | 3.5 USgpm  |
| <b>TOTAL MAXIMUM DAILY DEMAND:</b>  | 36.7   | L/min  | 0.6 | L/s | 9.7 USgpm  |
| <b>TOTAL MAXIMUM HOURLY DEMAND:</b> | 60.2   | L/min  | 1.0 | L/s | 15.9 USgpm |

Elevation of Water Meter: 96.1 m ASL  
 Finish Floor Elevation: 95.2 m ASL

**Existing Conditions**

|              |       |       |    | Static Pressure at Water Meter |         |
|--------------|-------|-------|----|--------------------------------|---------|
| MINIMUM HGL: | 141.6 | m ASL | 65 | psi                            | 446 kPa |
| MAXIMUM HGL: | 157.4 | m ASL | 87 | psi                            | 601 kPa |

**SUC Zone Reconfiguration**

|              |       |       |    | Static Pressure at Water Meter |         |
|--------------|-------|-------|----|--------------------------------|---------|
| MINIMUM HGL: | 145.5 | m ASL | 70 | psi                            | 484 kPa |
| MAXIMUM HGL: | 147.7 | m ASL | 73 | psi                            | 506 kPa |

## Boundary Conditions 3130 Woodroffe Ave

### Provided Information

| Scenario             | Demand |        |
|----------------------|--------|--------|
|                      | L/min  | L/s    |
| Average Daily Demand | 12     | 0.20   |
| Maximum Daily Demand | 36     | 0.60   |
| Peak Hour            | 60     | 1.00   |
| Fire Flow Demand #1  | 9,000  | 150.00 |

### Location



### Results – Existing Conditions

#### Connection 1 – Deerfox Dr.

| Demand Scenario     | Head (m) | Pressure <sup>1</sup> (psi) |
|---------------------|----------|-----------------------------|
| Maximum HGL         | 157.4    | 89.9                        |
| Peak Hour           | 141.6    | 67.5                        |
| Max Day plus Fire 1 | 117.8    | 33.6                        |

Ground Elevation = 94.1 m

## **Results – SUC Zone Reconfiguration**

### **Connection 1 – Deerfox Dr.**

| <b>Demand Scenario</b> | <b>Head (m)</b> | <b>Pressure<sup>1</sup> (psi)</b> |
|------------------------|-----------------|-----------------------------------|
| Maximum HGL            | 147.7           | 76.1                              |
| Peak Hour              | 145.5           | 73.0                              |
| Max Day plus Fire 1    | 144.0           | 70.9                              |

Ground Elevation = 94.1 m

### **Notes**

1. As per the Ontario Building Code in areas that may be occupied, the static pressure at any fixture shall not exceed 552 kPa (80 psi.) Pressure control measures to be considered are as follows, in order of preference:
  - a. If possible, systems to be designed to residual pressures of 345 to 552 kPa (50 to 80 psi) in all occupied areas outside of the public right-of-way without special pressure control equipment.
  - b. Pressure reducing valves to be installed immediately downstream of the isolation valve in the home/ building, located downstream of the meter so it is owner maintained.

### **Disclaimer**

*The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.*

## **APPENDIX B**

### SANITARY SERVICING





D.B. Gray Engineering Inc.

Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermains  
 700 Long Point Circle  
 Ottawa, Ontario K1T 4E9

613-425-8044  
 d.gray@dbgrayengineering.com

### SANITARY SEWER CALCULATIONS

3130 Woodroffe Avenue  
 Dental Clinic and Semi-Detached Dwellings  
 Ottawa, Ontario  
 October 31, 2022

Residential Average Daily Flow: 280 L/capita/day  
 Commercial Average Daily Flow: 28,000 L/ha/day  
 Institutional Average Daily Flow: 28,000 L/ha/day  
 Light Industrial Average Daily Flow: 35,000 L/ha/day  
 Heavy Industrial Average Daily Flow: 55,000 L/ha/day  
 Infiltration Allowance: 0.33 L/s/ha

Residential Peaking Factor: Harmon Formula  
 Harmon Formula Correction Factor: 0.8  
 Commercial Peaking Factor: 1.5  
 Institutional Peaking Factor: 1.5  
 Industrial Peaking Factor: Ministry of the Environment  
 Manning's Roughness Coefficient: 0.013

| Location |         | Residential   |               |           |            |           |           |            |            | Non-Residential |                |                 |            | Infiltration        |                |                 | Q<br>Flow Rate (L/s) | Sewer Data |                 |            |                       |                                      |           |                |                                  |                       |                 |       |      |      |      |       |  |  |  |  |  |
|----------|---------|---------------|---------------|-----------|------------|-----------|-----------|------------|------------|-----------------|----------------|-----------------|------------|---------------------|----------------|-----------------|----------------------|------------|-----------------|------------|-----------------------|--------------------------------------|-----------|----------------|----------------------------------|-----------------------|-----------------|-------|------|------|------|-------|--|--|--|--|--|
|          |         | Single Family | Semi Detached | Duplex    | Individual |           |           |            | Cumulative |                 |                |                 | Individual |                     | Cumulative     | Individual      |                      | Cumulative |                 | Length (m) | Nominal Diameter (mm) | Actual Diameter (mm)                 | Slope (%) | Velocity (m/s) | Q <sub>Full</sub> Capacity (L/s) | Q / Q <sub>Full</sub> |                 |       |      |      |      |       |  |  |  |  |  |
| (1 Bed)  | (2 Bed) |               |               |           | (3 Bed)    | (Average) | Area (ha) | Population | Area (ha)  | Population      | Peaking Factor | Flow Rate (L/s) | Area (ha)  | Daily Flow L/ha/day | Peaking Factor | Flow Rate (L/s) | Area (ha)            | Area (ha)  | Flow Rate (L/s) |            |                       |                                      |           |                |                                  |                       | Flow Rate (L/s) |       |      |      |      |       |  |  |  |  |  |
|          |         | ppu = 3.4     | ppu = 2.7     | ppu = 2.3 | ppu = 1.4  | ppu = 2.1 | ppu = 3.1 | ppu = 1.8  |            |                 |                |                 |            |                     |                |                 |                      |            |                 |            |                       |                                      |           |                |                                  |                       |                 |       |      |      |      |       |  |  |  |  |  |
| MH SA.1  | MH SA.2 |               | 4             |           |            |           |           |            | 0.1915     | 11              | 0.1915         | 11              | 3.2        | 0.11                | 0.1915         | 28,000          | 4.5                  | 0.28       | 0.3829          | 0.3829     | 0.13                  | 0.52                                 | 40.6      | 200            | 201                              | 0.65                  | 0.84            | 26.80 | 0.02 |      |      |       |  |  |  |  |  |
| MH SA.2  | 250 SAN |               |               |           |            |           |           |            | 0.1915     | 11              | 0.1915         | 11              | 3.2        | 0.11                |                |                 |                      | 0.28       | 0.3829          | 0.13       | 0.52                  | 9.8                                  | 200       | 201            | 0.65                             | 0.84                  | 26.80           | 0.02  |      |      |      |       |  |  |  |  |  |
|          |         |               |               |           |            |           |           |            |            |                 |                |                 |            |                     |                |                 |                      |            |                 |            |                       | 250 mm Deerfox Drive Sanitary Sewer: |           |                |                                  |                       |                 | 250   | 251  | 0.60 | 0.94 | 46.56 |  |  |  |  |  |

## **APPENDIX C**

### **STORMWATER MANAGEMENT & STORM SERVICING**

## STORMWATER MANAGEMENT CALCULATIONS

The orifice calculations are based on the following formula:

$$Q = C_d \times A_o \sqrt{2gh} \times 1000$$

where:

Q = flowrate in litres per second

$C_d$  = coefficient of discharge

$A_o$  = orifice area in sq.m.

g = 9.81 m/s<sup>2</sup>

h = head above orifice in meters

Flow control roof drain calculations are based on the following formula:

$$Q = N \times S \times d \times F$$

where:

Q = flowrate in litres per second

N = number of roof drains

S = slots per weir

d = pond depth at roof drain in mm

F = flowrate through each slot

0.0124 litres per second per mm pond depth (5 USgpm per inch)

Surface storage calculations on the roof, asphalted and landscaped area are based on the following formula for volume of a cone:

$$V = (A \times d)/3$$

where:

V = volume in cu.m.

A = ponding area in sq.m.

d = ponding depth in meters

# Summary Tables

## ONE-HUNDRED-YEAR EVENT

| Drainage Area | Pre-Development Flow Rate (L/s) | Maximum Allowable Release Rate (L/s) | Maximum Release Rate (L/s) | Maximum Volume Required (cu.m) | Maximum Volume Stored (cu.m) |
|---------------|---------------------------------|--------------------------------------|----------------------------|--------------------------------|------------------------------|
| AREA I (Roof) | -                               | -                                    | 3.35                       | 18.64                          | 18.64                        |
| AREA II       | -                               | -                                    | 6.00                       | 65.50                          | 65.50                        |
| AREA III      | -                               | -                                    | 15.17                      | 31.71                          | 31.71                        |
| TOTAL         | 78.98                           | 24.51                                | 24.51                      | 115.85                         | 115.85                       |

## FIVE-YEAR EVENT

| Drainage Area | Pre-Development Flow Rate (L/s) | Maximum Allowable Release Rate (L/s) | Maximum Release Rate (L/s) | Maximum Volume Required (cu.m) | Maximum Volume Stored (cu.m) |
|---------------|---------------------------------|--------------------------------------|----------------------------|--------------------------------|------------------------------|
| AREA I (Roof) | -                               | -                                    | 2.56                       | 8.32                           | 8.32                         |
| AREA II       | -                               | -                                    | 5.89                       | 27.83                          | 27.83                        |
| AREA III      | -                               | -                                    | 9.31                       | 15.31                          | 15.31                        |
| TOTAL         | 39.32                           | 24.51                                | 17.76                      | 51.47                          | 51.47                        |

## 3130 Woodroffe Avenue

Ottawa, Ontario

## STORMWATER MANAGEMENT CALCULATIONS

## Rational Method

## PRE-DEVELOPMENT CONDITIONS

## 100-Year Flow Rate

|                        |             |             | C           |
|------------------------|-------------|-------------|-------------|
| Roof Area:             | 395         | sq.m        | 1.00        |
| Asphalt/Concrete Area: | 450         | sq.m        | 1.00        |
| Gravel Area:           | 0           | sq.m        | 0.875       |
| Landscaped Area:       | <u>2984</u> | <u>sq.m</u> | <u>0.25</u> |
| Total Catchment Area:  | 3829        | sq.m        | 0.42        |

Bransby William Formula

$$T_c = \frac{0.057 \cdot L}{S_w^{0.2} \cdot A^{0.1}} \text{ min}$$

|                          |        |    |
|--------------------------|--------|----|
| Sheet Flow Distance (L): | 95     | m  |
| Slope of Land (Sw):      | 2.5    | %  |
| Area (A):                | 0.3829 | ha |

Time of Concentration (Sheet Flow): 5 min

|                         |      |       |
|-------------------------|------|-------|
| Area (A):               | 3829 | sq.m  |
| Time of Concentration:  | 10   | min   |
| Rainfall Intensity (i): | 179  | mm/hr |
| Runoff Coefficient (C): | 0.42 |       |

100-Year Pre-Development Flow Rate (2.78AiC): 78.98 L/s

## 5-Year Flow Rate

|                         |      |       | C    |
|-------------------------|------|-------|------|
| Roof Area:              | 395  | sq.m  | 0.90 |
| Asphalt/Concrete Area:  | 450  | sq.m  | 0.90 |
| Gravel Area:            | 0    | sq.m  | 0.70 |
| Landscaped Area:        | 2984 | sq.m  | 0.20 |
| Total Catchment Area:   | 3829 | sq.m  | 0.35 |
| Area (A):               | 3829 | sq.m  |      |
| Time of Concentration:  | 10   | min   |      |
| Rainfall Intensity (i): | 104  | mm/hr |      |
| Runoff Coefficient (C): | 0.35 |       |      |

5-Year Pre-Development Flow Rate (2.78AiC): 39.32 L/s

## Maximum Allowable Release Rate

\* As per Longfields Davidson Heights Serviceability Study

|               |      |        |
|---------------|------|--------|
| Area (A):     | 3829 | sq.m   |
| Release Rate: | 64   | L/s/ha |

Maximum Allowable Release Rate (2.78AiC): 24.51 L/s

# ONE-HUNDRED-YEAR EVENT

## DRAINAGE AREA I (Dental Clinic Roof)

(ONE-HUNDRED-YEAR EVENT)

|                       |      |                                      |                          |            |
|-----------------------|------|--------------------------------------|--------------------------|------------|
| Total Catchment Area: | 532  | sq.m                                 | C                        | 1.00       |
| No. of Roof Drains:   | 2    |                                      |                          |            |
| Slots per Wier:       | 1    | 0.0124 L/s/mm/slot (5 USGPM/in/slot) |                          |            |
| Depth at Roof Drain:  | 135  | mm                                   | Pond Area:               | 414 sq.m   |
| Maximum Release Rate: | 3.35 | L/s                                  | Achieved Volume:         | 18.64 cu.m |
|                       |      |                                      | Maximum Volume Required: | 18.64 cu.m |

| Time (min) | i (mm/hr) | 2.78AiC (L/s) | Release Rate (L/s) | Stored Rate (L/s) | Stored Volume (cu.m) |
|------------|-----------|---------------|--------------------|-------------------|----------------------|
| 5          | 243       | 35.89         | 3.35               | 32.55             | 9.76                 |
| 10         | 179       | 26.41         | 3.35               | 23.06             | 13.84                |
| 15         | 143       | 21.13         | 3.35               | 17.79             | 16.01                |
| 20         | 120       | 17.74         | 3.35               | 14.39             | 17.27                |
| 25         | 104       | 15.36         | 3.35               | 12.01             | 18.02                |
| 30         | 92        | 13.59         | 3.35               | 10.24             | 18.43                |
| 35         | 83        | 12.21         | 3.35               | 8.87              | 18.62                |
| 40         | 75        | 11.11         | 3.35               | 7.77              | 18.64                |
| 45         | 69        | 10.21         | 3.35               | 6.87              | 18.54                |
| 50         | 64        | 9.46          | 3.35               | 6.11              | 18.33                |
| 55         | 60        | 8.82          | 3.35               | 5.47              | 18.05                |
| 60         | 56        | 8.27          | 3.35               | 4.92              | 17.71                |
| 65         | 53        | 7.79          | 3.35               | 4.44              | 17.31                |
| 70         | 50        | 7.36          | 3.35               | 4.02              | 16.87                |
| 75         | 47        | 6.99          | 3.35               | 3.64              | 16.39                |
| 80         | 45        | 6.65          | 3.35               | 3.31              | 15.87                |
| 85         | 43        | 6.35          | 3.35               | 3.01              | 15.33                |
| 90         | 41        | 6.08          | 3.35               | 2.73              | 14.76                |
| 95         | 39        | 5.83          | 3.35               | 2.49              | 14.17                |
| 100        | 38        | 5.61          | 3.35               | 2.26              | 13.55                |
| 105        | 36        | 5.40          | 3.35               | 2.05              | 12.92                |
| 110        | 35        | 5.21          | 3.35               | 1.86              | 12.27                |
| 115        | 34        | 5.03          | 3.35               | 1.68              | 11.61                |
| 120        | 33        | 4.87          | 3.35               | 1.52              | 10.93                |

# DRAINAGE AREA II

(ONE-HUNDRED-YEAR EVENT)

|                        |      |      |       |
|------------------------|------|------|-------|
|                        |      |      | C     |
| Roof Area:             | 405  | sq.m | 1.00  |
| Asphalt/Concrete Area: | 688  | sq.m | 1.00  |
| Gravel Area:           | 0    | sq.m | 0.875 |
| Landscaped Area:       | 909  | sq.m | 0.25  |
|                        |      |      | <hr/> |
| Total Catchment Area:  | 2002 | sq.m | 0.66  |

|   |       |       |
|---|-------|-------|
| Water Elevation:  | 94.14 | m     |
| Invert of Outlet Pipe - CB/MH-2:                            | 92.03 | m     |
| Centroid of ICD Orifice:<br>(ICD in Outlet Pipe of CB/MH-2) | 92.07 | m     |
| Head:   | 2.07  | m     |
| Orifice Diameter:   | 75    | mm    |
| Orifice Area:   | 4418  | sq.mm |
| Coefficient of Discharge:                                   | 0.213 |       |
| Maximum Release Rate:                                       | 6.00  | L/s   |

| CB/MH   | Top Area<br>(sq.m) | Depth<br>(m) | Volume |      |
|---------|--------------------|--------------|--------|------|
| CB/MH-0 | 182                | 0.47         | 28.30  | cu.m |
| CB/MH-2 | 226                | 0.18         | 13.21  | cu.m |

| Pipe Storage |                  | Diameter<br>(mm) | Length<br>(m) |       |      |
|--------------|------------------|------------------|---------------|-------|------|
|              | CB/MH-2 to MH-1B | 250              | 9.0           | 0.38  | cu.m |
|              | MH-1B to /MH-1A  | 900              | 19.0          | 11.32 | cu.m |
|              | MH-1A to CB/MH-0 | 600              | 6.9           | 1.61  | cu.m |

| Manhole Storage | Invert  | Diameter<br>(mm) | Depth<br>(m) |      |           |
|-----------------|---------|------------------|--------------|------|-----------|
|                 | CB/MH-2 | 92.17            | 1200         | 1.79 | 2.02 cu.m |
|                 | MH-1B   | 92.21            | 1500         | 2.02 | 3.57 cu.m |
|                 | MH-1A   | 92.23            | 1500         | 1.96 | 3.46 cu.m |
|                 | CB/MH-0 | 92.24            | 1200         | 1.43 | 1.62 cu.m |

Achieved Volume: 65.50 cu.m

Maximum Volume Required: 65.50 cu.m



## DRAINAGE AREA II (Continued)

(ONE-HUNDRED-YEAR EVENT)

| Time<br>(min) | i<br>(mm/hr) | 2.78AiC<br>(L/s) | Release<br>Rate<br>(L/s) | Stored<br>Rate<br>(L/s) | Stored<br>Volume<br>(cu.m) |
|---------------|--------------|------------------|--------------------------|-------------------------|----------------------------|
| 5             | 243          | 89.08            | 3.00                     | 86.08                   | 25.82                      |
| 10            | 179          | 65.54            | 3.00                     | 62.54                   | 37.52                      |
| 15            | 143          | 52.45            | 3.00                     | 49.45                   | 44.50                      |
| 20            | 120          | 44.03            | 3.00                     | 41.03                   | 49.23                      |
| 25            | 104          | 38.11            | 3.00                     | 35.12                   | 52.67                      |
| 30            | 92           | 33.72            | 3.00                     | 30.72                   | 55.30                      |
| 35            | 83           | 30.31            | 3.00                     | 27.31                   | 57.35                      |
| 40            | 75           | 27.58            | 3.00                     | 24.58                   | 59.00                      |
| 45            | 69           | 25.34            | 3.00                     | 22.35                   | 60.33                      |
| 50            | 64           | 23.47            | 3.00                     | 20.47                   | 61.42                      |
| 55            | 60           | 21.88            | 3.00                     | 18.89                   | 62.32                      |
| 60            | 56           | 20.51            | 3.00                     | 17.52                   | 63.06                      |
| 65            | 53           | 19.32            | 3.00                     | 16.32                   | 63.67                      |
| 70            | 50           | 18.27            | 3.00                     | 15.28                   | 64.16                      |
| 75            | 47           | 17.34            | 3.00                     | 14.35                   | 64.56                      |
| 80            | 45           | 16.51            | 3.00                     | 13.51                   | 64.87                      |
| 85            | 43           | 15.77            | 3.00                     | 12.77                   | 65.11                      |
| 90            | 41           | 15.09            | 3.00                     | 12.09                   | 65.29                      |
| 95            | 39           | 14.47            | 3.00                     | 11.48                   | 65.41                      |
| 100           | 38           | 13.91            | 3.00                     | 10.91                   | 65.48                      |
| 105           | 36           | 13.40            | 3.00                     | 10.40                   | 65.50                      |
| 110           | 35           | 12.92            | 3.00                     | 9.92                    | 65.48                      |
| 115           | 34           | 12.48            | 3.00                     | 9.48                    | 65.43                      |
| 120           | 33           | 12.07            | 3.00                     | 9.07                    | 65.34                      |

# DRAINAGE AREA III

(ONE-HUNDRED-YEAR EVENT)

|                        |      |      |       |
|------------------------|------|------|-------|
|                        |      |      | C     |
| Roof Area:             | 0    | sq.m | 1.00  |
| Asphalt/Concrete Area: | 884  | sq.m | 1.00  |
| Gravel Area:           | 0    | sq.m | 0.875 |
| Landscaped Area:       | 411  | sq.m | 0.25  |
|                        |      |      | <hr/> |
| Total Catchment Area:  | 1295 | sq.m | 0.76  |

Water Elevation: 93.20 m

Invert of Outlet Pipe - CB/MH-11: 92.12 m

Centroid of ICD Orifice: 92.16 m  
(ICD in Outlet Pipe of CB/MH-5)

Head: 1.05 m

Orifice Diameter: 84 mm

Orifice Area: 5486 sq.mm

Coefficient of Discharge: 0.61

Maximum Release Rate: 15.17 L/s

| Pipe Storage |                      | Diameter<br>(mm) | Length<br>(m) | Volume<br>(cu.m.) |
|--------------|----------------------|------------------|---------------|-------------------|
|              | CB/MH-11 to CB/MH-10 | 450              | 19.7          | 2.94              |
|              | CB/MH-10 to CB/MH-9  | 450              | 18.9          | 2.82              |
|              | CB/MH-9 to CB/MH-8   | 450              | 5.0           | 0.60              |
|              | CB/MH-8 to CB/MH-7   | 525              | 16.0          | 3.17              |
|              | CB/MH-7 to CB/MH-6   | 900              | 23.6          | 14.06             |

| Manhole Storage | Invert | Diameter<br>(mm) | Depth<br>(m) | Volume<br>(cu.m.) |
|-----------------|--------|------------------|--------------|-------------------|
| CB/MH-11        | 92.115 | 1200             | 1.09         | 1.23              |
| CB/MH-10        | 92.155 | 1200             | 1.05         | 1.19              |
| CB/MH-9         | 92.19  | 1200             | 1.01         | 1.15              |
| MH-8            | 92.20  | 1200             | 1.00         | 1.13              |
| MH-7            | 92.225 | 1500             | 0.98         | 1.73              |
| CB/MH-6         | 92.245 | 1500             | 0.96         | 1.69              |

Achieved Volume: 31.71 cu.m

Maximum Volume Required: 31.71 cu.m

# DRAINAGE AREA III (Continued)

(ONE HUNDRED YEAR EVENT)

| Time<br>(min) | i<br>(mm/hr) | 2.78AiC<br>(L/s) | 50% of<br>Release<br>Rate<br>(L/s) | Stored<br>Rate<br>(L/s) | Stored<br>Volume<br>(cu.m) |
|---------------|--------------|------------------|------------------------------------|-------------------------|----------------------------|
| 5             | 243          | 66.58            | 7.58                               | 58.99                   | 17.70                      |
| 10            | 179          | 48.98            | 7.58                               | 41.40                   | 24.84                      |
| 15            | 143          | 39.20            | 7.58                               | 31.62                   | 28.45                      |
| 20            | 120          | 32.90            | 7.58                               | 25.32                   | 30.39                      |
| 25            | 104          | 28.49            | 7.58                               | 20.90                   | 31.36                      |
| 30            | 92           | 25.20            | 7.58                               | 17.62                   | 31.71                      |
| 35            | 83           | 22.65            | 7.58                               | 15.07                   | 31.65                      |
| 40            | 75           | 20.61            | 7.58                               | 13.03                   | 31.27                      |
| 45            | 69           | 18.94            | 7.58                               | 11.36                   | 30.67                      |
| 50            | 64           | 17.54            | 7.58                               | 9.96                    | 29.88                      |
| 55            | 60           | 16.36            | 7.58                               | 8.77                    | 28.95                      |
| 60            | 56           | 15.33            | 7.58                               | 7.75                    | 27.90                      |
| 65            | 53           | 14.44            | 7.58                               | 6.86                    | 26.75                      |
| 70            | 50           | 13.66            | 7.58                               | 6.08                    | 25.52                      |
| 75            | 47           | 12.96            | 7.58                               | 5.38                    | 24.21                      |
| 80            | 45           | 12.34            | 7.58                               | 4.76                    | 22.84                      |
| 85            | 43           | 11.78            | 7.58                               | 4.20                    | 21.42                      |
| 90            | 41           | 11.28            | 7.58                               | 3.69                    | 19.95                      |
| 95            | 39           | 10.82            | 7.58                               | 3.23                    | 18.44                      |
| 100           | 38           | 10.40            | 7.58                               | 2.81                    | 16.89                      |
| 105           | 36           | 10.01            | 7.58                               | 2.43                    | 15.30                      |
| 110           | 35           | 9.66             | 7.58                               | 2.07                    | 13.69                      |
| 115           | 34           | 9.33             | 7.58                               | 1.75                    | 12.04                      |
| 120           | 33           | 9.02             | 7.58                               | 1.44                    | 10.37                      |

# FIVE-YEAR EVENT

## DRAINAGE AREA I (Dental Clinic Roof)

(FIVE-YEAR EVENT)

|                       |      |                                      |                          |           |
|-----------------------|------|--------------------------------------|--------------------------|-----------|
| Total Catchment Area: | 532  | sq.m                                 | C                        | 0.90      |
| No. of Roof Drains:   | 2    |                                      |                          |           |
| Slots per Wier:       | 1    | 0.0124 L/s/mm/slot (5 USGPM/in/slot) |                          |           |
| Depth at Roof Drain:  | 103  | mm                                   | Pond Area:               | 242 sq.m  |
| Maximum Release Rate: | 2.56 | L/s                                  | Achieved Volume:         | 8.32 cu.m |
|                       |      |                                      | Maximum Volume Required: | 8.32 cu.m |

| Time (min) | i (mm/hr) | 2.78AiC (L/s) | Release Rate (L/s) | Stored Rate (L/s) | Stored Volume (cu.m) |
|------------|-----------|---------------|--------------------|-------------------|----------------------|
| 5          | 141       | 18.79         | 2.56               | 16.23             | 4.87                 |
| 10         | 104       | 13.87         | 2.56               | 11.31             | 6.79                 |
| 15         | 84        | 11.12         | 2.56               | 8.56              | 7.71                 |
| 20         | 70        | 9.35          | 2.56               | 6.79              | 8.15                 |
| 25         | 61        | 8.11          | 2.56               | 5.55              | 8.32                 |
| 30         | 54        | 7.18          | 2.56               | 4.62              | 8.32                 |
| 35         | 49        | 6.46          | 2.56               | 3.90              | 8.19                 |
| 40         | 44        | 5.88          | 2.56               | 3.32              | 7.98                 |
| 45         | 41        | 5.41          | 2.56               | 2.85              | 7.69                 |
| 50         | 38        | 5.01          | 2.56               | 2.45              | 7.36                 |
| 55         | 35        | 4.68          | 2.56               | 2.12              | 6.99                 |
| 60         | 33        | 4.38          | 2.56               | 1.83              | 6.58                 |
| 65         | 31        | 4.13          | 2.56               | 1.57              | 6.14                 |
| 70         | 29        | 3.91          | 2.56               | 1.35              | 5.68                 |
| 75         | 28        | 3.71          | 2.56               | 1.15              | 5.19                 |
| 80         | 27        | 3.54          | 2.56               | 0.98              | 4.69                 |
| 85         | 25        | 3.38          | 2.56               | 0.82              | 4.17                 |
| 90         | 24        | 3.23          | 2.56               | 0.67              | 3.64                 |
| 95         | 23        | 3.10          | 2.56               | 0.54              | 3.10                 |
| 100        | 22        | 2.98          | 2.56               | 0.42              | 2.55                 |
| 105        | 22        | 2.87          | 2.56               | 0.31              | 1.98                 |
| 110        | 21        | 2.77          | 2.56               | 0.21              | 1.41                 |
| 115        | 20        | 2.68          | 2.56               | 0.12              | 0.83                 |
| 120        | 19        | 2.59          | 2.56               | 0.03              | 0.24                 |

# DRAINAGE AREA II

(FIVE-YEAR EVENT)

|                        |            |             |             |
|------------------------|------------|-------------|-------------|
|                        |            |             | C           |
| Roof Area:             | 405        | sq.m        | 0.90        |
| Asphalt/Concrete Area: | 688        | sq.m        | 0.90        |
| Gravel Area:           | 0          | sq.m        | 0.70        |
| Landscaped Area:       | <u>909</u> | <u>sq.m</u> | <u>0.20</u> |
| Total Catchment Area:  | 2002       | sq.m        | 0.58        |

|   |       |       |
|---|-------|-------|
| Water Elevation:  | 94.06 | m     |
| Invert of Outlet Pipe - CB/MH-2:                            | 92.03 | m     |
| Centroid of ICD Orifice:<br>(ICD in Outlet Pipe of CB/MH-2) | 92.07 | m     |
| Head:   | 2.00  | m     |
| Orifice Diameter:   | 75    | mm    |
| Orifice Area:   | 4418  | sq.mm |
| Coefficient of Discharge:                                   | 0.213 |       |
| Maximum Release Rate:                                       | 5.89  | L/s   |

| CB/MH   | Top Area<br>(sq.m) | Depth<br>(m) | Volume |      |
|---------|--------------------|--------------|--------|------|
| CB/MH-0 | 192                | 0.39         | 25.15  | cu.m |
| CB/MH-2 | 78                 | 0.10         | 2.69   | cu.m |

| Pipe Storage |                  | Diameter<br>(mm) | Length<br>(m) |       |      |
|--------------|------------------|------------------|---------------|-------|------|
|              | CB/MH-2 to MH-1B | 250              | 9.0           | 0.38  | cu.m |
|              | MH-1B to /MH-1A  | 900              | 19.0          | 11.32 | cu.m |
|              | MH-1A to CB/MH-0 | 600              | 6.9           | 1.61  | cu.m |

| Manhole Storage | Invert  | Diameter<br>(mm) | Depth<br>(m) |      |                  |
|-----------------|---------|------------------|--------------|------|------------------|
|                 | CB/MH-2 | 92.17            | 1200         | 1.79 | 2.02 cu.m        |
|                 | MH-1B   | 92.21            | 1500         | 2.02 | 3.57 cu.m        |
|                 | MH-1A   | 92.23            | 1500         | 1.96 | 3.46 cu.m        |
|                 | CB/MH-0 | 92.24            | 1200         | 1.43 | <u>1.62</u> cu.m |

Achieved Volume: 27.83 cu.m

Maximum Volume Required: 27.83 cu.m

## DRAINAGE AREA II (Continued)

(FIVE-YEAR EVENT)

| Time<br>(min) | i<br>(mm/hr) | 2.78AiC<br>(L/s) | Release<br>Rate<br>(L/s) | Stored<br>Rate<br>(L/s) | Stored<br>Volume<br>(cu.m) |
|---------------|--------------|------------------|--------------------------|-------------------------|----------------------------|
| 5             | 141          | 45.74            | 2.95                     | 42.80                   | 12.84                      |
| 10            | 104          | 33.76            | 2.95                     | 30.81                   | 18.49                      |
| 15            | 84           | 27.07            | 2.95                     | 24.13                   | 21.72                      |
| 20            | 70           | 22.76            | 2.95                     | 19.82                   | 23.78                      |
| 25            | 61           | 19.73            | 2.95                     | 16.79                   | 25.18                      |
| 30            | 54           | 17.47            | 2.95                     | 14.53                   | 26.15                      |
| 35            | 49           | 15.72            | 2.95                     | 12.77                   | 26.83                      |
| 40            | 44           | 14.32            | 2.95                     | 11.37                   | 27.29                      |
| 45            | 41           | 13.16            | 2.95                     | 10.22                   | 27.59                      |
| 50            | 38           | 12.20            | 2.95                     | 9.25                    | 27.76                      |
| 55            | 35           | 11.38            | 2.95                     | 8.43                    | 27.83                      |
| 60            | 33           | 10.67            | 2.95                     | 7.73                    | 27.82                      |
| 65            | 31           | 10.06            | 2.95                     | 7.11                    | 27.74                      |
| 70            | 29           | 9.52             | 2.95                     | 6.57                    | 27.60                      |
| 75            | 28           | 9.04             | 2.95                     | 6.09                    | 27.41                      |
| 80            | 27           | 8.61             | 2.95                     | 5.66                    | 27.17                      |
| 85            | 25           | 8.22             | 2.95                     | 5.27                    | 26.90                      |
| 90            | 24           | 7.87             | 2.95                     | 4.92                    | 26.59                      |
| 95            | 23           | 7.55             | 2.95                     | 4.61                    | 26.25                      |
| 100           | 22           | 7.26             | 2.95                     | 4.31                    | 25.89                      |
| 105           | 22           | 6.99             | 2.95                     | 4.05                    | 25.50                      |
| 110           | 21           | 6.75             | 2.95                     | 3.80                    | 25.09                      |
| 115           | 20           | 6.52             | 2.95                     | 3.57                    | 24.66                      |
| 120           | 19           | 6.31             | 2.95                     | 3.36                    | 24.21                      |

# DRAINAGE AREA III

(FIVE-YEAR EVENT)

|                        |      |      |       |
|------------------------|------|------|-------|
|                        |      |      | C     |
| Roof Area:             | 0    | sq.m | 0.90  |
| Asphalt/Concrete Area: | 884  | sq.m | 0.90  |
| Gravel Area:           | 0    | sq.m | 0.70  |
| Landscaped Area:       | 411  | sq.m | 0.20  |
|                        |      |      | <hr/> |
| Total Catchment Area:  | 1295 | sq.m | 0.68  |

|   |       |   |
|---|-------|---|
| Water Elevation:  | 92.55 | m |
| Invert of Outlet Pipe - CB/MH-11:                           | 92.12 | m |
| Centroid of ICD Orifice:<br>(ICD in Outlet Pipe of CB/MH-5) | 92.16 | m |

Head: 0.39 m

Orifice Diameter: 84 mm

Orifice Area: 5486 sq.mm

Coefficient of Discharge: 0.61

Maximum Release Rate: 9.31 L/s

| Pipe Storage |                      | Diameter<br>(mm) | Length<br>(m) | Volume<br>(cu.m.) |
|--------------|----------------------|------------------|---------------|-------------------|
|              | CB/MH-11 to CB/MH-10 | 450              | 19.7          | 2.84              |
|              | CB/MH-10 to CB/MH-9  | 450              | 18.9          | 2.51              |
|              | CB/MH-9 to CB/MH-8   | 450              | 5.0           | 0.51              |
|              | CB/MH-8 to CB/MH-7   | 525              | 16.0          | 2.15              |
|              | CB/MH-7 to CB/MH-6   | 900              | 23.6          | 4.44              |

| Manhole Storage | Invert   | Diameter<br>(mm) | Depth<br>(m) |      |
|-----------------|----------|------------------|--------------|------|
|                 | CB/MH-11 | 92.115           | 1200         | 0.44 |
|                 | CB/MH-10 | 92.155           | 1200         | 0.40 |
|                 | CB/MH-9  | 92.19            | 1200         | 0.36 |
|                 | MH-8     | 92.2             | 1200         | 0.35 |
|                 | MH-7     | 92.225           | 1500         | 0.33 |
|                 | CB/MH-6  | 92.245           | 1500         | 0.31 |

Achieved Volume: 15.31 cu.m

Maximum Volume Required: 15.31 cu.m

# DRAINAGE AREA III (Continued)

(FIVE YEAR EVENT)

| Time<br>(min) | i<br>(mm/hr) | 2.78AiC<br>(L/s) | Release<br>Rate<br>(L/s) | Stored<br>Rate<br>(L/s) | Stored<br>Volume<br>(cu.m) |
|---------------|--------------|------------------|--------------------------|-------------------------|----------------------------|
| 5             | 141          | 34.45            | 4.65                     | 29.80                   | 8.94                       |
| 10            | 104          | 25.43            | 4.65                     | 20.77                   | 12.46                      |
| 15            | 84           | 20.39            | 4.65                     | 15.74                   | 14.16                      |
| 20            | 70           | 17.14            | 4.65                     | 12.49                   | 14.99                      |
| 25            | 61           | 14.86            | 4.65                     | 10.21                   | 15.31                      |
| 30            | 54           | 13.16            | 4.65                     | 8.51                    | 15.31                      |
| 35            | 49           | 11.84            | 4.65                     | 7.19                    | 15.09                      |
| 40            | 44           | 10.78            | 4.65                     | 6.13                    | 14.71                      |
| 45            | 41           | 9.91             | 4.65                     | 5.26                    | 14.20                      |
| 50            | 38           | 9.19             | 4.65                     | 4.53                    | 13.60                      |
| 55            | 35           | 8.57             | 4.65                     | 3.92                    | 12.93                      |
| 60            | 33           | 8.04             | 4.65                     | 3.38                    | 12.19                      |
| 65            | 31           | 7.58             | 4.65                     | 2.92                    | 11.39                      |
| 70            | 29           | 7.17             | 4.65                     | 2.51                    | 10.56                      |
| 75            | 28           | 6.81             | 4.65                     | 2.15                    | 9.68                       |
| 80            | 27           | 6.48             | 4.65                     | 1.83                    | 8.77                       |
| 85            | 25           | 6.19             | 4.65                     | 1.54                    | 7.83                       |
| 90            | 24           | 5.93             | 4.65                     | 1.27                    | 6.87                       |
| 95            | 23           | 5.69             | 4.65                     | 1.03                    | 5.89                       |
| 100           | 22           | 5.47             | 4.65                     | 0.81                    | 4.88                       |
| 105           | 22           | 5.27             | 4.65                     | 0.61                    | 3.86                       |
| 110           | 21           | 5.08             | 4.65                     | 0.43                    | 2.82                       |
| 115           | 20           | 4.91             | 4.65                     | 0.26                    | 1.76                       |
| 120           | 19           | 4.75             | 4.65                     | 0.10                    | 0.69                       |



# TWO-YEAR EVENT

## DRAINAGE AREA II

(TWO-YEAR EVENT)

|                        |      |      |       |
|------------------------|------|------|-------|
|                        |      |      | C     |
| Roof Area:             | 405  | sq.m | 0.90  |
| Asphalt/Concrete Area: | 688  | sq.m | 0.90  |
| Gravel Area:           | 0    | sq.m | 0.70  |
| Landscaped Area:       | 909  | sq.m | 0.20  |
|                        |      |      | <hr/> |
| Total Catchment Area:  | 2002 | sq.m | 0.58  |

|                                  |       |       |
|----------------------------------|-------|-------|
| Water Elevation:                 | 93.38 | m     |
| Invert of Outlet Pipe - CB/MH-2: | 92.03 | m     |
| Centroid of ICD Orifice:         | 92.07 | m     |
| Centroid of ICD Orifice:         |       |       |
| Head:                            | 1.32  | m     |
| Orifice Diameter:                | 75    | mm    |
| Orifice Area:                    | 4418  | sq.mm |
| Coefficient of Discharge:        | 0.213 |       |
| Maximum Release Rate:            | 4.78  | L/s   |

| CB/MH   | Top Area<br>(sq.m) | Depth<br>(m) | Volume |      |
|---------|--------------------|--------------|--------|------|
| CB/MH-0 | 0                  | 0.00         | 0.00   | cu.m |
| CB/MH-2 | 0                  | 0.00         | 0.00   | cu.m |

| Pipe Storage |                  | Diameter<br>(mm) | Length<br>(m) | Volume<br>(cu.m.) |      |
|--------------|------------------|------------------|---------------|-------------------|------|
|              | CB/MH-2 to MH-1B | 250              | 9.0           | 0.38              | cu.m |
|              | MH-1B to /MH-1A  | 900              | 19.0          | 11.32             | cu.m |
|              | MH-1A to CB/MH-0 | 600              | 6.9           | 1.61              | cu.m |

| Manhole Storage | Invert  | Diameter<br>(mm) | Depth<br>(m) |      |           |
|-----------------|---------|------------------|--------------|------|-----------|
|                 | CB/MH-2 | 92.17            | 1200         | 1.21 | 1.37 cu.m |
|                 | MH-1B   | 92.21            | 1500         | 1.17 | 2.07 cu.m |
|                 | MH-1A   | 92.23            | 1500         | 1.15 | 2.04 cu.m |
|                 | CB/MH-0 | 92.24            | 1200         | 1.14 | 1.29 cu.m |


Achieved Volume: 20.09 cu.m

Maximum Volume Required: 20.09 cu.m

## DRAINAGE AREA II (Continued)

(TWO-YEAR EVENT)

| Time<br>(min) | i<br>(mm/hr) | 2.78AiC<br>(L/s) | 50%                      | Stored        | Stored           |
|---------------|--------------|------------------|--------------------------|---------------|------------------|
|               |              |                  | Release<br>Rate<br>(L/s) | Rate<br>(L/s) | Volume<br>(cu.m) |
| 5             | 104          | 33.56            | 2.39                     | 31.17         | 9.35             |
| 10            | 77           | 24.89            | 2.39                     | 22.49         | 13.50            |
| 15            | 62           | 20.01            | 2.39                     | 17.62         | 15.86            |
| 20            | 52           | 16.86            | 2.39                     | 14.47         | 17.36            |
| 25            | 45           | 14.63            | 2.39                     | 12.24         | 18.37            |
| 30            | 40           | 12.97            | 2.39                     | 10.58         | 19.05            |
| 35            | 36           | 11.68            | 2.39                     | 9.29          | 19.51            |
| 40            | 33           | 10.65            | 2.39                     | 8.26          | 19.82            |
| 45            | 30           | 9.80             | 2.39                     | 7.41          | 20.00            |
| 50            | 28           | 9.09             | 2.39                     | 6.69          | 20.08            |
| 55            | 26           | 8.48             | 2.39                     | 6.09          | 20.09            |
| 60            | 25           | 7.96             | 2.39                     | 5.57          | 20.04            |
| 65            | 23           | 7.50             | 2.39                     | 5.11          | 19.93            |
| 70            | 22           | 7.10             | 2.39                     | 4.71          | 19.78            |
| 75            | 21           | 6.74             | 2.39                     | 4.35          | 19.59            |
| 80            | 20           | 6.43             | 2.39                     | 4.03          | 19.36            |
| 85            | 19           | 6.14             | 2.39                     | 3.75          | 19.11            |
| 90            | 18           | 5.88             | 2.39                     | 3.49          | 18.83            |
| 95            | 17           | 5.64             | 2.39                     | 3.25          | 18.53            |
| 100           | 17           | 5.43             | 2.39                     | 3.03          | 18.21            |
| 105           | 16           | 5.23             | 2.39                     | 2.84          | 17.87            |
| 110           | 16           | 5.04             | 2.39                     | 2.65          | 17.51            |
| 115           | 15           | 4.88             | 2.39                     | 2.48          | 17.14            |
| 120           | 15           | 4.72             | 2.39                     | 2.33          | 16.75            |

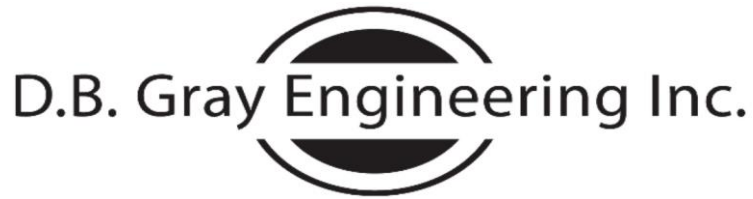

# STORM SEWER CALCULATIONS

Rational Method

FIVE YEAR EVENT

Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermains

700 Long Point Circle  
Ottawa, Ontario K1T 4E9

613-425-8044  
d.gray@dbgrayengineering.com

3130 Woodroffe Avenue  
Dental Clinic and Semi-Detached Dwellings  
Ottawa, Ontario

August 29, 2022

Manning's Roughness Coefficient: 0.013

|   |          | Individual       |                  |                    |                  | Cumulative |        |               |                                  | Sewer Data            |               |                             |                            |              |                   |  |               |                       |
|---|----------|------------------|------------------|--------------------|------------------|------------|--------|---------------|----------------------------------|-----------------------|---------------|-----------------------------|----------------------------|--------------|-------------------|--|---------------|-----------------------|
| Location  |          | Roof<br>C = 0.90 | Hard<br>C = 0.90 | Gravel<br>C = 0.70 | Soft<br>C = 0.20 | 2.78AC     | 2.78AC | Time<br>(min) | Rainfall<br>Intensity<br>(mm/hr) | Flow<br>Rate<br>(L/s) | Length<br>(m) | Nominal<br>Diameter<br>(mm) | Actual<br>Diameter<br>(mm) | Slope<br>(%) | Velocity<br>(m/s) | Q <sub>Full</sub><br>Capacity<br>(L/s) | Time<br>(min) | Q / Q <sub>Full</sub> |
| From  | To       | (ha)             | (ha)             | (ha)               | (ha)             |            |        |               |                                  |                       |               |                             |                            |              |                   |  |               |                       |
| CB/MH-0   | MH-1A    | 0.0405           |                  |                    | 0.0804           | 0.1460     | 0.1460 | 10.00         | 104                              | 15.22                 | 6.9           | 600                         | 594                        | 0.14         | 0.81              | 223.67                                 | 0.14          | 0.07                  |
| MH-1A   | MH-1B    |                  |                  |                    |                  | 0.0000     | 0.1460 | 10.14         | 103                              | 15.11                 | 19.0          | 900                         | 914                        | 0.14         | 1.08              | 705.82                                 | 0.29          | 0.02                  |
| MH-1B   | CB/MH-2  |                  |                  |                    |                  | 0.0000     | 0.1460 | 10.44         | 102                              | 14.89                 | 6.9           | 250                         | 251                        | 0.14         | 0.45              | 22.49                                  | 0.25          | 0.66                  |
| Roof  | CB/MH-2  | 0.0532           |                  |                    |                  | 0.1331     | 0.1331 | 10.00         | 104                              | 13.87                 | 3.3           | 200                         | 201                        | 2.00         | 1.48              | 47.01                                  | 0.04          | 0.30                  |
| Flow through flow control roof drains:          |          |                  |                  |                    |                  |            |        |               |                                  | 2.56                  | 3.3           | 200                         | 201                        | 2.00         | 1.48              | 47.01                                  | 0.04          | 0.05                  |
| CB/MH-2   | MH-3     |                  | 0.0688           |                    | 0.0105           | 0.1780     | 0.4571 | 10.69         | 101                              | 46.02                 | 23.8          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.50          | 0.35                  |
| Flow through inlet control device:              |          |                  |                  |                    |                  |            |        |               |                                  | 5.82                  | 23.8          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.50          | 0.04                  |
| Flow through flow control devices:              |          |                  |                  |                    |                  |            |        |               |                                  | 8.38                  | 23.8          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.50          | 0.06                  |
| MH-4  | MH-5     |                  |                  |                    |                  | 0.0000     | 0.0000 | 10.00         | 104                              | 0.00                  | 40.8          | 250                         | 251                        | 0.43         | 0.80              | 39.41                                  | 0.85          | 0.00                  |
| MH-5  | MH-3     |                  |                  |                    |                  | 0.0000     | 0.0000 | 10.85         | 100                              | 0.00                  | 9.9           | 250                         | 251                        | 0.43         | 0.80              | 39.41                                  | 0.21          | 0.00                  |
| MH-3  | MH-12    |                  |                  |                    |                  | 0.0000     | 0.4571 | 11.19         | 98                               | 44.94                 | 13.2          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.28          | 0.34                  |
| Flow through flow control devices:              |          |                  |                  |                    |                  |            |        |               |                                  | 8.38                  | 13.2          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.28          | 0.06                  |
| CB/MH-6   | CB/MH-7  |                  | 0.0262           |                    | 0.0114           | 0.0719     | 0.0719 | 10.00         | 104                              | 7.49                  | 23.6          | 900                         | 914                        | 0.10         | 0.91              | 596.53                                 | 0.43          | 0.01                  |
| CB/MH-7   | CB/MH-8  |                  | 0.0079           |                    | 0.0007           | 0.0202     | 0.0920 | 10.43         | 102                              | 9.39                  | 16.0          | 525                         | 533                        | 0.16         | 0.80              | 179.10                                 | 0.33          | 0.05                  |
| CB/MH-8   | CB/MH-9  |                  | 0.0237           |                    | 0.0019           | 0.0604     | 0.1524 | 10.76         | 100                              | 15.29                 | 5.0           | 450                         | 457                        | 0.20         | 0.81              | 132.86                                 | 0.10          | 0.12                  |
| CB/MH-9   | CB/MH-10 |                  | 0.0068           |                    | 0.0028           | 0.0186     | 0.1710 | 10.87         | 100                              | 17.07                 | 18.9          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.39          | 0.13                  |
| CB/MH-10  | CB/MH-11 |                  | 0.0131           |                    | 0.0094           | 0.0380     | 0.3010 | 11.26         | 98                               | 29.49                 | 19.7          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.41          | 0.22                  |
| CB/MH-11  | MH-12    |                  | 0.0107           |                    | 0.0149           | 0.0351     | 0.3361 | 11.67         | 96                               | 32.30                 | 13.2          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.28          | 0.25                  |
| Flow through flow control devices:              |          |                  |                  |                    |                  |            |        |               |                                  | 9.31                  | 13.2          | 450                         | 457                        | 0.195        | 0.80              | 131.19                                 | 0.28          | 0.07                  |
| MH-12   | Existing |                  |                  |                    |                  |            | 0.7932 | 11.95         | 95                               | 75.29                 | 8.5           | 375                         | 366                        | 0.26         | 0.80              | 83.79                                  | 0.18          | 0.90                  |
|   | 375 ST   |                  |                  |                    |                  |            |        |               |                                  |                       |               |                             |                            |              |                   |  |               |                       |
| Flow through flow control devices:              |          |                  |                  |                    |                  |            |        |               |                                  | 17.69                 | 8.5           | 375                         | 366                        | 0.26         | 0.80              | 83.79                                  | 0.18          | 0.21                  |
| Existing 375 mm Deerfox Drive Storm Sewer:      |          |                  |                  |                    |                  |            |        |               |                                  |                       |               | 375                         | 366                        | 0.8          | 1.40              | 146.98                                 |               |                       |
| exit. DI  | CB/MH-13 |                  |                  |                    |                  | 0.0000     | 0.0000 | 10.00         | 104                              | 0.00                  | 2.8           | 200                         | 201                        | 1            | 1.05              | 33.24                                  | 0.04          | 0.00                  |
| CB/MH-13  | Existing |                  |                  |                    |                  | 0.0000     | 0.0000 | 10.04         | 104                              | 0.00                  | 24.2          | 200                         | 201                        | 1            | 1.05              | 33.24                                  | 0.39          | 0.00                  |
|   | 1200 ST  |                  |                  |                    |                  |            |        |               |                                  |                       |               |                             |                            |              |                   |  |               |                       |
| Existing 1,200 mm Woodroffe Avenue Storm Sewer: |          |                  |                  |                    |                  |            |        |               |                                  |                       |               | 1,200                       | 1,220                      | 0.25         | 1.74              | 2,037                                  |               |                       |

## **APPENDIX D**

### **CITY OF OTTAWA SERVICING STUDY CHECKLIST**

## **CITY OF OTTAWA SERVICING STUDY CHECKLIST**

### **GENERAL CONTENT**

Executive Summary: **N/A**

Date and revision number of report: **Included**

Location map and plan showing municipal address, boundary and layout of proposed development: **Included**

Plan showing site and location of all existing services: **Included**

Development statistics, land use, density, adherence to zoning and Official Plan and reference to applicable watershed and subwatershed plans: **N/A**

Summary of Pre-Application Consultation meetings with City of Ottawa and other approval agencies: **N/A**

Confirmation of conformance with higher level studies: **Included**

Statement of objectives and servicing criteria: **Included**

Identification of existing and proposed infrastructure available in the immediate area: **Included**

Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development: **N/A**

Concept level master grading plan to confirm existing and proposed grades in the proposed development: **Included**

Identification of potential impacts of proposed piped services on private services on adjacent lands: **N/A**

Proposed phasing of proposed development: **N/A**

Reference to geotechnical studies: **Included**

All preliminary and formal site plan submissions should have the following information:

Metric scale: **Included**

North arrow: **Included**

Key plan: **Included**

Name and contact information of applicant and property owner: **N/A**

Property limits: **Included**

Existing and proposed structures and parking areas: **Included**

Easements, road widenings and right-of-ways: **Included**

Street names: **Included**

## **WATER SERVICING**

Confirmation of conformance with Master Servicing Study: **N/A**

Availability of public infrastructure to service proposed development: **Included**

Identification of system constraints: **Included**

Identification of boundary conditions: **Included**

Confirmation of adequate domestic supply: **Included**

Confirmation of adequate fire flow: **Included**

Check of high pressures: **Included**

Definition of phasing constraints: **N/A**

Address reliability requirements: **N/A**

Check on necessity of a pressure zone boundary modification: **N/A**

Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for proposed development: **Included**

Description of proposed water distribution network: **Included**

Description of required off-site infrastructure to service proposed development: **N/A**

Confirmation that water demands are calculated based on the City of Ottawa Water Design Guidelines: **Included**

Provision of a model schematic showing the boundary conditions locations, streets, parcels and building locations: **Included**

## **SANITARY SERVICING**

Summary of proposed design criteria: **Included**

Confirmation of conformance with Master Servicing Study: **N/A**

Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the City of Ottawa Sewer Design Guidelines: **N/A**

Description of existing sanitary sewer available for discharge of wastewater from proposed development: **Included**

Verification of available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service proposed development: **N/A**

Calculations related to dry-weather and wet-weather flow rates: **Included**

Description of proposed sewer network: **Included**

Discussion of previously identified environmental constraints and impact on servicing: **N/A**

Impacts of proposed development on existing pumping stations or requirements for new pumping station: **N/A**

Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity: **N/A**

Identification and implementation of emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding: **N/A**

Special considerations (e.g. contamination, corrosive environment): **N/A**

## **STORMWATER MANAGEMENT & STORM SERVICING**

Description of drainage outlets and downstream constraints: **Included**

Analysis of available capacity in existing public infrastructure: **N/A**

Plan showing subject lands, its surroundings, receiving watercourse, existing drainage pattern and proposed drainage pattern: **Included**

Water quantity control objective: **Included**

Water quality control objective: **Included**

Description of the stormwater management concept: **Included**

Setback from private sewage disposal systems: **N/A**

Watercourse and hazard lands setbacks: **N/A**

Record of pre-consultation with the Ministry of the Environment, Conservation and Parks and the Conservation Authority having jurisdiction on the affected watershed: **N/A**

Confirmation of conformance with Master Servicing Study: **N/A**

Storage requirements and conveyance capacity for minor events (5-year return period) and major events (100-year return period): **Included**

Identification of watercourses within the proposed development and how watercourses will be protected or if necessary altered by the proposed development: **N/A**

Calculation of pre-development and post-development peak flow rates: **Included**

Any proposed diversion of drainage catchment areas from one outlet to another: **N/A**

Proposed minor and major systems: **Included**

If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event: **N/A**

Identification of potential impacts to receiving watercourses: **N/A**

Identification of municipal drains: **N/A**

Description of how the conveyance and storage capacity will be achieved for the proposed development: **Included**

100-year flood levels and major flow routing: **Included**

Inclusion of hydraulic analysis including hydraulic grade line elevations: **N/A**

Description of erosion and sediment control during construction: **Included**

Obtain relevant floodplain information from Conservation Authority: **N/A**

Identification of fill constraints related to floodplain and geotechnical investigation: **N/A**

## **APPROVAL AND PERMIT REQUIREMENTS**

Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act: **N/A**

Application for Certificate of Approval (CofA) under the Ontario Water Resources Act: **N/A**

Changes to Municipal Drains: **N/A**

Other permits (e.g. National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation): **N/A**

## **CONCLUSIONS**

Clearly stated conclusions and recommendations: **Included**

Comments received from review agencies: **N/A**

Signed and stamped by a professional Engineer registered in Ontario: **Included**