

Site Servicing & Stormwater Management Brief

Canadian Tire Store No. 442

2501 Greenbank Rd.

Ottawa, Ontario

Table of Contents

1.0 INTRODUCTION	1
2.0 PURPOSE.....	1
3.0 EXISTING CONDITIONS	1
4.0 PROPOSED DEVELOPMENT	1
5.0 STORMWATER MANAGEMENT PLAN	2
6.0 STORM SEWERS AND SWM SYSTEM	2
7.0 SANITARY SEWER	2
8.0 WATER SERVICING.....	3
9.0 EROSION AND SEDIMENT CONTROL DURING CONSTRUCTION.....	4
10.0 CONCLUSIONS	4

List of Tables

Table 1 : Comparison Between Existing and Proposed Runoff Coefficient.....	2
Table 2 : Building Water Demands and Fire Flow.....	3

List of Figures

Figure 1 : Fire Hydrant Locations.....	3
--	---

List of Appendices

- Appendix A : Sanitary Sewer Computation Forms
- Appendix B : Sanitary Load and Fire Flow
- Appendix C : Site Boundary Condition
- Appendix D : Stormwater Management Improvements Report Novatech Engineering Consultants Ltd.

Drawings

- Drawing C101 | Removals Plan
- Drawing C102 | Site Servicing & Erosion and Sediment Control Plan
- Drawing C103 | Grading Plan
- Drawing C104 | Details

1.0 INTRODUCTION

Parsons Inc. was retained by Canadian Tire Real Estate Limited to provide engineering services for a proposed expansion to their existing store #442 located at 2501 Greenbank Road in Ottawa, Ontario.

The proposed expansion involves an additional retail and warehouse area on the south-east side of the existing store, relocation of the garden centre, new seasonal soil compound and new e-commerce parking spaces. The expansion will impact only a certain part of the total site. The impacted site area is estimated at 0.20 ha.

The proposed work will require modifications to the existing storm sewer and the removal of the garden centre on the south-east side of the existing store. The new garden centre, e-commerce parking spaces and the new seasonal soil compound will be integrated within the existing parking lot area.

2.0 PURPOSE

This brief summarizes the impact of the proposed expansion on the existing site servicing, grading and drainage design. The erosion and sediment control measures to be undertaken during construction are also described.

Stormwater management items addressed include the following:

- Comparison between the existing and proposed runoff from the site.

3.0 EXISTING CONDITIONS

Design of the initial site was made by Bronte Engineering Limited in 2000. An expansion to the south-east of the original store was previously designed in 2006 by Delcan (now Parsons Inc.). Improvements to stormwater management of the site was also made in 2014 by Novatech Engineering Consultants Ltd. to mitigate flooding onsite and to provide additional stormwater storage. New storm chambers were installed under the existing parking lot on the south-west side of the property along Greenbank Rd.

The runoff from all drainage areas is captured through the existing storm structures. The site stormwater discharge point is located on the south corner of the property. Site stormwater is exiting the site through a 180mm x 180mm diamond shape orifice ICD plate. As per Novatech report & plan in 2014, a check valve (flap gate) was proposed on the 300mm inlet pipe to prevent municipal storm sewer back flow on site.

4.0 PROPOSED DEVELOPMENT

As shown on the Architectural Site Plan, the proposed development will consist of the addition of a retail and warehouse area on the south-east side of the existing store, relocation of the garden centre, new seasonal soil compound and new e-commerce parking spaces.

The existing garden centre will be relocated to accommodate the building expansion. Existing catch basins and storm sewers, including a connection to the roof drains, located under the existing garden centre will be removed. The new roof drain connection will be accommodated by a new connection to the existing storm maintenance hole near the new building expansion. No grading modification are anticipated within the existing parking lot area to accommodate the new garden centre, soil compound and e-commerce parking spaces. However, a new grass swale is proposed south of the building expansion to capture any water runoff coming from the back of sidewalk along Strandherd Dr.

All of the remaining site will remain in its existing condition.

5.0 STORMWATER MANAGEMENT PLAN

As mentioned earlier, only a small portion of the existing site is impacted by the new building expansion. The estimated area impacted by the proposed works is 0.20 ha. The following table illustrates the comparison between the existing and proposed runoff coefficient of the impacted area using the following runoff coefficients:

- Landscaped surfaces (grass, trees, shrubs, etc.) C = 0.20
- Impervious surfaces (asphalt, concrete, pavers, rooftops, etc.) C = 0.90

Table 1 : Comparison Between Existing and Proposed Runoff Coefficient

	Existing Condition		Proposed Expansion	
	Area (ha)	Runoff Coefficient	Area (ha)	Runoff Coefficient
Landscape Areas	0.02	0.20	0.02	0.20
Impervious Areas (asphalt, concrete)	0.18	0.90	0.06	0.90
Building Area (roof)	-	0.90	0.12	0.90
Total	0.20	0.83	0.20	0.83

As shown in the previous table, the proposed building expansion is replacing impervious areas. Thus, the post-development runoff coefficient is the same as existing condition. No additional runoff is generated by the store expansion. Additionally, the existing StormTech Chambers located at the south-west end of the parking lot will provide storage for excessive runoff which is also controlled by an ICD diamond shape orifice 180mm x 180mm before exiting the site. A flap gate was also installed on the 300mm storm sewer pipe that outlet the site to prevent overflow from municipal storm sewer on site, see **Drawing C102** for more details. Stormwater quality control for this site is achieved via the existing Kennedy Burnett storm sewer management pond, therefore no additional treatment is required.

6.0 STORM SEWERS AND SWM SYSTEM

An existing storm sewer at the south side of the building needs to be removed due to the new building footprint. A new swale with a perforated subdrain on the south side of the new building addition will be added as well as a new rear yard catch basin to receive the subdrain and the swale. New storm sewer pipe and a storm sewer maintenance hole will also be added before re-connecting to an existing storm maintenance hole in the parking lot.

As previously mentioned, an existing roof drain will need to be removed to accommodate the proposed building extension. A new roof drain will therefore be located at the existing south-west side of the building and connected to an existing storm sewer maintenance hole in the parking lot.

Details including pipe lengths, sizes, materials, inverts elevations and structure types are shown on **Drawing C102**.


7.0 SANITARY SEWER

The building addition will be serviced internally from the existing building sanitary system. The peak sanitary flow for the building with the addition of the new expansion is calculated to be **1.98 L/s**, including infiltration. The increased sanitary load calculations can be found in Appendix B. The assessment of the existing sanitary service connection shows that the capacity is adequate for the expanded building. The Sanitary Sewer Computation Sheet is included in **Appendix A**. Details concerning the existing pipe lengths and locations are shown on the site servicing plan.

8.0 WATER SERVICING

Water servicing and fire protection for the proposed building addition will be provided by the existing building service. The existing 200mm service connection, off the existing 400mm watermain on Standherd Dr. will provide both the domestic and sprinkler demands. The exterior fire protection will be provided by a combination of three existing fire hydrants around the site, all located within 75m of the building as shown on the figure below.

Figure 1 : Fire Hydrant Locations

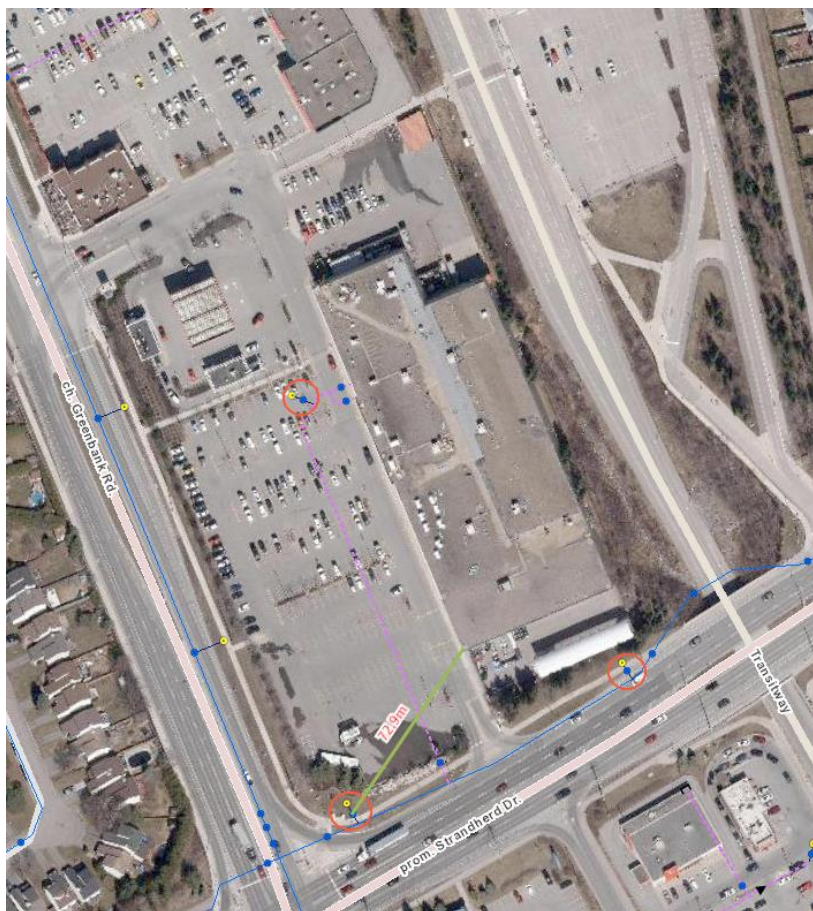

The water demands for the existing and proposed building are listed in **Table 2**. The fire flow was calculated using the Fire Underwriters Survey (FUS, 2020) method. As the table below indicates, the fire flow demand will remain the same after the proposed store addition and the average daily demand will also remain under 50m³/day (0.59L/s). Therefore, no modification to the existing on-site water service and exterior fire protection is required. Calculation details can be found in **Appendix B** and the boundary conditions received from the City are shown in **Appendix C**. Details regarding the existing watermain service connection pipe size and location are shown on **Drawing C102**.

Table 2 : Building Water Demands and Fire Flow

	Average Daily Demand (L/s)	Max Daily Demand (L/s)	Peak Hourly Demand (L/s)	Fire Flow Demand (L/s)	Max Daily + Fire Flow Demand (L/s)
Existing Store	0.28	0.42	0.75	150	150.42
Proposed Store	0.31	0.47	0.84	150	150.47

9.0 EROSION AND SEDIMENT CONTROL DURING CONSTRUCTION

To mitigate the impacts due to erosion and sedimentation during construction, erosion and sediment control measures shall be installed and maintained throughout the duration of construction.

Measures shall only be removed once the construction activities are complete, and the site has stabilized.

The measures will include:

- Siltsack® shall be installed between the frame and cover of existing and new catchbasins and maintenance holes, to minimize sediments entering the storm drainage system.
- Light Duty Silt Fence Barriers placed around the perimeter of the site where necessary, installed and maintained according to OPSS 577 and OPSD 219.110.

10.0 CONCLUSIONS

No additional stormwater management is required for this site as the building expansion does not generate additional runoff. Minimal modifications to the existing storm sewer are required due to the new building footprint. The existing StormTech chambers located at the south-west end of the parking will provide storage for large storm events. No on-site stormwater treatment is required as the required treatment is achieved via the existing Kennedy Burnett Pond located downstream from our site.

The water servicing of the building addition will be provided from the existing building plumbing system and the existing 200mm service. The proposed building fire flow was estimated at **150 L/s** which is the same as the existing building fire flow and the average daily demand is under 50m³/day. Thus, no modification to the existing water servicing and exterior fire protection is required.

The sanitary servicing of the building addition will be provided from the existing building plumbing system. The peak sanitary flow for the proposed building, including infiltration, is calculated to be **1.98 L/s**. The existing building sanitary service connection is adequate to carry the additional sanitary load.

Erosion and sediment control measures will minimize downstream impacts due to construction activities.

We look forward to receiving approval of this brief and the appended plans from the City of Ottawa in order to proceed with construction of the site.

Prepared by:

Reviewed by:



Patrick Charlebois, EIT



Mathew Theiner, P.Eng., ing.

Appendix A : Sanitary Sewer Computation Forms

SANITARY SEWER DESIGN SHEET

Drainage Area	From	To	Peak Flow Q (L/sec)	Sewer Data										REMARKS
				Type of Pipe	Pipe Dia.		Slope (%)	Length (m)	Capacity full (L/sec)	Velocity		Time of Flow (min)	Q(d) / Q(f)	
					nom. (mm)	actual (mm)				full (m/sec)	actual (m/sec)			
	CTC Site	Public San Sewer	1.98	PVC	200	203.2	0.5	150.0	24.2	0.75	0.40	6.21	0.08	

Manning's n = 0.013

Design: B. Villeneuve	Project Name: Barrhaven Canadian Tire
Check: M. Theiner	Parsons Project #: 478461
Date: March, 2023	Client: Canadian Tire Realty
	Client Project #:

Appendix B : Sanitary Load and Fire Flow

SANITARY DESIGN FLOWS

Area	WAREHOUSE					OFFICE					AUTOMOTIVE SERVICE CENTRE				COMMERCIAL/RETAIL			TOTAL	INFILTRATION			Total
	Site Area (ha)	Warehouse Area (m ²)	Capita (1/90m ²)	Peak Factor	Peak Flow (L/s)	Site Area (ha)	Office Area (m ²)	Capita (1/25m ²)	Peak Factor	Peak Flow (L/s)	Number of Bays	Capita	Peak Factor	Peak Flow (L/s)	Retail Area (m ²)	Peak Factor	Peak Flow (L/s)	Peak Flow (L/s)	Site Areas (ha)	Infiltration Allowance (L/s/ha)	Infil. Flow (L/s)	Total Peak Flow (L/s)
Existing Store (C.T. Store # 442)																			3.03	0.33	1.00	1.00
Retail															5,181	1.5	0.22	0.22				0.22
Office							460	18	1.5	0.02								0.02				0.02
Warehouse		3,116	35	1.5	0.05													0.05				0.05
Automotive Service Centre											15	18	1.5	0.02				0.02				0.02
Corner Store															107	1.5	0.005	0.00				0.00
Car Wash																		0.63				0.63
																						Total
																						1.94
Proposed Expansion (C.T. Store # 442)																			3.03	0.33	1.00	1.00
Retail															5,832	1.5	0.25	0.25				0.25
Office							411	16	1.5	0.02								0.02				0.02
Warehouse		3,675	41	1.5	0.05													0.05				0.05
Automotive Service Centre											15	18	1.5	0.02				0.02				0.02
Corner Store															107	1.5	0.005	0.00				0.00
Car Wash																		0.63				0.63
																						Total
																						1.98

Average Daily Demands

(Based on City of Ottawa Sewer Design Guidelines 2012 and MOE Water Design Guidelines)

Average Residential Daily Flow =	280 L/p/d	Peak Factors	
Institutional Flow =	28,000 L/ha/d	Commercial =	1.5 if commercial contribution > 20%, otherwise 1.0
Commercial Flow =	28,000 L/ha/d	Institutional =	1.5 if institutional contribution > 20%, otherwise 1.0
Light Industrial Flow =	35,000 L/ha/d	Industrial =	per Appendix 4-B.0 Graph
Heavy Industrial Flow =	55,000 L/ha/d	Residential :	Harmon Equatio $1 + (14/(4+(Capita/1000) ^ 0.5))*8$
Hotel Daily Flow =	225 L/bed/d		min = 2 max = 4
Office/Warehouse Daily Flow =	75 L/empl/d		
Shopping Centres =	2,500 L/(1000m ² /d)		

Infiltration allowance (dry weather)	0.05 L/s/ha
Infiltration allowance (wet weather)	0.28 L/s/ha

Population Densities

Average suburban residential dev.	60 p/ha	I/I (total)	0.33 L/s/ha
Single family	3.4 p./unit		
Semi-detached	2.7 p./unit		
Duplex	2.3 p./unit		
Townhouse	2.7 p./unit		
Appartment average	1.8 p./unit		
Bachelor	1.4 p./unit		
1 Bedroom	1.4 p./unit		
2 Bedrooms	2.1 p./unit		
3 Bedrooms	3.1 p./unit		
Hotel room, 18 m2	1 p./unit		
Restaurant, 1 m2	1 p./unit		
Office	1 p/25m ²		
Warehouse	1 p/90m ²		
Automotive Service Centre, per bay	1 p/bay (plus management)		
Car wash	40gallons per wash, 4mins wash, 10GPM, .0.63L/s		

Design: BV	Project: Barrhaven Canadian Tire Ottawa, Ontario
Check : MT	Location: 2501 Greenbank Rd Ottawa, Ontario
Dwg reference:	Project # : 478461 Date: March, 2023 Sheet: 1 of 1

Canadian Tire Barrhaven - Estimated Water Demands

Area	Units	Population	Gross Floor Area (m ²)	Average Daily Demand (ADD) (L/s)	Maximum Daily Demand (MDD) (L/s)	Peak Hourly Demand (PHD) (L/s)	Fire Flow (FF) (L/s)	MDD + FF (L/s)
Existing Canadian Tire Store								
Shopping Centre			9,565	0.28	0.42	0.75	150	150.42
Proposed Canadian Tire Store								
Shopping Centre			10,726	0.31	0.47	0.84	150	150.47

Average Daily Demand

Based on Ottawa Design Guidelines - Water Distribution, 2010 and MOE Design Guidelines for Drinking-Water Systems, 2008

Average Residential Daily Flow =	350 L/p/d
Institutional Flow =	28,000 L/gross ha/d
Commercial Flow =	28,000 L/gross ha/d
Light Industrial Flow =	35,000 L/gross ha/d
Heavy Industrial Flow =	55,000 L/gross ha/d
Hotel Daily Flow =	225 L/bed/d
Office/Warehouse Daily Flow =	75 L/person/d
Office/Warehouse Daily Flow =	8.06 L/m ² /day
Restaurant (Ordinary not 24 Hours) =	125 L/seat/d
Restaurant (24 Hours) =	200 L/seat/d
Shopping Centres =	2,500 L/(1000m ² /d)
Amenity Area =	5 L/m ² /d

Maximum Daily Demand

Residential = 2.5 x Average Daily Demand
4.9 x Average Daily Demand **
Industrial = 1.5 x Average Daily Demand
Commercial = 1.5 x Average Daily Demand
Institutional = 1.5 x Average Daily Demand

Peak Hourly Demand

Residential = 2.2 x Maximum Daily Demand
7.4 x Maximum Daily Demand **
Industrial = 1.8 x Maximum Daily Demand
Commercial = 1.8 x Maximum Daily Demand
Institutional = 1.8 x Maximum Daily Demand

Canadian Tire Barrhaven - Fire Demand Calculations

Building	Type of Construction C	Total Floor Area (m ²) A	Fire Flow (min. 2,000) (L/min) F	Adjusted (nearest 1,000) (L/min) (L/min)	Occupancy Factor O	Reduction / Increase due to Occupancy	Fire Flow with Occupancy (min. 2,000) (L/min) (L/min)	Sprinklers Factor S	Reduction due to Sprinklers (L/min)	Exposure Factor % E	Increase due to Exposure (L/min)	Fire Flow (L/min)	Roof Contribution (L/min) R	Required Fire Demand	
														Adjusted to the nearest 1000 (min. 2,000, max. 45,000) (L/min) F	Minimum 33 (L/s) (L/s)
Existing CT	0.8	9,565	17,213	17,000	0%	0	17,000	50%	8,500	0%	0	9,000	0	9,000	150
Proposed CT	0.8	10,726	18,228	18,000	0%	0	18,000	50%	9,000	0%	0	9,000	0	9,000	150

References

Water Supply for Public Fire Protection, 2020 by Fire Underwriters Survey (FUS) and Ottawa Design Guidelines - Water Distribution, July 2010 and subsequent Technical Bulletins

C Type of Construction

Wood Frame (Type V)	1.5
Mass Timber (Type IV-A) - Encapsulated Mass Timber	0.8
Mass Timber (Type IV-B) - Rated Mass Timber	0.9
Mass Timber (Type IV-C) - Ordinary Mass Timber	1.0
Mass Timber (Type IV-D) - Unrated Mass Timber	1.5
Ordinary Construction (Type III also known as joisted masonry)	1.0
Non-Combustible Construction (Type II - minimum 1 hour fire resistance rating)	0.8
Fire resistive Construction (Type I - minimum 2 hour fire resistance rating)	0.6

S Sprinklers

	<u>Complete Coverage</u>	<u>Partial Coverage</u>
Automatic Sprinklers NFPA Standards	30%	30% * x%
Standard Water Supply	10%	10% * x%
Full Supervision	10%	10% * x%

(x%: percentage of total protected floor area)

Additional Reductions for Community Level Automatic Sprinkler Protection of Area

Buildings located within communities or subdivisions that are completely sprinkler protected may apply up to a maximum additional 25% reduction in required fire flows beyond the normal maximum of 50% reduction for sprinkler protection of an individual building.

Adjustment of Sprinkler Reductions for Community Level Oversight of Sprinkler Maintenance, Testing, and Water Supply Requirements

The reduction in required fire flow for sprinkler protection may be reduced or eliminated if:

- The community does not have a Fire Prevention Program that provides a system of ensuring that the fire sprinkler systems are inspected, tested, and maintained in accordance with NFPA 25
- The community does not maintain the pressure and flow rate requirements for fire sprinkler installations, or otherwise allows the flow rates and pressure levels that were available during sprinkler system design to significantly degrade, increasing the probability of inadequate water supply for effective sprinkler operation.

E Exposure

The maximum exposure adjustment that can be applied to a building is 75% when summing the percentages of all sides of the building.

Separation Distance (m)	Maximum Exposure Adjustment	N	E	S	W
0 to 3	25%				
3.1 to 10	20%				
10.1 to 20	15%				
20.1 to 30	10%				
Greater than 30	0%				

Table 6: Exposure Adjustment Charges for Subject Building Considering Construction Type of Exposed Building Face

Distance to the Exposure (m)	Length-Height Factor of Exposing Building Face	Type V	Type III-IV ²	Type III-IV ³	Type II ²	Type I-II ³
		0 to 3	0-20: 20%	21-40: 21%	41-60: 22%	61-80: 23%
3.1 to 10	0-20: 15%	21-40: 16%	41-60: 17%	61-80: 18%	81-100: 19%	Over 100: 20%
10.1 to 20	0-20: 10%	21-40: 11%	41-60: 12%	61-80: 13%	81-100: 14%	Over 100: 15%
20.1 to 30	0-20: 0%	21-40: 2%	41-60: 4%	61-80: 6%	81-100: 8%	Over 100: 10%
Over 30m	All Sizes	0%	0%	0%	0%	0%

² with unprotected openings

³ without unprotected openings

Automatic Sprinkler Protection in Exposed Buildings

- If the exposed building is fully protected with an automatic sprinkler system (see note Recognition of Automatic Sprinkler), the exposure adjustment charge determined from Table 6 may be reduced by up to 50% of the value determined.

Automatic Sprinkler Protection in both Subject and Exposed Buildings

- If both the subject building and the exposed building are fully protected with automatic sprinkler systems (see note Recognition of Automatic Sprinkler), no exposure adjustment charge should be applied.

Exposure Protection of Area Between Subject and Exposed Buildings

- If the exposed building is fully protected with an automatic sprinkler system (see note Recognition of Automatic Sprinkler), and the area between the buildings is protected with an exterior automatic sprinkler system, no exposure adjustment charge should be applied.

Reduction of Exposure Charge for Type V Buildings

- If the exposed building face of a Type V building has an exterior cladding assembly with a minimum 1 hour fire resistive rating, then the exposure charge may be treated as a Type III/IV building for the purposes of looking up the appropriate exposure charge in Table 6.

A Total Effective Floor Area (m²)

Buildings Classified with a Construction Coefficient from 1.0 to 1.5

100% of all Floor Areas

Buildings Classified with a Construction Coefficient below 1.0

Vertical Openings Unprotected

Two (2) Largest Adjoining Floor Areas
Additional Floors (up to eight (8)) at 50%

Vertical Openings Properly Protected

Single Largest Floor
Additional Two (2) Adjoining Floors at 25%

High One Storey Building

When a building has a large single storey space exceeding 3m in height, the number of storeys to be used in determining the total effective area depends upon the use being made of the building.

Subdividing Buildings (Vertical Firewalls)

Minimum two (2) hour fire resistance rating and meets National Building Code requirements.

- Up to 10% can be applied if there is severe risk of fire on the exposed side of the firewall due to hazard conditions.
- An exposure charge of up to 10% can be applied if there are unprotected openings in the firewall

Basement

Basement floor excluded when it is at least 50% below grade.

Open Parking Garages

Use the area of the largest floor.

O Occupancy

Non-Combustible	-25%
Limited Combustible	-15%
Combustible	0%
Free Burning	15%
Rapid Burning	25%

- Table 3 provides recommended Occupancy and Contents Adjustment Factors for Example Major Occupancies from the National Building Code of Canada.

- Adjustment factors should be adjusted accordingly to the specific fire loading and situation that exists in the subject building.

- Values can be interpolated from the examples given considering fire loading and expected combustibility of contents if the subject building is not listed.

- Values can be modified by up to 10% (+/-) depending on the extent to which the fire loading is unusual for the building.

- Buildings with multiple major occupancies should use the most restrictive factor or interpolate based on the percentage of each occupancy and its associated fire loading.

Table 3 Values for Subject Building

Group:	F
Division:	3
Description of Occupancy:	Storage Garage including Open Air Parking Garage
Occupancy and Contents:	Combustible
Adjustment Factor:	0%

R Roof

Shake Roof	2,000 to 4,000 L/min	additional should be added to the fire flow
Wood Shingle	2,000 to 4,000 L/min	additional should be added to the fire flow

F Fire Flow (L/Min)

$$220 * C * (A^{0.5})$$

Appendix C : Site Boundary Condition

Boundary Conditions 2501 Greenbank Road

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	19	0.31
Maximum Daily Demand	28	0.47
Peak Hour	50	0.84
Fire Flow Demand #1	9,000	150.00

Location



Results

Existing Conditions (Pressure Zone 3SW)

Connection 1 – Strandherd Dr.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	156.8	80.0
Peak Hour	143.7	61.4
Max Day plus Fire Flow	133.8	47.3

¹ Ground Elevation = 100.5 m

Future Conditions (Pressure Zone SUC)

Connection 1 – Strandherd Dr.

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	146.9	65.9
Peak Hour	144.4	62.4
Max Day plus Fire Flow	145.1	63.3

¹ Ground Elevation = 101.2 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

Appendix D : Stormwater Management Improvements Report Novatech Engineering Consultants Ltd.

CANADIAN TIRE – BARRHAVEN

STORMWATER MANAGEMENT IMPROVEMENTS REPORT

Prepared by:

**NOVATECH ENGINEERING CONSULTANTS LTD.
240 Michael Cowpland Dr. - Suite 200
Ottawa, Ontario
K2M 1P6**

**File No.: 113199
Report Reference No.: R-2014-072**

May 28, 2014



May 28, 2014

Keller Engineering Associates Inc.
1390 Prince of Wales Drive, Suite 107
Ottawa, ON, K2C 3N6

Attention: Mr. Adam Archambault

Dear Sir:

**Reference: Canadian Tire – Barrhaven Ontario
Stormwater Management Improvements Report
Our File No.: 113199**

Enclosed herein is the Stormwater Management Improvements Report for improving the stormwater management strategy for the existing Canadian Tire in Barrhaven Ontario. This report is submitted to review the existing conditions and presents a stormwater management strategy for mitigating the existing flooding issues for the site.

Trusting this report is adequate for your purposes. Should you have any questions, or require additional information, please contact us.

Yours truly,

NOVATECH ENGINEERING CONSULTANTS LTD.

A handwritten signature in blue ink, appearing to read "M. Petepiece", with a long horizontal flourish extending to the right.

Michael Petepiece, P.Eng.
Project Manager

TABLE OF CONTENTS

1.0	INTRODUCTION	1
1.1	LOCATION	1
1.2	PHASING.....	1
2.0	SWM CRITERIA	2
2.1	ALLOWABLE RELEASE RATE	2
3.0	EXISTING CONDITIONS	3
3.1	VIDEO INSPECTION REPORT	3
3.2	BRONTE ENGINEERING LIMITED SWM REPORT	4
3.3	VILLAGE SQUARE PLAZA	4
3.4	GREENBANK ROAD	6
4.0	HYDROLOGIC AND HYDRAULIC MODELING	6
4.1	MODEL DEVELOPMENT	6
4.1.1	<i>Subcatchments / Storm Sewers</i>	7
4.1.2	<i>Infiltration</i>	7
4.1.3	<i>Depression Storage</i>	7
4.1.4	<i>Equivalent Width</i>	7
4.1.5	<i>Major & Minor System Networks</i>	7
4.1.6	<i>Modeling Files / Schematic</i>	7
4.2	DESIGN STORMS	8
5.0	EXISTING CONDITIONS MODEL	8
5.1	MODEL CALIBRATION (JULY 19 TH , 2013 STORM EVENT)	9
5.2	MODEL RESULTS (EXISTING CONDITIONS).....	11
5.3	IDENTIFICATION OF THE PRIMARY CAUSES OF FLOODING	13
6.0	PROPOSED SWM IMPROVEMENTS	13
6.1	MODEL RESULTS (PROPOSED IMPROVEMENTS)	13
6.2	DESIGN DETAILS	14
7.0	WATER QUALITY	15
8.0	EMERGENCY OVERLAND DRAINAGE	15
9.0	GEOTECHNICAL INVESTIGATION	15
10.0	EROSION & SEDIMENT CONTROL REQUIREMENTS	16
11.0	CONCLUSIONS AND RECOMMENDATIONS	16

List of Figures

Figure 1: Aerial Photo of the Canadian Tire Site (Google, 2013).....	1
Figure 2a: Gate/Orifice in MH16 Figure 2b: Rating Curve for orifice in MH16	3
Figure 3: Drainage Area from Village Square Plaza to CBMH6.....	5
Figure 4: Drainage Area from Greenbank Road to CBMH6 (Google, 2014)	6
Figure 5: Rainfall Intensity (mm/hr) - July 19 th , 2013 Event (Walter Baker Rain Gauge).....	10
Figure 6: Extent of Flooding on July 19 th , 2013	11
Figure 7: Existing and Proposed Ponding Limits	12

List of Tables

Table 1: Hydrologic Modeling Parameters.....	8
--	---

List of Appendices

Appendix A – Geotechnical Reports
Appendix B – Storm Sewer Design Sheets
Appendix C – SWM Calculations
Appendix D – SSA Model Results, Schematic and Input/Output Data
Appendix E – Stormtech MC-3500 Infiltration Chamber Details
Appendix F – External/Internal Drawings

List of Attached Drawings*External Drawings:*

- 1) Detailed Topographic Survey
(Fairhall Moffatt & Woodland Ltd. October 17, 2013)
- 2) Servicing and Grading Plan for Proposed Canadian Tire
(Bronte Engineering Limited, February, 2000)
- 3) Servicing Plan for Canadian Tire Gas Bar
(Trow Associates Inc., February, 2003)
- 4) Site Servicing and Grading Plan for South Expansion to Canadian Tire
(Delcan, March, 2006)
- 5) General Plan of Services for Village Square Plaza
(Cumming Cockburn Limited, December 2000)
- 6) Site Servicing Plan for Village Square Plaza Expansion
(Novatech Engineering Consultants Ltd., December 2010)
- 7) Plan and Profiles for Greenbank Road
(Regional Municipality of Ottawa-Carleton, July 1990)
- 8) Strandherd Drive Road Reconstruction
(McCormick Rankin Consulting Engineers, May 1992)

Internal Drawings:

- 1) 113199-SWM (storm drainage area plan)
- 2) 113199-STM-Existing (existing storm sewer network)
- 3) 113199-GP (proposed general plan of services)
- 4) 113199-DET (notes and details)
- 5) 113199-TCP (tree conservation plan)
- 6) 113199-L (landscape plan)

1.0 INTRODUCTION

This report outlines proposed improvements to the existing storm drainage infrastructure at the Canadian Tire retail centre and gas bar in Barrhaven, Ontario to reduce the frequency and extent of surface flooding during moderate to large storm events. This report identifies the primary causes of flooding, and illustrates the extent of flooding under existing conditions (based on model results) for various design rainfall events.

1.1 Location

The Canadian Tire site is located in Barrhaven (Ottawa), Ontario northwest of the intersection of Strandherd Drive and Greenbank Road, as shown in **Figure 1** below. The site shares an entrance off of Greenbank Road with Village Square Plaza, an existing retail plaza to the north of the Canadian Tire. An OC Transpo Transitway bounds the site to the east.



Figure 1: Aerial Photo of the Canadian Tire Site (Google, 2013)

1.2 Phasing

The current Canadian Tire site was developed in three phases, as outlined in the design reports prepared for each phase:

- Canadian Tire Building and Parking Lot (*Bronte Engineering Limited, February 2000*)
- Canadian Tire Gas Bar (*Trow Associates Inc., February 2003*)
- South Extension of the Existing Canadian Tire Building (*Delcan, March 2006*)

The initial site was designed in 2000 by Bronte Engineering Limited and has been modified twice to account for the development of the Gas Bar and expansion of the existing Canadian Tire building to the south. The original storm sewer design was modified to accommodate construction of the Canadian Tire Gas Bar (2003) and south extension (2006), but pipe sizes and slopes for both phases are similar to those specified in the original design by Bronte Engineering Limited.

The construction of the Gas Bar included removing storm sewers underneath the footprint of the Gas Bar to make room for the gas pumps, the underground fuel tanks, the car wash and the kiosk. The catchbasin manholes were relocated and a new sewer system was installed.

The construction of Strandherd Drive east of Greenbank Road provided the opportunity to expand the Canadian Tire building footprint to the south. The building expansion included extending the outlet pipe for the roof drains and relocating the existing catchbasins and catchbasin manholes within the footprint of the expansion.

2.0 SWM CRITERIA

The proposed storm drainage improvements to alleviate the existing surface flooding will adhere to the stormwater management criteria previously established in the following documents:

- Canadian Tire – Stormwater Management Report
(*Bronte Engineering Limited, February 18, 2000*)
- Village Square Plaza – Stormwater Management Report
(*Cumming Cockburn Limited, March 5, 2001*)
- Village Square Plaza Expansion – Stormwater Management Report
(*Novatech Engineering Consultants Limited (February 18, 2010)*)
- City of Ottawa Sewer Design Guidelines (October 2012)

2.1 Allowable Release Rate

Based on the storm sewer design sheets provided in the Stormwater Management Report for Village Square Plaza (**Appendix B**), the Canadian Tire site was allocated a release rate of 160L/s. The outlet manhole from the Canadian Tire Site (MH 16) includes a diamond shaped 180mm x 180mm orifice plate installed in a slide gate as shown in **Figure 2a**. The 375mm outlet pipe downstream of the orifice plate is sloped at 0.5% and connects to a catchbasin manhole installed on Greenbank Road. The rating curve for this orifice (**Figure 2b**), indicates that the depth of water in the manhole with the orifice plate (MH16) will need to be at the ground surface to achieve a release rate of 160L/s.



Figure 2a: Gate/Orifice in MH16

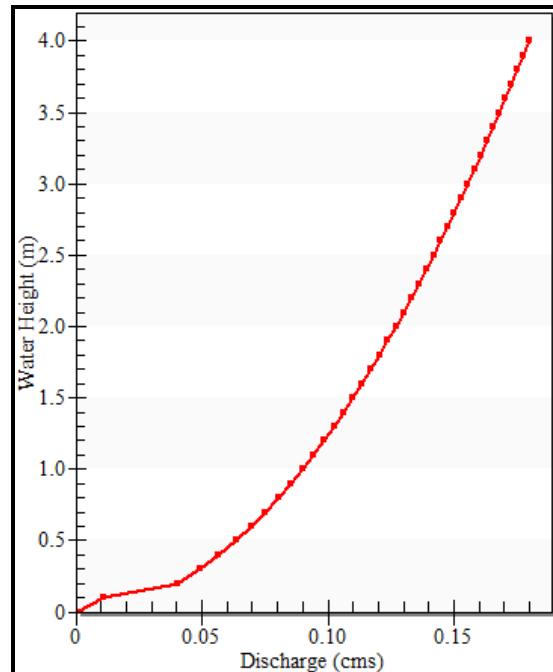


Figure 2b: Rating Curve for orifice in MH16

3.0 EXISTING CONDITIONS

The existing storm sewer network for the Canadian Tire site is shown on the Drawing 113199-STM-Existing.

3.1 Video Inspection Report

The video inspection completed by Multi-Drain Inspection Services (Multi-Drain) on October 23, 2013 did not reveal any significant problems with the storm sewers. In one instance there was a crack in the sewer, but this would only cause minor inflows/infiltration to or from the system.

Multi-Drain did notice the presence of oil sheen in the catchbasins and storm sewers near the Gas Bar. Further investigation by Terrapex Environmental Ltd. did not find any evidence of oil or sheen in the catchbasins and there were no obvious concerns with the stormceptor. At this time Terrapex Environmental Ltd. is not recommending any additional work since there does not appear to be any ongoing concern.

Pipe sizes and lengths were confirmed by Multi-Drain in the field and were consistent with the design drawings and survey completed by Fairhall Moffatt & Woodland Ltd. (October 17, 2013). Invert elevations of the storm sewers were provided by Multi-Drain Inspection Services to Fairhall Moffatt & Woodland Ltd. to develop an as-built drawing, which has been attached to this report.

3.2 Bronte Engineering Limited SWM Report

The stormwater management report for the original Canadian Tire (Bronte Engineering Limited, February 18, 2000) provided only a hydrologic analysis and did not include a hydraulic analysis of the sewer system. The hydrologic analysis from this report is summarized below:

- Allowable peak flow rate from the site (Rational Method):
 - 5-year = 151.8 L/s
 - 100-year = 248.7 L/s
- Controlled flow rate from the site (OTTHYMO model results):
 - 5-year = 144.6 L/s
 - 100-year = 147.2 L/s
- Depth of ponding in the parking lot:
 - 5-year = 0.19m (99.70m (elevation))
 - 100-year = 0.29m (99.80m elevation)

The building roof was designed to provide 836m³ of storage with outflows controlled using eleven (11) ZURN type roof drains, which restrict flows to 21L/s at a head of 0.125m.

The parking lot was designed to provide 600m³ of storage at a maximum ponding elevation of 99.80m, with outflows controlled using a 180mm x 180mm orifice plate located on the upstream side of the manhole at the southwest corner of the site (MH16).

3.3 Village Square Plaza

The Village Square Plaza was developed subsequent to the Canadian Tire site. The 1:1000 mapping provided by the City of Ottawa (2009) indicates that the parking lot of the Village Square Plaza is at least 1.0m higher than the Canadian Tire site.

The storm drainage area plan for Village Square Plaza allocated an area of approximately 0.30 ha to the Canadian Tire storm sewers (shown in blue on **Figure 3**). Based on a field review of existing conditions, several of the catchbasins in the Village Square parking lot are on a continuous grade, which significantly limits their effectiveness in capturing storm runoff. This results in a larger contributing area from the Village Square Plaza parking lot to the Canadian Tire site at the south entrance from Greenbank Road (i.e. CBMH6). Based on site visits and a review of the 1:1000 topographic mapping, the extra contributing drainage area from the Village Square Plaza is approximately 0.26 ha (shown in red on **Figure 3**), which is almost double what was previously allocated.

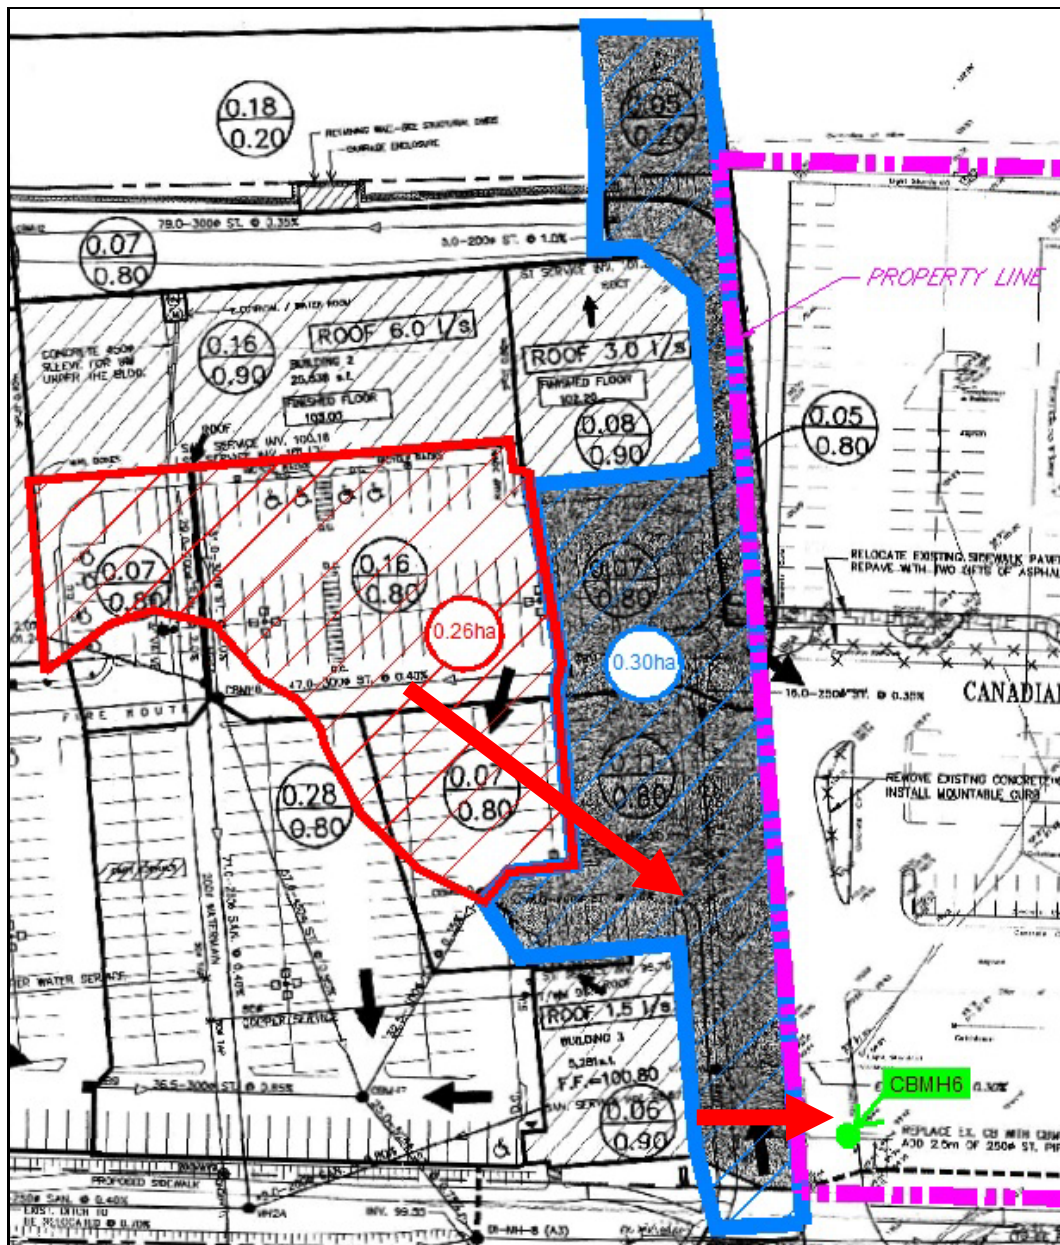


Figure 3: Drainage Area from Village Square Plaza to CBMH6

The storm sewer system on the Canadian Tire site is undersized (based on current City standards) and the additional runoff from the Village Square Plaza further reduces the level of service provided by the existing storm sewers.

3.4 Greenbank Road

The east portion of Greenbank Road drains into a roadside ditch, which flows into a ditch inlet catchbasin (DICB) north of the south entrance from Greenbank Road to the Canadian Tire site. As shown in **Figure 4**, there is a portion of Greenbank Road (approximately 0.07 ha) that drains into the Canadian Tire storm sewer system as the elevation of Greenbank Road is higher than the private entrance and a portion of Greenbank Road has roadside curbs.

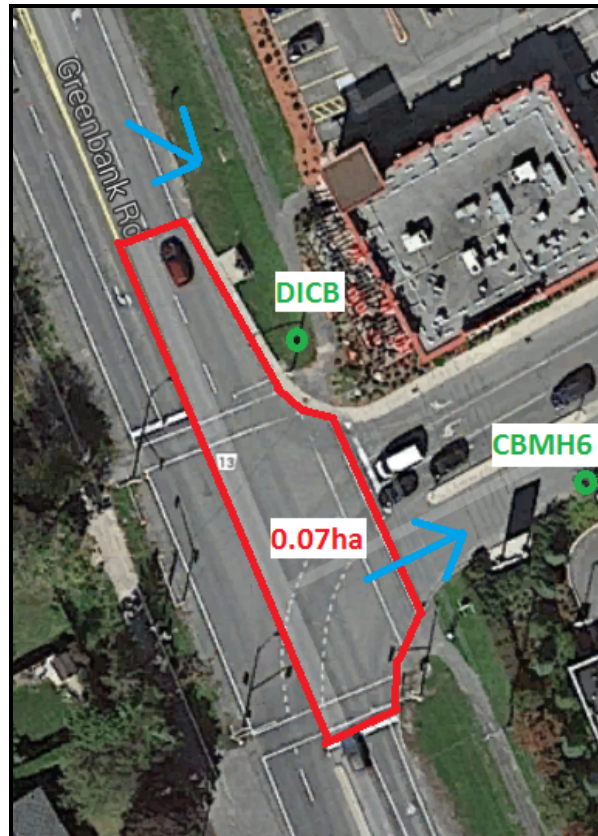


Figure 4: Drainage Area from Greenbank Road to CBMH6 (Google, 2014)

4.0 HYDROLOGIC AND HYDRAULIC MODELING

The City of Ottawa Sewer Design Guidelines (October 2012) require the use of a dynamic hydrologic/hydraulic model to evaluate stormwater management retrofits of existing infrastructure.

The existing Canadian Tire storm drainage system and the proposed modifications were modeled using Autodesk Storm and Sanitary Analysis (Autodesk SSA). The capabilities of the software are summarized in the *Autodesk Storm and Sanitary Analysis 2013 – Technical Capabilities and Functionalities* bulletin provided in **Appendix D**.

4.1 Model Development

The Autodesk SSA models account for both minor and major system flows, including the routing of flows through the storm sewer network (minor system), and overland between catchbasins (major system).

4.1.1 Subcatchments / Storm Sewers

Model parameters for the subcatchments and storm sewers were developed using the following sources:

- Detailed topographic survey by Fairhall Moffatt & Woodland Ltd. (October 17, 2013);
- 1:1000 mapping from the City of Ottawa (2009);
- Aerial photos from GeoOttawa (2011) and Google Maps (2013);
- Inverts and pipe sizes provided by Multi-Drain Inspection Services (October 23, 2013);
- Storm sewer design sheets and plan and profile drawings for Greenbank Road and Strandherd Drive (2001);

4.1.2 Infiltration

Infiltration losses were modeled using Horton's equation, which defines the infiltration capacity of the soil over the duration of a precipitation event using a decay function that ranges from an initial maximum infiltration rate to a minimum rate as the storm progresses. The default values from the City of Ottawa Sewer Design Guidelines (October 2012) were used for all catchments.

Horton's Equation:
 $f(t) = f_c + (f_o - f_c)e^{-k(t)}$

Initial infiltration rate: $f_o = 76.2$ mm/hr
Final infiltration rate: $f_c = 13.2$ mm/hr
Decay Coefficient: $k = 4.14$ /hr

4.1.3 Depression Storage

Building rooftops are assumed to provide no depression storage (all rainfall converted to runoff). The default values for depression storage from the City of Ottawa Sewer Design Guidelines (October 2012) were used for all other catchments.

- Depression Storage (pervious areas): 4.67 mm
- Depression Storage (impervious areas): 1.57 mm

4.1.4 Equivalent Width

The 'equivalent width' parameter is calculated by dividing the flow length by the catchment area, as described in the City of Ottawa Sewer Design Guidelines (October 2012).

4.1.5 Major & Minor System Networks

Inlets to the storm sewer network were modeled as storage nodes. The stage-storage curves include the storage volume within the structure (pipe invert to top of grate), as well as the storage above the structure (surface ponding).

Storm sewer (pipe) data includes length, diameter, slope, inlet and outlet elevations, Manning's Roughness, and inlet/outlet losses through manholes.

Overland flow paths between storm inlets are represented as open channels. Cross-sections and elevations for the overland flow network are based on the topographic data.

4.1.6 Modeling Files / Schematic

The Autodesk Storm and Sanitary Analysis modeling files and schematics are provided in **Appendix D**. Digital copies of the modeling files and model output for all storm events are provided on the enclosed CD.

4.2 Design Storms

The hydrologic analysis was completed using a wide range and variety of synthetic design storms and historical storms. The IDF parameters used to generate the design storms were taken from the City of Ottawa Sewer Design Guidelines (October 2012).

3 Hour Storm Distributions:

2-year 3hr Chicago
5-year 3hr Chicago
10-year 3hr Chicago
25-year 3hr Chicago
50-year 3hr Chicago
100-year 3hr Chicago
100-year 3hr Chicago (+20%)

24 Hour Storm Distributions:

2-year 24hr Chicago
5-year 24hr Chicago
10-year 24hr Chicago
25-year 24hr Chicago
50-year 24hr Chicago
100-year 24hr Chicago
100-year 24hr Chicago (+20%)

Historical Storms:

July 1, 1979
August 4, 1988
August 8, 1996
July 19, 2013 (used for calibration purposes)

5.0 EXISTING CONDITIONS MODEL

An existing conditions model of the Canadian Tire site was developed to simulate the minor and major drainage systems. In order to accurately evaluate hydraulic conditions in the on-site storm sewers, the following external drainage areas were also included in the model:

- Village Square Plaza / Plaza Expansion: Buildings and parking lots (including storage and controlled release rates), drainage areas tributary to the Canadian Tire site;
- Greenbank Road / Strandherd Drive: Upstream/downstream drainage areas, storm sewer network and major system overland flow routes.

For areas where as-built information was not available, design elevations from the original SWM reports and drawings were used. The model subdivides the site into subcatchments which represent the area tributary to each inlet to the storm sewer system as shown on the Drawing 113199-SWM. An overview of the modeling parameters for each subcatchment is provided in **Table 1**. Supporting calculations are provided in **Appendix C**.

Table 1: Hydrologic Modeling Parameters

Catchment ID	Area (ha)	Runoff Coefficient C	Percent Impervious (%)	Equivalent Width (m)	Avg. Slope (%)
External Drainage Areas					
Greenbank Road (A3)	0.440	0.70	71%	34	1.00%
Greenbank Road (A3 - A2)	0.275	0.70	71%	31	1.00%
Greenbank Road (A2 - A1)	0.450	0.70	71%	35	1.00%
Greenbank Road (A1 – A)	0.770	0.70	71%	39	1.00%
Greenbank Road (A – B)	0.424	0.71	73%	53	1.00%
Strandherd Drive (B – C)	1.150	0.70	71%	58	1.00%

Catchment ID	Area (ha)	Runoff Coefficient C	Percent Impervious (%)	Equivalent Width (m)	Avg. Slope (%)
Greenbank Road (C – D)	1.174	0.54	48%	117	1.00%
Greenbank Road (D – E)	0.498	0.65	64%	62	1.00%
Village Square (Buildings)	0.660	0.90	100%	138	2.45%
Village Square (Parking)	1.209	0.90	100%	139	1.50%
Village Square Expansion (Buildings)	0.221	0.90	100%	82	1.50%
Village Square Expansion (Parking)	0.521	0.90	100%	163	0.91%
Canadian Tire Site					
EX-1 (Village Square)	0.178	0.90	100%	27	2.77%
Greenbank Road	0.070	0.90	100%	16	1.33%
CBMH6	0.440	0.88	97%	70	1.84%
CB1	0.123	0.78	83%	47	1.38%
CBMH2	0.131	0.80	86%	33	4.26%
CB3	0.160	0.90	100%	40	3.76%
PUMPS	0.037	0.90	100%	22	1.50%
GAS BAR	0.013	0.90	100%	19	1.50%
CAR WASH	0.011	0.90	100%	18	1.50%
CBMH102	0.059	0.90	100%	20	1.52%
CBMH101	0.106	0.90	100%	31	1.45%
GB-CB3	0.068	0.90	100%	13	1.36%
CBMH104	0.010	0.90	100%	11	0.64%
CBMH103	0.022	0.90	100%	24	2.96%
GB-CB1	0.010	0.90	100%	9	1.52%
GB-CB4	0.008	0.90	100%	7	0.40%
GB-CB2	0.012	0.90	100%	6	0.37%
CBMH105	0.028	0.20	0%	16	0.40%
CBMH106	0.011	0.20	0%	6	0.78%
CBMH10	0.331	0.87	96%	60	1.02%
CBMH11	0.247	0.89	99%	44	1.17%
CBMH12	0.323	0.87	96%	60	1.33%
CBMH13	0.229	0.78	83%	55	1.54%
CB14	0.133	0.90	100%	78	1.05%
CBMH15	0.079	0.90	100%	29	0.65%
BLDG	0.786	0.90	100%	138	1.50%

5.1 Model Calibration (July 19th, 2013 Storm Event)

The existing conditions model was calibrated using rainfall data from the July 19th, 2013 storm event collected by the Walter Baker City of Ottawa Rain Gauge. Rainfall intensities for this storm event are shown in **Figure 5**.

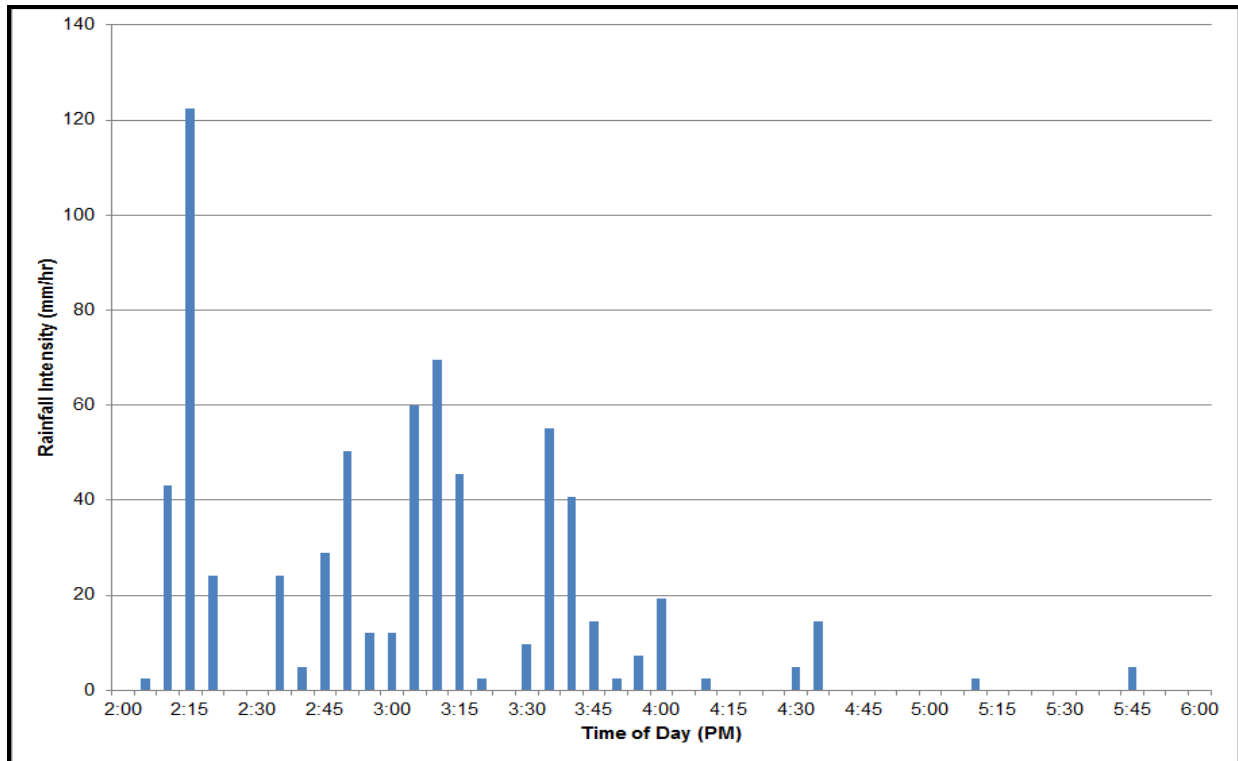


Figure 5: Rainfall Intensity (mm/hr) - July 19th, 2013 Event (Walter Baker Rain Gauge)

The July 19th, 2013 storm event had a peak intensity of 122 mm/hr and produced 56.6mm of rainfall at the Walter Baker rain gauge over approximately four (4) hours. This storm event can be categorized between a 1:5 year and 1:10 year return period.

Calibration of the existing conditions model was based on the observed extent of surface ponding following this event. The following photo (**Figure 6**) was taken at approximately 4:00pm on July 19th, 2013 from the car wash at the Canadian Tire Gas Bar. Through discussions with Canadian Tire Staff, this event resulted in approximately 15 - 20mm of water ponding in the parking lot for roughly 6 - 8 hours.



Figure 6: Extent of Flooding on July 19th, 2013

Using the July 19th, 2013 rainfall data, the model parameters were adjusted to produce ponding depths generally consistent with what is shown in **Figure 6**. It should be noted that the model reports a significantly shorter duration of ponding, which may be a result of an obstruction in one or more of the storm sewer inlets or outlets, or due to elevated water levels in the outlet storm sewers on Greenbank Road.


5.2 Model Results (Existing Conditions)

Following calibration of the existing conditions model, the performance of the existing Canadian Tire storm drainage system was evaluated using a range of synthetic design storms and historical storm events. The model results confirm that the storm sewer system is undersized and that portions of the site will experience surface flooding during relatively minor storm events. Ponding depths over each catchbasin (existing conditions) for the various storm events and distributions are summarized in Tables D1 – D3 in **Appendix D**. The extent of ponding under existing and proposed conditions for the 100-year storm event is shown on **Figure 7**.

The main Canadian Tire parking lot (CBMHs 10-13) is expected to experience approximately 0.14m of ponding overtop of the catchbasins during a 2-year storm event. The depth of ponding increases to 0.30m during a 100-year storm event, which is the maximum amount of ponding allowed for safe passage, as per the City of Ottawa Sewer Design Guidelines (October, 2012). When the system was stress tested by increasing 100-year peak flows and rainfall volumes by 20% there is 0.34m of ponding in the parking lot.

The catchbasin at the Gas Bar entrance from Greenbank Road (CBMH 6) experiences frequent flooding and greater ponding depths for a given storm event when compared with the main parking lot.

M:\2013\113186\CADD\design\113189-SWM.dwg - PONDING, May 20, 2014 - 12:55pm, cstabg

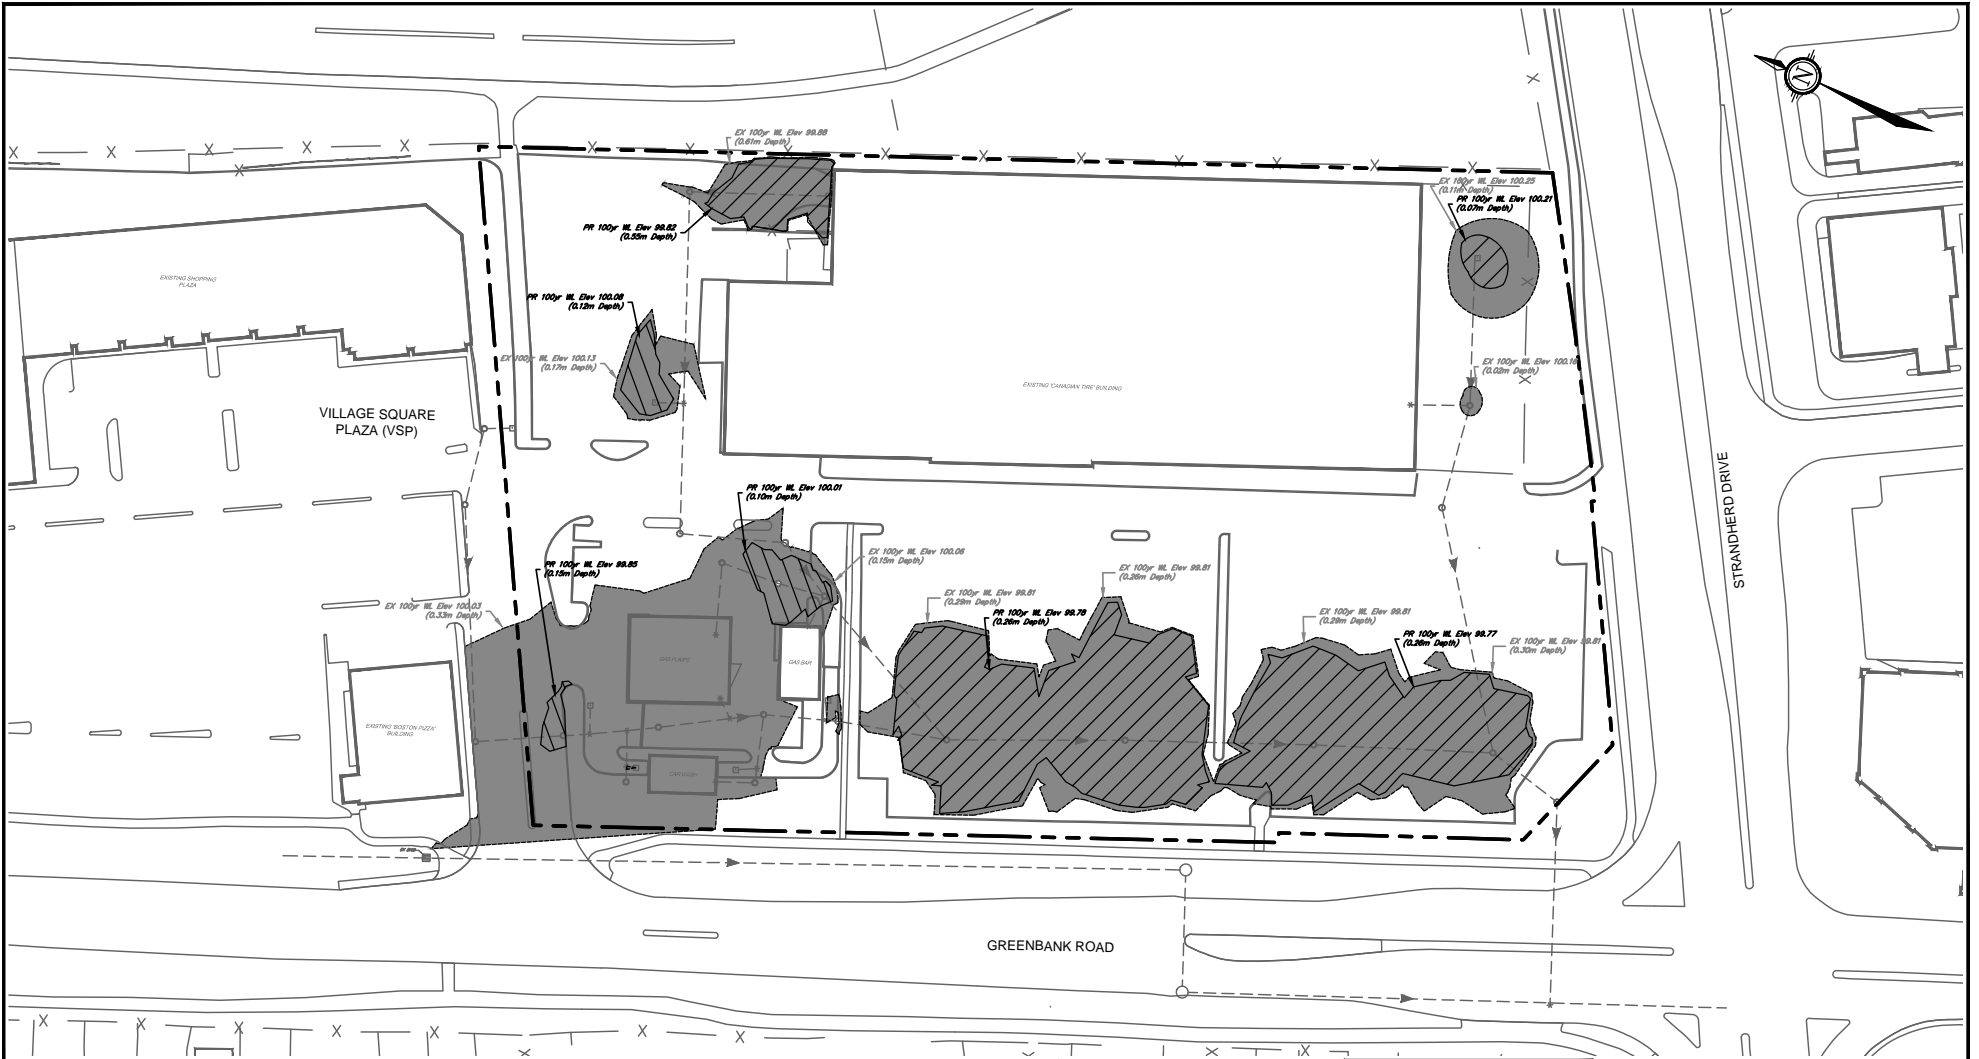

LEGEND

- >--- EXISTING STORM SEWER WITH FLOW DIRECTION
- ⊕ EXISTING CATCH BASIN MANHOLE
- EXISTING MANHOLE
- EXISTING CATCH BASIN
- EXISTING CURB
- PROPERTY LINE
- 100-YEAR PONDING LIMITS (EXISTING)
- ▨ 100-YEAR PONDING LIMITS (PROPOSED)

NOVATECH
ENGINEERING
CONSULTANTS LTD.
 ENGINEERS & PLANNERS
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada
 K2M 1P6
 Telephone (613) 254-9643
 Facsimile (613) 254-5867
 Email: novainfo@novatech-eng.com

SCALE

1:1000

1:1000

0 10 20 30 40

CANADIAN TIRE
 BARRHAVEN
 EXISTING AND PROPOSED
 100-YEAR PONDING LIMITS

MAY 2014 113199 FIGURE 7

5.3 Identification of the Primary Causes of Flooding

The frequent surface flooding in the vicinity of the Gas Bar (CBMH 6) is due to several factors: The storm sewers in the vicinity of the gas bar were intended to surcharge to the ground surface. Storm runoff would be routed through the on-site sewers and back out onto the parking lot surface through the grates of the catchbasin manholes in the main parking lot (CBMH10-13). However, the original design report did not evaluate the hydraulics of the system. A review of the existing storm sewer system revealed significant deficiencies in both the size and configuration of the storm sewers connecting the gas bar to the main parking lot, which prevents the system from operating as intended.

Storm sewers are typically designed to convey the 5-year post-development peak flows. Based on current City of Ottawa Standards, almost all of the on-site storm sewers are significantly undersized (refer to the storm sewer design sheets provided in **Appendix B**). While this may have been intentional (the storm system was intended to be restricted by the orifice in MH16 and to back up onto the surface through the grates of the catchbasins in the main parking lot), the ability of the sewers to internally convey runoff between the gas bar and the main parking lot was overlooked.

This issue is compounded by the additional runoff from the Village Square Plaza parking lot and Greenbank Road that was not accounted for in the original design, resulting in a larger volume of runoff entering the Canadian Tire site than was originally intended. There is also no defined major system (overland flow) outlet for the site, so the depth of water in the parking lots can exceed 0.30m during larger storm events.

6.0 PROPOSED SWM IMPROVEMENTS

The proposed improvements to the existing storm drainage system include:

- 1) The installation of a new 600mm storm sewer along the western boundary of the site to supplement the conveyance capacity of the existing storm sewer network connecting the gas bar and the main parking lot.
- 2) The installation of an underground storage system beneath the main parking lot consisting of two (2) rows of StormTech MC-3500 (or approved equivalent) infiltration chambers.
- 3) The installation of a check valve at the storm outlet to prevent inflows from the off-site storm sewers into the proposed underground storage system.

The proposed underground storage system (Drawing 113199-STM) represents a balance between cost and level of service. This configuration provides sufficient underground storage for runoff from a 5-year event (approx. 500 m³). Runoff from larger storms will exceed the available underground storage and begin to accumulate on the parking lot surface as per the original design intent.

6.1 Model Results (Proposed Improvements)

The model results indicate that the proposed works will significantly improve the capacity of the internal storm drainage network and reduce the frequency of surface flooding on the site. There will be no ponding in the main parking area during the 5-year storm event. The extent of ponding during the 100-year storm event (maximum depth of approximately 0.26 m) is shown on **Figure 7**.

6.2 Design Details

Infiltration Chambers

The proposed infiltration chambers (StormTech MC-3500) have been designed to provide the as much storage as possible while maintaining adequate clearance from the granular material in the parking lot. Details and design specifications are shown on Drawings 113199-STM and 113199-ND:

1. Provide a 300mm (minimum) clearstone base (50mm dia. D_{50}) and 150mm perforated subdrain pipe beneath the infiltration chambers.
2. Backfill the space surrounding the infiltration chambers with clean, crushed angular stone (19mm – 51mm) to a minimum depth of 305mm above the infiltration chambers
3. A non-woven geotextile (ADS 601 or approved equivalent) is to be wrapped around the perimeter of the stone fill to prevent soil movement into the storage area.
4. Provide a minimum 610mm of clearance from the top of the infiltration chambers to the base of asphalt.
5. The bottom of the first row of the storage chambers is to be underlain with a geotextile liner or flooring to allow for flushing of accumulated sediment.

Supporting calculations for the StormTech MC-3500 infiltration chambers are provided in **Appendix E**. Approved equivalent infiltration chambers can be specified, provided they meet the following standards:

1. The chambers must meet the requirements of CSA B184.0-11, “General Requirements and Methods of Testing for Polymeric Subsurface Stormwater Management Structures”
2. The chambers must meet the requirements of CBSA B184.2-11 for “Polypropylene (PP) Chambers”

600mm Storm Sewer

The proposed 600mm storm sewer from the south entrance from Greenbank Road to the infiltration chambers will alleviate the flooding at the south entrance, which will prevent the car wash from flooding during frequent events. The installation of this storm sewer will be within the property limits for the existing Canadian Tire, but will require the removal and installation of vegetation such as trees and bushes as shown on the Drawing 113199-TCP.

Check Valve

A check valve (flap gate) is to be installed on the 300mm pipe entering MH16 to prevent flows from the off-site storm sewers from entering the underground storage chambers.

Utilities

The location of existing utilities shown on the Drawing 113199-STM is based on the available design drawings. While there are no apparent conflicts based on the current layout, utility locates are to be performed in advance of construction. If any conflicts with existing utilities are identified, the layout of the proposed storm sewers and infiltration chambers will be adjusted accordingly.

Landscaping

The proposed 600mm storm sewer will be routed along the western property limit parallel to Greenbank Road in order to minimize disruption to the Gas Bar and carwash. The proposed sewer will require the removal of existing trees and shrubs along the property line.

The proposed landscaping plan (Drawing 113199-L) replaces the vegetation that will be removed during construction with vegetation of equivalent size. All large trees will be placed at least 1.5m from the proposed storm sewer.

Construction

A pre-construction meeting will be held with representatives from Keller Engineering, Novatech Engineering, and the contractor to go over the installation procedure. It is anticipated that construction will take approximately two (2) to three (3) weeks to complete.

7.0 WATER QUALITY

The Canadian Tire storm sewers are tributary to the Kennedy-Burnett Stormwater Management Facility, which provides water quality treatment before outletting into the Jock River. For the Gas Bar, two (2) existing stormceptors (STC-750) have been installed to capture any spillage from the gas pumps before outletting into the storm sewer system.

8.0 EMERGENCY OVERLAND DRAINAGE

The main Canadian Tire parking lot does not have a defined overland drainage route. The lowest spill elevation is along the west side of the site and is approximately 0.50m higher than the elevations of the catchbasins within the parking lot. The lowest point of the Canadian Tire building is the entrance to the garage, which is 0.80m higher than the elevations of the catchbasin within the parking lot.

The overland flow route for the Gas Bar is via Greenbank Road, which is sloped south to Strandherd Drive and eventually the Kennedy Burnett Stormwater Management Facility.

9.0 GEOTECHNICAL INVESTIGATION

The following geotechnical reports, provided in **Appendix A**, were reviewed to determine the soil type, depth of bedrock and groundwater elevations.

1. Geotechnical Investigation, Proposed Commercial Development, 1581 Greenbank Road (i.e. Village Square Plaza Expansion), Ottawa, Ontario
Golder and Associates, December 2009 – Report Number 09-1121-1036
2. Geotechnical Investigation – Canadian Tire Real Estate Limited, Proposed Store #442 Barrhaven, Ontario
Jacques, Whitford & Associates Limited, January 31, 2000

Based on the geotechnical report (Golder and Associates) for the expansion to Village Square Plaza, the soil type between 0.5 and 3.5m below grade is on average sandy silt (glacial till), which has a low hydraulic conductivity (10^{-7} m/s) and percolation rate (25mm/hr). Bedrock elevations were observed to be below 3.5m.

The geotechnical report (Jaques Whitford & Associates) for the Canadian Tire was completed before the building and parking lot were built. In general, the underlying soil was predominantly glacial till (consisting of a heterogeneous mixture of silt, sand and gravel) with layers of silty clay. Bedrock in the location of the proposed works is on average 3m from the ground surface with no groundwater levels observed in the boreholes.

10.0 EROSION & SEDIMENT CONTROL REQUIREMENTS

The erosion and sediment control requirements that will be implemented during construction are as follows.

Temporary and permanent erosion and sediment control measures are to be implemented prior to, during and after construction; and should be inspected regularly.

To prevent surface erosion, sediment and debris from entering the storm system during construction, the following erosion and sediment control measures should be implemented during construction in accordance with the “Guidelines on Erosion and Sediment Control for Urban Construction Sites” (Government of Ontario, May 1987):

- Filter socks (i.e. Filtrexx or approved equivalent) should be placed around the grates of all area drains and remain in place until the asphalt has been reestablished and construction is complete;
- Street sweeping and cleaning should be performed on all roads adjacent to active construction on a regular basis; and,
- Stockpiles should not be located overtop of maintenance holes, storm inlets or utility accesses. Stockpile locations should not block any overland drainage paths.

Permanent erosion and sediment control measures will consist of re-establishing the asphalt and re-planting all disturbed vegetation areas.

11.0 CONCLUSIONS AND RECOMMENDATIONS

This report provides an overview of the existing storm drainage system and identifies the probable causes for the existing flooding issues at the Canadian Tire in Barrhaven (Ottawa), Ontario. The proposed modifications to the existing system will improve the capacity of the on-site sewers and provide additional underground storage.

Existing Conditions

- The existing design did not account for the conveyance of stormwater (i.e. hydraulics) within the site, as such the storm sewers are undersized to convey peak flows to the main parking lot for storage.
- The main parking lot has been sized to provide sufficient surface storage.
- Ponding in the parking lot experienced during storm events equal to or greater than the 2-year storm event prevents stormwater from being conveyed from the south entrance from Greenbank Road; therefore, significant ponding occurs at the south entrance from Greenbank Road.

- The Hydraulic Grade Line in the 600mm storm sewer along Greenbank Road prevents the site from draining during storm events greater than the 2-year storm event, which causes backflows into the Canadian Tire storm sewer system.

Proposed Modifications

- Improve the conveyance capacity of the on-site storm sewers by installing a new 600mm pipe from the Gas Bar entrance to the underground storage system.
- Provide underground storage chambers (i.e. StormTech MC-3500 or approved equivalent) beneath the parking lot to store the 5-year storm event underground.

NOVATECH ENGINEERING CONSULTANTS LTD.

Prepared by:

Reviewed by:




Conrad Stang, M.A.Sc., P.Eng.
Water Resources Engineer



Michael Petepiece, P.Eng.
Project Manager

DRAWINGS




TOPOGRAPHIC INFORMATION & BENCHMARK

SURVEY COMPLETED BY ANNS O'SULLIVAN, VOLLEBECK LTD. ON NOVEMBER 9TH 2022. ELEVATIONS SHOWN ARE GEODETIC AND ARE REFERRED TO THE CANADIAN GEODETIC DATUM DERIVED FROM CONTROL MONUMENT NO. 51930071 HAVING AN ELEVATION OF 99.742m.

LEGEND:

- — — — — EXISTING PROPERTY LINE
- W — W — EXISTING WATERMAIN
- V — V — EXISTING V&VB
- F — F — EXISTING FIRE HYDRANT
- C — C — EXISTING CATCH BASIN
- S — S — EXISTING SANITARY SEWER AND MAINTENANCE HOLE
- ST — ST — EXISTING STORM SEWER AND MAINTENANCE HOLE
- ST — ST — PROPOSED STORM SEWER AND MAINTENANCE HOLE
- O — O — PROPOSED REAR YARD CATCH BASIN
- DC — DC — PROPOSED CENTERLINE SWALE WITH SUBDRAIN 150mmØ
- — — — — PROPOSED DEPRESSED CONCRETE CURB
- — — — — PROPOSED BUILDING ADDITION OUTLINE
- S — S — SILT SACK PER DETAIL D1

- ### NOTES-SEWER
- CONTRACTOR TO CONFIRM ELEVATION OF EXISTING STORM AND SANITARY SEWERS AT PROPOSED CONNECTION POINTS AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE COMMENCING ANY WORK.
 - ALL WORK SHALL BE PERFORMED AS APPLICABLE IN ACCORDANCE WITH OPSS 407 AND 410. PIPE MATERIAL TO BE PVC 80S-SI AND CONFORMING TO OPSS 344 UNLESS INDICATED OTHERWISE. PVC SEWERS TO BE INSTALLED PER OPSS 402 (S) (MODIFIED), BEDDING AND COVER MATERIALS TO BE OPSS 1010 GRANULAR + CRUSHED-RUBBER LIMESTONE BEDDING COMPACTED TO 95% SPREAD.
 - ALL SEWERS WITH LESS THAN 1.5 METERS OF COVER ARE SUBJECT TO INSULATION. PIPE BACKFILL MATERIAL TO BE APPROVED NATIVE MATERIAL OR SELECTED SUBGRADE MATERIAL IN CONFORMANCE WITH OPSS 272.
 - ALL MAINTENANCE HOLES AND CATCH BASIN MAINTENANCE HOLES TO BE 1000mm AS PER OPSS 701 UNLESS INDICATED OTHERWISE. MAINTENANCE HOLES AND CATCH BASIN MAINTENANCE HOLES TO BE INSTALLED PER OPSS 407.
 - ALL CATCH BASINS TO BE 600mmØ AS PER OPSS 705-710, UNLESS INDICATED OTHERWISE. CATCH BASINS TO BE INSTALLED PER OPSS 407.
 - EXCAVATING, BACKFILLING AND COMPACTING REQUIRED FOR MAINTENANCE HOLES. CATCH BASIN MAINTENANCE HOLES AND CATCH BASINS TO BE COMPLETED AS PER OPSS 407. THEY ARE TO BE BACKFILLED WITH OPSS GRANULAR + CRUSHED-RUBBER LIMESTONE BEDDING BETWEEN SECTIONS TO BE WRAPPED WITH NONWOVEN GEOTEXTILE.
 - FOR STORM STRUCTURES: CAST IRON CATCH BASIN MAINTENANCE HOLE COVER AS PER OPSS 401 (S) TYRE 'B' AND CAST IRON CATCH BASIN COVER AS PER OPSS 402 (S). THE CONTRACTOR IS RESPONSIBLE FOR MAKING OR BRANDED ALL CONNECTIONS TO THE EXISTING SEWERS AS PER MUNICIPAL REQUIREMENTS. PRIOR TO CONNECTION, THE CONTRACTOR MUST PROVIDE TO THE CONSULTANT (ENGINEER) AND THE CITY OR APPROVAL, ALL TEST RESULTS PERFORMED ON THE INTERNAL SERVICES ABOVE THE CITY PUBLIC WORKS AT LEAST 10 HOURS IN ADVANCE BEFORE ANY CONNECTION TO THE TOWN SERVICES. CO-ORDINATE WITH TOWN AS REQUIRED.
 - TERMINATE AND PLUS ALL SERVICE CONNECTIONS AT 1.5m FROM EDGE OF THE BUILDING.
 - ALL SEWERS TO BE C.C.T.V. INSPECTED BY THE CONTRACTOR AS PER OPSS 409. TWO COPIES OF THE INSPECTION REPORT MUST BE PROVIDED TO THE CONSULTANT AND THE C.C.T.V. INSPECTION IN DVD FORMAT ONLY.
 - SUBDRAIN (WOODSTOCK) (W) WILL BE PRE-MANUFACTURED WITH CATCH BASINS AND MAINTENANCE HOLES.
 - EXISTING STORMTECH CHAMBERS LOCATED ON THE SOUTH WEST END OF THE PARKING LOT, PARALLEL TO GREENBANK (SEE PLAN C102), TO BE KEPT AND PROTECT. FREE OF ANY CONSTRUCTION DEBRIS OR ANY OTHER DAMAGES DURING CONSTRUCTION.

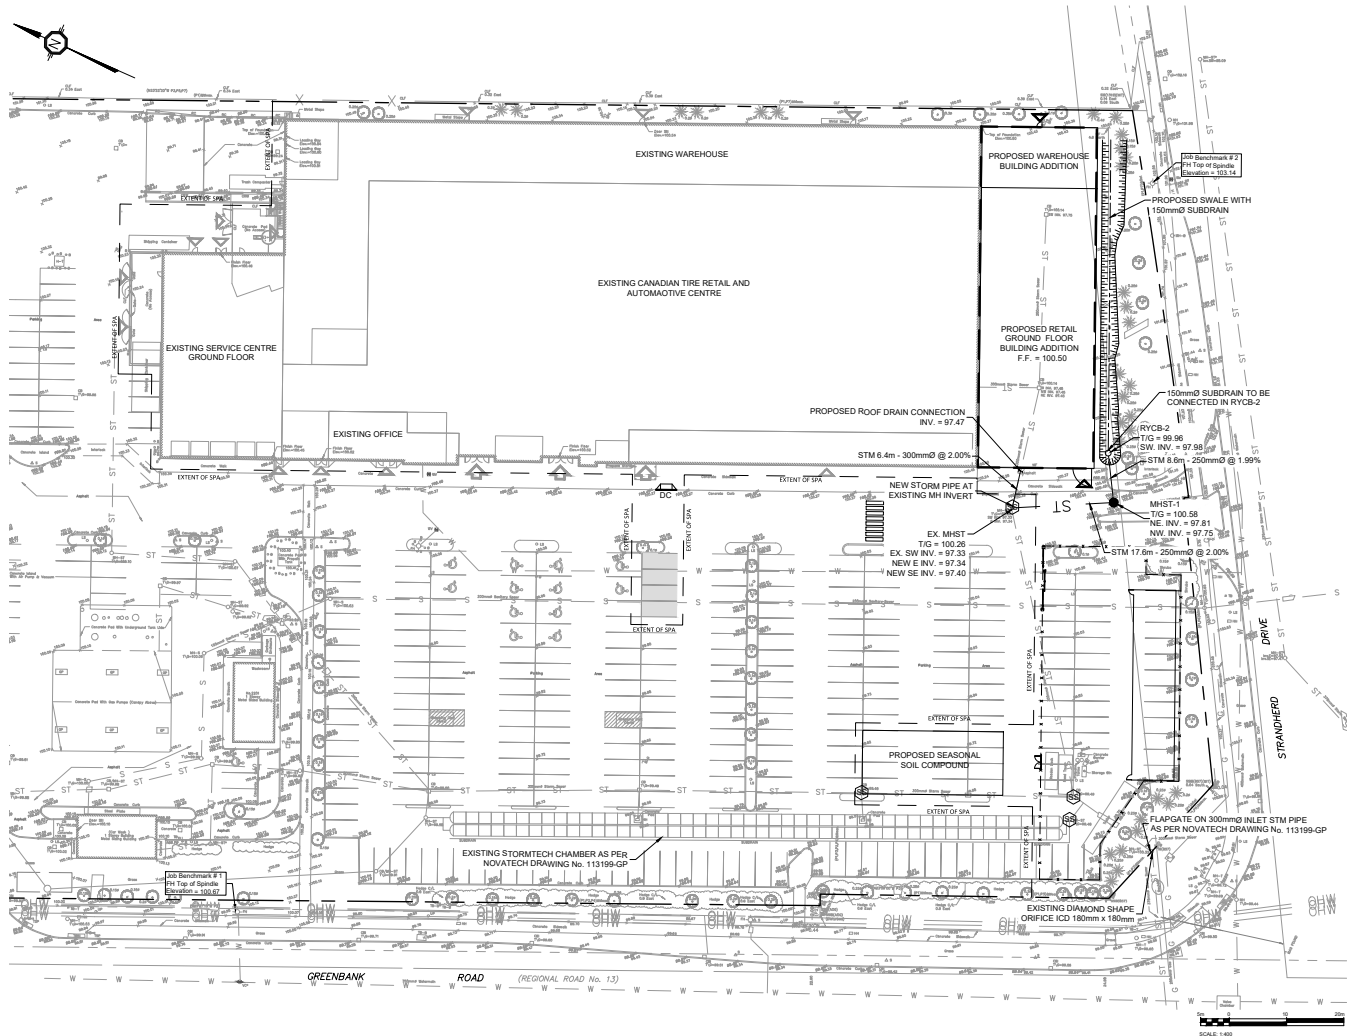

EROSION AND SEDIMENT CONTROL MEASURES:

- CONTRACTOR IS RESPONSIBLE FOR ALL INSTALLATION, MONITORING, REPAIR AND REMOVAL OF ALL EROSION AND SEDIMENT CONTROL FEATURES. THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE. DURING CONSTRUCTION ACTIVITIES THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- SEDIMENT AND EROSION CONTROL PLAN OBJECTIVES:
 - PREVENT SOIL EROSION: THIS CAN RESULT FROM STREAMING RUN WATER OR WIND EROSION DURING CONSTRUCTION.
 - PREVENT SEDIMENT DEPOSITS IN THE SEWER PIPES AND NEARBY COLLECTING STREAMS (AS APPLICABLE).
 - PREVENT AIR POLLUTION FROM PARTICULATE MATTER AND DUST.
- PRIOR TO START OF CONSTRUCTION:**
 - BEFORE THE REMOVAL OF ANY VEGETATIVE COVER, MOVING OF SOIL, AND CONSTRUCTION:
 - INSTALL SILT FENCE (AS PER OPSS 219.110) ALONG OTCHES IMMEDIATELY DOWNSTREAM FROM AREAS TO BE DISTURBED.
 - INSTALL TEN CLOTH ON DOWNSTREAM MANHOLE COVERS.
 - INSTALL SILT TRACK FILTERS IN ALL CONCRETE CATCH BASIN STRUCTURES.
 - INSPECT MEASURES IMMEDIATELY AFTER INSTALLATION.
 - THE CONTRACTOR MUST SET UP THE MEASURES INDICATED ON THE PLAN, INSPECT THEM FREQUENTLY AND CLEAN AND REPAIR OR REPLACE THE DETERIORATED STRUCTURES. AT THE END OF THE CONSTRUCTION PERIOD, THE CONTRACTOR IS RESPONSIBLE FOR REMOVAL OF THE TEMPORARY STRUCTURES AND RECONSTRUCTION OF THE AFFECTED AREAS.


2. DURING CONSTRUCTION:

- SEDIMENT AND EROSION CONTROL MEASURES TO BE CONSTRUCTED AS PER OPSS 815.
- WHEN SEDIMENT AND EROSION CONTROL MEASURES MUST BE REMOVED TO COMPLETE A PORTION OF THE WORK, THE SAME MEASURES MUST BE REINSTALLED UPON THE WORK'S COMPLETION.
- WORK TO BE DONE IN THE VICINITY OF MAJOR WATERWAYS TO BE CARRIED OUT FROM JULY AND SEPTEMBER ONLY.
- MINIMIZE THE EXTENT OF DISTURBED AREAS AND THE DURATION OF EXPOSURE.
- PROTECT DISTURBED AREAS FROM RAINFALL.
- PROVIDE TEMPORARY COVER SUCH AS SEEDING OR MULCHING IF DISTURBED AREA WILL NOT BE REHABILITATED SHORTLY.
- INSPECT STRAW BALE FLOW CHECK DAMS, SILT FENCES, SILT SACKS, AND CATCH BASIN STAMPS REGULARLY AND AFTER EVERY MAJOR STORM. CLEAN AND REPAIR WHEN NECESSARY.
- PLAN TO BE REVIEWED AND REVISED AS REQUIRED DURING CONSTRUCTION.
- EROSION CONTROL FENCING TO BE INSTALLED AROUND THE BASES OF ALL STOCKPILES.
- DO NOT LOCATE TOPSOIL PILES AND EXCAVATION MATERIAL CLOSER THAN 25m FROM ANY PAVED SURFACE, OR ONE METRE IS TO BE PAVED BEFORE THE PILE IS REMOVED. ALL TOPSOIL PILES ARE TO BE SEEDED IF THEY ARE TO REMAIN ON SITE LONG ENOUGH FOR SEEDS TO GROW (LONGER THAN 30 DAYS). WHEN STORING SOIL ON SITE PILES THE CONTRACTOR MUST COVER EACH PILE WITH TARP, STRAW OR A GEOTEXTILE FABRIC TO AVOID FINE PARTICLE TRANSPORT BY WIND AND/OR STREAMING RUN WATER.
- CONTROL WINDBLOWN DUST OFF SITE TO ACCEPTABLE LEVELS BY SEEDING TOPSOIL PILES AND OTHER AREAS TEMPORARILY PROVIDE WATERING AS REQUIRED.
- CONTRACTOR TO APPLY CALCIUM CHLORIDE (TYPE I - OPSS 2201 AND CANCOS8-15-1) AND WATER WITH EQUIPMENT APPROVED BY THE OWNER'S REPRESENTATIVE AT RATE IN:

3. AFTER CONSTRUCTION:

- PROVIDE PERMANENT COVER CONSISTING OF TOPSOIL AND SEED TO DISTURBED AREAS.
- ALL SEDIMENT AND EROSION CONTROL MEASURES TO BE REMOVED BY THE CONTRACTOR FOLLOWING THE COMPLETION OF WORK AND AFTER DISTURBED AREAS HAVE BEEN REHABILITATED AND STABILIZED. THIS INCLUDES REMOVE STRAW BALE FLOW CHECK DAMS, SILT FENCES AND PLER CLOTH ON CATCH BASINS AND MANHOLE COVERS.
- INSPECT AND CLEAN CATCH BASIN SLUMPS AND STORM SEWERS.
- ACCORDANCE TO OPSS 508 WHEN DIRECTED BY OWNER'S REPRESENTATIVE.
- ALL EROSION CONTROL STRUCTURE TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN STABILIZED EITHER BY PLANTING OR RESTORATION OF VEGETATIVE GROUND COVER. SEDIMENT CAPTURE SILT SACKS MUST BE MAINTAINED AND CANNOT BE REMOVED UNTIL ALL LANDSCAPING AREAS ARE COMPLETED.
- NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVES BY THIS CONSULTING ENGINEER AND THE TOWN DEPARTMENT OF PUBLIC WORKS.
- CONTRACTOR RESPONSIBLE FOR MUNICIPAL ROADWAY AND SIDEWALK TO BE CLEANED OF ALL SEGMENT FROM VEHICULAR TRACKS ETC. AT THE END OF EACH WORK DAY.
- DURING WET CONDITIONS, TIRES OF ALL VEHICLES/EQUIPMENT LEAVING THE SITE ARE TO BE SCRAMFED.
- ANY MULTIMATERIAL TRACKED ONTO THE ROAD SHALL BE REMOVED IMMEDIATELY BY HAND OR RUBBER TIRE CLEANER.
- TAKE ALL NECESSARY STEPS TO PREVENT BUILDING MATERIAL, CONSTRUCTION DEBRIS OR WASTE (BAGS SPILLED) OR TRACKED ALONGSIDE OR INTO PUBLIC STREETS DURING CONSTRUCTION AND PROCEED IMMEDIATELY TO CLEAN UP ANY AREAS SO AFFECTED.
- CONTRACTOR TO PROVIDE ENTRANCE WASHERS TO LEAVE THE SITE TO PROVIDE MUD TRACKING ONTO PAVED SURFACES. GRAVEL BED SHALL BE A MINIMUM OF 100 LIMS 40r WIDE, AND 3.16r DEEP AND SHALL CONSIST OF COARSE MATERIAL. MAINTAIN GRAVEL ENTRANCE IN CLEAN CONDITION.

STORM SEWER STRUCTURE TABLE					
STRUCTURE No.	STRUCTURE DETAILS	ELEVATIONS (m)	NORTHING	EASTING	
MHST-1	CONCRETE MANHOLE 1200mm ØPSD 701.010	1/6 = 100.58 T/G = 97.81 N.W. INV = 97.75	5014866.96	363999.18	
RYCB-2	RYCB 375mm CITY OF OTTAWA 531	1/6 = 99.96 INV SW = 97.98	5014871.28	364006.61	
EX. MHST	EXISTING STRUCTURE	EX 1/6 = 100.28 EX INV SW = 97.33 NEW INV E = 97.34 NEW INV SE = 97.40	5014882.64	363991.18	





PROJECT: 2801 GREENBANK RD
 CANADIAN TIRE STORE EXPANSION
 HARRHAVEN, ONTARIO

SITE SERVICING & EROSION/SEDIMENT CONTROL PLAN

PROJECT NO: 418461
 PROJECT DATE: 2022-09-23
 DRAWN BY: [Signature]
 CHECKED BY: [Signature]
 DATE: [Signature]
 SCALE: As indicated

DRAWING NO: C102 REV: 1

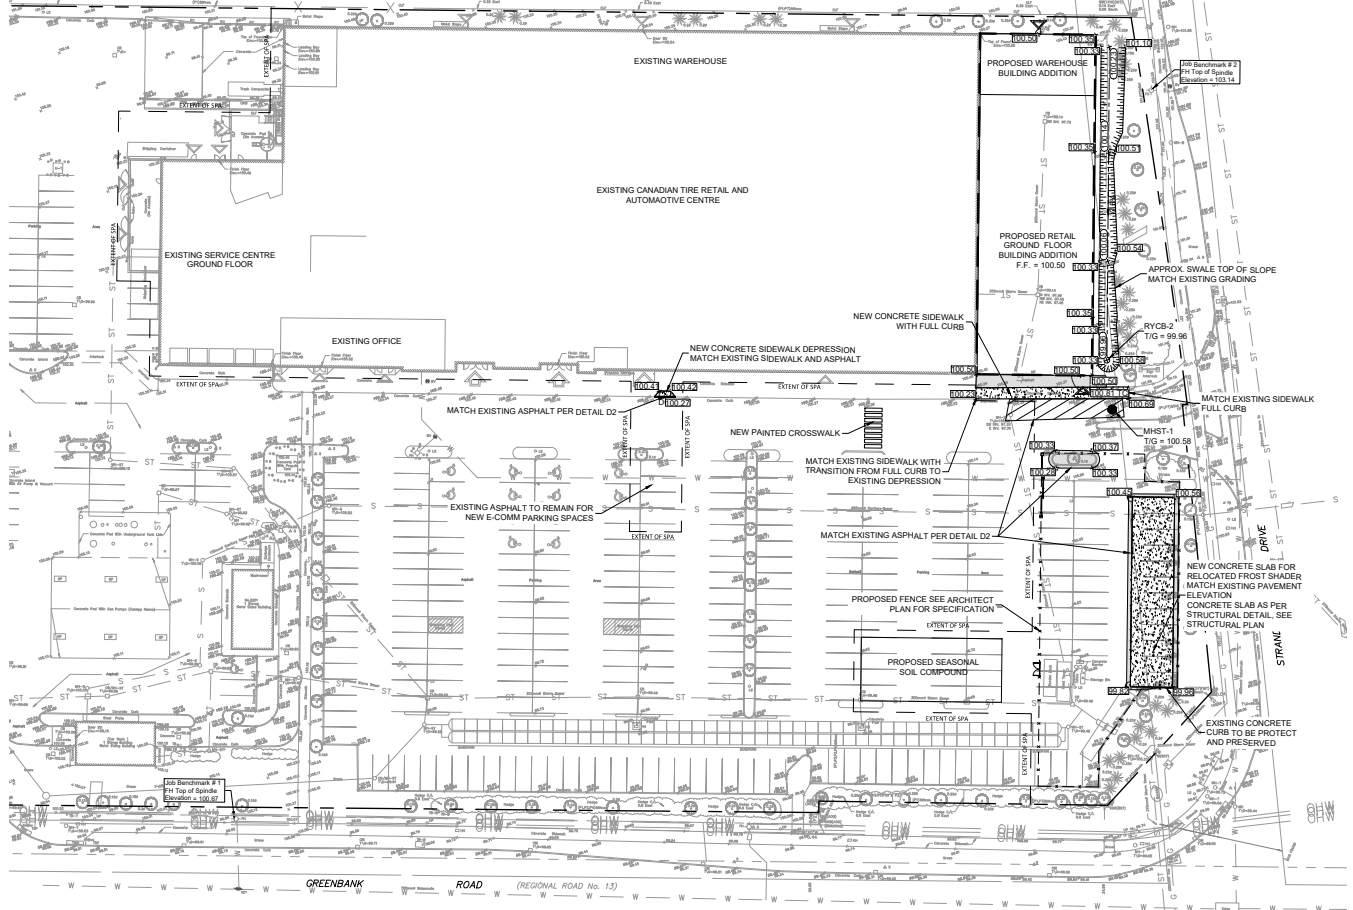

LEGEND:

- EXISTING PROPERTY LINE
- TERRACE (3:1 MAX)
- PROPOSED CENTERLINE SWALE WITH SUBDRAIN 150mmØ
- EXISTING GRADE
- PROPOSED GRADE
- PROPOSED SWALE TOP OF CURB
- PROPOSED GRADE CENTERLINE SWALE
- PROPOSED SLOPE DIRECTION AND PERCENTAGE
- PROPOSED LIGHT DUTY PAVEMENT
- PROPOSED HEAVY DUTY PAVEMENT
- PROPOSED CONCRETE SIDEWALK
- PROPOSED BUILDING ADDITION OUTLINE
- PROPOSED FENCE SEE ARCHITECT PLAN

TURNER FLEISCHER

Turner Fleischer Architects Inc.
67 Laurel Road
Toronto, ON M6S 1T1
Tel: 416-425-2222
turnerfleischer.com

THIS DRAWING IS AN INSTRUMENT OF SERVICE. IT IS PROVIDED AS IS AND IS THE PROPERTY OF TURNER FLEISCHER ARCHITECTS INC. (TFI). IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF TFI. THE USER OF THIS DRAWING AGREES TO HOLD TFI HARMLESS FROM AND AGAINST ALL CLAIMS, DAMAGES, LOSSES, AND EXPENSES, INCLUDING REASONABLE ATTORNEY'S FEES, ARISING OUT OF OR FROM THE USE OF THIS DRAWING, WHETHER SUCH CLAIMS, DAMAGES, LOSSES, AND EXPENSES ARE CAUSED IN WHOLE OR IN PART BY NEGLIGENCE OR OTHERWISE. THIS AGREEMENT SHALL APPLY TO ALL REVISIONS AND ADDENDUMS TO THIS DRAWING.

FOR A FULL LIST OF PROJECTS, VISIT www.turnerfleischer.com



KEY PLAN
N.T.B.

PARSONS

100 MIDLAND STREET, SUITE 400, OTTAWA, ONTARIO, K1P 1B7
Tel: 613-738-4100 Fax: 613-738-7100

TOPOGRAPHIC INFORMATION & BENCHMARK

SURVEY COMPLETED BY ANNS OSULLIVAN, VOLLEBECK LTD. ON NOVEMBER 9TH 2022. ELEVATIONS SHOWN ARE GEODETIC AND ARE REFERRED TO THE COGSD GEODETIC DATUM DERIVED FROM CONTROL MONUMENT NO. 519850071 HAVING AN ELEVATION OF 99.742m.

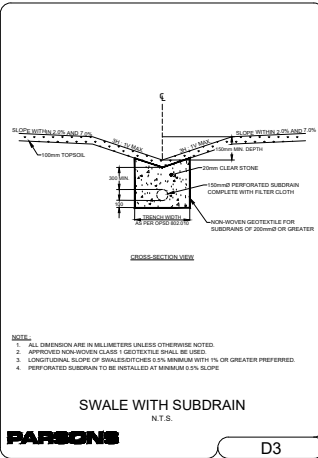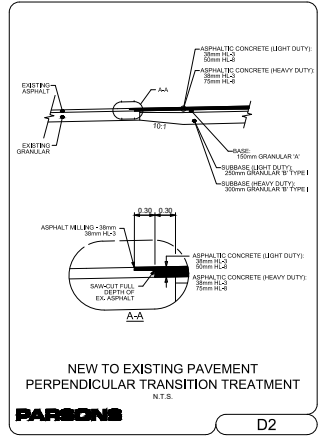

PAVEMENT STRUCTURES

MATERIAL	LIGHT DUTY	HEAVY DUTY	COMPACTION
Asphaltic Concrete Surface Course: HL3	38 mm	38 mm	≥ 97%
Asphaltic Concrete Binder Course: HL8	50 mm	75 mm	≥ 97%
Granular Base: OPSS 1010 Granular A (crushed limestone)	150 mm	150 mm	100%
Granular Sub-base: OPSS 1010 Granular B, Type I	250 mm	300 mm	100%

FROM: GEOTECHNICAL INVESTIGATION, PROPOSED BUILDING STORE #442, GREENBANK ROAD, NEPEAN, ONTARIO, BY JACQUES WHITFORD LIMITED, DATED JANUARY 31, 2020.
*MINIMUM PAVEMENT COMPACTION BASED ON MARSHALL BULK DENSITY TEST
**BASED ON STANDARD PROCTOR MAXIMUM DRY DENSITY (SPMDD)

PROJECT: 2801 GREENBANK RD CANADIAN TIRE STORE EXPANSION BARRHAVEN, ONTARIO

PROJECT NO: 2104641
PROJECT DATE: 2022-09-23
DESIGNED BY: [Signature]
CHECKED BY: [Signature]
SCALE: As indicated

HARRHAVEN
STORE No. 442

GRADING PLAN

PROJECT NO: 2104641
PROJECT DATE: 2022-09-23
DESIGNED BY: [Signature]
CHECKED BY: [Signature]
SCALE: As indicated

SWALE WITH SUBDRAIN
N.T.S.

PARSONS

D3

DRAWING NO: C103
REV: 1

