

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



Project No.: CCO-21-3339-01

Prepared for:

Nupur Chakravorty, OAA, LEED AP BD+C, B.Arch.
Senior Project Manager
City of Ottawa

Prepared by:

McIntosh Perry Consulting Engineers Ltd.
115 Walgreen Road
Carp, Ontario
K0A 1L0

Original: March 9, 2022

Revision 1: August 2, 2022

Revision 2: April 25, 2023

Revision 3: June 9, 2023

Revision 4: July 5, 2023

McIntosh Perry ('MP') was retained by the City of Ottawa ('the Client') to conduct a Scoped Hydrogeological Assessment and Terrain Analysis in support the City of Ottawa Site Plan Approval (SPA) process for the construction of an addition to the Corkery Community Centre, located at 3447 Old Almonte Road, Ottawa, Ontario (collectively referred to as 'the Site').

This report has been prepared using data collected from an existing water supply well at Community Centre at 3447 Old Almonte Road, Ottawa, ON (Test Well 1) by McIntosh Perry staff on February 3, 2022. An additional well at the Ottawa Fire Station 84 (Test Well 2) located immediately west of the Site (3449 Old Almonte Road) was tested for water quality, as per the City of Ottawa guidance. Hydrogeological data from these wells are considered representative of the Site.

Ground surface at the Site is relatively flat, with a large portion of the site having a very gentle slope towards the east. Site elevation ranges from approximately 156 - 160 metres above sea level (m asl). Surface drainage is interpreted to reflect surface topography and is likely controlled via permeable areas and ditches along the roadway. Based on public mapping, the site represents a triple divide point between three local subwatersheds, with a larger portion of site draining to the south and east towards Huntley Creek (Carp River), and the remaining portions to the north and east to Corkery Creek (Carp River), and to the east towards Cody Creek (Mississippi River). Given this, shallow groundwater flow direction in the vicinity of the Site is difficult to infer.

Test Well 1 was pumped for a duration of six (6) hours and was sampled twice during this time. The pumping rate during the 6-hour pumping test (approximately 32 L/min) is considered sufficient to supply the proposed development. **Therefore the current well may be used to service the existing building and the proposed expansion, and a new well is not required to be drilled from a hydrogeological perspective.** It is recommended that this well be protected during construction.

Water quality results indicate that the bedrock aquifer provides good quality water, which may be considered suitable for human consumption. All water from Test Well 1 and Test Well 2 meets all applicable health-related standards and guidelines at the present time. Some treatment may be desired for aesthetic reasons.

On-site overburden in the area of the subject site is listed by the Ontario Geological Survey (OGS) as bedrock-drift complex in a Paleozoic terrain, and fine-textured glaciomarine deposits, which typically indicates shallow overburden. This assertion is supported by MECP WWIS records, which indicate an average depth to bedrock of approximately 2.2 m below ground surface (bgs) for listed wells within 500 m of the Site.

The Site appears to be capable of supporting the proposed from a hydrogeological perspective.

The existing on-site sewage system components appear to be constructed in conformance with applicable stipulations as per applicable Ontario Regulations and sufficiently sized to accommodate the expanded community centre.

The result of the impact assessment related to the on-site sewage systems indicate that the proposed community centre expansion will not be associated with unacceptable off-site impacts.

TABLE OF CONTENTS

| | | |
|------------|---|-----------|
| 1.0 | INTRODUCTION | 1 |
| 1.1 | <i>Consultation</i> | 1 |
| 2.0 | BACKGROUND | 2 |
| 2.1 | <i>Site Setting</i> | 2 |
| 2.2 | <i>Neighbouring Properties and Land Uses.....</i> | 2 |
| 2.3 | <i>Hydrology.....</i> | 2 |
| 2.4 | <i>Geology and Hydrogeology.....</i> | 3 |
| 2.4.1 | Recharge and Discharge Areas | 3 |
| 2.4.2 | Potential Sources of Contamination | 4 |
| 2.4.3 | Water Well Record Review | 4 |
| 3.0 | METHODOLOGY – HYDROGEOLOGICAL ASSESSMENT | 5 |
| 4.0 | RESULTS | 7 |
| 4.1 | <i>Static Conditions.....</i> | 7 |
| 4.2 | <i>Pumping Test – TW1.....</i> | 7 |
| 4.2.1 | Well Yield | 7 |
| 4.2.2 | Transmissivity | 8 |
| 4.2.3 | Long Term Yield | 9 |
| 4.2.4 | Water Quality | 10 |
| | Analytical testing indicates that the water quality of TW1 is suitable for potable purposes. | 10 |
| 4.2.5 | Water Treatment..... | 10 |
| 5.0 | TERRAIN ANALYSIS | 12 |
| 5.1 | <i>Preamble.....</i> | 12 |
| 5.2 | <i>General Site Evaluation.....</i> | 12 |
| 5.2.1 | Overburden Depth..... | 12 |
| 5.2.2 | Overburden Characterization..... | 12 |
| 5.2.3 | Soil Classification for Private Sanitary Servicing..... | 13 |
| 5.2.4 | Bedrock | 14 |
| 5.2.5 | Groundwater | 14 |

| | | |
|------------|------------------------------------|-----------|
| 5.3 | Contaminant Attenuation..... | 14 |
| 5.3.1 | Three-Step Assessment Process..... | 14 |
| 5.3.2 | Other Discussions | 17 |
| 6.0 | RECOMMENDATIONS | 17 |
| 6.1 | Water Supply..... | 17 |
| 6.2 | Wastewater Servicing..... | 18 |
| 7.0 | LIMITATIONS | 19 |
| 8.0 | REFERENCES..... | 21 |

TABLES

Table 1 Summary of Laboratory Data

Table 2 Summary of Field Parameters

FIGURES

Figure 1 Site Location

Figure 2 Site Layout

Figure 3 Surrounding Land Use

Figure 4 MECP Water Well Information System Summary

Figure 5 Bedrock Formation

Figure 6 Surficial Geology

Figure 7 Test Pit Investigation Layout

APPENDICES

Appendix A Water Level Data and Pumping Test Analysis

Appendix B Laboratory Certificates of Analysis

Appendix C Calculations

Appendix D MECP Water Well Information System Data

Appendix E Borehole Logs, Test Pit Logs, and Soil Particle Size Distribution Analysis

| | |
|------------|---|
| Appendix F | Nitrate Attenuation Calculations |
| Appendix G | Sewage System Certificate of Completion for Fire Hall and Sewage System Renovation Permit for Community Centre |

1.0 INTRODUCTION

McIntosh Perry ('MP') was retained by the City of Ottawa ('the Client') to conduct a Hydrogeological Assessment and Terrain Analysis in support of the City of Ottawa Site Plan Approval (SPA) process for the construction of an addition to the Corkery Community Centre, located at 3447 Old Almonte Road, Ottawa, Ontario (collectively referred to as 'the Site').

Based on pre-consultation with City of Ottawa personnel, the scope of the hydrogeological investigation is to confirm whether an existing well at the Site (which currently serves the Corkery Community Centre) has sufficient capacity to serve the proposed addition as well as the existing community centre, and to confirm groundwater quality in the existing well. The scope of the septic assessment is to demonstrate that the Corkery Community Centre's existing on-site sewage system does not and will not adversely impact the existing on-site well water supply or existing water supply wells on surrounding properties as per section 5.2.5 of the City's Hydrogeological and Terrain Analysis Guidelines (March 2021).

The Site location is shown on Figure 1 – Site Location, and an outline of the Site showing the neighbouring properties is presented on Figure 2 – Site Layout.

This report has been prepared using data collected from an existing water supply well located on-Site by McIntosh Perry staff on February 3, 2022.

This Hydrogeological Evaluation addresses the following:

- Well Record search and evaluation;
- Background hydrogeological evaluation;
- Oversight of a minimum 6-hour pumping test on-Site;
- Water level and flow monitoring, field water quality analyses;
- Sampling and analysis – includes 3 samples analyzed for the 'Subdivision Supply Suite' of parameters (2 samples at Community Centre on-site (3447 Old Almonte Road) , 1 sample at Ottawa Fire Station 84 located immediately west of the Site (3449 Old Almonte Road); and
- Data Evaluation and Report.

1.1 Consultation

The City of Ottawa and McIntosh Perry conducted a pre-application consultation with the City of Ottawa on November 18, 2021. The City of Ottawa provided information of what would be required for this Hydrogeological Report and Terrain Analysis.

2.0 BACKGROUND

2.1 Site Setting

The Site is located in the Carp area of the consolidated City of Ottawa, within the geographical township of Huntley (Figure 1). The site is zoned as Rural Institutional Sub-Zone 3 (RI3) as per the City of Ottawa Zoning By-Law Number 2008-250 sections 223 and 224.

At the present time, the Site is occupied by the Corkery Community Centre. At the time of investigation, on-Site conditions consisted primarily of one building, an outdoor skating rink, a play structure, and three soccer fields. Based on a review of aerial photographs (GeoOttawa), it appears that the Site was developed between 1991 and 1999. *It should be noted that Ontario Parcel data available on public provincial online mapping as well as the City of Ottawa's GeoOttawa GIS online mapping service suggest that the property parcel containing the Corkery Community Centre also encompasses Ottawa Fire Station 84 even though both facilities have separate entrances on Old Almonte Road as well as individual civic addresses. McIntosh Perry's scope of work for this assignment did not include legal surveying to establish property parcel boundaries and as such, this report accounts for both possibilities.*

2.2 Neighbouring Properties and Land Uses

The Site is bounded by rural residential land to the north, east, south and west, with Old Almonte Road to the south, undeveloped forested land to the east/south, and the Ottawa Fire Station 84 to the west.

The Site has frontage to Old Almonte Road. While MECP Water Well Information System (WWIS) records for the area do not provide the detailed locations of most wells, all developments within the area are assumed to be privately serviced with wells and on-site sewage systems.

Figure 3 – MECP Wells Record Summary, presents the MECP Well Tag numbers and approximate well locations, where available, for wells within approximately 500 m of the Site.

2.3 Hydrology

Topography was reviewed on the Atlas of Canada–Toporama website. Site elevation ranges from approximately 156 - 160 metres above sea level (m asl) and is a local high point. Ground surface at the Site is relatively flat, with a large portion of the site having a very gentle slope towards the east.

Surface drainage is interpreted to reflect surface topography and is likely controlled via permeable areas and ditches along the roadway. Based on the Ministry of Natural Resources and Forestry (MNR) 's GIS Ontario Flow Assessment Tool, the site represents a triple divide point between three local subwatersheds, with a larger portion of site draining to the south and east towards Huntley Creek (Carp River), and the remaining portions to the north and east to Corkery Creek (Carp River), and to the east towards Cody Creek (Mississippi River). Given this, shallow groundwater flow direction in the vicinity of the Site is difficult to infer.

The closest large permanent water bodies are the Mississippi River and Carp River, both located approximately 10 km from the site to the southwest and northeast of the Site, respectively, at their closest points. On regional scale, surface water is likely to flow both to the Mississippi River and Carp River given its location at the headwaters of three local sub-watersheds and on the divide of two Quaternary Watersheds (i.e., Mississippi River to the west and Carp River to the east).

2.4 Geology and Hydrogeology

On-site overburden at the Site is identified by the Ontario Geological Survey (OGS) as a contact between coarse-textured glaciomarine deposits consisting of sand, gravel, minor silt and clay, and Paleozoic bedrock. According to notes provided by during the pre-application consultation meeting, there are suspected thin soils in the area. This assertion is supported by MECP WWIS records, which indicate an average depth to bedrock of approximately 2.2 m below ground surface (bgs) for listed wells within 500 m of the Site. Refer to Section 5.0 for a more detailed discussion regarding surficial geology. On-site bedrock is generally characterized as limestone, dolostone, shale, arkose, and sandstone from the Ottawa and Simcoe Groups, and the Shadow Lake Formation (OGS 2020), which is supported by well records that list the bedrock as either “sandstone” or “limestone,” which is commonly interchanged for dolostone in the absence of detailed inspection (MECP 2020).

Based on available information, shallow groundwater flow direction is difficult to infer as the site is located at a triple divide point for three local sub watersheds, each flowing in different directions.

2.4.1 Recharge and Discharge Areas

Based on a review of topographic data, geological maps, and Site visits, a larger portion of the central and south-eastern portion of the property slopes slightly downwards to the east, towards an unnamed creek which is tributary of Huntley Creek, while the northern limits drain north towards Corkery Creek and the south-western corner drains west towards Cody Creek. Shallow groundwater and surface water flows are therefore expected to vary depending on the exact location of the site. Overall, the majority of the Site appears to be well drained.

No bedrock outcrops were observed at the Site, but it is important to consider that the ground was snow covered at the time of the visit.

Due to shallow bedrock in the area, the Site is therefore considered to be a hydrogeologically sensitive area. It should be noted that no unacceptable aquifer impacts have been observed by the current level of development and exact discharge locations of the on-site sewage systems servicing the Community Hall and Fire Station, therefore, it is reasonable to expect that a marginal increase in sewage effluent discharge to the Community Centre’s sewage system will not disrupt the existing flow subsurface flow patterns on-site.

2.4.2 *Potential Sources of Contamination*

A windshield survey of the surrounding area was conducted in combination with a site walkthrough and review of maps and zoning information. The Site is located in a predominantly rural residential area. This does not appear to pose any significant source of contamination to the proposed development. No obvious potentially contaminating activities (e.g., fuel outlets, improperly maintained bulk fuel storage, salt storage, manure piles, livestock yards, etc.) were observed in the vicinity of the Site at the time of inspection. However, it was noted in discussions with the City of Ottawa that a retail fuel outlet may have been historically present in the vicinity of the Site, either at the community centre property itself or the adjacent fire hall. A review of aerial photographs from the City of Ottawa's online mapping tool did not identify any evidence of a retail fuel outlet based on 1976 and 1999 aerial photos.

The Site and surrounding properties are not connected to municipal services. As such, there are likely private on-site sewage systems at all nearby residences.

Based on the well construction details outlined in the well record for TW1 (see Well Record 1530802 in Appendix D), the water bearing zone is 222 ft below ground surface. Based on this depth, and the fact that the existing sewage system scheduled to remain unchanged in the location where it has been operating and discharging sewage effluent relative to two on-site wells (TW1 and TW2) that are scheduled to remain as part of the proposed facility expansion at a site and that is currently operating at steady-state with respect to the expected and acceptable anthropogenic impacts to the aquifer from the level of development currently present on and around the site that have been present for over a decade, it is our opinion that the marginal increase in sewage effluent from the proposed facility expansion will not cause undue impacts to the aquifer supply. Additionally, TW1 was constructed with extended casing of 44 ft which would greatly reduce any potential surface impacts.

2.4.3 *Water Well Record Review*

The MECP's WWIS database indicated 61 water wells that are located within 500 m of the Site boundary. 56 of these wells are listed for domestic purposes. The remaining wells are assumed abandoned. The MECP WWIS records are shown on Figure 3, and data are summarized in Appendix D.

All wells were completed in bedrock at final depths ranging from 19.2 – 17.6 m below ground surface (bgs). The average depth to bedrock was reported to be 2.15 m bgs. Driller-reported static groundwater levels ranged from 0.9 – 35.1 m bgs.

Driller-reported well yields ranged from 9.0 – 136.4 L/min, generally at or above the recommended minimum rate of 13.7 L/min for residential occupancies.

3.0 METHODOLOGY – HYDROGEOLOGICAL ASSESSMENT

McIntosh Perry conducted a hydrogeological investigation at the Site to assess the feasibility of servicing the proposed development. The work generally followed the guidance of MECP Procedure D-5-5: Technical Guideline for Private Wells: Water Supply Assessment and the City of Ottawa's Hydrogeological Guidelines.

McIntosh Perry tested the existing community/institutional drilled water supply well located at 3447 Old Almonte Road (Test Well 1, TW1), which is believed to be representative of the hydrogeological conditions across the entire Site.

The MECP water well record for TW1 (1530802) indicates that the total depth of the well is 72.5 m, with the pump set at 45.72 m. The well is reportedly completed in limestone with red-green shale and sandstone, with water found at 67.7 m and a static water level of 25 m at the time of drilling. The record for TW1 is provided in Appendix D. During the pumping test, TW1 was observed to be in good condition, with at least 0.6 m of stickup as required by O.Reg. 903.

The pumping test at TW1 used the existing installed plumbing equipment. It is important to note that for the entire duration of the test, the pump cycled on and off, filling the pressure tank, which resulted in oscillating water levels.

A six-hour pumping test was conducted at TW1 by McIntosh Perry staff on February 3, 2022. During the entire duration of the test, the well was effectively taken offline and used solely for purposes of the pumping test. Water was pumped directly from the test well using the existing domestic water well pump, via a hose attached to an outdoor tap. The water discharge was directed away from the building and was allowed to flow overland across the Site. Discharging the water onto potentially thin soils did not appear to affect flow or drawdown during the pumping test.

During the testing period, water levels in the well were measured using an electronic water level tape. Water quality (pH, temperature, conductivity, turbidity, and total dissolved solids) was also monitored and recorded in the field during the test using calibrated instruments (Horiba U-52). Groundwater chemistry had stabilized prior to collecting samples of the well water.

It should be noted that the samples collected at the Site were directly from the outdoor untreated tap. Two samples (TW1-1 and TW1-2) were collected for laboratory analysis, one within the first hour of the pump test (TW1-1) and the second one within the final hour (TW1-2). An additional sample ('TW2') was collected at from another drilled well servicing an adjacent facility at 3449 Old Almonte Road, Ottawa, ON (Ottawa Fire Station 84). Refer to Appendix D for TW2's Well Record (Well Record 1520285). These samples were analyzed for the full suite of parameters list in the City of Ottawa's Guidelines for Hydrogeological Studies. Water samples were also analyzed for benzene, toluene, ethylbenzene, and xylenes (BTEX) and petroleum hydrocarbons, fractions 1 through 4 (PHC F1-F4), due to the close proximity to the fire station, and anecdotal evidence of a retail fuel outlet in the vicinity.

It is important to note that a water sample was not obtained from an additional residential dwelling in an inferred downgradient direction.

Whenever samples were collected from TW1, confirmation of zero chlorine residual was measured using disposable test strips. All groundwater samples were collected unfiltered and unchlorinated, directly into clean bottles supplied by the analytical laboratories (Paracel Laboratories Ltd., Ottawa, ON). The samples were kept on ice and shipped directly to Paracel under strict chain of custody procedures. All of the samples were received by the laboratory within 24 hours of collection.

Paracel is fully accredited by the Standards Council of Canada/Canadian Association for Laboratory Accreditation (SCC/CALA) and has accreditation for Ontario Safe Drinking Water Act (OSDWA) testing.

During the pumping test, water level monitoring consisted of manual readings with an electronic water level tape. Drawdown was measured in the pumped well and measurements were made until at least 95% recovery were achieved, or 24 hours had passed (whichever came first). A data logger could not be used due to the risk of damaging down-hole equipment (pump and associated wiring).

Drawdown and recovery data from the pumping tests were plotted and analyzed using the Cooper-Jacob solution. The hydraulic conductivity (K , m/s) and transmissivity (T , m²/d) and long-term yield (Farvolden and Moell Method) of the aquifer were estimated. Storativity cannot be assessed properly without the use of an additional observation well, which was not available at the time of the test.

4.0 RESULTS

A drawdown curve and tabular data from the pumping tests at the Site is available in Appendix A. A summary of groundwater quality data and the official Laboratory Certificates of Analysis are available in Tables 1 and 2 and Appendix B, respectively.

4.1 Static Conditions

Prior to the initiation of pumping, water levels were measured in the well. The static groundwater level was recorded at 32.35 m below top of casing (btoc) at the time of the pumping test ($t=0$). Assigning an arbitrary site benchmark of 100.00 m (local) to the top of the casing, the static water elevation in the well was 67.65 m above datum (ad). According to the MECP Well Record for TW1 (1530802), the pump was set at a depth of 45.72 m, corresponding to an available drawdown of 13.37 m.

Standing water or evidence of groundwater discharge was not observed at the test well location at the time of the pumping test.

4.2 Pumping Test – TW1

A pumping test was conducted at TW1 (3447 Old Almonte Road) under the supervision of McIntosh Perry on February 3, 2022. Water was pumped directly from the test well using the existing domestic water well pump, and one hose attached to the outdoor tap. The water discharge was directed away from the building and was allowed to flow overland across the Site. At the time of the pumping test, the weather was approximately -6°C and cloudy.

All water level measurement data are presented in Appendix A. Due to the existing installed plumbing, water levels were seen to oscillate throughout the entire duration of the test.

At 9:40 AM, the outdoor tap was turned on and the flow rate adjusted to approximately 32 L/min from the hose. This pumping rate was maintained with minimal variation for the duration of the test (361 minutes total).

The groundwater level ranged between 32.21 – 32.752 m btoc, with a maximum drawdown of 0.402 m observed. Following pump shutoff (361 minutes), drawdown was recorded at 0.02 m within 33.33 minutes (32.37 btoc, 67.63 m ad), representing approximately 95% recovery.

4.2.1 Well Yield

The pumping test undertaken by McIntosh Perry provides a reasonable indication of the yield of the Test Well. During this test, approximately 11,372 L of water was pumped from the well; this volume exceeds the daily demand for water for a typical 4-BR home (2,250 L) as specified in the Guideline Procedure D-5-5 Private Wells: Water Supply Assessment. Since the well will not be used for residential purposes, it was also established that the volume pumped exceeded the expected water demand of

3,600 L/day which has been established for this assessment based the calculated total daily design sanitary sewage flows for the site.

4.2.2 Transmissivity

The transmissivity for TW1 was calculated following the Cooper-Jacob method. The calculations for Transmissivity are presented in Appendix C. Transmissivity was calculated using the following equation:

$$T = \frac{2.3 Q}{4 \pi \Delta s}$$

Where:

- T is the transmissivity (m²/day)
- Q is the pumping rate during the pumping test (L/min); and,
- Δs is the differential for residual drawdown for one log cycle (m)

Using drawdown and recovery data, respective transmissivities of 301 m²/d and 3375 m²/day were calculated using the Cooper-Jacob method. The transmissivity of 301 m²/day calculated from the drawdown was used in the calculations as it is the more conservative value. It is noted that recovery data are likely more representative of aquifer conditions, as drawdown data were complicated by the cycling of TW1's pressure tank.

Assuming an aquifer thickness of 59.74 m (corresponding to the interval between the bottom of the casing and the bottom of the well), the screened formation of TW1 was calculated to have a hydraulic conductivity ranging from 5.8 x 10⁻⁵ – 6.5 x 10⁻⁴ m/s.

Storativity (S) could not be calculated as no observation wells were available for measurement at the time of the pumping test.

A summary of the well and hydrogeological properties determined during the testing work at the Site are presented in Appendix A. The calculations for Transmissivity are presented in Appendix C.

4.2.3 Long Term Yield

The theoretical long-term safe yield was calculated using both the Farvolden and Moell methods. Drawdown data were used, as they are likely more representative of aquifer conditions (see above Section 4.2.2).

Farvolden Equation

The long-term yield (Q_{20}) was calculated using the following Farvolden equation:

$$Q_{20} = 0.68 T H_a S_f$$

Where:

- Q_{20} is the twenty-year safe yield;
- T is the transmissivity;
- H_a is the available water column height (above the pump); and
- S_f is a safety factor (0.7).

Based on the Farvolden Method, calculations indicate that a twenty-year safe yield is in the order of 1332 L/min. This means that TW1 could theoretically sustain continuous pumping for 20 years at this rate, which is improbable as with normal water use; the pump will cycle on and off on a much shorter time scale, allowing the well to recharge.

Moell Method

The Moell Method was also used to calculate the theoretical long-term safe yield for the pumping well. The long-term yield (Q_{20}) was calculated using the following Moell equation:

$$(Q_{20}) = (Q H_a S_f) / (s_{100} + 5 \Delta s)$$

Where:

- Q_{20} is the twenty-year safe yield (m^3/day);
- H_a is the available water column height (m);
- S_f is a safety factor (0.7);
- s_{100} is the drawdown at 100 minutes (semi-log long-term graph);
- Δs is the change in hydraulic head over one log cycle (drawdown vs. log time, see Appendix D); and
- Q is the pumping rate during the pumping test (L/min).

Using the Moell Method, calculations indicate that a twenty-year safe yield for the well is in the order of 763 L/min.

Accordingly, McIntosh Perry is of the opinion that the aquifer is capable of supplying water at a flow rate which greater than the minimum flow rate of 30 L/min, which assumes that the entire daily water demand of 3,600 occurs for a period of 120 minutes per day.

The calculations for the Farvolden and Moell method are presented in Appendix C.

4.2.4 Water Quality

Laboratory Certificates of Analysis for on-site groundwater testing are presented in Appendix B. A summary of field and laboratory results from the TW1 is presented in Tables 1 and 2. Samples were taken twice during the six-hour pumping test of TW1 on February 2, 2022. Samples were taken directly from the outdoor untreated tap into laboratory supplied containers. The pre-test and post-test samples at TW1 were labelled '-1' and '-2', respectively. A sample was also taken from an untreated bathroom tap at the Fire Station (TW2, 3449 Old Almonte Road), located immediately west of the Site.

The results of the analytical testing were compared to the Ontario Drinking Water Standards, Objectives, and Guidelines (ODWSOG). Based on the analytical results from February 3, 2022 the following was noted:

- Hardness concentration (as CaCO₃) for TW1-1 (380 mg/L) and TW1-2 (377 mg/L) is considered to be **very hard** in relation to operational guidelines (OG) of 80-100 mg/L;
- OWDS aesthetic objectives (AO) guideline for **iron** (0.3 mg/L) was exceeded in sample TW1-1 (0.5 mg/l);
- Organic Nitrogen's operation guideline (OG) (0.15 mg/L) was exceeded in both TW1-1 (0.17 mg/L) and TW1-2 (0.18 mg/L) samples;
- The health warning limit for sodium (20 mg/L) was exceeded in samples TW1-1, TW1-2, and TW2.

Analytical testing indicates that the water quality of TW1 is suitable for potable purposes.

4.2.5 Water Treatment

The groundwater quality at the Site, as indicated by analytical data from supply well TW1, is suitable for human consumption.

The hardness in TW1 is considered to be very hard. Water softening is recommended, specifically the use of potassium salts (i.e., KCl) is recommended. With the use of sodium-based water softeners, it is important to note that sodium concentrations will be elevated; currently the sodium concentration of 27.3 mg/L exceeds the 20 mg/L benchmark concentration for individuals on a sodium restricted diet. Therefore, a potassium salt softener (KCl) is recommended to avoid elevated levels of sodium above that reported in Table 1. It should be noted that a review of the manufacturer's technical data sheet provided by the City of Ottawa for the specific UV disinfection unit employed as part of the facility's drinking water system (Hallett model 500 PN, NSF/ANSI 55 Class A) did confirm that the hardness

concentration from the supply well (380 mg/L) is within the operating range of that specific UV disinfection unit, which lists a maximum operating Hardness concentration of 850 mg/L.

The Langelier Saturation Index (LSI) and Ryznar Stability Index (RSI) were calculated for TW1 (Appendix G). These results indicate that there is limited potential for scale to form on pipes, and that any calcium carbonate formation is not likely to form a protective corrosion inhibitor film (LSI=0.96, RSI=6.30).

Iron exceeds the aesthetic objective (AO) and may cause the staining of plumbing fixtures. Iron is readily treated through water softeners or manganese greensand filters. Similar to above with respect to the Hardness parameter, a review of the manufacturer's technical data sheet provided by the City of Ottawa for the specific UV disinfection unit employed as part of the facility's drinking water system (Hallett model 500 PN, NSF/ANSI 55 Class A) did confirm that the iron concentration from the supply well (0.3 mg/L) is within the operating range of that specific UV disinfection unit, which lists a maximum operating iron concentration of 3 mg/L.

Organic nitrogen exceeds the operation guideline and is associated with odor and taste when chlorine disinfection is used. In this case, the exceedance is marginal and will not lead to odor or taste issues since it was confirmed that the facility does not employ chlorination was part of the on-site drinking water system, but instead employs UV disinfection.

It should be noted that it is expected that this facility's drinking water system would be regulated under Ontario's Small Drinking Water Regulation 319/08 (O.Reg. 319/08) as it would likely be considered a small municipal non-residential drinking water system (even though it might not be capable of supplying water at a rate of more than 2.9 L/s) since it is understood to serve a "public facility" as defined in the regulation. Small drinking water systems that are regulated under O.Reg. 319/08 are assessed by Public Health inspectors (PHI). Although not currently employed as part of the facility's drinking water system, should future PHI directives with respect to treatment requirements include the requirement to provide chloring disinfection, the organic nitrogen operational guideline exceedance should be reviewed and discussed by both the PHI and the system's operator to ensure it does not interfere with chlorination or result in taste or/and odour problems. Similarly, should a change in UV disinfection unit be required in the future, the hardness and iron operational guideline exceedances should be reviewed and discussed by both the PHI and the system's operator to ensure they don't exceed the manufacturer's specific operating range for specific UV disinfection unit being proposed for use as part of the drinking water system on-site.

4.2.5.1 Well Protection During Construction

As the existing water supply well (TW1) is to be retained to service the expanded development, it is recommended that measures be taken to protect the well during construction. The well should be clearly marked to prevent accidental collisions by construction equipment. Consideration could be given to using a section of large-diameter concrete pipe around the well to protect it. Following construction, ground surface must be graded for positive drainage away from the well per the requirements of O.Reg. 903.

5.0 TERRAIN ANALYSIS

5.1 Preamble

EXP completed a Geotechnical Investigation in 2021 where four boreholes (BH-01 through BH-04) and three test pits (TP-03, TP-02, and TP-04) were advanced in the area of the proposed addition to the Corkery Community Centre (EXP, 2021). Additionally, as a part of this Hydrogeological Assessment and Terrain Analysis, McIntosh Perry advanced one test pit on December 22, 2021 (MP-TP1-2021), within the contact area of the existing sewage system. See Figure 7 for locations of test pits/boreholes and Appendix E for borehole logs and associated grain-size distribution curves.

The test pits and boreholes mentioned above all detail the depth of overburden and depth to bedrock. Various soil samples were collected for soil characterization.

5.2 General Site Evaluation

5.2.1 Overburden Depth

Where boreholes were advanced to refusal, overburden across the site was found to be relatively shallow (< 2.1 m), having an average overburden thickness of 1.7 m (EXP, 2021).

The test pit advanced by McIntosh Perry staff on December 22, 2021 was advanced to a depth of 0.85 m (refusal was not reached).

5.2.2 Overburden Characterization

The soil and groundwater conditions from the test pits and boreholes advanced by EXP and discussed in the Geotechnical Investigation report (EXP, 2021), with the borehole logs, test pits logs and Soil Particle Size Distribution Analysis included in Appendix E, along with the test pit log for the test pit advanced by McIntosh Perry staff as part of the Sewage System assessment on December 22, 2021.

The logs indicate the subsurface conditions at the specific test pit locations only. Boundaries between zones on the logs are often not discrete but transitional and have been interpreted. Subsurface conditions described have various degrees of precision based on the frequency of test pits, uniformity of subsurface conditions and number of samples collected. Where conditions at locations other than at the test pit locations are reported, these are inferred and may vary from the conditions at the test pits.

The soil descriptions in this report are based on tactile observations by McIntosh Perry staff as well as Grain Size Distribution curves provided in the EXP Geotechnical Investigation report (EXP, 2021).

5.2.2.1 Topsoil

A layer of topsoil was encountered in all of the test pit and borehole locations; the topsoil had a varying thickness between 0.075 m and 0.25 m (EXP, 2021), and 0.10 m in the test pit advanced by McIntosh Perry staff.

5.2.2.2 Silty Sand with Gravel (SM)

A layer of silty sand with gravel was encountered below the topsoil/granular fill layer in all test pits and boreholes with the exception of test pit MP-TP1-2021; the layer had a varying thickness between 0.4m and 1.5 m.

5.2.2.3 Sandy Gravel with Silt, Cobbles and Boulders (GM)

A layer of sandy gravel with silt, cobble and boulders was encountered below the silty sand with gravel layer in BH-01, BH-03, and TP-01 and below the silt gravel with sand layer in MP-TP1-2021; the layer had a varying thickness between 0.6 m and 1.3 m.

5.2.2.4 Silty Gravel with Sand, Cobbles and Boulders (GM)

A layer of silty gravel with sand, cobbles, and boulders was encountered either below the topsoil or below silty sand and gravel in BH-02 and MP-TP1-2021; the layer had a varying thickness between 0.1 m and 0.3 m.

5.2.2.5 Silty Sand to Sandy Silt with Gravel (SM-ML)

A layer of silt sand to sandy silt was encountered below the silty sand and gravel and immediately above the refusal depth in BH-04; the layer had a thickness of 0.6 m.

5.2.3 Soil Classification for Private Sanitary Servicing

Comparison of the soil classification for the Unified Soil Classification as provided in the Ministry of Municipal Affairs and Housing (MMAH) Supplementary Standard SB-6: Time and Soil Descriptions, reveals that the two main soils assessed on-site falls within either the following:

- GM: Silty Gravels, gravel-sand-silt mixtures
 - According to Table 2 of SB-6, the GM group of soils has a coefficient of permeability (K) of 10^{-2} to 10^{-4} with a percolation time (T) between 4-12 min/cm. Due to the permeable to medium permeability nature of the soil type, it is deemed acceptable as native receiving soil for Class 4 sewage systems.
- SM: Silty sands, sand-silt mixtures
 - According to Table 2 of SB-6, the SM group of soils has a coefficient of permeability (K) of 10^{-3} to 10^{-5} with a percolation time (T) of 8 to 20 min/cm. This soil type has a medium to low permeability and is deemed acceptable as native receiving soil for Class 4 sewage systems.

5.2.4 Bedrock

As previously discussed in Section 2.4, on-site bedrock is generally characterized as limestone, dolostone, shale, arkose, and sandstone from the Ottawa and Simcoe Groups, and the Shadow Lake Formation (OGS 2020), which is supported by the geotechnical borehole BH-03 (EXP), in addition to MECP drinking well records that list the bedrock as either “sandstone” or “limestone,” which is commonly interchanged for dolostone in the absence of detailed inspection (OGS 2020).

5.2.5 Groundwater

Groundwater was only encountered in the shallow overburden in EXP TP-03 (1.6 m bog) and was encountered in the shallow bedrock in the piezometer installed in the BH-03 (2.6 m bog).

5.3 Contaminant Attenuation

5.3.1 Three-Step Assessment Process

As part of the consent development application process, the City of Ottawa requires that a water quality impact risk assessment be completed as per MECP requirements. The MECP Procedure D-5-4 (Technical Guideline for Individual On-site Sewage Systems: Water Quality Impact Risk Assessment) outlines the following steps to be completed as part of a septic impact assessment:

- Step 1 – Lot Size Consideration
- Step 2 – System Isolation Consideration
- Step 3 – Contaminant Attenuation Considerations

The following outlines the results of the sewage system impact assessment as undertaken by McIntosh Perry.

5.3.1.1 Step 1 - Lot Size Consideration

For the purpose of this investigation, McIntosh Perry considered the land parcels upon which the Corkery Community Centre exists (2.60 hectares) and the neighbouring lot with the sports fields (1.16 hectares) as the site, which together combine to be 3.76 hectares. The site appears to have two separate civic addresses (3447 and 3449 Old Almonte Road). Please see Figure 2 for layout of the two adjacent parcels that are considered to form the subject site.

As part of the terrain assessment for this site, McIntosh Perry established an equivalent total daily sewage flow loading rate to the 1,000 L/day/ha of domestic waste, similarly than what is used for residential developments. As the subject site is approximately 3.76 ha and assuming the equivalent of domestic strength waste will be generated for the existing fire hall and proposed expanded community centre, a total daily sewage flow loading rate of 3,760 L/day was calculated based on spatial area to adequately permit development of the Site.

The existing fire hall's sewage system is calculated as having a capacity of approximate 1,200 L/day based on a review of the available information in sewage system permit Certificate of Completion No. 09-509 (Appendix G), with McIntosh Perry cursory field observations supporting the information contained in the Certificate of Completion. Additionally, the proposed expanded community centre will be associated with a daily sewage system flow of 3,600 L/day, for a total site-wide daily sewage flow of 4,800 L/day. Accordingly, McIntosh Perry considered that this total daily sewage flow was not insufficient for the scale of proposed development on the subject site, a therefore a review of Step 2 – System Isolation Consideration was undertaken.

5.3.1.2 Step 2 - System Isolation Consideration

As previously outlined, the existing lot is considered too small for lot size consideration; therefore, McIntosh Perry assessed whether System Isolation Considerations were applicable. If it can be demonstrated that the sewage system effluent is hydrogeologically isolated from the existing or potential drinking water supply aquifer, then the risk to groundwater is considered to be low. The system isolation argument applies to lands that extend up to 500 metres from the Site.

Based on a review of available geological information and mapping, in conjunction with site observations made during the Terrain Analysis and background information review, overburden depth on-site is shallow (< 2.1m). The Site is therefore determined not to be hydrogeologically isolated and, as such, the consideration for system isolation of sewage system effluent from the groundwater supply aquifer is not applicable to this site.

5.3.1.3 Step 3 – Contaminant Attenuation Considerations

Since neither lot size nor system isolation considerations apply to the proposed project, a predictive nitrate-nitrogen attenuation assessment was undertaken to determine if sufficient attenuation of nitrate-nitrogen could be achieved on the subject site.

The Thornthwaite Water Balance method, in conjunction with local climatic data available from Environment Canada for Ottawa's MacDonald-Cartier International Airport YOW (Site Climate ID: 6106000), was used to estimate the net potential infiltration for the subject site.

As previously discussed, for the purpose of the calculations, both 3447 and 3449 Old Almonte Road properties combined were used for contaminant attenuation considerations as both are owned by the City of Ottawa.

As indicated previously, the information contained in the 2009 sewage system Certificate of Completion No. 09-505 (Appendix G) obtained via a file search with the Ottawa Sewage System Office for the property at 3449 Old Almonte Road, which services the Fire Station, suggest it was designed for a total daily sewage flow of 1,200 L/day. In coordination with the City of Ottawa's project team for the Community Centre expansion project, it was established that a total daily sewage flow of 3,600 L/day would be appropriate for the Community Centre after the expansion based on occupancy for the

facility equivalent to 450 people in an assembly hall with no food service, 180 people in public parks with access to toilets only, or 100 people in an assembly hall with food service provided. Combining the total daily sewage flow for both the fire hall and the expanded Community Centre, a site-wide sewage flow of 4,800 L/day was carried forward for this assessment.

The nitrate concentration at the site boundaries was calculated using the following information (refer to Appendix A for more information):

- A water surplus (W_s) value of **333.88 mm/yr** was calculated based on 1981-2010 Climate Normal data for Ottawa's MacDonal-Cartier International Airport (YOW) (Site Climate ID: 6106000);
- An infiltration factor (I_f) of **0.600** was calculated as per Table 2 of MECP's document titled "MOEE Hydrogeological Technical Requirements for Land Development Applications," dated April 1995. The factors used to calculate the Infiltration Factor (I_f) and the associated rationale for selection are presented below:
 - A topographic factor of 0.20 was used as the land can be considered relatively flat or 'rolling land'.
 - A soil factor of 0.30 was used due to the silty sand with gravel and silty gravel with sand encountered in the overburden throughout the site (EXP, 2021).
 - A cover factor of 0.10 was used for Cultivated Land (0.1) as the majority of the site is expected to remain as cultivated land/mowed grass.
- Available infiltration (I) was calculated by multiplying the water surplus (W_s) by the infiltration factor (I_f). This yielded an infiltration value of **0.200 m/yr**.
- The infiltration area (A) was determined to be 3.2218 ha (32,217.82 m²) or 85.7% of the site, once adjustments were made for the approximately 5,364 m² of hard-surfaced areas present on-site (i.e., parking/driving surfaces, roofs, and play structure).
- The dilution water (D_w) available was calculated as 6454.06 m³/yr (17,682.35 L/day) by multiplying the infiltration area (A) with the available infiltration (I).
- Based on the samples collected from both Test Well 1 (3447 Old Almonte Road) and Test Well 2 (3449 Old Almonte Road), a background nitrate concentration (C_b) of 1.4 mg/L was used. *Note that this background nitrate concentration is expected to be conservative as it would already incorporate any of the existing steady-state anthropogenic impacts that the fire hall and existing portions of the community centre may have on the nitrate concentrations in the local groundwater supply since both of these facilities have been in operation for extended periods of time (i.e. over 20 years or approximately since ~1999) during which they would have been discharging sewage effluent to site's subsurface via Class 4 sewage systems.*
- The site-wide sewage system daily flow (Q_e) was set at 4,800 L/day, at a concentration (C_e) of 40 mg/L since the effluent is generally expected to be from domestic origins based on the type of facility being serviced.

Based on the above-noted information, the average nitrate concentration at the downgradient property boundary (C_w) would of be 9.94 mg/L, which is below the maximum boundary nitrate concentration of 10 mg/L.

5.3.2 Other Discussions

The above-noted analysis is considered very conservative as it assumes that the full sewage system impacts of both the existing Fire Hall and existing Community Centre are not already accounted for in the background nitrate concentrations. In practice, sewage flow from the Fire Hall is not expected to change as part of this project and the additional flow associated Community Centre expansion is expected to be relatively minimal when compared to the baseline conditions at the Community Centre for the previous 20 years (i.e. since ~1999).

In addition, it has been discussed in this report that empirical water quality data from the on-site wells that the combination of the properly constructed partially-raised leaching bed and drilled wells (all of which are proposed to remain to service as part of the expansion), in conjunction with the local surficial geology and bedrock conditions, are sufficient to protect the local aquifer from unacceptable impact even though the site is considered hydrogeologically sensitive.

Calculations for the predictive nitrate attenuation are presented in Appendix F.

6.0 RECOMMENDATIONS

6.1 Water Supply

Well Yield

- Well yields in the order of 32 L/min appear to be sustainable based on the pumping test data and calculations performed.

Water Quality and Treatment

- No maximum acceptable concentration (MAC) was exceeded in TW1. All applicable health related standards at the present time.
- If water softening is desired, the use of potassium salts (i.e., KCl) is recommended.
- It is noted that the warning level for sodium (20 mg/L) was exceeded in all samples collected as part of this investigation. As such, it is recommended that the Client notify the local Medical Officer of Health of the sodium exceeding the health-related warning limit.
- MP recommends that the Owner contact Ottawa Public Health regarding the organic nitrogen exceedance to review and discuss with the Public Health Inspector and the system's operator.
- It is expected that this facility's drinking water system is regulated under Ontario's Small Drinking Water Regulation 319/08 (O.Reg. 319/08) as a small municipal non-residential

drinking water system serving a “public facility”. Should the local Public Health inspector (PHI) have issued a directive with respect to treatment requirements that include the requirement to provide disinfection, the organic nitrogen operation guideline exceedance should be reviewed and discussed by both the PHI and the system’s operator to ensure it does not interfere with chlorination should it be required or already used as part of the existing drinking water system on-site.

6.2 Wastewater Servicing

Private Sewage Systems

- The capacity of the existing sewage system servicing the community centre is approximately 3,600 L/day. This was determined to be sufficient for the proposed expansion of the community centre and would translate to equivalent occupancy limits of the facility of 450 people in an assembly hall with no food service, 180 people in public parks with access to toilets only, or 100 people in an assembly hall with food service provided.
- The existing on-site sewage system components appear to be constructed in conformance with applicable stipulations as per applicable Ontario Regulations and sufficiently sized to accommodate the expanded community centre.
- The result of the impact assessment related to the on-site sewage systems indicate that the proposed community centre expansion will not cause unacceptable off-site impacts.
- Any septic systems must be constructed with all appropriate setbacks, treatment units and stipulations as per applicable Ontario Building Code requirements.
- Septic systems for the lot must be constructed down-gradient of the lot’s supply well.

Site Servicing Layout

- Proposed development on the subject site is expected to remain as is due to sufficient capacity of the existing well and sewage system servicing the community centre to accommodate the flows associated with the proposed expansion.

7.0 LIMITATIONS

This report has been prepared and the work referred to in this report has been undertaken by McIntosh Perry Consulting Engineers Ltd. for the applicants and the regulatory authority. It is intended for the sole and exclusive use of the applicants, their affiliated companies and partners and their respective insurers, agents, employees, advisors, and reviewers. The report may not be relied upon by any other person or entity without the express written consent (Reliance Letter) of McIntosh Perry Consulting Engineers Ltd.

Any use which a third party makes of this report, or any reliance on decisions made based on it, without a reliance letter are the responsibility of such third parties. McIntosh Perry Consulting Engineers Ltd. accept no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this report.

The investigation undertaken by McIntosh Perry Consulting Engineers Ltd. with respect to this report and any conclusions or recommendations made in this report reflect McIntosh Perry Consulting Engineers Ltd. judgment based on the Site conditions observed at the time of the site inspection on the date(s) set out in this report and on information available at the time of the preparation of this report.

This report has been prepared for specific application to this Site and it is based, in part, upon visual observation of the Site, subsurface investigation at discrete locations and depths, and specific analysis of specific chemical parameters and materials during a specific time interval, all as described in this report. Unless otherwise stated, the findings cannot be extended to previous or future Site conditions, portions of the Site which were unavailable for direct investigation, subsurface locations which were not investigated directly, or chemical parameters, materials or analysis which were not addressed. Substances other than those addressed by the investigation described in this report may exist within the Site, substances addressed by the investigation may exist in areas of the Site not investigated and concentrations of substances addressed which are different than those reported may exist in areas other than the locations from which samples were taken.

If site conditions or applicable standards change or if any additional information becomes available at a future date, modifications to the findings, conclusions and recommendations in this report may be necessary.


We trust that this information is satisfactory for your present requirements. Should you have any questions or require additional information, please do not hesitate to contact the undersigned.

Respectfully submitted,

McIntosh Perry Consulting Engineers Ltd.



Monica Black, B.Sc.
Environmental Scientist
(343) 925-0179
m.black@mcintoshperry.com

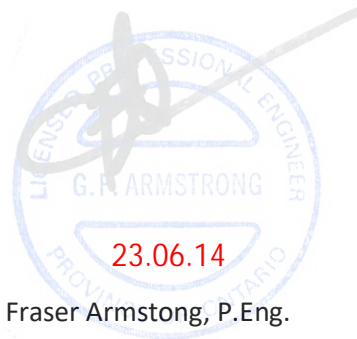

Fraser Armstong, P.Eng.
Senior Environmental Engineer
(613) 714-4589
f.armstrong@mcintoshperry.com



Erin Williams, EIT
Junior Environmental EIT
(613) 714-6796
e.williams@mcintoshperry.com



Patrick Leblanc, P.Eng.
Senior Environmental Engineer (Terrain Analysis)
(613) 714-4586
p.leblanc@mcintoshperry.com

Ref.: U:\Ottawa\01 Project - Proposals\2021 Jobs\CCO\CCO-21-3339 - CSV Corkery Hall - 3447 Old Almonte Road\CCO-21-3339-01\Report\Final\CCO-21-3339-01_3447 Old Almonte Rd_Hydro G_Rev.4.docx

8.0 REFERENCES

EXP, 2021. Geotechnical Investigation – Corkery Community Centre Expansion 3447 Old Almonte Road, Carp, Ontario.

OGS Earth, 2018. Ontario Ministry of Northern Development, Mines and Forestry, - Ontario Geological Survey Earth – for Google Earth. Overburden classification data for Eastern Ontario.

OGS Earth, 2018. Ontario Ministry of Northern Development, Mines and Forestry, - Ontario Geological Survey Earth – for Google Earth. Bedrock classification data for Eastern Ontario.

OGS Earth, 2018. Ontario Ministry of Northern Development, Mines and Forestry, - Ontario Geological Survey Earth – for Google Earth. Karst Study for Southern Ontario.

McIntosh Perry Consulting Engineers Ltd. (McIntosh Perry), 2020. Engineering Services – Corkery Community Centre Sewage System Assessment (OCM-19-0590) 3447 Old Almonte Road, Carp, ON.

MECP, 1995. Procedure D-5-4 Technical Guideline for Individual On-site Sewage Systems: Water Quality Impact Risk Assessment.

MECP, 1996. Procedure D-5-5 Technical Guideline for Private Wells: Water Supply Assessment.


MECP, 2021. Water Supply Wells: Requirements and Best Practices. (online)

MECP (Ontario Ministry of the Environment, Conservation and Parks). 2018. MECP Water Well Record Database (queried 2022).





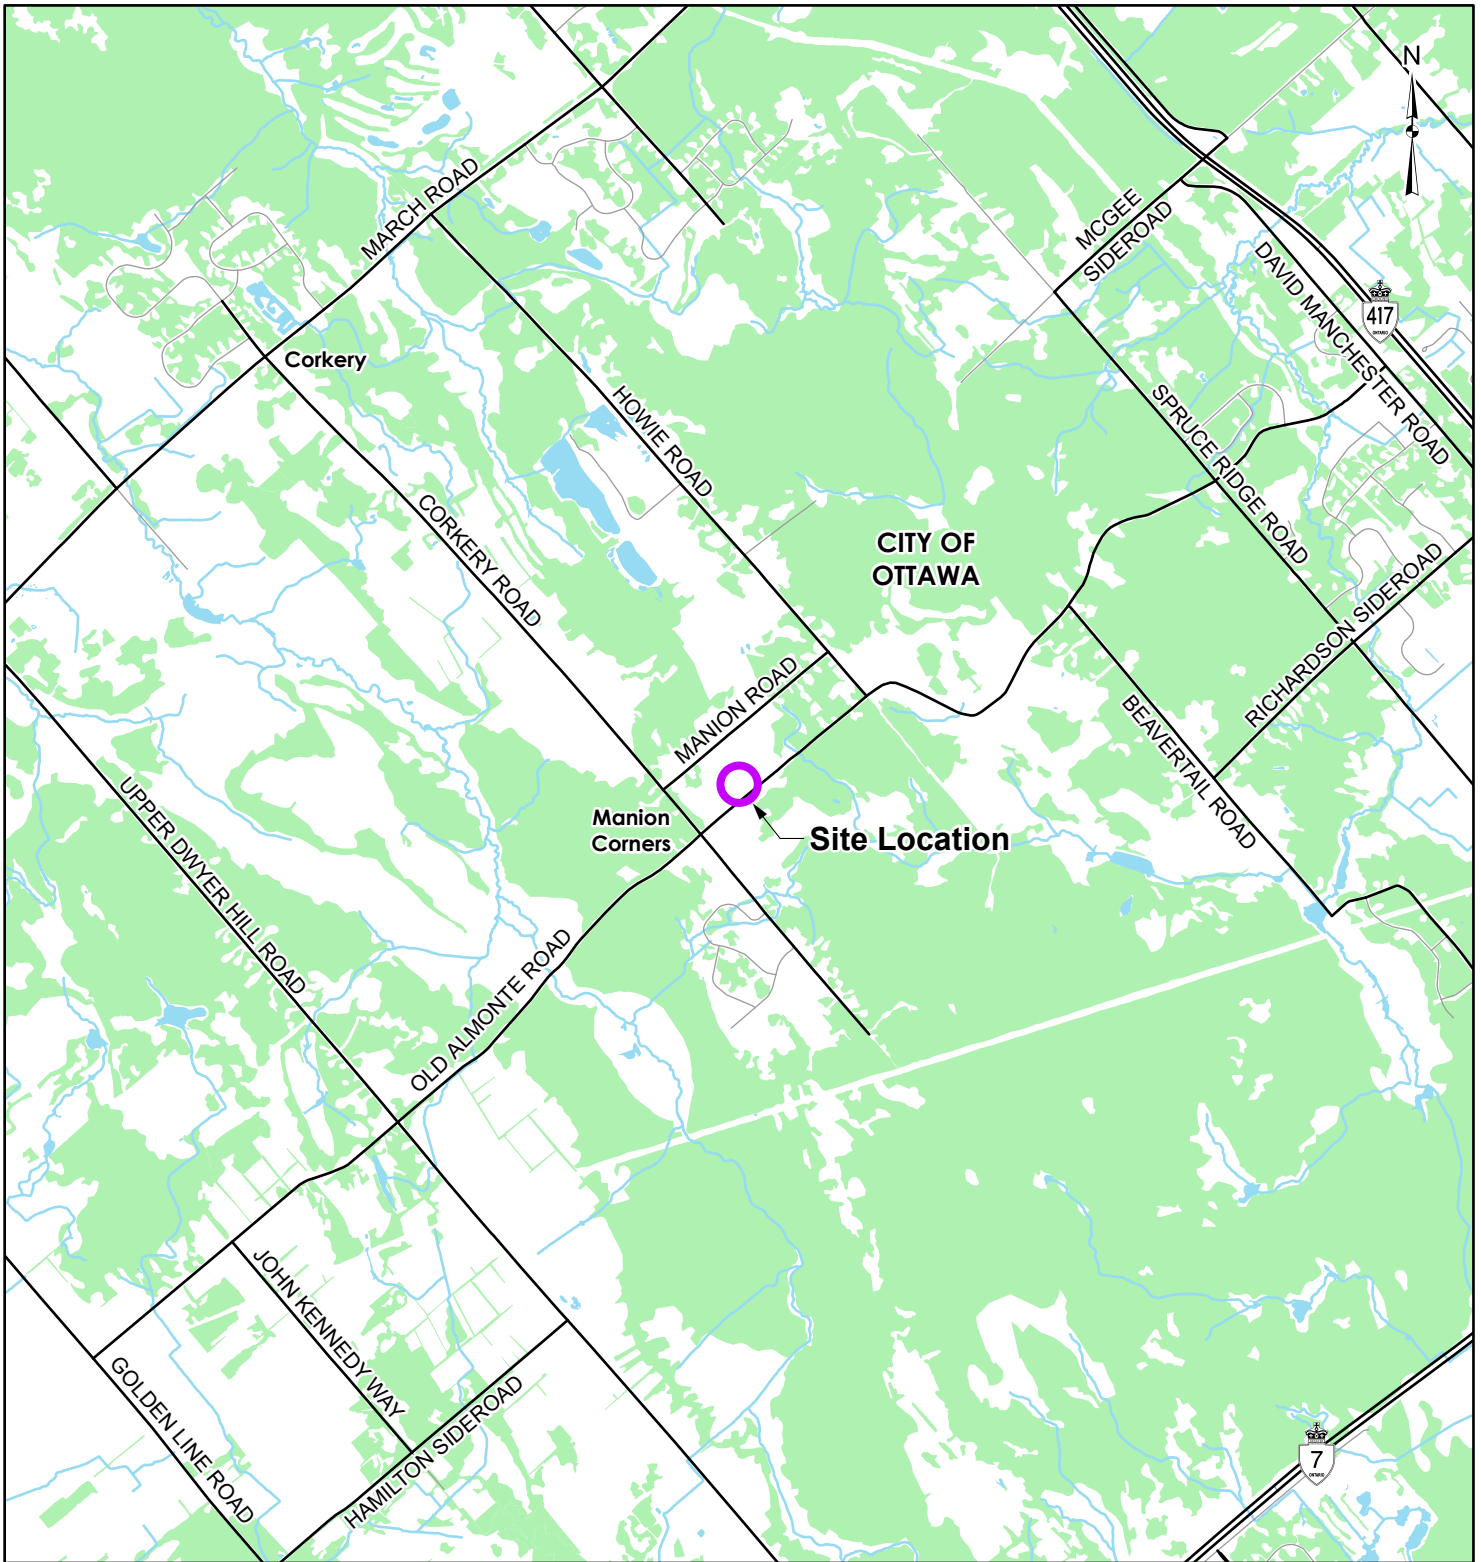

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



FIGURES





LEGEND

-  Site Location
-  Local Road
-  Major Road
-  Watercourse
-  Waterbody
-  Wooded Area

REFERENCE

GIS data provided by the Ontario Ministry of Northern Development, Mines, Natural Resources and Forestry, 2022.







| | | |
|---|---|----------------|
| CLIENT: | CITY OF OTTAWA | |
| PROJECT: | HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE | |
| TITLE: | SITE LOCATION | |
|  115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com | PROJECT NO: CCO-21-3339-01 | FIGURE: |
| | Date | Feb., 07, 2022 |
| | GIS | EU |
| Checked By | PM | 1 |

C:\Users\le.ungun\McIntosh_Perry\GIS - Documents\Projects\2021\CCO\CCO-21-3339-01 - City of Ottawa_Corkery Hall_Old Almonte.aprx\Environmental\HydroGI\CCO-21-3339-01_HydroG.aprx




LEGEND


-  Site Boundary
-  Lot & Concession
-  Unevaluated Wetland

-  TW1 Location


REFERENCE

GIS data provided by the Ontario Ministry of Northern Development, Mines, Natural Resources and Forestry, 2022.




| | | |
|--|---|----------------|
| CLIENT: | CITY OF OTTAWA | |
| PROJECT: | HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE | |
| TITLE: | SITE LAYOUT | |
|  115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com | PROJECT NO: CCO-21-3339-01 | FIGURE: |
| | Date | Feb., 07, 2022 |
| | Checked By | PM |
| | | 2 |

C:\Users\leungun\McIntosh_Perry\GIS - Documents\Projects\2021\CCO\CCO-21-3339-01_City of Ottawa_Corkery Hall_Old Almonte\aprx\Environmental\Hydro\CCO-21-3339-01_HydroG.aprx

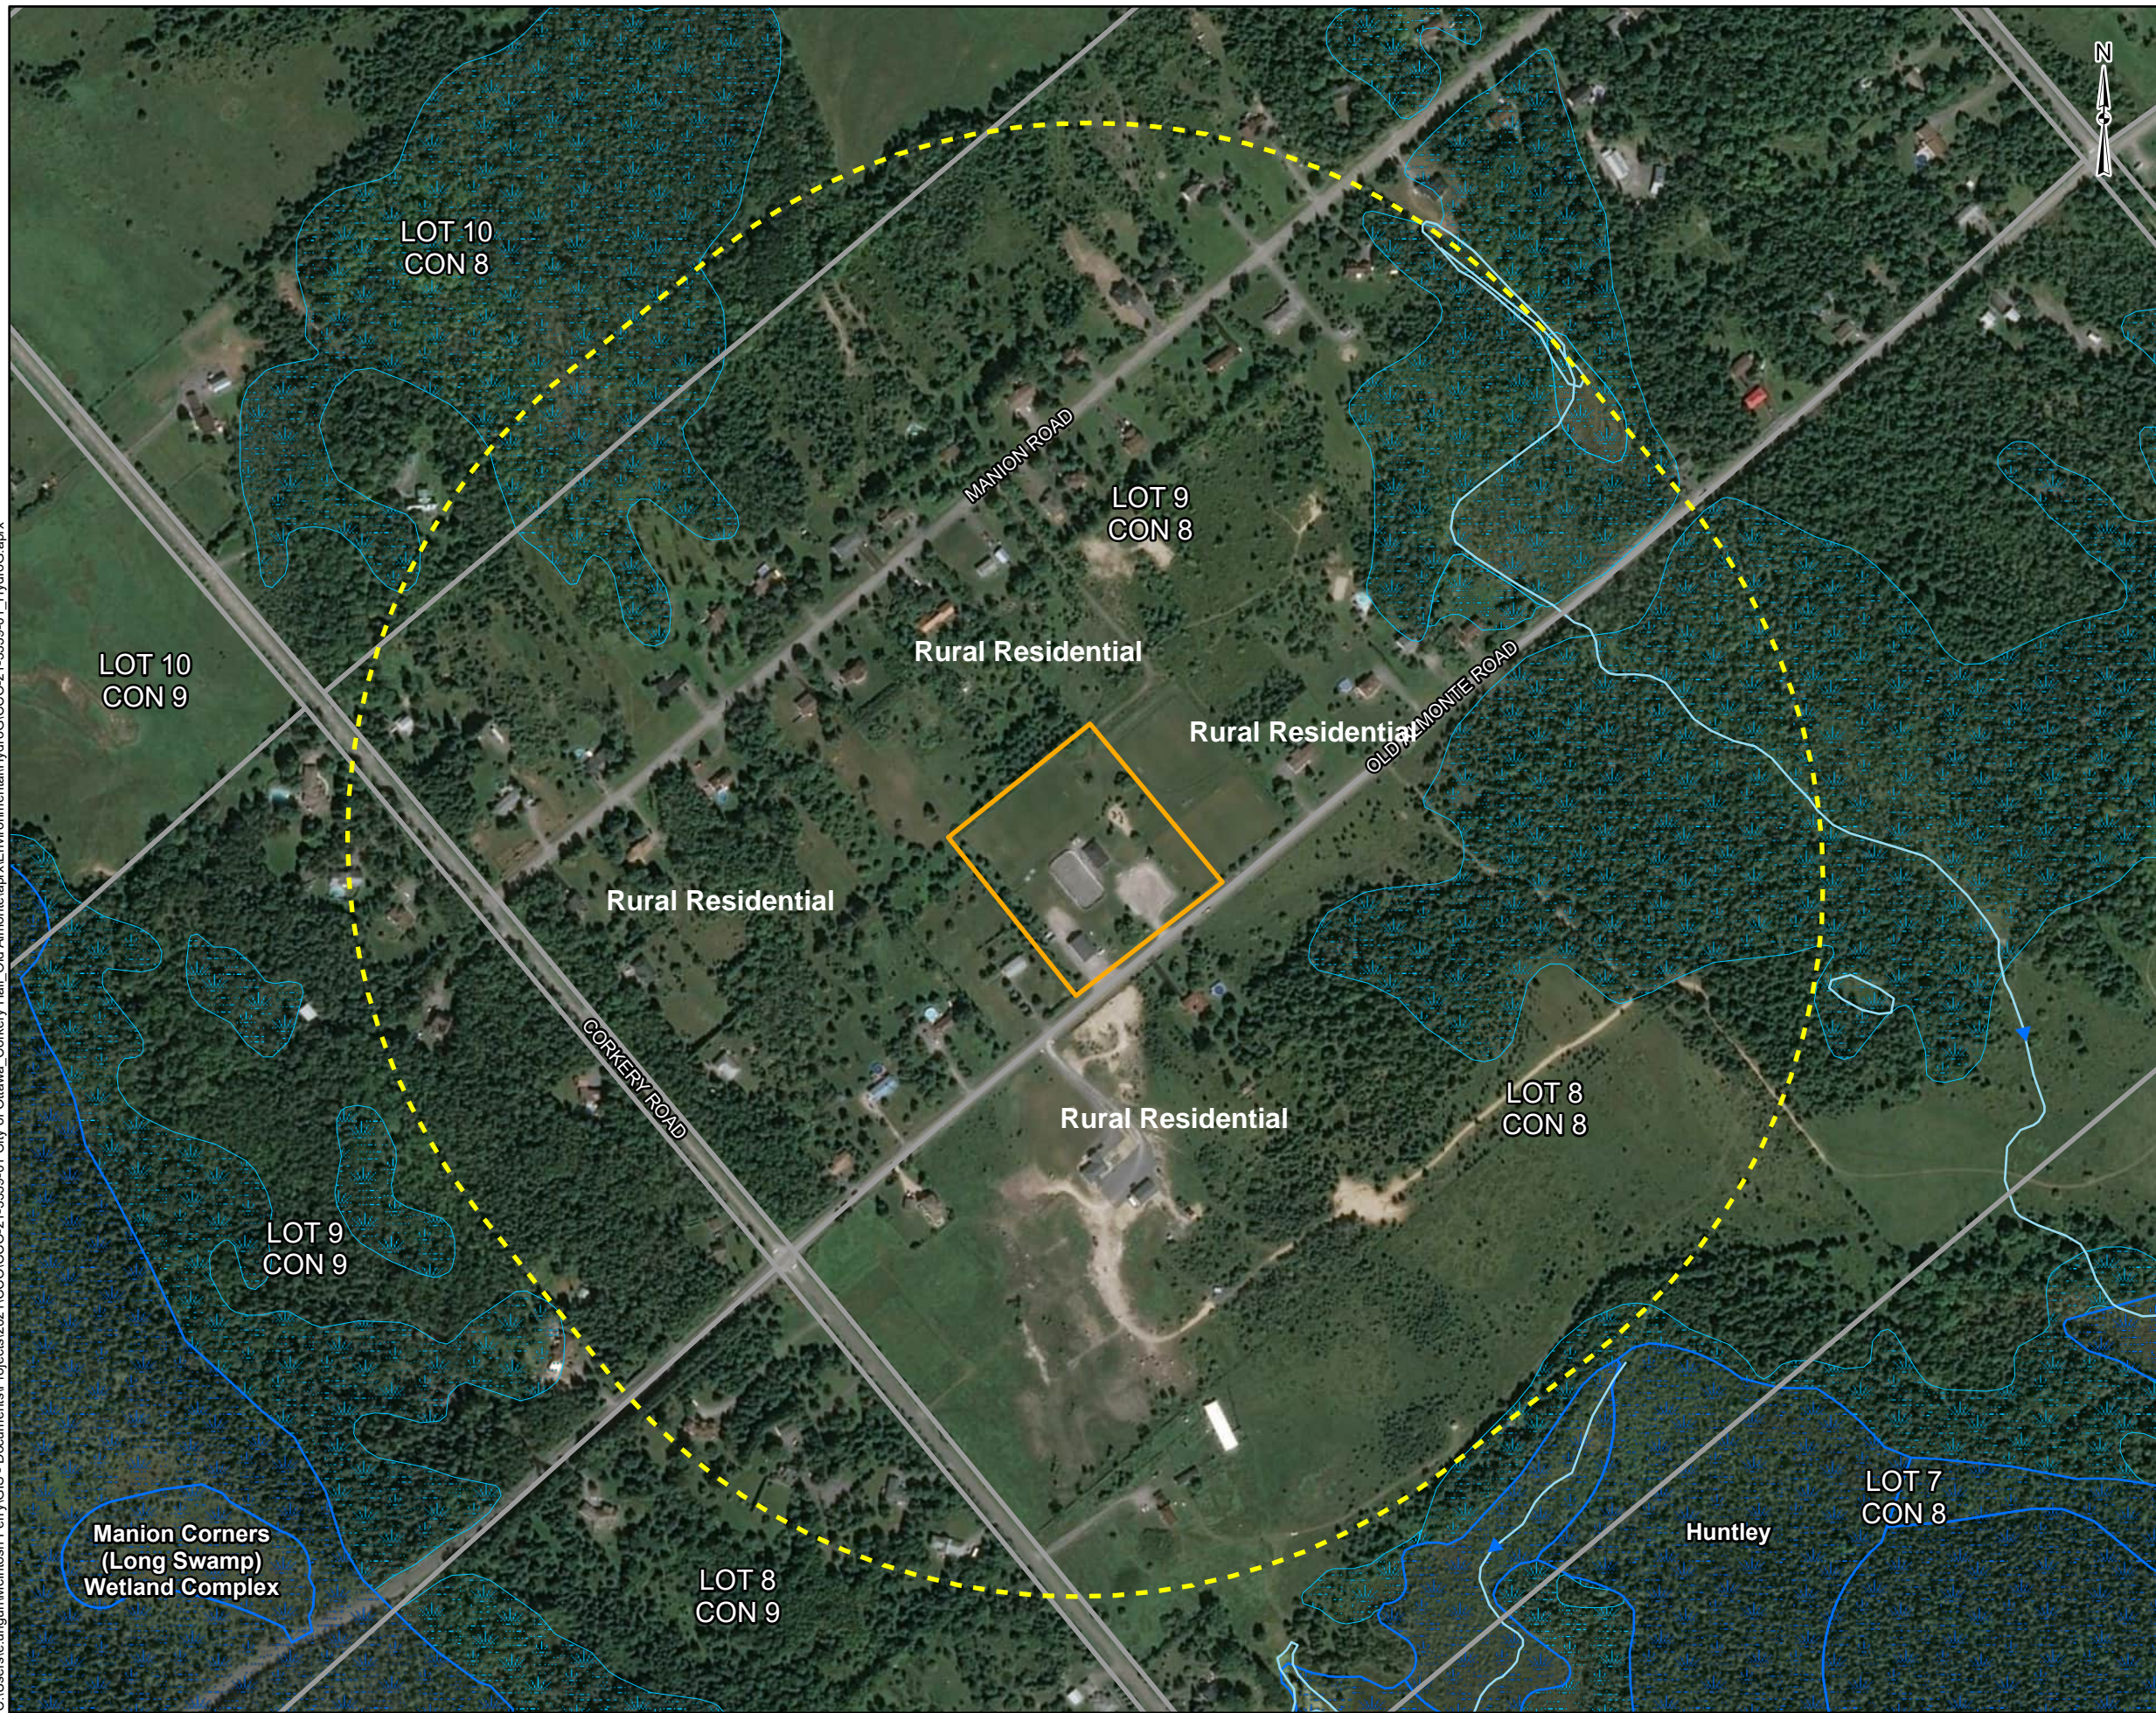


- LEGEND**
- Site Boundary
 - 500m Buffer
 - Lot & Concession
 - ~ Watercourse
 - Waterbody
 - Unevaluated Wetland
 - Provincially Significant Wetland

REFERENCE
 GIS data provided by the Ontario Ministry of Northern Development, Mines, Natural Resources and Forestry, 2022.



| | | |
|---|---|----------------|
| CLIENT: | CITY OF OTTAWA | |
| PROJECT: | HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE | |
| TITLE: | SURROUNDING LAND USE | |
| McINTOSH PERRY <small>115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com</small> | PROJECT NO: CCO-21-3339-01 | FIGURE: |
| | Date | Feb., 07, 2022 |
| | Checked By | PM |
| | | 3 |


C:\Users\leungun\McIntosh_Perry\GIS - Documents\Projects\2021\CCO\CCO-21-3339-01_City of Ottawa_Corkery Hall_Old Almonte\aprx\Environmental\Hydro\CCO-21-3339-01_HydroG.aprx

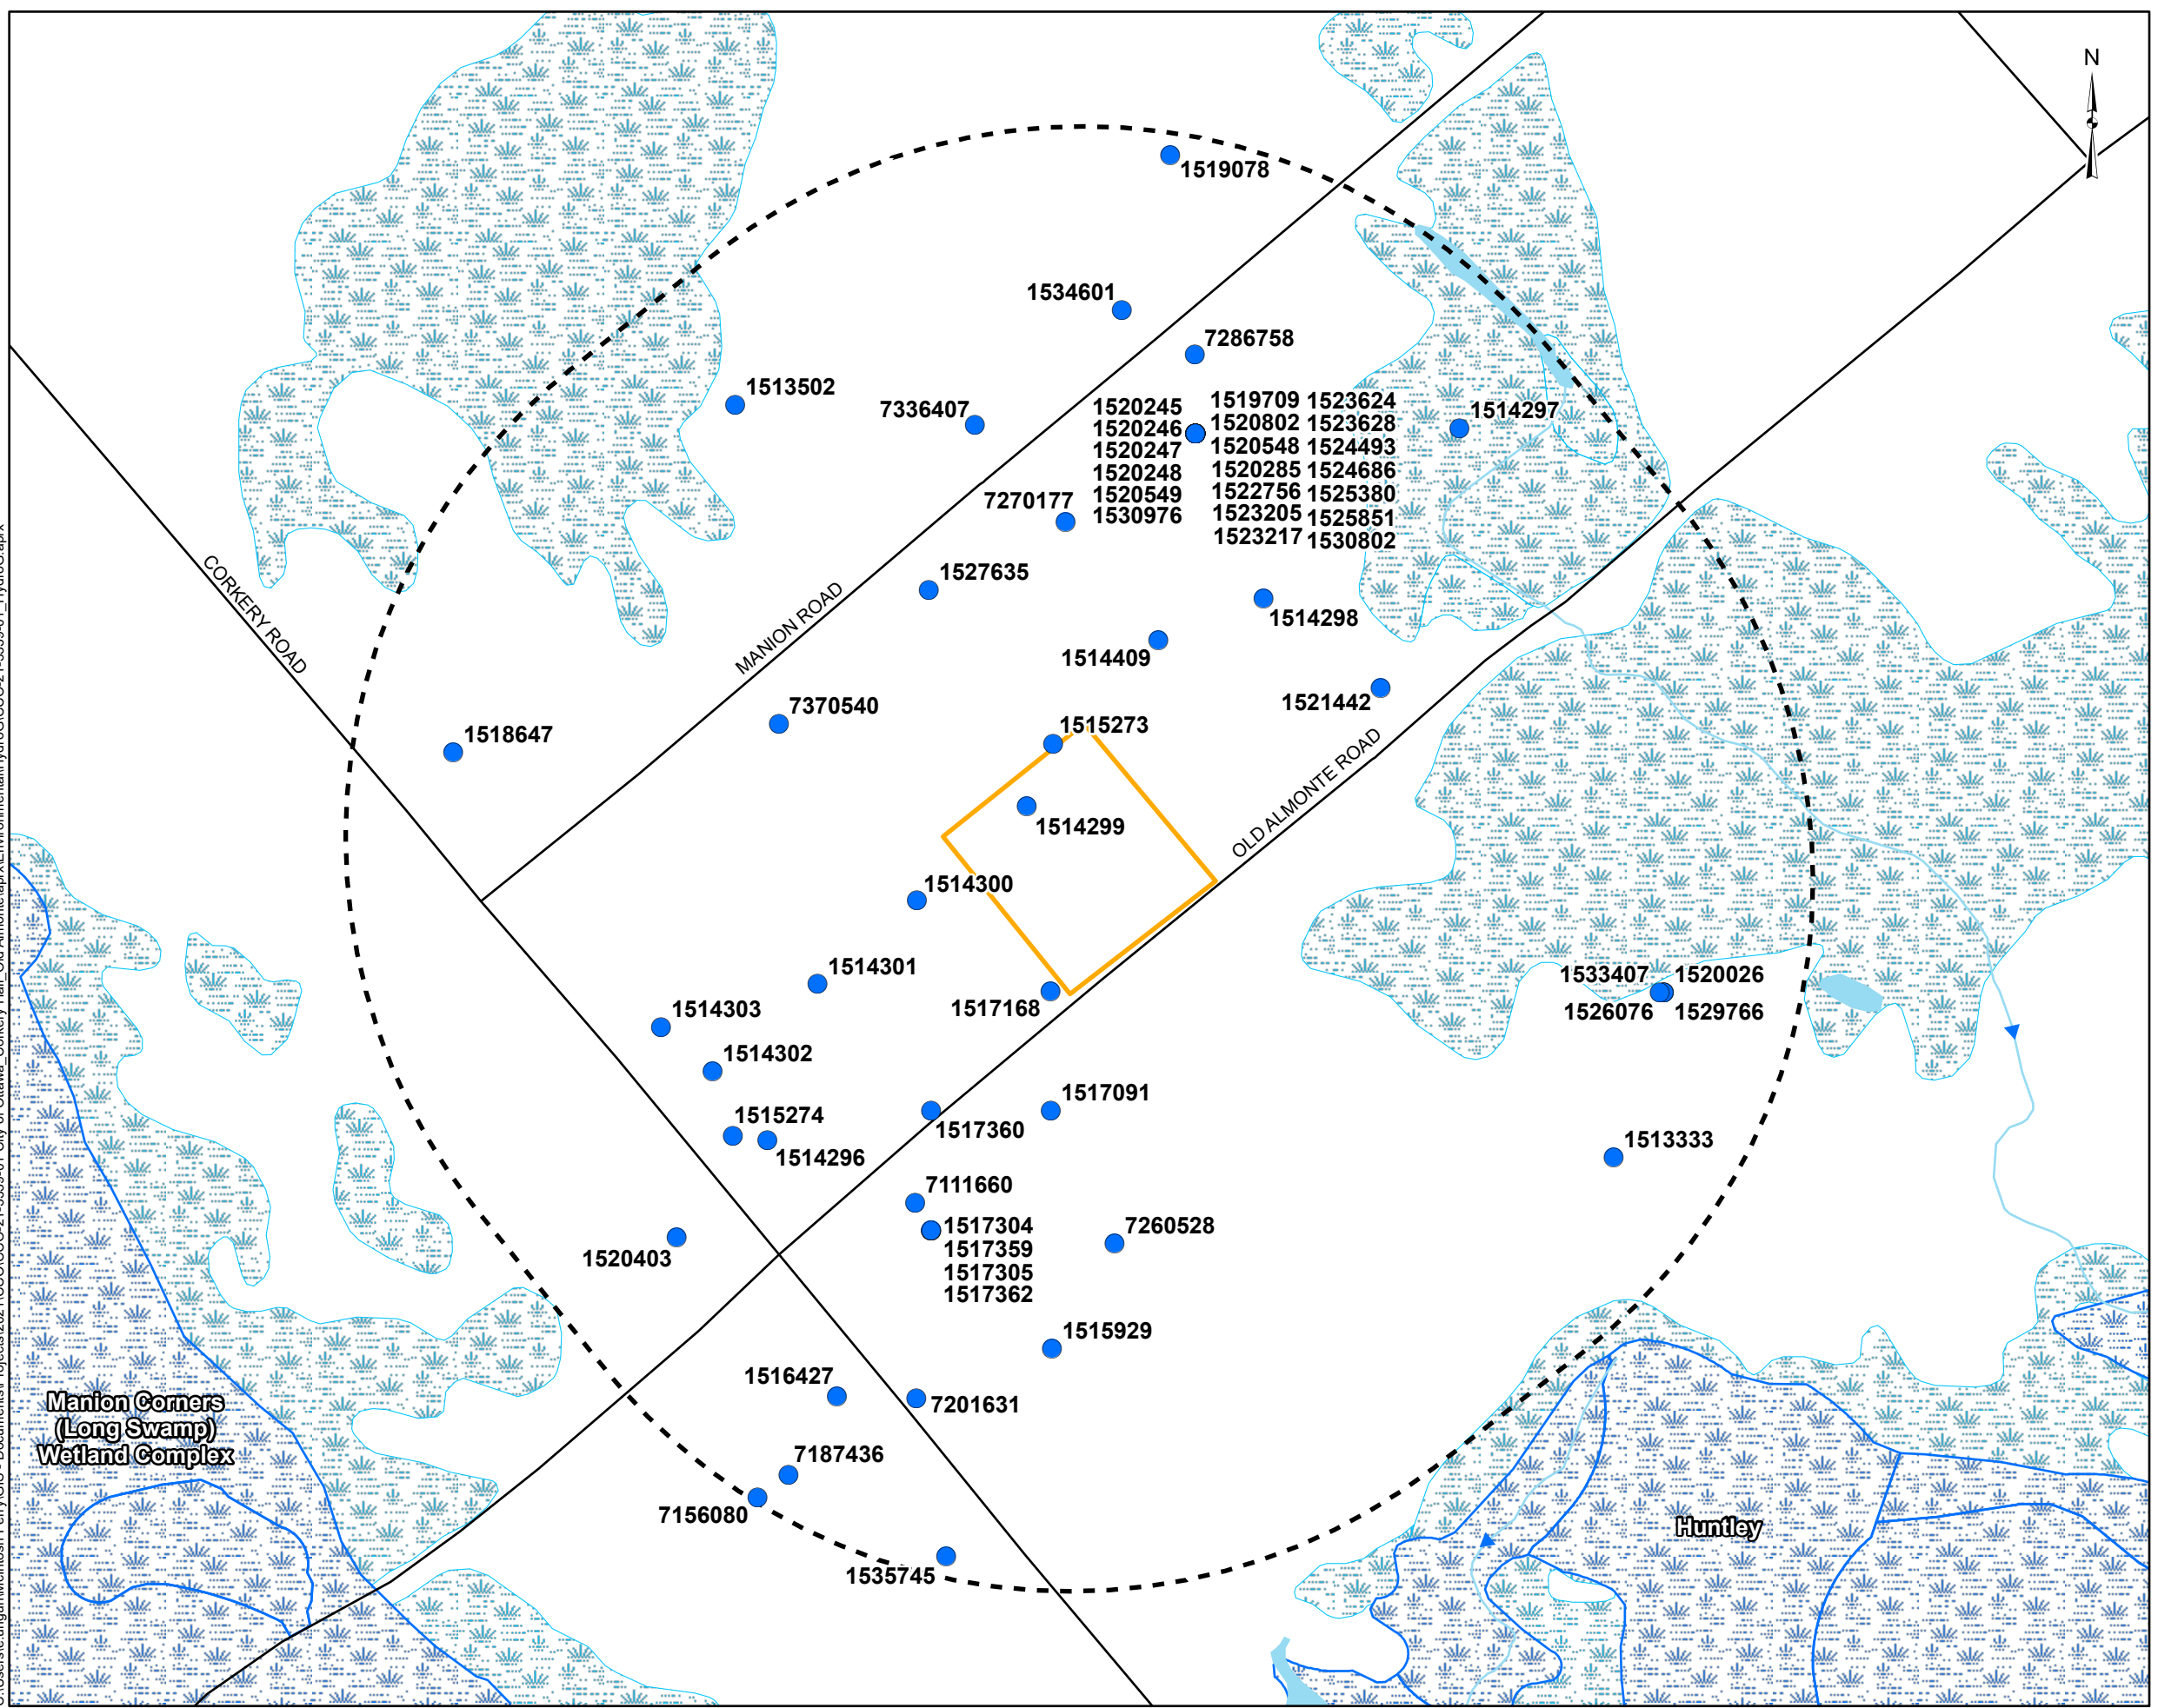

LEGEND


- Site Boundary
- 500m Buffer
- MECP Well Location
- Local Road
- Major Road
- Waterbody
- Watercourse
- Unevaluated Wetland
- Provincially Significant Wetland

REFERENCE
 GIS data provided by the Ontario Ministry of Northern Development, Mines, Natural Resources and Forestry, 2022.



| | | |
|--|---|----------------|
| CLIENT: | CITY OF OTTAWA | |
| PROJECT: | HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE | |
| TITLE: | MECP WWIS SUMMARY | |
| <small>115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com</small> | PROJECT NO: CCO-21-3339-01 | FIGURE: |
| | Date | Feb., 07, 2022 |
| | GIS | EU |
| Checked By | PM | 4 |

C:\Users\le.ungun\McIntosh_Perry\GIS - Documents\Projects\2021\CCO\CCO-21-3339-01 - City of Ottawa_Corkery Hall_Old Almonte.aprx\Environmental\HydroGI\CCO-21-3339-01_HydroG.aprx

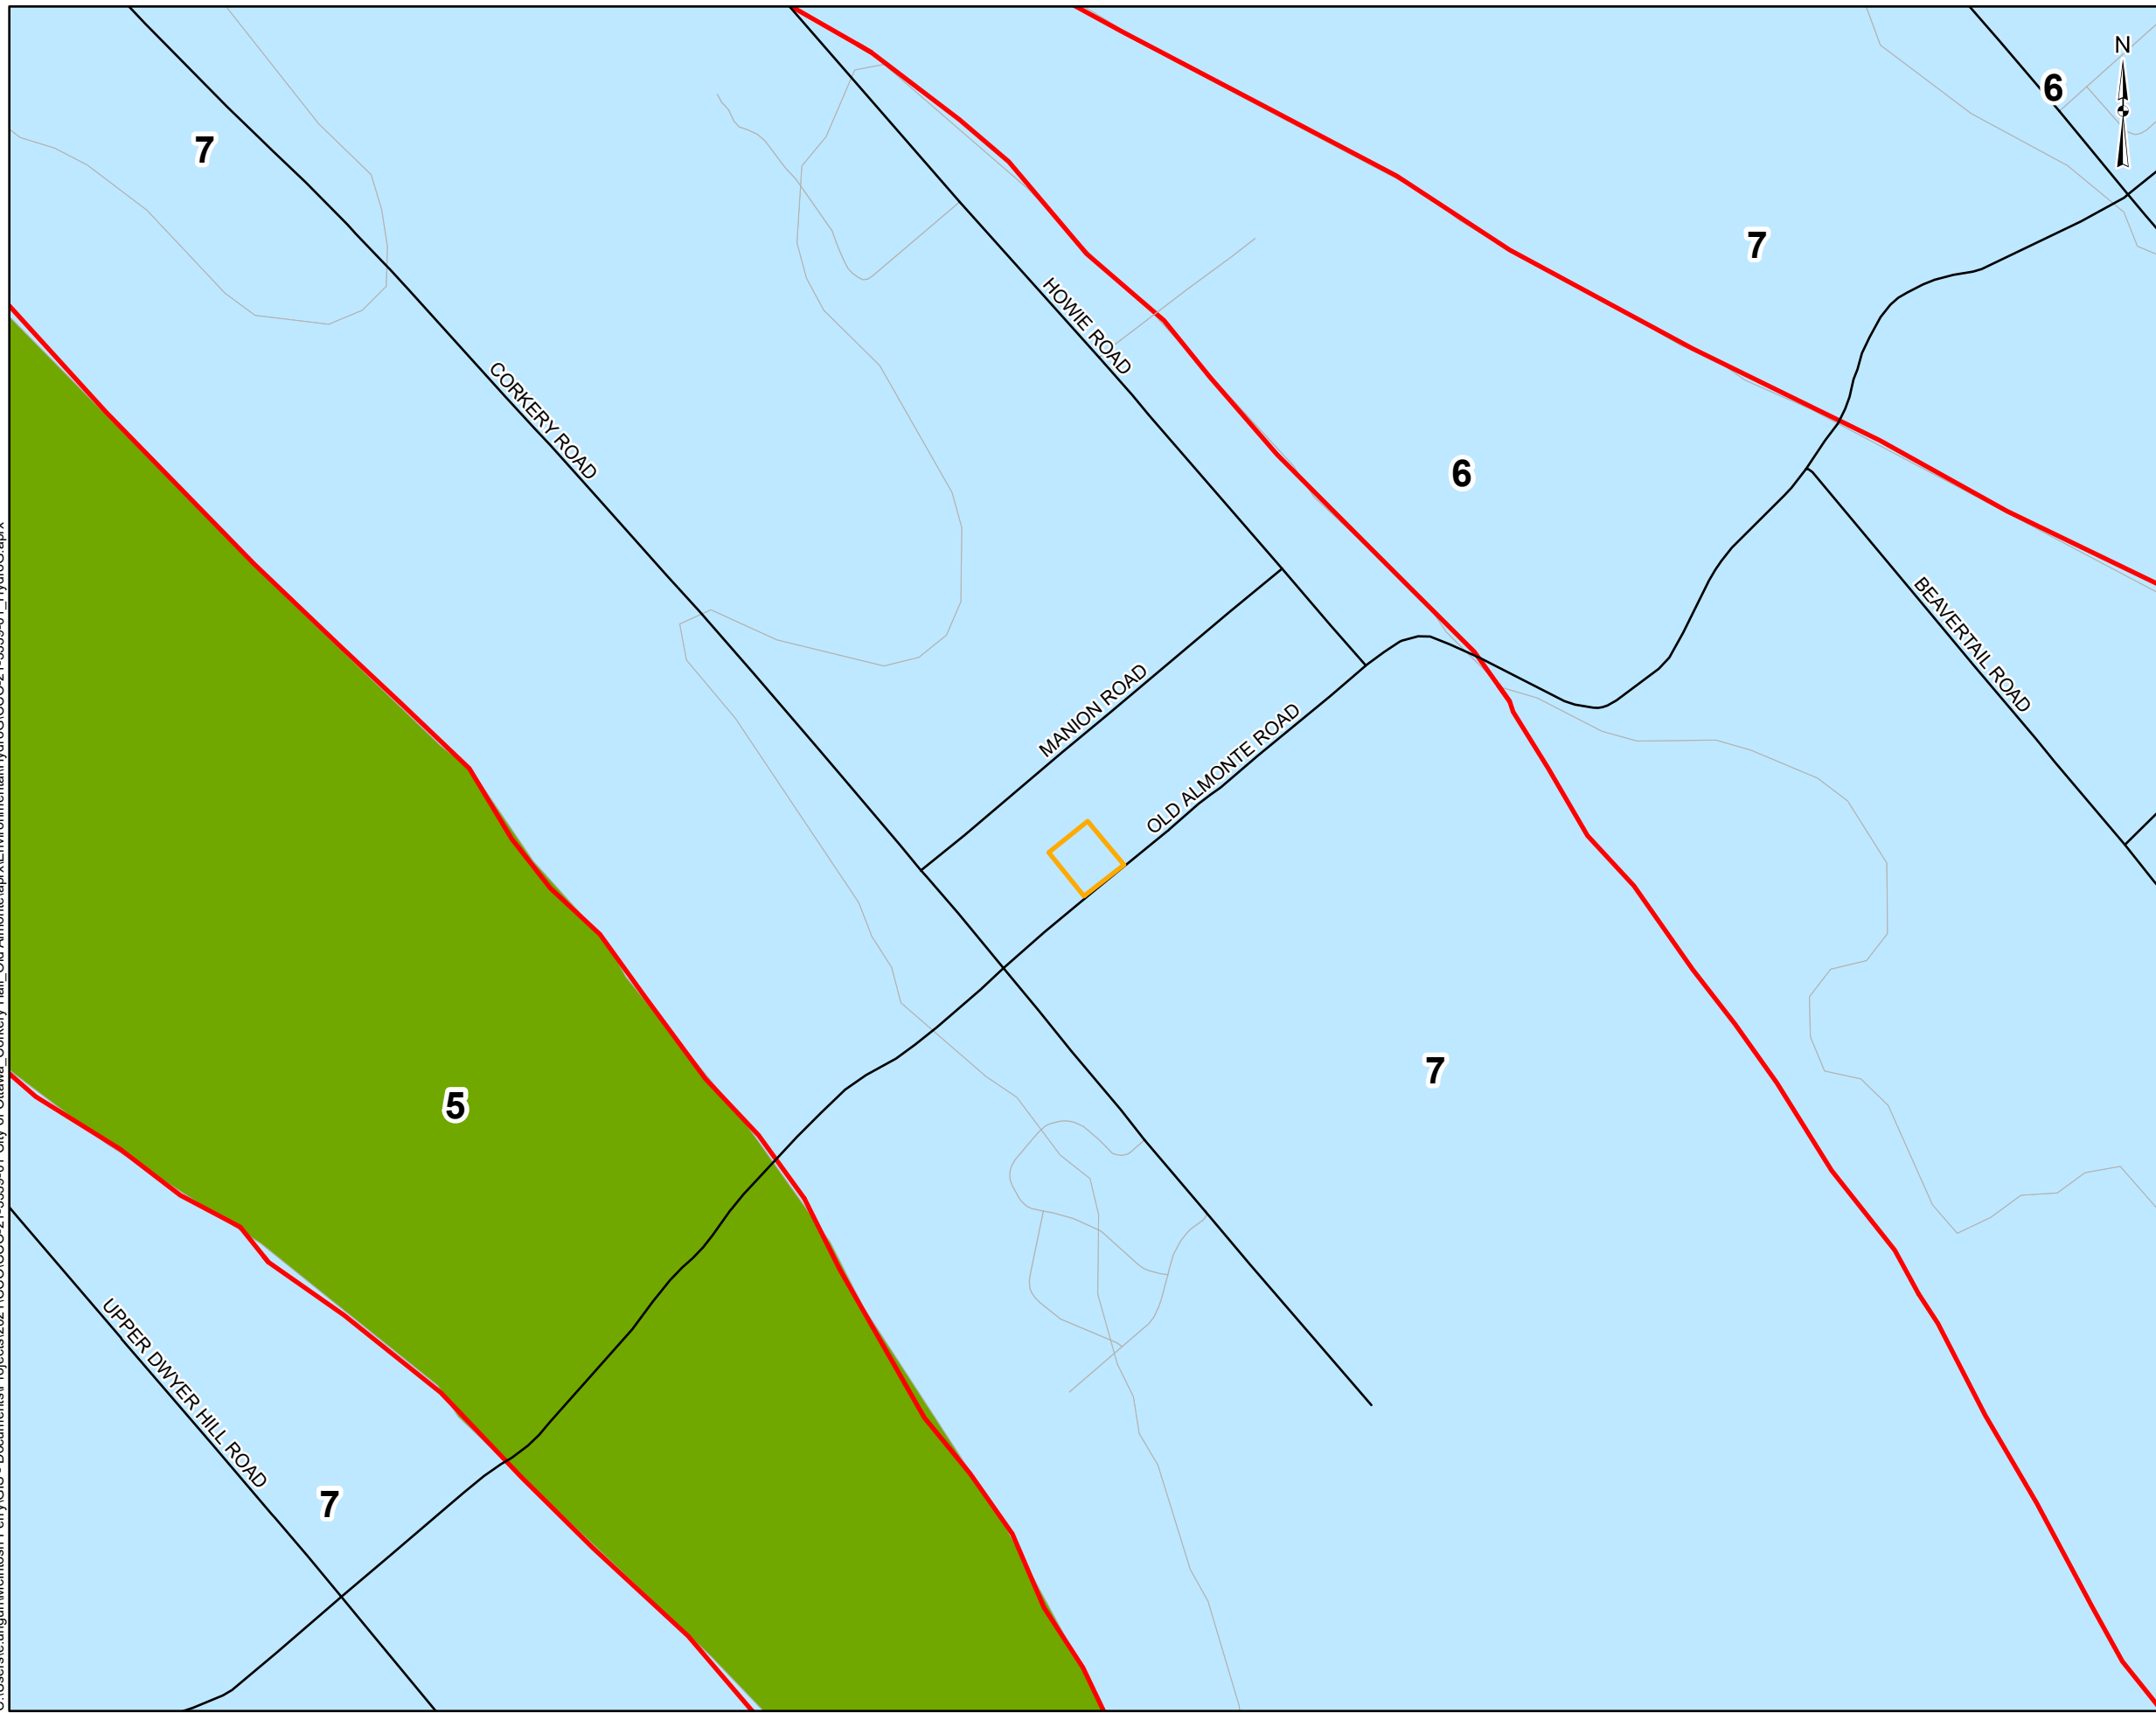

LEGEND


- Site Boundary
- Local Road
- Major Road
- Fault

Middle to Upper Ordovician

- 7** Bobcaygeon Formation: Interbedded silty dolomite, lithographic to fine crystalline limestone, oolitic limestone, shale, and fine-grained calcareous quartz sandstone
- 6** Gull River Formation: Interbedded silty dolomite, lithographic to fine crystalline limestone, oolitic limestone, shale, and fine-grained calcareous quartz sandstone
- 5** Rockliffe Formation: Interbedded fine-grained light greenish grey quartz sandstone, shaley limestone and shale, locally conglomerate at base, interbeds of calcarenite and silty dolostone in upper part


REFERENCE

GIS data provided by the Ontario Ministry of Natural Resources and Forestry, 2022.
 Urban Geology of the National Capital Area, Bélanger, R;
 Geological Survey of Canada, Open File 5311, 2008



| | | |
|---|---|----------------|
| CLIENT: | CITY OF OTTAWA | |
| PROJECT: | HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE | |
| TITLE: | BEDROCK FORMATION | |
| McINTOSH PERRY <small>115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com</small> | PROJECT NO: CCO-21-3339-01 | FIGURE: |
| | Date | Feb., 07, 2022 |
| | GIS | EU |
| | Checked By | PM |
| | | 5 |

C:\Users\le.ungun\McIntosh_Perry\GIS - Documents\Projects\2021\CCO\CCO-21-3339-01_City of Ottawa_Corkery Hall_Old Almonte\aprx\Environmental\Hydro\GIS\CCO-21-3339-01_HydroG.aprx

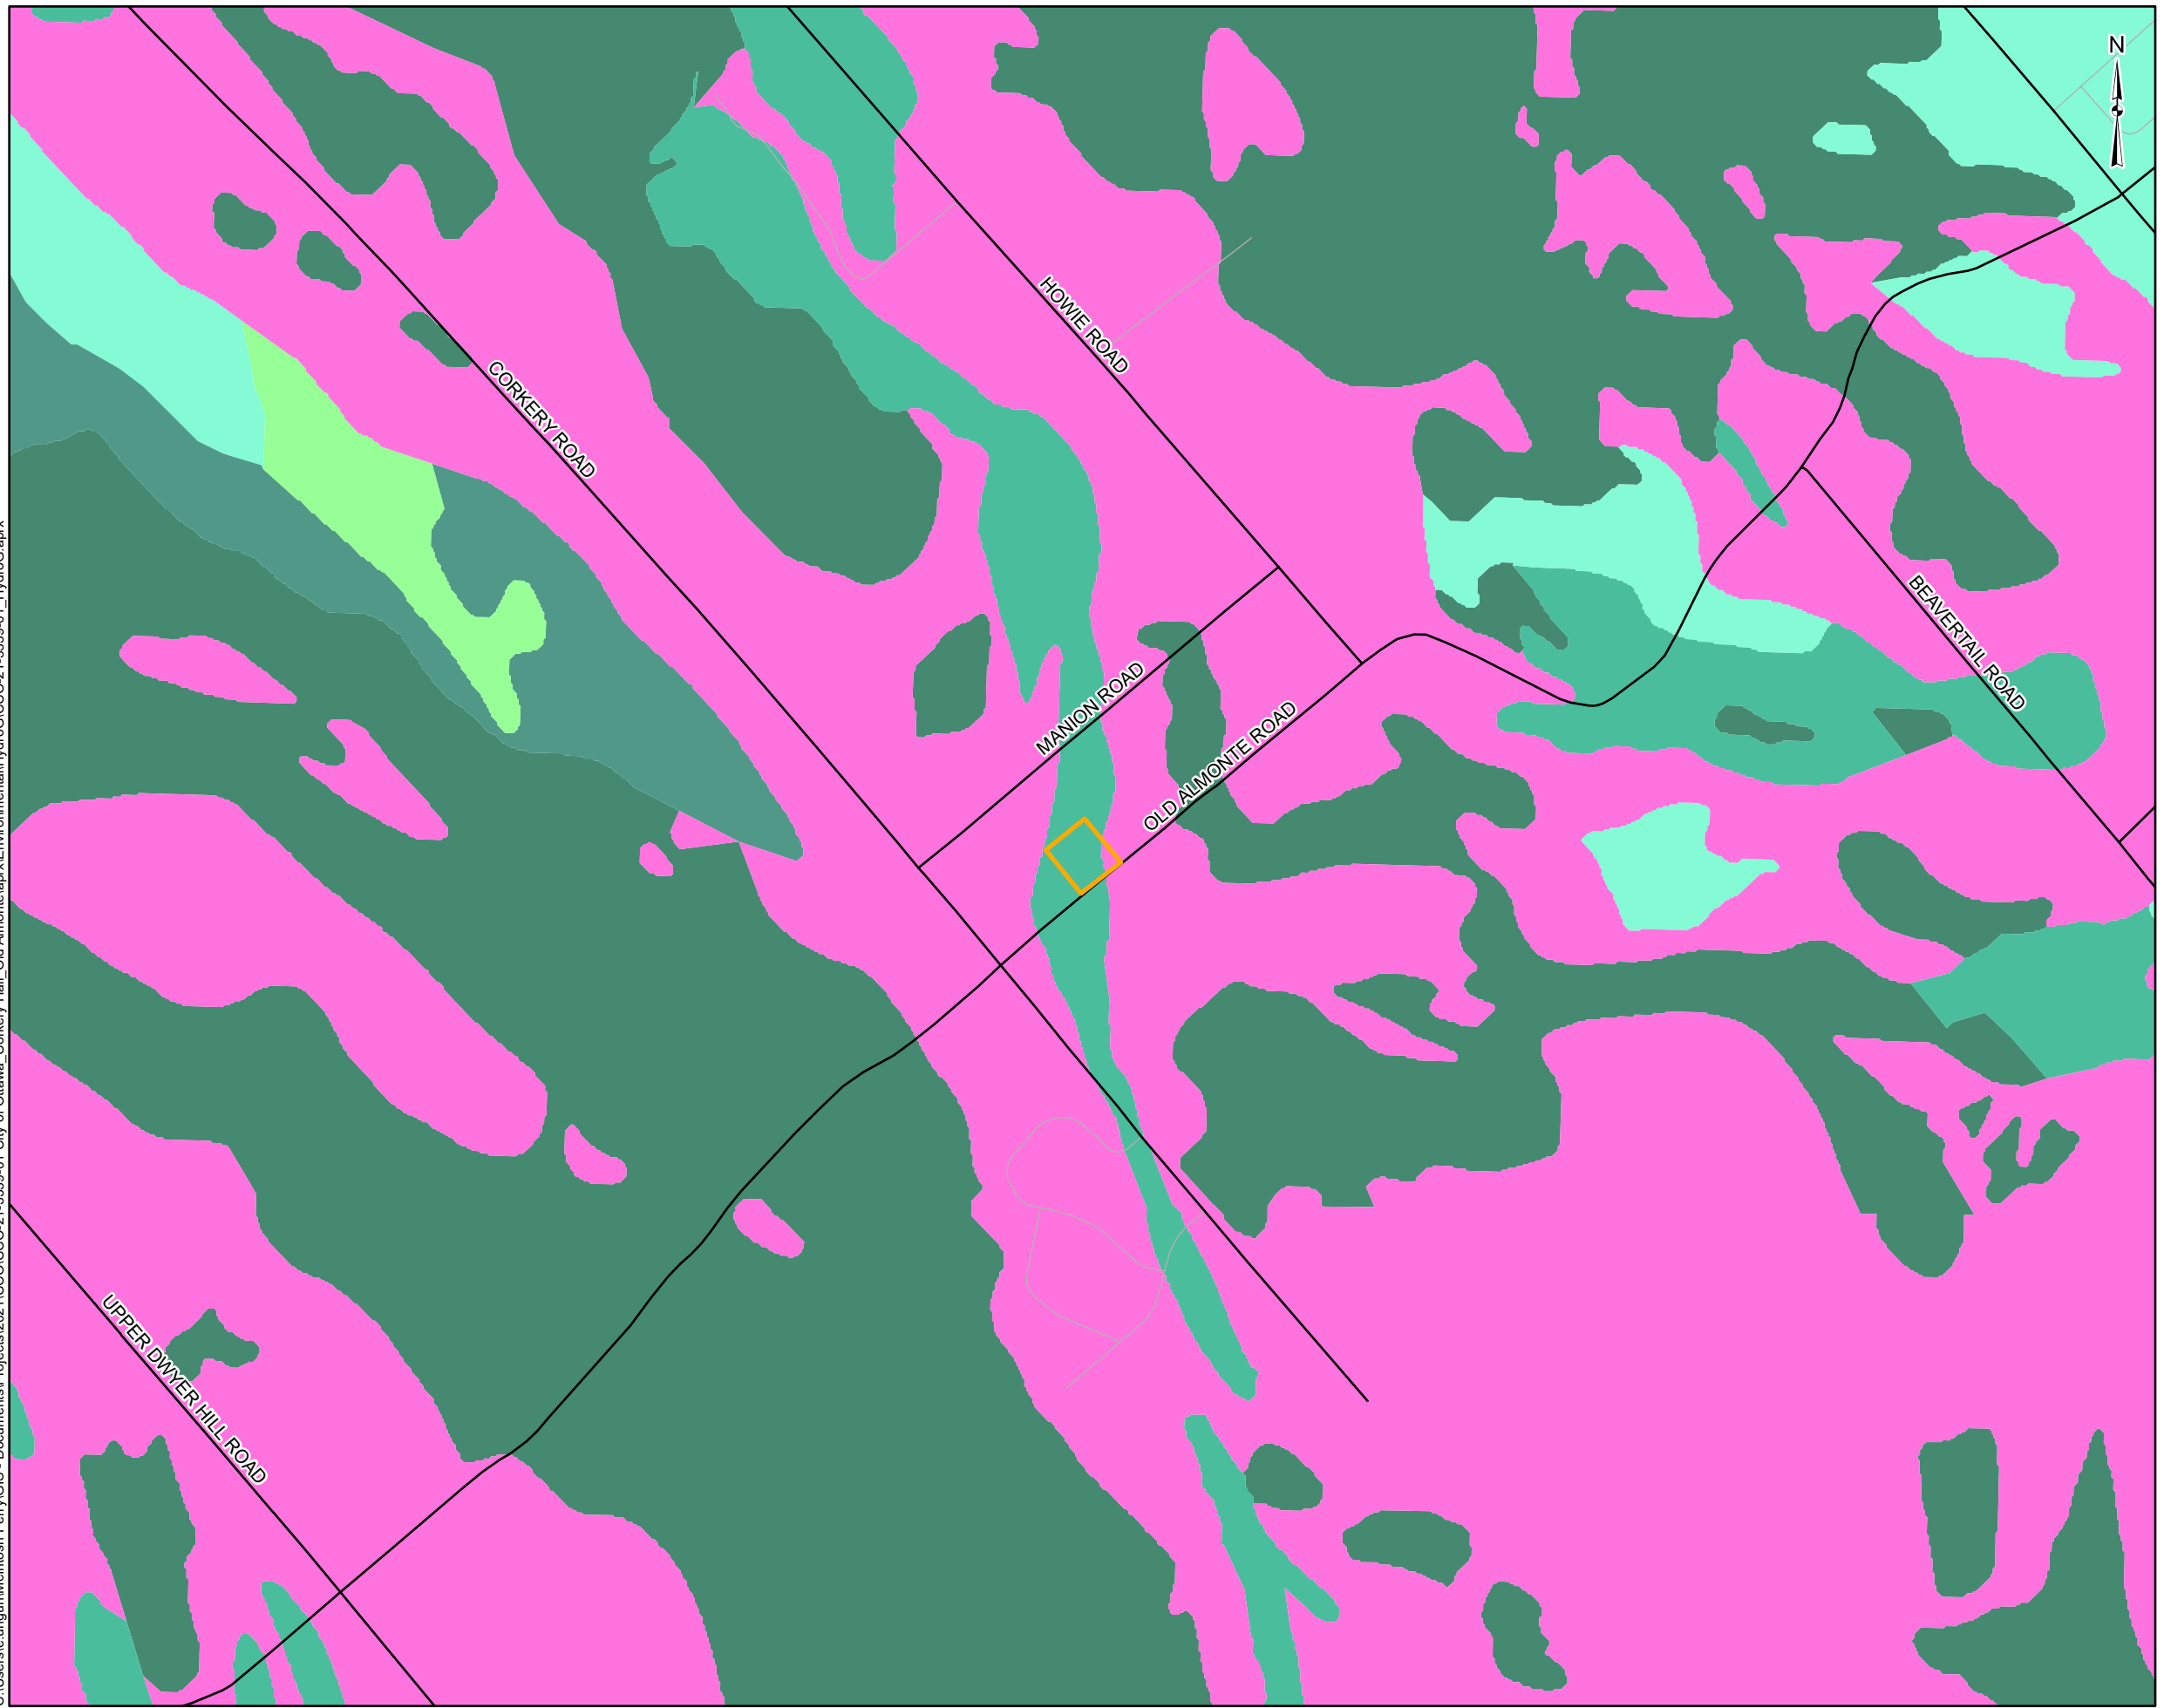

LEGEND


- Site Boundary
- Local Road
- Major Road

Surficial geology

- Organic Deposits
- Beach Formations
- Sand, reworked glaciofluvial
- Marine Deposits, clay, silt
- Till, plain
- Paleozoic Bedrock




REFERENCE

GIS data provided by the Ontario Ministry of Natural Resources and Forestry, 2022.
 Surficial Geology of Southern Ontario provided by the Ontario Geological Survey, Miscellaneous Release - Data 128 - Revised



| | | |
|--|---|----------------|
| CLIENT: | CITY OF OTTAWA | |
| PROJECT: | HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE | |
| TITLE: | SURFICIAL GEOLOGY | |
| <small>115 Walgreen Road, RR3, Carp, ON K0A1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.mcintoshperry.com</small> | PROJECT NO: CCO-21-3339-01 | FIGURE: |
| | Date | Feb., 07, 2022 |
| | Checked By | PM |
| | | 6 |

FILENAME: U:\Ottawa\01 Project - Proposals\2021 Jobs\CCO-21-3339 - CSV Corkery Hill - 3447 Old Almonte Road\CCO-21-3339-01\Terrain Analysis\PCO-21-3339_Test Pit Layout June 9, 2023.dwg
 LAST SAVED: Tuesday, June 13, 2023 10:23:23 AM
 LAST PRINTED: Wednesday, June 14, 2023 10:08:00 AM
 CIP FILE USED: ---

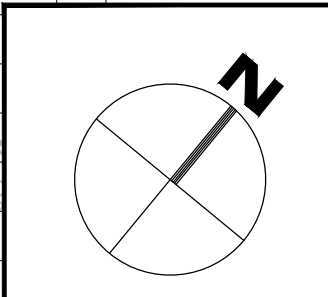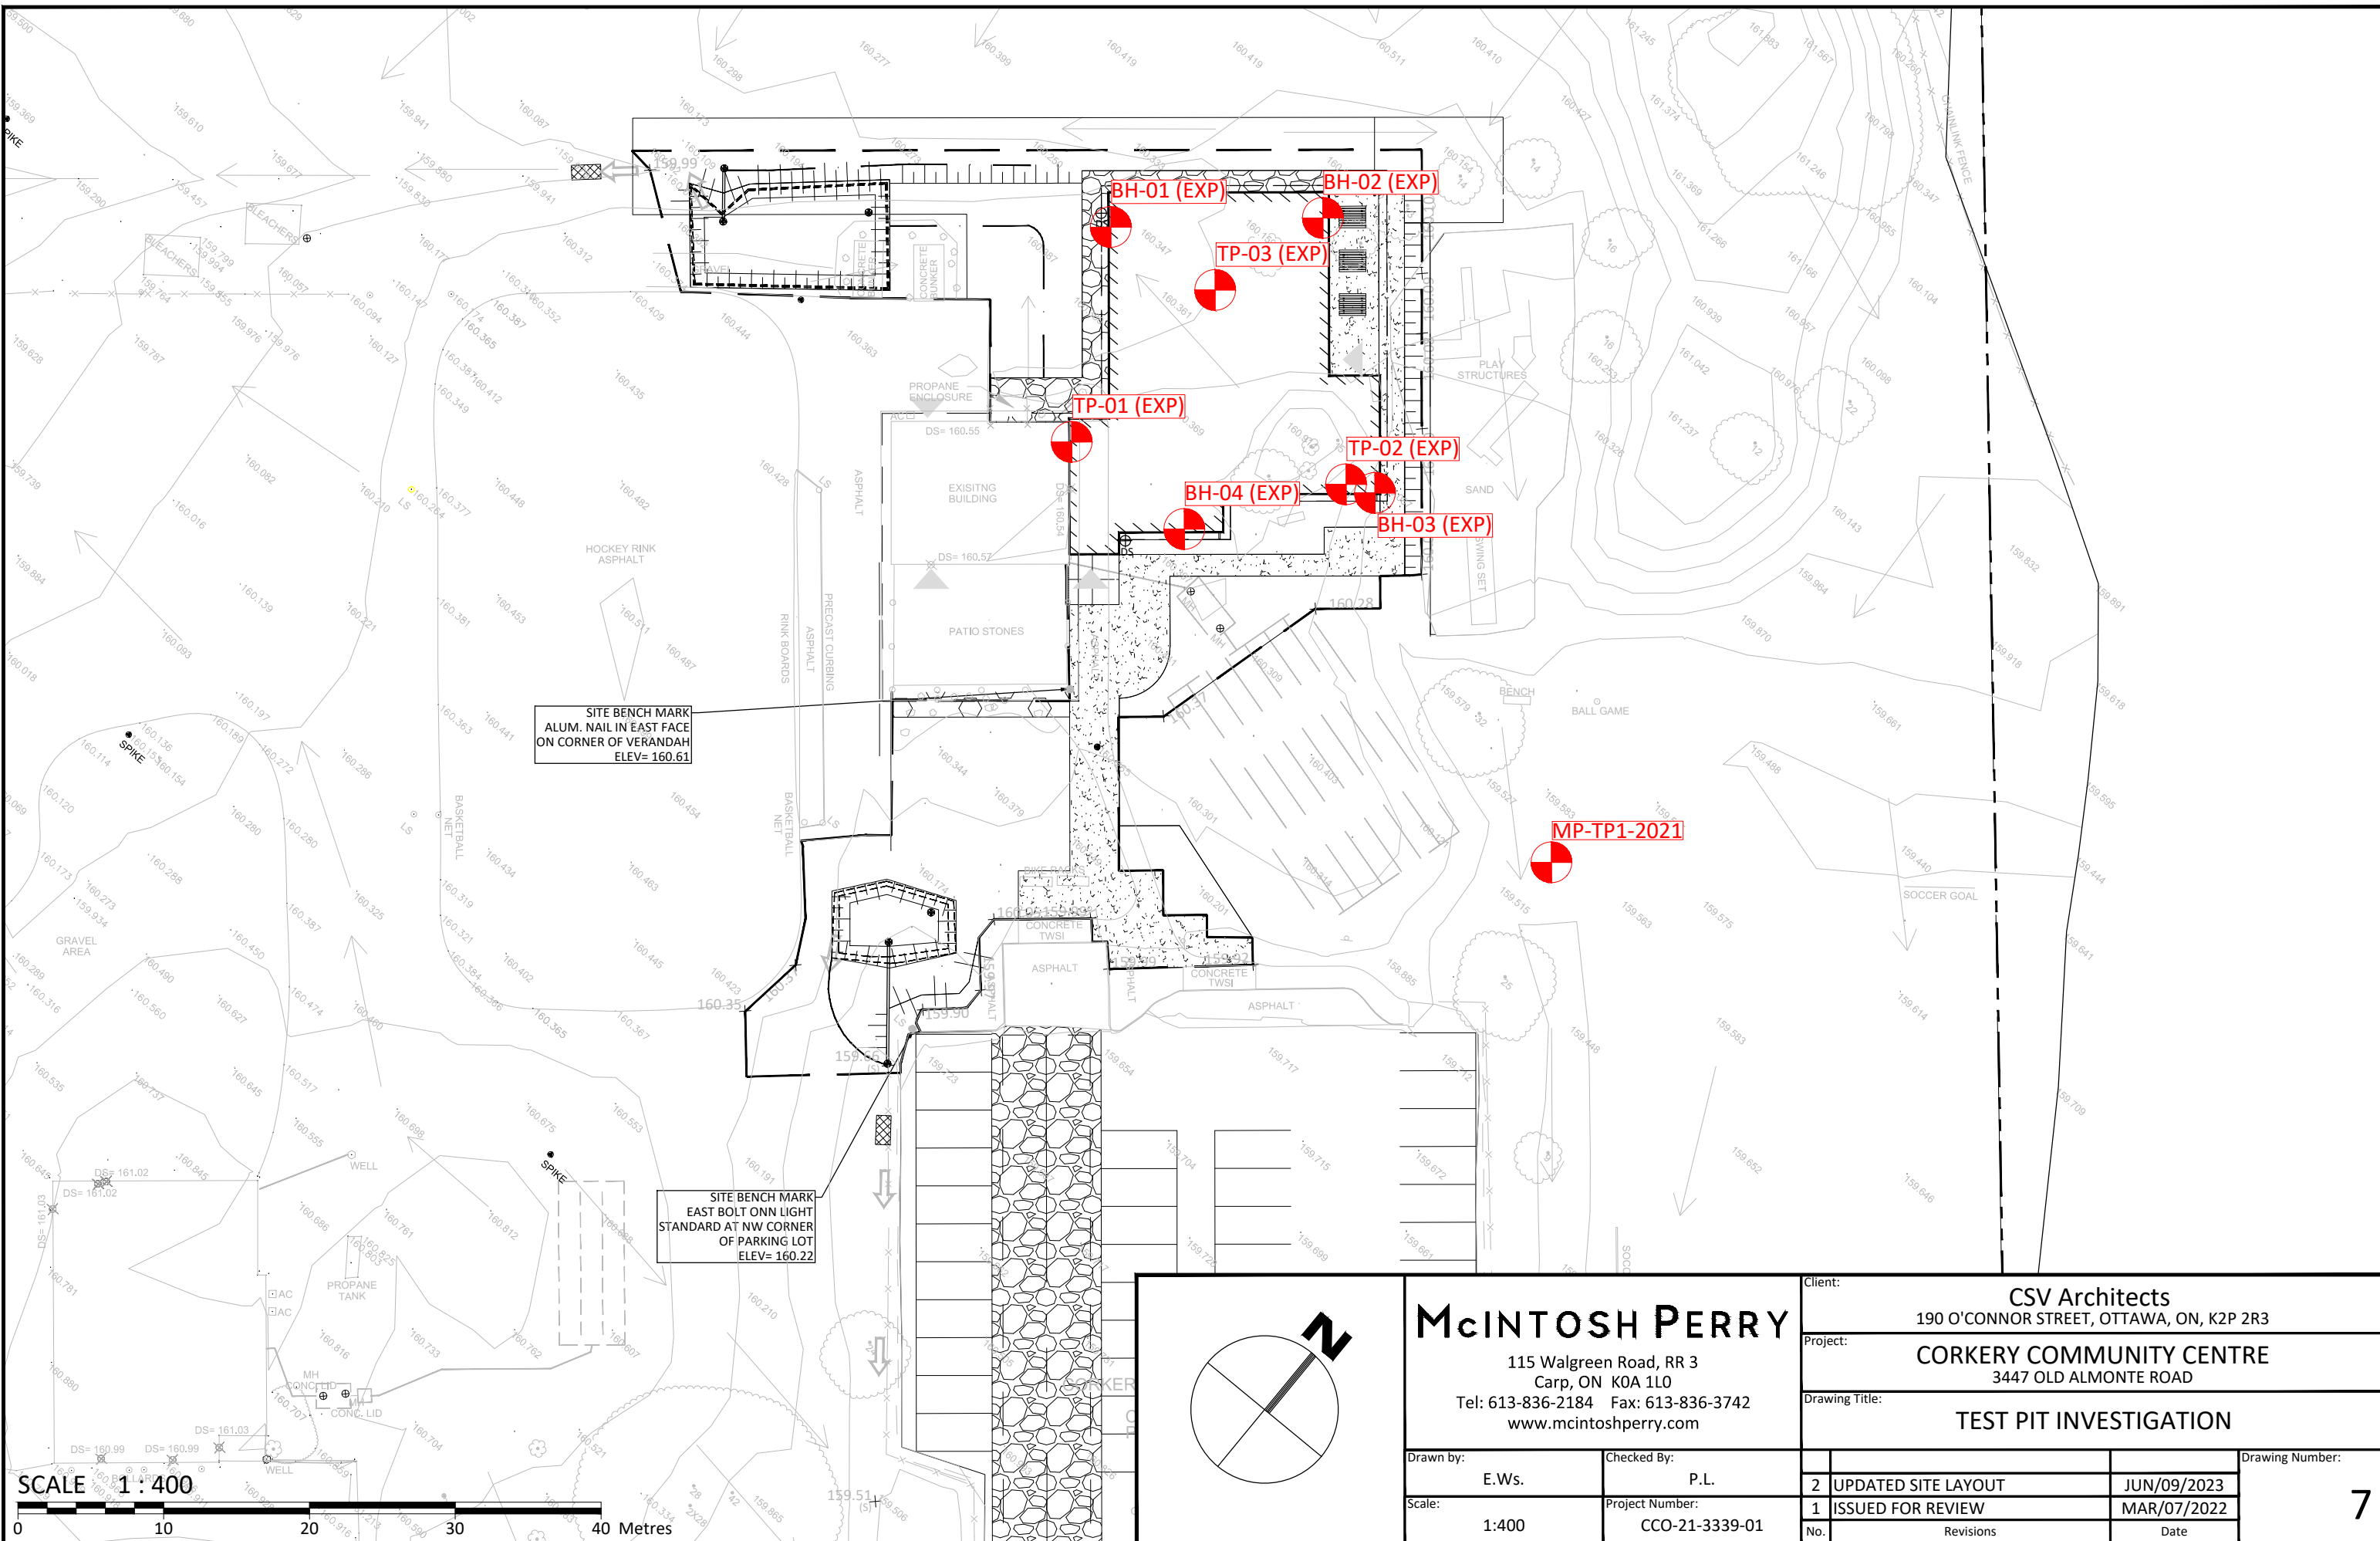

McINTOSH PERRY
 115 Walgreen Road, RR 3
 Carp, ON K0A 1L0
 Tel: 613-836-2184 Fax: 613-836-3742
 www.mcintoshperry.com

| | |
|-----------|-----------------|
| Drawn by: | Checked By: |
| E. Ws. | P. L. |
| Scale: | Project Number: |
| 1:400 | CCO-21-3339-01 |

| | | |
|-----------------|--|-------------|
| Client: | CSV Architects 190 O'CONNOR STREET, OTTAWA, ON, K2P 2R3 | |
| Project: | CORKERY COMMUNITY CENTRE 3447 OLD ALMONTE ROAD | |
| Drawing Title: | TEST PIT INVESTIGATION | |
| Drawing Number: | 2 | JUN/09/2023 |
| | 1 | MAR/07/2022 |
| No. | Revisions | Date |

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



TABLES

Table 1
Summary of Laboratory Results
3447 Old Almonte Road, Ottawa ON
Corkery Community Centre

| Sample ID | Units | MDL | ODWSOG | Limit Type | TW1-01 | TW1-02 | TW2 |
|---|------------|--------|--------|------------|-----------------------|--------------------------------------|-------------|
| Sample Date | | | | | 03-Feb-22 | | |
| Location | | | | | 3447 Old Almonte Road | 3449 Old Almonte Road (Fire Station) | |
| Parameter: | | | | | | | |
| Microbiological Parameters | | | | | | | |
| E. Coli | CFU/100 mL | 1 | 0 | MAC | ND (1) | ND (1) | ND (1) |
| Fecal Coliforms | CFU/100 mL | 1 | - | - | ND (1) | ND (1) | ND (1) |
| Total Coliforms | CFU/100 mL | 10 | 0 | MAC | ND (1) | ND (1) | ND (1) |
| Heterotrophic Plate Count | CFU/mL | 10 | - | - | - | - | 810 |
| General Inorganics | | | | | | | |
| Alkalinity, total | mg/L | 5 | 500 | OG | 280 | 279 | 310 |
| Ammonia as N | mg/L | 0.01 | - | - | 0.03 | 0.02 | 0.05 |
| Dissolved Organic Carbon | mg/L | 0.5 | 5 | AO | ND (0.5) | 1.1 | 0.6 |
| Colour | ACU | 2 | 5 | AO | ND (2) | 2 | ND (2) |
| Conductivity | uS/cm | 5 | - | - | 834 | 809 | 900 |
| Hardness | mg/L | 100 | - | OG | 380 | 377 | 32.2 |
| Organic Nitrogen (calculated) | mg/L | - | 0.15 | OG | 0.17 | 0.18 | 0.050 |
| pH | pH Units | 0.1 | - | - | 7.9 | 7.9 | 9.1 |
| Phenolics | mg/L | 0.001 | - | - | ND (0.001) | ND (0.001) | ND (0.001) |
| Total Dissolved Solids | mg/L | 10 | 500 | AO | 424 | 452 | 498 |
| Sulphide | mg/L | 0.02 | 0.05 | AO | ND (0.02) | ND (0.02) | ND (0.02) |
| Tannin & Lignin | mg/L | 0.1 | - | - | ND (0.1) | ND (0.1) | ND (0.1) |
| Total Kjeldahl Nitrogen | mg/L | 0.1 | - | - | 0.2 | 0.200 | 0.1 |
| Turbidity | NTU | 0.1 | 5 | AO | 3.2 | 1.9 | 0.3 |
| Anions | | | | | | | |
| Chloride | mg/L | 1 | 250 | AO | 70 | 70 | 70 |
| Fluoride | mg/L | 0.1 | 1.5 | MAC | 0.2 | 0.2 | 0.3 |
| Nitrate as N | mg/L | 0.1 | 10 | MAC | 1.4 | 1.4 | 1.1 |
| Nitrite as N | mg/L | 0.05 | 1 | MAC | ND (0.05) | ND (0.05) | ND (0.05) |
| Sulphate | mg/L | 0.02 | - | - | 40 | 37 | 35 |
| Metals | | | | | | | |
| Aluminum | mg/L | 0.001 | 0.1 | AO | ND (0.001) | ND (0.001) | - |
| Antimony | mg/L | 0.0005 | 0.006 | MAC | ND (0.0005) | ND (0.0005) | - |
| Arsenic | mg/L | 0.001 | 0.01 | MAC | ND (0.001) | ND (0.001) | - |
| Barium | mg/L | 0.001 | 1 | MAC | 0.077 | 0.077 | - |
| Beryllium | mg/L | 0.0005 | - | - | ND (0.0005) | ND (0.0005) | - |
| Boron | mg/L | 0.01 | 5 | MAC | 0.07 | 0.07 | - |
| Cadmium | mg/L | 0.0001 | 0.005 | MAC | ND (0.0001) | ND (0.0001) | - |
| Calcium | mg/L | 0.1 | - | - | 109 | 108 | 0.932 |
| Chromium | mg/L | 0.001 | 0.05 | MAC | ND (0.001) | ND (0.001) | - |
| Cobalt | mg/L | 0.0005 | - | - | 0.0007 | ND (0.0005) | - |
| Copper | mg/L | 0.0005 | 1 | AO | 0.0006 | 0.0007 | - |
| Iron | mg/L | 0.1 | 0.3 | AO | 0.5 | 0.3 | ND (0.1) |
| Lead | mg/L | 0.0001 | 0.01 | MAC | 0.0001 | ND (0.0001) | - |
| Magnesium | mg/L | 0.2 | - | - | 26.2 | 26.3 | 7.26 |
| Manganese | mg/L | 0.005 | 0.05 | AO | 0.043 | 0.020 | ND (0.005) |
| Molybdenum | mg/L | 0.0005 | - | - | ND (0.0005) | ND (0.0005) | - |
| Nickel | mg/L | 0.001 | - | - | 0.003 | 0.002 | - |
| Potassium | mg/L | 0.1 | - | - | 2.5 | 2.5 | ND (0.1) |
| Selenium | mg/L | 0.001 | 0.05 | MAC | ND (0.001) | ND (0.001) | - |
| Silver | mg/L | 0.0001 | - | - | ND (0.0001) | ND (0.0001) | - |
| Sodium | mg/L | 0.2 | 20 | MAC | 30.6 | 27.3 | 171 |
| Strontium | mg/L | 0.01 | - | - | 3.08 | 2.64 | - |
| Thallium | mg/L | 0.001 | - | - | ND (0.001) | ND (0.001) | - |
| Tin | mg/L | 0.01 | - | - | ND (0.01) | ND (0.01) | - |
| Titanium | mg/L | 0.005 | - | - | ND (0.005) | ND (0.005) | - |
| Tungsten | mg/L | 0.01 | - | - | ND (0.01) | ND (0.01) | - |
| Uranium | mg/L | 0.0001 | 0.02 | MAC | 0.0005 | 0.0005 | - |
| Vanadium | mg/L | 0.0005 | - | - | ND (0.0005) | ND (0.0005) | - |
| Zinc | mg/L | 0.005 | 5 | AO | 0.007 | ND (0.005) | - |
| Volatile Organic Compounds (VOC) | | | | | | | |
| Benzene | mg/L | 0.0005 | 0.001 | MAC | ND (0.0005) | ND (0.0005) | ND (0.0005) |
| Ethylbenzene | mg/L | 0.0005 | 0.14 | MAC | ND (0.0005) | ND (0.0005) | ND (0.0005) |
| Toluene | mg/L | 0.0005 | 0.06 | MAC | ND (0.0005) | ND (0.0005) | ND (0.0005) |
| m/p-Xylene | mg/L | 0.0005 | - | - | ND (0.0005) | ND (0.0005) | ND (0.0005) |
| o-Xylene | mg/L | 0.0005 | - | - | ND (0.0005) | ND (0.0005) | ND (0.0005) |
| Xylenes, total | mg/L | 0.0005 | 0.09 | MAC | ND (0.0005) | ND (0.0005) | ND (0.0005) |
| Petroleum Hydrocarbons (PHCs) | | | | | | | |
| F1 PHCs (C6-C10) | mg/L | 0.025 | - | - | ND (0.0250) | ND (0.0250) | ND (0.0250) |
| F2 PHCs (C10-C16) | mg/L | 0.1 | - | - | ND (0.1) | ND (0.1) | ND (0.1) |
| F3 PHCs (C16-C34) | mg/L | 0.1 | - | - | ND (0.1) | ND (0.1) | ND (0.1) |
| F4 PHCs (C34-C50) | mg/L | 0.1 | - | - | ND (0.1) | ND (0.1) | ND (0.1) |

Notes:

1050 Exceeds Ontario Drinking Water Standards, Objectives, and Guidelines

* Detection limits were elevated due to excessive turbidity in samples

MDL Method Detection Limit
ODWSOG Ontario Drinking Water Standards, Objectives, and Guidelines (MOECC, 2003 rev. 2006; PIBs 4449e01)
AO Aesthetic Objective
MAC Maximum Allowable Concentration (Health-Related Parameter)
OG Operational Guideline
ND Non detectable (below MDL)
mg/L Milligrams per litre
TCU True Colour Units
uS/cm Microsempens per centimeter
NTU Nephelometric Turbidity Units
CFU/100 mL Number of bacteria-forming colonies per 100 mL

Table 2
Summary of Field Parameters
3447 Old Almonte Road, Ottawa ON
Corkery Community Centre

| Pumping Test at: | Corkery Community Centre | | | Date: | 03-Feb-22 | |
|--------------------|---|------|----------------------|------------------|-----------|-------------------|
| Time Elapsed (min) | Turbidity (NTU) | pH | Conductivity (ms/cm) | Temperature (°C) | TDS (g/L) | Flow Rate (L/min) |
| Pump On | | | | | | |
| 16 | 14.7 | 7.03 | 0.967 | 10.38 | 0.619 | 33 |
| 27 | 19.9 | 7.73 | 0.909 | 8.63 | 0.581 | |
| 40 | 16.2 | 7.47 | 0.899 | 8.15 | 0.575 | |
| 50 | 11.4 | 7.49 | 0.893 | 7.74 | 0.571 | |
| 60 | 7.7 | 7.41 | 0.901 | 7.8 | 0.577 | |
| 120 | 5.5 | 7.64 | 0.892 | 7.56 | 0.571 | |
| 180 | 4.9 | 7.88 | 0.885 | 8.25 | 0.566 | |
| 240 | 5.2 | 7.89 | 0.88 | 8.25 | 0.564 | 31 |
| 300 | 3.6 | 8.09 | 0.873 | 8.52 | 0.558 | |
| 360 | 3.2 | 8.21 | 0.862 | 8.66 | 0.551 | |
| Notes: | <i>Flow rate measured with bucket and stopwatch</i> | | | | | |

NOTES:

min Minutes
 NTU Nephelometric Turbidity Units
 (ms/cm) Millisiemens per centimeter
 (°C) Degrees celsius
 g/L Grams per litre
 L/min Litres per minute

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON




APPENDIX A: WATER LEVEL DATA AND PUMPING TEST ANALYSIS

**Summary of Water Level Data
Pumping Test - TW1 February 3, 2022**


TOC Elevation (assumed) 100 m AD (Above Datum)
 Static Water Level 32.35 m BTOC
 Static Water Elevation 67.65 m AD (Above Datum)
 95% Recovery 32.3695 m BTOC
 67.6305 m AD (Above Datum)

| Elapsed Time (minutes) | Elapsed Time (Recovery) | T/T' | Water Level (m BTOC) | Water Level (m Datum) | Drawdown (m) | Notes |
|------------------------|-------------------------|----------|----------------------|-----------------------|--------------|---------------------|
| 0 | | | 32.35 | 67.65 | 0 | |
| 1.7 | | | 32.72 | 67.28 | 0.37 | |
| 2.52 | | | 32.72 | 67.28 | 0.37 | |
| 3.4 | | | 32.7 | 67.3 | 0.35 | |
| 6.02 | | | 32.72 | 67.28 | 0.37 | |
| 6.88 | | | 32.72 | 67.28 | 0.37 | |
| 8.63 | | | 32.72 | 67.28 | 0.37 | |
| 9.5 | | | 32.72 | 67.28 | 0.37 | |
| 10 | | | 32.36 | 67.64 | 0.01 | |
| 10.42 | | | 32.7 | 67.3 | 0.35 | |
| 10.9 | | | 32.37 | 67.63 | 0.02 | |
| 11.5 | | | 32.37 | 67.63 | 0.02 | |
| 11.75 | | | 32.36 | 67.64 | 0.01 | |
| 12.13 | | | 32.74 | 67.26 | 0.39 | |
| 12.6 | | | 32.36 | 67.64 | 0.01 | |
| 13.02 | | | 32.74 | 67.26 | 0.39 | |
| 13.48 | | | 32.36 | 67.64 | 0.01 | |
| 13.97 | | | 32.71 | 67.29 | 0.36 | |
| 14.35 | | | 32.36 | 67.64 | 0.01 | |
| 14.75 | | | 32.74 | 67.26 | 0.39 | |
| 15.22 | | | 32.36 | 67.64 | 0.01 | |
| 15.62 | | | 32.7 | 67.3 | 0.35 | |
| 16.5 | | | 32.73 | 67.27 | 0.38 | |
| 16.97 | | | 32.36 | 67.64 | 0.01 | |
| 17.92 | | | 32.37 | 67.63 | 0.02 | |
| 18.23 | | | 32.7 | 67.3 | 0.35 | |
| 18.67 | | | 32.38 | 67.62 | 0.03 | |
| 19.05 | | | 32.73 | 67.27 | 0.38 | |
| 19.52 | | | 32.36 | 67.64 | 0.01 | |
| 19.92 | | | 32.72 | 67.28 | 0.37 | |
| 22.5 | | | 32.73 | 67.27 | 0.38 | |
| 25.17 | | | 32.71 | 67.29 | 0.36 | |
| 29.52 | | | 32.73 | 67.27 | 0.38 | |
| 44.53 | | | 32.725 | 67.275 | 0.375 | |
| 45.03 | | | 32.364 | 67.636 | 0.014 | |
| 47.77 | | | 32.359 | 67.641 | 0.009 | |
| 48.17 | | | 32.716 | 67.284 | 0.366 | |
| 66.13 | | | 32.36 | 67.64 | 0.01 | |
| 68.13 | | | 32.7 | 67.3 | 0.35 | |
| 91.45 | | | 32.726 | 67.274 | 0.376 | |
| 91.95 | | | 32.366 | 67.634 | 0.016 | |
| 124.12 | | | 32.7 | 67.3 | 0.35 | |
| 124.58 | | | 32.37 | 67.63 | 0.02 | |
| 125 | | | 32.7 | 67.3 | 0.35 | |
| 125.38 | | | 32.375 | 67.625 | 0.025 | |
| 183.22 | | | 32.37 | 67.63 | 0.02 | |
| 184.38 | | | 32.375 | 67.625 | 0.025 | |
| 187.5 | | | 32.74 | 67.26 | 0.39 | |
| 187.85 | | | 32.375 | 67.625 | 0.025 | |
| 241.97 | | | 32.74 | 67.26 | 0.39 | |
| 243.17 | | | 32.752 | 67.248 | 0.402 | |
| 300 | | | 32.38 | 67.62 | 0.03 | |
| 300.83 | | | 32.75 | 67.25 | 0.4 | |
| 360.47 | | | 32.385 | 67.615 | 0.035 | |
| 361.47 | 0.47 | 769.0851 | 32.38 | 67.62 | 0.03 | Pump off at 361 min |
| 362 | 1 | 362 | 32.377 | 67.623 | 0.027 | |
| 363.23 | 2.23 | 162.8834 | 32.377 | 67.623 | 0.027 | |
| 364.07 | 3.07 | 118.5896 | 32.375 | 67.625 | 0.025 | |
| 365.17 | 4.17 | 87.57074 | 32.375 | 67.625 | 0.025 | |
| 366 | 5 | 73.2 | 32.375 | 67.625 | 0.025 | |
| 367 | 6 | 61.16667 | 32.375 | 67.625 | 0.025 | |
| 368 | 7 | 52.57143 | 32.38 | 67.62 | 0.03 | |
| 369.33 | 8.33 | 44.33733 | 32.38 | 67.62 | 0.03 | |
| 370 | 9 | 41.11111 | 32.38 | 67.62 | 0.03 | |
| 381 | 20 | 19.05 | 32.379 | 67.621 | 0.029 | |
| 394.33 | 33.33 | 11.83108 | 32.37 | 67.63 | 0.02 | |


Drawdown vs Time
Pumping Test (Drawdown), February 3, 2022
Corkery Community Centre

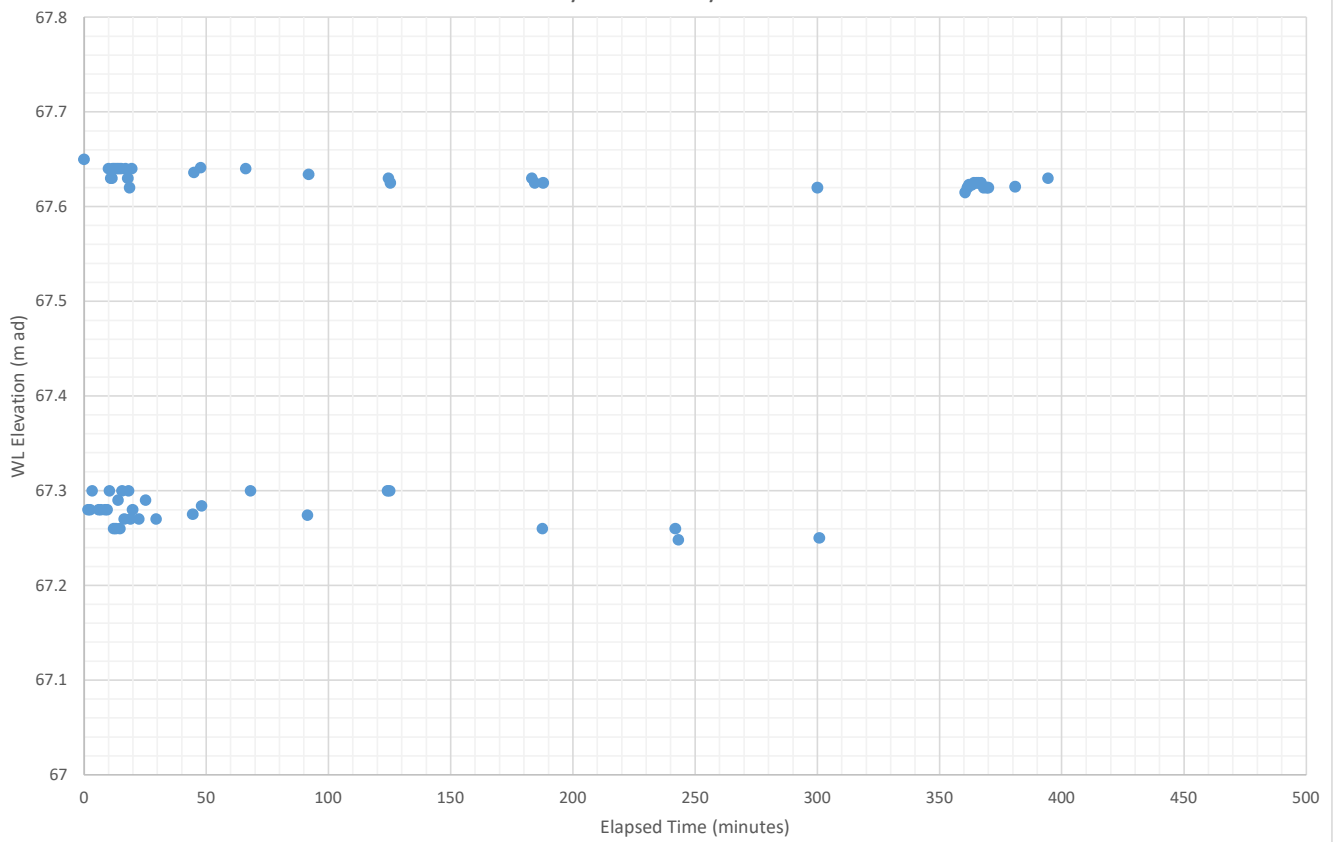

Drawdown vs Log Time
Pumping Test (Long-Term), February 3, 2022
Corkery Community Centre

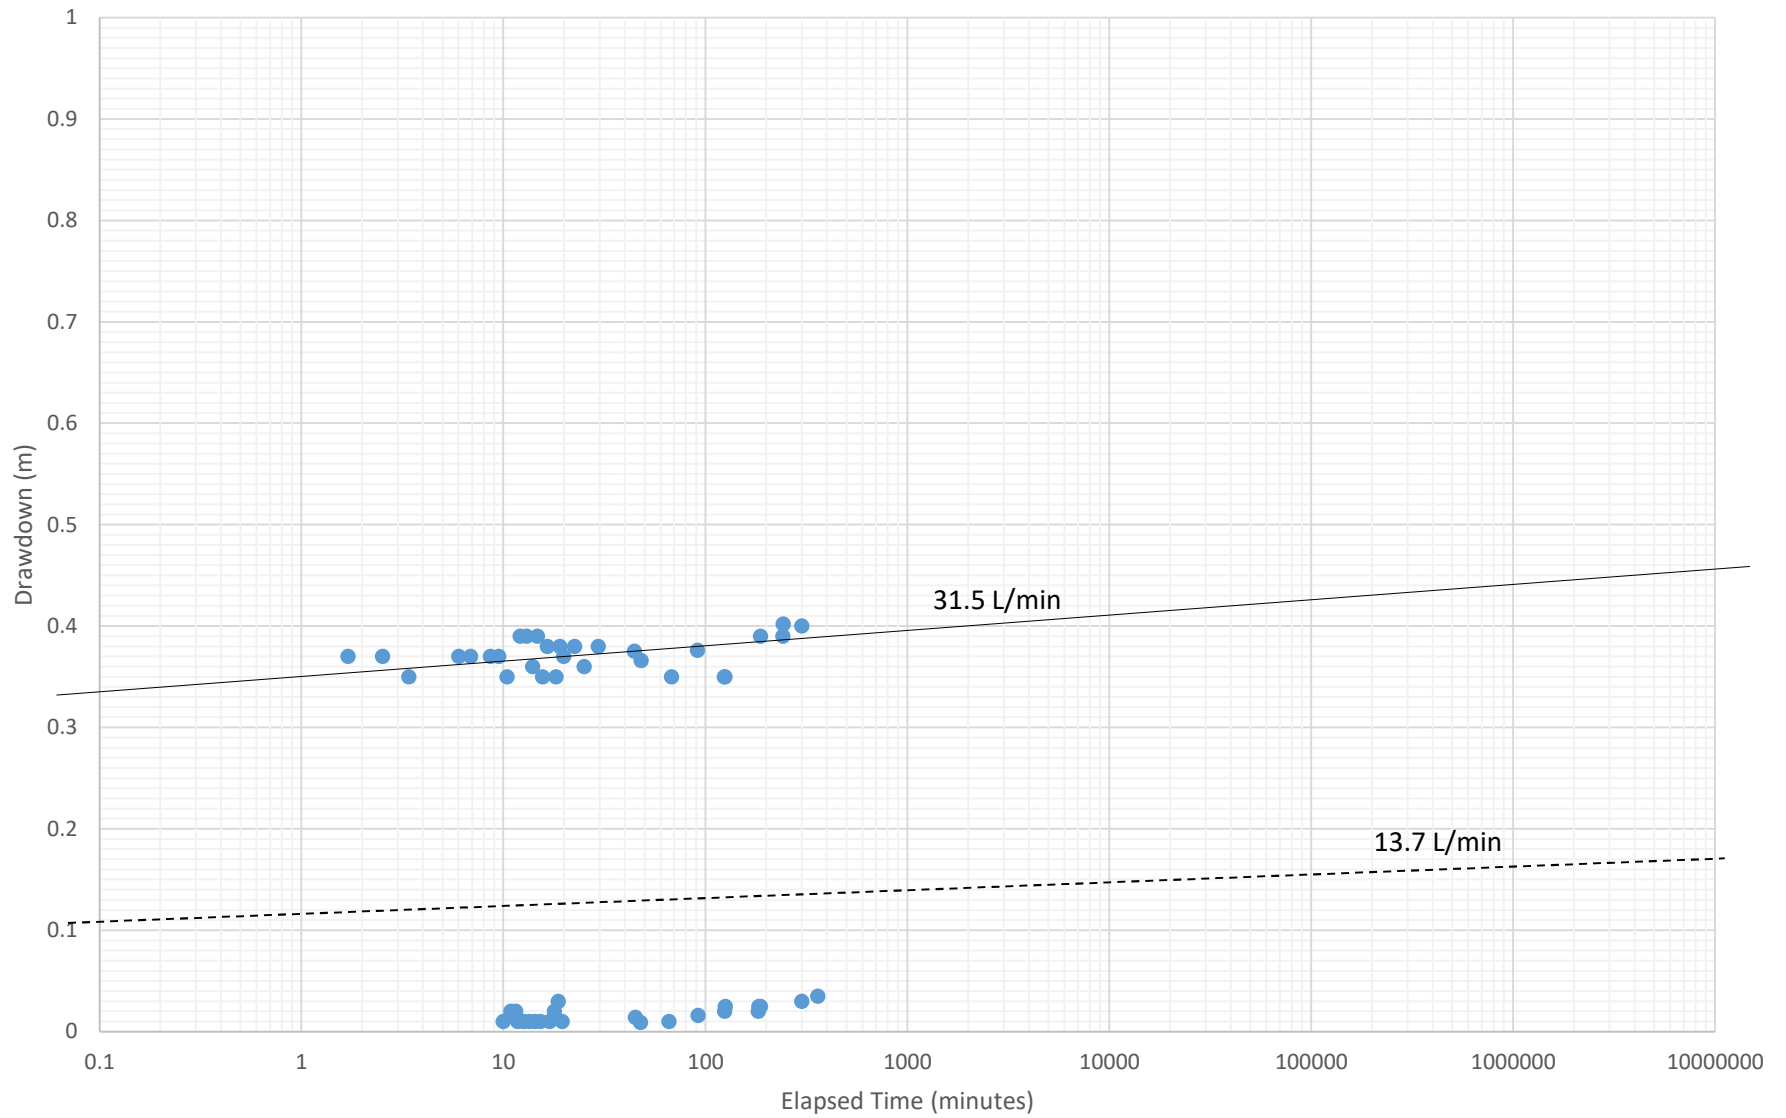

Drawdown vs Log Time
Pumping Test (Recovery), February 3, 2022
Corkery Community Centre

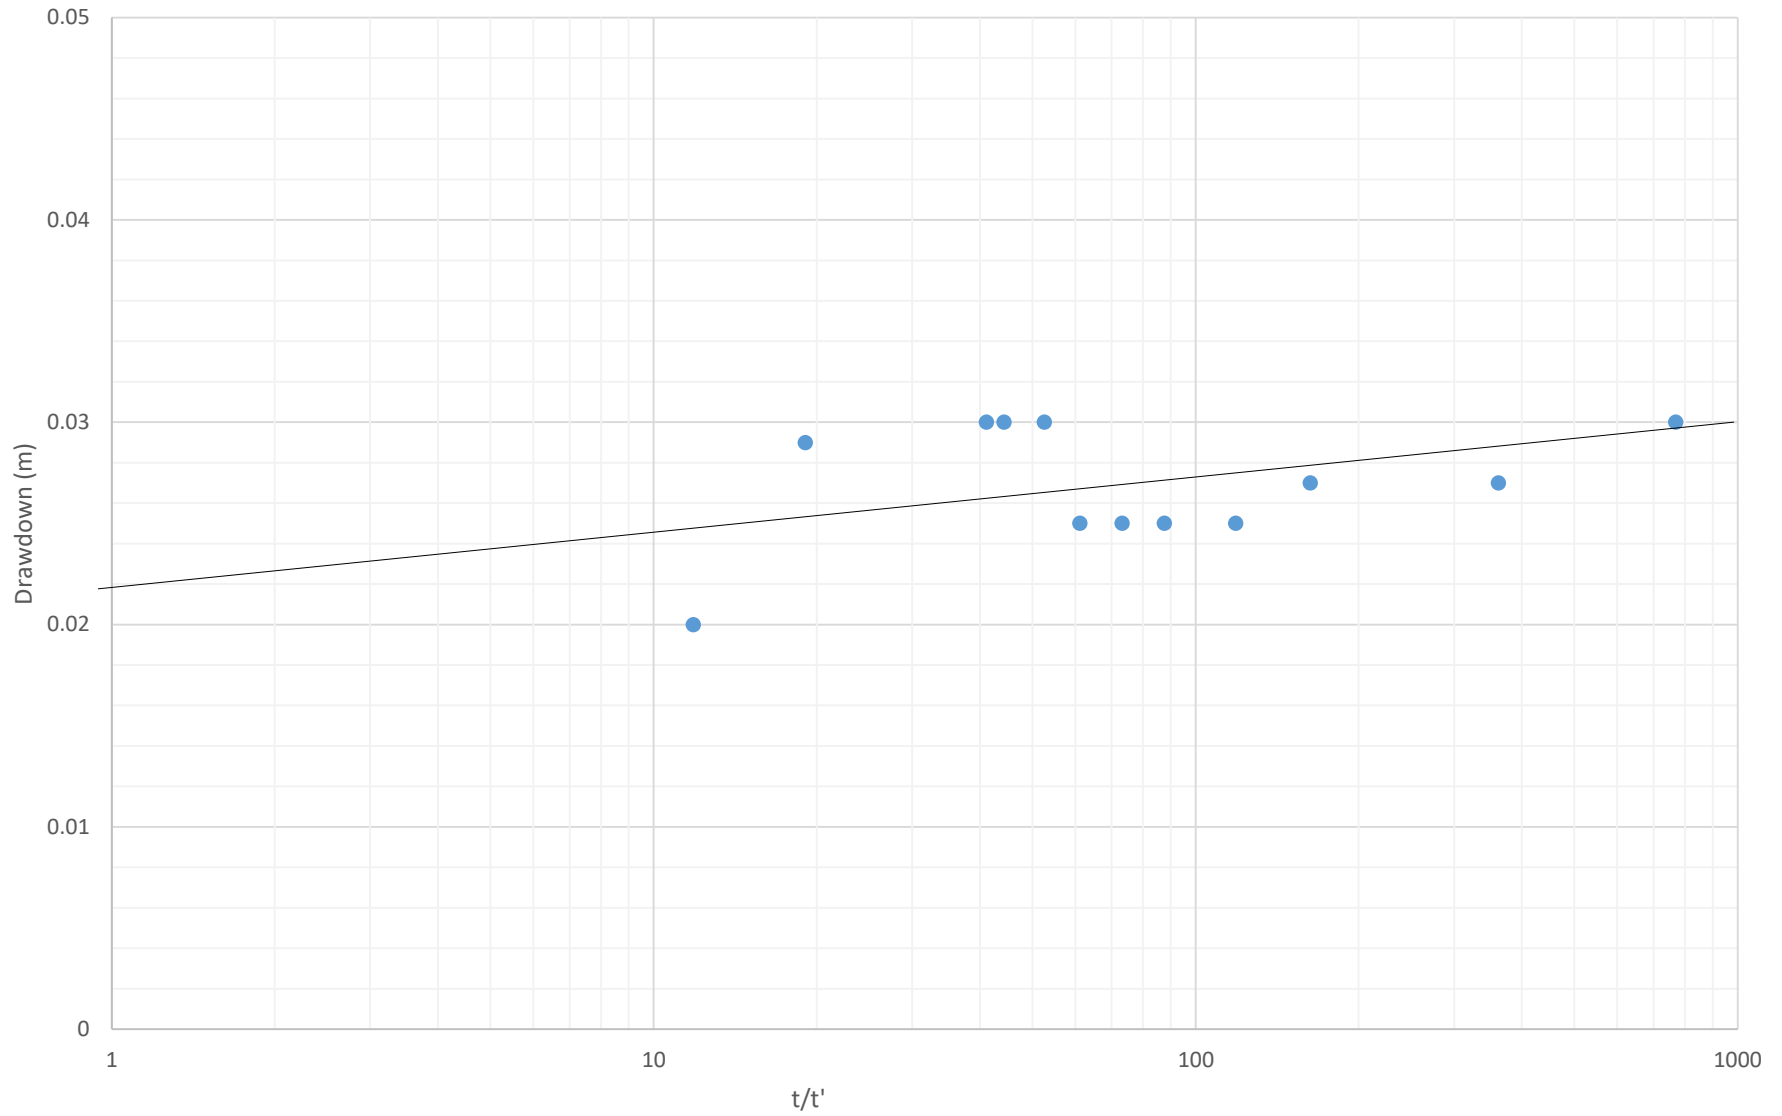

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



APPENDIX B: LABORATORY CERTIFICATES OF ANALYSIS

Certificate of Analysis

McIntosh Perry Consulting Eng. (Carp)

115 Walgreen Rd.
Carp, ON K0A 1L0
Attn: Dan Arnott

Client PO:
Project: CC0-21-3339-01
Custody: 41250

Report Date: 10-Feb-2022
Order Date: 3-Feb-2022

Order #: 2206415

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Paracel ID | Client ID |
|------------|-----------|
| 2206415-01 | Fire Stn |

Approved By:



Mark Foto, M.Sc.
Lab Supervisor

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

Analysis Summary Table

| Analysis | Method Reference/Description | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5 | 4-Feb-22 | 4-Feb-22 |
| Ammonia, as N | EPA 351.2 - Auto Colour | 7-Feb-22 | 7-Feb-22 |
| Anions | EPA 300.1 - IC | 4-Feb-22 | 4-Feb-22 |
| BTEX by P&T GC-MS | EPA 624 - P&T GC-MS | 7-Feb-22 | 7-Feb-22 |
| Colour | SM2120 - Spectrophotometric | 4-Feb-22 | 4-Feb-22 |
| Conductivity | EPA 9050A- probe @25 °C | 4-Feb-22 | 4-Feb-22 |
| Dissolved Organic Carbon | MOE E3247B - Combustion IR, filtration | 9-Feb-22 | 9-Feb-22 |
| E. coli | MOE E3407 | 3-Feb-22 | 3-Feb-22 |
| Fecal Coliform | SM 9222D | 3-Feb-22 | 3-Feb-22 |
| Heterotrophic Plate Count | SM 9215C | 3-Feb-22 | 3-Feb-22 |
| Metals, ICP-MS | EPA 200.8 - ICP-MS | 4-Feb-22 | 7-Feb-22 |
| pH | EPA 150.1 - pH probe @25 °C | 4-Feb-22 | 4-Feb-22 |
| PHC F1 | CWS Tier 1 - P&T GC-FID | 7-Feb-22 | 7-Feb-22 |
| PHCs F2 to F4 | CWS Tier 1 - GC-FID, extraction | 7-Feb-22 | 7-Feb-22 |
| Phenolics | EPA 420.2 - Auto Colour, 4AAP | 4-Feb-22 | 7-Feb-22 |
| Hardness | Hardness as CaCO ₃ | 4-Feb-22 | 7-Feb-22 |
| Sulphide | SM 4500SE - Colourimetric | 3-Feb-22 | 3-Feb-22 |
| Tannin/Lignin | SM 5550B - Colourimetric | 7-Feb-22 | 7-Feb-22 |
| Total Coliform | MOE E3407 | 3-Feb-22 | 3-Feb-22 |
| Total Dissolved Solids | SM 2540C - gravimetric, filtration | 7-Feb-22 | 8-Feb-22 |
| Total Kjeldahl Nitrogen | EPA 351.2 - Auto Colour, digestion | 4-Feb-22 | 4-Feb-22 |
| Turbidity | SM 2130B - Turbidity meter | 4-Feb-22 | 4-Feb-22 |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

| | | | | |
|---------------------|-----------------|---|---|---|
| Client ID: | Fire Stn | - | - | - |
| Sample Date: | 03-Feb-22 09:00 | - | - | - |
| Sample ID: | 2206415-01 | - | - | - |
| MDL/Units | Water | - | - | - |

Microbiological Parameters

| | | | | | |
|---------------------------|-------------|-----|---|---|---|
| E. coli | 1 CFU/100mL | ND | - | - | - |
| Fecal Coliforms | 1 CFU/100mL | ND | - | - | - |
| Total Coliforms | 1 CFU/100mL | ND | - | - | - |
| Heterotrophic Plate Count | 10 CFU/mL | 810 | - | - | - |

General Inorganics

| | | | | | |
|--------------------------|--------------|--------|---|---|---|
| Alkalinity, total | 5 mg/L | 310 | - | - | - |
| Ammonia as N | 0.01 mg/L | 0.05 | - | - | - |
| Dissolved Organic Carbon | 0.5 mg/L | 0.6 | - | - | - |
| Colour | 2 TCU | <2 | - | - | - |
| Conductivity | 5 uS/cm | 900 | - | - | - |
| Hardness | mg/L | 32.2 | - | - | - |
| pH | 0.1 pH Units | 9.1 | - | - | - |
| Phenolics | 0.001 mg/L | <0.001 | - | - | - |
| Total Dissolved Solids | 10 mg/L | 498 | - | - | - |
| Sulphide | 0.02 mg/L | <0.02 | - | - | - |
| Tannin & Lignin | 0.1 mg/L | <0.1 | - | - | - |
| Total Kjeldahl Nitrogen | 0.1 mg/L | 0.1 | - | - | - |
| Turbidity | 0.1 NTU | 0.3 | - | - | - |

Anions

| | | | | | |
|--------------|-----------|-------|---|---|---|
| Chloride | 1 mg/L | 70 | - | - | - |
| Fluoride | 0.1 mg/L | 0.3 | - | - | - |
| Nitrate as N | 0.1 mg/L | 1.1 | - | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | - | - | - |
| Sulphate | 1 mg/L | 35 | - | - | - |

Metals

| | | | | | |
|-----------|----------|--------|---|---|---|
| Calcium | 100 ug/L | 932 | - | - | - |
| Iron | 100 ug/L | <100 | - | - | - |
| Magnesium | 200 ug/L | 7260 | - | - | - |
| Manganese | 5 ug/L | <5 | - | - | - |
| Potassium | 100 ug/L | <100 | - | - | - |
| Sodium | 200 ug/L | 171000 | - | - | - |

Volatiles

| | | | | | |
|--------------|----------|------|---|---|---|
| Benzene | 0.5 ug/L | <0.5 | - | - | - |
| Ethylbenzene | 0.5 ug/L | <0.5 | - | - | - |
| Toluene | 0.5 ug/L | <0.5 | - | - | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

| | | | | | |
|----------------|---------------------|-----------------|---|---|---|
| | Client ID: | Fire Stn | - | - | - |
| | Sample Date: | 03-Feb-22 09:00 | - | - | - |
| | Sample ID: | 2206415-01 | - | - | - |
| | MDL/Units | Water | - | - | - |
| m,p-Xylenes | 0.5 ug/L | <0.5 | - | - | - |
| o-Xylene | 0.5 ug/L | <0.5 | - | - | - |
| Xylenes, total | 0.5 ug/L | <0.5 | - | - | - |
| Toluene-d8 | Surrogate | 103% | - | - | - |

Hydrocarbons

| | | | | | |
|-------------------|----------|------|---|---|---|
| F1 PHCs (C6-C10) | 25 ug/L | <25 | - | - | - |
| F2 PHCs (C10-C16) | 100 ug/L | <100 | - | - | - |
| F3 PHCs (C16-C34) | 100 ug/L | <100 | - | - | - |
| F4 PHCs (C34-C50) | 100 ug/L | <100 | - | - | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

Method Quality Control: Blank

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| Anions | | | | | | | | | |
| Chloride | ND | 1 | mg/L | | | | | | |
| Fluoride | ND | 0.1 | mg/L | | | | | | |
| Nitrate as N | ND | 0.1 | mg/L | | | | | | |
| Nitrite as N | ND | 0.05 | mg/L | | | | | | |
| Sulphate | ND | 1 | mg/L | | | | | | |
| General Inorganics | | | | | | | | | |
| Alkalinity, total | ND | 5 | mg/L | | | | | | |
| Ammonia as N | ND | 0.01 | mg/L | | | | | | |
| Dissolved Organic Carbon | ND | 0.5 | mg/L | | | | | | |
| Colour | ND | 2 | TCU | | | | | | |
| Conductivity | ND | 5 | uS/cm | | | | | | |
| Phenolics | ND | 0.001 | mg/L | | | | | | |
| Total Dissolved Solids | ND | 10 | mg/L | | | | | | |
| Sulphide | ND | 0.02 | mg/L | | | | | | |
| Tannin & Lignin | ND | 0.1 | mg/L | | | | | | |
| Total Kjeldahl Nitrogen | ND | 0.1 | mg/L | | | | | | |
| Turbidity | ND | 0.1 | NTU | | | | | | |
| Hydrocarbons | | | | | | | | | |
| F1 PHCs (C6-C10) | ND | 25 | ug/L | | | | | | |
| F2 PHCs (C10-C16) | ND | 100 | ug/L | | | | | | |
| F3 PHCs (C16-C34) | ND | 100 | ug/L | | | | | | |
| F4 PHCs (C34-C50) | ND | 100 | ug/L | | | | | | |
| Metals | | | | | | | | | |
| Calcium | ND | 100 | ug/L | | | | | | |
| Iron | ND | 100 | ug/L | | | | | | |
| Magnesium | ND | 200 | ug/L | | | | | | |
| Manganese | ND | 5 | ug/L | | | | | | |
| Potassium | ND | 100 | ug/L | | | | | | |
| Sodium | ND | 200 | ug/L | | | | | | |
| Microbiological Parameters | | | | | | | | | |
| E. coli | ND | 1 | CFU/100mL | | | | | | |
| Fecal Coliforms | ND | 1 | CFU/100mL | | | | | | |
| Total Coliforms | ND | 1 | CFU/100mL | | | | | | |
| Heterotrophic Plate Count | ND | 10 | CFU/mL | | | | | | |
| Volatiles | | | | | | | | | |
| Benzene | ND | 0.5 | ug/L | | | | | | |
| Ethylbenzene | ND | 0.5 | ug/L | | | | | | |
| Toluene | ND | 0.5 | ug/L | | | | | | |
| m,p-Xylenes | ND | 0.5 | ug/L | | | | | | |
| o-Xylene | ND | 0.5 | ug/L | | | | | | |
| Xylenes, total | ND | 0.5 | ug/L | | | | | | |
| <i>Surrogate: Toluene-d8</i> | 83.7 | | ug/L | | 105 | 50-140 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

Method Quality Control: Duplicate

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| Anions | | | | | | | | | |
| Chloride | 69.1 | 1 | mg/L | 69.7 | | | 0.9 | 10 | |
| Fluoride | 0.26 | 0.1 | mg/L | 0.28 | | | 6.9 | 10 | |
| Nitrate as N | 1.14 | 0.1 | mg/L | 1.14 | | | 0.2 | 10 | |
| Nitrite as N | ND | 0.05 | mg/L | ND | | | NC | 10 | |
| Sulphate | 34.7 | 1 | mg/L | 35.1 | | | 1.0 | 10 | |
| General Inorganics | | | | | | | | | |
| Alkalinity, total | 306 | 5 | mg/L | 310 | | | 1.1 | 14 | |
| Ammonia as N | 0.019 | 0.01 | mg/L | 0.021 | | | 7.2 | 18 | |
| Dissolved Organic Carbon | 2.9 | 0.5 | mg/L | 3.3 | | | 13.9 | 37 | |
| Colour | ND | 2 | TCU | ND | | | NC | 12 | |
| Conductivity | 898 | 5 | uS/cm | 900 | | | 0.3 | 5 | |
| pH | 9.1 | 0.1 | pH Units | 9.1 | | | 0.1 | 3.3 | |
| Phenolics | ND | 0.001 | mg/L | 0.001 | | | NC | 10 | |
| Total Dissolved Solids | 242 | 10 | mg/L | 230 | | | 5.1 | 10 | |
| Sulphide | ND | 0.02 | mg/L | ND | | | NC | 10 | |
| Tannin & Lignin | ND | 0.1 | mg/L | ND | | | NC | 11 | |
| Total Kjeldahl Nitrogen | 8.78 | 0.4 | mg/L | 9.22 | | | 4.9 | 16 | |
| Turbidity | 0.3 | 0.1 | NTU | 0.3 | | | 7.4 | 10 | |
| Hydrocarbons | | | | | | | | | |
| F1 PHCs (C6-C10) | ND | 25 | ug/L | ND | | | NC | 30 | |
| Metals | | | | | | | | | |
| Calcium | 34000 | 100 | ug/L | 35000 | | | 3.1 | 20 | |
| Iron | ND | 100 | ug/L | ND | | | NC | 20 | |
| Magnesium | 8790 | 200 | ug/L | 8690 | | | 1.1 | 20 | |
| Manganese | ND | 5 | ug/L | ND | | | NC | 20 | |
| Potassium | 1620 | 100 | ug/L | 1680 | | | 3.8 | 20 | |
| Sodium | 15700 | 200 | ug/L | 16300 | | | 3.4 | 20 | |
| Microbiological Parameters | | | | | | | | | |
| E. coli | ND | 1 | CFU/100mL | ND | | | NC | 30 | |
| Fecal Coliforms | ND | 1 | CFU/100mL | ND | | | NC | 30 | |
| Total Coliforms | ND | 1 | CFU/100mL | ND | | | NC | 30 | |
| Heterotrophic Plate Count | 770 | 10 | CFU/mL | 810 | | | 5.0 | 30 | |
| Volatiles | | | | | | | | | |
| Benzene | ND | 0.5 | ug/L | ND | | | NC | 30 | |
| Ethylbenzene | ND | 0.5 | ug/L | ND | | | NC | 30 | |
| Toluene | ND | 0.5 | ug/L | ND | | | NC | 30 | |
| m,p-Xylenes | ND | 0.5 | ug/L | ND | | | NC | 30 | |
| o-Xylene | ND | 0.5 | ug/L | ND | | | NC | 30 | |
| Surrogate: Toluene-d8 | 81.8 | | ug/L | | 102 | 50-140 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

Method Quality Control: Spike

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| Anions | | | | | | | | | |
| Chloride | 78.9 | 1 | mg/L | 69.7 | 92.0 | 77-123 | | | |
| Fluoride | 1.13 | 0.1 | mg/L | 0.28 | 84.9 | 79-121 | | | |
| Nitrate as N | 2.16 | 0.1 | mg/L | 1.14 | 102 | 79-120 | | | |
| Nitrite as N | 1.01 | 0.05 | mg/L | ND | 101 | 84-117 | | | |
| Sulphate | 44.0 | 1 | mg/L | 35.1 | 89.0 | 74-126 | | | |
| General Inorganics | | | | | | | | | |
| Ammonia as N | 0.278 | 0.01 | mg/L | 0.021 | 103 | 81-124 | | | |
| Dissolved Organic Carbon | 14.0 | 0.5 | mg/L | 3.3 | 106 | 60-133 | | | |
| Phenolics | 0.028 | 0.001 | mg/L | 0.001 | 109 | 67-133 | | | |
| Total Dissolved Solids | 114 | 10 | mg/L | ND | 114 | 75-125 | | | |
| Sulphide | 0.52 | 0.02 | mg/L | ND | 104 | 79-115 | | | |
| Tannin & Lignin | 0.9 | 0.1 | mg/L | ND | 94.7 | 71-113 | | | |
| Total Kjeldahl Nitrogen | 1.85 | 0.1 | mg/L | ND | 92.7 | 81-126 | | | |
| Hydrocarbons | | | | | | | | | |
| F1 PHCs (C6-C10) | 1650 | 25 | ug/L | ND | 82.3 | 68-117 | | | |
| F2 PHCs (C10-C16) | 1060 | 100 | ug/L | ND | 66.1 | 60-140 | | | |
| F3 PHCs (C16-C34) | 2550 | 100 | ug/L | ND | 65.0 | 60-140 | | | |
| F4 PHCs (C34-C50) | 1690 | 100 | ug/L | ND | 68.1 | 60-140 | | | |
| Metals | | | | | | | | | |
| Calcium | 8950 | 100 | ug/L | ND | 89.5 | 80-120 | | | |
| Iron | 2300 | 100 | ug/L | ND | 89.5 | 80-120 | | | |
| Magnesium | 16600 | 200 | ug/L | 8690 | 79.4 | 80-120 | | | QM-07 |
| Manganese | 47.1 | 5 | ug/L | ND | 90.0 | 80-120 | | | |
| Potassium | 11100 | 100 | ug/L | 1680 | 94.4 | 80-120 | | | |
| Sodium | 8980 | 200 | ug/L | ND | 89.8 | 80-120 | | | |
| Volatiles | | | | | | | | | |
| Benzene | 32.4 | 0.5 | ug/L | ND | 81.0 | 60-130 | | | |
| Ethylbenzene | 40.9 | 0.5 | ug/L | ND | 102 | 60-130 | | | |
| Toluene | 39.0 | 0.5 | ug/L | ND | 97.4 | 60-130 | | | |
| m,p-Xylenes | 79.8 | 0.5 | ug/L | ND | 99.8 | 60-130 | | | |
| o-Xylene | 39.7 | 0.5 | ug/L | ND | 99.3 | 60-130 | | | |
| Surrogate: Toluene-d8 | 79.1 | | ug/L | | 98.8 | 50-140 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 3-Feb-2022

Client PO:

Project Description: CC0-21-3339-01

Qualifier Notes:

Login Qualifiers :

Container and COC sample IDs don't match - PHC, Voc bottles read: "Fire Stn", COC reads: "Fire Hall."

Applies to samples: Fire Stn

Sample - Filtered and preserved by Paracel upon receipt at the laboratory - Metals 125ml subsampled from General bottle.

Applies to samples: Fire Stn

Sample Qualifiers :

QC Qualifiers :

QM-07 : The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

Sample Data Revisions

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

CCME PHC additional information:

- The method for the analysis of PHCs complies with the Reference Method for the CWS PHC and is validated for use in the laboratory. All prescribed quality criteria identified in the method has been met.
- F1 range corrected for BTEX.
- F2 to F3 ranges corrected for appropriate PAHs where available.
- The gravimetric heavy hydrocarbons (F4G) are not to be added to C6 to C50 hydrocarbons.
- In the case where F4 and F4G are both reported, the greater of the two results is to be used for comparison to CWS PHC criteria.
- When reported, data for F4G has been processed using a silica gel cleanup.



| | | |
|--|--|--|
| Client Name: <u>McIntosh Perry</u> | Project Reference: <u>Co-21-3339-01</u> | Turnaround Time: <input type="checkbox"/> 1 Day <input type="checkbox"/> 3 Day <input type="checkbox"/> 2 Day <input checked="" type="checkbox"/> Regular Date Required: _____ |
| Contact Name: <u>Don Arnott</u> | Quote # | |
| Address: <u>115 Wulfgreen Rd Carp ON K0A 1L0</u> | PO # | |
| Telephone: <u>(613) 714-4589</u> | Email Address: <u>d.arnott@mcintoshperry.com</u> | |

Criteria: O. Reg. 153/04 (As Amended) Table ___ RSC Filing O. Reg. 558/00 PWQO CCME SUB (Storm) SUB (Sanitary) Municipality: _____ Other: Other Subd.

| Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other) | | | | | Required Analyses | | | | | | | | | | | | | | |
|---|------------------|-----------|------------|-----------------|-------------------|------|-------------------------------------|-------------------------------------|-------------------------------------|------|--|--|--|--|--|--|--|--|--|
| Parcel Order Number: <u>2206415</u> | | Matrix | Air Volume | # of Containers | Sample Taken | | Other Substances | PAC | FI-FA | STEX | | | | | | | | | |
| Sample ID/Location Name | | | | | Date | Time | | | | | | | | | | | | | |
| 1 | <u>Fire Hall</u> | <u>GW</u> | | <u>11</u> | <u>3-Feb-2022</u> | | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | | | | | | | | | | |
| 2 | | | | | | | | | | | | | | | | | | | |
| 3 | | | | | | | | | | | | | | | | | | | |
| 4 | | | | | | | | | | | | | | | | | | | |
| 5 | | | | | | | | | | | | | | | | | | | |
| 6 | | | | | | | | | | | | | | | | | | | |
| 7 | | | | | | | | | | | | | | | | | | | |
| 8 | | | | | | | | | | | | | | | | | | | |
| 9 | | | | | | | | | | | | | | | | | | | |
| 10 | | | | | | | | | | | | | | | | | | | |

Comments: _____ Method of Delivery: Drop box

| | | | |
|--|---------------------------|-------------------------------------|---|
| Relinquished By (Sign): <u>[Signature]</u> | Received by Driver/Depot: | Received at Lab: <u>[Signature]</u> | Verified By: <u>[Signature]</u> |
| Relinquished By (Print): <u>Don Arnott</u> | Date/Time: | Date/Time: <u>Feb 3 2022 1:15</u> | Date/Time: <u>Feb 3 2022 2:19</u> |
| Date/Time: <u>3-Feb-2022 13:10</u> | Temperature: _____ °C | Temperature: <u>46</u> °C | pH Verified <input type="checkbox"/> By: <u>[Signature]</u> |

Certificate of Analysis

McIntosh Perry Consulting Eng. (Carp)

115 Walgreen Rd.
Carp, ON K0A 1L0
Attn: Monica Black

Client PO: Corkery Community Centre
Project: 21-3339
Custody: 14958

Report Date: 10-Feb-2022
Order Date: 4-Feb-2022

Order #: 2206476

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Paracel ID | Client ID |
|------------|-----------|
| 2206476-01 | TW1-1 |
| 2206476-02 | TW1-2 |

Approved By:



Mark Foto, M.Sc.
Lab Supervisor

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Analysis Summary Table

| Analysis | Method Reference/Description | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5 | 4-Feb-22 | 4-Feb-22 |
| Ammonia, as N | EPA 351.2 - Auto Colour | 7-Feb-22 | 7-Feb-22 |
| Anions | EPA 300.1 - IC | 4-Feb-22 | 4-Feb-22 |
| BTEX by P&T GC-MS | EPA 624 - P&T GC-MS | 9-Feb-22 | 9-Feb-22 |
| Colour | SM2120 - Spectrophotometric | 4-Feb-22 | 4-Feb-22 |
| Conductivity | EPA 9050A- probe @25 °C | 4-Feb-22 | 4-Feb-22 |
| Dissolved Organic Carbon | MOE E3247B - Combustion IR, filtration | 9-Feb-22 | 9-Feb-22 |
| E. coli | MOE E3407 | 4-Feb-22 | 4-Feb-22 |
| Fecal Coliform | SM 9222D | 4-Feb-22 | 4-Feb-22 |
| Metals, ICP-MS | EPA 200.8 - ICP-MS | 7-Feb-22 | 7-Feb-22 |
| pH | EPA 150.1 - pH probe @25 °C | 4-Feb-22 | 4-Feb-22 |
| PHC F1 | CWS Tier 1 - P&T GC-FID | 9-Feb-22 | 9-Feb-22 |
| PHCs F2 to F4 | CWS Tier 1 - GC-FID, extraction | 9-Feb-22 | 9-Feb-22 |
| Phenolics | EPA 420.2 - Auto Colour, 4AAP | 7-Feb-22 | 8-Feb-22 |
| Hardness | Hardness as CaCO ₃ | 7-Feb-22 | 7-Feb-22 |
| Sulphide | SM 4500SE - Colourimetric | 9-Feb-22 | 10-Feb-22 |
| Tannin/Lignin | SM 5550B - Colourimetric | 7-Feb-22 | 7-Feb-22 |
| Total Coliform | MOE E3407 | 4-Feb-22 | 4-Feb-22 |
| Total Dissolved Solids | SM 2540C - gravimetric, filtration | 8-Feb-22 | 9-Feb-22 |
| Total Kjeldahl Nitrogen | EPA 351.2 - Auto Colour, digestion | 7-Feb-22 | 8-Feb-22 |
| Turbidity | SM 2130B - Turbidity meter | 4-Feb-22 | 4-Feb-22 |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

| | | | | |
|---------------------|-----------------|-----------------|---|---|
| Client ID: | TW1-1 | TW1-2 | - | - |
| Sample Date: | 03-Feb-22 10:40 | 03-Feb-22 15:10 | - | - |
| Sample ID: | 2206476-01 | 2206476-02 | - | - |
| MDL/Units | Drinking Water | Drinking Water | - | - |

Microbiological Parameters

| | | | | | |
|-----------------|-------------|----|----|---|---|
| E. coli | 1 CFU/100mL | ND | ND | - | - |
| Fecal Coliforms | 1 CFU/100mL | ND | ND | - | - |
| Total Coliforms | 1 CFU/100mL | ND | ND | - | - |

General Inorganics

| | | | | | |
|--------------------------|--------------|--------|--------|---|---|
| Alkalinity, total | 5 mg/L | 280 | 279 | - | - |
| Ammonia as N | 0.01 mg/L | 0.03 | 0.02 | - | - |
| Dissolved Organic Carbon | 0.5 mg/L | <0.5 | 1.1 | - | - |
| Colour | 2 TCU | <2 | 2 | - | - |
| Conductivity | 5 uS/cm | 834 | 809 | - | - |
| Hardness | mg/L | 380 | 377 | - | - |
| pH | 0.1 pH Units | 7.9 | 7.9 | - | - |
| Phenolics | 0.001 mg/L | <0.001 | <0.001 | - | - |
| Total Dissolved Solids | 10 mg/L | 424 | 452 | - | - |
| Sulphide | 0.02 mg/L | <0.02 | <0.02 | - | - |
| Tannin & Lignin | 0.1 mg/L | <0.1 | <0.1 | - | - |
| Total Kjeldahl Nitrogen | 0.1 mg/L | 0.2 | 0.2 | - | - |
| Turbidity | 0.1 NTU | 3.2 | 1.9 | - | - |

Anions

| | | | | | |
|--------------|-----------|-------|-------|---|---|
| Chloride | 1 mg/L | 70 | 70 | - | - |
| Fluoride | 0.1 mg/L | 0.2 | 0.2 | - | - |
| Nitrate as N | 0.1 mg/L | 1.4 | 1.4 | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | <0.05 | - | - |
| Sulphate | 1 mg/L | 40 | 37 | - | - |

Metals

| | | | | | |
|-----------|-------------|---------|---------|---|---|
| Aluminum | 0.001 mg/L | <0.001 | <0.001 | - | - |
| Antimony | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Arsenic | 0.001 mg/L | <0.001 | <0.001 | - | - |
| Barium | 0.001 mg/L | 0.077 | 0.077 | - | - |
| Beryllium | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Boron | 0.01 mg/L | 0.07 | 0.07 | - | - |
| Cadmium | 0.0001 mg/L | <0.0001 | <0.0001 | - | - |
| Calcium | 0.1 mg/L | 109 | 108 | - | - |
| Chromium | 0.001 mg/L | <0.001 | <0.001 | - | - |
| Cobalt | 0.0005 mg/L | 0.0007 | <0.0005 | - | - |
| Copper | 0.0005 mg/L | 0.0006 | 0.0007 | - | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

| | Client ID: | TW1-1 | TW1-2 | - | - |
|------------|--------------|-----------------|-----------------|---|---|
| | Sample Date: | 03-Feb-22 10:40 | 03-Feb-22 15:10 | - | - |
| | Sample ID: | 2206476-01 | 2206476-02 | - | - |
| | MDL/Units | Drinking Water | Drinking Water | - | - |
| Iron | 0.1 mg/L | 0.5 | 0.3 | - | - |
| Lead | 0.0001 mg/L | 0.0001 | <0.0001 | - | - |
| Magnesium | 0.2 mg/L | 26.2 | 26.3 | - | - |
| Manganese | 0.005 mg/L | 0.043 | 0.020 | - | - |
| Molybdenum | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Nickel | 0.001 mg/L | 0.003 | 0.002 | - | - |
| Potassium | 0.1 mg/L | 2.5 | 2.5 | - | - |
| Selenium | 0.001 mg/L | <0.001 | <0.001 | - | - |
| Silver | 0.0001 mg/L | <0.0001 | <0.0001 | - | - |
| Sodium | 0.2 mg/L | 30.6 | 27.3 | - | - |
| Strontium | 0.01 mg/L | 3.08 | 2.64 | - | - |
| Thallium | 0.001 mg/L | <0.001 | <0.001 | - | - |
| Tin | 0.01 mg/L | <0.01 | <0.01 | - | - |
| Titanium | 0.005 mg/L | <0.005 | <0.005 | - | - |
| Tungsten | 0.01 mg/L | <0.01 | <0.01 | - | - |
| Uranium | 0.0001 mg/L | 0.0005 | 0.0005 | - | - |
| Vanadium | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Zinc | 0.005 mg/L | 0.007 | <0.005 | - | - |

Volatiles

| | | | | | |
|----------------|-------------|---------|---------|---|---|
| Benzene | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Ethylbenzene | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Toluene | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| m,p-Xylenes | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| o-Xylene | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Xylenes, total | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Toluene-d8 | Surrogate | 105% | 105% | - | - |

Hydrocarbons

| | | | | | |
|-------------------|-------------|---------|---------|---|---|
| F1 PHCs (C6-C10) | 0.0250 mg/L | <0.0250 | <0.0250 | - | - |
| F2 PHCs (C10-C16) | 0.1 mg/L | <0.1 | <0.1 | - | - |
| F3 PHCs (C16-C34) | 0.1 mg/L | <0.1 | <0.1 | - | - |
| F4 PHCs (C34-C50) | 0.1 mg/L | <0.1 | <0.1 | - | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Method Quality Control: Blank

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| Anions | | | | | | | | | |
| Chloride | ND | 1 | mg/L | | | | | | |
| Fluoride | ND | 0.1 | mg/L | | | | | | |
| Nitrate as N | ND | 0.1 | mg/L | | | | | | |
| Nitrite as N | ND | 0.05 | mg/L | | | | | | |
| Sulphate | ND | 1 | mg/L | | | | | | |
| General Inorganics | | | | | | | | | |
| Alkalinity, total | ND | 5 | mg/L | | | | | | |
| Ammonia as N | ND | 0.01 | mg/L | | | | | | |
| Dissolved Organic Carbon | ND | 0.5 | mg/L | | | | | | |
| Colour | ND | 2 | TCU | | | | | | |
| Conductivity | ND | 5 | uS/cm | | | | | | |
| Phenolics | ND | 0.001 | mg/L | | | | | | |
| Total Dissolved Solids | ND | 10 | mg/L | | | | | | |
| Sulphide | ND | 0.02 | mg/L | | | | | | |
| Tannin & Lignin | ND | 0.1 | mg/L | | | | | | |
| Total Kjeldahl Nitrogen | ND | 0.1 | mg/L | | | | | | |
| Turbidity | ND | 0.1 | NTU | | | | | | |
| Hydrocarbons | | | | | | | | | |
| F1 PHCs (C6-C10) | ND | 0.0250 | mg/L | | | | | | |
| Metals | | | | | | | | | |
| Aluminum | ND | 0.001 | mg/L | | | | | | |
| Antimony | ND | 0.0005 | mg/L | | | | | | |
| Arsenic | ND | 0.001 | mg/L | | | | | | |
| Barium | ND | 0.001 | mg/L | | | | | | |
| Beryllium | ND | 0.0005 | mg/L | | | | | | |
| Boron | ND | 0.01 | mg/L | | | | | | |
| Cadmium | ND | 0.0001 | mg/L | | | | | | |
| Calcium | ND | 0.1 | mg/L | | | | | | |
| Chromium | ND | 0.001 | mg/L | | | | | | |
| Cobalt | ND | 0.0005 | mg/L | | | | | | |
| Copper | ND | 0.0005 | mg/L | | | | | | |
| Iron | ND | 0.1 | mg/L | | | | | | |
| Lead | ND | 0.0001 | mg/L | | | | | | |
| Magnesium | ND | 0.2 | mg/L | | | | | | |
| Manganese | ND | 0.005 | mg/L | | | | | | |
| Molybdenum | ND | 0.0005 | mg/L | | | | | | |
| Nickel | ND | 0.001 | mg/L | | | | | | |
| Potassium | ND | 0.1 | mg/L | | | | | | |
| Selenium | ND | 0.001 | mg/L | | | | | | |
| Silver | ND | 0.0001 | mg/L | | | | | | |
| Sodium | ND | 0.2 | mg/L | | | | | | |
| Strontium | ND | 0.01 | mg/L | | | | | | |
| Thallium | ND | 0.001 | mg/L | | | | | | |
| Tin | ND | 0.01 | mg/L | | | | | | |
| Titanium | ND | 0.005 | mg/L | | | | | | |
| Tungsten | ND | 0.01 | mg/L | | | | | | |
| Uranium | ND | 0.0001 | mg/L | | | | | | |
| Vanadium | ND | 0.0005 | mg/L | | | | | | |
| Zinc | ND | 0.005 | mg/L | | | | | | |
| Microbiological Parameters | | | | | | | | | |
| E. coli | ND | 1 | CFU/100mL | | | | | | |
| Fecal Coliforms | ND | 1 | CFU/100mL | | | | | | |
| Total Coliforms | ND | 1 | CFU/100mL | | | | | | |
| Volatiles | | | | | | | | | |
| Benzene | ND | 0.0005 | mg/L | | | | | | |
| Ethylbenzene | ND | 0.0005 | mg/L | | | | | | |
| Toluene | ND | 0.0005 | mg/L | | | | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Method Quality Control: Blank

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| m,p-Xylenes | ND | 0.0005 | mg/L | | | | | | |
| o-Xylene | ND | 0.0005 | mg/L | | | | | | |
| Xylenes, total | ND | 0.0005 | mg/L | | | | | | |
| Surrogate: Toluene-d8 | 0.0848 | | mg/L | | 106 | 50-140 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Method Quality Control: Duplicate

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| Anions | | | | | | | | | |
| Chloride | 4.32 | 1 | mg/L | 4.38 | | | 1.3 | 10 | |
| Fluoride | 0.83 | 0.1 | mg/L | 0.83 | | | 0.4 | 10 | |
| Nitrate as N | 0.21 | 0.1 | mg/L | 0.21 | | | 1.4 | 10 | |
| Nitrite as N | ND | 0.05 | mg/L | ND | | | NC | 10 | |
| Sulphate | 24.4 | 1 | mg/L | 24.3 | | | 0.3 | 10 | |
| General Inorganics | | | | | | | | | |
| Alkalinity, total | 278 | 5 | mg/L | 280 | | | 0.7 | 14 | |
| Ammonia as N | 0.332 | 0.01 | mg/L | 0.334 | | | 0.5 | 17.7 | |
| Dissolved Organic Carbon | ND | 0.5 | mg/L | ND | | | NC | 37 | |
| Colour | ND | 2 | TCU | ND | | | NC | 12 | |
| Conductivity | 829 | 5 | uS/cm | 834 | | | 0.6 | 5 | |
| pH | 7.9 | 0.1 | pH Units | 7.9 | | | 0.3 | 3.3 | |
| Phenolics | ND | 0.001 | mg/L | ND | | | NC | 10 | |
| Total Dissolved Solids | 98.0 | 10 | mg/L | 92.0 | | | 6.3 | 10 | |
| Sulphide | ND | 0.02 | mg/L | ND | | | NC | 10 | |
| Tannin & Lignin | ND | 0.1 | mg/L | ND | | | NC | 11 | |
| Total Kjeldahl Nitrogen | 0.49 | 0.1 | mg/L | 0.55 | | | 11.4 | 16 | |
| Turbidity | 15.7 | 0.1 | NTU | 15.7 | | | 0.0 | 10 | |
| Hydrocarbons | | | | | | | | | |
| F1 PHCs (C6-C10) | ND | 0.0250 | mg/L | ND | | | NC | 30 | |
| Metals | | | | | | | | | |
| Aluminum | 0.099 | 0.001 | mg/L | 0.098 | | | 1.8 | 20 | |
| Antimony | ND | 0.0005 | mg/L | ND | | | NC | 20 | |
| Arsenic | ND | 0.001 | mg/L | ND | | | NC | 20 | |
| Barium | 0.011 | 0.001 | mg/L | 0.011 | | | 0.3 | 20 | |
| Beryllium | ND | 0.0005 | mg/L | ND | | | NC | 20 | |
| Boron | ND | 0.01 | mg/L | ND | | | NC | 20 | |
| Cadmium | ND | 0.0001 | mg/L | ND | | | NC | 20 | |
| Calcium | 7.3 | 0.1 | mg/L | 7.4 | | | 1.2 | 20 | |
| Chromium | ND | 0.001 | mg/L | ND | | | NC | 20 | |
| Cobalt | ND | 0.0005 | mg/L | ND | | | NC | 20 | |
| Copper | 0.0572 | 0.0005 | mg/L | 0.0574 | | | 0.3 | 20 | |
| Iron | ND | 0.1 | mg/L | ND | | | NC | 20 | |
| Lead | 0.0002 | 0.0001 | mg/L | 0.0002 | | | 1.8 | 20 | |
| Magnesium | 1.7 | 0.2 | mg/L | 1.7 | | | 3.2 | 20 | |
| Manganese | ND | 0.005 | mg/L | ND | | | NC | 20 | |
| Molybdenum | ND | 0.0005 | mg/L | ND | | | NC | 20 | |
| Nickel | ND | 0.001 | mg/L | ND | | | NC | 20 | |
| Potassium | 0.6 | 0.1 | mg/L | 0.6 | | | 2.9 | 20 | |
| Selenium | ND | 0.001 | mg/L | ND | | | NC | 20 | |
| Silver | 0.0003 | 0.0001 | mg/L | 0.0003 | | | NC | 20 | |
| Sodium | 15.3 | 0.2 | mg/L | 15.9 | | | 3.9 | 20 | |
| Thallium | ND | 0.001 | mg/L | ND | | | NC | 20 | |
| Tin | ND | 0.01 | mg/L | ND | | | NC | 20 | |
| Titanium | ND | 0.005 | mg/L | ND | | | NC | 50 | |
| Tungsten | ND | 0.01 | mg/L | ND | | | NC | 20 | |
| Uranium | ND | 0.0001 | mg/L | ND | | | NC | 20 | |
| Vanadium | ND | 0.0005 | mg/L | ND | | | NC | 20 | |
| Zinc | ND | 0.005 | mg/L | 0.005 | | | NC | 20 | |
| Microbiological Parameters | | | | | | | | | |
| E. coli | ND | 1 | CFU/100mL | ND | | | NC | 30 | |
| Fecal Coliforms | ND | 1 | CFU/100mL | ND | | | NC | 30 | |
| Total Coliforms | ND | 1 | CFU/100mL | ND | | | NC | 30 | |
| Volatiles | | | | | | | | | |
| Benzene | ND | 0.0005 | mg/L | ND | | | NC | 30 | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Method Quality Control: Duplicate

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| Ethylbenzene | ND | 0.0005 | mg/L | ND | | | NC | 30 | |
| Toluene | ND | 0.0005 | mg/L | ND | | | NC | 30 | |
| m,p-Xylenes | ND | 0.0005 | mg/L | ND | | | NC | 30 | |
| o-Xylene | ND | 0.0005 | mg/L | ND | | | NC | 30 | |
| Surrogate: Toluene-d8 | 0.0834 | | mg/L | | 104 | 50-140 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Method Quality Control: Spike

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| Anions | | | | | | | | | |
| Chloride | 14.1 | 1 | mg/L | 4.38 | 97.3 | 77-123 | | | |
| Fluoride | 1.73 | 0.1 | mg/L | 0.83 | 89.3 | 79-121 | | | |
| Nitrate as N | 1.37 | 0.1 | mg/L | 0.21 | 116 | 79-120 | | | |
| Nitrite as N | 0.876 | 0.05 | mg/L | ND | 87.6 | 84-117 | | | |
| Sulphate | 34.0 | 1 | mg/L | 24.3 | 97.0 | 74-126 | | | |
| General Inorganics | | | | | | | | | |
| Ammonia as N | 0.592 | 0.01 | mg/L | 0.334 | 103 | 81-124 | | | |
| Dissolved Organic Carbon | 12.4 | 0.5 | mg/L | ND | 124 | 60-133 | | | |
| Phenolics | 0.028 | 0.001 | mg/L | ND | 110 | 67-133 | | | |
| Total Dissolved Solids | 104 | 10 | mg/L | ND | 104 | 75-125 | | | |
| Sulphide | 0.51 | 0.02 | mg/L | ND | 102 | 79-115 | | | |
| Tannin & Lignin | 1.0 | 0.1 | mg/L | ND | 96.8 | 71-113 | | | |
| Total Kjeldahl Nitrogen | 2.46 | 0.1 | mg/L | 0.55 | 95.7 | 81-126 | | | |
| Hydrocarbons | | | | | | | | | |
| F1 PHCs (C6-C10) | 1.62 | 0.0250 | mg/L | ND | 81.1 | 68-117 | | | |
| Metals | | | | | | | | | |
| Aluminum | 43.3 | 0.001 | mg/L | ND | 86.6 | 80-120 | | | |
| Antimony | 46.1 | 0.0005 | mg/L | 0.0126 | 92.3 | 80-120 | | | |
| Arsenic | 45.3 | 0.001 | mg/L | 0.162 | 90.3 | 80-120 | | | |
| Barium | 53.1 | 0.001 | mg/L | 10.8 | 84.7 | 80-120 | | | |
| Beryllium | 40.9 | 0.0005 | mg/L | 0.0096 | 81.8 | 80-120 | | | |
| Boron | 40.3 | 0.01 | mg/L | 3.86 | 72.8 | 80-120 | | | QM-07 |
| Cadmium | 44.8 | 0.0001 | mg/L | 0.0101 | 89.7 | 80-120 | | | |
| Calcium | 15400 | 0.1 | mg/L | 7370 | 80.4 | 80-120 | | | |
| Chromium | 43.6 | 0.001 | mg/L | 0.120 | 87.0 | 80-120 | | | |
| Cobalt | 43.7 | 0.0005 | mg/L | 0.0198 | 87.5 | 80-120 | | | |
| Copper | 96.2 | 0.0005 | mg/L | 57.4 | 77.5 | 80-120 | | | QM-07 |
| Iron | 2170 | 0.1 | mg/L | 11.0 | 86.3 | 80-120 | | | |
| Lead | 40.5 | 0.0001 | mg/L | 0.189 | 80.6 | 80-120 | | | |
| Magnesium | 10700 | 0.2 | mg/L | 1750 | 89.9 | 80-120 | | | |
| Manganese | 45.5 | 0.005 | mg/L | 1.80 | 87.5 | 80-120 | | | |
| Molybdenum | 41.2 | 0.0005 | mg/L | 0.175 | 82.1 | 80-120 | | | |
| Nickel | 43.5 | 0.001 | mg/L | 0.483 | 86.0 | 80-120 | | | |
| Potassium | 9640 | 0.1 | mg/L | 624 | 90.1 | 80-120 | | | |
| Selenium | 42.6 | 0.001 | mg/L | 0.022 | 85.2 | 80-120 | | | |
| Silver | 43.8 | 0.0001 | mg/L | 0.261 | 87.1 | 80-120 | | | |
| Sodium | 23700 | 0.2 | mg/L | 15900 | 77.5 | 80-120 | | | QM-07 |
| Thallium | 43.9 | 0.001 | mg/L | 0.006 | 87.7 | 80-120 | | | |
| Tin | 42.0 | 0.01 | mg/L | 0.12 | 83.7 | 80-120 | | | |
| Titanium | 47.6 | 0.005 | mg/L | ND | 95.1 | 70-130 | | | |
| Tungsten | 44.3 | 0.01 | mg/L | 0.04 | 88.5 | 80-120 | | | |
| Uranium | 42.1 | 0.0001 | mg/L | 0.0060 | 84.2 | 80-120 | | | |
| Vanadium | 44.1 | 0.0005 | mg/L | 0.0918 | 88.1 | 80-120 | | | |
| Zinc | 48.0 | 0.005 | mg/L | 5.05 | 85.9 | 80-120 | | | |
| Volatiles | | | | | | | | | |
| Benzene | 0.0353 | 0.0005 | mg/L | ND | 88.3 | 60-130 | | | |
| Ethylbenzene | 0.0376 | 0.0005 | mg/L | ND | 94.0 | 60-130 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Method Quality Control: Spike

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| Toluene | 0.0391 | 0.0005 | mg/L | ND | 97.8 | 60-130 | | | |
| m,p-Xylenes | 0.0748 | 0.0005 | mg/L | ND | 93.5 | 60-130 | | | |
| o-Xylene | 0.0376 | 0.0005 | mg/L | ND | 93.9 | 60-130 | | | |
| Surrogate: Toluene-d8 | 0.0809 | | mg/L | | 101 | 50-140 | | | |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: McIntosh Perry Consulting Eng. (Carp)

Order Date: 4-Feb-2022

Client PO: Corkery Community Centre

Project Description: 21-3339

Qualifier Notes:

Login Qualifiers :

Container(s) - Labeled improperly/insufficient information - Sample time on bottles read: "AM", COC reads "10:40".

Applies to samples: TW1-1

Container(s) - Labeled improperly/insufficient information - Sample time on bottles read: "PM". COC reads: "15:10".

Applies to samples: TW1-2

Sample Qualifiers :

QC Qualifiers :

QM-07 : The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

Sample Data Revisions

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

CCME PHC additional information:

- The method for the analysis of PHCs complies with the Reference Method for the CWS PHC and is validated for use in the laboratory. All prescribed quality criteria identified in the method has been met.
- F1 range corrected for BTEX.
- F2 to F3 ranges corrected for appropriate PAHs where available.
- The gravimetric heavy hydrocarbons (F4G) are not to be added to C6 to C50 hydrocarbons.
- In the case where F4 and F4G are both reported, the greater of the two results is to be used for comparison to CWS PHC criteria.
- When reported, data for F4G has been processed using a silica gel cleanup.



2206476

No 14958

| | | | |
|-----------------------------------|---|---------------------|--|
| Client Name: McIntosh Perry | Project Ref: Corkey Community Centre | Waterworks Name: | Samples Taken By: |
| Contact Name: Monica Black | Quote #: | Waterworks Number: | Name: Monica Black |
| Address: 115 Walgreen Rd, Corp ON | PO #: 21-3339 | Address: | Signature: <i>M. Black</i> |
| After Hours Contact: | E-mail: m.black@mcintoshperry.com p.muniz@mcintoshperry.com | Public Health Unit: | Page 1 of 1 |
| Telephone: | Fax: | | Turn Around Time Required: <input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day |

| Samples Submitted Under: (Indicate ONLY one) <input type="checkbox"/> ON REG 170/03 <input type="checkbox"/> ON REG 319/08 <input type="checkbox"/> Private Well <input type="checkbox"/> ON REG 243/07 <input checked="" type="checkbox"/> Other ODWSOG | | Sample Type: R = Raw; T = Treated; D = Distribution; P = Plumbing Source Type: G = Ground Water; S = Surface Water Reportable: Requires AWQI reporting as per Regulation - Y = Yes; N = No | | Required Analyses | | | | | | | | | | | | | | | |
|---|-----------|--|------------------|---|----------|------------------|----------|-----------------|--------------------------------------|-------------------------------------|------------------------|-----|------|-----|---------------------------|------|-----|--------------|---|
| Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A Are these samples for human consumption?: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No | | All information must be completed before samples will be processed. | | Free/Combined Chlorine Residual mg/L Standing / Flushed: S / F (REG 243) Total Coliform/E. Coli HPC Lead THM sub div 5 supply residual BTEX PHC trace metals | | | | | | | | | | | | | | | |
| LOCATION NAME | SAMPLE ID | Sample Type: R/T/D/P | Source Type: G/S | Reportable: Y/N | Resample | SAMPLE COLLECTED | | # of Containers | Free/Combined Chlorine Residual mg/L | Standing / Flushed: S / F (REG 243) | Total Coliform/E. Coli | HPC | Lead | THM | sub div 5 supply residual | BTEX | PHC | trace metals | |
| | | | | | | DATE | TIME | | | | | | | | | | | | |
| 1 | TW1-1 | R G | N N | | | 03-02-22 | 10:40 AM | 11 | | | | | | | | X | X | X | X |
| 2 | TW1-2 | R G | N N | | | 03-02-22 | 3:10 PM | 11 | | | | | | | | X | X | X | X |
| 3 | | | | | | | | | | | | | | | | | | | |
| 4 | | | | | | | | | | | | | | | | | | | |
| 5 | | | | | | | | | | | | | | | | | | | |
| 6 | | | | | | | | | | | | | | | | | | | |
| 7 | | | | | | | | | | | | | | | | | | | |
| 8 | | | | | | | | | | | | | | | | | | | |
| 9 | | | | | | | | | | | | | | | | | | | |
| 10 | | | | | | | | | | | | | | | | | | | |

Comments: trace metals = aluminum, antimony, arsenic, barium, beryllium, boron, cadmium, chromium, cobalt, copper, lead, molybdenum, nickel, selenium, silver, strontium, thallium, uranium, vanadium, zinc

Method of Delivery: *uak*

| | | | |
|---|--|-------------------------------------|---|
| Relinquished By (Sign): <i>Monica Black</i> | Received By Driver/Depot: <i>[Signature]</i> | Received at Lab: <i>[Signature]</i> | Verified By: <i>[Signature]</i> |
| Relinquished By (Print): Monica Black | Date/Time: Feb 4/22 | Date/Time: Feb 4/2022 10:55 | Date/Time: Feb 9/2022 11:27 |
| Date/Time: 03-02-22 5:15 pm | Temperature: 10.3 °C | Temperature: 1.8 °C | pH Verified: <input checked="" type="checkbox"/> By: <i>[Signature]</i> |

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



APPENDIX C: CALCULATIONS

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



APPENDIX D: MECP WATER WELL INFORMATION SYSTEM DATA

Print only in spaces provided.
Mark correct box with a checkmark, where applicable.

11

1530802

Municipality: 15005, Con: COX, 08

County or District: OTTAWA-CARLETON
Township/Borough/City/Town/Village: WEST CARLETON (Huntley)
Con block tract survey, etc.: CONCESSION B, Lot: 9
Address: 5670 Carp Rd, Kirkburn, Ontario K0A 2H0.
Date completed: 09 09 99

Zone, Easting, Northing, RC, Elevation, RC, Basin Code, II, III, IV

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)

| General colour | Most common material | Other materials | General description | Depth - feet | |
|----------------|----------------------|--------------------------------|---------------------|--------------|-----|
| | | | | From | To |
| GREY | LIMESTONE | SHALE (RED-GREEN) SANDSTONE | | 0 | 238 |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |

31
32

41 WATER RECORD

| Water found at - feet | Kind of water |
|-----------------------|--|
| 22 | 1 Fresh 2 Salty 3 Sulphur 4 Minerals 5 Gas |
| 15-18 | 1 Fresh 2 Salty 3 Sulphur 4 Minerals 5 Gas |
| 20-23 | 1 Fresh 2 Salty 3 Sulphur 4 Minerals 5 Gas |
| 25-28 | 1 Fresh 2 Salty 3 Sulphur 4 Minerals 5 Gas |
| 30-32 | 1 Fresh 2 Salty 3 Sulphur 4 Minerals 5 Gas |

51 CASING & OPEN HOLE RECORD

| Inside diam inches | Material | Wall thickness inches | Depth - feet | |
|--------------------|---|-----------------------|--------------|-----|
| | | | From | To |
| 6 1/4" | 1 Steel 2 Galvanized 3 Concrete 4 Open hole 5 Plastic | .188" | +2 | 42 |
| 6" | 1 Steel 2 Galvanized 3 Concrete 4 Open hole 5 Plastic | | 42 | 238 |
| 24-25 | 1 Steel 2 Galvanized 3 Concrete 4 Open hole 5 Plastic | | | |

SCREEN

| Sizes of opening (Slot No.) | Diameter inches | Length feet |
|-----------------------------|-----------------|-----------------------------|
| | | |
| Material and type | | Depth at top of screen feet |

61 PLUGGING & SEALING RECORD

| Depth set at - feet | | Material and type (Cement grout, bentonite, etc.) |
|---------------------|-------|---|
| From | To | |
| 2 | 17 | Cement grout |
| 14-21 | 22-25 | |
| 26-29 | 30-33 | |


71 PUMPING TEST

Pumping test method: Pump, Bailor
Pumping rate: 12 GPM
Duration of pumping: 1 Hours, 0 Mins

| Static level | Water level end of pumping | Water levels during Pumping | | | |
|--------------|----------------------------|-----------------------------|------------|------------|------------|
| feet | feet | 15 minutes | 30 minutes | 45 minutes | 60 minutes |
| 82 | 95 | 90 | 94 | 95 | 95 |

If flowing give rate: _____ GPM
Pump intake set at: 150 feet
Water at end of test: Clear, Cloudy

Recommended pump type: Shallow, Deep
Recommended pump setting: 150 feet
Recommended pump rate: 10 GPM

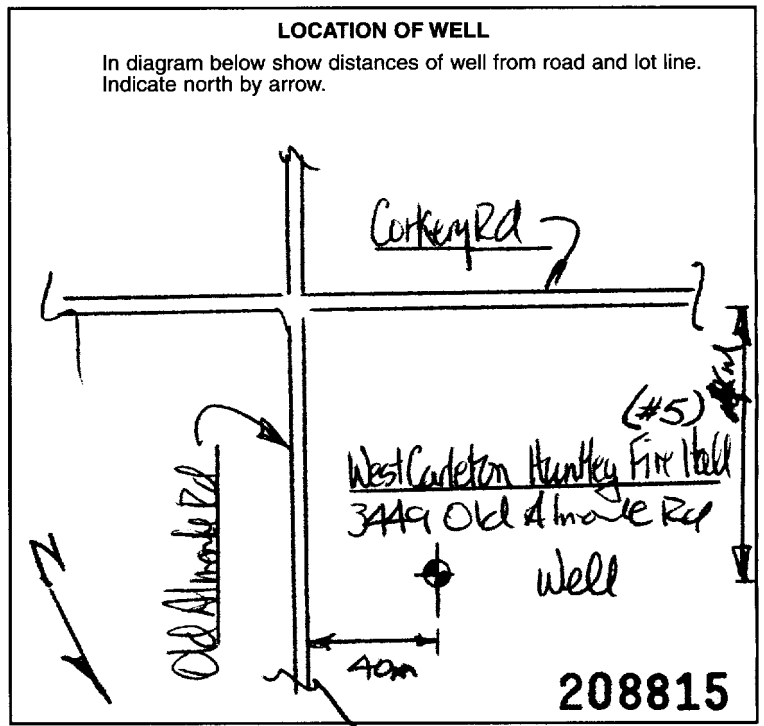

FINAL STATUS OF WELL

1 Water supply
2 Observation well
3 Test hole
4 Recharge well

5 Abandoned, insufficient supply
6 Abandoned, poor quality
7 Abandoned (Other)
8 Dewatering

9 Unfinished
10 Replacement well

WATER USE

1 Domestic
2 Stock
3 Irrigation
4 Industrial

5 Commercial
6 Municipal
7 Public supply
8 Cooling & air conditioning

9 Not use
10 Other

METHOD OF CONSTRUCTION

1 Cable tool
2 Rotary (conventional)
3 Rotary (reverse)
4 Rotary (air)

5 Air percussion
6 Boring
7 Diamond
8 Jetting

9 Driving
10 Digging
11 Other

Name of Well Contractor: STANTON DRILLING INC
Well Contractor's Licence No.: 4875
Address: Box 219, Pakenham, Ont.
Name of Well Technician: Peter Stanton
Well Technician's Licence No.: T-20086
Signature of Well Contractor: [Signature]
Submission date: 30 mo 09 yr 99

MINISTRY USE ONLY

Data source: 4875
Date received: OCT 22 1999
Date of inspection: _____
Inspector: _____
Remarks: _____
CSS.ES0

**FIRE HALL (TW2
at 3449 Old
Almonte Rd)**

WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED
2. CHECK CORRECT BOX WHERE APPLICABLE

1520285

| | | | |
|--|--|---|---|
| COUNTY OR DISTRICT Ottawa-Carleton | TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE West Carleton-Huntley | CON. BLOCK, TRACT, SURVEY, ETC. Conc. 8 | LOT 9 |
| OWNER (SURNAME FIRST) [REDACTED] | | ADDRESS Carp, Ontario. KOA 1L0 | DATE COMPLETED DAY 18 MO 11 YR 85 |

| GENERAL COLOUR | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET | |
|----------------|----------------------|-----------------|---------------------|--------------|-----|
| | | | | FROM | TO |
| Brown | Sand & Gravel | | | 0 | 6 |
| Brown | Shale | | | 6 | 10 |
| Gray | Limestone | | medium | 10 | 150 |


| 41 WATER RECORD | |
|-----------------------|---|
| WATER FOUND AT - FEET | KIND OF WATER |
| 10-13 125' | 1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL |
| 15-18 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL |
| 20-23 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL |
| 25-28 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL |
| 30-33 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL |

| 51 CASING & OPEN HOLE RECORD | | | | |
|------------------------------|---|-----------------------|--------------|-----|
| INSIDE DIAM INCHES | MATERIAL | WALL THICKNESS INCHES | DEPTH - FEET | |
| | | | FROM | TO |
| 10-11 6 1/4 | 1 <input checked="" type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE | .188 | 0 | 22 |
| 17-18 5 15/16 | 1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE | | 22 | 150 |
| 24-25 | 1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE | | | |

| SCREEN | SIZE(S) OF OPENING (SLOT NO.) | DIAMETER | LENGTH |
|-------------------|-------------------------------|------------------------|--------|
| | | INCHES | FEET |
| MATERIAL AND TYPE | | DEPTH TO TOP OF SCREEN | |
| | | 41-44 FEET | |

| 61 PLUGGING & SEALING RECORD | | |
|------------------------------|-------------------|----------------------------------|
| DEPTH SET AT - FEET | MATERIAL AND TYPE | (CEMENT GROUT LEAD PACKER, ETC.) |
| FROM TO | | |
| 10-13 | 14-17 | |
| 18-21 | 22-25 | |
| 26-29 | 30-33 | 80 |

| 71 PUMPING TEST | PUMPING TEST METHOD 1 <input checked="" type="checkbox"/> PUMP 2 <input type="checkbox"/> BAILER | PUMPING RATE 8 GPM | DURATION OF PUMPING 15-16 HOURS 17-18 MINS 1 | | | |
|--|---|---|---|-----------------|-----------------|-----------------|
| | STATIC LEVEL 115 FEET | WATER LEVEL END OF PUMPING 125 FEET | WATER LEVELS DURING 1 <input checked="" type="checkbox"/> PUMPING 2 <input type="checkbox"/> RECOVERY | | | |
| | 19-21 | 22-24 | 25-28 | 29-31 | 32-34 | 35-37 |
| | 115 FEET | 125 FEET | 125 FEET | 125 FEET | 125 FEET | 125 FEET |
| | IF FLOWING, GIVE RATE | PUMP INTAKE SET AT 125 FEET | WATER AT END OF TEST 1 <input checked="" type="checkbox"/> CLEAR 2 <input type="checkbox"/> CLOUDY | | | |
| RECOMMENDED PUMP TYPE <input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP | RECOMMENDED PUMP SETTING 135 FEET | RECOMMENDED PUMPING RATE 5 GPM | | | | |

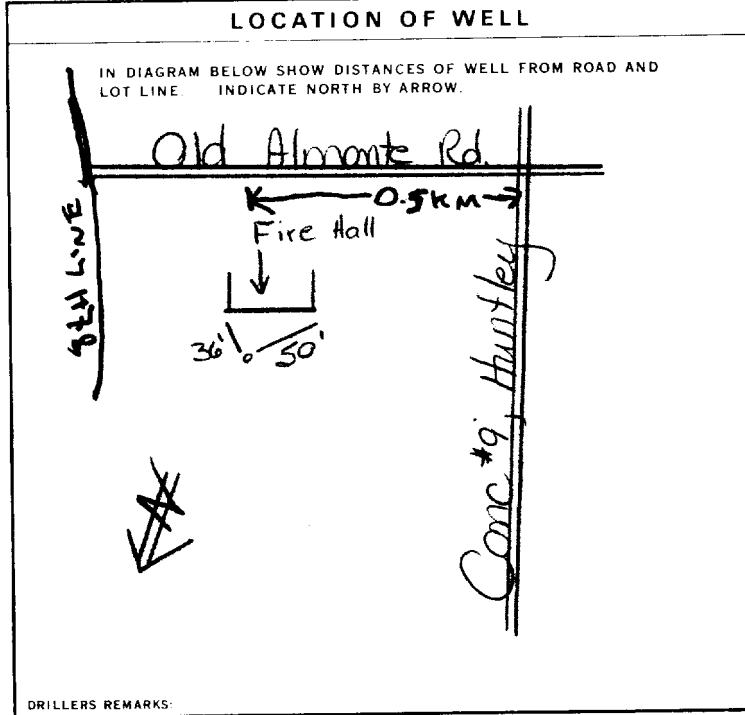

| 84 FINAL STATUS OF WELL | 1 <input checked="" type="checkbox"/> WATER SUPPLY 2 <input type="checkbox"/> OBSERVATION WELL 3 <input type="checkbox"/> TEST HOLE 4 <input type="checkbox"/> RECHARGE WELL | 5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY 6 <input type="checkbox"/> ABANDONED POOR QUALITY 7 <input type="checkbox"/> UNFINISHED |
|-------------------------|---|--|
| 85-86 WATER USE | 1 <input checked="" type="checkbox"/> DOMESTIC 2 <input type="checkbox"/> STOCK 3 <input type="checkbox"/> IRRIGATION 4 <input type="checkbox"/> INDUSTRIAL 5 <input type="checkbox"/> OTHER | 5 <input type="checkbox"/> COMMERCIAL 6 <input type="checkbox"/> MUNICIPAL 7 <input type="checkbox"/> PUBLIC SUPPLY 8 <input type="checkbox"/> COOLING OR AIR CONDITIONING 9 <input type="checkbox"/> NOT USED |
| 87 METHOD OF DRILLING | 1 <input type="checkbox"/> CABLE TOOL 2 <input type="checkbox"/> ROTARY (CONVENTIONAL) 3 <input type="checkbox"/> ROTARY (REVERSE) 4 <input type="checkbox"/> ROTARY (AIR) 5 <input checked="" type="checkbox"/> AIR PERCUSSION | 6 <input type="checkbox"/> BORING 7 <input type="checkbox"/> DIAMOND 8 <input type="checkbox"/> JETTING 9 <input type="checkbox"/> DRIVING |

| | | |
|------------|---|--|
| CONTRACTOR | NAME OF WELL CONTRACTOR Capital Water Supply Ltd. | LICENCE NUMBER 1558 |
| | ADDRESS Box 490; Stittsville, Ontario. KOA 3G0 | |
| | NAME OF DRILLER OR BORER S. Miller | LICENCE NUMBER |
| | SIGNATURE OF CONTRACTOR <i>[Signature]</i> | SUBMISSION DATE DAY 18 MO 11 YR 85 |

| | | | |
|-----------------|------------------------|------------|--------------------------------|
| OFFICE USE ONLY | DATA SOURCE | CONTRACTOR | DATE RECEIVED 210185 |
| | DATE OF INSPECTION | INSPECTOR | |
| | REMARKS CSSE | | |

| WELL_ID | COMPLETED | WELL DEPTH (m) | STATIC WATER LEVEL (m) | DEPTH TO BEDROCK (m) | FINAL STATUS | USE1 | GEOLOGY | FORMATION_TOP_DEPTH | FORMATION_END_DEPTH | UNITS OF MEASUREMENT |
|---------|-----------|----------------|------------------------|----------------------|--------------|----------|----------------------------|---------------------|---------------------|----------------------|
| 1513333 | 12-Jul-73 | 32 | 3.7 | 0.9144 | Water Supply | Domestic | LIMESTONE,, | 80 | 100 | ft |
| 1513333 | 12-Jul-73 | 32 | 3.7 | 0.9144 | Water Supply | Domestic | SAND, GRAVEL,, | 0 | 3 | ft |
| 1513333 | 12-Jul-73 | 32 | 3.7 | 0.9144 | Water Supply | Domestic | LIMESTONE,, | 65 | 80 | ft |
| 1513333 | 12-Jul-73 | 32 | 3.7 | 0.9144 | Water Supply | Domestic | LIMESTONE,, | 3 | 65 | ft |
| 1513333 | 12-Jul-73 | 32 | 3.7 | 0.9144 | Water Supply | Domestic | LIMESTONE,, | 100 | 105 | ft |
| 1513502 | 03-Aug-73 | 41.1 | 27.4 | 1.8288 | Water Supply | Domestic | GRAVEL, SAND,, | 0 | 6 | ft |
| 1513502 | 03-Aug-73 | 41.1 | 27.4 | 1.8288 | Water Supply | Domestic | LIMESTONE,, | 6 | 24 | ft |
| 1513502 | 03-Aug-73 | 41.1 | 27.4 | 1.8288 | Water Supply | Domestic | LIMESTONE,, | 24 | 53 | ft |
| 1513502 | 03-Aug-73 | 41.1 | 27.4 | 1.8288 | Water Supply | Domestic | LIMESTONE,, | 53 | 135 | ft |
| 1515273 | 06-Aug-75 | 45.7 | 24.4 | 2.1336 | Water Supply | Domestic | SANDSTONE, SAND, LAYERED | 7 | 16 | ft |
| 1515273 | 06-Aug-75 | 45.7 | 24.4 | 2.1336 | Water Supply | Domestic | LIMESTONE, DENSE,, | 16 | 128 | ft |
| 1515273 | 06-Aug-75 | 45.7 | 24.4 | 2.1336 | Water Supply | Domestic | LIMESTONE, SAND, LAYERED | 128 | 150 | ft |
| 1515273 | 06-Aug-75 | 45.7 | 24.4 | 2.1336 | Water Supply | Domestic | SAND, STONES, LOOSE | 0 | 7 | ft |
| 1515274 | 11-Aug-75 | 39.6 | 21.3 | 0.9144 | Water Supply | Domestic | SAND, STONES, LOOSE | 0 | 3 | ft |
| 1515274 | 11-Aug-75 | 39.6 | 21.3 | 0.9144 | Water Supply | Domestic | LIMESTONE, DENSE,, | 9 | 114 | ft |
| 1515274 | 11-Aug-75 | 39.6 | 21.3 | 0.9144 | Water Supply | Domestic | LIMESTONE, SAND, LAYERED | 114 | 130 | ft |
| 1515274 | 11-Aug-75 | 39.6 | 21.3 | 0.9144 | Water Supply | Domestic | SANDSTONE, LAYERED, | 3 | 9 | ft |
| 1514296 | 04-Jul-74 | 53.3 | 18.9 | 2.7432 | Water Supply | Domestic | SAND,, | 0 | 9 | ft |
| 1514296 | 04-Jul-74 | 53.3 | 18.9 | 2.7432 | Water Supply | Domestic | LIMESTONE,, | 9 | 175 | ft |
| 1514297 | 04-Jul-74 | 42.1 | 27.4 | 1.524 | Water Supply | Domestic | CLAY,, | 0 | 5 | ft |
| 1514297 | 04-Jul-74 | 42.1 | 27.4 | 1.524 | Water Supply | Domestic | LIMESTONE,, | 5 | 138 | ft |
| 1514298 | 02-Jul-74 | 71.9 | 27.4 | 0.6096 | Water Supply | Domestic | LIMESTONE,, | 2 | 236 | ft |
| 1514298 | 02-Jul-74 | 71.9 | 27.4 | 0.6096 | Water Supply | Domestic | SAND,, | 0 | 2 | ft |
| 1514299 | 03-Jul-74 | 48.2 | 21 | 1.524 | Water Supply | Domestic | SAND,, | 0 | 5 | ft |
| 1514299 | 03-Jul-74 | 48.2 | 21 | 1.524 | Water Supply | Domestic | LIMESTONE,, | 5 | 158 | ft |
| 1514300 | 03-Jul-74 | 47.2 | 19.8 | 1.2192 | Water Supply | Domestic | SAND,, | 0 | 4 | ft |
| 1514300 | 03-Jul-74 | 47.2 | 19.8 | 1.2192 | Water Supply | Domestic | LIMESTONE,, | 4 | 155 | ft |
| 1514301 | 03-Jul-74 | 34.7 | 20.7 | 1.2192 | Water Supply | Domestic | FILL,, | 0 | 4 | ft |
| 1514301 | 03-Jul-74 | 34.7 | 20.7 | 1.2192 | Water Supply | Domestic | LIMESTONE,, | 4 | 114 | ft |
| 1514302 | 05-Jul-74 | 47.2 | 20.1 | 2.4384 | Water Supply | Domestic | FILL,, | 0 | 8 | ft |
| 1514302 | 05-Jul-74 | 47.2 | 20.1 | 2.4384 | Water Supply | Domestic | LIMESTONE,, | 8 | 155 | ft |
| 1514303 | 05-Jul-74 | 28.7 | 18.6 | 1.8288 | Water Supply | Domestic | FILL,, | 0 | 6 | ft |
| 1514303 | 05-Jul-74 | 28.7 | 18.6 | 1.8288 | Water Supply | Domestic | LIMESTONE,, | 6 | 94 | ft |
| 1514409 | 10-Oct-74 | 45.1 | 15.2 | 1.542 | Water Supply | Domestic | GRAVEL,, | 0 | 5 | ft |
| 1514409 | 10-Oct-74 | 45.1 | 15.2 | 1.542 | Water Supply | Domestic | LIMESTONE,, | 5 | 148 | ft |
| 1515929 | 17-May-77 | 41.1 | 26.8 | 2.1336 | Water Supply | Domestic | LIMESTONE,, | 7 | 130 | ft |
| 1515929 | 17-May-77 | 41.1 | 26.8 | 2.1336 | Water Supply | Domestic | LIMESTONE,, | 130 | 135 | ft |
| 1515929 | 17-May-77 | 41.1 | 26.8 | 2.1336 | Water Supply | Domestic | SAND, GRAVEL, BOULDERS | 0 | 7 | ft |
| 1516427 | 09-Aug-77 | 22.3 | 16.2 | 2.1336 | Water Supply | Domestic | LIMESTONE,, | 7 | 65 | ft |
| 1516427 | 09-Aug-77 | 22.3 | 16.2 | 2.1336 | Water Supply | Domestic | SANDSTONE,, | 65 | 73 | ft |
| 1516427 | 09-Aug-77 | 22.3 | 16.2 | 2.1336 | Water Supply | Domestic | SAND,, | 0 | 7 | ft |
| 1517091 | 20-Aug-79 | 25.9 | 7.6 | 1.2336 | Water Supply | Domestic | SAND,, | 0 | 4 | ft |
| 1517091 | 20-Aug-79 | 25.9 | 7.6 | 1.2336 | Water Supply | Domestic | LIMESTONE,, | 4 | 85 | ft |
| 1517168 | 14-Sep-79 | 27.7 | 6.1 | 2.4384 | Water Supply | Domestic | SAND, GRAVEL,, | 0 | 8 | ft |
| 1517168 | 14-Sep-79 | 27.7 | 6.1 | 2.4384 | Water Supply | Domestic | LIMESTONE,, | 8 | 91 | ft |
| 1517304 | 10-Apr-80 | 29 | 9.1 | 2.7432 | Water Supply | Domestic | SAND,, | 0 | 9 | ft |
| 1517304 | 10-Apr-80 | 29 | 9.1 | 2.7432 | Water Supply | Domestic | LIMESTONE,, | 9 | 95 | ft |
| 1517305 | 14-May-80 | 39.3 | 25.9 | 0.6144 | Water Supply | Domestic | LIMESTONE,, | 3 | 129 | ft |
| 1517305 | 14-May-80 | 39.3 | 25.9 | 0.6144 | Water Supply | Domestic | SAND,, | 0 | 3 | ft |
| 1517359 | 30-Sep-80 | 34.7 | 13.7 | 2.1336 | Water Supply | Domestic | GRAVEL,, | 0 | 7 | ft |
| 1517359 | 30-Sep-80 | 34.7 | 13.7 | 2.1336 | Water Supply | Domestic | LIMESTONE,, | 7 | 114 | ft |
| 1517360 | 22-Oct-80 | 36.9 | 0.9 | 0 | Water Supply | Domestic | LIMESTONE,, | 0 | 121 | ft |
| 1517362 | 13-Aug-80 | 37.8 | 27.4 | 1.524 | Water Supply | Domestic | SAND,, | 0 | 5 | ft |
| 1517362 | 13-Aug-80 | 37.8 | 27.4 | 1.524 | Water Supply | Domestic | LIMESTONE,, | 5 | 124 | ft |
| 1518647 | 03-Aug-83 | 45.7 | 9.1 | 0 | Water Supply | Domestic | LIMESTONE,, | 0 | 25 | ft |
| 1518647 | 03-Aug-83 | 45.7 | 9.1 | 0 | Water Supply | Domestic | LIMESTONE,, | 25 | 110 | ft |
| 1518647 | 03-Aug-83 | 45.7 | 9.1 | 0 | Water Supply | Domestic | LIMESTONE,, | 110 | 150 | ft |
| 1519078 | 12-Jul-84 | 59.4 | 12.2 | 1.8288 | Water Supply | Domestic | SAND, STONES, LOOSE | 0 | 6 | ft |
| 1519078 | 12-Jul-84 | 59.4 | 12.2 | 1.8288 | Water Supply | Domestic | LIMESTONE, MEDIUM-GRAINED, | 188 | 195 | ft |
| 1519078 | 12-Jul-84 | 59.4 | 12.2 | 1.8288 | Water Supply | Domestic | LIMESTONE, MEDIUM-GRAINED, | 6 | 188 | ft |
| 1519709 | 23-May-85 | 43 | 27.1 | 0.9144 | Water Supply | Domestic | SHALE,, | 139 | 141 | ft |
| 1519709 | 23-May-85 | 43 | 27.1 | 0.9144 | Water Supply | Domestic | TOPSOIL, SAND, STONES | 0 | 3 | ft |
| 1519709 | 23-May-85 | 43 | 27.1 | 0.9144 | Water Supply | Domestic | LIMESTONE,, | 3 | 139 | ft |
| 1520026 | 12-Jun-85 | 19.2 | 7.6 | 1.2192 | Water Supply | Domestic | GRAVEL,, | 0 | 4 | ft |
| 1520026 | 12-Jun-85 | 19.2 | 7.6 | 1.2192 | Water Supply | Domestic | LIMESTONE,, | 4 | 63 | ft |
| 1520285 | 18-Nov-85 | 45.7 | 35.1 | 1.8288 | Water Supply | Domestic | SAND, GRAVEL,, | 0 | 6 | ft |
| 1520285 | 18-Nov-85 | 45.7 | 35.1 | 1.8288 | Water Supply | Domestic | SHALE,, | 6 | 10 | ft |
| 1520285 | 18-Nov-85 | 45.7 | 35.1 | 1.8288 | Water Supply | Domestic | LIMESTONE, MEDIUM-GRAINED, | 10 | 150 | ft |
| 1520403 | 27-Nov-85 | 32 | 9.4 | 1.2192 | Water Supply | Domestic | FILL, PACKED, | 0 | 4 | ft |
| 1520403 | 27-Nov-85 | 32 | 9.4 | 1.2192 | Water Supply | Domestic | LIMESTONE, MEDIUM-GRAINED, | 8 | 105 | ft |
| 1520403 | 27-Nov-85 | 32 | 9.4 | 1.2192 | Water Supply | Domestic | LIMESTONE, SOFT, FRACTURED | 4 | 8 | ft |
| 1520545 | 14-May-86 | 34.1 | 2.4 | 0.6096 | Water Supply | Domestic | LIMESTONE,, | 2 | 83 | ft |
| 1520545 | 14-May-86 | 34.1 | 2.4 | 0.6096 | Water Supply | Domestic | SHALE, SANDSTONE, | 83 | 91 | ft |
| 1520545 | 14-May-86 | 34.1 | 2.4 | 0.6096 | Water Supply | Domestic | TOPSOIL,, | 0 | 2 | ft |

| | | | | | | | | | |
|---------|-----------|------|------|--------|--------------|----------|--|-------|---------|
| 1520545 | 14-May-86 | 34.1 | 2.4 | 0.6096 | Water Supply | Domestic | LIMESTONE,, | 91 | 112 ft |
| 1520546 | 30-Apr-86 | 27.7 | 4.9 | 0.6096 | Test Hole | Domestic | TOPSOIL,SAND, | 0 | 2 ft |
| 1520546 | 30-Apr-86 | 27.7 | 4.9 | 0.6096 | Test Hole | Domestic | LIMESTONE,SHALE,TOPSOIL | 2 | 84 ft |
| 1520546 | 30-Apr-86 | 27.7 | 4.9 | 0.6096 | Test Hole | Domestic | SHALE,SANDSTONE, | 84 | 91 ft |
| 1520547 | 19-Mar-86 | 62.8 | 21.3 | 0.6096 | Test Hole | Domestic | TOPSOIL,SAND, | 0 | 2 ft |
| 1520547 | 19-Mar-86 | 62.8 | 21.3 | 0.6096 | Test Hole | Domestic | LIMESTONE,SHALE, | 2 | 177 ft |
| 1520547 | 19-Mar-86 | 62.8 | 21.3 | 0.6096 | Test Hole | Domestic | SHALE,SANDSTONE, | 177 | 206 ft |
| 1520548 | 05-Feb-86 | 33.5 | 4.3 | 4.572 | Test Hole | Domestic | GRAVEL,SAND, | 0 | 10 ft |
| 1520548 | 05-Feb-86 | 33.5 | 4.3 | 4.572 | Test Hole | Domestic | CLAY,, | 10 | 15 ft |
| 1520548 | 05-Feb-86 | 33.5 | 4.3 | 4.572 | Test Hole | Domestic | LIMESTONE,SHALE, | 15 | 110 ft |
| 1520549 | 22-Jan-86 | 45.7 | 0.9 | 0.6096 | Water Supply | Domestic | GRAVEL,TOPSOIL,SANDY | 0 | 2 ft |
| 1520549 | 22-Jan-86 | 45.7 | 0.9 | 0.6096 | Water Supply | Domestic | LIMESTONE,, | 6 | 150 ft |
| 1520549 | 22-Jan-86 | 45.7 | 0.9 | 0.6096 | Water Supply | Domestic | SHALE,, | 2 | 6 ft |
| 1520802 | 25-Mar-86 | 50.3 | 19.8 | 0.9144 | Water Supply | Domestic | CLAY,THICK, | 0 | 3 ft |
| 1520802 | 25-Mar-86 | 50.3 | 19.8 | 0.9144 | Water Supply | Domestic | LIMESTONE,MEDIUM- GRAINED,HARD | 3 | 165 ft |
| 1521442 | 02-Jun-87 | 56.4 | 18.3 | 0.9144 | Water Supply | Domestic | CLAY,, | 0 | 3 ft |
| 1521442 | 02-Jun-87 | 56.4 | 18.3 | 0.9144 | Water Supply | Domestic | SANDSTONE,, | 3 | 185 ft |
| 1522756 | 14-Oct-88 | 43.6 | 25.9 | 2.1336 | Water Supply | Domestic | LIMESTONE,SHALE,SANDSTONE | 13 | 143 ft |
| 1522756 | 14-Oct-88 | 43.6 | 25.9 | 2.1336 | Water Supply | Domestic | SHALE,FRACTURED,FRACTURED | 7 | 13 ft |
| 1522756 | 14-Oct-88 | 43.6 | 25.9 | 2.1336 | Water Supply | Domestic | CLAY,SANDY,STONES | 0 | 7 ft |
| 1523205 | 12-Oct-88 | 44.2 | | 3.3528 | Water Supply | Domestic | LIMESTONE,LIMESTONE,LAYERED | 128 | 145 ft |
| 1523205 | 12-Oct-88 | 44.2 | | 3.3528 | Water Supply | Domestic | SAND,BOULDERS,FILL | 0 | 5 ft |
| 1523205 | 12-Oct-88 | 44.2 | | 3.3528 | Water Supply | Domestic | MUCK,PACKED, | 5 | 7 ft |
| 1523205 | 12-Oct-88 | 44.2 | | 3.3528 | Water Supply | Domestic | SAND,GRAVEL,CLAY | 7 | 11 ft |
| 1523205 | 12-Oct-88 | 44.2 | | 3.3528 | Water Supply | Domestic | LIMESTONE,LIMESTONE,LAYERED | 11 | 128 ft |
| 1523217 | 26-May-88 | 39.6 | 2.1 | 0.3048 | Water Supply | Domestic | LIMESTONE,LIMESTONE,MEDIUM- GRAINED | 1 | 130 ft |
| 1523217 | 26-May-88 | 39.6 | 2.1 | 0.3048 | Water Supply | Domestic | SAND,LOOSE, | 0 | 1 ft |
| 1523624 | 28-Jul-89 | 61 | | 3.3528 | Water Supply | Not Used | SAND,CLAY,PACKED | 0 | 11 ft |
| 1523624 | 28-Jul-89 | 61 | | 3.3528 | Water Supply | Not Used | LIMESTONE,MEDIUM-GRAINED, | 11 | 165 ft |
| 1523624 | 28-Jul-89 | 61 | | 3.3528 | Water Supply | Not Used | LIMESTONE,SANDSTONE,LAYERED | 165 | 200 ft |
| 1523628 | 27-Jul-89 | 45.7 | 11 | 2.7432 | Water Supply | Domestic | LIMESTONE,MEDIUM-GRAINED, | 40 | 150 ft |
| 1523628 | 27-Jul-89 | 45.7 | 11 | 2.7432 | Water Supply | Domestic | SAND,PACKED, | 0 | 3 ft |
| 1523628 | 27-Jul-89 | 45.7 | 11 | 2.7432 | Water Supply | Domestic | LIMESTONE,SOFT, | 9 | 40 ft |
| 1523628 | 27-Jul-89 | 45.7 | 11 | 2.7432 | Water Supply | Domestic | SAND,CLAY,PACKED | 3 | 9 ft |
| 1524493 | 14-May-90 | 22.9 | | 2.1336 | Water Supply | Domestic | CLAY,SAND,PACKED | 0 | 7 ft |
| 1524493 | 14-May-90 | 22.9 | | 2.1336 | Water Supply | Domestic | HARDPAN,STONES,PACKED | 7 | 13 ft |
| 1524493 | 14-May-90 | 22.9 | | 2.1336 | Water Supply | Domestic | LIMESTONE,MEDIUM-GRAINED, | 13 | 75 ft |
| 1524686 | 01-Aug-90 | 45.7 | | 1.524 | Water Supply | Domestic | SAND,FILL,LOOSE | 0 | 5 ft |
| 1524686 | 01-Aug-90 | 45.7 | | 1.524 | Water Supply | Domestic | LIMESTONE,MEDIUM-GRAINED, | 5 | 130 ft |
| 1524686 | 01-Aug-90 | 45.7 | | 1.524 | Water Supply | Domestic | LIMESTONE,MEDIUM-GRAINED, | 130 | 138 ft |
| 1524686 | 01-Aug-90 | 45.7 | | 1.524 | Water Supply | Domestic | LIMESTONE,MEDIUM-GRAINED, | 138 | 150 ft |
| 1525380 | 12-Mar-91 | 38.1 | 6.1 | 3.048 | Water Supply | Domestic | CLAY,SANDY, | 0 | 10 ft |
| 1525380 | 12-Mar-91 | 38.1 | 6.1 | 3.048 | Water Supply | Domestic | LIMESTONE,, | 10 | 125 ft |
| 1525851 | 12-Jul-91 | 47.5 | 29.9 | 0 | Water Supply | Domestic | LIMESTONE,SHALE, | 0 | 156 ft |
| 1526076 | 16-Nov-91 | 22.9 | 2.4 | 0 | Water Supply | Domestic | CLAY,STONES,HARDPAN | 0 | 4 ft |
| 1526076 | 16-Nov-91 | 22.9 | 2.4 | 0 | Water Supply | Domestic | LIMESTONE,MEDIUM- GRAINED,HARD | 4 | 75 ft |
| 1527635 | 19-Aug-93 | 45.7 | 28 | 1.524 | Water Supply | Domestic | SAND,GRAVEL,STONES | 0 | 5 ft |
| 1527635 | 19-Aug-93 | 45.7 | 28 | 1.524 | Water Supply | Domestic | SHALE,SANDSTONE, | 90 | 150 ft |
| 1527635 | 19-Aug-93 | 45.7 | 28 | 1.524 | Water Supply | Domestic | LIMESTONE,SHALE, | 5 | 90 ft |
| 1529766 | 11-Nov-97 | 51.8 | 4.6 | 1.2192 | Water Supply | Domestic | SAND,FILL, | 0 | 4 ft |
| 1529766 | 11-Nov-97 | 51.8 | 4.6 | 1.2192 | Water Supply | Domestic | SHALE,LIMESTONE, | 4 | 170 ft |
| 1530802 | 09-Sep-99 | 72.5 | 25 | 0 | Water Supply | Domestic | LIMESTONE,SHALE, | 0 | 238 ft |
| 1530976 | 08-Nov-99 | 61 | | 2.4384 | Water Supply | Domestic | LIMESTONE,LAYERED, | 8 | 200 ft |
| 1530976 | 08-Nov-99 | 61 | | 2.4384 | Water Supply | Domestic | SAND,STONES,PACKED | 0 | 8 ft |
| 1533407 | 07-Nov-02 | 53.9 | 21.3 | 3.048 | Water Supply | Domestic | SAND,GRAVEL, | 0 | 10 ft |
| 1533407 | 07-Nov-02 | 53.9 | 21.3 | 3.048 | Water Supply | Domestic | LIMESTONE,CLAY,LAYERED | 10 | 175 ft |
| 1533407 | 07-Nov-02 | 53.9 | 21.3 | 3.048 | Water Supply | Domestic | LIMESTONE,CLAY,LAYERED | 175 | 177 ft |
| 1534601 | 17-Mar-04 | 46.6 | 15 | 0.9144 | Water Supply | Domestic | LIMESTONE,, | 3 | 147 ft |
| 1534601 | 17-Mar-04 | 46.6 | 15 | 0.9144 | Water Supply | Domestic | GRANITE,, | 147 | 153 ft |
| 1534601 | 17-Mar-04 | 46.6 | 15 | 0.9144 | Water Supply | Domestic | TOPSOIL,, | 0 | 3 ft |
| 1535745 | 09-Aug-05 | 76.2 | | 1.524 | Water Supply | Domestic | SAND,GRAVEL, | 0 | 1.524 m |
| 1535745 | 09-Aug-05 | 76.2 | | 1.524 | Water Supply | Domestic | LIMESTONE,, | 1.524 | 22.56 m |
| 1535745 | 09-Aug-05 | 76.2 | | 1.524 | Water Supply | Domestic | SANDSTONE,, | 22.56 | 24.69 m |
| 1535745 | 09-Aug-05 | 76.2 | | 1.524 | Water Supply | Domestic | LIMESTONE,, | 24.69 | 70.71 m |
| 1535745 | 09-Aug-05 | 76.2 | | 1.524 | Water Supply | Domestic | SANDSTONE,, | 70.71 | 76.2 m |

| | | | | | | | | | |
|---------|-----------|------|------|--------|------------------|--------------------------|-------------------|-------|---------|
| 7111660 | 12-Aug-08 | | | | Abandoned-Other | | | | |
| 7156080 | 11-Nov-10 | 76.2 | 13.9 | 25.9 | Water Supply | | | 0 | 25.9 m |
| 7156080 | 11-Nov-10 | 76.2 | 13.9 | 25.9 | Water Supply | | LIMESTONE,, | 25.9 | 54.86 m |
| 7156080 | 11-Nov-10 | 76.2 | 13.9 | 25.9 | Water Supply | | SANDSTONE,, | 54.86 | 76.19 m |
| 7187436 | 05-Jun-12 | | | | Abandoned-Supply | | | | |
| 7201631 | 26-Apr-13 | | | | Abandoned-Other | Monitoring and Test Hole | | | |
| 7260528 | 16-Dec-15 | 33.5 | 3.7 | 8.5344 | Water Supply | Domestic | TOPSOIL,, | 0 | 28 ft |
| 7260528 | 16-Dec-15 | 33.5 | 3.7 | 8.5344 | Water Supply | Domestic | LIMESTONE,, | 28 | 110 ft |
| 7270177 | 28-Jul-16 | 53.3 | 32.3 | 1.82 | Water Supply | Domestic | SAND,GRAVEL,LOOSE | 0 | 1.82 m |
| 7270177 | 28-Jul-16 | 53.3 | 32.3 | 1.82 | Water Supply | Domestic | LIMESTONE,, | 1.82 | 14.62 m |
| 7270177 | 28-Jul-16 | 53.3 | 32.3 | 1.82 | Water Supply | Domestic | SHALE,,SOFT | 14.62 | 53.33 m |
| 7286758 | 11-May-17 | | | | Water Supply | Domestic | | | ft |
| 7336407 | 03-Jun-19 | 51.8 | 27.1 | 1.524 | Water Supply | Domestic | SAND,GRAVEL, | 0 | 5 ft |
| 7336407 | 03-Jun-19 | 51.8 | 27.1 | 1.524 | Water Supply | Domestic | SHALE,LIMESTONE, | 5 | 170 ft |

Average (m) 2.20488
 Max (m) 76.2 35.1
 Min (m) 19.2 0.9

| WELL_ID | COMPLETED | WELL DEPTH (m) | STATIC WATER LEVEL (m) | DEPTH TO BEDROCK (m) | FINAL STATUS | USE1 | PUMPING RATE | LPM | RECOM RATE |
|---------|-----------|----------------|------------------------|----------------------|------------------|--------------------------|--------------|--------|------------|
| 1513333 | 12-Jul-73 | 32 | 3.7 | 0 | Water Supply | Domestic | 15 GPM | 68.19 | 5GPM |
| 1513502 | 03-Aug-73 | 41.1 | 27.4 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 5GPM |
| 1515273 | 06-Aug-75 | 45.7 | 24.4 | 0 | Water Supply | Domestic | 15 GPM | 68.19 | 5GPM |
| 1515274 | 11-Aug-75 | 39.6 | 21.3 | 0 | Water Supply | Domestic | 15 GPM | 68.19 | 5GPM |
| 1514296 | 04-Jul-74 | 53.3 | 18.9 | 0 | Water Supply | Domestic | 2 GPM | 9 | 3GPM |
| 1514297 | 04-Jul-74 | 42.1 | 27.4 | 0 | Water Supply | Domestic | 12 GPM | 54.55 | 8GPM |
| 1514298 | 02-Jul-74 | 71.9 | 27.4 | 0 | Water Supply | Domestic | 6 GPM | 27.28 | 6GPM |
| 1514299 | 03-Jul-74 | 48.2 | 21 | 0 | Water Supply | Domestic | 16 GPM | 72.74 | 10GPM |
| 1514300 | 03-Jul-74 | 47.2 | 19.8 | 0 | Water Supply | Domestic | 15 GPM | 68.19 | 10GPM |
| 1514301 | 03-Jul-74 | 34.7 | 20.7 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 10GPM |
| 1514302 | 05-Jul-74 | 47.2 | 20.1 | 0 | Water Supply | Domestic | 15 GPM | 68.19 | 10GPM |
| 1514303 | 05-Jul-74 | 28.7 | 18.6 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 8GPM |
| 1514409 | 10-Oct-74 | 45.1 | 15.2 | 0 | Water Supply | Domestic | 25 GPM | 113.65 | 5GPM |
| 1515929 | 17-May-77 | 41.1 | 26.8 | 0 | Water Supply | Domestic | 20 GPM | 90.92 | 5GPM |
| 1516427 | 09-Aug-77 | 22.3 | 16.2 | 0 | Water Supply | Domestic | 7 GPM | 31.82 | 7GPM |
| 1517091 | 20-Aug-79 | 25.9 | 7.6 | 0 | Water Supply | Domestic | 12 GPM | 54.55 | GPM |
| 1517168 | 14-Sep-79 | 27.7 | 6.1 | 0 | Water Supply | Domestic | 12 GPM | 54.55 | GPM |
| 1517304 | 10-Apr-80 | 29 | 9.1 | 0 | Water Supply | Domestic | 12 GPM | 54.55 | GPM |
| 1517305 | 14-May-80 | 39.3 | 25.9 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | GPM |
| 1517359 | 30-Sep-80 | 34.7 | 13.7 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | GPM |
| 1517360 | 22-Oct-80 | 36.9 | 0.9 | 0 | Water Supply | Domestic | 6 GPM | 27.28 | GPM |
| 1517362 | 13-Aug-80 | 37.8 | 27.4 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | GPM |
| 1518647 | 03-Aug-83 | 45.7 | 9.1 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 5GPM |
| 1519078 | 12-Jul-84 | 59.4 | 12.2 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 5GPM |
| 1519709 | 23-May-85 | 43 | 27.1 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 5GPM |
| 1520026 | 12-Jun-85 | 19.2 | 7.6 | 0 | Water Supply | Domestic | 5 GPM | 22.73 | 5GPM |
| 1520285 | 18-Nov-85 | 45.7 | 35.1 | 0 | Water Supply | Domestic | 8 GPM | 36.37 | 5GPM |
| 1520403 | 27-Nov-85 | 32 | 9.4 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 8GPM |
| 1520545 | 14-May-86 | 34.1 | 2.4 | 0 | Water Supply | Domestic | 7 GPM | 31.82 | 7GPM |
| 1520546 | 30-Apr-86 | 27.7 | 4.9 | 0 | Test Hole | Domestic | 4 GPM | 18.18 | 4GPM |
| 1520547 | 19-Mar-86 | 62.8 | 21.3 | 0 | Test Hole | Domestic | 10 GPM | 45.46 | 10GPM |
| 1520548 | 05-Feb-86 | 33.5 | 4.3 | 0 | Test Hole | Domestic | 4 GPM | 18.18 | 4GPM |
| 1520549 | 22-Jan-86 | 45.7 | 0.9 | 0 | Water Supply | Domestic | 2 GPM | 9 | 2GPM |
| 1520802 | 25-Mar-86 | 50.3 | 19.8 | 0 | Water Supply | Domestic | 20 GPM | 90.92 | 5GPM |
| 1521442 | 02-Jun-87 | 56.4 | 18.3 | 0 | Water Supply | Domestic | 4 GPM | 18.18 | 4GPM |
| 1522756 | 14-Oct-88 | 43.6 | 25.9 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 10GPM |
| 1523205 | 12-Oct-88 | 44.2 | 0 | 0 | Water Supply | Domestic | 8 GPM | 36.37 | 6GPM |
| 1523217 | 26-May-88 | 39.6 | 2.1 | 0 | Water Supply | Domestic | 8 GPM | 36.37 | 6GPM |
| 1523624 | 28-Jul-89 | 61 | 0 | 0 | Water Supply | Not Used | 12 GPM | 54.55 | 5GPM |
| 1523628 | 27-Jul-89 | 45.7 | 11 | 0 | Water Supply | Domestic | 20 GPM | 90.92 | 5GPM |
| 1524493 | 14-May-90 | 22.9 | 0 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 5GPM |
| 1524686 | 01-Aug-90 | 45.7 | 0 | 0 | Water Supply | Domestic | 5 GPM | 22.73 | 4GPM |
| 1525380 | 12-Mar-91 | 38.1 | 6.1 | 0 | Water Supply | Domestic | 8 GPM | 36.37 | 5GPM |
| 1525851 | 12-Jul-91 | 47.5 | 29.9 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 10GPM |
| 1526076 | 16-Nov-91 | 22.9 | 2.4 | 0 | Water Supply | Domestic | 30 GPM | 136.38 | 10GPM |
| 1527635 | 19-Aug-93 | 45.7 | 28 | 0 | Water Supply | Domestic | 12 GPM | 54.55 | 12GPM |
| 1529766 | 11-Nov-97 | 51.8 | 4.6 | 0 | Water Supply | Domestic | 3 GPM | 13.64 | 3GPM |
| 1530802 | 09-Sep-99 | 72.5 | 25 | 0 | Water Supply | Domestic | 12 GPM | 54.55 | 10GPM |
| 1530976 | 08-Nov-99 | 61 | 0 | 0 | Water Supply | Domestic | 6 GPM | 27.28 | 6GPM |
| 1533407 | 07-Nov-02 | 53.9 | 21.3 | 0 | Water Supply | Domestic | 8 GPM | 36.37 | 5GPM |
| 1534601 | 17-Mar-04 | 46.6 | 15 | 0 | Water Supply | Domestic | 10 LPM | 45.46 | 10LPM |
| 1535745 | 09-Aug-05 | 76.2 | 0 | 0 | Water Supply | Domestic | 43 LPM | 43 | 30LPM |
| 7111660 | 12-Aug-08 | 0 | 0 | 0 | Abandoned-Other | | | | |
| 7156080 | 11-Nov-10 | 76.2 | 13.9 | 0 | Water Supply | | 68.25 LPM | 68.25 | 45.5LPM |
| 7187436 | 05-Jun-12 | 0 | 0 | 0 | Abandoned-Supply | | | | |
| 7201631 | 26-Apr-13 | 0 | 0 | 0 | Abandoned-Other | Monitoring and Test Hole | | | |
| 7260528 | 16-Dec-15 | 33.5 | 3.7 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 10GPM |
| 7270177 | 28-Jul-16 | 53.3 | 32.3 | 0 | Water Supply | Domestic | 54.6 LPM | 54.6 | 45.5LPM |
| 7286758 | 11-May-17 | 0 | 0 | 0 | Water Supply | Domestic | | | |
| 7336407 | 03-Jun-19 | 51.8 | 27.1 | 0 | Water Supply | Domestic | 10 GPM | 45.46 | 10GPM |

MAX
MIN

136.38
9

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



APPENDIX E: BOREHOLE LOGS, TEST PIT LOGS, AND SOIL PARTICLE SIZE DISTRIBUTION ANALYSIS

Log of Borehole BH-01



Project No: OTT-21010977-A0
 Project: Corkery Community Centre Expansion
 Location: 3447 Old Almonte Road, Carp, ON
 Date Drilled: June 17, 2021
 Drill Type: CME 45 Track-Mounted Drill Rig
 Datum: Geodetic Elevation
 Logged by: G.C. Checked by: I.T.

Figure No. 3
 Page. 1 of 1

- Split Spoon Sample
- Auger Sample
- SPT (N) Value
- Dynamic Cone Test
- Shelby Tube
- Shear Strength by Vane Test
- Combustible Vapour Reading
- Natural Moisture Content
- Atterberg Limits
- Undrained Triaxial at % Strain at Failure
- Shear Strength by Penetrometer Test

| GWL | SOIL | SOIL DESCRIPTION | Geodetic Elevation m | Depth m | Standard Penetration Test N Value | | | | Combustible Vapour Reading (ppm) | | | Natural Unit Wt. kN/m ³ | |
|-----|------|---|----------------------|---------|-----------------------------------|----|----|----|--|-----|-----|------------------------------------|-----|
| | | | | | Shear Strength kPa | | | | 250 | 500 | 750 | | |
| | | | | | 20 | 40 | 60 | 80 | Natural Moisture Content % Atterberg Limits (% Dry Weight) | | | | |
| | | TOPSOIL ~100 mm thick | 160.37 160.3 | 0 | | | | | | | | | |
| | | FILL Silty sand with gravel, rootlets, brown, moist, (compact) | | | 15 | | | | | X | | | SS1 |
| | | FILL Sandy gravel with silt, cobbles and boulders, light brown, damp, (compact) | 159.7 | 1 | | | | | | | | | SS2 |
| | | | | | 22 + 50 for 130 mm | | | | | X | | | SS3 |
| | | Auger Refusal at 2.0 m Depth | 158.4 | | | | | | | | | | |

LOG OF BOREHOLE BH LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/2021

- NOTES:
- Borehole data requires interpretation by EXP before use by others
 - Borehole backfilled upon completion of drilling.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| June 17, 2021 | Dry | Open |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| | | | |

Log of Borehole BH-02



Project No: OTT-21010977-A0

Figure No. 4

Project: Corkery Community Centre Expansion

Page. 1 of 1

Location: 3447 Old Almonte Road, Carp, ON

Date Drilled: June 17, 2021

Split Spoon Sample

Combustible Vapour Reading

Drill Type: CME 45 Track-Mounted Drill Rig

Auger Sample

Natural Moisture Content

SPT (N) Value

Atterberg Limits

Datum: Geodetic Elevation

Dynamic Cone Test

Undrained Triaxial at % Strain at Failure

Shelby Tube

Shear Strength by Penetrometer Test

Logged by: G.C. Checked by: I.T.

Shear Strength by Vane Test

| GWL | SOIL LOG | SOIL DESCRIPTION | Geodetic Elevation m | Depth m | Standard Penetration Test N Value | | | | Combustible Vapour Reading (ppm) | | | Natural Unit Wt. kN/m ³ | |
|-----|----------|---|----------------------|-------------------|-----------------------------------|----|----|----|--|-----|-----|------------------------------------|-----|
| | | | | | Shear Strength kPa | | | | 250 | 500 | 750 | | |
| | | | | | 20 | 40 | 60 | 80 | Natural Moisture Content % Atterberg Limits (% Dry Weight) | | | | |
| | | TOPSOIL ~100 mm thick | 160.09 160.0 | 0 | | | | | | | | | |
| | | FILL Silty sand and gravel, light brown, damp, (compact) | | 15 | | | | | X | | | | SS1 |
| | | | | 18 | | | | | X | | | | SS2 |
| | | FILL Silty gravel with sand, cobbles and boulders, light brown, damp, (loose) | 158.6 | 4 + 50 for 100 mm | | | | | X | | | | SS3 |
| | | Auger Refusal at 1.8 m Depth | 158.3 | | | | | | | | | | |

LOG OF BOREHOLE BH LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/2021

- NOTES:
- Borehole data requires interpretation by EXP before use by others
 - Borehole backfilled upon completion of drilling.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| 'June 17, 2021 | Dry | Open |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| | | | |


Log of Borehole BH-03



Project No: OTT-21010977-A0
 Project: Corkery Community Centre Expansion
 Location: 3447 Old Almonte Road, Carp, ON
 Date Drilled: June 17, 2021
 Drill Type: CME 45 Track-Mounted Drill Rig
 Datum: Geodetic Elevation
 Logged by: G.C. Checked by: I.T.

Figure No. 5
 Page. 1 of 1

- Split Spoon Sample
- Auger Sample
- SPT (N) Value
- Dynamic Cone Test
- Shelby Tube
- Shear Strength by Vane Test
- Combustible Vapour Reading
- Natural Moisture Content
- Atterberg Limits
- Undrained Triaxial at % Strain at Failure
- Shear Strength by Penetrometer Test

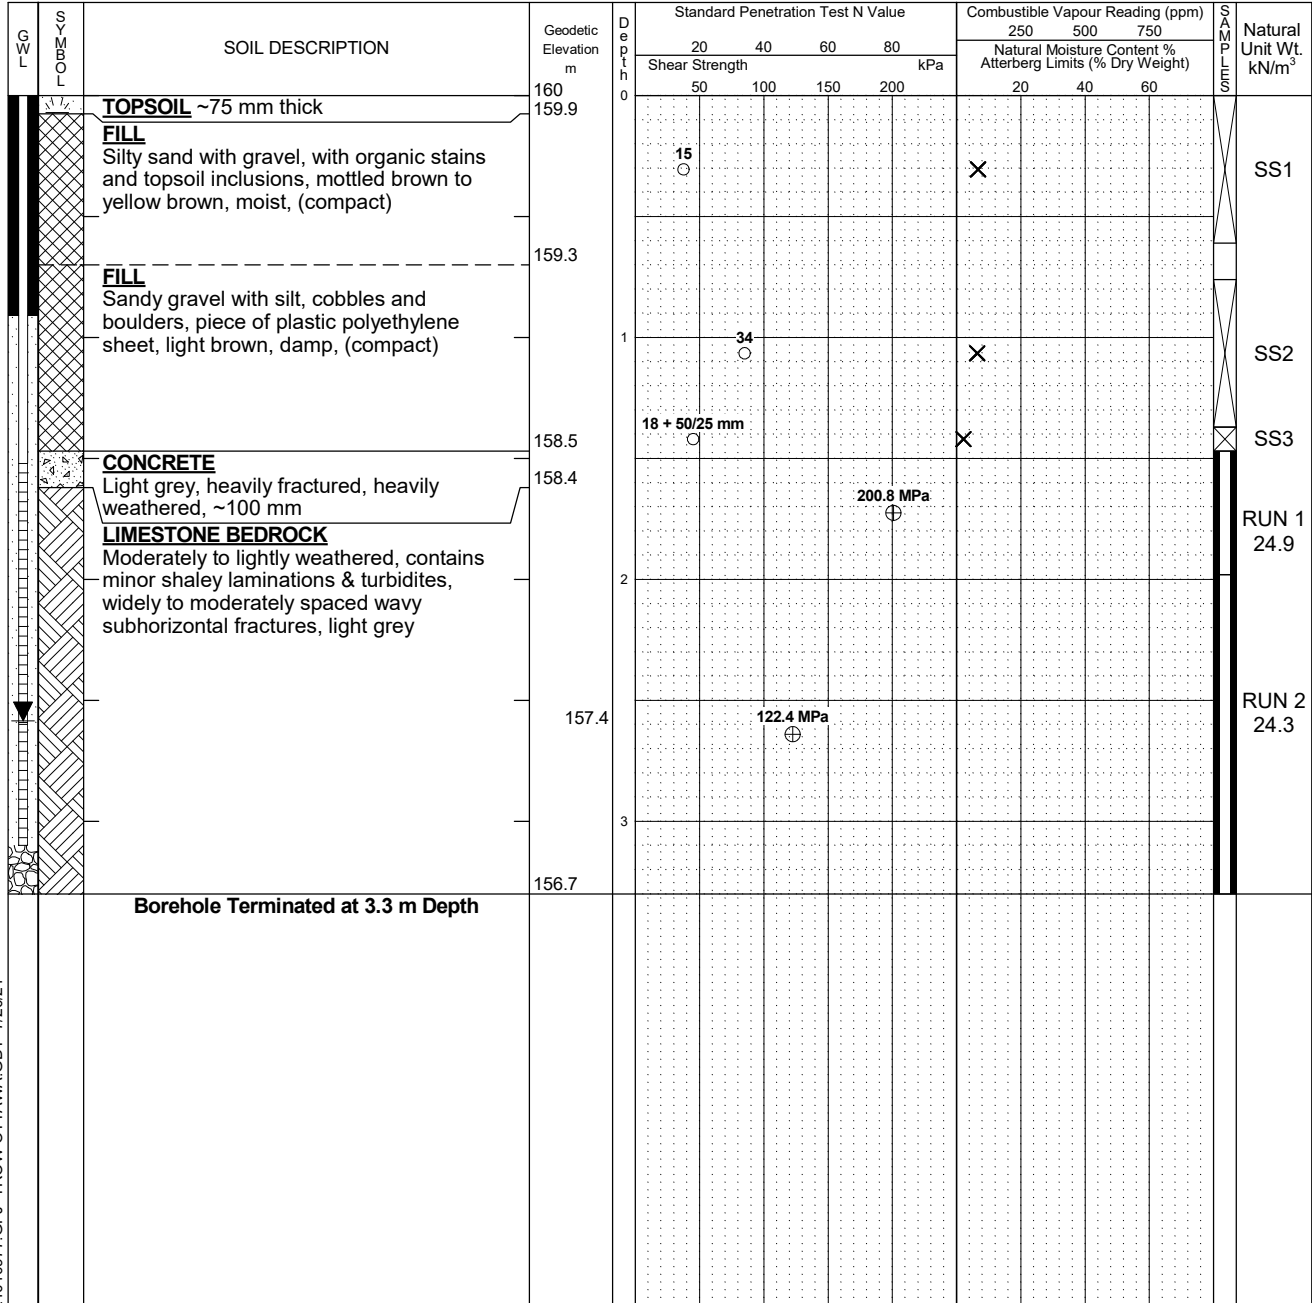

LOG OF BOREHOLE BH LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/2021

- NOTES:**
- Borehole data requires interpretation by EXP before use by others
 - 25 mm piezometer installed in borehole upon completion of drilling.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| June 17, 2021 | Dry | Open |
| July 14, 2021 | 2.6 | |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| 1 | 1.5 - 2 | 90 | 60 |
| 2 | 2 - 3.3 | 100 | 42 |

Log of Borehole BH-04



Project No: OTT-21010977-A0
 Project: Corkery Community Centre Expansion
 Location: 3447 Old Almonte Road, Carp, ON
 Date Drilled: June 17, 2021
 Drill Type: CME 45 Track-Mounted Drill Rig
 Datum: Geodetic Elevation
 Logged by: G.C. Checked by: I.T.

Figure No. 6
 Page. 1 of 1

- Split Spoon Sample
- Auger Sample
- SPT (N) Value
- Dynamic Cone Test
- Shelby Tube
- Shear Strength by Vane Test
- Combustible Vapour Reading
- Natural Moisture Content
- Atterberg Limits
- Undrained Triaxial at % Strain at Failure
- Shear Strength by Penetrometer Test

| GWL | SOIL DESCRIPTION | Geodetic Elevation m | Depth m | Standard Penetration Test N Value | | | | Combustible Vapour Reading (ppm) | | | Natural Unit Wt. kN/m ³ |
|-----|--|----------------------|---------|-----------------------------------|----|----|----|---|-----|-----|------------------------------------|
| | | | | Shear Strength kPa | | | | 250 | 500 | 750 | |
| | | | | 20 | 40 | 60 | 80 | Natural Moisture Content % Atterberg Limits (% Dry Weight) | | | |
| | TOPSOIL ~75 mm thick | 160.49 160.4 | 0 | | | | | | | | |
| | FILL Silty sand with gravel, with topsoil inclusions and organic stains, brown, moist, (compact) | | | 18 | | | | X | | | SS1 |
| | | | 1 | 18 | | | | X | | | SS2 |
| | SILTY SAND TO SANDY SILT with gravel, brown, moist, (compact) | 159.0 | | | | | | | | | |
| | | | 2 | 11 | | | | X | | | SS3 |
| | Auger Refusal at 2.1 m Depth | 158.4 | | | | | | | | | |

LOG OF BOREHOLE BH LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/2021

- NOTES:**
- Borehole data requires interpretation by EXP before use by others
 - 2.25 mm piezometer installed in borehole upon completion of drilling.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| June 17, 2021 | Dry | Open |
| July 14, 2021 | Dry | |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| | | | |

Log of Borehole TP-01



Project No: OTT-21010977-A0
 Project: Corkery Community Centre Expansion
 Location: 3447 Old Almonte Road, Carp, ON
 Date Drilled: June 23, 2021
 Drill Type: Caterpillar 415 Backhoe
 Datum: Geodetic Elevation
 Logged by: G.C. Checked by: I.T.

Figure No. 7
 Page. 1 of 1

- Split Spoon Sample
- Auger Sample
- SPT (N) Value
- Dynamic Cone Test
- Shelby Tube
- Shear Strength by Vane Test
- Combustible Vapour Reading
- Natural Moisture Content
- Atterberg Limits
- Undrained Triaxial at % Strain at Failure
- Shear Strength by Penetrometer Test

| G W L | S O I L D E S C R I P T I O N | Geodetic Elevation m | D e p t h m | Standard Penetration Test N Value | | | | Combustible Vapour Reading (ppm) | | | Natural Unit Wt. kN/m ³ |
|-------------|---|-------------------------|----------------------------|-----------------------------------|----|----|----|---|-----|-----|---------------------------------------|
| | | | | Shear Strength kPa | | | | Natural Moisture Content % Atterberg Limits (% Dry Weight) | | | |
| | | | | 20 | 40 | 60 | 80 | 250 | 500 | 750 | |
| | ASPHALT ~75 mm thick | 160.43 | 0 | | | | | | | | |
| | GRANULAR FILL crusher run limestone, ~210 mm thick | 160.4 | | | | | | | | | GS1 |
| | FILL Silty sand with gravel, brown, moist | 160.2 | | | | | | X | | | GS2 |
| | FILL Sandy gravel with silt, numerous cobbles and boulders, light brown, damp | 159.8 | | | | | | | | | |
| | | 158.8 | 1 | | | | | X | | | GS3 |
| | Bucket Refusal at 1.6 m Depth | | | | | | | | | | |

LOG OF BOREHOLE TP LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/20/21

- NOTES:**
- Borehole data requires interpretation by EXP before use by others
 - Test pit backfilled upon completion of excavation.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| 'June 23, 2021 | Dry | Open |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| | | | |

Log of Borehole TP-02



Project No: OTT-21010977-A0
 Project: Corkery Community Centre Expansion
 Location: 3447 Old Almonte Road, Carp, ON

Figure No. 8
 Page. 1 of 1

Date Drilled: June 23, 2021
 Drill Type: Caterpillar 415 Backhoe
 Datum: Geodetic Elevation
 Logged by: G.C. Checked by: I.T.

Split Spoon Sample
 Auger Sample
 SPT (N) Value
 Dynamic Cone Test
 Shelby Tube
 Shear Strength by Vane Test
 Combustible Vapour Reading
 Natural Moisture Content
 Atterberg Limits
 Undrained Triaxial at % Strain at Failure
 Shear Strength by Penetrometer Test

| GWL | SOIL SYMBOL | SOIL DESCRIPTION | Geodetic Elevation m | Depth m | Standard Penetration Test N Value | | | | Combustible Vapour Reading (ppm) | | | Natural Unit Wt. kN/m ³ |
|-----|-------------|---|----------------------|---------|-----------------------------------|----|----|----|---|-----|-----|------------------------------------|
| | | | | | Shear Strength kPa | | | | 250 | 500 | 750 | |
| | | | | | 20 | 40 | 60 | 80 | Natural Moisture Content % Atterberg Limits (% Dry Weight) | | | |
| | | TOPSOIL ~250 mm thick | 160.09 | 0 | | | | | | | | |
| | | FILL Silty sand with gravel, with rootlets and topsoil inclusions, contains plastic debris, mottled brown to grey, moist - changes to orange brown below 0.7 m depth | 159.8 | | | | | | | | | GS1 |
| | | FILL Silty sand with gravel, numerous cobbles and boulders, light brown, damp | 159.2 | | | | | | | | | GS2 |
| | | Bucket Refusal at 1.3 m Depth | 158.8 | 1 | | | | | | | | GS3 |

LOG OF BOREHOLE TP LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/20/21

- NOTES:
- Borehole data requires interpretation by EXP before use by others
 - Test pit backfilled upon completion of excavation.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| 'June 23, 2021 | Dry | Open |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| | | | |

Log of Borehole TP-03



Project No: OTT-21010977-A0
 Project: Corkery Community Centre Expansion
 Location: 3447 Old Almonte Road, Carp, ON
 Date Drilled: June 23, 2021
 Drill Type: Caterpillar 415 Backhoe
 Datum: Geodetic Elevation
 Logged by: G.C. Checked by: I.T.

Figure No. 9
 Page. 1 of 1

- Split Spoon Sample
- Auger Sample
- SPT (N) Value
- Dynamic Cone Test
- Shelby Tube
- Shear Strength by Vane Test
- Combustible Vapour Reading
- Natural Moisture Content
- Atterberg Limits
- Undrained Triaxial at % Strain at Failure
- Shear Strength by Penetrometer Test

| GWL | SOIL DESCRIPTION | Geodetic Elevation m | Depth | Standard Penetration Test N Value | | | | Combustible Vapour Reading (ppm) | | | Natural Unit Wt. kN/m ³ |
|-----|--|----------------------|-------|-----------------------------------|----|----|----|---|-----|-----|------------------------------------|
| | | | | Shear Strength kPa | | | | 250 | 500 | 750 | |
| | | | | 20 | 40 | 60 | 80 | Natural Moisture Content % Atterberg Limits (% Dry Weight) | | | |
| | TOPSOIL ~200 mm thick | 160.24 | 0 | | | | | | | | |
| | FILL Silty sand with gravel, cobbles and boulders, light brown, damp | 160.0 | 0 | | | | | | | | |
| | | | 1 | | | | | X | | | GS1 |
| | | 158.64 | | | | | | | | | |
| | - wet below 1.6 m depth | 158.5 | | | | | | | | | |
| | Bucket Refusal at 1.7 m Depth | | | | | | | | | | |

LOG OF BOREHOLE TP LOGS - 21010977.GPJ TROW OTTAWA.GDT 7/20/21

- NOTES:
- Borehole data requires interpretation by EXP before use by others
 - Test pit backfilled upon completion of excavation.
 - Field work supervised by an EXP representative.
 - See Notes on Sample Descriptions
 - Log to be read with EXP Report OTT-21010977-A0

| WATER LEVEL RECORDS | | |
|---------------------|-----------------|------------------|
| Date | Water Level (m) | Hole Open To (m) |
| 'June 23, 2021 | 1.6 m | Open |

| CORE DRILLING RECORD | | | |
|----------------------|-----------|--------|-------|
| Run No. | Depth (m) | % Rec. | RQD % |
| | | | |




Grain-Size Distribution Curve Method of Test For Sieve Analysis of Aggregate ASTM C-136

EXP Services Inc.
100-2650 Queensview Drive
Ottawa, ON K2B 8H6

Unified Soil Classification System

| CLAY AND SILT | SAND | | | GRAVEL | |
|---------------|------|--------|--------|--------|--------|
| | Fine | Medium | Coarse | Fine | Coarse |

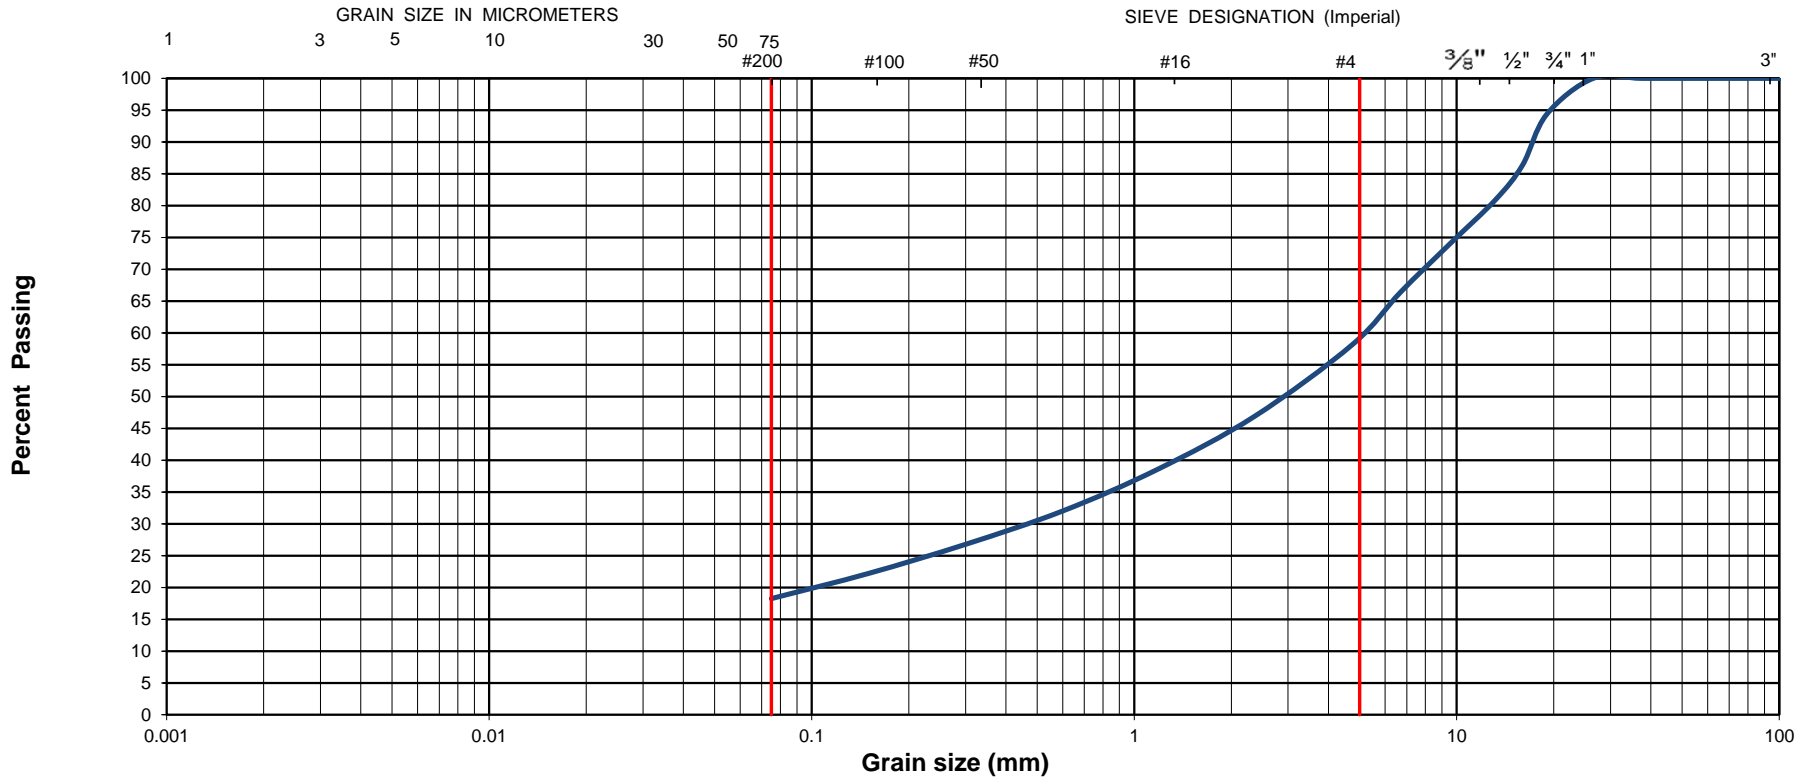

| | | | | |
|----------------------|--|--------------------|---|-------------|
| EXP Project No.: | OTT-21010977-A0 | Project Name : | Corkery Community Centre Expansion | |
| Client : | City of Ottawa | Project Location : | 3447 Old Almonte Road. Carp, Ottawa, ON | |
| Date Sampled : | June 17, 2021 | Borehole No: | BH2 | Sample: SS3 |
| | | Depth (m) : | 1.5-1.8 | |
| Sample Composition : | Gravel (%) | 42 | Sand (%) | 40 |
| | | Silt & Clay (%) | 18 | |
| Sample Description : | FILL: Silty Gravel with Sand (GM) | | | Figure : |
| | | | | 10 |




Grain-Size Distribution Curve Method of Test For Sieve Analysis of Aggregate ASTM C-136

EXP Services Inc.
100-2650 Queensview Drive
Ottawa, ON K2B 8H6

Unified Soil Classification System


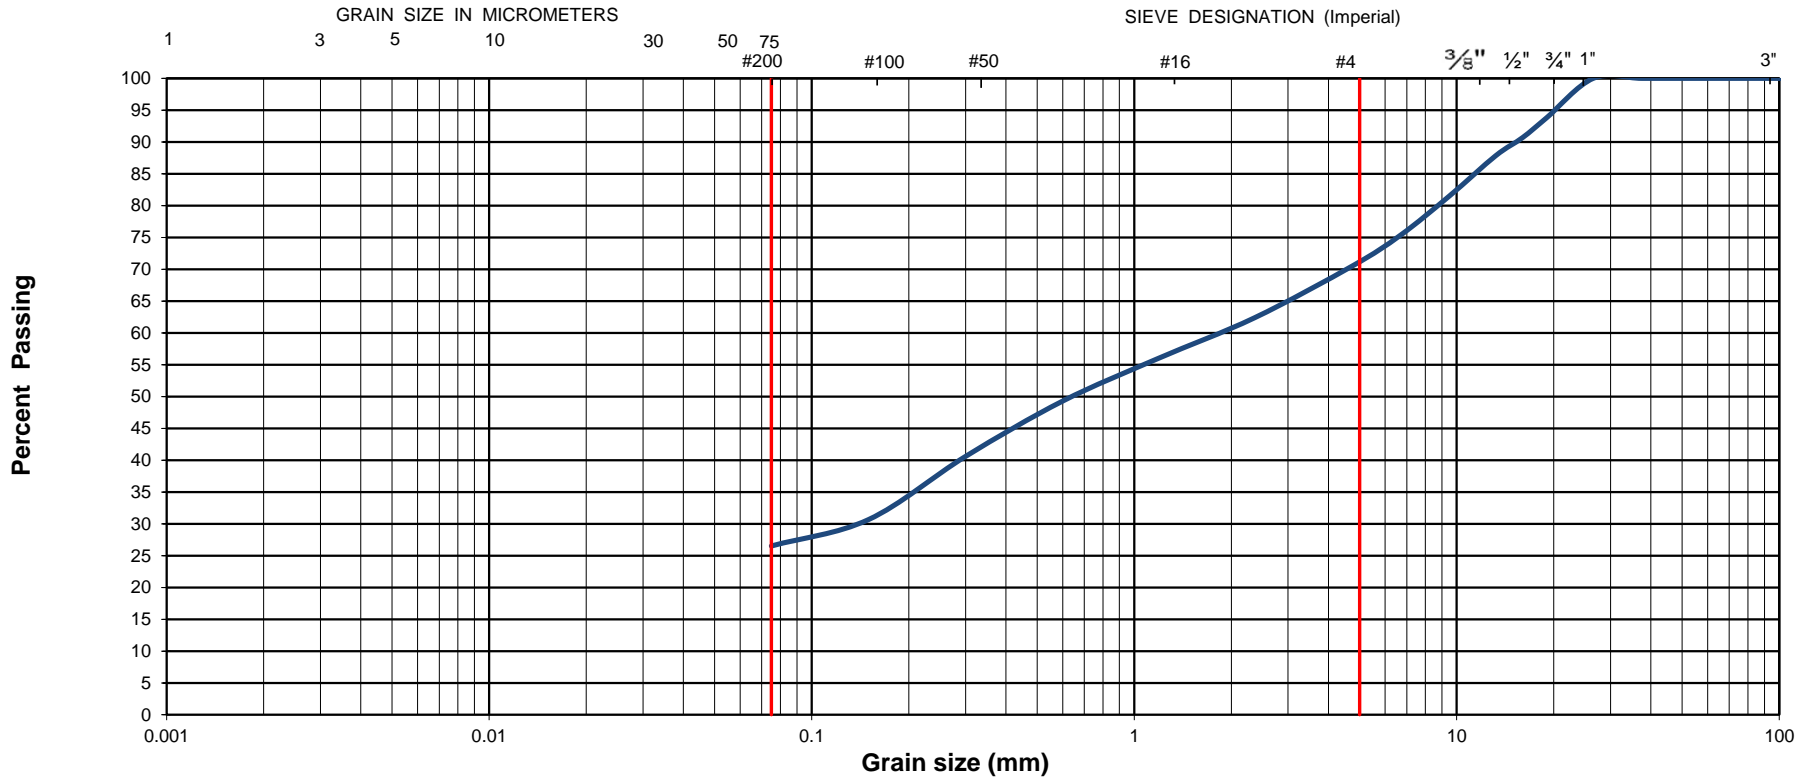


| CLAY AND SILT | SAND | | | GRAVEL | |
|---------------|------|--------|--------|--------|--------|
| | Fine | Medium | Coarse | Fine | Coarse |



| | | | | | | |
|----------------------|--|--------------------|---|---------|-----------------|----|
| EXP Project No.: | OTT-21010977-A0 | Project Name : | Corkery Community Centre Expansion | | | |
| Client : | City of Ottawa | Project Location : | 3447 Old Almonte Road. Carp, Ottawa, ON | | | |
| Date Sampled : | June 17, 2021 | Borehole No: | BH4 | Sample: | SS2 | |
| | | Depth (m) : | 1.1 - 1.4 | | | |
| Sample Composition : | Gravel (%) | 30 | Sand (%) | 43 | Silt & Clay (%) | 27 |
| Sample Description : | FILL: Silty Sand with Gravel (SM) | | | | Figure : | 11 |

CLIENT City of Ottawa
PROJECT NUMBER CCO-21-3339
DATE STARTED 21-12-22 **COMPLETED** 21-12-22
DRILLING CONTRACTOR McIntosh Perry
DRILLING METHOD Hand shovel and hand auger
LOGGED BY E.Ws. **CHECKED BY** PL
NOTES _____

PROJECT NAME Terrain Analysis
PROJECT LOCATION 3447 Old Almonte Road, Ottawa, ON
GROUND ELEVATION _____ **HOLE SIZE** _____
GROUND WATER LEVELS:
AT TIME OF DRILLING ---
AT END OF DRILLING ---
AFTER DRILLING ---

| DEPTH (m) | SAMPLE TYPE NUMBER | BLOW COUNTS (N VALUE) | ENVIRONMENTAL DATA | GRAPHIC LOG | MATERIAL DESCRIPTION | WELL DIAGRAM |
|-----------|--------------------|-----------------------|--------------------|---|--|--------------|
| | | | |  | Topsoil | |
| | | | | 0.10  | Silty Gravel with Sand, Cobbles and Boulders | |
| | | | | 0.20  | Sandy Gravel with Silt, Cobbles and Boulders | |
| 0.5 | | | | 0.70  | Sandy Gravel with Silt, Cobbles and Boulders, very dense | |
| | | | | 0.85 | Bottom of hole at 0.85 m. | |

ENVIRONMENTAL BH TEST PITS.GPJ GINT STD CANADA.GDT 22-2-17

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



APPENDIX F: NITRATE ATTENUATION CALCULATIONS

CCO-21-3339

Corkery Community Centre, 3447 Old Almonte Rd.
Nitrate Loading Calculations June.9.2023

Land Area

| | |
|-------------------|-------------------------|
| A_{total} | 37582.22 m ² |
| A_{imperv} | 5364.4 m ² |
| Infiltrating Area | 85.7% |
| A_{perv} | 32217.82 m ² |

Water Surplus (W_s)

| | |
|--------------------|----------------|
| Precipitation | 943.4 mm/yr |
| Evapotranspiration | 609.5239 mm/yr |

| | | |
|--|-------|----------------|
| $W_s = \text{Precipitation} - \text{Evapotranspiration}$ | W_s | 333.8761 mm/yr |
| | | 0.333876 m/yr |

Infiltration Factor (I_f) per MOEE 1995

| | | |
|---------|------------------|-------|
| Topo | Rolling Land | 0.2 |
| Soil | Silty sand | 0.3 |
| Cover | Cultivated lands | 0.1 |
| $I_f =$ | | 0.600 |

Infiltration (I)

| | | |
|--------------------|----------|---------------|
| $I = W_s * I_f$ | $I =$ | 0.200326 m/yr |
| Runoff = $W_s - I$ | Runoff = | 0.133550 m/yr |

Dilution Water Available (D_w)

| | | |
|---|----------------------------|---|
| $D_{w,perv} = A_{perv} * I$ | $D_w =$ | 6454.06 m ³ /yr |
| | | 17682.35 L/day |
| $Runoff_{perv} = A_{perv} * W_s * (1 - I_f)$ | Runoff _{perv} = | 4302.70 m ³ /yr |
| $Runoff_{imperv} = A_{imperv} * W_s$ | Runoff _{imperv} = | 1791.05 m ³ /yr |
| $Runoff_{total} = Runoff_{perv} + Runoff_{imperv}$ | Runoff _{total} = | 6093.75 m ³ /yr |
| | Runoff Reduction % = | 0% (if using LID for stormwater management) |
| | Runoff Reduction = | 0.00 m ³ /yr |
| $D_{w(final)} = D_{w,perv} + \text{Runoff Reduction}$ | $D_{w(final)} =$ | 6454.06 m ³ /yr |
| | $D_{w(final)} =$ | 17682.35 L/day |

Nitrate Concentrations

| | | |
|---|-------------------|--|
| Background Nitrate Concentration (C_b) | $C_b =$ | 1.4 mg/L |
| Max Boundary Nitrate Concentration (C_{boun}) | $C_{boun} =$ | 10 mg/L |
| Effluent Nitrate Concentration (C_e) | $C_e =$ | 40 mg/L |
| | Nitrate Reduction | 0% (if CAN/BNQ 3680-600 N-I or NSF/ANSI 245 applies) |
| | $C_{e(final)} =$ | 40 mg/L |

Effluent Loading (Q_e)

| | |
|---------|----------------|
| $Q_e =$ | 4800 L/day/Lot |
|---------|----------------|

Maximum Allowable Number of Lots (N)

$N = [D_w * (C_b - C_{boun})] / [(Q_e * C_e) + (C_b - C_e) * D_w]$
 $N = 1.009 \leq \text{Not Applicable}$

Calculated Nitrate Concentration (C_w)

$N = 1$ lots
 $C_w = [(C_e * Q_e * N) / ((Q_e * N) + D_w)] + C_b$
 $C_w = 9.940$
 $C_w \leq C_{boun}$, therefore proposed development will not exceed ODWO at property limit

Potential Evapotranspiration

Thornthwaite Method, "Hydrology & Hydraulic Systems", Gupta

$Et_{month} = 1.62 (10 * T_m / I)^a$

where:

$a = 675 * 10^{-9} * I^3 - 771 * 10^{-7} * I^2 + 179 * 10^{-4} * I + 492 * 10^{-3}$

$I = \text{sum}(T_m / 5)^{1.514}$

Stn: Ottawa MacDonald -Cartier Int'l A (YOW)
 Site Climate ID: 6106000

| Month | Temp C | I | ET (cm) unadjusted | Daylight Factor | ET (cm) adjusted |
|----------|--------|----------|--------------------|-----------------|------------------|
| January | -10.3 | | | | |
| Feb | -8.1 | | | | |
| March | -2.3 | | | | |
| April | 6.3 | 1.4189 | 2.8610 | 1.13 | 3.2330 |
| May | 13.3 | 4.3982 | 6.4518 | 1.28 | 8.2583 |
| June | 18.5 | 7.2487 | 9.2396 | 1.29 | 11.9191 |
| July | 21 | 8.7821 | 10.6062 | 1.31 | 13.8942 |
| Aug | 19.8 | 8.0336 | 9.9484 | 1.21 | 12.0375 |
| Sept | 15 | 5.2767 | 7.3542 | 1.04 | 7.6483 |
| Oct | 8 | 2.0372 | 3.7105 | 0.94 | 3.4879 |
| Nov | 1.5 | 0.1616 | 0.6001 | 0.79 | 0.4741 |
| Dec | -6.2 | | | | |
| I | | 37.35695 | 50.7719 | | 60.9524 |
| thus a = | | 1.0883 | | | |

Notes:

-Daylight Factor is an adjustment Factor for possible hours of sunshine based on latitude for Ottawa.

-Monthly temperatures from Environment Canada Climate Normals (1981-2010)

| |
|---|
| Input data from user |
| Set value |
| Site Constant (adjustment for latitude) |
| Calculated by worksheet |

HYDROGEOLOGICAL ASSESSMENT AND TERRAIN ANALYSIS, CORKERY COMMUNITY CENTRE, 3447 OLD ALMONTE ROAD, OTTAWA, ON



APPENDIX G: SEWAGE SYSTEM CERTIFICATE OF COMPLETION FOR FIRE HALL AND SEWAGE SYSTEM RENOVATION PERMIT FOR COMMUNITY CENTRE



File Search Reply – Match Found File
Information per applicant

Requester: Brandon Aubin **Date:** 02 Dec 2019
Email: b.aubin@mcintoshperry.com **Phone:** 613.806.0336

From: Ottawa Septic System Office – Sarah F
Phone: 613.692.3571 – Press “4” for the Septic office
Email: septic@rvca.ca


| | | |
|---|---|---|
| Follow up Inquiries Please Reference: FS-19-27 | | |
| Archive file (s): 09-505 (City Of Ottawa) | | |
| Civic Address: 3449 Old Almonte | | |
| Former Township: Huntley | | |
| Property Owner Last Name: City of Ottawa | | |
| Lot 20 | Con: -- | Sublot/Part: - Plan: M248 |
| | Septic system designed per the attached records for: | Real estate feature listing obtained via the internet: |
| Bedrooms | | |
| Bathrooms | Fire Station | |
| Square M | | |

Attachment(s):

Archive file: 09-505 (City Of Ottawa)

- ✓ Copy of approval
- ✓ Use Permit/Certificate of Completion issued by regulator at time of construction
- NA Tertiary Treatment unit:

The foregoing information is given for your convenience only. Supplementary requests are necessary for conformity with other legislation such as flood plain or shoreline works. It should be clearly understood that you must satisfy yourself as to whether the premises and the existing or proposed use thereof is or would be in conformity with all applicable regulations. For further information please contact Sarah Fletcher at the number listed above. Thank you for contacting the Ottawa Septic System Office.

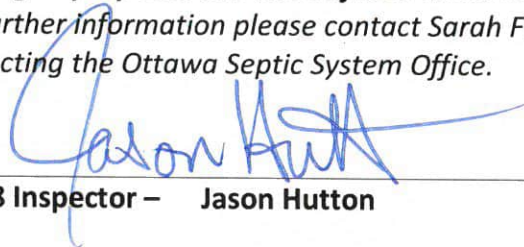

Part 8 Inspector – Jason Hutton



Ottawa Septic System Office Bureau des systèmes septiques d'Ottawa

R.V.C.A. RECEIVED

NOV 29 2019

Main Phone: 613-692-3571 x 1123
 Fax: 613-692-1507
 E-mail: septic@rvca.ca
 Mailing Address: 3889 Rideau Valley Drive
 P.O box 599, Manotick, ON K4M 1A5

Septic Records Search Form (1977 to present)

Complete and fax, mail or e-mail form → **NOTE: NON-REFUNDABLE FEE REQUIRED UPON SUBMISSION**
 Form is to be completed in full. Incomplete information may cause delays or inaccurate file searches. Requests that have been processed and returned to clients are considered to be closed.

| Requestor Information | | Section 1 | |
|--|---|--------------------|------------|
| Requested by | Brandon Aubin (McIntosh Perry) | | |
| Telephone | (613) 806-0336 | Date: (mm/dd/yyyy) | 11/29/2019 |
| File Search Response & Attached Septic Records to be | E-mailed to: b.aubin@mcintoshperry.com | | |
| | Mailed to: | | |
| | Faxed to: | | |
| Present Owner's Name | City of Ottawa | | |
| Applicant's Reference | CM-19-0590 City of Ottawa_Corkery Community Centre | | |

| File Search Property Information - Reference title and deed | | Section 2 | |
|---|--|-------------|------|
| Municipal Address | 3449 Old Almonte Rd, Carp, ON KOA 1L0 | | |
| Lot | | Concession: | |
| Subdivision Lot/Parts | BLK 'A' AND LOT 20 | Plan: | M248 |
| Approximate Date of System Installation and/or Replacement | Original building in 1996 serviced by holding tanks. Believed to be converted to Class IV around 2001 with installation of leaching bed. Tanks were retrofitted. | | |
| Owner at Time of Installation | City of Ottawa | | |

| Payment Information | | Section 3 | |
|--------------------------|--|----------------------|-------|
| Payment Type (Check one) | <input checked="" type="checkbox"/> MasterCard <input type="checkbox"/> Visa <input type="checkbox"/> Cheque Attached* | | |
| Card Number | [REDACTED] | Exp. Date: (mm/yyyy) | 02/21 |
| Cardholder Name | Janet Mousseau | | |
| Receipt Issued to | Janet Mousseau (McIntosh Perry) | | |

*Cheques can be made payable to Rideau Valley Conservation Authority

| Ottawa Septic System Office Use ONLY | |
|--------------------------------------|-----------|
| File Search Request # | |
| Invoice # | 15-19-227 |
| Date | |

| Response | | Section 4 | |
|-------------------------------------|--|-----------|--|
| <input type="checkbox"/> | Based on the above information, we were unable to locate a record of the related sewage disposal system in our files. We recommend contacting a consulting engineer to conduct an assessment. Please check with the Environment and Health Protection Branch for files dated between January 1960 to June 1977, Phone: 613-580-6744 ext. 23806 | | |
| <input checked="" type="checkbox"/> | To our knowledge there are no outstanding work orders against this system | | |
| <input type="checkbox"/> | Outstanding work orders against this system exist - see fax cover for details. | | |

NOTE: Life Expectancy of a sewage system is dependent on past usage and maintenance.

Personal information on this form is collected under the authority of the Health Protection and Promotion Act S.O. 1983 C 10 and the Environmental Protection Act R.S.O. 1980 C141 and will be used for the provision of the recording Environmental Health Services. Questions concerning the collection of this information should be directed to the Ottawa Septic System Office, 3889 Rideau Valley Drive, P.O. Box 599, Manotick, ON K4M 1A5. The forgoing information is given for your convenience only. It should be clearly understood that you must satisfy yourself as to whether the premises and existing or proposed use thereof is or would be in conformity with all applicable regulations.

PLEASE SAVE THIS FORM AND ATTACH THE PDF TO AN EMAIL

Batch # 13727
Entry #: 5

RECEIPT CONFIRMATION

Rideau Valley C. A.

P.O. Box 599
Manotick, Ontario K4M 1A5
Canada
Phone: (613) 692-3571
Fax: (613) 692-0831

DOCUMENT NO.: PY000035993

DATE: 12/2/2019

AMOUNT RECEIVED 150.00 CAD

FROM Janet Mousseau



SIGNATURE

PAID BY: VISA

CHECK/RECEIPT NO.: 000013727-00005

DATE RECEIVED: 12/2/2019

| DESCRIPTION | | AMOUNT |
|-------------------|---|--------|
| 4300-20-20600 | File Search 3449 Old Almonte (HUN) Septic FS-19-227 | 150.00 |
| SUB-TOTAL: | | 150.00 |
| TOTAL: | | 150.00 |

3449 OLD ALMONTE RD

PIN: 045400186

LEGAL DESCRIPTION / DESCRIPTION OFFICIELLE

| PIN | LEGAL DESCRIPTION / DESCRIPTION OFFICIELLE |
|-----------|--|
| 045400186 | PLAN M248 BLK 'A' AND LOT 20 |
| 045400187 | PLAN M248 BLK 'A' AND LOT 20 |



PROPERTY DIMENSIONS / DIMENSIONS DE LA PROPRIÉTÉ

| | |
|---|-----------|
| | 045400186 |
| FRONTAGE - ft / FAÇADE - pi: | 750.12 |
| DEPTH - ft / PRONFONDEUR - pi: | 0.00 |
| PROPERTY AREA - acre / SUPERFICIE - acre: | 9.2900 |

SERVICES / SERVICES

| PIN | WASTE COLLECTION PICK-UP DAY AND ZONE / JOUR ET ZONE DE LA COLLECTE DES ORDURES |
|-----------|--|
| 045400186 | Z1 WMI TUE A-Apt (GMP-Fbr) |

WARD INFORMATION / INFORMATIONS WARD

| PIN | WARD NUMBER / NUMÉRO DU QUARTIER | WARD NAME / NOM DU QUARTIER | COUNCILLOR NAME / NOM DU CONSEILLER - (ÈRE) |
|-----------|-------------------------------------|--------------------------------|--|
| 045400186 | 5 | WEST CARLETON- MARCH | Eli El-Chantiry |

Ottawa Septic System Office

From: Brandon Aubin <b.aubin@McIntoshPerry.com>
Sent: Friday, November 29, 2019 8:16 AM
To: Ottawa Septic System Office
Cc: Janet Mousseau
Subject: 3449 Old Almonte Road - Corkery Community Centre - File Search Request
Attachments: OSSO_Corkery Community Centre_Septic Records Search Form_11.29.19.pdf; 3449 Old Almonte Road_PropertyInformation.pdf

Good morning,


Please find attached a file search request form along with the additional submission requirements. Can you please send over the receipt of payment and include Janet from our office who I have cc'd in this email. If you need anything else let me know.

Regards,

Brandon Aubin

Civil Engineering Technologist
115 Walgreen Road, Carp, ON K0A 1L0
T. 613.903.5827 | C. 613.806.0336
b.aubin@McIntoshPerry.com | www.mcintoshperry.com

McINTOSH PERRY

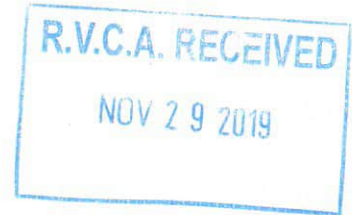

Confidentiality Notice – If this email wasn't intended for you, please return or delete it. Click [here](#) to read all of the legal language around this concept.



If you are using a web browser other than Microsoft Internet Explorer, please use the Export button to save this report as Word or pdf. You can then print the saved document.



3449 OLD ALMONTE RD

PIN: 045400186

LEGAL DESCRIPTION / DESCRIPTION OFFICIELLE

| PIN | LEGAL DESCRIPTION / DESCRIPTION OFFICIELLE |
|-----------|--|
| 045400186 | PLAN M248 BLK 'A' AND LOT 20 |
| 045400187 | PLAN M248 BLK 'A' AND LOT 20 |



PROPERTY DIMENSIONS / DIMENSIONS DE LA PROPRIÉTÉ

| | 045400186 |
|---|-----------|
| FRONTAGE - ft / FAÇADE - pi: | 750.12 |
| DEPTH - ft / PROFONDEUR - pi: | 0.00 |
| PROPERTY AREA - acre / SUPERFICIE - acre: | 9.2900 |

SERVICES / SERVICES

| PIN | WASTE COLLECTION PICK-UP DAY AND ZONE / JOUR ET ZONE DE LA COLLECTE DES ORDURES |
|-----------|--|
| 045400186 | Z1 WMI TUE A-Apt (GMP-Fbr) |

WARD INFORMATION / INFORMATIONS WARD

| PIN | WARD NUMBER / NUMÉRO DU QUARTIER | WARD NAME / NOM DU QUARTIER | COUNCILLOR NAME / NOM DU CONSEILLER - (ÈRE) |
|-----------|--|--------------------------------|--|
| 045400186 | 5 | WEST CARLETON- MARCH | Eli El-Chantiry |

Certificate of Completion



Ottawa Septic System Office Bureau des systèmes septiques d'Ottawa

For the use and operation of an on-site sewage disposal system in accordance with the **Sewage System Permit**.

This certifies that the on-site sewage system conforms to the *Ontario Building Code* and *Ontario Regulation 350/06* as amended by *Ontario Regulation 137/07*

| | | | | |
|--|--------|---------------------------------|---------------------------|---------------------------------|
| Sewage System Permit Number 09-505 | | Issued to City of Ottawa | | |
| Legal Description | Lot 20 | Concession | Sub. Lot | Registered/Reference Plan M 248 |
| Municipal Address: 3449 Old Almonte Rd | | | | |
| In the former Township/City of West Carleton, Huntley | | | Within the City of Ottawa | |

Details Pertaining to System new installation replacement alteration/repair

- a) Type of System: Class 4 sewage system trench filter media SBT area bed other
- b) New Existing septic/holding/pre-treatment tank with a working capacity of 3600 litres constructed of concrete fibreglass plastic
- c) Trench bed: 48 metres of [76 mm diameter pipe, or _____ chambers] laid in 4 runs of 12 m and fed by gravity pump
- d) Filter bed: Stone _____ m² Pipe _____ Fed by gravity pump
- e) Shallow Buried Trench: _____ metres of _____ millimetre diameter distribution pipe laid in _____ runs at _____ metres
- f) Area Bed: Stone _____ m² Sand _____ m² Pipe _____ Fed by gravity pump
- g) Effluent Filter: Manufacturer Zabel Model A-100
- h) Sewage Treatment Unit(s):* Manufacturer _____ Model _____
- i) Maintenance Contract:* _____ Expiry Date* _____
- j) Other: _____

Service provider must have Manufacturer Certification

Certificate Issued By:
Director of Regulations Jerry Davidson Date Issued DECEMBER 21, 2009
Ottawa Septic System Office



AS-BUILT COMPONENTS

(required prior to installation inspection)

Elevations of installed system must be supplied with this report (in reference to the TBM).

Exact size and location of all structures, well(s) and system(s) and its components must be shown (including neighbouring lots).


Septic/Holding Tank: 3600 L
 Manufacturer: MacGregor
 concrete polyethylene other
 Filter: no yes A100 make
 Treatment: Make: _____
 Unit: Model: _____
 Diameter of pipes: 3" mm/inches
 Make of pipes: Royal
 Ends: capped interconnected
 Number of runs: 4 m
 Length of runs: 12 m
Filter media:
 Amount Purchased: _____ kg
 Date Purchased: _____
 Supplier: _____
 Grain/size analysis by: _____
 Analysis dated: _____

Name of owner: City of Ottawa
 Installer: Lorne Montgomery Equip Rentals
 Installer Signature: Marcy Montgomery
 License Number: 37364
 Date of Installation: Oct 29/09
 Civic Address or Legal Description of Property:
3449 Old Almonte Rd.
 Township: Huntley
Pump Systems:
 Volume discharge rates: _____ /15 min
 Alarm location: _____
 Dimension of Pump Chamber: _____
 Height of Float Switch: _____
Grease Interceptor:
 no yes Size: _____
 Location: _____

*** Grain Size Analysis and weight bills must be supplied with this report.**


All rights reserved. No part of this work may be reproduced or used in any form without the prior written permission of the copyright holder.


NOTE: All as-built drawings must be cross-referenced to the house in two (2) locations.

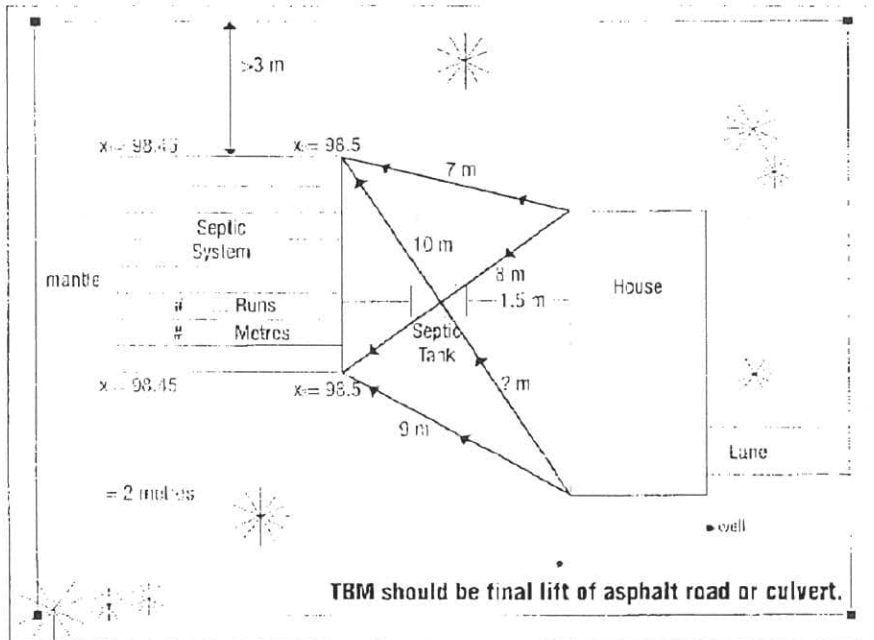

NOTE
 Drilled well • 15 metres to septic tank
 • 15 – 18 metres to distribution pipes
 Dug well • 15 metres septic tank
 • 30 – 33 metres to distribution pipes

AS-BUILT DRAWING

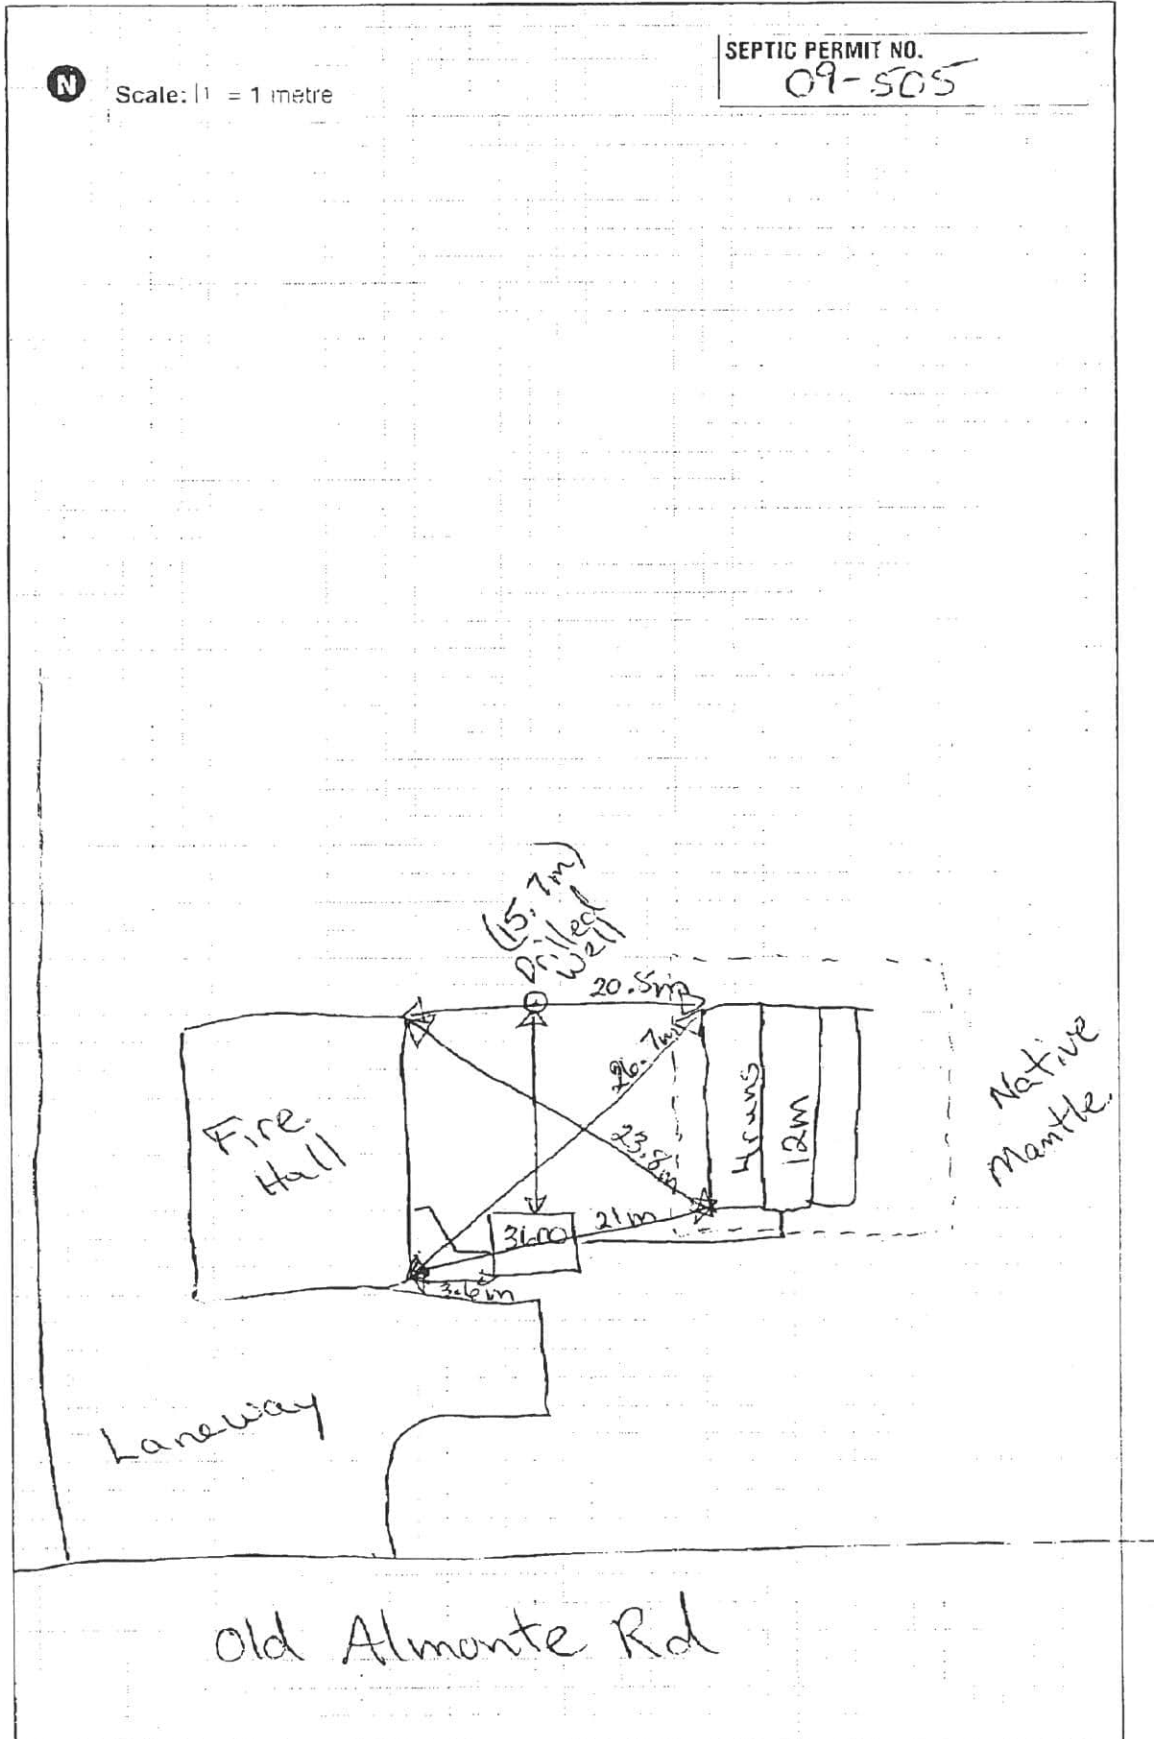

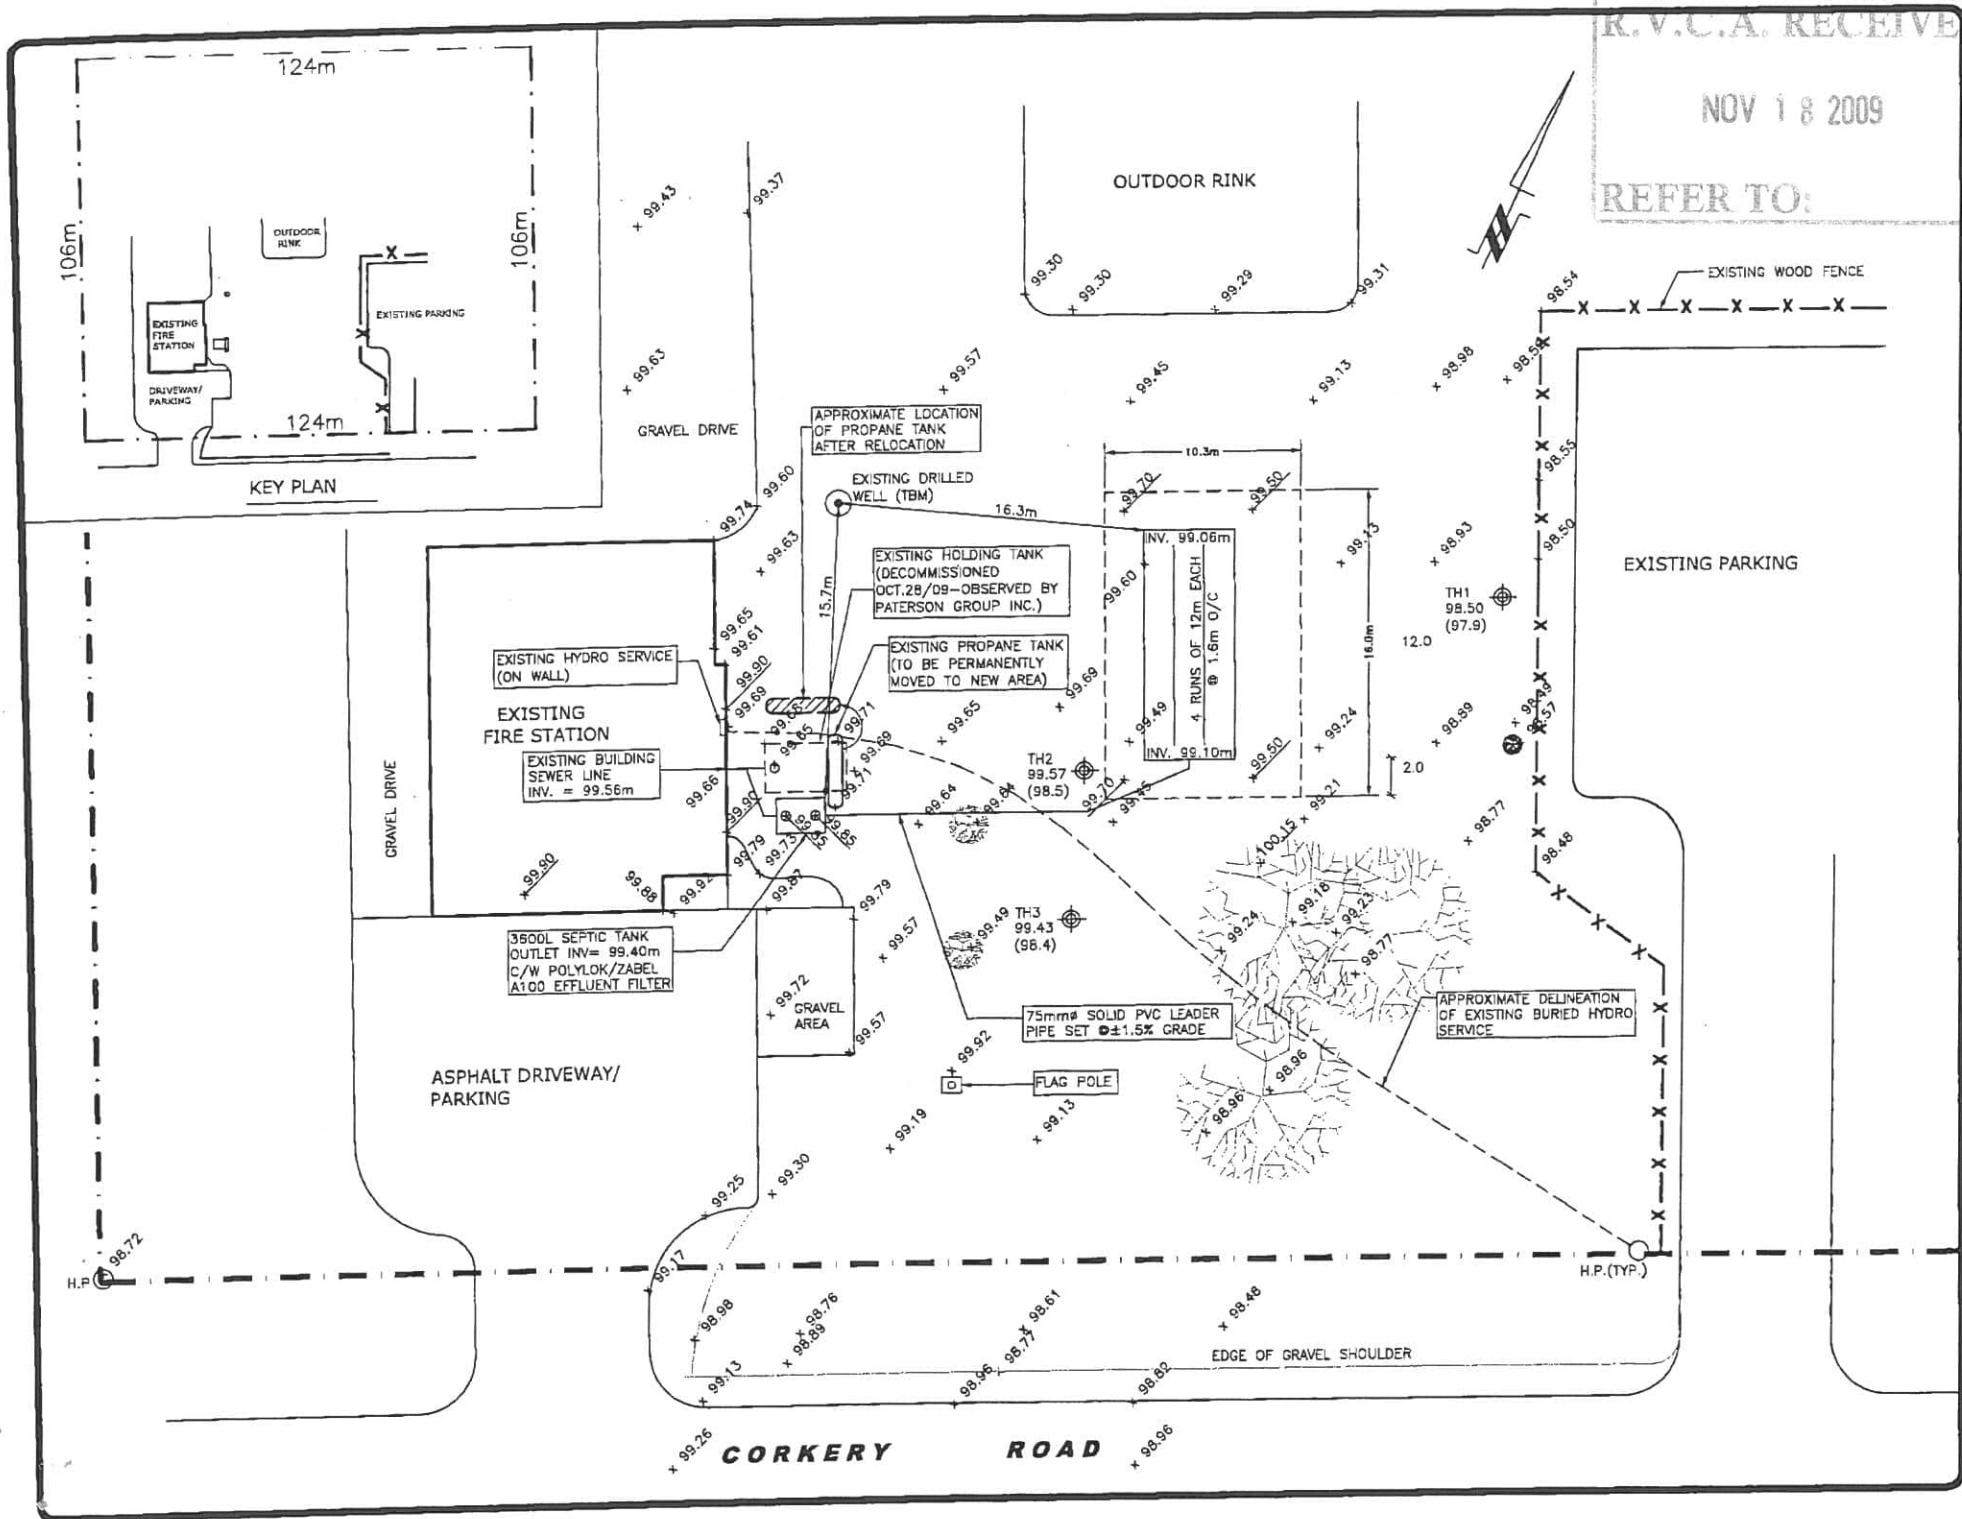

R.V.C.A. RECEIVE
 NOV 18 2009
 REFER TO:

LEGEND:
 ⊕ TEST HOLE LOCATION
 98.54 EXISTING GROUND SURFACE ELEV. (m)
 99.00 PROPOSED GROUND SURFACE ELEV. (m)
 (98.5) INFERRED BEDROCK ELEVATION (m)

BENCHMARK INFORMATION:
 TBM - TOP OF EXISTING DRILLED WELL
 ASSUMED ELEVATION = 100.00m

| Date | Description | Rev. |
|----------|---------------------|------|
| 28/10/09 | REVISED BED LAYOUT | 1 |
| 17/09/09 | ISSUED FOR APPROVAL | 0 |

Client:
CITY OF OTTAWA

Consultant:
patersongroup
 consulting engineers

Project:
CORKERY FIRE STATION NO. 84
 3449 OLD ALMONTE ROAD
 OTTAWA, ONTARIO

Drawing:
SEWAGE SYSTEM LAYOUT PLAN (AS-BUILT DRAWING)

Scale: 1:300
 Date: 09/2009
 Drawn by: BAA
 Checked by: RAP
 File: PH1211

Seal:
 Drawing No.:

PH1211-3

RENOVATION PERMIT #

B - 22 - 085

PART 10 & 11 - OSSO



Ottawa Septic System Office Bureau des systèmes septiques d'Ottawa

3889 Rideau Valley Drive Box 599 Manotick, ON K4M 1A5

Phone: 613-692-3571 Press "4"

Fax: 613-692-1507

Email: septic@rvca.ca

Scan - Email -Phone
Folder - CanadaPost -PickUp Box



Address of property: 3447 Old Almonte Township: Cum-Osg-Glo-Ott-Fit-Tor-Hun-Kan-Gou-Rid-Nep
Contact for pickup: City of Ottawa Phone#/Email: _____

INFORMATION FOR OWNER/APPLICANT

Attached is the completed plan review & comments for the proposed Renovation/Change of Use.

- Approval Part 10,11 – TWO (2) copies - attached:
 - APPLICANT – Copy #1 to retain for own reference & records
 - CITY – Copy #2 ** Agent/Property Owner is responsible for delivering directly to City Plans Examiner to append to concurrent building application package**

PLEASE NOTE

- A permit is **valid for 12 months** from the original date of issuance noted in field labelled "permit date". If lapsed, it is not renewable.
- No person shall make a material change or cause a material change to be made to a plan, specification, document or other information on the basis of which a permit was issued without notifying, filing details with and obtaining the authorization of the Chief Building Official. (*Building Code Act 1992, c.23, s.8(12)*)

Visit our website for a detailed description of the review process
Ottawasepticsystemoffice.ca

Questions – Contact Reviewer

EAST of Rideau River: Cumberland, Osgoode, Gloucester, Ottawa

WEST of Rideau River: Fitzroy, Torbolton, Huntley, Kanata, Goulbourn, Rideau, Nepean

Jason Hutton

x1152

jason.hutton@rvca.ca

Thank You!


Reno Part 10,11
Change of Use

Application for a Permit to Construct or Demolish

This form is authorized under subsection 8(1.1) of the *Building Code Act, 1992*

| | | | |
|--|------------------|---|-----------------------------|
| R.V.C.A. RECEIVED | | For use by Principal Authority | |
| Application number: | | Permit number (if different): | |
| OCT 28 2022 | | RENOVATION PERMIT # | |
| Date received: | | Roll number: | |
| | | B-22-085 | |
| PART 10 & 11 - OSSO | | | |
| Application submitted to: OTTAWA SEPTIC SYSTEM OFFICE | | | |
| (Name of municipality, upper-tier municipality, board of health or conservation authority) | | | |
| A. Project information | | | |
| Building number, street name | | Unit number | Lot/con. |
| 3447 Old Almonte Road | | | |
| Municipality | Postal code | Plan number/other description | |
| City of Ottawa | K0A 1L0 | | |
| Project value est. \$ | | Area of work (m ²) | |
| | | | |
| B. Purpose of application | | | |
| New construction | | Addition to an existing building | |
| | | Alteration/repair | |
| | | Demolition | |
| | | Conditional Permit | |
| Proposed use of building | | Current use of building | |
| Residential | | Residential | |
| Commercial | | Commercial | |
| Other: Community Centre | | Other: Community Centre | |
| Description of proposed work Check ALL that apply | | | |
| Add BEDROOMS Y (N) | | | |
| Add FIXTURES Y (N) | | | |
| Add FINISHED FLOOR AREA Y (N) | | | |
| CHANGE of USE Y (N) | | | |
| If OTHER, please describe project here: Obtain approval of existing undocumented Class 4 absorption trench sewage system to service existing community centre and proposed building expansion. See attached memorandum for detailed assessment of existing sewage system. | | | |
| C. Applicant | | | |
| Applicant is: | | <input type="checkbox"/> Owner or <input checked="" type="checkbox"/> Authorized agent of owner | |
| Last name | First name | Corporation or partnership | |
| Leblanc | Patrick | McIntosh Perry Consulting Engineers Ltd. | |
| Street address | | Unit number | Lot/con. |
| 115 Walgreen Road | | | |
| Municipality | Postal code | Province | E-mail |
| Carp | K0A 1L0 | ON | p.leblanc@mcintoshperry.com |
| Telephone number | Fax | Cell number | |
| (613) 714-4586 | (613) 836-3742 | (613) 229-5863 | |
| D. Owner (if different from applicant) | | | |
| Last name | | First name | |
| | | Corporation or partnership | |
| | | City of Ottawa | |
| Street address | | Unit number | Lot/con. |
| 110 Laurier Avenue West | | | |
| Municipality | Postal code | Province | E-mail |
| Ottawa | K1P 1J1 | ON | nupur.chakravorty@ottawa.ca |
| Telephone number | Fax | Cell number | |
| (613) 580-2400 ext. 4312 | () | (613) 286-0575 | |

Application for a Permit to Construct or Demolish – Effective January 1, 2014

| | | | |
|---|-------------|--|--|
| E. Builder (optional) | | | |
| Last name | First name | Corporation or partnership (if applicable) | |
| Street address | Postal code | Province | Unit number Lot/con. # |
| Municipality | Postal code | Province | E-mail |
| Telephone number () | Fax () | Cell number () | |
| F. Tarion Warranty Corporation (Ontario New Home Warranty Program) | | | |
| i. Is proposed construction for a new home as defined in the <i>Ontario New Home Warranties Plan Act</i> ? If no, go to section G. | | Yes | No <input checked="" type="checkbox"/> |
| ii. Is registration required under the <i>Ontario New Home Warranties Plan Act</i> ? | | Yes | No <input checked="" type="checkbox"/> |
| iii. If yes to (ii) provide registration number(s): _____ | | | |
| G. Required Schedules | | | |
| i) Attach Schedule 1 for each individual who reviews and takes responsibility for design activities. | | | |
| ii) Attach Schedule 2 where application is to construct on-site, install or repair a sewage system. | | | |
| H. Completeness and compliance with applicable law | | | |
| i) This application meets all the requirements of clauses 1.3.1.3 (5) (a) to (d) of Division C of the <i>Building Code</i> (the application is made in the correct form and by the owner or authorized agent, all applicable fields have been completed on the application and required schedules, and all required schedules are submitted). | | Yes <input checked="" type="checkbox"/> | No |
| Payment has been made of all fees that are required, under the applicable by-law, resolution or regulation made under clause 7(1)(c) of the <i>Building Code Act, 1992</i> , to be paid when the application is made. | | Yes <input checked="" type="checkbox"/> | No |
| ii) This application is accompanied by the plans and specifications prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> . | | Yes <input checked="" type="checkbox"/> | No |
| iii) This application is accompanied by the information and documents prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> which enable the chief building official to determine whether the proposed building, construction or demolition will contravene any applicable law. | | Yes <input checked="" type="checkbox"/> | No |
| iv) The proposed building, construction or demolition will not contravene any applicable law. | | Yes <input checked="" type="checkbox"/> | No |
| I. Declaration of applicant | | | |
| I, <u>Patrick Leblanc</u> declare that: | | | |
| (print name) | | | |
| 1. The information contained in this application, attached schedules, attached plans and specifications, and other attached documentation is true to the best of my knowledge. | | | |
| 2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership. | | | |
| Date May 26, 2022 | | Signature of applicant  | |


Personal information contained in this form and schedules is collected under the authority of subsection 8(1.1) of the *Building Code Act, 1992*, and will be used in the administration and enforcement of the *Building Code Act, 1992*. Questions about the collection of personal information may be addressed to: a) the Chief Building Official of the municipality or upper-tier municipality to which this application is being made, or, b) the inspector having the powers and duties of a chief building official in relation to sewage systems or plumbing for an upper-tier municipality, board of health or conservation authority to whom this application is made, or, c) Director, Building and Development Branch, Ministry of Municipal Affairs and Housing 777 Bay St., 2nd Floor. Toronto, M5G 2E5 (416) 585-6666.

R.V.C.A. RECEIVED

2022-05-28

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

| | | | |
|--|---|--|--|
| A. Project Information | | | |
| Building number, street name 3447 Old Almonte Road | | Unit no. | Lot/cont. |
| Municipality City of Ottawa | Postal code K0A 1L0 | Plan number/ other description | |
| B. Individual who reviews and takes responsibility for design activities | | | |
| Name Patrick Leblanc, P.Eng. | | Firm McIntosh Perry Consulting Engineers Ltd. | |
| Street address 115 Walgreen Road, R.R.3 | | Unit no. | Lot/cont. |
| Municipality Carp (City of Ottawa) | Postal code K0A 1L0 | Province | E-mail p.leblanc@mcintoshperry.com |
| Telephone number (613) 714-4586 | Fax number () | Cell number (613) 229-5863 | |
| C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1. of Division C] | | | |
| House | HVAC – House | Building Structural | |
| Small Buildings | Building Services | Plumbing – House | |
| Large Buildings | Detection, Lighting and Power | Plumbing – All Buildings | |
| Complex Buildings | Fire Protection | <input checked="" type="checkbox"/> On-site Sewage Systems | |
| Description of designer's work | | | |
| Obtain approval of existing undocumented Class 4 absorption trench sewage system to service existing community centre and proposed building expansion. See attached memorandum for detailed assessment of existing sewage system. | | | |
| D. Declaration of Designer | | | |
| I, <u>Patrick Leblanc, P.Eng.</u> declare that (choose one as appropriate): (print name) | | | |
| I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____ | | | |
| I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: _____ Basis for exemption from registration: <u>P.Eng. (Licence # 100141438)</u> | | | |
| The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____ | | | |
| I certify that: | | | |
| 1. The information contained in this schedule is true to the best of my knowledge. | | | |
| 2. I have submitted this application with the knowledge and consent of the firm. | | | |
| Date May 26, 2022 | Signature of Designer  | | |

RESERVATION PERMIT #
22-085
PART 10 & 11
OSSE

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) (c) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of practice, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

R.V.C.A. RECEIVED

OCT 28 2022

Schedule 2: Sewage System Installer Information

RENOVATION PERMIT #
8-22-085
PART 10 & 11 - OSSO

| | | |
|--|-------------------------------|--------------------------------|
| A. Project Information | | |
| Building number, street name 3447 Old Almonte Road | | Unit number Lot/con. |
| Municipality City of Ottawa | Postal code K0A 1L0 | Plan number/ other description |

B. Sewage system installer

Is the installer of the sewage system engaged in the business of constructing on-site, installing, repairing, servicing, cleaning or emptying sewage systems, in accordance with Building Code Article 3.3.1.1, Division C?

Yes (Continue to Section C) No (Continue to Section E) Installer unknown at time of application (Continue to Section E)

C. Registered installer information (where answer to B is "Yes")

| | | | |
|-------------------------|-------------|--------------------|----------|
| Name | | BCIN | |
| Street address | | Unit number | Lot/con. |
| Municipality | Postal code | Province | E-mail |
| Telephone number () | Fax () | Cell number () | |

D. Qualified supervisor information (where answer to section B is "Yes")

| | |
|---------------------------------|--|
| Name of qualified supervisor(s) | Building Code Identification Number (BCIN) |
| | |

E. Declaration of Applicant:

I, Patrick Leblanc declare that:
(print name)


I am the applicant for the permit to construct the sewage system. If the installer is unknown at time of application, I shall submit a new Schedule 2 prior to construction when the installer is known;

OR

I am the holder of the permit to construct the sewage system, and am submitting a new Schedule 2, now that the installer is known.

I certify that:

- The information contained in this schedule is true to the best of my knowledge.
- If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.

Date **May 26, 2022** Signature of applicant 



R.V.C.A. RECEIVED
OCT 28 2022

RENOVATION PERMIT #
B-22-085
PART 10 & 11 - OSSO

Schedule 13
Part 10 & 11 Site Amendment
Check All that apply to project

Site Amendment/Description of Proposed Change/Renovation

Residential Community Centre
 Commercial Property

| | | | | | | | | |
|---------------|-----------|-----|---|-----------|-------|---|-------|---------------------------------|
| Bedrooms: | #Existing | n/a | + | #Proposed | n/a | = | n/a | Schedule 8 (m ²) |
| Fixture Units | #Existing | 18 | + | #Proposed | 11.5 | = | 29.5 | |
| Floor Area | #Existing | 120 | + | #Proposed | 387.6 | = | 507.6 | |

Exceeding 15% of the gross area of the dwelling units for proposed addition
 Change in Use:
 Major occupancy (e.g. residential to commercial)
 Occupant load (e.g. Office to warehouse)
 Please describe proposed use:

 Installation of a POOL not meeting O.B.C Regulation setback distances
 Installation of a DECK not meeting O.B.C Regulation setback distances

Required attachments

To be supplied by applicant/agent at applicant's expense:

- One of the following documents to **DESCRIBE CURRENT SEPTIC SYSTEM** (ONE x1 copy):
 - A. Copy of current sewage system approval (Use permit/ Certificate of Completion)
 - B. Professional engineer's report indicating size and location of system
- Each of these documents to **DESCRIBE PROPOSED RENOVATION** (ONE x1 copy)
 - A. Copy of site plan: Drawn to scale, indicating the layout of the existing building, well, other structures i.e shed, workshop, cabana
 - B. Completed Reno 10,11 Application Form
 - C. Copy of Building Plans: Drawn to scale, showing the changes/additions as proposed



R.V.C.A. RECEIVED
OCT 28 2022

RENOVATION PERMIT
8-22-085
Do Not Complete
Permit #
Revision #
Date: 08/30

**Schedule 8
Fixture unit count**

| Fixtures | # Existing + # Proposed X unit count = Fixture Count | | | | | |
|---|--|---|---|---|-----|-------|
| Bathroom | | | | | | |
| Bathroom group (toilet, sink and tub or shower) installed in the <u>same</u> room | | + | | X | 6 | = |
| Bathtub with/without overhead shower | | + | | X | 1.5 | = |
| Shower stall | | + | | X | 1.5 | = |
| Wash basin (SINK) (1½inch trap) | 2 | + | 3 | X | 1.5 | = 7.5 |
| Watercloset (TOILET) tank operated | 3 | + | 1 | X | 4 | = 16 |
| Bidet | 1 | + | | X | 1.5 | = 1.5 |
| Kitchen | | | | | | |
| Dishwasher | | + | | X | 1 | = |
| Sink with/without garbage grinder(s), domestic and other small type single, double or 2 single with a common trap | 1 | + | 1 | X | 1.5 | = 3.0 |
| Other | | | | | | |
| Domestic washing machine | | + | | X | 1.5 | = |
| Combination sink and laundry tray single or double (Installed on 1½ trap) | | + | 1 | X | 1.5 | = 1.5 |

***Total: 29.5**

***Insert the TOTAL in Schedule 13 (O.Reg 151/13 Table 7.4.9.3)**

1. **Sump pumps and floor drains are not to be connected to the sewage system.** Connection of such fixtures to a sewage system may lead to a hydraulic failure of the said system. The above mentioned fixtures should be discharged separately to an approved Class 2 (leaching pit) sewage system.
2. Where laundry waste is not more than 20% of the total daily design sanitary sewage flow, it may discharge to a sewage system (Part 8, OBC, 8.1.3.1(2)).


Agent/Owner signature

May 26, 2022
Date



TBM: TOP OF EXISTING DRILLED WELL
ASSUMED ELEVATION = 100.00m

| No. | Revision/Issue | Date |
|-----|-----------------------------|------------|
| 1 | REVISED/FOR OSSO SUBMISSION | MAY/3/2022 |
| 0 | ISSUED FOR REVIEW | JAN/08/20 |

McINTOSH PERRY
 115 Walgreen Road, RR 3
 Carp, ON K0A 1L0
 Tel: 613-836-2184 Fax: 613-836-3742
 www.mcintoshperry.com

Stamp: **K.V.S.A. RECEIVED**
OCT 28 2022
 Stamp: **RENOVATION PERMIT #**
B-22-085
PART 10 & 11 - OSSO

Client:
CITY OF OTTAWA
 100 CONSTELLATION DRIVE

Project:
CORKERY COMMUNITY CENTRE
SEWAGE SYSTEM ASSESSMENT
 3447 OLD ALMONTE ROAD

Drawing Title:
EXISTING SEWAGE SYSTEM PLAN

| | | |
|--------------|-----------|---|
| Scale: | 1:250 | Project Number: CM-19-0590/ CCO-21-3339 |
| Drawn by: | BA | |
| Checked By: | PL | Drawing Number: FIG.1 |
| Designed By: | | |
| Date: | DEC/20/19 | |

ALLIANCE CONSULTANTS INC. Project: Corkery Community Centre Sewage System Assessment, 3447 Old Almonte Road, Ottawa, Ontario, Canada
 Date: 2022-05-03 10:00 AM
 Scale: 1:250
 Drawing: FIG.1



Do Not Complete
 Permit No B-22-085
 Revision No _____
 Date _____

Permit
 Part 10/11- Change of Use/Renovation
 Ontario Building Code

This permit verifies that the on-site sewage system was reviewed under the *Ontario Building Code* and *Ontario Regulation 350/06* as amended by *Ontario Regulation 503/09*

Reviewed & Recommended by: J.Hutton Owner: City of Ottawa
 Civic Address: 3447 Old Almonte Rd Legal: _____
 Roll #: _____

Existing number of bedrooms _____ Proposed number of bedrooms _____
 Existing number of fixture units _____ Proposed number of fixture units _____
 Existing finished floor area _____ m2 Proposed finished floor area _____ m2
 Existing design flow 3600 L/day Proposed design flow 3600 L/day

Type of system: Trench Filter Media Bed Area Bed Treatment Unit Effluent filter
 Bed Configuration 8 runs at 18.5 m _____
 Tank size 10870 L

Permit Refused By:

 Terry K. Davidson, P.Eng., Manager Septic System Approvals Date _____

Permit Refused for the following reasons:

- Contact a licensed installer
- Must obtain a permit for tank replacement
- Must obtain a permit for new sewage system
- Must obtain a permit for effluent filter and riser
- Building plans required
- Septic system records required
- Engineer's assessment of septic system required

Permit Approved and Issued By:

Terry K Davidson
 Terry K. Davidson, P.Eng., Manager - Septic System Approvals

NOVEMBER 8, 2022
 Permit Date

Details and Conditions of Approval:

1. Existing sewage system may be re-used for new building addition with a maximum occupancy of 100 people in the assembly hall with food service provided.

 Terry K. Davidson, P.Eng., Manager - Septic System Approvals

 Revision Date

Details and Conditions of Approval:

****Note: this permit is valid for 12 months from the date of signing. It is not renewable.****