

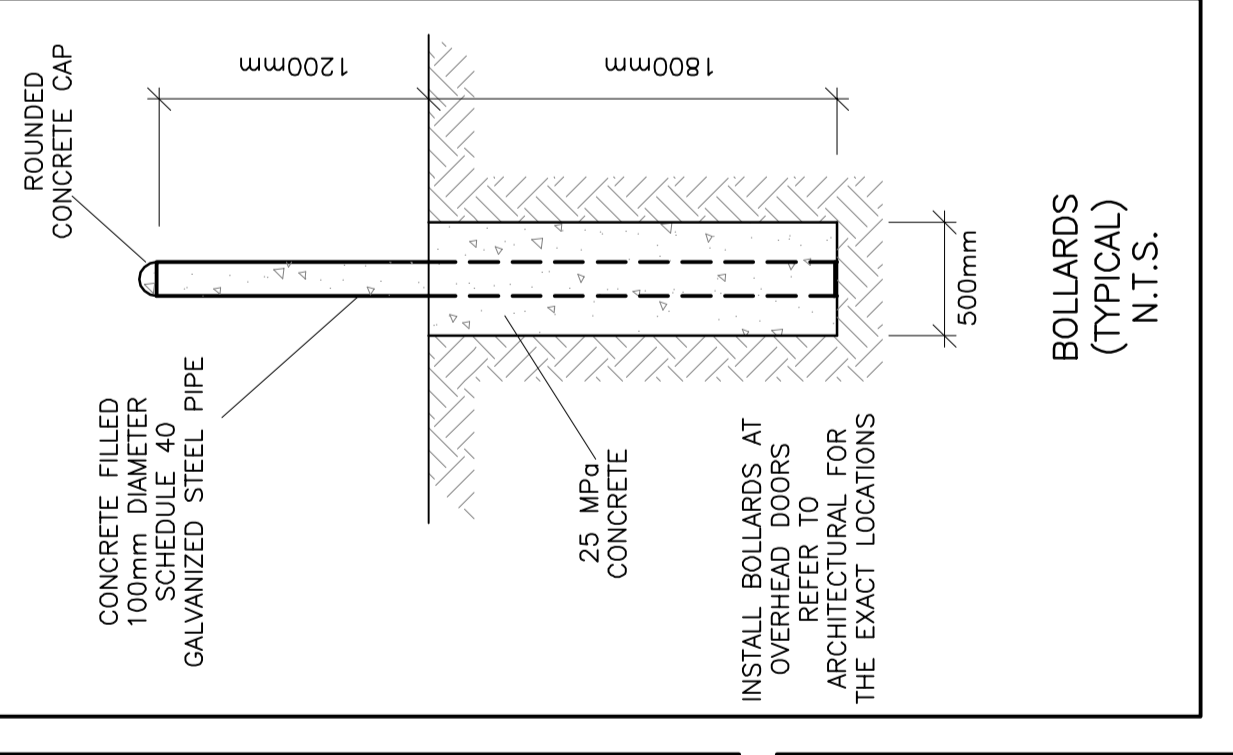



**OWNER:  
STOKED INDUSTRIES INC  
14 KNOLL TERRACE,  
NEPEAN ON  
K2J 2K6**

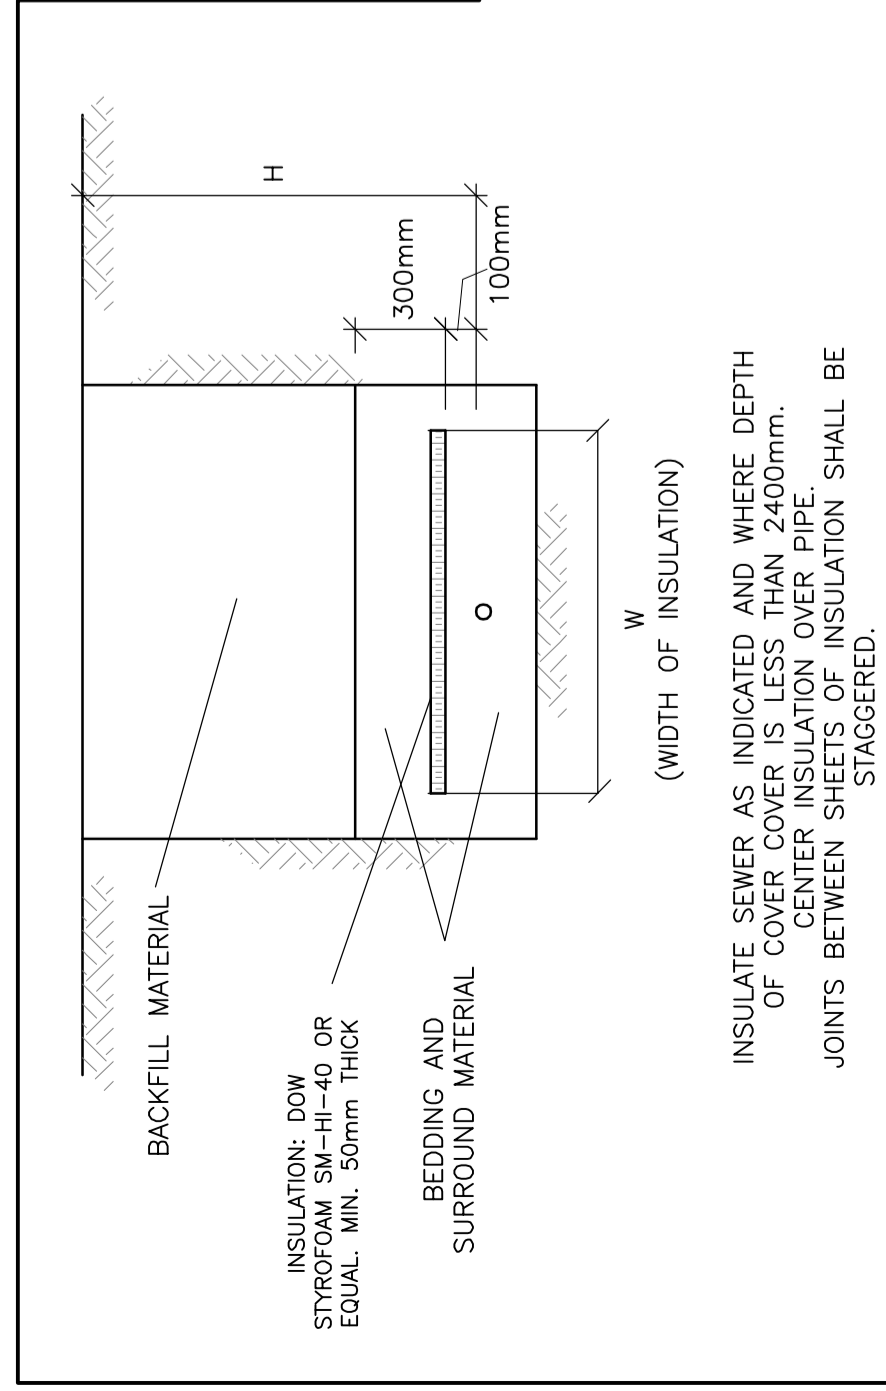


H (DEPTH OF COVER)	INSULATION THICKNESS	W (WIDTH OF INSULATION)
1800 TO 2400mm	50mm	1200mm
1500 TO 1800mm	75mm	1800mm
1200 TO 1500mm	100mm	2400mm

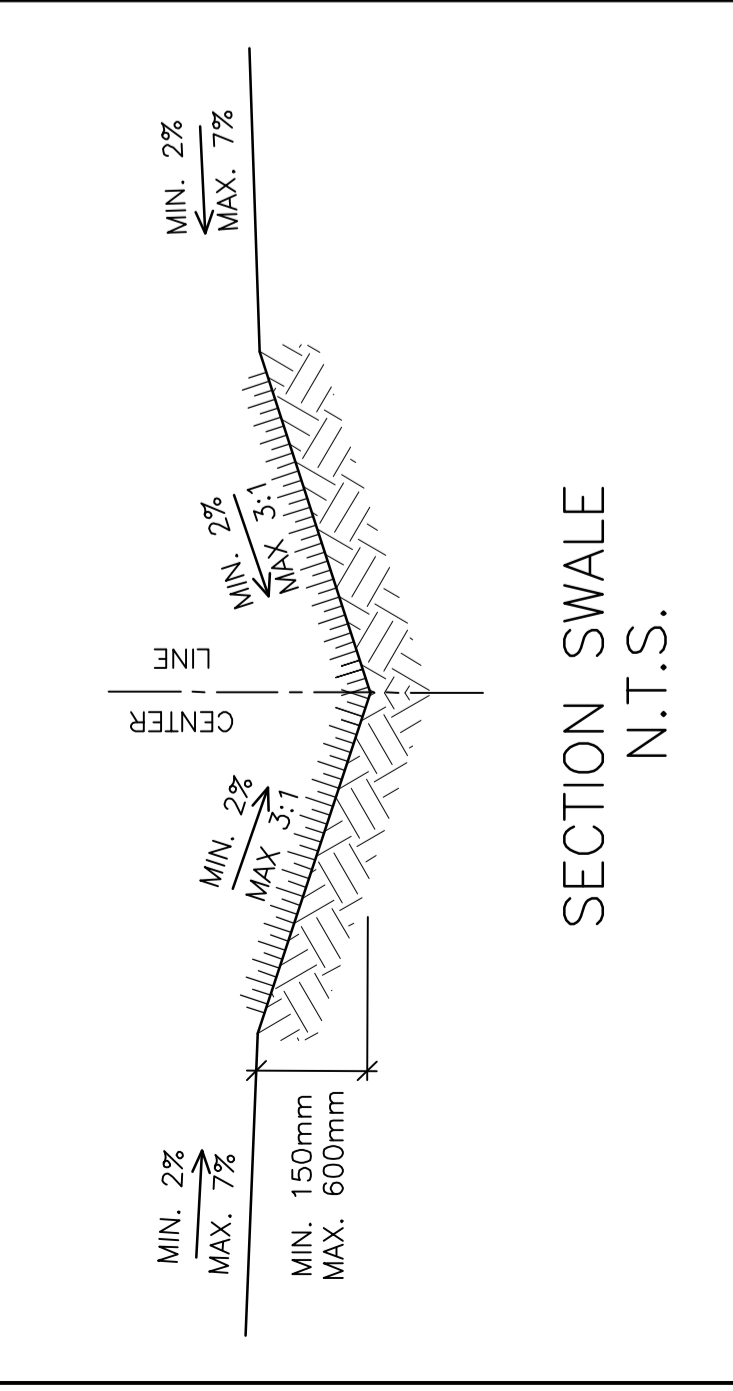


INSULATE SEWER AS INDICATED AND WHERE DEPTH OF COVER IS LESS THAN 2400mm. CENTER INSULATION OVER PIPE. JOINTS BETWEEN SHEETS OF INSULATION SHALL BE STAGGERED.

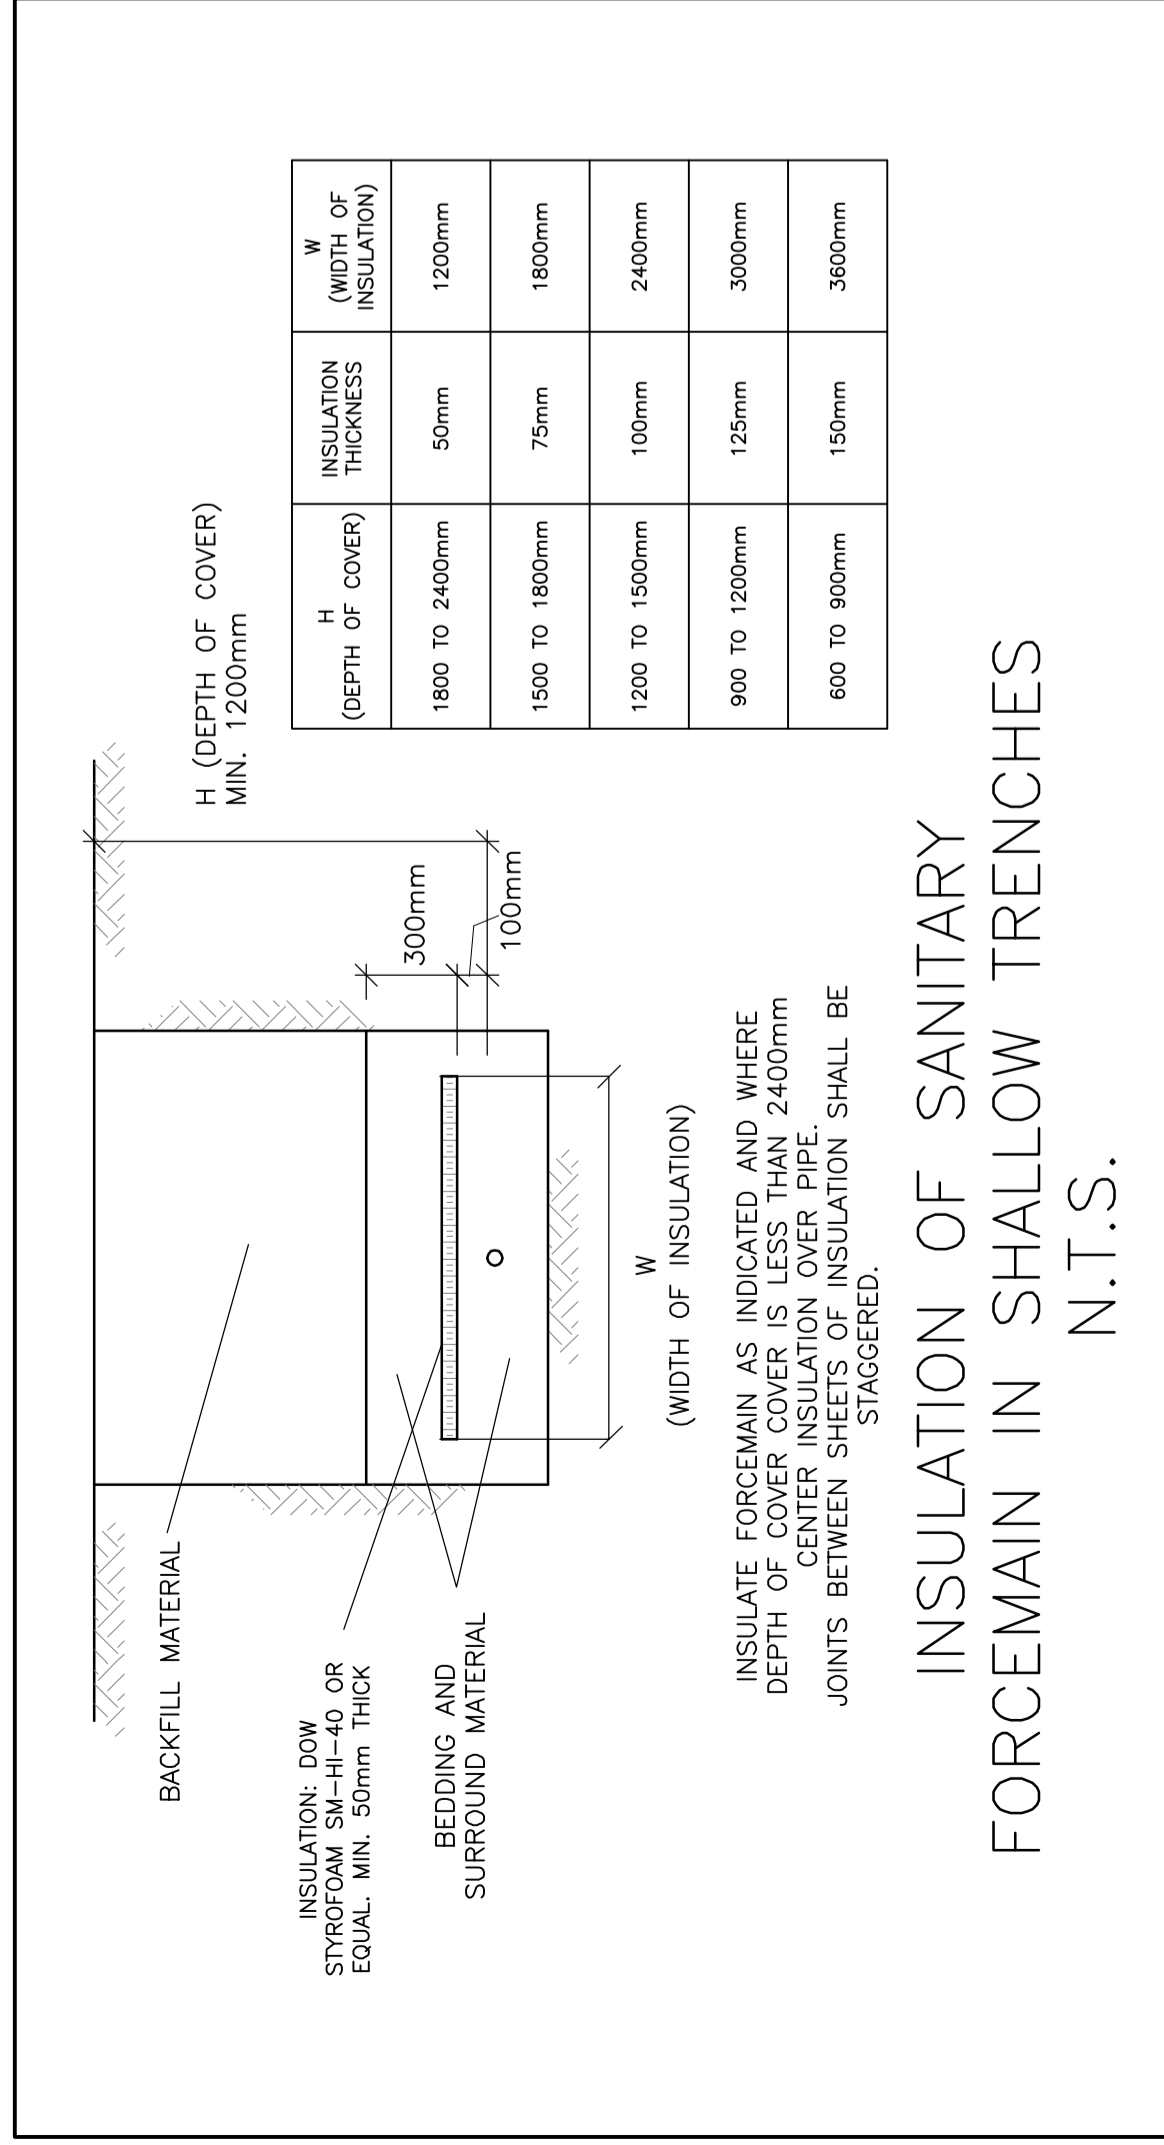








INSULATE FORCEMAIN AS INDICATED AND WHERE DEPTH OF COVER IS LESS THAN 2400mm CENTER INSULATION OVER PIPE. JOINTS BETWEEN SHEETS OF INSULATION SHALL BE STAGGERED.

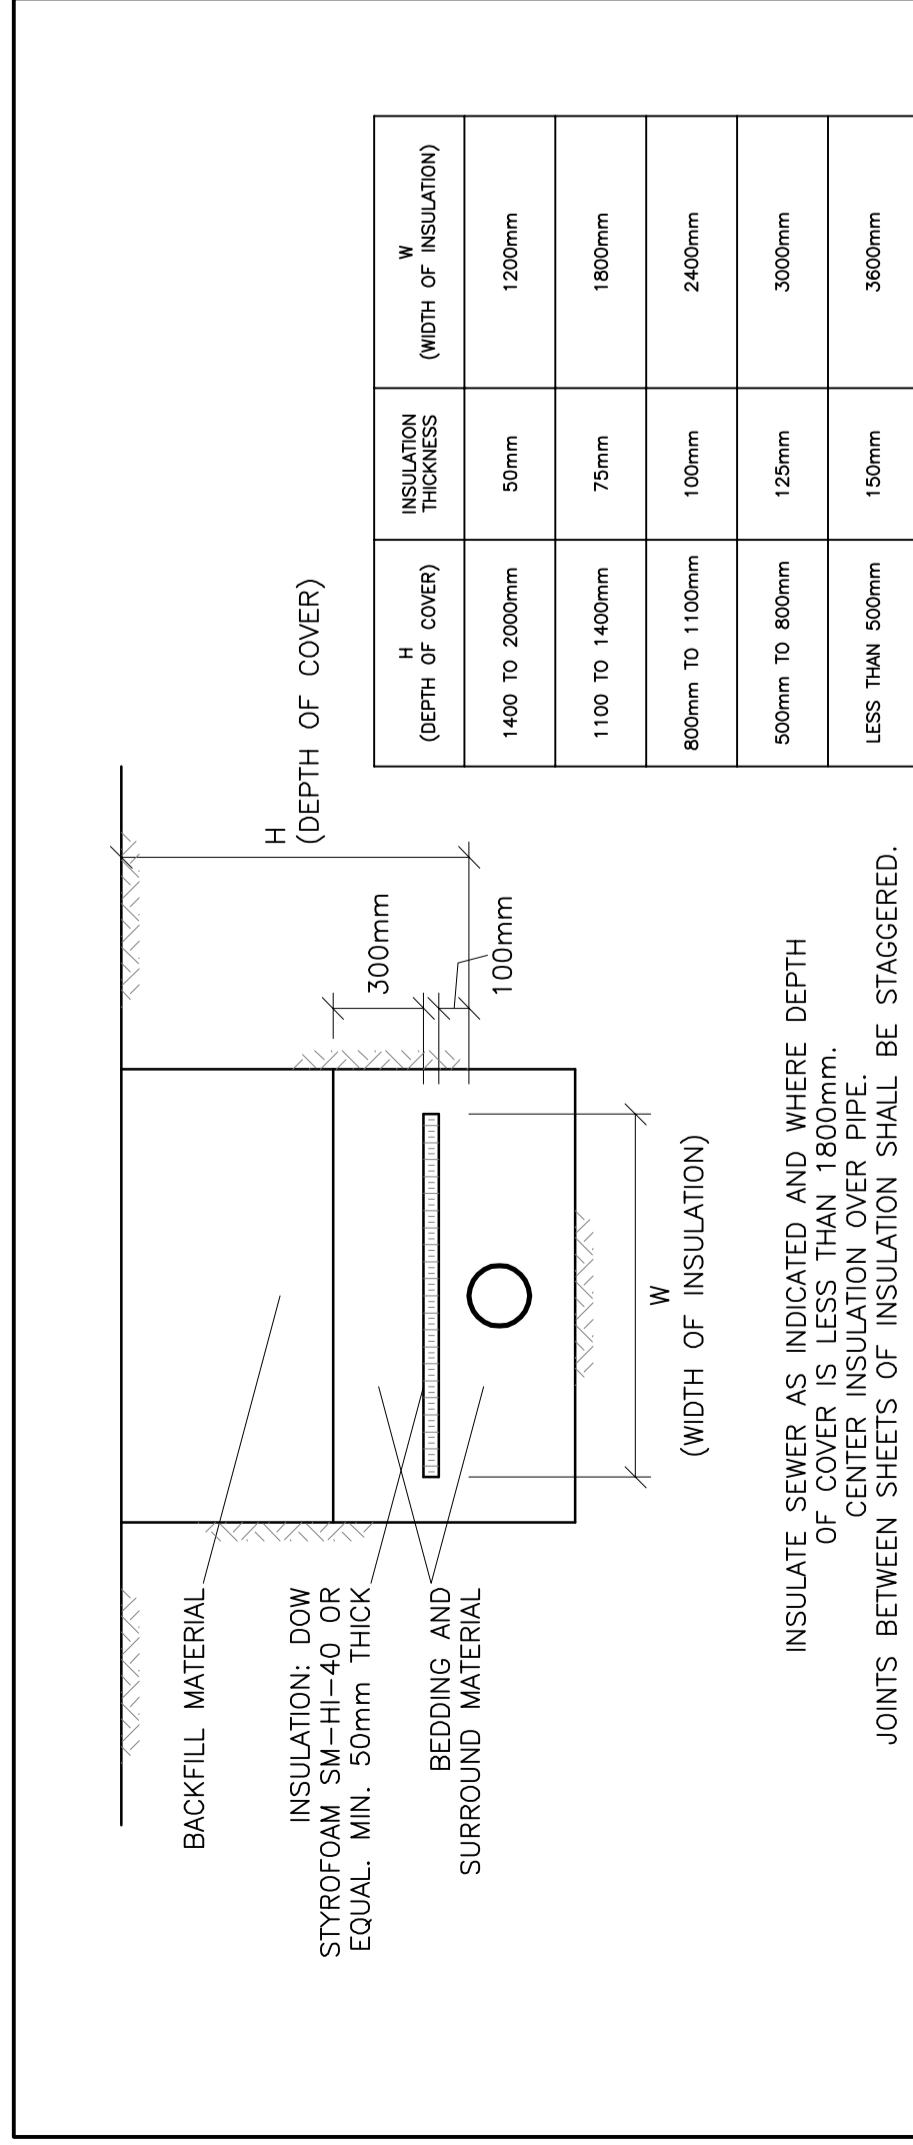

INSULATE SEWER AS INDICATED AND WHERE DEPTH OF COVER IS LESS THAN 2400mm. CENTER INSULATION OVER PIPE. JOINTS BETWEEN SHEETS OF INSULATION SHALL BE STAGGERED.

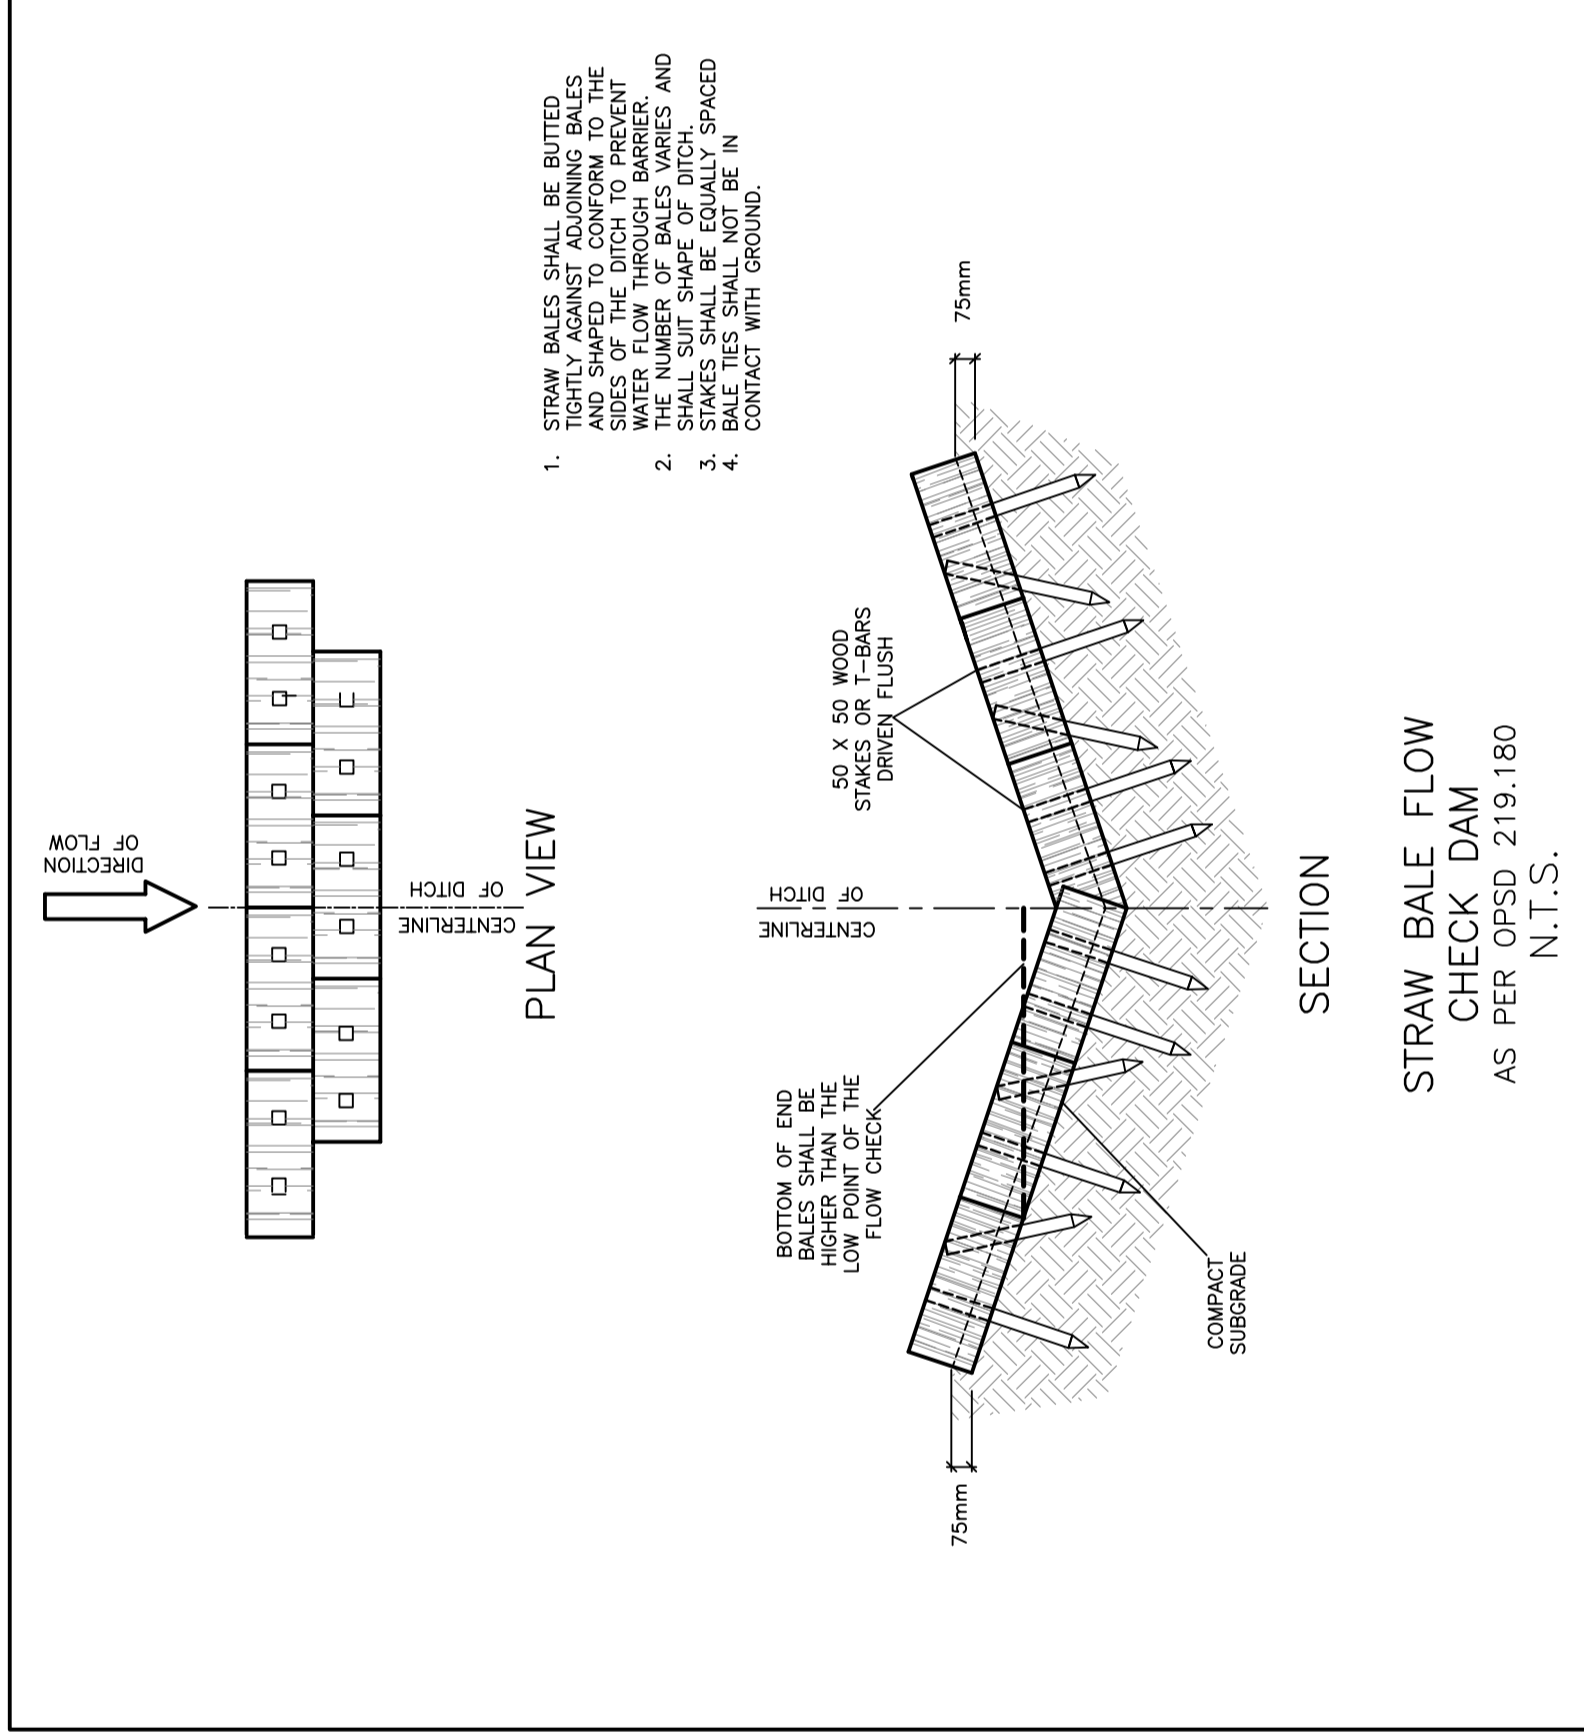

1. STRAW BALES SHALL BE BITTED TOGETHER AND SHAPED TO CONFORM TO THE WATER FLOW THROUGH BARRIERS.
2. STAKES SHALL BE EQUALLY SPACED AND CONTACT WITH GROUND.
3. STAKES SHALL BE EQUALLY SPACED AND CONTACT WITH GROUND.
4. CONTACT WITH GROUND.

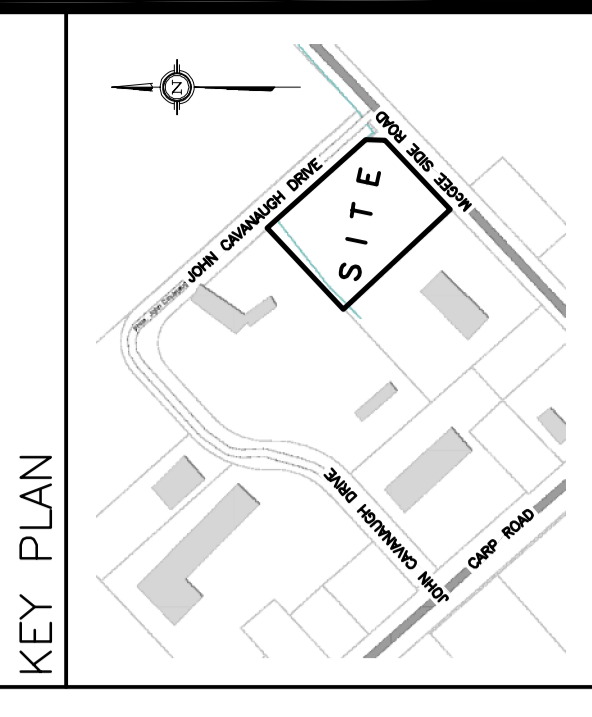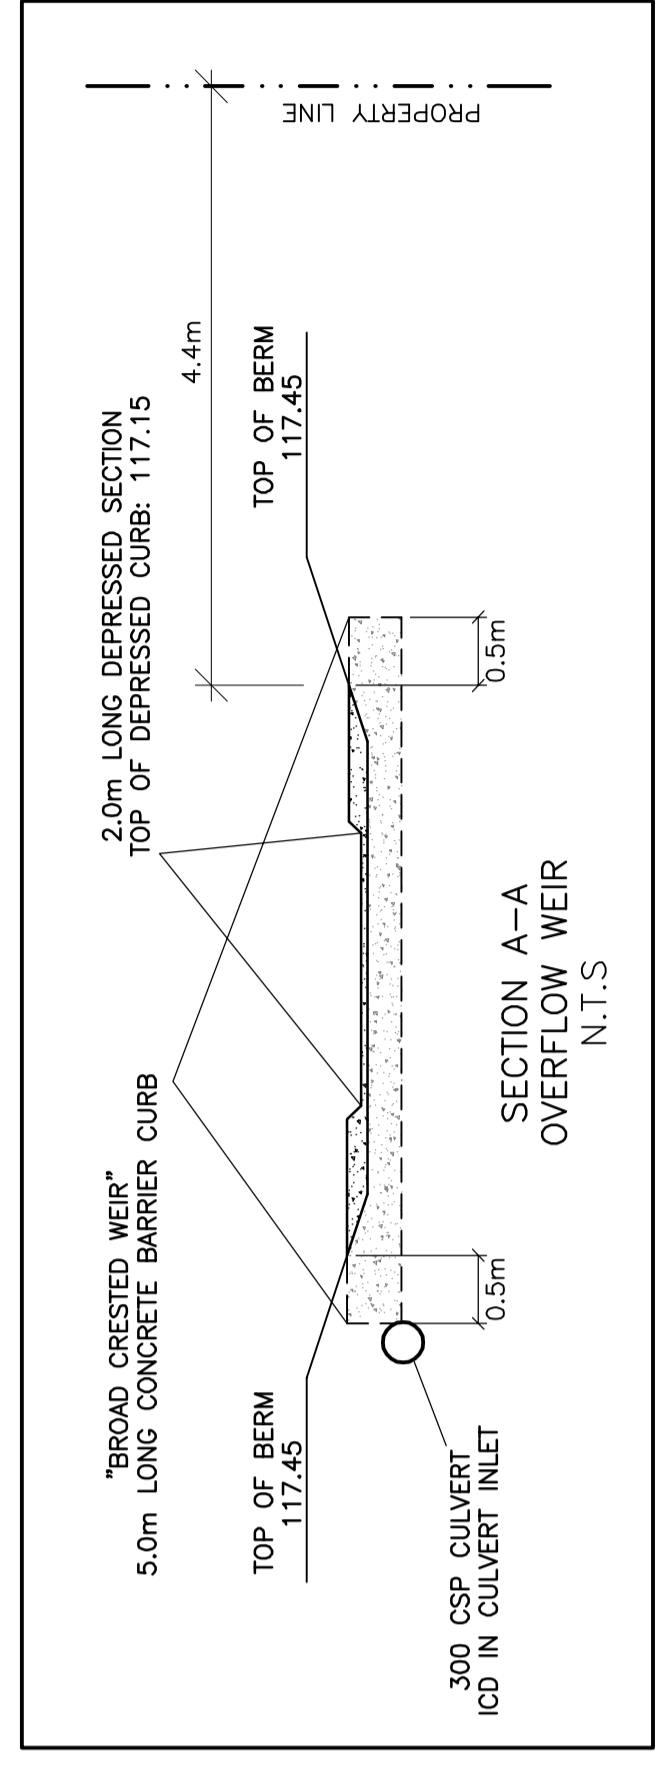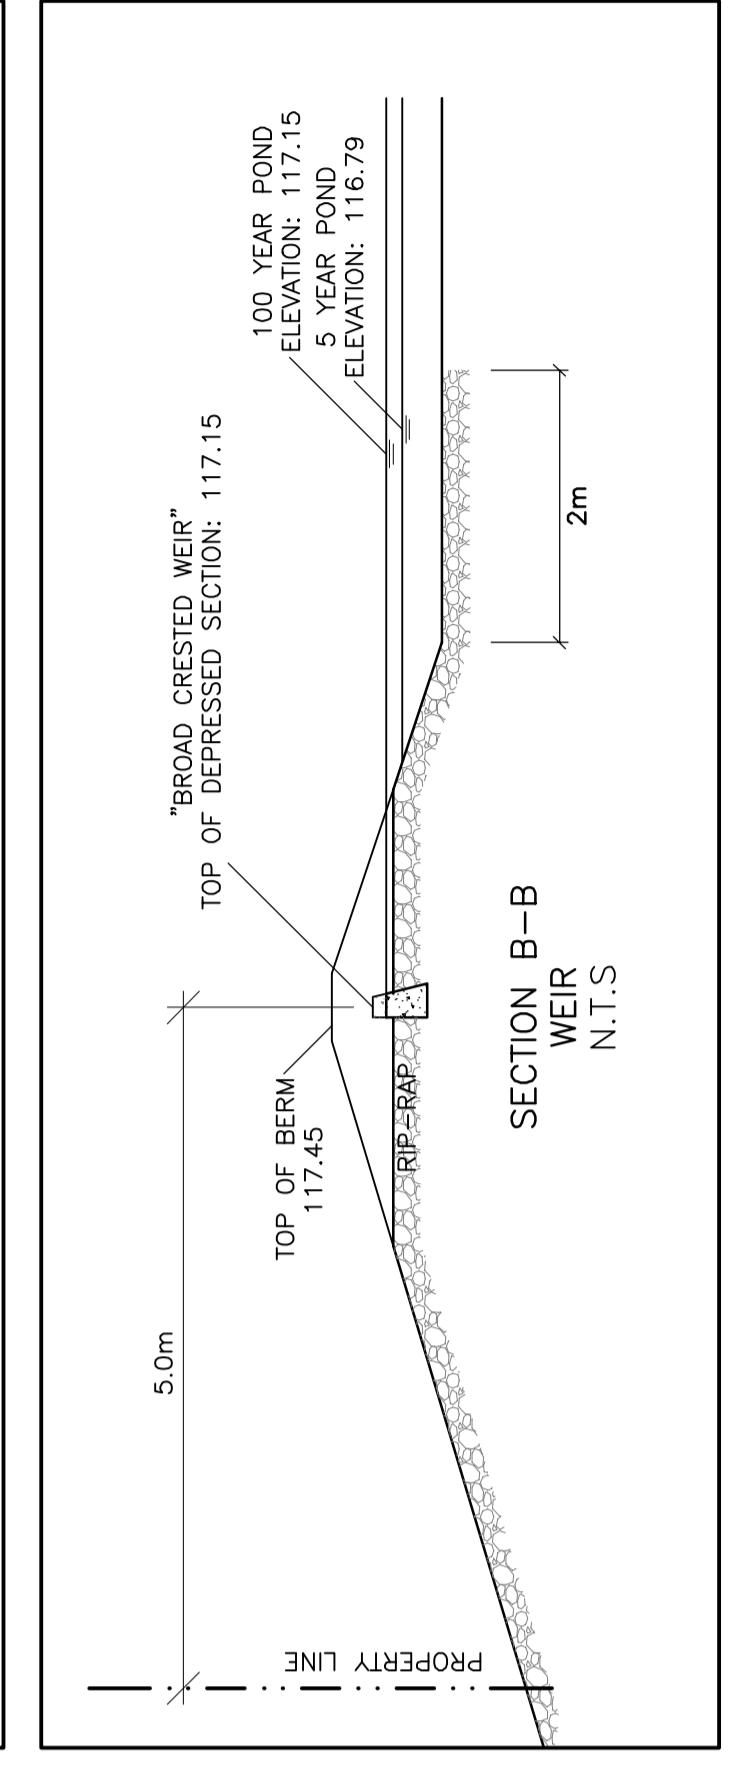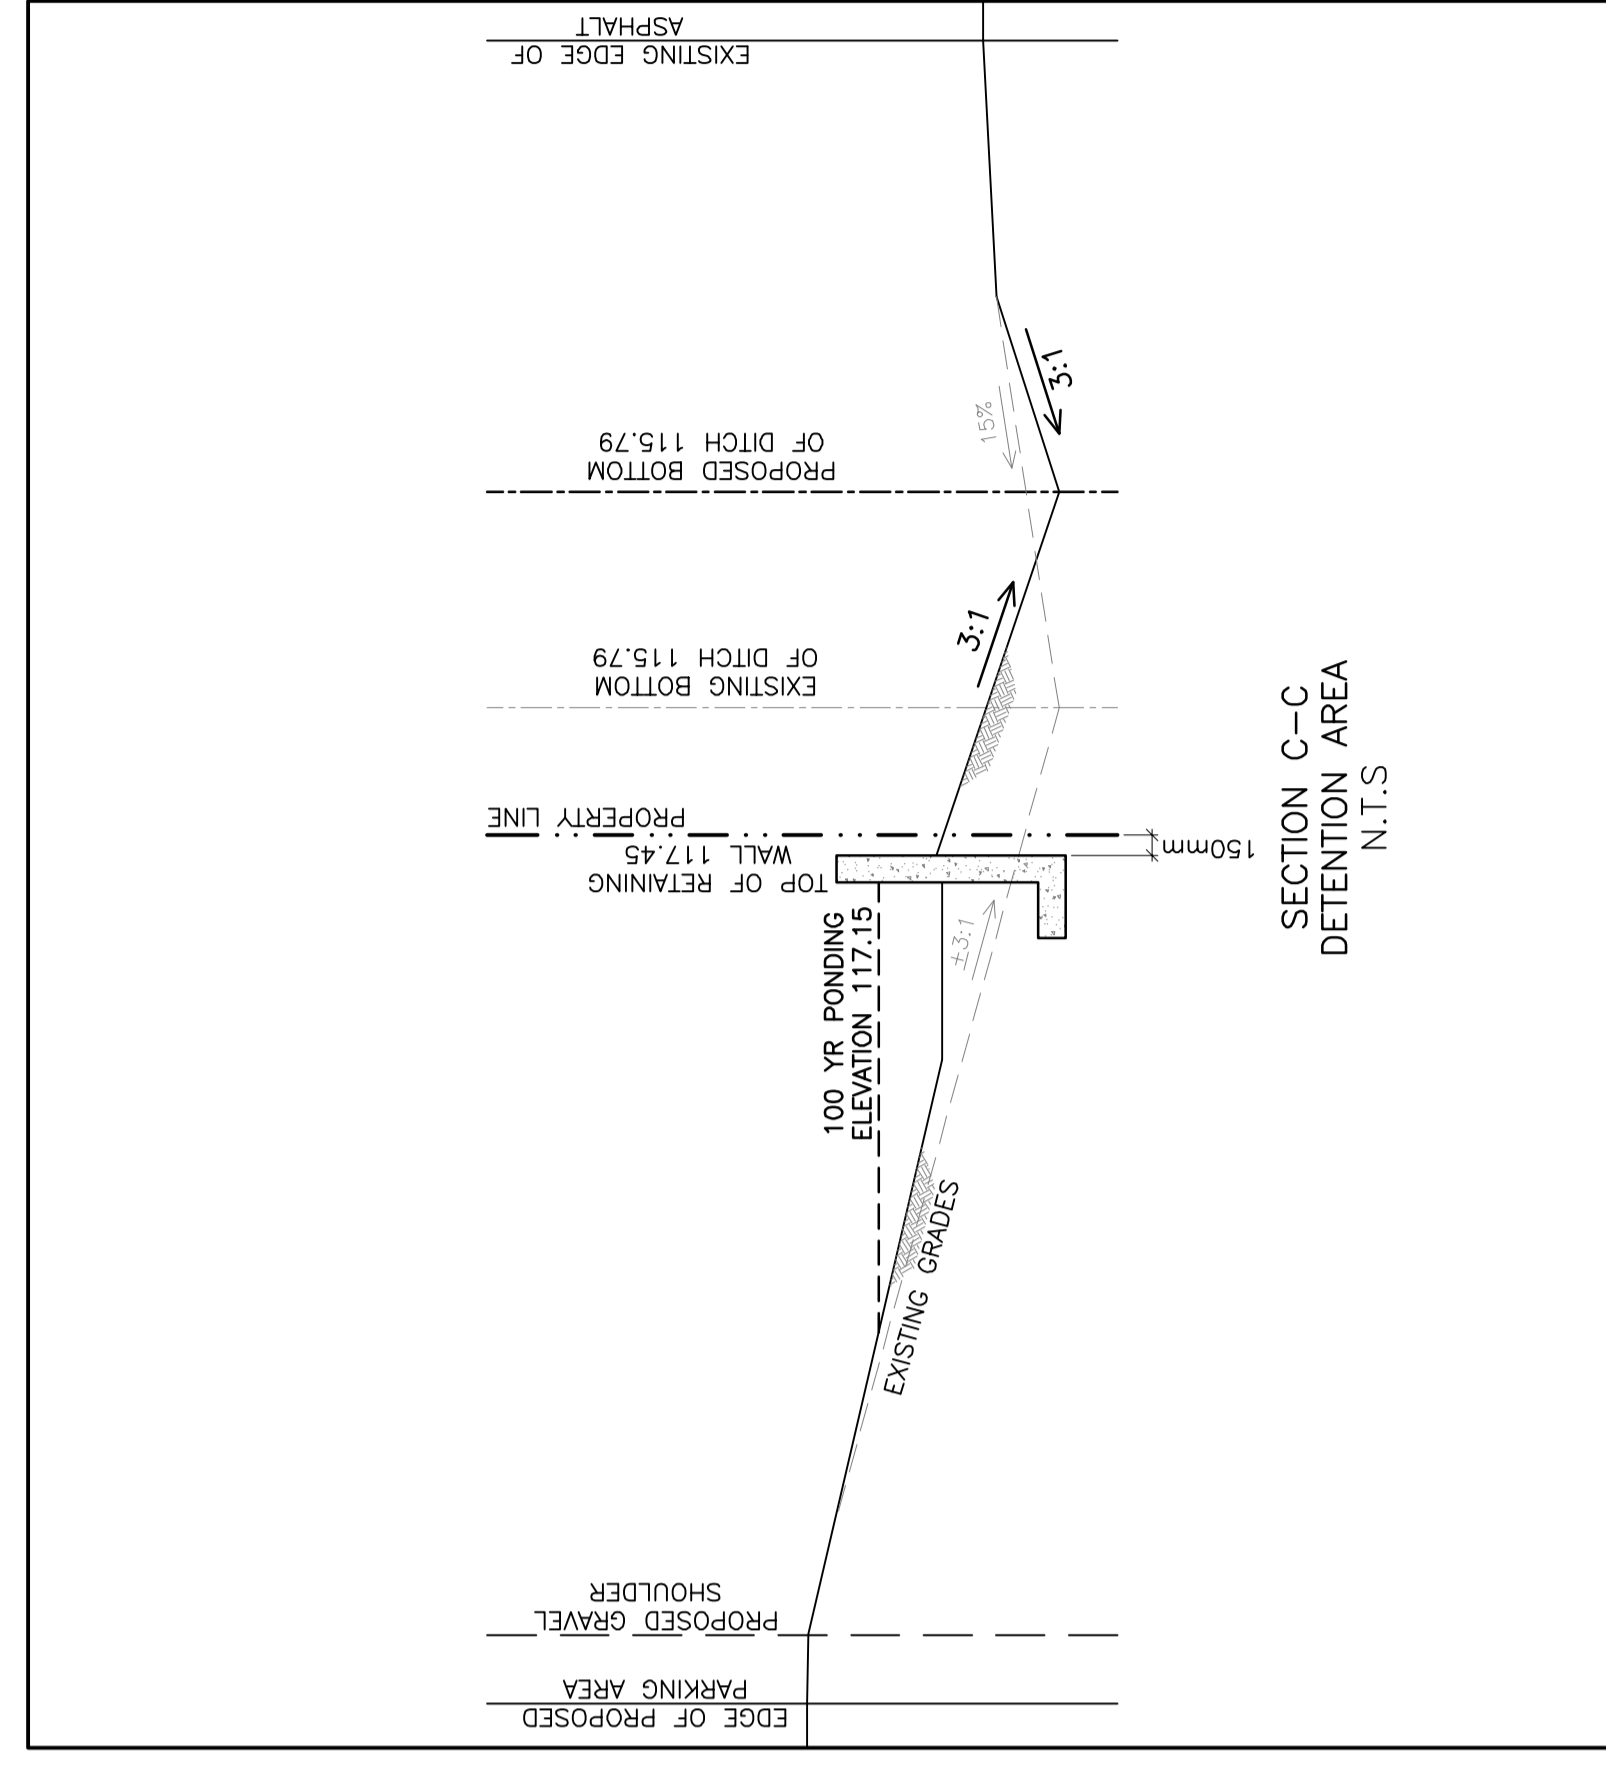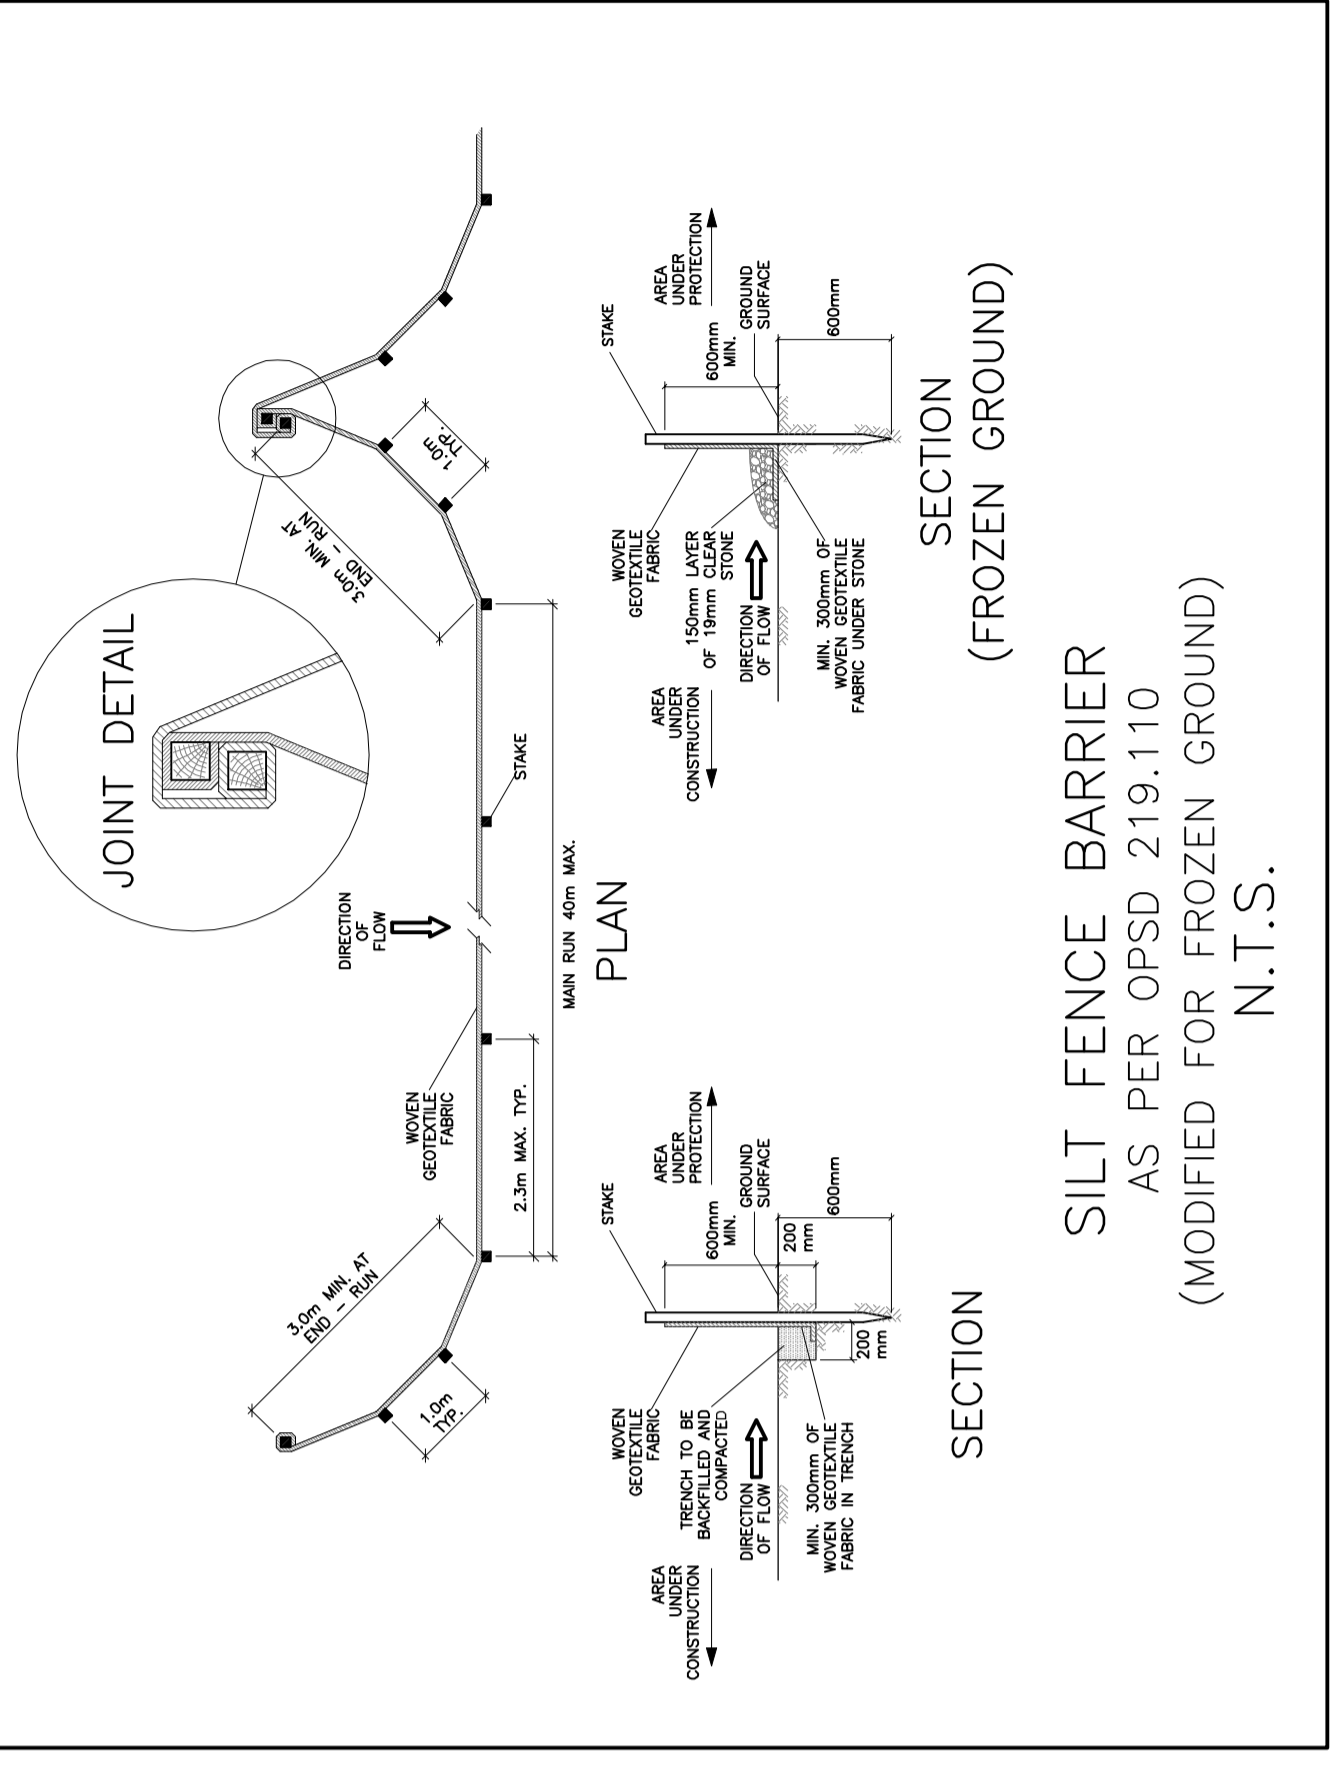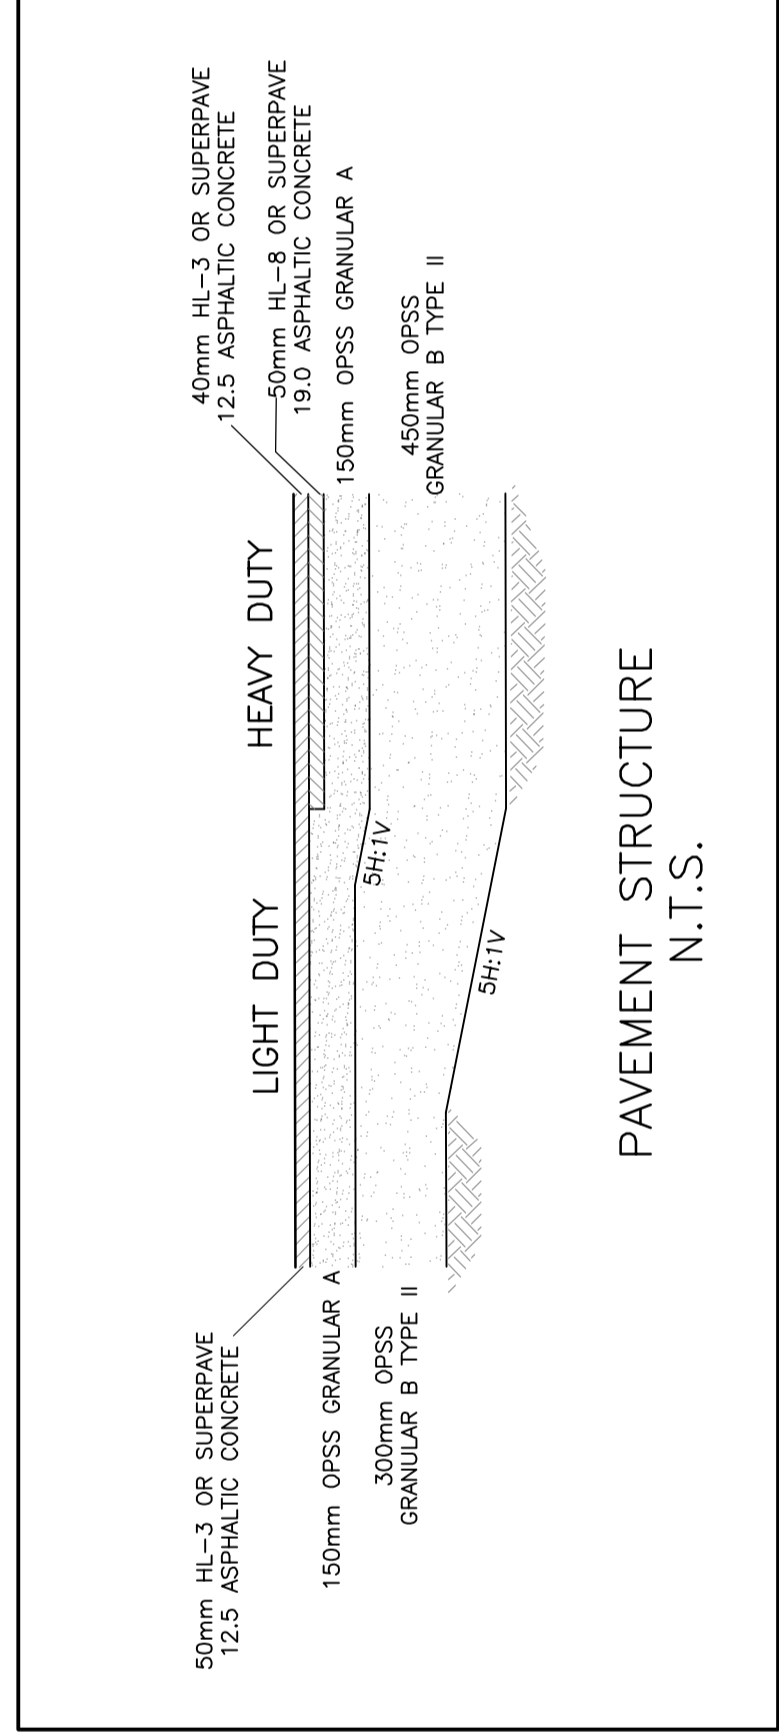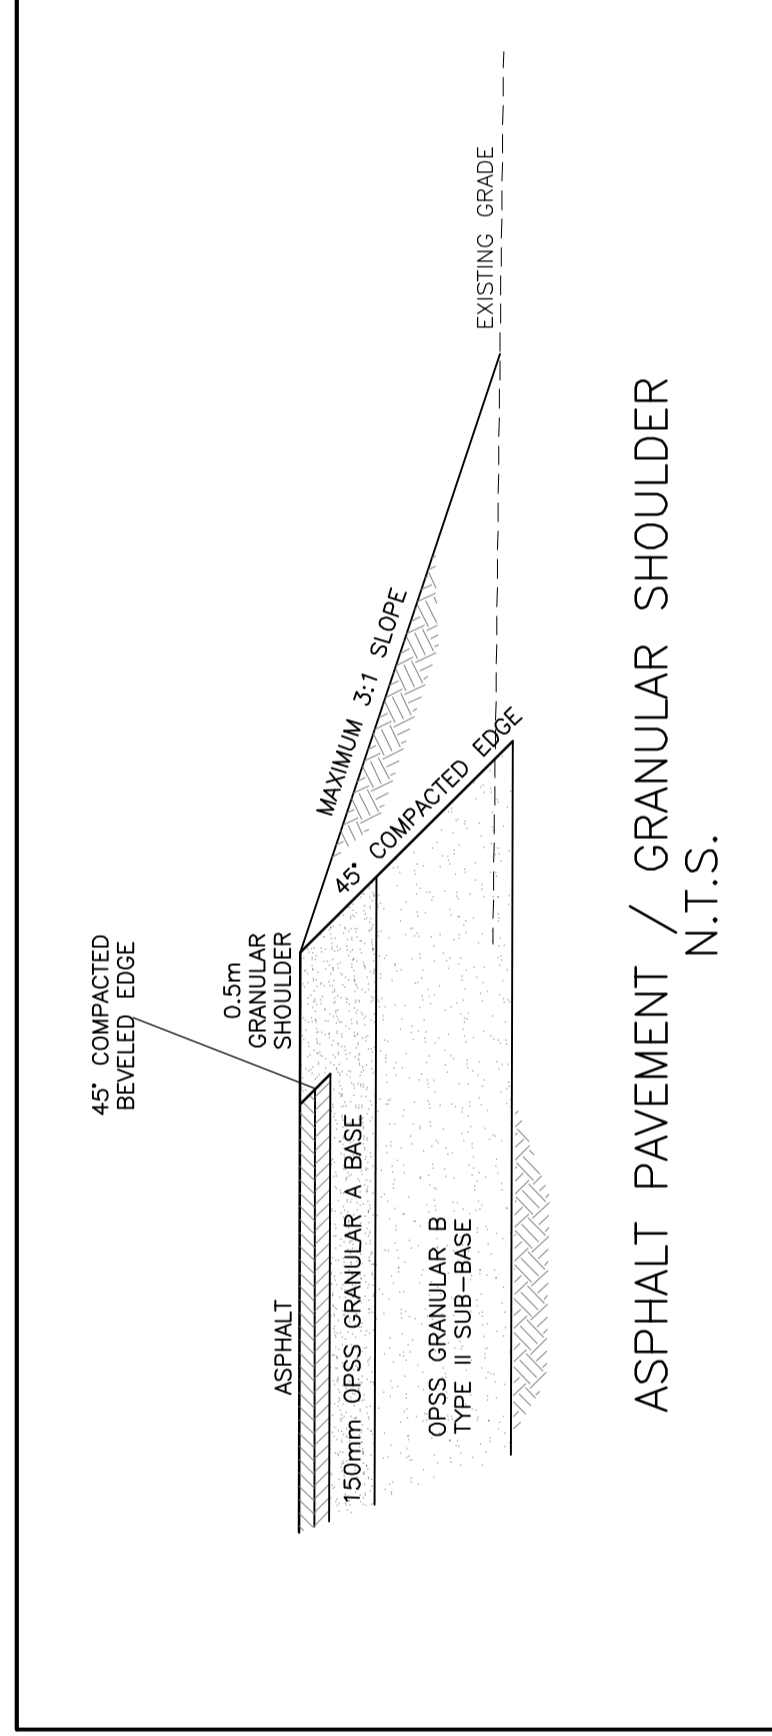

No.	DATE	REVISION
1	MAR 12-21	ISSUED FOR APPROVAL
2	JUN 14-21	RE-ISSUED FOR APPROVAL
3	JUL 26-21	RE-ISSUED FOR APPROVAL
4	APR 19-23	ISSUED FOR CLIENT REVIEW
5	JUN 23-23	ISSUED FOR COORDINATION
6	JUN 29-23	RE-ISSUED FOR APPROVAL
8	AUG 10-23	RE-ISSUED FOR APPROVAL

**D. B. GRAY ENGINEERING INC.**  
700 Long Point Circle  
Ottawa, Ontario  
613-425-8044  
dgray@dbgrayengineering.com

**OFFICE & WAREHOUSE  
2167 MCGEE SIDE ROAD  
OTTAWA, ONTARIO**

**DETAILS**

Engineer's Seal: D.B. GRAY, P. ENG., 17016502, AUG 10-23, PROVINCE OF ONTARIO

Drawn: O.B.G.  
Horz. Scale: 1:250  
Vert. Scale: N.T.S.  
Date: APR 19-23  
Rev. No.: 23024

Drawing No. **C-5** of **7**

NOT VALID UNLESS SIGNED & DATED