

# MEMORANDUM



**TO:** Dr. Ranjit Perera  
President Humanics Institute

**FROM:** Noah Chauvin, EIT. and  
James Fookes, P.Eng.

**PROJECT No.:** 210647100

**Subject:** Humanics Sanctuary & Sculpture Park- Ottawa  
Site Plan Development  
Stormwater Management Design Brief

**DATE:** November 22, 2021  
R1: April 28, 2023  
R2: August 16, 2023  
R3: September 28, 2023  
R4: October 03, 2023

X:\Proj\2021\210647100-Humanics Sanctuary Civil\08. Working\2. SWM

## 1 Introduction

This memorandum is part of the Site Plan application amendment for D07-12-16-0081, the memo gives an overview of the new stormwater management/drainage approach and measures for the development of 3400 Old Montreal Road, East of Ottawa. The proposed site development includes the 3 buildings, a pavilion and a lodge as well as an access route and parking areas. A site plan agreement based on an old Site Plan has been previously submitted and signed by the City of Ottawa.

**Figure 2** shows the proposed development and access roads/parking area locations and layout. Proposed stormwater management/drainage measures for the new development consists of a Low Impact Development (LID) Treatment Train Approach which includes a series of grass swales, vegetated filter strips, and a bioretention feature.

To provide a complete overview of the servicing of the new development, other new components include water servicing from an existing privately operated water well and a septic system, in addition to the enhanced grass swales.

## 2 Site Description

### 2.1 Existing Conditions

The site is located on the south side of Old Montreal Road, approximately 440 m west of Beckett's Creek Road as shown on **Figure 1**. The site is zoned Rural Residential 1. The municipal address of the proposed site is 3468 Old Montreal Road (PIN 145340141) and a portion of 3400 Old Montreal Road (PIN 145340140) in the City of Ottawa.

The site is primarily undeveloped with stone dust covered pathways and a number of stone sculptures. There are no permanent buildings on the site, however the owner is using a metal storage container for some landscaping equipment. The owner of the site has also constructed temporary gravel access roads to connect the site to Nirmala Drive and Old Montreal Road. These gravel roads were considered in the existing catchment runoff coefficients. The proposed site is bisected by a hydro corridor with overhead transmission lines mounted on wooden hydro poles which are found at two locations on the subject site. Surrounding properties consist of Old Montreal Road to the north of the property, vacant land to the south (which will become Cumberland Estates Phase 2), a residential property to the east, and vacant woodlots to the west.

### 3 Proposed Stormwater Management (SWM)

The overarching stormwater management strategy for the development of this site will maintain the existing drainage patterns to minimize the impacts to the Ravines which the site drains to today. To mitigate impact on these Ravines, Low Impact Development (LID) solutions such as enhanced grass swales and bioretention facilities for stormwater quality and quantity control are proposed.

The principles and methodologies of the Ministry of the Environment, Conservation and Parks (MECP) Stormwater Management Planning and Design Guidelines (2003) and Toronto Region Conservation Authority/Credit Valley Conservation Authority (TRCA/CVC) Low Impact Development Stormwater Management Planning and Design Guide (2010) were applied for the analysis and design of the drainage and SWM system.

### 4 Stormwater Approach and Criteria

#### 4.1 Quantity Control

For quantity control, the proposed stormwater management system will reduce the post-development peak flow to the pre-development runoff during storm events up to and including the 100-year event. This approach is consistent with the previous Stormwater Management study completed by EXP and was approved by the City of Ottawa. The required quantity control will be achieved by means of stormwater detention within the Bioretention Pond.

#### 4.2 Pre-Development Flows

A review of the topographic contours based on 2015 City of Ottawa LIDAR data was performed. LIDAR, or Light Detection and Ranging, is a remote sensing method of measuring distances (or ground surface elevation in this case) using lasers. The vertical accuracy of the LIDAR data provided by the City is reported as 8.6 centimeters. The topography of the site reveals that the natural ground slopes northerly towards a ravine located through the middle of the property with a watercourse running west to east. The southern section of the property is divided in two. The southernmost portion slopes towards the south boundary of the property to a smaller ravine located immediately to the south of the hydro corridor. The middle section flows towards the ravine running through the property. The larger deeper ravine has an approximate depth of 13.5m (49m - 62.5m), whereas the smaller shallower ravine is only 7.5m in depth (55m - 62.5m).

In its current condition, the site plan consists of both open fields and wooded areas. Stormwater runoff from the northern portion of the property currently drains in a southerly direction to the deeper ravine which flows from west to east and ultimately flows north to the Ottawa River. The flow path for the southern portion of the property is divided in two. The southernmost section flows down towards the shallower ravine which ultimately flows to Beckett's Creek. The mid-section flows to the north towards the deeper ravine. Both ravines are deeply incised in the landscape, with runoff from the development area being conveyed to two possible outlets denoted as North Outlet and South Outlet. The site is fairly self-contained and does not receive flows from the surrounding properties. Pre-development and post-development drainage conditions are illustrated in **Figures 1 and 2**.

As control of runoff to pre-development conditions is required, an estimation of peak flows prior to development was necessary. Although the Sanctuary Lands area is 7.52 hectares, only approximately 1.59 hectares is being developed. In order to compare the same pre-development and post-development drainage areas, the northern limit of drainage area was taken as the centre of the ravine, making the total area under consideration to be **3.85 hectares**. In accordance with the City of Ottawa's



Sewer Design Guidelines, the Rational Method was utilized for calculations of the pre-development runoff rates from drainage catchments. **Figure 2** illustrates the pre-development boundaries.

Catchment area OUT1 flow to the north ravine designated as the North Outlet. Catchment areas OUT2.1 and OUT2.2 flow to the south ravine designated as South Outlet.

Using rational method analysis of the existing catchment areas, the pre-development runoff coefficients as well as the pre-development flows during the 5-year and 100-year storm events were determined. Catchment area plans, which illustrate the existing drainage patterns, are included on **Figure 1**.

Total allowable release rate for the site will be **223.3 L/s for 5-year** and **478.4 L/s for 100-year**, this allowable rate is divided between the northern (OUT1) and southern (OUT2.1 & 2.2) outlets as per the below table.

Pre-development catchment parameters and peak flows are summarized in the table below with additional details in **Appendix A.2**.

Table 1 - Pre-Development Peak Flows

Drainage Area	Existing Condition	5-year		100-year	
	Area, A (ha)	Runoff Coefficient, R	Q (L/s)	Runoff Coefficient, R	Q (L/s)
OUT1	3.17	0.20	183.68	0.25	393.47
<b>North Outlet 1 Sub-Total</b>	<b>3.17</b>		<b>183.68</b>		<b>393.47</b>
OUT2.1	0.3248	0.20	18.82	0.25	40.31
OUT2.2	0.3594	0.20	20.82	0.25	44.60
<b>South Outlet 2 Sub-Total</b>	<b>0.68</b>		<b>39.64</b>		<b>84.91</b>
<b>Total</b>	<b>3.85</b>		<b>223.31</b>		<b>478.37</b>

## 5 Proposed Stormwater System

The proposed stormwater system consists of roadside swales, and culverts as a means to conveying stormwater to the bioretention pond, the flows to the ravines will be controlled to meet pre-development rates. The overall drainage patterns have remained wholly the same as shown on the proposed catchment area plan.

### 5.1 Post-Development Flows

The post-development catchment areas are illustrated in **Figure 2**.

Most of the North catchment area (A1.1 and A1.2) will stay draining uncontrolled to the existing north ravine, no significant changes in the northern pervious area are proposed as most of the development will be within the southern catchment area.

The South Catchment will include the proposed development (A2.1-A2.5) and the Hydro One easement (A2.6) which will be undisturbed. Runoff from the undisturbed area (A2.6) will be released uncontrolled to the southern existing ravine following the existing draining pattern. As for the development (A2.1-A2.5), it will be controlled through proposed swales adjacent to the access route conveying the captured storm water to the proposed Bioretention Pond.

The following table shows the post-development catchments areas, imperviousness and uncontrolled peak flows:

Table 2 - Post-Development Peak Flows (uncontrolled)

Drainage Area	Sub Area	Proposed Conditions	5-year		100-year	
		Area, A (ha)	Runoff Coefficient, R	Q (L/s)	Runoff Coefficient, R	Q (L/s)
	A1.1	2.22	0.20	129.4	0.25	277.3
	A1.2	0.23	0.45	30.6	0.57	65.6
<b>North Outfall 1 Sub-Total</b>		<b>2.45</b>		<b>160.1</b>		<b>342.9</b>
	A2.1	0.29	0.39	32.0	0.48	68.5
	A2.2	0.14	0.46	18.7	0.58	40.0
	A2.3	0.27	0.38	29.6	0.48	63.5
	A2.4	0.13	0.40	14.6	0.50	31.2
	A2.5	0.06	0.20	3.5	0.25	7.4
	A2.6	0.52	0.22	32.5	0.28	70.5
<b>South Outfall 2 Sub-Total</b>		<b>1.40</b>		<b>131.2</b>		<b>281.1</b>
<b>Total</b>		<b>3.85</b>		<b>291.3</b>		<b>624.0</b>

Complete post-development calculations are provided in **Appendix A.3**.

## 5.2 Post-Development Peak Flow Reduction and Storage

Considering the existing topography conditions, the site will be discharging to 2 outlets. The north of the site including most of the pre-development north catchment will drain to the same outlet as pre-development conditions. The south of site will include the development area and the rest of the south areas of the site.

Table 3 - Impact on Peak Flows – Uncontrolled

Drainage Area	5-year Pre-Development Flow	5-year Post-Development Flow	Difference	Percent Change	100-year Pre-Development Flow	100-year Post-Development Flow	Difference
	(L/s)	(L/s)	(L/s)	(%)	(L/s)	(L/s)	(L/s)
North Outlet	183.7	160.1	-23.6	-12.9%	393.5	342.9	-50.6
South Outlet	39.6	131.2	91.6	231.1%	84.9	281.1	196.2
<b>Total</b>	<b>223.3</b>	<b>291.3</b>	<b>68.0</b>	<b>30.4%</b>	<b>478.4</b>	<b>624.0</b>	<b>145.6</b>

According to the above table, the north outlet post-development calculated flows are **160.1 L/s for 5-year** and **342.9 L/s for 100-year**. These flows are reduced when compared to pre-development conditions, accordingly no stormwater management solution is needed.

For the south outfall, calculated uncontrolled post-development flows would be **131.2 L/s for 5-year** and **281.1 L/s for 100-year**, due to the site development. To control peak flows within this catchment area a Bioretention Pond is proposed. Catchments A2.1 to A2.5 will drain to the Pond. Due to site topography, Catchment A2.6 will drain uncontrolled. Catchment A2.6 has an area of **0.52 hectares**

resulting in an uncontrolled flow of **32.9 L/s for 5-year** and **70.5 L/s for 100-yr**. As such, the maximum allowable release rate from the Bioretention Pond is **6.7 L/s for 5-year** and **14.4 l/s for 100-year**.

Analysis of the pre- and post-development flows shows that the different in flows for different return periods (5-year & 100-year) requires a storage of **91.8 cubic meters for 5 years** and **199.0 cubic meters for 100 years**. (Note that slight over-control of the 100-year event was found to be necessary to maintain the peak 5-year run-off within the allowable release rate, using a single orifice). The full storage analysis can be found in **Appendix A.4**.

With the proposed storage, peak flows to the South Outlet will be reduced as follows:

*Table 4 - Impact on Peak Flows - Controlled*

Drainage Area	5-year Pre-Development Flow	5-year Post-Development Flow	Difference	Percent Change	100-year Pre-Development Flow	100-year Post-Development Flow	Difference
	(L/s)	(L/s)	(L/s)	(%)	(L/s)	(L/s)	(L/s)
North Outlet	183.7	160.1	-23.6	-12.9%	393.5	342.9	-50.6
South Outlet	39.6	38.8	-0.8	-2.0%	84.9	82.1	-2.8
<b>Total</b>	<b>223.3</b>	<b>198.9</b>	<b>-24.4</b>	<b>-10.9%</b>	<b>478.4</b>	<b>425.0</b>	<b>-53.4</b>

## 6 Stormwater Quality Control

Stormwater quality protection has been designed to meet the MECP's "Enhanced" standard of 80% Total Suspended Solids (TSS) removal rate prior to discharge to the Ravines.

### 6.1 Infiltration

A Low Impact Development approach will be taken for this development due to the nature of the site and soil conditions. The SWM design will rely on infiltration to achieve the required quality criteria for this design. To have the information to proceed with this approach an infiltration test was done in site and report was prepared, this report includes design infiltration rates to be used specifically for this site. Refer to the Memo in Appendix for Infiltration Testing. The report used the 2800K1 Guelph Permeameter to provide the design infiltration rate that varies from 52 to 29 mm/hr can be used. Complete results of the infiltration testing are provided in **Appendix B**.

The design of the Bio-retention Pond is to be as per MECP requirements, and the bottom of pond will be minimum 1m above the high groundwater. The bottom of Pond is **61.60 m**. Based on the geotechnical report prepared by EXP, the current **groundwater** in the area is approximately **58.0 m** which meets the requirements for MECP.

In accordance with TRCA SWM Criteria (2010), Section 7.4: "As a minimum, to achieve the enhance level of water quality control, the LID practice must be sized to provide storage for a minimum 5mm of rainfall."

As mentioned previously the site presented very suitable conditions for LID approach, this was done through proposing side swales that conveys water to a proposed Bioretention pond, this pond will provide the enhanced treatment required for this site. The proposed Bioretention pond will be designed

to retain a minimum of the first **10mm** of stormwater, this is equivalent to **35.4** cubic meters of water that will need to be infiltrated to the soil.

The proposed Bioretention cross section has a **2.60m** wide flat bottom with **3H:1V** side slopes, the elevation of the bottom is at **61.60m** and the spill elevation is at **62.15m**. The 100-year water level in the pond is **62.15m** with a freeboard of **0.3m** between the 100-yr / spill elevation and the adjacent roadway/parking lot. The swale has a length of **90m**. The proposed Bioretention swale can capture a volume up to **210 cubic meters**. To provide the required retention, a **200 mm** diameter outlet pipe equipped with a **102 mm** orifice ICD is proposed at an upstream invert elevation of **61.77m**. A volume of **47.6 cubic meters** will be retained in the Bioretention pond below the orifice invert, and an expected time of infiltration will be **4.4 hrs** with a rate of **39 mm/hr**. For more detailed calculation refer to **Appendix A.5 and A.6**. A detailed cross section of the proposed bioretention pond is presented in **Figure 3**.

Analysis for the entire site was done based on the drainage area and hourly precipitation data (excluding winter months) to establish overflow volume based on measured historical data. Infiltration at source (through runoff coefficient) and in the bioretention facility were calculated at hourly intervals, with the volume of water in the bioretention facility tracked to enable the volume of water lost to overflows to be calculated. The following tables provide summaries for each year analyzed. **Table 5** indicates that the bioretention facility can be expected to infiltrate a minimum of 89% (and potentially 90%+ depending on rainfall patterns) of run-off that reaches it. **Table 6** demonstrates that over 82% of all rain falling on the overall site is expected to infiltrate into the soil, either at source or from the bioretention facility, meeting the requirement for 'enhanced' quality control.

*Table 5 - Anticipated Infiltration Volumes for Controlled Catchments based on Historical Rainfall Data*


Year	Total rain (mm)	Runoff from catchments draining to bioretention (m <sup>3</sup> )	Infiltration in bioretention (m <sup>3</sup> )	Released Volume (m <sup>3</sup> )	Infiltration of runoff reaching bioretention %
2016	614	2083	1859	224	89%
2017	925	3140	2952	188	94%
2018	659	2236	2016	220	90%
2019	627	2130	2081	49	98%
2020	586	1990	1946	44	98%

*Note: Analysis excludes winter months (Jan - Apr). Winter conditions were excluded from the calculation as it is not possible to identify and model snow, winter rainfall and snow melt with accuracy. Instead, as is common practice, the analysis was completed for the spring, summer and fall period to provide a more accurate representation of the expected percentage of rainfall that will be infiltrated.*



Table 6 - Total Rain Infiltration on Site

Year	Total rain (mm)		Rain Infiltrated at Source - Run-off Coefficient			Rain Infiltrated in Bioretention (cu.m)	Total Rain Infiltrated (cu.m)	Percentage of Rain Infiltrated on Site (%)
			OUT1 (cu.m)	OUT2 A2.6 (uncontrolled) (cu.m)	OUT2 (bioretention) (cu.m)			
	(mm)	(cu.m)	(cu.m)	(cu.m)	(cu.m)	(cu.m)	(cu.m)	(%)
2016	614	23627	11393	2441	3712	1859	19405	82%
2017	925	35609	17170	3679	5594	2952	29395	83%
2018	659	25360	12228	2620	3984	2016	20849	82%
2019	627	24155	11647	2496	3795	2081	20018	83%
2020	586	22573	10884	2332	3546	1946	18708	83%

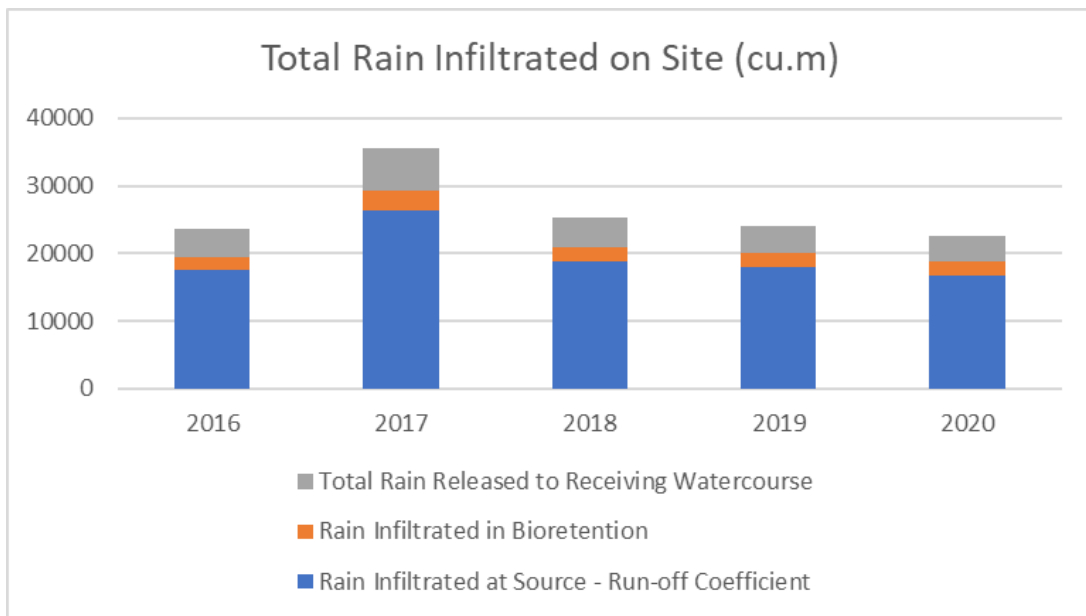

## 7 Erosion and Sediment Control during Construction

The contractor shall implement best management practices to provide for protection of the area drainage system and the receiving watercourses during construction activities, as per the Erosion and Sediment Control Plans included on the design drawings. Refer to Drawing ESC-PH1B prepared by EXP for proposed ESC measures for the site.

## 8 Conclusions

In conclusion the stormwater management design meets all required servicing constraints and associated design criteria/requirements.


Sincerely,

Morrison Hershfield Limited

---

James Fookes, P.Eng.

Civil Engineer

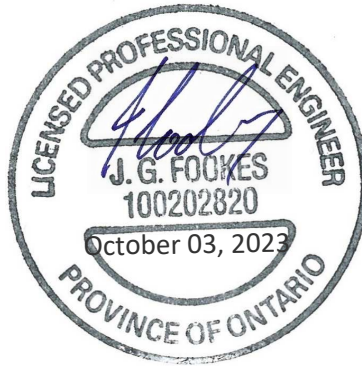



**Figures**


- Figure 1 Existing Catchments
- Figure 2 Proposed Catchments
- Figure 3 Stormwater Management Details

**Attachments**

- Appendix A Stormwater Management Calculations
- Appendix B Infiltration Testing Memorandum




2023-Aug-16 11:27:36 PM X:\Proj\2021\10647100-Humanics Sanctuary Civil\09\_CAD\07\_Sheets\Existing Catchments.dwg

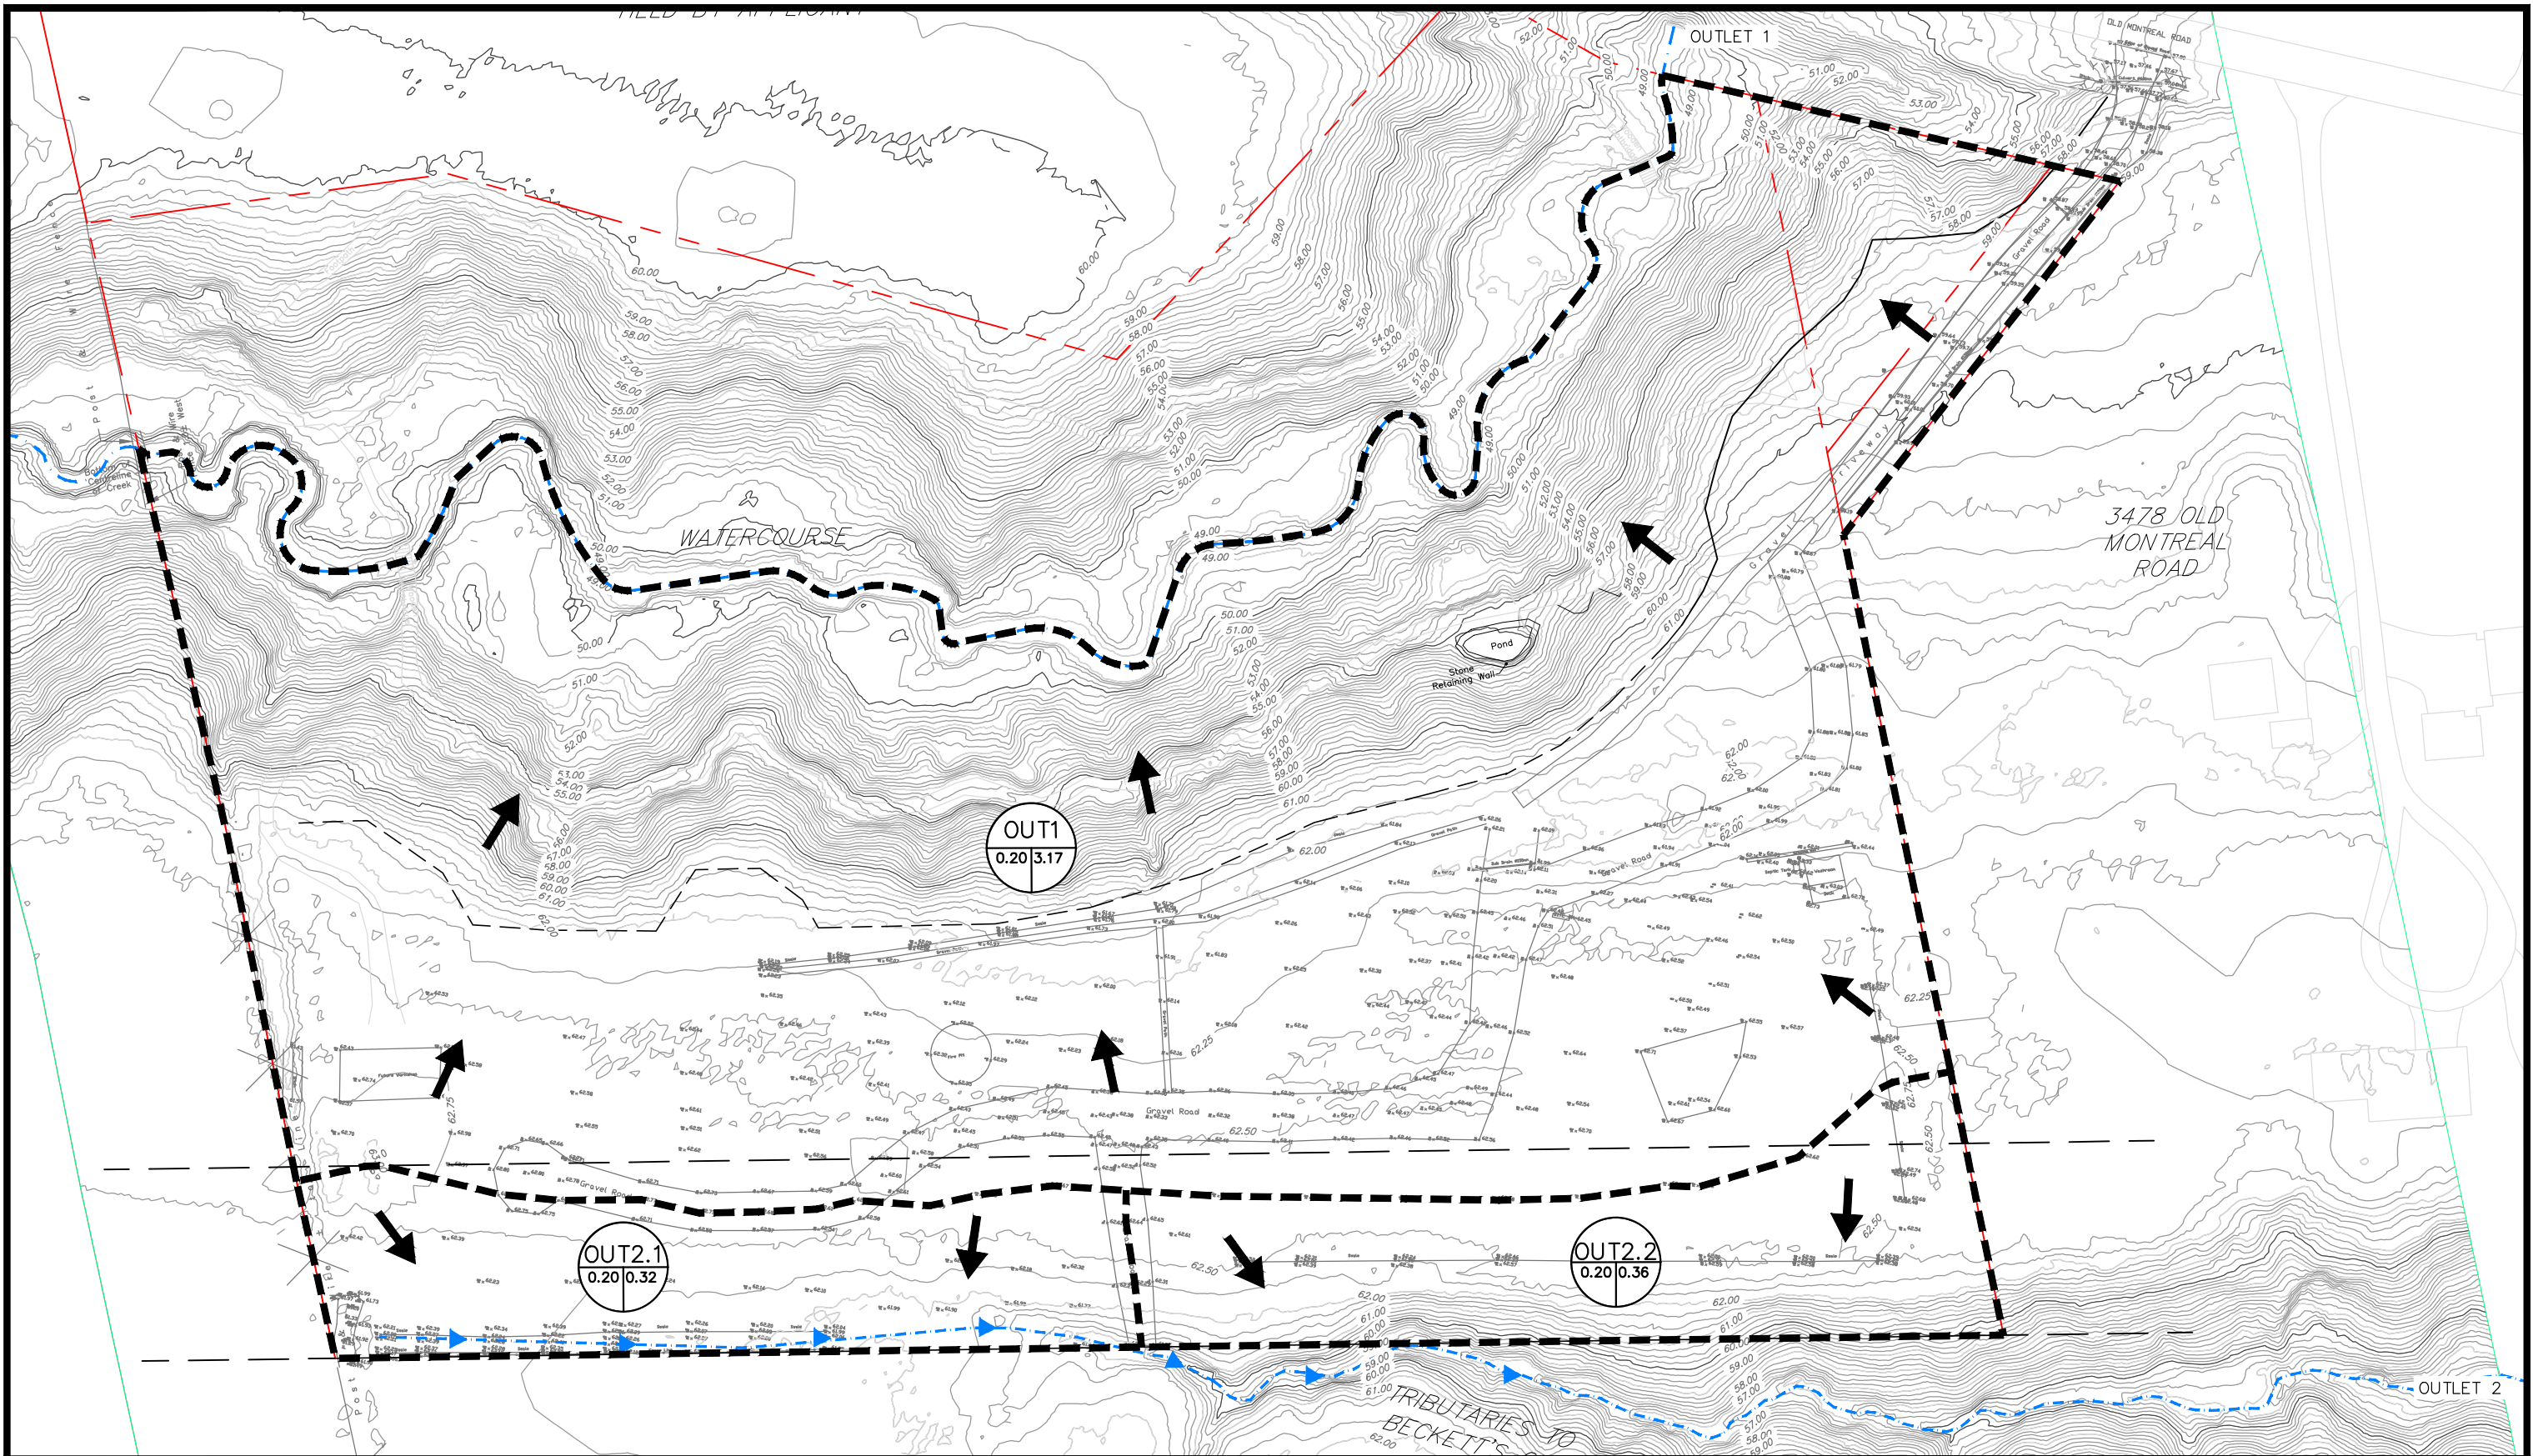

### HUMANICS SANCTUARY EXISTING STORM DRAINAGE AREA PLAN


#### LEGEND

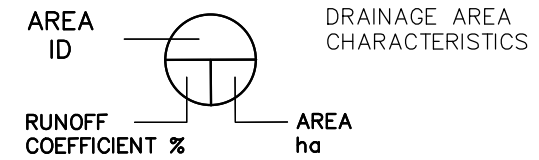

### FIGURE 1

DATE: 2023-08-16  
SCALE: N.T.S.

2023-Oct-04 9:01:04 AM X:\Proj\2021\1210647100-Humanics Sanctuary Civil\09\_CAD\07 Sheets\Proposed Catchments-NC.dwg

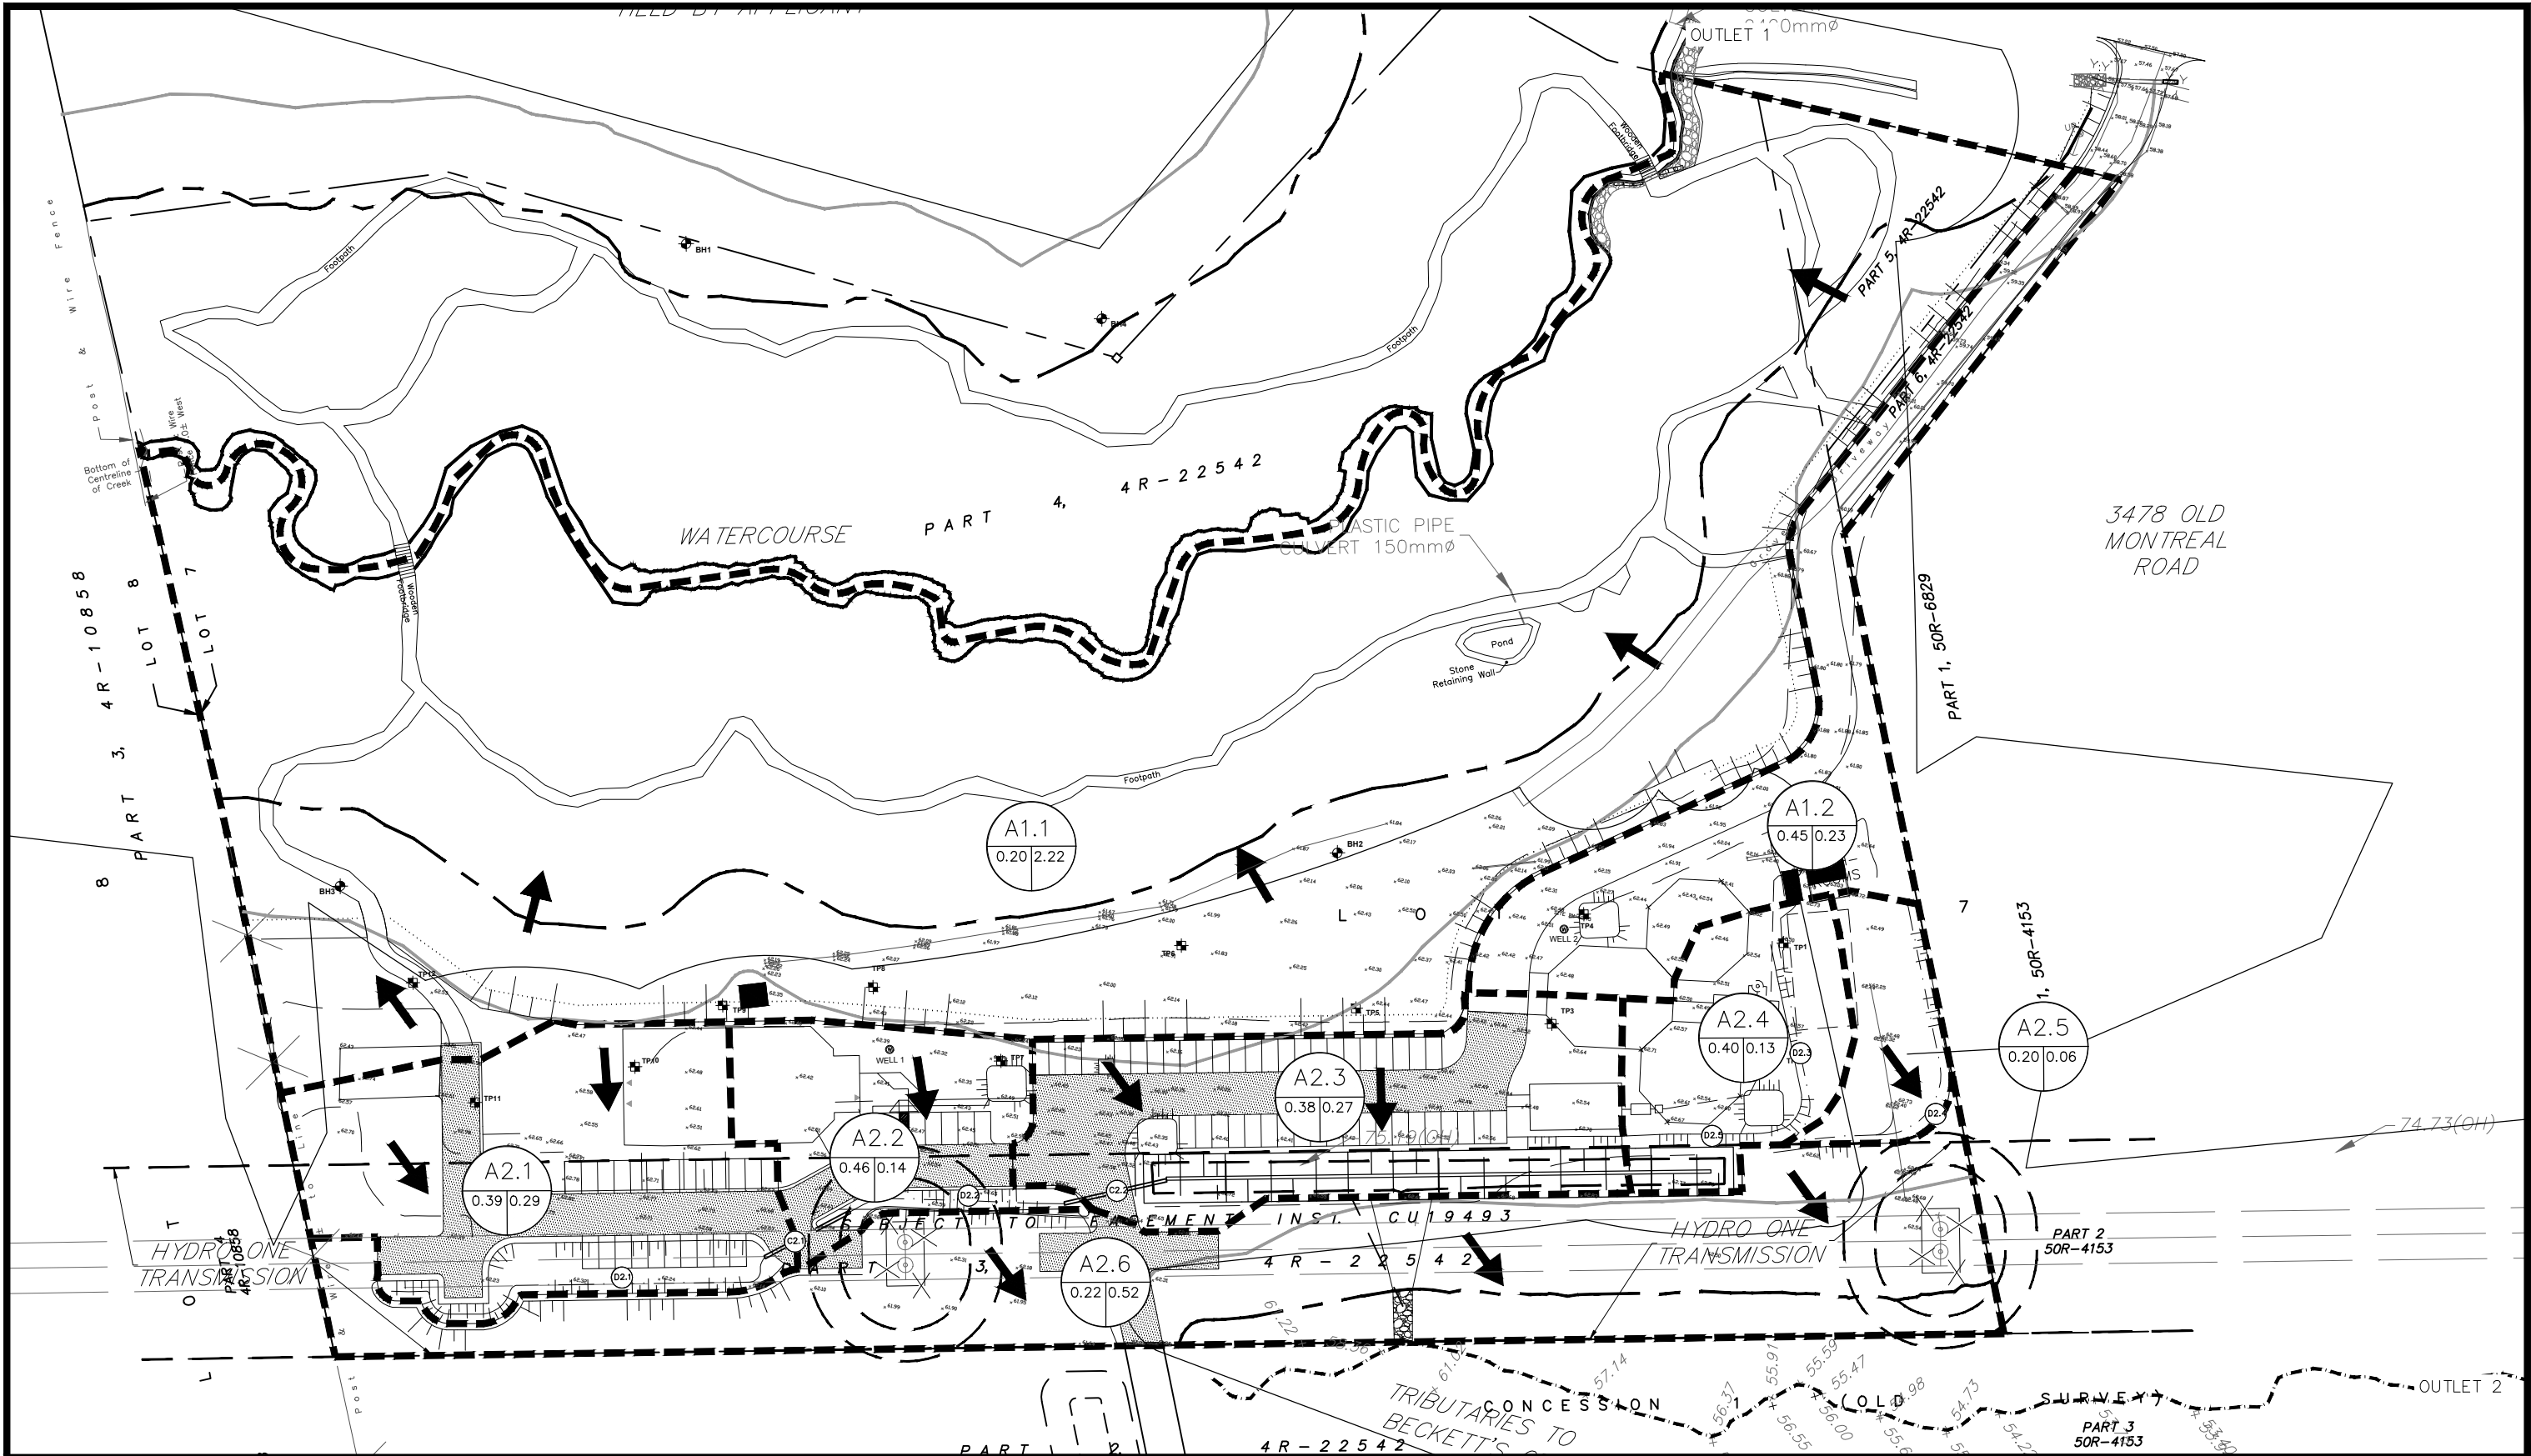

## HUMANICS SANCTUARY PROPOSED STORM DRAINAGE AREA PLAN


### LEGEND

AREA ID		DRAINAGE AREA CHARACTERISTICS
RUNOFF COEFFICIENT %		AREA ha

## FIGURE 2

DATE: 2023-09-28

SCALE: N.T.S.

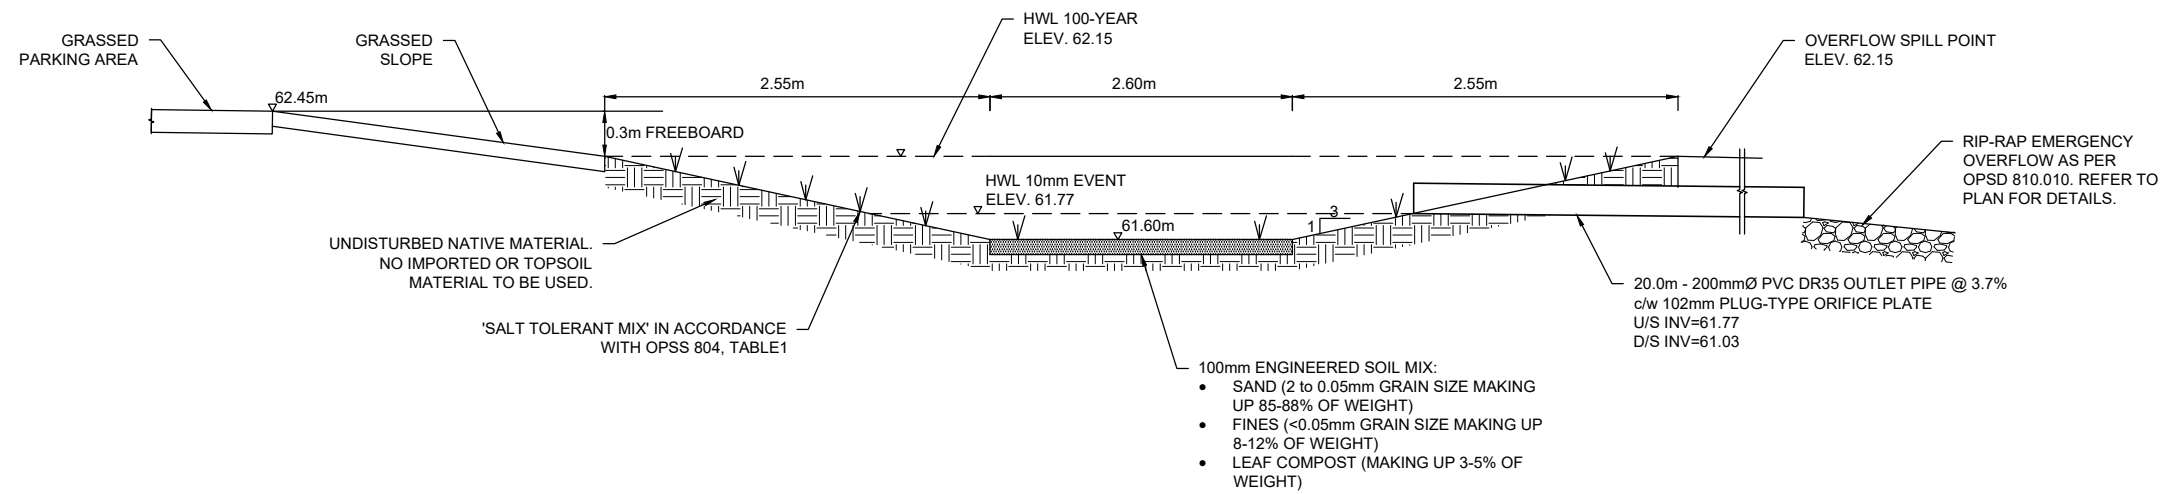

1 BIORETENTION POND CROSS SECTION  
NTS

**Figures**

- Figure 1 Existing Catchments
- Figure 2 Proposed Catchments
- Figure 3 Stormwater Management Details

**Attachments**

- Appendix A Stormwater Management Calculations
- Appendix B Infiltration Testing Memorandum



## **Appendix A**

---

# **Stormwater Management Calculations**



## A.1. Stormwater Management Summary

Humanics Centre, Ottawa, Ontario

Project No.	210647100
Date:	03/10/2023
Prepared By:	N Chauvin
Check By:	J Fookes

### Impact of Development on Drainage Areas

Drainage Area	Pre-development				Post-development			
	Area (ha)	Imp.	Imp Area (ha)	Runoff Coefficient, R	Area (ha)	Imp.	Imp. Area (ha)	Runoff Coefficient, R
North Outlet (OUT1)	3.17	0%	0.00	0.20	2.45	6%	0.15	0.23
South Outlet (OUT2)	0.68	0%	0.00	0.22	1.40	24%	0.33	0.32
<b>Total</b>	<b>3.85</b>	<b>0%</b>	<b>0.00</b>	<b>0.20</b>	<b>3.85</b>	<b>13%</b>	<b>0.49</b>	<b>0.26</b>

### Impact on Peak Flows (Uncontrolled)

Drainage Area	5-year Pre-Development Flow (L/s)	5-year Post-Development Flow (L/s)	Difference (L/s)	Percent Change (%)	100-year Pre-Development Flow (L/s)	100-year Post-Development Flow (L/s)	Difference (L/s)	Percent Change (%)
North Outlet (OUT1)	183.7	160.1	-23.6	-12.9%	393.5	342.9	-50.6	-12.9%
South Outlet (OUT2)	39.6	131.2	91.6	231.1%	84.9	281.1	196.2	231.1%
<b>Total</b>	<b>223.3</b>	<b>291.3</b>	<b>68.0</b>	<b>30.4%</b>	<b>478.4</b>	<b>624.0</b>	<b>145.6</b>	<b>30.4%</b>

### Impact on Peak Flows (With Proposed Controls)

Drainage Area	5-year Pre-Development Flow (L/s)	5-year Post-Development Flow (L/s)	Difference (L/s)	Percent Change (%)	100-year Pre-Development Flow (L/s)	100-year Post-Development Flow (L/s)	Difference (L/s)	Percent Change (%)
North Outlet (OUT1)	183.7	160.1	-23.6	-12.9%	393.5	342.9	-50.6	-12.9%
South Outlet (OUT2)	39.6	38.8	-0.8	-2.0%	84.9	82.1	-2.8	-3.3%
<b>Total</b>	<b>223.3</b>	<b>198.9</b>	<b>-24.4</b>	<b>-10.9%</b>	<b>478.4</b>	<b>425.0</b>	<b>-53.4</b>	<b>-11.2%</b>

## A.2. Pre Development Peak Flows

Humanics Centre, Ottawa, Ontario

Project No.	210647100
Date:	03/10/2023
Prepared By:	N Chauvin
Check By:	J Fookes

### Rational Method

Q = RAIN, where

Q = Peak runoff flow (L/s)	Woodland Area:	R = 0.30
R = Runoff coefficient	Lawn Area:	R = 0.20
A = Area (ha)	Building Area:	R = 0.90
I = Rainfall intensity (mm/hr)	Gravel Area:	R = 0.60
N = 2.78	Water Area:	R = 1.00


### Existing Drainage Area Characteristics

Drainage Area	Existing Conditions				
	Area, A (ha)	Pervious Area (ha)	Impervious Area (ha)	Imp.	Runoff Coefficient, R
OUT1	3.17	3.17		0%	0.20
OUT2.1	0.32	0.32		0%	0.20
OUT2.2	0.36	0.36		0%	0.20
<b>Total</b>	<b>3.85</b>	<b>3.85</b>	<b>0.00</b>	<b>0%</b>	<b>0.20</b>

### Existing Peak Flows

Where 
$$i = \frac{A}{(T_d + C)^B}$$

Calculation of Time of Concentration, using the Uplands Method (SCS National Engineering Handbook, 1971)

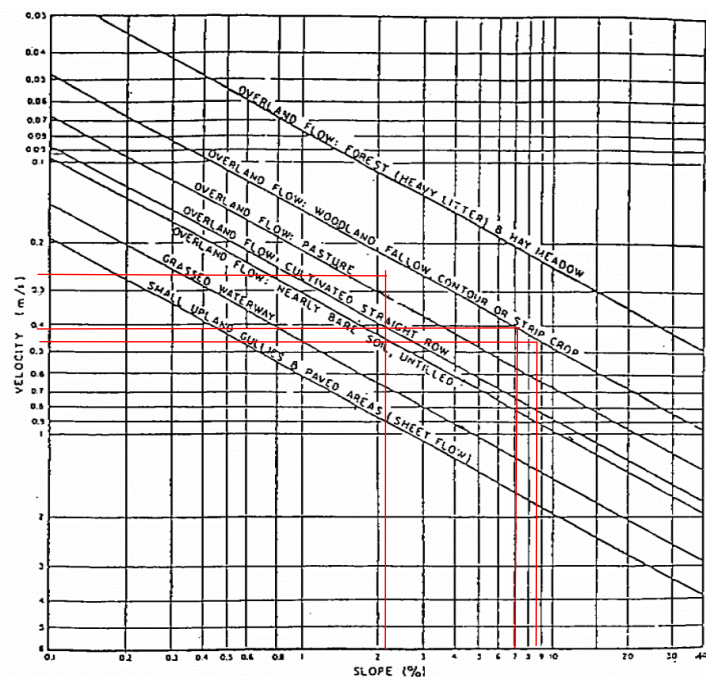

Drainage Area	Runoff Coefficient, R	Length, L (m)	Average Slope, S <sub>w</sub> (%)	Velocity (m/s)	Time of Concentration, T <sub>c</sub>
OUT1	0.20	143	9.5	0.47	5.07
OUT2.1	0.20	22.6	3.00	0.42	0.90
OUT2.2	0.20	24.8	7.2	0.27	1.53

Drainage Area	Existing Conditions		5-year			100-year		
	Area, A (ha)	Time of Concentration (Note 1)	I (mm/hr)	Runoff Coefficient, R	Q (L/s)	I (mm/hr)	Runoff Coefficient, R (Note 2)	Q (L/s)
OUT1	3.17	10.00	104.2	0.20	183.68	178.6	0.25	393.47
<b>Outlet 1 Sub-Total</b>	<b>3.17</b>				<b>183.68</b>	<b>178.6</b>		<b>393.47</b>
OUT2.1	0.3248	10.00	104.2	0.20	18.82	178.6	0.25	40.31
OUT2.2	0.3594	10.00	104.2	0.20	20.82	178.6	0.25	44.60
<b>Outlet 2 Sub-Total</b>	<b>0.68</b>				<b>39.64</b>			<b>84.91</b>
<b>Total</b>	<b>3.85</b>				<b>223.31</b>			<b>478.37</b>

Note 1: A minimum time of concentration of 10 mins was taken

Note 2: For 100-year event, Runoff Coefficient is increased by 25% to a maximum of 1.0.



**A.3. Post Development Peak Flows**  
Humanics Centre, Ottawa, Ontario

Project No.	210647100
Date:	03/10/2023
Prepared By:	N Chauvin
Check By:	J Fookes

<b>Rational Method</b>			
Q = RAIN, where			
Q =	Peak runoff flow (L/s)	Woodland Area:	R = 0.30
R =	Runoff coefficient	Lawn Area:	R = 0.20
A =	Area (ha)	Building Area:	R = 0.90
I =	Rainfall intensity (mm/hr)	Gravel Area:	R = 0.60
N =	2.78	Water Area:	R = 1.00


**Proposed Drainage Area Characteristics**

Drainage Area	Sub Area	Proposed Conditions						
		Area, A (ha)	Pervious Area (ha)	Gravel	Building	Impervious Area (ha)	Imp.	Runoff Coefficient, R
OUT1		2.45	2.30			0.15	6%	0.23
	A1.1	2.22	2.22		0.01	0.01	0%	0.20
	A1.2	0.23	0.08	0.12	0.03	0.15	64%	0.45
OUT2		1.40	1.06			0.33	24%	0.32
	A2.1	0.29	0.18	0.07	0.04	0.10	36%	0.39
	A2.2	0.14	0.08	0.03	0.04	0.06	46%	0.46
	A2.3	0.27	0.16	0.08	0.02	0.11	39%	0.38
	A2.4	0.13	0.09		0.04	0.04	28%	0.40
	A2.5	0.06	0.06			0.00	0%	0.20
	A2.6	0.52	0.49	0.03		0.03	5%	0.22
<b>Total</b>		<b>3.85</b>	<b>3.37</b>			<b>0.49</b>	<b>13%</b>	<b>0.26</b>

**Proposed Peak Flows (Uncontrolled)**

Where 
$$i = \frac{A}{(T_d + C)^B}$$

Calculation of Time of Concentration, using the Uplands Method (SCS National Engineering Handbook, 1971)

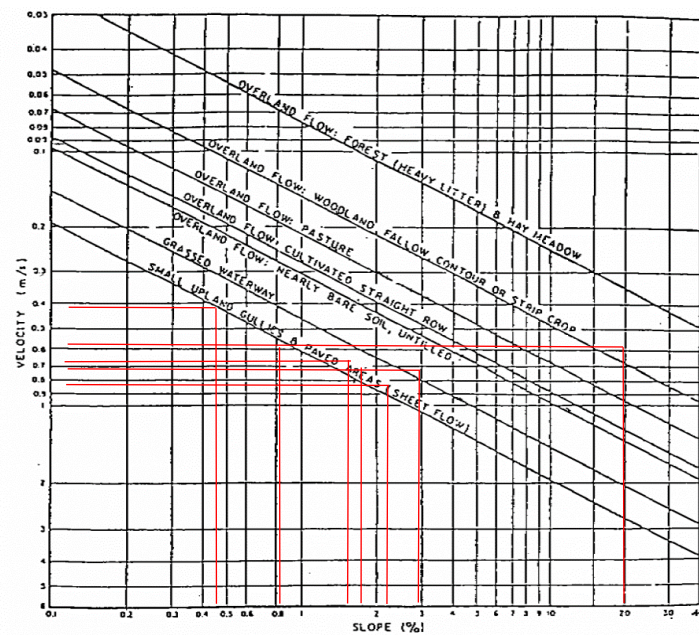

Drainage Area	Runoff Coefficient, R	Length, L (m)	Average Slope, S <sub>w</sub> (%)	Area, A	Velocity (m/s)	Time of Concentration, T <sub>c</sub>
A1.1	0.20	83.00	17.00	2.22	0.6	2.31
A1.2	0.45	175.00	2.70	0.23	0.75	3.89
A2.1	0.39	93.00	1.30	0.29	0.7	2.21
A2.2	0.46	32.00	2.00	0.14	0.88	0.61
A2.3	0.38	30.00	1.50	0.27	0.75	0.67
A2.4	0.40	60.00	1.00	0.13	0.6	1.67
A2.5	0.20	60.00	0.50	0.06	0.38	2.63
A2.6	0.22	23.00	1.60	0.52	0.75	0.51

Drainage Area	Sub Area	Proposed Conditions		5-year (Uncontrolled)			100-year (Uncontrolled)		
		Area, A (ha)	Time of Concentration (Note 1)	I (mm/hr)	Runoff Coefficient, R	Q (L/s)	I (mm/hr)	Runoff Coefficient, R (Note 2)	Q (L/s)
	A1.1	2.22	10.00	104.19	0.20	129.4	178.56	0.25	277.3
	A1.2	0.23	10.00	104.19	0.45	30.6	178.6	0.57	65.6
<b>Outlet 1 Sub-Total</b>		<b>2.45</b>				<b>160.1</b>			<b>342.9</b>
	A2.1	0.29	10.00	104.19	0.39	32.0	178.6	0.48	68.5
	A2.2	0.14	10.00	104.19	0.46	18.7	178.6	0.58	40.0
	A2.3	0.27	10.00	104.19	0.38	29.6	178.6	0.48	63.5
	A2.4	0.13	10.00	104.19	0.40	14.6	178.6	0.50	31.2
	A2.5	0.06	10.00	104.19	0.20	3.5	178.6	0.25	7.4
	A2.6	0.52	10.00	104.19	0.22	32.9	178.6	0.28	70.5
<b>Outlet 2 Sub-Total</b>		<b>1.40</b>				<b>131.2</b>			<b>281.1</b>
<b>Total</b>		<b>3.85</b>				<b>291.3</b>			<b>624.0</b>

Note 1: A minimum time of concentration of 10 mins was taken

Note 2: For 100-year event, Runoff Coefficient is increased by 25% to a maximum of 1.0.



**A.4. Proposed Storage**  
**Humanics Centre, Ottawa, Ontario**

Project No.	210647100
Date:	03/10/2023
Prepared By:	N Chauvin
Check By:	J Fookes

**4a. Outlet 2 Storage**

**Summary of all Drainage Areas:**

Drainage Area	Sub Area	Proposed Conditions					
		Area, A (ha)	Pervious Area (ha)	Impervious Area (ha)	Imp.	Runoff Coefficient, R	Runoff Coefficient, 100-year Event (Note 1)
OUT2		1.40	1.06	0.33	24%	0.32	0.41
	A2.1	0.29	0.18	0.10	36%	0.39	0.48
	A2.2	0.14	0.08	0.06	46%	0.46	0.58
	A2.3	0.27	0.16	0.11	39%	0.38	0.48
	A2.4	0.13	0.09	0.04	28%	0.40	0.50
	A2.5	0.06	0.06	0.00	0%	0.20	0.25
	A2.6	0.52	0.49	0.03	5%	0.22	0.28

Note 1: For 100-year event, Runoff Coefficient is increased by 25% to a maximum of 1.0.

**Summary of Uncontrolled Drainage Areas:**

Drainage Area	Sub Area	Proposed Conditions					Runoff Rate	
		Area, A (ha)	Pervious Area (ha)	Impervious Area (ha)	Imp.	Runoff Coefficient, R	5-year (L/s)	100-year (L/s)
OUT2	A2.6	0.52	0.49	0.03	5%	0.22	32.89	70.46

100-year Pre-Development Flow (L/s)= 84.9  
 100-year Uncontrolled Runoff (L/s)= 70.5  
**100-year Allowable Release Rate (L/s)= 14.4**

5-year Pre-Development Flow (L/s)= 39.6  
 5-year Uncontrolled Runoff (L/s)= 32.9  
**5-year Allowable Release Rate (L/s)= 6.7**

**Orifice Sizing**

$Q = CA(2gH)^{0.5}$

C = 0.61  
 Design Flow Rate = 14.4 (L/s)  
 Proposed 100-year pond depth = 0.55 (m)  
 Proposed 100-year head above centreline of orifice = 0.28 (m)  
 Orifice Area = 10140 (mm<sup>2</sup>)  
 Orifice diameter = 114 (mm) (if <75mm then vortex ICD required)  
 Standard orifice diameter = 102 (mm)  
 Standard orifice area = 8171 (mm<sup>2</sup>)  
 Maximum release rate during 100-year event = 11.64 (L/s)  
 Total maximum release rate during 100-year event = 82.1 (L/s) (uncontrolled portion + controlled portion)

**Release Rates during 5-year event**

Water depth during 5-year event = 0.29 (m) (based on result of Req. Storage Vol. calc below)  
 Water elevation during 5-year event = 61.89 (m)  
 Proposed 5-year head above invert of orifice = 0.123 (m)  
 Proposed 5-year head above centreline of orifice = 0.072 (m)  
 Maximum release rate during 5-year event = 5.93 (L/s)  
 Total maximum release rate during 5-year event = 38.8 (L/s) (uncontrolled portion + controlled portion)

**Summary of Controlled Areas:**

Drainage Area	Sub Area	Proposed Conditions					
		Area, A (ha)	Pervious Area (ha)	Impervious Area (ha)	Imp.	Runoff Coefficient, R	Runoff Coefficient, 100-year Event
	A2.1	0.29	0.18	0.10	36%	0.39	0.48
	A2.2	0.14	0.08	0.06	46%	0.46	0.58
	A2.3	0.27	0.16	0.11	39%	0.38	0.48
	A2.4	0.13	0.09	0.04	28%	0.40	0.50
	A2.5	0.06	0.06	0.00	0%	0.20	0.25
Total		0.88	0.57	0.31		0.39	0.48



**Required Storage Volume (using Modified Rational Method)**

Q = RAIN

Q = runoff rate (L/s)

R = runoff coefficient

i = rainfall intensity (mm/hr)

A = drainage area (ha)

N = 2.78

$$i = \frac{A}{(T_d + C)^B}$$

where i = Rainfall Intensity (mm/hr)

T<sub>d</sub> = Time of Concentration (min)

Time, T <sub>d</sub> (min)	5-Year Event				100-Year Event			
	Intensity (mm/hr)	Peak Flow (L/s)	Release Rate (L/s)	Storage Volume (m <sup>3</sup> )	Intensity (mm/hr)	Peak Flow (L/s)	Release Rate (L/s)	Storage Volume (m <sup>3</sup> )
10	104.19	98.3	5.93	55.4	178.56	210.7	11.64	119.4
20	70.25	66.3	5.93	72.4	119.95	141.5	11.64	155.8
30	53.93	50.9	5.93	80.9	91.87	108.4	11.64	174.1
40	44.18	41.7	5.93	85.8	75.15	88.7	11.64	184.8
50	37.65	35.5	5.93	88.8	63.95	75.4	11.64	191.4
60	32.94	31.1	5.93	90.6	55.89	65.9	11.64	195.5
70	29.37	27.7	5.93	91.5	49.79	58.7	11.64	197.8
80	26.56	25.1	5.93	91.8	44.99	53.1	11.64	198.9
90	24.29	22.9	5.93	91.7	41.11	48.5	11.64	199.0
100	22.41	21.1	5.93	91.3	37.90	44.7	11.64	198.4
110	20.82	19.7	5.93	90.5	35.20	41.5	11.64	197.3
120	19.47	18.4	5.93	89.6	32.89	38.8	11.64	195.6
130	18.29	17.3	5.93	88.4	30.90	36.5	11.64	193.5
140	17.27	16.3	5.93	87.0	29.15	34.4	11.64	191.1
150	16.36	15.4	5.93	85.6	27.61	32.6	11.64	188.4
160	15.56	14.7	5.93	84.0	26.24	31.0	11.64	185.4
170	14.83	14.0	5.93	82.2	25.01	29.5	11.64	182.2
180	14.18	13.4	5.93	80.4	23.90	28.2	11.64	178.8

minimum time = time of concentration

Storage volume used	91.8 m <sup>3</sup>	Storage volume used	199.0 m <sup>3</sup>
---------------------	---------------------	---------------------	----------------------

## A.5. Bioretention Pond Sizing

### Humanics Centre, Ottawa, Ontario

Project No.	210647100
Date:	03/10/2023
Prepared By:	N Chauvin
Check By:	J Fookes

The bioretention pond was sized in accordance with the LID Stormwater Management Planning and Design Guide. TRCA, 2010

In accordance with TRCA SWM Criteria (2021), Section 7.4:

"As a minimum, to achieve the enhance level of water quality control, the LID practice must be sized to provide storage for a minimum 5mm of rainfall."

#### Bioretention Sizing Characteristics

Contributing Drainage Area, $A_c$ =	8808.00 m <sup>2</sup>	(Catchments A1.1-A1.5)
Catchment Runoff Coefficient, C =	0.39	
Catchment Impervious Area, $A_i$ =	3088.00 m <sup>2</sup>	
Infiltration Volume Target, $V_i$ =	33.949 m <sup>3</sup>	(10mm rainfall retention was used for this design)
Field Measured Infiltration Rate, f =	97 mm/hr	(Median of field measured infiltration rates)
Safety Factor, z =	2.5	
Design Infiltration Rate, $f'$ =	39 mm/hr	(Median of field measured infiltration rates, f divided by z)
Filter Media Depth, $d_f$ =	100 mm	(To support shrubs, flowering perennial and deeply rooting decorative grasses)
Filter Media Porosity, $n_f$ =	0.35	(for more loamy Blend B, water quality treatment priority)
Side Slopes, m:1 =	3.0 max	Side Width= 2.55 m
Bottom Width, B =	2.60 m (min)	Total Top Width= 7.7 m
Total Pond Height, H=	0.85	
100-year Height, h =	0.55 m	
Base Length, L =	90 m	
Elevation of Base of Pond=	61.60 m	
Lowest Edge of Pond =	62.45 m	(freeboard measured to this point)
Freeboard=	0.3 m	
Pond Spill Elevation=	62.15 m	
100-year Water Level=	62.15 m	
100-year Volume=	210.4 cu.m	

#### 1. Decide if an underdrain will be included:

If the median field measured or estimated infiltration rate of the underlying native soil (f) is less than 15 mm/h, include an underdrain.

Field Measured Infiltration Rate, f =	97 mm/hr
Include underdrain =	No

#### 2. Select a surface ponding depth to begin sizing with

For practices without underdrain:  $d_{p,max} = f' \times 48$

Where:  $f'$  = Design infiltration rate (mm/h), and  
48 = Maximum permissible drainage time for surface ponded water (h)

$$d_{p,max} = 1.87 \text{ m}$$

#### 3. Select a design surface ponding depth

For practices with soft (i.e. landscaped) edges and bowl-shaped ponding areas calculate the mean surface ponding depth:

$$d'_p = d_{p,max} \times 0.5$$

$$d'_p = 0.94 \text{ m}$$

#### 4. Determine Water Quality Volume requirements

Infiltration Volume Target, $V_i$ =	33.95 m <sup>3</sup>	(10mm rainfall retention was used for this design)
Water Depth, y =	0.17 m	
Cross Sectional Area, A =	0.53 m <sup>2</sup>	
Volume Provided, $V_{i,actual}$ =	47.58 m <sup>3</sup>	
Invert Elevation of Overflow =	61.77 m	(orifice invert)

#### 5. Determine Water Depth in 5-Year Event

Water Depth, y =	0.29 m	(use this value in Proposed Storage calculation)
Cross Sectional Area, A =	1.02 m <sup>2</sup>	
5-year Volume Used =	91.84 m <sup>3</sup>	(provide required volume as per Proposed Storage sheet)



## A.6. Pond Draindown Time

Humanics Centre, Ottawa, Ontario

### Release Rate from Pond

Project No.	210647100
Date:	03/10/2023
Prepared By:	N Chauvin
Check By:	J Fookes

Equation 4.10 from MOE Stormwater Design Guidelines:

$$t = \frac{2A_P}{CA_o(2g)^{0.5}} (h_1^{0.5} - h_2^{0.5})$$

where:

Pond Volume	199.0 cu.m	Side Slopes, m:1 =	3
Water depth when full, h1	0.55 m	Bottom Width, B =	2.6
Water depth when empty, h2	0.0 m	Length, L =	90
Orifice coefficient, C	0.61	Orifice diameter =	102
Acceleration due to gravity, g	9.81 m/s <sup>2</sup>		

### Incremental draindown calculation (100-year event), based proposed orifice:

The drawdown when the water level is above the overflow will be governed by the orifice:

Water Depth at start of step, h1 (m)	Water depth at end of step, h2 (m)	Pond Surface Area, Ap (m <sup>2</sup> )	Duration of Step, t (s)	Realease Rate (L/s)
0.55	0.50	531	1660.12	32.63
0.50	0.45	504	1656.67	31.03
0.45	0.40	477	1657.72	29.35
0.40	0.35	450	1665.09	27.57
0.35	0.30	423	1681.59	25.66
0.30	0.17	396	4857.50	8.32
Total draindown duration			13178.69 seconds	
				3.7 hours

### Draindown Calculation (100-year event), based of infiltration rate of native soil:

The drawdown when the water level is below the overflow will be governed by the infiltration rate of the soil:

Depth of ponding, h (m)	Infiltration Rate of Soil, f (mm/hr)	Duration, t (hr)
0.17	39	4.4

**Total draindown duration = 8.0 hours**

## **Appendix B**

---

# **Infiltration Testing Memorandum**

# MEMORANDUM



**TO:** Ahmed Elsayed, P.Eng  
Project Manager / Engineer (Municipal)

**FROM:** Mitchell Dawley and Ant West

**PROJECT No.:** 210647100

**RE:** Infiltration Testing for Stormwater Management  
Design at the Humanics Sanctuary

**DATE:** 10/25/2021

\\EGNYTEDRIVE\MH CLOUD\PROJ\2021\210647100-HUMANICS SANCTUARY CIVIL\08. WORKING\1. INFILTRATION TESTING\210647100 INFILTRATION TEST MEMO\_REV0.DOCX

## 1. Introduction

Morrison Hershfield Ltd. (MH) was retained by Humanics Universal Inc. (the Client) to perform civil engineering design services associated with proposed improvements to the Humanics Sanctuary at 3400/3468 Old Montreal Road, Ottawa.

Specifically, MH is completing the Stormwater Management and Drainage Design as part of future development of the site. The Stormwater Management design will make use of Low Impact Development (LID) solutions that encourage infiltration.

Prior to design, MH's scope of services included infiltration testing to assist in selecting the LID solutions. The infiltration testing consisted of Guelph Permeameter testing at five (5) locations. This memorandum presents the methods findings and results of this testing.

## 2. Methodology

Infiltration testing was performed at five (5) locations using a 2800K1 Guelph Permeameter (GP) in accordance with ASTM D5126. The GP is an in-hole constant-head Permeameter that measures the steady-state rate of water recharge into unsaturated soil from a cylindrical borehole.

The locations of the infiltration testing are shown on **Figure 1 in Attachment A**.

The field procedures used with the GP were as follows:

- A 6 cm diameter borehole was hand augered to depths between 0.24 to 0.36 m. Basic soil characteristics were observed and recorded during augering.
- The GP reservoir was filled with water and the instrument was lowered into the borehole.
- A well head height (H) was established in the open borehole by adjusting the Air Tube.
- The water level in the instrument reservoir was recorded at regular time intervals and the rate of fall (of water) was determined for each interval.
- Operation of the GP continued until the "Steady-State Rate of Fall" was attained. This occurred when the rate of fall did not significantly change over three (3) consecutive time intervals.
- For each borehole, the above procedure was repeated by establishing a different well head height (H).

### 3. Results

#### Soil Conditions

The soil conditions observed in each borehole augured for the GP testing was noted and the results are summarized in Table 1 below.

**Table 1: Observed Soil Conditions**

Borehole ID	Depth of Borehole (mbgs)	Observed Soil Conditions
IN-1	0.24	Med to Fine Sand (SP) (0 – 0.17 m); Clayey Sand (SC) (0.17 – 0.24 m)
IN-2	0.27	Silty Sand (SM) (0.09 – 0.22 m); Med to Fine Sand (SP) (0.22 – 0.27 m)
IN-3	0.36	Silty Sand to Sand (SM-SP) (0.08 – 0.20); Med to Fine Sand (SP) (0.20 – 0.36 m)
IN-4	0.30	Silty Sand (SM) (0.08 – 0.14 m); Med to Fine Sand (SP) (0.14 – 0.30 m)
IN-5	0.26	Silty Sand (SM) (0.08 – 0.16 m); Med to Fine Sand (SP) (0.16 – 0.26 m)

#### Infiltration Testing

Hydraulic properties of the subgrade soils in the unsaturated zone were determined using a Guelph Permeameter (GP), by applying the single head method and averaging results of two (2) tests.

The GP instrument maintains a constant head of water in a borehole, causing water to infiltrate into the surrounding unsaturated soil. As water infiltrates, a “bulb” of saturated soil of specific dimensions develops around the borehole. Once the bulb develops, the steady-state flow rate of water out of the borehole is established and combined saturated-unsaturated flow occurs in the soil (Soilmoisture Corp., 2012).

For conditions of saturated-unsaturated flow, hydrostatic pressure, gravity and capillarity all contribute to the steady-state flow rate. Matric flux potential ( $\phi_m$ ) is a measure of the capillarity/capillary pull that the unsaturated soil exerts on infiltrating water while the field-saturated hydraulic conductivity ( $K_{fs}$ ) represents the hydrostatic pressure and gravity contributions to flow (Elrick & Reynolds, 1992).

Hydraulic conductivity is a function of water content in the soil and the maximum hydraulic conductivity value for a given soil unit occurs under conditions of saturation. With that said, the measured  $K_{fs}$  from infiltration testing is always slightly less than the saturated hydraulic conductivity ( $K_{sat}$ ) for the same soil type due to the fact that the infiltration process often does not expel all air from the voids in the unsaturated soil, leaving some air entrapped. This entrapped air results in a smaller available surface area for water to flow through resulting in  $K_{fs}$  being less than  $K_{sat}$ .

The calculations of these hydraulic parameters from the GP field results are provided in **Attachment B**.





For the design of LID stormwater infiltration systems, the measured  $K_{fs}$  values must be converted to an infiltration rate ( $f$ ) using the approximate relationship provided below (Ontario Ministry of Municipal Affairs and Housing, 1997):

$$f = \left( \frac{K_{fs}}{6 \times 10^{-11}} \right)^{\frac{1}{3.7363}}$$

A factor of safety of 2.5 was applied to this calculated infiltration rate to account for soil variability, potential reductions in soil permeability due to compaction or smearing during construction and gradual accumulation of fine sediments over the lifespan of the facility (Credit Valley and the Toronto and Region Conservation Authority, 2010)

**Table 2: Infiltration Rates and Hydraulic Properties of Soils in Unsaturated Zone**


Infiltration Location ID	Soil Type	$\Phi_m$ (cm <sup>2</sup> /min)	$K_{fs}$ (cm/s)	Infiltration Rate, $f$ , (mm/hr)	Design Infiltration Rate (mm/hr)
IN-1	Sand (SP) and Clayey Sand (SC)	4.29x10 <sup>-3</sup>	5.15x10 <sup>-4</sup>	72	29
IN-2	Silty Sand (SM) and Sand (SP)	5.60x10 <sup>-3</sup>	6.72x10 <sup>-4</sup>	77	31
IN-3	Silty Sand (SM) and Sand (SP)	3.82x10 <sup>-2</sup>	4.58x10 <sup>-3</sup>	129	52
IN-4	Silty Sand (SM) and Sand (SP)	2.76x10 <sup>-2</sup>	3.32x10 <sup>-3</sup>	118	47
IN-5	Silty Sand (SM) and Sand (SP)	1.34x10 <sup>-2</sup>	1.61x10 <sup>-3</sup>	97	39

#### 4. References



- Credit Valley and the Toronto and Region Conservation Authority. (2010). *Low Impact Development Stormwater Management Planning and Design Guide. Appendix C.*
- Elrick, D. E., & Reynolds, W. D. (1992). Methods for Analyzing Constant Head Well Permeameter Data. *Soil Science*, 320-323.
- Ontario Ministry of Municipal Affairs and Housing. (1997). *Supplementary Guidelines to the Ontario Building Code 1997. SG-6 Percolation Time and Soil Descriptions.* Toronto.
- Soilmoisture Corp. (2012). *Guelph Permeameter 2800 Operating Instructions.* Santa Barbara: Soilmoisture Corp.

#### Attachments:

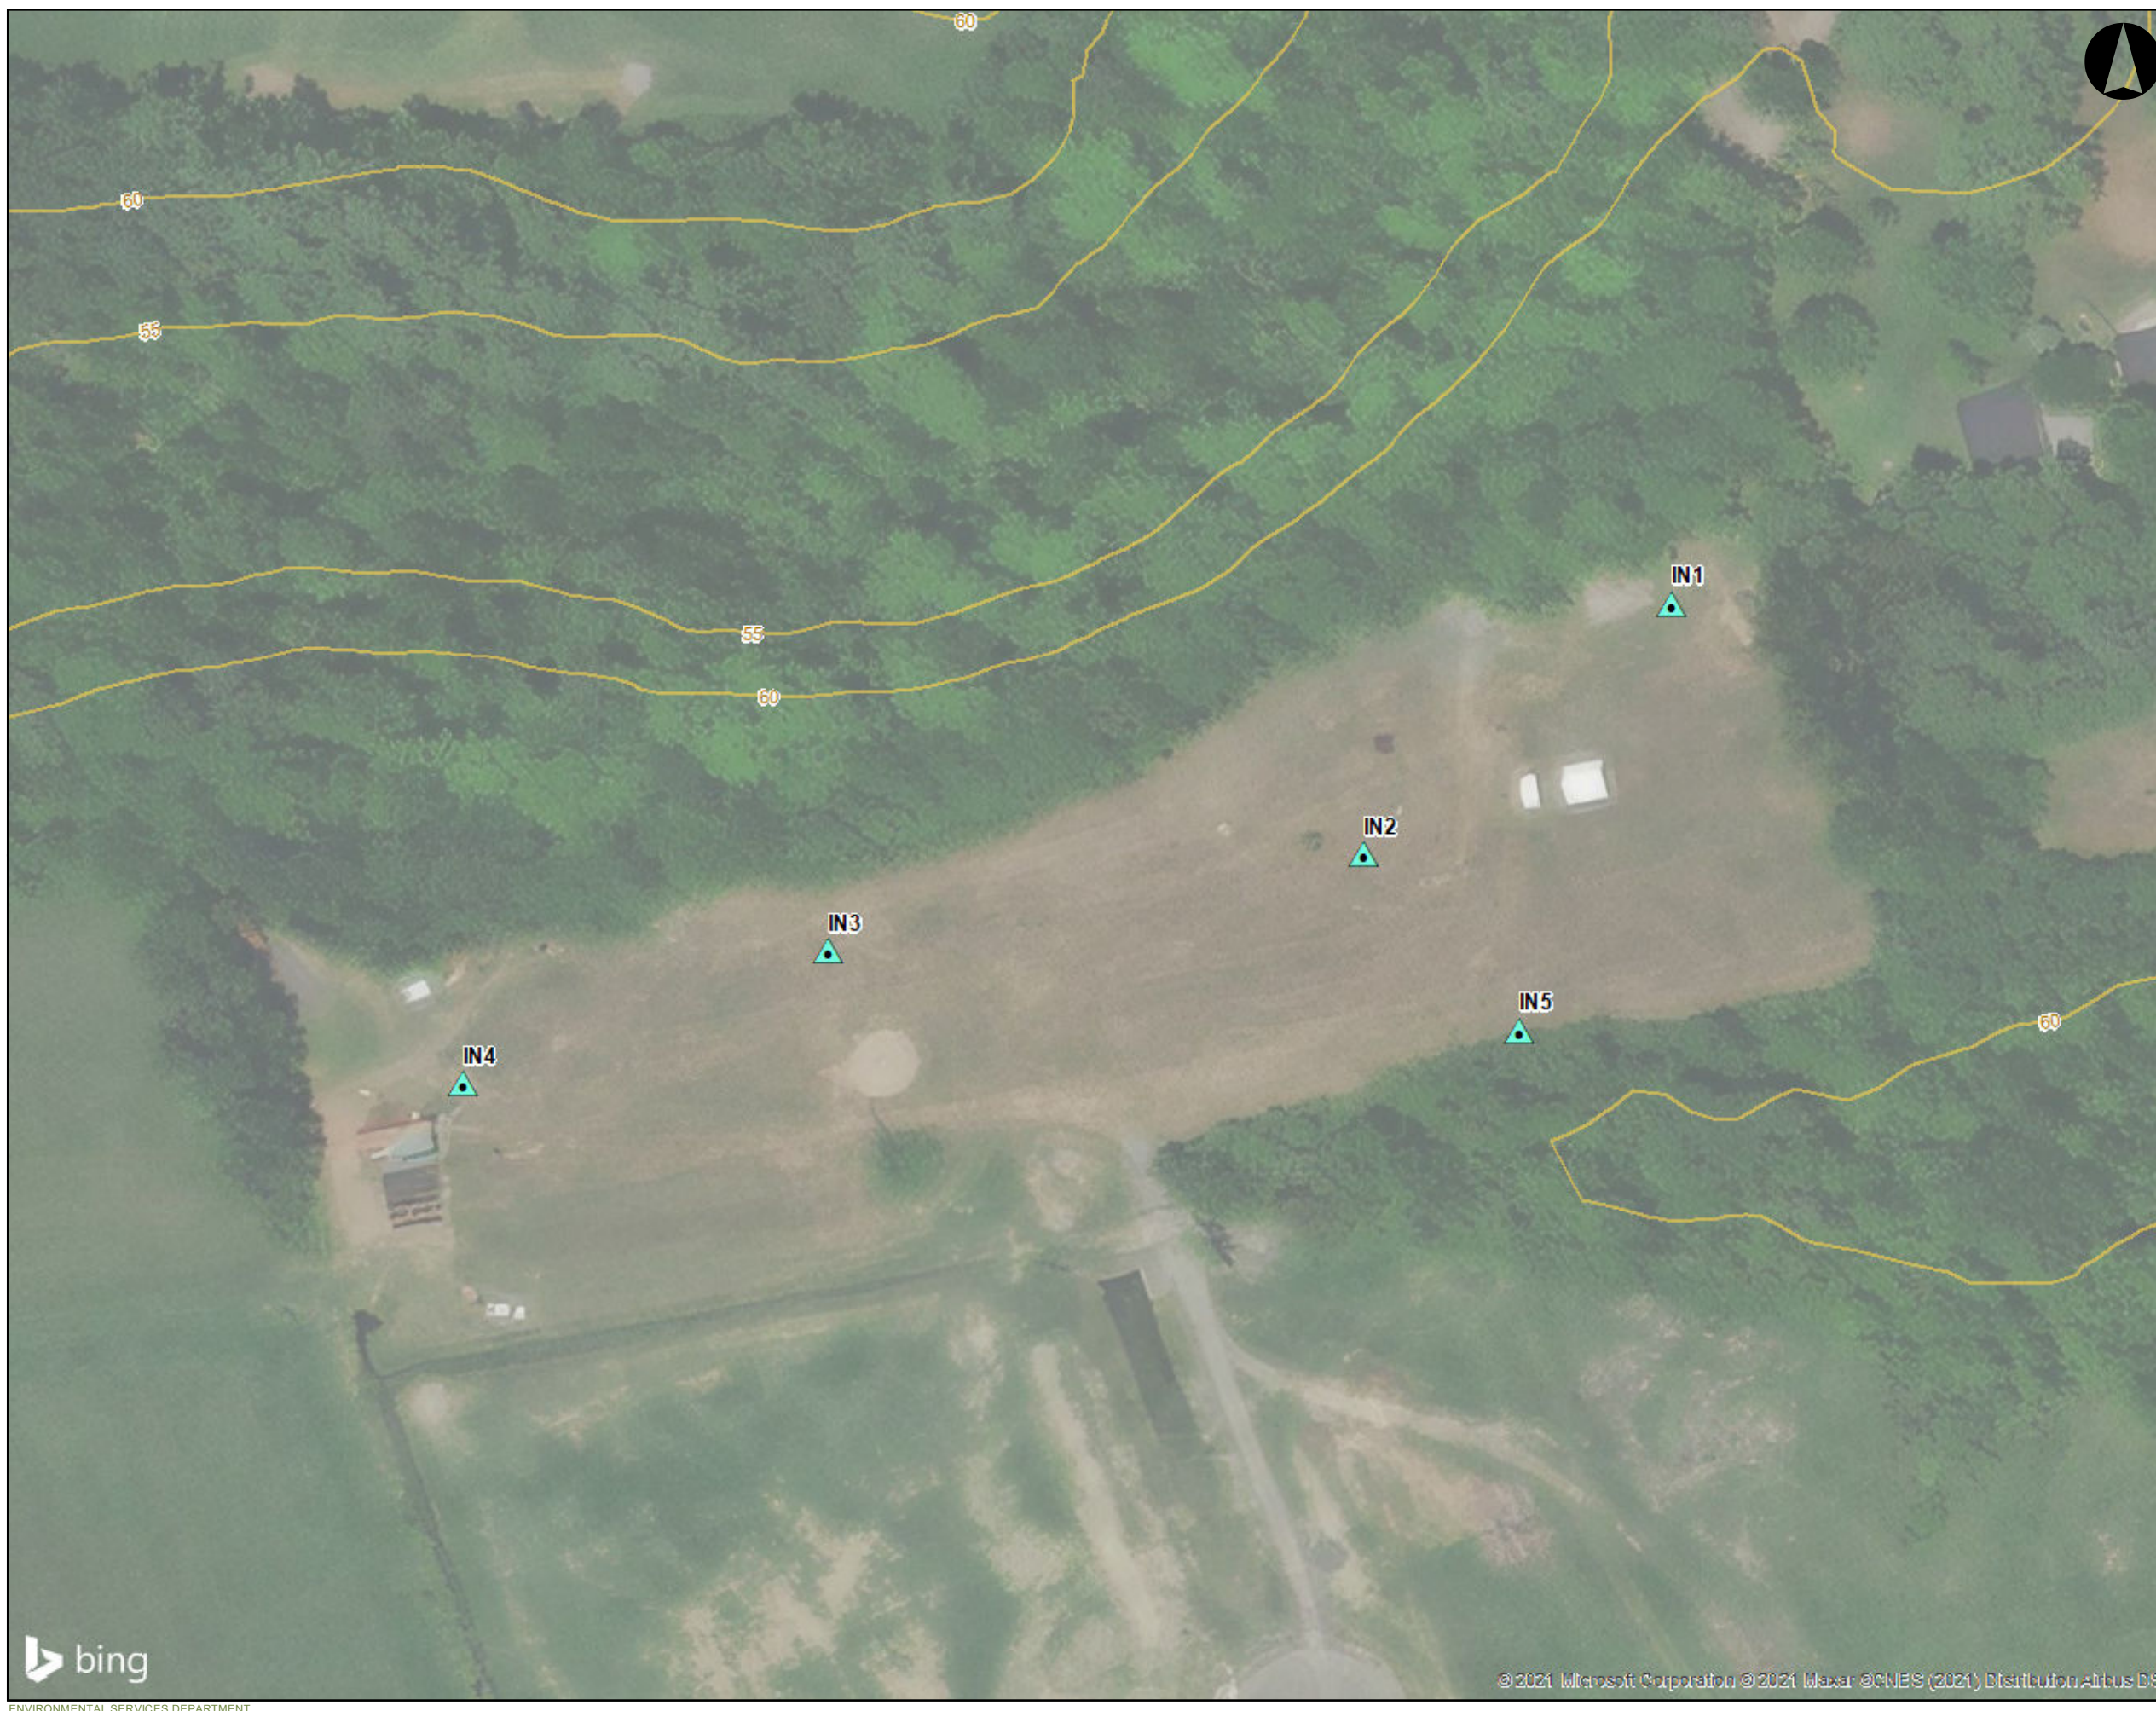
- Attachment A: Site Plan
- Appendix B: GP Results




**LEGEND**

-  Infiltration Test Locations
-  Topographic Contour (mASL)

ID	Easting	Northing
IN1	471533.9	5040209.08
IN2	471486.27	5040170.11
IN3	471403.14	5040155.07
IN4	471346.51	5040134.53
IN5	471510.42	5040142.8

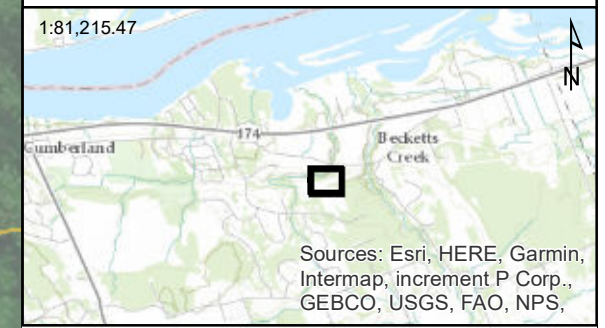

Coordinate System: NAD 1983 UTM Zone 18N



TITLE: **Infiltration Test Locations**

PROJECT NO.: 210647100  
**Infiltration Testing for Stormwater Management  
 Design at the Humanics Sanctuary**

DATE: October 2021 **Figure 1**





Input  
Result

Single Head Method (1)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **7**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **0.6000**

Res Type: 35.22  
H: 7  
a: 3  
H/a: 2.333  
a\*: 0.12  
CO.01: 0.991  
CO.04: 1.04  
CO.12: 1.014  
CO.36: 1.014  
C: 1.014  
R: 0.600  
Q: 0.352  
pi: 3.142

$\alpha^* = 0.12 \text{ cm}^{-1}$   
**C = 1.0139**  
**Q = 0.3522**  
 $K_{fs} = 5.08E-04 \text{ cm/sec}$   
 $3.05E-02 \text{ cm/min}$   
 $5.08E-06 \text{ m/sec}$   
 $1.20E-02 \text{ inch/min}$   
 $2.00E-04 \text{ inch/sec}$   
 $\Phi_m = 4.23E-03 \text{ cm}^2/\text{min}$

Single Head Method (2)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **15**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **1.2000**

Res Type: 35.22  
H: 15  
a: 3  
H/a: 5  
a\*: 0.12  
CO.01: 1.51827  
CO.04: 1.62914  
CO.12: 1.66689  
CO.36: 1.66689  
C: 1.66689  
R: 1.200  
Q: 0.7044  
pi: 3.1415

$\alpha^* = 0.12 \text{ cm}^{-1}$   
**C = 1.66689**  
**Q = 0.7044**  
 $K_{fs} = 5.23E-04 \text{ cm/sec}$   
 $3.14E-02 \text{ cm/min}$   
 $5.23E-06 \text{ m/sec}$   
 $1.23E-02 \text{ inch/min}$   
 $2.06E-04 \text{ inch/sec}$   
 $\Phi_m = 4.36E-03 \text{ cm}^2/\text{min}$

Average

$K_{fs} = 5.15E-04 \text{ cm/sec}$   
 $3.09E-02 \text{ cm/min}$   
 $5.15E-06 \text{ m/s}$   
 $1.22E-02 \text{ inch/min}$   
 $2.03E-04 \text{ inch/sec}$   
 $\Phi_m = 4.29E-03 \text{ cm}^2/\text{min}$

Calculation formulas related to shape factor (C). Where  $H_1$  is the first water head height (cm),  $H_2$  is the second water head height (cm),  $a$  is borehole radius (cm) and  $a^*$  is microscopic capillary length factor which is decided according to the soil texture-structure category. For one-head method, only C needs to be calculated while for two-head method,  $C_1$  and  $C_2$  are calculated (Zaig et al., 1998).

Soil Texture-Structure Category	$\alpha^*(\text{cm}^{-1})$	Shape Factor
Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.	0.01	$C_1 = \left( \frac{H_2/a}{2.081 + 0.121(H_2/a)} \right)^{0.672}$
Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.	0.04	$C_1 = \left( \frac{H_1/a}{1.992 + 0.091(H_1/a)} \right)^{0.683}$ $C_2 = \left( \frac{H_2/a}{1.992 + 0.091(H_2/a)} \right)^{0.683}$
Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.	0.12	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$
Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macro pores, etc.	0.36	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$

Calculation formulas related to one-head and two-head methods. Where  $R$  is steady-state rate of fall of water in reservoir (cm/s),  $K_{fs}$  is Soil saturated hydraulic conductivity (cm/s),  $\Phi_m$  is Soil matric flux potential (cm<sup>2</sup>/s),  $a^*$  is Macroscopic capillary length parameter (from Table 2),  $a$  is Borehole radius (cm),  $H_1$  is the first head of water established in borehole (cm),  $H_2$  is the second head of water established in borehole (cm) and  $C$  is Shape Factor (from Table 2).

One Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$	$K_{fs} = \frac{C_1 \times Q_1}{2\pi H_1^2 + \pi a^2 C_1 + 2\pi \left( \frac{H_1}{a} \right)}$ $\Phi_m = \frac{C_1 \times Q_1}{(2\pi H_1^2 + \pi a^2 C_1) a^* + 2\pi H_1}$
One Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$	
Two Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$ $Q_2 = \bar{R}_2 \times 35.22$	$G_1 = \frac{H_2 C_1}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $G_2 = \frac{H_1 C_2}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $K_{fs} = G_2 Q_2 - G_1 Q_1$ $G_3 = \frac{(2H_1^2 + a^2 C_1) C_1}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$
Two Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$ $Q_2 = \bar{R}_2 \times 2.16$	$G_4 = \frac{(2H_2^2 + a^2 C_2) C_2}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $\Phi_m = G_3 Q_1 - G_4 Q_2$



Input  
Result

Single Head Method (1)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **5**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **0.5000**

Res Type: 35.22  
H: 5  
a: 3  
H/a: 1.667  
a\*: 0.12  
CO.01: 0.809  
CO.04: 0.842  
CO.12: 0.803  
CO.36: 0.803  
C: 0.803  
R: 0.500  
Q: 0.294  
pi: 3.142

$\alpha^* = 0.12 \text{ cm}^{-1}$   
 $C = 0.80315$   
 $Q = 0.2935$   
 $K_{fs} = 5.34E-04 \text{ cm/sec}$   
 $3.20E-02 \text{ cm/min}$   
 $5.34E-06 \text{ m/sec}$   
 $1.26E-02 \text{ inch/min}$   
 $2.10E-04 \text{ inch/sec}$   
 $\Phi_m = 4.45E-03 \text{ cm}^2/\text{min}$

Single Head Method (2)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **12**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **1.5000**

Res Type: 35.22  
H: 12  
a: 3  
H/a: 4  
a\*: 0.12  
CO.01: 1.34796  
CO.04: 1.43553  
CO.12: 1.44896  
CO.36: 1.44896  
C: 1.44896  
R: 1.500  
Q: 0.8805  
pi: 3.1415

$\alpha^* = 0.12 \text{ cm}^{-1}$   
 $C = 1.44896$   
 $Q = 0.8805$   
 $K_{fs} = 8.11E-04 \text{ cm/sec}$   
 $4.86E-02 \text{ cm/min}$   
 $8.11E-06 \text{ m/sec}$   
 $1.91E-02 \text{ inch/min}$   
 $3.19E-04 \text{ inch/sec}$   
 $\Phi_m = 6.75E-03 \text{ cm}^2/\text{min}$

Average

$K_{fs} = 6.72E-04 \text{ cm/sec}$   
 $4.03E-02 \text{ cm/min}$   
 $6.72E-06 \text{ m/s}$   
 $1.59E-02 \text{ inch/min}$   
 $2.65E-04 \text{ inch/sec}$   
 $\Phi_m = 5.60E-03 \text{ cm}^2/\text{min}$

Calculation formulas related to shape factor (C). Where H<sub>1</sub> is the first water head height (cm), H<sub>2</sub> is the second water head height (cm), a is borehole radius (cm) and a\* is microscopic capillary length factor which is decided according to the soil texture-structure category. For one-head method, only C<sub>1</sub> needs to be calculated while for two-head method, C<sub>1</sub> and C<sub>2</sub> are calculated (Zaig et al., 1998).

Soil Texture-Structure Category	$\alpha^*(\text{cm}^{-1})$	Shape Factor
Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.	0.01	$C_1 = \left( \frac{H_2/a}{2.081 + 0.121(H_2/a)} \right)^{0.672}$
Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.	0.04	$C_1 = \left( \frac{H_1/a}{1.992 + 0.091(H_1/a)} \right)^{0.683}$ $C_2 = \left( \frac{H_2/a}{1.992 + 0.091(H_2/a)} \right)^{0.683}$
Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.	0.12	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$
Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macro pores, etc.	0.36	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$

Calculation formulas related to one-head and two-head methods. Where R is steady-state rate of fall of water in reservoir (cm/s), K<sub>fs</sub> is Soil saturated hydraulic conductivity (cm/s), Φ<sub>m</sub> is Soil matric flux potential (cm<sup>2</sup>/s), a\* is Macroscopic capillary length parameter (from Table 2), a is Borehole radius (cm), H<sub>1</sub> is the first head of water established in borehole (cm), H<sub>2</sub> is the second head of water established in borehole (cm) and C is Shape Factor (from Table 2).

One Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$	$K_{fs} = \frac{C_1 \times Q_1}{2\pi H_1^2 + \pi a^2 C_1 + 2\pi \left( \frac{H_1}{a} \right)}$ $\Phi_m = \frac{C_1 \times Q_1}{(2\pi H_1^2 + \pi a^2 C_1) a^* + 2\pi H_1}$
One Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$	
Two Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$	$G_1 = \frac{H_2 C_1}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $G_2 = \frac{H_1 C_2}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $K_{fs} = G_2 Q_2 - G_1 Q_1$ $G_3 = \frac{(2H_1^2 + a^2 C_1) C_1}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$
	$Q_2 = \bar{R}_2 \times 35.22$	
Two Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$	$G_4 = \frac{(2H_1^2 + a^2 C_1) C_2}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $\Phi_m = G_3 Q_1 - G_4 Q_2$
	$Q_2 = \bar{R}_2 \times 2.16$	



Input  
Result

Single Head Method (1)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **5**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **5.0000**

Res Type: 35.22  
H: 5  
a: 3  
H/a: 1.6667  
a\*: 0.12  
CO.01: 0.809  
CO.04: 0.842  
CO.12: 0.803  
CO.36: 0.803  
C: 0.803  
R: 5.000  
Q: 2.935  
pi: 3.142

$\alpha^* = 0.12 \text{ cm}^{-1}$   
**C = 0.80315**  
**Q = 2.935**  
 $K_{fs} = 5.34E-03 \text{ cm/sec}$   
**3.20E-01 cm/min**  
**5.34E-05 m/sec**  
**1.26E-01 inch/min**  
**2.10E-03 inch/sec**  
 $\Phi_m = 4.45E-02 \text{ cm}^2/\text{min}$

Single Head Method (2)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **17**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc


Steady State Rate of Water Level Change ("R" in cm/min): **10.0000**

Res Type: 35.22  
H: 17  
a: 3  
H/a: 5.66667  
a\*: 0.12  
CO.01: 1.61898  
CO.04: 1.7451  
CO.12: 1.79884  
CO.36: 1.79884  
C: 1.79884  
R: 10.000  
Q: 5.87  
pi: 3.1415

$\alpha^* = 0.12 \text{ cm}^{-1}$   
**C = 1.79884**  
**Q = 5.87**  
 $K_{fs} = 3.83E-03 \text{ cm/sec}$   
**2.30E-01 cm/min**  
**3.83E-05 m/sec**  
**9.05E-02 inch/min**  
**1.51E-03 inch/sec**  
 $\Phi_m = 3.19E-02 \text{ cm}^2/\text{min}$

Average

$K_{fs} = 4.58E-03 \text{ cm/sec}$   
**2.75E-01 cm/min**  
**4.58E-05 m/s**  
**1.08E-01 inch/min**  
**1.80E-03 inch/sec**  
 $\Phi_m = 3.82E-02 \text{ cm}^2/\text{min}$

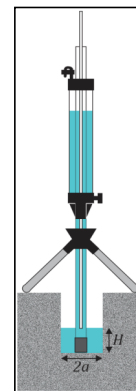

Calculation formulas related to shape factor (C). Where H<sub>1</sub> is the first water head height (cm), H<sub>2</sub> is the second water head height (cm), a is borehole radius (cm) and a\* is microscopic capillary length factor which is decided according to the soil texture-structure category. For one-head method, only C<sub>1</sub> needs to be calculated while for two-head method, C<sub>1</sub> and C<sub>2</sub> are calculated (Zaig et al., 1998).

Soil Texture-Structure Category	$\alpha^*(\text{cm}^{-1})$	Shape Factor
Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.	0.01	$C_1 = \left( \frac{H_2/a}{2.081 + 0.121(H_2/a)} \right)^{0.672}$
Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.	0.04	$C_1 = \left( \frac{H_1/a}{1.992 + 0.091(H_1/a)} \right)^{0.683}$ $C_2 = \left( \frac{H_2/a}{1.992 + 0.091(H_2/a)} \right)^{0.683}$
Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.	0.12	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$
Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macro pores, etc.	0.36	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$

Calculation formulas related to one-head and two-head methods. Where R is steady-state rate of fall of water in reservoir (cm/s), K<sub>fs</sub> is Soil saturated hydraulic conductivity (cm/s), Φ<sub>m</sub> is Soil matric flux potential (cm<sup>2</sup>/s), a\* is Macroscopic capillary length parameter (from Table 2), a is Borehole radius (cm), H<sub>1</sub> is the first head of water established in borehole (cm), H<sub>2</sub> is the second head of water established in borehole (cm) and C is Shape Factor (from Table 2).

One Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$	$K_{fs} = \frac{C_1 \times Q_1}{2\pi H_1^2 + \pi a^2 C_1 + 2\pi \left( \frac{H_1}{a} \right)}$ $\Phi_m = \frac{C_1 \times Q_1}{(2\pi H_1^2 + \pi a^2 C_1) a^* + 2\pi H_1}$
One Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$	
Two Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$ $Q_2 = \bar{R}_2 \times 35.22$	$G_1 = \frac{H_2 C_1}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $G_2 = \frac{H_1 C_2}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $K_{fs} = G_2 Q_2 - G_1 Q_1$ $G_3 = \frac{(2H_1^2 + a^2 C_1) C_1}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$
Two Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$ $Q_2 = \bar{R}_2 \times 2.16$	$G_4 = \frac{(2H_2^2 + a^2 C_2) C_2}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $\Phi_m = G_3 Q_1 - G_4 Q_2$



Input  
Result

Single Head Method (1)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **6**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **4.2000**

Res Type: 35.22  
H: 6  
a: 3  
H/a: 2  
a\*: 0.12  
CO.01: 0.904  
CO.04: 0.945  
CO.12: 0.912  
CO.36: 0.912  
C: 0.912  
R: 4.200  
Q: 2.465  
pi: 3.142

$\alpha^* = 0.12 \text{ cm}^{-1}$   
 $C = 0.91197$   
 $Q = 2.4654$   
 $K_{fs} = 3.97E-03 \text{ cm/sec}$   
 $2.38E-01 \text{ cm/min}$   
 $3.97E-05 \text{ m/sec}$   
 $9.38E-02 \text{ inch/min}$   
 $1.56E-03 \text{ inch/sec}$   
 $\Phi_m = 3.31E-02 \text{ cm}^2/\text{min}$

Single Head Method (2)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **14**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc


Steady State Rate of Water Level Change ("R" in cm/min): **5.7000**

Res Type: 35.22  
H: 14  
a: 3  
H/a: 4.66667  
a\*: 0.12  
CO.01: 1.4643  
CO.04: 1.56745  
CO.12: 1.59712  
CO.36: 1.59712  
C: 1.59712  
R: 5.700  
Q: 3.3459  
pi: 3.1415

$\alpha^* = 0.12 \text{ cm}^{-1}$   
 $C = 1.59712$   
 $Q = 3.3459$   
 $K_{fs} = 2.66E-03 \text{ cm/sec}$   
 $1.60E-01 \text{ cm/min}$   
 $2.66E-05 \text{ m/sec}$   
 $6.28E-02 \text{ inch/min}$   
 $1.05E-03 \text{ inch/sec}$   
 $\Phi_m = 2.22E-02 \text{ cm}^2/\text{min}$

Average

$K_{fs} = 3.32E-03 \text{ cm/sec}$   
 $1.99E-01 \text{ cm/min}$   
 $3.32E-05 \text{ m/s}$   
 $7.83E-02 \text{ inch/min}$   
 $1.31E-03 \text{ inch/sec}$   
 $\Phi_m = 2.76E-02 \text{ cm}^2/\text{min}$

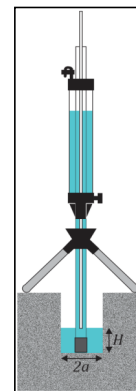

Calculation formulas related to shape factor (C). Where H<sub>1</sub> is the first water head height (cm), H<sub>2</sub> is the second water head height (cm), a is borehole radius (cm) and a\* is microscopic capillary length factor which is decided according to the soil texture-structure category. For one-head method, only C<sub>1</sub> needs to be calculated while for two-head method, C<sub>1</sub> and C<sub>2</sub> are calculated (Zaig et al., 1998).

Soil Texture-Structure Category	$\alpha^*(\text{cm}^{-1})$	Shape Factor
Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.	0.01	$C_1 = \left( \frac{H_2/a}{2.081 + 0.121(H_2/a)} \right)^{0.672}$
Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.	0.04	$C_1 = \left( \frac{H_1/a}{1.992 + 0.091(H_1/a)} \right)^{0.683}$ $C_2 = \left( \frac{H_2/a}{1.992 + 0.091(H_2/a)} \right)^{0.683}$
Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.	0.12	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$
Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macro pores, etc.	0.36	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$

Calculation formulas related to one-head and two-head methods. Where R is steady-state rate of fall of water in reservoir (cm/s), K<sub>fs</sub> is Soil saturated hydraulic conductivity (cm/s), Φ<sub>m</sub> is Soil matric flux potential (cm<sup>2</sup>/s), a\* is Macroscopic capillary length parameter (from Table 2), a is Borehole radius (cm), H<sub>1</sub> is the first head of water established in borehole (cm), H<sub>2</sub> is the second head of water established in borehole (cm) and C is Shape Factor (from Table 2).

One Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$	$K_{fs} = \frac{C_1 \times Q_1}{2\pi H_1^2 + \pi a^2 C_1 + 2\pi \left( \frac{H_1}{a} \right)}$ $\Phi_m = \frac{C_1 \times Q_1}{(2\pi H_1^2 + \pi a^2 C_1) a^* + 2\pi H_1}$
One Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$	
Two Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$ $Q_2 = \bar{R}_2 \times 35.22$	$G_1 = \frac{H_2 C_1}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $G_2 = \frac{H_1 C_2}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $K_{fs} = G_2 Q_2 - G_1 Q_1$ $G_3 = \frac{(2H_1^2 + a^2 C_1) C_1}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$
Two Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$ $Q_2 = \bar{R}_2 \times 2.16$	$G_4 = \frac{(2H_2^2 + a^2 C_1) C_2}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $\Phi_m = G_3 Q_1 - G_4 Q_2$



Input  
Result

Single Head Method (1)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **5**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc

Steady State Rate of Water Level Change ("R" in cm/min): **1.5000**

Res Type: 35.22  
H: 5  
a: 3  
H/a: 1.667  
a\*: 0.12  
CO.01: 0.809  
CO.04: 0.842  
CO.12: 0.803  
CO.36: 0.803  
C: 0.803  
R: 1.500  
Q: 0.881  
pi: 3.142

$\alpha^* = 0.12 \text{ cm}^{-1}$   
**C = 0.80315**  
**Q = 0.8805**  
 $K_{fs} = 1.60E-03 \text{ cm/sec}$   
**9.61E-02 cm/min**  
**1.60E-05 m/sec**  
**3.78E-02 inch/min**  
**6.31E-04 inch/sec**  
 $\Phi_m = 1.33E-02 \text{ cm}^2/\text{min}$

Single Head Method (2)

Reservoir Cross-sectional area in cm<sup>2</sup>  
(enter "35.22" for Combined and "2.16" for Inner reservoir): **35.22**  
Enter water Head Height ("H" in cm): **12**  
Enter the Borehole Radius ("a" in cm): **3**

Enter the soil texture-structure category (enter one of the below numbers): **3**

1. Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.
2. Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.
3. Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.
4. Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macropores, etc


Steady State Rate of Water Level Change ("R" in cm/min): **3.0000**

Res Type: 35.22  
H: 12  
a: 3  
H/a: 4  
a\*: 0.12  
CO.01: 1.34796  
CO.04: 1.43553  
CO.12: 1.44896  
CO.36: 1.44896  
C: 1.44896  
R: 3.000  
Q: 1.761  
pi: 3.1415

$\alpha^* = 0.12 \text{ cm}^{-1}$   
**C = 1.44896**  
**Q = 1.761**  
 $K_{fs} = 1.62E-03 \text{ cm/sec}$   
**9.73E-02 cm/min**  
**1.62E-05 m/sec**  
**3.83E-02 inch/min**  
**6.38E-04 inch/sec**  
 $\Phi_m = 1.35E-02 \text{ cm}^2/\text{min}$

Average

$K_{fs} = 1.61E-03 \text{ cm/sec}$   
**9.67E-02 cm/min**  
**1.61E-05 m/s**  
**3.81E-02 inch/min**  
**6.34E-04 inch/sec**  
 $\Phi_m = 1.34E-02 \text{ cm}^2/\text{min}$

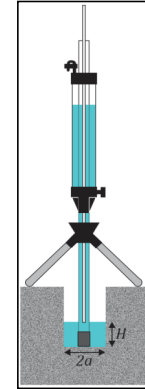

Calculation formulas related to shape factor (C). Where  $H_1$  is the first water head height (cm),  $H_2$  is the second water head height (cm),  $a$  is borehole radius (cm) and  $a^*$  is microscopic capillary length factor which is decided according to the soil texture-structure category. For one-head method, only C needs to be calculated while for two-head method,  $C_1$  and  $C_2$  are calculated (Zaig et al., 1998).

Soil Texture-Structure Category	$\alpha^*(\text{cm}^{-1})$	Shape Factor
Compacted, Structure-less, clayey or silty materials such as landfill caps and liners, lacustrine or marine sediments, etc.	0.01	$C_1 = \left( \frac{H_2/a}{2.081 + 0.121(H_2/a)} \right)^{0.672}$
Soils which are both fine textured (clayey or silty) and unstructured; may also include some fine sands.	0.04	$C_1 = \left( \frac{H_1/a}{1.992 + 0.091(H_1/a)} \right)^{0.683}$ $C_2 = \left( \frac{H_2/a}{1.992 + 0.091(H_2/a)} \right)^{0.683}$
Most structured soils from clays through loams; also includes unstructured medium and fine sands. The category most frequently applicable for agricultural soils.	0.12	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$
Coarse and gravelly sands; may also include some highly structured soils with large and/or numerous cracks, macro pores, etc.	0.36	$C_1 = \left( \frac{H_1/a}{2.074 + 0.093(H_1/a)} \right)^{0.754}$ $C_2 = \left( \frac{H_2/a}{2.074 + 0.093(H_2/a)} \right)^{0.754}$

Calculation formulas related to one-head and two-head methods. Where  $R$  is steady-state rate of fall of water in reservoir (cm/s),  $K_{fs}$  is Soil saturated hydraulic conductivity (cm/s),  $\Phi_m$  is Soil matric flux potential (cm<sup>2</sup>/s),  $a^*$  is Macroscopic capillary length parameter (from Table 2),  $a$  is Borehole radius (cm),  $H_1$  is the first head of water established in borehole (cm),  $H_2$  is the second head of water established in borehole (cm) and  $C$  is Shape Factor (from Table 2).

One Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$	$K_{fs} = \frac{C_1 \times Q_1}{2\pi H_1^2 + \pi a^2 C_1 + 2\pi \left( \frac{H_1}{a} \right)}$
One Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$	$\Phi_m = \frac{C_1 \times Q_1}{(2\pi H_1^2 + \pi a^2 C_1) a^* + 2\pi H_1}$
Two Head, Combined Reservoir	$Q_1 = \bar{R}_1 \times 35.22$ $Q_2 = \bar{R}_2 \times 35.22$	$G_1 = \frac{H_2 C_1}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $G_2 = \frac{H_1 C_2}{\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $K_{fs} = G_2 Q_2 - G_1 Q_1$ $G_3 = \frac{(2H_1^2 + a^2 C_1) C_1}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$
Two Head, Inner Reservoir	$Q_1 = \bar{R}_1 \times 2.16$ $Q_2 = \bar{R}_2 \times 2.16$	$G_4 = \frac{(2H_2^2 + a^2 C_2) C_2}{2\pi(2H_1 H_2 (H_2 - H_1) + a^2 (H_1 C_2 - H_2 C_1))}$ $\Phi_m = G_3 Q_1 - G_4 Q_2$