



SITE SERVICING BRIEF
135470-6.04.03

75 Michael Cowpland Drive

CITY OF OTTAWA

Development Application File No. **D07-12-22-0174**



Prepared for Huntington Properties
by IBI Group
December 2022
Revised: December 2023

Document Control Page

CLIENT:	Huntington Properties & Access Storage
PROJECT NAME:	60 Denzil Doyle Court
REPORT TITLE:	SITE SERVICING BRIEF 75 Michael Cowpland Drive
IBI REFERENCE:	135470-6.04.03
VERSION:	
DIGITAL MASTER:	[File Location]
ORIGINATOR:	[Name]
REVIEWER:	[Name]
AUTHORIZATION:	[Name]
CIRCULATION LIST:	
HISTORY:	

Table of Contents

1	INTRODUCTION.....	1
1.1	Scope	1
1.2	Subject Site	1
1.3	Previous Studies	2
1.4	Geotechnical Considerations	2
2	WATER SUPPLY	4
2.1	Existing Conditions	4
2.2	Design Criteria	4
	2.2.1 Water Demands	4
	2.2.2 System Pressure	4
	2.2.3 Fire Flow Rates	5
	2.2.4 Boundary Conditions	5
	2.2.5 Hydraulic Model	5
2.3	Proposed Water Plan.....	6
	2.3.1 Hydraulic Analysis	6
	2.3.2 Modeling Results	6
3	WASTEWATER DISPOSAL	8
3.1	Existing Conditions	8
3.2	Design Criteria	8
3.3	Recommended Wastewater Plan	8
4	SITE STORMWATER MANAGEMENT	9
4.1	Existing Conditions	9
4.2	Design Criteria	9

Table of Contents (continued)

4.3	Proposed Minor System	9
4.4	Stormwater Management.....	10
4.5	Inlet Controls.....	10
4.6	On-Site Detention	11
4.7	100 year + 20% Stress Test	12
4.8	Quality Control	12
5	GRADING AND ROADS.....	14
5.1	Site Grading.....	14
5.2	Road Network	14
6	SOURCE CONTROLS.....	15
6.1	General.....	15
6.2	Lot Grading.....	15
6.3	Vegetation.....	15
6.4	Groundwater Recharge	15
7	CONVEYANCE CONTROLS.....	16
7.1	General.....	16
7.2	Catchbasins and Maintenance Hole Sumps	16
8	SEDIMENT AND EROSION CONTROL PLAN.....	17
8.1	General.....	17
8.2	Trench Dewatering.....	17
8.3	Seepage Barriers.....	17
8.4	Surface Structure Filters	17
9	CONCLUSION	18

Table of Contents (continued)

List of Appendices

APPENDIX A

- Site Plan
- Legal Plan
- General Plan of Services Drawing C-001
- Notes of Pre-consultation

APPENDIX B

- City of Ottawa Boundary Conditions
- Watermain Demand Calculation Sheet
- FUS Fire Flow Requirement Calculation
- Modeling Output Files
- Water Entry Detail
- Correspondence from Architect and Mechanical Engineer

APPENDIX C

- Sanitary Sewer Design Sheet
- OPSD 1003.010 Drop Structure

APPENDIX D

- Storm Drainage Area Plan Drawing C-500
- Storm Sewer Design Sheet
- Ponding Plan Drawing C-600
- Stormwater Management Design Sheet
- Underground Storage Calculation Sheet
- Orifice Sizing Sheet
- Overflow Calculation
- IPEX ICD Specifications
- Kanata South Business Park – Stormwater Management Report
- OGS HydroDome Sizing Summary
- StormTech MC-3500 Underground Storage Chamber Details

APPENDIX E

- Grading Plan Drawing C-200
- Erosion and Sedimentation Control Plan Drawing C-900

1 INTRODUCTION

1.1 Scope

IBI Group has been retained by Huntington Properties & Access Storage to prepare the necessary engineering plans, specifications and documents to support the proposed Site Plan Application for the subject lands in accordance with the policies set out by the Planning and Development Branch of the City of Ottawa. This Brief will present a detailed servicing scheme to support development of the property, and will include sections on water supply, wastewater management, minor and major stormwater management along with erosion and sediment control.

1.2 Subject Site

The Self Storage Facility is located northeast of the Denzil Doyle Court and Terence Matthews Crescent intersection. The proposed Self Storage Facility development is approximately 1.66 hectares in size and is bounded by Denzil Doyle Court to the west, Terence Matthews Crescent to the south, Michael Cowpland Drive to the east, and multiple developed lots to the north. Please refer to **Figure 1** for more information regarding the site location.



Figure 1 Site Location

The Self Storage Facility project will consist of the construction of 6 prefabricated metal storage buildings, including 1 that will house a rental office, along with vehicular access routes, dedicated parking space and landscaping areas. A site plan of the envisioned development is included in **Appendix A**.

1.3 Previous Studies

Design of this project has been undertaken in accordance with the following reports:

- Kanata South Business Park – Stormwater Management Report prepared by A. J. Robinson & Associates Inc, February 1986

An engineering pre-consultation with the City of Ottawa was held in May 2021 regarding the proposed development. Notes from this meeting is included in **Appendix A**.

1.4 Geotechnical Considerations

Paterson Group Inc. was retained to prepare a geotechnical investigation for the site. The objectives of the investigation were to prepare a report to:

- Determine the subsoil and groundwater conditions at the site by means of test pits and boreholes and,
- To provide geotechnical recommendations pertaining to the design of the proposed development including construction considerations.

The geotechnical investigation report PG3798-2 Dated November 23, 2022 confirmed that the site consists mostly of silty clay. Based on the undrained shear strength testing results, a permissible grade raise of 0.8 m is recommended for the subject site and within 6 m of building footprints. A permissible grade raise restriction of up to 1.1 m is recommended for areas located a minimum of 6 m beyond building footprints. Grade raise exceeding the limits will require geotechnical investigation.

The report contains recommendations which include but are not limited to the following:

- Fill used for grading beneath the proposed development to meet OPSS Granular 'A' or Granular 'B' Type II placed in lifts no greater than 300 mm compacted to 98% SPMDD.
- Pavement Structure – Car Only Parking Areas:

LOCAL ROAD	THICKNESS
Asphaltic Concrete	50mm
OPSS Granular A Base	150mm
OPSS Granular B Type II Subbase	300mm

- Pavement Structure – Access Lanes and Heavy Truck Parking Areas:

LOCAL ROAD	THICKNESS
Asphaltic Concrete	90mm
OPSS Granular A Base	150mm
OPSS Granular B Type II Subbase	450mm

- Pipe bedding and cover: The pipe bedding for water and pipes placed on a relatively dry, undisturbed subgrade surface should consist of at least 150 mm of OPSS Granular A material. Where the bedding is located upon silty clay the thickness of the bedding material should be increased to a minimum of 300 mm of OPSS Granular A. The bedding layer should extend to the spring line of the pipe. Cover material, from the spring line to at least 300 mm above the obvert of the pipe should consist of OPSS Granular A or Granular B Type II. The bedding and cover materials should be placed in maximum 300 mm thick lifts compacted to a minimum of 99% of the material's SPMDD.
- The excavation side slopes above the groundwater level extending to a maximum depth of 3 m should be cut back at 1H:1V or flatter. The flatter slope is required for excavation below groundwater level.

2 WATER SUPPLY

2.1 Existing Conditions

As previously noted, the 1.66ha Self Storage Facility site is located east of Denzil Doyle Court, north of Terence Matthews Crescent, and east of Michael Cowpland Drive. The subject site is flanked on all three streets by existing watermains. An existing ductile iron 305mm diameter watermain is located within the Denzil Doyle Court right of way, the Terence Matthews Crescent right of way, and the Michael Cowpland right of way. All three watermains fall within the City of Ottawa's pressure district Pressure Zone 3 which will provide the water supply to the site.

2.2 Design Criteria

2.2.1 Water Demands

Water demands have been calculated for the full development. This site only consists of an office with an area of 94 m². Siamese connections will be provided for all 6 storage buildings. Per unit population density and consumption rates are taken from Tables 4.1 and 4.2 at the Ottawa Design Guidelines – Water Distribution and are summarized as follows:

- Commercial Shopping Center 2500 l/1000m²/day
- Other Commercial 28,000 l/gross ha/day
- ICI Average Day Demand 28,000 l/gross ha/day
- ICI peak Daily Demand 42,000 l/gross ha/day
- ICI Peak Hour Demand 75,600 l/gross ha/day

A watermain demand calculation sheet is included in **Appendix B** and the total water demands are summarized as follows:

- Average Day 0.0030 l/s
- Maximum Day 0.0046 l/s
- Peak Hour 0.0082 l/s

2.2.2 System Pressure

The Ottawa Design Guidelines – Water Distribution (WDG001), July 2010, City of Ottawa, Clause 4.2.2 states that the preferred practice for design of a new distribution system is to have normal operating pressures range between 345 kPa (50 psi) and 480 kPa (80 psi) under maximum daily flow conditions. Other pressure criteria identified in Clause 4.2.2 of the guidelines are as follows:

Minimum Pressure Minimum system pressure under peak hour demand conditions shall not be less than 276 kPa (40 psi)

Fire Flow	During the period of maximum day demand, the system pressure shall not be less than 140 kPa (20 psi) during a fire flow event.
Maximum Pressure	In accordance with the Ontario Building/Plumbing Code, the maximum pressure should not exceed 552 kPa (80 psi). Pressure reduction controls will be required for buildings where it is not possible/feasible to maintain the system pressure below 552 kPa.

2.2.3 Fire Flow Rates

The Self Storage Facility site plan contains 6 prefabricated buildings with automatic sprinkler system. All buildings will fall under OBC Section 3.10 “Self Service Storage Buildings”, F-2 Occupancy and non-combustible. The sprinkler system will be designed and installed in accordance with NFPA-13 requirements. The sprinkler system will be supplied from the city water connection and the demand will be calculated using the hazard classification plus the appropriate inside/outside hose allowances.

Calculations using the Fire Underwriting Survey (FUS version 2020) were conducted to determine the fire flow requirement for the site. Results of the analysis provides a maximum fire flow rate of 9,000 l/min or 150.0 l/s is required which is used in the hydraulic analysis. A copy of the FUS calculations is included in **Appendix B**.

2.2.4 Boundary Conditions

The City of Ottawa has provided the hydraulic boundary conditions at Denzil Doyle Court. A copy of the boundary conditions is included in **Appendix B** and summarized as follows:

Table 2. 1 Hydraulic Boundary Conditions

CRITERIA	HYDRAULIC HEAD
	Denzil Doyle Court
Max HGL (Basic Day)	161.1 m
Peak Hour	156.5 m
Max Day + Fire (9,000 l/m)	152.3 m

2.2.5 Hydraulic Model

A computer model for the subject site has been developed using the InfoWater program by Innovyze. The model includes the existing watermain and boundary condition at Denzil Doyle Court.

2.3 Proposed Water Plan

2.3.1 Hydraulic Analysis

A 150 mm watermain is proposed with the connection to the existing 300mm watermain at Denzil Doyle Court. 100mm water service is proposed to each building. Building A is the only building receiving potable water for daily use. There will be a 19mm diameter water feed from Building A to Building B for an automatic trap primer. Only Building A will have a domestic water metering. Building A water service line will be branched off to Building B after the water meter. Detailed water entry detail for each building is included in **Appendix B**. The 100mm watermain services for Building B – F are marked in the plan as fire service. Refer to the general plan of services **Drawing C-001** for detailed watermain layout for the subject site. A private hydrant is proposed to the north of Building D, with a design fire flow of 9000 L/min (150 L/s).

The hydraulic model was run under basic day conditions to determine the maximum pressure for the site. The minimum pressure for the site is determined in the peak hour analysis using the provided boundary condition. Results of the analysis for the site are summarized in Section 2.3.2 and the water model schematic and model results are included in **Appendix B**.

2.3.2 Modeling Results

The hydraulic model was run under basic day, maximum day with fire flows and under peak hour conditions. Results of the hydraulic model are included in **Appendix B** and summarized as follows:

Scenario

Basic Day (Max HGL) Pressure Range	576.19 to 580.60 kPa
Peak Hour (Min HGL) Pressure Range	531.12 to 535.53 kPa
Available Fire Flow under Max Day Scenario	212.47 L/s

A comparison of the results and design criteria is summarized as follows:

Maximum Pressure	All nodes in basic day scenario exceed 552 kPa (80 psi), therefore pressure reducing control is required for all buildings in this development, including the fire department connections to Building B to F. Pressure reducing valves (PRVs) are shown in both General Plan of Services Drawing C-001 and Grading Plan C-200.
Minimum Pressure	All nodes in the model exceed the minimum value of 276 kPa (40 psi).
Fire Flow	The required fire flow will be provided through the public hydrants and a private hydrant on site. The private hydrant provides 212.47 L/s of available fire flow, which is larger than the required fire flow 150 L/s (9000 L/min). There are 4 public hydrants around the site, 2 located on Michael Cowpland Drive, 1 on Terence Matthews Crescent and 1 on Denzil Doyle Court. All 4

hydrants are rated Class AA, which can provide 1500 GPM (5678 L/min) and above flow rate. All buildings are covered with at least 1 hydrant with 76m and 1 hydrant within 152m. According to Table 18.5.4.3 Maximum Fire Flow Hydrant Capacity - Ottawa Design Guidelines, a total of 5678 L/min + 3785 L/min = 9463 L/min fire flow can be provided, which is larger than required fire flow 9000 L/min. Therefore, the existing public can provide sufficient fire flow for the site.

3 WASTEWATER DISPOSAL

3.1 Existing Conditions

There is an existing 250mm diameter sanitary sewer along Denzil Doyle Court, and a 250mm diameter sanitary sewer along Michael Cowpland Drive. To the south of the site, an existing 250mm diameter sanitary sewer on Terence Matthews Crescent provides deeper sewer connection to service the site.

3.2 Design Criteria

The sanitary sewers for the subject site will be based on the City of Ottawa design criteria. It should be noted that the sanitary sewer design for this study incorporates the latest City of Ottawa design parameters identified in Technical Bulletin ISTB-2018-01. Some of the key criteria will include the following:

- Average commercial flow = 28,000 l/s/ha
- Peak ICI flow factor = 1.5 if ICI area is \leq 20% total area
1.0 if ICI area is $>$ 20% total area
- Inflow and Infiltration Rate = 0.33 l/s/ha
- Minimum Full Flow Velocity = 0.60 m/s
- Maximum Full Flow Velocity = 3.0 m/s
- Minimum Pipe Size = 200 mm diameter

3.3 Recommended Wastewater Plan

The on-site sanitary system will consist of 200mm PVC sewer installed at normal depth and slope and will provide a single 100mm service connection to the commercial building pad (Building A with office). Another 100mm sanitary service connection is proposed to Building B. The sewers have been designed using the criteria noted above in section 3.2 and outlet via a connection to the sanitary sewer within the Terence Matthews Crescent right of way to the south of the site. A copy of the sanitary sewer design sheet can be found in **Appendix C**. Please refer to the General Plan of Services **Drawing C-001** for further details.

4 SITE STORMWATER MANAGEMENT

4.1 Existing Conditions

The existing undeveloped subject lands currently drains south towards Terence Matthews Crescent and Michael Cowpland Drive. There is an existing 375mm diameter storm sewer along Michael Cowpland Drive, and a 450mm diameter storm sewer along Denzil Doyle Court. To the south of the site, the existing 375mm diameter storm sewer on Terence Matthews Crescent provides deep sewer connection to service the site.

4.2 Design Criteria

The stormwater system was designed following the principles of dual drainage, making accommodations for both major and minor flow.

Some of the key criteria include the following:

- Design Storm 1:2year return (Ottawa)
- Rational Method Sewer Sizing
- Initial Time of Concentration 10 minutes
- Runoff Coefficients
 - Landscaped Areas C = 0.30
 - Asphalt/Concrete C = 0.90
 - Roof C = 0.90
- Pipe Velocities 0.80 m/s to 6.0 m/s
- Minimum Pipe Size 250 mm diameter
(200 mm CB Leads)

4.3 Proposed Minor System

The minor storm sewers for the subject site will be sized based on the rational method and the City of Ottawa 2-year event. Minor storm flow to the downstream storm sewer network will be controlled by Inlet Control Devices (ICDs) to limit flow and prevent sewer surcharging downstream. A detailed storm sewer design sheet and the associated storm sewer drainage area plan is included in **Appendix D**. The sites outletting sewers, downstream of ICD's, have been sized such that they do not exceed the size of the connection sewers in the public ROW, however that they are able to convey the fixed flow generated by each respective ICD. The General Plan of Services, depicting all on-site storm sewers can be found in **Appendix A**.

4.4 Stormwater Management

The subject site will be limited to a release rate established using the criteria described in section 4.2 and the Stormwater Management Report for the Kanata South Business Park. This will be achieved through a combination of inlet control devices (ICD's) at inlet locations and a combination of surface and underground storage.

Flows generated that are in excess of the site's allowable release rate will be stored on site in strategic surface storage areas or underground storage and gradually released into the minor system so as not to exceed the site's allocation.

The maximum surface retention depth located within the developed areas will be limited to 300mm during a 100-year event. Overland flow routes will be provided in the grading to permit emergency overland flow, in excess of the 100-year event, from the site.

At certain locations within the site, the opportunity to store runoff is limited due to grading constraints and building geometry. These locations are generally located at the perimeter of the site where it is necessary to tie into public boulevards and adjacent properties or in areas where ponding stormwater is undesirable. These "uncontrolled" areas – 0.0456 hectares in total, have a C value of 0.30 (X1.25 as per City Comment). Based on 100-year storm uncontrolled flows, the uncontrolled areas generate 8.49 l/s runoff (refer to Section 4.5 for calculation).

The site grading and ponding has been designed to control water generated during the 1:100-year event, with no overflow leaving the site. Please refer to the SWM calculations in **Appendix D**.

4.5 Inlet Controls

The allowable release rate for the 1.66 Ha site can be calculated as follows:

$$\begin{aligned}
 Q_{\text{allowable}} &= 74.2 \text{ L/s/Ha as per Kanata South Business Park SWM Report} \\
 \text{Area} &= 1.66 \text{ Ha} \\
 &= \mathbf{123.17 \text{ L/s}}
 \end{aligned}$$

As noted in Section 4.4, the landscaped area along south which will into the storm sewer uncontrolled.

Based on a 100-year event, the flow from the 0.04 Ha uncontrolled area can be determined as:

$$\begin{aligned}
 Q_{\text{uncontrolled}} &= \mathbf{2.78 \times C \times i_{100\text{yr}} \times A} \text{ where:} \\
 C &= \text{Average runoff coefficient of uncontrolled area} = 0.2 \\
 i_{100\text{yr}} &= \text{Intensity of 100-year storm event (mm/hr)} \\
 &= 1735.688 \times (T_c + 6.014)^{0.820} = 178.56 \text{ mm/hr; where } T_c = 10 \text{ minutes} \\
 A &= \text{Uncontrolled Area} = 0.0456 \text{ Ha}
 \end{aligned}$$

Therefore, the uncontrolled release rate can be determined as:

$$\begin{aligned} Q_{\text{uncontrolled}} &= 2.78 \times C \times i_{100\text{yr}} \times A \\ &= 2.78 \times 0.3 \times 1.25 \times 178.56 \times 0.0456 \\ &= 8.49 \text{ L/s} \end{aligned}$$

The maximum allowable release rate from the remainder of the site can then be determined as:

$$\begin{aligned} Q_{\text{max allowable}} &= Q_{\text{restricted}} - Q_{\text{uncontrolled}} \\ &= 123.17 \text{ L/s} - 8.49 \text{ L/s} \\ &= 114.68 \text{ L/s} \end{aligned}$$

Based on the flow allowance at the various inlet locations, a combination of various sizes of inlet control devices (ICDs) were chosen in the design. The design of the inlet control devices is unique to each drainage area and is determined based on various factors, including hydraulic head and allowable release rate. The inlet control devices were sized according to the manufacturer's design charts. The restrictions will cause the on-site catchbasins and manholes to surcharge, generating surface ponding in the parking and landscaped areas. Ponding locations and elevations are summarized on the Ponding Plan **Drawing C-600**, and included in **Appendix D**.

4.6 On-Site Detention

The site was designed to limit runoff to the allowable release rate up to the 100-year storm event. Flows exceeding the 2-year storm, up to the 100-year storm will be contained on-site via surface and underground in-line storage. Orifices in manholes will be employed to control runoff from parking, access and landscape areas. To determine the resulting storage volumes a 2-year and 100-year storm was applied, starting at 2 minutes with time steps of 5 minutes interval until a peak storage volume requirement was attained for the sub-area being controlled. Available ponding volumes at each inlet were calculated using in-line structure volumes during the 100-year events.

The modified rational method was used to calculate maximum storage required for a given release rate. As per accepted convention, when underground storage is considered available storage the ICD release rate is to be reduced by 50% to account for the loss of head during the initial part of the rainfall event while the underground portion of the storage fills with runoff.

Major flow up to the 100-year storm is contained on-site and is gradually released to the minor system, aside from the small uncontrolled areas, major flow does not leave the site via overland flow.

The stormwater management for the site has ensured that there will be no surface ponding during the 2-year storm event except in the landscaped area.

A stormwater management summary sheet and the results of the on-site storage volume requirements are included in **Appendix D**.

A summary of the ICD type for each drainage area and corresponding storage details is provided in Table 4.1 below.

Table 4.1 – Post-Development Storage Summary Table

Post-Development Flows						
Drainage Area	ICD TYPE	Restricted /Uncontrolled Flow (L/s)	Storage Required (m ³)	Storage Provided (m ³)		
		100-year	100-year	Surface	Underground	Total
UNCONTROLLED FLOW						
UN	N/A	8.49	N/A	N/A	N/A	
CONTROLLED STORM SEWER SYSTEM						
Area Tributary to CBMH106	TEMPEST HF	108.00	491.76	142.87	349.64	492.51
Area Tributary to CBMH140	TEMPEST LMF	6.00	40.86	67.70	-	67.70
TOTAL RESTRICTED RELEASED RATE						
		122.49				

4.7 100 year + 20% Stress Test

A cursory review of the 100yr event + 20% has been performed using the modified rational method. The Peak flow from each area during a 100year event has been increased by 20%. The calculations have been included in **Appendix D**.

A summary of the require storage volumes, and overflow balances is provided below.

DRAINAGE AREA	ICD RESTRICTED FLOW (L/s)	100yr20 STORAGE REQUIRED (m ³)	TOTAL STORAGE PROVIDED (m ³)	100yr20 OVERFLOW (m ³)
Area Tributary to CBMH106	108.00	623.81	492.51	131.30
Area Tributary to CBMH140	6.00	52.28	67.70	0

The overland flow from the area tributary to CBMH106 is directed to Denzil Doyle Court. The volume of overflow is 131.30 m3. Based on a Tc of 50minutes, this volume can be reverse calculated to 42.08 L/s. Based on the spill point cross section, at the limit of the access, a simple rectangular channel with a bottom of 8.50m, at a grade of 2.0% can convey 42.08 L/s @ a depth of 0.01m. Therefore, the 100year +20% overflow of 42.08 L/s will have a maximum overflow depth of 0.01m (Ponding 102.06m). Refer to **Appendix D** for detailed overflow calculation.

4.8 Quality Control

According to Kanata South Business Park – Stormwater Management Report, the water quality aspects of the development were addressed with the following conclusions being presented:

- The light industrial/business park type industries are considered to produce a relatively low level of pollutants.
- The development is in the upper reaches of a large watershed draining to the Rideau River. The outlet from the site is to a municipal drain which is running at a very flat grade, thereby, presenting ample opportunity for pollutants to settle out.
- On-site control of stormwater by parking lot and possibly roof top storage will result in a reduction of pollutant loadings.
- Laboratory and field observations, indicate that installation of an orifice in the outlet of a catchbasin with a sump, has brought about a greater retention of grit and other solids after a storm event than observed with a conventional storm sewer outlet. The constricted release of flow from the orifice causes stormwater to backup in the catchbasin thereby keeping the turbulent zone of the water away from the sump and reducing velocities in the catchbasin. These actions facilitate settling of suspended solids into the sump.

Based on the above, it is felt that the proposed quantity control measures will also serve to ensure that the proposed development will not unduly affect the quality of water flowing from the site into Monahan Creek and thus to the Rideau River. Correspondence with RVCA regarding the water quality control is attached in **Appendix D**.

To provide sufficient water quality control, an OGS is proposed before the storm outlet to the street. An 80% of TSS removal is provided by the OGS. Detailed calculation and specifications for the OGS are included in **Appendix D**.

5 GRADING AND ROADS

5.1 Site Grading

The existing grades within portions of the proposed development lands vary due to the existing topography of the site. The grading plan will require the balancing of various requirements including but not limited to geotechnical constraints, minimum/maximum slopes, overland routing of stormwater, all to ensure the site is graded in accordance with municipal standards.

Refer to the grading plan provided in **Appendix E**.

A retaining wall exceed 1.0m in height is anticipated along the north eastern property lines. A retaining wall less than 600mm height is anticipated along Terrance Mathews Drive. Terracing has been utilized around the balance of the perimeter to tie the proposed grading into existing.

5.2 Road Network

No public roads are proposed through the site. Minimum 6.0m wide drive aisle have been provided, as shown on the Site Plan in **Appendix A**. An internal Fire route has been shown where fire truck access is required, as determined by the site architect.

There are 52 parking stalls provided on the site, of which 3 are barrier free.

Noise attenuation features and indoor noise clause provisions will not be required commercial use lands for road noise generated by the adjacent roads.

6 SOURCE CONTROLS

6.1 General

Since an end of pipe treatment facility is already provided for the development lands, stormwater site management for the subject lands will focus on site level or source control management of runoff. Such controls or mitigative measures are proposed for this development not only for final development but also during construction and build out. Some of these measures are:

- flat site grading where possible
- vegetation planting
- groundwater recharge in landscaped areas

6.2 Lot Grading

Where possible, all of the proposed blocks within the development will make use of gentle surface slopes on hard surfaces such as asphalt and concrete. In accordance with local municipal standards, all grading will be between 0.5 and 5.0 percent for hard surfaces and 2.0 and 7.0 percent for all landscaped areas. Significant grade changes will be accomplished through the use of terracing (3:1 max slope), ramps and/or retaining walls. All street and parking lot catchbasins shall be equipped with 3.0m subdrains on opposite sides of a curbside catchbasin running parallel to the curb, and with 3.0m subdrains extending out from all 4 sides of parking lot catchbasins.

6.3 Vegetation

As with most site plans, the developer will be required to complete a vegetation and planting program. Vegetation throughout the development including planting along roadsides and within the individual blocks provides opportunities to re-create lost vegetation.

6.4 Groundwater Recharge

Groundwater recharge targets have not been identified for this site. Perforated sub-drain systems will be implemented at capture locations in all vegetated areas. This will promote increased infiltration during low flow events before water is collected by the storm sewer system.

7 CONVEYANCE CONTROLS

7.1 General

Besides source controls, the development also proposes to use several conveyance control measures to improve runoff quality. These will include:

- vegetated swales; and
- catchbasin sumps and manhole sumps.

7.2 Catchbasins and Maintenance Hole Sumps

All catchbasins within the development, either rear yard or street, will be constructed with minimum 600 mm deep sumps. These sumps trap pollutants, sand, grit and debris which can be mechanically removed prior to being flushed into the minor pipe system. Both rear yard and street catchbasins will be to OPSD 705.02. All storm sewer maintenance holes serving local sewers less than 900 mm diameter shall be constructed with a 300 mm sump as per City standards.

8 SEDIMENT AND EROSION CONTROL PLAN

8.1 General

During construction, existing stream and conveyance systems can be exposed to significant sediment loadings. Although construction is only a temporary situation, it is proposed to possibly introduce a number of mitigative construction techniques to reduce unnecessary construction sediment loadings. These may include:

- Until the local storm sewer is constructed, groundwater in trenches will be pumped into a filter mechanism prior to release to the environment;
- sediment capture filter socks will remain on open surface structures such as maintenance holes and catchbasins until these structures are commissioned and put into use; and
- silt fence on the site perimeter will be installed.

8.2 Trench Dewatering

Any trench dewatering using pumps will be discharged into a filter trap made up of geotextile filters and straw bales similar in design to the OPSD 219.240 Dewatering Trap. These will be constructed in a bowl shape with the fabric forming the bottom and the straw bales forming the sides. Any pumped groundwater will be filtered prior to release to the existing surface runoff. The contractor will inspect and maintain the filters as needed, including sediment removal and disposal and material replacement as needed. It should be noted that that the contractor will be responsible for the design and management of the trap(s).

8.3 Seepage Barriers

In order to further reduce sediment loading to the stormwater management facility, seepage barriers will be installed on any surface water courses at appropriate locations that may become evident during construction. These barriers will be Light Duty Straw Bale Barriers per OPSD 219.100 and Heavy-Duty Silt Fence Barriers per OPSD 219.130; locations are shown on the Sediment and Erosion Control Plan included in **Appendix E**. They are typically made of layers of straw bales or geotextile fabric staked in place. All seepage barriers will be inspected and maintained as needed.

8.4 Surface Structure Filters

All catchbasins, and to a lesser degree, manholes, convey surface water to sewers. Until streets are asphalted and curbed, all catchbasins and manholes will be constructed with sediment capture inserts or equivalent located between the structure frame and cover. These will stay in place and be maintained during construction and build until it is appropriate to remove same.

9 CONCLUSION


This report has illustrated that the proposed Kanata West Center development can be serviced via existing municipal services. The water network will be extended to provide necessary service. All sanitary and storm sewer designs for this development will be completed in conformance with City of Ottawa standards while acknowledging downstream constraints. By limiting flow into the minor storm sewer system as per the applicable local stormwater management criteria and allowing for excess surface storage on-site, all stormwater management requirements will be met. Adherence to the Sediment and Erosion Control Plan during construction will minimize harmful impacts on surface water.

Based on the information provided within this report, the plans prepared for the subject development can be serviced to meet City of Ottawa requirements.



Demetrius Yannouloupoulos, P. Eng.
Director – Office Lead

Ryan Magladry, C.E.T
Project Manager



Amy Zhuang, P.ENG.
Project Engineer

APPENDIX A

- Site Plan
- Legal Plan
- General Plan of Services Drawing C-001
- Notes of Pre-consultation




COPYRIGHT NOTICE
THIS DRAWING AND DESIGN IS COPYRIGHT PROTECTED.
DO NOT REPRODUCE OR REVISE WITHOUT WRITTEN
PERMISSION BY ARCHITECTURE49 INC.



THIS BAR IS 25mm LONG WHEN PLOTTED AT
CORRECT SCALE. DO NOT SCALE DRAWINGS.

NORTH ARROW: DIGITAL REFERENCE:



PROJECT NO: 229-00058-11 CONTRACT NO.

DRAWN BY: NMAS CHECKED BY: JCAB APPROVED BY: Approver

KEYPLAN:

2023.11.13 ISSUED FOR SITE PLAN RESUBMISSION
2023.09.20 ISSUED FOR SITE PLAN RESUBMISSION
NO. DATE ISSUED

PROJECT

DRAWING TITLE


SITE PLAN - GENERAL

DRAWING NO.


A101

#18895

PRINT DATE: 12/14/2023 12:06:42 PM
D07-12-22-0174

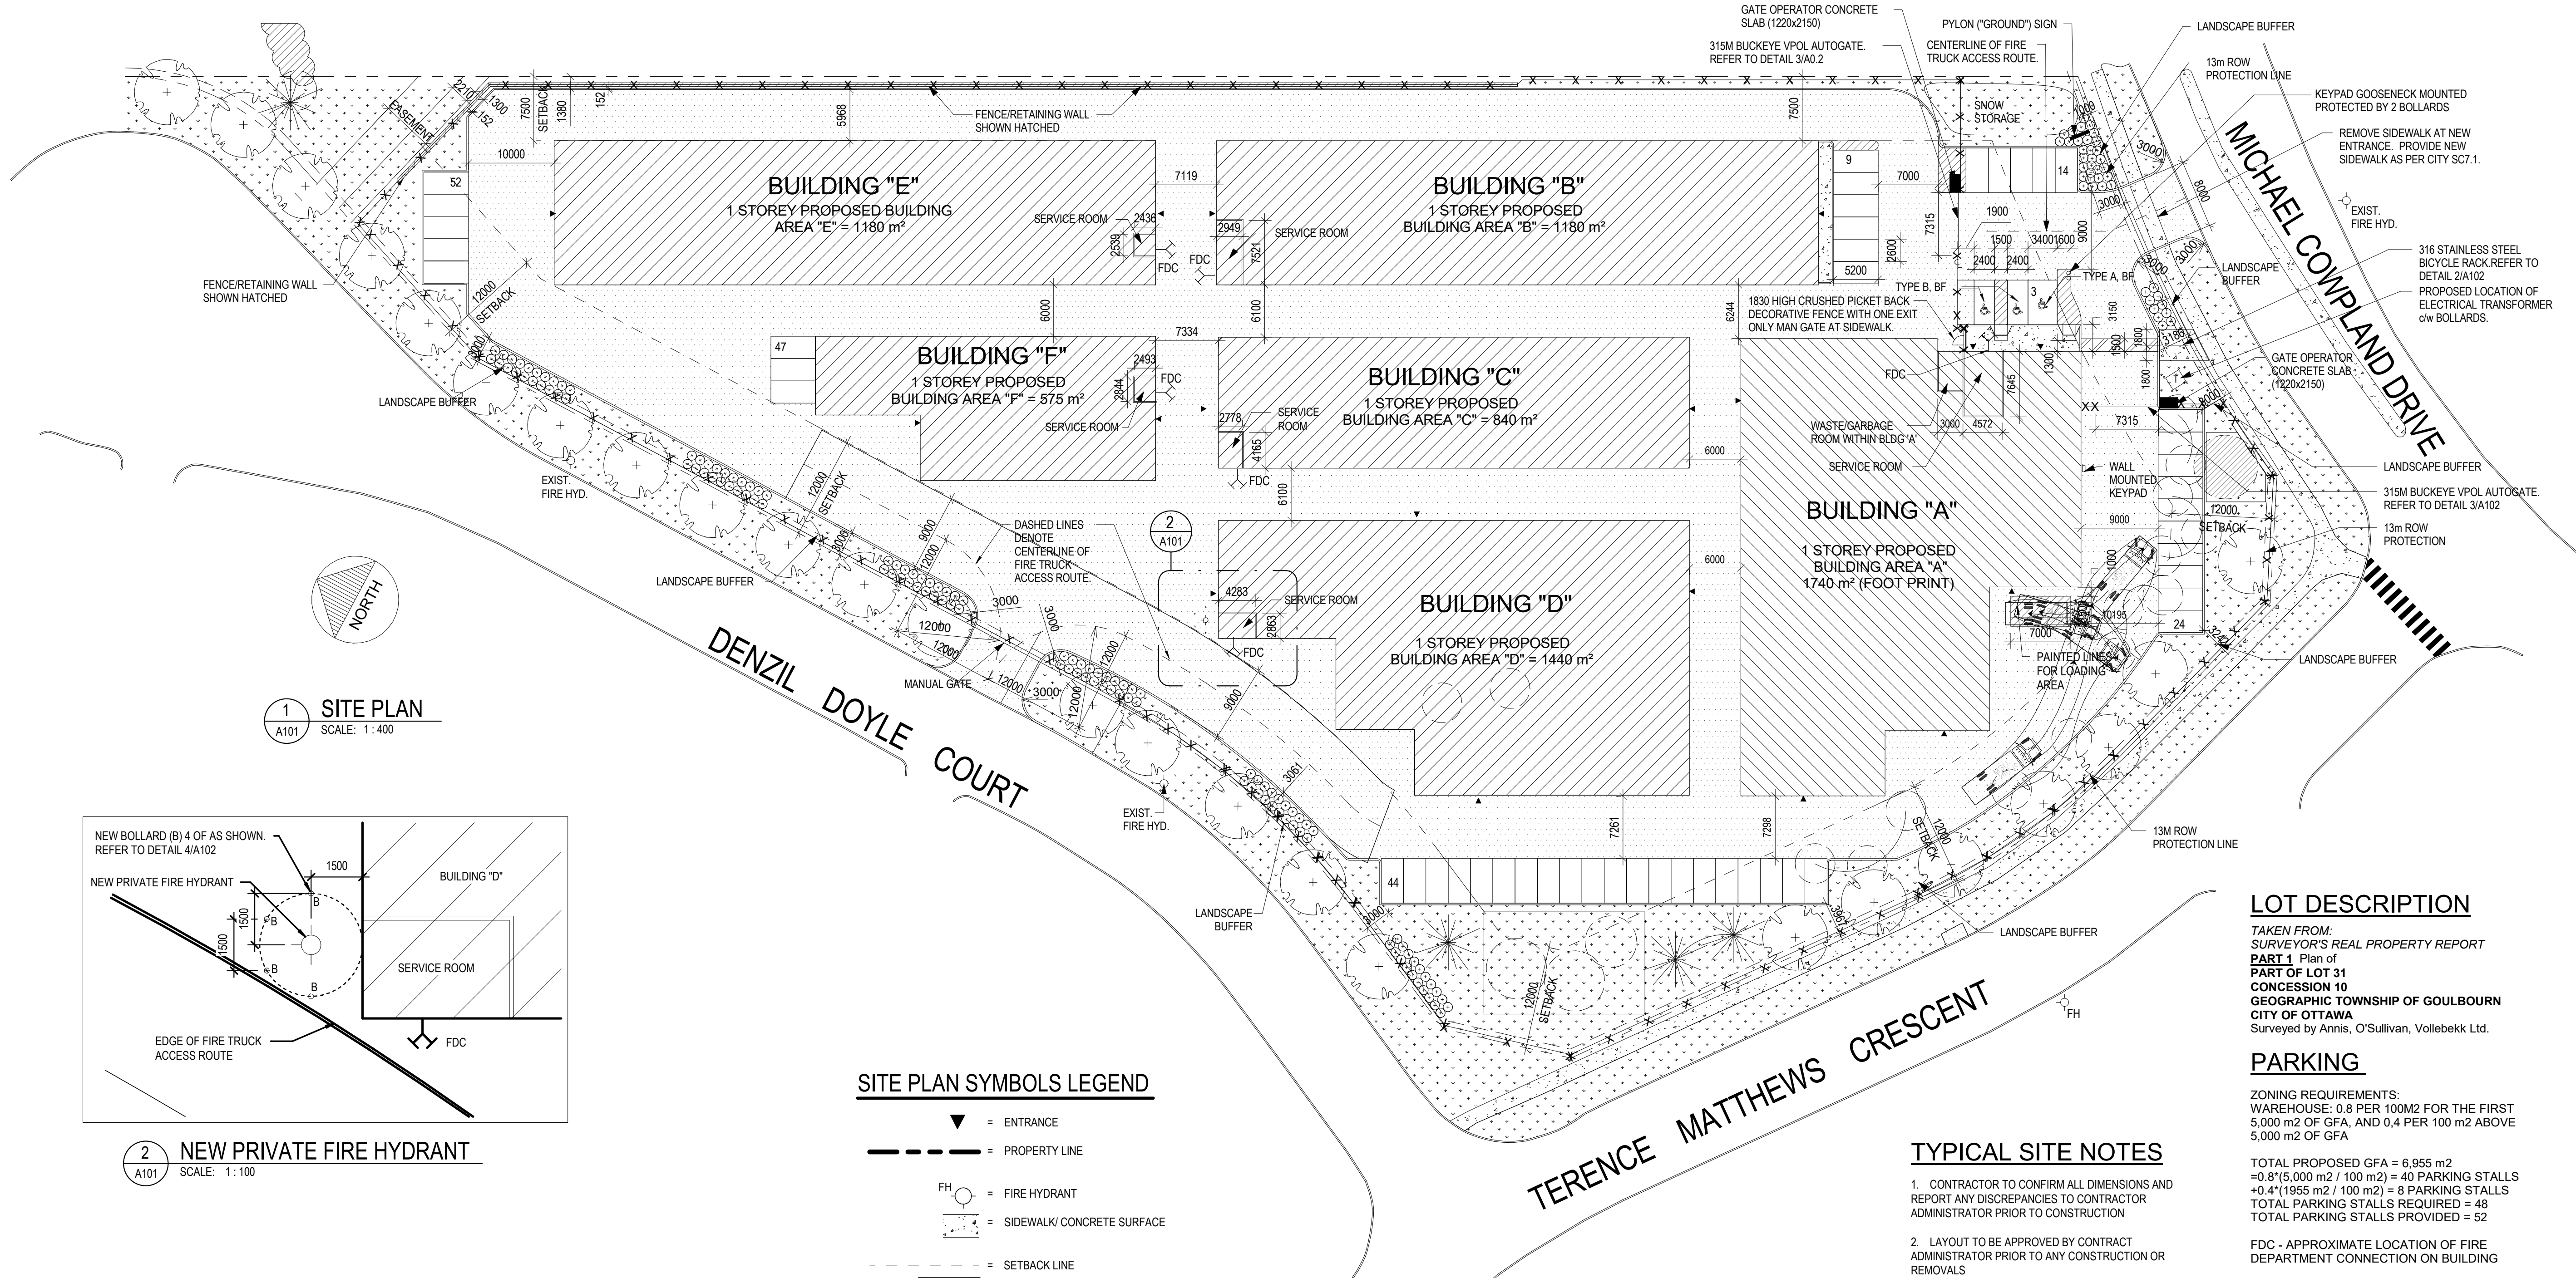

1 SITE PLAN
A101 SCALE: 1:400

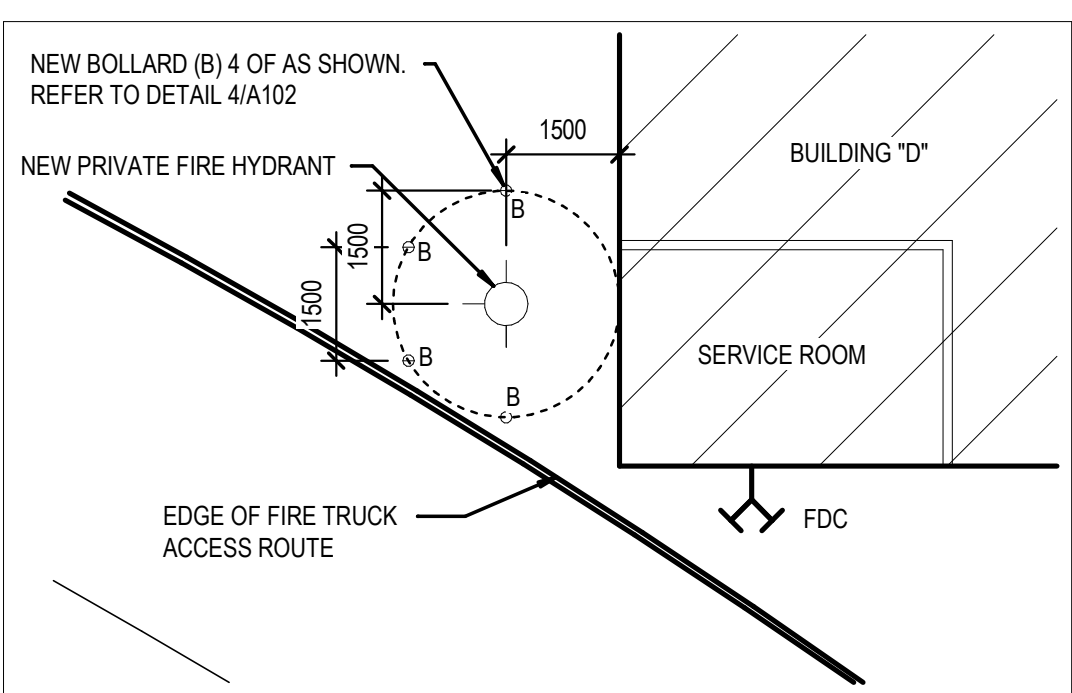

SITE PLAN SYMBOLS LEGEND

- ▼ = ENTRANCE
- — — = PROPERTY LINE
- FH = FIRE HYDRANT
- = SIDEWALK/ CONCRETE SURFACE
- - - = SETBACK LINE
- = GRASS
- X — X — X = FENCE LINE
- ▨ = LANDSCAPING
- ▨ = ASPHALT
- ▨ = PAINTED LINES
- ⊠ = PADMOUNT TRANSFORMER BY HYDRO OTTAWA. PROVIDE TRANSFORMER BASE TO HYDRO OTTAWA STANDARDS. PRECAST TRANSFORMER BASE AND BOLLARDS BY GENERAL CONTRACTOR. REFER TO HYDRO OTTAWA STANDARD DETAILS UFS0001, UGS0002 AND UTS0038.
- = BOLLARD
- = DENOTES TREE TO BE REMOVED
- = DENOTES TREE TO REMAIN
- ☼ = DENOTES NEW TREE. REFER TO LANDSCAPE
- ☼ = DENOTES NEW TREE. REFER TO LANDSCAPE

ZONING

75 Michael Cowpland Drive
SITE INFORMATION
Legal Description:
Part of Lot 31, Concession 10, Geographic Township of Goulbourn, City of Ottawa
Municipal Address:
75 Michael Cowpland Drive, Kanata, ON
Site Area:
16,575 m² (178,411.8 ft²)
Building Area:
Existing: N/A
Proposed: 8,243 m² (88,726.91 ft²)
ZONING INFORMATION:
Zoning:
Business Park Industrial, Subzone 4 – Kanata South Business Park (IP4)
Lot Coverage (Sec 205, Table 205):
Required: 55% (maximum)
Proposed: 41%
Building Height (Sec. 205, Table 205(h)):
Required: 22 m (maximum)
Proposed: 6.6 m
Floor Space Index (Sec. 205, Table 205(g)):
Required: 2 (maximum)
Proposed: 0.5
Required Yards (Sec. 206, Table 206B):
Min. Front Yard: Building A - 12 m (12 m required)
Min. Interior Side Yard: Buildings B and E - 7.5 m (7.5 m required)
Min. Rear Side Yard: 12 m (7.5 m required)

TYPICAL SITE NOTES

- CONTRACTOR TO CONFIRM ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO CONTRACTOR ADMINISTRATOR PRIOR TO CONSTRUCTION
- LAYOUT TO BE APPROVED BY CONTRACT ADMINISTRATOR PRIOR TO ANY CONSTRUCTION OR REMOVALS
- ALL DIMENSIONS ARE IN METRIC UNLESS OTHERWISE NOTED
- CONTRACTOR IS RESPONSIBLE FOR ALL EXCAVATIONS, REMOVALS, DISPOSALS AND ROUGH GRADING AS REQUIRED TO CONSTRUCTION ALL WORKS AS SHOWN ON ALL PLANS, DETAILS AND SPECIFICATIONS
- LOCATION OF ALL UTILITIES SHOWN FOR ILLUSTRATION ONLY. CONTRACTOR MUST CONTACT ALL UTILITIES REGARDING RULES FOR WORKING IN THE AREA OF THE UTILITIES PRIOR TO COMMENCEMENT OF ANY WORK. CONTRACTOR MUST CONFIRM LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION
- ALL EXISTING ROADS, SIDEWALKS, CURBS, FENCING, PAVING, SODDED AREAS, AND APPROACHES, ETC. TO REMAIN TO BE PROTECTED DURING CONSTRUCTION TO CONTRACT ADMINISTRATOR'S APPROVAL AT THE CONTRACTOR'S OWN COSTS.
- ALL EXISTING TREES, SHRUB BEDS, MULCH BEDS, AND SOD TO REMAIN TO BE PROTECTED DURING CONSTRUCTION. AREAS DAMAGED DURING CONSTRUCTION TO BE REPAIRED TO CONTRACT ADMINISTRATOR'S APPROVAL AT THE CONTRACTOR'S OWN COST.
- USE SPECIFIED BACKFILL IN ALL TRENCHES RUNNING BELOW ALL STRUCTURES, PAVING, WALKWAYS, ETC.
- FILL ALL HOLES AND LOW AREAS TO DESIGN SUBGRADE WITH COMPACTED FILL (SUITABLE TO SURFACE FINISH). FOR SODDED/PLANTED AREAS USE COMPACTED CLEAN EARTH FILL SUITABLE FOR PLANT GROWTH. FOR PAVED AREAS USE COMPACTED GRANULAR BASE.
- ALL TREES WITHIN OR IMMEDIATELY ADJACENT TO AREA OF WORK TO BE PROTECTED TO CITY OF OTTAWA TREE PROTECTION STANDARDS.
- REFER TO LANDSCAPE DRAWINGS FOR LOCATIONS OF ALL EXISTING, REMOVED, AND PROPOSED TREE AND SHRUB PLANTING

LOT DESCRIPTION

TAKEN FROM:
SURVEYOR'S REAL PROPERTY REPORT
PART 1 Plan of
PART OF LOT 31
CONCESSION 10
GEOGRAPHIC TOWNSHIP OF GOULBOURN
CITY OF OTTAWA
Surveyed by Annis, O'Sullivan, Vollebek Ltd.

PARKING

ZONING REQUIREMENTS:
WAREHOUSE: 0.8 PER 100M² FOR THE FIRST 5,000 m² OF GFA, AND 0.4 PER 100 m² ABOVE 5,000 m² OF GFA
TOTAL PROPOSED GFA = 6,955 m²
= 0.8(5,000 m² / 100 m²) = 40 PARKING STALLS
+ 0.4(1955 m² / 100 m²) = 8 PARKING STALLS
TOTAL PARKING STALLS REQUIRED = 48
TOTAL PARKING STALLS PROVIDED = 52
FDC - APPROXIMATE LOCATION OF FIRE DEPARTMENT CONNECTION ON BUILDING NOTED

SITE SUMMARY

EXISTING LOT AREA 16575 SQ.M
PROPOSED BUILDING "A" 1740 SQ.M
PROPOSED BUILDING "B" 1180 SQ.M
PROPOSED BUILDING "C" 840 SQ.M
PROPOSED BUILDING "D" 1440 SQ.M
PROPOSED BUILDING "E" 1180 SQ.M
PROPOSED BUILDING "F" 575 SQ.M
TOTAL PROPOSED G.F.A. 6,955 SQ.M
LOT COVERAGE 6955 42% PROPOSED
THE MAXIMUM PERMITTED LOT COVERAGE IS 55% AS PER TABLE 205(C)

ONTARIO BUILDING CODE

- SITE PLAN AND BUILDING DESIGN IS BASED ON "SECTION 3.10. SELF-SERVICE STORAGE BUILDINGS".
- OCCUPANCY CLASSIFICATION IS F-2, BUILDING IS SPRINKLERED. CONSTRUCTION IS NON-COMBUSTIBLE. OCCUPANT LOAD DOES NOT APPLY.
- SPATIAL SEPARATIONS DOES NOT APPLY BETWEEN BUILDINGS AS PER OBC 3.10.4.3 (4). THE DISTANCE BETWEEN INDIVIDUAL BUILDINGS SHALL NOT BE LESS THAN 6M.
- PER OBC 3.10, PROVISIONS FOR FIRE FIGHTING MEETS 9M WIDE ACCESS ROUTE AND UNOBSTRUCTED PATH OF TRAVEL FOR THE FIREFIGHTER FROM THE VEHICLE TO THE FIRE DEPARTMENT CONNECTION (FDC) OF MAX. 45M.
- BUILDING IS EXEMPT PER OBC, MMA SUPPLEMENTARY STANDARD SB-10, DIVISION 3, ENERGY EFFICIENCY DESIGN AFTER DECEMBER 31, 2016, PER SECTION 1.2.1.1 (1)(d) AND 1.2.1.1 (2)(b).


TOPOGRAPHIC PLAN OF SURVEY OF
PART OF LOT 31
CONCESSION 10
GEOGRAPHIC TOWNSHIP OF GOULBOURN
CITY OF OTTAWA
 Surveyed by Annis, O'Sullivan, Vollebek Ltd.

Scale 1 : 300
 METRIC SCALES ON THIS PLAN ARE INTERFERED AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

Surveyor's Certificate
 I, the undersigned, being a duly qualified and licensed Surveyor, do hereby certify that the above plan and map were prepared by me or under my direct supervision and that I am a duly qualified and licensed Surveyor under the Survey Act and the regulations made under them.
 The survey was completed on the 1st day of November, 2022.



Notes & Legend
 Densities
 Survey Monument Pinned
 Survey Monument Round
 SSB
 Short Standard Iron Bar
 Iron Bar
 Round Iron Bar
 Witness
 (100)
 Annis, O'Sullivan, Vollebek Ltd.
 Plan BR-10105
 (1892) Plan March 3, 2018
 Plan BR-12118
 Plan BR-12248
 Plan BR-12112
 Decision Tree
 Coniferous Tree
 Fire Hydrant
 Water Stand Post
 Maintenance Hole (Storm Sewer)
 Maintenance Hole (Sanitary)
 Maintenance Hole (Traffic)
 Maintenance Hole (Hydro)
 Maintenance Hole (Underdrain)
 Valve Chamber (Watermain)
 Underground Storm Sewer
 Underground Sanitary Sewer
 Underground Water Main
 Overhead Water
 Catch Basin
 Ball Terminal Box
 Cable Terminal Box
 Undersized Terminal Box
 Light Standard
 Diameter
 Location of Elevations
 Top of Concrete Curt. Elevation

Barangs are not derived from CANMAD 2018 Real Time Network (original) or from the National Hydrographic Survey (NHS) (original). For bearing comparisons, a rotation of 0.0007° counter-clockwise counter-clockwise was applied to bearings on P3 & P4.

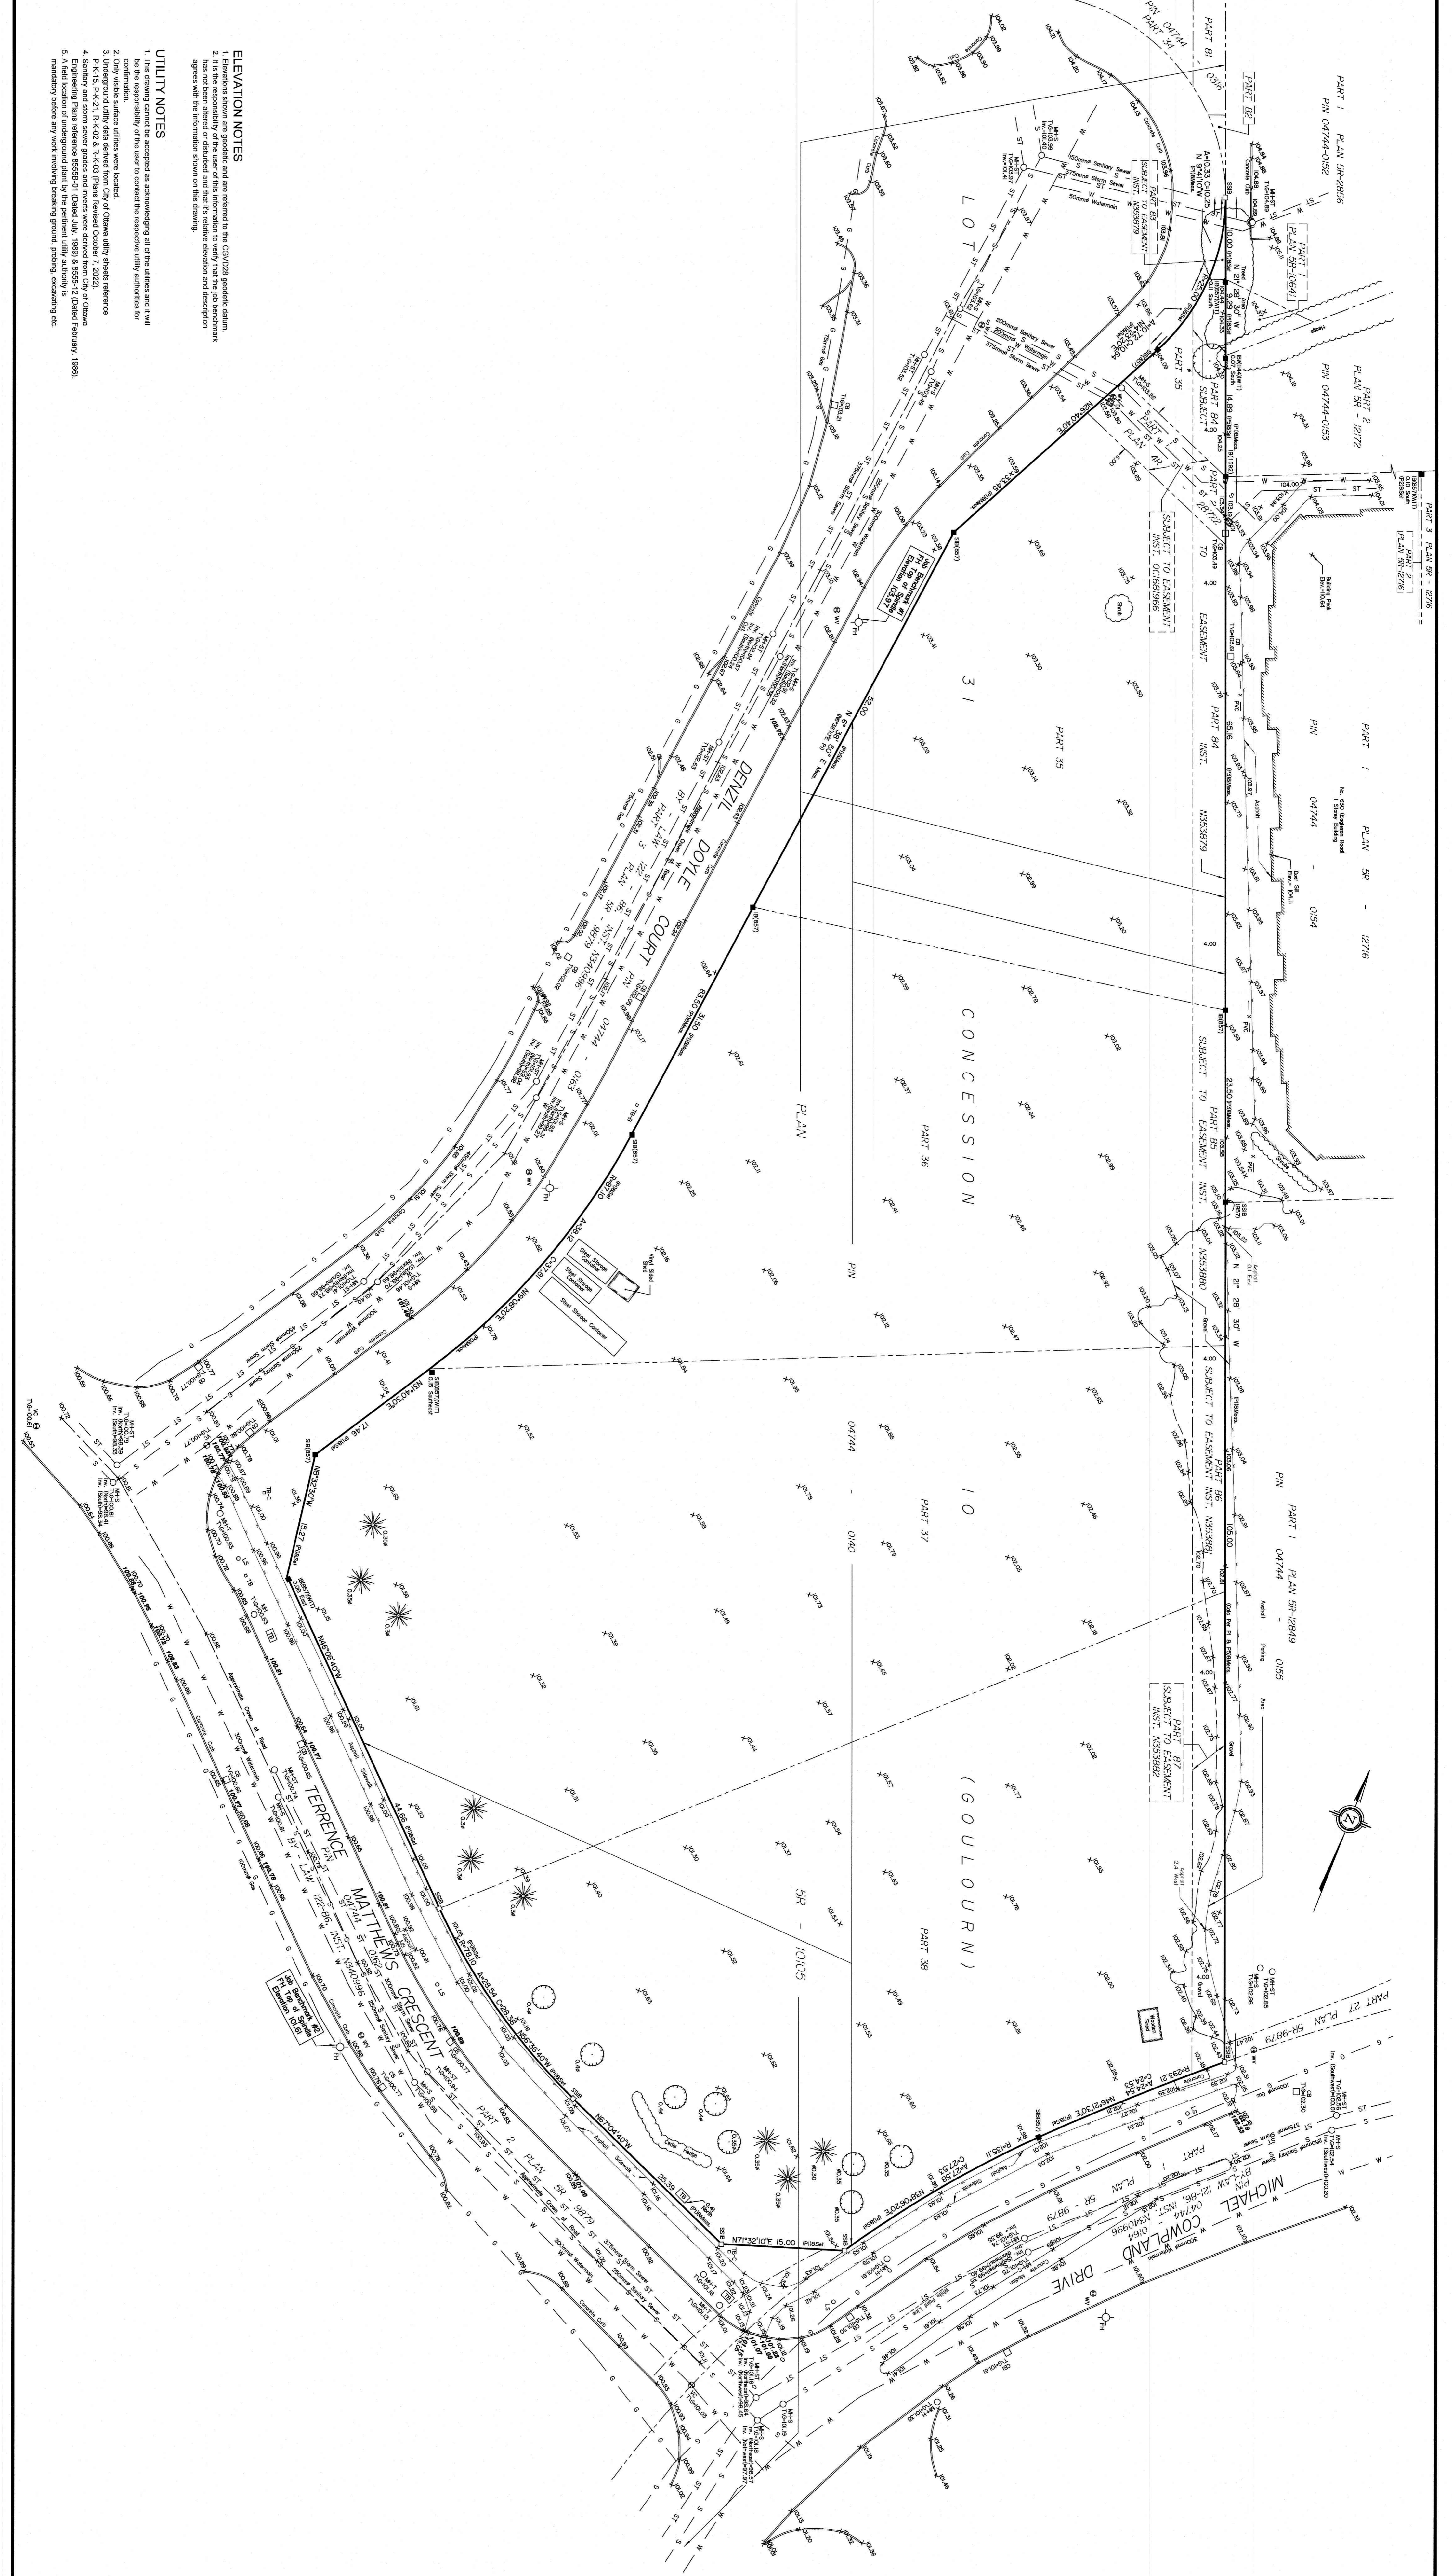

ELEVATION NOTES
 1. Elevations shown are graphic and are referred to the CGVD25 geoid datum.
 2. It is the responsibility of the user to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.

UTILITY NOTES
 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
 2. Confirmed surface utilities were located.
 3. Underground utility data derived from City of Ottawa utility sheets reference P-K-15, P-K-21, P-K-02 & P-K-03 (Plans Revised October 7, 2022).
 4. Sanitary and storm sewer grades and manholes were derived from City of Ottawa utility sheets reference P-K-15, P-K-21, P-K-02 & P-K-03 (Plans Revised October 7, 2022).
 5. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating, etc.

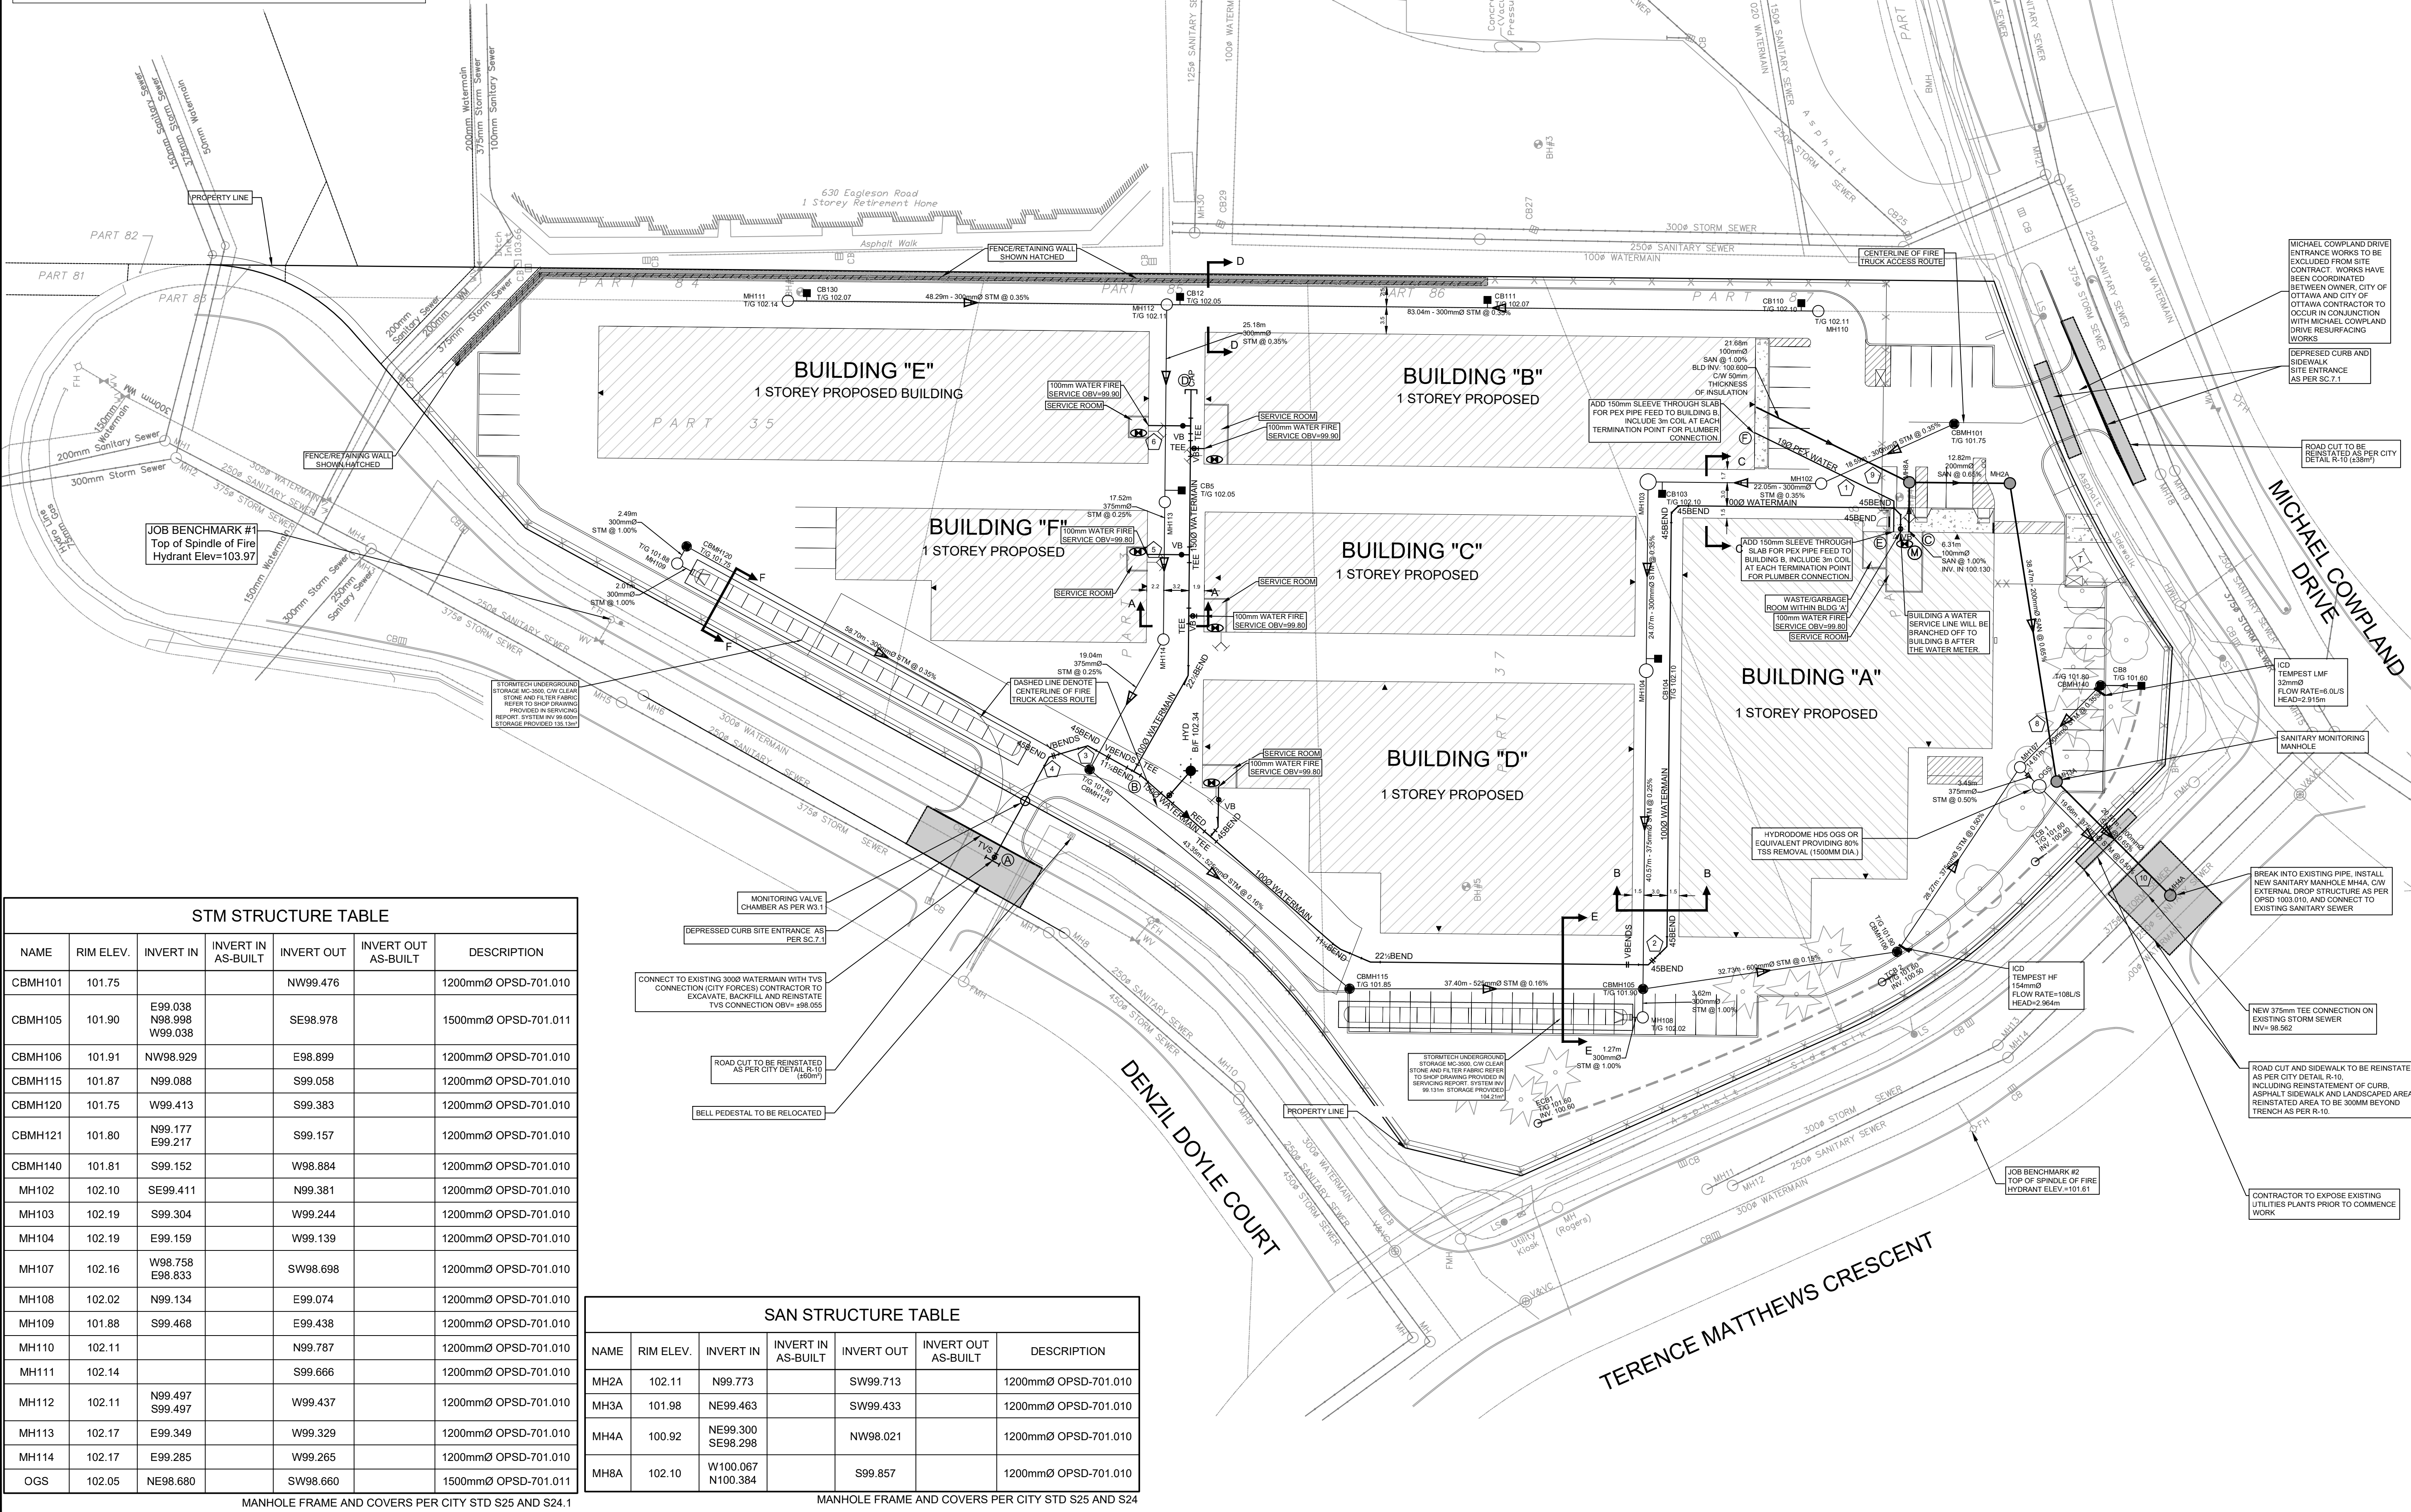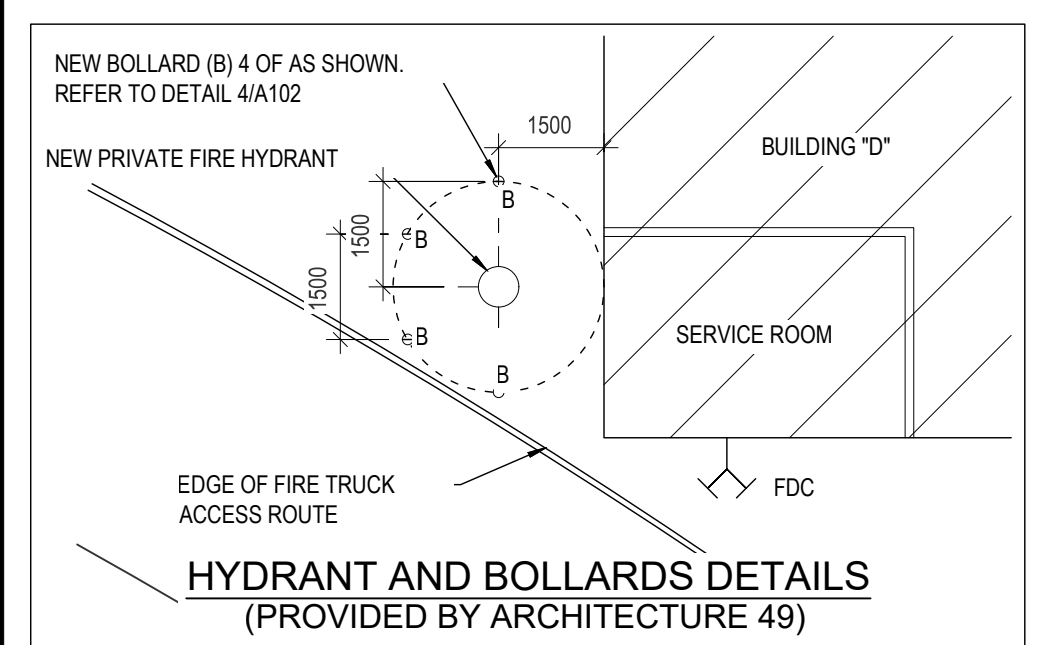

STM STRUCTURE TABLE

NAME	RIM ELEV.	INVERT IN	INVERT IN AS-BUILT	INVERT OUT	INVERT OUT AS-BUILT	DESCRIPTION
CBMH101	101.75			NW99.476		1200mmØ OPSD-701.010
CBMH105	101.90	E99.038 N98.998 W99.038		SE98.978		1500mmØ OPSD-701.011
CBMH106	101.91	NW98.929		E98.899		1200mmØ OPSD-701.010
CBMH115	101.87	N99.088		S99.058		1200mmØ OPSD-701.010
CBMH120	101.75	W99.413		S99.383		1200mmØ OPSD-701.010
CBMH121	101.80	N99.177 E99.217		S99.157		1200mmØ OPSD-701.010
CBMH140	101.81	S99.152		W98.884		1200mmØ OPSD-701.010
MH102	102.10	SE99.411		N99.381		1200mmØ OPSD-701.010
MH103	102.19	S99.304		W99.244		1200mmØ OPSD-701.010
MH104	102.19	E99.159		W99.139		1200mmØ OPSD-701.010
MH107	102.16	W98.758 E98.833		SW98.698		1200mmØ OPSD-701.010
MH108	102.02	N99.134		E99.074		1200mmØ OPSD-701.010
MH109	101.88	S99.468		E99.438		1200mmØ OPSD-701.010
MH110	102.11			N99.787		1200mmØ OPSD-701.010
MH111	102.14			S99.666		1200mmØ OPSD-701.010
MH112	102.11	N99.497 S99.497		W99.437		1200mmØ OPSD-701.010
MH113	102.17	E99.349		W99.329		1200mmØ OPSD-701.010
MH114	102.17	E99.285		W99.265		1200mmØ OPSD-701.010
OGS	102.05	NE98.680		SW98.660		1500mmØ OPSD-701.011

MANHOLE FRAME AND COVERS PER CITY STD S25 AND S24.1

SAN STRUCTURE TABLE

NAME	RIM ELEV.	INVERT IN	INVERT IN AS-BUILT	INVERT OUT	INVERT OUT AS-BUILT	DESCRIPTION
MH2A	102.11	N99.773		SW99.713		1200mmØ OPSD-701.010
MH3A	101.98	NE99.463		SW99.433		1200mmØ OPSD-701.010
MH4A	100.92	NE99.300 SE98.298		NW98.021		1200mmØ OPSD-701.010
MH8A	102.10	W100.067 N100.384		S99.857		1200mmØ OPSD-701.010

MANHOLE FRAME AND COVERS PER CITY STD S25 AND S24

CLIENT
HUNTINGTON PROPERTIES

COPYRIGHT
This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. When dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be relieved of any liability from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
is a member of the IBI Group of companies.

ISSUES

No.	DESCRIPTION	DATE
1	ISSUED FOR CITY REVIEW	2023-12-09
2	REVISED PER CITY COMMENTS	2023-03-09
3	REVISED PER CITY COMMENTS	2023-07-07
4	REVISED PER CITY COMMENTS	2023-07-19
5	REVISED PER CITY COMMENTS	2023-09-22
6	REVISED PER CITY COMMENTS	2023-11-13
7	REVISED PER CITY COMMENTS	2023-12-20

SEE 010, 011, 012 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS.

KEY PLAN

CONSULTANTS

Project Coordinator:
Huntington Properties
Architect:
A49 Architecture
Landscape:
Fotem
Mechanical & Electrical:
Goodkey & Woodmark & Associates Limited
Surveyor:
Annis O'Sullivan Vollebakk Ltd.
Geotech:
Paterson Group

Scale: 1:400

SEAL

PROJECT
PROPOSED SELF STORAGE DEVELOPMENT
75 MICHAEL COWPLAND

PROJECT NO: 135470
DRAWN BY: S.L. / D.D.
PROJECT MGR: R.M.

CHECKED BY: T.R.B.
APPROVED BY: T.R.B.

SHEET TITLE
GENERAL PLAN OF SERVICES

SHEET NUMBER: C-001
ISSUE: 6

File Location: \\1135470_R0_Deniz_Doyle_Cour...
Last Saved: December 20, 2023, 12:02:12 PM by Eric Henne
Printed: Wednesday, December 20, 2023, 12:02:12 PM by Eric Henne
CITY PLAN NO. 18885
CITY FILE NO. D07-12-22-0174

Pre-Application Consultation Meeting Minutes

Property Address: 60 Denzil Doyle Court

Location: Virtual – Microsoft Teams

Meeting Date: November 1st, 2022

Attendees: City Staff:

Molly Smith – File Lead

Steven Payne – Planning Coop

Matthew Ippersiel – Urban Design

Santhosh Kuruvilla – Engineer

Mark Richardson – Forester

Siobhan Kelly – Committee of Adjustment

Hayley Murray – Forestry

Applicant Team:

Jill MacDonald – WSP

Hind Barnieh – Access Storage

Mathieu Desjardins – Huntington Properties

Terry Brule – IBI Group

Ryan Magladry – IBI Group

Derek Noble – Huntington Properties

Andrew Bouwman – Architecture 49

Jie Chen – Architecture 49

Regrets: Neeti Paudel – Transportation Project Manager (City)

Applicant

- Access Storage in partnership with Huntington Properties
- Six buildings proposed, want to maximize buildable area
- Building A 2-storeys, remainder of buildings are a single-storey
- Huntington Properties has owned the property for 15-years
- Building A – 2-storey but climate controlled and has an office component that would only serve customers/site/facility. Office portion would be considered accessory due to nature of use and size. If office use is intended to serve as an office space outside of the site (regional), would not be considered accessory.

City Comments:

Planning

1. Complex Site Plan required. Please be aware of policy or procedures changes as a result of Bill 109.
2. Unclear if minor variances required. Please speak with Molly prior to submission.
3. Trees along Terence Matthews and Michael Cowpland need to be retained, please adjust the site plan layout to provide sufficient setbacks.
4. When submitting, elevations and site plan will need to include the whole site.
5. If possible, bicycle parking should be near main entrances and covered.
6. Additional landscaping and tree planting should be provided. Please look for opportunities to break up hardscaping with shade plantings.
7. Direct connections from the sidewalks should be provided.
8. Planning Rationale Required.

Feel free to contact Molly Smith, Planner (File Lead), at molly.smith@ottawa.ca for follow-up questions.

Minor Variance/Committee of Adjustment (if required)

Minor Variance

- The parking rate calculation depends on how the ancillary admin space functions (Building A)
 - Applicant confirmed that the admin space only services the warehouses on site –warehouse parking rate applicable

Provision	Required	Proposed
Warehouse:	$(5000/100) \times 0.8 = 40$	54 spaces
0.8 per 100 m2 for the first 5000 m2 of gross floor area, and 0.4 per 100 m2 above 5000 m2 of gross floor area.	$(3,557/100) \times 0.4 = 14.2$	
	$40 + 14.2 = 54$	

- If relief is required, the applicant can apply for a minor variance
- The new Official Plan designates the property Neighbourhood within the Suburban West Transect. If a minor variance is required, planning rationale will be required to support the proposed use and to demonstrate that it maintains the intent/purpose of the new Official Plan.
- PRED staff may support a minor variance for a reduction in parking if it contributes to the retention of trees along Terence Matthews Cres (New OP - Policy 4.8.2)
- The Committee of Adjustment can grant a minor variance if the following criteria are met:
 1. The variance maintains the general intent and purpose of the Official Plan
 2. The variance maintains the general intent and purpose of the Zoning By-law
 3. The variance is minor in nature

4. The variance is desirable for the appropriate development/use of the lands

Complete Application

For a complete list of the submission requirements, please refer to Section 2 of the application form:

https://app06.ottawa.ca/online_services/forms/ds/minor_variance_en.pdf

Timelines

- The Site Plan Control application should be underway before applying to the Committee of Adjustment for a minor variance
- The Committee of Adjustment process takes approx. 12-14 weeks from application submission to end of the appeal period. Once an applicant submits and the Committee of Adjustment Coordinators deem the application complete, it takes 4-6 weeks to be heard at a public hearing

Urban Design

1. Maintain and improve the planted edge along Terence Matthews. This landscaped edge is present on all other properties on Terence Matthews and defines the character of the street.
2. Consolidate the two snow storage areas in the narrow north corner of the site (increasing the snow storage area currently proposed).
3. Drive aisles need to be reorganized and widened throughout the site to improve circulation and safety. Create more direct vehicle lanes to avoid the necessity for frequent turning.
4. Consider integrating a central drive aisle leading off of Denzil Doyle, which would be perpendicular to the street. This could become the main organizational element of the site and inform the orientation of the buildings.
5. Rather than have parking spaces distributed in small pockets throughout the site, consolidate spaces in larger groups, perhaps primarily along the new widened vehicle aisle leading off Denzil Doyle (see previous comment).
6. Improve the interface between this site and the existing retirement home to the east. A landscape buffer is needed to screen the storage units from the residence's windows.
7. This application is not subject to review by the Urban Design Review Panel.
8. An Urban Design Brief is required as a part of your submission. This may be combined with your Planning Rationale report. Please refer to the attached Urban Design Brief Terms of Reference to inform the content of the brief.

Feel free to contact Matthew Ippersiel, Urban Designer, at matthew.ippersiel@ottawa.ca for follow-up questions.

Transportation

1. TIA will not be required.
2. Noise Impact Studies required for the following:
 - a) Stationary (if there will be any exposed mechanical equipment due to the proximity to neighbouring noise sensitive land uses)
3. The proposed access on Denzil Doyle creates an offset with the existing access on Denzil Doyle Court. Suggest that the access is proposed directly across the existing access on the west side.
4. ROW protection on Michael Cowpland is 26 m. Ensure this is protected and shown on the site plan.
5. The sidewalks along the frontages of Michael Cowpland Drive Terence Matthews Crescent is substandard. Please upgrade the sidewalks per City standards (1.8m min concrete sidewalk).
6. On site plan:
 - a) Show all details of the roads abutting the site up to and including the opposite curb; include such items as pavement markings, accesses and/or sidewalks.
 - b) Show all curb radii measurements; ensure that all curb radii are reduced as much as possible
 - c) Show lane/aisle widths.
7. As the proposed site is for the general public use, AODA legislation applies.
 - a) Clearly define accessible parking stalls and ensure they meet AODA standards (include an access aisle next to the parking stall and a pedestrian curb ramp at the end of the access aisle, as required).
 - b) Please consider using the City's Accessibility Design Standards, which provide a summary of AODA requirements. <https://ottawa.ca/en/city-hall/creating-equal-inclusive-and-diverse-city/accessibility-services/accessibility-design-standards-features#accessibility-design-standards>
8. Provide direct and safe pedestrian connections from the parking to the buildings.
9. Turning movements for the largest vehicle should be assessed at the nearby intersections and at the accesses and within the site.
10. Emergency services or building code services should be contacted to ensure there are no issues with the fire route. They provided the following comments:
 - a) Assuming the red part is the proposed fire access routes - If so, is the fire route more than 90m dead-end without a designated turnaround? Also, Building B and C do not appear to meet the OBC requirement to "face a street" and have a fire access route within 3-14m of the building face. Building B also appears to have a FDC that is more than 45m from a fire hydrant (although close).

Feel free to contact Neeti Paudel, Transportation Project Manager, at neeti.paudel@ottawa.ca for follow-up questions.

Parks

Parks and Facilities Planning Comments:

1. As per the [Parkland Dedication \(By-law No. 2022-280\) | City of Ottawa](#), as amended, parkland dedication will be required as a condition of development. In this circumstance given the parcel size and proposed use, Cash in Lieu of parkland would be considered appropriate.
2. Based in the details provided, the proposal would be best considered a commercial development for the purposes of the parkland dedication by-law. The applicant is encouraged to review the parkland dedication by-law should they feel that an alternative land use category be more appropriate. The parkland requirement for a commercial use is calculated as 2% of the gross land area of the site being developed.
3. Please identify in the Planning Rationale (when the initial development application is submitted) how the requirements in the Parkland Dedication (By-law No. 2022-280) will be achieved.
4. Please provide the City with a surveyor's area certificate/memo which specifies the exact gross land area of the property parcel being developed.
5. The value of the land will be determined by the City's Realty Services Branch. The owner is responsible for any appraisal costs incurred by the City.
6. Please note that the park comments are preliminary and will be finalized (and subject to change) upon receipt of the requested supporting documentation. Additionally, if the proposed land use changes, then the parkland dedication requirement will be re-evaluated accordingly.

Feel free to contact Jeff Goettling with Parks and Facilities Planning Services (jeff.goettling@ottawa.ca) for follow-up questions.

Forestry

1. A Tree Conservation Report is needed for this SPC
2. The retention of the well-established trees along the south and south east boundaries of the property are a priority
 - a. Under the new Official Plan, referencing section 4.8.2, growth, development and intensification shall maintain the urban forest canopy. Mature, healthy trees should be preserved and provided space on private and public lands including the provision of adequate soil volumes on high quality soil.
3. Snow should not be stored within the critical rootzone of retained trees

Tree Conservation Report requirements:

1. A Tree Conservation Report (TCR) must be supplied for review along with the suite of other plans/reports required by the City
 - a. an approved TCR is a requirement of Site Plan approval.
 - b. The TCR may be combined with the LP provided all information is supplied

2. Any removal of privately-owned trees 10cm or larger in diameter, or city-owned trees of any diameter requires a tree permit issued under the Tree Protection Bylaw (Bylaw 2020 – 340); the permit will be based on an approved TCR and made available at or near plan approval.
3. The Planning Forester from Planning and Growth Management as well as foresters from Forestry Services will review the submitted TCR
 - a. If tree removal is required, both municipal and privately-owned trees will be addressed in a single permit issued through the Planning Forester
 - b. Compensation may be required for city owned trees – if so, it will need to be paid prior to the release of the tree permit
4. The TCR must contain 2 separate plans:
 - a. Plan/Map 1 - show existing conditions with tree cover information
 - b. Plan/Map 2 - show proposed development with tree cover information
 - c. Please ensure retained trees are shown on the landscape plan
5. The TCR must list all trees on site, as well as off-site trees if the CRZ extends into the developed area, by species, diameter and health condition
 - a. please identify trees by ownership – private onsite, private on adjoining site, city owned, boundary (trees on a property line)
6. If trees are to be removed, the TCR must clearly show where they are, and document the reason they cannot be retained
7. All retained trees must be shown, and all retained trees within the area impacted by the development process must be protected as per City guidelines available at [Tree Protection Specification](#) or by searching Ottawa.ca
8. The location of tree protection fencing must be shown on the plan
9. The City encourages the retention of healthy trees; if possible, please seek opportunities for retention of trees that will contribute to the design/function of the site.

For more information on the process or help with tree retention options, contact Hayley Murray hayley.murray@ottawa.ca or on [City of Ottawa](#).

Landscape Plan tree planting requirements:

For additional information on the following please contact tracy.smith@Ottawa.ca

Minimum Setbacks

- Maintain 1.5m from sidewalk or MUP/cycle track or water service laterals.
- Maintain 2.5m from curb
- Coniferous species require a minimum 4.5m setback from curb, sidewalk or MUP/cycle track/pathway.
- Maintain 7.5m between large growing trees, and 4m between small growing trees. Park or open space planting should consider 10m spacing, except where otherwise approved in naturalization / afforestation areas. Adhere to Ottawa Hydro's planting guidelines (species and setbacks) when **planting around overhead primary conductors**.

Tree specifications

- Minimum stock size: 50mm tree caliper for deciduous, 200cm height for coniferous.
- Maximize the use of large deciduous species wherever possible to maximize future canopy coverage
- Tree planting on city property shall be in accordance with the City of Ottawa’s Tree Planting Specification; and include watering and warranty as described in the specification (can be provided by Forestry Services).
- Plant native trees whenever possible
- No root barriers, dead-man anchor systems, or planters are permitted.
- No tree stakes unless necessary (and only 1 on the prevailing winds side of the tree)

Hard surface planting

- Curb style planter is highly recommended
- No grates are to be used and if guards are required, City of Ottawa standard (which can be provided) shall be used.
- Trees are to be planted at grade

Soil Volume

- Please document on the LP that adequate soil volumes can be met:

Tree Type/Size	Single Tree Soil Volume (m3)	Multiple Tree Soil Volume (m3/tree)
Ornamental	15	9
Columnar	15	9
Small	20	12
Medium	25	15
Large	30	18
Conifer	25	15

Please note that these soil volumes are not applicable in cases with Sensitive Marine Clay.

- Please follow the City’s 2017 Tree Planting in Sensitive Marine Clay guidelines

Tree Canopy

- The landscape plan shall show how the proposed tree planting will replace and increase canopy cover on the site over time, to support the City’s 40% urban forest canopy cover target.

- At a site level, efforts shall be made to provide as much canopy cover as possible, through tree planting and tree retention, with an aim of 40% canopy cover at 40 years, as appropriate.
- Indicate on the plan the projected future canopy cover at 40 years for the site.

Feel free to contact Hayley Murray, Forester, at hayley.murray@ottawa.ca for follow-up questions.

Engineering

Please note the following information regarding the engineering design submission for the above noted site:

1. The Servicing Study Guidelines for Development Applications are available at the following link: <https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans>
2. Record drawings and utility plans are available for purchase from the City's Information Centre. Contact the City's Information Centre by email at informationcentre@ottawa.ca or by phone at (613) 580-2424 x44455
3. Stormwater quantity control criteria – Refer to Kanata South Business Park Stormwater Management Report (February 1986 by A.J. Robinson & Associates Inc.). See attached report.
4. Stormwater quality control – Consult with the Conservation Authority (MVCA) for their requirements. Include the correspondence with MVCA in the stormwater/site servicing report.
5. Existing watermains, sanitary and storm sewers are available on Denzil Doyle Court., Terence Matthews Cres., and Michael Cowpland Drive for service connections.
6. As per the City of Ottawa Slope Stability Guidelines for Development Applications an engineering report is required for any retaining walls proposed 1.0 m or greater in height within the subject site that addresses the global stability of the wall and provides structural details. A Retaining Wall Stability Analysis Report and Retaining Wall Structural Details are required to be provided from a Professional Engineer licensed in the Province of Ontario that demonstrates the proposed retaining wall structure has been assessed for global instability as per City standards. Please ensure the analysis and required documentation are provided as part of the submission to address this comment.
7. Emergency routes will need to be satisfactory to Fire Services. Please show fire routes on the site plan. For information regarding fire route provisions, please

consult with Kevin Heiss at kevin.heiss@ottawa.ca.

8. Clearly show and label the property lines on all sides of the property.
9. Clearly show and label all the easements (if any) on the property, on all plans.
10. When calculating the post development composite runoff coefficient (C), please provide a drawing showing the individual drainage area and its runoff coefficient.
11. When using the modified rational method to calculate the storage requirements for the site, the underground storage should not be included in the overall available storage. The modified rational method assumes that the restricted flow rate is constant throughout the storm which, in this case, underestimates the storage requirement prior to the 1:100-year head elevation being reached. Alternately, if you wish to include the underground storage, you may use an assumed average release rate equal to 50% of the peak allowable rate. Otherwise, disregard the underground storage as available storage or provide modeling to support the design.
12. Engineering plans are to be submitted on standard A1 size (594mm x 841mm) sheets.
13. Phase 1 ESA and Phase 2 ESA must conform to clause 4.8.4 of the Official Plan that requires that development applications conform to Ontario Regulation 153/04.
14. Provide the following information for water main boundary conditions:
 1. Location map with water service connection location(s).
 2. Average daily demand (l/s).
 3. Maximum daily demand (l/s).
 4. Maximum hourly demand (l/s).
 5. Fire flow demand (provide detailed fire flow calculations based on Fire Underwriters survey (FUS) Water Supply for Public Fire Protection). Exposure separation distances shall be defined on a figure to support the FUS calculation and required fire flow (RFF).
 6. Hydrant capacity shall be assessed to demonstrate the RFF can be achieved. Please identify which hydrants are being considered to meet the RFF on a fire hydrant coverage plan as part of the boundary conditions request.
15. If you are proposing any exterior light fixtures, all must be included and approved as part of the site plan approval. Therefore, the lights must be clearly identified by make, model and part number. All external light fixtures must meet the criteria for full cut-off classification as recognized by the Illuminating Engineering Society of North America (IESNA or IES), and must result in minimal light spillage onto adjacent properties (as a guideline, 0.5 fc is normally the maximum allowable

spillage). In order to satisfy these criteria, the applicant must provide certification from an acceptable professional engineer. The location of all exterior fixtures, a table showing the fixture types (including make, model, part number), and the mounting heights must be included on a plan.

16. As per Ottawa Sewer Design Guideline section 4.4.4.7, a monitoring maintenance hole shall be required just inside the property line for all non-residential and multi residential buildings connections from a private sewer to a public sewer. See the sewer use By-law 2003-514(14) monitoring devices for details.

Feel free to contact Santhosh Kuruvilla, Infrastructure Project Manager, at Santhosh.kuruvilla@ottawa.ca for follow-up questions.

Other

- Plans are to be standard A1 size (594 mm x 841 mm) or Arch D size (609.6 mm x 914.4 mm) sheets, dimensioned in metric and utilizing an appropriate Metric scale (1:200, 1:250, 1:300, 1:400 or 1:500).
- All PDF submitted documents are to be unlocked and flattened.
- A Waste Reduction Workplan Summary is required for the construction project as required by O.Reg. 102/94, being “Waste Audits and Waste Reduction Work Plans” made under the Environmental Protection Act, RSO 1990, c E.19, as amended.
- You are encouraged to contact the Ward Councillor, about the proposal.

Please refer to the links to [Guide to preparing studies and plans](#) and [fees](#) for further information. Additional information is available related to [building permits, development charges, and the Accessibility Design Standards](#). Be aware that other fees and permits may be required, outside of the development review process. You may obtain background drawings by contacting geoinformation@ottawa.ca.

It is anticipated that, as a result of the *More Homes for Everyone Act, 2022*, for applications for site plan approval and zoning by-law amendments, new processes in respect of pre-application consultation will be in place as of January 1, 2023. The new processes are anticipated to require a multiple phase pre-application consultation approach before an application will be deemed complete. Applicants who have not filed a complete application by the effective date may be required to undertake further pre-application consultation(s) consistent with the provincial changes. The by-laws to be amended include By-law 2009-320, the Pre-Consultation By-law, By-law 2022-239, the planning fees by-law and By-law 2022-254, the Information and Materials for Planning Application By-law. The revisions are anticipated to be before Council in the period after the new Council takes office and the end of the year.

These pre-con comments are valid for one year. If you submit a development application(s) after this time, you may be required to meet for another pre-consultation meeting and/or the submission requirements may change. You are as well encouraged to contact us for a follow-up meeting if the plan/concept will be further refined.

APPLICANT'S STUDY AND PLAN IDENTIFICATION LIST

Legend: **S** indicates that the study or plan is required with application submission.

A indicates that the study or plan may be required to satisfy a condition of approval/draft approval.

For information and guidance on preparing required studies and plans refer [here](#):

S/A	ENGINEERING		S/A
S	1. Site Servicing Plan	2. Site Servicing Study / Assessment of Adequacy of Public Services	S
S	3. Grade Control and Drainage Plan	4. Geotechnical Study / Slope Stability Study	S
	5. Composite Utility Plan	6. Groundwater Impact Study	
	7. Servicing Options Report	8. Wellhead Protection Study	
	9. Transportation Impact Assessment (TIA)	10. Erosion and Sediment Control Plan / Brief	S
S	11. Storm water Management Report / Brief	12. Hydro geological and Terrain Analysis	
	13. Hydraulic Water main Analysis	14. Noise / Vibration Study	S
	15. Roadway Modification Functional Design	16. Confederation Line Proximity Study	

S/A	PLANNING / DESIGN / SURVEY		S/A
	17. Draft Plan of Subdivision	18. Plan Showing Layout of Parking Garage	
	19. Draft Plan of Condominium	20. Planning Rationale	S
S	21. Site Plan	22. Minimum Distance Separation (MDS)	
	23. Concept Plan Showing Proposed Land Uses and Landscaping	24. Agrology and Soil Capability Study	
	25. Concept Plan Showing Ultimate Use of Land	26. Cultural Heritage Impact Statement	
S	27. Landscape Plan	28. Archaeological Resource Assessment Requirements: S (site plan) A (subdivision, condo)	
S	29. Survey Plan	30. Shadow Analysis	
S	31. Architectural Building Elevation Drawings (dimensioned)	32. Design Brief (includes the Design Review Panel Submission Requirements)	
	33. Wind Analysis		

S/A	ENVIRONMENTAL		S/A
S	34. Phase 1 Environmental Site Assessment	35. Impact Assessment of Adjacent Waste Disposal/Former Landfill Site	
A	36. Phase 2 Environmental Site Assessment (depends on the outcome of Phase 1)	37. Assessment of Landform Features	
	38. Record of Site Condition	39. Mineral Resource Impact Assessment	
S	40. Tree Conservation Report	41. Environmental Impact Statement / Impact Assessment of Endangered Species	
	42. Mine Hazard Study / Abandoned Pit or Quarry Study	43. Integrated Environmental Review (Draft, as part of Planning Rationale)	

S/A	ADDITIONAL REQUIREMENTS		S/A
S	44. Applicant's Public Consultation Strategy (may be provided as part of the Planning Rationale)	45. Site Lighting Plan	S
A	46. Site Lighting Certification Letter	47.	

Meeting Date: November 1, 2022

Application Type: *Site Plan Control*

File Lead (Assigned Planner): Molly Smith

Infrastructure Approvals Project Manager: Santhosh Kuruvilla

Site Address (Municipal Address): 60 Denzil Doyle Court *Preliminary Assessment: 1 2 3 4 5

*One (1) indicates that considerable major revisions are required before a planning application is submitted, while five (5) suggests that proposal appears to meet the City's key land use policies and guidelines. **This assessment is purely advisory and does not consider technical aspects of the proposal or in any way guarantee application approval.**

It is important to note that the need for additional studies and plans may result during application review. If following the submission of your application, it is determined that material that is not identified in this checklist is required to achieve complete application status, in accordance with the Planning Act and Official Plan requirements, the Planning, Real Estate and Economic Development Department will notify you of outstanding material required within the required 30 day period. Mandatory pre-application consultation will not shorten the City's standard processing timelines, or guarantee that an application will be approved. It is intended to help educate and inform the applicant about submission requirements as well as municipal processes, policies, and key issues in advance of submitting a formal development application. This list is valid for one year following the meeting date. If the application is not submitted within this timeframe the applicant must again pre-consult with the Planning, Real Estate and Economic Development Department.

APPENDIX B

- City of Ottawa Boundary Conditions
- Watermain Demand Calculation Sheet
- FUS Fire Flow Requirement Calculation
- Modeling Output Files
- Water Entry Detail
- Correspondence from Architect and Mechanical Engineer

Boundary Conditions 75 Micheal Cowpland

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	0.18	0.0030
Maximum Daily Demand	0.28	0.0046
Peak Hour	0.49	0.0082
Fire Flow Demand #1	9,000	150

Location



Results

Connection 1 – Denzil Doyle Court

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	161.1	83.4
Peak Hour	156.5	76.8
Max Day plus Fire Flow	152.3	70.9

¹ Ground Elevation = 102.5 m

Notes

1. As per the Ontario Building Code in areas that may be occupied, the static pressure at any fixture shall not exceed 552 kPa (80 psi.) Pressure control measures to be considered are as follows, in order of preference:
 - a. If possible, systems to be designed to residual pressures of 345 to 552 kPa (50 to 80 psi) in all occupied areas outside of the public right-of-way without special pressure control equipment.
 - b. Pressure reducing valves to be installed immediately downstream of the isolation valve in the home/ building, located downstream of the meter so it is owner maintained.

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.



IBI GROUP
333 PRESTON STREET
OTTAWA, ONTARIO
K1S 5N4

WATERMAIN DEMAND CALCULATION SHEET

PROJECT : 75 Michael Cowpland
CLIENT : Huntington Propertyies & Access Storage

FILE: 125600-6.4.4
DATE PRINTED: 30-Jun-23
DESIGN: WZ
PAGE: 1 OF 1

NODE	RESIDENTIAL				NON-RESIDENTIAL (ICI)			AVERAGE DAILY DEMAND (l/s)			MAXIMUM DAILY DEMAND (l/s)			MAXIMUM HOURLY DEMAND (l/s)			FIRE DEMAND (l/min)
	SINGLE FAMILY UNITS	3 bedroom UNITS	2 bedroom UNITS	POPULATION	INDUST. (ha)	COMM. (ha)	INSTIT. (ha)	RESIDENTIAL	ICI	TOTAL	RESIDENTIAL	ICI	TOTAL	RESIDENTIAL	ICI	TOTAL	
Site						0.0094			0.0030	0.0030		0.0046	0.0046		0.0082	0.0082	9,000

POPULATION DENSITY		WATER DEMAND RATES		PEAKING FACTORS		FIRE DEMANDS	
Single Family	3.4 persons/unit	Residential	350 l/cap/day	Maximum Daily		Single Family	10,000 l/min (166.7 l/s)
3 Bedroom Units	2.7 persons/unit	Commercial Shopping Center	2,500 L/(1000m ² /day)	Residential	2.5 x avg. day	Semi Detached &	
2 Bedroom Units	1.8 persons/unit	Other Commercial	28,000 L/Ha/day	Commercial	1.5 x avg. day	Townhouse	10,000 l/min (166.7 l/s)
				Maximum Hourly			
				Residential	2.2 x max. day		
				Commercial	1.8 x max. day		Fire flow for the site is determined using FUS.



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 ibigroup.com

FIRE UNDERWRITERS SURVEY

75 Michael Cowpland | Huntington Properties
 135470-6.0 | Rev #2 | 2023-12-19
 Prepared By: AZ | Checked By: RM

STEP	Contents	Discription	Adjustment Factor	Result
1	Building A (1-storey)	1st Floor Area	Height 3.2m 3	1740 m2
	Total Effective Floor Area	(Storage space exceeding 3m in height, floor area X 3)		5220 m2
2	Type of Construction	Type V Wood Frame	1.5	Type II Noncombustible Construction 0.8
		Type III Ordinary Construction	1.0	
		Type II Noncombustible Construction	0.8	
		Type I Fire Resistive Construction	0.6	
3	Required Fire Flow	RFF = 220CVA		12716 L/min
4	Occupancy and Contents	Noncombustible Contents	-25%	Combustible - F2 Storage Rooms 0%
		Limited Combustible Contents	-15%	
		Combustible Contents	0%	
		Free Burning Contents	15%	
		Rapid Burning Contents	25%	
	Fire Flow			12716 L/min
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13	-30%	Yes -30%
		Standard Water Supply for both the system and Fire Department Hose Lines	-10%	Yes -10%
		Fully Supervised System	-10%	No
	Fire Flow			7630 L/min
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building		
	North	Separation (m)	6.0	with unprotected opening 8%
		Length X Height Factor (m.storeys)	47.4	
		Construction Type	Type II	
	South	Separation (m)	>30	with unprotected opening 0%
		Length X Height Factor (m.storeys)	0	
Construction Type		Type II		
East	Separation (m)	6.2	with unprotected opening 6%	
	Length X Height Factor (m.storeys)	8.9		
	Construction Type	Type II		
West	Separation (m)	>30	with unprotected opening 0%	
	Length X Height Factor (m.storeys)	0		
	Construction Type	Type II		
	Fire Flow			8698 L/min
7	Total Required Fire Flow	Rounded to Nearest 1000 L/min		9000 L/min
				150 L/s

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 ibigroup.com

FIRE UNDERWRITERS SURVEY

75 Michael Cowpland | Huntington Properties
 135470-6.0 | Rev #1 | 2023-06-30
 Prepared By: AZ | Checked By: RM

STEP	Contents	Discription	Adjustment Factor	Result
1	Building B (1-storey)	1st Floor Area	Height 3.2m 3	1180 m2
	Total Effective Floor Area	(Storage space exceeding 3m in height, floor area X 3)		3540 m2
2	Type of Construction	Type V Wood Frame	1.5	Type II Noncombustible Construction 0.8
		Type III Ordinary Construction	1.0	
		Type II Noncombustible Construction	0.8	
		Type I Fire Resistive Construction	0.6	
3	Required Fire Flow	RFF = 220CVA		10472 L/min
4	Occupancy and Contents	Noncombustible Contents	-25%	Combustible - F2 Storage Rooms 0%
		Limited Combustible Contents	-15%	
		Combustible Contents	0%	
		Free Burning Contents	15%	
		Rapid Burning Contents	25%	
	Fire Flow			10472 L/min
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13	-30%	Yes -30%
		Standard Water Supply for both the system and Fire Department Hose Lines	-10%	Yes -10%
		Fully Supervised System	-10%	No
		Fire Flow		
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building		
	North	Separation (m)	7.1	with unprotected opening 6%
		Length X Height Factor (m.storeys)	16.7	
		Construction Type	Type II	
	South	Separation (m)	>30	with unprotected opening 0%
		Length X Height Factor (m.storeys)	0	
Construction Type		Type II		
East	Separation (m)	>30	with unprotected opening 0%	
	Length X Height Factor (m.storeys)	0		
	Construction Type	Type II		
West	Separation (m)	6.1	with unprotected opening 8%	
	Length X Height Factor (m.storeys)	54.9		
	Construction Type	Type II		
	Fire Flow			7163 L/min
7	Total Required Fire Flow	Rounded to Nearest 1000 L/min		7000 L/min
				117 L/s

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 ibigroup.com

FIRE UNDERWRITERS SURVEY

75 Michael Cowpland | Huntington Properties
 135470-6.0 | Rev #1 | 2023-06-30
 Prepared By: AZ | Checked By: RM

STEP	Contents	Discription	Adjustment Factor	Result
1	Building C (1-storey)	1st Floor Area	Height 3.2m 3	840 m2
	Total Effective Floor Area	(Storage space exceeding 3m in height, floor area X 3)		2520 m2
2	Type of Construction	Type V Wood Frame	1.5	Type II Noncombustible Construction 0.8
		Type III Ordinary Construction	1.0	
		Type II Noncombustible Construction	0.8	
		Type I Fire Resistive Construction	0.6	
3	Required Fire Flow	RFF = 220CVA		8835 L/min
4	Occupancy and Contents	Noncombustible Contents	-25%	Combustible - F2 Storage Rooms 0%
		Limited Combustible Contents	-15%	
		Combustible Contents	0%	
		Free Burning Contents	15%	
		Rapid Burning Contents	25%	
	Fire Flow			8835 L/min
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13	-30%	Yes -30%
		Standard Water Supply for both the system and Fire Department Hose Lines	-10%	Yes -10%
		Fully Supervised System	-10%	No
	Fire Flow			5301 L/min
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building		
	North	Separation (m)	7.1	with unprotected opening 6%
		Length X Height Factor (m.storeys)	15.2	
		Construction Type	Type II	
	South	Separation (m)	9.0	with unprotected opening 7%
		Length X Height Factor (m.storeys)	30.4	
Construction Type		Type II		
East	Separation (m)	6.1	with unprotected opening 8%	
	Length X Height Factor (m.storeys)	54.9		
	Construction Type	Type II		
West	Separation (m)	6.1	with unprotected opening 8%	
	Length X Height Factor (m.storeys)	54.9		
	Construction Type	Type II		
	Fire Flow			6838 L/min
7	Total Required Fire Flow	Rounded to Nearest 1000 L/min		7000 L/min
				117 L/s

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 ibigroup.com


FIRE UNDERWRITERS SURVEY

75 Michael Cowpland | Huntington Properties
 135470-6.0 | Rev #1 | 2023-06-30
 Prepared By: AZ | Checked By: RM

STEP	Contents	Discription	Adjustment Factor	Result
1	Building D (1-storey)	1st Floor Area	Height 3.2m 3	1440 m2
	Total Effective Floor Area	(Storage space exceeding 3m in height, floor area X 3)		4320 m2
2	Type of Construction	Type V Wood Frame	1.5	Type II Noncombustible Construction 0.8
		Type III Ordinary Construction	1.0	
		Type II Noncombustible Construction	0.8	
		Type I Fire Resistive Construction	0.6	
3	Required Fire Flow	RFF = 220CVA		11568 L/min
4	Occupancy and Contents	Noncombustible Contents	-25%	Combustible - F2 Storage Rooms 0%
		Limited Combustible Contents	-15%	
		Combustible Contents	0%	
		Free Burning Contents	15%	
		Rapid Burning Contents	25%	
	Fire Flow			11568 L/min
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13	-30%	Yes -30%
		Standard Water Supply for both the system and Fire Department Hose Lines	-10%	Yes -10%
		Fully Supervised System	-10%	No
	Fire Flow			6941 L/min
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building		
	North	Separation (m)	>30	with unprotected opening 0%
		Length X Height Factor (m.storeys)	0	
		Construction Type	Type II	
	South	Separation (m)	9.0	with unprotected opening 9%
		Length X Height Factor (m.storeys)	64.8	
Construction Type		Type II		
East	Separation (m)	6.1	with unprotected opening 8%	
	Length X Height Factor (m.storeys)	54.9		
	Construction Type	Type II		
West	Separation (m)	>30	with unprotected opening 0%	
	Length X Height Factor (m.storeys)	0		
	Construction Type	Type II		
	Fire Flow			8121 L/min
7	Total Required Fire Flow	Rounded to Nearest 1000 L/min		8000 L/min

133 L/s

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 ibigroup.com

FIRE UNDERWRITERS SURVEY

75 Michael Cowpland | Huntington Properties
 135470-6.0 | Rev #1 | 2023-06-30
 Prepared By: AZ | Checked By: RM

STEP	Contents	Discription	Adjustment Factor	Result
1	Building E (1-storey)	1st Floor Area	Height 3.2m 3	1180 m2
	Total Effective Floor Area	(Storage space exceeding 3m in height, floor area X 3)		3540 m2
2	Type of Construction	Type V Wood Frame	1.5	Type II Noncombustible Construction 0.8
		Type III Ordinary Construction	1.0	
		Type II Noncombustible Construction	0.8	
		Type I Fire Resistive Construction	0.6	
3	Required Fire Flow	RFF = 220CVA		10472 L/min
4	Occupancy and Contents	Noncombustible Contents	-25%	Combustible - F2 Storage Rooms 0%
		Limited Combustible Contents	-15%	
		Combustible Contents	0%	
		Free Burning Contents	15%	
		Rapid Burning Contents	25%	
	Fire Flow			10472 L/min
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13	-30%	Yes -30%
		Standard Water Supply for both the system and Fire Department Hose Lines	-10%	Yes -10%
		Fully Supervised System	-10%	No
	Fire Flow			6283 L/min
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building		
	North	Separation (m)	>30	with unprotected opening 0%
		Length X Height Factor (m.storeys)	0	
		Construction Type	Type II	
	South	Separation (m)	7.1	with unprotected opening 6%
		Length X Height Factor (m.storeys)	16.7	
Construction Type		Type II		
East	Separation (m)	>30	with unprotected opening 0%	
	Length X Height Factor (m.storeys)	0		
	Construction Type	Type II		
West	Separation (m)	6.0	with unprotected opening 7%	
	Length X Height Factor (m.storeys)	39.4		
	Construction Type	Type II		
	Fire Flow			7100 L/min
7	Total Required Fire Flow	Rounded to Nearest 1000 L/min		7000 L/min
				117 L/s

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.



IBI GROUP
 500-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 ibigroup.com

FIRE UNDERWRITERS SURVEY


75 Michael Cowpland | Huntington Properties
 135470-6.0 | Rev #1 | 2023-06-30
 Prepared By: AZ | Checked By: RM

STEP	Contents	Discription	Adjustment Factor	Result
1	Building F (1-storey)	1st Floor Area	Height 3.2m 3	575 m2
	Total Effective Floor Area	(Storage space exceeding 3m in height, floor area X 3)		1725 m2
2	Type of Construction	Type V Wood Frame 1.5 Type III Ordinary Construction 1.0 Type II Noncombustible Construction 0.8 Type I Fire Resistive Construction 0.6	Type II Noncombustible Construction 0.8	
3	Required Fire Flow	RFF = 220CVA		7310 L/min
4	Occupancy and Contents	Noncombustible Contents -25% Limited Combustible Contents -15% Combustible Contents 0% Free Burning Contents 15% Rapid Burning Contents 25%	Combustible - F2 Storage Rooms 0%	0 L/min
	Fire Flow			7310 L/min
5	Automatic Sprinkler Protection	Automatic Sprinkler Conforming to NFPA 13 -30% Standard Water Supply for both the system and Fire Department Hose Lines -10% Fully Supervised System -10%	Yes -30% Yes -10% No	-2193 L/min -731 L/min
	Fire Flow			4386 L/min
6	Exposure Adjustment	Based on Table 6 Exposure Adjustment Charges for Subject Building		
	North	Separation (m) >30 Length X Height Factor (m.storeys) 0 Construction Type Type II	with unprotected opening 0%	0 L/min
	South	Separation (m) 7.3 Length X Height Factor (m.storeys) 15.2 Construction Type Type II	with unprotected opening 6%	263 L/min
	East	Separation (m) 6.0 Length X Height Factor (m.storeys) 39.4 Construction Type Type II	with unprotected opening 7%	307 L/min
	West	Separation (m) >30 Length X Height Factor (m.storeys) 0 Construction Type Type II	with unprotected opening 0%	0 L/min
	Fire Flow			4956 L/min
7	Total Required Fire Flow	Rounded to Nearest 1000 L/min		5000 L/min

83 L/s

Notes 1. Fire flow calculation are based on Fire Underwriters Survey version 2020.

Junctions and Pipes Layout

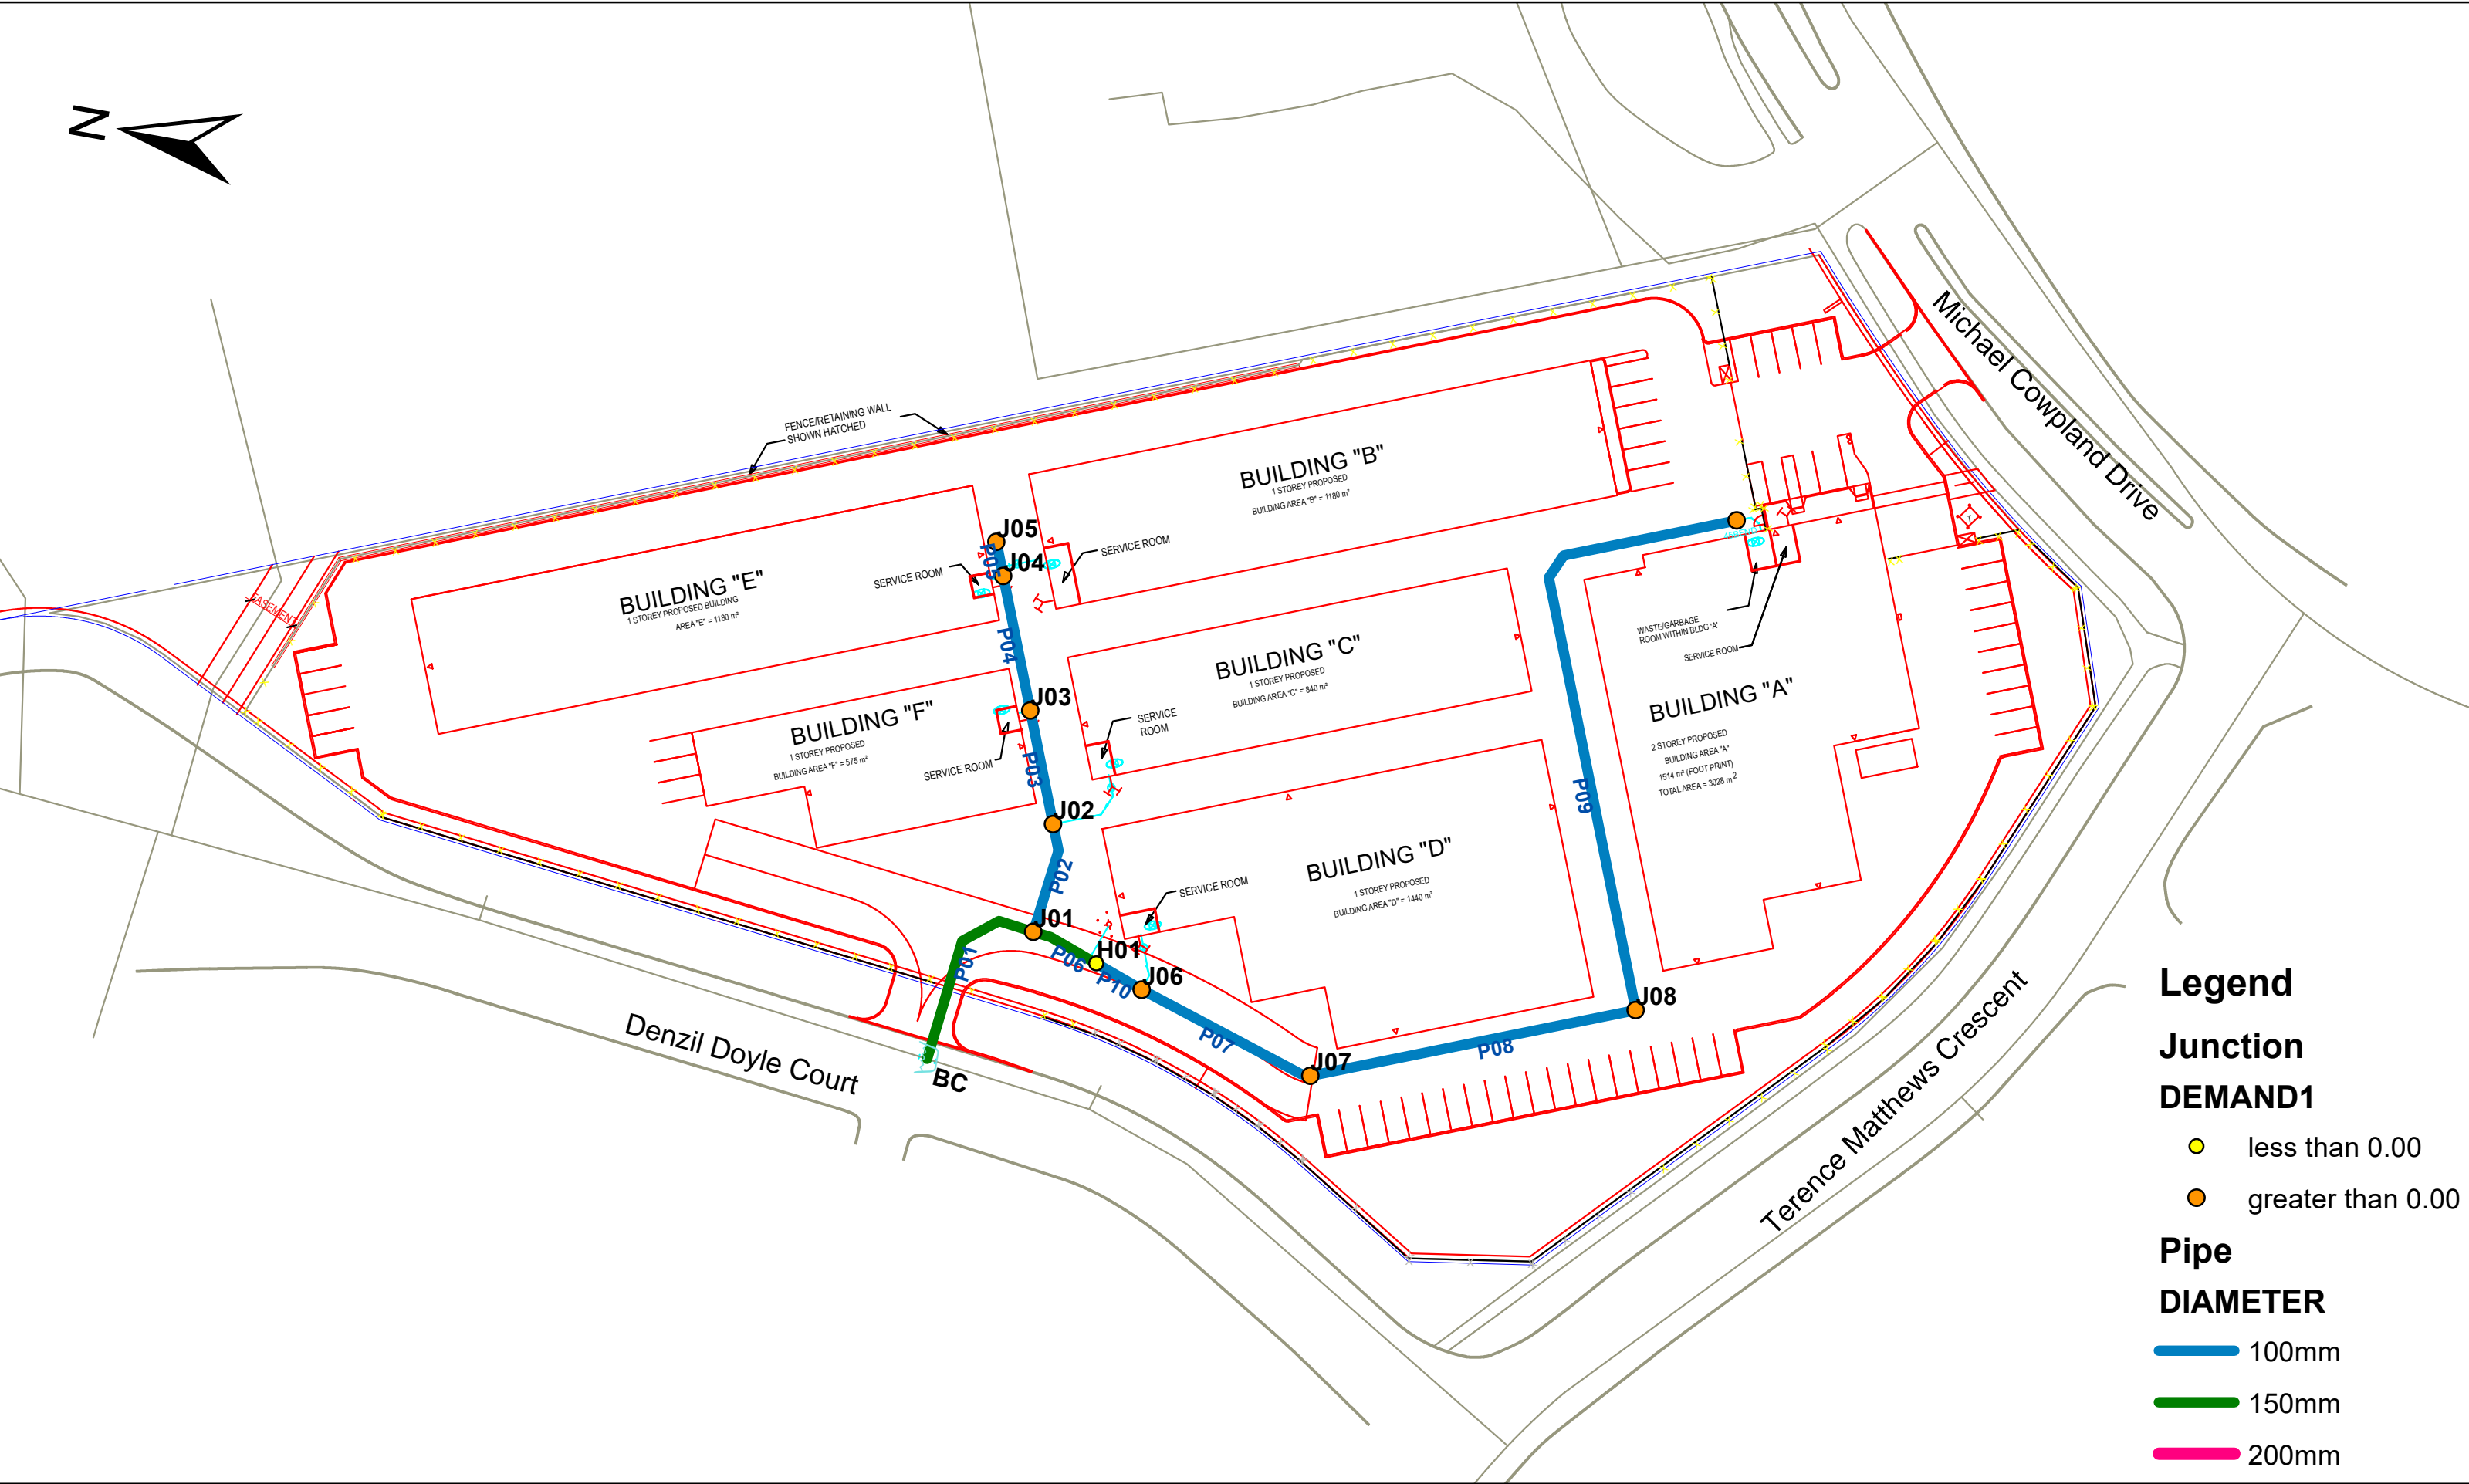

Legend

Junction


- less than 0.00
- greater than 0.00

Pipe

DIAMETER

- 100mm
- 150mm
- 200mm

Average Day Pressures

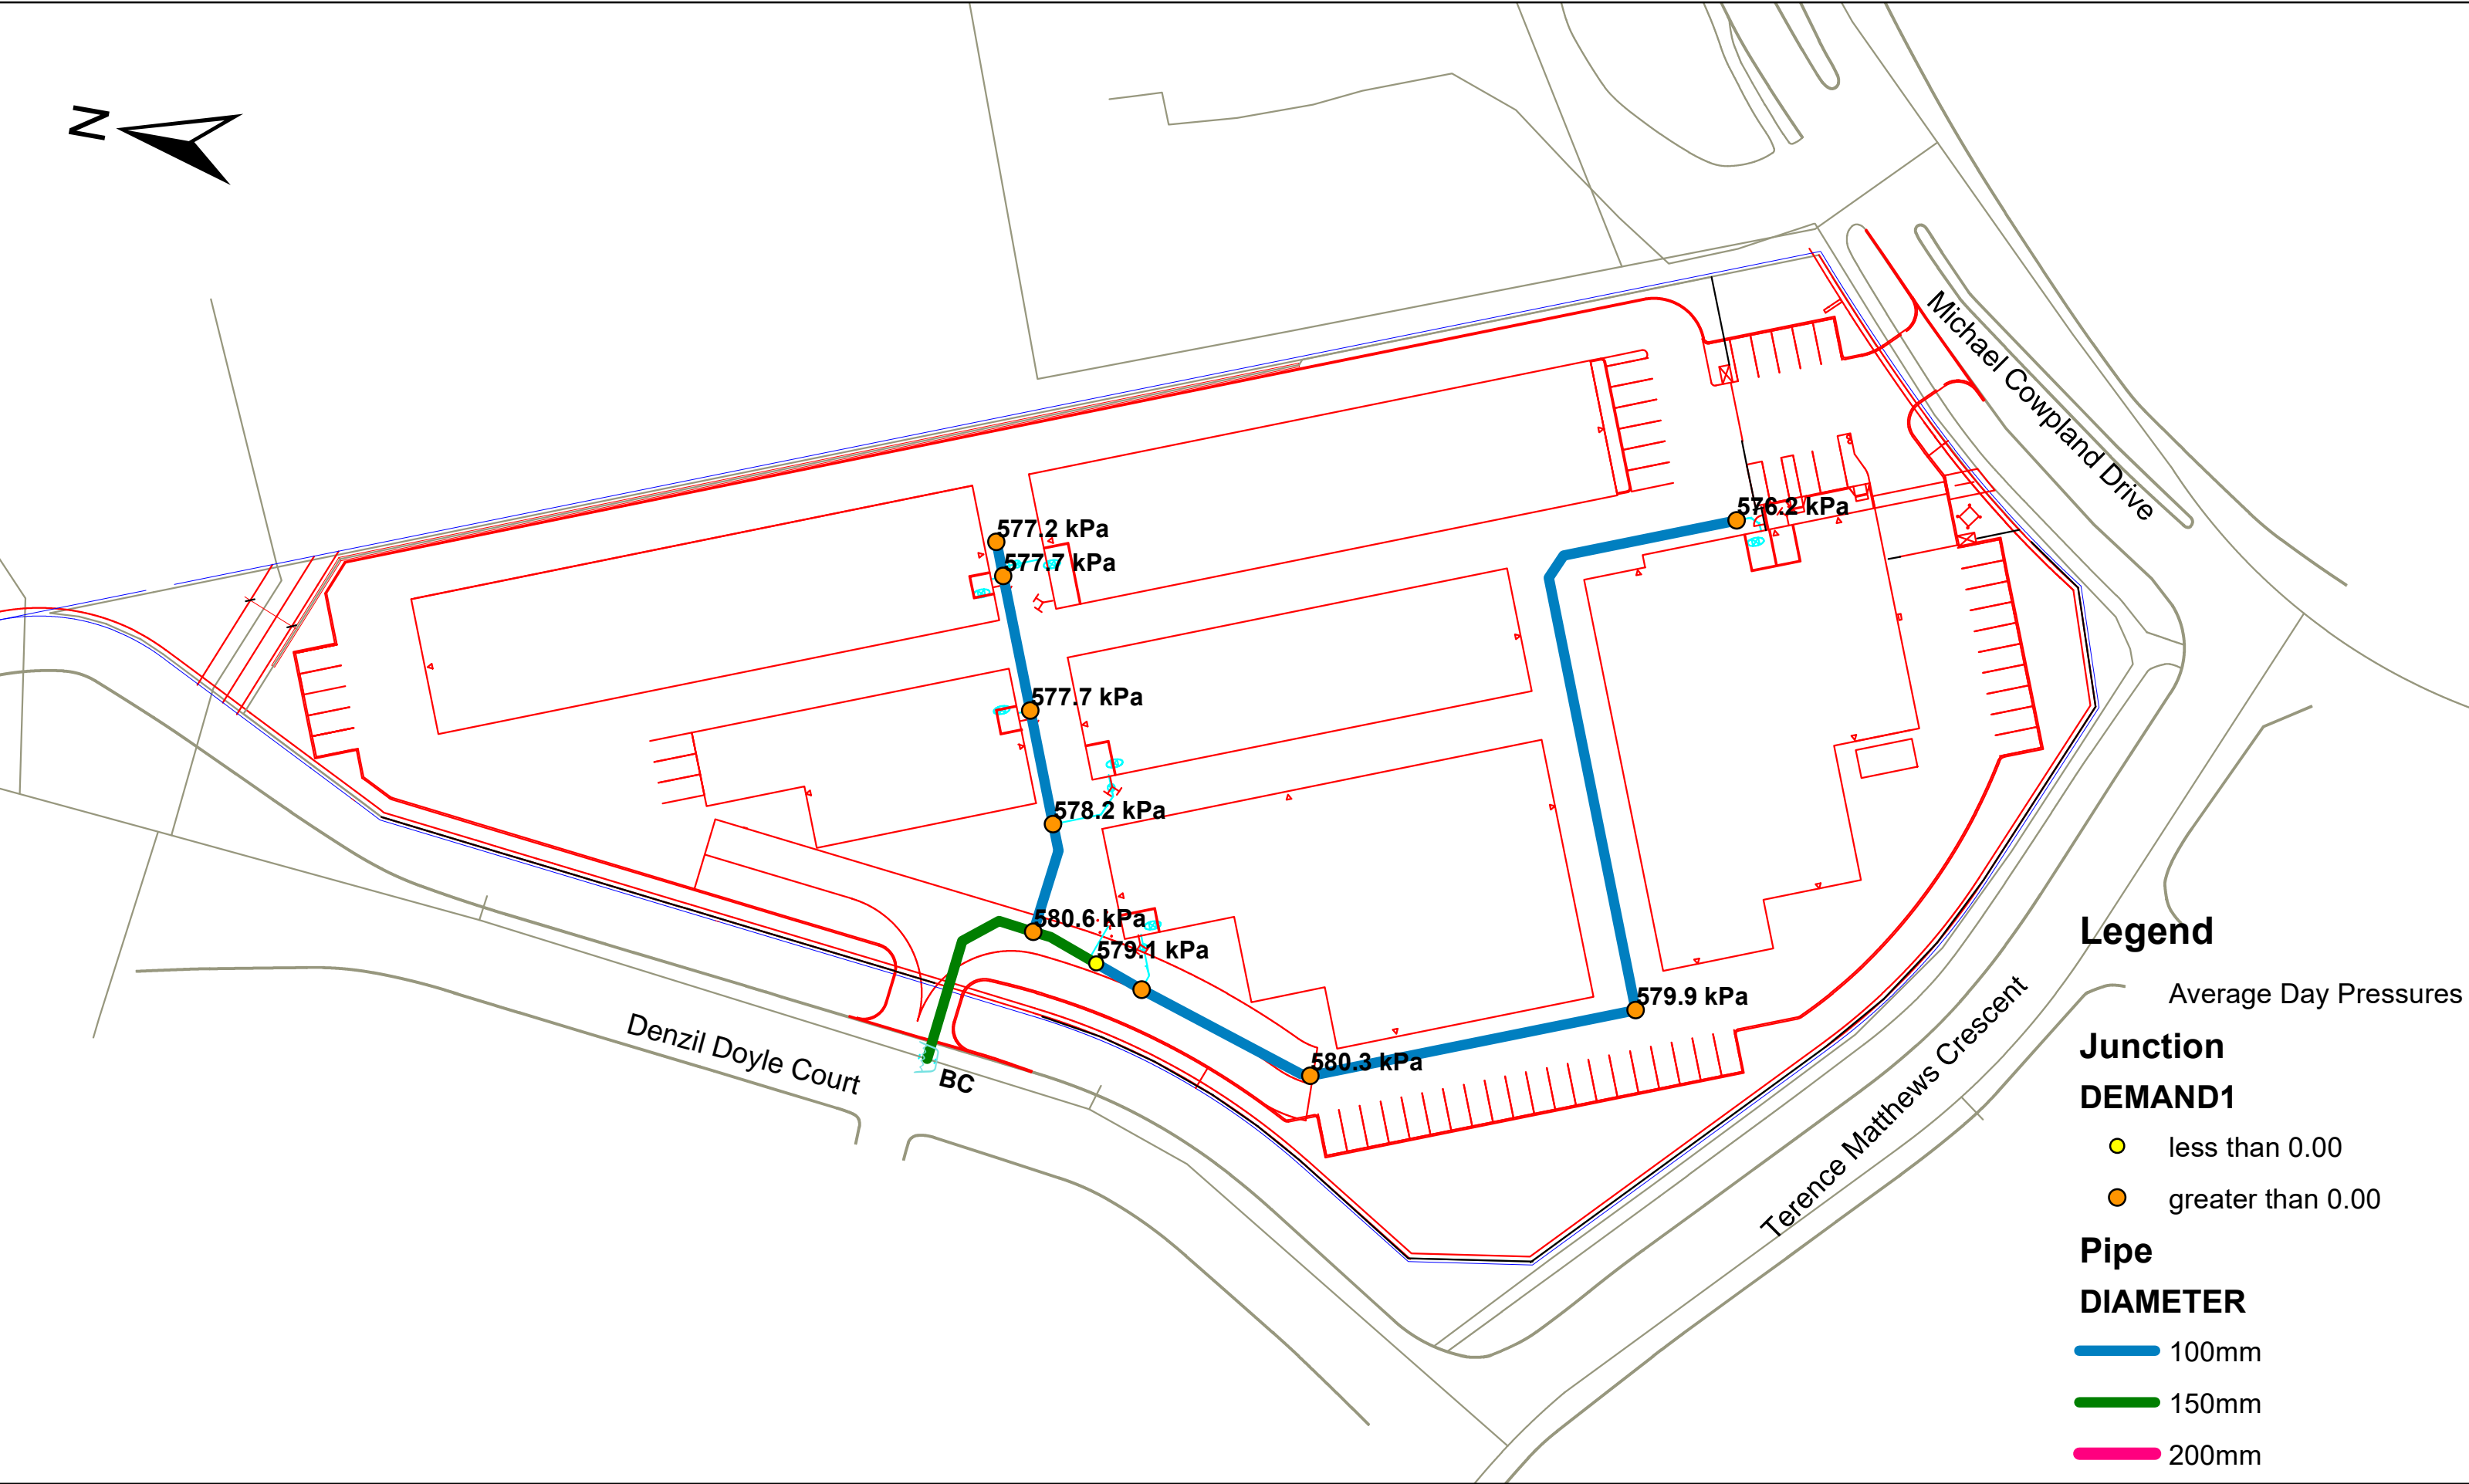

Legend

Average Day Pressures

Junction

DEMAND1

- less than 0.00
- greater than 0.00

Pipe


DIAMETER

- 100mm
- 150mm
- 200mm

Average Day Pressures

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)	Water Age (hrs)
1	<input type="checkbox"/>	H01	0.0000	102.00	161.10	579.13	0.00
2	<input type="checkbox"/>	J01	0.0000	101.85	161.10	580.60	0.00
3	<input type="checkbox"/>	J02	0.0000	102.10	161.10	578.15	0.00
4	<input type="checkbox"/>	J03	0.0000	102.15	161.10	577.66	0.00
5	<input type="checkbox"/>	J04	0.0000	102.15	161.10	577.66	0.00
6	<input type="checkbox"/>	J05	0.0000	102.20	161.10	577.17	0.00
7	<input type="checkbox"/>	J06	0.0000	102.05	161.10	578.64	0.00
8	<input type="checkbox"/>	J07	0.0000	101.88	161.10	580.31	0.00
9	<input type="checkbox"/>	J08	0.0000	101.92	161.10	579.92	0.00
10	<input type="checkbox"/>	J10	0.0031	102.30	161.10	576.19	0.00

Peak Hour Pressures

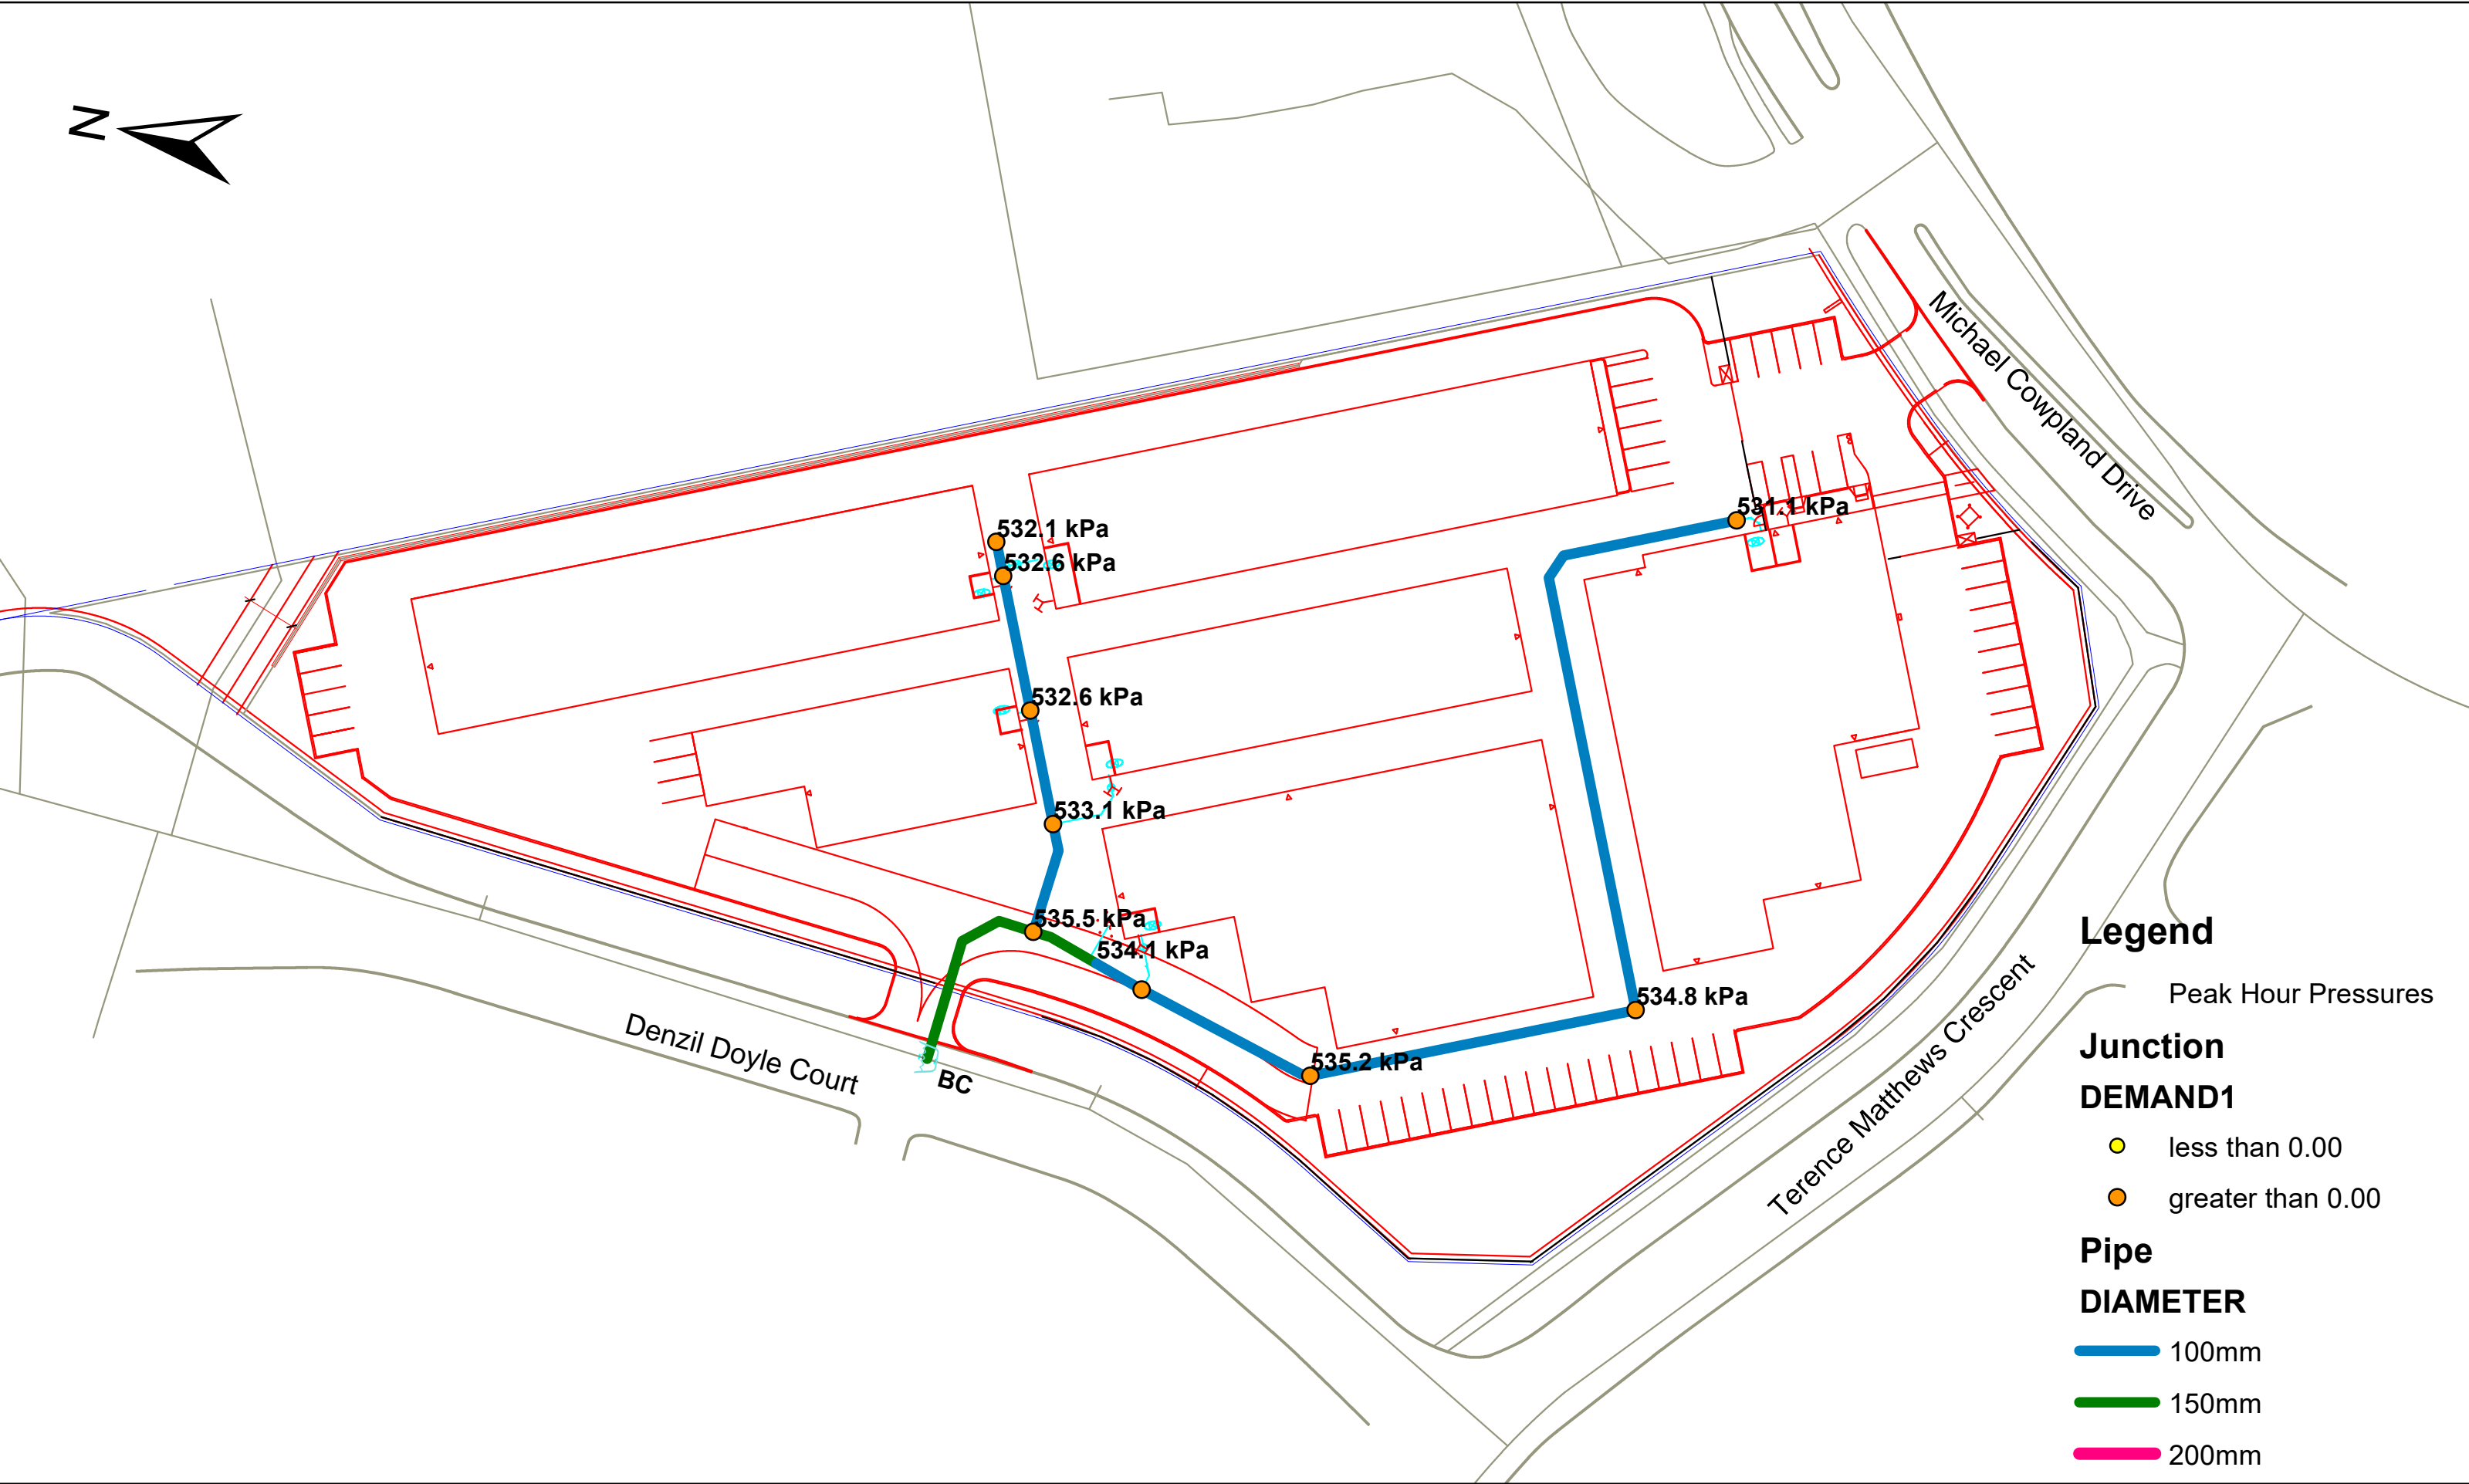

Legend

Peak Hour Pressures

Junction

DEMAND1

- less than 0.00
- greater than 0.00

Pipe


DIAMETER

- 100mm
- 150mm
- 200mm

Peak Hour Pressures

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)	Water Age (hrs)
1	<input type="checkbox"/>	H01	0.0000	102.00	156.50	534.06	0.00
2	<input type="checkbox"/>	J01	0.0000	101.85	156.50	535.53	0.00
3	<input type="checkbox"/>	J02	0.0000	102.10	156.50	533.08	0.00
4	<input type="checkbox"/>	J03	0.0000	102.15	156.50	532.59	0.00
5	<input type="checkbox"/>	J04	0.0000	102.15	156.50	532.59	0.00
6	<input type="checkbox"/>	J05	0.0000	102.20	156.50	532.10	0.00
7	<input type="checkbox"/>	J06	0.0000	102.05	156.50	533.57	0.00
8	<input type="checkbox"/>	J07	0.0000	101.88	156.50	535.23	0.00
9	<input type="checkbox"/>	J08	0.0000	101.92	156.50	534.84	0.00
10	<input type="checkbox"/>	J10	0.0082	102.30	156.50	531.12	0.00

Max Day + Fire Flow

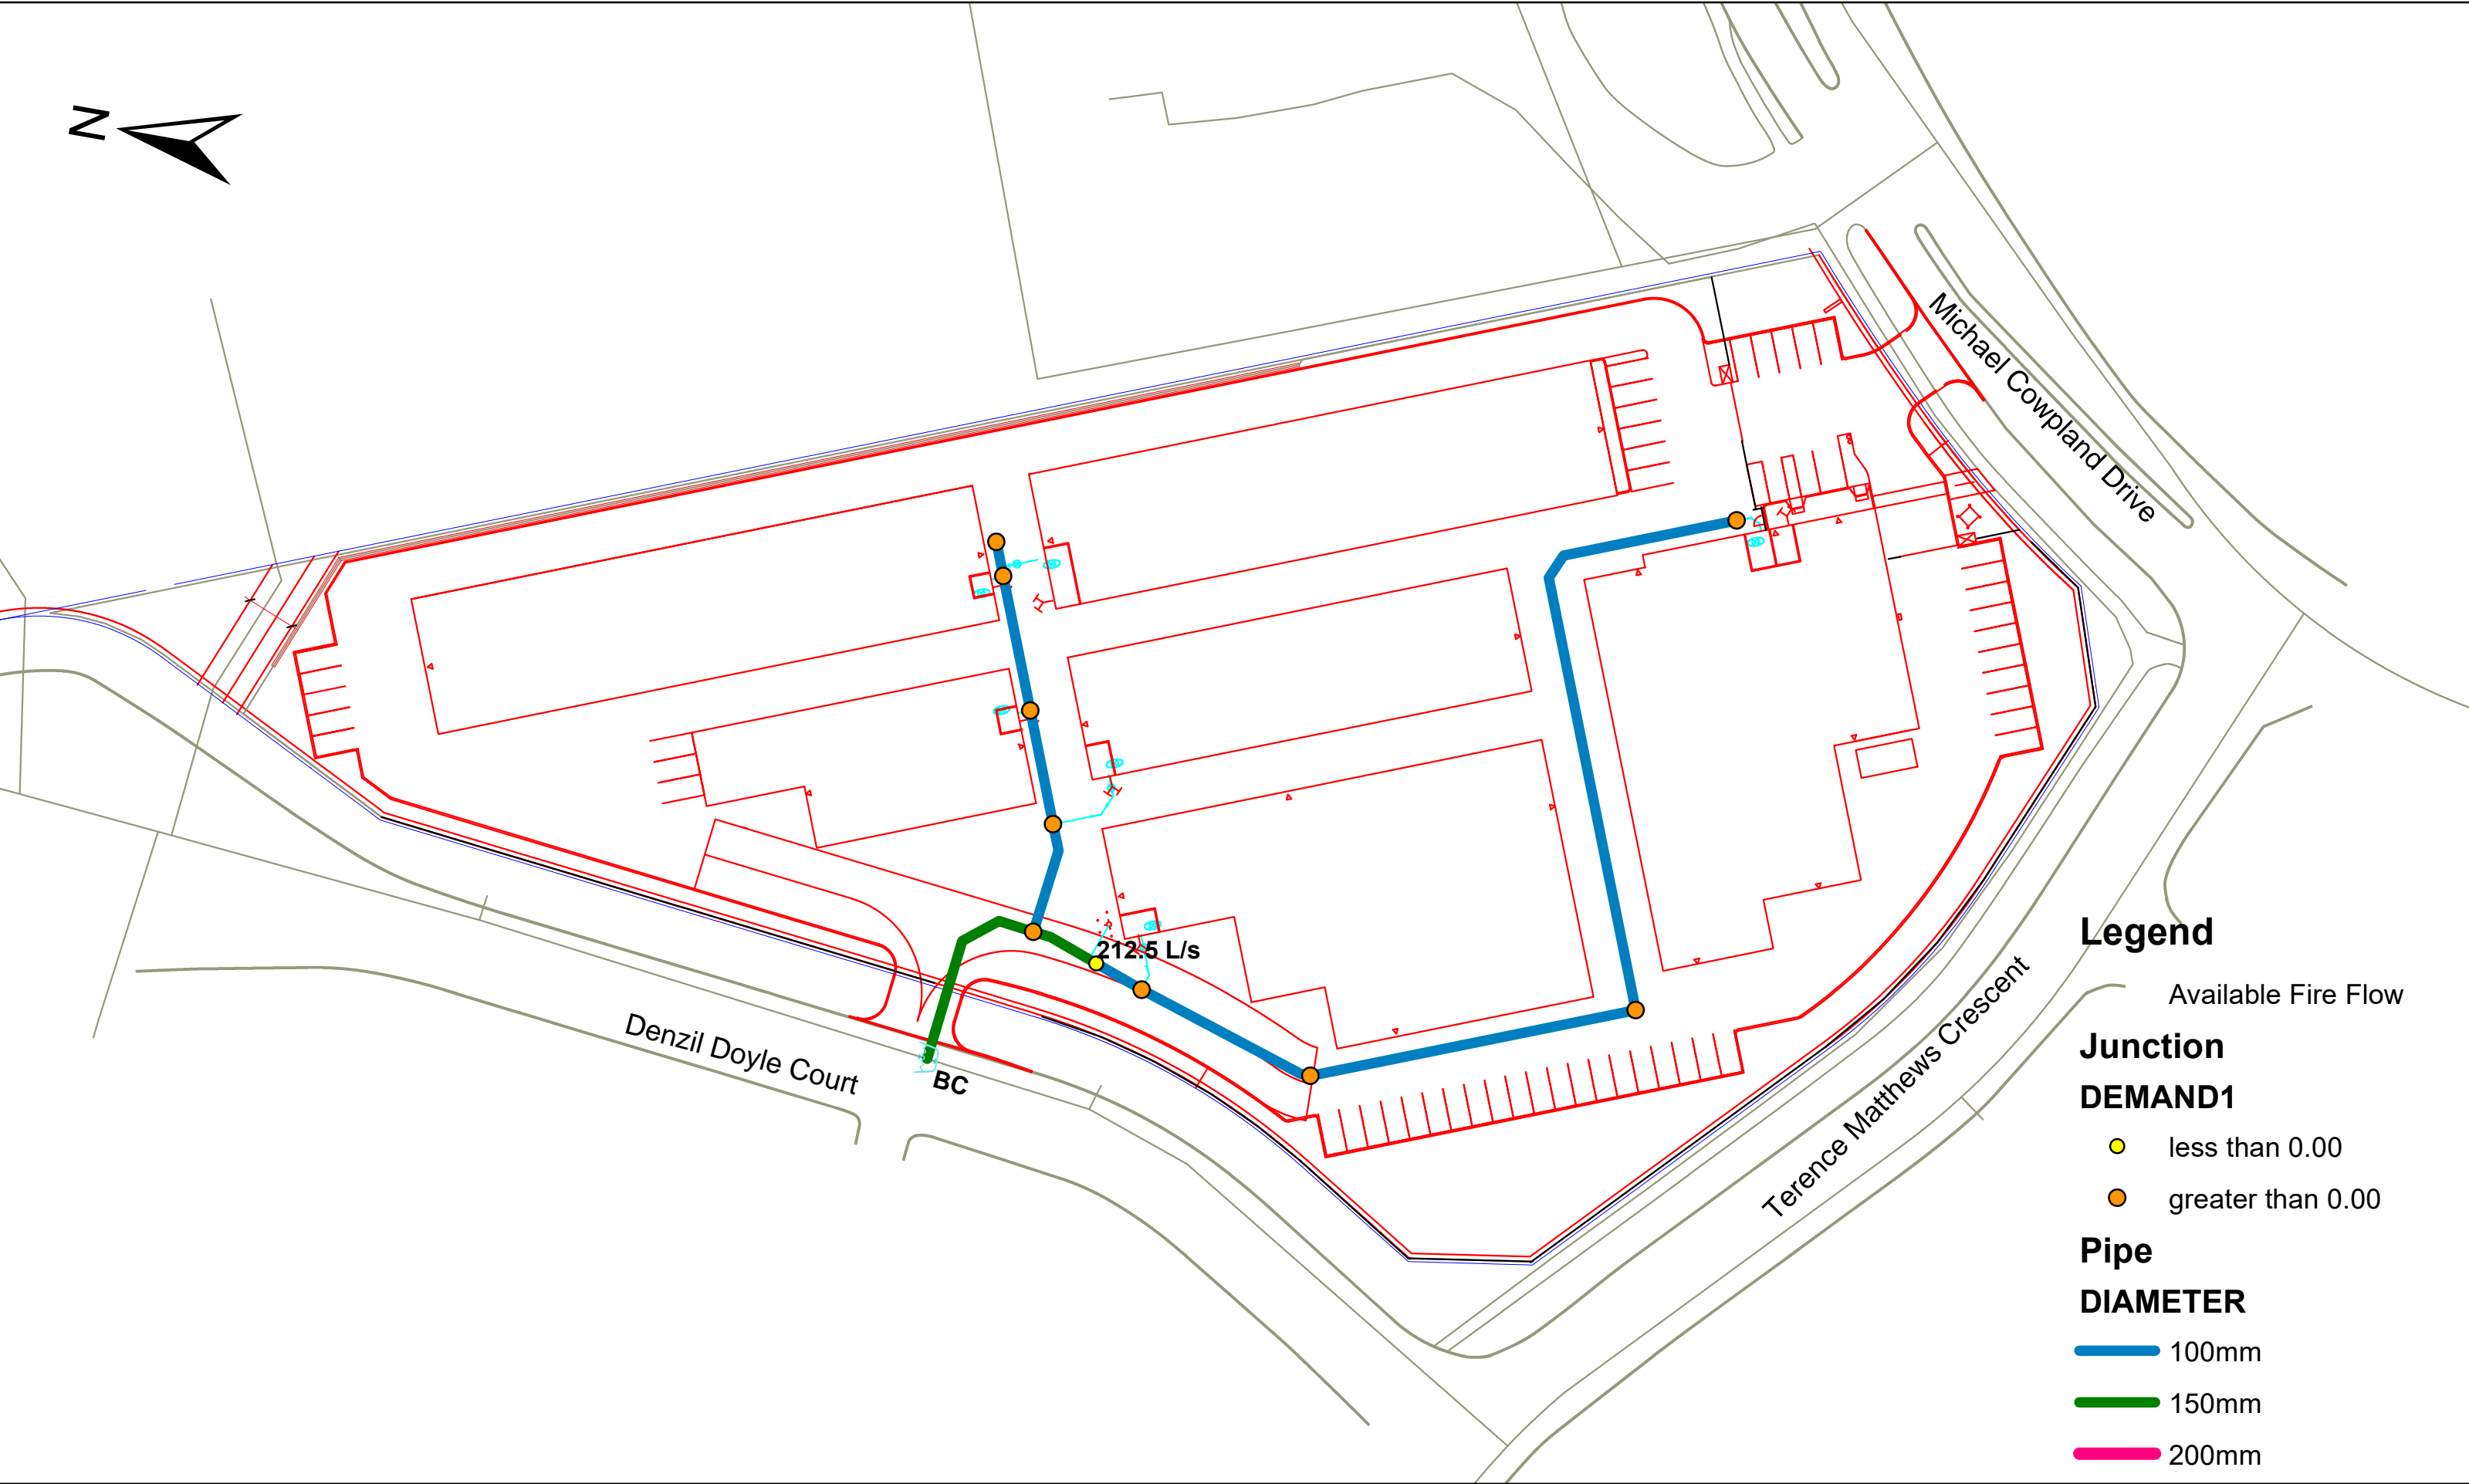

Legend

Available Fire Flow

Junction

DEMAND1

- less than 0.00
- greater than 0.00


Pipe

DIAMETER

- 100mm
- 150mm
- 200mm

Max Day+ Fire Flow

		ID	Static Demand (L/s)	Static Pressure (kPa)	Static Head (m)	Fire-Flow Demand (L/s)	Residual Pressure (kPa)	Hydrant Available Flow (L/s)	Hydrant Pressure at Available Flow (kPa)
1	<input type="checkbox"/>	H01	0.00	492.90	152.30	150.00	312.94	212.47	149.96

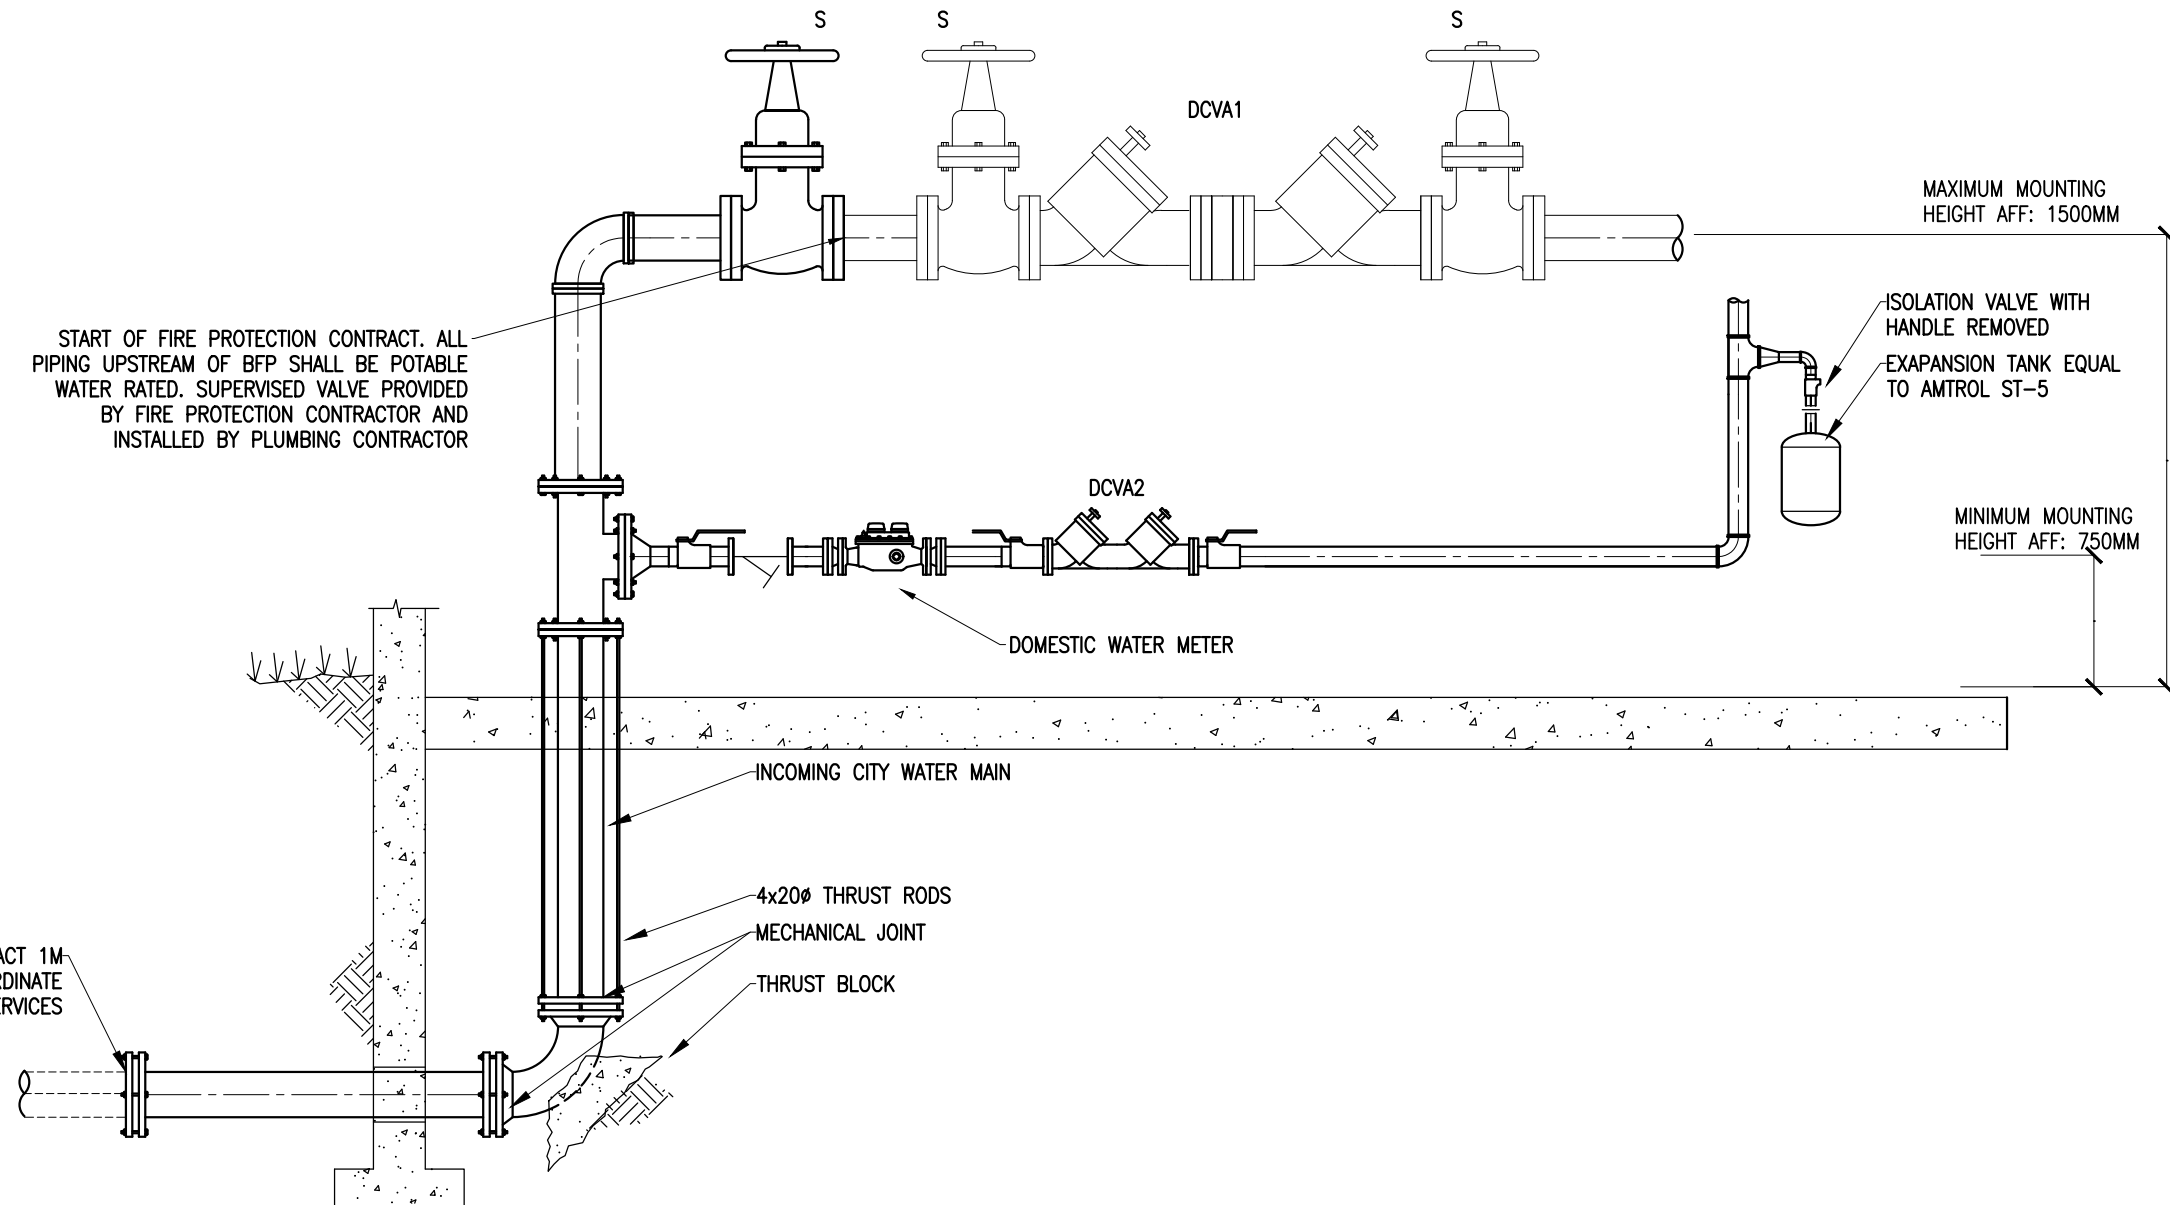

START OF FIRE PROTECTION CONTRACT. ALL PIPING UPSTREAM OF BFP SHALL BE POTABLE WATER RATED. SUPERVISED VALVE PROVIDED BY FIRE PROTECTION CONTRACTOR AND INSTALLED BY PLUMBING CONTRACTOR

START OF PLUMBING CONTRACT 1M FROM FOUNDATION WALL. COORDINATE WITH CIVIL SERVICES

MAXIMUM MOUNTING HEIGHT AFF: 1500MM

MINIMUM MOUNTING HEIGHT AFF: 750MM

DATE	REVISION	REF
2023-06-06	UPDATED DETAIL ISSUED FOR SITE PLAN RESPONSE	-
2023-03-03	ISSUED FOR SITE PLAN RESPONSE	-

THE ENGINEER WAVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHER FAILURE TO OBTAIN AND / OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

THIS DRAWING IS THE PROPERTY OF GOODKEY WEEDMARK & ASSOCIATES LIMITED AND ALL COPYRIGHTS ARE RESERVED. NO USE OF THIS DRAWING MAY BE MADE WITHOUT EXPRESS WRITTEN CONSENT.

DO NOT SCALE DRAWINGS

L'INGÉNIEUR DÉCLINE TOUTE RESPONSABILITÉ DÉCOULANT DE PROBLÈMES FAISANT SUITE AU NON RESPECT DES PLANS, DEVIS ET DE L'INTENTION DU CONCEPT QU'ILS INDIQUENT OU DE TOUTS LES PROBLÈMES POUVANT RESULTER DU DÉFAUT D'OBTENIR ET / OU DE SUIVRE LES CONSEILS DE L'INGÉNIEUR EN CE QUI CONCERNE LES ERREURS, OMISSIONS, INCONSISTANCES, AMBIGUITÉS OU CONFLITS ALLÉGUÉS.

CE DESSIN EST LA PROPRIÉTÉ LITTÉRAIRE DE GOODKEY WEEDMARK & ASSOCIATES LIMITED ET TOUTS LES DROITS SONT RÉSERVÉS. L'UTILISATION EST INTERDITE SANS LE CONSENTEMENT ÉCRIT DE L'AUTEUR.

NE PAS MESURER LES DESSINS À L'ÉCHELLE



1688 Woodward Dr. Ottawa Ontario Canada K2C 3R8
 613 727-5111 Voice
 613 727-5115 Fax
 www.gwal.com Web

PROJECT/PROJET
KANATA SOUTHWEST SELF STORAGE

75 MICHAEL COWPLAND DRIVE,
 OTTAWA, ON

TITLE/TITRE
BUILDING A WATER ENTRY DETAIL

Scale
 Échelle
 N.T.S.

Design by
 Conçu par
 J. HANSEN


Project no./
 No. du projet
 2021-566

Drawn by
 Dessiné par
 J. HANSEN

DWG. No.
 No. DESSIN

Reviewed by
 Examiné par
 R. LEFEBVRE

SK1

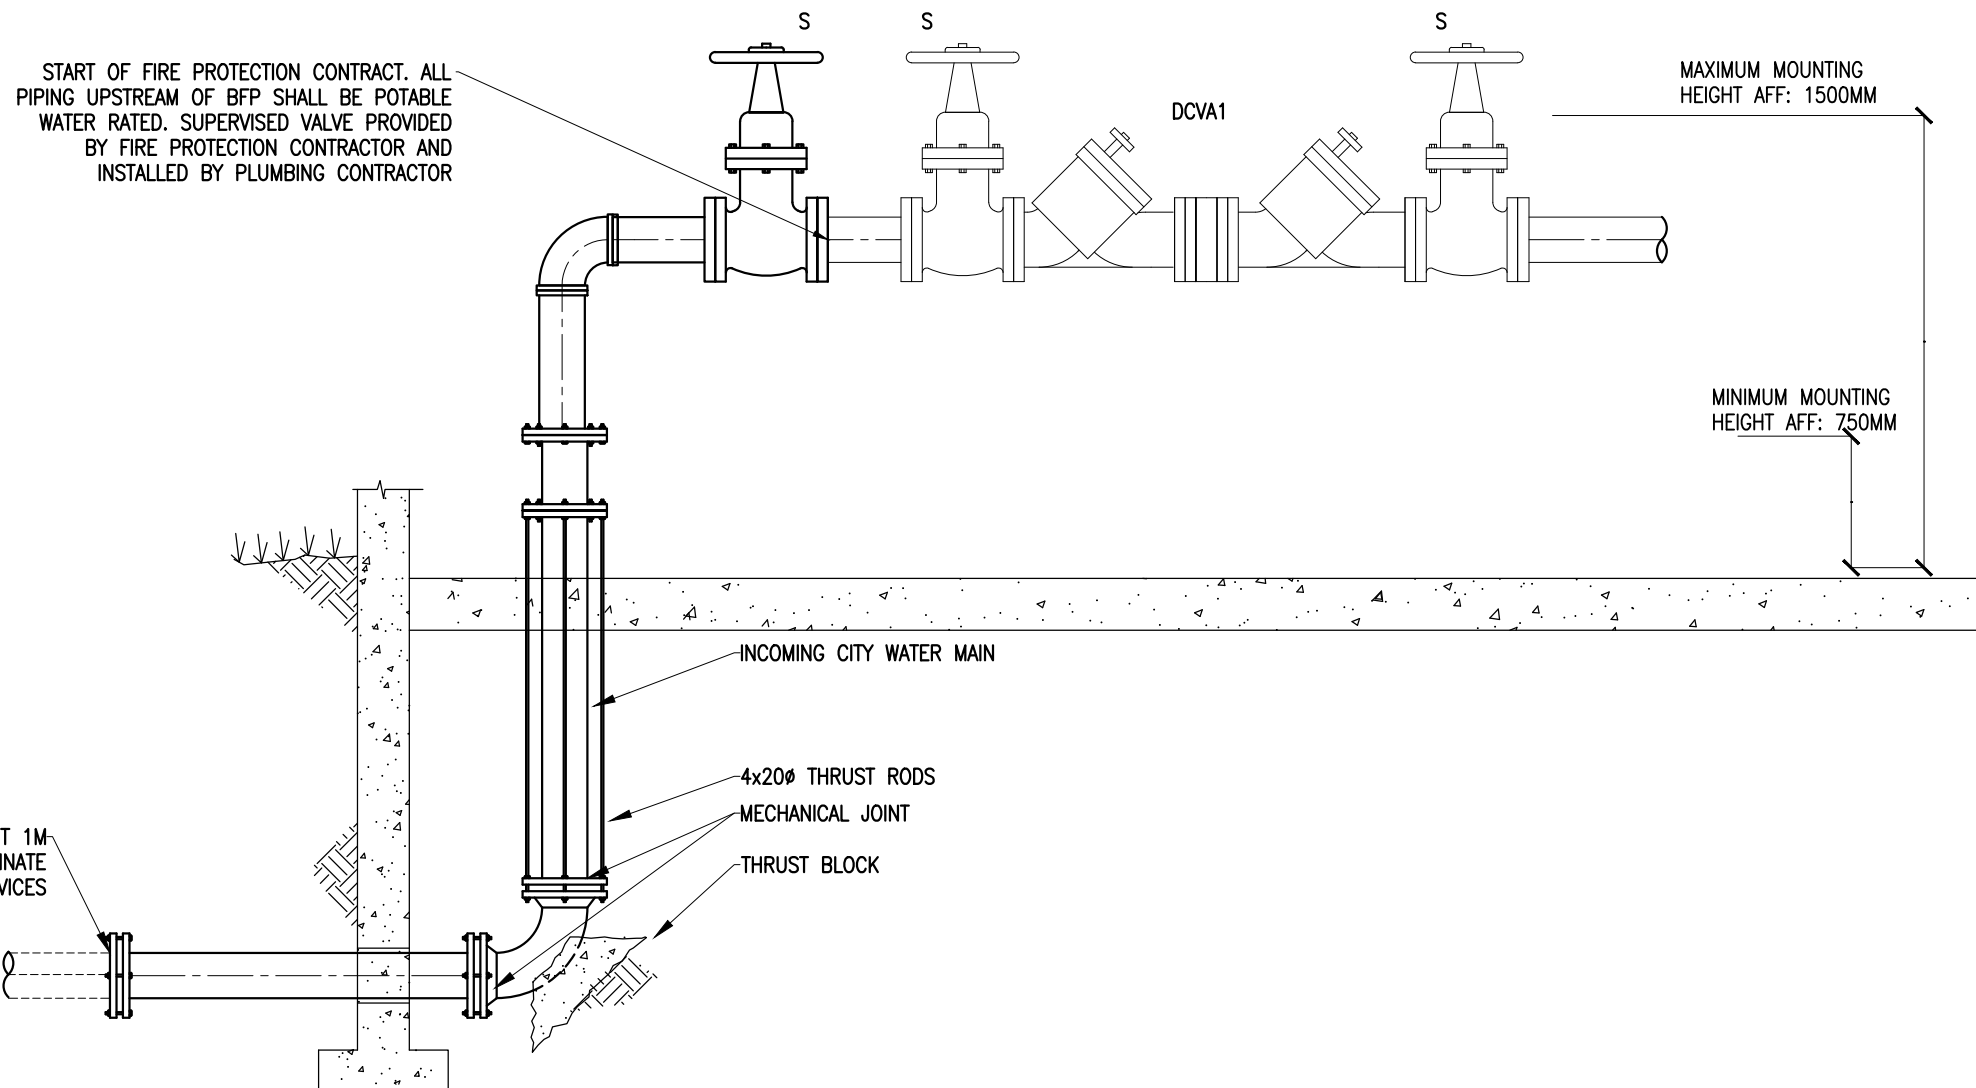

DATE	REVISION	REF
2023-06-06	UPDATED DETAIL ISSUED FOR SITE PLAN RESPONSE	-
2023-03-03	ISSUED FOR SITE PLAN RESPONSE	-

THE ENGINEER WAVES ANY AND ALL RESPONSIBILITY AND LIABILITY FOR PROBLEMS WHICH ARISE FROM FAILURE TO FOLLOW THESE PLANS, SPECIFICATIONS AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS WHICH ARISE FROM OTHER FAILURE TO OBTAIN AND / OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES OR CONFLICTS WHICH ARE ALLEGED.

THIS DRAWING IS THE PROPERTY OF GOODKEY WEEDMARK & ASSOCIATES LIMITED AND ALL COPYRIGHTS ARE RESERVED. NO USE OF THIS DRAWING MAY BE MADE WITHOUT EXPRESS WRITTEN CONSENT.

DO NOT SCALE DRAWINGS

L'INGÉNIEUR DÉCLINE TOUTE RESPONSABILITÉ DÉCOULANT DE PROBLÈMES FAISANT SUITE AU NON RESPECT DES PLANS, DEVIS ET DE L'INTENTION DU CONCEPT QU'ILS INDIQUENT OU DE TOUTS LES PROBLÈMES POUVANT RÉSULTER DU DÉFAUT D'OBTENIR ET / OU DE SUIVRE LES CONSEILS DE L'INGÉNIEUR EN CE QUI CONCERNE LES ERREURS, OMISSIONS, INCONSISTANCES, AMBIGUITÉS OU CONFLITS ALLÉGUÉS.

CE DESSIN EST LA PROPRIÉTÉ LITTÉRAIRE DE GOODKEY WEEDMARK & ASSOCIATES LIMITED ET TOUS LES DROITS SONT RÉSERVÉS. L'UTILISATION EST INTERDITE SANS LE CONSENTEMENT ÉCRIT DE L'AUTEUR.

NE PAS MESURER LES DESSINS À L'ÉCHELLE



1688 Woodward Dr. Ottawa Ontario Canada K2C 3R8
 613 727-5111 Voice
 613 727-5115 Fax
 www.gwal.com Web

PROJECT/PROJET
 KANATA SOUTHWEST SELF STORAGE

75 MICHAEL COWPLAND DRIVE,
 OTTAWA, ON

TITLE/TITRE
 TYPICAL BUILDING (BUILDING B TO F)
 ENTRY DETAIL

Scale
 Échelle
 N.T.S.

Design by J. HANSEN
 Conçu par
 Project no./
 No. du projet
 2021-566

Drawn by J. HANSEN
 Dessiné par
 DWG. No.
 No. DESSIN

Reviewed by R. LEFEBVRE
 Examiné par
 SK2

Amy Zhuang

From: Bouwman, Andrew <Andrew.Bouwman@architecture49.com>
Sent: Wednesday, November 30, 2022 8:29 AM
To: Amy Zhuang
Cc: Terry Brule; Ryan Magladry; Frank Abrantes; Mathieu Desjardins; Elisabeth Gebremedhin; Hind Barnieh; Chen, Jie
Subject: RE: APD Preferred grading - 60 Denzil Doyle Court

*** Exercise caution. This is an EXTERNAL email. DO NOT open attachments or click links from unknown senders or unexpected email. ***

Hi Amy,

All buildings will fall under OBC Section 3.10 "Self Service Storage Buildings", F-2 Occupancy and non-combustible.

Andrew Bouwman, m.a.a.t.o.
Architectural Technologist

Architecture49 Inc.
1345 Rosemount Ave., Cornwall, Ontario K6J 3E5 Canada
D+1 613.935.0508 F+1 613.936.0335 C+1 613.363.5502

www.architecture49.com
www.architecture49.com/ontario

From: Amy Zhuang <Amy.Zhuang@ibigroup.com>
Sent: November 30, 2022 2:12 AM
To: Hind Barnieh <hbarnieh@accesspd.ca>; Bouwman, Andrew <Andrew.Bouwman@architecture49.com>
Cc: Terry Brule <tbrule@IBIGroup.com>; Ryan Magladry <rماغladry@IBIGroup.com>; Frank Abrantes <fabrantes@accessstorage.ca>; Mathieu Desjardins <mdesjardins@huntingtonproperties.ca>; Elisabeth Gebremedhin <egebremedhin@accesspd.ca>
Subject: RE: APD Preferred grading - 60 Denzil Doyle Court

Hi Hind, thank you for the grading plans!

Just another question – could you confirm if the construction type will be wood frame/ordinary or non-combustible/fire-resistive? Thanks!

Amy Zhuang P.ENG.

Civil Engineer

Suite 500, 333 Preston Street
Ottawa ON K1S 5N4 Canada
tel +1 613 225 1311 ext 64080



IBI Group is now proudly a part of Arcadis.

NOTE: This email message/attachments may contain privileged and confidential information. If received in error, please notify the sender and delete this e-mail message.
NOTE: Ce courriel peut contenir de l'information privilégiée et confidentielle. Si vous avez reçu ce message par erreur, veuillez le mentionner immédiatement à l'expéditeur et effacer ce courriel.

Amy Zhuang

From: Jordan Hansen <jhansen@gwal.com>
Sent: Monday, June 26, 2023 8:23 AM
To: Amy Zhuang
Cc: Chen, Jie; Bouwman, Andrew
Subject: RE: 75 Michael Cowpland - Fire Department Hose Line

*** Exercise caution. This is an EXTERNAL email. DO NOT open attachments or click links from unknown senders or unexpected email. ***

Hi Amy,

The sprinkler system will be designed and installed in accordance with NFPA-13 requirements. The sprinkler system will be supplied from the city water connection and the demand will be calculated using the hazard classification plus the appropriate inside/outside hose allowances.

Based on the below it appears this would meet the requirements for a standard water supply.

Thanks,

JORDAN HANSEN C.E.T. | **Mechanical Technologist**
GOODKEY, WEEDMARK & ASSOCIATES LTD.

Email: jhansen@gwal.com

Office: (613) 727-5111 ext. 236 Mobile: (613) 282-5291

Address: 1688 Woodward Drive | Ottawa, Ontario | K2C 3R8

Website: www.gwal.com



GWAL
Goodkey, Weedmark & Associates Ltd.



Your *Trusted Choice* for Mechanical & Electrical Consulting Engineers *Since 1956*

Follow us on [LinkedIn](#)

From: Amy Zhuang <Amy.Zhuang@ibigroup.com>
Sent: Friday, June 23, 2023 10:44 AM
To: Jordan Hansen <jhansen@gwal.com>
Cc: Chen, Jie <jie.chen@architecture49.com>; Bouwman, Andrew <Andrew.Bouwman@architecture49.com>
Subject: RE: 75 Michael Cowpland - Fire Department Hose Line

Hi Jordan, could you confirm if the water supply is standard for both the sprinkler system and the fire department hose lines? Thanks!

Amy Zhuang P.ENG.

Civil Engineer

APPENDIX C

- Sanitary Sewer Design Sheet
- OPSD 1003.010 Drop Structure




IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

SANITARY SEWER DESIGN SHEET


75 Michael Cowpland
 City of Ottawa
 Huntington Properties

LOCATION				RESIDENTIAL										ICI AREAS								INFILTRATION ALLOWANCE				FIXED FLOW (L/s)		TOTAL FLOW (L/s)	PROPOSED SEWER DESIGN					
STREET	AREA ID	FROM MH	TO MH	AREA w/ Units (Ha)	UNIT TYPES				AREA w/o Units (Ha)	POPULATION		RES PEAK FACTOR	PEAK FLOW (L/s)	INSTITUTIONAL		COMMERCIAL		INDUSTRIAL		ICI PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)		FLOW (L/s)	IND	CUM	TOTAL FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY	
					SF	TH/SD	1 Bed APT	2 Bed APT		IND	CUM			IND	CUM	IND	CUM	IND	CUM			IND	CUM										IND	CUM
		Building B	MH8A								3.80	0.00	0.00	0.0	0.12	0.12	0.00	0.0	1.50	0.06	0.12	0.12	0.04	0.00	0.0	0.10	5.39	21.68	100	1.00	0.665	5.29	98.22%	
		Building A	MH8A								3.80	0.00	0.00	0.0	0.15	0.15	0.00	0.0	1.50	0.07	0.15	0.27	0.09	0.00	0.0	0.16	5.39	6.31	100	1.00	0.665	5.23	97.01%	
		MH8A	MH2A								3.80	0.00	0.00	0.0	1.39	1.66	0.00	0.0	1.50	0.81	1.39	1.66	0.55	0.00	0.0	1.35	27.59	12.82	200	0.65	0.851	26.23	95.10%	
		MH2A	MH3A								3.80	0.00	0.00	0.0	0.00	1.66	0.00	0.0	1.50	0.81	0.00	1.66	0.55	0.00	0.0	1.35	27.59	38.47	200	0.65	0.851	26.23	95.10%	
		MH3A	MH4A								3.80	0.00	0.00	0.0	0.00	1.66	0.00	0.0	1.50	0.81	0.00	1.66	0.55	0.00	0.0	1.35	27.59	20.51	200	0.65	0.851	26.23	95.10%	

Design Parameters:				Notes:				Designed: WZ				No. Revision				Date																		
Residential		ICI Areas		1. Mannings coefficient (n) = 0.013				2. Demand (per capita): 280 L/day				3. Infiltration allowance: 0.33 L/s/Ha				4. Residential Peaking Factor: Hamon Formula = $1 + \frac{14}{4 + (P/1000)^{0.5}}$ where K = 0.8 Correction Factor				5. Commercial and Institutional Peak Factors based on total area, 1.5 if greater than 20%, otherwise 1.0														
SF	3.4	p/p/u		INST	28,000	L/Ha/day																												
TH/SD	2.7	p/p/u		COM	28,000	L/Ha/day																												
1 Bed	1.4	p/p/u		IND	35,000	L/Ha/day																												
2 Bed	2.1	p/p/u																																
Other	60	p/p/Ha			17000	L/Ha/day																												
								Checked: RM				Dwg. Reference: 135470-400				File Reference: 135470-6.04.04				Date: 2022-12-09				Sheet No: 1 of 1										

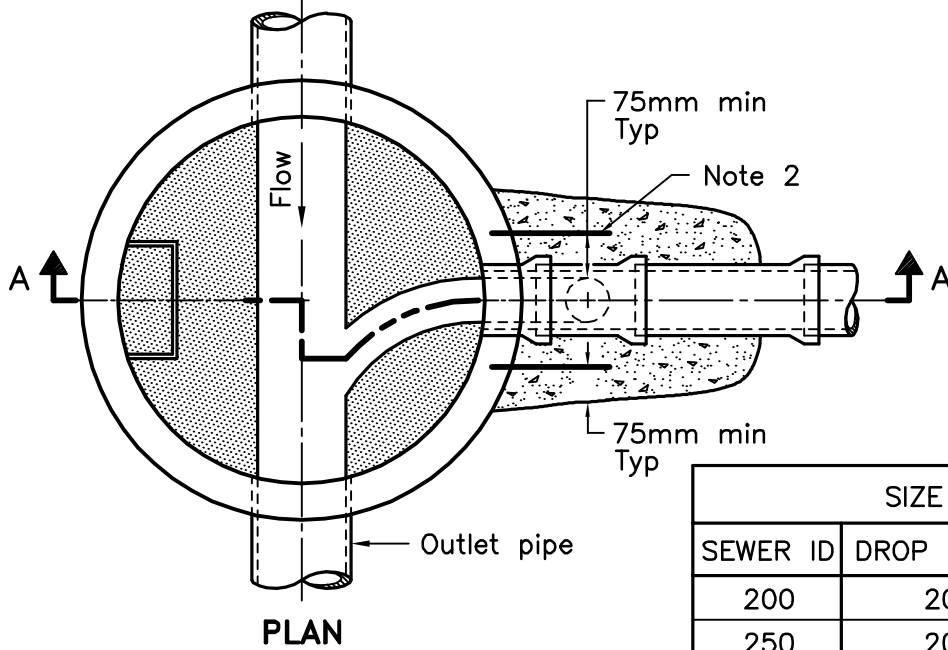


SIZE OF DROP PIPE		
SEWER ID	DROP PIPE ID	APPLICATION
200	200	Storm and Sanitary
250	200	Storm and Sanitary
300	250	Storm and Sanitary
375	300	Storm and Sanitary
450	375	Storm
525	450	Storm
600	525	Storm
675	600	Storm

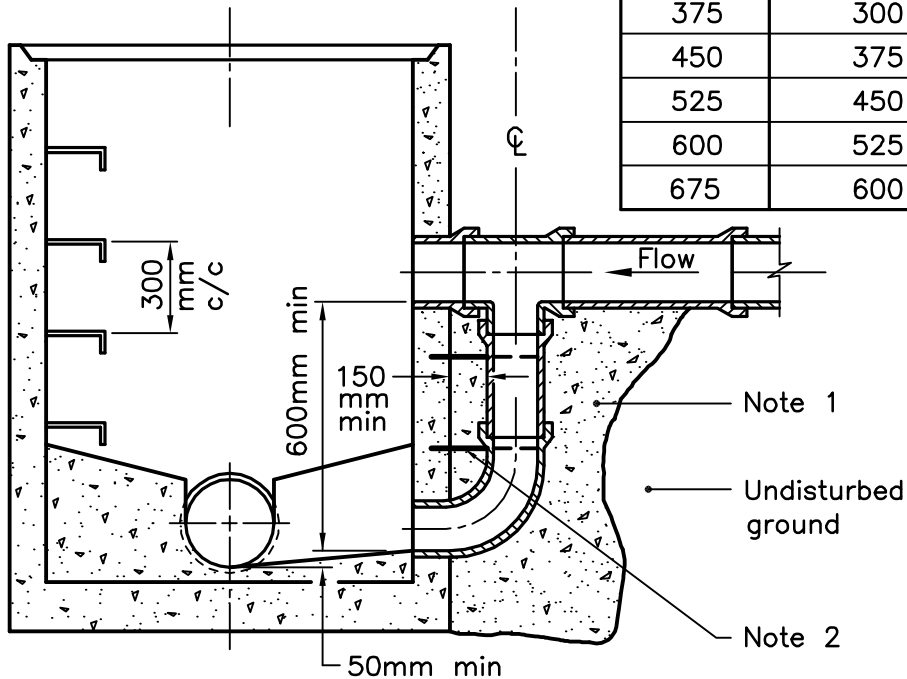

SECTION A-A

NOTES:



- Concrete shall be placed to undisturbed ground and the outside face of the maintenance hole, but there shall be a minimum of 150mm of 15MPa concrete around the drop pipe.
 - Concrete shall be secured to the maintenance hole with 450mm long, 13mm diameter threaded rods and drilled expansion anchors down either side of the drop pipe at 300mm centres.
- A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING		Nov 2016	Rev 3	
CAST-IN-PLACE MAINTENANCE HOLE DROP STRUCTURE TEE		-----		

		OPSD 1003.010		

APPENDIX D

- Storm Drainage Area Plan Drawing C-500
- Storm Sewer Design Sheet
- Ponding Plan Drawing C-600
- Stormwater Management Design Sheet
- Underground Storage Calculation Sheet
- Orifice Sizing Sheet
- Overflow Calculation
- IPEX ICD Specifications
- Kanata South Business Park – Stormwater Management Report
- OGS HydroDome Sizing Summary
- StormTech MC-3500 Underground Storage Chamber Details

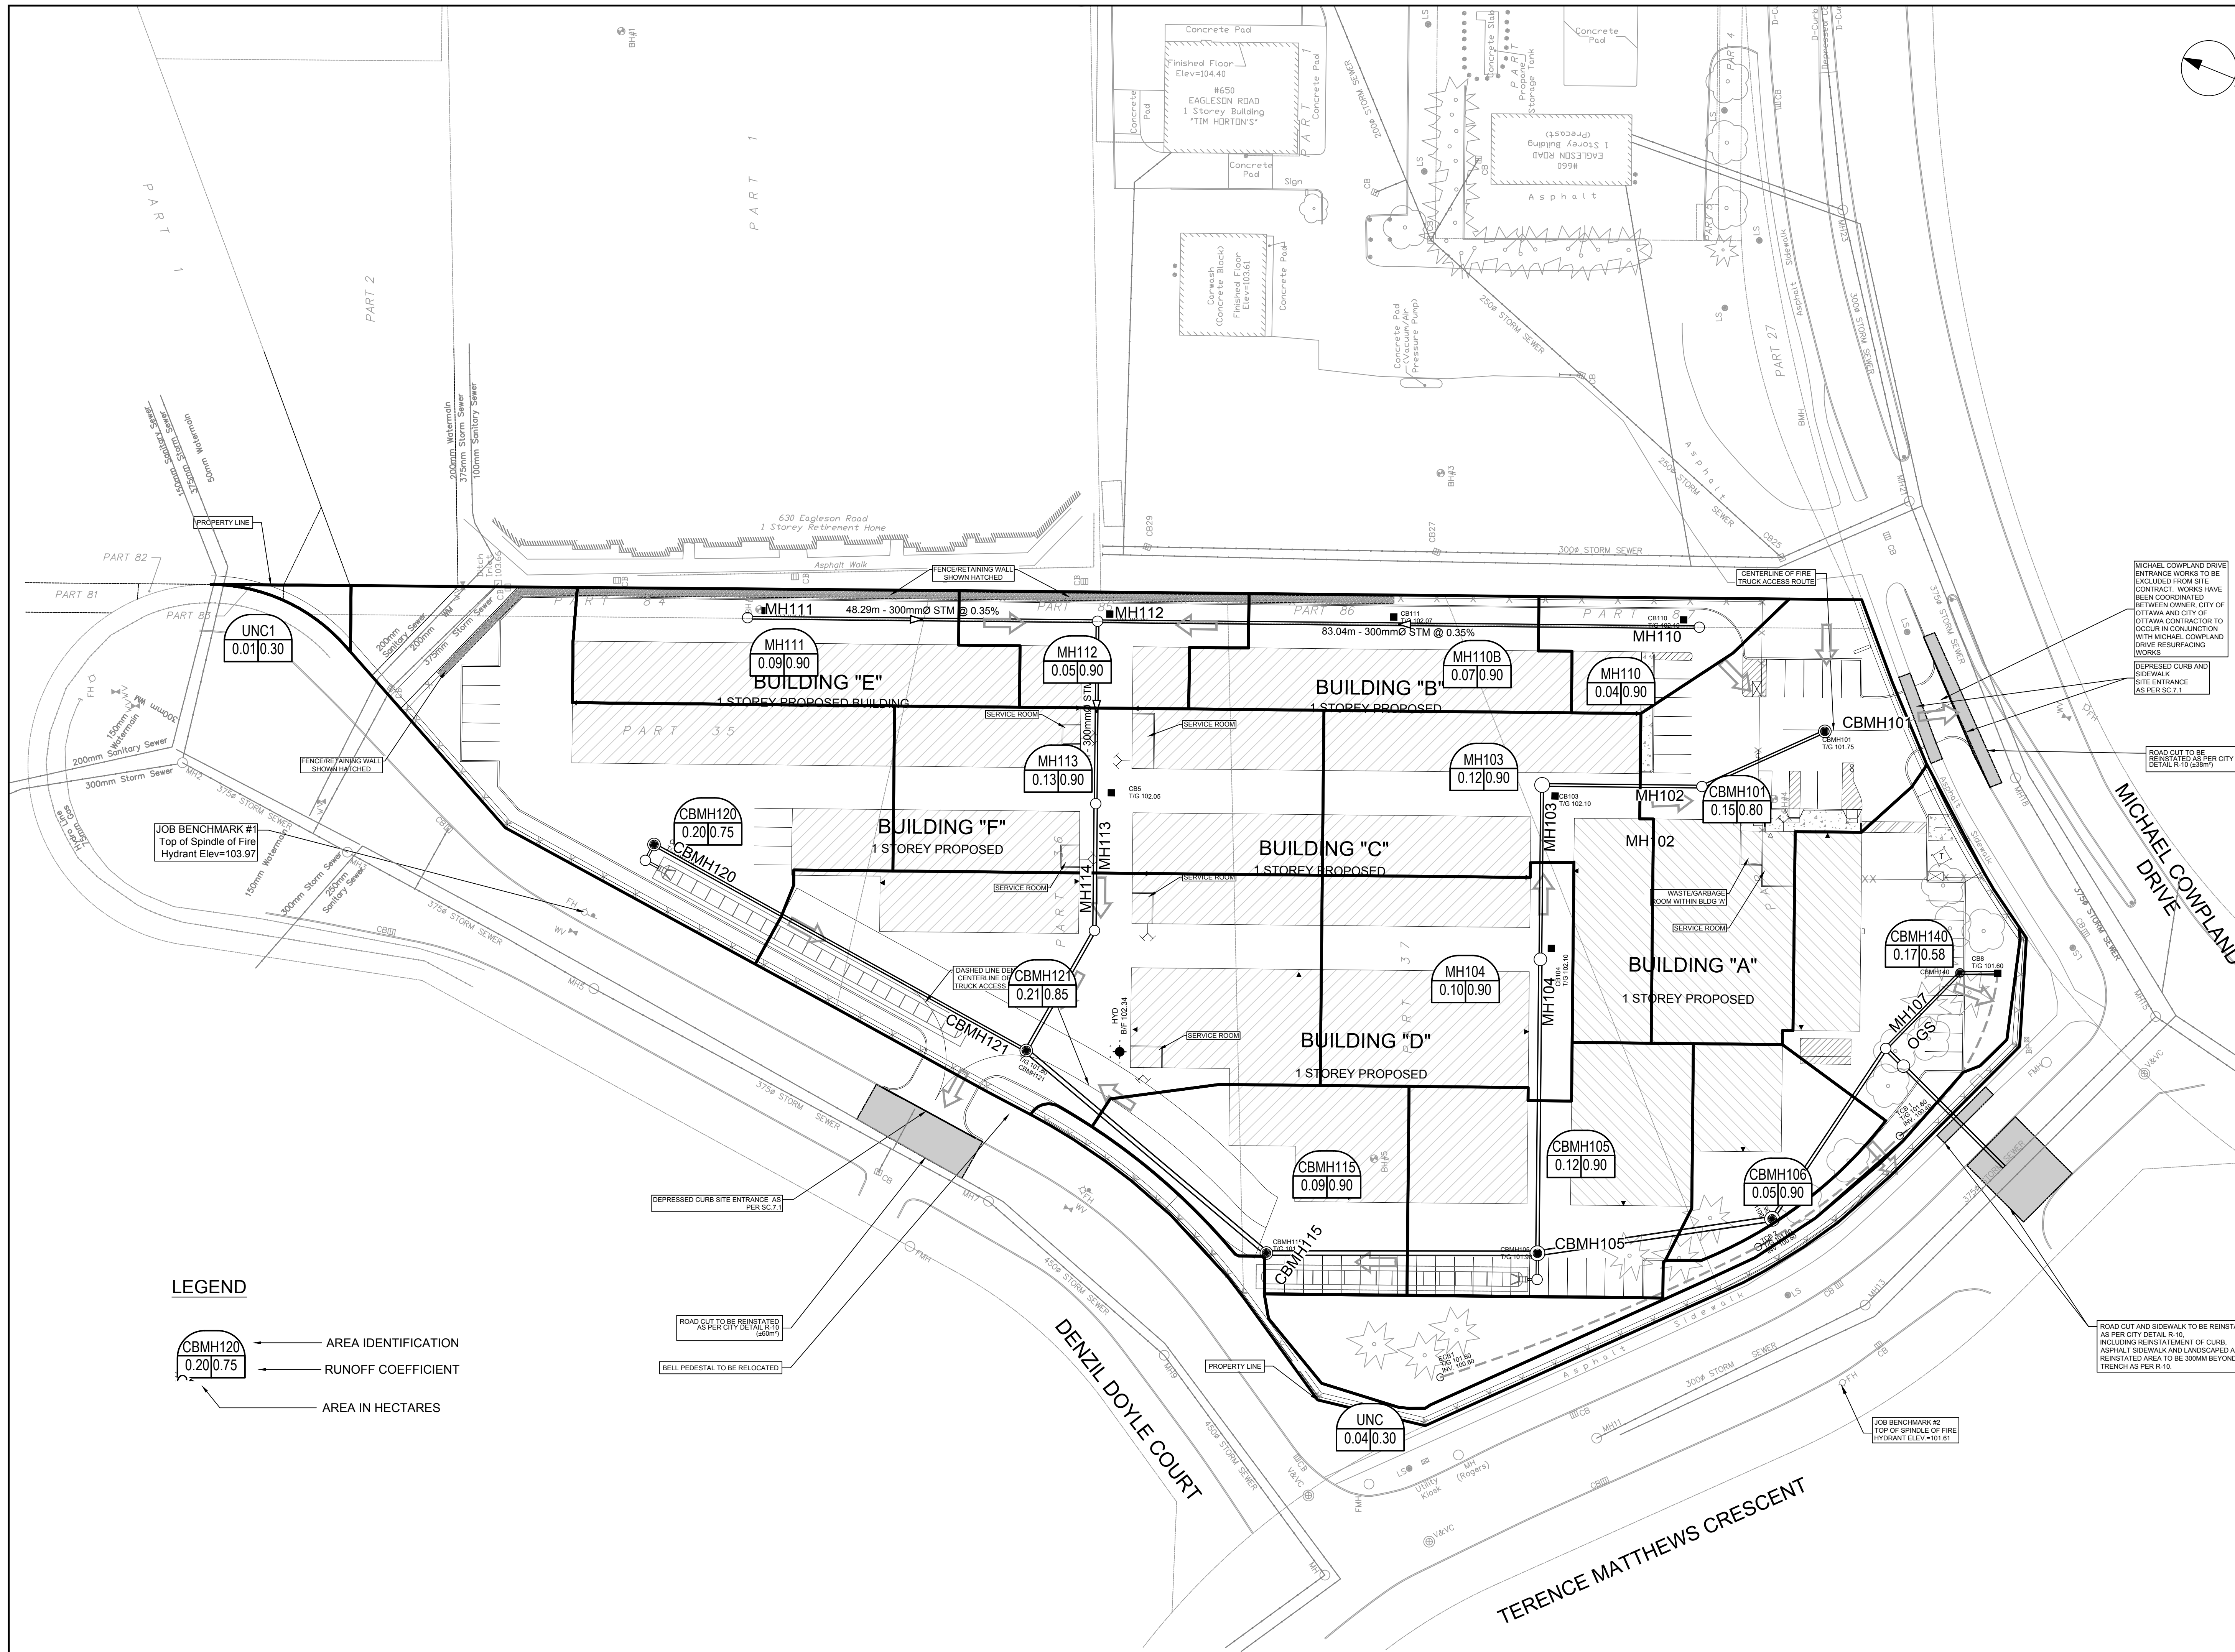


CLIENT
HUNTINGTON PROPERTIES

COPYRIGHT
 This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.
 IBI Group Professional Services (Canada) Inc.
 is a member of the IBI Group of companies.


ISSUES

No.	DESCRIPTION	DATE
1	ISSUED FOR CITY REVIEW	2023-12-09
2	REVISED PER CITY COMMENTS	2023-03-09
3	REVISED PER CITY COMMENTS	2023-07-07
4	REVISED PER CITY COMMENTS	2023-07-19
5	REVISED PER CITY COMMENTS	2023-09-22
6	REVISED PER CITY COMMENTS	2023-11-13
7	REVISED PER CITY COMMENTS	2023-12-20

SEE 010, 011, 012 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

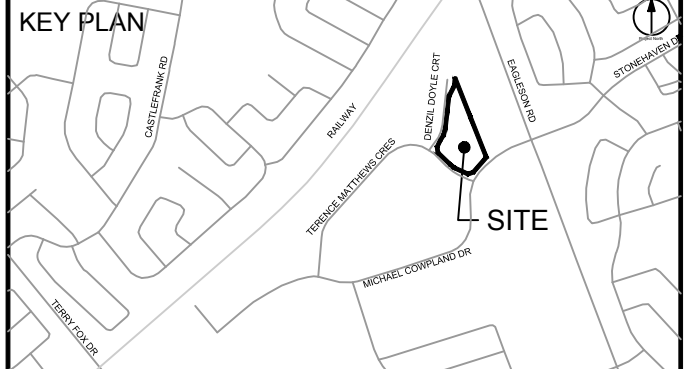

CONSULTANTS
 Project Coordinator:
 Huntington Properties
 Architect:
 A49 Architecture
 Landscape:
 Fohem
 Mechanical & Electrical:
 Goodkey, Weedmark & Associates Limited
 Surveyor:
 Annis O'Sullivan Vollebakk Ltd.
 Geotech:
 Paterson Group

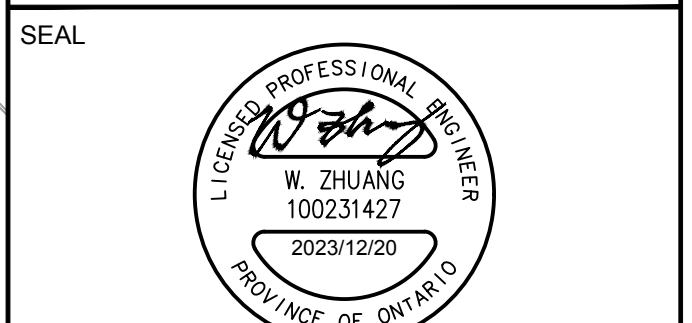

SEAL


IBI GROUP
 Suite 400 - 333 Preston Street
 Ottawa ON K1S 5N4 Canada
 Tel: 613 225 1311 / 613 241 3300 Fax: 613 225 9868
 ibigroup.com

PROJECT
PROPOSED SELF STORAGE DEVELOPMENT
 75 MICHAEL COWPLAND

PROJECT NO:
 135470
 DRAWN BY:
 S.L. / D.D.
 PROJECT MGR:
 R.M.
 CHECKED BY:
 T.R.B.
 APPROVED BY:
 T.R.B.

SHEET TITLE
STORM DRAINAGE AREA PLAN

SHEET NUMBER
C-500
 ISSUE
6

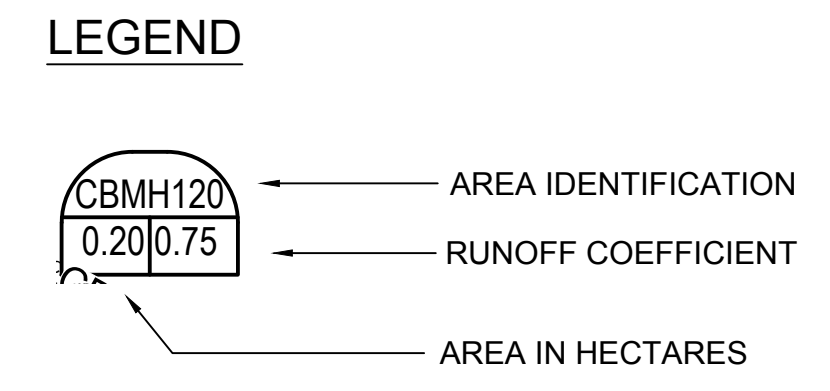

DEPRESSED CURB SITE ENTRANCE AS PER SEC.7.1
 ROAD CUT TO BE REINSTATED AS PER CITY DETAIL R-10 (650P)
 BELL PEDestal TO BE RELOCATED

ROAD CUT TO BE REINSTATED AS PER CITY DETAIL R-10 (650P)

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1


DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

DEPRESSED CURB AND SIDEWALK SITE ENTRANCE AS PER SEC.7.1

CITY PLAN No. 18885
 CITY FILE No. D07-12-22-0174
 File Location: J:\135470_Production\03_Design\04_Civil\Sheets\C-500_STORM DRAINAGE AREA PLAN.dwg
 Last Saved: December 20, 2023, by ehene
 Plotted: Wednesday, December 20, 2023 2:55:23 PM by Eric Henne

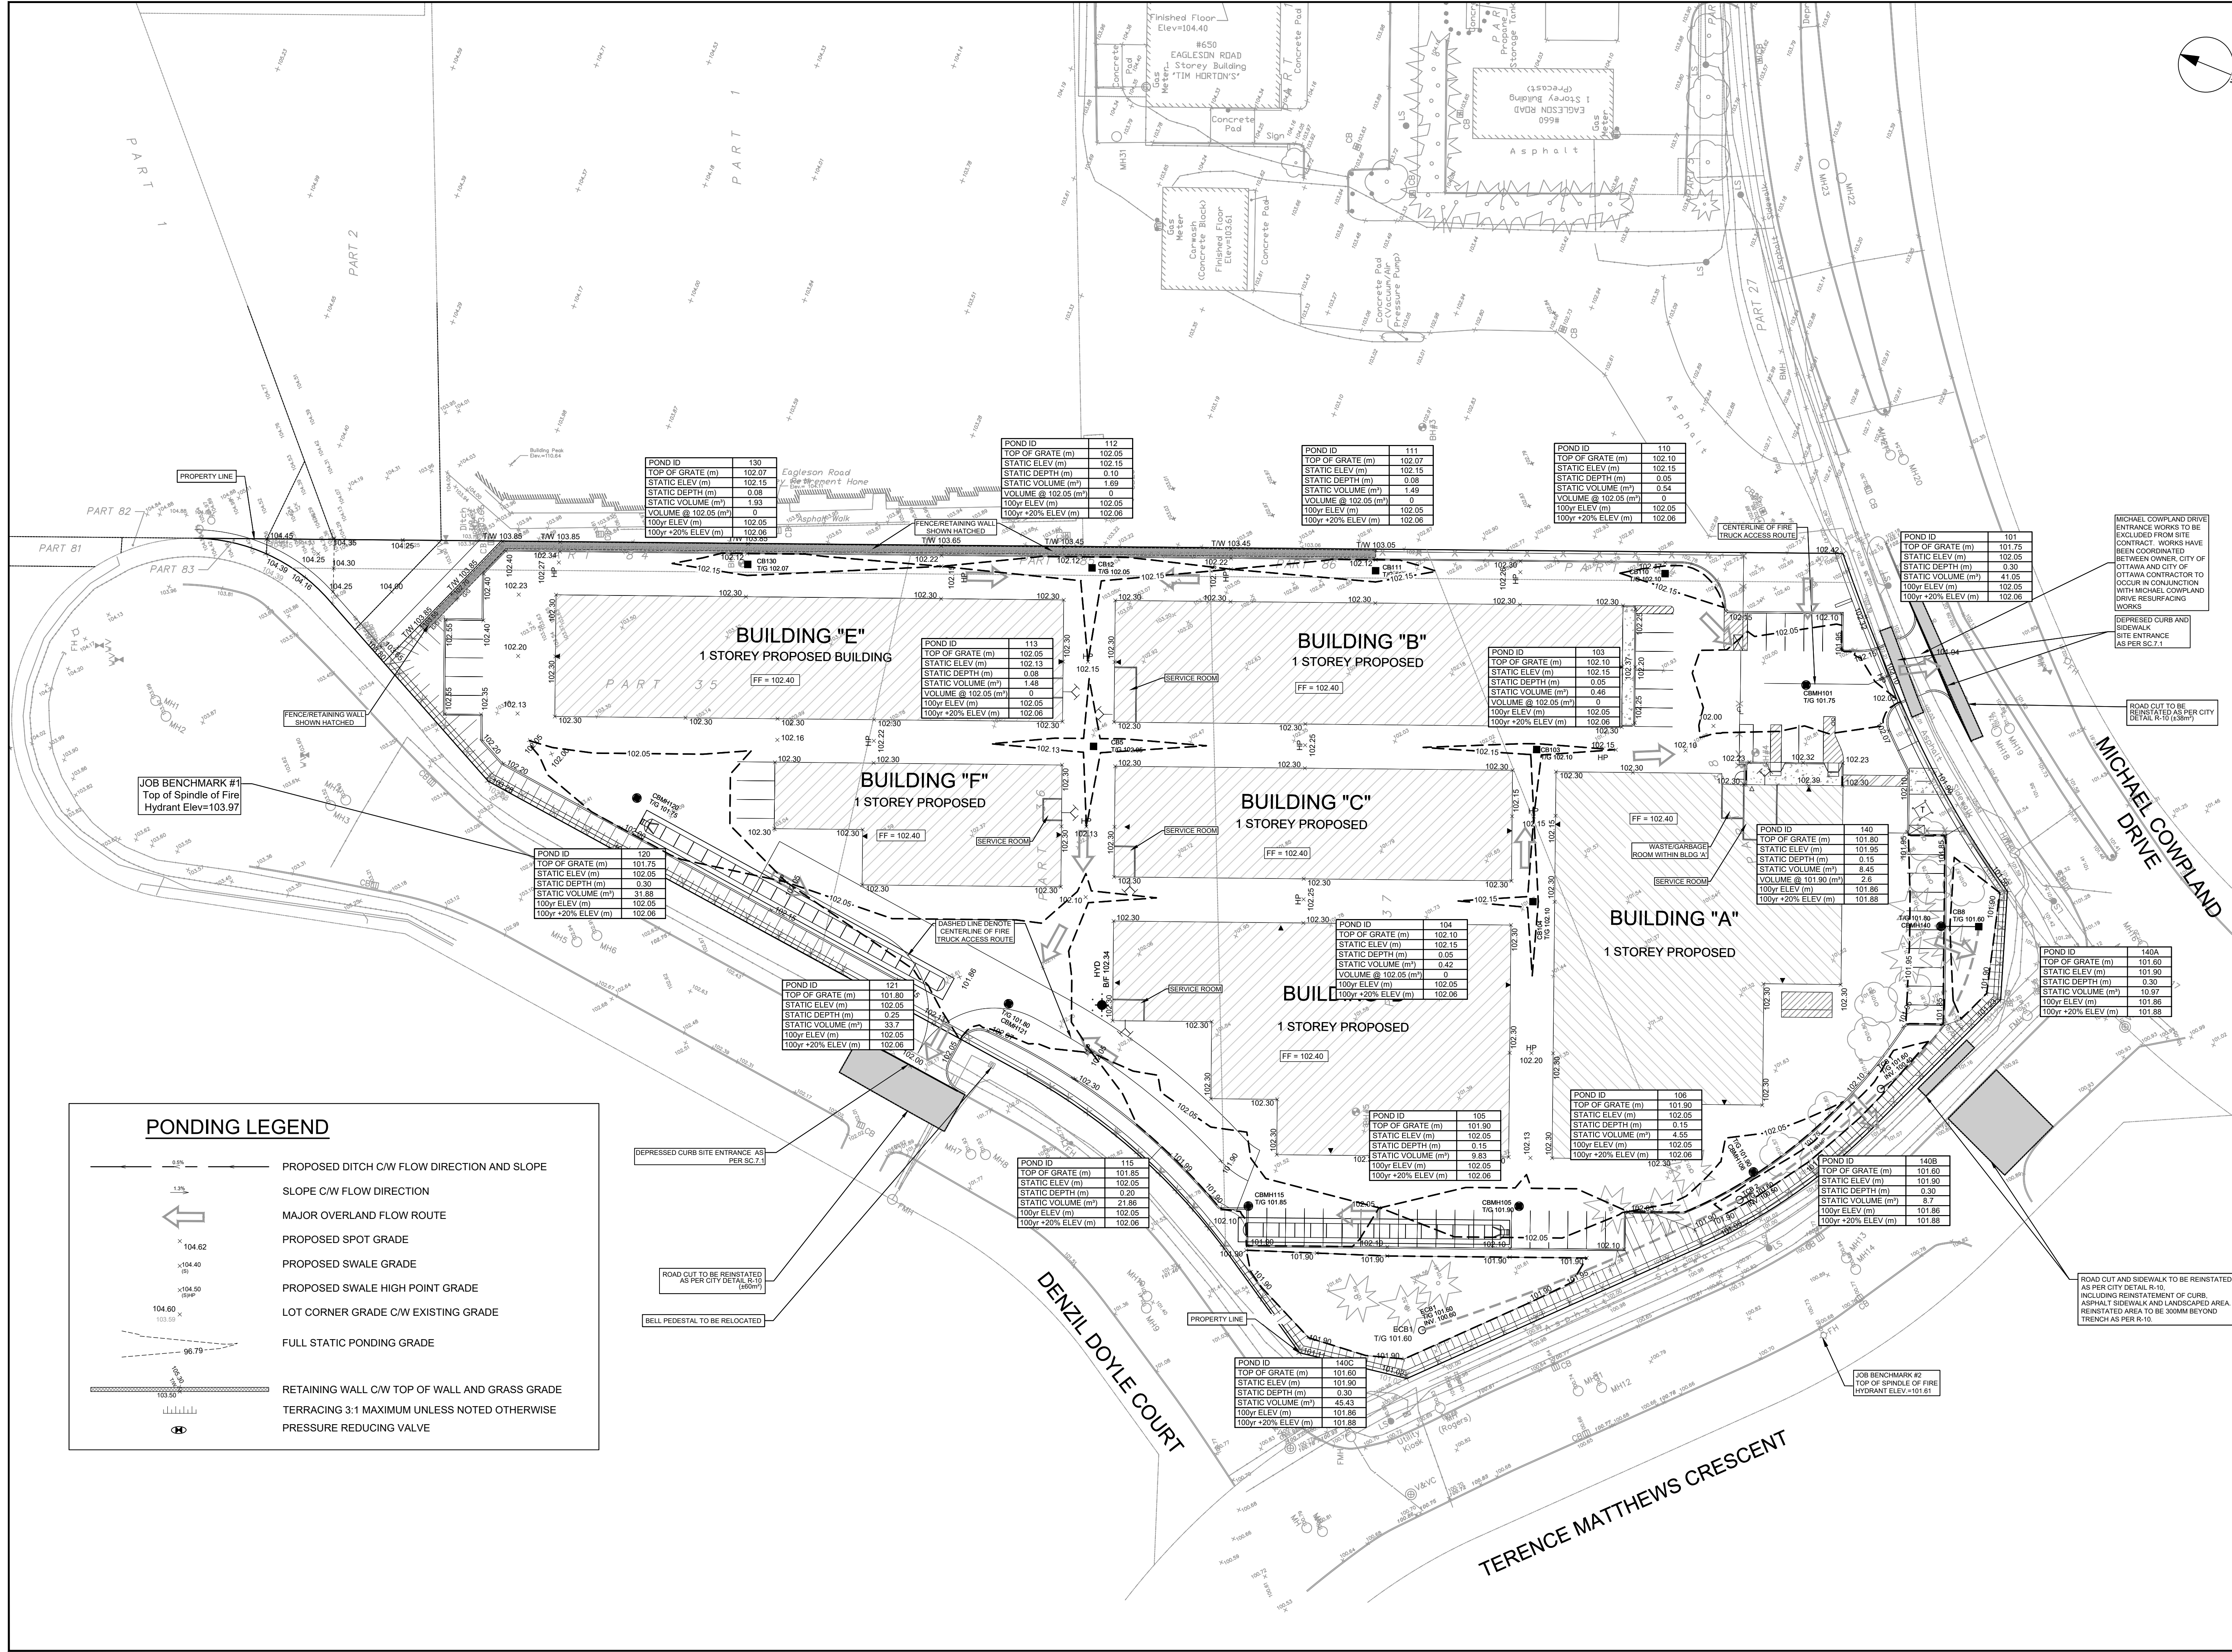

CLIENT
HUNTINGTON PROPERTIES

COPYRIGHT
 This drawing has been prepared solely for the intended use, and any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. When dimensions shall have precedence over scaled dimensions, Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general confirmation before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
 is a member of the IBI Group of companies.

ISSUES

No.	DESCRIPTION	DATE
1	ISSUED FOR CITY REVIEW	2023-12-09
2	REVISED PER CITY COMMENTS	2023-03-09
3	REVISED PER CITY COMMENTS	2023-07-07
4	REVISED PER CITY COMMENTS	2023-07-19
5	REVISED PER CITY COMMENTS	2023-09-22
6	REVISED PER CITY COMMENTS	2023-11-13
7	REVISED PER CITY COMMENTS	2023-12-20

SEE 010, 011, 012 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS.

KEY PLAN

CONSULTANTS

Project Coordinator:
Huntington Properties

Architect:
A49 Architecture

Landscapes:
Fotem

Mechanical & Electrical:
Goodkey, Weedmark & Associates Limited

Surveyor:
Annis O'Sullivan Vollebakk Ltd.

Geotech:
Paterson Group

SEAL

W. ZHUANG
 100231427
 2023/12/20
 PROVINCE OF ONTARIO

PROJECT
PROPOSED SELF STORAGE DEVELOPMENT
 75 MICHAEL COWPLAND

PROJECT NO:
135470

DRAWN BY:
S.L. / D.D.

CHECKED BY:
T.R.B.

PROJECT MGR:
R.M.

APPROVED BY:
T.R.B.

SHEET TITLE
PONDING PLAN

SHEET NUMBER
C-600

ISSUE
6

CITY PLAN NO. 18885
 CITY FILE NO. D07-12-22-0174
 File Location: \\1135470_Production\03_Design\04_Civil\Sheets\C600_PONDING PLAN.dwg Last Saved: December 19, 2023, 12:04:56 PM by Eric Henne
 Photo: Wednesday, December 20, 2023 12:04:56 PM by Eric Henne



IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

PROJECT: 75 Michael Cowpland
DATE: 2023-12-20
FILE: 135470-6.04
REV #: -
DESIGNED BY: WZ
CHECKED BY: RM

STORMWATER MANAGEMENT

Formulas and Descriptions

$i_{2yr} = 1:2 \text{ year Intensity} = 732.951 / (T_c + 6.199)^{0.810}$
 $i_{5yr} = 1:5 \text{ year Intensity} = 998.071 / (T_c + 6.053)^{0.814}$
 $i_{100yr} = 1:100 \text{ year Intensity} = 1735.688 / (T_c + 6.014)^{0.820}$
 $T_c = \text{Time of Concentration (min)}$
 $C = \text{Average Runoff Coefficient}$
 $A = \text{Area (Ha)}$
 $Q = \text{Flow} = 2.78CiA \text{ (L/s)}$

Maximum Allowable Release Rate

Restricted Flowrate (based on 74.2 L/s/Ha)

$A_{site} =$	1.66 Ha
$Q_{restricted} =$	123.17 L/s

Uncontrolled Release ($Q_{uncontrolled} = 2.78 \cdot C \cdot i_{100yr} \cdot A_{uncontrolled}$)

$C =$	0.375
$T_c =$	10 min
$i_{100yr} =$	178.56 mm/hr
$A_{uncontrolled} =$	0.0456 Ha
$Q_{uncontrolled} =$	8.49 L/s

Maximum Allowable Release Rate ($Q_{max\ allowable} = Q_{restricted} - Q_{uncontrolled}$)

$Q_{max\ allowable} =$	114.68 L/s
------------------------	------------

Release Rate Summary

	Area	Flow
Site	1.614	114.00
Uncontrolled	0.05	8.49
	1.660	122.49
Allowable		123.17
		TRUE

MODIFIED RATIONAL METHOD (100-Year & 2-Year Ponding)

Drainage Area Area Tributary to CBMH106

Area (Ha)	1.42	ICD Flow Rate	
C =	0.86	Restricted Flow Q_r (L/s)=	54.00
			108.00

100-Year Ponding						100-Year +20% Ponding		
T_c Variable (min)	i_{100yr} (mm/hour)	Peak Flow $Q_p = 2.78 \cdot C \cdot i_{100yr} \cdot A$ (L/s)	Q_r (L/s)	$Q_p - Q_r$ (L/s)	Volume 100yr (m^3)	100YRQp 20% (L/s)	$Q_p - Q_r$ (L/s)	Volume 100+20 (m^3)
42	72.57	247.13	54.00	193.13	486.69			
47	66.91	227.85	54.00	173.85	490.25			
52	62.14	211.62	54.00	157.62	491.76	253.94	199.94	623.81
57	58.07	197.75	54.00	143.75	491.61			
62	54.54	185.74	54.00	131.74	490.09			

Storage (m^3)					100+20		
Overflow	Required	Surface	Sub-surface	Balance	Overflow	Required	Balance
0.00	491.76	142.87	349.64	0.00	0.00	623.81	131.30
							42.08

overflows to: Street

Drainage Area Area Tributary to CBMH140

Area (Ha)	0.19	ICD Flow Rate	
C =	0.58	Restricted Flow Q_r (L/s)=	6.00

100-Year Ponding						100-Year +20% Ponding		
T_c Variable (min)	i_{100yr} (mm/hour)	Peak Flow $Q_p = 2.78 \cdot C \cdot i_{100yr} \cdot A$ (L/s)	Q_r (L/s)	$Q_p - Q_r$ (L/s)	Volume 100yr (m^3)	100YRQp 20% (L/s)	$Q_p - Q_r$ (L/s)	Volume 100+20 (m^3)
35	82.58	25.28	6.00	19.28	40.48			
40	75.15	23.00	6.00	17.00	40.80			
45	69.05	21.13	6.00	15.13	40.86	25.36	19.36	52.28
50	63.95	19.57	6.00	13.57	40.72			
55	59.62	18.25	6.00	12.25	40.42			

Storage (m^3)					100+20		
Overflow	Required	Surface	Sub-surface	Balance	Overflow	Required	Balance
0.00	40.86	67.70	0	0.00	0.00	52.28	0.00
							0.00

overflows to: Street

Drainage Area r to CBMH106

Area (Ha)	1.424	ICD Flow Rate	
C =	0.90	Restricted Flow Q_r (L/s)=	54.00
			108.00

2-Year Ponding					
T_c Variable (min)	i_{2yr} (mm/hour)	Peak Flow $Q_p = 2.78 \cdot C \cdot i_{2yr} \cdot A$ (L/s)	Q_r (L/s)	$Q_p - Q_r$ (L/s)	Volume 2yr (m^3)
24	46.37	165.27	54.00	111.27	160.23
25	45.17	160.97	54.00	106.97	160.45
26	44.03	156.91	54.00	102.91	160.53
27	42.95	153.07	54.00	99.07	160.49
28	41.93	149.43	54.00	95.43	160.33

Storage (m^3)				
Overflow	Required	Surface	Sub-surface	Balance
0.00	160.53	142.87	349.64	0.00

overflows to: Street

Drainage Area r to CBMH140

Area (Ha)	0.190	ICD Flow Rate	
C =	0.90	Restricted Flow Q_r (L/s)=	6.00

2-Year Ponding					
T_c Variable (min)	i_{2yr} (mm/hour)	Peak Flow $Q_p = 2.78 \cdot C \cdot i_{2yr} \cdot A$ (L/s)	Q_r (L/s)	$Q_p - Q_r$ (L/s)	Volume 2yr (m^3)
40	32.86	15.62	6.00	9.62	23.10
41	32.30	15.35	6.00	9.35	23.01
42	31.76	15.10	6.00	9.10	22.92
43	31.23	14.85	6.00	8.85	22.82
44	30.73	14.61	6.00	8.61	22.72

Storage (m^3)				
Overflow	Required	Surface	Sub-surface	Balance
0.00	22.92	67.70	0	0.00

overflows to: Street



IBI GROUP
400-333 Preston Street
Ottawa, Ontario K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

PROJECT: 75 Michael Cowpland
DATE: 2023-12-20
FILE: 135470 - 6.04.04
REV #: -
DESIGNED BY: WZ
CHECKED BY: RM

ORIFICE SIZING

Orifice coefficients	
Cv =	0.60

	Invert (m)	Diameter (mm)	Centre ICD (m)	Max. Pond Elevation (m)	Hydraulic Slope (m)	Target Flow (l/s)	Theoretical		Recommended	
							Orifice (m)	Actual Flow (l/s)	Orifice (m)	Actual Flow (l/s)
CBMH106	98.899	375	99.087	102.05	2.964	108.0	0.154	108.00	0.154	108.0
CBMH140	98.885	300	99.035	101.95	2.915	6.0	0.036	6.00	0.036	6.0
						114.00				114.00



IBI Group
 333 Preston Street - Suite 400
 Ottawa, Ontario
 K1S 5N4

PROJECT: 75 Michael Cowpland
 City of Ottawa
DEVELOPER : Huntington Properties
JOB #: 135470 - 6.04.04
DATE: 2023-12-20
DESIGN: WZ

FLOW EVALUATION:

Manning's Formula *City of Ottawa sewer design guidelines 6.4.1*
 $Q_{cap} = 1000 * (A * R^{2/3} * S^{1/2}) / n$

Flow Calculations:

Drainage Area	Overall Site except Landscaped Area	
Depth	0.01 m	
Grade	2 %	
Roughness:	0.013 Asphalt	
Parameters		
Area	0.083 sq.m	
Wetted Per.	8.519 m	
Hydr. Radius	0.010	
$Q = (1/N)(A)(R^{0.66})(S^{0.5})$		
$Q_{CAPACITY} =$	42.08 l/s	
Target Release rate =	42.08 l/s	

Overflow to west site entrance

Dimensions Used for Area

Width 8.5 m
Depth 0.01 m

PRODUCT INFORMATION: TEMPEST HF & MHF ICD

Product Description

Our HF, HF Sump and MHF ICD's are designed to accommodate catch basins or manholes with sewer outlet pipes 6" in diameter or larger. Any storm sewer larger than 12" may require custom modification. However, IPEX can custom build a TEMPEST device to accommodate virtually any storm sewer size.

Available in 5 preset flow curves, these ICDs have the ability to provide constant flow rates: 9lps (143 gpm) and greater

Product Function

TEMPEST HF (High Flow): designed to manage moderate to higher flows 15 L/s (240 gpm) or greater and prevent the propagation of odour and floatables. With this device, the cross-sectional area of the device is larger than the orifice diameter and has been designed to limit head losses. The HF ICD can also be ordered without flow control when only odour and floatable control is required.



TEMPEST HF (High Flow) Sump: The height of a sewer outlet pipe in a catch basin is not always conveniently located. At times it may be located very close to the catch basin floor, not providing enough sump for one of the other TEMPEST ICDs with universal back plate to be installed. In these applications, the HF Sump is offered. The HF Sump offers the same features and benefits as the HF ICD; however, is designed to raise the outlet in a square or round catch basin structure. When installed, the HF sump is fixed in place and not easily removed. Any required service to the device is performed through a clean-out located in the top of the device which can be often accessed from ground level.



TEMPEST MHF (Medium to High Flow): The MHF plate or plug is designed to control flow rates 9 L/s (143 gpm) or greater. It is not designed to prevent the propagation of odour and floatables.



Product Construction

The HF, HF Sump and MHF ICDs are built to be light weight at a maximum weight of 6.8 Kg (14.6 lbs).


Product Applications

The HF and MHF ICD's are available to accommodate both square and round applications:



Square Application

Universal Mounting Plate



Round Application

Spigot CB Wall Plate




Universal Mounting Plate Hub Adapter




+


=



The HF Sump is available to accommodate low to no sump applications in both square and round catch basins:

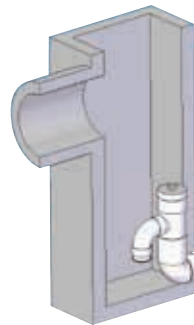

Square Catch Basin

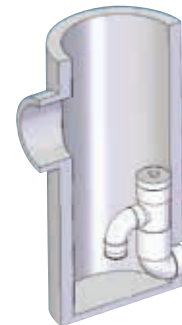

Round Catch Basin

SANTHOSH

STORMWATER MANAGEMENT
REPORT
CITY OF KANATA
KANATA SOUTH BUSINESS PARK

Prepared By: A.J. Robinson & Associates Inc.
February 1986

INTRODUCTION

The Kanata South Business Park is a 38.5 ha tract of land currently designated by the Regional Official Plan for industrial use. The site is located within the City of Kanata and is bounded by Eagleson Road on the east, old Hazeldean Road on the west, the C.P. Railway on the north and O.H.E.C. Right-of-Way on the south.

This property, including approximately 80 ha to the south, has been the subject of previous development plans by the Township of Goulbourn and most recently by Oceatain Properties. The City of Kanata has purchased the land described above and intends to develop a high class light industrial/business park, complete with storm and sanitary sewers, water and curbed roadways.

The purpose of this report is to present for review and approval, the proposed stormwater management design analysis, conclusions and proposed design criteria. Both quality and quantity aspects are addressed.

EXISTING DRAINAGE/PREDEVELOPMENT FLOWS

The existing drainage for the site is shown on the grading and drainage plan (Drawing No. 8555-GI). The total site drainage area of 43 ha includes a portion of Eagleson Road from the railway to the south side of the hydro property. It is noted that a portion of the railway right-of-way and lands to the north, drain along the north boundary to the existing roadside ditch on old Hazeldean Road. Since this drainage pattern will not be altered and does not drain through the site, this area has been excluded from the analysis.

As the topography indicates drainage is generally from east to west to defined ditches which drain to the south into Monahan Creek, a municipal drain, and then into the Jock River.

The predevelopment flow conditions were modelled using OTTHYMO with the design storms and CN values being established from

previous hydrological studies (refer to Bibliography). Figure 1 shows the breakdown of drainage sub-basins for the predevelopment flow analysis resulting in the following calculated peak flow rates, off the Business Park, at the southwest corner:

5 years - 1.64 m³/sec
100 years - 3.40 m³/sec

The computer runs for the modelled system are attached as Appendix 1.

POST DEVELOPMENT CONDITIONS

The City of Kanata has established stormwater management design criterion which stipulate that on an overall site basis, the 5 year and 100 year post development peak release rates must not exceed the predevelopment peak flow rate for the corresponding return period.

With these criteria in mind, it was decided to analyse the following scenarios for stormwater management for the proposed development:

- (1) 5 year post development storm sewer system with stormwater management pond sized for 5 and 100 year storm run-off.
- (2) Retention of 5 year run-off to predevelopment levels on individual lots, 5 year predevelopment flow sizing of storm sewers and stormwater management pond sized for the differences between the 5 and 100 year volume.
- (3) On-lot retention to 5 and 100 year predevelopment flow rates, and 5 year predevelopment flow sizing of storm sewers.

Due to the type of analysis required for post development scenarios, the computer model OTTSWMM was used to evaluate the three alternatives described.

The first scenario was very quickly rejected due to the extremely large storm sewers required (max size 2000 mm), the large volume of storage required (6900 m³) and the corresponding area of land necessary to construct the pond (1.3 ha). The first alternative was simply not cost effective.

The OTTSWMM model simulated the 5 year event with each lot controlling the 5 year run-off in parking lots draining via controlled outlets to the storm sewer. During the 100 year event the excess run-off, beyond the 5 year, overflowed to the major system and was conveyed via swales and roadways to the proposed pond, located in the southwest corner of the site. The additional storage volume required to satisfy the 100 year release rate for the Business Park is approximately 3200 m³. In reviewing this option, several things became evident:

- (i) Due to a calculated 100 year flood level of Monahan Creek of 95.4 m and a corresponding maximum design water level for the proposed pond of 95.4 the effectiveness of a pond to control run-off and eliminate flooding was questionable.
- (ii) The construction of the pond and outlets necessitated considerable grading in a peat bog and caused approximately 0.66 ha of saleable land to be eliminated from the park.
- (iii) Since on-site controls for the 5 year release rate were being considered anyway, it was felt that the additional storage and controls to handle the 100 year flows were not that much more restrictive. It was felt that the 3200 m³ required for the pond could simply be distributed over the developed acreage of the park resulting in approximately 100 m³/ha additional storage volume.

Based on the third scenario the off-lot release rates, to maintain predevelopment flow rates at the outlet, were determined

to be the following:

5 year - 35.8 l/s/ha
100 years - 74.2 l/s/ha

It is noted that the storage volumes determined by OTTSWMM were based on a 73% imperviousness rate. Individual lots when developed will vary in coverage and imperviousness, thus actual storage volumes required, to maintain the stipulated release rates, will vary.

Typical minimum size lots (0.4 ha) were evaluated to confirm that this proposal was practical and relatively easily attainable.

Based on this analysis, the third scenario is proposed for the stormwater management control for this development.

WATER QUALITY

With the proposed quantity control measures in mind, the water quality aspects of the development were addressed with the following conclusions being presented:

- (1) The light industrial/business park type industries are considered to produce a relatively low level of pollutants.
- (2) The development is in the upper reaches of a large watershed draining to the Rideau River. The outlet from the site is to a municipal drain which is running at a very flat grade, thereby, presenting ample opportunity for pollutants to settle out.
- (3) On-site control of stormwater by parking lot and possibly roof top storage will result in a reduction of pollutant loadings.
- (4) Laboratory and field observations, indicate that installation of an orifice in the outlet of a

catchbasin with a sump, has brought about a greater retention of grit and other solids after a storm event than observed with a conventional storm sewer outlet. The constricted release of flow from the orifice causes stormwater to backup in the catchbasin thereby keeping the turbulent zone of the water away from the sump and also reducing velocities in the catchbasin. These actions facilitate settling of suspended solids into the sump.

Based on the above, it is felt that the proposed quantity control measures will also serve to ensure that the proposed development will not unduly effect the quality of water flowing from the site into Monahan Creek and thus to the Rideau River.

STORMWATER MANAGEMENT DESIGN CRITERIA

The following design criteria are proposed for the overall stormwater management for the Business Park:

1. Individual lot developers will be required to provide on lot grading and drainage controls to control site drainage to predevelopment release rates for both the 5 year and 100 year storm events.
2. The maximum off-lot release rates, on an area basis, will not exceed the following:

5 year release rate - 35.8 l/s/ha
100 year release rate - 74.2 l/s/ha
3. Lot grading and drainage controls will generally be up to the developer, however, the design and construction will require approval and certification from the City of Kanata.
4. Control of stormwater release off-site into the pipe network shall be with an orifice fixed to the outlet pipe of the catchbasin/manhole.

5. The minimum orifice size shall be 4700 mm². The depth of ponding of water over the orifice must be designed accordingly to meet the maximum allowable release rate and minimum orifice size.
6. The minimum cover of backfill over the orifice shall be 1.4 metres. Certain lots may require the orifice to be placed in a separate manhole located away from the low point in the parking lot.
7. All parking lot catchbasins/manholes shall contain sumps and will require regular maintenance. Sumps may have to be cleaned out more often than a conventional parking lot drainage network.
8. The storm sewer system will be designed by the rational method using an average run-off co-efficient of 0.25 for developed areas. It is noted that the peak run-off from the storm sewer system calculated using this criterion is 1.80 m³/s comparing to 1.64 m³/s calculated using the OTTHYMO model.

MONAHAN CREEK

As shown on Drawing Nos. 8555-10 and 8555-11 it is proposed that the storm sewer system for the site will outlet to an open ditch running west along the Hydro lands and then southerly to Monahan Drain. Based on minimum cover requirements for the storm sewer and to minimize fill required within the development, the outlet grade of the ditch at Monahan Creek is proposed to be set at 93.52. The existing grade at this point of 94.4. Thus, to obtain outlet for the site, it will be necessary to deepen Monahan Creek from the point of outlet to the existing, and relatively new, culvert at Eagleson Road.

The proposed and existing grade of the deepened drain is shown on Drawing No. 8555-11. The grade up to Fernbank Road corresponds to the proposed grade presented in the Seto-Walt Report. At Fernbank Road, it is proposed to lower the existing culvert to

the new design grade. Based on a peak 25 year flow, calculated by Seto-Walt, of $4.36 \text{ m}^3/\text{s}$, the existing 1.47 m culvert is slightly undersized with a capacity of $3.88 \text{ m}^3/\text{s}$. If the culvert is damaged or is not suitable for reinstallation, it would be replaced with a 1.65 m culvert, to achieve free flow under the 25 year storm event. As part of the final design, we propose to review the flow calculation to confirm the above proposal.

It is noted that work on the drain, downstream of Eagleson Road, has been undertaken in the recent past and that the culvert at Eagleson Road has been replaced with a 1.95 m x 4.4 m concrete box culvert with a capacity of $18.9 \text{ m}^3/\text{s}$. With this in mind and considering the fact that flooding levels suggested by the Seto-Walt Report are lower when the culvert structures are removed (refer to Figures 4-7b and 4-8b of that report), along with the proposal to outlet the development to the drain at predevelopment levels, it is felt that the downstream effects of channelization of the drain will be minimal, if any.

It is proposed that, since Monahan Creek is a municipal drain, the work will be carried out under Seciton 77 of the Drainage Act, whereby certain works (lowering and widening included) may be authorized and carried out by the drainage superintendent of the municipality without petitioning and without the necessity of an Engineer's Report.

FLOOD CONTROLS

In recognition of the maximum 100 year flood level of 95.4 established by the Kostuch Report, it is proposed that all roads and buildings will be kept at least 0.3 m above this elevation and that property owners will be advised accordingly. Seto-Walt calculated a maximum flood level of 96.0, however, since the Kostuch study utilized more sophisticated routing techniques and the topographical mapping is more accurate and comparable to current mapping, it is felt that the 95.4 m level is more representative.

The potential storage volume on the site below the 95.4 contour

level is limited to the southwest corner of the site and is estimated at 7000 m³. The additional volume of storage created by the excavation of the outlet ditch to Monahan Creek is approximately 7500 m³. Thus, the total volume of available storage is approximately the same after development.

BIBLIOGRAPHY

- 1) Flood Risk Mapping of Kizell Drain and Shirley's Brook.
A.J. Robinson and Associates Inc., May 1985.
- 2) Sawmill Creek Water Quality and Quantity Study.
A.J. Robinson and Associates Inc., July 1984.
- 3) Hazeldean South Industrial Park Monahan Drain Drainage
Study. R.M. Kostuch Associates Ltd., July 1976.
- 4) Flood and Erosion Study of the Monahan Creek Drainage Basin.
Seto-Walt and Associates Ltd., April 1975.

APPENDIX I

OTTHYMO RUNS

RAINFALL HYETOGRAPH
 .0400 .0400 .0400 .0400 .0400
 .0400 .0400 .0400 .0400 .0400
 .0400 .0400 .0400 .0400 .0400
 .0799 .0799 .0799 .0799 .0799
 .0799 .0799 .0799 .0799 .0799
 .0799 .0799 .0799 .0799 .0799
 .1199 .1199 .1199 .1199 .1199
 .1599 .1599 .1599 .1599 .1599
 .2398 .2398 .2398 .2398 .2398
 1.7986 1.7986 1.7986 1.7986 1.7986
 .3597 .3597 .3597 .3597 .3597
 .1599 .1599 .1599 .1599 .1599
 .1199 .1199 .1199 .1199 .1199
 .0799 .0799 .0799 .0799 .0799
 .0799 .0799 .0799 .0799 .0799
 .0400 .0400 .0400 .0400 .0400
 .0400 .0400 .0400 .0400 .0400
 .0400 .0400 .0400 .0400 .0400

SHAPE CONSTANT, N = 2.594
 UNIT PEAK = 15.756CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.96
 PEAK DISCHARGE = 5.87 CFS RUNOFF = 1.277 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 1.993 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.64

PRINT HYD ID=1

HYDROGRAPH FROM AREA 100

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	5.35	12.000	0.17	18.000	0.00
0.100	0.00	6.100	4.21	12.100	0.12	18.100	0.00
0.200	0.00	6.200	3.28	12.200	0.09	18.200	0.00
0.300	0.00	6.300	2.70	12.300	0.04	18.300	0.00
0.400	0.00	6.400	2.37	12.400	0.05	18.400	0.00
0.500	0.00	6.500	2.02	12.500	0.04	18.500	0.00
0.600	0.00	6.600	1.71	12.600	0.03	18.600	0.00
0.700	0.00	6.700	1.49	12.700	0.03	18.700	0.00
0.800	0.00	6.800	1.33	12.800	0.02	18.800	0.00
0.900	0.00	6.900	1.23	12.900	0.02	18.900	0.00
1.000	0.00	7.000	1.12	13.000	0.02	19.000	0.00
1.100	0.00	7.100	1.02	13.100	0.02	19.100	0.00
1.200	0.00	7.200	0.94	13.200	0.01	19.200	0.00
1.300	0.00	7.300	0.88	13.300	0.01	19.300	0.00
1.400	0.00	7.400	0.83	13.400	0.01	19.400	0.00
1.500	0.00	7.500	0.80	13.500	0.01	19.500	0.00
1.600	0.00	7.600	0.77	13.600	0.01	19.600	0.00
1.700	0.00	7.700	0.74	13.700	0.01	19.700	0.00

3.500	0.04	9.500	0.80	15.900	0.00	21.900	0.00	27.900	0.00
4.000	0.05	10.000	0.77	16.000	0.00	22.000	0.00	28.000	0.00
4.100	0.07	10.100	0.74	16.100	0.00	22.100	0.00	28.100	0.00
4.200	0.09	10.200	0.71	16.200	0.00	22.200	0.00	28.200	0.00
4.300	0.11	10.300	0.71	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.14	10.400	0.69	16.400	0.00	22.400	0.00	28.400	0.00
4.500	0.17	10.500	0.68	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.21	10.600	0.67	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.25	10.700	0.67	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.29	10.800	0.66	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.33	10.900	0.65	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.40	11.000	0.65	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.50	11.100	0.64	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.60	11.200	0.64	17.200	0.00	23.200	0.00	29.200	0.00
5.300	0.69	11.300	0.64	17.300	0.00	23.300	0.00	29.300	0.00
5.400	0.77	11.400	0.63	17.400	0.00	23.400	0.00	29.400	0.00
5.500	2.03	11.500	0.63	17.500	0.00	23.500	0.00	29.500	0.00
5.600	4.41	11.600	0.63	17.600	0.00	23.600	0.00	29.600	0.00
5.700	7.20	11.700	0.63	17.700	0.00	23.700	0.00	29.700	0.00
5.800	9.96	11.800	0.63	17.800	0.00	23.800	0.00	29.800	0.00
5.900	12.54	11.900	0.62	17.900	0.00	23.900	0.00	29.900	0.00
0									

RUNOFF VOLUME = 0.723 INCHES

PEAK DISCHARGE RATE = 12.54 CFS

ADD HYD PEAK FLOW = ID=6 HYD NO=520 ID I=1 ID II=5 RUNOFF VOLUME = ID II=5 0.835 INCHES

ADD HYD ID=6 25.35 CFS HYD NO=520 ID I=1

COMPUTE HYD ID=2 HYD NO=104 DT=0.100 DA=41.5

AA=0.0 AB=0.0

CN=78.6 IA=0.185 K=0.317 TP=0.268

NI=120

RAIN CODE=-1

SHAPE CONSTANT, N = 0.001

UNIT PEAK = 68.21CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.99

PEAK DISCHARGE = 19.80 CFS RUNOFF = 0.724 INCHES TIME TO PEAK = 6.000 HRS

TOTAL RAINFALL = 1.998 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.36

PRINT HYD ID=2

HYDROGRAPH FROM AREA 104

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	19.80	12.000	1.02	18.000	0.00
0.100	0.00	6.100	18.42	12.100	0.86	18.100	0.00
0.200	0.00	6.200	16.00	12.200	0.68	18.200	0.00
0.300	0.00	6.300	13.74	12.300	0.54	18.300	0.00
0.400	0.00	6.400	12.06	12.400	0.42	18.400	0.00
0.500	0.00	6.500	10.50	12.500	0.34	18.500	0.00
0.600	0.00	6.600	8.98	12.600	0.28	18.600	0.00
0.700	0.00	6.700	7.70	12.700	0.24	18.700	0.00
0.800	0.00	6.800	6.76	12.800	0.21	18.800	0.00

0.900	0.00	6.900	6.14	12.900	0.18	18.900	0.00	24.900	0.00
1.000	0.00	7.000	5.68	13.000	0.16	19.000	0.00	25.000	0.00
1.100	0.00	7.100	5.24	13.100	0.15	19.100	0.00	25.100	0.00
1.200	0.00	7.200	4.87	13.200	0.13	19.200	0.00	25.200	0.00
1.300	0.00	7.300	4.57	13.300	0.12	19.300	0.00	25.300	0.00
1.400	0.00	7.400	4.35	13.400	0.11	19.400	0.00	25.400	0.00
1.500	0.00	7.500	4.18	13.500	0.10	19.500	0.00	25.500	0.00
1.600	0.00	7.600	4.04	13.600	0.09	19.600	0.00	25.600	0.00
1.700	0.00	7.700	3.93	13.700	0.08	19.700	0.00	25.700	0.00
1.800	0.00	7.800	3.83	13.800	0.07	19.800	0.00	25.800	0.00
1.900	0.00	7.900	3.75	13.900	0.06	19.900	0.00	25.900	0.00
2.000	0.00	8.000	3.60	14.000	0.06	20.000	0.00	26.000	0.00
2.100	0.00	8.100	3.49	14.100	0.05	20.100	0.00	26.100	0.00
2.200	0.00	8.200	3.37	14.200	0.05	20.200	0.00	26.200	0.00
2.300	0.00	8.300	2.98	14.300	0.04	20.300	0.00	26.300	0.00
2.400	0.00	8.400	2.84	14.400	0.04	20.400	0.00	26.400	0.00
2.500	0.00	8.500	2.72	14.500	0.03	20.500	0.00	26.500	0.00
2.600	0.00	8.600	2.63	14.600	0.03	20.600	0.00	26.600	0.00
2.700	0.00	8.700	2.55	14.700	0.03	20.700	0.00	26.700	0.00
2.800	0.00	8.800	2.50	14.800	0.02	20.800	0.00	26.800	0.00
2.900	0.00	8.900	2.46	14.900	0.02	20.900	0.00	26.900	0.00
3.000	0.00	9.000	2.42	15.000	0.02	21.000	0.00	27.000	0.00
3.100	0.00	9.100	2.38	15.100	0.02	21.100	0.00	27.100	0.00
3.200	0.00	9.200	2.35	15.200	0.02	21.200	0.00	27.200	0.00
3.300	0.00	9.300	2.33	15.300	0.01	21.300	0.00	27.300	0.00
3.400	0.00	9.400	2.31	15.400	0.01	21.400	0.00	27.400	0.00
3.500	0.01	9.500	2.20	15.500	0.01	21.500	0.00	27.500	0.00
3.600	0.02	9.600	2.03	15.600	0.01	21.600	0.00	27.600	0.00
3.700	0.03	9.700	1.84	15.700	0.01	21.700	0.00	27.700	0.00
3.800	0.04	9.800	1.69	15.800	0.01	21.800	0.00	27.800	0.00
3.900	0.05	9.900	1.57	15.900	0.01	21.900	0.00	27.900	0.00
4.000	0.08	10.000	1.48	16.000	0.01	22.000	0.00	28.000	0.00
4.100	0.10	10.100	1.41	16.100	0.01	22.100	0.00	28.100	0.00
4.200	0.14	10.200	1.36	16.200	0.01	22.200	0.00	28.200	0.00
4.300	0.17	10.300	1.32	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.21	10.400	1.29	16.400	0.00	22.400	0.00	28.400	0.00
4.500	0.25	10.500	1.27	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.31	10.600	1.25	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.38	10.700	1.23	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.45	10.800	1.21	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.51	10.900	1.20	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.61	11.000	1.18	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.75	11.100	1.17	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.91	11.200	1.16	17.200	0.00	23.200	0.00	29.200	0.00
5.300	1.06	11.300	1.15	17.300	0.00	23.300	0.00	29.300	0.00
5.400	1.21	11.400	1.14	17.400	0.00	23.400	0.00	29.400	0.00
5.500	2.63	11.500	1.14	17.500	0.00	23.500	0.00	29.500	0.00
5.600	5.67	11.600	1.13	17.600	0.00	23.600	0.00	29.600	0.00
5.700	9.68	11.700	1.12	17.700	0.00	23.700	0.00	29.700	0.00
5.800	14.04	11.800	1.12	17.800	0.00	23.800	0.00	29.800	0.00
5.900	18.34	11.900	1.11	17.900	0.00	23.900	0.00	29.900	0.00

10
 RUNOFF VOLUME = 0.724 INCHES
 PEAK DISCHARGE RATE = 19.80 CFS

1.500	0.00	7.500	0.72	13.500	0.01	19.500	0.00	25.500	0.00
1.500	0.00	7.500	0.71	13.500	0.00	19.500	0.00	25.500	0.00
2.500	0.00	8.500	0.66	14.000	0.00	20.000	0.00	26.000	0.00
2.500	0.00	8.500	0.60	14.100	0.00	20.100	0.00	26.100	0.00
2.500	0.00	8.500	0.55	14.200	0.00	20.200	0.00	26.200	0.00
2.500	0.00	8.500	0.52	14.300	0.00	20.300	0.00	26.300	0.00
2.500	0.00	8.500	0.50	14.400	0.00	20.400	0.00	26.400	0.00
2.500	0.00	8.500	0.48	14.500	0.00	20.500	0.00	26.500	0.00
2.500	0.00	8.500	0.47	14.600	0.00	20.600	0.00	26.600	0.00
2.500	0.00	8.700	0.46	14.700	0.00	20.700	0.00	26.700	0.00
2.500	0.00	8.800	0.45	14.800	0.00	20.800	0.00	26.800	0.00
2.500	0.00	8.900	0.44	14.900	0.00	20.900	0.00	26.900	0.00
2.500	0.00	9.000	0.44	15.000	0.00	21.000	0.00	27.000	0.00
2.500	0.00	9.100	0.43	15.100	0.00	21.100	0.00	27.100	0.00
2.500	0.00	9.200	0.43	15.200	0.00	21.200	0.00	27.200	0.00
2.500	0.00	9.300	0.42	15.300	0.00	21.300	0.00	27.300	0.00
2.500	0.00	9.400	0.42	15.400	0.00	21.400	0.00	27.400	0.00
2.500	0.01	9.500	0.38	15.500	0.00	21.500	0.00	27.500	0.00
2.500	0.01	9.600	0.34	15.600	0.00	21.600	0.00	27.600	0.00
2.500	0.02	9.700	0.30	15.700	0.00	21.700	0.00	27.700	0.00
2.500	0.03	9.800	0.27	15.800	0.00	21.800	0.00	27.800	0.00
2.500	0.03	9.900	0.26	15.900	0.00	21.900	0.00	27.900	0.00
2.500	0.04	10.000	0.25	16.000	0.00	22.000	0.00	28.000	0.00
2.500	0.06	10.100	0.24	16.100	0.00	22.100	0.00	28.100	0.00
2.500	0.06	10.200	0.23	16.200	0.00	22.200	0.00	28.200	0.00
2.500	0.09	10.300	0.23	16.300	0.00	22.300	0.00	28.300	0.00
2.500	0.11	10.400	0.22	16.400	0.00	22.400	0.00	28.400	0.00
2.500	0.13	10.500	0.22	16.500	0.00	22.500	0.00	28.500	0.00
2.500	0.16	10.600	0.22	16.600	0.00	22.600	0.00	28.600	0.00
2.500	0.19	10.700	0.22	16.700	0.00	22.700	0.00	28.700	0.00
2.500	0.21	10.800	0.21	16.800	0.00	22.800	0.00	28.800	0.00
2.500	0.24	10.900	0.21	16.900	0.00	22.900	0.00	28.900	0.00
2.500	0.27	11.000	0.21	17.000	0.00	23.000	0.00	29.000	0.00
2.500	0.35	11.100	0.21	17.100	0.00	23.100	0.00	29.100	0.00
2.500	0.41	11.200	0.21	17.200	0.00	23.200	0.00	29.200	0.00
2.500	0.46	11.300	0.21	17.300	0.00	23.300	0.00	29.300	0.00
2.500	0.50	11.400	0.21	17.400	0.00	23.400	0.00	29.400	0.00
2.500	1.37	11.500	0.21	17.500	0.00	23.500	0.00	29.500	0.00
2.500	2.74	11.600	0.20	17.600	0.00	23.600	0.00	29.600	0.00
2.500	4.03	11.700	0.20	17.700	0.00	23.700	0.00	29.700	0.00
2.500	5.05	11.800	0.20	17.800	0.00	23.800	0.00	29.800	0.00
2.500	5.57	11.900	0.20	17.900	0.00	23.900	0.00	29.900	0.00

RUNOFF VOLUME = 1.277 INCHES
 PEAK DISCHARGE RATE = 5.67 CFS

COMPUTE HYD

ID=2 HYD NO=101 DT=0.100 DA=2.38
 AA=0.0 AB=0.0
 CN=93 LA=0.185 K=0.141 TP=0.119
 NI=120
 RAIN CODE=-1

SHAPE CONSTANT, N = 2.995
 UNIT PEAK = B BOCFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.78
 PEAK DISCHARGE = 2.94 CFS RUNOFF = 1.254 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 1.998 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.63

PRINT HYD ID=2

HYDROGRAPH FROM AREA 101

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	2.07	12.000	0.09	18.000	0.00	24.000	0.00
0.100	0.00	6.100	1.42	12.100	0.03	18.100	0.00	24.100	0.00
0.200	0.00	6.200	1.11	12.200	0.02	18.200	0.00	24.200	0.00
0.300	0.00	6.300	0.99	12.300	0.01	18.300	0.00	24.300	0.00
0.400	0.00	6.400	0.94	12.400	0.01	18.400	0.00	24.400	0.00
0.500	0.00	6.500	0.75	12.500	0.01	18.500	0.00	24.500	0.00
0.600	0.00	6.600	0.60	12.600	0.01	18.600	0.00	24.600	0.00
0.700	0.00	6.700	0.52	12.700	0.01	18.700	0.00	24.700	0.00
0.800	0.00	6.800	0.48	12.800	0.00	18.800	0.00	24.800	0.00
0.900	0.00	6.900	0.45	12.900	0.00	18.900	0.00	24.900	0.00
1.000	0.00	7.000	0.39	13.000	0.00	19.000	0.00	25.000	0.00
1.100	0.00	7.100	0.35	13.100	0.00	19.100	0.00	25.100	0.00
1.200	0.00	7.200	0.32	13.200	0.00	19.200	0.00	25.200	0.00
1.300	0.00	7.300	0.31	13.300	0.00	19.300	0.00	25.300	0.00
1.400	0.00	7.400	0.30	13.400	0.00	19.400	0.00	25.400	0.00
1.500	0.00	7.500	0.29	13.500	0.00	19.500	0.00	25.500	0.00
1.600	0.00	7.600	0.28	13.600	0.00	19.600	0.00	25.600	0.00
1.700	0.00	7.700	0.27	13.700	0.00	19.700	0.00	25.700	0.00
1.800	0.00	7.800	0.27	13.800	0.00	19.800	0.00	25.800	0.00
1.900	0.00	7.900	0.27	13.900	0.00	19.900	0.00	25.900	0.00
2.000	0.00	8.000	0.23	14.000	0.00	20.000	0.00	26.000	0.00
2.100	0.00	8.100	0.21	14.100	0.00	20.100	0.00	26.100	0.00
2.200	0.00	8.200	0.19	14.200	0.00	20.200	0.00	26.200	0.00
2.300	0.00	8.300	0.19	14.300	0.00	20.300	0.00	26.300	0.00
2.400	0.00	8.400	0.18	14.400	0.00	20.400	0.00	26.400	0.00
2.500	0.00	8.500	0.18	14.500	0.00	20.500	0.00	26.500	0.00
2.600	0.00	8.600	0.18	14.600	0.00	20.600	0.00	26.600	0.00
2.700	0.00	8.700	0.18	14.700	0.00	20.700	0.00	26.700	0.00
2.800	0.00	8.800	0.17	14.800	0.00	20.800	0.00	26.800	0.00
2.900	0.00	8.900	0.17	14.900	0.00	20.900	0.00	26.900	0.00
3.000	0.00	9.000	0.17	15.000	0.00	21.000	0.00	27.000	0.00
3.100	0.00	9.100	0.17	15.100	0.00	21.100	0.00	27.100	0.00
3.200	0.00	9.200	0.17	15.200	0.00	21.200	0.00	27.200	0.00
3.300	0.00	9.300	0.17	15.300	0.00	21.300	0.00	27.300	0.00
3.400	0.00	9.400	0.17	15.400	0.00	21.400	0.00	27.400	0.00
3.500	0.00	9.500	0.14	15.500	0.00	21.500	0.00	27.500	0.00
3.600	0.01	9.600	0.12	15.600	0.00	21.600	0.00	27.600	0.00
3.700	0.01	9.700	0.11	15.700	0.00	21.700	0.00	27.700	0.00
3.800	0.01	9.800	0.10	15.800	0.00	21.800	0.00	27.800	0.00
3.900	0.02	9.900	0.10	15.900	0.00	21.900	0.00	27.900	0.00
4.000	0.03	10.000	0.09	16.000	0.00	22.000	0.00	28.000	0.00
4.100	0.03	10.100	0.09	16.100	0.00	22.100	0.00	28.100	0.00
4.200	0.04	10.200	0.09	16.200	0.00	22.200	0.00	28.200	0.00
4.300	0.05	10.300	0.09	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.05	10.400	0.09	16.400	0.00	22.400	0.00	28.400	0.00

4.500	0.07	10.500	0.09	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.08	10.600	0.09	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.10	10.700	0.09	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.11	10.800	0.09	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.11	10.900	0.09	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.15	11.000	0.09	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.18	11.100	0.09	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.21	11.200	0.09	17.200	0.00	23.200	0.00	29.200	0.00
5.300	0.22	11.300	0.09	17.300	0.00	23.300	0.00	29.300	0.00
5.400	0.24	11.400	0.09	17.400	0.00	23.400	0.00	29.400	0.00
5.500	1.03	11.500	0.09	17.500	0.00	23.500	0.00	29.500	0.00
5.600	1.79	11.600	0.09	17.600	0.00	23.600	0.00	29.600	0.00
5.700	2.31	11.700	0.09	17.700	0.00	23.700	0.00	29.700	0.00
5.800	2.68	11.800	0.09	17.800	0.00	23.800	0.00	29.800	0.00
5.900	2.94	11.900	0.09	17.900	0.00	23.900	0.00	29.900	0.00
0									

RUNOFF VOLUME = 1.254 INCHES
 PEAK DISCHARGE RATE = 2.94 CFS

ADD HYD PEAK FLOW = ID=3 HYD NO=500 ID I=1 ID II=2 RUNOFF VOLUME = 1.270 INCHES

ADD HYD ID=3 HYD NO=500 ID I=1
 COMPUTE HYD ID=4 HYD NO=102 DT=0.100 DA=5.85

AA=0.0 AB=0.0
 CRF=78.6 IA=0.185 K=0.143 TP=0.121
 NJ=120

RAIN CODE=-1
 SHAPE CONSTANT, N = 3.004
 UNIT PEAK = 21.31CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.79
 PEAK DISCHARGE = 4.01 CFS RUNOFF = 0.710 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 1.998 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.36

PRINT HYD ID=4

HYDROGRAPH FROM AREA 102

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	2.92	12.000	0.10
0.100	0.00	6.100	2.02	12.100	0.05
0.200	0.00	6.200	1.61	12.200	0.03
0.300	0.00	6.300	1.44	12.300	0.02
0.400	0.00	6.400	1.37	12.400	0.02
0.500	0.00	6.500	1.12	12.500	0.02
0.600	0.00	6.600	0.91	12.600	0.01
0.700	0.00	6.700	0.79	12.700	0.01
0.800	0.00	6.800	0.73	12.800	0.01
0.900	0.00	6.900	0.67	12.900	0.01
1.000	0.00	7.000	0.61	13.000	0.00
1.100	0.00	7.100	0.55	13.100	0.00
1.200	0.00	7.200	0.51	13.200	0.00
1.300	0.00	7.300	0.49	13.300	0.00
1.400	0.00	7.400	0.47	13.400	0.00

1.500	0.00	7.500	0.46	13.500	0.00	19.500	0.00	25.500	0.00
1.600	0.00	7.600	0.45	13.600	0.00	19.600	0.00	25.600	0.00
1.700	0.00	7.700	0.44	13.700	0.00	19.700	0.00	25.700	0.00
1.800	0.00	7.800	0.44	13.800	0.00	19.800	0.00	25.800	0.00
1.900	0.00	7.900	0.43	13.900	0.00	19.900	0.00	25.900	0.00
2.000	0.00	8.000	0.38	14.000	0.00	20.000	0.00	26.000	0.00
2.100	0.00	8.100	0.34	14.100	0.00	20.100	0.00	26.100	0.00
2.200	0.00	8.200	0.32	14.200	0.00	20.200	0.00	26.200	0.00
2.300	0.00	8.300	0.31	14.300	0.00	20.300	0.00	26.300	0.00
2.400	0.00	8.400	0.30	14.400	0.00	20.400	0.00	26.400	0.00
2.500	0.00	8.500	0.30	14.500	0.00	20.500	0.00	26.500	0.00
2.600	0.00	8.600	0.30	14.600	0.00	20.600	0.00	26.600	0.00
2.700	0.00	8.700	0.29	14.700	0.00	20.700	0.00	26.700	0.00
2.800	0.00	8.800	0.29	14.800	0.00	20.800	0.00	26.800	0.00
2.900	0.00	8.900	0.29	14.900	0.00	20.900	0.00	26.900	0.00
3.000	0.00	9.000	0.29	15.000	0.00	21.000	0.00	27.000	0.00
3.100	0.00	9.100	0.29	15.100	0.00	21.100	0.00	27.100	0.00
3.200	0.00	9.200	0.29	15.200	0.00	21.200	0.00	27.200	0.00
3.300	0.00	9.300	0.29	15.300	0.00	21.300	0.00	27.300	0.00
3.400	0.00	9.400	0.29	15.400	0.00	21.400	0.00	27.400	0.00
3.500	0.00	9.500	0.24	15.500	0.00	21.500	0.00	27.500	0.00
3.600	0.01	9.600	0.20	15.600	0.00	21.600	0.00	27.600	0.00
3.700	0.01	9.700	0.18	15.700	0.00	21.700	0.00	27.700	0.00
3.800	0.01	9.800	0.17	15.800	0.00	21.800	0.00	27.800	0.00
3.900	0.01	9.900	0.16	15.900	0.00	21.900	0.00	27.900	0.00
4.000	0.02	10.000	0.16	16.000	0.00	22.000	0.00	28.000	0.00
4.100	0.02	10.100	0.16	16.100	0.00	22.100	0.00	28.100	0.00
4.200	0.03	10.200	0.15	16.200	0.00	22.200	0.00	28.200	0.00
4.300	0.04	10.300	0.15	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.04	10.400	0.15	16.400	0.00	22.400	0.00	28.400	0.00
4.500	0.05	10.500	0.15	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.07	10.600	0.15	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.08	10.700	0.15	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.09	10.800	0.15	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.10	10.900	0.15	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.13	11.000	0.15	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.16	11.100	0.15	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.18	11.200	0.15	17.200	0.00	23.200	0.00	29.200	0.00
5.300	0.20	11.300	0.15	17.300	0.00	23.300	0.00	29.300	0.00
5.400	0.22	11.400	0.15	17.400	0.00	23.400	0.00	29.400	0.00
5.500	1.04	11.500	0.15	17.500	0.00	23.500	0.00	29.500	0.00
5.600	1.95	11.600	0.15	17.600	0.00	23.600	0.00	29.600	0.00
5.700	2.74	11.700	0.15	17.700	0.00	23.700	0.00	29.700	0.00
5.800	3.42	11.800	0.15	17.800	0.00	23.800	0.00	29.800	0.00
5.900	4.01	11.900	0.15	17.900	0.00	23.900	0.00	29.900	0.00
0									
	0.710 INCHES								
	PEAK DISCHARGE RATE =	4.01 CFS							

ADD HYD PEAK FLOW = ID=5 HYD NO=510 ID I=4 ID I1=3 RUNOFF VOLUME = 1.031 INCHES
 ADD HYD ID=5 HYD NO=510 ID I=4
 COMPUTE HYD ID=1 HYD NO=103 DT=0.100 DA=23.89

AA=0.0 AB=0.0
 CN=78.5 IA=0.185 K=0.255 TP=0.215
 NI=120
 SHAPE CONSTANT, N = 2.007
 UNIT PEAK = 48.79CFS
 RAIN CODE=-1

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.98
 PEAK DISCHARGE = 12.54 CFS RUNOFF = 0.723 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 1.992 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.36

PRINT HYD ID=1

HYDROGRAPH FROM AREA 103

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	12.50	12.000	0.55	18.000	0.00	24.000	0.00
0.100	0.00	6.100	10.62	12.100	0.42	18.100	0.00	24.100	0.00
0.200	0.00	6.200	8.64	12.200	0.31	18.200	0.00	24.200	0.00
0.300	0.00	6.300	7.24	12.300	0.23	18.300	0.00	24.300	0.00
0.400	0.00	6.400	6.36	12.400	0.18	18.400	0.00	24.400	0.00
0.500	0.00	6.500	5.49	12.500	0.14	18.500	0.00	24.500	0.00
0.600	0.00	6.600	4.65	12.600	0.12	18.600	0.00	24.600	0.00
0.700	0.00	6.700	4.02	12.700	0.10	18.700	0.00	24.700	0.00
0.800	0.00	6.800	3.65	12.800	0.09	18.800	0.00	24.800	0.00
0.900	0.00	6.900	3.35	12.900	0.08	18.900	0.00	24.900	0.00
1.000	0.00	7.000	3.09	13.000	0.07	19.000	0.00	25.000	0.00
1.100	0.00	7.100	2.83	13.100	0.06	19.100	0.00	25.100	0.00
1.200	0.00	7.200	2.63	13.200	0.05	19.200	0.00	25.200	0.00
1.300	0.00	7.300	2.48	13.300	0.05	19.300	0.00	25.300	0.00
1.400	0.00	7.400	2.35	13.400	0.04	19.400	0.00	25.400	0.00
1.500	0.00	7.500	2.27	13.500	0.03	19.500	0.00	25.500	0.00
1.600	0.00	7.600	2.20	13.600	0.03	19.600	0.00	25.600	0.00
1.700	0.00	7.700	2.14	13.700	0.03	19.700	0.00	25.700	0.00
1.800	0.00	7.800	2.09	13.800	0.02	19.800	0.00	25.800	0.00
1.900	0.00	7.900	2.05	13.900	0.02	19.900	0.00	25.900	0.00
2.000	0.00	8.000	1.94	14.000	0.02	20.000	0.00	26.000	0.00
2.100	0.00	8.100	1.79	14.100	0.02	20.100	0.00	26.100	0.00
2.200	0.00	8.200	1.66	14.200	0.01	20.200	0.00	26.200	0.00
2.300	0.00	8.300	1.56	14.300	0.01	20.300	0.00	26.300	0.00
2.400	0.00	8.400	1.49	14.400	0.01	20.400	0.00	26.400	0.00
2.500	0.00	8.500	1.44	14.500	0.01	20.500	0.00	26.500	0.00
2.600	0.00	8.600	1.40	14.600	0.01	20.600	0.00	26.600	0.00
2.700	0.00	8.700	1.37	14.700	0.01	20.700	0.00	26.700	0.00
2.800	0.00	8.800	1.35	14.800	0.01	20.800	0.00	26.800	0.00
2.900	0.00	8.900	1.33	14.900	0.01	20.900	0.00	26.900	0.00
3.000	0.00	9.000	1.31	15.000	0.00	21.000	0.00	27.000	0.00
3.100	0.00	9.100	1.30	15.100	0.00	21.100	0.00	27.100	0.00
3.200	0.00	9.200	1.29	15.200	0.00	21.200	0.00	27.200	0.00
3.300	0.00	9.300	1.28	15.300	0.00	21.300	0.00	27.300	0.00
3.400	0.00	9.400	1.27	15.400	0.00	21.400	0.00	27.400	0.00
3.500	0.01	9.500	1.18	15.500	0.00	21.500	0.00	27.500	0.00
3.600	0.01	9.600	1.04	15.600	0.00	21.600	0.00	27.600	0.00
3.700	0.02	9.700	0.94	15.700	0.00	21.700	0.00	27.700	0.00
3.800	0.03	9.800	0.86	15.800	0.00	21.800	0.00	27.800	0.00

ADD HYD PEAK FLOW = ID=3 HYD NO=530 ID I=2 ID II=6 RUNOFF VOLUME = ID I=6 0.777 INCHES
 ADD HYD 42.68 CFS HYD NO=530 ID I=2
 COMPUTE HYD ID=4 HYD NO=105 DT=0.100 DA=35.39

AA=0.0 AB=0.0
 CN=78.6 IA=0.185 K=0.411 TP=0.347
 NI=120
 RAIN CODE=-1

SHAPE CONSTANT, N = 2.998
 UNIT PEAK = 48.68CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 10.00
 PEAK DISCHARGE = 15.54 CFS RUNOFF = 0.725 INCHES TIME TO PEAK = 6.100 HRS
 TOTAL RAINFALL = 1.998 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.36

PRINT HYD ID=4

HYDROGRAPH FROM AREA 105

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
1.400	0.00	7.400	4.28	13.400	0.16	19.400	0.00
1.500	0.00	7.500	4.08	13.500	0.15	19.500	0.00
1.600	0.00	7.600	3.93	13.600	0.14	19.600	0.00
1.700	0.00	7.700	3.81	13.700	0.13	19.700	0.00
1.800	0.00	7.800	3.71	13.800	0.12	19.800	0.00
1.900	0.00	7.900	3.62	13.900	0.11	19.900	0.00
2.000	0.00	8.000	3.52	14.000	0.10	20.000	0.00
2.100	0.00	8.100	3.37	14.100	0.09	20.100	0.00
2.200	0.00	8.200	3.20	14.200	0.08	20.200	0.00
2.300	0.00	8.300	3.04	14.300	0.08	20.300	0.00
2.400	0.00	8.400	2.90	14.400	0.07	20.400	0.00
2.500	0.00	8.500	2.78	14.500	0.07	20.500	0.00
2.600	0.00	8.600	2.68	14.600	0.06	20.600	0.00
2.700	0.00	8.700	2.59	14.700	0.06	20.700	0.00
2.800	0.00	8.800	2.52	14.800	0.05	20.800	0.00
2.900	0.00	8.900	2.46	14.900	0.05	20.900	0.00
3.000	0.00	9.000	2.41	15.000	0.04	21.000	0.00
3.100	0.00	9.100	2.37	15.100	0.04	21.100	0.00
3.200	0.00	9.200	2.33	15.200	0.04	21.200	0.00

3.300	0.00	9.300	2.30	15.300	0.03	21.300	0.00	27.300	0.00
3.400	0.00	9.400	2.27	15.400	0.03	21.400	0.00	27.400	0.00
3.500	0.01	9.500	2.21	15.500	0.03	21.500	0.00	27.500	0.00
3.600	0.01	9.600	2.09	15.600	0.03	21.600	0.00	27.600	0.00
3.700	0.02	9.700	1.95	15.700	0.02	21.700	0.00	27.700	0.00
3.800	0.03	9.800	1.81	15.800	0.02	21.800	0.00	27.800	0.00
3.900	0.04	9.900	1.69	15.900	0.02	21.900	0.00	27.900	0.00
4.000	0.05	10.000	1.59	16.000	0.02	22.000	0.00	28.000	0.00
4.100	0.07	10.100	1.50	16.100	0.02	22.100	0.00	28.100	0.00
4.200	0.10	10.200	1.44	16.200	0.02	22.200	0.00	28.200	0.00
4.300	0.13	10.300	1.38	16.300	0.02	22.300	0.00	28.300	0.00
4.400	0.16	10.400	1.34	16.400	0.01	22.400	0.00	28.400	0.00
4.500	0.19	10.500	1.30	16.500	0.01	22.500	0.00	28.500	0.00
4.600	0.24	10.600	1.27	16.600	0.01	22.600	0.00	28.600	0.00
4.700	0.29	10.700	1.25	16.700	0.01	22.700	0.00	28.700	0.00
4.800	0.35	10.800	1.23	16.800	0.01	22.800	0.00	28.800	0.00
4.900	0.40	10.900	1.21	16.900	0.01	22.900	0.00	28.900	0.00
5.000	0.48	11.000	1.19	17.000	0.01	23.000	0.00	29.000	0.00
5.100	0.58	11.100	1.17	17.100	0.01	23.100	0.00	29.100	0.00
5.200	0.70	11.200	1.16	17.200	0.01	23.200	0.00	29.200	0.00
5.300	0.83	11.300	1.15	17.300	0.01	23.300	0.00	29.300	0.00
5.400	0.95	11.400	1.13	17.400	0.01	23.400	0.00	29.400	0.00
5.500	1.13	11.500	1.12	17.500	0.01	23.500	0.00	29.500	0.00
5.600	3.54	11.600	1.11	17.600	0.01	23.600	0.00	29.600	0.00
5.700	6.24	11.700	1.10	17.700	0.00	23.700	0.00	29.700	0.00
5.800	9.49	11.800	1.09	17.800	0.00	23.800	0.00	29.800	0.00
5.900	12.99	11.900	1.09	17.900	0.00	23.900	0.00	29.900	0.00

0 RUNOFF VOLUME = 0.725 INCHES
 PEAK DISCHARGE RATE = 19.54 CFS

0 ADD HYD PEAK FLOW = ID=5 HYD NO=540 ID 1=4 ID 11=3 RUNOFF VOLUME = ID 11=3 0.760 INCHES
 ADD HYD ID=5 57.83 CFS ID 1=4

0 PRINT HYD ID=5 HYD NO=540 ID 1=4 ID 11=3

HYDROGRAPH FROM AREA 540

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	57.83	12.000	2.93	18.000	0.00
0.100	0.00	6.100	52.21	12.100	2.42	18.100	0.00
0.200	0.00	6.200	45.33	12.200	1.94	18.200	0.00
0.300	0.00	6.300	39.48	12.300	1.55	18.300	0.00
0.400	0.00	6.400	35.15	12.400	1.24	18.400	0.00
0.500	0.00	6.500	30.52	12.500	1.02	18.500	0.00
0.600	0.00	6.600	25.34	12.600	0.85	18.600	0.00
0.700	0.00	6.700	22.84	12.700	0.72	18.700	0.00
0.800	0.00	6.800	20.21	12.800	0.63	18.800	0.00
0.900	0.00	6.900	18.30	12.900	0.55	18.900	0.00
1.000	0.00	7.000	16.66	13.000	0.49	19.000	0.00
1.100	0.00	7.100	15.24	13.100	0.44	19.100	0.00
1.200	0.00	7.200	14.10	13.200	0.39	19.200	0.00
1.300	0.00	7.300	13.25	13.300	0.35	19.300	0.00

1.400	0.00	7.400	12.59	13.400	0.32	19.400	25.400	0.00
1.500	0.00	7.500	12.08	13.500	0.29	19.500	25.500	0.00
1.600	0.00	7.600	11.67	13.600	0.26	19.600	25.600	0.00
1.700	0.00	7.700	11.33	13.700	0.24	19.700	25.700	0.00
1.800	0.00	7.800	11.06	13.800	0.22	19.800	25.800	0.00
1.900	0.00	7.900	10.84	13.900	0.20	19.900	25.900	0.00
2.000	0.00	8.000	10.33	14.000	0.18	20.000	26.000	0.00
2.100	0.00	8.100	9.70	14.100	0.16	20.100	26.100	0.00
2.200	0.00	8.200	9.10	14.200	0.15	20.200	26.200	0.00
2.300	0.00	8.300	8.60	14.300	0.13	20.300	26.300	0.00
2.400	0.00	8.400	8.21	14.400	0.12	20.400	26.400	0.00
2.500	0.00	8.500	7.89	14.500	0.11	20.500	26.500	0.00
2.600	0.00	8.600	7.65	14.600	0.10	20.600	26.600	0.00
2.700	0.00	8.700	7.45	14.700	0.09	20.700	26.700	0.00
2.800	0.00	8.800	7.29	14.800	0.08	20.800	26.800	0.00
2.900	0.00	8.900	7.15	14.900	0.08	20.900	26.900	0.00
3.000	0.00	9.000	7.04	15.000	0.07	21.000	27.000	0.00
3.100	0.00	9.100	6.94	15.100	0.06	21.100	27.100	0.00
3.200	0.00	9.200	6.86	15.200	0.06	21.200	27.200	0.00
3.300	0.00	9.300	6.79	15.300	0.05	21.300	27.300	0.00
3.400	0.01	9.400	6.73	15.400	0.05	21.400	27.400	0.00
3.500	0.04	9.500	6.65	15.500	0.04	21.500	27.500	0.00
3.600	0.07	9.600	6.52	15.600	0.04	21.600	27.600	0.00
3.700	0.10	9.700	6.32	15.700	0.04	21.700	27.700	0.00
3.800	0.15	9.800	6.15	15.800	0.03	21.800	27.800	0.00
3.900	0.19	9.900	6.00	15.900	0.03	21.900	27.900	0.00
4.000	0.27	10.000	5.83	16.000	0.03	22.000	28.000	0.00
4.100	0.37	10.100	5.64	16.100	0.03	22.100	28.100	0.00
4.200	0.48	10.200	5.40	16.200	0.02	22.200	28.200	0.00
4.300	0.59	10.300	5.23	16.300	0.02	22.300	28.300	0.00
4.400	0.70	10.400	5.09	16.400	0.02	22.400	28.400	0.00
4.500	0.87	10.500	4.90	16.500	0.02	22.500	28.500	0.00
4.600	1.07	10.600	4.71	16.600	0.02	22.600	28.600	0.00
4.700	1.28	10.700	4.55	16.700	0.01	22.700	28.700	0.00
4.800	1.49	10.800	4.35	16.800	0.01	22.800	28.800	0.00
4.900	1.69	10.900	4.20	16.900	0.01	22.900	28.900	0.00
5.000	2.06	11.000	4.07	17.000	0.01	23.000	29.000	0.00
5.100	2.52	11.100	3.93	17.100	0.01	23.100	29.100	0.00
5.200	3.00	11.200	3.80	17.200	0.01	23.200	29.200	0.00
5.300	3.46	11.300	3.67	17.300	0.01	23.300	29.300	0.00
5.400	3.90	11.400	3.55	17.400	0.01	23.400	29.400	0.00
5.500	4.33	11.500	3.35	17.500	0.01	23.500	29.500	0.00
5.600	50.10	11.600	3.31	17.600	0.01	23.600	29.600	0.00
5.700	52.20	11.700	3.29	17.700	0.01	23.700	29.700	0.00
5.800	44.64	11.800	3.28	17.800	0.01	23.800	29.800	0.00
5.900	56.68	11.900	3.26	17.900	0.00	23.900	29.900	0.00

0 RUNOFF VOLUME = 57.83 INCHES
 PEAK DISCHARGE RATE = 0.760 CFS

FINISH

```

*****
**
** UNIVERSITY OF OTTAWA HYDROLOGIC MODEL
**
** OTHYMO (VERSION 1.0)
**
**
** NOVEMBER 1982
**
**
**
*****

```

THIS MODEL IS THE UNIVERSITY OF OTTAWA VERSION OF THE HYDROLOGIC MODEL (HYMO) DEVELOPED BY J. R. WILLIAMS AND R. W. HANN (1973) OF THE U.S. DEPT. OF AGRICULTURE. IT HAS THREE NEW SUBROUTINES, URBHYD, KINRTE, AND NASHYD, AND HAS BEEN MODIFIED SUCH THAT IT CAN BE USED IN BOTH ENGLISH AND METRIC UNITS.

THE MODEL WAS DEVELOPED IN THE FRAME OF THE IMPSWM (IMPLEMENTATION OF STORMWATER MANAGEMENT) PROGRAM AT THE DEPARTMENT OF CIVIL ENGINEERING, UNIVERSITY OF OTTAWA. THE DOCUMENTATION FOR THE MODEL CAN BE FOUND IN THE IMPSWM URBAN DRAINAGE MODELLING PROCEDURES (1982).

THE DETAILS ABOUT THE COPYRIGHT AND DISCLAIMER CAN BE FOUND BETWEEN LINES 22 AND 44 IN THE LISTING. THE USER AGREES TO RESPECT THE COPYRIGHT AND THE DISCLAIMER.

THE ENGLISH UNITS OPTION HAS BEEN SPECIFIED

```

*
* KANATA SOUTH INDUSTRIAL PARK
* PREDEVELOPMENT FLOWS
* 100 YR 12 HR SCS TYPE
* STORM DISTRIBUTION
*
* START RAINFALL STARTS AT 0.0 HRS
* COMPUTE HYD ID=1 HYD NO=100 DT=0.100 DA=5.48
AA=0.0 AB=0.0
CNK=93 IA=0.185 K=0.224 TP=0.189
N1=120

```

RAINFALL HYETOGRAPH

0621 0621 0621 0621 0621
 0621 0621 0621 0621 0621
 0621 0621 0621 0621 0621
 1242 1242 1242 1242 1242
 1242 1242 1242 1242 1242
 1242 1242 1242 1242 1242
 1242 1242 1242 1242 1242
 1862 1862 1862 1862 1862
 2483 2483 2483 2483 2483
 3725 3725 3725 3725 3725

2.7935 2.7935 2.7935 2.7935 2.7935
 5587 5587 5587 5587 5587
 2483 2483 2483 2483 2483
 1862 1862 1862 1862 1862
 1862 1862 1862 1862 1862
 1242 1242 1242 1242 1242
 1242 1242 1242 1242 1242
 0621 0621 0621 0621 0621
 0621 0621 0621 0621 0621
 0621 0621 0621 0621 0621
 0621 0621 0621 0621 0621

SHAPE CONSTANT, N = 2.995
 UNIT PEAK = 12.75CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.96
 PEAK DISCHARGE = 10.45 CFS RUNOFF = 2.313 INCHES TIME TO PEAK = 5.900 HRS

TOTAL RAINFALL = 3.104 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.75
 PRINT HYD ID=1

HYDROGRAPH FROM AREA 100

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	9.40	12.000	0.28	18.000	0.00	24.000	0.00
0.100	0.00	6.100	7.35	12.100	0.20	18.100	0.00	24.100	0.00
0.200	0.00	6.200	5.69	12.200	0.14	18.200	0.00	24.200	0.00
0.300	0.00	6.300	4.68	12.300	0.10	18.300	0.00	24.300	0.00
0.400	0.00	6.400	4.08	12.400	0.08	18.400	0.00	24.400	0.00
0.500	0.00	6.500	3.48	12.500	0.05	18.500	0.00	24.500	0.00
0.600	0.00	6.600	2.93	12.600	0.05	18.600	0.00	24.600	0.00
0.700	0.00	6.700	2.55	12.700	0.04	18.700	0.00	24.700	0.00
0.800	0.00	6.800	2.29	12.800	0.04	18.800	0.00	24.800	0.00
0.900	0.00	6.900	2.10	12.900	0.03	18.900	0.00	24.900	0.00
1.000	0.00	7.000	1.91	13.000	0.03	19.000	0.00	25.000	0.00
1.100	0.00	7.100	1.73	13.100	0.02	19.100	0.00	25.100	0.00
1.200	0.00	7.200	1.60	13.200	0.02	19.200	0.00	25.200	0.00
1.300	0.00	7.300	1.49	13.300	0.02	19.300	0.00	25.300	0.00
1.400	0.00	7.400	1.41	13.400	0.02	19.400	0.00	25.400	0.00
1.500	0.00	7.500	1.34	13.500	0.01	19.500	0.00	25.500	0.00
1.600	0.00	7.600	1.29	13.600	0.01	19.600	0.00	25.600	0.00
1.700	0.00	7.700	1.25	13.700	0.01	19.700	0.00	25.700	0.00

1.800	0.00	7.800	1.21	13.800	0.01	19.800	0.00	25.800	0.00
1.900	0.00	7.900	1.18	13.900	0.01	19.900	0.00	25.900	0.00
2.000	0.00	8.000	1.09	14.000	0.01	20.000	0.00	26.000	0.00
2.100	0.00	8.100	1.00	14.100	0.01	20.100	0.00	26.100	0.00
2.200	0.00	8.200	0.92	14.200	0.00	20.200	0.00	26.200	0.00
2.300	0.00	8.300	0.86	14.300	0.00	20.300	0.00	26.300	0.00
2.400	0.00	8.400	0.82	14.400	0.00	20.400	0.00	26.400	0.00
2.500	0.00	8.500	0.79	14.500	0.00	20.500	0.00	26.500	0.00
2.600	0.01	8.600	0.77	14.600	0.00	20.600	0.00	26.600	0.00
2.700	0.02	8.700	0.76	14.700	0.00	20.700	0.00	26.700	0.00
2.800	0.03	8.800	0.74	14.800	0.00	20.800	0.00	26.800	0.00
2.900	0.05	8.900	0.73	14.900	0.00	20.900	0.00	26.900	0.00
3.000	0.06	9.000	0.72	15.000	0.00	21.000	0.00	27.000	0.00
3.100	0.08	9.100	0.71	15.100	0.00	21.100	0.00	27.100	0.00
3.200	0.09	9.200	0.70	15.200	0.00	21.200	0.00	27.200	0.00
3.300	0.11	9.300	0.69	15.300	0.00	21.300	0.00	27.300	0.00
3.400	0.12	9.400	0.69	15.400	0.00	21.400	0.00	27.400	0.00
3.500	0.14	9.500	0.63	15.500	0.00	21.500	0.00	27.500	0.00
3.600	0.15	9.600	0.55	15.600	0.00	21.600	0.00	27.600	0.00
3.700	0.17	9.700	0.49	15.700	0.00	21.700	0.00	27.700	0.00
3.800	0.18	9.800	0.45	15.800	0.00	21.800	0.00	27.800	0.00
3.900	0.19	9.900	0.42	15.900	0.00	21.900	0.00	27.900	0.00
4.000	0.23	10.000	0.40	16.000	0.00	22.000	0.00	28.000	0.00
4.100	0.27	10.100	0.39	16.100	0.00	22.100	0.00	28.100	0.00
4.200	0.31	10.200	0.38	16.200	0.00	22.200	0.00	28.200	0.00
4.300	0.34	10.300	0.37	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.37	10.400	0.37	16.400	0.00	22.400	0.00	28.400	0.00
4.500	0.43	10.500	0.36	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.49	10.600	0.36	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.55	10.700	0.35	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.60	10.800	0.35	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.64	10.900	0.35	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.74	11.000	0.34	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.87	11.100	0.34	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.98	11.200	0.34	17.200	0.00	23.200	0.00	29.200	0.00
5.300	1.07	11.300	0.34	17.300	0.00	23.300	0.00	29.300	0.00
5.400	1.14	11.400	0.34	17.400	0.00	23.400	0.00	29.400	0.00
5.500	2.86	11.500	0.34	17.500	0.00	23.500	0.00	29.500	0.00
5.600	5.40	11.600	0.33	17.600	0.00	23.600	0.00	29.600	0.00
5.700	7.52	11.700	0.33	17.700	0.00	23.700	0.00	29.700	0.00
5.800	9.26	11.800	0.33	17.800	0.00	23.800	0.00	29.800	0.00
5.900	10.45	11.900	0.33	17.900	0.00	23.900	0.00	29.900	0.00

RUNOFF VOLUME = 2.313 INCHES
 PEAK DISCHARGE RATE = 10.45 CFS

COMPUTE HYD

ID=2 HYD NO=101 DT=0.100 DA=2.38
 AA=0.0 AB=0.0
 CN*=93 IA=0.165 K=0.141 TP=0.119
 NI=120

SHAPE CONSTANT, N = 2.976
 UNIT PEAK = 8.80CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.78
 PEAK DISCHARGE = 5.12 CFS RUNOFF = 2.270 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 3.104 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.73

PRINT HYD ID=2

HYDROGRAPH FROM AREA 101

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	3.50	12.000	0.09	18.000	0.00	24.000	0.00	30.000	0.00
0.100	0.00	6.100	3.45	12.100	0.05	18.100	0.00	24.100	0.00	30.100	0.00
0.200	0.00	6.200	1.92	12.200	0.03	18.200	0.00	24.200	0.00	30.200	0.00
0.300	0.00	6.300	1.69	12.300	0.02	18.300	0.00	24.300	0.00	30.300	0.00
0.400	0.00	6.400	1.60	12.400	0.02	18.400	0.00	24.400	0.00	30.400	0.00
0.500	0.00	6.500	1.27	12.500	0.01	18.500	0.00	24.500	0.00	30.500	0.00
0.600	0.00	6.600	1.03	12.600	0.01	18.600	0.00	24.600	0.00	30.600	0.00
0.700	0.00	6.700	0.89	12.700	0.01	18.700	0.00	24.700	0.00	30.700	0.00
0.800	0.00	6.800	0.80	12.800	0.01	18.800	0.00	24.800	0.00	30.800	0.00
0.900	0.00	6.900	0.75	12.900	0.01	18.900	0.00	24.900	0.00	30.900	0.00
1.000	0.00	7.000	0.66	13.000	0.00	19.000	0.00	25.000	0.00	31.000	0.00
1.100	0.00	7.100	0.59	13.100	0.00	19.100	0.00	25.100	0.00	31.100	0.00
1.200	0.00	7.200	0.54	13.200	0.00	19.200	0.00	25.200	0.00	31.200	0.00
1.300	0.00	7.300	0.51	13.300	0.00	19.300	0.00	25.300	0.00	31.300	0.00
1.400	0.00	7.400	0.49	13.400	0.00	19.400	0.00	25.400	0.00	31.400	0.00
1.500	0.00	7.500	0.48	13.500	0.00	19.500	0.00	25.500	0.00	31.500	0.00
1.600	0.00	7.600	0.46	13.600	0.00	19.600	0.00	25.600	0.00	31.600	0.00
1.700	0.00	7.700	0.45	13.700	0.00	19.700	0.00	25.700	0.00	31.700	0.00
1.800	0.00	7.800	0.44	13.800	0.00	19.800	0.00	25.800	0.00	31.800	0.00
1.900	0.00	7.900	0.44	13.900	0.00	19.900	0.00	25.900	0.00	31.900	0.00
2.000	0.00	8.000	0.38	14.000	0.00	20.000	0.00	26.000	0.00	32.000	0.00
2.100	0.00	8.100	0.34	14.100	0.00	20.100	0.00	26.100	0.00	32.100	0.00
2.200	0.00	8.200	0.32	14.200	0.00	20.200	0.00	26.200	0.00	32.200	0.00
2.300	0.00	8.300	0.31	14.300	0.00	20.300	0.00	26.300	0.00	32.300	0.00
2.400	0.00	8.400	0.30	14.400	0.00	20.400	0.00	26.400	0.00	32.400	0.00
2.500	0.00	8.500	0.30	14.500	0.00	20.500	0.00	26.500	0.00	32.500	0.00
2.600	0.01	8.600	0.29	14.600	0.00	20.600	0.00	26.600	0.00	32.600	0.00
2.700	0.01	8.700	0.29	14.700	0.00	20.700	0.00	26.700	0.00	32.700	0.00
2.800	0.02	8.800	0.29	14.800	0.00	20.800	0.00	26.800	0.00	32.800	0.00
2.900	0.03	8.900	0.29	14.900	0.00	20.900	0.00	26.900	0.00	32.900	0.00
3.000	0.03	9.000	0.28	15.000	0.00	21.000	0.00	27.000	0.00	33.000	0.00
3.100	0.04	9.100	0.28	15.100	0.00	21.100	0.00	27.100	0.00	33.100	0.00
3.200	0.05	9.200	0.28	15.200	0.00	21.200	0.00	27.200	0.00	33.200	0.00
3.300	0.05	9.300	0.28	15.300	0.00	21.300	0.00	27.300	0.00	33.300	0.00
3.400	0.06	9.400	0.28	15.400	0.00	21.400	0.00	27.400	0.00	33.400	0.00
3.500	0.07	9.500	0.23	15.500	0.00	21.500	0.00	27.500	0.00	33.500	0.00
3.600	0.07	9.600	0.19	15.600	0.00	21.600	0.00	27.600	0.00	33.600	0.00
3.700	0.08	9.700	0.17	15.700	0.00	21.700	0.00	27.700	0.00	33.700	0.00
3.800	0.09	9.800	0.16	15.800	0.00	21.800	0.00	27.800	0.00	33.800	0.00
3.900	0.09	9.900	0.16	15.900	0.00	21.900	0.00	27.900	0.00	33.900	0.00
4.000	0.12	10.000	0.15	16.000	0.00	22.000	0.00	28.000	0.00	34.000	0.00
4.100	0.14	10.100	0.15	16.100	0.00	22.100	0.00	28.100	0.00	34.100	0.00
4.200	0.15	10.200	0.15	16.200	0.00	22.200	0.00	28.200	0.00	34.200	0.00
4.300	0.17	10.300	0.15	16.300	0.00	22.300	0.00	28.300	0.00	34.300	0.00
4.400	0.18	10.400	0.15	16.400	0.00	22.400	0.00	28.400	0.00	34.400	0.00

4.500	0.21	10.500	0.14	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.24	10.600	0.14	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.27	10.700	0.14	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.28	10.800	0.14	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.30	10.900	0.14	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.37	11.000	0.14	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.44	11.100	0.14	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.48	11.200	0.14	17.200	0.00	23.200	0.00	29.200	0.00
5.300	0.51	11.300	0.14	17.300	0.00	23.300	0.00	29.300	0.00
5.400	0.53	11.400	0.14	17.400	0.00	23.400	0.00	29.400	0.00
5.500	2.10	11.500	0.14	17.500	0.00	23.500	0.00	29.500	0.00
5.600	3.45	11.600	0.14	17.600	0.00	23.600	0.00	29.600	0.00
5.700	4.28	11.700	0.14	17.700	0.00	23.700	0.00	29.700	0.00
5.800	4.79	11.800	0.14	17.800	0.00	23.800	0.00	29.800	0.00
5.900	5.12	11.900	0.14	17.900	0.00	23.900	0.00	29.900	0.00

RUNOFF VOLUME = 2.270 INCHES
 PEAK DISCHARGE RATE = 5.12 CFS

ADD HYD PEAK FLOW = ID=3 HYD NO=500 ID I=1 ID II=2 RUNOFF VOLUME = 2.300 INCHES

ADD HYD IP=9 HYD NO=500 ID I=1 ID II=2

COMPUTE HYD ID=4 HYD NO=102 DT=0.100 DA=5.85

AA=0.0 AB=0.0
 CN=78.6 IA=C.135 K=0.143 TP=0.121

NI=120

RAIN CODE=-1

SHAPE CONSTANT, N = 3.004

UNIT PEAK = 21.31CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.79
 PEAK DISCHARGE = 8.31 CFS RUNOFF = 1.479 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 3.104 INCHES RUNOFF VOLUMETRICCOEFFICIENT 0.48

PRINT HYD ID=4

HYDROGRAPH FROM AREA 102

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	5.99	12.000	0.18	18.000	0.00
0.100	0.00	6.100	4.12	12.100	0.10	18.100	0.00
0.200	0.00	6.200	3.25	12.200	0.06	18.200	0.00
0.300	0.00	6.300	2.90	12.300	0.05	18.300	0.00
0.400	0.00	6.400	2.77	12.400	0.04	18.400	0.00
0.500	0.00	6.500	2.23	12.500	0.03	18.500	0.00
0.600	0.00	6.600	1.80	12.600	0.02	18.600	0.00
0.700	0.00	6.700	1.57	12.700	0.02	18.700	0.00
0.800	0.00	6.800	1.43	12.800	0.01	18.800	0.00
0.900	0.00	6.900	1.35	12.900	0.01	18.900	0.00
1.000	0.00	7.000	1.19	13.000	0.01	19.000	0.00
1.100	0.00	7.100	1.07	13.100	0.01	19.100	0.00
1.200	0.00	7.200	1.00	13.200	0.01	19.200	0.00
1.300	0.00	7.300	0.95	13.300	0.00	19.300	0.00
1.400	0.00	7.400	0.91	13.400	0.00	19.400	0.00

1.500	0.00	7.500	0.89	13.500	0.00	19.500	0.00	25.500	0.00
1.500	0.00	7.500	0.87	13.600	0.00	19.600	0.00	25.600	0.00
1.700	0.00	7.700	0.85	13.700	0.00	19.700	0.00	25.700	0.00
1.800	0.00	7.800	0.84	13.800	0.00	19.800	0.00	25.800	0.00
1.900	0.00	7.900	0.83	13.900	0.00	19.900	0.00	25.900	0.00
2.000	0.00	8.000	0.73	14.000	0.00	20.000	0.00	26.000	0.00
2.100	0.00	8.100	0.65	14.100	0.00	20.100	0.00	26.100	0.00
2.200	0.00	8.200	0.61	14.200	0.00	20.200	0.00	26.200	0.00
2.300	0.00	8.300	0.59	14.300	0.00	20.300	0.00	26.300	0.00
2.400	0.00	8.400	0.58	14.400	0.00	20.400	0.00	26.400	0.00
2.500	0.00	8.500	0.57	14.500	0.00	20.500	0.00	26.500	0.00
2.500	0.00	8.600	0.55	14.600	0.00	20.600	0.00	26.600	0.00
2.700	0.01	8.700	0.56	14.700	0.00	20.700	0.00	26.700	0.00
2.800	0.01	8.800	0.55	14.800	0.00	20.800	0.00	26.800	0.00
2.900	0.02	8.900	0.55	14.900	0.00	20.900	0.00	26.900	0.00
3.000	0.03	9.000	0.55	15.000	0.00	21.000	0.00	27.000	0.00
3.100	0.03	9.100	0.55	15.100	0.00	21.100	0.00	27.100	0.00
3.200	0.04	9.200	0.54	15.200	0.00	21.200	0.00	27.200	0.00
3.300	0.04	9.300	0.54	15.300	0.00	21.300	0.00	27.300	0.00
3.400	0.05	9.400	0.54	15.400	0.00	21.400	0.00	27.400	0.00
3.500	0.05	9.500	0.45	15.500	0.00	21.500	0.00	27.500	0.00
3.600	0.06	9.600	0.37	15.600	0.00	21.600	0.00	27.600	0.00
3.700	0.06	9.700	0.34	15.700	0.00	21.700	0.00	27.700	0.00
3.800	0.07	9.800	0.32	15.800	0.00	21.800	0.00	27.800	0.00
3.900	0.08	9.900	0.31	15.900	0.00	21.900	0.00	27.900	0.00
4.000	0.10	10.000	0.30	16.000	0.00	22.000	0.00	28.000	0.00
4.100	0.12	10.100	0.29	16.100	0.00	22.100	0.00	28.100	0.00
4.200	0.13	10.200	0.29	16.200	0.00	22.200	0.00	28.200	0.00
4.300	0.15	10.300	0.27	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.16	10.400	0.28	16.400	0.00	22.400	0.00	28.400	0.00
4.500	0.20	10.500	0.28	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.23	10.600	0.28	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.25	10.700	0.28	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.28	10.800	0.28	16.800	0.00	22.800	0.00	28.800	0.00
4.900	0.30	10.900	0.28	16.900	0.00	22.900	0.00	28.900	0.00
5.000	0.38	11.000	0.28	17.000	0.00	23.000	0.00	29.000	0.00
5.100	0.46	11.100	0.28	17.100	0.00	23.100	0.00	29.100	0.00
5.200	0.51	11.200	0.28	17.200	0.00	23.200	0.00	29.200	0.00
5.300	0.56	11.300	0.27	17.300	0.00	23.300	0.00	29.300	0.00
5.400	0.60	11.400	0.27	17.400	0.00	23.400	0.00	29.400	0.00
5.500	2.55	11.500	0.27	17.500	0.00	23.500	0.00	29.500	0.00
5.600	4.56	11.600	0.27	17.600	0.00	23.600	0.00	29.600	0.00
5.700	6.11	11.700	0.27	17.700	0.00	23.700	0.00	29.700	0.00
5.800	7.33	11.800	0.27	17.800	0.00	23.800	0.00	29.800	0.00
5.900	8.31	11.900	0.28	17.900	0.00	23.900	0.00	29.900	0.00
RUNOFF VOLUME = 1.479 INCHES									
PEAK DISCHARGE RATE = 8.31 CFS									

ADD HYD ID=5 HYD NO=510 ID I=4 ID II=3 PEAK FLOW = 23.88 CFS RUNOFF VOLUME = 1.950 INCHES
 ADD HYD ID=5 HYD NO=510 ID I=4 ID II=3

COMPUTE HYD ID=1 HYD NO=107 DT=0.100 RA=23.89

AA=0.0 AD=0.0
 CN**78.6 IA=0.185 K=0.255 TP=0.216
 NI=120
 RAIN CODE=-1

SHAPE CONSTANT, N = 3.007
 UNIT PEAK = 48.79CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.98
 PEAK DISCHARGE = 26.79 CFS RUNDFF = 1.507 INCHES TIME TO PEAK = 5.900 HRS
 TOTAL RAINFALL = 3.104 INCHES RUNOFF VOLUMETRICCOEFFICIENT 0.47

PRINT HYD ID=1

HYDROGRAPH FROM AREA 103

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	26.25	12.000	1.02	18.000	0.00	24.000	0.00	24.000	0.00
0.100	0.00	6.100	22.08	12.100	0.78	18.100	0.00	24.100	0.00	24.100	0.00
0.200	0.00	6.200	17.83	12.200	0.58	18.200	0.00	24.200	0.00	24.200	0.00
0.300	0.00	6.300	14.82	12.300	0.43	18.300	0.00	24.300	0.00	24.300	0.00
0.400	0.00	6.400	12.91	12.400	0.33	18.400	0.00	24.400	0.00	24.400	0.00
0.500	0.00	6.500	11.08	12.500	0.26	18.500	0.00	24.500	0.00	24.500	0.00
0.600	0.00	6.600	9.36	12.600	0.22	18.600	0.00	24.600	0.00	24.600	0.00
0.700	0.00	6.700	8.10	12.700	0.18	18.700	0.00	24.700	0.00	24.700	0.00
0.800	0.00	6.800	7.29	12.800	0.16	18.800	0.00	24.800	0.00	24.800	0.00
0.900	0.00	6.900	6.71	12.900	0.14	18.900	0.00	24.900	0.00	24.900	0.00
1.000	0.00	7.000	6.16	13.000	0.12	19.000	0.00	25.000	0.00	25.000	0.00
1.100	0.00	7.100	5.64	13.100	0.11	19.100	0.00	25.100	0.00	25.100	0.00
1.200	0.00	7.200	5.22	13.200	0.10	19.200	0.00	25.200	0.00	25.200	0.00
1.300	0.00	7.300	4.91	13.300	0.08	19.300	0.00	25.300	0.00	25.300	0.00
1.400	0.00	7.400	4.67	13.400	0.07	19.400	0.00	25.400	0.00	25.400	0.00
1.500	0.00	7.500	4.47	13.500	0.06	19.500	0.00	25.500	0.00	25.500	0.00
1.600	0.00	7.600	4.32	13.600	0.06	19.600	0.00	25.600	0.00	25.600	0.00
1.700	0.00	7.700	4.19	13.700	0.05	19.700	0.00	25.700	0.00	25.700	0.00
1.800	0.00	7.800	4.08	13.800	0.04	19.800	0.00	25.800	0.00	25.800	0.00
1.900	0.00	7.900	3.98	13.900	0.04	19.900	0.00	25.900	0.00	25.900	0.00
2.000	0.00	8.000	3.75	14.000	0.03	20.000	0.00	26.000	0.00	26.000	0.00
2.100	0.00	8.100	3.47	14.100	0.03	20.100	0.00	26.100	0.00	26.100	0.00
2.200	0.00	8.200	3.21	14.200	0.03	20.200	0.00	26.200	0.00	26.200	0.00
2.300	0.00	8.300	3.02	14.300	0.02	20.300	0.00	26.300	0.00	26.300	0.00
2.400	0.00	8.400	2.87	14.400	0.02	20.400	0.00	26.400	0.00	26.400	0.00
2.500	0.00	8.500	2.77	14.500	0.02	20.500	0.00	26.500	0.00	26.500	0.00
2.600	0.01	8.600	2.69	14.600	0.02	20.600	0.00	26.600	0.00	26.600	0.00
2.700	0.02	8.700	2.63	14.700	0.01	20.700	0.00	26.700	0.00	26.700	0.00
2.800	0.04	8.800	2.58	14.800	0.01	20.800	0.00	26.800	0.00	26.800	0.00
2.900	0.05	8.900	2.54	14.900	0.01	20.900	0.00	26.900	0.00	26.900	0.00
3.000	0.07	9.000	2.50	15.000	0.01	21.000	0.00	27.000	0.00	27.000	0.00
3.100	0.09	9.100	2.47	15.100	0.01	21.100	0.00	27.100	0.00	27.100	0.00
3.200	0.12	9.200	2.44	15.200	0.01	21.200	0.00	27.200	0.00	27.200	0.00
3.300	0.14	9.300	2.42	15.300	0.01	21.300	0.00	27.300	0.00	27.300	0.00
3.400	0.16	9.400	2.40	15.400	0.01	21.400	0.00	27.400	0.00	27.400	0.00
3.500	0.18	9.500	2.24	15.500	0.00	21.500	0.00	27.500	0.00	27.500	0.00
3.600	0.20	9.600	2.00	15.600	0.00	21.600	0.00	27.600	0.00	27.600	0.00
3.700	0.23	9.700	1.78	15.700	0.00	21.700	0.00	27.700	0.00	27.700	0.00
3.800	0.25	9.800	1.63	15.800	0.00	21.800	0.00	27.800	0.00	27.800	0.00

3.900	0.27	9.900	1.52	15.900	0.00	21.900	0.00	27.900	0.00
4.000	0.32	10.000	1.45	16.000	0.00	22.000	0.00	28.000	0.00
4.100	0.38	10.100	1.39	16.100	0.00	22.100	0.00	28.100	0.00
4.200	0.45	10.200	1.36	16.200	0.00	22.200	0.00	28.200	0.00
4.300	0.51	10.300	1.33	16.300	0.00	22.300	0.00	28.300	0.00
4.400	0.56	10.400	1.31	16.400	0.00	22.400	0.00	28.400	0.00
4.500	0.65	10.500	1.29	16.500	0.00	22.500	0.00	28.500	0.00
4.600	0.75	10.600	1.27	16.600	0.00	22.600	0.00	28.600	0.00
4.700	0.87	10.700	1.25	16.700	0.00	22.700	0.00	28.700	0.00
4.800	0.97	10.800	1.24	16.800	0.00	22.800	0.00	28.800	0.00
4.900	1.05	10.900	1.23	16.900	0.00	22.900	0.00	28.900	0.00
5.000	1.24	11.000	1.21	17.000	0.00	23.000	0.00	29.000	0.00
5.100	1.48	11.100	1.21	17.100	0.00	23.100	0.00	29.100	0.00
5.200	1.73	11.200	1.20	17.200	0.00	23.200	0.00	29.200	0.00
5.300	1.74	11.300	1.19	17.300	0.00	23.300	0.00	29.300	0.00
5.400	2.12	11.400	1.19	17.400	0.00	23.400	0.00	29.400	0.00
5.500	5.14	11.500	1.18	17.500	0.00	23.500	0.00	29.500	0.00
5.600	10.56	11.600	1.18	17.600	0.00	23.600	0.00	29.600	0.00
5.700	16.53	11.700	1.17	17.700	0.00	23.700	0.00	29.700	0.00
5.800	21.99	11.800	1.17	17.800	0.00	23.800	0.00	29.800	0.00
5.900	26.79	11.900	1.17	17.900	0.00	23.900	0.00	29.900	0.00
RUNOFF VOLUME = 1.507 INCHES									
PEAK DISCHARGE RATE = 26.79 CFS									

ADD HYD PEAK FLOW = ID=6 HYD NO=520 ID I=1 ID II=5 RUNOFF VOLUME = 1.668 INCHES
 ADD HYD ID=5 HYD NO=520 ID I=1

COMPUTE HYD ID=2 HYD NO=104 DT=0.100 DA=41.5

AA=0.0 AB=0.0

CM=78.5 IA=0.185 K=0.317 TP=0.268

NI=120

RAIN CODE=-1

SHAPE CONSTANT, N = 3.001

UNIT PEAK # 68.21CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 9.99

PEAK DISCHARGE = 42.05 CFS RUNOFF = 1.509 INCHES TIME TO PEAK = 6.000 HRS

TOTAL RAINFALL = 3.104 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.49

PRINT HYD ID=2

HYDROGRAPH FROM AREA 104

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	42.05	12.000	1.91	18.000	0.00
0.100	0.00	6.100	38.67	12.100	1.61	18.100	0.00
0.200	0.00	6.200	33.31	12.200	1.28	18.200	0.00
0.300	0.00	6.300	28.38	12.300	1.00	18.300	0.00
0.400	0.00	6.400	24.70	12.400	0.79	18.400	0.00
0.500	0.00	6.500	21.34	12.500	0.64	18.500	0.00
0.600	0.00	6.600	18.19	12.600	0.53	18.600	0.00
0.700	0.00	6.700	15.55	12.700	0.45	18.700	0.00
0.800	0.00	6.800	13.62	12.800	0.39	18.800	0.00

0.900	0.00	6.900	12.34	12.900	0.34	18.900	0.00	24.900	0.00
1.000	0.00	7.000	11.39	13.000	0.31	19.000	0.00	25.000	0.00
1.100	0.00	7.100	10.50	13.100	0.28	19.100	0.00	25.100	0.00
1.200	0.00	7.200	9.73	13.200	0.25	19.200	0.00	25.200	0.00
1.300	0.00	7.300	9.12	13.300	0.22	19.300	0.00	25.300	0.00
1.400	0.00	7.400	8.55	13.400	0.20	19.400	0.00	25.400	0.00
1.500	0.00	7.500	8.29	13.500	0.18	19.500	0.00	25.500	0.00
1.600	0.00	7.600	7.99	13.600	0.16	19.600	0.00	25.600	0.00
1.700	0.00	7.700	7.74	13.700	0.15	19.700	0.00	25.700	0.00
1.800	0.00	7.800	7.52	13.800	0.13	19.800	0.00	25.800	0.00
1.900	0.00	7.900	7.34	13.900	0.12	19.900	0.00	25.900	0.00
2.000	0.00	8.000	7.04	14.000	0.11	20.000	0.00	26.000	0.00
2.100	0.00	8.100	6.61	14.100	0.10	20.100	0.00	26.100	0.00
2.200	0.00	8.200	6.18	14.200	0.09	20.200	0.00	26.200	0.00
2.300	0.00	8.300	5.80	14.300	0.08	20.300	0.00	26.300	0.00
2.400	0.00	8.400	5.51	14.400	0.07	20.400	0.00	26.400	0.00
2.500	0.00	8.500	5.28	14.500	0.06	20.500	0.00	26.500	0.00
2.600	0.01	8.600	5.09	14.600	0.06	20.600	0.00	26.600	0.00
2.700	0.03	8.700	4.94	14.700	0.05	20.700	0.00	26.700	0.00
2.800	0.05	8.800	4.82	14.800	0.05	20.800	0.00	26.800	0.00
2.900	0.07	8.900	4.73	14.900	0.04	20.900	0.00	26.900	0.00
3.000	0.11	9.000	4.64	15.000	0.04	21.000	0.00	27.000	0.00
3.100	0.14	9.100	4.57	15.100	0.03	21.100	0.00	27.100	0.00
3.200	0.17	9.200	4.51	15.200	0.03	21.200	0.00	27.200	0.00
3.300	0.21	9.300	4.45	15.300	0.03	21.300	0.00	27.300	0.00
3.400	0.25	9.400	4.40	15.400	0.02	21.400	0.00	27.400	0.00
3.500	0.28	9.500	4.19	15.500	0.02	21.500	0.00	27.500	0.00
3.600	0.32	9.600	3.86	15.600	0.02	21.600	0.00	27.600	0.00
3.700	0.36	9.700	3.50	15.700	0.02	21.700	0.00	27.700	0.00
3.800	0.39	9.800	3.21	15.800	0.02	21.800	0.00	27.800	0.00
3.900	0.43	9.900	2.78	15.900	0.01	21.900	0.00	27.900	0.00
4.000	0.50	10.000	2.80	16.000	0.01	22.000	0.00	28.000	0.00
4.100	0.59	10.100	2.67	16.100	0.01	22.100	0.00	28.100	0.00
4.200	0.69	10.200	2.58	16.200	0.01	22.200	0.00	28.200	0.00
4.300	0.80	10.300	2.50	16.300	0.01	22.300	0.00	28.300	0.00
4.400	0.89	10.400	2.44	16.400	0.01	22.400	0.00	28.400	0.00
4.500	1.02	10.500	2.39	16.500	0.01	22.500	0.00	28.500	0.00
4.600	1.19	10.600	2.35	16.600	0.01	22.600	0.00	28.600	0.00
4.700	1.36	10.700	2.32	16.700	0.01	22.700	0.00	28.700	0.00
4.800	1.53	10.800	2.28	16.800	0.01	22.800	0.00	28.800	0.00
4.900	1.69	10.900	2.25	16.900	0.00	22.900	0.00	28.900	0.00
5.000	1.94	11.000	2.23	17.000	0.00	23.000	0.00	29.000	0.00
5.100	2.30	11.100	2.20	17.100	0.00	23.100	0.00	29.100	0.00
5.200	2.68	11.200	2.18	17.200	0.00	23.200	0.00	29.200	0.00
5.300	3.04	11.300	2.15	17.300	0.00	23.300	0.00	29.300	0.00
5.400	3.38	11.400	2.14	17.400	0.00	23.400	0.00	29.400	0.00
5.500	5.78	11.500	2.13	17.500	0.00	23.500	0.00	29.500	0.00
5.600	13.75	11.600	2.11	17.600	0.00	23.600	0.00	29.600	0.00
5.700	32.47	11.700	2.10	17.700	0.00	23.700	0.00	29.700	0.00
5.800	31.41	11.800	2.09	17.800	0.00	23.800	0.00	29.800	0.00
5.900	39.70	11.900	2.08	17.900	0.00	23.900	0.00	29.900	0.00

RUNOFF VOLUME = 1.507 INCHES
 PEAK DISCHARGE RATE = 42.05 CFS

ADD HYD ID=3 HYD NO=530 ID I=2 ID II=6 RUNOFF VOLUME = 1.524 INCHES
 PEAK FLOW = 90.37 CFS
 ADD HYD ID=3 HYD NO=530 ID I=2

COMPUTE HYD ID=4 HYD NO=105 DT=0.100 DA=38.39
 AA=0.0 AB=0.0
 CNA=78.6 IA=0.155 K=0.411 TP=0.347
 NI=120

SHAPE CONSTANT, N = 2.998
 UNIT PEAK = 48.65CFS

SUM OF THE UNIT HYDROGRAPH CO-ORDINATES = 10.00
 PEAK DISCHARGE = 33.04 CFS RUNOFF = 1.510 INCHES TIME TO PEAK = 5.100 HRS
 TOTAL RAINFALL = 3.104 INCHES RUNOFF VOLUMETRIC COEFFICIENT 0.49

PRINT HYD ID=4

HYDROGRAPH FROM AREA 105

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	6.000	32.75	12.000	1.95	18.000	0.01	24.000	0.00	30.000	0.00	36.000	0.00	42.000	0.00
0.100	0.00	6.100	33.04	12.100	1.75	18.100	0.01	24.100	0.00	30.100	0.00	36.100	0.00	42.100	0.00
0.200	0.00	6.200	30.93	12.200	1.51	18.200	0.01	24.200	0.00	30.200	0.00	36.200	0.00	42.200	0.00
0.300	0.00	6.300	27.91	12.300	1.27	18.300	0.01	24.300	0.00	30.300	0.00	36.300	0.00	42.300	0.00
0.400	0.00	6.400	24.95	12.400	1.06	18.400	0.00	24.400	0.00	30.400	0.00	36.400	0.00	42.400	0.00
0.500	0.00	6.500	22.15	12.500	0.89	18.500	0.00	24.500	0.00	30.500	0.00	36.500	0.00	42.500	0.00
0.600	0.00	6.600	19.44	12.600	0.76	18.600	0.00	24.600	0.00	30.600	0.00	36.600	0.00	42.600	0.00
0.700	0.00	6.700	16.74	12.700	0.65	18.700	0.00	24.700	0.00	30.700	0.00	36.700	0.00	42.700	0.00
0.800	0.00	6.800	14.77	12.800	0.56	18.800	0.00	24.800	0.00	30.800	0.00	36.800	0.00	42.800	0.00
0.900	0.00	6.900	13.03	12.900	0.49	18.900	0.00	24.900	0.00	30.900	0.00	36.900	0.00	42.900	0.00
1.000	0.00	7.000	11.55	13.000	0.44	19.000	0.00	25.000	0.00	31.000	0.00	37.000	0.00	43.000	0.00
1.100	0.00	7.100	10.59	13.100	0.40	19.100	0.00	25.100	0.00	31.100	0.00	37.100	0.00	43.100	0.00
1.200	0.00	7.200	9.69	13.200	0.36	19.200	0.00	25.200	0.00	31.200	0.00	37.200	0.00	43.200	0.00
1.300	0.00	7.300	9.05	13.300	0.33	19.300	0.00	25.300	0.00	31.300	0.00	37.300	0.00	43.300	0.00
1.400	0.00	7.400	8.56	13.400	0.31	19.400	0.00	25.400	0.00	31.400	0.00	37.400	0.00	43.400	0.00
1.500	0.00	7.500	8.15	13.500	0.28	19.500	0.00	25.500	0.00	31.500	0.00	37.500	0.00	43.500	0.00
1.600	0.00	7.600	7.82	13.600	0.26	19.600	0.00	25.600	0.00	31.600	0.00	37.600	0.00	43.600	0.00
1.700	0.00	7.700	7.55	13.700	0.24	19.700	0.00	25.700	0.00	31.700	0.00	37.700	0.00	43.700	0.00
1.800	0.00	7.800	7.36	13.800	0.22	19.800	0.00	25.800	0.00	31.800	0.00	37.800	0.00	43.800	0.00
1.900	0.00	7.900	7.19	13.900	0.20	19.900	0.00	25.900	0.00	31.900	0.00	37.900	0.00	43.900	0.00
2.000	0.00	8.000	6.94	14.000	0.19	20.000	0.00	26.000	0.00	32.000	0.00	38.000	0.00	44.000	0.00
2.100	0.00	8.100	6.64	14.100	0.17	20.100	0.00	26.100	0.00	32.100	0.00	38.100	0.00	44.100	0.00
2.200	0.00	8.200	6.30	14.200	0.16	20.200	0.00	26.200	0.00	32.200	0.00	38.200	0.00	44.200	0.00
2.300	0.00	8.300	5.97	14.300	0.15	20.300	0.00	26.300	0.00	32.300	0.00	38.300	0.00	44.300	0.00
2.400	0.00	8.400	5.58	14.400	0.14	20.400	0.00	26.400	0.00	32.400	0.00	38.400	0.00	44.400	0.00
2.500	0.00	8.500	5.43	14.500	0.13	20.500	0.00	26.500	0.00	32.500	0.00	38.500	0.00	44.500	0.00
2.600	0.01	8.600	5.23	14.600	0.12	20.600	0.00	26.600	0.00	32.600	0.00	38.600	0.00	44.600	0.00
2.700	0.01	8.700	5.05	14.700	0.11	20.700	0.00	26.700	0.00	32.700	0.00	38.700	0.00	44.700	0.00
2.800	0.03	8.800	4.71	14.800	0.10	20.800	0.00	26.800	0.00	32.800	0.00	38.800	0.00	44.800	0.00
2.900	0.05	8.900	4.38	14.900	0.09	20.900	0.00	26.900	0.00	32.900	0.00	38.900	0.00	44.900	0.00
3.000	0.07	9.000	4.08	15.000	0.08	21.000	0.00	27.000	0.00	33.000	0.00	39.000	0.00	45.000	0.00
3.100	0.10	9.100	4.57	15.100	0.08	21.100	0.00	27.100	0.00	33.100	0.00	39.100	0.00	45.100	0.00
3.200	0.13	9.200	4.51	15.200	0.07	21.200	0.00	27.200	0.00	33.200	0.00	39.200	0.00	45.200	0.00

3.500	0.16	9.500	4.44	15.300	0.07	21.300	0.00	27.300	0.00
3.400	0.17	9.400	4.38	15.400	0.06	21.400	0.00	27.400	0.00
3.500	0.22	9.500	4.24	15.500	0.05	21.500	0.00	27.500	0.00
3.600	0.25	9.600	4.01	15.600	0.05	21.600	0.00	27.600	0.00
3.700	0.27	9.700	3.74	15.700	0.05	21.700	0.00	27.700	0.00
3.800	0.33	9.800	3.47	15.800	0.04	21.800	0.00	27.800	0.00
3.900	0.35	9.900	3.24	15.900	0.04	21.900	0.00	27.900	0.00
4.000	0.40	10.000	3.04	16.000	0.04	22.000	0.00	28.000	0.00
4.100	0.47	10.100	2.88	16.100	0.03	22.100	0.00	28.100	0.00
4.200	0.55	10.200	2.75	16.200	0.03	22.200	0.00	28.200	0.00
4.300	0.63	10.300	2.64	16.300	0.03	22.300	0.00	28.300	0.00
4.400	0.71	10.400	2.55	16.400	0.03	22.400	0.00	28.400	0.00
4.500	0.82	10.500	2.48	16.500	0.02	22.500	0.00	28.500	0.00
4.600	0.94	10.600	2.42	16.600	0.02	22.600	0.00	28.600	0.00
4.700	1.08	10.700	2.37	16.700	0.02	22.700	0.00	28.700	0.00
4.800	1.23	10.800	2.33	16.800	0.02	22.800	0.00	28.800	0.00
4.900	1.37	10.900	2.29	16.900	0.02	22.900	0.00	28.900	0.00
5.000	1.56	11.000	2.25	17.000	0.02	23.000	0.00	29.000	0.00
5.100	1.82	11.100	2.22	17.100	0.02	23.100	0.00	29.100	0.00
5.200	2.11	11.200	2.19	17.200	0.01	23.200	0.00	29.200	0.00
5.300	2.42	11.300	2.17	17.300	0.01	23.300	0.00	29.300	0.00
5.400	2.72	11.400	2.14	17.400	0.01	23.400	0.00	29.400	0.00
5.500	4.57	11.500	2.12	17.500	0.01	23.500	0.00	29.500	0.00
5.600	8.77	11.600	2.10	17.600	0.01	23.600	0.00	29.600	0.00
5.700	14.71	11.700	2.08	17.700	0.01	23.700	0.00	29.700	0.00
5.800	21.55	11.800	2.05	17.800	0.01	23.800	0.00	29.800	0.00
5.900	28.59	11.900	2.04	17.900	0.01	23.900	0.00	29.900	0.00
RUNOFF VOLUME = 1.510 INCHES									
PEAK DISCHARGE RATE = 32.04 CFS									

ADD HYD PEAK FLOW = ID=5 HYD NO=540 ID I=4 ID II=3 RUNOFF VOLUME = 1.560 INCHES

ADD HYD ID=5 HYD NO=540 ID I=4 ID II=3


PRINT HYD

HYDROGRAPH FROM AREA 540

TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS	TIME HRS	FLOW CFS
0.000	0.00	5.000	120.04	12.000	5.42	18.000	0.01	24.000	0.00
0.100	0.00	5.100	107.71	12.100	4.50	18.100	0.01	24.100	0.00
0.200	0.00	5.200	92.94	12.200	3.61	18.200	0.01	24.200	0.00
0.300	0.00	5.300	80.38	12.300	2.88	18.300	0.01	24.300	0.00
0.400	0.00	5.400	71.01	12.400	2.32	18.400	0.01	24.400	0.00
0.500	0.00	5.500	61.95	12.500	1.90	18.500	0.01	24.500	0.00
0.600	0.00	5.600	52.75	12.600	1.59	18.600	0.00	24.600	0.00
0.700	0.00	5.700	45.60	12.700	1.35	18.700	0.00	24.700	0.00
0.800	0.00	5.800	40.20	12.800	1.17	18.800	0.00	24.800	0.00
0.900	0.00	5.900	35.28	12.900	1.03	18.900	0.00	24.900	0.00
1.000	0.00	7.000	32.95	13.000	0.91	19.000	0.00	25.000	0.00
1.100	0.00	7.100	30.08	13.100	0.82	19.100	0.00	25.100	0.00
1.200	0.00	7.200	27.79	13.200	0.73	19.200	0.00	25.200	0.00
1.300	0.00	7.300	26.04	13.300	0.67	19.300	0.00	25.300	0.00


1.450	0.60	7.400	24.69	13.400	0.60	19.400	25.400	0.00
1.500	0.00	7.500	23.52	13.500	0.55	19.500	25.500	0.00
1.550	0.00	7.600	22.75	13.600	0.50	19.600	25.600	0.00
1.700	0.00	7.700	22.04	13.700	0.45	19.700	25.700	0.00
1.800	0.00	7.800	21.40	13.800	0.41	19.800	25.800	0.00
1.900	0.00	7.900	20.95	13.900	0.37	19.900	25.900	0.00
2.000	0.00	8.000	19.95	14.000	0.34	20.000	26.000	0.00
2.100	0.00	8.100	19.70	14.100	0.31	20.100	26.100	0.00
2.200	0.00	8.200	17.93	14.200	0.28	20.200	26.200	0.00
2.300	0.00	8.300	16.55	14.300	0.25	20.300	26.300	0.00
2.400	0.00	8.400	15.75	14.400	0.23	20.400	26.400	0.00
2.500	0.01	8.500	15.14	14.500	0.21	20.500	26.500	0.00
2.600	0.05	8.600	14.53	14.600	0.19	20.600	26.600	0.00
2.700	0.10	8.700	14.23	14.700	0.17	20.700	26.700	0.00
2.800	0.16	8.800	13.69	14.800	0.16	20.800	26.800	0.00
2.900	0.27	8.900	13.61	14.900	0.14	20.900	26.900	0.00
3.000	0.37	9.000	13.21	15.000	0.13	21.000	27.000	0.00
3.100	0.45	9.100	13.17	15.100	0.12	21.100	27.100	0.00
3.200	0.59	9.200	12.99	15.200	0.11	21.200	27.200	0.00
3.300	0.71	9.300	12.53	15.300	0.10	21.300	27.300	0.00
3.400	0.83	9.400	12.57	15.400	0.09	21.400	27.400	0.00
3.500	0.94	9.500	11.98	15.500	0.08	21.500	27.500	0.00
3.600	1.06	9.600	10.96	15.600	0.08	21.600	27.600	0.00
3.700	1.18	9.700	10.02	15.700	0.07	21.700	27.700	0.00
3.800	1.30	9.800	9.22	15.800	0.05	21.800	27.800	0.00
3.900	1.41	9.900	8.62	15.900	0.06	21.900	27.900	0.00
4.000	1.63	10.000	8.15	16.000	0.05	22.000	28.000	0.00
4.100	1.77	10.100	7.73	16.100	0.05	22.100	28.100	0.00
4.200	2.22	10.200	7.50	16.200	0.04	22.200	28.200	0.00
4.300	2.60	10.300	7.23	16.300	0.04	22.300	28.300	0.00
4.400	2.88	10.400	7.10	16.400	0.04	22.400	28.400	0.00
4.500	3.03	10.500	6.95	16.500	0.03	22.500	28.500	0.00
4.600	3.85	10.600	6.82	16.600	0.03	22.600	28.600	0.00
4.700	4.39	10.700	6.71	16.700	0.03	22.700	28.700	0.00
4.800	4.88	10.800	6.52	16.800	0.03	22.800	28.800	0.00
4.900	5.35	10.900	6.33	16.900	0.02	22.900	28.900	0.00
5.000	5.24	11.000	6.46	17.000	0.02	23.000	29.000	0.00
5.100	7.36	11.100	6.09	17.100	0.02	23.100	29.100	0.00
5.200	8.49	11.200	5.33	17.200	0.02	23.200	29.200	0.00
5.300	9.54	11.300	6.27	17.300	0.02	23.300	29.300	0.00
5.400	10.50	11.400	6.22	17.400	0.02	23.400	29.400	0.00
5.500	24.00	11.500	6.18	17.500	0.01	23.500	29.500	0.00
5.600	45.48	11.600	5.12	17.600	0.01	23.600	29.600	0.00
5.700	71.71	11.700	6.10	17.700	0.01	23.700	29.700	0.00
5.800	95.33	11.800	6.07	17.800	0.01	23.800	29.800	0.00
5.900	113.96	11.900	6.04	17.900	0.01	23.900	29.900	0.00

RUNOFF VOLUME = 1.500 INCHES
PEAK DISCHARGE RATE = 130.94 CFS

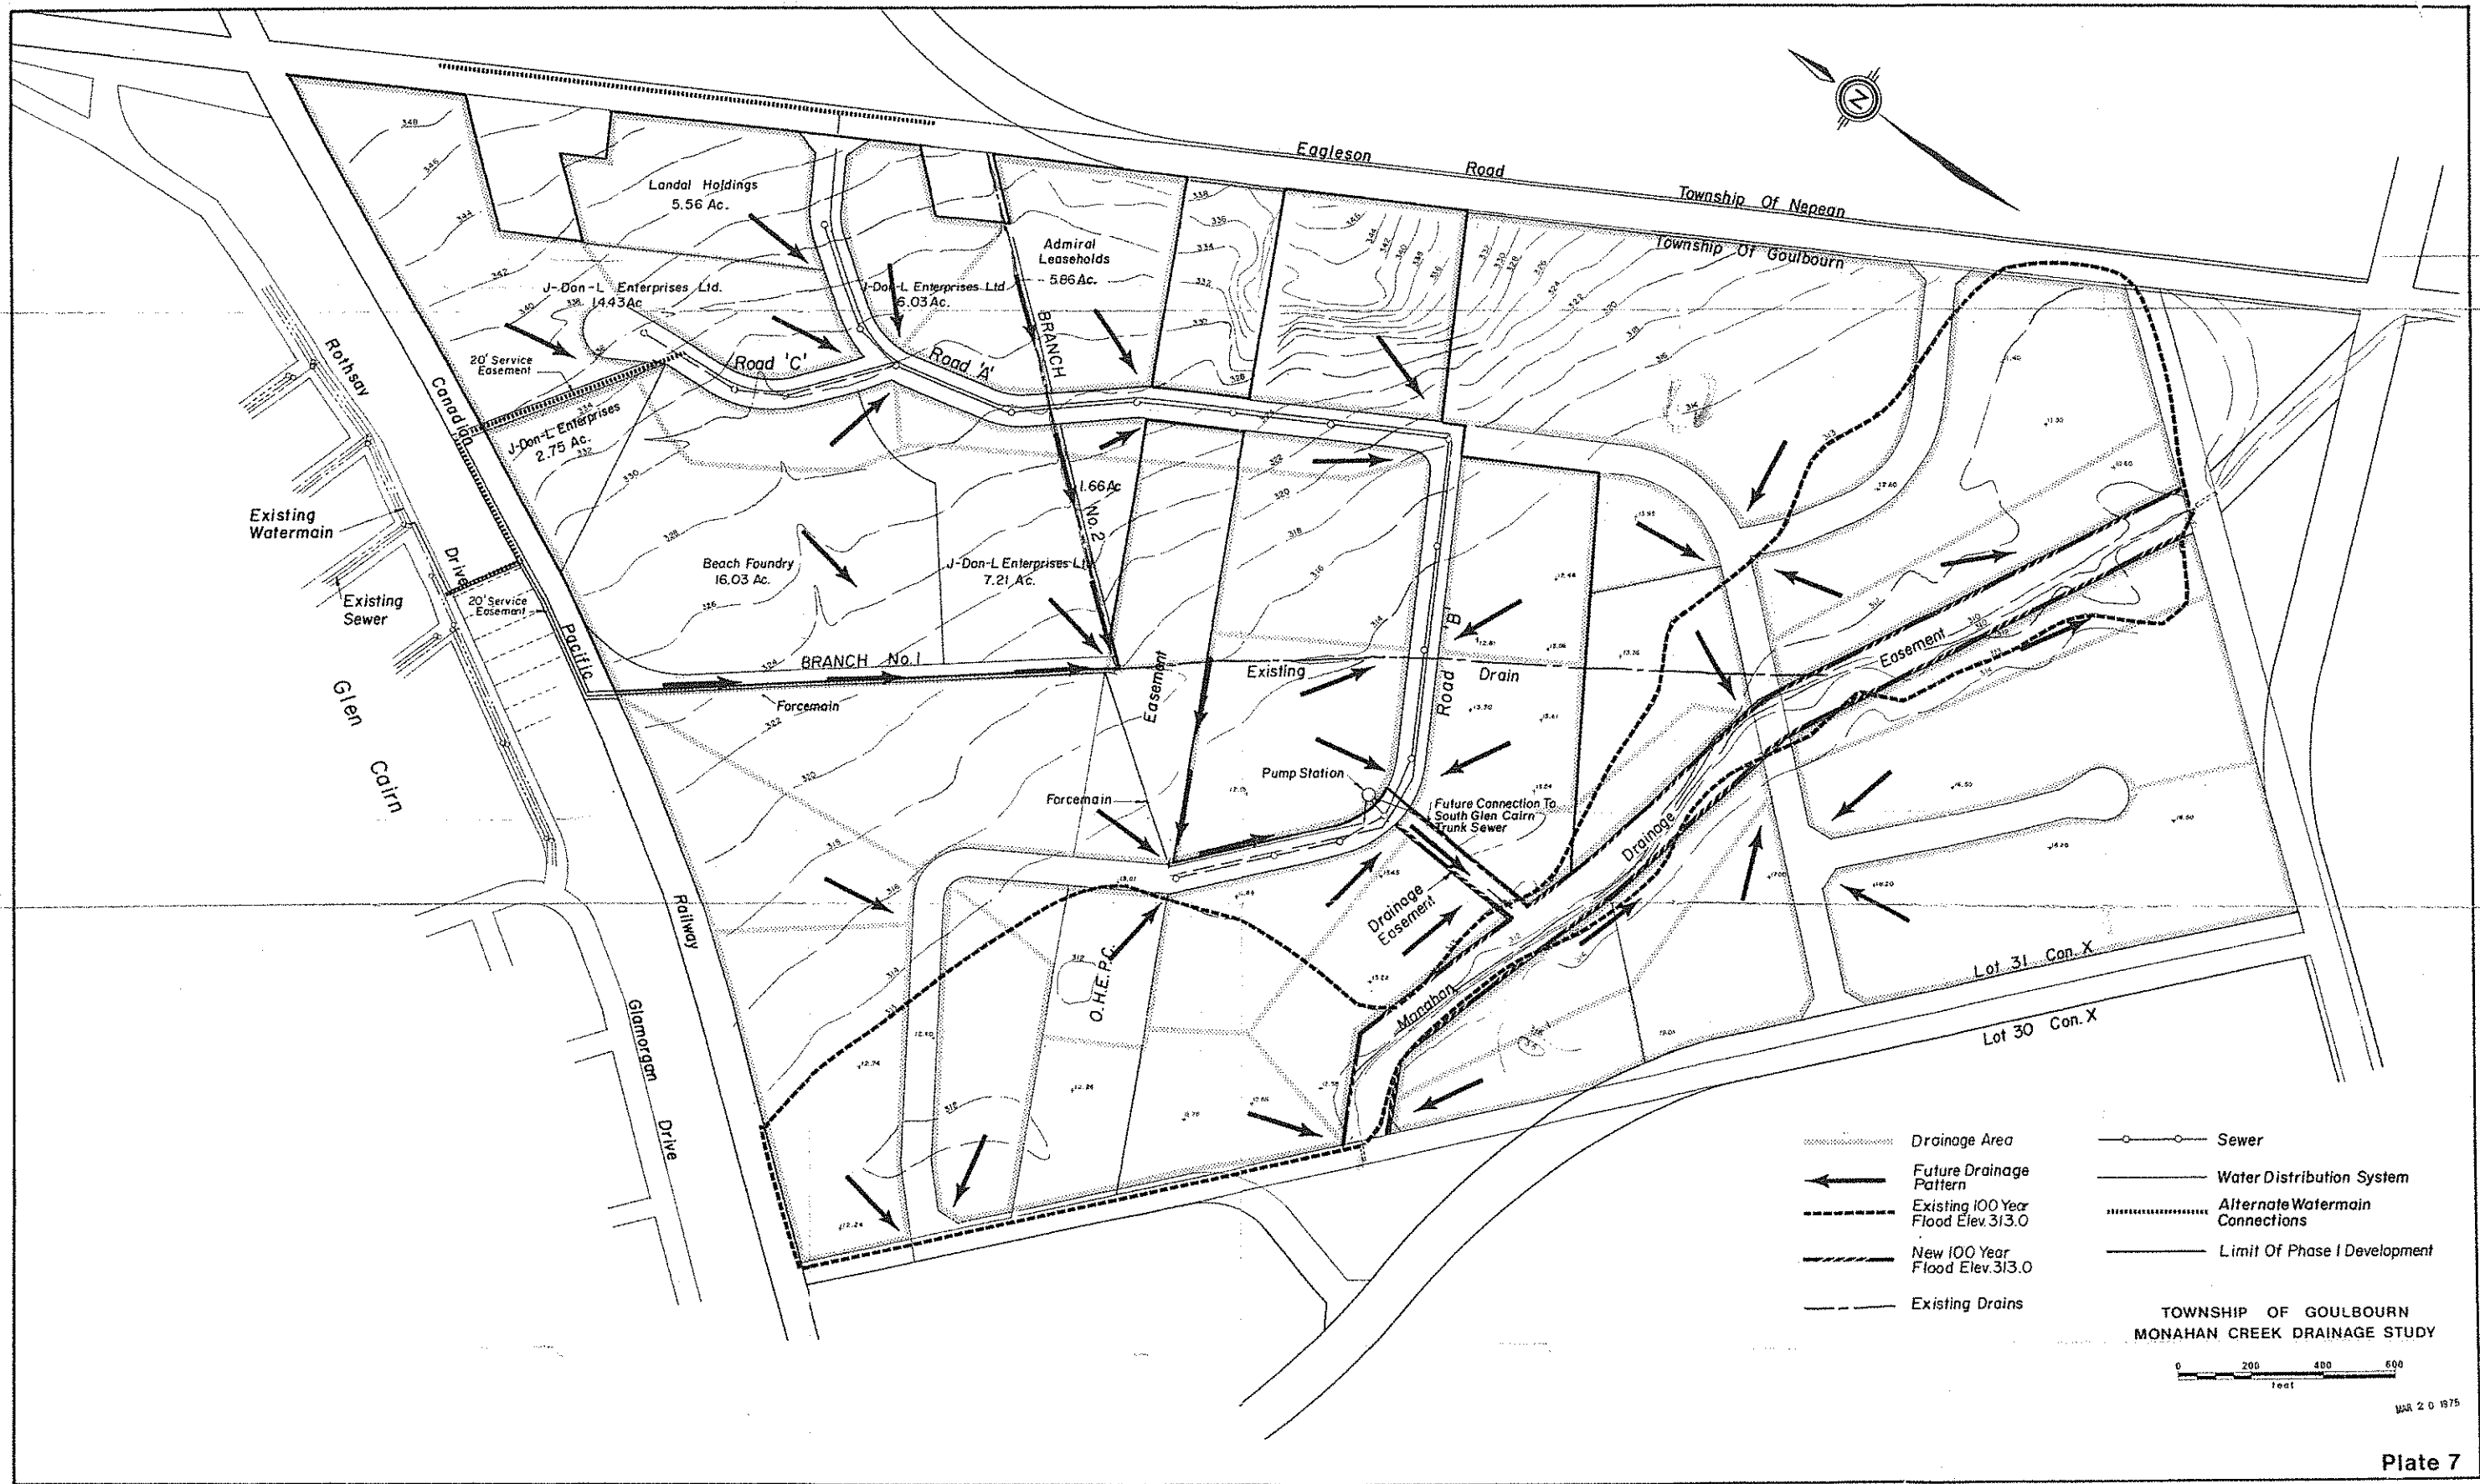

- | | | | |
|--|-------------------------------------|--|---------------------------------|
| | Drainage Area | | Sewer |
| | Future Drainage Pattern | | Water Distribution System |
| | Existing 100 Year Flood Elev. 313.0 | | Alternate Watermain Connections |
| | New 100 Year Flood Elev. 313.0 | | Limit Of Phase I Development |
| | Existing Drains | | |

TOWNSHIP OF GOULBOURN
MONAHAN CREEK DRAINAGE STUDY



MA 2 0 1975



Hydroworks Sizing Summary

Private Development-OGS 1

Kanata, Ontario

06-04-2023

Recommended Size: HydroDome HD 5

A HydroDome HD 5 is recommended to provide 80 % annual TSS removal based on a drainage area of 1.61 (ha) with an imperviousness of 94.3 % and Ottawa CDA, Ontario rainfall for the 20 um to 2000 um particle size distribution.

The recommended HydroDome HD 5 treats 99 % of the annual runoff and provides 80 % annual TSS removal for the Ottawa CDA rainfall records and 20 um to 2000 um particle size distribution.

The HydroDome has a siphon which creates a discontinuity in headloss. The given peak flow of .23 (m³/s) is greater than the full pipe flow of .18 (m³/s) indicating the pipe will be surcharged during the peak flow. Full pipe flow was assumed for the headloss calculations. The pressure head in the pipe was not evaluated since this would require a hydraulic gradeline analysis. The headloss was calculated to be 399 (mm) above the crown of the 375 (mm) outlet pipe.

This summary report provides the main parameters that were used for sizing. These parameters are shown on the summary tables and graphs provided in this report.

If you have any questions regarding this sizing summary please do not hesitate to contact Hydroworks at 888-290-7900 or email us at support@hydroworks.com.

The sizing program is for sizing purposes only and does not address any site specific parameters such as hydraulic gradeline, tailwater submergence, groundwater, soils bearing capacity, etc. Headloss calculations are not a hydraulic gradeline calculation since this requires a starting water level and an analysis of the entire system downstream of the HydroDome .

TSS Removal Sizing Summary

Hydroworks Siphon Separator Sizing Program - HydroDome

File Product Units CAD Video Help

General | Dimensions | Rainfall | Site | TSS PSD | TSS Loading | Quantity Storage | By-Pass | Custom | CAD | Video | Other

Site Parameters
 Area (ha)
 Imperviousness (%)

Units
 U.S.
 Metric

Rainfall Station
 Ottawa CDA Ontario
 1960 To 2001 Rainfall Timestep = 60 min.

Project Title
 (2 lines)

ETV Lab Testing Results Post Treatment Recharge

Outlet Pipe
 Diam. (mm) Peak Design Flow (m3/s)
 Slope (%)

HydroDome Annual Sizing Results

Model #	Qlow (m3/s)	Qtot (m3/s)	Flow Capture (%)	TSS Removal (%)
Unavailable	.233	.233	99 %	59 %
HD 4	.233	.233	99 %	71 %
HD 5	.233	.233	99 %	80 %
HD 6	.233	.233	99 %	85 %
Unavailable	.233	.233	99 %	88 %
HD 8	.233	.233	99 %	91 %
HD 10	.233	.233	99 %	94 %
HD 12	.233	.233	99 %	96 %

Particle Size Distribution

Size (um)	%	SG
20	20	2.65
60	20	2.65
150	20	2.65
400	20	2.65
2000	20	2.65

Note: Results vary significantly based on particle size distribution

TSS Particle Size Distribution

Hydroworks Siphon Separator Sizing Program - HydroDome

File Product Units CAD Video Help

General | Dimensions | Rainfall | Site | TSS PSD | TSS Loading | Quantity Storage | By-Pass | Custom | CAD | Video | Other

TSS Particle Size Distribution

Size (um)	%	SG
▶ 20	20	2.65
60	20	2.65
150	20	2.65
400	20	2.65
2000	20	2.65
*		

Notes:


- To change data just click a cell and type in the new value(s)
- To add a row just go to the bottom of the table and start typing.
- To delete a row, select the row by clicking on the first pointer column, then press delete
- To sort the table click on one of the column headings

TSS Distributions

ETV Canada / NJDEP
 Standard HDS Design
 Alden Laboratory
 OK110
 Toronto
 Ontario Fine
 Calgary Forebay
 Kitchener
 User Defined

You must select a particle size distribution for TSS to simulate TSS removal

Water Temp (C)

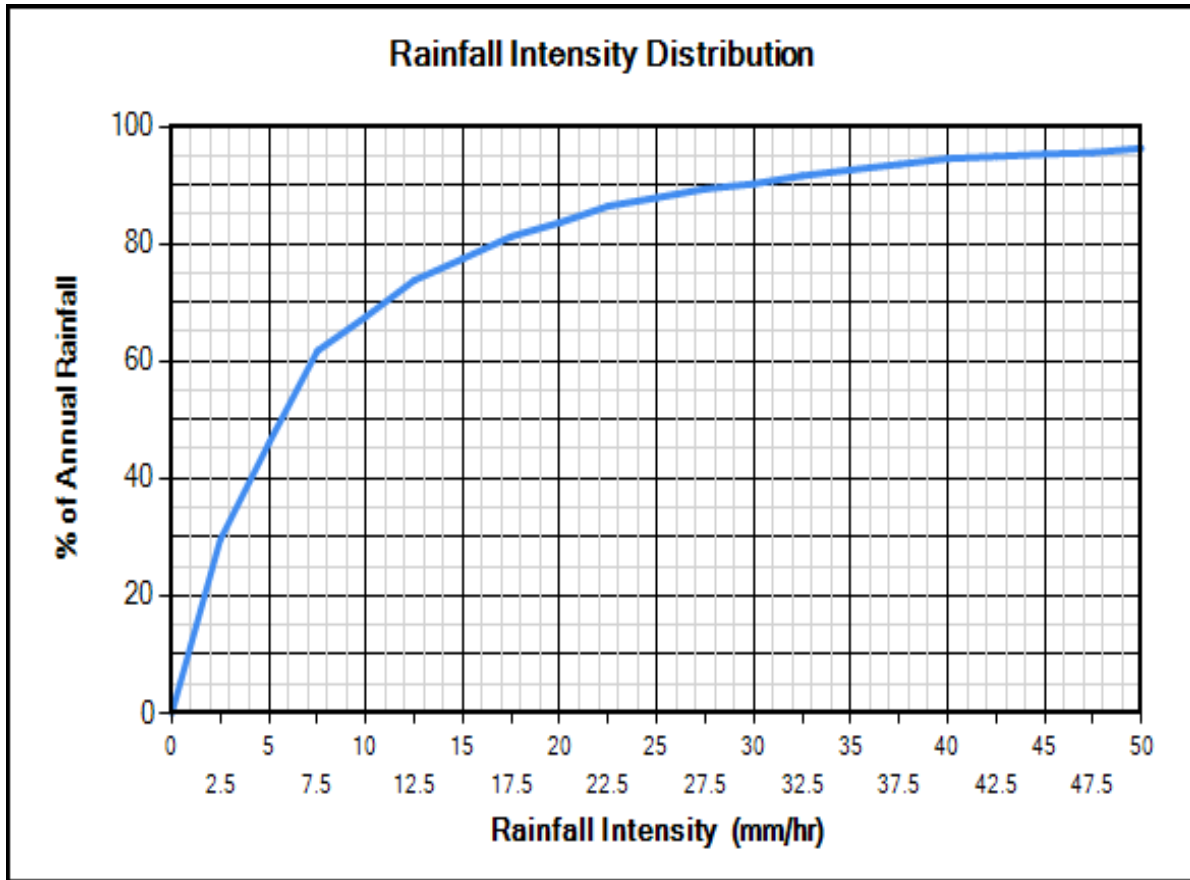

Site Physical Characteristics

Hydroworks Siphon Separator Sizing Program - HydroDome

File Product Units CAD Video Help

General Dimensions Rainfall Site TSS PSD TSS Loading Quantity Storage By-Pass Custom CAD Video Other

Catchment Parameters

Width (m) Imperv. Mannings n Maintenance Frequency (months)

Perv Mannings n

Slope (%) Imp. Depress. Storage (mm)

Perv. Depress. Storage (mm)

Daily Evaporation (mm/day)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
0	0	0	2.54	2.54	3.81	3.81	3.81	2.54	2.54	0	0

Infiltration

Max. Infiltration Rate (mm/hr)

Min. Infiltration Rate (mm/hr)

Infiltration Decay Rate (1/s)

Infiltration Regen. Rate (1/s)

Catch Basins

of Catch basins

Controlled Roof Runoff

Roof Runoff (m3/s)

Dimensions And Capacities

Hydroworks Siphon Separator Sizing Program - HydroDome


File Product Units CAD Video Help

General Dimensions Rainfall Site TSS PSD TSS Loading Quantity Storage By-Pass Custom CAD Video Other

Dimensions and Capacities					
Model	Diam. (m)	Depth (m)	Float. Vol. (L)	Sediment Vol. (m3)	Total Vol. (m3)
HD 3	0.91	1.22	123	0.5	0.8
HD 4	1.22	1.37	266	0.9	1.6
HD 5	1.52	1.68	483	1.7	3.1
HD 6	1.83	1.98	803	2.9	5.2
HD 7	2.13	2.29	1226	4.6	8.2
HD 8	2.44	2.59	1863	6.8	12.1
HD 10	3.05	3.2	3617	13	23.3
HD 12	3.66	3.81	6224	22.2	40

Depth = Depth from outlet invert to inside bottom of tank

Generic HD 5 CAD Drawing

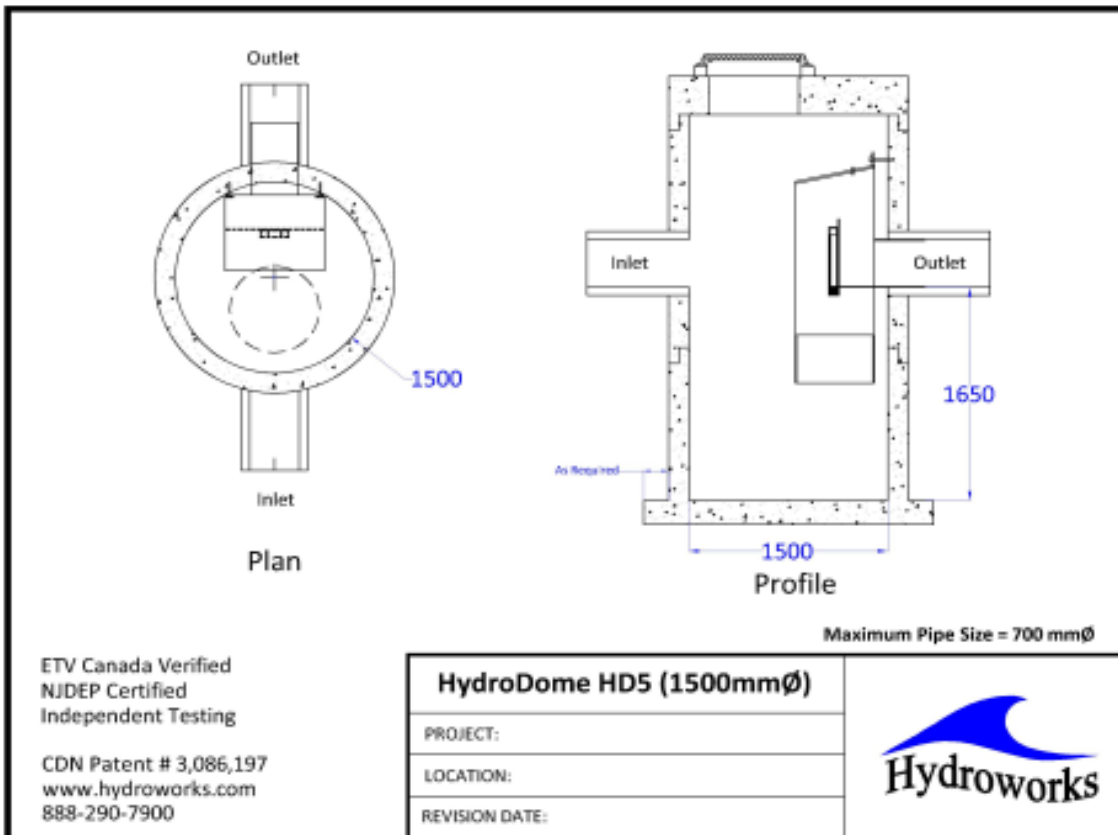

TSS Buildup And Washoff

Hydroworks Siphon Separator Sizing Program - HydroDome

File Product Units CAD Video Help

General | Dimensions | Rainfall | Site | TSS PSD | TSS Loading | Quantity Storage | By-Pass | Custom | CAD | Video | Other

TSS Buildup

Power Linear
 Exponential
 Michaelis-Menton

TSS Washoff

Power-Exponential
 Rating Curve (no upper limit)
 Rating Curve (limited to buildup)

Street Sweeping

Efficiency (%)
 Start Month
 Stop Month
 Frequency (days)
 Available Fraction

Soil Erosion
 Add Erosion to TSS

TSS Buildup Parameters

Limit (kg/ha)
 Coeff (kg/ha)
 Exponent

TSS Washoff Parameters

Coefficient
 Exponent

TSS Buildup

Based on Area
 Based on Curb Length

Upstream Quantity Storage

Hydroworks Siphon Separator Sizing Program - HydroDome

File Product Units CAD Video Help

General | Dimensions | Rainfall | Site | TSS PSD | TSS Loading | Quantity Storage | By-Pass | Custom | CAD | Video | Other

Quantity Control Storage

	Storage (m3)	Discharge (m3/s)
▶	0	0
*		

Notes:

1. To change data just click a cell and type in the new value (s)
2. To add a row just go to the bottom of the table and start typing.
3. To delete a row, select the row by clicking on the first pointer column, then press delete
4. To sort the table click on one of the column headings

Other Parameters

Hydroworks Siphon Separator Sizing Program - HydroDome

File Product Units CAD Video Help

General | Dimensions | Rainfall | Site | TSS PSD | TSS Loading | Quantity Storage | By-Pass | Custom | CAD | Video | Other

Scaling Law

- Peclet Scaling based on diameter x depth
- Peclet Scaling based on surface area (diameter x diameter)

HydroDome Design

- High Flow Weir
- Flow Control (parking lot storage)
Must add Quantity Storage Table

TSS Removal Extrapolation

- Extrapolate TSS Removal for flows lower than tested
- No TSS Removal extrapolation for flows lower than tested
- No TSS Removal extrapolation for lower flows or inter-event periods

HD Hydraulics

HD Model HD 5

- Custom Insert Size

Lab Testing

- Use NJDEP Lab Testing Results
- Use ETV Canada Lab Testing Results

TSS Removal Results

- Required TSS Removal
- Choose Model #

TSS Removal Required



TSS Removal (%) 80.0 Enter required TSS Removal (%)

Flagged Issues

If there is underground detention storage upstream of the HydroDome please contact Hydroworks to ensure it has been modeled correctly.

Hydroworks Sizing Program - Version 5.7
Copyright Hydroworks, LLC, 2022
1-800-290-7900
www.hydroworks.com

PROPOSED LAYOUT		CONCEPTUAL ELEVATIONS:		PART TYPE		ITEM ON LAYOUT		DESCRIPTION		*INVERT ABOVE BASE OF CHAMBER	
16	STORMTECH MC-3500 CHAMBERS	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED)	3.810								
7	STORMTECH MC-3500 END CAPS	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC)	1.981								
450	STONE ABOVE (mm)	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC)	1.829								
228	STONE BELOW (mm)	MINIMUM ALLOWABLE GRADE (TOP OF RIGID CONCRETE PAVEMENT)	1.829								
30	STONE VOID	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT)	1.829								
104.5	INSTALLED SYSTEM VOLUME (m ³)	TOP OF STONE	1.829								
	(PERIMETER STONE INCLUDED)	TOP OF MC-3500 CHAMBER	1.372								
	(COVER STONE INCLUDED)	600 mm ISOLATOR ROW PLUS INVERT	0.281								
125.8	SYSTEM AREA (m ²)	BOTTOM OF MC-3500 CHAMBER	0.226								
81.7	SYSTEM PERIMETER (m)	BOTTOM OF STONE	0.000								

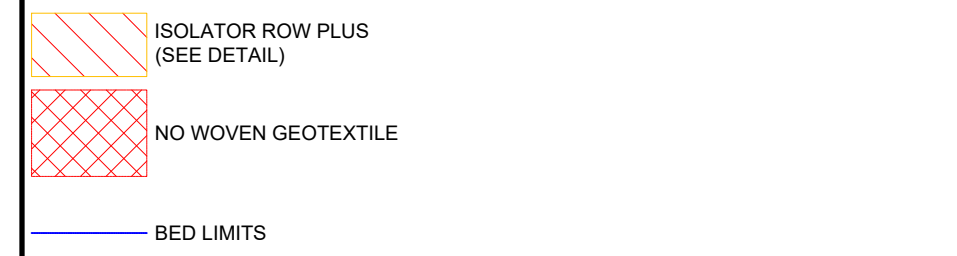
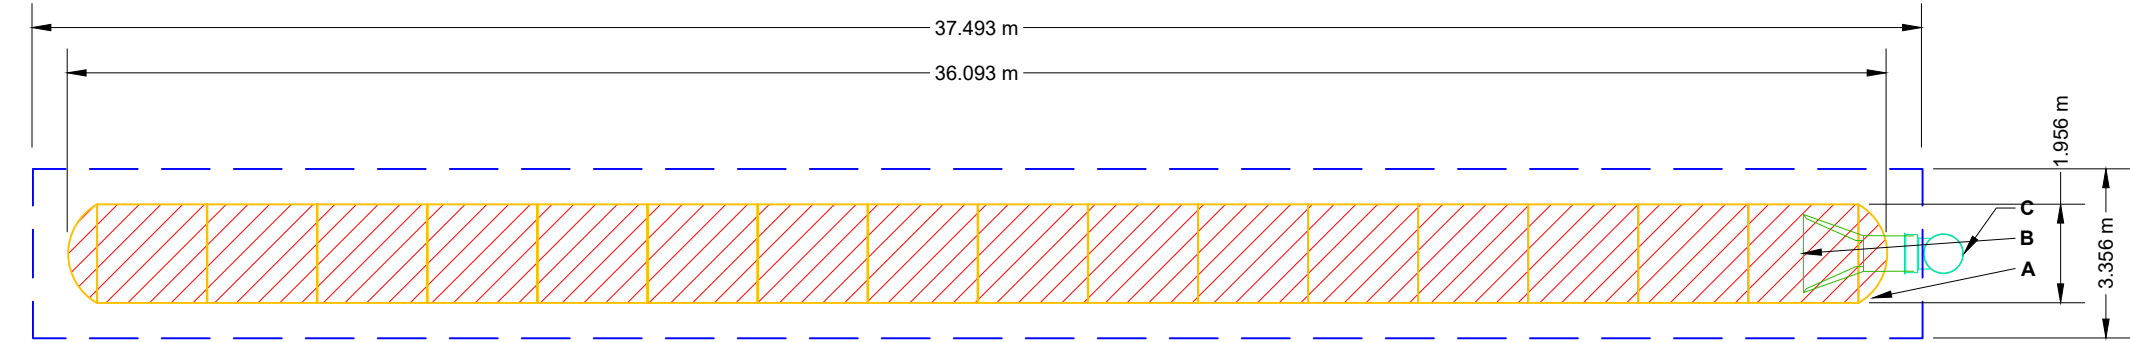


NOTES

- MANHOLE SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH NOTE #6.32 FOR MANHOLE SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANHOLE COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- THIS CHAMBER SYSTEM WAS DESIGNED WITHOUT SITE-SPECIFIC INFORMATION ON SOIL CONDITIONS OR BEARING CAPACITY. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL AND PROVIDING THE BEARING CAPACITY OF THE INSITU SOILS. THE BASE STONE DEPTH MAY BE INCREASED OR DECREASED ONCE THIS INFORMATION IS PROVIDED.
- NOT FOR CONSTRUCTION:** THIS LAYOUT IS FOR DIMENSIONAL PURPOSES ONLY TO PROVE CONCEPT & THE REQUIRED STORAGE VOLUME CAN BE ACHIEVED ON SITE.

SPACE INTENTIONALLY LEFT BLANK

SPACE INTENTIONALLY LEFT BLANK

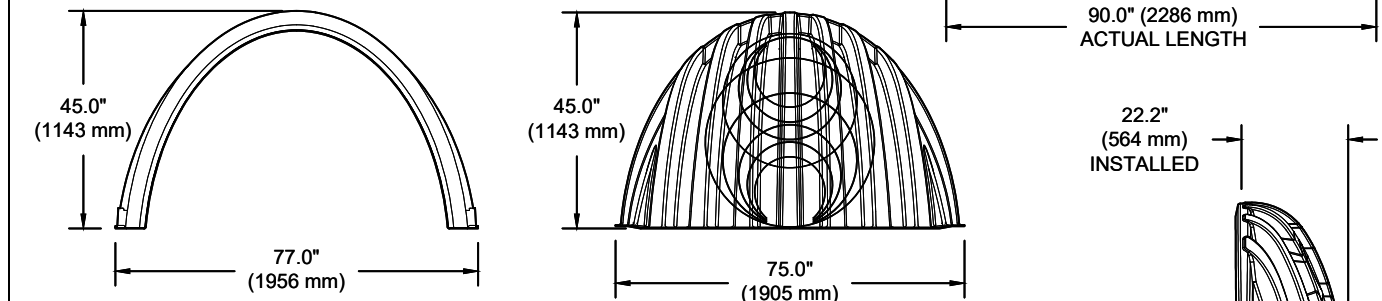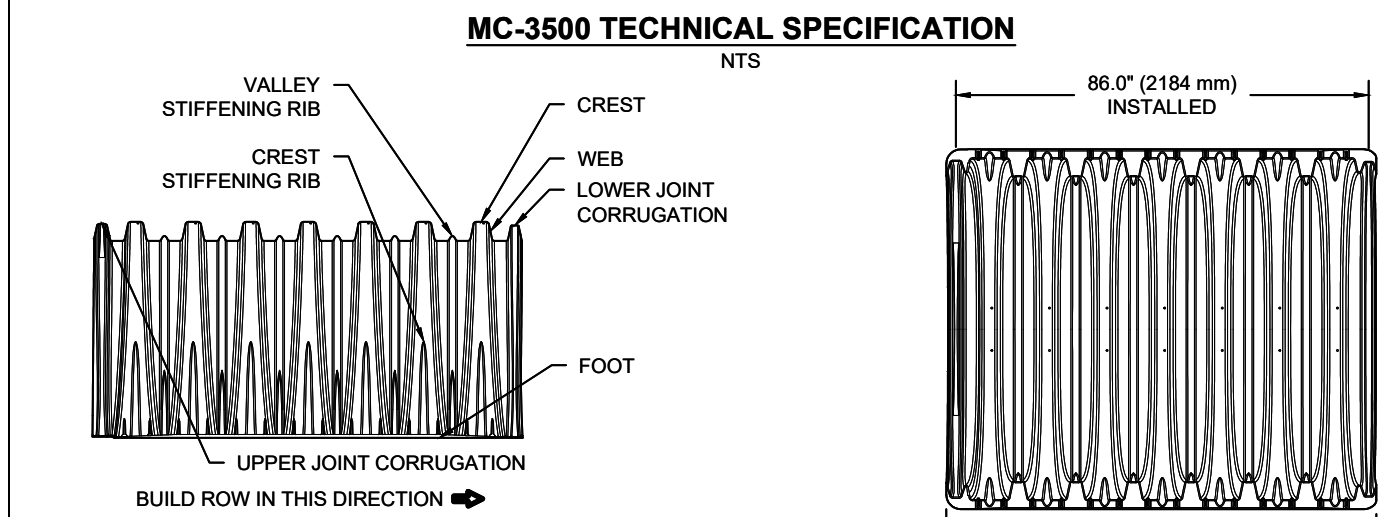

NOMINAL CHAMBER SPECIFICATIONS		NOMINAL END CAP SPECIFICATIONS	
SIZE (W X H X INSTALLED LENGTH)	77.0\"/>		
CHAMBER STORAGE	109.9 CUBIC FEET (3.11 m ³)	SIZE (W X H X INSTALLED LENGTH)	75.0\"/>
MINIMUM INSTALLED STORAGE*	175.0 CUBIC FEET (4.96 m ³)	END CAP STORAGE	14.9 CUBIC FEET (0.42 m ³)
WEIGHT	134 lbs. (60.8 kg)	MINIMUM INSTALLED STORAGE*	45.1 CUBIC FEET (1.28 m ³)
		WEIGHT	49 lbs. (22.2 kg)

*ASSUMES 12\"/>

STUBS AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH 'B'
 STUBS AT TOP OF END CAP FOR PART NUMBERS ENDING WITH 'T'
 END CAPS WITH A WELDED CROWN PLATE END WITH 'C'
 END CAPS WITH A PREFABRICATED WELDED STUB END WITH 'W'

PART #	STUB	B	C
MC3500EPP08T	6\"/>		
MC3500EPP08B	6\"/>		
MC3500EPP08T	8\"/>		
MC3500EPP08B	8\"/>		
MC3500EPP10T	10\"/>		
MC3500EPP10B	10\"/>		
MC3500EPP12T	12\"/>		
MC3500EPP12B	12\"/>		
MC3500EPP15T	15\"/>		
MC3500EPP15B	15\"/>		
MC3500EPP18T	18\"/>		
MC3500EPP18T	18\"/>		
MC3500EPP18B	18\"/>		
MC3500EPP24T	24\"/>		
MC3500EPP24T	24\"/>		
MC3500EPP24B	24\"/>		
MC3500EPP24B	24\"/>		
MC3500EPP30B	30\"/>		

CUSTOM PRECURED INVERTS ARE AVAILABLE UPON REQUEST. INVENTORIED MANIFOLDS INCLUDE 12-24\"/>


2 MC-3500 TECHNICAL SPECIFICATION

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS


MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER.	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24\"/>	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. OR MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	BEGIN COMPACTIONS AFTER 24\"/>
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

PLEASE NOTE:
 1. THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
 2. STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9\"/>

3 MC-3500 ISOLATOR ROW PLUS DETAIL

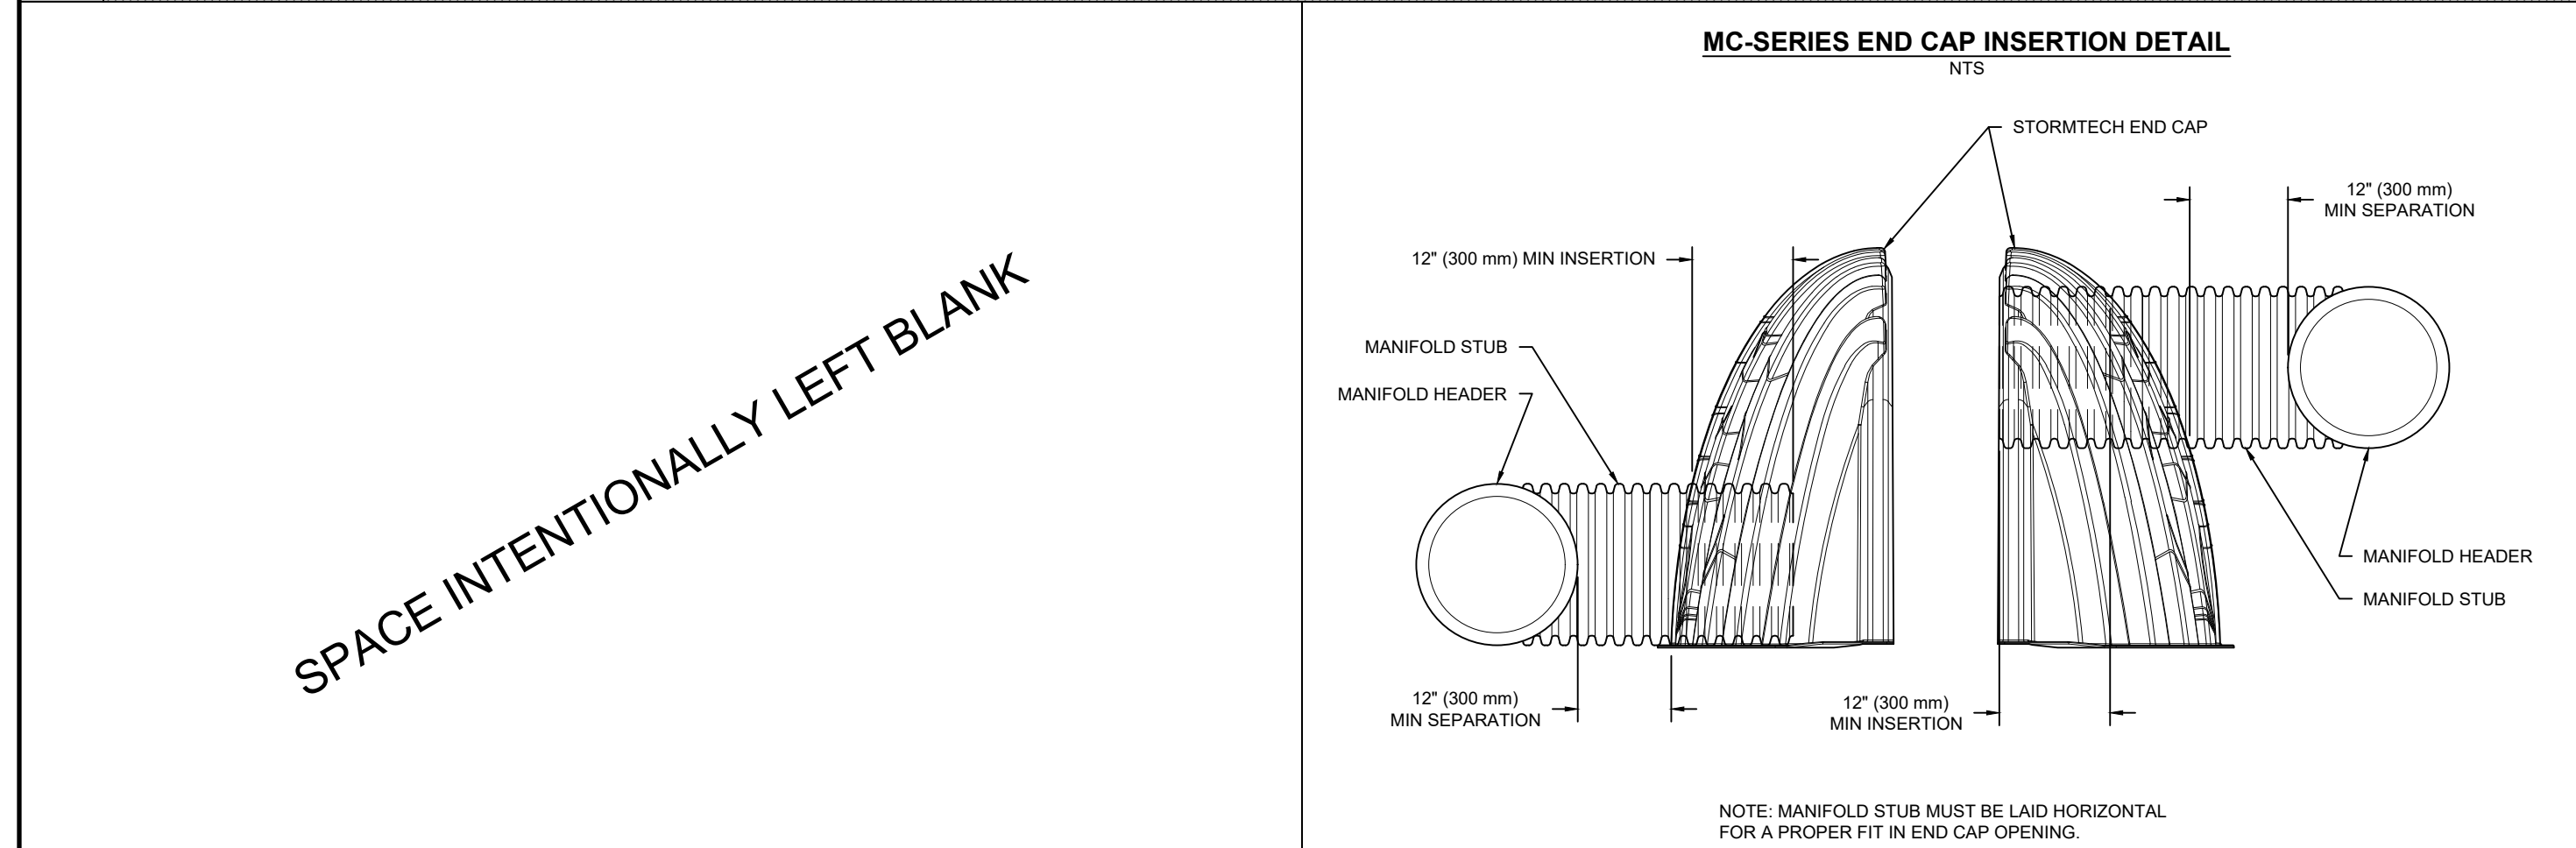

SPACE INTENTIONALLY LEFT BLANK

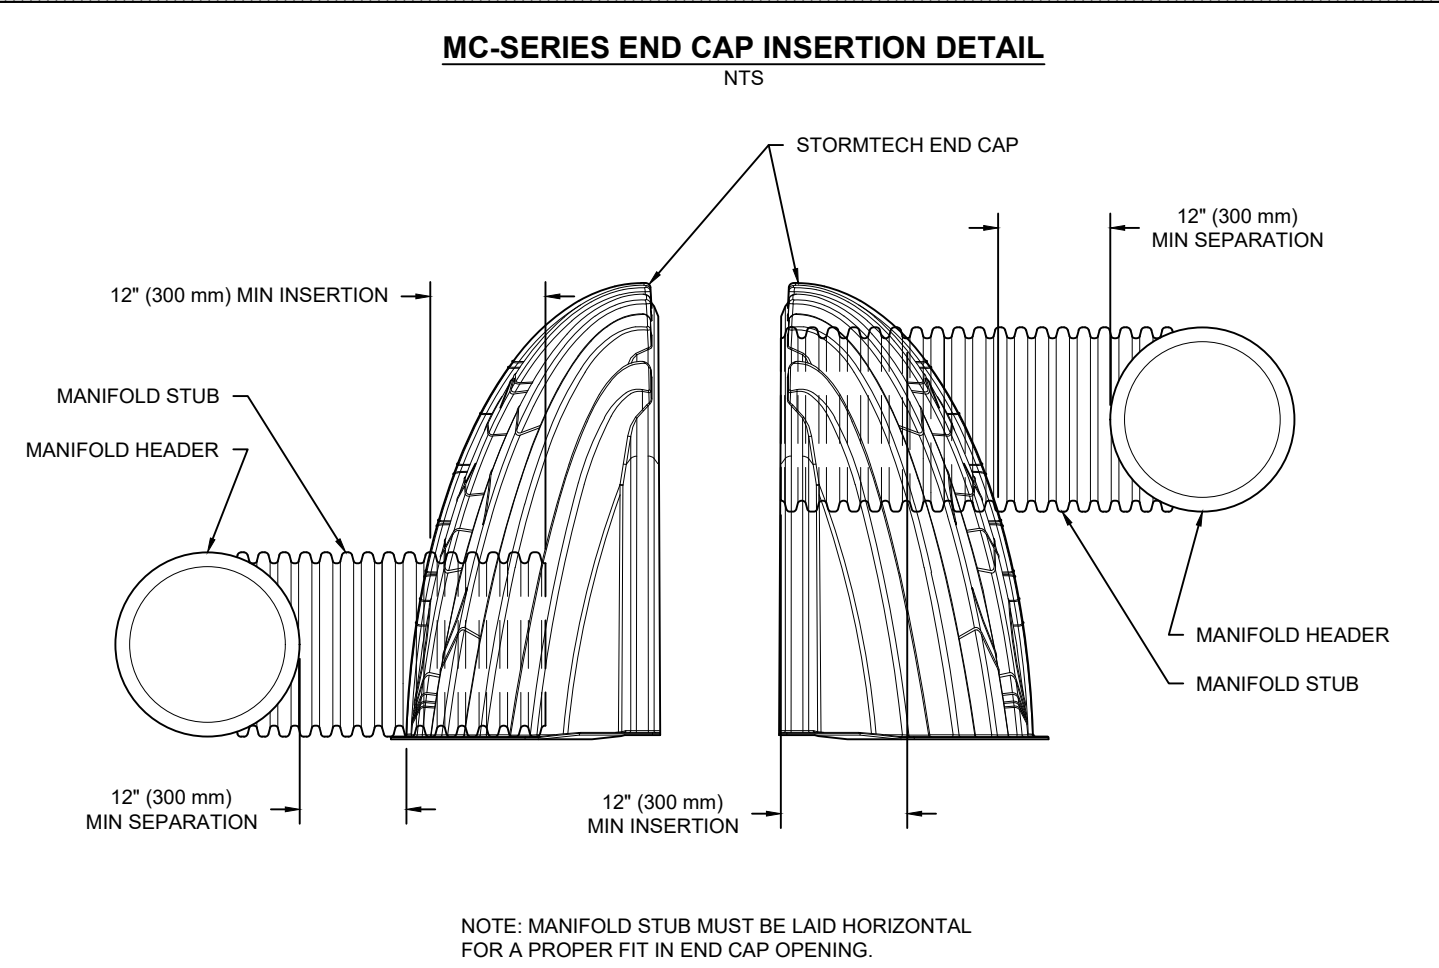

1 MC-3500 CROSS SECTION DETAIL

NOTES:
 1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION 55.
 2. MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 3. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
 4. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
 5. REQUIREMENTS FOR HANDLING AND INSTALLATION:
 • TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 • TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3\"/>

DATE: PROJECT #: NOT TO SCALE

DRAWN: AZ CHECKED: N/A REV: 75 MICHAEL COWPLAND - CHAMBER 1 OTTAWA, AK, USA

StormTech Chamber System 888-892-2894 | WWW.STORMTECH.COM



4640 TRUEMAN BLVD HILLIARD, OH 43026 1-800-733-7473

ADS

SHEET 1 OF 1

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.


PROPOSED LAYOUT		CONCEPTUAL ELEVATIONS:		PART TYPE		ITEM ON LAYOUT	DESCRIPTION	INVERT	MAX FLOW
21	STORMTECH MC-3500 CHAMBERS	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED)	3.810						
2	STORMTECH MC-3500 END CAPS	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC)	1.981						
450	STONE ABOVE (mm)	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC)	1.829						
228	STONE BELOW (mm)	MINIMUM ALLOWABLE GRADE (TOP OF RIGID CONCRETE PAVEMENT)	1.829						
30	STONE VOID	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT)	1.829						
135.5	INSTALLED SYSTEM VOLUME (m ³)	TOP OF STONE	1.829						
	(PERIMETER STONE INCLUDED)	TOP OF MC-3500 CHAMBER	1.374						
	(COVER STONE INCLUDED)	600 mm ISOLATOR ROW PLUS INVERT	0.281						
162.5	SYSTEM AREA (m ²)	BOTTOM OF MC-3500 CHAMBER	0.226						
103.5	SYSTEM PERIMETER (m)	BOTTOM OF STONE	0.000						

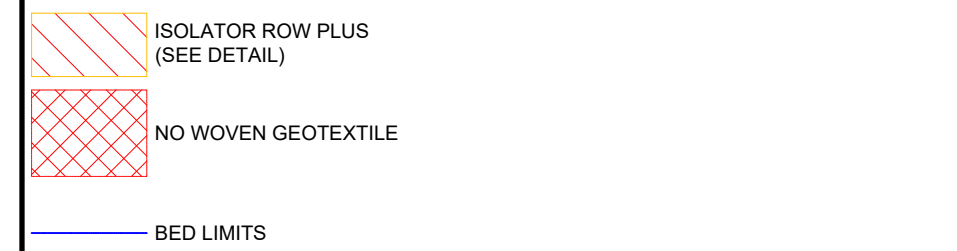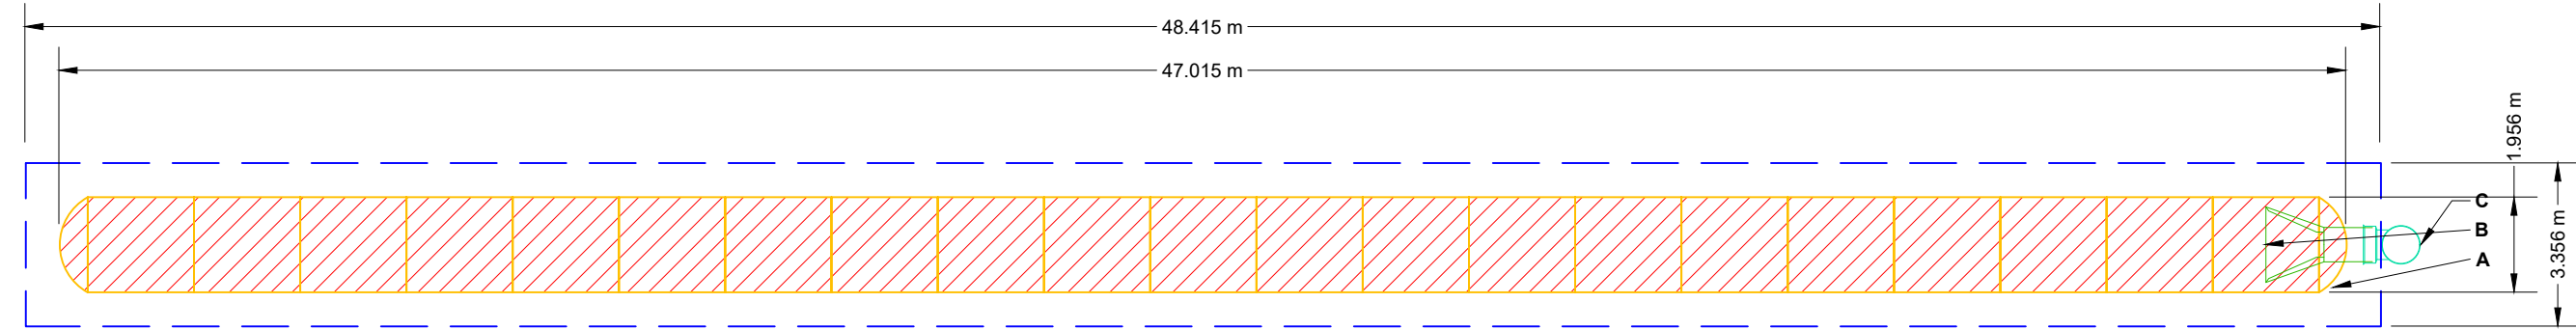

NOTES
 MANHOLE SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH NOTE #6.32 FOR MANHOLE SIZING GUIDANCE.
 DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANHOLE COMPONENTS IN THE FIELD.
 THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
 THIS CHAMBER SYSTEM WAS DESIGNED WITHOUT SITE-SPECIFIC INFORMATION ON SOIL CONDITIONS OR BEARING CAPACITY. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL AND PROVIDING THE BEARING CAPACITY OF THE INSITU SOILS. THE BASE STONE DEPTH MAY BE INCREASED OR DECREASED ONCE THIS INFORMATION IS PROVIDED.
 NOT FOR CONSTRUCTION: THIS LAYOUT IS FOR DIMENSIONAL PURPOSES ONLY TO PROVE CONCEPT & THE REQUIRED STORAGE VOLUME CAN BE ACHIEVED ON SITE.

SPACE INTENTIONALLY LEFT BLANK

SPACE INTENTIONALLY LEFT BLANK

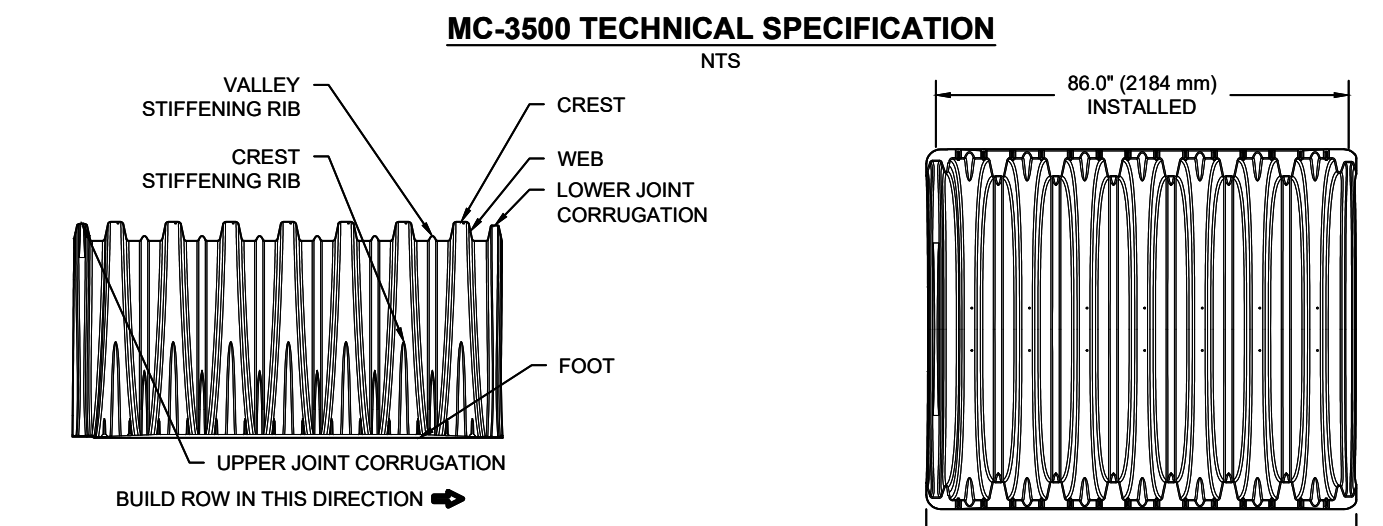

NOMINAL CHAMBER SPECIFICATIONS		NOMINAL END CAP SPECIFICATIONS	
SIZE (W X H X INSTALLED LENGTH)	77.0' X 45.0' X 86.0'	SIZE (W X H X INSTALLED LENGTH)	75.0' X 45.0' X 22.2'
CHAMBER STORAGE	109.9 CUBIC FEET (3.11 m ³)	END CAP STORAGE	14.9 CUBIC FEET (0.42 m ³)
MINIMUM INSTALLED STORAGE*	175.0 CUBIC FEET (4.96 m ³)	MINIMUM INSTALLED STORAGE*	45.1 CUBIC FEET (1.28 m ³)
WEIGHT	134 lbs. (60.8 kg)	WEIGHT	49 lbs. (22.2 kg)

*ASSUMES 12" (305 mm) STONE ABOVE, 9" (229 mm) STONE FOUNDATION, 6" SPACING BETWEEN CHAMBERS, 6" (152 mm) STONE PERIMETER IN FRONT OF END CAPS AND 40% STONE POROSITY

PART #	STUB	B	C
MC3500IEP08T	6" (150 mm)	33.21" (844 mm)	0.66" (17 mm)
MC3500IEP08B	8" (200 mm)	31.16" (791 mm)	---
MC3500IEP08B	8" (200 mm)	---	0.81" (21 mm)
MC3500IEP10T	10" (250 mm)	29.04" (738 mm)	---
MC3500IEP10B	10" (250 mm)	---	0.93" (24 mm)
MC3500IEP12T	12" (300 mm)	26.36" (670 mm)	---
MC3500IEP12B	12" (300 mm)	---	1.35" (34 mm)
MC3500IEP15T	15" (375 mm)	23.39" (594 mm)	---
MC3500IEP15B	15" (375 mm)	---	1.50" (38 mm)
MC3500IEP18T	18" (450 mm)	20.03" (509 mm)	---
MC3500IEP18B	18" (450 mm)	---	1.77" (45 mm)
MC3500IEP24T	24" (600 mm)	14.48" (368 mm)	---
MC3500IEP24B	24" (600 mm)	---	2.06" (52 mm)
MC3500IEP30B	30" (750 mm)	---	2.75" (70 mm)


STUBS AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH "B"
 STUBS AT TOP OF END CAP FOR PART NUMBERS ENDING WITH "T"
 END CAPS WITH A WELDED CROWN PLATE END WITH "C"
 END CAPS WITH A PREFABRICATED WELDED STUB END WITH "W"
 CUSTOM PRECURED INVERTS ARE AVAILABLE UPON REQUEST.
 INVENTORIED MANIFOLDS INCLUDE 12-24" (300-600 mm) SIZE ON SIZE AND 15-48" (375-1200 mm) ECCENTRIC MANIFOLDS. CUSTOM INVERT LOCATIONS ON THE MC-3500 END CAP CUT IN THE FIELD ARE NOT RECOMMENDED FOR PIPE SIZES GREATER THAN 10" (250 mm). THE INVERT LOCATION IN COLUMN 'B' ARE THE HIGHEST POSSIBLE FOR THE PIPE SIZE.
 NOTE: ALL DIMENSIONS ARE NOMINAL

2 MC-3500 TECHNICAL SPECIFICATION

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER.	ANY SOIL/ROCK MATERIALS, NATIVE SOILS, OR PER ENGINEER'S PLANS. CHECK PLANS FOR PAVEMENT SUBGRADE REQUIREMENTS.	N/A PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	AASHTO M145 ¹ A-1, A-2.4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43 ¹ 3, 4 NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43 ¹ 3, 4 PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}


PLEASE NOTE:
 1. THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
 2. STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERSAGES WITH A VIBRATORY COMPACTOR.
 3. WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
 4. ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.

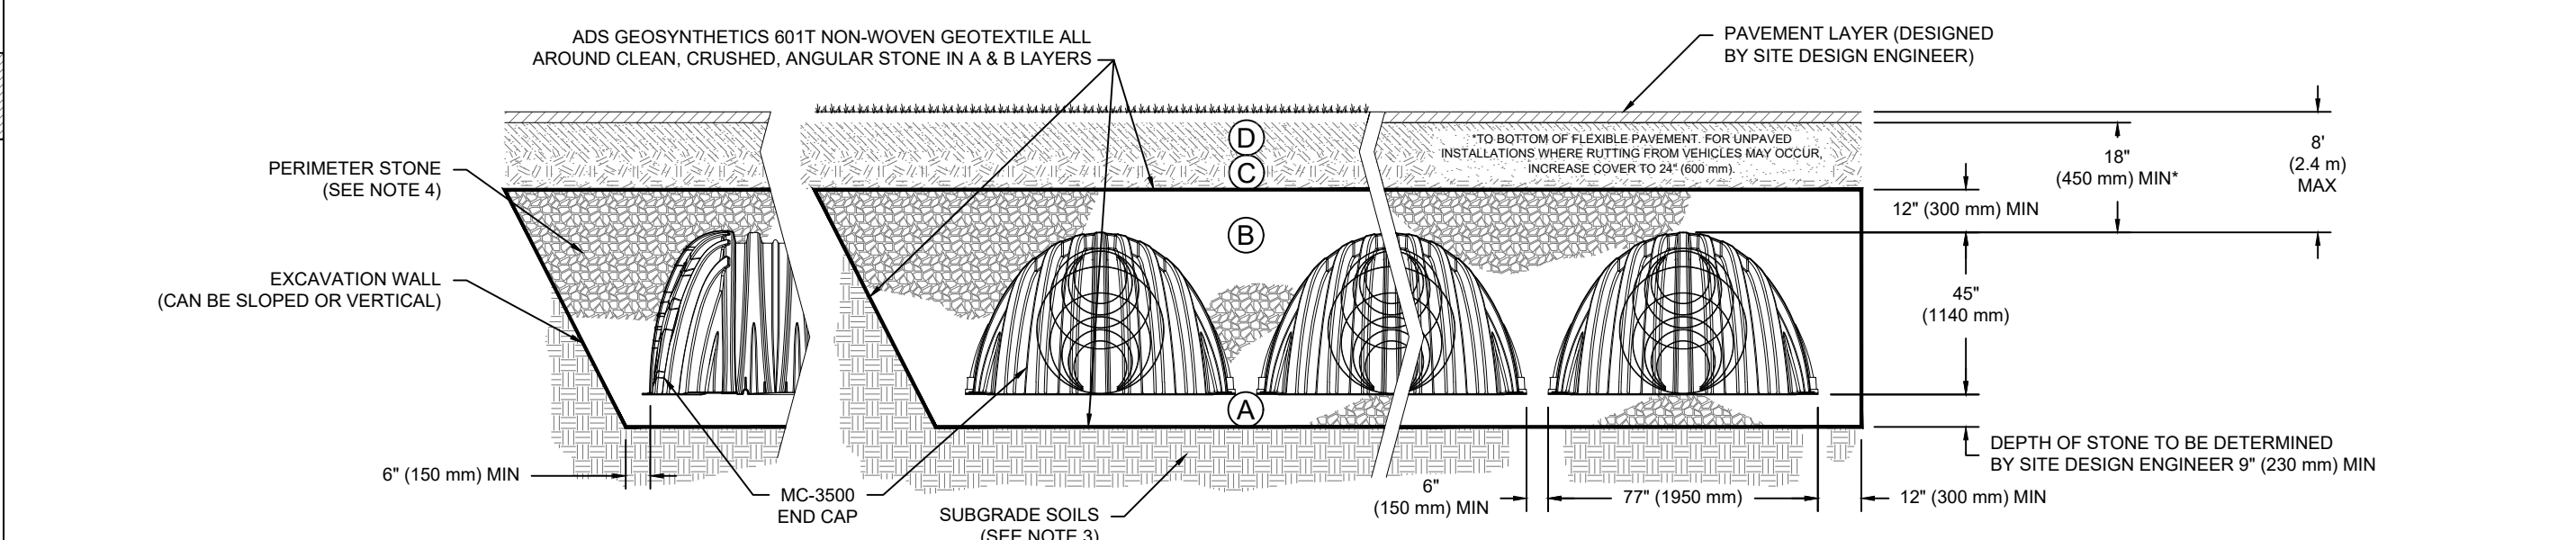

NOTES:
 1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION 55.
 2. MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 3. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
 4. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
 5. REQUIREMENTS FOR HANDLING AND INSTALLATION:
 • TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 • TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3".
 • TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT SHALL BE GREATER THAN OR EQUAL TO 450 LBS/FT². THE ASC IS DEFINED IN SECTION 6.2.8 OF ASTM F2418. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.


1 MC-3500 CROSS SECTION DETAIL

3 MC-3500 ISOLATOR ROW PLUS DETAIL

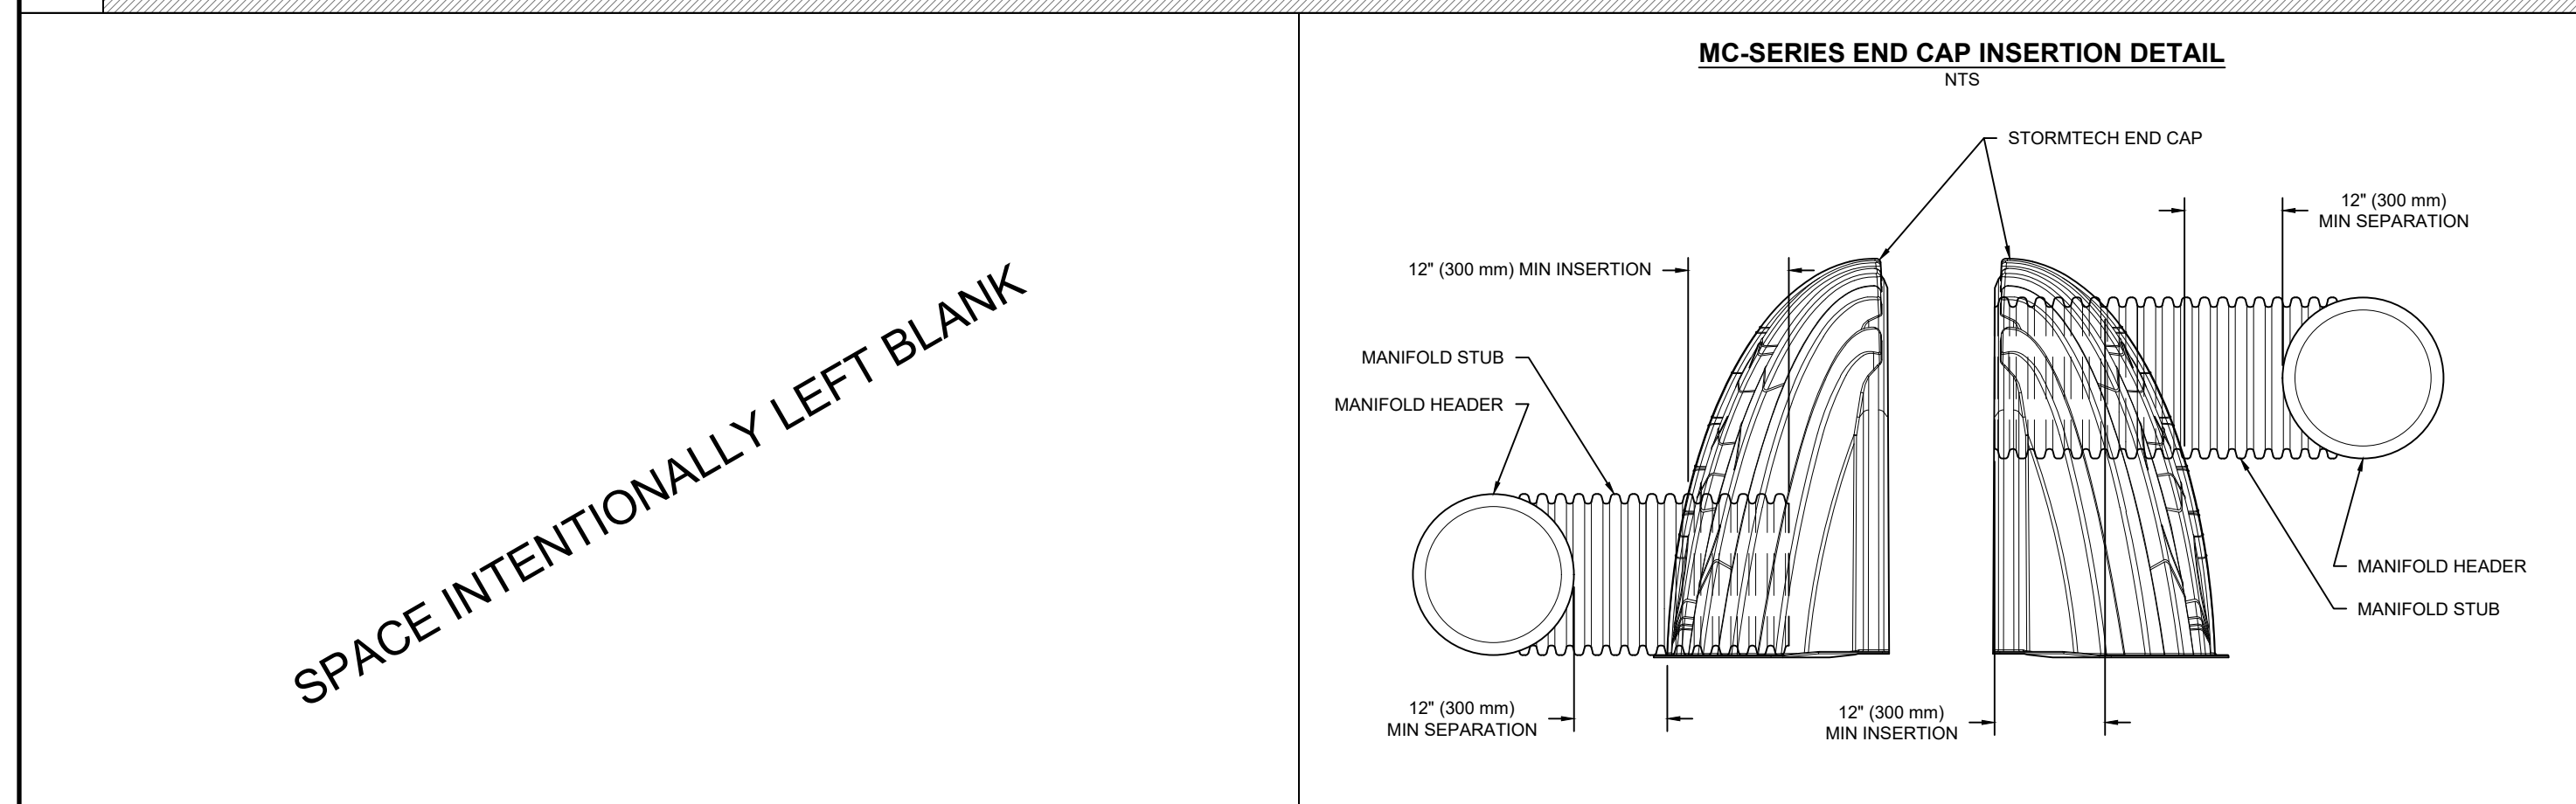

SPACE INTENTIONALLY LEFT BLANK

4 MC-SERIES END CAP INSERTION DETAIL

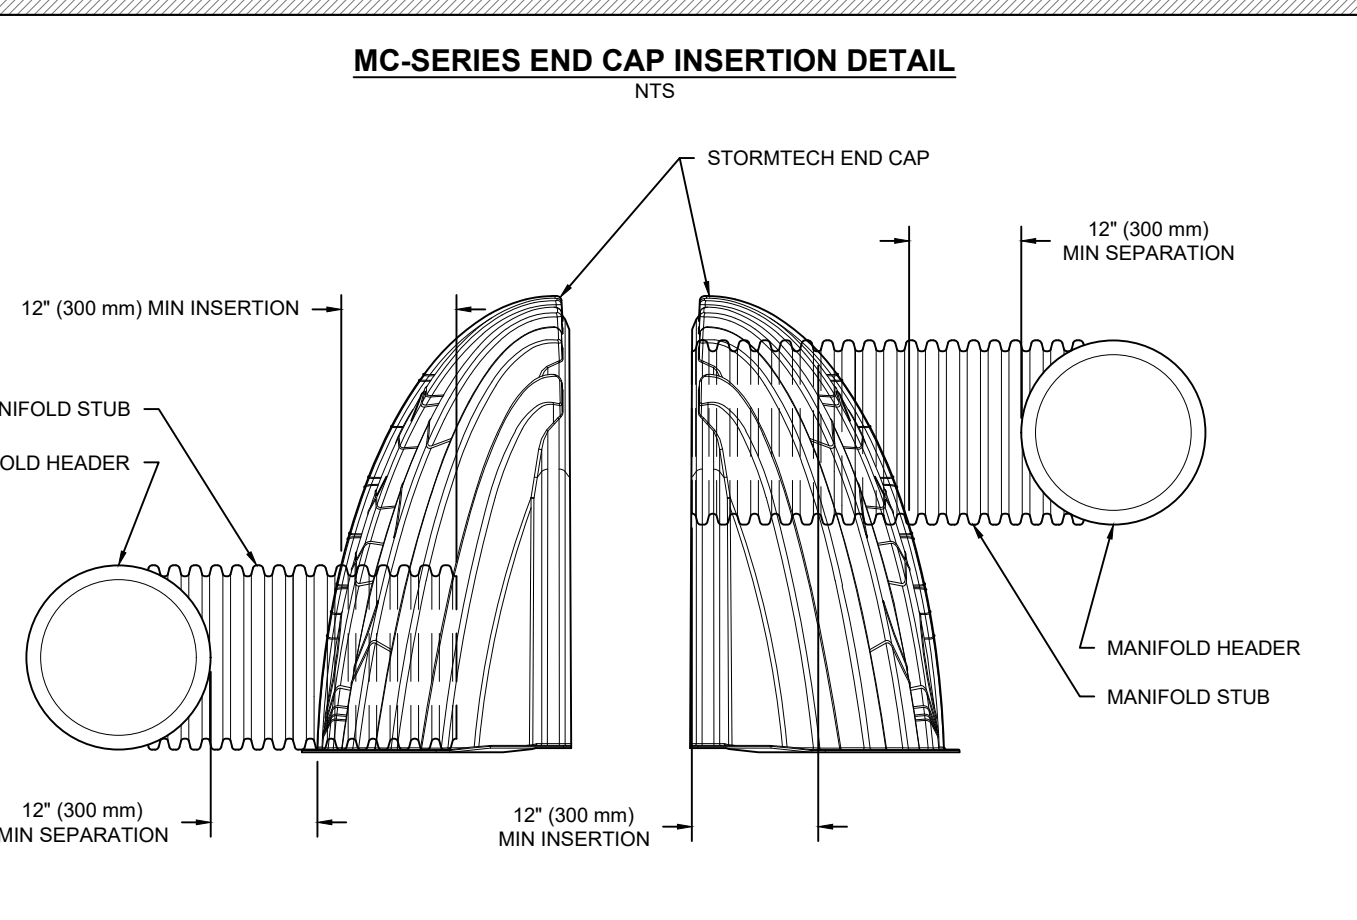



4 MC-SERIES END CAP INSERTION DETAIL

DATE: _____ PROJECT #: _____
 DRAWN: AZ CHECKED: N/A REV: _____
75 MICHAEL COWPLAND - CHAMBER 2
OTTAWA, AK, USA
 888-892-2894 | WWW.STORMTECH.COM
StormTech®
 Chamber System
 4640 TRUEMAN BLVD
 HILLIARD, OH 43026
 1-800-733-7473
 SHEET
 1 OF 1

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

APPENDIX E

- Grading Plan Drawing C-200
- Erosion and Sedimentation Control Plan Drawing C-900

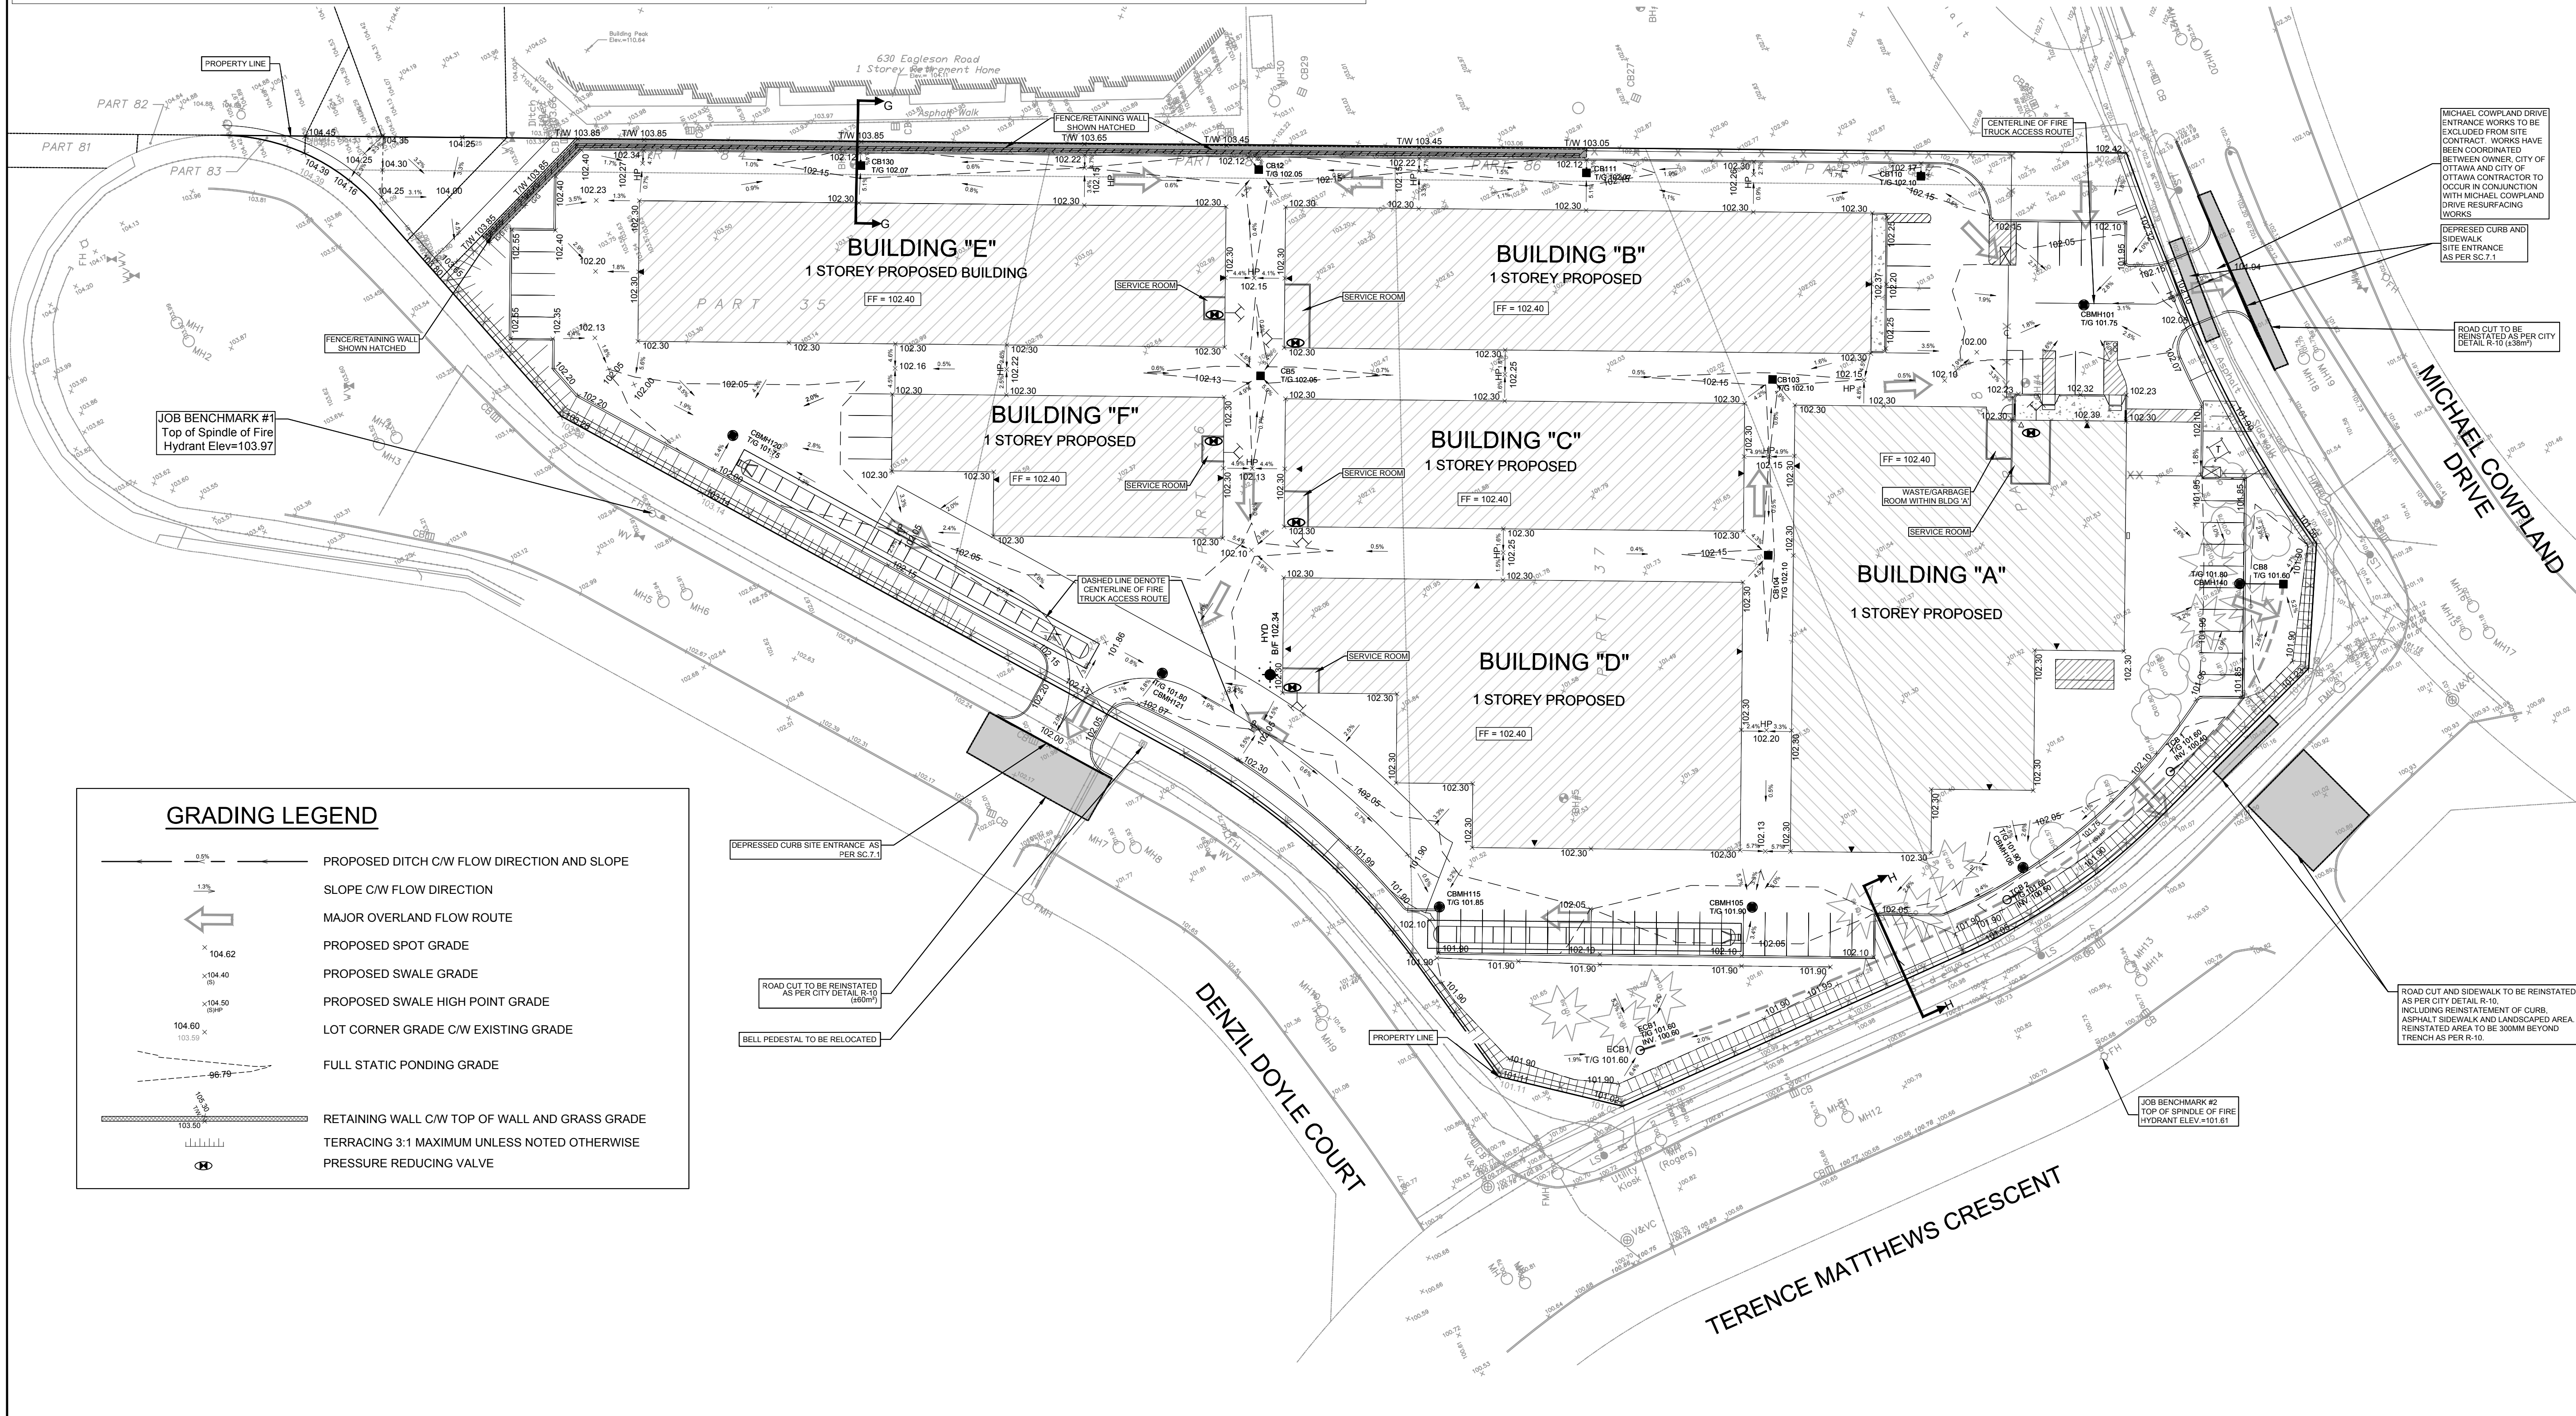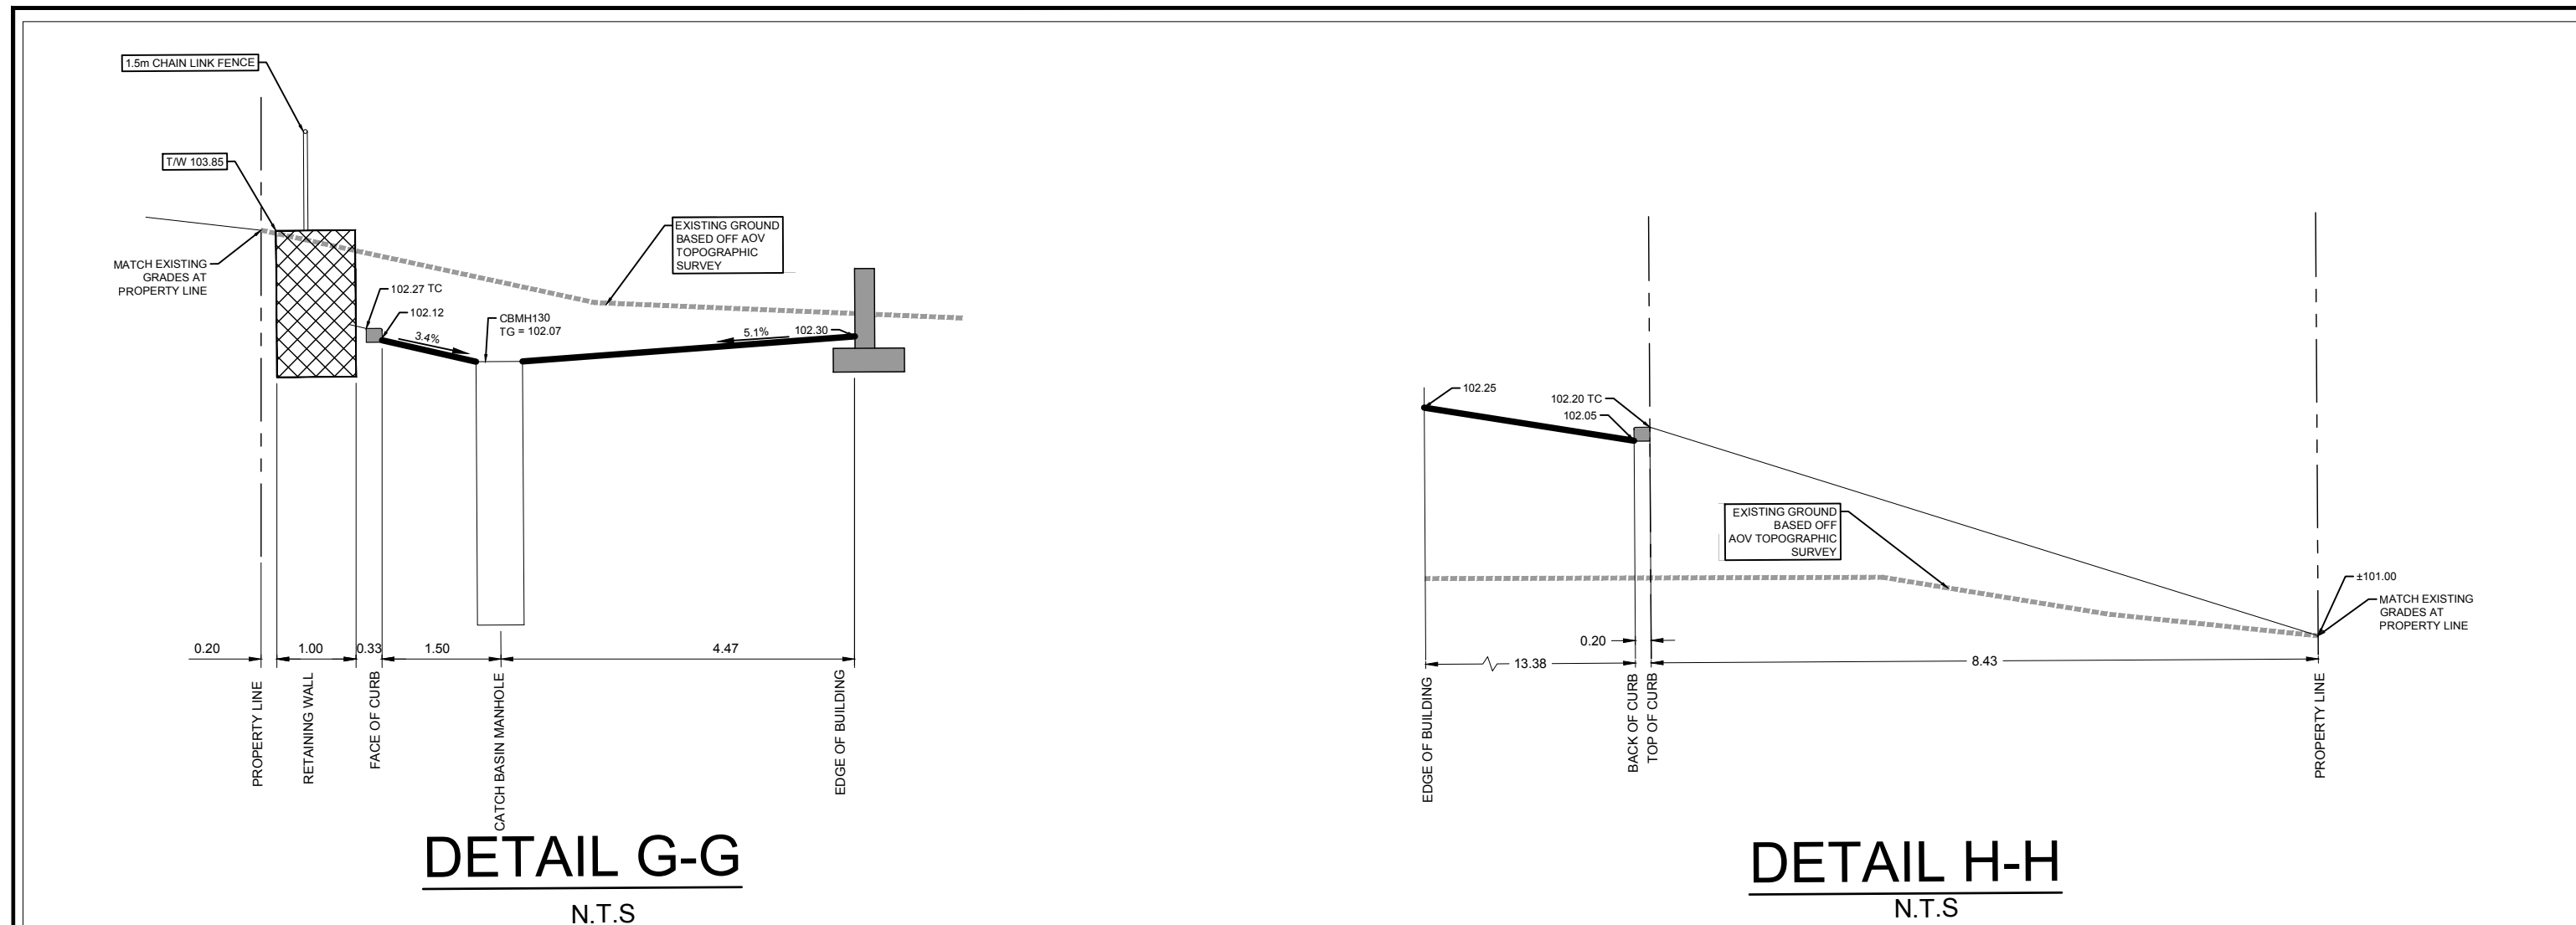

CLIENT
HUNTINGTON PROPERTIES
Huntington PROPERTIES

COPYRIGHT
This drawing has been prepared solely for the intended use, any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. When dimensions shall have precedence over scaled dimensions, Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general concurrence before proceeding with fabrication.
IBI Group Professional Services (Canada) Inc.
is a member of the IBI Group of companies.

ISSUES

No.	DESCRIPTION	DATE
1	ISSUED FOR CITY REVIEW	2023-12-09
2	REVISED PER CITY COMMENTS	2023-03-09
3	REVISED PER CITY COMMENTS	2023-07-07
4	REVISED PER CITY COMMENTS	2023-07-19
5	REVISED PER CITY COMMENTS	2023-09-22
6	REVISED PER CITY COMMENTS	2023-11-13
7	REVISED PER CITY COMMENTS	2023-12-20

SEE 010, 011, 012 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

KEY PLAN

CONSULTANTS

Project Coordinator:
Huntington Properties
Architect:
A49 Architecture
Landscape:
Fotem
Mechanical & Electrical:
Goodkew, Weedmark & Associates Limited
Surveyor:
Annis O'Sullivan Vollebakk Ltd.
Geotech:
Paterson Group

SEAL

IBI GROUP
Suite 400 - 333 Preston Street
Ottawa ON K1S 5N4 Canada
Tel: 613 225 1311 / 613 241 3300 Fax: 613 225 9868
ibigroup.com

PROJECT
PROPOSED SELF STORAGE DEVELOPMENT
75 MICHAEL COWPLAND

PROJECT NO:
135470


DRAWN BY: S.L. / D.D. **CHECKED BY:** T.R.B.

PROJECT MGR: R.M. **APPROVED BY:** T.R.B.


SHEET TITLE
GRADING PLAN

SHEET NUMBER C-200 **ISSUE** 6


File Location: \\135470_Production\IBI_Design\04_Civil\Sheet\C-200_GRADING PLAN.dwg Last Saved: December 19, 2023, by ehennic
Photo: Wednesday, December 20, 2023 2:18:55 PM by Eric Henne
CITY PLAN NO. 18885
CITY FILE NO. D07-12-22-0174

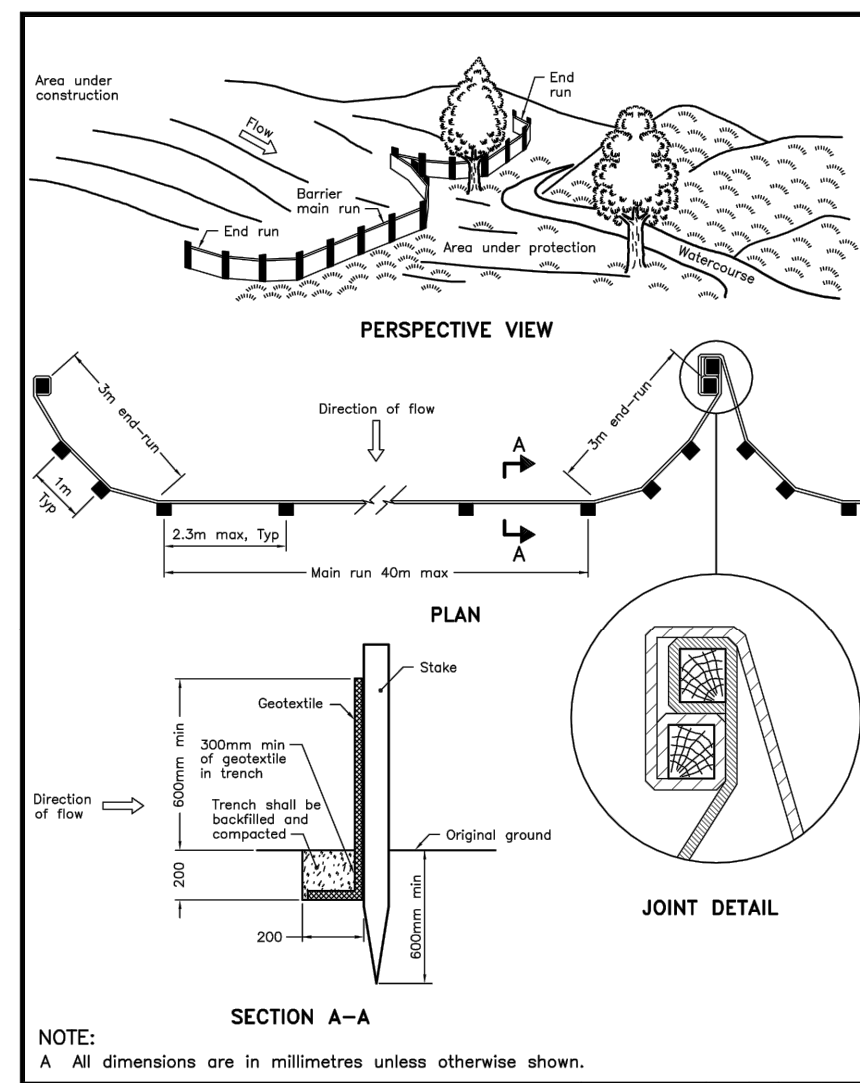

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
LIGHT-DUTY SILT FENCE BARRIER
 OPSD 219.110

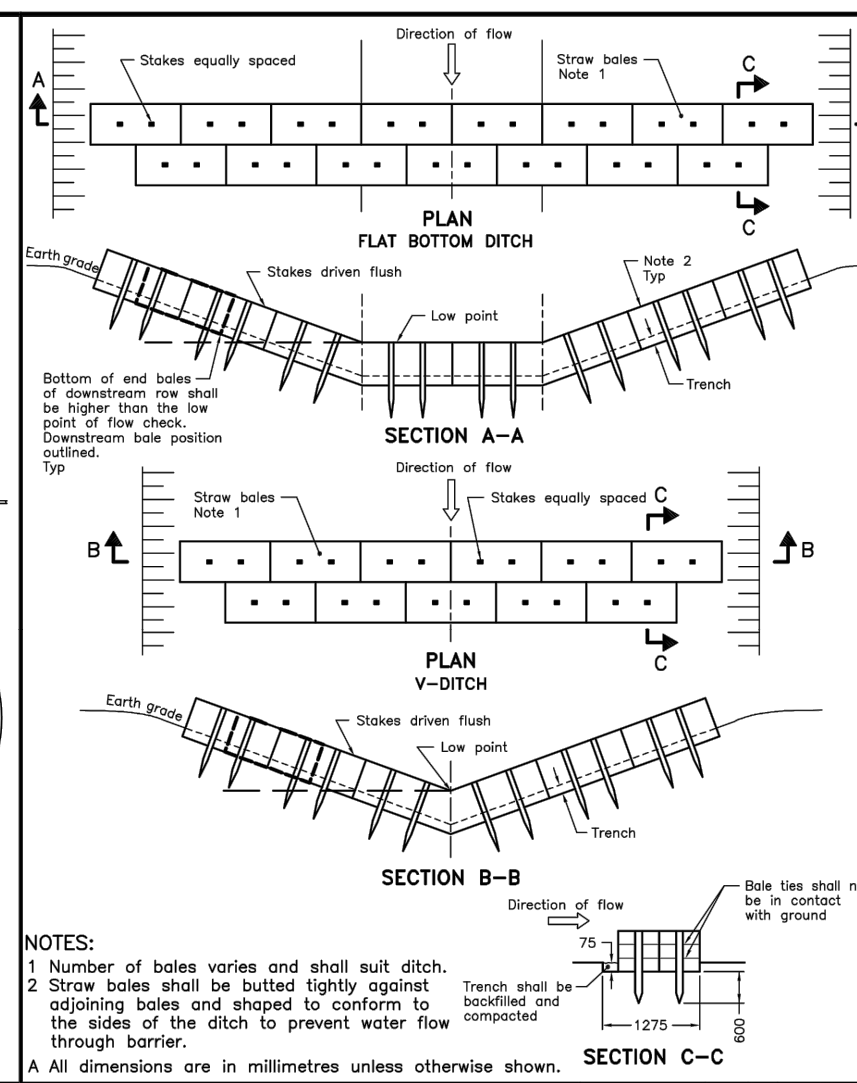

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
STRAW BALE FLOW CHECK DAM
 OPSD 219.180

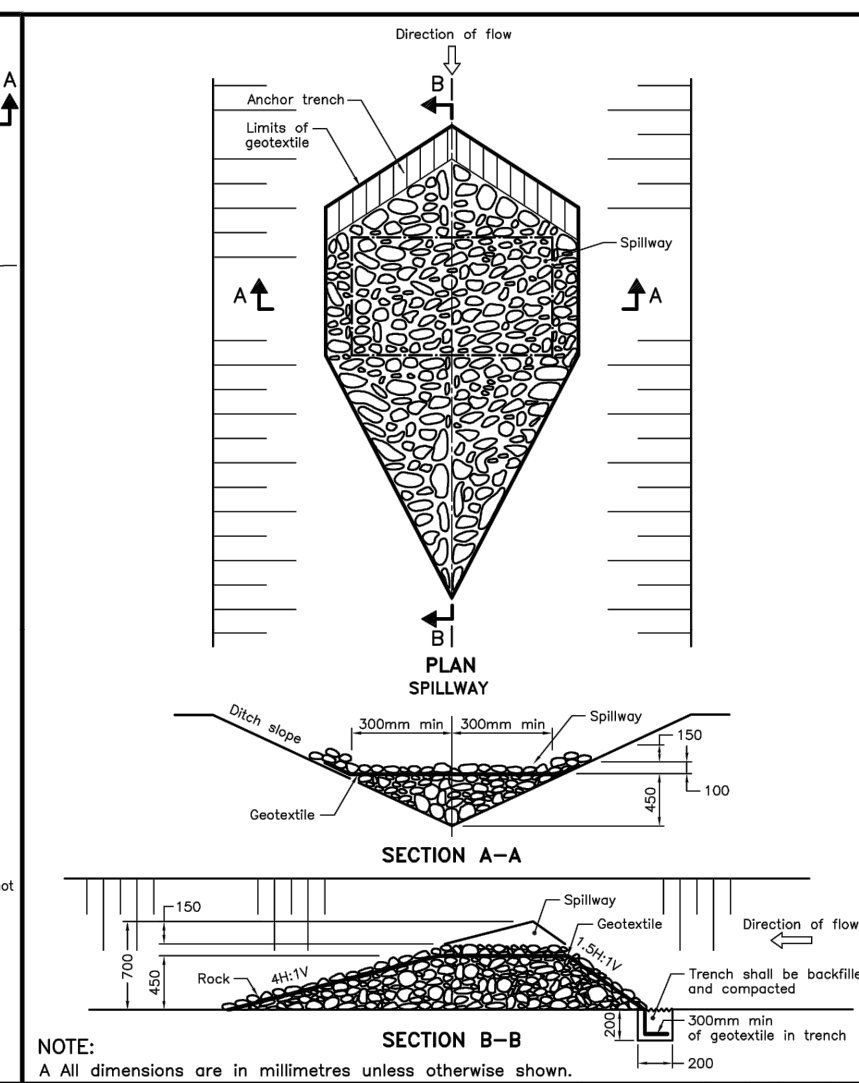


ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
TEMPORARY ROCK FLOW CHECK DAM V-DITCH
 OPSD 219.210

NOTES:

- THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- SILT FENCE TO BE ERECTED PRIOR TO EARTH WORKS BEING COMMENCED. SILT FENCE TO BE MAINTAINED UNTIL VEGETATION IS ESTABLISHED OR UNTIL START OF SUBSEQUENT PHASE.
 - STRAW BALE SEDIMENT TRAPS TO BE CONSTRUCTED IN EXISTING ROAD SIDE DITCHES. TRAPS TO REMAIN AND BE MAINTAINED UNTIL VEGETATION IS ESTABLISHED.
 - SILT SACK TO BE PLACED AND MAINTAINED UNDER COVER OF ALL CATCHBASINS. GEOTEXTILE SILT SACK IN STREET CBS TO REMAIN UNTIL ALL CURBS ARE CONSTRUCTED. GEOTEXTILE FABRIC IN RYCBs TO REMAIN UNTIL VEGETATION IS ESTABLISHED. ALL CATCHBASINS TO BE REGULARLY INSPECTED AND CLEANED, AS NECESSARY, UNTIL SOD AND CURBS ARE CONSTRUCTED.
 - CONTRACTOR TO PROVIDE DETAILS ON LOCATION(S) AND DESIGN OF DEWATERING TRAP(S) PRIOR TO COMMENCING WORK. CONTRACTOR ALSO RESPONSIBLE FOR MAINTAINING TRAP(S) AND ADJUSTING SIZE(S) IF DEEMED REQUIRED BY THE ENGINEER DURING CONSTRUCTION.
 - CONTRACTOR TO PROTECT EXISTING CATCHBASINS WITH FILTER CLOTH UNDER THE COVERS TO TRAP SEDIMENTATION. REFER TO IDENTIFIED STRUCTURES.
 - WORKS NOTED ABOVE ARE TO BE INSTALLED, INSPECTED, MAINTAINED AND ULTIMATELY REMOVED BY SERVICING CONTRACTOR.
 - THIS IS A "LIVING DOCUMENT" AND MAY BE MODIFIED IN THE EVENT THE PROPOSED CONTROL MEASURES ARE INSUFFICIENT

LEGEND :

- LIGHT DUTY SILT FENCE AS PER OPSD-219.110
- SNOW FENCE
- STRAW BALE CHECK DAM AS PER OPSD-219.180
- ROCK CHECK DAM AS PER OPSD-219.210
- SILT SACK PLACED UNDER EXISTING CB COVER
- TEMPORARY MUD MAT 0.15m THICK 50mm CLEAR STONE ON NON WOVEN FILTER CLOTH



CLIENT
HUNTINGTON PROPERTIES


COPYRIGHT
 This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general confirmation before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
 is a member of the IBI Group of companies.

ISSUES

No.	DESCRIPTION	DATE
1	ISSUED FOR CITY REVIEW	2023-12-09
2	REVISED PER CITY COMMENTS	2023-03-09
3	REVISED PER CITY COMMENTS	2023-07-07
4	REVISED PER CITY COMMENTS	2023-07-19
5	REVISED PER CITY COMMENTS	2023-09-22
6	REVISED PER CITY COMMENTS	2023-11-13
7	REVISED PER CITY COMMENTS	2023-12-20

SEE 010, 011, 012 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

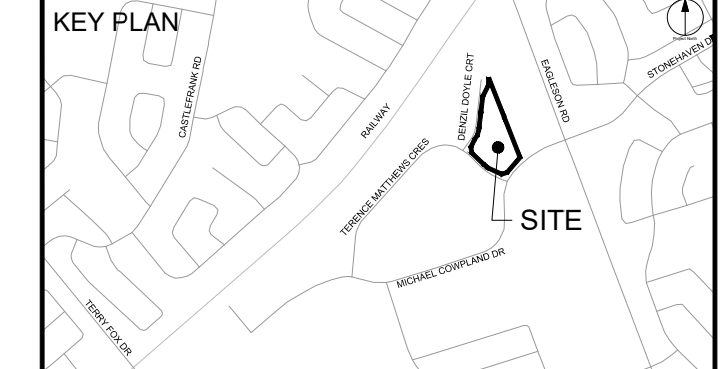

LEGEND

Project Coordinator:
 Huntington Properties

Architect:
 A49 Architecture


Landscaper:
 Fofem

Mechanical & Electrical:
 Goodkey, Weedmark & Associates Limited

Surveyor:
 Annis O'Sullivan Vollebakk Ltd.

Geotech:
 Paterson Group

SEAL

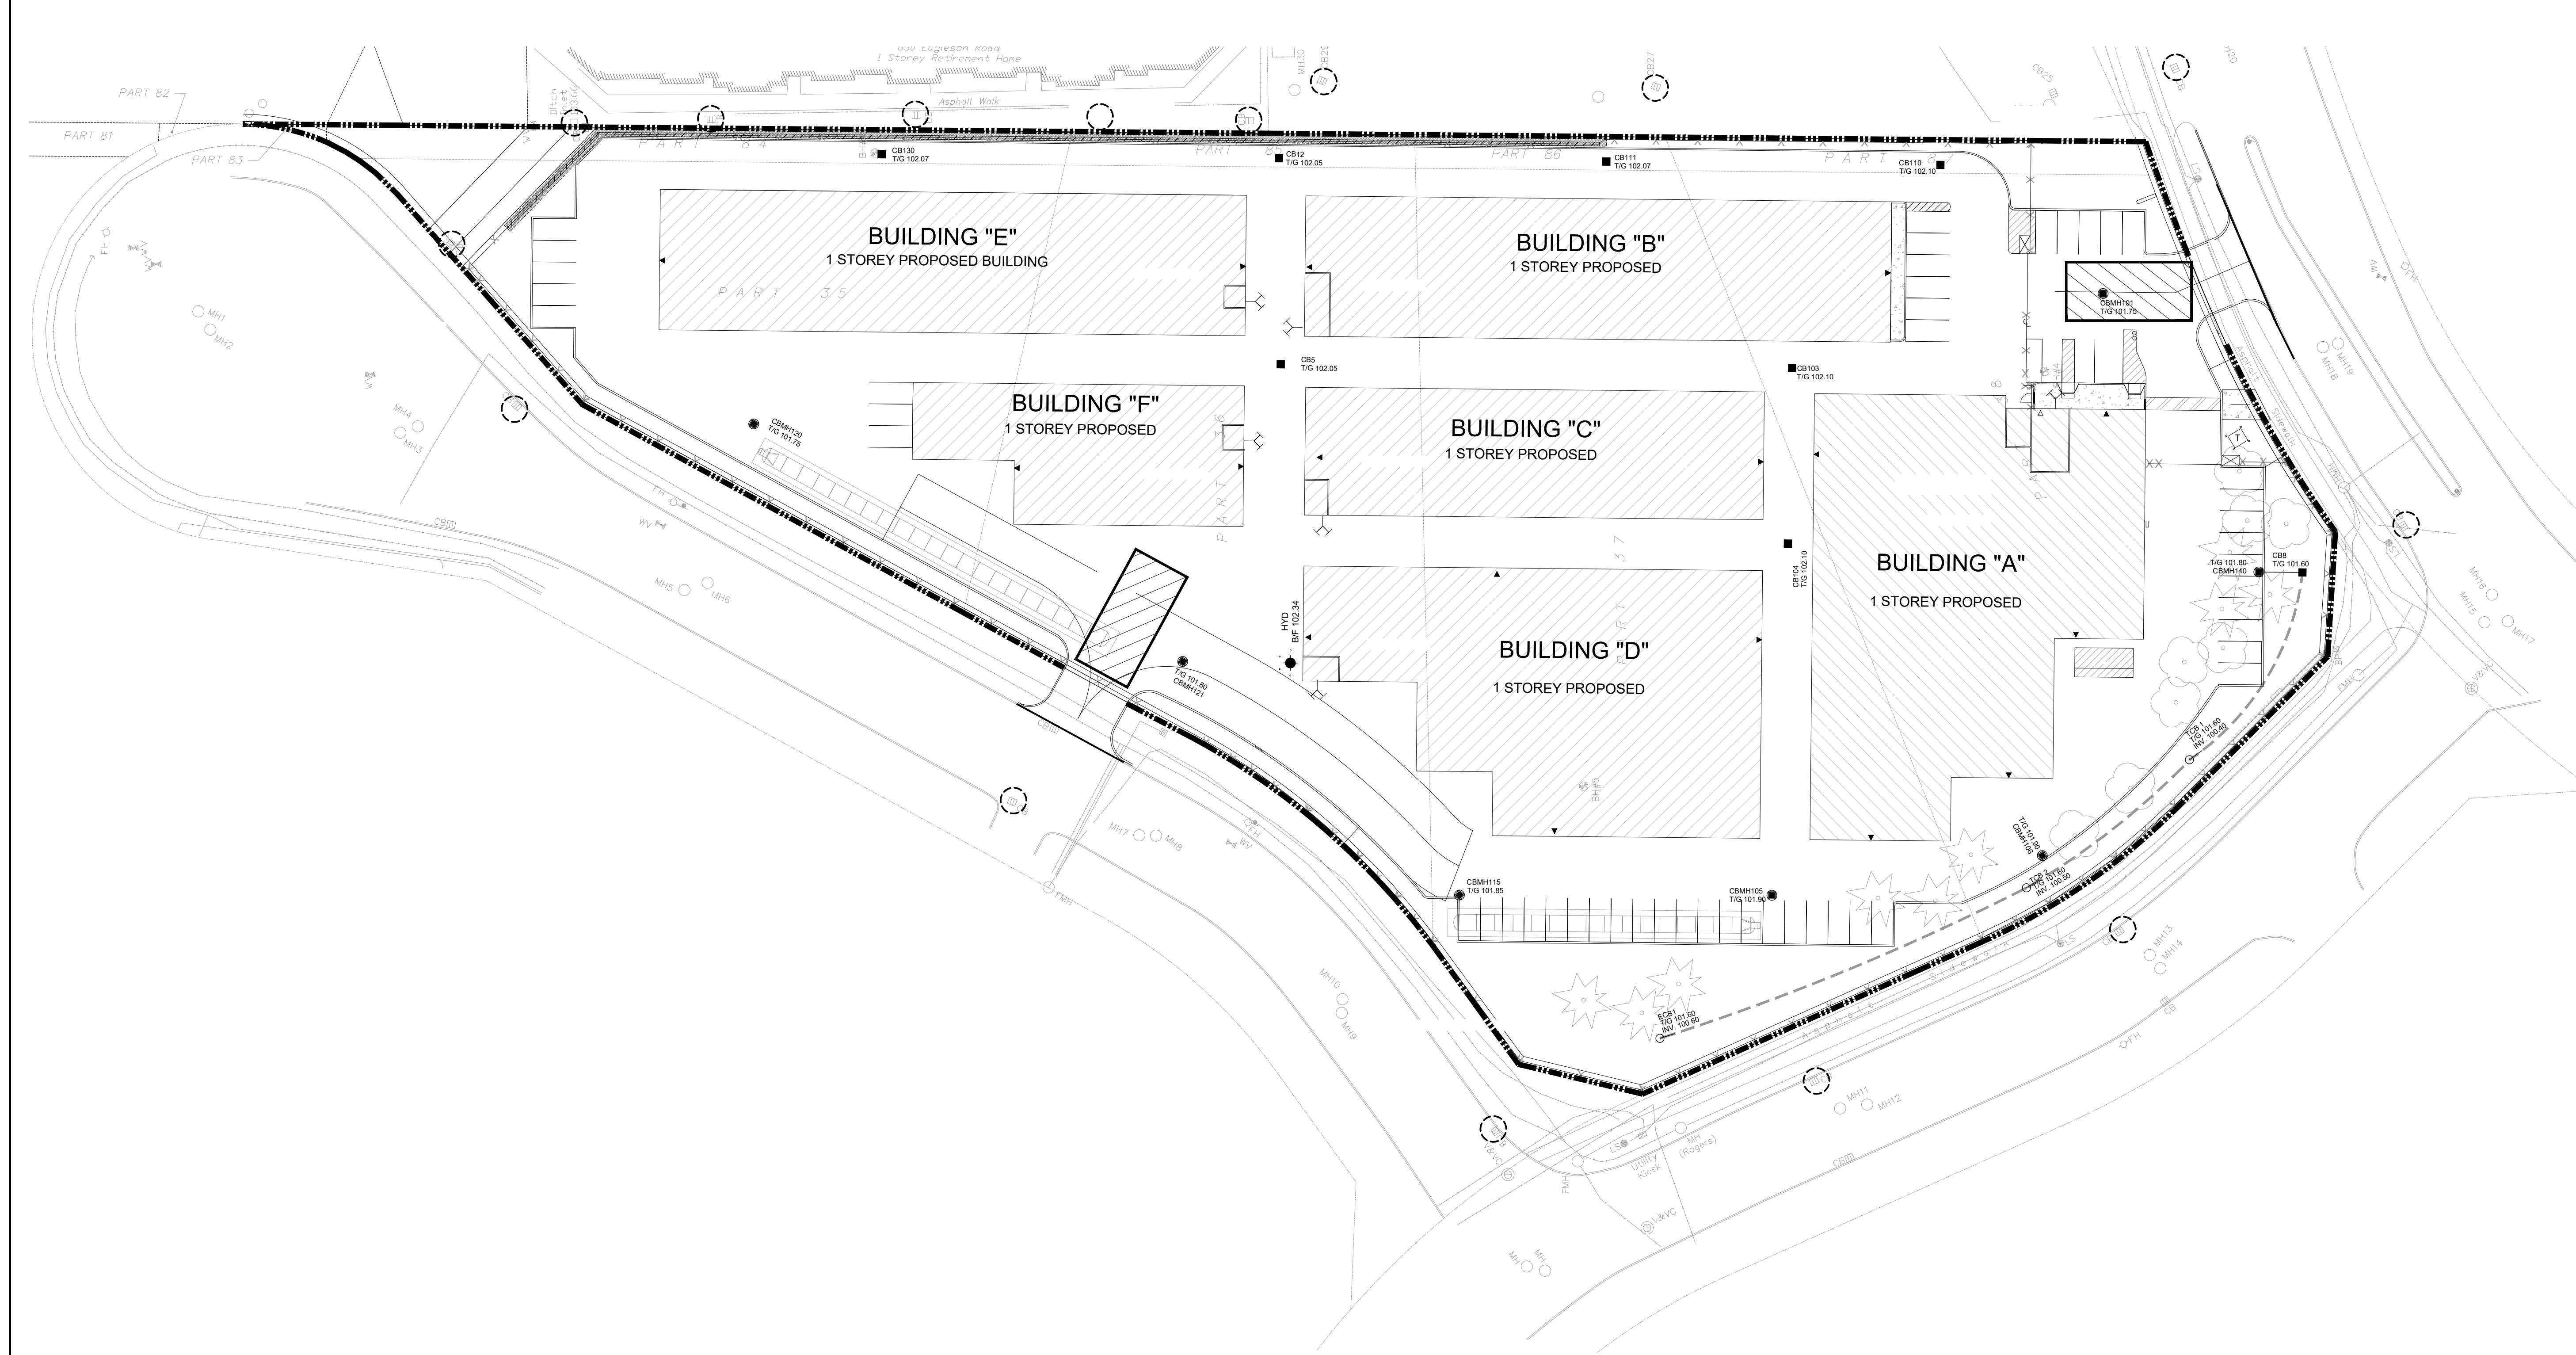

IBI GROUP
 Suite 400 - 333 Preston Street
 Ottawa, ON K1S 5N4 Canada
 Tel: 613 225 1311 / 613 241 3300 Fax: 613 225 9868
 ibigroup.com

PROJECT
PROPOSED SELF STORAGE DEVELOPMENT
 75 MICHAEL COWPLAND

PROJECT NO:
 135470

DRAWN BY:
 S.L. / D.D.

PROJECT MGR:
 R.M.

CHECKED BY:
 T.R.B.

APPROVED BY:
 T.R.B.

SHEET TITLE
SEDIMENT - EROSION PLAN

SHEET NUMBER
C-900

ISSUE
6

CITY PLAN NO. 18885
 CITY FILE NO. D07-12-22-0174
 EROSION PLAN
 W. ZHUANG
 100231427
 2023/12/20
 PROVINCE OF ONTARIO
 LAST SAVED: SEPTEMBER 20, 2023, BY: EHERNE
 PLOTTED: WEDNESDAY, DECEMBER 20, 2023 12:05:25 PM BY: ERIC HENNE