


- LEGEND**
- PROPOSED ELEVATION
 - EXISTING ELEVATION
 - F.F. PROPOSED TOP OF MAIN FLOOR ELEVATION
 - T.O.F. PROPOSED TOP OF CONCRETE FOUNDATION ELEVATION
 - U.S.F. PROPOSED UNDERSIDE OF CONCRETE FOOTING ELEVATION
 - D/W PROPOSED DRIVEWAY
 - EXISTING COMBINED SEWER
 - EXISTING WATERMAIN
 - PROPOSED 150mm PVC SANITARY LATERAL SERVICE @ 1% (MIN.) SLOPE
 - PROPOSED 150mm PVC STORM LATERAL SERVICE @ 1% (MIN.) SLOPE
 - PROPOSED 100mm WATER SERVICE (PVC CL 150 DR-18)
 - EXISTING COMBINED MANHOLE
 - EXISTING CATCH BASIN
 - EXISTING WATER VALVE
 - EXISTING FIRE HYDRANT
 - EXISTING UTILITY POLE
 - EXISTING OVERHEAD WIRES
 - PROPOSED VALVE AND VALVE BOX (V&VB)
 - PROPOSED GENERAL DIRECTION OF LOT GRADING
 - PROPOSED ROOF DOWNSPOUT LOCATION
 - PROPOSED ROOF SCUPPER LOCATION
 - PROPOSED HIGH RIDGE LINE
 - PROPOSED WEeping TILE SUMP PIT LOCATION
 - C/W DUPLEX SUMP PUMPS (REFER TO ARCHITECTURAL DRAWINGS FOR DETAILS)
 - PROPOSED SANITARY HOLDING TANK LOCATION
 - C/W DUPLEX SEWAGE PUMPS
 - PROPOSED CONCRETE BARRIER CURB LOCATION
 - PROPOSED TOP OF CONCRETE CURB ELEVATION
 - PROPOSED BOTTOM OF CONCRETE CURB ELEVATION
 - DENOTES LIMIT OF ROAD CUT AND REINSTATEMENT

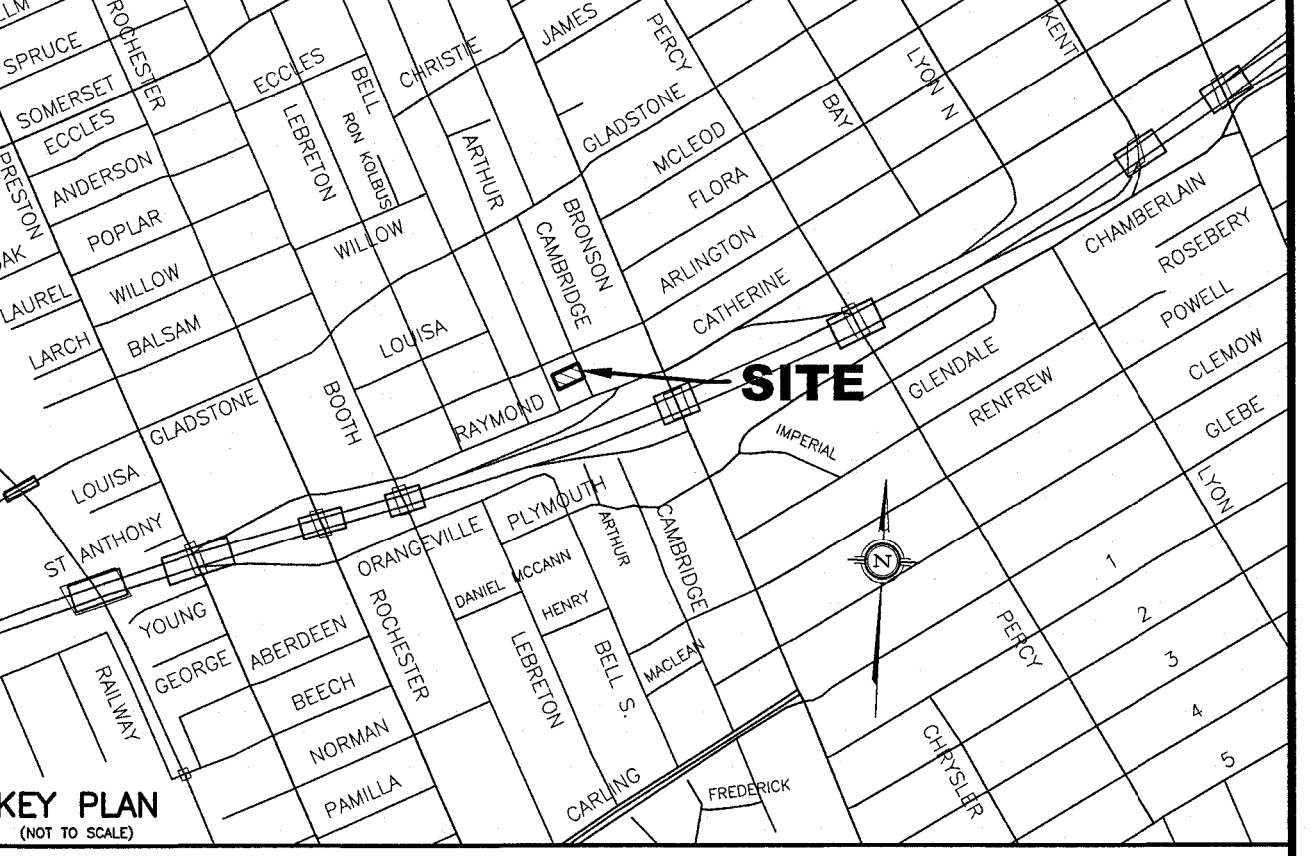



- NOTES**
- EXISTING SERVICES AND UTILITIES SHOWN ON THIS DRAWING WERE TAKEN FROM THE BEST AVAILABLE RECORDS BUT ARE NOT COMPLETE. CONTRACTOR IS REQUESTED TO CHECK IN THE FIELD FOR LOCATION AND ELEVATION OF PIPES, UNDERGROUND STRUCTURES, ETC. AND CHECK WITH AUTHORITIES AND UTILITIES TO HIS SATISFACTION BEFORE DIGGING.
 - CONTRACTOR IS ADVISED TO COLLECT INFORMATION ON SOIL CONDITIONS AS DEEMED NECESSARY. REFER ALSO TO THE SITE GEOTECHNICAL INVESTIGATION REPORT PREPARED BY THE OWNER'S GEOTECHNICAL CONSULTANTS KOLLAR ASSOCIATES - ENTITLED "GEOTECHNICAL INVESTIGATION 4-STORY RESIDENTIAL APARTMENT BUILDING" (PROJ. No. 220214 DATED APRIL 8, 2022).
 - EXISTING BUILDING AND STRUCTURE LOCATION, TOPOGRAPHICAL INFORMATION ON THIS DRAWING, GEODETIC SITE BENCHMARK, SEWER INVERT, SERVICE LOCATION AND MANHOLE LOCATIONS, ETC. SHOWN ON THIS PLAN WERE PROVIDED BY ANNIS O'SULLIVAN VOLLEBEKK LTD. (JOB No. 21327-21 COMPLETED MARCH 25, 2021) AND RECEIVED ON APRIL 27, 2022. SANITARY AND STORM SEWER INVERT INFORMATION ALONG CAMBRIDGE STREET NORTH CAN ALSO BE REFERENCED FROM THE CITY'S PLAN AND PROFILE DRAWING ENTITLED "CAMBRIDGE STREET - RAYMOND STREET TO STA. 130.00 PLAN No. 3335 SHEET 3 OF 24 DATED JANUARY, 2003 PREPARED BY THE CITY OF OTTAWA. THE CONTRACTOR SHALL FIELD SURVEY AND VERIFY THIS INFORMATION TO HIS OR HER SATISFACTION PRIOR TO CONSTRUCTION. T.L. MAK ENGINEERING CONSULTANTS LTD. DOES NOT TAKE ANY RESPONSIBILITY FOR THE SURVEY INFORMATION SHOWN HERE. THE CONTRACTOR IS ADVISED TO OBTAIN AND REVIEW TO HIS SATISFACTION THIS SURVEY/TOPOGRAPHICAL PLAN PRIOR TO CONSTRUCTION.
 - SITE LAYOUT AND DETAILS FOR GRADING AND SWM DESIGN WERE PROVIDED BY THE OWNER'S BUILDING DESIGNER "MIRCO DESIGN INC." AS DETAILED ON THEIR SITE PLAN (DWG. No. S1.1 REV. No. 2 DATED JUNE 20, 2023) RECEIVED ON AUGUST 23, 2023 AND UPDATED ON NOVEMBER 28, 2023. PROPOSED ELEVATIONS PLAN (DWG. No. A1.2 DATED DECEMBER 2021) RECEIVED ON MAY 6, 2022 WAS USED TO ESTABLISH THE F.F., T.O.F., TOP OF BASEMENT SLAB AND U.S.F. ELEVATIONS. BUILDING ELEVATION WERE UPDATED PER ELEVATION DESIGNER'S E-MAIL OF JULY 13, 2022 AND AUGUST 8, 2022.
 - ALL GRADES SHOWN ARE GEODETIC AND METRIC (SEE ANNIS O'SULLIVAN VOLLEBEKK LTD'S TOPOGRAPHICAL PLAN).
 - PIPE SIZES SHOWN ON THIS PLAN ARE METRIC.
 - THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NECESSARY EQUIPMENT, LABOUR AND MATERIALS RELATING TO ALL CIVIL WORKS REQUIRED FOR THIS SITE AND BY THE CITY OF OTTAWA TO CONNECT INTO THE WATERMAIN.
 - ALL GRADING SHALL BE DONE TO THE SATISFACTION OF THE CITY OF OTTAWA.
 - CONNECTION OF THE 100mm WATER SERVICE TO THE EXISTING 200mm WATERMAIN ON CAMBRIDGE STREET NORTH SHALL BE BY THE CITY OF OTTAWA AND EXCAVATION, BACKFILLING AND REINSTATEMENT SHALL BE CARRIED OUT BY THE CONTRACTOR. ALL WATERWORKS TO BE CONSTRUCTED TO CITY OF OTTAWA WATER ENGINEERING STANDARDS AND SPECIFICATIONS.
 - CONSTRUCT ALL WATERMAIN, WATER SERVICES, SANITARY AND STORM SEWER SYSTEMS IN ACCORDANCE WITH CITY OF OTTAWA'S LATEST REVISED STANDARD OTHERWISE AS PER OPSS REQUIREMENT AND DONE TO THE SATISFACTION OF THE CITY.
 - BEDDING AND HAUNCHING MATERIAL FOR SEWER INSTALLATIONS TO BE GRANULAR "A" INSTALLED AND COMPACTED AS PER CITY STANDARD DETAIL DWG. No. S6 AND S7.
 - STORM AND SANITARY LATERALS (150mm) SHALL BE PVC DR-28 OR EQUIVALENT. SEWER CONNECTION DETAILS PER CITY DETAIL S11.1 FOR FLEXIBLE PIPES AND S11 FOR RIGID PIPES.
 - ALL WATER SERVICES/MAINS SHALL HAVE 2.4m COVER (MIN.). THE 100mm WATER SERVICE SHALL BE PVC CL 150 DR-18 WATER SERVICE AND UNDERSIDE OF CONCRETE FOOTING DETAILS AS PER CITY OF OTTAWA W17. THURST BLOCK DETAILS AS PER CITY DETAIL W25.3 DATED MAY 2001. FITTINGS SHALL CONFORM TO APPROVED AWWA AND/OR CSA STANDARDS. CATHODIC PROTECTION FOR NEW WATERMAIN AND SERVICE AS PER CITY DETAIL W40 REV. DATE MARCH 2005.
 - IF WATER SERVICE IS LESS THAN 1.0m FROM SEWER, MANHOLE OR CATCHBASIN, CONTRACTOR IS REQUESTED TO INSULATE BETWEEN THEM WITH S/M RIGID INSULATION (SEE CITY DETAIL DRAWING No. W23).
 - STORM MANAGEMENT NOTES
-REFER TO PROPOSED ROOFTOP STORMWATER MANAGEMENT PLAN (DWG. No. 821-155 SWM-1) FOR ROOF TOP 2 YEAR AND 100 YEAR HWL.
-SEE STORM DRAINAGE REPORT No. R-821-155 DATED JULY 2022 ALSO FOR DETAILS.
-CONTROLLED ROOF DRAIN (MAX) RELEASE FLOW RATE FOR EACH DRAIN SHALL BE 0.95 L/s OR 15.0 U.S. GAL/MIN. UNDER A HEADING OF 150mm.
 - ALL PROPOSED BUILDING SANITARY, STORM AND WATER SERVICES SHALL TERMINATE ±1.0m OUTSIDE THE FOUNDATION WALL AND CONNECTION TO PLUMBING BY OTHERS.
 - IT IS REQUIRED THAT A CITY APPROVED BACKWATER VALVE BE INSTALLED AT THE NEW 150mm DIA. (FOUNDATION DRAINS) STORM LATERAL SERVICE AND A FULL PORT BACKWATER VALVE BE INSTALLED FOR THE NEW SANITARY LATERAL SERVICE AS PER CITY DETAIL S14, S14.1, AND S14.2.
 - PRIOR TO CONCRETE FOOTING AND FOUNDATION POURING, THE OWNERS AND/OR CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT THE SUBGRADE ON THIS IS SUFFICIENT TO SUPPORT THE PROPOSED BUILDING.
 - FOR DEVELOPMENT OF THIS LOT, THE CONTRACTOR MUST FIRST CONSTRUCT THE UNDERGROUND SANITARY, STORM AND WATER SERVICES FROM THE SEWER AND WATERMAIN TO SERVICE THE ENTIRE PROPERTY, PRIOR TO BUILDING CONCRETE FOUNDATION POURING. THE CONTRACTOR SHALL VERIFY SEWER DEPTHS TO ENSURE THAT SEWER DEPTHS CAN ACHIEVE A SLOPE OF 1.0% (MIN.) AND STILL BE BELOW PROPOSED UNDERSIDE OF CONCRETE FOOTING ELEVATION. IF THIS IS FOUND NOT POSSIBLE, THE CONTRACTOR SHALL CONTACT THE OWNER TO REPORT THE FINDING IN ORDER TO ADJUST THE BUILDING FOUNDATION GRADES PRIOR TO CONCRETE POURING.
 - THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NECESSARY EQUIPMENT, LABOUR AND MATERIALS RELATING TO THE CIVIL WORKS REQUIRED FOR INSTALLATION OF NEW SITE SERVICES. PROVINCIAL HEALTH AND SAFETY REGULATIONS MUST BE FOLLOWED DURING CONSTRUCTION.
 - IT IS THE RESPONSIBILITY OF THE SITE SERVICES CONTRACTOR TO OBTAIN AND CONSTRUCT THE WORKS TO MEET THE LATEST REVISIONS IN CURRENT CIRCULATION OF THE CITY OF OTTAWA'S ENGINEERING STANDARDS, OPSS AND OPSD STANDARDS, AND ONTARIO BUILDING/PLUMBING CODES. WHERE THE LATEST REVISION DIFFERS FROM THE REQUIREMENTS SET OUT IN THIS PLAN, THE CONTRACTOR SHALL PRIOR TO THE WORKS TO MEET LATEST REVISION STANDARDS IN HIS PRICE BID FOR THIS PROJECT. THE CONTRACTOR SHALL INFORM THE ENGINEERS OF ANY CHANGES PRIOR TO COMMENCEMENT OF THE WORKS.
 - PROPOSED GROUND FLOOR, TOP OF CONCRETE FOUNDATION, TOP OF BASEMENT SLAB AND UNDERSIDE OF FOOTING ELEVATIONS SHALL BE REVIEWED AND APPROVED BY OWNER'S ARCHITECTS PRIOR TO CONSTRUCTION.
 - IF EXISTING GRADES ALONG ANY EXISTING ABUTTING PROPERTY LIMITS EXCEED THE PROPOSED GRADES ON THIS PROPERTY BY A HEIGHT DIFFERENTIAL THAT EXCEEDS TERRACING OF 3H TO 1V, THEN INSTALL A RETAINING WALL AS PER OWNER'S REQUIREMENTS.
 - SITE SERVING BEDDING, BACKFILL REQUIREMENTS ALONG WITH ROADWAY AND PARKING LOT PAVEMENT STRUCTURES SHALL MEET RECOMMENDATIONS AND REQUIREMENTS SET OUT IN THE OWNER'S SOILS ENGINEER'S REPORT. ALL WORKS TO BE CARRIED OUT BY THE CONTRACTOR ON THE PROPOSED ASPHALT ACCESS LANEWAY AND PRIVATE DRIVEWAY STRUCTURE SHALL BE APPROVED BY SOILS ENGINEER ON SITE PRIOR TO CONSTRUCTION.
 - CONCRETE BARRIER CURB AND DEPRESSED CURB DETAILS AS PER CITY OF OTTAWA STANDARDS (DWG. NO. SC1.1 AND SC1.4 MARCH 2007 AND S06, MARCH 2007). CONCRETE CURB AND CONCRETE SIDEWALK CONSTRUCTION AND REINSTATEMENT SHALL BE DONE TO THE SATISFACTION OF THE CITY OF OTTAWA AND IN ACCORDANCE WITH THE LATEST REVISED CITY ENGINEERING STANDARDS.

ANDREW MCCREIGHT
MANAGER, DEVELOPMENT REVIEW CENTRAL
PLANNING, DEVELOPMENT & BUILDING SERVICES
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA

APPROVED
By Andrew McCreight at 7:36 am, Jun 07, 2024

- CONCRETE SIDEWALK, DEPRESSED CURB, AND DEPRESSED CONCRETE SIDEWALK DETAILS AS PER CITY OF OTTAWA STANDARDS (DWG. NO. SC1 AND SC1.4 REV. DATE MARCH 2007, S04 REV. DATE MARCH 2007 AND SC7.1 REV. DATE MARCH 2007). CONCRETE CURB AND SIDEWALK CONSTRUCTION AND REINSTATEMENT SHALL BE DONE TO THE SATISFACTION OF THE CITY OF OTTAWA AND IN ACCORDANCE WITH THE LATEST REVISED CITY ENGINEERING STANDARDS.
- THE EXISTING CONCRETE CURB AND SIDEWALK ON CAMBRIDGE STREET NORTH IF DAMAGED BY THE CONTRACTOR DURING CONSTRUCTION SHALL BE REINSTATEMENT BY THE CONTRACTOR TO THE SATISFACTION OF THE CITY OF OTTAWA AND IN ACCORDANCE WITH THE LATEST REVISED CITY ENGINEERING STANDARDS.
- THE CONTRACTOR, UPON COMPLETION OF THE NEW DRIVEWAY, SHALL RESTORE THE EXISTING CAMBRIDGE STREET NORTH ROADWAY BULEVARD DISTURBED BY CONSTRUCTION WORKS ON THIS PROPERTY. ADDITIONALLY, THE ROADWAY GRADING SHALL BE RESTORED AND REGRADED TO DRAIN POSITIVELY TO EXISTING STORMWATER OUTLET AS REQUIRED BY THE CITY INSPECTOR.
- WHERE FROST COVER FROM UNDERSIDE OF BUILDING CONCRETE FOOTING TO PROPOSED FINISHED GROUND ELEVATION IS LESS THAN 1.55m, IT IS RECOMMENDED THAT INSULATION (50mm THICK) MINIMUM BE INSTALLED AT THE BUILDING FOOTING AND FOUNDATION TO PROVIDE SUFFICIENT FROST COVER FOR THE FOUNDATION STRUCTURES. THE FOOTINGS WILL NEED TO BE REVIEWED FOR INSULATION BY THE OWNER'S SOILS ENGINEER. EXACT INSULATION REQUIREMENTS SHALL BE AS PER ARCHITECT'S INSULATION DETAILS AS SHOWN ON THEIR ARCHITECTURAL DRAWINGS AND CONFIRMED BY THE OWNER'S SITE SOILS ENGINEER.
- INSULATE THE PROPOSED HOUSE SERVICE LATERALS ON PRIVATE PROPERTY FROM PROPERTY LINE TO THE HOUSE AND WITHIN THE ROAD RIGHT OF WAY WITH RIGID STYROFOAM INSULATION (50mm THICK MINIMUM) AND ANY OTHER LOCATION WHERE GROUND COVER IS LESS THAN 2.4m FOR WATER, STORM, AND SANITARY SERVICES. INSULATION THICKNESS AND WIDTH REQUIREMENTS SHALL BE AS PER CITY'S ENGINEERING STANDARDS AND PER REQUIREMENTS OF THE CITY OF OTTAWA AND OWNER'S SOILS ENGINEER.
- EXISTING LATERALS AND WATER SERVICE PIPING HAVE BEEN AND/OR SHALL BE ABANDONED. THE WATER SERVICE SHALL BE BLANKED AND CAPPED AT THE MAIN AS PER CITY'S REQUIREMENTS. THE SEWER LATERAL(S) SHALL BE CAPPED AND/OR PLUGGED AT THE FRONT PROPERTY LINE. ALL WATER AND SEWER LATERAL WORKS SHALL BE CARRIED OUT TO THE CITY'S SATISFACTION.
- ANY TREES AND UTILITY PLANT PROPOSED BY THE OWNER'S ARCHITECT SHALL MAINTAIN A 2.0m (MIN.) CLEARANCE TO THE PROPOSED WATER SERVICE AND BUILDING LATERAL TRENCH.
- a) THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE FOR PROTECTION OF THE RECEIVING STORM SEWER DURING CONSTRUCTION ACTIVITIES. THESE PRACTICES ARE REQUIRED TO ENSURE NO SEDIMENT AND/OR ASSOCIATED POLLUTANTS ARE RELEASED TO THE RECEIVING WATERCOURSE. THESE PRACTICES INCLUDE INSTALLATION OF SEDIMENT BARRIERS ON ALL CATCH BASIN AND MAINTENANCE HOLES AND A SILT FENCE BARRIER (AS PER OPSD 219.10 AND ASSOCIATED SPECIFICATIONS) ALONG THE PROPERTY LIMITS OF THE PROPOSED DEVELOPMENT AND ALL OTHER AREAS THAT SHEET DRAIN OFF SITE. MAINTENANCE HOLES SEDIMENT BARRIERS TO BE AMCO 4555 NONWOVEN GEOTEXTILE OR APPROVED EQUIVALENT.
- b) THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE. DURING CONSTRUCTION ACTIVITIES, THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
- NO EXCESS DRAINAGE, DURING AND AFTER CONSTRUCTION, WILL BE DIRECTED TOWARDS THE NEIGHBORS' PROPERTIES.
- ALL TREES ON THE RIGHT-OF-WAY ARE TO BE MAINTAINED BEFORE AND AFTER CONSTRUCTION AND ALL TREES WITHIN THE PROPERTY SHALL BE PROTECTED AS PER THE "MUNICIPAL TREES AND NATURAL AREAS PROTECTION BY-LAWS" AND THE "URBAN TREES CONSERVATION BY-LAW" AS AMENDED FROM TIME TO TIME.
- THERE WILL BE NO ALTERATION TO THE EXISTING GRADE AND DRAINAGE PATTERN ON THE PROPERTY LINES.
- THE CITY OF OTTAWA RECOMMENDS THAT A PRESSURIZED DRAIN PIPE TYPE MATERIAL BE USED FOR THE ROOF DRAIN LEADER PIPE IN THE BUILDING IN THE EVENT OF SURCHARGE IN THE SYSTEM.
- 300mm MINIMUM SEPARATION BETWEEN EXISTING WATERMAIN AND PROPOSED SEWER LATERALS AS PER CITY STANDARDS. IF 300mm MINIMUM SEPARATION CANNOT BE MET, UNSHINKABLE FILL SHALL BE USED.
- a) GIVEN THE ARCHITECTURAL REQUIREMENTS FOR THE PROPOSED APARTMENT BUILDING, THE LOWER BASEMENT SLAB AND UNDERSIDE OF CONCRETE FOOTING IS BELOW THE PROPOSED SANITARY LATERAL INVERT WHICH OUTLET TO THE CAMBRIDGE STREET NORTH COMBINED SEWER. THE OWNER'S ARCHITECT IS AWARE OF THIS CONSTRAINT. THE BUILDER AND HIS ARCHITECT WILL MAKE INTERNAL HOUSE PUMPING PROVISIONS TO PUMP SANITARY BASEMENT SEWAGE UP TO THE SANITARY LATERAL FROM A SANITARY SEWAGE PUMPING SYSTEM FOR THE BUILDING. SEE LATEST REVISED ARCHITECTURAL PLANS FOR DISCHARGE PIPE HEIGHT DETAILS, SEWAGE PUMP/TANK SIZE, AND PUMPING SYSTEM FOR THIS BUILDING. IT IS RECOMMENDED THAT THE SANITARY SEWAGE TANK BE OVERSIZED. A DUPLEX PUMPING SYSTEM SHALL BE IN THE SANITARY TANK.
- b) THE ARCHITECT AND OWNER'S/DEVELOPER'S MECHANICAL ENGINEER SHALL ENSURE THAT SANITARY SEWAGE FLOW FROM FLOOR LEVELS ABOVE THE BASEMENT LEVEL OF BOTH BUILDINGS SHALL BE DIRECTED AND OULETTED TO THE PROPOSED GRAVITY FLOW SANITARY LATERAL PIPE AND NOT INTO THE BASEMENT SEWAGE TANK FOR PUMPING.
- c) THE PROPOSED SANITARY SEWAGE TANK AND PUMPING SYSTEM ARE FOR DRAINAGE OF BASEMENT FIXTURES AND FLOOR DRAINS AS PER ARCHITECT'S DRAWINGS IN ACCORDANCE WITH THE LATEST REVISED ONTARIO BUILDING CODE.
- HOUSE WEeping TILE DRAINAGE FOR THE PROPOSED LOWER BASEMENT SLAB AND UNDERSIDE OF FOOTING SHALL BE SUMP-PUMPED VIA DOWNSTREAM FROM SHOWN ON THIS PLAN. THE SUMP SHALL BE 150mm DIA. PVC STORM LATERAL THAT OUTLETS TO THE CITY COMBINED SEWER AT CAMBRIDGE STREET NORTH. ALL WORKS SHALL BE CARRIED OUT TO CITY'S REQUIREMENTS AND IN COMPLIANCE WITH LATEST REVISED ENGINEERING STANDARDS.
- THE OWNER'S HOUSE DESIGNER SHALL INFORM THE OWNERS THAT AN ONGOING YEAR ROUND MAINTENANCE PROGRAM IS REQUIRED FOR THIS BUILDING TO ENSURE THAT WEeping TILE AND SEWAGE TANKS BE ANNUALLY INSPECTED AND CLEANED IF NECESSARY. ALL PUMPS USED IN THIS BUILDING ARE TO BE DETERMINED BY THE OWNER'S MECHANICAL ENGINEER AND/OR PLUMBER BASED ON THEIR SPECIFIC USAGE UNDER THE PRESENT PLUMBING CODE AND CITY REQUIREMENTS.
- THE HOUSE DESIGNER SHALL INFORM THE OWNERS TO HAVE AVAILABLE AT ALL TIMES A BACKUP GENERATOR ON STANDBY AT THE BUILDING IN THE EVENT OF A POWER BLACKOUT OR OTHER EMERGENCIES.

NO.	REVISION	DATE	BY
6	REVISIONS AS PER HOUSE DESIGNER'S LATEST REVISED SITE PLAN PROVIDED ON NOVEMBER 23, 2023 AND PER CITY'S REVIEW COMMENTS OF NOVEMBER 27, 2023	12/01/23	TLM
5	REVISIONS AS PER CITY'S REVIEW COMMENTS OF NOVEMBER 23, 2023	11/24/23	TLM
4	REVISIONS AS PER HOUSE DESIGNER'S COMMENTS OF SEPTEMBER 21, 2023	09/28/23	TLM
3	REVISIONS AS PER HOUSE DESIGNER'S LATEST REVISED SITE PLAN OF AUG. 23, 2023 AND HOUSE DESIGNER'S COMMENTS OF SEPT. 2023	09/12/23	TLM
2	REVISIONS AS PER HOUSE DESIGNER'S LATEST REVISED SITE PLAN AND LANDSCAPE PLAN PROVIDED ON DECEMBER 6, 2022	12/06/22	TLM
1	REVISIONS AS PER HOUSE DESIGNER'S LATEST REVISED SITE PLAN OF AUGUST 8, 2022	08/08/22	TLM

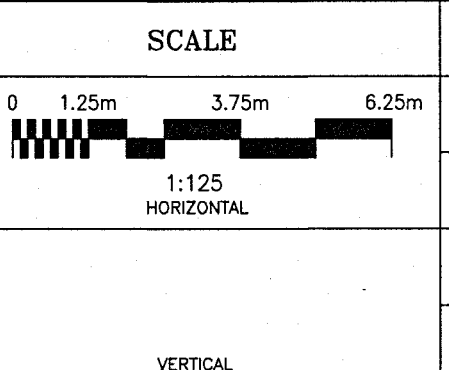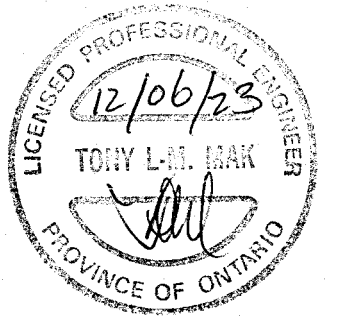

DESIGN	T.L.M.
CHECKED	T.L.M.
DRAWN BY	P.M.
CHECKED	T.L.M.
APPROVED	T.L.M.

PROJECT	370 CAMBRIDGE STREET NORTH LOT 15 WEST CAMBRIDGE STREET NORTH SOUTH OF STONE BOUNDARY REGISTERED PLAN 33 CITY OF OTTAWA
DRAWING TITLE	PROPOSED GRADING AND SERVICING PLAN

T.L. MAK ENGINEERING CONSULTANTS LTD. CONSULTING ENGINEERS			
PROJECT No.	DATE	DRAWING No.	
821-155	APRIL 2022	G-1	

D07-12-23-0036

#18957