


GROUNDWATER


LEVELS MAY


24/27-24

50mm CLEAR STONE

EXISTING GRADE

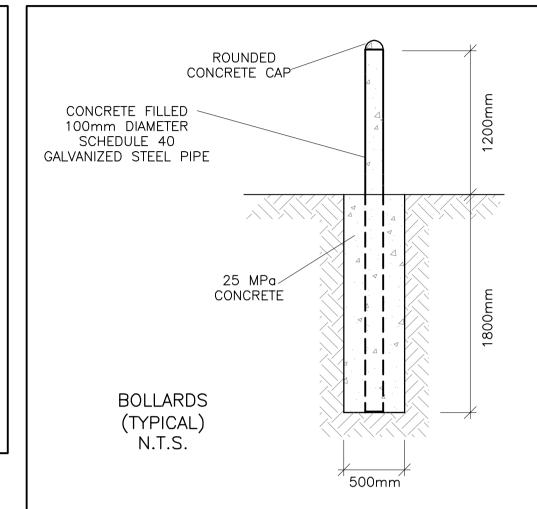

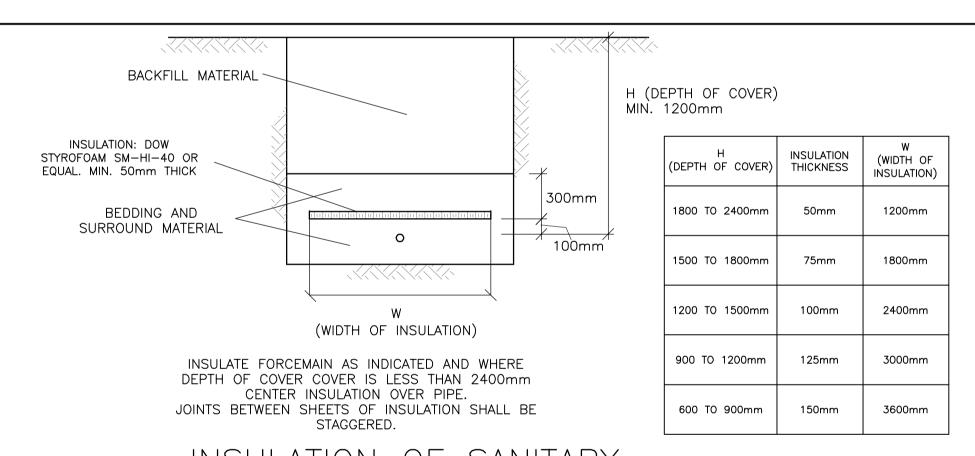


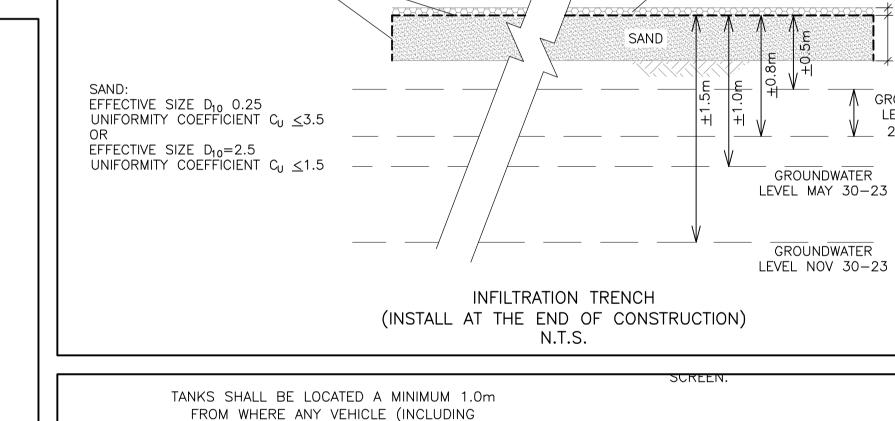

FIRE TRUCKS) CAN DRIVE


GEOTEXTILE FABRIC

OVERLAP 300mm

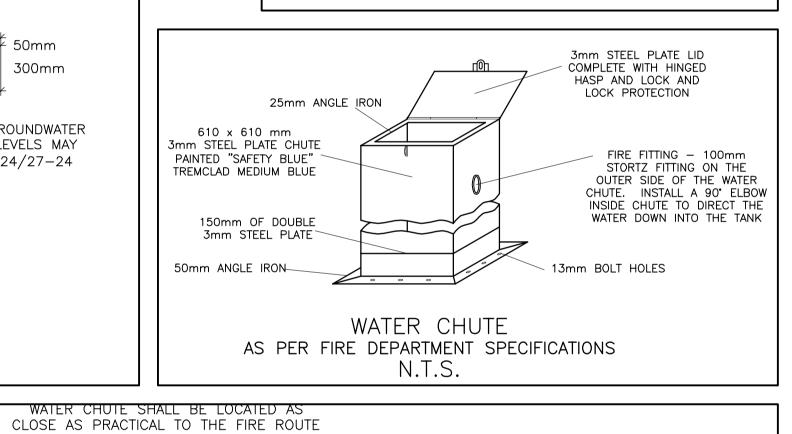

LOCATE HYDRANT SIGN



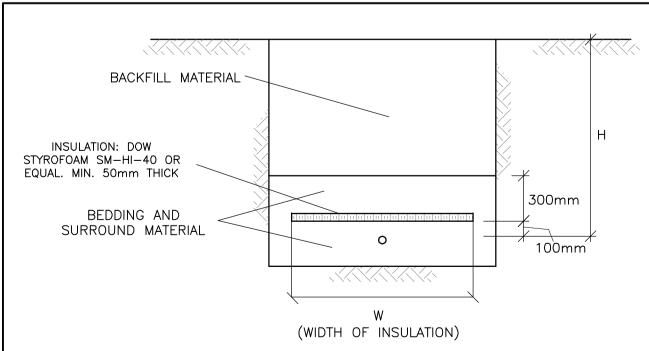


H (DEPTH OF COVER)	INSULATION THICKNESS	W (WIDTH OF INSULATION)
1800 TO 2400mm	50mm	1200mm
1500 TO 1800mm	75mm	1800mm
1200 TO 1500mm	100mm	2400mm


INSULATE SEWER AS INDICATED AND WHERE DEPTH OF COVER COVER IS LESS THAN 2400mm.

PROVIDE A MINIMUM 1200mm COVER. CENTER INSULATION OVER PIPE. JOINTS BETWEEN SHEETS OF INSULATION SHALL BE

INSULATION OF WELL WATER LINE SHALLOW TRENCHES N.T.S.

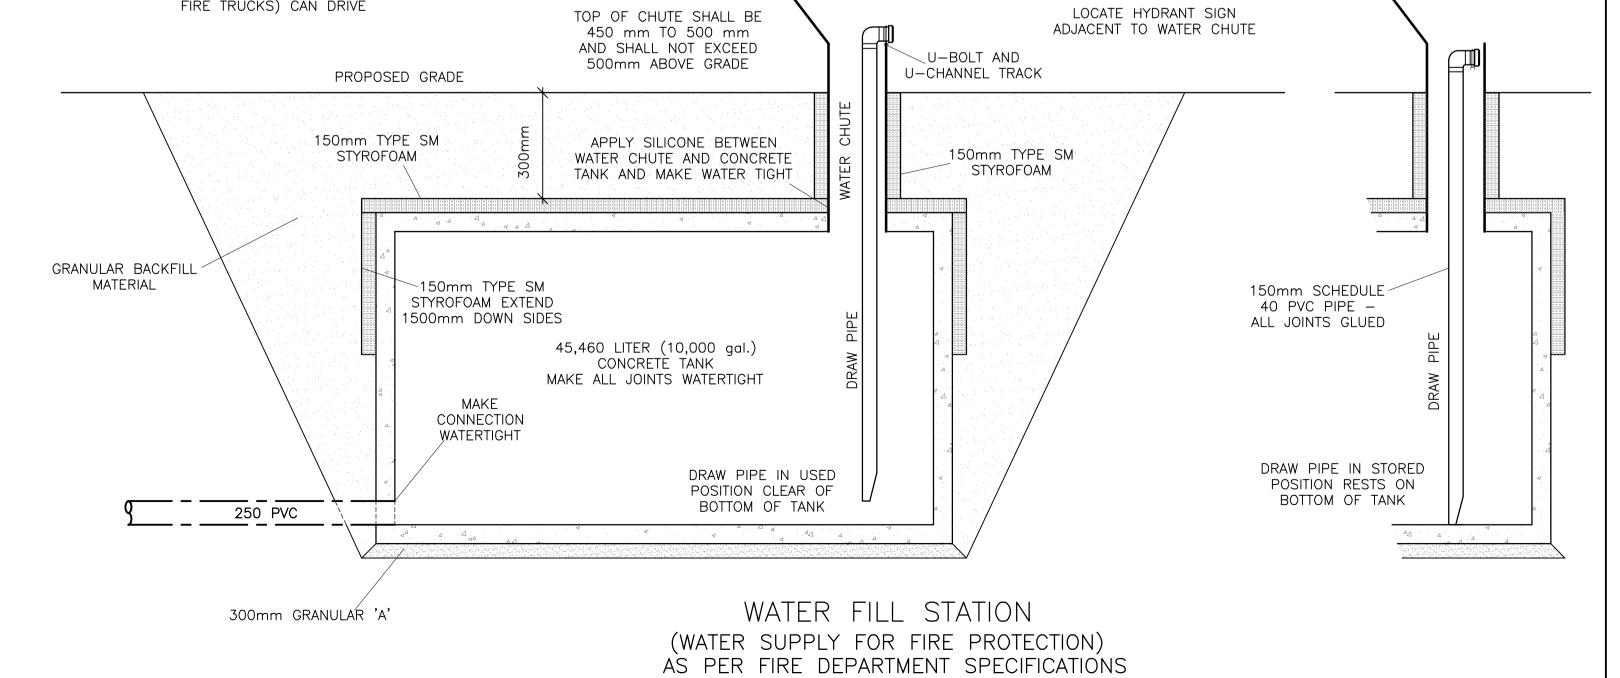

N.T.S.

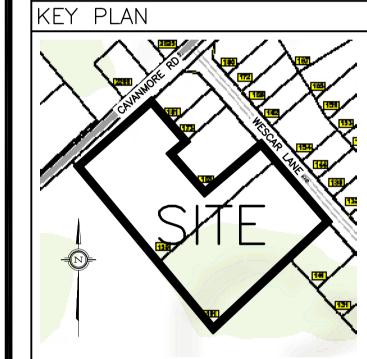

6	AUG 22-24	RE-ISSUED FOR APPROVAL	
5	JUL 10-24	ISSUED FOR BUILDING PERMIT	
4	DEC 13-23	RE-ISSUED FOR APPROVAL	
3	AUG 31-23	ISSUED FOR APPROVAL	
2	AUG 16-23	ISSUED FOR COORDINATION	
1	JUL 17-23	ISSUED FOR COORDINATION	
No.	DATE	REVISION	

D. B. GRAY ENGINEERING INC. tormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain.


700 Long Point Circle 613-425-8044 Ottawa, Ontario d.gray@dbgrayengineering.com

SUNBELT RENTALS INC.-EQUIPMENT MAINTENANCE **FACILITY**

CARP, ONTARIO

Drawing Title

DETAILS



	Drawn	D.B.G
	H. Scale	
	V. Scale	
	Date JUL	17-23
	Job No.	22111
1		
1	D! N-	

C - 14of 17