CATCH BASIN & MANHOLE SCHEDULE

REF	TOP	SIZE	TYPE	INVERT AT	INVERT AT	NOTES
KEF	109	SIZE		SEWER	OUTLET	NOTES
			3101(10)	JEWEN		
CB-1	122.16	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.36	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-2	122.34	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	-	121.35	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-3	122.23	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	121.19(W)	121.19(E)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-4	122.19	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	_	121.20	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-5	122.16	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	_	121.34	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-6	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.20	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-7	121.87	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.12	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-8	122.16	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	121.13(W) 121.13(N)	121.13(SE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-9	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.07	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-10	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	120.95	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-10A	121.75	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	_	121.00	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-11	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.95(SW) 120.95(NN)	120.95(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-12	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	_	121.01	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-12A	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	_	121.09	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB-13	122.18	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.02	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-14	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.82(SW)	120.82(SE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-15	122.00	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.70(NW)	120.70(S)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-16	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.12	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-17	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	121.00(SW)	121.00(SE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-18	121.98	600mm × 600mm	PRECAST CONCRETE CATCH—BASIN	-	121.05	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-19	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.93(SW) 120.93(NW)	120.93(SE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-20	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	120.98	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-21	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.86(SW) 120.86(NW)	120.86(SE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB-22	121.98	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	-	120.92	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19
CB/MH-23	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.79(SW) 120.79(NW)	120.79(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-24	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.73(SW)	120.73(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
CB/MH-25	121.98	1200mm	PRECAST CONCRETE CATCH-BASIN/MANHOLE	120.66(SW)	120.66(E)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010
MH-26	122.00	CDS PMSU4030-8	PRECAST CONCRETE MANHOLE	120.98(SW)	120.98(NE)	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS EXCEPT WITH A DEEP SUMF AS REQUIRED BY CDS
CB-27	121.58	600mm x 600mm	PRECAST CONCRETE CATCH—BASIN	_	119.33	TO OPSD 705.010 & CITY OF OTTAWA STANDARDS — FRAME & COVER TO CITY OF OTTAWA DRAWING No. S19

<u>GENERAL</u>

1.1 USE BAR SCALE TO CONFIRM ACTUAL PLOT SCALE. ALL PIPE DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.

1.2 UNLESS OTHERWISE STATED "ENGINEER" REFERS TO D. B. GRAY ENGINEERING INC 1.3 EXISTING ELEVATIONS AND LOCATIONS, INVERTS AND SIZES OF EXISTING SERVICES & UTILITIES ARE NOT NECESSARILY SHOWN ON PLAN AND THOSE SHOWN ARE DERIVED FROM AVAILABLE INFORMATION AND MUST BE CONFIRMED ON SITE BEFORE COMMENCING CONSTRUCTION REPORT ANY DIFFERENCES TO ENGINEER. UNDERGROUND LOCATES (INCLUDING ONTARIO ONE CALL: 1-800-400-2255) SHALL BE

CONDUCTED PRIOR TO THE COMMENCEMENT OF ANY EXCAVATION. 1.4 SITE BOUNDARIES AND EXISTING GRADES AND OTHER FEATURES DERIVED FROM TOPOGRAPHIC SURVEY PREPARED BY CALLON DIETZ INCORPORATED FILE No.: 22-1868. EXISTING AND NEW GRADE ELEVATIONS AND INVERT ELEVATIONS ON THE THE SURVEY PLAN AND THESE DRAWINGS ARE IN METRES AND ARE GEODETIC (CGVD-1928:1978) AND ARE DERIVED FROM THE CANNET VRS NETWORK STATION OTTAWA HAVING AN ELEVATION OF 95.230. IT IS THE RESPONSIBILITY OF THE USER OF THE SURVEY PLAN AND THESE DRAWINGS TO VERIFY THAT THE JOB BENCHMARK HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREE WITH THE INFORMATION SHOWN ON SURVEY PLAN AND THESE DRAWINGS.

REFER TO ARCHITECTURAL AND LANDSCAPE SITE PLANS FOR EXACT LOCATIONS OF BUILDINGS, PAVED AREAS, SIDEWALKS, PLANTERS ETC. LAYOUT SHALL BE COMPLETED BY THE CONTRACTOR AND SHALL BE REVIEWED BY THE OWNER'S REPRESENTATIVE OR ENGINEER PRIOR TO CONSTRUCTION. AT ALL TIMES THE CONTRACTOR IS RESPONSIBLE FOR THE ACCURACY OF THE LAYOUT INCLUDING LINES AND GRADES. REFERENCE THE LATEST REVISION AND ALL ADDENDLING OF THE GEOTECHNICAL INVESTIGATION BY KOLLARD ASSOCIATES PROJECT #

230403, DATED JUNE 14, 2022. SITE PREPARATION SHALL CONFORM TO THE GEOTECHNICAL INVESTIGATION TO THE SATISFACTION OF THE GEOTECHNICAL ENGINEER INCLUDING: BUILDING SUB-GRADE PREPARATION; PAVEMENT SUB-GRADE PREPARATION AND CONSTRUCTION OF HE PAVEMENT STRUCTURE; EXCAVATION AND BACKFILLING; SERVICE TRENCH EXCAVATION AND PIPE BEDDING AND BACKFILL; AND THI COMPACTION OF MATERIALS

DRAWINGS ARE TO BE READ IN CONJUNCTION WITH SERVICING STUDY & STORM WATER MANAGEMENT REPORT No. 22111 PREPARED BY B. GRAY ENGINEERING IN

REINSTATE ADJACENT PROPERTIES TO PRE-CONSTRUCTION CONDITIONS. 1.9 REINSTATE CITY PROPERTIES TO CITY STANDARDS AND TO CITY OF OTTAWA'S SATISFACTION. 1.10 ALL RELEVANT WORK SHALL BE DONE IN ACCORDANCE WITH CURRENT CITY STANDARDS AND SPECIFICATIONS

I ONTARIO PROVINCIAL STANDARDS & SPECIFICATIONS WILL APPLY WHERE NO CITY STANDARDS ARE AVAILABLE. 1.12 ALL PROPOSED RETAINING WALLS SHALL BE SETBACK A MINIMUM 0.15m FROM PROPERTY LINE INCLUDING THE WALL FOUNDATION AND FOOTINGS. ALL PROPOSED RETAINING WALLS GREATER THAN 1.0m IN HEIGHT SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER REGISTERED IN ONTARIO. ALL RETAINING WALLS OVER 0.6 m REQUIRE A GUARD RAIL (SEE ARCHITECTURAL).

EROSION AND SEDIMENT CONTROL PLAN

2.1 THE EROSION AND SEDIMENT CONTROL PLAN IS A "LIVING DOCUMENT" AND SHALL BE REVISED IN THE EVENT THE SPECIFIED CONTROL MEASURES ARE NOT SUFFICIENT. THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATER COURSE DURING CONSTRUCTION ACTIVITIES. THIS INCLUDES LIMITING THE AMOUNT OF EXPOSED SOIL, USING SEDIMENT CAPTURE FILTER SOCK INSERTS IN CATCH BASINS AND MANHOLES AND INSTALLING SILT FENCES AND OTHER EFFECTIVE SEDIMENT TRAPS. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY. SPECIFICALLY THE CONTRACTOR SHALL INSTALL THE FOLLOWING CONTROL MEASURES AND INSPECT (AFTER EACH RAINFALL), MAINTAIN AND REMOVE THE CONTROL

AT ANY MANHOLES OR CATCH BASINS THAT WILL RECEIVE DISCHARGE FROM DE-WATERING OPERATIONS AND ALL NEW CATCH BASINS AS THEY ARE INSTALLED: INSTALL SEDIMENT CAPTURE FILTER SOCK INSERTS (TERRAFIX GEOSYNTHETICS INC SILTSACK OR APPROVED EQUAL) INSPECT AT THE END OF EACH DAY AND AFTER EACH RAINFALL. REMOVE SEDIMENT AS RECOMMENDED BY THE MANUFACTURER. IMMEDIATELY REPAIR OR REPLACE ANY DAMAGED FILTER SOCK INSERTS. DO NOT REMOVE UNTIL CONSTRUCTION IS COMPLETE.

INSTALL A SILT FENCE BARRIER AROUND STOCKPILED SEDIMENT OR SOIL. PRIOR TO COMMENCEMENT OF CONSTRUCTION INSTALL A SILT FENCE BARRIER AS SHOWN ON PLANS. INSPECT ALL SILT FENCES AT THE END OF EACH DAY AND AFTER EACH RAINFALL. REMOVE SEDIMENT DEPOSITS WHEN THE LEVEL OF DEPOSITS REACHES ONE THIRD THE HEIGHT OF THE FENCE. IMMEDIATELY REPAIR OR REPLACE ANY DAMAGED SECTIONS OF FENCE. DO NOT REMOVE ANY SILT FENCES IN ANY PHASE UNTIL CONSTRUCTION IS COMPLETE. PRIOR TO COMMENCEMENT OF CONSTRUCTION INSTALL STRAW BALE FLOW CHECK DAMS AS INDICATED ON DRAWINGS. INSPECT ALL STRAW BALE FLOW CHECK DAMS AT THE END OF EACH DAY AND AFTER EVERY RAINFALL. REMOVE SEDIMENT DEPOSITS WHEN THE LEVEL OF DEPOSITS REACHES ONE THIRD THE HEIGHT OF THE DAM. IMMEDIATELY REPAIR OR REPLACE ANY DAMAGED BALES. STRAW BALES SHALL

BE EMBEDDED INTO SOIL A MINIMUM 150MM AND SHALL BE SECURELY ANCHORED BY TWO STAKES. THE FIRST STAKE IN EACH BALE SHALL BE DRIVEN TOWARDS THE PREVIOUSLY LAID BALE TO FORCE THE BALES TOGETHER. DO NOT REMOVE ANY STRAW BALES UNTIL CONTROL AND LIMIT VEHICLE ACCESS TO AND AROUND THE CONSTRUCTION SITE TO MINIMIZE THE DISTURBANCE OF SOIL AND VEGETATION. PRIOR TO COMMENCEMENT OF CONSTRUCTION INSTALL AT ALL POINTS OF EGRESS TO PUBLIC ROADS GEOTEXTILE FABRIC MUD MATS (TERRAFIX GEOSYNTHETICS INC. OR APPROVED EQUAL OR OTHER APPROVED METHOD. MUD MATS SHALL BE THE FULL WIDTH OF THE EGRESS POINT AND AT LEAST 18m IN LENGTH. MUD MATS SHALL BE WASHED AS REQUIRED TO PREVENT MATERIAL FROM BEING

TRACKED ONTO THE PUBLIC ROAD. DO NOT REMOVE MUD MATS UNTIL CONSTRUCTION IS COMPLETE. IN ADDITION, IF REQUIRED TO PREVENT MATERIAL FROM BEING TRACKED ONTO THE PUBLIC ROAD, WASH VEHICLE TIRES AT THE EGRESS POINT.. ANY MATERIAL DEPOSITED ON A PUBLIC ROAD SHALL BE REMOVED BY SWEEPING AND SHOVELING OR VACUUMING AND DISPOSING

SEDIMENT IN A CONTROLLED AREA. DO NOT SWEEP OR HOSE MATERIAL INTO ANY STORMWATER CONVEYANCE SYSTEM. 2.6 CONSTRUCTION IS CONSIDERED COMPLETE WHEN THE FOLLOWING CONDITIONS HAVE BEEN MET:

ALL STRUCTURES HAVE BEEN BUILT. ALL HARD SURFACES HAVE BEEN CONSTRUCTED.
ALL PROPOSED GRASSED AREAS ARE EITHER SODDED OR HAVE A FULL COVERAGE OF WELL ESTABLISHED TURF AND HAVE HAD A MINIMUM OF ONE FULL GROWING SEASON (MAY 15TH TO SEPTEMBER 15TH).

ALL STOCKPILED MATERIALS HAVE BEEN REMOVED. 2.7 REMOVE EROSION AND SEDIMENT CONTROL MEASURES WHEN CONSTRUCTION IS COMPLETE.

THERE ARE NO AREAS OF EXPOSED EARTH.

GRADING & DRAINAGE

 3.1 NEW GRADES TO MATCH EXISTING AT PROPERTY LINE. NO EXCESS DRAINAGE WILL BE DIRECTED TOWARDS THE ADJACENT PROPERTIES DURING AND AFTER CONSTRUCTION. THERE WILL BE NO ALTERATION TO EXISTING GRADE AND DRAINAGE PATTERNS ON PROPERTY LINE.
 3.2 ALL AREAS SHALL BE GRADED TO ENSURE ADEQUATE DRAINAGE AWAY FROM BUILDINGS TO CATCH BASINS, SWALES, DITCHES AND OTHER APPROVED DISPOSAL AREAS. GRADING SHALL BE GRADUAL BETWEEN FINISHED SPOT ELEVATIONS SHOWN ON DRAWINGS TO PREVENT

PONDING (OTHER THAN PONDING REQUIRED FOR STORMWATER MANAGEMENT). 3.3 WHETHER RESULT OF POOR WORKMANSHIP OR DAMAGE: DEFECTIVE GRADING SHALL BE CORRECTED. PROMPTLY MAKE GOOD OTHER CONTRACTOR'S WORK DAMAGED BY SUCH CORRECTIONS. CULVERTS SHALL HDPE TO CITY OF OTTAWA STANDARDS AND SPECIFICATIONS AND TO OPSS 1840 AND CSA B182.8 OR 182.6. MINIMUM

320 kPa STIFFNESS AT 5% DEFLECTION. JOINTS SHALL BE SOIL-TIGHT OR BETTER (BOSS 2000 OR APPROVED EQUAL). CULVERTS SHALL BE 500mm ROUND CORRUGATED STEEL [[UNDER 600mm 2.0 mm]] [[600mm AND OVER 2.8mm]] THICK ALUMINIZED TYPE 2 TO CITY OF OTTAWA STANDARDS AND SPECIFICATIONS AND TO OPSS 1801 AND OPSD 805.010 AND CSA G401. ALL CULVERTS WITHIN PAVED AREAS SHALL HAVE 5:1 FROST TAPERS FROM THE INVERT OF THE CULVERT TO THE PAVEMENT SUB—GRADE.

3.5 RIP RAP: PLACE RIP-RAP 300mm THICK AS INDICATED ON PLANS AS PER OPSS 511 AND OPSD 810.010 AND/OR 810.020. USF QUARRIED STONE 200MM TO 300MM IN DIAMETER. AREA TO BE RIP RAPPED SHALL BE EXCAVATED AND FINE GRADED TO A UNIFORM AND EVEN SURFACE TO PROVIDE ADEQUATE FOUNDATION. FILL AND THOROUGHLY COMPACT DEPRESSIONS. WHERE RIP RAP IS TO BE PLACED ON SLOPES, EXCAVATE TRENCH AT TOE OF SLOPE. PLACE GEOTEXTILE FABRIC ON PREPARED SURFACE. GEOTEXTILE FABRIC SHALL EXTEND A MINIMUM 300mm BEYOND THE EXTENT OF THE RIP RAP IN ALL DIRECTIONS. PLACE RIP RAP ON FABRIC CAREFULLY, D AVOID PUNCTURING FABRIC. PLACE RIP RAP IN A SET AND STABLE MANNER. ROCK SHALL BE PLACED, STARTING AT THE LOWER END

OF THE SLOPE. THE LARGEST ROCKS OBTAINABLE SHALL BE USED AND PLACED IN THE BOTTOM COURSES AND FOR USE AS HEADERS THROUGH SUBSEQUENT COURSES. THEY SHALL BE LAID CLOSELY AND SUCH THAT THEY WILL PROVIDE A REASONABLE SEMBLANCE OF FILL VOIDS WITH ROCK SPALLS OR COBBLE FINNISH SURFACE EVEN, FREE OF LARGE OPENINGS AND NEAT IN APPEARANCE 3.6 GEOTEXTILE FABRIC: TO OPSS 1860. WOVEN SYNTHETIC FIBRE FABRIC SHALL BE USED IN SILT FENCE BARRIER (GEOSYNTHETIC HD105 OR APPROVED EQUAL). NON-WOVEN SYNTHETIC FIBRE FABRIC 1.75mm THICK, 200g/sq.m. SHALL BE USED FOR MATERIAL SEPARATION. SUBDRAIN / DRY WELL / INFILTRATION TRENCH APPLICATIONS: GEOSYNTHETIC TERRAFIX 360R OR APPROVED EQUAL. RIP RAP APPLICATIONS: GEOSYNTHETIC TERRAFIX 420R OR APPROVED EQUAL. PRIOR TO INSTALLATION SUBMIT SHOP DRAWING TO ENGINEER FOR APPROVAL. GEOTEXTILE FABRIC SHALL BE FREE OF TEARS AND RESISTANT TO DETERIORATION BY ULTRA VIOLET AND HEAT EXPOSURE. PLACE GEOTEXTILE MATERIAL BY UNROLLING ONTO GRADED SURFACE, SMOOTH AND FREE OF TENSION STRESS, FOLDS, WRINKLES CREASES. PLACE GEOTEXTILE MATERIAL ON SLOPING SURFACES IN ONE CONTINUOUS LENGTH FROM TOE OF SLOPE TO UPPER EXTENT OF GEOTEXTILE. OVERLAP EACH SUCCESSIVE STRIP OF GEOTEXTILE 600mm OVER PREVIOUSLY LAID STRIP IN DIRECTION OF FLOW. LTERNATIVELY THE FABRIC MAY BE LAPPED A MINIMUM OF 300mm AND PINNED TOGETHER. PROTECT INSTALLED GEOTEXTILE MATERIAL FROM DISPLACEMENT, DAMAGE OR DETERIORATION BEFORE, DURING AND AFTER PLACEMENT OF MATERIAL LAYERS AFTER INSTALLATION, COVER WITH OVERLYING LAYER WITHIN 4 HOURS OF PLACEMENT. DURING DELIVERY AND STORAGE, PROTECT GEOTEXTILES FROM DIRECT SUNLIGHT, ULTRAVIOLET RAYS, EXCESSIVE HEAT, MUD, DIRT, DUST, DEBRIS AND RODENTS. VEHICULAR TRAFFIC NOT PERMITTED DIRECTLY ON GEOTEXTILE. AVOID PUNCTURING GEOTEXTILE. REPLACE DAMAGED OR DETERIORATED GEOTEXTILE.

SITE SERVICES

WATERMAIN CONNECTING FIRE TANKS (WATER FILL STATION / WATER SUPPLY FOR FIREFIGHTING) AND FIRE TANKS TO FIRE HYDRANTS SHALL BE PVC DR25 TO AWWA C-900 & CSA B137.3 (IPEX BLUE BRUTE OR APPROVED EQUAL). PROVIDE THRUST BLOCKS AS PER CITY OF OTTAWA DWG, NO. W25.3 & W25.4 AT ALL VALVES, TEES, CAPS, BENDS, REDUCERS AND HYDRANTS OR OTHER FITTINGS WHERE CONNECTIONS, RESTRAINT RODS AND VALVE BOLTS TO BE STAINLESS STEEL. CATHODIC PROTECTION & ANODE INSTALLATION AS PER CITY OF OTTAWA DWG. NO W40. W42. W44 & W47.

4.2 PROVIDE A MINIMUM 2.4 m COVER OVER WELL WATER LINE AND WATERMAIN. WHERE THE MINIMUM COVER IS NOT POSSIBLE INSULATE AS

4.3 THE HYDRANT SHALL BE INSTALL WITH THE BREAKABLE FLANGE 50mm TO 150mm ABOVE FINISHED GRADE. THERE SHALL BE NO VEGETATION OR OTHER OBSTRUCTIONS IN FRONT OF HYDRANT AND WITHIN 1.5m OF FIRE HYDRANT. THE FIRE HYDRANT SHALL BE RED WITH WHITE BONNETS AND CAPS TO CITY STANDARDS.

4.4 SEWER MATERIAL SHALL BE PVC OR REINFORCED CONCRETE. PVC SEWERS SHALL BE SDR-35 (SDR-28 FOR DIAMETERS 150mm OR LESS) AND SHALL CONFORM TO CSA B182.2 AND SHALL HAVE BELL AND SPIGOT JOINTS WITH RUBBER GASKETS.

4.5 SANITARY FORCEMAIN SHALL BE PVC SDR 26 (IPEX CYLCETOUGH OR APPROVED EQUAL). PROVIDE THRUST BLOCKS AS PER CITY OF OTTAWA DWG. No. W25.3 & W25.4 AT ALL VALVES, TEES, CAPS, BENDS, REDUCERS AND HYDRANTS OR OTHER FITTINGS WHERE CHANGES OCCUR IN PIPE DIAMETER OR DIRECTION. RESTRAINING AS PER AS PER CITY OF OTTAWA DWG. No W25.5 & W25.6. 4.6 PROVIDE A MINIMUM 2.4 m COVER OVER SANITARY FORCEMAIN.

4.7 MANHOLES & CATCH BASINS: PRECAST MANHOLE UNITS: TO OPSS 1351 AND OPSD 701.010 WITH BASE SLAB OR MONOLITHIC BASE. TOP SECTIONS ECCENTRIC CONE OR FLAT LAB TOP TYPE WITH OPENING OFFSET FOR VERTICAL LADDER INSTALLATION. MANHOLE STEPS: TO OPSD 405.01

ADJUSTING RINGS: TO ASTM C 478M.

ALUMINUM SURFACES IN CONTACT WITH OR CAST INTO CONCRETE SHALL HAVE POLYETHYLENE ANCHOR INSULATING SLEEVES. PRECAST CATCH BASIN SECTIONS: TO OPSS 1351.

JOINTS: SHALL BE MADE WATERTIGHT USING BUTYL BASED, FLEXIBLE WATERSTOP/JOINT SEALANT MATERIAL.

H. STORM SEWERS: MANHOLES SHALL HAVE A 300mm SUMP AND CATCH BASINS AND DITCH INLETS SHALL HAVE A 600mm SUMP. FRAMES, GRATES AND COVERS TO CITY OF OTTAWA DRAWINGS OR OPSD (AS PER CATCH BASIN & MANHOLE SCHEDULE). GRATES AND COVERS TO BEAR EVENLY ON FRAMES.

GRANULAR BEDDING AND BACKFILL: OPSS GRANULAR A. RE-CYLCLED GRANULAR MATERIALS ARE NOT PERMITTED. 4.8 THE INLET CONTROL DEVICE (ICD) LOCATED IN THE INLET OF OF THE 450 mm CULVERT AT THE OUTLET OF THE STORMWATER DETENTION AREA SHALL BE PLUG STYLE WITH A ROUND ORIFICE (WITH THE ORIFICE LOCATED AT THE BOTTOM OF THE PLUG) MANUFACTURED BY PEDRO PLASTICS (OR APPROVED EQUAL) AND SIZED BY THE MANUFACTURER FOR A DISCHARGE RATE AS INDICATED ON PLAN. PRIOR TO INSTALLATION SUBMIT SHOP DRAWING TO ENGINEER FOR APPROVAL.

4.9 WATER FILL STATION / WATER SUPPLY FOR FIRE FIGHTING STORAGE TANKS, CHUTE WITH FIRE FITTINGS AND DRAW PIPES AS PER LOCAL FIRE DEPARTMENT STANDARDS. SUPPLY AND INSTALL A LOW WATER LEVEL FLOAT ALARM (AUDIBLE AND VISUAL) THAT IS ACTIVATED WHEN THE WATER LEVEL DROPS MORE THAN 300 mm BELOW THE TOP OF THE TANK. CONNECT 45,460 LITRE (10,000 GAL) CONCRETE TANKS WITH 250 mm DIAMETER PVC DR25 PIPE (IPEX BLUE BRUTE OR APPROVED EQUAL). CORE DRILL OPENINGS IN TANKS AND MAKE JOINTS WATERTIGHT BETWEEN TANK AND PIPE. AS INDICATED ON PLANS: TANKS SHALL EITHER HAVE A CHUTE AND A DRAW PIPE OR SHALL HAVE AN ACCESS OPENING WITH A 150 mm GALVANIZED STEEL "CANDY CANE" VENT C/W WITH RODENT SCREEN. ANCHOR TANKS TO PREVENT UPLIET FROM HYDROSTATIC PRESSURES USING A METHOD APPROVED BY TANK MANUFACTURER. HANDLE AND INSTALL FIRE STORAGE TANKS USING METHODS APPROVED BY THE TANK MANUFACTURER AND AS FOLLOWS (IN THE EVENT OF A CONFLICT, THE METHOD APPROVED BY THE MANUFACTURER SHALL BE USED):

A. PLACE TANK PLUMB AND TRUE TO ALIGNMENT AND GRADE. B. SET TANK ON MINIMUM 300 mm OF OPSS GRANULAR A COMPACTED TO 100% CORRECTED MAXIMUM DRY DENSITY OR AS DIRECTED BY MANUFACTURER. RE—CYLCLED GRANULAR MATERIALS ARE NOT PERMITTED.

C. PLACE GRANULAR BACKFILL MATERIALS IN A UNIFORM LAYERS TO COMPACTED THICKNESS OF 150 MM, COMPACT TO 95% CORRECTED MAXIMUM DRY DENSITY.

PLACE LAYERS SIMULTANEOUSLY ON BOTH SIDES OF INSTALLED WORK TO EQUALIZE LOADING.

MAKE ALL JOINTS WATERTIGHT.

PERFORM FIELD LEAKAGE TESTS ON ALL TANKS AND CONNECTING PIPES AND WATERMAIN COMPLETED IN ACCORDANCE WITH OPSS 407 (MAINTENANCE HOLES & VALVE CHAMBERS) & OPSS 410 (SEWERS). REPAIR AND RETEST AS REQUIRED. REPAIR VISIBLE LEAKS REGARDLESS OF TEST RESULTS.

5. <u>CONSTRUCTION:</u>

5.1 PRIOR TO COMMENCING WORK:

A. OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE AUTHORITIES. B. SIZE, DEPTH AND LOCATION OF EXISTING SERVICES, UTILITIES AND STRUCTURES AS INDICATED ON THE DRAWINGS ARE FOR GUIDANCE ONLY. ALL EXISTING SERVICES, UTILITIES AND STRUCTURES ARE NOT NECESSARILY SHOWN ON THE DRAWINGS. COMPLETENESS AND ACCURACY ARE NOT GUARANTEED. NOTIFY ALL APPLICABLE OWNERS, UTILITY COMPANIES AND AUTHORITIES HAVING JURISDICTION OF PROPOSED WORK AND LOCATE AND CLEARLY IDENTIFY ALL EXISTING SERVICES, UTILITIES AND STRUCTURES ON AND ADJACENT TO THE SITE. UNDERGROUND LOCATES (INCLUDING ONTARIO ONE CALL: 1-800-400-2255) SHALL BE CONDUCTED PRIOR TO THE COMMENCEMENT OF ANY EXCAVATION. CONFIRM LOCATIONS OF BURIED SERVICES AND UTILITIES BY CAREFUL TEST EXCAVATIONS AND REPORT ANY DIFFERENCES TO THE ENGINEER.

C. EXISTING GRADE ELEVATIONS INDICATED ON THE DRAWINGS ARE FOR GUIDANCE ONLY. COMPLETENESS AND ACCURACY ARE NOT GUARANTEED. CONFIRM EXISTING GRADE ELEVATIONS AND REPORT ANY DIFFERENCES TO THE ENGINEER. D. COORDINATE AND SCHEDULE WORK WITH THE AUTHORITIES AND OTHER TRADES.

SCHEDULE WORK TO PROVIDE THE MINIMUM DISRUPTION TO SERVICES.

INSTALL CONSTRUCTION FENCING AROUND THE AREA OF WORK. DO NOT REMOVE FENCING UNTIL WORK IS COMPLETE. 5.2 MAINTAIN AND PROTECT FROM DAMAGE, SERVICES, UTILITIES AND STRUCTURES ENCOUNTERED.

5.3 PROTECT EXISTING BUILDINGS, TREES AND OTHER PLANTS, LAWNS, FENCING, SERVICE POLES, WIRES, PAVEMENT, SURVEY BENCH MARKS AND MONUMENTS AND OTHER SURFACE FEATURES FROM DAMAGE WHILE WORK IS IN PROGRESS. DO NOT DISTURB SOIL WITHIN BRANCH SPREAD OF TREES OR SHRUBS THAT ARE TO REMAIN.

REPLACEMENT OF ALL NECESSARY SIGNAGE AND BARRIERS, AS REQUIRED BY THE AUTHORITIES. IF APPLICABLE, PROVIDE TRAFFIC MANAGEMENT PLAN AS PER CITY OF OTTAWA REQUIREMENTS. 5.5 FENCE OFF ALL OPEN EXCAVATIONS AT THE END OF EACH WORK DAY. FENCES SHALL BE INSTALLED AND MAINTAINED IN A GOOD AND

5.4 PROVIDE TRAFFIC CONTROL AND SAFETY MEASURES INCLUDING ANY NECESSARY PERSONNEL AND THE SUPPLY, INSTALLATION, REMOVAL AND

5.6 REMOVE OBSTRUCTIONS, ICE AND SNOW, FROM SURFACES TO BE EXCAVATED.

5.7 CUT PAVEMENT AND / OR SIDEWALK NEATLY ALONG LIMITS OF PROPOSED EXCAVATION IN ORDER THAT SURFACE MAY BREAK EVENLY AND 5.8 COORDINATE AND PAY FOR GEOTECHNICAL INSPECTIONS AND COMPACTION TESTS OF SUB-GRADE, PIPE BEDDING AND EACH LAYER OF

SURROUND MATERIAL, BACKFILL, SUB-BASE, BASE AND ASPHALT TO THE SATISFACTION OF THE GEOTECHNICAL CONSULTANT AND ENGINEER. SUBMIT GEOTECHNICAL INSPECTIONS AND COMPACTION REPORTS TO ENGINEER FOR REVIEW.

5.9 FILL MATERIAL AND THE PLACEMENT AND COMPACTION OF THE FILL MATERIAL AS PER THE GEOTECHNICAL REPORT AND TO SATISFACTION OF THE GEOTECHNICAL CONSULTANT. STOCKPILE GRANULAR AND FILL MATERIALS IN MANNER TO PREVENT SEGREGATION AND PROTECT FROM CONTAMINATION. PLACE MATERIAL IN UNIFORM LAYERS NOT EXCEEDING 300mm COMPACTED THICKNESS. 5.10 PROTECT WORK AREA AGAINST FLOODING AND DAMAGE DUE TO SURFACE RUN-OFF. DEWATER AS REQUIRED TO KEEP WORK AREA FREE

DISCHARGE AREA. ENSURE THAT THE DISCHARGED WATER DOES NOT CAUSE EROSION OR OTHER DAMAGE TO ADJACENT LANDS. 5.11 EXCAVATION, TRENCHING, ENGINEERED FILL, COMPACTION & BACKFILL SHALL BE AS PER THE GEOTECHNICAL INVESTIGATION: A. SHORE AND BRACE EXCAVATIONS, PROTECT SLOPES AND BANKS AND PERFORM ALL WORK IN ACCORDANCE WITH ONTARIO REGULATION

입 UNDER THE ONTARIO OCCUPATIONAL HEALTH AND SAFETY ACT AND OTHER AUTHORITIES HAVING JURISDICTION. KEEP EXCAVATIONS FREE OF WATER WHILE WORK IS IN PROGRESS. PROTECT OPEN EXCAVATIONS AGAINST FLOODING AND DAMAGE

OF WATER. DISCHARGE FROM DEWATERING OPERATIONS SHALL BE DIRECTED TO A SEDIMENT CONTROL MEASURE AND/OR A VEGETATED

C. EXCAVATION MUST NOT INTERFERE WITH BEARING CAPACITY OF ADJACENT FOUNDATIONS. D. DO NOT OBSTRUCT FLOW OF SURFACE DRAINAGE OR NATURAL WATERCOURSES.

E. EXCAVATE TO LINES, GRADES, ELEVATIONS AND DIMENSIONS AS INDICATED. F. EARTH BOTTOMS OF EXCAVATIONS TO BE UNDISTURBED SOIL, LEVEL, FREE FROM LOOSE, SOFT OR ORGANIC MATTER.

G. ALL STRUCTURES WITHIN PAVED AREAS SHALL HAVE 4:1 FROST TAPERS FROM FROST LINE TO SUB-GRADE. H. CORRECT OVER-EXCAVATION WITH GRANULAR A COMPACTED TO NOT LESS THAN 95% OF CORRECTED MAXIMUM DRY DENSITY.

I. SUB-GRADE AND AREAS TO BE BACKFILLED TO BE FREE FROM DEBRIS, SNOW, ICE, WATER AND FROZEN GROUND. J. DO NOT USE BACKFILL MATERIAL WHICH IS FROZEN OR CONTAINS ICE. SNOW OR DEBRIS.

K. PIPE BEDDING AND SURROUND MATERIAL SHALL BE OPSS GRANULAR A. SURROUND MATERIAL FOR CONCRETE PIPE MAY BE CLEAN WELL GRADED SAND. RE-CYLCLED GRANULAR MATERIALS ARE NOT PERMITTED.

. DO NOT USE BEDDING, SURROUND OR BACKFILL MATERIAL WHICH IS FROZEN OR CONTAINS ICE, SNOW OR DEBRIS. M. PIPE BEDDING SHALL BE 150mm THICK. SHAPE BED TRUE TO GRADE AND TO PROVIDE CONTINUOUS, UNIFORM BEARING SURFACE

N. PLACE SURROUND MATERIAL AROUND PIPES TO FULL WIDTH OF TRENCH AND TO 300mm ABOVE PIPES.

O. PLACE BEDDING AND SURROUND MATERIAL IN UNIFORM LAYERS NOT EXCEEDING 150mm COMPACTED THICKNESS. PLACE FILL AND BACKFILL MATERIAL IN UNIFORM LAYERS NOT EXCEEDING 300mm COMPACTED THICKNESS.

P. COMPACT EACH LAYER TO 95% OF CORRECTED DRY DENSITY BEFORE PLACING SUCCEEDING LAYER

Q. DO NOT BACKFILL AROUND OR OVER CAST-IN-PLACE CONCRETE WITHIN 24 HOURS AFTER PLACING OF CONCRETE. BACKFILL MATERIALS WITHIN 1.8m OF PROPOSED GRADE SHALL MATCH THE MATERIALS EXPOSED ON THE TRENCH WALLS. BACKFILL BACKFILL MATERIALS WITHIN 1.8m OF PROPOSED GRADE SHALL MATCH THE MATERIALS EXPOSED ON THE TRENCH WALLS. BACKFILL BELOW 1.8m OF THE PROPOSED CAN CONSIST OF EITHER ACCEPTABLE NATIVE MATERIAL; ROCK; OR IMPORTED GRANULAR MATERIAL CONFORMING TO OPSS GRANULAR B TYPE I OR II. ANY ORGANIC SOILS OR TOPSOIL, IF ENCOUNTERED, SHALL BE REMOVED FROM THE EXCAVATION. IF ROCK IS USED AS BACKFILL IT SHALL BE WELL SHATTERED AND GRADED AND 200mm OR SMALLER IN DIAMETER. TO PREVENT INGRESS OF FINE MATERIAL INTO VOIDS IN THE ROCK FILL, THE UPPER SURFACE OF THE ROCK FILL SHALL BE COVERED WITH 150mm LAYER OF COMPACTED, WELL GRADED CRUSHED STONE PLACED ON GEOTEXTILE FABRIC.

A. HANDLE PIPE USING METHODS APPROVED BY MANUFACTURER.

B. LAY, CUT AND JOIN PIPES IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

C. USE ONLY FITTINGS AS RECOMMENDED BY PIPE MANUFACTURER. D. LAY PIPES ON PREPARED BED, TRUE TO LINE AND GRADE AND ENSURE BARREL OF EACH PIPE IS IN CONTACT WITH SHAPED BED

THROUGHOUT ITS FULL LENGTH, FREE OF SAGS OR HIGH POINTS. DO NOT EXCEED MAXIMUM JOINT DEFLECTION RECOMMENDED BY PIPE MANUFACTURER.

WHENEVER WORK IS SUSPENDED, INSTALL REMOVABLE WATERTIGHT BULKHEAD AT OPEN END OF LAST PIPE LAID TO PREVENT ENTRY OF FORFIGN MATERIALS.

WHEN STOPPAGE OF WORK OCCURS, BLOCK PIPES TO PREVENT CREEP DURING DOWN TIME. MAKE WATERTIGHT CONNECTIONS TO

H. JOINTS SHALL BE STRUCTURALLY SOUND AND WATERTIGHT. I. REPAIR OR REPLACE PIPE, PIPE JOINT OR BEDDING FOUND DEFECTIVE

5.13 SEWERS AND SEWER SERVICES:

A. CONSTRUCT SEWER TRENCHES AS PER CITY DWG S6 & S7. RIGID STRUCTURES, INSTALL PIPE JOINTS NOT MORE THAN 1.2 m FROM SIDE OF STRUCTURE.

CONDUCT TWO CCTV INSPECTIONS OF SEWERS. FIRST INSPECTION AFTER COMPLETION OF CONSTRUCTION. SECOND INSPECTION IMMEDIATELY PRIOR TO END OF WARRANTY PERIOD. A PAN AND TILT CAMERA SHALL BE USED. REPAIR SEWER LINE AS REQUIRED. SUBMIT REPORTS AND DVDS TO ENGINEER.

5.14 MANHOLES & CATCH BASINS: A. JOINTS: SHALL BE MADE WATERTIGHT.

DUE TO SURFACE RUN-OFF.

B. SET PRECAST CONCRETE BASE ON 150mm MINIMUM OF GRANULAR BEDDING COMPACTED TO 100% CORRECTED MAXIMUM DRY DENSITY. C. MAKE EACH JOINT WATERTIGHT WITH RUBBER RING GASKETS. D. PLACE GRANULAR BACKFILL MATERIALS IN A UNIFORM LAYERS TO COMPACTED THICKNESS OF 150mm, COMPACT TO 95% CORRECTED

E. PLACE FRAME AND COVER ON TOP SECTION TO ELEVATION AS INDICATED. IF ADJUSTMENT REQUIRED USE CONCRETE RINGS TO A

F. CLEAN UNITS OF DEBRIS, FOREIGN AND SURPLUS MATERIALS. REMOVE FINS AND SHARP PROJECTIONS. PREVENT DEBRIS FROM ENTERING SYSTEM. 5.15 MAINTAIN RECORD DRAWINGS AND RECORD ACCURATELY DEVIATIONS FROM THE ORIGINAL CONTRACT DOCUMENTS CAUSED BY SITE CONDITIONS AND CHANGES MADE BY CHANGE ORDER OR ADDITIONAL INSTRUCTIONS. UPDATE DAILY AND MAKE AVAILABLE ON-SITE FOR REVIEW THROUGHOUT THE CONSTRUCTION PERIOD. MARK CHANGES IN RED INK. RECORD DRAWINGS SHALL INCLUDE BUT NOT NECESSARILY LIMITED TO CHANGES OF DIMENSION AND DETAIL; CHANGES TO GRADE ELEVATIONS; AND HORIZONTAL AND VERTICAL LOCATIONS OF LINDERGROUND SERVICES LITHLITIES AND APPLIETENANCES REFERENCED TO A PERMANENT SURFACE STRUCTURE. SUBMIT A RECORD DRAWING OF "AS-BUILT" GRADE ELEVATIONS. PREPARED BY A SURVEYOR. TO THE ENGINEER AT THE END OF CONSTRUCTION.

5.16 CONCRETE CURBS SHALL BE CONSTRUCTED TO CITY OF OTTAWA DRAWING No. SC1.1. CONCRETE SIDEWALK SHALL BE CONSTRUCTED TO CITY OF OTTAWA DRAWING No. SC4. MONOLITHIC CONCRETE CURB AND SIDEWALK SHALL BE CONSTRUCTED TO CITY OF OTTAWA DRAWING

5.17 WHETHER RESULT OF POOR WORKMANSHIP, USE OF DEFECTIVE PRODUCTS OR DAMAGE: DEFECTIVE PORTIONS OF CURBS, SIDEWALK AND ASPHALT SHALL BE CORRECTED OR REMOVED AND REPLACED. PROMPTLY MAKE GOOD OTHER CONTRACTOR'S WORK DAMAGED BY SUCH REMOVALS OR REPLACEMENTS.

5.11 REINSTATE ALL AREAS DISTURBED BY CONSTRUCTION. REINSTATE PAVEMENTS, CURBS AND SIDEWALKS, TO THICKNESS, STRUCTURE AND ELEVATION WHICH EXISTED BEFORE CONSTRUCTION. REINSTATE LANDSCAPED AREAS TO THE CONDITION AND ELEVATION WHICH EXISTED 5.13 CLEAN AND REINSTATE AREAS AFFECTED BY THE WORK.

6. ASPHALT PAVEMENT

6.1 ASPHALT PAVEMENT STRUCTURE:

LIGHT DUTY PAVEMENT: 50mm SUPERPAVE 12.5 ASPHALTIC CONCRETE

150mm OPSS GRANULAR A BASE

300mm OPSS GRANULAR B TYPE II SUB-BASE (50 OR 100mm MINUS CRUSHED STONE) NON-WOVEN GEOTEXTILE FABRIC (60Z/SQ.YD.); TERRAFIX OR THARCE-LING 150WX OR APPROVED EQUAL.

HEAVY DUTY PAVEMENT 40mm HL-3 OR SUPERPAVE 12.5 ASPHALTIC CONCRETE

50mm HL-8 OR SUPERPAVE 19.0 ASPHALTIC CONCRETE 150mm OPSS GRANULAR A BASE

300mm OPSS GRANULAR B TYPE II SUB-BASE (50 OR 100mm MINUS CRUSHED STONE) NON-WOVEN GEOTEXTILE FABRIC (60Z/SQ.YD.); TERRAFIX OR THARCE-LING 150WX OR APPROVED EQUAL.

6.2 RE-CYLCLED GRANULAR MATERIALS ARE NOT PERMITTED.

ASPHALTIC CONCRETE SHALL BE PERFORMANCE GRADE PG58-34 HOT MIX ASPHALT MATERIALS SHALL BE ACCORDING TO OPSS 1150 OR 1151

PAVEMENT SUB-GRADE PREPARATION AND CONSTRUCTION OF THE PAVEMENT STRUCTURE SHALL CONFORM TO THE GEOTECHNICAL INVESTIGATION TO THE SATISFACTION OF THE GEOTECHNICAL ENGINEER.

6.3 REMOVE ALL MATERIALS TO THE SUB-GRADE LEVEL. REMOVE ORGANIC OR UNSUITABLE MATERIAL FROM SUB-GRADE WHERE ENCOUNTERED TO THE SATISFACTION OF THE GEOTECHNICAL CONSULTANT. SUB-GRADE TO BE FREE FROM DEBRIS, SNOW, ICE, WATER AND FROZEN GROUND. COMPACT SUB-GRADE TO 95%.

6.4 CONSTRUCT GRANULAR BASE AND SUB-BASE TO DEPTH AND GRADE IN AREAS INDICATED.CONSTRUCT A 5H:1V FROST TAPER IN SUB-GRADE SURFACE AS A TRANSITION BETWEEN DIFFERING PAVEMENT STRUCTURES AND BETWEEN PAVEMENT AND CURBS AND

6.5 ENSURE NO FROZEN MATERIAL IS PLACED. PLACE MATERIAL ONLY ON CLEAN UNFROZEN SURFACE, FREE FROM SNOW OR ICE. 6.6 PLACE MATERIAL TO FULL WIDTH IN UNIFORM LAYERS NOT EXCEEDING 300mm COMPACTED THICKNESS. SHAPE EACH LAYER TO SMOOTH

CONTOUR AND COMPACT TO SPECIFIED DENSITY BEFORE SUCCEEDING LAYER IS PLACED. 6.7 COMPACT SUB-BASE MATERIAL TO DENSITY OF NOT LESS THAN 98% CORRECTED MAXIMUM DRY DENSITY. FILL OVER-EXCAVATE SUB-GRADE WITH SUB-BASE MATERIAL, COMPACT TO 98%. COMPACT BASE AND SHOULDER MATERIAL TO DENSITY NOT LESS THAN 100% CORRECTED MAXIMUM DRY DENSITY.

6.9 REPLACE PAVEMENT DISTURBED BY CONSTRUCTION AND REPLACE WITH PAVEMENT STRUCTURE ABOVE 6.10 WHERE NEW ASPHALT COMES IN CONTACT WITH EXISTING PAVEMENT: SAWCUT EXISTING ASPHALT LAYER TO CREATE A CLEAN STRAIGHT

6.8 IN AREAS NOT ACCESSIBLE TO ROLLING EQUIPMENT, COMPACT TO SPECIFIED DENSITY WITH MECHANICAL TAMPERS.

EDGE. TACK COAT SHALL BE APPLIED TO ASPHALT SURFACES AT WHICH JOINTS ARE TO BE MADE INCLUDING EXISTING PAVEMENT SURFACES THAT HAVE BEEN CUT, GROUND OR MILLED. TACK COAT THE SURFACE OF ALL BINDER COURSES AND BUTTING CONCRETE SURFACES. SURFACES TO BE TACK COATED SHALL BE FREE OF STANDING WATER AND CONTAMINATION, SUCH AS MUD, LOOSE AGGREGATE OR DEBRIS AND SHALL BE DRY AND CLEAN WHEN THE TACK COAT IS APPLIED. TACK COAT SHALL BE PLACED SUFFICIENTLY AHEAD OF THE PAVING OPERATION TO ALLOW FOR CURING. PAVING AND CONSTRUCTION FOUIPMENT SHALL NOT BE PERMITTED ONTO THE TACK COAT. UNTIL IT HAS SET. TACK COAT MATERIAL SHALL CONSIST OF SS-1 EMULSIFIED ASPHALT DILUTED WITH AN EQUAL VOLUME OF WATER.

THE UNDILUTED MATERIAL SHALL BE ACCORDING TO OPSS 1103. 6.11 SHAPE BASE TO SMOOTH CONTOUR AND COMPACT TO NOT LESS THAN 100% CORRECTED MAXIMUM DRY DENSITY BEFORE BEGINNING PAVING OPERATIONS. 6.12 APPLY ASPHALTIC CONCRETE ONLY WHEN BASE OR PREVIOUS COURSE IS DRY AND AIR TEMPERATURE IS ABOVE 5 DEG.C


AREAS INACCESSIBLE TO A ROLLER. BEVEL EDGES ADJACENT TO GRANULAR SURFACES. 6.14 FINISH SURFACE SMOOTH, TRUE TO GRADE.

6.15 KEEP VEHICULAR TRAFFIC AND OTHER LOADS OFF NEWLY PAVED AREAS UNTIL 24 HOURS AFTER PAVING. 6.16 DIVERT UNUSED AND WASTE ASPHALT TO A FACILITY APPROVED FOR ACCEPTING SUCH MATERIALS.

6.17 APPLY TRAFFIC PAINT AS IDENTIFIED ON PLAN. TRAFFIC PAINT: NON-DARKENING, HOMOGENEOUS, UNIFORM AND SMOOTH, FREE FROM SKIN, DIRT AND OTHER FOREIGN PARTICLES. APPLY TO DRY PAVEMENT SURFACE FREE FROM FROST, ICE, DUST, OIL, GREASE AND OTHER FOREIGN MATERIALS. PROTECT PAVEMENT MARKINGS UNTIL DRY.

6.13 ROLL UNTIL ROLLER MARKS ARE ELIMINATED AND COMPACTED TO NOT LESS THAN 95% OF DENSITY. COMPACT WITH HOT TAMPERS IN

(EY PLAN

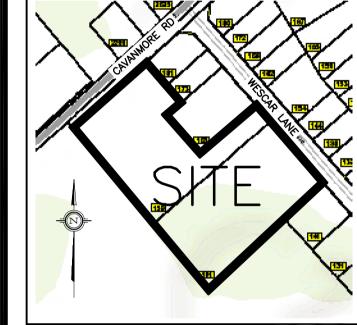

ı						
ı						
ı						
ı						
ı	6	AUG 22-24	RE-ISSUED FOR APPROVAL			
ı	5	JUL 10-24	ISSUED FOR BUILDING PERMIT			
ı	4	DEC 13-23	RE-ISSUED FOR APPROVAL			
ı	3	AUG 31-23	ISSUED FOR APPROVAL			
ı	2	AUG 16-23	ISSUED FOR COORDINATION			
ı	1	JUL 17-23	ISSUED FOR COORDINATION			
ı	No.	DATE	REVISION			


D.B. GRAY ENGINEERING INC. Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain


700 Long Point Circle 613-425-8044 Ottawa, Ontario d.gray@dbgrayengineering.com

SUNBELT RENTALS INC.— EQUIPMENT MAINTENANCE **FACILITY**

CARP, ONTARIO

NOTES & SCHEDULE





Drawing No. C - 15