

## WATERMAIN PROFILE TABLE

DIAMETER/MATERIAL: 250mm/PVC DR25

STATION	DESCRIPTION	GRADE ELEVATION	TOP OF PIPE	DEPTH OF COVER	NOTES
E+00.0	WATER FILL STATION	122.36	118.86	3.50	-
E+01.4	45° HORIZONTAL BEND TO CITY OF OTTAWA STANDARDS	121.84	118.91	2.93	-
E+08.6	-	121.81	119.00	2.81	BOTTOM OF SWALE
E+16.8	22.5° VERTICAL BEND UP TO CITY OF OTTAWA STANDARDS	122.54	119.00	3.53	TOP OF SLOPE
E+18.7	22.5° VERTICAL BEND DOWN TO CITY OF OTTAWA STANDARDS	122.49	119.78	2.71	-
E+27.2	-	122.41	119.78	2.63	CROSSING 450 ST U/S 120.77 WM TOP 119.78 - 990mm CLEARANCE (MIN. 500mm REQ'D)
E+29.4	-	122.44	119.78	2.66	BOTTOM OF CURB
E+31.9	-	122.18	119.78	2.40	BOTTOM OF CURB
E+59.1	-	122.16	119.76	2.40	BOTTOM OF CURB
E+62.5	-	122.19	119.75	2.44	CROSSING 450 ST U/S 120.68 WM TOP 119.75 - 930mm CLEARANCE (MIN. 500mm REQ'D) BOTTOM OF CURB
E+66.8	22.5° HORIZONTAL BEND TO CITY OF OTTAWA STANDARDS	122.13	119.73	2.40	-
E+96.4 (F+00.0)	250 TO 150 REDUCER	121.95	119.28	2.67	-


DIAMETER/MATERIAL: 150mm/PVC DR25

STATION	DESCRIPTION	GRADE ELEVATION	TOP OF PIPE	DEPTH OF COVER	NOTES
F+00.0 (E+96.4)	250 TO 150 REDUCER	121.95	119.28	2.67	-
F+01.0	FH-1 - FIRE HYDRANT AVK 2760 NOSTALGIC - SINGLE PUMPER TO AWWA C-502 & CITY OF OTTAWA STANDARDS	121.68	119.28	2.40	-

### LEGEND

- FFL FINISHED FLOOR ELEVATION
- USF UNDERSIDE OF FOOTING
- PROPERTY LINE
- CB [ ] CATCH-BASIN
- MH ( ) STORM MANHOLE
- CB/MH ( ) CATCH-BASIN/MANHOLE
- SAN - SANITARY SEWER
- SAN - SANITARY FORCEMAIN
- ST - STORM SEWER
- WL/WM - WELL WATER LINE/WATERMAIN
- SPL SPRINGLINE OF PIPE
- INV INVERT OF PIPE
- T.O.S - TOP OF SLOPE
- B.O.S - BOTTOM OF SLOPE
- CENTERLINE OF SWALE
- ===== 150mm BARRIER CURB

### KEY PLAN

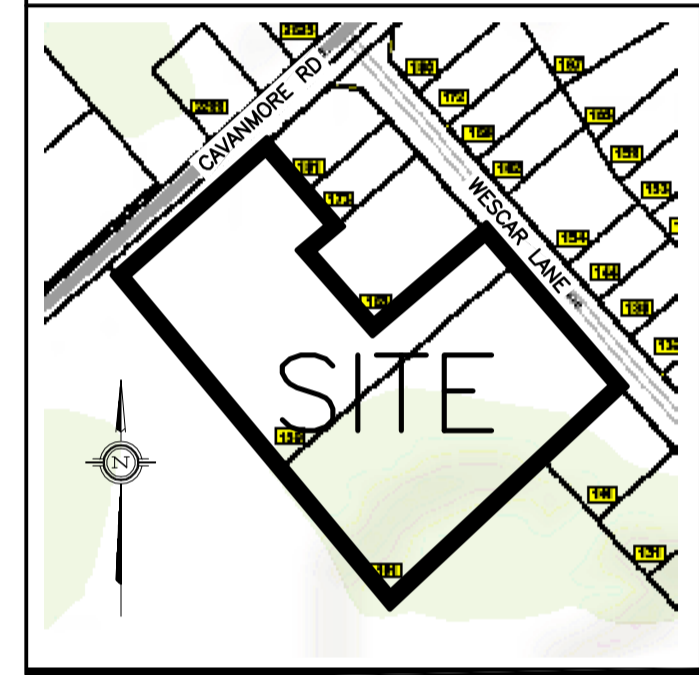

No.	DATE	REVISION
6	AUG 22-24	RE-ISSUED FOR APPROVAL
5	AUG 19-24	ISSUED TO OFS FOR APPROVAL OF FIRE TANKS & FHS LOCATION
4	JUL 10-24	ISSUED FOR BUILDING PERMIT
3	DEC 13-23	RE-ISSUED FOR APPROVAL
2	AUG 31-23	ISSUED FOR APPROVAL
1	AUG 16-23	ISSUED FOR COORDINATION

**D. B. GRAY ENGINEERING INC.**  
 Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain  
 700 Long Point Circle 613-425-8044  
 Ottawa, Ontario d.gray@dbgrayengineering.com

Project  
**SUNBELT RENTALS INC. - EQUIPMENT MAINTENANCE FACILITY**  
 CARP, ONTARIO

Drawing Title  
**WATER PROFILE TABLE**  
 (LINE E & F)

	Drawn D.B.G.
	H. Scale 1:250
	V. Scale
	Date AUG 16-23
Job No. 22111	Drawing No. C-8 of 17

REFER TO NOTES, DETAILS & SCHEDULES ON DRAWINGS C-7, C-9, C-13 & C-14