

JLR No.: 29899-002
Revision: 0

September 26, 2024

Prepared for:

12714001 CANADA INC.
100-768 Boulevard St-Joseph
Gatineau, QC
J8Y 4B8

Prepared by:

J.L. RICHARDS & ASSOCIATES LIMITED
343 Preston Street, Suite 900 and 1000
Ottawa, ON
K1S 1N4

Site Servicing Report

Residential Site Plan (Block 17)

**2983, 3053 and 3079 Navan Road & 2690 Pagé Road,
Ottawa, Ontario**



Site Servicing Report

Residential Site Plan (Block 17)

Table of Contents

1.0	INTRODUCTION.....	1
1.1	General.....	1
1.2	Site Description	1
1.3	Proposed Development.....	1
1.4	Proposed Connections to Existing Infrastructure	1
1.5	Consultation and Permits	1
2.0	WATER SERVICING	2
2.1	Water Supply Design Criteria.....	2
2.2	Domestic Water Demands	2
2.3	Fire Flow Requirements	3
2.4	Proposed Water Servicing, Boundary Conditions and Water Model	3
	2.4.1 Proposed Water Servicing	3
	2.4.2 Boundary Conditions	3
	2.4.3 Water Model.....	4
2.5	Simulation Results	4
	2.5.1 Peak Hour.....	4
	2.5.2 Maximum Day Plus Fire Flow	5
	2.5.3 Maximum Pressure	5
2.6	Summary and Conclusions	5
3.0	WASTEWATER SERVICING	6
3.1	Design Criteria.....	6
3.2	Proposed Sanitary Servicing and Design Flows	6
3.3	Summary and Conclusions.....	7
4.0	STORM SERVICING AND STORMWATER MANAGEMENT.....	8
4.1	Design Criteria.....	8
4.2	Proposed Stormwater Management Approach	8
4.3	Proposed Minor System Servicing.....	9
4.4	Stormwater Management Modelling Approach	9
	4.4.1 Dual Drainage Model	9
	4.4.2 Boundary Conditions	10
4.5	Modelling Parameters	10
	4.5.1 Hydrological Parameters.....	10
	4.5.2 Simulation of Storm Distributions.....	10
4.6	Simulation Results	10
	4.6.1 Low Point Ponding Analysis.....	10
	4.6.2 Roof Drainage.....	11
	4.6.3 Parking Lot Drainage	11
	4.6.4 Landscaped Drainage.....	12
	4.6.5 Building Release Rates.....	12
4.7	Summary and Conclusions.....	12
5.0	Erosion and Sedimentation Control.....	13

Site Servicing Report

Residential Site Plan (Block 17)

List of Tables

Table 1: Water Demands	3
Table 2: Hydraulic Boundary Conditions	4
Table 3: Watermain Internal Diameters and C-Factors	4
Table 4: Wastewater Key Design Parameters	6
Table 5: Sanitary Design Flow Summary.....	6
Table 6: Catchbasin Ponding Depths	11
Table 7: Parking Area ICD Capture Analysis	11
Table 8: Landscaped Area ICD Capture Analysis.....	12

List of Appendices

Appendix A	Concept Plan, Draft plan of Subdivision and Topographical Survey
Appendix B	Pre-Consultation Meeting Notes and Site Servicing Report Checklist
Appendix C	Water Servicing
Appendix D	Stormwater Management
Appendix E	Sanitary Servicing

Site Servicing Report

Residential Site Plan (Block 17)

1.0 INTRODUCTION

1.1 General

In 2023, J.L. Richards & Associates Limited (JLR) was retained by 12714001 Canada Inc. (the Owner) to prepare the detailed design of municipal infrastructure for Site Plan Approval (SPA) of the Mixed-Use Site Plan (Block 17). This Site Servicing Report (SSR) presents the servicing constraints and strategies for water, wastewater, stormwater servicing, and stormwater management in accordance with the City of Ottawa Design Guidelines, the associated technical bulletins and relevant design excerpts.

1.2 Site Description

The Residential Site Plan (Block 17) is located within the City of Ottawa's Official Plan boundary and consists of a 0.55 ha parcel bounded by Navan Road to the south, Page Road to the west, an existing property to the north, and the proposed East Ridge Orleans Subdivision to the east (as per the Site Servicing Report prepared by J.L. Richards and Associates, dated August 2024). The legal description of the subject property can be found in the Draft Plan of Subdivision attached to Appendix A.

A topographical survey was completed by Stantec Inc. in August 2024 (Appendix A). The survey indicates that the existing topography generally slopes downwards towards the intersection between Page Road and Navan Road.

1.3 Proposed Development

The proposed development will consist of two 4-story condominium buildings. Each building has 48 residential units, for a total of 96 residential units. The Concept Plan for the Residential Site Plan (Block 17) is attached to Appendix A.

1.4 Proposed Connections to Existing Infrastructure

Block 17 is proposed to be serviced by the infrastructure that is part of the East Ridge Orleans Subdivision. One sanitary, storm and water service lateral will extend to the parking garage footprint from the subdivision as shown in the servicing drawings.

1.5 Consultation and Permits

A pre-consultation meeting was held on September 13, 2023, to discuss the planning process, design criteria, and servicing constraints. A copy of the pre-consultation meeting notes and the site servicing checklist has been provided in Appendix B.

Site Servicing Report

Residential Site Plan (Block 17)

2.0 WATER SERVICING

2.1 Water Supply Design Criteria

A Hydraulic Network Analysis (HNA) was completed as part of the detailed design for the East Ridge Orleans subdivision to confirm that the proposed watermains could provide adequate supply while complying with both the Ottawa Design Guidelines for Water Distribution (July 2010) and Technical Bulletins ISDTB-2014-02, ISTB-2018-02 and ISTB-2021-03. These documents are herein referred to as the Design Guidelines and TB-2014-02, TB-2018-02, and TB-2021-03, respectively.

The HNA completed as part of the East Ridge Orleans Subdivision design included water demands for the Residential Site Plan (Block 17). The HNA has since been updated to reflect the proposed water service lateral for Block 17 but is based on the same demands and the boundary conditions used in the original East Ridge Orleans Subdivision HNA (refer to Appendix C for a copy of City correspondence for boundary conditions).

Section 4.2.2 of the Design Guidelines states the following criteria for development additions to the public water distribution system:

- Under maximum hourly demand conditions (peak hour), the residual pressures shall not be less than 276 kPa (40 psi);
- During periods of maximum day and fire flow demand, the residual pressure at any point in the distribution system shall not be less than 140 kPa (20 psi);
- In accordance with the Ontario Building Code (OBC) in areas that may be occupied, the static pressure at any fixture shall not exceed 552 kPa (80 psi);
- The maximum pressure at any point in the distribution system in unoccupied areas shall not exceed 689 kPa (100 psi); and
- Feeder mains, which have been provided primarily for the purpose of redundancy, shall meet, at a minimum, the basic day plus fire flow demand.

2.2 Domestic Water Demands

The water demands presented in this section are based on the site layout and unit count shown in the Site Plan (Appendix A). Domestic water demands were calculated for 96 apartment units with an average density of 1.8 persons per unit, giving a total population of 173 people.

The residential consumption rates for average day, maximum day, and peak hour demand were set in accordance with Table 4-2 of the Design Guidelines. Table 1 summarizes the water consumption rates and peaking factors used in the HNA.

Site Servicing Report

Residential Site Plan (Block 17)

Table 1: Water Demands

Demand Scenario	Residential Water Consumption or Peaking Factor	Total Demands (L/s)
Average Day Demand	280 L/c/d	0.56
Maximum Day Demand	2.5 x Avg Day	1.40
Peak Hour Demand	2.2 x Max Day	3.08

2.3 Fire Flow Requirements

The City has specified that the Fire Underwriters Survey (FUS) method shall be used for any public or private site where new fire hydrants are being designed. Specifically, the required fire flow (RFF) for each structure was calculated in accordance with TB-2018-02.

The required fire flow for the Residential Site Plan (Block 17) was calculated as 233 L/s for Building E and 250 L/s for Building F. Refer to Appendix C for the detailed RFF calculations for the critical fire area.

Both buildings within Block 17 will be equipped with a fully supervised automatic sprinkler designed and installed in accordance with NFPA 13. In the analysis, a sprinkler flow of 1500 L/min (25 L/s) was applied to each building as recommended by the Owner's Mechanical Engineer (refer to Appendix C).

2.4 Proposed Water Servicing, Boundary Conditions and Water Model

2.4.1 Proposed Water Servicing

Water will be supplied to the Residential Site Plan (Block 17) by a 150 mm diameter water service that will connect to the 200 mm diameter watermain loop within the East Ridge Orleans subdivision. Fire protection will be provided by each building's sprinkler system, the proposed hydrants within the East Ridge Orleans Subdivision, and the existing hydrants on Navan Road and Page Road. The Siamese connection for each building is located no more than 45 m way from a hydrant as required by the OBC (refer to hydrant coverage markup in Appendix C).

2.4.2 Boundary Conditions

Hydraulic boundary conditions were provided by the City at the two proposed connection locations for the East Ridge Orleans subdivision (Connection 1 and Connection 2). Table 2 summarizes the hydraulic boundary conditions received (refer to Appendix C for a copy of the City correspondence).

The boundary condition for 250 L/s was used in this analysis since this is the maximum required fire flow for the site (refer to Section 2.3).

Site Servicing Report

Residential Site Plan (Block 17)

Table 2: Hydraulic Boundary Conditions

Demand Scenarios	Connection 1 Head (m)	Connection 2 Head (m)
Maximum HGL	130.7	130.7
Peak Hour	127.0	126.8
Max Day plus Fire Flow #4 15,000 L/min (250.00 L/s)	124.4	121.9

2.4.3 Water Model

A hydraulic water model within the WaterCAD® software platform was used to carry out the HNA (refer to the overall schematics presented in Appendix C). The water demands from Table 1 and the boundary conditions from Table 2 were input into the model for each demand scenario. Table 3 summarizes the watermain diameters and roughness coefficients used in the model, based on Sections 4.2.12 and 4.3.5 of the Design Guidelines.

Table 3: Watermain Internal Diameters and C-Factors

Nominal Diameter	Inside Diameter	C-Factor
150 mm	155 mm	100
200 mm	204 mm	110
300 mm	297 mm	120

2.5 Simulation Results

The HNA was carried out under steady-state peak hour, maximum day plus fire flow, and maximum pressure conditions to confirm that the proposed water servicing can meet the design criteria outlined in Section 2.1.

2.5.1 Peak Hour

The simulation results found the minimum pressure at the site during the peak hour condition to be 433 kPa (62.8psi) (refer to Appendix C), which exceeds the minimum pressure criterion of 276 kPa (40 psi) per the Design Guidelines.

Site Servicing Report

Residential Site Plan (Block 17)

2.5.2 Maximum Day Plus Fire Flow

Fire water supply will be provided by the fully automatic sprinkler system, a proposed hydrant within the East Ridge Orleans subdivision, and existing hydrants on Page Road and Navan Road. To ensure adequate fire protection, the maximum day demand shown in Table 1 was analyzed simultaneously with the fire flow requirements. As mentioned in Section 2.3, a sprinkler system flow of 1,500 L/min (25 L/s) was assumed for Block 17, and it was assumed that only one (1) building would require fire flow at once.

Once the maximum day demands, the sprinkler demands, and the 15,000 L/min (250 L/s) boundary condition provided by the City (refer to Table 2) were input in the model, the fire flow simulation was carried out by allowing WaterCAD® to calculate the available fire flow that can be drawn from a hydrant without allowing any part of the system to experience pressures less than 140 kPa (20 psi).

From the simulation results, the system is expected to deliver a minimum of 15,000 L/min (250 L/s) to the site through the contribution of the sprinkler system and the nearby hydrants. Attached to Appendix C is a map of the hydrant coverage for Block 17 which confirms that both buildings within the block meet the RFF of 250 L/s through the aggregate sum of hydrant flows. Based on Appendix I of TB-2018-02 hydrants within 75 m of a building can provide 95 L/s of fire flow and hydrants within 75 to 150 m of a building can provide 63 L/s of fire flow.

2.5.3 Maximum Pressure

Based on a zero (0 L/s) demand condition, the simulation results found the maximum pressure at the site to be 468 kPa (67.9 psi). This value is below the maximum pressure constraint of 552 kPa (80 psi), therefore pressure reducing valves are not anticipated to be required.

2.6 Summary and Conclusions

Based on the water simulation results, the proposed development can be serviced by the proposed 150 mm water service lateral connected to the 200 mm watermain loop within the East Ridge Orleans Subdivision. Furthermore, adequate water supply can be achieved from the proposed hydrants within the East Ridge Orleans Subdivision, and existing hydrants on Page Road and Navan Road.

Site Servicing Report

Residential Site Plan (Block 17)

3.0 WASTEWATER SERVICING

3.1 Design Criteria

The sanitary sewer system within the Residential Site Plan (Block 17) is designed in accordance with the Ottawa Sewer Design Guidelines and subsequent technical bulletins. The design parameters are applied under two scenarios as per ISTB Technical Bulletin 2018-01. The key design parameters have been summarized in Table 4.

Table 4: Wastewater Key Design Parameters

Design Parameter	Design Value
Average Apartment	1.8 ppu
Residential Average Flow	280 L/Cap/Day
Residential Peaking Factor	Harmon's Formula
Harmon's Correction Factor (K)	0.8
Infiltration Allowance	0.33 L/s/ha
Manning's Roughness Coefficient (n)	0.013
Allowable Slopes	Varies (Refer to Section 6.1.2.2 of ODSG)
Allowable Velocities	0.6 m/s – 3.0 m/s
Allowable Freeboard	-

3.2 Proposed Sanitary Servicing and Design Flows

Wastewater generated from the Residential Site Plan (Block 17) will be conveyed via a proposed 200 mm diameter sanitary service lateral, which will then discharge into the East Ridge Orleans Subdivision as shown in the Servicing Drawing.

Wastewater flows from the proposed development are presented in the Residential Site Plan (Block 17) Sanitary Design Sheet (refer to Appendix E). Based on the design criteria (Table 4) and the site constraints, a total design peak flow of 2.16 L/s is calculated for the development. Table 5 summarizes the results from the sanitary design sheet.

Table 5: Sanitary Design Flow Summary

Area	Site Area	Unit Count	Unit Density	Pop.	Harmon's Peaking Factor	Res. Peak Flow	Comm. Peak Flow	Infil. Flow	Total Flow
Block 17	0.55 ha	96	1.8 ppu	173 persons	3.54	1.98 L/s	0.0 L/s	0.18 L/s	2.16 L/s

A 200 mm diameter sanitary service lateral is expected to have sufficient capacity to convey the wastewater flows for the site. The flows from this block were already incorporated in the design of the sanitary sewer for the subdivision (refer to the East Ridge Orleans Subdivision Site Servicing Report prepared by J.L. Richards and Associates, dated August 2024). As shown in this report, the subdivision will consist of 200 mm diameter pipes which will have, at minimum,

Site Servicing Report

Residential Site Plan (Block 17)

20.24 L/s of capacity. Furthermore, the overall subdivision inclusive of the Site Plan Blocks 14, 15 and 17 is expected to generate 12.98 L/s of wastewater flows which is less than the minimum expected capacity of the pipes by 35%. Therefore, it is anticipated that the sanitary sewer system downstream will have sufficient capacity for the 2.17 L/s of wastewater flows generated by Block 17.

Furthermore, it has been confirmed by the Owner's Mechanical Engineer that a 200mm diameter service will be sufficient to convey the flows generated by the mechanical fixtures (refer to Appendix E).

3.3 Summary and Conclusions

Wastewater servicing for Block 17 will be designed in accordance with the City of Ottawa Sewer Design Guidelines, the associated technical bulletins, and various background documents as highlighted throughout this section. Wastewater will be conveyed via a proposed 200 mm diameter sanitary service lateral which will then discharge into the East Ridge Orleans Subdivision. It is recommended that this wastewater servicing plan be implemented to provide adequate sanitary servicing for the proposed development.

Site Servicing Report

Residential Site Plan (Block 17)

4.0 STORM SERVICING AND STORMWATER MANAGEMENT

4.1 Design Criteria

Storm and stormwater management servicing for the Residential Site Plan (Block 17) was developed in accordance with the City of Ottawa 2012 Sewer Design Guidelines (OSDG) and the more recent Technical Bulletin PIEDTB-2016-01 (September 6, 2016). These two documents are herein referred to as the Design Guidelines in this section. A summary of the key storm and stormwater management criteria follows:

- Control minor system flows to the allowable release rates of 48 L/s as identified in Table 5-4 Site Servicing Report 2983, 3053 and 3079 Navan Road & 2690 Pagé Road, Ottawa, Ontario (JLR 2024);
- Proposed Storm sewers are designed to capture the 1:2-year storm event and the 1:10-year peak flows on Navan Road as a minimum using the Rational Method and using the regressions derived from Intensity-Duration-Frequency (IDF) equations as per the Design Guidelines;
- Provide a freeboard in the sewer network to the underside of footing (USF) of 300 mm during the 1:100-year storm where weeping tile connections are present;
- The runoff coefficients (C-factors) to be calculated based on the ratio of pervious and impervious surfaces depicted on proposed site plans;
- ;
- Minimum roadway slope of 0.1% from crest-to-crest for overland flow route;
- Minimum rear yard slope in the absence of perforated pipe system of 1.5% along with swale side slopes of 3 horizontal to 1 vertical;
- Maximum parking ponding depth of 350 mm (static and dynamic) as per the Design Guidelines and maximum depth of rear yard flow to be 300 mm;
- Minimum vertical clearance of 0.15 m between the spill elevation on the street and the finished grade (garage elevation);
- Minimum vertical clearance of 0.30 m between the rear yard spill elevation and the ground elevation at the building in the rear yards;
- Major system flows, up to and including the 1:100-year design storm event, are contained within the site using the parking lot area and surface drainage;
- Peak flows estimated based on an inlet time of ten (10) minutes, as per the Technical Bulletin ISDTB-2012-4.
- Quality control will be accommodated by Pond #3 to meet an MECP Enhanced Level of Protection (80% TSS removal).
- Provide measures to ensure that site preparation and construction is in accordance with the current Best Management Practices for Erosion and Sediment Control.

4.2 Proposed Stormwater Management Approach

In order to achieve the allowable release rates, the stormwater management of the site will include:

- Rooftop control with rooftop storage and released at a cumulative controlled release rate of 2 L/s for each building; per WATTS RD-200 detail for Small Area Roof Drain (Appendix D) and as recommended by the landowner's mechanical engineer.

Site Servicing Report

Residential Site Plan (Block 17)

- Surface storage within the parking lots in greater than a 1:2-year event with captured flows conveyed to the building plumbing system and internal cistern;
- Ramp runoff captured and conveyed to the building plumbing system and internal cistern;
- Storage in the building cistern with flows pumped at a controlled rate to the minor system with a backwater valve at the connection; and,
- Controlled release of the flows captured in the ditch drainage system for the surrounding landscaped areas.

Foundation drains will be connected to the internal building plumbing system therefore no HGL analysis is required.

4.3 Proposed Minor System Servicing

A minor system connection will be provided from the building envelope to the minor system within the subdivision. The connection will be sized based on the 1:2-year release from the site. The runoff coefficient is based on the ratio of impervious surfaces and grassed or landscaped areas. The breakdown between pervious and impervious surfaces is shown on the figure entitled Overall Site Imperviousness in Appendix D. A design sheet for sizing of the connection and sizing of pipes internal to the site is provided in Appendix D.

4.4 Stormwater Management Modelling Approach

4.4.1 Dual Drainage Model

The analysis of both major and minor drainage systems was carried out to demonstrate their compliance with respect to the design criteria described in Section 4.1. The performance of the major overland system and minor storm sewer system was analyzed with PCSWMM. This software is a dynamic model which allows both hydrologic and hydraulic components to be simulated in the same platform and also allows the simulation of the interaction between the major and minor systems. The PCSWMM software platform was used to:

- Generate the surface runoff hydrograph for each sub-area under various recurrences.
- Subdivide each inflow hydrograph into its minor and major system components based on the proposed inlet capture rates and roadway sag storage.
- Assess cascading, if any, and carry out dynamic routing of storm flows to determine flow depths along the roadways. As previously stated, the maximum major overland flow depths within the parking lot areas are to be limited to 350 mm or less, as per Technical Bulletin PIEDTB-2016-01.

PCSWMM was set-up to evaluate the proposed servicing as detailed on Drawing C01 and C02. Subcatchments were delineated for the structure roof areas, parking lot low points and landscaped low points. Model schematics are prepared in Appendix D.

Site Servicing Report

Residential Site Plan (Block 17)

4.4.2 Boundary Conditions

Boundary conditions are taken from the downstream subdivision model issued as part of the Site Servicing Report 2983, 3053 and 3079 Navan Road & 2690 Pagé Road, Ottawa, Ontario (JLR 2024).

The downstream 1:100-year HGL at the connection to the Subdivision at MH504 is identified as 78.75 m which is lower than any minor system within the site and therefore there is no backflow from the boundary condition and no impacts on HGL.

4.5 Modelling Parameters

4.5.1 Hydrological Parameters

The following parameters were used in the hydrologic component of PCSWMM:

- **Areas and Imperviousness:** Catchment ID and drainage areas used by PCSWMM match those shown on either Drawing DST or Figure E-1 (Appendix E1).
- **Catchment Width:** The catchment width is estimated at the width of overland sheet flow based on the grading of the catchment and slope direction.
- **Manning's Roughness Coefficient:** Manning's Roughness Coefficients of 0.013 and 0.25 were used for the impervious and pervious surfaces, respectively.
- **Horton Infiltration parameters:** City of Ottawa OSDG Horton Infiltration Parameters have been used in the modelling.
- **Initial Abstraction:** Initial abstraction of 4.67 mm and 1.57 mm was used for the pervious and impervious surfaces respectively, consistent with the OSDG.

4.5.2 Simulation of Storm Distributions

To assess peak flow rates and peak volume storage requirements the 3-hour Chicago storm has been simulated for the site for the 1:2-year event and 1:100-year event and the 24-hour SCS storms for the 1:100-year event.

4.6 Simulation Results

4.6.1 Low Point Ponding Analysis

Ponding depths in the low points in the parking area and landscaped areas are shown in Table 6.

Site Servicing Report

Residential Site Plan (Block 17)

Table 6: Catchbasin Ponding Depths

Low Point ID	Top of Grate (m)	Maximum Static Depth (mm)	3-hour Chicago 1:2 year Depth (mm)	3-hour Chicago 1:100 year Depth (mm)	24-hour SCS 1:100 year Depth (mm)
1	82.10	300	30*	100	50
2	82.28	300	10*	60	50
3	80.80	250	0	180	170
4	81.05	200	0	0	0
5	82.00	200	0	60	60

Those values marked with * are greater than 0 mm in the 2-year event due to the model setup. In order to represent the Zurn inlet control device, the orifice has been set at the top of grate elevation as the control is at the surface. Therefore, the model requires a head buildup over the structure for simulation of flows.

The simulation results compiled in Table 6 shows that:

- No ponding nor dynamic flow will occur in the 1:2-year event;
- Maximum ponding depth of 180 mm during the 1:100-year event; and,
- There is no spill from the site in the 1:100-year event.

4.6.2 Roof Drainage

The roof drainage system is to be designed by the Mechanical Engineer to achieve a flow rate of 2 L/s from each roof structure. The maximum depth of ponding required, assuming storage across 66% of the rooftop area, is 80 mm.

4.6.3 Parking Lot Drainage

The parking lot drainage system connects to the building cistern and is controlled by the ZURN_Z150F-6NH (detail provided in Appendix D) to allow the 1:2-year event to drain and for the surface to provide storage during greater events up to the 1:100 year. Capture rates are shown in **Error! Reference source not found.**

Table 7: Parking Area ICD Capture Analysis

Low Point	ICD Type	1:2 year Rational Flow (l/s)	1:100 year 3-hour Chicago Flow (l/s)	1:100 year 3-hour Chicago Head (m)
1	ZURN_Z150F-6NH	16	43	100
2		8	39	60

The table shows that the parking lot ICDs capture the 1:2-year design flow.

Site Servicing Report

Residential Site Plan (Block 17)

4.6.4 Landscaped Drainage

The landscaped drainage consists of typical rear yard system of swales and perforated pipes. The rear-yard system is connected to the building internal piping, upstream of the cistern. Flows are controlled using inlet control devices sized to ensure that the ponding criteria is met and sizing of the cistern is optimized. Capture rates and ponding depths are shown in Table 8.

Table 8: Landscaped Area ICD Capture Analysis

Low Point	ICD Type	1:2 year Rational Flow (l/s)	1:100 year 3-hour Chicago Flow (l/s)	1:100 year 3-hour Chicago Head (m)
3	Vortex_ICD_70	3	6	180
4		1		0
5	Vortex_ICD_70	2	6	60

The table above demonstrates that the landscaped area ICDs capture the 1:2-year design flow.

4.6.5 Building Release Rates

The allowable release rate from the site is calculated based on 85 L/s/ha for areas within the site extents and 43 L/s/ha for existing rear-yards draining into the site. In order to maintain flows within the allowable range, the building drainage system will be controlled to 41 L/s and both roof drains will each account for an additional 2 L/s. This remains below the allowable release rate of 47 L/s for the area draining into the subdivision. Based on a pumped rate of 41 L/s a cistern size of 49 m³ is required in the building basement.

4.7 Summary and Conclusions

The stormwater servicing achieves a release rate from the site to the minor system limited to the allowable release rate and contains up to the 1:100 year on site.

Site Servicing Report

Residential Site Plan (Block 17)

5.0 Erosion and Sedimentation Control

Erosion and sediment control measures, as outlined in the Ontario Ministry of Natural Resources (MNR) Guidelines on Erosion and Sediment Control for Urban Construction Sites, will be implemented to trap sediment on site. The following erosion and sediment control measures can be implemented during construction as shown on the Erosion and Sediment Control Plan (Drawing C04):

- Supply and installation of a silt fence barrier, as per OPSD 219.110.
- Supply and installation of siltsack or sentinel CB inserts between the frame and cover of catch basins and maintenance holes adjacent to the project area during construction, to prevent sediment from entering the sewer system.
- Stockpiling of material during construction is to be located along flat areas away from drainage paths. For material placed on sloped areas, stockpiles are to be enclosed with a silt fence to protect watercourses.
- All catch basins are to be equipped with sumps, inspected frequently, and cleaned as required.
- Temporary ICDs are to be placed blocking part of the sewer pipe in the connecting storm maintenance holes to eliminate construction debris from entering the existing storm sewer system. The ICDs are to be removed after the proposed storm sewers have been fully cleaned.

The proposed removal and reinstatement measures as well as the erosion control measures shall conform to the following documents:

- “Guidelines on Erosion and Sediment Control for Urban Construction Sites” published by Ontario Ministries of Natural Resources, Environment, Municipal Affairs, and Transportation & Communication, Association of Construction Authorities of Ontario and Urban Development Institute, Ontario, May 1987.
- “MTO Drainage Manual”, Chapter F: “Erosion of Materials and Sediment Control”, Ministry of Transportation & Communications, 1985.
- “Erosion and Sediment Control” Training Manual by Ministry of Environment, Spring 1998.
- Applicable Regulations and Guidelines of the Ministry of Natural Resources.

Site Servicing Report

Residential Site Plan (Block 17)

This report has been prepared by J.L. Richards & Associates Limited for Minto Communities Inc.'s exclusive use. Its discussions and conclusions are summary in nature and cannot properly be used, interpreted or extended to other purposes without a detailed understanding and discussions with the client as to its mandated purpose, scope and limitations. This report is based on information, drawings, data, or reports provided by the named client, its agents, and certain other suppliers or third parties, as applicable, and relies upon the accuracy and completeness of such information. Any inaccuracy or omissions in information provided, or changes to applications, designs, or materials may have a significant impact on the accuracy, reliability, findings, or conclusions of this report.

This report was prepared for the sole benefit and use of the named client and may not be used or relied on by any other party without the express written consent of J.L. Richards & Associates Limited, and anyone intending to rely upon this report is advised to contact J.L. Richards & Associates Limited in order to obtain permission and to ensure that the report is suitable for their purpose.

J.L. RICHARDS & ASSOCIATES LIMITED

Water and Wastewater
Prepared by:

Stormwater
Prepared by:

Felipe Abello
Engineering Graduate

Mathieu Lacelle, EIT
Engineering Graduate

Reviewed by:

Reviewed by:

Karla Ferrey, P.Eng.,
Senior Associate, Manager, Ottawa, Civil
Development, Senior Civil Engineer

Bobby Pettigrew, P. Eng.,
Associate, Senior Water Resources Engineer,
Water Resources Practice Lead

Site Servicing Report

2983, 3053 and 3079 Navan Road & 2690 Pagé Road, Ottawa, Ontario

Appendix A

Concept Plan, Draft Plan of
Subdivision and Topographical
Survey



LOTS AREAS		LOTS AREAS	
LOT NUMBER	AREAS (M2)	LOT NUMBER	AREAS (M2)
B01-1	394	B06-4	154
B01-2	184	B06-5	163
B01-3	184	B06-6	154
B01-4	189	B06-7	369
B01-5	189	B07	2,002
B01-6	184	B08-1	525
B01-7	184	B08-2	174
B01-8	299	B08-3	184
B02-1	281	B08-4	174
B02-2	176	B08-5	184
B02-3	184	B08-6	174
B02-4	184	B08-7	234
B02-5	174	B09-1	234
B02-6	233	B09-2	174
B03-1	250	B09-3	184
B03-2	182	B09-4	184
B03-3	182	B09-5	174
B03-4	182	B09-6	234
B03-5	182	B10-1	234
B03-6	182	B10-2	174
B03-7	250	B10-3	184
B04-1	233	B10-4	184
B04-2	174	B10-5	174
B04-3	184	B10-6	487
B04-4	174	B11-1	748
B04-5	184	B11-2	286
B04-6	174	B11-3	265
B04-7	278	B11-4	246
B05-1	368	B11-5	242
B05-2	154	B11-6	242
B05-3	163	B11-7	321
B05-4	163	B12	240
B05-5	154	B13	1,232
B05-6	206	B14	5,728
B06-1	206	B16	7,811
B06-2	154	B17	5,312
B06-3	163		

SITE PLAN LEGEND	
	EXISTING BUILDING
	NEW BUILDING
	NEW BUILDING WITH COMMERCIAL SPACE AT-GRADE
	GRASS
	ASPHALT
	LOT LINE
	SETBACKS
	NEW TREE
	FIREWALL
	SIDEWALK

SITE INFORMATION & DEVELOPMENT STATISTICS

LOTS	PIN	
	04756-0303	
	04756-0315	
	04756-0316	
	04756-1337	
ZONING	GM(2546) H(14.5)	
SITE AREA		
TOTAL SITE AREA:	~53,441.14 m ² (5.34ha)	
TOTAL DEVELOPABLE AREA:	~45,956.28 m ² (4.59ha)	
NET SITE AREA:	~38,956.28 m ² (3.89ha)	
UNITS		
TOWNHOUSES:		
MAIN UNIT:	67 UNITS	
BASEMENT UNIT:	67 UNITS	
TOTAL NUMBER OF UNITS:	134 UNITS	
BLOCK 01:		
1 X RESIDENTIAL APARTMENT BUILDING	48 UNITS	
1 X MIXED USE BUILDING		
RESIDENTIAL:	36 UNITS	
COMMERCIAL SPACES:	~899 m ²	
BLOCK 02:		
1 X RESIDENTIAL APARTMENT BUILDING	47 UNITS	
1 X MIXED USE BUILDING		
RESIDENTIAL:	36 UNITS	
COMMERCIAL SPACES:	~899 m ²	
BLOCK 03:		
2 X RESIDENTIAL APARTMENT BUILDING	96 UNITS	
TOTAL NUMBER OF UNITS:	397 UNITS	
TOTAL COMMERCIAL SPACES:	~1,798 m ²	
	REQUIRED	PROVIDED
MAXIMUM DENSITY	NO MAX.	102 units/net ha
MINIMUM LOT WIDTH	NO MIN.	5.8 m
MINIMUM LOT AREA	NO MIN.	174 m ²
MAXIMUM BUILDING HEIGHT	14.5 m	14.5 m
SETBACKS		
MINIMUM FRONT YARD:	3 m	3 m
MINIMUM CORNER SIDE YARD:	3 m	3 m
MINIMUM INTERIOR SIDE YARD:		
NON-RESIDENTIAL OR MIXED-USE:	5 m	5 m
LOW-RISE RESIDENTIAL :	1.2 m	1.2 m
MID-RISE RESIDENTIAL :	3 m	3 m
MINIMUM REAR YARD:		
ABUTTING A STREET:	3 m	3 m
FROM A RESIDENTIAL ZONE:	7.5 m	7.5 m
FOR A RESIDENTIAL BUILDING:	7.5 m	7.5 m
PARKING RATES		
R9 - TOWNHOUSES:	1 p/main unit = 67	67 (GARAGES)
VISITOR:	0	67 DRIVE AISLES
BLOCK 14:		
R12 - APARTEMENTS	1.0 p/unit = 84	84 (UNDERGROUND)
VISITOR:	0.2 p/unit = 17	18 (UNDERGROUND)
N79 - RETAIL STORE:	3.4 p/100 m ² GFA = 30.6	32 (EXTERIOR)
		TOTAL: 134
BLOCK 15:		
R12 - APARTEMENTS	1.0 p/unit = 83	83 (UNDERGROUND)
VISITOR:	0.2 p/unit = 16.6	16 (UNDERGROUND)
N79 - RETAIL STORE:	3.4 p/100 m ² GFA = 30.6	32 (EXTERIOR)
		TOTAL: 131
BLOCK 17:		
R12 - APARTEMENTS	1.0 p/unit = 96	96 (UNDERGROUND)
VISITOR:	0.2 p/unit = 19.2	19 (15 EXT. + 4 UND.)
		TOTAL: 115
GROSS FLOOR AREA		
TOWNHOUSE A:		267 m ²
TOWNHOUSE B:		239 m ²
TOWNHOUSE C:		232 m ²
TOWNHOUSE D (CORNER UNIT):		236 m ²
TOWNHOUSE E:		225 m ²
TOTAL MODEL 01 (ABBBBBBA)		1,968 m ²
TOTAL MODEL 02 (ABBBBBBA)		1,729 m ²
TOTAL MODEL 03 (ABBBBBBA)		1,490 m ²
TOTAL MODEL 04 (CDDCDDC)		1,611 m ²
TOTAL MODEL 05 (CDDCDDC)		1,386 m ²
MIXED USE BUILDING (TOTAL OF 2 BUILDINGS):		
RESIDENTIAL:		3,927 m ²
COMMERCIAL:		899 m ²
RESIDENTIAL APARTMENT BUILDING (TOTAL OF 4 BUILDINGS):		
RESIDENTIAL:		3,927 m ²
RESIDENTIAL:		3,927 m ²
NOTE		
1. ASSUMES TYPICAL RESIDENTIAL FLOOR HEIGHT OF 3m.		
2. THE BASE PLAN (LOT LINES, EXISTING ROADS AND SURROUNDING AREAS) IS BASED ON THE TOPOGRAPHICAL PLAN OF SURVEY, SURVEYED STANTEC GEOMATICS LTD.		
3. DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048.		

NAVAN ROAD DEVELOPMENT

2983, Navan Road, Orleans, ON K1C 7G4

OWNER: Group of PMA ARCHITECTES

ARCHITECTURAL: PMA ARCHITECTES

(416) 851-8954
INFO@PMAARCHITECTES.COM

3070, CHEMIN DES QUATRE-BORDEURS
QUÉBEC, QC G1W 2M4
PMAARCHITECTES.COM

L'Atelier architectes

53, BOUL. SAINT-RAYMOND,
GATINEAU, QC J8Y 1R8

CIVIL ENGINEERS / PLANNER: J.L. Richards

ENGINEERS - ARCHITECTS - PLANNERS

1565 CARLING AVENUE, SUITE 700,
OTTAWA, ON K1Z 6R1

MECHANICAL & ELECTRICAL ENGINEERS: M&E ENGINEERING

9 GURDWARA ROAD, UNIT 200,
OTTAWA, ON K2E 7X6

SURVEYOR: Stantec

1331 CLYDE AVENUE, SUITE 400,
OTTAWA, ON K2C 3G4

ARCHITECT SEAL

REVISIONS		
NO	DESCRIPTION	DATE
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		

NOTE

IT IS THE RESPONSIBILITY OF THE APPROPRIATE CONTRACTOR TO CHECK AND VERIFY ALL DIMENSIONS ON THE SITE AND TO REPORT ALL ERRORS AND/OR OMISSIONS TO THE ARCHITECT. ALL CONTRACTORS MUST COMPLY WITH ALL PERTINENT CODES AND BY-LAWS. DO NOT SCALE DRAWINGS.

THIS DOCUMENT AND ITS CONTENT IS COPYRIGHTED. ANY REPRODUCTION IS PROHIBITED UNLESS GRANTED BY THE ARCHITECT.

DO NOT USE FOR CONSTRUCTION

DATE	DESIGNED
2024-08-20	P.POMERLEAU
DATE	DRAWN
	P.POMERLEAU
PROJECT No	CHECKED
20554	P.MARTIN
SHEET TITLE	
GLOBAL SITE PLAN	

SHEET No: A100


Autodesk Docs://NAVAN ROAD/20554_DEV/NAVAN_SITE_PLAN_LR24.rvt

PLAN 4M-

I CERTIFY THAT THIS PLAN IS REGISTERED IN THE LAND REGISTRY OFFICE FOR THE LAND TITLES DIVISION OF OTTAWA-CARLETON (NO. 4) AT... ON CLOCK ON THE... DAY OF... 2024 AND ENTERED IN THE REGISTER FOR P.L.N.'S 04756-0303, 04756-0315, 04756-0316 & 04756-1337, AND THE REQUIRED CONSENTS ARE REGISTERED AS PLAN DOCUMENT NUMBER OC-... REPRESENTATIVE FOR LAND REGISTRAR

APPROVED UNDER SECTION 51 OF THE PLANNING ACT BY THE CITY OF OTTAWA THIS... DAY OF... 20... VIVI CHI, INTERIM GENERAL MANAGER PLANNING, PLANNING, DEVELOPMENT AND BUILDING SERVICES DEPARTMENT, CITY OF OTTAWA

PAGE ROAD ROAD ALLOWANCE BETWEEN LOTS 5 & 6 (AS WIDENED) PIN 04404-0409

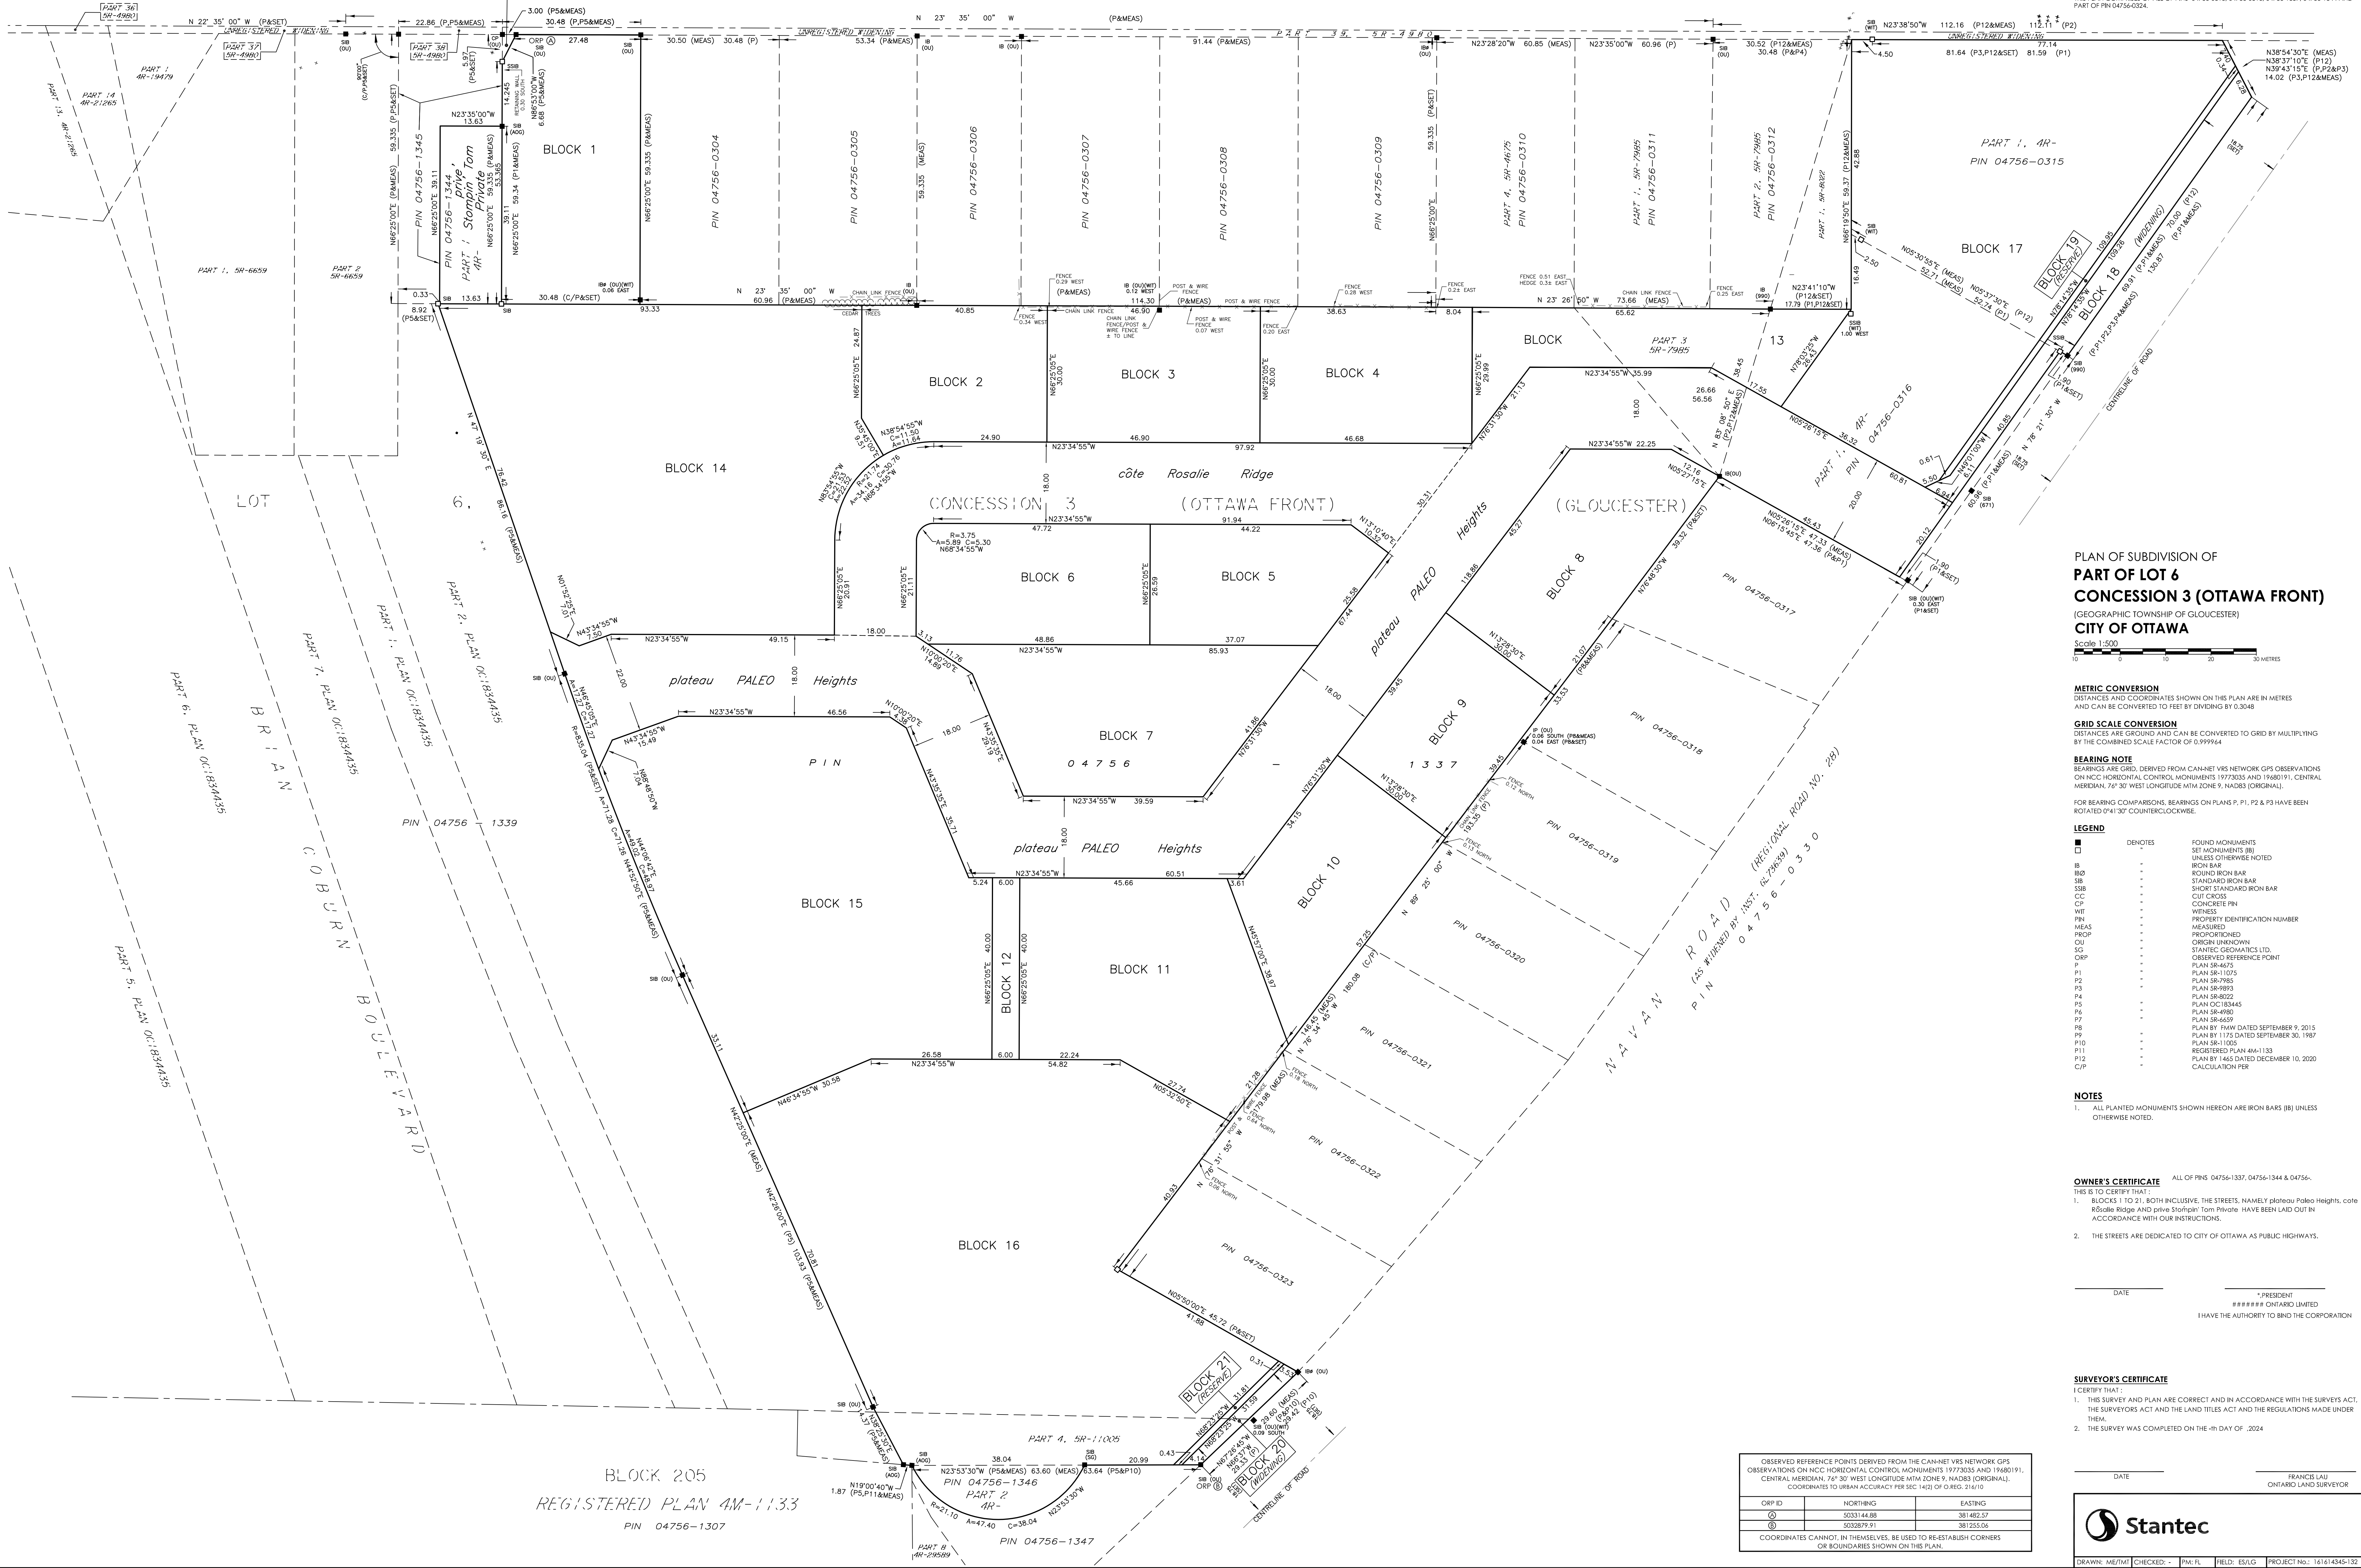

PLAN OF SUBDIVISION OF PART OF LOT 6 CONCESSION 3 (OTTAWA FRONT) CITY OF OTTAWA

Scale 1:500

METRIC CONVERSION DISTANCES AND COORDINATES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

GRID SCALE CONVERSION DISTANCES ARE GROUND AND CAN BE CONVERTED TO GRID BY MULTIPLYING BY THE COMBINED SCALE FACTOR OF 0.999914

BEARING NOTE BEARINGS ARE GRID, DERIVED FROM CANMET VRS NETWORK GPS OBSERVATIONS ON NCC-HORIZONTAL CONTROL MONUMENTS 1973035 AND 19690191, CENTRAL AMERICAN 76°30' WEST LONGITUDE WITH ZONE 9, NAD83 (ORIGINAL)

- LEGEND DENOTES FOUND MONUMENTS SET MONUMENTS (B) UNLESS OTHERWISE NOTED IRON BAR ROUND IRON BAR STANDARD IRON BAR SHORT STANDARD IRON BAR CUT CROSS CONCRETE PIN WITNESS PROPERTY IDENTIFICATION NUMBER MEASURED PROPORTIONED OBSERVATION STANTEC GEOMATICS LTD. PLAN SR-4675 PLAN SR-11075 PLAN SR-7955 PLAN SR-8893 PLAN SR-8822 PLAN OC 18345 PLAN SR-6990 PLAN SR-6659 PLAN BY 1175 DATED SEPTEMBER 9, 2015 PLAN BY 1125 DATED SEPTEMBER 30, 1987 PLAN BY 1105 PLAN BY 1465 DATED DECEMBER 10, 2020 CALCULATION PIR

NOTES 1. ALL PLANTED MONUMENTS SHOWN HEREON ARE IRON BARS (B) UNLESS OTHERWISE NOTED.

OWNER'S CERTIFICATE ALL OF PINS 04756-1337, 04756-1344 & 04756-1347 IS TO CERTIFY THAT 1. BLOCKS 1 TO 21, BOTH INCLUSIVE, THE STREETS, NAMELY Plateau Paleo Heights, Côte Rosalie Ridge and Plateau Paleo Tom Private, HAVE BEEN Laid OUT IN ACCORDANCE WITH OUR INSTRUCTIONS. 2. THE STREETS ARE DEDICATED TO CITY OF OTTAWA AS PUBLIC HIGHWAYS.

DATE... I, FRANCIS LAU, ONTARIO LAND SURVEYOR, HAVE THE AUTHORITY TO BIND THE CORPORATION

SURVEYOR'S CERTIFICATE I CERTIFY THAT 1. THIS SURVEY AND PLAN ARE CORRECT AND IN ACCORDANCE WITH THE SURVEYS ACT, THE SURVEYORS ACT AND THE LAND TITLES ACT AND THE REGULATIONS MADE UNDER THEM. 2. THE SURVEY WAS COMPLETED ON THE... DAY OF... 2024.

DATE... I, FRANCIS LAU, ONTARIO LAND SURVEYOR

Table with columns: ORP ID, NORTHING, EASTING. Values: 9333144.68, 381482.57, 9332879.91, 381255.06. Includes note: COORDINATES CANNOT, IN THEMSELVES, BE USED TO RE-ESTABLISH CORNERS OR BOUNDARIES SHOWN ON THIS PLAN.

Site Servicing Report

2983, 3053 and 3079 Navan Road & 2690 Pagé Road, Ottawa, Ontario

Appendix B

Pre Consultation Meeting
Notes and Site Servicing Report
Checklist

Carmine Zayoun
12714001 Canada Inc (Zayoun Group)
Via email: carmine@zayoungroup.com

**Subject: Pre-Consultation: Meeting Feedback
Proposed Site Plan Application – 2983 Navan Road
Four residential and two mixed-use buildings – PC2023-0226**

Please find below information regarding next steps as well as consolidated comments from the above-noted pre-consultation meeting held on September 13, 2023.

Pre-Consultation Preliminary Assessment

1 <input type="checkbox"/>	2 <input type="checkbox"/>	3 <input type="checkbox"/>	4 <input checked="" type="checkbox"/>	5 <input type="checkbox"/>
----------------------------	----------------------------	----------------------------	---------------------------------------	----------------------------

One (1) indicates that considerable major revisions are required while five (5) suggests that the proposal appears to meet the City's key land use policies and guidelines. This assessment is purely advisory and does not consider technical aspects of the proposal or in any way guarantee application approval.

Next Steps

1. A review of the proposal and materials submitted for the above-noted pre-consultation has been undertaken. Please proceed to complete a Phase 2 / Phase 3 Pre-consultation Application Form and submit it together with the necessary studies and/or plans to planningcirculations@ottawa.ca.
2. In your subsequent pre-consultation submission, please ensure that all comments or issues detailed herein are addressed. A detailed cover letter stating how each issue has been addressed must be included with the submission materials. Please coordinate the numbering of your responses within the cover letter with the comment number(s) herein.
3. Please note, if your development proposal changes significantly in scope, design, or density before the Phase 3 pre-consultation, you may be required to complete or repeat the Phase 2 pre-consultation process.

Supporting Information and Material Requirements

1. The attached **Study and Plan Identification List** outlines the information and material that has been identified, during this phase of pre-consultation, as either required (R) or advised (A) as part of a future complete application submission.
 - a. The required plans and studies must meet the City's Terms of Reference (ToR) and/or Guidelines, as available on Ottawa.ca. These ToR and Guidelines outline

the specific requirements that must be met for each plan or study to be deemed adequate.

Consultation with Technical Agencies

1. You are encouraged to consult with technical agencies early in the development process and throughout the development of your project concept. A list of technical agencies and their contact information is enclosed.

Planning

Comments:

1. In the Official Plan the subject site is designated as Neighbourhood is modified with the Evolving Neighbourhood overlay. Brian Coburn Boulevard is also designated as a Minor Corridor. The property is further identified as Low-density residential in the EUC – Phases 1 Community Design Plans (CDP). The subject lands are currently zoned GM[2546]H(14.5) General Mixed-Use, Exception and DR Development Reserve.

2. Committee of Adjustment

No variances have been identified at this point. I would be supportive of reducing the parking requirement for the residential units if it will result in addition landscaping and tree cover. Staff will set up a meeting with a Committee of Adjustment Plan if any required.

3. Design guidelines

The following guidelines are meant as a starting place to help guide the design. I realize that they are specifically related to your project. [Urban Design Guidelines for Low-rise Infill Housing](#)

4. Landscape requirements

All required yards are to be landscaped with parking located between the buildings. Green spaces and tree canopy needs to be maximized.

5. Parking requirements

Parking should comply with Sections 100, 101, 106, 109 and 111

Vehicle and bicycle parking should be situated with easily access while minimizing pavement.

6. Easements

Will there be any easements required?

7. Commercial units should be orientated to the streets as much as possible.
8. Provide locations of signage and ensure that space is made available for tree planting

Urban Design

9. This proposal does not run along or does not meet the threshold in one of the City's Design Priority Areas and need not attend the City's UDRP. Staff will be responsible for evaluating the Urban Design Brief and providing design direction.
10. An Urban Design Brief is a required submittal Re-zoning applications. The Urban Design Brief should be structured by generally following the headings highlighted under Section 3 – Contents of these Terms of Reference. Please see the Urban Design Brief Terms of Reference provided.
11. We recommend further detail be provided about the low-rise apartments to better understand their relationship to the surrounding buildings and properties.
12. If this site is located outside the greenbelt, a shadow analysis will be required.
13. We recommend the low-rise buildings fronting City streets consider grade related units accessed from the street to further 'fit-in' with the surrounding low-rise residential community where feasible.
14. We recommend additional landscaping detail be provided around the low-rise apartments to better understand how the buildings relate to their context.
15. We recommend additional detail be provided of the front yards of the townhouse units facing City streets to better understand how they will integrate with the public realm.
16. We recommend tree planting in front yards facing public right-of-way.
17. When a wind and/or shadow studies are required please refer to the Terms of Reference for the wind analysis and shadow analysis to conduct the studies and evaluate the impacts.
18. Note. The Urban Design Brief submittal should have a section which addresses these pre-consultation comments.

This is an exciting project in an area full of potential. We look forward to helping you achieve its goals with the highest level of design resolution. We are happy to assist and answer any questions regarding the above. Feel free to contact the Urban Design Planner, Christopher Moise, at Christopher.Moise@ottawa.ca, for follow-up questions

Engineering

Comments:

19. The Stormwater Management Criteria, for the subject site, is to be based on the following:
 - a. The 5-yr storm event using the IDF information derived from the Meteorological Services of Canada rainfall data, taken from the MacDonald Cartier Airport, collected 1966 to 1997.
 - b. For separated sewer system built pre-1970 the design of the storm sewers are based on a 2 year storm.
 - c. The pre-development runoff coefficient or a maximum equivalent 'C' of 0.5, whichever is less (§ 8.3.7.3).
 - d. A calculated time of concentration (Cannot be less than 10 minutes).
 - e. Flows to the storm sewer in excess of the 5-year storm release rate, up to and including the 100-year storm event, must be detained on site.
 - f. For a combined sewer system the maximum $C = 0.4$ or the pre-development C value, whichever is less. In the absence of other information the allowable release rate shall be based on a 2 year storm event.
20. Deep Services (Storm, Sanitary & Water Supply)
 - a. Provide existing servicing information and the recommended location for the proposed connections. Services should ideally be grouped in a common trench to minimize the number of road cuts.
 - b. Connections to trunk sewers and easement sewers are typically not permitted.
 - c. Provide information on the monitoring manhole requirements – should be located in an accessible location on private property near the property line (ie. Not in a parking area).
 - d. Review provision of a high-level sewer.

- e. Sewer connections to be made above the springline of the sewermain as per:
 - i. Std Dwg S11.1 for flexible main sewers – connections made using approved tee or wye fittings.
 - ii. Std Dwg S11 (For rigid main sewers) – lateral must be less than 50% the diameter of the sewermain,
 - iii. Std Dwg S11.2 (for rigid main sewers using bell end insert method) – for larger diameter laterals where manufactured inserts are not available; lateral must be less than 50% the diameter of the sewermain,
 - iv. Connections to manholes permitted when the connection is to rigid main sewers where the lateral exceeds 50% the diameter of the sewermain. – Connect obvert to obvert with the outlet pipe unless pipes are a similar size.
 - v. No submerged outlet connections.

21. Water Boundary condition requests must include the location of the service (map or plan with connection location(s) indicated) and the expected loads required by the proposed development, including calculations. Please provide the following information:

no BCR will be requested for res site plans, no watermains built, navaan connection already provided as part of subdivision

- a. Location of service
- b. Type of development and the amount of fire flow required (as per FUS).
- c. Average daily demand: ___ l/s.
- d. Maximum daily demand: ___ l/s.
- e. Maximum hourly daily demand: ___ l/s.

22. An MECP Environmental Compliance Approval **[Industrial Sewage Works or Municipal/Private Sewage Works]** will be required for the proposed development. Please contact the Ministry of the Environment, Conservation and Parks, Ottawa District Office to arrange a pre-submission consultation:

a. Charlie Primeau at (613) 521-3450, ext. 251 or Charlie.Primeau@ontario.ca

b. Emily Diamond at (613) 521-3450, ext. 238 or Emily.Diamond@ontario.ca

General Comments:

23. Review of the Phase 3 submission for this application will not occur until the detailed design of the subdivision that it is within (D07-16-21-0027) is approved.
24. At the stage of site plan approval, a condition will be imposed detailing that a commence work notification will not be issued until the subdivision's infrastructure is in-service.
25. Engineering Studies:
26. All engineering studies (detailed in the Study and Plan Identification List form) are to follow the to be approved draft plan of subdivision D07-16-21-0027

Feel free to contact **Derek Unrau, Infrastructure Project Manager**, for follow-up questions.

Noise

Comments:

27. Noise report is required to identify and mitigate traffic noise from **Brian Coburn Boulevard and Navan Road**

Feel free to contact the Senior Transportation Engineer, Mike Giampa, at Mike.Giampa@ottawa.ca , for follow-up questions.

Transportation

Comments:

- a. A full TIA is not required as this site is covered under the recent subdivision TIA.
- b. **A memo including the pertinent subdivision trips is sufficient.**
- c. The right of way protection on Brian Coburn and Navan Roads is 40m and 37.5m, respectively

Feel free to contact the Senior Transportation Engineer, Mike Giampa, at Mike.Giampa@ottawa.ca , for follow-up questions.

Planning Forestry

Comments:

28. A Tree Conservation Report and Landscape Plan must be submitted with both SPC applications
29. A permit is required prior to any tree removal on site. The tree permit will be released upon site plan approval. Please contact the File Lead or the Planning Forester, Hayley Murray (hayley.murray@ottawa.ca) for information on obtaining the tree permit.
30. If marine clay soils are present, setbacks on City properties must adhere to the 2017 SMC guidelines (attached). The Geotechnical report must address the implications of these soils, if present, on tree planting in relation to private land.
31. If underground parking is planned, a design must be provided for the site to support tree planting
32. We expect a very strong landscape plan to re-establish canopy cover across the properties. Tree planting and protecting existing urban forest canopy is imperative to reach the City's target of 40% canopy cover.

Feel free to contact Hayley Murray, Planning Forester, for follow-up questions.

Parkland

Comments:

33. Parkland contributions were made through the Subdivision process.

Feel free to contact Jessica Button, Parks Planner, for follow-up questions

Conservation Authority

Comments:

34. The Rideau Valley Conservation authority will be commenting on this application

Feel free to contact RVCA, for follow-up questions.

Other

35. The High Performance Development Standard (HPDS) is a collection of voluntary and required standards that raise the performance of new building projects to achieve sustainable and resilient design. The HPDS was passed by Council on April 13, 2022.



- a. At this time, the HPDS is not in effect and Council has referred the 2023 HPDS Update Report back to staff with direction to bring forward an updated report to Committee with recommendations for revised phasing timelines, resource requirements and associated amendments to the Site Plan Control By-law by no later than Q1 2024.
- b. Please refer to the HPDS information attached and ottawa.ca/HPDS for more information.

Submission Requirements and Fees

1. Outlines the application type/subtype required and the associated fees
 - a. Additional information regarding fees related to planning applications can be found [here](#).
2. The attached **Study and Plan Identification List** outlines the information and material that has been identified as either required (R) or advised (A) as part of a future complete application submission.
 - a. The required plans and studies must meet the City's Terms of Reference (ToR) and/or Guidelines, as available on Ottawa.ca. These ToR and Guidelines outline the specific requirements that must be met for each plan or study to be deemed adequate.
3. All of the above comments or issues should be addressed to ensure the effectiveness of the application submission review.

Should there be any questions, please do not hesitate to contact myself or the contact identified for the above areas / disciplines.

Yours Truly,
Steve Belan

cc.

Tim Chadder
Raad Akrawi
Madelen Fellows
Karla Ferrey
Tatyana Roumie
Christopher Moise
Derek Unrau
Mike Giampa
Haley Murray
Jessica Button

12714001 Canada Inc – Mixed Use Site Plan (Block 17)
2983, 3053 and 3079 Navan Road & 2690 Pagé Road
SITE SERVICING REPORT CHECKLIST

REFERENCED STUDIES AND REPORTS	REFERENCE
Site Servicing Report for 12714001 Canada Inc, Residential Site Plan (Block 17) 2983, 3053 and 3079 Navan Road & 2690 Pagé Road (J.L. Richards & Associates Limited, August 16, 2024)	Site Servicing Report

4.1	GENERAL CONTENT	REFERENCE
<input type="checkbox"/>	Executive Summary (for larger reports only).	N/A
<input checked="" type="checkbox"/>	Date and revision number of the report.	Site Servicing Report
<input checked="" type="checkbox"/>	Location map and plan showing municipal address, boundary, and layout of proposed development.	Site Servicing Report (Appendix A) All Drawings
<input checked="" type="checkbox"/>	Plan showing the site and location of all existing services.	Servicing Plan
<input checked="" type="checkbox"/>	Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.	Site Servicing Report
<input checked="" type="checkbox"/>	Summary of Pre-consultation Meetings with City and other approval agencies.	Site Servicing Report (Appendix 'B')
<input checked="" type="checkbox"/>	Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.	Reference made to Stantec 2005 EUC ISSU
<input checked="" type="checkbox"/>	Statement of objectives and servicing criteria.	Site Servicing Report
<input checked="" type="checkbox"/>	Identification of existing and proposed infrastructure available in the immediate area.	Site Servicing Report Servicing Plan
<input type="checkbox"/>	Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).	N/A

<input checked="" type="checkbox"/>	Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.	Grading Plan
<input type="checkbox"/>	Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.	N/A
<input type="checkbox"/>	Proposed phasing of the development, if applicable.	N/A
<input checked="" type="checkbox"/>	Reference to geotechnical studies and recommendations concerning servicing.	Site Servicing Report and Drawings
<input checked="" type="checkbox"/>	All preliminary and formal site plan submissions should have the following information: <ul style="list-style-type: none"> ▪ Metric scale ▪ North arrow (including construction North) ▪ Key plan ▪ Name and contact information of applicant and property owner ▪ Property limits, including bearings and dimensions ▪ Existing and proposed structures and parking areas ▪ Easements, road widening and rights-of-way ▪ Adjacent street names 	All Drawings

4.2	SITE SERVICING REPORT: WATER	REFERENCE
<input type="checkbox"/>	Confirm consistency with Master Servicing Study, if available.	N/A
<input checked="" type="checkbox"/>	Availability of public infrastructure to service proposed development.	Site Servicing Report (Section 2.0) Servicing Plan
<input checked="" type="checkbox"/>	Identification of system constraints.	Site Servicing Report (Section 2.0) Servicing Plan
<input checked="" type="checkbox"/>	Identify boundary conditions.	Site Servicing Report (Section 2.0)
<input checked="" type="checkbox"/>	Confirmation of adequate domestic supply and pressure.	Site Servicing Report (Section 2.0)
<input checked="" type="checkbox"/>	Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.	Site Servicing Report (Section 2.0)
<input checked="" type="checkbox"/>	Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	Site Servicing Report (Section 2.0)

<input type="checkbox"/>	Definition of phasing constraints. Hydraulic modelling is required to confirm servicing for all defined phases of the project, including the ultimate design.	N/A
<input checked="" type="checkbox"/>	Address reliability requirements, such as appropriate location of shutoff valves.	Site Servicing Report (Section 2.0)
<input type="checkbox"/>	Check on the necessity of a pressure zone boundary modification.	N/A
<input checked="" type="checkbox"/>	Reference to water supply analysis to show that major infrastructure can deliver sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range.	Site Servicing Report (Section 2.0)
<input checked="" type="checkbox"/>	Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants), including special metering provisions.	Site Servicing Report (Section 2.0) Servicing Plan
<input type="checkbox"/>	Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	N/A
<input checked="" type="checkbox"/>	Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Site Servicing Report (Section 2.0)
<input checked="" type="checkbox"/>	Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	Site Servicing Report (Section 2.0)

4.3	SITE SERVICING REPORT: WASTEWATER	REFERENCE
<input checked="" type="checkbox"/>	Summary of proposed design criteria (Note: Wet weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	Site Servicing Report (Section 3.0,
<input type="checkbox"/>	Confirm consistency with Master Servicing Study and/or justifications for deviations.	Stantec 2005 EUC ISSU
<input type="checkbox"/>	Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the Guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	N/A
<input checked="" type="checkbox"/>	Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Site Servicing Report (Section 3.0) Servicing Plan

<input checked="" type="checkbox"/>	Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable.)	Site Servicing Report (Section 3.0)
<input checked="" type="checkbox"/>	Calculations related to dry weather and wet weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.	Site Servicing Report (Section 3.0)
<input checked="" type="checkbox"/>	Description of proposed sewer network, including sewers, pumping stations and forcemains.	Site Servicing Report (Section 3.0) Servicing Plan
<input type="checkbox"/>	Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	N/A
<input type="checkbox"/>	Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	N/A
<input type="checkbox"/>	Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	N/A
<input type="checkbox"/>	Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	N/A
<input type="checkbox"/>	Special considerations, such as contamination, corrosive environment, etc.	N/A

4.4	SITE SERVICING REPORT: STORMWATER	REFERENCE
<input checked="" type="checkbox"/>	Description of drainage outlets and downstream constraints, including legality of outlets (i.e., municipal drain, right-of-way, watercourse, or private property).	Site Servicing Report (Section 4.0)
<input checked="" type="checkbox"/>	Analysis of available capacity in existing public infrastructure.	Site Servicing Report (Section 4.0)
<input checked="" type="checkbox"/>	A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	Servicing, Grading and Drainage Plans
<input checked="" type="checkbox"/>	Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.	Site Servicing Report (Section 4.0)

<input checked="" type="checkbox"/>	Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Site Servicing Report (Section 4.0)
<input checked="" type="checkbox"/>	Description of the stormwater management concept with facility locations and descriptions with references and supporting information.	Site Servicing Report (Section 4.0) Servicing, Grading and Drainage Plans
<input type="checkbox"/>	Setback from private sewage disposal systems.	N/A
<input type="checkbox"/>	Watercourse and hazard lands setbacks.	N/A
<input checked="" type="checkbox"/>	Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	Site Servicing Report (Appendix 'B')
<input type="checkbox"/>	Confirm consistency with subwatershed and Master Servicing Study, if applicable study exists.	Stantec 2005 EUC ISSU
<input checked="" type="checkbox"/>	Storage requirements (complete with calculations) and conveyance capacity for minor events (1:2 year return period) and major events (1:100 year return period).	Site Servicing Report (Section 4.0)
<input type="checkbox"/>	Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	N/A
<input checked="" type="checkbox"/>	Calculate pre- and post-development peak flow rates, including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Site Servicing Report (Section 4.0)
<input checked="" type="checkbox"/>	Any proposed diversion of drainage catchment areas from one outlet to another.	Site Servicing Report (Section 4.0)
<input checked="" type="checkbox"/>	Proposed minor and major systems, including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	Servicing, Grading and Drainage Plans
<input type="checkbox"/>	If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.	Quantity control proposed per Site Servicing Report (Section 4.0)
<input type="checkbox"/>	Identification of potential impacts to receiving watercourses.	N/A
<input type="checkbox"/>	Identification of municipal drains and related approval requirements.	N/A
<input checked="" type="checkbox"/>	Description of how the conveyance and storage capacity will be achieved for the development.	Site Servicing Report (Section 4.0)

<input checked="" type="checkbox"/>	100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	Site Servicing Report (Section 4.0) Servicing, Grading and Drainage Plans
<input checked="" type="checkbox"/>	Inclusion of hydraulic analysis, including hydraulic grade line elevations.	Site Servicing Report (Section 4.0)
<input checked="" type="checkbox"/>	Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	Site Servicing Report (Section 5.0) Servicing Plan
<input type="checkbox"/>	Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	N/A
<input type="checkbox"/>	Identification of fill constraints related to floodplain and geotechnical investigation.	N/A

4.5	APPROVAL AND PERMIT REQUIREMENTS	REFERENCE
The Site Servicing Report shall provide a list of applicable permits and regulatory approvals necessary for the proposed development, as well as the relevant issues affecting such approval. The approval and permitting shall include but not be limited to the following:		
<input type="checkbox"/>	Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams, as defined in the Act.	N/A
<input type="checkbox"/>	Application for Environmental Compliance Approval (ECA) under the Ontario Water Resources Act.	As part of future submission
<input type="checkbox"/>	Changes to Municipal Drains.	N/A
<input type="checkbox"/>	Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation, etc.).	N/A

4.6	CONCLUSION CHECKLIST	REFERENCE
<input checked="" type="checkbox"/>	Clearly stated conclusions and recommendations.	Site Servicing Report
<input checked="" type="checkbox"/>	Comments received from review agencies, including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.	Not yet applicable

<input checked="" type="checkbox"/>	All draft and final reports shall be signed and stamped by a Professional Engineer registered in Ontario.	Site Servicing Report All Drawings

Appendix C

Water Servicing

WATERMAIN DEMAND CALCULATION SHEET

PROJECT : NAVAN ROAD DEVELOPMENT PROJECT
LOCATION : CITY OF OTTAWA
DEVELOPER : 12714001 Canada Inc.

NODE	RESIDENTIAL			NON-RESIDENTIAL	AVERAGE DAILY DEMAND (l/s)			MAXIMUM DAILY DEMAND (l/s)			PEAK HOUR DEMAND (l/s)		
	UNITS		POP'N	COMM (ha.)	Res.	Non-res.	Total	Res.	Non-res.	Total	Res.	Non-res.	Total
	Townhouses (TH)	Condo Units (CU)											
J-25	0	96	173	0.00	0.56	0.00	0.56	1.40	0.00	1.40	3.08	0.00	3.08
TOTALS	0	96	173	0.00	0.56	0.00	0.56	1.40	0.00	1.40	3.08	0.00	3.08

ASSUMPTIONS			
RESIDENTIAL DENSITIES			
- Townhouse (TH)	2.7	p / p / u	AVG. DAILY DEMAND
- Condo Units (CU)	1.8	p / p / u	- Residential 280 l / cap / day
		p / p / u	- Institutional 28,000 l / ha / day
		p / p / u	- Commercial 28,000 l / ha / day
		p / p / u	MAX. DAILY DEMAND
		p / p / u	- Residential 700 l / cap / day
		p / p / u	- Institutional 42,000 l / ha / day
		p / p / u	- Commercial 42,000 l / ha / day
			MAX. HOURLY DEMAND
			- Residential 1,540 l / cap / day
			- Institutional 75,600 l / ha / day
			- Commercial 75,600 l / ha / day

FUS Fire Flow Calculations

NAVAN ROAD DEVELOPMENT PROJECT - Commercial Building (JLR 29899-002)

Step	Parameter	Value	Note
A	Type of Construction	Wood Frame	Building E (4 Story Mixed Use Condominium Building)
	Coefficient (C)	1.5	
B	Ground Floor Area	1067.77 m ²	
C	Height in storeys	4 storeys	Basements are excluded.
	Total Floor Area	4271.08 m ²	
D	Fire Flow Formula	F=220C√A	
	Fire Flow	21567 L/min	
	Rounded Fire Flow	22000 L/min	Flow rounded to nearest 1000 L/min.
E	Occupancy Class	Limited Combustible	Residential buildings have a limited combustible occupancy.
	Occupancy Charge	-15%	
	Occupancy Increase or Decrease	-3300	
	Fire Flow	18700 L/min	
F	Sprinkler Protection	Automatic Fully Supervised	
	Sprinkler Credit	-50%	
	Decrease for Sprinkler	-9350 L/min	
G	<i>North Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Wood Frame	
	Length of Exposed Wall:	38.8 m	
	Height of Exposed Wall:	1 storeys	
	Length-Height Factor	38.8 m-storeys	
	Separation Distance	39.47 m	
	North Side Exposure Charge	5%	
	<i>East Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Wood Frame	
	Length of Exposed Wall:	24.9 m	
	Height of Exposed Wall:	4 storeys	
	Length-Height Factor	99.7 m-storeys	
	Separation Distance	17.15 m	
	East Side Exposure Charge	15%	
	<i>South Side Exposure</i>		
	Exposing Wall:		
	Exposed Wall:		
	Length of Exposed Wall:	m	
	Height of Exposed Wall:	storeys	
	Length-Height Factor	0.0 m-storeys	
	Separation Distance	m	
	South Side Exposure Charge	0%	
	<i>West Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Wood Frame	
Length of Exposed Wall:	10.4 m		
Height of Exposed Wall:	1 storeys		
Length-Height Factor	10.4 m-storeys		
Separation Distance	42.94 m		
West Side Exposure Charge	5%		
Total Exposure Charge	25%	The total exposure charge is below the maximum value of 75%.	
Increase for Exposures	4675 L/min		
H	Fire Flow	14025 L/min	
	Rounded Fire Flow	14000 L/min	Flow rounded to nearest 1000 L/min.
City Cap (RFF)	Required Fire Flow	14000 L/min	
		233 L/s	


Fire Underwriters Survey (FUS) Fire Flow Calculations
 In accordance with City of Ottawa Technical Bulletin ISTB-2018-02 dated March 21, 2018

FUS Fire Flow Calculations

NAVAN ROAD DEVELOPMENT PROJECT - Commercial Building
(JLR 29899-002)

Step	Parameter	Value	Note
A	Type of Construction	Wood Frame	Building F (4 Story Mixed Use Condominium Building)
	Coefficient (C)	1.5	
B	Ground Floor Area	1067.84 m ²	
C	Height in storeys	4 storeys	Basements are excluded.
	Total Floor Area	4271.36 m ²	
D	Fire Flow Formula	F=220C√A	
	Fire Flow	21567 L/min	
	Rounded Fire Flow	22000 L/min	Flow rounded to nearest 1000 L/min.
E	Occupancy Class	Limited Combustible	Residential buildings have a limited combustible occupancy.
	Occupancy Charge	-15%	
	Occupancy Increase or Decrease	-3300	
	Fire Flow	18700 L/min	
F	Sprinkler Protection	Automatic Fully Supervised	
	Sprinkler Credit	-50%	
	Decrease for Sprinkler	-9350 L/min	
G	<i>North Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Wood Frame	
	Length of Exposed Wall:	8.4 m	
	Height of Exposed Wall:	1 storeys	
	Length-Height Factor	8.4 m-storeys	
	Separation Distance	15.03 m	
	North Side Exposure Charge	12%	
	<i>East Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Wood Frame	
	Length of Exposed Wall:	40.9 m	
	Height of Exposed Wall:	1 storeys	
	Length-Height Factor	40.9 m-storeys	
	Separation Distance	40.14561369 m	
	East Side Exposure Charge	5%	
	<i>South Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Non-combustible	
	Length of Exposed Wall:	m	
	Height of Exposed Wall:	storeys	
	Length-Height Factor	0.0 m-storeys	
	Separation Distance	m	
	South Side Exposure Charge	0%	
	<i>West Side Exposure</i>		
	Exposing Wall:	Wood Frame	
	Exposed Wall:	Wood Frame	
	Length of Exposed Wall:	56.0 m	
Height of Exposed Wall:	4 storeys		
Length-Height Factor	223.8 m-storeys		
Separation Distance	14.76 m		
West Side Exposure Charge	15%		
Total Exposure Charge	32%	The total exposure charge is below the maximum value of 75%.	
Increase for Exposures	5984 L/min		
H	Fire Flow	15334 L/min	
	Rounded Fire Flow	15000 L/min	Flow rounded to nearest 1000 L/min.
City Cap (RFF)	Required Fire Flow	15000 L/min	
		250 L/s	

Fire Underwriters Survey (FUS) Fire Flow Calculations
In accordance with City of Ottawa Technical Bulletin ISTB-2018-02 dated March 21, 2018

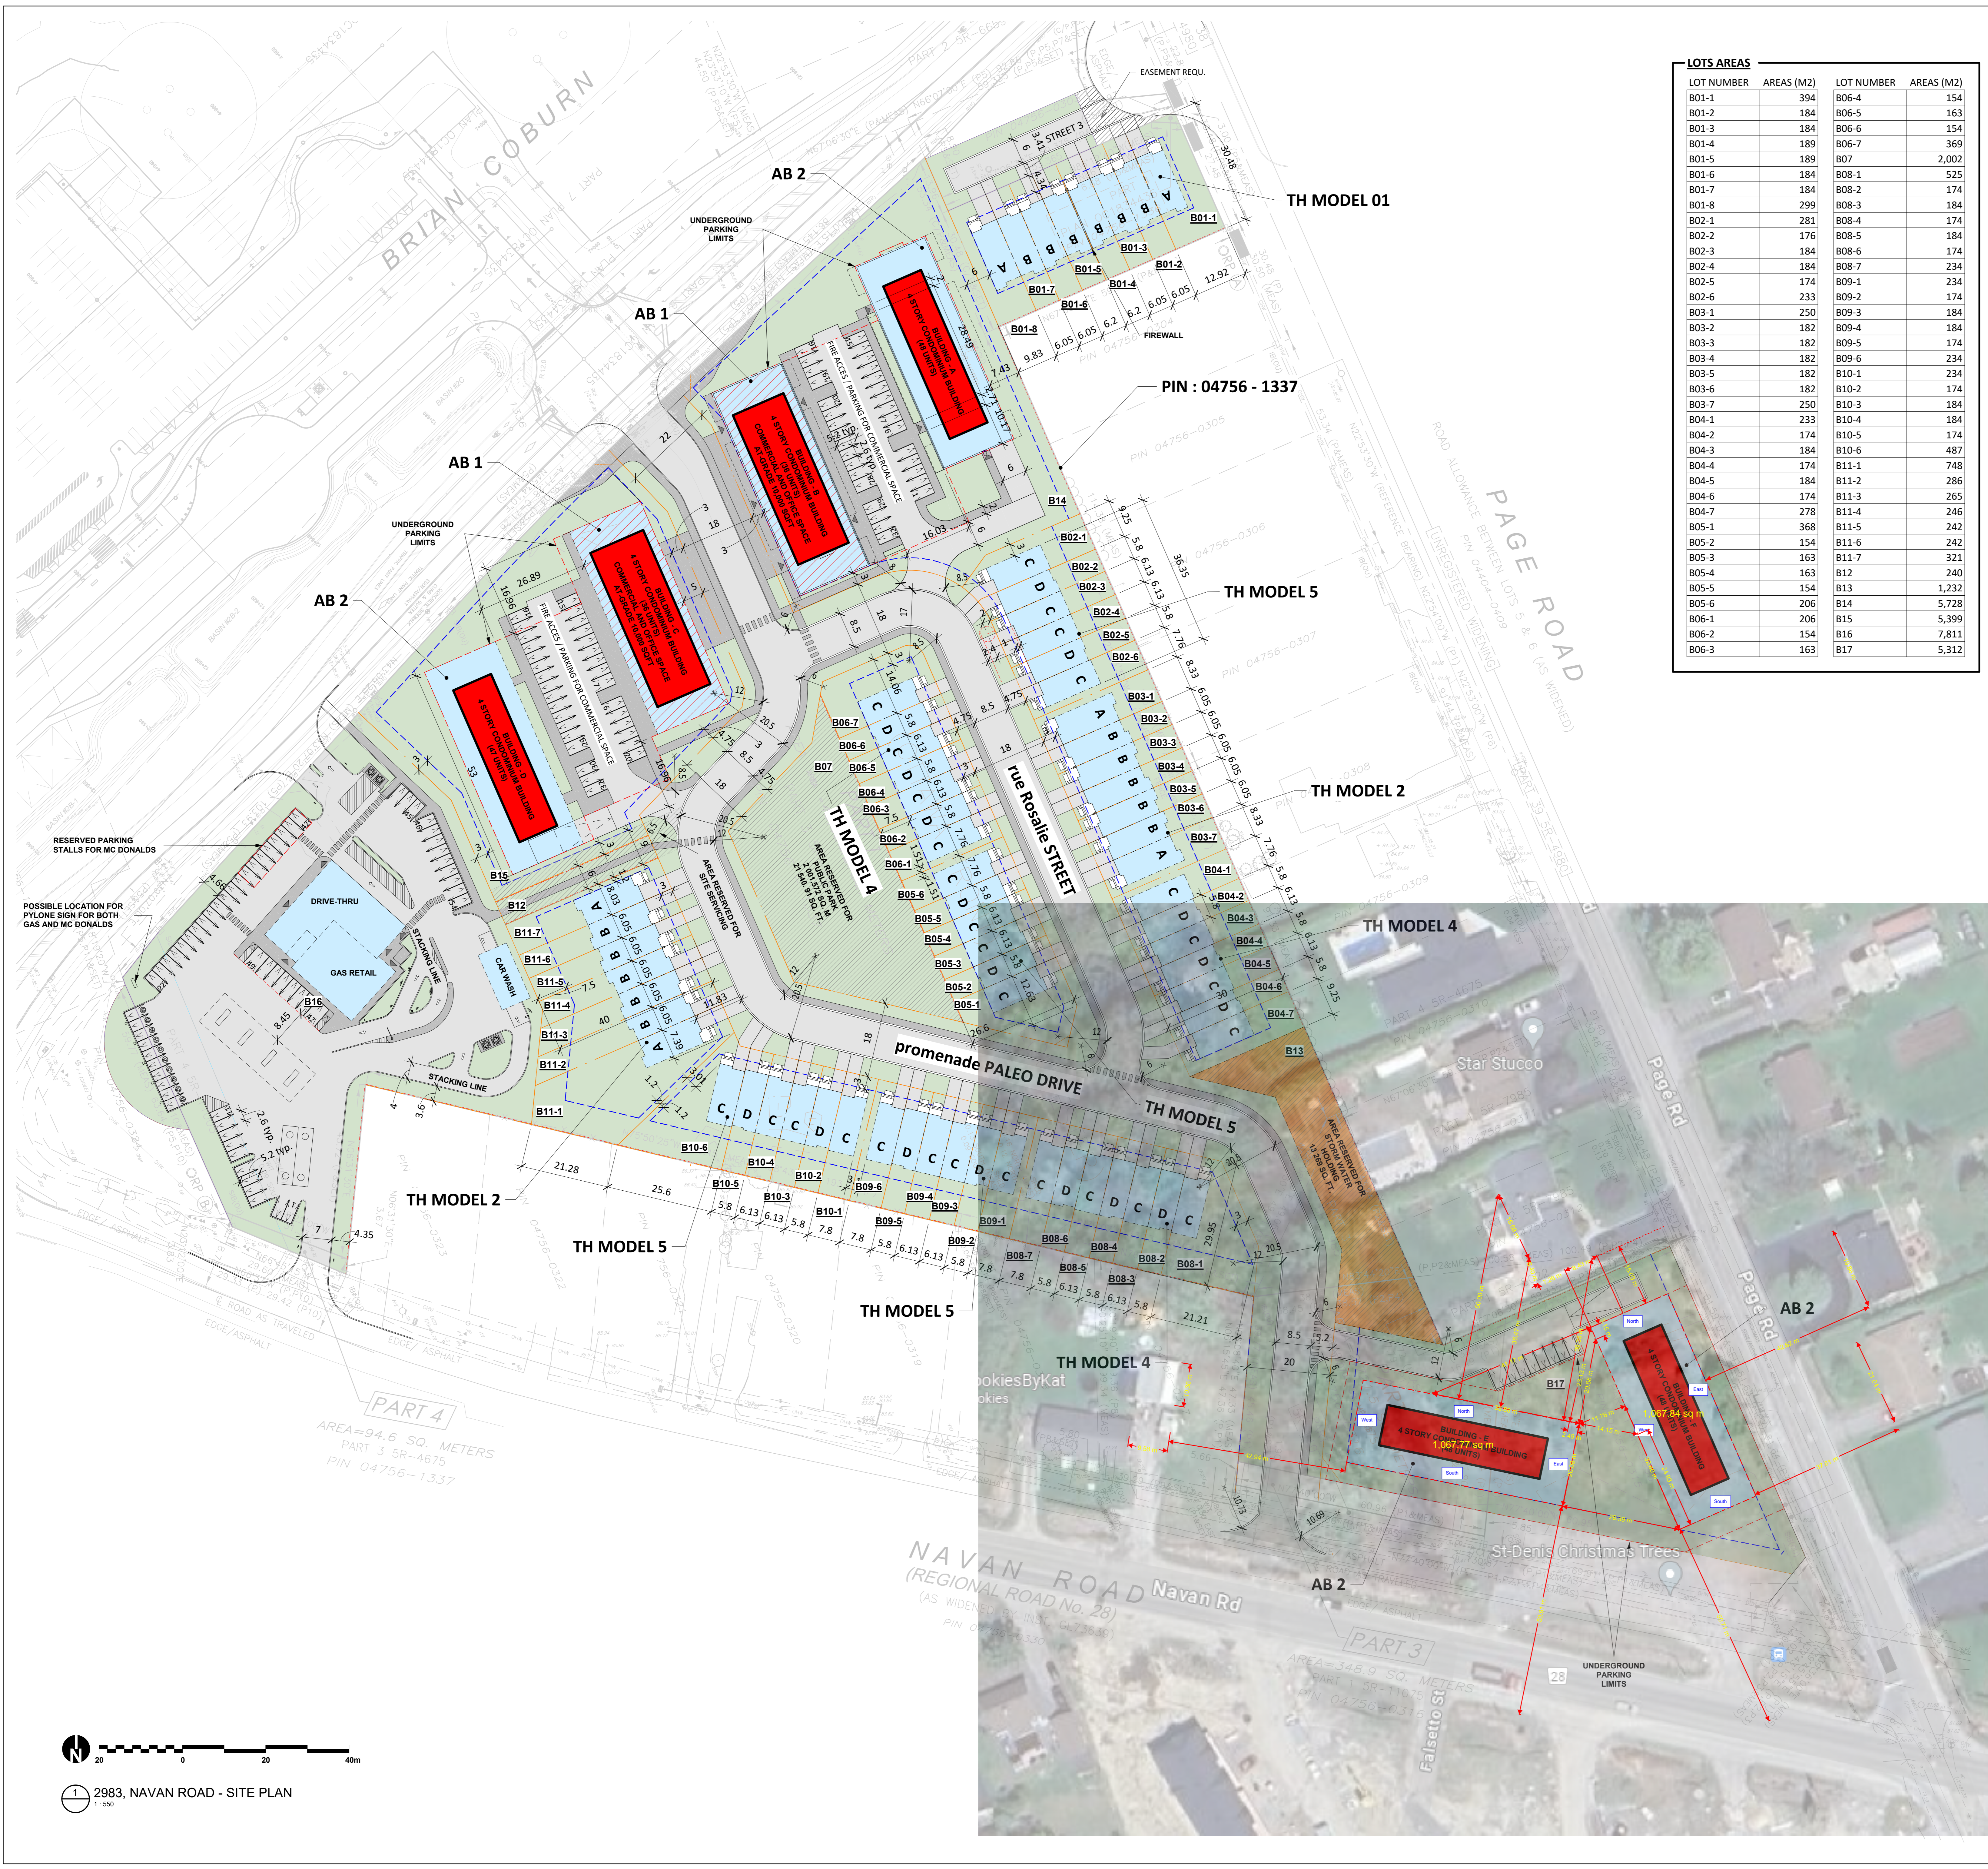

LOTS AREAS

LOT NUMBER	AREAS (M2)	LOT NUMBER	AREAS (M2)
B01-1	394	B06-4	154
B01-2	184	B06-5	163
B01-3	184	B06-6	154
B01-4	189	B06-7	369
B01-5	189	B07	2,002
B01-6	184	B08-1	525
B01-7	184	B08-2	174
B01-8	299	B08-3	184
B02-1	281	B08-4	174
B02-2	176	B08-5	184
B02-3	184	B08-6	174
B02-4	184	B08-7	234
B02-5	174	B09-1	234
B02-6	233	B09-2	174
B03-1	250	B09-3	184
B03-2	182	B09-4	184
B03-3	182	B09-5	174
B03-4	182	B09-6	234
B03-5	182	B10-1	234
B03-6	182	B10-2	174
B03-7	250	B10-3	184
B04-1	233	B10-4	184
B04-2	174	B10-5	174
B04-3	184	B10-6	487
B04-4	174	B11-1	748
B04-5	184	B11-2	286
B04-6	174	B11-3	265
B04-7	278	B11-4	246
B05-1	368	B11-5	242
B05-2	154	B11-6	242
B05-3	163	B11-7	321
B05-4	163	B12	240
B05-5	154	B13	1,232
B05-6	206	B14	5,728
B06-1	206	B15	5,399
B06-2	154	B16	7,811
B06-3	163	B17	5,312

SITE PLAN LEGEND

	EXISTING BUILDING		LOT LINE
	NEW BUILDING		SETBACKS
	NEW BUILDING WITH COMMERCIAL SPACE AT-GRADE		NEW TREE
	GRASS		FIREWALL
	ASPHALT		SIDEWALK

SITE INFORMATION & DEVELOPMENT STATISTICS

LOTS	PIN
	04756-0303
	04756-0315
	04756-0316
	04756-1337

ZONING

ZONING	GM(2546) H(14.5)
--------	------------------

SITE AREA

TOTAL SITE AREA:	~53,441.14 m ² (5.34ha)
TOTAL DEVELOPABLE AREA:	~45,956.28 m ² (4.59ha)
NET SITE AREA:	~38,956.28 m ² (3.89ha)

UNITS

TOWNHOUSES:	67 UNITS
BLOCK 01:	
1 X RESIDENTIAL APARTMENT BUILDING	48 UNITS
1 X MIXED USE BUILDING	
RESIDENTIAL:	36 UNITS
COMMERCIAL SPACES:	~929 m ²
BLOCK 02:	
1 X RESIDENTIAL APARTMENT BUILDING	47 UNITS
1 X MIXED USE BUILDING	
RESIDENTIAL:	36 UNITS
COMMERCIAL SPACES:	~929 m ²
BLOCK 03:	
2 X RESIDENTIAL APARTMENT BUILDING	96 UNITS
TOTAL NUMBER OF UNITS:	330 UNITS
TOTAL COMMERCIAL SPACES:	~1,858 m ²

	REQUIRED	PROVIDED
MAXIMUM DENSITY	NO MAX.	84.8 units/net ha
MINIMUM LOT WIDTH	NO MIN.	5.8 m
MINIMUM LOT AREA	NO MIN.	174 m ²
MAXIMUM BUILDING HEIGHT	14.5 m	14.5 m

SETBACKS

MINIMUM FRONT YARD:	3 m	3 m
MINIMUM CORNER SIDE YARD:	3 m	3 m
MINIMUM INTERIOR SIDE YARD:		
NON-RESIDENTIAL OR MIXED-USE:	5 m	5 m
LOW-RISE RESIDENTIAL :	1.2 m	1.2 m
MID-RISE RESIDENTIAL :	3 m	3 m
MINIMUM REAR YARD:		
ABUTTING A STREET:	3 m	3 m
FROM A RESIDENTIAL ZONE:	7.5 m	7.5 m
FOR A RESIDENTIAL BUILDING:	7.5 m	7.5 m

PARKING RATES

R9 - TOWNHOUSES:	1 p/unit = 67	67 (GARAGES)
VISITOR:	0	67 DRIVE AISLES
BLOCK 14:		
R12 - APARTEMENTS	1.2 p/unit = 101	101 (UNDERGROUND)
VISITOR:	0.2 p/unit = 17	17 (UNDERGROUND)
N79 - RETAIL STORE:	3.4 p/100 m ² GFA = 32	32 (EXTERIOR)
TOTAL:		150
BLOCK 15:		
R12 - APARTEMENTS	1.2 p/unit = 100	100 (UNDERGROUND)
VISITOR:	0.2 p/unit = 17	17 (UNDERGROUND)
N79 - RETAIL STORE:	3.4 p/100 m ² GFA = 32	32 (EXTERIOR)
TOTAL:		150
BLOCK 18:		
R12 - APARTEMENTS	1.2 p/unit = 116	145 (UNDERGROUND)
VISITOR:	0.2 p/unit = 17	17 (8 EXT. + 12 UND.)
TOTAL:		162

GROSS FLOOR AREA

TOWNHOUSE A:	267 m ²
TOWNHOUSE B:	239 m ²
TOWNHOUSE C:	232 m ²
TOWNHOUSE C (CORNER UNIT):	236 m ²
TOWNHOUSE D:	225 m ²
TOTAL MODEL 01 (ABBBBBBA)	1,968 m ²
TOTAL MODEL 02 (ABBBBBBA)	1,729 m ²
TOTAL MODEL 03 (ABBBBBBA)	1,490 m ²
TOTAL MODEL 04 (CDCDCDC)	1,611 m ²
TOTAL MODEL 05 (CDCDCDC)	1,386 m ²

MIXED USE BUILDING (TOTAL OF 2 BUILDINGS):

RESIDENTIAL:	3,201 m ²
COMMERCIAL:	929 m ²
RESIDENTIAL APARTMENT BUILDING (TOTAL OF 4 BUILDINGS) :	TOTAL: 4,130 m ²
RESIDENTIAL:	4,130 m ²

NOTE

1. ASSUMES TYPICAL RESIDENTIAL FLOOR HEIGHT OF 3m.
2. THE BASE PLAN (LOT LINES, EXISTING ROADS AND SURROUNDING AREAS) IS BASED ON THE TOPOGRAPHICAL PLAN OF SURVEY, SURVEYED STANTEC GEOMATICS LTD.
3. DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0,3048.

PROJECT
NAVAN ROAD DEVELOPMENT
 2983, Navan Road, Orleans, ON K1C 7G4
 OWNER

 788, BOUL. SAINT-JOSEPH, SUITE 100 GATINEAU, QC J8Y 4B8
 ARCHITECTURAL

 (418) 851-9564
 INFO@PMAARCHITECTES.COM
 3070, CHEMIN DES QUATRE-BOURGEONS QUÉBEC (QC) G1W 2M4
 PMAARCHITECTES.COM
 ENGINEERS / PLANNER

 ENGINEERS - ARCHITECTS - PLANNERS
 1985 CARLING AVENUE, SUITE 700, OTTAWA, ON K1Z 6R1
 SURVEYOR

 1331 GLYDE AVENUE, SUITE 400, OTTAWA, ON K2C 3G4
 KEY PLAN

 ARCHITECT SEAL
 REVISIONS

NO	DESCRIPTION	DATE
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		

IT IS THE RESPONSIBILITY OF THE APPROPRIATE CONTRACTOR TO CHECK AND VERIFY ALL DIMENSIONS ON THE SITE AND TO REPORT ALL ERRORS AND/OR OMISSIONS TO THE ARCHITECT. ALL CONTRACTORS MUST COMPLY WITH ALL PERTINENT CODES AND BY-LAWS. DO NOT SCALE DRAWINGS.

THIS DOCUMENT AND ITS CONTENT IS COPYRIGHTED. ANY REPRODUCTION IS PROHIBITED UNLESS GRANTED BY THE ARCHITECT.

DO NOT USE FOR CONSTRUCTION

DATE	DESIGNED
2023-10-04	PP
PROJECT No	CHECKED
2054	PM
DATE	DRAWN
2023-10-04	PP
PROJECT No	CHECKED
2054	PM
DATE	SHEET TITLE
2023-10-04	SITE PLAN

SHEET No
A100

BIM 360/NAVAN/2005_DEV-NAVAN_SITE_PLAN_R01.rvt

2983, NAVAN ROAD - SITE PLAN
 1:500

Table 1. Maximum flow to be considered from a given hydrant



Block 17

Required Fire Flow Building E = 233 L/s
 Required Fire Flow Building F = 250 L/s

Hydrant Class	Distance to asset/structure/building (m) ^a	Contribution to required fire flow (L/min) ^b
AA	≤ 75	5,700
	> 75 and ≤ 150	3,800
A	≤ 75	3,800
	> 75 and ≤ 150	2,850
B	≤ 75	1,900
	> 75 and ≤ 150	1,500
C	≤ 75	800
	> 75 and ≤ 150	800

^a Distance of contributing hydrant from the structure, measured in accordance with NFPA 1 (Appendix A).

^b Maximum flow contribution to be considered for a given asset/structure/building, at a residual pressure of 20 psi, measured at the location of the main, at ground level.

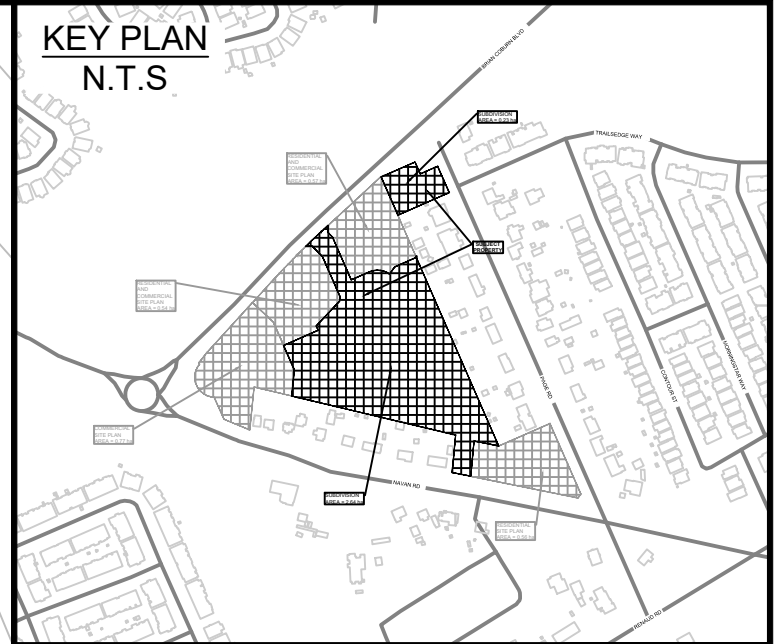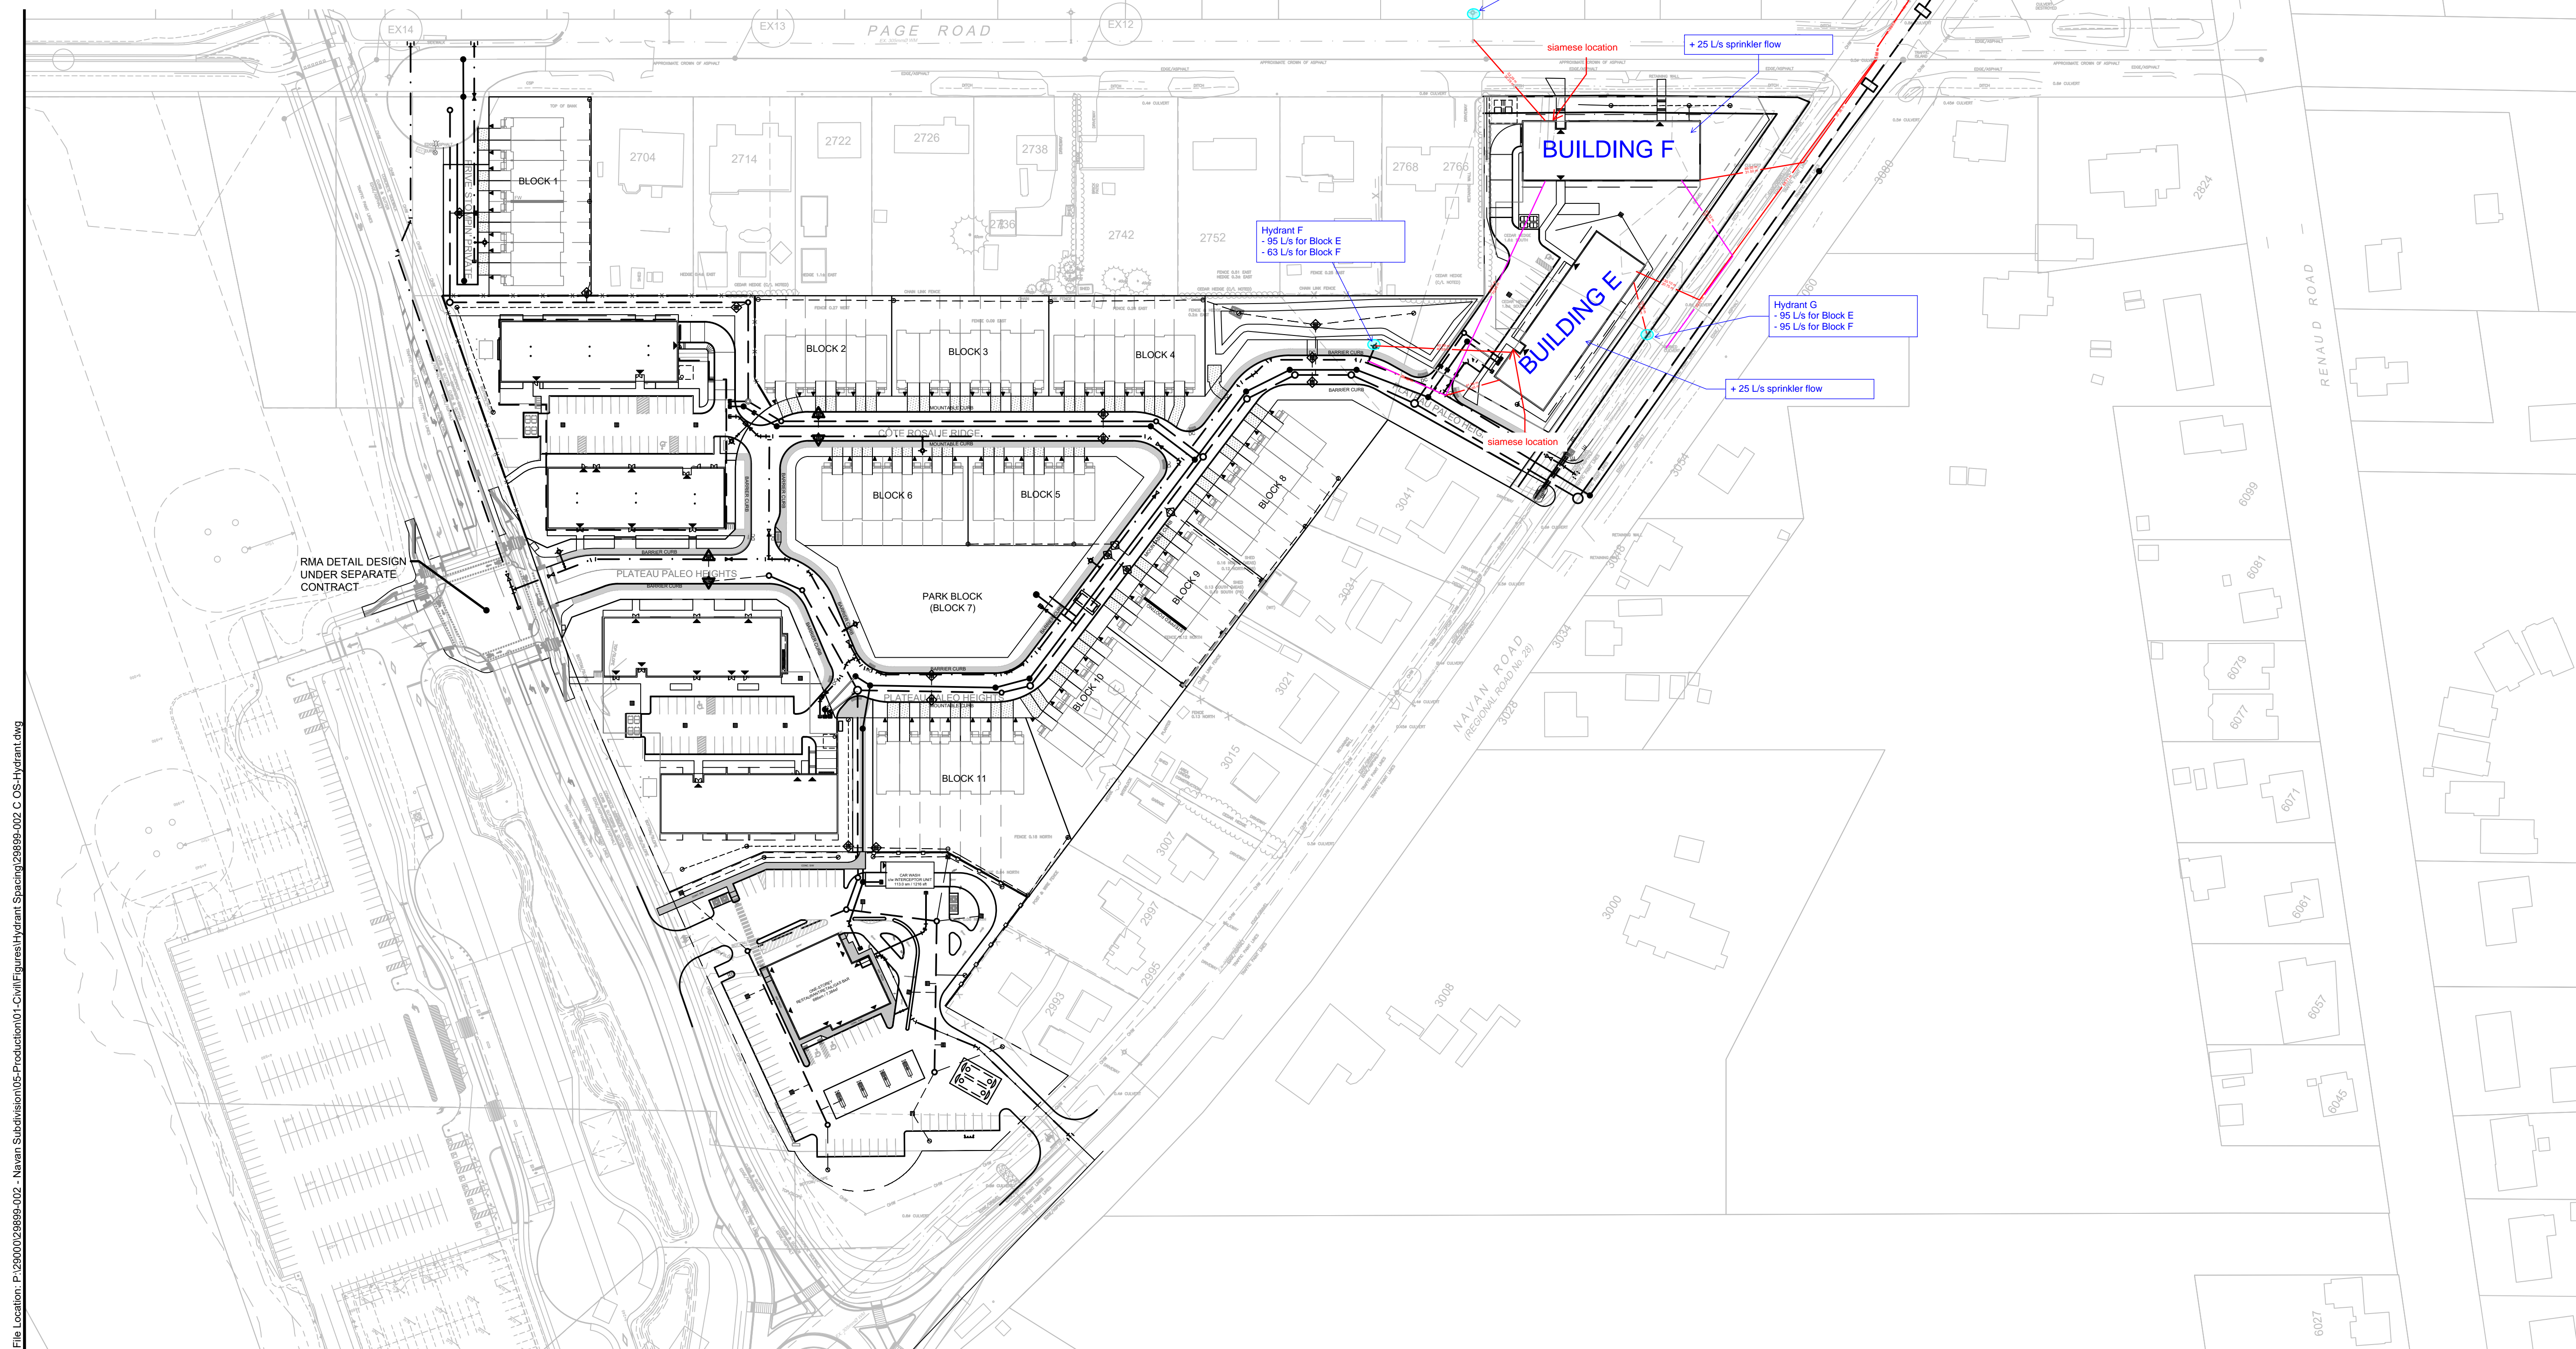

LEGEND

- PROPOSED WATERMAIN, VALVE & HYDRANT
- EXISTING WATERMAIN, VALVE & HYDRANT
- EXISTING SANITARY SEWER & MANHOLE
- EXISTING STORM SEWER & MANHOLE
- PROPOSED SANITARY SEWER & MANHOLE
- PROPOSED STORM SEWER & MANHOLE
- STEPPED FOOTING
- FIREWALL
- PROPOSED CULVERT
- DRAWING NUMBER
- RIP-RAP TO OPSD 810.010 (TYPE B)
- EXISTING CATCH BASIN
- PROPOSED CATCH BASIN w/ CO
- PROPOSED CATCH BASIN & LEAD
- PROPOSED TEE CATCH BASIN
- PROPOSED SWAY CATCH BASIN
- TACTILE WALKING INDICATOR STRIP (TWS)
- CONC. SIDEWALK
- ASPHALT
- INFILTRATION TRENCH

Draft Print

04	2024-06-20 05:31:39 PM	04/03/24
03	RE-ISSUED TO CITY FOR ENGINEERING REVIEW (SECOND SUBMISSION)	16/02/24
02	ISSUED FOR MUNICIPAL CONSENT	09/02/24
01	ISSUED TO CITY FOR ENGINEERING REVIEW	22/09/23

No. ISSUE / REVISION DDMMYY

THESE DRAWINGS HAVE BEEN PRODUCED BY J.L. RICHARDS & ASSOCIATES LIMITED AND ARE SUBJECT TO COPYRIGHT AND USE RESTRICTIONS SET OUT IN THE APPLICABLE PROJECT CONTRACT. ANY USE, REUSE, OR MODIFICATION OF THESE DRAWINGS FOR PURPOSES OTHER THAN THE ORIGINAL PROJECT OR EXECUTION OF THE DESCRIBED WORK IS NOT PERMITTED OR ENDORSED WITHOUT THE PRIOR WRITTEN AUTHORIZATION OF J.L.R. J.L.R. MAKES NO WARRANTIES, EITHER EXPRESS OR IMPLIED, OF THE SUITABILITY OR FITNESS OF THESE DRAWINGS FOR ANY OTHER PURPOSE, AND ANY PARTY WHICH CHOOSES TO USE, MODIFY, OR OTHERWISE RELY ON THESE DRAWINGS WITHOUT J.L.R.'S AUTHORIZATION ACCEPTS THESE LIMITATIONS AND DOES SO AT THEIR SOLE RISK AND WITHOUT LIABILITY TO J.L.R.

VERIFY SHEET SIZE AND SCALES. THE BAR TO THE RIGHT IS 25mm IF THIS IS A FULL SIZE DRAWING.

SCALE: 1:1000

CLIENT:

CONSULTANT:

J.L. Richards
ENGINEERS - ARCHITECTS - PLANNERS

CONSULTANT:

PROFESSIONAL STAMP

PROJECT NORTH

PROJECT:

NAVAN SUBDIVISION

2983, 3053, & 3079 NAVAN ROAD & 2690 PAGE ROAD
OTTAWA, ONTARIO

DRAWING:

OVERALL SERVICING


DESIGN: TR	DRAWING #:
DRAWN: KT	OS
CHECKED: KF	
JLR #: 29899-002	

Boundary Conditions Navan Subdivision

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	404	6.74
Maximum Daily Demand	632	10.53
Peak Hour	1,090	18.17
Fire Flow Demand #1	6,000	100.00
Fire Flow Demand #2	10,000	166.67
Fire Flow Demand #3	14,000	233.33
Fire Flow Demand #4	15,000	250.00

Location

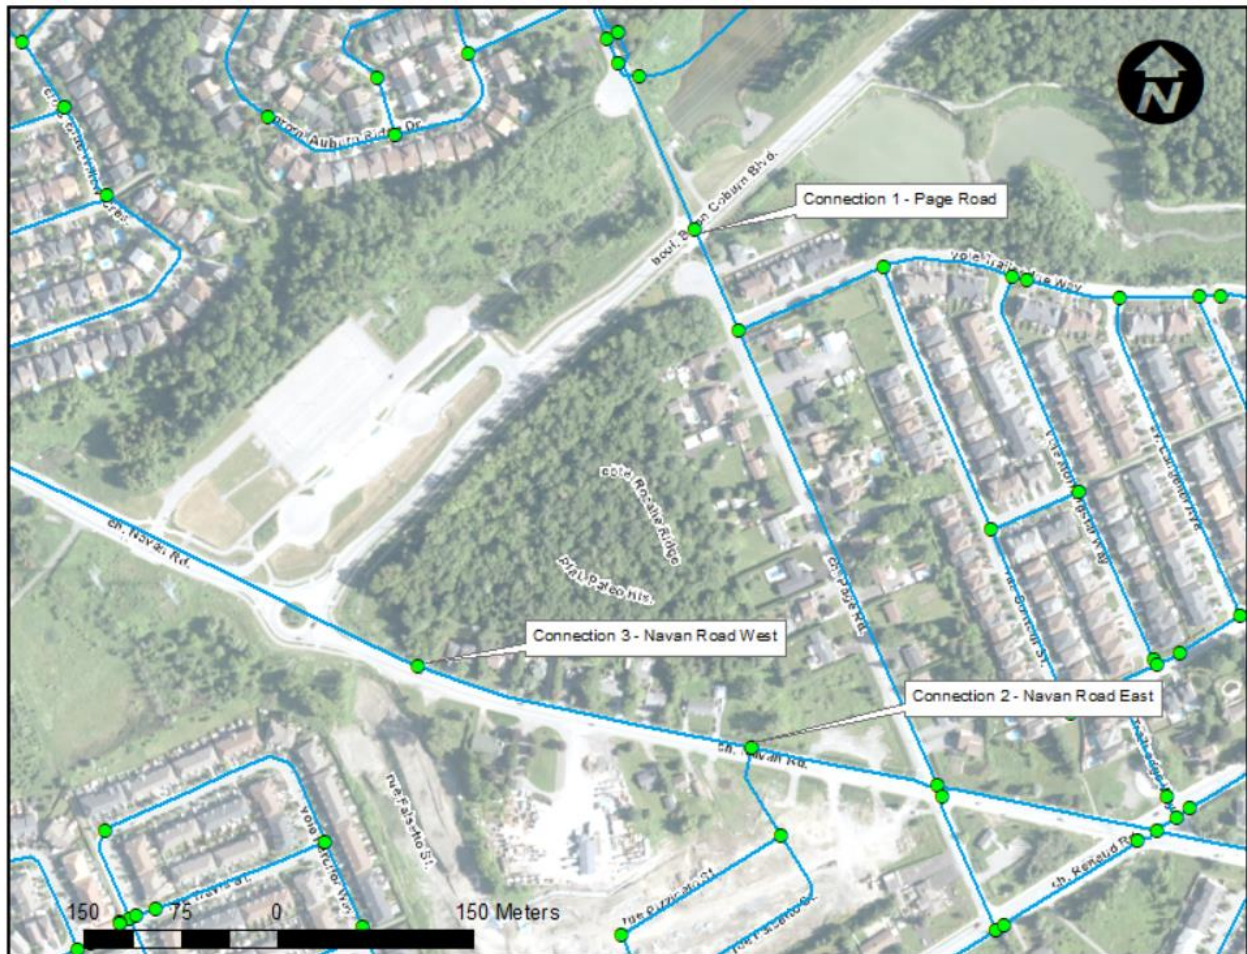

Results

Connection 1 - Page Road

Demand Scenario	Head (m)	Pressure¹ (psi)
Maximum HGL	130.7	64.0
Peak Hour	127.0	58.6
Max Day plus Fire Flow #1	128.2	60.4
Max Day plus Fire Flow #2	126.8	58.3
Max Day plus Fire Flow #3	124.9	55.7
Max Day plus Fire Flow #4	124.4	55.0

¹ Ground Elevation = 85.7 m

Connection 2 - Navan Road East

Demand Scenario	Head (m)	Pressure¹ (psi)
Maximum HGL	130.7	71.4
Peak Hour	126.8	65.9
Max Day plus Fire Flow #1	127.7	67.1
Max Day plus Fire Flow #2	125.5	64.1
Max Day plus Fire Flow #3	122.7	60.1
Max Day plus Fire Flow #4	121.9	58.9

¹ Ground Elevation = 80.5 m

Connection 3 - Navan Road West

Demand Scenario	Head (m)	Pressure¹ (psi)
Maximum HGL	130.7	69.3
Peak Hour	126.8	63.8
Max Day plus Fire Flow #1	127.3	64.5
Max Day plus Fire Flow #2	124.6	60.6
Max Day plus Fire Flow #3	120.9	55.3
Max Day plus Fire Flow #4	119.8	53.8

¹ Ground Elevation = 81.9 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

William Rugamba

From: Mahad Musse
Sent: July 15, 2024 1:21 PM
To: William Rugamba
Subject: FW: Navan Subdivision - Boundary Condition Request
Attachments: NavanSubdivision_Boundary Condition(4july2024).docx

Mahad Musse, B.Eng., EIT
Civil Engineering Graduate
Ottawa, ON
Work: [343-633-1501](tel:343-633-1501)

From: Polyak, Alex <alex.polyak@ottawa.ca>
Sent: Monday, July 15, 2024 10:12 AM
To: Mahad Musse <mmusse@jlrichards.ca>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>; Armstrong, Justin <justin.armstrong@ottawa.ca>; Tatyana Roumie <troumie@jlrichards.ca>
Subject: RE: Navan Subdivision - Boundary Condition Request

[CAUTION] This email originated from outside JLR. Do not click links or open attachments unless you recognize the sender and know the content is safe. Do not forward suspicious emails, if you are unsure, please send a separate message to Helpdesk.

Good morning Mahad,

Please find the boundary conditions attached.

Regards,

Oleksandr (Alex) Polyak, B.Eng., C.E.T., P.Eng. 

Project Manager, Infrastructure Approvals, Development Review East Branch | Gestionnaire de projet, Direction de l'examen des projets d'aménagement – Est.
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)

City of Ottawa | Ville d'Ottawa
110 Laurier Ave., 4th Fl East, Ottawa ON K1P 1J1
Email: alex.polyak@ottawa.ca
Cell : 613-857-4380
www.Ottawa.ca



From: Mahad Musse <mmusse@jlrichards.ca>
Sent: July 12, 2024 1:31 PM
To: Polyak, Alex <alex.polyak@ottawa.ca>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>; Armstrong, Justin <justin.armstrong@ottawa.ca>; Tatyana Roumie <troumie@jlrichards.ca>
Subject: RE: Navan Subdivision - Boundary Condition Request

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Alex,

Just wondering if you have a status update for the boundary conditions for Navan.

Thanks
Mahad



Mahad Musse, B.Eng., EIT
Civil Engineering Graduate

1000-343 Preston Street
Ottawa, ON, K1S 1N4

Work: [343-633-1501](tel:343-633-1501)
mmusse@jlrichards.ca

From: Mahad Musse <mmusse@jlrichards.ca>
Sent: Wednesday, July 3, 2024 11:02 AM
To: Polyak, Alex <alex.polyak@ottawa.ca>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>; Armstrong, Justin <justin.armstrong@ottawa.ca>; Tatyana Roumie <troumie@jlrichards.ca>
Subject: RE: Navan Subdivision - Boundary Condition Request

Good morning Alex,

As we discussed last week our Client is looking into the option of converting the row townhouse units into duplex units (townhouse units with apartments in the basement). As a result, this will increase the total demand on the site and we will therefore require new water boundary conditions. We'd like to note that the footprint of the blocks will not change and neither will their layout or any of the offsets.

As a summary:

- Domestic demands were calculated based on a daily consumption rate of 280 L/cap/day with peaking factors consistent with City of Ottawa Guidelines
- Required Fire Flow (RFF) was calculated in accordance to the Fire Underwriters Survey (FUS) Water Supply for Public Fire Protection and the City of Ottawa FUS protocol (Bulletin ISDTB-2014-02 & Bulletin ISDTB-2018-02), which considers material, expose distance & height. We have attached the calculation spreadsheet and the figure.

We request boundary conditions under high pressure, peak hour, and maximum day + fire flow conditions (for each of the below fire flows). Domestic demand and fire flow calculations are attached. Please provide the boundary conditions at the proposed connection locations as shown in the attached figure.

Average Day Demand: 6.74 L/s
Maximum Day Demand: 10.53 L/s
Peak Hour Demand: 18.17 L/s
Required Fire Flow (per FUS): 6,000 L/min (100 L/s)
Required Fire Flow (per FUS): 10,000 L/min (167 L/s)
Required Fire Flow (per FUS): 14,000 L/min (233 L/s)
Required Fire Flow (per FUS): 15,000 L/min (250 L/s)

For your reference, the previous boundary condition received from the City is attached and below is the email chain.

If you have any questions or comments please let us know.

Thanks
Mahad



Mahad Musse, B.Eng., EIT
Civil Engineering Graduate

1000-343 Preston Street
Ottawa, ON, K1S 1N4

Work: [343-633-1501](tel:343-633-1501)
mmusse@jlrichards.ca

From: Polyak, Alex <alex.polyak@ottawa.ca>
Sent: Thursday, August 17, 2023 3:01 PM
To: William Rugamba <wrugamba@jlrichards.ca>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>; Shahira Jalal <sjalal@jlrichards.ca>
Subject: RE: Navan Subdivision - Boundary Condition Request

[CAUTION] This email originated from outside JLR. Do not click links or open attachments unless you recognize the sender and know the content is safe. Do not forward suspicious emails, if you are unsure, please send a separate message to Helpdesk.

Hello William,

Sorry that I missed your call, I was in a meeting. The boundary conditions are attached.

Regards,

Oleksandr (Alex) Polyak, B.Eng., P.Eng

Project Manager, Infrastructure Approvals, Development Review East Branch | Gestionnaire de projet, Direction de l'examen des projets d'aménagement – Est.
Planning, Real Estate and Economic Development Department | Direction générale de la planification, des biens immobiliers et du développement économique

City of Ottawa | Ville d'Ottawa
110 Laurier Ave., 4th Fl East, Ottawa ON K1P 1J1
Email: alex.polyak@ottawa.ca
Cell : 613-857-4380
www.Ottawa.ca



From: William Rugamba <wrugamba@jlrichards.ca>
Sent: August 15, 2023 9:26 AM
To: Polyak, Alex <alex.polyak@ottawa.ca>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>; Shahira Jalal <sjalal@jlrichards.ca>
Subject: RE: Navan Subdivision - Boundary Condition Request

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good morning Alex,

Just wanted to follow up on the status of this boundary request. Please let me know if you need anything else from us.

Thanks,
William

William Rugamba, M.Eng.
Civil Engineering Intern

J.L. Richards & Associates Limited
1000-343 Preston Street, Ottawa, ON K1S 1N4
Direct: 343-804-4374



Platinum member

From: Tatyana Roumie
Sent: Tuesday, July 25, 2023 3:53 PM
To: 'alex.polyak@ottawa.ca' <alex.polyak@ottawa.ca>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; carmine@zayoungroup.com;
Shahira Jalal <sjalal@jlrichards.ca>
Subject: Navan Subdivision - Boundary Condition Request

Hello Alex.

To support our upcoming detailed design for the site, we are requesting updated boundary conditions for the 3079 Navan Road Development.

As a brief history, we received boundary conditions from the City in July 2021 (attached, but with incorrect connection locations) and again in April 2022 (also attached) in support of the functional servicing design. We understand from the April 2022 boundary conditions that the maximum available fire flow for the site is 250 L/s.

We are currently requesting updated boundary conditions for this site as we are commencing the detailed servicing design and this request will accommodate the recent site plan changes and proposed connection points. This request is also applicable to the upcoming site plan designs which will be submitted as separate applications.

We request boundary conditions under high pressure, peak hour, and maximum day + fire flow conditions (for each of the below fire flows). Domestic demand and fire flow calculations are attached. Please provide the boundary conditions at the proposed connection locations as shown in the attached figure.

- Average Day Demand: 6.44 L/s**
- Maximum Day Demand: 9.77 L/s**
- Peak Hour Demand: 16.50 L/s**
- Required Fire Flow (per FUS): 6,000 L/min (100 L/s)**
- Required Fire Flow (per FUS): 10,000 L/min (167 L/s)**
- Required Fire Flow (per FUS): 14,000 L/min (233 L/s)**
- Required Fire Flow (per FUS): 15,000 L/min (250 L/s)**

Thanks,
Tatyana

'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.


'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'


Mixed-Use Site Plan (Block 17) Model Schematic

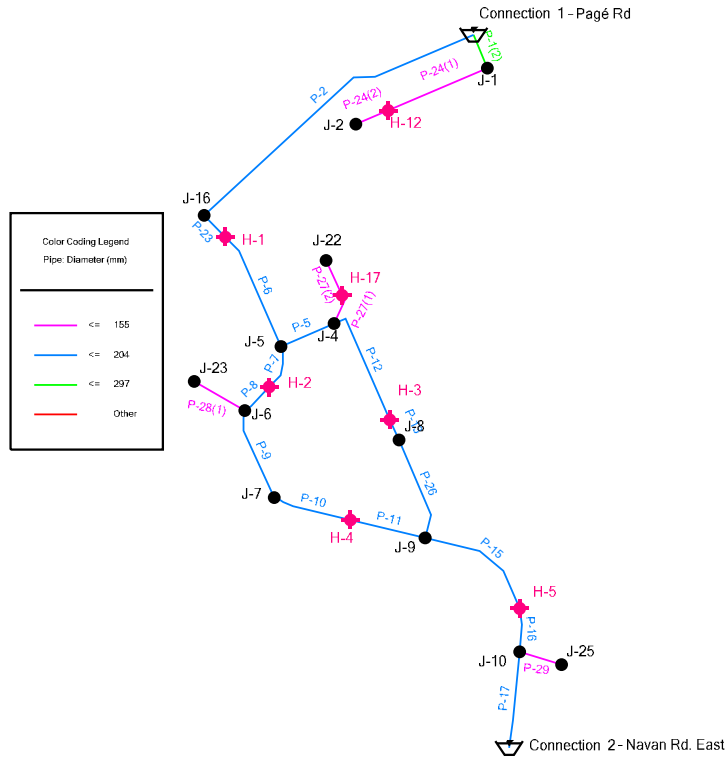

Mixed-Use Site Plan (Block 17)


Model Schematic

Elevation Model

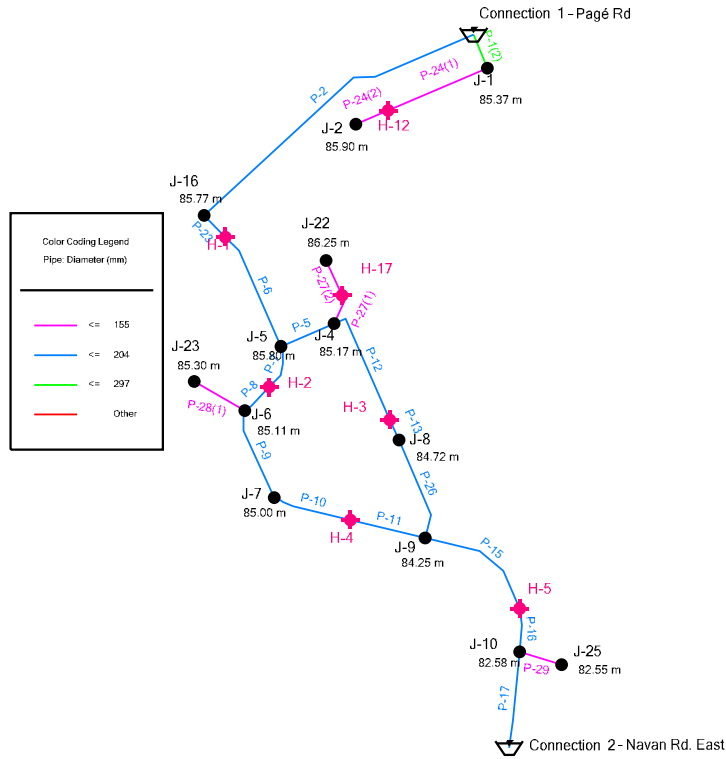

Mixed-Use Site Plan (Block 17)

Peak Hour Demand

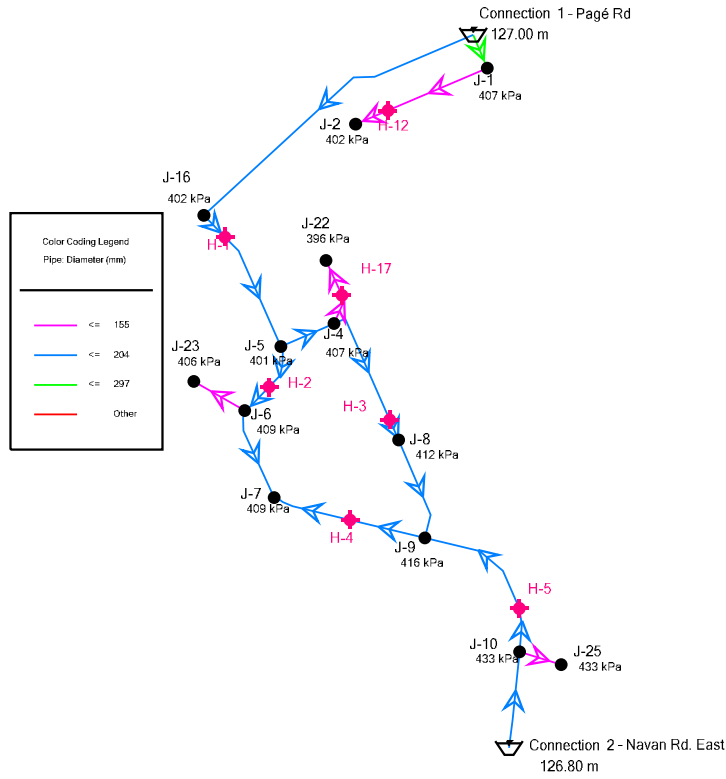

Mixed-Use Site Plan (Block 17)

Peak Hour Demand

Junction Table

Label	Elevation (m)	Demand (L/s)	Hydraulic Grade (m)	Pressure (kPa)
J-22	86.25	2.78	126.76	396
J-5	85.80	0.00	126.78	401
J-16	85.77	0.00	126.85	402
J-2	85.90	0.58	127.00	402
J-23	85.30	2.74	126.76	406
J-4	85.17	0.00	126.78	407
J-1	85.37	0.00	127.00	407
J-6	85.03	0.00	126.77	409
J-7	85.00	4.95	126.77	409
J-8	84.72	1.90	126.77	412
J-9	84.25	1.46	126.77	416
J-10	82.58	0.00	126.78	433
J-25	82.55	3.08	126.77	433

Mixed-Use Site Plan (Block 17)


Peak Hour Demand

Pipe Table

Label	Length (Scaled) (m)	Diameter (mm)	Material	Hazen-Williams C	Flow (L/s)	Velocity (m/s)
P-1(2)	19	297	PVC	120.0	-0.58	0.01
P-2	173	204	PVC	110.0	10.38	0.32
P-5	31	204	PVC	110.0	-4.93	0.15
P-6	64	204	PVC	110.0	-10.38	0.32
P-7	24	204	PVC	110.0	5.45	0.17
P-8	18	204	PVC	110.0	5.45	0.17
P-9	49	204	PVC	110.0	2.71	0.08
P-10	41	204	PVC	110.0	-2.24	0.07
P-11	40	204	PVC	110.0	-2.24	0.07
P-12	64	204	PVC	110.0	2.15	0.07
P-13	11	204	PVC	110.0	2.15	0.07
P-15	67	204	PVC	110.0	-3.45	0.11
P-16	23	204	PVC	110.0	-3.45	0.11
P-17	50	204	PVC	110.0	-6.53	0.20
P-23	16	204	PVC	110.0	10.38	0.32
P-24(1)	56	155	PVC	100.0	0.58	0.03
P-24(2)	18	155	PVC	100.0	0.58	0.03
P-26	55	204	PVC	110.0	0.25	0.01
P-27(1)	16	155	PVC	100.0	2.78	0.15
P-27(2)	20	155	PVC	100.0	2.78	0.15
P-28(1)	30	155	PVC	100.0	2.74	0.15
P-29	23	155	PVC	100.0	3.08	0.16

Mixed-Use Site Plan (Block 17)

Max Day + Fire Flow Requirement

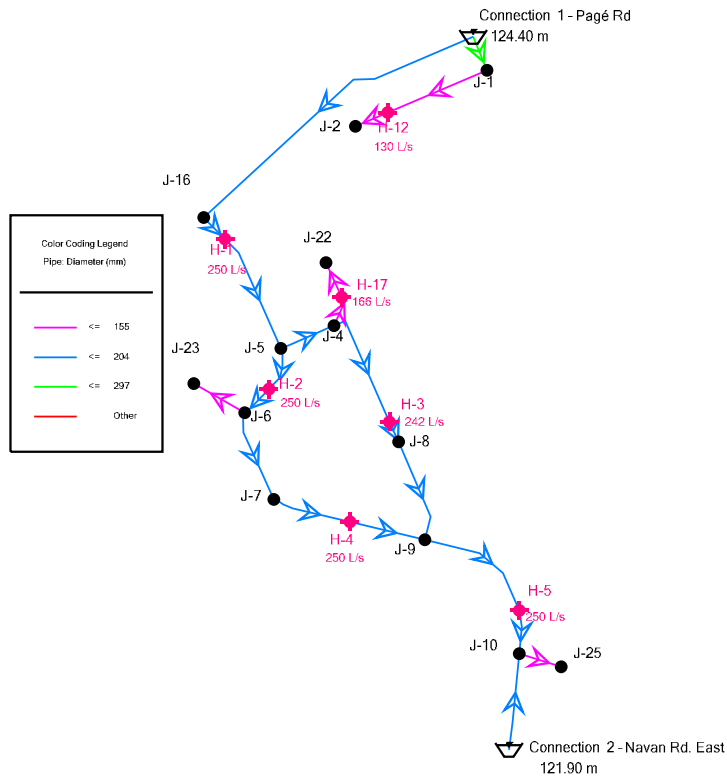


Mixed-Use Site Plan (Block 17)
Max Day + Fire Flow Requirement
Hydrant Table

Label	Satisfies Fire Flow Constraints?	Fire Flow (Available) (L/s)	Flow (Total Available) (L/s)	Pressure (Residual Lower Limit) (kPa)	Pressure (Calculated Residual) (kPa)	Pressure (Calculated System Lower Limit) (kPa)	Junction w/ Minimum Pressure (System)
H-1	True	250	250	140	164	186	J-16
H-2	True	250	250	140	142	148	J-23
H-3	True	242	242	140	140	155	J-8
H-4	True	250	250	140	144	154	J-7
H-5	True	250	250	140	253	256	J-22
H-12	True	130	130	140	144	140	J-2
H-17	True	166	166	140	143	140	J-22

Mixed-Use Site Plan (Block 17)

Maximum Pressure Analysis

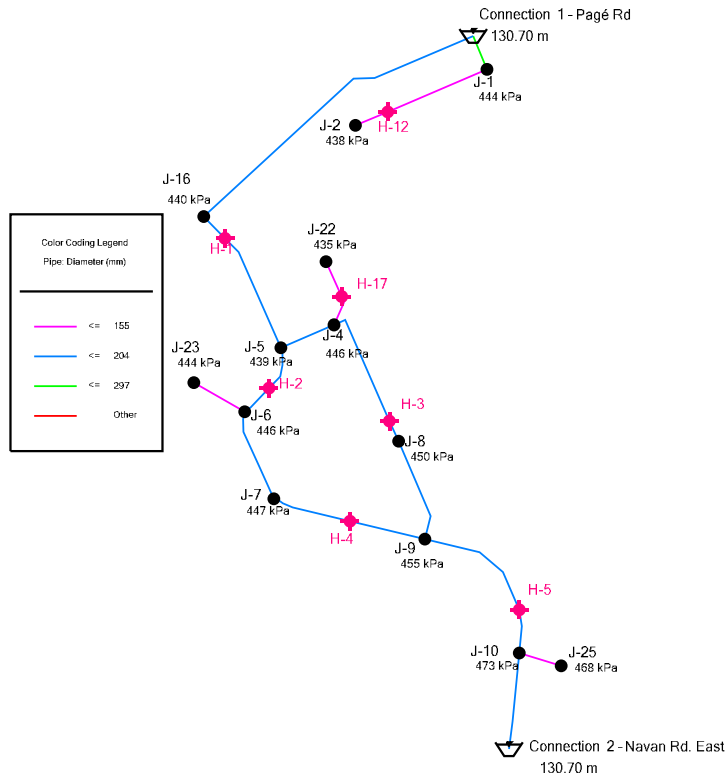

Mixed-Use Site Plan (Block 17)

Maximum Pressure Analysis

Junction Table

Label	Elevation (m)	Demand (L/s)	Hydraulic Grade (m)	Pressure (kPa)
J-22	86.25	0	130.70	435
J-2	85.90	0	130.70	438
J-5	85.80	0	130.70	439
J-16	85.77	0	130.70	440
J-1	85.37	0	130.70	444
J-23	85.30	0	130.70	444
J-4	85.17	0	130.70	446
J-6	85.11	0	130.70	446
J-7	85.00	0	130.70	447
J-8	84.72	0	130.70	450
J-9	84.25	0	130.70	455
J-25	82.90	0	130.70	468
J-10	82.42	0	130.70	473

Mixed-Use Site Plan (Block 17)

Maximum Pressure Analysis

Pipe Table

Label	Length (Scaled) (m)	Diameter (mm)	Material	Hazen-Williams C	Flow (L/s)	Velocity (m/s)
P-1(2)	19	297	PVC	120.0	0	0.00
P-2	173	204	PVC	110.0	0	0.00
P-5	31	204	PVC	110.0	0	0.00
P-6	64	204	PVC	110.0	0	0.00
P-7	24	204	PVC	110.0	0	0.00
P-8	18	204	PVC	110.0	0	0.00
P-9	49	204	PVC	110.0	0	0.00
P-10	41	204	PVC	110.0	0	0.00
P-11	40	204	PVC	110.0	0	0.00
P-12	64	204	PVC	110.0	0	0.00
P-13	11	204	PVC	110.0	0	0.00
P-15	67	204	PVC	110.0	0	0.00
P-16	23	204	PVC	110.0	0	0.00
P-17	50	204	PVC	110.0	0	0.00
P-23	16	204	PVC	110.0	0	0.00
P-24(1)	56	155	PVC	100.0	0	0.00
P-24(2)	18	155	PVC	100.0	0	0.00
P-26	55	204	PVC	110.0	0	0.00
P-27(1)	16	155	PVC	100.0	0	0.00
P-27(2)	20	155	PVC	100.0	0	0.00
P-28(1)	30	155	PVC	100.0	0	0.00
P-29	23	155	PVC	100.0	0	0.00

Appendix D

Stormwater Management

JLR NO. 29899-003 (NAVAN BLOCK 17)																																					
PIPE REACH			Peak Flow Estimation												Sewer Data					Upstream Geometry				Downstream Geometry				Self-Cleansing Velocities									
LOCATION	From MH	To MH	C-Factor (1.2 Year)			Cum. Total Area (ha)	Inlet Time (min.)	In Pipe Flow Time (min)	Total Time	12 Year Storm Rational Method			Pip Flows		Total Peak Flow (L/s)	Type	Nominal Dia. (mm)	Actual Dia. (mm)	Slope	Length (m)	Q Full (L/s)	V Full (m/s)	Residual Capacity (L/s)	% Full	TG From	Obvert	Invert	Cover	TG To	Drop	Obvert	Invert	Cover	Q/Q ₁ Ratio	Flow Depth (mm)	Actual Velocity (m/s)	Flow Depth to Dia. Ratio (d/D)
			0.20	0.30	0.80					1.2 Year Storm Intensity (mm/hr)	1.2 Year Peak Flow (L/s)	ICD Flow EXIST (L/s)	Roof Drain Flow (L/s)	Custom Flow (L/s)																							
EAST ORLEANS RIDGE SUBDIVISION ⁽¹⁾	UPSTREAM	EX MH 504	Refer to Note 8			5.00	16.86	0.25	16.31	10.18	52.36	604.31	454.00	454.00	CONCRETE	825	825.00	0.250%	20.7	748.75	1.36	144.42	81%	82.44	79.84	79.10	2.51	82.46	0.20	79.80	79.05	2.57			Refer to Note 9		
BLOCK 17	BLOCK 17	MH 505	0.213	0.033	0.321	0.567	16.80	0.14	16.14	0.95	75.81	72.84	4.00	41.00	45.60	PVC	300	304.80	1.60%	13.8	123.05	1.60	60.71	89%	82.60	79.74	79.44	3.14	82.35	0.36	79.53	79.23	2.80	0.36	127.10	1.66	0.42
BLOCK 17	MH 505	EX MH 504				0.567	16.14	0.26	16.39	0.95	76.29	72.36		45.60	45.60	PVC	300	304.80	1.60%	26.7	123.05	1.60	61.30	89%	82.35	79.47	79.17	2.68	82.46	0.36	79.09	78.78	3.37	0.36	127.10	1.66	0.42
EAST ORLEANS RIDGE SUBDIVISION ⁽¹⁾	EX MH 504	EX MH 503	Refer to Note 8			6.56	16.31	0.67	16.98	11.38	58.84	669.32		499.00	CONCRETE	900	914.00	0.250%	27.7	844.20	1.44	274.97	71%	82.40	79.68	78.17	3.37	81.65	0.07	78.34	78.03	2.91	0.53	471.83	1.46	0.52	

Design Parameters (Per OSD)
Manning's Coefficient: 0.013
1.2 Year Intensity: 4.2 mm/hr @ 6.150% R.O.
Note: Tc is the time of concentration in minutes


Drainage Areas Breakdown
Total Site Area: 0.554 ha
Controlled Area Within Site Boundaries: 0.534 ha
Existing Areas Captured Within Site: 0.533 ha
Total Captured Areas: 0.554 ha
Uncontrolled Area - Outlet to Plug: 0.020 ha
This area is part of the total site area (0.554 ha)

Notes on Pipe Flows
(1) Controlled flow rate downstream of EXIST MPROOF as part of the East Orleans Ridge subdivision
(2) Total flow rates of roof drains for Buildings E and F
(3) Custom Outflow Rate


Notes on Peak Flow and Pipe Sizing
(4) Allowable Release Rate from Site (ALR_s) is equal to the sum of Existing Flow (ELF) and Roof Drain Flow (RDF)
(5) Downstream Peak Flow is equal to allowable release rate for site (45 L/s) combined with the existing controlled flows from the subdivision (454 L/s)
(6) Pipes are conservatively sized for 1.2 Year Peak Flow Rate
(7) Actual Velocities based on actual peak flows from Note 5
(8) Additional details from Existing Sewers can be found within East Orleans Ridge Subdivision Design Sheet


REAR YARD CATCH BASIN TABLE


Street Name	CB ID Number	T/G	Inlet					Outlet				Drop (m)	CATCH BASIN TYPE	ICD TYPE
			Pipe Dia. (mm)	Pipe Length (m)	Slope	Invert	Cover	Pipe Dia. (mm)	Pipe Length (m)	Invert	COVER (m)			
BLOCK 17	CB124	81.05	-	-	-	-	-	250	23.32	79.470	1.33		CATCH BASIN ELBOW PER CITY STANDARD S30	NO ICD
	CB122	80.80	-	-	-	-	-	250	12.24	79.350	1.20		CATCH BASIN ELBOW PER CITY STANDARD S30	NO ICD
	CB123	81.35	250	23.32	1.0%	79.237	1.86	250	3.49	79.168	1.93	0.06	600x600mm PRECAST CONCRETE PER OPSD 705.010 C/W FRAME AND COVER AS PER CITY OF OTTAWA S19	Vortex_ICD_70
			250	12.24	1.0%	79.228	1.87							
CB125	82.00	-	-	-	-	-	200	1.90	80.200	1.60		600x600mm PRECAST CONCRETE PER OPSD 705.010 C/W FRAME AND COVER AS PER CITY OF OTTAWA S19	Vortex_ICD_70	

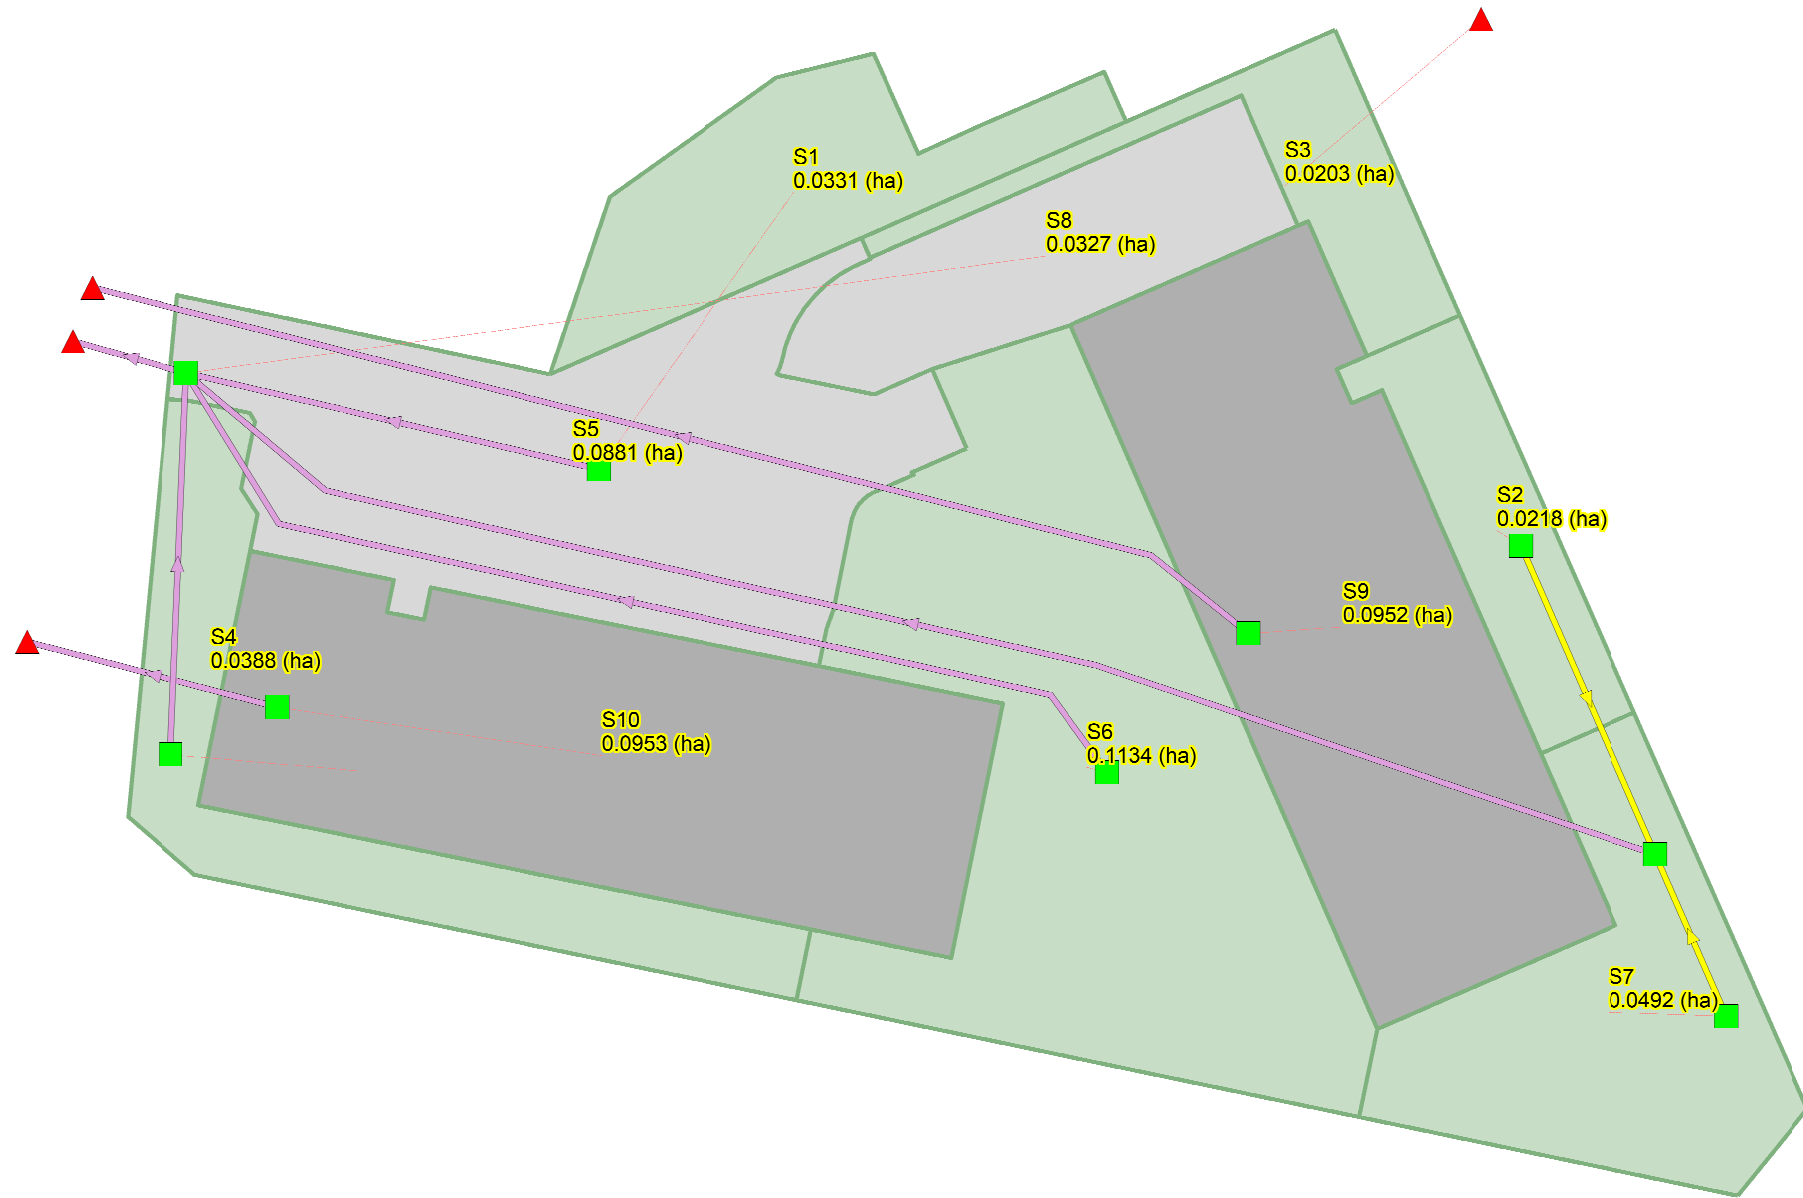

- Legend**
- ▲ Outfalls
 - Storages
 - Conduits
 - Outlets
- Subcatchments**
- Rear-Yard
 - Parking Lot Area
 - Ramp to Garage
 - Building

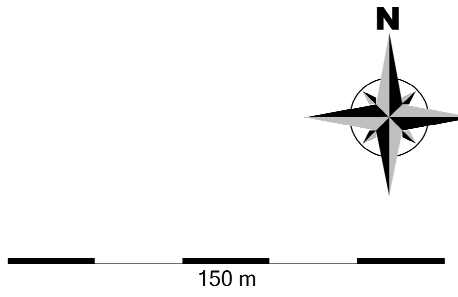

PROJECT: NAVAN RESIDENTIAL SITE PLAN - BLOCK 17 Ottawa, ON			
DRAWING: Overall System Model Schematic			
 J.L. Richards <small>ENGINEERS · ARCHITECTS · PLANNERS</small>	This drawing is copyright protected and may not be reproduced or use for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.		DESIGN: ML
			JLR NO.: 29899-002
			DRAWING NO.: Figure 3
		CHECKED: BP	



Legend

- C-Factor
- Area Tributary to Subdivision (C-Factor - 0.3)
 - Landscaped Areas (C-Factor - 0.2)
 - Pavement Areas (C-Factor - 0.9)

PROJECT:		NAVAN RESIDENTIAL AND COMMERCIAL BLOCK 14	
		OTTAWA, ONTARIO	
DRAWING:		OVERALL SITE IMPERVIOUSNESS	
<p>J.L. Richards ENGINEERS · ARCHITECTS · PLANNERS</p>	This drawing is copyright protected and may not be reproduced or used for purposes other than execution of the described work without express written consent of J.L. Richards & Associates Limited.		DESIGN: ML
			DRAWING NO: 29899-002
	DRAWN: ML		DRAWING NO:
CHECKED: BP		Figure	

Post-Development 3-hour Chicago 1:2 year Event

```

[;TITLE]
;;Project Title/Notes

[;OPTIONS]
;;Option Value
FLOW_UNITS CMS
INFILTRATION HORTON
FLOW_ROUTING DYNWAVE
LINK_OFFSETS ELEVATION
MIN_SLOPE 0
ALLOW_PONDING NO
SKIP_STEADY_STATE NO

START_DATE 01/01/2000
START_TIME 00:00:00
REPORT_START_DATE 01/01/2000
REPORT_START_TIME 00:00:00
END_DATE 01/01/2000
END_TIME 03:00:00
SWEEP_START 1/1
SWEEP_END 12/31
DRY_DAYS 0
REPORT_STEP 00:01:00
WET_STEP 00:05:00
DRY_STEP 00:05:00
ROUTING_STEP 5
RULE_STEP 00:00:00

INERTIAL_DAMPING PARTIAL
NORMAL_FLOW_LIMITED BOTH
FORCE_MAIN_EQUATION H-W
VARIABLE_STEP 0.75
LENGTHENING_STEP 0
MIN_SURFAREA 0
MAX_TRIALS 8
HEAD_TOLERANCE 0
SYS_FLOW_TOL 5
LAT_FLOW_TOL 5
MINIMUM_STEP 0.5
THREADS 12

[;EVAPORATION]
;;Data Source Parameters
CONSTANT 0.0
DRY_ONLY NO

[;RAINGAGES]
;;Name Format Interval SCF Source
3CHI1002 INTENSITY 0:10 1.0 TIMESERIES 3CHI1002
3CHI1100 INTENSITY 0:10 1.0 TIMESERIES 3CHI1100

[;SUBCATCHMENTS]
;;Name Rain Gage Outlet Area %Imperv Width %Slope CurbLen
S1 3CHI1002 CB120 0.0331 14.286 38.601 1.5 0
S10 3CHI1002 Roof2 0.0953 100 18 1 0
S2 3CHI1002 CB124 0.0218 11.125 38.94 2.1 0
S3 3CHI1002 OF2 0.0203 0 26.019 2 0
S4 3CHI1002 CB125 0.0388 3.093 163.644 1.5 0
S5 3CHI1002 CB120 0.0881 77.464 79.845 2 0
S6 3CHI1002 CB121 0.1134 17.819 105.724 2.1 0
S7 3CHI1002 CB122 0.0492 13.679 44.221 3.3 0
S8 3CHI1002 St_UnGrd 0.0327 95.747 11.978 5.2 0
S9 3CHI1002 Roof1 0.0952 100 18 1 0

[;SUBAREAS]
;;Subcatchment N-Imperv N-Perv S-Imperv S-Perv PctZero RouteTo PctRouted
S1 0.013 0.25 1.57 4.67 0 OUTLET 100
S10 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S2 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S3 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S4 0.013 0.25 1.57 4.67 0 OUTLET 100
S5 0.013 0.25 1.57 4.67 0 OUTLET 100
S6 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S7 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S8 0.013 0.25 1.57 4.67 0 OUTLET 100
S9 0.013 0.25 1.57 4.67 0 OUTLET 100

[;INFILTRATION]
;;Subcatchment Param1 Param2 Param3 Param4 Param5
S1 76.2 13.2 4.14 7 0
S10 76.2 13.2 4.14 7 0
S2 76.2 13.2 4.14 7 0
S3 76.2 13.2 4.14 7 0
S4 76.2 13.2 4.14 7 0
S5 76.2 13.2 4.14 7 0
S6 76.2 13.2 4.14 7 0
S7 76.2 13.2 4.14 7 0
S8 76.2 13.2 4.14 7 0
S9 76.2 13.2 4.14 7 0

[;OUTFALLS]
;;Name Elevation Type Stage Data Gated Route To
MH505 78 NORMAL NO 0 0
OF2 0 FREE NO 0 0
OF3 78.88 NORMAL NO 0 0
OF4 78.88 NORMAL NO 0 0

[;STORAGE]
;;Name Elev. Psi MaxDepth Ksat InitDepth IMD Shape Curve Name/Params
SurDepth Fevap
CB120 82.1 0.3 0 0 TABULAR CB120 0
CB121 82.28 0.3 0 0 TABULAR CB121 0
CB122 79.35 1.7 0 0 TABULAR CB122 0
CB123 79.168 2.182 0 0 TABULAR CB123 0
CB124 79.47 1.78 0 0 TABULAR CB124 0
CB125 80.2 2 0 0 TABULAR CB125 0
Roof1 88.85 0.15 0 0 FUNCTIONAL 0 0 635 0
Roof2 88.85 0.15 0 0 FUNCTIONAL 0 0 635 0
St_UnGrd 78 1 0 0 FUNCTIONAL 0 0 49 0

[;CONDUITS]
;;Name From Node To Node Length Roughness InOffset OutOffset
InitFlow MaxFlow
C1 0.04 CB124 CB123 23.322 0.013 79.47 79.24
C2 0.04 CB122 CB123 12.244 0.013 79.35 79.228

[;OUTLETS]
;;Name From Node To Node Offset Type QTable/Qcoeff
Qexpon Gated
C1 0.04 CB124 CB123 23.322 0.013 79.47 79.24
C2 0.04 CB122 CB123 12.244 0.013 79.35 79.228

[;CURVES]
;;Name Type X-Value Y-Value
CBMH Inlet Capture Curve based on the OSDG Appendix 7-A
CBMH Rating 0 0.122 0.06
CBMH 0.183 0.073
CBMH 0.2 0.076
CBMH 0.243 0.084
CBMH 0.305 0.094

DI_GRATE_A_OPSD403.01 Rating 0.02 0.00762
DI_GRATE_A_OPSD403.01 0.04 0.01524
DI_GRATE_A_OPSD403.01 0.08 0.0381
DI_GRATE_A_OPSD403.01 0.12 0.06858
DI_GRATE_A_OPSD403.01 0.2 0.1524
DI_GRATE_A_OPSD403.01 0.26 0.23622
DI_GRATE_A_OPSD403.01 0.36 0.4572
DI_GRATE_A_OPSD403.01 0.46 0.6858

DI_GRATE_C_OPSD403.01 Rating 0.02 0.01465
DI_GRATE_C_OPSD403.01 0.04 0.0293
DI_GRATE_C_OPSD403.01 0.08 0.07325
DI_GRATE_C_OPSD403.01 0.12 0.13185
DI_GRATE_C_OPSD403.01 0.2 0.293
DI_GRATE_C_OPSD403.01 0.26 0.45415
DI_GRATE_C_OPSD403.01 0.36 0.879
DI_GRATE_C_OPSD403.01 0.46 1.3185

Les Produits MURPHCO Ltée Rating 0 0
Les Produits MURPHCO Ltée 0.0127 4E-05
Les Produits MURPHCO Ltée 0.0254 0.00019
Les Produits MURPHCO Ltée 0.0381 0.00032
Les Produits MURPHCO Ltée 0.0508 0.00051
Les Produits MURPHCO Ltée 0.0635 0.00064
Les Produits MURPHCO Ltée 0.0762 0.00083
Les Produits MURPHCO Ltée 0.0889 0.00093
Les Produits MURPHCO Ltée 0.1016 0.00101
Les Produits MURPHCO Ltée 0.1143 0.00111
Les Produits MURPHCO Ltée 0.127 0.0012
Les Produits MURPHCO Ltée 0.1397 0.00128
Les Produits MURPHCO Ltée 0.1524 0.00135

;Reversed Flow from rear yard manhole_Lid to the Street
Manhole_Lid Rating 0 0
Manhole_Lid 0.11 0
Manhole_Lid 0.2 0.187
Manhole_Lid 0.3 0.395
Manhole_Lid 0.4 0.602
Manhole_Lid 0.5 0.81
Manhole_Lid 0.6 1.018
Manhole_Lid 0.7 1.225
Manhole_Lid 0.8 1.433
Manhole_Lid 0.9 1.641
Manhole_Lid 1 1.848

;Tempest Rating Curve for MHF IPEX TYPE A, No grate allowance
MHF IPEX TYPE A Rating 0 0
MHF IPEX TYPE A 0.1 0.0057
MHF IPEX TYPE A 0.2 0.0081
MHF IPEX TYPE A 0.3 0.0099
MHF IPEX TYPE A 0.4 0.0114
MHF IPEX TYPE A 0.5 0.0128
MHF IPEX TYPE A 0.6 0.014
MHF IPEX TYPE A 0.7 0.0151
MHF IPEX TYPE A 0.8 0.0162
MHF IPEX TYPE A 0.9 0.0172
MHF IPEX TYPE A 1 0.0181
MHF IPEX TYPE A 1.2 0.0198
MHF IPEX TYPE A 1.4 0.0214
MHF IPEX TYPE A 1.6 0.0229
MHF IPEX TYPE A 1.8 0.0243
MHF IPEX TYPE A 2 0.0256
MHF IPEX TYPE A 2.5 0.0286
MHF IPEX TYPE A 3 0.0313

;Tempest Rating Curve for MHF IPEX TYPE B, No grate allowance
MHF IPEX TYPE B Rating 0 0
MHF IPEX TYPE B 0.1 0.0081
MHF IPEX TYPE B 0.2 0.0115
MHF IPEX TYPE B 0.3 0.0141
MHF IPEX TYPE B 0.4 0.0162
MHF IPEX TYPE B 0.5 0.0182
MHF IPEX TYPE B 0.6 0.0199
MHF IPEX TYPE B 0.7 0.0215
MHF IPEX TYPE B 0.8 0.023
MHF IPEX TYPE B 0.9 0.0244
MHF IPEX TYPE B 1 0.0257
MHF IPEX TYPE B 1.2 0.0281
MHF IPEX TYPE B 1.4 0.0304
MHF IPEX TYPE B 1.6 0.0325
MHF IPEX TYPE B 1.8 0.0344
MHF IPEX TYPE B 2 0.0363
MHF IPEX TYPE B 2.5 0.0406
MHF IPEX TYPE B 3 0.0445

;Tempest Rating Curve for MHF IPEX TYPE C, No grate allowance
MHF IPEX TYPE C Rating 0 0
MHF IPEX TYPE C 0.1 0.0106
MHF IPEX TYPE C 0.2 0.015
MHF IPEX TYPE C 0.3 0.0183
MHF IPEX TYPE C 0.4 0.0212
MHF IPEX TYPE C 0.5 0.0237
MHF IPEX TYPE C 0.6 0.0259
MHF IPEX TYPE C 0.7 0.028
MHF IPEX TYPE C 0.8 0.0299
MHF IPEX TYPE C 0.9 0.0317
MHF IPEX TYPE C 1 0.0335
MHF IPEX TYPE C 1.2 0.0366
MHF IPEX TYPE C 1.4 0.0396
MHF IPEX TYPE C 1.6 0.0423
MHF IPEX TYPE C 1.8 0.0449

[;XSECTIONS]
;;Link Shape Geom1 Geom2 Geom3 Geom4 Barrels
Culvert
C1 CIRCULAR 0.25 0 0 0 1
C2 CIRCULAR 0.25 0 0 0 1

[;LOSSES]
;;Link Kentry Kexit Kavg Flap Gate Seepage

[;INFLOWS]
;;Node Constituent Time Series Type Mfactor Sfactor Baseline Pattern
St_UnGrd FLOW InfiltratedInflow FLOW 1.0 1 0

[;BLDG_E]
Roof2 OF4 88.85 TABULAR/HEAD O_Roof2
[;BLDG_F]
Roof1 OF3 88.85 TABULAR/HEAD O_Roof1
CB120 CB120 St_UnGrd 82.1 TABULAR/HEAD ZURN_Z150F-6NH
CB121 CB121 St_UnGrd 82.28 TABULAR/HEAD ZURN_Z150F-6NH
CB123 CB123 St_UnGrd 79.168 TABULAR/HEAD Vortex_ICD_70
CB125 CB125 St_UnGrd 80.2 TABULAR/HEAD Vortex_ICD_70
OL1 St_UnGrd MH505 78 TABULAR/HEAD O_St_UnGrd

```

MHF_IPEX_TYPE_C	2	0.0473	Vortex_ICD_50	Rating	0	0
MHF_IPEX_TYPE_C	2.5	0.0529	Vortex_ICD_50		0.1	0.0007
MHF_IPEX_TYPE_C	3	0.0579	Vortex_ICD_50		0.2	0.001
;Tempest Rating Curve for MHF IPEX TYPE D, No grate allowance						
MHF_IPEX_TYPE_D	Rating	0	Vortex_ICD_50		0.3	0.0012
MHF_IPEX_TYPE_D	0.1	0.0154	Vortex_ICD_50		0.4	0.0014
MHF_IPEX_TYPE_D	0.2	0.0217	Vortex_ICD_50		0.5	0.0016
MHF_IPEX_TYPE_D	0.3	0.0266	Vortex_ICD_50		0.6	0.0018
MHF_IPEX_TYPE_D	0.4	0.0307	Vortex_ICD_50		0.7	0.0019
MHF_IPEX_TYPE_D	0.5	0.0343	Vortex_ICD_50		0.8	0.002
MHF_IPEX_TYPE_D	0.6	0.0375	Vortex_ICD_50		0.9	0.0021
MHF_IPEX_TYPE_D	0.7	0.0406	Vortex_ICD_50		1	0.0023
MHF_IPEX_TYPE_D	0.8	0.0434	Vortex_ICD_50		1.2	0.0025
MHF_IPEX_TYPE_D	0.9	0.0461	Vortex_ICD_50		1.4	0.0027
MHF_IPEX_TYPE_D	1	0.0485	Vortex_ICD_50		1.6	0.0029
MHF_IPEX_TYPE_D	1.2	0.0532	Vortex_ICD_50		1.8	0.003
MHF_IPEX_TYPE_D	1.4	0.0574	Vortex_ICD_50		2	0.0032
MHF_IPEX_TYPE_D	1.6	0.0614	Vortex_ICD_50		2.5	0.0036
MHF_IPEX_TYPE_D	1.8	0.0651	Vortex_ICD_50		3	0.0039
MHF_IPEX_TYPE_D	2	0.0687	;Tempest Rating Curve for Vortex ICD 55, No grate allowance			
MHF_IPEX_TYPE_D	2.5	0.0768	Vortex_ICD_55	Rating	0.1	0.0009
MHF_IPEX_TYPE_D	3	0.0841	Vortex_ICD_55		0.2	0.0012
;Tempest Rating Curve for MHF IPEX TYPE E, No grate allowance						
MHF_IPEX_TYPE_E	Rating	0	Vortex_ICD_55		0.3	0.0015
MHF_IPEX_TYPE_E	0.1	0.0205	Vortex_ICD_55		0.4	0.0017
MHF_IPEX_TYPE_E	0.2	0.0289	Vortex_ICD_55		0.5	0.0019
MHF_IPEX_TYPE_E	0.3	0.0355	Vortex_ICD_55		0.6	0.0021
MHF_IPEX_TYPE_E	0.4	0.0409	Vortex_ICD_55		0.7	0.0023
MHF_IPEX_TYPE_E	0.5	0.0458	Vortex_ICD_55		0.8	0.0024
MHF_IPEX_TYPE_E	0.6	0.0501	Vortex_ICD_55		0.9	0.0026
MHF_IPEX_TYPE_E	0.7	0.0542	Vortex_ICD_55		1	0.0027
MHF_IPEX_TYPE_E	0.8	0.0579	Vortex_ICD_55		1.2	0.003
MHF_IPEX_TYPE_E	0.9	0.0614	Vortex_ICD_55		1.4	0.0032
MHF_IPEX_TYPE_E	1	0.0647	Vortex_ICD_55		1.6	0.0034
MHF_IPEX_TYPE_E	1.2	0.0709	Vortex_ICD_55		1.8	0.0036
MHF_IPEX_TYPE_E	1.4	0.0766	Vortex_ICD_55		2	0.0038
MHF_IPEX_TYPE_E	1.6	0.0819	Vortex_ICD_55		2.5	0.0043
MHF_IPEX_TYPE_E	1.8	0.0868	Vortex_ICD_55		3	0.0047
MHF_IPEX_TYPE_E	2	0.0915	;Tempest Rating Curve for Vortex ICD 60, No grate allowance			
MHF_IPEX_TYPE_E	2.5	0.1023	Vortex_ICD_60	Rating	0.1	0.0011
MHF_IPEX_TYPE_E	3	0.1121	Vortex_ICD_60		0.2	0.0015
O_Roof1	Rating	0	Vortex_ICD_60		0.3	0.0018
O_Roof1	0.001	0.002	Vortex_ICD_60		0.4	0.0021
O_Roof1	0.15	0.002	Vortex_ICD_60		0.5	0.0023
O_Roof2	Rating	0	Vortex_ICD_60		0.6	0.0025
O_Roof2	0.001	0.002	Vortex_ICD_60		0.7	0.0027
O_Roof2	0.15	0.002	Vortex_ICD_60		0.8	0.0029
O_St_L1	Rating	0	Vortex_ICD_60		0.9	0.0031
O_St_L1	0.001	0.003	Vortex_ICD_60		1	0.0032
O_St_L1	0.35	0.003	Vortex_ICD_60		1.2	0.0036
O_St_L2	Rating	0	Vortex_ICD_60		1.4	0.0038
O_St_L2	0.001	0.002	Vortex_ICD_60		1.6	0.0041
O_St_L2	0.35	0.002	Vortex_ICD_60		1.8	0.0043
O_St_L3	Rating	0	Vortex_ICD_60		2	0.0046
O_St_L3	0.001	0.0137	Vortex_ICD_60		2.5	0.0051
O_St_L3	0.35	0.0137	Vortex_ICD_60		3	0.0056
O_St_UnGrd	Rating	0	;Tempest Rating Curve for Vortex ICD 65, No grate allowance			
O_St_UnGrd	0.01	0.041	Vortex_ICD_65	Rating	0	0
O_St_UnGrd	1	0.041	Vortex_ICD_65		0.1	0.0012
;Tempest Rating Curve for Vortex ICD 100, No grate allowance						
Vortex_ICD_100	Rating	0	Vortex_ICD_65		0.2	0.0016
Vortex_ICD_100	0.1	0.0028	Vortex_ICD_65		0.3	0.002
Vortex_ICD_100	0.2	0.004	Vortex_ICD_65		0.4	0.0023
Vortex_ICD_100	0.3	0.0049	Vortex_ICD_65		0.5	0.0025
Vortex_ICD_100	0.4	0.0056	Vortex_ICD_65		0.6	0.0028
Vortex_ICD_100	0.5	0.0063	Vortex_ICD_65		0.7	0.003
Vortex_ICD_100	0.6	0.0069	Vortex_ICD_65		0.8	0.0032
Vortex_ICD_100	0.7	0.0075	Vortex_ICD_65		0.9	0.0034
Vortex_ICD_100	0.8	0.008	Vortex_ICD_65		1	0.0036
Vortex_ICD_100	0.9	0.0085	Vortex_ICD_65		1.2	0.0038
Vortex_ICD_100	1	0.0089	Vortex_ICD_65		1.4	0.0041
Vortex_ICD_100	1.2	0.0098	Vortex_ICD_65		1.6	0.0043
Vortex_ICD_100	1.4	0.0106	Vortex_ICD_65		1.8	0.0046
Vortex_ICD_100	1.6	0.0113	Vortex_ICD_65		2	0.0049
Vortex_ICD_100	1.8	0.012	Vortex_ICD_65		2.5	0.0051
Vortex_ICD_100	2	0.0126	Vortex_ICD_65		3	0.0057
Vortex_ICD_100	2.5	0.0141	;Tempest Rating Curve for Vortex ICD 70, No grate allowance			
Vortex_ICD_100	3	0.0155	Vortex_ICD_70	Rating	0	0
;Tempest Rating Curve for Vortex ICD 105, No grate allowance						
Vortex_ICD_105	Rating	0.1	Vortex_ICD_70		0.1	0.0013
Vortex_ICD_105	0.2	0.0044	Vortex_ICD_70		0.2	0.0019
Vortex_ICD_105	0.3	0.0054	Vortex_ICD_70		0.3	0.0023
Vortex_ICD_105	0.4	0.0062	Vortex_ICD_70		0.4	0.0027
Vortex_ICD_105	0.5	0.0069	Vortex_ICD_70		0.5	0.003
Vortex_ICD_105	0.6	0.0076	Vortex_ICD_70		0.6	0.0033
Vortex_ICD_105	0.7	0.0082	Vortex_ICD_70		0.7	0.0036
Vortex_ICD_105	0.8	0.0088	Vortex_ICD_70		0.8	0.0038
Vortex_ICD_105	0.9	0.0093	Vortex_ICD_70		0.9	0.0041
Vortex_ICD_105	1	0.0098	Vortex_ICD_70		1	0.0043
Vortex_ICD_105	1.2	0.0107	Vortex_ICD_70		1.2	0.0046
Vortex_ICD_105	1.4	0.0116	Vortex_ICD_70		1.4	0.0049
Vortex_ICD_105	1.6	0.0124	Vortex_ICD_70		1.6	0.0051
Vortex_ICD_105	1.8	0.0131	Vortex_ICD_70		1.8	0.0054
Vortex_ICD_105	2	0.0139	Vortex_ICD_70		2	0.0058
Vortex_ICD_105	2.5	0.0155	Vortex_ICD_70		2.5	0.0061
Vortex_ICD_105	3	0.017	Vortex_ICD_70		3	0.0068
;Tempest Rating Curve for Vortex ICD 40, No grate allowance						
Vortex_ICD_40	Rating	0	Vortex_ICD_70		3	0.0075
Vortex_ICD_40	0.1	0.0004	;Tempest Rating Curve for Vortex ICD 75, No grate allowance			
Vortex_ICD_40	0.2	0.0006	Vortex_ICD_75	Rating	0	0
Vortex_ICD_40	0.3	0.0007	Vortex_ICD_75		0.1	0.0016
Vortex_ICD_40	0.4	0.0009	Vortex_ICD_75		0.2	0.0022
Vortex_ICD_40	0.5	0.001	Vortex_ICD_75		0.3	0.0027
Vortex_ICD_40	0.6	0.001	Vortex_ICD_75		0.4	0.0032
Vortex_ICD_40	0.7	0.0011	Vortex_ICD_75		0.5	0.0035
Vortex_ICD_40	0.8	0.0012	Vortex_ICD_75		0.6	0.0039
Vortex_ICD_40	0.9	0.0013	Vortex_ICD_75		0.7	0.0042
Vortex_ICD_40	1	0.0014	Vortex_ICD_75		0.8	0.0045
Vortex_ICD_40	1.2	0.0015	Vortex_ICD_75		0.9	0.0048
Vortex_ICD_40	1.4	0.0016	Vortex_ICD_75		1	0.005
Vortex_ICD_40	1.6	0.0017	Vortex_ICD_75		1.2	0.0055
Vortex_ICD_40	1.8	0.0018	Vortex_ICD_75		1.4	0.0059
Vortex_ICD_40	2	0.0019	Vortex_ICD_75		1.6	0.0063
Vortex_ICD_40	2.5	0.0022	Vortex_ICD_75		1.8	0.0067
Vortex_ICD_40	3	0.0024	Vortex_ICD_75		2	0.0071
;Tempest Rating Curve for Vortex ICD 45, No grate allowance						
Vortex_ICD_45	Rating	0	Vortex_ICD_75		2.5	0.0079
Vortex_ICD_45	0.1	0.0006	Vortex_ICD_75		3	0.0087
Vortex_ICD_45	0.2	0.0008	;Tempest Rating Curve for Vortex ICD 80, No grate allowance			
Vortex_ICD_45	0.3	0.001	Vortex_ICD_80	Rating	0	0
Vortex_ICD_45	0.4	0.0011	Vortex_ICD_80		0.1	0.0018
Vortex_ICD_45	0.5	0.0013	Vortex_ICD_80		0.2	0.0026
Vortex_ICD_45	0.6	0.0014	Vortex_ICD_80		0.3	0.0031
Vortex_ICD_45	0.7	0.0015	Vortex_ICD_80		0.4	0.0036
Vortex_ICD_45	0.8	0.0016	Vortex_ICD_80		0.5	0.004
Vortex_ICD_45	0.9	0.0017	Vortex_ICD_80		0.6	0.0044
Vortex_ICD_45	1	0.0018	Vortex_ICD_80		0.7	0.0048
Vortex_ICD_45	1.2	0.002	Vortex_ICD_80		0.8	0.0051
Vortex_ICD_45	1.4	0.0021	Vortex_ICD_80		0.9	0.0054
Vortex_ICD_45	1.6	0.0023	Vortex_ICD_80		1	0.0057
Vortex_ICD_45	1.8	0.0024	Vortex_ICD_80		1.2	0.0063
Vortex_ICD_45	2	0.0026	Vortex_ICD_80		1.4	0.0068
Vortex_ICD_45	2.5	0.0029	Vortex_ICD_80		1.6	0.0072
Vortex_ICD_45	3	0.0031	Vortex_ICD_80		1.8	0.0077
;Tempest Rating Curve for Vortex ICD 50, No grate allowance						
Vortex_ICD_50	Rating	0	Vortex_ICD_80		2	0.0081
Vortex_ICD_50	0.1	0.0006	Vortex_ICD_80		2.5	0.009
Vortex_ICD_50	0.2	0.0008	Vortex_ICD_80		3	0.0099
Vortex_ICD_50	0.3	0.001	;Tempest Rating Curve for Vortex ICD 85, No grate allowance			
Vortex_ICD_50	0.4	0.0011	Vortex_ICD_85	Rating	0	0
Vortex_ICD_50	0.5	0.0013	Vortex_ICD_85		0.1	0.002
Vortex_ICD_50	0.6	0.0014	Vortex_ICD_85		0.2	0.0029
Vortex_ICD_50	0.7	0.0015	Vortex_ICD_85		0.3	0.0035
Vortex_ICD_50	0.8	0.0016	Vortex_ICD_85		0.4	0.0041
Vortex_ICD_50	0.9	0.0017	Vortex_ICD_85		0.5	0.0045
Vortex_ICD_50	1	0.0018	Vortex_ICD_85		0.6	0.005
Vortex_ICD_50	1.2	0.002	Vortex_ICD_85		0.7	0.0054
Vortex_ICD_50	1.4	0.0021	Vortex_ICD_85		0.8	0.0057
Vortex_ICD_50	1.6	0.0023				
Vortex_ICD_50	1.8	0.0024				
Vortex_ICD_50	2	0.0026				
Vortex_ICD_50	2.5	0.0029				
Vortex_ICD_50	3	0.0031				

Vortex_ICD_85	0.9	0.0061	InfiltratedInflow	01/01/2000	00:22:00	0.00070567	
Vortex_ICD_85	1	0.0064	InfiltratedInflow	01/01/2000	00:23:00	0.00070567	
Vortex_ICD_85	1.2	0.007	InfiltratedInflow	01/01/2000	00:24:00	0.00070567	
Vortex_ICD_85	1.4	0.0076	InfiltratedInflow	01/01/2000	00:25:00	0.00070567	
Vortex_ICD_85	1.6	0.0081	InfiltratedInflow	01/01/2000	00:26:00	0.00070567	
Vortex_ICD_85	1.8	0.0086	InfiltratedInflow	01/01/2000	00:27:00	0.00070567	
Vortex_ICD_85	2	0.0091	InfiltratedInflow	01/01/2000	00:28:00	0.00070567	
Vortex_ICD_85	2.5	0.0101	InfiltratedInflow	01/01/2000	00:29:00	0.00070567	
Vortex_ICD_85	3	0.0111	InfiltratedInflow	01/01/2000	00:30:00	0.0009500579	
;Tempest Rating Curve for Vortex ICD 90, No grate allowance							
Vortex_ICD_90	Rating	0	InfiltratedInflow	01/01/2000	00:31:00	0.0009500579	
Vortex_ICD_90	0.1	0.0022	InfiltratedInflow	01/01/2000	00:32:00	0.0009500579	
Vortex_ICD_90	0.2	0.0032	InfiltratedInflow	01/01/2000	00:33:00	0.0009500579	
Vortex_ICD_90	0.3	0.0039	InfiltratedInflow	01/01/2000	00:34:00	0.0009500579	
Vortex_ICD_90	0.4	0.0045	InfiltratedInflow	01/01/2000	00:35:00	0.0009500579	
Vortex_ICD_90	0.5	0.0051	InfiltratedInflow	01/01/2000	00:36:00	0.0009500579	
Vortex_ICD_90	0.6	0.0055	InfiltratedInflow	01/01/2000	00:37:00	0.0009500579	
Vortex_ICD_90	0.7	0.006	InfiltratedInflow	01/01/2000	00:38:00	0.0009500579	
Vortex_ICD_90	0.8	0.0064	InfiltratedInflow	01/01/2000	00:39:00	0.001494585	
Vortex_ICD_90	0.9	0.0068	InfiltratedInflow	01/01/2000	00:40:00	0.001494585	
Vortex_ICD_90	1	0.0072	InfiltratedInflow	01/01/2000	00:41:00	0.001494585	
Vortex_ICD_90	1.1	0.0077	InfiltratedInflow	01/01/2000	00:42:00	0.001494585	
Vortex_ICD_90	1.2	0.0079	InfiltratedInflow	01/01/2000	00:43:00	0.001494585	
Vortex_ICD_90	1.4	0.0085	InfiltratedInflow	01/01/2000	00:44:00	0.001494585	
Vortex_ICD_90	1.6	0.0091	InfiltratedInflow	01/01/2000	00:45:00	0.001494585	
Vortex_ICD_90	1.8	0.0096	InfiltratedInflow	01/01/2000	00:46:00	0.001494585	
Vortex_ICD_90	2	0.0102	InfiltratedInflow	01/01/2000	00:47:00	0.001494585	
Vortex_ICD_90	2.5	0.0114	InfiltratedInflow	01/01/2000	00:48:00	0.001494585	
Vortex_ICD_90	3	0.0125	InfiltratedInflow	01/01/2000	00:49:00	0.001494585	
;Tempest Rating Curve for Vortex ICD 95, No grate allowance							
Vortex_ICD_95	Rating	0	InfiltratedInflow	01/01/2000	00:50:00	0.003812069	
Vortex_ICD_95	0.1	0.0026	InfiltratedInflow	01/01/2000	00:51:00	0.003812069	
Vortex_ICD_95	0.2	0.0036	InfiltratedInflow	01/01/2000	00:52:00	0.003812069	
Vortex_ICD_95	0.3	0.0044	InfiltratedInflow	01/01/2000	00:53:00	0.003812069	
Vortex_ICD_95	0.4	0.0051	InfiltratedInflow	01/01/2000	00:54:00	0.003812069	
Vortex_ICD_95	0.5	0.0057	InfiltratedInflow	01/01/2000	00:55:00	0.003812069	
Vortex_ICD_95	0.6	0.0062	InfiltratedInflow	01/01/2000	00:56:00	0.003812069	
Vortex_ICD_95	0.7	0.0067	InfiltratedInflow	01/01/2000	00:57:00	0.003812069	
Vortex_ICD_95	0.8	0.0071	InfiltratedInflow	01/01/2000	00:58:00	0.003812069	
Vortex_ICD_95	0.9	0.0076	InfiltratedInflow	01/01/2000	00:59:00	0.00898767	
Vortex_ICD_95	1	0.008	InfiltratedInflow	01/01/2000	01:00:00	0.00898767	
Vortex_ICD_95	1.2	0.0087	InfiltratedInflow	01/01/2000	01:01:00	0.00898767	
Vortex_ICD_95	1.4	0.0094	InfiltratedInflow	01/01/2000	01:02:00	0.00898767	
Vortex_ICD_95	1.6	0.0101	InfiltratedInflow	01/01/2000	01:03:00	0.00898767	
Vortex_ICD_95	1.8	0.0107	InfiltratedInflow	01/01/2000	01:04:00	0.007100608	
Vortex_ICD_95	2	0.0113	InfiltratedInflow	01/01/2000	01:05:00	0.007100608	
Vortex_ICD_95	2.5	0.0126	InfiltratedInflow	01/01/2000	01:06:00	0.007100608	
Vortex_ICD_95	3	0.0138	InfiltratedInflow	01/01/2000	01:07:00	0.007100608	
;From Zurn Manual RD178							
ZURN_2150F-6NH	Rating	0	InfiltratedInflow	01/01/2000	01:08:00	0.005764153	
ZURN_2150F-6NH	0.0127	0.00503838308477861	InfiltratedInflow	01/01/2000	01:09:00	0.005764153	
ZURN_2150F-6NH	0.0257	0.0132420013231177	InfiltratedInflow	01/01/2000	01:10:00	0.005764153	
ZURN_2150F-6NH	0.0384	0.0234992054543888	InfiltratedInflow	01/01/2000	01:11:00	0.005764153	
ZURN_2150F-6NH	0.0508	0.0357128365761305	InfiltratedInflow	01/01/2000	01:12:00	0.004817648	
ZURN_2150F-6NH	0.0765	0.042501972611045	InfiltratedInflow	01/01/2000	01:13:00	0.004817648	
ZURN_2150F-6NH	0.1024	0.0433196215664931	InfiltratedInflow	01/01/2000	01:14:00	0.004817648	
;Rainfall (mm/hr)							
3CHI002	01/01/2000	00:00:00	2.491	InfiltratedInflow	01/01/2000	01:15:00	0.004147314
3CHI002	01/01/2000	00:10:00	2.966	InfiltratedInflow	01/01/2000	01:16:00	0.004147314
3CHI002	01/01/2000	00:20:00	3.696	InfiltratedInflow	01/01/2000	01:17:00	0.004147314
3CHI002	01/01/2000	00:30:00	4.976	InfiltratedInflow	01/01/2000	01:18:00	0.004147314
3CHI002	01/01/2000	00:40:00	6.248	InfiltratedInflow	01/01/2000	01:19:00	0.004147314
3CHI002	01/01/2000	00:50:00	19.966	InfiltratedInflow	01/01/2000	01:20:00	0.004147314
3CHI002	01/01/2000	01:00:00	76.805	InfiltratedInflow	01/01/2000	01:21:00	0.004147314
3CHI002	01/01/2000	01:10:00	22.777	InfiltratedInflow	01/01/2000	01:22:00	0.004147314
3CHI002	01/01/2000	01:20:00	10.797	InfiltratedInflow	01/01/2000	01:23:00	0.004147314
3CHI002	01/01/2000	01:30:00	8.025	InfiltratedInflow	01/01/2000	01:24:00	0.004147314
3CHI002	01/01/2000	01:40:00	6.096	InfiltratedInflow	01/01/2000	01:25:00	0.00367257
3CHI002	01/01/2000	01:50:00	4.938	InfiltratedInflow	01/01/2000	01:26:00	0.00367257
3CHI002	01/01/2000	02:00:00	3.825	InfiltratedInflow	01/01/2000	01:27:00	0.00367257
3CHI002	01/01/2000	02:10:00	3.613	InfiltratedInflow	01/01/2000	01:28:00	0.00367257
3CHI002	01/01/2000	02:20:00	3.197	InfiltratedInflow	01/01/2000	01:29:00	0.00367257
3CHI002	01/01/2000	02:30:00	2.873	InfiltratedInflow	01/01/2000	01:30:00	0.003336346
3CHI002	01/01/2000	02:40:00	2.4	InfiltratedInflow	01/01/2000	01:31:00	0.003336346
3CHI002	01/01/2000	02:50:00	2.3	InfiltratedInflow	01/01/2000	01:32:00	0.003336346
3CHI002	01/01/2000	03:00:00	0	InfiltratedInflow	01/01/2000	01:33:00	0.003336346
;Rainfall (mm/hr)							
3CHI100	01/01/2000	00:00:00	5.339	InfiltratedInflow	01/01/2000	01:34:00	0.003098226
3CHI100	01/01/2000	00:10:00	6.376	InfiltratedInflow	01/01/2000	01:35:00	0.003098226
3CHI100	01/01/2000	00:20:00	7.977	InfiltratedInflow	01/01/2000	01:36:00	0.003098226
3CHI100	01/01/2000	00:30:00	10.797	InfiltratedInflow	01/01/2000	01:37:00	0.003098226
3CHI100	01/01/2000	00:40:00	17.136	InfiltratedInflow	01/01/2000	01:38:00	0.002929584
3CHI100	01/01/2000	00:50:00	45.128	InfiltratedInflow	01/01/2000	01:39:00	0.002929584
3CHI100	01/01/2000	01:00:00	178.107	InfiltratedInflow	01/01/2000	01:40:00	0.002929584
3CHI100	01/01/2000	01:10:00	51.056	InfiltratedInflow	01/01/2000	01:41:00	0.002929584
3CHI100	01/01/2000	01:20:00	26.163	InfiltratedInflow	01/01/2000	01:42:00	0.002929584
3CHI100	01/01/2000	01:30:00	17.571	InfiltratedInflow	01/01/2000	01:43:00	0.002929584
3CHI100	01/01/2000	01:40:00	13.277	InfiltratedInflow	01/01/2000	01:44:00	0.002929584
3CHI100	01/01/2000	01:50:00	10.712	InfiltratedInflow	01/01/2000	01:45:00	0.002810149
3CHI100	01/01/2000	02:00:00	9.008	InfiltratedInflow	01/01/2000	01:46:00	0.002810149
3CHI100	01/01/2000	02:10:00	7.793	InfiltratedInflow	01/01/2000	01:47:00	0.002810149
3CHI100	01/01/2000	02:20:00	6.883	InfiltratedInflow	01/01/2000	01:48:00	0.002810149
3CHI100	01/01/2000	02:30:00	6.174	InfiltratedInflow	01/01/2000	01:49:00	0.002810149
3CHI100	01/01/2000	02:40:00	6.005	InfiltratedInflow	01/01/2000	01:50:00	0.002041464
3CHI100	01/01/2000	02:50:00	5.142	InfiltratedInflow	01/01/2000	01:51:00	0.002041464
3CHI100	01/01/2000	03:00:00	0	InfiltratedInflow	01/01/2000	01:52:00	0.002041464
;Sum of Infiltrated flow from above the garage slab calculated from Infiltration graphs for S6 multiplied by the total pervious area above the garage.							
InfiltratedInflow	01/01/2000	00:01:00	0.0004756018	InfiltratedInflow	01/01/2000	01:53:00	0.002041464
InfiltratedInflow	01/01/2000	00:02:00	0.0004756018	InfiltratedInflow	01/01/2000	01:54:00	0.002041464
InfiltratedInflow	01/01/2000	00:03:00	0.0004756018	InfiltratedInflow	01/01/2000	01:55:00	0.0019428026
InfiltratedInflow	01/01/2000	00:04:00	0.0004756018	InfiltratedInflow	01/01/2000	01:56:00	0.0019428026
InfiltratedInflow	01/01/2000	00:05:00	0.0004756018	InfiltratedInflow	01/01/2000	01:57:00	0.0019428026
InfiltratedInflow	01/01/2000	00:06:00	0.0004756018	InfiltratedInflow	01/01/2000	01:58:00	0.0019428026
InfiltratedInflow	01/01/2000	00:07:00	0.0004756018	InfiltratedInflow	01/01/2000	01:59:00	0.0019428026
InfiltratedInflow	01/01/2000	00:08:00	0.0004756018	InfiltratedInflow	01/01/2000	02:00:00	0.0019428026
InfiltratedInflow	01/01/2000	00:09:00	0.0004756018	InfiltratedInflow	01/01/2000	02:01:00	0.0019428026
InfiltratedInflow	01/01/2000	00:10:00	0.0005662926	InfiltratedInflow	01/01/2000	02:02:00	0.0019428026
InfiltratedInflow	01/01/2000	00:11:00	0.0005662926	InfiltratedInflow	01/01/2000	02:03:00	0.0019428026
InfiltratedInflow	01/01/2000	00:12:00	0.0005662926	InfiltratedInflow	01/01/2000	02:04:00	0.0019428026
InfiltratedInflow	01/01/2000	00:13:00	0.0005662926	InfiltratedInflow	01/01/2000	02:05:00	0.0019428026
InfiltratedInflow	01/01/2000	00:14:00	0.0005662926	InfiltratedInflow	01/01/2000	02:06:00	0.0019428026
InfiltratedInflow	01/01/2000	00:15:00	0.0005662926	InfiltratedInflow	01/01/2000	02:07:00	0.0019428026
InfiltratedInflow	01/01/2000	00:16:00	0.0005662926	InfiltratedInflow	01/01/2000	02:08:00	0.0019428026
InfiltratedInflow	01/01/2000	00:17:00	0.0005662926	InfiltratedInflow	01/01/2000	02:09:00	0.0019428026
InfiltratedInflow	01/01/2000	00:18:00	0.0005662926	InfiltratedInflow	01/01/2000	02:10:00	0.0019428026
InfiltratedInflow	01/01/2000	00:19:00	0.0005662926	InfiltratedInflow	01/01/2000	02:11:00	0.0019428026
InfiltratedInflow	01/01/2000	00:20:00	0.00070567	InfiltratedInflow	01/01/2000	02:12:00	0.0019428026
InfiltratedInflow	01/01/2000	00:21:00	0.00070567	InfiltratedInflow	01/01/2000	02:13:00	0.0019428026
InfiltratedInflow	01/01/2000	00:22:00	0.00070567	InfiltratedInflow	01/01/2000	02:14:00	0.0019428026
InfiltratedInflow	01/01/2000	00:23:00	0.00070567	InfiltratedInflow	01/01/2000	02:15:00	0.0019428026
InfiltratedInflow	01/01/2000	00:24:00	0.00070567	InfiltratedInflow	01/01/2000	02:16:00	0.0019428026
InfiltratedInflow	01/01/2000	00:25:00	0.00070567	InfiltratedInflow	01/01/2000	02:17:00	0.0019428026
InfiltratedInflow	01/01/2000	00:26:00	0.00070567	InfiltratedInflow	01/01/2000	02:18:00	0.0019428026
InfiltratedInflow	01/01/2000	00:27:00	0.00070567	InfiltratedInflow	01/01/2000	02:19:00	0.0019428026
InfiltratedInflow	01/01/2000	00:28:00	0.00070567	InfiltratedInflow	01/01/2000	02:20:00	0.0019428026
InfiltratedInflow	01/01/2000	00:29:00	0.00070567	InfiltratedInflow	01/01/2000	02:21:00	0.0019428026
InfiltratedInflow	01/01/2000	00:30:00	0.00070567	InfiltratedInflow	01/01/2000		

InfiltratedInflow	01/01/2000	02:51:00	0.0004582273	S5	381570.904	5032844.497	
InfiltratedInflow	01/01/2000	02:52:00	0.0004582273	S5	381568.214	5032843.324	
InfiltratedInflow	01/01/2000	02:53:00	0.0004582273	S5	381568.127	5032843.284	
InfiltratedInflow	01/01/2000	02:54:00	0.0004582273	S5	381568.041	5032843.241	
InfiltratedInflow	01/01/2000	02:55:00	0.0004582273	S5	381567.957	5032843.195	
InfiltratedInflow	01/01/2000	02:56:00	0.0004582273	S5	381567.874	5032843.147	
InfiltratedInflow	01/01/2000	02:57:00	0.0004582273	S5	381567.793	5032843.096	
InfiltratedInflow	01/01/2000	02:58:00	0.0004582273	S5	381567.714	5032843.041	
InfiltratedInflow	01/01/2000	02:59:00	0.0004582273	S5	381567.637	5032842.985	
InfiltratedInflow	01/01/2000	03:00:00	0.0004582273	S5	381567.561	5032842.925	
[REPORT]				S5	381567.488	5032842.863	
;;Reporting Options				S5	381567.417	5032842.799	
INPUT YES				S5	381567.348	5032842.732	
CONTROLS NO				S5	381567.282	5032842.663	
SUBCATCHMENTS ALL				S5	381567.218	5032842.591	
NODES ALL				S5	381567.156	5032842.519	
LINKS ALL				S5	381567.097	5032842.442	
[TAGS]				S5	381567.041	5032842.365	
Node	St_UnGrd	Underground_Storage		S5	381566.987	5032842.285	
[MAP]				S5	381566.936	5032842.204	
DIMENSIONS	381503.2836	5032790.42705	381639.0324	5032880.16395	S5	381566.888	5032842.121
UNITS	Meters				S5	381566.843	5032842.036
[COORDINATES]				S5	381566.8	5032841.95	
;;Node	X-Coord	Y-Coord		S5	381566.761	5032841.863	
MH505	381512.619	5032853.746		S5	381566.725	5032841.774	
OF2	381610.244	5032876.085		S5	381566.692	5032841.684	
OP3	381513.952	5032857.477		S5	381566.661	5032841.593	
OP4	381509.454	5032832.912		S5	381566.634	5032841.501	
CB120	381549.093	5032844.875		S5	381566.611	5032841.408	
CB121	381584.314	5032823.865		S5	381566.59	5032841.314	
CB122	381627.208	5032806.966		S5	381565.348	5032835.196	
CB123	381622.312	5032818.188		S5	381564.854	5032833.766	
CB124	381612.986	5032839.563		S5	381567.337	5032832.218	
CB125	381519.372	5032825.114		S5	381546.649	5032834.808	
Roof1	381594.1	5032833.494		S5	381537.422	5032836.68	
Roof2	381526.761	5032828.396		S5	381536.967	5032834.441	
St_UnGrd	381520.468	5032851.542		S5	381534.419	5032837.198	
[VERTICES]				S5	381524.892	5032839.223	
;;Link	X-Coord	Y-Coord		S5	381525.411	5032841.771	
BLDG_F	381587.375	5032838.9		S5	381524.284	5032841.53	
CB121	381580.382	5032829.221		S5	381525.228	5032848.183	
CB121	381526.869	5032841.1		S5	381524.866	5032848.769	
CB123	381583.496	5032831.297		S5	381520.586	5032849.638	
CB123	381530.098	5032843.407		S5	381519.868	5032849.734	
[POLYGONS]				S5	381545.732	5032856.933	
;;Subcatchment	X-Coord	Y-Coord		S5	381545.732	5032851.414	
S1	381585.63	5032868.962		S6	381574.562	5032846.362	
S1	381545.732	5032851.464		S6	381574.562	5032846.312	
S1	381549.853	5032832.912		S6	381572.167	5032851.809	
S1	381561.389	5032872.018		S6	381581.761	5032854.864	
S1	381568.127	5032873.68		S6	381590.946	5032833.812	
S1	381571.213	5032866.739		S6	381603.052	5032806.066	
S1	381575.91	5032868.703		S6	381601.782	5032799.963	
S1	381584.113	5032872.421		S6	381562.788	5032808.079	
S1	381585.63	5032868.962		S6	381563.78	5032812.963	
S10	381577.07	5032828.633		S6	381573.49	5032810.992	
S10	381573.49	5032810.992		S6	381577.07	5032822.633	
S10	381521.312	5032821.582		S6	381564.337	5032831.218	
S10	381524.892	5032839.223		S6	381564.854	5032833.766	
S10	381534.873	5032837.198		S6	381565.348	5032835.196	
S10	381534.419	5032834.588		S6	381566.611	5032841.314	
S10	381536.967	5032834.441		S6	381566.611	5032841.408	
S10	381537.422	5032836.68		S6	381566.635	5032841.501	
S10	381577.07	5032828.633		S6	381566.662	5032841.593	
S2	381600.237	5032851.815		S6	381566.692	5032841.684	
S2	381608.78	5032855.542		S6	381566.725	5032841.774	
S2	381620.836	5032828.001		S6	381566.761	5032841.862	
S2	381614.354	5032825.173		S6	381566.801	5032841.95	
S2	381603.372	5032850.345		S6	381566.843	5032841.036	
S2	381601.278	5032849.431		S6	381566.888	5032842.121	
S2	381600.237	5032851.815		S6	381566.937	5032842.203	
S3	381600.122	5032875.319		S6	381566.988	5032842.285	
S3	381608.78	5032855.542		S6	381567.04	5032842.364	
S3	381602.332	5032852.729		S6	381567.098	5032842.442	
S3	381598.259	5032862.063		S6	381567.157	5032842.517	
S3	381597.544	5032861.752		S6	381567.218	5032842.591	
S3	381593.609	5032870.772		S6	381567.282	5032842.663	
S3	381567.855	5032859.534		S6	381567.349	5032842.732	
S3	381567.277	5032860.913		S6	381567.417	5032842.798	
S4	381600.122	5032875.319		S6	381567.488	5032842.863	
S4	381524.892	5032839.223		S6	381567.562	5032842.925	
S4	381521.312	5032821.582		S6	381567.637	5032842.984	
S4	381563.78	5032812.963		S6	381567.714	5032843.041	
S4	381562.788	5032808.079		S6	381567.793	5032843.095	
S4	381521.032	5032816.77		S6	381567.874	5032843.147	
S4	381516.421	5032820.775		S6	381567.957	5032843.195	
S4	381519.182	5032849.734		S6	381568.041	5032843.241	
S4	381520.586	5032849.638		S6	381568.127	5032843.284	
S4	381524.866	5032848.769		S6	381568.214	5032843.324	
S4	381525.228	5032848.183		S6	381570.904	5032844.497	
S4	381524.284	5032843.53		S6	381570.746	5032844.646	
S4	381525.411	5032841.771		S6	381574.562	5032846.312	
S4	381524.892	5032839.223		S7	381627.999	5032794.506	
S4	381545.732	5032851.464		S7	381601.782	5032799.963	
S5	381567.277	5032860.913		S7	381603.052	5032806.066	
S5	381567.855	5032859.534		S7	381619.55	5032813.264	
S5	381567.897	5032859.438		S7	381614.354	5032825.173	
S5	381567.158	5032859.115		S7	381620.836	5032828.001	
S5	381566.874	5032858.986		S7	381632.862	5032800.531	
S5	381566.594	5032858.846		S7	381627.999	5032794.506	
S5	381566.319	5032858.697		S7	381597.524	5032861.751	
S5	381566.05	5032858.539		S8	381581.761	5032854.863	
S5	381565.786	5032858.372		S8	381572.167	5032851.809	
S5	381565.528	5032858.196		S8	381568.16	5032850.064	
S5	381565.276	5032858.012		S8	381561.615	5032851.396	
S5	381565.03	5032857.819		S8	381561.441	5032851.483	
S5	381564.792	5032857.617		S8	381561.507	5032851.62	
S5	381564.56	5032857.408		S8	381561.569	5032851.759	
S5	381564.335	5032857.191		S8	381561.627	5032851.9	
S5	381564.118	5032856.966		S8	381561.68	5032852.043	
S5	381563.908	5032856.735		S8	381561.729	5032852.188	
S5	381563.707	5032856.496		S8	381561.773	5032852.334	
S5	381563.514	5032856.25		S8	381561.812	5032852.481	
S5	381563.329	5032855.999		S8	381561.846	5032852.63	
S5	381563.153	5032855.741		S8	381561.917	5032852.929	
S5	381562.986	5032855.477		S8	381561.997	5032853.226	
S5	381562.827	5032855.207		S8	381562.087	5032853.52	
S5	381562.681	5032854.937		S8	381562.186	5032853.811	
S5	381562.543	5032854.662		S8	381562.296	5032854.099	
S5	381562.415	5032854.382		S8	381562.415	5032854.382	
S5	381562.296	5032854.099		S8	381562.543	5032854.662	
S5	381562.186	5032853.811		S8	381562.681	5032854.937	
S5	381562.087	5032853.52		S8	381562.827	5032855.207	
S5	381561.997	5032853.226		S8	381562.986	5032855.477	
S5	381561.917	5032852.929		S8	381563.153	5032855.741	
S5	381561.846	5032852.63		S8	381563.329	5032855.999	
S5	381561.812	5032852.481		S8	381563.514	5032856.25	
S5	381561.773	5032852.334		S8	381563.707	5032856.496	
S5	381561.729	5032852.188		S8	381563.908	5032856.735	
S5	381561.68	5032852.043		S8	381564.118	5032856.966	
S5	381561.627	5032851.9		S8	381564.335	5032857.191	
S5	381561.569	5032851.759		S8	381564.56	5032857.408	
S5	381561.507	5032851.62		S8	381564.792	5032857.617	
S5	381561.441	5032851.483		S8	381565.03	5032857.819	
S5	381561.615	5032851.396		S8	381565.276	5032858.012	
S5	381568.16	5032850.064		S8	381565.528	5032858.196	
S5	381572.167	5032846.312		S8	381566.05	5032858.539	
S5	381574.562	5032846.312		S8	381566.319	5032858.697	
S5	381570.746	5032844.646		S8	381566.594	5032858.846	
				S8	381566.874	5032858.986	
				S8	381567.158	5032859.115	
				S8	381567.897	5032859.438	
				S8	381567.855	5032859.534	
				S8	381593.609	5032870.772	
				S9	381597.544	5032861.751	
				S9	381581.761	5032854.863	
				S9	381598.259	5032862.063	

S9 381602.332 5032852.729
 S9 381600.237 5032851.815
 S9 381601.278 5032849.431
 S9 381603.372 5032850.345
 S9 381619.55 5032813.264
 S9 381603.052 5032806.066
 S9 381581.761 5032854.865

```
;;Storage Node X-Coord Y-Coord
;;-----
[SYMBOLS]
;;Gage X-Coord Y-Coord
;;-----
```

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.2 (Build 5.2.4)

```
*****
Element Count
*****
Number of rain gages ..... 2
Number of subcatchments ... 10
Number of nodes ..... 13
Number of links ..... 9
Number of pollutants ..... 0
Number of land uses ..... 0
```

```
*****
Raingage Summary
*****
```

Name	Data Source	Data Type	Recording Interval
3CHI002	3CHI002	INTENSITY	10 min.
3CHI100	3CHI100	INTENSITY	10 min.

```
*****
Subcatchment Summary
*****
```

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
S1	0.03	38.60	14.29	1.5000	3CHI002	CB120
S10	0.10	18.00	100.00	1.0000	3CHI002	Roof2
S2	0.02	38.94	11.12	2.1000	3CHI002	CB124
S3	0.02	26.02	0.00	2.0000	3CHI002	OF2
S4	0.04	163.64	3.09	1.5000	3CHI002	CB125
S5	0.09	79.85	77.46	2.0000	3CHI002	CB120
S6	0.11	105.72	17.82	2.1000	3CHI002	CB121
S7	0.05	44.22	13.68	3.3000	3CHI002	CB122
S8	0.03	11.98	95.75	5.2000	3CHI002	St_UnGrd
S9	0.10	18.00	100.00	1.0000	3CHI002	Roof1

```
*****
Node Summary
*****
```

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
MH505	OUTFALL	78.00	0.00	0.0	
OF2	OUTFALL	0.00	0.00	0.0	
OF3	OUTFALL	78.88	0.00	0.0	
OF4	OUTFALL	78.88	0.00	0.0	
CB120	STORAGE	82.10	0.30	0.0	
CB121	STORAGE	82.28	0.30	0.0	
CB122	STORAGE	79.35	1.70	0.0	
CB123	STORAGE	79.17	2.18	0.0	
CB124	STORAGE	79.47	1.78	0.0	
CB125	STORAGE	80.20	2.00	0.0	
Roof1	STORAGE	88.85	0.15	0.0	
Roof2	STORAGE	88.85	0.15	0.0	
St_UnGrd	STORAGE	78.00	1.00	0.0	Yes

```
*****
Link Summary
*****
```

Name	From Node	To Node	Type	Length	%Slope
C1	CB124	CB123	CONDUIT	23.3	0.9862
C2	CB122	CB123	CONDUIT	12.2	0.9965
BLDG_E	Roof2	OF4	OUTLET		
BLDG_F	Roof1	OF3	OUTLET		
CB120	CB120	St_UnGrd	OUTLET		
CB121	CB121	St_UnGrd	OUTLET		
CB123	CB123	St_UnGrd	OUTLET		
CB125	CB125	St_UnGrd	OUTLET		
OLL	St_UnGrd	MH505	OUTLET		

```
*****
Cross Section Summary
*****
```

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	CIRCULAR	0.25	0.05	0.06	0.25	1	0.06
C2	CIRCULAR	0.25	0.05	0.06	0.25	1	0.06

```
*****
Analysis Options
*****
Flow Units ..... CMS
Process Models:
Rainfall/Runoff ..... YES
RDII ..... NO
Snowmelt ..... NO
Groundwater ..... NO
Flow Routing ..... YES
Ponding Allowed ..... NO
Water Quality ..... NO
Infiltration Method ..... HORTON
Flow Routing Method ..... DYNWAVE
Surcharge Method ..... EXTRAN
Starting Date ..... 01/01/2000 00:00:00
Ending Date ..... 01/01/2000 03:00:00
Antecedent Dry Days ..... 0.0
Report Time Step ..... 00:01:00
Wet Time Step ..... 00:05:00
Dry Time Step ..... 00:05:00
Routing Time Step ..... 5.00 sec
Variable Time Step ..... YES
Maximum Trials ..... 8
Number of Threads ..... 1
Head Tolerance ..... 0.001524 m
```

```
*****
Runoff Quantity Continuity
*****
```

	Volume	Depth
	hectare-m	mm
Total Precipitation	0.019	31.879
Evaporation Loss	0.000	0.000
Infiltration Loss	0.009	14.658
Surface Runoff	0.010	16.356
Final Storage	0.001	1.128
Continuity Error (%)	-0.823	

```
*****
Flow Routing Continuity
*****
```

	Volume	Volume
	hectare-m	10^6 ltr
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.010	0.096
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.002	0.022
External Outflow	0.009	0.093
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.003	0.025
Continuity Error (%)	0.000	

 Time-Step Critical Elements

 None

 Highest Flow Instability Indexes

 All links are stable.

 Most Frequent Nonconverging Nodes

 Convergence obtained at all time steps.

 Routing Time Step Summary

 Minimum Time Step : 4.50 sec
 Average Time Step : 5.00 sec
 Maximum Time Step : 5.00 sec
 % of Time in Steady State : 0.00
 Average Iterations per Step : 2.00
 % of Steps Not Converging : 0.00
 Time Step Frequencies :
 5.000 - 3.155 sec : 100.00 %
 3.155 - 1.991 sec : 0.00 %
 1.991 - 1.256 sec : 0.00 %
 1.256 - 0.792 sec : 0.00 %
 0.792 - 0.500 sec : 0.00 %

 Subcatchment Runoff Summary

Total Runoff Subcatchment	Total Runoff	Peak Runoff	Total Runoff Precip Coeff	Total Runoff	Total Evap	Total Infil	Imperv Runoff	Perv Runoff
mm	mm	mm		mm	mm	mm	mm	mm
S1	0.00	0.00	31.88	0.00	0.00	29.87	4.34	2.03
S10	0.00	0.00	31.88	0.00	0.00	0.00	30.03	0.00
S2	0.00	0.00	0.061	0.00	0.00	30.13	3.38	1.95
S3	0.00	0.00	31.88	0.00	0.00	31.71	0.00	0.29
S4	0.00	0.00	0.009	0.00	0.00	31.17	0.94	1.10
S5	0.00	0.00	31.88	0.00	0.00	7.10	23.48	0.16
S6	0.00	0.00	0.742	0.00	0.00	26.07	5.41	0.22
S7	0.00	0.00	31.88	0.00	0.00	29.90	4.15	2.03
S8	0.00	0.00	0.064	0.00	0.00	2.02	29.00	28.00
S9	0.00	0.00	31.88	0.00	0.00	0.00	30.03	0.00
S11	0.00	0.00	0.942	0.00	0.00	0.00	0.00	0.00
S12	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S13	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S14	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S15	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S16	0.00	0.00	0.064	0.00	0.00	0.00	0.00	0.00
S17	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S18	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S19	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S20	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S21	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S22	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S23	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S24	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S25	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S26	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S27	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S28	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S29	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S30	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S31	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S32	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S33	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S34	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S35	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S36	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S37	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S38	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S39	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S40	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S41	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S42	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S43	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S44	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S45	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S46	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S47	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S48	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S49	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S50	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S51	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S52	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S53	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S54	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S55	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S56	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S57	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S58	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S59	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S60	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S61	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S62	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S63	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S64	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S65	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S66	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S67	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S68	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S69	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S70	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S71	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S72	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S73	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S74	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S75	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S76	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S77	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S78	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S79	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S80	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S81	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S82	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S83	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S84	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S85	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S86	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S87	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S88	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S89	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S90	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S91	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S92	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S93	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S94	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S95	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S96	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S97	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00
S98	0.00	0.00	31.88	0.00	0.00	0.00	0.00	0.00
S99	0.00	0.00	0.061	0.00	0.00	0.00	0.00	0.00
S100	0.00	0.00	0.009	0.00	0.00	0.00	0.00	0.00

 Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
MH505	OUTFALL	0.00	0.00	78.00	0 00:00	0.00
OF2	OUTFALL	0.00	0.00	0.00	0 00:00	0.00
OF3	OUTFALL	0.00	0.00	78.88	0 00:00	0.00
OF4	OUTFALL	0.00	0.00	78.88	0 00:00	0.00
CB120	STORAGE	0.00	0.03	82.13	0 01:10	0.03
CB121	STORAGE	0.00	0.01	82.29	0 01:10	0.01
CB122	STORAGE	0.00	0.03	79.38	0 01:10	0.03
CB123	STORAGE	0.01	0.13	79.30	0 01:15	0.13
CB124	STORAGE	0.00	0.02	79.49	0 01:10	0.02
CB125	STORAGE	0.00	0.07	80.27	0 01:11	0.07
Roof1	STORAGE	0.01	0.03	88.88	0 01:44	0.03
Roof2	STORAGE	0.01	0.03	88.88	0 01:44	0.03
St_UnGrd	STORAGE	0.00	0.01	78.01	0 01:10	0.01

 Node Inflow Summary

Flow Balance Error	Node Percent	Type	Maximum Inflow CMS	Maximum Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow 10^6 ltr	Total Inflow Volume 10^6 ltr
MH505	0.000	OUTFALL	0.000	0.035	0 01:10	0	0.0606
OF2	0.000	OUTFALL	0.000	0.000	0 01:10	5.85e-05	5.85e-05
OF3	0.000	OUTFALL	0.000	0.002	0 00:54	0	0.016
OF4	0.000	OUTFALL	0.000	0.002	0 00:54	0	0.016
CB120	0.001	STORAGE	0.016	0.016	0 01:10	0.0214	0.0214
CB121	0.001	STORAGE	0.005	0.005	0 01:10	0.00636	0.00636
CB122	0.603	STORAGE					

Post-Development 3-hour Chicago 1:100 year Event

```

[TITLE]
;;Project Title/Notes

[OPTIONS]
;;Option Value
FLOW_UNITS CMS
INFILTRATION HORTON
FLOW_ROUTING DYNWAVE
LINK_OFFSETS ELEVATION
MIN_SLOPE 0
ALLOW_PONDING NO
SKIP_STEADY_STATE NO

START_DATE 01/01/2000
START_TIME 00:00:00
REPORT_START_DATE 01/01/2000
REPORT_START_TIME 00:00:00
END_DATE 01/01/2000
END_TIME 03:00:00
SWEEP_START 01/01
SWEEP_END 12/31
DRY_DAYS 0
REPORT_STEP 00:00:05
WET_STEP 00:02:00
DRY_STEP 00:02:00
ROUTING_STEP 5
RULE_STEP 00:00:00

INERTIAL_DAMPING PARTIAL
NORMAL_FLOW_LIMITED BOTH
FORCE_MAIN_EQUATION H-W
VARIABLE_STEP 0.75
LENGTHENING_STEP 0
MIN_SURFAREA 0
MAX_TRIALS 8
HEAD_TOLERANCE 0.0015
SYS_FLOW_TOL 5
LAT_FLOW_TOL 5
MINIMUM_STEP 0.5
THREADS 12

[EVAPORATION]
;;Data Source Parameters
CONSTANT 0.0
DRY_ONLY NO

[RAINGAGES]
;;Name Format Interval SCF Source
3CHI1100 INTENSITY 0:10 1.0 TIMESERIES 3CHI1100

[SUBCATCHMENTS]
;;Name Rain Gage Outlet Area %Imperv Width %Slope CurbLen
SnowPack
S1 3CHI1100 CB120 0.0331 14.286 38.601 1.5 0
S10 3CHI1100 Roof2 0.0953 100 18 1 0
S2 3CHI1100 CB124 0.0218 11.125 38.94 2.1 0
S3 3CHI1100 OF2 0.0203 0 26.019 2 0
S4 3CHI1100 CB125 0.0388 3.093 163.644 1.5 0
S5 3CHI1100 CB120 0.0881 77.464 79.845 2 0
S6 3CHI1100 CB121 0.1134 17.819 105.724 2.1 0
S7 3CHI1100 CB122 0.0492 13.679 44.221 3.3 0
S8 3CHI1100 St_UnGrd 0.0327 95.747 11.978 5.2 0
S9 3CHI1100 Roof1 0.0952 100 18 1 0

[SUBAREAS]
;;Subcatchment N-Imperv N-Perv S-Imperv S-Perv PctZero RouteTo PctRouted
S1 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S10 0.013 0.25 1.57 4.67 0 OUTLET
S2 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S3 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S4 0.013 0.25 1.57 4.67 0 OUTLET
S5 0.013 0.25 1.57 4.67 0 OUTLET
S6 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S7 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S8 0.013 0.25 1.57 4.67 0 OUTLET
S9 0.013 0.25 1.57 4.67 0 OUTLET

[INFILTRATION]
;;Subcatchment Param1 Param2 Param3 Param4 Param5
S1 76.2 13.2 4.14 7 0
S10 76.2 13.2 4.14 7 0
S2 76.2 13.2 4.14 7 0
S3 76.2 13.2 4.14 7 0
S4 76.2 13.2 4.14 7 0
S5 76.2 13.2 4.14 7 0
S6 76.2 13.2 4.14 7 0
S7 76.2 13.2 4.14 7 0
S8 76.2 13.2 4.14 7 0
S9 76.2 13.2 4.14 7 0

[OUTFALLS]
;;Name Elevation Type Stage Data Gated Route To
MH505 78 NORMAL NO
OF2 0 FREE NO
OF3 78.88 NORMAL NO
OF4 78.88 NORMAL NO

[STORAGE]
;;Name Elev. Psi MaxDepth Ksat InitDepth Shape Curve Name/Params
SurDepth Fevap
CB120 82.1 0.3 0 TABULAR CB120 0
CB121 82.28 0.3 0 TABULAR CB121 0
CB122 79.35 1.7 0 TABULAR CB122 0
CB123 79.168 2.182 0 TABULAR CB123 0
CB124 79.47 1.78 0 TABULAR CB124 0
CB125 80.2 2 0 TABULAR CB125 0
Roof1 88.85 0.15 0 FUNCTIONAL 0 0 635 0
Roof2 88.85 0.15 0 FUNCTIONAL 0 0 635 0
St_UnGrd 78 1 0 FUNCTIONAL 0 0 49 0

[CONDUITS]
;;Name From Node To Node Length Roughness InOffset OutOffset
InitFlow MaxFlow
C1 0 CB124 CB123 23.322 0.013 79.47 79.24
C2 0 0.04 CB122 CB123 12.244 0.013 79.35 79.228

[OUTLETS]

```


MHF_IPEX_TYPE_C	0.7	0.028	Vortex_ICD_45	1.4	0.0021
MHF_IPEX_TYPE_C	0.8	0.0299	Vortex_ICD_45	1.6	0.0023
MHF_IPEX_TYPE_C	0.9	0.0317	Vortex_ICD_45	1.8	0.0024
MHF_IPEX_TYPE_C	1	0.0335	Vortex_ICD_45	2	0.0025
MHF_IPEX_TYPE_C	1.2	0.0366	Vortex_ICD_45	2.5	0.0029
MHF_IPEX_TYPE_C	1.4	0.0396	Vortex_ICD_45	3	0.0031
MHF_IPEX_TYPE_C	1.6	0.0423			
MHF_IPEX_TYPE_C	1.8	0.0449			
MHF_IPEX_TYPE_C	2	0.0473			
MHF_IPEX_TYPE_C	2.5	0.0529			
MHF_IPEX_TYPE_C	3	0.0579			
;Tempest Rating Curve for MHF IPEX TYPE D, No grate allowance					
MHF_IPEX_TYPE_D	Rating	0	Vortex_ICD_50	Rating	0
MHF_IPEX_TYPE_D	0.1	0.0154	Vortex_ICD_50	0.1	0.0007
MHF_IPEX_TYPE_D	0.2	0.0217	Vortex_ICD_50	0.2	0.001
MHF_IPEX_TYPE_D	0.3	0.0266	Vortex_ICD_50	0.3	0.0012
MHF_IPEX_TYPE_D	0.4	0.0307	Vortex_ICD_50	0.4	0.0014
MHF_IPEX_TYPE_D	0.5	0.0343	Vortex_ICD_50	0.5	0.0016
MHF_IPEX_TYPE_D	0.6	0.0376	Vortex_ICD_50	0.6	0.0018
MHF_IPEX_TYPE_D	0.7	0.0406	Vortex_ICD_50	0.7	0.0019
MHF_IPEX_TYPE_D	0.8	0.0434	Vortex_ICD_50	0.8	0.002
MHF_IPEX_TYPE_D	0.9	0.0461	Vortex_ICD_50	0.9	0.0021
MHF_IPEX_TYPE_D	1	0.0485	Vortex_ICD_50	1	0.0023
MHF_IPEX_TYPE_D	1.2	0.0532	Vortex_ICD_50	1.2	0.0025
MHF_IPEX_TYPE_D	1.4	0.0574	Vortex_ICD_50	1.4	0.0027
MHF_IPEX_TYPE_D	1.6	0.0614	Vortex_ICD_50	1.6	0.0029
MHF_IPEX_TYPE_D	1.8	0.0651	Vortex_ICD_50	1.8	0.003
MHF_IPEX_TYPE_D	2	0.0687	Vortex_ICD_50	2	0.0032
MHF_IPEX_TYPE_D	2.5	0.0768	Vortex_ICD_50	2.5	0.0036
MHF_IPEX_TYPE_D	3	0.0841	Vortex_ICD_50	3	0.0039
;Tempest Rating Curve for Vortex ICD 50, No grate allowance					
MHF_IPEX_TYPE_D	Rating	0	Vortex_ICD_55	Rating	0
MHF_IPEX_TYPE_D	0.1	0.0205	Vortex_ICD_55	0.1	0.0009
MHF_IPEX_TYPE_D	0.2	0.0289	Vortex_ICD_55	0.2	0.0012
MHF_IPEX_TYPE_D	0.3	0.0355	Vortex_ICD_55	0.3	0.0015
MHF_IPEX_TYPE_D	0.4	0.0409	Vortex_ICD_55	0.4	0.0017
MHF_IPEX_TYPE_D	0.5	0.0458	Vortex_ICD_55	0.5	0.0019
MHF_IPEX_TYPE_D	0.6	0.0501	Vortex_ICD_55	0.6	0.0021
MHF_IPEX_TYPE_D	0.7	0.0542	Vortex_ICD_55	0.7	0.0023
MHF_IPEX_TYPE_D	0.8	0.0579	Vortex_ICD_55	0.8	0.0024
MHF_IPEX_TYPE_D	0.9	0.0614	Vortex_ICD_55	0.9	0.0026
MHF_IPEX_TYPE_D	1	0.0647	Vortex_ICD_55	1	0.0027
MHF_IPEX_TYPE_D	1.2	0.0709	Vortex_ICD_55	1.2	0.003
MHF_IPEX_TYPE_D	1.4	0.0766	Vortex_ICD_55	1.4	0.0032
MHF_IPEX_TYPE_D	1.6	0.0819	Vortex_ICD_55	1.6	0.0034
MHF_IPEX_TYPE_D	1.8	0.0868	Vortex_ICD_55	1.8	0.0036
MHF_IPEX_TYPE_D	2	0.0915	Vortex_ICD_55	2	0.0038
MHF_IPEX_TYPE_D	2.5	0.1023	Vortex_ICD_55	2.5	0.0044
MHF_IPEX_TYPE_D	3	0.1121	Vortex_ICD_55	3	0.0047
;Tempest Rating Curve for Vortex ICD 55, No grate allowance					
MHF_IPEX_TYPE_E	Rating	0	Vortex_ICD_60	Rating	0
MHF_IPEX_TYPE_E	0.1	0.0205	Vortex_ICD_60	0.1	0.0011
MHF_IPEX_TYPE_E	0.2	0.0289	Vortex_ICD_60	0.2	0.0015
MHF_IPEX_TYPE_E	0.3	0.0355	Vortex_ICD_60	0.3	0.0018
MHF_IPEX_TYPE_E	0.4	0.0409	Vortex_ICD_60	0.4	0.0021
MHF_IPEX_TYPE_E	0.5	0.0458	Vortex_ICD_60	0.5	0.0023
MHF_IPEX_TYPE_E	0.6	0.0501	Vortex_ICD_60	0.6	0.0025
MHF_IPEX_TYPE_E	0.7	0.0542	Vortex_ICD_60	0.7	0.0027
MHF_IPEX_TYPE_E	0.8	0.0579	Vortex_ICD_60	0.8	0.0029
MHF_IPEX_TYPE_E	0.9	0.0614	Vortex_ICD_60	0.9	0.0031
MHF_IPEX_TYPE_E	1	0.0647	Vortex_ICD_60	1	0.0032
MHF_IPEX_TYPE_E	1.2	0.0709	Vortex_ICD_60	1.2	0.0036
MHF_IPEX_TYPE_E	1.4	0.0766	Vortex_ICD_60	1.4	0.0038
MHF_IPEX_TYPE_E	1.6	0.0819	Vortex_ICD_60	1.6	0.0041
MHF_IPEX_TYPE_E	1.8	0.0868	Vortex_ICD_60	1.8	0.0043
MHF_IPEX_TYPE_E	2	0.0915	Vortex_ICD_60	2	0.0046
MHF_IPEX_TYPE_E	2.5	0.1023	Vortex_ICD_60	2.5	0.0051
MHF_IPEX_TYPE_E	3	0.1121	Vortex_ICD_60	3	0.0056
;Tempest Rating Curve for Vortex ICD 60, No grate allowance					
O_Roof1	Rating	0	Vortex_ICD_65	Rating	0
O_Roof1	0.001	0.002	Vortex_ICD_65	0.1	0.0012
O_Roof1	0.15	0.002	Vortex_ICD_65	0.2	0.0016
O_Roof1			Vortex_ICD_65	0.3	0.002
O_Roof1			Vortex_ICD_65	0.4	0.0023
O_Roof1			Vortex_ICD_65	0.5	0.0025
O_Roof1			Vortex_ICD_65	0.6	0.0027
O_Roof1			Vortex_ICD_65	0.7	0.0029
O_Roof1			Vortex_ICD_65	0.8	0.0031
O_Roof1			Vortex_ICD_65	0.9	0.0032
O_Roof1			Vortex_ICD_65	1	0.0033
O_Roof1			Vortex_ICD_65	1.2	0.0036
O_Roof1			Vortex_ICD_65	1.4	0.0038
O_Roof1			Vortex_ICD_65	1.6	0.0041
O_Roof1			Vortex_ICD_65	1.8	0.0043
O_Roof1			Vortex_ICD_65	2	0.0046
O_Roof1			Vortex_ICD_65	2.5	0.0051
O_Roof1			Vortex_ICD_65	3	0.0056
;Tempest Rating Curve for Vortex ICD 65, No grate allowance					
O_Roof2	Rating	0	Vortex_ICD_70	Rating	0
O_Roof2	0.001	0.002	Vortex_ICD_70	0.1	0.0013
O_Roof2	0.15	0.002	Vortex_ICD_70	0.2	0.0019
O_Roof2			Vortex_ICD_70	0.3	0.0023
O_Roof2			Vortex_ICD_70	0.4	0.0027
O_Roof2			Vortex_ICD_70	0.5	0.003
O_Roof2			Vortex_ICD_70	0.6	0.0033
O_Roof2			Vortex_ICD_70	0.7	0.0036
O_Roof2			Vortex_ICD_70	0.8	0.0038
O_Roof2			Vortex_ICD_70	0.9	0.0041
O_Roof2			Vortex_ICD_70	1	0.0043
O_Roof2			Vortex_ICD_70	1.2	0.0046
O_Roof2			Vortex_ICD_70	1.4	0.0048
O_Roof2			Vortex_ICD_70	1.6	0.0051
O_Roof2			Vortex_ICD_70	1.8	0.0054
O_Roof2			Vortex_ICD_70	2	0.0057
O_Roof2			Vortex_ICD_70	2.5	0.0063
O_Roof2			Vortex_ICD_70	3	0.0068
;Tempest Rating Curve for Vortex ICD 70, No grate allowance					
O_St_L1	Rating	0	Vortex_ICD_75	Rating	0
O_St_L1	0.001	0.003	Vortex_ICD_75	0.1	0.0016
O_St_L1	0.35	0.003	Vortex_ICD_75	0.2	0.0022
O_St_L1			Vortex_ICD_75	0.3	0.0027
O_St_L1			Vortex_ICD_75	0.4	0.0032
O_St_L1			Vortex_ICD_75	0.5	0.0035
O_St_L1			Vortex_ICD_75	0.6	0.0039
O_St_L1			Vortex_ICD_75	0.7	0.0042
O_St_L1			Vortex_ICD_75	0.8	0.0045
O_St_L1			Vortex_ICD_75	0.9	0.0048
O_St_L1			Vortex_ICD_75	1	0.005
O_St_L1			Vortex_ICD_75	1.2	0.0055
O_St_L1			Vortex_ICD_75	1.4	0.0059
O_St_L1			Vortex_ICD_75	1.6	0.0063
O_St_L1			Vortex_ICD_75	1.8	0.0067
O_St_L1			Vortex_ICD_75	2	0.0071
O_St_L1			Vortex_ICD_75	2.5	0.0079
O_St_L1			Vortex_ICD_75	3	0.0087
;Tempest Rating Curve for Vortex ICD 75, No grate allowance					
O_St_L2	Rating	0	Vortex_ICD_80	Rating	0
O_St_L2	0.001	0.002	Vortex_ICD_80	0.1	0.0018
O_St_L2	0.35	0.002	Vortex_ICD_80	0.2	0.0022
O_St_L2			Vortex_ICD_80	0.3	0.0031
O_St_L2			Vortex_ICD_80	0.4	0.0036
O_St_L2			Vortex_ICD_80	0.5	0.004
O_St_L2			Vortex_ICD_80	0.6	0.0044
O_St_L2			Vortex_ICD_80	0.7	0.0048
O_St_L2			Vortex_ICD_80	0.8	0.0051
O_St_L2			Vortex_ICD_80	0.9	0.0054
O_St_L2			Vortex_ICD_80	1	0.0057
O_St_L2			Vortex_ICD_80	1.2	0.0063
O_St_L2			Vortex_ICD_80	1.4	0.0068
O_St_L2			Vortex_ICD_80	1.6	0.0072
O_St_L2			Vortex_ICD_80	1.8	0.0077
O_St_L2			Vortex_ICD_80	2	0.0081
O_St_L2			Vortex_ICD_80	2.5	0.009
O_St_L2			Vortex_ICD_80	3	0.0099
;Tempest Rating Curve for Vortex ICD 80, No grate allowance					
O_St_L3	Rating	0	Vortex_ICD_85	Rating	0
O_St_L3	0.001	0.0137	Vortex_ICD_85	0.1	0.0017
O_St_L3	0.35	0.0137	Vortex_ICD_85	0.2	0.0023
O_St_L3			Vortex_ICD_85	0.3	0.003
O_St_L3			Vortex_ICD_85	0.4	0.0037
O_St_L3			Vortex_ICD_85	0.5	0.0044
O_St_L3			Vortex_ICD_85	0.6	0.0051
O_St_L3			Vortex_ICD_85	0.7	0.0057
O_St_L3			Vortex_ICD_85	0.8	0.0063
O_St_L3			Vortex_ICD_85	0.9	0.0069
O_St_L3			Vortex_ICD_85	1	0.0074
O_St_L3			Vortex_ICD_85	1.2	0.0081
O_St_L3			Vortex_ICD_85	1.4	0.0087
O_St_L3			Vortex_ICD_85	1.6	0.0093
O_St_L3			Vortex_ICD_85	1.8	0.0099
O_St_L3			Vortex_ICD_85	2	0.0105
O_St_L3			Vortex_ICD_85	2.5	0.0113
O_St_L3			Vortex_ICD_85	3	0.0121
;Tempest Rating Curve for Vortex ICD 85, No grate allowance					
O_St_UnGrd	Rating	0	Vortex_ICD_85	Rating	0
O_St_UnGrd	0.01	0.041	Vortex_ICD_85	0.1	0.0017
O_St_UnGrd	1	0.041	Vortex_ICD_85	0.2	0.0023
O_St_UnGrd			Vortex_ICD_85	0.3	0.003
O_St_UnGrd			Vortex_ICD_85	0.4	0.0037
O_St_UnGrd			Vortex_ICD_85	0.5	0.0044
O_St_UnGrd			Vortex_ICD_85	0.6	0.0051
O_St_UnGrd			Vortex_ICD_85	0.7	0.0057
O_St_UnGrd			Vortex_ICD_85	0.8	0.0063
O_St_UnGrd			Vortex_ICD_85	0.9	0.0069
O_St_UnGrd			Vortex_ICD_85	1	0.0074
O_St_UnGrd			Vortex_ICD_85	1.2	0.0081
O_St_UnGrd			Vortex_ICD_85	1.4	0.0087
O_St_UnGrd			Vortex_ICD_85	1.6	0.0093
O_St_UnGrd			Vortex_ICD_85	1.8	0.0099
O_St_UnGrd			Vortex_ICD_85	2	0.0105
O_St_UnGrd			Vortex_ICD_85	2.5	0.0113
O_St_UnGrd			Vortex_ICD_85	3	0.0121
;Tempest Rating Curve for Vortex ICD 100, No grate allowance					
Vortex_ICD_100	Rating	0	Vortex_ICD_100	Rating	0
Vortex_ICD_100	0.1	0.0028	Vortex_ICD_100	0.1	0.0011
Vortex_ICD_100	0.2	0.004	Vortex_ICD_100	0.2	0.0015
Vortex_ICD_100	0.3	0.0049	Vortex_ICD_100	0.3	0.0018
Vortex_ICD_100	0.4	0.0056	Vortex_ICD_100	0.4	0.0021
Vortex_ICD_100	0.5	0.0063	Vortex_ICD_100	0.5	0.0023
Vortex_ICD_100	0.6	0.0069	Vortex_ICD_100	0.6	0.0025
Vortex_ICD_100	0.7	0.0075	Vortex_ICD_100	0.7	0.0027
Vortex_ICD_100	0.8	0.008	Vortex_ICD_100	0.8	0.0029
Vortex_ICD_100	0.9	0.0085	Vortex_ICD_100	0.9	0.0031
Vortex_ICD_100	1	0.0089	Vortex_ICD_100	1	0.0032
Vortex_ICD_100	1.2	0.0098	Vortex_ICD_100	1.2	0.0036
Vortex_ICD_100	1.4	0.0106	Vortex_ICD_100	1.4	0.0038
Vortex_ICD_100	1.6	0.0113	Vortex_ICD_100	1.6	0.0041
Vortex_ICD_100	1.8	0.012	Vortex_ICD_100	1.8	0.0043
Vortex_ICD_100	2	0.0126	Vortex_ICD_100	2	0.0046
Vortex_ICD_100	2.5	0.0141	Vortex_ICD_100	2.5	0.0051
Vortex_ICD_100	3	0.0155	Vortex_ICD_100	3	0.0056
;Tempest Rating Curve for Vortex ICD 105, No grate allowance					
Vortex_ICD_105	Rating	0	Vortex_ICD_105	Rating	0
Vortex_ICD_105	0.1	0.0031	Vortex_ICD_105	0.1	0.0012
Vortex_ICD_105	0.2	0.0044	Vortex_ICD_105	0.2	0.0016
Vortex_ICD_105	0.3	0.0054	Vortex_ICD_105	0.3	0.002
Vortex_ICD_105	0.4	0.0062	Vortex_ICD_105	0.4	0.0023
Vortex_ICD_105	0.5	0.0069	Vortex_ICD_105	0.5	0.0025
Vortex_ICD_105	0.6	0.0076	Vortex_ICD_105	0.6	0.0027
Vortex_ICD_105	0.7	0.0082	Vortex_ICD_105	0.7	0.0029
Vortex_ICD_105	0.8	0.0088	Vortex_ICD_105	0.8	0.0031
Vortex_ICD_105	0.9	0.0093	Vortex_ICD_105	0.9	0.0032
Vortex_ICD_105	1	0.0098	Vortex_ICD_105	1	0.0033
Vortex_ICD_105	1.2	0.0107	Vortex_ICD_105	1.2	0.0036
Vortex_ICD_105	1.4	0.0116	Vortex_ICD_105	1.4	0.0038
Vortex_ICD_105	1.6	0.0124	Vortex_ICD_105	1.6	0.0041
Vortex_ICD_105	1.8	0.0131	Vortex_ICD_105	1.8	0.0043
Vortex_ICD_105	2	0.0139	Vortex_ICD_105	2	0.0046
Vortex_ICD_105					

```

Vortex_ICD_85      0.1      0.002
Vortex_ICD_85      0.2      0.0029
Vortex_ICD_85      0.3      0.0035
Vortex_ICD_85      0.4      0.0041
Vortex_ICD_85      0.5      0.0045
Vortex_ICD_85      0.6      0.005
Vortex_ICD_85      0.7      0.0054
Vortex_ICD_85      0.8      0.0057
Vortex_ICD_85      0.9      0.0061
Vortex_ICD_85      1      0.0064
Vortex_ICD_85      1.2      0.007
Vortex_ICD_85      1.4      0.0076
Vortex_ICD_85      1.6      0.0081
Vortex_ICD_85      1.8      0.0086
Vortex_ICD_85      2      0.0091
Vortex_ICD_85      2.5      0.0101
Vortex_ICD_85      3      0.0111

;Tempest Rating Curve for Vortex ICD 90, No grate allowance
Vortex_ICD_90      Rating      0      0
Vortex_ICD_90      0.1      0.0022
Vortex_ICD_90      0.2      0.0032
Vortex_ICD_90      0.3      0.0039
Vortex_ICD_90      0.4      0.0045
Vortex_ICD_90      0.5      0.0051
Vortex_ICD_90      0.6      0.0055
Vortex_ICD_90      0.7      0.006
Vortex_ICD_90      0.8      0.0064
Vortex_ICD_90      0.9      0.0068
Vortex_ICD_90      1      0.0072
Vortex_ICD_90      1.2      0.0079
Vortex_ICD_90      1.4      0.0085
Vortex_ICD_90      1.6      0.0091
Vortex_ICD_90      1.8      0.0096
Vortex_ICD_90      2      0.0102
Vortex_ICD_90      2.5      0.0114
Vortex_ICD_90      3      0.0125

;Tempest Rating Curve for Vortex ICD 95, No grate allowance
Vortex_ICD_95      Rating      0      0
Vortex_ICD_95      0.1      0.0026
Vortex_ICD_95      0.2      0.0036
Vortex_ICD_95      0.3      0.0044
Vortex_ICD_95      0.4      0.0051
Vortex_ICD_95      0.5      0.0057
Vortex_ICD_95      0.6      0.0062
Vortex_ICD_95      0.7      0.0067
Vortex_ICD_95      0.8      0.0071
Vortex_ICD_95      0.9      0.0076
Vortex_ICD_95      1      0.008
Vortex_ICD_95      1.2      0.0087
Vortex_ICD_95      1.4      0.0094
Vortex_ICD_95      1.6      0.0101
Vortex_ICD_95      1.8      0.0107
Vortex_ICD_95      2      0.0113
Vortex_ICD_95      2.5      0.0126
Vortex_ICD_95      3      0.0138

;From Zurn Manual RD178
ZURN_2150F-6NH      Rating      0      0
ZURN_2150F-6NH      0.0127      0.00503838308477861
ZURN_2150F-6NH      0.0257      0.0132420013231177
ZURN_2150F-6NH      0.0384      0.0234992054543888
ZURN_2150F-6NH      0.0508      0.0357128365761305
ZURN_2150F-6NH      0.0765      0.0425019726111045
ZURN_2150F-6NH      0.1024      0.0433196215564931

CB120      Storage      0      0.36
CB120      0.3      338.53

CB121      Storage      0      0.36
CB121      0.3      292.64

CB122      Storage      0      0.073
CB122      1.45      0.073
CB122      1.7      74.71

CB123      Storage      0      0.36
CB123      2.182      0.36

CB124      Storage      0      0.073
CB124      1.58      34.68
CB124      1.78      34.68

CB125      Storage      0      0.36
CB125      1.65      36
CB125      1.95      37.3
CB125      2      37.3

[;TIMESERIES]
;Name      Date      Time      Value
;-----
;Rainfall (mm/hr)
3CHI00      01/01/2000      00:00:00      5.339
3CHI100      01/01/2000      00:10:00      6.376
3CHI100      01/01/2000      00:20:00      7.977
3CHI100      01/01/2000      00:30:00      10.797
3CHI100      01/01/2000      00:40:00      14.36
3CHI100      01/01/2000      00:50:00      45.128
3CHI100      01/01/2000      01:00:00      178.107
3CHI100      01/01/2000      01:10:00      51.056
3CHI100      01/01/2000      01:20:00      16.63
3CHI100      01/01/2000      01:30:00      17.571
3CHI100      01/01/2000      01:40:00      13.277
3CHI100      01/01/2000      01:50:00      10.712
3CHI100      01/01/2000      02:00:00      9.008
3CHI100      01/01/2000      02:10:00      7.983
3CHI100      01/01/2000      02:20:00      6.883
3CHI100      01/01/2000      02:30:00      6.174
3CHI100      01/01/2000      02:40:00      5.607
3CHI100      01/01/2000      02:50:00      5.142
3CHI100      01/01/2000      03:00:00      0

;Sum of Infiltrated flow from above the garage slab calculated from Infiltration graphs for S6
multiplied by the total pervious area above the garage.
InfiltratedInflow 01/01/2000 00:01:00 0.001019365
InfiltratedInflow 01/01/2000 00:02:00 0.001019365
InfiltratedInflow 01/01/2000 00:03:00 0.001019365
InfiltratedInflow 01/01/2000 00:04:00 0.001019365
InfiltratedInflow 01/01/2000 00:05:00 0.001019365
InfiltratedInflow 01/01/2000 00:06:00 0.001019365
InfiltratedInflow 01/01/2000 00:07:00 0.001019365
InfiltratedInflow 01/01/2000 00:08:00 0.001523033
InfiltratedInflow 01/01/2000 00:09:00 0.001019365
InfiltratedInflow 01/01/2000 00:10:00 0.001217357
InfiltratedInflow 01/01/2000 00:11:00 0.001217357
InfiltratedInflow 01/01/2000 00:12:00 0.001523033
InfiltratedInflow 01/01/2000 00:13:00 0.001217357
InfiltratedInflow 01/01/2000 00:14:00 0.001217357
InfiltratedInflow 01/01/2000 00:15:00 0.001217357
InfiltratedInflow 01/01/2000 00:16:00 0.001523033
InfiltratedInflow 01/01/2000 00:17:00 0.001217357
InfiltratedInflow 01/01/2000 00:18:00 0.001217357
InfiltratedInflow 01/01/2000 00:19:00 0.001217357
InfiltratedInflow 01/01/2000 00:20:00 0.001523033
InfiltratedInflow 01/01/2000 00:21:00 0.001523033
InfiltratedInflow 01/01/2000 00:22:00 0.001523033
InfiltratedInflow 01/01/2000 00:23:00 0.001523033
InfiltratedInflow 01/01/2000 00:24:00 0.001523033
InfiltratedInflow 01/01/2000 00:25:00 0.001523033
InfiltratedInflow 01/01/2000 00:26:00 0.001523033
InfiltratedInflow 01/01/2000 00:27:00 0.001523033
InfiltratedInflow 01/01/2000 00:28:00 0.001523033
InfiltratedInflow 01/01/2000 00:29:00 0.001523033
InfiltratedInflow 01/01/2000 00:30:00 0.00206145
InfiltratedInflow 01/01/2000 00:31:00 0.00206145
InfiltratedInflow 01/01/2000 00:32:00 0.00206145
InfiltratedInflow 01/01/2000 00:33:00 0.00206145
InfiltratedInflow 01/01/2000 00:34:00 0.00206145

InfiltratedInflow 01/01/2000 00:35:00 0.00206145
InfiltratedInflow 01/01/2000 00:36:00 0.00206145
InfiltratedInflow 01/01/2000 00:37:00 0.00206145
InfiltratedInflow 01/01/2000 00:38:00 0.00206145
InfiltratedInflow 01/01/2000 00:39:00 0.00206145
InfiltratedInflow 01/01/2000 00:40:00 0.003271743
InfiltratedInflow 01/01/2000 00:41:00 0.003271743
InfiltratedInflow 01/01/2000 00:42:00 0.003271743
InfiltratedInflow 01/01/2000 00:43:00 0.003271743
InfiltratedInflow 01/01/2000 00:44:00 0.003271743
InfiltratedInflow 01/01/2000 00:45:00 0.003271743
InfiltratedInflow 01/01/2000 00:46:00 0.003271743
InfiltratedInflow 01/01/2000 00:47:00 0.003271743
InfiltratedInflow 01/01/2000 00:48:00 0.003271743
InfiltratedInflow 01/01/2000 00:49:00 0.003271743
InfiltratedInflow 01/01/2000 00:50:00 0.008514358
InfiltratedInflow 01/01/2000 00:51:00 0.008514358
InfiltratedInflow 01/01/2000 00:52:00 0.008514358
InfiltratedInflow 01/01/2000 00:53:00 0.008514358
InfiltratedInflow 01/01/2000 00:54:00 0.008514358
InfiltratedInflow 01/01/2000 00:55:00 0.006765399
InfiltratedInflow 01/01/2000 00:56:00 0.006765399
InfiltratedInflow 01/01/2000 00:57:00 0.006765399
InfiltratedInflow 01/01/2000 00:58:00 0.006765399
InfiltratedInflow 01/01/2000 00:59:00 0.006765399
InfiltratedInflow 01/01/2000 01:00:00 0.005526751
InfiltratedInflow 01/01/2000 01:01:00 0.005526751
InfiltratedInflow 01/01/2000 01:02:00 0.005526751
InfiltratedInflow 01/01/2000 01:03:00 0.005526751
InfiltratedInflow 01/01/2000 01:04:00 0.005526751
InfiltratedInflow 01/01/2000 01:05:00 0.004649515
InfiltratedInflow 01/01/2000 01:06:00 0.004649515
InfiltratedInflow 01/01/2000 01:07:00 0.004649515
InfiltratedInflow 01/01/2000 01:08:00 0.004649515
InfiltratedInflow 01/01/2000 01:09:00 0.004649515
InfiltratedInflow 01/01/2000 01:10:00 0.004028239
InfiltratedInflow 01/01/2000 01:11:00 0.004028239
InfiltratedInflow 01/01/2000 01:12:00 0.004028239
InfiltratedInflow 01/01/2000 01:13:00 0.004028239
InfiltratedInflow 01/01/2000 01:14:00 0.004028239
InfiltratedInflow 01/01/2000 01:15:00 0.003588238
InfiltratedInflow 01/01/2000 01:16:00 0.003588238
InfiltratedInflow 01/01/2000 01:17:00 0.003588238
InfiltratedInflow 01/01/2000 01:18:00 0.003588238
InfiltratedInflow 01/01/2000 01:19:00 0.003276621
InfiltratedInflow 01/01/2000 01:20:00 0.003276621
InfiltratedInflow 01/01/2000 01:21:00 0.003276621
InfiltratedInflow 01/01/2000 01:22:00 0.003276621
InfiltratedInflow 01/01/2000 01:23:00 0.003055928
InfiltratedInflow 01/01/2000 01:24:00 0.003055928
InfiltratedInflow 01/01/2000 01:25:00 0.003055928
InfiltratedInflow 01/01/2000 01:26:00 0.003055928
InfiltratedInflow 01/01/2000 01:27:00 0.003055928
InfiltratedInflow 01/01/2000 01:28:00 0.003055928
InfiltratedInflow 01/01/2000 01:29:00 0.003055928
InfiltratedInflow 01/01/2000 01:30:00 0.002899628
InfiltratedInflow 01/01/2000 01:31:00 0.002899628
InfiltratedInflow 01/01/2000 01:32:00 0.002899628
InfiltratedInflow 01/01/2000 01:33:00 0.002899628
InfiltratedInflow 01/01/2000 01:34:00 0.002899628
InfiltratedInflow 01/01/2000 01:35:00 0.002788933
InfiltratedInflow 01/01/2000 01:36:00 0.002788933
InfiltratedInflow 01/01/2000 01:37:00 0.002788933
InfiltratedInflow 01/01/2000 01:38:00 0.002788933
InfiltratedInflow 01/01/2000 01:39:00 0.002710537
InfiltratedInflow 01/01/2000 01:40:00 0.002710537
InfiltratedInflow 01/01/2000 01:41:00 0.002710537
InfiltratedInflow 01/01/2000 01:42:00 0.002710537
InfiltratedInflow 01/01/2000 01:43:00 0.002710537
InfiltratedInflow 01/01/2000 01:44:00 0.002655015
InfiltratedInflow 01/01/2000 01:45:00 0.002655015
InfiltratedInflow 01/01/2000 01:46:00 0.002655015
InfiltratedInflow 01/01/2000 01:47:00 0.002655015
InfiltratedInflow 01/01/2000 01:48:00 0.002655015
InfiltratedInflow 01/01/2000 01:49:00 0.002655015
InfiltratedInflow 01/01/2000 01:50:00 0.002615693
InfiltratedInflow 01/01/2000 01:51:00 0.002615693
InfiltratedInflow 01/01/2000 01:52:00 0.002615693
InfiltratedInflow 01/01/2000 01:53:00 0.002615693
InfiltratedInflow 01/01/2000 01:54:00 0.002615693
InfiltratedInflow 01/01/2000 01:55:00 0.002587845
InfiltratedInflow 01/01/2000 01:56:00 0.002587845
InfiltratedInflow 01/01/2000 01:57:00 0.002587845
InfiltratedInflow 01/01/2000 01:58:00 0.002587845
InfiltratedInflow 01/01/2000 01:59:00 0.002587845
InfiltratedInflow 01/01/2000 02:00:00 0.002568122
InfiltratedInflow 01/01/2000 02:01:00 0.002568122
InfiltratedInflow 01/01/2000 02:02:00 0.002568122
InfiltratedInflow 01/01/2000 02:03:00 0.002568122
InfiltratedInflow 01/01/2000 02:04:00 0.002554154
InfiltratedInflow 01/01/2000 02:05:00 0.002554154
InfiltratedInflow 01/01/2000 02:06:00 0.002554154
InfiltratedInflow 01/01/2000 02:07:00 0.002554154
InfiltratedInflow 01/01/2000 02:08:00 0.002554154
InfiltratedInflow 01/01/2000 02:09:00 0.002554154
InfiltratedInflow 01/01/2000 02:10:00 0.002544262
InfiltratedInflow 01/01/2000 02:11:00 0.002544262
InfiltratedInflow 01/01/2000 02:12:00 0.002544262
InfiltratedInflow 01/01/2000 02:13:00 0.002544262
InfiltratedInflow 01/01/2000 02:14:00 0.002544262
InfiltratedInflow 01/01/2000 02:15:00 0.002537255
InfiltratedInflow 01/01/2000 02:16:00 0.002537255
InfiltratedInflow 01/01/2000 02:17:00 0.002537255
InfiltratedInflow 01/01/2000 02:18:00 0.002537255
InfiltratedInflow 01/01/2000 02:19:00 0.002537255
InfiltratedInflow 01/01/2000 02:20:00 0.002532294
InfiltratedInflow 01/01/2000 02:21:00 0.002532294
InfiltratedInflow 01/01/2000 02:22:00 0.002532294
InfiltratedInflow 01/01/2000 02:23:00 0.002532294
InfiltratedInflow 01/01/2000 02:24:00 0.002528779
InfiltratedInflow 01/01/2000 02:25:00 0.002528779
InfiltratedInflow 01/01/2000 02:26:00 0.002528779
InfiltratedInflow 01/01/2000 02:27:00 0.002528779
InfiltratedInflow 01/01/2000 02:28:00 0.002528779
InfiltratedInflow 01/01/2000 02:29:00 0.002528779
InfiltratedInflow 01/01/2000 02:30:00 0.002526291
InfiltratedInflow 01/01/2000 02:31:00 0.002526291
InfiltratedInflow 01/01/2000 02:32:00 0.002526291
InfiltratedInflow 01/01/2000 02:33:00 0.002526291
InfiltratedInflow 01/01/2000 02:34:00 0.002526291
InfiltratedInflow 01/01/2000 02:35:00 0.002524528
InfiltratedInflow 01/01/2000 02:36:00 0.002524528
InfiltratedInflow 01/01/2000 02:37:00 0.002524528
InfiltratedInflow 01/01/2000 02:38:00 0.002524528
InfiltratedInflow 01/01/2000 02:39:00 0.002524528
InfiltratedInflow 01/01/2000 02:40:00 0.00252328
InfiltratedInflow 01/01/2000 02:41:00 0.00252328
InfiltratedInflow 01/01/2000 02:42:00 0.00252328
InfiltratedInflow 01/01/2000 02:43:00 0.00252328
InfiltratedInflow 01/01/2000 02:44:00 0.00252328
InfiltratedInflow 01/01/2000 02:45:00 0.002522396
InfiltratedInflow 01/01/2000 02:46:00 0.002522396
InfiltratedInflow 01/01/2000 02:47:00 0.002522396
InfiltratedInflow 01/01/2000 02:48:00 0.002522396
InfiltratedInflow 01/01/2000 02:49:00 0.002522396
InfiltratedInflow 01/01/2000 02:50:00 0.00252177
InfiltratedInflow 01/01/2000 02:51:00 0.00252177
InfiltratedInflow 01/01/2000 02:52:00 0.00252177
InfiltratedInflow 01/01/2000 02:53:00 0.00252177
InfiltratedInflow 01/01/2000 02:54:00 0.00252177
InfiltratedInflow 01/01/2000 02:55:00 0.0009938035
InfiltratedInflow 01/01/2000 02:56:00 0.0009938035
InfiltratedInflow 01/01/2000 02:57:00 0.0009938035
InfiltratedInflow 01/01/2000 02:58:00 0.0009938035
InfiltratedInflow 01/01/2000 02:59:00 0.0009938035
InfiltratedInflow 01/01/2000 03:00:00 0.0009938035

[;REPORT]
;Reporting Options

```

Post-Development 3-hour Chicago 1:100-year Event

July 2024

INPUT CONTROLS	YES NO			85	381567.561	5032842.925
SUBCATCHMENTS	ALL			85	381567.488	5032842.863
NODES	ALL			85	381567.417	5032842.799
LINKS	ALL			85	381567.348	5032842.732
[TAGS]				85	381567.282	5032842.663
Subcatch	S10	Building		85	381567.218	5032842.591
Subcatch	S5	ParkingLot		85	381567.156	5032842.518
Subcatch	S8	Ramp		85	381567.097	5032842.442
Subcatch	S9	Building		85	381567.041	5032842.365
Node	St_UnGrd	Underground_Storage		85	381566.987	5032842.285
[MAP]				85	381566.936	5032842.204
DIMENSIONS	381503.2836	5032790.42705	381639.0324	85	381566.888	5032842.121
UNITS	Meters		5032880.16395	85	381566.843	5032842.036
[COORDINATES]				85	381566.8	5032841.95
;;Node	X-Coord	Y-Coord		85	381566.761	5032841.863
MH505	381512.619	5032853.746		85	381566.725	5032841.774
OF2	381610.244	5032876.085		85	381566.692	5032841.684
OF3	381513.952	5032857.477		85	381566.661	5032841.593
OF4	381509.454	5032832.912		85	381566.634	5032841.501
CB120	381549.093	5032839.563		85	381566.611	5032841.408
CB121	381584.314	5032823.865		85	381566.59 <th>5032841.314</th>	5032841.314
CB122	381627.208	5032806.966		85	381565.348 <th>5032835.196</th>	5032835.196
CB123	381622.312	5032818.188		85	381564.854 <th>5032833.766</th>	5032833.766
CB124	381612.986	5032839.563		85	381564.337 <th>5032831.218</th>	5032831.218
CB125	381519.372	5032825.114		85	381546.649 <th>5032834.808</th>	5032834.808
Roof1	381594.1	5032833.494		85	381537.422 <th>5032836.68</th>	5032836.68
Roof2	381526.761	5032828.396		85	381536.967 <th>5032834.441</th>	5032834.441
St_UnGrd	381520.468	5032851.542		85	381534.419 <th>5032834.958</th>	5032834.958
[VERTICES]				85	381534.873 <th>5032833.198</th>	5032833.198
;;Link	X-Coord	Y-Coord		85	381524.892 <th>5032839.223</th>	5032839.223
BLDG_F	381587.375	5032838.9		85	381525.411 <th>5032841.771</th>	5032841.771
CB121	381580.382	5032829.221		85	381524.284 <th>5032843.53</th>	5032843.53
CB121	381526.869	5032841.1		85	381525.228 <th>5032848.183</th>	5032848.183
CB123	381583.496	5032831.297		85	381524.866 <th>5032848.769</th>	5032848.769
CB123	381530.098	5032843.407		85	381520.586 <th>5032849.638</th>	5032849.638
[POLYGONS]				85	381519.182 <th>5032849.734</th>	5032849.734
;;Subcatchment	X-Coord	Y-Coord		85	381519.868 <th>5032856.263</th>	5032856.263
S1	381585.63	5032868.962		85	381545.732 <th>5032851.464</th>	5032851.464
S1	381545.732	5032851.464		85	381574.562 <th>5032846.312</th>	5032846.312
S1	381549.853	5032863.759		86	381574.562 <th>5032846.312</th>	5032846.312
S1	381561.389	5032872.018		86	381572.167 <th>5032851.809</th>	5032851.809
S1	381568.12	5032873.68		86	381581.761 <th>5032854.864</th>	5032854.864
S1	381571.213	5032866.739		86	381590.946 <th>5032833.812</th>	5032833.812
S1	381575.491	5032868.703		86	381603.052 <th>5032806.066</th>	5032806.066
S1	381584.113	5032872.421		86	381601.787 <th>5032799.963</th>	5032799.963
S1	381585.63	5032868.962		86	381562.788 <th>5032808.079</th>	5032808.079
S10	381577.07	5032828.633		86	381563.78 <th>5032812.962</th>	5032812.962
S10	381573.49	5032810.992		86	381573.49 <th>5032810.992</th>	5032810.992
S10	381521.312	5032821.582		86	381577.07 <th>5032828.633</th>	5032828.633
S10	381524.892	5032839.223		86	381564.337 <th>5032831.218</th>	5032831.218
S10	381534.873	5032837.198		86	381564.854 <th>5032833.766</th>	5032833.766
S10	381534.917	5032834.958		86	381565.348 <th>5032835.196</th>	5032835.196
S10	381536.967	5032834.441		86	381566.59 <th>5032841.314</th>	5032841.314
S10	381537.422	5032836.68		86	381566.611 <th>5032841.408</th>	5032841.408
S10	381577.07	5032828.633		86	381566.635 <th>5032841.501</th>	5032841.501
S2	381600.237	5032851.815		86	381566.662 <th>5032841.593</th>	5032841.593
S2	381608.78	5032855.542		86	381566.692 <th>5032841.684</th>	5032841.684
S2	381620.836	5032828.001		86	381566.725 <th>5032841.774</th>	5032841.774
S2	381614.354	5032825.173		86	381566.761 <th>5032841.862</th>	5032841.862
S2	381603.372	5032850.345		86	381566.801 <th>5032841.95</th>	5032841.95
S2	381601.278	5032849.431		86	381566.843 <th>5032842.036</th>	5032842.036
S2	381600.237	5032851.815		86	381566.888 <th>5032842.121</th>	5032842.121
S2	381600.122	5032875.319		86	381566.937 <th>5032842.203</th>	5032842.203
S2	381600.122	5032875.319		86	381566.988 <th>5032842.285</th>	5032842.285
S2	381608.78	5032855.542		86	381567.041 <th>5032842.364</th>	5032842.364
S2	381602.332	5032852.729		86	381567.098 <th>5032842.442</th>	5032842.442
S2	381598.259	5032862.063		86	381567.157 <th>5032842.517</th>	5032842.517
S2	381597.544	5032861.752		86	381567.218 <th>5032842.591</th>	5032842.591
S2	381593.609	5032870.772		86	381567.282 <th>5032842.663</th>	5032842.663
S2	381567.855	5032859.534		86	381567.348 <th>5032842.732</th>	5032842.732
S2	381567.277	5032860.913		86	381567.417 <th>5032842.798</th>	5032842.798
S2	381600.122	5032875.319		86	381567.488 <th>5032842.863</th>	5032842.863
S2	381524.892	5032839.223		86	381567.562 <th>5032842.925</th>	5032842.925
S4	381521.312	5032821.582		86	381567.63 <th>5032842.984</th>	5032842.984
S4	381563.78	5032812.963		86	381567.714 <th>5032843.041</th>	5032843.041
S4	381562.788	5032808.079		86	381567.793 <th>5032843.095</th>	5032843.095
S4	381521.032	5032816.77		86	381567.874 <th>5032843.147</th>	5032843.147
S4	381516.421	5032820.775		86	381567.952 <th>5032843.199</th>	5032843.199
S4	381519.182	5032849.734		86	381568.041 <th>5032843.241</th>	5032843.241
S4	381520.586	5032849.638		86	381568.127 <th>5032843.284</th>	5032843.284
S4	381524.866	5032848.769		86	381568.214 <th>5032843.324</th>	5032843.324
S4	381525.228	5032848.183		86	381570.904 <th>5032844.497</th>	5032844.497
S4	381524.284	5032843.53		86	381570.746 <th>5032844.646</th>	5032844.646
S4	381525.411	5032841.771		86	381574.562 <th>5032846.312</th>	5032846.312
S4	381524.892	5032839.223		87	381627.999 <th>5032794.506</th>	5032794.506
S5	381545.732	5032851.464		87	381601.787 <th>5032799.963</th>	5032799.963
S5	381567.277	5032860.913		87	381603.052 <th>5032806.066</th>	5032806.066
S5	381567.855	5032859.534		87	381619.55 <th>5032813.264</th>	5032813.264
S5	381567.158	5032859.115		87	381614.354 <th>5032825.173</th>	5032825.173
S5	381566.874	5032858.986		87	381620.836 <th>5032828.001</th>	5032828.001
S5	381566.594	5032858.846		87	381632.862 <th>5032800.531</th>	5032800.531
S5	381566.319	5032858.697		87	381627.999 <th>5032794.506</th>	5032794.506
S5	381566.05	5032858.539		88	381597.544 <th>5032861.751</th>	5032861.751
S5	381565.786	5032858.372		88	381561.761 <th>5032854.863</th>	5032854.863
S5	381565.528	5032858.196		88	381568.041 <th>5032843.241</th>	5032843.241
S5	381565.276	5032858.012		88	381568.127 <th>5032843.284</th>	5032843.284
S5	381565.03	5032857.819		88	381568.214 <th>5032843.324</th>	5032843.324
S5	381564.792	5032857.617		88	381570.904 <th>5032844.497</th>	5032844.497
S5	381564.56	5032857.408		88	381570.746 <th>5032844.646</th>	5032844.646
S5	381564.335	5032857.191		88	381574.562 <th>5032846.312</th>	5032846.312
S5	381564.118	5032856.966		88	381627.999 <th>5032794.506</th>	5032794.506
S5	381563.908	5032856.735		88	381601.787 <th>5032799.963</th>	5032799.963
S5	381563.707	5032856.496		88	381603.052 <th>5032806.066</th>	5032806.066
S5	381563.514	5032856.25		88	381619.55 <th>5032813.264</th>	5032813.264
S5	381563.329	5032855.999		88	381614.354 <th>5032825.173</th>	5032825.173
S5	381563.153	5032855.741		88	381620.836 <th>5032828.001</th>	5032828.001
S5	381562.986	5032855.477		88	381632.862 <th>5032800.531</th>	5032800.531
S5	381562.827	5032855.207		88	381627.999 <th>5032794.506</th>	5032794.506
S5	381562.681	5032854.937		88	381597.544 <th>5032861.751</th>	5032861.751
S5	381562.543	5032854.662		88	381561.761 <th>5032854.863</th>	5032854.863
S5	381562.415	5032854.382		88	381568.041 <th>5032843.241</th>	5032843.241
S5	381562.296	5032854.099		88	381568.127 <th>5032843.284</th>	5032843.284
S5	381562.186	5032853.811		88	381568.214 <th>5032843.324</th>	5032843.324
S5	381562.087	5032853.52		88	381570.904 <th>5032844.497</th>	5032844.497
S5	381561.997	5032853.226		88	381570.746 <th>5032844.646</th>	5032844.646
S5	381561.917	5032852.929		88	381574.562 <th>5032846.312</th>	5032846.312
S5	381561.846	5032852.63		88	381627.999 <th>5032794.506</th>	5032794.506
S5	381561.812	5032852.481		88	381601.787 <th>5032799.963</th>	5032799.963
S5	381561.773	5032852.334		88	381603.052 <th>5032806.066</th>	5032806.066
S5	381561.729	5032852.188		88	381619.55 <th>5032813.264</th>	5032813.264
S5	381561.68	5032852.043		88	381614.354 <th>5032825.173</th>	5032825.173
S5	381561.627	5032851.9		88	381620.836 <th>5032828.001</th>	5032828.001
S5	381561.569	5032851.759		88	381632.862 <th>5032800.531</th>	5032800.531
S5	381561.507	5032851.62		88	381627.999 <th>5032794.506</th>	5032794.506
S5	381561.441	5032851.483		88	381597.544 <th>5032861.751</th>	5032861.751
S5	381561.615	5032851.396		88	381561.761 <th>5032854.863</th>	5032854.863
S5	381568.16	5032850.064		88	381568.041 <th>5032843.241</th>	5032843.241
S5	381572.167	5032851.809		88	381568.127 <th>5032843.284</th>	5032843.284
S5	381574.562	5032846.312		88	381568.214 <th>5032843.324</th>	5032843.324
S5	381570.746	5032844.646		88	381570.904 <th>5032844.497</th>	5032844.497
S5	381570.904	5032844.497		88	381570.746 <th>5032844.646</th>	5032844.646
S5	381568.214	5032843.324		88	381574.562 <th>5032846.312</th>	5032846.312
S5	381568.127	5032843.284		88	381627.999 <th>5032794.506</th>	5032794.506
S5	381568.041	5032843.241		88	381601.787 <th>5032799.963</th>	5032799.963
S5	381567.957	5032843.195		88	381603.052 <th>5032806.066</th>	5032806.066
S5						

```
;;-----
[SYMBOLS]
;;Gage      X-Coord      Y-Coord
;;-----
```

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.2 (Build 5.2.4)

```
*****
Element Count
*****
Number of rain gages ..... 1
Number of subcatchments ... 10
Number of nodes ..... 13
Number of links ..... 9
Number of pollutants ..... 0
Number of land uses ..... 0
```

```
*****
Raingage Summary
*****
```

Name	Data Source	Data Type	Recording Interval
3CHI100	3CHI100	INTENSITY	10 min.

```
*****
Subcatchment Summary
*****
```

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
S1	0.03	38.60	14.29	1.5000	3CHI100	CB120
S10	0.10	18.00	100.00	1.0000	3CHI100	Roof2
S2	0.02	38.94	11.12	2.1000	3CHI100	CB124
S3	0.02	26.02	0.00	2.0000	3CHI100	OF2
S4	0.04	163.64	3.09	1.5000	3CHI100	CB125
S5	0.09	79.85	77.46	2.0000	3CHI100	CB120
S6	0.11	105.72	17.82	2.1000	3CHI100	CB121
S7	0.05	44.22	13.68	3.3000	3CHI100	CB122
S8	0.03	11.98	95.75	5.2000	3CHI100	St_UnGrd
S9	0.10	18.00	100.00	1.0000	3CHI100	Roof1

```
*****
Node Summary
*****
```

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
MH505	OUTFALL	78.00	0.00	0.0	
OF2	OUTFALL	0.00	0.00	0.0	
OF3	OUTFALL	78.88	0.00	0.0	
OF4	OUTFALL	78.88	0.00	0.0	
CB120	STORAGE	82.10	0.30	0.0	
CB121	STORAGE	82.28	0.30	0.0	
CB122	STORAGE	79.35	1.70	0.0	
CB123	STORAGE	79.17	2.18	0.0	
CB124	STORAGE	79.47	1.78	0.0	
CB125	STORAGE	80.20	2.00	0.0	
Roof1	STORAGE	88.65	0.15	0.0	
Roof2	STORAGE	88.85	0.15	0.0	
St_UnGrd	STORAGE	78.00	1.00	0.0	Yes

```
*****
Link Summary
*****
```

Name	From Node	To Node	Type	Length	%Slope
C1	CB124	CB123	CONDUIT	23.3	0.9862
C2	CB122	CB123	CONDUIT	12.2	0.9965
BLDG_F	Roof2	OF4	OUTLET		
Roof1	OF3	OUTLET			
CB120	St_UnGrd	OUTLET			
CB121	St_UnGrd	OUTLET			
CB123	St_UnGrd	OUTLET			
CB125	St_UnGrd	OUTLET			
OL1	St_UnGrd	MH505	OUTLET		

```
*****
Cross Section Summary
*****
```

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	CIRCULAR	0.25	0.05	0.06	0.25	1	0.06
C2	CIRCULAR	0.25	0.05	0.06	0.25	1	0.06

```
*****
Analysis Options
*****
Flow Units ..... CMS
Process Models:
Rainfall/Runoff ..... YES
RDII ..... NO
Snowmelt ..... NO
Groundwater ..... NO
Flow Routing ..... YES
Ponding Allowed ..... NO
Water Quality ..... NO
Infiltration Method ..... HORTON
Flow Routing Method ..... DYNWAVE
Surcharge Method ..... EXTRAN
Starting Date ..... 01/01/2000 00:00:00
Ending Date ..... 01/01/2000 03:00:00
Antecedent Dry Days ..... 0.0
Report Time Step ..... 00:00:05
Wet Time Step ..... 00:02:00
Dry Time Step ..... 00:02:00
Routing Time Step ..... 5.00 sec
Variable Time Step ..... YES
Maximum Trials ..... 8
Number of Threads ..... 1
Head Tolerance ..... 0.001500 m
```

```
*****
Volume Depth
----- mm
Runoff Quantity Continuity hectare-m
*****
Total Precipitation ..... 0.042 71.708
Evaporation Loss ..... 0.000 0.000
Infiltration Loss ..... 0.012 19.860
Surface Runoff ..... 0.030 50.847
Final Storage ..... 0.001 1.269
Continuity Error (%) ..... -0.374
```

```
*****
Volume Volume
----- 10^6 ltr
Flow Routing Continuity hectare-m
*****
Dry Weather Inflow ..... 0.000 0.000
Wet Weather Inflow ..... 0.030 0.299
Groundwater Inflow ..... 0.000 0.000
RDII Inflow ..... 0.000 0.000
External Inflow ..... 0.003 0.031
External Outflow ..... 0.023 0.233
Flooding Loss ..... 0.000 0.000
Evaporation Loss ..... 0.000 0.000
Exfiltration Loss ..... 0.000 0.000
Initial Stored Volume ..... 0.000 0.000
Final Stored Volume ..... 0.010 0.096
```

Continuity Error (%) 0.028

Time-Step Critical Elements

None

Highest Flow Instability Indexes

Link C2 (4)
Link C1 (3)

Most Frequent Nonconverging Nodes

Convergence obtained at all time steps.

Routing Time Step Summary

Minimum Time Step : 1.01 sec
Average Time Step : 4.99 sec
Maximum Time Step : 5.00 sec
% of Time in Steady State : 0.00
Average Iterations per Step : 2.01
% of Steps Not Converging : 0.05
Time Step Frequencies :
5.000 - 3.155 sec : 99.77 %
3.155 - 1.991 sec : 0.18 %
1.991 - 1.256 sec : 0.00 %
1.256 - 0.792 sec : 0.05 %
0.792 - 0.500 sec : 0.00 %

Subcatchment Runoff Summary

Total Runoff mm	Total Runoff 10 ⁶ ltr	Peak Runoff CMS	Total Runoff Precip mm	Total Runoff mm	Total Evap mm	Total Infil mm	Imperv Runoff mm	Perv Runoff mm
S1			71.71	0.00	0.00	39.23	10.02	32.49
32.49	0.01	0.01	0.453	0.00	0.00	0.00	69.39	0.00
S10			71.71	0.00	0.00	40.02	7.81	31.87
69.39	0.07	0.05	0.968	0.00	0.00	43.90	0.00	28.05
S2			71.71	0.00	0.00	42.42	2.17	29.69
31.87	0.01	0.01	0.444	0.00	0.00	9.77	54.30	6.49
S3			71.71	0.00	0.00	36.14	12.50	22.97
28.05	0.01	0.01	0.391	0.00	0.00	39.37	9.60	32.39
S4			71.71	0.00	0.00	2.17	67.06	67.58
29.69	0.01	0.02	0.414	0.00	0.00	0.00	69.40	0.00
S5			71.71	0.00	0.00	0.00	0.00	0.00
60.79	0.05	0.04	0.848	0.00	0.00	0.00	0.00	0.00
S6			71.71	0.00	0.00	0.00	0.00	0.00
35.47	0.04	0.04	0.495	0.00	0.00	0.00	0.00	0.00
S7			71.71	0.00	0.00	0.00	0.00	0.00
32.39	0.02	0.02	0.452	0.00	0.00	0.00	0.00	0.00
S8			71.71	0.00	0.00	0.00	0.00	0.00
67.58	0.02	0.02	0.942	0.00	0.00	0.00	0.00	0.00
S9			71.71	0.00	0.00	0.00	0.00	0.00
69.40	0.07	0.05	0.968	0.00	0.00	0.00	0.00	0.00

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
MH505	OUTFALL	0.00	0.00	78.00	0 00:00	0.00
OF2	OUTFALL	0.00	0.00	0.00	0 00:00	0.00
OF3	OUTFALL	0.00	0.00	78.88	0 00:00	0.00
OF4	OUTFALL	0.00	0.00	78.88	0 00:00	0.00
CB120	STORAGE	0.01	0.10	82.20	0 01:10	0.10
CB121	STORAGE	0.01	0.06	82.34	0 01:10	0.06
CB122	STORAGE	0.47	1.63	80.98	0 01:22	1.63
CB123	STORAGE	0.56	1.81	80.98	0 01:22	1.81
CB124	STORAGE	0.42	1.51	80.98	0 01:22	1.51
CB125	STORAGE	0.30	1.86	82.06	0 01:13	1.86
Roof1	STORAGE	0.05	0.08	88.93	0 02:23	0.08
Roof2	STORAGE	0.05	0.08	88.93	0 02:23	0.08
St_UnGrd	STORAGE	0.19	0.97	78.97	0 01:22	0.97

Node Inflow Summary

Flow Balance	Node	Type	Maximum Inflow CMS	Maximum Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow 10 ⁶ ltr	Total Inflow 10 ⁶ ltr
MH505	OUTFALL	0.000	0.041	0	01:02	0	0.192
OF2	OUTFALL	0.008	0.008	0	01:10	0.00569	0.00569
OF3	OUTFALL	0.000	0.002	0	00:38	0	0.018
OF4	OUTFALL	0.000	0.002	0	00:38	0	0.018
CB120	STORAGE	0.056	0.056	0	01:10	0.0643	0.0643
CB121	STORAGE	0.045	0.045	0	01:10	0.0402	0.0402
CB122	STORAGE	0.020	0.025	0	01:10	0.0159	0.0161
CB123	STORAGE	0.000	0.017	0	01:09	0	0.0232
CB124	STORAGE	0.009	0.012	0	01:05	0.00695	0.00706
CB125	STORAGE	0.017	0.017	0	01:10	0.0115	0.0115
Roof1	STORAGE	0.047	0.047	0	01:10	0.066	0.066
Roof2	STORAGE	0.047	0.047	0	01:10	0.066	0.066
St_UnGrd	STORAGE	0.021	0.114	0	01:10	0.0528	0.192

Node Surcharge Summary

No nodes were surcharged.

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

Maximum Outflow Storage Unit CMS	Average Volume 1000 m ³	Avg Pcnt Full	Evap Pcnt Loss	Exfil Pcnt Loss	Maximum Volume 1000 m ³	Max Pcnt Full	Time of Max Occurrence days hr:min
CB120	0.000	0.6	0.0	0.0	0.006	11.2	0 01:10
0.043	0.000	0.2	0.0	0.0	0.002	4.6	0 01:10
CB121	0.039	7.1	0.0	0.0	0.005	50.7	0 01:22
0.014	0.000	25.6	0.0	0.0	0.001	82.9	0 01:22
CB123	0.011	0.9	0.0	0.0	0.000	3.1	0 01:22
0.011	0.000	4.1	0.0	0.0	0.004	43.3	0 01:13
CB124	0.006	30.9	0.0	0.0	0.049	51.1	0 02:23
0.029	0.029	30.9	0.0	0.0	0.049	51.2	0 02:23
Roof1	0.002	19.1	0.0	0.0	0.047	96.9	0 01:22
0.002	0.029	30.9	0.0	0.0	0.049	51.2	0 02:23
Roof2	0.002	19.1	0.0	0.0	0.047	96.9	0 01:22
0.002	0.029	30.9	0.0	0.0	0.049	51.2	0 02:23
St_UnGrd	0.041	19.1	0.0	0.0	0.047	96.9	0 01:22

Outfall Loading Summary

Outfall Node	Flow Pcnt	Avg Flow CMS	Max Flow CMS	Total Volume 10 ⁶ ltr
MH505	99.40	0.018	0.041	0.192
OF2	32.12	0.002	0.008	0.006
OF3	89.00	0.002	0.002	0.018
OF4	89.00	0.002	0.002	0.018
System	77.38	0.023	0.053	0.233

Link Flow Summary

Link	Type	Maximum Flow CMS	Time of Max Occurrence days hr:min	Maximum Velocity m/sec	Max/Full Flow	Max/Full Depth
C1	CONDUIT	0.011	0 01:10	0.45	0.19	1.00
C2	CONDUIT	0.014	0 01:09	0.59	0.23	1.00
BLDG_E	DUMMY	0.002	0 00:38			
BLDG_F	DUMMY	0.002	0 00:38			
CB120	DUMMY	0.043	0 01:10			
CB121	DUMMY	0.039	0 01:10			
CB123	DUMMY	0.006	0 01:22			
CB125	DUMMY	0.006	0 01:13			
OL1	DUMMY	0.041	0 01:02			

Flow Classification Summary

Conduit	Adjusted / Actual Length	Up Dry	Down Dry	Sub Dry	Fraction of Time in Flow Class	Sup Crit	Up Crit	Down Crit	Norm Crit	Inlet Crit
C1	1.00	0.33	0.00	0.00	0.48	0.00	0.00	0.19	0.07	0.00
C2	1.00	0.33	0.00	0.00	0.48	0.00	0.00	0.19	0.04	0.00

Conduit Surcharge Summary

Conduit	Hours Full Both Ends	Hours Full Upstream	Hours Full Dnstream	Hours Above Normal Flow	Hours Capacity Limited
C1	1.04	1.04	1.21	0.01	0.01
C2	1.12	1.12	1.22	0.01	0.01

Analysis begun on: Thu Sep 26 08:32:10 2024
Analysis ended on: Thu Sep 26 08:32:10 2024
Total elapsed time: < 1 sec

Post-Development 24-hour SCS 1:100-year Event

[TITLE]
;;Project Title/Notes

[OPTIONS]
;;Option Value
FLOW_UNITS CMS
INFILTRATION HORTON
FLOW_ROUTING DYNWAVE
LINK_OFFSETS ELEVATION
MIN_SLOPE 0
ALLOW_PONDING NO
SKIP_STEADY_STATE NO
START_DATE 01/01/2000
START_TIME 00:00:00
REPORT_START_DATE 01/01/2000
REPORT_START_TIME 00:00:00
END_DATE 01/02/2000
END_TIME 00:00:00
SWEEP_START 01/01
SWEEP_END 12/31
DRY_DAYS 0
REPORT_STEP 00:01:00
WET_STEP 00:05:00
DRY_STEP 00:05:00
ROUTING_STEP 5
RULE_STEP 00:00:00

INERTIAL_DAMPING PARTIAL
NORMAL_FLOW_LIMITED BOTH
FORCE_MAIN_EQUATION H-W
VARIABLE_STEP 0.75
LENGTHENING_STEP 0
MIN_SURFAREA 0
MAX_TRIALS 8
HEAD_TOLERANCE 0.0015
SYS_FLOW_TOL 5
LAT_FLOW_TOL 5
MINIMUM_STEP 0.5
THREADS 12

[EVAPORATION]
;;Data Source Parameters
CONSTANT 0.0
DRY_ONLY NO

[RAINGAGES]
;;Name Format Interval SCF Source
24SCS100 INTENSITY 0:15 1.0 TIMESERIES 24SCS100
3CHI1100 INTENSITY 0:10 1.0 TIMESERIES 3CHI1100

[SUBCATCHMENTS]
;;Name Rain Gage Outlet Area %Imperv Width %Slope CurbLen
SnowPack
S1 24SCS100 CB120 0.0331 14.286 38.601 1.5 0
S10 24SCS100 Roof2 0.0953 100 18 1 0
S11 24SCS100 CB124 0.0218 11.125 38.94 2.1 0
S3 24SCS100 OF2 0.0203 0 26.019 2 0
S4 24SCS100 CB125 0.0388 3.093 163.644 1.5 0
S5 24SCS100 CB120 0.0881 77.464 79.845 2 0
S6 24SCS100 CB121 0.1134 17.819 105.724 2.1 0
S7 24SCS100 CB122 0.0492 13.679 44.221 3.3 0
S8 24SCS100 St_UnGrd 0.0327 95.747 11.978 5.2 0
S9 24SCS100 Roof1 0.0952 100 18 1 0

[SUBAREAS]
;;Subcatchment N-Imperv N-Perv S-Imperv S-Perv PctZero RouteTo PctRouted
S1 0.013 0.25 1.57 4.67 0 Manhole_Lid 100
S10 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S2 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S3 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S4 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S5 0.013 0.25 1.57 4.67 0 OUTLET 100
S6 0.013 0.25 1.57 4.67 0 OUTLET 100
S7 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S8 0.013 0.25 1.57 4.67 0 PERVIOUS 100
S9 0.013 0.25 1.57 4.67 0 OUTLET 100

[INFILTRATION]
;;Subcatchment Param1 Param2 Param3 Param4 Param5
S1 76.2 13.2 4.14 7 0
S10 76.2 13.2 4.14 7 0
S2 76.2 13.2 4.14 7 0
S3 76.2 13.2 4.14 7 0
S4 76.2 13.2 4.14 7 0
S5 76.2 13.2 4.14 7 0
S6 76.2 13.2 4.14 7 0
S7 76.2 13.2 4.14 7 0
S8 76.2 13.2 4.14 7 0
S9 76.2 13.2 4.14 7 0

[OUTFALLS]
;;Name Elevation Type Stage Data Gated Route To
MH505 78 NORMAL NO 0 635 0
OF2 0 FREE NO 0 635 0
OF3 78.88 NORMAL NO 0 635 0
OF4 78.88 NORMAL NO 0 635 0

[STORAGE]
;;Name Elev. Psi MaxDepth Ksat InitDepth IMD Shape Curve Name/Params
SurDepth Fevap
CB120 82.1 0.3 0 TABULAR CB120 0
CB121 82.28 0.3 0 TABULAR CB121 0
CB122 79.35 1.7 0 TABULAR CB122 0
CB123 79.168 2.182 0 TABULAR CB123 0
CB124 79.47 1.78 0 TABULAR CB124 0
CB125 80.2 2 0 TABULAR CB125 0
Roof1 88.85 0.15 0 FUNCTIONAL 0 0 635 0
Roof2 88.85 0.15 0 FUNCTIONAL 0 0 635 0
St_UnGrd 78 1 0 FUNCTIONAL 0 0 49 0

[CONDUITS]
;;Name From Node To Node Length Roughness InOffset OutOffset
InitFlow MaxFlow
C1 0.04 CB124 CB123 23.322 0.013 79.47 79.24
C2 0.04 CB122 CB123 12.244 0.013 79.35 79.228

[OUTLETS]
MH505 78 NORMAL NO 0 635 0
OF2 0 FREE NO 0 635 0
OF3 78.88 NORMAL NO 0 635 0
OF4 78.88 NORMAL NO 0 635 0

Table with columns: Name, From Node, To Node, Offset, Type, QTable/Qcoeff. Contains detailed data for various nodes and conduits, including flow rates and types.

MHF_IPEX_TYPE_C	2	0.0473	Vortex_ICD_50	Rating	0	0
MHF_IPEX_TYPE_C	2.5	0.0529	Vortex_ICD_50		0.1	0.0007
MHF_IPEX_TYPE_C	3	0.0579	Vortex_ICD_50		0.2	0.001
;Tempest Rating Curve for MHF IPEX TYPE D, No grate allowance			Vortex_ICD_50		0.3	0.0012
MHF_IPEX_TYPE_D	Rating	0	Vortex_ICD_50		0.4	0.0014
MHF_IPEX_TYPE_D		0.1	Vortex_ICD_50		0.5	0.0016
MHF_IPEX_TYPE_D		0.2	Vortex_ICD_50		0.6	0.0018
MHF_IPEX_TYPE_D		0.3	Vortex_ICD_50		0.7	0.0019
MHF_IPEX_TYPE_D		0.4	Vortex_ICD_50		0.8	0.002
MHF_IPEX_TYPE_D		0.5	Vortex_ICD_50		0.9	0.0021
MHF_IPEX_TYPE_D		0.6	Vortex_ICD_50		1	0.0023
MHF_IPEX_TYPE_D		0.7	Vortex_ICD_50		1.2	0.0025
MHF_IPEX_TYPE_D		0.8	Vortex_ICD_50		1.4	0.0027
MHF_IPEX_TYPE_D		0.9	Vortex_ICD_50		1.6	0.0029
MHF_IPEX_TYPE_D		1	Vortex_ICD_50		1.8	0.003
MHF_IPEX_TYPE_D		1.2	Vortex_ICD_50		2	0.0032
MHF_IPEX_TYPE_D		1.4	Vortex_ICD_50		2.5	0.0036
MHF_IPEX_TYPE_D		1.6	Vortex_ICD_50		3	0.0039
MHF_IPEX_TYPE_D		1.8				
MHF_IPEX_TYPE_D		2				
MHF_IPEX_TYPE_D		2.5				
MHF_IPEX_TYPE_D		3				
;Tempest Rating Curve for MHF IPEX TYPE E, No grate allowance			;Tempest Rating Curve for Vortex ICD 55, No grate allowance			
MHF_IPEX_TYPE_E	Rating	0	Vortex_ICD_55	Rating	0.1	0.0009
MHF_IPEX_TYPE_E		0.1	Vortex_ICD_55		0.2	0.0012
MHF_IPEX_TYPE_E		0.2	Vortex_ICD_55		0.3	0.0015
MHF_IPEX_TYPE_E		0.3	Vortex_ICD_55		0.4	0.0017
MHF_IPEX_TYPE_E		0.4	Vortex_ICD_55		0.5	0.0019
MHF_IPEX_TYPE_E		0.5	Vortex_ICD_55		0.6	0.0021
MHF_IPEX_TYPE_E		0.6	Vortex_ICD_55		0.7	0.0023
MHF_IPEX_TYPE_E		0.7	Vortex_ICD_55		0.8	0.0024
MHF_IPEX_TYPE_E		0.8	Vortex_ICD_55		0.9	0.0026
MHF_IPEX_TYPE_E		0.9	Vortex_ICD_55		1	0.0027
MHF_IPEX_TYPE_E		1	Vortex_ICD_55		1.2	0.003
MHF_IPEX_TYPE_E		1.2	Vortex_ICD_55		1.4	0.0032
MHF_IPEX_TYPE_E		1.4	Vortex_ICD_55		1.6	0.0034
MHF_IPEX_TYPE_E		1.6	Vortex_ICD_55		1.8	0.0036
MHF_IPEX_TYPE_E		1.8	Vortex_ICD_55		2	0.0038
MHF_IPEX_TYPE_E		2	Vortex_ICD_55		2.5	0.0043
MHF_IPEX_TYPE_E		2.5	Vortex_ICD_55		3	0.0047
MHF_IPEX_TYPE_E		3				
;Tempest Rating Curve for Vortex ICD 60, No grate allowance			;Tempest Rating Curve for Vortex ICD 65, No grate allowance			
O_Roof1	Rating	0	Vortex_ICD_60	Rating	0.1	0.0011
O_Roof1		0.001	Vortex_ICD_60		0.2	0.0015
O_Roof1		0.15	Vortex_ICD_60		0.3	0.0018
O_Roof2	Rating	0	Vortex_ICD_60		0.4	0.0021
O_Roof2		0.001	Vortex_ICD_60		0.5	0.0023
O_Roof2		0.15	Vortex_ICD_60		0.6	0.0025
O_St_L1	Rating	0	Vortex_ICD_60		0.7	0.0027
O_St_L1		0.001	Vortex_ICD_60		0.8	0.0029
O_St_L1		0.35	Vortex_ICD_60		0.9	0.0031
O_St_L2	Rating	0	Vortex_ICD_60		1	0.0032
O_St_L2		0.001	Vortex_ICD_60		1.2	0.0036
O_St_L2		0.35	Vortex_ICD_60		1.4	0.0038
O_St_L3	Rating	0	Vortex_ICD_60		1.6	0.0041
O_St_L3		0.001	Vortex_ICD_60		1.8	0.0043
O_St_L3		0.35	Vortex_ICD_60		2	0.0046
O_St_UnGrd	Rating	0	Vortex_ICD_60		2.5	0.0051
O_St_UnGrd		0.01	Vortex_ICD_60		3	0.0056
O_St_UnGrd		1				
;Tempest Rating Curve for Vortex ICD 100, No grate allowance			;Tempest Rating Curve for Vortex ICD 70, No grate allowance			
Vortex_ICD_100	Rating	0	Vortex_ICD_70	Rating	0	0
Vortex_ICD_100		0.1	Vortex_ICD_70		0.1	0.0013
Vortex_ICD_100		0.2	Vortex_ICD_70		0.2	0.0019
Vortex_ICD_100		0.3	Vortex_ICD_70		0.3	0.0023
Vortex_ICD_100		0.4	Vortex_ICD_70		0.4	0.0027
Vortex_ICD_100		0.5	Vortex_ICD_70		0.5	0.003
Vortex_ICD_100		0.6	Vortex_ICD_70		0.6	0.0033
Vortex_ICD_100		0.7	Vortex_ICD_70		0.7	0.0036
Vortex_ICD_100		0.8	Vortex_ICD_70		0.8	0.0038
Vortex_ICD_100		0.9	Vortex_ICD_70		0.9	0.004
Vortex_ICD_100		1	Vortex_ICD_70		1	0.0042
Vortex_ICD_100		1.2	Vortex_ICD_70		1.2	0.0044
Vortex_ICD_100		1.4	Vortex_ICD_70		1.4	0.0046
Vortex_ICD_100		1.6	Vortex_ICD_70		1.6	0.0048
Vortex_ICD_100		1.8	Vortex_ICD_70		1.8	0.005
Vortex_ICD_100		2	Vortex_ICD_70		2	0.0051
Vortex_ICD_100		2.5	Vortex_ICD_70		2.5	0.0057
Vortex_ICD_100		3	Vortex_ICD_70		3	0.0063
;Tempest Rating Curve for Vortex ICD 105, No grate allowance			;Tempest Rating Curve for Vortex ICD 75, No grate allowance			
Vortex_ICD_105	Rating	0.1	Vortex_ICD_75	Rating	0	0
Vortex_ICD_105		0.2	Vortex_ICD_75		0.1	0.0016
Vortex_ICD_105		0.3	Vortex_ICD_75		0.2	0.0022
Vortex_ICD_105		0.4	Vortex_ICD_75		0.3	0.0027
Vortex_ICD_105		0.5	Vortex_ICD_75		0.4	0.0032
Vortex_ICD_105		0.6	Vortex_ICD_75		0.5	0.0035
Vortex_ICD_105		0.7	Vortex_ICD_75		0.6	0.0039
Vortex_ICD_105		0.8	Vortex_ICD_75		0.7	0.0042
Vortex_ICD_105		0.9	Vortex_ICD_75		0.8	0.0045
Vortex_ICD_105		1	Vortex_ICD_75		0.9	0.0048
Vortex_ICD_105		1.2	Vortex_ICD_75		1	0.005
Vortex_ICD_105		1.4	Vortex_ICD_75		1.2	0.0055
Vortex_ICD_105		1.6	Vortex_ICD_75		1.4	0.0059
Vortex_ICD_105		1.8	Vortex_ICD_75		1.6	0.0063
Vortex_ICD_105		2	Vortex_ICD_75		1.8	0.0067
Vortex_ICD_105		2.5	Vortex_ICD_75		2	0.0071
Vortex_ICD_105		3	Vortex_ICD_75		2.5	0.0079
;Tempest Rating Curve for Vortex ICD 40, No grate allowance			;Tempest Rating Curve for Vortex ICD 80, No grate allowance			
Vortex_ICD_40	Rating	0	Vortex_ICD_80	Rating	0	0
Vortex_ICD_40		0.1	Vortex_ICD_80		0.1	0.0018
Vortex_ICD_40		0.2	Vortex_ICD_80		0.2	0.0026
Vortex_ICD_40		0.3	Vortex_ICD_80		0.3	0.0031
Vortex_ICD_40		0.4	Vortex_ICD_80		0.4	0.0036
Vortex_ICD_40		0.5	Vortex_ICD_80		0.5	0.004
Vortex_ICD_40		0.6	Vortex_ICD_80		0.6	0.0044
Vortex_ICD_40		0.7	Vortex_ICD_80		0.7	0.0048
Vortex_ICD_40		0.8	Vortex_ICD_80		0.8	0.0051
Vortex_ICD_40		0.9	Vortex_ICD_80		0.9	0.0054
Vortex_ICD_40		1	Vortex_ICD_80		1	0.0057
Vortex_ICD_40		1.2	Vortex_ICD_80		1.2	0.006
Vortex_ICD_40		1.4	Vortex_ICD_80		1.4	0.0068
Vortex_ICD_40		1.6	Vortex_ICD_80		1.6	0.0072
Vortex_ICD_40		1.8	Vortex_ICD_80		1.8	0.0077
Vortex_ICD_40		2	Vortex_ICD_80		2	0.0081
Vortex_ICD_40		2.5	Vortex_ICD_80		2.5	0.009
Vortex_ICD_40		3	Vortex_ICD_80		3	0.0099
;Tempest Rating Curve for Vortex ICD 45, No grate allowance			;Tempest Rating Curve for Vortex ICD 85, No grate allowance			
Vortex_ICD_45	Rating	0	Vortex_ICD_85	Rating	0	0
Vortex_ICD_45		0.1	Vortex_ICD_85		0.1	0.002
Vortex_ICD_45		0.2	Vortex_ICD_85		0.2	0.0029
Vortex_ICD_45		0.3	Vortex_ICD_85		0.3	0.0035
Vortex_ICD_45		0.4	Vortex_ICD_85		0.4	0.0041
Vortex_ICD_45		0.5	Vortex_ICD_85		0.5	0.0045
Vortex_ICD_45		0.6	Vortex_ICD_85		0.6	0.005
Vortex_ICD_45		0.7	Vortex_ICD_85		0.7	0.0054
Vortex_ICD_45		0.8	Vortex_ICD_85		0.8	0.0057
Vortex_ICD_45		0.9				
Vortex_ICD_45		1				
Vortex_ICD_45		1.2				
Vortex_ICD_45		1.4				
Vortex_ICD_45		1.6				
Vortex_ICD_45		1.8				
Vortex_ICD_45		2				
Vortex_ICD_45		2.5				
Vortex_ICD_45		3				
;Tempest Rating Curve for Vortex ICD 50, No grate allowance						

Vortex_ICD_85	0.9	0.0061
Vortex_ICD_85	1	0.0064
Vortex_ICD_85	1.2	0.007
Vortex_ICD_85	1.4	0.0076
Vortex_ICD_85	1.6	0.0081
Vortex_ICD_85	1.8	0.0086
Vortex_ICD_85	2	0.0091
Vortex_ICD_85	2.5	0.0101
Vortex_ICD_85	3	0.0111

;Tempest Rating Curve for Vortex ICD 90, No grate allowance

Vortex_ICD_90	Rating	0	0.0022
Vortex_ICD_90	0.1	0.0032	
Vortex_ICD_90	0.2	0.0039	
Vortex_ICD_90	0.3	0.0045	
Vortex_ICD_90	0.4	0.0051	
Vortex_ICD_90	0.5	0.0055	
Vortex_ICD_90	0.6	0.006	
Vortex_ICD_90	0.7	0.0064	
Vortex_ICD_90	0.8	0.0068	
Vortex_ICD_90	0.9	0.0072	
Vortex_ICD_90	1	0.0079	
Vortex_ICD_90	1.2	0.0085	
Vortex_ICD_90	1.4	0.0091	
Vortex_ICD_90	1.6	0.0096	
Vortex_ICD_90	1.8	0.0102	
Vortex_ICD_90	2	0.0114	
Vortex_ICD_90	2.5	0.0125	
Vortex_ICD_90	3	0.0138	

;Tempest Rating Curve for Vortex ICD 95, No grate allowance

Vortex_ICD_95	Rating	0	0.0026
Vortex_ICD_95	0.1	0.0036	
Vortex_ICD_95	0.2	0.0044	
Vortex_ICD_95	0.3	0.0051	
Vortex_ICD_95	0.4	0.0057	
Vortex_ICD_95	0.5	0.0062	
Vortex_ICD_95	0.6	0.0067	
Vortex_ICD_95	0.7	0.0071	
Vortex_ICD_95	0.8	0.0076	
Vortex_ICD_95	0.9	0.008	
Vortex_ICD_95	1	0.0087	
Vortex_ICD_95	1.2	0.0094	
Vortex_ICD_95	1.4	0.0101	
Vortex_ICD_95	1.6	0.0107	
Vortex_ICD_95	1.8	0.0113	
Vortex_ICD_95	2	0.0126	
Vortex_ICD_95	2.5	0.0138	
Vortex_ICD_95	3	0.0158	

;From Zurn Manual RD178

ZURN_Z150F-6NH	Rating	0	0
ZURN_Z150F-6NH	0.0127	0.00503838308477861	
ZURN_Z150F-6NH	0.0257	0.0132420013231177	
ZURN_Z150F-6NH	0.0384	0.0234992054543888	
ZURN_Z150F-6NH	0.0508	0.0357128365761305	
ZURN_Z150F-6NH	0.0765	0.042501972611045	
ZURN_Z150F-6NH	0.1024	0.0433196215564931	

CB120	Storage	0	0.36
CB120		0.3	338.53
CB121	Storage	0	0.36
CB121		0.3	292.64
CB122	Storage	0	0.073
CB122		1.45	0.073
CB122		1.7	74.71
CB123	Storage	0	0.36
CB123		2.182	0.36
CB124	Storage	0	0.073
CB124		1.58	0.073
CB124		1.78	34.68
CB125	Storage	0	0.36
CB125		1.65	0.36
CB125		1.95	37.3
CB125		2	37.3

[TIMESERIES]

;;Name	Date	Time	Value
;;-----			
;Rainfall (mm/hr)	01/01/2000	00:00:00	1.548
24SCS100	01/01/2000	00:15:00	1.548
24SCS100	01/01/2000	00:30:00	1.548
24SCS100	01/01/2000	00:45:00	1.548
24SCS100	01/01/2000	01:00:00	0.7224
24SCS100	01/01/2000	01:15:00	0.7224
24SCS100	01/01/2000	01:30:00	0.7224
24SCS100	01/01/2000	01:45:00	0.7224
24SCS100	01/01/2000	02:00:00	1.3416
24SCS100	01/01/2000	02:15:00	1.3416
24SCS100	01/01/2000	02:30:00	1.3416
24SCS100	01/01/2000	02:45:00	1.3416
24SCS100	01/01/2000	03:00:00	1.3416
24SCS100	01/01/2000	03:15:00	1.3416
24SCS100	01/01/2000	03:30:00	1.3416
24SCS100	01/01/2000	03:45:00	1.3416
24SCS100	01/01/2000	04:00:00	1.7544
24SCS100	01/01/2000	04:15:00	1.7544
24SCS100	01/01/2000	04:30:00	1.7544
24SCS100	01/01/2000	04:45:00	1.7544
24SCS100	01/01/2000	05:00:00	1.548
24SCS100	01/01/2000	05:15:00	1.548
24SCS100	01/01/2000	05:30:00	1.548
24SCS100	01/01/2000	05:45:00	1.548
24SCS100	01/01/2000	06:00:00	2.064
24SCS100	01/01/2000	06:15:00	2.064
24SCS100	01/01/2000	06:30:00	2.064
24SCS100	01/01/2000	06:45:00	2.064
24SCS100	01/01/2000	07:00:00	2.064
24SCS100	01/01/2000	07:15:00	2.064
24SCS100	01/01/2000	07:30:00	2.064
24SCS100	01/01/2000	07:45:00	2.064
24SCS100	01/01/2000	08:00:00	2.7864
24SCS100	01/01/2000	08:15:00	2.7864
24SCS100	01/01/2000	08:30:00	2.7864
24SCS100	01/01/2000	08:45:00	2.7864
24SCS100	01/01/2000	09:00:00	3.3024
24SCS100	01/01/2000	09:15:00	3.3024
24SCS100	01/01/2000	09:30:00	3.7152
24SCS100	01/01/2000	09:45:00	3.7152
24SCS100	01/01/2000	10:00:00	4.7472
24SCS100	01/01/2000	10:15:00	4.7472
24SCS100	01/01/2000	10:30:00	6.3984
24SCS100	01/01/2000	10:45:00	6.3984
24SCS100	01/01/2000	11:00:00	9.9072
24SCS100	01/01/2000	11:15:00	9.9072
24SCS100	01/01/2000	11:30:00	12.9312
24SCS100	01/01/2000	11:45:00	113.9328
24SCS100	01/01/2000	12:00:00	14.8608
24SCS100	01/01/2000	12:15:00	14.8608
24SCS100	01/01/2000	12:30:00	7.6368
24SCS100	01/01/2000	12:45:00	7.6368
24SCS100	01/01/2000	13:00:00	5.5728
24SCS100	01/01/2000	13:15:00	5.5728
24SCS100	01/01/2000	13:30:00	4.3344
24SCS100	01/01/2000	13:45:00	4.3344
24SCS100	01/01/2000	14:00:00	3.3024
24SCS100	01/01/2000	14:15:00	3.3024
24SCS100	01/01/2000	14:30:00	3.3024
24SCS100	01/01/2000	14:45:00	3.3024
24SCS100	01/01/2000	15:00:00	2.8896
24SCS100	01/01/2000	15:15:00	2.8896
24SCS100	01/01/2000	15:30:00	2.8896
24SCS100	01/01/2000	15:45:00	2.8896

24SCS100	01/01/2000	16:00:00	2.2704
24SCS100	01/01/2000	16:15:00	2.2704
24SCS100	01/01/2000	16:30:00	2.2704
24SCS100	01/01/2000	16:45:00	2.2704
24SCS100	01/01/2000	17:00:00	2.3736
24SCS100	01/01/2000	17:15:00	2.3736
24SCS100	01/01/2000	17:30:00	2.3736
24SCS100	01/01/2000	17:45:00	2.3736
24SCS100	01/01/2000	18:00:00	1.548
24SCS100	01/01/2000	18:15:00	1.548
24SCS100	01/01/2000	18:30:00	1.548
24SCS100	01/01/2000	18:45:00	1.548
24SCS100	01/01/2000	19:00:00	1.2384
24SCS100	01/01/2000	19:15:00	1.2384
24SCS100	01/01/2000	19:30:00	1.2384
24SCS100	01/01/2000	19:45:00	1.2384
24SCS100	01/01/2000	20:00:00	1.7544
24SCS100	01/01/2000	20:15:00	1.7544
24SCS100	01/01/2000	20:30:00	1.7544
24SCS100	01/01/2000	20:45:00	1.7544
24SCS100	01/01/2000	21:00:00	1.1352
24SCS100	01/01/2000	21:15:00	1.1352
24SCS100	01/01/2000	21:30:00	1.1352
24SCS100	01/01/2000	21:45:00	1.1352
24SCS100	01/01/2000	22:00:00	1.032
24SCS100	01/01/2000	22:15:00	1.032
24SCS100	01/01/2000	22:30:00	1.032
24SCS100	01/01/2000	22:45:00	1.032
24SCS100	01/01/2000	23:00:00	1.032
24SCS100	01/01/2000	23:15:00	1.032
24SCS100	01/01/2000	23:30:00	1.032
24SCS100	01/01/2000	23:45:00	1.032
24SCS100	01/02/2000	00:00:00	0

;Rainfall (mm/hr)

3CHI100	01/01/2000	00:00:00	5.339
3CHI100	01/01/2000	00:10:00	6.376
3CHI100	01/01/2000	00:20:00	7.977
3CHI100	01/01/2000	00:30:00	10.797
3CHI100	01/01/2000	00:40:00	17.136
3CHI100	01/01/2000	00:50:00	45.128
3CHI100	01/01/2000	01:00:00	178.107
3CHI100	01/01/2000	01:10:00	51.056
3CHI100	01/01/2000	01:20:00	26.163
3CHI100	01/01/2000	01:30:00	17.571
3CHI100	01/01/2000	01:40:00	13.277
3CHI100	01/01/2000	01:50:00	10.712
3CHI100	01/01/2000	02:00:00	9.008
3CHI100	01/01/2000	02:10:00	7.793
3CHI100	01/01/2000	02:20:00	6.883
3CHI100	01/01/2000	02:30:00	6.174
3CHI100	01/01/2000	02:40:00	5.607
3CHI100	01/01/2000	02:50:00	5.142
3CHI100	01/01/2000	03:00:00	0

;Sum of Infiltrated flow from above the garage slab calculated from Infiltration graphs for S6 multiplied by the total pervious area above the garage.

InfiltratedInflow	01/01/2000	00:01:00	0.0002955566
InfiltratedInflow	01/01/2000	00:02:00	0.0002955566
InfiltratedInflow	01/01/2000	00:03:00	0.0002955566
InfiltratedInflow	01/01/2000	00:04:00	0.0002955566
InfiltratedInflow	01/01/2000	00:05:00	0.0002955566
InfiltratedInflow	01/01/2000	00:06:00	0.0002955566
InfiltratedInflow	01/01/2000	00:07:00	0.0002955566
InfiltratedInflow	01/01/2000	00:08:00	0.0002955566
InfiltratedInflow	01/01/2000	00:09:00	0.0002955566
InfiltratedInflow	01/01/2000	00:10:00	0.0002955566
InfiltratedInflow	01/01/2000	00:11:00	0.0002955566

.....
Too many data points (1440 in total).

[REPORT]

;Reporting Options
INPUT YES
CONTROLS NO
SUBCATCHMENTS ALL
NODES ALL
LINKS ALL

[TAGS]

Node	St_UnGrd	Underground_Storage
------	----------	---------------------

[MAP]	DIMENSIONS	381503.2836	5032790.42705	381639.0324	5032880.16395
	UNITS	Meters			

[COORDINATES]

;;Node	X-Coord	Y-Coord
--------	---------	---------

MHS05	381512.619	5032853.746
OF2	381610.244	5032876.085
OF3	381513.952	5032857.477
OF4	381509.454	5032832.912
CB120	381549.093	5032844.875
CB121	381584.314	5032823.865
CB122	381627.208	5032806.966
CB123	381622.312	5032818.188
CB124	381612.986	5032839.563
CB125	381519.372	5032825.114
Roof1	381594.1	5032833.494
Roof2	381526.761	5032828.396
St_UnGrd	381520.468	5032851.542

[VERTICES]

;;Link	X-Coord	Y-Coord
--------	---------	---------

BLDG_F	381587.375	5032838.9
CB121	381580.382	5032829.221
CB121	381526.869	5032841.1
CB123	381583.496	5032831.297
CB123	381530.098	5032843.407

[POLYGONS]

;;Subcatchment	X-Coord	Y-Coord
----------------	---------	---------

S1	381585.63	5032868.962
S1	381545.732	5032851.464
S1	381549.853	5032863.759
S1	381561.389	5032872.018
S1	381568.12	5032873.68
S1	381571.213	5032866.739
S1	381575.491	5032868.703
S1	381584.113	5032870.421
S1	381585.63	5032868.962
S10	381577.07	5032828.

S3	381600.122	5032875.319	S6	381568.214	5032843.324
S4	381524.892	5032839.223	S6	381570.904	5032844.497
S4	381521.312	5032821.582	S6	381570.746	5032844.646
S4	381563.788	5032812.963	S6	381574.562	5032846.312
S4	381562.788	5032808.079	S7	381627.999	5032794.506
S4	381521.032	5032816.77	S7	381601.782	5032799.963
S4	381516.421	5032820.775	S7	381603.052	5032806.066
S4	381519.182	5032849.734	S7	381619.55	5032813.264
S4	381520.586	5032849.638	S7	381614.354	5032825.173
S4	381524.866	5032848.769	S7	381620.836	5032828.001
S4	381525.228	5032848.183	S7	381632.862	5032800.531
S4	381524.284	5032843.53	S7	381627.999	5032794.506
S4	381525.411	5032841.771	S8	381597.544	5032861.751
S4	381524.892	5032839.223	S8	381581.761	5032854.863
S5	381545.732	5032851.464	S8	381572.167	5032851.809
S5	381567.277	5032860.933	S8	381568.16	5032850.064
S5	381567.855	5032859.534	S8	381561.615	5032851.396
S5	381567.897	5032859.438	S8	381561.441	5032851.483
S5	381567.158	5032859.115	S8	381561.507	5032851.62
S5	381566.874	5032858.986	S8	381561.569	5032851.759
S5	381566.594	5032858.846	S8	381561.627	5032851.9
S5	381566.319	5032858.697	S8	381561.68	5032852.043
S5	381566.05	5032858.539	S8	381561.729	5032852.188
S5	381565.786	5032858.372	S8	381561.773	5032852.334
S5	381565.528	5032858.196	S8	381561.812	5032852.481
S5	381565.276	5032858.012	S8	381561.846	5032852.63
S5	381565.03	5032857.819	S8	381561.917	5032852.929
S5	381564.792	5032857.617	S8	381561.997	5032853.226
S5	381564.56	5032857.408	S8	381562.08	5032853.52
S5	381564.335	5032857.191	S8	381562.186	5032853.811
S5	381564.118	5032856.966	S8	381562.296	5032854.099
S5	381563.908	5032856.735	S8	381562.415	5032854.382
S5	381563.707	5032856.496	S8	381563.54	5032854.662
S5	381563.514	5032856.25	S8	381562.681	5032854.937
S5	381563.329	5032855.999	S8	381562.827	5032855.207
S5	381563.153	5032855.741	S8	381562.986	5032855.477
S5	381562.986	5032855.477	S8	381563.153	5032855.741
S5	381562.827	5032855.207	S8	381563.329	5032855.999
S5	381562.681	5032854.937	S8	381563.514	5032856.25
S5	381562.543	5032854.662	S8	381563.707	5032856.496
S5	381562.415	5032854.382	S8	381563.908	5032856.735
S5	381562.296	5032854.099	S8	381564.118	5032856.966
S5	381562.186	5032853.811	S8	381564.335	5032857.191
S5	381562.087	5032853.52	S8	381564.56	5032857.408
S5	381561.997	5032853.226	S8	381564.792	5032857.617
S5	381561.917	5032852.929	S8	381565.03	5032857.819
S5	381561.846	5032852.63	S8	381565.276	5032858.012
S5	381561.812	5032852.481	S8	381565.528	5032858.196
S5	381561.773	5032852.334	S8	381565.786	5032858.372
S5	381561.729	5032852.188	S8	381566.05	5032858.539
S5	381561.68	5032852.043	S8	381566.319	5032858.697
S5	381561.627	5032851.9	S8	381566.594	5032858.846
S5	381561.569	5032851.759	S8	381566.874	5032858.986
S5	381561.507	5032851.62	S8	381567.158	5032859.115
S5	381561.441	5032851.483	S8	381567.897	5032859.438
S5	381561.615	5032851.396	S8	381567.855	5032859.534
S5	381568.16	5032850.064	S8	381593.609	5032870.772
S5	381572.167	5032851.809	S8	381597.544	5032861.751
S5	381574.562	5032846.312	S9	381581.761	5032854.863
S5	381570.746	5032844.646	S9	381598.259	5032862.063
S5	381570.904	5032844.497	S9	381602.332	5032852.729
S5	381568.214	5032843.324	S9	381600.237	5032853.815
S5	381568.127	5032843.284	S9	381601.278	5032849.431
S5	381568.041	5032843.241	S9	381603.372	5032850.345
S5	381567.957	5032843.195	S9	381619.55	5032813.264
S5	381567.874	5032843.147	S9	381603.052	5032806.066
S5	381567.793	5032843.096	S9	381581.761	5032854.863
S5	381567.714	5032843.041			
S5	381567.637	5032842.985			
S5	381567.561	5032842.925			
S5	381567.488	5032842.863			
S5	381567.417	5032842.799			
S5	381567.348	5032842.732			
S5	381567.282	5032842.663			
S5	381567.218	5032842.591			
S5	381567.156	5032842.518			
S5	381567.097	5032842.442			
S5	381567.041	5032842.365			
S5	381566.987	5032842.285			
S5	381566.936	5032842.204			
S5	381566.888	5032842.121			
S5	381566.843	5032842.036			
S5	381566.8	5032841.95			
S5	381566.761	5032841.863			
S5	381566.725	5032841.774			
S5	381566.692	5032841.684			
S5	381566.661	5032841.593			
S5	381566.634	5032841.501			
S5	381566.611	5032841.408			
S5	381566.59	5032841.314			
S5	381565.348	5032835.196			
S5	381564.854	5032833.766			
S5	381564.337	5032831.218			
S5	381546.649	5032834.808			
S5	381537.422	5032836.68			
S5	381536.967	5032834.441			
S5	381534.419	5032834.958			
S5	381534.873	5032837.198			
S5	381524.892	5032839.223			
S5	381525.411	5032841.771			
S5	381524.284	5032843.53			
S5	381525.228	5032848.183			
S5	381524.866	5032848.769			
S5	381520.586	5032849.638			
S5	381519.182	5032849.734			
S5	381519.868	5032856.933			
S6	381545.732	5032851.464			
S6	381574.562	5032846.312			
S6	381574.562	5032846.312			
S6	381572.167	5032851.809			
S6	381581.761	5032854.864			
S6	381590.946	5032833.812			
S6	381603.052	5032806.066			
S6	381601.782	5032799.963			
S6	381562.788	5032808.079			
S6	381563.78	5032812.963			
S6	381573.49	5032810.992			
S6	381577.07	5032828.633			
S6	381564.337	5032831.218			
S6	381564.854	5032833.766			
S6	381565.348	5032835.196			
S6	381566.59	5032841.314			
S6	381566.611	5032841.408			
S6	381566.635	5032841.501			
S6	381566.662	5032841.593			
S6	381566.692	5032841.684			
S6	381566.725	5032841.774			
S6	381566.761	5032841.862			
S6	381566.801	5032841.95			
S6	381566.843	5032842.036			
S6	381566.888	5032842.121			
S6	381566.937	5032842.203			
S6	381566.988	5032842.285			
S6	381567.041	5032842.364			
S6	381567.098	5032842.442			
S6	381567.157	5032842.517			
S6	381567.218	5032842.591			
S6	381567.282	5032842.662			
S6	381567.349	5032842.732			
S6	381567.417	5032842.798			
S6	381567.488	5032842.863			
S6	381567.562	5032842.925			
S6	381567.637	5032842.984			
S6	381567.714	5032843.041			
S6	381567.793	5032843.095			
S6	381567.874	5032843.147			
S6	381567.957	5032843.195			
S6	381568.041	5032843.241			
S6	381568.127	5032843.284			

```

;;Storage Node X-Coord Y-Coord
;;
[SYMBOLS]
;;Gage X-Coord Y-Coord
;;

```

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.2 (Build 5.2.4)

Element Count

Number of rain gages 2
Number of subcatchments ... 10
Number of nodes 13
Number of links 9
Number of pollutants 0
Number of land uses 0

Raingage Summary

Name	Data Source	Data Type	Recording Interval
24SCS100	24SCS100	INTENSITY	15 min.
3CHI100	3CHI100	INTENSITY	10 min.

Subcatchment Summary

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
S1	0.03	38.60	14.29	1.5000	24SCS100	CB120
S10	0.10	18.00	100.00	1.0000	24SCS100	Roof2
S2	0.02	38.94	11.12	2.1000	24SCS100	CB124
S3	0.02	26.02	0.00	2.0000	24SCS100	OF2
S4	0.04	163.64	3.09	1.5000	24SCS100	CB125
S5	0.09	79.85	77.46	2.0000	24SCS100	CB120
S6	0.11	105.72	17.82	2.1000	24SCS100	CB121
S7	0.05	44.22	13.68	3.3000	24SCS100	CB122
S8	0.03	1.98	95.75	5.2000	24SCS100	St_UnGrd
S9	0.10	18.00	100.00	1.0000	24SCS100	Roof1

Node Summary

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
MH505	OUTFALL	78.00	0.00	0.0	
OF2	OUTFALL	0.00	0.00	0.0	
OF3	OUTFALL	78.88	0.00	0.0	
OF4	OUTFALL	78.88	0.00	0.0	
CB120	STORAGE	82.10	0.30	0.0	
CB121	STORAGE	82.28	0.30	0.0	
CB122	STORAGE	79.35	1.70	0.0	
CB123	STORAGE	79.17	2.18	0.0	
CB124	STORAGE	79.47	1.78	0.0	
CB125	STORAGE	80.20	2.00	0.0	
Roof1	STORAGE	88.85	0.15	0.0	
Roof2	STORAGE	88.85	0.15	0.0	
St_UnGrd	STORAGE	78.00	1.00	0.0	Yes

Link Summary

Name	From Node	To Node	Type	Length	%Slope
C1	CB124	CB123	CONDUIT	23.3	0.9862
C2	CB122	CB123	CONDUIT	12.2	0.9965
BLDG_E	Roof2	OF4	OUTLET		
BLDG_F	Roof1	OF3	OUTLET		
CB120	CB120	St_UnGrd	OUTLET		
CB121	CB121	St_UnGrd	OUTLET		
CB123	CB123	St_UnGrd	OUTLET		
CB125	CB125	St_UnGrd	OUTLET		
OL1	St_UnGrd	MH505	OUTLET		

Cross Section Summary

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	CIRCULAR	0.25	0.05	0.06	0.25	1	0.06
C2	CIRCULAR	0.25	0.05	0.06	0.25	1	0.06

Analysis Options

Flow Units CMS
Process Models:
Rainfall/Runoff YES
RDI NO
Snowmelt NO
Groundwater NO
Flow Routing YES
Ponding Allowed NO
Water Quality NO
Infiltration Method HORTON
Flow Routing Method DYNWAVE
Surcharge Method EXTRAN
Starting Date 01/01/2000 00:00:00
Ending Date 01/02/2000 00:00:00
Antecedent Dry Days 0.0
Report Time Step 00:01:00
Wet Time Step 00:05:00
Dry Time Step 00:05:00
Routing Time Step 5.00 sec
Variable Time Step YES
Maximum Trials 8
Number of Threads 1
Head Tolerance 0.001500 m

Runoff Quantity Continuity

	Volume hectare-m	Depth mm
Total Precipitation	0.061	103.200
Evaporation Loss	0.000	0.000
Infiltration Loss	0.021	35.664
Surface Runoff	0.039	66.953
Final Storage	0.001	1.025
Continuity Error (%)	-0.429	

Flow Routing Continuity

	Volume 10 ⁶ ltr	Volume 10 ⁶ ltr
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.039	0.394
Groundwater Inflow	0.000	0.000
RDI Inflow	0.000	0.000
External Inflow	0.005	0.053
External Outflow	0.045	0.446
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.000	0.000
Continuity Error (%)	0.007	

Time-Step Critical Element

None

Highest Flow Instability Indexes

All links are stable.

Most Frequent Nonconverging Nodes

Convergence obtained at all time steps.

Routing Time Step Summary

Minimum Time Step	: 2.43 sec
Average Time Step	: 5.00 sec
Maximum Time Step	: 5.00 sec
% of Time in Steady State	: 0.00
Average Iterations per Step	: 2.00
% of Steps Not Converging	: 0.00
Time Step Frequencies	:
5.000 - 3.155 sec	: 99.99 %
3.155 - 1.991 sec	: 0.01 %
1.991 - 1.256 sec	: 0.00 %
1.256 - 0.792 sec	: 0.00 %
0.792 - 0.500 sec	: 0.00 %

Subcatchment Runoff Summary

Subcatchment	Runoff mm	Peak Runoff CMS	Total Runoff Precip Coeff	Total Runon mm	Total Evap mm	Total Infil mm	Imperv Runoff mm	Perv Runoff mm
S1	0.01	0.01	103.20	0.00	0.00	72.73	14.52	30.78
S10	0.01	0.01	103.20	0.00	0.00	0.00	101.69	0.00
S2	0.10	0.03	0.985	0.00	0.00	73.02	11.31	30.59
S3	0.01	0.01	0.296	0.00	0.00	75.55	0.00	28.27
S4	0.01	0.01	0.274	0.00	0.00	74.38	3.14	29.39
S5	0.01	0.01	0.285	0.00	0.00	16.90	78.72	6.51
S6	0.08	0.03	0.826	0.00	0.00	62.17	18.10	23.14
S7	0.05	0.03	0.400	0.00	0.00	72.76	13.90	30.77
S8	0.02	0.01	0.298	0.00	0.00	13.14	97.36	88.32
S9	0.03	0.01	0.856	0.00	0.00	101.69	0.00	0.00
St_UnGrd	0.10	0.03	0.985	0.00	0.00	0.00	0.00	0.00

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
MH505	OUTFALL	0.00	0.00	78.00	0 00:00	0.00
OF2	OUTFALL	0.00	0.00	0.00	0 00:00	0.00
OF3	OUTFALL	0.00	0.00	78.88	0 00:00	0.00
OF4	OUTFALL	0.00	0.00	78.88	0 00:00	0.00
CB120	STORAGE	0.00	0.05	82.15	0 12:00	0.05
CB121	STORAGE	0.00	0.05	82.33	0 12:00	0.05
CB122	STORAGE	0.05	1.62	80.97	0 12:06	1.62
CB123	STORAGE	0.06	1.81	80.97	0 12:05	1.81
CB124	STORAGE	0.05	1.51	80.98	0 12:05	1.50
CB125	STORAGE	0.04	1.86	82.06	0 12:02	1.86
Roof1	STORAGE	0.02	0.06	88.91	0 13:00	0.06
Roof2	STORAGE	0.02	0.06	88.91	0 13:00	0.06
St_UnGrd	STORAGE	0.01	0.78	78.78	0 12:05	0.78

Node Inflow Summary

Flow	Maximum Inflow CMS	Maximum Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow 10 ⁶ ltr	Total Inflow 10 ⁶ ltr
Balance					
Error					
Node Percent	Type				
MH505	OUTFALL	0.000	0.041	0 11:47	0 0.247
OF2	OUTFALL	0.006	0.006	0 12:00	0 0.00574
OF3	OUTFALL	0.000	0.002	0 11:07	0 0.0967
OF4	OUTFALL	0.000	0.002	0 11:07	0 0.0968
CB120	STORAGE	0.036	0.036	0 12:00	0 0.0853
CB121	STORAGE	0.032	0.032	0 12:00	0 0.0468
CB122	STORAGE	0.014	0.015	0 11:58	0 0.0151
CB123	STORAGE	0.000	0.012	0 11:56	0 0.022
CB124	STORAGE	0.006	0.007	0 11:50	0 0.00667
CB125	STORAGE	0.011	0.011	0 12:00	0 0.0114
Roof1	STORAGE	0.030	0.030	0 12:00	0 0.0968
Roof2	STORAGE	0.030	0.030	0 12:00	0 0.0969
St_UnGrd	STORAGE	0.013	0.092	0 12:00	0 0.0815

Node Surcharge Summary

No nodes were surcharged.

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

Maximum Outflow Storage Unit CMS	Average Volume 1000 m ³	Avg Pcnt Full	Evap Loss	Exfil Loss	Maximum Volume 1000 m ³	Max Pcnt Full	Time of Max Occurrence days hr:min
CB120	0.000	0.0	0.0	0.0	0.002	3.0	0 12:00
0.036							
CB121	0.000	0.0	0.0	0.0	0.001	2.5	0 12:00
0.032							
CB122	0.000	0.7	0.0	0.0	0.005	49.0	0 12:06
0.010							
CB123	0.000	3.0	0.0	0.0	0.001	82.8	0 12:05
0.007							
CB124	0.000	0.1	0.0	0.0	0.000	3.1	0 12:05
0.007							
CB125	0.000	0.4	0.0	0.0	0.003	40.7	0 12:02
0.006							
Roof1	0.010	10.0	0.0	0.0	0.039	41.2	0 13:00
0.002							
Roof2	0.010	10.0	0.0	0.0	0.039	41.2	0 13:00
0.002							
St_UnGrd	0.001	1.5	0.0	0.0	0.038	78.1	0 12:05
0.041							

Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow CMS	Max Flow CMS	Total Volume 10 ⁶ ltr
MH505	99.92	0.003	0.041	0.247
OF2	3.97	0.002	0.006	0.006
OF3	94.75	0.001	0.002	0.097
OF4	94.75	0.001	0.002	0.097
System	73.35	0.007	0.051	0.446

Link Flow Summary

Link	Type	Maximum Flow CMS	Time of Max Occurrence days hr:min	Maximum Veloc m/sec	Max/ Full Flow	Max/ Full Depth
C1	CONDUIT	0.007	0 11:57	0.39	0.12	1.00
C2	CONDUIT	0.010	0 11:55	0.48	0.17	1.00
BLDG_E	DUMMY	0.002	0 11:07			
BLDG_F	DUMMY	0.002	0 11:07			
CB120	DUMMY	0.036	0 12:00			
CB121	DUMMY	0.032	0 12:00			
CB123	DUMMY	0.006	0 12:05			
CB125	DUMMY	0.006	0 12:02			
OL1	DUMMY	0.041	0 11:47			

Flow Classification Summary

Conduit	Adjusted /Actual Length	Fraction of Time in Flow Class								
		Dry	Up Dry	Down Dry	Sub Crit	Sup Crit	Up Crit	Down Crit	Norm Ltd	Inlet Ctrl
C1	1.00	0.48	0.00	0.00	0.06	0.00	0.00	0.46	0.01	0.00
C2	1.00	0.48	0.00	0.00	0.06	0.00	0.00	0.46	0.01	0.00

Conduit Surcharge Summary

Conduit	Hours Full			Hours Above Full Normal Flow	Hours Capacity Limited
	Both Ends	Upstream	Dnstream		
C1	0.97	0.97	1.16	0.01	0.01
C2	1.05	1.05	1.17	0.01	0.01

Analysis begun on: Thu Sep 26 08:32:10 2024
Analysis ended on: Thu Sep 26 08:32:10 2024
Total elapsed time: < 1 sec

Engineering Specification

Job Name _____
 Job Location _____
 Engineer _____
 Approval _____
 Tag _____

Contractor _____
 Approval _____
 Contractor's P.O. No. _____
 Representative _____

RD-200 Small Area Roof Drain Specification


Watts RD-200 epoxy coated cast iron roof drain with flashing clamp with integral gravel stop, self-locking polyethylene dome (standard), and no hub (standard) outlet.

Pipe Sizing	
Suffix	Description
2	2"(51) Pipe Size <input type="checkbox"/>
3	3"(76) Pipe Size <input type="checkbox"/>
4	4"(102) Pipe Size (NH Only) <input type="checkbox"/>

Outlet Type	
Suffix	Description
NH	No Hub (MJ) <input type="checkbox"/>
P	Push On <input type="checkbox"/>
T	Threaded <input type="checkbox"/>
X	Inside Caulk <input type="checkbox"/>

Options	
Suffix	Description
-13	Galvanized Body & Flashing Clamp <input type="checkbox"/>
-B	Sump Receiver <input type="checkbox"/>
-D	Underdeck Clamp <input type="checkbox"/>
-F	Deck Flange/Adj. Extension <input type="checkbox"/>
-GSS	Stainless Steel Ballast Guard <input type="checkbox"/>
-K	Ductile Iron Dome <input type="checkbox"/>
-K13	Galvanized Dome <input type="checkbox"/>
-K80	Aluminum Dome <input type="checkbox"/>
-K81	Rough Bronze Dome <input type="checkbox"/>
-K83	SS Mesh Covered Dome <input type="checkbox"/>
-L	Vandal Proof Dome <input type="checkbox"/>
-R	2" External Water Dam <input type="checkbox"/>
-SO	Side Outlet <input type="checkbox"/>
-W	Adjustable Internal Water Dam <input type="checkbox"/>

Optional Body Material	
Suffix	Description
-60	PVC Body w/Socket Outlet <input type="checkbox"/>
-61	ABS Body w/Socket Outlet <input type="checkbox"/>

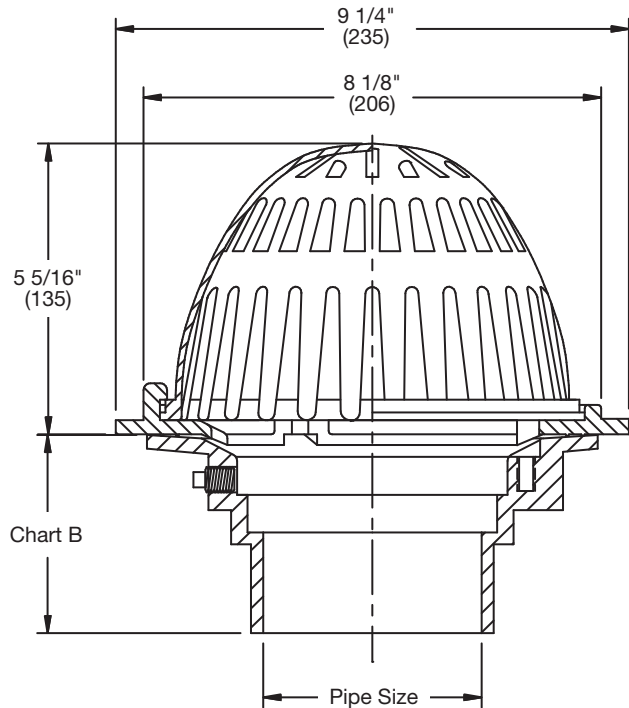

**Deck Opening 6 1/2"(165)
with Sump Receiver 8"(203)**

**Free Area
Sq. In.
35**

	Std.	P	T	X	60/61
Pipe Size	No Hub	Push On	Female Thread	Inside Caulk	PVC/ABS
2"(51)	3 5/8"(92)	4 1/4"(108)	4 1/4"(108)	4 1/2"(108)	4"(102)
3"(76)	3 5/8"(92)	4 1/4"(108)	4 1/4"(108)	4 1/2"(108)	4"(102)
4"(102)	3 5/8"(92)	4 1/4"(108)	4 1/4"(108)	4 1/2"(108)	4"(102)

NOTICE
 The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.



USA: T: (800) 338-2581 • F: (828) 248-3929 • Watts.com
Canada: T: (888) 208-8927 • F: (905) 481-2316 • Watts.ca
Latin America: T: (52) 55-4122-0138 • Watts.com



Adjustable Accutrol Weir
 Tag: _____

**Adjustable Flow Control
 for Roof Drains**



ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.
 Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
 [5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

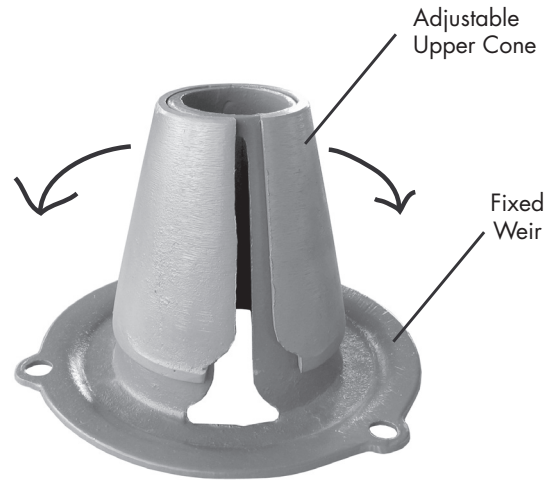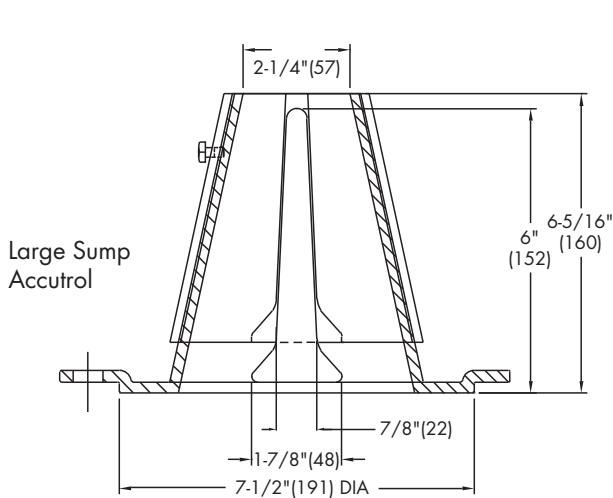

1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____
 Job Location _____
 Engineer _____

Contractor _____
 Contractor's P.O. No. _____
 Representative _____

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com
Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca
Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com






Z150F

FLOFORCE™ HIGH PERFORMANCE PROMENADE DECK DRAIN WITH ROTATABLE FRAME AND HEEL-PROOF GRATE

SPECIFICATION SHEET

TAG _____

Design and Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

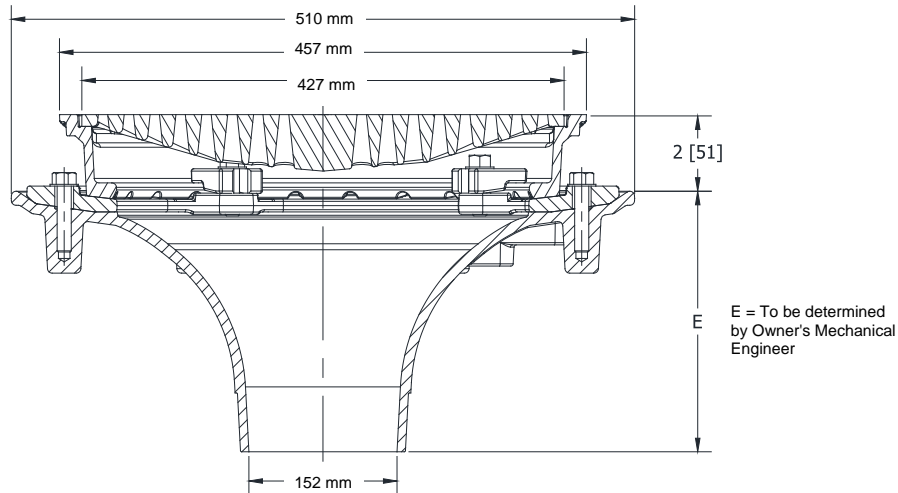

4 [102] No-Hub Illustrated

A Outlet Size In. [mm]	B Body Diameter In [mm]	C Frame Size In [mm]	D Grate Size In [mm]	Weight lbs [kg]	Grate Open Area Sq. In. [cm ²]
2,3,4 [51,76,102]	16-9/16 [421]	14 [356]	12-13/16 [325]	66 [30]	44 [284]
6,8 [152, 203]	20-3/32 [510]	18 [457]	16-13/16 [427]	94 [43]	70 [452]

ENGINEERING SPECIFICATION: ZURN Z150F

FLOFORCE™ High efficient flow performing roof drain for promenade deck roof drain applications. Drain incorporates a smooth funnel-shaped interior surface, providing a seamless transition to outlet connection and eliminating internal obstructions within the body. Complete with Dura-Coated cast iron body with membrane flashing clamp, rotatable square promenade frame, seepage openings, securing clamps, and heavy-duty ductile iron heel-proof grate.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

(Specify size/type) **OUTLET**

E BODY HT. DIM.

2, 3, 4 [51, 76, 102]	NH	No-Hub	6-15/16 [176]
6, 8 [152, 203]	NH	No-Hub	7-7/16 [189]
2, 3, 4 [51, 76, 102]	NL	Neo-Loc	7-3/8 [187]
6 [152]	NL	Neo-Loc	8-1/32 [204]
2, 3, 4 [51, 76, 102]	IP	Threaded	5-15/16, 6-3/16, 6-5/16 [151, 157, 160]
6, 8 [152, 203]	IP	Threaded	6-11/16, 6-3/4 [170, 171]
3, 4 [76, 102]	IC	Inside Caulk	5-13/16 [148]
6 [152]	IC	Inside Caulk	6-1/16 [154]

PREFIXES

___ Z	D.C.C.I. Body and Frame with Ductile Iron Grate*
___ ZN	D.C.C.I. Body and Frame with Ductile Iron Grate and Polished Nickel Bronze Veneer Finish

SUFFIXES

___ -AR	Acid Resistant Epoxy Coated	___ -R	Roof Sump Receiver
___ -C	Underdeck Clamp	___ -SC	Secondary Clamp Collar
___ -DP	Top-Set® Deck Plate (Replaces both the -C and -R)	___ -TC	Neo-Loc Test Cap Gasket (2, 3, 4 [51, 76, 102] NL Bottom Outlet Only)
___ -DR	Top-Set® Drain Riser	___ -VP	Vandal-Proof Secured Top
___ -E	Static Extension 1 [25] thru 4 [102] (Specify Ht.)	___ -Y	Type 304 [CF8] SS Sediment Bucket
___ -EA	Adjustable Extension Assembly 2-1/8 [54] thru 3-1/2 [89]	___ -85	Type 304 [CF8] Stainless Steel Perforated Extension
___ -G	Galvanized Cast Iron	___ -89	2 [51] High Overflow Dam and Low-Profile Pedestal Paver Dome
___ -PD	Low-Profile Pedestal Paver Dome		

* Regularly furnished unless otherwise specified

⚠ WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov

⚠ ADVERTENCIA: Cáncer y daño reproductivo - www.P65Warnings.ca.gov

⚠ AVERTISSEMENT: Cancer et effets néfastes sur la reproduction - www.P65Warnings.ca.gov

Zurn Industries, LLC | Specification Drainage Operation
1801 Pittsburgh Avenue, Erie, PA 16502, Ph. 855.663.9876

In Canada | Zurn Industries Limited
7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, Ph. 877.892.5216

www.zurn.com

Rev. -
Date: 08/08/2022
C.N. No. 144780
Prod. | Dwg. No. Z150F FLOFORCE™ Page 1 of 1

Site Servicing Report

2983, 3053 and 3079 Navan Road & 2690 Pagé Road, Ottawa, Ontario

Appendix E

Sanitary Servicing

JLR NO. 29899-003 (NAVAN BLOCK 17)																																				
Street Name	Pipe Reach		Multiples	Apartments	Cum. Pop.	Peaking Factor	Residential Flow (L/s)	Commercial/Institutional			Infiltration			Peak Design Flow L/s	Pipe Data							Upstream Geometry				Downstream Geometry				Self Cleansing Velocities						
	From	To						Cum. Area (ha)	Peaking Factor	Inst. Flow (L/s)	Plug Flow (L/s)	Cum. Area (ha)	Peak Extr. Flow L/s		Dia	Type	Actual Diameter	Slope	Q Full (L/s)	V Full	Length	Residual Capacity	% Full	TG From	Obvert	Invert	Cover	TG TO	Drop	Obvert	Invert	Cover	Q/QF Ratio	Flow Depth (mm)	Actual Velocity (m/s)	Flow Depth to Dia. Ratio (d/D)
EAST ORLEANS RIDGE SUBDIVISION	UPSTREAM	03	59	226	567	3.36	6.17	0.96	1.50	0.46	3.60	4.46	1.47	11.70	200	Circular	203.20	0.36%	20.39	0.63	22.7	8.69	57%	82.50	80.22	80.02	2.27	82.49	0.40	80.14	79.94	2.31	0.57	110.34	0.65	0.54
BLOCK 17	BLOCK 17	04		96	173	3.54	1.98	0.00	1.50	0.00	0.00	0.55	0.18	2.16	200	Circular	203.20	1.50%	41.91	1.29	11.6	39.74	5%	82.88	80.35	80.15	2.53	82.34	0.06	80.18	79.98	2.16	0.05	31.29	0.68	0.15
BLOCK 17	04	03			173	3.54	1.98	0.00	1.50	0.00	0.00	0.55	0.18	2.16	200	Circular	203.20	1.50%	41.91	1.29	21.5	39.74	5%	82.34	80.12	79.92	2.22	82.49	0.06	79.80	79.59	2.69	0.05	31.29	0.68	0.15
EAST ORLEANS RIDGE SUBDIVISION	03	02			740	3.30	7.92	0.96	1.50	0.46	3.60	5.08	1.68	13.66	200	Circular	203.20	0.33%	19.75	0.61	57.9	6.09	69%	82.49	79.74	79.53	2.72	81.83	0.07	79.54	79.34	2.29	0.69	124.16	0.66	0.61

Design Parameters		
Apartments Population	1.8	Cap/Unit
Multiples (Townhouse) Population	2.7	Cap/Unit
Residential Flows	280	L/Cap/Day
Infiltration Flows	0.33	L/s/ha
Harmon's Correction Factor	0.8	unitless
Commercial Peak Factor	1.5	unitless
Institutional/Commercial Average Flow	28000	L/gross ha/d
Manning Coefficient	0.013	unitless

Notes	
Existing	Details from Existing Sewers can be found within East Orleans Ridge Subdivision Design Sheet. This information was used to verify capacities in the existing sewers.

William Rugamba

From: William Rugamba
Sent: July 22, 2024 8:18 AM
To: William Rugamba
Subject: FW: Re-confirmation of Mechanical Items for Servicing Report

William Rugamba, M.Eng., B.A.Sc., EIT
Civil Engineering Graduate
Ottawa, ON
Work: [343-804-4374](tel:343-804-4374)

From: Sarith Lopez <slopez@qmeengineering.com>
Sent: Wednesday, July 17, 2024 8:07 PM
To: Mahad Musse <mmusse@jlrichards.ca>; Chuck Clark <CWC@qmeengineering.com>
Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>
Subject: RE: Re-confirmation of Mechanical Items for Servicing Report

[CAUTION] This email originated from outside JLR. Do not click links or open attachments unless you recognize the sender and know the content is safe. Do not forward suspicious emails, if you are unsure, please send a separate message to Helpdesk.

Hi Mahad,

All items below confirmed

Regards

Sarith López
Project Manager

9 Gurdwara Road, Unit 200
Ottawa, ON K2E 7X6
T: 613-366-4763 ext. 129
slopez@qmeengineering.com



From: Mahad Musse <mmusse@jlrichards.ca>

Sent: Tuesday, July 16, 2024 3:08 PM

To: Sarith Lopez <slopez@qmeengineering.com>; Chuck Clark <CWC@qmeengineering.com>

Cc: Karla Ferrey <kferrey@jlrichards.ca>; Raad Akrawi <rakrawi@groupeheafey.com>; Carmine Zayoun <carmine@zayoungroup.com>

Subject: Re-confirmation of Mechanical Items for Servicing Report

Hi Sarith/Chuck,

Thank you for the information below and in our meetings. I understand all these items have been discussed before but we need to submit something as part of our report. Can you just re-confirm the following questions below and then we will attach your confirmation to the Report.

1. Please confirm that the sanitary service size of 200mm diameter for the Site Plan Blocks (Block 14, 15 and 17) is preferred by the mechanical engineer on file;
2. Please confirm that a sprinkler flow of 25 L/s can be assumed for the Site Plan Blocks (Block 14, 15 and 17) at this stage.

Thanks
Mahad



Mahad Musse, B.Eng., EIT
Civil Engineering Graduate

1000-343 Preston Street
Ottawa, ON, K1S 1N4



Work: [343-633-1501](tel:343-633-1501)
mmusse@jlrichards.ca





Platinum
member

www.jlrichards.ca

Ottawa

343 Preston Street
Tower II, Suite 1000
Ottawa ON Canada
K1S 1N4
Tel: 613 728-3571
ottawa@jlrichards.ca

Kingston

203-863 Princess Street
Kingston ON Canada
K7L 5N4
Tel: 613 544-1424
kingston@jlrichards.ca

Sudbury

314 Countryside Drive
Sudbury ON Canada
P3E 6G2
Tel: 705 522-8174
sudbury@jlrichards.ca

Timmins

834 Mountjoy Street S
Timmins ON Canada
P4N 7C5
Tel: 705 360-1899
timmins@jlrichards.ca

North Bay

501-555 Oak Street E
North Bay ON Canada
P1B 8E3
Tel: 705 495-7597

northbay@jlrichards.ca

Hawkesbury

326 Bertha Street
Hawkesbury ON Canada
K6A 2A8
Tel: 613 632-0287

hawkesbury@jlrichards.ca

Guelph

107-450 Speedvale Ave. West
Guelph ON Canada
N1H 7Y6
Tel: 519 763-0713

guelph@jlrichards.ca

