



August 14, 2024 (Revision 04: November 12, 2024)

Our File Ref.: 01348

MacEwen Petroleum Inc.  
18 Adelaide Street, P.O. Box 100  
Maxville, Ontario K0C 1T0

Attention: Roch Lortie,

Subject: Hydrogeological Assessment & Terrain Analysis - Proposed Fuel Dispensing  
Facility Re-development  
5546 Albion Road South, Ottawa (Gloucester), Ontario

Dear Mr. Lortie,

LRL Engineering (LRL) was retained by MacEwen Petroleum Inc. (MPI) to complete a Hydrogeological Assessment & Terrain Analysis for the property located at 5546 Albion Road in Ottawa (Gloucester), Ontario as part of a proposed site re-development and associated Site Plan Application submission to the City of Ottawa. It is anticipated that the existing fuel dispensing facility will be re-developed to include new fuel storage and dispensing equipment, and convenience store serviced by a private water supply well and sewage disposal system.

The assessment was carried out to determine if the existing supply well can adequately and safely supply the proposed development with potable water according to the Ontario Drinking Water Standards (ODWS) and *Procedure D-5-5 Technical Guideline for Private Wells: Water Supply Assessment (August 1996)*; and that the proposed development can be serviced with a private septic system. The assessment was also intended to confirm that the construction of the supply well, and proposed construction activities, will be such as to minimize impairment to the regional aquifer, local Well Protection Area, and that it meets the current Ontario Regulation 903 requirements.

The assessment was conducted according to Ontario Ministry of the Environment, Conservation and Parks (MECP) "Hydrogeological Technical Information Requirements for Land Development Applications" (April 1995), which include the following guidelines and procedures:

- Guideline D-5 Planning for Sewage and Water Services (August 1996);
- Procedure D-5-4 Technical Guideline for Individual On-site Sewage Systems: Water Quality Impact Risk Assessment (August 1996); and
- Procedure D-5-5 Technical Guideline for Private Wells: Water Supply Assessment (August 1996).

Furthermore, the assessment was completed in accordance with the City of Ottawa's Hydrogeological and Terrain Analysis Guidelines (March 2021).

The assessment involved a desktop review of available information on the geology and hydrogeology of the site and adjacent lands, in addition to in-situ activities and testing. Based on our review of available information, it is determined that the proposed development can be supplied with a sufficient quantity and quality of potable water, and that the site conditions are suitable for an on-site sewage disposal system.

## 1 SCOPE OF INVESTIGATION

LRL was retained by MacEwen Petroleum Inc. (MPI) to complete a Hydrogeological Assessment & Terrain Analysis for the property located at 5546 Albion Road in Ottawa (Gloucester), Ontario as part of a proposed site re-development and associated Site Plan Application submission to the City of Ottawa. It is anticipated that the existing fuel dispensing facility will be re-developed to include new fuel storage and dispensing equipment, and convenience store serviced by a private water supply well and sewage disposal system. Further details pertaining to the anticipated development are included in Section 3.

LRLs scope for this investigation was in general accordance with current applicable provincial guidelines, in addition to the City of Ottawa, Hydrogeological and Terrain Analysis Guideline, dated March 2021. Prior to the initiation of the scope of this investigation, a virtual meeting was held with the City of Ottawa's Hydrogeologist to review the project, discuss the Wellhead Protection Area identified across the site (discussed in greater detail in Section 2), and how this can be addressed through the pumping test of the supply well. LRLs scope for this Hydrogeological Assessment & Terrain Analysis was generally as follows:

- Conduct a search of available well information for neighbouring properties through the MECP water well records database;
- Perform a desk top review of available geological maps and local well records to obtain information pertaining to the quantity supply aquifer of the subject site;
- Conduct one (1) – six (6) hour pumping test on the existing supply well by using a submersible pump, lowered above the existing installation components, and generator.
  - As discussed with the City, and agreed upon by the client, as not to disrupt site operations, the pumping test was completed during over-night hours when the facility was closed. The pumping rate was increased throughout the shorter duration of the test (6-hours rather than the typical 8-hours recognized for a commercial establishment) to account for comparable demand volumes;
  - Manual water levels were collected from the supply well during the pumping test to analyse the hydrogeological characteristics of the aquifer onsite. A datalogger meter was also lowered in the supply well to further collect measurements of groundwater fluctuation;
  - Collect and submit water samples from the supply well periodically during the pumping test, 3-hours and 6-hours of pumping, for laboratory analysis under the subdivision package, and volatile organic compounds; and
  - Following the pumping test, record water levels for up to 24 hours or until 95% recovery has occurred.
- In conjunction with additional sub-surface investigation fieldwork, in support of the proposed development application, advance boreholes across the property to characterize the site's hydrogeological conditions as part of the Terrain Analysis study;



- Submit select soil samples collected from the various subsurface materials for grain size analysis;
- Using piezometers/monitoring wells installed as part of additional sub-surface investigation fieldwork, in support of the proposed development application, collect groundwater measurements to aid in characterizing the shallow groundwater aquifer;
- Compare the laboratory analysis results, from the supply well, to the applicable Ontario Drinking Water Standard (ODWS) and MECP D-5-5 Treatability Limits;
- Prepare a summary regarding the quality and the quantity of the supply aquifer and comparison to D-5-5 compliance requirements set forth by the City of Ottawa Technical Authority. Summarize the findings to confirm that the lot size and soil conditions are suitable to attenuate the impacts of the septic system effluent; and
- Provide recommendations on the construction of the septic system based on the information retrieved.

## 2 SITE AND AREA DESCRIPTION

The subject site (5546 Albion Road, herein referred to as the 'Site') is located within a generally rural residential and commercial area of Ottawa, at the northwest corner of the intersection of Albion Road, and Mitch Owens Road. The location of the Site is presented in **Figure 1**. The property is legally described as Part of Lot 30, Concession 3 (Rideau Front), Geographic Township of Gloucester, City of Ottawa with Zoning - Rural Commercial 2 (RC2). It is understood that the proposed development will not require a zoning amendment or zoning change.

The Site is irregular shaped being generally rectangular with a portion of the southeastern extent being reduced. The Site is between approximately 85 and 110 m wide (east-west) by between 90 and 115 m deep (north-south) for an approximate surface area of 11 920 m<sup>2</sup>. The dimensions of the Site, and general configuration, are presented in **Figure 2**. For the purpose of this report, Albion Road will be inferred as running in a north-south direction.

### 2.1 Topography

The topography of the Site and neighbouring lands is generally flat. The subject Site and the neighbouring lands have a common topographic elevation of approximately 100 m above mean sea level (amsl) according to The Atlas of Canada - Toporama. More specifically, the Site has a slight slope to the south, towards Mitch Owens Road. Elevations along the southern extent of the site range between 103.7 and 102.5 m amsl according to the Annis, O'Sullivan, Vollebekk Ltd. Topographic Survey plan, dated April 18, 2022, and included in **Attachment A**.

According to The Atlas of Canada – Toporama, the regional groundwater flow direction is to the northwest towards the Rideau River, located approximately 8.5 km to the west of the Site.

### 2.2 Existing Development Features

The Site is presently developed and operated as a retail petroleum dispensing facility equipped with the following equipment:

- Six (6) gasoline dispensing pumps;
- One (1) diesel dispensing pump, and
- Five (5) underground storage tank located at the general southeastern portion of the Site.

No further details pertaining to the size, capacity or construction details of the storage tanks are available at this time. The fuel dispensing pumps are set over a concrete apron with an over-head canopy. A single-story convenience store is located at the approximate central portion of the Site

with pavement structure associated with parking and circulation across the central and general eastern portions of the Site. The western and northern portions of the Site is manicured grass with trees. The Site is serviced with a private sewage disposal system located at the northern portion of the property, and a supply well located at the east-central extent of the Site. Further details pertaining to the supply well on the Site is presented in Section 5.1.

### 2.3 Aerial Imagery

Aerial imagery was access through the City of Ottawa's on-line interactive mapping portal, geoOttawa. The available historical imagery for the Site dates back to the mid 1970's (1976) when the Site and neighbouring lands to the north, west and south following Mitch Owens Road appear undeveloped. East of the subject Site, following Albion Road, is developed with what can be assumed as commercial, or light industrial type facility with large buildings/structures present and significant cleared inferred parking and circulation area.

The subsequent 1991 aerial imagery confirms these observations. The Site is noted to be developed in the available 1999 aerial imagery, in comparable conditions and with similar features to those of present time. The 2005 aerial imagery depicts alterations, and likely re-development of the Site, with a larger parking and circulation area, a new peaked roof building, and additional underground storage tank fill ports along the south of the Site. In the 2002 aerial imagery, it is observed that development of the "Albion Sun Vista Community" residential subdivision is underway to the south of the Site, following Mitch Owens Road.

### 2.4 Neighbouring Properties and Land Uses

According to the City of Ottawa's Zoning information, available through the City of Ottawa's on-line interactive mapping portal, geoOttawa, the neighbouring lands are zoned as follows:

- Rural Residential Zone (RR5) to the west and north;
- Rural Heavy Industrial Zone (RH1) followed by Mineral Extraction Zone (ME2) to the east of the Site following Albion Road; and
- Rural Commercial Zone (RC and RC3) to south and southeast of the Site, respectively; and Mobile Home Zone (RM3) to the southwest.

The neighbouring land uses generally include the following:

- The neighbouring land to the south includes Mitch Owens Road followed by wooded land and high-density residential developments, including the Albion Sun Vista mobile home community, between 160 m and 400 m from the southern property limit of the Site;
- East of the Site, following Albion Road, is un-developed grass land with the exception to the portion of the land in the vicinity to the Mitch Owen Road and Albion Road intersection which includes an asphalted structure across the ground surface;
- West of the Site is wooded in addition to an unevaluated wetland, as identified by the City of Ottawa (Further details are provided in subsequent sections); and
- North of the subject Site is a residential subdivision development.

### 2.5 Hydrology

The Site is generally flat with a slight incline mound at the northern portion of the property, in the location of the septic disposal field. According to a topographic survey completed for the Site, included **Attachment A**, in support of the proposed re-development activities, the top of the incline is approximately 104 amsl, and the toe of the mound has an elevation of approximately 103 m amsl. The Site has a slight slope to the south, towards Mitch Owens Road. Elevations along the southern extent of the site range between 103.7 and 102.5 m amsl.

The Site is fitted with storm water structures, including catch basins and buried catchment drainage piping. These systems set in place are used to collect and control surface runoff across the Site and distributes it into accepted City services and infrastructure for further off-Site handling. No swales or drainage courses are present on the subject Site. A municipal ditch however does run in a general east-west direction along Mitch Owens Road, along the adjacent lands to the west. Based on the topography of the site, and site features, it is inferred that the property drainage pattern flows south towards Mitch Owens Road.

A watercourse is located on the neighbouring property to the west; however, the City of Ottawa identifies it as a 'ditch' in the interactive mapping system, geoOttawa. As discussed in greater detail below in Section 2.6, the wooded lands located immediately west of the Site, and the neighbouring lands to the north, are identified to contain unevaluated wetlands according to provincial mapping systems (Ministry of Natural Resources and Forestry, Make a Map: Natural Heritage Areas). The location of the wetlands identified are presented in **Figure 3**. Such natural features may be indicative of the possibility for elevated seasonal saturated conditions on, or in the vicinity of the Site. Storm water management designs are considered a suitable approach to mitigate possible concerns to the developed portion of the Site resulting from these features, in addition to recognized setbacks requirements and additional engineering controls to sensitive features (i.e. sump pumps in building basement, where applicable). Storm water management is discussed in greater detail in the Stormwater Management Report and Servicing Brief, Site Re-Development MacEwen Albion, 5546 Albion Road, Gloucester, Ontario report prepared by LRL, dated December 22, 2022, and included in the re-development application submission package to the City of Ottawa.

## 2.6 Natural Heritage Features

A watercourse has been identified in the vicinity of the Site, on the neighbouring land to the west. According to the City of Ottawa's interactive mapping system, geoOttawa, the watercourse is further defined as a ditch, extending approximately 5.0 m from the western Site boundary. The extents of the proposed development footprint, excluding the landscaped grassed portion of the Site, is within 30 metres of the watercourse. LRL has been requested to complete an Environmental Impact Study to provide greater detail of this natural feature and acceptable mitigation measures to reduce possible impacts to the quality of the watercourse. The findings of this study are presented in the Environmental Impact Study report, prepared by LRL, dated January 11, 2023.

The wooded lands located immediately west of the Site, and the neighbouring lands to the north, are identified to contain unevaluated wetlands according to provincial mapping systems (Ministry of Natural Resources and Forestry, Make a Map: Natural Heritage Areas). The location of the wetlands identified are presented in **Figure 3**.

GEMTEC Consulting Engineers and Scientists Limited (GEMTEC) were retained by MacEwen Petroleum Inc. to complete a Wetland Boundary Assessment for unevaluated wetland on the neighbouring lands. The assessment was initiated to confirm the extents of the unevaluated wetland in support planning and design of the proposed re-development of the Site. The conclusions of the report revealed that the unevaluated wetland boundaries, based on vegetation species, extends approximately 30 m from the western boundary of the Site. A copy of this report is included **Attachment B**.



## 2.7 Geology & Hydrogeology

### 2.7.1 Geological Mapping

Surficial soil deposit mapping<sup>1</sup> indicates that the surficial geology is fine- to medium-grained sand, calcareous and commonly fossiliferous; nearshore sand generally occurs as a sheet or as bars or spits associates with glaciofluvial materials. The surficial mapping details are presented in **Figure 4**. Bedrock mapping<sup>2</sup> indicates that the bedrock is described as the Oxford Formation: dolomite and limestone. The bedrock mapping details are presented in **Figure 5**.

The surficial overburden, and more specifically the confining clay layer, which is anticipated to restrict impacts from the proposed Site operations to the local supply aquifer, are summarized below in the summary table. Using details revealed through the previously completed intrusive investigation on the Site, in support of the proposed re-development (Geotechnical Investigation, June 2022 as detailed in Section 4.3; and Phase II Environmental Site Assessment January 2023 as detailed in Section 4.2), the soil characteristics, including the clay layer at the northern portion of the Site, are inferred to be as follows:

- Northern extent of the Site, represented by BH2; BH3; BH22-5; and BH22-9 (as presented in **Figure 9**):

Borehole Reference Identification	Clay Characteristics
BH2	<p>Encountered from between 2.9 and 4.4 m below grade. Grey in colour, saturated, firm with traces of sand, silty. In-situ vane shear testing readings were found to be in the range of between 30 and 38 kPa.</p> <p>Particle size analysis (Geotechnical Investigation, June 2022) of a sample collected from between 3.05 and 3.66 m below grade from BH2 (sample BH2-SS-5) was reported to have a D60 value of 0.0038 and a D50 value o 0.0026. No D10 value was derived in the analysis report based on the consistency of the clay. However, interpretation of the curve of the analysis for BH2-SS-5, it is found that the D10 values would be approximately 0.0003. Using the Slichter (1899) method, the hydraulic conductivity of the clay, specifically in the sample collected from depths between 3.05 and 3.66 m below grade, and is considered representative of the clay material encountered, was interpreted to be approximately <math>1 \times 10^{-5}</math>.</p> <p>A copy of the particle size analysis is included in <b>Attachment C</b>.</p>
BH3	<p>Encountered from between 2.9 and 4.1 m below grade. Grey in colour, saturated, firm with traces of sand, silty. In-situ vane shear testing readings were found to be in the range of between 30 and 38 kPa.</p> <p>No particle size testing was performed on the clay encountered in BH3, however is considered comparable to that of BH2 discussed above.</p>
BH22-9	<p>Encountered from 3.8 m below grade, to at least 4.6 m below grade, where the borehole was terminated. Grey in colour, silty. No further in-situ testing was performed on the clay material in the location, however, based on its vicinity to BH2, the characteristics of the clay described above should be comparable.</p>

<sup>1</sup> St-Onge, D.A., Surficial Geology, Lower Ottawa Valley, Ontario, Map 2140A, Geological Survey of Canada, 2009.

<sup>2</sup> Richards, J.H., Generalized Bedrock Geology, Ottawa-Hull, Ontario and Quebec, Map 1508A, Geological Survey of Canada, 1979.



- Clay was not encountered in borehole BH22-5, but rather glacial till, with traces of clay, beneath a sand layer extending between 0.6 and 3.6 m below grade;
- Central portion of the Site, represented by BH4; BH22-3; BH22-4; and BH22-10 (as presented in **Figure 9**). Clay was not encountered in these boreholes, which extended to depths of between 4.6 and 6.7 m below grade. Rather a glacial till, being clayey to with traces of clay, was found commencing at depth from between 3.7 and 4.5 m below grade, to the extent of the boreholes; and
- Southern extent of the Site, represented by BH22-1; BH22-2 and BH22-6 (as presented in **Figure 9**). Clay was not encountered in these boreholes, which extended to depths of between 4.6 m below grade. Rather a glacial till, with traces of clay, was found commencing at depth from between 2.8 and 3.5 m below grade, to the extent of the boreholes.

Based on the underlying overburden conditions encountered across the Site, at the time of the previous geotechnical and environmental investigations, it is anticipated that the clay confining layer is present at the northern extent of the subject property, with a hydraulic conductivity of  $1 \times 10^{-5}$ . It is anticipated that this area includes the area of the proposed septic disposal system, which will act as a confining layer to the supply aquifer by possible septic effluent impacts. Select locations, namely the central and southern portion of the Site, did not encounter a district clay layer. **Figure 11** and **Figure 11A** depicts the approximately inferred extent of the clay subsurface material encountered as well as overall overburden conditions, and a further visual depiction of the underlying conditions anticipated to be present across the Site based on previous intrusive investigations. Bedrock was encountered in the on-Site supply well (discussed in Section 2.8) at a depth of 16.5 m below grade.

According to the Brunton, F.R. and Dodge, J.E.P. Karst map of Southern Ontario, including Manitoulin Island; Ontario Geological Survey, Groundwater Resource Study 5, 2008, known areas to potential areas of karst geology is present in the vicinity of the Site, namely to the south. The Site and adjacent land to the east and west are identified as “Unknown or no observed evidence of karstification due to the character of bedrock, lack of outcrop and/or relative thickness of overburden.” Based on the available well record for the on-Site supply well, bedrock on the Site is anticipated to be encountered at depths of approximately 16.5 m below grade.

### 2.7.2 Well Head Protection

Initial pre-consultation discussions with the City of Ottawa, September 22, 2021, revealed that the proposed development is located within the wellhead capture zone for the neighbouring Albion Sun Vista communal supply well system. This communal well is located downgradient (south) of the subject Site, following Mitch Owens Road and is sourced by the shallow bedrock aquifer which is hydraulically connected to the sand/gravel/till overburden recharge zone.

A copy of the *Wellhead Protection Area Plan, Albion Sun Vista Community & Peer Review – Albion Sun Vista Wellhead Protection Area Plan* report, prepared by Trow Associates Inc. and Jacques Whitford Environmental Limited, dated June 2004, was provided to LRL from the City of reference. The report outlines details of the identified Wellhead Protection area, as well as clearly indicating appropriate recommendations to protect the drinking water source of the communal supply well.

The study interpreted a groundwater flow model that was initiated to determine the likely time of travel within the Albion Sun Vista Community capture zones. The modeling took into consideration local potential contamination sources to evaluate the relative risk of these areas towards the communal well. Seven (7) sites were identified to have, or potentially have uses and activities with the potential for contamination impacts to the groundwater within the wellhead capture zone, the risk to the communal wells supply aquifer was considered low to moderate due to the

underlying low permeable layer present. The Site, as discussed herein, was identified as a potential for contamination impacts, based on its up-gradient location and facility operations. Based on the modelling included as part of the study, 5546 Albion Road is inferred to encompass the 50 Day – 2 Year Capture Zone, which signifies that groundwater can travel through the capture zone in less than two (2)-year time (Zone 1).

An exert of the 50 Day – 2 Year Capture Zone, as included in the Wellhead Protection Plan, is included in **Figure 6A**. Furthermore, exerts from this previous report depicting the following are included:

- The two (2) to ten (10)-year time capture zone (Zone 2) is presented in **Figure 6B**;
- The ten (10) to 25 – year time capture zone (Zone 3) is presented in **Figure 6C**; and
- The capture zone limit is included in **Figure 6D**.

Based on the pre-consultation with the City of Ottawa, it has been indicated that **the proposed re-development of the Site (pre- and post- construction activities) must follow the recommendations set out in the Wellhead Protection Area Plan documentation prepared by Trow Associates Inc. and Jacques Whitford Environmental Limited, dated June 2004 to protect the communal supply aquifer**. These recommendations are reiterated in Section 11, with greater detail on how the proposed re-development of the Site will follow the recommendations, but are summarized as follows:

- The sand and gravel unit, set over the bedrock layer, acts as the recharge area of the supply aquifer. A Spill & Risk Management shall be implemented, including the best management practices, spills prevention plan, spills response plan, staff training requirements outlined therein, during construction and throughout the operational period of the Site;
- Prior to finalization of the re-development of the Site, a sounding inspection of the exiting well grouting should be completed by a licenced well installer to confirm that the bedrock aquifer intercepted by the supply well construction is isolated from possible surficial impacts (i.e. spills);
- All underground storage tanks must be equipped with interstitial monitoring systems and the tanks and associated piping should have leak detection systems in place; and
- A monitoring program of the Site's supply well must be established to provide ongoing water quality information. This should include monitoring on an annual basis for general water quality parameters and metals in addition to parameters often associated with fuel dispensing and handling facilities: petroleum hydrocarbons (PHC) Fractions F1 through F4; and Volatile Organic Compounds (VOCs) including Benzene, Toluene, Ethylbenzene and Xylenes (BTEX).

The *Wellhead Protection Area Plan, Albion Sun Vista Community & Peer Review – Albion Sun Vista Wellhead Protection Area Plan* report is summarized in below in Section 4.1. Clear risk prevention measures with respect to the Wellhead Protection Area, specifically those to be implemented on the Site by the Owner, are generally presented in Section 9. A formal Construction Risk Management Plan for Source Water Protection, a Spills Prevention and Risk Management Plan (which will include staff training and record keeping as a risk management measure), and the Monitoring Program will be prepared.

Furthermore, to support the protection of the local communal well, as outlined in the Wellhead Protection Plan Report (Jacques Whitford, 2004), the distribution of clay encountered across the Site requires detail characterization, as provided above in Section 2.7.





A copy of this report can be made available from the City of Ottawa, upon request.

### 2.7.3 Recharge Areas

Locally, the groundwater recharge zone for the bedrock supply aquifer is most likely the unconfined soil conditions encountered to the north, east and west of the Site, across the vast area of wooded and undeveloped land. Surficial geological mapping available from the Ontario Ministry of Northern Development, Mines, Natural Resources and Forestry, interactive mapping system reviewed as part of this assessment, reveal that the following surficial conditions are present.

- Glaciomarine and Marine Deposits: sand, gravelly sand and gravel, nearshore and beach deposits;
- Glaciofluvial ice-contact deposits: gravel and sand, minor till, includes esker, kame, end moraine, ice-marginal delta and subaqueous fan deposits; and
- Till: undifferentiated, predominantly sandy silt to silt matrix, commonly rich in clasts, often high in total matrix carbonate content.

Each of which are considered to have a suitable permeability which could attribute to infiltration and bedrock aquifer recharge.

### 2.7.4 Hydrogeologically Sensitive Areas

The Site is not considered Hydrogeologically Sensitive in regard to shallow soils or bedrock outcrops. Review of geological mapping and additional supporting documents, including MECP water well records, have revealed a deposit of overburden greater than 1.5 m in thickness. This was further confirmed through the advancement of boreholes across the Site at the time of additional sub-surface investigation fieldwork completed by LRL, in support of the proposed development application. These additional investigations included a Geotechnical Investigation and a Phase II Environmental Site Assessment. No bedrock outcrops were encountered at the time of LRLs Site visits associated with the corresponding investigations and assessments.

Subsurface conditions encountered during these studies are summarized as follows, although greater detail is available in the corresponding reporting documents completed for the respective investigations. Copies of the borehole logs from the Phase II Environmental Site Assessment and Geotechnical Investigation are included in **Attachment D**, and further detail pertaining to each summary, including chemical analysis and conclusions are provided in Section 4.

#### Geotechnical Investigation (June 2022):

Topsoil was found to have a thickness of 75 mm in a borehole advanced at the general central portion of the Site, on the grassed landscaped area of the property. The remaining boreholes, advanced across the asphalted parking and circulation areas of the Site revealed the presence of consisting of 100 mm thickness of asphalt overlying granular material have a thickness of 300 – 400 mm. The pavement structure, and topsoil, was followed a fill material to depths ranging between 1.06 and 1.75 m bgs. The fill was generally be described as a mixture of brown sand and gravel.

Underlying the fill was sand that extended to depths ranging between 2.97 and 6.71 m bgs. This material can be described as having trace silt, trace clay, greyish brown, and wet. Two (2) boreholes advanced to the north of the existing store encountered a thin layer of silt and clay under the sand layer, to depths of between 4.12 and 4.42 m bgs. This material can be described as having trace sand, grey, and wet.



Glacial Till was encountered under the sand, or silt and clay materials which extended to a depth of 6.71 m bgs, where the boreholes were terminated. This material can be described as a mixture of silt-sand, some gravel sized stone, trace clay, grey, and wet.



As part of the investigation, select soil samples were submitted for laboratory gradation analyses. The results of these analysis are summarized as follows:

Sample Location	Depth (m)	Percent for Each Soil Gradation							Estimated Hydraulic Conductivity 'K' (m/s)
		Gravel		Sand			Silt (%)	Clay (%)	
		Coarse (%)	Fine (%)	Coarse (%)	Medium (%)	Fine (%)			
BH1	1.5 - 2.1	0.0	0.0	0.1	24.0	66.1	8.9	0.9	$2 \times 10^{-7}$
BH2	3.1 - 3.7	0.0	0.0	0.2	0.4	5.4	51.6	42.4	$1 \times 10^{-7}$
BH3	4.6 - 5.2	0.0	12.0	5.9	9.1	26.6	42.7	3.7	$2 \times 10^{-6}$

Phase II Environmental Site Assessment (January 2023)

The subsurface soil conditions in the area investigated on the Site generally consist of asphalt structure beneath approximately 0.1 m of asphalt followed by fill to depths between 0.4 and 1.8 m bgs, sand to depths between 2.8 and 4.5 m bgs, and silty till to a depth of 4.6 where the boreholes were terminated. The fill generally consists of medium-grained sand with gravel and stones, and black silty organics. The overburden material was moist at depths between 1.2 and 1.7 m bgs and saturated at depths between 1.5 and 2.1 m bgs.

The Site is considered Hydrogeologically Sensitive due to its proximity to the wellhead capture zone for the neighbouring Albion Sun Vista communal supply well system as discussed above in Section 2.7.2.

According to the Brunton, F.R. and Dodge, J.E.P. Karst map of Southern Ontario, including Manitoulin Island; Ontario Geological Survey, Groundwater Resource Study 5, 2008, known areas to potential areas of karst geology is present in the vicinity of the Site, namely to the south. The Site and adjacent land to the east and west are identified as "Unknown or no observed evidence of karstification due to the character of bedrock, lack of outcrop and/or relative thickness of overburden."

2.7.5 Potential Sources of Contamination

As part of this assessment, a desktop review of potential sources of contamination to the supply aquifer was completed. This review was completed with general reference to Ontario Regulation 153/04, which is the provincial regulation which is most often referenced when considering the environmental conditions of a Site. The regulation outlines possible Potential Contaminating Activities (PCA) which can be associated with impairment or impacts to the quality of the subject property conditions. The review revealed the following potential sources of contamination, and the corresponding PCA as set out by Ontario Regulation 153/04.

The subject Site is presently operated as a retail fuel dispensing facility equipped with underground petroleum storage tanks, and associated petroleum dispensing equipment (piping and dispensing pumps). The property has been used for its current operations since at least the mid to late 1990's. Petroleum handling and dispensing facilities are often considered a high risk for potential impairment to subsurface quality and conditions. Ontario Regulation 153/04 considers the "Gasoline and Associated Products Storage in Fixed Tanks" as a PCA (PCA 28). Therefore, the Site operations have been identified as a potential source of contamination.

Confining aquifer conditions, like that present in the area of the Site, may be considered less likely to be impacted by the possible contamination sources, although in cases of damaged bedrock

supply well seals/grouting, contamination within shallow aquifers may penetrate down into deeper points.

A large aggregate extraction facility is located approximately 390 m northeast and 600 m east of the Site. Aggregate extraction (pits and quarries) is also considered a high risk for potential contaminant to the natural environment, and aquifers mainly due to the equipment usage, and activities. Disturbance to aquifers can be the result of operational de-watering activities and blasting. Mechanical and equipment malfunctions can result in chemical spills (i.e. petroleum hydrocarbons) which could infiltrate into possible drinking water sources or impair the surficial materials at the facility. Ontario Regulation 153/04 considers the “*Storage, maintenance, fuelling and repair of equipment, vehicles, and material used to maintain transportation systems*” a PCA (PCA 52).

The historical industrial/commercial development previously occupying the property located immediately east of the Site, following Albion Road, is also identified as a potential source of contamination. Little detail regarding the historical operations which took place at the property from between at least the mid 1970’s and 2019. Available aerial imagery retrieved through the City of Ottawa’s interactive portal, geoOttawa, reveal the presence of a fueling station along the southern extent of the property. The storage container (tank) appeared to be above-grade, and the contents are unknown. In the 2014 aerial imagery, numerous pieces of heavy machinery and large vehicles are visible across the property. The activities, namely the inferred re-fueling station at the south of the property, are considered a potential source of contamination, generally comparable to the activities at the subject Site. PCA identified with the historical land use, as per Ontario Regulation 153/04 include “*Storage, maintenance, fuelling and repair of equipment, vehicles, and material used to maintain transportation systems*”, and “*Gasoline and Associated Products Storage in Fixed Tanks*”.

## 2.8 Ontario Water Well Records

A search was conducted of the well records from the MECP Water Well Record (WWR) department. The search by UTM coordinates covered a 500 m radius from the site. The search returned 70 WWRs. A copy of the WWRs is included in **Attachment E** and their approximately locations are presented in **Figure 7**.

The records of the wells within 500 m of the Site revealed that the wells are drilled wells extending to depths between 14.0 and 67.9 m. The well records show that that the geological conditions within 500 m are generally similar and consist of sand or sand and gravel mix, followed by clay over bedrock. Glacial till material was encountered in select wells retrieved, and additionally, clay was not identified in all locations. The bedrock typically includes limestone, sandstone, or a combination of both. Two (2) well records retrieved, Well No. 1501837 approximately 385 m north of the Site, and Well No. 1501841, the supply well for the site, have granite rock listed.

Inferred subsurface profiles cross sections are presented in **Figure 8A** through **Figure 8B** and include select wells in the vicinity of the cross-section segments as shown in **Figure 7**. The general overburden conditions encountered in the wells within 500 m of the site are as follows:



MECP Well Number	Distance and Direction From Site (m)	Depth (m)	Overburden Details						
			Topsoil/ Clayey Loam (m)	Sand/ Gravel/Till (m)	Clay (m)	Weathered Bedrock/ Bedrock (m)	Groundwater Encountered (m)	Static Water Level (m)	Type of Water
1501841	On Site	41.4	--	0 – 3.0 (Sand) 3.0 – 9.1 (Gravel) 9.1 – 16.4 (Till)	--	16.4 – 41.4 (Limestone/ Sandstone/ Granite)	22.8 33.5	5.4	Fresh
1501837	435 N	25.9	0 – 7.6 (Topsoil)	7.6 – 16.7 (Gravel)	--	16.7 – 25.9 (Granite)	21.3	--	Fresh
1502207	385 N	15.8	--	0 – 1.8 (Sand Fill) 12.2 – 14.0 (Till) 14.0 – 15.8 (Gravel)	1.8 – 12.2		15.8	1.5	Fresh
1507206	410 W	17.3	--	--	0 – 15.5	15.5 – 17.3 (Limestone)	16.7	0.6	Fresh
1510978	40 E	26.5		5.7 – 9.1 (Sand)	0 – 5.8 9.1 – 16.1	16.1 – 26.5 (Limestone)	26.5	6.1	Fresh
1512040	200 N	14.0			0 – 14.0		14.0	1.8	Fresh
1514039	240 SW	31.1		0 – 19.2 (Sand)		19.2 – 31.1 (Limestone)	31.1	8.5	Fresh
1514603	440 N	31.6		0 – 11.5 (Sand) 11.5 – 14.3 (Gravel)		14.3 – 31.6 (Limestone)	28.9 31.6	1.8	Fresh
1515197	245 N	22.2		0 – 10.6 (Sand) 10.6 – 58 (Gravel)		8.5 – 22.2 (Limestone)	21.3	0.3	Fresh
1517522	150 N	19.2		0 – 0.6 (Sand Fill) 6.0 – 13.4 (Sand)	0.6 – 6.0	13.4 – 19.2 (Limestone)	19.2	Flowing	Fresh
1519504	430 W	18.2		0 – 3.6 (Sand)	3.6 – 10.9	10.9 – 18.2 (Limestone)	12.1 16.4	0.9	Fresh
1529731	430 SE	60.9		0 – 3.0 (Sand) 10.7 – 15.8 (Sand and Gravel)	3.0 – 10.6	15.8 – 60.9 (Limestone/ Sandstone)	59.4	9.4	N/A
1531934	485 SE	23.1		0 – 2.7 (Sand) 7.0 – 11.2 (Gravel and Boulders)	2.7 – 7.0	11.2 – 23.1 (Limestone)	19.8	2.5	N/A
1531972	445 SE	31.0		0 – 10.3 (Sand)		10.3 – 36.5 (Limestone/ Sandstone)	26.8 34.1	4.5	N/A
1532047	470 SE	60.9		0 – 3.6 (Sand) 7.3 – 11.8 (Sand and Gravel)	3.6 – 7.3	11.8 – 60.9 (Limestone / Sandstone)	58.2	1.8	N/A
1532048	485 SE	30.4		0 – 2.4 (Sand) 7.3 – 11.5 (Sand and Gravel)	2.4 – 7.3	11.5 – 30.4 (Limestone)	28.0	1.4	NA
1532211	360 W	42.6		0 – 2.7 7.6 – 14.6 (Sand and Gravel)	2.7 – 7.6	14.6 – 42.6 (Sandstone)	14.1	6.8	N/A



MECP Well Number	Distance and Direction From Site (m)	Depth (m)	Overburden Details						
			Topsoil/ Clayey Loam (m)	Sand/ Gravel/Till (m)	Clay (m)	Weathered Bedrock/ Bedrock (m)	Groundwater Encountered (m)	Static Water Level (m)	Type of Water
1532213	500 W	22.8		0 – 2.4 (Sand)	2.4 – 7.6	7.6 – 22.8 (Limestone)	17.9 18.8	1.8	N/A
1532594	540 SE	18.6	0 – 1.8 (Peat Moss)	0 – 10.3 (Sand)		10.3 – 18.5 (Limestone)	14.9 15.5 16.1 16.4	1.2	N/A
1533042	520 SE	31.0		0 – 8.8		8.8 – 31.0	15.2 18.5 21.9 25.9	0.9	N/A
1533068	415 SE	24.3		0 – 10.6		10.6 – 24.3	21.6	2.4	N/A
1533110	530 E	48.7			0 – 12.4	12.4 – 48.7 (Limestone/ Sandstone)	45.7	3.9	N/A
1533111	360 SE	42.6		0 – 10.9		10.9 – 42.6 (Limestone/ Sandstone)	40.5	3.6	N/A
1533215	330 SE	30.7		0 – 9.7		9.7 – 30.7 (Limestone)	15.5 19.5 20.7	1.5	N/A
1536160	500 N	52.7		0 – 1.2 (Sandy Fill) 1.2 – 4.2 (Sand) 10.0 – 14.6 (Sand and Gravel)	4.2 – 10.0	14.6 – 52.7 (Sandstone)	49.6	5.0	N/A
7042574	500 N	27.4		0 – 11.5 (Sand and Gravel)		11.5 – 27.4 (Limestone)	21.0 26.5	Flowing	N/A
7048696	500 N	53.9		0 – 13.1 (Sand, Gravel, Boulders)		13.1 – 53.9 (Limestone/ Sandstone)	56.3	3.7	N/A
7048697	405 N	36.5		0 – 6.1 (Sand)	6.1 – 15.8	15.8 – 36.5 (Limestone/ Sandstone)	33.5	4.7	N/A
7049238	500 N	48.7		0 – 3.3 (Sand) 11.5 – 13.1 (Gravel)	3.3 – 11.5	13.1 – 48.7 (Limestone/ Sandstone)	28.9	5.3	N/A
7050746	500 N	28.9		2.1 – 13.7 (Sand and Gravel)	0 – 2.1	13.7 – 28.9 (Limestone)	27.4	0.1	N/A
7050752	600 NW	24.3		0 – 3.0 (Sand) 9.1 – 10.6 (Gravel)	3.0 – 9.1	10.6 – 24.3 (Limestone/ Sandstone)	16.7 22.2	0.2	N/A
7108138	165 E	33.5		0 – 6.1 (Sand and Gravel, Boulders)		6.1 – 33.5 (Limestone)	29.8	3.2	N/A
7108364	380 N	48.7		0 – 2.4 (Sand and Gravel)	2.4 – 16.7	16.7 – 48.7 (Limestone)	22.0 41.4 45.1	5.9	N/A
7108365	505 N	50.5		0 – 3.0 (Sand) 13.7 – 14.6 (Gravel)	3.0 – 13.7	14.6 – 50.5 (Limestone / Sandstone)	29.5 48.4	6.0	N/A
7109764	550 NW	43.2		0 – 11.8 (Sand, Gravel, Boulders)		11.8 – 43.2 (Sandstone/ Limestone)	41.7	1.1	N/A
7109765	515 NW	36.5		0 – 11.5 (Sand, Gravel, Boulders)		11.5 – 36.5 (Limestone/ Sandstone)	34.4	5.1	N/A



MECP Well Number	Distance and Direction From Site (m)	Depth (m)	Overburden Details						
			Topsoil/ Clayey Loam (m)	Sand/ Gravel/Till (m)	Clay (m)	Weathered Bedrock/ Bedrock (m)	Groundwater Encountered (m)	Static Water Level (m)	Type of Water
7109766	730 NW	24.3		0 – 10.3		10.3 – 24.3 (Sandstone / Limestone)	15.8 22.5	0.1	N/A
7110787	335 N	54.8		10.3 – 17.3	0 – 10.3	17.37 – 54.8 (Limestone)	51.2	5.7	N/A
7110788	250 N	30.4			0 – 10.9	10.9 – 30.4 (Sandstone)	26.5 28.3	2.0	N/A
7110789	220 N	30.4			0 – 10.9	10.9 – 30.4 (Sandstone)	26.5 28.3	6.3	N/A
7126559	260 N	42.6		7.9 – 11.5 (Sand, Gravel, Boulders)	0 – 7.9	11.5 – 42.6 (Limestone/ Sandstone)	29.8 40.2	4.0	N/A
7126560	290 N	30.4		0 – 1.2 (Gravel) 7.9 – 12.1 (Sand, Gravel, Boulders)	1.2 – 7.9	12.1 – 30.4 (Limestone)	17.0 28.3	1.7	N/A
7126658	235 N	31.3	0 – 2.4	9.1 – 11.5 (Sand and Boulders)	2.4 – 9.1	11.5 – 31.3 (Limestone)	28.6	4.1	N/A
7132592	420 S	18.2		0 – 10.3 (Sand, Gravel, Boulders)		10.3 – 18.2 (Limestone)	14.6 15.8	2.0	N/A
7145839	280 N	18.5			0 – 8.8	8.8 – 18.5 (Limestone)	14.3 15.5 16.4	1.1	N/A
7150145	500 N	37.1		0 – 1.8 (Sand) 4.5 – 14.3 (Sand and Gravel)	1.8 – 4.5	14.3 – 37.1 (Limestone)	35.0	5.3	N/A
7151421	500 N	48.7		0 – 0.9 (Gravel Fill) 0.9 – 14.0 (Sand, Gravel, Boulders)	0.9 – 3.6	14.0 – 48.7 (Limestone / Sandstone)	25.9 41.1 46.9	5.2	N/A
7156118	400 N	67.9		0 – 1.5 (Fill) 10.6 – 17.0 (Till)	1.5 – 10.6	17.0 – 67.9 (Limestone / Sandstone)	64.9	6.8	N/A
7164576	470 N	54.5		0 – 13.3 (Sand)		13.3 – 54.4 (Limestone)	46.9 51.5	3.5	N/A
7199506	580 N	67.0		0 – 1.5 (Sand) 5.4 – 12.8 (Sand)	1.5 – 5.4	12.8 – 67.0 (Sandstone)	66.4	5.5	N/A
7200357	540 NW	51.8		0 – 0.6 (Gravel) 4.5 – 13.1 (Silty)	0.6 – 4.5	13.1 – 51.8 (Sandstone)	27.7 49.9	3.8	N/A
7216304	505 NW	30.9		0 – 3.9	3.9 – 6.9	6.9 – 30.9 (Shale/ Limestone)	IL*	6.2	Fresh
7228033	510 NW	37.4		0 – 12.1		12.1 – 37.4	25.9 35.0	5.9	N/A
7234834	70 N	42.6		0 – 2.4 (Sand) 6.0 – 15.2 (Gravel)	2.4 – 6.0	15.2 – 42.6 (Sandstone with Limestone)	27.1 35.0 40.5	5.1	N/A
7234935	70N	25.9		0 – 11.5		11.5 – 25.9	20.4	3.6	Fresh
7262956	445 NW	30.4		7.6 – 12.1	0 – 7.6	12.1 – 30.4 (Limestone/ Sandstone)	28.3	0.1	N/A



MECP Well Number	Distance and Direction From Site (m)	Depth (m)	Overburden Details						
			Topsoil/ Clayey Loam (m)	Sand/ Gravel/Till (m)	Clay (m)	Weathered Bedrock/ Bedrock (m)	Groundwater Encountered (m)	Static Water Level (m)	Type of Water
7268437	275 NW	48.7		0 – 14.6 (Sand, Gravel and Clay)		14.6 – 48.7 (Limestone)	45.7 46.9	7.3	N/A
7272978	280 W	28.9			0 – 10.9 (Clay, Sand and Boulders)	10.9 – 28.9 (Limestone)	26.8 27.1	2.6	N/A
7275892	80 S	54.8		0 – 12.1 (Sand and Gravel)		12.1 – 54.8 (Sandstone)	39.0 50.2 53.0	3.1	N/A
7279254	365 NW	48.4		0 – 14.8 (Sand)		14.8 – 48.4 (Limestone)	IL*	4.3	N/A
7285355	360 W	48.7			0 – 12.8 (Clay with Sand and Gravel)	12.8 – 48.7 (Limestone)	41.7 46.6	3.5	N/A
7285357	145 N	36.5			0 – 12.1 (Clay with Sand and Gravel)	12.1 – 36.5 (Limestone with Sandstone)	34.7	2.8	N/A
7287901	375 NW	48.7		9.7 – 12.1 (Gravel and Boulders)	0 – 9.7	12.1 – 48.7 (Sandstone)	3.0 45.7	1.4	N/A
7287917	370 W	33.5		0 – 12.1		12.1 – 33.5 (Limestone/ Sandstone)	16.7 28.0 31.6	2.8	N/A
7287923	500 W	33.5		7.6 – 12.8	0 – 7.6	12.8 – 33.5 (Limestone)	27.4 31.6	3.5	N/A
7294916	715 NW	49.0			0 – 9.6	9.6 – 49.0 (Limestone)	9.6 43.0	3.1	Fresh
7324276	520 NW	32.9		0 – 11.2		11.2 – 32.9 (Limestone)	26.8 28.9	3.5	N/A
7329110	120 N	36.0		0 – 12.0		12.0 – 36.0 (Sandstone)	3.0 33.9	3.6	N/A
7330777	90 N	24.3		0 – 3.0	3.0 – 12.8	12.8 – 24.3 (Limestone)	17.9 19.8	4.9	Fresh
7359616	410 NW	25.9		0 – 12.4 (Sand, with Clay and Gravel)		12.4 – 25.3	21.0 23.4	1.5	NA

**Notes:**

*Italics* Supply Well On-Site  
N/A Not Data/Not Tested

### 2.8.1 Water Well Record Summary

Based on the details of the well records obtained in the area (within 500 m of the Site) the aquifer can yield a sufficient amount to supply the proposed development on the Site in the long term. For example, pumping test results from select neighbouring wells within 500 m of the Site, indicate the bedrock aquifer being able achieve 189 L/min over 60 minutes utilizing approximately 84% of the available drawdown; and a pumping rate of 75.7 L/min over 60 minutes utilizing approximately 95% of the water column available. The locations of wells within 500 m are presented in **Figure 7**. A summary of the quantity of water of select neighboring wells within a 500 m radius of the Site is as follows:





MECP Well Number	Distance and Direction from Site	Depth (m)	Pump Test Details					
			Pump Rate (L/min)	Duration (min)	Drawdown (m)	Specific Capacity (L/Sec/m)	Recovery (%)	Recommended Pump Rate (L/min)
1510978	40 E	26.5	45.4	120	10.6	0.0713	--	18.9
1502207	385 N	15.8	37.8	120	--	--	--	18.9
1512040	200 N	14.0	75.7	60	9.1	0	--	18.9
1514039	240 SW	31.1	30.2	240	0	--	--	30.2
1514603	440 N	31.6	26.5	90	8.8	0.050	100	26.5
1515197	245 N	22.2	18.9	60	0	--	100	18.9
1517522	150 N	19.2	113	60	0	--	100	18.9
1519504	430 W	60.9	75.7	360	0.3	4.20	--	75.7
1529731	430 SE	60.9	18.9	60	51.5	0.006	100	18.9
1531934	485 SE	23.1	94.6	60	5.4	0.292	--	18.9
1531972	445 SE	31.0	30.2	60	25.9	0.019	100	30.2
1532047	470 SE	60.9	75.7	60	56.3	0.022	82.6	18.9
1532048	485 SE	30.4	56.7	60	27.7	0.034	75.8	18.9
1532211	360 W	42.6	75.7	60	34.4	0.036	74.1	18.9
1532213	500 W	22.8	113	60	4.2	0.448	0	18.9
1533068	415 SE	24.3	113	60	18.8	0.100	100	56.7
1533111	360 SE	42.6	189	60	32.9	0.095	100	56.7
1533215	330 SE	30.7	87.0	60	25.9	0.055	100	30.2

-- No Data is Available

xx Well Described in Greater Detail Above (available drawdown)

## 2.9 Shallow Overburden Groundwater Monitoring Wells

MacEwen Petroleum Inc. retained LRL to complete a Phase II Environmental Site Assessment (ESA) on the Site in the context of property redevelopment. The assessment was completed to determine if recognized potential environmental concerns have negatively impacted soil and groundwater quality of the subject Site. The potential environmental concerns identified that requires investigation includes:

- The past and present Site operations as a retail fuel outlet, and corresponding fuel dispensing equipment;
- The historical fueling station, and presence of heavy machinery on the neighbouring lands to the east following Albion Road (5545 Albion Road) encountered in aerial imagery obtained from between the period of mid 1970's and 2019; and
- The mineral aggregate operations on the neighbouring land approximately 390 m northeast.

To address these concerns, an intrusive investigation was carried out on July 28 and 29, 2022 by LRL. Further details pertaining to the findings of the Phase II Environmental Site Assessment, namely concentrations of contaminants encountered, contamination plumes, and recommendations are described below in Section 11. This section pertains solely to the geological and hydrogeological characteristics across the Site.

A total of ten (10) boreholes were advanced across the Site. The subsurface soil conditions in the area investigated on the Site generally consist of asphalt structure beneath approximately 0.1 m

of asphalt followed by fill to depths between 0.4 and 1.8 m bgs, sand to depths between 2.8 and 4.5 m bgs, and silty till to a depth of 4.6 where the boreholes were terminated. The fill generally consists of medium-grained sand with gravel and stones, and black silty organics. The overburden material was moist at depths between 1.2 and 1.7 m bgs and saturated at depths between 1.5 and 2.1 m bgs.

Four (4) boreholes were completed as monitoring wells: BH22-1, BH22-2, BH22-3 and BH22-4 (herein referred to as MW22-1, MW22-2, MW22-3, and MW22-4). Monitoring wells were constructed within the 91 mm diameter boreholes with a 51 mm slotted PVC piezometer. The top of the screen was extended to the ground surface using a solid riser pipe. Annular space around the slotted portion of the piezometer was backfilled with pre-washed and graded silica sand up to 300 mm above the top of the screen. A bentonite seal was placed above the sand pack and bentonite was used to fill the remainder of the hole to the surface. Monitoring wells were finished at the surface with a flush-mount aluminum casing.

The locations of the monitoring wells are described as follows:

Monitoring Well Identification	Location
MW22-1	Southeast portion of the Site.
MW22-2	Southeastern portion of the Site
MW22-3	Vicinity of the petroleum dispensing pump islands
MW22-4	Vicinity of the petroleum dispensing pump islands

The borehole and monitoring well locations are presented in **Figure 9**, and a copy of the borehole logs are included in **Attachment D**. Static groundwater elevations were measured at each monitoring well prior to the respective sampling activities and are summarized in the following Table. Groundwater depth measurements were between 1.77 and 1.98 m bgs, which corresponded to elevations between 98.15 and 98.43 m, with respect to an arbitrary benchmark established and assigned an elevation of 100.00 m.

The groundwater elevations and interpreted flow contours are shown in **Figure 9**. Based on these elevations the groundwater flow direction on the Site is towards the south-southwest.

Monitoring Well	Ground Surface Elevation	Reference Elevation	Depth to Water Table (m)		Groundwater Elevation
	(m)	(m)	Reference Point	Ground Surface	(m)
MW22-1	100.17	100.06	1.67	1.77	98.39
MW22-2	99.94	99.86	1.71	1.79	98.15
MW22-3	100.20	100.13	1.91	1.98	98.22
MW22-4	100.21	100.10	1.67	1.78	98.43



### 3 PROPOSED DEVELOPMENT

It is anticipated that the existing features mentioned above in Section 2 will be decommissioned or demolished, and removed from the Site accordingly, and replaced as follows:

- 400 m<sup>2</sup> single-story convenience store at the central portion of the Site;
- An approximately 525 m<sup>2</sup> concrete apron with overhead canopy;
- Four (4) underground storage tank, including the following:
  - 25 000 L capacity, fiberglass diesel fuel storage tank;
  - 25 000 L capacity, fiberglass super grade gasoline storage tank; and
  - Two (2) 65 000 L capacity, fiberglass regular grade gasoline storage tank.
- Six (6) fuel dispensing pumps; and
- New private sewage disposal system at the northwest portion of the Site, as described in greater detail herein.

The location and dimensions of the existing and proposed features are presented in **Figure 2** and **Figure 10**, respectively. It should be noted that during the redevelopment of the Site, soils with impacts from the on-going fuel dispensing activities (as identified in the Phase II Environmental Site Assessment, LRL, 2023) will be remediated accordingly and as considered practical, and the formal summary report will be submitted to the Technical Standards and Safety Authority (TSSA), and all other required regulatory authorities. A post re-development groundwater monitoring plan will be prepared and followed as discussed in Section 11.

Additionally, soils included in the existing sewage disposal system will be removed from the Site and disposed of accordingly. The Demolition Plan (C102) included in the proposed re-development application package to the City includes a note with reference to the area of the existing sewage disposal system to be removed.

To protect the local supply aquifer, namely that of the neighbouring residential development with a communal supply well, the low conductivity layer (clay) present at the northern portion of the Site should be protected during the redevelopment activities. The proposed construction activities associated with the re-development should not puncture the low conductivity layer, unless it is to remove known contaminates which will pose a notable risk to the environmental quality and conditions of the Site and neighbouring lands.

The proposed construction activities associated with the re-development will include:

- The removal and replacement of the underground petroleum storage tanks.
  - As presented in the included **Figure 11**, the proposed underground storage tanks will be positioned in the general same location as their existing position, with a slight shift towards the east and north, and the inclusion of two (2) additional tanks to the west of the exiting installations.
  - The excavation associated with the installation of underground storage tanks of this size (two (2) at 65,000 L capacity and two (2) at 25,000 L capacity) generally extends to a depth of approximately 4.2 m below grade, which includes 0.6 m of granular underlying the installations.
  - The majority of excavation related to the installation of the underground storage equipment will include the area presently encompassed by the current installations.



- Based on the finding of the Phase II ESA, prepared by LRL (2023), although petroleum hydrocarbon-based contamination was not identified in the sampling program completed, it was inferred that underlying soils within the existing tank nest (i.e. fill around the installations) and under the fuel dispensing pumps may be impacted. This area is estimated to be 300 m<sup>2</sup> (tank nest area) and 450 m<sup>2</sup> (pump island area). Based on the properties of petroleum-based contaminants (LNAPL), they are often limited to the depth of the groundwater table. The boreholes advanced as part of the Phase II ESA revealed that groundwater was encountered at depths of between 1.2 – 2.1 m below grade, which can suggest that impacted overburden is likely limited to these depths.
- Further discussion and procedures related to the excavation of the impacted material are included in the Construction Management Plan.
- The removal and replacement of the fuel dispensing equipment (i.e. fuel dispensing pumps and corresponding piping and lines) and the overhead canopy.
- The removal of existing asphalt and cement structure and features, as presented in the Demolition Plan (C102) included in the proposed re-development application package to the City.
- The removal and replacement of the sewage disposal system on the northern portion of the Site.
- The removal and re-construction of the convenience store.
  - It should be noted that the convenience store will be comparable to that of the existing one on the site with no significant quantities of fuels, oils or lubricants stored. Those which are present are in small quantities and contained in sealed containers for retail. No vehicle repair or carwash operations presently occur on the site, nor are they anticipated.

Further details with respect to training, construction management, spill & risk management to be followed at the Site, will be included in a Construction Risk Management Plan for Source Water Protection, a Spills Prevention and Risk Management Plan (which will include staff training and record keeping as a risk management measure), and the Monitoring Program – will be prepared and reviewed by the City as a condition of the site plan agreement.

## **4 PREVIOUSLY PREPARED REPORTS**

### **4.1 Wellhead Protection Area Plan, Albion Sun Vista Community & Peer Review – Albion Sun Vista Wellhead Protection Area Plan, June 2004**

The report was prepared by Trow Associates Inc. and Jacques Whitford Environmental Limited in support of a Wellhead Protection Study carried out for the water wells that supply the existing and proposed expansion of the Albion Sun Vista Community mobile home park located in the vicinity of the community now known as Greely, formerly the Osgoode Township within the City of Ottawa. The Wellhead Protection Study was completed to identify the supply aquifer which services the respective communal well for the Albion Sun Vista Community as well as to identify and locate existing and potential areas of contamination situated within the corresponding capture zone of the communal well.

The study interpreted a groundwater flow model initiated to determine the likely time of travel within the Albion Sun Vista Community capture zones. The modeling took into consideration local



potential contamination sources to evaluate the relative risk of these areas towards the communal well. The study generally concluded the following:

- Recharge zone for the supply aquifer of the communal wells includes the sand and gravel overburden layer extending approximately 1.5 km northeast of the Site;
- The presence of a low permeability zone consisting of clay and silt was identified above the deeper water supply aquifer located within the capture zone, downgradient of the corresponding communal wells recharge zone. This low permeability zone is anticipated to reduce possible impacts from surface sources;
- Although seven (7) sites were identified to have, or potentially have uses and activities with the potential for contamination impacts to the groundwater within the wellhead capture zone, the risk to the communal wells supply aquifer was considered low to moderate due to the underlying low permeable layer present; and
- The following recommendations were specified to protect the communal wells supply aquifer and source zone:
  - It was recommended that source protection measures to the sand and gravel layer should be implemented which can include limiting the land uses within the identified recharge area to those of lower risk;
  - All wells constructed within the capture zone should be constructed accordingly so that there is prevention of downward drive of contamination through the low permeable layer into the supply aquifer. Penetration of the low permeability layer can result in impacts to the underlying aquifer;
  - Installation and sealing of well casings should be completed under supervision of a qualified person, such as a professional geoscientist or a professional engineer;
  - Underground storage tanks, installed within the identified 10-year Time-of-Travel zone, should be equipped with an interstitial monitoring system. Leak detection units should equip the tanks and associated piping at these locations;
  - An on-going water quality monitoring program should be established to verify the on-going water quality of the upgradient region from the site. This includes the monitoring of the supply well at 5446 Albion Road (rather, it is inferred that this should read 5546 Albion Road), where it is recommended that annual monitoring for petroleum-based parameters be completed, including petroleum hydrocarbons and volatile organic compounds; and
  - A monitoring well should be constructed on the northern extent of the Albion Sun Vista Community property. It was recommended that samples from this monitoring wells should be collected for analysis in accordance with Schedule 13 of the Ontario Regulation 170/03 for a groundwater source. Furthermore, it was recommended that the proposed monitoring well be sampled for total petroleum hydrocarbons and select volatile organic compounds, namely BTEX, annually.

A copy of this report can be provided upon request to the City of Ottawa.

#### **4.2 Phase II Environmental Site Assessment, 5546 Albion Road, Ottawa, Ontario, March 17, 2023**

The report was prepared by LRL for MacEwen Petroleum Inc. in support of the proposed Site re-development application. The assessment was completed as per CSA Standards. The purpose of a Phase II Environmental Site Assessment (ESA) was initiated to determine if recognized

potential environmental concerns have negatively impacted soil and groundwater quality of the subject Site. The potential environmental concerns identified that requires investigation includes:

- The past and present Site operations as a retail fuel outlet, and corresponding fuel dispensing equipment;
- The historical fueling station, and presence of heavy machinery on the neighbouring lands to the east following Albion Road (5545 Albion Road) encountered in aerial imagery obtained from between the period of mid 1970's and 2019; and
- The mineral aggregate operations on the neighbouring land approximately 390 m northeast.

Contaminants of potential concern (COPCs) include: Petroleum Hydrocarbon Compounds (PHCs), Volatile Organic Compounds (VOCs), Polycyclic Aromatic Hydrocarbons (PAH), Polychlorinated Biphenyls (PCBs), metals, and inorganics.

Regulatory requirements for assessing environmental conditions of a site are established by Ontario Regulation 153/04 – Records of Site Conditions, Part XV.1 of the Environmental Protection Act (O. Reg. 153/04). Site condition standards are set out in the MECP's "Soil, Ground Water and Sediment Standards for Use Under Part IV.1 of the Environmental Protection Act", April 15, 2011, as amended. The applicable SCS used was the Table 2 Full Depth Generic Site Condition Standards in a Potable Groundwater Condition, commercial property use and coarse-textured soils.

The investigation involved advancing ten (10) boreholes across the Site at strategic locations based on areas of potential environmental concern. Four (4) of the boreholes were completed as monitoring wells to assess hydrogeological conditions and facilitate groundwater sampling.

The subsurface soil conditions in the area investigated on the Site generally consist of asphalt structure beneath approximately 0.1 m of asphalt followed by fill to depths between 0.4 and 1.8 m bgs, sand to depths between 2.8 and 4.5 m bgs, and silty till to a depth of 4.6 m where the boreholes were terminated. The fill generally consists of medium-grained sand with gravel and stones, and black silty organics. The overburden material was moist at depths between 1.2 and 1.7 m bgs and saturated at depths between 1.5 and 2.1 m bgs. No olfactory or visual evidence of petroleum hydrocarbon impacts were observed in the soils collected from all boreholes. The combustible soil vapours (CSV) concentrations measured in the soil samples collected ranged between less than the machine detection limit (<0.1 ppm) and 0.7 ppm.

Based on the groundwater elevations measured on August 2, 2022, at the time of groundwater monitoring well development, the groundwater flow direction in the overburden is interpreted to be towards the south-southwest. Headspace VOC levels in MW22-1, MW22-2, MW22-3, and MW22-4 were 0.6 ppm, 3.2 ppm, <0.1 ppm, and 0.7 ppm, respectively, prior to development of the wells. During the sampling event, following purging, the levels were <0.1 ppm, 1.0 ppm, 0.1 ppm, and 0.4 ppm, respectively.

Select soil and groundwater samples were submitted for analysis to establish if areas of potential environmental concern have negatively impacted soil and groundwater conditions. In the soil, VOC and PAH parameters analysed were not detected in any of the samples submitted for analysis. Select PHC and metals parameters analysed were detected, however levels were measured below applicable Table 2 SCS's. The general inorganic parameters analysed met the applicable standards with the exception of BH22-4-SS1A which exceeded for conductivity with a level of 1430 µS/cm, above the SCS of 1400 µS/cm.

In the groundwater, VOC, PAH, and PCB parameters were not detected in the samples submitted. PHC F3 and F4 were detected in MW22-1, however levels were measured below the SCSs of

500 µg/L. Select metal parameters were detected, however all levels are below the applicable SCS's with the exception of sodium in MW22-1, MW22-2, MW22-3 and MW22-4 with levels of 708 000 µg/L, 702 000 µg/L, 531 000 µg/L and 715 000 µg/L, respectively, above the SCS of 490 000 µg/L. The duplicate of MW22-2 was below the SCS with a level of 307 000 µg/L. Chloride exceeded the applicable SCS of 790 µg/L in MW22-1 (1500 µg/L), MW22-2 (1350 µg/L and duplicate 1360 µg/L), and MW22-3 (980 µg/L).

The report indicates that based on the observations during drilling activities, along with screening of samples and laboratory analysis, there is evidence of conductivity impacts to the surface soil in the southeast portion of the Site, and sodium and chloride impacts in the groundwater across the Site. The horizontal and vertical extent of contaminated soil has not been fully delineated; however, it is anticipated that the fill across the majority of the Site maybe contaminated. It was recommended that if groundwater monitoring wells are not required for future monitoring purposes, they should be decommissioned in accordance with O. Reg. 903.

During the proposed re-development activities of the Site, an environmental remediation program will be implemented to address the identified or anticipated impacted overburden across the southern extent of the Site. The environmental remediation program will support the future protection of the on-Site supply well, in addition to the further protection of additional natural features and aquifers from possible contamination and damage in the long term. As presented in the Phase II Environmental Site Assessment, and discussed above in this section, generally contaminants associated with fuel handling facility were not encountered, although suspected to be present in the surrounding soils encompassing the underground storage tanks, and in the area of the pump islands, which could not be investigated due to the risk of damaging the fuel handling equipment.

Following the Technical Standards and Safety Authority's (TSSA) Environmental Management Protocol for Fuel Handling Sites in Ontario, August 2012 (formerly GA1/99), contaminated soils will be remediated to conditions which meet the corresponding site conditions standards, as best possible. Caution will be taken to not puncture the confining clay barrier, which acts as a protective layer to the neighbouring supply aquifer. Should restrictions to the excavation activities be encountered, alternative remediation methods will be implemented.

#### **4.3 Geotechnical Investigation, Proposed Site Redevelopment, 5546 Albion Road South, Ottawa, Ontario, June 2022 (Revised November 2023)**

LRL was retained by MacEwen Petroleum Inc. to perform a geotechnical investigation for the proposed site redevelopment, located at 5546 Albion Road Street South, Ottawa, Ontario. The purpose of the investigation was to identify the subsurface conditions across the Site and provide guidelines on the geotechnical engineering aspects of the design of the project, including construction considerations.

The fieldwork for this investigation was carried out on May 25, 2022. A total of four (4) boreholes, labelled BH1 through BH4, were drilled onsite to get a general representative of the Site's soil condition. The boreholes were advanced using a truck mount CME 75 drill rig equipped with 200 mm diameter continuous flight hollow stem auger supplied. Sampling of the overburden materials encountered in the boreholes was carried out at regular depth intervals using a 50.8 mm diameter drive open conventional spoon sampler in conjunction with standard penetration testing (SPT) "N" values. The SPT were conducted following the method ASTM D1586 and the results of SPT, in terms of the number of blows per 0.3 m of split-spoon sampler penetration after first 0.15 m designated as "N" value.

The boreholes were advanced to a depth of 6.71 m bgs. The subsurface conditions encountered at the time of the borehole drilling generally included the following:

- Topsoil, with a thickness of 75 mm, was encountered in a borehole advanced at the general central portion of the Site, on the grassed landscaped area of the property. The remaining boreholes, advanced across the asphalted parking and circulation areas of the Site revealed the presence of consisting of 100 mm thickness of asphalt overlying granular material have a thickness of 300 – 400 mm.
- The pavement structure, and topsoil, was followed a fill material to depths ranging between 1.06 and 1.75 m bgs. The fill was generally be described as a mixture of brown sand and gravel.
- Underlying the fill was sand that extended to depths ranging between 2.97 and 6.71 m bgs. This material can be described as having trace silt, trace clay, greyish brown, and wet.
- Two (2) boreholes advanced to the north of the existing store encountered a thin layer of silt and clay under the sand layer, to depths of between 4.12 and 4.42 m bgs. This material can be described as having trace sand, grey, and wet.
- Glacial Till was encountered under the sand, or silt and clay materials which extended to a depth of 6.71 m bgs, where the boreholes were terminated. This material can be described as a mixture of silt-sand, some gravel sized stone, trace clay, grey, and wet.

Groundwater was carefully monitored during this field investigation. During drilling, water was encountered at depths ranging between 2.9 and 3.3 m bgs.

Based on the conditions encountered at the time of the field investigation, and the results of the corresponding laboratory analysis, detailed geotechnical considerations with respect to the various aspects of the proposed construction are provided. For specific details related to these considerations, the formal report dated June 2022 (revised November 2023) should be consulted.

## 5 WATER QUALITY AND QUANTITY ASSESSMENT

### 5.1 Supply Well – 5546 Albion Road South

The supply well (1501841) which services the subject property was installed on September 1, 1965, by McLean Water Supply Ltd. Although the specified location of the supply well is different that that of the actual Site location, it is possible that references previously used at the time of the well installation have since been altered (i.e. edge of roadways). A copy of the WWR is included in **Attachment E**. The well is located along the eastern perimeter of the Site, which includes a grassed median. A curb is present on either side of median, however, the well may be prone to possible damage should an automotive incident occur. Recommendations for well placement improvement are included in Section 11. Furthermore, the proposed development grading is anticipated to be such, as presented in **Figure 10**, that runoff is away from the structure.

On November 28, 2023, PV Well Water (Carp, Ontario) conducted a camera inspection of the existing supply well to address questions related to the integrity of the existing well raised by the City of Ottawa. The details on the inspection are included in **Attachment F**. Please note that in the report, 'TOC' is an abbreviation for Top of Casing. The inspection confirmed that the casing extended to approximately 18.2 m in depth, where open hole construction was encountered. The pump was set at 22.2 m below TOC, which restricted further decent of the camera. PV Well Water concluded that the well should be extended to a minimum of 40 cm above the existing grade and completed with a vermin proof cap as per O. Reg. 903.

LRL has reached out to PV Water Well to proceed with the modification to the well. A formal quotation has been received, reviewed and accepted (stick up of the supply well casing to 74 cm to match the proposed final grade, and the addition of a vermin proof cap). The requirements for



the well modifications in accordance with O. Reg. 903 requires that post well modifications, the well will require formal disinfection. To comply with the O. Reg. 903 requirements, the chlorination requires that the well be not used for between 12 and 24 hours. This will require that the operations of the site be stopped for this duration. As the Site operates as a 24-hour fuel service station, this would require the station to close for a period which is not considered practical at this time. The importance of the well modifications is understood, and it is guaranteed that during the initial stages of the construction activities associated with the re-development (i.e. removing asphalt and cement structures), PV Water Well will be retained to complete the required modifications. **The City can request as a condition of occupancy that formal written acknowledgement and evidence that these modification have been completed.**

The annular space of the well was not confirmed through the camera inspection, nor could it be verified through a casing depth sensor inspection. PV Well Water indicated that the annular space would need to be excavated and disturbed to establish the conditions of the grout, however during initial conversations with the sub-contractor, they indicated that excavation around the well is not advisable or recommended, as it most often would result in damaging the grout thus compromising the integrity of the well construction. This could result in a potential contamination pathway into the deeper bedrock aquifer.

The well record specifies approximately 3.0 m of sand, followed by gravel and boulders to 10.0 m below grade. The sand and boulders are underlaid by till to a depth of 16.2 m followed by bedrock. The well is identified to extend to a total depth of 40.8 m below grade. Water was reported to be found between 22.5 and 33.0 m below grade and was noted to be fresh. The steel casing extends to a depth of 19.2 m below grade with the remainder of the well being assumed open hole. The well record specifies a 24-hour pumping test at a rate of approximately 90 L/minute (30 Gallons per Minute). No details pertaining to drawdown or recovery are included in the well record, however a recommended pumping rate of 30 gallons per minute was reported. A formal draw down evaluation (pumping test) was completed as part of this assessment. The findings are presented in Section 5.2.

## 5.2 Quantity

The proposed re-development of the Site is anticipated to include a gasoline retail outlet and convenience store; much like that of present time. The required aquifer yield has been derived from the City of Ottawa’s Water Distribution Guidelines, July 2010, as amended, including the August 18, 2021, Technical Bulletin specified alterations, and the MECP’s Design Guidelines for Drinking-Water Systems, 2008.

The anticipated average daily flow demands have been evaluated based on the septic design. The daily flow demand is estimated based on the total daily design sanitary sewage flow, calculated as per Table 8.2.1.3.B of the Ontario Building Code, 2012. The calculation is shown in the following table.

Occupancy Type	Column 2 (L/unit)	Column 1 (unit)	Number of units	Daily Design Flow
Service Station*	560 L	fuel outlet	7**	3 920
	950 L	water closet	4	3 800
<b>Total Daily Demand</b>				<b>7 720 L</b>

### Notes

\* Volumes listed apply to Service Stations, with no vehicle washing, as indicated in Table 8.2.1.3.B of the Ontario Building Code, 2012



\*\* The number of fuel outlets is considered the maximum number of fuel nozzles that could be in use at the same time, as per the Table 8.2.1.3.B of the Ontario Building Code, 2012.

Therefore, based on the septic design, the anticipated daily flow demand is 7 720 L/day. The average daily flow demand was estimated based on the anticipated daily flow demand of 7 720 L/day over a 12-hour period as 17.9 L/min. Although the facility operates 24-hour daily, it is considered a more conservative approach to establish peak demand within 12-hours which is often the period which a fuel dispensing facility would encounter greater 'traffic'.

For general consideration, and although not the anticipated volume to be met at the Site during operations, the maximum daily flow is often estimated based on a multiplier of 1.5 the average daily flow. This is intended to confirm the aquifer can meet this arbitrary value in the event of a possible isolated increase in demand. The maximum daily flow is estimated as 11 580 L/day or 16.08 L/min (1.5 times the average daily flow, over a 12-hour period) and the peak hourly flow is estimated as 19.30 L/min (1.8 times the maximum daily flow).

### 5.2.1 Pumping Test

To establish the hydraulic properties of the proposed supply aquifer, a 6-hr pump test was conducted on the existing supply well throughout the over-night period of October 16 and 17, 2022, as mentioned above in Section 1. As discussed with the City, and agreed upon by the client, as not to disrupt site operations, the pumping test was completed during over-night hours when the facility was closed. The pumping rate was increased throughout the shorter duration of the test (6-hours rather than the typical 8-hours recognized for a commercial establishment) to account for comparable demand volumes.

The well was pumped at a constant flow rate ( $\pm 5\%$ ) of approximately 30 L/min over 6-hr period using a temporary submersible pump lowered into the well, above the existing components so not cause potential disruption to the Site operations (i.e. damage pump during the test). Drawdown was measured manually during the pumping and recovery periods using an electronic water level tape. A data logger was also submersed into the well throughout the duration of the pumping test as an additional means for data collection. Field measurements of turbidity, residual chlorine, colour, conductivity, total dissolved solids (TDS), pH and temperature were frequently collected at the pumping of the well during each pumping test. Following the pump's cessation, the supply well water level recovery was measured. Data collected in the field for the pumping test which includes the flow rate, water levels and measurement intervals, in addition to in-field quality measurements such as turbidity, are presented in **Attachment G**.

The initial static water level was measured as 2.98 m below top of casing (btc), and test well depth was measured as 30.7 m btc. As the existing supply submersible pump was left in the well throughout the duration of the test, it is likely that the well depth measurement recorded in the field is that of the set pump, as the corresponding well record indicates a depth of 41.4 m below ground surface.

The drawdown after 6-hr of pumping was 1.55 m. This represents only approximately 4.0% of the available drawdown in the well. The specific capacity of the well after 6-hr of pumping was calculated to be 0.322 L/sec/m with a long-term availability of 51.1 m<sup>3</sup> per day. The calculation is presented in **Table 1**. The recovery was commenced at the end of the 6-hr pumping duration. The submersible pump remained in the well throughout this time so not to alter the recovery test process and measurements. After one (1) hour of recovery, the well returned to 97.4% of the initial water level (3.02 m btc).



### 5.2.2 Aquifer Characteristics

Following the completion of the constant rate pumping test, the data was analysed using the Aquifer Test software package, by Waterloo Hydrogeologic. The data underwent Theis and Agarwal-Theis Recovery analysis, the results of which are shown in the table below. Graphical analyses are provided for reference purposes in **Attachment H**.

Based on the information gathered from the pump test, the wells' transmissivity and coefficient of storage were calculated using the average of the Theis logarithmic approximation for the drawdown and Agarwal/Theis for the recovery. The specific yield of the well was calculated using the information obtained from the pump test, the transmissivity and coefficient of storage. The yield takes into account a minimum safety factor of 3. The characteristics of the well are summarized in the table below. The yield was calculated using the safety factor; therefore, the theoretical yields can be higher.

Parameter	Supply Well (1501841)
	6 Hour Test
	Theis
Transmissivity (m <sup>2</sup> /sec)	1.00 x 10 <sup>-3</sup>
Coefficient of Storage	1.00 x 10 <sup>-4</sup>
Pumping Rate (L/min)	30
Available Drawdown (m) – assuming pump set at 36 m as per the water well record	33.0
Maximum Drawdown (m)	1.55
% Drawdown	4.0%
Specific Yield (L/sec/m)	0.032
Maximum Pumping Rate (L/min)	128.9
Long Term Availability (m <sup>3</sup> /day)	185.6

Based on the observed drawdown/recovery relationship, it is concluded that the long-term yield of the test well is in excess of minimum daily demand of 7 720 L (7.72 m<sup>3</sup>/day) and is found to be able meet a maximum pumping rate of 128.9 L/minute. This is considered sufficient to supply the inferred average and peak hourly flow demands of 16.08 L/min and 19.30 L/min, respectively.

### 5.3 Quality

#### 5.3.1 Supply Aquifer – Supply Well No.1501841

The groundwater chemistry of the proposed supply aquifer for the commercial re-development was obtained by collecting water samples from the existing supply well (No. 1501841) located at the eastern perimeter of the property. The well was installed within the various bedrock formation common of the area, including limestone to between 16.2 and 29.7 m; sandstone to between 29.7 and 35.7 m; and granite to between 35.7 and 40.8 m. Water was reported to be found within the limestone and sandstone formation, as identified on the corresponding well record, at depths between 22.5 and 33.0 m.

To represent the long-term water quality of the well, samples were collected during different stages of the pump test and well development (after 3 and 6-hours of pumping). The water samples were collected using laboratory prepared bottles and were submitted to an accredited laboratory (Parcel Laboratories Ltd. of Ottawa, Ontario) for analysis of a standard “subdivision” package, and volatile organic compounds (VOCs). The laboratory certificates of analysis are included in **Attachment I**.



**Table 2, Table 4 and Table 5** summarizes the water analysis and also includes the relative ODWS (O. Reg. 169/03) for the parameters tested. The water samples meet the ODWS parameters tested except for the following:

- Hardness was found to be 204 and 219 mg/L at 3- and 6-hours, respectively, above the ODWS operation guideline (OG) limit of 100 mg/L. High levels of hardness can lead to scale deposits and excessive utilization of regular soaps. Hardness can be reduced through the use of a water softener; however, the use of sodium chloride as a regenerant for the resins can increase the sodium content of the water. This poses a lower risk to the subject site based on its anticipated use, although it should be noted that for individuals with sodium restricted diets, potassium chloride can be substituted for sodium in the ion exchange system to lower the hardness in the water supply.
  - The Langelier Saturation Index (LSI) is used to determine the calcium carbonate stability of water and the pH at which water is saturated with calcium carbonate (pHs). The LSI calculation is used to establish the level of saturation. The Ryznar Stability Index (RI) is used to determine the aggressiveness of water which can indicate the scale and corrosion potential. The calculations for RI and LSI are shown in **Table 3**. Using a water temperature of 10°C, the LSI was calculated for the 6-hour sample of 0.40 which indicate the water is slightly scale forming and corrosive. The RI was calculated to be 7.1 at the 6 hours sample which indicate significant corrosion potential.
- Turbidity was measured to have a level of 4.2 NTU in the 3-hour sample, and 8.8 NTU in the 6-hour sample. Both of which are above the ODWS OG of 1 NTU if the treatment system is required to provide filtration and, the 6-hour sample is above the AO of 5 NTU. The 6-hour sample level is also above the D-5-5 level considered reasonably treatable of 5 NTU. Turbidity measures the relative clarity of the water and likely represents the disturbance of the distribution system as a result of the pumping test. However, being that the water has an acceptable microbiological quality the elevated turbidity can be considered acceptable as long as the groundwater well is maintained properly. Turbidity can be reduced through proper filtration techniques.

It should be noted that during the time of sample collection, as outlined above in Section 5.2.1, in-field turbidity measurements were recorded as 0.31 and 0.27 NTU, at the 3-hour and 6-hour sample time, respectively. It is possible that select chemicals or compounds may have reacted in the samples from between the sample collection time and the sample analysis at the laboratory. The field parameters recorded are included in **Attachment G**.

- Total Coliforms were detected in the samples collected at 3-hours and 6-hours of pumping, with values of 4 and 2 CFU/100 mL, respectively. The ODWS has a Maximum Allowable Concentration (MAC) of 0 CFU/100 mL for total coliforms in a drinking water system. According to the MECP D-5-5 guideline, a maximum concentration of 5 CFU/100 mL is considered reasonably treatable. The values obtained are considered to be reasonable treatable. Microbial impacts can be treated through the use of an ultraviolet disinfection system.
- Sulphide concentrations were below the reported detections limits by the laboratory in the sample collected after 3-hours of pumping (<0.02 mg/L). The concentrations increased to 0.12 mg/L after 6-hours of pumping, above the 0.05 mg/L ODWS aesthetic objective (AO). The presence of sulphide can lead to objectionable odours and taste in the water and black staining and deposits on fixtures. Sulphide can be reduced through aeration, which oxidizes it to sulphate, or an activated carbon filter.

- Iron levels were measured to be 0.4 and 0.9 mg/L, above the ODWS AO of 0.3 mg/L. This level is below the D-5-5 treatability limit of 10 mg/L. Iron can be reduced through the use of a water softener; however, the use of sodium chloride as a regenerant for the resins can increase the sodium content of the water. This poses a lower risk to the subject site based on its anticipated use, although it should be noted that for individuals with sodium restricted diets, potassium chloride can be substituted for sodium in the ion exchange system to lower the hardness in the water supply.

In-field measurements, as summarized in the included **Attachment G**, were found to be generally as follows:

- Turbidity measurements collected were found to range between 1.14 NTU after one (1) hour of consecutive pumping, and 0.27 NTU after six (6) hours of pumping;
- Chlorine residual measurements were all below the machine detection limit of 0.01 mg/L, throughout the pumping test;
- Colour values were measured to be as high as 73 TCU after four (4) hours of pumping, to 13 TCU at the six (6) hour;
- pH of the water ranged between 7.99 and 8.25 pH units throughout the pumping test; and
- TDS values range from between 233 and 258 mg/L; and
- Conductivity values were measured to be between 463 and 519  $\mu$ s.

LRL returned to the Site on October 21, 2022, to collect a raw water sample for Trace Metals. The laboratory certificates of analysis are included in **Attachment G. Table 4** summarizes the water analysis and includes the relative ODWS (O. Reg. 169/03) for the trace metal parameters tested.

All metal parameters analysed were below the respective OWDS, with the exception to Manganese which was reported with a value of 0.07 mg/L, above the ODWS of 0.05 mg/L. Elevated manganese can result in a brown or rust-colour discoloration to water and may cause staining to faucets, sinks, or laundry. As the levels are considered marginally above the ODWS, it is considered acceptable to treat these elevated concentrations with a water softener system, as mentioned above for the treatment of hardness.

### 5.3.2 Supply Aquifer – Additional Sampling

To address the minimum parameters outlined in the previous pre-consultation, and those outlined in the Wellhead Protection Plan Report (Jacques Whitford, 2004), LRL returned to the Site on November 23, 2023, to collect an additional water sample from the supply well on the Site. The sample was collected directly from the pressure tank, located within the storage room of the convenience store on the Site. The tap was allowed to run for approximately ten (10) minutes, to allow for the supply line to be flushed, and to permit for a representative sample to be collected. The Site was in operation at the time of the sample collected, and throughout the initial flushing of the lines, audio observations of the pressure tank being re-filled, was encountered.

Laboratory supplied bottles were labelled clearly to indicate the sample identification, date and other required information for submission purposes. After the ten (10) minutes of the lines being flushed, new gloves were donned, and each bottled was filled.

In field measurements revealed that chlorine residual was below the detection limit of the equipment (<0.01 mg/L). The water samples were collected using laboratory prepared bottles and were submitted to an accredited laboratory (Parcel Laboratories Ltd. of Ottawa, Ontario) for analysis of a standard “subdivision” package, VOCs, petroleum hydrocarbons (PHC) Fractions

F1 through F4, trace metals, and polycyclic aromatic hydrocarbons (PAH). The laboratory certificates of analysis are included in **Attachment I**.

**Table 2, Table 4** through **Table 6** summarizes the water analysis and also includes the relative ODWS (O. Reg. 169/03) for the parameters tested. The water samples meet the ODWS parameters tested except for the following:

- Hardness was found to be 203 mg/L, above the ODWS OG limit of 100 mg/L. High levels of hardness can lead to scale deposits and excessive utilization of regular soaps. Hardness can be reduced through the use of a water softener; however the use of sodium chloride as a regenerant for the resins can increase the sodium content of the water. This poses a lower risk to the subject site based on it's anticipated use, although it should be noted that for individuals with sodium restricted diets, potassium chloride can be substituted for sodium in the ion exchange system to lower the hardness in the water supply.
  - The Langelier Saturation Index (LSI), as presented in **Table 3**, is discussed above, with respect to the samples collected at the time of the six (6) hour pumping test. Using a water temperature of 10°C, the LSI was calculated for the 6-hour sample of 0.40 which indicate the water is slightly scale forming and corrosive. The RI was calculated to be 7.1 at the 6 hours sample which indicate significant corrosion potential.
- Total Coliforms were detected with a value of 1 CFU/100 mL, respectively. The ODWS has a MAC of 0 CFU/100 mL for total coliforms in a drinking water system. According to the MECP D-5-5 guideline, a maximum concentration of 5 CFU/100 mL is considered reasonably treatable. The values obtained are considered to be reasonable treatable. Microbial impacts can be treated through the use of an ultraviolet disinfection system.
- Iron levels were measured to be 0.5 mg/L, above the ODWS AO of 0.3 mg/L. This level is below the D-5-5 treatability limit of 10 mg/L. Iron can be reduced through the use of a water softener; however, the use of sodium chloride as a regenerant for the resins can increase the sodium content of the water. This poses a lower risk to the subject site based on it's anticipated use, although it should be noted that for individuals with sodium restricted diets, potassium chloride can be substituted for sodium in the ion exchange system to lower the hardness in the water supply.

No VOC, PHC or PAH parameters were detected in the samples collected, and all trace metals detected were below the applicable provincial drinking water standards, including manganese, which was previously detected in excess of the AO – ODWS in the October 17, 29023 sample collected.

## 6 WATER SUPPLY ASSESSMENT

Based on the Site's geology and hydrogeology the recommended potential supply aquifer for the Site, is the bedrock aquifer. The existing supply well currently intercepts this aquifer, and it is our understanding that the proposed re-development of the Site will utilize the existing well. The selection of this aquifer is supported by the following:

- Although the unconfined sand, gravel and boulder layer formation between 0 – 3.0 m (Sand) and 3.0 – 9.1 m (Gravel & Boulders) may be considered a suitable layer for the construction of a supply well, based on the proposed use of the Site being considered 'high risk' for possible shallow groundwater impacts, is considered unsuitable for the construction of a well within this layer. The risk to impairment of the on-Site water supply,



as well as the possible pathway for contaminants in the shallow soils is considered too great of a risk to explore this as a potential supply aquifer.

- No records of neighbouring shallow supply wells were returned which suggests it may not be a suitable source.
- The well is existing, and the client intends to keep the existing well for the proposed re-development on the site. The construction of a new supply well is not considered necessary, therefore other potential aquifers were not explored.

The water quantity assessment will demonstrate that:

- The water taking will not result in interferences which will impair existing or future on-Site and adjacent land use and groundwater use.

#### 6.1.1 Demand

The average daily flow demand was estimated based on the anticipated daily flow demand of 7 720 L/day over a 12-hour period as 16.08 L/min. Although the facility operates 24-hour daily, it is considered a more conservative approach to establish peak demand within 12-hours which is often the time period which a fuel dispensing facility would encounter greater 'traffic'.

For general consideration, and although not the anticipated volume to be met at the Site during operations, the maximum daily flow is often estimated based on a multiplier of 1.5 the average daily flow. This is intended to confirm the aquifer can meet this arbitrary value in the event of a possible isolated increase in demand. The maximum daily flow is estimated as 11 580 L/day or 16.08 L/min (1.5 times the average daily flow, over a 12-hour period) and the peak hourly flow is estimated as 19.30 L/min (1.8 times the maximum daily flow).

## 7 TERRAIN ANALYSIS

The terrain analysis was conducted to demonstrate that the unconsolidated material on the Site is appropriate for the construction of an on-Site subsurface sewage disposal system on the Site. The subject property is currently developed with a sewage disposal system, however, to support the re-development and Site up-grades, a new structure and associated components will be constructed in accordance with the Ontario Building Code, 2012. The proposed location of the newly constructed sewage disposal system is presented in **Figure 11**. Details pertaining to specific design are not included herein. A formal submission to the Ottawa Septic System Office (OSSO) has been made by the client, or those engaged on their behalf. A copy of the formally issued septic permit, as issued by the Ottawa Septic System Office (OSSO) is included in **Attachment J**.

The Site is not considered Hydrogeologically Sensitive in regard to geological formations. Review of geological mapping and additional supporting documents, including MECP water well records, have revealed a deposit of overburden greater than 1.5 m in thickness. This was further confirmed through the advancement of boreholes across the Site at the time of additional sub-surface investigation fieldwork completed by LRL, in support of the proposed development application. These additional investigations included a Geotechnical Investigation and a Phase II Environmental Site Assessment. No bedrock outcrops were encountered at the time of LRLs Site visits associated with the corresponding investigations and assessments.

Subsurface conditions encountered during these studies are summarized as follows, although greater detail is available in the corresponding reporting documents completed for the respective investigations. Copies of the borehole logs from the Phase II Environmental Site Assessment and



Geotechnical Investigation are included in **Attachment D**, and further detail pertaining to each summary, including chemical analysis and conclusions are provided in Section 4.2.

As part of the geotechnical investigation, select soil samples were submitted for laboratory gradation analyses. The results of these analysis are summarized as follows:

Sample Location	Depth (m)	Percent for Each Soil Gradation							Estimated Hydraulic Conductivity K (m/s)
		Gravel		Sand			Silt (%)	Clay (%)	
		Coarse (%)	Fine (%)	Coarse (%)	Medium (%)	Fine (%)			
BH1	1.5-2.1	0.0	0.0	0.1	24.0	66.1	8.9	0.9	$2 \times 10^{-7}$
BH2	3.1-3.7	0.0	0.0	0.2	0.4	5.4	51.6	42.4	$1 \times 10^{-7}$
BH3	4.6-5.2	0.0	12.0	5.9	9.1	26.6	42.7	3.7	$2 \times 10^{-6}$

The subsurface conditions indicated for the Site are considered suitable for a Class IV septic sewage disposal system with a partially to fully raised leaching bed depending on the Site-specific soil and groundwater conditions at the actual location of the proposed septic system leaching bed. The leaching bed should be constructed to conform to the specifications set out in the Ontario Building Code (OBC).

As part of this assessment, an analysis was carried out to ensure that sufficient space exists at the proposed lot for the construction of a septic system in accordance with the OBC. As a conservative approach to determining the expected largest septic system envelope required to service a commercial gasoline service station establishment at the Site, a septic system envelope size was calculated assuming a fully raised bed with mantle, a percolation rate of 12 min/cm for the imported sand required and a daily sewage flow of 7 720 L.

The total length of pipe required for the septic bed, and as described in greater detail in the included approved proposed septic design, and permit (**Attachment J**), assuming imported fill, was calculated as approximately 84 m:

$$L = QT/200$$

where L = length of pipe (m)

Q = daily sewage flow for the proposed development (L/day)

T = percolation rate of the imported sand fill material (min/cm)

Assuming a Norweco HK 4730L-3M treatment unit is used, the anticipated pipe runs will include two (2) cells, each with 6 runs and 7 m in length. All details related to the proposed installation, sizing of the equipment, and features are included in **Attachment J**, and should be referenced as part of this Terrain Analysis. Therefore, an area of approximately 772 m<sup>2</sup> is required for the septic bed. A mantle of 15 m in length would be required along the down gradient portion of the bed. Based on the total coverage of the septic bed (raised portion and mantle plus a replacement area) would be approximately 1 784 m<sup>2</sup>.

The Site has a surface 11 920 m<sup>2</sup>, of which, approximately 3 525 m<sup>2</sup> is considered suitable for placement of the sewage disposal system, which encompasses the north/northwestern portion of the property. Sufficient area of replacement area and mantle exists on the Site in accordance



with the OBC to service the proposed development with a design sewage flow of up to 7 720 L/day. A proposed development layout plan is presented in **Figure 10** which provides visual support to this. A copy of the approved septic permit is included in **Attachment J**.

## 8 PRIVATE SEWAGE DISPOSAL SYSTEM IMPACT STUDY

Section 5.2, Groundwater Impact Assessment in Non-Designated Areas, of the MECP's Procedure D-5-4 outlines the three (3) step assessment process for evaluating the potential risk for "*every proposed development involving on-site sewage systems*". The steps are intended to be followed in succession, where the conditions established in the previous step determine whether it is necessary to move on to the next step.

Step one of the assessment processes is **Lot Size Consideration**. If it can be demonstrated that the area of the Site is not hydrogeologically sensitive, developments with lots that average 1 hectare (with no lot smaller than 0.8 ha) may not require a comprehensive hydrogeological assessment. It is expected that attenuative processes inside a one (1) hectare parcel of land will be adequate to decrease the nitrate-nitrogen to a satisfactory focus in groundwater underneath contiguous properties. The Site has a surface area of 11 920 m<sup>2</sup> (1.19 hectare), which meets the Lot Size Consideration. However, the Site is considered Hydrogeologically Sensitive due to its proximity to the wellhead capture zone for the neighbouring Albion Sun Vista communal supply well system as discussed above in Section 2.7.2. Therefore, the proceeding steps identified in the guidelines are to be considered.

Step Two is **System Isolation Considerations**, which evaluates the risk to groundwater from septic effluent, where geological setting and characteristics present suitable isolation conditions. Such conditions are most often supported by a lower hydraulic or physical boundary of the receiving groundwater. Such boundaries can include a thick layer of underlying soils with low permeability (i.e. clays).

As discussed above in Section 2.7.2, the subsurface conditions on the Site generally include Fill and Sand to depths between 2.8 and 6.7 m bgs. This is considered the proposed receiving layer for septic effluent based on the depths encountered and that the proposed septic bed will be a fully in-ground system (see **Attachment J** for details). Although a confining clay layer has been identified on the northern portion of the Site, it has not been confirmed as being 'widespread' across the Site. The **System Isolation Consideration** approach is not considered suitable for the Site, therefore Step Three of the assessment will be applied for the Site.

The **Contaminant Attenuation Consideration (Predictive Assessment)** was used to determine the potential risk to groundwater resources on- and off-Site resulting from the proposed on-Site septic systems. More specifically, to confirm that the concentration of nitrates at the boundary of the Site are in accordance with the MECP's Procedure D-5-4: Technical Guideline for Individual On-Site Sewage Systems: Water Quality Impact Risk Assessment. The potential risk to off-Site receptors from the proposed upgraded sewage disposal system has been considered using the inferred nitrate contamination loading for commercial / industrial property use. Section 5.6.3 of the D-5-4 Guideline pertains to Predictive Assessment - Industrial/Commercial Development. The procedure (MECP's Procedure D-5-4 (1996)) followed for this study specifies a maximum allowable concentration of nitrate in the groundwater of 10 mg/L at the property boundary.



To support the corresponding estimation of anticipated nitrate concentration at the property boundary, nitrate dilution calculations for commercial / industrial properties were considered. The following details were included in the calculation used:

- Infiltration factors for the Site;
  - A total area of 11 920 m<sup>2</sup> (1.19 hectare);
  - Flat topography;
  - Infiltration Factors (Post Re-Development), and in accordance with Table 3.1 of the MECP Stormwater Management Planning and Design Manual (March 2003):
    - i. Grain size analysis of the shallower soils more likely to intersect the septic effluent, as referenced above in Section 7, generally includes fine to medium grained sand;
    - ii. Approximately 9 113 m<sup>2</sup> of the site is considered Cultivated Land, and 2 807 m<sup>2</sup> is considered to be woodland;
  - Moisture Surplus (Post Re-Development):
    - i. The cultivated land (lawn and grassed area) is considered Shallow Rooted Crops, whereas the woodland at the general perimeter of the property is considered Deep Rooted Crops;
    - ii. Laboratory grain size analysis revealed the overburden material, anticipated to be impacted by the septic bed, is sand;
  - Impervious areas (proposed development footprint) were calculated to be of 4 980 m<sup>2</sup> for the proposed convenience store building, pump island concrete apron and paved parking and circulation area. This equates to hard surface area, post re-development, of 41.7% of the subject property;
  - Background nitrate concentrations in the receiving aquifer will be inferred negligible (0 mg/L used in the calculation);
  - Moisture surplus values from the Ottawa weather station (Environment Canada, 2011). The moisture surplus printouts for the City of Ottawa are included in **Attachment K**; and
  - The use of an advanced tertiary treatment system, which is discussed in greater detail below, with a capability to treat nitrate concentrations of the effluent to at least 15 mg/L (67% nitrogen reduction).

The available infiltration, using the values and considerations identified above, has been calculated as 2 261 m<sup>3</sup>/year for the Site. A summary of the calculation is presented in the included **Table 4**. As indicated in Section 5.6.3 (b) of the D-5-4 Guideline, “*The maximum allowable flow for each lot or block in the industrial/commercial development can be calculated by dividing the amount of available infiltration by a factor of three*”. This calculation assumes a nitrogen concentration of the effluent being 40 mg/L.

As discussed above in Section 7 and detailed in the OSSO approved Septic Permit included in **Attachment J**, an advanced tertiary treatment system is proposed as part of the Site re-development. Most often, tertiary treatment systems are considered to have the capability to reduce effluent nitrate levels to 20 mg/L from the non-treated standard value of 40 mg/L. The proposed tertiary treatment system, Norweco HK 4730L-3M, has the capability to reduce nitrates to at least 15 mg/L (67% nitrogen reduction). The specifications for the proposed unit are included in **Attachment L**.



As the septic system will be able to achieve a nitrate reduction of 67%, the factor included in the Predictive Assessment calculation has been adjusted from 3 (for conventional – non advanced treatment sewage disposal systems) to a value of 0.75. The Table below demonstrates Predictive Assessment calculation for establishing the maximum daily septic flow inferred for the Site assuming the advanced tertiary treatment system. Consideration to the use of a conventional treatment system (40 mg/L effluent nitrate concentration), as well as an alternative tertiary treatment system with a 50% nitrate reduction (20 mg/L effluent nitrate concentration) is also included in the following table, for demonstration of the value to support the proposed Norweco HK 4730L-3M unit.

Site Area (m <sup>2</sup> )	Impervious Area (m <sup>2</sup> )	Available Infiltration (m <sup>3</sup> /year)	Effluent Nitrate Concentration (mg/L)	Annual septic flow required for the Site (m <sup>3</sup> /year) <sup>1</sup>	Predictive Assessment Calculation Factor	Maximum allowable septic flow (m <sup>3</sup> /year)
11 920	6 940	2 261	40	2 818	3	754
11 920	6 940	2 261	20	2 818	1	2 261
11 920	6 940	2 261	15	2 818	0.75	3 014

**Notes**

XXX Does not meet the annual septic flow required for the Site

XXX Meets the annual septic flow required for the Site

1 Calculated based on the assumption of 7,720 L/day, multiplied by 365 days

As presented above, the Contaminant Attenuation Consideration (Predictive Assessment) demonstrates that through the use of the advanced tertiary septic treatment system, with an effluent nitrate concentration of 15 mg/L, the risk for impairment to the groundwater is considered low. The annual septic flow for the Site of 2 818 m<sup>3</sup> will be met with a calculated maximum allowable septic flow of 3 014 m<sup>3</sup>, with nitrate reduction technologies.

Based on these considerations, the current Site conditions are suitable to attenuate the nitrate impacts generated by the septic systems on the development in accordance with current D-5-4 guidelines, provided an appropriate tertiary treatment is used and maintained. **The system must be able to treat the effluent to a nitrate level of 15 mg/L or less.** The potential impacts related to the use of the sewage disposal system on the Site, with respect to natural features, and shallow groundwater conditions is low risk. Furthermore, supply wells in the area retain their water supply from deeper bedrock aquifer which is confined by a thick overburden layer, therefore the on-Site septic system will have little to negligible impacts to the neighbouring water supply.



## 9 WELLHEAD PROTECTION AREA – SITE SPECIFIC RISK PREVENTION MEASURES

It is the responsibility of the Site Owner to follow and enforce the following site-specific risk prevention measures for all general daily operations, or future renovations, re-development or construction activities. At this time, the Site is owned and operated by MacEwen Petroleum Inc. If future land transactions or ease agreements occur, the following must be implemented by the respective parties overseeing, managing or operating the Site. A Construction Risk Management Plan for Source Water Protection, a Spills Prevention and Risk Management Plan (which will include staff training and record keeping as a risk management measure), and the Monitoring Program will be prepared to provide greater detail on the risk management and mitigation measures to be implemented.

WELLHEAD PROTECTION AREA – SITE SPECIFIC RISK PREVENTION MEASURES		
Responsible Party	Risk Prevention Measure	Discussion
Site Owner	Follow the specific recommendations set out in the <i>Wellhead Protection Area Plan</i> documentation prepared by Trow Associates Inc. and Jacques Whitford Environmental Limited, dated June 2004 to protect the communal supply aquifer.	<p>Ensure that during work, or general Site operations, that source protection measures of the neighbouring supply well sand and gravel contact zone layer be implemented. These measures include:</p> <ul style="list-style-type: none"> <li>• Ensuring equipment on Site is maintained and is in property operating order.</li> <li>• Manufacturer service, inspection and maintenance schedules are followed. Including but not limited to the on-site sewage disposal system, and fuel dispensing / storage equipment.</li> <li>• Governing authority (i.e. TSSA) inspection and reporting requirements are completed, and accurately documented.</li> <li>• Fuel dispensing and storage equipment must include properly functioning interstitial monitoring system. Leak detection units must also equip the tanks and associated piping.</li> <li>• The details of the S Spills Prevention and Risk Management Plan are implemented.</li> <li>• Ensuring that operators, tenants, contractors, employees and other occupants of the Site are aware of the risks associated with the sensitive receptor and are formally trained on the procedures, risks and measures to be implemented relating to the site.</li> <li>• All wells constructed or located on the Site (supply and monitoring wells) are constructed accordingly, by an O. Reg. 903 licensed well installer, so that there is prevention of downward drive of contamination through the low permeable layer into the supply aquifer.</li> <li>• Ensure that it is communicated that snow piling is not permitted in the 15 m distance from the supply well on the Site.</li> <li>• That the supply well casing be maintained a minimum of 40 cm above grade.</li> <li>• That the supply well be constructed according to O. Reg. 903 and maintained as per O. Reg. 903. This includes a</li> </ul>

		<p>proper fitted cap, grading away from the structure and any work related to the supply well (i.e. pump replacement) be followed by disinfection.</p> <ul style="list-style-type: none"> <li>• Protective bollards or barriers be maintained around the supply well to prevent damaged.</li> <li>• Grading around the well is such as presented in the Site re-development grading plans and is maintained.</li> <li>• A qualified person, such as a professional geoscientist or a professional engineer must be retained to review the installation and sealing of well casings installed on the Site.</li> <li>• Retain the services of an environmental professional to formalize, and execute an annual groundwater quality monitoring program, as outlined in the corresponding Monitoring Program.</li> <li>• Take action to remedy and remediate impacted subsurface conditions and report the findings (during on-site construction, or groundwater monitoring) to the local MECP and the TSSA authorities. This shall be done with assistance from a qualified person (such as a professional geoscientist or a professional engineer in the environmental field).</li> <li>• Support the repair and maintenance of groundwater monitoring wells on the Site, as deemed required by the qualified person (such as a professional geoscientist or a professional engineer in the environmental field).</li> <li>• Comply with the Environmental Compliance Approval issued to the site, and all the respective conditions.</li> </ul>
<p>Site Owner (Continued)</p>	<p>Do not permit the land use to become such which may cause further risk to the supply aquifer.</p>	<p>Have a representative frequent the property to ensure that the Site continues to operate in a fashion which respects the points mentioned above.</p> <p>Ensure that the Site is well kept, with no excessive storage of potential hazardous materials.</p> <p>Ensure that operations on the Site do no include heavy industrial uses, mineral extraction, waste disposal, or other light industrial uses which are known to be a high risk for potential environmental concern such as automotive repair operations or chemical refinement.</p>
	<p>Have received a copy, have reviewed, and clearly understands the items included in the Spills Prevention and Risk Management Plan for the Site.</p>	<p>A Spills Prevention and Risk Management Plan will be prepared for the Site.</p> <p>In the event of a land transaction, or change in Site operator, a copy of this plan must be transferred to the new owner/operator, to ensure that they:</p> <ol style="list-style-type: none"> <li>1. Create one of their own which follows the points included and</li> <li>2. Are clear on the sensitive requirements of the Site and neighbouring lands.</li> </ol>



	<p>Have received a copy, have reviewed, and clearly understands the items included in the Employee &amp; Contractor Training Plan.</p>	<p>This plan will be included in the Spills Prevention and Risk Management Plan to be prepared.</p> <ol style="list-style-type: none"> <li>1. Create one of their own which follows the points included and</li> <li>2. Are clear on the sensitive requirements of the Site and neighbouring lands.</li> </ol>
	<p>Have received a copy, have reviewed, and clearly understands the items included in the Construction Risk Management Plan for Source Water Protection.</p>	<p>A Construction Risk Management Plan for Source Water Protection will be prepared for the Site.</p>
<p>Site Operator</p>	<p>Follow the specific recommendations set out by the Owner with respect to the in the Wellhead Protection Area Plan.</p> <p>The Operator is Responsible to ensure that Staff and Contractors are aware of the Wellhead Protection Area restrictions, and measures to be applied.</p> <p>More specific duties and roles are included in the adjacent column.</p>	<ul style="list-style-type: none"> <li>• Notify the Owner if equipment on the Site, and specific to the Site (i.e. Septic) requires assistance, maintenance or does not appear to be operating accordingly.</li> <li>• In conjunction with the Site Owner, and at times, specific to the Site Operators Equipment, ensure that manufacturer service, inspection and maintenance schedules are followed. Including but not limited to the on-site sewage disposal system, and fuel dispensing / storage equipment.</li> <li>• Governing authority (i.e. TSSA) inspection and reporting requirements are completed, and accurately documented when related to Site Operator specific equipment.</li> <li>• The Spills Prevention and Risk Management Plan specific requirements and details are implemented.</li> <li>• Ensuring that tenants, contractors, employees and other occupants of the Site are aware of the risks associated with the sensitive receptor and are formally trained on the procedures, risks and measures to be implemented relating to the site.</li> <li>• Ensure that snow piling is not permitted in the 15 m distance from the supply well on the Site.</li> <li>• That the supply well casing be maintained a minimum of 40 cm above grade.</li> <li>• Protective bollards or barriers be maintained around the supply well to prevent damaged. If damaged, the Site Owner must be notified.</li> <li>• Comply with the Environmental Compliance Approval issued to the site, and all the respective conditions that apply to Site operations.</li> </ul>
	<p>Do not permit the land use to become such which may cause further risk to the supply aquifer.</p>	<p>Have a representative frequent the property to ensure that the Site continues to operate in a fashion which respects the points mentioned above.</p> <p>Ensure that the Site is well kept, with no excessive storage of potential hazardous materials.</p> <p>Ensure that operations on the Site do no include heavy industrial uses, mineral extraction, waste disposal, or other light industrial uses which are known to be a high risk for potential environmental</p>



		concern such as automotive repair operations or chemical refinement.
	Have received a copy, have reviewed, and clearly understands the items included in the Spills Prevention and Risk Management Plan for the Site.	A Spills Prevention and Risk Management Plan will be prepared for the Site. <ol style="list-style-type: none"> <li>1. Create one of their own which follows the points included and</li> <li>2. Are clear on the sensitive requirements of the Site and neighbouring lands.</li> </ol>
	Have received a copy, have reviewed, and clearly understands the items included in the Employee & Contractor Training Plan.	This plan will be included in the Spills Prevention and Risk Management Plan to be prepared. <ol style="list-style-type: none"> <li>1. Create one of their own which follows the points included and</li> <li>2. Are clear on the sensitive requirements of the Site and neighbouring lands. Including excavation limitations to protect the aquifer.</li> </ol>
Site Contractor	Follow the specific recommendations set out by the Site Operator with respect to the in the Wellhead Protection Area Plan.	<ul style="list-style-type: none"> <li>• Notify the Operator (or Staff Representative) if equipment on the Site, requires assistance, maintenance or does not appear to be operating accordingly.</li> <li>• Conduct respective activities in a fashion which is respectful to the sensitive features of the Site, and mitigate the risk of impacts to the supply aquifer (See Spills Prevention and Risk Management Plan).</li> </ul>
	Have received a copy, have reviewed, and clearly understands the items included in the Spills Prevention and Risk Management Plan for the Site.	A Spills Prevention and Risk Management Plan will be prepared for the Site. <ol style="list-style-type: none"> <li>1. Create one of their own which follows the points included and</li> <li>2. Are clear on the sensitive requirements of the Site and neighbouring lands.</li> </ol>
	Have received a copy, have reviewed, and clearly understands the items included in the Employee & Contractor Training Plan.	This plan will be included in the Spills Prevention and Risk Management Plan to be prepared. <ol style="list-style-type: none"> <li>1. Create one of their own which follows the points included and</li> <li>2. Are clear on the sensitive requirements of the Site and neighbouring lands.</li> </ol>
	Have received a copy, have reviewed, and clearly understands the items included in the Construction Risk Management Plan for Source Water Protection.	This is only applicable during the proposed Site re-development discussed in this report. Future projects will require specific plans for contractors to follow.
Site Employee	Follow the specific recommendations set out by the Site Operator with respect to the in the Wellhead Protection Area Plan.	<ul style="list-style-type: none"> <li>• Notify the Operator (or Staff Representative) if equipment on the Site, requires assistance, maintenance or does not appear to be operating accordingly.</li> <li>• Conduct respective activities in a fashion which is respectful to the sensitive features of the Site, and mitigate the risk of impacts to the supply aquifer as set out in the Spills Prevention and Risk Management Plan and included Employee &amp; Contractor Training Plan.</li> </ul>



	Have received a copy, have reviewed, and clearly understands the items included in the Spills Prevention and Risk Management Plan for the Site.	A Spills Prevention and Risk Management Plan will be prepared for the Site.  1. Create one of their own which follows the points included and 2. Are clear on the sensitive requirements of the Site and neighbouring lands.
	Have received a copy, have reviewed, and clearly understands the items included in the Employee & Contractor Training Plan.	This plan will be included in the Spills Prevention and Risk Management Plan to be prepared.  1. Create one of their own which follows the points included and 2. Are clear on the sensitive requirements of the Site and neighbouring lands.
MECP	Ensure that the conditions of the ECA are met and issue orders are required to ensure compliance.	Should reported aquifer impairment be noted, the MECP must consult with the Owner and Operator to address the issue and come to a plan of resolution.

## 10 SUMMARY AND CONCLUSIONS

Based on the results of this investigation the following summary and conclusions are provided.

- The subject Site is located within a generally rural residential and commercial area of Ottawa, at the northwest corner of the intersection of Albion Road, and Mitch Owens Road. The Site is presently developed and operated as a retail petroleum dispensing facility equipped with six (6) gasoline dispensing pumps, one (1) diesel dispensing pump, and five (5) underground storage tank located at the general southeastern portion of the Site. The Site has operated as a fuel dispensing facility since at least the mid to late 1990's.
- The Hydrogeological Assessment & Terrain Analysis was completed in support of the proposed site re-development and associated Site Plan Application submission to the City of Ottawa. It is anticipated that the existing fuel dispensing facility will be re-developed to include new fuel storage and dispensing equipment, and convenience store serviced by a private water supply well and sewage disposal system.
- The proposed construction activities associated with the re-development will include the removal and replacement of the underground petroleum storage tanks. The excavation associated with the installation of underground storage tanks of this size (two (2) at 65,000 L capacity and two (2) at 25,000 L capacity) generally extends to a depth of approximately 4.2 m below grade, which includes 0.6 m of granular underlying the installations.
- The Site is irregular shaped being generally rectangular with a portion of the southeastern extent being reduced. The Site is between approximately 85 and 110 m wide (east-west) by between 90 and 115 m deep (north-south) for an approximate surface area of 10 920 m<sup>2</sup> (2.7 acres).
- The topography of the Site and neighbouring lands is generally flat with a gentle slope to the south, towards Mitch Owens Road.
- The Site is fitted with storm water structures, including catch basins and buried catchment drainage piping. These systems set in place are used to collect and control surface runoff across the Site and distributes it into accepted City services and infrastructure for further off-Site handling. No swales or drainage courses are present on the subject Site. A municipal ditch however does run in a general east-west direction along Mitch Owens Road, along the adjacent lands to the west. Based on the topography of the site, and site



features, it is inferred that the property drainage pattern flows south towards Mitch Owens Road.

- A watercourse is located on the neighbouring property to the west, however the City of Ottawa identifies it as a 'ditch'. The neighbouring lands to the north, are identified to contain unevaluated wetlands according to provincial mapping systems (Ministry of Natural Resources and Forestry, Make a Map: Natural Heritage Areas).
- Surficial soil deposit mapping indicates that the surficial geology is fine- to medium-grained sand, calcareous and commonly fossiliferous; nearshore sand generally occurs as a sheet or as bars or spits associated with glaciofluvial materials. Bedrock mapping indicates that the bedrock is described as the Oxford Formation: dolomite and limestone.
- The Site is located within the wellhead capture zone for the neighbouring Albion Sun Vista communal supply well system. This communal well is located downgradient (south) of the subject Site, following Mitch Owens Road and is sourced by the shallow bedrock aquifer which is hydraulically connected to the sand/gravel/till overburden recharge zone.
- As part of this assessment, a desktop review of potential sources of contamination to the supply aquifer was completed. This review was completed with general reference to Ontario Regulation 153/04. The review revealed the following potential sources of contamination, and the corresponding PCA as set out by Ontario Regulation 153/04:
  - Petroleum handling and dispensing facility operations and associated equipment on the Site;
  - Aggregate extraction facility located approximately 390 m northeast and 600 m east of the Site; and
  - The historical industrial/commercial development previously occupying the property located immediately east of the Site, which historically included a fueling station along the southern extent of the property, an above-grade storage container (tank) associated with the fueling station, and the numerous pieces of heavy machinery and large vehicles are visible across the property through historical aerial imagery reviewed.
- A search was conducted of the well records from the MECP Water Well Record revealed 70 wells recorded within an approximately 500 m radius of the Site. The records of the wells within 500 m of the Site revealed that the wells are drilled wells extending to depths between 14.0 and 67.9 m. Geological conditions within 500 m are generally similar and consist of sand or sand and gravel mix, followed by clay over bedrock. Glacial till material was encountered in select wells retrieved, and additionally, clay was not identified in all locations. The bedrock typically includes limestone, sandstone, or a combination of both.
- Four (4) groundwater monitoring wells were constructed on the Site as part of a Phase II Environmental Site Assessment completed in support of the proposed Site re-development application. The wells were advanced to depths of approximately 4.5 m bgs. Groundwater levels measured in the installations were recorded to be between 1.77 and 1.98 m bgs, which corresponded to elevations between 98.15 and 98.43 m, with respect to an arbitrary benchmark established and assigned an elevation of 100.00 m.
- Groundwater sampling of the shallow groundwater monitoring wells installed on the Site, and the corresponding chemical analysis for VOC, PAH and PCB parameters revealed that concentrations were below the laboratory method detection limits, with the exception to PHC F3 and F4 parameters detected in a single location. The levels encountered were measured below the respective site condition standard. Select metal parameters were

detected, however all levels are below the applicable site condition standards with the exception of sodium in each groundwater monitoring well location, and Chloride at the majority of the sample locations.

- During the proposed re-development activities of the Site, an environmental remediation program will be implemented to address the identified or anticipated impacted overburden across the southern extent of the Site. The environmental remediation program will support the future protection of the on-Site supply well, in addition to the further protection of additional natural features and aquifers from possible contamination and damage in the long term. As presented in the Phase II Environmental Site Assessment, and discussed above in this section, generally contaminants associated with fuel handling facility were not encountered, although suspected to be present in the surrounding soils encompassing the underground storage tanks, and in the area of the pump islands, which could not be investigated due to the risk of damaging the fuel handling equipment. Following the TSSA Environmental Management Protocol for Fuel Handling Sites in Ontario, August 2012 (formerly GA1/99), contaminated soils will be remediated to conditions which meet the corresponding site conditions standards, as best possible. Caution will be taken to not puncture the confining clay barrier, when encountered, which acts as a protective layer to the neighbouring supply aquifer. Should restrictions to the excavation activities be encountered, alternative remediation methods will be implemented.
- Based on the proposed re-development attributes, the anticipated average daily flow demands of the proposed development have been evaluated based on the septic design. The daily flow demand is estimated based on the total daily design sanitary sewage flow, calculated as per Table 8.2.1.3.B of the Ontario Building Code, 2012. The anticipated daily flow demand is 7 720 L/day.
- With consideration to the average daily flow demand, a 6-hr pump test was conducted on the existing supply well. The well was pumped at a constant flow rate ( $\pm 5\%$ ) of approximately 30 L/min over 6-hr period. The drawdown after 6-hr of pumping was 1.55 m which represents only approximately 4.0% of the available drawdown in the well. The specific capacity of the well after 6-hr of pumping was calculated to be 0.322 L/sec/m with a long-term availability of 51.1 m<sup>3</sup> per day. The recovery was commenced at the end of the 6-hr pumping duration. After one (1) hour of recovery, the well returned to 97.4% of the initial water level (3.02 m btc).
- Based on the observed drawdown/recovery relationship, it is concluded that the long-term yield of the test well is in excess of minimum daily demand of 7 720 L (8.62 m<sup>3</sup>/day) and is found to be able meet a maximum pumping rate of 128.9 L/minute. This is considered sufficient to supply the inferred average and peak hourly flow demands of 16.08 L/min and 19.30 L/min, respectively.
- To represent the long-term water quality of the well, samples were collected during different stages of the pump test (after 3 and 6-hours of pumping), and shortly thereafter. The water samples meet the ODWS parameters tested except for the following:
  - Hardness was found to be 204 and 219 mg/L at 3- and 6-hours, respectively, above the ODWS OG limit of 100 mg/L;
  - Turbidity was measured to have a level of 4.2 NTU in the 3-hour sample, and 8.8 NTU in the 6-hour sample. Both of which are above the ODWS OG of 1 NTU if the treatment system is required to provide filtration and, the 6-hour sample is above the AO of 5 NTU;



- All trace metal parameters analysed were below the respective OWDS, with the exception to Manganese which was reported with a value of 0.07 mg/L, above the ODWS of 0.05 mg/L;
  - Sulphide concentrations were reported as 0.12 mg/L after 6-hours of pumping, above the 0.05 mg/L ODWS AO. Sulphide can be reduced through aeration, which oxidizes it to sulphate, or an activated carbon filter;
  - Total Coliforms were detected in the samples collected at 3-hours and 6-hours of pumping, with values of 4 and 2 CFU/100 mL, respectively. Microbial impacts can be treated through the use of an ultraviolet disinfection system; and
  - Iron levels were measured to be 0.4 and 0.9 mg/L, above the ODWS AO of 0.3 mg/L. This level is below the D-5-5 treatability limit of 10 mg/L. Iron can be reduced through the use of a water softener.
- Additional water samples collected from the supply well on the Site has confirmed the absence of potential contaminants of concern, related to the Site operations as a petroleum storage and dispensing facility (VOCs, PHC, PAHs).
  - Based on the Site's geology and hydrogeology the recommended potential supply aquifer for the Site, is the bedrock aquifer. The existing supply well currently intercepts this aquifer, and it is our understanding that the proposed re-development of the Site will utilize the existing well. Based on the findings of the Hydrogeological Assessment, it is considered acceptable for the proposed re-development to use the existing supply well on Site.
  - As a conservative approach to determining the expected largest septic system envelope required to service a commercial gasoline service station establishment at the Site, a septic system envelope size was calculated assuming a fully raised bed with mantle, a percolation rate of 12 min/cm for the imported sand required and a daily sewage flow of 7 720 L. An area of approximately 772 m<sup>2</sup> is required for the septic bed. A mantle of 15 m in length would be required along the down gradient portion of the bed. Based on the total coverage of the septic bed (raised portion and mantle plus a replacement area) would be approximately 1 784 m<sup>2</sup>.
  - The Site has a surface 11 920 m<sup>2</sup>, of which, approximately 3 525 m<sup>2</sup> is considered suitable for placement of the sewage disposal system, which encompasses the north/northwestern portion of the property. Sufficient area of replacement area and mantle exists on the Site in accordance with the OBC to service the proposed development with a design sewage flow of up to 7 720 L/day.
  - The proposed sewage disposal system for the Site is the Norweco HK 4730L-3M tertiary treatment unit. The Norweco HK 4730L-3M, has the capability to reduce nitrates to at least 15 mg/L (67% nitrogen reduction).
  - It should be noted that only marginal changes from the current Site use and daily flows are anticipated for the Site (approximately daily flow increase of 1,900 L to account for one (1) additional washroom). The use of an upgraded sewage treatment/disposal system is considered a substantial improvement to the exiting conditions and current effluent concentrations, therefore the use of the proposed Norweco tertiary system will in fact have a beneficial improvement to the Site in comparison to current conditions.
  - Section 5.2, Groundwater Impact Assessment in Non-Designated Areas, of the MECP's Procedure D-5-4 outlines the three (3) step assessment process for evaluating the potential risk for "every proposed development involving on-site sewage systems". The steps are intended to be followed in succession, where the conditions established in the previous

step determine whether it is necessary to move on to the next step. The Contaminant Attenuation Consideration (Predictive Assessment) was used to determine the potential risk to groundwater resources on- and off-Site resulting from the proposed on-Site septic systems. More specifically, to confirm that the concentration of nitrates at the boundary of the Site are in accordance with the MECP's Procedure D-5-4: Technical Guideline for Individual On-Site Sewage Systems: Water Quality Impact Risk Assessment.

- Following the procedures set forth in the D-5-4 Guidelines for the Contaminant Attenuation Consideration (Predictive Assessment) methodology, and assuming an effluent nitrate reduction of 67%, which can reduce nitrates from 40 mg/L to 15 mg/L, the annual septic flow required for the Site of 2 818 m<sup>3</sup>/year will be met with a calculated maximum allowable septic flow of 3 014 m<sup>3</sup>.
- Based on the D-5-4 Guideline considerations, the current Site conditions are suitable to attenuate the nitrate impacts generated by the septic systems on the development in accordance with current D-5-4 guidelines, provided an appropriate tertiary treatment is used and maintained. The system must be able to treat the effluent to a nitrate level of 15 mg/L or less. The potential impacts related to the use of the sewage disposal system on the Site, with respect to natural features, and shallow groundwater conditions is low risk. Furthermore, supply wells in the area retain their water supply from deeper bedrock aquifer, therefore the on-Site septic system is anticipated to have little to negligible impacts to the neighbouring water supply.

## 11 RECOMMENDATIONS

Based on the results of this investigation the following recommendations are provided:

1. It is recommended that the existing supply well at the Site be utilized as a water supply for the proposed re-development features of the Site. The well is found to generally have acceptable groundwater supply for human consumption and will be able to meet the daily supply demands, as determined through the 6-hour pumping test initiated.
2. Stick up of the existing supply well casing must be extended to 74 cm to match the proposed final grade and to include a 40 cm above grade stick up. The addition of a vermin proof cap should also be included to the existing supply well. The requirements for the well modifications in accordance with O. Reg. 903 requires that post well modifications, the well will require formal disinfection. To comply with the O. Reg. 903 requirements, the chlorination requires that the well be not used for between 12 and 24 hours. This will require that the operations of the site be stopped for this duration. As the Site operates as a 24-hour fuel service station, this would require the station to close for a period which is not considered practical at this time. The importance of the well modifications is understood, and it is guaranteed that during the initial stages of the construction activities associated with the re-development (i.e. removing asphalt and cement structures), the required modifications will be completed. The City can request as a condition of occupancy that formal written acknowledgement and evidence that these modification have been completed.
3. As mentioned in recommendation Item 2, the casing of the well must be extended to 0.4 m (40 cm) above ground level. It is also required that protective barriers (bollards) be added around the well structure to prevent possible damage by vehicle traffic. The grading and development plans associated with the development include specific details related to the inclusion of bollards to act as additional protection to the supply well, and requirements for grading at the supply well to divert run-off away from the structure. These

details must be followed so the final grading and development are as specified in the plans.

4. Additional consideration with respect to maintaining the condition of the supply well, and the corresponding supply aquifer include the following:
  - a. Snow should not be piled in the area of the well so as not to potentially damage the supply well;
  - b. A monitoring program of the Site's supply well must be initiated to provide ongoing water quality information. This program will include monitoring on an annual basis for general water quality parameters and metals in addition to parameters often associated with fuel dispensing and handling facilities: petroleum hydrocarbons (PHC) Fractions F1 through F4; and Volatile Organic Compounds (VOCs) including Benzene, Toluene, Ethylbenzene and Xylenes (BTEX). A detailed Groundwater Monitoring scope will be prepared at a later date, as a condition of occupancy permits issuance with the City of Ottawa. The plan will provide details related to :
    - i. Monitoring well locations, depths and construction details;
    - ii. Monitoring well sampling frequency;
    - iii. Provincial criteria, or standards to be applied to the water quality representative of the samples collected, and trigger mechanism to be applied to protect off-Site receptors;
    - iv. Roles and responsibilities relating to the monitoring wells, and corresponding reporting and regulatory submission;
    - v. Procedures and guidelines to be followed to ensure the presence of the monitoring wells to not present a potential pathway for impairment of local supply aquifer resources; and
    - vi. Contingency planning with respect to contaminants of concern including, but not limited to formal reporting procedures, plans of actions, and necessary actions to be taken; and

The proposed monitoring program and included proposed contingency plan will be reviewed by the City of Ottawa as a condition of the approval.

- c. The Site, post- re-development, should be graded such that surface run-off and drainage be diverted away from the supply well, which is demonstrated in the site redevelopment grading plans.
5. The water quality of the supply well is found to be in general accordance with the ODWS. The following exceptions were encountered:
  - a. Hardness was found to be above the ODWS OG limit of 100 mg/L, and manganese exceeded the 0.05 mg/L ODWS. High levels of hardness can lead to scale deposits and excessive utilization of regular soaps, and elevated manganese can result in a brown or rust-colour discolouration to water and may cause staining to faucets, sinks, or laundry. Hardness and manganese can be reduced through the use of a water softener; however the use of sodium chloride as a regenerant for the resins can increase the sodium content of the water. This poses a lower risk to the subject site based on it's anticipated use, although it should be noted that for individuals with sodium restricted diets, potassium chloride can be substituted for sodium in the ion exchange system to lower the hardness in the water supply.

- b. Turbidity was measured to have a level of 4.2 NTU in the 3-hour sample, and 8.8 NTU in the 6-hour sample. Both of which are above the ODWS OG of 1 NTU if the treatment system is required to provide filtration and, the 6-hour sample is above the AO of 5 NTU. Turbidity can be reduced through proper filtration techniques, although it is anticipated that the elevated concentration is a result of a chemical reaction which may have occurred post- sample collection.
  - c. Total coliforms were detected in both the 3- and 6- hour samples collected. Microbial impacts encountered (Total Coliforms) can be treated through the use of an ultraviolet disinfection system.
  - d. Sulphide concentrations were reported as 0.12 mg/L after 6-hours of pumping, above the 0.05 mg/L ODWS AO. Sulphide can be reduced through aeration, which oxidizes it to sulphate, or an activated carbon filter.
6. Water Treatment options should be considered on an individual basis. Any water treatment system should be maintained on a regular basis in accordance with the manufacturer's recommendations to ensure that it is properly functioning and providing a safe drinking water.
7. The water system will be a small drinking water system that is governed by the Ministry of Health and Long-Term Care (MOGLTC). The procedures outlined in O. Reg. 319/08, including procedures for regular testing of the drinking water, upkeep of records of sampling and maintenance, and the protection of the drinking water source must be adhered to. Although it appears that the supply well is hydraulically separated from the shallow overburden aquifer, it is recommended that the drinking water testing include petroleum hydrocarbons and volatile organic compounds.
8. The owner should maintain their supply well as outlined in the Ontario Ministry of Agricultural and Rural Affairs Best Management Series – Water Wells.
9. Risk Management measures are required as the Site is located within the Wellhead Protection Area for the Albion Sun Vista communal wells. The proposed development must adhere to the Well Protection Area Plan prepared by Jacques Whitford (2004), and associated risk management measures. A Construction Risk Management Plan for Source Water Protection, a Spills Prevention and Risk Management Plan (which will include staff training and record keeping as a risk management measure), and a Monitoring Program – will be prepared and reviewed by the City as a condition of the site plan agreement. Once approved, these plans are to be implemented.  
  
Site specific wellhead protection area – prevention measures are generally outlined above in Section 9. These measures must be implemented and will be outlined in the proposed Construction Risk Management Plan for Source Water Protection, a Spills Prevention and Risk Management Plan (which will include staff training and record keeping as a risk management measure), and a Monitoring Program to be prepared.
10. The proposed sewage disposal system for the Site is a Class IV – Filter Media. It is proposed that the system will be fully in-ground with two (2) septic beds, and two (2) 4 730 L capacity Norweco HK 4730L-3M units. The subsurface conditions indicated for the Site are considered suitable for this proposed sewage disposal system. Sewage system designs shall be based on specific investigations to evaluate the suitability of local conditions on each lot. The system should be designed using the percolation time of the native and imported sand and according to the Ontario Building Code (OBC). The leaching beds should be constructed to conform to the specifications set out in the OBC. The septic



systems shall be constructed above the groundwater table over the native soil once all organic soils have been stripped from its footprint.

11. A tertiary treatment system for the septic system is required, such as a Norweco HK 4730L-3M sewage disposal system, or equivalent, which can treat nitrates to a level, at least 67% of that of a conventional system (15 mg/L). It is required that such a system be used, and maintained accordingly by the client to ensure possible off-Site impacts are negligible.
12. A maintenance agreement for the tertiary treatment system must be prepared by the Site Owner and maintained. A condition will be included in the development agreement prepared by the City of Ottawa that indicates that the owner must provide support that a maintenance agreement has been signed for the long-term maintenance of the septic system, as required in the OBC for advanced treatment units.
13. The previous (existing at the time this report was prepared) sewage disposal system must be decommissioned and removed from the Site. Soils which make up the system shall be removed from the Site as 'contaminated' material, and the applicable provincial regulations (i.e. O. Reg. 558) shall be followed in support of the off-Site disposal requirements.
14. The septic system should be placed at least 15 m from any drilled supply wells, 30 m from any shallow/dug wells, and at least 3 m from the property boundary limits.
15. It is recommended that the water table be surveyed prior to installation of the sewage disposal systems by the septic system designer or installer.



## 12 LIMITATIONS

The findings contained in this report are based on data and information collected during the Hydrogeological Assessment & Terrain Analysis of the subject property conducted by LRL Engineering. The conclusions and recommendations are based solely on-site conditions encountered at the time of our fieldwork between October 16<sup>th</sup> and 21<sup>st</sup>, 2022, supplemented by historical information and data obtained as described in this report. The information presented in this report represents the groundwater conditions at the locations sampled. Due to natural variations in geological conditions, no inference is made to the soil or groundwater conditions between sampling points. No assurance is made regarding changes in conditions subsequent to the time of this investigation. If additional information is discovered or obtained, LRL Engineering should be requested to re-evaluate the conclusions presented in this report and to provide amendments as required.

In evaluating the subject property, LRL Engineering has relied in good faith on information provided by individuals as noted in this report. We assume that the information provided is factual and accurate. We accept no responsibility for any deficiencies, misstatements or inaccuracies contained in this report as a result of omissions, misinterpretation or fraudulent acts of the persons contacted.

Yours truly,  
LRL Engineering



Jessica Arthurs  
Environmental Engineering Manager



Kourosh Mohammadi, Ph. D., P. Eng.  
Hydrogeological Engineer





## FIGURES



**LRL**

ENGINEERING | INGÉNIÉRIE

5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

PROJECT

HYDROGEOLOGICAL ASSESSMENT &  
TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO

DRAWING TITLE

SITE LOCATION  
(NOT TO SCALE)  
SOURCE: UCPR A LA CARTE

CLIENT

MACEWEN PETROLEUM INC.

DATE


NOVEMBER 2024

PROJECT





01348

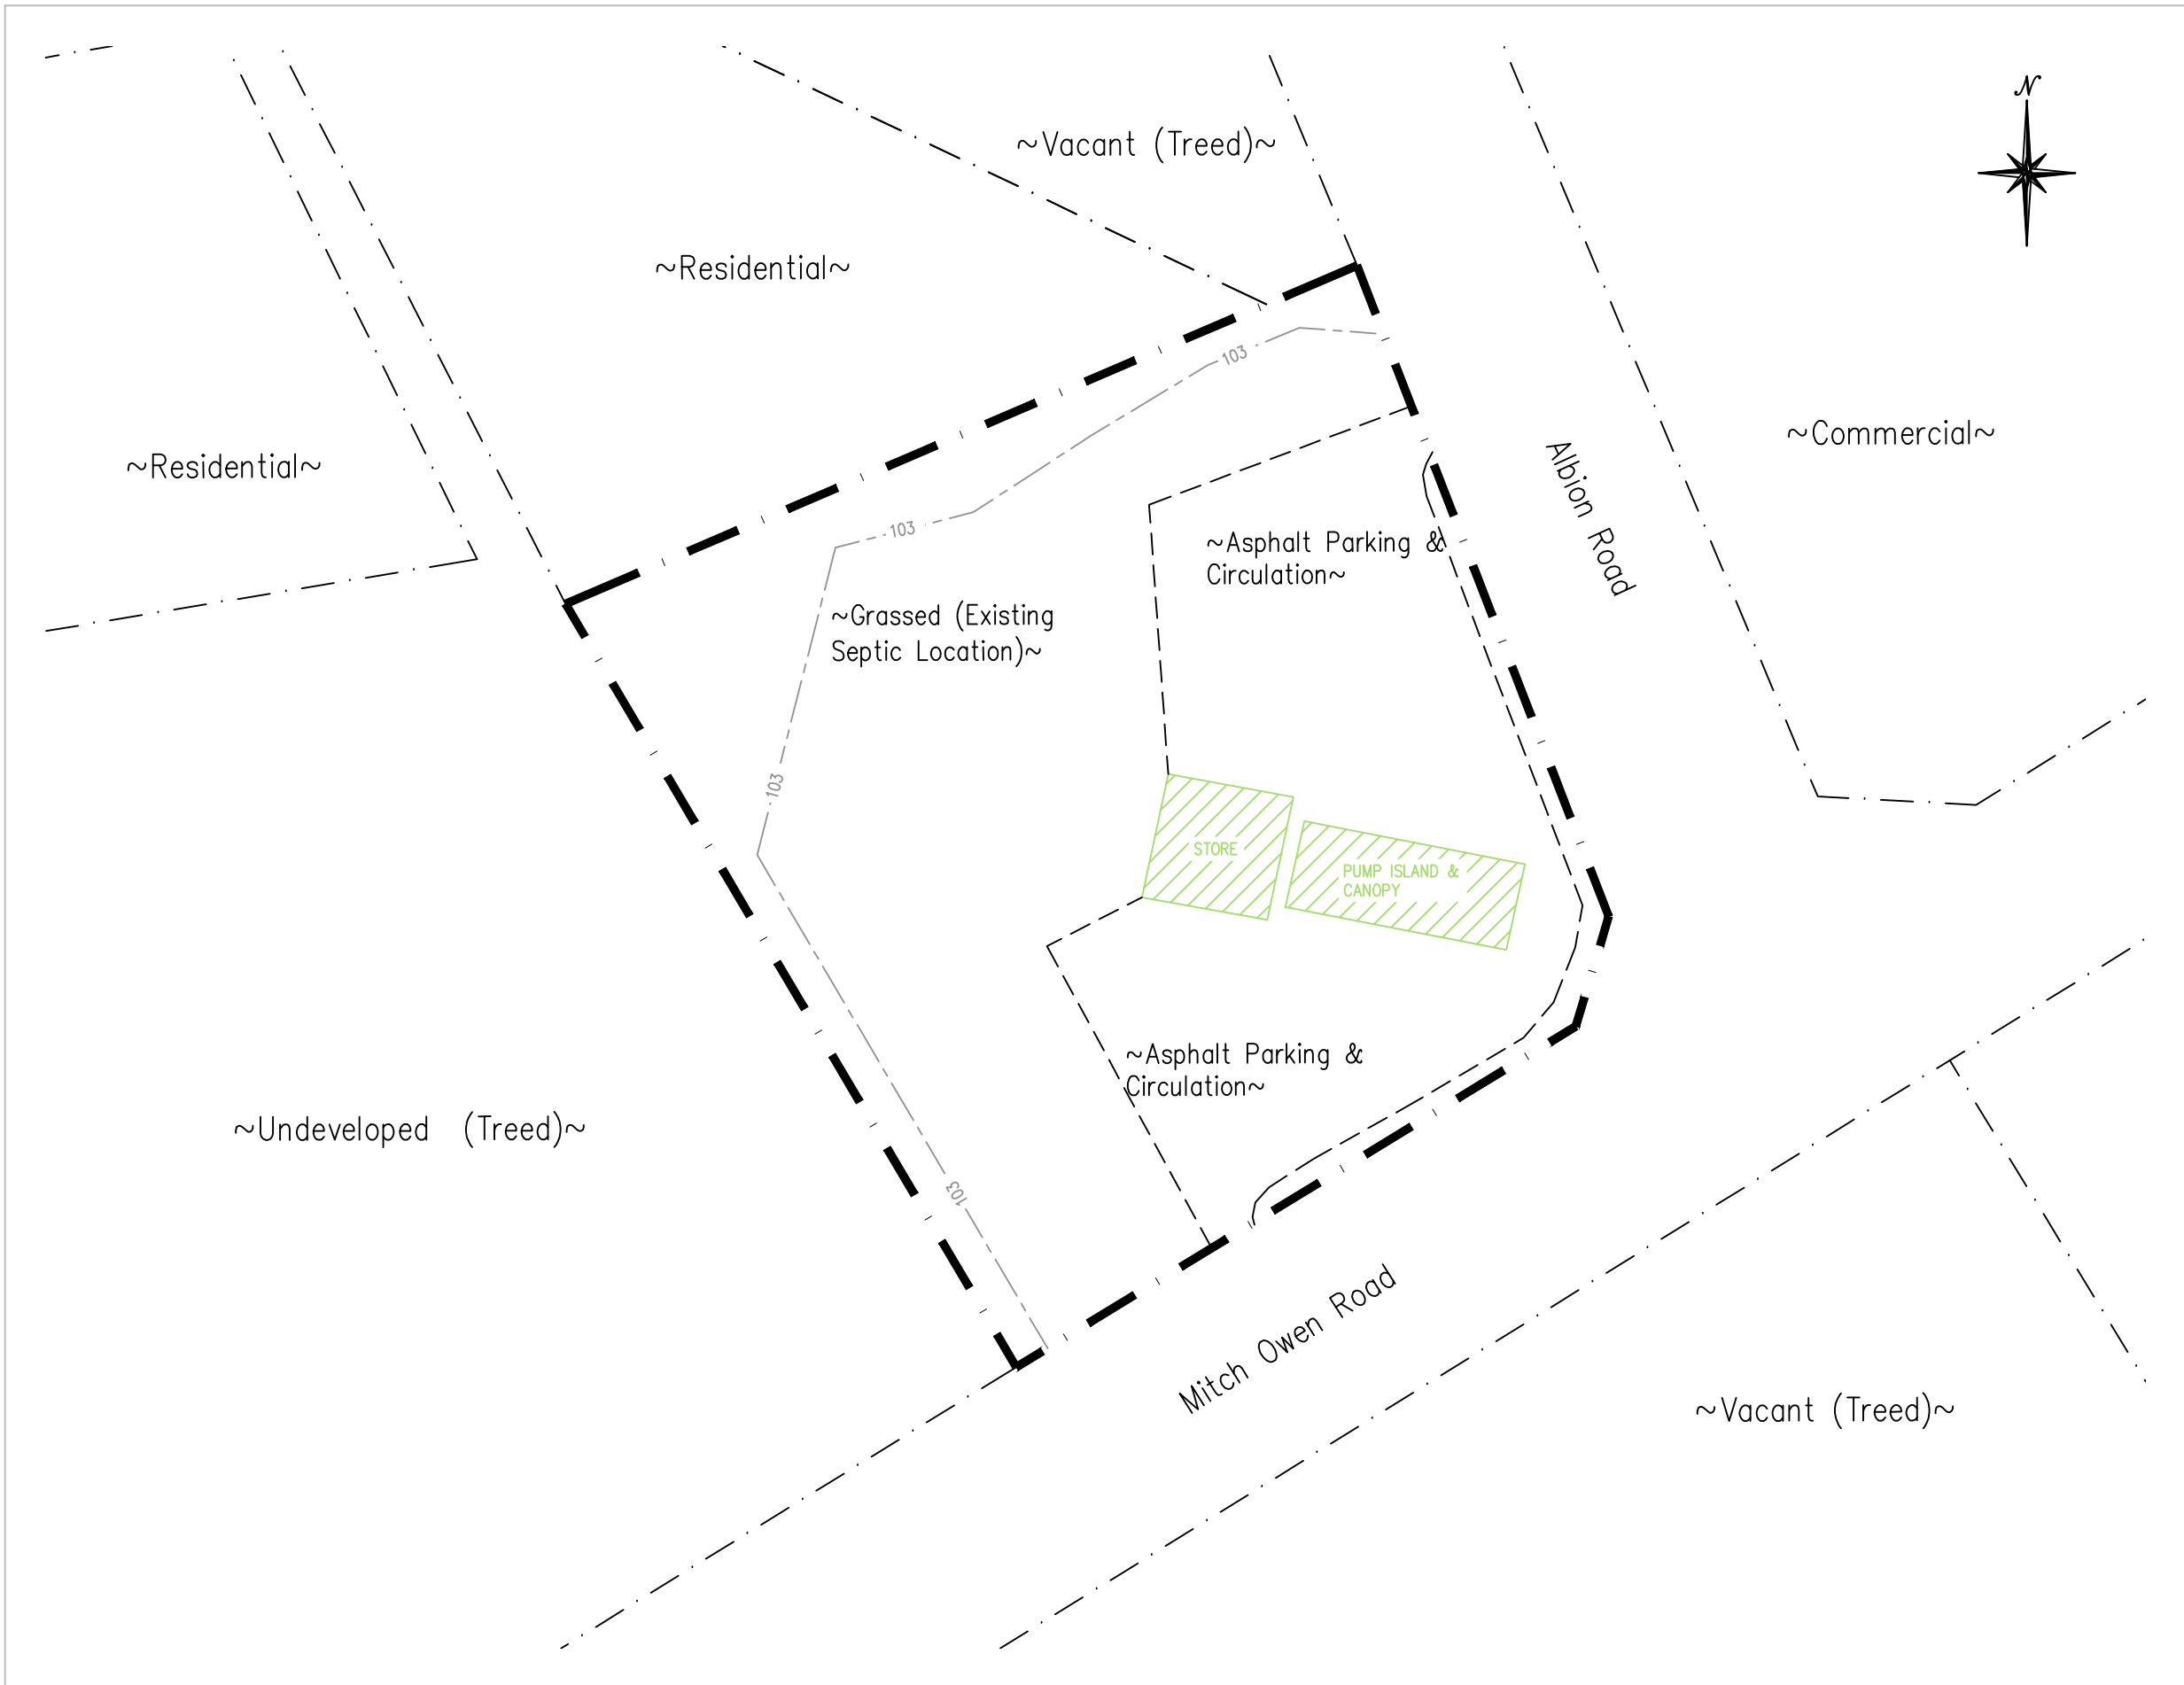
**FIGURE 1**





**LEGEND**

	Property Line
	Existing Building/Structure
	Existing Supply Well
	Approximate Topographic Contour



SCALE: 1:1750

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



**LRL**

ENGINEERING | INGÉNIERIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY: --      DRAWN BY: J.A.      APPROVED BY: J.A.


PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**

DRAWING TITLE  
**SITE PLAN - EXISTING CONDITIONS**

PROJECT NO.  
**01348**

DATE  
**NOVEMBER 2024**

**FIGURE 2**

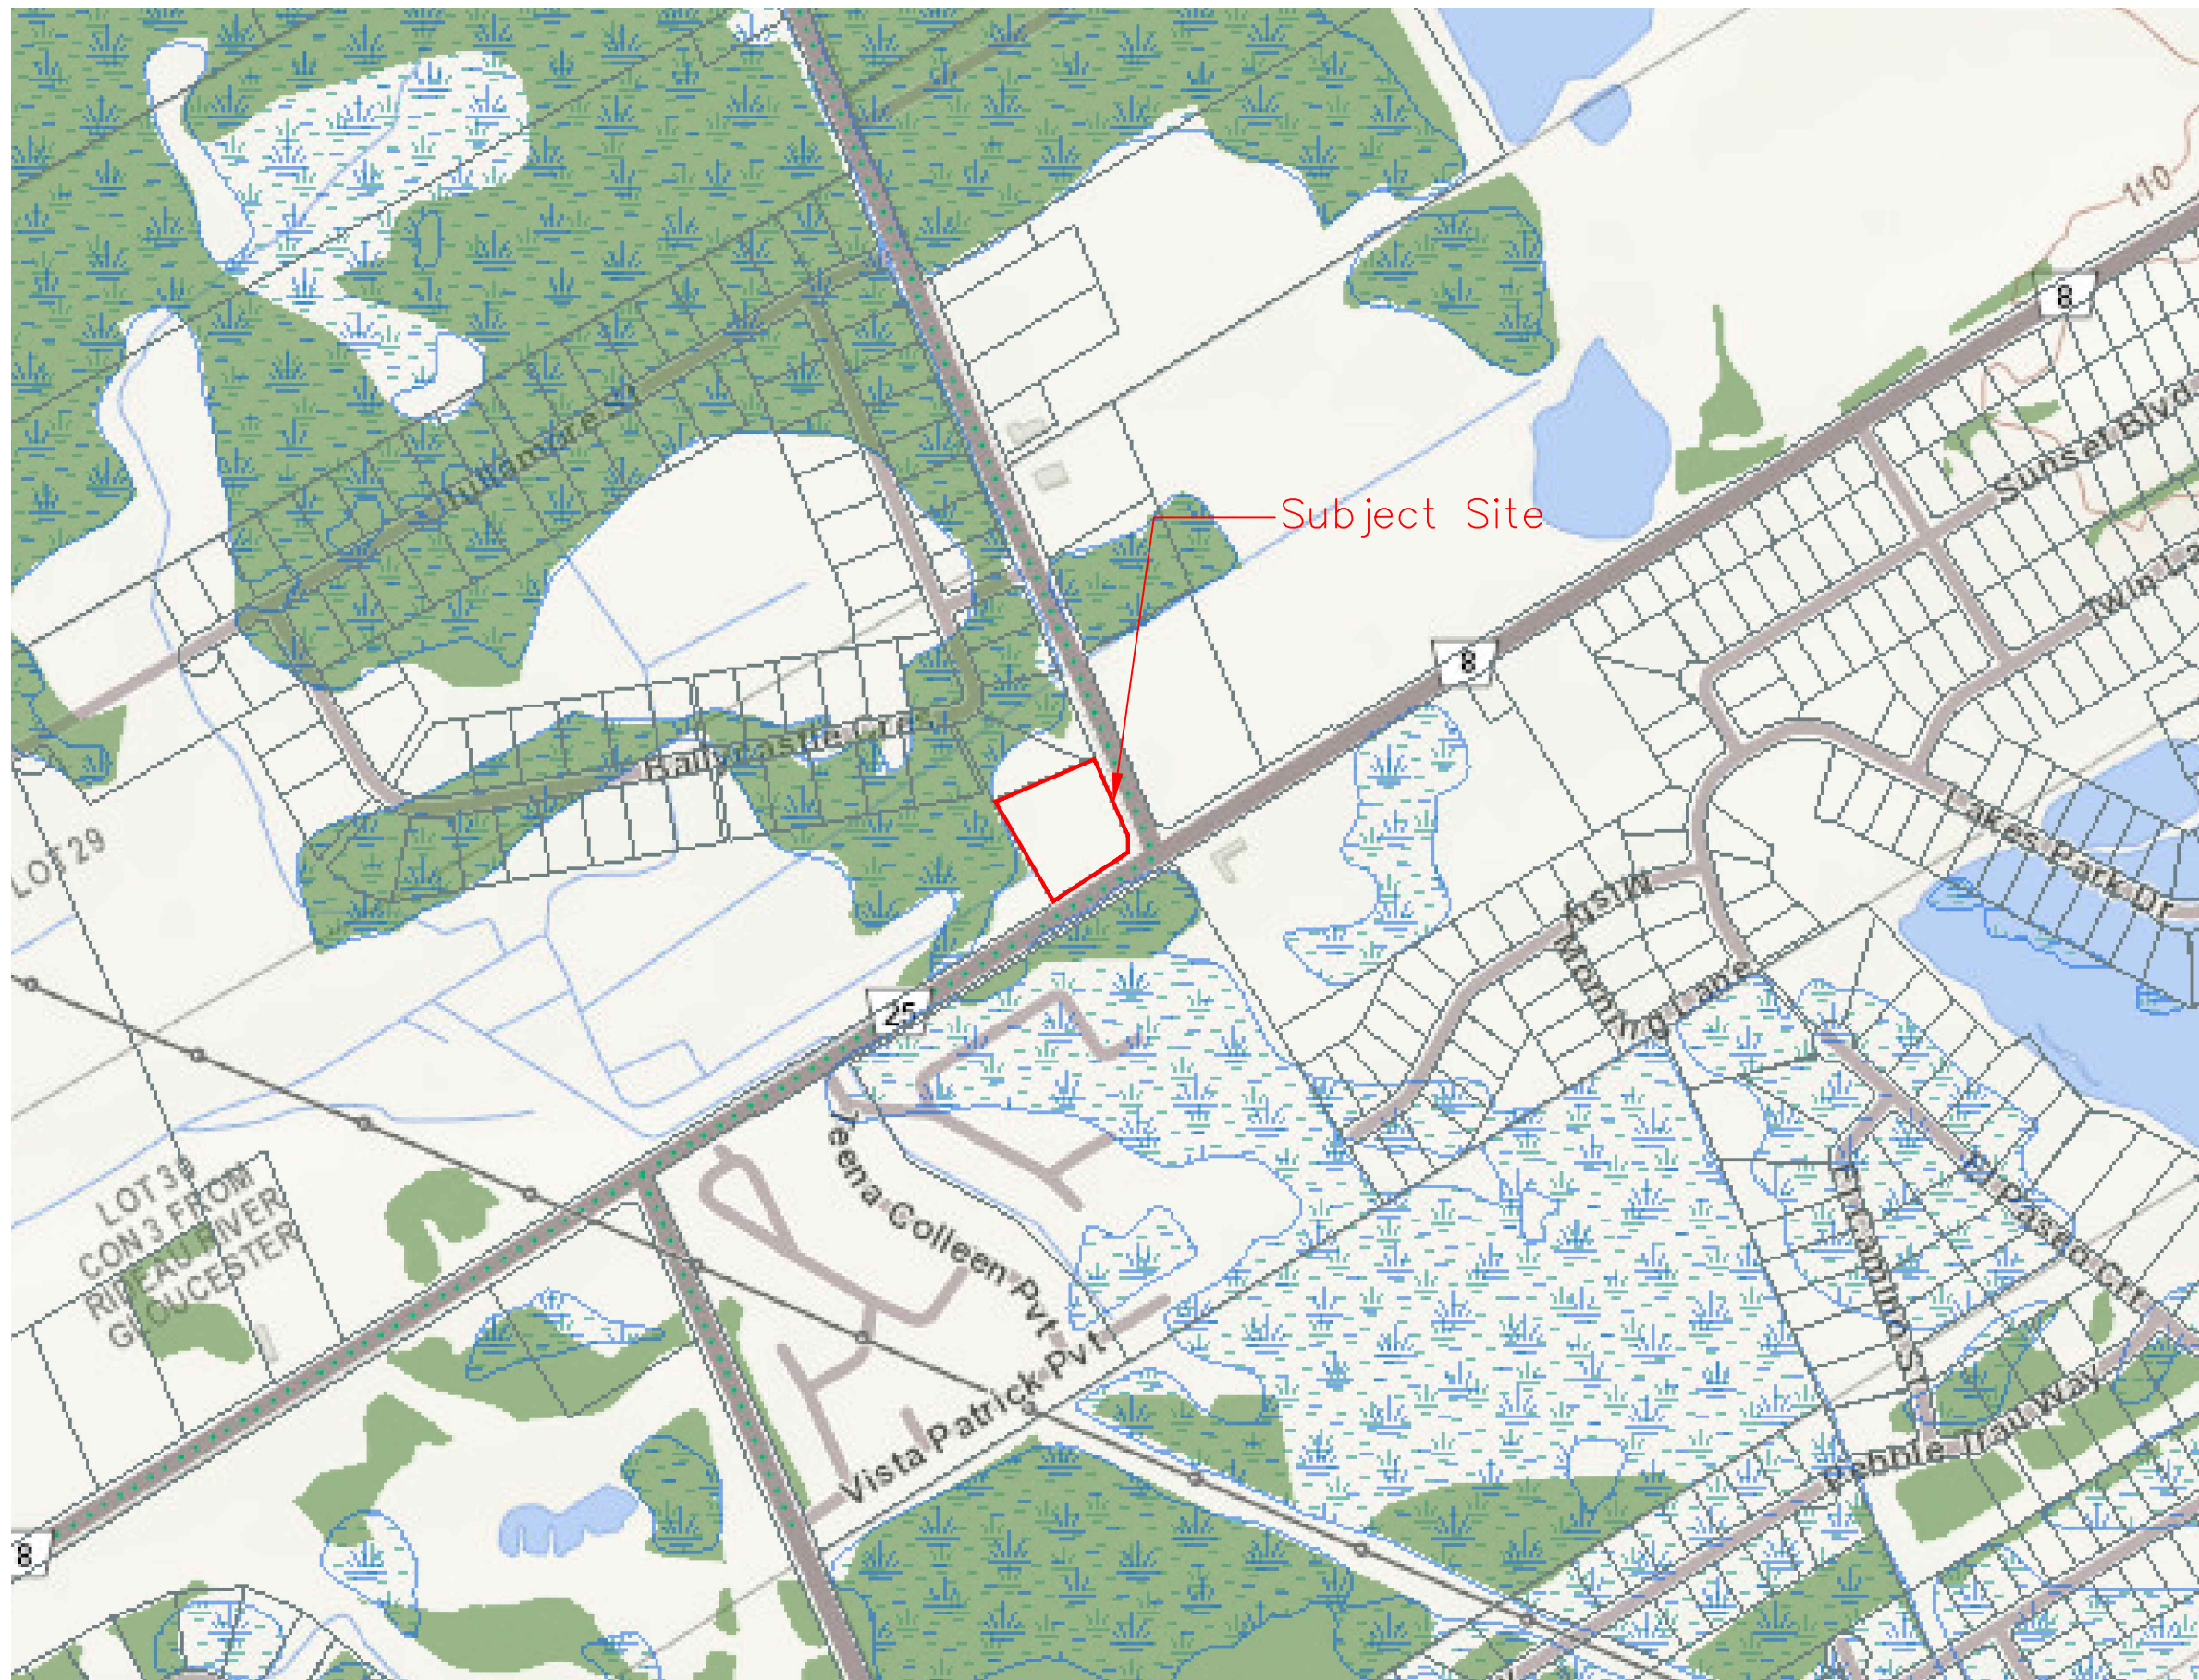

**LEGEND**

	Provincially Significant/considérée d'importance provinciale
	Non-Provincially Significant/non considérée d'importance provinciale
	Unevaluated Wetland
	Woodland

02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022
No.	REVISIONS	BY	DATE



CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY:	DRAWN BY:	APPROVED BY:
--	J.A.	J.A.


PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**

DRAWING TITLE  
**MNRF - NATURAL FEATURES  
SOURCE: MAKE A MAP: NATURAL  
HERITAGE AREAS**

PROJECT NO.  
01348

DATE  
NOVEMBER 2024

**FIGURE 3**

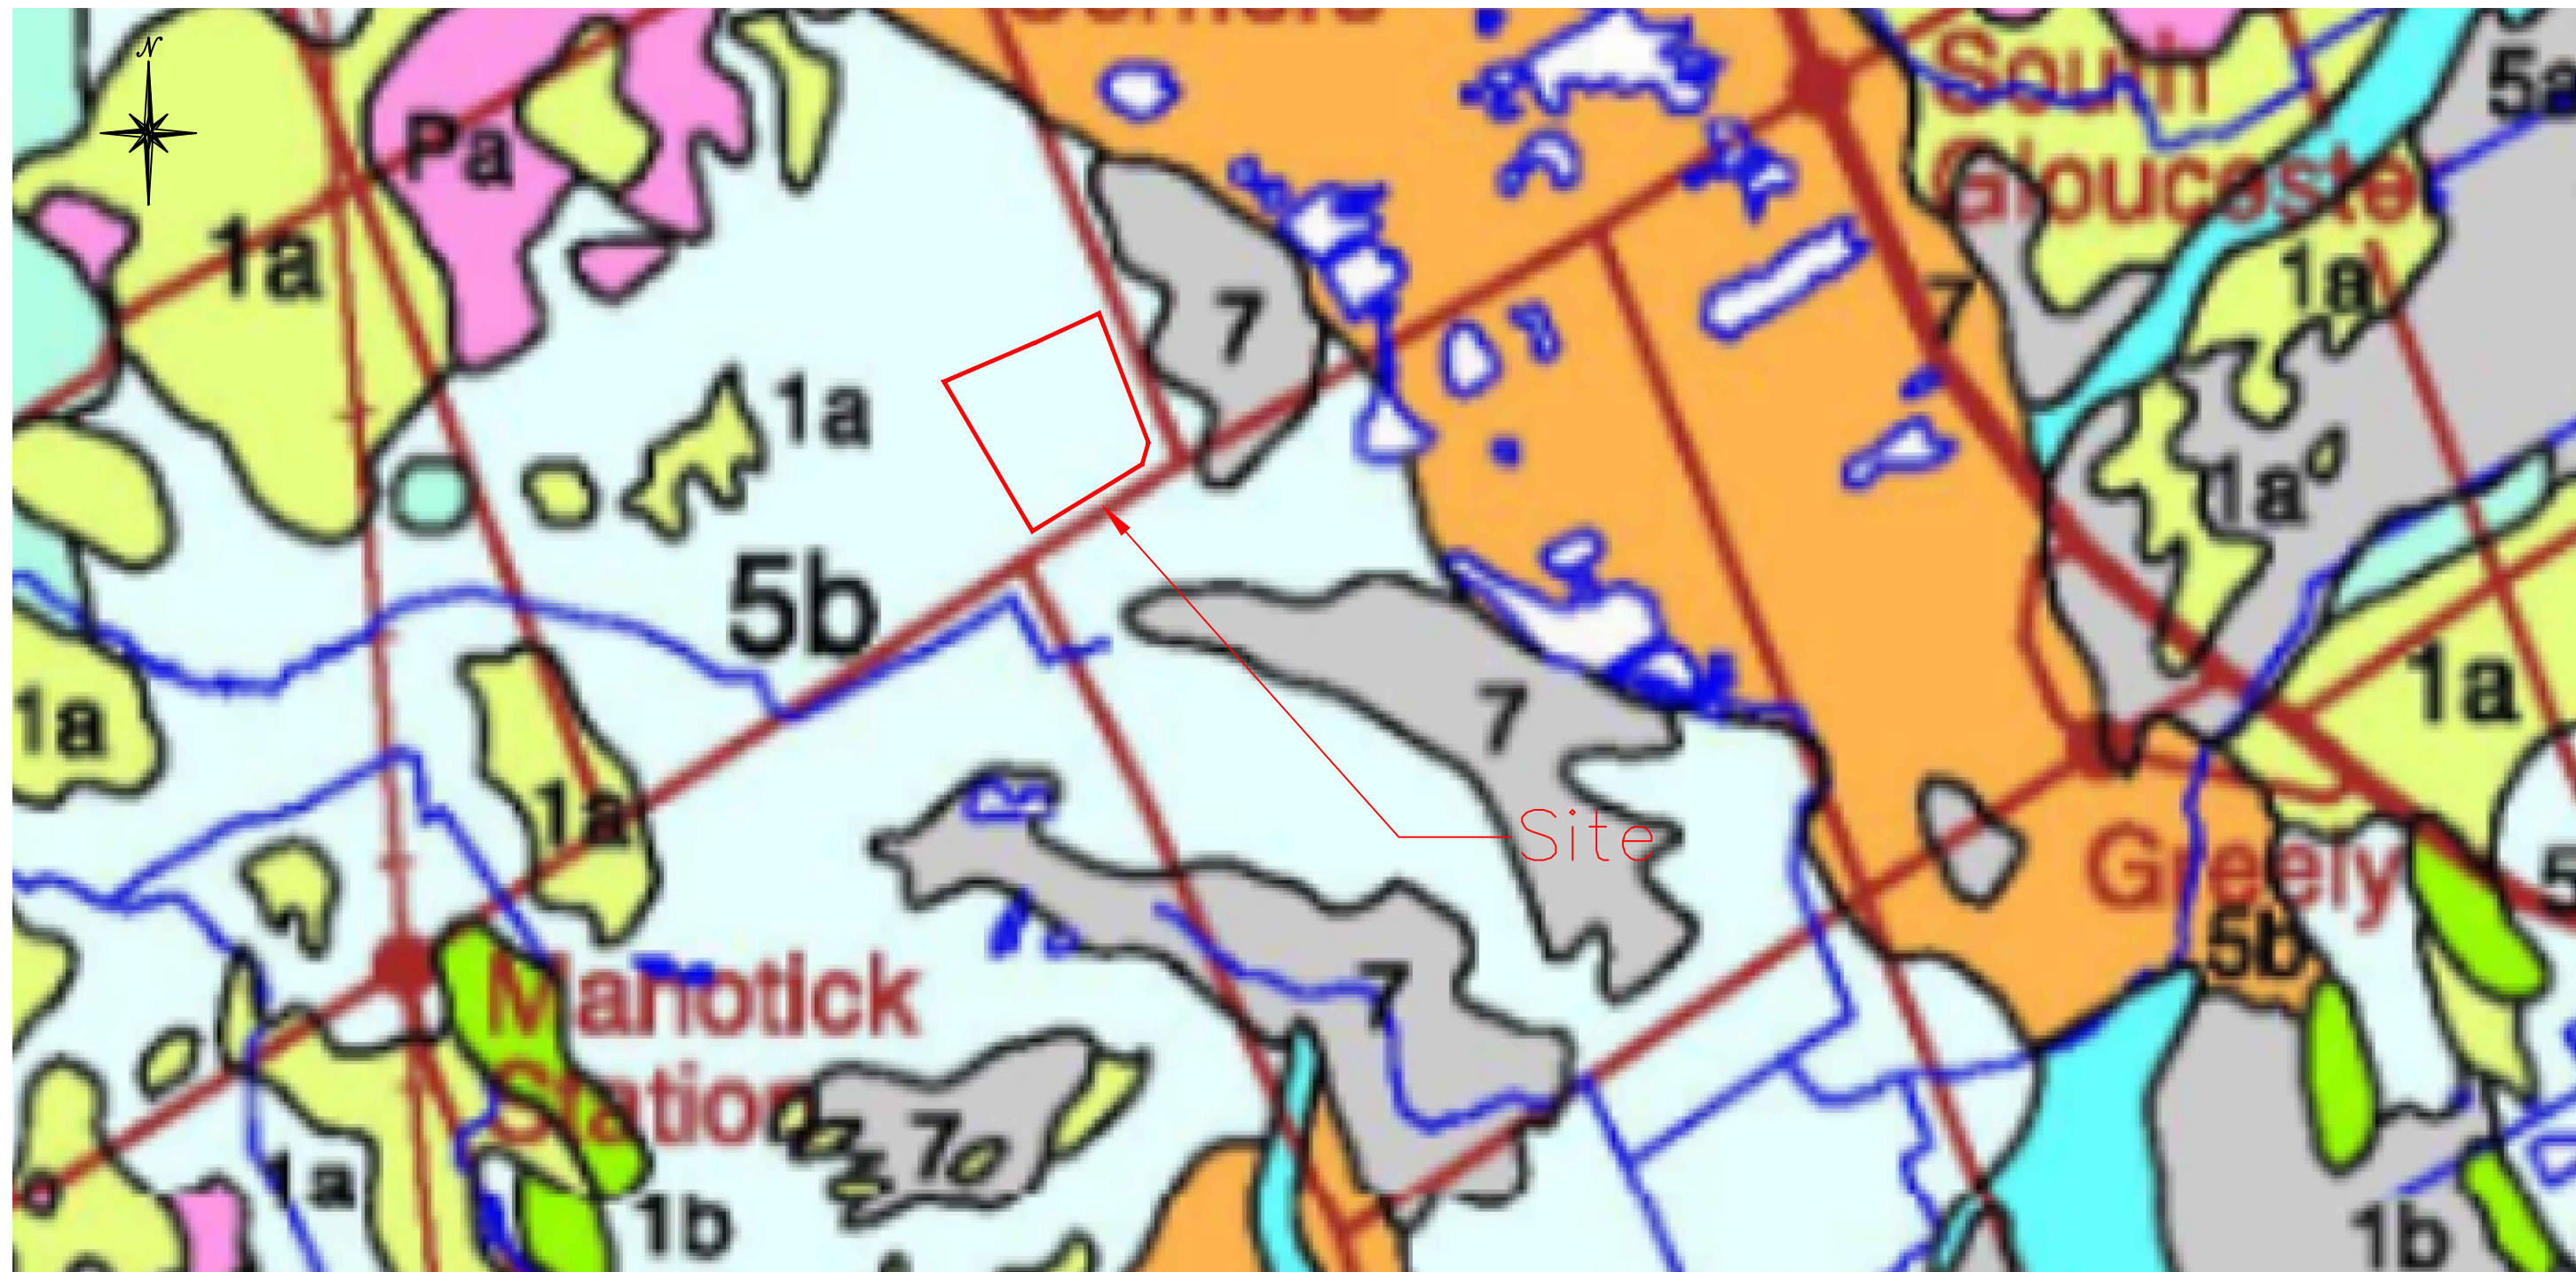

Legend

CHAMPLAIN SEA SEDIMENTS

**NEARSHORE SEDIMENTS:** gravel, sand, and coarser material, generally well sorted.

- 5a** Gravel, sand, and boulders; beaches commonly fossiliferous; nature of sediment controlled by underlying material (gravel, sand, and boulders where developed from till and glaciofluvial deposits; slabs and shingles where developed from sedimentary bedrock).
- 5b** Fine- to medium-grained sand, calcareous and commonly fossiliferous; nearshore sand generally occurs as a sheet or as bars or spits associated with glaciofluvial materials.

No.	REVISIONS	BY	DATE
02	REVISION	J.A.	11/08/24
01	FINAL	J.A.	12/28/22



**LRL**

ENGINEERING | INGÉNIÉRIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT

MACEWEN PETROLEUM INC.

DESIGNED BY:	DRAWN BY:	APPROVED BY:
J.A.	J.A.	J.A.

PROJECT

HYDROGEOLOGICAL ASSESSMENT &  
TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO

DRAWING TITLE

SURFICIAL GEOLOGY  
SOURCE: GEOLOGICAL SURVEY OF  
CANADA, MAP 2140A,

NOT TO SCALE


PROJECT NO.

01348

DATE

NOVEMBER 2024

**FIGURE 4**

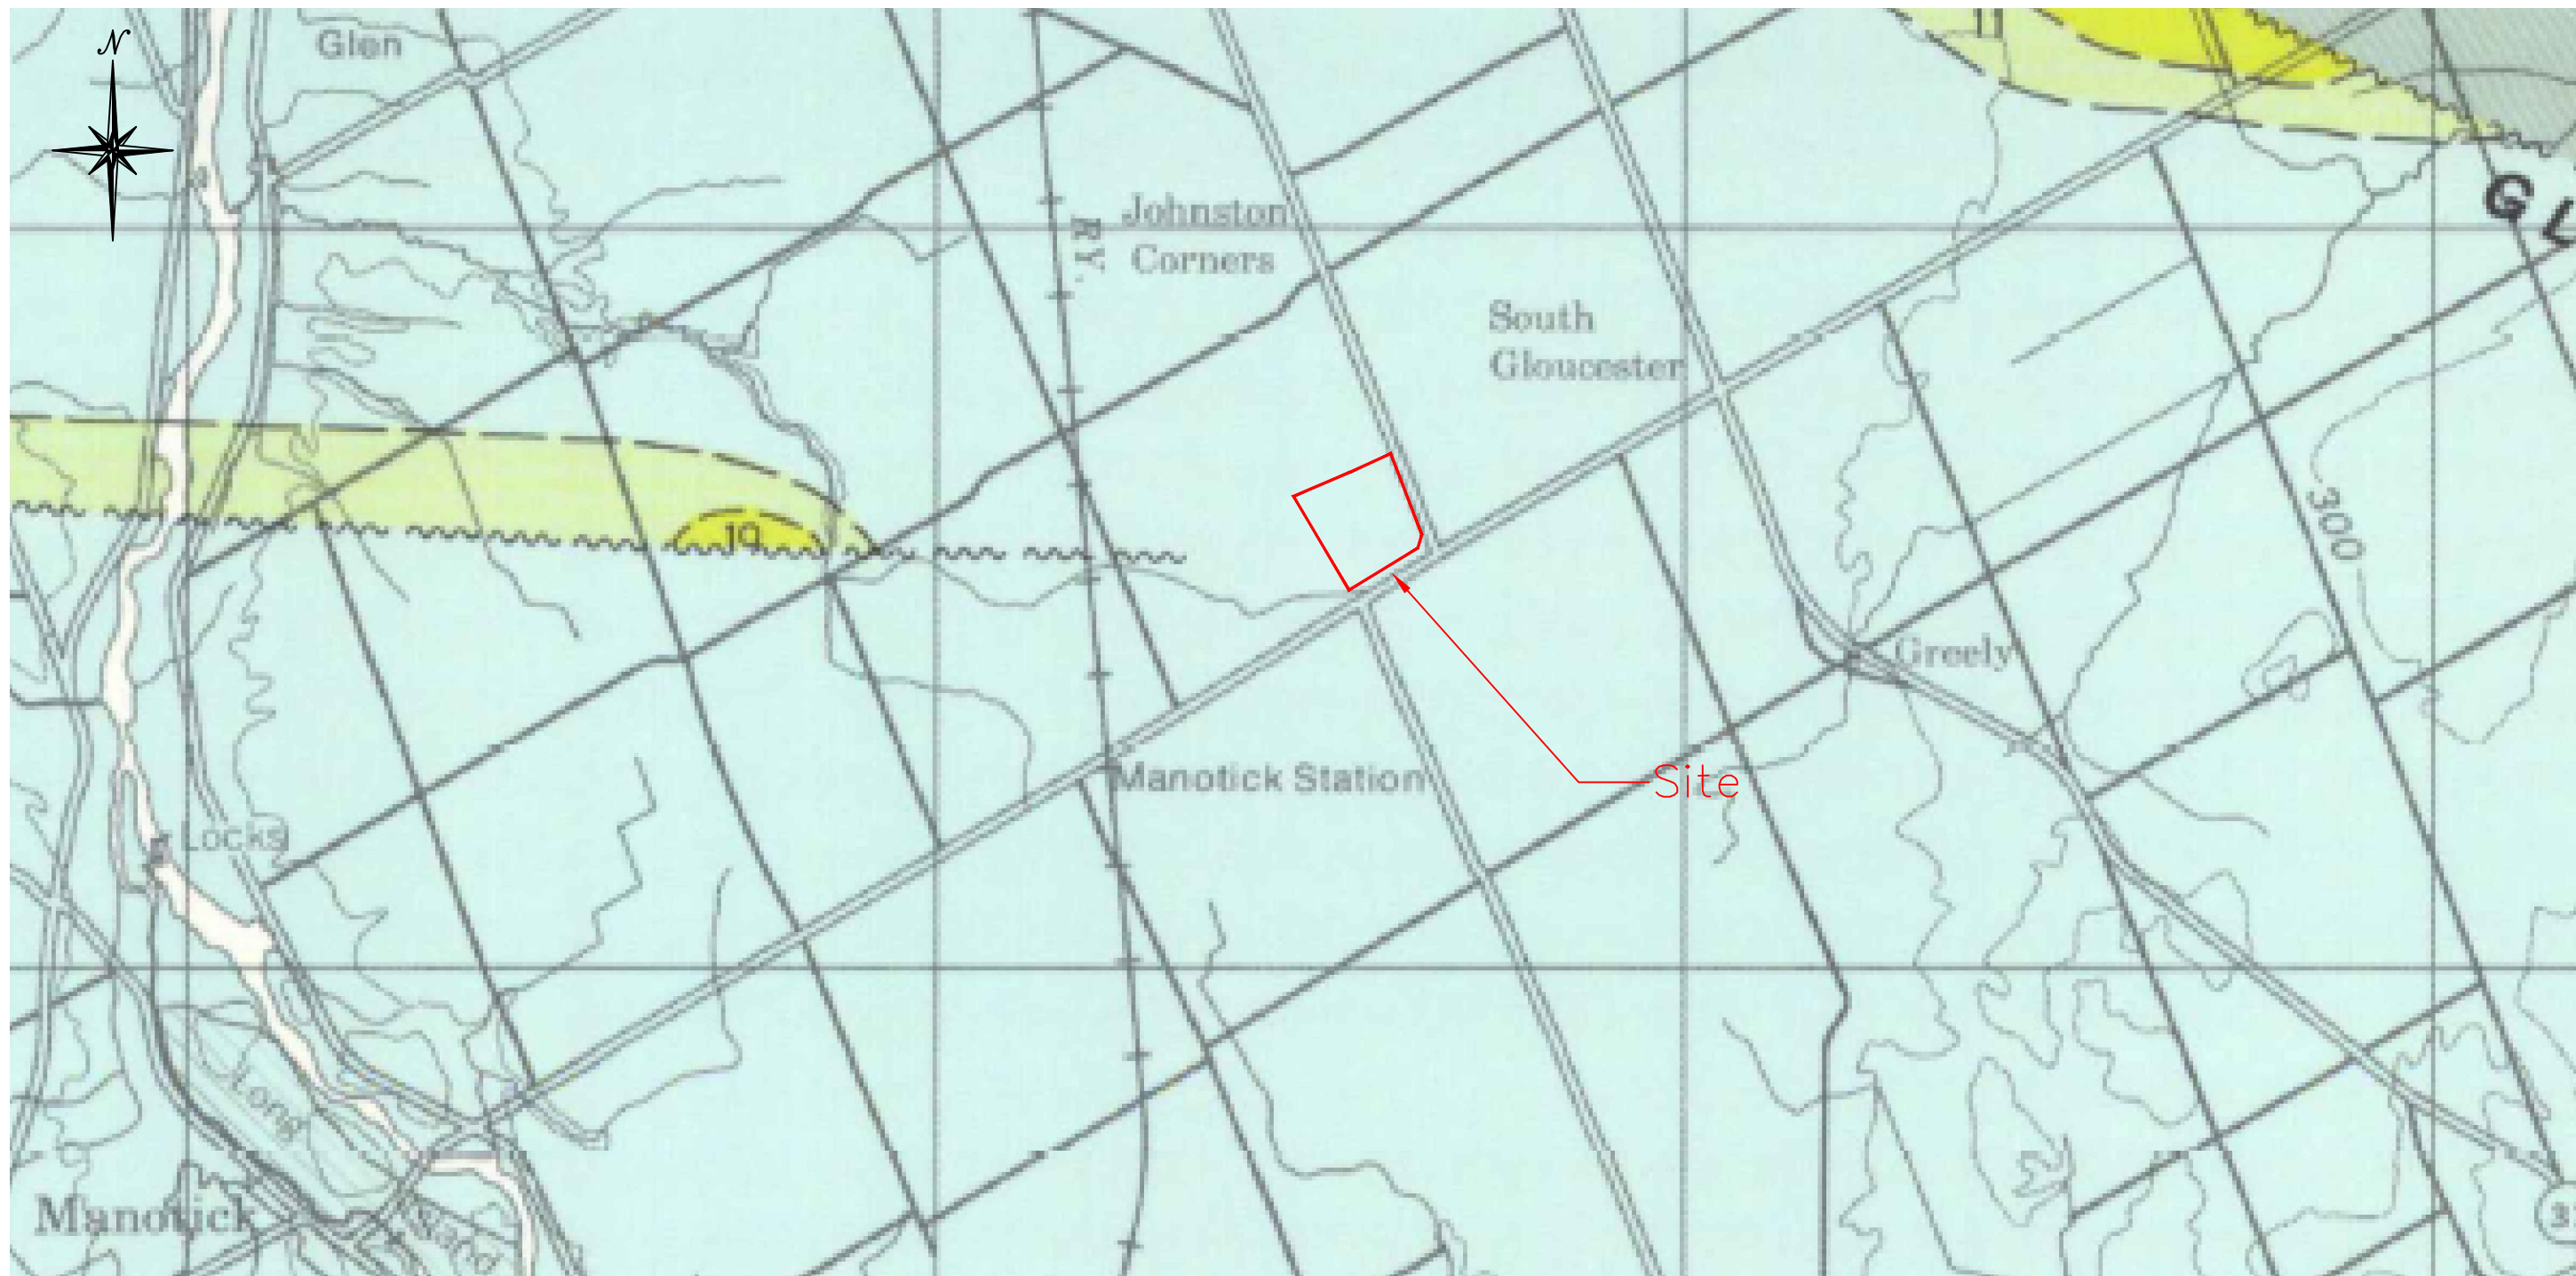

Legend

12	OXFORD FORMATION: dolomite and limestone
----	--

02	REVISION	J.A.	11/08/24
01	FINAL	J.A.	12/28/22
No.	REVISIONS	BY	DATE



**LRL**  
 ENGINEERING | INGÉNIÉRIE  
 5430 Canotek Road | Ottawa, ON, K1J 9G2  
 www.lrl.ca | (613) 842-3434

CLIENT  
 MACEWEN PETROLEUM INC.

DESIGNED BY: J.A.    DRAWN BY: J.A.    APPROVED BY: J.A.

PROJECT  
 HYDROGEOLOGICAL ASSESSMENT &  
 TERRAIN ANALYSIS  
 5546 ALBION ROAD  
 OTTAWA, ONTARIO

DRAWING TITLE  
 BEDROCK GEOLOGY  
 SOURCE: GEOLOGICAL SURVEY OF  
 CANADA, MAP 1508A

NOT TO SCALE

PROJECT NO.  
 01348  
 DATE  
 NOVEMBER 2024

**FIGURE 5**





**Trow Associates Inc.** 154 Colonnade Road South, Ottawa, Ontario K2E 7J5 Tel: (613) 225-0940 Fax: (613) 225-7337

SCALE 1:15,000	CLIENT <b>ALBION SUN VISTA</b>	JOB No. OTEN00014309_A
DATE JUNE 2004	TITLE <b>CAPTURE ZONE - 50 DAYS - 2 YEARS</b>	<b>FIG 6</b>
DRAWN RG		

Source: Wellhead Protection Area Plan, Albion Sun Vista Community & Peer Review – Albion Sun Vista Wellhead Protection Plan, June 2004

**LEGEND**

 50 Day – 2 Year Capture Zone (as determined by Others)

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



**LRL**

ENGINEERING | INGÉNIÉRIE

5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT

**MACEWEN PETROLEUM INC.**

DESIGNED BY: --	DRAWN BY: J.A.	APPROVED BY: J.A.
--------------------	-------------------	----------------------

PROJECT

**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**

DRAWING TITLE

**ALBION SUN VISTA - CAPTURE ZONE  
DETAIL  
NOT TO SCALE**


PROJECT NO.

**01348**

DATE

**NOVEMBER 2024**

**FIGURE 6**

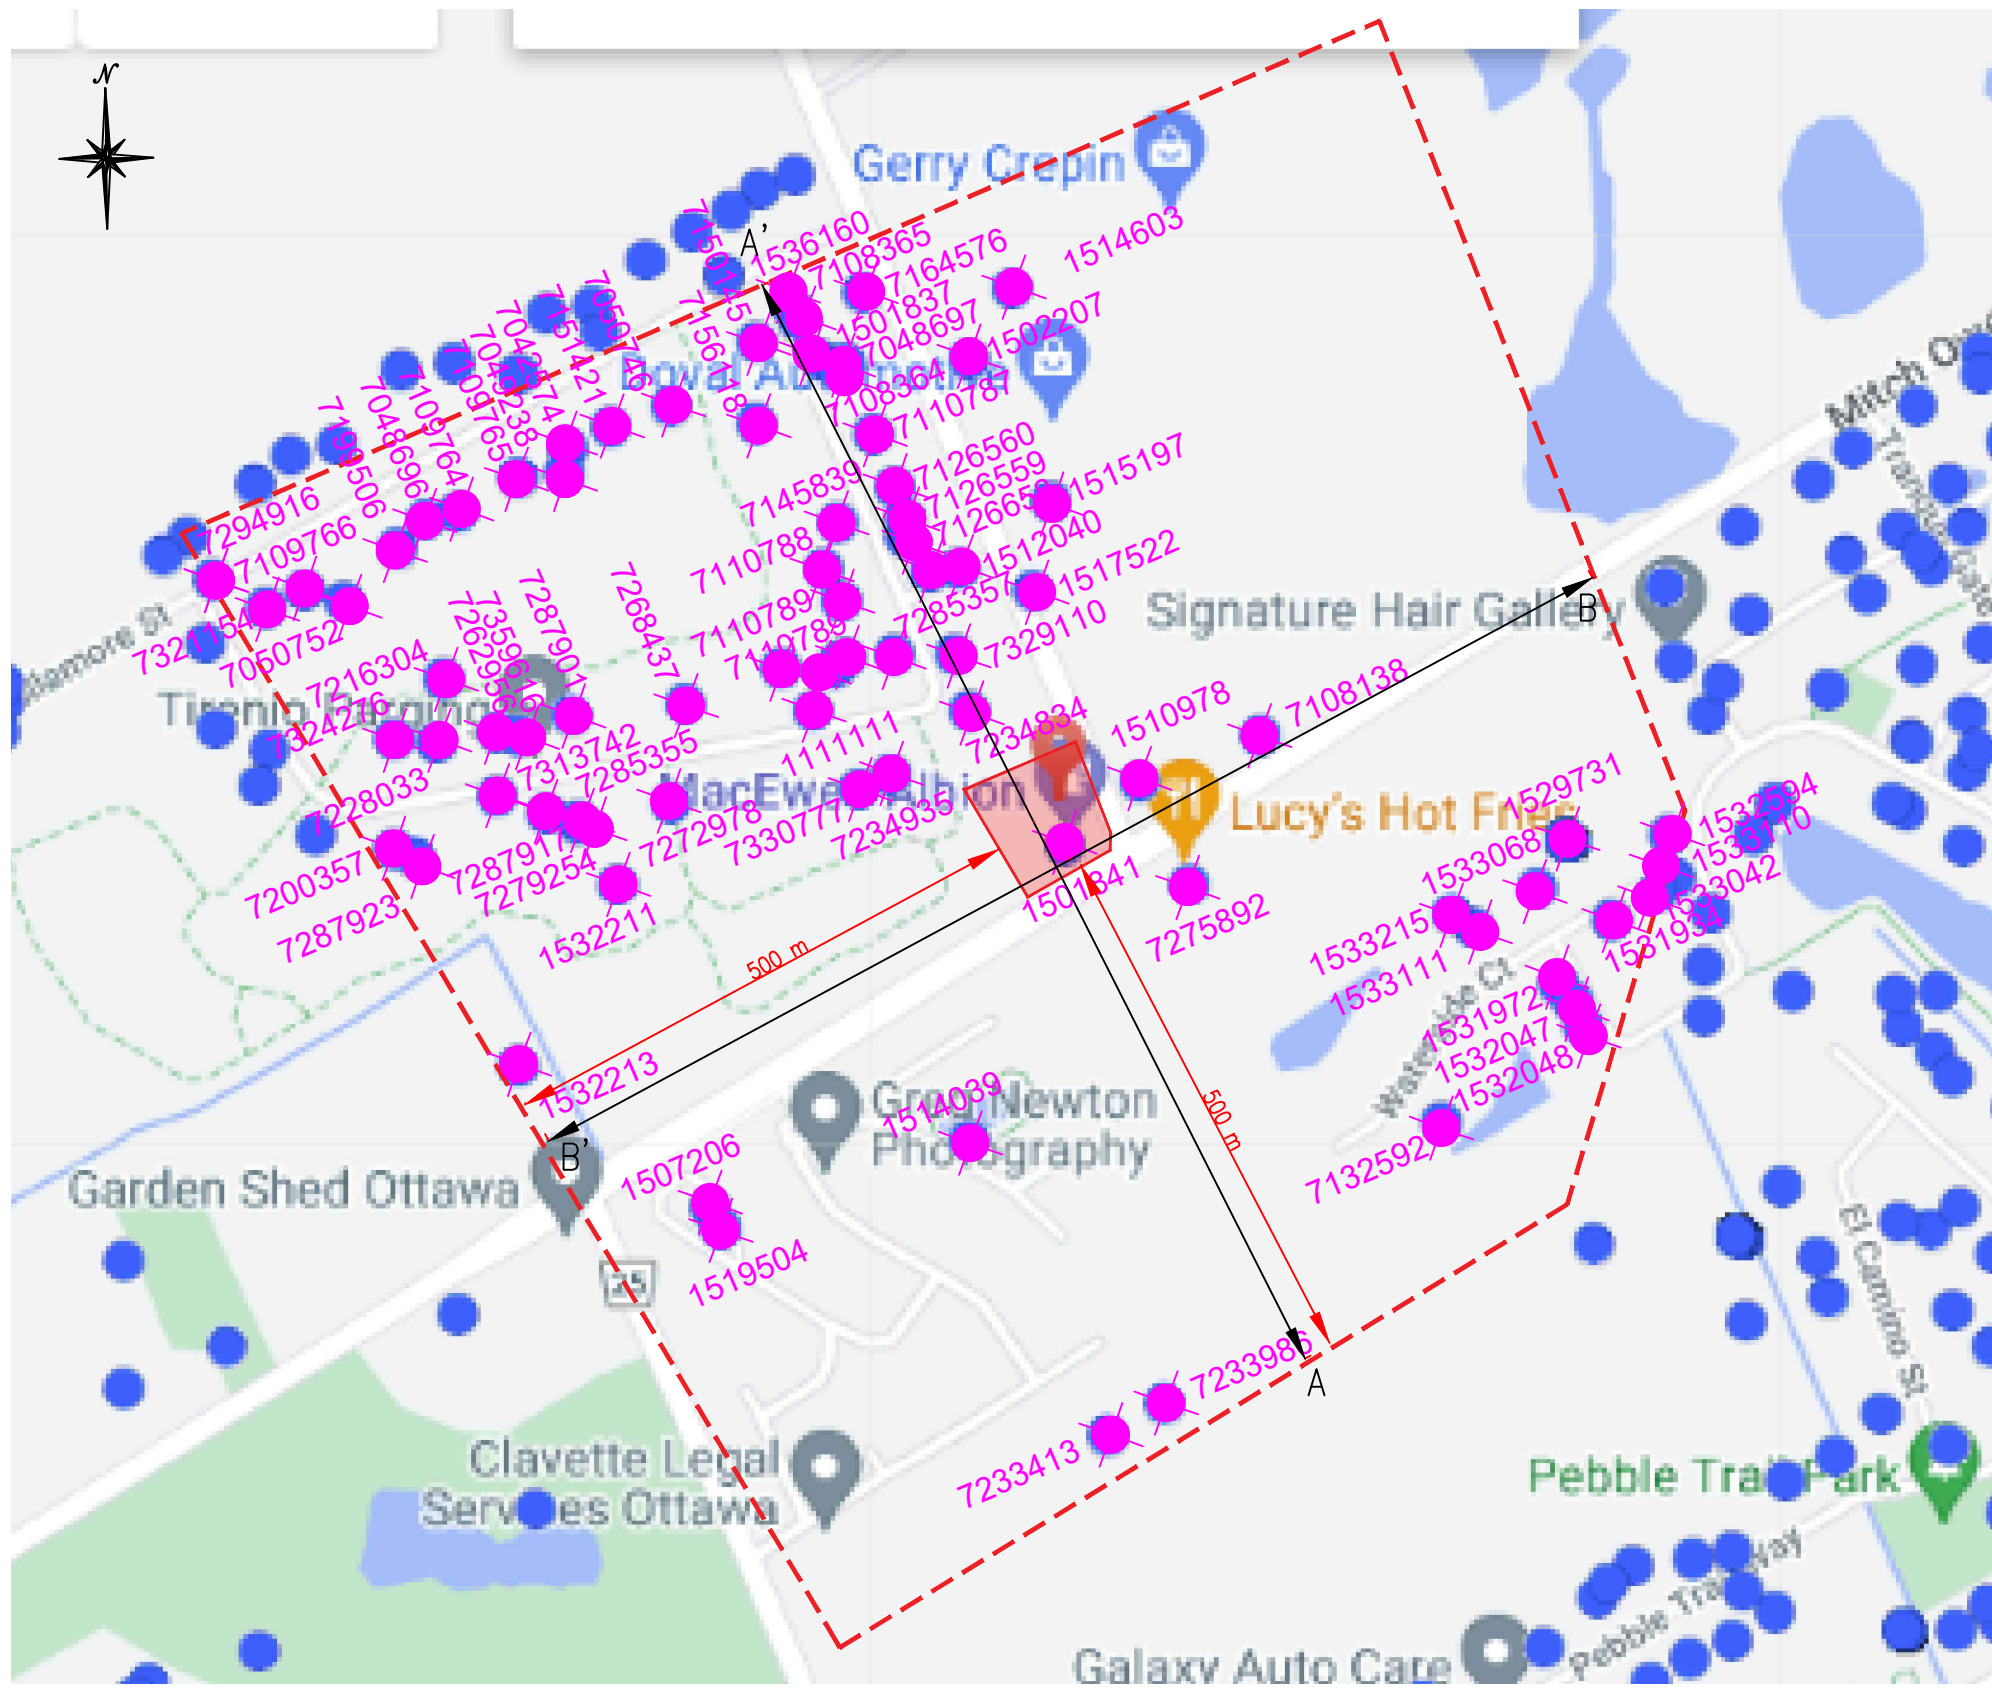

**LEGEND**

	Property Line
	Existing Supply Well
	Wells within 500 m of the Site
	Wells beyond 500 m of the Site

02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022
No.	REVISIONS	BY	DATE



CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY:	DRAWN BY:	APPROVED BY:
--	J.A.	J.A.

PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**


DRAWING TITLE  
**WELLS WITHIN 500 m OF THE SITE  
(SOURCE & BASE LAYER: MECP WELL RECORD DATABASE)**

PROJECT NO.  
01348





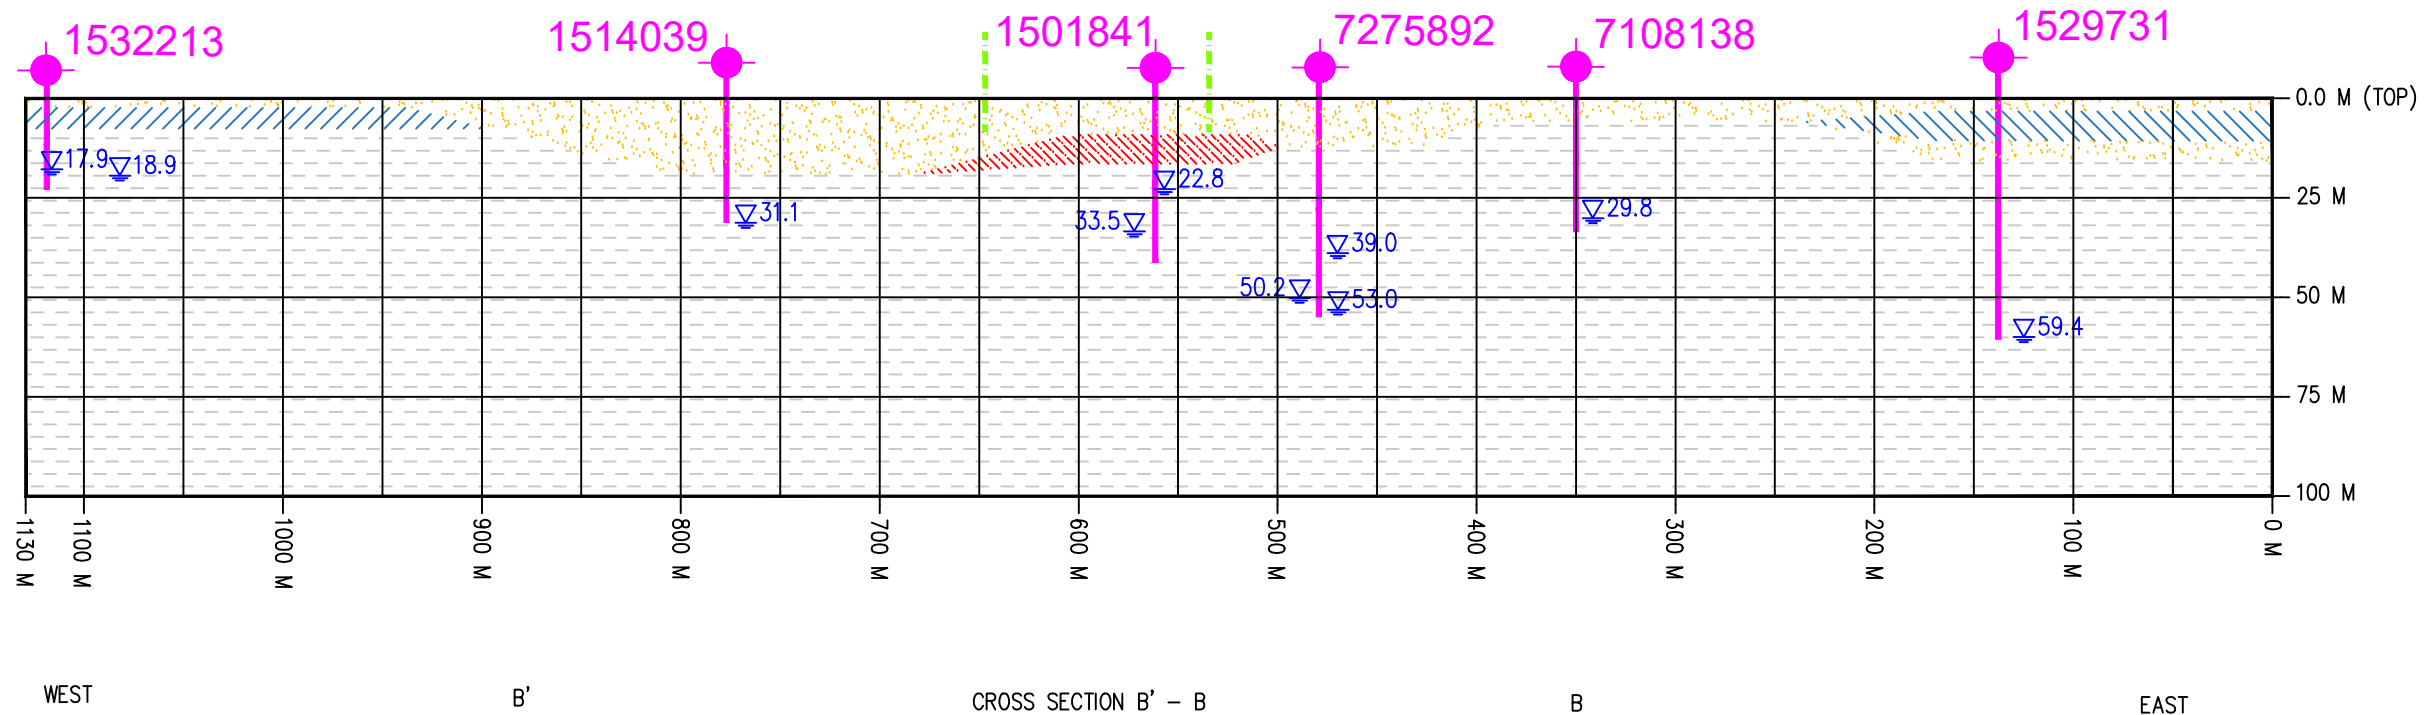


DATE  
NOVEMBER 2024

**FIGURE 7**





**LEGEND**

-  Supply Well
-  Subject Site Property Extents
-  Groundwater Found
-  Sand (Sand, Gravel, Boulders)
-  Clay
-  Till
-  Pavement Structure and Fill Material

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



**LRL**  
ENGINEERING | INGÉNIERIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY: --      DRAWN BY: J.A.      APPROVED BY: J.A.


PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**

DRAWING TITLE  
**CROSS SECTION B' - B**

PROJECT NO.  
**01348**

DATE  
**NOVEMBER 2024**

**FIGURE 8A**

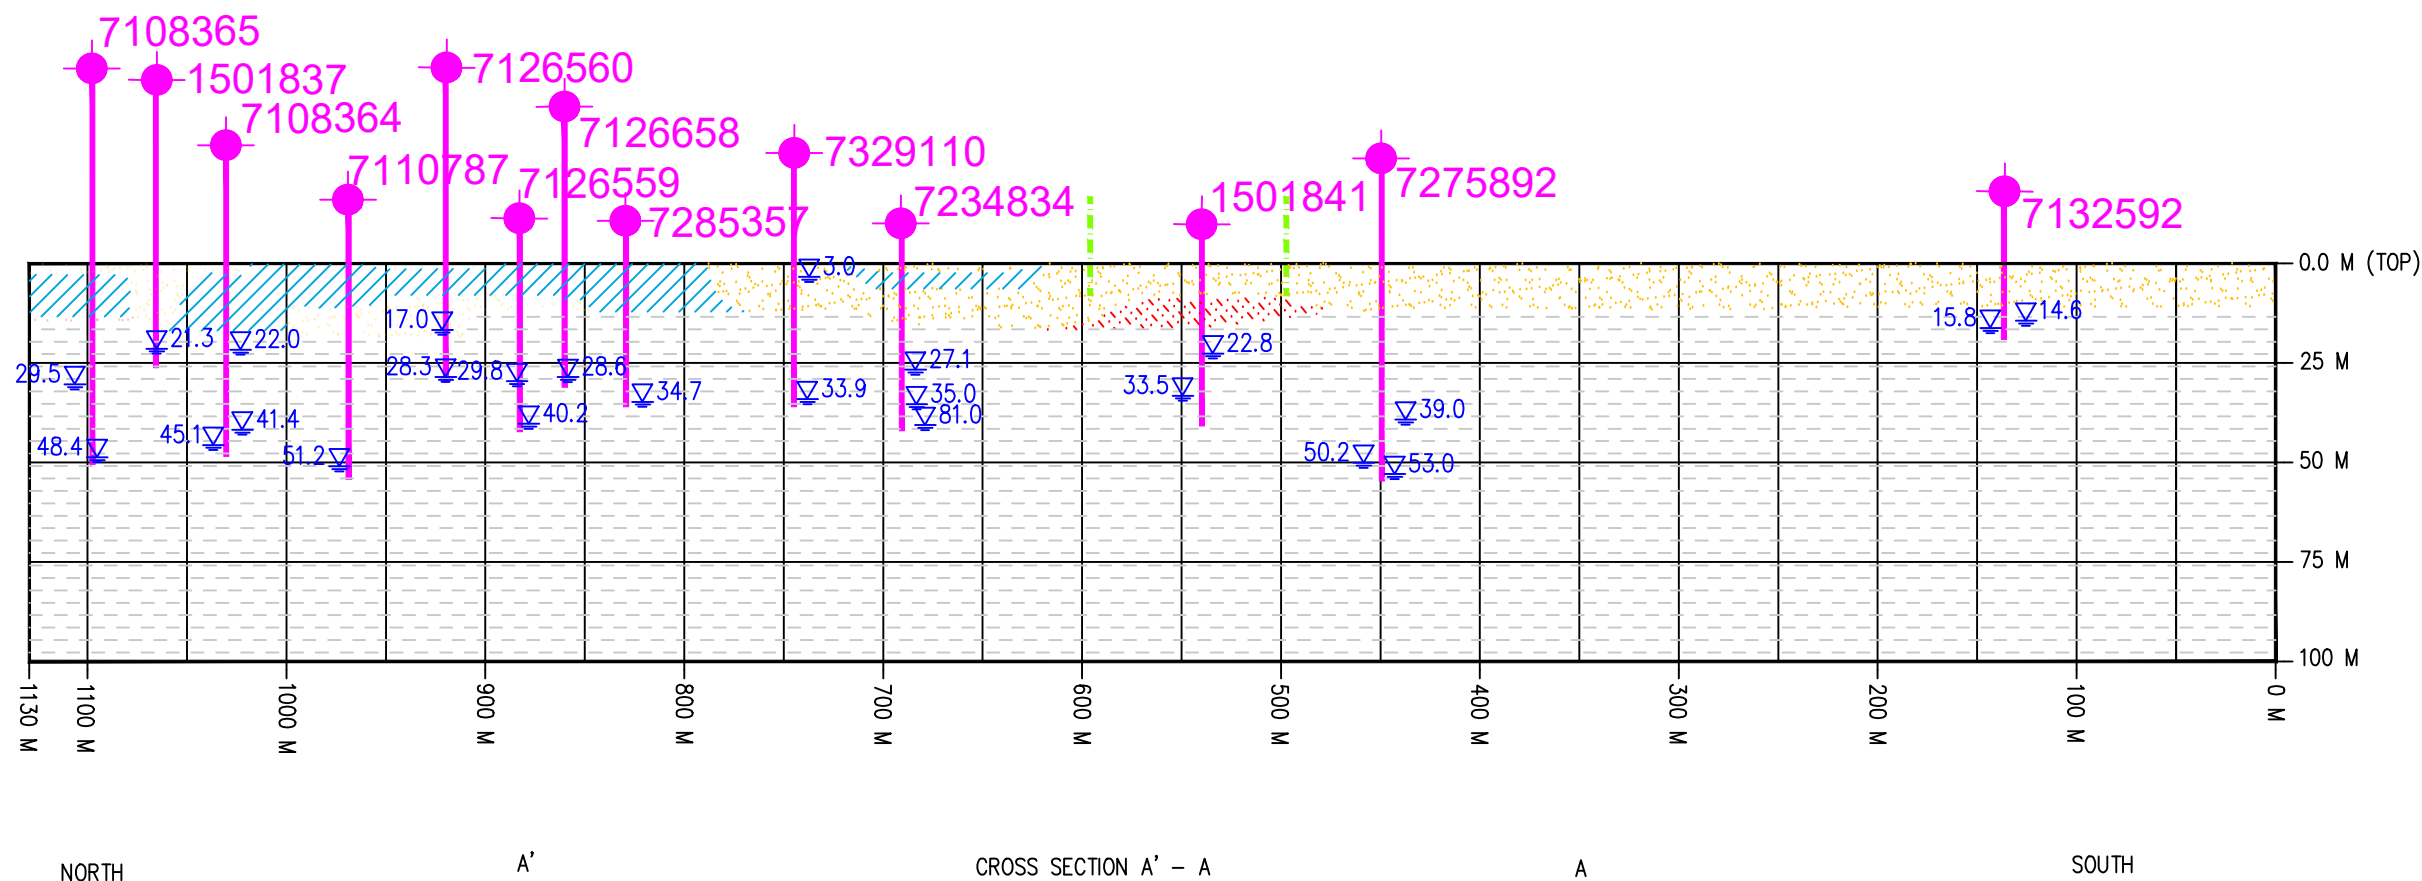

- LEGEND**
- Supply Well
  - Subject Site Property Extents
  - Groundwater Found
  - Sand (Sand, Gravel, Boulders)
  - Clay
  - Till
  - Pavement Structure and Fill Material

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY: --      DRAWN BY: J.A.      APPROVED BY: J.A.


PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**

DRAWING TITLE  
**CROSS SECTION A' - A**

PROJECT NO.  
**01348**


DATE  
**NOVEMBER 2024**

**FIGURE8B**

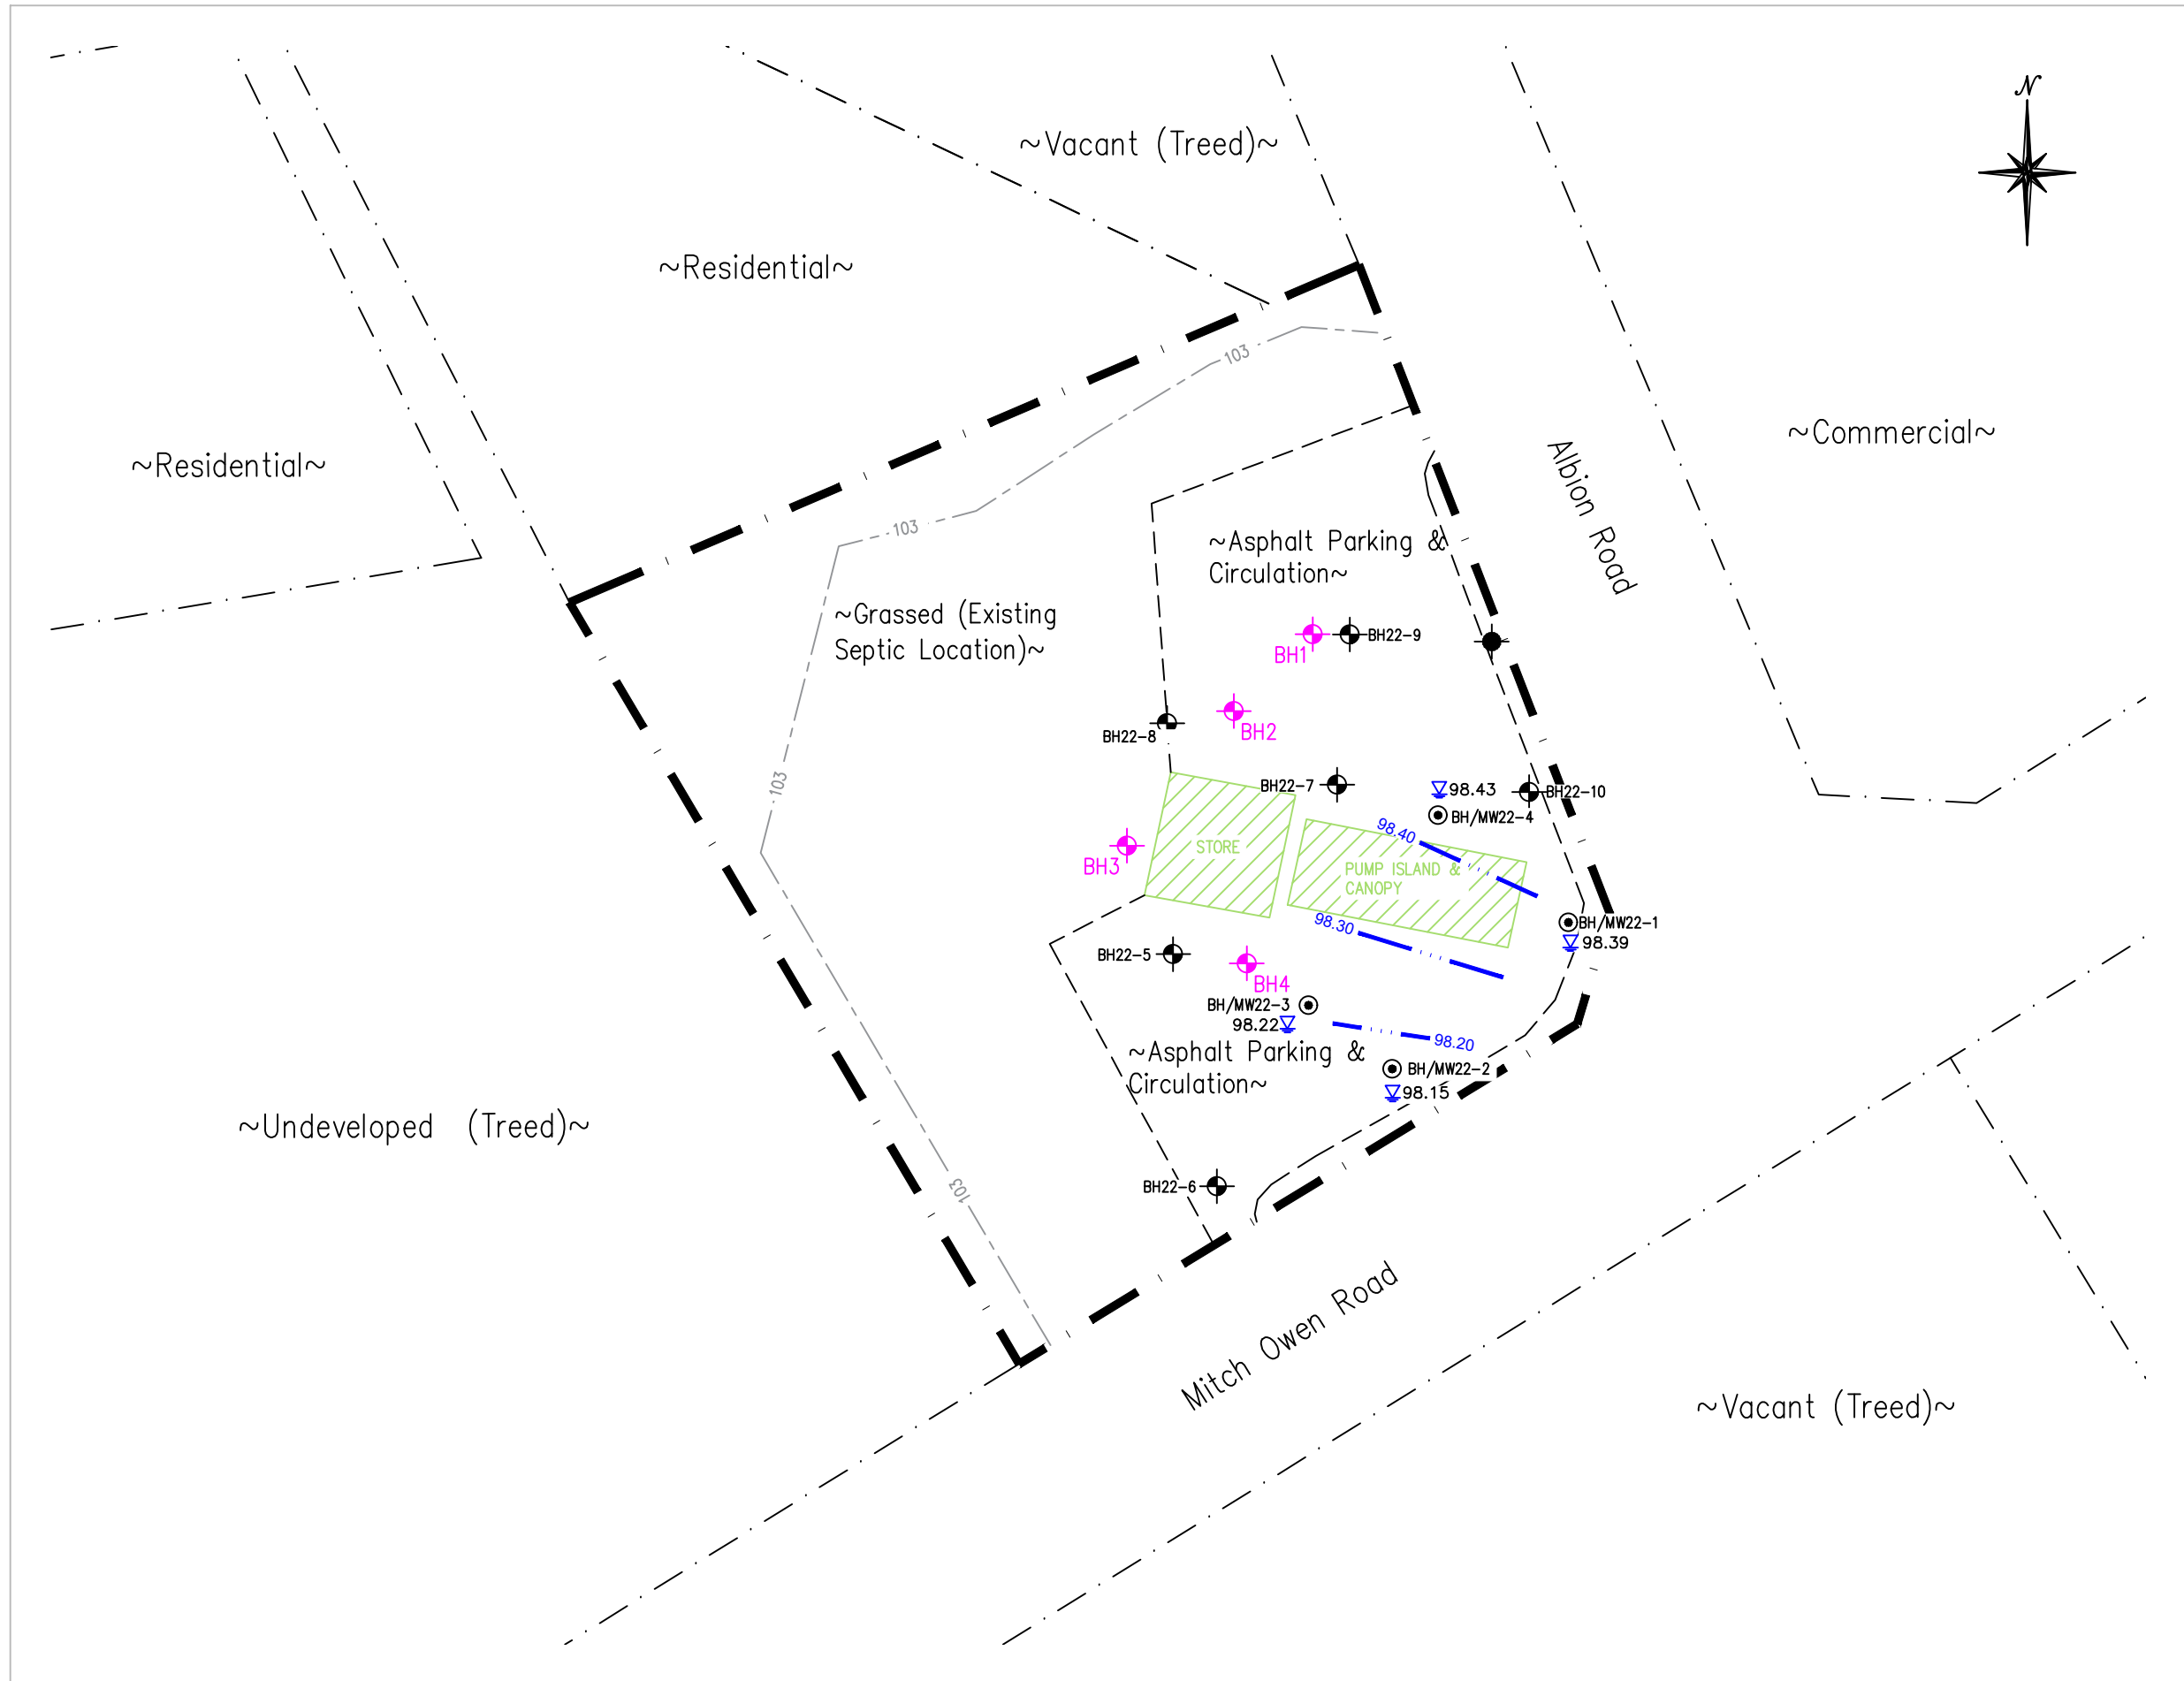

**LEGEND**

- Property Line
- Existing Building/Structure
- Existing Supply Well
- Approximate Topographic Contour
- Phase II Environmental Site Assessment Groundwater Monitoring Well (July 2022)
- Phase II Environmental Site Assessment Borehole (July 2022)
- Geotechnical Investigation Borehole (May 2022)
- Groundwater Elevation (July 2022)
- Ground Contour (July 2022)



SCALE: 1:1750

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



**LRL**

ENGINEERING | INGÉNIERIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY: --      DRAWN BY: J.A.      APPROVED BY: J.A.

PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**





































DRAWING TITLE  
**BOREHOLE & MONITORING WELL LOCATIONS (GEOTECHNICAL INVESTIGATION & ESA)**


PROJECT NO.  
01348

DATE  
NOVEMBER 2024

**FIGURE 9**

**LEGEND:**

-  EXISTING PROPERTY LINE TO REMAIN
-  PROPOSED CURB
-  PROPOSED DEPRESSED CURB
-  PROPOSED SILT FENCE AS PER OPSD 219.110
-  PROPOSED FENCE
-  PROPOSED DOOR ENTRANCE/EXIT
-  PROPOSED GRASS AREA (100mm TOP SOIL & SOD)
-  PROPOSED CONCRETE FEATURES/SLAB
-  PROPOSED HEAVY DUTY ASPHALT
-  PROPOSED LIGHT DUTY ASPHALT
-  PROPOSED RIP RAP
- 
-  PROPOSED ELEVATION
-  PROPOSED HIGH POINT ELEVATION
-  PROPOSED SWALE ELEVATION
-  PROPOSED BOTTOM OF CURB / ASPHALT ELEVATION
-  PROPOSED TOP OF CURB ELEVATION
-  MATCH INTO EXISTING ELEVATION
-  EXISTING ELEVATION
- 
-  PROPOSED OVERLAND MAJOR FLOW ROUTE
- 
-  PROPOSED STORM SEWER
-  PROPOSED WATERMAIN
-  EXISTING STORM SEWER
-  EXISTING SANITARY SEWER
-  EXISTING WATERMAIN
- 
-  EXISTING MANHOLE
-  EXISTING CATCHBASIN
-  PROPOSED CATCHBASIN-MANHOLE/CATCHBASIN
-  PROPOSED MANHOLE
-  PROPOSED CURB STOP
- 
-  PROPOSED PIPE INSULATION
-  PROPOSED 100 YEAR HIGH WATER LEVEL (ELEV = 103.85)
-  PROPOSED 5 YEAR HIGH WATER LEVEL (ELEV = 103.80)
- 
-  STORM WATERSHED EXTENT
- 
-  WATERSHED NAME
-  RUNOFF COEFFICIENT
-  AREA IN HECTARES

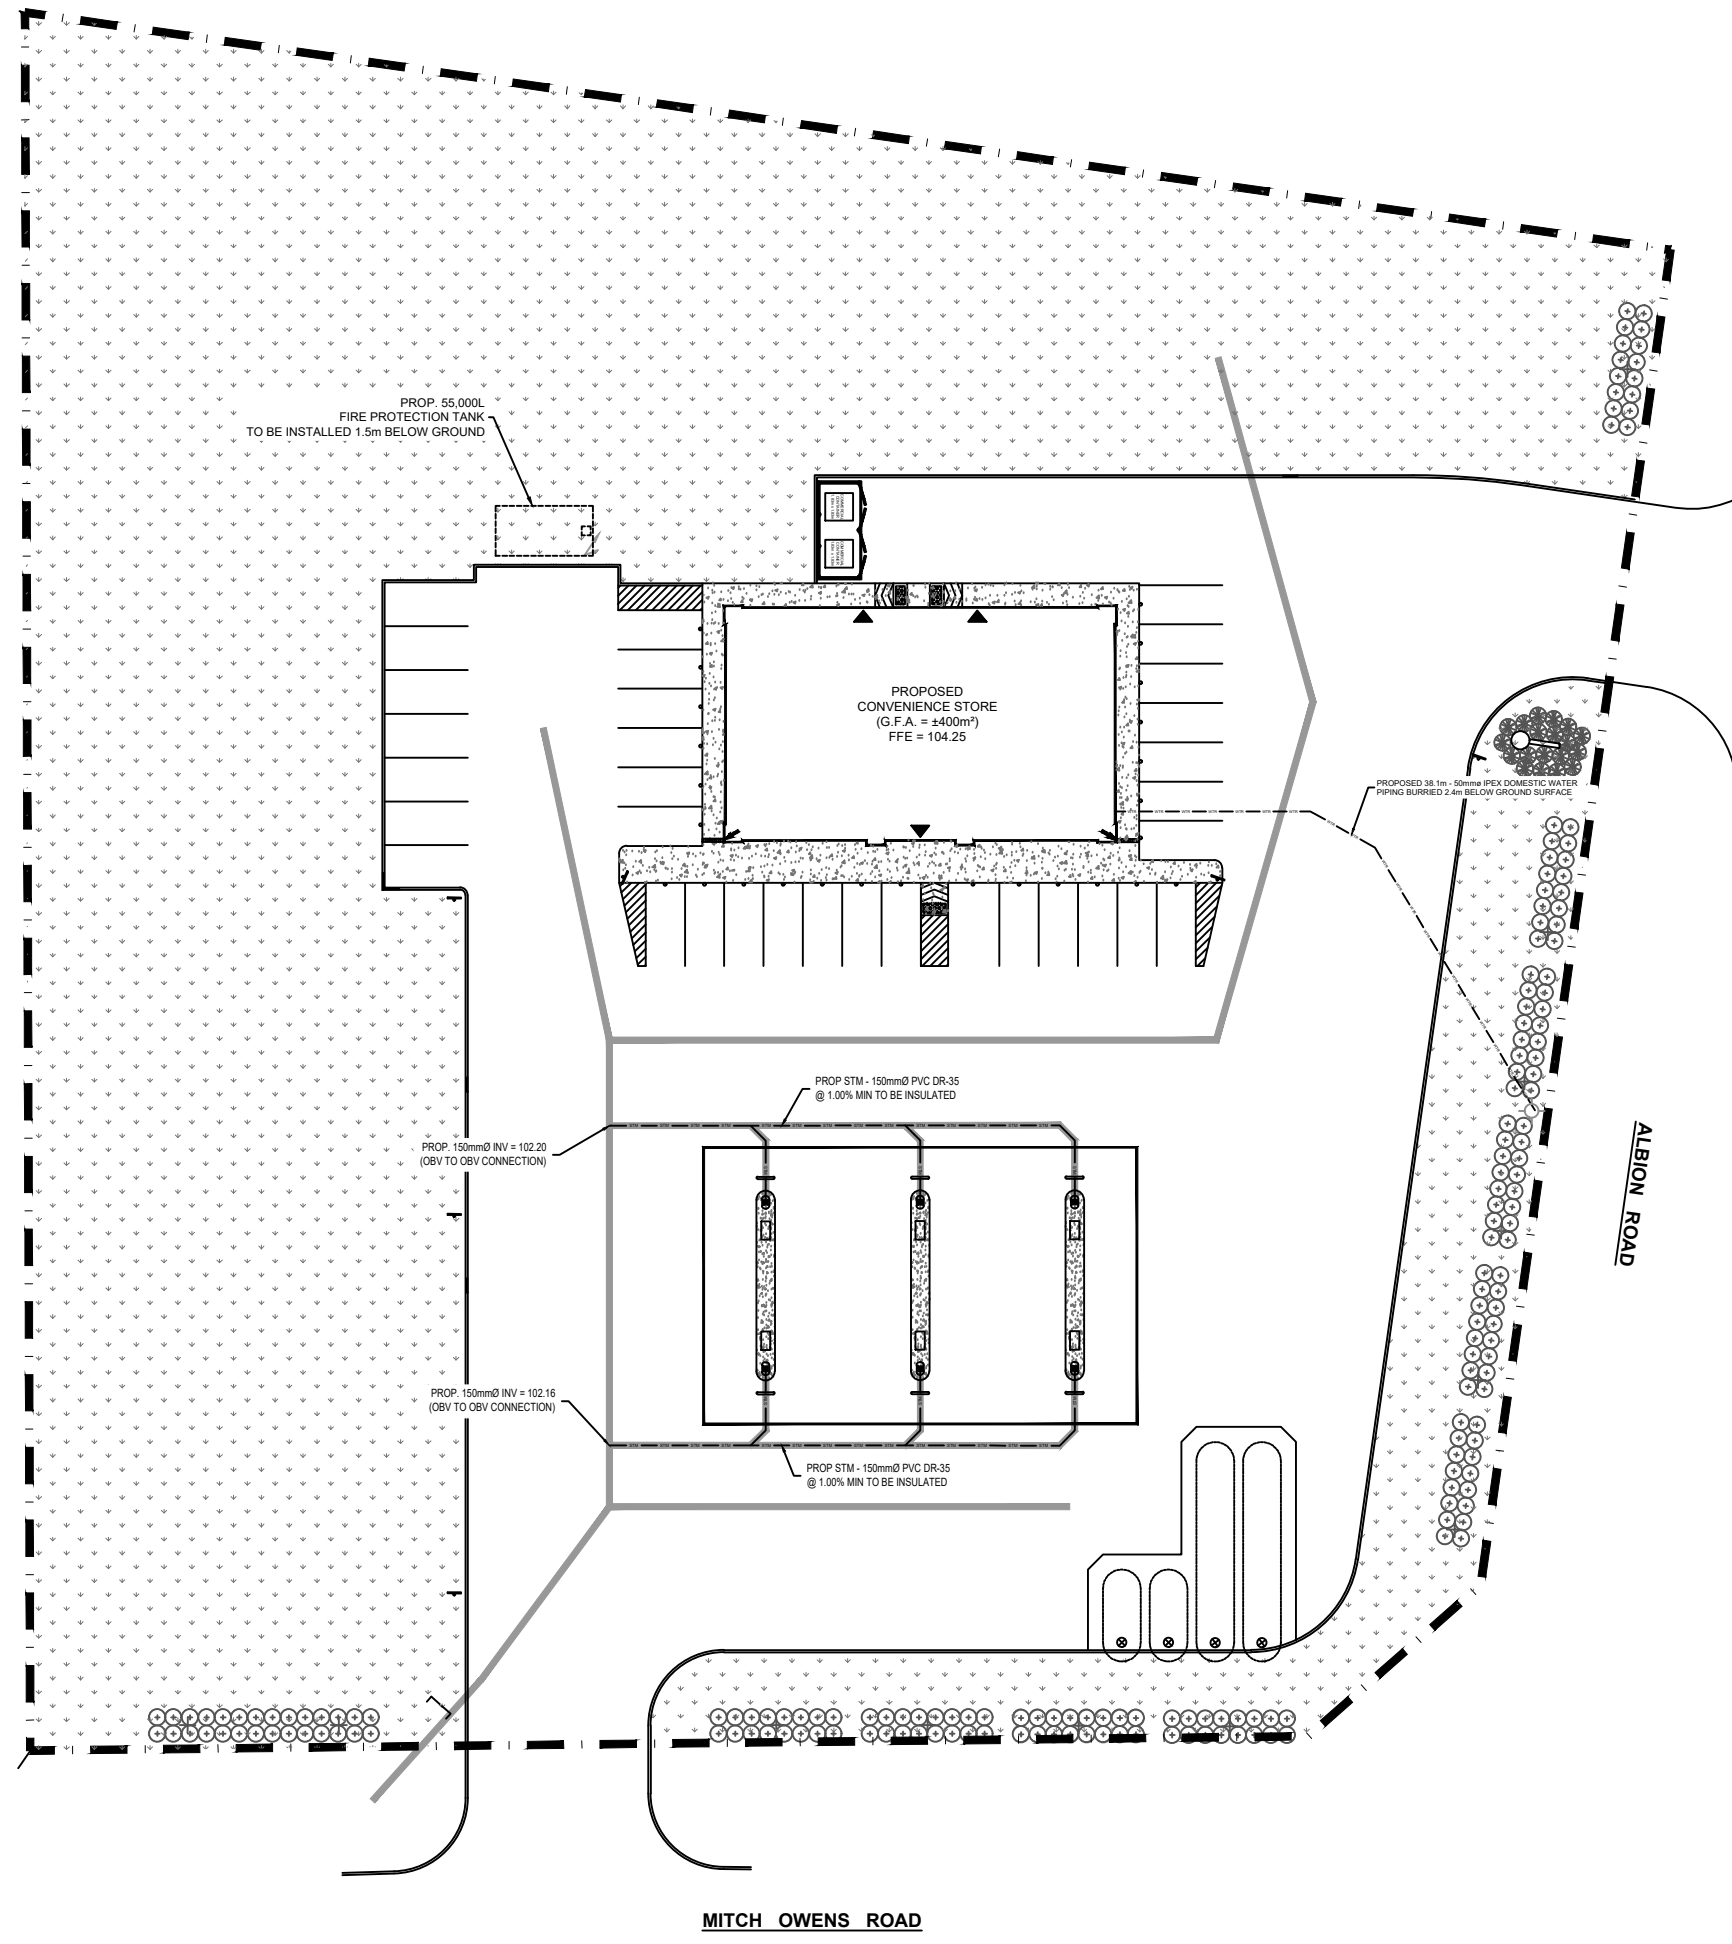

SCALE: 1:500

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



**LRL**  
ENGINEERING | INGÉNIERIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT			
<b>MACEWEN PETROLEUM INC.</b>			
DESIGNED BY:	DRAWN BY:	APPROVED BY:	
--	J.A.	J.A.	


PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS**  
5546 ALBION ROAD  
OTTAWA, ONTARIO

DRAWING TITLE  
**PROPOSED DEVELOPMENT PLAN**

PROJECT NO.  
01348

DATE  
NOVEMBER 2024

FIGURE10

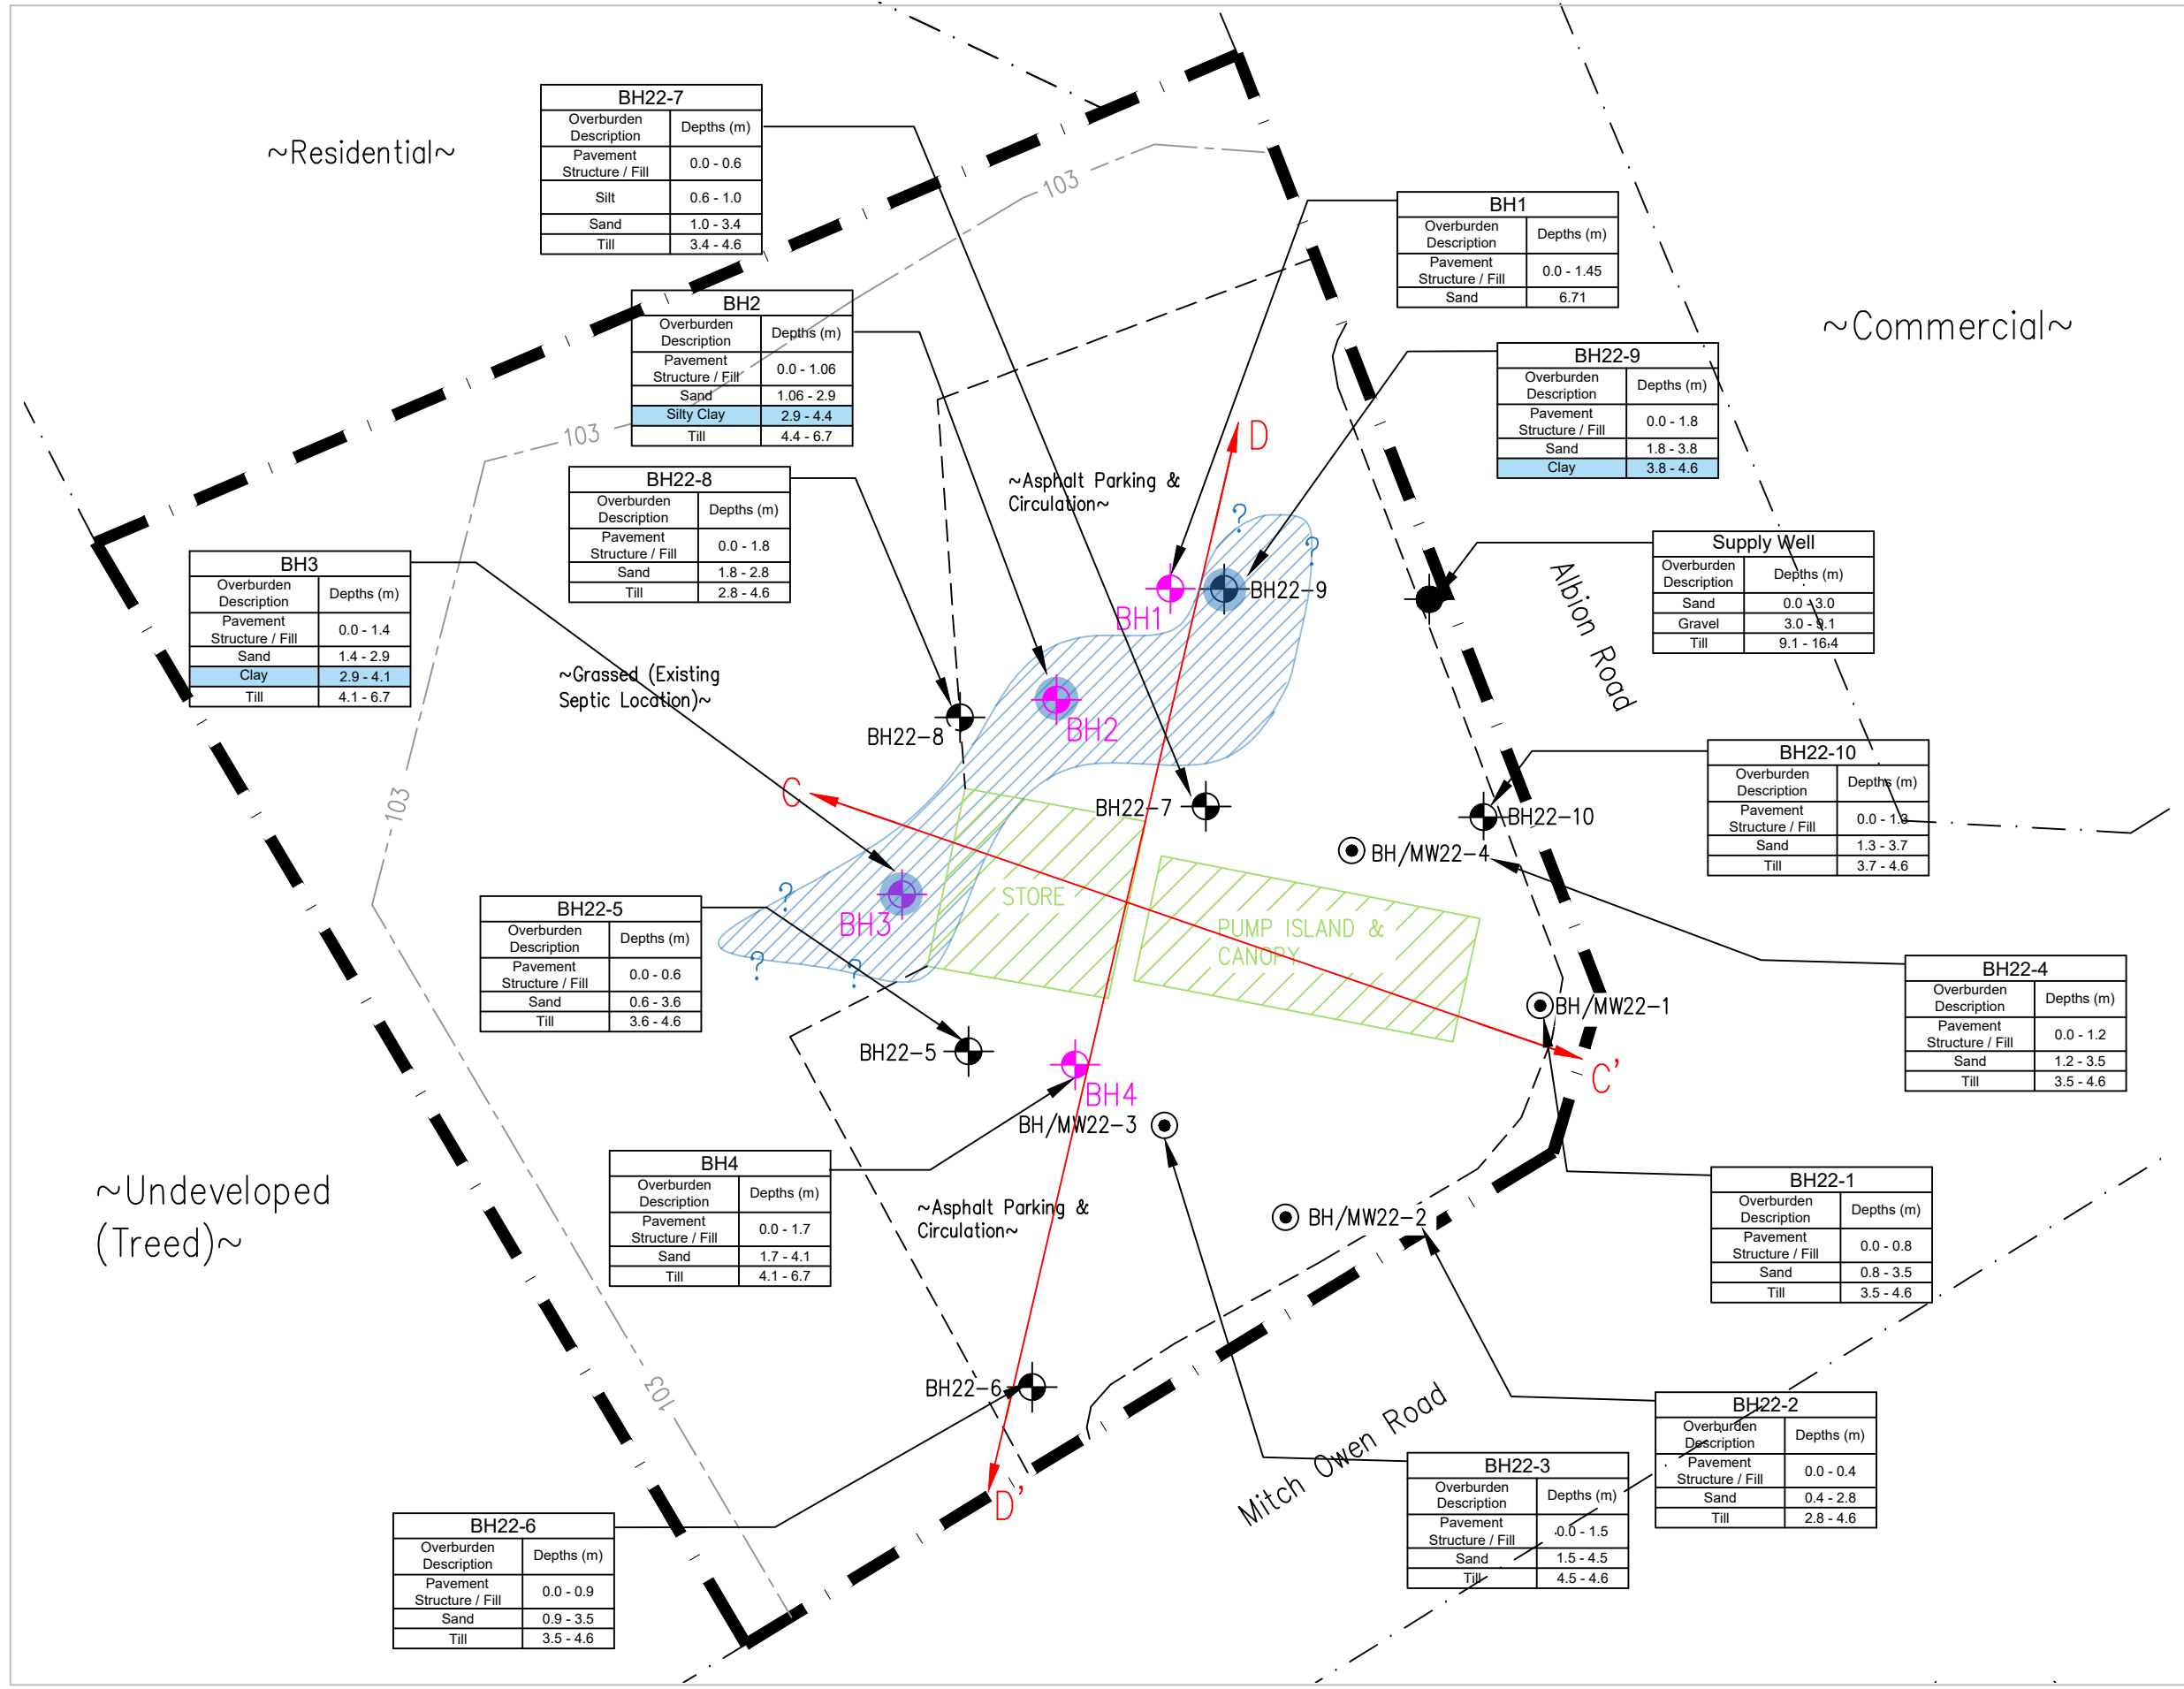

BH22-7	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 0.6
Silt	0.6 - 1.0
Sand	1.0 - 3.4
Till	3.4 - 4.6

BH2	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.06
Sand	1.06 - 2.9
Silty Clay	2.9 - 4.4
Till	4.4 - 6.7

BH22-8	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.8
Sand	1.8 - 2.8
Till	2.8 - 4.6

BH3	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.4
Sand	1.4 - 2.9
Clay	2.9 - 4.1
Till	4.1 - 6.7

BH1	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.45
Sand	6.71

BH22-9	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.8
Sand	1.8 - 3.8
Clay	3.8 - 4.6

Supply Well	
Overburden Description	Depths (m)
Sand	0.0 - 3.0
Gravel	3.0 - 9.1
Till	9.1 - 16.4

BH22-10	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.3
Sand	1.3 - 3.7
Till	3.7 - 4.6

BH22-5	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 0.6
Sand	0.6 - 3.6
Till	3.6 - 4.6

BH22-4	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.2
Sand	1.2 - 3.5
Till	3.5 - 4.6

BH4	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.7
Sand	1.7 - 4.1
Till	4.1 - 6.7

BH22-1	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 0.8
Sand	0.8 - 3.5
Till	3.5 - 4.6

BH22-6	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 0.9
Sand	0.9 - 3.5
Till	3.5 - 4.6

BH22-3	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 1.5
Sand	1.5 - 4.5
Till	4.5 - 4.6

BH22-2	
Overburden Description	Depths (m)
Pavement Structure / Fill	0.0 - 0.4
Sand	0.4 - 2.8
Till	2.8 - 4.6

**LEGEND**

- Property Line
- Existing Building/Structure
- Existing Supply Well
- Approximate Topographic Contour
- Phase II Environmental Site Assessment Groundwater Monitoring Well (July 2022)
- Phase II Environmental Site Assessment Borehole (July 2022)
- Geotechnical Investigation Borehole (May 2022)
- Estimated Extent Clay / Silty Clay Deposit Encountered in Boreholes Advanced
- Full Directional Extent of Clay / Silty Clay Deposit Un-Defined
- Borehole Advanced with Clay / Silty Clay Encountered
- Cross Section Segment



SCALE: 1:600

No.	REVISIONS	BY	DATE
02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022



**LRL**

ENGINEERING | INGENIERIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434



CLIENT			
<b>MACEWEN PETROLEUM INC.</b>			
DESIGNED BY:	DRAWN BY:	APPROVED BY:	
--	J.A.	J.A.	

PROJECT	
HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS 5546 ALBION ROAD OTTAWA, ONTARIO	

DRAWING TITLE	
APPROXIMATE EXTENT AND THICKNESS OF THE CLAY ON-SITE	

PROJECT NO.	
01348	
DATE	
NOVEMBER 2024	

FIGURE 11

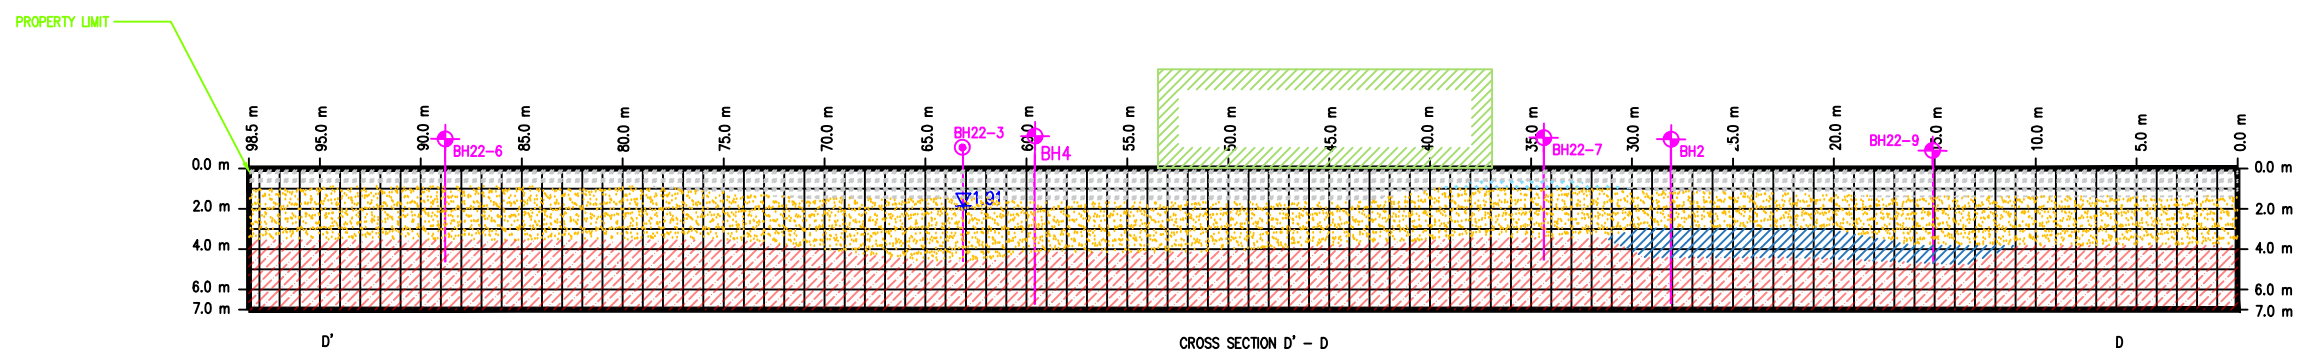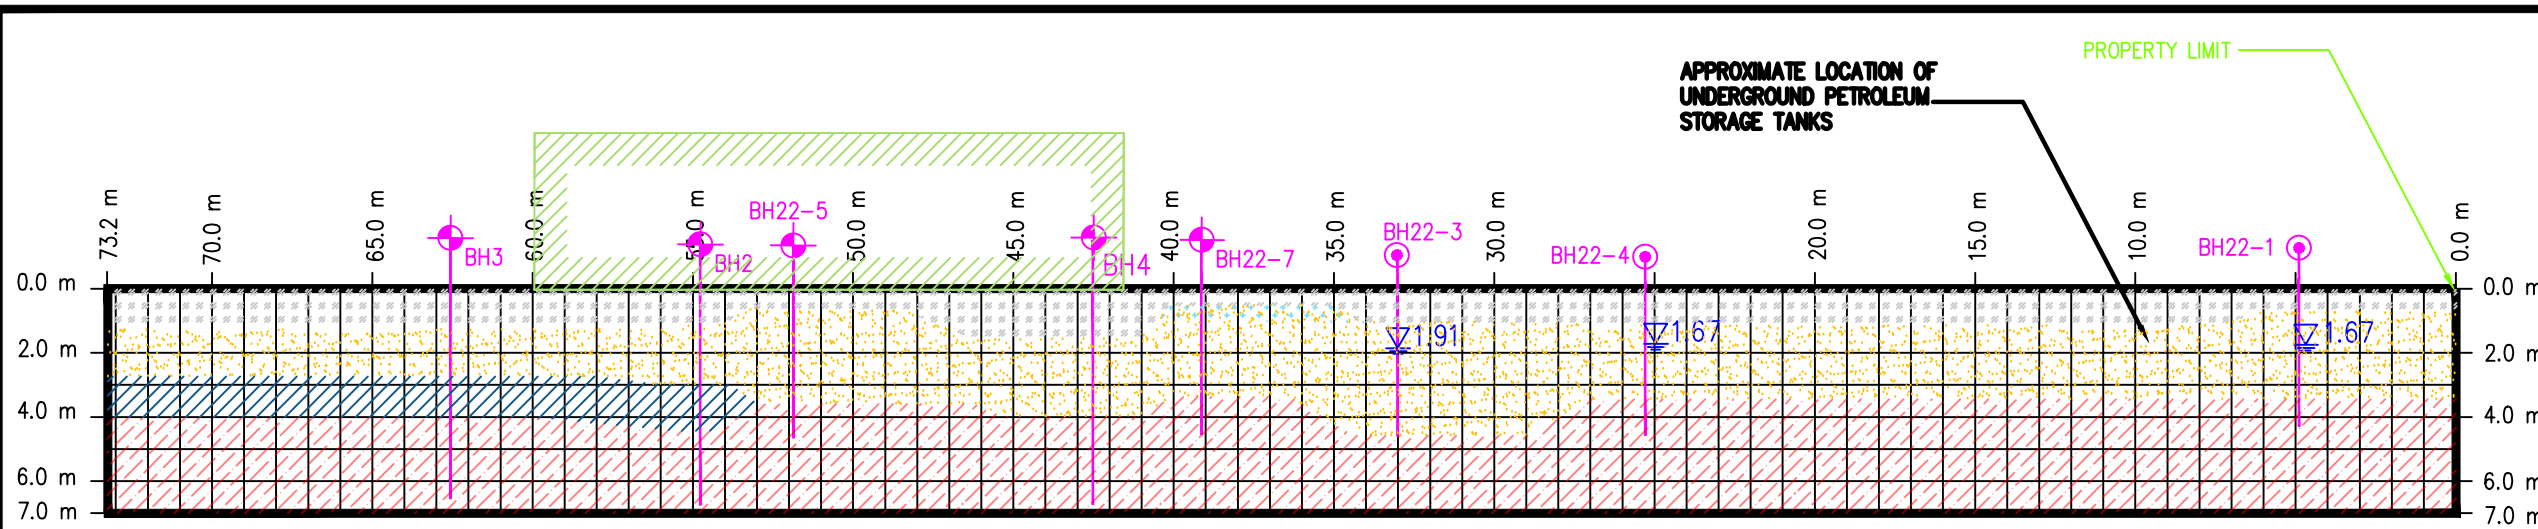

**LEGEND**

- Borehole
- Monitoring Well
- Measured Groundwater Level (m bgs)
- Sand
- Clay
- Till
- Pavement Structure and Fill Material
- Silt
- Approximate Extents of Existing Building (Convenience Store) on Site

02	REVISED	J.A.	08/11/2024
01	FINAL	J.A.	28/12/2022
No.	REVISIONS	BY	DATE



**LRL**  
ENGINEERING | INGENIERIE  
5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrl.ca | (613) 842-3434

CLIENT  
**MACEWEN PETROLEUM INC.**

DESIGNED BY: -- DRAWN BY: J.A. APPROVED BY: J.A.

PROJECT  
**HYDROGEOLOGICAL ASSESSMENT & TERRAIN ANALYSIS  
5546 ALBION ROAD  
OTTAWA, ONTARIO**

DRAWING TITLE  
**OVERBURDEN THICKNESS ACROSS SITE,  
AND CROSS SECTION C - C'  
&  
CROSS SECTION D - D'**

PROJECT NO.  
**01348**

DATE  
**NOVEMBER 2024**

**FIGURE 11A**

## TABLES

**Table 1**  
**Specific Capacity and Longterm Availability**  
Hydrogeological Assessment & Terrain Analysis- Proposed Fuel Dispensing Facility Re-Development  
5546 Albion Road South, Ottawa (Gloucester), Ontario  
LRL File: 01348

Tested By: LRL Associates Ltd.  
Well Depth 41.4

Date	Cs - Static mTOC	Cp - Pump* mTOC	Cp - Cs	Drawdown (m)	Pumping Rate L/min	Sc - Specific Capacity L/sec/m	Specific Yield (m <sup>3</sup> /day/m)	Qsc -Maximum Pumping Rate L/min	Long Term Availability m <sup>3</sup> /day	Qsc GPM (US)	Qsc GPM (IMP)
2022.10.17	2.98	22.86	19.88	1.55	30.0	3.23E-01	27.9	128.9	185.6	34.1	28.4

**Notes:**

$$Q_{sc} = 0.67 \frac{(C_p - C_s) S_c}{SF}$$

Where:

Qsc Pumping rate with safety factor (SF) of 2.5 (L/min);

C<sub>p</sub> - C<sub>s</sub> Difference between pump level and static water level (m);

S<sub>c</sub> Specific capacity (L/min/m); and

0.67 Is a factor that compensates for the variation of the static water level due to seasonal variations as well as to drawdown from nearby wells

SF 2.0

Minimum Demand 8.62 m<sup>3</sup>/day

\* Depth of Pump at the time of the Pumping Test.

Greater than Minimum Demand

Less than Minimum Demand

TOC Top of Casing



**Table 2**  
**Summary of Analysis of Water Sample Collected from the Supply Well - Subdivision Package**  
Hydrogeological Assessment & Terrain Analysis - Proposed Fuel Dispensing Facility Re-Development  
5546 Albion Road South, Ottawa (Gloucester), Ontario  
LRL File: 01348

Parameter	Units	MRL	Ontario Drinking Water Standards		MECP D-5-5 <sup>5</sup>	Sample		
			Standard	Type		5546 Albion Rd - Supply Well - 3 hrs	5546 Albion Rd - Supply Well - 6 hrs	5546 Albion Rd - Supply Well
Sample Date (d/m/y)						2022.10.17	2022.10.17	2023.11.23
<b>Microbiological Parameters</b>								
E. Coli	CFU/100 mL	1	0	MAC		<1	<1	<1
Fecal Coliforms	CFU/100 mL	1	0 <sup>1</sup>	MAC		<1	<1	<1
Heterotrophic Plate Count	CFU/ml	10	--			10	10	10
Total Coliforms	CFU/100 mL	1	0/5 <sup>1</sup>	MAC		<b>4</b>	<b>2</b>	<b>1</b>
<b>General Inorganics</b>								
Alkalinity, total	mg/L	5	30 - 500	OG		189	198	187
Ammonia as N	mg/L	0.01	--			0.02	0.03	0.04
Dissolved Organic Carbon	mg/L	0.5	5	AO	10	0.9	0.9	<0.5
Colour	TCU	2	5	AO	7	<2	<2	<2
Conductivity	uS/cm	5	--			534	584	470
Hardness	mg/L	1.1	80 - 100	OG	500	<b>204</b>	<b>219</b>	<b>203</b>
pH	pH Units	0.05	6.5 - 8.5	OG		8.0	8.0	8.0
Phenolics	mg/L	0.001	--			<0.001	<0.001	<0.001
Total Dissolved Solids	mg/L	10	500	AO		300	336	258
Sulphide	mg/L	0.02	0.05	AO		<0.02	<b>0.12</b>	<0.02
Tannin & Lignin	mg/L	0.1	--			<0.1	<0.1	<0.1
Total Kjeldahl Nitrogen	mg/L	0.1	--			0.1	<0.1	<0.1
Organic Nitrogen	mg/L		0.15	OG		0.08	0.02	0.01
Turbidity	NTU	0.1	1/5 <sup>2</sup>	MAC/AO	5	4.2	<b>8.8</b>	3.4
<b>Anions</b>								
Chloride	mg/L	1	250	AO	250	23	30	14
Fluoride	mg/L	0.1	1.5 <sup>3</sup> /2.4	MAC		0.2	0.1	0.1
Nitrate as N	mg/L	0.1	10	MAC		<0.1	<0.1	<0.1
Nitrite as N	mg/L	0.05	1	MAC		<0.10	<0.10	<0.05
Sulphate	mg/L	1	500	AO	500	51	56	52
<b>Metals</b>								
Calcium	mg/L	0.1	--			50.3	54.3	51.0
Iron	mg/L	0.1	0.3	AO	10	<b>0.4</b>	<b>0.9</b>	<b>0.5</b>
Magnesium	mg/L	0.2	--			19.2	20.3	18.5
Manganese	mg/L	0.005	0.05	AO	1	0.019	0.029	0.015
Potassium	mg/L	0.1	--			1.8	1.9	2
Sodium	mg/L	0.2	20 <sup>1</sup> /200	AO	200	15.3	17.1	11.2

**NOTES**

- MRL** Minimum Reportable Limit
- MAC** Maximum Acceptable Concentration
- AO** Aesthetic Objective
- OG** Operational Guideline
- ODWS** Ontario Drinking Water Standards (2006)
- NA** Not Analysed
- UNDERLINE** Parameter level above ODWS
- italics** Notify Medical Officer of Health
- BOLD** Parameter level above D-5-5 maximum treatability limits

<sup>1</sup> As per Table 1 of MECP's technical guideline "D-5-5 Private Wells: Water Supply Assessment"

<sup>2</sup> 1.0 NTU MAC if treatment system required to provide filtration for disinfection. 5.0 NTU AO for all points of consumption

<sup>3</sup> Where supplies of naturally occurring fluoride at levels above 1.5 mg/L but below 2.4 mg/L the Ministry of Health recommends notification of local board of health of levels to avoid excesses exposure from other sources.

<sup>4</sup> Limit at which Local Medical Officer of Health should be notified of Levels.

<sup>5</sup> MECP D-5-5 guideline, maximum concentration considered reasonably treatable

**Table 3**  
**Langelier and Ryznar Calculations**

Hydrogeological Assessment & Terrain Analysis - Proposed Fuel Dispensing Facility Re-Development  
5546 Albion Road South, Ottawa (Gloucester), Ontario  
LRL File: 01348

**Analyzed Parameters**

TDS (mg/L)	336
Hardness (mg/L)	219
Alkalinity (mg/L)	198
pH (pH units)	8.0
Temperature °C	10

**Langelier**

LSI = pH - pHs

pHs = (9.3 +A+B) - (C+D)	Where	A= (Log10(TDS)-1)/10	=	0.1526339
		B= (-13.12*Log10(T°C+273))+34.55	=	2.382562
		C= Log10(Hardness)-0.4	=	1.9404441
		D= Log10(Alkalinity)	=	2.2966652

**Ryznar**

RI=2pHs-pH

pHs=	7.598086589
LSI=	0.401913
RI=	7.196173177

**Langelier**

-2.0 < -0.5	Serious Corrosion
-0.5 < 0	Slightly corrosive byt non-scale forming
LSI = 0.0	Balanced but pitting corrosion possible
0.0 < 0.5	Slightly scale forming and corrosive
0.5 < 2	Scale forming but non corrosive

<http://www.lenntech.com/calculators/langelier/index/langelier.htm>

**Ryznar**

4.0-5.0	Heavy Scale
5.0-6.0	Light Scale
6.0-7.0	Light Scale or Corrosion
7.0-7.5	Corrosion Significant
7.5-9.0	Heavy Corrosion
9.0 +	Corrosion is Intolerable

<http://www.lenntech.com/calculators/ryznar/index/ryznar.htm>

**Table 4**  
**Summary of Analysis of Water Sample Collected from the Supply Well - Trace Metals**  
 Hydrogeological Assessment & Terrain Analysis - Proposed Fuel Dispensing Facility Re-Development  
 5546 Albion Road South, Ottawa (Gloucester), Ontario  
 LRL File: 01348

Parameter	Units	Ontario Drinking Water Standards			MECP D-5-5 <sup>1</sup>	Sample	
		MRL	Standard	Type		5546 Albion Rd - Supply Well	5546 Albion Rd - Supply Well
Sample Date (d/m/y)						2022.10.17	2023.11.23
<b>Metals</b>							
Aluminum	mg/L	0.001				0.001	<0.001
Antimony	mg/L	0.0005	0.006			<0.0005	<0.0005
Arsenic	mg/L	0.001	0.01	MAC		<0.001	<0.001
Barium	mg/L	0.001	1	MAC		0.033	0.122
Beryllium	mg/L	0.0005				<0.0005	<0.0005
Boron	mg/L	0.01	5	MAC		0.05	0.05
Cadmium	mg/L	0.0001	0.005	MAC		<0.0001	<0.0001
Calcium	mg/L	0.1				21.4	51.0
Chromium	mg/L	0.001	0.05	MAC		<0.001	<0.001
Cobalt	mg/L	0.0005				<0.0005	<0.0005
Copper	mg/L	0.0005	1	AO		0.0009	0.0009
Iron	mg/L	0.1	0.3	AO	10	0.2	0.5
Lead	mg/L	0.0001	0.01	MAC		<0.0001	0.0001
Magnesium	mg/L	0.2				19.1	18.5
Manganese	mg/L	0.005	0.05	AO	1	<u>0.070</u>	0.015
Molybdenum	mg/L	0.0005				0.0027	0.0038
Nickel	mg/L	0.001				<0.001	<0.001
Potassium	mg/L	0.1				2.7	2.0
Selenium	mg/L	0.001	0.05	MAC		<0.001	<0.001
Silver	mg/L	0.0001				<0.0001	0.0001
Sodium	mg/L	0.2	20/200	MAC/AO	200	15.5	11.2
Strontium	mg/L	0.01				0.08	0.23
Thallium	mg/L	0.001				<0.001	<0.001
Tin	mg/L	0.01				<0.01	<0.01
Titanium	mg/L	0.005				<0.005	<0.005
Tungsten	mg/L	0.01				<0.01	<0.01
Uranium	mg/L	0.0001	0.02	MAC		<0.0001	0.0004
Vanadium	mg/L	0.0005				<0.0005	<0.0005
Zinc	mg/L	0.005	5	AO		<0.005	<0.005

**NOTES**

- MRL** Minimum Reportable Limit
  - MAC** Maximum Acceptable Concentration
  - AO** Aesthetic Objective
  - OG** Operational Guideline
  - ODWS** Ontario Drinking Water Standards (2006)
  - NA** Not Analysed
  - UNDERLINE** Parameter level above ODWS
- <sup>1</sup> MECP D-5-5 guideline, maximum concentration considered reasonably treatable

**Table 5**  
**Summary of Analysis of Water Sample Collected from the Supply Well - VOC & PHC**  
 Hydrogeological Assessment & Terrain Analysis- Proposed Fuel Dispensing Facility Re-Development  
 5546 Albion Road South, Ottawa (Gloucester), Ontario  
 LRL File: 01348

Parameter	Units	MRL	Ontario Drinking Water Standards		Sample		
			Standard	Type	5546 Albion Rd - Supply Well - 3 hrs	5546 Albion Rd - Supply Well - 6 hrs	5547 Albion Rd - Supply Well
Sample Date (d/m/y)					2022.10.17	2022.10.17	2023.11.23
<b>Volatiles</b>							
Acetone	ug/L	5.0			--	<5.0	<5.0
Benzene	ug/L	0.5	1	MAC	--	<0.5	<0.5
Bromodichloromethane	ug/L	0.5			--	<0.5	<0.5
Bromoform	ug/L	0.5			--	<0.5	<0.5
Bromomethane	ug/L	0.5			--	<0.5	<0.5
Carbon Tetrachloride	ug/L	0.2	2	MAC	--	<0.2	<0.2
Chlorobenzene	ug/L	0.5	80	MAC	--	<0.5	<0.5
Chloroethane	ug/L	1.0			--	<1.0	<1.0
Chloroform	ug/L	0.5			--	<0.5	<0.5
Chloromethane	ug/L	3.0			--	<3.0	<3.0
Dibromochloromethane	ug/L	0.5			--	<0.5	<0.5
Dichlorodifluoromethane	ug/L	1.0			--	<1.0	<1.0
Ethylene dibromide (dibromoethane, 1,2-)	ug/L	0.2			--	<0.2	<0.2
1,2-Dichlorobenzene	ug/L	0.5	200	MAC	--	<0.5	<0.5
1,3-Dichlorobenzene	ug/L	0.5			--	<0.5	<0.5
1,4-Dichlorobenzene	ug/L	0.5	5	MAC	--	<0.5	<0.5
1,1-Dichloroethane	ug/L	0.5			--	<0.5	<0.5
1,2-Dichloroethane	ug/L	0.5	5	MAC	--	<0.5	<0.5
1,1-Dichloroethylene	ug/L	0.5	14	MAC	--	<0.5	<0.5
cis-1,2-Dichloroethylene	ug/L	0.5			--	<0.5	<0.5
trans-1,2-Dichloroethylene	ug/L	0.5			--	<0.5	<0.5
1,2-Dichloroethylene, total	ug/L	0.5			--	<0.5	<0.5
1,2-Dichloropropane	ug/L	0.5			--	<0.5	<0.5
cis-1,3-Dichloropropylene	ug/L	0.5			--	<0.5	<0.5
trans-1,3-Dichloropropylene	ug/L	0.5			--	<0.5	<0.5
1,3-Dichloropropene, total	ug/L	0.5			--	<0.5	<0.5
Ethylbenzene	ug/L	0.5	140	MAC	--	<0.5	<0.5
Hexane	ug/L	1.0			--	<1.0	<1.0
Methyl Ethyl Ketone (2-Butanone)	ug/L	5.0			--	<5.0	<5.0
Methyl Butyl Ketone (2-Hexanone)	ug/L	10.0			--	<10.0	<10.0
Methyl Isobutyl Ketone	ug/L	5.0			--	<5.0	<5.0
Methyl tert-butyl ether	ug/L	2.0			--	<2.0	<2.0
Methylene Chloride	ug/L	5.0	50	MAC	--	<5.0	<5.0
Styrene	ug/L	0.5			--	<0.5	<0.5
1,1,1,2-Tetrachloroethane	ug/L	0.5			--	<0.5	<0.5
1,1,2,2-Tetrachloroethane	ug/L	0.5			--	<0.5	<0.5
Tetrachloroethylene	ug/L	0.5	10	MAC	--	<0.5	<0.5
Toluene	ug/L	0.5	60	MAC	--	<0.5	<0.5
1,1,1-Trichloroethane	ug/L	0.5			--	<0.5	<0.5
1,1,2-Trichloroethane	ug/L	0.5			--	<0.5	<0.5
Trichloroethylene	ug/L	0.5	5	MAC	--	<0.5	<0.5
Trichlorofluoromethane	ug/L	1.0			--	<1.0	<1.0
1,3,5-Trimethylbenzene	ug/L	0.5			--	<0.5	<0.5
Vinyl Chloride	ug/L	0.5	1	MAC	--	<0.5	<0.5
m/p-Xylene	ug/L	0.5			--	<0.5	<0.5
o-Xylene	ug/L	0.5			--	<0.5	<0.5
Xylenes, total	ug/L	0.5	90	MAC	--	<0.5	<0.5
<b>Petroleum Hydrocarbons (PHC)</b>							
PHC F1 (C6 - C10)	ug/L	0.025			--	--	<0.0250
PHC F2 (C10-C16)	ug/L	0.1			--	--	<0.1
PHC F3 (C16-C34)	ug/L	0.1			--	--	<0.1
PHC F4 (C34-C50)	ug/L	0.1			--	--	<0.1

**NOTES**

- MRL Minimum Reportable Limit
- MAC Maximum Acceptable Concentration
- ODWS Ontario Drinking Water Standards (2006)

**Table 6**  
**Summary of Analysis of Water Sample Collected from the Supply Well - PAH**  
 Hydrogeological Assessment & Terrain Analysis- Proposed Fuel Dispensing Facility Re-Development  
 5546 Albion Road South, Ottawa (Gloucester), Ontario  
 LRL File: 01348

Parameter	Units	MRL	Ontario Drinking Water Standards		Sample
			Standard	Type	5547 Albion Rd - Supply Well
<b>Sample Date (d/m/y)</b>					<b>2023.11.23</b>
<b>Semi-Volatiles</b>					
Acenaphthene	ug/L	0.05			<5.0
Acenaphthylene	ug/L	0.05			<0.5
Anthracene	ug/L	0.01			<0.5
Benzo[a]anthracene	ug/L	0.01			<0.5
Benzo[a]pyrene	ug/L	0.01	0.01	MAC	<0.5
Benzo[b]fluoranthene	ug/L	0.05			<0.2
Benzo[g,h,i]perylene	ug/L	0.05			<0.5
Benzo[k]fluoranthene	ug/L	0.05			<1.0
Chrysene	ug/L	0.05			<0.5
Dibenzo[a,h]anthracene	ug/L	0.05			<3.0
Fluoranthene	ug/L	0.01			<0.5
Fluorene	ug/L	0.05			<1.0
Indeno [1,2,3-cd] pyrene	ug/L	0.05			<0.2
1-Methylnaphthalene	ug/L	0.05			<0.5
2-Methylnaphthalene	ug/L	0.05			<0.5
Methylnaphthalene (1&2)	ug/L	0.1			<0.5
Naphthalene	ug/L	0.05			<0.5
Phenanthrene	ug/L	0.05			<0.5
Pyrene	ug/L	0.01			<0.5

**NOTES**

- MRL** Minimum Reportable Limit
- MAC** Maximum Acceptable Concentration
- ODWS** Ontario Drinking Water Standards (2006)

**Table 7**  
**Contaminant Attenuation Consideration (Predictive Assessment) - Available Infiltration**  
Hydrogeological Assessment & Terrain Analysis- Proposed Fuel Dispensing Facility Re-Development  
5546 Albion Road South, Ottawa (Gloucester), Ontario  
LRL File: 01348

**1. Potential Infiltration**

Weather Station          Ottawa

No.	Section Area (m <sup>2</sup> )	Infiltration Factor (IF) <sup>1</sup>							Moisture Surplus (MS)				Potential Infiltration (PI) (IF*MS) (mm)	
		Topography	Value	Soil	Value	Cover	Value	Total	Ground Cover	Soil Type	Moisture Retention <sup>2</sup> (mm)	Moisture Surplus <sup>3</sup> (mm)	Section	Weighted
1	2,807	Flat	0.3	Sand	0.4	Woodland	0.2	0.9	Deep Rooted Crops	1 Fine Sand	100	363	326.7	76.9
2	9,113	Flat	0.3	Sand	0.4	Cultivated Land	0.1	0.8	Shallow Rooted Crops	1 Fine Sand	50	407	325.6	248.9
<b>Total<sup>6</sup></b>													<b>Total</b>	<b>325.9</b>

**2. Area Available for Infiltration**

Approximate footprint of the proposed store	H	400 m2
Approximate footprint of the proposed pump island concrete apron	H	525 m2
Approximate Area of Proposed Parking and Circulation	L	4,055 m2
Total Area of Property		11,920 m2
Impervious Area		4,980 m <sup>2</sup>
Roads	l x w	- m2
Parking and Circulation	d	4,055 m2
Building or Structure	Sum of H's	925 m2
<b>Permeable Area</b>	<b>A</b>	<b>6,940 m<sup>2</sup></b>

**3. Available Infiltration & Volume Calculations**

Nitrate Concentration of Infiltration <sup>4</sup>	C <sub>i</sub>	0 mg/L
Site Infiltration	Q <sub>i</sub> = A*PI	2,261 m <sup>3</sup>
Daily Sewage Volume - Proposed New Development <sup>5</sup>	Q <sub>d</sub>	7.72 m <sup>3</sup>
Maximum Yearly Sewage Volume - Proposed New Development	Q <sub>e</sub> =365*Q <sub>d</sub>	2,818 m <sup>3</sup>

**NOTES**

- <sup>1</sup> Table 2: Infiltration Factors, *Hydrological Technical Information Requirements for Land Development Applications*, Ministry of the Energy and Environment, April 1995.
- <sup>2</sup> Thornthwaite and Mather's (1957) Instructions and Tables for Computing Potential Evapotranspiration and the Water Balance.
- <sup>3</sup> Moisture surplus for data for Ottawa ON (Environment Canada Meteorological Service of Canada, 2010).
- <sup>4</sup> The nitrate concentration of infiltration is assumed to be 0.0 mg/L.
- <sup>5</sup> As Per Septic Design for the Site - Prepared by Others

**ATTACHMENT A**  
**Topographic Map**





**ATTACHMENT B**  
**WETLAND BOUNDARY REPORT – GEMTEC JUNE 2022**

June 6, 2022

File: 101972.001

LRL Engineering  
5430 Canotek Road  
Ottawa, Ontario  
K1J 9G2

Attention: Maxime Longtin, C.E.T. – Civil Team Manager

**Re: Wetland Boundary Assessment, Unevaluated Wetland  
Lot 30, Concession 3, From Rideau River Gloucester  
Ottawa, Ontario**

---

Please accept this letter as the GEMTEC Consulting Engineers and Scientists Limited (GEMTEC) Wetland Boundary Assessment completed for the property parcel municipally addressed as 5546 Albion Road and the west adjacent property located on Lot 30, Concession 3, From Rideau River Gloucester, herein collectively referred to as the study area.

## **INTRODUCTION**

The purpose of this letter report is to provide a summary of the wetland boundary assessment completed for the unevaluated, local wetland identified by the City of Ottawa as occupying portions of both property parcels comprising the study area. The study area is illustrated on Figure A.1 in Attachment A.

## **BACKGROUND**

It is GEMTEC's understanding that LRL Engineering (LRL) is completing an Environmental Impact Statement (EIS) for 5546 Albion Road and requires a certified Ontario Wetland Evaluation System (OWES) wetland evaluator to establish and ground-truth the boundary of wetlands within the study area.

The unevaluated, local wetland as identified by the City of Ottawa, covers approximately 10 ha, and is located immediately north of Mitch Owens Road, south of Ballycastle Crescent, east of the Spratt Municipal Drain (SMD) and west of Albion Road.

The nearest Provincially Significant Wetland (PSW), the Osgood PSW complex, is located approximately 4 km southeast of the study area.

Based on review of aerial photography (1976, 1999, 2002-2018) the study area was cleared sometime prior to 1976. Since 1976, the study area has been left in a fallow state to revegetate with the exception of periodic drainage improvements to the SMD and the construction of stormwater infrastructure associated with the Ballycastle Crescent subdivision to the north.

## **METHODOLOGY**

To complete this Wetland Boundary Assessment, vegetation communities were delineated following the protocols outlined in the Wetland Evaluation System for Southern Ontario (OMNRF, 2014) supported by publicly available air photos and surficial soil data from the Ontario Soil Survey Complex (OMAFRA, 2022). A single field investigation was completed on May 25, 2022, from 07:00 to 09:00 to provide field verification of vegetation communities delineated during the desktop review. The conditions at the time of the field investigation were: clear skies with no precipitation, 21°C and light wind.

Field verification of vegetation communities was completed by walking linear transects along the soil moisture gradient from drier to wetter ecosites while documenting dominant vegetation species within the various vegetation community forms. The boundary between wetland ecosites and terrestrial ecosites was determined using the *50/50 Vegetation Rule* as outlined in the Ontario Wetland Evaluation System for Southern Ontario (OMNRF, 2014), where the wetland boundary is determined to be the point along each transect when 50% of the vegetation becomes comprised of hydrophilic or obligate wetland species.

## **EXISTING CONDITIONS**

The study area is comprised of three vegetation communities including two upland vegetation communities and one wetland vegetation community. In general, vegetation on the subject property is consistent with cultural vegetation communities, those communities whose composition and form are heavily influenced by historical or on-going anthropogenic activities.

Vegetation communities present on the subject property are summarized in Table 1 below and are illustrated on Figure A.1.

Photograph 1 below provides illustrates the typical community form of the upland vegetation community present within the study area, while Photograph 2 illustrates the typical community form of the wetland vegetation community within the study area.

**Table 1 - Vegetation Communities**

ELC Type	Description
Fresh – Moist Poplar Deciduous Woodland (WODM5-1)	This upland vegetation community occurs over the eastern portions of the study area and is characterized by a semi-mature, fresh to moist poplar deciduous woodland. Dominant tree species included trembling aspen ( <i>Populus tremuloides</i> ), large-toothed aspen ( <i>Populus grandidentata</i> ) and sugar maple ( <i>Acer saccharum</i> ), and with lesser constituents including white pine ( <i>Pinus strobus</i> ), white elm ( <i>Ulmus americana</i> ), green ash ( <i>Fraxinus pennsylvanica</i> ) and glossy buckthorn ( <i>Frangula alnus</i> ).
Mineral Deciduous Thicket Swamp (SWT2)	This immature deciduous swamp is located over the western and central portion of the study area and is comprised primarily of hydrophilic tall shrub species. Dominant species consisted primarily of green alder ( <i>Alnus viridis</i> ) glossy buckthorn, red maple ( <i>Acer rubrum</i> ), slender willow ( <i>Salix petiolaris</i> ) and nannyberry ( <i>Viburnum lentago</i> )

**Photograph One**



## Photograph Two



### SUMMARY

Based on the results of the desktop evaluation and completion of the vegetation survey, the ground-truthed wetland boundary is presented on Figure A.1.

We trust this report is sufficient for your current needs; however, should you require any clarification of the information presented above, please do not hesitate to contact the undersigned.

Sincerely,


---

Drew Paulusse, B.Sc.  
Senior Biologist,  
Manager, Environmental Services



## **ATTACHMENTS**


Figure A.1 – Site Layout

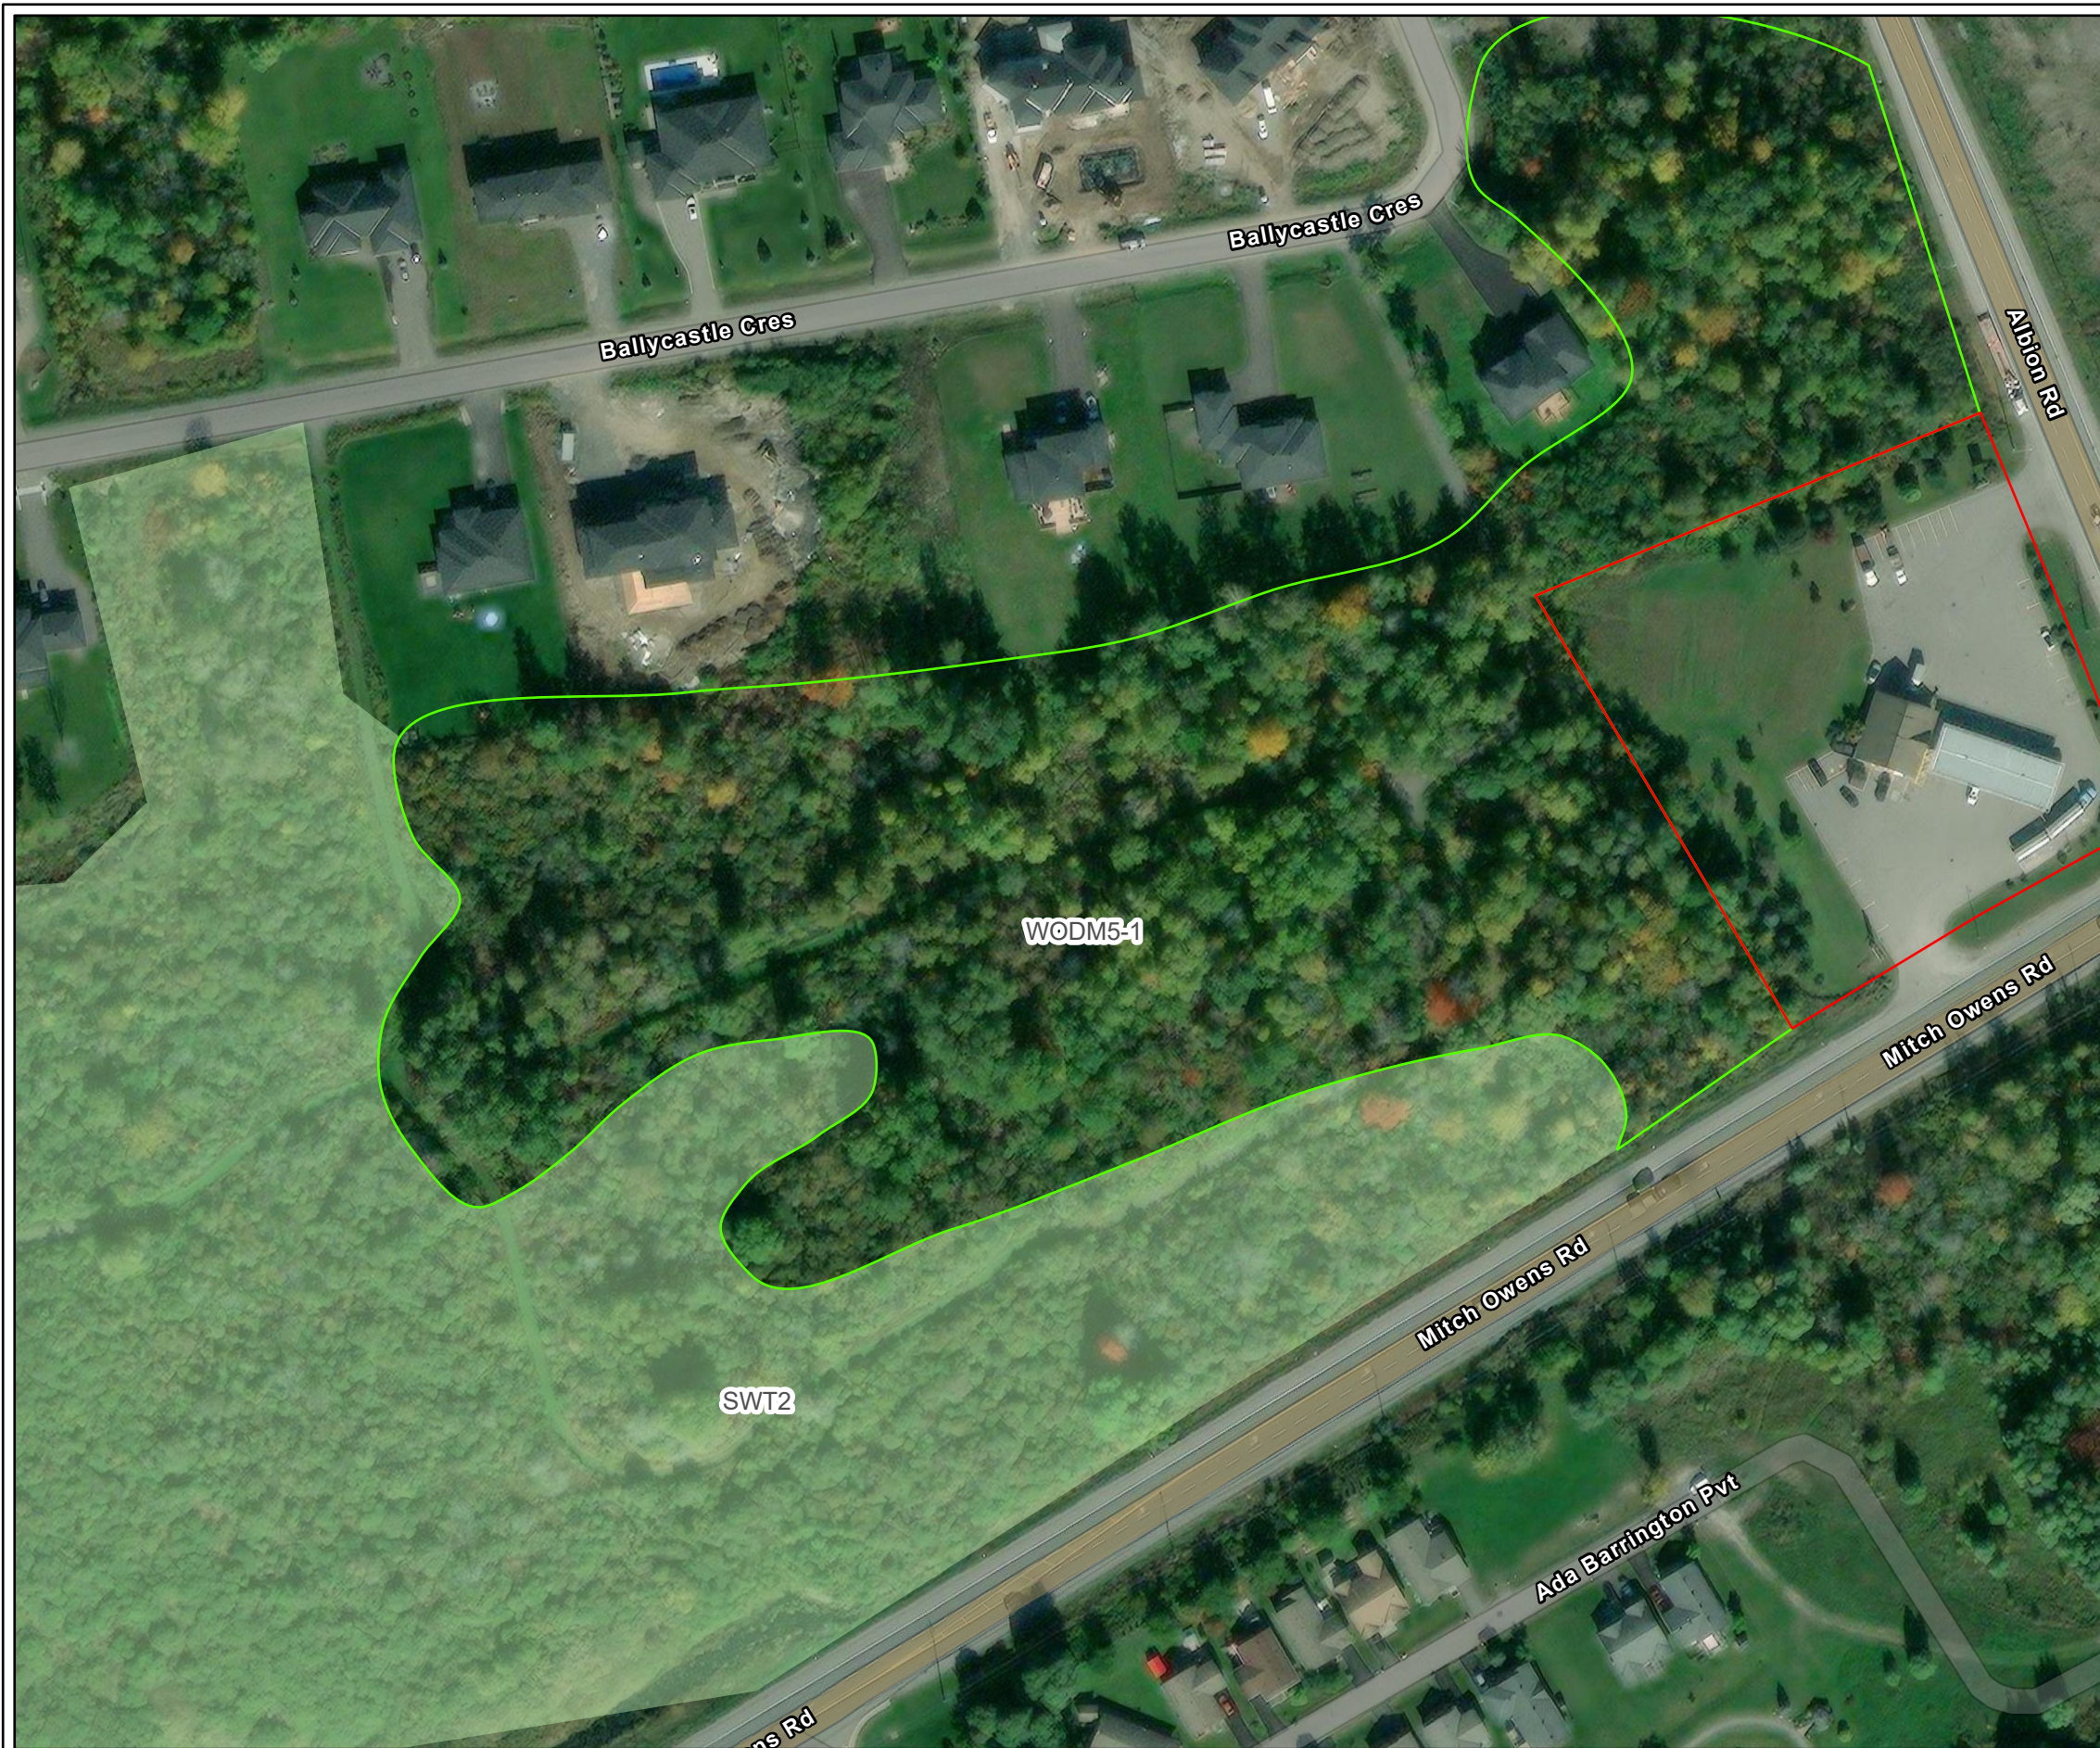

**Legend**

- Property Boundary
- Local Wetland
- Vegetation Community

SWT2 = Mineral Deciduous Thicket Swamp  
 WODM5-1 = Fresh-Moist Poplar Deciduous Woodland

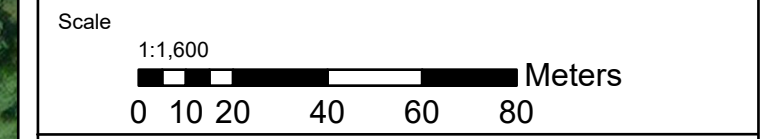

**GEMTEC**  
CONSULTING ENGINEERS  
 AND SCIENTISTS

32 Steacie Drive,  
 Ottawa, ON K2K 2A9  
 T: (613) 836-1422  
 www.gemtec.ca  
 ottawa@gemtec.ca

Client: <b>LRL Associates Ltd.</b>	Project: <b>101972.001</b>
------------------------------------	----------------------------

Location  
**5546 Albion Road  
 Ottawa, Ontario**

Drwn By: JD	Chkd By: DP	<b>Site Location</b>
----------------	----------------	----------------------

Date: June 2022	Rev. 0	<b>Figure: A.1</b>
-----------------	-----------	--------------------

Coordinate System: NAD 1983 UTM Zone 18N  
 Service Layer Credits: World Imagery: Maxar, Microsoft  
 Hybrid Reference Layer: Esri Community Maps Contributors, City of Ottawa, Province of Ontario, Esri Canada, Esri, HERE, Garmin, SafeGraph, GeoTechnologies, Inc, METI/NASA, USGS, EPA, NPS, US Census Bureau, USDA, NRCan, Parks Canada

**ATTACHMENT C**  
**Particle Size Analysis**






# PARTICLE SIZE ANALYSIS

ASTM D 422 / LS-702

Client: Maclean Petroleum Inc.  
 Project: Geotechnical Investigation  
 Location: 0000 0000 Road South, Gloucester, O.

File No.: 0000  
 Report No.: 0  
 Date: May 00, 0000

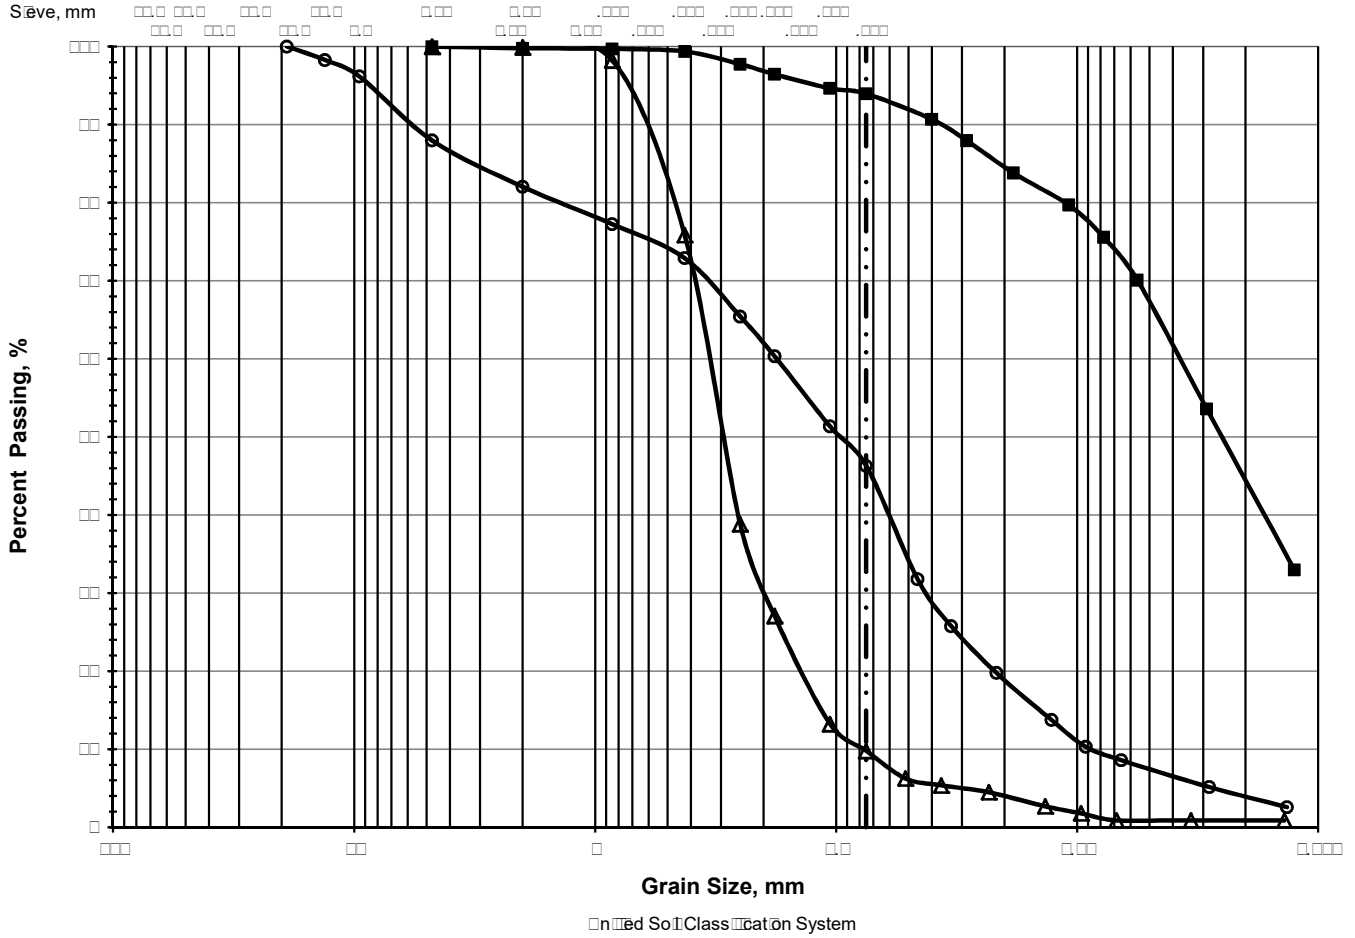

> 75 mm	% GRAVEL		% SAND			% FINES	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
△	00	00	00	000	000	00	00
■	00	00	00	00	00	000	000
○	00	000	00	00	000	000	00

Location	Sample	Depth, m	D <sub>60</sub>	D <sub>50</sub>	D <sub>30</sub>	D <sub>15</sub>	D <sub>10</sub>	C <sub>c</sub>	C <sub>u</sub>
△	SS-0	0.00 - 0.00	0.0000	0.0000	0.0000	0.0000	0.0000	0.0	0.0
■	SS-0	0.00 - 0.00	0.0000	0.0000					
○	SS-0	0.00 - 0.00	0.0000	0.0000	0.0000	0.0000	0.0000	0.0	000



**ATTACHMENT D**  
**Borehole Logs**



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 28, 2022

**Borehole Log: BH/MW22-1**

Project: Phase II Environmental Site Assessment


Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Equipment: Geoprobe 7822DT

Drilling Method: Direct Push

SUBSURFACE PROFILE		SAMPLE DATA						Combustible Soil Vapours ppm 20 40 60 80 % LEL 10 20 30 40 50 60 70 80 90	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	100.17							
0.0 - 0.30	<b>ASPHALT</b> □□□ mm t□□□	99.87			SS1A				
0.30 - 0.80	<b>PAVEMENT STRUCTURE</b> Sand and gravel, dry.	99.37			SSAB	NA	87	VOC, PHC, PAH, Metals O.Reg.153, General inorganics	<0.1
0.80 - 1.0	<b>FILL</b> Sand and gravel to 0.5 m bgs, silty loam to 0.8 m bgs.	99.37			SS1C				<0.1
1.0 - 1.9	<b>SAND</b> Medium- to coarse- grained, becoming, fossiliferous, brown becoming grey with depth, oxidized at 1.7 m bgs, moist at 1.5 m bgs becoming saturated at 1.9 m bgs.				SS2A SS2B	NA	53	VOC, PHC, PAH, Metals O.Reg.153, General inorganics	<0.1
1.9 - 3.5					SS3A				<0.1
3.5 - 4.6	<b>GLACIAL TILL</b> Grey silt-sand with gravel, saturated.	96.67			SS3B	NA	100		<0.1
4.6 - 4.6	End of Borehole	95.57			SS3C			VOC, PHC, Metals O.Reg.153, General inorganics	<0.1

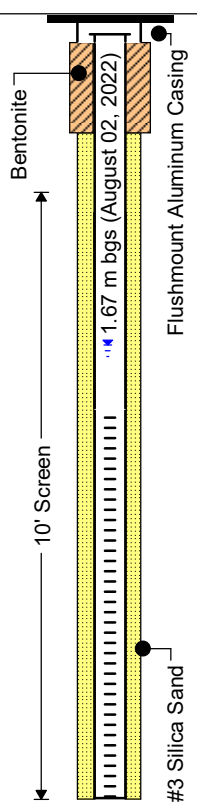

**Easting:** 0453388      **Northing:** 5013088  
**Site Datum:** "R" on "Danger" on storm sewer grate in east portion of the Site  
**Groundsurface Elevation:** 100.17 m      **Top of Riser Elev.:** 100.06 m  
**Hole Diameter:** 91 mm      **Monitoring Well Diameter:** 51 mm

**NOTES**  
- Duplicate samples collected of SS2B (identified as SS5A).  
- Groundwater sample collected on August 04, 2022 was submitted for laboratory analysis of VOC, PHC, PAH, Reg.153 Metals, General Inorganics.



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

Drilling Equipment: Geoprobe 7822DT

**Borehole Log: BH/MW22-2**


Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Method: Direct Push

SUBSURFACE PROFILE		SAMPLE DATA						Combustible Soil Vapours ppm 20 40 60 80 % LEL 10 20 30 40 50 60 70 80 90	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	99.94							
0.0 - 0.4	ASPHALT PAVEMENT STRUCTURE Sand and gravel, dry.	99.54							
0.4 - 2.1	SAND Medium- to coarse-grained, becoming clayey at 1.3 m bgs, and clayey silt at 1.5 to 2.1 m bgs, brown becoming grey with depth, moist at 1.5 m bgs becoming saturated at 2.1 m bgs.				SS1A	NA	50		
					SS1B				
					SS2A				
					SS2B	NA	63	VOC, PHC, PAH, Metals O.Reg.153, General inorganics	
					SS2C				
					SS3A				
					SS3B				
					SS3C	NA	100		
2.80	GLACIAL TILL Silty sand with gravel, clayey, becoming more compact at 3.0 m bgs, saturated silt at 3.2 m bgs.	97.14							
4.60	End of Borehole	95.34							

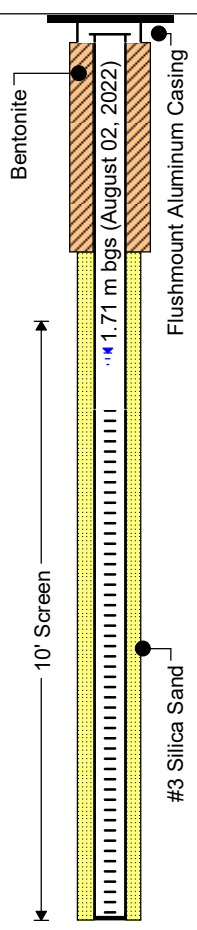

Easting: 0453364

Northing: 5013069

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 99.94 m

Top of Riser Elev.: 99.86 m

Hole Diameter: 91 mm

Monitoring Well Diameter: 51 mm

**NOTES**

- Duplicate samples collected of SS2A (identified as SS4A).
- Groundwater sample collected on August 04, 2022 was submitted for laboratory analysis of VOC, PHC, PAH, Reg.153 Metals, General Inorganics.



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

**Borehole Log: BH/MW22-3**

Project: Phase II Environmental Site Assessment


Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Equipment: Geoprobe 7822DT

Drilling Method: Direct Push

SUBSURFACE PROFILE		SAMPLE DATA						Monitoring Well Details		
Depth ft m	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		Lab Analysis	Combustible Soil Vapours ppm
								20		40
0.0	Ground Surface	100.20								
0.0 - 0.30	<b>ASPHALT PAVEMENT STRUCTURE</b> Sand and gravel, dry.	99.90								
0.30 - 1.50	<b>FILL</b> Sand and gravel, dry.	98.70			SS1A	NA	12		<0.1	
1.50 - 1.91	<b>SAND</b> Medium- to coarse- grained, clayey 1.6 m bgs, brown becoming grey with depth, moist at 1.7 m bgs becoming saturated at 1.9 m bgs	1.50			SS2A	NA	52	VOC, PHC, PAH, Metals O.Reg.153.	0.6	
				SS2B	0.4					
				SS2C	<0.1					
1.91 - 4.50	<b>GLACIAL TILL</b> Grey silt with gravel, fossiliferous.				SS3A	NA	68	VOC, PHC, Metals O.Reg.153, General inorganics	<0.1	
				SS3B	0.1					
				SS3C	0.3					
4.50 - 16.0	<b>GLACIAL TILL</b> Grey silt with gravel, fossiliferous. End of Borehole	95.70								

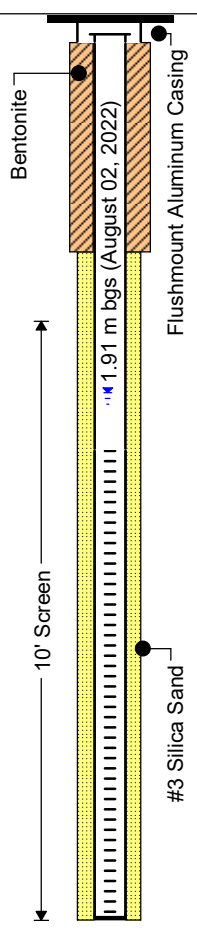

Easting: 0453352

Northing: 5013075

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 100.20 m

Top of Riser Elev.: 100.13 m

Hole Diameter: 91 mm

Monitoring Well Diameter: 51 mm

**NOTES**

- Duplicate samples collected of SS2C (identified as SS4C).
- Groundwater sample collected on August 04, 2022 was submitted for laboratory analysis of VOC, PHC, PAH, Reg.153 Metals, General Inorganics.



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

**Borehole Log: BH/MW22-4**

Project: Phase II Environmental Site Assessment


Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Equipment: Geoprobe 7822DT

Drilling Method: Direct Push

SUBSURFACE PROFILE			SAMPLE DATA					Combustible Soil Vapours ppm 20 40 60 80 % LEL 10 20 30 40 50 60 70 80 90	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	100.21							
0.0 - 0.45	ASPHALT PAVEMENT STRUCTURE Sand and gravel, dry.	99.76			SS1A			VOC, PHC, Metals O.Reg.153, General	0.7
0.45 - 1.20	FILL Silty Loam, brown, dry.	99.01			SS1A SS1B	NA	47		0.1
1.20 - 3.50	SAND Medium-grained, brown becoming grey with depth, oxidized at 1.5 m bgs, moist becoming saturated at 2.0 m bgs, fractured rock at 3.5 m bgs.	99.01			SS1C				<0.1
3.50 - 4.60	GLACIAL TILL Silty-sand, clayey with gravel at 4.0 m bgs, grey, saturated.	96.71			SS2A SS1B SS2B	NA	51	VOC, PHC, Metals O.Reg.153, General inorganics	<0.1
4.60 - 15.0	End of Borehole	95.61			SS3A SS3B SS1C SS3C	NA	100		<0.1

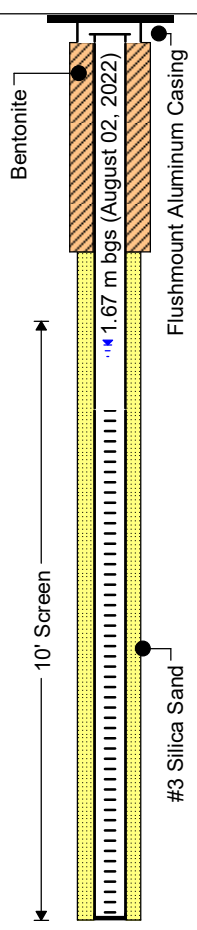

**Easting:** 0453371      **Northing:** 5013099  
**Site Datum:** "R" on "Danger" on storm sewer grate in east portion of the Site  
**Groundsurface Elevation:** 100.21 m      **Top of Riser Elev.:** 100.1 m  
**Hole Diameter:** 91 mm      **Monitoring Well Diameter:** 51 mm

**NOTES**  
- Duplicate samples collected of SS1B (identified as SS4A).  
- Groundwater sample collected on August 04, 2022 was submitted for laboratory analysis of VOC, PHC, PAH, Reg.153 Metals, General Inorganics.



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

Drilling Equipment: Geoprobe 7822DT

**Borehole Log: BH22-5**

Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Method: Direct Push

SUBSURFACE PROFILE			SAMPLE DATA					Combustible Soil Vapours ppm 20 40 60 80 % LEL 10 20 30 40 50 60 70 80 90	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	100.20							
0.0 - 0.30	<b>ASPHALT</b> <b>PAVEMENT STRUCTURE</b> Sand and gravel, dry.	99.90			SS1A				<0.1
0.30 - 0.60	<b>FILL</b> Crushed stone and gravel, dry.	99.60			SS1A SS1B	NA	53		<0.1
0.60 - 1.9	<b>SAND</b> Silty, □ □ gravel at 0.8 to 1.0 m bgs and at 1.8 to 2.0, coarse- grained at 2.9 to 3.1 m bgs and becoming medium-grained with depth, brown, dry becoming saturated at 1.9 m bgs.				SS2A			VOC, PHC, PAH, Metals O.Reg.153, General inorganics	<0.1
1.9 - 3.60					SS1B SS2B	NA	58		<0.1
3.60 - 4.60	<b>GLACIAL TILL</b> Clayey silty-sand, with gravel.	96.60			SS3A				<0.1
4.60 - 4.60	End of Borehole	95.60			SS2A SS3B SS3C	NA	100		<0.1

Easting: 0453338

Northing: 5013084

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 100.19 m

Top of Riser Elev.: NA

Hole Diameter: 91 mm

Monitoring Well Diameter: NA

**NOTES**

- Duplicate samples collected of SS2B (identified as SS4B).
- NA : Not applicable



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

**Borehole Log: BH22-6**

Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Equipment: Geoprobe 7822DT

Drilling Method: Direct Push

SUBSURFACE PROFILE		SAMPLE DATA						Combustible Soil Vapours ppm 20 40 60 80 % LEL 10 20 30 40 50 60 70 80 90	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	99.28							
0.0	<b>ASPHALT</b>	0.00							
1.0	<b>PAVEMENT STRUCTURE</b> Sand and gravel, dry.	98.98							
2.0	<b>FILL</b> Medium-grained sand and gravel, dry.	98.35				NA	58		<0.1
3.0	<b>SAND</b> Silty sand, medium-grained, trace clayey silt between 2.5 and 2.7 m bgs, brown becoming grey with depth, moist becoming saturated at 1.2 m bgs.	0.93			SS1A			SS1A: VOC, PAH, Metals O.Reg.153.	0.1
4.0					SS1B				<0.1
5.0									
6.0					SS2A				<0.1
7.0					SS2B	NA	92		<0.1
8.0					SS2C			SS2C: VOC, PHC, PAH, Metals O.Reg.153.	0.1
9.0					SS3A				<0.1
10.0					SS3B	NA	10		<0.1
11.0					SS3C				<0.1
12.0	<b>GLACIAL TILL</b> Silt-sand, some gravel, trace clay, grey, saturated.	95.73							
13.0		3.55							
14.0									
15.0	<b>End of Borehole</b>	94.68							
16.0		4.60							
17.0									
18.0									
19.0									

Easting: 0453341

Northing: 5013052

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 99.28 m

Top of Riser Elev.: NA

Hole Diameter: 91 mm

Monitoring Well Diameter: NA

**NOTES**

- Duplicate samples collected of SS2A (identified as SS4A).
- NA : Not applicable





**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

Drilling Equipment: Geoprobe 7822DT

**Borehole Log: BH22-7**

Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Method: Direct Push

SUBSURFACE PROFILE			SAMPLE DATA					Combustible Soil Vapours ppm 20 40 60 80	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	100.23							
0.0	<b>ASPHALT</b>	0.00							
1.0	<b>PAVEMENT STRUCTURE</b>								
2.0	Sand and gravel.	99.63							<0.1
2.0	<b>SILT</b>	0.60			SS1A	NA	56		<0.1
3.0	Brown, dry.	99.23							<0.1
4.0	<b>SAND</b>	1.00			SS2B				<0.1
5.0	Loamy sand at 1.5 m bgs to 1.7 m bgs, brown becoming grey with depth, moist becoming saturated at 1.8 m bgs.				SS2A				<0.1
6.0					SS2B				<0.1
7.0						NA	58		<0.1
8.0								VOC, PHC, PAH, Metals O.Reg.153.	<0.1
9.0					SS2C				<0.1
10.0									<0.1
11.0					SS3A				<0.1
12.0	<b>GLACIAL TILL</b>	96.83							<0.1
13.0	Silt-sand, some gravel, trace clay, grey, saturated.	3.40			SS3B	NA	100		<0.1
14.0									<0.1
15.0					SS3C				<0.1
16.0	End of Borehole	95.63							
17.0		4.60							

Easting: 0453359

Northing: 5013102

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 100.23 m

Top of Riser Elev.: NA

Hole Diameter: 91 mm

Monitoring Well Diameter: NA

**NOTES**

- Duplicate samples collected of SS2C (identified as SS4C).
- NA : Not applicable



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

**Borehole Log: BH22-8**

Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Equipment: Geoprobe 7822DT

Drilling Method: Direct Push

SUBSURFACE PROFILE			SAMPLE DATA					Combustible Soil Vapours ppm 20 40 60 80	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		
0.0	Ground Surface	100.30							
0.0 - 1.0	<b>ASPHALT</b>	0.00							
1.0 - 2.0	<b>PAVEMENT STRUCTURE</b>	0.30							
2.0 - 3.0	<b>FILL</b>								
3.0 - 6.0	Sand and gravel, dry.								
3.0 - 4.0	<b>FILL</b>								
4.0 - 6.0	Sand, presence of gravel to 1.8 m bgs, brown, dry.				SS1A	NA	52		<0.1
6.0 - 7.0					SS1B				0.1
7.0 - 8.0					SS2A				<0.1
8.0 - 9.0					SS2B				<0.1
9.0 - 10.0	<b>SAND</b>	98.50						VOC, PHC, Metals O.Reg.153.	<0.1
10.0 - 11.0	Brown becoming grey with depth, moist becoming saturated at 2.1 m bgs.	1.80			SS2C	NA	69		<0.1
11.0 - 12.0					SS2D				0.1
12.0 - 13.0					SS3A				<0.1
13.0 - 14.0	<b>GLACIAL TILL</b>	97.42							<0.1
14.0 - 15.0	Silt-sand, some gravel, trace clay, grey, saturated.	2.88			SS3B	NA	87		<0.1
15.0 - 16.0					SS3C				<0.1
16.0 - 17.0									
17.0 - 18.0									
18.0 - 19.0									
19.0	End of Borehole	95.70							
		4.60							

Easting: 0453338

Northing: 5013114

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 100.30 m

Top of Riser Elev.: NA

Hole Diameter: 91 mm

Monitoring Well Diameter: NA

**NOTES**

- Duplicate samples collected of SS2C (identified as SS4C).
- NA : Not applicable



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

Drilling Equipment: Geoprobe 7822DT

**Borehole Log: BH22-9**

Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Method: Direct Push

SUBSURFACE PROFILE			SAMPLE DATA						Monitoring Well Details
Depth ft m	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)	Lab Analysis	
									◯ 20 40 60 80 ◯ % LEL ◻ 10 20 30 40 50 60 70 80 90 ◻
0.0	Ground Surface	100.13							
0.0	<b>ASPHALT PAVEMENT STRUCTURE</b> Sand and gravel, dry.	99.83							
1.0	<b>FILL</b> Gravel and sand, medium-grained sand at 1.1 m bgs to 1.5 m bgs, brown.	0.30			SS1A				<0.1
2.0					SS1A	NA	55		
3.0					SS1B				<0.1
4.0									
5.0									
6.0	<b>SAND</b> Medium-grained, clayey at 2.9 m bgs to 3.1 m bgs, brown, saturated.	98.33						VOC, PHC, PAH, Metals O.Reg.153.	<0.1
7.0		1.80			SS2A	NA	67		<0.1
8.0									
9.0					SS2B				<0.1
10.0					SS3A				<0.1
11.0									
12.0									
13.0	<b>CLAY</b> Grey, silty in basal portion.	96.33				NA	92		<0.1
14.0		3.80			SS3B				
15.0									
16.0	End of Borehole	95.53							
17.0		4.60							
18.0									
19.0									

Easting: 0453364

Northing: 5013122

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 100.13 m

Top of Riser Elev.: NA

Hole Diameter: 91 mm

Monitoring Well Diameter: NA

**NOTES**

- Duplicate samples collected of SS2A (identified as SS4A).
- NA : Not applicable



**LRJ**

Driller: Strata Drilling Group

Project No.: 01348

Client: MacEwen Petroleum Inc.

Date: July 29, 2022

Drilling Equipment: Geoprobe 7822DT

**Borehole Log: BH22-10**

Project: Phase II Environmental Site Assessment

Location: 5546 Albion Road, Ottawa, Ontario

Field Personnel: GM

Drilling Method: Direct Push

SUBSURFACE PROFILE		SAMPLE DATA						Monitoring Well Details	
Depth	Soil Description	Elev./Depth (m)	Lithology	Type	Sample Number	N or RQD (%)	Recovery (%)		Lab Analysis
								ppm	
0.0	Ground Surface	100.10							
0.0 - 0.30	<b>ASPHALT PAVEMENT STRUCTURE</b> Sand and gravel, dry	99.80							
0.30 - 1.30	<b>FILL</b> Sand to 0.9 m bgs, silt to 1.3 m bgs, brown, dry.	98.80			SS1A	NA	60		<0.1
1.30 - 3.70	<b>SAND</b> Medium -grained, brown becoming grey with depth, dry becoming saturated at 1.5 m bgs.	96.40			SS1B			VOC, PHC, Metals O.Reg.153.	0.1
3.70 - 4.60	<b>GLACIAL TILL</b> Silt-sand, with some gravel, trace clay, grey, saturated.	95.50			SS2A				<0.1
4.60 - 5.0	End of Borehole	4.60			SS2B				<0.1
5.0 - 10.0					SS2C	NA	60		<0.1
10.0 - 13.0					SS3A				0.1
13.0 - 15.0					SS3B	NA	100		<0.1

Easting: 0453383

Northing: 5013101

Site Datum: "R" on "Danger" on storm sewer grate in east portion of the Site

Groundsurface Elevation: 100.10 m

Top of Riser Elev.: NA

Hole Diameter: 91 mm

Monitoring Well Diameter: NA

**NOTES**

- NA : Not applicable



Project No.: 001348

Client: MacEwen Petroleum Inc.

Date: May 25, 2022

**Borehole Log: BH1**

Project: Proposed Site Redevelopment

Location: 5546 Albion Road S, Ottawa ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Truck Mount CME 850

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details				
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50	150		25	50	75	
							SPT N Value (Blows/0.3 m)			Liquid Limit (%)			
							20	40	60	80	25	50	75
0	Ground Surface	0.00											
0	<b>PAVEMENT STRUCTURE</b> 100 mm of asphalt overlying 300 mm of granular material.	0.41		SS1	72	83						2	
1	<b>FILL</b> sand and gravel, brown, moist, dense.	1.45		SS2	41	75						6	
2	<b>SAND</b> trace silt, trace clay, greyish brown, moist, compact to very loose.	1.45		SS3	18	50						19	
3				SS4	9	63						25	
4				SS5	WH	67						48	
5				SS6	16	50						36	
6				SS7	2	63						12	
7													
8													
9													
10													
11													
12													
13													
14													
15													
16													
17													
18													
19													
20													
21				SS8	5	100						11	
22	End of Borehole	6.71											

Easting: 453352 m

Northing: 5013122 m

Site Datum: NM

Top of Riser Elev.: NA

Groundsurface Elevation: NM

Monitoring Well Diameter: N/A

Hole Diameter: 200 mm

**NOTES:**



**Project No.:** 001348  
**Client:** MacEwen Petroleum Inc.  
**Date:** May 25, 2022

**Borehole Log: BH2**  
**Project:** Proposed Site Redevelopment  
**Location:** 5546 Albion Road S, Ottawa ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details			
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50	150		25	50	75
							SPT N Value (Blows/0.3 m)			Liquid Limit (%)		
				20	40	60	80	25	50	75		
0	Ground Surface	0.00										
0	<b>PAVEMENT STRUCTURE</b> 100 mm of asphalt overlying 300 mm of granular material.	0.41		SS1	42	83		42	5			
1	<b>FILL</b> sand and gravel, brown, moist, dense.	1.06		SS2	36	88			5			
2	<b>SAND</b> trace silt, trace clay, greyish brown, moist, compact to loose.	2.97		SS3	11	92		36	10			
3				SS4	4	79		11	21			
4				SS5	WH	79		4	22			
5	<b>SILT and CLAY</b> trace sand, grey, wet, firm.	4.42						0	50			
6								36				
7								38				
8	<b>GLACIAL TILL</b> silt-sand, some gravel sized stone, trace clay, grey, wet, compact.	6.71		SS7	17	79		17	16			
9												
10												
11												
12												
13												
14												
15												
16												
17												
18												
19												
20												
21				SS8	15	75		15	10			
22	End of Borehole	6.71										

**Easting:** 453334 m

**Northing:** 5013122 m

**NOTES:**

**Site Datum:** NM

**Groundsurface Elevation:** NM

**Top of Riser Elev.:** NA

**Hole Diameter:** 200 mm

**Monitoring Well Diameter:** N/A



Project No.: 001348

Client: MacEwen Petroleum Inc.

Date: May 25, 2022

**Borehole Log: BH3**

Project: Proposed Site Redevelopment

Location: 5546 Albion Road S, Ottawa ON

Field Personnel: BJ

Driller: CCC Geotech and Enviro Drilling

Drilling Equipment: Truck Mount CME 850

Drilling Method: Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
0	Ground Surface	0.00							
0-1	<b>TOPSOIL</b> about 75 mm thick.			SS1	21	96	21	4	
1-3	<b>FILL</b> sand and gravel, asphalt debris, brown, moist, compact.			SS2	23	88	23	14	
3-5									
5-6	<b>SAND</b> trace silt, trace clay, greyish brown, moist, dense to loose.	1.45		SS3	33	100	33	16	
6-8									
8-9				SS4	6	67	6	23	
9-10									
10-11	<b>SILT and CLAY</b> trace sand, grey, wet, firm.	2.97		SS5	WH	75	0	46	
11-13									
13-14							30		
14-15	<b>GLACIAL TILL</b> silt-sand, some gravel sized stone, trace clay, grey, wet, compact to loose.	4.12							
15-16				SS7	17	79	17	12	
16-17									
17-20									
20-21				SS8	4	75	4	10	
21-22									
	End of Borehole	6.71							

Easting: 453320 m

Northing: 5013082 m

Site Datum: NM

Groundsurface Elevation: NM

Top of Riser Elev.: NA

Hole Diameter: 200 mm

Monitoring Well Diameter: N/A

**NOTES:**



**Project No.:** 001348  
**Client:** MacEwen Petroleum Inc.  
**Date:** May 25, 2022

**Borehole Log: BH4**  
**Project:** Proposed Site Redevelopment  
**Location:** 5546 Albion Road S, Ottawa ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details			
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50	150		25	50	75
							SPT N Value (Blows/0.3 m)			Liquid Limit (%)		
0	Ground Surface	0.00										
0.50	<b>PAVEMENT STRUCTURE</b> 100 mm of asphalt overlying about 400 mm of granular material..			SS1	36	79	36		3			
0.50	<b>FILL</b> sand and gravel, greyish brown, moist, dense.			SS2	42	83	42		5			
1.75	<b>SAND</b> trace silt, trace clay, greyish brown, wet, compact to loose.			SS3	26	83	26		16			
1.75				SS4	10	75	10		26			
1.75				SS5	7	75	7		23			
4.12	<b>GLACIAL TILL</b> silt-sand, some gravel sized stone, trace clay, grey, wet, very loose to loose.			SS7	2	100	2		10			
4.12				SS8	8	75	8		10			
6.71	End of Borehole											

**Easting:** 453346 m

**Northing:** 5013076 m

**Site Datum:** NM

**Groundsurface Elevation:** NM

**Top of Riser Elev.:** NA

**Hole Diameter:** 200 mm

**Monitoring Well Diameter:** N/A

**NOTES:**



# Symbols and Terms Used on Borehole and Test Pit Logs

## 1. Soil Description

The soil descriptions presented in this report are based on commonly accepted methods of classification and identification employed in geotechnical practice. Classification and identification of soil involves some judgement and LRL Associates Ltd. does not guarantee descriptions as exact, but infers accuracy to the extent that is common in current geotechnical practice. Boundaries between zones on the logs are often not distinct but transitional and were interpreted.

### a. Proportion

The proportion of each constituent part, as defined by the grain size distribution, is denoted by the following terms:

Term	Proportions
“trace”	1% to 10%
“some”	10% to 20%
prefix (i.e. “sandy” silt)	20% to 35%
“and” (i.e. sand “and” gravel)	35% to 50%

### b. Compactness and Consistency

The state of compactness of granular soils is defined on the basis of the Standard Penetration Number (N) as per ASTM D-1586. It corresponds to the number of blows required to drive 300 mm of the split spoon sampler using a metal drop hammer that has a weight of 62.5 kg and free fall distance of 760 mm. For a 600 mm long split spoon, the blow counts are recorded for every 150 mm. The “N” value is obtained by adding the number of blows from the 2<sup>nd</sup> and 3<sup>rd</sup> count. Technical refusal indicates a number of blows greater than 50.

The consistency of clayey or cohesive soils is based on the shear strength of the soil, as determined by field vane tests and by a visual and tactile assessment of the soil strength.

The state of compactness of granular soils is defined by the following terms:

State of Compactness Granular Soils	Standard Penetration Number “N”	Relative Density (%)
Very loose	0 – 4	<15
Loose	4 – 10	15 – 35
Compact	10 - 30	35 – 65
Dense	30 - 50	65 - 85
Very dense	> 50	> 85

The consistency of cohesive soils is defined by the following terms:

Consistency Cohesive Soils	Undrained Shear Strength ( $C_u$ ) (kPa)	Standard Penetration Number “N”
Very soft	<12.5	<2
Soft	12.5 - 25	2 - 4
Firm	25 - 50	4 - 8
Stiff	50 - 100	8 - 15
Very stiff	100 - 200	15 - 30
Hard	>200	>30

### c. Field Moisture Condition

Description (ASTM D2488)	Criteria
Dry	Absence of moisture, dusty, dry to touch.
Moist	Damp, but not visible water.
Wet	Visible, free water, usually soil is below water table.

## 2. Sample Data

### a. Elevation depth

This is a reference to the geodesic elevation of the soil or to a benchmark of an arbitrary elevation at the location of the borehole or test pit. The depth of geological boundaries is measured from ground surface.

**b. Type**

Symbol	Type	Letter Code
	Auger	AU
▲	Split Spoon	SS
	Shelby Tube	ST
	Rock Core	RC

**c. Sample Number**

Each sample taken from the borehole is numbered in the field as shown in this column.

LETTER CODE (as above) – Sample Number.

**d. Recovery (%)**

For soil samples this is the percentage of the recovered sample obtained versus the length sampled. In the case of rock, the percentage is the length of rock core recovered compared to the length of the drill run.

**3. Rock Description**


Rock Quality Designation (RQD) is a rough measure of the degree of jointing or fracture in a rock mass. The RQD is calculated as the cumulative length of rock pieces recovered having lengths of 100 mm or more divided by the length of coring. The qualitative description of the bedrock based on RQD is given below.

Rock Quality Designation (RQD) (%)	Description of Rock Quality
0 – 25	Very poor
25 – 50	Poor
50 – 75	Fair
75 – 90	Good
90 – 100	Excellent

Strength classification of rock is presented below.


Strength Classification	Range of Unconfined Compressive Strength (MPa)
Extremely weak	< 1
Very weak	1 – 5
Weak	5 – 25
Medium strong	25 – 50
Strong	50 – 100
Very strong	100 – 250
Extremely strong	> 250

**4. General Monitoring Well Data**

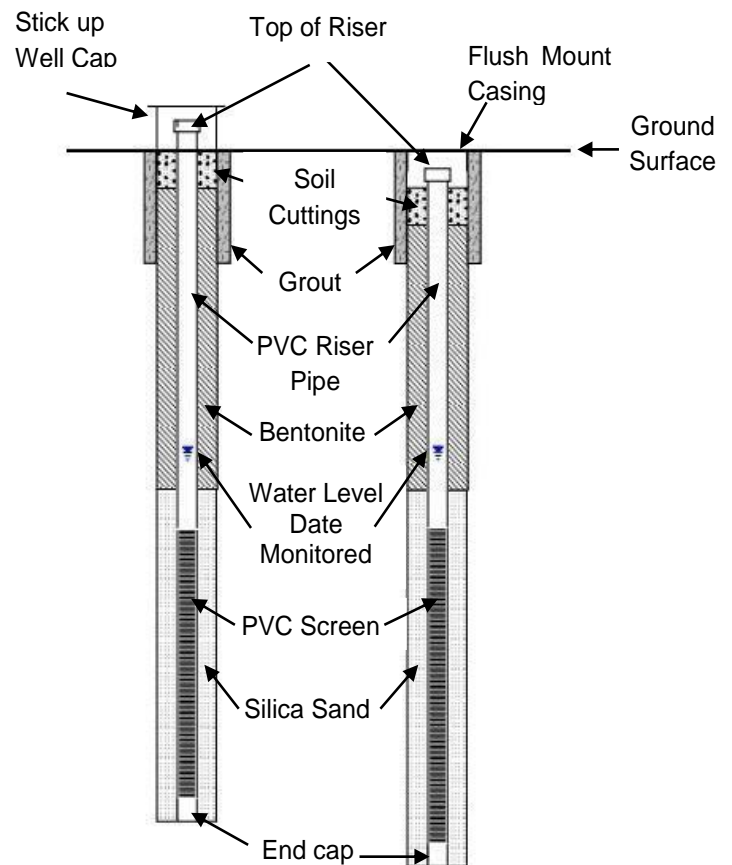

**5. Classification of Soils for Engineering Purposes (ASTM D2487)  
(United Soil Classification System)**

Major divisions		Group Symbol	Typical Names	Classification Criteria
Coarse-grained soils More than 50% retained on No. 200 sieve* (>0.075 mm)	Gravels More than 50% of coarse fraction retained on No. 4 sieve(4.75 mm)	Clean gravels <5% fines	GW Well-graded gravel	<p>Classification on basis of percentage of fines:                      Less than 5% pass No. 200 sieve - GW, GP, SW, SP                      More than 12% pass No. 200 sieve - GM, GC, SM, SC                      5 to 12% pass No. 200 sieve - Borderline classifications, use of dual symbols</p> <p><math>C_u = \frac{D_{60}}{D_{10}} \geq 4</math>; <math>C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}</math> between 1 and 3</p> <p>Not meeting either <math>C_u</math> or <math>C_c</math> criteria for GW</p> <p>Atterberg limits below "A" line or PI less than 4                      Atterberg limits on or above "A" line and PI &gt; 7                      Atterberg limits plotting in hatched area are borderline classifications requiring use of dual symbols                      If fines are organic add "with organic fines" to group name</p> <p><math>C_u = \frac{D_{60}}{D_{10}} \geq 6</math>; <math>C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}</math> between 1 and 3</p> <p>Not meeting either <math>C_u</math> or <math>C_c</math> criteria for SW</p> <p>Atterberg limits below "A" line or PI less than 4                      Atterberg limits on or above "A" line and PI &gt; 7                      Atterberg limits plotting in hatched area are borderline classifications requiring use of dual symbols                      If fines are organic add "with organic fines" to group name</p>
		GP Poorly graded gravel		
		Gravels with >12% fines	GM Silty gravel	
		GC Clayey gravel		
	Sands 50% or more of coarse fraction passes No. 4 sieve(<4.75 mm)	Clean sands <5% fines	SW Well-graded sand	
		SP Poorly graded sand		
		Sands with >12% fines	SM Silty sand	
		SC Clayey sand		
Fine-grained soils 50% or more passes No. 200 sieve* (<0.075 mm)	Silts and Clays Liquid Limit <50%	Inorganic	ML Silt	<p>If 15 to 29% coarse-grained, add "with sand" or "with gravel" as appropriate.                      If &gt; 30% coarse-grained, add "sandy" or "gravelly" as appropriate.                      Class as organic when oven dried liquid limit is &lt; 75% of undried liquid limit.</p>
		CL Lean Clay -low plasticity		
		Organic	OL Organic clay or silt (Clay plots above 'A' Line)	
	Silts and Clays Liquid Limit >50%	Inorganic	MH Elastic silt	
		CH Fat Clay -high plasticity		
		Organic	OH Organic clay or silt (Clay plots above 'A' Line)	
	Highly Organic Soils	PT	Peat, muck and other highly organic soils	

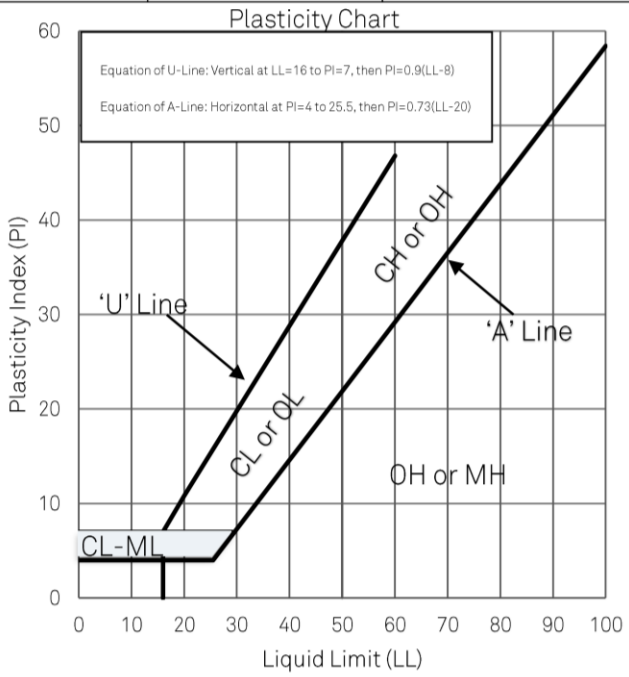

**ATTACHMENT E**  
**MECP Water Well Records**

310/52



WATER RESOURCES DIVISION NO. 15 N. 1841  
NOV 30 1965  
ONTARIO WATER RECORD

UTM 1182 4531310 E  
5R 51011281610

Elev. 430 0131315  
Lot 430

Basin 25 District Carleton  
Conc III RF Lot 30

Ontario Water Resources Commission Act

# WATER WELL RECORD

Township, Village, Town or City Gloucester  
Date completed 3 SEP 65  
(day month year)

Address 467 McLeod St. Ottawa

### Casing and Screen Record

Inside diameter of casing 6 1/4"  
 Total length of casing 64'  
 Type of screen none  
 Length of screen —  
 Depth to top of screen —  
 Diameter of finished hole 6"

### Pumping Test

Static level 18 FT.  
 Test-pumping rate 30 G.P.M.  
 Pumping level 76 FT  
 Duration of test pumping 24 hrs  
 Water clear or cloudy at end of test clear  
 Recommended pumping rate 30 G.P.M.  
 with pump setting of 120 feet below ground surface

### Well Log

### Water Record

Overburden and Bedrock Record	From ft.	To ft.	Depth(s) at which water(s) found	Kind of water (fresh, salty, sulphur)
sand	0	10		
gravel & boulders	10	30		
hard boulder Till	30	54		
hard limestone	54	90	75-110	Fresh
Sandstone	90	119		
Granite	119	136		

For what purpose(s) is the water to be used?

Subdivision

Is well on upland, in valley, or on hillside? upland

Drilling or Boring Firm

McLean Water Supply Ltd

Address 1532 Raven Ave  
Ottawa 3

Licence Number 1686

Name of Driller or Borer A. Scharf


Address

Date Sept 1, 1965

(Signature of Licensed Drilling or Boring Contractor)

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

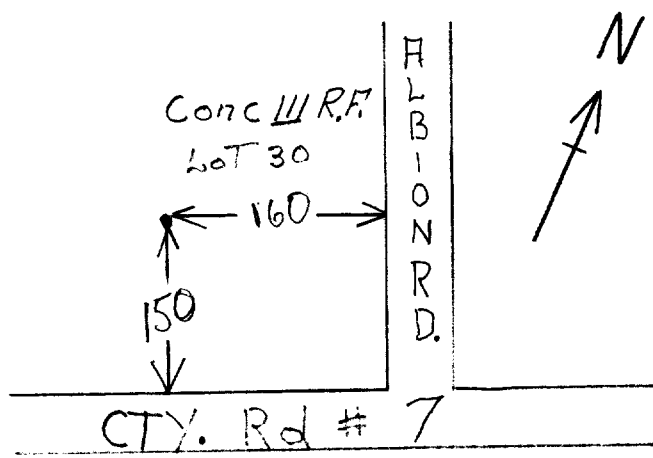

UTM 18Z 45311010 E  
 1942 501753210  
 Elev to 9 R 0.3 11.0  
 Basin 15

316/5ax



RECEIVED  
 APR 19 1949  
 GEOLOGICAL BRANCH  
 DEPARTMENT OF MINES

1837

X

not  
 well drilled from Jan 3  
 finished because  
 of boulder  
 formation

The Well Drillers Act  
 Department of Mines, Province of Ontario

# Water Well Record

To *Shouich* Con. *29* Lot *29* Pt. Lot  
*Manotick* Acres *100*  
 (including pump) *25.5*

## Pipe and Casing Record

## Pumping Test

Casing diameter(s) *4"*  
 Length(s) of casing(s) *5.5'*  
 Length of screen  
 Type of screen  
 Type of pump  
 Capacity of pump  
 Depth of pump setting

Date *Feb. 10*  
 Developed Capacity *200 gal P.H.*  
 Duration of Test *1 hr*  
 Pumping Rate  
 Drawdown *4'*  
 Static level of completed well *15'*  
 Is well a gravel-wall type?

## Water Record

Kind (fresh or mineral) *fresh*  
 Quality (hard, soft, contains iron, sulphur etc.) *hard*  
 Appearance (clear, cloudy, coloured) *clear*  
 For what purpose(s) is the water to be used? *stock well.*  
 How far is well from possible source of contamination? *100'*  
 What is source of contamination? *Farm yard.*  
 Enclose a copy of any mineral analysis that has been made of water

Depth(s) to Water Horizon(s)	Kind of Water	No. of Feet Water Rises
<i>85'</i>	<i>fresh</i>	<i>70'</i>

## Well Log


### Drift and Bedrock Record

From To  
 0 ft. ....ft.

<i>Top soil &amp; boulders</i>	<i>1</i>	<i>2.5</i>
<i>gravel</i>	<i>2.5</i>	<i>5.5</i>
<i>granite? limestone</i>	<i>5.5</i>	<i>85</i>

## Location of Well

In diagram below show distances of well from road and lot line

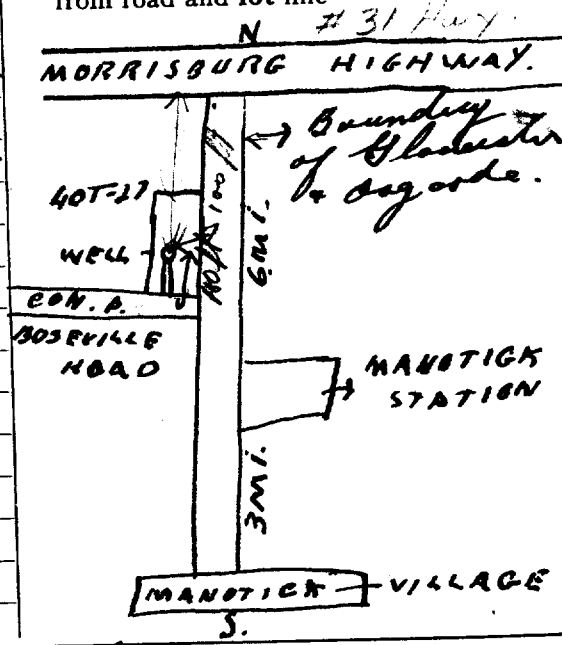

Situation: Is well on upland, in valley, or on hillside? *hillside*  
 Drilling Firm *M. M. Eagher*  
 Address *Britannia Heights*  
 Recorded by *M. M. Eagher* Address *Britannia Heights*  
 Date *Feb 18 1949* Licence Number

319/50



R.F. 9  
UTM ~~1381~~ 4 5 3 2 4 0 E

15 N: 2207

5 R 0 1 1 3 3 2 0 N  
The Ontario Water Resources Commission Act

ONTARIO WATER RESOURCES COMMISSION

Elev. 4 R 0 3 4 1

# WATER WELL RECORD

Basin 2 5 | | Carl County or District  
Township, Village, Town or City Carlisle  
Con. IV R F Lot 29 Date completed 24 Feb 1966  
(day month year)  
Owner Geo. Crain & Sons Ltd Address 555 Cambridge St  
(print in block letters) Ottawa

### Casing and Screen Record

### Pumping Test

Inside diameter of casing 6 1/6  
Total length of casing 52'  
Type of screen  
Length of screen  
Depth to top of screen  
Diameter of finished hole 6"

Static level 5'  
Test-pumping rate 10 G.P.M.  
Pumping level 15  
Duration of test pumping 2 hr  
Water clear or cloudy at end of test clear  
Recommended pumping rate 5 G.P.M.  
with pump setting of 35' feet below ground surface

### Well Log


### Water Record

Overburden and Bedrock Record	From ft.	To ft.	Depth(s) at which water(s) found	Kind of water (fresh, salty, sulphur)
<u>sand fill</u>	<u>0'</u>	<u>6'</u>	<u>52'</u>	<u>fresh</u>
<u>clay</u>	<u>6</u>	<u>40'</u>		
<u>hardpan</u>	<u>40'</u>	<u>46'</u>		
<u>gravel</u>	<u>46'</u>	<u>52'</u>		
<u>gravel backed up pipe to 45'</u>				

For what purpose(s) is the water to be used? office building & garage  
Is well on upland, in valley, or on hillside? upland  
Drilling or Boring Firm Capital Water Supply  
Address 14 Ashford Dr  
Ottawa 828-1764  
Licence Number 1687  
Name of Driller or Borer H Mains  
Address  
Date 24 Feb 1966  
Halter Kavanagh  
(Signature of Licensed Drilling or Boring Contractor)

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

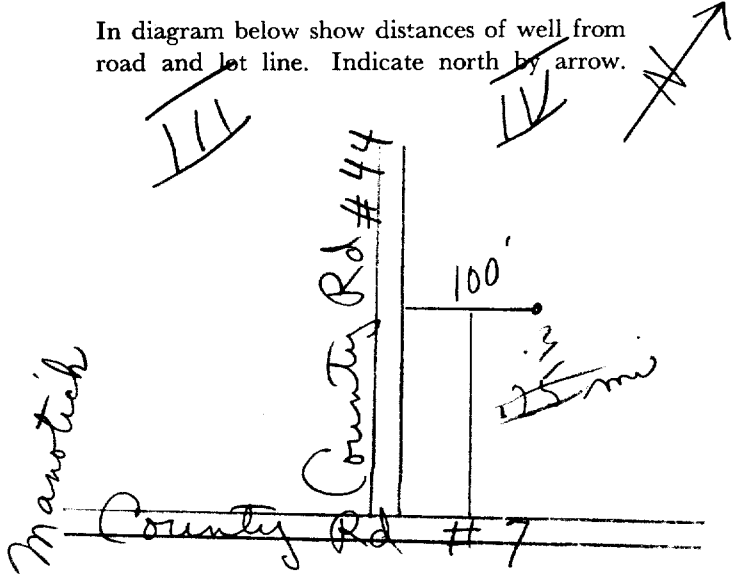

134



ONTARIO

15 No 7206  
 GROUND WATER BRANCH  
 OCT 6 1958  
 ONTARIO WATER  
 RESOURCES COMMISSION

UTM 1182 452990E

5R 5012520N

Elev. 10335

Basin 2451

The Water-well Drillers Act, 1954  
Department of Mines

# Water-Well Record

ip, Village, Town or City.....

Village, Town or City).....

Date completed 13 SEP 58  
(day) (month) (year)

### Pipe and Casing Record

### Pumping Test

Casing diameter(s) 5.5" - 12"  
 Length(s) 61'  
 Type of screen No  
 Length of screen

Static level 2'  
 Pumping rate 7.10 GPM  
 Pumping level 5'  
 Duration of test 4 1/2 hrs

### Well Log


### Water Record

Overburden and Bedrock Record	From ft.	To ft.	Depth (s) at which water (s) found	No. of feet water rises	Kind of water (fresh, salty, or sulphur)
SANDY CLAY	0	51			
LIMESTONE	51	57	57	25	FRESH

For what purpose(s) is the water to be used?  
 TRAILER CAMP  
 Is water clear or cloudy? CLEAR  
 Is well on upland, in valley, or on hillside?  
 Drilling firm B. A. W. PHILLIPS DRILLING CO.  
 Address OTTAWA  
 Name of Driller J. PROUSE  
 Address TRAS  
 Licence Number.....

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

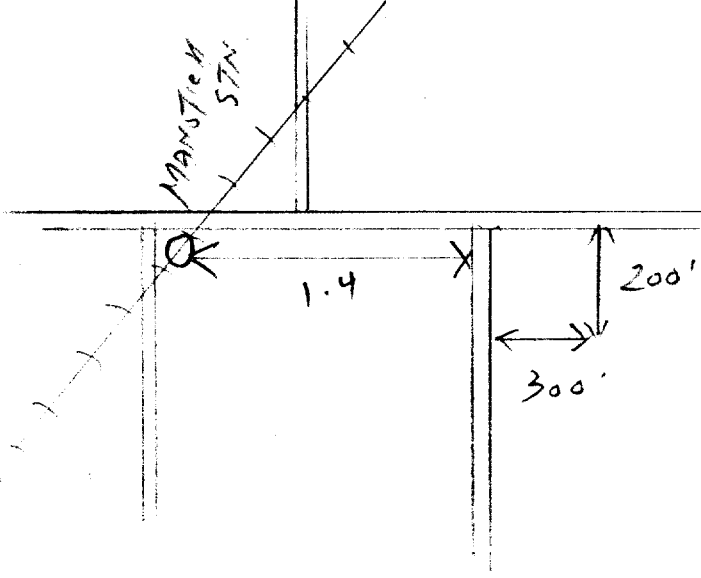

I certify that the foregoing statements of fact are true.  
 B. A. W. Phillips  
 Signature of Licensee





# WATER WELL RECORD

316/5a

Water management in Ontario

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1510978

MUNICIP. 15002

CON. RF

LOT 04

CARLETON  
 TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE Gloucester  
 CON., BLOCK, TRACT, SURVEY, ETC. 4 R.F.  
 DATE COMPLETED 20 11 70  
 HING 012920 RC. 4 ELEVATION 0338 RC. BASIN CODE 25

### LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	Clay	Silt	Loose	0'	19'
Grey	Gravel	Boulder	Hard	19'	30'
Grey	Clay	Stones	Hard	30'	53'
Grey	Lime Stone			53'	87'

31 001900500 003021113 005320512 0087215  
 32

#### 41 WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER
10-13	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
15-18	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
20-23	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
25-28	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
30-33	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

#### 51 CASING & OPEN HOLE RECORD

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
11	1 <input checked="" type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE	1.88	0	54
17-18	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE			20-23
24-25	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE			27-30

#### SCREEN

SIZE(S) OF OPENING (SLOT NO.)	DIAMETER	LENGTH
MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN

#### 61 PLUGGING & SEALING RECORD

DEPTH SET AT - FEET		MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.)
FROM	TO	
10-13	14-17	
18-21	22-25	
26-29	30-33	

#### 71 PUMPING TEST

PUMPING TEST METHOD <input type="checkbox"/> PUMP <input checked="" type="checkbox"/> BAILER	PUMPING RATE 0012 GPM	DURATION OF PUMPING 02 HOURS 00 MINS.
STATIC LEVEL 020 FEET	WATER LEVEL END OF PUMPING 055 FEET	WATER LEVELS DURING PUMPING 15 MINUTES: 055 FEET 30 MINUTES: 055 FEET 45 MINUTES: 055 FEET 60 MINUTES: 055 FEET
IF FLOWING, GIVE RATE	PUMP INTAKE SET AT	WATER AT END OF TEST <input type="checkbox"/> CLEAR <input checked="" type="checkbox"/> CLOUDY
RECOMMENDED PUMP TYPE <input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP	RECOMMENDED PUMP SETTING 070 FEET	RECOMMENDED PUMPING RATE 0005 GPM

50-53 000.3 GPM./FT. SPECIFIC CAPACITY

#### LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE. INDICATE NORTH BY ARROW.

DRILLERS REMARKS:

#### FINAL STATUS OF WELL

1  WATER SUPPLY 5  ABANDONED, INSUFFICIENT SUPPLY  
 2  OBSERVATION WELL 6  ABANDONED, POOR QUALITY  
 3  TEST HOLE 7  UNFINISHED  
 4  RECHARGE WELL

#### WATER USE

1  DOMESTIC 5  COMMERCIAL  
 2  STOCK 6  MUNICIPAL  
 3  IRRIGATION 7  PUBLIC SUPPLY  
 4  INDUSTRIAL 8  COOLING OR AIR CONDITIONING  
 OTHER 9  NOT USED

#### METHOD OF DRILLING

1  CABLE TOOL 6  BORING  
 2  ROTARY (CONVENTIONAL) 7  DIAMOND  
 3  ROTARY (REVERSE) 8  JETTING  
 4  ROTARY (AIR) 9  DRIVING  
 5  AIR PERCUSSION

#### CONTRACTOR

NAME OF WELL CONTRACTOR: Capital Water Supply  
 LICENCE NUMBER: 1558  
 ADDRESS: 14 Ashford Dr Ottawa  
 NAME OF DRILLER OR BORER: L. Behrman  
 SIGNATURE OF CONTRACTOR: Walter Swanagh  
 SUBMISSION DATE: DAY \_\_\_\_ MO \_\_\_\_ YR \_\_\_\_

#### OFFICE USE ONLY

DATA SOURCE: 1  
 CONTRACTOR: 1558  
 DATE RECEIVED: 021270  
 DATE OF INSPECTION: \_\_\_\_\_  
 INSPECTOR: \_\_\_\_\_  
 REMARKS: \_\_\_\_\_  
 P: \_\_\_\_\_  
 W: \_\_\_\_\_



# WATER WELL RECORD

316/5A  
South Gloucester

Water management in Ontario

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1512040

MUNICIPALITY 15002

CON. 2-18  
2-26  
03

COUNTY OR DISTRICT: South Gloucester TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: Moncester CON., BLOCK, TRACT, SURVEY, ETC.: 3 RF LOT: 25-27  
 DATE COMPLETED: 48-53  
Albion Rd., Ottawa DAY: 24 MO: 08 YR: 72  
 RC: 13122 ELEVATION: 4 0338 BASIN CODE: 4 26

### LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	sand	clay	packed	0	4
Brown	sand		packed	4	35
Grey	sand	gravel	packed	35	46
<i>This is a gravel well</i>					

31 000462805 0035628 00462811

41 WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER			
10-13	1 <input checked="" type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
15-18	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
20-23	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
25-28	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
30-33	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		

51 CASING & OPEN HOLE RECORD

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 7/8	STEEL	2 23	0	48
06	GALVANIZED			0046
	CONCRETE			
	OPEN HOLE			
	STEEL			
	GALVANIZED			
	CONCRETE			
	OPEN HOLE			
	STEEL			
	GALVANIZED			
	CONCRETE			
	OPEN HOLE			

SCREEN

SIZE(S) OF OPENING (SLOT NO.)	DIAMETER	LENGTH
	INCHES	FEET
		41-44
		80
		FEET

MATERIAL AND TYPE: \_\_\_\_\_ DEPTH TO TOP OF SCREEN: \_\_\_\_\_

61 PLUGGING & SEALING RECORD

DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.)
FROM TO	
10-13 14-17	
18-21 22-25	
26-29 30-33 80	

71 PUMPING TEST METHOD

1  PUMP 2  BAILER


PUMPING RATE: 0020 GPM. DURATION OF PUMPING: 01 HOURS 00 MINS.

STATIC LEVEL: -00 FEET. WATER LEVELS DURING PUMPING:

15 MINUTES	30 MINUTES	45 MINUTES	60 MINUTES
<u>030</u> FEET	<u>030</u> FEET	<u>030</u> FEET	<u>030</u> FEET

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP. RECOMMENDED PUMP SETTING: 030 FEET. RECOMMENDED PUMPING RATE: 005 GPM.

50-53 000.7 GPM./FT. SPECIFIC CAPACITY

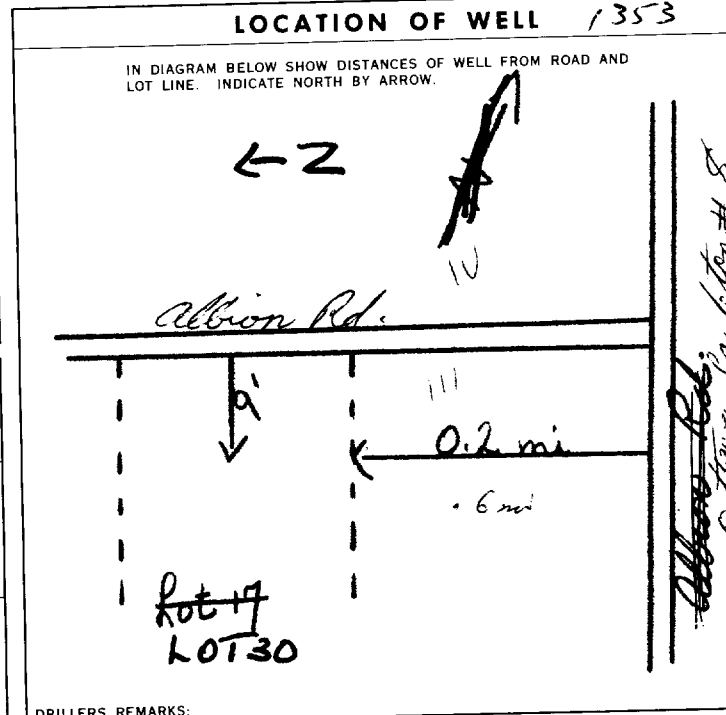

FINAL STATUS OF WELL: 1  WATER SUPPLY

WATER USE: 05

METHOD OF DRILLING: 1  CABLE TOOL

CONTRACTOR: Capital Water Supply Ltd LICENCE NUMBER: 1558

ADDRESS: Box 490, Stittsville, Ont.

NAME OF DRILLER OR BOPER: Mike Kowmnyk LICENCE NUMBER: \_\_\_\_\_

SIGNATURE OF CONTRACTOR: Halbo Kowmnyk SUBMISSION DATE: 28 MO: 8 YR: 72

OFFICE USE ONLY

DATA SOURCE: 1 CONTRACTOR: 1558 DATE RECEIVED: 041072

DATE OF INSPECTION: \_\_\_\_\_ INSPECTOR: \_\_\_\_\_

REMARKS: \_\_\_\_\_

P   
WI



South Gloucester Z-18  
B-26  
316/5a

# WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11 1514039 15009 CAN 04

COUNTY OR DISTRICT: Coquitlam TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: Osgoode CON., BLOCK, TRACT, SURVEY, ETC.: 4 LOT: 24-27

DATE COMPLETED: DAY 14 MC 12 YR. 73

R 2 Greely out

2667 RC 4 ELEVATION 0335 RC 4 BASIN CODE 26

## LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
	Sand			0	49
	Sand	Boulders		49	63
	Limestone		soft	63	162

31 0049 28 0063 2813 0102 15

32

### 41 WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER			
10-13	1 <input checked="" type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
2	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
15-18	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
2	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
20-23	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
2	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
25-28	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
2	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
30-33	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR		
2	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		

### 51 CASING & OPEN HOLE RECORD

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
10-11	1 <input checked="" type="checkbox"/> STEEL	8/32	0	0065
2	2 <input type="checkbox"/> GALVANIZED			
3	3 <input type="checkbox"/> CONCRETE			
4	4 <input type="checkbox"/> OPEN HOLE			
17-18	1 <input type="checkbox"/> STEEL			
2	2 <input type="checkbox"/> GALVANIZED			
3	3 <input type="checkbox"/> CONCRETE			
4	4 <input checked="" type="checkbox"/> OPEN HOLE			0102
24-25	1 <input type="checkbox"/> STEEL			
2	2 <input type="checkbox"/> GALVANIZED			
3	3 <input type="checkbox"/> CONCRETE			
4	4 <input type="checkbox"/> OPEN HOLE			

### SCREEN

SIZE(S) OF OPENING (SLOT NO.)	DIAMETER INCHES	LENGTH FEET

MATERIAL AND TYPE: \_\_\_\_\_ DEPTH TO TOP OF SCREEN: \_\_\_\_\_ FEET

### 61 PLUGGING & SEALING RECORD

DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.)
10-13	14-17
18-21	22-25
26-29	30-33

### 71 PUMPING TEST

PUMPING TEST METHOD:  PUMP  BAILER

PUMPING RATE: 0008 GPM

DURATION OF PUMPING: 04 HOURS 00 MINS

STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING			
028	028	15 MINUTES: 028	30 MINUTES: 028	45 MINUTES: 028	60 MINUTES: 028

IF FLOWING, GIVE RATE: \_\_\_\_\_ GPM

PUMP INTAKE SET AT: 45 FEET


WATER AT END OF TEST:  CLEAR  CLOUDY

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP

RECOMMENDED PUMP SETTING: 045 FEET

RECOMMENDED PUMPING RATE: 0008 GPM

016.0

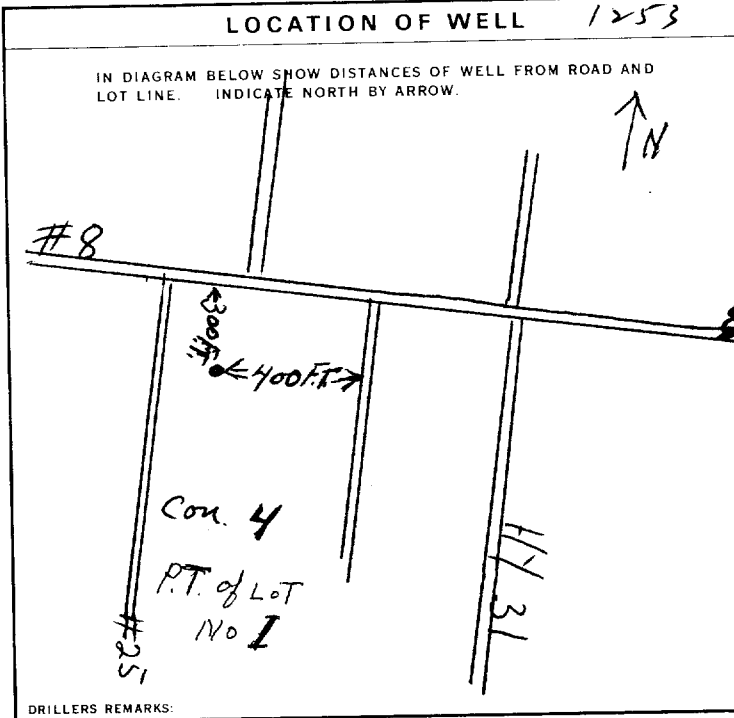

### FINAL STATUS OF WELL

1  WATER SUPPLY

2  OBSERVATION WELL

3  TEST HOLE

4  RECHARGE WELL

5  ABANDONED, INSUFFICIENT SUPPLY

6  ABANDONED, POOR QUALITY

7  UNFINISHED

### WATER USE

1  DOMESTIC

2  STOCK

3  IRRIGATION

4  INDUSTRIAL

5  COMMERCIAL

6  MUNICIPAL

7  PUBLIC SUPPLY

8  COOLING OR AIR CONDITIONING

9  NOT USED

### METHOD OF DRILLING

1  CABLE TOOL

2  ROTARY (CONVENTIONAL)

3  ROTARY (REVERSE)

4  ROTARY (AIR)

5  AIR PERCUSSION

6  BORING

7  DIAMOND

8  JETTING

9  DRIVING

### CONTRACTOR

NAME OF WELL CONTRACTOR: F.R. COSSETTE LICENCE NUMBER: 1603

ADDRESS: 1510 BASELINE

NAME OF DRILLER OR BORER: \_\_\_\_\_ LICENCE NUMBER: \_\_\_\_\_

SIGNATURE OF CONTRACTOR: F.R. Cossette SUBMISSION DATE: DAY 14 MO. Dec YR. 73

### OFFICE USE ONLY

DATA SOURCE: 1 CONTRACTOR: 1603 DATE RECEIVED: 270574

DATE OF INSPECTION: \_\_\_\_\_ INSPECTOR: K.

REMARKS: \_\_\_\_\_



Ontario

# WATER WELL RECORD

316/5a

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11 1514603 15002 KF 04

COUNTY OR DISTRICT <b>Carleton</b>	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE <b>Gloucester</b>	CONV., BLOCK, TRACT, SURVEY, ETC. <b>4 R2</b>	LOT <b>029</b>
ADDRESS <b>42 Kingsdale Ave., Ottawa, Ont.</b>			DATE COMPLETED DAY <b>12</b> MO <b>02</b> YR <b>75</b>
THING <b>013387</b>	RC <b>4</b>	ELEVATION <b>0345</b>	RC <b>4</b>
		BASIN CODE <b>26</b>	

### LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
	<b>Sand</b>			0	10
	<b>Sand</b>	<b>Clay</b>		10	38
	<b>Gravel</b>	<b>Boulders</b>		38	47
	<b>Limestone</b>			47	104

31 0010 28 0038 2805 0047 1113 0104 15

32

**41 WATER RECORD**

WATER FOUND AT - FEET	KIND OF WATER
10-13 <b>0095</b>	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
15-18 <b>0104</b>	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
20-23	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
25-28	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
30-33	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

**51 CASING & OPEN HOLE RECORD**

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET
06 5/8	1 <input checked="" type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE	.188	0 0047 47
06	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE		20-23 0104
24-25	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE		27-30

**SCREEN**

SIZE(S) OF OPENING (SLOT NO.)	DIAMETER	LENGTH
	INCHES	FEET
MATERIAL AND TYPE	DEPTH TO TOP OF SCREEN	
	41-44	80
	FEET	

**61 PLUGGING & SEALING RECORD**

DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.)
FROM TO	
12 10-12 15 16-17	<b>Cement Grout</b>
18-21 22-25	
26-29 30-33 80	

**71 PUMPING TEST**

PUMPING TEST METHOD 1 <input type="checkbox"/> PUMP 2 <input checked="" type="checkbox"/> BAILER	PUMPING RATE <b>0007</b> GPM.	DURATION OF PUMPING 15-16 HOURS 30 17-18 MINS.
STATIC LEVEL 19-21 <b>006</b> FEET	WATER LEVEL END OF PUMPING 22-24 <b>035</b> FEET	WATER LEVELS DURING PUMPING RECOVERY 15 MINUTES 26-28 <b>011</b> FEET 30 MINUTES 29-31 <b>006</b> FEET 45 MINUTES 32-34 <b>006</b> FEET 60 MINUTES 35-37 <b>006</b> FEET
IF FLOWING, GIVE RATE	PUMP INTAKE SET AT	WATER AT END OF TEST
	GPM.	1 <input checked="" type="checkbox"/> CLEAR 2 <input type="checkbox"/> CLOUDY
RECOMMENDED PUMP TYPE <input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP	RECOMMENDED PUMP SETTING <b>050</b> FEET	RECOMMENDED PUMPING RATE <b>0007</b> GPM.
50-53	000.2 GPM./FT. SPECIFIC CAPACITY	

**LOCATION OF WELL 1353**

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE. INDICATE NORTH BY ARROW.

OTTAWA CANAL #8

3 m  
40'  
WELL

OT  
T  
A  
W  
A  
C  
A  
N  
A  
L  
#  
8

25

DRILLERS REMARKS:

**FINAL STATUS OF WELL**

1  WATER SUPPLY 5  ABANDONED, INSUFFICIENT SUPPLY  
2  OBSERVATION WELL 6  ABANDONED, POOR QUALITY  
3  TEST HOLE 7  UNFINISHED  
4  RECHARGE WELL

**WATER USE**

1  DOMESTIC 5  COMMERCIAL  
2  STOCK 6  MUNICIPAL  
3  IRRIGATION 7  PUBLIC SUPPLY  
4  INDUSTRIAL 8  COOLING OR AIR CONDITIONING  
9  OTHER 9  NOT USED

**METHOD OF DRILLING**

1  CABLE TOOL 6  BORING  
2  ROTARY (CONVENTIONAL) 7  DIAMOND  
3  ROTARY (REVERSE) 8  JETTING  
4  ROTARY (AIR) 9  DRIVING  
5  AIR PERCUSSION

**CONTRACTOR**

NAME OF WELL CONTRACTOR  
**McLean Water Supply Ltd**

LICENCE NUMBER  
**3504**

ADDRESS  
**1532 Raven Ave., Ottawa, Ont.**

NAME OF DRILLER OR BORER  
**M. Mallon**

LICENCE NUMBER

SIGNATURE OF CONTRACTOR  
*M. Mallon*

SUBMISSION DATE  
DAY **12** MO **2** YR **75**

**OFFICE USE ONLY**

DATA SOURCE  
**1**

CONTRACTOR  
**3504**

DATE RECEIVED  
**290475**

DATE OF INSPECTION

INSPECTOR

REMARKS:

P

WI



# WATER WELL RECORD

3/6/76

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11 | 1515197 | 15002 | RF | 04

COUNTY OR DISTRICT: Carleton | TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: Gloucester | CON. BLOCK, TRACT, SURVEY ETC.: 4RF | LOT: 25-27: 30

DATE COMPLETED: 48-53: DAY 12 MO 01 YR 76

ADDRESS: Box 151 R.R. # 5 Albion Rd. Ottawa, Ontario

DATE OF DRILLING: 01/3/84 | RC: 4 | ELEVATION: 0338 | RC: 4 | BASIN CODE: 26

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)					
GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
brown	sand		frozen	0	3
brown	sand		loose	3	35
black	gravel			35	38
black	limestone		medium hard	38	51
black	limestone			51	73

31 | 0003628 | 003562877 | 0038811 | 005181573 | 0073815

32 |

**41 WATER RECORD**

WATER FOUND AT - FEET	KIND OF WATER
10-13	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
15-18	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
20-23	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
25-28	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
30-33	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

**51 CASING & OPEN HOLE RECORD**

WELLSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
64	1 <input checked="" type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE	188	0	0051
57	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE		51	73
06	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE			0073

**SCREEN**

SIZE(S) OF OPENING (SLOT NO.)	DIAMETER	LENGTH
31-33	34-38	39-40
MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN
		41-44
		80

**61 PLUGGING & SEALING RECORD**

DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.)
FROM TO	
10-13	14-17
18-21	22-25
26-29	30-33

**71 PUMPING TEST**

PUMPING TEST METHOD: 1  PUMP 2  BAILER

PUMPING RATE: 0050 GPM

DURATION OF PUMPING: 01 HOURS 00 MINS


STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING			
19-21	22-24	15 MINUTES	30 MINUTES	45 MINUTES	60 MINUTES
-5 ft	001	001	001	001	001

IF FLOWING, GIVE RATE: 0000 GPM

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP

RECOMMENDED PUMP SETTING: 030 FEET

RECOMMENDED PUMPING RATE: 0005 GPM

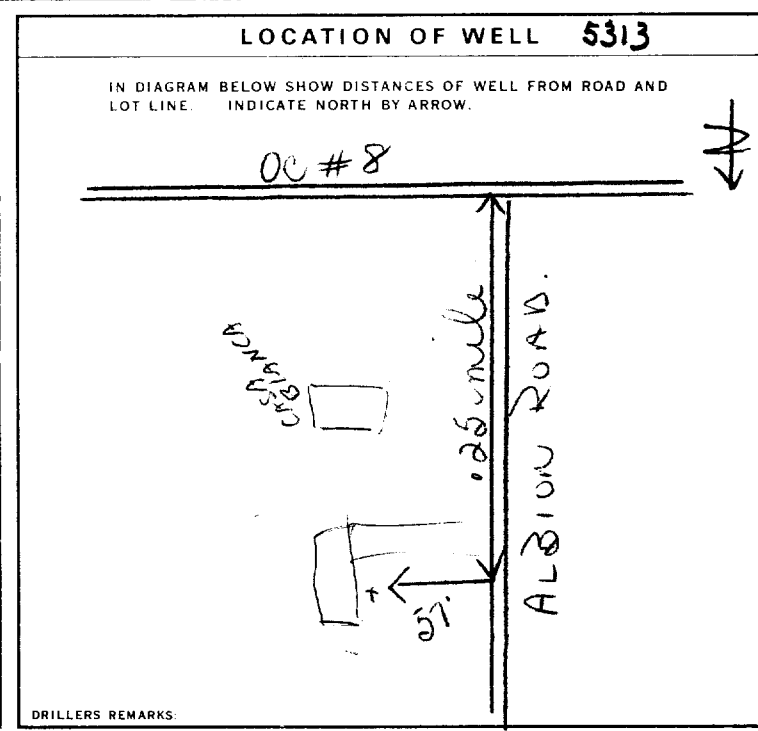

**FINAL STATUS OF WELL**

1  WATER SUPPLY  
2  OBSERVATION WELL  
3  TEST HOLE  
4  RECHARGE WELL

5  ABANDONED, INSUFFICIENT SUPPLY  
6  ABANDONED, POOR QUALITY  
7  UNFINISHED

**WATER USE**

1  DOMESTIC  
2  STOCK  
3  IRRIGATION  
4  INDUSTRIAL  
5  OTHER

6  COMMERCIAL  
7  MUNICIPAL  
8  PUBLIC SUPPLY  
9  COOLING OR AIR CONDITIONING  
10  NOT USED

**METHOD OF DRILLING**

1  CABLE TOOL  
2  ROTARY (CONVENTIONAL)  
3  ROTARY (REVERSE)  
4  ROTARY (AIR)  
5  AIR PERCUSSION

6  BORING  
7  DIAMOND  
8  JETTING  
9  DRIVING

**CONTRACTOR**

NAME OF WELL CONTRACTOR: Capital Water Supply Ltd. | LICENCE NUMBER: 1558

ADDRESS: Box 490 Stittville, Ontario

NAME OF DRILLER OR BORER: M. Hamilton | LICENCE NUMBER:

SIGNATURE OF CONTRACTOR: [Signature] | SUBMISSION DATE: DAY 14 MO 1 YR 76

**OFFICE USE ONLY**

DATA SOURCE: 1558 | CONTRACTOR: 150378 | DATE RECEIVED:

DATE OF INSPECTION: 15 Jul 76 | INSPECTOR: P/R Doyle

REMARKS:

P. WI



Ministry  
of the  
Environment  
Ontario

The Ontario Water Resources Act

3165a

# WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE



1517522

MUNICIP.

15002

CON.

RF

01

COUNTY OR DISTRICT <b>Ottawa-Carleton</b>	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE <b>Gloucester</b>	CON. BLOCK, TRACT, SURVEY ETC. <b>Conc. 4 R. F.</b>	DATE COMPLETED DAY <b>30</b> MO <b>10</b> YR <b>80</b>
ADDRESS <b>Box 153, Albion Rd., Ottawa, Ontario</b>			P/Lt. 29 <b>030</b>

NG <b>13099</b>	RC <b>4</b>	ELEVATION <b>0340</b>	RC <b>1</b>	BASIN CODE <b>26</b>
--------------------	----------------	--------------------------	----------------	-------------------------

## LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	Sand	Fill	Loose	0	2
Gray	Clay	Sand & Stones	Soft	2	20
Gray	Sand	Boulders	Packed	20	44
Black	Limestone		Medium Soft	44	63

34	600212810177	602029228112	60442261379	60639057863
----	--------------	--------------	-------------	-------------

### 41 WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER
10-13 <b>0063'</b>	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
15-18	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
20-23	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
25-28	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
30-33	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

### 51 CASING & OPEN HOLE RECORD

INSIDE DIAM INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
06-10 <b>6 1/4</b>	1 <input checked="" type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE	188	0	0046
10-17 <b>06</b>	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE		46	0055
17-18 <b>06</b>	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE		55	0063

### SCREEN


SIZE(S) OF OPENING (SLOT NO.)	DIAMETER INCHES	LENGTH FEET
	31-33	34-36
MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN 41-44

### 61 PLUGGING & SEALING RECORD

DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER, ETC.)
FROM TO	
10-13	14-17
18-21	22-25
26-29	30-33

### 71 PUMPING TEST

PUMPING TEST METHOD 1 <input type="checkbox"/> PUMP 2 <input checked="" type="checkbox"/> BAILER	PUMPING RATE <b>0030</b> GPM	DURATION OF PUMPING 15-16 HOURS <b>00</b> 17-18 MINS
STATIC LEVEL <b>000</b>	WATER LEVEL END OF PUMPING <b>003</b> FEET	WATER LEVELS DURING PUMPING 1 <input checked="" type="checkbox"/> PUMPING 2 <input type="checkbox"/> RECOVERY
19-21 <b>Flowing</b>	22-24 <b>003</b> FEET	15 MINUTES <b>003</b> FEET
26-28 <b>003</b> FEET	29-31 <b>003</b> FEET	30 MINUTES <b>003</b> FEET
32-34 <b>003</b> FEET	35-37 <b>003</b> FEET	45 MINUTES <b>003</b> FEET
38-41 <b>003</b> FEET	42 <b>003</b> FEET	60 MINUTES <b>003</b> FEET
IF FLOWING, GIVE RATE	PUMP INTAKE SET AT GPM	WATER AT END OF TEST 1 <input checked="" type="checkbox"/> CLEAR 2 <input type="checkbox"/> CLOUDY
RECOMMENDED PUMP TYPE 1 <input checked="" type="checkbox"/> SHALLOW 2 <input type="checkbox"/> DEEP	RECOMMENDED PUMP SETTING <b>025</b> FEET	RECOMMENDED PUMPING RATE <b>0005</b> GPM

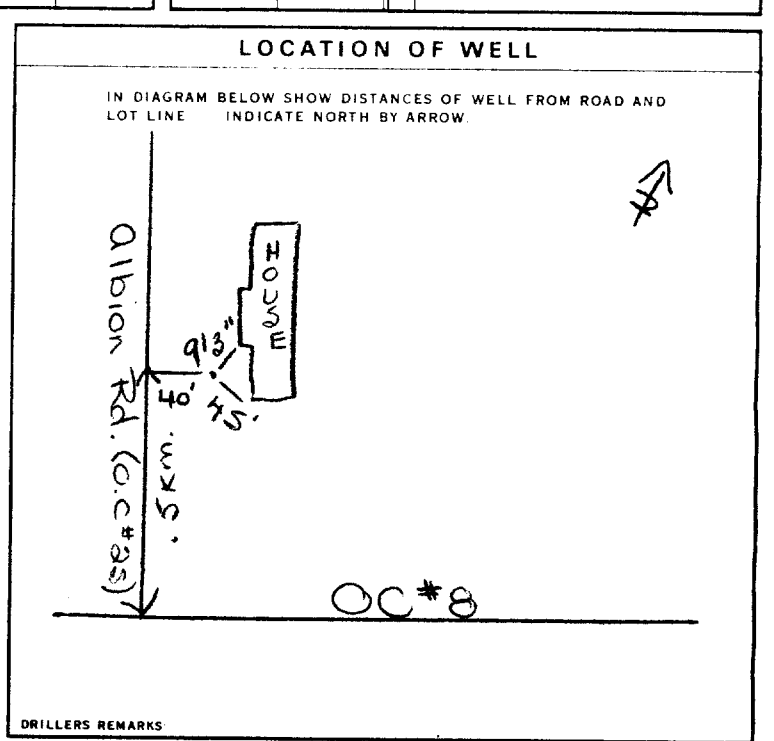

### FINAL STATUS OF WELL

1  WATER SUPPLY 5  ABANDONED, INSUFFICIENT SUPPLY  
2  OBSERVATION WELL 6  ABANDONED POOR QUALITY  
3  TEST HOLE 7  UNFINISHED  
4  RECHARGE WELL

### WATER USE

1  DOMESTIC 5  COMMERCIAL  
2  STOCK 6  MUNICIPAL  
3  IRRIGATION 7  PUBLIC SUPPLY  
4  INDUSTRIAL 8  COOLING OR AIR CONDITIONING  
9  OTHER 9  NOT USED

### METHOD OF DRILLING

1  CABLE TOOL 6  BORING  
2  ROTARY (CONVENTIONAL) 7  DIAMOND  
3  ROTARY (REVERSE) 8  JETTING  
4  ROTARY (AIR) 9  DRIVING  
5  AIR PERCUSSION

### CONTRACTOR

NAME OF WELL CONTRACTOR  
**Capital Water Supply Ltd.** LICENCE NUMBER **1558**

ADDRESS  
**Box 490, Stittsville, Ontario K0A 3G0**

NAME OF DRILLER OR BORER  
**J. Moore** LICENCE NUMBER

SIGNATURE OF CONTRACTOR  
*[Signature]* SUBMISSION DATE  
DAY **31** MO **10** YR **80**

### OFFICE USE ONLY

DATA SOURCE  
**1** CONTRACTOR  
**1558** DATE RECEIVED  
**020381**

DATE OF INSPECTION  
INSPECTOR

REMARKS:

3/65a

The Ontario Water Resources Act

# WATER WELL RECORD



1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1519504

MUNICIPALITY 15009

CON. CON

04

COUNTY OR DISTRICT: **Ottawa-Carleton** TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: **Osgoode** CON. BLOCK, TRACT, SURVEY, ETC: **TV Con .04** LOT: **001**

DATE COMPLETED: DAY **14** MO **08** YR **84**  
 ADDRESS: **Buchanan Cres. Ottawa, Ont.**  
 ELEVATION: **249.9** BASIN CODE: **0335**

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	Sand		Med. brown sand	0°	12°
Grey	Clay		Soft grey clay	12°	32°
Grey	Clay	Sand silt stones	Hard grey clay silt, sand, stones	12°	36°
Grey	Limestone		Med. grey limestone	36°	60°

MOE VF-18

31: 001262878 003220585 00361057806 006021578

**41 WATER RECORD**

WATER FOUND AT - FEET	KIND OF WATER
0040°	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
0054°	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

**51 CASING & OPEN HOLE RECORD**

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET
06 08	STEEL		0° - 0040°
06 18	OPEN HOLE	.188	+2° - 40°

**SCREEN**


SIZE (S) OF OPENING (SLOT NO.)	DIAMETER INCHES	LENGTH FEET

**61 PLUGGING & SEALING RECORD**

DEPTH SET AT - FEET	MATERIAL AND TYPE
20°	Cement grout
4°	4 sacks of high high early cement

**71 PUMPING TEST**

PUMPING TEST METHOD: <input checked="" type="checkbox"/> PUMP	PUMPING RATE: 0020 GPM	DURATION OF PUMPING: 06 HOURS 00 MINS
STATIC LEVEL: 3.31°	WATER LEVEL END OF PUMPING: 4.48°	WATER LEVELS DURING PUMPING: 3.75°, 4.15°, 4.18°, 4.18°
RECOMMENDED PUMP TYPE: <input checked="" type="checkbox"/> SHALLOW	RECOMMENDED PUMP SETTING: 050°	RECOMMENDED PUMPING RATE: 0020 GPM

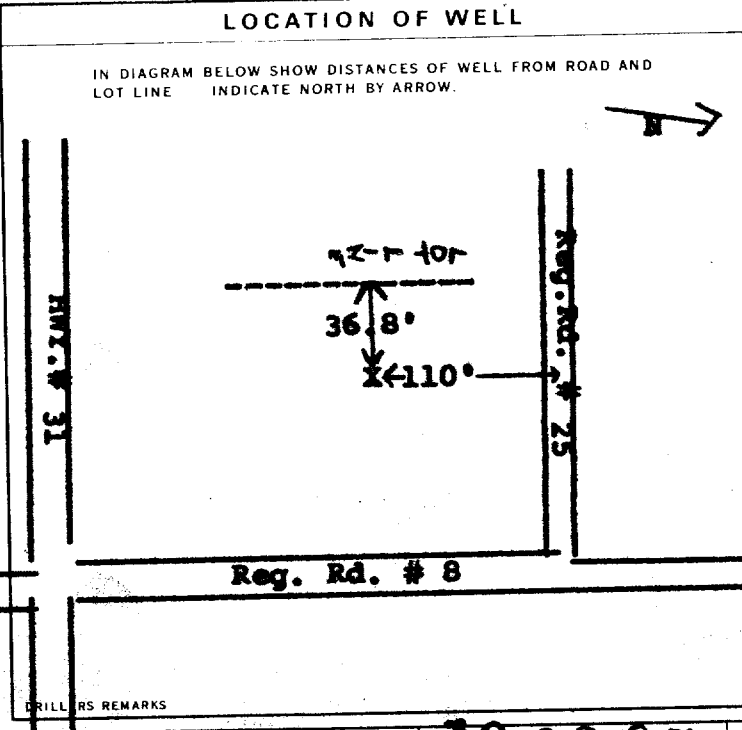

**FINAL STATUS OF WELL**: 1  WATER SUPPLY

**WATER USE**: 12  DOMESTIC

**METHOD OF DRILLING**: 2  ROTARY (CONVENTIONAL)

**CONTRACTOR**: OLYMPIC DRILLING CO. LIMITED, LICENCE NUMBER 4006  
 ADDRESS: Box 9180 OTTAWA, Ontario K1G 3T9  
 NAME OF DRILLER OR BORER: Roy W. Ranwick  
 SIGNATURE OF CONTRACTOR: [Signature]  
 SUBMISSION DATE: 10 MO 09 YR 84

**OFFICE USE ONLY**

DATA SOURCE: 1  
 CONTRACTOR: 4006  
 DATE RECEIVED: 19 03 85  
 DATE OF INSPECTION: \_\_\_\_\_  
 INSPECTOR: \_\_\_\_\_

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1529731

Municipality 15009 Con. CON 04

County or District: [Redacted] Township/Borough/City/Town/Village: Osgoode  
 Address: 6792 Mitch Owens Rd Greely, Ontario  
 Date completed: 17 day 10 month 97 year  
 Con block tract survey, etc.: 4 Lot: 1

General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	Sand	Stones	Dry	0	10
Gray	Clay	Stones	Sticky	10	35
Gray	Sand & Clay	Boulders	Packed	35	52
Gray	Limestone		Medium HARD	52	95
Gray & White	Sandstone		Very Hard	95	200

**41 WATER RECORD**

Water found at - feet: 195

Kind of water: NOT TESTED

Options: Fresh, Salty, Sulphur, Minerals, Gas

**51 CASING & OPEN HOLE RECORD**

Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/8	Galvanized	.188	0	55.5
6	Concrete		55.5	175
5 7/8	Plastic		175	200

**SCREEN**

Sizes of opening (Slot No.): [Blank]  
 Diameter: [Blank] inches  
 Length: [Blank] feet  
 Material and type: [Blank]  
 Depth at top of screen: [Blank] feet

**61 PLUGGING & SEALING RECORD**

Annular space:  Abandonment:

Depth set at - feet: [Blank]

Material and type (Cement grout, bentonite, etc.): Bentonite, Cement (High Early)

**71 PUMPING TEST**

Pumping test method:  Pump

Pumping rate: 5 GPM


Duration of pumping: 1 Hours

Water levels during: 15 min: 137 feet, 30 min: 75 feet, 45 min: 32 feet, 60 min: 31 feet

Recommended pump type:  Deep

Recommended pump setting: 175 feet

Recommended pump rate: 5 GPM

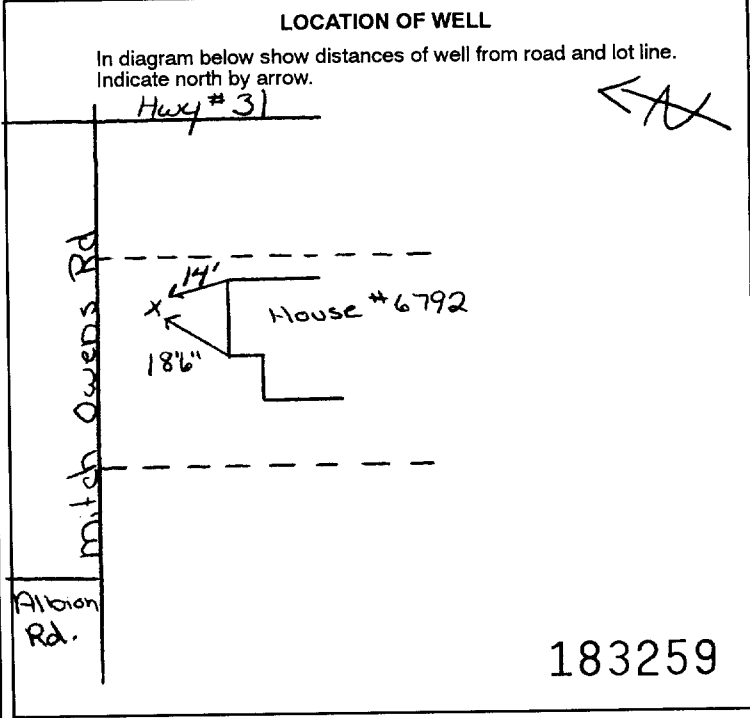

**FINAL STATUS OF WELL**

1  Water supply

**WATER USE**

1  Domestic

**METHOD OF CONSTRUCTION**

5  Air percussion

Name of Well Contractor: Capital Water Supply Ltd.  
 Well Contractor's Licence No.: 1558  
 Name of Well Technician: S. Miller  
 Well Technician's Licence No.: T0097  
 Submission date: day 22 mo 10 yr 97

**MINISTRY USE ONLY**

Data source: 1558  
 Date received: DEC 22 1997  
 Date of inspection: [Blank]  
 Inspector: [Blank]  
 Remarks: [Blank]



Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1531934

Municipality **15009** Con. **CON** **04**

County or District <b>Ottawa Carleton</b>	Township/Borough/City/Town/Village <b>Osgoode</b>	Con block tract survey, etc. <b>4</b>	Lot <b>25-27</b>
Address <b>60 Robinson Road, Nepean, ON. K2H 5Y8</b>		Date completed <b>20 04 01</b>	<b>48-53</b> day month year
21	2	10	12
1	2	10	12

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)**

General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	Sand			0	4
Grey	sand			4	9
Grey	clay			9	23
Grey	sand gravel & boulders			23	37
Grey	limestone			37	75

31

32

**41 WATER RECORD**

Water found at - feet	Kind of water
65	1 <input checked="" type="checkbox"/> NOT TESTED 2 <input type="checkbox"/> Salty
15-18	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty
20-23	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty
25-28	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty
30-33	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty

**51 CASING & OPEN HOLE RECORD**

Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	.188	0	40
6	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		40	75
6	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic			75

**SCREEN RECORD**


Sizes of opening (Slot No.)	Diameter	Length
	inches	feet
Material and type		Depth at top of screen
		feet

**61 PLUGGING & SEALING RECORD**

<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)
From	To	
40	0	Grouted-Bentonite
18-21	22-25	
26-29	30-33	

**71 PUMPING TEST**

Pumping test method <input checked="" type="checkbox"/> Pump	Pumping rate <b>25</b> GPM	Duration of pumping <b>1</b> Hours
Static level <b>8' 4"</b> feet	Water level end of pumping <b>25</b> feet	Water levels during Pumping
		15 minutes <b>70</b> feet
		30 minutes <b>50</b> feet
		45 minutes <b>50</b> feet
		60 minutes <b>25</b> feet
If flowing give rate GPM	Pump intake set at feet	Water at end of test <input checked="" type="checkbox"/> Clear <input type="checkbox"/> Cloudy
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting <b>35</b> feet	Recommended pump rate <b>5</b> GPM

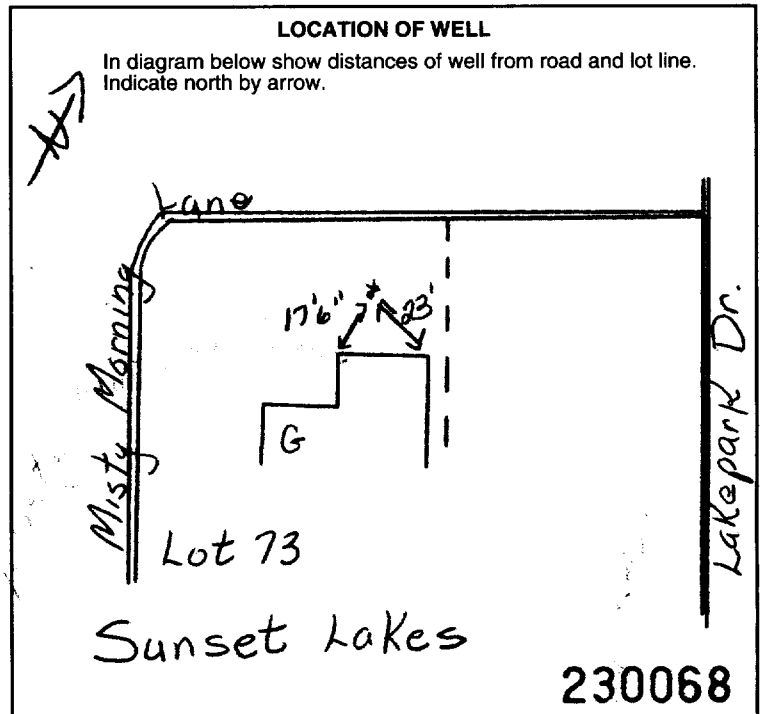

**FINAL STATUS OF WELL**

1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

**WATER USE**

1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

**METHOD OF CONSTRUCTION**

1 <input type="checkbox"/> Cable tool	5 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input checked="" type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting	

Name of Well Contractor <b>Capital Water Supply Ltd.</b>	Well Contractor's Licence No. <b>1558</b>
Address <b>Box 490, Stittsville, ON. K2S 1A6</b>	
Name of Well Technician <b>S. Miller</b>	Well Technician's Licence No. <b>T0097</b>
Signature of Technician/Contractor <i>S. Miller</i>	Submission date day <b>24</b> mo <b>04</b> yr <b>01</b>

**MINISTRY USE ONLY**

Data source <b>1558</b>	Contractor <b>1558</b>	Date received <b>JUN 15 2001</b>
Date of inspection	Inspector	
Remarks <b>CSS.ES1</b>		

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1531972

Municipality 15009 Con. CAN 04  
10 14 15 22 23 24

Sublot 72

County or District <b>Ottawa Carleton</b>	Township/Borough/City/Town/Village <b>Osgoode</b>	Con block tract survey, etc. <b>4</b>	25-27 <b>4</b>
Address <b>Breezy Ont</b>		Date completed <b>02 04 01</b> day month year	

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
	<b>sand</b>	<b>blue clay</b>		0	34
<b>grey</b>	<b>limestone</b>			34	101
<b>grey</b>	<b>sandstone</b>			101	120

31

32


41 WATER RECORD			
Water found at - feet	Kind of water		
88	<input checked="" type="checkbox"/> Fresh	<input checked="" type="checkbox"/> Sulphur	<input type="checkbox"/> Minerals
	<input type="checkbox"/> Salty	<input type="checkbox"/> Gas	
112	<input checked="" type="checkbox"/> Fresh	<input checked="" type="checkbox"/> Sulphur	<input type="checkbox"/> Minerals
	<input type="checkbox"/> Salty	<input type="checkbox"/> Gas	

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	Steel	188	0	42
8 3/4	Galvanized		0	40
6	Steel		40	120

SCREEN	Sizes of opening (Slot No.)	Diameter	Length
	inches	inches	feet

61 PLUGGING & SEALING RECORD			
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
2	42	Cement grout	

71 PUMPING TEST					
Pumping test method	Pumping rate	Duration of pumping		Water levels during	
<input checked="" type="checkbox"/> Pump	8 GPM	1	1	<input type="checkbox"/> Pumping	<input checked="" type="checkbox"/> Recovery
Static level	Water level end of pumping	15 minutes	30 minutes	45 minutes	60 minutes
15 feet	100 feet	15 feet	15 feet	15 feet	15 feet

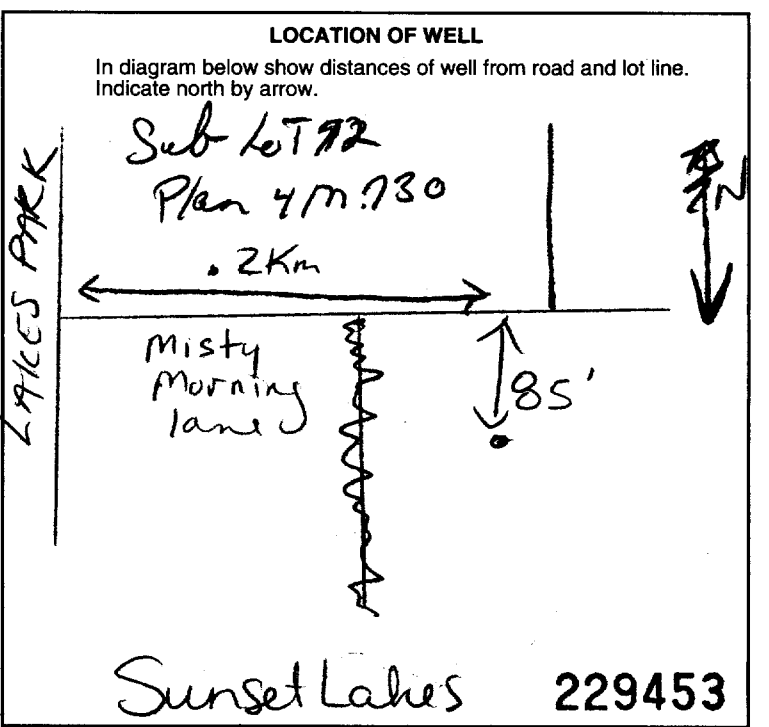

FINAL STATUS OF WELL		
<input checked="" type="checkbox"/> Water supply	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Unfinished
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well
<input type="checkbox"/> Test hole	<input type="checkbox"/> Abandoned (Other)	
<input type="checkbox"/> Recharge well	<input type="checkbox"/> Dewatering	

WATER USE	
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Commercial
<input type="checkbox"/> Stock	<input type="checkbox"/> Municipal
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Public supply
<input type="checkbox"/> Industrial	<input type="checkbox"/> Cooling & air conditioning

MINISTRY USE ONLY			
Data source	Contractor	Date received	
	1119	JUN 12 2001	
Date of inspection	Inspector	Remarks	
		CSS.ES1	

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1532047

Municipality **15009** Con. **CON** 04

County or District <b>Ottawa Carleton</b>		Township/Borough/City/Town/Village <b>Osgoode</b>		Con block tract survey, etc. <b>4</b>	Lot <b>2</b>
Owner's surname <b>Sienna Homes</b>	First Name	Address <b>60 Robinson Road, Nepean, ON K2H 5Y8</b>		Date completed <b>07 06 01</b> day month year	

21

Zone Easting Northing RC Elevation RC Basin Code ii iii iv

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	sand			0	4
Grey	sand		wet	4	12
Grey	clay	stones		12	24
Grey	sand & gravel	boulders		24	39
Grey	limestone			39	110
Grey & white sandstone				110	200

31

32


41 WATER RECORD	
Water found at - feet	Kind of water
191 10-13	1 <input checked="" type="checkbox"/> Not tested 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas
15-18	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas
20-23	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas
25-28	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas
30-33	1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty 3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 5 <input type="checkbox"/> Gas

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	.188	0	42'6"
6	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		42'6"	200
6	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic			

SCREEN	Sizes of opening (Slot No.)	Diameter	Length
	31-33	34-38 inches	39-40 feet
	Material and type		Depth at top of screen 41-44 feet

61 PLUGGING & SEALING RECORD			
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
42'6"	0	Grouted-Bentonite (3)	
18-21	22-25		
26-29	30-33		

71 PUMPING TEST	
Pumping test method 1 <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailer	Pumping rate <b>20 GPM</b>
Static level <b>6 feet</b>	Water level end of pumping <b>35 feet</b>
Water levels during 15 minutes <b>190 feet</b> 30 minutes <b>100 feet</b> 45 minutes <b>75 feet</b> 60 minutes <b>35 feet</b>	Duration of pumping 1 <b>1</b> Hours 5-16 Mins
If flowing give rate GPM	Pump intake set at feet
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting <b>100 feet</b>
Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy	Recommended pump rate <b>5 GPM</b>

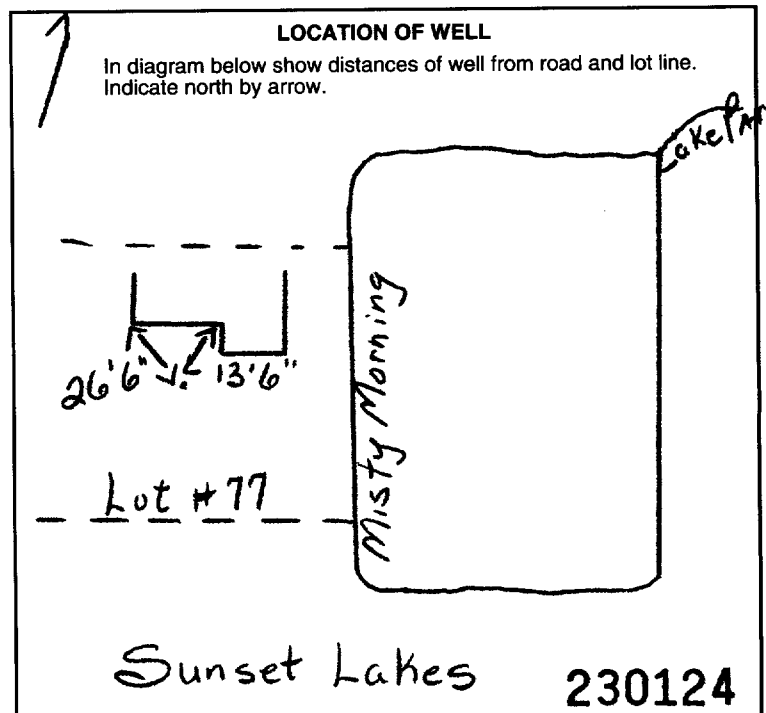

54 FINAL STATUS OF WELL		
1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

55-56 WATER USE		
1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

57 METHOD OF CONSTRUCTION		
1 <input type="checkbox"/> Cable tool	5 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input checked="" type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting	

Name of Well Contractor <b>Capital Water Supply Ltd</b>	Well Contractor's Licence No. <b>1558</b>
Address <b>Box 490, Stittsville, ON. K2S 1A6</b>	
Name of Well Technician <b>S. Miller</b>	Well Technician's Licence No. <b>T0097</b>
Signature of Technician/Contractor <i>S. Miller</i>	Submission date day <b>9</b> mo <b>06</b> yr <b>01</b>

MINISTRY USE ONLY	Data source	Contractor	Date received
		<b>1558</b>	<b>JUL 18 2001</b>
	Date of inspection	Inspector	
Remarks			<b>GSS.ES1</b>

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1532048

Municipality: 15009 Con: CON 04

County or District <b>Ottawa Carleton</b>		Township/Borough/City/Town/Village <b>Osgoode</b>		Con block tract survey, etc. <b>4</b>		Lot <b>1</b>	
Owner's surname <b>Sienna Homes</b>		First Name		Address <b>60 Robinson Road Nepean, Ontario K2H 5Y8</b>		Date completed <b>12</b> day <b>6</b> month <b>01</b> year	

21

Zone Easting Northing RC Elevation RC Basin Code ii iii iv

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	Sand			0	8
Gray	Clay			8	24
Gray	Sand & Gravel			24	38
Gray	Limestone			38	100
Note: There was 2 feet of casing left above ground at time of drilling					

31

32


41 WATER RECORD			
Water found at - feet	Kind of water		
10-13 <b>92</b>	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
15-18	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
20-23	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
25-28	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
30-33	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic	.188	0	42
6 1/8	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input checked="" type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic		42	100
24-25	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic			27-30

SCREEN	31-33		34-38		39-40	
	Sizes of opening (Slot No.)	Diameter inches	Length feet	Material and type	Depth at top of screen feet	

61 PLUGGING & SEALING RECORD			
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
42	0	Grouted - Cement #	
18-21	22-25	Bentonite (4)	
26-29	30-33		

71 PUMPING TEST			
Pumping test method <input checked="" type="checkbox"/> Pump <input type="checkbox"/> Bailer		Pumping rate <b>15</b> GPM	Duration of pumping <b>1</b> Hours <b>17</b> Mins
Static level <b>4' 6"</b>	Water level end of pumping <b>25</b> feet	Water levels during <input checked="" type="checkbox"/> Pumping <input type="checkbox"/> Recovery	
15 minutes <b>95</b> feet	30 minutes <b>60</b> feet	45 minutes <b>60</b> feet	60 minutes <b>25</b> feet
If flowing give rate	Pump intake set at <b>60</b> feet	Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy	
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting <b>60</b> feet	Recommended pump rate <b>5</b> GPM	

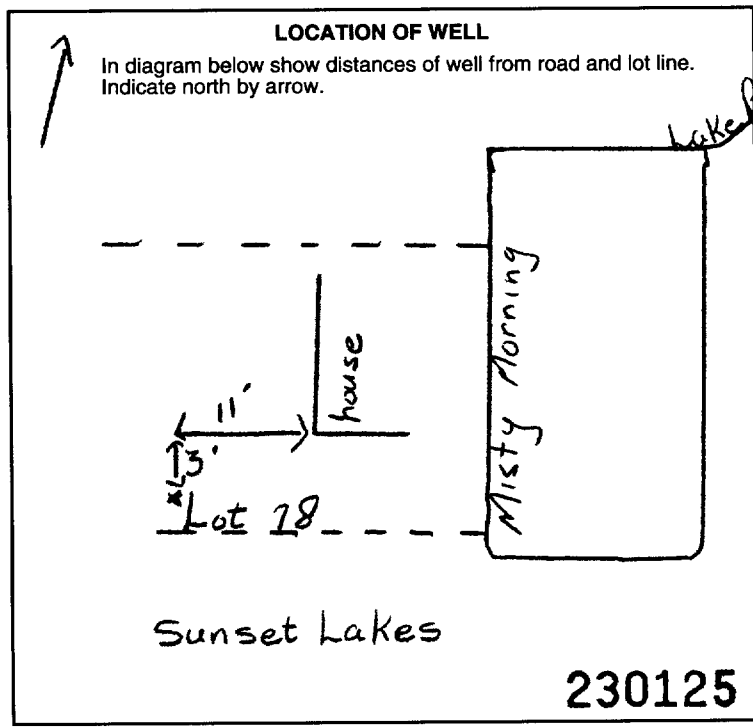

FINAL STATUS OF WELL			
<input checked="" type="checkbox"/> Water supply	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Unfinished	
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	
<input type="checkbox"/> Test hole	<input type="checkbox"/> Abandoned (Other)		
<input type="checkbox"/> Recharge well	<input type="checkbox"/> Dewatering		

WATER USE			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not use	
<input type="checkbox"/> Stock	<input type="checkbox"/> Municipal	<input type="checkbox"/> Other	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Public supply		
<input type="checkbox"/> Industrial	<input type="checkbox"/> Cooling & air conditioning		

METHOD OF CONSTRUCTION			
<input type="checkbox"/> Cable tool	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Driving	
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Other	
<input checked="" type="checkbox"/> Rotary (air mud)	<input type="checkbox"/> Jetting		

Name of Well Contractor <b>Capital Water Supply Ltd.</b>	Well Contractor's Licence No. <b>1558</b>
Address <b>P.O. Box 490 Stettville, Ontario K2S 1A6</b>	
Name of Well Technician <b>S. Miller</b>	Well Technician's Licence No. <b>T0097</b>
Signature of Technician/Contractor <i>S. Miller</i>	Submission date day <b>13</b> no <b>06</b> yr <b>01</b>

MINISTRY USE ONLY	58 Contractor		59-62 Date received	
	Data source	<b>1558</b>	<b>JUL 18 2001</b>	
	Date of inspection	Inspector		
Remarks				
CSS.ES1				



Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1532211

Municipality 15002 Con. CON 03

County or District <b>Ottawa Carleton</b>	Township/Borough/City/Town/Village <b>Gloucester</b>	Con block tract survey, etc. <b>3</b>	Lot <b>30</b>
Address <b>6668 Island Park Dr., Manotick, ON/K4M 1J3</b>		Date completed <b>31 08 01</b>	day month year

21

U T M 10 12 17 18 24 25 26 30 31 47

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	sandy		dry	0	5
Grey	sandy		wet	5	9
Grey	clay			9	25
Grey	gravel & boulders		packed	25	48
Grey & white	Sandstone			48	140

31

32


41 WATER RECORD	
Water found at - feet	Kind of water
135	<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
15-18	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
20-23	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
25-28	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
30-33	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic	.188	0	54
6 1/8	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic		54	140
24-25	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic			27-30

SCREEN	Sizes of opening (Slot No.)	Diameter	Length
	inches	inches	feet
	Material and type		Depth at top of screen
			feet

61 PLUGGING & SEALING RECORD			
<input type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
10-13	14-17		
18-21	22-25		
26-29	30-33		

71 PUMPING TEST	
Pumping test method 1 <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailor	Pumping rate <b>20</b> GPM
Duration of pumping 1 <input checked="" type="checkbox"/> 15-16 Hours 2 <input type="checkbox"/> 17-18 Mins	
Static level <b>22'4"</b> feet	Water level end of pumping <b>50</b> feet
Water levels during 1 <input checked="" type="checkbox"/> Pumping 2 <input type="checkbox"/> Recovery	
15 minutes <b>135</b> feet	30 minutes <b>120</b> feet
45 minutes <b>100</b> feet	60 minutes <b>50</b> feet
If flowing give rate GPM	Pump intake set at feet
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting <b>100</b> feet
	Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy
	Recommended pump rate <b>5</b> GPM

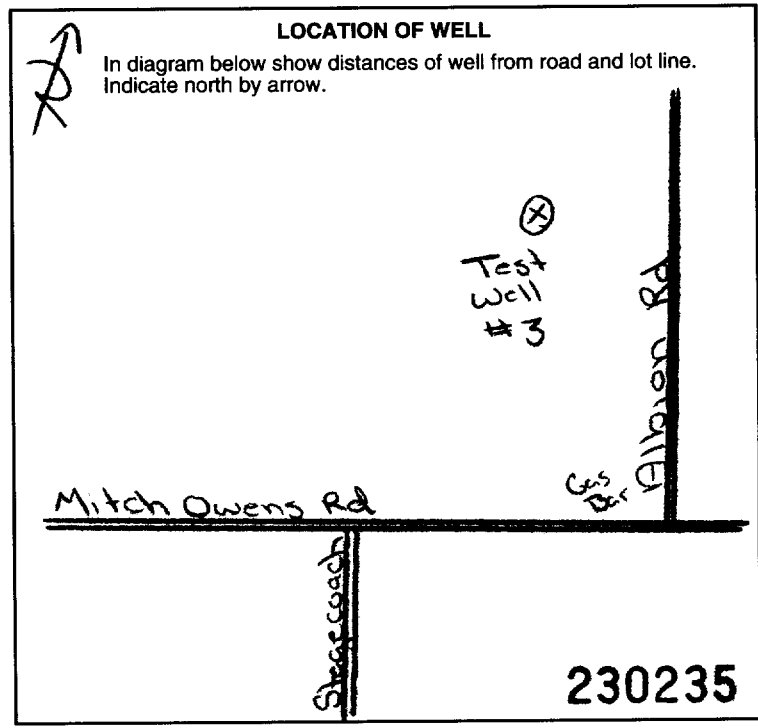

54 FINAL STATUS OF WELL		
1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

55-56 WATER USE		
1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

57 METHOD OF CONSTRUCTION		
1 <input type="checkbox"/> Cable tool	5 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input checked="" type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting	

Name of Well Contractor <b>Capital Water Supply Ltd.</b>	Well Contractor's Licence No. <b>1558</b>
Address <b>Box 490, Stittsville, ON. K2S 1A6</b>	
Name of Well Technician <b>S. Miller</b>	Well Technician's Licence No. <b>T0097</b>
Signature of Technician/Contractor	Submission date day <b>31</b> mo <b>8</b> yr <b>01</b>

MINISTRY USE ONLY	Data source	Contractor	Date received
		<b>1558</b>	<b>SEP 17 2001</b>
	Date of inspection	Inspector	
Remarks			
088.ES1			



Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1532213

Municipality  
15002

Con.  
CON 03

County or District <b>Ottawa Carleton</b>	Township/Borough/City/Town/Village <b>Gloucester</b>	Con block tract survey, etc. <b>3</b>	Lot <b>30</b>
Address <b>5668 Island Park Dr. Manotick ON. K4M 1J3</b>		Date completed <b>30 08 01</b>	

21

U  
T  
M

10 12 17 16 24 25 26 30 31 47

Northing RC Elevation RC Basin Code ii iii iv

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	sand			0	4
Grey	sand			4	8
Grey	sand & clay			8	25
Grey	limestone			25	75
Note: casing was left 18" above ground level at time of drilling.					

31

32

10 14 15 21 32 43 54 65 75 80


41 WATER RECORD			
Water found at - feet	Kind of water		
59 10-13	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	14
62 15-18	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	19
20-23	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	24
25-28	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	29
30-33	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty	<input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas	34

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic	.188	0	32-16
6 1/8	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input checked="" type="checkbox"/> Open hole <input type="checkbox"/> Plastic		32	75
24-25	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic			27-30

SCREEN	Sizes of opening (Slot No.)	Diameter	Length
	31-33	34-38	39-40
		inches	feet
	Material and type	Depth at top of screen	
		feet	

61 PLUGGING & SEALING RECORD			
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
32 10-13	0 14-17	Grouted-bentonite & cement	
18-21	22-25	-mix	
26-29	30-33	80	

71 PUMPING TEST		Pumping test method	Pumping rate	Duration of pumping
<input checked="" type="checkbox"/> Pump	<input type="checkbox"/> Bailer	30 GPM	1 1/2 Hours	17-18 Mins
Static level	Water level end of pumping	Water levels during		
6 feet	20 feet	15 minutes	30 minutes	45 minutes
		20 feet	20 feet	20 feet
If flowing give rate	Pump intake set at	Water at end of test		
		<input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy		
Recommended pump type	Recommended pump setting	Recommended pump rate		
<input checked="" type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	30 feet	5 GPM		

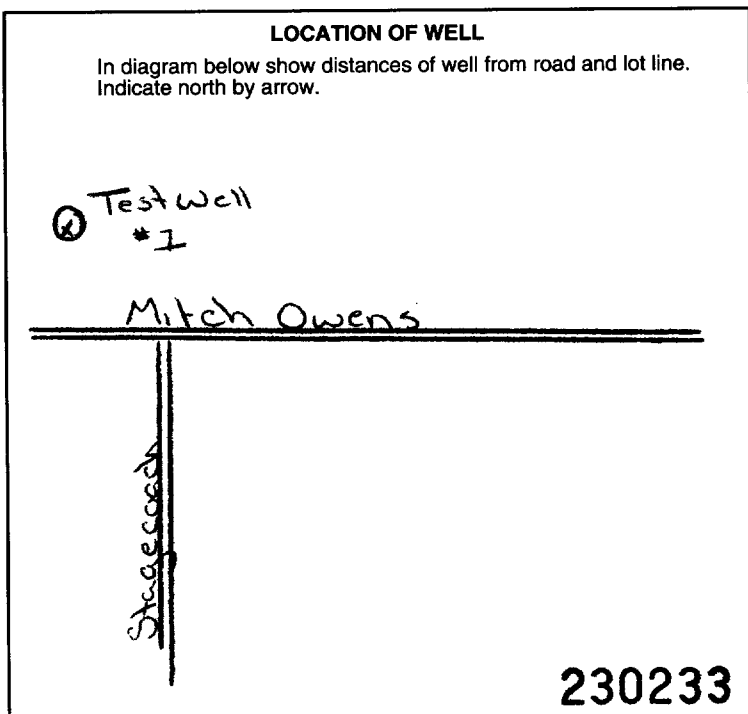

FINAL STATUS OF WELL		
<input checked="" type="checkbox"/> Water supply	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Unfinished
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well
<input type="checkbox"/> Test hole	<input type="checkbox"/> Abandoned (Other)	
<input type="checkbox"/> Recharge well	<input type="checkbox"/> Dewatering	

WATER USE		
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not use
<input type="checkbox"/> Stock	<input type="checkbox"/> Municipal	<input type="checkbox"/> Other
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Public supply	
<input type="checkbox"/> Industrial	<input type="checkbox"/> Cooling & air conditioning	

METHOD OF CONSTRUCTION		
<input type="checkbox"/> Cable tool	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Driving
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Boring	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Other
<input checked="" type="checkbox"/> Rotary (air)	<input type="checkbox"/> Jetting	

Name of Well Contractor <b>Capital Water Supply Ltd.</b>	Well Contractor's Licence No. <b>1558</b>
Address <b>Box 490, Stittsville, ON. K2S 1A6</b>	
Name of Well Technician <b>S. Miller</b>	Well Technician's Licence No. <b>T0097</b>
Signature of Technician/Contractor <i>[Signature]</i>	Submission date day <b>31</b> mo <b>8</b> yr <b>01</b>

MINISTRY USE ONLY	Data source <b>1558</b>	Contractor <b>1558</b>	Date received <b>SEP 17 2001</b>
	Date of inspection	Inspector	
	Remarks <b>088.ES1</b>		

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

1532594

11

Municipality 15009 Con SRN 04

Plan 4M861 Sub lot 49

County or District <b>Ottawa Carleton</b>	Township/Borough/City/Town/Village <b>OSgoode</b>	Con block tract survey, etc. <b>4</b>	Lot <b>1</b>
Owner's surname <b>Picasso Homes</b>	First Name <b>Greely, Ont</b>	Address <b>Greely, Ont</b>	
Date completed <b>20 11 01</b>		day month year	

Zone <b>21</b>	Easting	Northing	RC	Elevation	RC	Basin Code	ii	iii	iv
-------------------	---------	----------	----	-----------	----	------------	----	-----	----

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)**

General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
black earth		peat moss		0	6
grey <del>clay</del> sand				6	34
grey limestone				34	61

31	32
----	----

**41 WATER RECORD**

Water found at - feet	Kind of water
49	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 14 2 <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <b>NOT GAS</b>
51	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 19 2 <input type="checkbox"/> Salty 6 <input type="checkbox"/> Minerals <b>NOT GAS</b>
53	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 24 2 <input type="checkbox"/> Salty 6 <input type="checkbox"/> Minerals <b>NOT GAS</b>
54	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 29 2 <input type="checkbox"/> Salty 6 <input type="checkbox"/> Minerals <b>NOT GAS</b>

**51 CASING & OPEN HOLE RECORD**

Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	1 <input checked="" type="checkbox"/> Steel 12 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	188	0	42 1/2
8 3/4	1 <input type="checkbox"/> Steel 19 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		0	40 1/2
6	1 <input type="checkbox"/> Steel 26 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		40 1/2	61

**SCREEN**


Sizes of opening (Slot No.)	Diameter	Length
	inches	feet
Material and type		Depth at top of screen
		feet

**61 PLUGGING & SEALING RECORD**

Depth set at - feet		Material and type (Cement grout, bentonite, etc.)
From	To	
2	42 1/2	<b>Bentonite grout</b>
18-21	22-25	
26-29	30-33	

**71 PUMPING TEST**

Pumping test method 1 <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailer	Pumping rate <b>28</b> GPM	Duration of pumping 1 <input type="checkbox"/> Hours 17-18 Mins
Static level <b>4</b> feet	Water level end of pumping <b>50</b> feet	Water levels during 1 <input type="checkbox"/> Pumping 2 <input checked="" type="checkbox"/> Recovery
		15 minutes <b>4</b> feet 26-28 30 minutes <b>4</b> feet 29-31 45 minutes <b>4</b> feet 32-34 60 minutes <b>4</b> feet 35-37
If flowing give rate GPM	Pump intake set at feet	Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting <b>50</b> feet	Recommended pump rate <b>28</b> GPM

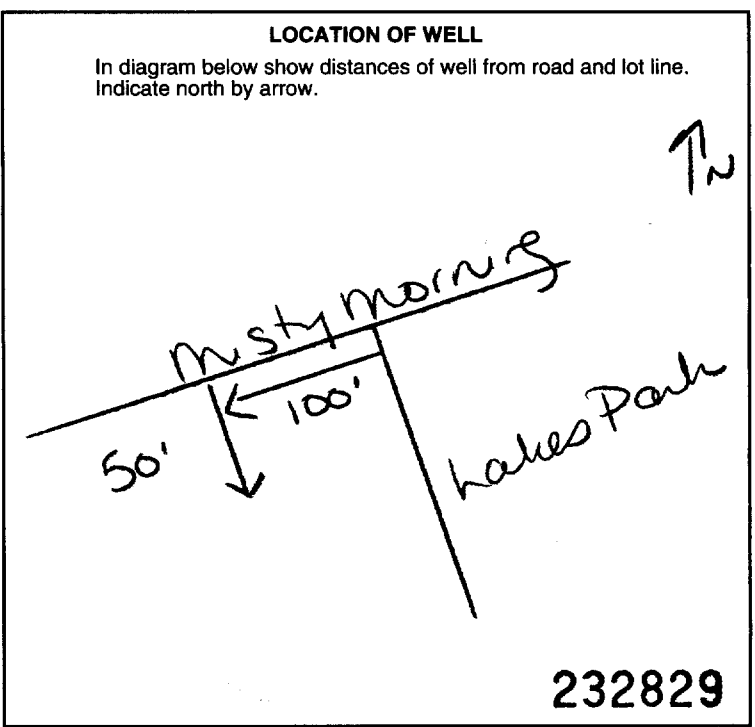

**FINAL STATUS OF WELL**

1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

**WATER USE**

1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

**METHOD OF CONSTRUCTION**

1 <input type="checkbox"/> Cable tool	5 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting	

Name of Well Contractor <b>Art Koch Drill &amp; Blt Ltd</b>	Well Contractor's Licence No. <b>1119</b>
Address <b>Rt #2 Jasper, Ont</b>	
Name of Well Technician <b>Shannon Purcell</b>	Well Technician's Licence No. <b>Ta 122</b>
Signature of Technician/Contractor <i>[Signature]</i>	Submission date <b>11 12 01</b> day mo yr

**MINISTRY USE ONLY**

Data source <b>1119</b>	Contractor <b>1119</b>	Date received <b>JAN 08 2002</b>
Date of inspection	Inspector	
Remarks <b>CSS.ES2</b>		

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

1533042

Municipality 15001 Con. 04  
10-14 22 24

Plan 4m1123 Sublot 16

County or District: Ottawa-Carleton  
Township/Borough/City/Town/Village: Osgoode  
Con block tract survey, etc.: 4 Lot: 1:2  
Address: Greely, Ont  
Date completed: 10/07/02

Northings: 10, 12, 17, 18, 24, 25, 26, 30, 31, 47  
RC, Elevation, RC, Basin Code, ii, iii, iv

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
	sand	boulders		0	29
grey	fractured limestone			29	34
"	limestone			34	102

31, 32

41 WATER RECORD

Water found at - feet	Kind of water
50	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 14 2 <input type="checkbox"/> Salty 4 <input type="checkbox"/> Minerals 3 <input type="checkbox"/> Gas
61	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 19 2 <input type="checkbox"/> Salty 4 <input type="checkbox"/> Minerals 3 <input type="checkbox"/> Gas
72	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 24 2 <input type="checkbox"/> Salty 4 <input type="checkbox"/> Minerals 3 <input type="checkbox"/> Gas
85	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 29 2 <input type="checkbox"/> Salty 4 <input type="checkbox"/> Minerals 3 <input type="checkbox"/> Gas
	1 <input type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 34 2 <input type="checkbox"/> Salty 4 <input type="checkbox"/> Minerals 3 <input type="checkbox"/> Gas

51 CASING & OPEN HOLE RECORD

Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	1 <input checked="" type="checkbox"/> Steel 12 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	1 8/8	0	40
8 3/4	1 <input type="checkbox"/> Steel 19 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		0	38
6	1 <input type="checkbox"/> Steel 26 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		38	102

SCREEN


Sizes of opening (Slot No.)	Diameter inches	Length feet
Material and type		Depth at top of screen feet

61 PLUGGING & SEALING RECORD

<input type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
2	40	bentonite	
18-21	22-25		
26-29	30-33	80	

71 PUMPING TEST

Pumping test method <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailer	Pumping rate 25 GPM	Duration of pumping 1 Hours 17-18 Mins
Static level 3 feet	Water level end of pumping 70 feet	Water levels during 15 minutes: 3 feet 30 minutes: 3 feet 45 minutes: 3 feet 60 minutes: 3 feet
If flowing give rate GPM	Pump intake set at 70 feet	Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting 70 feet	Recommended pump rate 25 GPM

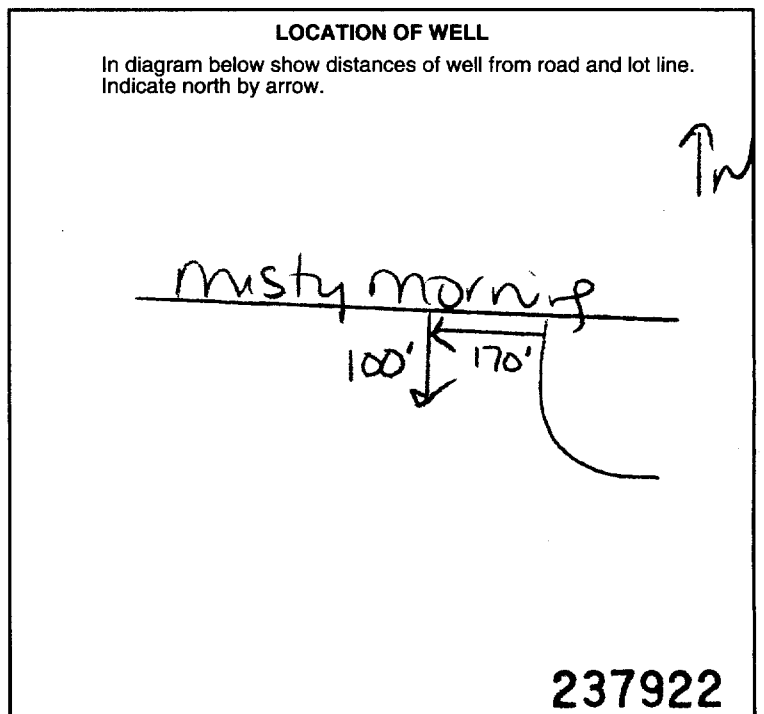

54 FINAL STATUS OF WELL

<input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

55-56 WATER USE

<input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

57 METHOD OF CONSTRUCTION

1 <input type="checkbox"/> Cable tool	4 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	5 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	6 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input type="checkbox"/> Rotary (air)	7 <input type="checkbox"/> Jetting	

Name of Well Contractor: A. Koch Drilling Co Ltd 1119  
Address: RR#1 Richmond, Ont  
Name of Well Technician: Shannon Purcell  
Signature of Technician/Contractor: [Signature]  
Well Contractor's Licence No.: 1119  
Well Technician's Licence No.: 12122  
Submission date: 02/08/02

MINISTRY USE ONLY

Data source	1119	Date received	AUG 09 2002
Date of inspection	Inspector		
Remarks	CSS.ES2		



Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

11

1533068

Municipality: **15009 CON** Con. **04**  
Plan: **1122** Sheet: **1**

County or District <b>Ottawa Carleton</b>		Township/Borough/City/Town/Village <b>Osgoode</b>		Con block tract survey, etc. <b>4</b>		Lot <b>112</b>	
Owner's surname <b>Picasso Homes</b>		First Name		Address <b>Greely, Ont</b>		Date completed <b>07 08 02</b> day month year	

21

Zone	Easting	Northing	RC	Elevation	RC	Basin Code	ii	iii	iv
------	---------	----------	----	-----------	----	------------	----	-----	----

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)**

General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
	<b>sand</b>	<b>blue clay</b>		<b>0</b>	<b>35</b>
<b>grey</b>	<b>limestone</b>			<b>35</b>	<b>80</b>

31

32

**41 WATER RECORD**

Water found at - feet	Kind of water
<b>71</b>	<b>NOT TESTED</b>
10-13	1 <input checked="" type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur Minerals 14
15-18	1 <input type="checkbox"/> Fresh 4 <input type="checkbox"/> Minerals 15
20-23	1 <input type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 24
25-28	1 <input type="checkbox"/> Fresh 4 <input type="checkbox"/> Minerals 29
30-33	1 <input type="checkbox"/> Fresh 3 <input type="checkbox"/> Sulphur 34

**51 CASING & OPEN HOLE RECORD**

Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
<b>6 1/4</b>	<b>Steel</b>	<b>1.88</b>	<b>0</b>	<b>44</b>
<b>8 3/4</b>	<b>Steel</b>		<b>0</b>	<b>42</b>
<b>6</b>	<b>Steel</b>		<b>42</b>	<b>80</b>

**SCREEN**


Sizes of opening (Slot No.)	Diameter inches	Length feet
Material and type		Depth at top of screen feet

**61 PLUGGING & SEALING RECORD**

<input checked="" type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at - feet	Material and type (Cement grout, bentonite, etc.)
<b>2 1/4</b>	<b>bentonite</b>

**71 PUMPING TEST**

Pumping test method <input checked="" type="checkbox"/> Pump <input type="checkbox"/> Bailer	Pumping rate <b>30</b> GPM	Duration of pumping <b>1</b> Hours <b>17</b> Mins				
Static level <b>8</b> feet	Water level end of pumping <b>70</b> feet	Water levels during <table border="0"> <tr> <td>15 minutes <b>8</b> feet</td> <td>30 minutes <b>8</b> feet</td> <td>45 minutes <b>8</b> feet</td> <td>60 minutes <b>8</b> feet</td> </tr> </table>	15 minutes <b>8</b> feet	30 minutes <b>8</b> feet	45 minutes <b>8</b> feet	60 minutes <b>8</b> feet
15 minutes <b>8</b> feet	30 minutes <b>8</b> feet	45 minutes <b>8</b> feet	60 minutes <b>8</b> feet			
If flowing give rate GPM	Pump intake set at <b>70</b> feet	Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy				
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	Recommended pump setting <b>70</b> feet	Recommended pump rate <b>30</b> GPM				

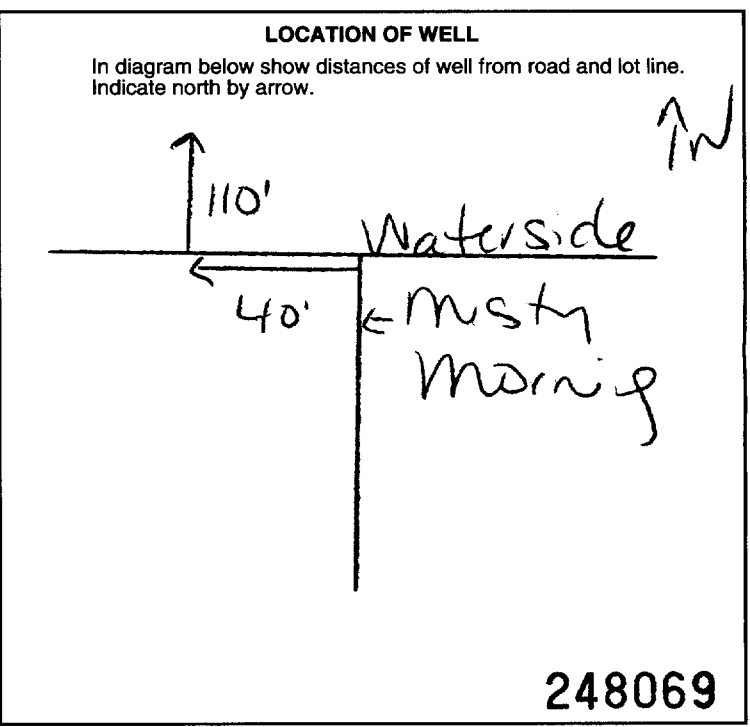

**FINAL STATUS OF WELL**

1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

**WATER USE**

1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

**METHOD OF CONSTRUCTION**

1 <input type="checkbox"/> Cable tool	6 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	7 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	8 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input type="checkbox"/> Rotary (air)		

Name of Well Contractor <b>Arkol Drilling Ltd 1119</b>	Well Contractor's Licence No.
Address <b>Rt #1 Richmond Ont</b>	
Name of Well Technician <b>Shannon Purcell</b>	Well Technician's Licence No. <b>12122</b>
Signature of Technician/Contractor <i>[Signature]</i>	Submission date <b>23 08 02</b> day mo yr

**MINISTRY USE ONLY**

Data source	Contractor <b>1119</b>	Date received <b>AUG 27 2002</b>
Date of inspection	Inspector	
Remarks	<b>CSS.ES2</b>	

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

1533110

Municipality 15009 Con. 04

Plan 4m937 Sublot 69

County or District Ottawa-Carleton	Township/Borough/City/Town/Village Osgoode	Con. block tract survey, etc. 4	Lot 152
Address Greely, Ont		Date completed 21 08 02 day month year	

21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
	Sandy clay			0	41
grey	Limestone			41	121
grey	Sandstone			121	160

31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60


41 WATER RECORD	
Water found at - feet	Kind of water
150	1 <input checked="" type="checkbox"/> Fresh 2 <input checked="" type="checkbox"/> Salty 3 <input checked="" type="checkbox"/> Sulphur 4 <input checked="" type="checkbox"/> Minerals 5 <input checked="" type="checkbox"/> Gas

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	188	0	50
8 3/4	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		0	48
6	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		48	160

SCREEN	31-33 Sizes of opening (Slot No.)		34-38 Diameter inches		39-40 Length feet	
	From	To	From	To	From	To

61 PLUGGING & SEALING RECORD		
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)
From	To	
2	50	bentonite

71 PUMPING TEST	
1 <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailer	10 Pumping rate 7 GPM
15-16 Static level 13 feet	17-18 Duration of pumping 1 Hours 17 Mins
19-21 Water level end of pumping 150 feet	25 Water levels during 1 <input type="checkbox"/> Pumping 2 <input checked="" type="checkbox"/> Recovery
22-24 15 minutes 65 feet	28 30 minutes 13 feet
25-27 45 minutes 13 feet	32-34 60 minutes 13 feet
35-37 If flowing give rate	38-41 Pump intake set at 150 feet
42 Recommended pump type <input checked="" type="checkbox"/> Deep	43-45 Recommended pump setting 150 feet
46-49 Recommended pump rate 7 GPM	50-53 Water at end of test <input checked="" type="checkbox"/> Cloudy

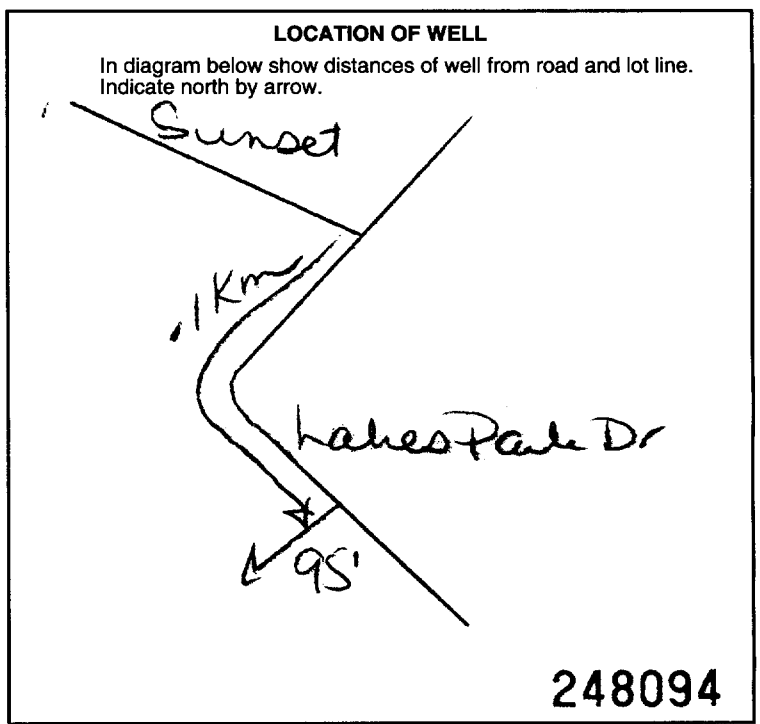

54 FINAL STATUS OF WELL		
1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

55-56 WATER USE		
1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

57 METHOD OF CONSTRUCTION		
1 <input type="checkbox"/> Cable tool	5 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting	

Name of Well Contractor Air Koch Drilling Ltd	Well Contractor's Licence No. 1119
Address RR#1 Richmond, Ont	
Name of Well Technician Shannon Powell	Well Technician's Licence No. 10122
Signature of Technician/Contractor Kemp	Submission date 09 09 02 day mo yr

MINISTRY USE ONLY	Data source I119	Date received SEP 16 2002
	Date of inspection	Inspector
	Remarks CSS.ES2	

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

1533111

Municipality Con. 15009 CAN 04

11

Dian 4m1123 Sublot 3

County or District <b>Ottawa Carleton</b>		Township/Borough/City/Town/Village <b>Osgoode</b>		Con block tract survey, etc. <b>4</b>	Lot <b>152</b>
Owner's surname <b>Picasso Homes</b>	First Name	Address <b>Breezy</b>		Date completed <b>21 08 02</b> day month year	

21

Zone	Easting	Northing	RC	Elevation	RC	Basin Code	ii	iii	iv
------	---------	----------	----	-----------	----	------------	----	-----	----

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
	<b>Sand</b>	<b>blue clay</b>		<b>0</b>	<b>36</b>
<b>grey</b>	<b>Limestone</b>			<b>36</b>	<b>111</b>
<b>grey</b>	<b>Sandstone</b>			<b>111</b>	<b>140</b>

31

32


41 WATER RECORD	
Water found at - feet	Kind of water
<b>133</b>	<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas <input type="checkbox"/> Taste
15-18	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
20-23	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
25-28	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas
30-33	<input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals <input type="checkbox"/> Gas

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
<b>6 1/4</b>	<input checked="" type="checkbox"/> Steel	<b>188</b>	<b>0</b>	<b>44</b>
<b>8 3/4</b>	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic		<b>0</b>	<b>42</b>
<b>6</b>	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic		<b>42</b>	<b>140</b>

SCREEN	31-33 Sizes of opening (Slot No.)		34-38 Diameter inches		39-40 Length feet	
	Material and type			Depth at top of screen		

61 PLUGGING & SEALING RECORD			
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
<b>2</b>	<b>44</b>	<b>compact bentonite</b>	
18-21	22-25		
26-29	30-33		

71 PUMPING TEST	
Pumping test method	Pumping rate
<input checked="" type="checkbox"/> Pump	<b>15</b> GPM
Static level	Water level end of pumping
<b>12</b> feet	<b>120</b> feet
Water levels during	15 minutes
<b>12</b> feet	<b>12</b> feet
Recommended pump type	Recommended pump setting
<input checked="" type="checkbox"/> Deep	<b>170</b> feet

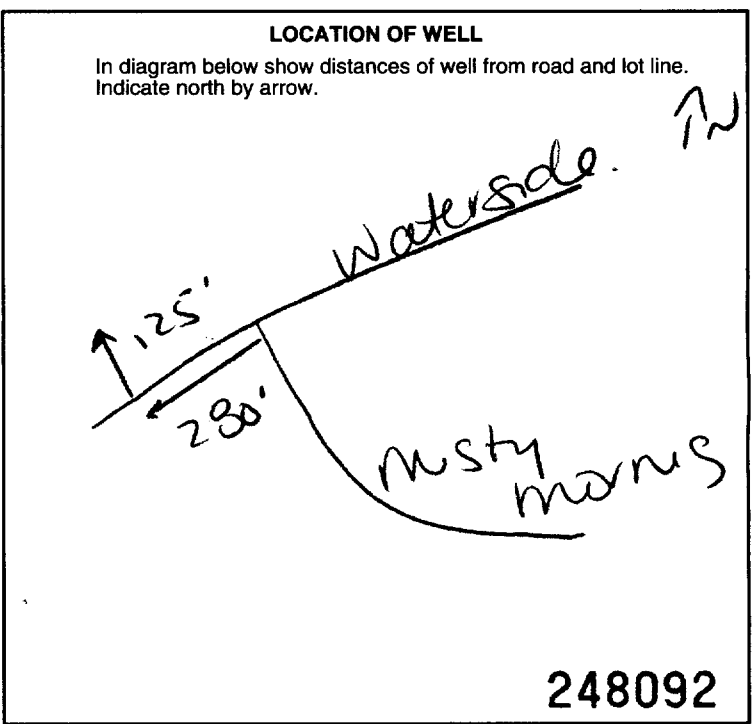

FINAL STATUS OF WELL		
<input checked="" type="checkbox"/> Water supply	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Unfinished
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well
<input type="checkbox"/> Test hole	<input type="checkbox"/> Abandoned (Other)	
<input type="checkbox"/> Recharge well	<input type="checkbox"/> Dewatering	

WATER USE		
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not use
<input type="checkbox"/> Stock	<input type="checkbox"/> Municipal	<input type="checkbox"/> Other
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Public supply	
<input type="checkbox"/> Industrial	<input type="checkbox"/> Cooling & air conditioning	

METHOD OF CONSTRUCTION		
<input type="checkbox"/> Cable tool	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Driving
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Boring	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Jetting	

Name of Well Contractor <b>A. Koch Drilling Ltd</b>	Well Contractor's Licence No. <b>1119</b>
Address <b>R.R.#1 Richmond, Ont</b>	
Name of Well Technician <b>Shannon Purcell</b>	Well-Technician's Licence No. <b>12122</b>
Signature of Technician/Contractor	Submission date <b>09 09 02</b> day mo yr

MINISTRY USE ONLY	Data source	Contractor	Date received
		<b>1119</b>	<b>SEP 10 2002</b>
	Date of inspection	Inspector	
Remarks			

Print only in spaces provided.  
Mark correct box with a checkmark, where applicable.

1533215

Municipality: 15009 Con. 04  
Plan 4m123 Sublot 5

11

County or District: Ottawa Carleton  
Township/Borough/City/Town/Village: Osgoode  
Con block tract survey, etc.: 4 Lot: 1:2  
Address: Greely, Ont  
Date completed: 12 09 02  
Basin Code: ii iii iv

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)**

General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
grey	sand limestone	blue clay, boulders		0	32
				32	101

31  
32

**41 WATER RECORD**

Water found at - feet	Kind of water
51	NOT
64	FRESH
68	FRESH

**51 CASING & OPEN HOLE RECORD**

Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	Steel	188	0	44
8 3/4	Steel		0	42
6	Steel		42	101

**SCREEN**

Sizes of opening (Slot No.)	Diameter inches	Length feet

**61 PLUGGING & SEALING RECORD**

Depth set at - feet	Material and type (Cement grout, bentonite, etc.)
2 44	bentonite

**71 PUMPING TEST**

Pumping test method:  Pump  
Pumping rate: 23 GPM  
Duration of pumping: 1 Hours  
Static level: 5 feet  
Water level end of pumping: 65 feet  
Water levels during: 15 min: 5 feet, 30 min: 5 feet, 45 min: 5 feet, 60 min: 5 feet  
Pump intake set at: 65 feet  
Recommended pump setting: 65 feet  
Recommended pump rate: 23 GPM

**LOCATION OF WELL**

In diagram below show distances of well from road and lot line. Indicate north by arrow.

248146

**FINAL STATUS OF WELL**

Water supply  
 Abandoned, insufficient supply  
 Abandoned, poor quality  
 Abandoned (Other)  
 Dewatering

**WATER USE**

Domestic  
 Commercial  
 Municipal  
 Public supply  
 Cooling & air conditioning

**METHOD OF CONSTRUCTION**

Air percussion  
 Boring  
 Diamond  
 Jetting

Name of Well Contractor: Arkoeh Drilling Ltd  
Well Contractor's Licence No.: 1119  
Address: RR#1 Richmond, Ont  
Name of Well Technician: Shannon Powell  
Well Technician's Licence No.: T2122  
Signature of Technician/Contractor: [Signature]  
Submission date: 27 09 02

**MINISTRY USE ONLY**

Data source: 1119  
Date received: OCT 10 2002  
Date of inspection: \_\_\_\_\_  
Inspector: \_\_\_\_\_  
Remarks: CSS.ES2

**Instructions for Completing Form**

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

First Name <b>Patterson Homes</b>		Last Name		Mailing Address (Street Number/Name, RR, Lot, Concession) <b>R.R. #2</b>			
County/District/Municipality <b>Lanark</b>		Township/City/Town/Village <b>Ashton</b>		Province <b>Ontario</b>	Postal Code <b>K0A 1B0</b>	Telephone Number (include area code) <b>613 229 5889</b>	
Address of Well Location (County/District/Municipality) <b>Ottawa Carleton</b>				Township <b>Gloucester</b>		Lot <b>29/30</b>	Concession <b>4</b>
RR#/Street Number/Name <b>Lot 40 Emerald Creek</b>				City/Town/Village <b>Manotick</b>		Site/Compartment/Block/Tract etc.	
GPS Reading	NAD	Zone	Easting	Northing	Unit Make/Model <b>Garmin</b>	Mode of Operation: <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify	
	<b>83</b>	<b>18</b>	<b>453104</b>	<b>5013591</b>			

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
<b>brown</b>	<b>sandy soil</b>	<b>stones</b>	<b>fill</b>	<b>0</b>	<b>1.21</b>
<b>brown</b>	<b>sand</b>		<b>dry</b>	<b>1.21</b>	<b>3.04</b>
<b>gray</b>	<b>sand</b>		<b>wet</b>	<b>3.04</b>	<b>4.26</b>
<b>gray</b>	<b>clay</b>		<b>packed</b>	<b>4.26</b>	<b>10.05</b>
<b>gray</b>	<b>sand &amp; gravel</b>		<b>packed</b>	<b>10.05</b>	<b>14.62</b>
<b>gray &amp; white sandstone</b>			<b>very hard</b>	<b>14.62</b>	<b>52.72</b>

Hole Diameter		
Depth From	Metres To	Diameter Centimetres
<b>0</b>	<b>16.45</b>	<b>22.75</b>
<b>16.45</b>	<b>52.72</b>	<b>15.23</b>


Construction Record				
Inside diam centimetres	Material	Wall thickness centimetres	Depth Metres	
			From	To
<b>Casing</b>				
<b>15.86</b>	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	<b>0.48</b>	<b>+ .45</b>	<b>16.45</b>
<b>Screen</b>				
Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	Slot No.		
<b>No Casing or Screen</b>				
<b>15.23</b>	<input checked="" type="checkbox"/> Open hole		<b>16.54</b>	<b>52.72</b>

Test of Well Yield				
Pumping test method	Draw Down		Recovery	
	Time min	Water Level Metres	Time min	Water Level Metres
<b>submersible</b>				
Pump intake set at - (metres)	<b>30.47</b>	Static Level	<b>5.00</b>	
Pumping rate - (litres/min)	<b>1</b>	<b>5.68</b>	<b>1</b>	<b>5.60</b>
Duration of pumping	<b>2</b>	<b>5.83</b>	<b>2</b>	<b>5.62</b>
Final water level end of pumping	<b>3</b>	<b>5.89</b>	<b>3</b>	<b>5.62</b>
Recommended pump type	<b>4</b>	<b>5.93</b>	<b>4</b>	<b>5.59</b>
Recommended pump depth	<b>5</b>	<b>5.96</b>	<b>5</b>	<b>5.56</b>
Recommended pump rate	<b>10</b>	<b>6.06</b>	<b>10</b>	<b>5.46</b>
	<b>15</b>	<b>6.13</b>	<b>15</b>	<b>5.37</b>
	<b>20</b>	<b>6.19</b>	<b>20</b>	<b>5.35</b>
	<b>25</b>	<b>6.23</b>	<b>25</b>	<b>5.33</b>
	<b>30</b>	<b>6.27</b>	<b>30</b>	<b>5.31</b>
	<b>40</b>	<b>6.32</b>	<b>40</b>	<b>5.30</b>
	<b>50</b>	<b>6.36</b>	<b>50</b>	<b>5.30</b>
	<b>60</b>	<b>6.38</b>	<b>60</b>	<b>5.30</b>

Plugging and Sealing Record			<input checked="" type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)	
<b>16.45</b>	<b>0</b>	<b>Grouted Bentonite Slurry</b>	<b>.964m3</b>	

<b>Method of Construction</b>			
<input type="checkbox"/> Cable Tool	<input checked="" type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	
<b>Water Use</b>			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	
<b>Final Status of Well</b>			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

<b>Well Contractor/Technician Information</b>	
Name of Well Contractor <b>Capital Water Supply Ltd.</b>	Well Contractor's Licence No. <b>1558</b>
Business Address (street name, number, city etc.) <b>Box 490 Stittsville, Ontario K2S 1A6</b>	
Name of Well Technician (last name, first name) <b>Miller, Stephen</b>	Well Technician's Licence No. <b>T0097</b>
Signature of Technician/Contractor <i>[Signature]</i>	Date Submitted <b>2005 12 06</b>

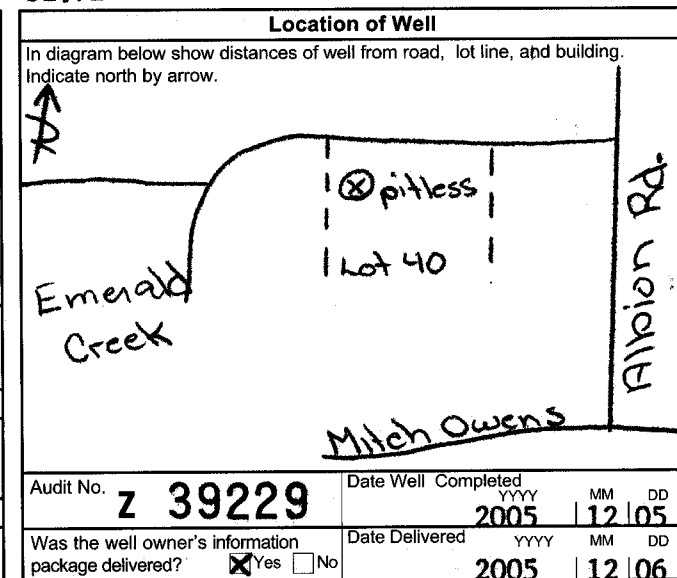

<b>Ministry Use Only</b>	
Data Source	Contractor <b>1558</b>
Date Received <b>JAN 13 2006</b>	Date of Inspection YYYY MM DD
Remarks	Well Record Number

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Ministry Use Only**

Address of Well Location (County/District/Municipality) **Gloucester** Township **Rideau Front** Lot **1129430** Concession **3**  
 RR#/Street Number/Name **#528 Tullamore** City/Town/Village **Gloucester** Site/Compartment/Block/Tract/etc. **Plan 4A-1275-123**  
 GPS Reading NAD **83** Zone **18** Easting **452890** Northing **5013460** Unit Make/Model **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify \_\_\_\_\_

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth	
				From	To
	<b>Sand + Gravel</b>			<b>0</b>	<b>11.58</b>
	<b>limestone</b>			<b>11.58</b>	<b>27.4</b>

**Hole Diameter**

Depth	Metres	Diameter
From	To	Centimetres
<b>0</b>	<b>27.43</b>	<b>15.23</b>

**Construction Record**


Inside diam centimetres	Material	Wall thickness centimetres	Depth	
			From	To
<b>Casing</b>				
<b>15.88</b>	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	<b>48</b>	<b>0</b>	<b>15.85</b>
<b>Screen</b>				
Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	Slot No.		
<b>No Casing or Screen</b>				
		<input checked="" type="checkbox"/> Open hole	<b>15.24</b>	<b>27.43</b>

**Test of Well Yield**

Pumping test method	Draw Down		Recovery	
	Time min	Water Level Metres	Time min	Water Level Metres
<b>Sub Pump</b>				
Pump intake set at (metres)	<b>01.33</b>	Static Level <b>Flow</b>		<b>0.22</b>
Pumping rate (litres/min)	<b>1</b>	<b>0.18</b>	<b>1</b>	<b>Flow</b>
Duration of pumping	<b>6</b>	<b>0.18</b>	<b>2</b>	
Final water level end of pumping	<b>0.22</b>	<b>0.18</b>	<b>3</b>	
Recommended pump type	<b>4</b>	<b>0.19</b>	<b>4</b>	
Recommended pump depth	<b>21.33</b>	<b>0.19</b>	<b>5</b>	
Recommended pump rate (litres/min)	<b>10</b>	<b>0.20</b>	<b>10</b>	
If flowing give rate - (litres/min)	<b>15</b>	<b>0.20</b>	<b>15</b>	
	<b>20</b>	<b>0.21</b>	<b>20</b>	
	<b>25</b>	<b>0.21</b>	<b>25</b>	
	<b>30</b>	<b>0.21</b>	<b>30</b>	
	<b>40</b>	<b>0.22</b>	<b>40</b>	
	<b>50</b>	<b>0.22</b>	<b>50</b>	
	<b>60</b>	<b>0.22</b>	<b>60</b>	

**Plugging and Sealing Record**

Depth set at - Metres	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
From	To	
<b>15.24</b>	<b>Neat Cement Slurry</b>	<b>0.1816</b>
<b>12.19</b>	<b>Bentonite Slurry</b>	<b>0.490</b>

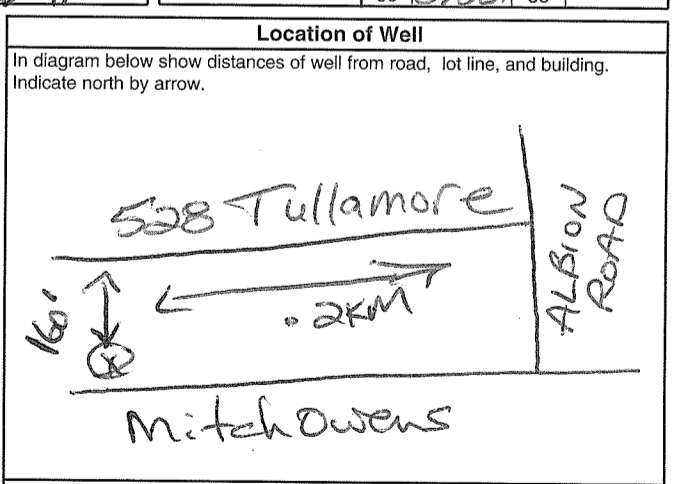

**Method of Construction**

<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	

**Water Use**

<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	

**Final Status of Well**

<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

**Well Contractor/Technician Information**

Name of Well Contractor **AR ROCK DRILLING LTD** Well Contractor's Licence No. **1119**  
 Business Address (street name, number, city etc.) **RR#1 Richmond Ont K0A 2Z0**  
 Name of Well Technician (last name, first name) **MURCELL SHANNON** Well Technician's Licence No. **T2122**  
 Signature of Technician/Contractor *[Signature]* Date Submitted **2007 05 30**

Audit No. **Z 55580** Date Well Completed **2006 12 06**  
 Was the well owner's information package delivered?  Yes  No Date Delivered **2006 12 07**

**Ministry Use Only**

Data Source \_\_\_\_\_ Contractor **1119**  
 Date Received **APR 11 2007** Date of Inspection \_\_\_\_\_  
 Remarks \_\_\_\_\_ Well Record Number \_\_\_\_\_

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

**Ministry Use Only**

MUN	CON	LOT
-----	-----	-----

First Name: **DR SHAQIR** Last Name: **ESSA** Mailing Address (Street Number/Name, RR, Lot, Concession): **406546251 Canada Inc Gainsborough**  
 County/District/Municipality: **Ottawa** Province: **Ontario** Postal Code: **K2A 2Y7** Telephone Number (include area code):  
 Address of Well Location (County/District/Municipality): **Gloucester** Township: **Rideau Front** Lot: **1129430** Concession: **3**  
 RR#/Street Number/Name: **#512 Tullamore** City/Town/Village: **Gloucester** Site/Compartment/Block/Tract etc.: **14M-1275/L19**  
 GPS Reading: NAD: **83** Zone: **18** Easting: **452755** Northing: **5013393** Unit Make/Model: **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sand, Gravel, Boulders			0	13.11
	Gray Limestone			13.11	26.52
	White Sandstone			26.52	53.95

**Hole Diameter**

Depth From	Metres To	Diameter Centimetres
0	53.95	14.91

**Water Record**

Water found at: **51.36** Metres Kind of Water: **TESTED**

Fresh  Sulphur  Gas  Salty  Minerals  Other:

After test of well yield, water was **clear and sediment free**

Chlorinated:  Yes  No

**Construction Record**

Inside diam centimetres	Material	Wall thickness centimetres	Depth Metres	
			From	To
15.88	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	48	0	15.85

**Casing**

Steel  Fibreglass  Plastic  Concrete  Galvanized

**Screen**

Outside diam:  Steel  Fibreglass  Plastic  Concrete  Galvanized Slot No.:

**No Casing or Screen**

Open hole

**Test of Well Yield**

Pumping test method	Draw Down		Recovery	
	Time min	Water Level Metres	Time min	Water Level Metres
Subsidence				
Pump intake set at (metres)	Static Level	3.70		14.70
Pumping rate (litres/min)	1	6.81	1	10.00
Duration of pumping (hrs min)	2	8.10	2	9.4
Final water level end of pumping (metres)	3	8.97	3	8.38
Recommended pump type	4	9.62	4	7.80
Recommended pump depth (metres)	5	10.19	5	7.40
Recommended pump rate (litres/min)	10	11.92	10	5.90
	15	12.75	15	5.30
If flowing give rate (litres/min)	20	13.31	20	5.2
	25	13.69	25	5.8
If pumping discontinued, give reason.	30	13.87	30	4.65
	40	14.22	40	4.33
	50	14.53	50	4.23
	60	14.70	60	4.00

**Plugging and Sealing Record**  Annular space  Abandonment

Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
15.21	12.19	neat cement slurry	0.227
12.19	0	bentonite slurry	0.613

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

Audit No. **Z 65062** Date Well Completed **2007 04 27**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 04 27**

**Well Contractor/Technician Information**

Name of Well Contractor: **HR ROCK DRILLING LTD** Well Contractor's Licence No.: **1119**  
 Business Address (street name, number, city etc.): **RR#1 RICHMOND ONT K0A2Z0**  
 Name of Well Technician (last name, first name): **PURCELL STANNON** Well Technician's Licence No.: **12122**  
 Signature of Technician/Contractor: **[Signature]** Date Submitted **2007 08 01**

**Ministry Use Only**

Data Source: Contractor **1119**

Date Received **AUG 29 2007** Date of Inspection **2007 04 27**

Remarks: Well Record Number

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

Ministry Use Only

Address of Well Location (County/District/Municipality) <b>Gloucester</b>		Township <b>Rideau Front</b>	Lot <b>Plan 30</b>	Concession <b>3</b>
RR#/Street Number/Name <b>#607 Ballycastle</b>		City/Town/Village <b>Gloucester</b>	Site/Compartment/Block/Tract, etc. <b>Plan 4M-1215 3/L38</b>	
GPS Reading <b>8.3</b>	NAD <b>18</b>	Zone <b>453193</b>	Easting <b>5013539</b>	Northing <b>Magellan</b>

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sand, Boulder			0	1.22
	Sand			1.22	6.10
	Clay			6.10	15.85
	Grey limestone			15.85	32.92
	White Sandstone			32.92	36.57

Hole Diameter			Construction Record				Test of Well Yield					
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down Time min	Water Level Metres	Recovery Time min	Water Level Metres
0	36.57	14.91	15.88	Steel	4.80	18.90	36.57	Subpump	4.73	34.32	34.32	34.32
<b>Water Record</b>			<b>Casing</b>				<b>Test of Well Yield</b>					
Water found at <b>32.93</b> m Kind of Water <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other: <b>TESTED</b>			<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized				Pump intake set at <b>32</b> metres Pumping rate (litres/min) <b>56.78</b> Duration of pumping <b>1</b> hrs + <b>0</b> min Final water level end of pumping <b>34.32</b> metres Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep Recommended pump depth <b>32.92</b> metres Recommended pump rate <b>56.78</b> (litres/min) If flowing give rate - (litres/min) If pumping discontinued, give reason.					
After test of well yield, water was <b>clear and sediment free</b> <input type="checkbox"/> Other specify: <b>TESTED</b>			<b>Screen</b>				20 <b>28.60</b> 20 <b>3.09</b> 25 <b>32.74</b> 25 <b>6.60</b> 30 <b>34.32</b> 30 <b>5.60</b> 40 <b>34.33</b> 40 <b>4.92</b> 50 <b>34.32</b> 50 <b>4.15</b> 60 <b>34.32</b> 60					
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No			<b>No Casing or Screen</b>									
			<input checked="" type="checkbox"/> Open hole									

Plugging and Sealing Record			Location of Well	
Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
18.70	15.85	Neat Cement Slurry		
15.85	0	Bentonite Slurry		
<b>Method of Construction</b>			<b>Audit No.</b> <b>Z 65079</b>	
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (air) <input type="checkbox"/> Diamond <input type="checkbox"/> Digging <input type="checkbox"/> Rotary (conventional) <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Jetting <input type="checkbox"/> Other <input type="checkbox"/> Rotary (reverse) <input type="checkbox"/> Boring <input type="checkbox"/> Driving			Date Well Completed <b>2007 05 15</b>	
<b>Water Use</b>			Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
<input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Industrial <input type="checkbox"/> Public Supply <input type="checkbox"/> Other <input type="checkbox"/> Stock <input type="checkbox"/> Commercial <input type="checkbox"/> Not used <input type="checkbox"/> Irrigation <input type="checkbox"/> Municipal <input type="checkbox"/> Cooling & air conditioning			Date Delivered <b>2007 05 16</b>	
<b>Final Status of Well</b>			<b>Ministry Use Only</b>	
<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Recharge well <input type="checkbox"/> Unfinished <input type="checkbox"/> Abandoned, (Other) <input type="checkbox"/> Observation well <input type="checkbox"/> Abandoned, insufficient supply <input type="checkbox"/> Dewatering <input type="checkbox"/> Test Hole <input type="checkbox"/> Abandoned, poor quality <input type="checkbox"/> Replacement well			Data Source Contractor <b>1119</b>	
<b>Well Contractor/Technician Information</b>			Date Received <b>AUG 29 2007</b>	
Name of Well Contractor <b>AK ROCK DRILLING CO LTD 1119</b>			Date of Inspection	
Business Address (street name, number, city etc.) <b>Rte 1 Richmond Ave Korozo</b>			Remarks	
Name of Well Technician (last name, first name) <b>Desautels Ken</b>			Well Record Number	
Signature of Technician/Contractor <b>[Signature]</b>			Date Submitted <b>2007 08 21</b>	

Name of Well Contractor <b>AK ROCK DRILLING CO LTD 1119</b>		Well Contractor's Licence No. <b>1119</b>	
Business Address (street name, number, city etc.) <b>Rte 1 Richmond Ave Korozo</b>		Date Received <b>AUG 29 2007</b>	
Name of Well Technician (last name, first name) <b>Desautels Ken</b>		Date of Inspection	
Signature of Technician/Contractor <b>[Signature]</b>		Remarks	
Date Submitted <b>2007 08 21</b>		Well Record Number	



**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

**Ministry Use Only**

MUN \_\_\_\_\_ CON \_\_\_\_\_ LOT \_\_\_\_\_

First Name: **Vince Repaci** Last Name: **Repaci** Mailing Address (Street Number/Name, RR, Lot, Concession): **90 B. Wilson 625 Gainsborough Ave**  
 County/District/Municipality: \_\_\_\_\_ Township/City/Town/Village: **Ottawa** Province: **Ontario** Postal Code: **K2A2Y7** Telephone Number (include area code): \_\_\_\_\_  
 Address of Well Location (County/District/Municipality): **Gloucester** Township: **Rideau Front** Lot: **P122230** Concession: **3**  
 RR#/Street Number/Name: **#524 Tullamore** City/Town/Village: **Gloucester** Site/Compartment/Block/Tract etc.: **16M4M-1275 S/L22**  
 GPS Reading: NAD: **83** Zone: **18** Easting: **452886** Northing: **501337** Unit/Make/Model: **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify \_\_\_\_\_

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sand Gravel			0	3.35
	Blue Clay			3.35	11.58
	Gravel			11.58	13.11
	Grey Limestone			13.11	27.43
	Grey Limestone + Grey Sandstone Mix			27.43	48.77

**Hole Diameter**

Depth From	Metres To	Diameter Centimetres
0	48.77	15.55

**Water Record**

Water found at \_\_\_\_\_ metres Kind of Water

Fresh  Sulphur  Gas  Salty  Minerals  Other: \_\_\_\_\_

Fresh  Sulphur  Gas  Salty  Minerals  Other: \_\_\_\_\_

Fresh  Sulphur  Gas  Salty  Minerals  Other: \_\_\_\_\_

After test of well yield, water was  clear and sediment free  Other: specify \_\_\_\_\_

Chlorinated  Yes  No

**Construction Record**

Inside diam centimetres	Material	Wall thickness centimetres	Depth Metres	
			From	To
15.88	Steel <input checked="" type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized <input type="checkbox"/>	.48	0	16.76

**Casing**

Steel  Fibreglass  Plastic  Concrete  Galvanized

**Screen**

Outside diam	Material	Slot No.
16.15	Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized <input type="checkbox"/>	

**No Casing or Screen**

Open hole  \_\_\_\_\_

16.15 48.77

**Test of Well Yield**

Pumping test method	Draw Down		Recovery	
	Time min	Water Level Metres	Time min	Water Level Metres
Sub pump	5.30	20.89	20.89	20.89
Pump intake set at (metres) 45.12	Static Level	5.30		
Pumping rate (litres/min) 91	1	6.73	1	20.42
Duration of pumping hrs + 0 min	2	8.10	2	17.58
Final water level end of pumping 20.89 metres	3	9.62	3	15.94
Recommended pump type _____	4	11.00	4	13.06
Recommended pump depth 30.48 metres	5	11.75	5	12.56
Recommended pump rate 91 (litres/min)	10	15.80	10	7.99
If flowing give rate - (litres/min)	15	18.10	15	6.20
	20	20.00	20	5.22
	25	21.05	25	
	30	22.40	30	
	40	21.06	40	
	50	20.91	50	
	60	20.89	60	

**Plugging and Sealing Record**

Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
16.5	11	Neat Cement Slurry	0.227
13.11	0	Bentonite Slurry	0.858

Annular space  Abandonment

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  Rotary (conventional)  Air percussion  Jetting  Other  Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  Stock  Commercial  Not used  Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  Observation well  Abandoned, insufficient supply  Dewatering  Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

#524 Tullamore

160' (distance from road)

0.1 KM (distance from road)

Albion Road

Audit No. **Z 65187** Date Well Completed **2007 06 11**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 10 13**

**Well Contractor/Technician Information**

Name of Well Contractor: **AIR ROCK DRILLING LTD** Well Contractor's Licence No.: **1119**  
 Business Address (street name, number, city etc.): **241 RICHMOND ST K2A2Z0**  
 Name of Well Technician (last name, first name): **Jessamine's son** Well Technician's Licence No.: **14**  
 Signature of Technician/Contractor: \_\_\_\_\_ Date Submitted: **2007-09-08**

**Ministry Use Only**

Data Source \_\_\_\_\_ Contractor **1119**

Date Received **SEP 17 2007** DD Date of Inspection \_\_\_\_\_ YYYY MM DD

Remarks \_\_\_\_\_ Well Record Number \_\_\_\_\_

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

**Well Owner's Information and Location of Well Information**

Ministry Use Only									
MUN									LOT

RR#/Street Number Name: **536 Tullamore** City/Town/Village: **Gloucester** Site/Compartment/Block/Tract etc.: **122930 3**

GPS Reading: **18 452989 5013478** Unit/Make/Model: **Magellan** Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sandy Clay			0	2.13
	Grey Sand & Gravel			2.13	13.72
	Grey Limestone			13.72	28.95

**Hole Diameter**

Depth From	Depth To	Metres	Diameter Centimetres
0	28.95		15.88

**Water Record**

Water found at: **27.43** m Kind of Water: **TESTED**

After test of well yield, water was **clear and sediment free**

Chlorinated:  Yes  No

**Construction Record**

Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Depth To
15.88	Steel	.48	0	17.37

**Screen**

Outside diam:  Steel  Fibreglass  Plastic  Concrete  Galvanized

Slot No.:

**No Casing or Screen**

Open hole

Depth: **16.76** to **28.95**

**Test of Well Yield**

Pumping test method	Draw Down		Recovery	
	Time min	Water Level Metres	Time min	Water Level Metres
Sub pump				
Pump intake set at (metres)	0.10		16.40	
Pumping rate (litres/min)	1	6.8	1	12.90
Duration of pumping	2	2.43	2	9.66
Final water level end of pumping (metres)	3	3.88	3	7.94
Recommended pump type	4	4.56	4	6.51
Recommended pump depth (metres)	5	5.51	5	5.45
Recommended pump rate (litres/min)	10	10.20	10	2.36
If flowing give rate (litres/min)	15	11.94	15	1.21
	20	13.40	20	0.73
	25	14.42	25	0.52
If pumping discontinued, give reason	30	14.93	30	
	40	15.68	40	
	50	16.14	50	
	60	16.40	60	

**Plugging and Sealing Record**

Depth set at - Metres From	Depth set at - Metres To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
16.76	13.72	Neat Cement Slurry	0.227
13.72	0	Bentonite Slurry	0.613

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging

Rotary (conventional)  Air percussion  Jetting  Other

Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other

Stock  Commercial  Not used

Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)

Observation well  Abandoned, insufficient supply  Dewatering

Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

Audit No. **Z 65073** Date Well Completed **2007 05 08**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 05 10**

**Well Contractor/Technician Information**

Name of Well Contractor: **HR ROCK DRILLING LTD 1119** Well Contractor's Licence No. **1119**

Business Address (street name, number, city etc.): **121 RICHMOND ONT K0A2Z0**

Name of Well Technician (last name, first name): **FURCELL SHANNAN** Well Technician's Licence No. **12122**

Signature of Technician/Contractor: *[Signature]* Date Submitted **2007 10 10**

**Ministry Use Only**

Data Source: Contractor

Date Received **OCT 12 2007** Date of Inspection **YYYY MM DD**

Remarks: Well Record Number

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

<b>Ministry Use Only</b>			
MUN	CON	LOT	
<b>Well Owner's Information and Location of Well Information</b>			
First Name <b>6546251 Corodaine</b>		Last Name	
Mailing Address (Street Number/Name, RR, Lot, Concession) <b>625 Gainsborough Ave</b>			
County/District/Municipality		Township/City/Town/Village	Province
		<b>Ottawa</b>	<b>Ontario</b>
Address of Well Location (County/District/Municipality)		Township	Lot
<b>Gloucester</b>		<b>Rideau Front</b>	<b>P/L 29 &amp; 30</b>
RR#/Street Number/Name		City/Town/Village	Site/Compartment/Block/Tract etc
<b>#504 Tullamore</b>		<b>Gloucester Plan 4M-1215</b>	<b>1/17</b>
GPS Reading	NAD	Zone	Easting
	<b>83</b>	<b>18</b>	<b>452679 5013318</b>
Unit Make/Model		Mode of Operation: <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged	
<b>Magellan</b>		<input type="checkbox"/> Differentiated, specify	

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sand, gravel			0	3.05
	blue clay			3.05	9.14
	Gravel, boulders			9.14	10.67
	grey limestone			10.67	18.29
	White Sandstone			18.29	24.38

<b>Hole Diameter</b>	<b>Construction Record</b>	<b>Test of Well Yield</b>																																																																																				
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>Depth From</th> <th>Metres To</th> <th>Diameter Centimetres</th> </tr> <tr> <td>0</td> <td>24.38</td> <td>15.23</td> </tr> </table>	Depth From	Metres To	Diameter Centimetres	0	24.38	15.23	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>Inside diam centimetres</th> <th>Material</th> <th>Wall thickness centimetres</th> <th>Depth From</th> <th>Metres To</th> </tr> <tr> <td>15.88</td> <td><input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized</td> <td>1.48</td> <td>0</td> <td>14.30</td> </tr> <tr> <td colspan="5" style="text-align: center;"><b>Screen</b></td> </tr> <tr> <td>Outside diam</td> <td><input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized</td> <td>Slot No.</td> <td colspan="2"></td> </tr> <tr> <td colspan="5" style="text-align: center;"><b>No Casing or Screen</b></td> </tr> <tr> <td colspan="2"><input checked="" type="checkbox"/> Open hole</td> <td></td> <td>13.72</td> <td>24.38</td> </tr> </table>	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	15.88	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	1.48	0	14.30	<b>Screen</b>					Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	Slot No.			<b>No Casing or Screen</b>					<input checked="" type="checkbox"/> Open hole			13.72	24.38	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>Pumping test method</th> <th>Draw Down</th> <th>Recovery</th> </tr> <tr> <td><b>Suppump</b></td> <td>Time min Water Level Metres</td> <td>Time min Water Level Metres</td> </tr> <tr> <td>Pump intake set at (metres)</td> <td>Static Level</td> <td>0.47</td> </tr> <tr> <td>Pumping rate (litres/min)</td> <td>1 0.38</td> <td>1 0.37</td> </tr> <tr> <td>Duration of pumping</td> <td>2 0.39</td> <td>2 0.35</td> </tr> <tr> <td>Final water level end of pumping (metres)</td> <td>3 0.41</td> <td>3 0.34</td> </tr> <tr> <td>Recommended pump type</td> <td>4</td> <td>4 0.33</td> </tr> <tr> <td>Recommended pump depth (metres)</td> <td>5</td> <td>5 0.32</td> </tr> <tr> <td>Recommended pump rate (litres/min)</td> <td>10 0.42</td> <td>10 0.31</td> </tr> <tr> <td>If flowing give rate (litres/min)</td> <td>15 0.43</td> <td>15 0.31</td> </tr> <tr> <td></td> <td>20 0.44</td> <td>20 0.30</td> </tr> <tr> <td></td> <td>25 0.45</td> <td>25</td> </tr> <tr> <td>If pumping discontinued, give reason.</td> <td>30 0.46</td> <td>30</td> </tr> <tr> <td></td> <td>40 0.47</td> <td>40</td> </tr> <tr> <td></td> <td>50</td> <td>50 0.29</td> </tr> <tr> <td></td> <td>60</td> <td>60 0.29</td> </tr> </table>	Pumping test method	Draw Down	Recovery	<b>Suppump</b>	Time min Water Level Metres	Time min Water Level Metres	Pump intake set at (metres)	Static Level	0.47	Pumping rate (litres/min)	1 0.38	1 0.37	Duration of pumping	2 0.39	2 0.35	Final water level end of pumping (metres)	3 0.41	3 0.34	Recommended pump type	4	4 0.33	Recommended pump depth (metres)	5	5 0.32	Recommended pump rate (litres/min)	10 0.42	10 0.31	If flowing give rate (litres/min)	15 0.43	15 0.31		20 0.44	20 0.30		25 0.45	25	If pumping discontinued, give reason.	30 0.46	30		40 0.47	40		50	50 0.29		60	60 0.29
Depth From	Metres To	Diameter Centimetres																																																																																				
0	24.38	15.23																																																																																				
Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To																																																																																		
15.88	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	1.48	0	14.30																																																																																		
<b>Screen</b>																																																																																						
Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	Slot No.																																																																																				
<b>No Casing or Screen</b>																																																																																						
<input checked="" type="checkbox"/> Open hole			13.72	24.38																																																																																		
Pumping test method	Draw Down	Recovery																																																																																				
<b>Suppump</b>	Time min Water Level Metres	Time min Water Level Metres																																																																																				
Pump intake set at (metres)	Static Level	0.47																																																																																				
Pumping rate (litres/min)	1 0.38	1 0.37																																																																																				
Duration of pumping	2 0.39	2 0.35																																																																																				
Final water level end of pumping (metres)	3 0.41	3 0.34																																																																																				
Recommended pump type	4	4 0.33																																																																																				
Recommended pump depth (metres)	5	5 0.32																																																																																				
Recommended pump rate (litres/min)	10 0.42	10 0.31																																																																																				
If flowing give rate (litres/min)	15 0.43	15 0.31																																																																																				
	20 0.44	20 0.30																																																																																				
	25 0.45	25																																																																																				
If pumping discontinued, give reason.	30 0.46	30																																																																																				
	40 0.47	40																																																																																				
	50	50 0.29																																																																																				
	60	60 0.29																																																																																				
<b>Water Record</b>																																																																																						
Water found at <b>16.70</b> metres / Kind of Water																																																																																						
<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other:																																																																																						
<b>22.23</b> metres / Kind of Water																																																																																						
<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other:																																																																																						
After test of well yield, water was <b>cloudy NOT clear and sediment free</b>																																																																																						
<input type="checkbox"/> Other, specify																																																																																						
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No																																																																																						

**Plugging and Sealing Record**  Annular space  Abandonment

Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
13.72	10.67	Neat Cement Slurry	0.2724
10.67	0	Bentonite Slurry	2.45

**Method of Construction**

Cable Tool  Rotary (air)  Diamond  Digging  
 Rotary (conventional)  Air percussion  Jetting  Other  
 Rotary (reverse)  Boring  Driving

**Water Use**

Domestic  Industrial  Public Supply  Other  
 Stock  Commercial  Not used  
 Irrigation  Municipal  Cooling & air conditioning

**Final Status of Well**

Water Supply  Recharge well  Unfinished  Abandoned, (Other)  
 Observation well  Abandoned, insufficient supply  Dewatering  
 Test Hole  Abandoned, poor quality  Replacement well

**Location of Well**

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

**#504 Tullamore**

Audit No. **Z 65103** Date Well Completed **2007 06 27**

Was the well owner's information package delivered?  Yes  No Date Delivered **2007 06 25**

**Well Contractor/Technician Information**

Name of Well Contractor **ARK ROCK DRILLING CO LTD 1119** Well Contractor's Licence No. **RR#1 RICHMOND ONT KOA 220**

Business Address (street name, number, city etc.)

Name of Well Technician (last name, first name) **Desautels Ken** Well Technician's Licence No. **14**

Signature of Technician/Contractor **x/ken** Date Submitted **2007 10 10**

**Ministry Use Only**

Data Source Contractor

Date Received **OCT 12 2007** YYYY MM DD Date of Inspection YYYY MM DD

Remarks Well Record Number

Measurements recorded in:  Metric  Imperial

Page      of     

**A066515**

Address of Well Location (Street Number/Name) **6693 Pebble Trail** City/Town/Village **Osgoode** Province **Ontario** Postal Code **4**

County/District/Municipality **OTMwa Carlton**

UTM Coordinates Zone **18** Easting **4535465013185** Northing **4M-1306** Municipal Plan and Sublot Number **S/212**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
	Sand and gravel & Boulders			0	6.10
Grey	Limestone			6.10	33.53

**Annular Space**

Depth Set at (m/ft) From	Depth Set at (m/ft) To	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
1.92	4.88	Neat Cement Slurry	0.227
4.88	0	Bentonite Slurry	0.245

**Results of Well Yield Testing**

After test of well yield, water was:  NOT TESTED

Time (min)	Draw Down (m/ft)		Recovery (m/ft)	
	Water Level	Time	Water Level	Time
Static Level	3.27		4.30	
1	3.33	1	3.40	
2	3.40	2	3.27	
3	3.43	3		
4	3.44	4		
5	3.44	5		
10	4m	10		
15	4.20	15		
20	4.2	20		
25	4.30	25		
30	4.3	30		
40	4.3	40		
50	4.3	50		
60	4.3	60		

Pump intake set at (m/ft) **24.38**

Pumping rate (l/min / GPM) **91**

Duration of pumping **1** hrs + **0** min

Final water level end of pumping (m/ft) **4.30**

Recommended pump depth (m/ft) **24.38**

Recommended pump rate (l/min / GPM) **91**

Well production (l/min / GPM) **190**

Disinfected?  Yes  No

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial

Other, specify

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
15.88	steel	48	6.10	6.10	<input checked="" type="checkbox"/> Water Supply
15.23	openhole		6.10	33.53	<input type="checkbox"/> Replacement Well

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
					<input type="checkbox"/> Test Hole

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Hole Diameter Depth (m/ft) From	Hole Diameter Diameter (cm/in) To
29.81		0	15.23

**Well Contractor and Well Technician Information**


Business Name of Well Contractor **Air Rock Drilling Co Ltd** Well Contractor's Licence No. **1119**

Business Address (Street Number/Name) **RR1** Municipality **Richmond**

Province **Ont** Postal Code **K0A2Z0** Business E-mail Address

Bus. Telephone No. (inc. area code) **613 838 2170** Name of Well Technician (Last Name, First Name) **Orsham, Ryan**

Well Technician's Licence No. **T3484** Signature of Technician and/or Contractor **[Signature]** Date Submitted **20080630**

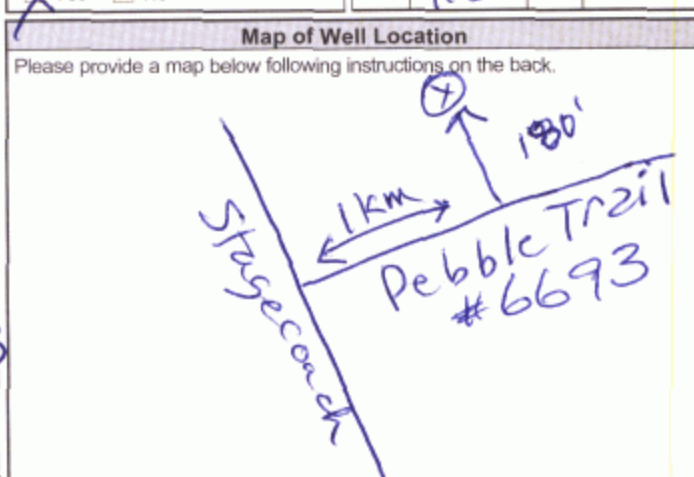

Comments: **6693 Pebble Trail**

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered <b>20080527</b>	<b>Ministry Use Only</b>
Date Work Completed <b>20080527</b>	Audit No. <b>Z 80759</b>	
		<b>JUL 15 2008</b>

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.

<b>Ministry Use Only</b>					
MUN		CON		LOT	
<b>Well Owner's Information and Location of Well Information</b>		Mailing Address (Street Number/Name, RR, Lot, Concession)			
First Name <b>654625/Canada Inc.</b>	Last Name	<b>625 Gainsborough Ave</b>			
County/District/Municipality <b>Ottawa</b>	Township/City/Town/Village	Province <b>Ontario</b>	Postal Code <b>K2A2Y7</b>	Telephone Number (include area code)	
Address of Well Location (County/District/Municipality) <b>Gloucester</b>		Township <b>Rideau Front</b>	Lot <b>P/L 29930</b>	Concession <b>3</b>	
RR#/Street Number/Name <b>#611 Ballycastle</b>		City/Town/Village <b>Gloucester</b>	Site/Compartment/Block/Tract etc. <b>Plan 4M-1275-1437</b>		
GPS Reading	NAD <b>813</b>	Zone <b>18</b>	Easting <b>453148</b>	Northing <b>5013532</b>	Unit Make/Model <b>Megalon</b>
Mode of Operation: <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify					

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sand, Gravel			0	2.44
	Blue Clay			2.44	12.19
	Clay boulders			12.19	16.76
	Grey limestone			16.76	48.77

Hole Diameter		
Depth From	Metres To	Diameter Centimetres
0	48.77	15.23
Water Record		
Water found at <b>20.56</b> metres	Kind of Water	
<input checked="" type="checkbox"/> Fresh	<input type="checkbox"/> Sulphur	
<input type="checkbox"/> Gas	<input type="checkbox"/> Salty	<input type="checkbox"/> Minerals
Other: <b>NOT TESTED</b>		
<b>41.45</b> metres	Kind of Water	
<input type="checkbox"/> Fresh	<input type="checkbox"/> Sulphur	
<input type="checkbox"/> Gas	<input type="checkbox"/> Salty	<input type="checkbox"/> Minerals
Other: <b>NOT TESTED</b>		
After test of well yield, water was <b>clear and sediment free</b>		
<input type="checkbox"/> Other, specify: <b>NOT TESTED</b>		
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		

Construction Record				
Inside diam centimetres	Material	Wall thickness centimetres	Depth Metres	
			From	To
15.88	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	.48	0	20.42
Casing				
	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized			
Screen				
Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	Slot No.		
No Casing or Screen				
	<input checked="" type="checkbox"/> Open hole		19.81	48.77

Test of Well Yield				
Pumping test method	Draw Down		Recovery	
	Time min	Water Level Metres	Time min	Water Level Metres
<b>Subpump</b>				
Pump intake set at (metres) <b>45.12</b>	Static Level	<b>5.98</b>		<b>26.06</b>
Pumping rate - (litres/min) <b>19.21</b>	1	<b>7.83</b>	1	<b>21.55</b>
Duration of pumping <b>1</b> hrs + <b>0</b> min	2	<b>9.60</b>	2	<b>19.52</b>
Final water level end of pumping <b>26.06</b> metres	3	<b>10.71</b>	3	<b>17.77</b>
Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	4	<b>11.32</b>	4	<b>15.55</b>
Recommended pump depth <b>45.12</b> metres	5	<b>12.90</b>	5	<b>13.06</b>
Recommended pump rate <b>19.21</b> (litres/min)	10	<b>15.69</b>	10	<b>8.70</b>
If flowing give rate - (litres/min)	15	<b>17.94</b>	15	<b>7.32</b>
	20	<b>19.05</b>	20	<b>6.35</b>
	25	<b>21.36</b>	25	<b>6.05</b>
If pumping discontinued, give reason.	30	<b>22.53</b>	30	<b>5.97</b>
	40	<b>23.87</b>	40	
	50	<b>24.98</b>	50	
	60	<b>26.06</b>	60	

Plugging and Sealing Record			<input checked="" type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at - Metres	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)		
From To				
19.81 16.76	Neat Cement Slurry	.2724		
16.76 0	Bentonite Slurry	.735		
Method of Construction				
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging	
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other	
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving		
Water Use				
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other	
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used		
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning		
Final Status of Well				
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)	
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering		
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well		

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No. <b>Z 65109</b>	Date Well Completed <b>2007 05 27</b>
Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered <b>2007 06 25</b>

Well Contractor/Technician Information	
Name of Well Contractor <b>AIRPACK DRILLING CO LTD</b>	Well Contractor's Licence No. <b>1119</b>
Business Address (street name, number, city etc.) <b>RR#1 RICHMOND ONT K0A2Z0</b>	
Name of Well Technician (last name, first name) <b>Desaulniers Ken</b>	Well Technician's Licence No. <b>74</b>
Signature of Technician/Contractor <i>[Signature]</i>	Date Submitted <b>2007 10 11</b>

Ministry Use Only	
Data Source	Contractor
Date Received <b>OCT 22 2007</b>	Date of Inspection
Remarks	Well Record Number

**Instructions for Completing Form**

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.**
- Please print clearly in blue or black ink only.


Well Owner's Information and Location of Well Information				Ministry Use Only			
MUN		CON		LOT			
First Name	Last Name	Mailing Address (Street Number/Name, RR, Lot, Concession)					
6546251	Canada Inc	625 Gainsborough Ave					
County/District/Municipality	Township/City/Town/Village	Province	Postal Code	Telephone Number (include area code)			
	Ottawa	Ontario	K2A2T7				
Address of Well Location (County/District/Municipality)		Township	Lot	Concession			
Gloucester		Rideau Front	1129x30	3			
RR#/Street Number/Name		City/Town/Village		Site/Compartment/Block/Tract etc.			
#603 Ballycastle		Gloucester		Plan M-1215-3/L39			
GPS Reading	NAD	Zone	Easting	Northing	Unit Make/Model	Mode of Operation:	
8.3	18	453112	503578	110200		<input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify	

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
	Sand, Gravel			0	3.05
	Blue Clay			3.05	13.72
	Gravel			13.72	14.63
	Gray Limestone			14.63	29.56
	Gray Limestone/Gray Sandstone Mix			29.56	50.59

Hole Diameter			Construction Record				Test of Well Yield					
Depth	Metres	Diameter	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down		Recovery	
From	To	Centimetres							Time min	Water Level Metres	Time min	Water Level Metres
0	50.59	15.55						Subpump	1	6.00	1	7.57
			<b>Casing</b>				Pump intake set at (metres) 15.72					
			<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized				Pumping rate - (litres/min) 71					
			15.88				Duration of pumping (hrs + min) 1 0					
			.48				Final water level end of pumping (metres) 6.37					
			0				Recommended pump type. <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep					
			18.29				Recommended pump depth (metres) 30.48					
							Recommended pump rate (litres/min) 91					
							If flowing give rate - (litres/min)					
							30 7.42					
							40 7.52					
							50 7.55					
							60 7.37					
							If pumping discontinued, give reason.					
							-					

Plugging and Sealing Record			
Depth set at - Metres	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)	<input checked="" type="checkbox"/> Annular space <input type="checkbox"/> Abandonment
From To			
17.68 14.63	Neat Cement Slurry	.227	
14.63 0	Bentonite Slurry	.858	

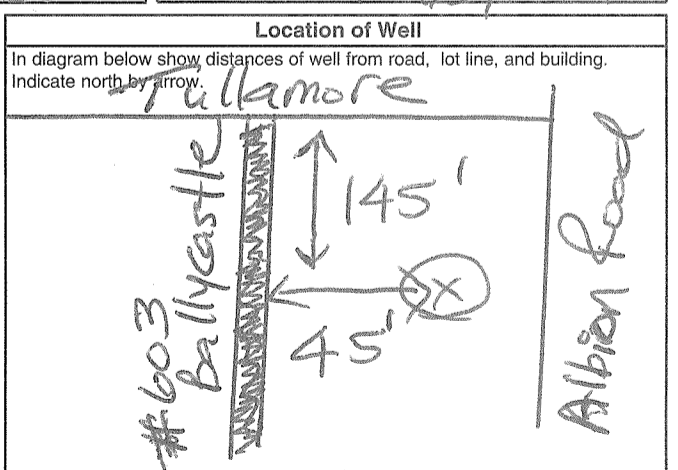

Method of Construction			
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	

Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	

Final Status of Well			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Audit No.	Z 65183	Date Well Completed	2007 10 11
Was the well owner's information package delivered?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered	2007 06 12

Well Contractor/Technician Information	
Name of Well Contractor	Well Contractor's Licence No.
AIRROCK DRILLING CO LTD	1119
Business Address (street name) number, city etc.)	
1401 RICHMOND CRT K0A2Z0	
Name of Well Technician (last name, first name)	Well Technician's Licence No.
Desaulniers Ken	19
Signature of Technician/Contractor	Date Submitted
X [Signature]	2007 10 11

Ministry Use Only	
Data Source	Contractor
Date Received	Date of Inspection
OCT 22 2007	
Remarks	Well Record Number

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**A066944**

Well Owner's Information

#516 Tullamore Rideau front 29 & 30 3  
 County/District/Municipality: **Gloucester** City/Town/Village: **Gloucester** Province: **Ontario** Postal Code: \_\_\_\_\_  
 UTM Coordinates: Zone **18** Easting **452785** Northing **5013401** Municipal Plan and Sublot Number: **PLAN 4M-1275 S/L# 20**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	<b>Sand, Gravel, Boulders</b>			<b>0</b>	<b>11.89</b>
	<b>Grey Sandstone &amp; Limestone mix</b>			<b>11.89</b>	<b>43.28</b>

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From	To	
<b>15.24</b>	<b>Neat Cement Slurry</b>	<b>.8172</b>

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **TESTED**

If pumping discontinued, give reason: ~~\_\_\_\_\_~~

Pump intake set at (m/ft): **30.48**

Pumping rate (l/min / GPM): **91**

Duration of pumping: **1 hrs + 0 min**

Final water level end of pumping (m/ft): **5.55**

If flowing give rate (l/min / GPM): ~~\_\_\_\_\_~~

Recommended pump depth (m/ft): **30.48**

Recommended pump rate (l/min / GPM): **91**

Well production (l/min / GPM): **20**

Disinfected?  Yes  No

Draw Down		Recovery	
Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
Static Level	<b>1.15cm</b>		<b>5.55</b>
1	<b>3.58</b>	1	<b>3.78</b>
2	<b>3.84</b>	2	<b>2.30</b>
3	<b>4.19</b>	3	<b>1.94</b>
4	<b>4.43</b>	4	<b>1.86</b>
5	<b>4.57</b>	5	<b>1.72</b>
10	<b>5.02</b>	10	<b>1.57</b>
15	<b>5.21</b>	15	<b>1.45</b>
20	<b>5.33</b>	20	<b>1.33</b>
25	<b>5.54</b>	25	<b>1.21</b>
30	<b>5.54</b>	30	<b>1.15</b>
40	<b>5.55</b>	40	<b>↓</b>
50	<b>5.55</b>	50	<b>↓</b>
60	<b>5.55</b>	60	<b>↓</b>

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
<b>15.88</b>	<b>steel</b>	<b>.48</b>	<b>1.6</b>	<b>15.24</b>	<input checked="" type="checkbox"/> Water Supply
<b>15.07</b>	<b>openhole</b>		<b>15.24</b>	<b>43.28</b>	<input type="checkbox"/> Replacement Well

Test Hole  Recharge Well  Dewatering Well  Observation and/or Monitoring Hole  Alteration (Construction)  Abandoned, Insufficient Supply  Abandoned, Poor Water Quality  Abandoned, other, specify \_\_\_\_\_  Other, specify \_\_\_\_\_

**Construction Record - Screen**


Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)
			From
<del>_____</del>			

**Water Details**

Water found at Depth (m/ft)	Kind of Water:	Hole Diameter
	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft) From To Diameter (cm/in)
<b>41.76</b>	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	<b>0 43.28 15.07</b>
<b>_____</b>	<input type="checkbox"/> Fresh <input type="checkbox"/> Untested	
<b>_____</b>	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **AIR ROCK DRILLING CO LTD 1119** Well Contractor's Licence No.: \_\_\_\_\_  
 Business Address (Street Number/Name): **RR#1 RICHMOND** Municipality: **RICHMOND**  
 Province: **ONT** Postal Code: **K0A2Z0** Business E-mail Address: \_\_\_\_\_  
 Bus. Telephone No. (inc. area code): **613-838-2170** Name of Well Technician (Last Name, First Name): **GRAHAM RYAN**  
 Well Technician's Licence No.: **T3484** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **2008 08 01**

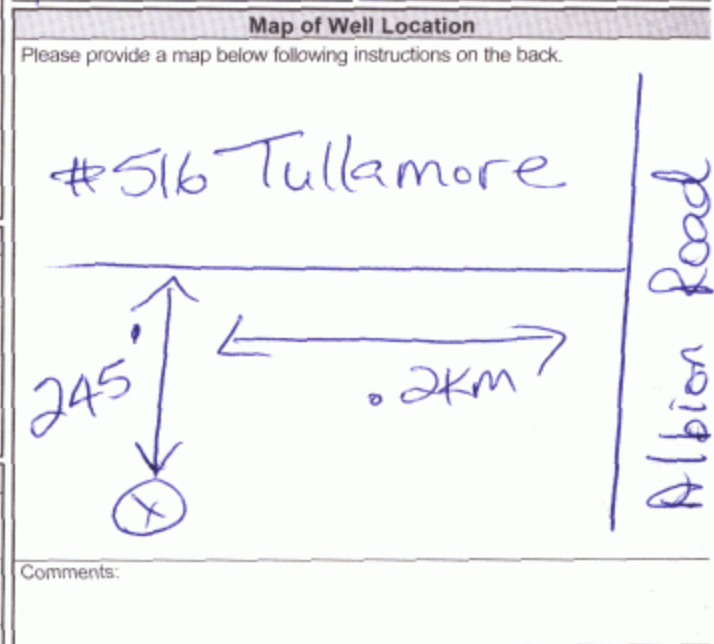

Well owner's information package delivered:  Yes  No

Date Package Delivered: **20080709**

Date Work Completed: **20080707**

**Ministry Use Only**

Audit No. **Z 80830**

**AUG 14 2008**

Received \_\_\_\_\_

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

Well A 066946  
A066946

Well Owner's Information

#520 Tullamore Rideau front #129430 3  
 County/District/Municipality: Gloucester City/Town/Village: Gloucester Province: Ontario Postal Code: \_\_\_\_\_  
 UTM Coordinates: Zone: 83 Easting: 18452842 Northing: 5013432 Municipal Plan and Sublot Number: PLAN 4M-1275- S/L# 21 Other: \_\_\_\_\_

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Grey	Sand Gravel & Boulders			0	11.58
	Limestone & Sandstone Mix			11.58	36.57

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
4.63 0	Neat Cement Slurry	.908

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify \_\_\_\_\_

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft): 33.53

Pumping rate (l/min / GPM): 45.48

Duration of pumping: 1 hrs + 0 min

Final water level end of pumping (m/ft): 29.56

If flowing give rate (l/min / GPM): \_\_\_\_\_

Recommended pump depth (m/ft): 33.53

Recommended pump rate (l/min / GPM): 45.48

Well production (l/min / GPM): 10

Disinfected?  Yes  No

Time (min)	Draw Down (m/ft)		Recovery (m/ft)	
	From	To	Time (min)	Water Level (m/ft)
Static Level	5.10			29.56
1	9.33	1		27.01
2	11.27	2		25.68
3	12.99	3		23.88
4	13.29	4		22.18
5	14.68	5		16.36
10	19.01	10		11.95
15	22.03	15		9.12
20	24.10	20		6.98
25	25.36	25		6.26
30	26.62	30		
40	28.14	40		
50	28.90	50		
60	29.56	60		

**Method of Construction**

Cable Tool  Diamond  Rotary (Conventional)  Jetting  Rotary (Reverse)  Driving  Boring  Digging  Air percussion  Other, specify \_\_\_\_\_

**Well Use**

Public  Commercial  Not used  Domestic  Municipal  Dewatering  Livestock  Test Hole  Monitoring  Irrigation  Cooling & Air Conditioning  Industrial  Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
15.88	steel	.48	7.6	14.63	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
14.91	open hole		14.63	36.57	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**


Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____
34.44	

**Hole Diameter**

Depth (m/ft)	Diameter (cm/in)
0 36.57	14.91

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: AIR ROCK DRILLING CO LTD Well Contractor's Licence No.: 1119  
 Business Address (Street Number/Name): RR1 Municipality: Richmond  
 Province: Ont Postal Code: K0A2Z0 Business E-mail Address: \_\_\_\_\_  
 Bus. Telephone No. (inc. area code): 6138382170 Name of Well Technician (Last Name, First Name): Graham, Ryan  
 Well Technician's Licence No.: 73484 Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: 20080801

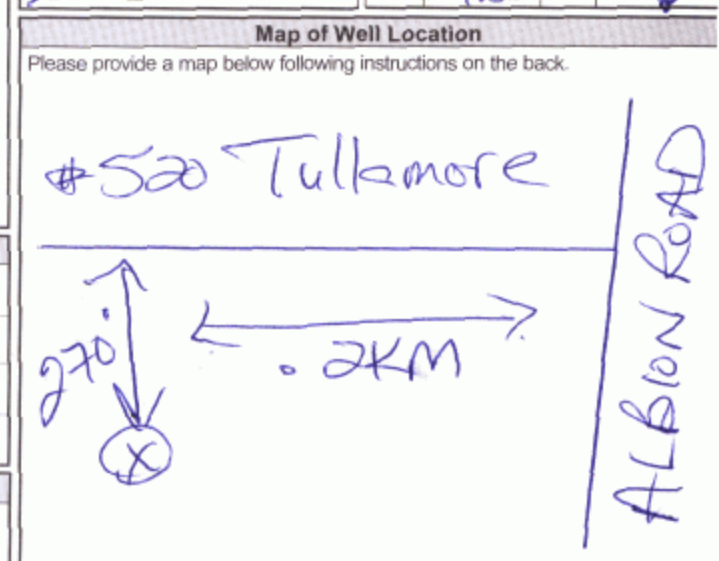

Comments: \_\_\_\_\_

Well owner's information package delivered:  Yes  No

Date Package Delivered: 20080709  
 Date Work Completed: 20080707

**Ministry Use Only**

Audit No. Z 80831  
 AUG 14 2008  
 Received: \_\_\_\_\_



Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**A066951**

Well Owner's Information

# 500 Tullamore Rideau front P/L 2003 3  
 County/District/Municipality: Gloucester City/Town/Village: Gloucester Province: Ontario  
 UTM Coordinates: Zone 8, Easting 18452642, Northing 5013329 Municipal Plan and Sublot Number: PLAN 4M-1275-3/L16

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Grey	Sand / Boulders Sandstone Limestone Mix			0	10.36
				10.36	24.38

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From	To	
13.41	Neat Cement Slurry	.7264
10.36	Bentonite Slurry	.613

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify: **NOT TESTED**

If pumping discontinued, give reason:  
~~\_\_\_\_\_~~

Pump intake set at (m/ft): **21.33**

Pumping rate (l/min / GPM): **91**

Duration of pumping: **1 hrs + 0 min**

Final water level end of pumping (m/ft): **48**

If flowing give rate (l/min / GPM): **4**

Recommended pump depth (m/ft): **21.33**

Recommended pump rate (l/min / GPM): **91**

Well production (l/min / GPM): **30**

Disinfected?  Yes  No

Time (min)	Draw Down (m/ft)		Recovery (m/ft)	
	Water Level	Time	Water Level	Time
Static Level	10cm		48cm	
1	11cm	1	10cm	
2	12cm	2	9cm	
3	13cm	3	5cm	
4	16cm	4	Flowing	
5	20cm	5		
10	32cm	10		
15	38cm	15		
20	42cm	20		
25	44cm	25		
30	45cm	30		
40	47cm	40		
50	48cm	50		
60	48cm	60		

**Method of Construction**

Cable Tool  Diamond  
 Rotary (Conventional)  Jetting  
 Rotary (Reverse)  Driving  
 Boring  Digging  
 Air percussion  
 Other, specify \_\_\_\_\_

**Well Use**

Public  Commercial  Not used  
 Domestic  Municipal  Dewatering  
 Livestock  Test Hole  Monitoring  
 Irrigation  Cooling & Air Conditioning  
 Industrial  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
15.88	steel	.48	1.6	13.41	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
15.07	open hole		13.41	24.38	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To
<del>_____</del>				

**Water Details**

Water found at Depth (m/ft)	Kind of Water:	Untested
15.85	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	<input checked="" type="checkbox"/>
22.55	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	<input checked="" type="checkbox"/>
	<input type="checkbox"/> Fresh <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	<input type="checkbox"/>

**Hole Diameter**

Depth (m/ft)	Diameter (cm/in)
From	To
0	24.38
15.07	

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **AIR ROCK DRILLING CO LTD** Well Contractor's Licence No.: **1119**  
 Business Address (Street Number/Name): **RR 1** Municipality: **Richmond**  
 Province: **Ont** Postal Code: **K0A2Z0** Business E-mail Address: \_\_\_\_\_  
 Bus. Telephone No. (inc. area code): **613 838 2170** Name of Well Technician (Last Name, First Name): **Hogan, Dan**  
 Well Technician's Licence No.: **T3058** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **2008 08 01**

**Map of Well Location**

Please provide a map below following instructions on the back.

#500 Tullamore

285' ↓

← 3km →

ALBION ROAD

Comments: \_\_\_\_\_

Well owner's information package delivered:  Yes  No

Date Package Delivered: **2008 07 09**

Date Work Completed: **2008 07 08**

**Ministry Use Only**

Audit No. **Z 80832**

**AUG 14 2008**

Received \_\_\_\_\_

Measurements recorded in:  Metric  Imperial

**A066936**

Page \_\_\_ of \_\_\_

Address of Well Location (Street Number/Name): **615 Ballycastle** Township: **Gloucester** Precinct: **P/L 29 & 30** Section: **3**  
 County/District/Municipality: **Gloucester** City/Town/Village: **Gloucester** Province: **Ontario** Postal Code: \_\_\_\_\_  
 UTM Coordinates Zone: **18** Easting: **453182** Northing: **5013472** Municipal Plan and Sublot Number: **4M-1275** Other: **S/L 36**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Grey	clay			0	10.36
	Sand			10.36	17.31
Grey	Limestone			17.31	54.86

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
20.42 0	Neat Cement Slurry	.7718

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
15.88	steel	.48	t.6	20.42	<input checked="" type="checkbox"/> Water Supply
15.55	open hole		20.42	54.86	<input type="checkbox"/> Replacement Well

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
<del>_____</del>					

**Water Details**

Water found at Depth (m/ft)	Kind of Water:	Hole Diameter
51.20	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft): 0 to 54.86; Diameter (cm/in): 15.55
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **AIR ROCK DRILLING CO LTD** Well Contractor's Licence No.: **1119**  
 Business Address (Street Number/Name): **R R 1** Municipality: **Richmond**  
 Province: **Ont** Postal Code: **K0A2Z0** Business E-mail Address: \_\_\_\_\_  
 Bus. Telephone No. (inc. area code): **613 8382110** Name of Well Technician (Last Name, First Name): **Graham, Ryan**  
 Well Technician's Licence No.: **T3484** Signature of Technician and/or Contractor: *[Signature]* Date Submitted: **20080825**

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify \_\_\_\_\_

If pumping discontinued, give reason: **NOT TESTED**

Pump intake set at (m/ft): **48.77**

Pumping rate (l/min / GPM): **91**

Duration of pumping: **1** hrs + **0** min

Final water level end of pumping (m/ft): **7.80**

If flowing give rate (l/min / GPM): \_\_\_\_\_


Recommended pump depth (m/ft): **48.77**

Recommended pump rate (l/min / GPM): **91**

Well production (l/min / GPM): **40**

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	5.78		7.80	
1	7.15	1	6.00	
2	7.32	2	5.94	
3	7.40	3	5.92	
4	7.44	4	5.91	
5	7.45	5	5.90	
10	7.50	10	5.88	
15	7.54	15	5.88	
20	7.56	20	5.88	
25	7.58	25	5.86	
30	7.60	30	5.86	
40	7.62	40	5.85	
50	7.64	50	5.84	
60	7.80	60	5.84	

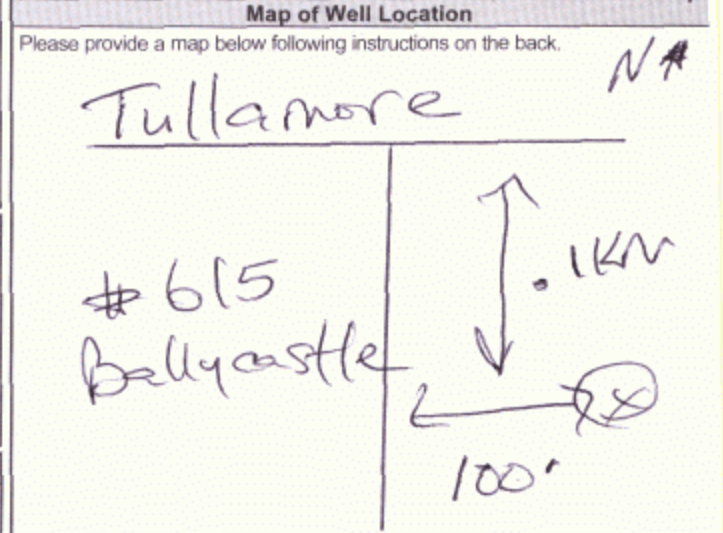

Comments: \_\_\_\_\_

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered: <b>20080818</b>	<b>Ministry Use Only</b>
Date Work Completed: <b>20080814</b>	Audit No. <b>Z 82479</b>	
Received: _____		SEP 03 2008

Measurements recorded in:  Metric  Imperial

A075978

Page \_\_\_ of \_\_\_

Address of Well Location (Street Number/Name) **#620 Ballycastle** Township **Rideau Front 9/L298 30 3** Concession **3**  
 County/District/Municipality **Gloucester** City/Town/Village **Gloucester** Province **Ontario** Postal Code \_\_\_\_\_  
 UTM Coordinates Zone Easting Northing **18 4531325013345** Municipal Plan and Sublot Number **Plan 4M-1275 S/L 31** Other \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
<b>Grey</b>	<b>Sand clay &amp; Gravel</b>			<b>0</b>	<b>10.97</b>
	<b>Sandstone</b>			<b>10.97</b>	<b>30.48</b>

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
<b>14.02 0</b>	<b>Neat Cement Slurry</b>	<b>.6356</b>

**Results of Well Yield Testing**

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	<b>2.00</b>		<b>5.35</b>	
1	<b>3.60</b>	1	<b>2.10</b>	
2	<b>4.25</b>	2	<b>2.00</b>	
3	<b>4.70</b>	3		
4	<b>4.90</b>	4		
5	<b>5.00</b>	5		
10	<b>5.30</b>	10		
15	<b>5.35</b>	15		
20	<b>5.35</b>	20		
25	<b>5.35</b>	25		
30	<b>5.35</b>	30		
40	<b>5.35</b>	40		
50	<b>5.35</b>	50		
60	<b>5.35</b>	60		

After test of well yield, water was:  
 Clear and sand free  
 **NO TESTED**  
 If pumping discontinued, give reason: **NO TESTED**  
 Pump intake set at (m/ft) **29.38**  
 Pumping rate (l/min / GPM) **90**  
 Duration of pumping **1 hrs + 0 min**  
 Final water level end of pumping (m/ft) **5.35**  
 If flowing give rate (l/min / GPM) \_\_\_\_\_  
 Recommended pump depth (m/ft) **24.38**  
 Recommended pump rate (l/min / GPM) **91**  
 Well production (l/min / GPM) **30**  
 Disinfected?  Yes  No

**Method of Construction**

<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole	<input type="checkbox"/> Monitoring
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning	
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial		
<input type="checkbox"/> Other, specify		<input type="checkbox"/> Other, specify		

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
<b>15.88</b>	<b>Steel</b>	<b>48</b>	<b>1.6</b>	<b>14.02</b>	<input checked="" type="checkbox"/> Water Supply
<b>15.07</b>	<b>open hole</b>		<b>14.02</b>	<b>30.48</b>	<input type="checkbox"/> Replacement Well

**Construction Record - Screen**


Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
					<input type="checkbox"/> Test Hole
					<input type="checkbox"/> Recharge Well
					<input type="checkbox"/> Dewatering Well
					<input type="checkbox"/> Observation and/or Monitoring Hole
					<input type="checkbox"/> Alteration (Construction)
					<input type="checkbox"/> Abandoned, Insufficient Supply
					<input type="checkbox"/> Abandoned, Poor Water Quality
					<input type="checkbox"/> Abandoned, other, specify
					<input type="checkbox"/> Other, specify

**Water Details**

Water found at Depth (m/ft)	Kind of Water:	Hole Diameter
<b>26.52</b>	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft) From To
<b>28.35</b>	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	<b>0 30.48</b>
	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Diameter (cm/in) <b>15.07</b>
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **AIR ROCK DRILLING CO LTD** Well Contractor's Licence No. **1119**  
 Business Address (Street Number/Name) **RRI** Municipality **Richmond**  
 Province **Ont** Postal Code **K0A2Z0** Business E-mail Address \_\_\_\_\_  
 Bus. Telephone No. (inc. area code) **6138352170** Name of Well Technician (Last Name, First Name) **Hagan, Dan**  
 Well Technician's Licence No. **T3058** Signature of Technician and/or Contractor **[Signature]** Date Submitted **20080825**

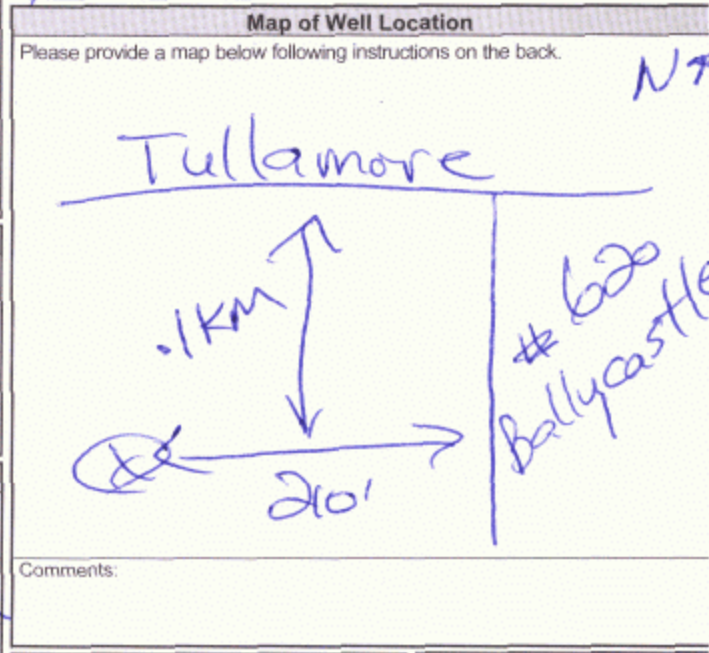

Well owner's information package delivered  Yes  No

Date Package Delivered **20080814**  
 Date Work Completed **20080808**

**Ministry Use Only**  
 Audit No. **Z 82489**  
 SEP 03 2008  
 Received \_\_\_\_\_



Measurements recorded in:  Metric  Imperial

**A076017**

Page \_\_\_ of \_\_\_

Address of Well Location (Street Number/Name) **#624 Ballycastle Rideau Front P/LA#30 3** (Township) **Gloucester** (Lot) **3** (Concession)

County/District/Municipality **Gloucester** City/Town/Village **Gloucester** Province **Ontario** Postal Code

UTM Coordinates Zone Easting Northing **18 4 53 14 9 50 133 14** Municipal Plan and Sublot Number **Plan 4M-1275 9/L32** Other

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Grey	Sand clay and Gravel Sandstone			0	10.99
				10.99	30.48

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
14.02	Neat Cement Slurry	0.6356

**Results of Well Yield Testing**

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	6.30		22.10	
1	9.60	1	16.67	
2	11.27	2	15.02	
3	12.02	3	13.42	
4	13.04	4	12.36	
5	13.92	5	11.46	
10	17.00	10	10.27	
15	18.70	15	8.46	
20	19.60	20	8.10	
25	20.25	25	6.98	
30	20.75	30	6.30	
40	21.37	40		
50	21.80	50		
60	22.10	60		

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **TESTED**

If pumping discontinued, give reason:  
~~\_\_\_\_\_~~

Pump intake set at (m/ft) **24.38**

Pumping rate (l/min / GPM) **75.82**

Duration of pumping **1** hrs + **0** min

Final water level end of pumping (m/ft) **22.10**

If flowing give rate (l/min / GPM) **18**

Recommended pump depth (m/ft) **24.38**

Recommended pump rate (l/min / GPM) **75.82**

Well production (l/min / GPM) **18**

Disinfected?  Yes  No

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial

Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
15.88	steel	.48	7.6	14.02	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
15.07	open hole		14.02	30.48	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**


Water found at Depth (m/ft)	Kind of Water:	Depth (m/ft)	Diameter (cm/in)
26.52	<input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	0	15.07
28.35	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____		

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **AIR ROCK DRILLING CO LTD** Well Contractor's Licence No. **1119**

Business Address (Street Number/Name) **R.R.1** Municipality **Richmond**

Province **Ont** Postal Code **K0A2Z0** Business E-mail Address \_\_\_\_\_

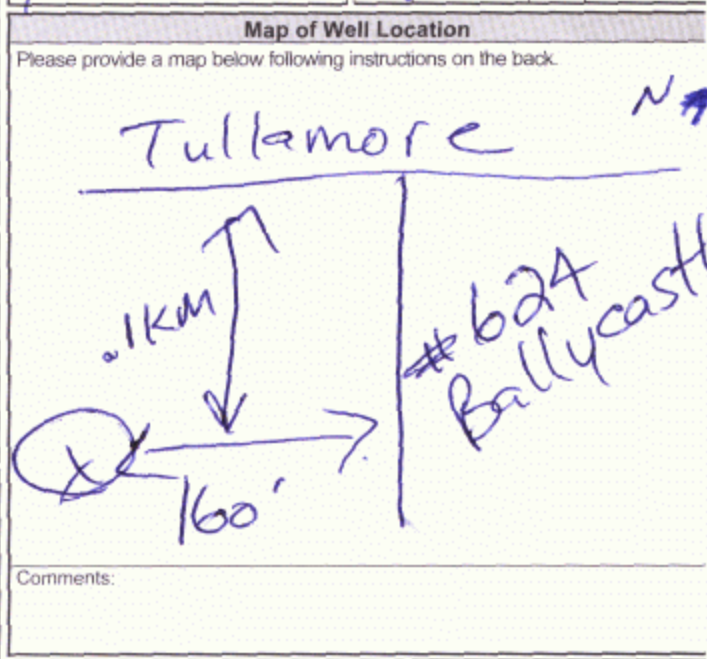

Bus. Telephone No. (inc. area code) **613 838 2170** Name of Well Technician (Last Name, First Name) **Hogan, Dan**

Well Technician's Licence No. **T3058** Signature of Technician and/or Contractor **[Signature]** Date Submitted **20080825**

Well owner's information package delivered  Yes  No

Date Package Delivered **20080816**

Date Work Completed **20080808**

**Ministry Use Only**

Audit No. **Z 82488**

SEP 03 2008

Received \_\_\_\_\_

A082456



**Well Location**

Address of Well Location (Street Number/Name) #623 Ballycastle Crescent (Gloicester) Rideau Front  
 Township (Gloicester) Concession #29030 Con3  
 County/District/Municipality Gloucester City/Town/Village Gloucester Province Ontario  
 UTM Coordinates Zone Easting 18N 453211 Subplot Number 5013392 Municipal Plan and Sublot Number PLAN 4M-1275 Other SL34

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	Grey Clay			0	26'
	Sand, Gravel & Boulders			26'	38'
	Grey limestone			38'	95'
	Grey Sandstone & limestone Mix			95'	140'

**Annular Space**

Depth Set at (m/ft) From 48' 0 To  
 Type of Sealant Used (Material and Type) Neef Cement Slurry 28'08  
 Volume Placed (m<sup>3</sup>/ft<sup>3</sup>)

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify  
 Other, specify

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
6"	Steel	.188"	12'	48'	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify
6"	Open hole		48'	140'	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
					<input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

**Water Details**

Water found at Depth 98'0 Kind of Water:  Fresh  Untested  
 Gas  Other, specify  
 Water found at Depth 132'0 Kind of Water:  Fresh  Untested  
 Gas  Other, specify  
 Water found at Depth Kind of Water:  Fresh  Untested  
 Gas  Other, specify

**Hole Diameter**

Depth (m/ft) From 0 To 140'6"  
 Diameter (cm/in) 140'6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor AIR LOCK DRILLING Co LTD 1119 Well Contractor's Licence No.  
 Business Address (Street Number/Name) R#1 Richmond Municipality  
 Province ONT Postal Code K0A2Z0 Business E-mail Address  
 Bus. Telephone No. (inc. area code) 613 8382170 Name of Well Technician (Last Name, First Name) GRANT RYAN  
 Well Technician's Licence No. T3484 Signature of Technician and/or Contractor Date Submitted 20090727


**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify TESTED

If pumping discontinued, give reason:  
 Pump intake set at (m/ft) 120  
 Pumping rate (l/min / GPM) 20  
 Duration of pumping 1 hrs + 0 min  
 Final water level end of pumping (m/ft) 87'1"  
 If flowing give rate (l/min / GPM)

Time (min)	Water Level (m/ft)	Recovery	
		Time (min)	Water Level (m/ft)
Static Level	13'4"		87'1"
1	21'	1	58'2"
2	27'5"	2	50'8"
3	32'	3	45'5"
4	35'9"	4	41'9"
5	39'1"	5	38'5"
10	50'7"	10	29'1"
15	56'9"	15	20'6"
20	63'3"	20	13'4"
25	66'9"	25	
30	70'7"	30	
40	76'	40	
50	81'5"	50	
60	87'1"	60	

Recommended pump depth (m/ft) (YHP) 120"  
 Recommended pump rate (l/min / GPM) 20  
 Well production (l/min / GPM) 20  
 Disinfected?  Yes  No

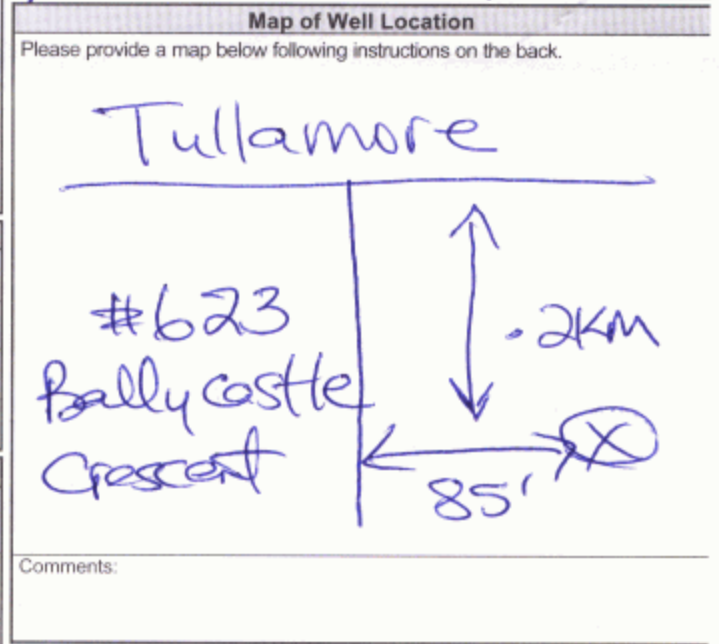

**Well owner's information package delivered**

Yes  No

Date Package Delivered 20090709  
 Date Work Completed 20090630

**Ministry Use Only**

Audit No. Z 94718  
 JUL 30 2009  
 Received

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

Well Owner's Information

[Redacted Well Owner Information]

Well Location

Address of Well Location (Street Number/Name) **#619 Ballycastle Crescent** Township **Gloucester** Lot **Plan 30** Concession **Con 3**  
 County/District/Municipality **Ottawa-Carleton** City/Town/Village **Gloucester** Province **Ontario** Postal Code \_\_\_\_\_  
 UTM Coordinates Zone **18** Easting **453201** Northing **5013422** Municipal Plan and Sublot Number **PLAN # 4M-1275** Other **SL35**

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	Gravel			0	4'
	Grey clay			4'	26'
	Sand, Gravel + boulders			26'	40'
	Grey limestone			40'	100'

Annular Space		
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
50' 0"	Neat Cement Slurry	29.64

Method of Construction		Well Use	
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial	
<input type="checkbox"/> Other, specify		<input type="checkbox"/> Other, specify	


Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify
			From	To	
6"	Steel	.188"	12'	50'	
6"	Open hole		50'	100'	

Construction Record - Screen				
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

Water Details		Hole Diameter	
Water found at Depth <b>56'</b> (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	Depth (m/ft) From <b>0</b> To <b>100'</b>	Diameter (cm/in) <b>6"</b>
Water found at Depth <b>93'</b> (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		

Well Contractor and Well Technician Information			
Business Name of Well Contractor <b>Air Rock Drilling Co Ltd</b>	Well Contractor's Licence No. <b>1119</b>	Business Address (Street Number/Name) <b>Rte 1 Richmond</b>	Municipality <b>Richmond</b>
Province <b>ONT</b>	Postal Code <b>K0A2Z0</b>	Business E-mail Address	
Bus. Telephone No. (inc. area code) <b>6138382170</b>	Name of Well Technician (Last Name, First Name) <b>GRAHAM RYAN</b>	Well Technician's Licence No. <b>T3484</b>	Signature of Technician and/or Contractor <b>[Signature]</b>
	Date Submitted <b>20090727</b>		

Results of Well Yield Testing				
After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
<input checked="" type="checkbox"/> TESTED	Static Level	<b>5'6"</b>		<b>24'7"</b>
If pumping discontinued, give reason:	1	<b>14'9"</b>	1	<b>12'4"</b>
Pump intake set at (m/ft) <b>30'</b>	2	<b>17'7"</b>	2	<b>10'0"</b>
Pumping rate (l/min / GPM) <b>20</b>	3	<b>19'3"</b>	3	<b>8'8"</b>
Duration of pumping <b>1</b> hrs + <b>0</b> min	4	<b>20'1"</b>	4	<b>8'3"</b>
Final water level end of pumping (m/ft) <b>24'7"</b>	5	<b>20'8"</b>	5	<b>8'0"</b>
If flowing give rate (l/min / GPM)	10	<b>21'6"</b>	10	<b>6'8"</b>
	15	<b>22'5"</b>	15	<b>5'9"</b>
Recommended pump depth (m/ft) <b>(24HP) 80'</b>	20	<b>23'3"</b>	20	<b>5'6"</b>
Recommended pump rate (l/min / GPM) <b>20</b>	25	<b>23'6"</b>	25	
Well production (l/min / GPM) <b>20</b>	30	<b>23'8"</b>	30	
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	40	<b>24'1"</b>	40	
	50	<b>24'4"</b>	50	
	60	<b>24'7"</b>	60	

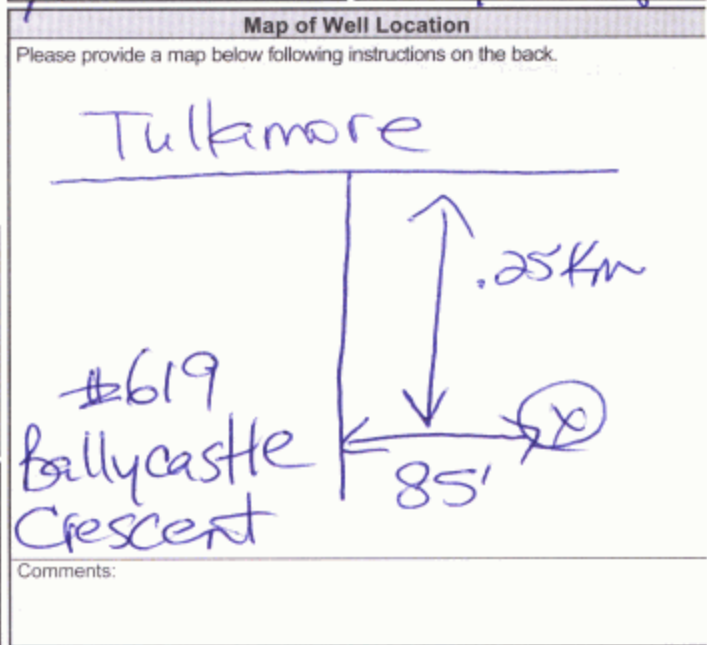

Well owner's information package delivered		Ministry Use Only	
<input checked="" type="checkbox"/> Yes	Date Package Delivered <b>20090706</b>	Audit No. <b>Z 94719</b>	
<input type="checkbox"/> No	Date Work Completed <b>20090630</b>	Received <b>JUL 30 2009</b>	



Measurements recorded in:  Metric  Imperial

Address of Well Location (Street Number/Name) **# 627 Ballycastle Rideau Front P/L 29430 Con 3** Township **Rideau Front** Lot **30** Concession **Con 3**  
 County/District/Municipality **Gloucester** City/Town/Village **Gloucester** Province **Ontario** Postal Code \_\_\_\_\_  
 UTM Coordinates Zone **18** Easting **45321050** Northing **13375** Municipal Plan and Sublot Number **PLAN 4M-1275** Other **SL 33**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	- Clay & Black Earth			0	8'
	- Clay			8'	30'
	- Sand & Boulders			30'	38'
	- Grey limestone			38'	103'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From <b>48'</b> To <b>0</b>	<b>Neat cement slurry</b>	<b>34.32</b>

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
<b>6" Steel</b>		<b>1.88"</b>	<b>2'</b>	<b>48'</b>	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
<b>6" Openhole</b>			<b>48'</b>	<b>103'</b>	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____
<b>94'</b>	

**Hole Diameter**

Depth (m/ft)	Diameter (cm/in)
From <b>0'</b> To <b>103'</b>	<b>6"</b>


**Well Contractor and Well Technician Information**

Business Name of Well Contractor **AIR ROCK DRILLING CO LTD 1119** Well Contractor's Licence No. \_\_\_\_\_  
 Business Address (Street Number/Name) **Rt #1 RICHMOND** Municipality \_\_\_\_\_  
 Province **ONT** Postal Code **K0A0Z0** Business E-mail Address \_\_\_\_\_

Bus. Telephone No. (inc. area code) **613 838 2170** Name of Well Technician (Last Name) First Name **PURCELL SHANNON**  
 Well Technician's Licence No. **T 0122** Signature of Technician and/or Contractor *[Signature]* Date Submitted **20090616**

**Results of Well Yield Testing**

After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input checked="" type="checkbox"/> Other, specify <b>TESTED</b>	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason: <del>_____</del> Pump intake set at (m/ft) <b>90'</b> Pumping rate (l/min / GPM) <b>15</b> Duration of pumping <b>1</b> hrs + <b>0</b> min Final water level end of pumping (m/ft) <b>85' 2"</b> If flowing give rate (l/min / GPM) _____ Recommended pump depth (m/ft) <b>(12HP) 90'</b> Recommended pump rate (l/min / GPM) <b>15</b> Well production (l/min / GPM) <b>15</b> Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Static Level	<b>13' 7"</b>		<b>85' 2"</b>
	1	<b>22' 3"</b>	1	<b>76' 4"</b>
	2	<b>27' 9"</b>	2	<b>72'</b>
	3	<b>32' 7"</b>	3	<b>58'</b>
	4	<b>37'</b>	4	<b>49'</b>
	5	<b>40' 7"</b>	5	<b>42'</b>
	10	<b>54'</b>	10	<b>23'</b>
	15	<b>59' 9"</b>	15	<b>13' 7"</b>
	20	<b>63'</b>	20	
	25	<b>66' 2"</b>	25	
	30	<b>69' 8"</b>	30	
	40	<b>74' 9"</b>	40	
	50	<b>79' 8"</b>	50	
	60	<b>85' 2"</b>	60	

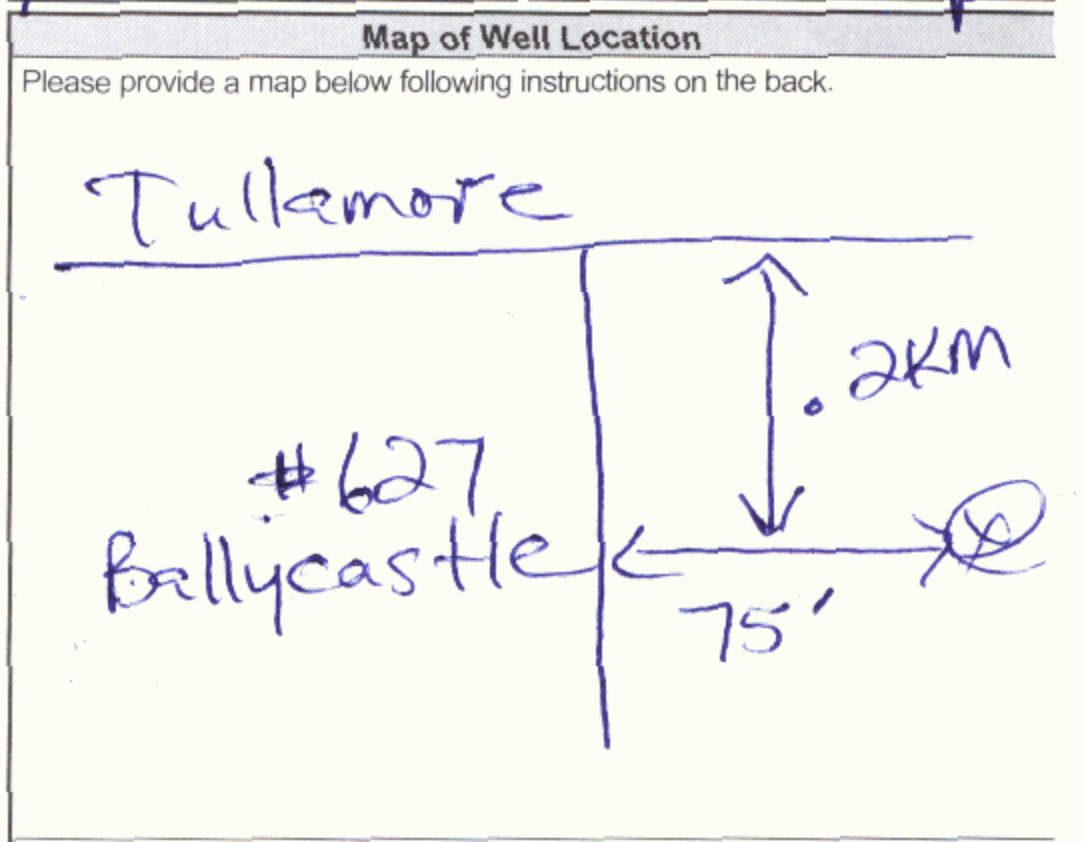

Comments:

Well owner's information package delivered  Yes  No

Date Package Delivered **20090519**  
 Date Work Completed **20090513**

**Ministry Use Only**  
 Audit No. **Z 94643**  
 Received **AUG 03 2009**



Ministry of the Environment

A 089381

Well T:

Below

Well Record

Regulation 903 Ontario Water Resources Act

Measurements recorded in:  Metric  Imperial

A 089381

Well Location

Address of Well Location (Street Number/Name) #6707 Waterside Court Osgoode Township Lot 2 Concession 3

County/District/Municipality Ottawa-Carleton City/Town/Village Greeley Province Ontario Postal Code

UTM Coordinates Zone Easting Northing NAD 83 8460502 5014110 Municipal Plan and Sublot Number PLAN 4M-1123 Other S/L13

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
From	To			From To
	Sand, Gravel + Boulders			0' 34'
	Grey limestone			34' 60'

Annular Space			
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )	
From	To		
40' 30'	Neat Cement Slurry	7.8	
30' 0'	Neat Bentonite Slurry	25.2	

Method of Construction		Well Use	
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial	
<input type="checkbox"/> Other, specify		<input type="checkbox"/> Other, specify	

Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Replacement Well
From	To				
6"	Steel	.188"	2' 40'	<input type="checkbox"/> Test Hole	<input type="checkbox"/> Recharge Well
5 7/8"	Open hole		40' 60'	<input type="checkbox"/> Dewatering Well	<input type="checkbox"/> Observation and/or Monitoring Hole

Construction Record - Screen				Status of Well
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
From	To			
				<input type="checkbox"/> Alteration (Construction)
				<input type="checkbox"/> Abandoned, Insufficient Supply
				<input type="checkbox"/> Abandoned, Poor Water Quality
				<input type="checkbox"/> Abandoned, other, specify
				<input type="checkbox"/> Other, specify

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	Depth (m/ft)	Diameter (cm/in)
From	To		
48 (m/ft)		0	40' 6"
52 (m/ft)		40'	60' 5 7/8"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: AIR LOCK DRILLING CO LTD 1119  
 Business Address (Street Number/Name): RR#1 RICHMOND  
 Province: ONT Postal Code: L4A 2Z0 Business E-mail Address:

Business Telephone No. (inc. area code): 613 838 2170 Name of Well Technician (Last Name, First Name): GRATHAM RYAN  
 Well Technician's Licence No.: T13484 Signature of Technician and/or Contractor: [Signature] Date Submitted: 2009/10/26

Results of Well Yield Testing					
After test of well yield, water was:		Draw Down		Recovery	
<input type="checkbox"/> Clear and sand free	<input checked="" type="checkbox"/> Other, specify: TESTED	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:		Static Level	6'7"		8'3"
Pump intake set at (m/ft): 50'		1	8'1"	1	6'8"
Pumping rate (l/min / GPM): 20		2	8'3"	2	6'7"
Duration of pumping: 0 hrs 0 min		3	8'3"	3	6'7"
Final water level end of pumping (m/ft): 8'3"		4		4	
If flowing give rate (l/min / GPM): 20+		5		5	
Recommended pump depth (m/ft): 50'		10		10	
Recommended pump rate (l/min / GPM): 20		15		15	
Well production (l/min / GPM): 20+		20		20	
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		25		25	
		30		30	
		40		40	
		50		50	
		60		60	

**Map of Well Location**

Please provide a map below following instructions on the back.

Comments:

Well owner's information package delivered:  Yes  No

Date Package Delivered: 2009/10/06

Date Work Completed: 2009/10/05

**Ministry Use Only**

Audit No.: Z102718

Rec: OCT 27 2009



Measurements recorded in:  Metric  Imperial

Page of

A095927

Well Location

Address of Well Location (Street Number/Name): #616 Ballycastle  
 Township: Gloucester p/h 2930 Con 3  
 County/District/Municipality: Ottawa-Carleton  
 City/Town/Village: Gloucester  
 Province: Ontario  
 Postal Code: \_\_\_\_\_  
 UTM Coordinates Zone: 18 Easting: 453145 Northing: 5013389  
 Municipal Plan and Sublot Number: PLAN 4M-1275 S/L 30  
 Other: \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	Clay, Gravel & Sand Grey limestone			0'	29' 29' 61'

**Annular Space**

Depth Set at (m/ft)		Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From	To		
40'	0'	Neat Cement Slurry	23.4

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
6"	Steel	.188"	12'	40'	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
6"	Open hole		40'	61'	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
					<input type="checkbox"/> Other, specify _____

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
47' (15')	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	0'	6"
51' (16')	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____		
54' (16')	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____		

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: AIR ROCK DRILLING CO LTD 1119  
 Business Address (Street Number/Name): RR#1 RICHMOND  
 Province: ONT Postal Code: K0A2Z0  
 Business E-mail Address: \_\_\_\_\_  
 Bus. Telephone No. (inc. area code): 613 838 2170  
 Name of Well Technician (Last Name, First Name): HOGAN DAN  
 Well Technician's Licence No.: T3058  
 Signature of Technician and/or Contractor: \_\_\_\_\_  
 Date Submitted: 20100510

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify \_\_\_\_\_

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft): 50'

Pumping rate (l/min / GPM): 20

Duration of pumping: 1 hrs + 0 min

Final water level end of pumping (m/ft): 5'

If flowing give rate (l/min / GPM): \_\_\_\_\_


Recommended pump depth (m/ft): 50'

Recommended pump rate (l/min / GPM): 20

Well production (l/min / GPM): 20

Disinfected?  Yes  No

Time (min)	Draw Down (m/ft)		Recovery (m/ft)	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	3' 7"		5'	
1	4'	1	3' 7"	
2	↓	2		
3	4' 1"	3		
4	↓	4		
5	4' 2"	5		
10	4' 3"	10		
15	4' 4"	15		
20	4' 6"	20		
25	4' 8"	25		
30	↓	30		
40	↓	40		
50	4' 9"	50		
60	5'	60		

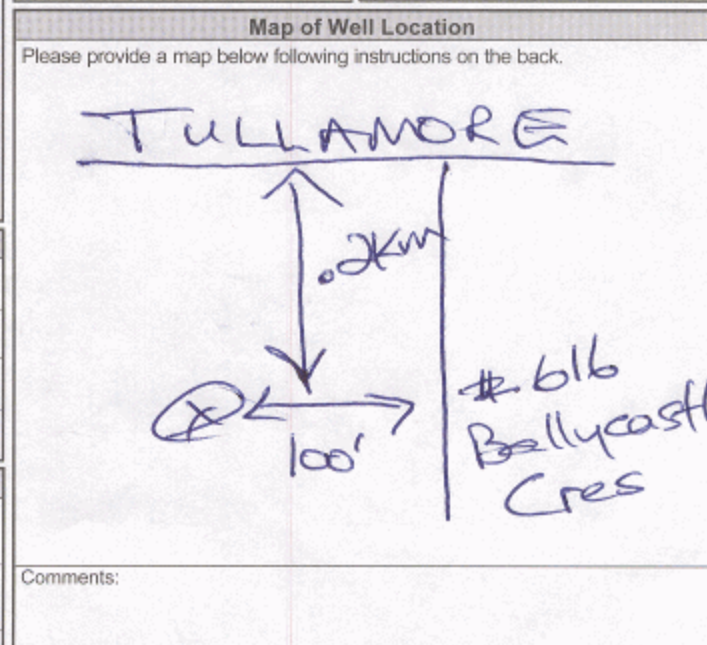

Comments: \_\_\_\_\_

Well owner's information package delivered	Date Package Delivered	Ministry Use Only
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	20100412 20100406	Audit No. Z108312 Received JUN 01 2010

A105381

Address of Well Location (Street Number/Name) #604 Ballycastle  
 Township Gloucester  
 County/District/Municipality ~~Ulster-Brabant~~ Gloucester  
 Province Ontario  
 UTM Coordinates Zone Easting Northing NAD 83 184530711503559  
 Municipal Plan and Sublot Number PLAN 4M-1275  
 Concession 30 Con 3  
 Other 3/L 27

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
From	To			From To
	Sand			0' 6'
	Grey Clay			6' 15'
	Sand & gravel			15' 47'
	Grey limestone			47' 102'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From To		
58' 0'	Red Cement Slurry	39.

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
6"	Steel	.188"	72'	58'	<input checked="" type="checkbox"/> Water Supply
5 1/16"	Open hole		58'	102'	<input type="checkbox"/> Replacement Well

**Status of Well**

Test Hole  Recharge Well  Dewatering Well  Observation and/or Monitoring Hole  Alteration (Construction)  Abandoned, Insufficient Supply  Abandoned, Poor Water Quality  Abandoned, other, specify \_\_\_\_\_  Other, specify \_\_\_\_\_

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Depth (m/ft)	Diameter (cm/in)
From	To	From	To
115'		0' 58' 6"	
		58' 102' 5 1/16"	

**Well Contractor and Well Technician Information**

Business Name of Well Contractor AIR ROCK DRILLING CO LTD 1119  
 Well Contractor's Licence No. 1119  
 Business Address (Street Number/Name) RR#1 RICHMOND  
 Municipality RICHMOND  
 Province ONT Postal Code K0A2Z0  
 Business E-mail Address

Bus. Telephone No. (inc. area code) 613 838 2170  
 Name of Well Technician (Last Name, First Name) GRAHAM RYAN  
 Well Technician's Licence No. T13484  
 Signature of Technician and/or Contractor [Signature]  
 Date Submitted 20100809

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify \_\_\_\_\_

If pumping discontinued, give reason:  NOT TESTED

Pump intake set at (m/ft) 100'

Pumping rate (l/min / GPM) 20

Duration of pumping 1 hrs + 0 min

Final water level end of pumping (m/ft) 23' 5"

If flowing give rate (l/min / GPM)


Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	17' 6"		23' 5"	
1	21' 8"	1	18' 8"	
2	22' 2"	2	18' 2"	
3	22' 4"	3	17' 8"	
4	22' 6"	4	17' 6"	
5	22' 8"	5		
10		10		
15		15		
20		20		
25		25		
30	22' 9"	30		
40	23' 1"	40		
50	23' 3"	50		
60	23' 5"	60		

Recommended pump depth (m/ft) 100'

Recommended pump rate (l/min / GPM) 20

Well production (l/min / GPM) 20+

Disinfected?  Yes  No

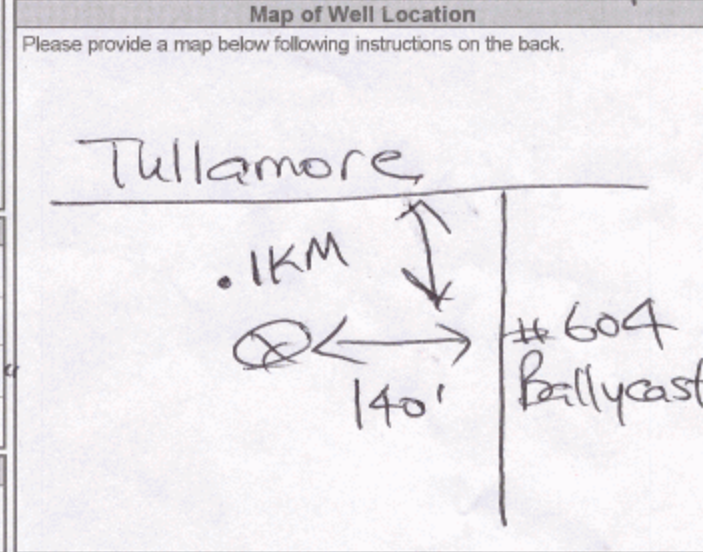

Comments:

Well owner's information package delivered  Yes  No

Date Package Delivered 20100722

Date Work Completed 20100719

**Ministry Use Only**

Audit No. z110726

Received AUG 20 2010



Measurements recorded in:  Metric  Imperial

Well Location

Address of Well Location (Street Number/Name) #532 Tullamore

Township Kidean Front Lot

City/Town/Village Gloucester P/L 294 30 3

County/District/Municipality Ottawa-Carleton

Province Ontario

Postal Code

UTM Coordinates Zone Easting Northing NAD 83 18 452933 5013479

Municipal Plan and Sublot Number PLAN # 4M-1275

Other S/L # 24

Concession

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
	Gravel Fill			0' 3'
	Grey Clay			3' 12'
	Sand Gravel + Boulders			12' 46'
	Grey limestone			46' 105'
	Grey limestone + sandstone mix			105' 160'

Annular Space

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From To		
58' 0'	Neat Cement Slurry	42.12

Results of Well Yield Testing

After test of well yield, water was:		Draw Down		Recovery	
<input type="checkbox"/> Clear and sand free	<input type="checkbox"/> Other, specify	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
<input checked="" type="checkbox"/> TESTED		Static Level	17' 2"		36' 6"
If pumping discontinued, give reason:		1	23' 6"	1	26' 1"
Pump intake set at (m/ft)		2	25' 9"	2	24' 4"
Pumping rate (l/min / GPM)		3	28'	3	23' 2"
Duration of pumping		4	29' 3"	4	22' 3"
Final water level end of pumping (m/ft)		5	30' 2"	5	21' 5"
If flowing give rate (l/min / GPM)		10	33'	10	19'
Recommended pump depth (m/ft)		15	34' 2"	15	17' 3"
Recommended pump rate (l/min / GPM)		20	34' 9"	20	17' 2"
Well production (l/min / GPM)		25	35' 4"		
Disinfected?		30	35' 7"		
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		40	36' 2"		
		50	36' 5"		
		60	36' 6"		

Method of Construction

Well Use

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial

Other, specify

Construction Record - Casing

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	Status of Well
			From To	
6"	Steel	.188"	0' 58'	<input checked="" type="checkbox"/> Water Supply
5 3/4"	Openhole		58' 160'	<input type="checkbox"/> Replacement Well

Construction Record - Screen

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	Status of Well
			From To	
				<input type="checkbox"/> Test Hole
				<input type="checkbox"/> Recharge Well
				<input type="checkbox"/> Dewatering Well
				<input type="checkbox"/> Observation and/or Monitoring Hole
				<input type="checkbox"/> Alteration (Construction)
				<input type="checkbox"/> Abandoned, Insufficient Supply
				<input type="checkbox"/> Abandoned, Poor Water Quality
				<input type="checkbox"/> Abandoned, other, specify
				<input type="checkbox"/> Other, specify

Water Details

Hole Diameter

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	From To	
85 (m/ft)	<input checked="" type="checkbox"/> Untested	0' 58' 6"	6"
135 (m/ft)	<input checked="" type="checkbox"/> Untested	58' 160'	5 3/4"
154 (m/ft)	<input type="checkbox"/> Untested		

Well Contractor and Well Technician Information

Business Name of Well Contractor AIR ROCK DRILLING CO LTD

Well Contractor's Licence No. 1119

Business Address (Street Number/Name) RR#1 RICHMOND

Province ONT Postal Code K0A2Z0

Business E-mail Address


Bus. Telephone No. (inc. area code) 613 8382170

Name of Well Technician (Last Name, First Name) GRATTAM RYAN

Well Technician's Licence No. T3484

Signature of Technician and/or Contractor

Date Submitted 20100903

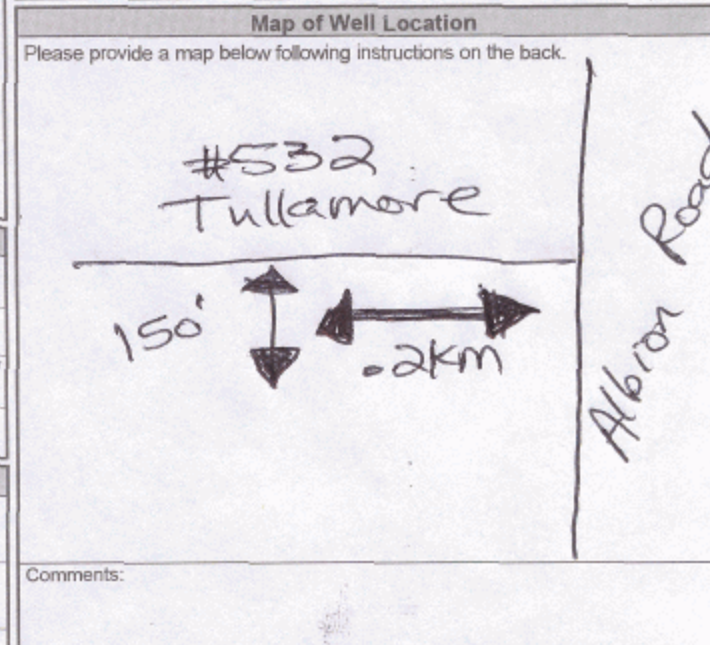

Well owner's information package delivered  Yes  No

Date Package Delivered 20100823

Date Work Completed 20100810

Ministry Use Only

Audit No. z110665

Received SEP 17 2010

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

First Name	Last Name / Organization <b>Junicon Homes</b>	E-mail Address	<input type="checkbox"/> Well Constructed by Well Owner
Mailing Address (Street Number/Name) <b>555 Winnards Perch</b>	Municipality <b>Manotick</b>	Province <b>Ontario</b>	Postal Code <b>K4M 0A1</b>
		Telephone No. (inc. area code) <b>613 692 1414</b>	

**Well Location**

Address of Well Location (Street Number/Name) <b>608 Ballycastle</b>	Township <b>Gloucester</b>	Lot <b>30</b>	Concession <b>3</b>
County/District/Municipality <b>Ottawa Carleton</b>	City/Town/Village <b>Gloucester</b>	Province <b>Ontario</b>	Postal Code
UTM Coordinates Zone Easting Northing <b>NAD 83 18 453068 5013483</b>	Municipal Plan and Sublot Number	Other	

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Soil Stones		Fill	0	1.52
Brown	Sandy Clay			1.52	3.65
Grey	Clay		Sticky	3.65	10.66
Grey	Till			10.66	17.06
Grey	Limestone			17.06	32.00
Grey & White Sandstone				32.00	67.96

Annular Space			
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)	
From To 19.20 0	Grouted Bentonite Slurry	.92m³	

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input checked="" type="checkbox"/> Rotary (Conventional) <input type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify _____	<input type="checkbox"/> Diamond <input type="checkbox"/> Jetting <input type="checkbox"/> Driving <input type="checkbox"/> Digging <input type="checkbox"/> Public <input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Livestock <input type="checkbox"/> Irrigation <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify _____

Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
			From	To	
15.86	Steel	.48	+4.5	19.20	

Construction Record - Screen				
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Depth (m/ft)	Diameter (cm/in)
64.91		From To	
		0 19.20	15.86
		19.20 67.96	15.23

Well Contractor and Well Technician Information			
Business Name of Well Contractor <b>Capital Water Supply Ltd.</b>	Well Contractor's Licence No. <b>1 5 5 8</b>		
Business Address (Street Number/Name) <b>Box 490</b>	Municipality <b>Stittsville</b>		
Province <b>Ontario</b>	Postal Code <b>K2S 1A6</b>	Business E-mail Address <b>office@capitalwater.ca</b>	
Bus. Telephone No. (inc. area code) <b>613 836 1766</b>	Name of Well Technician (Last Name, First Name) <b>Miller, Stephen</b>		
Well Technician's Licence No. <b>0 0 9 7</b>	Signature of Technician and/or Contractor		Date Submitted <b>20100921</b>

Results of Well Yield Testing				
After test of well yield, water was: <input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:  Pump intake set at (m/ft) <b>60.95</b> Pumping rate (l/min / GPM) <b>45.5</b> Duration of pumping <b>6</b> hrs + _____ min Final water level end of pumping (m/ft) <b>8.13</b> If flowing give rate (l/min / GPM)  Recommended pump depth (m/ft) <b>30.47</b> Recommended pump rate (l/min / GPM) <b>45.5</b> Well production (l/min / GPM)  Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Static Level	<b>6.85</b>		
	1	<b>7.84</b>	1	<b>7.20</b>
	2	<b>8.13</b>	2	<b>7.04</b>
	3	<b>8.42</b>	3	<b>7.03</b>
	4	<b>8.69</b>	4	<b>7.03</b>
	5	<b>8.84</b>	5	<b>7.02</b>
10	<b>9.44</b>	10	<b>7.01</b>	
15	<b>9.73</b>	15	<b>7.01</b>	
20	<b>9.92</b>	20	<b>7.00</b>	
25	<b>9.99</b>	25	<b>7.00</b>	
30	<b>10.03</b>	30	<b>7.00</b>	
40	<b>10.10</b>	40	<b>7.00</b>	
50	<b>10.14</b>	50	<b>7.00</b>	
60	<b>10.14</b>	60	<b>7.00</b>	

Map of Well Location	
Please provide a map below following instructions on the back.	
ALBION RD. <span style="float: right;">↖</span>	
TULLAMORE ST.	BALLYCASTLE CRES.  WELL AT BACK PIPLESS ADAPTOR

 Comments:

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered <b>20100921</b>	<b>Ministry Use Only</b> Audit No. <b>z115619</b> DEC 09 2010 Received
Date Work Completed <b>20100920</b>		

Measurements recorded in:  Metric  Imperial

Address of Well Location (Street Number/Name) **600 Ballycastle Crest, Gloucester** Township **Gloucester** Lot **26** Concession **3**  
 County/District/Municipality **OTTAWA-city** City/Town/Village **Gloucester** Province **Ontario** Postal Code **K1X0A2**  
 UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other  
**NAD 83 184531735013604 4M-1275**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	sand.	Boulders	soft	0	13.33
Grey	limestone.		Hard.	13.33	54.54

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From: 16.36 To: 0	Cement Grout	540 kg.

**Method of Construction**

Cable Tool  Diamond  Rotary (Conventional)  Jetting  Rotary (Reverse)  Driving  Boring  Digging  Air percussion  Other, specify

**Well Use**

Public  Commercial  Not used  Domestic  Municipal  Dewatering  Livestock  Test Hole  Monitoring  Irrigation  Cooling & Air Conditioning  Industrial  Other, specify

**Results of Well Yield Testing**

After test of well yield, water was:	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
<input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify				
If pumping discontinued, give reason:	Static Level	3.59		5.45
Pump intake set at (m/ft)	1	4.51	1	3.81
Pumping rate (l/min / GPM)	2	4.90	2	3.15
Duration of pumping	3	5.04	3	3.68
<b>33 hrs + 00 min</b>	4	5.06	4	3.60
Final water level end of pumping (m/ft)	5	5.11	5	3.59
If flowing give rate (l/min / GPM)	10	5.30	10	
	15	5.35	15	
	20	5.39	20	
Recommended pump depth (m/ft)	25	5.41	25	
Recommended pump rate (l/min / GPM)	30	5.42	30	
Well production (l/min / GPM)	40	5.44	40	
Disinfected?	50	5.45	50	
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	60	5.45	60	

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	
			From	To
15.55	Steel	0.48	2.12	16.36

**Status of Well**

Water Supply  Replacement Well  Test Hole  Recharge Well  Dewatering Well  Observation and/or Monitoring Hole  Alteration (Construction)  Abandoned, Insufficient Supply  Abandoned, Poor Water Quality  Abandoned, other, specify  Other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**

Water found at Depth (m/ft)	Kind of Water:	Depth (m/ft)	Diameter (cm/in)
46.96	<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	0	16.36
51.51	<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	16.36	54.54

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **DAR-WATER-Well-Drilling** Well Contractor's Licence No.: **6006**  
 Business Address (Street Number/Name): **1763-Route 900 west** Municipality: **NATION**  
 Province: **ON** Postal Code: **K0A3C0** Business E-mail Address:

**Map of Well Location**

Please provide a map below following instructions on the back.

Bus. Telephone No. (inc. area code): **6139875598** Name of Well Technician (Last Name, First Name): **Desnoyers Louis**  
 Well Technician's Licence No.: **TC 25** Signature of Technician and/or Contractor: **Louis Desnoyers** Date Submitted: **20110531**

Well owner's information package delivered:  Yes  No

Date Package Delivered: **20110525**  
 Date Work Completed: **20110525**

**Ministry Use Only**  
 Audit No.: **z125169**  
 Received: **JUN 28 2011**



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization, E-mail Address, Mailing Address (Street Number/Name), Municipality, Province, Postal Code, Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name), Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Zone, Easting, Northing, Municipal Plan and Sublot Number, Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used (Material and Type), Volume Placed (m³/ft³)

Method of Construction and Well Use sections with checkboxes for Cable Tool, Rotary, Boring, Air percussion, etc.


Construction Record - Casing and Status of Well sections with columns for Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, and checkboxes for Water Supply, Replacement Well, etc.

Construction Record - Screen table with columns for Outside Diameter, Material, Slot No., Depth

Water Details and Hole Diameter tables with columns for Water found at Depth, Kind of Water, Depth, Diameter

Well Contractor and Well Technician Information section with fields for Business Name, Licence No., Address, E-mail, Technician Name, Signature, Date Submitted

Results of Well Yield Testing table with columns for Draw Down, Recovery, Time, Water Level

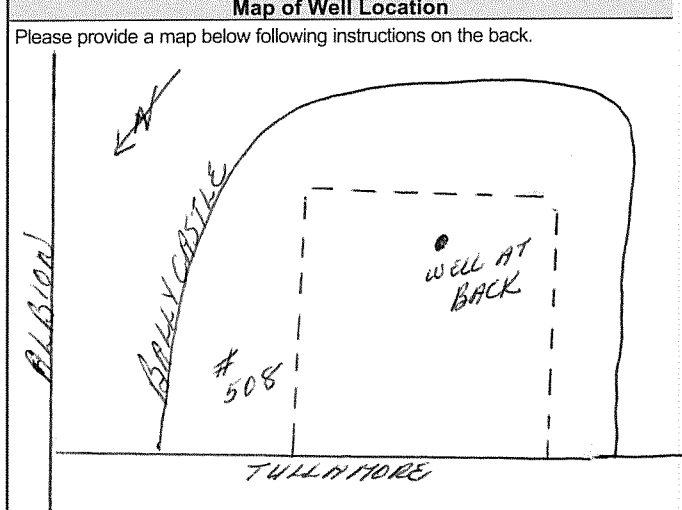

Comments, Well owner's information package delivered, Date Package Delivered, Date Work Completed, Ministry Use Only Audit No. Z139861



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (Omega Homes c/o 7184841 Canada Inc), E-mail Address, Mailing Address (4515 Ramsaville Road), Municipality (Gloucester), Province (ON), Postal Code (K1G 3N4), Telephone No.

Well Location

Address of Well Location (695 Ballycastle Crescent), Township (Rideau Front), Lot (P/L 29+30 3), Concession, County/District/Municipality (Gloucester), City/Town/Village (Gloucester), Province (Ontario), UTM Coordinates, Municipal Plan and Sublot Number (4M-1275), Other (S/L 31)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Gravel, Clay, Silty Sand, Sandstone.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used; Volume Placed (m³/ft³). Row: 54' to 0', Neat cement, 59.3.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, Diamond, Jetting, Driving, Digging, Public, Domestic, Commercial, Municipal, etc.


Construction Record - Casing and Status of Well. Includes Inside Diameter (6 1/4", 5 7/8"), Material (Steel, Open Hole), Wall Thickness (.188"), Depth (2' to 54', 54' to 170'), and Status (Water Supply, Replacement Well, etc.).

Construction Record - Screen. Includes Outside Diameter, Material, Slot No., and Depth (From, To).

Water Details and Hole Diameter. Includes Water found at Depth (91', 164', m/ft), Kind of Water (Fresh, Untested), and Hole Diameter (Depth, Diameter).

Well Contractor and Well Technician Information. Includes Business Name (Air Rock Drilling Co. Ltd.), Well Contractor's Licence No. (1119), Business Address (6859 Franktown Road, RR#1), Municipality (Richmond), Province (ON), Postal Code (K0A 2Z0), Business E-mail Address (air-rock@sympatico.ca), Name of Well Technician (Graham, Ryan), Well Technician's Licence No. (T3484), and Signature.

Results of Well Yield Testing table. Includes After test of well yield, water was (Not tested), Draw Down (Time, Water Level), Recovery (Time, Water Level), Pump intake set at (160'), Pumping rate (20), Duration of pumping (1 hrs + 0 min), Final water level end of pumping (25.5"), If flowing give rate (20), Recommended pump depth (100'), Recommended pump rate (20), Well production (20), Disinfected? (Yes).

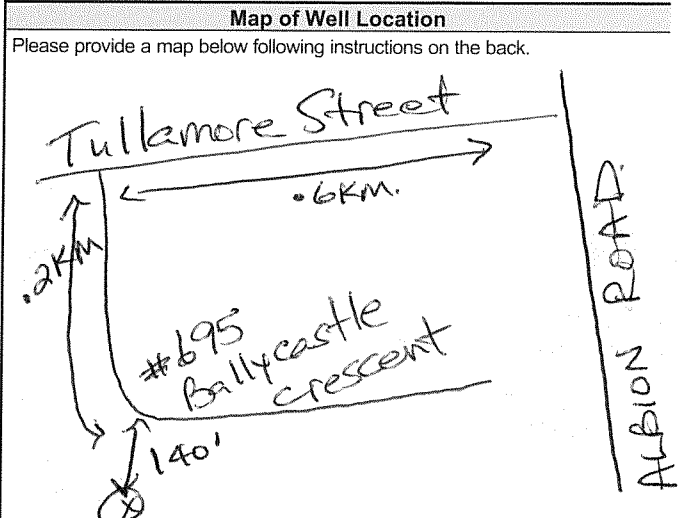

Comments: 3/4 HP - 15 GPM SET @ 100 FEET

Ministry Use Only section. Includes Well owner's information package delivered (Yes), Date Package Delivered (2013 03 19), Date Work Completed (2013 03 13), Audit No. (z 155053), and Received date (APR 15 2013).



Measurements recorded in:  Metric  Imperial

Address of Well Location (Street Number/Name) 704 Ballycastle Cr Township Gloucester Lot 3 Concession
County/District/Municipality OTTAWA - City City/Town/Village Gloucester Province Ontario Postal Code K1K0A2
UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number NAD 83 18 452771 5013242 4M-1482

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)
Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To.
Rows: Brown Sand, Grey Clay, Grey SHALE Gravel, Grey Limestone Hard.

Annular Space
Table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used (Material and Type); Volume Placed (m³/ft³).
Rows: 13.03 0 Cement Grouts 4 Bags, Bentonite 3/8 6 Bags.

Method of Construction Well Use
Cable Tool, Rotary (Conventional), Rotary (Reverse), Boring, Air percussion, Other, specify.
Diamond, Jetting, Driving, Digging.
Public, Commercial, Not used, Domestic, Municipal, Dewatering, Livestock, Test Hole, Monitoring, Irrigation, Cooling & Air Conditioning, Industrial, Other, specify.


Construction Record - Casing
Table with columns: Inside Diameter (cm/in), Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel), Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well.
Rows: 25.40 Open Hole 0 13.03, 15.55 Steel 0.48 1.51 13.03.

Construction Record - Screen
Table with columns: Outside Diameter (cm/in), Material (Plastic, Galvanized, Steel), Slot No., Depth (m/ft) From, To, Status of Well.

Water Details Hole Diameter
Water found at Depth (m/ft), Kind of Water (Fresh, Untested, Gas, Other, specify), Depth (m/ft) From, To, Diameter (cm/in).
Rows: 11.51 (m/ft) Gas, 7.87 (m/ft) Gas, 0 30.90 15.55.

Well Contractor and Well Technician Information
Business Name of Well Contractor: D&R-WATER-well-Drilling
Well Contractor's Licence No.: 6006
Business Address (Street Number/Name): 1763 - Route 900 west
Municipality: NATIOW
Province: ON Postal Code: K0A3C0
Business E-mail Address:
Name of Well Technician (Last Name, First Name): Desnoyers Louis
Signature of Technician and/or Contractor: [Signature]
Date Submitted: 2013/12/27

Results of Well Yield Testing
After test of well yield, water was:  Clear and sand free  Other, specify
If pumping discontinued, give reason:
Pump intake set at (m/ft): 28.78
Pumping rate (l/min / GPM): 45.00
Duration of pumping: 1 hrs + 00 min
Final water level end of pumping (m/ft): 20.77
If flowing give rate (l/min / GPM):
Recommended pump depth (m/ft): 28.78
Recommended pump rate (l/min / GPM): 45.00
Well production (l/min / GPM): 49.50
Disinfected?  Yes  No
Table with columns: Time (min), Water Level (m/ft), Recovery Time (min), Water Level (m/ft).
Rows: 1 7.18 1 18.60, 2 8.20 2 17.55, 3 8.92 3 16.49, 4 9.60 4 15.51, 5 10.42 5 14.71, 10 13.03 10 11.53, 15 14.89 15 9.53, 20 16.40 20 7.82, 25 17.44 25 6.96, 30 18.25 30 6.27, 40 19.37 40 6.27, 50 20.77 50 6.27, 60 20.77 60 6.27.

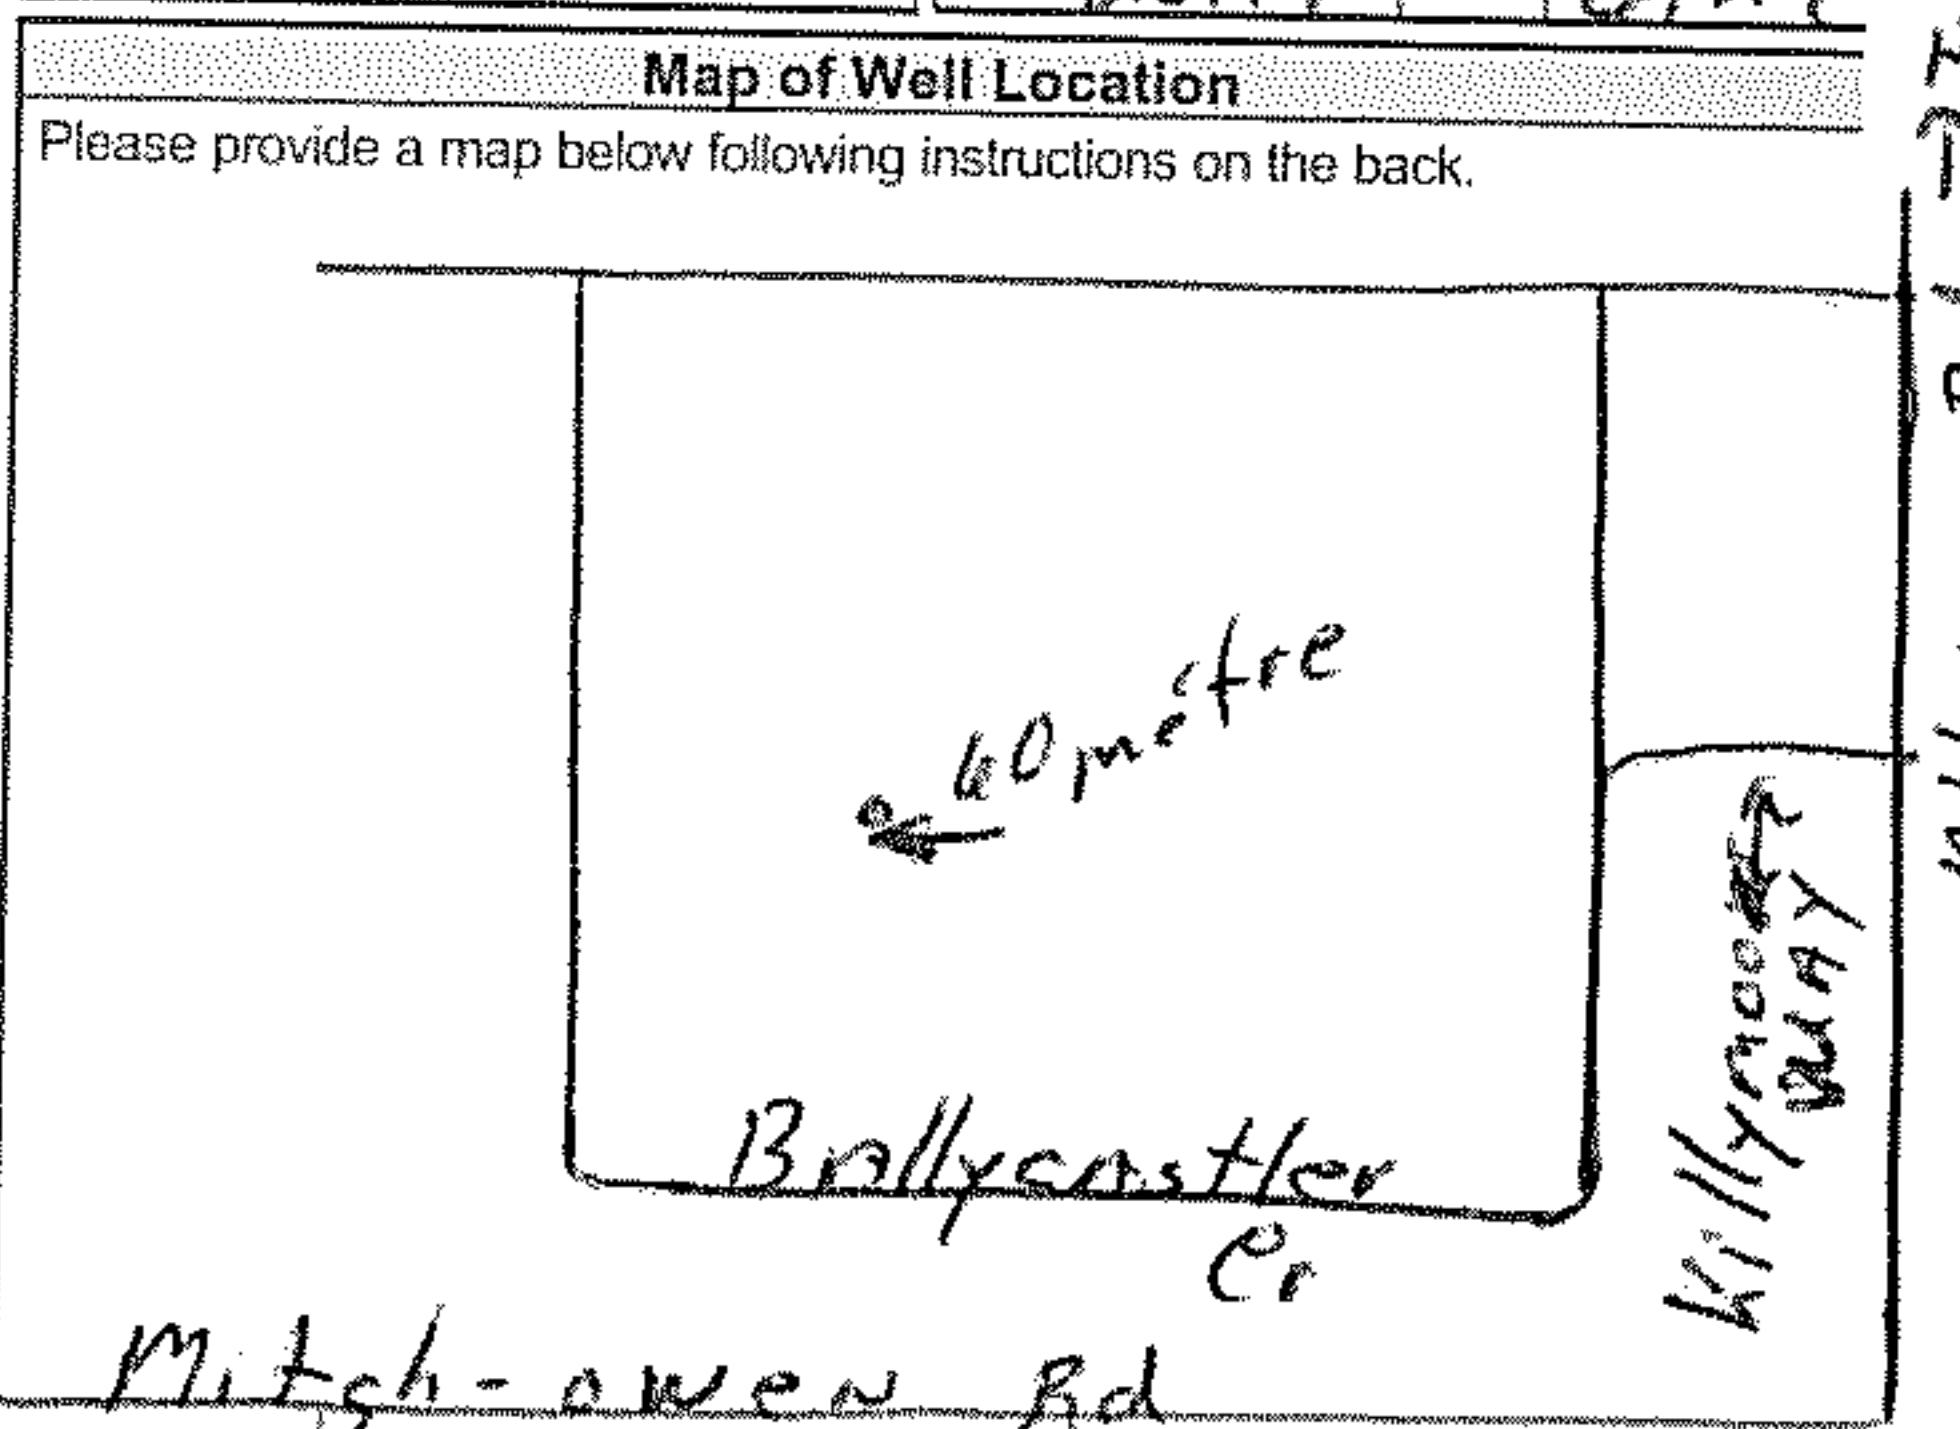

Comments:

Well owner's information package delivered:  Yes  No
Date Package Delivered: 2013/12/23
Date Work Completed: 2013/12/23
Ministry Use Only
Audit No.: 2175579
FEB 14 2014



Measurements recorded in:  Metric  Imperial

Address of Well Location (Street Number/Name) <b>688 Ballycastle Crescent</b>		Township <b>Rideau Front</b>	Lot <b>P/L 29</b>	Concession <b>3</b>
County/District/Municipality <b>Ottawa-Carleton</b>		City/Town/Village <b>Gloucester</b>	Province <b>Ontario</b>	Postal Code
JTM Coordinates Zone	Easting	Northing	Municipal Plan and Sublot Number <b>4M-1482</b>	
NAD 83	<b>18 452765</b>	<b>5013184</b>	Other <b>S/L 5</b>	

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	<b>Sand &amp; Gravel</b>	<b>Boulders</b>		0'	40'
<b>Grey &amp; White</b>	<b>Sandstone</b>			40'	85'
<b>Grey &amp; White</b>	<b>Sandstone</b>			85'	115'
<b>Grey &amp; White</b>	<b>Sandstone</b>			115'	123'

Annular Space			
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )	
From: 50' To: 0'	<b>Neat cement</b>	<b>46.8</b>	

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (Conventional) <input type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify _____	<input type="checkbox"/> Public <input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Livestock <input type="checkbox"/> Irrigation <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify _____


Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Replacement Well
From	To				
<b>6 1/4"</b>	<b>Steel</b>	<b>188"</b>	<b>+2' to 50'</b>	<input type="checkbox"/> Test Hole	<input type="checkbox"/> Recharge Well
<b>6"</b>	<b>Open Hole</b>		<b>50' to 123'</b>	<input type="checkbox"/> Dewatering Well	<input type="checkbox"/> Observation and/or Monitoring Hole

Construction Record - Screen			
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)
			From To

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
<b>85</b>	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	From To	
<b>115</b>	<input type="checkbox"/> Gas <input checked="" type="checkbox"/> Untested	<b>0' to 50'</b>	<b>9 3/4"</b>
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	<b>50' to 123'</b>	<b>6"</b>

Well Contractor and Well Technician Information			
Business Name of Well Contractor <b>Air Rock Drilling Co. Ltd.</b>		Well Contractor's Licence No. <b>1119</b>	
Business Address (Street Number/Name) <b>6659 Franktown Road, RR#1</b>		Municipality <b>Richmond</b>	
Province <b>ON</b>	Postal Code <b>K0A 2Z0</b>	Business E-mail Address <b>air-rock@sympatico.ca</b>	
Bus. Telephone No. (inc. area code) <b>6138382170</b>		Name of Well Technician (Last Name, First Name) <b>Hogan, Dan</b>	
Well Technician's Licence No. <b>T3058</b>	Signature of Technician and/or Contractor	Date Submitted <b>2014 09 30</b>	

Results of Well Yield Testing			
After test of well yield, water was:	Draw Down		
<input type="checkbox"/> Clear and sand free	Time (min)	Water Level (m/ft)	Recovery
<input type="checkbox"/> Other, specify <b>Not tested</b>			Time (min)
If pumping discontinued, give reason:	Static Level		Water Level (m/ft)
<b>X</b>	<b>19.5'</b>		<b>31.5'</b>
Pump intake set at (m/ft)	1	25	1
<b>100</b>	2	26.3	2
Pumping rate (l/min / GPM)	3	26.9	3
<b>15</b>	4	27.3	4
Duration of pumping	5	27.6	5
<b>1 hrs + 0 min</b>	10	28.4	10
Final water level end of pumping (m/ft)	15	28.4	15
<b>31.5'</b>	20	28.9	20
If flowing give rate (l/min / GPM)	25	29.4	25
<b>X</b>	30	29.8	30
Recommended pump depth (m/ft)	40	30.1	40
<b>100'</b>	50	30.6	50
Recommended pump rate (l/min / GPM)	60	31.5	60
<b>15</b>			
Well production (l/min / GPM)			
<b>15</b>			
Disinfected?			
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No			

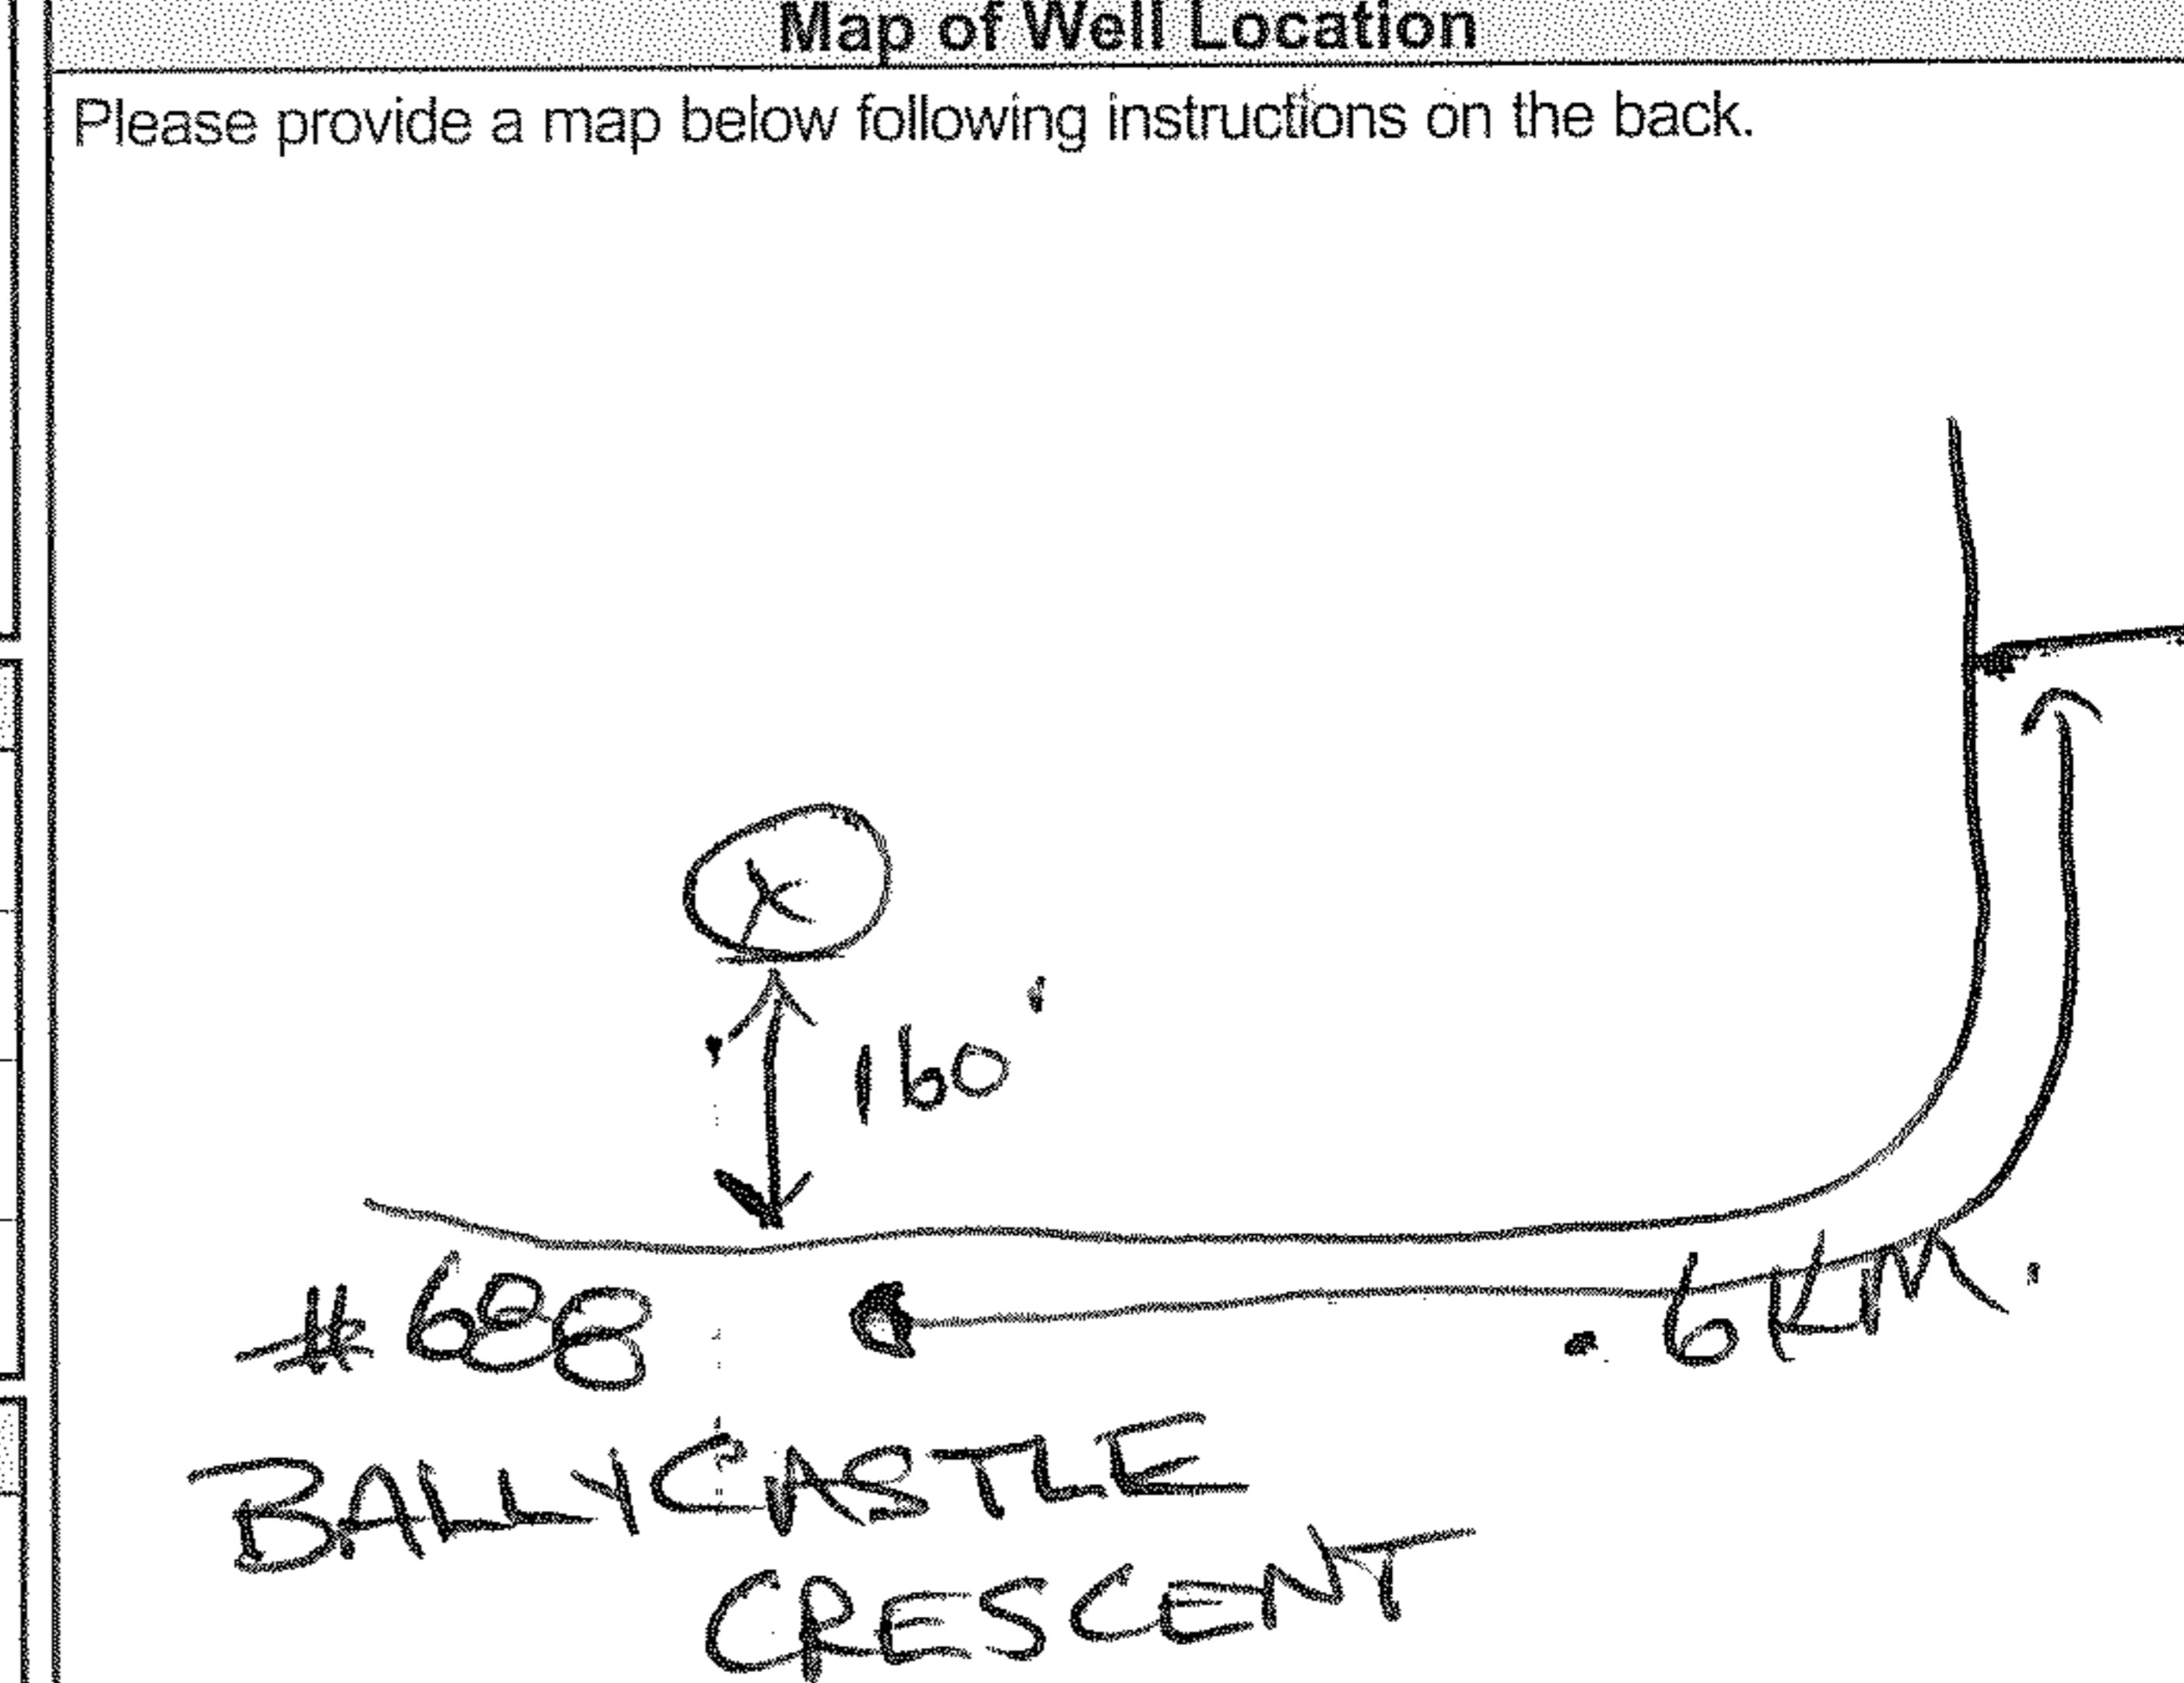

Comments:		Ministry Use Only	
<b>3/4 HP - 15 GPM SET @ 100 FT</b>		Audit No.	
Well owner's information package delivered	Date Package Delivered	<b>Z 167008</b>	
<input checked="" type="checkbox"/> Yes	<b>2014 09 02</b>	<b>SEP 22 2014</b>	
<input type="checkbox"/> No	Date Work Completed		
	<b>2014 08 26</b>		

## Map: Well records

This map allows you to search and view well record information from reported wells in Ontario.

Full dataset is available in the Open Data catalogue (<https://data.ontario.ca/dataset/well-records>) .

---

[Go Back to Map](#)

### Well ID

Well ID Number: 7233986

Well Audit Number: C22635

Well Tag Number: A147901

*This table contains information from the original well record and any subsequent updates.*

### Well Location

<b>Address of Well Location</b>	
<b>Township</b>	OSGOODE TOWNSHIP
<b>Lot</b>	
<b>Concession</b>	

<b>County/District/Municipality</b>	OTTAWA-CARLETON
<b>City/Town/Village</b>	
<b>Province</b>	ON
<b>Postal Code</b>	n/a
<b>UTM Coordinates</b>	NAD83 — Zone 18 Easting: 453450.00 Northing: 5012552.00
<b>Municipal Plan and Sublot Number</b>	
<b>Other</b>	

### Overburden and Bedrock Materials Interval

<b>General Colour</b>	<b>Most Common Material</b>	<b>Other Materials</b>	<b>General Description</b>	<b>Depth From</b>	<b>Depth To</b>

### Annular Space/Abandonment Sealing Record

<b>Depth From</b>	<b>Depth To</b>	<b>Type of Sealant Used (Material and Type)</b>	<b>Volume Placed</b>

--	--	--	--

**Method of Construction & Well Use**

Method of Construction	Well Use

**Status of Well**

**Construction Record - Casing**

Inside Diameter	Open Hole or material	Depth From	Depth To

**Construction Record - Screen**

Outside Diameter	Material	Depth From	Depth To

--	--	--	--

## Well Contractor and Well Technician Information

Well Contractor's Licence Number: 1844

## Results of Well Yield Testing

<b>After test of well yield, water was</b>	
<b>If pumping discontinued, give reason</b>	
<b>Pump intake set at</b>	
<b>Pumping Rate</b>	
<b>Duration of Pumping</b>	
<b>Final water level</b>	
<b>If flowing give rate</b>	
<b>Recommended pump depth</b>	
<b>Recommended pump rate</b>	
<b>Well Production</b>	
<b>Disinfected?</b>	

**Draw Down & Recovery**

<b>Draw Down Time(min)</b>	<b>Draw Down Water level</b>	<b>Recovery Time(min)</b>	<b>Recovery Water level</b>
SWL			
1		1	
2		2	
3		3	
4		4	
5		5	
10		10	
15		15	
20		20	
25		25	
30		30	
40		40	
45		45	

50		50	
60		60	

**Water Details**

Water Found at Depth	Kind

**Hole Diameter**

Depth From	Depth To	Diameter

**Audit Number:** C22635

**Date Well Completed:** September 08, 2014

## Date Well Record Received by MOE: December 16, 2014

### Related

How to use a Ministry of the Environment map (<https://www.ontario.ca/page/how-use-ministry-environment-map#wells>)

Technical documentation: Metadata record (<https://data.ontario.ca/dataset/well-records/resource/3031344e-e3f2-48d5-888c-c1deadfd2f77>)





Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (John Gerard Homes), E-mail Address, Mailing Address (Street Number/Name), Municipality (Greely), Province (On), Postal Code (K4N 1A0), Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name) 647 Ballycastle Crescent, Township (Rideau Front), Lot (P/L 29420 3), County/District/Municipality (Ottawa-Carleton), City/Town/Village (Gloucester), Province (Ontario), UTM Coordinates (NAD 83, Zone 18, Easting 453271, Northing 5013208), Municipal Plan and Sublot Number (4M-1482), Other (S/L 19)

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Sand, Clay, Gravel, Sandstone, and Limestone.

Annular Space: Depth Set at (m/ft) From 60' To 0', Type of Sealant Used (Neat cement), Volume Placed (49.9 m³)

Results of Well Yield Testing: Draw Down (Time, Water Level), Recovery (Time, Water Level), Pump intake set at (130), Pumping rate (20), Duration of pumping (1 hrs + 0 min), Final water level end of pumping (92'), Recommended pump depth (100'), Recommended pump rate (20+), Well production (20+), Disinfected? (Yes)

Method of Construction:  Air percussion,  Other, specify. Well Use:  Domestic,  Commercial,  Not used,  Municipal,  Dewatering,  Test Hole,  Monitoring,  Irrigation,  Cooling & Air Conditioning,  Industrial,  Other, specify.


Construction Record - Casing: Inside Diameter (6 1/4" Steel, 6" Open Hole), Open Hole OR Material (Steel, Open Hole), Wall Thickness (.188"), Depth (m/ft) From +2' To 60', Status of Well:  Water Supply,  Replacement Well,  Test Hole,  Recharge Well,  Dewatering Well,  Observation and/or Monitoring Hole,  Alteration (Construction),  Abandoned, Insufficient Supply,  Abandoned, Poor Water Quality,  Abandoned, other, specify,  Other, specify.

Construction Record - Screen: Outside Diameter (cm/in), Material (Plastic, Galvanized, Steel), Slot No., Depth (m/ft) From, To

Water Details: Water found at Depth (89, 115, 133 m/ft), Kind of Water (Fresh, Gas, Other, specify), Hole Diameter: Depth (m/ft) From, To, Diameter (cm/ft) (9 3/4", 6")

Well Contractor and Well Technician Information: Business Name of Well Contractor (Air Rock Drilling Co. Ltd.), Well Contractor's Licence No. (1119), Business Address (6055 Frankover Road, Richmond), Municipality (Richmond), Province (ON), Postal Code (N0A 2Z0), Business E-mail Address (airrock@sympatico.ca)

Well Technician's Licence No. (T3632), Signature of Technician and/or Contractor, Date Submitted (2014 11 28)

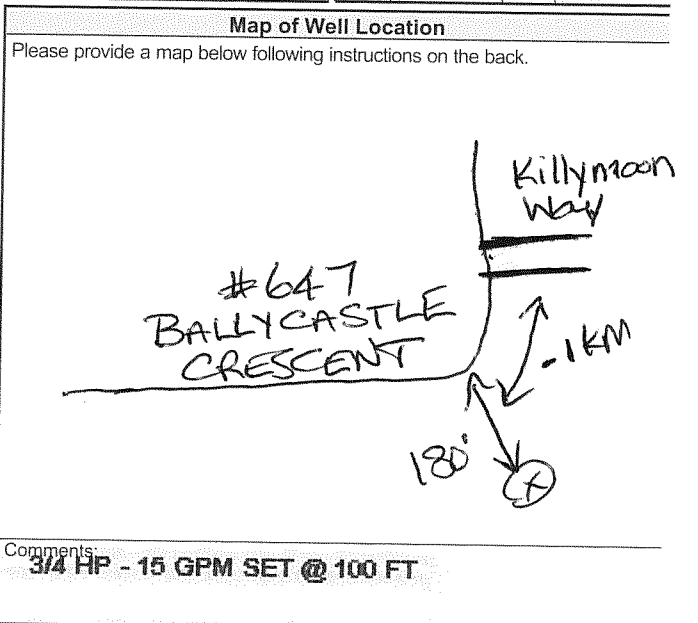

Comments: 3/4 HP - 15 GPM SET @ 100 FT. Well owner's information package delivered (Yes), Date Package Delivered (2014 11 04), Date Work Completed (2014 10 29), Ministry Use Only: Audit No. (Z191300), Received (JAN 06 2015)



Address of Well Location (Street Number/Name) **651 bally castle Cres** Township **Gloucester** Lot **30** Concession **03**  
 County/District/Municipality **Ottawa Carleton** City/Town/Village **Gloucester** Province **Ontario** Postal Code **K1X0A2**  
 UTM Coordinates Zone Easting Northing **8 3 18753548451613** Municipal Plan and Sublot Number **Sublot 20/4M-1482** Other \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Sand with stones			0	38'
Grey	Fractured	Bedrock		38'	45'
Grey	Med	Bedrock		45'	85'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
45' 0'	6 Bags cement 10 Bags Quik grout	

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
10"	open hole		0	45'	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
6"	steel	188	+3	45'	
6"	open hole		45'	80'	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
67' (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____			
(m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____			
(m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____			

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Olympic Drilling Co Ltd** Well Contractor's Licence No. **40006**  
 Business Address (Street Number/Name) **6662 Bank St Metcalpe** Municipality \_\_\_\_\_  
 Province **ont** Postal Code **K0A2P0** Business E-mail Address \_\_\_\_\_

Bus. Telephone No. (inc. area code) **613 229 8371** Name of Well Technician (Last Name, First Name) **Wayne Renwick**  
 Well Technician's Licence No. **0327** Signature of Technician and/or Contractor **Wayne Renwick** Date Submitted **2014 12 20**

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify \_\_\_\_\_

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft) **50 ft**

Pumping rate (l/min / GPM) **10 gpm**

Duration of pumping **1 hrs + \_\_\_\_\_ min**

Final water level end of pumping (m/ft) **15.3'**

If flowing give rate (l/min / GPM) \_\_\_\_\_


Recommended pump depth (m/ft) **60'**

Recommended pump rate (l/min / GPM) **10 gpm**

Well production (l/min / GPM) **35**

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	12.1			
1	12.4	1		
2	12.7	2		
3	13.0	3		
4	13.4	4		
5	13.9	5		
10	14.7	10		
15	14.8	15		
20	14.9	20		
25	14.10	25		
30	15.00	30		
40	15.3	40		
50	15.3	50		
60	15.3	60		

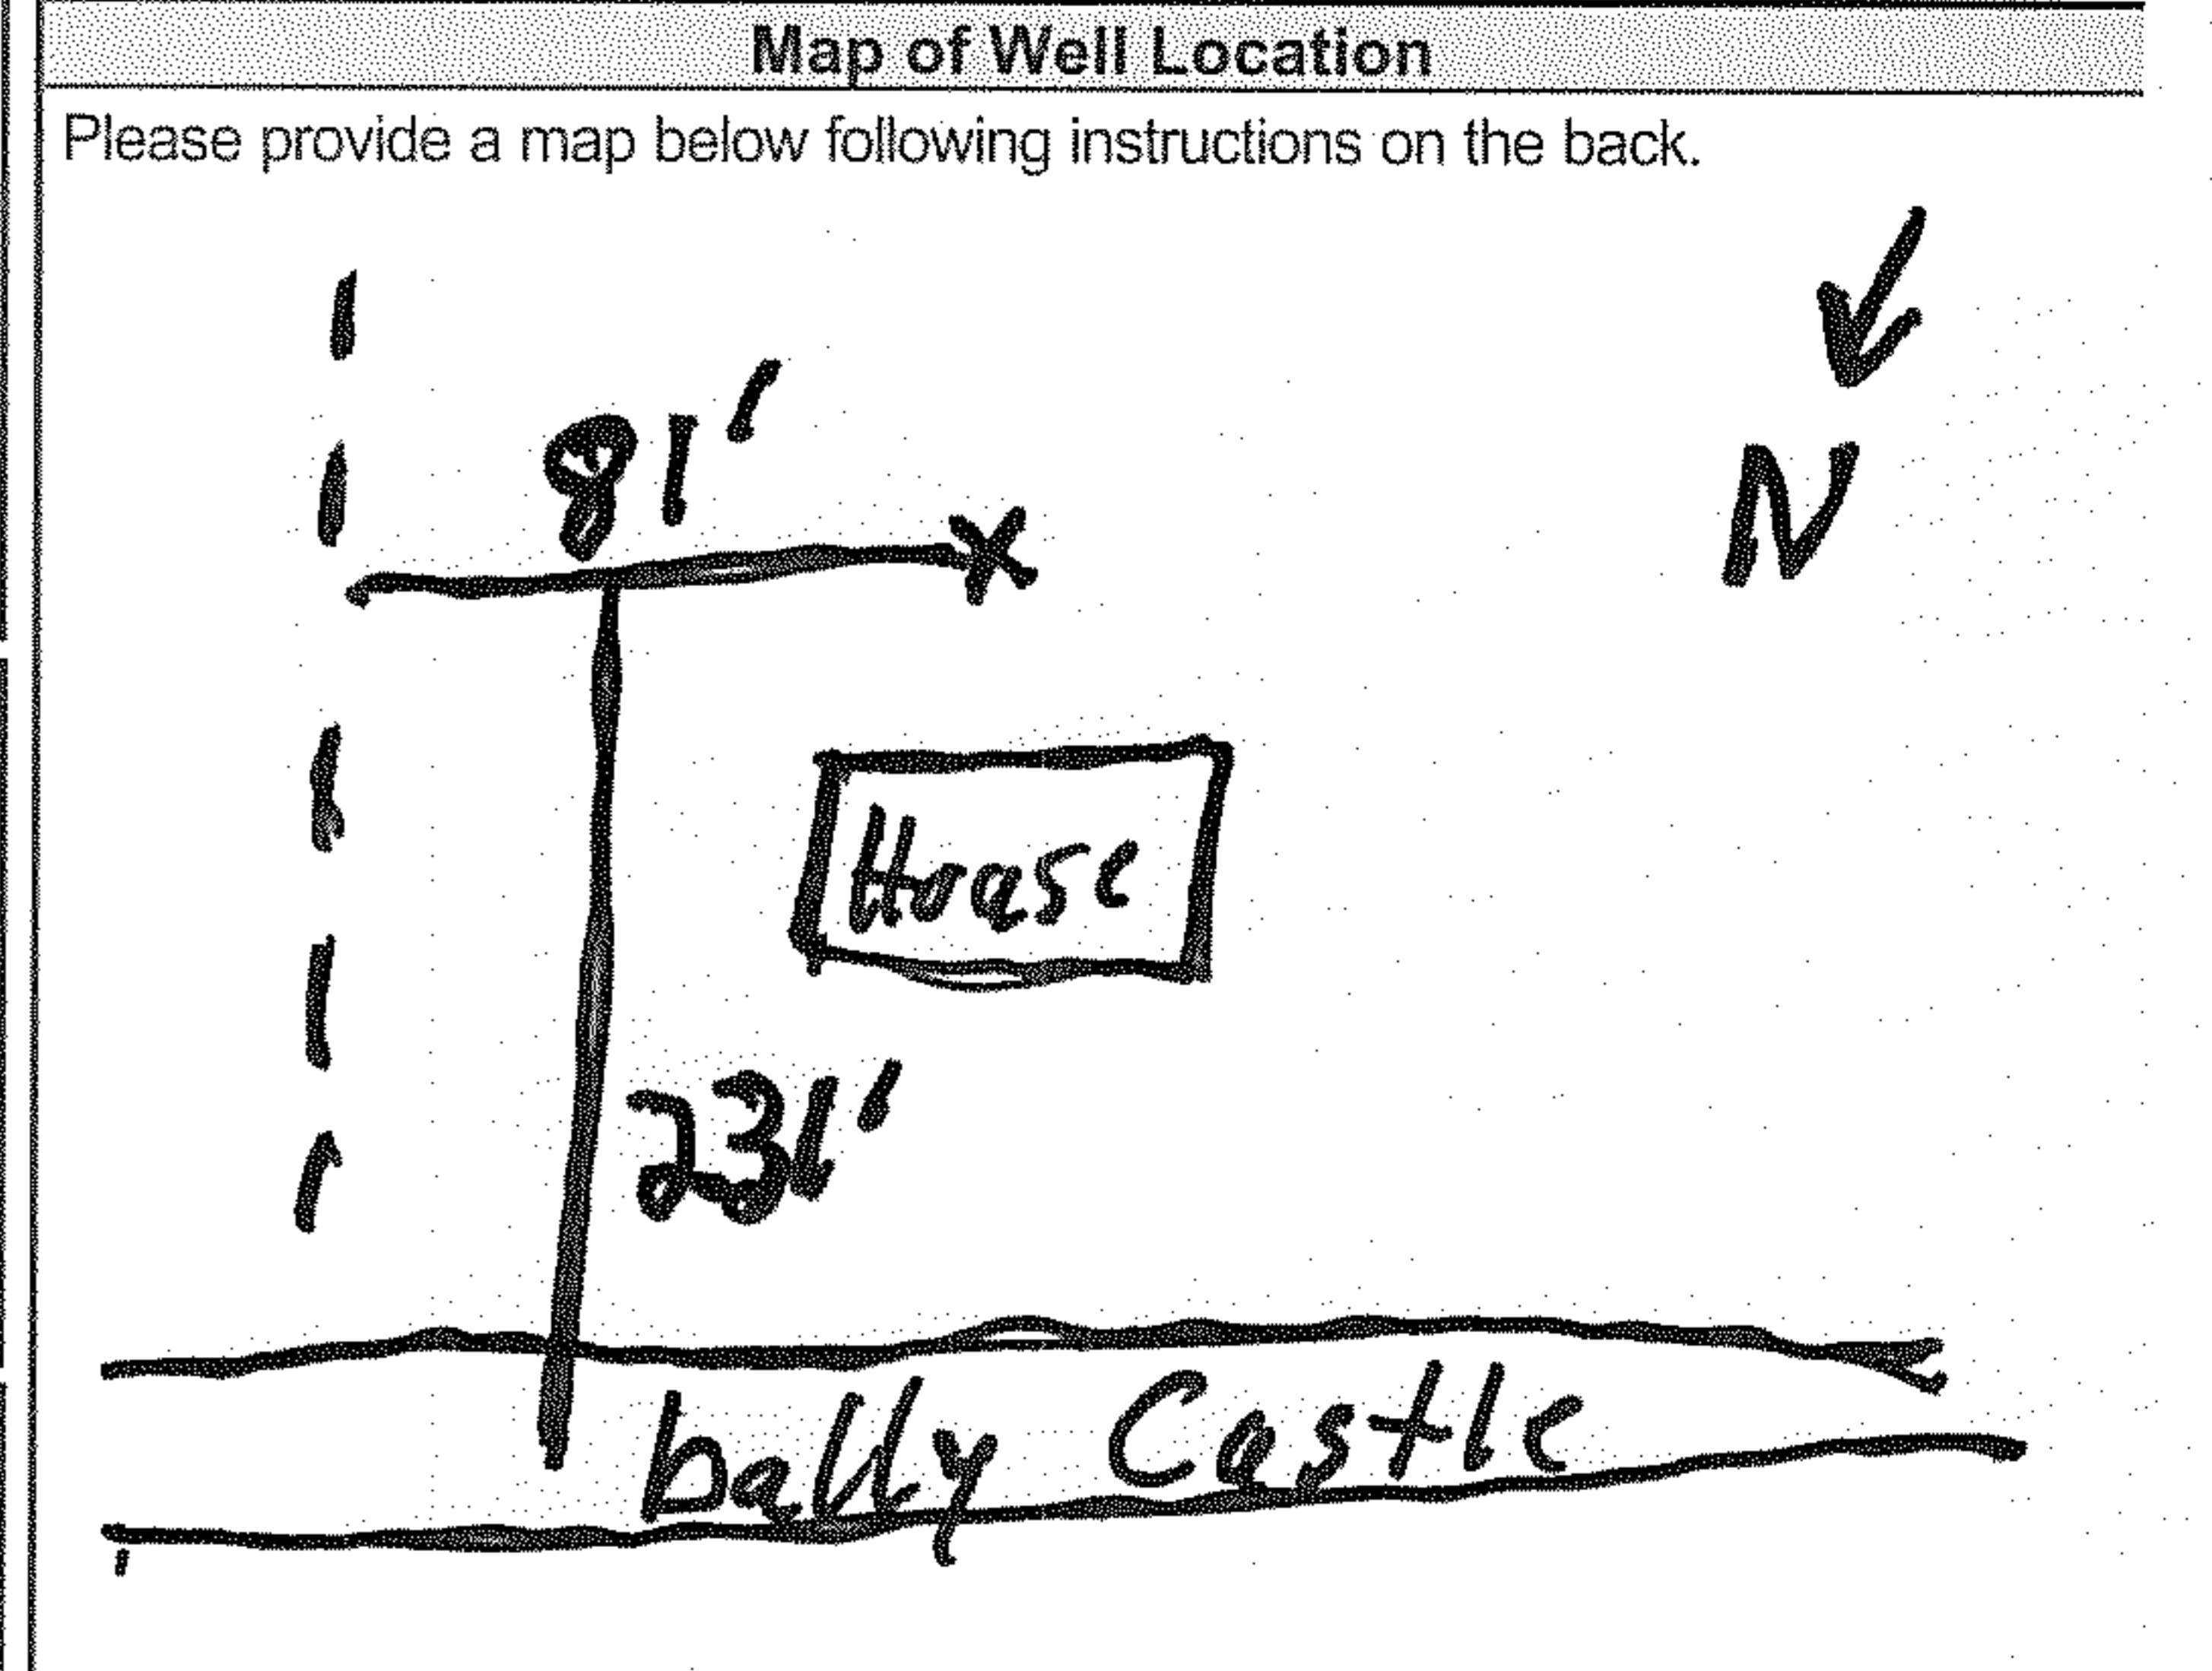

Comments: \_\_\_\_\_

Well owner's information package delivered  Yes  No

Date Package Delivered **2014 12 20**

Date Work Completed **2014 12 03**

**Ministry Use Only**

Audit No. **Z 17741A**

Received **JAN 07 2015**

Measurements recorded in:  Metric  Imperial

**Well Owner's Information**

First Name \_\_\_\_\_ Last Name / Organization **Mackie Homes** E-mail Address \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name) **Box 136** Municipality **Greely** Province **ON** Postal Code **K4P 1N4** Telephone No. (inc. area code) \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name) **684 Ballycastle Crescent** Township **Rideau Front** Lot **P/L 29** Concession **3**

County/District/Municipality **Ottawa-Carleton** City/Town/Village **Gloucester** Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other  
 NAD 83 **18 452820 5013191 4M-1482 S/L 6**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
	Clay			0' 25'
	Sand	Gravel		25' 40'
Grey	Limestone			40' 67'
Grey & White	Sandstone			67' 93'
Grey & White	Sandstone			93' 100'

**Annular Space**

Depth Set at (m/ft) From To Type of Sealant Used (Material and Type) Volume Placed (m<sup>3</sup>)  
 50' 0' Neat cement 40.6

**Method of Construction** **Well Use**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing** **Status of Well**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
			From	To	
6 1/4"	Steel	.188"	+2'	50'	<input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
6"	Open Hole		50'	100'	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details** **Hole Diameter**

Water found at Depth **93' (m/ft)** Kind of Water:  Fresh  Untested  Gas  Other, specify \_\_\_\_\_

Water found at Depth \_\_\_\_\_ Kind of Water:  Fresh  Untested  Gas  Other, specify \_\_\_\_\_

Water found at Depth \_\_\_\_\_ Kind of Water:  Fresh  Untested  Gas  Other, specify \_\_\_\_\_

Depth (m/ft)	Diameter (cm/in)
0' 50'	9 3/4"
50' 100'	6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No. **1119**

Business Address (Street Number/Name) **6659 Franktown Road, RR#1** Municipality **Richmond**

Province **ON** Postal Code **K0A 2Z0** Business E-mail Address **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code) **6138382170** Name of Well Technician (Last Name, First Name) **Hanna, Jeremy**

Well Technician's Licence No. **13632** Signature of Technician and/or Contractor *[Signature]* Date Submitted **2016 03 31**

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **Not tested**

If pumping discontinued, give reason: **X**

Pump intake set at (m/ft) **80**

Pumping rate (l/min / GPM) **20**

Duration of pumping **1 hrs + 0 min**

Final water level end of pumping (m/ft) **2.9'**

If flowing give rate (l/min / GPM) **X**


Recommended pump depth (m/ft) **80**

Recommended pump rate (l/min / GPM) **20**

Well production (l/min / GPM) **20**

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	4"		2.9'	
1	1.4	1	1.7	
2	1.5	2	1.4	
3	1.6	3	1.4	
4	1.7	4	1.4	
5	1.8	5	1.4	
10	2.1	10	1.3	
15	2.2	15	1.3	
20	2.3	20	1.3	
25	2.4	25	1.2	
30	2.5	30	1.2	
40	2.7	40	1.2	
50	2.8	50	1.1	
60	2.9'	60	1.1'	

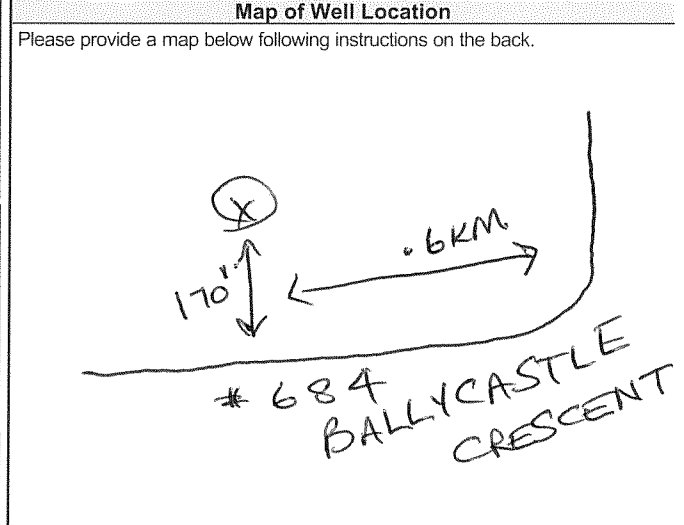

Comments: **3/4 HP - 15 GPM SET @ 80 FT**

Well owner's information package delivered	Date Package Delivered	Ministry Use Only
<input checked="" type="checkbox"/> Yes	<b>2016 03 17</b>	Audit No. <b>Z 202752</b>
<input type="checkbox"/> No	Date Work Completed <b>2016 03 14</b>	<b>MAY 12 2016</b>



Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name Last Name / Organization E-mail Address  Well Constructed by Well Owner

Mailing Address (Street Number/Name) Municipality Province Postal Code Telephone No. (inc. area code)

Well Location Address of Well Location (Street Number/Name) Township Lot Concession

County/District/Municipality City/Town/Village Province Postal Code

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Sand & Gravel, Clay, Limestone.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used (Material and Type); Volume Placed (m³/ft³). Row: Neat cement, 43.7.

Method of Construction and Well Use tables. Method of Construction includes Cable Tool, Rotary, Boring, etc. Well Use includes Public, Commercial, Domestic, etc.

Construction Record - Casing table with columns: Inside Diameter (cm/in), Open Hole OR Material, Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well.


Construction Record - Screen table with columns: Outside Diameter (cm/in), Material, Slot No., Depth (m/ft) From, To.

Water Details and Hole Diameter tables. Water Details includes Water found at Depth, Kind of Water. Hole Diameter includes Depth (m/ft) From, To, Diameter (cm/in).

Well Contractor and Well Technician Information

Business Name of Well Contractor, Well Contractor's Licence No., Business Address, Municipality, Province, Postal Code, Business E-mail Address, Name of Well Technician, Well Technician's Licence No., Signature of Technician and/or Contractor, Date Submitted.

Results of Well Yield Testing table with columns: Draw Down, Recovery, Time (min), Water Level (m/ft), Static Level, Pumping rate (l/min / GPM), Duration of pumping, Final water level end of pumping (m/ft), Recommended pump depth (m/ft), Recommended pump rate (l/min / GPM), Well production (l/min / GPM), Disinfected?.

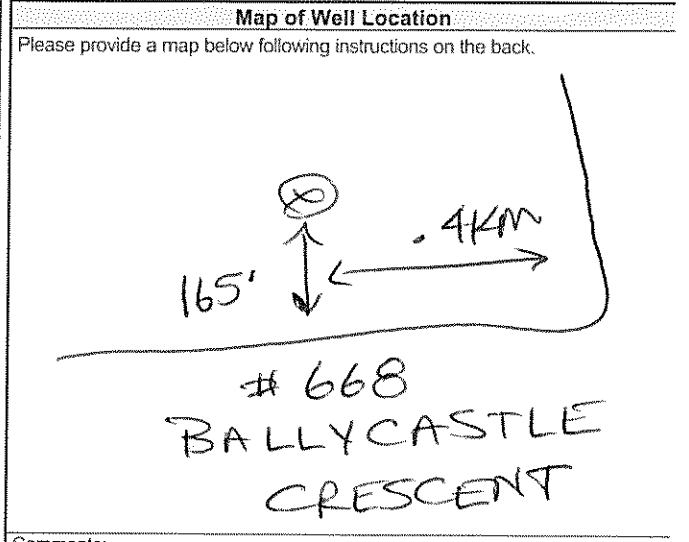

Comments: 1HP-15GPM SET @ 125 FT. Well owner's information package delivered: Yes. Date Package Delivered: 2016 05 30. Date Work Completed: 2016 05 25. Ministry Use Only: Audit No. 202808, Received: AUG 10 2016.



Measurements recorded in:  Metric  Imperial

A207792

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name, Last Name / Organization, E-mail Address, Mailing Address (Street Number/Name), Municipality, Province, Postal Code, Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name), Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Zone, Easting, Northing, Municipal Plan and Sublot Number, Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m) From, To

Annular Space table with columns: Depth Set at (m) From, To, Type of Sealant Used (Material and Type), Volume Placed (m³)

Method of Construction and Well Use checkboxes: Cable Tool, Rotary, Boring, Air percussion, Diamond, Jetting, Driving, Digging, Public, Commercial, Not used, Domestic, Municipal, Dewatering, Livestock, Test Hole, Monitoring, Irrigation, Industrial, Cooling & Air Conditioning

Construction Record - Casing table with columns: Inside Diameter (cm), Open Hole OR Material, Wall Thickness (cm), Depth (m) From, To, Status of Well


Construction Record - Screen table with columns: Outside Diameter (cm), Material, Slot No., Depth (m) From, To

Water Details and Hole Diameter tables

Well Contractor and Well Technician Information: Business Name, Licence No., Business Address, Municipality, Province, Postal Code, Business E-mail Address

Well Technician's Licence No., Signature of Technician and/or Contractor, Date Submitted

Results of Well Yield Testing table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level)

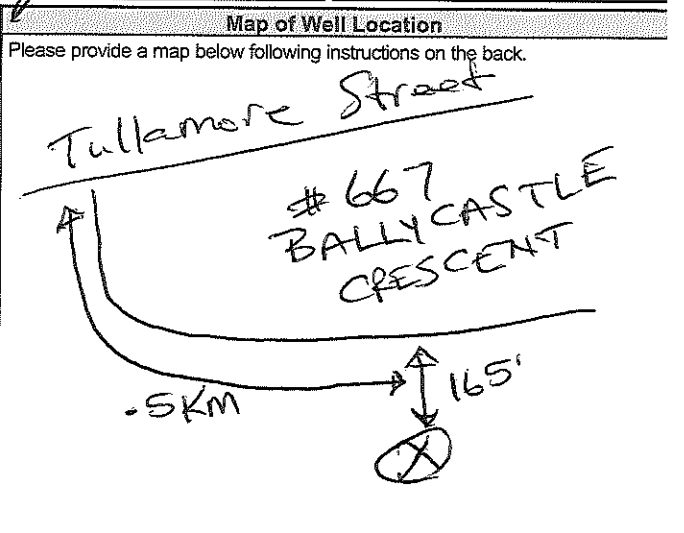

Comments: 3/4 HP - 15 GPM SET @ 80 FT

Well owner's information package delivered, Date Package Delivered, Date Work Completed, Ministry Use Only (Audit No., Received)



A207695

Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name, Last Name / Organization (1343487 Ontario Ltd.), E-mail Address, Well Constructed by Well Owner

Mailing Address (Street Number/Name): 1678 Bank Street, Suite 1; Municipality: Ottawa; Province: ON; Postal Code: K1V 7Y6; Telephone No.

Well Location

Address of Well Location (Street Number/Name): 6690 Mitch Owens Road; Township: Osgoode; Lot: P/L 1; Concession: 4

County/District/Municipality: Ottawa-Carleton; City/Town/Village: Greely; Province: Ontario; Postal Code

UTM Coordinates: Zone 18, Easting 453476, Northing 5013043; Municipal Plan and Sublot Number; Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Rows include Sand, Gravel, Limestone, Sandstone.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used; Volume Placed (m³/ft³). Rows include Neat cement, Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, Diamond, Jetting, Driving, Digging, Domestic, Commercial, Municipal, Test Hole, Cooling & Air Conditioning, etc.


Construction Record - Casing table with columns: Inside Diameter (cm/in), Open Hole OR Material, Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well. Includes Steel, Open Hole, Water Supply.

Construction Record - Screen table with columns: Outside Diameter (cm/in), Material, Slot No., Depth (m/ft) From, To. Includes Steel, Slot No., Depth.

Water Details and Hole Diameter table. Water found at Depth (128, 165, 174 m/ft), Kind of Water, Hole Diameter (Depth, Diameter).

Well Contractor and Well Technician Information. Business Name: Air Rock Drilling Co. Ltd.; Well Contractor's Licence No. 1119; Business Address; Province: ON; Postal Code: K1A 2Z0; Business E-mail Address: air-rock@sympatico.ca; Bus. Telephone No. 613-882-170; Name of Well Technician: Hogan, Dan; Well Technician's Licence No. 13056; Signature of Technician and/or Contractor; Date Submitted: 10/31/2016.

Results of Well Yield Testing table. Columns: Time (min), Water Level (m/ft), Time (min), Water Level (m/ft). Includes Draw Down and Recovery data for various pumping durations.

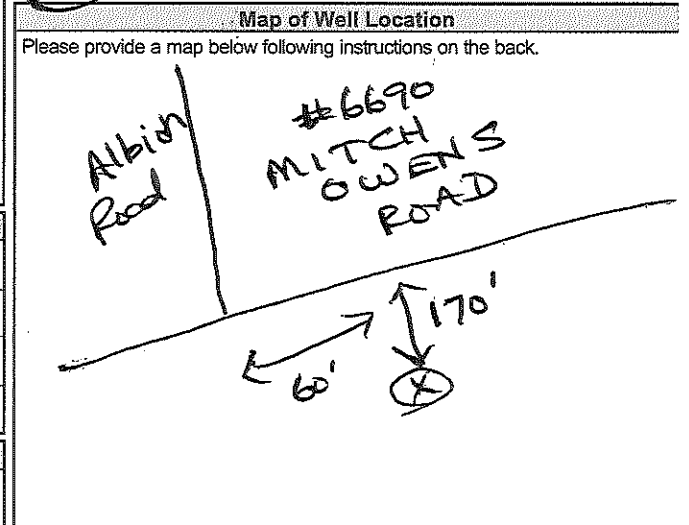

Comments: 3/4 HP - 15 GPM SET @ 100 FT. Ministry Use Only: Audit No. 2237048, Received: NOV 28 2016.

Measurements recorded in:  Metric  Imperial

A 207441

Page 1 of 1

Address of Well Location (Street Number/Name) **687 Bally Castle Cr** Township **Ossoude** Lot **29** Concession

County/District/Municipality **OTTAWA City** City/Town/Village **Greely** Province **Ontario** Postal Code **K1H0A3**

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other

NAD 83 **184528995013103** **4M-14R2**

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	SAND		Soft	0	14.84
Grey	limestone		Hard	14.84	48.48

Annular Space

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
0 17.87	Quik vents Cement vents	10 Bag 2 Bag

Results of Well Yield Testing

After test of well yield, water was:	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
<input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify				
If pumping discontinued, give reason:	Static Level	4.36		7.67
Pump intake set at (m/ft)	1	5.61	1	6.47
Pumping rate (l/min / GPM)	2	5.96	2	5.89
Duration of pumping	3	6.23	3	5.52
Final water level end of pumping (m/ft)	4	6.38	4	5.29
If flowing give rate (l/min / GPM)	5	6.43	5	5.15
Recommended pump depth (m/ft)	10	6.96	10	4.80
Recommended pump rate (l/min / GPM)	15	7.17	15	4.94
Well production (l/min / GPM)	20	7.32	20	4.36
Disinfected?	25	7.41	25	4.36
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	30	7.49	30	4.36
	40	7.58	40	4.36
	50	7.63	50	4.36
	60	7.67	60	4.36

Method of Construction

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse air)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial  Other, specify

Construction Record - Casing

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
5.55	Steel	0.48	0.60	17.87	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

Construction Record - Screen

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	

Water Details

Water found at Depth (m/ft)	Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	Hole Diameter	
		Depth (m/ft)	Diameter (cm/in)
4.84	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0 17.87	25.40
6.06	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0 48.48	15.55

Well Contractor and Well Technician Information

Business Name of Well Contractor **DNR WATER-well-Drilling** Well Contractor's Licence No. **7526**

Business Address (Street Number/Name) **1763 Route 900 west** Municipality **NATION**

Province **ON** Postal Code **K0A3C0** Business E-mail Address

Bus. Telephone No. (inc. area code) **613 782 5598** Name of Well Technician (Last Name, First Name) **Mouette Karl**

Well Technician's Licence No. **3773** Signature of Technician and/or Contractor **Karl Mouette** Date Submitted **20120120**

Map of Well Location

Please provide a map below following instructions on the back.

Comments:

Well owner's information package delivered  Yes  No

Date Package Delivered **20120109**

Date Work Completed **20120100**

Ministry Use Only

Audit No. **2236545**

Received **JAN 19 2017**

Address of Well Location (Street Number/Name) <b>679 Ballycastle Crescent</b>		Township <b>Gloucester</b>	Lot <b>P/L 29</b>	Concession <b>3</b>
County/District/Municipality <b>Ottawa-Carleton</b>		City/Town/Village <b>Gloucester</b>	Province <b>Ontario</b>	Postal Code 
UTM Coordinates NAD   8   3	Zone <b>18</b>	Easting <b>452867</b>	Northing <b>5013114</b>	Municipal Plan and Sublot Number <b>4M-1482</b>
Other <b>S/L 27</b>				

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)						
General Colour	Most Common Material	Other Materials	General Description		Depth (m/ft) From To	
Grey	Clay	& Sand & Gravel			0'	42'
Grey	Limestone				42'	100'
White	Sandstone				100'	137'
White	Sandstone				137'	153'
White	Sandstone				153'	160'

Annular Space		
Depth Set at (m/ft) From To	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
52' 0'	Neat cement	49.9

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (Conventional) <input type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify _____	<input type="checkbox"/> Diamond <input type="checkbox"/> Jetting <input type="checkbox"/> Driving <input type="checkbox"/> Digging <input type="checkbox"/> Public <input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Livestock <input type="checkbox"/> Irrigation <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify _____

Construction Record - Casing			Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft) From To	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
6 1/4"	Steel	.188"	+2' 52'	
5 5/16"	Open Hole		52' 160'	


Construction Record - Screen			
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft) From To

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft) From To	Diameter (cm/in)
137 (m/ft)	<input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____	0' 52'	9 3/4"
153 (m/ft)	<input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____	52' 160'	5 5/16"

Well Contractor and Well Technician Information	
Business Name of Well Contractor <b>Air Rock Drilling Co. Ltd.</b>	Well Contractor's Licence No. <b>1119</b>
Business Address (Street Number/Name) <b>8659 Franktown Road, RR#1</b>	Municipality <b>Richmond</b>
Province <b>ON</b>	Postal Code <b>K0A 2Z0</b>
Business E-mail Address <b>air-rock@sympatico.ca</b>	

Bus. Telephone No. (inc. area code) <b>6138382170</b>	Name of Well Technician (Last Name, First Name) <b>Hogan, Dan</b>
Well Technician's Licence No. <b>T3058</b>	Signature of Technician and/or Contractor 
Date Submitted <b>2017 03 31</b>	

Results of Well Yield Testing				
After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify <b>Not tested</b>	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:  <b>X</b>	Static Level	<b>11.7"</b>		<b>53.7'</b>
	1	22.5	1	39
	2	28.2	2	31
	3	32.3	3	27.2
	4	35.6	4	24.7
	5	38.3	5	22.3
Pump intake set at (m/ft) <b>140</b>				
Pumping rate (l/min / GPM) <b>20</b>				
Duration of pumping <b>hrs + min</b>				
Final water level end of pumping (m/ft) <b>53.7'</b>				
If flowing give rate (l/min / GPM) <b>X</b>				
Recommended pump depth (m/ft) <b>100'</b>				
Recommended pump rate (l/min / GPM) <b>20</b>				
Well production (l/min / GPM) <b>20</b>				
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				

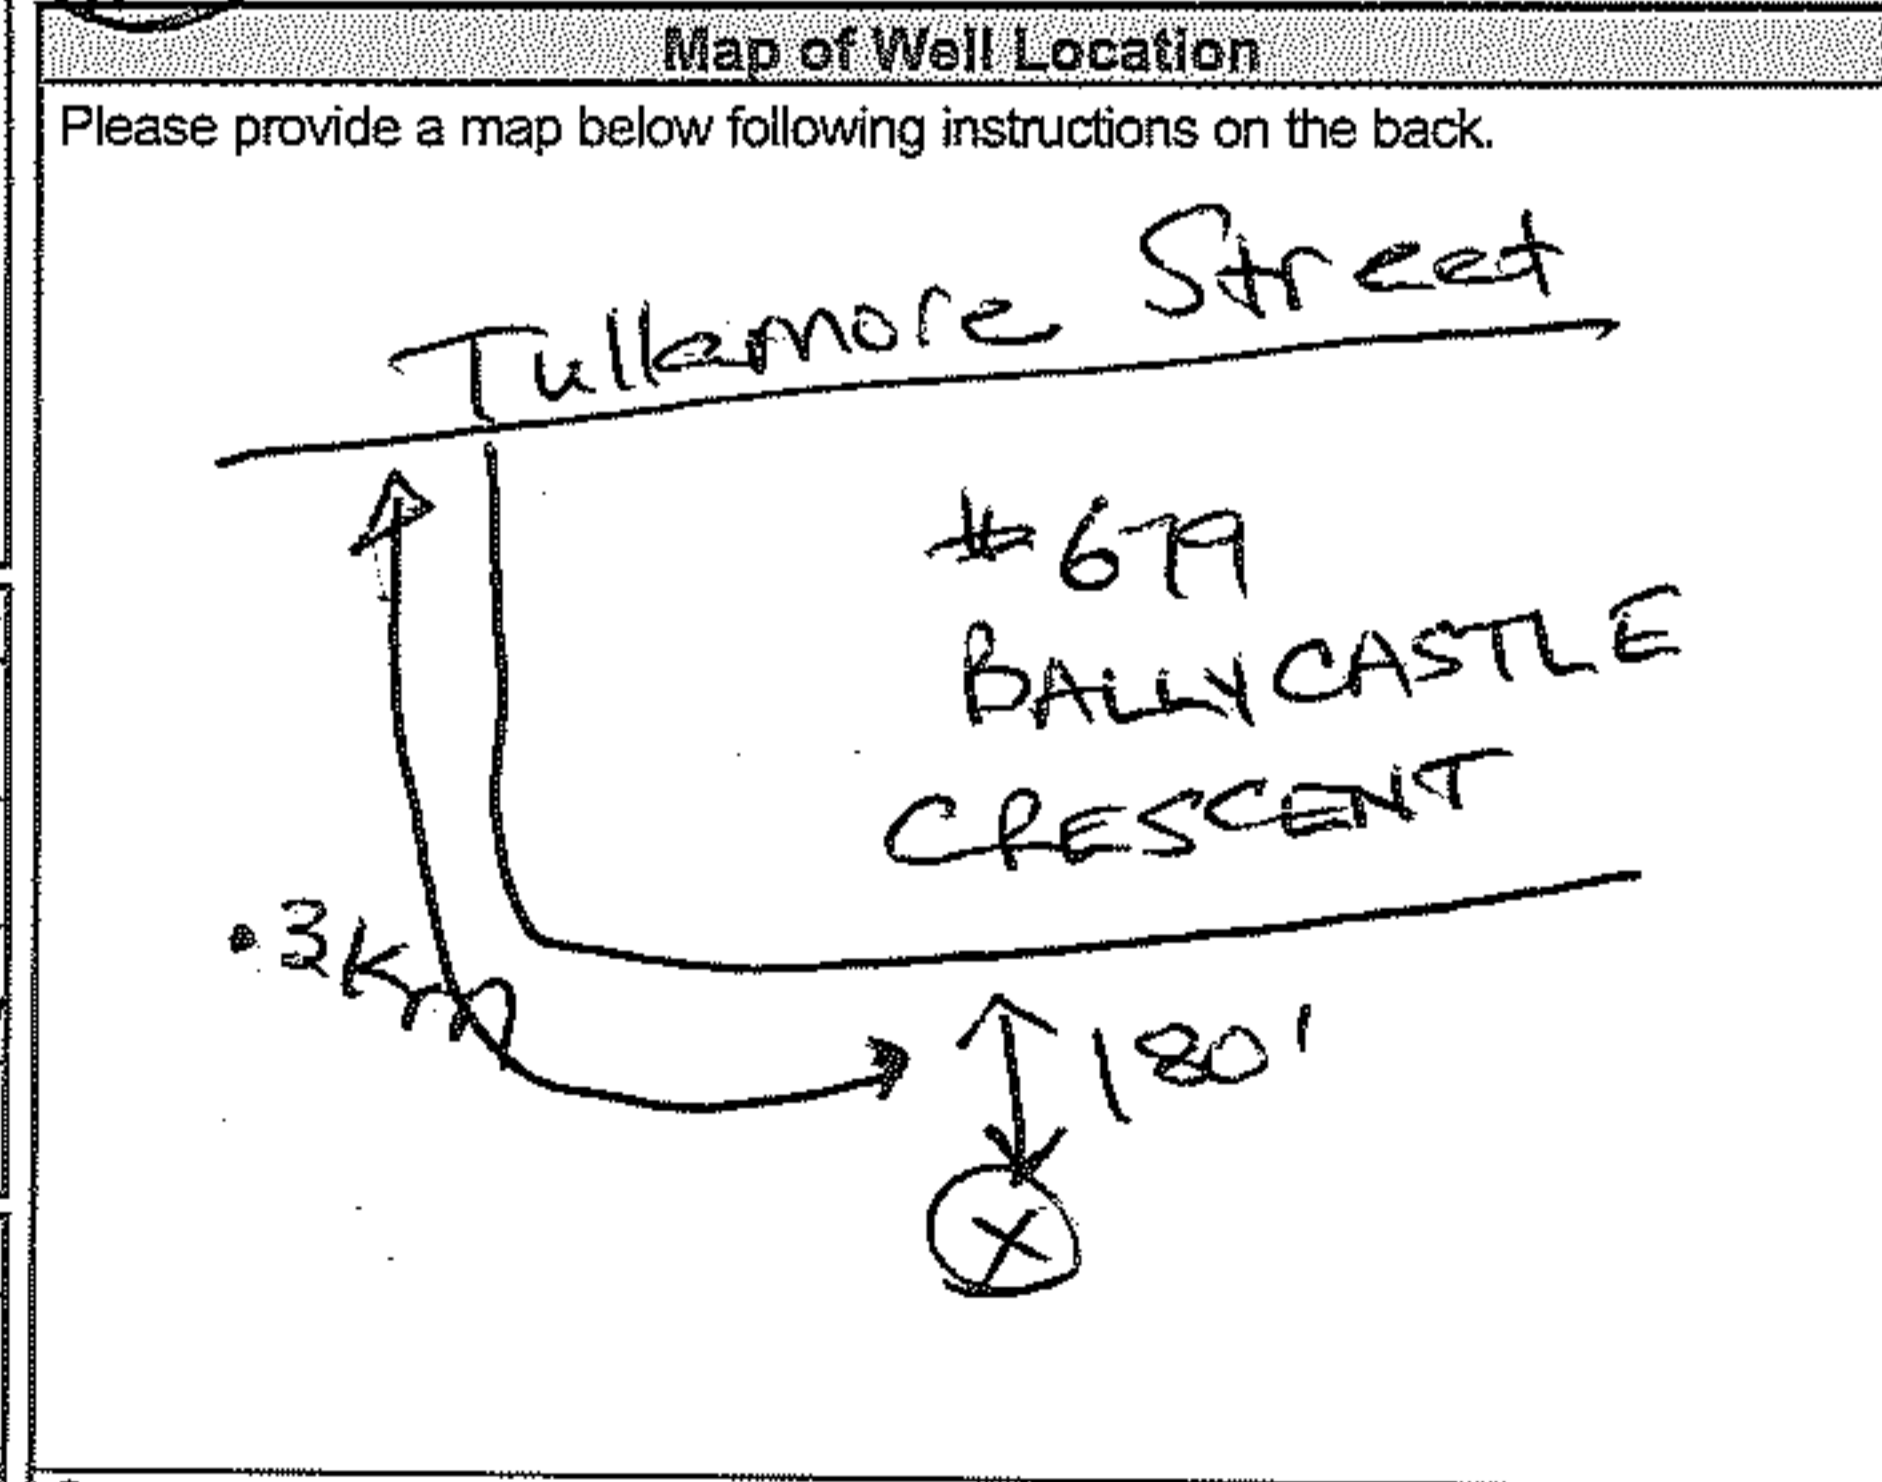

Comments:  
**3/4 HP - 15 GPM SET @ 100 FT**

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered	Ministry Use Only	
	Y Y M M D D	Audit No.	Received
	<b>2017 03 23</b>	<b>Z237313</b>	
	Date Work Completed		
	<b>2017 03 13</b>	<b>APR 18 2017</b>	



Measurements recorded in:  Metric  Imperial

Address of Well Location (Street Number/Name) 635 Ballycastle Crescent
Township Gloucester
Lot P/L 29
Concession 3
County/District/Municipality Ottawa-Carleton
City/Town/Village Gloucester
Province Ontario
Postal Code
UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other
NAD 83 18 453235 5013339 4M-1482 S/L 16

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)
Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m) From, To.
Rows: Clay & Gravel & Sand (0' to 40'), Grey Limestone w/ Grey Sandstone (40' to 114'), Grey Limestone w/ Grey Sandstone (114' to 120')

Annular Space
Depth Set at (m) From To
Type of Sealant Used (Material and Type) Neat cement
Volume Placed (m³) 45.2

Results of Well Yield Testing
Table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level).
Includes pumping rate (20 GPM), duration (20 min), final water level (40.7 m), and various draw down/recovery points.


Method of Construction
Well Use
Includes checkboxes for Cable Tool, Rotary, Boring, Air percussion, and various well uses like Domestic, Commercial, etc.

Construction Record - Casing
Table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (m) From To.
Rows: Steel (6 1/4" dia, 188" wall, +2' to 50'), Open Hole (6" dia, 50' to 120')

Construction Record - Screen
Table with columns: Outside Diameter, Material, Slot No., Depth (m) From To.

Water Details
Hole Diameter
Table with columns: Water found at Depth, Kind of Water, Depth (m) From To, Diameter (cm/in).

Well Contractor and Well Technician Information
Business Name of Well Contractor: Air Rock Drilling Co. Ltd.
Well Contractor's Licence No.: 1119
Business Address: 6659 Franktown Road, RR#1, Richmond

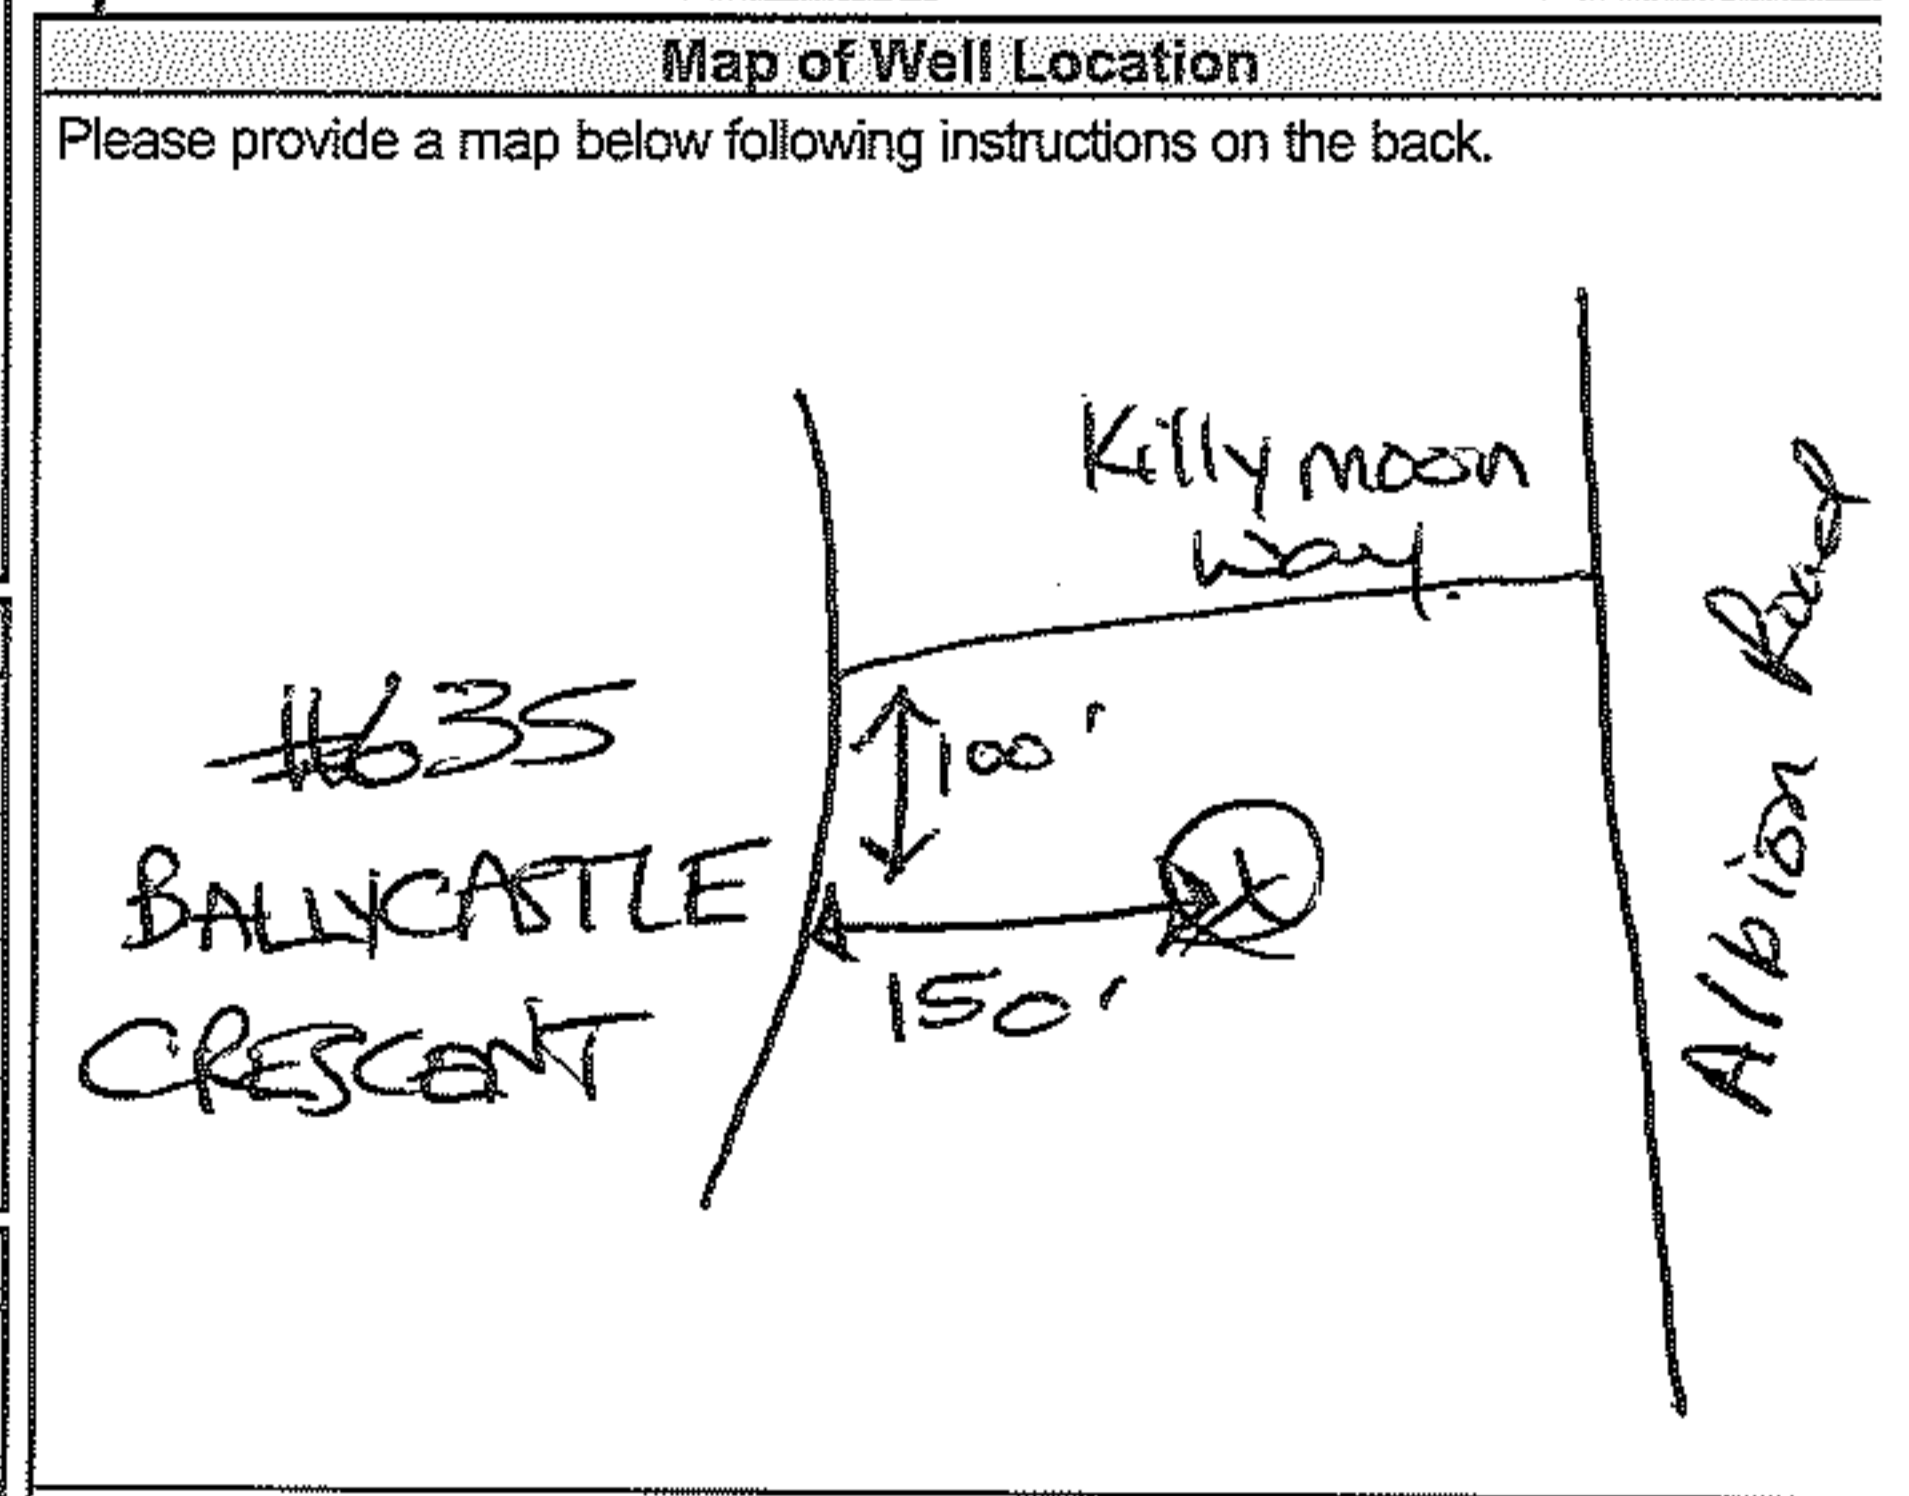

Province ON, Postal Code K0A 2Z0, Business E-mail Address air-rock@sympatico.ca
Bus. Telephone No. 8138382170, Name of Well Technician Hogan, Dan
Well Technician's Licence No. 13058, Signature of Technician and/or Contractor, Date Submitted 2017 03 31

Comments: 3/4 HP - 15 GPM SET @ 100 FT
Well owner's information package delivered: Yes
Date Package Delivered: 2017 03 24
Date Work Completed: 2017 03 16
Ministry Use Only: Audit No. 2237317, Received APR 18 2017



Measurements recorded in: Metric Imperial

Address of Well Location (Street Number/Name) 676 Ballycastle Crescent
Township Gloucester
Lot P/L 29
Concession 3
County/District/Municipality Ottawa-Carleton
City/Town/Village Gloucester
Province Ontario
Postal Code
UTM Coordinates Zone Easting Northing
NAD 8 3 18 452891 5013207
Municipal Plan and Sublot Number 4M-1482
Other S/L 8

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)
Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m) From To

Annular Space
Table with columns: Depth Set at (m) From To, Type of Sealant Used (Material and Type), Volume Placed (m³)

Method of Construction
Well Use
List of options for construction methods and well uses.

Construction Record - Casing
Table with columns: Inside Diameter (cm/in), Open Hole OR Material, Wall Thickness (cm/in), Depth (m/ft) From To, Status of Well


Construction Record - Screen
Table with columns: Outside Diameter (cm/in), Material, Slot No., Depth (m/ft) From To, Status of Well

Water Details
Table with columns: Water found at Depth (m/ft), Kind of Water, Hole Diameter (m/ft) From To, Diameter (cm/in)

Well Contractor and Well Technician Information
Business Name of Well Contractor: Air Rock Drilling Co. Ltd.
Well Contractor's Licence No.: 1119
Business Address: 8859 Franktown Road, RR#1
Municipality: Richmond
Province: ON, Postal Code: K0A 2Z0, Business E-mail Address: air-rock@sympatico.ca

Well Technician's Licence No.: T3632
Signature of Technician and/or Contractor: Hanna, Jeremy
Date Submitted: 2017 05 31

Results of Well Yield Testing
Table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level), Pumping rate, Duration of pumping, Final water level end of pumping, Recommended pump depth, Recommended pump rate, Well production

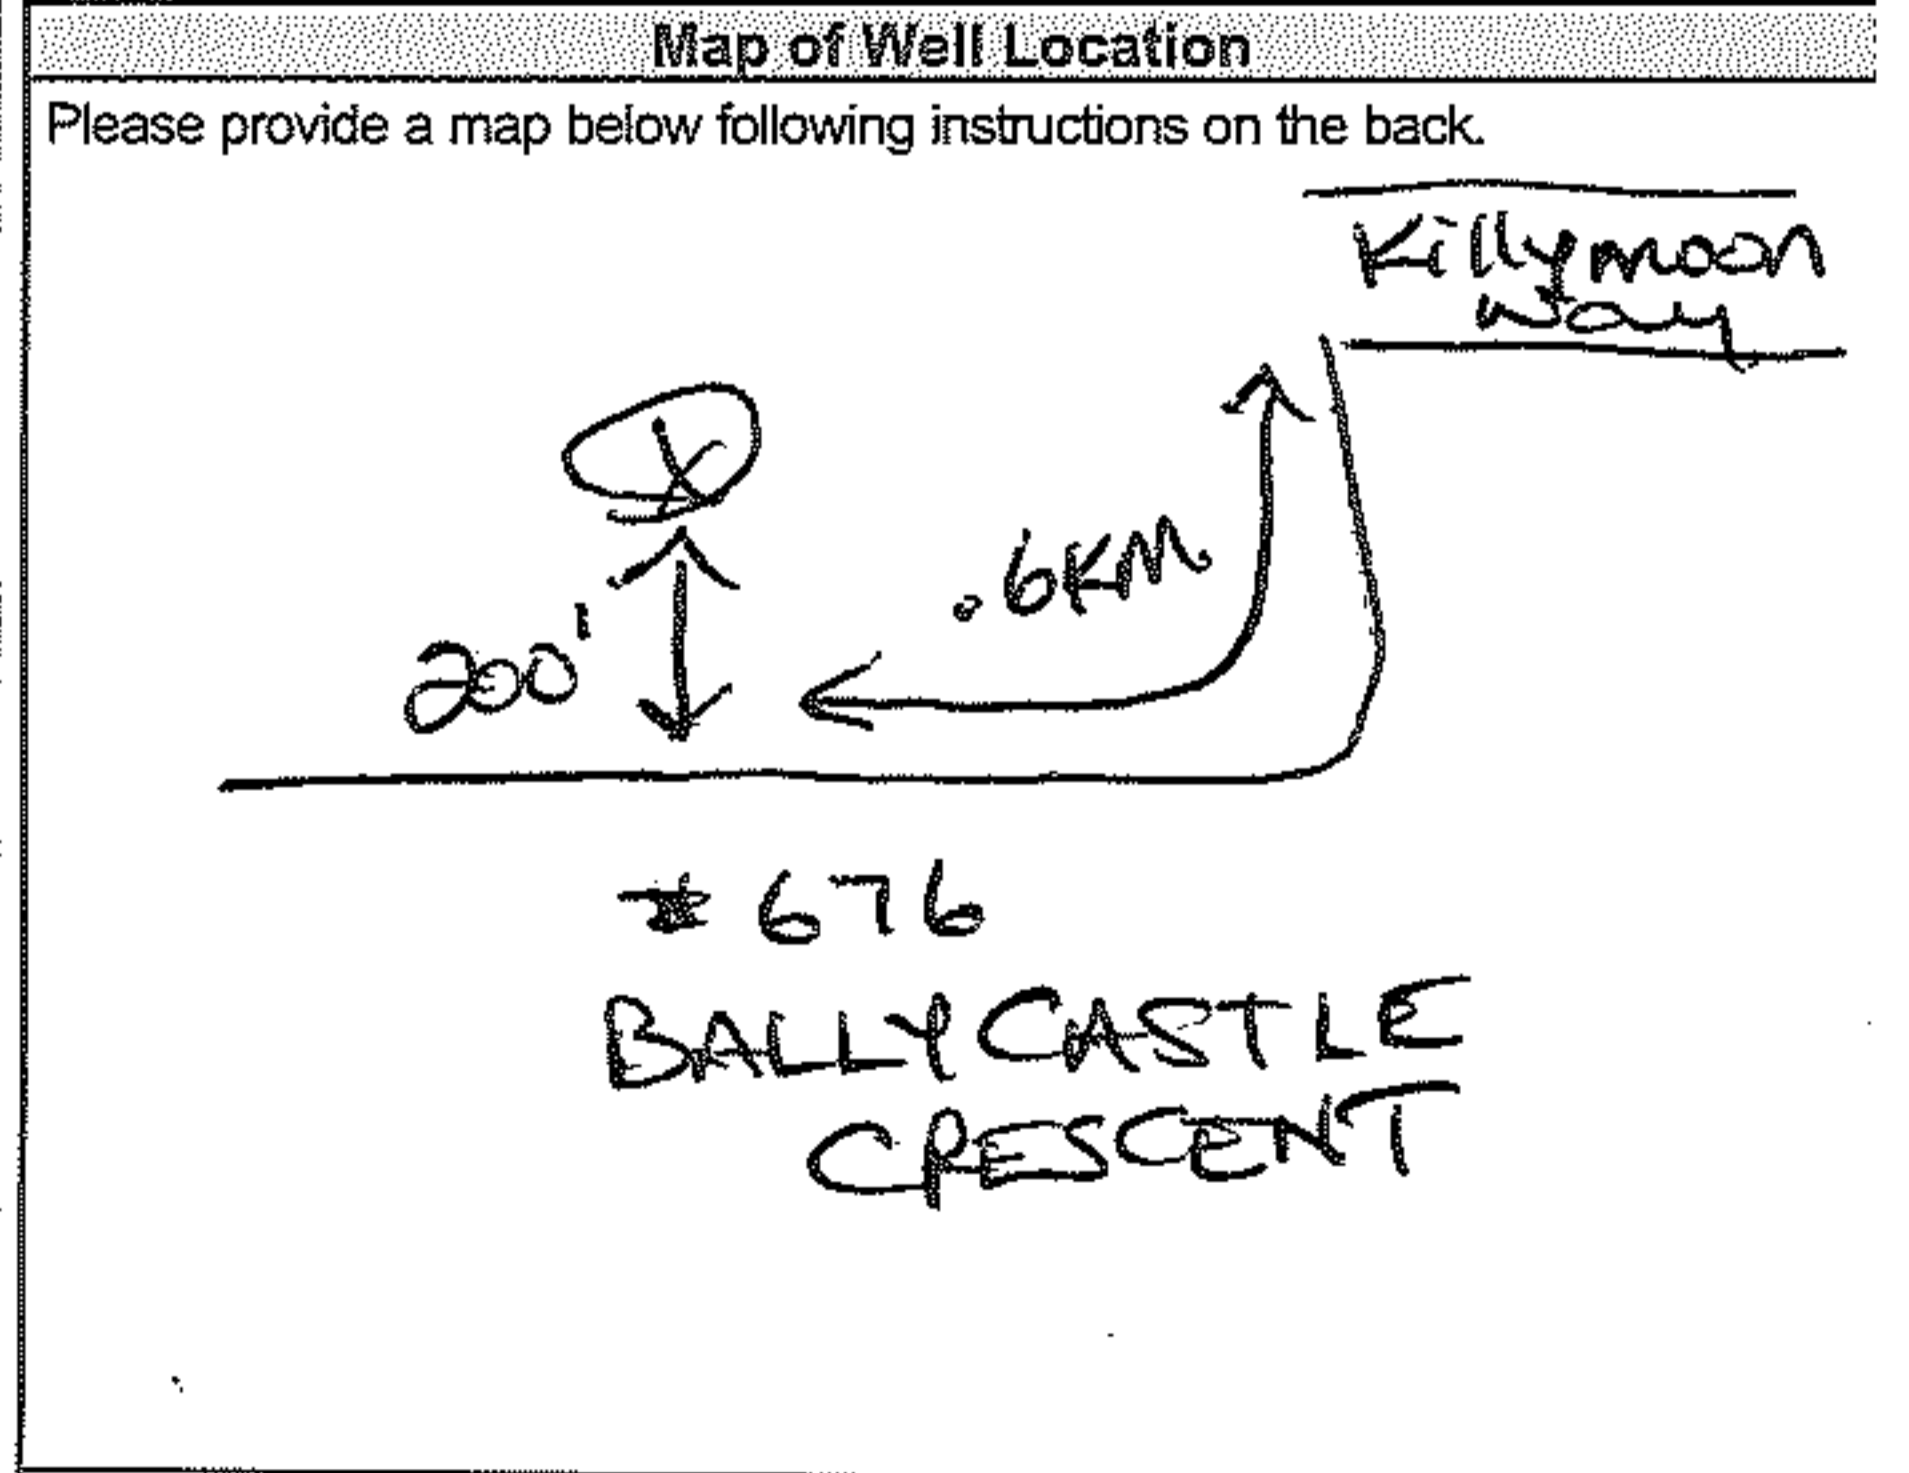

Comments: 3/4 HP - 15 GPM Pump Set @ 100 FT

Well owner's information package delivered: Yes
Date Package Delivered: 2017 05 09
Date Work Completed: 2017 04 27
Ministry Use Only: Audit No. 2237348, JUN 07 2017



Measurements recorded in:  Metric  Imperial

Address of Well Location (Street Number/Name) 675 Ballycastle Crescent
Township Gloucester
Lot P/L 29
Concession 3
County/District/Municipality Ottawa-Carleton
City/Town/Village Gloucester
Province Ontario
Postal Code
UTM Coordinates Zone Easting Northing NAD 8 3 18 452900 5013108
Municipal Plan and Sublot Number 4M-1482
Other S/L 26

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)
Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To

Annular Space
Table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used (Material and Type); Volume Placed (m³/ft³)

Method of Construction
Well Use
List of options for construction methods and well uses.


Construction Record - Casing
Table with columns: Inside Diameter (cm/in), Open Hole OR Material, Wall Thickness (cm/in), Depth (m/ft) From, To, Status of Well

Construction Record - Screen
Table with columns: Outside Diameter (cm/in), Material, Slot No., Depth (m/ft) From, To

Water Details
Hole Diameter
Table with columns: Water found at Depth, Kind of Water, Depth (m/ft) From, To, Diameter (cm/in)

Well Contractor and Well Technician Information
Business Name of Well Contractor: Air Rock Drilling Co. Ltd.
Well Contractor's Licence No.: 1119
Business Address: 6659 Franktown Road, RR#1
Municipality: Richmond
Province: ON
Postal Code: K0A 2Z0
Business E-mail Address: air-rock@sympatico.ca
Bus. Telephone No.: 6138382170
Name of Well Technician: Hogan, Dan
Well Technician's Licence No.: T3058
Signature of Technician and/or Contractor: [Signature]
Date Submitted: 2017 04 28

Results of Well Yield Testing
Table with columns: After test of well yield, water was; Draw Down (Time, Water Level); Recovery (Time, Water Level); Pumping rate; Duration of pumping; Final water level end of pumping; Recommended pump depth; Recommended pump rate; Well production; Disinfected?

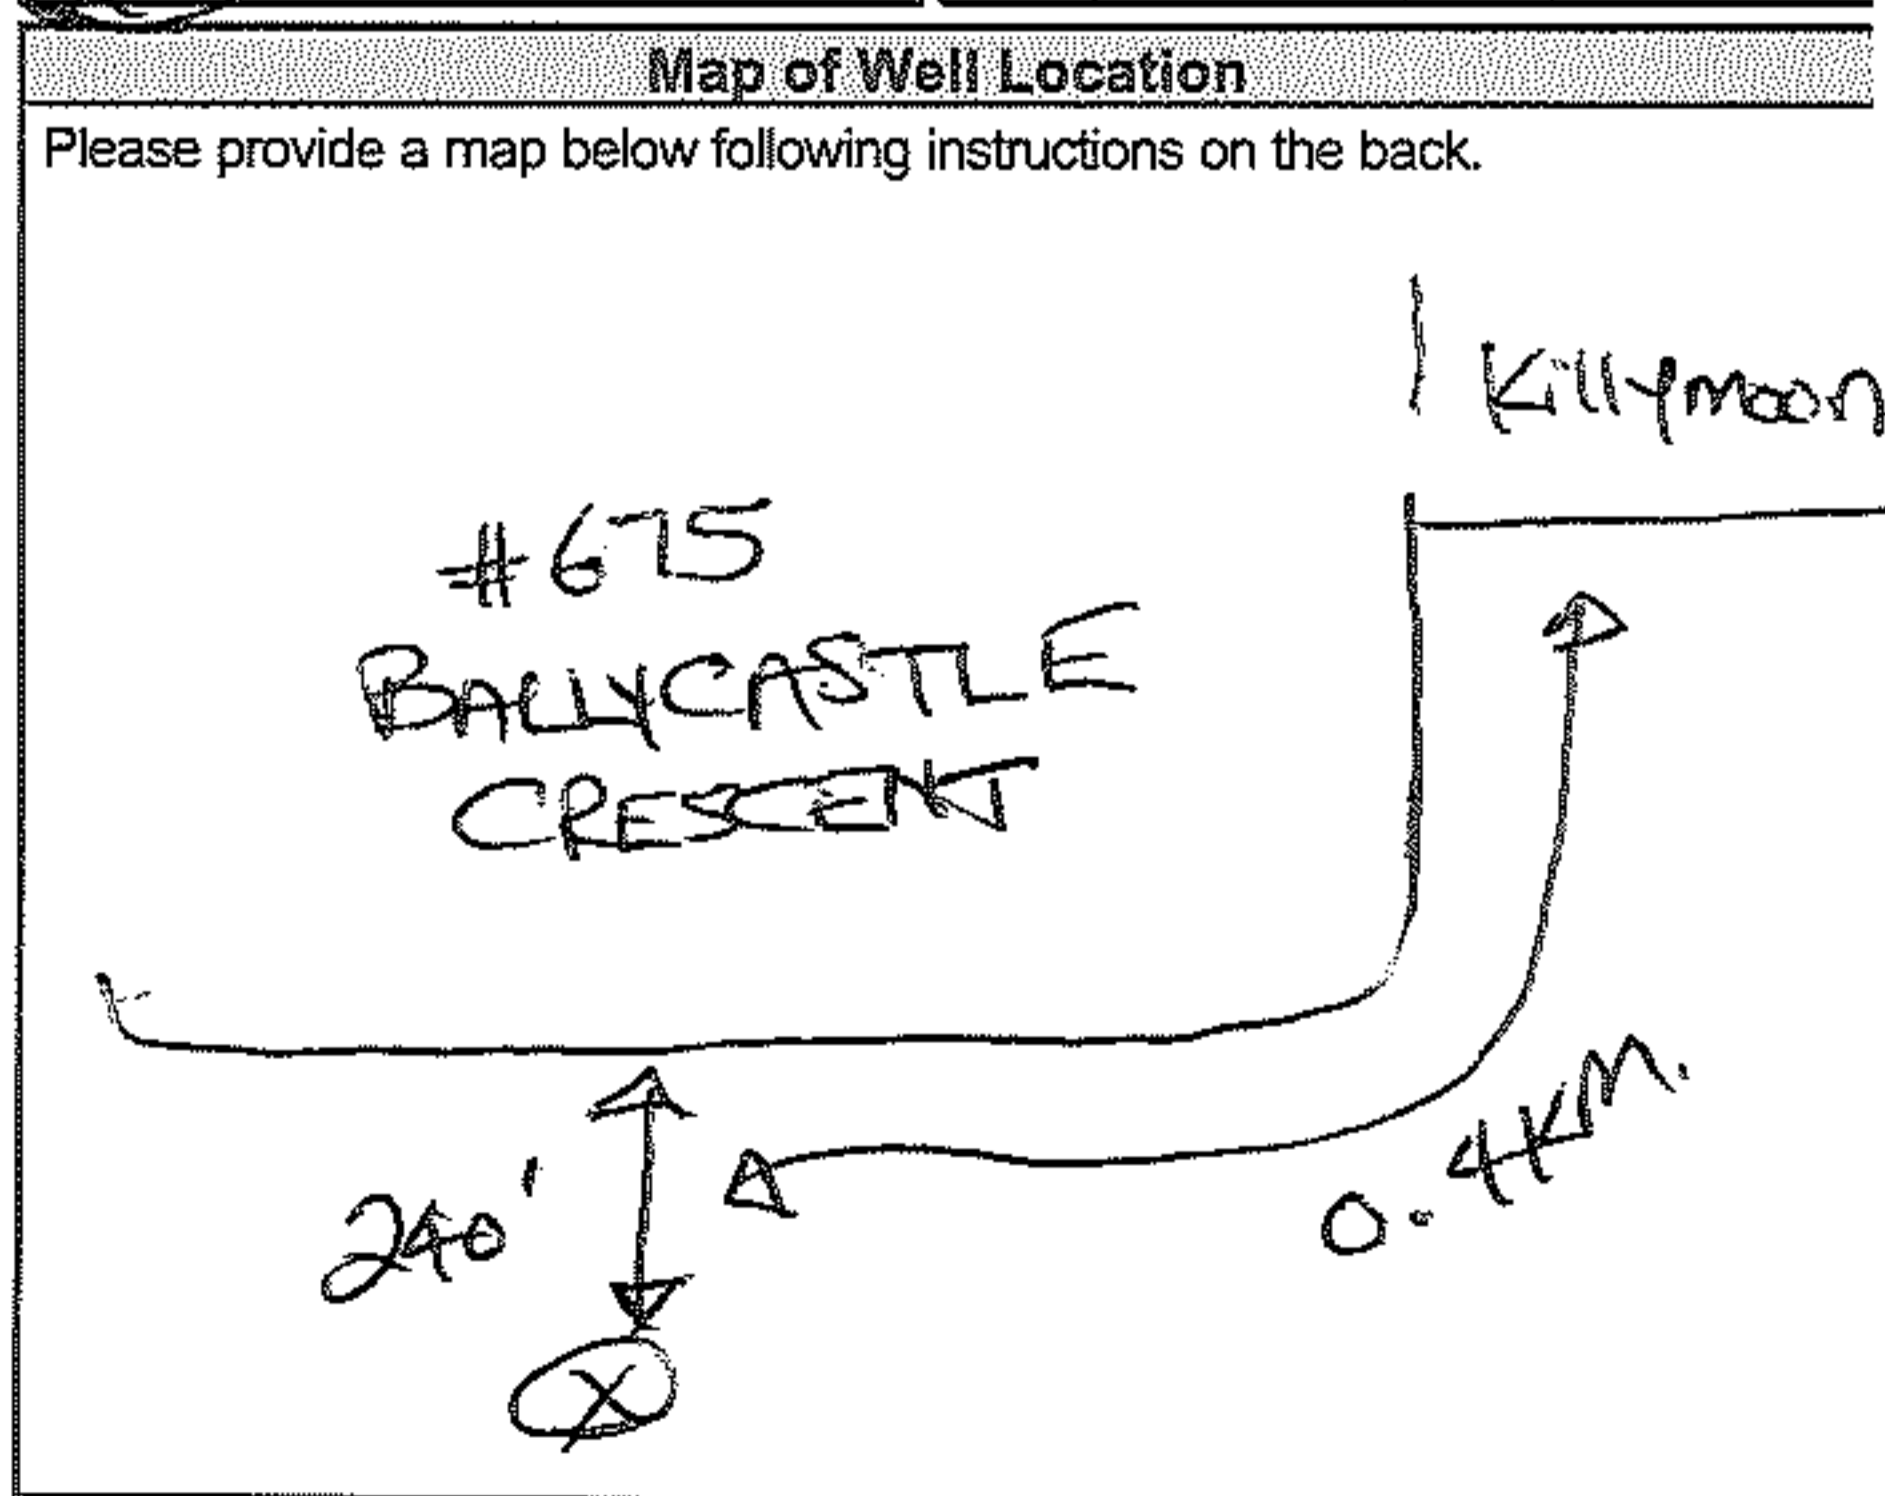

Comments: 3/4 HP - 15 GPM SET @ 100 FT

Well owner's information package delivered: [X] Yes
Date Package Delivered: 2017 04 05
Date Work Completed: 2017 03 31
Ministry Use Only: Audit No. 2237321, JUN 07 2017

Measurements recorded in:  Metric  Imperial

A207599

Page \_\_\_\_\_ of \_\_\_\_\_

Well Owner's Information

First Name \_\_\_\_\_ Last Name / Organization Grizzly Homes E-mail Address \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name) PO Box 422, RR#4 Municipality Ashton Province On Postal Code K0A 1B0 Telephone No. (inc. area code) \_\_\_\_\_

Well Location

Address of Well Location (Street Number/Name) 691 Ballycastle Crescent Township Gloucester Lot P/L 29 Concession 3

County/District/Municipality Ottawa-Carleton City/Town/Village Gloucester Province Ontario Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other

NAD 83 18 452744 5013074 4M-1482 S/L 30

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m)	From	To
Grey	Clay			0'		25'
	Sand	☉ Cobble		25'		42'
Grey	Limestone			42'		90'
Grey	Limestone			90'		104'
Grey	Limestone			104'		110'

**Annular Space**

Depth Set at (m)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> )
From 52' To 0'	Neat cement	31.2

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify Not tested

If pumping discontinued, give reason:  
 Pump intake set at (m) 90

Pumping rate (l/min / GPM) 15

Duration of pumping \_\_\_\_\_ hrs + \_\_\_\_\_ min

Final water level end of pumping (m) 37.4"

If flowing give rate (l/min / GPM) \_\_\_\_\_

Recommended pump depth (m) 90'

Recommended pump rate (l/min / GPM) 15

Well production (l/min / GPM) 15

Disinfected?  Yes  No

Time (min)	Draw Down (m)		Recovery (m)	
	Water Level (m)	Time (min)	Water Level (m)	Time (min)
Static Level	11.8"		37.4"	
1	18.6	1	23.6	
2	18.7	2	20.1	
3	20.5	3	17.9	
4	22.1	4	16	
5	23.6	5	15	
10	27.6	10	11.8	
15	30	15	11.8	
20	31.5	20	11.8	
25	32.7	25	11.8	
30	33.7	30	11.8	
40	35.4	40	11.8	
50	36.6	50	11.8	
60	37.4"	60	11.8"	

**Method of Construction**

Cable Tool  Diamond  Rotary (Conventional)  Jetting  Rotary (Reverse)  Driving  Boring  Digging

Air percussion  Other, specify \_\_\_\_\_

**Well Use**

Public  Commercial  Not used  Domestic  Municipal  Dewatering  Livestock  Test Hole  Monitoring  Irrigation  Industrial  Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm)	Depth (m)	From	To
6 1/4"	Steel	.188	+2'		52'
5 15/16"	Open Hole			52'	110'

**Status of Well**

Water Supply  Replacement Well  Test Hole  Recharge Well  Dewatering Well  Observation and/or Monitoring Hole  Alteration (Construction)  Abandoned, Insufficient Supply  Abandoned, Poor Water Quality  Abandoned, other, specify \_\_\_\_\_  Other, specify \_\_\_\_\_

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	From	To

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____
90' (m)	
104' (m)	
(m/ft)	

**Hole Diameter**

Depth (m/ft)	Diameter (cm/in)
From 0' To 52'	9 3/4"
52' To 110'	5 15/16"

**Well Contractor and Well Technician Information**


Business Name of Well Contractor Air Rock Drilling Co. Ltd. Well Contractor's Licence No. 1119

Business Address (Street Number/Name) 6659 Franktown Road, RR#1 Municipality Richmond

Province ON Postal Code K0A 2Z0 Business E-mail Address air-rock@sympatico.ca

Bus. Telephone No. (inc. area code) 613-832-170 Name of Well Technician (Last Name, First Name) Hogan, Dan

Well Technician's Licence No. T3058 Signature of Technician and/or Contractor [Signature] Date Submitted 2017 05 31

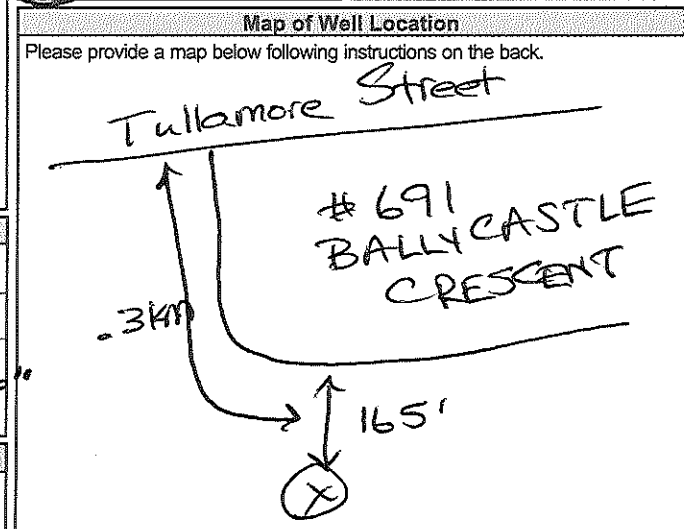

Comments: 1/2 HP - 10 GPM SET @ 90 FT

Well owner's information package delivered  Yes  No

Date Package Delivered 2017 05 04

Date Work Completed 2017 05 03

Ministry Use Only  
 Audit No. 2237355  
 JUN 07 2017  
 Received

Measurements recorded in:  Metric  Imperial

A209549

Address of Well Location (Street Number/Name) **485 Tullamore, St** Township **Ossode** Lot **40** Concession

County/District/Municipality **OTTAWA City** City/Town/Village **Greely** Province **Ontario** Postal Code **K1K1C8A4**

UTM Coordinates Zone **18N** Easting **452553** Northing **5013340** Municipal Plan and Sublot Number **419 1482**

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
Grey	Play	SAND	Soft	0	3.03
Grey	Play		Soft	3.03	9.69
Grey	limestone		Hard	9.69	49.09

Annular Space

Depth Set at (m/ft) From	Depth Set at (m/ft) To	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
0	13.03	Quik Vent	12 Bag

Results of Well Yield Testing

After test of well yield, water was:	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
<input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify				
If pumping discontinued, give reason:	Static Level	3.11		5.81
Pump intake set at (m/ft)	1	4.32	1	4.42
Pumping rate (l/min / GPM)	2	4.65	2	4.15
Duration of pumping	3	4.97	3	3.91
Final water level end of pumping (m/ft)	4	5.05	4	3.68
If flowing give rate (l/min / GPM)	5	5.15	5	3.49
Recommended pump depth (m/ft)	10	5.40	10	3.11
Recommended pump rate (l/min / GPM)	15	5.50	15	3.11
Well production (l/min / GPM)	20	5.59	20	3.11
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	25	5.63	25	3.11
	30	5.68	30	3.11
	40	5.73	40	3.11
	50	5.78	50	3.11
	60	5.81	60	3.11

Method of Construction

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse) AIR  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial

Other, specify

Construction Record - Casing

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
5.55	steel	0.48	1.51	13.03	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

Construction Record - Screen

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

Water Details


Water found at Depth (m/ft)	Kind of Water:	Hole Diameter
9.69 (m/ft)	<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft) From To Diameter (cm/in)
4303 (m/ft)	<input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	0 13.03 25.40
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0 49.09 15.55

Well Contractor and Well Technician Information

Business Name of Well Contractor: **DXR-WATER-well-Drilling** Well Contractor's Licence No.: **7526**

Business Address (Street Number/Name): **1763-Route 900 west** Municipality: **NATION**

Province: **ON** Postal Code: **K0A3C0** Business E-mail Address:

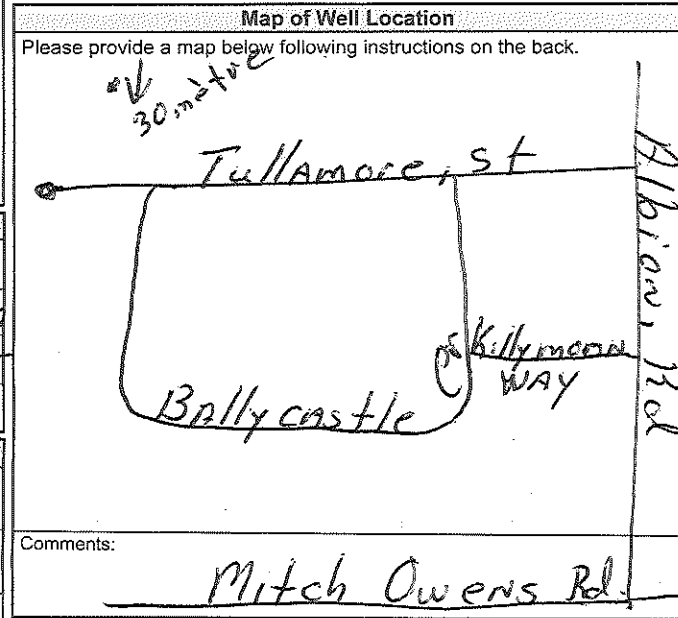

Well owner's information package delivered:  Yes  No

Date Package Delivered: **2017 08 31**

Date Work Completed: **2017 08 31**

Ministry Use Only

Audit No.: **2252212**

SEP 19 2017

Received



Measurements recorded in:  Metric  Imperial

A252801

Address of Well Location (Street Number/Name) **692 Ballycastle Crescent** Township **Gloucester** Lot **P/L 29** Concession **3 RF**

County/District/Municipality **Ottawa Carleton** City/Town/Village **Gloucester** Province **Ontario** Postal Code

UTM Coordinates Zone **18** Easting **452723** Northing **5013187** Municipal Plan and Sublot Number **4M-1482** Other **S/L4**

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
	Sand	Clay	Boulders	0'	37'
Grey	Limestone			37'	68'
Grey	Limestone			68'	95'
Grey	Limestone			95'	103'

**Annular Space**

Depth Set at (m/ft) From **47'** To **0**

Type of Sealant Used (Material and Type) **Neat cement**

Volume Placed (m<sup>3</sup>/ft<sup>3</sup>) **53.04**

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **Not tested**

If pumping discontinued, give reason:  
 **X**

Pump intake set at (m/ft) **80**

Pumping rate (l/min / GPM) **20**

Duration of pumping **1 hrs + 0 min**

Final water level end of pumping (m/ft) **45.4'**

If flowing give rate (l/min / GPM) **X**

Recommended pump depth (m/ft) **80'**

Recommended pump rate (l/min / GPM) **20**

Well production (l/min / GPM) **20**

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	11.5"		45.4"	
1	18.7	1	30.5	
2	22.5	2	25.1	
3	25.1	3	20.8	
4	27.5	4	18.3	
5	28.9	5	12.7	
10	38.1	10	11.5	
15	38.6	15	11.5	
20	41.5	20	11.5	
25	43.3	25	11.5	
30	44.9	30	11.5	
40	45.2	40	11.5	
50	45.4	50	11.5	
60	45.4"	60	11.5"	

**Method of Construction**

Cable Tool  Diamond  Rotary (Conventional)  Rotary (Reverse)  Boring  Air percussion  Other, specify

**Well Use**

Public  Domestic  Livestock  Irrigation  Industrial  Other, specify

Commercial  Municipal  Test Hole  Cooling & Air Conditioning  Not used  Dewatering  Monitoring

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
6 1/4"	Steel	.188"	+2'	47'	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify
6 1/8"	Open Hole		47'	103'	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft) From	Depth (m/ft) To

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Hole Diameter Depth (m/ft) From	Hole Diameter Diameter (cm/in) To
88	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0' 47'	9 3/4"
95	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	47' 103'	6 1/8"

**Well Contractor and Well Technician Information**


Business Name of Well Contractor **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No. **1119**

Business Address (Street Number/Name) **1005 Main Street RR#4** Municipality **Richmond**

Province **ON** Postal Code **K0A 2Z0** Business E-mail Address **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code) **6138382170** Name of Well Technician (Last Name, First Name) **Hogan, Dan**

Well Technician's Licence No. **15058** Signature of Technician and/or Contractor Date Submitted **2018 10 31**

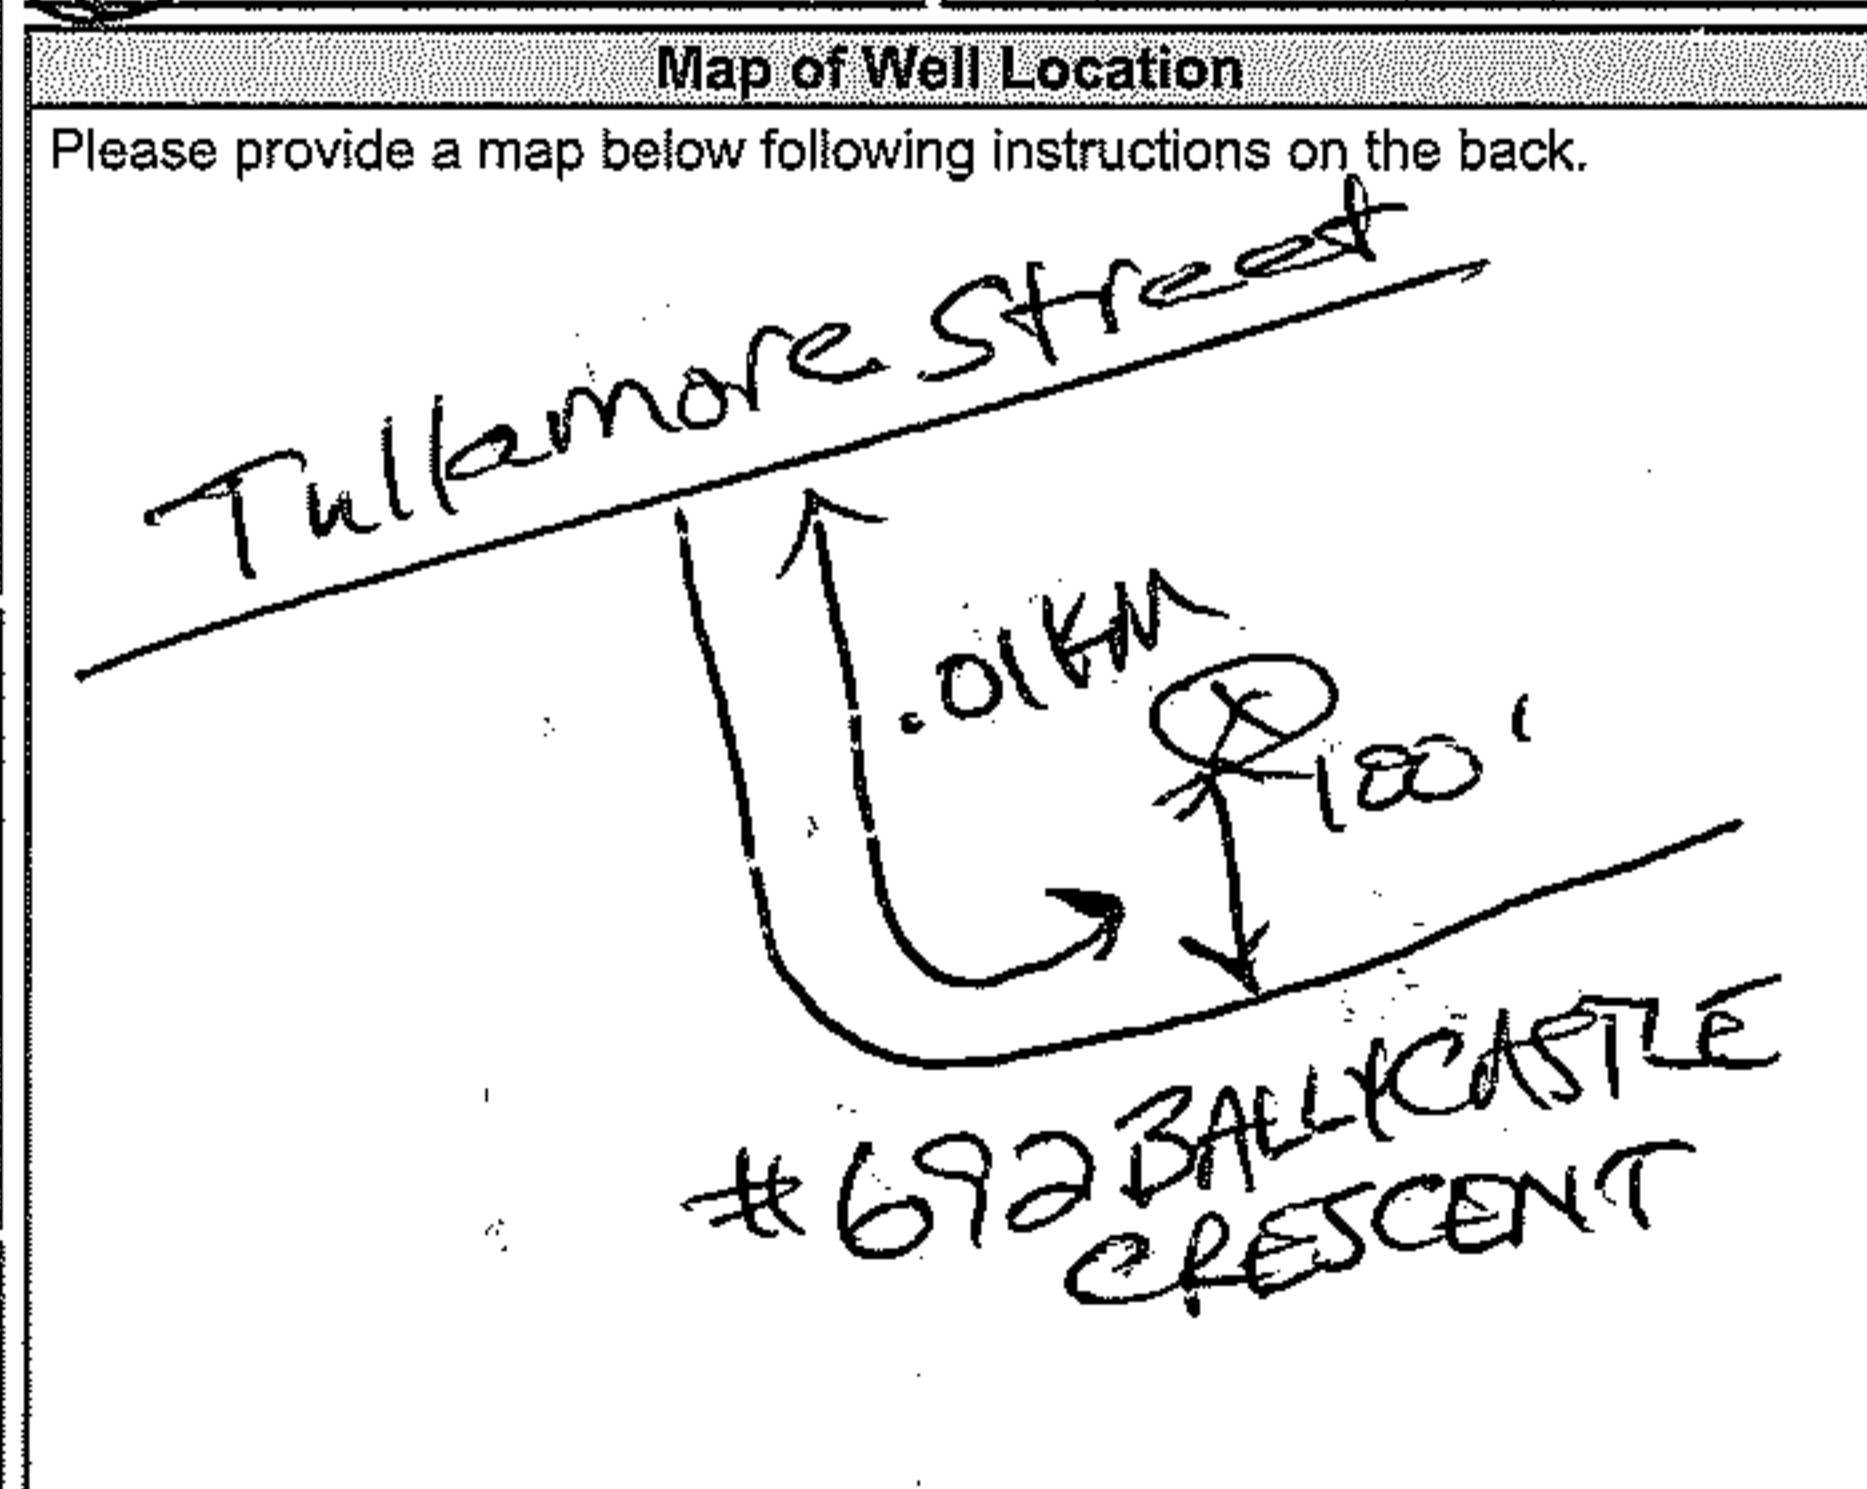

Comments: **1 HP 20 GPM SET AT 80 FEET**

Well owner's information package delivered  Yes  No

Date Package Delivered **2018 10 01**

Date Work Completed **2018 09 27**

**Ministry Use Only**

Audit No. **2276787**

**DEC 11 2018**

Received

## Map: Well records

This map allows you to search and view well record information from reported wells in Ontario.

Full dataset is available in the Open Data catalogue (<https://data.ontario.ca/dataset/well-records>).

[Go Back to Map](#)

### Well ID

Well ID Number: 7329110

Well Audit Number: Z302536

Well Tag Number: A260988

*This table contains information from the original well record and any subsequent updates.*

### Well Location

<b>Address of Well Location</b>	639 BALLYCASTE CRESCENT
<b>Township</b>	GLOUCESTER TOWNSHIP
<b>Lot</b>	030
<b>Concession</b>	RF 03
<b>County/District/Municipality</b>	OTTAWA-CARLETON
<b>City/Town/Village</b>	GLOUCESTER
<b>Province</b>	ON
<b>Postal Code</b>	n/a
<b>UTM Coordinates</b>	NAD83 — Zone 18 Easting: 453258.00 Northing: 5013264.00
<b>Municipal Plan and Sublot Number</b>	
<b>Other</b>	

### Overburden and Bedrock Materials Interval

General Colour	Most Common Material	Other Materials	General Description	Depth From	Depth To
	SAND	CLAY	BLDR	0 ft	40 ft
GREY	SNDS			40 ft	110 ft
GREY	SNDS			110 ft	113 ft
GREY	SNDS			113 ft	120 ft

### Annular Space/Abandonment Sealing Record

Depth From	Depth To	Type of Sealant Used (Material and Type)	Volume Placed
50 ft	0 ft	NEAT CEMENT	

**Method of Construction & Well Use**

Method of Construction	Well Use
Air Percussion	
	Domestic

**Status of Well**

Water Supply

**Construction Record - Casing**

Inside Diameter	Open Hole or material	Depth From	Depth To
6.25 Inch	STEEL	-2 ft	50 ft
5.875 Inch	OPEN HOLE	50 ft	120 ft

**Construction Record - Screen**

Outside Diameter	Material	Depth From	Depth To

**Well Contractor and Well Technician Information**

Well Contractor's Licence Number: 1119

**Results of Well Yield Testing**

After test of well yield, water was	OTHER
If pumping discontinued, give reason	
Pump intake set at	100 ft
Pumping Rate	20 GPM
Duration of Pumping	1 h:0 m
Final water level	14.25 ft
If flowing give rate	
Recommended pump depth	100 ft
Recommended pump rate	20 GPM



<b>Well Production</b>	
<b>Disinfected?</b>	Y

**Draw Down & Recovery**

Draw Down Time(min)	Draw Down Water level	Recovery Time(min)	Recovery Water level
SWL	12.417 ft		
1	13.7 ft	1	13.3 ft
2	13.7 ft	2	12.8 ft
3	13.7 ft	3	12.5 ft
4	13.8 ft	4	12.5 ft
5	13.8 ft	5	12.5 ft
10	14 ft	10	12.5 ft
15	14.1 ft	15	12.5 ft
20	14.1 ft	20	12.5 ft
25	14.1 ft	25	12.5 ft
30	14.2 ft	30	12.5 ft
40	14.2 ft	40	12.5 ft
45		45	
50	14.2 ft	50	12.5 ft
60	14.3 ft	60	12.5 ft

**Water Details**

Water Found at Depth	Kind
10 ft	Untested
113 ft	Untested

**Hole Diameter**

Depth From	Depth To	Diameter
0 ft	50 ft	9.75 Inch
50 ft	120 ft	5.875 Inch

**Audit Number:** Z302536

**Date Well Completed:** January 15, 2019

**Date Well Record Received by MOE:** February 22, 2019

#### Related

How to use a Ministry of the Environment map (<https://www.ontario.ca/page/how-use-ministry-environment-map#wells>)

Technical documentation: Metadata record (<https://data.ontario.ca/dataset/well-records/resource/3031344e-e3f2-48d5-888c-c1deadfd2f77>)

Address of Well Location (Street Number/Name) <b>655 Ballycastie Crescent</b>		Township <b>Gloucester</b>	Lot <b>21</b>	Concession <b>30</b>
County/District/Municipality <b>Ottawa Carleton</b>		City/Town/Village <b>Ottawa</b>	Province <b>Ontario</b>	Postal Code <b>K1X 0A3</b>
UTM Coordinates NAD <b>83</b>	Zone <b>18</b>	Easting <b>751870</b>	Northing <b>4549180</b>	Municipal Plan and Sublot Number <b>Plan 4M-1482</b>

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)						
General Colour	Most Common Material	Other Materials	General Description		Depth (m/ft)	
					From	To
Brown	Sand				0	10'
Grey	Clay with stones				10'	47'
Grey	Fractured limestone				42'	45'
Grey	met limestone				45'	80'

Annular Space		
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From	To	
49'	0'	15 bags cement 8 bags Quik grow

Results of Well Yield Testing					
After test of well yield, water was:		Draw Down		Recovery	
<input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____		Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:		Static Level	16.1		16.8
Pump intake set at (m/ft) <b>50 ft</b>		1	16.2	1	16.5
Pumping rate (l/min / GPM) <b>20 gpm</b>		2	16.2	2	16.3
Duration of pumping <b>1 hrs + 0 min</b>		3	16.3	3	16.2
Final water level end of pumping (m/ft)		4	16.3	4	16.2
If flowing give rate (l/min / GPM)		5	16.4	5	16.2
Recommended pump depth (m/ft) <b>50 ft</b>		10	16.5	10	16.2
Recommended pump rate (l/min / GPM) <b>20 gpm</b>		15	16.7	15	16.2
Well production (l/min / GPM) <b>+75 gpm</b>		20	16.8	20	16.2
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <b>35</b>		25	16.8	25	16.2
		30	16.8	30	16.2
		40	16.8	40	16.2
		50	16.8	50	16.2
		60	16.8	60	16.2

Method of Construction		Well Use	
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial	
<input type="checkbox"/> Other, specify _____		<input type="checkbox"/> Other, specify _____	


Construction Record - Casing			Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	
			From	To
6 1/8	steel	<del>188</del> 188	49'	51' +2'

Construction Record - Screen				
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
		From	To
59' (m/ft)	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	49'	0
65' (m/ft)	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	49'	80

Well Contractor and Well Technician Information	
Business Name of Well Contractor <b>Olympic Drilling Co Ltd</b>	Well Contractor's Licence No. <b>40016</b>
Business Address (Street Number/Name) <b>6662 Bank Street</b>	Municipality <b>Ottawa</b>
Province <b>ont</b>	Postal Code <b>K1A2P0</b>

Bus. Telephone No. (inc. area code) <b>613 229 8371</b>	Name of Well Technician (Last Name, First Name) <b>Wayne Renwick</b>
Well Technician's Licence No. <b>0327</b>	Signature of Technician and/or Contractor <b>Wayne Renwick</b>
	Date Submitted <b>20180718</b>

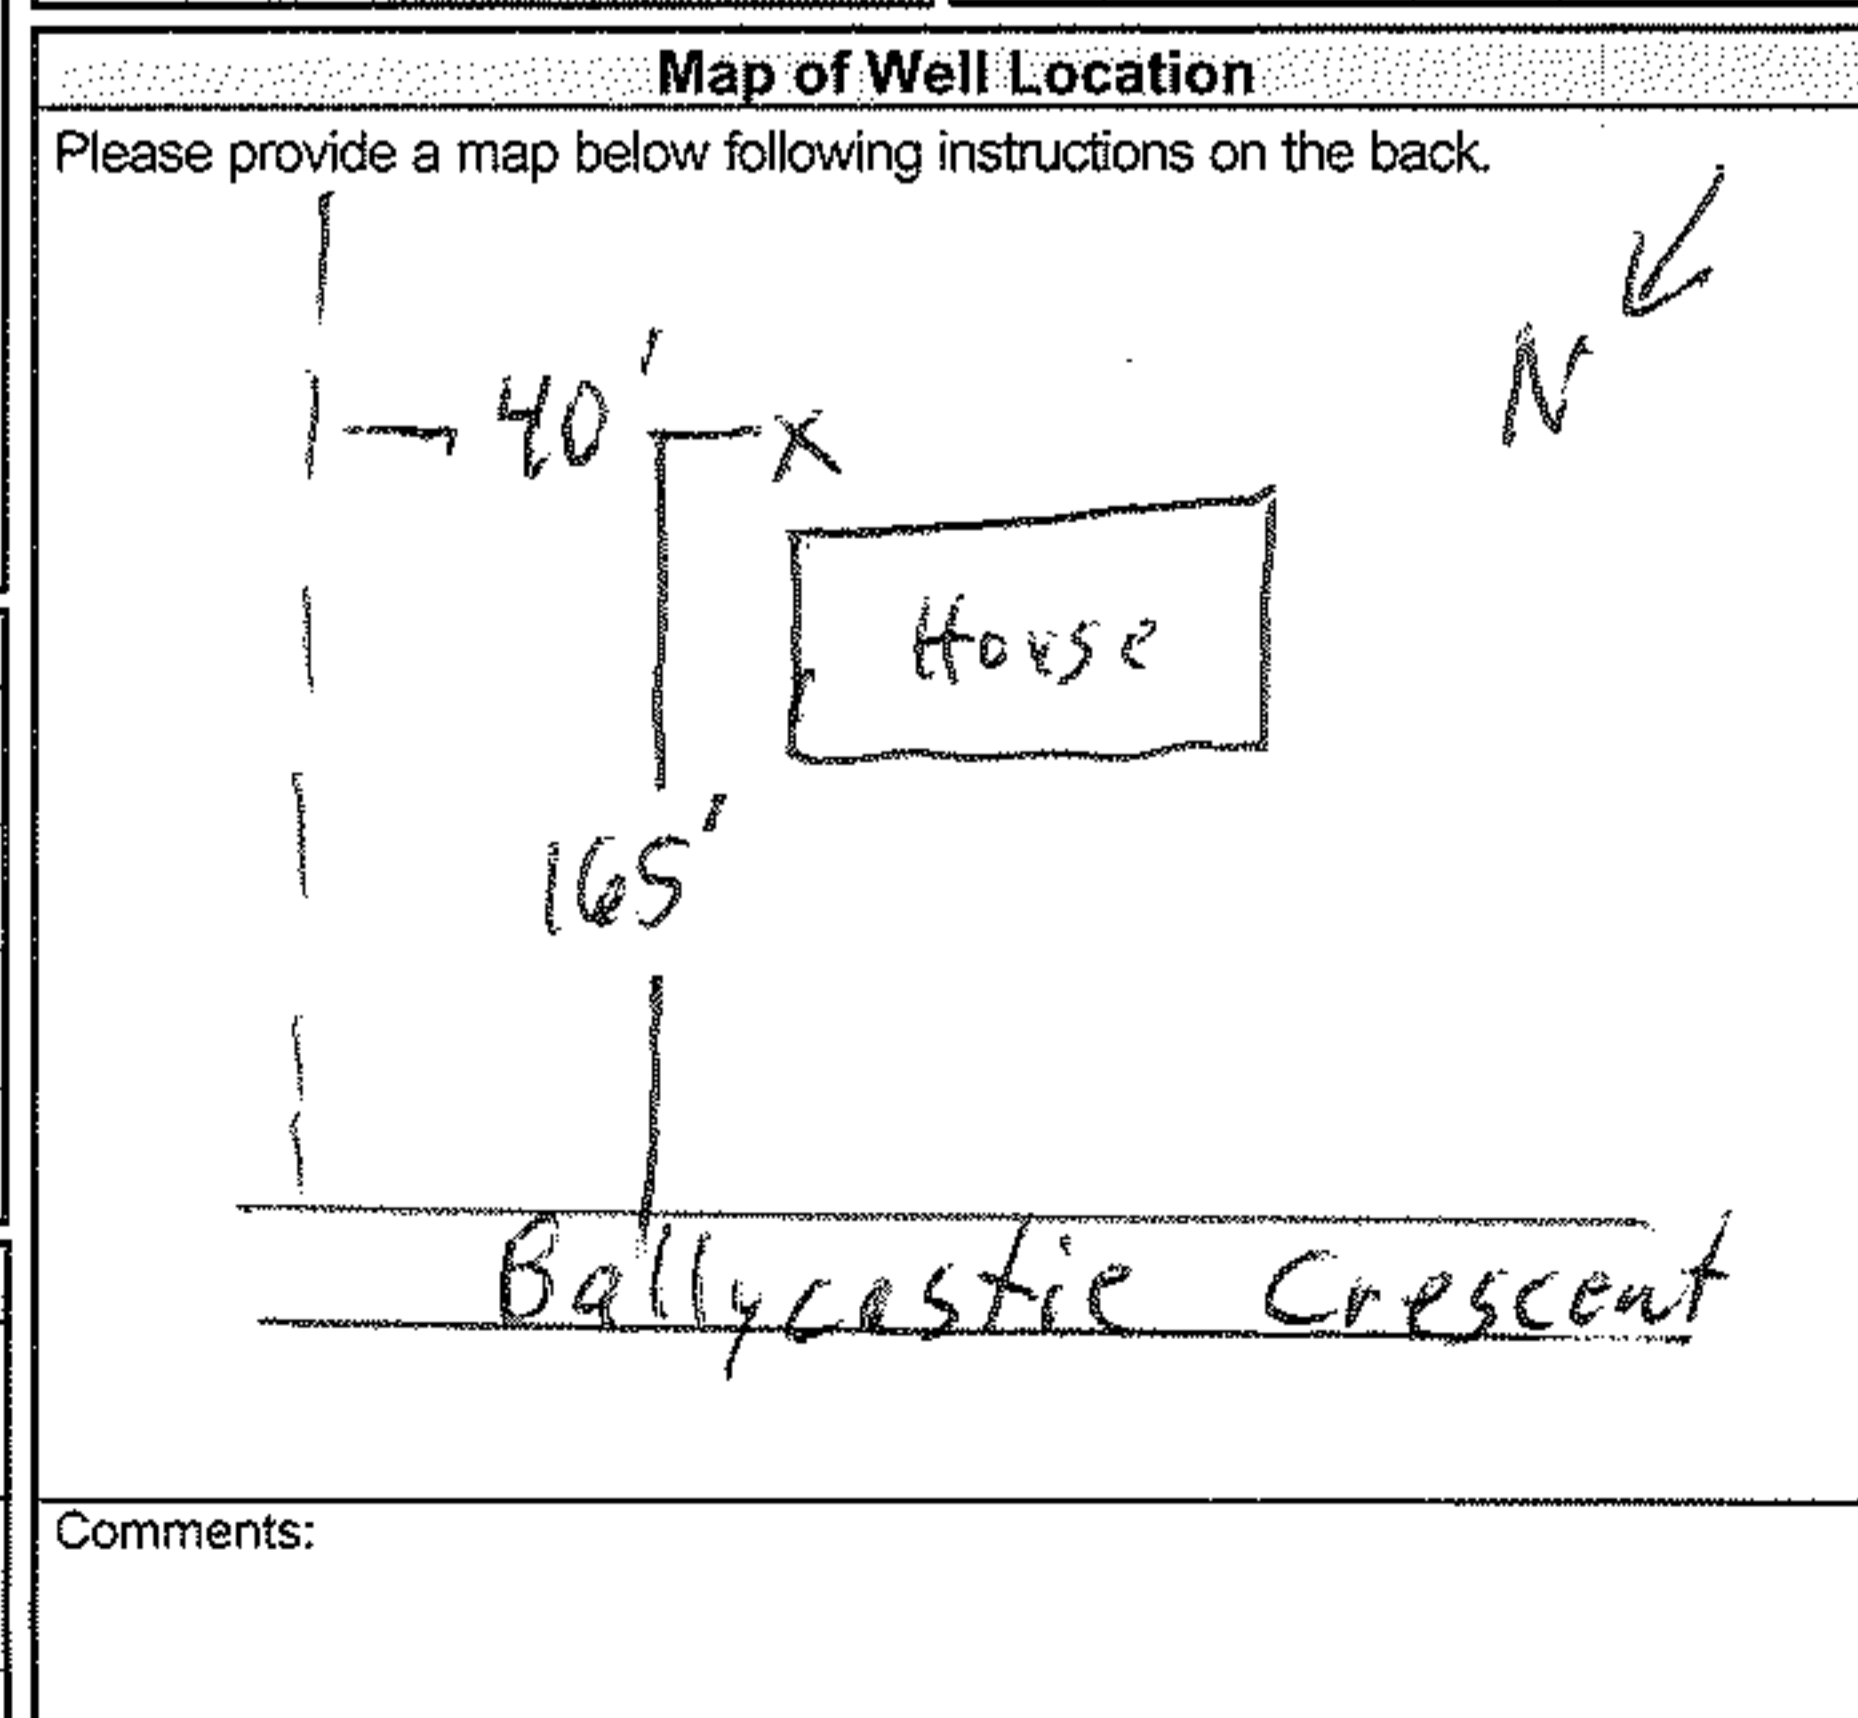

Well owner's information package delivered	Date Package Delivered	Ministry Use Only	
	Y Y Y Y   M M   D D	Audit No.	REAS
<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<b>20180718</b>	<b>2177453</b>	<b>APR 01 2019</b>



Measurements recorded in:  Metric  Imperial

Well  at Below A252912

Page \_\_\_ of \_\_\_

**Well Location**

Address of Well Location (Street Number/Name): # 680 BALLYCASTLE CRESCENT  
 Township: Gloucester  
 Lot: 1482  
 Concession: 3

County/District/Municipality: OTTAWA-CARLETON  
 City/Town/Village: Gloucester  
 Province: Ontario  
 Postal Code: \_\_\_\_\_

JTM Coordinates Zone Easting Northing  
 NAD 83 184528435013188  
 Municipal Plan and Sublot Number: 4M-1482  
 Other: S/L # 7

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
From	To			From To
	Sand, Clay & Gravel			0' 41'
	Black & Grey Limestone			41' 83'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From To		
51' 0'	Neat Cement Slurry	28.08

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify \_\_\_\_\_

If pumping discontinued, give reason:  \_\_\_\_\_

Pump intake set at (m/ft): 75'

Pumping rate (l/min / GPM): 20

Duration of pumping: 1 hrs + 0 min

Final water level end of pumping (m/ft): 6' 7"

If flowing give rate (l/min / GPM):  \_\_\_\_\_

Recommended pump depth (m/ft): 70'

Recommended pump rate (l/min / GPM): 20

Well production (l/min / GPM): 20

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level	5' 1"		6' 7"	
1	5.9	1	5' 1"	
2	6.1	2	5' 1"	
3	6.1	3		
4	6.2	4		
5	6.3	5		
10	6.5	10		
15	6.6	15		
20	6.6	20		
25	6.7	25		
30	6.7"	30		
40		40		
50		50		
60		60		

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
6 1/4"	Steel	.188"	2' 51'		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
6"	Open hole		51' 83'		

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To


**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
69 (m/ft)	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	0' 51'	9 3/4"
77 (m/ft)	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	51' 83'	6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: AIR ROCK DRILLING CO LTD  
 Well Contractor's Licence No.: C7681  
 Business Address (Street Number/Name): 6659 Franktown Road  
 Municipality: Richmond  
 Province: Ont  
 Postal Code: K6A2Z0  
 Business E-mail Address: \_\_\_\_\_

Bus. Telephone No. (inc. area code): 6138882170  
 Name of Well Technician (Last Name, First Name): HOGAN DAN  
 Well Technician's Licence No.: T3058  
 Signature of Technician and/or Contractor: \_\_\_\_\_  
 Date Submitted: 2020/04/20

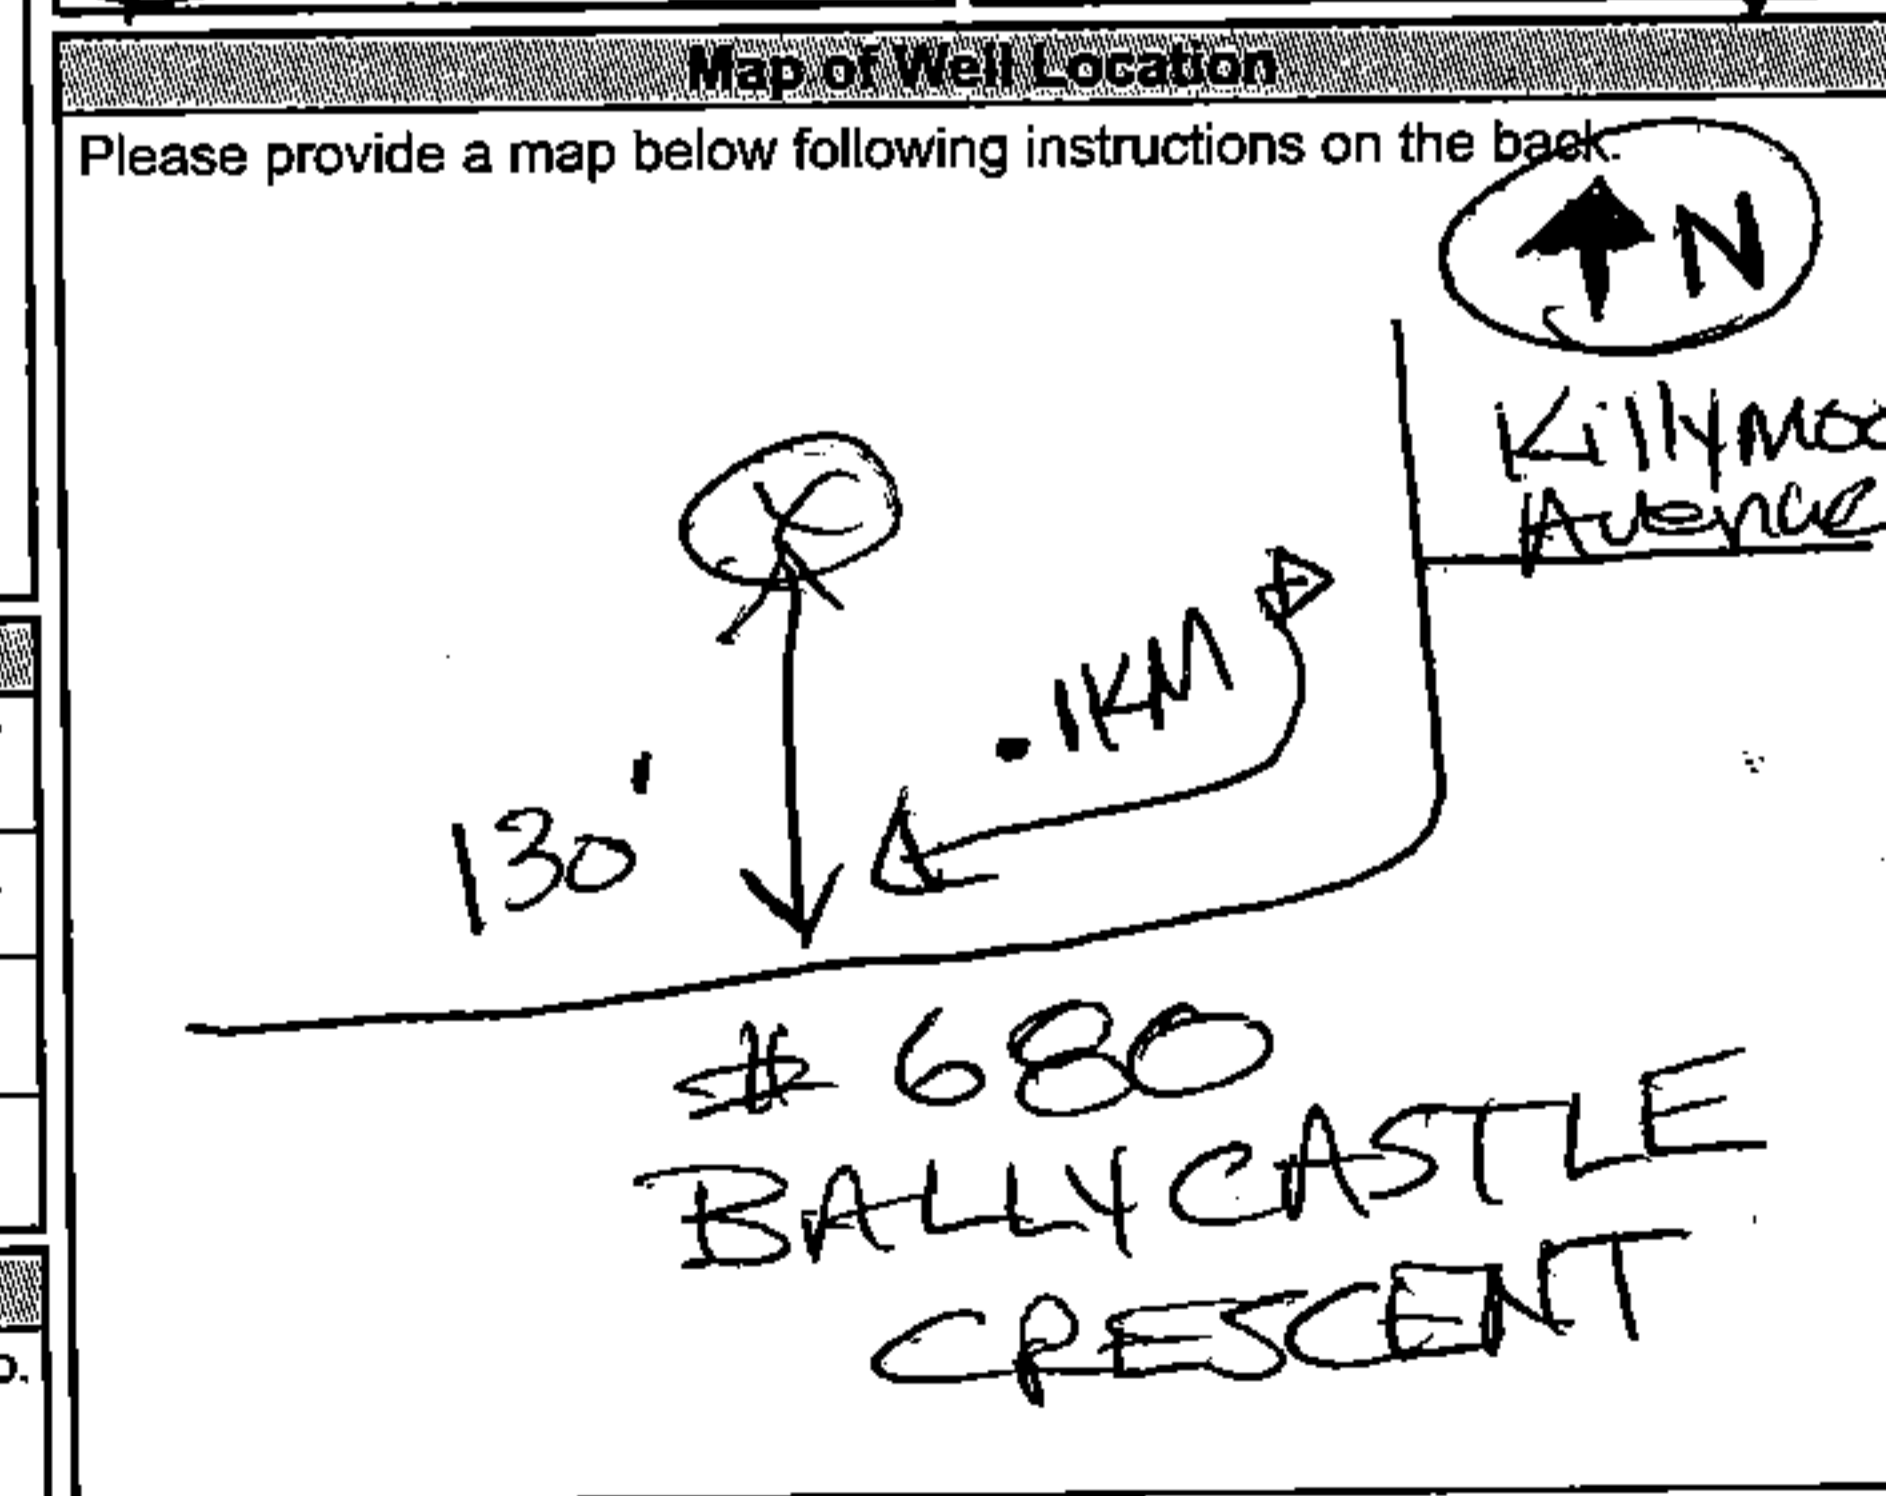

Comments: 3/4HP-15GPM Set 70 FT

Well owner's information package delivered:  Yes  No

Date Package Delivered: 2020/04/14  
 Date Work Completed: 2020/04/20

**Ministry Use Only**

Audit No: Z302625  
 Received: MAY 28 2020

**ATTACHMENT F**  
**Camera Inspection – On-Site Supply Well**



---

**3831 Carp Road  
Carp, Ontario K0A 1L0  
613-839-5550  
contact@well-water.ca**

## Camera Inspection Report

Date: November 28, 2023

Location: 5546 Albion Road South, Ottawa, Ontario K1X 1A8

Job #: 4335

[Click Here to View or Download Video](#)

If link will not function use the following URL:

[https://drive.google.com/file/d/1cl16E3\\_wy75-SKd\\_Ly3VUB9Q3cC9cDnY/view?usp=sharing](https://drive.google.com/file/d/1cl16E3_wy75-SKd_Ly3VUB9Q3cC9cDnY/view?usp=sharing)

**Please download a copy of your video within 30 days of the inspection date. The video will be deleted after 30 days from our system. We do not keep an archived copy.**

---

### Timeline

- 0 Minutes 16 Seconds - Camera enters well at top of casing.
- 0 Minutes 38 Seconds - 5ft TOC Pitless adapter visible.
- 0 Minutes 55 Seconds - Static water level reached at 9ft 2in TOC.
- 0 Minutes 58 Seconds - 10ft TOC Iron build up is visible on the casing.
- 1 Minutes 20 Seconds - 15ft TOC
- 1 Minutes 43 Seconds - 20ft TOC Very poor visibility due to turbidity.
- 2 Minutes 04 Seconds - 25ft TOC
- 2 Minutes 26 Seconds - 30ft TOC
- 2 Minutes 47 Seconds - 35ft TOC
- 3 Minutes 09 Seconds - 40ft TOC
- 3 Minutes 29 Seconds - 45ft TOC Visibility starts to improve. Possible Biofilm visible.
- 3 Minutes 50 Seconds - 50ft TOC
- 4 Minutes 11 Seconds - 55ft TOC Heavy build up on side of well.

- 4 Minutes 30 Seconds - Transition from casing to open hole.
- 4 Minutes 32 Seconds - 60ft TOC Open hole clearly visible.
- 4 Minutes 57 Seconds - 65ft TOC
- 5 Minutes 18 Seconds - 70ft TOC
- 5 Minutes 30 Seconds - Approx. 73ft TOC Pump set depth reached, unable to proceed further down well.
- 5 Minutes 51 Seconds - Camera retrieval begins.
- 7 Minutes 05 Seconds - Camera exits well.

TOC = Top of Casing

Notes:

There appears to be approximately 60ft of casing from TOC to transition to open hole. Well casing is currently less than 16" above grade and should be extended and have a vermin proof well cap installed as per Ontario Regulation 903. Typically casing is sold in 20ft lengths so it is very likely they used three full lengths of casing in the construction of the well.

We are unable to verify the annular space seal via camera inspection or casing depth sensor inspection. Annular space would need to be dug and disturbed to establish if and how much grout was used to seal the annular space. No grout was visible at the grade.



# INVOICE #6512

ISSUED:  
Nov 28, 2023

DUE:  
Dec 28, 2023

**RECIPIENT:**

**LRL Engineering**

5430 Canotek Rd  
Ottawa, Ontario K1J 9G2

**SENDER:**

**PV Plumbing & Water Inc.**

3831 Carp Road  
Carp, Ontario K0A 1L0

**SERVICE ADDRESS:**

5546 Albion Road South  
Gloucester  
Ottawa, Ontario K1X 1A8

Phone: 613-839-5550  
Email: contact@pvplumbingwater.com

## For Services Rendered

Product/Service	Description	Qty.	Unit Price	Total
<b>Nov 28, 2023</b>				
WL / Well Inspection / Camera Inspection	Camera inspection of a well. Includes a report and video.  Please note that if the pump remains in the well there is a risk that the camera can get stuck. If this happens pulling the pump to retrieve the camera is completed at additional cost.	1	\$495.00	\$495.00
WL / Inspection / Standard	Ontario Regulation 903. Compliance Inspection (grouting as visible from surface)***	1	\$50.00	\$50.00

Thank you for your business!

Standard One Year Parts and Labour Warranty  
Warranty expires 365 days following service date on invoice.  
All parts must be supplied and installed by us to be covered under warranty.  
Please retain a copy of your invoice for verification purposes.

PV Well Water is a PV Plumbing & Water Inc. Brand.

HST/GST Number 784916934RT0001

Subtotal	\$545.00
HST (13.0%)	\$70.85
<b>Total</b>	<b>\$615.85</b>

**Pay Now**



**ATTACHMENT G**  
**Pumping Test – Field Data**

**Pump Test Data - MacEwen Petroleum Inc.**  
**Hydrogeological Assessment & Terrain Analysis - Proposed Fuel Dispensing Facility Re-Development**  
 5546 Albion Road, Ottawa, Ontario  
 LRL File No. 01348

<b>Date:</b>	October 16 & 17, 2022	<b>Technician:</b>	A. Kader
<b>Well Number:</b>	1501841	<b>Pump Depth (m BTC):</b>	22.5
<b>Depth of Well (m BTC):</b>	41.40	<b>Start Time:</b>	9:00 PM 16-Oct-22
<b>Ground Surface Elev. (m):</b>	Not Measured	<b>End Time:</b>	3:10 AM 17-Oct-22
<b>Top of Casing Elev. (m):</b>	Not Measured	<b>Average Pump Rate (L/min):</b>	30.0
<b>Water Level before Pump In (m BTC)</b>	2.98		

Time <sup>1</sup> (min)	Water Level (Pump In) (m BTC)	Drawdown (m)	Flow Rate (L/min)	Turbidity (NTU)	Residual Chlorine (mg/L)	Field Parameters			Total Dissolved (mg/L)
						Colour (TCU)	pH	Conductivity (µs)	
0.0	2.98	0.00	30.0						
0.5	3.79	0.81	30.0						
1.0	3.60	0.62	30.0						
1.5	3.72	0.74	30.0						
2.0	3.81	0.83	30.0						
2.5	3.91	0.93	30.0						
3.0	3.96	0.98	30.0						
3.5	4.01	1.03	30.0						
4.5	4.06	1.08	30.0						
5.0	4.07	1.09	30.0						
6.0	4.11	1.13	30.0						
7.0	4.13	1.15	30.0						
8.0	4.15	1.17	30.0						
9.0	4.17	1.19	30.0						
10.0	4.19	1.21	30.0						
20.0	4.26	1.28	30.0						
30.0	4.28	1.30	30.0						
60.0	4.30	1.32	30.0	1.14	0.0	27	8.25	463	233
90.0	4.30	1.32	30.0						
120.0	4.30	1.32	30.0	0.74	0.0	29	8.13	471	239
150.0	4.30	1.32	30.0						
180.0	4.30	1.32	30.0	0.31	0.0	22	8.07	484	242
240.0	6.48	3.50	30.0	0.98	0.0	73	7.99	513	258
300.0	4.42	1.44	30.0	0.99	0.0	29	8.07	513	254
360.0	4.53	1.55	30.0	0.27	0.0	13	8.12	519	257
<b>Recovery</b>				<b>% Recovery</b>					
0 (370)	4.53	1.55		0.0					
0.5	3.86	0.88		43.2					
1.0	3.61	0.63		59.4					
1.6	3.48	0.50		67.7					
2.0	3.41	0.43		72.3					
2.5	3.33	0.35		77.4					
3.0	3.28	0.30		80.6					
3.5	3.24	0.26		83.2					
4.0	3.22	0.24		84.5					
4.5	3.19	0.21		86.5					
5.0	3.17	0.19		87.7					
6.0	3.15	0.17		89.0					
7.0	3.13	0.15		90.3					
8.0	3.11	0.13		91.6					
9.0	3.10	0.12		92.3					
10.0	3.09	0.11		92.9					
20.0	3.05	0.07		95.5					
30.0	3.02	0.04		97.4					
60.0	3.02	0.04		97.4					

<sup>1</sup> Time elapse from pump turning on or off.

**BTC:** Below Top of Casing

**ATTACHMENT H**  
**Pumping Test – Theis Analysis**



LRL Associates Ltd.  
5430 Canotek Road  
Ottawa, Ontario

**LRL**

**Pumping Test Analysis Report**

Project: Hydrogeological Assessment & Terrain Anlysis - Proposed Fuel Dispensing Facility

Number: 01348


Client: MacEwen Petroleum Inc.

Location: 5546 Albion Road, Ottawa, Ontario	Pumping Test: Well 1501841	Pumping Well: 1501841
---	----------------------------	-----------------------

Test Conducted by: LRL Associates	Test Date: 2023-01-09
-----------------------------------	-----------------------

Analysis Performed by: LRL Associates	Drawdown	Analysis Date: 2023-01-09
---------------------------------------	----------	---------------------------

Aquifer Thickness:	Discharge Rate: 30 [l/s]
--------------------	--------------------------

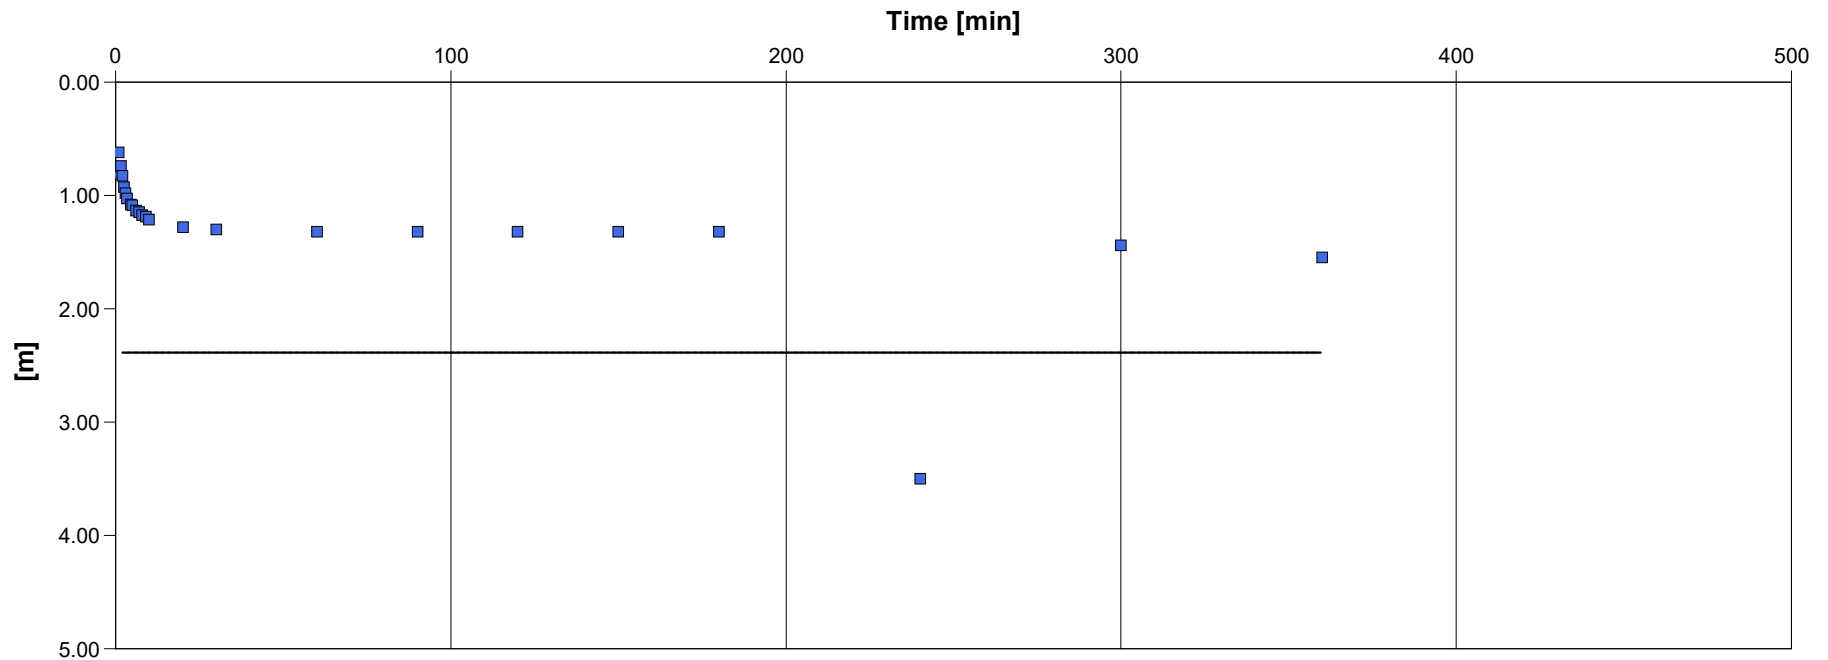

Calculation using Theis

Observation Well	Transmissivity [m <sup>2</sup> /s]	Storage coefficient	Radial Distance to PW [m]
1501841	1.00 × 10 <sup>-3</sup>	1.00 × 10 <sup>-4</sup>	

**ATTACHMENT I**  
**Laboratory Certificate of Analysis**

## Certificate of Analysis

**LRL Associates Ltd.**

5430 Canotek Road  
Ottawa, ON K1J 9G2  
Attn: Abdul Kader Alhaj

Client PO:  
Project: 01348  
Custody: 17463

Report Date: 24-Oct-2022  
Order Date: 17-Oct-2022

**Order #: 2243028**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted :

Parcel ID	Client ID
2243028-01	5546 Albion Rd - Supply Well - 3 hrs
2243028-02	5546 Albion Rd - Supply Well - 6 hrs

Approved By:



Dale Robertson, BSc  
Laboratory Director

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 24-Oct-2022  
 Order Date: 17-Oct-2022  
 Project Description: 01348

**Analysis Summary Table**

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Alkalinity, total to pH 4.5	EPA 310.1 - Titration to pH 4.5	18-Oct-22	18-Oct-22
Ammonia, as N	EPA 351.2 - Auto Colour	18-Oct-22	18-Oct-22
Anions	EPA 300.1 - IC	19-Oct-22	19-Oct-22
Colour	SM2120 - Spectrophotometric	17-Oct-22	17-Oct-22
Conductivity	EPA 9050A- probe @25 °C	18-Oct-22	18-Oct-22
Dissolved Organic Carbon	MOE E3247B - Combustion IR, filtration	18-Oct-22	18-Oct-22
E. coli	MOE E3407	18-Oct-22	18-Oct-22
Fecal Coliform	SM 9222D	18-Oct-22	18-Oct-22
Heterotrophic Plate Count	SM 9215C	18-Oct-22	18-Oct-22
Metals, ICP-MS	EPA 200.8 - ICP-MS	19-Oct-22	19-Oct-22
pH	EPA 150.1 - pH probe @25 °C	18-Oct-22	18-Oct-22
Phenolics	EPA 420.2 - Auto Colour, 4AAP	18-Oct-22	18-Oct-22
Hardness	Hardness as CaCO <sub>3</sub>	19-Oct-22	19-Oct-22
Sulphide	SM 4500SE - Colourimetric	19-Oct-22	19-Oct-22
Tannin/Lignin	SM 5550B - Colourimetric	17-Oct-22	17-Oct-22
Total Coliform	MOE E3407	18-Oct-22	18-Oct-22
Total Dissolved Solids	SM 2540C - gravimetric, filtration	17-Oct-22	18-Oct-22
Total Kjeldahl Nitrogen	EPA 351.2 - Auto Colour, digestion	18-Oct-22	19-Oct-22
Turbidity	SM 2130B - Turbidity meter	17-Oct-22	17-Oct-22
VOCs by P&T GC-MS	EPA 624 - P&T GC-MS	18-Oct-22	18-Oct-22

Certificate of Analysis

Report Date: 24-Oct-2022

Client: LRL Associates Ltd.

Order Date: 17-Oct-2022

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Rd - Supply Well - 3 hrs	5546 Albion Rd - Supply Well - 6 hrs	-	-
<b>Sample Date:</b>	17-Oct-22 00:05	17-Oct-22 03:05	-	-
<b>Sample ID:</b>	2243028-01	2243028-02	-	-
<b>MDL/Units</b>	Drinking Water	Drinking Water	-	-

**Microbiological Parameters**

E. coli	1 CFU/100mL	ND	ND	-	-
Fecal Coliforms	1 CFU/100mL	ND	ND	-	-
Total Coliforms	1 CFU/100mL	4	2	-	-
Heterotrophic Plate Count	10 CFU/mL	10	10	-	-

**General Inorganics**

Alkalinity, total	5 mg/L	189	198	-	-
Ammonia as N	0.01 mg/L	0.02	0.03	-	-
Dissolved Organic Carbon	0.5 mg/L	0.9	0.9	-	-
Colour	2 TCU	<2	<2	-	-
Conductivity	5 uS/cm	534	584	-	-
Hardness	mg/L	204	219	-	-
pH	0.1 pH Units	8.0	8.0	-	-
Phenolics	0.001 mg/L	<0.001	<0.001	-	-
Total Dissolved Solids	10 mg/L	300	336	-	-
Sulphide	0.02 mg/L	<0.02	0.12	-	-
Tannin & Lignin	0.1 mg/L	<0.1	<0.1	-	-
Total Kjeldahl Nitrogen	0.1 mg/L	0.1	<0.1	-	-
Turbidity	0.1 NTU	4.2	8.8	-	-

**Anions**

Chloride	1 mg/L	23 [5]	30 [5]	-	-
Fluoride	0.1 mg/L	0.2 [5]	0.1 [5]	-	-
Nitrate as N	0.1 mg/L	<0.1 [5]	<0.1 [5]	-	-
Nitrite as N	0.10 mg/L	<0.10 [5]	<0.10 [5]	-	-
Sulphate	1 mg/L	51 [5]	56 [5]	-	-

**Metals**

Calcium	0.1 mg/L	50.3	54.3	-	-
Iron	0.1 mg/L	0.4	0.9	-	-
Magnesium	0.2 mg/L	19.2	20.3	-	-
Manganese	0.005 mg/L	0.019	0.029	-	-
Potassium	0.1 mg/L	1.8	1.9	-	-
Sodium	0.2 mg/L	15.3	17.1	-	-

**Volatiles**

Acetone	5.0 ug/L	-	<5.0	-	-
Benzene	0.5 ug/L	-	<0.5	-	-



Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 24-Oct-2022  
 Order Date: 17-Oct-2022  
 Project Description: 01348

	MDL/Units	Client ID: 5546 Albion Rd - Supply Well - 3 hrs Sample Date: 17-Oct-22 00:05 Sample ID: 2243028-01 Drinking Water	5546 Albion Rd - Supply Well - 6 hrs Sample Date: 17-Oct-22 03:05 Sample ID: 2243028-02 Drinking Water	-	-
Bromodichloromethane	0.5 ug/L	-	<0.5	-	-
Bromoform	0.5 ug/L	-	<0.5	-	-
Bromomethane	0.5 ug/L	-	<0.5	-	-
Carbon Tetrachloride	0.2 ug/L	-	<0.2	-	-
Chlorobenzene	0.5 ug/L	-	<0.5	-	-
Chloroethane	1.0 ug/L	-	<1.0	-	-
Chloroform	0.5 ug/L	-	<0.5	-	-
Chloromethane	3.0 ug/L	-	<3.0	-	-
Dibromochloromethane	0.5 ug/L	-	<0.5	-	-
Dichlorodifluoromethane	1.0 ug/L	-	<1.0	-	-
1,2-Dibromoethane	0.2 ug/L	-	<0.2	-	-
1,2-Dichlorobenzene	0.5 ug/L	-	<0.5	-	-
1,3-Dichlorobenzene	0.5 ug/L	-	<0.5	-	-
1,4-Dichlorobenzene	0.5 ug/L	-	<0.5	-	-
1,1-Dichloroethane	0.5 ug/L	-	<0.5	-	-
1,2-Dichloroethane	0.5 ug/L	-	<0.5	-	-
1,1-Dichloroethylene	0.5 ug/L	-	<0.5	-	-
cis-1,2-Dichloroethylene	0.5 ug/L	-	<0.5	-	-
trans-1,2-Dichloroethylene	0.5 ug/L	-	<0.5	-	-
1,2-Dichloroethylene, total	0.5 ug/L	-	<0.5	-	-
1,2-Dichloropropane	0.5 ug/L	-	<0.5	-	-
cis-1,3-Dichloropropylene	0.5 ug/L	-	<0.5	-	-
trans-1,3-Dichloropropylene	0.5 ug/L	-	<0.5	-	-
1,3-Dichloropropene, total	0.5 ug/L	-	<0.5	-	-
Ethylbenzene	0.5 ug/L	-	<0.5	-	-
Hexane	1.0 ug/L	-	<1.0	-	-
Methyl Ethyl Ketone (2-Butanone)	5.0 ug/L	-	<5.0	-	-
Methyl Butyl Ketone (2-Hexanone)	10.0 ug/L	-	<10.0	-	-
Methyl Isobutyl Ketone	5.0 ug/L	-	<5.0	-	-
Methyl tert-butyl ether	2.0 ug/L	-	<2.0	-	-
Methylene Chloride	5.0 ug/L	-	<5.0	-	-
Styrene	0.5 ug/L	-	<0.5	-	-
1,1,1,2-Tetrachloroethane	0.5 ug/L	-	<0.5	-	-
1,1,2,2-Tetrachloroethane	0.5 ug/L	-	<0.5	-	-
Tetrachloroethylene	0.5 ug/L	-	<0.5	-	-

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 24-Oct-2022  
 Order Date: 17-Oct-2022  
 Project Description: 01348

	MDL/Units	5546 Albion Rd - Supply Well - 3 hrs 17-Oct-22 00:05 2243028-01 Drinking Water	5546 Albion Rd - Supply Well - 6 hrs 17-Oct-22 03:05 2243028-02 Drinking Water	-	-
Toluene	0.5 ug/L	-	<0.5	-	-
1,1,1-Trichloroethane	0.5 ug/L	-	<0.5	-	-
1,1,2-Trichloroethane	0.5 ug/L	-	<0.5	-	-
Trichloroethylene	0.5 ug/L	-	<0.5	-	-
Trichlorofluoromethane	1.0 ug/L	-	<1.0	-	-
1,3,5-Trimethylbenzene	0.5 ug/L	-	<0.5	-	-
Vinyl chloride	0.5 ug/L	-	<0.5	-	-
m,p-Xylenes	0.5 ug/L	-	<0.5	-	-
o-Xylene	0.5 ug/L	-	<0.5	-	-
Xylenes, total	0.5 ug/L	-	<0.5	-	-
4-Bromofluorobenzene	Surrogate	-	123%	-	-
Dibromofluoromethane	Surrogate	-	92.7%	-	-
Toluene-d8	Surrogate	-	113%	-	-

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 24-Oct-2022  
 Order Date: 17-Oct-2022  
 Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>General Inorganics</b>									
Alkalinity, total	ND	5	mg/L						
Ammonia as N	ND	0.01	mg/L						
Dissolved Organic Carbon	ND	0.5	mg/L						
Colour	ND	2	TCU						
Conductivity	ND	5	uS/cm						
Phenolics	ND	0.001	mg/L						
Total Dissolved Solids	ND	10	mg/L						
Sulphide	ND	0.02	mg/L						
Tannin & Lignin	ND	0.1	mg/L						
Total Kjeldahl Nitrogen	ND	0.1	mg/L						
Turbidity	ND	0.1	NTU						
<b>Metals</b>									
Calcium	ND	0.1	mg/L						
Iron	ND	0.1	mg/L						
Magnesium	ND	0.2	mg/L						
Manganese	ND	0.005	mg/L						
Potassium	ND	0.1	mg/L						
Sodium	ND	0.2	mg/L						
<b>Microbiological Parameters</b>									
E. coli	ND	1	CFU/100mL						
Fecal Coliforms	ND	1	CFU/100mL						
Total Coliforms	ND	1	CFU/100mL						
Heterotrophic Plate Count	ND	10	CFU/mL						
<b>Volatiles</b>									
Acetone	ND	5.0	ug/L						
Benzene	ND	0.5	ug/L						
Bromodichloromethane	ND	0.5	ug/L						
Bromoform	ND	0.5	ug/L						
Bromomethane	ND	0.5	ug/L						
Carbon Tetrachloride	ND	0.2	ug/L						
Chlorobenzene	ND	0.5	ug/L						
Chloroethane	ND	1.0	ug/L						
Chloroform	ND	0.5	ug/L						
Chloromethane	ND	3.0	ug/L						
Dibromochloromethane	ND	0.5	ug/L						
Dichlorodifluoromethane	ND	1.0	ug/L						
1,2-Dibromoethane	ND	0.2	ug/L						
1,2-Dichlorobenzene	ND	0.5	ug/L						
1,3-Dichlorobenzene	ND	0.5	ug/L						
1,4-Dichlorobenzene	ND	0.5	ug/L						
1,1-Dichloroethane	ND	0.5	ug/L						
1,2-Dichloroethane	ND	0.5	ug/L						
1,1-Dichloroethylene	ND	0.5	ug/L						
cis-1,2-Dichloroethylene	ND	0.5	ug/L						
trans-1,2-Dichloroethylene	ND	0.5	ug/L						
1,2-Dichloroethylene, total	ND	0.5	ug/L						
1,2-Dichloropropane	ND	0.5	ug/L						
cis-1,3-Dichloropropylene	ND	0.5	ug/L						
trans-1,3-Dichloropropylene	ND	0.5	ug/L						
1,3-Dichloropropene, total	ND	0.5	ug/L						
Ethylbenzene	ND	0.5	ug/L						
Hexane	ND	1.0	ug/L						
Methyl Ethyl Ketone (2-Butanone)	ND	5.0	ug/L						
Methyl Butyl Ketone (2-Hexanone)	ND	10.0	ug/L						
Methyl Isobutyl Ketone	ND	5.0	ug/L						
Methyl tert-butyl ether	ND	2.0	ug/L						
Methylene Chloride	ND	5.0	ug/L						
Styrene	ND	0.5	ug/L						

Certificate of Analysis

Report Date: 24-Oct-2022

Client: LRL Associates Ltd.

Order Date: 17-Oct-2022

Client PO:

Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
1,1,1,2-Tetrachloroethane	ND	0.5	ug/L						
1,1,2,2-Tetrachloroethane	ND	0.5	ug/L						
Tetrachloroethylene	ND	0.5	ug/L						
Toluene	ND	0.5	ug/L						
1,1,1-Trichloroethane	ND	0.5	ug/L						
1,1,2-Trichloroethane	ND	0.5	ug/L						
Trichloroethylene	ND	0.5	ug/L						
Trichlorofluoromethane	ND	1.0	ug/L						
1,3,5-Trimethylbenzene	ND	0.5	ug/L						
Vinyl chloride	ND	0.5	ug/L						
m,p-Xylenes	ND	0.5	ug/L						
o-Xylene	ND	0.5	ug/L						
Xylenes, total	ND	0.5	ug/L						
Surrogate: 4-Bromofluorobenzene	112		ug/L		139	50-140			
Surrogate: Dibromofluoromethane	68.7		ug/L		85.9	50-140			
Surrogate: Toluene-d8	90.2		ug/L		113	50-140			

Certificate of Analysis

Report Date: 24-Oct-2022

Client: LRL Associates Ltd.

Order Date: 17-Oct-2022

Client PO:

Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>General Inorganics</b>									
Alkalinity, total	33.0	5	mg/L	33.4			1.4	14	
Ammonia as N	0.027	0.01	mg/L	0.027			2.8	17.7	
Dissolved Organic Carbon	0.7	0.5	mg/L	0.9			19.3	37	
Colour	ND	2	TCU	ND			NC	12	
Conductivity	162	5	uS/cm	165			1.6	5	
pH	8.4	0.1	pH Units	8.4			0.1	3.3	
Phenolics	ND	0.001	mg/L	ND			NC	10	
Total Dissolved Solids	86.0	10	mg/L	86.0			0.0	10	
Sulphide	ND	0.02	mg/L	ND			NC	10	
Tannin & Lignin	ND	0.1	mg/L	ND			NC	11	
Total Kjeldahl Nitrogen	0.12	0.1	mg/L	0.12			1.0	16	
Turbidity	4.2	0.1	NTU	4.2			0.5	10	
<b>Metals</b>									
Calcium	50.6	0.1	mg/L	50.3			0.7	20	
Iron	0.4	0.1	mg/L	0.4			2.7	20	
Magnesium	19.4	0.2	mg/L	19.2			1.2	20	
Manganese	0.019	0.005	mg/L	0.019			0.1	20	
Potassium	1.8	0.1	mg/L	1.8			1.7	20	
Sodium	15.0	0.2	mg/L	15.3			1.6	20	
<b>Microbiological Parameters</b>									
E. coli	ND	1	CFU/100mL	ND			NC	30	
Fecal Coliforms	ND	1	CFU/100mL	ND			NC	30	
Total Coliforms	4	1	CFU/100mL	4			0.0	30	
Heterotrophic Plate Count	ND	10	CFU/mL	10			NC	30	
<b>Volatiles</b>									
Acetone	ND	5.0	ug/L	ND			NC	30	
Benzene	ND	0.5	ug/L	ND			NC	30	
Bromodichloromethane	ND	0.5	ug/L	ND			NC	30	
Bromoform	ND	0.5	ug/L	ND			NC	30	
Bromomethane	ND	0.5	ug/L	ND			NC	30	
Carbon Tetrachloride	ND	0.2	ug/L	ND			NC	30	
Chlorobenzene	ND	0.5	ug/L	ND			NC	30	
Chloroethane	ND	1.0	ug/L	ND			NC	30	
Chloroform	ND	0.5	ug/L	ND			NC	30	
Chloromethane	ND	3.0	ug/L	ND			NC	30	
Dibromochloromethane	ND	0.5	ug/L	ND			NC	30	
Dichlorodifluoromethane	ND	1.0	ug/L	ND			NC	30	
1,2-Dibromoethane	ND	0.2	ug/L	ND			NC	30	
1,2-Dichlorobenzene	ND	0.5	ug/L	ND			NC	30	
1,3-Dichlorobenzene	ND	0.5	ug/L	ND			NC	30	
1,4-Dichlorobenzene	ND	0.5	ug/L	ND			NC	30	
1,1-Dichloroethane	ND	0.5	ug/L	ND			NC	30	
1,2-Dichloroethane	ND	0.5	ug/L	ND			NC	30	
1,1-Dichloroethylene	ND	0.5	ug/L	ND			NC	30	
cis-1,2-Dichloroethylene	ND	0.5	ug/L	ND			NC	30	
trans-1,2-Dichloroethylene	ND	0.5	ug/L	ND			NC	30	
1,2-Dichloropropane	ND	0.5	ug/L	ND			NC	30	
cis-1,3-Dichloropropylene	ND	0.5	ug/L	ND			NC	30	
trans-1,3-Dichloropropylene	ND	0.5	ug/L	ND			NC	30	
Ethylbenzene	ND	0.5	ug/L	ND			NC	30	
Hexane	ND	1.0	ug/L	ND			NC	30	
Methyl Ethyl Ketone (2-Butanone)	ND	5.0	ug/L	ND			NC	30	
Methyl Butyl Ketone (2-Hexanone)	ND	10.0	ug/L	ND			NC	30	
Methyl Isobutyl Ketone	ND	5.0	ug/L	ND			NC	30	
Methyl tert-butyl ether	ND	2.0	ug/L	ND			NC	30	
Methylene Chloride	ND	5.0	ug/L	ND			NC	30	

Certificate of Analysis

Report Date: 24-Oct-2022

Client: LRL Associates Ltd.

Order Date: 17-Oct-2022

Client PO:

Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Styrene	ND	0.5	ug/L	ND			NC	30	
1,1,1,2-Tetrachloroethane	ND	0.5	ug/L	ND			NC	30	
1,1,2,2-Tetrachloroethane	ND	0.5	ug/L	ND			NC	30	
Tetrachloroethylene	ND	0.5	ug/L	ND			NC	30	
Toluene	ND	0.5	ug/L	ND			NC	30	
1,1,1-Trichloroethane	ND	0.5	ug/L	ND			NC	30	
1,1,2-Trichloroethane	ND	0.5	ug/L	ND			NC	30	
Trichloroethylene	ND	0.5	ug/L	ND			NC	30	
Trichlorofluoromethane	ND	1.0	ug/L	ND			NC	30	
1,3,5-Trimethylbenzene	ND	0.5	ug/L	ND			NC	30	
Vinyl chloride	ND	0.5	ug/L	ND			NC	30	
m,p-Xylenes	ND	0.5	ug/L	ND			NC	30	
o-Xylene	ND	0.5	ug/L	ND			NC	30	
Surrogate: 4-Bromofluorobenzene	86.0		ug/L		108	50-140			
Surrogate: Dibromofluoromethane	72.8		ug/L		91.0	50-140			
Surrogate: Toluene-d8	87.8		ug/L		110	50-140			

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 24-Oct-2022  
 Order Date: 17-Oct-2022  
 Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>General Inorganics</b>									
Ammonia as N	0.269	0.01	mg/L	0.027	96.6	81-124			
Dissolved Organic Carbon	10.1	0.5	mg/L	0.9	92.0	60-133			
Phenolics	0.027	0.001	mg/L	ND	108	67-133			
Total Dissolved Solids	94.0	10	mg/L	ND	94.0	75-125			
Sulphide	0.54	0.02	mg/L	ND	107	79-115			
Tannin & Lignin	1.0	0.1	mg/L	ND	95.7	71-113			
Total Kjeldahl Nitrogen	2.09	0.1	mg/L	0.12	98.4	81-126			
<b>Metals</b>									
Calcium	57300	0.1	mg/L	50300	70.1	80-120			QM-07
Iron	2560	0.1	mg/L	371	87.4	80-120			
Magnesium	27700	0.2	mg/L	19200	85.9	80-120			
Manganese	65.0	0.005	mg/L	18.7	92.7	80-120			
Potassium	11300	0.1	mg/L	1790	94.7	80-120			
Sodium	23500	0.2	mg/L	15300	81.9	80-120			
<b>Volatiles</b>									
Acetone	81.3	5.0	ug/L	ND	81.3	50-140			
Benzene	35.5	0.5	ug/L	ND	88.8	60-130			
Bromodichloromethane	36.7	0.5	ug/L	ND	91.7	60-130			
Bromoform	42.2	0.5	ug/L	ND	106	60-130			
Bromomethane	40.4	0.5	ug/L	ND	101	50-140			
Carbon Tetrachloride	47.2	0.2	ug/L	ND	118	60-130			
Chlorobenzene	40.9	0.5	ug/L	ND	102	60-130			
Chloroethane	31.5	1.0	ug/L	ND	78.8	50-140			
Chloroform	44.0	0.5	ug/L	ND	110	60-130			
Chloromethane	35.5	3.0	ug/L	ND	88.7	50-140			
Dibromochloromethane	43.5	0.5	ug/L	ND	109	60-130			
Dichlorodifluoromethane	26.3	1.0	ug/L	ND	65.6	50-140			
1,2-Dibromoethane	35.8	0.2	ug/L	ND	89.5	60-130			
1,2-Dichlorobenzene	38.9	0.5	ug/L	ND	97.2	60-130			
1,3-Dichlorobenzene	39.9	0.5	ug/L	ND	99.7	60-130			
1,4-Dichlorobenzene	40.5	0.5	ug/L	ND	101	60-130			
1,1-Dichloroethane	36.8	0.5	ug/L	ND	92.0	60-130			
1,2-Dichloroethane	41.8	0.5	ug/L	ND	104	60-130			
1,1-Dichloroethylene	32.4	0.5	ug/L	ND	81.1	60-130			
cis-1,2-Dichloroethylene	40.9	0.5	ug/L	ND	102	60-130			
trans-1,2-Dichloroethylene	36.6	0.5	ug/L	ND	91.4	60-130			
1,2-Dichloropropane	35.5	0.5	ug/L	ND	88.6	60-130			
cis-1,3-Dichloropropylene	35.9	0.5	ug/L	ND	89.7	60-130			
trans-1,3-Dichloropropylene	38.3	0.5	ug/L	ND	95.8	60-130			
Ethylbenzene	33.8	0.5	ug/L	ND	84.6	60-130			
Hexane	37.1	1.0	ug/L	ND	92.8	60-130			
Methyl Ethyl Ketone (2-Butanone)	116	5.0	ug/L	ND	116	50-140			
Methyl Butyl Ketone (2-Hexanone)	67.4	10.0	ug/L	ND	67.4	50-140			
Methyl Isobutyl Ketone	81.0	5.0	ug/L	ND	81.0	50-140			
Methyl tert-butyl ether	82.5	2.0	ug/L	ND	82.5	50-140			
Methylene Chloride	37.6	5.0	ug/L	ND	94.1	60-130			
Styrene	30.7	0.5	ug/L	ND	76.7	60-130			
1,1,1,2-Tetrachloroethane	36.0	0.5	ug/L	ND	90.1	60-130			

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 24-Oct-2022  
 Order Date: 17-Oct-2022  
 Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
1,1,2,2-Tetrachloroethane	41.9	0.5	ug/L	ND	105	60-130			
Tetrachloroethylene	49.9	0.5	ug/L	ND	125	60-130			
Toluene	36.3	0.5	ug/L	ND	90.6	60-130			
1,1,1-Trichloroethane	42.1	0.5	ug/L	ND	105	60-130			
1,1,2-Trichloroethane	38.5	0.5	ug/L	ND	96.2	60-130			
Trichloroethylene	41.7	0.5	ug/L	ND	104	60-130			
Trichlorofluoromethane	41.2	1.0	ug/L	ND	103	60-130			
1,3,5-Trimethylbenzene	40.6	0.5	ug/L	ND	102	60-130			
Vinyl chloride	35.7	0.5	ug/L	ND	89.2	50-140			
m,p-Xylenes	70.4	0.5	ug/L	ND	88.0	60-130			
o-Xylene	34.6	0.5	ug/L	ND	86.5	60-130			
<i>Surrogate: 4-Bromofluorobenzene</i>	69.5		ug/L		86.9	50-140			
<i>Surrogate: Dibromofluoromethane</i>	78.0		ug/L		97.5	50-140			
<i>Surrogate: Toluene-d8</i>	70.1		ug/L		87.6	50-140			



Certificate of Analysis  
Client: LRL Associates Ltd.  
Client PO:

Report Date: 24-Oct-2022  
Order Date: 17-Oct-2022  
Project Description: 01348

**Qualifier Notes:**

***Login Qualifiers :***

Container and COC sample IDs don't match - Sulphide bottle is labelled as 5548 Albion Rd, chain of custody reads 5546 Albion Rd.

*Applies to samples: 5546 Albion Rd - Supply Well - 3 hrs*

Sample - Not submitted in the correct container - VOC sample decanted from plastic general 500mL bottle.

*Applies to samples: 5546 Albion Rd - Supply Well - 6 hrs*

Sample - F1/BTEX/VOCs (water) submitted with headspace which covered the bottom surface of the vial when inverted.

*Applies to samples: 5546 Albion Rd - Supply Well - 6 hrs*

***Sample Qualifiers :***

5 : Subcontracted analysis - Eurofins Environment Testing

***QC Qualifiers :***

QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated



arent Blvd.  
K1G 4J8  
17  
cellabs.com

Parcel Order Number

2243028

Chain Of Custody  
Ontario Drinking Water Samples

No 17463

Client Name: <b>LRL</b>	Project Ref: <b>01348</b>	Waterworks Name:	Samples Taken By:
Contact Name: <b>Abdul Kader</b>	Quote #:	Waterworks Number:	Name: <b>Abdul Kader</b>
Address: <b>5430 Canotek Rd</b>	PO #:	Address: <b>5546 Albion Rd</b>	Signature:
After Hours Contact:	E-mail: <b>akader@lrl.ca</b>	<b>Ottawa, ON.</b>	Page <b>1</b> of <b>1</b>
Telephone: <b>6133156602</b>	Fax:	Public Health Unit:	Turn Around Time Required: <input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day

Samples Submitted Under: (Indicate ONLY one) <input type="checkbox"/> ON REG 170/03 <input type="checkbox"/> ON REG 319/08 <input type="checkbox"/> Private Well <input type="checkbox"/> ON REG 243/07 <input checked="" type="checkbox"/> Other: <b>ODWS</b>		Sample Type: R = Raw ; T = Treated ; D = Distribution ; P = Plumbing Source Type: G = Ground Water ; S = Surface Water Reportable: Requires AWQI reporting as per Regulation - Y = Yes ; N = No				Required Analyses				
Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Are these samples for human consumption?: <input type="checkbox"/> Yes <input type="checkbox"/> No		Sample Type: R/T/D/P Source Type: G/S Reportable: Y/N Resample	SAMPLE COLLECTED		# of Containers Free/Combined Chlorine Residual mg/L Standing / Flushed: S/F (REG 243) Total Coliform/E. Coll	HPC Lead THM	Division Residual			
All information must be completed before samples will be processed.			DATE	TIME						
LOCATION NAME	SAMPLE ID									
1	5546 Albion Rd - supply well - 3hrs	RGN	17.10.2022	12:05am	8					X
2	5546 Albion Rd - supply well - 6hrs	RGN	17.10.2022	3:05am	8					X
3										
4										
5										
6										
7										
8										
9										
10										

Comments:			Method of Delivery: <b>Drop Box</b>		
Relinquished By (Sign):	Received By Driver/Depot:	Received at Lab:	Verified By:		
Relinquished By (Print): <b>Abdul Kader</b>	Date/Time:	Date/Time: <b>Oct 17 2022 7:57</b>	Date/Time: <b>Oct 17 2022 10:10</b>		
Date/Time: <b>17-10-2022 / 4:45am</b>	Temperature: °C	Temperature: <b>7.4</b> °C	pH Verified: <input type="checkbox"/> By:		

## Certificate of Analysis

**LRL Associates Ltd.**

5430 Canotek Road  
Ottawa, ON K1J 9G2  
Attn: Abdul Kader Alhaj

Client PO:  
Project: 01348  
Custody: 17473

Report Date: 27-Oct-2022  
Order Date: 21-Oct-2022

**Order #: 2243484**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted :

Paracel ID	Client ID
2243484-01	5546 Albion Rd-Supply Well

Approved By:



Dale Robertson, BSc  
Laboratory Director

Certificate of Analysis  
Client: **LRL Associates Ltd.**  
Client PO:

Report Date: 27-Oct-2022  
Order Date: 21-Oct-2022  
Project Description: **01348**

**Analysis Summary Table**

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Metals, ICP-MS	EPA 200.8 - ICP-MS	26-Oct-22	26-Oct-22

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 27-Oct-2022  
 Order Date: 21-Oct-2022  
 Project Description: 01348

<b>Client ID:</b>	5546 Albion Rd-Supply Well	-	-	-
<b>Sample Date:</b>	21-Oct-22 08:35	-	-	-
<b>Sample ID:</b>	2243484-01	-	-	-
<b>MDL/Units</b>	Drinking Water	-	-	-

**Metals**

Element	MDL/Units	Result	Pass/Fail	Pass/Fail	Pass/Fail
Aluminum	0.001 mg/L	0.001	-	-	-
Antimony	0.0005 mg/L	<0.0005	-	-	-
Arsenic	0.001 mg/L	<0.001	-	-	-
Barium	0.001 mg/L	0.033	-	-	-
Beryllium	0.0005 mg/L	<0.0005	-	-	-
Boron	0.01 mg/L	0.05	-	-	-
Cadmium	0.0001 mg/L	<0.0001	-	-	-
Calcium	0.1 mg/L	21.4	-	-	-
Chromium	0.001 mg/L	<0.001	-	-	-
Cobalt	0.0005 mg/L	<0.0005	-	-	-
Copper	0.0005 mg/L	0.0009	-	-	-
Iron	0.1 mg/L	0.2	-	-	-
Lead	0.0001 mg/L	<0.0001	-	-	-
Magnesium	0.2 mg/L	19.1	-	-	-
Manganese	0.005 mg/L	0.070	-	-	-
Molybdenum	0.0005 mg/L	0.0027	-	-	-
Nickel	0.001 mg/L	<0.001	-	-	-
Potassium	0.1 mg/L	2.7	-	-	-
Selenium	0.001 mg/L	<0.001	-	-	-
Silver	0.0001 mg/L	<0.0001	-	-	-
Sodium	0.2 mg/L	15.5	-	-	-
Strontium	0.01 mg/L	0.08	-	-	-
Thallium	0.001 mg/L	<0.001	-	-	-
Tin	0.01 mg/L	<0.01	-	-	-
Titanium	0.005 mg/L	<0.005	-	-	-
Tungsten	0.01 mg/L	<0.01	-	-	-
Uranium	0.0001 mg/L	<0.0001	-	-	-
Vanadium	0.0005 mg/L	<0.0005	-	-	-
Zinc	0.005 mg/L	<0.005	-	-	-

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 27-Oct-2022  
 Order Date: 21-Oct-2022  
 Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Metals</b>									
Aluminum	ND	0.001	mg/L						
Antimony	ND	0.0005	mg/L						
Arsenic	ND	0.001	mg/L						
Barium	ND	0.001	mg/L						
Beryllium	ND	0.0005	mg/L						
Boron	ND	0.01	mg/L						
Cadmium	ND	0.0001	mg/L						
Calcium	ND	0.1	mg/L						
Chromium	ND	0.001	mg/L						
Cobalt	ND	0.0005	mg/L						
Copper	ND	0.0005	mg/L						
Iron	ND	0.1	mg/L						
Lead	ND	0.0001	mg/L						
Magnesium	ND	0.2	mg/L						
Manganese	ND	0.005	mg/L						
Molybdenum	ND	0.0005	mg/L						
Nickel	ND	0.001	mg/L						
Potassium	ND	0.1	mg/L						
Selenium	ND	0.001	mg/L						
Silver	ND	0.0001	mg/L						
Sodium	ND	0.2	mg/L						
Strontium	ND	0.01	mg/L						
Thallium	ND	0.001	mg/L						
Tin	ND	0.01	mg/L						
Titanium	ND	0.005	mg/L						
Tungsten	ND	0.01	mg/L						
Uranium	ND	0.0001	mg/L						
Vanadium	ND	0.0005	mg/L						
Zinc	ND	0.005	mg/L						

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 27-Oct-2022  
 Order Date: 21-Oct-2022  
 Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Metals</b>									
Aluminum	0.001	0.001	mg/L	0.001			0.6	20	
Antimony	ND	0.0005	mg/L	ND			NC	20	
Arsenic	ND	0.001	mg/L	ND			NC	20	
Barium	0.033	0.001	mg/L	0.033			2.7	20	
Beryllium	ND	0.0005	mg/L	ND			NC	20	
Boron	0.05	0.01	mg/L	0.05			1.2	20	
Cadmium	ND	0.0001	mg/L	ND			NC	20	
Calcium	21.8	0.1	mg/L	21.4			1.9	20	
Chromium	ND	0.001	mg/L	ND			NC	20	
Cobalt	ND	0.0005	mg/L	ND			NC	20	
Copper	0.0009	0.0005	mg/L	0.0009			0.5	20	
Iron	0.2	0.1	mg/L	0.2			0.0	20	
Lead	ND	0.0001	mg/L	ND			NC	20	
Magnesium	19.4	0.2	mg/L	19.1			1.8	20	
Manganese	0.071	0.005	mg/L	0.070			1.8	20	
Molybdenum	0.0027	0.0005	mg/L	0.0027			0.3	20	
Nickel	ND	0.001	mg/L	ND			NC	20	
Potassium	3.0	0.1	mg/L	2.7			9.6	20	
Selenium	ND	0.001	mg/L	ND			NC	20	
Silver	ND	0.0001	mg/L	ND			NC	20	
Sodium	14.9	0.2	mg/L	15.5			4.0	20	
Thallium	ND	0.001	mg/L	ND			NC	20	
Tin	ND	0.01	mg/L	ND			NC	20	
Titanium	ND	0.005	mg/L	ND			NC	50	
Tungsten	ND	0.01	mg/L	ND			NC	20	
Uranium	ND	0.0001	mg/L	ND			NC	20	
Vanadium	ND	0.0005	mg/L	ND			NC	20	
Zinc	ND	0.005	mg/L	ND			NC	20	

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 27-Oct-2022  
 Order Date: 21-Oct-2022  
 Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Metals</b>									
Aluminum	49.6	0.001	mg/L	1.06	97.1	80-120			
Antimony	44.1	0.0005	mg/L	ND	88.1	80-120			
Arsenic	52.0	0.001	mg/L	0.115	104	80-120			
Barium	78.3	0.001	mg/L	33.4	89.8	80-120			
Beryllium	49.9	0.0005	mg/L	0.0184	99.8	80-120			
Boron	93.8	0.01	mg/L	49.7	88.3	80-120			
Cadmium	45.4	0.0001	mg/L	0.0076	90.7	80-120			
Calcium	30300	0.1	mg/L	21400	89.1	80-120			
Chromium	53.8	0.001	mg/L	0.045	108	80-120			
Cobalt	49.8	0.0005	mg/L	0.0396	99.4	80-120			
Copper	48.4	0.0005	mg/L	0.937	94.9	80-120			
Iron	2540	0.1	mg/L	212	93.0	80-120			
Lead	46.9	0.0001	mg/L	0.0359	93.6	80-120			
Magnesium	27600	0.2	mg/L	19100	84.8	80-120			
Manganese	118	0.005	mg/L	69.9	96.8	80-120			
Molybdenum	49.0	0.0005	mg/L	2.71	92.7	80-120			
Nickel	49.1	0.001	mg/L	0.192	97.8	80-120			
Potassium	13100	0.1	mg/L	2690	104	80-120			
Selenium	49.1	0.001	mg/L	0.059	98.1	80-120			
Silver	46.0	0.0001	mg/L	0.0054	91.9	80-120			
Sodium	24200	0.2	mg/L	15500	87.4	80-120			
Thallium	46.5	0.001	mg/L	0.006	92.9	80-120			
Tin	46.8	0.01	mg/L	0.14	93.4	80-120			
Titanium	59.0	0.005	mg/L	ND	118	70-130			
Tungsten	48.1	0.01	mg/L	0.08	95.9	80-120			
Uranium	49.8	0.0001	mg/L	0.0268	99.6	80-120			
Vanadium	54.5	0.0005	mg/L	0.0134	109	80-120			
Zinc	48.6	0.005	mg/L	2.08	93.0	80-120			



Certificate of Analysis  
Client: **LRL Associates Ltd.**  
Client PO:

Report Date: 27-Oct-2022  
Order Date: 21-Oct-2022  
Project Description: **01348**

**Qualifier Notes:**

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable  
ND: Not Detected  
MDL: Method Detection Limit  
Source Result: Data used as source for matrix and duplicate samples  
%REC: Percent recovery.  
RPD: Relative percent difference.  
NC: Not Calculated



Client Name: LRL Associates	Project Ref: 01348	Waterworks Name:	Samples Taken By:
Contact Name: Abdul Kader	Quote #:	Waterworks Number:	Name: Abdul Kader
Address: 5430 Canotek Rd	PO #:	Address: 5546 Albion Rd.	Signature:
After Hours Contact:	E-mail: akader@lrl.ca	Ottawa, ON.	Page 1 of 1
Telephone: 613 315 6602	Fax:	Public Health Unit:	Turn Around Time Required: <input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day

Samples Submitted Under: (Indicate ONLY one)		Sample Type: R = Raw; T = Treated; D = Distribution; P = Plumbing		Source Type: G = Ground Water; S = Surface Water		Reportable: Requires AWQI reporting as per Regulation - Y = Yes; N = No		Required Analyses							
<input type="checkbox"/> ON REG 170/03 <input type="checkbox"/> ON REG 319/08 <input type="checkbox"/> Private Well <input type="checkbox"/> ON REG 243/07 <input checked="" type="checkbox"/> Other: ODWS															
Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		Are these samples for human consumption?: <input type="checkbox"/> Yes <input type="checkbox"/> No		All information must be completed before samples will be processed.		SAMPLE COLLECTED									
LOCATION NAME	SAMPLE ID	Sample Type: R/T/D/P	Source Type: G/S	Reportable: Y/N	Resample	DATE	TIME	# of Containers	Free/Combined Chlorine Residual mg/L	Standing / Flushed: S/F (REG 243)	Total Coliform/E. Coli	HPC	Lead	THM	X Trace Metals
5546 Albion Rd - supply well		R	G	N		21.10.22	8:35	1							X

Comments:

Method of Delivery: Drop Box

Relinquished By (Sign): Abdul Kader	Received By Driver/Depot:	Received at Lab:	Verified By:
Relinquished By (Print):	Date/Time:	Date/Time: Oct 21/22 10:30	Date/Time: Oct 21/22 11:10a
Date/Time: 21/10/2022 / 10:10	Temperature: °C	Temperature: 11.3 °C	pH Verified: <input type="checkbox"/> By: SC

## Certificate of Analysis

**LRL Associates Ltd.**

5430 Canotek Road  
Ottawa, ON K1J 9G2  
Attn: Jessica Arthurs

Client PO:  
Project: 01348  
Custody: 13259

Report Date: 29-Nov-2023  
Order Date: 23-Nov-2023

**Order #: 2347319**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Parcel ID	Client ID
2347319-01	5546 Albion Road

Approved By:



Dale Robertson, BSc

Laboratory Director

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Analysis Summary Table**

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Alkalinity, total to pH 4.5	EPA 310.1 - Titration to pH 4.5	27-Nov-23	27-Nov-23
Ammonia, as N	EPA 351.2 - Auto Colour	27-Nov-23	27-Nov-23
Anions	EPA 300.1 - IC	29-Nov-23	29-Nov-23
Colour	SM2120 - Spectrophotometric	23-Nov-23	24-Nov-23
Conductivity	EPA 9050A- probe @25 °C	27-Nov-23	27-Nov-23
Dissolved Organic Carbon	MOE 3247B - Combustion IR	23-Nov-23	24-Nov-23
E. coli	MOE E3407	23-Nov-23	23-Nov-23
Fecal Coliform	SM 9222D	23-Nov-23	23-Nov-23
Heterotrophic Plate Count	SM 9215C	23-Nov-23	23-Nov-23
Metals, ICP-MS	EPA 200.8 - ICP-MS	24-Nov-23	24-Nov-23
pH	EPA 150.1 - pH probe @25 °C	27-Nov-23	27-Nov-23
PHC F1	CWS Tier 1 - P&T GC-FID	27-Nov-23	28-Nov-23
PHCs F2 to F4	CWS Tier 1 - GC-FID, extraction	28-Nov-23	28-Nov-23
Phenolics	EPA 420.2 - Auto Colour, 4AAP	28-Nov-23	28-Nov-23
REG 153: PAHs by GC-MS	EPA 625 - GC-MS, extraction	27-Nov-23	27-Nov-23
Hardness	Hardness as CaCO <sub>3</sub>	29-Nov-23	29-Nov-23
Sulphide	SM 4500SE - Colourimetric	23-Nov-23	23-Nov-23
Tannin/Lignin	SM 5550B - Colourimetric	23-Nov-23	24-Nov-23
Total Coliform	MOE E3407	23-Nov-23	23-Nov-23
Total Dissolved Solids	SM 2540C - gravimetric, filtration	27-Nov-23	28-Nov-23
Total Kjeldahl Nitrogen	EPA 351.2 - Auto Colour, digestion	27-Nov-23	28-Nov-23
Turbidity	SM 2130B - Turbidity meter	23-Nov-23	23-Nov-23
VOCs by P&T GC-MS	EPA 624 - P&T GC-MS	28-Nov-23	28-Nov-23

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Road	-	-	-	-
<b>Sample Date:</b>	23-Nov-23 08:05	-	-	-	-
<b>Sample ID:</b>	2347319-01	-	-	-	-
<b>Matrix:</b>	Drinking Water	-	-	-	-
<b>MDL/Units</b>					

**Microbiological Parameters**

E. coli	1 CFU/100mL	ND	-	-	-	-
Total Coliforms	1 CFU/100mL	1	-	-	-	-
Fecal Coliforms	1 CFU/100mL	ND	-	-	-	-
Heterotrophic Plate Count	10 CFU/mL	10	-	-	-	-

**General Inorganics**

Alkalinity, total	5 mg/L	187	-	-	-	-
Ammonia as N	0.01 mg/L	0.04	-	-	-	-
Dissolved Organic Carbon	0.5 mg/L	<0.5	-	-	-	-
Colour	2 TCU	<2	-	-	-	-
Conductivity	5 uS/cm	470	-	-	-	-
Hardness	mg/L	203	-	-	-	-
pH	0.1 pH Units	8.0	-	-	-	-
Phenolics	0.001 mg/L	<0.001	-	-	-	-
Total Dissolved Solids	10 mg/L	258	-	-	-	-
Sulphide	0.02 mg/L	<0.02	-	-	-	-
Tannin & Lignin	0.1 mg/L	<0.1	-	-	-	-
Total Kjeldahl Nitrogen	0.1 mg/L	<0.1	-	-	-	-
Turbidity	0.1 NTU	3.4	-	-	-	-

**Anions**

Chloride	1 mg/L	14	-	-	-	-
Fluoride	0.1 mg/L	0.1	-	-	-	-
Nitrate as N	0.1 mg/L	<0.1	-	-	-	-
Nitrite as N	0.05 mg/L	<0.05	-	-	-	-
Sulphate	1 mg/L	52	-	-	-	-

**Metals**

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Road	-	-	-	-
<b>Sample Date:</b>	23-Nov-23 08:05	-	-	-	-
<b>Sample ID:</b>	2347319-01	-	-	-	-
<b>Matrix:</b>	Drinking Water	-	-	-	-
<b>MDL/Units</b>					

**Metals**

Element	MDL/Units	Result	Pass/Fail	Pass/Fail	Pass/Fail	Pass/Fail
Aluminum	0.001 mg/L	<0.001	-	-	-	-
Antimony	0.0005 mg/L	<0.0005	-	-	-	-
Arsenic	0.001 mg/L	<0.001	-	-	-	-
Barium	0.001 mg/L	0.122	-	-	-	-
Beryllium	0.0005 mg/L	<0.0005	-	-	-	-
Boron	0.01 mg/L	0.05	-	-	-	-
Cadmium	0.0001 mg/L	<0.0001	-	-	-	-
Calcium	0.1 mg/L	51.0	-	-	-	-
Chromium	0.001 mg/L	<0.001	-	-	-	-
Cobalt	0.0005 mg/L	<0.0005	-	-	-	-
Copper	0.0005 mg/L	0.0009	-	-	-	-
Iron	0.1 mg/L	0.5	-	-	-	-
Lead	0.0001 mg/L	0.0001	-	-	-	-
Magnesium	0.2 mg/L	18.5	-	-	-	-
Manganese	0.005 mg/L	0.015	-	-	-	-
Molybdenum	0.0005 mg/L	0.0038	-	-	-	-
Nickel	0.001 mg/L	<0.001	-	-	-	-
Potassium	0.1 mg/L	2.0	-	-	-	-
Selenium	0.001 mg/L	<0.001	-	-	-	-
Silver	0.0001 mg/L	0.0001	-	-	-	-
Sodium	0.2 mg/L	11.2	-	-	-	-
Strontium	0.01 mg/L	0.23	-	-	-	-
Thallium	0.001 mg/L	<0.001	-	-	-	-
Tin	0.01 mg/L	<0.01	-	-	-	-
Titanium	0.005 mg/L	<0.005	-	-	-	-

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Road	-	-	-	-
<b>Sample Date:</b>	23-Nov-23 08:05	-	-	-	-
<b>Sample ID:</b>	2347319-01	-	-	-	-
<b>Matrix:</b>	Drinking Water	-	-	-	-
<b>MDL/Units</b>					

**Metals**

Tungsten	0.01 mg/L	<0.01	-	-	-	-
Uranium	0.0001 mg/L	0.0004	-	-	-	-
Vanadium	0.0005 mg/L	<0.0005	-	-	-	-
Zinc	0.005 mg/L	<0.005	-	-	-	-

**Volatiles**

Acetone	0.0050 mg/L	<0.0050	-	-	-	-
Benzene	0.0005 mg/L	<0.0005	-	-	-	-
Bromodichloromethane	0.0005 mg/L	<0.0005	-	-	-	-
Bromoform	0.0005 mg/L	<0.0005	-	-	-	-
Bromomethane	0.0005 mg/L	<0.0005	-	-	-	-
Carbon Tetrachloride	0.0002 mg/L	<0.0002	-	-	-	-
Chlorobenzene	0.0005 mg/L	<0.0005	-	-	-	-
Chloroethane	0.0010 mg/L	<0.0010	-	-	-	-
Chloroform	0.0005 mg/L	<0.0005	-	-	-	-
Dibromochloromethane	0.0005 mg/L	<0.0005	-	-	-	-
Dichlorodifluoromethane	0.0010 mg/L	<0.0010	-	-	-	-
1,2-Dibromoethane	0.0002 mg/L	<0.0002	-	-	-	-
1,2-Dichlorobenzene	0.0005 mg/L	<0.0005	-	-	-	-
1,3-Dichlorobenzene	0.0005 mg/L	<0.0005	-	-	-	-
1,4-Dichlorobenzene	0.0005 mg/L	<0.0005	-	-	-	-
1,1-Dichloroethane	0.0005 mg/L	<0.0005	-	-	-	-
1,2-Dichloroethane	0.0005 mg/L	<0.0005	-	-	-	-
1,1-Dichloroethylene	0.0005 mg/L	<0.0005	-	-	-	-
cis-1,2-Dichloroethylene	0.0005 mg/L	<0.0005	-	-	-	-
trans-1,2-Dichloroethylene	0.0005 mg/L	<0.0005	-	-	-	-

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Road	-	-	-	-
<b>Sample Date:</b>	23-Nov-23 08:05	-	-	-	-
<b>Sample ID:</b>	2347319-01	-	-	-	-
<b>Matrix:</b>	Drinking Water	-	-	-	-
<b>MDL/Units</b>					

**Volatiles**

1,2-Dichloroethylene, total	0.0005 mg/L	<0.0005	-	-	-	-
1,2-Dichloropropane	0.0005 mg/L	<0.0005	-	-	-	-
cis-1,3-Dichloropropylene	0.0005 mg/L	<0.0005	-	-	-	-
trans-1,3-Dichloropropylene	0.0005 mg/L	<0.0005	-	-	-	-
1,3-Dichloropropene, total	0.0005 mg/L	<0.0005	-	-	-	-
Ethylbenzene	0.0005 mg/L	<0.0005	-	-	-	-
Hexane	0.0010 mg/L	<0.0010	-	-	-	-
Methyl Ethyl Ketone (2-Butanone)	0.0050 mg/L	<0.0050	-	-	-	-
Methyl Isobutyl Ketone	0.0050 mg/L	<0.0050	-	-	-	-
Methyl tert-butyl ether	0.0020 mg/L	<0.0020	-	-	-	-
Methylene Chloride	0.0050 mg/L	<0.0050	-	-	-	-
Styrene	0.0005 mg/L	<0.0005	-	-	-	-
1,1,1,2-Tetrachloroethane	0.0005 mg/L	<0.0005	-	-	-	-
1,1,2,2-Tetrachloroethane	0.0005 mg/L	<0.0005	-	-	-	-
Tetrachloroethylene	0.0005 mg/L	<0.0005	-	-	-	-
Toluene	0.0005 mg/L	<0.0005	-	-	-	-
1,1,1-Trichloroethane	0.0005 mg/L	<0.0005	-	-	-	-
1,1,2-Trichloroethane	0.0005 mg/L	<0.0005	-	-	-	-
Trichloroethylene	0.0005 mg/L	<0.0005	-	-	-	-
Trichlorofluoromethane	0.0010 mg/L	<0.0010	-	-	-	-
Vinyl chloride	0.0002 mg/L	<0.0002	-	-	-	-
m,p-Xylenes	0.0005 mg/L	<0.0005	-	-	-	-
o-Xylene	0.0005 mg/L	<0.0005	-	-	-	-
Xylenes, total	0.0005 mg/L	<0.0005	-	-	-	-
Toluene-d8	Surrogate	99.7%	-	-	-	-



Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Road	-	-	-	-
<b>Sample Date:</b>	23-Nov-23 08:05	-	-	-	-
<b>Sample ID:</b>	2347319-01	-	-	-	-
<b>Matrix:</b>	Drinking Water	-	-	-	-
<b>MDL/Units</b>					

**Volatiles**

4-Bromofluorobenzene	Surrogate	119%	-	-	-	-
Dibromofluoromethane	Surrogate	78.4%	-	-	-	-

**Hydrocarbons**

F1 PHCs (C6-C10)	0.0250 mg/L	<0.0250	-	-	-	-
F2 PHCs (C10-C16)	0.1 mg/L	<0.1	-	-	-	-
F3 PHCs (C16-C34)	0.1 mg/L	<0.1	-	-	-	-
F4 PHCs (C34-C50)	0.1 mg/L	<0.1	-	-	-	-

**Semi-Volatiles**

Acenaphthene	0.05 ug/L	<0.05	-	-	-	-
Acenaphthylene	0.05 ug/L	<0.05	-	-	-	-
Anthracene	0.01 ug/L	<0.01	-	-	-	-
Benzo [a] anthracene	0.01 ug/L	<0.01	-	-	-	-
Benzo [a] pyrene	0.01 ug/L	<0.01	-	-	-	-
Benzo [b] fluoranthene	0.05 ug/L	<0.05	-	-	-	-
Benzo [g,h,i] perylene	0.05 ug/L	<0.05	-	-	-	-
Benzo [k] fluoranthene	0.05 ug/L	<0.05	-	-	-	-
Chrysene	0.05 ug/L	<0.05	-	-	-	-
Dibenzo [a,h] anthracene	0.05 ug/L	<0.05	-	-	-	-
Fluoranthene	0.01 ug/L	<0.01	-	-	-	-
Fluorene	0.05 ug/L	<0.05	-	-	-	-
Indeno [1,2,3-cd] pyrene	0.05 ug/L	<0.05	-	-	-	-
1-Methylnaphthalene	0.05 ug/L	<0.05	-	-	-	-
2-Methylnaphthalene	0.05 ug/L	<0.05	-	-	-	-
Methylnaphthalene (1&2)	0.10 ug/L	<0.10	-	-	-	-
Naphthalene	0.05 ug/L	<0.05	-	-	-	-

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

<b>Client ID:</b>	5546 Albion Road	-	-	-	-
<b>Sample Date:</b>	23-Nov-23 08:05	-	-	-	-
<b>Sample ID:</b>	2347319-01	-	-	-	-
<b>Matrix:</b>	Drinking Water	-	-	-	-
<b>MDL/Units</b>					

**Semi-Volatiles**

Phenanthrene	0.05 ug/L	<0.05	-	-	-	-
Pyrene	0.01 ug/L	<0.01	-	-	-	-
2-Fluorobiphenyl	Surrogate	68.0%	-	-	-	-
Terphenyl-d14	Surrogate	58.0%	-	-	-	-

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Anions</b>								
Chloride	ND	1	mg/L					
Fluoride	ND	0.1	mg/L					
Nitrate as N	ND	0.1	mg/L					
Nitrite as N	ND	0.05	mg/L					
Sulphate	ND	1	mg/L					
<b>General Inorganics</b>								
Alkalinity, total	ND	5	mg/L					
Ammonia as N	ND	0.01	mg/L					
Dissolved Organic Carbon	ND	0.5	mg/L					
Colour	ND	2	TCU					
Conductivity	ND	5	uS/cm					
Phenolics	ND	0.001	mg/L					
Total Dissolved Solids	ND	10	mg/L					
Sulphide	ND	0.02	mg/L					
Tannin & Lignin	ND	0.1	mg/L					
Total Kjeldahl Nitrogen	ND	0.1	mg/L					
Turbidity	ND	0.1	NTU					
<b>Hydrocarbons</b>								
F1 PHCs (C6-C10)	ND	0.0250	mg/L					
F2 PHCs (C10-C16)	ND	0.1	mg/L					
F3 PHCs (C16-C34)	ND	0.1	mg/L					
F4 PHCs (C34-C50)	ND	0.1	mg/L					
<b>Metals</b>								
Aluminum	ND	0.001	mg/L					
Antimony	ND	0.0005	mg/L					
Arsenic	ND	0.001	mg/L					
Barium	ND	0.001	mg/L					
Beryllium	ND	0.0005	mg/L					
Boron	ND	0.01	mg/L					
Cadmium	ND	0.0001	mg/L					
Calcium	ND	0.1	mg/L					
Chromium	ND	0.001	mg/L					

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
Cobalt	ND	0.0005	mg/L					
Copper	ND	0.0005	mg/L					
Iron	ND	0.1	mg/L					
Lead	ND	0.0001	mg/L					
Magnesium	ND	0.2	mg/L					
Manganese	ND	0.005	mg/L					
Molybdenum	ND	0.0005	mg/L					
Nickel	ND	0.001	mg/L					
Potassium	ND	0.1	mg/L					
Selenium	ND	0.001	mg/L					
Silver	ND	0.0001	mg/L					
Sodium	ND	0.2	mg/L					
Strontium	ND	0.01	mg/L					
Thallium	ND	0.001	mg/L					
Tin	ND	0.01	mg/L					
Titanium	ND	0.005	mg/L					
Tungsten	ND	0.01	mg/L					
Uranium	ND	0.0001	mg/L					
Vanadium	ND	0.0005	mg/L					
Zinc	ND	0.005	mg/L					
<b>Microbiological Parameters</b>								
E. coli	ND	1	CFU/100mL					
Total Coliforms	ND	1	CFU/100mL					
Fecal Coliforms	ND	1	CFU/100mL					
Heterotrophic Plate Count	ND	10	CFU/mL					
<b>Semi-Volatiles</b>								
Acenaphthene	ND	0.05	ug/L					
Acenaphthylene	ND	0.05	ug/L					
Anthracene	ND	0.01	ug/L					
Benzo [a] anthracene	ND	0.01	ug/L					
Benzo [a] pyrene	ND	0.01	ug/L					
Benzo [b] fluoranthene	ND	0.05	ug/L					
Benzo [g,h,i] perylene	ND	0.05	ug/L					

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
Benzo [k] fluoranthene	ND	0.05	ug/L					
Chrysene	ND	0.05	ug/L					
Dibenzo [a,h] anthracene	ND	0.05	ug/L					
Fluoranthene	ND	0.01	ug/L					
Fluorene	ND	0.05	ug/L					
Indeno [1,2,3-cd] pyrene	ND	0.05	ug/L					
1-Methylnaphthalene	ND	0.05	ug/L					
2-Methylnaphthalene	ND	0.05	ug/L					
Methylnaphthalene (1&2)	ND	0.10	ug/L					
Naphthalene	ND	0.05	ug/L					
Phenanthrene	ND	0.05	ug/L					
Pyrene	ND	0.01	ug/L					
Surrogate: 2-Fluorobiphenyl	14.1		%	70.6	50-140			
Surrogate: Terphenyl-d14	15.3		%	76.4	50-140			
<b>Volatiles</b>								
Acetone	ND	0.0050	mg/L					
Benzene	ND	0.0005	mg/L					
Bromodichloromethane	ND	0.0005	mg/L					
Bromoform	ND	0.0005	mg/L					
Bromomethane	ND	0.0005	mg/L					
Carbon Tetrachloride	ND	0.0002	mg/L					
Chlorobenzene	ND	0.0005	mg/L					
Chloroethane	ND	0.0010	mg/L					
Chloroform	ND	0.0005	mg/L					
Dibromochloromethane	ND	0.0005	mg/L					
Dichlorodifluoromethane	ND	0.0010	mg/L					
1,2-Dibromoethane	ND	0.0002	mg/L					
1,2-Dichlorobenzene	ND	0.0005	mg/L					
1,3-Dichlorobenzene	ND	0.0005	mg/L					
1,4-Dichlorobenzene	ND	0.0005	mg/L					
1,1-Dichloroethane	ND	0.0005	mg/L					
1,2-Dichloroethane	ND	0.0005	mg/L					

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
1,1-Dichloroethylene	ND	0.0005	mg/L					
cis-1,2-Dichloroethylene	ND	0.0005	mg/L					
trans-1,2-Dichloroethylene	ND	0.0005	mg/L					
1,2-Dichloroethylene, total	ND	0.0005	mg/L					
1,2-Dichloropropane	ND	0.0005	mg/L					
cis-1,3-Dichloropropylene	ND	0.0005	mg/L					
trans-1,3-Dichloropropylene	ND	0.0005	mg/L					
1,3-Dichloropropene, total	ND	0.0005	mg/L					
Ethylbenzene	ND	0.0005	mg/L					
Hexane	ND	0.0010	mg/L					
Methyl Ethyl Ketone (2-Butanone)	ND	0.0050	mg/L					
Methyl Isobutyl Ketone	ND	0.0050	mg/L					
Methyl tert-butyl ether	ND	0.0020	mg/L					
Methylene Chloride	ND	0.0050	mg/L					
Styrene	ND	0.0005	mg/L					
1,1,1,2-Tetrachloroethane	ND	0.0005	mg/L					
1,1,2,2-Tetrachloroethane	ND	0.0005	mg/L					
Tetrachloroethylene	ND	0.0005	mg/L					
Toluene	ND	0.0005	mg/L					
1,1,1-Trichloroethane	ND	0.0005	mg/L					
1,1,2-Trichloroethane	ND	0.0005	mg/L					
Trichloroethylene	ND	0.0005	mg/L					
Trichlorofluoromethane	ND	0.0010	mg/L					
Vinyl chloride	ND	0.0002	mg/L					
m,p-Xylenes	ND	0.0005	mg/L					
o-Xylene	ND	0.0005	mg/L					
Xylenes, total	ND	0.0005	mg/L					
Surrogate: 4-Bromofluorobenzene	0.0815		%	102	50-140			
Surrogate: Dibromofluoromethane	0.0687		%	85.9	50-140			
Surrogate: Toluene-d8	0.0807		%	101	50-140			

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Anions</b>									
Chloride	142	1	mg/L	141			0.2	20	
Fluoride	ND	0.1	mg/L	ND			NC	20	
Nitrate as N	2.91	0.1	mg/L	2.93			0.8	20	
Nitrite as N	ND	0.05	mg/L	ND			NC	20	
Sulphate	81.9	1	mg/L	81.3			0.8	20	
<b>General Inorganics</b>									
Alkalinity, total	181	5	mg/L	187			3.1	14	
Ammonia as N	ND	0.01	mg/L	0.049			NC	17.7	
Dissolved Organic Carbon	1.1	0.5	mg/L	1.0			8.8	37	
Colour	ND	2	TCU	ND			NC	12	
Conductivity	449	5	uS/cm	470			4.7	5	
pH	8.0	0.1	pH Units	8.0			0.1	3.3	
Phenolics	ND	0.001	mg/L	ND			NC	10	
Total Dissolved Solids	240	10	mg/L	258			7.2	10	
Sulphide	ND	0.02	mg/L	ND			NC	10	
Tannin & Lignin	ND	0.1	mg/L	ND			NC	11	
Total Kjeldahl Nitrogen	ND	0.1	mg/L	ND			NC	16	
Turbidity	3.6	0.1	NTU	3.4			6.8	10	
<b>Hydrocarbons</b>									
F1 PHCs (C6-C10)	ND	0.0250	mg/L	ND			NC	30	
<b>Metals</b>									
Aluminum	0.001	0.001	mg/L	ND			NC	20	
Antimony	ND	0.0005	mg/L	ND			NC	20	
Arsenic	ND	0.001	mg/L	ND			NC	20	
Barium	0.127	0.001	mg/L	0.122			4.3	20	
Beryllium	ND	0.0005	mg/L	ND			NC	20	
Boron	0.05	0.01	mg/L	0.05			1.5	20	
Cadmium	ND	0.0001	mg/L	ND			NC	20	
Calcium	51.0	0.1	mg/L	51.0			0.0	20	
Chromium	ND	0.001	mg/L	ND			NC	20	

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Cobalt	ND	0.0005	mg/L	ND			NC	20	
Copper	0.0009	0.0005	mg/L	0.0009			2.0	20	
Iron	0.5	0.1	mg/L	0.5			1.8	20	
Lead	0.0001	0.0001	mg/L	0.0001			0.4	20	
Magnesium	18.7	0.2	mg/L	18.5			0.9	20	
Manganese	0.014	0.005	mg/L	0.015			1.2	20	
Molybdenum	0.0037	0.0005	mg/L	0.0038			2.6	20	
Nickel	ND	0.001	mg/L	ND			NC	20	
Potassium	2.1	0.1	mg/L	2.0			2.4	20	
Selenium	ND	0.001	mg/L	ND			NC	20	
Silver	ND	0.0001	mg/L	0.0001			NC	20	
Sodium	11.1	0.2	mg/L	11.2			0.8	20	
Thallium	ND	0.001	mg/L	ND			NC	20	
Tin	ND	0.01	mg/L	ND			NC	20	
Titanium	ND	0.005	mg/L	ND			NC	50	
Tungsten	ND	0.01	mg/L	ND			NC	20	
Uranium	0.0004	0.0001	mg/L	0.0004			0.6	20	
Vanadium	ND	0.0005	mg/L	ND			NC	20	
Zinc	ND	0.005	mg/L	ND			NC	20	
<b>Microbiological Parameters</b>									
E. coli	ND	1	CFU/100mL	ND			NC	30	
Total Coliforms	1	1	CFU/100mL	1			0.0	30	
Fecal Coliforms	ND	1	CFU/100mL	ND			NC	30	
Heterotrophic Plate Count	10	10	CFU/mL	10			0.0	30	
<b>Volatiles</b>									
Acetone	ND	0.0050	mg/L	ND			NC	30	
Benzene	ND	0.0005	mg/L	ND			NC	30	
Bromodichloromethane	ND	0.0005	mg/L	ND			NC	30	
Bromoform	ND	0.0005	mg/L	ND			NC	30	
Bromomethane	ND	0.0005	mg/L	ND			NC	30	
Carbon Tetrachloride	ND	0.0002	mg/L	ND			NC	30	



Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Chlorobenzene	ND	0.0005	mg/L	ND			NC	30	
Chloroethane	ND	0.0010	mg/L	ND			NC	30	
Chloroform	ND	0.0005	mg/L	ND			NC	30	
Dibromochloromethane	ND	0.0005	mg/L	ND			NC	30	
Dichlorodifluoromethane	ND	0.0010	mg/L	ND			NC	30	
1,2-Dibromoethane	ND	0.0002	mg/L	ND			NC	30	
1,2-Dichlorobenzene	ND	0.0005	mg/L	ND			NC	30	
1,3-Dichlorobenzene	ND	0.0005	mg/L	ND			NC	30	
1,4-Dichlorobenzene	ND	0.0005	mg/L	ND			NC	30	
1,1-Dichloroethane	ND	0.0005	mg/L	ND			NC	30	
1,2-Dichloroethane	ND	0.0005	mg/L	ND			NC	30	
1,1-Dichloroethylene	ND	0.0005	mg/L	ND			NC	30	
cis-1,2-Dichloroethylene	ND	0.0005	mg/L	ND			NC	30	
trans-1,2-Dichloroethylene	ND	0.0005	mg/L	ND			NC	30	
1,2-Dichloropropane	ND	0.0005	mg/L	ND			NC	30	
cis-1,3-Dichloropropylene	ND	0.0005	mg/L	ND			NC	30	
trans-1,3-Dichloropropylene	ND	0.0005	mg/L	ND			NC	30	
Ethylbenzene	ND	0.0005	mg/L	ND			NC	30	
Hexane	ND	0.0010	mg/L	ND			NC	30	
Methyl Ethyl Ketone (2-Butanone)	ND	0.0050	mg/L	ND			NC	30	
Methyl Isobutyl Ketone	ND	0.0050	mg/L	ND			NC	30	
Methyl tert-butyl ether	ND	0.0020	mg/L	ND			NC	30	
Methylene Chloride	ND	0.0050	mg/L	ND			NC	30	
Styrene	ND	0.0005	mg/L	ND			NC	30	
1,1,1,2-Tetrachloroethane	ND	0.0005	mg/L	ND			NC	30	
1,1,2,2-Tetrachloroethane	ND	0.0005	mg/L	ND			NC	30	
Tetrachloroethylene	ND	0.0005	mg/L	ND			NC	30	
Toluene	ND	0.0005	mg/L	ND			NC	30	
1,1,1-Trichloroethane	ND	0.0005	mg/L	ND			NC	30	
1,1,2-Trichloroethane	ND	0.0005	mg/L	ND			NC	30	
Trichloroethylene	ND	0.0005	mg/L	ND			NC	30	

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Trichlorofluoromethane	ND	0.0010	mg/L	ND			NC	30	
Vinyl chloride	ND	0.0002	mg/L	ND			NC	30	
m,p-Xylenes	ND	0.0005	mg/L	ND			NC	30	
o-Xylene	ND	0.0005	mg/L	ND			NC	30	
Surrogate: 4-Bromofluorobenzene	0.0977		%		122	50-140			
Surrogate: Dibromofluoromethane	0.0624		%		78.0	50-140			
Surrogate: Toluene-d8	0.0799		%		99.9	50-140			

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Anions</b>									
Chloride	150	1	mg/L	141	89.5	70-124			
Fluoride	0.93	0.1	mg/L	ND	93.0	70-130			
Nitrate as N	3.95	0.1	mg/L	2.93	102	77-126			
Nitrite as N	0.944	0.05	mg/L	ND	94.4	82-115			
Sulphate	90.8	1	mg/L	81.3	95.8	70-130			
<b>General Inorganics</b>									
Ammonia as N	1.09	0.01	mg/L	0.049	104	81-124			
Dissolved Organic Carbon	11.7	0.5	mg/L	1.8	99.1	60-133			
Phenolics	0.026	0.001	mg/L	ND	103	74-126			
Total Dissolved Solids	86.0	10	mg/L	ND	86.0	75-125			
Sulphide	0.49	0.02	mg/L	ND	98.4	79-115			
Tannin & Lignin	1.1	0.1	mg/L	ND	112	71-113			
Total Kjeldahl Nitrogen	0.92	0.1	mg/L	ND	91.7	81-126			
<b>Hydrocarbons</b>									
F1 PHCs (C6-C10)	1.99	0.0250	mg/L	ND	99.3	85-115			
F2 PHCs (C10-C16)	1.9	0.1	mg/L	ND	120	60-140			
F3 PHCs (C16-C34)	4.7	0.1	mg/L	ND	121	60-140			
F4 PHCs (C34-C50)	3.2	0.1	mg/L	ND	131	60-140			
<b>Metals</b>									
Aluminum	49.0	0.001	mg/L	0.993	95.9	80-120			
Arsenic	52.5	0.001	mg/L	0.215	105	80-120			
Barium	160	0.001	mg/L	122	76.4	80-120			QM-07
Beryllium	50.7	0.0005	mg/L	0.0461	101	80-120			
Boron	88.6	0.01	mg/L	45.2	86.7	80-120			
Cadmium	47.2	0.0001	mg/L	0.0340	94.4	80-120			
Calcium	57200	0.1	mg/L	51000	62.7	80-120			QM-07
Chromium	48.4	0.001	mg/L	0.094	96.6	80-120			
Cobalt	47.2	0.0005	mg/L	0.0484	94.4	80-120			
Copper	47.2	0.0005	mg/L	0.910	92.6	80-120			
Iron	2660	0.1	mg/L	462	88.1	80-120			

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Lead	44.7	0.0001	mg/L	0.143	89.2	80-120			
Magnesium	25800	0.2	mg/L	18500	73.2	80-120			QM-07
Manganese	58.1	0.005	mg/L	14.5	87.0	80-120			
Molybdenum	46.6	0.0005	mg/L	3.81	85.5	80-120			
Nickel	47.2	0.001	mg/L	0.115	94.1	80-120			
Potassium	11600	0.1	mg/L	2000	96.1	80-120			
Selenium	48.6	0.001	mg/L	0.180	96.9	80-120			
Silver	48.2	0.0001	mg/L	0.112	96.3	80-120			
Sodium	19400	0.2	mg/L	11200	82.0	80-120			
Thallium	47.0	0.001	mg/L	0.044	93.9	80-120			
Tin	46.8	0.01	mg/L	0.23	93.1	80-120			
Titanium	58.7	0.005	mg/L	ND	117	70-130			
Tungsten	47.3	0.01	mg/L	0.61	93.4	80-120			
Uranium	48.8	0.0001	mg/L	0.443	96.7	80-120			
Vanadium	48.4	0.0005	mg/L	0.0464	96.7	80-120			
Zinc	46.9	0.005	mg/L	2.05	89.6	80-120			
<b>Semi-Volatiles</b>									
Acenaphthene	3.89	0.05	ug/L	ND	77.8	50-140			
Acenaphthylene	4.30	0.05	ug/L	ND	85.9	50-140			
Anthracene	4.96	0.01	ug/L	ND	99.2	50-140			
Benzo [a] anthracene	4.41	0.01	ug/L	ND	88.2	50-140			
Benzo [a] pyrene	3.23	0.01	ug/L	ND	64.6	50-140			
Benzo [b] fluoranthene	4.01	0.05	ug/L	ND	80.2	50-140			
Benzo [g,h,i] perylene	3.80	0.05	ug/L	ND	75.9	50-140			
Benzo [k] fluoranthene	4.49	0.05	ug/L	ND	89.7	50-140			
Chrysene	4.30	0.05	ug/L	ND	86.0	50-140			
Dibenzo [a,h] anthracene	3.89	0.05	ug/L	ND	77.8	50-140			
Fluoranthene	5.21	0.01	ug/L	ND	104	50-140			
Fluorene	3.80	0.05	ug/L	ND	76.0	50-140			
Indeno [1,2,3-cd] pyrene	3.54	0.05	ug/L	ND	70.9	50-140			
1-Methylnaphthalene	3.43	0.05	ug/L	ND	68.6	50-140			

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
2-Methylnaphthalene	3.67	0.05	ug/L	ND	73.5	50-140			
Naphthalene	3.72	0.05	ug/L	ND	74.4	50-140			
Phenanthrene	4.14	0.05	ug/L	ND	82.7	50-140			
Pyrene	5.20	0.01	ug/L	ND	104	50-140			
<i>Surrogate: 2-Fluorobiphenyl</i>	<i>15.4</i>		%		<i>77.1</i>	<i>50-140</i>			
<i>Surrogate: Terphenyl-d14</i>	<i>14.0</i>		%		<i>70.2</i>	<i>50-140</i>			
<b>Volatiles</b>									
Acetone	0.127	0.0050	mg/L	ND	127	50-140			
Benzene	0.0377	0.0005	mg/L	ND	94.4	60-130			
Bromodichloromethane	0.0349	0.0005	mg/L	ND	87.3	60-130			
Bromoform	0.0411	0.0005	mg/L	ND	103	60-130			
Bromomethane	0.0373	0.0005	mg/L	ND	93.2	50-140			
Carbon Tetrachloride	0.0341	0.0002	mg/L	ND	85.2	60-130			
Chlorobenzene	0.0430	0.0005	mg/L	ND	108	60-130			
Chloroethane	0.0475	0.0010	mg/L	ND	119	50-140			
Chloroform	0.0450	0.0005	mg/L	ND	112	60-130			
Dibromochloromethane	0.0340	0.0005	mg/L	ND	84.9	60-130			
Dichlorodifluoromethane	0.0454	0.0010	mg/L	ND	114	50-140			
1,2-Dibromoethane	0.0449	0.0002	mg/L	ND	112	60-130			
1,2-Dichlorobenzene	0.0458	0.0005	mg/L	ND	114	60-130			
1,3-Dichlorobenzene	0.0432	0.0005	mg/L	ND	108	60-130			
1,4-Dichlorobenzene	0.0464	0.0005	mg/L	ND	116	60-130			
1,1-Dichloroethane	0.0335	0.0005	mg/L	ND	83.8	60-130			
1,2-Dichloroethane	0.0367	0.0005	mg/L	ND	91.7	60-130			
1,1-Dichloroethylene	0.0482	0.0005	mg/L	ND	120	60-130			
cis-1,2-Dichloroethylene	0.0383	0.0005	mg/L	ND	95.7	60-130			
trans-1,2-Dichloroethylene	0.0371	0.0005	mg/L	ND	92.7	60-130			
1,2-Dichloropropane	0.0364	0.0005	mg/L	ND	91.1	60-130			
cis-1,3-Dichloropropylene	0.0411	0.0005	mg/L	ND	103	60-130			
trans-1,3-Dichloropropylene	0.0340	0.0005	mg/L	ND	85.0	60-130			
Ethylbenzene	0.0408	0.0005	mg/L	ND	102	60-130			

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Hexane	0.0353	0.0010	mg/L	ND	88.2	60-130			
Methyl Ethyl Ketone (2-Butanone)	0.0816	0.0050	mg/L	ND	81.6	50-140			
Methyl Isobutyl Ketone	0.0625	0.0050	mg/L	ND	62.5	50-140			
Methyl tert-butyl ether	0.0798	0.0020	mg/L	ND	79.8	50-140			
Methylene Chloride	0.0364	0.0050	mg/L	ND	91.1	60-130			
Styrene	0.0307	0.0005	mg/L	ND	76.8	60-130			
1,1,1,2-Tetrachloroethane	0.0349	0.0005	mg/L	ND	87.2	60-130			
1,1,2,2-Tetrachloroethane	0.0337	0.0005	mg/L	ND	84.2	60-130			
Tetrachloroethylene	0.0473	0.0005	mg/L	ND	118	60-130			
Toluene	0.0420	0.0005	mg/L	ND	105	60-130			
1,1,1-Trichloroethane	0.0423	0.0005	mg/L	ND	106	60-130			
1,1,2-Trichloroethane	0.0438	0.0005	mg/L	ND	110	60-130			
Trichloroethylene	0.0422	0.0005	mg/L	ND	106	60-130			
Trichlorofluoromethane	0.0467	0.0010	mg/L	ND	117	60-130			
Vinyl chloride	0.0508	0.0002	mg/L	ND	127	50-140			
m,p-Xylenes	0.103	0.0005	mg/L	ND	128	60-130			
o-Xylene	0.0429	0.0005	mg/L	ND	107	60-130			
Surrogate: 4-Bromofluorobenzene	0.0865		%		108	50-140			
Surrogate: Dibromofluoromethane	0.0728		%		91.0	50-140			
Surrogate: Toluene-d8	0.0734		%		91.8	50-140			

Certificate of Analysis

Report Date: 29-Nov-2023

Client: LRL Associates Ltd.

Order Date: 23-Nov-2023

Client PO:

Project Description: 01348

**Qualifier Notes:**

**Login Qualifiers :**

Container(s) - Labeled improperly/insufficient information - All bottles missing sample time.

Applies to Samples: 5546 Albion Road

**Sample Qualifiers :**

**QC Qualifiers:**

QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

**Sample Data Revisions:**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

***CCME PHC additional information:***

- The method for the analysis of PHCs complies with the Reference Method for the CWS PHC and is validated for use in the laboratory. All prescribed quality criteria identified in the method has been met.
- F1 range corrected for BTEX.
- F2 to F3 ranges corrected for appropriate PAHs where available.
- The gravimetric heavy hydrocarbons (F4G) are not to be added to C6 to C50 hydrocarbons.
- In the case where F4 and F4G are both reported, the greater of the two results is to be used for comparison to CWS PHC criteria.
- When reported, data for F4G has been processed using a silica gel cleanup.

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.



Parcel ID: 2347319



Parcel Order Number	Chain Of Custody
2347319	Ontario Drinking Water Samples
	No 13259

Client Name: LRL Associates Ltd	Project Ref: 01348	Waterworks Name: MacEwen Petroleum	Samples Taken By:
Contact Name: Jessica Arthurs	Quote #:	Waterworks Number:	Name: Jessica Arthurs
Address: 5430 CANOTEK RD OTTAWA, ON K1J 9G2	PO #:	Address: 5546 Albion Road	Signature: <i>J Arthurs</i>
After Hours Contact: Jessica Arthurs	E-mail: jarthurs@lrl.ca	Ottawa, Ontario #	Page 1 of 1
Telephone: 613 978 0658	Fax: 613 842 4338	Public Health Unit:	Turn Around Time Required: <input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day

Samples Submitted Under: (Indicate ONLY one) <input checked="" type="checkbox"/> ON REG 170/03 <input type="checkbox"/> ON REG 319/08 <input type="checkbox"/> Private Well <input type="checkbox"/> ON REG 243/07 <input type="checkbox"/> Other		Sample Type: R = Raw ; T = Treated ; D = Distribution ; P = Plumbing Source Type: G = Ground Water ; S = Surface Water Reportable: Requires AWQI reporting as per Regulation - Y = Yes ; N = No		Required Analyses															
Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A		Are these samples for human consumption?: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		All information must be completed before samples will be processed.															
LOCATION NAME	SAMPLE ID	Sample Type: R/T/D/P	Source Type: G/S	Reportable: Y/N	Resample	SAMPLE COLLECTED		# of Containers	Free/Combined Chlorine Residual mg/L	Standing / Flushed: S/F (REG 243)	Total Coliform/E. Coll	HPC	Lead	THM	Substance 909	Trace Metals	PAH	VOC, PHC	
						DATE	TIME												
1 5546 Albion Road	5546 Albion Road	R	G	N	N	2023/11/23	8:05 AM	13	0.01	F						X	X	X	X
2																			
3																			
4																			
5																			
6																			
7																			
8																			
9																			
10																			

Comments:		Method of Delivery: <i>Walker</i>	
Relinquished By (Sign): <i>J Arthurs</i>	Received By Driver/Depot: <i>855</i>	Received at Lab: <i>855</i>	Verified By: <i>SO</i>
Relinquished By (Print): Jessica Arthurs	Date/Time: <i>Nov 23/23</i>	Date/Time: <i>Nov 23/23</i>	Date/Time: <i>Nov 23, 2023 12:25p</i>
Date/Time: <i>Nov 23, 2023 8:55 AM</i>	Temperature: °C	Temperature: <i>11.4</i> °C	pH Verified: <input checked="" type="checkbox"/> By: <i>SO</i>



**ATTACHMENT J**  
**OSSO Permit**



Ottawa Septic Bureau des systèmes  
System Office septiques d'Ottawa

3889 Rideau Valley Drive Box 599 Manotick, ON K4M 1A5

Phone: 613-692-3571 **PRESS "4" for septic office**, 1-800-267-3504 Fax: 613-692-1507

Address of property: 5546 Albion Rd Township: OSG-HUN-GLO-FIT-CUM-NEP-GOU-RID-KAN-TOR

Contact for pickup: GVE/MacEwen Phone#/Email: \_\_\_\_\_

### INFORMATION FOR OWNER/API

Attached is your Sewage System Permit. A minimum of two inspections are required for your proposed sewage system can be approved for use (additional inspections may be required for clay soils/bedrock and/or re-inspections). Inspections must be requested in writing. Please see attached:

- Inspection fax request form (all inspections MUST be requested in writing)
- As-built components and drawing form
- Copy of the approved application and schedule pages
- Approved Part 8 permit 2x copies: **Copy 1: APPLICANT** + **Copy 2: Plans Examiner** \*\* Agent Deliver Direct To City

**\*\*NON-RESIDENTIAL\*\***

- Commercial
- Industrial
- Institutional

#### Special Note

- A permit is valid for 12 months from the original date of issuance noted in "permit date". If lapsed, it may be renewed only once for a period of 12 months from the date of expiry.

- No person shall make a material change or cause a material change to be made to a plan, specification, document or other information on the basis of which a permit was issued without notifying, filing details with and obtaining the authorization of the Chief Building Official. (Building Code Act 1992, c.23, s.8(12))

#### Sewage System Permit Construction Requirements

##### 1. Clay Soils/Bedrock only (if required per issued Approval)

In clay soils/bedrock, a site preparation inspection is required. The total contact area must be properly prepared. Scarification must be done under dry conditions prior to importing leaching bed fill.

##### 2. Installation Inspection – 2<sup>nd</sup> inspection

When the sewage system is substantially completed (i.e., before the final fill is placed over the septic tank and leaching bed system) an installation inspection is required. Prior to any inspection request, the following must be submitted:

- "as-built components" and "as-built drawings" — see attached form
- "engineer letter" — if the system is engineered
- grain size analysis and weight bills for all Filter Media types of septic systems
- Weight bills for washed septic stone, where applicable
- Maintenance/service contract for treatment unit installed

##### 3. Final Grading Inspection – 3<sup>rd</sup> inspection

When construction of the sewage system is complete, a final grading inspection is required. Before a Certificate of Completion can be issued, the following must be complete:

- The leaching bed and septic tank must be covered with sand fill and topsoil and graded accordingly
- All conditions of the Sewage System Permit & comments on the installation inspection report must be met
- The depth of cover & material type must be identified by inspection pipes or holes placed over trenches at 4 corners of bed
- The 4 corners of the bed must be staked

June 2019

Phone Folder Name:  PickUp

Canada Post to:

Weekly Courier

R.V.C.A. RECEIVED

SEP 19 2022

Email: [septic@rvca.ca](mailto:septic@rvca.ca)

SEPTIC FILE #

22 - 398





# Green Valley Environmental Inc.


## LETTER OF AUTHORIZATION

Owner: MacEwen Petroleum Inc.  
 Address: 18 Adelaide St.  
Maxville, ON, K0C 1T0

Phone No.: (613) 527-2100 Cell No.: \_\_\_\_\_  
 Work No.: (613) 527-2728 Fax No.: \_\_\_\_\_

### LOCATION OF PROPERTY:

Lot No.: 30  
 Concession No.: 3  
 Sub lot/Part No.: \_\_\_\_\_  
 R. Plan No.: \_\_\_\_\_  
 Civic Address: 5546 Albion Rd.  
 Municipality: Gloucester  
 Roll No.: \_\_\_\_\_

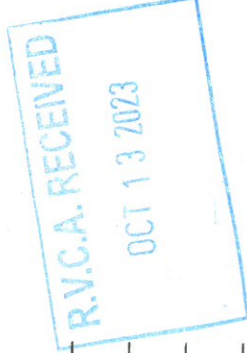

SEPTIC FILE #

22-398

OTTAWA

Commercial: (provide description of building and intended use)

Convenience store + Gas Station

I, the above – mentioned authorize Green Valley Environmental Services to act as my agent to apply for and obtain a sewage system permit from the responsible Approval Agency.

Signature: *Frank Loutle* Date: 08/10/2022

# Application for a Permit to Construct or Demolish

This form is authorized under subsection 8(1.1) of the Building Code Act, 1992

For use by Principal Authority			
Application number:	Permit number (if different):		
Date received:	Roll number:		
<b>OTTAWA SEPTIC SYSTEM OFFICE</b>			
Application submitted to: _____ (Name of municipality, upper-tier municipality, board of health or conservation authority)			
A. Project information			
Building number, street name	Unit number	Lot/con.	
Municipality	Plan number/other description		
Project value est. \$	Area of work (m <sup>2</sup> )		
B. Purpose of application			
<input checked="" type="checkbox"/> New construction	Addition to an existing building	Alteration/repair	Demolition
Proposed use of building	Current use of building		
Description of proposed work			
C. Applicant			
Last name	Applicant is:	Owner or	Authorized agent of owner
Street address	First name	Corporation or partnership	
Municipality	Postal code	Province	Unit number
Telephone number	Fax		E-mail
<b>D. Owner (if different from applicant)</b>			
Last name	First name	Corporation or partnership	Unit number
Street address	Postal code	Province	E-mail
Municipality	Fax		Cell number

R.V.C.A. RECEIVED  
 OCT 13 2023

SEPTIC FILE #  
 22-398

Commercial  
 Commercial  
 Commercial

Install new septic system for proposed/replacement  
 Commercial.

Patel  
 6107 First Line Rd.  
 North Gowers  
 K4M 1A7  
 (613) 692-2616  
 Gowers  
 Green Valley Environmental Inc.  
 engineering@greenvalley.ca  
 (613) 229-3900

Maxville  
 18 Adelaide St.  
 Maxville Petroleum Inc.  
 K0C 1T0  
 (613) 527-2100

Application for a Permit to Construct or Demolish – Effective January 1, 2014

**E. Builder (optional)**

Last name	First name	Corporation or partnership (if applicable)	
Street address	SEPTIC FILE #		
Municipality	Postal code	Province	Lot/con.
Telephone number	Fax	Cell number	
( )	( )	( )	

**F. Taron Warranty Corporation (Ontario New Home Warranty Program)**

i. Is proposed construction for a new home as defined in the <i>Ontario New Home Warranties Plan Act</i> ? If no, go to section G.	Yes	No
ii. Is registration required under the <i>Ontario New Home Warranties Plan Act</i> ?	Yes	No

iii. If yes to (ii) provide registration number(s): \_\_\_\_\_

**G. Required Schedules**

- i) Attach Schedule 1 for each individual who reviews and takes responsibility for design activities.  
 ii) Attach Schedule 2 where application is to construct on-site, install or repair a sewage system.

**H. Completeness and compliance with applicable law**

i) This application meets all the requirements of clauses 1.3.1.3 (5) (a) to (d) of Division C of the Building Code (the application is made in the correct form and by the owner or authorized agent, all applicable fields have been completed on the application and required schedules, and all required schedules are submitted). Payment has been made of all fees that are required, under the applicable by-law, resolution or regulation made under clause 7(1)(c) of the <i>Building Code Act, 1992</i> , to be paid when the application is made.	Yes	No
ii) This application is accompanied by the plans and specifications prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> .	Yes	No
iii) This application is accompanied by the information and documents prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> which enable the chief building official to determine whether the proposed building, construction or demolition will contravene any applicable law.	Yes	No
iv) The proposed building, construction or demolition will not contravene any applicable law.	Yes	No

**I. Declaration of applicant**

I, Davis Patel declare that:  
 (print name)

Date Oct 13, 2023 Signature of applicant [Signature]

- The information contained in this application, attached schedules, attached plans and specifications, and other attached documentation is true to the best of my knowledge.
- If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.

Personal information contained in this form and schedules is collected under the authority of subsection 8(1.1) of the *Building Code Act, 1992*, and will be used in the administration and enforcement of the *Building Code Act, 1992*. Questions about the collection of personal information may be addressed to: a) the Chief Building Official of the municipality or upper-tier municipality to which this application is being made, or b) the inspector having the powers and duties of a chief building official in relation to sewage systems or plumbing for an upper-tier municipality, board of health or conservation authority to whom this application is made, or, c) Director, Building and Development Branch, Ministry of Municipal Affairs and Housing 777 Bay St., 2nd Floor, Toronto, M5G 2E5 (416) 585-6666.

# Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

**A. Project Information**

Building number, street name: 5546 Albion Rd. Unit no.: \_\_\_\_\_ Lot/con.: 30/3

Municipality: Windsor Postal code: K9X 1A5 Plan number/ other description: \_\_\_\_\_

**B. Individual who reviews and takes responsibility for design activities**

Name: Davis Patel Firm: Green Valley Environmental Inc.

Street address: 6107 First Line Rd. Unit no.: \_\_\_\_\_ Lot/con.: \_\_\_\_\_

Municipality: North Green Postal code: K9M 1A7 Province: ON

Telephone number: (613) 692-2616 Fax number: \_\_\_\_\_ E-mail: Engineering@greenvale.ca

**C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1. of Division C]**

House \_\_\_\_\_ HVAC - House \_\_\_\_\_ Building Structural \_\_\_\_\_

Small Buildings \_\_\_\_\_ Building Services \_\_\_\_\_ Plumbing - House \_\_\_\_\_

Large Buildings \_\_\_\_\_ Detection, Lighting and Power \_\_\_\_\_ Plumbing - All Buildings \_\_\_\_\_

Complex Buildings \_\_\_\_\_ Fire Protection \_\_\_\_\_ On-site Sewage Systems

Description of designer's work: Design a septic system for proposed/replacement commercial building.

**D. Declaration of Designer**

I, Davis Patel (print name) declare that (choose one as appropriate):

I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories.

Individual BCIN: 119685 Firm BCIN: 16035 **SEPTIC FILE #**

Individual BCIN: \_\_\_\_\_ Firm BCIN: \_\_\_\_\_ **22-398**

Basis for exemption from registration: OTTAWA

The design work is exempt from the registration and qualification requirements of the Building Code.

Basis for exemption from registration and qualification: \_\_\_\_\_

I certify that:

- The information contained in this schedule is true to the best of my knowledge.
- I have submitted this application with the knowledge and consent of the firm.


Date: Oct 13, 2023 Signature of Designer: [Signature]

R.V.C.A. RECEIVED  
OCT 13 2023

**NOTE:**

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) (C) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of practice, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

## Schedule 2: Sewage System Installer Information

<b>A. Project Information</b>			
Building number, street name 5546 Albion Rd.	Unit number	Lot/con.	3013
Municipality Windsor	Postal code K1X 1A5	Plan number/ other description	
<b>B. Sewage system installer</b>			
Is the installer of the sewage system engaged in the business of constructing on-site, installing, repairing, servicing, cleaning or emptying sewage systems, in accordance with Building Code Article 3.3.1.1, Division C? Yes (Continue to Section C)      No (Continue to Section E) <input checked="" type="checkbox"/> Installer unknown at time of application (Continue to Section E)			
<b>C. Registered installer information (where answer to B is "Yes")</b>			
Name		BCIN	
Street address		Unit number	Lot/con.
Municipality	Postal code	Province	
Telephone number ( ) ( )	Fax ( ) ( )	E-mail	
<b>D. Qualified supervisor information (where answer to section B is "Yes")</b>		Building Code Identification Number (BCIN)	
Name of qualified supervisor(s) R.V.G.A. RECEIVED OCT 13 2023		22-398	
<b>E. Declaration of Applicant:</b>			
I, <u>Davis Patel</u> (print name) declare that:			
I am the applicant for the permit to construct the sewage system. If the installer is unknown at time of application, I shall submit a new Schedule 2 prior to construction when the installer is known;			
OR			
I am the holder of the permit to construct the sewage system, and am submitting a new Schedule 2, now that the installer is known.			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge.			
2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.			
Date	Signature of applicant		
Oct 13, 2023			



R.V.C.A. RECEIVED  
OCT 13 2023

Do Not Complete  
Permit # \_\_\_\_\_  
Revision # \_\_\_\_\_  
Date \_\_\_\_\_

### Schedule 4 Proposed Services Complete Sections 1 thru 7

#### 1. Engineered

- Yes
- No

#### 2. Water supply

- Proposed
- Existing

#### 3. Type of work proposed

- New Installation
- Replacement
- Alteration

#### 4. Type of Well

- Dug/bored/Sandpoint well
- Drilled well
- Municipal
- Other

#### 5. Residential Sewage Design Flow Info.

Bedrooms \_\_\_\_\_  
House (floor area) \_\_\_\_\_ m<sup>2</sup>  
People \_\_\_\_\_  
Total Fixture Units \_\_\_\_\_ (Schedule 8)  
Residential Flow \_\_\_\_\_ L/day

#### 6. Sewage Design Flow Other Occupancies

Design Flow 7720 L/day  
Detailed sewage flow calculations:  
Store: Water Closet 4x950 = 3800 L/day  
Wired Outlets 7x560 = 3920 L/day  
7720 L/day

#### 7. Type of System

- Treatment Unit \_\_\_\_\_
- Class 2 – Leaching Pit
- Class 3 – Cesspool
- Class 4 – Shallow Buried Trench
- Class 4 – Trench (schedule 9)
  - Fully raised
  - Partially raised
  - In-ground
- Class 4 – Filter Media (schedule 10)
  - Fully raised
  - Partially raised
  - In-ground

#### Class 4 – BMEC Area Bed (Schedule 11)

- Fully raised
- Partially raised
- In-ground
- Class 4 – “Type A” Dispersal (Schedule 13)
  - Fully raised
  - Partially raised
  - In-ground
- Class 4 – “Type B” Dispersal (Schedule 14)
  - Fully raised
  - Partially raised
  - In-ground

- Class 5 – Holding Tank (9000L min)
- Tank/Treatment Unit/Pump Chamber ONLY
- Effluent Filter/Risers ONLY

SEPTIC FILE #  
22-398

OTTAWA





**RECEIVED**  
OCT 13 2023

**SEPTIC FILES**  
22-398

**Schedule 5 OTTAWA Sewage System Details**

Not Complete  
Permit No \_\_\_\_\_  
Revision No \_\_\_\_\_  
Date \_\_\_\_\_

Type of System Class 4 Filter Media Bed (Schedule 4)  
 Septic/Holding Tank Size: 900 Litres Make: MacKreger  
 Septic Tank Effluent Filter Make: Polylok Model: PL-250

Treatment Unit - Make & Model Norsweco HK 4730L-3M

Number of Units: 2 Other: \_\_\_\_\_

Refer to Typical Drawing # PL-S-1174 Pump(s) required Liberty 250 (0.5hp)

Mantle Information: Pump Rate L/15min

Native or imported = 15m in \_\_\_\_\_ direction(s) **Note:** Alarm required for all pumping systems

Slope subgrade \_\_\_\_\_ % slope  
 \_\_\_\_\_ direction(s)

Site to be Scarified (If clay) YES (NO)  
 Clay Seal Required (If bedrock) YES (NO)

Trench  Shallow Buried Trench  
 Distribution Pipe Length \_\_\_\_\_ m Pipe Length \_\_\_\_\_ m  
 Loading Area \_\_\_\_\_ m<sup>2</sup>

Type of Chamber \_\_\_\_\_  Filter Media Bed  
 Length of Chamber \_\_\_\_\_ m Stone 96 m<sup>2</sup>

Dispersal Bed Extended Base 96 m<sup>2</sup>  
 BMEC  Type A  Type B Pipe 84 m

Stone \_\_\_\_\_ m<sup>2</sup> Weight of Filter Media \_\_\_\_\_ Kg  
 Sand \_\_\_\_\_ m<sup>2</sup> Loading Area 772 m<sup>2</sup>  
 Pipe \_\_\_\_\_ m<sup>2</sup> (Native)

Linear Loading \_\_\_\_\_ L/m<sup>2</sup>

Tank/Treatment Unit/Pump Chamber Replacement ONLY  
 Effluent Filter & Riser ONLY

Construction Notes:

---



---



---



Ottawa Septic Bureau des systèmes  
System Office septiques d'Ottawa

R.V.C.A. RECEIVED SEPTIC FILE #

22-398

Do Not Complete  
Permit # \_\_\_\_\_  
Revision # \_\_\_\_\_  
Date \_\_\_\_\_

Schedule 64WA /

**Soil and Water Table Information**  
(Minimum depth of test pit: 2 metres)

Name of Applicant/Agent: <u>Davis Hotel</u> Date: <u>Apr 19, 2022</u> Time: <u>9 AM</u> Applicant/Agent Signature: <u>[Signature]</u>		Inspector: <u>Ryan H. Lemstra</u> Date: <u>Oct 23/23</u> Time: _____ Inspector Signature: <u>[Signature]</u>	
EG (.....) <u>103.68</u> 	T	EG (.....) <u>103.70</u> 	
EG (.....) _____ 	T	EG (.....) _____ 	

**LEGEND**  
 BR = Bedrock  
 GWT = Ground water table  
 HGWT = High ground water table  
 M = metres  
 EG = Existing grade  
 T = percolation rate



Do Not Complete


Permit # \_\_\_\_\_

Revision # \_\_\_\_\_

Date \_\_\_\_\_

**Schedule 7  
Layout Section**

Scale: 1Block = NTS

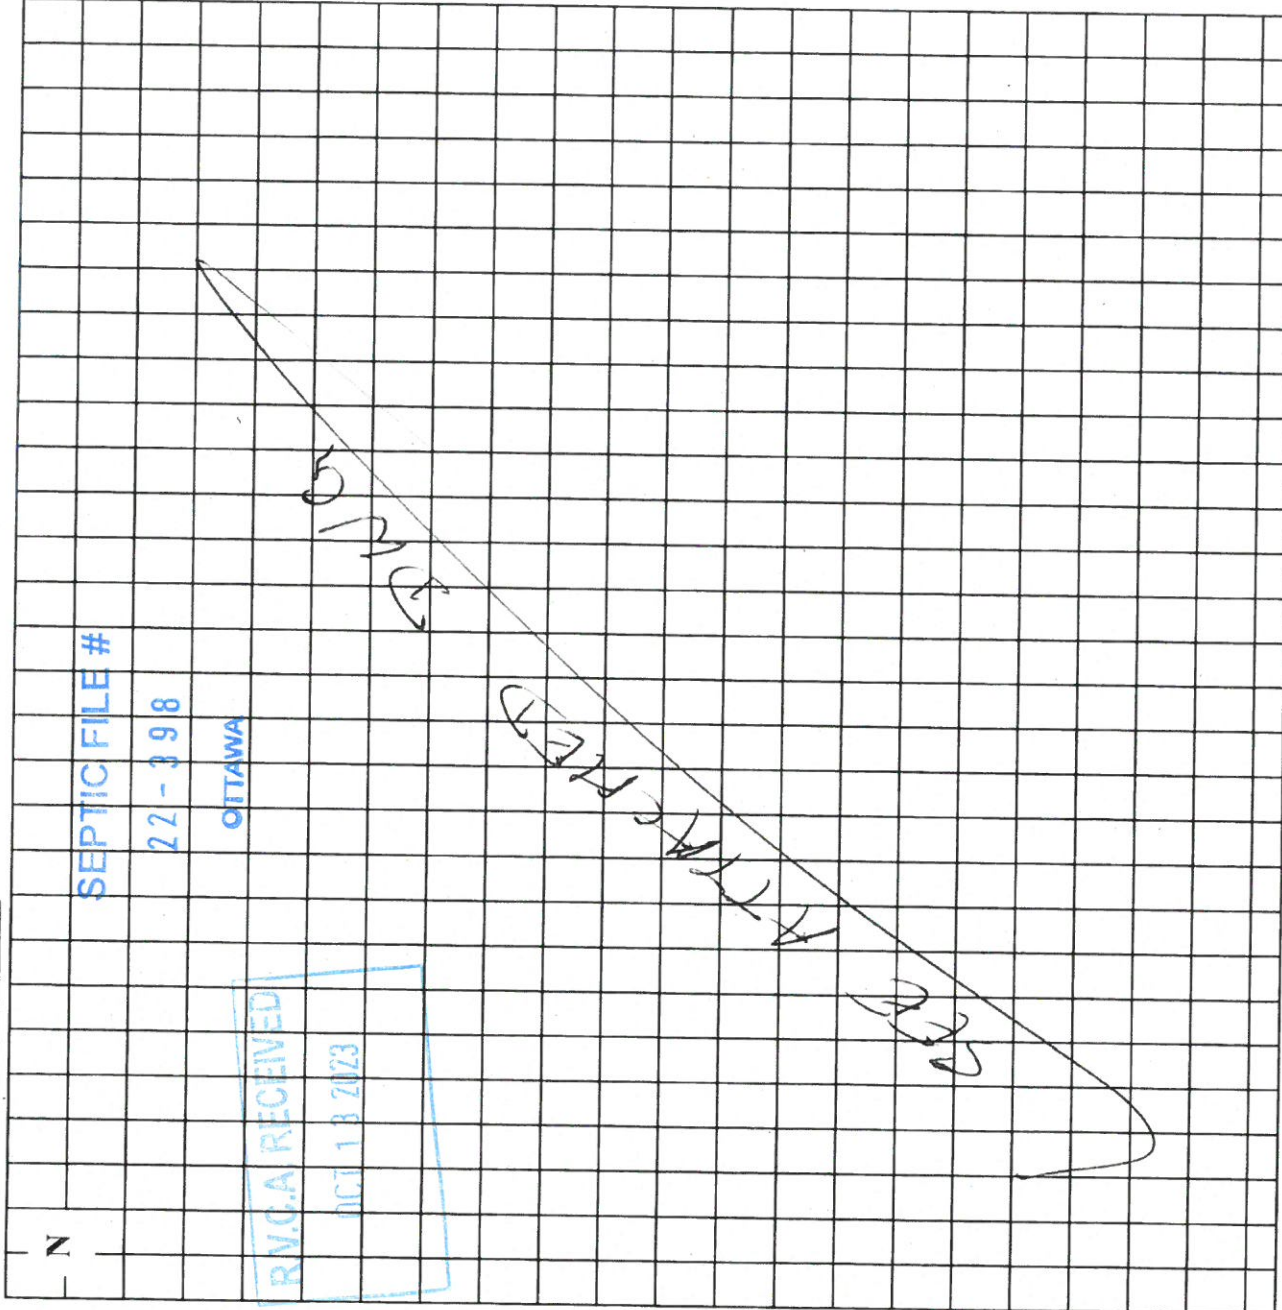

o Dug Well • Drilled Well ▲ Neighbouring Homes ◊ Benchmark --- Tile Drainage --- Property Line

Elevations (metric only)

B.M. 104-48 m

B.M. Description Nail on hydro pole

Exact Location North corner of property.

Min. of 5 elevations in proposed system area (in X pattern)

X<sub>1</sub>

X<sub>3</sub>

X<sub>5</sub>

X<sub>7</sub>

~~SEE ATTACHED DRAWING~~

SEE

X<sub>4</sub>

X<sub>6</sub> (toe)

X<sub>8</sub>



R.V.C.A. RECEIVED

OCT 13 2023

SEPTIC PERMIT #

22-398

Do Not Complete

Permit # \_\_\_\_\_

Revision # \_\_\_\_\_

Date \_\_\_\_\_

**Schedule 8**  
**Fixture unit count**

Fixtures	# Existing	+ # Proposed	X	unit count =	Fixture Count
<b>Bathroom</b>					
Bathroom group (toilet, sink and tub or shower) installed in the <u>same</u> room		+	X	6	=
Bathtub with/without overhead shower		+	X	1.5	=
1 Urinal	2	+	X	1.5	= 3
Wash basin (SINK) (1 1/2 inch trap)	5	+	X	1.5	= 7.5
Watercloset (TOILET) tank operated	4	+	X	4	= 16
Bidet		+	X	1	=
<b>Kitchen</b>					
Dishwasher		+	X	1	=
Sink with/without garbage grinder(s), domestic and other small type single, double or 2 single with a common trap		+	X	1.5	=
<b>Other</b>					
Domestic washing machine		+	X	1.5	=
Combination sink and laundry tray single or double (Installed on 1 1/2 trap)		+	X	1.5	=

**\*Total: 26.5**

**\*Insert the TOTAL in section 5 of Schedule 4 (O.Reg 151/13 Table 7.4.9.3)**

1. **Sump pumps and floor drains are not to be connected to the sewage system.** Connection of such fixtures to a sewage system may lead to a hydraulic failure of the said system. The above mentioned fixtures should be discharged separately to an approved Class 2 (leaching pit) sewage system.
2. Where laundry waste is not more than 20% of the total daily design sanitary sewage flow, it may discharge to a sewage system (Part 8, OBC, 8.1.3.1(2)).

*[Signature]*

Agent/Owner signature

Oct 13, 2023

Date


Do Not Complete  
 Permit # \_\_\_\_\_  
 Revision # \_\_\_\_\_  
 Date \_\_\_\_\_

**Ottawa Septic System Office**  
 Bureau des systèmes septiques d'Ottawa  
 TYPICAL DRAWING B  
 BURIED OR RAISED TILE BED  
 FILTER MEDIA METHOD

**R.V.C.A. RECEIVED**  
 OCT 13 2023  
**SEPTIC FILE #**  
 22-398  
 OTTAWA

*RAY*  
*Oct 23/23*

Approved Grades	Installation Grades	Proposed Grades	As per Agent
Existing Grade		103.90	
		103.45	
		103.30	
		102.55	
		102.40	

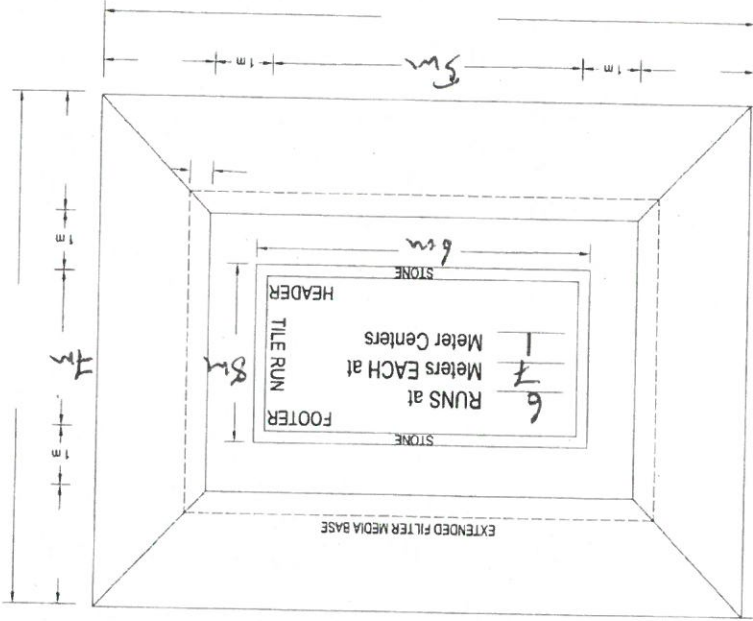

**Plan View**


SAND AREA = *772 m²*

CLAY SEAL REQUIRED:  No  Yes

SCAFFOLDING REQUIRED:  No  Yes

MANTE REQUIRED:  No  Yes


**Cross-Section Profile**

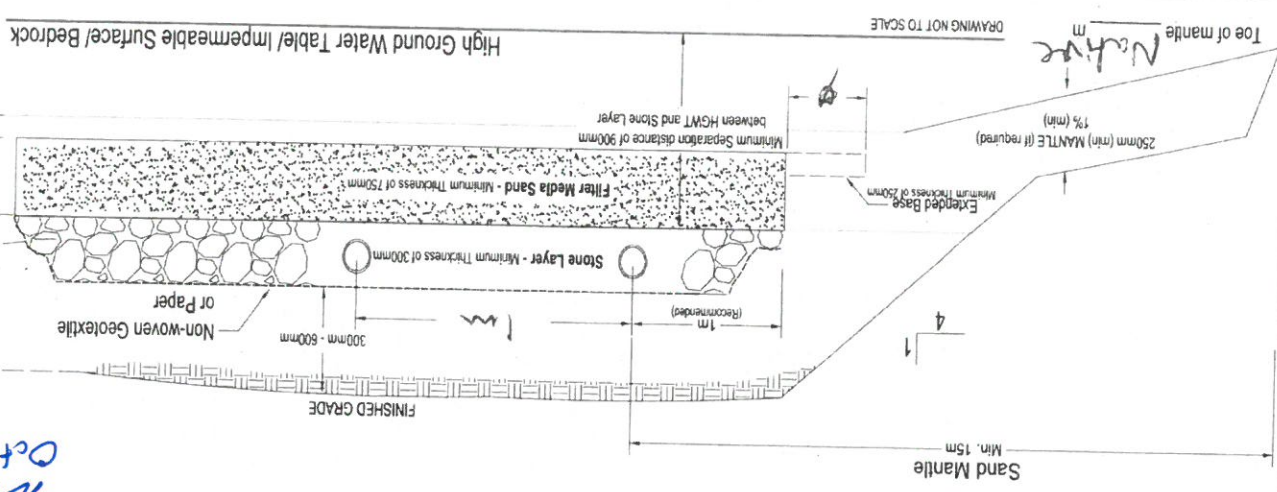

SEPTIC FILE # 22-398

R.V.C.A. RECEIVED  
OCT 13 2023

OTTAWA

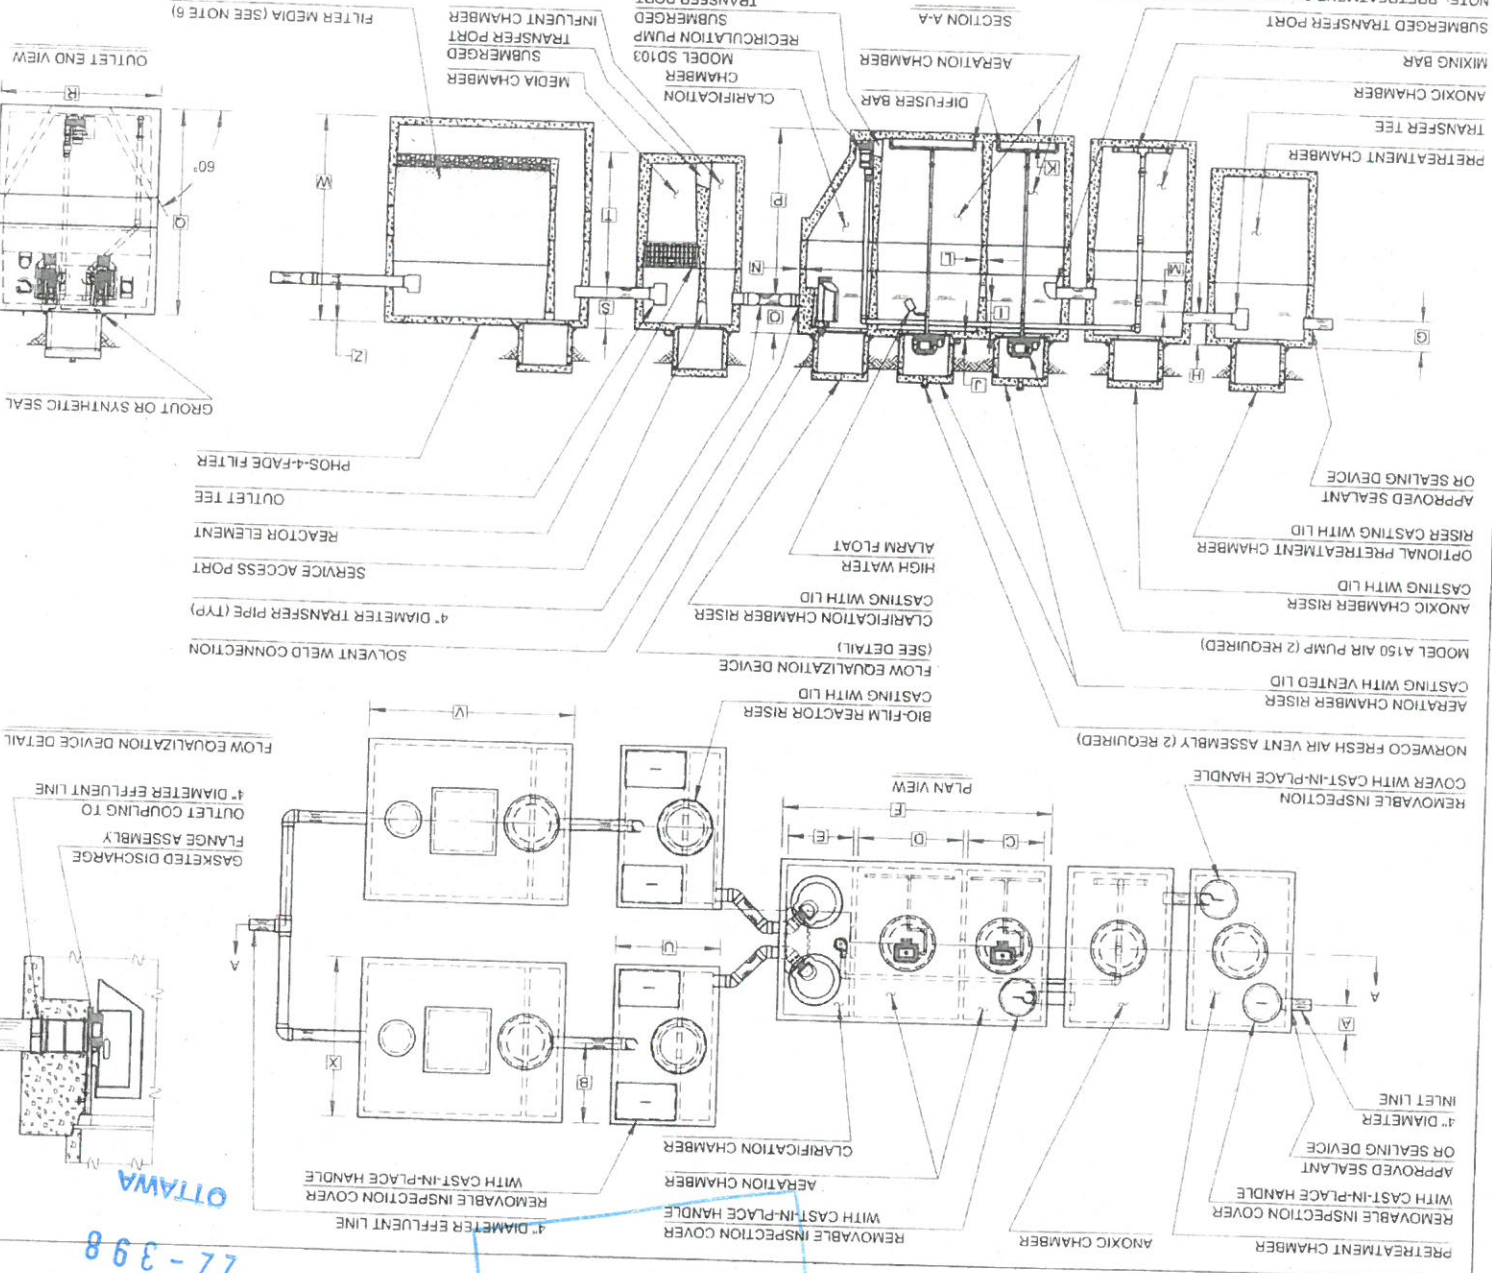

CAN/BNO 3680-600 TREATMENT LEVEL	
CLASS B - IV, D - I, N - I, P - II	
PROJECT ENGINEERS APPROVAL	
DRAWING HAS BEEN CHECKED AND IS APPROVED	
DATE:	
CONTRACTOR'S CERTIFICATION:	
(I/WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED	
DATE:	
CRITICAL DIMENSIONS	
A	1'-0"
B	2'-9"
C	2'-8"
D	3'-7"
E	2'-3"
F	9'-3"
G	1'-0"
H	1'-1"
I	3'-7 1/2"
J	7'-0"
K	0'-3"
L	0'-2"
M	1'-7"

PC-S-1174  
 NTS  
 05-27-2018  
 JMM  
 NPD  
 MAD 01-10-2017 A

NOTE: ANY CONTAMINATED MATERIAL PRESENT IN THE EXCAVATION AREA TO BE REMOVED AND REPLACED WITH SANDFILL.


R.V.C.A. RECEIVED  
OCT 13 2023

SEPTIC FILE #

22-398

OTTAWA

*Handwritten signature*  
Oct 23/23

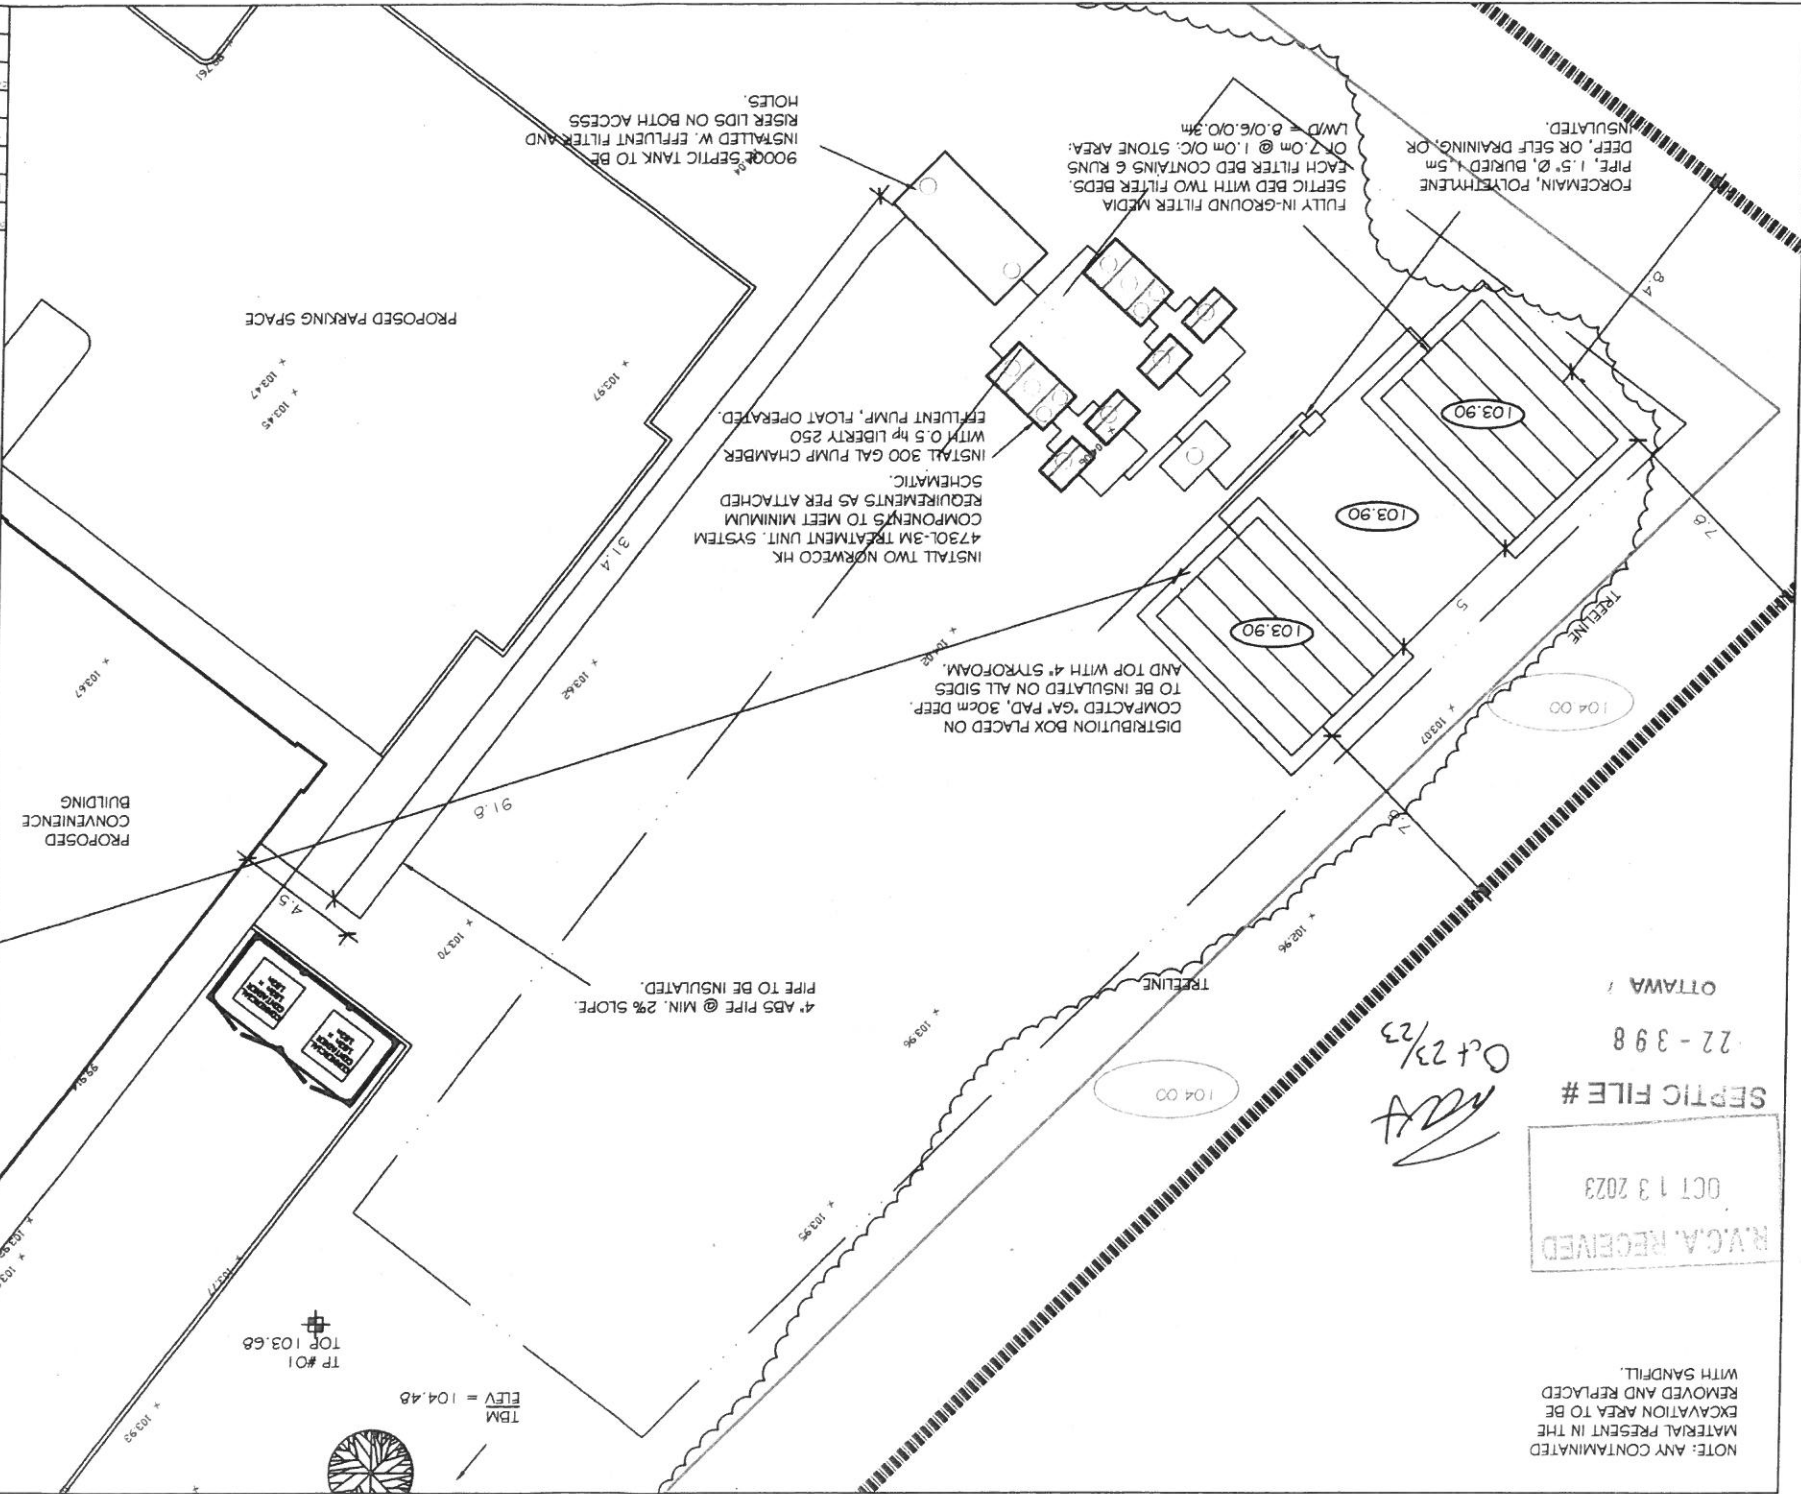

**NOTES:**

1. ALL TREATMENT UNITS AND LEACHING BED ARE TO BE INSTALLED IN ACCORDANCE WITH MINIMUM OBC CLEARANCE DISTANCES. ANY OMISSIONS OR INACCURACIES SHALL BE BROUGHT TO THE ATTENTION OF GVE AND OS50.
2. CARE IS TO BE EXERCISED DURING CONSTRUCTION ACTIVITIES NEAR OVERHEAD HYDRO WIRES.
3. EXISTING ELEVATIONS ARE APPROXIMATE. CONTRACTOR MUST VERIFY ALL ELEVATIONS AND DIMENSIONS PRIOR TO CONSTRUCTION.
4. SOIL CONDITIONS ARE ACCURATE FOR THE LOCATIONS SHOWN. CONTRACTOR MUST CONTACT THE DESIGN ENGINEER OR REGULATORY AUTHORITY SHOULD SOIL CONDITIONS DIFFER.
5. ALL DIMENSIONS AND CONDITIONS TO BE VERIFIED ON SITE. FIGURED DIMENSIONS TAKE PRECEDENCE OVER SCALE.
6. UTILITY LOCATES SHALL BE COMPLETED PRIOR TO ANY EXCAVATION.
7. THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.
8. THIS DOCUMENT IS COPYRIGHT PROTECTED AND IS THE SOLE PROPERTY OF GVE GROUP. THIS DRAWING SHALL NOT BE ALTERED IN ANY MANNER.
9. EXISTING LOT SERVICED WITH A DRILLED WELL.

**METRIC:**  
DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METERS AND MAY BE CONVERTED TO FEET BY DIVIDING BY 0.3048.

**LEGEND:**

- PROPOSED ELEVATION:
- EXISTING ELEVATION:
- EXISTING SEWAGE WORKS:
- PROPOSED SEWAGE WORKS:
- FENCE LINE:
- PROPERTY LINE:
- TEMPORARY BENCH MARK (DESCRIPTION: NAIL ON HYDRO POLE):
- TEST PIT LOCATION:

**SEPARATION DISTANCES:**

1. MINIMUM CLEARANCE FROM SEPTIC PIPE TO:
  - LOT LINE = 3.0m
  - HOUSE = 5.0m
  - DRILLED WELL = 15.0m
2. MINIMUM CLEARANCE FROM TREATMENT UNITS TO:
  - LOT LINE = 3.0m
  - HOUSE = 1.5m
  - DRILLED WELL = 15.0m

**DP** DP  
 Description Date Approved  
 DP WS

Rev.	Description	Date	Approved

Township Plan# Lot Sublot Con  
 5546 ALBION RD  
 13/10/23 1:200  
 GREEN VALLEY ENVIRONMENTAL  
 MACEWAN PETROLEUM INC.

NOTE: ANY CONTAMINATED MATERIAL PRESENT IN THE EXCAVATION AREA TO BE REMOVED AND REPLACED WITH SANDFILL.

FORCEMAIN, POLYETHYLENE PIPE, 1.5' Ø, BURIED 1.5' DEEP, OR SELF DRAINING, OR OF 7.0m @ 1.0m O.C. STONE AREA. SEPTIC BEDS WITH TWO FILTER BEDS. FULLY IN-GROUND FILTER MEDIA RISER LIDS ON BOTH ACCESS HOLES.

900L SEPTIC TANK TO BE INSTALLED W. EFFLUENT FILTER AND RISER LIDS ON BOTH ACCESS HOLES.


INSTALL TWO NORWECO 430L-TM TREATMENT UNIT SYSTEM COMPONENTS TO MEET MINIMUM SCHEMATIC REQUIREMENTS AS PER ATTACHED SCHEDULE. INSTALL 300 GAL. TUMP CHAMBER WITH 0.5 HP HUBERT 250 EFFLUENT PUMP, FLOAT OPERATED. PROPOSED PARKING SPACE

DISTRIBUTION BOX PLACED ON COMPACTED 64T PAD, 30cm DEEP AND TOP WITH 4" STYROFOAM TO BE INSULATED ON ALL SIDES

4" ABS PIPE @ MIN. 2% SLOPE. PIPE TO BE INSULATED.

R.V.C.A. RECEIVED  
 13 2023  
 SEPTIC FILE # 22-398  
 OTTAWA

*MA*  
 04/23/23

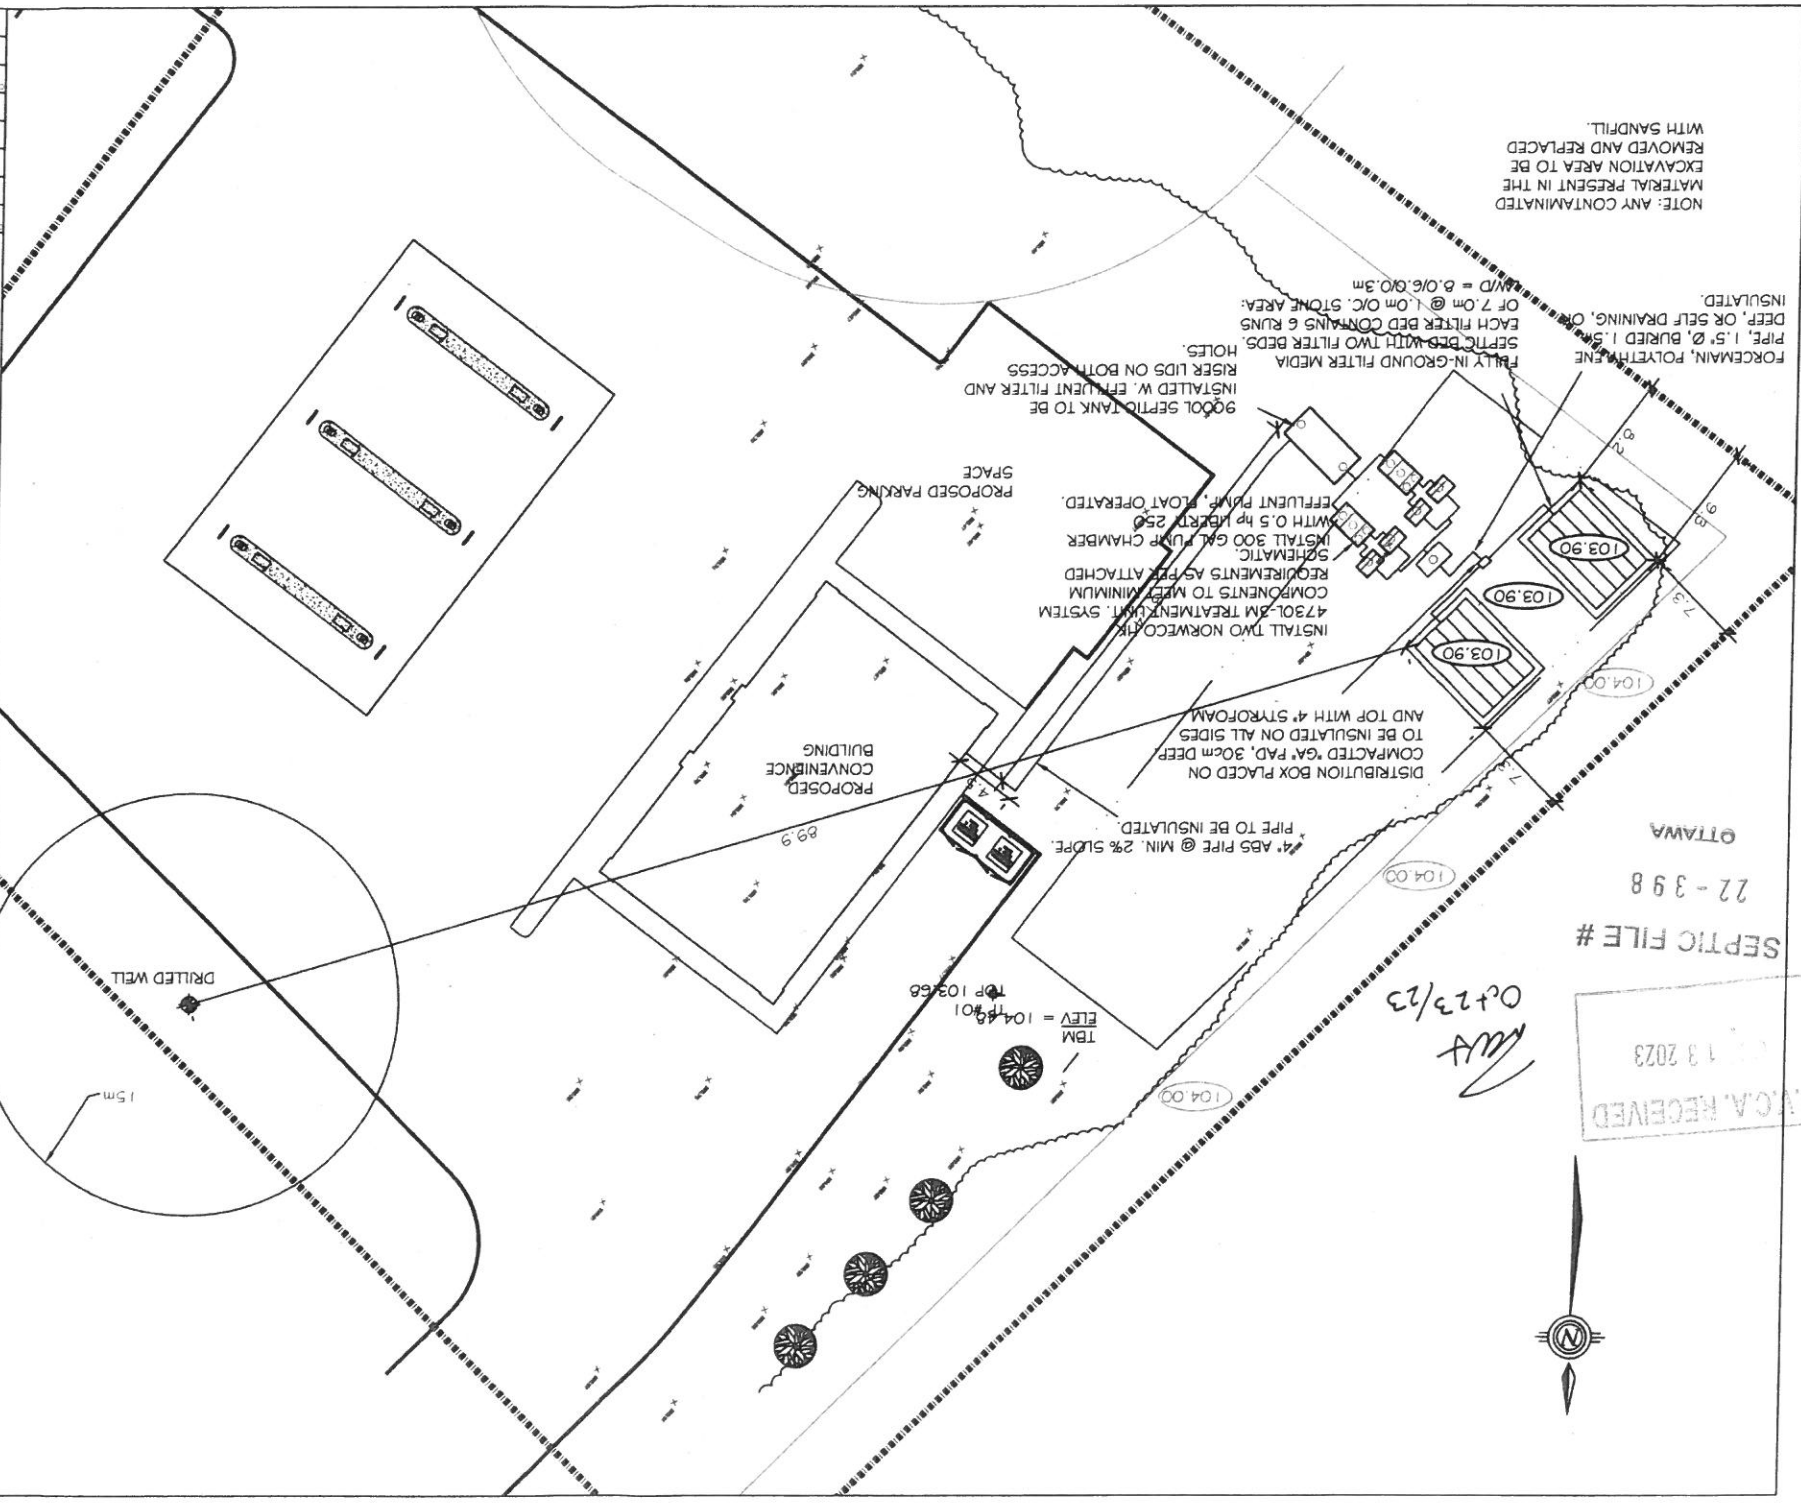

- 1. MINIMUM CLEARANCE FROM SEPTIC PIPE TO: LOT LINE = 3.0m HOUSE = 5.0m DRILLED WELL = 15.0m
- 2. MINIMUM CLEARANCE FROM TREATMENT UNITS TO: LOT LINE = 3.0m HOUSE = 1.5m DRILLED WELL = 15.0m

- SEPARATION DISTANCES:
- PROPOSED ELEVATION:
  - EXISTING ELEVATION:
  - EXISTING WORKS:
  - PROPOSED SEWAGE WORKS:
  - FENCE LINE:
  - PROPERTY LINE:
  - TEMPORARY BENCH MARK (DESCRIPTION: NAIL ON HYDRO POLE):
  - TEST FIT LOCATION:

LEGEND:

DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METERS AND MAY BE CONVERTED TO FEET BY DIVIDING BY 0.3048.

METRIC:

- NOTES:
1. ALL TREATMENT UNITS AND LEACHING BED ARE TO BE INSTALLED IN ACCORDANCE WITH MINIMUM OBC CLEARANCE DISTANCES. ANY OMISSIONS OR INACCURACIES SHALL BE BROUGHT TO THE ATTENTION OF GVE AND OSSO.
  2. CARE IS TO BE EXERCISED DURING CONSTRUCTION ACTIVITIES NEAR OVERHEAD HYDRO WIRES.
  3. EXISTING ELEVATIONS ARE APPROXIMATE. CONTRACTOR MUST VERIFY ALL ELEVATIONS AND DIMENSIONS PRIOR TO CONSTRUCTION.
  4. SOIL CONDITIONS ARE ACCURATE FOR THE LOCATIONS SHOWN. CONTRACTOR MUST CONTACT THE DESIGN ENGINEER OR REGULATORY AUTHORITY SHOULD SOIL CONDITIONS DIFFER.
  5. ALL DIMENSIONS AND CONDITIONS TO BE VERIFIED ON SITE. FIGURED DIMENSIONS TAKE PRECEDENCE OVER SCALE.
  6. UTILITY LOCATES SHALL BE COMPLETED PRIOR TO ANY EXCAVATION.
  7. THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.
  8. THIS DOCUMENT IS COPYRIGHT PROTECTED AND IS THE SOLE PROPERTY OF GVE GROUP. THIS DRAWING SHALL NOT BE ALTERED IN ANY MANNER.
  9. EXISTING LOT SERVICED WITH A DRILLED WELL.

DP	DP	WS
Rev:	Description	Date
Approved		
Township:	Plan#	Lot
Sublot	Con	
5546 ALBION RD	SP7215-22-FM	
13/10/23	1:400	
GREEN VALLEY ENVIRONMENTAL		
MACEWAN PETROLEUM INC.		







# Permit Part 8 – Sewage System Ontario Building Code

Do Not Complete  
Permit No 22-398  
Revision No \_\_\_\_\_  
Date \_\_\_\_\_  
Related Application \_\_\_\_\_

**A copy of this permit must be posted on the property at all time during construction. OBC, Division C — Part 1, Section 1.3.2.1**  
This permit verifies that the on-site sewage system was reviewed and approved for construction under the *Ontario Building Code* and *O.Reg. 323/12* as amended by *O.Reg. 151/13*.

Inspected & Recommended by: Ryan Hiemstra Owner: MacEwen Petroleum  
Inspection Date & Time: Sept 28, 2022 Weather: Sunny  
Civic Address: 5546 Albion Road Legal: Lot 30, Con 3  
In the former Township/City of Gloucester

Design Flow for Commercial / Institutional / Industrial (as per Table 8.2.1.3.B)  
Q: 3800 (Water closets) + 3920 (Fuel pumps) L/day

pretreatment tank 9000 L weigh bills for Filter Media  yes  no  
effluent filter YES grain size analysis required  yes  no  
pump rate \_\_\_\_\_ system pumps L/15 MIN site to be scarified  yes  no  
treatment unit Norweco HK 4730L-3M clay seal inspection  yes  no  
number of units 2 mantle required  yes  no  
sub-grade inspection  yes  no

ELEVATION  In Ground  Partially Raised  Fully Raised

### TYPE OF SYSTEM

Trench  
 Pipe and Stone or  Chambers  
type of chamber \_\_\_\_\_ pipe length \_\_\_\_\_ m  
loading area \_\_\_\_\_ m<sup>2</sup> orifice spacing \_\_\_\_\_ m  
total trench length \_\_\_\_\_ m  Filter Media Bed  
trench configuration \_\_\_\_\_ stone \_\_\_\_\_ 96 m<sup>2</sup>  
 Dispersal Bed extended base \_\_\_\_\_ 96 m<sup>2</sup>  
 BMEC  Type A  Type B pipe \_\_\_\_\_ 2 cells (6 runs at 7m)  
stone \_\_\_\_\_ m<sup>2</sup> weight of filter media \_\_\_\_\_ 115,200 kg  
sand \_\_\_\_\_ m<sup>2</sup> loading area \_\_\_\_\_ Native m<sup>2</sup>  
pipe \_\_\_\_\_ m<sup>2</sup>  
weight of sand \_\_\_\_\_ kg  
 Class 5 Holding Tank  
 Septic Tank Only

Manager, Septic System Approvals: Tony Doudier Permit Date: OCTOBER 23, 2023  
Comments: 1. RVCA to inspect/subgrade before placement of sandfill  
  
 maintenance/pumping required  ESA permit # required  engineer to verify  
 Class 5 Holding Tank approval only valid for three years from date of issue  subgrade  squirt height  
Manager, Septic System Approvals: \_\_\_\_\_ Revision Date: \_\_\_\_\_  
Comments: \_\_\_\_\_

NOTE: For further details, refer to corresponding application.

**ATTACHMENT K**  
**Moisture Surplus Print Outs**

Ottawa Airport, ON      Ottawa\_50mm\_WBNRMSD.txt  
WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY... 50 MM      HEAT INDEX... 36.41  
LONG... 75.67      LOWER ZONE..... 30 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	27	83	50	299
28- 2	-8.8	57	12	18	1	1	0	29	110	50	356
31- 3	-2.7	66	32	80	5	5	0	107	64	50	422
30- 4	5.9	72	67	69	32	32	0	104	0	50	494
31- 5	13.0	74	74	0	80	79	-1	13	0	32	568
30- 6	18.3	82	82	0	116	97	-19	4	0	14	651
31- 7	20.8	89	89	0	135	94	-41	3	0	5	740
31- 8	19.5	87	87	0	117	83	-34	1	0	9	827
30- 9	14.6	84	84	0	75	66	-9	7	0	20	912
31-10	8.1	77	76	0	36	35	-1	24	0	37	77
30-11	1.3	80	63	8	10	10	0	50	9	49	157
31-12	-7.0	78	26	15	1	1	0	38	47	50	236
AVE	5.9 TTL	911	705	205	608	503	-105	407			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	31	43	0	55
28- 2	2.6	29	15	27	1	1	0	37	59	0	59
31- 3	2.3	28	22	47	4	4	0	53	83	0	65
30- 4	1.7	31	31	84	8	8	0	84	0	2	74
31- 5	1.9	32	32	0	12	11	5	21	0	19	85
30- 6	1.2	38	38	0	9	26	26	17	0	19	93
31- 7	1.2	42	42	0	8	30	31	12	0	14	93
31- 8	1.3	39	39	0	8	30	32	5	0	16	107
30- 9	1.5	38	38	0	8	14	13	20	0	21	110
31-10	1.4	37	37	2	7	7	3	27	0	19	37
30-11	1.7	27	28	9	4	4	0	30	13	6	45
31-12	3.0	30	22	14	1	1	0	29	34	0	56

Ottawa Airport, ON                      Ottawa\_75mm\_WBNRMSD.txt  
WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32                      WATER HOLDING CAPACITY... 75 MM                      HEAT INDEX... 36.41  
LONG... 75.67                      LOWER ZONE..... 45 MM                      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	27	83	75	299
28- 2	-8.8	57	12	18	1	1	0	29	110	75	356
31- 3	-2.7	66	32	80	5	5	0	107	64	75	422
30- 4	5.9	72	67	69	32	32	0	104	0	75	494
31- 5	13.0	74	74	0	80	80	0	13	0	56	568
30- 6	18.3	82	82	0	116	107	-10	4	0	28	651
31- 7	20.8	89	89	0	135	104	-32	2	0	10	740
31- 8	19.5	87	87	0	117	85	-32	1	0	12	827
30- 9	14.6	84	84	0	75	66	-9	4	0	26	912
31-10	8.1	77	76	0	36	35	-1	15	0	52	77
30-11	1.3	80	63	8	10	10	0	42	9	71	157
31-12	-7.0	78	26	15	1	1	0	36	47	75	236
AVE	5.9 TTL	911	705	205	608	526	-84	384			

Ottawa Airport, ON                      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	30	43	0	55
28- 2	2.6	29	15	27	1	1	0	37	59	0	59
31- 3	2.3	28	22	47	4	4	0	53	83	0	65
30- 4	1.7	31	31	84	8	8	0	84	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	19	19	17	0	28	93
31- 7	1.2	42	42	0	8	28	30	11	0	22	93
31- 8	1.3	39	39	0	8	29	31	5	0	23	107
30- 9	1.5	38	38	0	8	14	14	17	0	29	110
31-10	1.4	37	37	2	7	7	2	23	0	28	37
30-11	1.7	27	28	9	4	4	0	33	13	11	45
31-12	3.0	30	22	14	1	1	0	30	34	3	56

Ottawa Airport, ON      Ottawa\_100mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY... 100 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE..... 60 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	25	83	99	299
28- 2	-8.8	57	12	18	1	1	0	28	110	99	356
31- 3	-2.7	66	32	80	5	5	0	106	64	100	422
30- 4	5.9	72	67	69	32	32	0	104	0	100	494
31- 5	13.0	74	74	0	80	80	0	13	0	81	568
30- 6	18.3	82	82	0	116	112	-4	4	0	47	651
31- 7	20.8	89	89	0	135	115	-21	2	0	19	740
31- 8	19.5	87	87	0	117	88	-29	1	0	18	827
30- 9	14.6	84	84	0	75	66	-8	3	0	32	912
31-10	8.1	77	76	0	36	35	-1	10	0	63	77
30-11	1.3	80	63	8	10	10	0	34	9	91	157
31-12	-7.0	78	26	15	1	1	0	33	47	97	236
AVE	5.9 TTL	911	705	205	608	545	-63	363			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	30	43	5	55
28- 2	2.6	29	15	27	1	1	0	37	59	3	59
31- 3	2.3	28	22	47	4	4	0	53	83	0	65
30- 4	1.7	31	31	84	8	8	0	84	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	12	11	17	0	34	93
31- 7	1.2	42	42	0	8	25	26	11	0	30	93
31- 8	1.3	39	39	0	8	29	30	5	0	30	107
30- 9	1.5	38	38	0	8	14	13	15	0	35	110
31-10	1.4	37	37	2	7	6	2	21	0	36	37
30-11	1.7	27	28	9	4	4	0	34	13	19	45
31-12	3.0	30	22	14	1	1	0	30	34	8	56

Ottawa Airport, ON      Ottawa\_125mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY... 125 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE..... 75 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	24	83	122	299
28- 2	-8.8	57	12	18	1	1	0	28	110	123	356
31- 3	-2.7	66	32	80	5	5	0	105	64	125	422
30- 4	5.9	72	67	69	32	32	0	104	0	125	494
31- 5	13.0	74	74	0	80	80	0	13	0	106	568
30- 6	18.3	82	82	0	116	115	-1	4	0	69	651
31- 7	20.8	89	89	0	135	122	-13	2	0	33	740
31- 8	19.5	87	87	0	117	92	-25	1	0	28	827
30- 9	14.6	84	84	0	75	67	-7	3	0	41	912
31-10	8.1	77	76	0	36	35	-1	9	0	74	77
30-11	1.3	80	63	8	10	10	0	27	9	108	157
31-12	-7.0	78	26	15	1	1	0	29	47	119	236
AVE	5.9 TTL	911	705	205	608	560	-47	349			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	31	43	10	55
28- 2	2.6	29	15	27	1	1	0	37	59	8	59
31- 3	2.3	28	22	47	4	4	0	54	83	0	65
30- 4	1.7	31	31	84	8	8	0	84	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	4	17	0	39	93
31- 7	1.2	42	42	0	8	21	23	11	0	37	93
31- 8	1.3	39	39	0	8	26	28	5	0	38	107
30- 9	1.5	38	38	0	8	13	11	14	0	42	110
31-10	1.4	37	37	2	7	6	2	20	0	42	37
30-11	1.7	27	28	9	4	4	0	32	13	25	45
31-12	3.0	30	22	14	1	1	0	30	34	14	56

Ottawa Airport, ON      Ottawa\_150mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY... 150 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE..... 90 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	23	83	144	299
28- 2	-8.8	57	12	18	1	1	0	26	110	146	356
31- 3	-2.7	66	32	80	5	5	0	103	64	150	422
30- 4	5.9	72	67	69	32	32	0	104	0	150	494
31- 5	13.0	74	74	0	80	80	0	13	0	131	568
30- 6	18.3	82	82	0	116	116	0	4	0	93	651
31- 7	20.8	89	89	0	135	127	-8	2	0	52	740
31- 8	19.5	87	87	0	117	97	-19	1	0	41	827
30- 9	14.6	84	84	0	75	68	-6	3	0	54	912
31-10	8.1	77	76	0	36	36	-1	8	0	88	77
30-11	1.3	80	63	8	10	10	0	23	9	126	157
31-12	-7.0	78	26	15	1	1	0	26	47	140	236
AVE	5.9 TTL	911	705	205	608	573	-34	336			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	31	43	15	55
28- 2	2.6	29	15	27	1	1	0	37	59	12	59
31- 3	2.3	28	22	47	4	4	0	54	83	0	65
30- 4	1.7	31	31	84	8	8	0	84	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	8	1	17	0	41	93
31- 7	1.2	42	42	0	8	18	18	11	0	42	93
31- 8	1.3	39	39	0	8	22	23	5	0	44	107
30- 9	1.5	38	38	0	8	12	10	14	0	49	110
31-10	1.4	37	37	2	7	6	2	19	0	47	37
30-11	1.7	27	28	9	4	4	0	30	13	31	45
31-12	3.0	30	22	14	1	1	0	29	34	20	56



Ottawa Airport, ON                      Ottawa\_200mm\_WBNRMSD.txt  
WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32                      WATER HOLDING CAPACITY...200 MM                      HEAT INDEX... 36.41  
LONG... 75.67                      LOWER ZONE.....120 MM                      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	21	83	187	299
28- 2	-8.8	57	12	18	1	1	0	24	110	191	356
31- 3	-2.7	66	32	80	5	5	0	99	64	199	422
30- 4	5.9	72	67	69	32	32	0	103	0	200	494
31- 5	13.0	74	74	0	80	80	0	13	0	181	568
30- 6	18.3	82	82	0	116	116	0	4	0	143	651
31- 7	20.8	89	89	0	135	132	-3	2	0	97	740
31- 8	19.5	87	87	0	117	106	-11	1	0	78	827
30- 9	14.6	84	84	0	75	70	-4	3	0	89	912
31-10	8.1	77	76	0	36	36	0	7	0	123	77
30-11	1.3	80	63	8	10	10	0	19	9	164	157
31-12	-7.0	78	26	15	1	1	0	22	47	182	236
AVE	5.9 TTL	911	705	205	608	589	-18	318			

Ottawa Airport, ON                      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	30	43	24	55
28- 2	2.6	29	15	27	1	1	0	36	59	20	59
31- 3	2.3	28	22	47	4	4	0	55	83	4	65
30- 4	1.7	31	31	84	8	8	0	83	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	11	10	11	0	48	93
31- 8	1.3	39	39	0	8	16	16	5	0	54	107
30- 9	1.5	38	38	0	8	10	8	14	0	59	110
31-10	1.4	37	37	2	7	6	1	19	0	55	37
30-11	1.7	27	28	9	4	4	0	29	13	41	45
31-12	3.0	30	22	14	1	1	0	28	34	29	56

Ottawa Airport, ON      Ottawa\_225mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY...225 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE.....135 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	21	83	209	299
28- 2	-8.8	57	12	18	1	1	0	24	110	214	356
31- 3	-2.7	66	32	80	5	5	0	97	64	224	422
30- 4	5.9	72	67	69	32	32	0	103	0	225	494
31- 5	13.0	74	74	0	80	80	0	13	0	206	568
30- 6	18.3	82	82	0	116	116	0	4	0	168	651
31- 7	20.8	89	89	0	135	133	-2	2	0	121	740
31- 8	19.5	87	87	0	117	109	-8	1	0	99	827
30- 9	14.6	84	84	0	75	71	-4	3	0	109	912
31-10	8.1	77	76	0	36	36	0	7	0	143	77
30-11	1.3	80	63	8	10	10	0	18	9	185	157
31-12	-7.0	78	26	15	1	1	0	21	47	204	236
AVE	5.9 TTL	911	705	205	608	594	-14	314			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	30	43	28	55
28- 2	2.6	29	15	27	1	1	0	36	59	24	59
31- 3	2.3	28	22	47	4	4	0	56	83	7	65
30- 4	1.7	31	31	84	8	8	0	82	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	10	7	11	0	49	93
31- 8	1.3	39	39	0	8	14	13	5	0	58	107
30- 9	1.5	38	38	0	8	10	7	14	0	63	110
31-10	1.4	37	37	2	7	6	1	19	0	58	37
30-11	1.7	27	28	9	4	4	0	29	13	44	45
31-12	3.0	30	22	14	1	1	0	28	34	33	56

Ottawa Airport, ON      Ottawa\_250mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY...250 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE.....150 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	20	83	232	299
28- 2	-8.8	57	12	18	1	1	0	23	110	238	356
31- 3	-2.7	66	32	80	5	5	0	96	64	248	422
30- 4	5.9	72	67	69	32	32	0	102	0	250	494
31- 5	13.0	74	74	0	80	80	0	13	0	231	568
30- 6	18.3	82	82	0	116	116	0	4	0	193	651
31- 7	20.8	89	89	0	135	134	-1	2	0	145	740
31- 8	19.5	87	87	0	117	111	-6	1	0	121	827
30- 9	14.6	84	84	0	75	72	-3	3	0	130	912
31-10	8.1	77	76	0	36	36	0	7	0	164	77
30-11	1.3	80	63	8	10	10	0	18	9	207	157
31-12	-7.0	78	26	15	1	1	0	20	47	226	236
AVE	5.9 TTL	911	705	205	608	598	-10	309			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	29	43	32	55
28- 2	2.6	29	15	27	1	1	0	36	59	27	59
31- 3	2.3	28	22	47	4	4	0	56	83	9	65
30- 4	1.7	31	31	84	8	8	0	82	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	9	5	11	0	50	93
31- 8	1.3	39	39	0	8	12	11	5	0	61	107
30- 9	1.5	38	38	0	8	9	6	14	0	66	110
31-10	1.4	37	37	2	7	7	1	19	0	61	37
30-11	1.7	27	28	9	4	4	0	29	13	47	45
31-12	3.0	30	22	14	1	1	0	28	34	36	56

Ottawa Airport, ON      Ottawa\_265mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY...265 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE.....159 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	20	83	246	299
28- 2	-8.8	57	12	18	1	1	0	23	110	252	356
31- 3	-2.7	66	32	80	5	5	0	96	64	263	422
30- 4	5.9	72	67	69	32	32	0	102	0	265	494
31- 5	13.0	74	74	0	80	80	0	13	0	246	568
30- 6	18.3	82	82	0	116	116	0	4	0	208	651
31- 7	20.8	89	89	0	135	134	-1	2	0	160	740
31- 8	19.5	87	87	0	117	112	-5	1	0	135	827
30- 9	14.6	84	84	0	75	72	-3	3	0	144	912
31-10	8.1	77	76	0	36	36	0	7	0	177	77
30-11	1.3	80	63	8	10	10	0	18	9	221	157
31-12	-7.0	78	26	15	1	1	0	20	47	240	236
AVE	5.9 TTL	911	705	205	608	599	-9	309			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	29	43	34	55
28- 2	2.6	29	15	27	1	1	0	36	59	29	59
31- 3	2.3	28	22	47	4	4	0	56	83	10	65
30- 4	1.7	31	31	84	8	8	0	82	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	8	4	11	0	51	93
31- 8	1.3	39	39	0	8	11	10	5	0	62	107
30- 9	1.5	38	38	0	8	9	5	14	0	68	110
31-10	1.4	37	37	2	7	7	1	19	0	62	37
30-11	1.7	27	28	9	4	4	0	29	13	49	45
31-12	3.0	30	22	14	1	1	0	28	34	38	56

Ottawa Airport, ON      Ottawa\_275mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY...275 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE.....165 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	19	83	255	299
28- 2	-8.8	57	12	18	1	1	0	23	110	261	356
31- 3	-2.7	66	32	80	5	5	0	96	64	272	422
30- 4	5.9	72	67	69	32	32	0	101	0	275	494
31- 5	13.0	74	74	0	80	80	0	13	0	256	568
30- 6	18.3	82	82	0	116	116	0	4	0	218	651
31- 7	20.8	89	89	0	135	135	-1	2	0	170	740
31- 8	19.5	87	87	0	117	113	-4	1	0	144	827
30- 9	14.6	84	84	0	75	72	-2	3	0	153	912
31-10	8.1	77	76	0	36	36	0	7	0	186	77
30-11	1.3	80	63	8	10	10	0	18	9	230	157
31-12	-7.0	78	26	15	1	1	0	20	47	249	236
AVE	5.9 TTL	911	705	205	608	601	-7	307			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	29	43	35	55
28- 2	2.6	29	15	27	1	1	0	36	59	30	59
31- 3	2.3	28	22	47	4	4	0	56	83	11	65
30- 4	1.7	31	31	84	8	8	0	81	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	8	3	11	0	51	93
31- 8	1.3	39	39	0	8	11	9	5	0	63	107
30- 9	1.5	38	38	0	8	9	5	14	0	69	110
31-10	1.4	37	37	2	7	7	1	19	0	63	37
30-11	1.7	27	28	9	4	4	0	29	13	50	45
31-12	3.0	30	22	14	1	1	0	28	34	39	56

Ottawa Airport, ON      Ottawa\_280mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY...280 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE.....168 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	19	83	260	299
28- 2	-8.8	57	12	18	1	1	0	23	110	266	356
31- 3	-2.7	66	32	80	5	5	0	95	64	277	422
30- 4	5.9	72	67	69	32	32	0	101	0	280	494
31- 5	13.0	74	74	0	80	80	0	13	0	261	568
30- 6	18.3	82	82	0	116	116	0	4	0	223	651
31- 7	20.8	89	89	0	135	135	-1	2	0	175	740
31- 8	19.5	87	87	0	117	113	-4	1	0	148	827
30- 9	14.6	84	84	0	75	72	-2	3	0	157	912
31-10	8.1	77	76	0	36	36	0	7	0	191	77
30-11	1.3	80	63	8	10	10	0	18	9	234	157
31-12	-7.0	78	26	15	1	1	0	20	47	254	236
AVE	5.9 TTL	911	705	205	608	601	-7	306			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	29	43	35	55
28- 2	2.6	29	15	27	1	1	0	36	59	31	59
31- 3	2.3	28	22	47	4	4	0	56	83	12	65
30- 4	1.7	31	31	84	8	8	0	81	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	8	3	11	0	52	93
31- 8	1.3	39	39	0	8	10	9	5	0	64	107
30- 9	1.5	38	38	0	8	9	5	14	0	69	110
31-10	1.4	37	37	2	7	7	1	19	0	64	37
30-11	1.7	27	28	9	4	4	0	29	13	50	45
31-12	3.0	30	22	14	1	1	0	28	34	39	56

Ottawa Airport, ON      Ottawa\_300mm\_WBNRMSD.txt  
 WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY...300 MM      HEAT INDEX... 36.41  
 LONG... 75.67      LOWER ZONE.....180 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	19	83	279	299
28- 2	-8.8	57	12	18	1	1	0	23	110	285	356
31- 3	-2.7	66	32	80	5	5	0	95	64	297	422
30- 4	5.9	72	67	69	32	32	0	101	0	300	494
31- 5	13.0	74	74	0	80	80	0	13	0	281	568
30- 6	18.3	82	82	0	116	116	0	4	0	243	651
31- 7	20.8	89	89	0	135	135	0	2	0	194	740
31- 8	19.5	87	87	0	117	114	-3	1	0	167	827
30- 9	14.6	84	84	0	75	73	-2	3	0	176	912
31-10	8.1	77	76	0	36	36	0	7	0	209	77
30-11	1.3	80	63	8	10	10	0	18	9	252	157
31-12	-7.0	78	26	15	1	1	0	20	47	272	236
AVE	5.9 TTL	911	705	205	608	603	-5	306			

Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	29	43	37	55
28- 2	2.6	29	15	27	1	1	0	36	59	33	59
31- 3	2.3	28	22	47	4	4	0	57	83	13	65
30- 4	1.7	31	31	84	8	8	0	81	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	8	2	11	0	52	93
31- 8	1.3	39	39	0	8	10	8	5	0	65	107
30- 9	1.5	38	38	0	8	9	5	14	0	71	110
31-10	1.4	37	37	2	7	7	1	19	0	65	37
30-11	1.7	27	28	9	4	4	0	29	13	52	45
31-12	3.0	30	22	14	1	1	0	28	34	41	56

Ottawa Airport, ON      Ottawa\_400mm\_WBNRMSD.txt  
WATER BUDGET MEANS FOR THE PERIOD 1950-2010      DC20492

LAT.... 45.32      WATER HOLDING CAPACITY... 400 MM      HEAT INDEX... 36.41  
LONG... 75.67      LOWER ZONE..... 240 MM      A..... 1.075

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	-10.6	64	13	15	0	0	0	19	83	375	299
28- 2	-8.8	57	12	18	1	1	0	22	110	382	356
31- 3	-2.7	66	32	80	5	5	0	94	64	395	422
30- 4	5.9	72	67	69	32	32	0	99	0	400	494
31- 5	13.0	74	74	0	80	80	0	13	0	381	568
30- 6	18.3	82	82	0	116	116	0	4	0	343	651
31- 7	20.8	89	89	0	135	135	0	2	0	294	740
31- 8	19.5	87	87	0	117	116	-1	1	0	265	827
30- 9	14.6	84	84	0	75	74	-1	3	0	272	912
31-10	8.1	77	76	0	36	36	0	7	0	305	77
30-11	1.3	80	63	8	10	10	0	18	9	349	157
31-12	-7.0	78	26	15	1	1	0	19	47	369	236
AVE	5.9 TTL	911	705	205	608	606	-2	301			


Ottawa Airport, ON      STANDARD DEVIATIONS FOR THE PERIOD 1950-2010      DC20492

DATE	TEMP (C)	PCPN	RAIN	MELT	PE	AE	DEF	SURP	SNOW	SOIL	ACC P
31- 1	3.0	26	16	18	1	1	0	29	43	44	55
28- 2	2.6	29	15	27	1	1	0	36	59	39	59
31- 3	2.3	28	22	47	4	4	0	57	83	20	65
30- 4	1.7	31	31	84	8	8	0	80	0	2	74
31- 5	1.9	32	32	0	12	12	0	21	0	22	85
30- 6	1.2	38	38	0	9	9	0	17	0	41	93
31- 7	1.2	42	42	0	8	8	0	11	0	53	93
31- 8	1.3	39	39	0	8	8	4	5	0	69	107
30- 9	1.5	38	38	0	8	8	2	14	0	76	110
31-10	1.4	37	37	2	7	7	0	19	0	69	37
30-11	1.7	27	28	9	4	4	0	29	13	57	45
31-12	3.0	30	22	14	1	1	0	28	34	46	56



**ATTACHMENT L**  
**Norweco Tertiary System Specifications**

# HYDRO-KINETIC® FEU

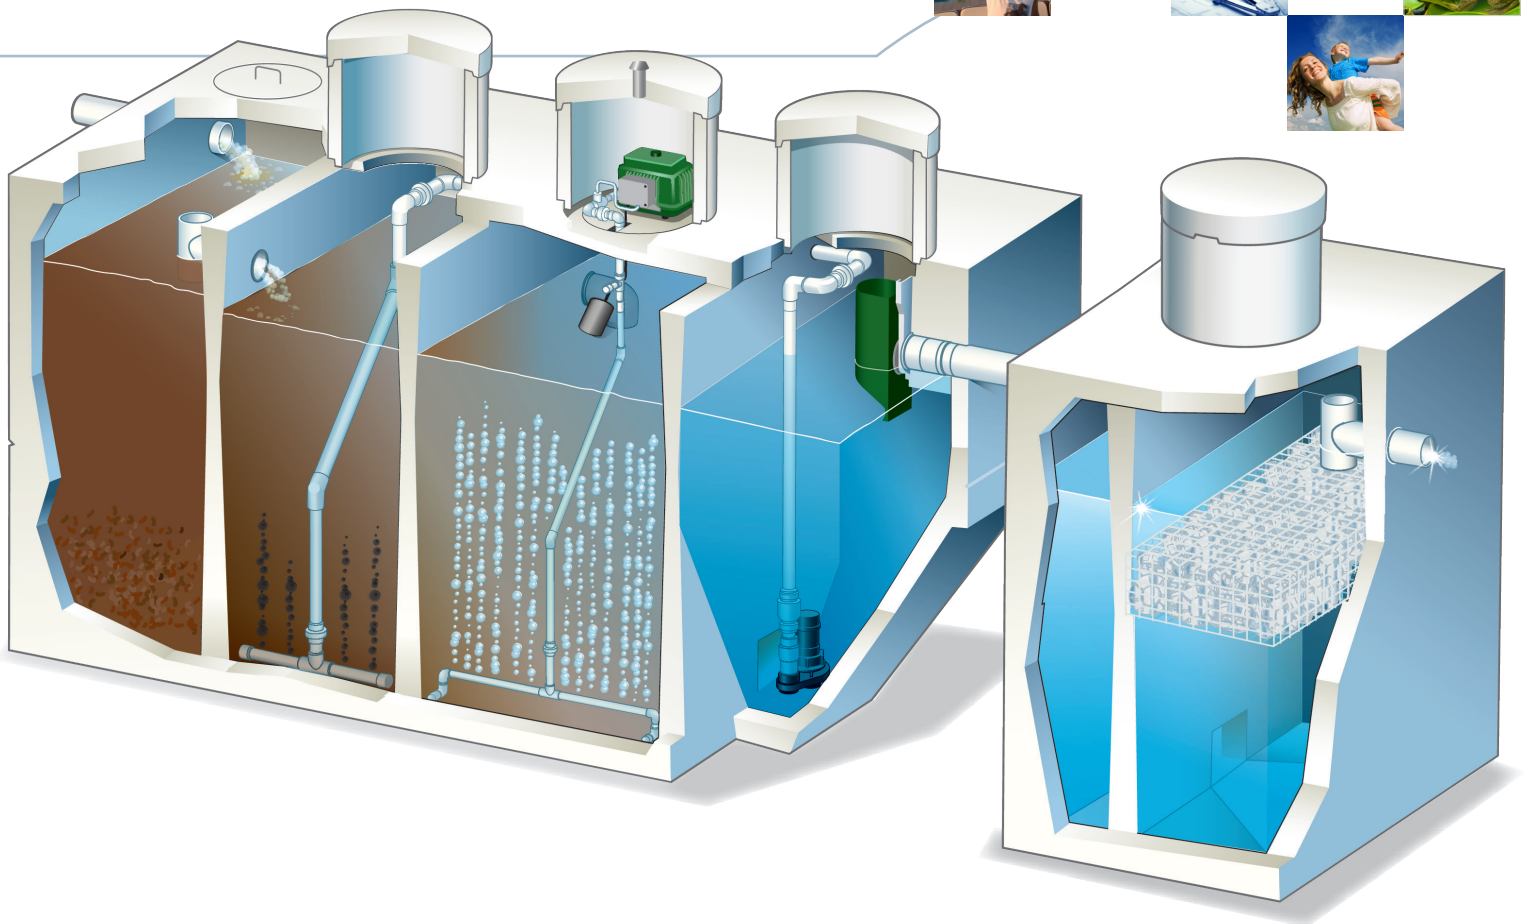

***norweco***®

Engineering the future of water  
and wastewater treatment

TOXIC CHAMBER RISER  
LID WITH LID

TRANSFER TEE

IMPROVED SEALANT  
SEALING DEVICE

# HYDRO-KINETIC®

A revolutionary wastewater treatment system that employs innovative Hydro-Kinetic® filtration technology to produce the cleanest, most consistent effluent quality available

During its successful completion of both NSF/ANSI Standard 40 and 245 tests, the Hydro-Kinetic FEU system:

- Became the only NSF/ANSI Standard 40 and 245 certified residential wastewater treatment system to pass two consecutive back-to-back tests without performing routine maintenance for a full 12 months.
- Achieved unmatched effluent results of 2.1 mg/L CBOD (Carbonaceous Biochemical Oxygen Demand), 1.8 mg/L TSS (Total Suspended Solids) and 7.95 mg/L TN (Total Nitrogen).

It quietly, efficiently and automatically pretreats, aerates, flow equalizes and filters all wastewater returning only the purest effluent back to the receiving environment. Better yet, all treatment processes are managed by reliable components and user friendly controls. The integrity of the treatment process is protected by our patented non-mechanical, demand use flow equalization device, as well as our revolutionary Hydro-Kinetic Bio-Film Reactor.

solutions in wastewater treatment

SOLVENT WELD CONNECTION

4" DIAMETER TRANSFER PIPE

POLISHING MEDIA

G

M

L

N

P

H

60°

DIFFUSER BAR

POLISHING CHAMBER

INFLUENT CHAMBER

CLARIFICATION CHAMBER

MODEL SD103 RECIRCULATION PUMP

CAST-IN AERATION

CHAMBER TRANSFER PORT


TREATMENT CHAMBER

TOXIC CHAMBER

NG B

TRANSFER PORT

# Revolutionary in design, unparalleled in performance

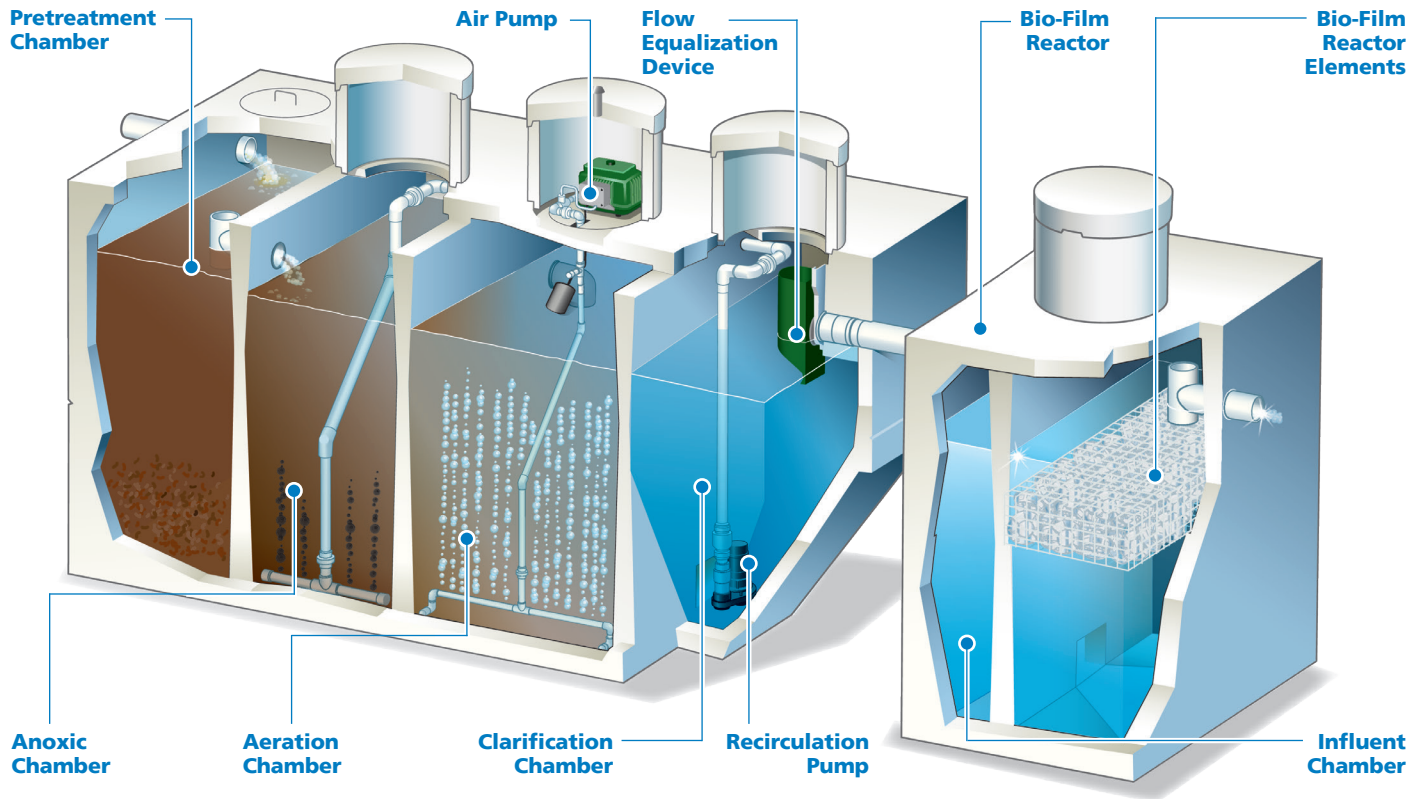

## Pretreatment Chamber

Anaerobic bacteria and gravity precondition the wastewater here to protect the integrity of downstream treatment processes.

## Anoxic Chamber

Pretreatment Chamber effluent is mixed with nitrified liquid recirculated from the clarifier in measured doses, via a mixing bar in this chamber. Under carefully controlled conditions, bacteria remove nitrogen by consuming nitrate-bound oxygen during their respiratory process.

## Aeration Chamber

Here, safe, living aerobic bacteria convert the wastewater into stable substances. Flow equalization maximizes this biological oxidation and assures proper retention and treatment.

## Model A100 Air Pump

Our exclusive Model A100 air pump is a precision engineered electro-mechanical device that has been specifically designed for use in the system. It can be installed below grade or remotely located up to 75 feet from the system.

## Clarification Chamber

Flow equalization enhances the settling of biologically active substances inside the Clarification Chamber. Pretreated, aerated wastewater has now been converted to clarified liquids for discharge from this chamber.

## Model SD103 Recirculation Pump

This highly efficient recirculation pump is installed at the bottom of the Clarification Chamber and is used to transfer nitrified liquid back to the Anoxic Chamber for denitrification.

## Flow Equalization Device


Controls flow through the treatment process and regulates the velocity of treated effluent that can leave the system, enhancing the efficiency of the attached growth filtration media in the Hydro-Kinetic system.

## Bio-Film Reactor

Flow equalized liquid from the clarifier enters the Bio-Film Reactor where it flows downward and is evenly distributed beneath our exclusive Hydro-Kinetic filtration media. The liquid then travels through the proprietary attached growth filtration media where the final treatment takes place.

## Precast Concrete Tank

Every tank is constructed of high quality, non-corrosive materials under rigid quality control standards. The tank, access risers and covers are reinforced precast concrete manufactured locally by your licensed Norweco distributor.

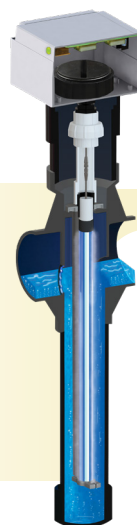


## AT 1500 Ultraviolet Disinfection System

CAPABLE OF MEETING EVEN THE MOST STRINGENT ENVIRONMENTAL REQUIREMENTS, THE MODEL AT 1500 UV DISINFECTION SYSTEM REDUCES BACTERIA LEVELS FROM SECONDARY EFFLUENT TO MEET STRICT WATER QUALITY STANDARDS. THE AT 1500 IS THE ONLY UV TREATMENT SYSTEM LISTED BY UNDERWRITERS LABORATORIES FOR RESIDENTIAL APPLICATIONS.

## Consider the facts:


- The Hydro-Kinetic FEU system meets or exceeds regulatory standards and is performance certified and listed by NSF International to Standards 40 and 245. The system achieved an astounding effluent quality of 2.1 mg/L CBOD, 1.8 mg/L TSS and 7.95 mg/L TN.
- The system produced these unmatched effluent results while being tested for 12 continuous months without service. The Hydro-Kinetic system passed two consecutive 6 month tests with flying colors, including duplicate multi-stress sequences.
- We have engineered the Model A100 air pump to maximize operational efficiency and increase service life. It requires minimal electricity to operate and utilizes a standard 115V power connection. Multiple air pump mounting locations are available.
- The Model SD103 recirculation pump features a ½ horsepower electric motor that is securely mounted in an oil-filled, watertight, corrosion resistant housing with lubricated ball bearings to assure long life. The recirculation pump features a 2" discharge connection.
- The Hydro-Kinetic Bio-Film Reactor provides final treatment of the wastewater to a near pristine state. As liquid flows up through our proprietary attached growth filtration media, final polishing takes place insuring only the highest quality effluent is safely returned to the environment.

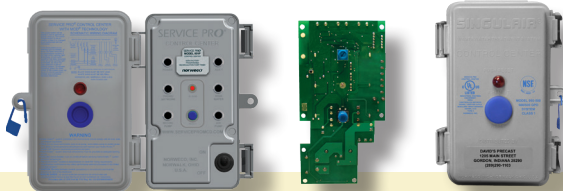

### SERVICE PRO® Model 801P

EVERY SYSTEM COMES WITH THE SERVICE PRO MODEL 801P CONTROL CENTER THAT USES MCD TECHNOLOGY TO PROVIDE MONITORING, COMPLIANCE AND DIAGNOSTIC FUNCTIONS FOR THE TREATMENT SYSTEM. EACH CONTROL CENTER INCLUDES A TIME CLOCK, ALARM LIGHT, RESET BUTTON, POWER SWITCH, POWER LIGHT, PHONE/NETWORK LIGHT, RECIRCULATION PUMP ALARM, AIR PUMP ALARM, HIGH WATER ALARM AND ADDITIONAL AUXILIARY COMPONENT INPUT.

## Unmatched Effluent Results

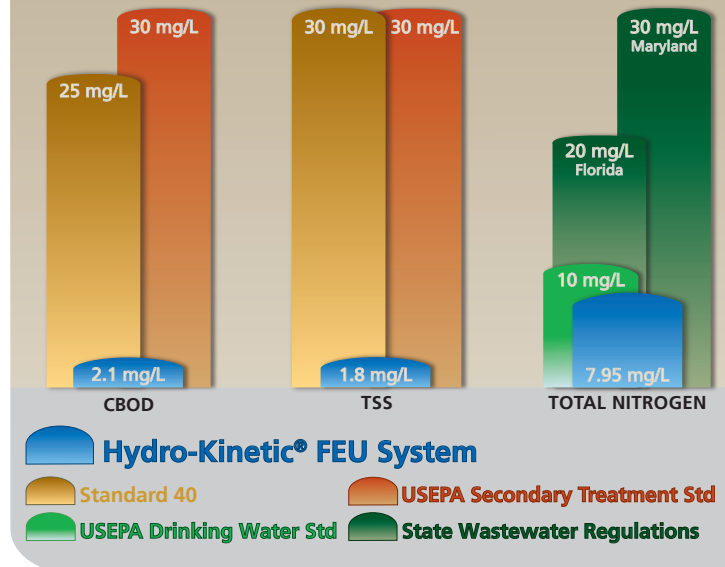

- 70-hour retention in the Hydro-Kinetic system insures adequate exposure to all treatment processes and reduces pumping frequency as compared to smaller capacity systems.
- Our patented non-mechanical flow equalization device guarantees that all incoming wastewater is fully treated, regardless of heavy use periods.
- All flow is equalized an average of 50% at the NSF Standard 40/245 600 GPD (gallons per day) design loading pattern.
- Durable, reliable components are safely installed out-of-sight below grade. No exposed power cords or air lines that are above ground.
- Your local licensed Norweco distributor sells, installs and services your Hydro-Kinetic system with pride. You'll find their name and contact info conveniently posted on the system's control center.



### Blue Crystal® Residential Disinfecting Tablets and Bio-Max® Dechlorination Tablets

PURE CALCIUM HYPOCHLORITE TABLETS FORMULATED FOR USE IN RESIDENTIAL SYSTEMS, BLUE CRYSTAL TABLETS CONTAIN 70% AVAILABLE CHLORINE TO PROVIDE EFFICIENT, RELIABLE DISINFECTION. BIO-MAX TABLETS PROVIDE A CONVENIENT SOURCE TO INSTANTLY REMOVE CHLORINE FROM WASTEWATER, POTABLE WATER AND PROCESS WATER. EACH TABLET CONTAINS 92% SODIUM SULFITE.



Norweco distributors are located throughout the United States and much of the rest of the world. Research, product development, manufacturing, marketing and sales support are conducted inside our offices and factory in Norwalk, Ohio USA. Everyone at Norweco is committed to shaping the future of our industry.


# engineering the future

of water and wastewater treatment


## Specify Hydro-Kinetic®

As a designer, choosing to incorporate the Hydro-Kinetic system in your project will insure that you achieve successful treatment while offering outstanding quality and reliability. At the same time, the reputation of your company will be protected for years to come. Your local Norweco distributor is fully trained to assist you in the design, installation and operation of a Norweco Hydro-Kinetic FEU (Flow Equalized Upflow) system.

As a homeowner, getting the highest quality product is essential. The Hydro-Kinetic system arrives to the jobsite complete, including delivery, tank setting, equipment installation, plant start-up and service. A series of service and adjustment inspections are prescheduled for the first two years of operation at the time your system is installed. These inspections are included in the sale so that your system continues to perform at the highest level to protect you and your investment. Extended service contracts are also available from your local Norweco distributor.

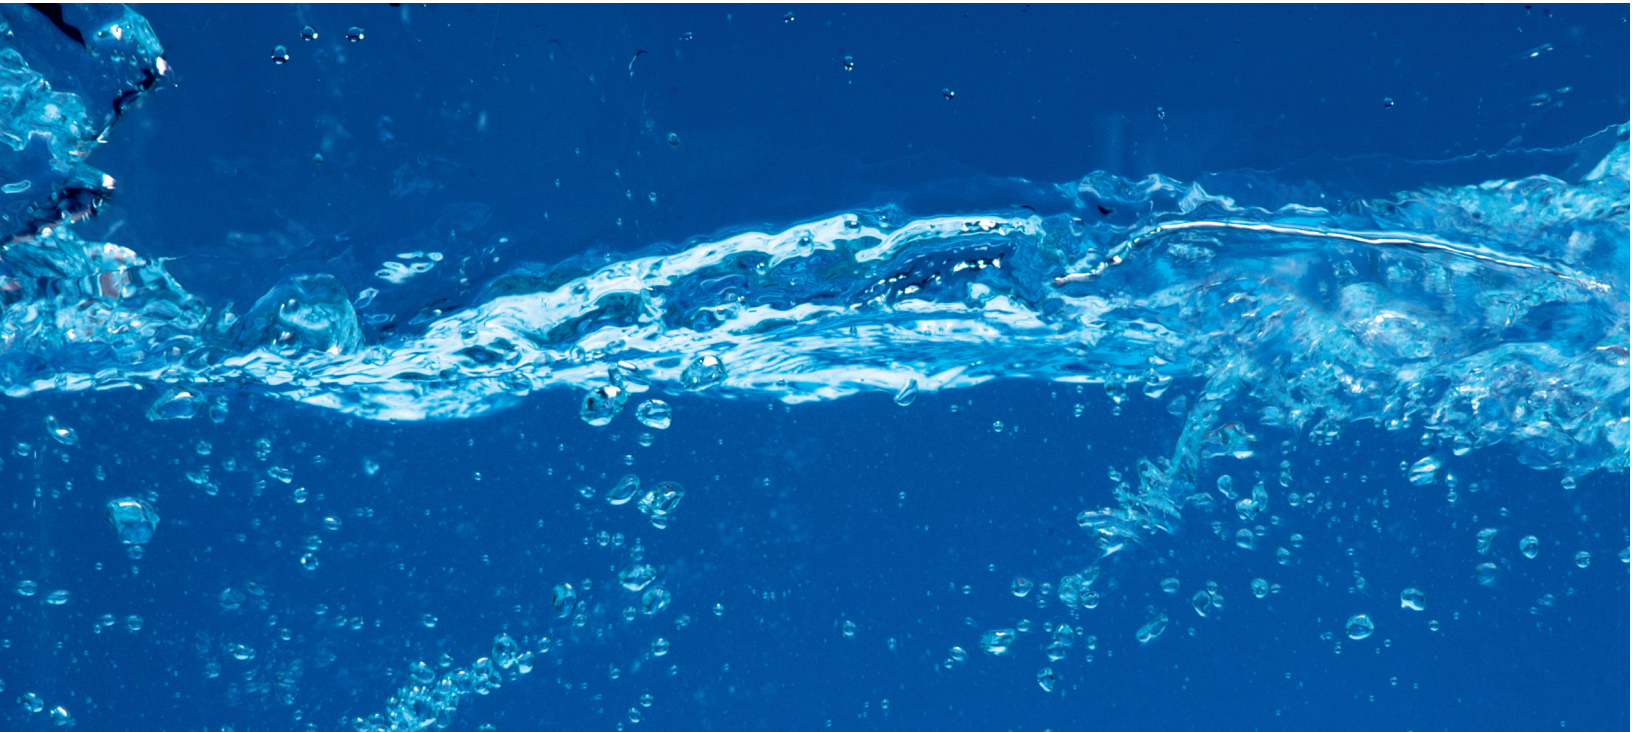

## comprehensive protection, guaranteed



The Hydro-Kinetic wastewater treatment system, Service Pro control center, and all Norweco components are warranted against defects in material and workmanship under normal use and service by our comprehensive 2 year Limited Warranty. A Warranty Registration Card and Owner's Manual are included with purchase. Warranty information is detailed on the back page of the Hydro-Kinetic System Owner's Manual.

### Other Products

#### Singulair® Wastewater Treatment Plants

FOR RESIDENTIAL APPLICATIONS

#### Modulair® Wastewater Treatment Plants

FOR SEMI-COMMERCIAL APPLICATIONS

#### Travalair® Wastewater Treatment Plants

FEATURING AUTO SLUDGE AND SKIMMER SYSTEM

# ***norweco***®

*Engineering the future of water  
and wastewater treatment*

**220 Republic Street  
Norwalk, Ohio, U.S.A. 44857-1156  
PH: 419.668.4471  
FAX: 419.663.5440  
www.norweco.com**

The Hydro-Kinetic system components are listed, licensed, and/or certified by each of the following agencies/organizations.



### Progress Through Service Since 1906

*We engineer, manufacture, install, and maintain advanced water and wastewater treatment technologies for residential properties, communities, and commercial properties that are not connected to sewer lines. Norweco treatment systems are in service all over the world.*

*Norweco®, Norweco.com®, Singulair®, Modulair®, Travalair®, Singulair R3®, Singulair Green®, Ribbit Rivet®, Hydro-Kinetic®, Hydro-Kinetic Bio-Film Reactor®, Evenair®, Lift-Rail®, Microsonic®, Bio-Dynamic®, Bio-Sanitizer®, Bio-Neutralizer®, Bio-Kinetic®, Bio-Static®, Bio-Gem®, Bio-Max®, Bio-Perc®, Blue Crystal®, Phos-4-Fade®, Enviro-C®, ClearCheck®, ChemCheck®, Tri-Max®, Hydra-Max®, Service Pro®, MCD®, TNT®, WASP®, Grease Buster® and "BUSTER" logo are all registered trademarks of Norwalk Wastewater Equipment Company, Inc.*


***norweco***<sup>®</sup>

**HYDRO-KINETIC**<sup>®</sup>

**WASTEWATER TREATMENT SYSTEM  
MODEL 600 FEU**

**GENERAL SPECIFICATIONS**

The contractor shall furnish and install one complete Hydro-Kinetic wastewater treatment system with all necessary parts and equipment as described in the following specifications. Treatment of the domestic wastewater shall be accomplished by the extended aeration process with non-mechanical flow equalization, pretreatment of the influent and filtration of the final effluent. The treatment system shall provide primary, secondary and tertiary treatment of the wastewater flow, denitrification, and if required, chlorination/dechlorination or ultraviolet disinfection of the effluent prior to discharge. All treatment processes shall be contained within reinforced precast concrete tankage meeting the requirements of ACI Standard 318. The wastewater treatment system shall be a Hydro-Kinetic Model 600 FEU as manufactured by Norweco, Inc., Norwalk, Ohio, USA.

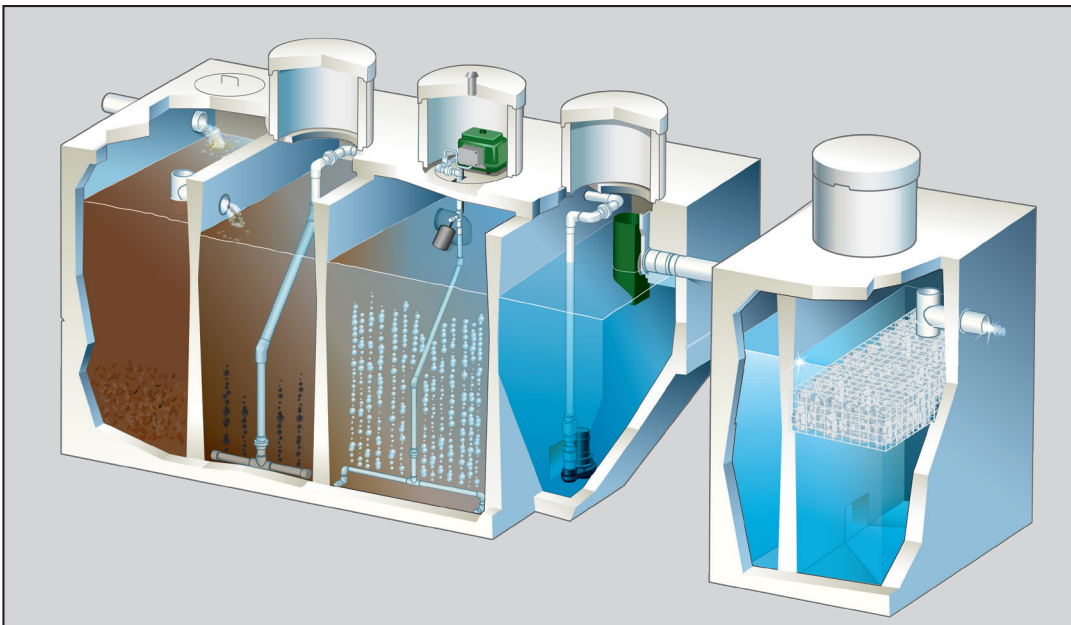

The wastewater treatment system shall include precast concrete tankage providing separate pretreatment, anoxic, aeration, clarification and final filtration chambers. The tankage shall be furnished with cast-in-place inlets, submerged transfer ports, access risers with removable covers, cast-in-place molded plastic vent assembly, cast-in-place clarification outlet coupling and cast-in-place outlet tee. Principal items of electro-mechanical equipment supplied with the Hydro-Kinetic system shall be a Model A100 air pump, Model SD103 recirculation pump, UL Listed Service Pro Model 801P electrical control center with MCD technology, flow equalization device and Hydro-Kinetic FEU filter for final filtration of system effluent.

**SPECIFICATIONS**




# HYDRO-KINETIC®

## OPERATING CONDITIONS

Total holding capacity of the system shall provide a minimum of 70 hour retention of the daily flow. The pretreatment chamber shall provide at least 15 hour retention, the anoxic chamber shall provide at least 15 hour retention, the extended aeration chamber shall provide at least 21 hour retention, the clarification chamber shall provide at least 7 hour retention and the Hydro-Kinetic filter shall provide at least 12 hour retention of the daily flow. The non-mechanical flow equalization device shall increase individual chamber and total system retention time in direct proportion to loading. Design of the system shall include a compartmented tank and non-mechanical flow equalization device to insure successful treatment performance without upset even when the significant runoff period is six hours. Hydraulic design considerations of the system and flow equalization device shall be such that intermittent peak flow factors as high as four shall not upset hydraulic reliability within the system. Capability of the system to perform as outlined, when built by an approved manufacturer, shall be certified by an independent testing laboratory and approved for use by the local governing regulatory agency.

## PRETREATMENT CHAMBER

All domestic wastewater shall be preconditioned while passing through the pretreatment chamber prior to being introduced to the anoxic chamber. The outlet of the pretreatment chamber shall be equipped with a discharge tee that extends vertically into the liquid so that only the preconditioned flow from the center area of the chamber is displaced to the anoxic chamber. The discharge tee and transfer port shall be of adequate size to handle a peak flow factor of four without restricting the outlet and disturbing hydraulic displacement to the anoxic chamber. A removable inspection cover shall be cast into the top of the pretreatment chamber to allow tank and transfer tee inspection. As a safety measure, the uncovered opening shall be small enough to insure that the tank cannot be entered for inspection or service.

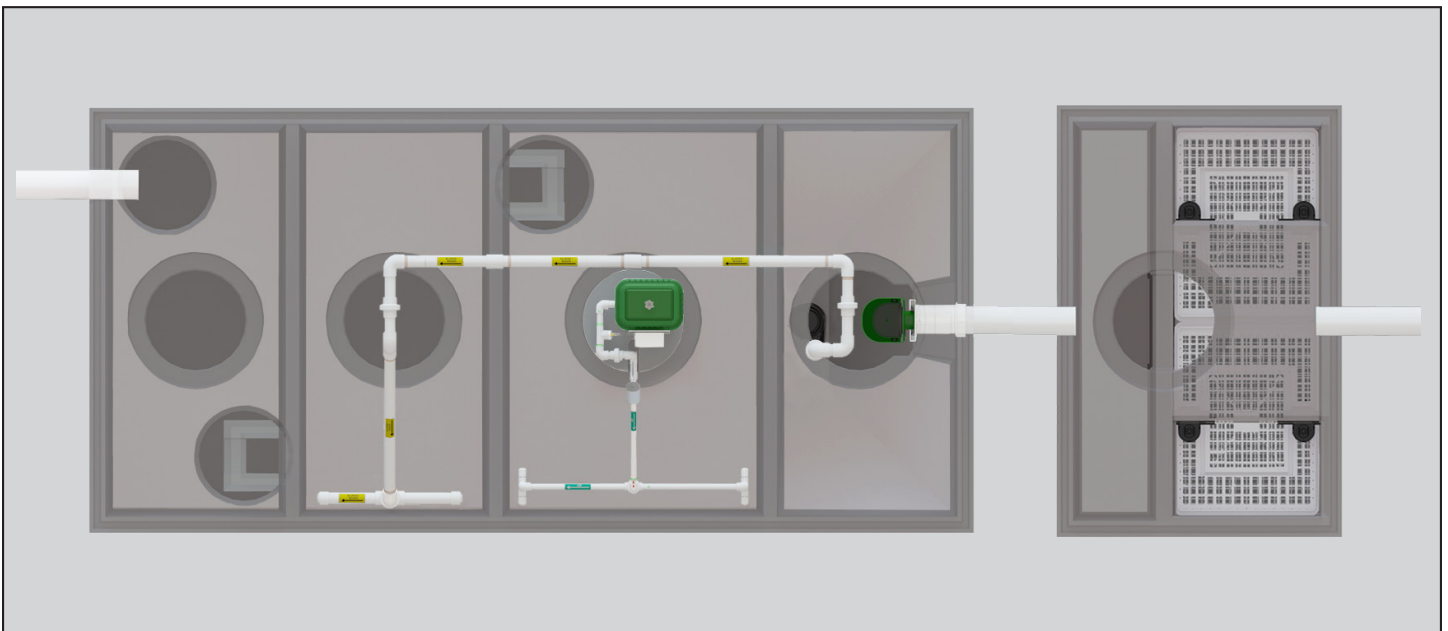

## ANOXIC CHAMBER


The anoxic chamber shall provide in excess of 15 hour retention of the equalized daily flow. In the anoxic chamber, low oxygen levels shall compel facultative heterotrophic bacteria to use nitrate-bound oxygen in their respiratory process. Nitrified liquid from the clarifier shall enter the chamber in measured doses and nitrogen compounds shall be converted to harmless nitrogen gas which shall escape into the atmosphere. Overall design of the chamber shall insure that effective mixing and suspension of the biomass is maintained in an anoxic condition to insure consistent biological denitrification. Systems that have not been performance certified to reduce Total Nitrogen (TN) to less than 10 mg/L shall not be considered for this application.

## AERATION CHAMBER

The extended aeration chamber shall provide in excess of 21 hour retention of the equalized daily flow. The chamber shall be of sufficient size to provide a minimum of 80 cubic feet of tank capacity per pound of applied BOD. The aeration chamber length-width-depth ratio shall be designed to insure uniform tank mixing and provide optimum treatment. The aeration chamber(s) shall be an integral part of the system flow path and constructed of properly reinforced 5,000 PSI, 28 day compression strength precast concrete. All castings used to construct the precast concrete tankage shall be monolithic units with external and internal walls incorporated into each section.


## FINAL CLARIFICATION CHAMBER

The final clarification chamber shall consist of 5 functionally independent zones operating together to provide satisfactory settling and clarification of the equalized flow. An inlet zone shall be provided and shall dissipate transfer turbulence at the flow inlet of the clarification chamber. A recirculation pump in the settled sludge zone shall transfer a portion of the wastewater back to the anoxic chamber. Liquid is then displaced into the hopper zone of the clarifier. In this zone, settling by gravity takes place. Three of the four sidewalls are slanted to form a hopper which directs all settled material back to the settled sludge zone. Clarified liquid from the hopper zone shall be displaced into the final settling zone to provide additional clarification of the liquid. The liquid is finally displaced to the outlet zone where the treated effluent shall pass through the flow equalization device and be discharged from the final clarification chamber.

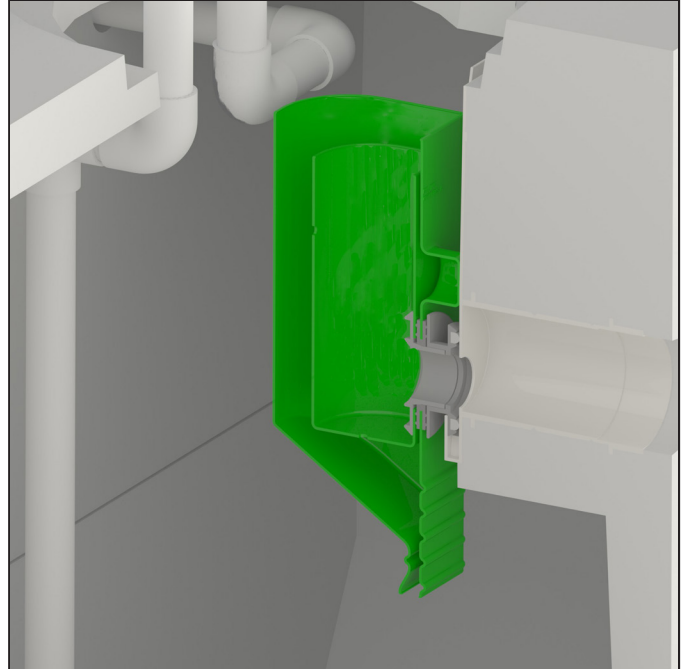

## FLOW EQUALIZATION DEVICE

The system shall include a non-mechanical, demand use, flow equalization device. The device shall be installed with the design flow equalization port located below the normal liquid level of the clarifier. If intermittent flow rates exceed the capacity of the design flow port, flow shall be held upstream until the intermittent flow dissipates. If the intermittent flow continues to increase, the liquid level may reach a sustained flow equalization port. With both ports in use, flow through the system increases while continuing to provide flow equalization to upstream and downstream processes. A peak flow equalization port is supplied but should not be required in a properly sized system. The device shall control normal residential flow rates and reduce typical residential flow surges. The flow equalization rate shall be dependent upon the specific loading pattern and the duration of flow surges. At the 600 GPD (gallons per day) NSF Standard 40/245 design loading schedule, minimum performance of the device shall equalize daily flow an average of 50%.

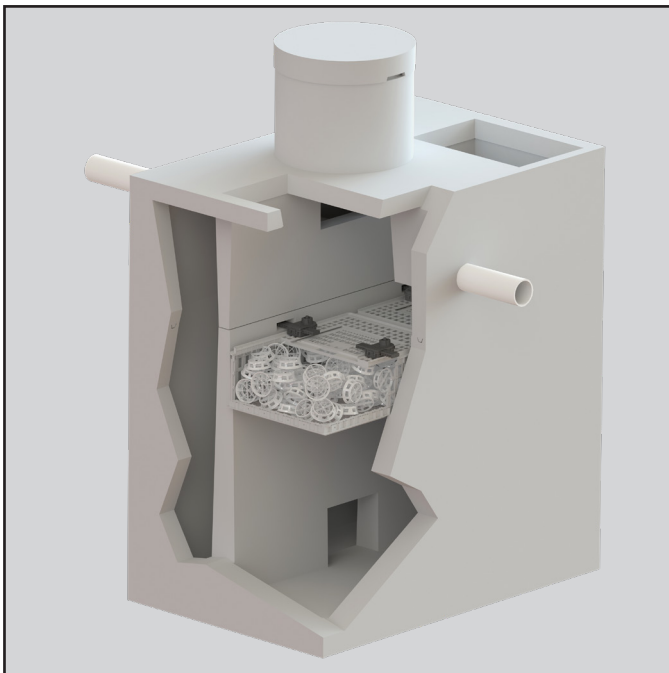


## HYDRO-KINETIC® FILTER

Significant reduction of organic matter shall occur in the treatment system prior to the Hydro-Kinetic filter. This Bio-Film reactor shall provide final treatment of the effluent to a near pristine state. Flow equalized liquid from the clarifier shall enter the influent chamber, travel down and be evenly distributed beneath the filtration media. The effects of gravity shall cause solids to settle to the bottom of the tank. As liquid travels up through the proprietary attached growth media, further reduction of organic matter shall take place. Additional settling and consolidation of solids shall take place downstream of the filter media. After passing through the filtration media for final polishing, the highly treated liquid shall flow into the final effluent zone before exiting the Hydro-Kinetic filter through the outlet tee.

# MODEL 600 FEU

## SERVICE PRO® MODEL 801P ELECTRICAL CONTROL CENTER

The Model 801P control center with MCD technology shall provide Monitoring, Compliance and Diagnostic functions for the treatment system. The pre-wired controls shall be mounted in a lockable NEMA rated enclosure designed specifically for outdoor use. The control center shall be a UL Listed assembly and shall include a time clock, alarm light, reset button, power switch, power light, phone/network light, recirculation pump light, air pump light, high water light and auxiliary alarm light. A pre-programmed time clock shall control the recirculation pump to insure that approximately 400% of the average daily flow is returned to the anoxic chamber. The control center shall monitor recirculation pump current, air pump operation, high water and auxiliary alarm circuitry. In the event of an alarm from the air pump or auxiliary input, the audible and visual alarms shall activate and the optional telemetry system shall report the condition. If abnormal operation of the recirculation pump is detected, a diagnostic sequence shall begin and the visual alarm shall activate. After a factory programmed recovery interval, an automatic restart attempt shall be initiated. If normal pump operation does not resume during 24 programmed recovery and restart cycles, the audible alarm shall activate and the optional telemetry system shall report the condition to the Service Pro monitoring center.

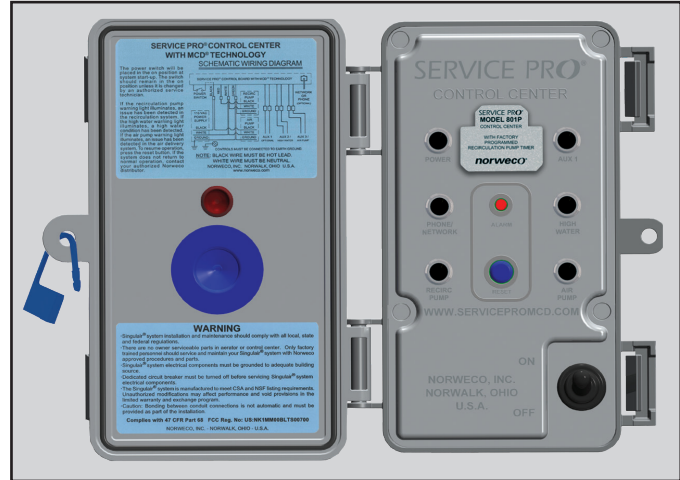

## SERVICE PRO® MONITORING CENTER

The Service Pro monitoring center shall include a 256 bit encrypted password protected website for interface with the monitoring center database. Access to the secure website shall be obtained through a unique user name and password that provides tiered access to data from monitored treatment systems. Access level tiers shall include distributors, service providers, regulatory agencies and individual system owners. Distributors and service providers shall be able to create accounts, enter serial numbers for system equipment, maintain service records and grant regulatory agencies access to the information. The monitoring center shall have the capability to schedule future service inspections and provide notification. Individual system owners shall be able to view information regarding their own systems, as well as download instructional information. Integrity of stored data shall be maintained through the use of multiple servers operating in geographically isolated locations.


## MODEL AT 1500 ULTRAVIOLET DISINFECTION SYSTEM (Optional)

The Hydro-Kinetic system shall be furnished complete with a Model AT 1500 ultraviolet disinfection system. The AT 1500 system shall incorporate a turbulence inducer and dual-pass design to insure pathogenic organisms receive maximum exposure to the ultraviolet light source. Effluent fecal coliform concentrations shall be consistently reduced to less than 200 mg/L. The ultraviolet disinfection system shall be UL Listed under Standard 979 as a residential treatment device and shall include a disinfection chamber, turbulence inducer, extension riser, quartz tube, Teflon cover, ultraviolet bulb and controls. An interlock switch shall be furnished to automatically disable the ultraviolet light source when the disinfection chamber is accessed. Ultraviolet disinfection systems without a residential UL Listing and an interlock switch have not demonstrated compliance with international electrical standards for safety and reliability and shall not be considered for this application.

# SPECIFICATIONS

## CERTIFIED PERFORMANCE


The wastewater treatment system shall be certified to operate for 12 consecutive months at the rated daily capacity without routine service. This performance shall be demonstrated by a continuous 12 month evaluation performed by an independent ANSI accredited, third-party testing facility. The evaluation shall consist of 2 consecutive ANSI/NSF Standard 40 and 245 evaluations back-to-back, including the stress sequences, with no maintenance allowed in between. When the first six-month evaluation is complete, the second full six-month evaluation shall immediately begin. For the entire certification protocol, the system shall achieve a total test average for the consecutive 12 month period of less than 5 mg/L Biochemical Oxygen Demand (CBOD), less than 5 mg/L Total Suspended Solids (TSS), and less than 10 mg/L Total Nitrogen (TN) in the effluent. Systems unable to meet these effluent quality parameters for at least 12 months of continuous testing by an independent ANSI accredited, third-party testing facility without service do not provide the desired level of effluent quality or service frequency, and shall not be considered for this application.

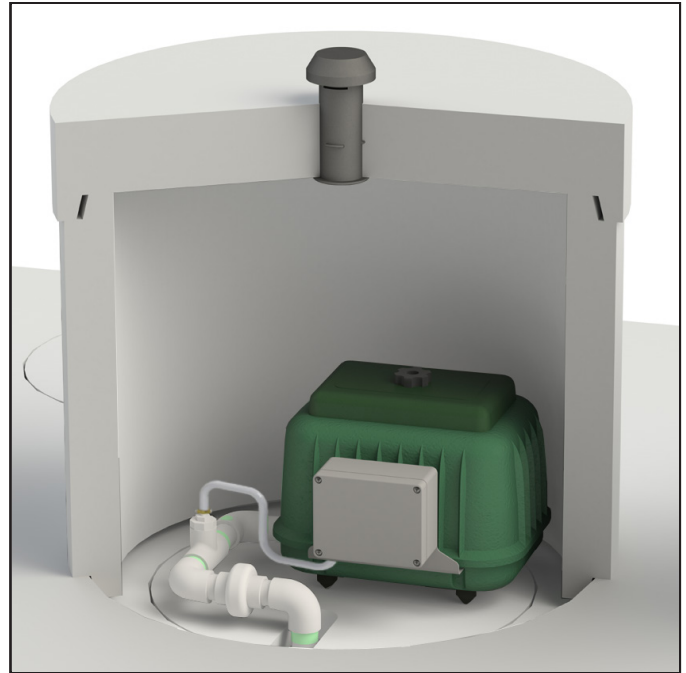

## MODEL A100 AIR PUMP

The Model A100 air pump shall be configured to allow remote mounting or installation within the access riser above the aeration chamber. When installed in the access riser, fresh air shall enter through a molded plastic vent assembly or integral perimeter vent in the access cover above the air pump. Fresh air shall enter the air pump through a filter located under the housing cover and be introduced below the liquid surface through a prefabricated diffuser assembly. Only the plastic diffuser assembly and the air piping shall be installed in contact with the liquid. The Model A100 air pump shall be wired for 115 volt, single phase, 60 cycle operation. The air pump shall include impact-resistant rubber diaphragms and valves which

prolong operational life. The unique design and construction shall provide easy maintenance, excellent cooling and quiet operation. The air pump shall continue aerating and mixing the aeration chamber even during high water conditions. Treatment systems that interrupt air delivery during high water conditions disrupt biological activity and shall not be considered for this application.

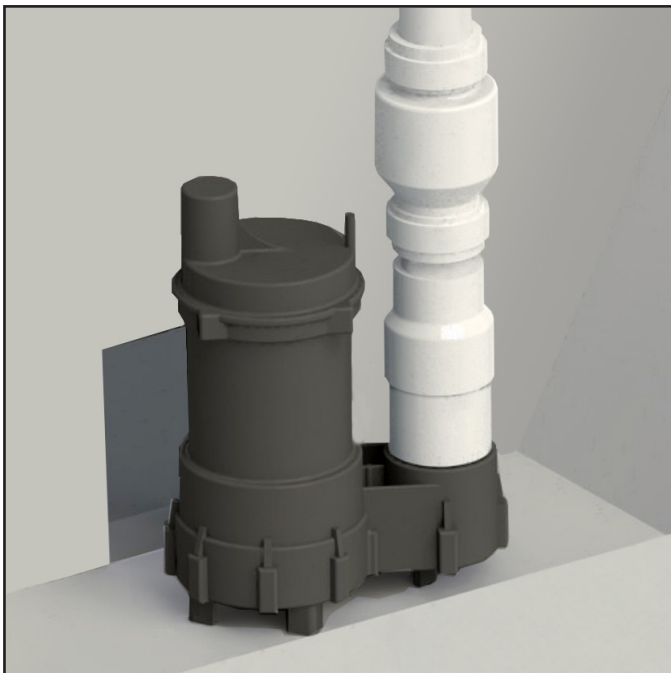

## MODEL SD103 RECIRCULATION PUMP

The Model SD103 submersible recirculation pump shall be wired for 115 volt, single phase, 60 cycle operation and shall be installed in the clarification chamber. The pump motor shall be  $\frac{1}{3}$  horsepower, operating at 3000 RPM. All openings in the flow path of the recirculation pump shall be of sufficient size to permit the passage of a  $\frac{3}{4}$ " diameter sphere. The pump shall be designed to be non-overloading throughout the entire pump curve and shall draw less than 7 full load amps. The pump motor shall contain moisture resistant windings and shall be securely mounted inside an oil-filled, watertight housing for maximum pump life. The stator housing and casing shall be of high grade cast iron or thermoplastic construction.

## BLUE CRYSTAL® CHLORINATION SYSTEM (Optional)

The Hydro-Kinetic system shall be furnished complete with a tablet feeder and a six month supply of Blue Crystal disinfecting tablets. Blue Crystal tablets shall be specifically formulated for consistent chlorine dosage and effluent disinfection to the sustained, variable and intermittent flows that are typical of domestic wastewater treatment systems. The tablets shall be manufactured from pure calcium hypochlorite and contain a minimum of 70% available chlorine. Each tablet shall be 2<sup>5</sup>/<sub>8</sub>" diameter, compressed to a 1" thickness, weigh approximately 5 ounces and be white in color with blue crystals for easy identification. The tablets shall dissolve in direct proportion to the flow rate, releasing controlled amounts of chlorine.

## BIO-MAX® DECHLORINATION SYSTEM (Optional)

The Hydro-Kinetic system shall be furnished complete with a tablet feeder and a six month supply of Bio-Max dechlorination tablets. The dechlorination tablets shall contain 92% sodium sulfite as the active ingredient and shall be specially formulated to chemically neutralize both free and combined chlorine. Each tablet shall be 2<sup>5</sup>/<sub>8</sub>" diameter, compressed to a 1<sup>3</sup>/<sub>16</sub>" thickness, weigh approximately 5 ounces and be green in color for easy identification. The tablets shall dissolve slowly, releasing controlled amounts of chemical for the instantaneous removal of residual chlorine from the system effluent.

## LIMITED WARRANTY

The wastewater treatment system shall be covered by a two year limited warranty. The Model A100 air pump, Model SD103 recirculation pump, Service Pro Model 801P control center and any other Hydro-Kinetic components purchased from the manufacturer shall be warranted to be free from defects in material and workmanship, under normal use and service, for a period of two years from the date of purchase. A warranty registration card shall be attached to the system before shipment from the factory. A means to register the wastewater treatment system for warranty protection via the internet shall be provided by the manufacturer for the convenience of the distributor, customer and regulatory agency. The distributor shall provide details of the limited warranty to the regulatory agency, contractor and customer as required.

## EQUIPMENT MANUFACTURER

The equipment specified herein shall be the product of a manufacturer having a minimum of seven years experience in the construction of prefabricated wastewater treatment equipment and systems. Bids shall be prepared on the basis of the equipment and material specified herein for purposes of determining the low bid. This is not done, however, to eliminate other products or equipment of equal quality and efficiency. If equipment is to be substituted, approval of such substitution must be made prior to execution of any order. It is assumed that substitution will result in a reduction of cost to the contractor and that if accepted, these savings will be passed along by a reduction in the base bid.

# PROGRESS THROUGH SERVICE SINCE 1906

***norweco***®

*Engineering the future of water  
and wastewater treatment*

220 REPUBLIC STREET  
NORWALK, OHIO, U.S.A. 44857  
TELEPHONE (419) 668-4471  
FAX (419) 663-5440  
[www.norweco.com](http://www.norweco.com)

**DISTRIBUTED LOCALLY BY:**

Norweco®, Norweco.com®, Singulair®, Modulair®, Travalair®, Singulair R3®, Singulair Green®, Ribbit Rivet®, Hydro-Kinetic®, Hydro-Kinetic Bio-Film Reactor®, Evenair®, Lift-Rail®, Microsonic®, Bio-Dynamic®, Bio-Sanitizer®, Bio-Neutralizer®, Bio-Kinetic®, Bio-Static®, Bio-Gem®, Bio-Max®, Bio-Perc®, Blue Crystal®, Phos-4-Fade®, Enviro-C®, Nitro-Buster®, ClearCheck®, ChemCheck®, Tri-Max®, Hydra-Max®, Service Pro®, MCD®, TNT®, WASP®, Grease Buster® and "BUSTER" logo® are registered trademarks of Norwalk Wastewater Equipment Company, Inc.

©MMXXI NORWECO, INC. / REV.10/2021