

May 5, 2025



PM15625-LET.01-Rev.02

1818 Farm & Cidery
1811 Richardson Side Road
Ottawa (Carp), Ontario
K0A 1L0

Attention: Ken Hoppner

Subject: **Hydrogeological Assessment and Terrain Analysis
Zoning Bylaw Amendment and Site Plan Control
Application
1811 Richardson Side Road
Ottawa (Carp), Ontario**

Consulting Engineers

9 Auriga Drive
Ottawa, Ontario
K2E 7T9
Tel: (613) 226-7381

Geotechnical Engineering
Environmental Engineering
Hydrogeology
Materials Testing
Building Science
Rural Development Design
Retaining Wall Design
Noise and Vibration Studies

patersongroup.ca

INTRODUCTION

Further to your request, Paterson has conducted a Hydrogeological Assessment and Terrain Analysis in support of a Re-Zoning Application and Site Plan Control Application for the proposed alteration to allow for a place of assembly as part of an on-farm diversified use (OFDU) and/or restaurant to be located at 1811 Richardson Side Road in Ottawa (Carp), Ontario.

The purpose of this work has been to determine the suitability of the water supply aquifer underlying the site as well as determine the capacity of the site to attenuate the sewage system impacts to support the Re-Zoning Application and Site Plan Control Application.

The Subject Site consists of a 11.68 ha lot and is currently occupied by a residential dwelling, located centrally near Bradley Side Road, a centrally located commercial building (Cidery), a commercial building to the south, and an agricultural area located on the northeastern portion of the property with an associated temporary tent-based greenhouse. The south-western portion of the site generally consists of treed areas. The ground surface generally slopes towards the east. There is a sharp slope from the central property to the northeastern agricultural area. The general direction of water flow is towards the Ottawa River to the north.

The Subject Site is bordered on all sides by agricultural lands, with a church and dwelling located to the south of the site. The site has frontage onto Bradley Side Road to the northwest, Huntmar Drive to the northeast and Richardson Side Road to the southeast.



The subject site itself and the surrounding commercial areas are zoned AG3 for Agricultural General Subzone 3 (GeoOttawa).

Hydrogeological Pre-consultation

A Hydrogeological pre-consultation was completed with a City of Ottawa Hydrogeologist on June 23, 2024. The City Hydrogeologist noted that water quantity and quality may be an issue. Evidence was provided from the water well hydrofracking process to increase the quantity and was to be confirmed with the pumping test. An 8-hour pumping test with the standard Subdivision Package suite of parameters, trace metals and Volatile Organic Compounds (VOC's) required by the City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG) was determined to be acceptable.

Description of Subject Site

The subject site is an approximately 11.68 ha lot and is currently occupied by a two-storey residential dwelling, a commercial building to the south with associated parking and storage, a commercial building (Cidery), and agricultural lands to the east, with an associated temporary tent-based greenhouse. The Re-zoning Application is for a zoning by-law amendment to increase the number of guests allowed at the OFDU and/or restaurant. Please refer to Figure-1 Key Plan, attached, for the proposed site location.

The residential dwelling is currently serviced by an onsite sewage system and an existing private drilled well. A newly drilled well was installed in 2022 to service the Cidery and a new sewage system will be required to service the proposed change of use. At this time no site plan has been completed.

The newly drilled well, hereafter referred to as Test Well 1 (TW1), is the well which is currently servicing the Cidery and will continue to service the building following the completion of construction. The property owner will need to ensure that protective measures are taken to protect the wellhead, such as the use of a barrier, during construction.

The suitability of the aquifer to supply the subject site was assessed using the methodology provided in City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

Based on available Ontario Geological Survey (OGS) mapping (GRS005), the subject site is not within an area of potential karst.

MISSISSIPPI-RIDEAU SOURCE PROTECTION PLAN

The Mississippi-Rideau Source Protection Plan (MRSP) provides guidance as to which policies apply to a given property, municipality or specific activity and if there are specific designations that apply to the area. The subject site and surrounding areas have not been



designated as a Significant Groundwater Recharge Area (SGRA), Highly Vulnerable Aquifer (HVA), or Intake Protection Zones (IPZ) Zone within the MRSP.

There are no related requirements for this site relative to the MRSP.

Karst Mapping

As discussed in the City pre-consultation meeting, karst was not considered a concern at the site. Available Karst mapping (OGS GRS005) was reviewed as part of this assessment. The available mapping does not indicate the presence of any inferred or potential karstic features. Furthermore, no indication of karstic features was observed during the site visits completed by Paterson personnel.

FIELDWORK PROGRAM

Well Inspection

A visual inspection of TW1 was performed by Paterson personnel which confirmed that the well casing and cap are in good condition. The final grading around the well will be sufficiently graded to direct surface water away from the wellhead (as required by O.Reg 903) at the time of the new sewage system installation. The stick-up was measured to be 0.49 m above ground surface. Based on a visual inspection by Paterson personnel, the well was deemed to be in good condition.

Well Testing

As a means to demonstrate the adequacy of the aquifer underlying the subject lands, with respect to water quality and quantity, TW1 was tested. TW1 has a Water Well Record (WWR) Well ID of A342224 with a 152.4 mm diameter steel casing that extends to 20.1 m below ground surface (bgs) and a 0.49 m stick-up. The well itself extends to a depth of 121.9 m bgs. Based on available geological mapping, the drift thickness at TW1 varies from 15 to 25 m.

As a means to evaluate the water supply aquifer intercepted by the well, the well was subjected to an 8-hour constant rate pumping test. The pumping test was conducted on June 25, 2024 under the full-time supervision of Paterson personnel. Prior to the pumping test the well was disinfected as per the MECP Disinfection Instruction Sheet, and a data-logger was installed to monitor the background groundwater levels.

The existing submersible pump was used for the 8-hour pumping test. A licensed water well technician (Air Rock) completed the necessary plumbing related activities. The discharge line was placed at a sufficient distance to ensure that the discharge water was being directed away from the well as well as any septic systems in the area. Upon completion of the test, the system was returned to its normal configuration.



The pumping test was carried out at a pumping rate of 30 L/min for a duration of 8 hours. During the pumping test, the pumping rate was periodically measured using the timed volume correlation method. The pumping rate was maintained within 5% of the selected pumping rate. The static water level was recorded manually and an electric datalogger (VanEssen TD-Diver) was installed in the test well prior to the start of the pumping test.

The selected rate of 30 L/min provides approximately 1.4 times (14,400 L) the maximum total daily design sanitary sewage flow (TDDSSF) of 10,000 L/day for the subject site during the 8-hour pumping test in support of the Re-zoning Application. The TDDSSF for the proposed development is 7,125 L/day (design by others) under the Site Plan Application. This provides greater than 2 times the TDDSSF proposed for the Site Plan Application. The total daily design sanitary sewage flows (TDDSSF) are proposed to remain below the limit of 10,000 L/day as set out by the Ontario Building Code (OBC) and does not require a large-scale subsurface sewage system.

The data logger recorded water levels at 30 second intervals. In addition, manual water level readings were taken at periodic intervals during the test.

Recovery data was collected from the well following the completion of the pumping. The well was noted to have achieved 95% recovery approximately 13 hours after the completion of pumping.

Groundwater samples were collected at 4 hours and 8 hours after the start of pumping. Prior to collection of the groundwater samples, the free chlorine residual was verified as non-detectable. The water samples were submitted for comprehensive testing of bacteriological, chemical, and physical water quality parameters consistent with the standard "Subdivision Supply" suite of parameters plus trace metals. VOCs were sampled 4 hours and 8 hours after the start of pumping.

All samples were collected unfiltered and unchlorinated and were placed directly into clean bottles supplied by the analytical laboratory. Samples were placed immediately into a cooler with ice and were transported directly to Environmental Testing Canada Inc.(Eurofins) laboratory in Ottawa. All samples were received by the laboratory within 24 hours of collection.

A series of field tests of the pumped water were carried out at the well head during the 8-hour pumping test. The parameters tested at the well head included: pH, total dissolved solids, conductivity, turbidity, apparent colour, hydrogen sulfide (olfactory only), and temperature. Calibration / confirmation of calibration of all field-testing equipment was performed in Paterson's laboratory the day prior to the pumping test. Values are then confirmed again onsite prior to the start of the pumping test.

Due to elevated measurements for turbidity, colour, and aluminum levels encountered during the pumping test, Paterson personnel returned to the site on July 19, 2024 to collect an additional untreated sample under normal operating conditions of TW1.



Aquifer Analysis

Water Quantity

Pumping test data was analyzed using AQTESOLV Pro Version 4 aquifer analysis software package by HydroSOLVE Inc. Drawdown data was measured using an electronic water level tape and an electronic datalogger unit.

Table 1: SUMMARY OF WATER SUPPLY AQUIFER CHARACTERISTICS OF TW1	
AQUIFER PARAMETER	RESULT OF ANALYSIS
Transmissivity (m ² /day)	1.68
Pumping Rate (L/min)	30
Pre-test Static Water Level (m)	4.25
Post-test Static Water Level (m)	19.47
Available Drawdown (m)	118.16
% Drawdown During Pumping Test (%)	13
Specific Capacity (L/min/m drawdown)	1.97

The drawdown data was analyzed using the Theis and Cooper Jacob methods of analysis. Aquifer transmissivity is estimated to be 1.68 m²/day. Refer to the Theis and Cooper Jacob methods of analysis data sheets attached to this report.

The pumping test results show that TW1 has a high yield to support the water demands that may be required. Overall maximum drawdown at a constant pumping rate for a period of 8 hours was approximately 15.22 m at approximately 8 hours into the pumping test (13% of the available drawdown). 95% recovery was achieved approximately 13 hours after the end of pumping.

The total volume of water pumped during the 8-hour pumping event was approximately 14,400 L. This is approximately 1.4 times the maximum total daily design volume of water (10,000 L/d) required to support the Re-Zoning Application for all uses on the property. This volume is more than twice the TDDSSF of 7,125 L/day for the Site Plan.

The suitability of the aquifer to support the proposed Re-Zoning Application and Site Plan Control Application for the proposed development was assessed using the methodology provided in the City of Ottawa HTAG. Based on the information summarized in Table 1, it is readily apparent that the water supply well has intercepted an adequately strong water supply aquifer which has sufficient quantity to service the maximum site requirements under OBC.

Given the analyses presented and summarized above, it is our opinion that there is an adequate supply of water to support the proposed Re-Zoning Application and Site Plan Control Application. Available water well records (WWR) of the neighboring properties on



the MECP Well Record mapping website indicated that the wells were screened in limestone. Surrounding WWR's are attached to this report.

Water Quality

Field Data

Turbidity, electrical conductivity, total dissolved solids (TDS), pH, true color and temperature were measured at the wellhead during the pumping test. The measurements and time intervals for each of these parameters are summarized in the graphical representation below. In addition, a HACH Pocket Colorimeter II chlorine reader was used to measure the free chlorine residual level. No chlorine residual was detected in the discharge water prior to the collection of the water samples.

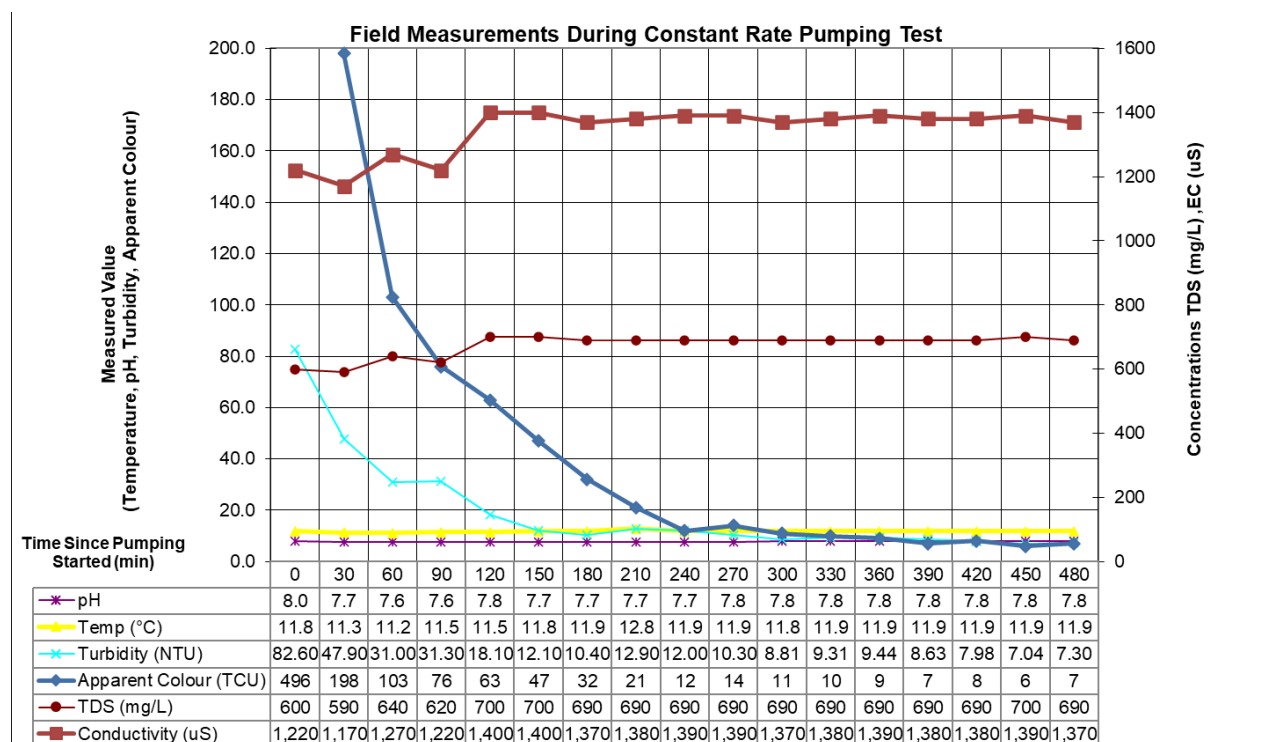


Figure 1: Field Testing Results



Laboratory Data

The Subdivision Package suite of parameters and trace metals laboratory water quality obtained from the pumping test of TW1 is provided in Table 2a and 2b below and the laboratory analyses reports can be found attached. VOC laboratory analytical testing was completed and measured to be non-detect in the sample results and is provided in Table 2c. All laboratory test results can be found attached to this report.

TABLE 2a: GROUNDWATER MICROBIOLOGY & GENERAL GEOCHEMISTRY						
PARAMETER	UNITS	ODWS		TW1		
		LIMIT	TYPE	TW1 GW1 (4 hr)	TW1 GW2 (8 hr)	TW1 GW-3
				6/25/2024	6/25/2024	7/19/2024
MICROBIOLOGICAL						
Escherichia Coli (E.Coli)	ct/100mL	0	MAC	0	0	-
Total Coliforms	ct/100mL	0	MAC	0	0	-
GENERAL CHEMICAL - HEALTH RELATED						
Fluoride (F)	mg/L	1.5	MAC	1.32	1.34	-
Ammonia (N-NH ₃)	mg/L	-	-	0.259	0.263	-
Nitrite (N-NO ₂)	mg/L	1	MAC	<0.5	<0.5	-
Nitrate (N-NO ₃)	mg/L	10	MAC	<0.5	<0.5	-
Total Kjeldahl Nitrogen	mg/L	-	-	1.460	0.483	-
Turbidity (Field)	NTU	1.0 (5.0)	MAC/AO	12.00	7.30	0.56
Turbidity (Laboratory)	NTU	1.0 (5.0)	MAC/AO	11.5	7.1	3.3
GENERAL CHEMICAL - AESTHETIC RELATED						
Alkalinity (as CaCO3)	mg/L	30-500	OG	225	225	-
Chloride (Cl)	mg/L	250	AO	85	86	-
Colour (Apparent-Lab)	TCU	5	AO	10	10	12
Colour (Apparent-Field)	TCU	5	AO	12	7	0
Conductivity	uS/cm	-	-	1,350	1,370	-
Dissolved Organic Carbon	mg/L	5	AO	1.3	1.0	-
Hardness (as CaCO3)	mg/L	100	OG	356	360	-
Ion Balance	unitless	-	-	1.01	1.02	-
pH	unitless	6.5-8.5	AO	7.97	8.04	-
Phenols	mg/L	-	-	<0.001	<0.001	-
Sulphate (SO ₄)	mg/L	500	AO	388	394	-
Sulphide (S ₂ ⁻)	mg/L	0.05	AO	0.95	1.16	-
Tannin & Lignin	mg/L	-	-	0.20	0.30	-
Total Dissolved Solids	mg/L	500	AO	944	959	-

- ODWS identifies the following types of parameters:
MAC = Maximum Allowable Concentration
AO = Aesthetic Objective
OG = Operational Guideline
- Shaded Concentration Indicates an Exceedance of the ODWS Objective



TABLE 2b: GROUNDWATER GEOCHEMISTRY - METALS

PARAMETER	UNITS	ODWS		TW1		
		LIMIT	TYPE	TW1 GW1 (4 hr)	TW1 GW2 (8 hr)	TW1 GW-3
				6/25/2024	6/25/2024	7/19/2024
METALS						
Aluminum (Al)	mg/L	0.1	OG	0.43	0.34	0.02
Antimony (Sb)	mg/L	0.006	IMAC	<0.0005	<0.0005	-
Arsenic (As)	mg/L	0.01	IMAC	<0.001	<0.001	-
Barium (Ba)	mg/L	1.0	MAC	0.19	0.19	-
Beryllium (Be)	mg/L	-	-	<0.0005	<0.0005	-
Boron (B)	mg/L	5.0	IMAC	0.43	0.44	-
Cadmium (Cd)	mg/L	0.005	MAC	<0.0001	<0.0001	-
Calcium (Ca)	mg/L	-	-	74	75	-
Chromium (Cr)	mg/L	0.05	MAC	0.001	<0.001	-
Cobalt (Co)	mg/L	-	-	0.0002	<0.0002	-
Copper (Cu)	mg/L	1.0	AO	<0.001	<0.001	-
Iron (Fe)	mg/L	0.3	AO	0.68	0.44	-
Lead (Pb)	mg/L	0.01	MAC	<0.001	<0.001	-
Magnesium (Mg)	mg/L	-	-	42	42	-
Manganese (Mn)	mg/L	0.05	AO	0.02	0.02	-
Mercury (Hg)	mg/L	0.001	MAC	<0.0001	<0.0001	-
Molybdenum (Mo)	mg/L	-	-	<0.005	<0.005	-
Nickel (Ni)	mg/L	-	-	<0.005	<0.005	-
Potassium (K)	mg/L	-	-	6	6	-
Selenium (Se)	mg/L	0.05	MAC	<0.001	<0.001	-
Silver (Ag)	mg/L	-	-	<0.0001	<0.0001	-
Sodium (Na)	mg/L	200	AO	181	186	-
Strontium (Sr)	mg/L	-	-	2.64	2.72	-
Thallium (Tl)	mg/L	-	-	<0.0001	<0.0001	-
Uranium (U)	mg/L	0.02	MAC	<0.001	<0.001	-
Vanadium (V)	mg/L	-	-	0.001	<0.001	-
Zinc (Zn)	mg/L	5.0	AO	<0.01	<0.01	-

1. ODWS identifies the following types of parameters:

MAC = Maximum Acceptable Concentration

IMAC = Interim Maximum Acceptable Concentration

AO = Aesthetic Objective

OG = Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective



TABLE 2c: GROUNDWATER GEOCHEMISTRY - VOLATILES

PARAMETER	UNITS	ODWS		TW1	
		LIMIT	TYPE	TW1 GW1 (4 hr) 6/25/2024	TW1 GW2 (8 hr) 6/25/2024
VOCs Surrogates					
1,2-dichloroethane-d4	%	-	-	122	109
4-bromofluorobenzene	%	-	-	71	72
Toluene-d8	%	-	-	110	113
Volatiles					
1,1,1,2-tetrachloroethane	µg/L	-	-	<0.5	<0.5
1,1,1-trichloroethane	µg/L	-	-	<0.4	<0.4
1,1,2,2-tetrachloroethane	µg/L	-	-	<0.5	<0.5
1,1,2-trichloroethane	µg/L	-	-	<0.4	<0.4
1,1-dichloroethane	µg/L	-	-	<0.4	<0.4
1,1-dichloroethylene	µg/L	14.0	MAC	<0.5	<0.5
1,2-dichlorobenzene	µg/L	200.0	MAC	<0.4	<0.4
1,2-dichloroethane	µg/L	5.0	IMAC	<0.2	<0.2
1,2-dichloropropane	µg/L	-	-	<0.5	<0.5
1,3,5-trimethylbenzene	µg/L	-	-	<0.3	<0.3
1,3-dichlorobenzene	µg/L	-	-	<0.4	<0.4
1,3-Dichloropropylene (cis+trans)	µg/L	-	-	<0.3	<0.3
1,4-dichlorobenzene	µg/L	5.0	MAC	<0.4	<0.4
Acetone	µg/L	-	-	<30	<30
Benzene	µg/L	1.0	MAC	<0.5	<0.5
Bromodichloromethane	µg/L	-	-	<0.3	<0.3
Bromoform	µg/L	-	-	<0.4	<0.4
Bromomethane	µg/L	-	-	<0.5	<0.5
c-1,2-Dichloroethylene	µg/L	-	-	<0.4	<0.4
c-1,3-Dichloropropylene	µg/L	-	-	<0.2	<0.2
Carbon Tetrachloride	µg/L	2.0	MAC	<0.2	<0.2
Chloroethane	µg/L	-	-	<0.2	<0.2
Chloroform	µg/L	-	-	<0.5	<0.5
Dibromochloromethane	µg/L	-	-	<0.3	<0.3
Dichlorodifluoromethane	µg/L	-	-	<0.5	<0.5
Dichloromethane	µg/L	50	MAC	<4.0	<4.0
Ethylbenzene	µg/L	140	MAC	<0.5	<0.5
Ethylene Dibromide	µg/L	-	-	<0.2	<0.2
Hexane	µg/L	-	-	<5	<5
m/p-xylene	µg/L	-	-	<0.4	<0.4
Methyl Ethyl Ketone (MEK)	µg/L	-	-	<2	<2
Methyl Isobutyl Ketone (MIBK)	µg/L	-	-	<5	<5
Methyl Tert Butyl Ether (MTBE)	µg/L	15	AO	<2	<2
Monochlorobenzene	µg/L	80	MAC	<0.5	<0.5
o-xylene	µg/L	-	-	<0.4	<0.4
Styrene	µg/L	-	-	<0.5	<0.5
trans-1,2-Dichloroethylene	µg/L	-	-	<0.4	<0.4
trans-1,3-Dichloropropylene	µg/L	-	-	<0.2	<0.2
Tetrachloroethylene	µg/L	10	MAC	<0.3	<0.3
Toluene	µg/L	60	MAC	<0.4	<0.4
Trichloroethylene	µg/L	5	MAC	<0.3	<0.3
Trichlorofluoromethane	µg/L	-	-	<0.5	<0.5
Vinyl Chloride	µg/L	1	MAC	<0.2	<0.2
Xylene; total	µg/L	90	MAC	<0.5	<0.5

- ODWS identifies the following types of parameters:
MAC = Maximum Acceptable Concentration
IMAC = Interim Maximum Acceptable Concentration
AO = Aesthetic Objective
OG = Operational Guideline
- Shaded Concentration Indicates an Exceedance of the ODWS Objective



The bacteriological test results (Certificate of Analysis – Report No. 3966666) indicated that the test samples at the 4 and 8 hour interval were non-detect (0 ct/100 mL) for E.Coli and Total Coliforms.

The water quality of the subject water supply well meets all the Ontario Drinking Water Standards maximum acceptable concentrations (MAC). Furthermore, the water meets all of the Aesthetic Objectives (AO) and Operational Guidelines (OG) with the exception of the following.

- ☐ Hardness (as CaCO_3)
- ☐ Total Dissolved Solids (TDS)
- ☐ Iron (Fe)
- ☐ Total Sulphides
- ☐ Aluminum (Al)
- ☐ Colour
- ☐ Turbidity

Exceedances of the above parameters are not uncommon of the water supply in the subject aquifer. Each of these groundwater parameters are discussed in detail below.

Should any water treatment be desired by the owner, it is recommended that a water treatment specialist be retained to ensure that water treatment occurs in a safe manner.

Hardness as CaCO_3

Hardness, expressed as calcium carbonate, is an operation guideline and does not appear in the ODWS. Rather, it appears in the Technical Support Documents for Ontario Drinking Water Standards, Objectives and Guidelines as a parameter with an operational guideline at 100 mg/L. At the measured concentrations of 356 and 360 mg/L, the water is considered to be very hard, however, it is below the reasonable treatable limit of 500 mg/L specified in Table 3 of the MOECC guidance document Procedure D-5-5 (1996).

The Langelier calculation provided an LSI of 0.0. Based on the evaluation of the result, the water is saturated and tends to precipitate a scale layer of calcium carbonate (scale forming and mildly corrosive). Based on the range of stability, there are no mitigative measures needed. See Langelier Saturation Index Calculation attached for calculation details.

It is recommended that water hardness be treated using conventional technologies such as water softening or reverse osmosis, if desired by the owner. Without treating hardness, scaling can occur which can result in discolouration and residue build-up on water fixtures, or reduction in boiler efficiency due to scale build-up. According to Health Canada's *Guidelines for Canadian Drinking Water Quality - Summary Tables* "Although hardness may have significant aesthetic effects, a guideline has not been established because public acceptance of hardness may vary considerably according to the local conditions; major contributors to hardness (calcium and magnesium) are not of direct public health concern".



Total Dissolved Solids (TDS)

TDS refers to the concentration of inorganic substances dissolved in water. The main constituents are typically chloride, sulphates, calcium, magnesium, and bicarbonates. The TDS concentration of 944 and 959 mg/L, at the 4- and 8-hour points, respectively, exceeds the Aesthetic Objective of 500 mg/L. At concentrations above 500 mg/L, some consumers may find the taste objectionable, however, as the objective is an aesthetic objective, no treatment is required. It is recommended that a point of use reverse osmosis unit be installed to remove taste issues, if the owner desires, for drinking purposes. As such, no taste problems will occur when the recommended treatment technology, or equivalent, is used.

The Langelier calculation provided an LSI of 0.0. Based on the evaluation of the result, the water is saturated and does not tend to precipitate a scale layer of calcium carbonate (non-scale forming and non-corrosive). Based on the range of stability in the positive direction, there are no mitigative measures needed. See Langelier Saturation Index Calculation attached for calculation details.

Iron

Concentrations of iron above 0.3 mg/L can contribute to staining of fixtures and a metallic taste at higher concentrations. Precipitation of iron can promote the growth of iron bacteria in pipes. The concentration of iron in the groundwater in TW1 was measured to be 0.68 and 0.44 mg/L. The concentration of iron in the groundwater in the test well is considered to be reasonably treatable in accordance with Procedure D-5-5. It is recommended that a water softener or manganese greensand filter be used to reduce the levels of iron and reduce the potential for excessive precipitate occurring in the water supply system, if desired by the property owner. If treatment is not used, negative impacts such as discolouration of water fixtures, precipitation of iron and staining may occur.

Total Sulphides

Total sulphides were reported to be present within the water supply aquifer at concentrations of 0.95 and 1.16 mg/L. These can present as compounds such as iron sulphide or hydrogen sulphide, but are not limited to these forms. The value noted is for the **total sulphides** within the sample as there is no laboratory test for only hydrogen sulphide. Total sulphides should **not** be equated to a result for hydrogen sulphide.

Hydrogen sulphide is a gas that is heavier than air and has a very distinct “rotten egg” odour. Through the latter portion of the test, a faint odour was detected periodically. The aesthetic objective for hydrogen sulphide, which is incidentally also the threshold of the average human olfactory detection, is 0.05 mg/L. Field testing (olfactory only) estimated values in the range of 0 to 0.1 mg/L, which is in line with the intermittent olfactory observation. MECP Procedure D-5-5 does not indicate a maximum treatable limit for sulphide. One method to remove hydrogen sulphide, if desired, is a chlorine feeder and filter through oxidation or equivalent method recommended by a water treatment professional.



Aluminum

Aluminum was reported to be present within the water supply aquifer at concentrations of 0.43 and 0.32 mg/L at the 4- and 8-hour marks, respectively. Aluminum has an OG of 0.1 mg/L where an exceedance may cause coating of pipes in the distribution system and flocculation in the distribution system. Aluminum has a federal health related guideline MAC of 2.9 mg/L, which was not exceeded. During a revisit to the subject site and resample, the aluminum concentration was 0.02 mg/L, indicating that TW1 operating under normal usage meets the required guidelines.

Colour

Colour may occur in drinking water for several reasons. It may be due to organic substances from the decay of vegetation, or the presence of metals such as iron, manganese, and copper, which are abundant in nature. The provincial aesthetic objective for colour in drinking water is 5 True Colour Units (TCU). The federal (Health Canada) guideline aesthetic objective limit for colour is 15 TCU (Guidelines for Canadian Drinking Water Quality, Health Canada June 2019). Procedure D-5-5 gives a maximum concentration considered reasonably treatable for colour as 7 TCU. As colour is a strictly aesthetic parameter, a manganese greensand filter or a carbon filter can be used to reduced manganese from the water supply, if desired by the owner.

During the field pumping test, a DR900 colorimeter was used to measure apparent colour in the groundwater at regular intervals. Field testing for colour had values of 12 and 7 TCU. Laboratory testing showed colour values of 10 TCU during the field test and 12 TCU from the revisit. Apparent colour in the groundwater was measured as 0 TCU during regular usage which is below the aesthetic objective of 5 TCU. The elevated apparent colour levels detected in the lab samples is attributed to the precipitation of iron and manganese out of the groundwater.

Turbidity

Turbidity, which is generally an aesthetic parameter, was detected in the laboratory test samples at values of 11.5 and 7.1 NTU at the 4 hour and 8 h mark of the pumping test, and at 3.3 NTU during regular usage. Field testing of turbidity showed values of 12, and 7.3 NTU at the 4- and 8-hour mark of the pumping test and 0.56 NTU during regular usage. The test during regular usage was completed during the resample visit. Continued pumping showed a gradual decrease towards the end of the pumping test. The rented pump would have disturbed any precipitate in the water column during its installation and removal of the existing pump. This is demonstrated by the reduction in turbidity and iron during the pumping test, further corroborated by the reduction in turbidity under normal usage.

The ODWS maximum acceptable concentration for turbidity in drinking water entering the distribution system is 1 NTU. In accordance with Procedure D-5-5, Table 2 does not reflect a maximum concentration considered reasonably treatable for Turbidity. The Aesthetic Objective and Maximum Concentration Considered Reasonably Treatable



(MCCRT) for turbidity in drinking water reaching the consumer is 5 NTU (Procedure D-5-5, Table 3). Rather, Procedure D-5-5 indicated that “particular care must be taken during testing to ensure that the bacteria requirements of Table 1 are met.” Based on the test results, the bacteria requirements of Table 1 of D-5-5 have been met (E.Coli = 0 and Total Coliforms = 0).

Sodium

Sodium (Na), an aesthetic parameter, was detected in the laboratory test sample at concentrations of 181 and 186 mg/L, which does not exceed the ODWS aesthetic objective of 200 mg/L. Although sodium is not toxic and no maximum acceptable concentration has been set, concentrations above 20 mg/L require that the Medical Officer of Health be notified of the water quality results, so that this information may be passed on to local physicians for use in treatment of those requiring a sodium-restricted diet. It should be noted that some water treatment technologies, such as water softeners, can increase the sodium concentration so care should be given if such treatment technologies are used.

Water Treatment

A water treatment specialist, PV Plumbing & Water Inc., was retained by the owner to provide a treatment train for the water supply. A quote outlining the treatment system has been attached. Based on the water treatment system, the aforementioned aesthetic objectives will be met. Although a specific water treatment system has been proposed, general water treatment recommendations for the aforementioned parameters are still provided.



Terrain Analysis

Surficial Geology

The subsurface conditions are mapped to be fine-textured glaciomarine deposits, mainly consisting of silt and clay, underlying the eastern side of the property; while the western side of the property is mapped to be underlain by stone-poor sandy-silt to silty-sand textured till (OGS MRD218, 2022). The bedrock geology is mapped to be limestone and shale of the Verulam formation of the Simcoe Group (OGS MRD219).

Drift thickness is mapped to be 15 to 25 m bgs, which coincides with neighbouring water well records. The WWR for TW1 showed an overburden thickness of 18m.

Hydrogeological Sensitivity of the Site

The subject site currently contains a two-storey residential dwelling, a commercial building to the south with associated parking and storage, a commercial building (Cidery), and agricultural lands to the east. The subject site is bordered on all sides by agricultural lands, with a church and dwelling located to the south of the site. The site fronts onto Bradley Side Road to the north-west, Huntmar Drive to the north-east and Richardson Side Road to the south-east. All surrounding properties are on private services. The adjacent properties are serviced by private wells and septic systems.

According to available mapping and WWRs, the overburden thickness was observed to be greater than 2 m. As the proposed site does not have bedrock within 2 m of the ground surface, the site is not considered hydrogeologically sensitive. Separation distances are not required to be increased between the septic components and the onsite well.

To corroborate our position in this matter, the water quality of the bedrock aquifer accessed by the onsite drilled potable supply well shows no indication of surface water or surface impacts from sewage system effluent.

Conceptual Lot Development

This Terrain Analysis is completed to support a Re-zoning Application and a Site Plan Control Application. See the attached Site Plan titled “1818 Farm and Cidery – Site Plan” by Vandenberg & Wildeboer Architects, dated March 20, 2024. The place of assembly will consist of a cidery and open air assembly area along with associated parking.

Sewage System Design and Total Daily Design Sewage Flow

This Terrain Analysis has been completed to support a Re-zoning Application and Site Plan Control Application. The associated Ontario Septic System Office permit and sewage treatment system design by D.B. Grey Engineering Inc has been included in the



overall application submission. The TDDSSF for the place of assembly was provided to be 7,125 L/day. A maximum predicted nitrate concentration will be determined for the site as a whole, and the current assessment will be completed based on existing conditions that include the existing residence. Any associated flows with the residence will be counted towards the total site capacity in the site plan application. The total volumes for the site, including the place of assembly and on-site residence, are less than 10,000 L/day per review and design by others.

The proposed property will be analysed as part of the Re-zoning Application and Site Plan Control Application to ensure the theoretical impacts are below the Ontario Drinking Water Objective maximum allowable concentration of 10 mg/L of nitrate in the groundwater prior to the property line.

Predictive Nitrate Impact Assessment

Nitrate is considered to be a critical parameter of concern when assessing impacts to groundwater quality downgradient of an onsite sewage system. The City of Ottawa annotated MECP Procedure D-5-4 in the Hydrogeological and Terrain Analysis Guidelines (HTAG) applies for the proposed development. For the purpose of this guideline, the Ontario Drinking Water Objective of 10 mg/L of nitrate is the maximum allowable concentration detectable in the groundwater prior to the property line.

A detailed impact assessment is required due to the proposed zoning of the site. In order to demonstrate that private services would adequately support the proposed Re-zoning Application, a predictive nitrate impact assessment for the subject site was completed. This calculation was completed to determine the maximum sewage flow volume which could be applied to the subject site with the current site conditions and without the use of tertiary treatment systems (nitrate reducing systems). Furthermore, to support the Site Plan Control Application, a maximum TDDSSF of 10,000 L/day will be examined to determine the nitrate concentration at the property boundary. The values shown in the Predictive Nitrate Impact Assessment calculation attached to this report are summarized below:

<input type="checkbox"/> Site area	11.68 ha
<input type="checkbox"/> Impervious area (%)	7 %
<input type="checkbox"/> Concentration of nitrate in effluent (Value based on typical effluent concentration)	40 mg/L
<input type="checkbox"/> Surplus Water (The surplus water value was estimated based on Environment Canada Climate Office values with a soil type comprised of a mixture between clay loam (Urban Lawns), fine sandy loam (Mature Forest) and anthropogenic sources.)	329 mm/yr



❑ Combined infiltration factor based on:	0.45
• Topography infiltration factor	0.10
• Soil texture infiltration factor	0.20
• Cover infiltration factor	0.15

The topography infiltration factor of 0.10 is based upon a hilly land with an average slope of 28 to 47 m/km. The soil texture infiltration factor was based upon “medium combinations of clay and loam” with a value of 0.2 which is a reasonable generalization based upon the site investigations and available geological mapping. The “cover infiltration factor” was calculated at 0.15 based upon the mix of tree cover and cultivated land.

The predicted nitrate concentration calculation for a conventional sewage system (system without nitrate reduction) results in a maximum of **14.16 m³/day** of an effluent using a nitrate concentration of 40 mg/L. This maximum is significantly more than the proposed maximum daily usage of 10 m³/d. Therefore, using a conventional sewage system, the maximum TDDSSF of 10,000 L/day (10 m³/d) is less than the maximum volumes that the site can support.

Based on the results of the predicted nitrate impact assessment, it is our opinion that the property can adequately support the proposed re-zoning and development without having an adverse impact on the underlying bedrock aquifer.



CONCLUSIONS

Based on the information contained within the body of this report the following conclusions can be drawn:

1. The water supply aquifer intercepted by the existing well is considered to be adequate to support the water quantity demands for the proposed building usage.
2. Based on a visual inspection performed by Paterson personnel of TW1, the well casing, stickup, and well cap are in compliance with O.Reg 903. The final grading around the well will be sufficiently graded to direct surface water away from the wellhead at the time of the new sewage system installation. The water supply well should be protected from traffic.
3. The preferred water supply intercepted by TW1 contains a water supply that is potable, and contains only elevated concentrations of hardness, TDS, total sulphides, and iron. The noted parameters can be treated with current readily available water conditioning equipment. A water treatment specialist has been retained by the owner to provide treatment for the building water supply.
4. Colour, turbidity, and aluminum were measured to be elevated in initial laboratory testing. A resample was completed at a later date. The field testing of the re-sample showed 0 TCU for colour and 0.56 NTU for turbidity. Laboratory testing for aluminum was under the operational guideline at the resample. These values represent typical usage of TW1.
5. If desired by the property owner, a residential grade water softener can be used to facilitate the reduction of the hardness concentration and reduce scaling. If a water softener is used for the proposed development, the owner should be made aware that additional sodium will be added to the water to reduce hardness. If desired, a point-of-use reverse osmosis system can be used to provide a drinking tap source without increasing sodium levels.
6. The sodium concentration was measured to be above the 20 mg/L reporting limit and, as such, the Medical Officer of Health for the City of Ottawa should be informed to assist area physicians in the treatment of local residents on sodium reduced diets. It should be noted that some water treatment equipment may further increase the sodium concentration.
7. A water treatment specialist has been retained by the owner and a water treatment system has been proposed. The water treatment system to be used by the proposed development can be found attached. The treatment system is proposed to treat the aesthetic exceedances.



8. The predicted nitrate concentrations at the property boundary is calculated to be below the required 10 mg/L threshold when a conventional treatment system is used for greater than 10,000 L/day.
9. A Sewage System Permit and Building Permit need to be issued prior to the commencement of construction.
10. The results of the Hydrogeological Assessment and Terrain Analysis have provided satisfactory evidence that the subject site can support the proposed Re-Zoning Application and Site Plan Control Application with respect to water quality, quantity and sewage system effluent (>10k L/day) attenuation within the property boundary.

We trust that the current submission satisfies your immediate requirements.

Best Regards,

Paterson Group Inc.

Alexander Schopf, PhD, EIT

Michael S. Killam, P.Eng.

Attachments:

- ☐ Key Plan
- ☐ MECP Water Well Records
- ☐ Eurofins Certificate of Analysis
- ☐ AQTESOLV - Pumping Test Analysis Reports
- ☐ Nitrate Impact Assessment Calculations
- ☐ Langelier Saturation Index (LSI) Calculation
- ☐ PV Plumbing & Water Inc. Water Treatment Quote.





FIGURE 1

KEY PLAN



Measurements recorded in: ☐ Metric ☒ Imperial

Page of

Well Owner's Information

First Name	Last Name/Organization	E-mail Address	<input type="checkbox"/> Well Constructed by Well Owner
	1818 Bradley Side Road Inc (Ken Hoppner)		

Mailing Address (Street Number/Name)	Municipality	Province	Postal Code	Telephone No. (inc. area code)
1818 Bradley Side Road	Carp	On	K0A 1L0	

Well Location

Address of Well Location (Street Number/Name)	Township	Lot	Concession
1818 Bradley Side Road	West Carleton	P/L 6	1

County/District/Municipality	City/Town/Village	Province	Postal Code
Ottawa Carleton	Corn	Ontario	

UTM Coordinates	Zone	Easting	Northing	Municipal Plan and Sublot Number	Other
NAD 83	18	425440	5017793	4R-1805	Part 1

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m) From To
	Gravel	or Boulders	& Hard Pan.	0' 60'
Grey & Black	Limestone	(Soft)		60' 390'
Grey & Black	Limestone	(Soft)		390' 400'

Annular Space

Depth Set at (m) ⁽¹⁾ From	To	Type of Sealant Used (Material and Type)	Volume Placed (m ³) ⁽²⁾
66'	56'	Neat cement	10.92
56'	0'	Bentonite slurry	21

Method of Construction

<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole	<input type="checkbox"/> Monitoring
<input checked="" type="checkbox"/> Spring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning	
<input checked="" type="checkbox"/> Percussion		<input type="checkbox"/> Industrial		
Other, specify <u>Suited</u>		<input type="checkbox"/> Other, specify		

Construction Record - Casing

Inside Diameter (mm)	Open Hole OR Material (Galvanized, Fiberglass, Concrete, Plastic, Steel)	Wall Thickness (mm)	Depth (m)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned,
			From	To	
6 1/4"	Steel	.188"	+2'	66'	
6"	Open Hole		66'	400'	

Construction Record - Screen

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (mm/in)	
			From	To

☐ pH
☐ Water Quality
☐ Abandoned, other, specify _____
☐ Other, specify _____

Water Details

Water found at Depth 390 (mft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Other, specify _____
Water found at Depth _____ (mft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify _____
Water found at Depth _____ (mft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify _____

Hole Diameter

Depth (m)		Diameter (cm)
From	To	
0'	66'	9 3/4"
66'	400'	6"

Well Contractor and Well Technician Information

Business Name of Well Contractor Air Rock Drilling Co. Ltd.	Well Contractor's Licence No. C7681
Business Address (Street Number/Name) 6659 Frankdown Road	Municipality Richmond

Province ON	Postal Code K0A 2Z0	Business E-mail Address air-rock@sympatico.ca
----------------	------------------------	--

Bus. Telephone No. (inc. area code)	Name of Well Technician (Last Name, First Name)
6138382170	Hanna, Jeremy

Well Technician's Licence No. T3632	Signature of Technician and/or Contractor 	Date Submitted 03 31 2022
-------------------------------------	---	---------------------------

Results of Well Yield Testing

After test of well yield, water was:		Draw Down		Recovery	
<input type="checkbox"/> Clear and sand free	<input checked="" type="checkbox"/> Other, specify <u>Not tested</u>	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason: <u>X</u>		Static Level	14'5"		112'
		1	17.6	1	104
Pump intake set at (m/ft) <u>300</u>		2	21	2	102
Pumping rate (l/min/GPM) <u>4</u>		3	24	3	100
Duration of pumping <u>1</u> hrs + <u>0</u> min		4	26.9	4	98
Final water level end of pumping (m/ft) <u>112'</u>		5	29.7	5	95.9
If flowing give rate (l/min/GPM) <u>X</u>		10	41.8	10	86.1
Recommended pump depth (m/ft) <u>380'</u>		15	52	15	77.4
Recommended pump rate (l/min/GPM) <u>5</u>		20	61.1	20	69.5
Well production (l/min/GPM) <u>4</u>		25	69.3	25	65.3
Disintegrated? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		30	76.7	30	62.7
		40	90	40	58.2
		50	101	50	55.4
		60	112'	60	53.4'

Map of Well Location

Please provide a map below following instructions on the back.

#1818
BRADLEY
SIDE
ROAD

Huntmar
Drive

0.2 km

0.2 km


Comments:
1 HP 5 GPM SET AT 380 FEET

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered Y <u>2022</u> M <u>03</u> D <u>16</u>	Ministry Use Only Audit No. <u>Z379220</u>
	2022 Work Completed 16 Y Y Y Y M M D D	Received

UTM 18Z 425455E
5R 5017205IN
Elev. 4R 0355



31652

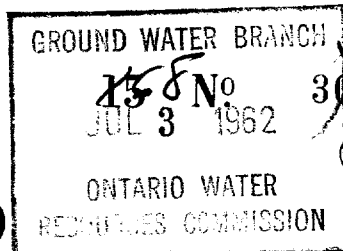

The Ontario Water Resources Commission Act

WATER WELL RECORD

Basin 25
County or District CARLETON
Con. 1 County Rd #31 Lot ALV 1/2 E 5'

Township, Village, Town or City Huntley
Date completed 30th June 1962
(day month year)
Address Corp. Snt.

Casing and Screen Record

Inside diameter of casing 6 1/4"
Total length of casing 71'
Type of screen
Length of screen
Depth to top of screen
Diameter of finished hole 5' 3/4

Pumping Test

Static level 30'
Test-pumping rate 15' G.P.M.
Pumping level 75'
Duration of test pumping 45' min.
Water clear or cloudy at end of test clear
Recommended pumping rate 5' G.P.M.
with pump setting of 95' feet below ground surface

Well Log

Overburden and Bedrock Record

clay
gravel
sand & gravel
quartz sand.
limestone
sandstone

From
ft.

To
ft.

0	15'
15'	30
30	40
40	55'
55'	105'
105'	125'

Depth(s) at
which water(s)
found

Kind of water
(fresh, salty,
sulphur)

100

fresh.

For what purpose(s) is the water to be used?

house

Is well on upland, in valley, or on hillside? upland

Drilling or Boring Firm Melville M. Laughlin

Address Ashton Snt.

Licence Number 593

Name of Driller or Borer Melville M. Laughlin


Address Ashton Snt.

Date June 30 1962

Melville M. Laughlin
(Signature of Licensed Drilling or Boring Contractor)

Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

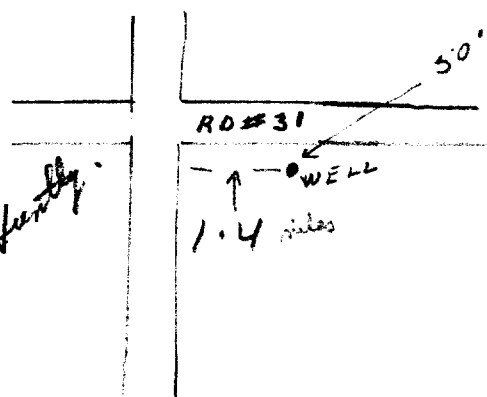

UTM ²¹⁵ 18 2 425 460 E
5R 5017460 N



31 G 5 d

GROUND WATER BRANCH
No. 3028
DEC 7 1962
ONTARIO WATER
RESOURCES COMMISSION

Elev. 4R 8345

The Ontario Water Resources Commission Act

WATER WELL RECORD

Basin 25 Carleton
County or District

Con. I Lot 5E 1/2 6

Township, Village, Town or City Huntley
Date completed 7th November 1962
(day month year)

Address Corp. Ont.

Casing and Screen Record

Inside diameter of casing 6 1/4"
Total length of casing 74'
Type of screen
Length of screen
Depth to top of screen
Diameter of finished hole 6"

Pumping Test

Static level 24'
Test-pumping rate 10 G.P.M.
Pumping level 40'
Duration of test pumping 30 min
Water clear or cloudy at end of test clear
Recommended pumping rate 5' G.P.M.
with pump setting of 100' feet below ground surface

Well Log

Overburden and Bedrock Record

clay & boulders
gravel
gumbo sand
limestone rock

From
ft.

To
ft.

Depth(s) at
which water(s)
found

Kind of water
(fresh, salty,
sulphur)

0 20
20 40
40 58
58 120

98 fresh

For what purpose(s) is the water to be used?

farm

Is well on upland, in valley, or on hillside? upland

Drilling or Boring Firm Mel M. Laughlin

Address Ashton Ont

Licence Number 593

Name of Driller or Borer Melville M. Laughlin


Address Ashton Ont

Date November 7, 1962

Melville M. Laughlin
(Signature of Licensed Drilling or Boring Contractor)

Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

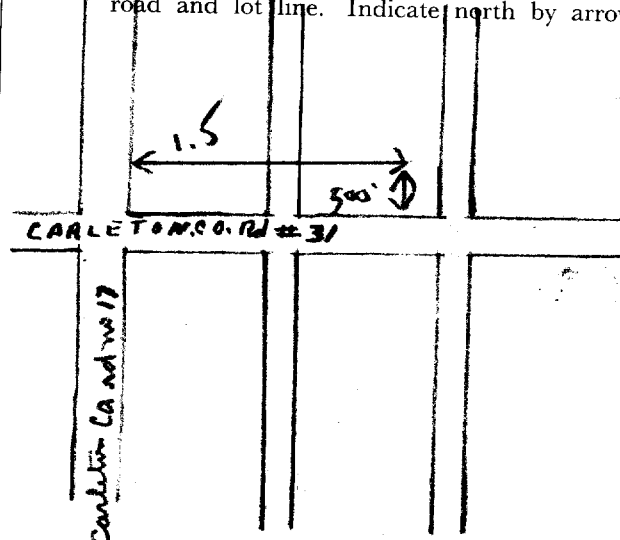



31^G/₅₀

11 11514699

MUNICIP. 15005 CON. CEN 01

COUNTY OR DISTRICT	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE	CON., BLOCK, TRACT, SURVEY, ETC.	LOT
Carleton Place	West Carleton Huron	1	006
DATE COMPLETED			48-53
DAY 02			NO 05
R. # 3 Carp, Ontario			YR. 75
ING	RC.	ELEVATION	RC.
1514699	18	425353	5017358
4	360	4	26
JUL 08, 1977			301

[illegible]

31	00156281279	00452141379	00642281379	008021585	0094 1585		
32							

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
41		WATER RECORD																												
WATER FOUND AT - FEET										KIND OF WATER																				
10-13										14																				
0093										1																				
										2																				
15-18										19																				
										1																				
										2																				
20-23										24																				
										1																				
										2																				
25-28										29																				
										1																				
										2																				
30-33										34																				
										1																				
										2																				

CASING & OPEN HOLE RECORD				
INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
10-11	1 <input checked="" type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE	188	0	0066
17-18	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE			0080
24-25	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE			0094

SCREEN	SIZE(S) OF OPENING (SLOT NO.)	31-33	DIAMETER	34-38	LENGTH	39-41
			INCHES		FEET	
	MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN		41-44	FEET

61		PLUGGING & SEALING RECORD	
DEPTH SET AT - FEET		MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.)	
FROM	TO		
10-13	14-17		
18-21	22-25		
26-29	30-33	80	

PUMPING TEST	PUMPING TEST METHOD		10	PUMPING RATE		11-14	DURATION OF PUMPING		
	1 <input type="checkbox"/> PUMP 2 <input checked="" type="checkbox"/> BAILER			0006		GPM.	02	15-16 HOURS 00 17-18 MINS.	
	STATIC LEVEL	WATER LEVEL END OF PUMPING	25		WATER LEVELS DURING				
	19-21	22-24	15 MINUTES	26-28	30 MINUTES	29-31	45 MINUTES	32-34	60 MINUTES
	060 FEET	060 FEET	060 FEET	060 FEET	060 FEET	060 FEET	060 FEET	060 FEET	
IF FLOWING, GIVE RATE.		38-41	PUMP INTAKE SET AT			WATER AT END OF TEST			
		GPM.				FEET			
RECOMMENDED PUMP TYPE			RECOMMENDED PUMP SETTING		43-45	RECOMMENDED PUMPING RATE		46-49	
<input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP			080 FEET			0005		GPM.	
50-53		GPM. / FT. SPECIFIC CAPACITY							

<p>FINAL STATUS OF WELL</p>	<p>54</p> <p>1 <input checked="" type="checkbox"/> WATER SUPPLY</p> <p>2 <input type="checkbox"/> OBSERVATION WELL</p> <p>3 <input type="checkbox"/> TEST HOLE</p> <p>4 <input type="checkbox"/> RECHARGE WELL</p>	<p>5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY</p> <p>6 <input type="checkbox"/> ABANDONED, POOR QUALITY</p> <p>7 <input type="checkbox"/> UNFINISHED</p>
<p>WATER USE</p>	<p>55-56</p> <p>1 <input checked="" type="checkbox"/> DOMESTIC</p> <p>2 <input type="checkbox"/> STOCK</p> <p>3 <input type="checkbox"/> IRRIGATION</p> <p>4 <input type="checkbox"/> INDUSTRIAL</p> <p><input type="checkbox"/> OTHER</p>	<p>5 <input type="checkbox"/> COMMERCIAL</p> <p>6 <input type="checkbox"/> MUNICIPAL</p> <p>7 <input type="checkbox"/> PUBLIC SUPPLY</p> <p>8 <input type="checkbox"/> COOLING OR AIR CONDITIONING</p> <p>9 <input type="checkbox"/> NOT USED</p>
<p>METHOD OF DRILLING</p>	<p>57</p> <p>1 <input checked="" type="checkbox"/> CABLE TOOL</p> <p>2 <input type="checkbox"/> ROTARY (CONVENTIONAL)</p> <p>3 <input type="checkbox"/> ROTARY (REVERSE)</p> <p>4 <input type="checkbox"/> ROTARY (AIR)</p> <p>5 <input checked="" type="checkbox"/> AIR PERCUSSION</p>	<p>6 <input type="checkbox"/> BORING</p> <p>7 <input type="checkbox"/> DIAMOND</p> <p>8 <input type="checkbox"/> JETTING</p> <p>9 <input type="checkbox"/> DRIVING</p>

LOCATION OF WELL 2517

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE. INDICATE NORTH BY ARROW.

RICHARDSON SIDE RD.

300'

BARN

.55 mile

N

HUNTLEY CON 2

DRILLERS REMARKS:

CONTRACTOR	NAME OF WELL CONTRACTOR	LICENCE NUMBER
	Capital Water Supply Ltd.	1558
	ADDRESS	
	Box 490 Stittsville, Ontario	
	NAME OF DRILLER OR BORER	LICENCE NUMBER
	M. Hamilton	
	SIGNATURE OF CONTRACTOR	SUBMISSION DATE
	<i>Walter Kavanagh</i>	DAY 8 MO. 5 YR. 75

OFFICE USE ONLY	DATA SOURCE	58	CONTRACTOR	59-62	DATE RECD	63-68
	1		1558		05 06 75	
	DATE OF INSPECTION		INSPECTOR			
	9 Apr 74		P/R. Dough			
	REMARKS					P
	CSS.58					WI



WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED
2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

11

1516888

MUNICIP

15.006

CON.

C6N

01

COUNTY OR DISTRICT

Carleton Place

TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE

March

CON., BLOCK, TRACT, SURVEY, ETC.

1

LOT

006

DATE COMPLETED

DAY 22 MO 12 YR 78

17680

4

0325

4

26

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	Hardpan	Boulders		0	10
Brown	Clay			10	25
Blue	Clay			25	29
Grey	Granite			29	90
Grey	Granite			90	130
White + green granite			med hard	130	175
grey granite			very hard	175	200

001061413 0025605 0029305 0130221 017512173 02002219073

WATER RECORD	
WATER FOUND AT - FEET	KIND OF WATER
0125	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

CASING & OPEN HOLE RECORD			
INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET
6 1/4	1 <input checked="" type="checkbox"/> STEEL	188	0 0030
06	2 <input type="checkbox"/> GALVANIZED		
06	3 <input type="checkbox"/> CONCRETE		
5 7/8	4 <input checked="" type="checkbox"/> OPEN HOLE		30 0090
06	1 <input type="checkbox"/> STEEL		
5 7/8	2 <input type="checkbox"/> GALVANIZED		
	3 <input type="checkbox"/> CONCRETE		
	4 <input checked="" type="checkbox"/> OPEN HOLE		90 0200

SCREEN	SIZE(S) OF OPENING (SLOT NO 1)	DIAMETER	LENGTH

PLUGGING & SEALING RECORD	
DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER, ETC.)
10-13	14-17
18-21	22-25
26-29	30-33


PUMPING TEST METHOD		PUMPING RATE	DURATION OF PUMPING
1 <input checked="" type="checkbox"/> PUMP 2 <input type="checkbox"/> BAILER	0003 2 1/2	01 15-16 00 17-18	
STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING	1 <input checked="" type="checkbox"/> PUMPING 2 <input type="checkbox"/> RECOVERY
012	175	175 175 175 175	
IF FLOWING, GIVE RATE	PUMP INTAKE SET AT	WATER AT END OF TEST	
RECOMMENDED PUMP TYPE	RECOMMENDED PUMP SETTING	RECOMMENDED PUMPING RATE	
<input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP	0190	0002	

LOCATION OF WELL	
IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE. INDICATE NORTH BY ARROW.	
DRILLERS REMARKS:	

FINAL STATUS OF WELL	1 <input checked="" type="checkbox"/> WATER SUPPLY 5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY 2 <input type="checkbox"/> OBSERVATION WELL 6 <input type="checkbox"/> ABANDONED, POOR QUALITY 3 <input type="checkbox"/> TEST HOLE 7 <input type="checkbox"/> UNFINISHED 4 <input type="checkbox"/> RECHARGE WELL
WATER USE	1 <input type="checkbox"/> DOMESTIC 5 <input type="checkbox"/> COMMERCIAL 2 <input checked="" type="checkbox"/> STOCK 6 <input type="checkbox"/> MUNICIPAL 3 <input type="checkbox"/> IRRIGATION 7 <input type="checkbox"/> PUBLIC SUPPLY 4 <input type="checkbox"/> INDUSTRIAL 8 <input type="checkbox"/> COOLING OR AIR CONDITIONING 9 <input type="checkbox"/> NOT USED
METHOD OF DRILLING	1 <input checked="" type="checkbox"/> CABLE TOOL 6 <input type="checkbox"/> BORING 2 <input type="checkbox"/> ROTARY (CONVENTIONAL) 7 <input type="checkbox"/> DIAMOND 3 <input type="checkbox"/> ROTARY (REVERSE) 8 <input type="checkbox"/> JETTING 4 <input type="checkbox"/> ROTARY (AIR) 9 <input type="checkbox"/> DRIVING 5 <input checked="" type="checkbox"/> AIR PERCUSSION

CONTRACTOR	NAME OF WELL CONTRACTOR CAPITAL WATER SUPPLY LTD 1558 ADDRESS Box 490 STITTVILLE ONTARIO NAME OF DRILLER OR BORER S Miller - J Moore SIGNATURE OF CONTRACTOR H Koeneck	LICENCE NUMBER 1558 LICENCE NUMBER
SUBMISSION DATE DAY 22 MO 12 YR 78		

OFFICE USE ONLY	DATA SOURCE 1 DATE OF INSPECTION 22/05/79 REMARKS K L	CONTRACTOR 1558 DATE RECEIVED 220179
-----------------	--	---



The Ontario Water Resources Act

WATER WELL RECORD

1526023

MUNICIP.
15005

CON.
CON

101

1. PRINT ONLY IN SPACES PROVIDED

2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

11

COUNTY OR DISTRICT	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE	CON. BLOCK, TRACT, SURVEY ETC	LOT
Ottawa Carleton	West Carleton	1	6
OWNER (SURNAME FIRST)	ADDRESS	DATE COMPLETED	
Jacques Whitford Ltd.	C-20 2285 St. Laurent Blvd. Ottawa, Ontario	DAY 21 MO 10 YR. 91	

21 ZONE EASTING **K46** RC ELEVATION RC BASIN CODE I III IV

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

[illegible]

31

32

41 WATER RECORD

WATER FOUND AT - FEET		KIND OF WATER		
10-13 243	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	14	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS		
15-18	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	19	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS		
20-23	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	24	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS		
25-28	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	29	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS		
30-33	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	34	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS		

51 CASING & OPEN HOLE RECORD

INSIDE DIAM INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4 ¹⁰⁻³¹	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input checked="" type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC	.188 ¹²	0	34 ¹³⁻¹⁶
6 1/16 ¹⁷⁻¹⁸	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input checked="" type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC		34	200 ²⁰⁻²³
6 ²⁴⁻²⁵	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input checked="" type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC		200	300 ²⁷⁻³⁰

61 PLUGGING & SEALING RECORD

DEPTH SET AT - FEET		MATERIAL AND TYPE	
FROM	TO	(CEMENT GROUT LEAD PACKER, ETC.)	
10-13	14-17	Cement	(
Grouted			
18-21	22-25		
26-29	30-33	80	

PUMPING TEST	PUMPING TEST METHOD		10	PUMPING RATE		11-14	DURATION OF PUMPING	
	1 <input checked="" type="checkbox"/> PUMP 2 <input type="checkbox"/> BAILER			2.5		GPM	1 15-16 HOURS 17-18 MINS	
	STATIC LEVEL	WATER LEVEL END OF PUMPING	25 WATER LEVELS DURING				1 <input checked="" type="checkbox"/> PUMPING 2 <input type="checkbox"/> RECOVERY	
	19-21	22-24	15 MINUTES	30 MINUTES	45 MINUTES	60 MINUTES		
	25 FEET	200 FEET	26-28 200 FEET	29-31 200 FEET	32-34 200 FEET	35-37 200 FEET		
IF FLOWING, GIVE RATE		38-41	PUMP INTAKE SET AT		WATER AT END OF TEST			42
		GPM	FEET		1 <input type="checkbox"/> CLEAR 2 <input type="checkbox"/> CLOUDY			
RECOMMENDED PUMP TYPE		RECOMMENDED PUMP SETTING		43-45	RECOMMENDED PUMPING RATE		46-49	
<input type="checkbox"/> SHALLOW <input type="checkbox"/> DEEP		225 FEET			2.5		GPM	

LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE INDICATE NORTH BY ARROW.

Bradley Side Rd

Oak Creek Rd

Thunderbird
club

x test well
*!
Pitless

Richardson Side Rd

100188

<p>FINAL STATUS OF WELL</p>	<p>34</p> <p>1 <input checked="" type="checkbox"/> WATER SUPPLY 2 <input type="checkbox"/> OBSERVATION WELL 3 <input type="checkbox"/> TEST HOLE 4 <input type="checkbox"/> RECHARGE WELL</p>	<p>5 <input checked="" type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY 6 <input type="checkbox"/> ABANDONED POOR QUALITY 7 <input type="checkbox"/> UNFINISHED <input type="checkbox"/> DEWATERING</p>
<p>WATER USE</p>	<p>55-56</p> <p>1 <input checked="" type="checkbox"/> DOMESTIC 2 <input type="checkbox"/> STOCK 3 <input type="checkbox"/> IRRIGATION 4 <input type="checkbox"/> INDUSTRIAL <input type="checkbox"/> OTHER</p>	<p>5 <input type="checkbox"/> COMMERCIAL 6 <input type="checkbox"/> MUNICIPAL 7 <input type="checkbox"/> PUBLIC SUPPLY 8 <input type="checkbox"/> COOLING OR AIR CONDITIONING 9 <input type="checkbox"/> NOT USED</p>
<p>METHOD OF CONSTRUCTION</p>	<p>57</p> <p>1 <input type="checkbox"/> CABLE TOOL 2 <input type="checkbox"/> ROTARY (CONVENTIONAL) 3 <input type="checkbox"/> ROTARY (REVERSE) 4 <input type="checkbox"/> ROTARY (AIR) 5 <input checked="" type="checkbox"/> AIR PERCUSSION</p>	<p>6 <input type="checkbox"/> BORING 7 <input type="checkbox"/> DIAMOND 8 <input type="checkbox"/> JETTING 9 <input type="checkbox"/> DRIVING <input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER</p>

CONTRACTOR	NAME OF WELL CONTRACTOR		WELL CONTRACTOR'S LICENCE NUMBER	
	Capital Water Supply Ltd.		1558	
	ADDRESS			
	Box 490 Stittsville, Ontario K2S 1A6			
CONTRACTOR	NAME OF WELL TECHNICIAN		WELL TECHNICIAN'S LICENCE NUMBER	
	S. Miller		T0096	
	SIGNATURE OF TECHNICIAN/CONTRACTOR		SUBMISSION DATE	
	[Signature]		DAY 25 MO. 10 YR 91	

OFFICE USE ONLY	DATA SOURCE	58 CONTRACTOR	59-62 DATE RECEIVED	63-68
		1558	JAN 13 1992	
	DATE OF INSPECTION	INSPECTOR		
	REMARKS			

CSSIED

FD-302a (Rev. 5-22-64)

MINISTRY OF THE ENVIRONMENT COPY

FORM NO. 0506 (11/86) FORM 9



The Ontario Water Resources Act

1526122

MUNICIP.
15005

CON.
|CON

101

1. PRINT ONLY IN SPACES PROVIDED

2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

11

21 ZONE EASTING KLG 426 RC. ELEVATION RC. BASIN CODE II III IV

100-25 OVERBURNED AND REDBROCK MATERIALS

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

31

32

41 WATER RECORD

51 CASING & OPEN HOLE RECORD

SCREEN	SIZE: 1 OF OPENING		DIAMETER		LENGTH	
	SLOT NO 1					
			INCHES		FEET	
	MATERIAL AND TYPE			DEPTH TO TOP OF SCREEN		
				FEET		

PLUGGING & SEALING RECORD

DLPTH SET AT - FEET		MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER, ETC.)	
FROM	TO		
10-13	14-17		
18-21	22-25		
26-29	30-33	80	

71	PUMPING TEST METHOD		10	PUMPING RATE		11-14	DURATION OF PUMPING	
	1 <input checked="" type="checkbox"/> PUMP	2 <input checked="" type="checkbox"/> BAILER		20		GPM	1	15-16 HOURS 17-18 MINS
	STATIC LEVEL		WATER LEVEL END OF PUMPING		25 WATER LEVELS DURING		1 <input checked="" type="checkbox"/> PUMPING 2 <input type="checkbox"/> RECOVERY	
	10-21	22-24	15 MINUTES	30 MINUTES	45 MINUTES	60 MINUTES		
	18 FEET	45 FEET	20-20 45 FEET	20-31 45 FEET	32-34 45 FEET	35-37 45 FEET		
	IF FLOWING, GIVE RATE		30-01	PUMP INTAKE SET AT		WATER AT END OF TEST		42
		GPM	45 FEET		1 <input checked="" type="checkbox"/> CLEAR 2 <input type="checkbox"/> CLOUDY			
RECOMMENDED PUMP TYPE			RECOMMENDED PUMP SETTING		43-45	RECOMMENDED PUMPING RATE		
<input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP			100 FEET			46-49 5 GPM		
50-53								

LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE INDICATE NORTH BY ARROW.

Hand-drawn map showing the location of the Thunderbird Golf Course. A vertical line on the left is labeled "Oak Creek Rd". A horizontal line at the top is labeled "Bradley Side Rd". A dashed line extends from the intersection of these two roads, with an arrow pointing down and the number "65'" written next to it. At the end of this dashed line is an "X" mark, with the text "Thunderbird Golf Course" written below it.

DRILLERS REMARKS

113303

<p>FINAL STATUS OF WELL</p>	<p>54</p> <p>1 <input checked="" type="checkbox"/> WATER SUPPLY</p> <p>2 <input type="checkbox"/> OBSERVATION WELL</p> <p>3 <input type="checkbox"/> TEST HOLE</p> <p>4 <input type="checkbox"/> RECHARGE WELL</p>	<p>5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY</p> <p>6 <input type="checkbox"/> ABANDONED POOR QUALITY</p> <p>7 <input type="checkbox"/> UNFINISHED</p> <p><input type="checkbox"/> DEWATERING</p>
<p>WATER USE</p>	<p>55-56</p> <p>1 <input checked="" type="checkbox"/> DOMESTIC</p> <p>2 <input type="checkbox"/> STOCK</p> <p>3 <input checked="" type="checkbox"/> IRRIGATION</p> <p>4 <input type="checkbox"/> INDUSTRIAL</p> <p><input type="checkbox"/> OTHER</p>	<p>5 <input type="checkbox"/> COMMERCIAL</p> <p>6 <input type="checkbox"/> MUNICIPAL</p> <p>7 <input type="checkbox"/> PUBLIC SUPPLY</p> <p>8 <input type="checkbox"/> COOLING OR AIR CONDITIONING</p> <p>9 <input type="checkbox"/> NOT USED</p>
<p>METHOD OF CONSTRUCTION</p>	<p>57</p> <p>1 <input checked="" type="checkbox"/> CABLE TOOL 175-205</p> <p>2 <input type="checkbox"/> ROTARY (CONVENTIONAL)</p> <p>3 <input type="checkbox"/> ROTARY (REVERSE)</p> <p>4 <input type="checkbox"/> ROTARY (AIR)</p> <p>5 <input checked="" type="checkbox"/> AIR PERCUSSION 0-175</p>	<p>6 <input type="checkbox"/> BORING</p> <p>7 <input type="checkbox"/> DIAMOND</p> <p>8 <input type="checkbox"/> JETTING</p> <p>9 <input type="checkbox"/> DRIVING</p> <p><input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER</p>

CONTRACTOR	NAME OF WELL CONTRACTOR		WELL CONTRACTOR'S LICENCE NUMBER	
	Capital Water Supply Ltd.		1558	
	ADDRESS			
	Box 490 Stittsville, Ontario K2S 1A6			
CONTRACTOR	NAME OF WELL TECHNICIAN		WELL TECHNICIAN'S LICENCE NUMBER	
	S. Miller/ J. Moore		T0097/T0096	
	SIGNATURE OF TECHNICIAN/CONTRACTOR		SUBMISSION DATE	
	[Signature]		DAY 28 MO 11 YR 91	

OFFICE USE ONLY	DATA SOURCE	58	CONTRACTOR	58-62	DATE RECEIVED	63-68	80
			1558		APR 30 1992		
	DATE OF INSPECTION			INSPECTOR			
REMARKS							
<div style="text-align: right;">CSG. E</div>							

MINISTRY OF THE ENVIRONMENT COPY

FORM NO. 0506 (11/86) FORM 9



The Ontario Water Resources Act

WATER WELL RECORD

1527008

MUNICIP
15005

CON.
|CON

101

1. PRINT ONLY IN SPACES PROVIDED
2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

ii

COUNTY OR DISTRICT		TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE		CON. BLOCK, TRACT, SURVEY ETC.		LOT	
Ottawa Carleton		West Carleton - Huntley		1		6	
OWNER (SURNAME FIRST)		ADDRESS		DATE COMPLETED		48-53	
[REDACTED]		c/o Thunderbird Golf & Athletic Club Carp, Ontario		14 MO 01		93	
21		KOA 1L)					

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

[illegible][illegible]

41	WATER RECORD			
WATER FOUND AT - FEET	KIND OF WATER			
10-13	1 <input type="checkbox"/> FRESH 2 <input type="checkbox"/> SALTY	3 <input type="checkbox"/> SULPHUR 4 <input type="checkbox"/> MINERALS 5 <input type="checkbox"/> GAS	14	
54	1 <input type="checkbox"/> FRESH 2 <input type="checkbox"/> SALTY	3 <input type="checkbox"/> SULPHUR 4 <input type="checkbox"/> MINERALS 5 <input type="checkbox"/> GAS	19	
15-18	1 <input type="checkbox"/> FRESH 2 <input type="checkbox"/> SALTY	3 <input type="checkbox"/> SULPHUR 4 <input type="checkbox"/> MINERALS 5 <input type="checkbox"/> GAS	24	
66	NOT TESTED			
20-23	1 <input type="checkbox"/> FRESH 2 <input type="checkbox"/> SALTY	3 <input type="checkbox"/> SULPHUR 4 <input type="checkbox"/> MINERALS 5 <input type="checkbox"/> GAS	29	
25-28	1 <input type="checkbox"/> FRESH 2 <input type="checkbox"/> SALTY	3 <input type="checkbox"/> SULPHUR 4 <input type="checkbox"/> MINERALS 5 <input type="checkbox"/> GAS	34	
30-33	1 <input type="checkbox"/> FRESH 2 <input type="checkbox"/> SALTY	3 <input type="checkbox"/> SULPHUR 4 <input type="checkbox"/> MINERALS 5 <input type="checkbox"/> GAS		

CASING & OPEN HOLE RECORD				
INSIDE DIAM INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	<input checked="" type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC	.188	0	40
6 1/8	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input checked="" type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC		40	90
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			

SCREEN	54	65	75	80		
	SIZE OF OPENING (SLOT NO.)	31-33	DIAMETER	34-38	LENGTH	39-43
	INCHES			FEET		
MATERIAL AND TYPE			DEPTH TO TOP OF SCREEN		41-44	50
					FEET	

61		PLUGGING & SEALING RECORD	
DEPTH SET AT - FEET		MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER, ETC.)	
FROM	TO		
10-13 40	14-17 2	Grouted Cement (7)	
18-21	22-25		
26-29	30-33	80	

PUMPING TEST	PUMPING TEST METHOD		PUMPING RATE		DURATION OF PUMPING	
	1 <input type="checkbox"/> PUMP 2 <input checked="" type="checkbox"/> BAILER		5 GPM		1 15-16 HOURS 17-18 MINS	
	STATIC LEVEL		WATER LEVELS DURING		1 <input checked="" type="checkbox"/> PUMPING 2 <input type="checkbox"/> RECOVERY	
	19-21 22-24		15 MINUTES 26-28 30 MINUTES 29-31 45 MINUTES 32-34 60 MINUTES 35-37			
	20 FEET 70 FEET		55 FEET 70 FEET		70 FEET 70 FEET	
IF FLOWING, GIVE RATE		PUMP INTAKE SET AT		WATER AT END OF TEST		
38-41 GPM		FEET		1 <input type="checkbox"/> CLEAR 2 <input checked="" type="checkbox"/> CLOUDY		
RECOMMENDED PUMP TYPE		RECOMMENDED PUMP SETTING		RECOMMENDED PUMPING RATE		
<input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP		80 FEET		46-49 5 GPM		
50-53						

<p>FINAL STATUS OF WELL</p>	<p>54</p> <p>1 <input checked="" type="checkbox"/> WATER SUPPLY</p> <p>2 <input type="checkbox"/> OBSERVATION WELL</p> <p>3 <input type="checkbox"/> TEST HOLE</p> <p>4 <input type="checkbox"/> RECHARGE WELL</p>	<p>5 <input type="checkbox"/> ABANDONED INSUFFICIENT SUPPLY</p> <p>6 <input type="checkbox"/> ABANDONED POOR QUALITY</p> <p>7 <input type="checkbox"/> UNFINISHED</p> <p><input type="checkbox"/> DEWATERING</p>
<p>WATER USE</p>	<p>55-56</p> <p>1 <input checked="" type="checkbox"/> DOMESTIC</p> <p>2 <input type="checkbox"/> STOCK</p> <p>3 <input type="checkbox"/> IRRIGATION</p> <p>4 <input type="checkbox"/> INDUSTRIAL</p> <p><input type="checkbox"/> OTHER</p>	<p>5 <input type="checkbox"/> COMMERCIAL</p> <p>6 <input type="checkbox"/> MUNICIPAL</p> <p>7 <input type="checkbox"/> PUBLIC SUPPLY</p> <p>8 <input type="checkbox"/> COOLING OR AIR CONDITIONING</p> <p>9 <input type="checkbox"/> NOT USED</p>
<p>METHOD OF CONSTRUCTION</p>	<p>57</p> <p>1 <input checked="" type="checkbox"/> CABLE TOOL</p> <p>2 <input type="checkbox"/> ROTARY (CONVENTIONAL)</p> <p>3 <input type="checkbox"/> ROTARY (REVERSE)</p> <p>4 <input type="checkbox"/> ROTARY (AIR)</p> <p>5 <input type="checkbox"/> AIR PERCUSSION</p>	<p>6 <input type="checkbox"/> BORING</p> <p>7 <input type="checkbox"/> DIAMOND</p> <p>8 <input type="checkbox"/> JETTING</p> <p>9 <input type="checkbox"/> DRIVING</p> <p><input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER</p>

LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE INDICATE NORTH BY ARROW.

House * 1943

40'


19' 6"

x

Richardson Side Rd

130012

DRILLERS REMARKS:

CONTRACTOR	NAME OF WELL CONTRACTOR		WELL CONTRACTOR'S LICENCE NUMBER	
	Capital Water Supply Ltd.		1550	
	ADDRESS			
	Box 490 Stittsville, Ontario K2S 1A6		WELL TECHNICIAN'S LICENCE NUMBER	
	J. Moore		T0096	
	SIGNATURE OF TECHNICIAN / CONTRACTOR		SUBMISSION DATE	
			DAY 20 MO 01 YR 93	

OFFICE USE ONLY	DATA SOURCE	58	CONTRACTOR	59-62	DATE RECEIVED	63-68	80
	1558		MAR 04 1993				
	DATE OF INSPECTION		INSPECTOR				
REMARKS							

A 054566

A 054566

Instructions for Completing Form

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10th of a metre.
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

First Name	Last Name	Mailing Address (Street Number/Name, RR, Lot, Concession)	
	TRINITY PRESBYTERIAN CHURCH	110 MCCURDY DR.	
County/District/Municipality	Township/City/Town/Village	Province	Postal Code
OTTAWA CARELTON	OTTAWA	Ontario	K2L2Z6
Address of Well Location (County/District/Municipality)		Township	Lot PT
OTTAWA CARELTON		WEST CARELTON	6
RR#/Street Number/Name		City/Town/Village	Concession
1817 RICHARDSON SIDE RD.		OTTAWA	1
GPS Reading	NAD	Zone	Easting
	83	18	425510
		Northing	Unit Make/Model
		5017649	MAGELLAN
Mode of Operation:		<input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged	
		<input type="checkbox"/> Differentiated, specify	

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth From	Metres To
BROWN	SAND	CLAY, STONES, BOULDERS		0	2.43
GREY	CLAY	SAND, STONES, BOULDERS		2.43	15.84
GREY	LIMESTONE	BROWN LIMESTONE		15.84	46.63

Hole Diameter			Construction Record				Test of Well Yield					
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down Time min	Water Level Metres	Recovery Time min	Water Level Metres
0	16.91	24.77						SUB. PUMP				
16.91	46.63	15.23						Pump intake set at (metres) 43.5	Static Level	0		
			15.87	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass		0	1.52	Pumping rate - (litres/min) 36.4	1	2.04	1	16.91
				<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete				Duration of pumping 1 hrs + 0 min	2	3.96	2	15.94
				<input type="checkbox"/> Galvanized				Final water level end of pumping 18.47 metres	3	5.27	3	14.96
				<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass				Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	4	6.33	4	14.08
				<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete				Recommended pump depth 43.5 metres	5	7.31	5	13.16
				<input type="checkbox"/> Galvanized				Recommended pump rate 36.4 (litres/min)	10	10.82	10	9.02
								If flowing give rate - (litres/min) /	15	12.58	15	6.46
								If pumping discontinued, give reason.	20	14.38	20	5.51
									25	16.0	25	3.56
									30	17.03	30	2.62
									40	18.44	40	1.57
									50	18.47	50	1.03
									60	18.47	60	0.88

Plugging and Sealing Record			<input checked="" type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)	
0	16.91	BENTONITE SLURRY	1.15	
Method of Construction				
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging	
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other	
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving		
Water Use				
<input type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input checked="" type="checkbox"/> Public Supply	<input type="checkbox"/> Other	
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used		
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning		
Final Status of Well				
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)	
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering		
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well		

Well Contractor/Technician Information	
Name of Well Contractor	Well Contractor's Licence No.
T. SAUNDERS DRILLING LTD	4879
Business Address (street name, number, city etc.)	
RR#1 BRASIDE ONT.	K0A 1G0
Name of Well Technician (last name, first name)	Well Technician's Licence No.
SAUNDERS TROY	T-517
Signature of Technician/Contractor	Date Submitted
X Troy Saunders	07/01/19

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No.	Date Well Completed
Z 44855	06/12/19
Was the well owner's information package delivered?	Date Delivered
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	06/12/19

Ministry Use Only	
Data Source	Contractor
	4879
Date Received	Date of Inspection
FEB 21 2007	
Remarks	Well Record Number

OFFICIAL CERTIFICATE OF ANALYSIS : 3966666
WORK REQUEST : 100292480
Report Date : 2024-07-03
Paterson Group

9 Auriga Dr
Nepean, Ontario
K2E 7T9
Attention : Alex Schopf

Reception Date : 2024-06-26
Project : PM15625
Sampler : NA
PO Number : 60535
Temperature : 6 °C

Analysis	Quantity	External Method
Alkalinity (Water, Automated)	2	Modified from SM 2320 B
Ammonia, Total (Water, Colorimetry)	2	Modified from EPA 350.1
Chloride (Water, IC)	2	Modified from SM 4110 B and C
Colour, Apparent (Water, Spectrophotometry)	2	Modified from SM 2120 C
Conductivity (Water, Automated)	2	Modified from SM 2510 B
DOC (Water, IR)	2	Modified from SM 5310 B
Escherichia coli (DC Plate)	2	Modified from MECP E3407
Fluoride (Water, Auto/ISE)	2	Modified from SM 4500-F A and 4500-F C
Hardness (Water, Calculation Only)	2	SM 2340 B
Ion Balance (Water, Calculation)	2	Modified from SM1030 E
Metals Scan (Water, ICP/MS)	2	Modified from EPA 200.8
Metals Scan (Water, ICP/OES)	2	Modified from SM 3120 B
Nitrate (Water, IC)	2	Modified from SM 4110 B and C
Nitrite (Water, IC)	2	Modified from SM 4110 B and C
pH (25°C) (Water, Automated)	2	Modified from SM 4500-H+ B
Phenols (Water, Colorimetry)	2	Modified from EPA 420.2
Sulphate (Water, IC)	2	Modified from SM 4110 B and C
Sulphide (Water, Colorimetry)	2	Modified from SM 4500-S2 D
Tannin and Lignin (Water, Spec)	2	Modified from SM 5550 B
TDS (Estimated)	2	Modified from SM 2510 A
Total Coliforms (DC Plate)	2	Modified from MECP E3407
Total Kjeldahl Nitrogen (Water, Colorimetry)	2	Modified from EPA 351.2
Turbidity (Water, Turbidimeter)	2	Modified from SM 2130 B
VOCs (Water, GC/MS)	2	Modified from EPA 8260

Criteria :

A : Ontario Regulation 169/03 (Non-Regulated Drinking Water)

Sample status upon receipt :

7802343 7802344

Compliant

Certificate Comments :

7802344

Anions MRL increase due to matrix interference. B spike not available due to high native analyte concentration in the mother sample. B results were verified for this sample. DOC analyzed from plastic sample bottle.

7802343

Anions MRLs increased due to matrix interferences. B spike not available due to high native analyte concentration in the mother sample. B results were verified for this sample.

Notes :

- All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise stated.

- Eurofins Environment Testing Canada Inc. is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at <https://directory.cala.ca/>
- Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline or regulatory limits listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official guideline or regulation as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Legend :

RL : Reporting limit

N/A : Not applicable

* : Analysis conducted by external subcontracting

QC : Reference material (QC)

1 : Results in annex

^ : Analysis not accredited

OFFICIAL CERTIFICATE OF ANALYSIS - EXCEEDENCE SUMMARY

Client : Paterson Group

Project : PM15625

Reception Date : 2024-06-26

Eurofins Sample No	Client Sample Identification	Analyte	Result	Units	Exceeded Criteria		
					A	B	C
Colour, Apparent (Water, Spectrophotometry)							
7802343	TW1 - GW1	Colour (Apparent)	10	TCU	5		
7802344	TW1 - GW2	Colour (Apparent)	10	TCU	5		
Hardness (Water, Calculation Only)							
7802343	TW1 - GW1	Hardness as CaCO3 (Calculation)	356	mg/L	80-100		
7802344	TW1 - GW2	Hardness as CaCO3 (Calculation)	360	mg/L	80-100		
Metals Scan (Water, ICP/MS)							
7802343	TW1 - GW1	Aluminum	0.43	mg/L	0.1		
7802344	TW1 - GW2	Aluminum	0.34	mg/L	0.1		
7802343	TW1 - GW1	Iron	0.68	mg/L	0.3		
7802344	TW1 - GW2	Iron	0.44	mg/L	0.3		
Sulphide (Water, Colorimetry)							
7802343	TW1 - GW1	Sulphide (S2-)	0.95	mg/L	0.05		
7802344	TW1 - GW2	Sulphide (S2-)	1.16	mg/L	0.05		
TDS (Estimated)							
7802343	TW1 - GW1	TDS (Estimated)^a	944	mg/L	500		
7802344	TW1 - GW2	TDS (Estimated)^a	959	mg/L	500		
Turbidity (Water, Turbidimeter)							
7802343	TW1 - GW1	Turbidity	11.5	NTU	5		
7802344	TW1 - GW2	Turbidity	7.10	NTU	5		

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Eurofins Sample No :				7802343	7802344			
Matrix :				Drinking water	Drinking water			
Sampling Date :				2024-06-25	2024-06-25			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
Anions	RL	Unit	Criteria					
			A	B	C			
Chloride	0.5	mg/L	250			84.9	86.4	
Nitrate (as Nitrogen)	0.1	mg/L	10.0			<0.5	<0.5	
Nitrite (as Nitrogen)	0.1	mg/L	1.0			<0.5	<0.5	
Sulphate	1	mg/L	500			388	394	

Eurofins Sample No :				7802343	7802344			
Matrix :				Drinking water	Drinking water			
Sampling Date :				2024-06-25	2024-06-25			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
Calculations	RL	Unit						
			A	B	C			
Ion Balance (Calculation)^	0.1		1.01	1.02				

Eurofins Sample No :				7802343	7802344			
Matrix :				Drinking water	Drinking water			
Sampling Date :				2024-06-25	2024-06-25			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
General Chemistry	RL	Unit	Criteria					
			A	B	C			
Alkalinity (as CaCO ₃)	5	mg/L	500			225	225	
Colour (Apparent)	2	TCU	5			10	10	
Conductivity @ 25°C	5	µS/cm				1350	1370	
Dissolved Organic Carbon	0.5	mg/L	5			1.3	1.0	
Fluoride	0.1	mg/L	1.5			1.32	1.34	
Hardness as CaCO ₃ (Calculation)	1	mg/L	80-100			356	360	
pH @ 25°C	1		6.5-8.5			7.97	8.04	
Phenols-4AAP	0.001	mg/L				<0.001	<0.001	
Sulphide (S ₂ -)	0.01	mg/L	0.05			0.95	1.16	
Tannin and Lignin	0.1	mg/L				0.2	0.3	
TDS (Estimated)^	5	mg/L	500			944	959	
Turbidity	0.1	NTU	5			11.5	7.10	

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Eurofins Sample No :						7802343	7802344			
Matrix :						Drinking water	Drinking water			
Sampling Date :						2024-06-25	2024-06-25			
Client Sample Identification :						TW1 - GW1	TW1 - GW2			
Metals	RL	Unit	Criteria							
			A	B	C					
Metals Scan (Water, ICP/MS)										
Aluminum	0.01	mg/L	0.1			0.43	0.34			
Antimony	0.0005	mg/L	0.006			<0.0005	<0.0005			
Arsenic	0.001	mg/L	0.01			<0.001	<0.001			
Barium	0.001	mg/L	1			0.191	0.190			
Beryllium	0.0005	mg/L				<0.0005	<0.0005			
Boron	0.01	mg/L	5			0.43	0.44			
Cadmium	0.0001	mg/L	0.005			<0.0001	<0.0001			
Chromium	0.001	mg/L	0.05			0.001	<0.001			
Cobalt	0.0002	mg/L				0.0002	<0.0002			
Copper	0.001	mg/L	1			<0.001	<0.001			
Iron	0.03	mg/L	0.3			0.68	0.44			
Lead	0.001	mg/L	0.01			<0.001	<0.001			
Manganese	0.01	mg/L	0.05			0.02	0.02			
Mercury	0.0001	mg/L	0.001			<0.0001	<0.0001			
Molybdenum	0.005	mg/L				<0.005	<0.005			
Nickel	0.005	mg/L				<0.005	<0.005			
Selenium	0.001	mg/L	0.05			<0.001	<0.001			
Silver	0.0001	mg/L				<0.0001	<0.0001			
Strontium	0.001	mg/L				2.64	2.72			
Thallium	0.0001	mg/L				<0.0001	<0.0001			
Uranium	0.001	mg/L	0.02			<0.001	<0.001			
Vanadium	0.001	mg/L				0.001	<0.001			
Zinc	0.01	mg/L	5			<0.01	<0.01			
Metals Scan (Water, ICP/OES)										
Calcium	1	mg/L				74	75			
Magnesium	1	mg/L				42	42			
Potassium	1	mg/L				6	6			
Sodium	1	mg/L	200			181	186			
Eurofins Sample No :						7802343	7802344			
Matrix :						Drinking water	Drinking water			
Sampling Date :						2024-06-25	2024-06-25			
Client Sample Identification :						TW1 - GW1	TW1 - GW2			
Microbiology	RL	Unit	Criteria							
			A	B	C					
Escherichia coli (DC)	0	CFU/100mL	0			0	0			
Total Coliforms (DC)	0	CFU/100mL	0			0	0			

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Eurofins Sample No :			7802343	7802344				
Matrix :			Drinking water	Drinking water				
Sampling Date :			2024-06-25	2024-06-25				
Client Sample Identification :			TW1 - GW1	TW1 - GW2				
Nutrients	RL	Unit						
Ammonia (Total, as Nitrogen)	0.02	mg/L	0.259	0.263				
Total Kjeldahl Nitrogen	0.1	mg/L	1.46	0.483				

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26


Eurofins Sample No :				7802343	7802344			
Matrix :				Drinking water	Drinking water			
Sampling Date :				2024-06-25	2024-06-25			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
Volatile Organic Compounds	RL	Unit	Criteria					
			A	B	C			
VOCs (Water, GC/MS)								
1,1,1,2-Tetrachloroethane	0.5	ug/L				<0.5	<0.5	
1,1,1-Trichloroethane	0.4	ug/L				<0.4	<0.4	
1,1,2,2-Tetrachloroethane	0.5	ug/L				<0.5	<0.5	
1,1,2-Trichloroethane	0.4	ug/L				<0.4	<0.4	
1,1-Dichloroethane	0.4	ug/L				<0.4	<0.4	
1,1-Dichloroethene	0.4	ug/L	14			<0.4	<0.4	
1,2-Dibromoethane	0.2	ug/L				<0.2	<0.2	
1,2-Dichlorobenzene	0.4	ug/L	200			<0.4	<0.4	
1,2-Dichloroethane	0.2	ug/L	5			<0.2	<0.2	
1,2-Dichloropropane	0.5	ug/L				<0.5	<0.5	
1,3,5-Trimethylbenzene	0.3	ug/L				<0.3	<0.3	
1,3-Dichlorobenzene	0.4	ug/L				<0.4	<0.4	
1,4-Dichlorobenzene	0.4	ug/L	5			<0.4	<0.4	
Acetone	5	ug/L				<5.0	<5.0	
Benzene	0.5	ug/L	1			<0.5	<0.5	
Bromodichloromethane	0.3	ug/L				<0.3	<0.3	
Bromoform	0.4	ug/L				<0.4	<0.4	
Bromomethane	0.5	ug/L				<0.5	<0.5	
Carbon tetrachloride	0.2	ug/L	2			<0.2	<0.2	
Chloroethane	0.2	ug/L				<0.2	<0.2	
Chloroform	0.5	ug/L				<0.5	<0.5	
Chloromethane	0.2	ug/L				<0.2	<0.2	
cis-1,2-Dichloroethene	0.4	ug/L				<0.4	<0.4	
cis-1,3-Dichloropropene	0.2	ug/L				<0.2	<0.2	
Dibromochloromethane	0.3	ug/L				<0.3	<0.3	
Dichloromethane	4	ug/L	50			<4.0	<4.0	
Diethyl ether	5	ug/L				<5	<5	
Ethylbenzene	0.5	ug/L	140			<0.5	<0.5	
m/p-Xylene	0.4	ug/L				<0.4	<0.4	
Methyl ethyl ketone (MEK)	2	ug/L				<2.0	<2.0	
Methyl isobutyl ketone (MIBK)	5	ug/L				<5.0	<5.0	
Methyl tert-butyl ether (MTBE)	2	ug/L				<2	<2	
Monochlorobenzene	0.5	ug/L	80			<0.5	<0.5	
o-Xylene	0.4	ug/L				<0.4	<0.4	
Styrene	0.5	ug/L				<0.5	<0.5	
Tetrachloroethylene (PCE)	0.3	ug/L	10			<0.3	<0.3	
Toluene	0.4	ug/L	60			<0.4	<0.4	
trans-1,2-dichloroethene	0.4	ug/L				<0.4	<0.4	
trans-1,3-dichloropropene	0.2	ug/L				<0.2	<0.2	
Trichloroethylene (TCE)	0.3	ug/L	5			<0.3	<0.3	
Trichlorofluoromethane	0.5	ug/L				<0.5	<0.5	

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Eurofins Sample No :				7802343	7802344			
Matrix :				Drinking water	Drinking water			
Sampling Date :				2024-06-25	2024-06-25			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
Volatile Organic Compounds	RL	Unit	Criteria					
			A	B	C			
Vinyl chloride	0.2	ug/L	1			<0.2	<0.2	
Xylene (Total)	0.5	ug/L	90			<0.5	<0.5	
1,2-dichloroethane-d4 (surrogate)	0	%				122	109	
4-bromofluorobenzene (surrogate)	0	%				71	72	
Toluene-d8 (surrogate)	0	%				110	113	

Approved by : 
Emma-Dawn Ferguson, M.Sc.
Environmental Chemist

Approved by : 
Jason Kennedy,
Project Manager

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Alkalinity (Water, Automated)									
Method : Alkalinity (water, titration to pH 4.5, automated). Internal method: OTT-I-AT-WI45398.									
Alkalinity (as CaCO3)	mg/L	5	<5	100	95-105			-	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-28 Analysis Date: 2024-07-02	
Ammonia, Total (Water, Colorimetry)									
Method : Ammonia (Water, Colorimetry). Internal method: OTT-I-NUT-WI46201.									
Ammonia (Total, as Nitrogen)	mg/L	0.02	<0.020	104	80-120	112	80-120	3	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-27	
Chloride (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Chloride	mg/L	0.5	<0.5	96	80-120	101	80-120	-	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	
Colour, Apparent (Water, Spectrophotometry)									
Method : Colour (Water, Spectrophotometric). Internal method: OTT-I-SPEC-WI45980.									
Colour (Apparent)	TCU	2	<2	110	39-159			2	0-40
Associated Samples : 7802343, 7802344								Prep Date: 2024-07-03 Analysis Date: 2024-07-03	
Conductivity (Water, Automated)									
Method : Conductivity (Water, Autotitrator). Internal Method: OTT-I-AT-WI45398.									
Conductivity @ 25°C	uS/cm	5	<5	98	98-102			2	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-28 Analysis Date: 2024-07-02	
DOC (Water, IR)									
Method : Organic carbon (water, IR, combustion). Internal method: OTT-I-DEM-WI46148.									
Dissolved Organic Carbon	mg/L	0.5	<0.5	89	84-116	99	80-120	-	0-15
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-28 Analysis Date: 2024-07-02	
Escherichia coli (DC Plate)									
Method : Total Coliforms and E.Coli by MF (Water, DC plate). Internal method: OTT-M-BAC-WI45296.									
Escherichia coli (DC)	CFU/100mL	0	0					-	0-30
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-26 Analysis Date: 2024-06-27	
Fluoride (Water, Auto/ISE)									
Method : Fluoride by autotitrator, ion selective electrode. Internal method: OTT-I-AT-WI45398.									
Fluoride	mg/L	0.1	<0.10	100	90-110				
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-28 Analysis Date: 2024-07-02	

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Metals Scan (Water, ICP/MS)									
Method : Metals (Water, ICP/MS). Internal method: AMMTFQE1.									
Aluminum	mg/L	0.01	<0.01	100	80-120	-	70-130	-	0-20
Antimony	mg/L	0.0005	<0.0005	89	80-120	95	70-130	-	0-20
Arsenic	mg/L	0.001	<0.001	100	80-120	100	70-130	-	0-20
Barium	mg/L	0.001	<0.001	100	80-120	-	70-130	-	0-20
Beryllium	mg/L	0.0005	<0.0005	112	80-120	113	70-130	-	0-20
Boron	mg/L	0.01	<0.01	110	80-120	119	70-130	-	0-20
Cadmium	mg/L	0.0001	<0.0001	103	80-120	-	70-130	-	0-20
Chromium	mg/L	0.001	<0.001	110	80-120	-	70-130	-	0-20
Cobalt	mg/L	0.0002	<0.0002	105	80-120	-	70-130	-	0-20
Copper	mg/L	0.001	<0.001	110	80-120	-	70-130	-	0-20
Iron	mg/L	0.03	<0.03	90	80-120	101	70-130	-	0-20
Lead	mg/L	0.001	<0.001	100	80-120	-	70-130	-	0-20
Manganese	mg/L	0.01	<0.01	100	80-120	-	70-130	-	0-20
Mercury	mg/L	0.0001	<0.0001	110	80-120	-	70-130	-	0-20
Molybdenum	mg/L	0.005	<0.005	100	80-120	95	70-130	-	0-20
Nickel	mg/L	0.005	<0.005	110	80-120	-	70-130	-	0-20
Selenium	mg/L	0.001	<0.001	105	80-120	114	70-130	-	0-20
Silver	mg/L	0.0001	<0.0001	113	80-120	-	70-130	-	0-20
Strontium	mg/L	0.001	<0.001	100	80-120	-	70-130	-	0-20
Thallium	mg/L	0.0001	<0.0001	99	80-120	-	70-130	-	0-20
Uranium	mg/L	0.001	<0.001	90	80-120	90	70-130	-	0-20
Vanadium	mg/L	0.001	<0.001	100	80-120	-	70-130	-	0-20
Zinc	mg/L	0.01	<0.01	110	80-120	-	70-130	-	0-20
Associated Samples : 7802343								Prep Date: 2024-07-02 Analysis Date: 2024-07-03	
Method : Metals (Water, ICP/MS). Internal method: AMMTFQE1.									
Aluminum	mg/L	0.01	<0.01	100	80-120	117	70-130	8	0-20
Antimony	mg/L	0.0005	<0.0005	89	80-120	-	70-130	-	0-20
Arsenic	mg/L	0.001	<0.001	100	80-120	104	70-130	-	0-20
Barium	mg/L	0.001	<0.001	100	80-120	83	70-130	1	0-20
Beryllium	mg/L	0.0005	<0.0005	112	80-120	-	70-130	-	0-20
Boron	mg/L	0.01	<0.01	110	80-120			1	0-20
Cadmium	mg/L	0.0001	<0.0001	103	80-120	-	70-130	-	0-20
Chromium	mg/L	0.001	<0.001	110	80-120	99	70-130	-	0-20
Cobalt	mg/L	0.0002	<0.0002	105	80-120	103	70-130	-	0-20
Copper	mg/L	0.001	<0.001	110	80-120	93	70-130	-	0-20
Iron	mg/L	0.03	<0.03	90	80-120	100	70-130	4	0-20
Lead	mg/L	0.001	<0.001	100	80-120	89	70-130	-	0-20
Manganese	mg/L	0.01	<0.01	100	80-120	103	70-130	-	0-20
Mercury	mg/L	0.0001	<0.0001	110	80-120	103	70-130	-	0-20
Molybdenum	mg/L	0.005	<0.005	100	80-120	109	70-130	-	0-20
Nickel	mg/L	0.005	<0.005	110	80-120	101	70-130	-	0-20
Selenium	mg/L	0.001	<0.001	105	80-120	-	70-130	-	0-20
Silver	mg/L	0.0001	<0.0001	113	80-120	-	70-130	-	0-20
Strontium	mg/L	0.001	<0.001	100	80-120	73	70-130	1	0-20
Thallium	mg/L	0.0001	<0.0001	99	80-120	-	70-130	-	0-20
Uranium	mg/L	0.001	<0.001	90	80-120	94	70-130	-	0-20

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Metals Scan (Water, ICP/MS)									
Method : Metals (Water, ICP/MS). Internal method: AMMTFQE1.									
Vanadium	mg/L	0.001	<0.001	100	80-120	100	70-130	-	0-20
Zinc	mg/L	0.01	<0.01	110	80-120	-	70-130	-	0-20
Associated Samples : 7802344								Prep Date: 2024-07-02 Analysis Date: 2024-07-03	
Metals Scan (Water, ICP/OES)									
Method : Metals (Water, ICP/OES). Internal method: OTT-I-MET-WI48491.									
Calcium	mg/L	1	<1	107	86-115	100	70-130	0	0-20
Magnesium	mg/L	1	<1	105	91-109	104	70-130	0	0-20
Potassium	mg/L	1	<1	106	87-113	116	70-130	-	0-20
Sodium	mg/L	1	<1	104	85-115	108	70-130	0	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-07-02 Analysis Date: 2024-06-26	
Nitrate (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Nitrate (as Nitrogen)	mg/L	0.1	<0.1	97	80-120	101	80-120		
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	
Nitrite (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Nitrite (as Nitrogen)	mg/L	0.1	<0.1	93	80-120	100	80-120		
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	
pH (25°C) (Water, Automated)									
Method : pH (Water, Automated Meter). Internal method: OTT-I-AT-WI45398.									
pH @ 25°C		1	5.78	100	97-103			0	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-28 Analysis Date: 2024-07-02	
Phenols (Water, Colorimetry)									
Method : Phenols (Water, Colorimetry). Internal method: OTT-I-4AAP-WI46150.									
Phenols-4AAP	mg/L	0.001	<0.001	114	75-125	111	70-130	-	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-28 Analysis Date: 2024-07-02	
Sulphate (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Sulphate	mg/L	1	<1	95	90-110	95	80-120		
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	
Sulphide (Water, Colorimetry)									
Method : Sulphide, S2- (Water, Colorimetry). Internal method: OTT-I-SPEC-WI45931.									
Sulphide (S2-)	mg/L	0.01	<0.01	96	80-120			-	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-07-02 Analysis Date: 2024-07-02	
Tannin and Lignin (Water, Spec)									
Method : Tannin and Lignin (Water, Spec), Internal method: OTT-I-SPEC-WI57693.									
Tannin and Lignin	mg/L	0.1	<0.1	96	80-120			-	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Total Coliforms (DC Plate)									
Method : Total Coliforms and E.Coli by MF (Water, DC plate). Internal method: OTT-M-BAC-WI45296.									
Total Coliforms (DC)	CFU/100mL	0	0					-	0-30
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-26 Analysis Date: 2024-06-27	
Total Kjeldahl Nitrogen (Water, Colorimetry)									
Method : TKN (Water, colorimetry). Internal method: OTT-I-NUT-WI46201.									
Total Kjeldahl Nitrogen	mg/L	0.1	<0.100	95	70-130	102	70-130	1	0-20
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	
Turbidity (Water, Turbidimeter)									
Method : Turbidity (Water, Turbidimeter). Internal method: OTT-I-TUR-WI46288.									
Turbidity	NTU	0.1	<0.1	100	80-120			2	0-30
Associated Samples : 7802343, 7802344								Prep Date: 2024-06-27 Analysis Date: 2024-06-28	

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-06-26

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
VOCs (Water, GC/MS)									
Method : Volatile Organic Compounds (Water, GC/MS). Internal method: AMVOMSE8.									
1,1,1,2-Tetrachloroethane	ug/L	0.5	<0.5	109	70-130	91	70-130	-	0-30
1,1,1-Trichloroethane	ug/L	0.4	<0.4	92	70-130	114	70-130	-	0-30
1,1,2,2-Tetrachloroethane	ug/L	0.5	<0.5	119	70-130	86	70-130	-	0-30
1,1,2-Trichloroethane	ug/L	0.4	<0.4	118	70-130	104	70-130	-	0-30
1,1-Dichloroethane	ug/L	0.4	<0.4	97	70-130	110	70-130	-	0-30
1,1-Dichloroethene	ug/L	0.4	<0.4	99	70-130	113	70-130	-	0-30
1,2-Dibromoethane	ug/L	0.2	<0.2	96	70-130	108	70-130	-	0-30
1,2-Dichlorobenzene	ug/L	0.4	<0.4	111	70-130	87	70-130	-	0-30
1,2-Dichloroethane	ug/L	0.2	<0.2	106	70-130	100	70-130	-	0-30
1,2-Dichloropropane	ug/L	0.5	<0.5	100	70-130	94	70-130	-	0-30
1,3,5-Trimethylbenzene	ug/L	0.3	<0.3	111	70-130	103	70-130	-	0-30
1,3-Dichlorobenzene	ug/L	0.4	<0.4	110	70-130	104	70-130	-	0-30
1,4-Dichlorobenzene	ug/L	0.4	<0.4	110	70-130	107	70-130	-	0-30
Acetone	ug/L	5	<5.0	74	70-130	114	70-130	-	0-30
Benzene	ug/L	0.5	<0.5	97	70-130	107	70-130	-	0-30
Bromodichloromethane	ug/L	0.3	<0.3	96	70-130	106	70-130	-	0-30
Bromoform	ug/L	0.4	<0.4	96	70-130	106	70-130	-	0-30
Bromomethane	ug/L	0.5	<0.5	104	70-130	83	70-130	-	0-30
Carbon tetrachloride	ug/L	0.2	<0.2	97	70-130	105	70-130	-	0-30
Chloroethane	ug/L	0.2	<0.2	100	70-130	97	70-130	-	0-30
Chloroform	ug/L	0.5	<0.5	83	70-130	91	70-130	-	0-30
Chloromethane	ug/L	0.2	<0.2	83	70-130	91	70-130	-	0-30
cis-1,2-Dichloroethene	ug/L	0.4	<0.4	97	70-130	105	70-130	-	0-30
cis-1,3-Dichloropropene	ug/L	0.2	<0.2	79	70-130	119	70-130	-	0-30
Dibromochloromethane	ug/L	0.3	<0.3	95	70-130	100	70-130	-	0-30
Dichloromethane	ug/L	4	<4.0	90	70-130	91	70-130	-	0-30
Diethyl ether	ug/L	5	<5	100	70-130	100	70-130	-	0-30
Ethylbenzene	ug/L	0.5	<0.5	117	70-130	117	70-130	-	0-30
m/p-Xylene	ug/L	0.4	<0.4	94	70-130	98	70-130	-	0-30
Methyl ethyl ketone (MEK)	ug/L	2	<2.0	74	70-130	93	70-130	-	0-30
Methyl isobutyl ketone (MIBK)	ug/L	5	<5.0	90	70-130	119	70-130	-	0-30
Methyl tert-butyl ether (MTBE)	ug/L	2	<2	90	70-130	90	70-130	-	0-30
Monochlorobenzene	ug/L	0.5	<0.5	104	70-130	100	70-130	-	0-30
o-Xylene	ug/L	0.4	<0.4	117	70-130	96	70-130	-	0-30
Styrene	ug/L	0.5	<0.5	107	70-130	100	70-130	-	0-30
Tetrachloroethylene (PCE)	ug/L	0.3	<0.3	95	70-130	112	70-130	-	0-30
Toluene	ug/L	0.4	<0.4	109	70-130	92	70-130	-	0-30
trans-1,2-dichloroethene	ug/L	0.4	<0.4	90	70-130	104	70-130	-	0-30
trans-1,3-dichloropropene	ug/L	0.2	<0.2	83	70-130	113	70-130	-	0-30
Trichloroethylene (TCE)	ug/L	0.3	<0.3	102	70-130	104	70-130	-	0-30
Trichlorofluoromethane	ug/L	0.5	<0.5	97	70-130	117	70-130	-	0-30
Vinyl chloride	ug/L	0.2	<0.2	83	70-130	117	70-130	-	0-30
Xylene (Total)	ug/L	0.5	<0.5				-		-
Associated Samples : 7802343, 7802344									
								Prep Date: 2024-07-02 Analysis Date: 2024-07-03	

Where RPD % is reported as "-" the calculation is not available because one or both of the duplicates is within 5 times the RL.

CLIENT INFORMATION				INVOICE INFO															
Company:	Paterson Group			Company:															
Contact:	Alex Schopf			Contact:															
Address:	9 Auriga Drive			Address:															
Telephone:	613-218-3444	Cell:		Telephone:															
Email:	#1: eardley@patersongroup.ca, mlaflamme@patersongroup.ca			PO #: 60535															
Email:	#2: aschopf@patersongroup.ca;																		
Project:	PM15625	Quote #:																	
TURN-AROUND TIME (Business Days)				REGULATION/GUIDELINE REQUIRED															
<input type="checkbox"/> 1 Day* (100%) <input type="checkbox"/> 2 Day** (50%) <input type="checkbox"/> 3-5 Days (25%) <input checked="" type="checkbox"/> 5-7 Days (Standard)				<input type="checkbox"/> Sanitary Sewer, City: Ottawa															
Please contact Lab in advance to determine rush availability.				<input type="checkbox"/> Storm Sewer, City: Ottawa															
*For results reported after rush due date, surcharges will apply: before 12:00 - 100%, after 12:00 - 50%.				<input checked="" type="checkbox"/> ODWSOG															
**For results reported after rush due date, surcharges will apply: before 12:00 - 50%, after 12:00 - 25%.				<input type="checkbox"/> PWQO															
				<input type="checkbox"/> O. Reg 347/558															
				<input type="checkbox"/> Other: _____															
				<input type="checkbox"/> None															
The optimal temperature conditions during transport should be less than 10°C. Sample(s) cannot be frozen, unless otherwise indicated or agreed upon with the Laboratory. Note that this COC is not to be used for drinking water samples. The COC must be complete upon submission of the samples, there will be a \$25 surcharge if required information is missing (required fields are shaded in grey).				Sample Analysis Required										RN# (Lab Use Only)					
				Sample Details		O.Reg.153 parameters													
Field Filtered →		Sample Matrix	# of Containers	PHC F1 - F4	BTEX	VOCs	PAHs	PCBs	Metals + Inorganics	Metals only	See attached paper	Subdivision Supply Batch 2 (E2/TC only)	TSS	pH	Total Metals	Hg			
Sample ID	Date/Time Collected																		
TW1-GW1	June 25, 2024	GW	10	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TW1-GW2	June 25, 2024	GW	10	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PRINT		SIGN		DATE/TIME		TEMP (°C)		COMMENTS:											
Sampled By:	Alex Schopf			June 25, 2024		6.2		Total and Trace Metals											
Relinquished By:	Alex Schopf			June 26, 2024															
Received By:								CUSTODY SEAL: <input type="checkbox"/> YES <input type="checkbox"/> NO Ice packs submitted: <input type="checkbox"/> Yes <input type="checkbox"/> No											

OFFICIAL CERTIFICATE OF ANALYSIS : 3991228**WORK REQUEST : 100298583****Report Date : 2024-07-22****Paterson Group**

9 Auriga Dr

Nepean, Ontario

K2E 7T9

Attention : Alex Schopf

Reception Date : 2024-07-19

Project : PM15625

Sampler : NA

PO Number : 60753

Temperature : 14 °C

Analysis	Quantity	External Method
Colour, Apparent (Water, Spectrophotometry)	1	Modified from SM 2120 C
Turbidity (Water, Turbidimeter)	1	Modified from SM 2130 B

Criteria :**A :** Ontario Regulation 169/03 (Non-Regulated Drinking Water)**Sample status upon receipt :**

7872590

Compliant**Notes :**

- All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise stated.
- Eurofins Environment Testing Canada Inc. is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at <https://directory.cala.ca/>
- Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline or regulatory limits listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official guideline or regulation as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Legend :

RL : Reporting limit

QC : Reference material (QC)

N/A : Not applicable

1 : Results in annex

* : Analysis conducted by external subcontracting

^ : Analysis not accredited

OFFICIAL CERTIFICATE OF ANALYSIS - EXCEEDENCE SUMMARY

Client : Paterson Group

Project : PM15625

Reception Date : 2024-07-19

Eurofins Sample No	Client Sample Identification	Analyte	Result	Units	Exceeded Criteria		
					A	B	C
Colour, Apparent (Water, Spectrophotometry)							
7872590	TW1 - GW - 3	Colour (Apparent)	12	TCU	5		

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-07-19

			Eurofins Sample No : 7872590						
			Matrix : Groundwater						
			Sampling Date : 2024-07-19						
			Client Sample Identification : TW1 - GW - 3						
General Chemistry			Criteria						
	RL	Unit	A	B	C				
Colour (Apparent)	2	TCU	5			12			
Turbidity	0.1	NTU	5			3.29			

Approved by : 
Emma-Dawn Ferguson, M.Sc.
Environmental Chemist

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-07-19

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Colour, Apparent (Water, Spectrophotometry)									
Method : Colour (Water, Spectrophotometric). Internal method: OTT-I-SPEC-WI45980.									
Colour (Apparent)	TCU	2	<2	102	39-159			-	0-40
Associated Samples : 7872590								Prep Date: 2024-07-22 Analysis Date: 2024-07-22	
Turbidity (Water, Turbidimeter)									
Method : Turbidity (Water, Turbidimeter). Internal method: OTT-I-TUR-WI46288.									
Turbidity	NTU	0.1	<0.1	102	80-120			2	0-30
Associated Samples : 7872590								Prep Date: 2024-07-20 Analysis Date: 2024-07-20	

Where RPD % is reported as "-" the calculation is not available because one or both of the duplicates is within 5 times the RL.

CLIENT INFORMATION

Company:	Paterson Group		
Contact:	Alex Schopf		
Address:	9 Auriga Drive		
Telephone:	613-218-3444	Cell:	
Email:	#1: leardley@patersongroup.ca, mkillam@patersongroup.ca		
Email:	#2: aschopf@patersongroup.ca;		
Project:	PM15625	Quote #:	

INVOICE INFORMATION

Company:	
Contact:	
Address:	
Telephone:	

100298583



Printed On : 2024-07-19 17:13:38

PO #: 60753

IN: YES ☒ NO ☐

REGULATION/GUIDELINE REQUIRED

<input type="checkbox"/>	Sanitary Sewer, City: Ottawa
<input type="checkbox"/>	Storm Sewer, City: Ottawa
<input checked="" type="checkbox"/>	ODWSOG
<input type="checkbox"/>	PWQO
<input type="checkbox"/>	O. Reg 347/558
<input type="checkbox"/>	Other: _____
<input type="checkbox"/>	None

<input type="checkbox"/>	O. Reg 153
Table # ____, Course / Fine, Surface / subsurface.	
Type: Com-Ind / Res-Park / Agri / GW / All Other / Sediment	
<input type="checkbox"/>	Excess Soil, Table: _____ Type: _____
The sample results from this submission will form part of a formal Record of Site Condition (RSC) under O.Reg. 153/04	
<input type="checkbox"/>	Yes <input type="checkbox"/> No

TURN-AROUND TIME (Business Days)

☐ 1 Day* (100%) ☐ 2 Day** (50%) ☐ 3-5 Days (25%) ☒ 5-7 Days (Standard)

Please contact Lab in advance to determine rush availability.

*For results reported after rush due date, surcharges will apply: before 12:00 - 100%, after 12:00 - 50%.

**For results reported after rush due date, surcharges will apply: before 12:00 - 50%, after 12:00 - 25%.

The optimal temperature conditions during transport should be less than 10°C. Sample(s) cannot be frozen, unless otherwise indicated or agreed upon with the Laboratory. Note that this COC is not to be used for drinking water samples. The COC must be complete upon submission of the samples, there will be a \$25 surcharge if required information is missing (required fields are shaded in grey).

Sample Details

Field Filtered -->

Sample Analysis Required

O.Reg.153 parameters

This form is not to be used for drinking water samples. The CCR must be complete upon submission of the samples, there will be a \$25 surcharge if required information is missing (required fields are shaded in grey).		Sample Matrix	# of Containers	O.Reg.153 parameters							See attached paper	Subdivision Supply Batch 2 (Ec/TC only)	TSS	pH	Total Metals	Hg	Turbidity	Colour	Aluminum	RN# (Lab Use Only)
Sample ID	Date/Time Collected			PHC F1 - F4	BTEX	VOCs	PAHs	PCBs	Metals + Inorganics	Metals only										
TW1 - GW - 3	July 19, 2024	GW	1	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	7872590
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

PRINT

SIGN

DATE/TIME

TEMP (°C)

COMMENTS:

Sampled By:	Alex Schopf
Relinquished By:	Alex Schopf
Received By:	

July 19, 2024

July 19, 2024

July 19, 2024

14

CUSTODY SEAL: ☐ YES ☐ NO Ice packs submitted: ☐ Yes ☐ No

OFFICIAL CERTIFICATE OF ANALYSIS : 3993095**WORK REQUEST : 100298584****Report Date : 2024-07-24****Paterson Group**

9 Auriga Dr
Nepean, Ontario
K2E 7T9
Attention : Alex Schopf

Reception Date : 2024-07-19

Project : PM15625

Sampler : NA

PO Number : 60753

Temperature : 14 °C

Analysis	Quantity	External Method
Metals Scan (Water, ICP/MS)	1	Modified from EPA 200.8

Criteria :**A :** Ontario Regulation 169/03 (Non-Regulated Drinking Water)**Sample status upon receipt :**

7872596

Compliant**Notes :**

- All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise stated.
- Eurofins Environment Testing Canada Inc. is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at <https://directory.cala.ca/>
- Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline or regulatory limits listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official guideline or regulation as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Legend :

RL : Reporting limit

QC : Reference material (QC)

N/A : Not applicable

1 : Results in annex

* : Analysis conducted by external subcontracting

^ : Analysis not accredited


OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PM15625

Reception Date: 2024-07-19

Eurofins Sample No :						7872596				
Matrix :						Groundwater				
Sampling Date :						2024-07-19				
Client Sample Identification :						TW1 - GW - 3				
Metals		RL	Unit	Criteria		0.02				
			A	B	C					
Aluminum	0.01	mg/L	0.1							

Approved by :


Emma-Dawn Ferguson, M.Sc.
Environmental Chemist

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PM15625

Reception Date: 2024-07-19


Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Metals Scan (Water, ICP/MS)									
Method : Metals (Water, ICP/MS). Internal method: AMMTFQE1.									
Aluminum	mg/L	0.01	<0.01	100	80-120	106	70-130	0	0-20
Associated Samples : 7872596								Prep Date: 2024-07-21 Analysis Date: 2024-07-23	

Where RPD % is reported as "-" the calculation is not available because one or both of the duplicates is within 5 times the RL.

CLIENT INFORMATION						INVOICE INFORMATION (\$)							REGULATION/GUIDELINE REQUIRED																																																										
Company: Paterson Group						Company:							100298584 YES [X] NO []) 																																																										
Contact: Alex Schopf						Contact:							Printed On : 2024-07-19 17:15:49																																																										
Address: 9 Auriga Drive						Address:							PO #: 60753																																																										
Telephone: 613-218-3444 Cell:						Telephone:																																																																	
Email: #1: leardley@patersongroup.ca, mkillam@patersongroup.ca													<input type="checkbox"/> O. Reg 153																																																										
Email: #2: aschopf@patersongroup.ca;													Table # ____, Course / Fine, Surface / subsurface. Type: Com-Ind / Res-Park / Agri / GW / All Other / Sediment																																																										
Project: PM15625 Quote #:						<input type="checkbox"/> Sanitary Sewer, City: Ottawa <input type="checkbox"/> Storm Sewer, City: Ottawa <input checked="" type="checkbox"/> ODWSOG <input type="checkbox"/> PWQO <input type="checkbox"/> O. Reg 347/558 <input type="checkbox"/> Other: <input type="checkbox"/> None							<input type="checkbox"/> Excess Soil, Table: Type: The sample results from this submission will form part of a formal Record of Site Condition (RSC) under O.Reg. 153/04 <input type="checkbox"/> Yes <input type="checkbox"/> No																																																										
TURN-AROUND TIME (Business Days) <input type="checkbox"/> 1 Day* (100%) <input type="checkbox"/> 2 Day** (50%) <input type="checkbox"/> 3-5 Days (25%) <input checked="" type="checkbox"/> 5-7 Days (Standard) <small>Please contact Lab In advance to determine rush availability.</small> <small>*For results reported after rush due date, surcharges will apply: before 12:00 - 100%, after 12:00 - 50%.</small> <small>**For results reported after rush due date, surcharges will apply: before 12:00 - 50%, after 12:00 - 25%.</small>						<div style="display: flex; justify-content: space-between;"> Sample Details Sample Analysis Required </div> <p>The optimal temperature conditions during transport should be less than 10°C. Sample(s) cannot be frozen, unless otherwise indicated or agreed upon with the Laboratory. Note that this COC is not to be used for drinking water samples. The COC must be complete upon submission of the samples, there will be a \$25 surcharge if required information is missing (required fields are shaded in grey).</p> <table border="1"> <thead> <tr> <th rowspan="2">Field Filtered --></th> <th rowspan="2">Sample Matrix</th> <th rowspan="2"># of Containers</th> <th colspan="8">O.Reg.153 parameters</th> <th rowspan="2">See attached paper</th> <th rowspan="2">Subdivision Supply Batch 2 (EC/TC only)</th> <th rowspan="2">TSS</th> <th rowspan="2">pH</th> <th rowspan="2">Total Metals</th> <th rowspan="2">Hg</th> <th rowspan="2">Turbidity</th> <th rowspan="2">Colour</th> <th rowspan="2">Aluminum</th> <th rowspan="2">RN# (Lab Use Only)</th> </tr> <tr> <th>PHCF1 - F4</th> <th>BTEX</th> <th>VOCs</th> <th>PAHs</th> <th>PCBs</th> <th>Metals + Inorganics</th> <th>Metals only</th> </tr> </thead> <tbody> <tr> <td></td> <td>TW1 - GW - 3</td> <td>July 19, 2024</td> <td>GW</td> <td>1</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td>7872896</td> </tr> <!-- Additional rows would follow here --> </tbody> </table>															Field Filtered -->	Sample Matrix	# of Containers	O.Reg.153 parameters								See attached paper	Subdivision Supply Batch 2 (EC/TC only)	TSS	pH	Total Metals	Hg	Turbidity	Colour	Aluminum	RN# (Lab Use Only)	PHCF1 - F4	BTEX	VOCs	PAHs	PCBs	Metals + Inorganics	Metals only		TW1 - GW - 3	July 19, 2024	GW	1																		7872896
Field Filtered -->	Sample Matrix	# of Containers	O.Reg.153 parameters								See attached paper	Subdivision Supply Batch 2 (EC/TC only)	TSS	pH	Total Metals	Hg	Turbidity	Colour	Aluminum	RN# (Lab Use Only)																																																			
			PHCF1 - F4	BTEX	VOCs	PAHs	PCBs	Metals + Inorganics	Metals only																																																														
	TW1 - GW - 3	July 19, 2024	GW	1																		7872896																																																	
PRINT						SIGN							DATE/TIME		TEMP (°C)		COMMENTS:																																																						
Sampled By: Alex Schopf													July 19, 2024		14																																																								
Relinquished By: Alex Schopf													July 19, 2024																																																										
Received By:													JULY 19 2024																																																										
																	CUSTODY SEAL: YES [] NO [] Ice packs submitted: YES [] NO []																																																						


Pumping Test Analysis Report

File No.	PM15625	Well ID:	TW1
Date:	Tuesday, June 25, 2024	Solution Method:	Theis
Client:	Ken Hoppner	Transmissivity (m ² /day):	1.7
Site Address:	1811 Richardson Side Road	Discharge Rate (L/min)	30
Project:	Re-zoning Application	Analysis performed by:	AS

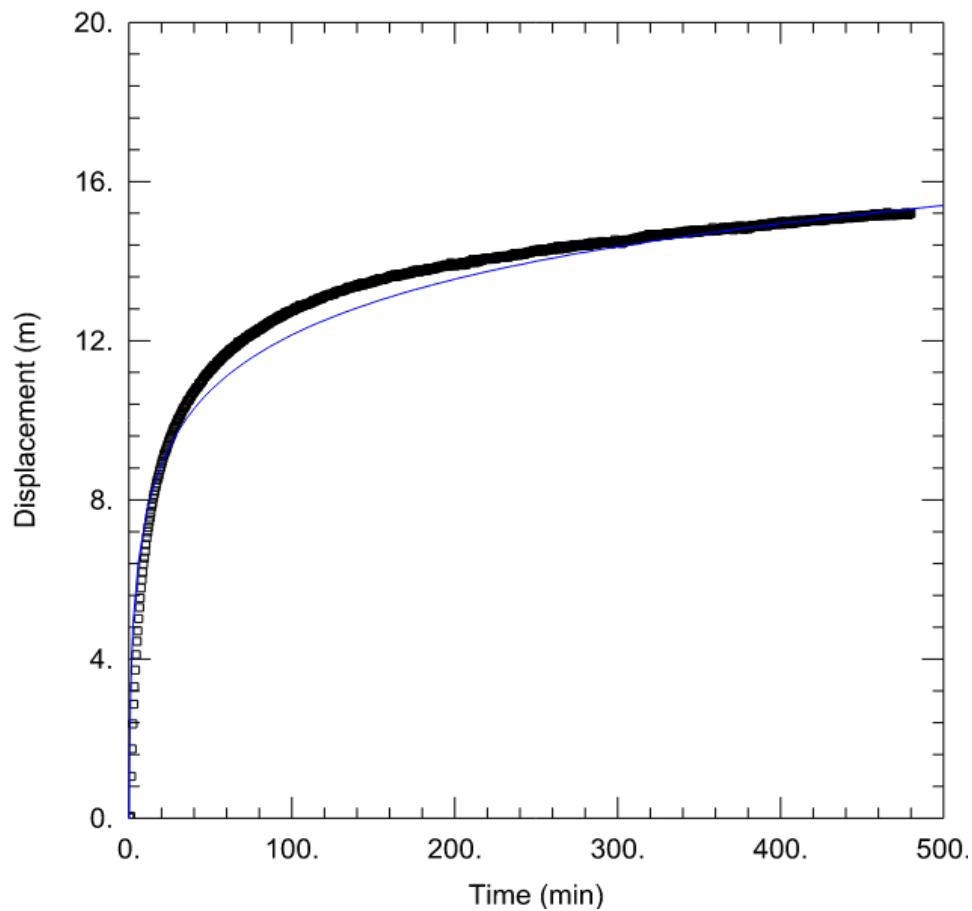

Pumping Test Analysis Report

File No.	PM15625	Well ID:	TW1
Date:	Tuesday, June 25, 2024	Solution Method:	Cooper-Jacob
Client:	Ken Hoppner	Transmissivity (m ² /day):	1.65
Site Address:	1811 Richardson Side Road	Discharge Rate (L/min)	30
Project:	Re-zoning Application	Analysis performed by:	AS

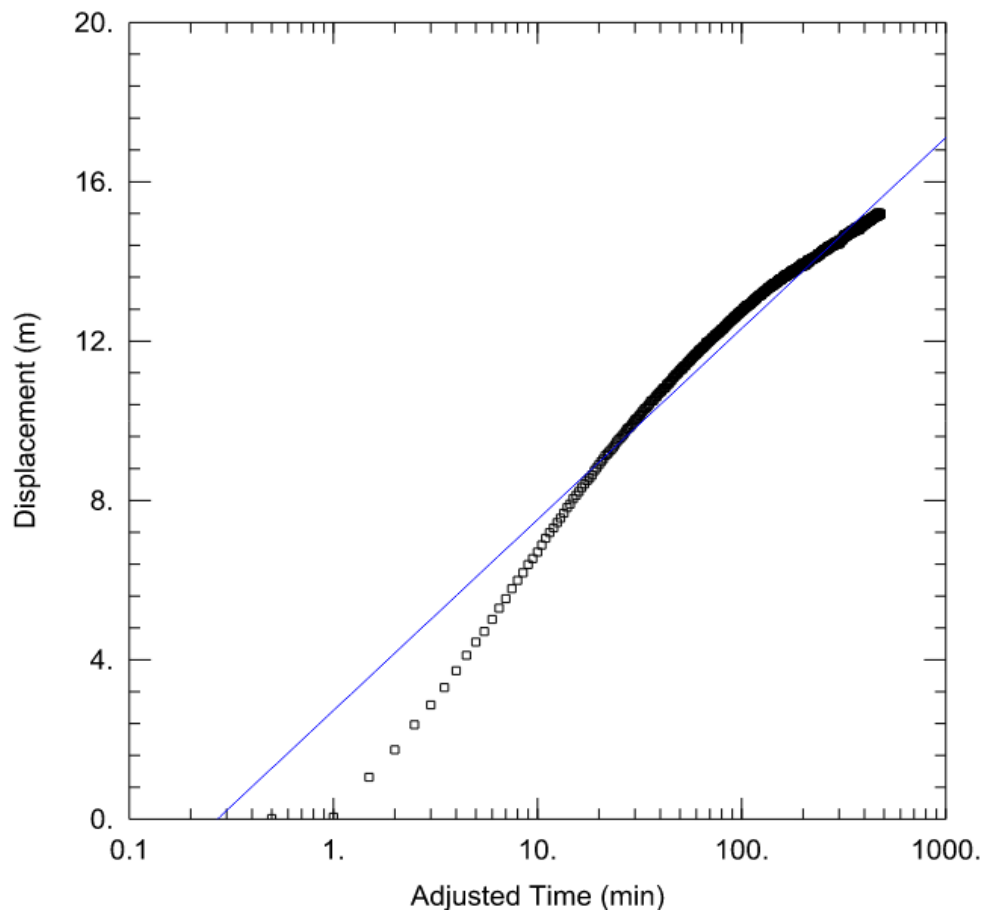

Pumping Test Analysis Report

File No. PM15625
Date: Tuesday, June 25, 2024
Client: Ken Hoppner
Site Address: 1811 Richardson Side Road
Project: Re-zoning Application

Summary Table:		
Solution Method:	Well ID:	Transmissivity (m ² /day):
Theis	TW1	1.7
Cooper-Jacob	TW1	1.65
Average:		1.68

PREDICTIVE NITRATE IMPACT ASSESSEMENT		
Infiltration Factors		
Topography	0.10	
Soil	0.20	
Cover	0.15	
Total	0.45	
Site Characteristics		
Area of Site :	116782	m ²
Total of roof areas:	2500	m ²
Total area of paved driveway areas:	6215	m ²
Roof + paved driveway areas	8715	m ²
Impervious Area	8715	m ²
Percent Impervious Area =	7	%
Infiltration Area =	108067	m ²
Septic Effluent		
Concentration of Effluent (Cs) =	40	mg/L
Infiltration Calculation		
Nitrate concentration in precipitation (C _i) =	0	mg/L
Surplus Water (Environment Canada)	329	mm/yr
Factored Water Surplus =	148	mm/yr
Infiltration % due to stormwater management measures	-	%
Infiltration rate from stormwater management measures =	0	mm/yr
Infiltration Flow Entering the System (Q _i) =	44	m ³ /day
Mass Balance Model (MOEE, 1995)		
$C_T = (Q_b C_b + Q_e C_e + Q_i C_i) / (Q_b + Q_e + Q_i)$ = Cumulative Nitrate Concentration		
Q _b = flow entering the system across the upgradient area	0	m ³ /day
C _b = background nitrate concentration	0	mg/L
C _s = concentration of nitrates in the septic effluent	40	mg/L
Q _i = flow entering the system from infiltration	44	m ³ /day
C _i = Concentration of nitrates in the infiltrate	0	mg/L
C_T =	10.00	mg/L
Maximum Allowable Sewage Flow Volume		
Daily Sewage Flow (Q _s)=	14.61122351	m ³
<i>Notes: Site characteristic values were measured as approximate values from the available site plans and GeoOttawa.</i>		

MW1 inputs			
pH	8	A	0.20
TDS	952	B	2.36
Calcium	75	C	1.48
Alkalinity	225	D	2.35
Temp.	11	pHs =	8.03

Langelier Saturation Index (LSI) Calculation		(Langelier, 1936)
$LSI = pH - pHs$ $pHs = (9.3 + A + B) - (C + D)$ Where:		$A = (\text{Log}_{10} [\text{TDS}] - 1) / 10$ $B = -13.12 \times \text{Log}_{10} (oC + 273) + 34.55$ $C = \text{Log}_{10} [\text{Ca}^{2+} \text{ as } \text{CaCO}_3] - 0.4$ $D = \text{Log}_{10} [\text{alkalinity as } \text{CaCO}_3]$
		LSI = 0.0
LSI	Effect	
0.5 to 2	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive)	
0 to 0.5	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (slightly scale forming and corrosive).	
0	Water is saturated (in equilibrium) with calcium carbonate. A scale layer of calcium carbonate is neither precipitated nor dissolved.	
0 to -0.5	Water is under saturated and tends to dissolve solid calcium carbonate (slightly corrosivebut non-scale forming).	
-0.5 to -2	Water is under saturated and tends to dissolve solid calcium carbonate (seriously corrosive).	



QUOTE #1861

SENT ON:

Oct 06, 2023

RECIPIENT:

Ken Hoppner

1818 Bradley Side Road
Ottawa, Ontario K0A 1L0

SENDER:

PV Plumbing & Water Inc.

3831 Carp Road
Carp, Ontario K0A 1L0

Phone: 613-839-5550

Email: contact@pvplumbingwater.com

Product/Service	Description	Qty.	Unit Price	Total
WT / RO / V360	<p>Vectapure 360 4 Stage 75gpm Complete Reverse Osmosis System with Quick Change Filters.</p> <p>The V360 Reverse Osmosis System is a compact, under-sink residential drinking water system that combines the ease of quick-change colour-coded cartridges, with a 75 gallon (285 liter) per day output. Pure, refreshing drinking water at your fingertips.</p> <p>Your Vectapure 360 system has effortless quarter-turn filter cartridges that change in seconds without the need to turn off the water supply! Each cartridge is colour-coded for easy and trouble-free selection and installation.</p>	1	\$455.00	\$455.00
WT / Softener / CS45FP	<p>Franklin Water 45K Deluxe Clack Water Softener with Bypass</p>	1	\$1,695.00	\$1,695.00
WT / CFO / ZEN12	<p>1.2 CuFt Clack Zentec™ Hybrid Capsulate Chemical-Free Iron, Sulphur, and Manganese Filter - EWS BTZC1 - CFOZ12</p> <p>Chemical-Free Zentec™ Capsulate Iron, Sulphur, and Manganese Filtration for iron, sulphur (often referred to as that "rotten egg smell"), and manganese for well water applications.</p> <p>No chemicals, safe for septic beds, inexpensive operation uses air injection with our Zentec™ Hybrid specialty removal media blend for clean filtered water.</p>	1	\$1,606.00	\$1,606.00



QUOTE #1861

SENT ON:

Oct 06, 2023

Product/Service	Description	Qty.	Unit Price	Total
WT / UV / IHS10D4	Viqua Whole Home UV Rack System with 10" Pre-filter and D4 UV Lamp The IHS10-D4 been validated through microbial testing to inactivate the following microorganisms: Cryptosporidium, Giardia, E.Coli and Fecal Coliform. The Integrated Home System is a reliable and economical way to treat drinking water in any residential application, for flow rates up to 12 gpm (45 lpm).	1	\$1,095.00	\$1,095.00
WT / Filters / EPBB10	Pentair carbon block filter for "Big Blue" or other 4.5" x 10" filter housing. 5 Micron Rating. Recommend changing annually.	1	\$65.00	\$65.00
WT / Clack / 75TKJG	3/4" John Guest 90 Tail Kit for Clack	2	\$32.50	\$65.00
LB / Day Rate	Labour charge for jobs requiring full day of work.	1	\$1,350.00	\$1,350.00
Materials	Materials to complete installation. Pipe and fittings.	1	\$350.00	\$350.00
Notes	<p>Recommend onsite consult to nail down requirements and scope of new treatment system once building is further along and ready for water. This quote is for planning purposes only and based off information collected while onsite. Hub drain in utility room would be required for drainage.</p> <p>Assumes use of well water for new building only. Point of use RO treatment for drinking water at bar or kitchen. Softener, iron, sulfur and UV treatment for whole building. Assumes 10GPD flow rate. 75GPM per day RO water.</p> <p>WE DO NOT DRILL GRANITE/STONE/MARBLE COUNTERTOPS FOR R.O. SPIGOT</p>			

Subtotal	\$6,681.00
HST (13.0%)	\$868.53
Total	\$7,549.53

This quote is valid for the next 30 days, after which values may be subject to change.