


ST JOSEPH BOULEVARD


∼VALVE PER W24 -ASPHALT TO BE REINSTATED TO EXISTING CONDITIONS IN ACCORDANCE WITH CITY STANDARD R10. EXISTING PAVEMENT STRUCTURE TO BE MATCHED. OUTLINE OF STEP JOINT PER CITY R10


OUTLINE OF STEP JOINT PER CITY R10 (300mm MIN) CONCRETE MEDIAN TO BE REINSTATED TO EXISTING CONDITIONS

∕-3.52m - 300mmØ PVC WTM TVS CHAMBER PER CITY W11.1 TO CONNECT TO EXISTING 610mmØ C01 WTM

EX. 610mmØ TOP±67.38 PROP 300mmØ TOP = 67.18 CONNECTION BY CITY FORCES

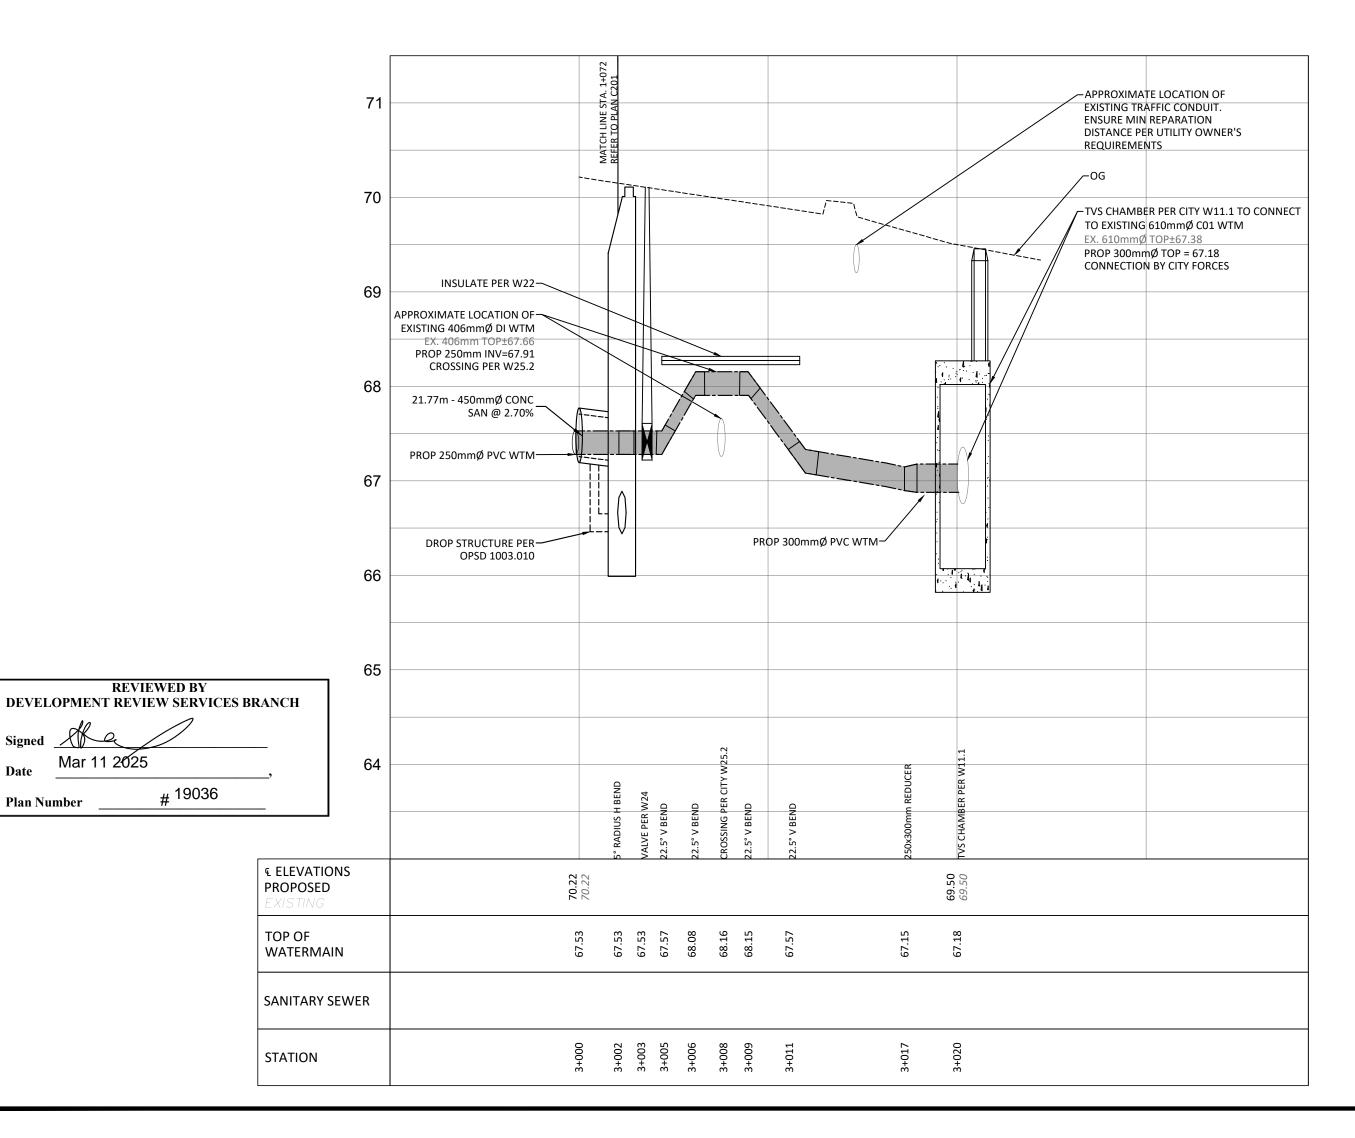

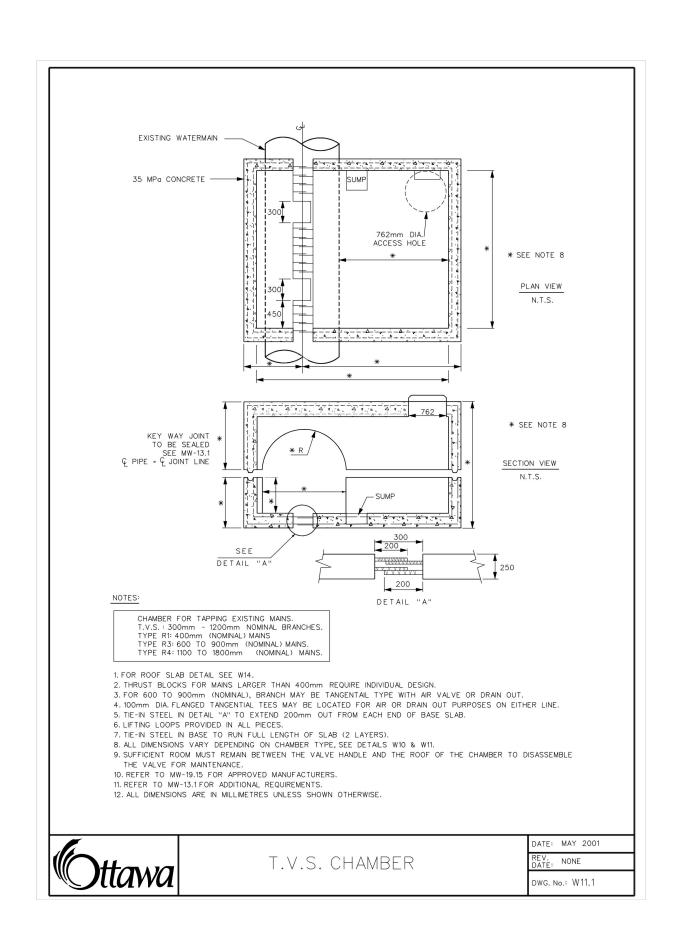

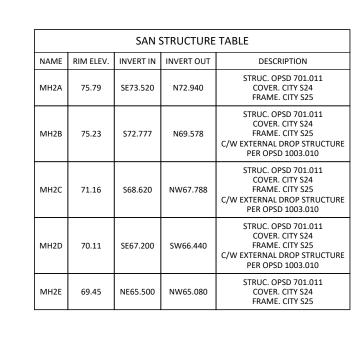

MUNICIPAL SEWER/WATERMAIN RELOCATION NOTES:

- 1. CONSTRUCT ALL SEWERS, MANHOLES AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY.
- 2. SEWER TRENCHING AND BEDDING SHALL CONFORM TO OPSD 802.010 AND 802.013 UNLESS NOTED 2.1. BEDDING SHALL BE A MINIMUM 150mm OF GRANULAR "A", COMPACTED TO MINIMUM 98% STANDARD
- PROCTOR DRY DENSITY (SPMDD). CLEAR STONE BEDDING SHALL NOT BE PERMITTED. BEDDING THICKNESS TO BE INCREASED TO 300mmm IF PLACED ON BEDROCK. 2.2. SUB-BEDDING, IF REQUIRED SHALL CONSIST OF 450mm OF COMPACTED GRANULAR "B" TYPF 1. 2.3. BACKFILL TO AT LEAST 300mm ABOVE TOP OF PIPE WITH GRANULAR "A" OR GRANULAR "B" TYPE 1. 2.4. TO MINIMIZE DIFFERENTIAL FROST HEAVING, TRENCH BACKFILL (FROM PAVEMENT SUBGRADE TO 1.8 METRES BELOW FINISHED GRADE) SHALL MATCH EXISTING SOIL CONDITIONS. THE TRENCH BACKFILL
- 3. THE CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION PHASING AND LAYOUT. A PHASING PLAN SHALL BE ESTABLISHED FOR THE REALIGNMENT OF THE PROPOSED WATER AND SANITARY SERVICES TO ENSURE CONTINUAL SERVICE FOR THE OFF-SITE FLOWS.

SHOULD BE PLACED IN MAXIMUM 225mm THICK LOOSE LIFTS AND COMPACTED TO 98% OF THE


- 4. SEWERS AND CONNECTIONS 200mmØ-375mmØ TO BE PVC SDR-35. SEWER CONNECTIONS 450mmØ AND LARGER TO BE CONCRETE. BEDDING TO BE TYPE "B" EXCEPT AT RISERS, UNLESS NOTED OTHERWISE. CONCRETE SEWER CLASS IN ACCORDANCE WITH OPSD 807.010 & 807.030, AS APPLICABLE.
- 5. CONTRACTOR TO CCTV SANITARY SEWER UPSTREAM AND DOWNSTREAM OF PROPOSED TIE IN LOCATIONS
- PRIOR TO AND AFTER PROPOSED WORKS. 6. PROPOSED SANITARY MAINTENANCE STRUCTURES TO BE BENCHED PER OPSD 701.021.
- 7. SEWERS AND WATERMAINS LOCATED PARALLEL TO EACH OTHER SHOULD BE CONSTRUCTED IN SEPARATE TRENCHES, WHEN IT IS IMPOSSIBLE OR NOT PRACTICAL TO MAINTAIN VERTICAL AND/OR HORIZONTAL SEPARATION PER MECP STANDARDS, ALL SEWERS SHOULD BE CONSTRUCTED OF WATERMAIN QUALITY PIPE, PRESSURE TESTED IN PLACE AT A PRESSURE OF 350 kPa (50 psi) WITHOUT LEAKAGE USING THE TESTING

METHODOLOGY IN ONTARIO PROVINCIAL STANDARD SPECIFICATION 701 (OPSS 701) OF THE OPS.

- 8. WHERE SANITARY SEWERS ARE 0.6M BELOW GROUNDWATER TABLE, SANITARY MAINTENANCE HOLES SHALL BI EXTERNALLY WRAPPED WITH WATERPROOF MEMBRANE PLACED EXTERNALLY AROUND ALL PRECAST JOINTS, INCLUDING JOINTS BELOW THE MAINTENANCE HOLE FRAME AND COVER, WITH A MINIMUM 300MM WIDE
- 9. THE LOCATION OF EXISTING UTILITIES ARE TO BE FIELD VERIFIED PRIOR TO CONSTRUCTION.
- 10. INSTALLATION TO BE IN ACCORDANCE WITH CURRENT CODES AND STANDARDS OF APPROVAL AGENCIES HYDRO ONE, BELL, ROGERS AND THE CITY.
- 11. CONSTRUCT ALL WATERMAINS AND APPURTENANCES IN ACCORDANCE WITH OPSD STANDARDS AND SPECIFICATIONS, AS WELL AS CITY STANDARDS.
- 12. WATERMAINS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 2.4m. INSULATE ALL WATERMAINS AND SERVICES THAT HAVE LESS THAN 2.4m COVER WITH THERMAL INSULATION AS PER CITY
- 13. IF THE WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS EQUAL TO OR LESS THAN THAT WHICH IS RECOMMENDED BY THE MANUFACTURER.
- 14. THERMAL INSULATION OF WATERMAINS AT OPEN STRUCTURES AS PER CITY DETAIL W23.
- 15. VALVES TO BE OPERATED BY CITY STAFF ONLY.

MATERIAL'S SPMDD.

- 16. NO CONNECTION TO EXISTING WATER NETWORK SHALL BE COMPLETED UNTIL A WATER PERMIT IS OBTAINED FROM THE CITY. CITY TO BE PRESENT FOR WATERMAIN CONNECTION. CONNECTION, EXCAVATION, BACKFILLING AND REINSTATEMENT TO BE COMPLETED BY CONTRACTOR.
- 17. IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PERFORM ANY WATERMAIN CONNECTION(S) REQUIRED. THIS SHALL BE COMPLETED IN THE PRESENCE OF A DESIGNATED MUNICIPAL WATER OPERATOR AND THE SELECTED CONTRACTOR SHALL PROVE TO THE SATISFACTION OF THE CITY THAT THEY ARE COMPETENT TO PERFORM THE WORKS PRIOR TO INITIATING CONSTRUCTION.
- 18. CONCRETE THRUST BLOCKS TO CONFORM TO OPSD 1103.010 AND OPSD 1103.020.
- 19. ALL WATERMAIN TO BE CLASS 150 DR-18 OR APPROVED EQUIVALENT.
- 20. ALL WATERMAIN TO BE EQUIPPED WITH TRACER WIRE.
- 21. AS PER CITY GUIDELINE, THE MINIMUM VERTICAL CLEARANCE BETWEEN WATERMAIN AND SEWER/UTILITY IS 0.25m FOR CROSSING OVER THE SEWER, AS PER CITY DETAIL W25.2 FOR CROSSING UNDER SEWER, THE MINIMUM VERTICAL CLEARANCE IS 0.5m AS PER CITY DETAIL W25. FOR CROSSING UNDER SEWER, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER.

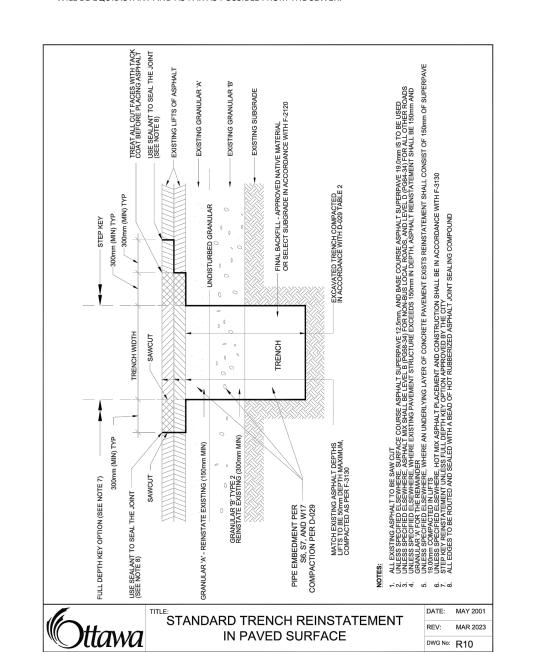



PROP. VALVE PER CITY W24 FIRE HYDRANT PROPOSED WALL — — — CENTRELINE OF SWALE PROPOSED SIAMESE CONNECTION

PROPOSED WATER METER AND REMOTE METER

VALVE/CHAMBER

PROPOSED CONCRETE PROP AND EX. REDUCER

— P U/G HYDRO DUCT PER ELEC. _____ ST____ EX. STM SEWER SAN EX. SAN SEWER

— L — EX. UG STREET LIGHT ---- TF ---- EX. TRAFFIC LINE EX. WATERMAIN — GAS — EX. GAS OHW EX. OHW — GAS — EX. TRAFFIC CABLE — BELL — EX. BELL

PROPOSED ELEVATION EXISTING ELEVATION

TOP/BOTTOM WALL FACE ELEVATIONS

PROPOSED EMERGENCY OVERLAND FLOW ROUTE

HEAVY DUTY SILT FENCE BARRIER PER OPSD 219.130

BUILDING ENTRANCE

CB SILT SACK PER C101 DETAIL

SERVICE/SEWER CROSSING

PROPOSED GRASS

SWALE ELEVATION

SEPT 05, 202 ISSUED FOR SPC AND MUNICIPAL CONSENT Date Revisions




Check and verify all dimensions

before proceeding with the work

115 Walgreen Road, R.R.3 Carp, ON K0A 1L0 Tel: 613-836-2184 Fax: 613-836-3742 www.egis-group.com

Do not scale drawings





THEBERGE DEVELOPMENTS LTD 1600 LAPERRIERE AVE OTTAWA, ON K1Z 8P5

3030 ST. JOSEPH BOULEVARD

OTTAWA

PLAN & PROFILE STA. 3+000 TO 3+020

1:200 CCO-24-0142 RRR Checked By: AM

ON