

January 27, 2025



PH4559-LET.01.REV.04

Whelan Truck Repair
P.O. Box 13090
Ottawa, Ontario
K2K 1X3

Attention: Greg Whelan

Subject: **Site Servicing Report**
Site Plan Application
158 Cardevco Road, Ottawa (Carp), Ontario

Consulting Engineers

9 Auriga Drive
Ottawa, Ontario
K2E 7T9
Tel: (613) 226-7381

Geotechnical Engineering
Environmental Engineering
Hydrogeology
Materials Testing
Building Science
Rural Development Design
Retaining Wall Design
Noise and Vibration Studies

patersongroup.ca

INTRODUCTION

Further to your request and authorization, Paterson group (Paterson) was commissioned to complete this servicing brief to address the proposed water and wastewater services for the Site Plan Application for the additional workspace at 158 Cardevco Road in Ottawa (Carp). There will not be any additional employees/employee shifts or fixtures due to the additional workspace and as such, the daily design sewage flow is not anticipated to change. Furthermore, the proposed addition will be constructed on existing impermeable area and no additional impermeable surfaces are being proposed. Therefore, there will be no changes in the available permeable surface areas. Due to the elevated chlorides (397 mg/L) and sodium (274 mg/L) found in the existing onsite well supply, the Site Plan application is to continue using the existing non-potable supply well.

Existing Conditions

The property consists of a lot of approximately 0.49 hectares (ha). The lot is currently occupied by a single-storey industrial building, and associated gravel access lanes, parking areas and existing septic system which services the development. The existing development is currently serviced by a private onsite sewage system and a drilled well. The water is used for non-potable (toilets/hand washing) uses. Bottled water is supplied to all employees, and signs have been posted indicating that the water supply is non-potable. There is no public access to the building. Refer to Figure 1 – Key Plan below showing the site location.

An Ottawa Septic System Office (OSSO) Part 10/11 application was completed along with the Site Servicing Report. Specifically, an OSSO application for a renovation. The septic flow volumes were confirmed to remain consistent with the use prior to the renovation, and as such no changes to the septic system were required.



Figure 1: Key Plan

City of Ottawa Hydrogeological Pre-consultation

A City of Ottawa Hydrogeological Pre-consultation was completed on July 7, 2022. During the Hydrogeological Pre-consultation, the City indicated that a pumping test would not be required should the existing water demand not be changing. Additionally, a Septic Impact Assessment would not be required if the existing septic flow volumes would not be changing. Should those conditions be met, a Site Servicing Report would be required in lieu of a Hydrogeological Assessment and Terrain Analysis.

Development Proposal

The Site Plan Application is to build an additional building as an extension to the current existing industrial building. Municipal services are not available at this site. The proposed development will be privately serviced by the existing onsite sewage system and existing water well supply. No additional fixtures or employees will be associated with the additional workspace provided by the building addition. Please refer to Shade Group Inc. Drawing titled Site Plan dated Nov 13, 2024 attached to this report for additional details.

AQUIFER ANALYSIS

A member of our hydrogeological staff visited the subject site on November 2nd and 3rd, 2022 to carry out the water supply well disinfection and an inspection of the existing water system which services the subject site. The fieldwork program consisted of disinfecting the existing well, an inspection of the existing drilled water supply well / existing water treatment / distribution system, the collection of a raw water sample for chemical and microbiological analysis, and the field testing of the water supply using portable testing kits.



The existing water supply is obtained from a drilled well. A Water Well Record (WWR) could not be located by the landowner and could not be found online using the Ministry of the Environment, Conservation, and Parks (MECP) WWR mapping tool. As such, the onsite water supply well was measured manually by Paterson personnel during the site visit.

The onsite drilled water supply well was measured to have a 158 mm diameter steel casing, which extends to at least 5.45 m from the top of the casing (TOC). It is inferred that the casing is a minimum length of 6.1 m based upon standard pipe length used in well installations. According to available drift thickness mapping, the drift thickness on the subject site mapped to be from 3 to 5 m thick. The well depth was measured to extend to approximately 16.7 m below the TOC, with a static water level measured at 1.1 m below the TOC.

The well head is fully accessible with the 158 mm diameter steel casing extending approximately 680 mm above the existing ground surface. The present water well regulations, Ontario Regulation 903, requires that the well casing extends at least 400 mm above the ground surface.

The well cap was observed to consist of a vermin proof well cap. The ground surface in the vicinity of the well was adequately shaped to shed surface water away from the well. The well is located greater than 15 m from the subject and neighboring sewage systems, as required by the regulations.

Existing Water Treatment / Distribution System

The existing water system, listed in the direction of flow consists of the following:

- ☐ Submersible Pump
- ☐ Flexcon Industries Well-Rite Pressure Tank

It was noted that no water treatment is currently being used at the time of writing this report. The well has been historically used as a non-potable supply well and is proposed to remain a non-potable supply well.

Water Quantity

A pumping test was not required as the number of fixtures and employees is not changing with the building addition. As the available water supply quantity has been sufficient historically, the existing well is considered to be capable of supplying an adequate volume of water to satisfy the water demand for the subject site.

As per the City of Ottawa Hydrogeological Pre-consultation, an assessment of the available water supply well quantity is not required if the proposed water demands will not be changing for the development.



Occupant Interview

An interview was completed by Paterson personnel with the current occupant on November 2, 2022. During the interview, the occupant noted that the well water is not used for drinking, and that there has never been any issues with available quantity.

Water Quality

On November 2, 2022 Paterson personnel chlorinated the well as per the MECP Water Well Disinfection Instruction Sheet, attached to this report.

The client completed the purging of the well on November 3, 2022. The existing submersible pump was used to purge the well. The discharge line was placed at a sufficient distance to ensure that the discharge water was being directed away from the well as well as any septic systems in the area.

Groundwater samples were collected after the free chlorine residual was verified as non-detectable. A HACH Pocket Colorimeter II chlorine reader was used to measure the free chlorine residual levels. The water samples were submitted for comprehensive testing of bacteriological, chemical, and physical water quality parameters consistent with the standard "Subdivision Supply" suite of parameters plus trace metals, VOC's and PHC's.

All samples were collected unfiltered and unchlorinated and were placed directly into clean bottles supplied by the analytical laboratory. Samples were placed immediately into a cooler with ice and were transported directly to Environmental Testing Canada Inc.(Eurofins) laboratory in Ottawa. All samples were received by the laboratory within 24 hours of collection.

A series of field tests of the pumped water were carried out at the well head prior to the collection of the water samples. The parameters tested at the well head included: pH, total dissolved solids, conductivity, turbidity, true colour, and temperature. The results of the on-site testing are summarized in Table 1 below:



Table 1: Field Testing			
Parameter	Units	Raw Sample	ODWS Water Quality Objective
True Colour	TCU	3	5
Turbidity	NTU	1.12	5
pH	-	7.49	6.5-8.5
Total Dissolved Solids	mg/L	990	500
Conductivity	µs/L	1980	-
Temperature	°C	11.8	8-12

Laboratory Data

The Subdivision Package suite of parameters and trace metals laboratory water quality obtained from the onsite well supply is provided in Table 2a and 2b below and the laboratory analyses reports can be found attached. VOC and PHC laboratory analytical testing was completed and measured to be non-detect in the sample results. All laboratory test results can be found attached to this report.



TABLE 2A: GROUNDWATER GEOCHEMISTRY				
PARAMETER	UNITS	ODWS		Onsite Supply Well
		LIMIT	TYPE	GW1
				2022-11-03
MICROBIOLOGICAL				
Escherichia Coli (E.Coli)	ct/100mL	0	MAC	0
Total Coliforms	ct/100mL	0	MAC	0
GENERAL CHEMICAL - HEALTH RELATED				
Fluoride	mg/L	1.5(2.4)	MAC	<0.10
N-NO2 (Nitrite)	mg/L	1	MAC	<0.10
N-NO3 (Nitrate)	mg/L	10	MAC	0.56
Turbidity (Laboratory)	NTU	1.0 (5.0)	MAC/AO	0.30
Turbidity (Field)	NTU	1.0 (5.0)	MAC/AO	1.12
N-NH3 (Ammonia)	mg/L	-	-	0.02
Total Kjeldahl Nitrogen	mg/L	-	-	0.41
GENERAL CHEMICAL - AESTHETIC RELATED				
Hardness (as CaCO ₃)	mg/L	100	OG	321
Ion Balance	unitless	-	-	0.96
Total Dissolved Solids	mg/L	500	AO	1,250
Alkalinity (as CaCO ₃)	mg/L	500	OG	315
Chloride	mg/L	250	AO	397
Colour	TCU	5	AO	4
Conductivity	uS/cm	-	-	1930
pH	unitless	6.5-8.5	AO	7.44
Sulphide	mg/L	0.05	AO	<0.01
Sulphate	mg/L	500	AO	77
Phenols	mg/L	-	-	<0.001
Tannin & Lignin	mg/L	-	-	<0.1
Dissolved Organic Carbon	mg/L	5	AO	4.6

1. ODWS identifies the following types of parameters:

MAC=Maximum Allowable Concentration

AO = Aesthetic Objective

OG= Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective



TABLE 2B: GROUNDWATER GEOCHEMISTRY				
PARAMETER	UNITS	ODWS		Onsite Supply Well
		LIMIT	TYPE	GW1
				2021-11-03
METALS				
Aluminum (Al)	mg/L	0.1	OG	<0.01
Antimony (Sb)	mg/L	0.006	IMAC	<0.0005
Arsenic (As)	mg/L	0.01	IMAC	<0.001
Barium (Ba)	mg/L	1	MAC	0.22
Beryllium (Be)	mg/L	-	-	<0.0005
Boron (B)	mg/L	5	IMAC	0.03
Cadmium (Cd)	mg/L	0.005	MAC	<0.0001
Calcium (Ca)	mg/L	-	-	102
Chromium (Cr)	mg/L	0.05	MAC	<0.001
Cobalt (Co)	mg/L	-	-	0.002
Copper (Cu)	mg/L	1	AO	0.009
Iron (Fe)	mg/L	0.3	AO	0.03
Lead (Pb)	mg/L	0.01	MAC	0.001
Magnesium (Mg)	mg/L	-	-	16
Manganese (Mn)	mg/L	0.05	AO	0.15
Mercury (Hg)	mg/L	0.01	MAC	<0.0001
Molybdenum (Mo)	mg/L	-	-	<0.005
Nickle (Ni)	mg/L	-	-	<0.005
Potassium (K)	mg/L	-	-	2
Selenium (Se)	mg/L	0.05	MAC	<0.001
Silver (Ag)	mg/L	-	-	<0.0001
Sodium (Na)	mg/L	200	AO	274
Strontium (Sr)	mg/L	-	-	0.604
Thallium (Tl)	mg/L	-	-	<0.0001
Uranium (U)	mg/L	0.02	MAC	0.001
Vanadium (V)	mg/L	-	-	<0.001
Zinc (Z)	mg/L	5	AO	<0.01

1. ODWS identifies the following types of parameters:

MAC=Maximum Allowable Concentration

AO = Aesthetic Objective

OG= Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective



The bacteriological test results (Certificate of Analysis – Report No. 1989429) indicated that E.Coli and Total Coliforms were non-detectable in the well water (0 ct/100 mL).

The water quality of the subject water supply well meets all of the Ontario Drinking Water Standards (ODWS) maximum acceptable concentrations (MAC) other than Manganese. Furthermore, the water meets all of the aesthetic objectives (AO) and operational guidelines (OG) with the exception of the following:

- ☐ Hardness (as CaCO_3)
- ☐ Total Dissolved Solids (TDS)
- ☐ Chlorides
- ☐ Sodium
- ☐ Manganese

Exceedances of the above parameters are not uncommon of the water supply in the area. Each of these groundwater parameters are discussed in detail below.

Hardness as CaCO_3

Hardness, expressed as calcium carbonate, an operational guideline, does not appear in the ODWS. Rather, it appears in the Technical Support Documents for Ontario Drinking Water Standards, Objectives, and Guidelines as a parameter with an operational guideline of 100 mg/L. At the measured concentration of 321 mg CaCO_3 /L, the water is considered hard. The Technical Support Document for the ODWS publication states that water with hardness in excess of 500 mg/L may be unacceptable for most domestic purposes, however, there is no maximum treatable value available. It is expected that the hardness concentration can be treated using commercial grade water softener technologies, if desired by the owner.

Total Dissolved Solids (TDS)

Total dissolved solids (TDS) refers to the concentration of inorganic substances dissolved in water. The main constituents are typically chloride, sulphates, calcium, magnesium, and bicarbonates. Water with a TDS concentration above 500 mg/L may not be palatable. As the water is not used for consumption (non-potable supply), palatability is not a concern. The non-potable supply will continue to be used only for hand washing and toilet flushing. Procedure D-5-5 does not provide a treatability limit for TDS, but it does require written rationale that corrosion, encrustation, or taste problems will not occur.

The Langelier Saturation Index (Langelier, 1936) is used to predict the calcium carbonate stability of the water. It indicates whether the calcium carbonate will precipitate, dissolve, or be in equilibrium with the water. The results of the Langelier calculation ($\text{LSI} = -0.3$) indicate that the water is under saturated and tends to dissolve solid calcium carbonate (slightly corrosive but non-scale forming). Based on site observations, significant corrosion was not noted. Should corrosion become an issue, PEX piping would be the most effective mitigation measure for potential corrosion. See Langelier Saturation Index Calculation attached for calculation details.



Chloride

Chloride, an aesthetic parameter, was detected in the laboratory test sample at a concentration of 397 mg/L which is in excess of the ODWS aesthetic objective of 250 mg/L. The World Health Organization (WHO) prepared a document “Chloride in Drinking-water” dated 1996 that concludes that chloride concentrations in excess of 250 mg/L may potentially provide a detectable taste in the water. Consumers may become accustomed to chloride concentrations that exceed 250 mg/L. WHO noted that they would not be proposing limits for chlorides in drinking water.

Health Canada notes within the document “Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Chloride” that the aesthetic objective of <250 mg/L was established for chlorides in drinking water, however, a maximum concentration was not set by Health Canada.

Concentrations exceeding the aesthetic objective value may impart undesirable tastes to water and beverages. The treatability limit of chloride is 250 mg/L and as the chloride concentration is well above the treatability limit, the water is not considered to be palatable by the City of Ottawa Hydrogeological and Terrain analysis Guidelines (HTAG) standards. Therefore, imported bottled water or a water cooler will be used as an alternative drinking water source as the onsite well supply will not be a potable water well.

Sodium

Sodium is an aesthetic parameter and was detected in the test sample at a concentration of 274 mg/L, which is greater than the ODWS aesthetic objective of 200 mg/L. Although sodium is not toxic and no maximum acceptable concentration has been set, concentrations above 20 mg/L require that the Medical Officer of Health be notified of the water quality results, so that this information may be passed on to local physicians for use in treatment of those requiring a sodium-restricted diet.

As the sodium levels are above the maximum level considered treatable by the City of Ottawa HTAG (200 mg /L), the raw water encountered by the onsite well is not considered palatable.

Manganese

The manganese concentration results from the laboratory test samples yielded a value of 0.15 mg/L in the onsite well, which is above the aesthetic objectives in the ODWSOG of 0.05 mg/L. Additionally, the manganese concentration in the aquifer exceeds the Canadian Guidelines of Drinking Water Quality maximum acceptable concentration (MAC) of 0.12 mg/L. The City of Ottawa annotated procedure D-5-5 gives a maximum concentration considered reasonably treatable for manganese as 1.0 mg/L. The water supply aquifer will only be used for non-potable activities and potable drinking water will be provided through external sources. A conventional water softener or manganese greensand filter can be used to reduce the levels of manganese, if desired.



Private Sewage Service

The proposed development will continue to be serviced by the existing onsite sewage system. Refer to the attached OSSO Sewage System Certificate of Completion (OSSO COC) with Sewage System Permit Number 18-222 for additional details on the existing sewage system.

Existing Sewage System Design

The existing Class 4 sewage system was installed in 2018 and consists of a septic tank and leaching bed/treatment system. According to the OSSO COC, the existing system consists of a 4,500 L concrete septic tank which gravity feeds two (2) runs of eight (8) units of the Eljen Model GSF A-42 treatment system (total of 16 units) over a 122 m² sand bed. The concrete septic tank is outfitted with a Tuf-Tite Ef-6 effluent filter. The septic tank and treatment bed meet the setback requirements from the onsite and neighboring drilled wells, as well as all required distances set by the OBC.

Existing Sewage System Capacity

The estimated sewage flow in the OSSO permit is based on the number of 8-hour employee shifts. It has been specified that there will be 14 x 8-hour shifts per day, which according to the OBC guideline of 75 L per 8-hour shift for factories, workshops, etc., results in a daily flow rate of 1,050 L/day. The existing system has been designed to support 1,500 L/d (approximately 20 employee shifts).

The septic tank, for commercial applications, should have a minimum working capacity of at least three (3) times the total design daily sanitary sewage flow of 1,500 L/d based on the maximum the system can support. As such, the existing septic tank, with a volume of 4,500 L, is considered adequate to support the estimated sewage flow.

The number of modules for the Eljen GSF A-42 treatment system required is determined by the formula $Q/95$, where “Q” is the design daily sewage flow. Based on the flow rate of 1,050 L/d, 12 modules would be required, however, the existing system was designed with two (2) rows of eight (8) modules for a total of 16 modules. The sand area required is calculated by $QT/400$, where “Q” is the design daily sewage flow and “T” is the percolation rate of the soil. For the current site, a percolation rate of 30 min/cm was used, resulting in a required sand area of 78.75 m². The existing sand area is 122 m² which is greater than the required sand area and can support a daily sewage flow of 1,600 L/day.

Since no additional fixtures or additional employee shifts are being proposed as part of the proposed building expansion, the septic flow volumes are not anticipated to change.

As the septic system is already oversized compared to the calculated volume under OBC, it can be concluded that the existing system is sufficient to support the proposed development.



Conclusions

Based on the information contained within the body of this report the following conclusions can be drawn:

1. The water supply aquifer intercepted by the existing well is considered to be adequate to support the water quantity demands for the proposed warehouse addition.
2. As the onsite well currently provides non-potable water to the existing building, the client is familiar with the quality of the groundwater.
3. Bottled water must be provided to all employees, and signage indicating that the water is non-potable must be posted at all drinking water locations.
4. The preferred water supply aquifer intercepted by the onsite drilled supply well contains a water supply that is not potable, and contains elevated concentrations of Hardness, TDS, and Manganese. All of these parameters can be treated with current readily available water conditioning equipment.
5. The preferred water supply aquifer intercepted by the onsite drilled supply well contains a water supply that is not potable and contains elevated concentrations of Chlorides and Sodium which exceed the City of Ottawa's HTAG (Section 3.2 - annotated MECP Procedure D-5-5) maximum concentrations considered reasonably treatable. As such, the onsite water supply is considered a non-potable water supply well.
6. The sodium concentrations were measured to be above the 20 mg/L reporting limit and, as such, the Medical Officer of Health for the City of Ottawa should be informed to assist area physicians in the treatment of local residents on sodium reduced diets.
7. A Building Permit needs to be issued prior to the commencement of construction on the proposed warehouse addition.
8. The results of the Site Servicing Report have provided satisfactory evidence that the subject site can support the proposed workplace addition with the existing non-potable water supply and the existing septic system.




We trust that the current submission satisfies your immediate requirements.

Best Regards,

Paterson Group Inc.

Alexander Schopf, PhD, EIT

Erik Ardley, P.Geo




Attachments:

- ☐ MECP Water Well Disinfection Instruction Sheet
- ☐ Eurofins Certificate of Analysis
- ☐ Langelier Saturation Calculation
- ☐ Ottawa Public Health's Manganese in Drinking Water Fact Sheet, dated September 12, 2024
- ☐ OSSO Sewage System Certificate of Completion with permit No.18-222
- ☐ Shade Group Inc. - Site Plan – Drawing No. 1 of 1 dated November 13, 2024



Disinfection Instruction Sheet

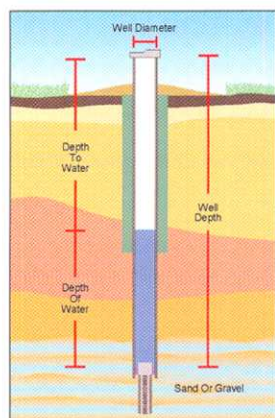

If your drinking water continues to test positive on repeated submissions, consult your local health unit, which can help you interpret the results of your tests and provide you with advice on what measures you can take to safeguard your drinking water.

The first step in identifying the reason for repeated adverse water quality is to conduct a visual inspection of your well. Start with a close look at your well. The area around it should be

clear of any potential contaminant sources, such as pets, lawn care products, and gardens. Once you're satisfied that the area around your well is okay, take a good, close look at the well itself. If you have an older well, make sure that the cap and the sealant around the well casing isn't cracked or damaged. If it is, you need to fix or replace it right away.

If the source of the problem can't be detected, consult a licensed well contractor right away to identify the source of the problem and eliminate it. You can save yourself a lot of money by doing this instead of rushing out to buy a home treatment device that may be expensive to install, operate, and maintain. And it may not eliminate the source of your trouble.

(If you have a cistern, please talk to your public health unit about disinfection requirements.)

1. Measure the diameter of the well.
2. Measure the well depth and the static or resting water level, then calculate the depth of water in the well.
3. Using the table on this sheet, measure out the amount of bleach needed. (The table gives the volume of bleach needed for different well sizes.) Then, pour the mixture into your well.
4. If possible, mix the water in the well. This can be accomplished by attaching a hose to a tap, running water from the well, through the hose and back into the well.
5. After adding chlorine to the well, remove or bypass any carbon filters that are in the system for water treatment. If you don't, these filters will remove the chlorine from the water, and any pipes beyond the filter will not get disinfected. Replace with new filters after chlorination to avoid reintroducing bacteria into the system.
6. Run water at every faucet in the house (and barn, if you have one) until a strong chlorine odour is detected. Be aware that your nose may lose its ability to detect chlorine.
7. If there is no chlorine smell or it is very weak, add more bleach to the well and repeat Step 6 above.
8. Drain the water heater and fill with chlorinated water.
9. Backflush the water softener and all water filters (except carbon filters).

Volume of Bleach to Add for Every 3 Metres (10 Feet) of Water in the Well*		
Casing Diameter		Volume of Unscented Bleach (5.25% solution)
Millimetres	Inches	Millilitres
50	2	6
100	4	30
150	6	60
200	8	100
250	10	200
300	12	250
400	16	400
500	20	650
600	24	900
900	36	2000 (2 litres)
1200	48	3600 (3.6 litres)

For example: If you have 6 metres (20 feet) of water in your well and it has a casing diameter of 100 mm or 4 inches, you would add 60 mm or 2 fluid ounces of bleach.

* For questions or more information on how to disinfect your well, contact your local health unit.

For more information

Ontario Government Ministry Abbreviations

Ministry of Health and Long-Term Care
MOHLTC (also MOH)

Ministry of the Environment
MOE (also MOEE)

Ontario Ministry of Agriculture and Food
OMAF (also OMAFRA)

Ontario Government Information Lines

MOE Public Information Centre: 1-800-565-4923

MOE Water Well Records: 1-888-396-9355

MOHLTC INFOline: 1-800-268-1154

OMAF Agricultural Information Contact Centre: 1-877-424-1300

Ontario Government Web Sites

MOE: www.ene.gov.on.ca

MOHLTC: www.health.gov.on.ca

OMAF: www.gov.on.ca/omaf

Publications available on-line

Health Canada: www.hc-sc.gc.ca

- *A Guide to Well Water Treatment and Maintenance*;
- *Water treatment devices for disinfection of drinking water*.

MOHLTC: www.health.gov.on.ca

- *How to use water safely during a "Boil Water Advisory"*;
- *E. coli Bacteria*;
- List of Public Health Units in Ontario.

OMAF: www.gov.on.ca/omaf

- *Assessing the Potential for Ground Water Contamination on Your Farm*, Publication 97-017;
- *Best Management Practices: Water Wells*, OMAFRA and Agriculture and Agri-Food Canada, 2003 (to order).

MOE: www.ene.gov.on.ca

- *Important Facts About Water Well Construction*, Publication 3788;
- *Water Wells and Groundwater Supplies: The Protection of Water Quality in Bored and Dug Wells*, Information Sheet PIB 601b;
- *Water Wells and Groundwater Supplies: The Protection of Water Quality in Drilled Wells*, Information Sheet PIB 602b.

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

Page 1 of 14

Dear Alex Schopf:

Please find attached the analytical results for your samples. If you have any questions regarding this report, please do not hesitate to call (613-727-5692).

Report Comments:

Revision 1: This is an amendment and supersedes all other copies of this report issued on 2022-11-18. VOCs added as per the client's request.

APPROVAL:

Emma-Dawn Ferguson, Chemist

All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise indicated.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at: <https://directory.cala.ca/>.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is licensed by the Ontario Ministry of the Environment, Conservation, and Parks (MECP) for specific tests in drinking water (license #2318). A copy of the license is available upon request.

Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) is accredited by the Ontario Ministry of Agriculture, Food, and Rural Affairs for specific tests in agricultural soils.

Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline values listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official provincial or federal guideline as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

					Lab I.D. Sample Matrix Sample Type Sampling Date Sample I.D.
					1660784 GW 2022-11-03 GW1
Group	Analyte	MRL	Units	Guideline	
Anions	Cl	1	mg/L	AO 250	397*
	F	0.10	mg/L	MAC 1.5	<0.10
	N-NO2	0.10	mg/L	MAC 1.0	<0.10
	N-NO3	0.10	mg/L	MAC 10.0	0.56
	SO4	1	mg/L	AO 500	77
General Chemistry	Alkalinity as CaCO3	5	mg/L	OG 30-500	315
	Colour (Apparent)	2	TCU	AO 5	4
	Conductivity	5	uS/cm		1930
	DOC	0.5	mg/L	AO 5	4.6
	pH	1.00		6.5-8.5	7.44
	Phenols	0.001	mg/L		<0.001
	S2-	0.01	mg/L	AO 0.05	<0.01
	TDS (COND - CALC)	1	mg/L	AO 500	1250*
	Turbidity	0.1	NTU	AO 5	0.3
Hardness	Hardness as CaCO3	1	mg/L	OG 80-100	321*
Hydrocarbons	F1 (C6-C10)	20	ug/L		<20
	F2 (C10-C16)	300	ug/L		<300
	F3 (C16-C34)	750	ug/L		<750
	F4 (C34-C50)	750	ug/L		<750
Indices/Calc	Ion Balance	0.01			0.96
Metals	Ag	0.0001	mg/L		<0.0001
	Al	0.01	mg/L	OG 0.1	<0.01
	As	0.001	mg/L	IMAC 0.01	<0.001
	B	0.01	mg/L	IMAC 5.0	0.03
	Ba	0.01	mg/L	MAC 1.0	0.22

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

					Lab I.D. Sample Matrix Sample Type Sampling Date Sample I.D.
					1660784 GW 2022-11-03 GW1
Group	Analyte	MRL	Units	Guideline	
Metals	Be	0.0005	mg/L		<0.0005
	Ca	1	mg/L		102
	Cd	0.0001	mg/L	MAC 0.005	<0.0001
	Co	0.0002	mg/L		0.0020
	Cr	0.001	mg/L	MAC 0.05	<0.001
	Cu	0.001	mg/L	AO 1	0.009
	Fe	0.03	mg/L	AO 0.3	0.03
	Hg	0.0001	mg/L	MAC 0.001	<0.0001
	K	1	mg/L		2
	Mg	1	mg/L		16
	Mn	0.01	mg/L	AO 0.05	0.15*
	Mo	0.005	mg/L		<0.005
	Na	1	mg/L	AO 200	274*
	Ni	0.005	mg/L		<0.005
	Pb	0.001	mg/L	MAC 0.010	0.001
	Sb	0.0005	mg/L	IMAC 0.006	<0.0005
	Se	0.001	mg/L	MAC 0.05	<0.001
	Sr	0.001	mg/L		0.604
	Tl	0.0001	mg/L		<0.0001
	U	0.001	mg/L	MAC 0.02	0.001
	V	0.001	mg/L		<0.001
	Zn	0.01	mg/L	AO 5	<0.01
Microbiology	Escherichia Coli	0	ct/100mL	MAC 0	0
	Total Coliforms	0	ct/100mL	MAC 0	0
Nutrients	N-NH3	0.020	mg/L		0.023

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

					Lab I.D. Sample Matrix Sample Type Sampling Date Sample I.D.
					1660784 GW 2022-11-03 GW1
Group	Analyte	MRL	Units	Guideline	
Nutrients	Total Kjeldahl Nitrogen	0.100	mg/L		0.407
PHC Surrogate	Alpha-androstrane	0	%		101
Subcontract	Tannin & Lignin	0.1	mg/L		0.9
VOCs Surrogates	1,2-dichloroethane-d4	0	%		83
	4-bromofluorobenzene	0	%		76
	Toluene-d8	0	%		106
Volatiles	1,1,1,2-tetrachloroethane	0.5	ug/L		<0.5
	1,1,1-trichloroethane	0.4	ug/L		<0.4
	1,1,2,2-tetrachloroethane	0.5	ug/L		<0.5
	1,1,2-trichloroethane	0.4	ug/L		<0.4
	1,1-dichloroethane	0.4	ug/L		<0.4
	1,1-dichloroethylene	0.5	ug/L	MAC 14	<0.5
	1,2-dichlorobenzene	0.4	ug/L	MAC 200	<0.4
	1,2-dichloroethane	0.5	ug/L	IMAC 5	<0.5
	1,2-dichloropropane	0.5	ug/L		<0.5
	1,3,5-trimethylbenzene	0.3	ug/L		<0.3
	1,3-dichlorobenzene	0.4	ug/L		<0.4
	1,3-Dichloropropylene (cis+trans)	0.5	ug/L		<0.5
	1,4-dichlorobenzene	0.4	ug/L	MAC 5	<0.4
	Acetone	30	ug/L		<30
	Benzene	0.5	ug/L	MAC 1	<0.5
	Bromodichloromethane	0.3	ug/L		<0.3
	Bromoform	0.4	ug/L		<0.4
	Bromomethane	0.5	ug/L		<0.5
	c-1,2-Dichloroethylene	0.4	ug/L		<0.4

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

					Lab I.D. Sample Matrix Sample Type Sampling Date Sample I.D.
					1660784 GW 2022-11-03 GW1
Group	Analyte	MRL	Units	Guideline	
Volatiles	c-1,3-Dichloropropylene	0.5	ug/L		<0.5
	Carbon Tetrachloride	0.2	ug/L	MAC 2	<0.2
	Chloroethane	0.5	ug/L		<0.5
	Chloroform	0.5	ug/L		<0.5
	Dibromochloromethane	0.3	ug/L		<0.3
	Dichlorodifluoromethane	0.5	ug/L		<0.5
	Dichloromethane	4.0	ug/L	MAC 50	<4.0
	Ethylbenzene	0.5	ug/L	MAC 140	<0.5
	Ethylene Dibromide	0.2	ug/L		<0.2
	Hexane	5	ug/L		<5
	m/p-xylene	0.4	ug/L		<0.4
	Methyl Ethyl Ketone (MEK)	10	ug/L		<10
	Methyl Isobutyl Ketone (MIBK)	10	ug/L		<10
	Methyl Tert Butyl Ether (MTBE)	2	ug/L	AO 15	<2
	Monochlorobenzene	0.5	ug/L	MAC 80	<0.5
	o-xylene	0.4	ug/L		<0.4
	Styrene	0.5	ug/L		<0.5
	t-1,2-Dichloroethylene	0.4	ug/L		<0.4
	t-1,3-Dichloropropylene	0.5	ug/L		<0.5
	Tetrachloroethylene	0.3	ug/L	MAC 10	<0.3
	Toluene	0.4	ug/L	MAC 60	<0.4
	Trichloroethylene	0.3	ug/L	MAC 5	<0.3
	Trichlorofluoromethane	0.5	ug/L		<0.5
	Vinyl Chloride	0.2	ug/L	MAC 1	<0.2
	Xylene; total	0.5	ug/L	MAC 90	<0.5

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Run No 432536 Analysis/Extraction Date 2022-11-05 Analyst DRA Method AMBCOLM1			
Escherichia Coli			
Total Coliforms			
Run No 432577 Analysis/Extraction Date 2022-11-04 Analyst ACG Method C SM2130B			
Turbidity	<0.1 NTU	101	70-130
Run No 432702 Analysis/Extraction Date 2022-11-07 Analyst SD Method EPA 200.8			
Silver	<0.0001 mg/L	102	80-120
Aluminum	<0.01 mg/L	101	80-120
Arsenic	<0.001 mg/L	90	80-120
Boron (total)	<0.01 mg/L	97	80-120
Barium	<0.01 mg/L	93	80-120
Beryllium	<0.0005 mg/L	99	80-120
Cadmium	<0.0001 mg/L	96	80-120
Cobalt	<0.0002 mg/L	102	80-120
Chromium Total	<0.001 mg/L	99	80-120

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Copper	<0.001 mg/L	102	80-120
Iron	<0.03 mg/L	99	80-120
Manganese	<0.01 mg/L	105	80-120
Molybdenum	<0.005 mg/L	94	80-120
Nickel	<0.005 mg/L	101	80-120
Lead	<0.001 mg/L	102	80-120
Antimony	<0.0005 mg/L	85	80-120
Selenium	<0.001 mg/L	91	80-120
Strontium	<0.001 mg/L	92	80-120
Thallium	<0.0001 mg/L	97	80-120
Uranium	<0.001 mg/L	96	80-120
Vanadium	<0.001 mg/L	98	80-120
Zinc	<0.01 mg/L	99	80-120
Run No 432727 Analysis/Extraction Date 2022-11-08 Analyst ACG Method C SM2120C			
Colour (Apparent)	<2 TCU	100	90-110
Run No 432747 Analysis/Extraction Date 2022-11-08 Analyst ACG Method C SM4500-S2-D			

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
S2-	<0.01 mg/L	101	80-120
Run No 432787 Analysis/Extraction Date 2022-11-08 Analyst ACG Method SM2320,2510,4500H/F			
Alkalinity (CaCO ₃)	<5 mg/L	101	90-110
Conductivity	<5 uS/cm	101	90-110
F	<0.10 mg/L	103	90-110
pH		99	90-110
Run No 432789 Analysis/Extraction Date 2022-11-09 Analyst AaN Method SM 4110			
N-NO ₂	<0.10 mg/L	104	90-110
N-NO ₃	<0.10 mg/L	102	90-110
SO ₄	<1 mg/L	100	90-110
Run No 432807 Analysis/Extraction Date 2022-11-09 Analyst PJ Method CCME O.Reg 153/04			
Petroleum Hydrocarbons F1	<20 ug/L		60-140
Run No 432821 Analysis/Extraction Date 2022-11-09 Analyst Z S Method M SM3120B-3500C			
Calcium	<1 mg/L	95	90-110
Potassium	<1 mg/L	95	87-113

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Magnesium	<1 mg/L	94	76-124
Sodium	<1 mg/L	93	82-118
Run No 432822 Analysis/Extraction Date 2022-11-09 Analyst SKH Method EPA 350.1			
N-NH3	<0.020 mg/L	89	80-120
Run No 432843 Analysis/Extraction Date 2022-11-09 Analyst SKH Method EPA 351.2			
Total Kjeldahl Nitrogen	<0.100 mg/L	102	70-130
Run No 432885 Analysis/Extraction Date 2022-11-10 Analyst AaN Method SM 4110			
Chloride	<5 mg/L		90-110
Run No 432886 Analysis/Extraction Date 2022-11-09 Analyst SD Method EPA 200.8			
Mercury	<0.0001 mg/L	111	80-120
Run No 432898 Analysis/Extraction Date 2022-11-10 Analyst ACG Method C SM5310C			
DOC	<0.5 mg/L	108	84-116
Run No 432901 Analysis/Extraction Date 2022-11-10 Analyst SKH Method C SM2340B			

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Hardness as CaCO ₃			
Ion Balance			
TDS (COND - CALC)			
Run No 432913 Analysis/Extraction Date 2022-11-10 Analyst SS Method CCME O.Reg 153/04			
Petroleum Hydrocarbons F2	<20 ug/L	84	60-140
Petroleum Hydrocarbons F3	<50 ug/L	84	60-140
Petroleum Hydrocarbons F4	<50 ug/L	84	60-140
Run No 432919 Analysis/Extraction Date 2022-11-10 Analyst IP Method SM5530D/EPA420.2			
Phenols	<0.001 mg/L	111	50-120
Run No 433456 Analysis/Extraction Date 2022-11-17 Analyst AET Method SUBCONTRACT-A			
Tannin & Lignin	<0.10 mg/L	96	
Run No 435457 Analysis/Extraction Date 2022-11-08 Analyst PJ Method EPA 8260			
Tetrachloroethane, 1,1,1,2-	<0.5 ug/L	98	60-130
Trichloroethane, 1,1,1-	<0.4 ug/L	91	60-130
Tetrachloroethane, 1,1,2,2-	<0.5 ug/L	99	60-130

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Trichloroethane, 1,1,2-	<0.4 ug/L	97	60-130
Dichloroethane, 1,1-	<0.4 ug/L	92	60-130
Dichloroethylene, 1,1-	<0.5 ug/L	81	60-130
Dichlorobenzene, 1,2-	<0.4 ug/L	94	60-130
Dichloroethane, 1,2-	<0.5 ug/L	92	60-130
Dichloropropane, 1,2-	<0.5 ug/L	92	60-130
1,3,5-trimethylbenzene	<0.3 ug/L	99	60-130
Dichlorobenzene, 1,3-	<0.4 ug/L	90	60-130
Dichloropropene, 1,3-	<0.5 ug/L		
Dichlorobenzene, 1,4-	<0.4 ug/L	90	60-130
Acetone	<30 ug/L		60-130
Benzene	<0.5 ug/L	94	60-130
Bromodichloromethane	<0.3 ug/L	92	60-130
Bromoform	<0.4 ug/L	94	60-130
Bromomethane	<0.5 ug/L	81	60-130
Dichloroethylene, 1,2-cis-	<0.4 ug/L	90	60-130
Dichloropropene, 1,3-cis-	<0.5 ug/L	82	60-130
Carbon Tetrachloride	<0.2 ug/L	93	60-130

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Chloroethane	<0.5 ug/L	83	60-130
Chloroform	<0.5 ug/L	93	60-130
Dibromochloromethane	<0.3 ug/L	93	60-130
Dichlorodifluoromethane	<0.5 ug/L	72	60-130
Methylene Chloride	<4.0 ug/L	97	60-130
Ethylbenzene	<0.5 ug/L	90	60-130
Ethylene dibromide	<0.2 ug/L	99	60-130
Hexane (n)	<5 ug/L	100	60-130
m/p-xylene	<0.4 ug/L	97	60-130
Methyl Ethyl Ketone	<10 ug/L	100	60-130
Methyl Isobutyl Ketone	<10 ug/L		60-130
Methyl tert-Butyl Ether (MTBE)	<2 ug/L	90	60-130
Chlorobenzene	<0.5 ug/L	93	60-130
o-xylene	<0.4 ug/L	92	60-130
Styrene	<0.5 ug/L	89	60-130
Dichloroethylene, 1,2-trans-	<0.4 ug/L	93	60-130
Dichloropropene, 1,3-trans-	<0.5 ug/L	86	60-130
Tetrachloroethylene	<0.3 ug/L	90	60-130

Guideline = ODWSOG

*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

QC Summary

Analyte	Blank	QC % Rec	QC Limits
Toluene	<0.4 ug/L	88	60-130
Trichloroethylene	<0.3 ug/L	89	60-130
Trichlorofluoromethane	<0.5 ug/L	80	60-130
Vinyl Chloride	<0.2 ug/L	79	60-130
Run No 435458 Analysis/Extraction Date 2022-12-20 Analyst PJ Method EPA 8260			
Xylene Mixture			

Guideline = ODWSOG

* = Guideline Exceedence

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

Certificate of Analysis

Client: Paterson Group
9 Auriga Dr
Nepean, ON
K2E 7T9
Attention: Mr. Alex Schopf
PO#: 56114
Invoice to: Paterson Group

Report Number: 1989429
Date Submitted: 2022-11-04
Date Reported: 2022-12-20
Project: PH4559
COC #: 902536

Sample Comment Summary

Sample ID: 1660784 GW1 F2-F4 MRLs are elevated due to insufficient sample volume.

Guideline = ODWSOG*** = Guideline Exceedence**

Results relate only to the parameters tested on the samples submitted.
Methods references and/or additional QA/QC information available on request.

MRL = Method Reporting Limit, AO = Aesthetic Objective, OG = Operational Guideline, MAC = Maximum Acceptable Concentration, IMAC = Interim Maximum Acceptable Concentration, STD = Standard, PWQO = Provincial Water Quality Guideline, IPWQO = Interim Provincial Water Quality Objective, TDR = Typical Desired Range

TW1 inputs			
pH	7.44	A	0.21
TDS	1250	B	2.35
Calcium	102	C	1.61
Alkalinity	315	D	2.50
Temp.	11.8		
		pHs =	7.749215673

Langelier Saturation Index (LSI) Calculation		(Langelier, 1936)
$LSI = pH - pH_s$ $pH_s = (9.3 + A + B) - (C + D)$ <p>Where:</p>		$A = (\log_{10} [TDS] - 1) / 10$ $B = -13.12 \times \log_{10} (oC + 273) + 34.55$ $C = \log_{10} [Ca^{2+} \text{ as } CaCO_3] - 0.4$ $D = \log_{10} [\text{alkalinity as } CaCO_3]$
		LSI = -0.3
LSI	Effect	
0.5 to 2	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive)	
0 to 0.5	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (slightly scale forming and corrosive).	
0	Water is saturated (in equilibrium) with calcium carbonate. A scale layer of calcium carbonate is neither precipitated nor dissolved.	
0 to -0.5	Water is under saturated and tends to dissolve solid calcium carbonate (slightly corrosivebut non-scale forming).	
-0.5 to -2	Water is under saturated and tends to dissolve solid calcium carbonate (seriously corrosive).	



Manganese in Drinking Water Fact Sheet

WHAT IS MANGANESE?

Manganese is a naturally occurring element that is an essential nutrient for humans and animals. It is found in many foods, as well as in air, water, soil, and rocks.¹ Manganese makes up 0.1% of the Earth's crust, and can be found as a component of other minerals like sulfides, oxides, carbonates, and silicates.² Manganese is used in the manufacture of various products including iron and steel alloys, batteries, glass, fireworks, fertilizers, cosmetics, paints, and cleaning and disinfection products.^{1,2} Manganese can also be purchased as a nutritional supplement.²

HOW DOES MANGANESE GET INTO DRINKING WATER?

Manganese is naturally occurring in many surface and ground waters. Manganese can also be dissolved from soils, sand and rocks to enter surface and ground waters.¹ Human activities like mining, industrial discharges, or landfills may also contribute to manganese in surface and ground waters.^{1,2} In general, manganese can be found at higher concentrations in groundwater compared to surface water.² Some lakes and reservoirs can also have higher levels of manganese due to natural water chemistry.²

Permanganate, a compound that contains manganese, may also be added to water during the treatment of drinking water to remove other chemicals (e.g., for the removal of iron).^{2,3}

HOW DOES MANGANESE INTAKE AFFECT MY HEALTH?

Too much or too little manganese in your body can lead to health problems.

Manganese deficiency: Manganese deficiency is rare and symptoms are not well defined. Health effects observed in individuals with diets very low in manganese include skin rashes, slow nail growth, reduced bone density, loss of pigmentation in hair, and low cholesterol levels.²

Manganese excess: There are few reports of adverse health effects from people who ingest too much manganese from food and water.¹ Recent evidence reviewed by Health Canada indicates that high levels of manganese in drinking water may impact memory and learning, behaviour, and fine motor control in infants and young children.^{2,4} Formula-fed infants may be more susceptible to health risks if water with high concentrations of manganese is used to prepare formula. This is because infant brains are rapidly developing, they drink more water in proportion to their body weight, and they absorb more manganese and are less able to remove

it from their bodies compared to other age groups.³ For adults and older children, short term exposure to manganese in drinking water at levels slightly above the guideline is unlikely to cause negative health effects.³

Health Canada notes that exposure to manganese while showering (either through breathing in water vapour or absorption through skin) is likely to be negligible.²

WHAT ARE THE LEVELS OF MANGANESE FOUND IN CANADIANS?

For most Canadians, diet is the main source of manganese. The Canadian Health Measures Survey (CHMS) is a national survey that collects information about the general health of Canadians and includes measurements of chemicals in blood and urine samples.⁵ The objective of the chemical measurements in the CHMS survey is to establish baseline levels in the Canadian population. Given that manganese is an essential trace element, its presence in the blood and urine of Canadians is expected. Manganese in blood and urine can be interpreted as an indicator of exposure, but does not necessarily mean that health effects will occur.⁵ Data collected from 2007 to 2011 for the CHMS found that the average levels of manganese measured in the blood of people in the Canadian population (aged 3 to 79) ranged from 8.8 – 11 µg/L.⁶ More information on the CHMS and the levels of manganese in Canadians can be obtained by visiting the Canadian Biomonitoring Dashboard.⁶

ARE THERE STANDARDS FOR MANGANESE IN DRINKING WATER?

The Ontario Drinking Water Standard (ODWS) published in 2006 sets an aesthetic objective for manganese in drinking water at 0.05 mg/L.⁷ The aesthetic objective is not intended to prevent health effects (e.g., not a health-based standard), but instead is intended to prevent the discolouration and staining of fixtures, and the undesirable taste caused by higher levels of manganese in water.

The Canadian Drinking Water Guideline for manganese developed by Health Canada stipulates a maximum acceptable concentration (MAC) in drinking water of 0.12 mg/L and an aesthetic objective of 0.02 mg/L.² The MAC is a health-based value intended to be protective of neurological effects in infants, the most sensitive population, and therefore it is also protective for chronic exposure in children and adults.²

ARE THERE OTHER STANDARDS OR GUIDELINE VALUES FOR MANGANESE?

The main source of exposure to manganese is via food, with grains, nuts and vegetables contributing the most to a person's daily intake of manganese. The average dietary intakes of manganese across all age groups according to the Canadian Total Diet Study (TDS) were estimated to range between 44.0 to 61.3 µg/kg of bodyweight per day (based on data gathered from different Canadian cities for the TDS).² Health Canada has also established Adequate Intake Levels for manganese ranging with age or lifestage from 0.003 to 2.6 mg/day and Tolerable Upper Intake Levels ranging from 2 to 11 mg/day.⁸

Infant formula sold in Canada is regulated to contain a minimum of 5 µg of manganese per 100 available kilocalories (equivalent to 3.33 µg per 100 mL of ready-to-feed formula); a maximum amount of manganese has not been set for infant formula.⁹

HOW CAN I TELL IF MY DRINKING WATER HAS HIGH MANGANESE LEVELS?

Water testing is the only way to know if manganese is present. Although water with elevated levels of manganese may impart a bitter metallic taste, tint water purplish brown or black (water discolouration may occur at concentrations as low as 0.005 to 0.02 mg/L), and stain laundry and plumbing fixtures;^{2,10,11} but these issues can also be caused by other chemicals.

WHAT SHOULD I DO IF A HIGH LEVEL OF MANGANESE IS FOUND IN MY WELL WATER?

For households who do not obtain their drinking water from a municipal source, a residential drinking water treatment device may be an option to reduce manganese concentrations in drinking water. Options can be explored with professionals specialized in water treatment, but examples of treatment processes effective at removing manganese include reverse osmosis, ion exchange (including water softeners and other cation exchange systems) and oxidizing filters.² As with any water treatment system, it is important to follow the manufacturer's recommendations for operation and maintenance (e.g., replacement of filter media).

REFERENCES

1. United States Environmental Protection Agency (US EPA). Drinking Water Health Advisory for Manganese [Internet]. 2004. Available from: https://www.epa.gov/sites/default/files/2014-09/documents/support_cc1_magnese_dwreport_0.pdf
2. Health Canada. Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Manganese [Internet]. 2019. Available from: <https://www.canada.ca/en/health-canada/services/publications/healthy-living/guidelines-canadian-drinking-water-quality-guideline-technical-document-manganese.html>
3. Health Canada. Water Talk - Manganese in drinking water [Internet]. 2023. Available from: <https://www.canada.ca/en/health-canada/services/environmental-workplace-health/reports-publications/water-quality/water-talk-manganese.html>
4. HealthLink British Columbia. Manganese in Drinking Water [Internet]. Available from: <https://www.healthlinkbc.ca/healthlinkbc-files/manganese-drinking-water>
5. Health Canada. Second Report on Human Biomonitoring of Environmental Chemicals in Canada: Manganese [Internet]. 2013. Available from: <https://www.canada.ca/en/health-canada/services/environmental-workplace-health/reports-publications/environmental->

contaminants/second-report-human-biomonitoring-environmental-chemicals-canada-health-canada-2013.html#a8.9

6. Government of Canada. Canadian Biomonitoring Dashboard [Internet]. 2024. Available from: <https://health-infobase.canada.ca/biomonitoring/about.html>
7. Ontario Ministry of the Environment, Conservation and Parks. Technical Support Document for Ontario Drinking Water Standards, Objectives and Guidelines [Internet]. 2006. Available from: <https://wcwc.ca/wp-content/uploads/2021/08/Technical-Support-Document-for-Ontario-Drinking-Water-Standards-Objectives-and-Guidelines.pdf>
8. Health Canada. Dietary reference intakes tables: Reference values for elements [Internet]. 2023. Available from: <https://www.canada.ca/en/health-canada/services/food-nutrition/healthy-eating/dietary-reference-intakes/tables/reference-values-elements.html#tbl2>
9. Government of Canada. Food and Drug Regulations (C.R.C., c. 870) [Internet]. Available from: https://lois-laws.justice.gc.ca/eng/regulations/C.R.C.%2C_c._870/page-53.html
10. United States Environmental Protection Agency (US EPA). Secondary Drinking Water Standards: Guidance for Nuisance Chemicals [Internet]. 2024. Available from: <https://www.epa.gov/sdwa/secondary-drinking-water-standards-guidance-nuisance-chemicals>
11. World Health Organization (WHO). Manganese in drinking-water: Background document for development of WHO Guidelines for drinking-water quality [Internet]. 2021. Available from: <https://www.who.int/publications/i/item/WHO-HEP-ECH-WSH-2021.5>

Please note: This fact sheet was created by Ottawa Public Health in consultation with Public Health Ontario.

Manganese in Drinking Water Fact Sheet [Last updated: September 12, 2024]

Certificate of Completion



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

For the use and operation of an on-site sewage disposal system in accordance with the Sewage System Permit.
This certifies that the on-site sewage system conforms to the Ontario Building Code and Ontario Regulation 332/12 as amended by Ontario Regulation 151/13

Sewage System Permit Number	18-222	Issued to	GREG WHALEN
Legal Description	Lot	Concession	Sub. Lot
Municipal Address: 158 Cardevco		Registered/Reference Plan	
In the former Township/City of West Carleton - Huntley		Within the City of Ottawa	

Details Pertaining to System: Replacement

- a) Type of System: Class 4 sewage system BMEC Area Bed
- b) ☒ New ☐ Existing Septic tank with a working capacity of 4500 litres constructed of Concrete
- c) Trench bed: metres of mm laid in runs of m and fed by Loading Area m³
- d) Filter bed: Stone m³ Loading Area m³ Ex. Base Pipe Fed by
- e) Shallow Buried Trench: metres of millimetre diameter distribution pipe laid in runs at metres
- f) Area Bed: Stone m³ Sand 122 m³ Pipe 2 runs @ 8 Eljen Fed by Gravity
- g) Effluent Filter: Manufacturer Tuf-Tite Model EF-6
- h) Sewage Treatment Unit(s):* Manufacturer Eljen Model GSF A-42 (x16)
- i) Maintenance Contract:* Rideau Valley Septic Services Expiry Date* JUNE 22, 2019
- j) Other:

Service provider must have Manufacturer Certification

Certificate Issued By:

Director of Regulations Aison Hult Date Issued JULY 12, 2018
Ottawa Septic System Office

July 2014
2K12-1547-OSSO

Certificate of Completion



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

For the use and operation of an on-site sewage disposal system in accordance with the Sewage System Permit.
This certifies that the on-site sewage system conforms to the Ontario Building Code and Ontario Regulation 332/12 as amended by Ontario Regulation 151/13

Sewage System Permit Number	18-222	Issued to	GREG WHALEN
Legal Description	Lot	Concession	Sub. Lot
			Registered/Reference Plan

Municipal Address: 158 Cardevco

In the former Township/City of West Carleton - Huntley

Within the City of Ottawa

Details Pertaining to System: Replacement

- a) Type of System: Class 4 sewage system BMEC Area Bed
- b) ☒ New ☐ Existing Septic tank with a working capacity of 4500 litres constructed of Concrete
- c) Trench bed: metres of mm laid in runs of m and fed by Loading Area m²
- d) Filter bed: Stone m² Loading Area m² Ex. Base Pipe Fed by
- e) Shallow Buried Trench: metres of millimetre diameter distribution pipe laid in runs at metres
- f) Area Bed: Stone m² Sand 122 m² Pipe 2 runs @ 8 Eljen Fed by Gravity
- g) Effluent Filter: Manufacturer Tuf-Tite Model EF-6
- h) Sewage Treatment Unit(s):* Manufacturer Eljen Model GSF A-42 (x16)
- i) Maintenance Contract:* Rideau Valley Septic Services Expiry Date* JUNE 22, 2019
- j) Other:

Service provider must have Manufacturer Certification

Certificate Issued By:

Director of Regulations Cason Huntley Date Issued JULY 12, 2018
Ottawa Septic System Office

July 2014
2K12-1547-OSSO

Batch # 11471
Entry #: 1

Page: 1

Rideau Valley C. A.

P.O. Box 599
Manotick, Ontario K4M 1A5
Canada
Phone: (613) 692-3571
Fax: (613) 692-0831

DOCUMENT NO.: PY000030647

DATE: 5/23/2018

AMOUNT RECEIVED

936.00 CAD

FROM Doug Norton

SIGNATURE


PAID BY: DEBITC

CHECK/RECEIPT NO.: 000011471-00001

DATE RECEIVED: 5/23/2018

DESCRIPTION		AMOUNT
4300-20-20600	158 Cardevco (HUN) Septic 18-222 - Part 8	936.00
SUB-TOTAL:		936.00
TOTAL:		936.00

PRELIMINARY ELJEN BED

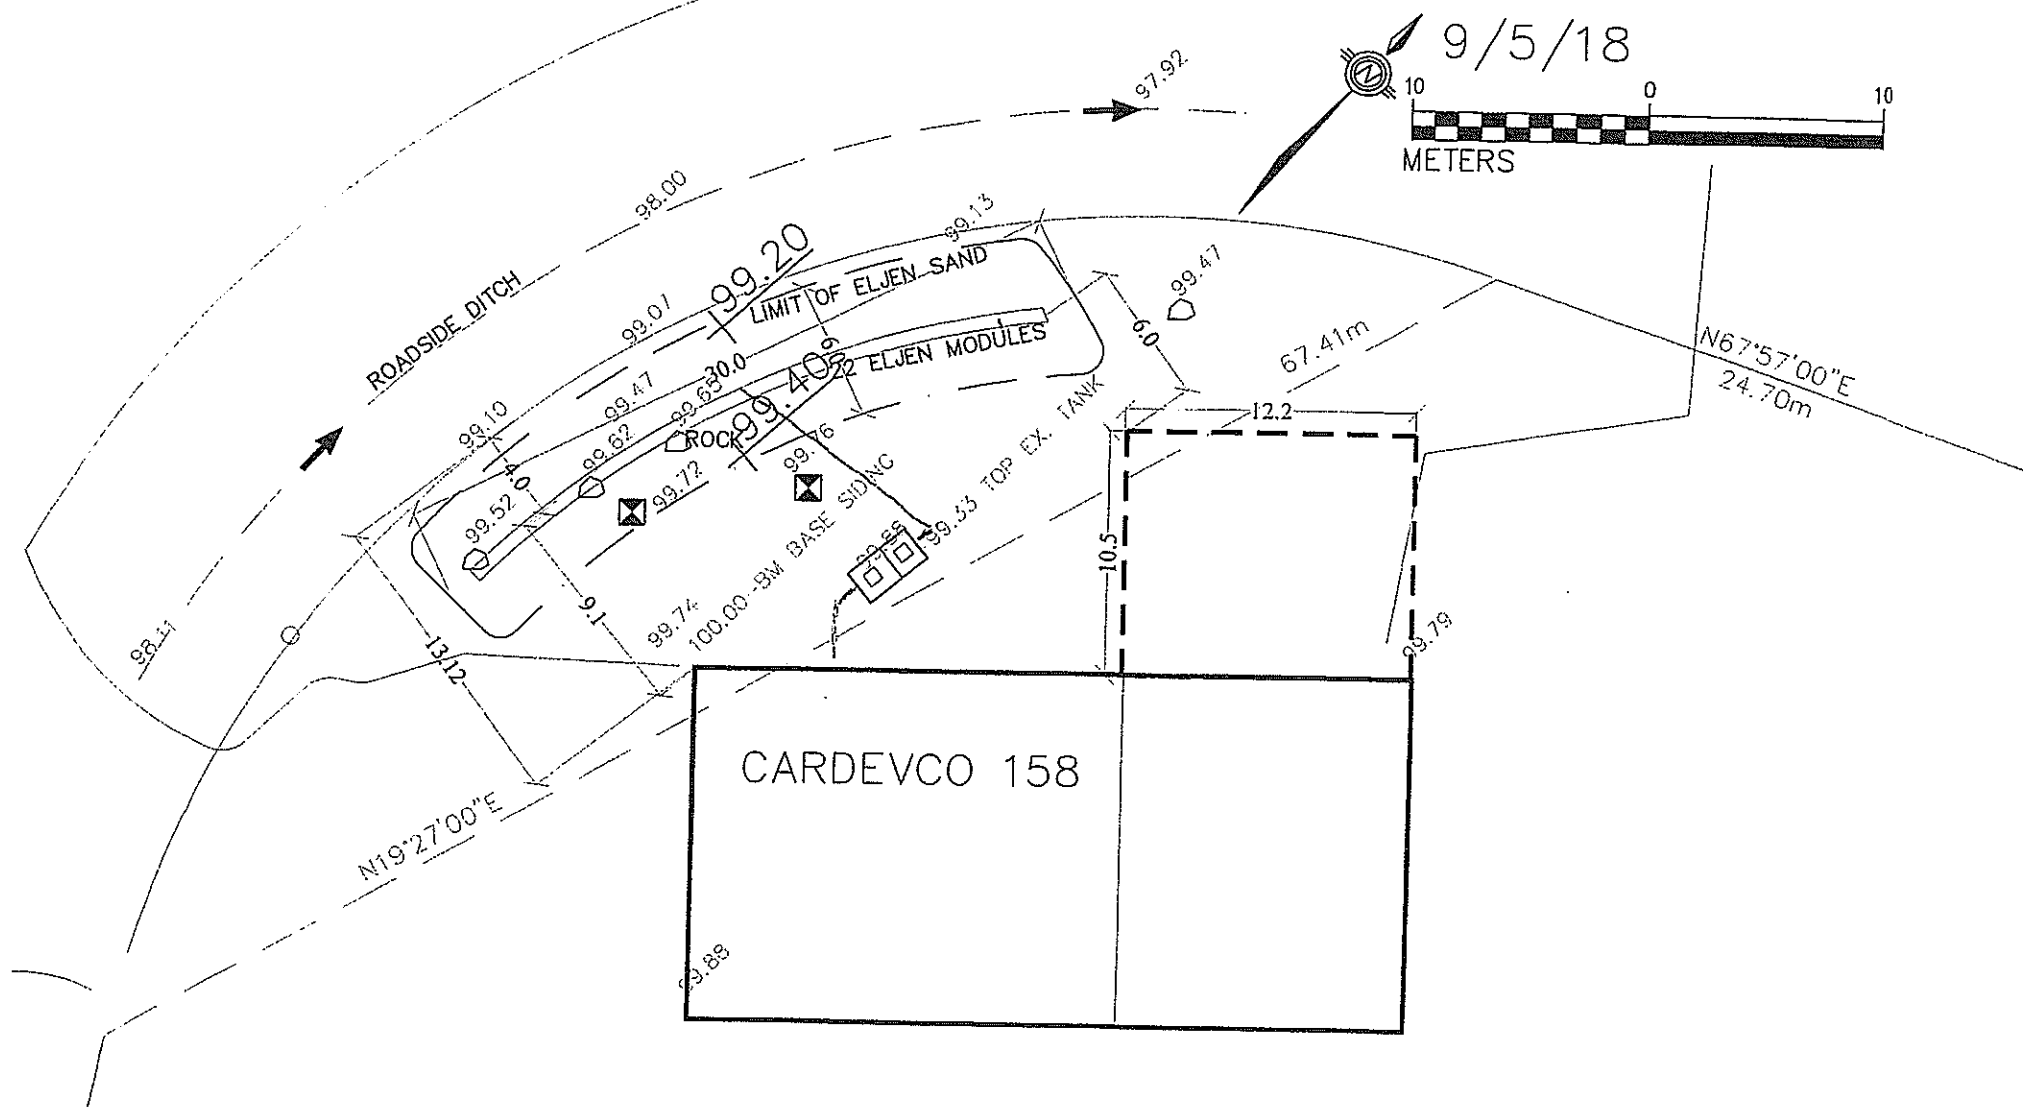

Certificate of Completion



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

For the use and operation of an on-site sewage disposal system in accordance with the Sewage System Permit.
This certifies that the on-site sewage system conforms to the Ontario Building Code and Ontario Regulation 332/12 as amended by Ontario Regulation 151/13

Sewage System Permit Number	18-222	Issued to	GREG WHALEN
Legal Description	Lot	Concession	Sub. Lot
			Registered/Reference Plan

Municipal Address: 158 Cardevco

In the former Township/City of West Carleton - Huntley

Within the City of Ottawa

Details Pertaining to System: Replacement

- a) Type of System: Class 4 sewage system BMEC Area Bed
- b) ☒ New ☐ Existing Septic tank with a working capacity of 4500 litres constructed of Concrete
- c) Trench bed: metres of mm laid in runs of m and fed by Loading Area m²
- d) Filter bed: Stone m² Loading Area m² Ex. Base Pipe Fed by
- e) Shallow Buried Trench: metres of millimetre diameter distribution pipe laid in runs at metres
- f) Area Bed: Stone m² Sand 122 m² Pipe 2 runs @ 8 Eljen Fed by Gravity
- g) Effluent Filter: Manufacturer Tuf-Tite Model EF-6
- h) Sewage Treatment Unit(s):* Manufacturer Eljen Model GSF A-42 (x16)
- i) Maintenance Contract:* Rideau Valley Septic Services Expiry Date* JUNE 22, 2019
- j) Other:

Service provider must have Manufacturer Certification

Certificate Issued By:

Director of Regulations Caron Hunt Date Issued JULY 12, 2018
Ottawa Septic System Office

July 2014
2K12-1547-OSSO



Corporation des Services
System Office - Bureau des systèmes
techniques d'Ottawa

3889 Rideau Valley Drive Box 599 Manotick, ON K4M 1A5

Phone: 613-892-3571 1-800-267-3504 Fax: 613-692-1507

Scan - Email -Phone
Folder - CanadaPost -PickUp Box

Email: 'septic@ovca.ca'

Address of property: 158 Casanova

Township: OSG HUN-GLO-FIT-CUM-NEP-GOU-RID-KAN

Contact for pickup: Theresa Ege

Phone#/Email:

INFORMATION FOR OWNER/APPLICANT

Attached is your Sewage System Permit. A minimum of two inspections are required before your proposed sewage system can be approved for use (additional inspections may be required for clay soils/bedrock and/or re-inspections). Inspections must be requested in writing. Please see attached:

- Inspection fax request form (all inspections MUST be requested in writing)
- As-built components and drawing form
- Copy of the approved application and schedule pages
- Approved Part 8 permit (applicant copy - YELLOW)(CITY copy#2 - PINK ** Agent Deliver Direct To City**)

Special Note

- A permit is valid for 12 months from the original date of issuance noted in "permit date". If lapsed, it may be renewed only once for a period of 12 months from the date of expiry.

- No person shall make a material change or cause a material change to be made to a plan, specification, document or other information on the basis of which a permit was issued without notifying, filing details with and obtaining the authorization of the Chief Building Official. (Building Code Act 1992, c.23, s.8(12))

Sewage System Permit Construction Requirements

1. Clay Soils/Bedrock only (if required per issued Approval)

In clay soils/bedrock, a site preparation inspection is required. The total contact area must be properly prepared. Scarification must be done under dry conditions prior to importing leaching bed fill.

2. Installation Inspection - 2nd inspection

When the sewage system is substantially completed (i.e., before the final fill is placed over the septic tank and leaching bed system) an installation inspection is required. Prior to any inspection request, the following must be submitted:

- "as-built components" and "as-built drawings" — see attached form
- "engineer letter" — if the system is engineered
- grain size analysis and weight bills for all Filter Media types of septic systems
- Weight bills for washed septic stone, where applicable
- Maintenance/service contract for treatment unit installed

3. Final Grading Inspection - 3rd inspection

When construction of the sewage system is complete, a final grading inspection is required. Before a Certificate of Completion can be issued, the following must be complete:

- The leaching bed and septic tank must be covered with sand fill and topsoil and graded accordingly
- All conditions of the Sewage System Permit & comments on the installation inspection report must be met
- The depth of cover & material type must be identified by inspection pipes or holes placed over trenches at 4 corners of bed
- The 4 corners of the bed must be staked



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

Main Phone: 613-692-3571 x 1129

Inspection Request Form

Complete and fax to: 613-692-1507 or e-mail: septic@rvca.ca

Section A. Property and General Information			
Date Submitted			Septic File Number:
Civic Address			
Former Township	<input type="checkbox"/> Osgoode <input type="checkbox"/> Cumberland <input type="checkbox"/> Goulbourn <input type="checkbox"/> Torbolton <input type="checkbox"/> Nepean		
Property Owner	<input type="checkbox"/> Huntley <input type="checkbox"/> Rideau <input type="checkbox"/> Gloucester <input type="checkbox"/> Fitzroy <input type="checkbox"/> Kanata <input type="checkbox"/> Ottawa		

Section B. Requestor Information			
Name of Requestor			Phone Number:
E-mail			Fax Number:
I am the (check one)	<input type="checkbox"/> Installer <input type="checkbox"/> Engineer <input type="checkbox"/> Property Owner		

Section C. I am Requesting the following:			
<input type="checkbox"/> 1 st - Subgrade (If required - check one):	<input type="checkbox"/> 2 nd - Installation Inspection (Check all that apply)	<input type="checkbox"/> 3 rd - Final Grade Inspection	
<input type="checkbox"/> Scarification	Refer to attached:	Note: Topsoil must be applied unless winter conditions exist at Director's discretion All deficiencies must be addressed from installation report	
<input type="checkbox"/> Clay Seal	<input type="checkbox"/> As-Built Components Page		
<input type="checkbox"/> Subgrade	<input type="checkbox"/> As-Built Drawing		
	<input type="checkbox"/> Engineers Letter		
	<input type="checkbox"/> Filter Media Bills		
	<input type="checkbox"/> Grain Size Analysis		
	<input type="checkbox"/> Maintenance Agreement		
	<input type="checkbox"/> ESA Permit Number:		
Notes/Comments			

Section D. Re-inspection			
<input type="checkbox"/> Re-inspection - 1 st call	<input type="checkbox"/> Re-inspection Request - 2 nd call		
	Note: Re-inspection fee applies on requests for same deficiency - Please provide payment information below		
	Card Type:	<input type="checkbox"/> Mastercard	<input type="checkbox"/> Visa
	Card Number:		
	Cardholder Name:	Expiry:	
Notes/Comments			

Please Note:

- 3-5 business day turn around for inspections
- OSSO file will be given to inspector upon receipt of this request form
- PRIORITY will be given to requests that have septic file/permit numbers

Submit	Reset	Print
--------	-------	-------

SEPTIC PERMIT NO. _____

AS-BUILT COMPONENTS

(required prior to installation inspection)

Elevations of installed system must be supplied with this report (in reference to the TBM).
Exact size and location of all structures, well(s) and system(s) and its components must be shown (including neighbouring lots).

Septic/Holding Tank: _____ L

Manufacturer: _____

☐ concrete ☐ plastic ☐ other

Filter: ☐ no ☐ yes _____ make

Treatment: Make _____

Unit: Model _____

Diameter of pipes _____ mm/inches

Make of pipes: _____

Ends: ☐ capped ☐ interconnected

Number of runs: _____ m

Length of runs: _____ m

Stone area _____ m²

Filter media:

Amount Purchased: _____ kg

Date Purchased: _____

Supplier: _____

Grain/size analysis by: _____

Analysis dated: _____

Stone:

Amount Purchased: _____ kg

Date Purchased: _____

Supplier: _____

Name of owner: _____

Installer: _____

Installer Signature: _____

License Number: _____

Date of Installation: _____

Pump Systems:

ESA Permit #: _____

Volume discharge rates: _____ /15min

Alarm location: _____

Dimension of Pump Chamber: _____

Height of Float Switch: _____


Grease Interceptor:

☐ no ☐ yes Size: _____

Location: _____

*** Grain Size Analysis and weight bills must be supplied with this report.**

All rights reserved. No part of this work may be reproduced or used in any form without the prior written permission of the copyright holder.

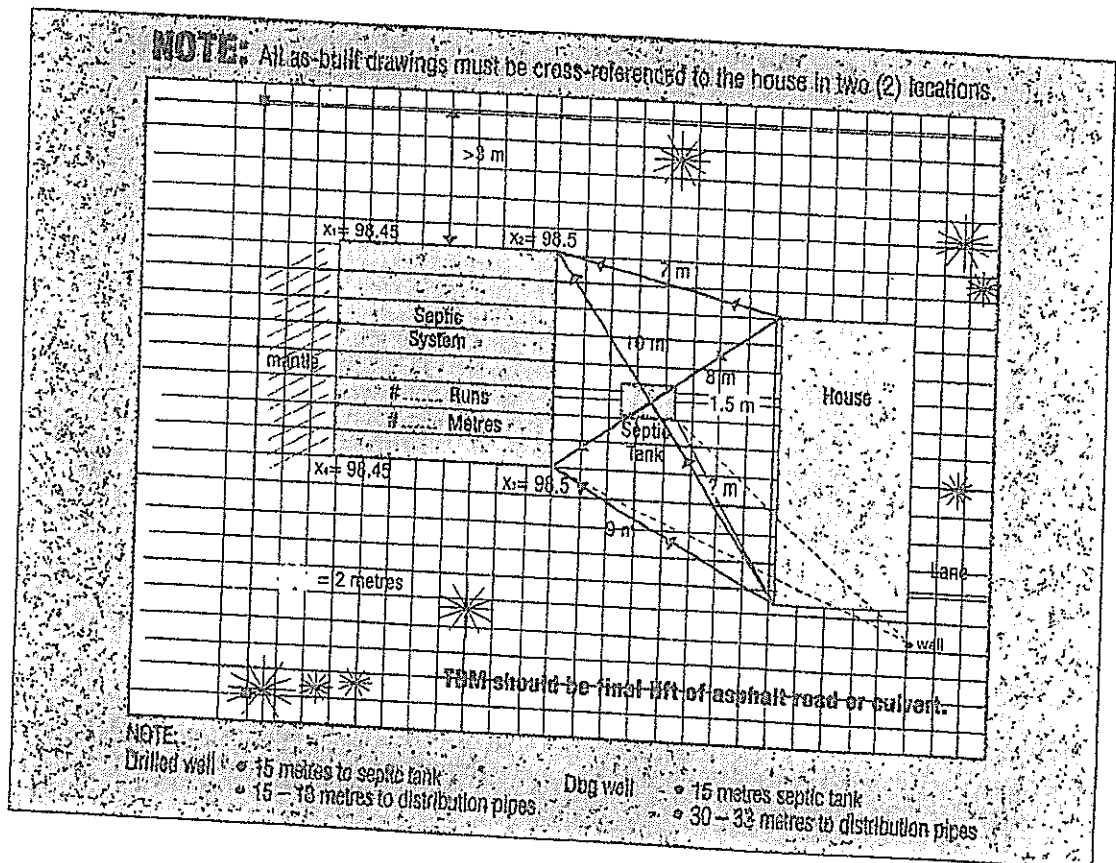

AS-BUILT DRAWING



Scale: 1" = 1 metre

SEPTIC PERMIT NO.

Batch # 11471

Entry #: 1

Page: 1

Rideau Valley C. A.

P.O. Box 599
Manotick, Ontario K4M 1A5
Canada

Phone: (613) 692-3571

Fax: (613) 692-0831

DOCUMENT NO.: PY000030647

DATE: 5/23/2018

AMOUNT RECEIVED

936.00 CAD

FROM Doug Norton

SIGNATURE

PAID BY: DEBITC

CHECK/RECEIPT NO.: 000011471-00001

DATE RECEIVED: 5/23/2018

DESCRIPTION		AMOUNT
4300-20-20600	158 Cardevco (HUN) Septic 18-222 - Part 8	936.00
SUB-TOTAL:		936.00
TOTAL:		936.00


If you are using a web browser other than Microsoft Internet Explorer, please use the Export button to save this report as Word or pdf. You can then print the saved document.

Ottawa PROPERTY INFORMATION
INFORMATION SUR LA PROPRIÉTÉ Run On: 5/17/2018 5:28:10 AM

168 CARLETON RD PIN: 045350142

LEGAL DESCRIPTION / DESCRIPTION OFFICIELLE

PIN: 045350142
LEGAL DESCRIPTION / DESCRIPTION OFFICIELLE
PLAN 4M-356 PT BLK 10 & 11, RP 4R7593 PARTS 1 & 2 RP 4R7616
PARTS 19 TO 22

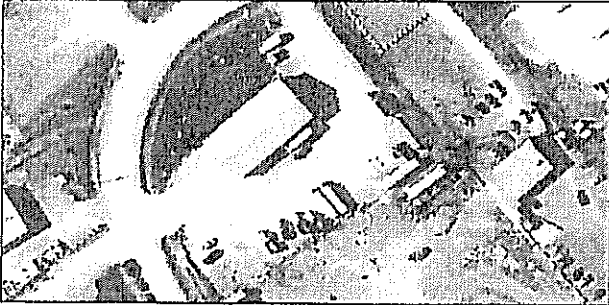

PROPERTY DIMENSIONS / DIMENSIONS DE LA PROPRIÉTÉ

FRONTAGE - ft / FACADE - pi	045350142
DEPTH - ft / PROFONDEUR - pi	0 00
PROPERTY AREA - acre / SUPERFICIE - acre	0 00
	1.2100

SERVICES / SERVICES

PIN	WASTE COLLECTION PICK-UP DAY AND ZONE / JOUR ET ZONE DE LA COLLECTE DES ORDURES
045350142	Z1 W/ TUE A

WARD INFORMATION / INFORMATIONS WARD

PIN	WARD NUMBER / NUMÉRO DU QUARTIER	WARD NAME / NOM DU QUARTIER	COUNCILLOR NAME / NOM DU CONSEILLER - (ERE)
045350142	5	WEST CARLETON- MARCH	59 El Chantry

Page 1 of 1

CHANGE =
TDL WEST

R.V.C.A. RECEIVED

MAY 17 2018

REFER TO:

2

Application for a Permit to Construct or Demolish

This form is authorized under subsection 8(1.1) of the Building Code Act, 1992

For use by Principal Authority			
Application number: R.V.C.A. RECEIVED		Permit number (if different):	
Date received: MAY 17 2018		Roll number:	
REFER TO: OTTAWA SEPTIC SYSTEM OFFICE			
Application submitted to: _____ (Name of municipality, upper-tier municipality, board of health or conservation authority)			
A. Project information			
Building number, street name 158 Cardevco Rd		Unit number	Lot/con.
Municipality Carp / HUNTER	Postal code K0A 1L0	Plan number/other description 4m 356	
Project value est. \$		Area of work (m ²)	
B. Purpose of application			
New construction		Addition to an existing building	
		Alteration/repair	
		Demolition	
		Conditional Permit	
Proposed use of building Com / Truck Shop		Current use of building Same	
Description of proposed work CLASS II PRIVATE SEWAGE INSTALLATION REPLACE SEPTIC SYSTEM SITE LOCATION - NORTH ON CARP RD FROM RICHARDSON SIDE RD. FROM - LEFT ON CARDEVCO RD. - 250m - CIVIC # 158			
C. Applicant			
Applicant is: Owner or		Authorized agent of owner ON RIGHT	
Last name		First name	Corporation or partnership
Street address		Unit number	Lot/con.
Municipality	Postal code	Province	E-mail
Telephone number ()	Fax ()	Cell number ()	
D. Owner (if different from applicant)			
Last name Whalen		First name Greg	Corporation or partnership TDL WEST
Street address 158 Cardevco Rd		Unit number	Lot/con.
Municipality	Postal code K0A 1L0	Province	E-mail
Telephone number (613) 831 7677	Fax ()	Cell number greg.whelan@TDLWEST.COM	

Application for a Permit to Construct or Demolish -- Effective January 1, 2014

OSSO version June 2014

****Commercial****

E. Builder (optional)				
Last name		First name		Corporation or partnership (if applicable)
Street address		Unit number		Lot/con.
Municipality		Postal code	Province	E-mail
Telephone number ()		Fax ()	Cell number ()	

R.V.C.A. RECEIVED
 MAY 17 2018
 REFER TO:

F. Tarion Warranty Corporation (Ontario New Home Warranty Program)		
i. Is proposed construction for a new home as defined in the <i>Ontario New Home Warranties Plan Act</i> ? If no, go to section G.	Yes	No <input checked="" type="checkbox"/>
ii. Is registration required under the <i>Ontario New Home Warranties Plan Act</i> ?	Yes	No <input checked="" type="checkbox"/>
iii. If yes to (ii) provide registration number(s): _____		

G. Required Schedules		
i) Attach Schedule 1 for each individual who reviews and takes responsibility for design activities.		
ii) Attach Schedule 2 where application is to construct on-site, install or repair a sewage system.		

H. Completeness and compliance with applicable law		
i) This application meets all the requirements of clauses 1.3.1.3 (5) (a) to (d) of Division C of the <i>Building Code</i> (the application is made in the correct form and by the owner or authorized agent, all applicable fields have been completed on the application and required schedules, and all required schedules are submitted). Payment has been made of all fees that are required, under the applicable by-law, resolution or regulation made under clause 7(1)(c) of the <i>Building Code Act, 1992</i> , to be paid when the application is made.	Yes <input checked="" type="checkbox"/>	No
ii) This application is accompanied by the plans and specifications prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> .	Yes <input checked="" type="checkbox"/>	No
iii) This application is accompanied by the information and documents prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> which enable the chief building official to determine whether the proposed building, construction or demolition will contravene any applicable law.	Yes <input checked="" type="checkbox"/>	No
iv) The proposed building, construction or demolition will not contravene any applicable law.	Yes <input checked="" type="checkbox"/>	No

I. Declaration of applicant	
I, <u>Graig Whelan</u> declare that: (print name)	
1. The information contained in this application, attached schedules, attached plans and specifications, and other attached documentation is true to the best of my knowledge. 2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.	
Date <u>May 14 2018</u>	Signature of applicant <u>[Signature]</u>

Personal information contained in this form and schedules is collected under the authority of subsection 8(1.1) of the *Building Code Act, 1992*, and will be used in the administration and enforcement of the *Building Code Act, 1992*. Questions about the collection of personal information may be addressed to: a) the Chief Building Official of the municipality or upper-tier municipality to which this application is being made, or, b) the inspector having the powers and duties of a chief building official in relation to sewage systems or plumbing for an upper-tier municipality, board of health or conservation authority to whom this application is made, or, c) Director, Building and Development Branch, Ministry of Municipal Affairs and Housing 777 Bay St., 2nd Floor, Toronto, M5G 2E5 (416) 585-6666.

R.V.C.A. RECEIVED

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.


A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality		Postal code	Plan number/ other description
B. Individual who reviews and takes responsibility for design activities			
Name		Firm	
Street address		Unit no.	Lot/con.
Municipality	Postal code	Province	E-mail
Telephone number	Fax number	Cell number	
C. Design activities undertaken by individual identified in Section B. (Building Code Table 3.5.2.1 of Division C)			
House	HVAC – House	Building Structural	
Small Buildings	Building Services	Plumbing – House	
Large Buildings	Detection, Lighting and Power	Plumbing – All Buildings	
Complex Buildings	Fire Protection	On-site Sewage Systems	
Description of designer's work			
D. Declaration of Designer			
I, <u>JONATHAN MAYBURY</u> , declare that (choose one as appropriate):			
(print name)			
I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories.			
Individual BCIN: <u>12924</u>			
Firm BCIN: <u>26787</u>			
I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code.			
Individual BCIN: _____			
Basis for exemption from registration: _____			
The design work is exempt from the registration and qualification requirements of the Building Code.			
Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge.			
2. I have submitted this application with the knowledge and consent of the firm.			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) (c) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of practice, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.


R.V.C.A. RECEIVED

Schedule 2: Sewage System Installer Information

A. Project Information		MAY 17 2018		Unit number	Lot/con.
Building number, street name		156 CARDELLA RD			
Municipality	Postal code	Plan number/ other description			
OTTAWA-LANARK	K1P 1G1	4M 356 B44 10/11			
B. Sewage system installer					
Is the installer of the sewage system engaged in the business of constructing on-site, installing, repairing, servicing, cleaning or emptying sewage systems, in accordance with Building Code Article 3.3.1.1, Division C?					
Yes (Continue to Section C)		No (Continue to Section E)		Installer unknown at time of application (Continue to Section E)	
C. Registered installer information (where answer to B is "Yes")					
Name			BCIN		
ALL IN ONE SEPTIC + EX.			36933		
Street address			Unit number	Lot/con.	
Municipality	Postal code	Province	E-mail		
Telephone number ()	Fax ()	Cell number ()			
D. Qualified supervisor information (where answer to section B is "Yes")					
Name of qualified supervisor(s)			Building Code Identification Number (BCIN)		
GARNET NORTON			15470		
DUB NORTON			10586		
E. Declaration of Applicant:					
I, <u>G. WHITEYLAN</u> declare that:					
(print name)					
I am the applicant for the permit to construct the sewage system. If the installer is unknown at time of application, I shall submit a new Schedule 2 prior to construction when the installer is known;					
OR					
I am the holder of the permit to construct the sewage system, and am submitting a new Schedule 2, now that the installer is known.					
I certify that:					
1. The information contained in this schedule is true to the best of my knowledge.					
2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.					
Date		Signature of applicant			
MAY 14 2018					



Ottawa Septic System Office Bureau des systèmes septiques d'Ottawa

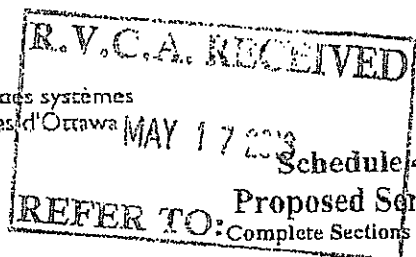

Do Not Complete
Permit No _____
Revision No _____
Date _____

1. Engineered

☐ Yes

☒ No

3. Type of work proposed

☐ New Installation

☒ Replacement

☐ Alteration

2. Water supply

☐ Proposed

☒ Existing

4. Type of Well

☐ Dug/bored/Sandpoint well

☒ Drilled well

☐ Municipal

☐ Other

5. Residential Sewage Design Flow Info.

Bedrooms _____

House (floor area) _____ m²

People _____

Total Fixture Units _____ (Schedule 8)

Residential Flow _____ L/day

6. Sewage Design Flow Other Occupancies

Actual Design Flow 1650 L/day DESIGNED
Detailed sewage flow calculations: FOR 14 EMPLOYEES
@ 75L PER PERSON 1500L

☒ Class 4 – BMEC Area Bed (Schedule 11)

☐ Fully raised

☐ Partially raised

☒ In-ground

☐ Class 4 – “Type A” Dispersal (Schedule 13)

☐ Fully raised

☐ Partially raised

☐ In-ground

☐ Class 4 – “Type B” Dispersal (Schedule 14)

☐ Fully raised

☐ Partially raised

☐ In-ground

☐ Class 5 – Holding Tank (9000L min)

☐ Tank/Treatment Unit/Pump Chamber ONLY

☐ Effluent Filter/Risers ONLY

7. Type of System ECJTSN

☒ Treatment Unit GSF-A-42

☐ Class 2 – Leaching Pit

☐ Class 3 – Cesspool

☐ Class 4 – Shallow Buried Trench

☐ Class 4 – Trench (Schedule 9)

☐ Fully raised

☐ Partially raised

☐ In-ground

☐ Class 4 – Filter Media (Schedule 10)

☐ Fully raised

☐ Partially raised

☐ In-ground



Ottawa Septic System Office Bureau des systèmes septiques d'Ottawa

R.V.C.A. RECEIVED
MAY 17 2018
Schedule 5
REFER TO: Sewage System Details

Do Not Complete
 Permit No _____
 Revision No _____
 Date _____

Type of System CLASS III PRIVATE SEWAGE SYSTEM (Schedule 4)
 Septic/Holding Tank Size: 4500 Litres^{min} Make: _____
 Septic Tank Effluent Filter Make: Y-E Model: _____

Treatment Unit – Make & Model FELJEN GSF-A42
 Number of Units: 16 Other: _____
 Refer to Typical Drawing # CAR 158D Pump(s) required N/A
 Mantle Information: Pump Rate _____ L/15min
 Native or imported = 15m in N/A direction(s) Note: Alarm required for all pumping systems
 Slope subgrade N/A % slope
 _____ direction(s)

Site to be Scarified (If clay) YES NO
 Clay Seal Required (If bedrock) YES NO

☐ Trench

Distribution Pipe Length _____ m
 Loading Area _____ m²
 Type of Chamber _____
 Length of Chamber _____ m

☐ Shallow Buried Trench

Pipe Length _____ m

☒ BMEC Area Bed

☐ Type A

☐ Type B

Stone _____ m²

FELJEN Sand 122 m²

Pipe _____ m

Linear Loading _____ L/m²

☐ Filter Media Bed

Stone _____ m²

Extended Base _____ m²

Pipe _____ m

Weight of Filter Media _____ Kg

Loading Area _____ m²


☐ Tank/Treatment Unit/Pump Chamber Replacement ONLY

☐ Effluent Filter & Riser ONLY

Construction Notes:



Ottawa Septic System Office Bureau des systèmes septiques d'Ottawa

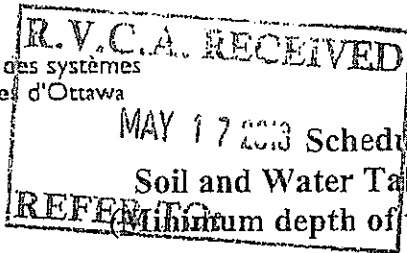

Do Not Complete
 Permit No _____
 Revision No _____
 Date _____

Name of Applicant/Agent: <u>J. B. MAYBURY</u> Date: <u>09-5-18</u> Time: <u>4:30 PM</u> Applicant/Agent Signature: <u>[Signature]</u>			Inspector: _____ Date: <u>May 18/18</u> Time: <u>11:15 AM</u> Inspector Signature: <u>[Signature]</u>		
EG <u>99.72</u>	Soil Description	T	EG (.....)	Soil Description	T
.5m	<u>COMPACT</u> <u>fill</u> <u>WATER</u> <u>COAM</u> <u>20-30</u> <u>BRG.</u>		.5m	<u>as per</u> <u>agent</u> <u>FILL</u> <u>interface</u> <u>Layer difficult to</u> <u>locate</u>	
1.0 m			1.0 m		
1.5m			1.5m		
2.0 m			2.0 m		
EG <u>99.72</u>	Soil Description	T	EG (.....)	Soil Description	T
.5m	<u>same</u>		.5m		
1.0 m			1.0 m		
1.5m			1.5m		
2.0 m			2.0 m		

LEGEND

BR = Bedrock	HGWT = High ground water table	EG = Existing grade
GWT = Ground water table	M = metres	T = percolation rate



Scale: 1Block = _____

R.V.C.A. R-1

Schedule 7

Layout Section

MAY 7 2018

REFER TO:

REFERENCE DRAWINGS BY

THIRD EYE TECH.

① CAR 150

② CAR 1500

oDug Well •Drilled Well ▲ Neighbouring Homes ◇Benchmark ---Tile Drainage —Property Line

Elevations (metric only)

B.M. _____ m

B.M Description _____

Exact Location _____

Min. of 5 elevations in proposed system area
(in X pattern)

X₁ _____ X₂ _____

X₃ _____ X₄ _____

X₅ _____ X₆ (loc) _____

X₇ _____ X₈ _____



Ottawa Septic System Office
Bureau des systèmes
septiques d'Ottawa

RECEIVED

MAY 17 2018
Schedule 8
Fixture unit count

Do Not Complete

Permit No _____

Revision No _____

Date _____

Fixtures

REFER TO:

Existing + # Proposed X unit count = Fixture Count

Bathroom							
Bathroom group (toilet, sink and tub or shower) with flush tank		+		X	6	=	
Bathtub with/without overhead shower		+		X	1.5	=	
Shower stall		+		X	1.5	=	
Wash basin (1½ inch trap)	3	+		X	1.5	=	4.5
Watercloset (toilet) tank operated	2	+		X	4	=	8.0
Bidet		+		X	1	=	
Kitchen							
Dishwasher		+		X	1	=	
Sink with/without garbage grinder(s), domestic and other small type single, double or 2 single with a common trap		+		X	1.5	=	
Other							
Domestic washing machine		+		X	1.5	=	
Combination sink and laundry tray single or double (Installed on 1½ trap)		+		X	1.5	=	

*Total: 12.5

*Insert the TOTAL in section 5 of Schedule 4 (O.Reg 151/13 Table 7.4.9.3)

1. Sump pumps and floor drains are not to be connected to the sewage system. Connection of such fixtures to a sewage system may lead to a hydraulic failure of the said system. The above mentioned fixtures should be discharged separately to an approved Class 2 (leaching pit) sewage system.
2. Where laundry waste is not more than 20% of the total daily design sanitary sewage flow, it may discharge to a sewage system (Part 8, OBC, 8.1.3.1(2)).

Agent/Owner signature

Date

158
CARDEVCO RD.
PRIVATE
SEWAGE SYSTEM
DEVELOPMENT PLAN

PLAN 4M 358
PART 8LK 10/11
RP 4R 7953
PARTS 1 & 2
RP 4R 7616
PARTS 19 & 22
CITY OF OTTAWA
(W. CARLETON)

DWG. #CAR 158
DRAWN BY: JBM
DATE: 16/5/18


J. D. MAYBURY o/a THIRD EYE TECH

©COPYRIGHT 2018

SCALE 1 : 250 (11 by 17 paper size)

10
0
10
METERS

REFER TO:
V.C.A. RECORD
MAY 17 2018

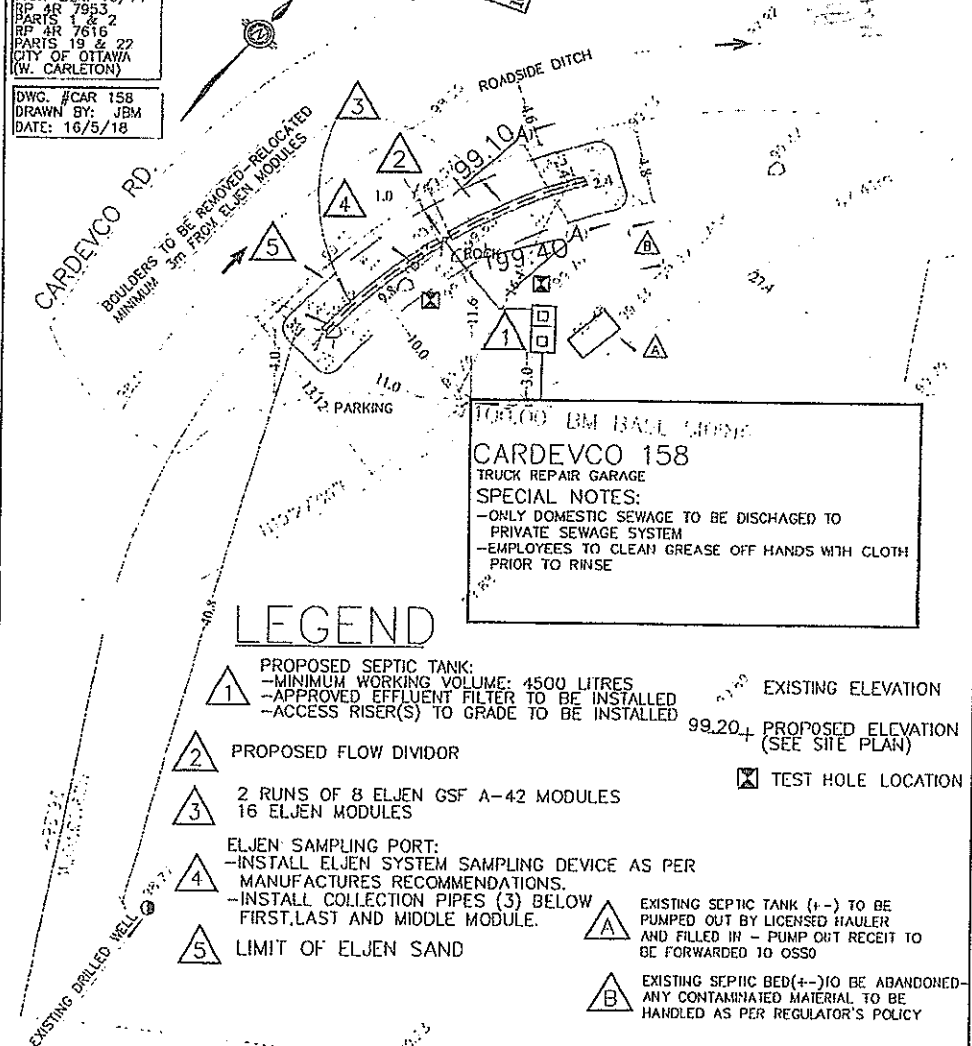

LEGEND

- 1 PROPOSED SEPTIC TANK:
-MINIMUM WORKING VOLUME: 4500 LITRES
-APPROVED EFFLUENT FILTER TO BE INSTALLED
-ACCESS RISER(S) TO GRADE TO BE INSTALLED
- 2 PROPOSED FLOW DIVIDOR
- 3 2 RUNS OF 8 ELJEN GSF A-42 MODULES
16 ELJEN MODULES
- 4 ELJEN SAMPLING PORT:
-INSTALL ELJEN SYSTEM SAMPLING DEVICE AS PER
MANUFACTURERS RECOMMENDATIONS.
-INSTALL COLLECTION PIPES (3) BELOW
FIRST, LAST AND MIDDLE MODULE.
- 5 LIMIT OF ELJEN SAND
- EXISTING ELEVATION
- 99.20+ PROPOSED ELEVATION
(SEE SITE PLAN)
- TEST HOLE LOCATION
- EXISTING SEPTIC TANK (+) TO BE
PUMPED OUT BY LICENSED HAULER
AND FILLED IN - PUMP OUT RECEIPT TO
BE FORWARDED TO OSSO
- EXISTING SEPTIC BED (+) TO BE ABANDONED-
ANY CONTAMINATED MATERIAL TO BE
HANDLED AS PER REGULATOR'S POLICY

NOTES:

- 1.0 THIS PLAN IS TO BE READ IN CONJUNCTION WITH THE SEWAGE SYSTEM PERMIT AND DWG #CAR 158-D.
- 2.0 THE SEPTIC TANK SYSTEM CONTRACTOR IS RESPONSIBLE TO CONTINUE ALL DESIGN REQUIREMENTS PRIOR TO COMMENCE WORK.
- 3.0 THE DEVELOPMENT AS PROPOSED IS UNDER THE DIRECTION OF THE OWNER/AGENT. THE OWNER/AGENT ASSUME FULL RESPONSIBILITY FOR DEVELOPMENT AS PROPOSED.
- 4.0 PROPERTY LINE/ENCUMBRANCE/LEGAL DESCRIPTION AND EXISTING/NEIGHBOURING WELL INFORMATION WAS PROVIDED BY OWNER OR THEIR AGENT, NOT THIRD EYE TECHNICAL SERVICE. THE OWNER OR THEIR AGENT ASSUME FULL RESPONSIBILITY FOR SCOPE & ACCURACY OF THIS INFORMATION AS DETAINED.
- 5.0 IT IS RECOMMENDED THAT THE INLET/OUTLET PIPES AND SEPTIC TANK BE INSULATED PRIOR TO BACKFILLING.
- 6.0 THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE LOCATION AND PROTECTION OF UTILITIES.
- 7.0 THE GRADING AND DRAINAGE DESIGN AS COMPLETED IS OF A GENERAL NATURE. ALL ELEVATIONS AND GRADING SPECIFICATIONS TO BE CONFIRMED BY THE CONTRACTOR PRIOR TO COMMENCE WORK.
- 8.0 ALL MEASUREMENTS AND ELEVATIONS ARE METRIC.
- 9.0 THIS PLAN NOT TO BE SCALED FOR LAYOUT.

CAUTION: THIS IS NOT A PLAN OF SURVEY
METRIC: DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048
BENCH MARK: THE BENCH MARK ELEVATION IS BASED ON LOCAL GEODETIC DATUM AND IS FOR USE ON THIS PROJECT ONLY.


THIRD EYE

Declaration of Engineer under section 2.17.4 of O.R.C.
Form ECR 1 (2018) - Issued 2018-01-01 - ECR 1 (2018)

5430 Riverdale Cr.
Mississauga, ON L4W 1G1
(905) 279-0602
e mail: jdm@thirdeye.ca

TECHNICAL SERVICE

ELJEN GSF A-42 MODULE BED PLAN VIEW NTS

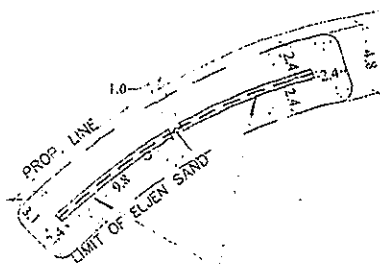

2 RUNS @ 8 ELJEN MODULES/RUN

NOTES:

- 1.0 SEPTIC TANK SYSTEM DESIGN IS BASED ON MAXIMUM 15 EMPLOYEES.
PLUMBING FIXTURE UNITS COUNT: 12.5
- 2.0 DESIGN DAILY SEWAGE VOLUME(Q): 14 * 75L = 1050L
NO. OF ELJEN GSF A-42 MODULES REQUIRED 0/95=1050/95=11
USE 2 RUNS OF 8 MODULES= 16 MODULES TOTAL
SAND AREA REQUIRED = 0.7/100 = 1050*0.7/100 = 73.5m²
SAND AREA PROVIDED: 127m²
- 3.0 THE CONSTRUCTION AND OPERATION OF THE PRIVATE SEWAGE SYSTEM SHALL CONFORM WITH ONTARIO REGULATION 332/12 AS AMENDED MADE UNDER THE BUILDING CODE ACT, 1992.
- 4.0 THE APPROVED TREATMENT UNIT SHALL BE INSTALLED AND OPERATED IN ACCORDANCE WITH THE OBC-SWCC AUTHORIZATION AND THE MANUFACTURER'S RECOMMENDATIONS.
- 5.0 ALL VEGETATION STUMPS TO BE REMOVED FROM ENTIRE AREA BED FILL ZONE.
PRIOR TO PLACEMENT OF PERMEABLE FILL ONLY LIGHT TRACKED EQUIPMENT SHALL BE PERMITTED TO TRAVEL OVER PREPARED INTERFACE OF NATIVE MATERIAL.
- 6.0 THIS PLAN IS TO BE READ IN CONJUNCTION WITH THE SEWAGE SYSTEM PERMIT AND DRAWING #CAR 158.
- 7.0 THE SEPTIC TANK SYSTEM CONTRACTOR IS RESPONSIBLE TO CONFIRM ALL DESIGN REQUIREMENTS PRIOR TO COMMENCE WORK.
- 8.0 THE DEVELOPMENT AS PROPOSED IS UNDER THE DIRECTION OF THE OWNER/AGENT. THE OWNER/AGENT ASSUME FULL RESPONSIBILITY FOR DEVELOPMENT AS PROPOSED.
- 9.0 THIRD EYE TECHNICAL SERVICE CANNOT BE HELD RESPONSIBLE FOR THE INSTALLATION, ULTIMATE OPERATION AND ENVIRONMENTAL IMPACT OF THE PRIVATE SEWAGE DISPOSAL SYSTEM.
- 10.0 THE GRADING AND DRAINAGE DESIGN AS COMPLETED IS OF A GENERAL NATURE. ALL ELEVATIONS AND GRADING SPECIFICATIONS TO BE CONFIRMED BY THE CONTRACTOR PRIOR TO COMMENCE WORK.
- 11.0 ALL MEASUREMENTS AND ELEVATIONS ARE METRIC.
- 12.0 THIS PLAN NOT TO BE SCALED.



158
CARDEVCO RD.

PRIVATE
SEWAGE SYSTEM
DETAIL PLAN


PLAN 4M 356
PART BLK. 10/11
SP 4R 7953
PARTS 1 & 2
SP 4R 7915
PARTS 19 & 22
CITY OF OTTAWA
(W. CARLETON)

DWG. #CAR 158D
DRAWN BY: JBM
DATE: 18/5/18

SPECIAL NOTES:

1. This system (is/is not) designed for the use of a garbage disposal.
2. This system is not designed to receive backwash from a domestic water treatment device.
3. Organic Lean Layer must be removed from bed and slope extension areas prior to fill placement. Scarify subsoil prior to fill placement.
4. All fill material shall be clean and permeable and meet Eljen design manual requirements. The 150 mm of Specified Sand underneath and surrounding the GSF modules shall comply with ASTM C33 sand.
5. Backfill material can be native soil with no stones larger than 50 mm in any dimension to a maximum depth of 30 cm over the GSF modules and covered with a minimum 150 mm of clean loam.
6. Any Eljen GSF System that is more than 450 mm below finish grade as measured from the top of the module shall be vented.
7. This design complies with and must be installed in accordance with the MOST CURRENT Eljen GSF System Design and Installation Manual for Ontario.
8. Installation shall be performed by an authorized ELJEN Installer detaining a valid C.A. RECEIVED.
9. Eljen GSF product shall be supplied by an Ontario authorized Eljen GSF Distributor.

ELJEN GSF A-42 MODULE A-A BED SECTION NTS

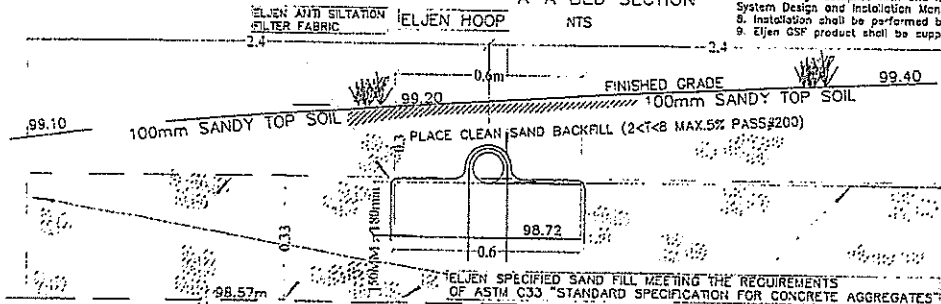

INVERT ELEVATIONS (BOTTOM OF PIPES)	
FEED HEADER	
PROPOSED	REVISED
98.90	AS-BUILT
END HEADER	
98.90	

COMPACTED FILL TO BE REMOVED
UNDER ENTIRE ELJEN SYSTEM
FOOTPRINT

PLACE CLEAN SAND BACKFILL (2<T<8 MAX.5% PASS#200)

COMPACTED FILL TO BE REMOVED
UNDER ENTIRE ELJEN SYSTEM FOOTPRINT

SCARIFY/LOOSEN EXCAVATION

EXCAVATION TO INTERFACE WITH NATIVE LOAM: 98.40 (+/-)

SCARIFY/LOOSEN EXCAVATION

SPECIAL NOTE:
SCARIFICATION/LOOSENING OF THE NATIVE SOIL INTERFACE
IS TO BE COMPLETED DURING DRY SOIL CONDITIONS

C.A. RECEIVED
MAY 17 2018
REFER TO:



Ottawa Septic Bureau des systèmes
System Office septiques d'Ottawa

Permit Part 8 – Sewage System Ontario Building Code

Do Not Complete
Permit No.
Revision No.
Date
Related Application

A copy of this permit must be posted on the property at all times during construction. OBC, Division C – Part 1, Section 1.3.2.1
This permit verifies that the on-site sewage system was reviewed and approved for construction under the Ontario Building Code and O.Reg. 323/12 as amended by O.Reg. 151/13.

Inspected & Recommended by: T. Hutton Owner: T.M. West
Inspection Date & Time: May 18/18 (11:15 AM) Weather: Sunny, 10°C
Civic Address: 158 Candana Rd. Legal: _____

number of bedrooms: _____ fixture units: _____
finished floor area: _____ G: 1500/Any

septic/holding tank/pre-treatment tank <u>4500</u> L	weigh bills for filter media <u>Eljen</u> <input checked="" type="checkbox"/> yes <input type="checkbox"/> no
effluent filter <u>yes</u>	grain size analysis required <input checked="" type="checkbox"/> yes <input type="checkbox"/> no
pump rate _____ L/15 min	site to be scarified <input checked="" type="checkbox"/> yes <input type="checkbox"/> no
treatment unit <u>Eljen GSF 442</u>	clay seal inspection <input type="checkbox"/> yes <input checked="" type="checkbox"/> no
number of units <u>1/2</u>	manhole required <input type="checkbox"/> yes <input checked="" type="checkbox"/> no
	sub-grade inspection <input checked="" type="checkbox"/> yes <input type="checkbox"/> no

ELEVATION ☐ In Ground ☐ Partially Raised ☐ Fully Raised

TYPE OF SYSTEM

<input type="checkbox"/> Trench	<input type="checkbox"/> Shallow Buried Trench
<input type="checkbox"/> Pipe and Stone or <input type="checkbox"/> Chambers	pipe length _____ m
type of chamber _____	orifice spacing _____ m
loading area _____ m ²	<input type="checkbox"/> Filter Media Bed
total trench length _____ m	stone _____ m ²
trench configuration _____	extended base _____ m ²
<input checked="" type="checkbox"/> Dispersal Bed	pipe _____
<input checked="" type="checkbox"/> BMEC <input type="checkbox"/> Type A <input type="checkbox"/> Type B	weight of filter media _____ kg
stone _____ m ²	loading area _____ m ²
sand <u>182</u> m ²	<input type="checkbox"/> Class 5 Holding Tank
pipe <u>2 runs of 8 Eljen</u>	<input type="checkbox"/> Septic Tank Only
linear loading _____ L/m ²	

Manager, Septic System Approvals: T. Hutton Permit Date: MAY 29, 2018

Comments: 1) Subgrade inspection required. Contractor to ensure that all
disposal fill is covered down to active lower soil

☒ maintenance/pumping required ☐ ESA permit # required ☐ engineer to verify
☐ Class 5 Holding Tank approval only valid for three years from date of issue ☐ subgrade ☐ squirt height

Manager, Septic System Approvals: _____ Revision Date: _____

Comments: _____

NOTE: For further details, refer to corresponding application.

Revised 2016
Revised 2014-10-05/00

