



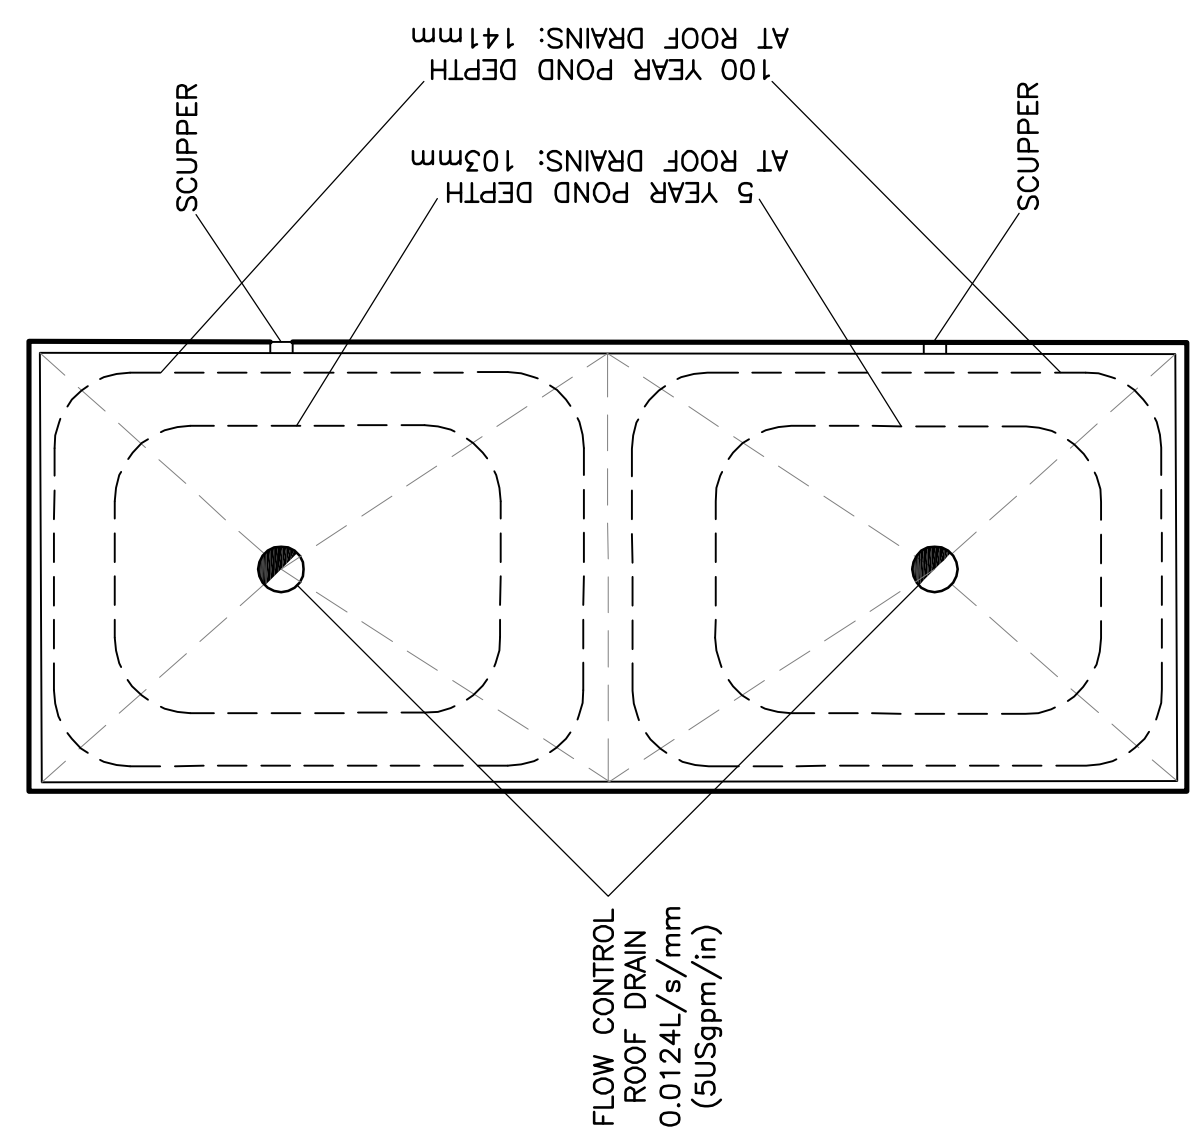


CATCH-BASIN & MANHOLE SCHEDULE

APPROVED
By Adam Brown at 9:41 am, May 25, 2025

INSTALL A MINIMUM OF 2 SCUPPERS. EACH A MINIMUM 300mm WIDE. BOTTOM OF SCUPPERS SHALL BE 150mm ABOVE THE ROOF DRAINS REFER TO ARCHITECTURAL FOR EXACT LOCATIONS AND DETAILS. ROOF SHALL BE DESIGNED TO CARRY THE LOAD OF WATER HAVING A 50mm DEPTH AT SCUPPERS (i.e. 200mm DEPTH AT THE ROOF DRAINS). REFER TO STRUCTURAL.

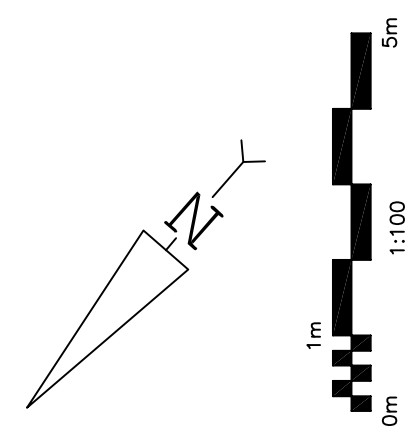

ROOF DRAINAGE PLAN




MAR 25-25	RE-ISSUED FOR APPROVAL
FEB 10-25	RE-ISSUED FOR APPROVAL
OCT 11-24	RE-ISSUED FOR APPROVAL
JUN 9-23	RE-ISSUED FOR APPROVAL
NOV 24-22	ISSUED FOR APPROVAL
NOV 15-22	ISSUED FOR COORDINATION
SEP 12-22	PRELIMINARY
DATE	REVISION

D. B. GRAY ENGINEERING INC.
Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain

700 Long Point Circle
Ottawa, Ontario
613-425-8044
d.gray@dbgrayengineering.com

PROPOSED ADDITION
135 CARDEVCO ROAD
OTTAWA, ONTARIO

Drawing Title



rawing No.
C-
of