

June 17, 2025

PH4905-LET.02.REV.02.

Ottawa Sivan Temple
2104 Roger Stevens Drive
Ottawa, Ontario
K0A 2T0

Attention: **Kula Sellathurai**

Subject: **Hydrogeological Assessment and Terrain Analysis**
Proposed Temple Redevelopment
2104 Roger Stevens Drive Ottawa, Ontario

Consulting Engineers

9 Auriga Drive
Ottawa, Ontario
K2E 7T9
Tel: (613) 226-7381

Geotechnical Engineering
Environmental Engineering
Hydrogeology
Materials Testing
Building Science
Rural Development Design
Retaining Wall Design
Noise and Vibration Studies

patersongroup.ca

INTRODUCTION

Further to your request, Paterson Group (Paterson) has conducted a Hydrogeological Assessment and Terrain Analysis in support of a Site Plan Control Application for the proposed redevelopment of the temple located at 2104 Roger Stevens Drive in Ottawa, Ontario. Please refer to the Key Plan (attached) for the approximate site location. The subject site refers to the parcel at 2104 Roger Steven Drive.

The purpose of this work has been to determine the suitability of the water supply aquifer underlying the site to support the Site Plan Application for the proposed redevelopment.

The proposed Site Plan Application is for the construction of a new temple and priest residence that is replacing the currently existing temple. Details of the proposed temple redevelopment can be found in the attached P² Concepts drawing SP01 - Site Plan – dated May 13, 2025.

The Subject Site consists of a 2.04 hectares (ha) lot and is currently occupied by the existing temple with associated private infrastructure. The ground surface is generally flat at the location of the temple and is sloped to the south behind the temple and towards the rear of the property. The surficial groundwater flow is anticipated to be towards the southeast, while general groundwater flow is anticipated to be to the east towards an unnamed tributary which eventually drains into Stevens Creek.



The Subject Site is situated in a rural area which is serviced by private water supplies and private on-site septic fields. The site is bordered to the north by Roger Stevens Drive, followed by a residential dwelling and agricultural land, to the west by residential dwellings, and to the south and east by agricultural land.

Description of Subject Site

The subject site is approximately 2.04 ha in size and is currently occupied by a one-storey commercial building; Ottawa Sivan Temple. The Site Plan application is for a proposed redevelopment. The proposed redevelopment includes the construction of a new temple and a priest residence. Please refer to Figure-1 Key Plan and P² Concepts Site Plan Drawing SP01 dated May 13, 2025, attached, for the proposed site location and site layout.

The subject site is currently serviced by an onsite sewage system and a private drilled well. A new drilled well was installed onsite to support the redevelopment. A new sewage system is proposed to be located on the western side, behind the priest residence. D.B Gray Engineering Inc. (hereby referred to as DBG Engineering) has designed a new sewage system due to the nitrate reduction required as part of the Nitrate Impact Assessment (NIA). A septic flow calculation was completed by DBG Engineering and resulted in a total daily water demand calculation of 7,250 L/day. Please refer to DBG Engineering Sewage System design, attached, for full details.

The existing well is currently servicing the existing building, however, a new drilled well, hereafter referred to as Test Well 1 (TW1) was installed on September 9, 2024 and is intended to service the proposed temple and priest residence following the completion of the proposed redevelopment. The existing well will be decommissioned in accordance with O.Reg.903 once it is no longer required.

The suitability of the aquifer to supply the subject site was assessed using the methodology provided in City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

Karst Mapping

Available Karst mapping (OGS GRS005) was reviewed as part of this assessment. The available mapping does not indicate the presence of any inferred or potential karstic features. Furthermore, no indication of karstic features were observed during the site visits completed by Paterson personnel.

Mississippi-Rideau Source Protection Plan

The Mississippi-Rideau Source Protection Plan (MRSP) provides guidance as to which policies apply to a given property, municipality or specific activity and if there are specific designations that apply to the area. The subject site has not been designated as any of the four groundwater related vulnerable areas identified within the Clean Water Act



(2006). The four vulnerable areas consist of Significant Groundwater Recharge Area (SGRA), Highly Vulnerable Aquifer (HVA), Intake Protection Zone (IPZ) and Wellhead Protection Area (WHPA).

As the subject site has not been designated as any of the four groundwater related vulnerable areas, there is no prohibition of land uses on the subject site based upon its existing or proposed usage.

HYDROGEOLOGICAL ASSESSMENT

The purpose of this work has been to determine the suitability of the water supply aquifer underlying the site to support the Site Plan Application for the proposed temple redevelopment for potable supply usage. Specifically, the intent of this report is to review the availability of a safe and reliable water supply having sufficient quantity and quality to provide potable water for the proposed redevelopment.

Fieldwork Program

Geotechnical Program

A geotechnical investigation was carried out on September 19, 2023, and consisted of a total of 3 boreholes excavated to a maximum depth of 6.7 m below ground surface (bgs). Practical refusal to DCPT was encountered at a depth of 10.8 m bgs in BH3-23. The boreholes were distributed in a manner to provide general coverage of the proposed redevelopment, taking into account underground utilities and site features. The locations of the boreholes are shown on Drawing PG6832-1 – Test Hole Location Plan (attached). The geotechnical analysis is completed under report no. PG6832-1.Revision 2, dated October 15, 2024.

Well Testing

As a means to demonstrate the adequacy of the aquifer underlying the subject lands, with respect to water quality and quantity, the newly drilled well (TW1) on the subject site was tested. TW1 has a Water Well Record (WWR) Well ID of A395525. TW1 has a 158.7 mm diameter steel casing that extends to 17.67 m below ground surface (bgs) with a 0.62 m stick up. The well itself extends to a depth of 54.9 m bgs. Based on available geological mapping, the drift thickness at TW1 varies from 15 to 25 m. According to the Water Well Record (WWR) for the newly drilled well, the overburden generally consists of sand and gravel, boulders, clay and hardpan to a depth of 15.84 m, where limestone bedrock was encountered. Refer to P²Concepts - Site Plan Drawing-SP01 attached, for the approximate location of TW1.

As a means to evaluate the water supply aquifer intercepted by the well, the well was subjected to an 8-hour constant rate pumping test. The pumping test was conducted on September 24, 2024 under the full-time supervision of Paterson personnel. Prior to the



pumping test the well was disinfected as per the MECP Disinfection Instruction Sheet (attached), and a data-logger was installed to monitor the background groundwater levels.

The submersible pump was rented from and installed by a licensed well technician (Air Rock Drilling Inc.) and used for the 8-hour pumping test. A licensed water well technician (Air Rock) completed the necessary plumbing related activities. The discharge line was placed at a sufficient distance to ensure that the discharge water was being directed away from the well as well as any septic systems in the area. Upon completion of the test, the system was returned to its normal configuration.

The pumping test was carried out at a pumping rate of 58 L/min for a duration of 8 hours. During the pumping test, the pumping rate was periodically measured using the timed volume correlation method. The pump rate was maintained within 5% of the selected pump rate. The static water level was recorded manually and an electric datalogger (VanEssen TD-Diver) was installed in the test well prior to the start of the pumping test. The selected rate of 58 L/min provides approximately 3.8 times the maximum total daily design volume for the septic system during the 8-hour pumping test. The rate was determined to be representative of a flow rate which would be in excess of what the proposed redevelopment would require.

The data logger recorded water levels at 30 second intervals. In addition, manual water level readings were taken at periodic intervals during the test.

Recovery data was collected from the well following the completion of the pumping. The well was noted to have fully recovered within 2 minutes after the end of pumping.

Groundwater samples were collected 4 hours and 8 hours after the start of pumping. Prior to collection of the groundwater samples, the free chlorine residual was verified as non-detectable. The water samples were submitted for comprehensive testing of bacteriological, chemical, and physical water quality parameters consistent with the standard "Subdivision Supply" suite of parameters plus trace metals, and volatile organic compounds (VOCs).

All samples were collected unfiltered and unchlorinated and were placed directly into clean bottles supplied by the analytical laboratory. Samples were placed immediately into a cooler with ice and were transported directly to Environmental Testing Canada Inc.(Eurofins) laboratory in Ottawa. All samples were received by the laboratory within 24 hours of collection.

A series of field tests of the pumped water were carried out at the well head during the 8-hour pumping test. The parameters tested at the well head included: pH, total dissolved solids, conductivity, turbidity, apparent colour, and temperature.



Well Inspection

A visual inspection of TW1 was performed by Paterson personnel and confirmed that the well casing and well cap are in good condition. The grading around the well was noted to be sufficiently graded to direct surface water away from the wellhead, as required by O.Reg 903. The stickup was measured to be 0.62 m above ground surface. Based on a visual inspection by Paterson personnel, the well was deemed to be in good condition.

Aquifer Analysis

Water Quantity

Pumping test data was analyzed using AQTESOLV Pro Version 4 aquifer analysis software package by HydroSOLVE Inc. Drawdown data was measured using an electronic water level tape and an electronic datalogger unit.

Table 1: SUMMARY OF WATER SUPPLY AQUIFER CHARACTERISTICS OF TW1	
AQUIFER PARAMETER	RESULT OF ANALYSIS
Transmissivity (m ² /day)	1971
Pumping Rate (L/min)	58
Pre-test Static Water Level (m)	4.62
Post-test Static Water Level (m)	4.88 (4.98 max)
Available Drawdown (m)	50.28
% Drawdown During Pump Test (%)	0.7
Specific Capacity (L/min/m drawdown)	161

The drawdown data was analyzed using the Cooper Jacob method of analysis. Aquifer transmissivity is estimated to be 1971 m²/day. Refer to the Cooper Jacob method of analysis data sheet attached to this report. Note that there was very little draw down during the pumping test at the associated pumping rate.

The pumping test results show that TW1 has a high yield to support the water demands that may be required. Overall maximum drawdown at a constant pumping rate for a period of 8 hours was approximately 0.36 m (0.7% of the available drawdown). It should be noted that full recovery was achieved within 2 minutes after the end of pumping.

The total volume of water pumped during the 8-hour pumping event was approximately 27,840 L. This is approximately 3.8 times the maximum total daily design volume of water required (7,250 L/day) to support the proposed redevelopment.

The suitability of the aquifer to supply the proposed Site Plan Application for the proposed commercial modification was assessed using the methodology provided in the City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).



Based on the information summarized in Table 1, it is readily apparent that the water supply well has intercepted an adequately strong water supply aquifer which has sufficient quantity to service the proposed Site Plan Control Application.

Given the analyses presented and summarized above, it is our opinion that there is an adequate supply of water to support the proposed redevelopment as well as the neighbouring lots. Available water well records (WWR) of the neighboring properties on the MECP Well Record mapping website indicated that the wells were screened in limestone and sandstone. Surrounding WWR's are attached to this report.

Water Quality

Field Data

Turbidity, electrical conductivity, total dissolved solids (TDS), pH, apparent color and temperature were measured at the wellhead during the pumping test. The measurements and time intervals for each of these parameters are summarized on the graphical representation below. In addition, a HACH Pocket Colorimeter II chlorine reader was used to measure the free chlorine residual level. No chlorine residual was detected in the discharge water prior to the collection of the water samples.

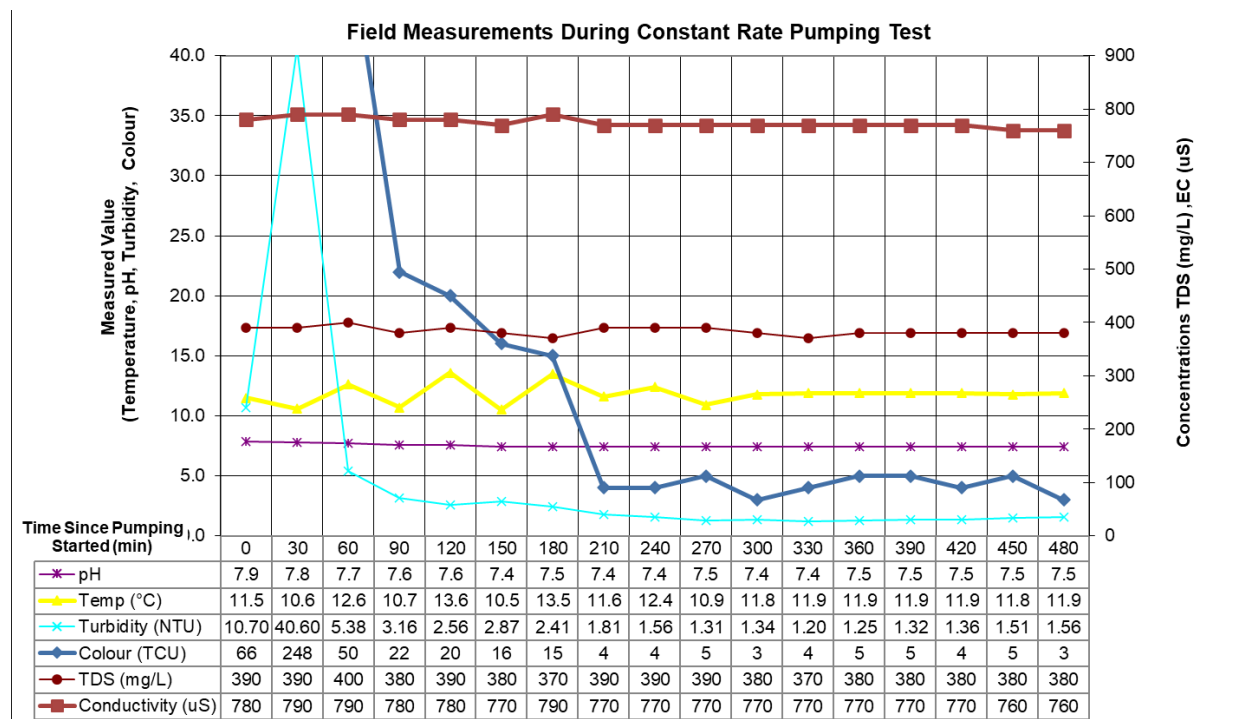


Figure 1: Field Measurements

**Laboratory Data**

The Subdivision Package suite of parameters and trace metals laboratory water quality obtained from the pumping test of TW1 is provided in Table 2a, 2b, and 2c below and the laboratory analyses reports can be found attached. VOC laboratory analytical testing were completed and measured to be non-detect in the sample results. All laboratory test results can be found attached to this report.

TABLE 2a: GROUNDWATER MICROBIOLOGY & GENERAL GEOCHEMISTRY					
PARAMETER	UNITS	ODWS		TW1	
		LIMIT	TYPE	TW1 GW1 (4 hr)	TW1 GW2 (8 hr)
				9/24/2024	9/24/2024
MICROBIOLOGICAL					
Escherichia Coli (E.Coli)	ct/100mL	0	MAC	0	0
Total Coliforms	ct/100mL	0	MAC	0	0
GENERAL CHEMICAL - HEALTH RELATED					
Fluoride (F)	mg/L	1.5	MAC	0.64	0.63
Ammonia (N-NH ₃)	mg/L	-	-	0.154	0.153
Nitrite (N-NO ₂)	mg/L	1	MAC	<0.1	<0.1
Nitrate (N-NO ₃)	mg/L	10	MAC	<0.1	<0.1
Total Kjeldahl Nitrogen	mg/L	-	-	0.231	0.236
Turbidity (Field)	NTU	1.0 (5.0)	MAC/AO	1.56	1.56
Turbidity (Laboratory)	NTU	1.0 (5.0)	MAC/AO	1.6	2.3
GENERAL CHEMICAL - AESTHETIC RELATED					
Alkalinity (as CaCO3)	mg/L	30-500	OG	229	236
Chloride (Cl)	mg/L	250	AO	90	85
Colour (Apparent - Lab)	TCU	5	AO	6	7
Colour (Apparent - Field)	TCU	5	AO	4	3
Conductivity	uS/cm	-	-	781	766
Dissolved Organic Carbon	mg/L	5	AO	0.7	1.1
Hardness (as CaCO3)	mg/L	100	OG	226	226
Ion Balance	unitless	-	-	1.01	1.00
pH@25°C	unitless	6.5-8.5	AO	7.99	7.95
Phenols	mg/L	-	-	<0.001	<0.001
Sulphate (SO ₄)	mg/L	500	AO	47	47
Sulphide (S ₂ ⁻)	mg/L	0.05	AO	<0.01	<0.01
Tannin & Lignin	mg/L	-	-	0.10	<0.01
Total Dissolved Solids	mg/L	500	AO	508	498

1. ODWS identifies the following types of parameters:

MAC = Maximum Allowable Concentration

AO = Aesthetic Objective

OG = Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective

**TABLE 2b: GROUNDWATER GEOCHEMISTRY - METALS**

PARAMETER	UNITS	ODWS		TW1	
		LIMIT	TYPE	TW1 GW1 (4 hr)	TW1 GW2 (8 hr)
				9/24/2024	9/24/2024
METALS					
Aluminum (Al)	mg/L	0.1	OG	0.03	0.01
Antimony (Sb)	mg/L	0.006	IMAC	<0.0005	<0.0005
Arsenic (As)	mg/L	0.01	IMAC	<0.001	<0.001
Barium (Ba)	mg/L	1.0	MAC	0.07	0.06
Beryllium (Be)	mg/L	-	-	<0.0005	<0.0005
Boron (B)	mg/L	5.0	IMAC	0.20	0.20
Cadmium (Cd)	mg/L	0.005	MAC	<0.0001	<0.0001
Calcium (Ca)	mg/L	-	-	42	42
Chromium (Cr)	mg/L	0.05	MAC	<0.001	<0.001
Cobalt (Co)	mg/L	-	-	<0.0002	<0.0002
Copper (Cu)	mg/L	1.0	AO	<0.001	<0.001
Iron (Fe)	mg/L	0.3	AO	0.19	0.33
Lead (Pb)	mg/L	0.01	MAC	<0.001	<0.001
Magnesium (Mg)	mg/L	-	-	30	29
Manganese (Mn)	mg/L	0.05	AO	<0.01	<0.01
Molybdenum (Mo)	mg/L	-	-	<0.005	<0.005
Nickel (Ni)	mg/L	-	-	<0.005	<0.005
Potassium (K)	mg/L	-	-	8	8
Selenium (Se)	mg/L	0.05	MAC	<0.001	<0.001
Silver (Ag)	mg/L	-	-	<0.0001	<0.0001
Sodium (Na)	mg/L	200	AO	81	78
Strontium (Sr)	mg/L	-	-	1.75	1.77
Thallium (Tl)	mg/L	-	-	<0.0001	<0.0001
Uranium (U)	mg/L	0.02	MAC	<0.001	<0.001
Vanadium (V)	mg/L	-	-	<0.001	<0.001
Zinc (Zn)	mg/L	5.0	AO	<0.01	<0.01

1. ODWS identifies the following types of parameters:

MAC = Maximum Acceptable Concentration

IMAC = Interim Maximum Acceptable Concentration

AO = Aesthetic Objective

OG = Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective

**TABLE 2c: GROUNDWATER GEOCHEMISTRY - VOLATILES**

PARAMETER	UNITS	ODWS		TW1	
		LIMIT	TYPE	TW1 GW1 (4 hr)	TW1 GW2 (8 hr)
				9/24/2024	9/24/2024
VOCs Surrogates					
1,2-dichloroethane-d4	%	-	-	-	113
4-bromofluorobenzene	%	-	-	-	81
Toluene-d8	%	-	-	-	99
Volatiles					
1,1,1,2-tetrachloroethane	µg/L	-	-	-	<0.5
1,1,1-trichloroethane	µg/L	-	-	-	<0.4
1,1,2,2-tetrachloroethane	µg/L	-	-	-	<0.5
1,1,2-trichloroethane	µg/L	-	-	-	<0.4
1,1-dichloroethane	µg/L	-	-	-	<0.4
1,1-dichloroethylene	µg/L	14.0	MAC	-	<0.5
1,2-dichlorobenzene	µg/L	200.0	MAC	-	<0.4
1,2-dichloroethane	µg/L	5.0	IMAC	-	<0.2
1,2-dichloropropane	µg/L	-	-	-	<0.5
1,3,5-trimethylbenzene	µg/L	-	-	-	<0.3
1,3-dichlorobenzene	µg/L	-	-	-	<0.4
1,3-Dichloropropylene (cis+trans)	µg/L	-	-	-	<0.3
1,4-dichlorobenzene	µg/L	5.0	MAC	-	<0.4
Acetone	µg/L	-	-	-	<30
Benzene	µg/L	1.0	MAC	-	<0.5
Bromodichloromethane	µg/L	-	-	-	<0.3
Bromoform	µg/L	-	-	-	<0.4
Bromomethane	µg/L	-	-	-	<0.5
c-1,2-Dichloroethylene	µg/L	-	-	-	<0.4
c-1,3-Dichloropropylene	µg/L	-	-	-	<0.2
Carbon Tetrachloride	µg/L	2.0	MAC	-	<0.2
Chloroethane	µg/L	-	-	-	<0.2
Chloroform	µg/L	-	-	-	<0.5
Dibromochloromethane	µg/L	-	-	-	<0.3
Dichlorodifluoromethane	µg/L	-	-	-	<0.5
Dichloromethane	µg/L	50	MAC	-	<4.0
Ethylbenzene	µg/L	140	MAC	-	<0.5
Ethylene Dibromide	µg/L	-	-	-	<0.2
Hexane	µg/L	-	-	-	<5
m/p-xylene	µg/L	-	-	-	<0.4
Methyl Ethyl Ketone (MEK)	µg/L	-	-	-	<10
Methyl Isobutyl Ketone (MIBK)	µg/L	-	-	-	<10
Methyl Tert Butyl Ether (MTBE)	µg/L	15	AO	-	<2
Monochlorobenzene	µg/L	80	MAC	-	<0.5
o-xylene	µg/L	-	-	-	<0.4
Styrene	µg/L	-	-	-	<0.5
t-1,2-Dichloroethylene	µg/L	-	-	-	<0.4
t-1,3-Dichloropropylene	µg/L	-	-	-	<0.2
Tetrachloroethylene	µg/L	10	MAC	-	<0.3
Toluene	µg/L	60	MAC	-	<0.4
Trichloroethylene	µg/L	5	MAC	-	<0.3
Trichlorofluoromethane	µg/L	-	-	-	<0.5
Vinyl Chloride	µg/L	1	MAC	-	<0.2
Xylene; total	µg/L	90	MAC	-	<0.5



The bacteriological test results (Certificate of Analysis – Report No. 4102006) indicated that the test samples at the 4 and 8 hour interval were non-detect (0 ct/100 mL) for E.Coli and Total Coliforms.

The water quality of the subject water supply well meets all the Ontario Drinking Water Standards maximum acceptable concentrations (MAC). Furthermore, the water meets all of the Aesthetic Objectives (AO) and Operational Guidelines (OG) with the exception of the following.

- ☐ Hardness (as CaCO_3)
- ☐ Turbidity
- ☐ Iron (Fe)

Exceedances of the above parameters are not uncommon of the water supply in the subject aquifer. Each of these groundwater parameters are discussed in detail below.

Hardness as CaCO_3

Hardness, expressed as calcium carbonate, is an operation guideline and does not appear in the ODWS. Rather, it appears in the Technical Support Documents for Ontario Drinking Water Standards, Objectives and Guidelines (ODWS) as a parameter with an operational guideline at 100 mg/L. At the measured concentration of 226 mg/L, the water is considered to be hard, however, it is below the reasonable treatable limit of 500 mg/L specified in Table 3 of the MOECC guidance document Procedure D-5-5 (1996). The hardness concentration can be treated using conventional softening technologies, if desired by the owner.

Turbidity

Turbidity, which is generally an aesthetic parameter, was detected in the laboratory test samples at values of 1.6 and 2.3 NTU in the 4- and 8-hours tests, respectively. Field testing of the samples detected values of 1.56 NTU in the 4- and 8-hour field tests, respectively. It is expected that continued use of the well would further reduce turbidity values. The elevated turbidity in the laboratory analyzed samples is attributed to the precipitation of iron.

The ODWS maximum acceptable concentration for turbidity in drinking water entering the distribution system is 1 NTU. The health-related Ontario Drinking Water Objective (ODWO) is 1 NTU. The Aesthetic Objective for turbidity in drinking water reaching the consumer is 5 NTU. The City's HTAG has a Maximum Concentration Considered Reasonably Treatable (MCCRT) of 5 NTU.

The field test parameters are below the 5 NTU objective. Furthermore, total coliforms and E.Coli were non-detect (0 ct/100 mL) in both the 4 and 8-hour samples, which meets the health requirements of the City's HTAG when the sample results are above the health-related ODWO of 1 NTU. Therefore, treatment for turbidity is not required



Iron

Concentrations of iron above 0.3 mg/L can contribute to staining of fixtures and a metallic taste at higher concentrations. Precipitation of iron can promote the growth of iron bacteria in pipes. The concentration of iron in the groundwater in TW1 was measured to be 0.33 mg/L at the 8-hour mark. The concentration of iron in the groundwater in the test well is considered to be reasonably treatable in accordance with Procedure D-5-5. It is recommended that an iron filter be used to reduce the levels of iron and reduce the potential for excessive precipitate occurring in the water supply system, if desired by the owner.

Colour

Colour may occur in drinking water for several reasons. It may be due to organic substances from the decay of vegetation, or the presence of metals such as iron, manganese, and copper, which are abundant in nature. The provincial aesthetic objective for colour in drinking water is 5 True Colour Units (TCU). The federal (Health Canada) guideline aesthetic objective limit for colour is 15 TCU (Guidelines for Canadian Drinking Water Quality, Health Canada June 2019). Procedure D-5-5 gives a maximum concentration considered reasonably treatable for colour as 7 TCU. As colour is a strictly aesthetic parameter, it can be reduced from the water supply, if desired, through the use of a manganese greensand treatment.

During the field pumping test, a DR900 colorimeter was used to measure apparent colour in the groundwater at regular intervals. Apparent colour in the groundwater was measured as 4 and 3 TCU at the 4- and 8- hour marks, which are below the aesthetic guideline of 5 TCU, whereas apparent colour from laboratory measurements was 6 and 7 TCU which is above the guideline but within treatable limits. The elevated colour levels detected in the lab samples is attributed to the precipitation of iron out of the groundwater.

Total Dissolved Solids (TDS)

TDS refers to the concentration of inorganic substances dissolved in water. The main constituents are typically chloride, sulphates, calcium, magnesium, and bicarbonates. The TDS concentration of 508 mg/L at the 4-hour mark exceeds the Aesthetic Objective of 500 mg/L. At concentrations above 500 mg/L, some consumers may find the taste objectionable, however, as the objective is an aesthetic objective, no treatment is required. At the 8-hour mark, the TDS concentration was 498 mg/L which is below the Aesthetic Objective. As the TDS concentration was decreasing with time and was below the Aesthetic Objective no taste problems are anticipated to occur and treatment is not likely to be required. If desired by the owner, a point of use reverse osmosis unit can be installed to reduce TDS levels for drinking purposes.

The Langelier calculation provided an LSI of 0.0. Based on the evaluation of the result, the water is saturated and does not precipitate a scale layer of calcium carbonate or dissolve calcium carbonate (neither scale forming nor corrosive). Based on the stable



value, there are no mitigative measures needed. See Langelier Saturation Index Calculation attached for calculation details.

Sodium

Sodium (Na), an aesthetic parameter, was detected in the laboratory test sample at concentrations of 81 and 78 mg/L, which does not exceed the ODWS aesthetic objective of 200 mg/L. Although sodium is not toxic and no maximum acceptable concentration has been set, concentrations above 20 mg/L require that the Medical Officer of Health be notified of the water quality results, so that this information may be passed on to local physicians for use in treatment of those requiring a sodium-restricted diet.

O.Reg 903

All wells must be maintained in accordance with O.Reg 903. If a well is no longer in use, it must be decommissioned in accordance with O.Reg 903.

TERRAIN ANALYSIS

The purpose of this study is to determine the site's suitability for private on-site wastewater systems. Specifically, the intent of this report is to provide design details for private septic servicing and lot development potential.

Surficial Geology

Paterson carried out a Geotechnical Investigation on September 19, 2023 where 3 boreholes were installed in a manner to provide general coverage of the subject site, with specific consideration to the redevelopment. The general overburden was observed to be a thin layer of topsoil followed by fill and/or glacial till. Fill, consisting of brown silty sand with gravel, was encountered in BH2-23 and BH3-23, to a maximum depth of 2.1 m bgs. Glacial till, consisting of silty sand to sandy silt with varying amounts of gravel and, cobbles and boulders, was found in each borehole to the maximum depth of the boreholes. Practical refusal to augering was observed at a depth of 5 m in BH1-23 and DCPT refusal was observed in BH3-23 at a depth of 10.8 m bgs. The results of the geotechnical program are generally consistent with available geological mapping provided by the Ontario Geological Survey (OGS MRD128) and with the available historical surrounding Water Well Records (WWR). Further details can be found in geotechnical report PG6832-1.Revision 2, dated October 15, 2024.

Available bedrock geological mapping provided by the Ontario Geological Survey (MRD 219) indicates that the bedrock underlying the subject site consists of dolostone, minor shale and sandstone of the Oxford Formation in the Beekmantown Group. Available overburden thickness mapping shows a drift thickness of 10 to 15 m across the subject site.



Hydrogeological Sensitivity of the Site

The subject site currently consists of a temple with associated infrastructure and private servicing. The subject site is serviced by a private potable well and septic system. The subject site is currently occupied by a one-story commercial building, specifically the Ottawa Sivan Temple. The site is bordered to the north by Roger Stevens Drive, followed by a residential dwelling and agricultural land, to the west by residential dwellings, and to the south and east by agricultural land. All surrounding properties are on private services. The adjacent properties are serviced by private wells and septic systems.

The overburden at the subject site and surrounding WWRs is recorded as a sand based glacial till.

According to the Ontario Building Code (OBC) Section 8.7.2.1 (1) (b)(i), highly permeable soils as it relates to sewage system design is defined by soils having a percolation rate of less than 1 minute per cm. According to the Ministry of Municipal Affairs and Housing (MMAH) Supplementary Standard SB-6 – Percolation time and soil descriptions dated January 1, 2024 only “Well graded gravels, gravel-sand mixtures, little or no fines” or “Poorly graded gravels, gravel-sand mixtures, little or no fines” have a percolation time of less than 1 minute per cm. The onsite soils were noted to be a glacial till consisting of silty sand to sandy silt with varying amounts of gravel and, cobbles and boulders. Due to the presence of silty sand to sandy silt (a high composition of fines), the percolation time is anticipated to be greater than 1 min/cm and therefore is not considered a highly permeable soil. As such, septic impacts due to observed soils are not anticipated onsite.

According to the Geotechnical Investigation, the overburden thickness was observed to be greater than 2 m.

As the proposed site does not have bedrock within 2 m of the ground surface and the site does not contain any highly permeable soils, the site is not considered hydrogeologically sensitive. Separation distances are not required to be increased between the septic components and the onsite well.

To corroborate our position in this matter, the water quality of the bedrock aquifer targeted by the onsite drilled potable supply well shows no indication of surface water or surface impacts.

Lot Development Plan

The Site Plan for the proposed redevelopment was produced by P² Concepts and is attached (Drawing-SP01). The location of the temple, priest residence, proposed sewage system, and related infrastructure are shown. Please note that although a “permeable parking area” was designated in the site plan drawing, the material was considered impermeable as a conservative approach for this Nitrate Impact Assessment.



Sewage System Volumes

The sewage system has been designed by D.B. Gray Engineering and can be found attached to this report. The maximum total daily design sanitary sewage flow volume (TDDSSF) was determined to be 7,250 L/day. An approved Ottawa Septic System Office (OSSO) permit will be submitted with the Site Plan Application.

Predictive Nitrate Impact Assessment

In order to demonstrate that private services would adequately support the proposed Site Plan application, a Predictive Nitrate Impact Assessment (NIA) for the subject site was completed. The values shown in the Predictive NIA attached to this report are summarized below.

<input type="checkbox"/> Site area	2.04 ha
<input type="checkbox"/> Impervious area (%)	27 %
<input type="checkbox"/> Daily sewage flow	7.25 m ³ /d
<input type="checkbox"/> Concentration of nitrate in effluent (Value based on typical effluent concentration)	40 mg/L
<input type="checkbox"/> Concentration of nitrate in effluent with treatment (Value based on BNQ/NSF 245 certified nitrate reduction system with 50% nitrate reduction)	20 mg/L
<input type="checkbox"/> Surplus Water (The surplus water value was estimated based on Environment Canada Climate Office values with a soil type comprised of a fine sandy loam (Urban lawns / Shallow Rooted Crops) and anthropogenic sources.)	378 mm/yr
<input type="checkbox"/> Combined infiltration factor based on:	0.70
• Topography infiltration factor	0.20
• Soil texture infiltration factor	0.40
• Cover infiltration factor	0.10

The topography infiltration factor of 0.20 is based upon a generally rolling land with an average slope between 2.8 to 3.8 m/km. The soil texture infiltration factor was based upon an “open sandy loam” with a value of 0.4 which is a reasonable generalization based upon the site investigations and available geological mapping. The “cover infiltration factor” was calculated at 0.10 based upon a cultivated land type cover.

The calculation for a conventional septic system results in a predicted nitrate concentration of 16.05 mg/L nitrate for the subject site, using a value of 40 mg/L nitrate concentration within the effluent. This value was based upon a daily sewage flow of 7,250 L/day. It is expected that the actual usage should be lower. The inclusion of nitrate reduction technology (50 % nitrogen reduction of the effluent nitrate, with a BNQ or NSF



245 certified technology) would result in a nitrate concentration of 8.03 mg/L at the property boundary using a value of 20 mg/L nitrate within the effluent, which is below the maximum property value of 10 mg/L nitrate by the property boundary.

Based on the results of the predictive NIA, it is our opinion that the property can adequately support the proposed Site Plan application without having an adverse impact on the underlying bedrock aquifer, provided that an BNQ/NSF 245 certified nitrate reduction system with a minimum of 50% nitrate reduction is used in the sewage system.



CONCLUSIONS

Based on the information contained within the body of this report the following conclusions can be drawn:

1. The water supply aquifer intercepted by the existing well is considered to be adequate to support the water quantity demands for the proposed redevelopment.
2. Based on a visual inspection performed by Paterson personnel, the well casing, stickup, well cap, and surrounding grading around the well are of sufficient standard to meet O.Reg 903. It is a requirement that the well continue to adhere to and be maintained in accordance with O.Reg 903.
3. The preferred water supply intercepted by TW1 contains a water supply that is potable, and contains only elevated concentrations of hardness, turbidity, iron, and apparent colour. The noted parameters can be treated with current readily available water conditioning equipment if desired by the owner.
4. A residential grade water softener is recommended to facilitate the reduction of the hardness concentration. If a water softener is used for the proposed redevelopment, the owner should be made aware that additional sodium will be added to the water to reduce hardness. If desired, a point-of-use reverse osmosis system can be also used to provide a drinking tap source.
5. If desired, the owner can use an iron filter to treat the potential iron values.
6. The sodium concentration was measured to be above the 20 mg/L reporting limit and, as such, the Medical Officer of Health for the City of Ottawa should be informed to assist area physicians in the treatment of local residents on sodium reduced diets.
7. The site is not considered hydrogeologically sensitive.
8. The predicted nitrate concentrations at the property boundary is calculated to be below the required 10 mg/L threshold when a standard denitrification system (50% nitrate reduction) using BNQ/NSF 245 certified nitrate reduction technology is used.
9. A Sewage System Permit and Building Permit need to be issued prior to the commencement of construction on the proposed redevelopment or the proposed septic system.
10. The existing well will be decommissioned in accordance with O.Reg.903 once it is no longer needed.



11. The results of the Hydrogeological Assessment and Terrain Analysis have provided satisfactory evidence that the subject site can support the proposed redevelopment with respect to water quality, quantity and sewage system placement.

We trust that the current submission satisfies your immediate requirements.

Best Regards,

Paterson Group Inc.

Alexander Schopf, PhD, EIT



Erik Ardley, P.Geo

Attachments:

- ☐ Key Plan
- ☐ P²Concepts - Drawing SP.01 dated May 13, 2025
- ☐ MECP Water Well Records
- ☐ Eurofins Certificate of Analysis
- ☐ AQTESOLV - Pumping Test Analysis Reports
- ☐ Langelier Saturation Calculation
- ☐ Testhole Soil Profile and Data Sheets
- ☐ Nitrate Impact Assessment Calculations
- ☐ PG6832-1 – Test Hole Location Plan
- ☐ DBG Engineering Septic System Design



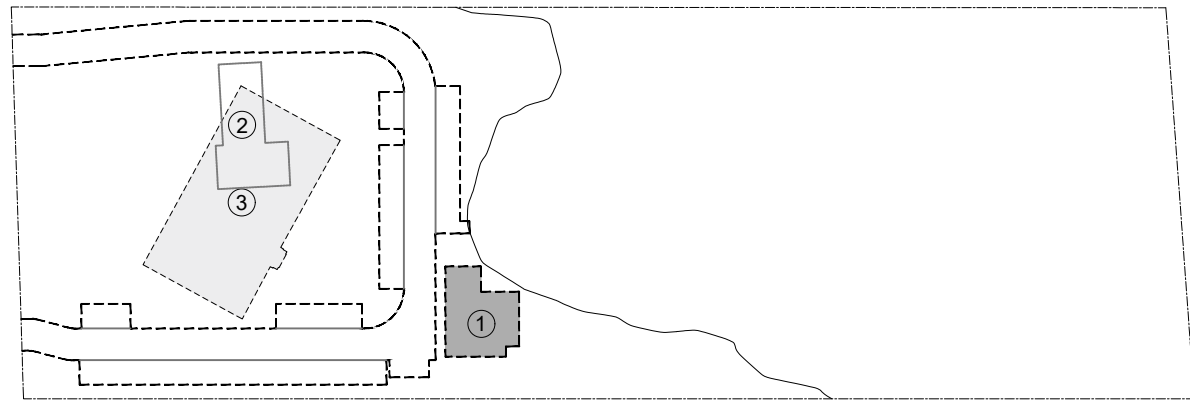


FIGURE 1

KEY PLAN

2104 Roger Stevens	R13 [608r]	S. 1A - Area D (Rural)	S. 58 - Floodplain overlay	Official Plan - S. B9	Rural Transect - Village	Temple GFA 2,013 m2 Priest Residence GFA 551 m2 Temple Assembly Area GFA 1,067.74 m2
General Provisions		Section	Required		Proposed	
Permitted uses*		S. 240 [608r]	School, Place of Worship, or Dwelling unit accessory to these uses		Place of Worship, Dwelling unit	
Min. lot area (sq. m)		Table 224A, (a)	10,000 m2		20,395 m2	
Min. lot width (m)		Table 224A, (b)	75 m		82.95 m	
Max. building height (m)		Table 224A, (g)	12 m		8.44 m (Temple), 9.53m (Priest Residence)	
Min. front yard setback (m)		Table 224A, (c)	9 m		26.20 m	
Min. rear yard setback (m)		Table 224A, (d)	10 m		140.88 m	
Min. int. side yard setback (m)		Table 224A, (e)	9 m		16.69 m (east), 9 m (west)	
Max. lot coverage (%)		Table 224A, (h)	30% lot area = 6,118.50 m2		6% lot area = 1,309.56 m2	
Min. landscaped area (%)		Table 224A, (i)	20% lot area = 4,079 m2		94% lot area = 19,085.44 m2	
* 608r exception						
Parking Provisions		Section	Required		Proposed	
Place of Worship		Table 101, N66	10 spaces / 100 m2 of assembly area GFA = 107 Spaces		60 spaces	MV REQUIRED
Dwelling unit		Table 101, R4	1 space		1 space	
Parking space size		S. 106, (1)	2.6 m x 5.2 m		2.6 m x 5.2 m	
B/F parking (included in total)		AODA, S. 80.36	4% of the total provided spaces = 2 spaces		3 spaces (2 type A, 1 type B)	
Type A parking space dimensions		AODA, S. 80.34 (1)	3.4 m x 5.2 m (plus 1.5 m aisle)		3.4 m x 5.2 m with 1.5 m shared aisle	
Type B parking space dimensions		AODA, S. 80.34 (2)	2.4 m x 5.2 m (plus 1.5 m aisle)		2.4 m x 5.2 m with 1.5 m shared aisle	
Min. drive aisle width (m)		S. 107, (1) (d)	6.7 m		6.7 m	
Min. driveway width (m)		S. 107, (1) (a)	3 m - single lane; 6 m - double lane		6.7 m	
Min. landscaped area for parking lots (%)		S. 110, (1)	15% (322.32 m2)		24% (757.31 m2)	
Min. landscaped buffer for parking lot (m)		Table 110, (1)	3 m abutting street; 1.5 m not abutting street		11.94 abutting a street; 3.02 not abutting street	
Min. setback for outdoor refuse (in-ground container)		S. 110, (3)	9 m from a lot line abutting a public street 3 m from any other lot line		77.71 m from a lot line abutting a public street 4.57 m from any other lot line	
			Screened by soft landscaping 2 m in height		Screened by soft landscaping 2 m in height	
Permitted parking lot material		S. 100, (3) (b)	gravel; B/F spaces must be hard and stable		Asphalt, interlock pavers	
Min. number of bike parking spaces		Table 111A, (i)	1 space / 1,500 m2 GFA = 1 Space		3 spaces	
Min. number of loading spaces		Table 113A, (a)	1 space if 2,000 - 4,999 m2 of GFA = 1 Space		0 spaces	MV REQUIRED

PHASING DIAGRAM:



- PHASE 1 : CONSTRUCTION OF A TWO STOREY BUILDING (TEMPORARY TEMPLE / PRIEST RESIDENCE) DRIVEWAY / PARKING)
- PHASE 2 : DEMOLITION OF THE OF EXISTING BUILDING
- PHASE 3 : CONSTRUCTION OF A ONE STOREY BUILDING - TEMPLE

LEGEND:

INTERNAL ROAD / FIRE ROUTE

S.O.D.

SNOW STORAGE AREA

PERMEABLE PARKING AREA

TERRACES

BARRIER FREE CAR PARKING SPACES
TYPE A (3.4 x 5.2 m)
TYPE B (2.4 x 5.2 m)
ACCESS AISLE (1.5 x 5.2 m)

CAR PARKING SPACES

PROPOSED BUILDING

PROPOSED WALKWAY

SHRUB / BUSHES

EXISTING VEGETATION

PROPOSED TREES

BIKES PARKING SPACE

MOLOK BIN

SANITARY MANHOLE

STORM / CATCH BASIN MANHOLE

CATCH BASIN

LIMIT OF SITE DEVELOPMENT



EXISTING STATUE

ACCESSIBLE BENCH WITH CONCRETE PAD

PROPOSED PICNIC TABLE

EXISTING TREE TO REMAIN

SITE SIGNAGE

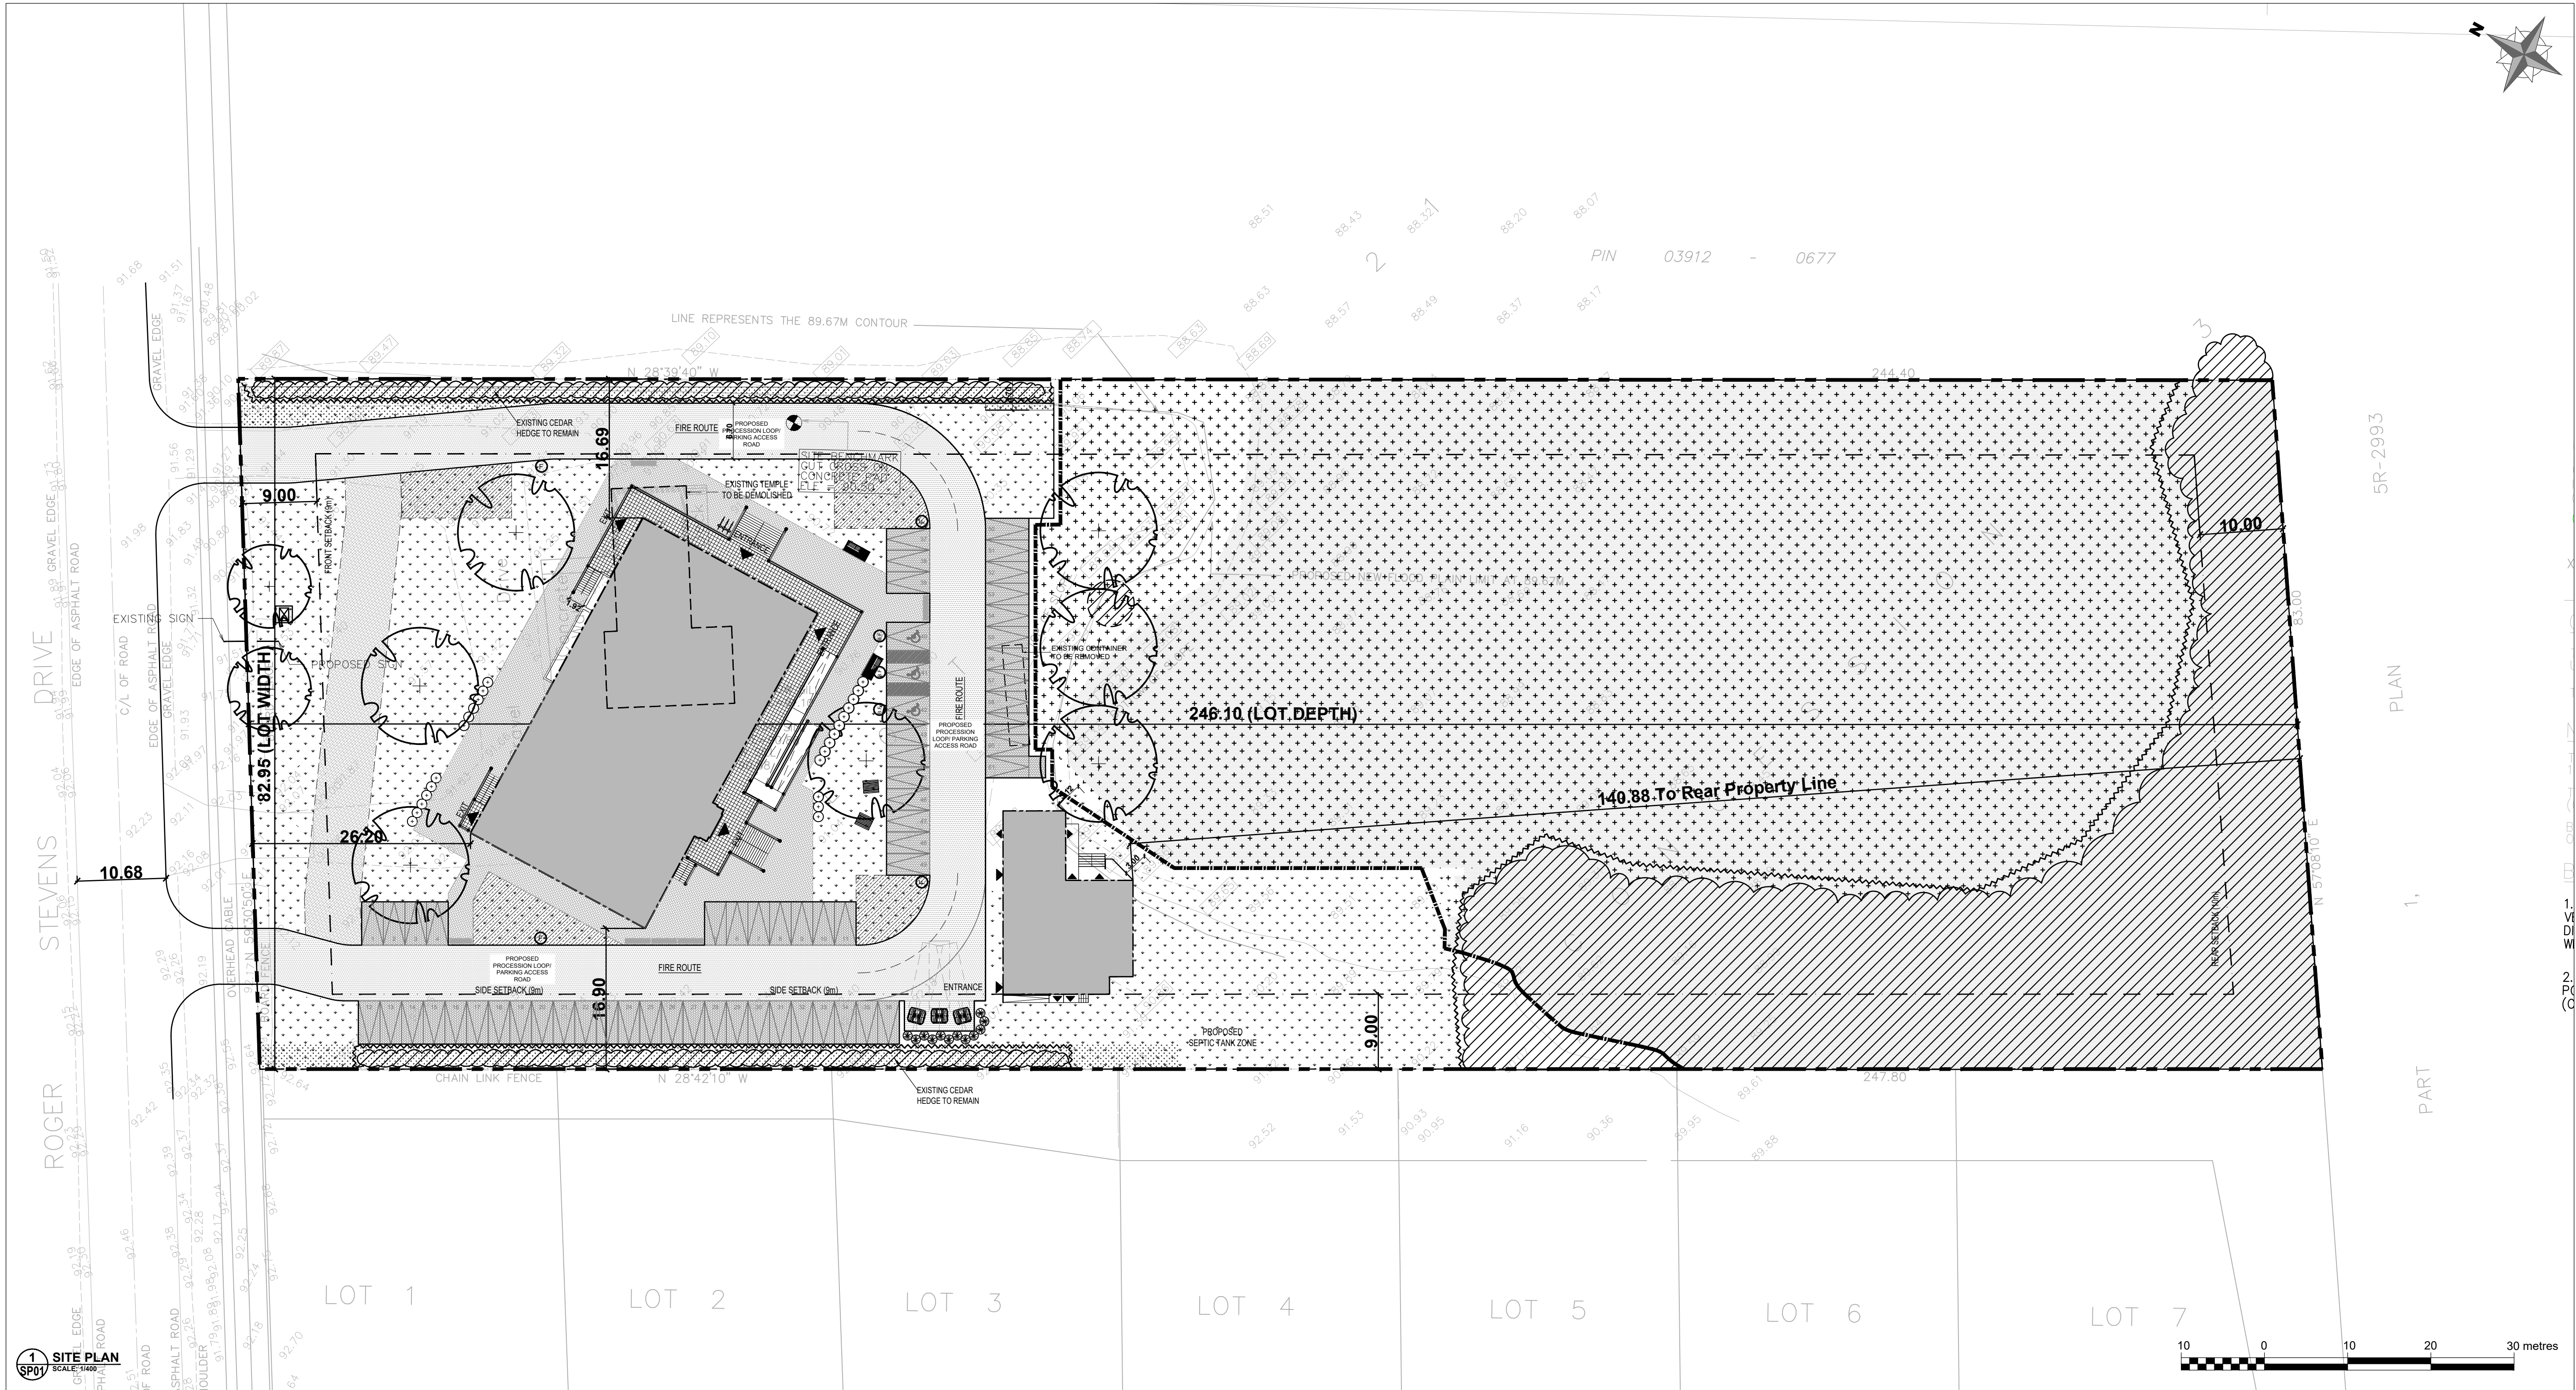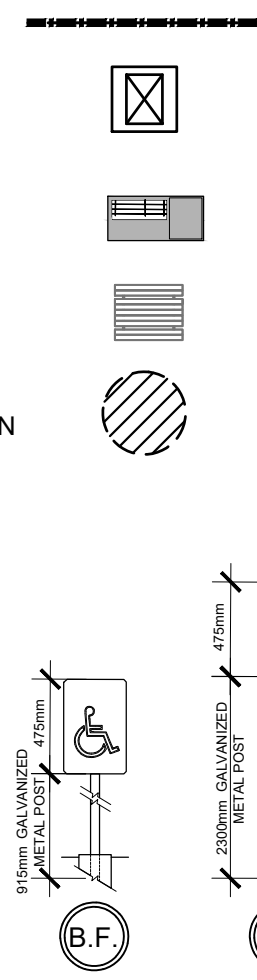

OWNER NAME & ADDRESS
Valluvambiga Sri Talyaynayaki Sametha
Vaihiyanathan Swamy Koll Inc.
Kugendran Sabaratnam
2104 Roger Stevens Rd North Gower, ON, K0A 2T0

ARCHITECT
OM P. MADAN ARCHITECT
8 AVE. Q, QUA. IMMAC.
7 SPENCER CRES.
OTTAWA, ONTARIO K2B 1B3
T: (613) 203-1805

APPLICANT AND DESIGNER
P-SQUARED CONCEPTS INC.
P² concepts

PROJECT TEAM (ENGINEERS)
PATerson GROUP
CIMAX
D.B. Gray Engineering Inc.
James B. Lemox & Associates Inc.
LANDSCAPE ARCHITECTS

PLAN OF SURVEY
INFORMATION SHOWN HAS BEEN TAKEN FROM
J.D. BARNES LIMITED
62 STEACIE DRIVE, SUITE 103,
KANATA, ON K2K 2A9
(613) 731-7244

TOPOGRAPHIC PLAN OF
PART OF LOT 21
CONCESSION 3
GEOGRAPHIC TOWNSHIP OF NORTH GOWER
NOW IN THE
CITY OF OTTAWA

BENCHMARK NOTE

1. IT IS THE RESPONSIBILITY OF THE USER OF THIS INFORMATION TO VERIFY THAT THE SITE BENCHMARK HAVE NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION SHOWN ON THIS DRAWING.

2. ELEVATIONS ARE GEODETIC AND REFERRED TO PUBLISHED CONTROL POINT 01019791716 HAVING A PUBLISHED ELEVATION OF 91.214 METRES (GVD28-78 DATUM)

09	ISSUED FOR COORDINATION	2025-05-13
08	ISSUED FOR REVIEW	2025-04-09
07	ISSUED FOR REVIEW	2025-04-03
06	ISSUED FOR COORDINATION	2025-03-06
05	ISSUED FOR COORDINATION	2024-10-04
04	ISSUED FOR COORDINATION	2024-09-26
04	ISSUED FOR COORDINATION	2024-08-08
03	ISSUED FOR CIVIL COORDINATION	2024-05-21
02	ISSUED FOR CLIENT REVIEW	2024-04-09
01	ISSUED FOR PHASE I PRE-CONSULT	2024-03-01
No.	REVISIONS	DATE

NOT AUTHENTIC UNLESS SIGNED AND DATED

P² concepts
2001 HURON ST. SUITE 205
OTTAWA, ONTARIO, K1G 4E1

DESIGNED BY: S.A. DRAWN BY: P.S. APPROVED BY: P.R.

PROJECT

NEW OTTAWA SIVAN TEMPLE

DRAWING TITLE

SITE PLAN

PROJECT NO. 0399
DATE MAY, 13, 2025

SP01

Measurements recorded in: ☐ Metric ☒ Imperial

A395525

Regulation 903 Ontario Water Resources Act

Page _____ of _____

Well Owner's Information

First Name	Last Name/Organization Ottawa Sivan Temple	E-mail Address	<input type="checkbox"/> Well Constructed by Well Owner
Mailing Address (Street Number/Name) 2104 Roger Stevens Drive	Municipality North Gower	Province ON	Postal Code K0A 2T0

Well Location

Address of Well Location (Street Number/Name) 2104 Roger Stevens Drive	Township Rideau	Lot P/L 21	Concession 3
County/District/Municipality Ottawa Carleton	City/Town/Village North Gower	Province Ontario	Postal Code
UTM Coordinates Zone NAD 83	Eastings 18 445192	Northing 4998614	Municipal Plan and Sublot Number 5R-6158

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m)
	Sand	Clay		0' to 25'
	Gravel	Boulders	Hard Pan	25' to 52'
Grey & Black	Limestone			52' to 154'
Grey & Black	Limestone			154' to 160'
Grey	Sandstone			160' to 170'
Grey	Sandstone			170' to 174'
Grey	Sandstone			174' to 180'

*Owner - Vallavambiga Sri Taiyalayaki Sametha
Vaithiyanatha Swamy Koil Inc. AS Ottawa Sivan Temple*

Annular Space			
Depth Set at (m)	From	To	Type of Sealant Used (Material and Type)
58'	48'		Neat cement
48'	0'		Bentonite slurry

Method of Construction		Well Use	
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Not used
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Municipal	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Irrigation	<input type="checkbox"/> Monitoring
<input type="checkbox"/> Other, specify		<input type="checkbox"/> Industrial	<input type="checkbox"/> Cooling & Air Conditioning
		<input type="checkbox"/> Other, specify	

Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m)	From	To
6 1/4"	Steel	.188"	+2'	58'	
6"	Open Hole			58'	180'

Construction Record - Screen			
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m)
			From To

Water Details		Hole Diameter	
Water found at Depth 154' (m) Gas	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Contested	Depth (m)	Diameter (cm/in)
Water found at Depth 170' (m) Gas	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Contested	From To	
Water found at Depth 174' (m) Gas	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Contested	0' 58'	9 3/4"
		58' 180'	6"

Business Name of Well Contractor Air Rock Drilling Co. Ltd.		Well Contractor's Licence No. 27881
Business Address (Street Number/Name) 5550 Frankton Road		Municipality Richmond
Province ON	Postal Code K0A 2Z0	Business E-mail Address air-rock@sympatico.ca

Bus. Telephone No. (inc. area code) 8138382170	Name of Well Technician (Last Name, First Name) Hanna, Jeremy
Well Technician's Licence No. 13632	Signature of Technician and/or Contractor <i>[Signature]</i>
Date 2024 09 30	Date 2024 09 30

Results of Well Yield Testing			
After test of well yield, water was:	Draw Down	Recovery	
<input type="checkbox"/> Clear and sand free	Time (min)	Water Level (m/ft)	Time (min)
<input type="checkbox"/> Other, specify Not tested	Static Level		Water Level (m/ft)
If pumping discontinued, give reason:	1	16.1	1
Pump intake set at (m/ft) 170	2	16.2	2
Pumping rate (l/min / GPM) 20	3	16.2	3
Duration of pumping 1 hrs + 0 min	4	16.2	4
Final water level end of pumping (m/ft) 16.5"	5	16.2	5
If flowing give rate (l/min/GPM)	10	16.3	10
Recommended pump depth (m/ft) 100	15	16.3	15
Recommended pump rate (l/min/GPM) 20	20	16.4	20
Well production (l/min/GPM) 20	25	16.4	25
Disturbed?	30	16.4	30
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	40	16.5	40
	50	16.5	50
	60	16.5	60

Map of Well Location	
Please provide a map below following instructions on the back.	
#2104 ROGER STEVENS DRIVE	
Trailwood Drive ← 150m →	
170 FT	
Comments: LHP-20 GPM Set @ 100 FT	
Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered 2024 09 30
Ministry Use Only	
Audit No. 2427310	
Received	

Print only in spaces provided.

Mark correct box with a checkmark, where applicable.

11

1531768

Municipality

15004

Con.

CON

03

County or District **CARLETON** Township/Borough/City/Town/Village **RIDEAU** Con. block tract survey, etc. **3** Lot **20** 25-27
Address **6626 3RD Line RD KARS** Date completed **16** day **01** month **2001** year 48-50
25-27 28-29 30-31 32-33 34-35 36-37 38-39 40-41 42-43 44-45 46-47 48-49 50-51 52-53 54-55 56-57 58-59 60-61 62-63 64-65 66-67 68-69 70-71 72-73 74-75 76-77 78-79 80-81 82-83 84-85 86-87 88-89 90-91 92-93 94-95 96-97 98-99 100-101 102-103 104-105 106-107 108-109 110-111 112-113 114-115 116-117 118-119 120-121 122-123 124-125 126-127 128-129 130-131 132-133 134-135 136-137 138-139 140-141 142-143 144-145 146-147 148-149 150-151 152-153 154-155 156-157 158-159 160-161 162-163 164-165 166-167 168-169 170-171 172-173 174-175 176-177 178-179 180-181 182-183 184-185 186-187 188-189 190-191 192-193 194-195 196-197 198-199 200-201 202-203 204-205 206-207 208-209 210-211 212-213 214-215 216-217 218-219 220-221 222-223 224-225 226-227 228-229 230-231 232-233 234-235 236-237 238-239 240-241 242-243 244-245 246-247 248-249 250-251 252-253 254-255 256-257 258-259 260-261 262-263 264-265 266-267 268-269 270-271 272-273 274-275 276-277 278-279 280-281 282-283 284-285 286-287 288-289 290-291 292-293 294-295 296-297 298-299 300-301 302-303 304-305 306-307 308-309 310-311 312-313 314-315 316-317 318-319 320-321 322-323 324-325 326-327 328-329 330-331 332-333 334-335 336-337 338-339 340-341 342-343 344-345 346-347 348-349 350-351 352-353 354-355 356-357 358-359 360-361 362-363 364-365 366-367 368-369 370-371 372-373 374-375 376-377 378-379 380-381 382-383 384-385 386-387 388-389 390-391 392-393 394-395 396-397 398-399 400-401 402-403 404-405 406-407 408-409 410-411 412-413 414-415 416-417 418-419 420-421 422-423 424-425 426-427 428-429 430-431 432-433 434-435 436-437 438-439 440-441 442-443 444-445 446-447 448-449 450-451 452-453 454-455 456-457 458-459 460-461 462-463 464-465 466-467 468-469 470-471 472-473 474-475 476-477 478-479 480-481 482-483 484-485 486-487 488-489 490-491 492-493 494-495 496-497 498-499 500-501 502-503 504-505 506-507 508-509 510-511 512-513 514-515 516-517 518-519 520-521 522-523 524-525 526-527 528-529 530-531 532-533 534-535 536-537 538-539 540-541 542-543 544-545 546-547 548-549 550-551 552-553 554-555 556-557 558-559 560-561 562-563 564-565 566-567 568-569 570-571 572-573 574-575 576-577 578-579 580-581 582-583 584-585 586-587 588-589 590-591 592-593 594-595 596-597 598-599 600-601 602-603 604-605 606-607 608-609 610-611 612-613 614-615 616-617 618-619 620-621 622-623 624-625 626-627 628-629 630-631 632-633 634-635 636-637 638-639 640-641 642-643 644-645 646-647 648-649 650-651 652-653 654-655 656-657 658-659 660-661 662-663 664-665 666-667 668-669 670-671 672-673 674-675 676-677 678-679 680-681 682-683 684-685 686-687 688-689 690-691 692-693 694-695 696-697 698-699 700-701 702-703 704-705 706-707 708-709 710-711 712-713 714-715 716-717 718-719 720-721 722-723 724-725 726-727 728-729 730-731 732-733 734-735 736-737 738-739 740-741 742-743 744-745 746-747 748-749 750-751 752-753 754-755 756-757 758-759 760-761 762-763 764-765 766-767 768-769 770-771 772-773 774-775 776-777 778-779 780-781 782-783 784-785 786-787 788-789 790-791 792-793 794-795 796-797 798-799 800-801 802-803 804-805 806-807 808-809 810-811 812-813 814-815 816-817 818-819 820-821 822-823 824-825 826-827 828-829 830-831 832-833 834-835 836-837 838-839 840-841 842-843 844-845 846-847 848-849 850-851 852-853 854-855 856-857 858-859 860-861 862-863 864-865 866-867 868-869 870-871 872-873 874-875 876-877 878-879 880-881 882-883 884-885 886-887 888-889 890-891 892-893 894-895 896-897 898-899 900-901 902-903 904-905 906-907 908-909 910-911 912-913 914-915 916-917 918-919 920-921 922-923 924-925 926-927 928-929 930-931 932-933 934-935 936-937 938-939 940-941 942-943 944-945 946-947 948-949 950-951 952-953 954-955 956-957 958-959 960-961 962-963 964-965 966-967 968-969 970-971 972-973 974-975 976-977 978-979 980-981 982-983 984-985 986-987 988-989 990-991 992-993 994-995 996-997 998-999 1000-1001 1002-1003 1004-1005 1006-1007 1008-1009 1010-1011 1012-1013 1014-1015 1016-1017 1018-1019 1020-1021 1022-1023 1024-1025 1026-1027 1028-1029 1030

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	clay		thick	0	10
Grey	clay		Runny	10	20
Grey	Clay	Sandy, with Boulders,	HARD Pan	20	36
Grey	Limestone	BROKEN LAYERS,	Sand MED HARD	36	48
Grey	Limestone		MED HARD	48	65
		43' OF 6 1/4" casing			
		20' OF 5" casing			
		1 Heavy Duty DRIVE shoe			
		1 well cap			
		10 Bags OF Cement			

[illegible]

41	10				14 15				21			
WATER RECORD												
Water found at - feet				Kind of water								
<div> <div>13</div> <div>53</div> </div>				1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty		3 <input type="checkbox"/> Sulphur 4 <input checked="" type="checkbox"/> Minerals 6 <input type="checkbox"/> Gas		14				
15-18				1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty		3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 6 <input type="checkbox"/> Gas		19				
20-23				1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty		3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 6 <input type="checkbox"/> Gas		24				
25-28				1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty		3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 6 <input type="checkbox"/> Gas		29				
30-33				1 <input type="checkbox"/> Fresh 2 <input type="checkbox"/> Salty		3 <input type="checkbox"/> Sulphur 4 <input type="checkbox"/> Minerals 6 <input type="checkbox"/> Gas		34				

CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
6 1/4	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	.188	0	38
5 1/4	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	.188	30	50
4 3/8	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic		50	65
24-25	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic			27-30

SCREEN	Sizes of opening (Slot No.)	31-33	Diameter	34-38	Length	39-40
			inches		feet	
	Material and type			Depth at top of screen 41-44		
				feet		

61 PLUGGING & SEALING RECORD			
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
0 ³	38	Cement Grout	
18-21	22-25		
26-29	30-33	80	

PUMPING TEST	Pumping test method ¹⁰ 1 <input type="checkbox"/> Pump 2 <input checked="" type="checkbox"/> Bailer		Pumping rate ¹¹⁻¹⁴ 10 GPM		Duration of pumping ¹⁵⁻¹⁸ 1 Hours 17-18 Mins	
	Static level		Water level end of pumping ²⁵		Water levels during 1 <input checked="" type="checkbox"/> Pumping 2 <input type="checkbox"/> Recovery	
	19-21 3 feet	22-24 40 feet	15 minutes ²⁶⁻²⁸ 40 feet	30 minutes ²⁹⁻³¹ 40 feet	45 minutes ³²⁻³⁴ 40 feet	60 minutes ³⁵⁻³⁷ 40 feet
	If flowing give rate ³⁸⁻⁴¹ GPM		Pump intake set at feet		Water at end of test ⁴² <input checked="" type="checkbox"/> Clear <input type="checkbox"/> Cloudy	
	Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep		Recommended pump setting ⁴³⁻⁴⁵ 50 feet		Recommended pump rate ⁴⁶⁻⁴⁹ 7 GPM	
	50-53					

FINAL STATUS OF WELL		54
1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)	
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering	

WATER USE		55-56
1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply	
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning	

METHOD OF CONSTRUCTION		57
1 <input checked="" type="checkbox"/> Cable tool	5 <input type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other
4 <input type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting	

LOCATION OF WELL

In diagram below show distances of well from road and lot line.
Indicate north by arrow.

Roger Stevens DR.

Address

3rd Line Rd

4th Line

Pumped well for
49 hrs until clear

227611

Name of Well Contractor B. MOORE Well Drilling	Well Contractor's License No. 6455
Address Box 436 OSAGE OAK KOA 2ND	
Name of Well Technician BOB MOORE	Well Technician's License No. T-0319
Signature of Technician/Contractor <i>Bob Moore</i>	Submission date 17 01 2001 day mo yr

MINISTRY USE ONLY	Data source	58 Contractor	59-62	Date received	63-68	69
		64 55		MAR 01 2001		
	Date of inspection	Inspector				
	Remarks					
	CSS.ES1					

Print only in spaces provided. Mark correct box with a checkmark, where applicable.

11

1532449

Municipality 15004 Con. CAN Plan # 4 11773

County or District: Ottawa-Carleton Township/Borough/City/Town/Village: North Gower Con block tract survey, etc.: 3 block 21 Lot: 5

Owner's surname: Hans and Jo construction First Name: Address: north Daniel 166 Date completed: 24/19/01

Zone: Easting: Northing: RC: Elevation: RC: Basin Code: ii iii iv

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)					
General colour	Most common material	Other materials	General description	Depth - feet	
				From	To
Brown	Till	Boulder	Dense	0	9
Gray	"	"	"	9	48
Gray	limestone Rock		Fractured	48	85

31 32

41 WATER RECORD

Water found at - feet: 70 Kind of water: 1 Fresh 3 Sulphur 4 Minerals 6 Gas

51 CASING & OPEN HOLE RECORD

Inside diam inches: 8 1/4 Material: 1 Steel 2 Galvanized 3 Concrete 4 Open hole 5 Plastic Wall thickness inches: 1/2 Depth - feet: From To

54 SCREEN

Sizes of opening (Slot No.): 31-33 Diameter: 34-38 Length: 39-40

61 PLUGGING & SEALING RECORD

Annular space: Abandonment: Depth set at - feet: From To Material and type (Cement grout, bentonite, etc.): 0 48 Cement grout

71 PUMPING TEST

Pumping test method: 1 Pump 2 Bailor Pumping rate: 12 GPM Duration of pumping: 0 Hours 17-18 Mins

FINAL STATUS OF WELL

Water supply: 1 Water supply 2 Observation well 3 Test hole 4 Recharge well

WATER USE

Method of construction

LOCATION OF WELL

In diagram below show distances of well from road and lot line. Indicate north by arrow.

232401

Name of Well Contractor: Gilles Bourgeois well drill Well Contractor's Licence No.: 1414

Address: ST-ALBERT

Name of Well Technician: Jacques Raymond Well Technician's Licence No.: 0264

Signature of Technician/Contractor: Gilles Bourgeois Submission date: 24 10 01

MINISTRY USE ONLY

Data source: 1414 Date received: NOV 02 2001

Date of inspection: Inspector:

Remarks:



The Ontario Water Resources Act

WATER WELL RECORD

Print only in spaces provided.

Mark correct box with a checkmark, where applicable.

11

1532710

Municipality
15004

Con. **CON** **03**

County or District Ottawa Carleton	Township/Borough/City/Town/Village Rideau	Con block tract survey, etc. 3	Lot 1	25-27
Address Northower, Ont		Date completed 04 04 02 day month year		

21

1 2

0
T
M

10 12 13 14 15 16 17

Northing

18 19 20 21 22 23 24

RC

Elevation

25 26 27 28 29 30

Basin Code

ii iii iv

31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)

[illegible]

31

32

41		10		14		15		21	
WATER RECORD									
Water found at - feet			Kind of water						
10-13 142			1	<input checked="" type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	14		
			2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals			
15-18			1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	19		
			2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals			
20-23			1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	24		
			2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals			
25-28			1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	29		
			2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals			
30-33			1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	34		
			2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals			

CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
10-11 6 $\frac{1}{4}$	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic	12 188	0	46
17-18 8 $\frac{3}{4}$	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input checked="" type="checkbox"/> Open hole <input type="checkbox"/> Plastic	19	0	44
24-25 6	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input checked="" type="checkbox"/> Open hole <input type="checkbox"/> Plastic	26	44	150

SCREEN	54	60	75	86
	Sizes of opening (Slot No.)	31-33	Diameter 34-38 inches	Length 39-40 feet
	Material and type		Depth at top of screen 41-44 feet	30

61				PLUGGING & SEALING RECORD			
<input checked="" type="checkbox"/> Annular space				<input type="checkbox"/> Abandonment			
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)					
From	To						
10-13	14-17	bentonite					
246							
18-21	22-25						
26-29	30-33	80					

PUMPING TEST	Pumping test method ¹⁰ 1 <input checked="" type="checkbox"/> Pump 2 <input type="checkbox"/> Bailer		Pumping rate ¹¹⁻¹⁴ 20 GPM		Duration of pumping ¹⁵⁻¹⁸ 1 Hours ¹⁷⁻¹⁸ Mins	
	Static level ¹⁹⁻²¹ 8 feet		Water level end of pumping ²²⁻²⁴ 70 feet		Water levels during ²⁵ 1 <input type="checkbox"/> Pumping 2 <input checked="" type="checkbox"/> Recovery	
			15 minutes ²⁶⁻²⁸ 8 feet		30 minutes ²⁹⁻³¹ 8 feet	
			45 minutes ³²⁻³⁴ 8 feet		60 minutes ³⁵⁻³⁷ 8 feet	
	If flowing give rate ³⁸⁻⁴¹ GPM		Pump intake set at ⁴² feet		Water at end of test ⁴³ <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy	
	Recommended pump type ⁴⁴⁻⁴⁵ <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep		Recommended pump setting ⁴⁶⁻⁴⁹ 70 feet		Recommended pump rate ⁵⁰⁻⁵³ 20 GPM	

FINAL STATUS OF WELL			54
1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished	
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well	
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)		
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering		

WATER USE			55-56
1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use	
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other	
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply		
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning		

METHOD OF CONSTRUCTION			57
1 <input type="checkbox"/> Cable tool	5 <input checked="" type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving	
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging	
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other	
4 <input type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting		

LOCATION OF WELL

In diagram below show distances of well from road and lot line.
Indicate north by arrow.


↑ N

100'

← 11 Km

Trailwood.

237826

Name of Well Contractor A. Koch Drilling Ltd	Well Contractor's Licence No. 1119
Address RR #1 Richmond, Ont	
Name of Well Technician Shannon Purcell	Well Technician's Licence No. T2122
Signature of Technician/Contractor 	Submission date 10 day 04 mo 02 yr

MINISTRY USE ONLY	Data source	58	Contractor	59-62	Date received	63-68	69
			1119		APR 15 2002		
	Date of inspection		Inspector				
	Remarks	CSS.ES2					

Print only in spaces provided.

Mark correct box with a checkmark, where applicable.

11

1533234

Municipality
150

Con

County or District <i>Ottawa Carleton</i>	Township/Borough/City/Town/Village <i>Osgood</i>	Con block tract survey, etc. <i>PLAN 4/M-773</i>	Lot <i>8</i>
Address <i>2180 Trailwood Drive North Gower</i>		Date completed <i>07/10/02</i>	<i>48:53</i>

21

1 2

U
T
M

10 15 17

Normal

18 24

15

25

26

30

21

22

23

24

25

26

27

28

29

30

31

32

33

34

35

36

37

38

39

40

41

42

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)[illegible]

31

32

10 14 15 31 20 49 64 65 75 90

41		WATER RECORD		42	
Water found at - feet		Kind of water			
10-13 <i>80</i>	1 <input checked="" type="checkbox"/> Fresh	3 <input type="checkbox"/> Sulphur	14		
	2 <input type="checkbox"/> Salty	4 <input type="checkbox"/> Minerals			
15-18	1 <input type="checkbox"/> Fresh	3 <input type="checkbox"/> Sulphur	19		
	2 <input type="checkbox"/> Salty	4 <input type="checkbox"/> Minerals			
20-23	1 <input type="checkbox"/> Fresh	3 <input type="checkbox"/> Sulphur	24		
	2 <input type="checkbox"/> Salty	4 <input type="checkbox"/> Minerals			
25-28	1 <input type="checkbox"/> Fresh	3 <input type="checkbox"/> Sulphur	29		
	2 <input type="checkbox"/> Salty	4 <input type="checkbox"/> Minerals			
30-33	1 <input type="checkbox"/> Fresh	3 <input type="checkbox"/> Sulphur	34		
	2 <input type="checkbox"/> Salty	4 <input type="checkbox"/> Minerals			

51 CASING & OPEN HOLE RECORD					
Inside diam inches	Material	Wall thickness inches	Depth - feet		
			From	To	
10-11 8 3/4"	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	12	0	13-16 45	
17-18 6 1/4"	1 <input checked="" type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	19	1.88	20-23 + 2 45	
24-25 6"	1 <input type="checkbox"/> Steel 2 <input type="checkbox"/> Galvanized 3 <input type="checkbox"/> Concrete 4 <input checked="" type="checkbox"/> Open hole 5 <input type="checkbox"/> Plastic	26		27-30 45 90	

SCREEN	Sizes of opening (Slot No.)	31-33	Diameter	34-38	Length	39-40
			inches		feet	
	Material and type			Depth at top of screen		30
				41-44		
				feet		

61 PLUGGING & SEALING RECORD			
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
10-13 18-21	14" 22-25		
26-29	30-33	80	

PUMPING TEST	71 Pumping test method ¹⁰ 1 <input type="checkbox"/> Pump <u>4-4</u> ¹⁰ <u>Water</u>		Pumping rate ¹¹⁻¹⁴ <u>7</u> GPM		Duration of pumping ¹⁵⁻¹⁶ <u>1</u> Hours <u>0</u> ¹⁷⁻¹⁸ Mins	
	Static level		Water level end of pumping ²⁵		Water levels during 1 <input type="checkbox"/> Pumping 2 <input checked="" type="checkbox"/> <u>Recovery</u>	
	¹⁹⁻²¹ <u>18</u> feet		²²⁻²⁴ <u>90</u> feet		²⁵⁻²⁸ <u>24</u> feet	
	²⁹⁻³¹ <u>22</u> feet		³²⁻³⁴ <u>20</u> feet		³⁵⁻³⁷ <u>18</u> feet	
	If flowing give rate ³⁸⁻⁴¹ GPM		Pump intake set at <u>90</u> feet		Water at end of test ⁴² <input type="checkbox"/> Clear <input checked="" type="checkbox"/> <u>Cloudy</u>	
	Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> <u>Deep</u>		Recommended pump setting ⁴³⁻⁴⁵ <u>80</u> feet		Recommended pump rate ⁴⁶⁻⁴⁹ <u>6</u> GPM	

FINAL STATUS OF WELL			54
1	<input checked="" type="checkbox"/> Water supply	5	<input type="checkbox"/> Abandoned, insufficient supply
2	<input type="checkbox"/> Observation well	6	<input type="checkbox"/> Abandoned, poor quality
3	<input type="checkbox"/> Test hole	7	<input type="checkbox"/> Abandoned (Other)
4	<input type="checkbox"/> Recharge well	8	<input type="checkbox"/> Dewatering
9	<input type="checkbox"/> Unfinished		
10	<input type="checkbox"/> Replacement well		

WATER USE			55-56
1	<input checked="" type="checkbox"/> Domestic	5	<input type="checkbox"/> Commercial
2	<input type="checkbox"/> Stock	6	<input type="checkbox"/> Municipal
3	<input type="checkbox"/> Irrigation	7	<input type="checkbox"/> Public supply
4	<input type="checkbox"/> Industrial	8	<input type="checkbox"/> Cooling & air conditioning
9	<input type="checkbox"/> Not use		
10	<input type="checkbox"/> Other		

METHOD OF CONSTRUCTION			57
1	<input type="checkbox"/> Cable tool	5	<input type="checkbox"/> Air percussion
2	<input type="checkbox"/> Rotary (conventional)	6	<input type="checkbox"/> Boring
3	<input type="checkbox"/> Rotary (reverse)	7	<input type="checkbox"/> Diamond
4	<input checked="" type="checkbox"/> Rotary (air)	8	<input type="checkbox"/> Jetting
9	<input type="checkbox"/> Driving		
10	<input type="checkbox"/> Digging		
11	<input type="checkbox"/> Other		

LOCATION OF WELL

In diagram below show distances of well from road and lot line.
Indicate north by arrow.

Maple Forest Estate Subd.

252700

Name of Well Contractor <i>Gilles Bourgeois well drill</i>	Well Contractor's Licence No. <i>1414</i>
Address <i>St-Albert Ont.</i>	
Name of Well Technician <i>Jacques Raymond</i>	Well Technician's Licence No. <i>T-0264</i>
Signature of Technician/Contractor	Submission date day mo yr

MINISTRY USE ONLY	Data source	58	Contractor	59-62	Date received	63-68	69	
			1414		OCT 21 2002			
	Date of inspection		Inspector					
	Remarks							
	CSS.ES2							

Print only in spaces provided.

Mark correct box with a checkmark, where applicable.

11

1533324

Municipality

15004

Con.

County or District <i>Ottawa Carleton</i>		Township/Borough/City/Town/Village <i>North Gower</i>	Con block tract survey, etc. <i>Plan 4M-773</i>	Lot <i>6</i>
Owner's surname <i>Ontario Ltd</i>	First Name <i>724471</i>	Address <i>2120 TRAILWOOD DR. N. GOWER</i>	Date completed <i>28/10/02</i> day month year	

21

U

Fasting

Nothing

RC

Elevation

1

Basin Code

ii

10

10

iii

1

in

LOG OF OVERBURDEN AND BEDROCK MATERIALS (see instructions)[illegible]

31

32

41		10		14		15		21	
WATER RECORD									
Water found at - feet		Kind of water							
10-13		1	<input checked="" type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	14			
80		2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals				
				6	<input type="checkbox"/> Gas				
15-18		1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	19			
		2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals				
				6	<input type="checkbox"/> Gas				
20-23		1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	24			
		2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals				
				6	<input type="checkbox"/> Gas				
25-28		1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	29			
		2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals				
				6	<input type="checkbox"/> Gas				
30-33		1	<input type="checkbox"/> Fresh	3	<input type="checkbox"/> Sulphur	34			
		2	<input type="checkbox"/> Salty	4	<input type="checkbox"/> Minerals				
				6	<input type="checkbox"/> Gas				

51 CASING & OPEN HOLE RECORD				
Inside diam inches	Material	Wall thickness inches	Depth - feet	
			From	To
10-11 8 3/4"	<input type="checkbox"/> Steel <input checked="" type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input checked="" type="checkbox"/> Open hole <input type="checkbox"/> Plastic	12	0	13-16 45
17-18 6 1/4"	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic	19	188 + 2	20-23 45
24-25 6"	<input type="checkbox"/> Steel <input type="checkbox"/> Galvanized <input type="checkbox"/> Concrete <input type="checkbox"/> Open hole <input type="checkbox"/> Plastic	26	45	27-30 90

SCREEN	Sizes of opening (Slot No.)	31-33	Diameter	34-38	Length	39-40
			inches		feet	
	Material and type				Depth at top of screen	30
					feet	

61		PLUGGING & SEALING RECORD	
<input checked="" type="checkbox"/> Annular space		<input type="checkbox"/> Abandonment	
Depth set at - feet		Material and type (Cement grout, bentonite, etc.)	
From	To		
0-13	45	Cement grout	
18-21	22-25		
26-29	30-33		
		80	

PUMPING TEST	Pumping test method ¹⁰ 1 <input type="checkbox"/> Pump <i>AIR</i> Bailer		Pumping rate ¹¹⁻¹⁴ <i>15</i> GPM		Duration of pumping ¹⁵⁻¹⁸ <i>1</i> Hours <i>0</i> Mins	
	Static level ¹⁹⁻²¹ <i>16</i> feet		Water level end of pumping ²²⁻²⁴ <i>90</i> feet		Water levels during ²⁵ 1 <input type="checkbox"/> Pumping 2 <input checked="" type="checkbox"/> Recovery	
	15 minutes ²⁶⁻²⁸ <i>22</i> feet		30 minutes ²⁹⁻³¹ <i>20</i> feet		45 minutes ³²⁻³⁴ <i>18</i> feet	
	60 minutes ³⁵⁻³⁷ <i>16</i> feet		If flowing give rate ³⁸⁻⁴¹ GPM		Pump intake set at ⁴² <i>90</i> feet	
	Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep		Recommended pump setting ⁴³⁻⁴⁵ <i>75</i> feet		Recommended pump rate ⁴⁶⁻⁴⁸ <i>10</i> GPM	
					Water at end of test <input type="checkbox"/> Clear <input checked="" type="checkbox"/> Cloudy	

FINAL STATUS OF WELL			54
1 <input checked="" type="checkbox"/> Water supply	5 <input type="checkbox"/> Abandoned, insufficient supply	9 <input type="checkbox"/> Unfinished	
2 <input type="checkbox"/> Observation well	6 <input type="checkbox"/> Abandoned, poor quality	10 <input type="checkbox"/> Replacement well	
3 <input type="checkbox"/> Test hole	7 <input type="checkbox"/> Abandoned (Other)		
4 <input type="checkbox"/> Recharge well	8 <input type="checkbox"/> Dewatering		

WATER USE			55-56
1 <input checked="" type="checkbox"/> Domestic	5 <input type="checkbox"/> Commercial	9 <input type="checkbox"/> Not use	
2 <input type="checkbox"/> Stock	6 <input type="checkbox"/> Municipal	10 <input type="checkbox"/> Other	
3 <input type="checkbox"/> Irrigation	7 <input type="checkbox"/> Public supply		
4 <input type="checkbox"/> Industrial	8 <input type="checkbox"/> Cooling & air conditioning		

METHOD OF CONSTRUCTION			57
1 <input type="checkbox"/> Cable tool	5 <input type="checkbox"/> Air percussion	9 <input type="checkbox"/> Driving	
2 <input type="checkbox"/> Rotary (conventional)	6 <input type="checkbox"/> Boring	10 <input type="checkbox"/> Digging	
3 <input type="checkbox"/> Rotary (reverse)	7 <input type="checkbox"/> Diamond	11 <input type="checkbox"/> Other	
4 <input checked="" type="checkbox"/> Rotary (air)	8 <input type="checkbox"/> Jetting		

LOCATION OF WELL

In diagram below show distances of well from road and lot line.
Indicate north by arrow.

252742

Name of Well Contractor <i>Gilles Bourgeois Well Drill</i>	Well Contractor's Licence No. <i>1414</i>
Address <i>St-Albert Ont.</i>	
Name of Well Technician <i>Jacques Raymond</i>	Well Technician's Licence No. <i>T-0264</i>
Signature of Technician/Contractor <i>Gilles Bourgeois</i>	Submission date <i>28 11 02</i> day mo yr

MINISTRY USE ONLY	Data source	58 Contractor	59-62	Date received	63-68	80
		1414		NOV 08 2002		
	Date of inspection	Inspector				
	Remarks					
	CSS.ES2					

Instructions for Completing Form

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10th of a metre.**
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

First Name Hansand J	Last Name Construction	Mailing Address (Street Number/Name, RR, Lot, Concession) 2108 Regional Rd 8	
County/District/Municipality City of Ottawa	Township/City/Town/Village NORTH LOWER	Province Ontario	Postal Code K0A 2T0
Address of Well Location (County/District/Municipality) City of Ottawa		Township Osgoode	Lot 38
RR#/Street Number/Name 6647 Stillwood DRIVE		City/Town/Village NORTH LOWER	Site/Compartment/Block/Tract etc. Plan 4M-1209
GPS Reading NAD 83	Zone 18	Easting 445173 E	Northing 4998194
Unit Make/Model Magellan		Mode of Operation: <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify	

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth From	Metres To
brown	fill		Hard	0	3.0
grey	fill	boulders	Hard	3.0	11.88
grey	limestone		layered	11.88	27.43

Hole Diameter			Construction Record				Test of Well Yield				
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down	Recovery	
0	11.88	22.23						34HPS46	Time min	Water Level Metres	
11.88	27.43	15.55						25	5.10	5.90	
								60	5.58	5.50	
								1	5.70	5.42	
								2	5.73	5.40	
								3	5.80	5.38	
								4	5.90	5.35	
								5	5.81	5.30	
								10	5.86	5.25	
								15	5.89	5.20	
								20	5.90	5.20	
								25	5.90	5.20	
								30	5.90	5.20	
								40	5.90	5.20	
								50	5.90	5.20	
								60	5.90	5.20	

Plugging and Sealing Record			Annular space	Abandonment
Depth set at - Metres	From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
0	11.88		neat cement grout	96 bag

Method of Construction			
<input type="checkbox"/> Cable Tool	<input checked="" type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	

Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	

Final Status of Well	
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality
<input type="checkbox"/> Unfinished	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Abandoned, (Other)	<input type="checkbox"/> Replacement well

Well Contractor/Technician Information	
Name of Well Contractor Gilles Bouargneis	Well Contractor's Licence No. 1414
Business Address (street name, number, etc.) 5741 16th ave	
Name of Well Technician (last name, first name) SA me	Well Technician's Licence No. 0-193
Signature of Technician/Contractor x Gilles Bouargneis	Date Submitted 04 09 16

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	

Audit No. 12199	Date Well Completed 04 09 16
Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered 04 09 16

Ministry Use Only	
Data Source	Contractor 1414
Date Received AUG 30 2004	Date of Inspection 04 09 16
Remarks	Well Record Number 1534867



Ministry of
the Environment

Well Tag

A 012062

Well Record

Regulation 903 Ontario Water Resources Act

page ____ of ____

Instructions for Completing Form

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10th of a metre.
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

First Name Hans and Jo	Last Name Const Ruction	Mailing Address (Street Number/Name, RR Lot, Concession) 124471 on Ltd 2108 Regional Rd 8	
County/District/Municipality City of Ottawa	Township/City/Town/Village Osgoode	Province Ontario	Postal Code 613-838-2463
Address of Well Location (County/District/Municipality) City of Ottawa		Township Osgoode	Lot 37
RR#/Street Number/Name MA. Stillwood Drive		City/Town/Village NORTH Osgoode	Site/Compartment/Block/Tract etc. Plan 4M-1209
GPS Reading 8.3	NAD 18	Zone 44517.0 E	Easting 4998147
Unit Make/Model Magellan		Mode of Operation: <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify _____	

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth From	Metres To
brown	fill		Hard	0	2.90
grey	fill	solids	Hard	2.90	10.36
grey	limestone		layered	10.36	24.38

Hole Diameter			Construction Record				Test of Well Yield			
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down	Recovery
0	10.36	22.23						3-HP sub	Time min	Water Level Metres
10.36	24.38	15.55						Pump intake set at - (metres) 18	Static Level	3.90
				<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass	0.48	0	10.36	Pumping rate - (litres/min) 60	1	4.28
				<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete				Duration of pumping 1 hrs + 0 min	2	4.33
				<input type="checkbox"/> Galvanized				Final water level end of pumping 4.52 metres	3	4.14
				<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass				Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	4	4.37
				<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete				Recommended pump depth 18 metres	5	4.57
				<input type="checkbox"/> Galvanized				Recommended pump rate (litres/min) 44	10	4.46
								If flowing give rate - (litres/min)	15	4.46
									20	4.51
									25	4.54
									30	4.54
									40	4.54
									50	4.52
									60	4.52

Plugging and Sealing Record			<input type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at	Metres To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)	
0	10.00	cement slurry	8 bags	

Method of Construction			
<input type="checkbox"/> Cable Tool	<input checked="" type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging*
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	
Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	
Final Status of Well			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Well Contractor/Technician Information	
Name of Well Contractor Gilles Bourgeois	Well Contractor's Licence No. 1414
Business Address (street name, number, city etc.) 5741 Berrand Ave	
Name of Well Technician (last name, first name) SA me	Well Technician's Licence No. 0-193
Signature of Technician/Contractor x Gilles Bourgeois	Date Submitted 04/08/16

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No. Z 12198	Date Well Completed 04/08/16
Was the well owner's information package delivered? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date Delivered 04/08/16

Ministry Use Only	
Data Source	Contractor 1414
Date Received AUG 30 2004	Date of Inspection 04/08/16
Remarks	Well Record Number 1534868



022034

Well Record

Regulation 903 Ontario Water Resources Act

page _____ of _____

Instructions for Completing Form

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- **All metre measurements shall be reported to 1/10th of a metre.**
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

MUN

CON

LOT

STREET NUMBER/NAME * 2134 TRAILWOOD DRIVE				CITY/TOWN/VILLAGE NORTH GOWER		SITE/COMPARTMENT/BLOCK/TRACT, ETC. PLAN 4M-113, S/L 9	
GPS READING		NAD 83	Zone 18	Easting 445119	Northings 4998321	UNIT MAKE/MODEL MAGELLAN	MODE OF OPERATION: <input type="checkbox"/> Undifferentiated <input type="checkbox"/> Differentiated, specify <input checked="" type="checkbox"/> Averaged

Log of Overburden and Bedrock Materials (see instructions)

[illegible]

Hole Diameter			Construction Record				Test of Well Yield					
Depth	Metres	Diameter	Inside diam centimetres	Material	Wall thickness centimetres	Depth		Pumping test method	Draw Down		Recovery	
From	To	Centimetres				From	To		Time min	Water Level Metres	Time min	Water Level Metres
0	36.57	15.23						Sub pump	Static Level	6.88		7.25
								Pump intake set at - (metres)	1	7.77	1	7.06
								Pumping rate - (litres/min)	2	7.23	2	7.95
								Duration of pumping	3	7.23	3	7.90
								Final water level end of pumping	4	7.23	4	7.88
								Recommended pump type	5	7.23	5	
								Recommended pump depth	10	7.23	10	
								Recommended pump rate	15	7.23	15	
								If flowing give rate - (litres/min)	20	7.23	20	
								If pumping discontinued, give reason	25	7.23	25	
									30	7.23	30	
									40	7.24	40	
									50	7.24	50	
									60	7.23	60	

Water Record			
Water found at	Kind of Water		
33.32 m	<input type="checkbox"/> Fresh <input type="checkbox"/> Sulphur		
<input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals			
<input type="checkbox"/> Other:			
	<input type="checkbox"/> Fresh <input type="checkbox"/> Sulphur		
<input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals			
<input type="checkbox"/> Other:			
After test of well yield, water was			
<input type="checkbox"/> Clear and sediment free			
<input type="checkbox"/> Other, specify			
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No			

Casing			
15.88	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass	.48	0 17.37
	<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete		
	<input type="checkbox"/> Galvanized		
	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass		
	<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete		
	<input type="checkbox"/> Galvanized		
	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass		
	<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete		
	<input type="checkbox"/> Galvanized		
Screen			
Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass	Slot No.	
	<input type="checkbox"/> Plastic <input type="checkbox"/> Concrete		
	<input type="checkbox"/> Galvanized		
No Casing or Screen			
	<input checked="" type="checkbox"/> Open hole	16.76	36.57

Plugging and Sealing Record		<input checked="" type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at - Metres		Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
From	To		
11.76	13.71	NEAT CEMENT SLURRY	- 454
13.71	0	BENTONITE SLURRY	- 123

Method of Construction			
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input checked="" type="checkbox"/> Boring	<input type="checkbox"/> Driving	


Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	

Final Status of Well			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other) _____
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Well Contractor/Technician Information	
Name of Well Contractor	Well Contractor's Licence No.
AIRROCK DRILLING CO LTD	TU119
Business Address (street name, number, city etc.)	
RR #1 RICHMOND ONT	K0A2Z0
Name of Well Technician (last name, first name)	Well Technician's Licence No.
HOGAN DAN	T3058
Signature of Technician/Contractor	Date Submitted
[Signature]	yyyy mm dd 2005 03 22

Location of Well

In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.

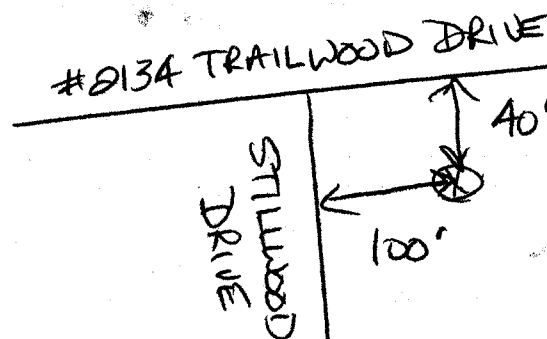

Audit No. z 23248	Date Well Completed 2005 04 27
Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered 2005 04 27

Ministry Use Only				
Data Source		Contractor		
Date Received		Date of Inspection		
YYYY	MM	DD	YYYY	MM
DD		DD		
Remarks		Well Record Number		

Instructions for Completing Form

page ____ of ____

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10th of a metre.
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

Ministry Use Only									
MUN								CON	LOT

City/Town/Village **City of Ottawa** North Corner **39**

RR#/Street Number/Name **6643 5011 Wood DR.** City/Town/Village **NORTH Corner** Site/Compartment/Block/Tract etc. **Plan 4 M-1209**

GPS Reading **8 3** NAD **18** Zone **44** Easting **5174 E** Northing **4998222** Unit Make/Model **Magellan** Mode of Operation: ☐ Undifferentiated ☒ Averaged ☐ Differentiated, specify

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth From	Metres To
Brown	fill	boulders	Hard	0	4.26
grey	fill	boulders	Hard	4.26	9.14
grey	11 m. stone		Fracture	9.14	11.27
grey	11 m. stone		layered	11.27	27.43

Hole Diameter			Construction Record				Test of Well Yield					
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down Time min	Water Level Metres	Recovery Time min	Water Level Metres
0	11.27	21.23						2. H.P. sub				
11.27	27.43	15.55	15.55	Steel	0.48	+0.60	11.27	Pump intake set at (metres) 15	1	3.36	1	3.93
				Plastic				Pumping rate - (litres/min) 40	2		2	
				Galvanized				Duration of pumping 1 hrs + 0 min	3	3.70	3	3.36
				Steel				Final water level end of pumping 2.93 metres	4	3.78	4	
				Plastic				Recommended pump type. <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	5	3.83	5	
				Galvanized				Recommended pump depth. 15 metres	10	3.93	10	
				Steel				Recommended pump rate. 40 (litres/min)	15	3.93	15	
				Plastic				If flowing give rate - (litres/min)	20	3.93	20	
				Galvanized				If pumping discontinued, give reason.	25	3.93	25	
									30	3.93	30	
									40	3.93	40	
									50	3.93	50	
									60	3.93	60	

Plugging and Sealing Record			
Depth set at - Metres From	Metres To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)
0	11.27	neat cement slurry	6 Bags

Method of Construction			
<input type="checkbox"/> Cable Tool	<input checked="" type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	

Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	

Final Status of Well			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Well Contractor/Technician Information	
Name of Well Contractor Gilles Bourgeois	Well Contractor's Licence No. 1414
Business Address (street name, number, city etc.) 5011 Wood DR.	
Name of Well Technician (last name, first name) Claude Boucher	Well Technician's Licence No. 3310
Signature of Technician/Contractor C. Boucher	Date Submitted 05/11/18

Location of Well			
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.			
Audit No. Z 40061	Date Well Completed 05/11/18		
Was the well owner's information package delivered? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date Delivered 05/11/18		

Ministry Use Only			
Data Source	Contractor 1414		
Date Received DEC 20 2005	Date of Inspection		
Remarks	Well Record Number		

Instructions for Completing Form

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10th of a metre.
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

MUN CON LOT

Ottawa Carleton
RR#/Street Number/Name

Rideau - North Gower
City/Town/Village

19/20 4
Site/Compartment/Block/Tract etc.

Stillwood Drive, Maple Forest

North Gower

GPS Reading NAD Zone Easting Northing Unit Make/Model Mode of Operation: ☐ Undifferentiated ☒ Averaged
8.3 18 44 51 45 499 82 79 Garmin ☐ Differentiated, specify

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth Metres	
				From	To
Brown	Hardpan	Boulders	Packed	0	9.14
Gray	Sand & Gravel			9.14	12.19
Gray	Hardpan			12.19	13.71
Gray	Limestone	Sandstone Layers	Hard	13.71	52.72

Hole Diameter			Construction Record				Test of Well Yield					
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth Metres		Pumping test method	Draw Down		Recovery	
						From	To		Time min	Water Level Metres	Time min	Water Level Metres
0	17.98	22.75						submersible				
17.98	52.72	15.23						Pump intake set at - (metres) 45.71	Static Level	5.61		
			15.86	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	.48	+	.45	Pumping rate (litres/min) 54.6	1	6.17	1	5.57
								Duration of pumping 1 hrs + min	2	6.23	2	5.57
								Final water level end of pumping 6.34 metres	3	6.23	3	5.57
								Recommended pump type <input type="checkbox"/> Shallow <input checked="" type="checkbox"/> Deep	4	6.26	4	5.64
								Recommended pump depth 24.38 metres	5	6.26	5	5.64
								Recommended pump rate 45.5 (litres/min)	10	6.28	10	5.64
								If flowing give rate - (litres/min)	15	6.29	15	5.63
								If pumping discontinued, give reason.	20	6.30	20	5.63
									25	6.30	25	5.63
									30	6.30	30	5.62
									40	6.32	40	5.62
									50	6.33	50	5.61
									60	6.34	60	5.61

Water Record			Screen				No Casing or Screen			
Water found at Metres	Kind of Water		Outside diam		Slot No.					
51.50	<input type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals	not tested		<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized						
	<input type="checkbox"/> Other: <input type="checkbox"/> m <input type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals			<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized						
	<input type="checkbox"/> Other: <input type="checkbox"/> m <input type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Gas <input type="checkbox"/> Salty <input type="checkbox"/> Minerals									
After test of well yield, water was										
<input checked="" type="checkbox"/> Clear and sediment free										
<input type="checkbox"/> Other, specify										
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No										
			15.23	<input checked="" type="checkbox"/> Open hole			17.98		52.72	

Plugging and Sealing Record			<input checked="" type="checkbox"/> Annular space <input type="checkbox"/> Abandonment	
Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.		Volume Placed (cubic metres)
17.98	0	Grouted - Cement		.63m3

Method of Construction			
<input type="checkbox"/> Cable Tool	<input checked="" type="checkbox"/> Rotary (air mud)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	
Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	
Final Status of Well			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Well Contractor/Technician Information	
Name of Well Contractor Capital Water Supply Ltd.	Well Contractor's Licence No. 1558
Business Address (street name, number, city etc.) Box 490 Stittsville, Ontario K2S 1A6	
Name of Well Technician (last name, first name) Miller, Stephen	Well Technician's Licence No. T0097
Signature of Technician/Contractor	Date Submitted 2006 6 20

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No. Z 46988	Date Well Completed 2006 6 16
Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered 2006 6 16

Ministry Use Only	
Data Source	Contractor 1558
Date Received JUL 11 2006	Date of Inspection
Remarks	Well Record Number

Instructions for Completing Form

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- **All metre measurements shall be reported to 1/10th of a metre.**
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information

Ministry Use Only															
MUN								CON							LOT

Ottawa Carleton				Rideau				21		3	
RR#/Street Number/Name				City/Town/Village				Site/Compartment/Block/Tract etc.			
Lot 36, Maple Forest				North Gower							
GPS Reading		NAD Zone		Easting		Northing		Unit Make/Model		Mode of Operation:	
8 3		18		44 51 85		49 981 12		Garmin		<input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged <input type="checkbox"/> Differentiated, specify	

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth From	Metres To
Brown	Soil	Stones	Packed	0	3.65
Gray	Sandy Soil		Packed	3.65	7.01
Gray	Hardpan		Packed	7.01	10.05
Gray	Limestone		Medium	10.05	29.86
Gray & White	Sandstone		Hard	29.86	48.76

Hole Diameter		
Depth From	Metres To	Diameter Centimetres
0	11.88	22.75
11.88	48.76	15.07

Water Record	
Water found at <u>46.63</u> Metres	Kind of Water
<input checked="" type="checkbox"/> Gas <input type="checkbox"/> Sulphur <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other:	<input type="checkbox"/> Fresh <input type="checkbox"/> Sulphur <input type="checkbox"/> Salty <input type="checkbox"/> Minerals <input type="checkbox"/> Other:
not tested	
After test of well yield, water was	
<input checked="" type="checkbox"/> Clear and sediment free <input type="checkbox"/> Other, specify	
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	

Construction Record				
Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To
Casing				
15.86	<input checked="" type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	.48	+ .45	11.88
Screen				
Outside diam	<input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input type="checkbox"/> Plastic <input type="checkbox"/> Concrete <input type="checkbox"/> Galvanized	Slot No.		
No Casing or Screen				
15.07	<input checked="" type="checkbox"/> Open hole		11.88	48.76

Test of Well Yield				
Pumping test method	Draw Down	Recovery	Time min	Water Level Metres
submersible	Static Level			
Pump intake set at - (metres)	3.78			
Pumping rate - (litres/min)	5.87	1		8.91
Duration of pumping	6.22	2		6.10
Final water level end of pumping	7.01	3		4.87
Recommended pump type	7.95	4		4.25
Recommended pump depth	8.64	5		3.96
Recommended pump rate	9.57	10		3.78
If flowing give rate - (litres/min)	11.46	15		3.77
If pumping discontinued, give reason.	12.29	20		3.78
	12.53	25		3.78
	12.65	30		3.78
	13.47	40		3.78
	13.54	50		3.78
	13.58	60		3.78

Plugging and Sealing Record			
Depth set at - Metres	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)	
11.88	Grouted - Cement Slurry	.42m3	
Method of Construction			
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (conventional) <input type="checkbox"/> Rotary (reverse)	<input checked="" type="checkbox"/> Rotary (air) <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Boring	<input type="checkbox"/> Diamond <input type="checkbox"/> Jetting <input type="checkbox"/> Driving	<input type="checkbox"/> Digging <input type="checkbox"/> Other
Water Use			
<input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Stock <input type="checkbox"/> Irrigation	<input type="checkbox"/> Industrial <input type="checkbox"/> Commercial <input type="checkbox"/> Municipal	<input type="checkbox"/> Public Supply <input type="checkbox"/> Not used <input type="checkbox"/> Cooling & air conditioning	<input type="checkbox"/> Other
Final Status of Well			
<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Observation well <input type="checkbox"/> Test Hole	<input type="checkbox"/> Recharge well <input type="checkbox"/> Abandoned, insufficient supply <input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Unfinished <input type="checkbox"/> Dewatering <input type="checkbox"/> Replacement well	<input type="checkbox"/> Abandoned, (Other)

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No. Z 58707	Date Well Completed 2006 11 02
Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered 2006 11 02

Well Contractor/Technician Information	
Name of Well Contractor	Well Contractor's Licence No.
Capital Water Supply Ltd.	1558
Business Address (street name, number, city etc.)	
Box 490 Stittsville, Ontario K2S 1A6	
Name of Well Technician (last name, first name)	Well Technician's Licence No.
Miller, Stephen	T0097
Signature of Technician/Contractor	Date Submitted
	2006 11 03

Ministry Use Only	
Data Source	Contractor
	1558
Date Received JAN 25 2007	Date of Inspection
Remarks	Well Record Number



Well Tag **A 055097** (see below)

A055097

Instructions for Completing Form

- For use in the **Province of Ontario** only. This document is a permanent **legal** document. Please retain for future reference.
- All Sections **must** be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Help Desk (Toll Free) at 1-888-396-9355.
- All metre measurements shall be reported to 1/10th of a metre.**
- Please print clearly in blue or black ink only.

Ministry Use Only

Address of Well Location (County/District/Municipality) **Ottawa - Carleton** Township **Rideau** Lot **20** Concession **3**

RR#/Street Number/Name **# 2121 Roger Stevens** City/Town/Village **North Gower** Site/Compartment/Block/Tract/etc. **1**

GPS Reading NAD **83** Zone **18** Easting **444967** Northing **4998642** Unit Make/Model **Mogellon** Mode of Operation: ☐ Undifferentiated ☒ Averaged ☐ Differentiated, specify

Log of Overburden and Bedrock Materials (see instructions)

General Colour	Most common material	Other Materials	General Description	Depth	
				From	To
	Sand, Boulders			0	12.19
	Gray Limestone			12.19	36.57

Hole Diameter			Construction Record				Test of Well Yield						
Depth	Metres	Diameter	Inside diam centimetres	Material	Wall thickness centimetres	Depth	Metres	Pumping test method		Draw Down		Recovery	
From	To	Centimetres				From	To	Time min	Water Level Metres	Time min	Water Level Metres	Time min	Water Level Metres
0	36.57	14.59						Sub Pump					
								Pump intake set at (metres)	30.48	Static Level	2.75		10.50
								Pumping rate (litres/min)	71	1	5.24	1	5.73
								Duration of pumping	1 hrs + 0 min	2	6.20	2	3.69
								Final water level end of pumping	10.50 metres	3	7.06	3	2.75
								Recommended pump type	Shallow	4	7.67	4	
								Recommended pump depth	30.48 metres	5	8.22	5	
								Recommended pump rate (litres/min)	91	10	9.48	10	
								If flowing give rate (litres/min)	10.36	15	9.89	15	
									10.40	20	10.36	20	
									10.40	25	10.40	25	
									10.48	30	10.48	30	
									10.48	40	10.48	40	
									10.50	50	10.50	50	
									10.50	60	10.50	60	

Water Record			Screen			
Water found at	Metres	Kind of Water	Outside diam	Material	Slot No.	
36	36	TESTED				
<input checked="" type="checkbox"/> Fresh		<input type="checkbox"/> Sulphur				
<input type="checkbox"/> Gas		<input type="checkbox"/> Salty				
<input type="checkbox"/> Other:		<input type="checkbox"/> Minerals				
<input type="checkbox"/> m		<input type="checkbox"/> Fresh				
<input type="checkbox"/> Gas		<input type="checkbox"/> Salty				
<input type="checkbox"/> Other:		<input type="checkbox"/> Minerals				
After test of well yield, water was						
<input checked="" type="checkbox"/> Clear and sediment free						
<input type="checkbox"/> Other, specify: TESTED						
Chlorinated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No						

Casing			
<input checked="" type="checkbox"/> Steel	<input type="checkbox"/> Fibreglass		
<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete		
<input type="checkbox"/> Galvanized			
<input type="checkbox"/> Steel	<input type="checkbox"/> Fibreglass		
<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete		
<input type="checkbox"/> Galvanized			
<input type="checkbox"/> Steel	<input type="checkbox"/> Fibreglass		
<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete		
<input type="checkbox"/> Galvanized			

No Casing or Screen			
<input checked="" type="checkbox"/> Open hole			
15.88	480	16.46	
15.85		36.57	

Plugging and Sealing Record			Annular space		Volume Placed (cubic metres)
Depth set at - Metres	From	To	Material and type (bentonite slurry, neat cement slurry) etc.		
15.85	12.80	0	Neat Cement Slurry		.227
12.80	0	0	Bentonite Slurry		.613

Method of Construction			
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input checked="" type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input type="checkbox"/> Boring	<input type="checkbox"/> Driving	

Water Use			
<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input type="checkbox"/> Other
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	

Final Status of Well			
<input checked="" type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Well Contractor/Technician Information	
Name of Well Contractor AIR ROCK DRILLING CO LTD	Well Contractor's Licence No. 1119
Business Address (street name, number, city etc.) RR#1 RICHMOND ONT L6A2Z0	
Name of Well Technician (last name, first name) Dasamuni Ken	Well Technician's Licence No. 14
Signature of Technician/Contractor [Signature]	Date Submitted 2007 07/27

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No. Z 65105	Date Well Completed 2007 06/28
Was the well owner's information package delivered? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Delivered 2007 06/28

Ministry Use Only	
Data Source	Contractor 11119
Date Received AUG 07 2007	Date of Inspection 2007 06/28
Remarks	Well Record Number

Measurements recorded in: ☒ Metric ☐ Imperial

Well Owner's Information

First Name <i>Mary and</i>	Last Name / Organization <i>Jo Construction</i>	E-mail Address <i>NA</i>		<input type="checkbox"/> Well Constructed by Well Owner
Mailing Address (Street Number/Name) <i>6639 Stillwood Drive</i>	Municipality <i>North Gower</i>	Province <i>Ontario</i>	Postal Code <i>K0A 2E0</i>	Telephone No. (inc. area code) <i>613 838 2463</i>

Well Location

Address of Well Location (Street Number/Name) 6639 Stillwood Drive		Township Osgood (Rideau)	Lot 4021	Concession 3
County/District/Municipality Ottawa		City/Town/Village North Gower	Province Ontario	Postal Code K0A2T0
UTM Coordinates	Zone	Easting	Northing	Municipal Plan and Sublot Number
NAD 83	18	445166	4998242	4m 1209- Lot 40
Other				

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Clay	Silt, Boulder	Hard	0	4.6
Grey	Clay	Silt, Boulder	Hard	4.6	10.2
Grey	gravel		packed	10.2	10.9
Grey	limestone		layered	10.9	30.48

Annular Space

Depth Set at (m/ft)		Type of Sealant Used (Material and Type)	Volume Placed (m ³ /ft ³)
From	To		
0	12.8	Ciment grout	10 Bag

Results of Well Yield Testing

Before Test or After Pumping		Recovery	
Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
After test of well yield, water was: <input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____			
If pumping discontinued, give reason:		Static Level	4.84
		1	5.56
Pump intake set at (m/ft) 24		2	4.95
Pumping rate (l/min / GPM) 60		3	4.84
Duration of pumping 1 hrs + min		4	4.84
Final water level end of pumping (m/ft) 7.69		5	7.14
If flowing give rate (l/min / GPM)		10	7.40
Recommended pump depth (m/ft) 24		15	7.54
Recommended pump rate (l/min / GPM) 60		20	7.56
Well production (l/min / GPM) 85		25	7.54
Disinfected?		30	7.60
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		40	7.60
		50	7.61
		60	7.69

Construction Record - Casing

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned
			From	To	
15.55	Steel	0.48	1.6	12.8	
15.55	open Hole		12.8	30.48	

Status of Well

☒ Water Supply

☐ Replacement Well

☐ Test Hole

☐ Recharge Well

☐ Dewatering Well

☐ Observation and/or Monitoring Hole

☐ Alteration (Construction)

☐ Abandoned, Insufficient Supply

☐ Abandoned, Poor Water Quality

☐ Abandoned, other, *specify*

☐ Other, *specify*

Construction Record - Screen

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		
			From	To	
					<input type="checkbox"/> Abandoned, Poor Water Quality
					<input type="checkbox"/> Abandoned, other, specify _____
					<input type="checkbox"/> Other, specify _____


Water Details

Water found at Depth 26 (m/ft) <input type="checkbox"/> Gas	Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify
Water found at Depth (m/ft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify
Water found at Depth (m/ft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify

Hole Diameter

Depth (m/ft)		Diameter (cm/in)
From	To	
0	12.8	21.23
12.8	30.48	15.55

Well Contractor and Well Technician Information

Business Name of Well Contractor		Well Contractor's Licence No.	
Bourgeois's well Drilling		11414	
Business Address (Street Number/Name)		Municipality	
1182 900 East		Nation	
Province	Postal Code	Business E-mail Address	
Ontario	K0A3C0	NA	
Bus. Telephone No. (inc. area code)	Name of Well Technician (Last Name, First Name)		
6139875291	Michael Genier		
Well Technician's Licence No.	Signature of Technician and/or Contractor	Date Submitted	
3493		2008/1128	

Map of Well Location

Please provide a map below following instructions on the back.

A hand-drawn map of the study area. At the top, a horizontal line is labeled "North Groyne". Below this line, a vertical line is labeled "Trashwood". To the right of the "Trashwood" line, a horizontal line is labeled "300m". Below the "300m" line, a vertical line is labeled "Stillwood". To the right of the "Stillwood" line, a horizontal line is labeled "1 km". A small circle is labeled "well". On the far right, the number "416" is written vertically.

Comments:

Well owner's information package delivered

☐ Yes

☒ No

Date Package Delivered
Y Y Y Y M M D
Date Work Completed
2008 11 2

Ministry Use Only

Audit No. **Z 90529**

Received

Ministry of
the Environment

A113230

W _____ (Print Below)

Well Record

Regulation 903 Ontario Water Resources Act

Measurements recorded in: ☐ Metric ☒ Imperial

Page _____ of _____

Well Owner's Information

First Name	Last Name / Organization Grizzly Homes	E-mail Address	<input type="checkbox"/> Well Constructed by Well Owner
Mailing Address (Street Number/Name) PO Box 422, RR#4		Municipality Ashton	Province On
		Postal Code K0A 1B0	Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name) 2134 Maple Forest Drive		Township Rideau	Lot 21	Concession 3
County/District/Municipality Ottawa-Carleton		City/Town/Village North Gower	Province Ontario	Postal Code
UTM Coordinates Zone Easting NAD 8 3 18 445224	Northings 4998033	Municipal Plan and Sublot Number 4M-1209	Other S/L 32	

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
	Sand & Gravel	Boulders		0' 30'
Grey + Brown	Limestone			30' 88'
Grey + Brown	Limestone			88' 157'
Grey + Brown	Limestone			157' 162'

Annular Space		
Depth Set at (m/ft) From To 40' 0'	Type of Sealant Used (Material and Type) Neat cement slurry	Volume Placed (m³) 26.5

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (Conventional) <input type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify	<input type="checkbox"/> Public <input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Livestock <input type="checkbox"/> Irrigation <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify
<input type="checkbox"/> Diamond <input type="checkbox"/> Jetting <input type="checkbox"/> Driving <input type="checkbox"/> Digging	<input type="checkbox"/> Commercial <input type="checkbox"/> Municipal <input type="checkbox"/> Test Hole <input type="checkbox"/> Cooling & Air Conditioning <input type="checkbox"/> Not used <input type="checkbox"/> Dewatering <input type="checkbox"/> Monitoring

Construction Record - Casing			Status of Well	
Inside Diameter (cm/in) 6"	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) Steel	Wall Thickness (cm/in) .188"	Depth (m/ft) From To +2' 40'	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify
515/16"	Open Hole		40' 162'	

Construction Record - Screen		
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No. Depth (m/ft) From To

Water Details		Hole Diameter	
Water found at Depth 88' (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	Depth (m/ft) From To 0' 40'	Diameter (cm/in) 6"
Water found at Depth 157' (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	40' 162'	515/16"
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		

Well Contractor and Well Technician Information			
Business Name of Well Contractor Air Rock Drilling Co. Ltd.		Well Contractor's Licence No. 1119	
Business Address (Street Number/Name) 6659 Franktown Road, RR#1		Municipality Richmond	
Province ON	Postal Code K0A 2Z0	Business E-mail Address air-rock@sympatico.ca	
Bus. Telephone No. (inc. area code) 6138382170		Name of Well Technician (Last Name, First Name) Hogan, Dan	
Well Technician's Licence No. T3058		Signature of Technician and/or Contractor 	
Date Submitted 2011 03 31		Date Package Delivered 2011 03 25	

Results of Well Yield Testing			
After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify Not tested		Draw Down	
If pumping discontinued, give reason:		Time (min)	Water Level (m/ft)
X		Static Level	9.2'
Pump intake set at (m/ft) 140'		Time (min)	Water Level (m/ft)
Pumping rate (l/min / GPM) 12		1	15.5
Duration of pumping 1 hrs + 0 min		2	18.5
Final water level end of pumping (m/ft) 28.9'		3	21.5
If flowing give rate (l/min / GPM)		4	24.6
Recommended pump depth (m/ft) 100'		5	27.7
Recommended pump rate (l/min / GPM) 12		10	27.9
Well production (l/min / GPM) 12		15	28
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		20	28.1
		25	28.2
		30	28.2
		40	28.4
		50	28.7
		60	28.9'

Map of Well Location	
Please provide a map below following instructions on the back.	
Comments: #2134 Maple Forest Drive	
Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Ministry Use Only Audit No. z119813 APR 26 2011

Address of Well Location (Street Number/Name) 2130 Maple Forest Drive		Township Rideau	Lot 21	Concession 3
County/District/Municipality Ottawa-Carleton		City/Town/Village North Gower	Province Ontario	Postal Code
UTM Coordinates Zone 18	Easting 445253	Northings 4998049	Municipal Plan and Sublot Number 4M-1209	Other S/L 33

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
	Sand & Gravel	Clay		0' 26'
Grey	Limestone			26' 68'
Grey	Limestone			68' 156'
Grey	Limestone			156' 162'

Annular Space			
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/gal)	
36' 0'	Neat cement slurry	20.3	

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (Conventional) <input type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify	<input type="checkbox"/> Public <input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Livestock <input type="checkbox"/> Irrigation <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify

Construction Record - Casing				Status of Well
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	
6"	Steel	.188	+2' 36'	<input checked="" type="checkbox"/> Water Supply
515/16"	Open Hole		36' 162'	<input type="checkbox"/> Replacement Well

Construction Record - Screen				Status of Well
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
				<input type="checkbox"/> Test Hole
				<input type="checkbox"/> Recharge Well
				<input type="checkbox"/> Dewatering Well
				<input type="checkbox"/> Observation and/or Monitoring Hole
				<input type="checkbox"/> Alteration (Construction)
				<input type="checkbox"/> Abandoned, Insufficient Supply
				<input type="checkbox"/> Abandoned, Poor Water Quality
				<input type="checkbox"/> Abandoned, other, specify
				<input type="checkbox"/> Other, specify

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
68' (n/ft)	<input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify	0' 36'	6"
156' (n/ft)	<input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify	36' 162'	515/16"

Well Contractor and Well Technician Information			
Business Name of Well Contractor Air Rock Drilling Co. Ltd.		Well Contractor's Licence No. 1119	
Business Address (Street Number/Name) 6659 Franktown Road, RR#1		Municipality Richmond	

Province ON	Postal Code K0A 2Z0	Business E-mail Address air-rock@sympatico.ca
Bus. Telephone No. (inc. area code) 6138382170		
Name of Well Technician (Last Name, First Name) Hogan, Dan		
Well Technician's Licence No. T3058	Signature of Technician and/or Contractor 	Date Submitted 2011 03 31

Results of Well Yield Testing			
After test of well yield, water was:	Draw Down	Recovery	
<input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify Not tested	Time (min)	Water Level (m/ft)	Time (min)
If pumping discontinued, give reason:	Static Level	6.8'	10.7'
Pump intake set at (m/ft) 140'	1	9.3	1 6.8
Pumping rate (l/min / GPM) 20	2	10.7	2 6.8
Duration of pumping 1 hrs + 0 min	3	10.7	3 6.8
Final water level end of pumping (m/ft) 10.7'	4	10.7	4 6.8
If flowing give rate (l/min / GPM) 20	5	10.7	5 6.8
Recommended pump depth (m/ft) 100'	10	10.7	10 6.8
Recommended pump rate (l/min / GPM) 20	15	10.7	15 6.8
Well production (l/min / GPM) 20	20	10.7	20 6.8
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	25	10.7	25 6.8
	30	10.7	30 6.8
	40	10.7	40 6.8
	50	10.7	50 6.8
	60	10.7	60 6.8

Map of Well Location

Please provide a map below following instructions on the back.

Rogar Stevens Drive

Trailwood Drive 1KM

45'

2130

Maple Forest Drive

0.1KM

Comments:

Well owner's information package delivered ☒ Yes ☐ No

Date Package Delivered **2011 03 25**

Date Work Completed **2011 03 23**

Ministry Use Only

Audit No. **z119812**

APR 26 2011

Received



Ontario

Ministry of
the Environment

Well Tag No. (Place Sticker and/or Print Below)

A117425

Well Record

Regulation 903 Ontario Water Resources Act

Measurements recorded in: ☐ Metric ☒ Imperial

Page _____ of _____

Well Owner's Information

First Name 1504107 Ontario Inc	Last Name / Organization da Lockwood Brothers Construction	E-mail Address	<input checked="" type="checkbox"/> Well Constructed by Well Owner
Mailing Address (Street Number/Name) 2010 Totem Ranch Road	Municipality Oxford Station	Province ON	Postal Code K0G 1T0
Telephone No. (inc. area code) 613 258 4225			

Well Location

Address of Well Location (Street Number/Name) 2127 Rodger Stevens Drive	Township Rideau	Lot 20	Concession 3
County/District/Municipality Ottawa	City/Town/Village North Gower	Province Ontario	Postal Code K0A 2T0
UTM Coordinates Zone 18	Easting 444956	Northing 4998590	Municipal Plan and Sublot Number Plan 4R 16097
Other			

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	To
Brown	Fill	Cement	Packed	0	3'
Brown	Clay	Stone's	Packed	3'	24'
Gray	Clay	Stone's	Packed	24'	47'
Gray	Limestone		Hard	47'	115'
Gray	Limestone	Sandstone	Hard	115'	141'

Annular Space		
Depth Set at (m/ft) From	To	Type of Sealant Used (Material and Type)
52'	40'	Cement Pressure Grouted
40'	0	Bentonite Pressure Grouted

Method of Construction		Well Use	
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial
<input checked="" type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial	
<input type="checkbox"/> Other, specify		<input type="checkbox"/> Other, specify	

Construction Record - Casing			Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft) From	To
9 7/8"	Open Hole		0	52'
6 1/4"	Steel	0.188	0	52'
6 1/8"	Open Hole		52'	141'

<input type="checkbox"/> Water Supply	<input checked="" type="checkbox"/> Replacement Well
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Recharge Well
<input type="checkbox"/> Dewatering Well	<input type="checkbox"/> Observation and/or Monitoring Hole
<input type="checkbox"/> Alteration (Construction)	<input type="checkbox"/> Abandoned, Insufficient Supply
<input type="checkbox"/> Abandoned, Poor Water Quality	<input type="checkbox"/> Abandoned, other, specify
<input type="checkbox"/> Other, specify	

Construction Record - Screen			Status of Well	
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft) From	To

<input type="checkbox"/> Water Supply	<input checked="" type="checkbox"/> Replacement Well
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Recharge Well
<input type="checkbox"/> Dewatering Well	<input type="checkbox"/> Observation and/or Monitoring Hole
<input type="checkbox"/> Alteration (Construction)	<input type="checkbox"/> Abandoned, Insufficient Supply
<input type="checkbox"/> Abandoned, Poor Water Quality	<input type="checkbox"/> Abandoned, other, specify
<input type="checkbox"/> Other, specify	

Water Details		Hole Diameter	
Water found at Depth 128' (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft) From	To
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0	52'
Water found at Depth 52' (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested	52'	141'
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		
Water found at Depth 52' (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested		
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		

9 7/8"	6 1/4"
6 1/8"	

Business Name of Well Contractor 1425486 Ontario Ltd		Well Contractor's Licence No. 4877
Business Address (Street Number/Name) PO Box 1083		Municipality Prescott
Province ON	Postal Code K0E 1T0	Business E-mail Address
Telephone No. (inc. area code) 39254885	Name of Well Technician (Last Name, First Name) Ferguson, Todd	
Technician's Licence No. 478	Signature of Technician and/or Contractor Todd Ferguson	Date Submitted 2011/11/10

Results of Well Yield Testing			
After test of well yield, water was: <input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify		Draw Down	
If pumping discontinued, give reason:		Time (min)	Water Level (m/ft)
Pump intake set at (m/ft) 120'		Static Level	17.9
Pumping rate (l/min / GPM) 21 gpm		1	18.1
Duration of pumping 1 hrs + 0 min		2	18.2
Final water level end of pumping (m/ft) 18.4		3	18.3
If flowing give rate (l/min / GPM)		4	18.3
Recommended pump depth (m/ft) 120'		5	18.3
Recommended pump rate (l/min / GPM) 10 gpm		10	18.4
Well production (l/min / GPM)		15	18.4
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No 150		20	18.4
		25	18.4
		30	18.4
		40	18.4
		50	18.4
		60	18.4

Map of Well Location

Please provide a map below following instructions on the back.

Map of Well Location

1 Mile to North

Rodger Stevens Drive

Comments:
150 Chlorine after Drilling
Chlorine after Yield Test

Well owner's Information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered 2011/11/04	Ministry Use Only	
Date Work Completed 2011/10/26	Audit No. 2138522	Received DEC 05 2011	

Measurements recorded in: ☐ Metric ☒ Imperial

A128135

Address of Well Location (Street Number/Name) 2126 Maple Forest Drive				Township Rideau		Lot 21		Concession 3	
County/District/Municipality Ottawa-Carleton				City/Town/Village North Gower				Province Ontario	
UTM Coordinates				Municipal Plan and Sublot Number				Postal Code	
Zone		Easting		Northing		Other			
NAD 83		18 445286		4998074		4M-1209		S/ 34	

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

[illegible]

Annular Space			
Depth Set at (m) ⁽¹⁾ From To		Type of Sealant Used (Material and Type)	Volume Placed (m ³) ⁽²⁾
47	0	Neat cement	32.8


Method of Construction		Well Use		
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input checked="" type="checkbox"/> Domestic	<input type="checkbox"/> Municipal	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole	<input type="checkbox"/> Monitoring
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning	
<input checked="" type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial		
<input type="checkbox"/> Other, <i>specify</i> _____		<input type="checkbox"/> Other, <i>specify</i> _____		

Construction Record - Casing					Status of Well
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Inactive
			From	To	
6 1/4"	Steel	.188"	+2'	47'	
5 15/16"	Open Hole		47'	168'	



Construction Record - Screen				
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

☐ Insufficient Supply
☐ Abandoned, Poor Water Quality
☐ Abandoned, other, *specify* _____
☐ Other, *specify* _____

Water Details		Hole Diameter	
Water found at Depth 162 (m/ft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Other, specify _____	Depth (m/ft) From	Diameter (cm/in) To
Water found at Depth (m/ft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify _____	0'	47' 9 3/4"
Water found at Depth (m/ft) <input type="checkbox"/> Gas	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Other, specify _____	47'	168' 5 15/16"

Well Contractor and Well Technician Information									
Business Name of Well Contractor						Well Contractor's Licence No.			
Air Rock Drilling Co. Ltd.						11/19			
Business Address (Street Number/Name)						Municipality			
6659 Franktown Road, RR#1						Richmond			
Province		Postal Code		Business E-mail Address					
ON		K0A 2Z0		air-rock@sympatico.ca					
Bus. Telephone No. (inc. area code)				Name of Well Technician (Last Name, First Name)					
6138382170				Hanna, Jeremy					
Well Technician's Licence No.		Signature of Technician and/or Contractor				Date Submitted			
B632						2013 7 31			

Results of Well Yield Testing

After test of well yield, water was:	Draw Down		Recovery	
<input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify Not tested	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:	Static Level	10.4'		77'
	1	14.8	1	56.3
Pump intake set at (m/ft) 150	2	17.3	2	43.2
Pumping rate (l/min / GPM) 20	3	19.7	3	34.6
Duration of pumping 1 hrs + 0 min	4	22	4	27.3
Final water level end of pumping (m/ft) 77'	5	24.2	5	20.9
If flowing give rate (l/min / GPM)	10	33	10	10.4
	15	38.6	15	10.4
Recommended pump depth (m/ft) 100' (3/4 HP 157 ft)	20	44.2	20	10.4
Recommended pump rate (l/min / GPM) 20	25	48.7	25	10.4
Well production (l/min / GPM) 20	30	53.2	30	10.4
Disinfected?	40	62.2	40	10.4
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	50	70	50	10.4
	60	77'	60	10.4'

Map of Well Location

Please provide a map below following instructions on the back.

Stillwood Drive

MAPLE FOREST DRIVE

1 KM

75'

Comments:

3/4 HP - 15 GPM - SET @ 100 FT

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered 2013 07 30	Ministry Use Only Audit No. z 155162 Recd. AUG 19 2013
	Date Work Completed 2013 07 29	

OFFICIAL CERTIFICATE OF ANALYSIS : 4102006
WORK REQUEST : 100315477
Report Date : 2024-10-01
Paterson Group

9 Auriga Dr
Nepean, Ontario
K2E 7T9
Attention : Alex Schopf

Reception Date : 2024-09-25

Project : PH4905

Sampler : NA

PO Number : 61375

Temperature : 15 °C

Analysis	Quantity	External Method
Alkalinity (Water, Automated)	2	Modified from SM 2320 B
Ammonia, Total (Water, Colorimetry)	2	Modified from EPA 350.1
Chloride (Water, IC)	2	Modified from SM 4110 B and C
Colour, Apparent (Water, Spectrophotometry)	2	Modified from SM 2120 C
Conductivity (Water, Automated)	2	Modified from SM 2510 B
DOC (Water, IR)	2	Modified from SM 5310 B
Escherichia coli (DC Plate)	2	Modified from MECP E3407
Fluoride (Water, Auto/ISE)	2	Modified from SM 4500-F A and 4500-F C
Hardness (Water, Calculation Only)	2	SM 2340 B
Ion Balance (Water, Calculation)	2	Modified from SM1030 E
Metals Scan (Water, ICP/MS)	2	Modified from EPA 200.8
Metals Scan (Water, ICP/OES)	2	Modified from SM 3120 B
Nitrate (Water, IC)	2	Modified from SM 4110 B and C
Nitrite (Water, IC)	2	Modified from SM 4110 B and C
pH (25°C) (Water, Automated)	2	Modified from SM 4500-H+ B
Phenols (Water, Colorimetry)	2	Modified from EPA 420.2
Sulphate (Water, IC)	2	Modified from SM 4110 B and C
Sulphide (Water, Colorimetry)	2	Modified from SM 4500-S2 D
Tannin and Lignin (Water, Spec)	2	Modified from SM 5550 B
TDS (Estimated)	2	Modified from SM 2510 A
Total Coliforms (DC Plate)	2	Modified from MECP E3407
Total Kjeldahl Nitrogen (Water, Colorimetry)	2	Modified from EPA 351.2
Turbidity (Water, Turbidimeter)	2	Modified from SM 2130 B
VOCs (Water, GC/MS)	1	Modified from EPA 8260

Criteria :
A : Ontario Regulation 169/03 (Non-Regulated Drinking Water)

Sample status upon receipt :

8059996 8059998

Compliant
Notes :

- All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise stated.
- Eurofins Environment Testing Canada Inc. is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at <https://directory.cala.ca/>
- Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline or regulatory limits listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official guideline or regulation as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

Legend :

RL : Reporting limit

QC : Reference material (QC)

N/A : Not applicable

1 : Results in annex

* : Analysis conducted by external subcontracting

^ : Analysis not accredited

OFFICIAL CERTIFICATE OF ANALYSIS - EXCEEDENCE SUMMARY

Client : Paterson Group
Project : PH4905

Reception Date : 2024-09-25

Eurofins Sample No	Client Sample Identification	Analyte	Result	Units	Exceeded Criteria		
					A	B	C
Colour, Apparent (Water, Spectrophotometry)							
8059996	TW1 - GW1	Colour (Apparent)	6	TCU	5		
8059998	TW1 - GW2	Colour (Apparent)	7	TCU	5		
Hardness (Water, Calculation Only)							
8059996	TW1 - GW1	Hardness as CaCO3 (Calculation)	226	mg/L	80-100		
8059998	TW1 - GW2	Hardness as CaCO3 (Calculation)	226	mg/L	80-100		
Metals Scan (Water, ICP/MS)							
8059998	TW1 - GW2	Iron	0.33	mg/L	0.3		
TDS (Estimated)							
8059996	TW1 - GW1	TDS (Estimated)^	508	mg/L	500		

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

Eurofins Sample No :				8059996	8059998			
Matrix :				Groundwater	Groundwater			
Sampling Date :				2024-09-24	2024-09-24			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
Anions	RL	Unit	Criteria					
			A	B	C			
Chloride	0.5	mg/L	250			90.2	85.2	
Nitrate (as Nitrogen)	0.1	mg/L	10.0			<0.1	<0.1	
Nitrite (as Nitrogen)	0.1	mg/L	1.0			<0.1	<0.1	
Sulphate	1	mg/L	500			47	47	

Eurofins Sample No :				8059996	8059998			
Matrix :				Groundwater	Groundwater			
Sampling Date :				2024-09-24	2024-09-24			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
Calculations	RL	Unit						
Ion Balance (Calculation)^	0.1		1.01	1.00				

Eurofins Sample No :				8059996	8059998			
Matrix :				Groundwater	Groundwater			
Sampling Date :				2024-09-24	2024-09-24			
Client Sample Identification :				TW1 - GW1	TW1 - GW2			
General Chemistry	RL	Unit	Criteria					
			A	B	C			
Alkalinity (as CaCO ₃)	5	mg/L	500			229	236	
Colour (Apparent)	2	TCU	5			6	7	
Conductivity @ 25°C	5	µS/cm				781	766	
Dissolved Organic Carbon	0.5	mg/L	5			0.7	1.1	
Fluoride	0.1	mg/L	1.5			0.64	0.63	
Hardness as CaCO ₃ (Calculation)	1	mg/L	80-100			226	226	
pH @ 25°C	1		6.5-8.5			7.99	7.95	
Phenols-4AAP	0.001	mg/L				<0.001	<0.001	
Sulphide (S ₂ -)	0.01	mg/L	0.05			<0.01	<0.01	
Tannin and Lignin	0.1	mg/L				0.1	<0.1	
TDS (Estimated)^	5	mg/L	500			508	498	
Turbidity	0.1	NTU	5			1.6	2.3	

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

Eurofins Sample No :						8059996	8059998			
Matrix :						Groundwater	Groundwater			
Sampling Date :						2024-09-24	2024-09-24			
Client Sample Identification :						TW1 - GW1	TW1 - GW2			
Metals	RL	Unit	Criteria							
			A	B	C					
Metals Scan (Water, ICP/MS)										
Aluminum	0.01	mg/L	0.1			0.03	0.01			
Antimony	0.0005	mg/L	0.006			<0.0005	<0.0005			
Arsenic	0.001	mg/L	0.01			<0.001	<0.001			
Barium	0.001	mg/L	1			0.066	0.062			
Beryllium	0.0005	mg/L				<0.0005	<0.0005			
Boron	0.01	mg/L	5			0.20	0.20			
Cadmium	0.0001	mg/L	0.005			<0.0001	<0.0001			
Chromium	0.001	mg/L	0.05			<0.001	<0.001			
Cobalt	0.0002	mg/L				<0.0002	<0.0002			
Copper	0.001	mg/L	1			<0.001	<0.001			
Iron	0.03	mg/L	0.3			0.19	0.33			
Lead	0.001	mg/L	0.01			<0.001	<0.001			
Manganese	0.01	mg/L	0.05			<0.01	<0.01			
Mercury	0.0001	mg/L	0.001			<0.0001	<0.0001			
Molybdenum	0.005	mg/L				<0.005	<0.005			
Nickel	0.005	mg/L				<0.005	<0.005			
Selenium	0.001	mg/L	0.05			<0.001	<0.001			
Silver	0.0001	mg/L				<0.0001	<0.0001			
Strontium	0.001	mg/L				1.75	1.77			
Thallium	0.0001	mg/L				<0.0001	<0.0001			
Uranium	0.001	mg/L	0.02			<0.001	<0.001			
Vanadium	0.001	mg/L				<0.001	<0.001			
Zinc	0.01	mg/L	5			<0.01	<0.01			
Metals Scan (Water, ICP/OES)										
Calcium	1	mg/L				42	42			
Magnesium	1	mg/L				30	29			
Potassium	1	mg/L				8	8			
Sodium	1	mg/L	200			81	78			
Eurofins Sample No :						8059996	8059998			
Matrix :						Groundwater	Groundwater			
Sampling Date :						2024-09-24	2024-09-24			
Client Sample Identification :						TW1 - GW1	TW1 - GW2			
Microbiology	RL	Unit	Criteria							
			A	B	C					
Escherichia coli (DC)	0	CFU/100mL	0			0	0			
Total Coliforms (DC)	0	CFU/100mL	0			0	0			

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

Eurofins Sample No :			8059996	8059998					
Matrix :			Groundwater	Groundwater					
Sampling Date :			2024-09-24	2024-09-24					
Client Sample Identification :			TW1 - GW1	TW1 - GW2					
Nutrients	RL	Unit							
Ammonia (Total, as Nitrogen)	0.02	mg/L	0.154	0.153					
Total Kjeldahl Nitrogen	0.1	mg/L	0.231	0.236					

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

Eurofins Sample No :				8059998					
Matrix :				Groundwater					
Sampling Date :				2024-09-24					
Client Sample Identification :				TW1 - GW2					
Volatile Organic Compounds	RL	Unit	Criteria						
			A	B	C				
VOCs (Water, GC/MS)									
1,1,1,2-Tetrachloroethane	0.5	ug/L				<0.5			
1,1,1-Trichloroethane	0.4	ug/L				<0.4			
1,1,2,2-Tetrachloroethane	0.5	ug/L				<0.5			
1,1,2-Trichloroethane	0.4	ug/L				<0.4			
1,1-Dichloroethane	0.4	ug/L				<0.4			
1,1-Dichloroethene	0.4	ug/L	14			<0.5			
1,2-Dibromoethane	0.2	ug/L				<0.2			
1,2-Dichlorobenzene	0.4	ug/L	200			<0.4			
1,2-Dichloroethane	0.2	ug/L	5			<0.2			
1,2-Dichloropropane	0.5	ug/L				<0.5			
1,3,5-Trimethylbenzene	0.3	ug/L				<0.3			
1,3-Dichlorobenzene	0.4	ug/L				<0.4			
1,4-Dichlorobenzene	0.4	ug/L	5			<0.4			
Acetone	5	ug/L				<5.0			
Benzene	0.5	ug/L	1			<0.5			
Bromodichloromethane	0.3	ug/L				<0.3			
Bromoform	0.4	ug/L				<0.4			
Bromomethane	0.5	ug/L				<0.5			
Carbon tetrachloride	0.2	ug/L	2			<0.2			
Chloroethane	0.2	ug/L				<0.5			
Chloroform	0.5	ug/L				<0.5			
Chloromethane	0.2	ug/L				<0.2			
cis-1,2-Dichloroethene	0.4	ug/L				<0.4			
cis-1,3-Dichloropropene	0.5	ug/L				<0.5			
Dibromochloromethane	0.3	ug/L				<0.3			
Dichloromethane	4	ug/L	50			<4.0			
Diethyl ether	5	ug/L				<5.0			
Ethylbenzene	0.5	ug/L	140			<0.5			
m/p-Xylene	0.4	ug/L				<0.4			
Methyl ethyl ketone (MEK)	2	ug/L				<2.0			
Methyl isobutyl ketone (MIBK)	5	ug/L				<5.0			
Methyl tert-butyl ether (MTBE)	2	ug/L				<2.0			
Monochlorobenzene	0.5	ug/L	80			<0.5			
o-Xylene	0.4	ug/L				<0.4			
Styrene	0.5	ug/L				<0.5			
Tetrachloroethylene (PCE)	0.3	ug/L	10			<0.3			
Toluene	0.4	ug/L	60			<0.4			
trans-1,2-dichloroethene	0.4	ug/L				<0.4			
trans-1,3-dichloropropene	0.5	ug/L				<0.5			
Trichloroethylene (TCE)	0.3	ug/L	5			<0.3			
Trichlorofluoromethane	0.5	ug/L				<0.5			
Vinyl chloride	0.2	ug/L	1			<0.2			
Xylene (Total)	0.5	ug/L	90			<0.5			
1,2-dichloroethane-d4 (surrogate)	0	%				113			
4-bromofluorobenzene (surrogate)	0	%				81			

OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

			Eurofins Sample No :			8059998				
			Matrix :			Groundwater				
			Sampling Date :			2024-09-24				
			Client Sample Identification :			TW1 - GW2				
Volatile Organic Compounds			Criteria							
	RL	Unit	A	B	C					
Toluene-d8 (surrogate)	0	%				99				

Approved by : 
Emma-Dawn Ferguson, M.Sc.
Environmental Chemist

Approved by : 
Jason Kennedy,
Project Manager

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Alkalinity (Water, Automated)									
Method : Alkalinity (water, titration to pH 4.5, automated). Internal method: OTT-I-AT-WI45398.									
Alkalinity (as CaCO3)	mg/L	5	<5	99	95-105			1	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-30	
Ammonia, Total (Water, Colorimetry)									
Method : Ammonia (Water, Colorimetry). Internal method: OTT-I-NUT-WI46201.									
Ammonia (Total, as Nitrogen)	mg/L	0.02	<0.020	112	80-120	112	80-120	0	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-29 Analysis Date: 2024-10-01	
Chloride (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Chloride	mg/L	0.5	<0.5	102	80-120	105	80-120	2	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-27	
Colour, Apparent (Water, Spectrophotometry)									
Method : Colour (Water, Spectrophotometric). Internal method: OTT-I-SPEC-WI45980.									
Colour (Apparent)	TCU	2	<2	99	39-159			9	0-40
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-30 Analysis Date: 2024-09-30	
Conductivity (Water, Automated)									
Method : Conductivity (Water, Autotitrator). Internal Method: OTT-I-AT-WI45398.									
Conductivity @ 25°C	uS/cm	5	<5	101	98-102			1	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-30	
DOC (Water, IR)									
Method : Organic carbon (water, IR, combustion). Internal method: OTT-I-DEM-WI46148.									
Dissolved Organic Carbon	mg/L	0.5	<0.5	100	84-116	85	80-120	-	0-15
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-30 Analysis Date: 2024-10-01	
Escherichia coli (DC Plate)									
Method : Total Coliforms and E.Coli by MF (Water, DC plate). Internal method: OTT-M-BAC-WI45296.									
Escherichia coli (DC)	CFU/100mL	0	0					-	0-30
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-25 Analysis Date: 2024-09-26	
Fluoride (Water, Auto/ISE)									
Method : Fluoride by autotitrator, ion selective electrode. Internal method: OTT-I-AT-WI45398.									
Fluoride	mg/L	0.1	<0.10	98	90-110			-	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-30	

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group
Project : PH4905

Reception Date: 2024-09-25

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Metals Scan (Water, ICP/MS)									
Method : Metals (Water, ICP/MS). Internal method: AMMTFQE1.									
Aluminum	mg/L	0.01	<0.01	100	80-120	114	70-130	-	0-20
Antimony	mg/L	0.0005	<0.0005	87	80-120	93	70-130	-	0-20
Arsenic	mg/L	0.001	<0.001	99	80-120	106	70-130	-	0-20
Barium	mg/L	0.001	<0.001	100	80-120	91	70-130	0	0-20
Beryllium	mg/L	0.0005	<0.0005	108	80-120	108	70-130	-	0-20
Boron	mg/L	0.01	<0.01	100	80-120	102	70-130	-	0-20
Cadmium	mg/L	0.0001	<0.0001	106	80-120	100	70-130	-	0-20
Chromium	mg/L	0.001	<0.001	100	80-120	105	70-130	-	0-20
Cobalt	mg/L	0.0002	<0.0002	102	80-120	94	70-130	-	0-20
Copper	mg/L	0.001	<0.001	110	80-120	93	70-130	-	0-20
Iron	mg/L	0.03	<0.03	100	80-120	101	70-130	-	0-20
Lead	mg/L	0.001	<0.001	110	80-120	86	70-130	-	0-20
Manganese	mg/L	0.01	<0.01	100	80-120	99	70-130	-	0-20
Mercury	mg/L	0.0001	<0.0001	106	80-120	78	70-130	-	0-20
Molybdenum	mg/L	0.005	<0.005	90	80-120	100	70-130	-	0-20
Nickel	mg/L	0.005	<0.005	100	80-120	96	70-130	-	0-20
Selenium	mg/L	0.001	<0.001	102	80-120	101	70-130	-	0-20
Silver	mg/L	0.0001	<0.0001	117	80-120	93	70-130	-	0-20
Strontium	mg/L	0.001	<0.001	100	80-120	88	70-130	0	0-20
Thallium	mg/L	0.0001	<0.0001	104	80-120	87	70-130	-	0-20
Uranium	mg/L	0.001	<0.001	90	80-120	92	70-130	-	0-20
Vanadium	mg/L	0.001	<0.001	100	80-120	108	70-130	-	0-20
Zinc	mg/L	0.01	<0.01	110	80-120	88	70-130	-	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-27	
Metals Scan (Water, ICP/OES)									
Method : Metals (Water, ICP/OES). Internal method: OTT-I-MET-WI48491.									
Calcium	mg/L	1	<1	104	86-115	101	70-130	1	0-20
Magnesium	mg/L	1	<1	100	91-109	100	70-130	-	0-20
Potassium	mg/L	1	<1	107	87-113	114	70-130	-	0-20
Sodium	mg/L	1	<1	106	85-115	107	70-130	-	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-30 Analysis Date: 2024-09-25	
Nitrate (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Nitrate (as Nitrogen)	mg/L	0.1	<0.1	106	80-120				
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-27	
Nitrite (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Nitrite (as Nitrogen)	mg/L	0.1	<0.1	105	80-120				
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-27	
pH (25°C) (Water, Automated)									
Method : pH (Water, Automated Meter). Internal method: OTT-I-AT-WI45398.									
pH @ 25°C		1	5.71	100	97-103			1	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-30	

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group

Project : PH4905

Reception Date: 2024-09-25

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
Phenols (Water, Colorimetry)									
Method : Phenols (Water, Colorimetry). Internal method: OTT-I-4AAP-WI46150.									
Phenols-4AAP	mg/L	0.001	<0.001	114	75-125	118	70-130	-	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-27 Analysis Date: 2024-09-27	
Sulphate (Water, IC)									
Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.									
Sulphate	mg/L	1	<1	105	90-110	110	80-120	1	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-27	
Sulphide (Water, Colorimetry)									
Method : Sulphide, S2- (Water, Colorimetry). Internal method: OTT-I-SPEC-WI45931.									
Sulphide (S2-)	mg/L	0.01	<0.01	100	80-120			-	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-26	
Tannin and Lignin (Water, Spec)									
Method : Tannin and Lignin (Water, Spec), Internal method: OTT-I-SPEC-WI57693.									
Tannin and Lignin	mg/L	0.1	<0.1	92	80-120			-	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-30 Analysis Date: 2024-09-30	
Total Coliforms (DC Plate)									
Method : Total Coliforms and E.Coli by MF (Water, DC plate). Internal method: OTT-M-BAC-WI45296.									
Total Coliforms (DC)	CFU/100mL	0	0					-	0-30
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-25 Analysis Date: 2024-09-26	
Total Kjeldahl Nitrogen (Water, Colorimetry)									
Method : TKN (Water, colorimetry). Internal method: OTT-I-NUT-WI46201.									
Total Kjeldahl Nitrogen	mg/L	0.1	<0.100	98	70-130	111	70-130	3	0-20
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-27 Analysis Date: 2024-09-29	
Turbidity (Water, Turbidimeter)									
Method : Turbidity (Water, Turbidimeter). Internal method: OTT-I-TUR-WI46288.									
Turbidity	NTU	0.1	<0.1	103	80-120			-	0-30
Associated Samples : 8059996, 8059998								Prep Date: 2024-09-26 Analysis Date: 2024-09-26	

OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group

Project : PH4905


Reception Date: 2024-09-25

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
VOCs (Water, GC/MS)									
Method : Volatile Organic Compounds (Water, GC/MS). Internal method: AMVOMSE8.									
1,1,1,2-Tetrachloroethane	ug/L	0.5	<0.5	121	70-130	126	70-130	-	0-30
1,1,1-Trichloroethane	ug/L	0.4	<0.4	116	70-130	122	70-130	-	0-30
1,1,2,2-Tetrachloroethane	ug/L	0.5	<0.5	117	70-130	116	70-130	-	0-30
1,1,2-Trichloroethane	ug/L	0.4	<0.4	109	70-130	115	70-130	-	0-30
1,1-Dichloroethane	ug/L	0.4	<0.4	102	70-130	125	70-130	-	0-30
1,1-Dichloroethene	ug/L	0.4	<0.5	122	70-130	125	70-130	-	0-30
1,2-Dibromoethane	ug/L	0.2	<0.2	100	70-130	105	70-130	-	0-30
1,2-Dichlorobenzene	ug/L	0.4	<0.4	100	70-130	102	70-130	-	0-30
1,2-Dichloroethane	ug/L	0.2	<0.2	87	70-130	120	70-130	-	0-30
1,2-Dichloropropane	ug/L	0.5	<0.5	107	70-130	117	70-130	-	0-30
1,3,5-Trimethylbenzene	ug/L	0.3	<0.3	112	70-130	115	70-130	-	0-30
1,3-Dichlorobenzene	ug/L	0.4	<0.4	98	70-130	100	70-130	-	0-30
1,4-Dichlorobenzene	ug/L	0.4	<0.4	101	70-130	104	70-130	-	0-30
Acetone	ug/L	5	<5.0	117	70-130	89	70-130	-	0-30
Benzene	ug/L	0.5	<0.5	121	70-130	126	70-130	-	0-30
Bromodichloromethane	ug/L	0.3	<0.3	119	70-130	128	70-130	-	0-30
Bromoform	ug/L	0.4	<0.4	90	70-130	95	70-130	-	0-30
Bromomethane	ug/L	0.5	<0.5	87	70-130	87	70-130	-	0-30
Carbon tetrachloride	ug/L	0.2	<0.2	111	70-130	118	70-130	-	0-30
Chloroethane	ug/L	0.2	<0.5	101	70-130	112	70-130	-	0-30
Chloroform	ug/L	0.5	<0.5	121	70-130	127	70-130	-	0-30
Chloromethane	ug/L	0.2	<0.2	86	70-130	89	70-130	-	0-30
cis-1,2-Dichloroethene	ug/L	0.4	<0.4	118	70-130	125	70-130	-	0-30
cis-1,3-Dichloropropene	ug/L	0.5	<0.5	75	70-130	85	70-130	-	0-30
Dibromochloromethane	ug/L	0.3	<0.3	103	70-130	108	70-130	-	0-30
Dichloromethane	ug/L	4	<4.0	77	70-130	110	70-130	-	0-30
Diethyl ether	ug/L	5	<5.0	100	70-130	95	70-130	-	0-30
Ethylbenzene	ug/L	0.5	<0.5	129	70-130	110	70-130	-	0-30
m/p-Xylene	ug/L	0.4	<0.4	124	70-130	106	70-130	-	0-30
Methyl ethyl ketone (MEK)	ug/L	2	<2.0	124	70-130	124	70-130	-	0-30
Methyl isobutyl ketone (MIBK)	ug/L	5	<5.0	107	70-130	114	70-130	-	0-30
Methyl tert-butyl ether (MTBE)	ug/L	2	<2.0	110	70-130	113	70-130	-	0-30
Monochlorobenzene	ug/L	0.5	<0.5	110	70-130	114	70-130	-	0-30
o-Xylene	ug/L	0.4	<0.4	123	70-130	112	70-130	-	0-30
Styrene	ug/L	0.5	<0.5	123	70-130	106	70-130	-	0-30
Tetrachloroethylene (PCE)	ug/L	0.3	<0.3	82	70-130	86	70-130	-	0-30
Toluene	ug/L	0.4	<0.4	122	70-130	128	70-130	-	0-30
trans-1,2-dichloroethene	ug/L	0.4	<0.4	126	70-130	111	70-130	-	0-30
trans-1,3-dichloropropene	ug/L	0.5	<0.5	90	70-130	101	70-130	-	0-30
Trichloroethylene (TCE)	ug/L	0.3	<0.3	97	70-130	101	70-130	-	0-30
Trichlorofluoromethane	ug/L	0.5	<0.5	116	70-130	118	70-130	-	0-30
Vinyl chloride	ug/L	0.2	<0.2	95	70-130	108	70-130	-	0-30
Xylene (Total)	ug/L	0.5	<0.5				-		-
Associated Samples : 8059998									
								Prep Date: 2024-09-26	
								Analysis Date: 2024-10-01	

Where RPD % is reported as "-" the calculation is not available because one or both of the duplicates is within 5 times the RL.

Pumping Test Analysis Report

File No.	PH4905	Well ID:	TW1
Date:	Tuesday, September 24, 2024	Solution Method:	Cooper-Jacob
Client:	Ottawa Sivan Temple	Transmissivity (m ² /day):	1970.7
Site Address:	2104 Roger Stevens Road	Discharge Rate (L/min)	58
Project:	Proposed Redevelopment	Analysis performed by:	AS

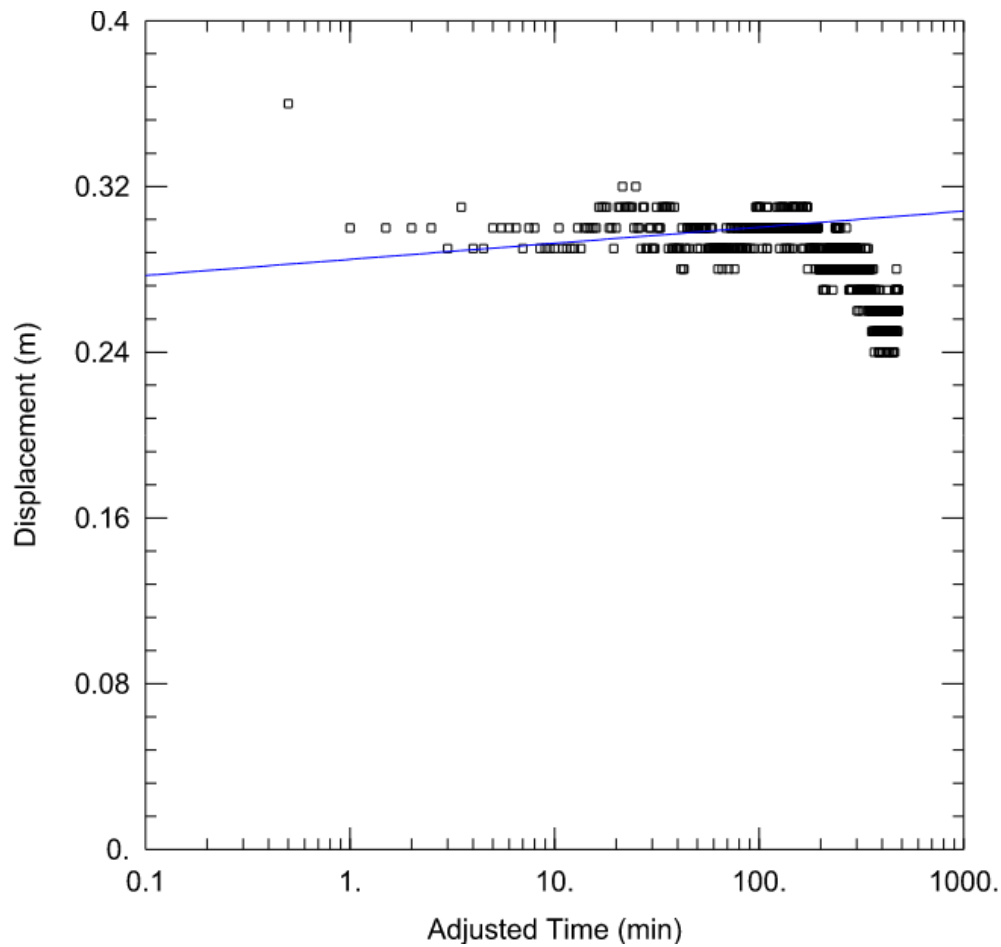

Pumping Test Analysis Report

File No. PH4905
Date: Tuesday, September 24, 2024
Client: Ottawa Sivan Temple
Site Address: 2104 Roger Stevens Road
Project: Proposed Redevelopment

Summary Table:		
Solution Method:	Well ID:	Transmissivity (m ² /day):
Cooper-Jacob	TW1	1970.7
Average:		1970.70

MW1 inputs		
pH	7.95	A 0.17
TDS	498	B 2.09
Calcium	42	C 1.22
Alkalinity	236	D 2.37
Temp.	25	
		pHs = 7.961844256

Langelier Saturation Index (LSI) Calculation		(Langelier, 1936)
$LSI = pH - pH_s$ $pH_s = (9.3 + A + B) - (C + D)$ <p>Where:</p> $A = (\log_{10} [TDS] - 1) / 10$ $B = -13.12 \times \log_{10} (oC + 273) + 34.55$ $C = \log_{10} [Ca^{2+} \text{ as } CaCO_3] - 0.4$ $D = \log_{10} [\text{alkalinity as } CaCO_3]$		
		LSI = 0.0
LSI	Effect	
0.5 to 2	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive)	
0 to 0.5	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (slightly scale forming and corrosive).	
0	Water is saturated (in equilibrium) with calcium carbonate. A scale layer of calcium carbonate is neither precipitated nor dissolved.	
0 to -0.5	Water is under saturated and tends to dissolve solid calcium carbonate (slightly corrosivebut non-scale forming).	
-0.5 to -2	Water is under saturated and tends to dissolve solid calcium carbonate (seriously corrosive).	



**PATERSON
GROUP**

SOIL PROFILE AND TEST DATA

GEOTECHNICAL INVESTIGATION

2104 Roger Stevens Drive, Ottawa, Ontario

DATUM: Geodetic **EASTING:** 367934.449 **NORTHING:** 5000149.976 **ELEVATION:** 91.00

PROJECT: Proposed Hindu Temple

FILE NO. PG6832

BORINGS BY: CME 55 Low Clearance Drill

REMARKS:

DATE: September 19, 2023

HOLE NO. BH 1-23

SAMPLE DESCRIPTION	STRATA PLOT	SAMPLE		SAMPLE % RECOVERY	N VALUE or RQD	WATER CONTENT %	DEPTH (m)	Remoulded Shear Strength (kPa)					Peak Shear Strength (kPa)					Pen. Resist. Blows/0.3m (50 mm Dia. Cone)					Piezometer Construction
		No.	Type					0	25	50	75	100	0	25	50	75	100	0	25	50	75	100	
Ground Surface																							
EL 91 m																							
TOPSOIL																							
0.05 m EL 90.95 m		AU 1	●				0																
		SS 2	▽	75	46		1																
		SS 3	▽	60	50+		2																
GLACIAL TILL: Dense to very dense, brown silty sand to sandy silt with gravel, cobbles and boulders, trace clay		SS 4	▽	50	50+		3																
		SS 5	▽	58	50+		4																
		SS 6	▽	67	24		5																
4.95 m EL 86.05 m		SS 7	▽	25	50+		6																
End of Borehole							7																
Practical refusal to augering at 4.98m depth.							8																
(GWL @ 2.20m - Sep. 21, 2023)							9																
							10																
							11																
							12																
							13																
							14																

DISCLAIMER: THE DATA PRESENTED IN THIS LOG IS THE PROPERTY OF PATERSON GROUP AND THE CLIENT FOR WHO IT WAS PRODUCED. THIS LOG SHOULD BE READ IN CONJUNCTION WITH ITS CORRESPONDING REPORT. PATERSON GROUP IS NOT RESPONSIBLE FOR THE UNAUTHORIZED USE OF THIS DATA.

SOIL PROFILE AND TEST DATA

GEOTECHNICAL INVESTIGATION

2104 Roger Stevens Drive, Ottawa, Ontario


DATUM: Geodetic **EASTING:** 367950.643 **NORTHING:** 5000130.909 **ELEVATION:** 90.49

PROJECT: Proposed Hindu Temple

FILE NO. PG6832

BORINGS BY: CME 55 Low Clearance Drill

REMARKS:
DATE: September 19, 2023

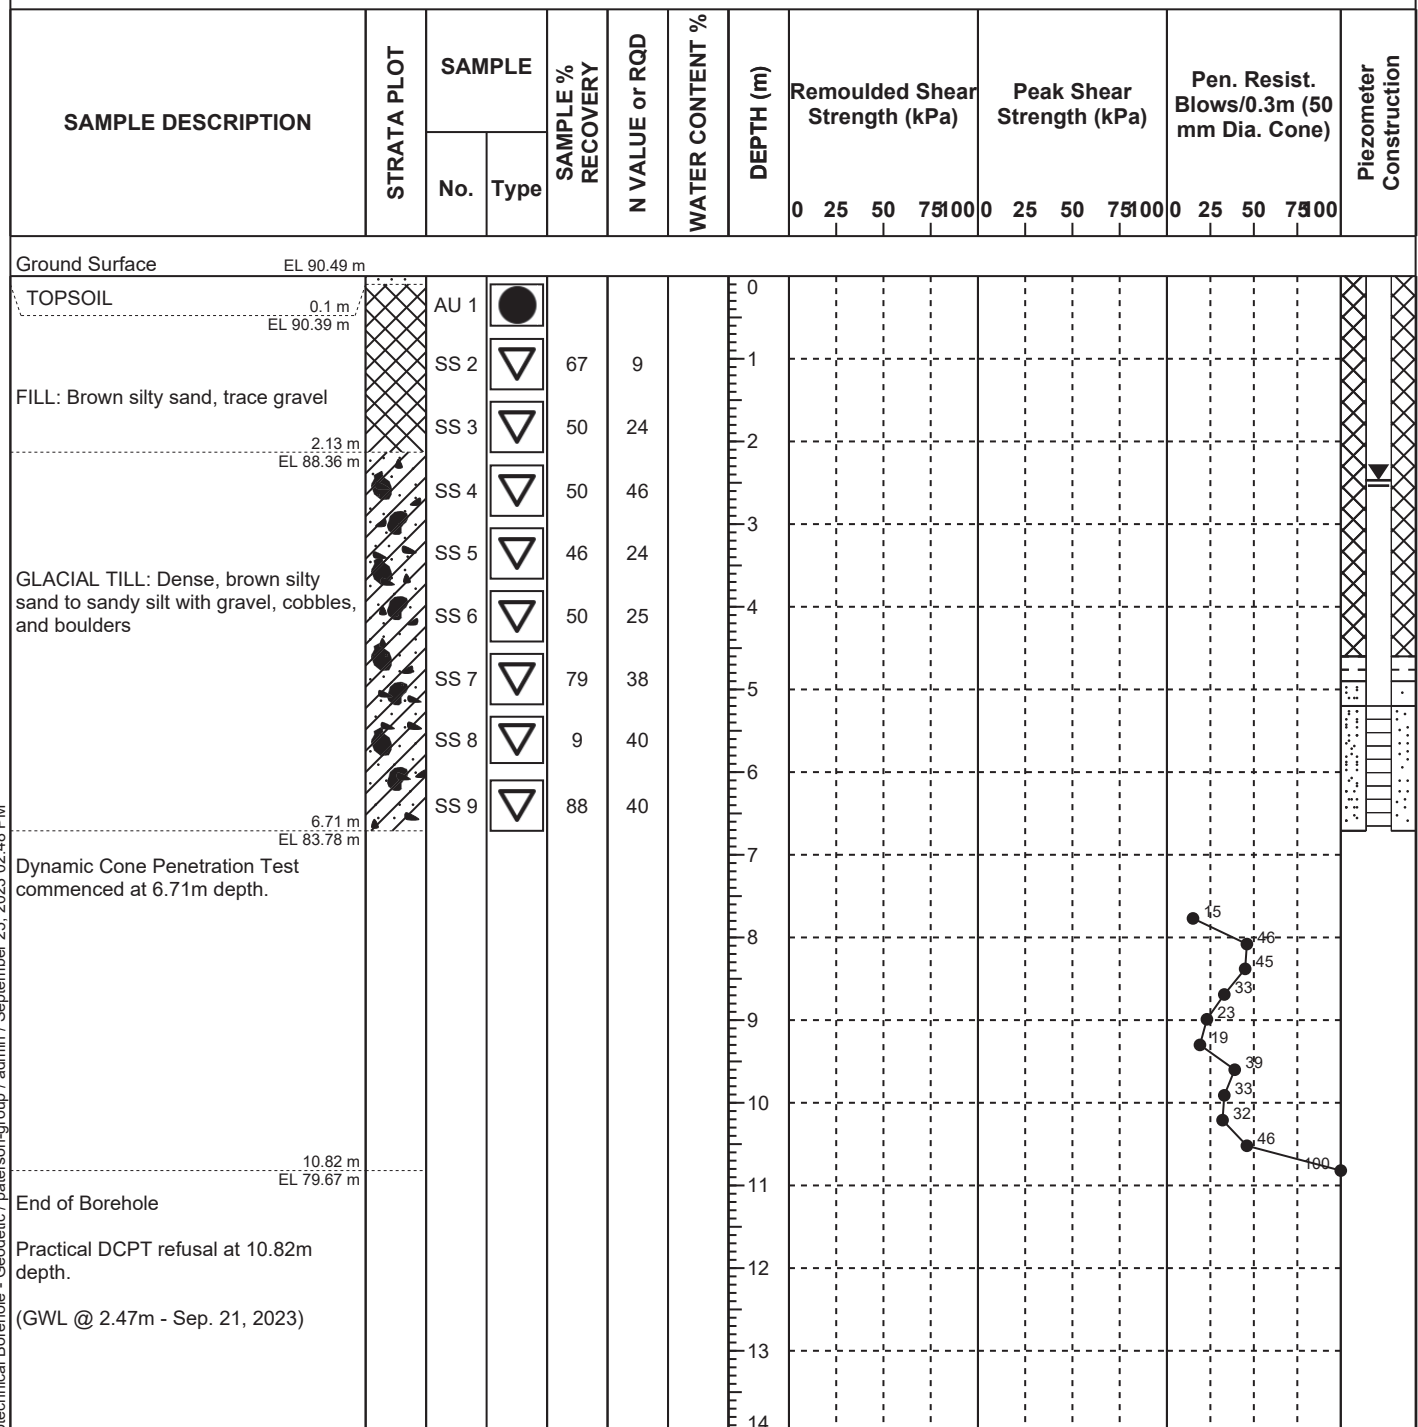HOLE NO. BH 2-23


DISCLAIMER: THE DATA PRESENTED IN THIS LOG IS THE PROPERTY OF PATERSON GROUP AND THE CLIENT FOR WHO IT WAS PRODUCED. THIS LOG SHOULD BE READ IN CONJUNCTION WITH ITS CORRESPONDING REPORT. PATERSON GROUP IS NOT RESPONSIBLE FOR THE UNAUTHORIZED USE OF THIS DATA.

SOIL PROFILE AND TEST DATA

GEOTECHNICAL INVESTIGATION

2104 Roger Stevens Drive, Ottawa, Ontario

DATUM: Geodetic **EASTING:** 367971.19 **NORTHING:** 5000144.833 **ELEVATION:** 90.23

PROJECT: Proposed Hindu Temple

FILE NO. PG6832

BORINGS BY: CME 55 Low Clearance Drill

REMARKS:


DATE: September 19, 2023

HOLE NO. BH 3-23

SAMPLE DESCRIPTION	STRATA PLOT	SAMPLE		SAMPLE % RECOVERY	N VALUE or RQD	WATER CONTENT %	DEPTH (m)	Remoulded Shear Strength (kPa)					Peak Shear Strength (kPa)					Pen. Resist. Blows/0.3m (50 mm Dia. Cone)					Piezometer Construction
		No.	Type					0	25	50	75	100	0	25	50	75	100	0	25	50	75	100	
Ground Surface							0																
EL 90.23 m																							
TOPSOIL		AU 1	●				0																
0.1 m																							
EL 90.13 m		SS 2	▽	50	6		1																
FILL: Brown silty sand, trace gravel		SS 3	▽	0	11		2																
1.35 m																							
EL 88.88 m		SS 4	▽	67	15		3																
GLACIAL TILL: Compact to very dense, brown silty sand to sandy silt with gravel, cobbles and boulders		SS 5	▽	33	33		4																
		SS 6	▽	79	16		5																
		SS 7	▽	67	30		6																
		SS 8	▽	67	18		7																
		SS 9	▽	71	50+		8																
6.71 m							9																
EL 83.52 m							10																
End of Borehole							11																
(GWL @ 2.57m - Sep. 21, 2023)							12																
							13																
							14																

DISCLAIMER: THE DATA PRESENTED IN THIS LOG IS THE PROPERTY OF PATERSON GROUP AND THE CLIENT FOR WHO IT WAS PRODUCED. THIS LOG SHOULD BE READ IN CONJUNCTION WITH ITS CORRESPONDING REPORT. PATERSON GROUP IS NOT RESPONSIBLE FOR THE UNAUTHORIZED USE OF THIS DATA.

PREDICTIVE NITRATE IMPACT ASSESSEMENT		
Infiltration Factors		
Topography	0.20	
Soil	0.40	
Cover	0.10	
Total	0.70	
Site Characteristics		
Area of Site :	20405	m ²
Total of roof areas:	1040	m ²
Total area of paved driveway areas:	4448	m ²
Roof + paved driveway areas	5488	m ²
Impervious Area	5488	m ²
Percent Impervious Area =	27	%
Infiltration Area =	14917	m ²
Septic Effluent		
Concentration of Effluent (Cs) =	20	mg/L
Infiltration Calculation		
Nitrate concentration in precipitation (C _i) =	0	mg/L
Surplus Water (Environment Canada)	378	mm/yr
Factored Water Surplus =	265	mm/yr
Infiltration % due to stormwater management measures	-	%
Infiltration rate from stormwater management measures =	0	mm/yr
Infiltration Flow Entering the System (Q _i) =	11	m ³ /day
Mass Balance Model (MOEE, 1995)		
$C_T = (Q_b C_b + Q_e C_e + Q_i C_i) / (Q_b + Q_e + Q_i)$ = Cumulative Nitrate Concentration		
Q _b = flow entering the system across the upgradient area	0	m ³ /day
C _b = background nitrate concentration	0	mg/L
Q _e = flow entering the system from the septic drainfield	7.25	m ³ /day
C _e = concentration of nitrates in the septic effluent	20	mg/L
Q _i = flow entering the system from infiltration	11	m ³ /day
C _i = Concentration of nitrates in the infiltrate	0	mg/L
C_T =	8.03	mg/L
Sewage Flow Volume		
Daily Sewage Flow (Q _s)=	7.25	m³
Notes: Site characteristic values were measured as approximate values from the available site plans and GeoOttawa.		

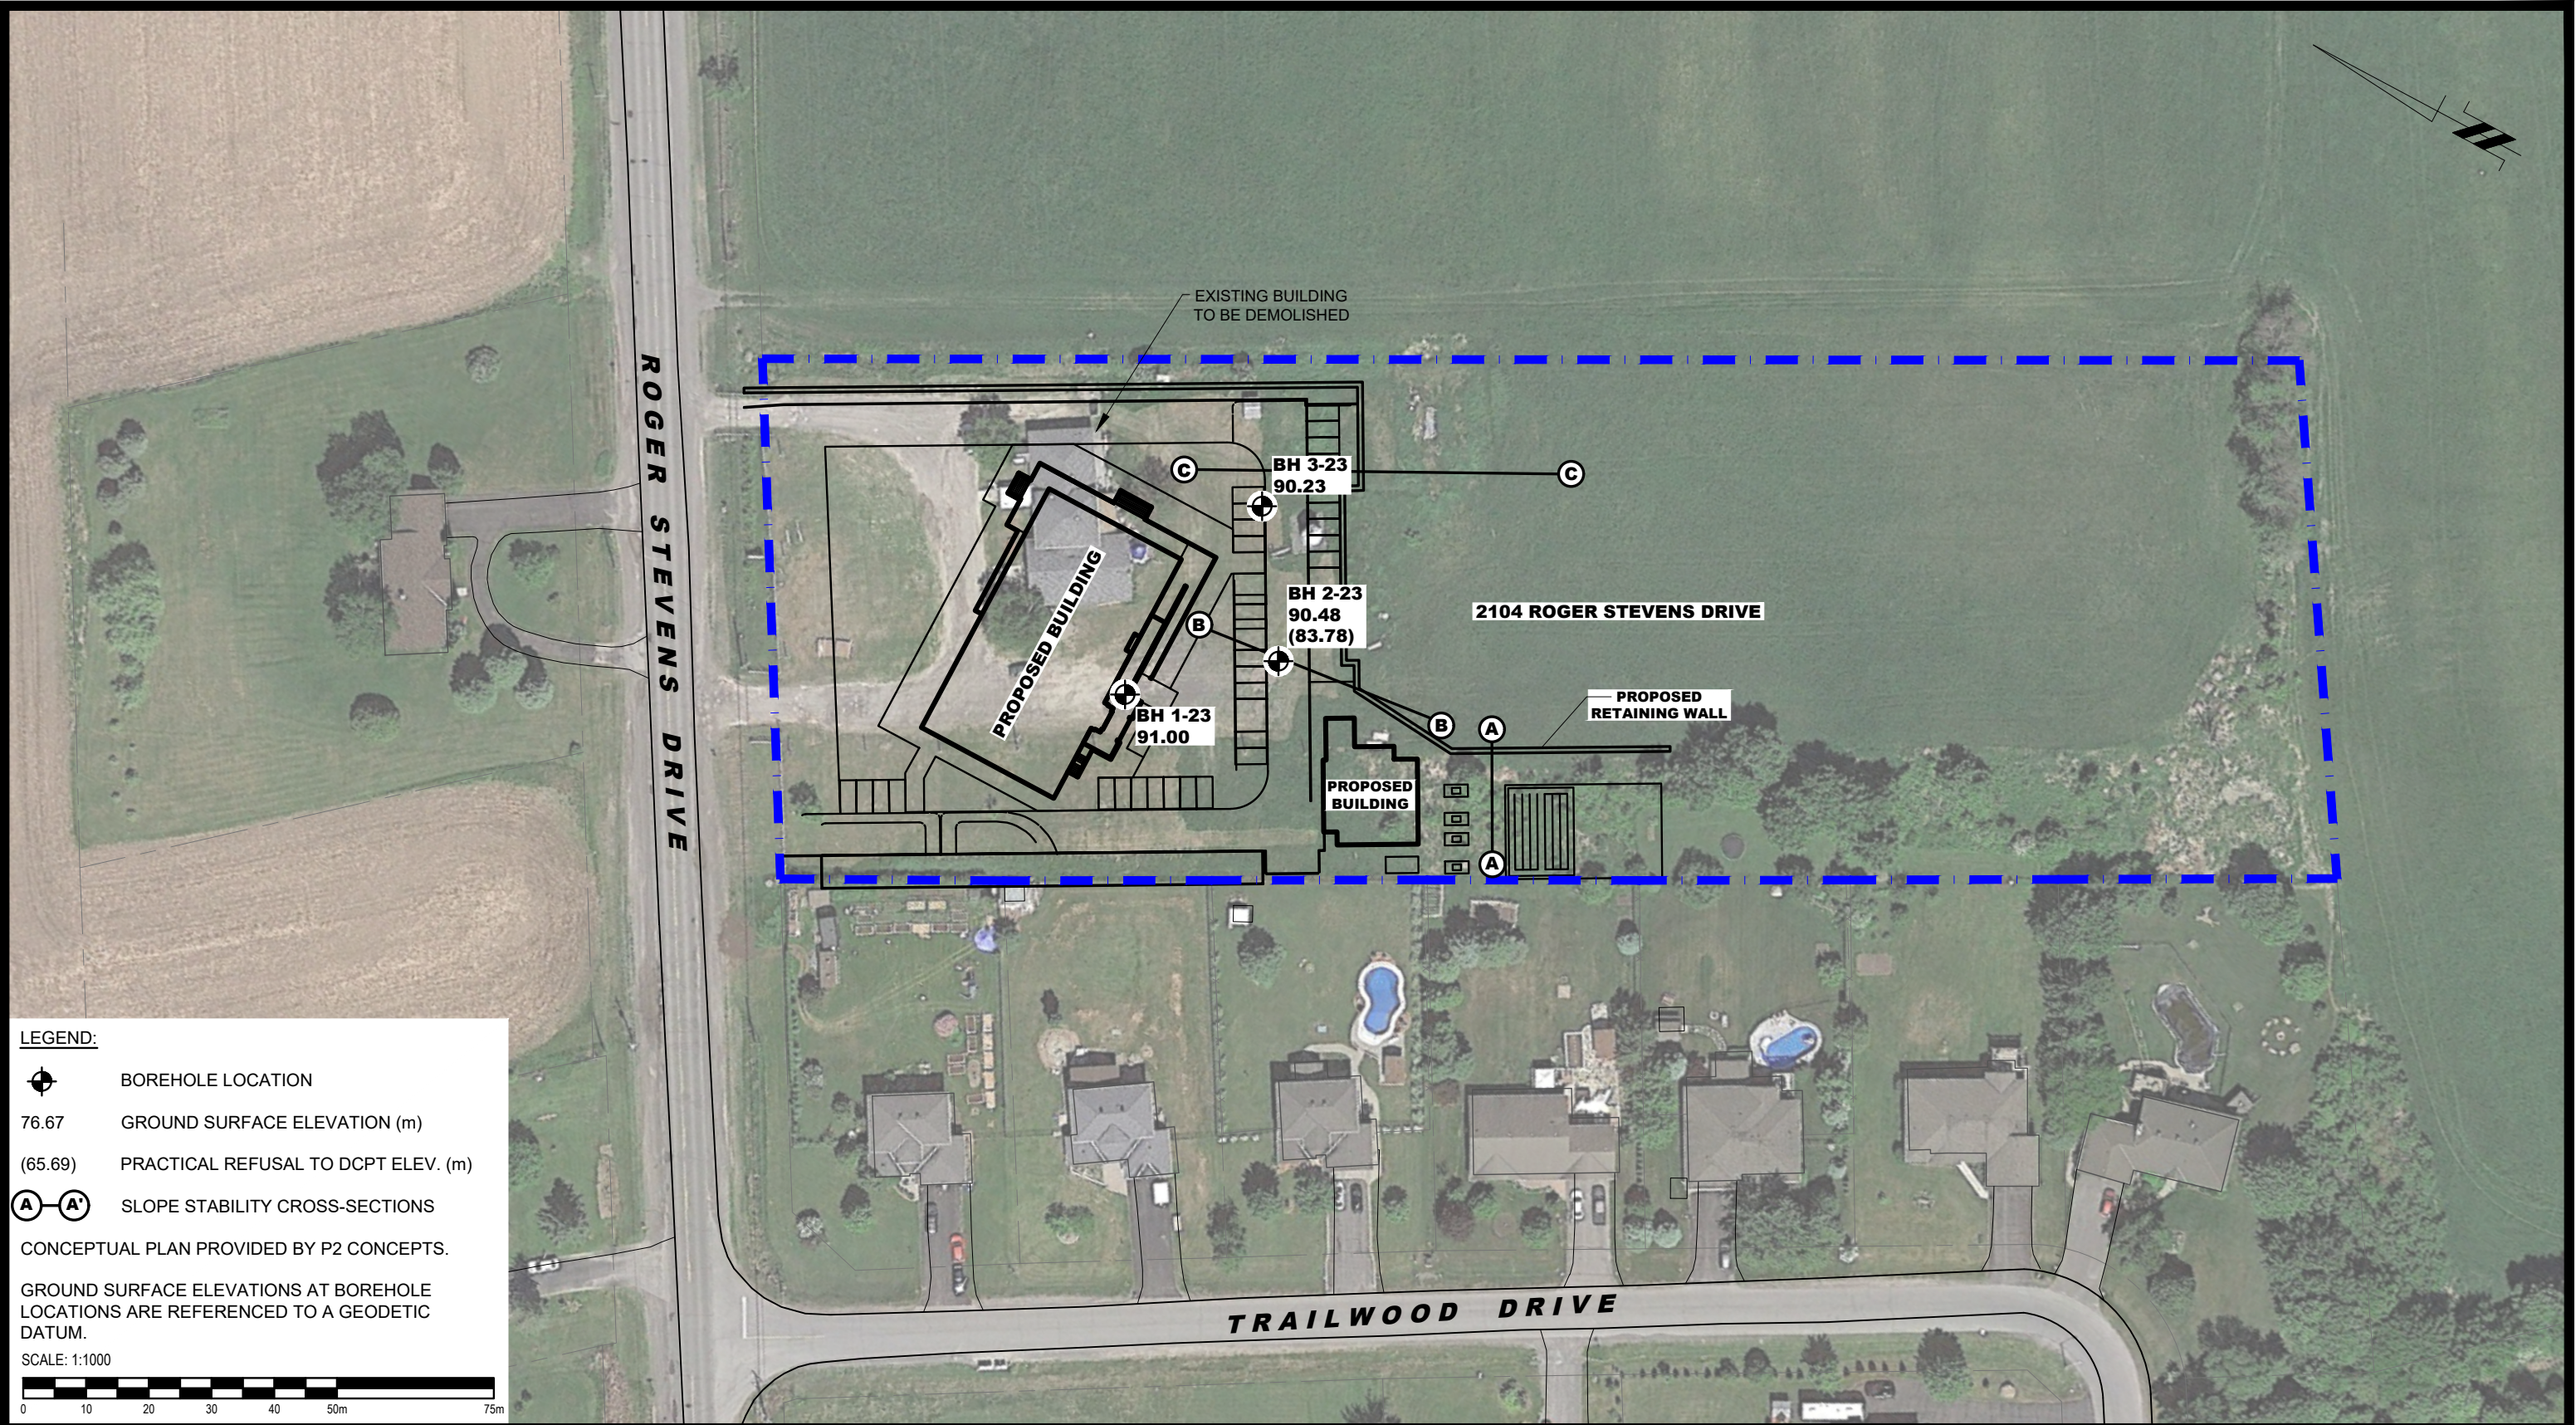

LEGEND:

BOREHOLE LOCATION

76.67 GROUND SURFACE ELEVATION (m)


(65.69) PRACTICAL REFUSAL TO DCPT ELEV. (m)

SLOPE STABILITY CROSS-SECTIONS

CONCEPTUAL PLAN PROVIDED BY P2 CONCEPTS.


GROUND SURFACE ELEVATIONS AT BOREHOLE LOCATIONS ARE REFERENCED TO A GEODETIC DATUM.

SCALE: 1:1000

<div></div> <div><div>PATERSON GROUP</div><div>9 AURIGA DRIVE OTTAWA, ON K2E 7T9 TEL: (613) 226-7381</div></div>					OTTAWA, Title:TEST HOLE LOCATION PLAN	OTTAWA SIVAN TEMPLE GEOTECHNICAL INVESTIGATION PROPOSED HINDU TEMPLE 2104 ROGER STEVENS DRIVE ONTARIO	Scale:1:1000	Date:09/2023
							Drawn by:NFRV	Report No.:PG6832-1
	2	ADDED SLOPE STABILITY CROSS SECTION C-C TO PLAN	27/01/2025	DR			Checked by:OM	Dwg. No.: PG6832-1
	1	AS PER REVISED CONCEPTUAL PLAN	24/06/2024	OM			Approved by:SD	
	NO.	REVISIONS	DATE	INITIAL				Revision No.:2

INSULATE SEWER AS INDICATED AND WHERE DEPTH
OF COVER COVER IS LESS THAN 2400mm.
PROVIDE A MINIMUM 1200mm COVER.
CENTER INSULATION OVER PIPE.
JOINTS BETWEEN SHEETS OF INSULATION SHALL BE
STAGGERED.

INSULATION OF WELL WATER LINE
SHALLOW TRENCHES
N.T.S.

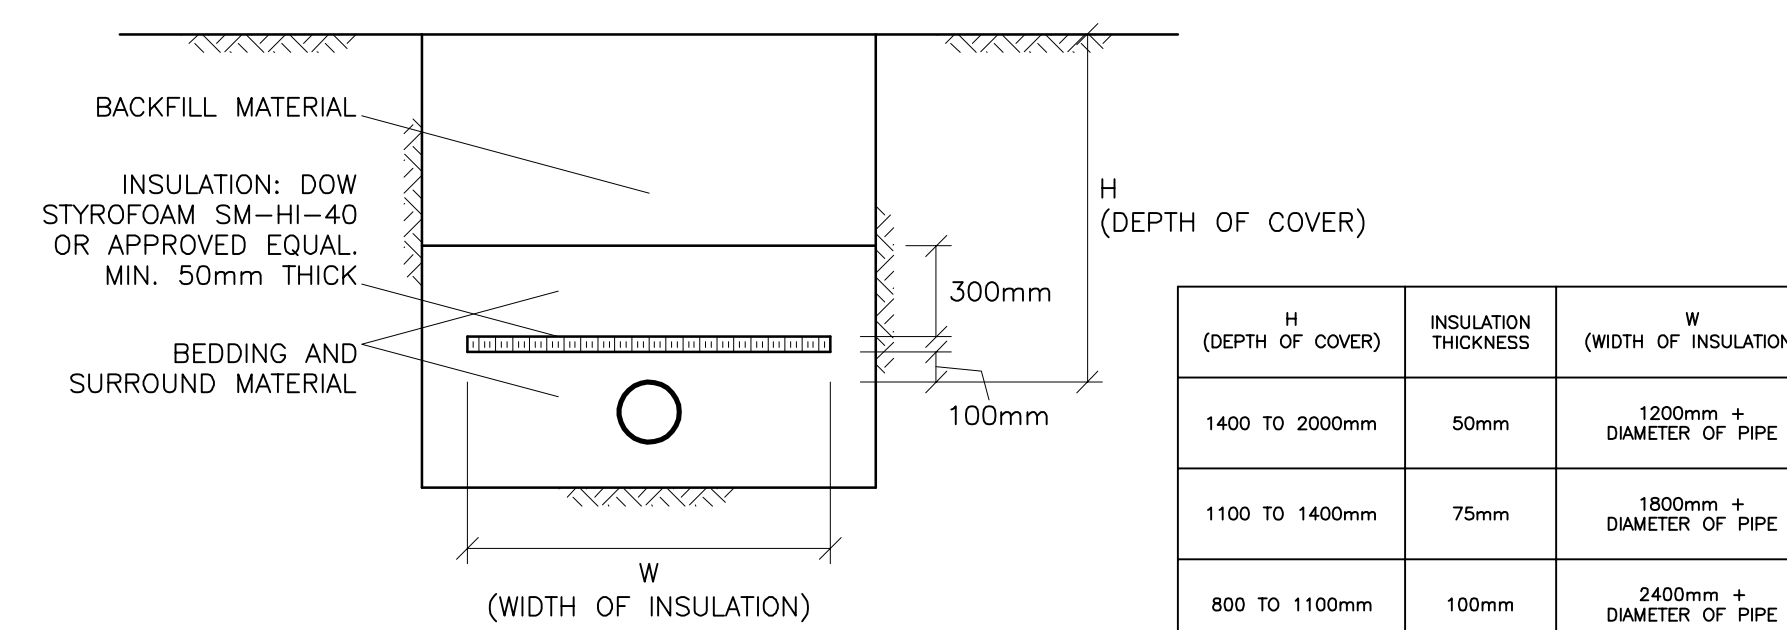















INSULATE SEWER AS INDICATED AND AS PER CITY DRAWING S35
AND WHERE DEPTH OF COVER IS LESS THAN 2000mm.
CENTER INSULATION OVER PIPE.
JOINTS BETWEEN SHEETS OF INSULATION SHALL BE STAGGERED.


INSULATION OF SEWERS
IN SHALLOW TRENCHES
AS PER CITY OF OTTAWA DRAWING No. S35
N.T.S

H (DEPTH OF COVER)	INSULATION THICKNESS	W (WIDTH OF INSULATION)
1800 TO 2400mm	50mm	1200mm
1500 TO 1800mm	75mm	1800mm
1200 TO 1500mm	100mm	2400mm

(DEPTH OF COVER) H	INSULATION THICKNESS	(WIDTH OF INSULATION) W
1400 TO 2000mm	50mm	1200mm + DIAMETER OF PIPE
1100 TO 1400mm	75mm	1800mm + DIAMETER OF PIPE
800 TO 1100mm	100mm	2400mm + DIAMETER OF PIPE
500 TO 800mm	125mm	3000mm + DIAMETER OF PIPE

- | <u>LEGEND</u> | |
|---|--------------------------|
| FFL | FIRST FLOOR ELEVATION |
| TOF | TOP OF FOUNDATION |
| BFL | BASEMENT FLOOR ELEVATION |
| USF | UNDERSIDE OF FOOTING |
|    | PROPERTY LINE |
| CB  | CATCH BASIN |
| MH  | STORM MANHOLE |
| CB/MH  | CATCH BASIN/MANHOLE |
| MH  | SANITARY MANHOLE |
|  <u>SAN</u>  | SANITARY SEWER |
|  <u>ST</u>  | STORM SEWER |
|  <u>WL</u>  | WELL WATER LINE |
| INV | INVERT OF PIPE |
| <u>RDO</u> | ROOF DRAIN OUTLET |
|  | EXISTING GRADE ELEVATION |

KEY PLAN

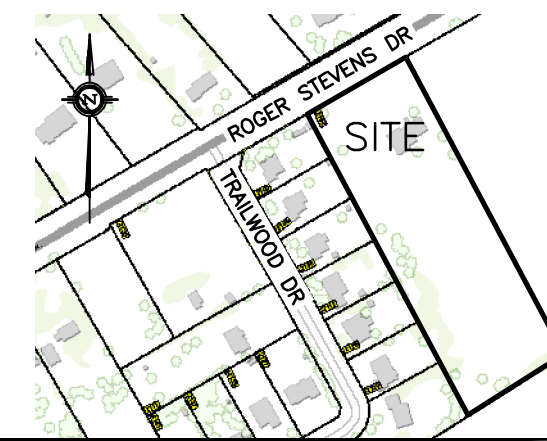

8	JUN 12-25	RE-ISSUED FOR APPROVAL & BUILDING PERMIT FOR PRIEST RESIDENCE
7	APR 10-25	RE-ISSUED FOR APPROVAL
6	OCT 25-24	ISSUED FOR APPROVAL
5	OCT 18-24	ISSUED FOR COORDINATION
4	OCT 15-24	ISSUED FOR COORDINATION
3	SEP 20-24	ISSUED FOR COORDINATION
2	AUG 6-24	ISSUED FOR COORDINATION
1	OCT 23-24	ISSUED FOR APPROVAL
No.	DATE	REVISION

D. B. GRAY ENGINEERING INC.


700 Long Point Circle
Ottawa, Ontario

Project

PROPOSED HINDU TEMPLE
2104 ROGER STEVENS DR
NORTH GOWER, ONTARIO

Drawing Title

SITE SERVICING PLAN

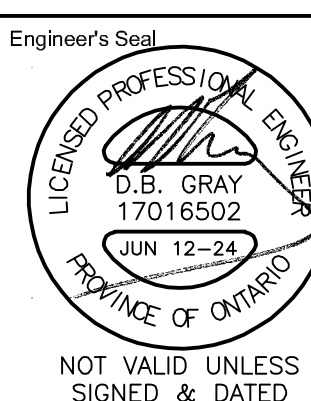

Drawn	D.B.
H. Scale	1:300
V. Scale	
Date	JUN 11-24
Job No.	2002

Drawing No.
C-1
of 7

REFER TO NOTES & DETAILS
ON DRAWING C-5 & C-6

RDO: ROOF DRAIN OUTLET TO BE 0.30m ABOVE GRADE - TURN END OF PIPE DOWN ON TO SPLASH PAD

REFER TO DRAWING C-2 FOR INSULATION OF SEPTIC SYSTEM PIPES (SEWERS & FORCEMAINS)

