
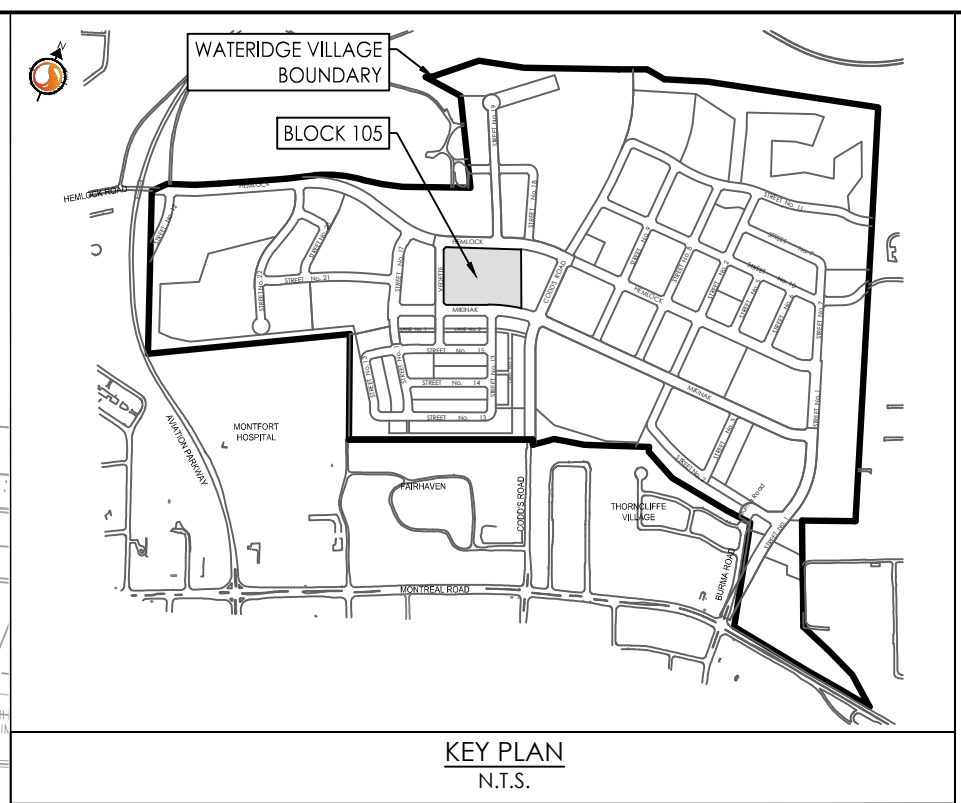


2025-05-25 1:00 PM C:\Users\jg\OneDrive\Documents\16402127-258.dwg
2025-05-25 1:00 PM C:\Users\jg\OneDrive\Documents\16402127-258.dwg

200mmØ WATERMAIN A TABLE				
STA:	FINISHED GRADE	TOP W/M	ITEM	
0+000	86.02	83.46	CONNECT TO EXISTING 200mm VALVE AND BOX	
0+001.4	86.02	83.620	45° VERTICAL BEND (W25.2)	
0+002.4	86.02	83.88	45° VERTICAL BEND (W25.2, W22)	
0+004.4	86.10	83.88	45° VERTICAL BEND (W25.2, W22)	
0+005.4	85.95	83.550	45° VERTICAL BEND (W25.2)	
0+010.0	86.16	83.760	TOP OF PIPE	
0+019.8	86.25	84.130	200mmØ x 200mmØ TEE	
0+021.2	86.28	84.130	200mm VALVE AND BOX	
0+022.3	86.28	83.880	45° VERTICAL BEND (W25.2)	
0+022.8	86.28	84.27	45° VERTICAL BEND (W25.2, W22)	
0+025.2	86.32	84.27	45° VERTICAL BEND (W25.2, W22)	
0+025.7	86.32	83.920	45° VERTICAL BEND (W25.2)	
0+026.3	86.30	84.130	22.5° HORIZONTAL BEND	
REFER TO DWG PP-2 FOR CONTINUATION OF PROPOSED WATERMAIN				

ORIGINAL SHEET - ARCH C

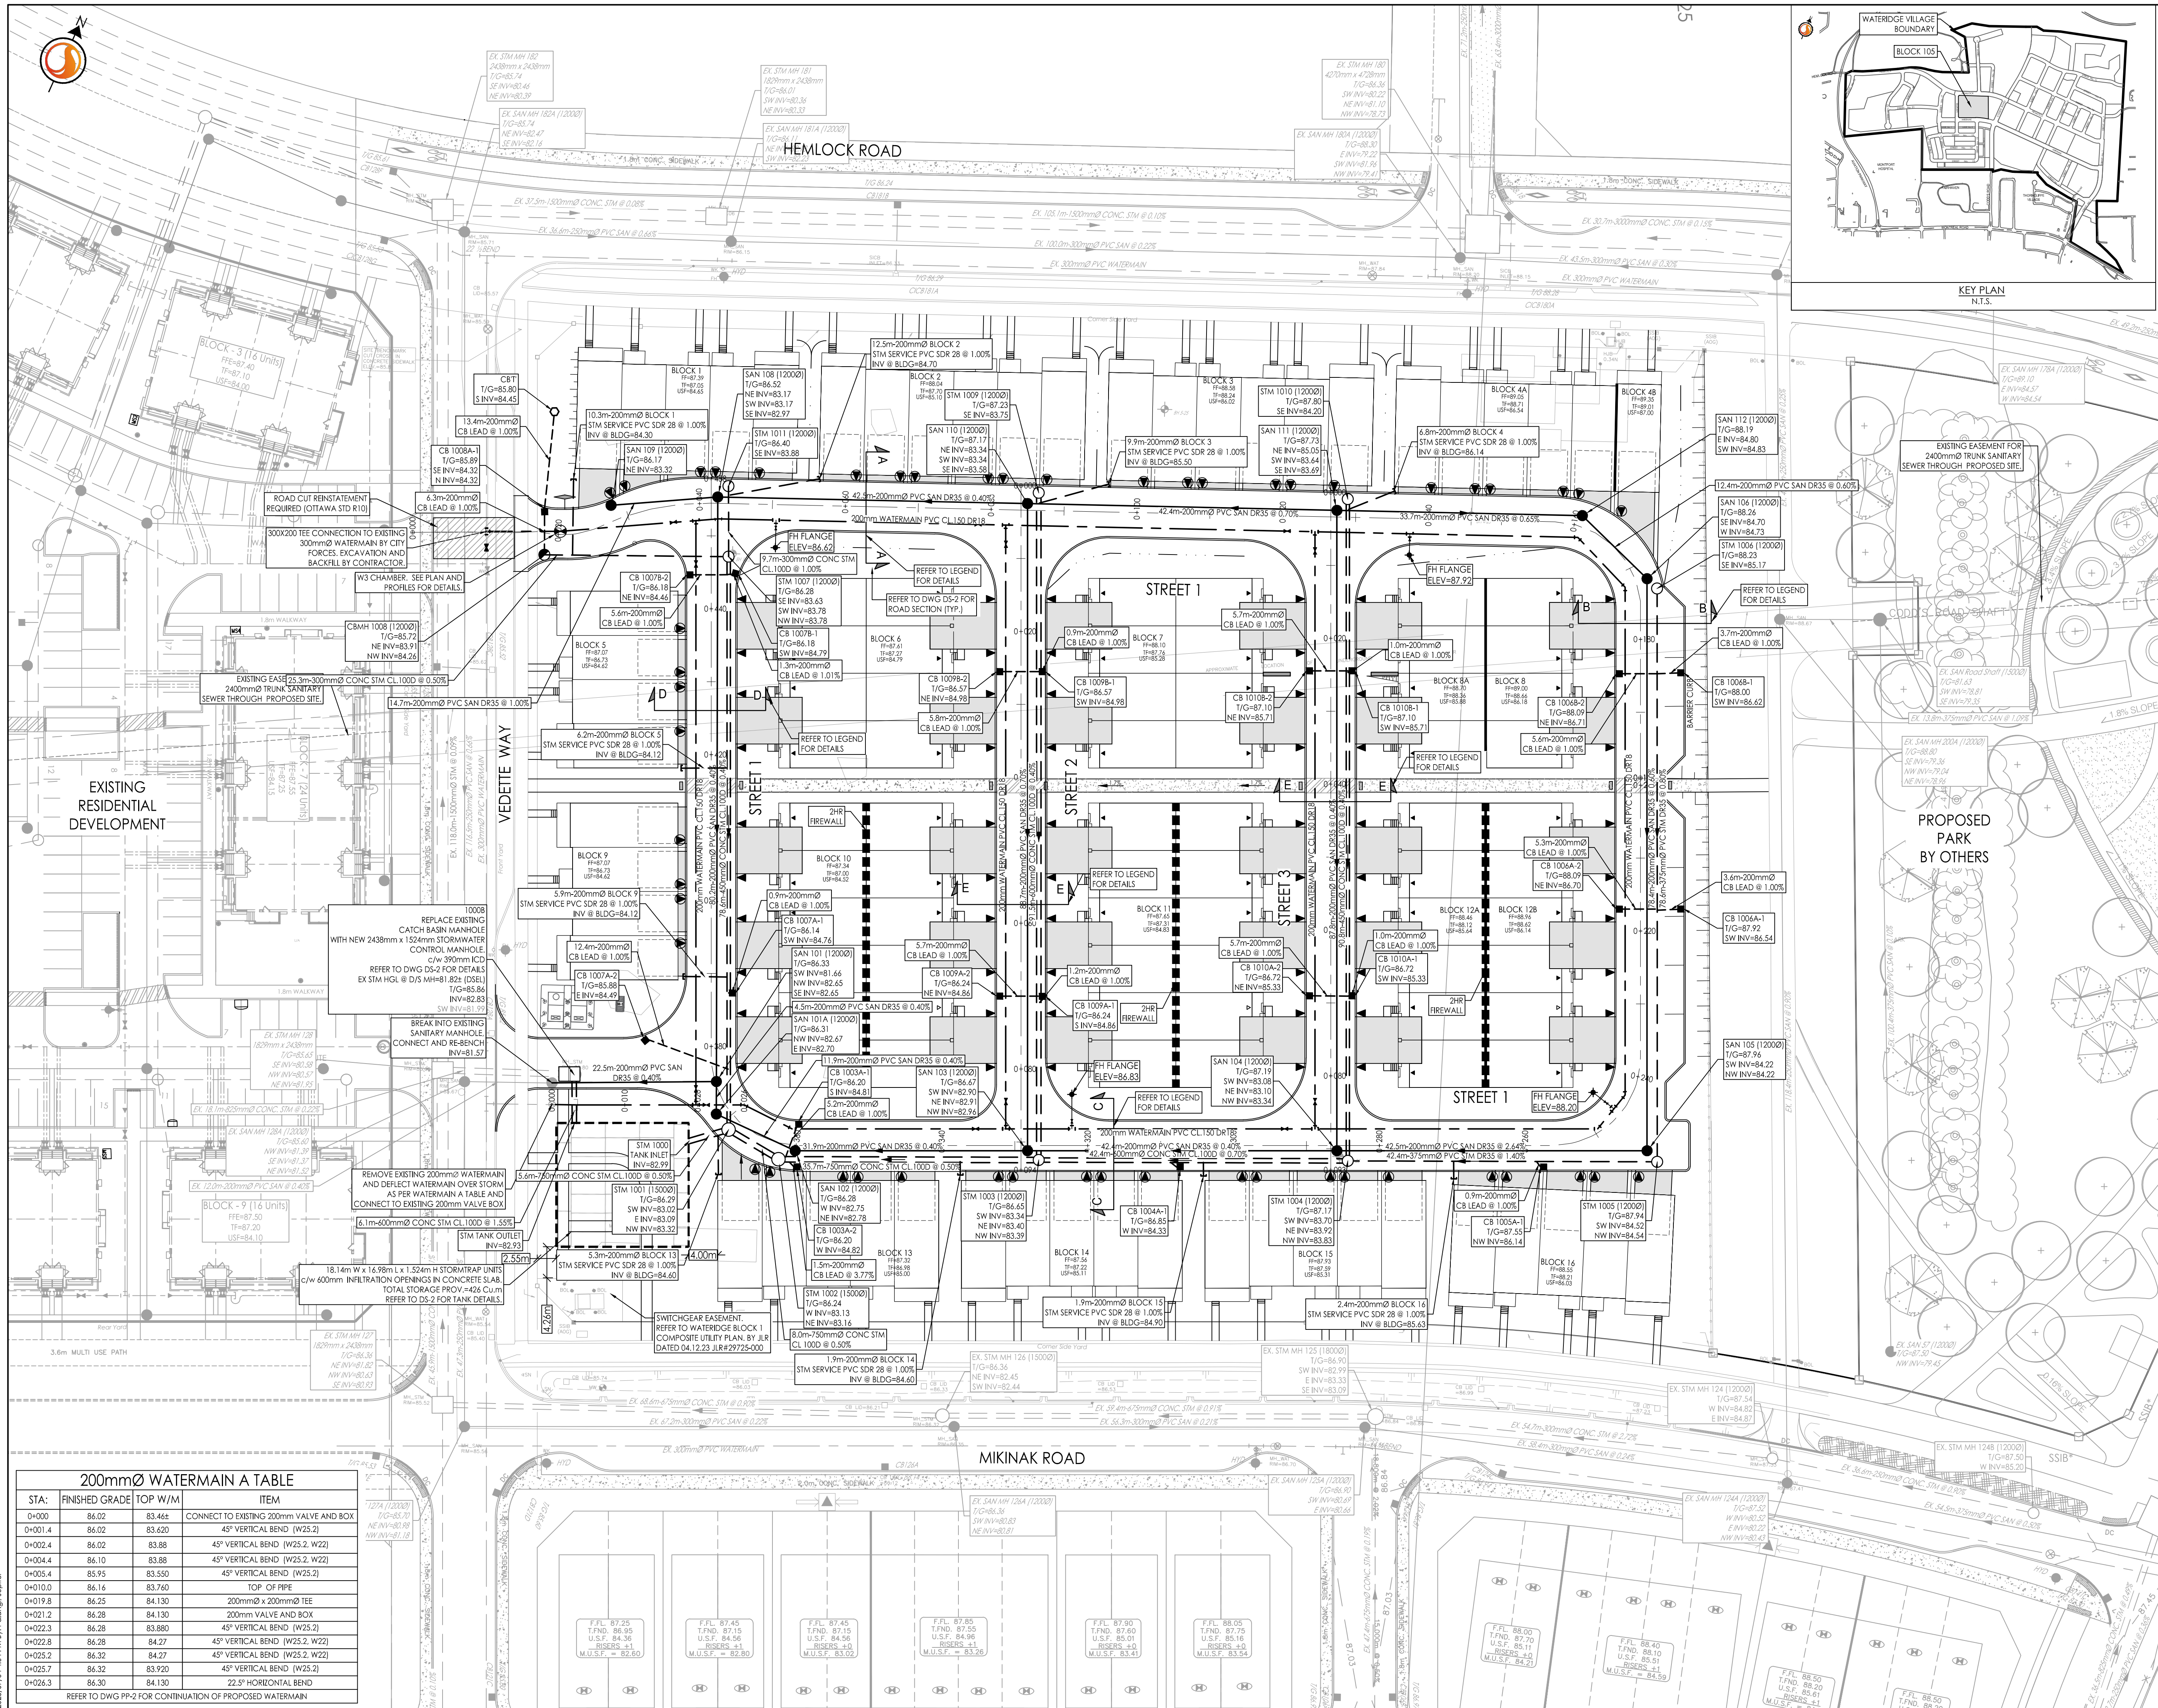

Stantec Consulting Ltd.
400 - 1331 Clyde Avenue
Ottawa ON
Tel. 613.722.4420
www.stantec.com

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale this drawing - any errors or omissions shall be reported to Stantec without delay.
The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

- Legend
- PROPOSED WATERMAIN
 - PROPOSED VALVE AND VALVE BOX
 - PROPOSED VALVE CHAMBER
 - PROPOSED REDUCER
 - PROPOSED FIRE HYDRANT
 - PROPOSED SANITARY SEWER
 - PROPOSED STORM SEWER
 - PROPOSED CATCH-BASIN MANHOLE
 - PROPOSED CATCH-BASIN
 - EXISTING WATERMAIN
 - EXISTING VALVE AND VALVE BOX
 - EXISTING VALVE CHAMBER
 - EXISTING REDUCER
 - EXISTING FIRE HYDRANT
 - EXISTING SANITARY SEWER
 - EXISTING STORM SEWER
 - EXISTING CATCH-BASIN MANHOLE
 - EXISTING CATCH-BASIN
 - PROPOSED DEPRESSION CURB LOCATIONS
 - PROPOSED BARRIER CURB
 - THERMAL INSULATION ON STORM SEWER WHERE COVER IS LESS THAN 1.5m. THERMAL INSULATION ON WATERMAIN WHERE COVER IS LESS THAN 2.4m AS PER W22.
 - PROPOSED 2H RATED FIRE WALL LOCATION

- SCUPPER LOCATIONS
- TYPICAL ROAD CROSS-SECTION
REFER TO D5-2 FOR MORE DETAILS
- SERVICE LATERAL LOCATION (SANITARY AND WATER ONLY)
150mm SANITARY SERVICE PVC SDR 26 @ 1.5m
150mm FIRE LUGGING WATER SERVICE C/W CURB STOP AND SERVICE POST, WATER AND RANCH METER.
STANDPOST ON PRIVATE SIDE TO BE LOCATED 0.7m BEHIND FACE OF CURB. STANDPOST ON PUBLIC SIDE TO BE ON PROPERTY.
- SERVICE LATERAL LOCATION (SANITARY, WATER AND STORM)
150mm STORM SERVICE PVC SDR 26 @ 1.5m
150mm SANITARY SERVICE PVC SDR 26 @ 1.5m
150mm FIRE LUGGING WATER SERVICE C/W CURB STOP AND SERVICE POST, WATER AND RANCH METER.
STANDPOST ON PRIVATE SIDE TO BE LOCATED 0.7m BEHIND FACE OF CURB. STANDPOST ON PUBLIC SIDE TO BE ON PROPERTY.

- Notes
- SERVICING INFORMATION WITHIN PROPERTY LIMITS AND ADJACENT ROADS NETWORK RETRIEVED FROM BI GROUP WATERIDGE VILLAGE AT ROCKLIFE PHASE 1A, DATED OCT 25, 2025
 - SITE PLAN PREPARED BY KORSIAK URBAN PLANNING, DATED 2025-05-25, TITLED: SITE PLAN, DRAWING NO. A.

2	ISSUED FOR CITY REVIEW	JP	PM	25.07.04	
1	ISSUED FOR CITY REVIEW	JP	PM	25.04.04	
Revision		By	Appd.	YY.MM.DD	
File Name: 160402127-DB		JP	PM	JP	25.03.24
Permit-Seal		Dwn.	Chkd.	Dsgn.	YY.MM.DD

Permit-Seal

Client/Project
MATTAMY HOMES

WATERIDGE VILLAGE
BLOCK 105
OTTAWA, ON, CANADA

Title
SITE SERVICING PLAN

Project No.
160402127

Scale
1:400

Drawing No.
Sheet

Revision
Revision

SSP-1
3 of 11
2
PLAN # XXXXX

D07-12-25-0063
D07-04-25-0006