

STATION	FINISHED GRADE	TOP W/M	ITEM
D-000	91.11	87.80	150mm Ø X 150mm Ø RE
D-003	91.09	87.81	150mm VALVE AND BOX
D-020	91.00	87.85	TOP OF PIPE
D-040	91.17	87.90	TOP OF PIPE
D-048	91.22	87.92	22" HORIZONTAL BEND
D-060	91.38	87.95	TOP OF PIPE
D-074.3	91.24	87.97	150mm VALVE AND BOX
D-082.5	91.75	88.01	DRY FIRE HYD PER W33

STATION	FINISHED GRADE	TOP W/M	ITEM
D-000	91.09	87.75	300mm FIRE WATERM IN ET
D-016	91.07	87.79	150mm VALVE AND BOX
D-023.3	91.11	87.80	150mm Ø X 150mm Ø RE
D-023.5	91.13	87.81	22" HORIZONTAL BEND
D-040	91.29	87.85	TOP OF PIPE
D-060	91.43	87.90	TOP OF PIPE
D-060.4	91.58	87.95	22" HORIZONTAL BEND
D-068	91.82	87.99	150mm VALVE AND BOX
D-102.8	91.78	88.00	DRY FIRE HYD PER W33




CROSSING	STW INV	STW OUT	SAN INV	SAN OUT	WTR TOP	WTR BOT
▲ (B) (B) (27)	90.13 (90.24)				87.80	87.85
▲ (B) (B) (23)	90.26 (90.14)				87.93	87.78
▲ (B) (B) (45)	90.07 (90.16)				87.97	87.82
		90.00	90.00	90.00	88.00	87.85

* BRACKETS DENOTE ADJUSTED VALUE WITH CONCRETE PIPE THICKNESS

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawings - any errors or omissions shall be reported to Stantec without delay.
The Copyright in all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

- Legend**
- PROPOSED WATERMAIN
 - PROPOSED VALVE AND VALVE BOX
 - PROPOSED DRY FIRE HYDRANT PER W33
 - PROPOSED SANITARY SEWER
 - PROPOSED STORM SEWER
 - PROPOSED CATCH-BAIN MANHOLE
 - EXISTING WATERMAIN
 - EXISTING VALVE AND VALVE BOX
 - EXISTING VALVE CHAMBER
 - EXISTING FIRE HYDRANT
 - EXISTING FIRE HYDRANT
 - EXISTING COMBINED SEWER
 - EXISTING STORM SEWER
 - EXISTING CATCH-BAIN MANHOLE
 - EXISTING CATCH-BAIN
 - PROPOSED DEPRESSED CURB LOCATIONS
 - PROPOSED BARRIER CURB
 - THERMAL ISOLATION ON STORM SEWER WHERE COVER IS LESS THAN 2.0m AND ON SANITARY SEWER WHERE COVER IS LESS THAN 0.4m PER O.S.
 - ENGINEERED RETAINING WALL TO BE DESIGNED BY STRUCTURAL / GEOTECHNICAL ENGINEER
 - CHAIN LINK FENCE PER ARCHITECTURAL PLANS

Notes

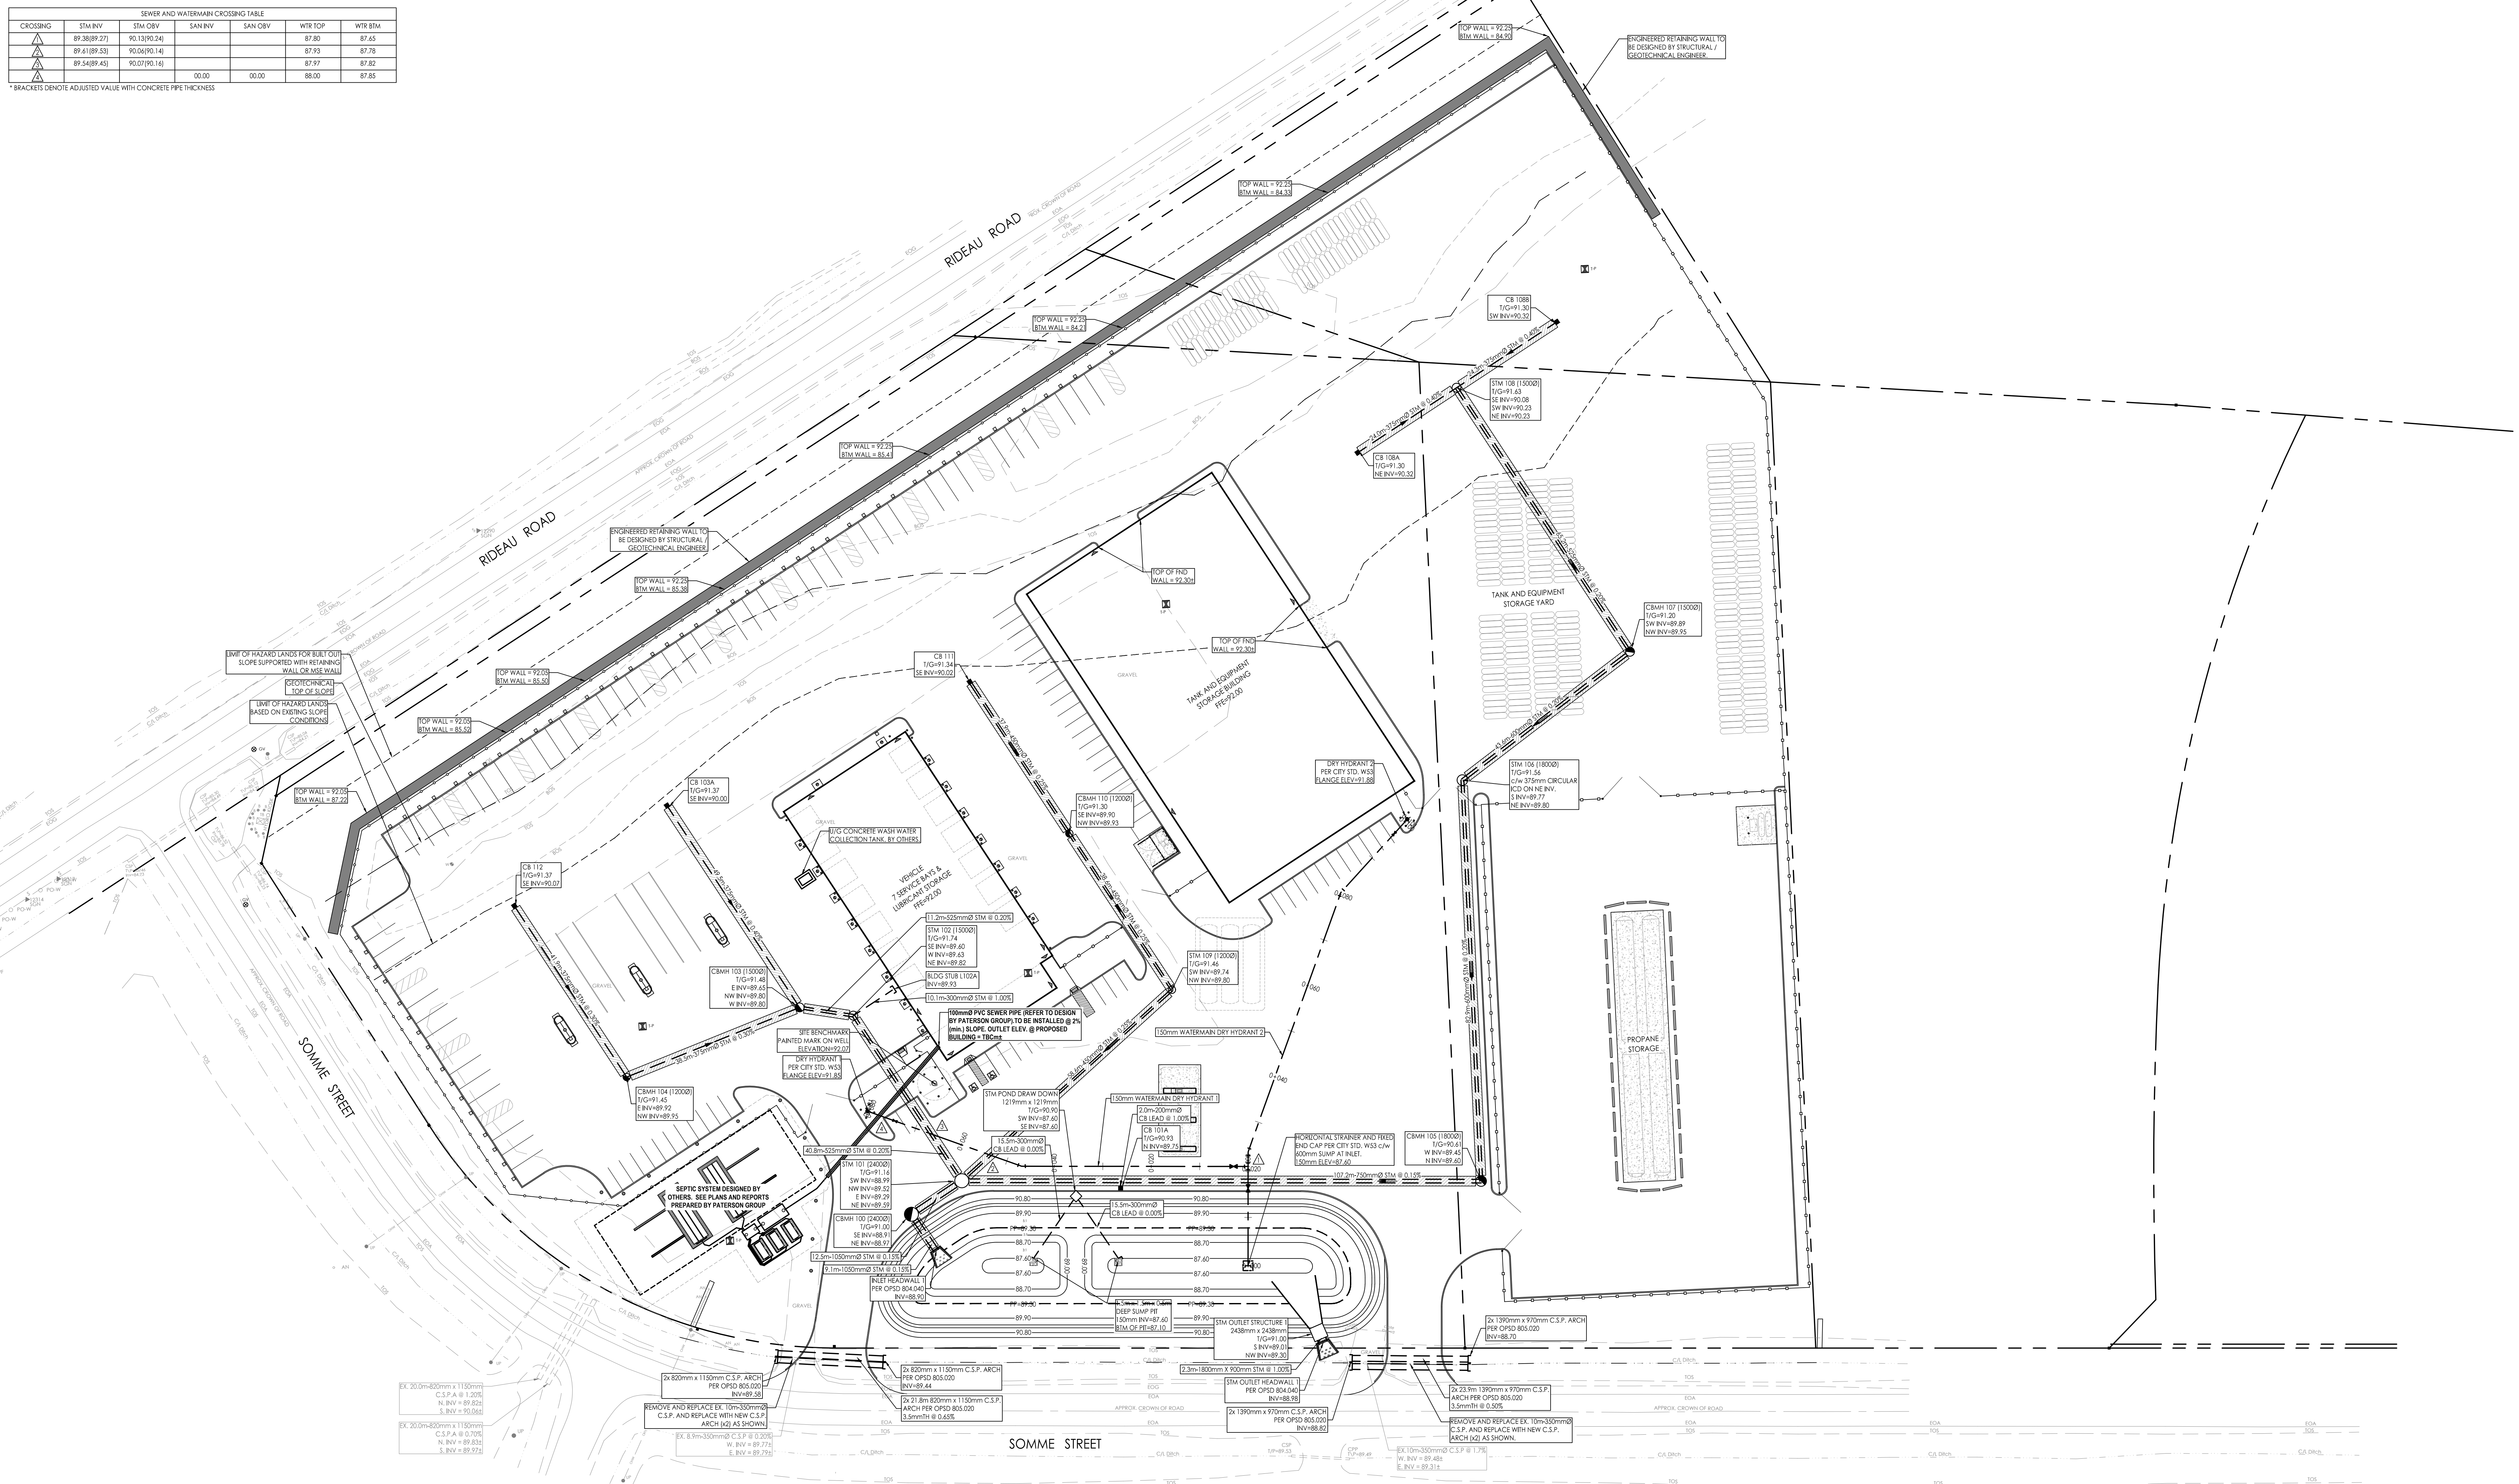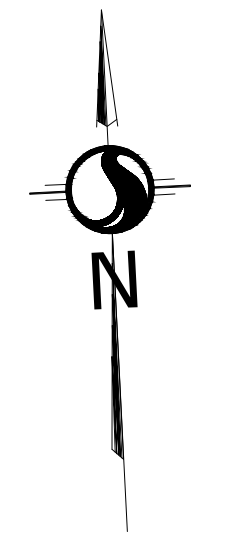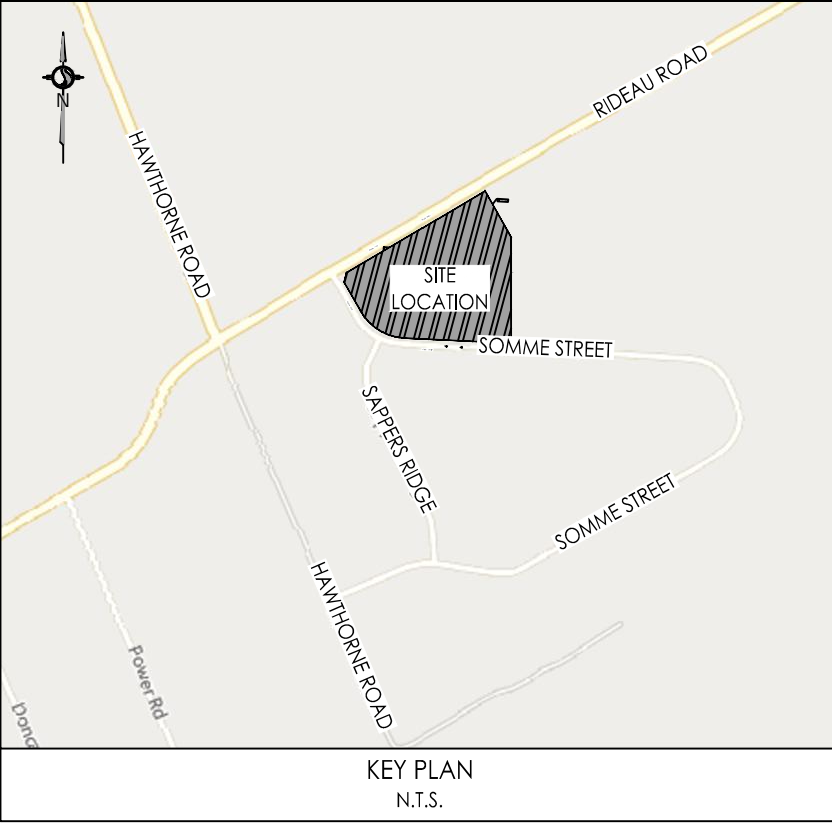

Revision	By	App'd	Y/M/D
0	ISSUED FOR REVIEW	M.S.	PM 25.08.22
1		M.S.	BY 25.08.22
2		M.S.	BY 25.08.22
3		M.S.	BY 25.08.22



Client/Project
W. O. Stinson & Son Ltd.
Albion Road Property
VEHICLE YARD SERVICE BUILDING
301 SOMME STREET
OTTAWA, ON, CANADA

Title
SITE SERVICING PLAN

Project No.	Scale	Sheet	Revision
160402138	0 5 10 25m	SSP-1	3 of 9