





3210 ALBION ROAD SOUTH

ISSUED FOR SITE PLAN APPLICATION

2025/09/29 EFI REF. NO. 7834

DRAWING LIST

7834-C001	COVER PAGE
7834-C100	EXISTING CONDITIONS PLAN
7834-C101	REMOVALS PLAN (FUTURE SUBMISSION)
7834-C103	SERVICING PLAN
7834-C104	GRADING PLAN
7834-C105	SEDIMENT AND EROSION CONTROL PLAN
7834-C106	PRE-DEVELOPMENT STORM PLAN
7834-C107	POST-DEVELOPMENT STORM PLAN
7834-C108	CIVIL NOTES AND DETAILS PLAN

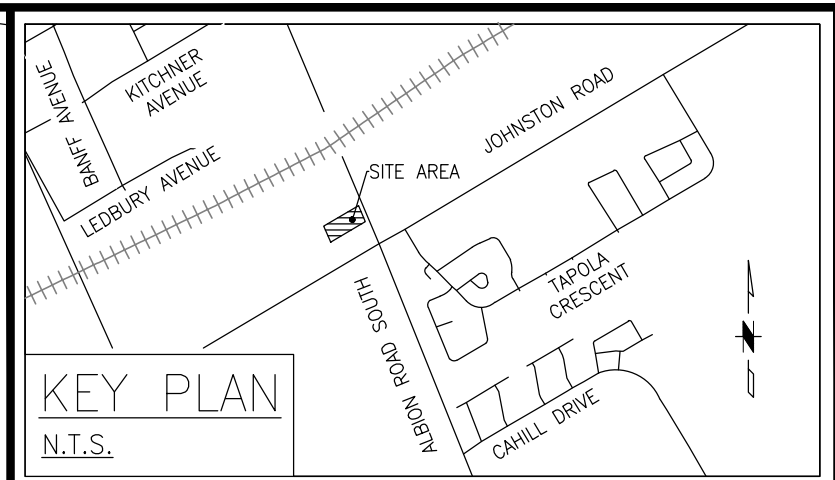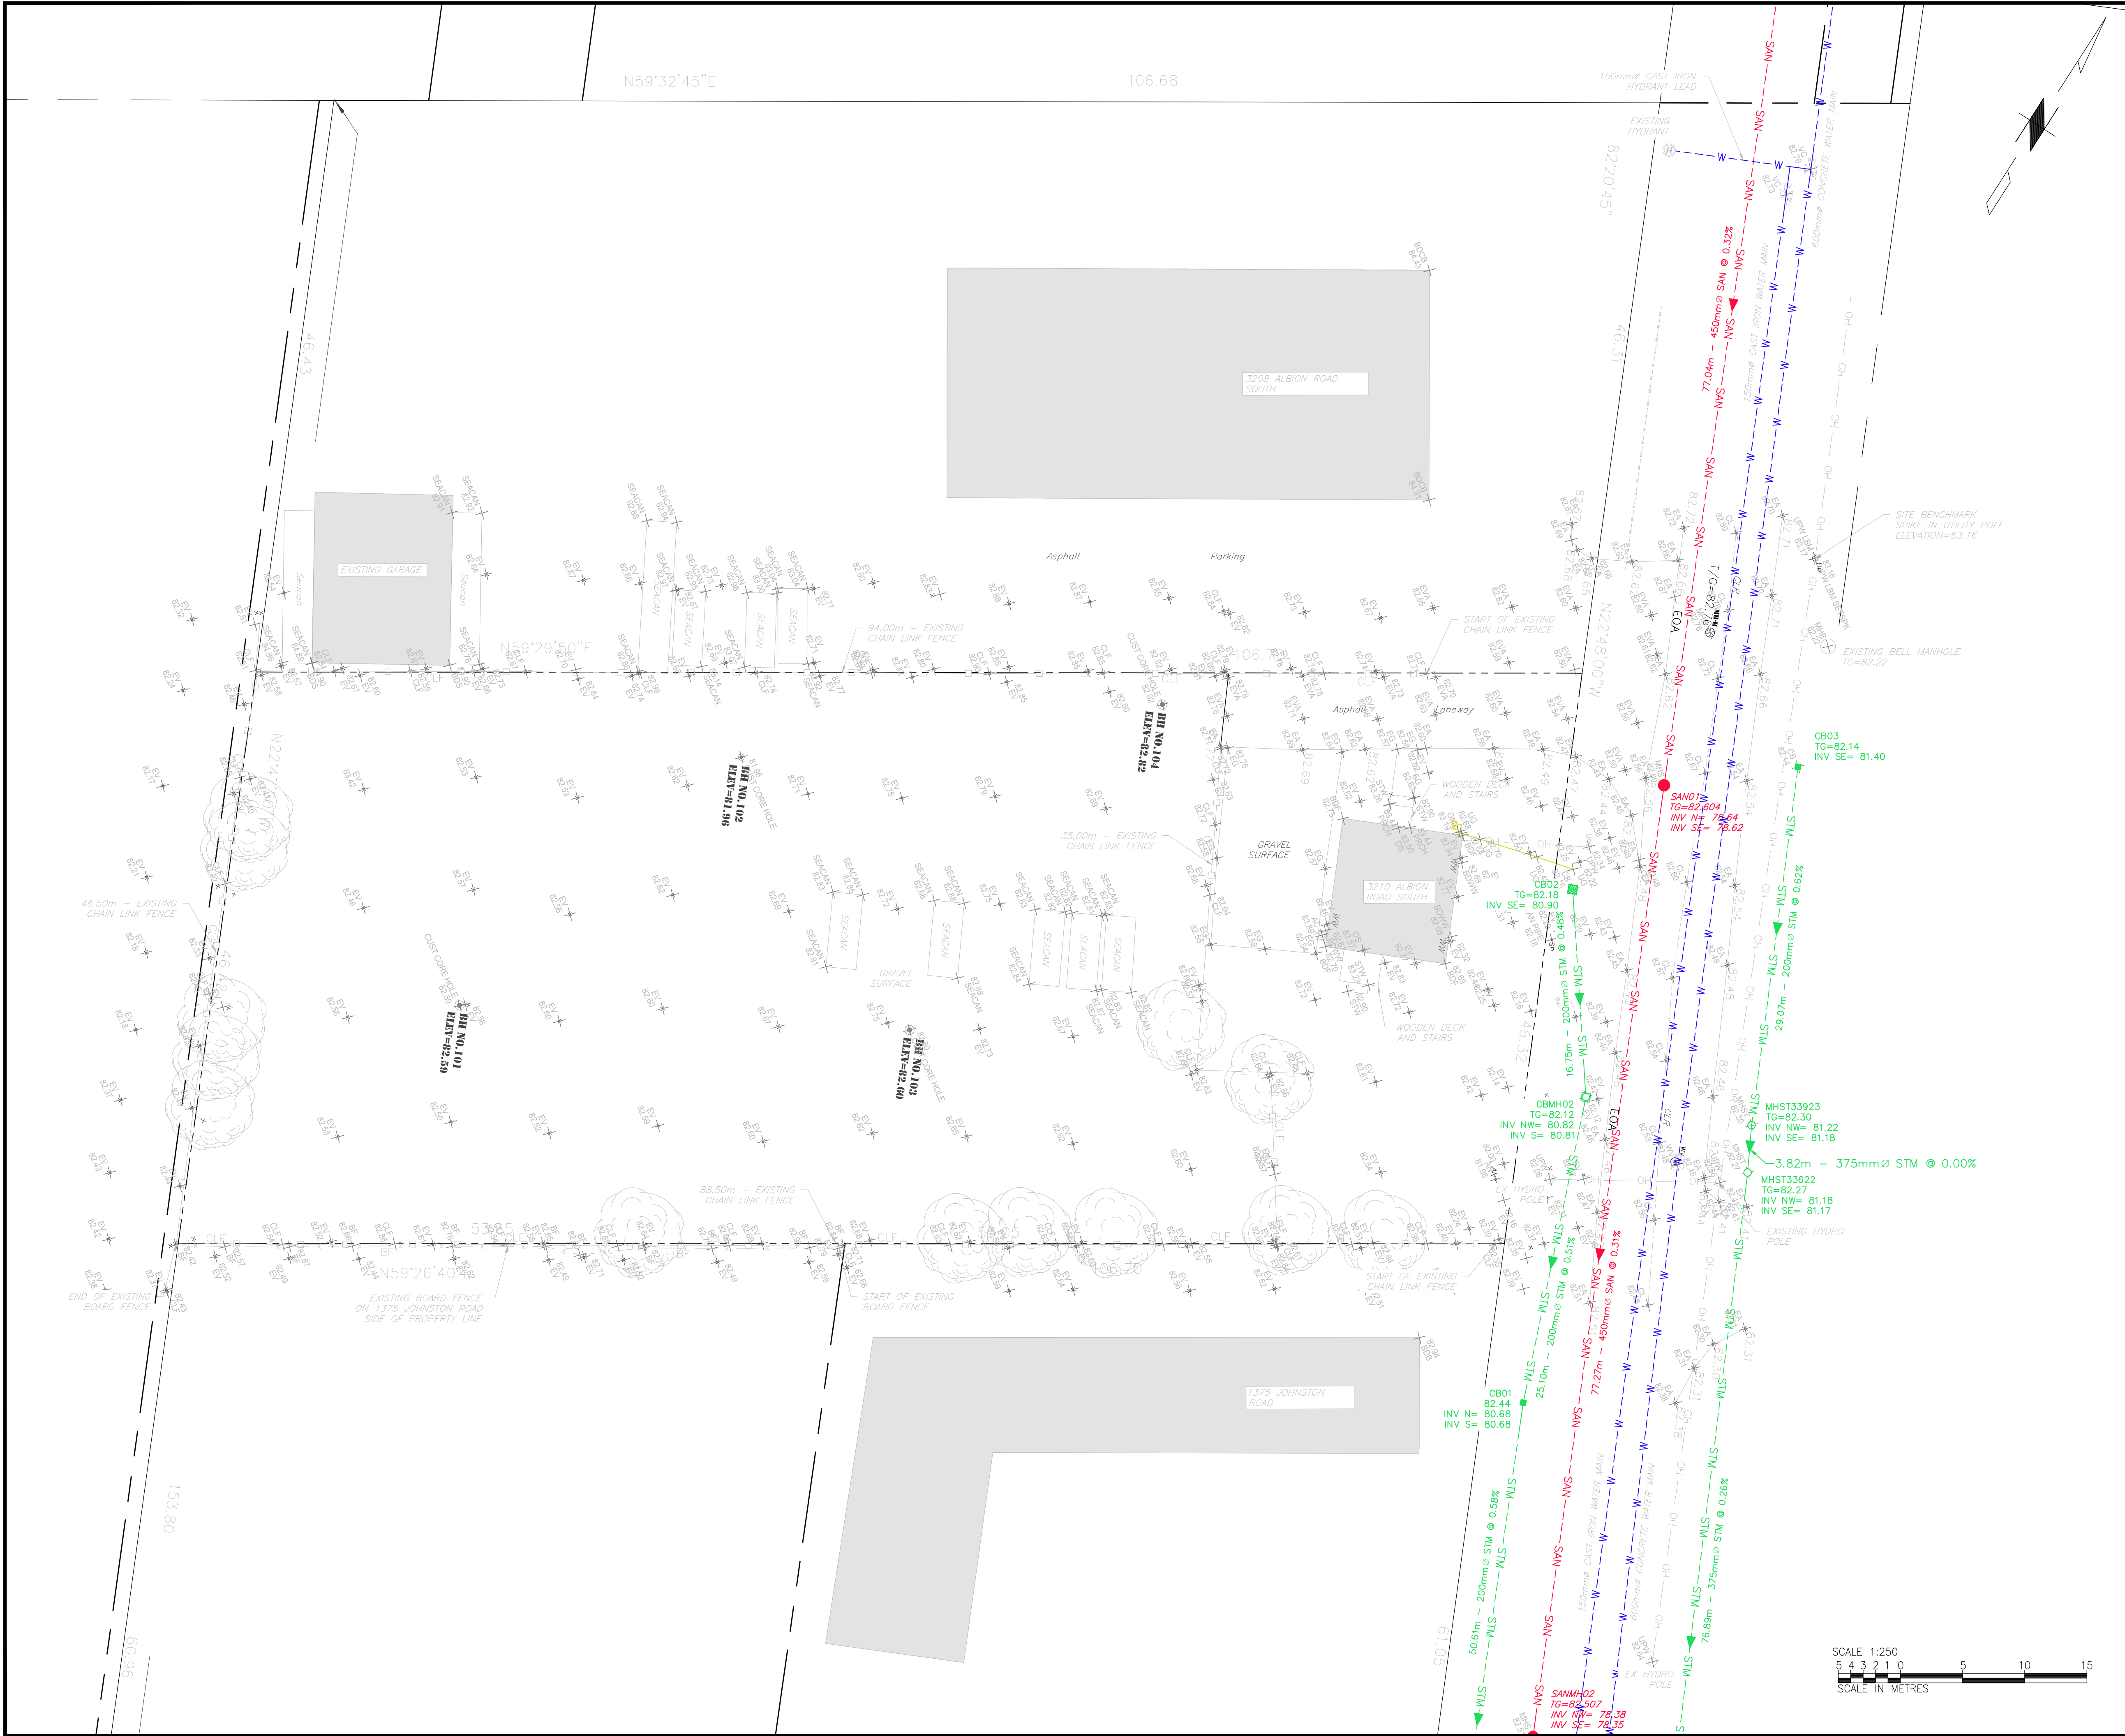


LEGEND:

---	PROPERTY LINE
CLF	EXISTING CHAIN LINK FENCE
BF	EXISTING BOARD FENCE
SAN	EXISTING SANITARY MANHOLE AND SEWER
STM	EXISTING STORM MANHOLE AND SEWER
W	EXISTING WATER MAIN
HYDRANT	EXISTING HYDRANT
CATCHBASIN	EXISTING CATCHBASIN MANHOLE
CATCHBASIN	EXISTING CATCHBASIN
EVA	EXISTING ELEVATION - MONUMENT URSO 2025 SURVEY
WV	EXISTING WATER MAIN VALVE

25/09/29	01	ISSUED FOR SPA	RV	AK
DATE	REV.	REVISIONS	BY	APP'D

ISSUED STATUS:		

DRAWN BY:	RV	2025/09/29
DESIGNED BY:	RV	2025/09/29
DRAWING CHECKED BY:	AK	2025/09/29
QC BY:	AK	2025/09/29
PM:	TR	2025/09/29

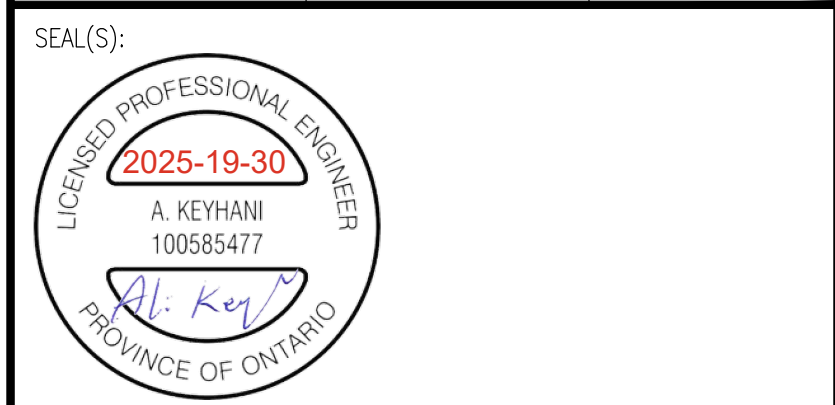

UNAUTHORIZED USE OF DATA, DISCLOSURE OF TECHNICAL INFORMATION CONTAINED HEREIN, OR REPRODUCTION OF THIS DOCUMENT IN WHOLE OR IN PART FOR USE BY THIRD PARTIES IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM EFI ENGINEERING INC.

EFI
ENGINEERING
ARCHITECTURE
PROCESS PROFESSIONALS

T: (613) 936-0148
engineer@efiengineering.com
www.efiengineering.com



CLIENT: ROOF MAINTENANCE SOLUTIONS (2317290 ONTARIO INC)

SITE: 3210 ALBION ROAD SOUTH, OTTAWA, ON

TITLE: EXISTING CONDITIONS PLAN

SCALE: 1:250 DATE: 2025/09/29

PROJECT NO: 7834	DRAWING NO: C100	REVISION: 1
---------------------	---------------------	----------------

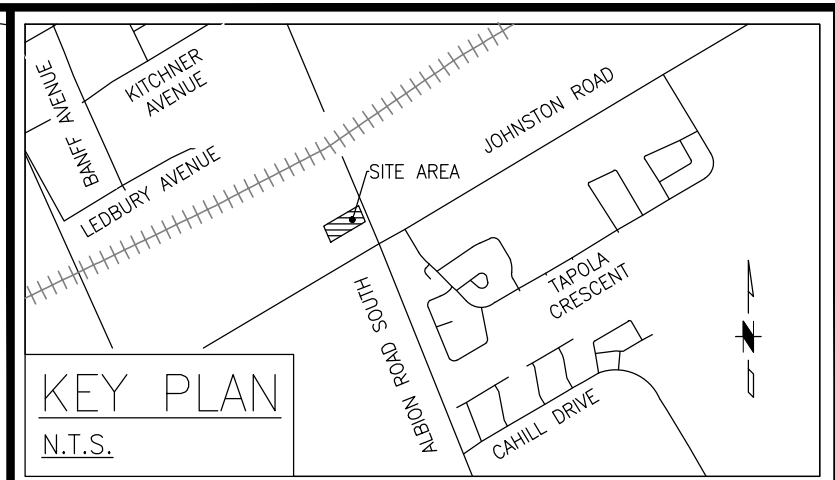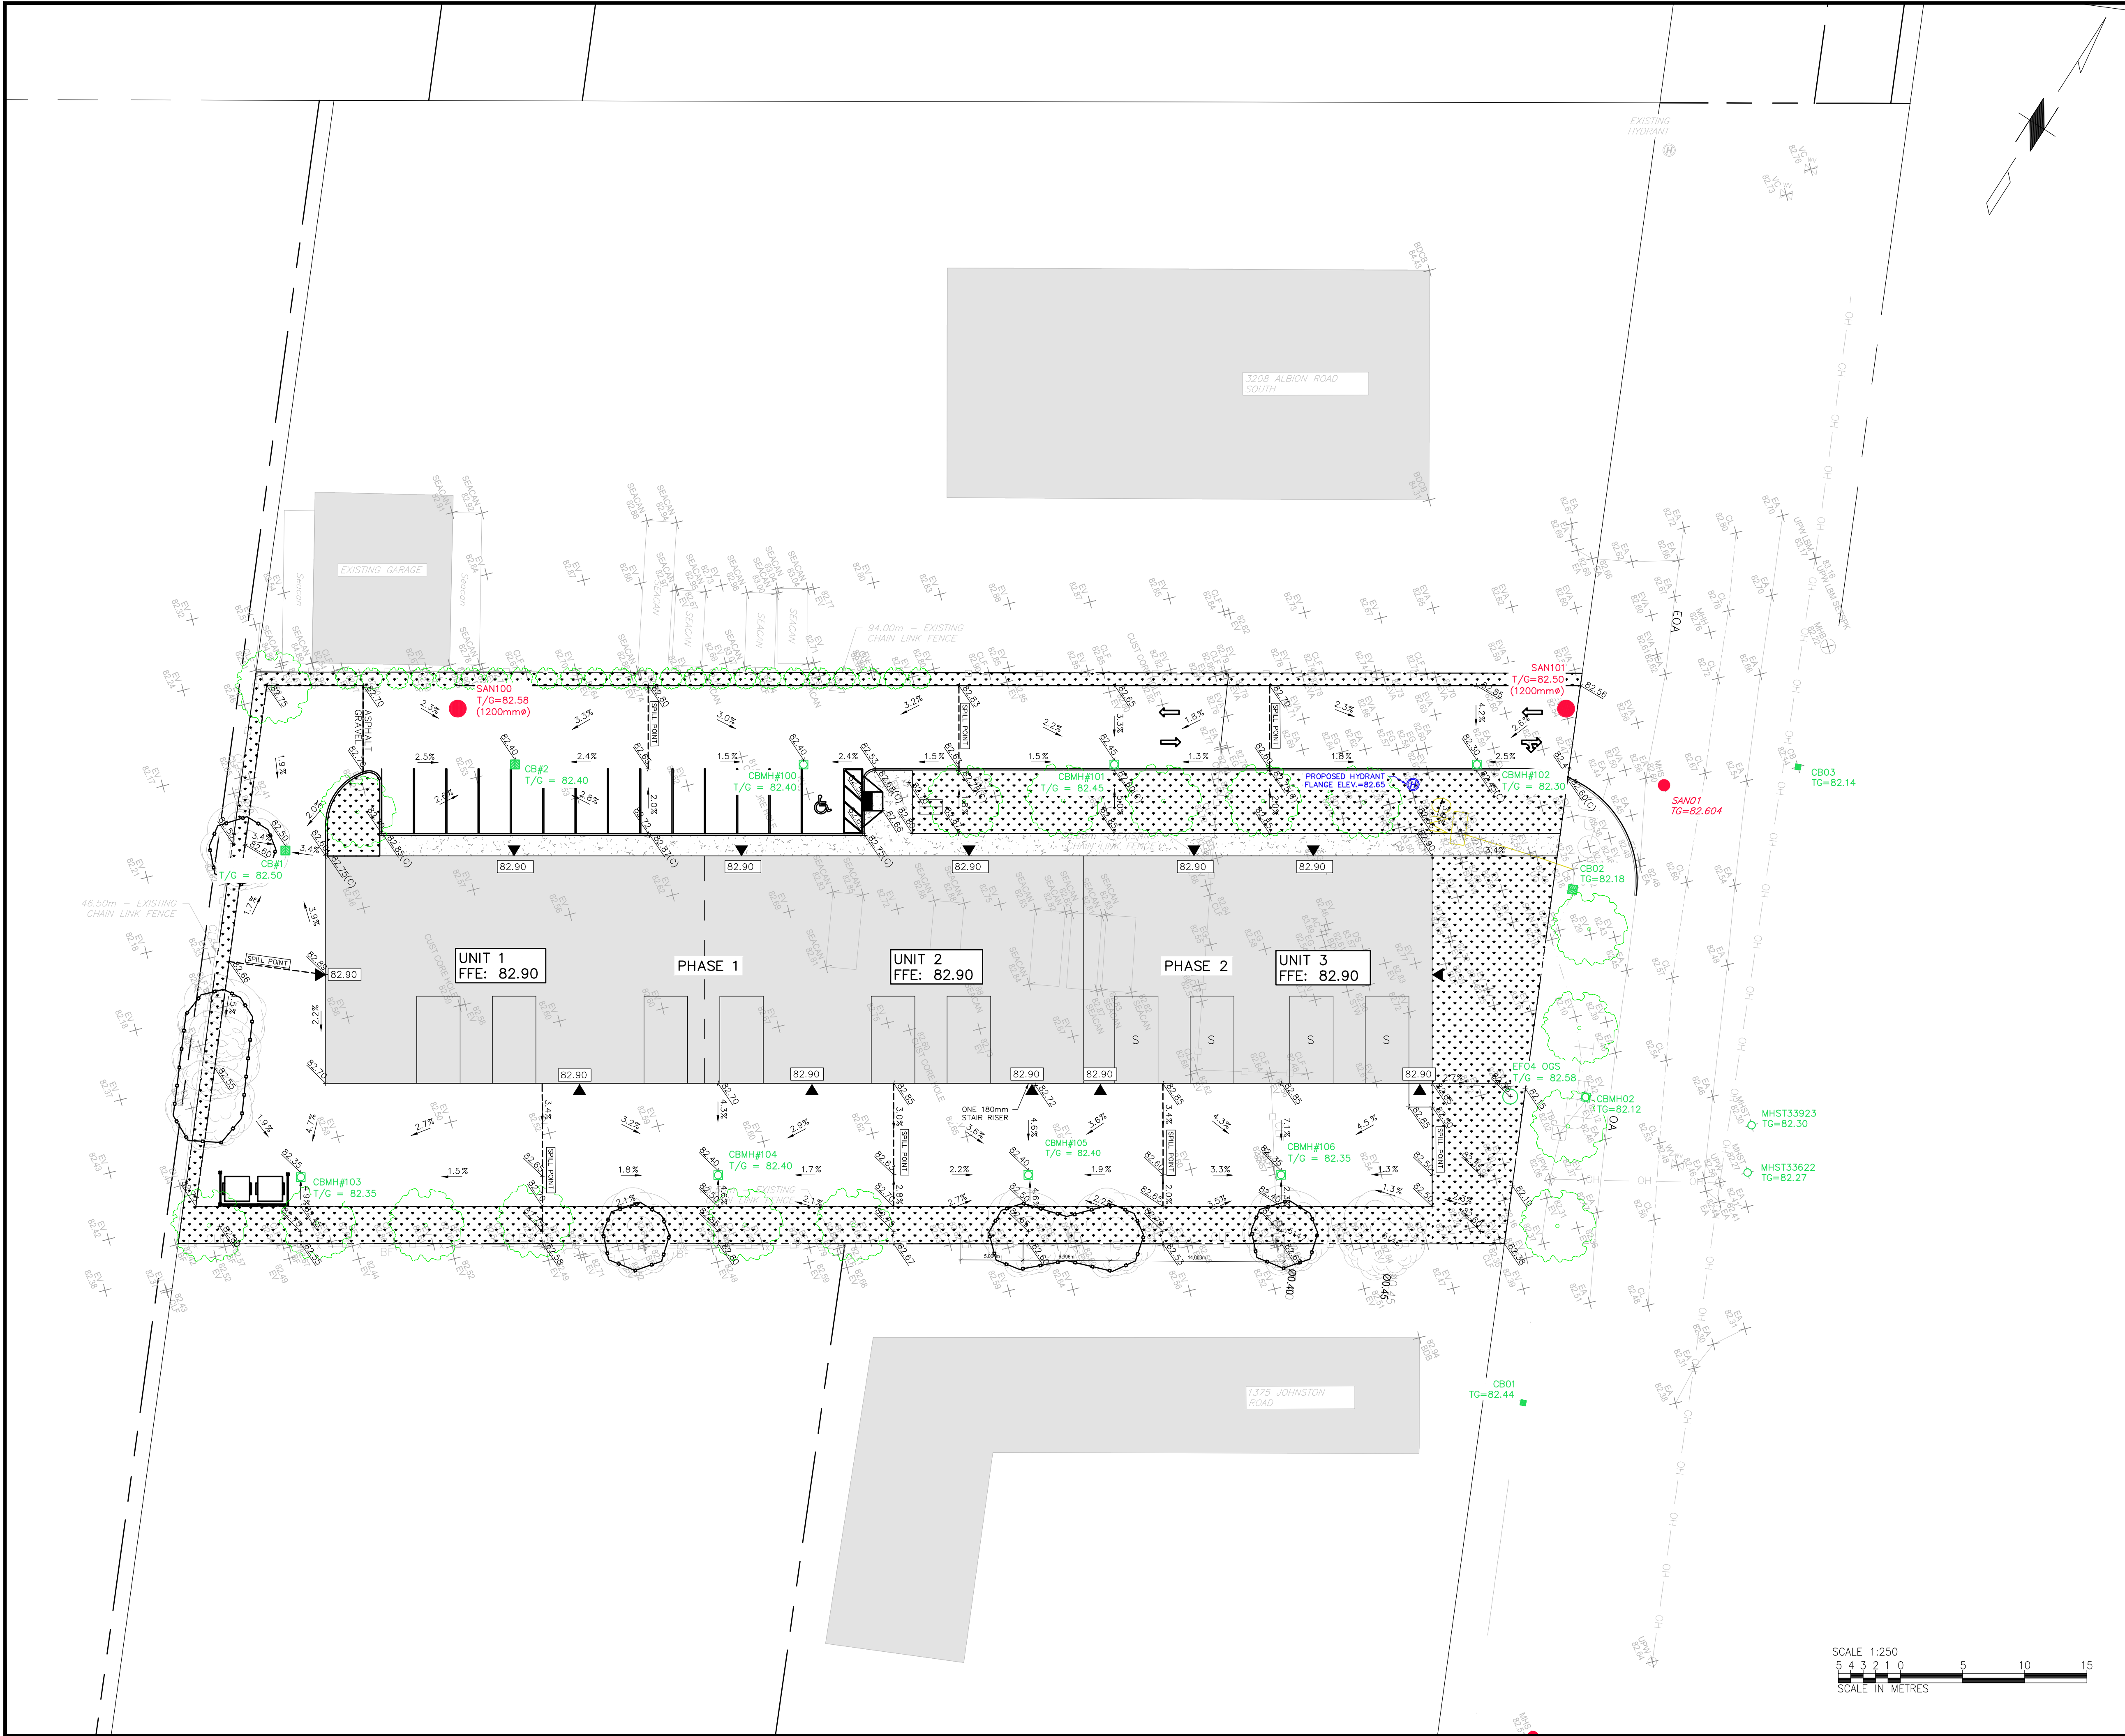

- LEGEND:**
- PROPERTY LINE
 - 125.92_x PROPOSED ELEVATION
 - 125.92_x PROPOSED CURB ELEVATION
 - EA 82.67 EXISTING ELEVATION
 - PROPOSED CATCH BASIN MANHOLE
 - PROPOSED CATCH BASIN
 - EXISTING CATCH BASIN MANHOLE
 - EXISTING CATCH BASIN
 - SANITARY MANHOLE
 - EXISTING TREE
 - PROPOSED TREE

25/09/29	01	ISSUED FOR SPA	RV	AK
DATE	REV.	REVISIONS	BY	APP'D
ISSUED STATUS: —				
DRAWN BY:		INITIALS:	YYYY/MM/DD	
DESIGNED BY:		RV	2025/09/29	
DRAWING CHECKED BY:		AK	2025/09/29	
QC BY:		AK	2025/09/29	
PM:		TR	2025/09/29	

SEAL(S):

LICENSED PROFESSIONAL ENGINEER

2025-10-30

A. KEYHANI

100585477

Al. Keyhani

PROVINCE OF ONTARIO

UNAUTHORIZED USE OF DATA, DISCLOSURE OF TECHNICAL INFORMATION CONTAINED HEREIN, OR REPRODUCTION OF THIS DOCUMENT IN WHOLE OR IN PART FOR USE BY THIRD PARTIES IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM EFI ENGINEERING INC.

EFI

ENGINEERING
ARCHITECTURE
PROCESS PROFESSIONALS

T: (613) 936-0148
engineer@efiengineering.com
www.efiengineering.com


CLIENT: ROOF MAINTENANCE SOLUTIONS
(2317290 ONTARIO INC)



SITE: 3210 ALBION ROAD SOUTH,
OTTAWA, ON

TITLE: GRADING PLAN

SCALE: 1:250 DATE: 2025/09/29

PROJECT NO: 7834	DRAWING NO: C104	REVISION: 1
---------------------	---------------------	----------------

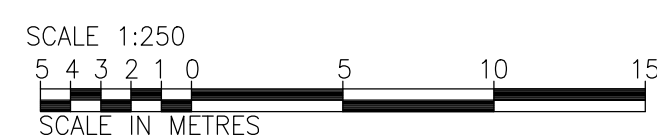

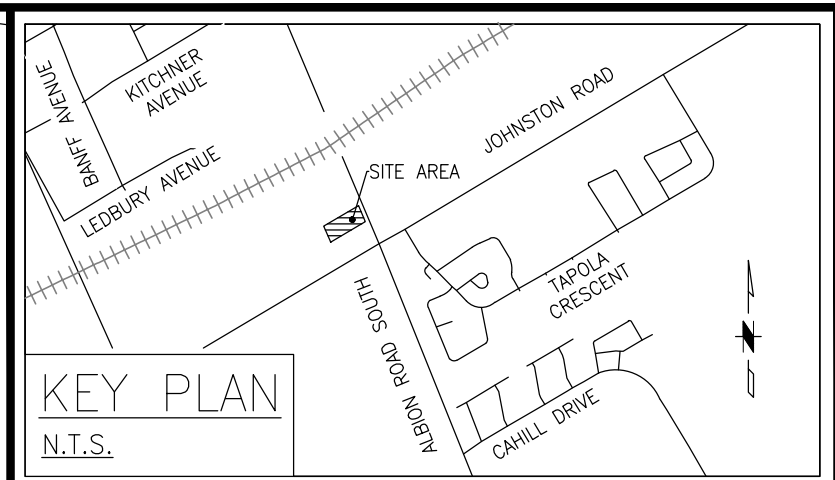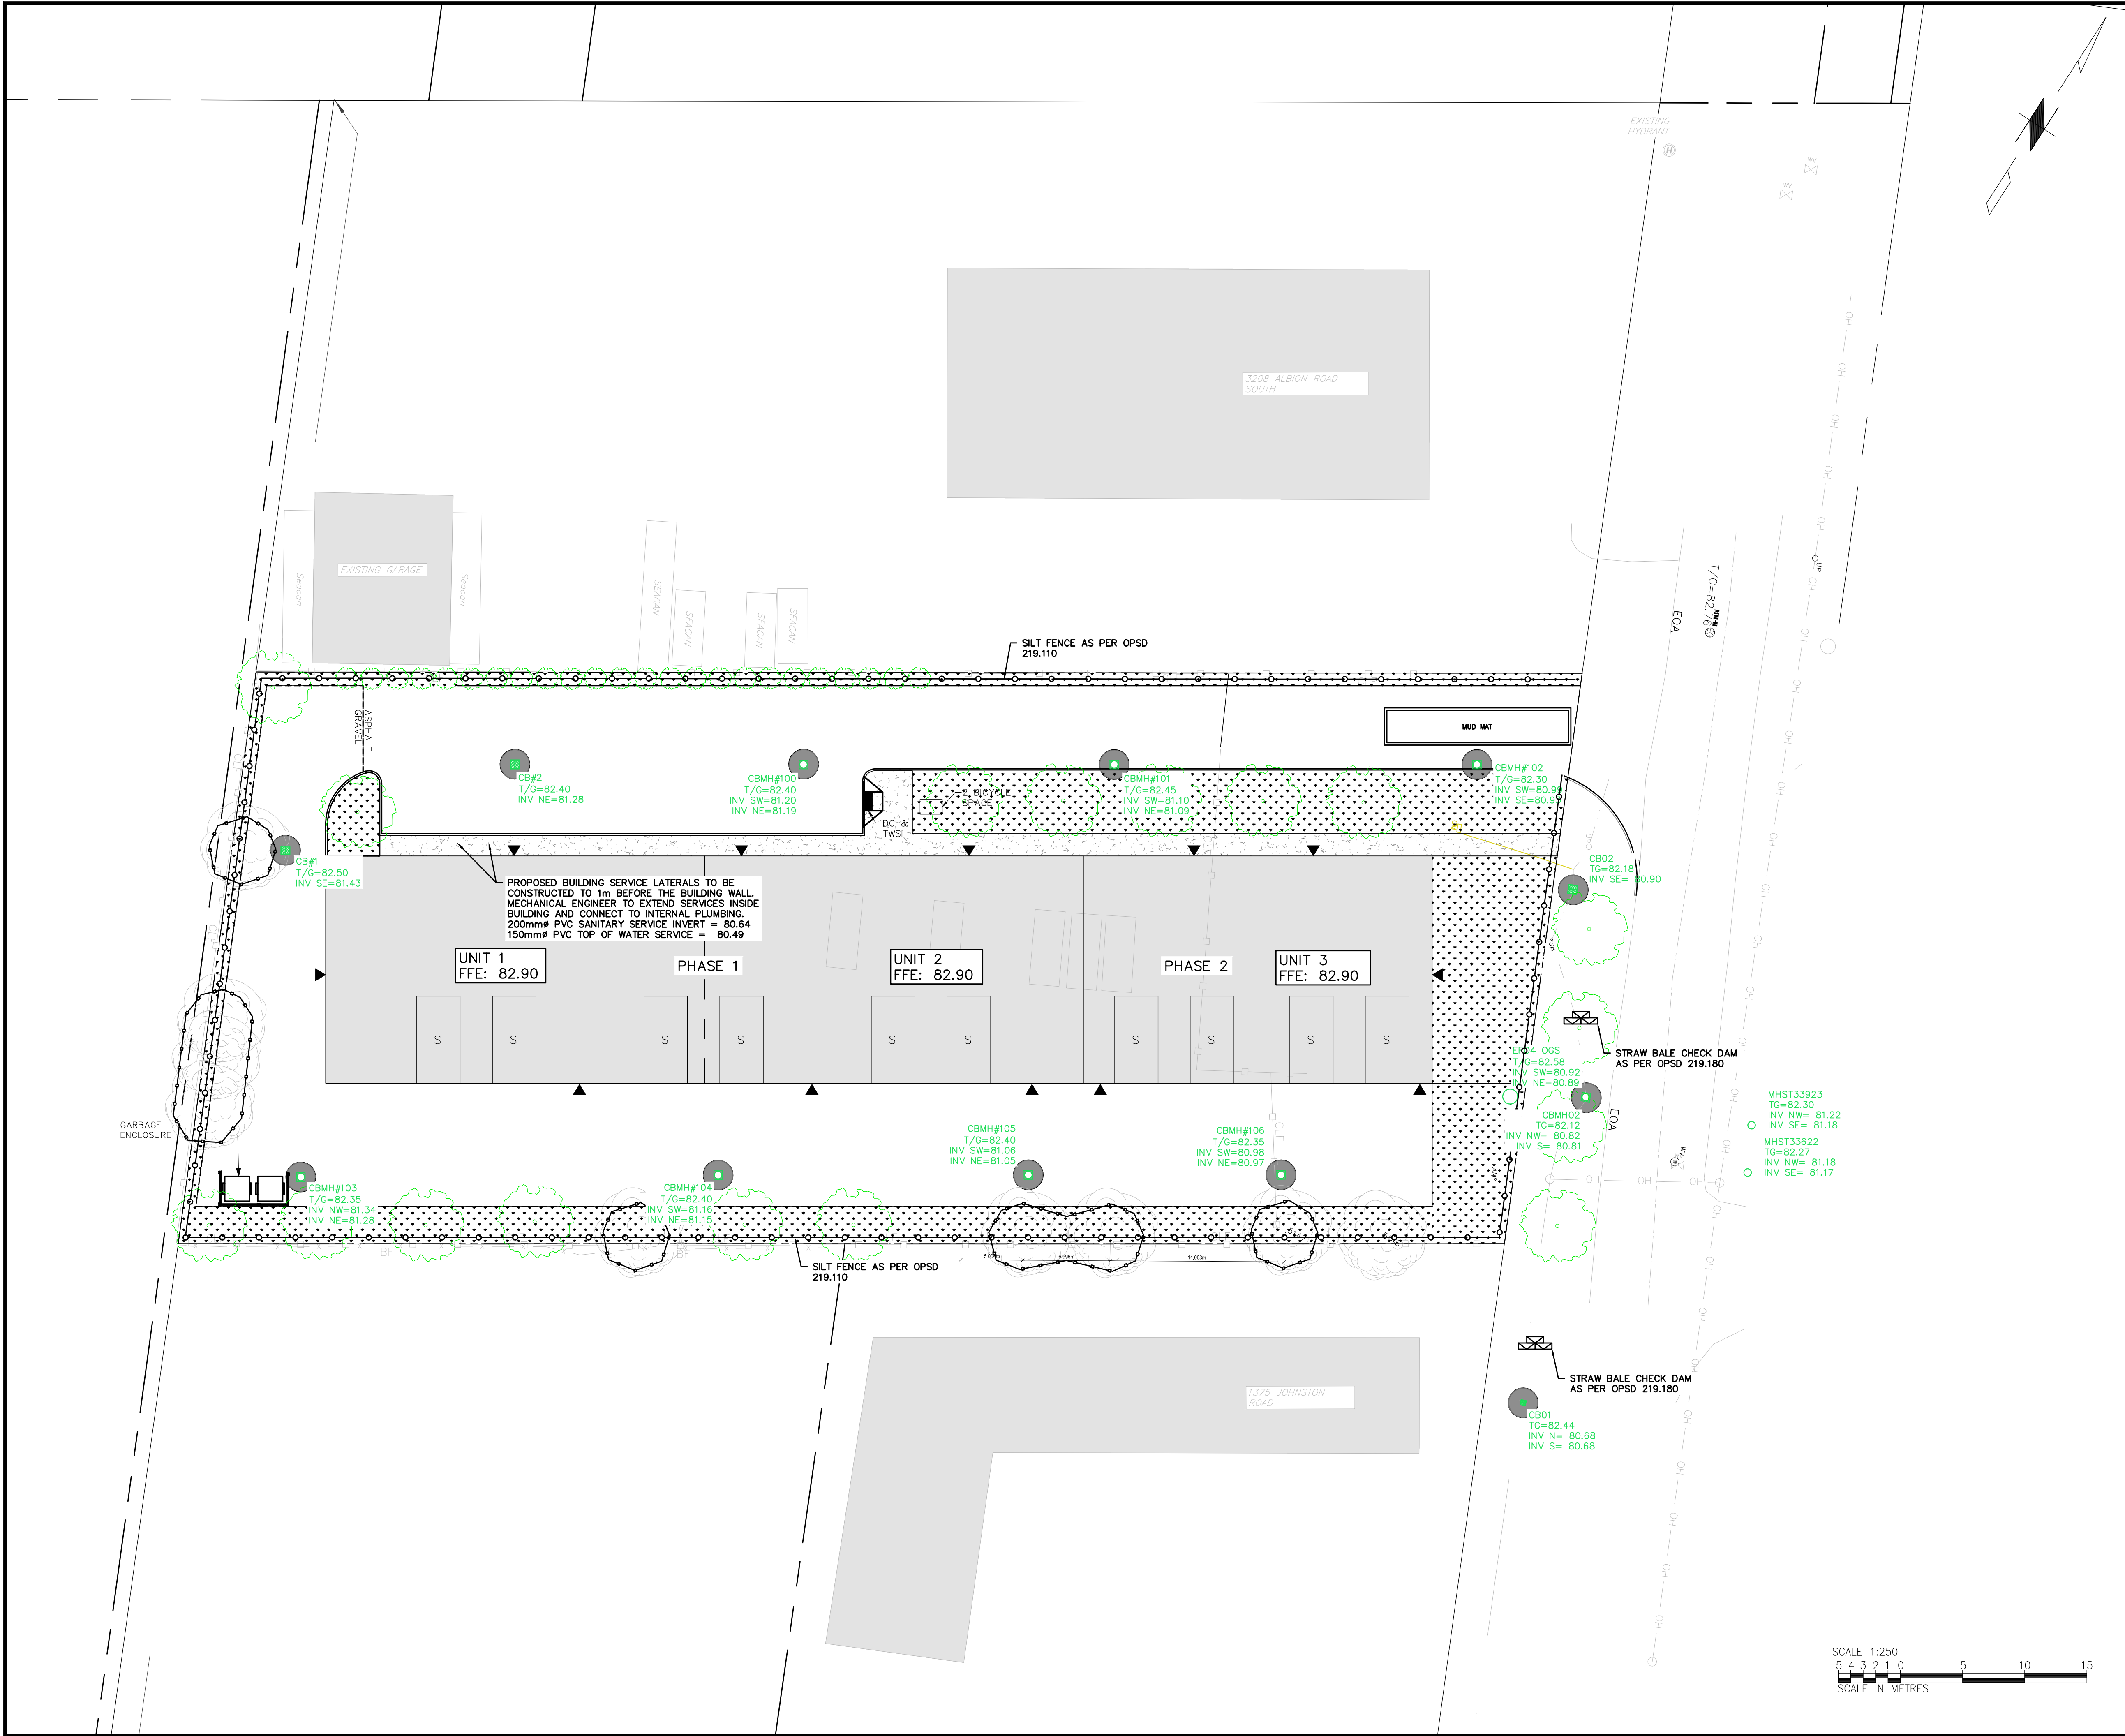

- LEGEND:**
- PROPERTY LINE
 - EXISTING CHAIN LINK FENCE
 - LIGHT DUTY SILT FENCE
 - PROPOSED MUD MAT
 - STRAW BALE, FLOW CHECK DAM, PER OPSD 219.180
 - PROPOSED SILTSACKS
 - PROPOSED CATCH BASIN
 - EXISTING CATCH BASIN
 - PROPOSED CATCH BASIN MANHOLE
 - EXISTING CATCH BASIN MANHOLE

25/09/29	01	ISSUED FOR SPA	RV	AK
----------	----	----------------	----	----

DATE	REV.	REVISIONS	BY	APP'D
------	------	-----------	----	-------

ISSUED STATUS: —

	INITIALS:	YYYY/MM/DD
DRAWN BY:	RV	2025/09/29
DESIGNED BY:	RV	2025/09/29
DRAWING CHECKED BY:	AK	2025/09/29
QC BY:	AK	2025/09/29
PM:	TR	2025/09/29



UNAUTHORIZED USE OF DATA, DISCLOSURE OF TECHNICAL INFORMATION CONTAINED HEREIN, OR REPRODUCTION OF THIS DOCUMENT IN WHOLE OR IN PART FOR USE BY THIRD PARTIES IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM EFI ENGINEERING INC.

EFI
ENGINEERING
ARCHITECTURE
PROCESS PROFESSIONALS

T: (613) 936-0148
engineer@efiengineering.com
www.efiengineering.com


CLIENT: ROOF MAINTENANCE SOLUTIONS
(2317290 ONTARIO INC)



SITE: 3210 ALBION ROAD SOUTH,
OTTAWA, ON

TITLE: SEDIMENT AND EROSION
CONTROL PLAN

SCALE: 1:250	DATE: 2025/09/29
--------------	------------------

PROJECT NO: 7834	DRAWING NO: C105	REVISION: 1
---------------------	---------------------	----------------

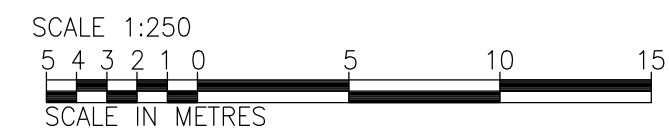

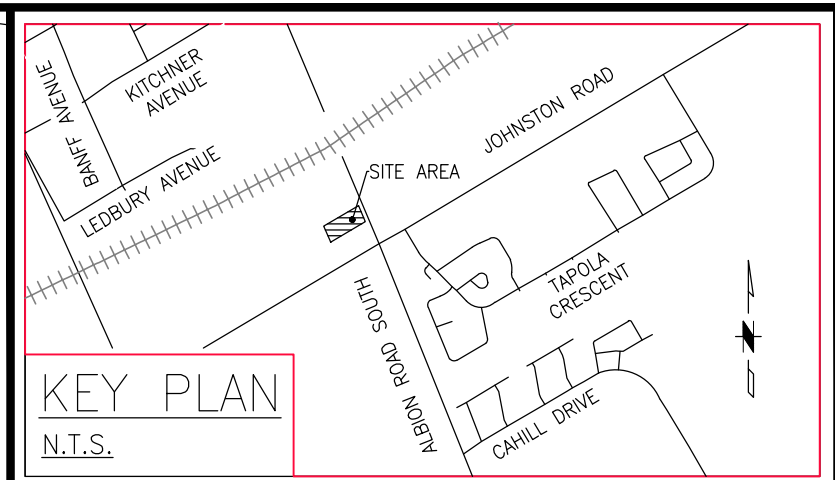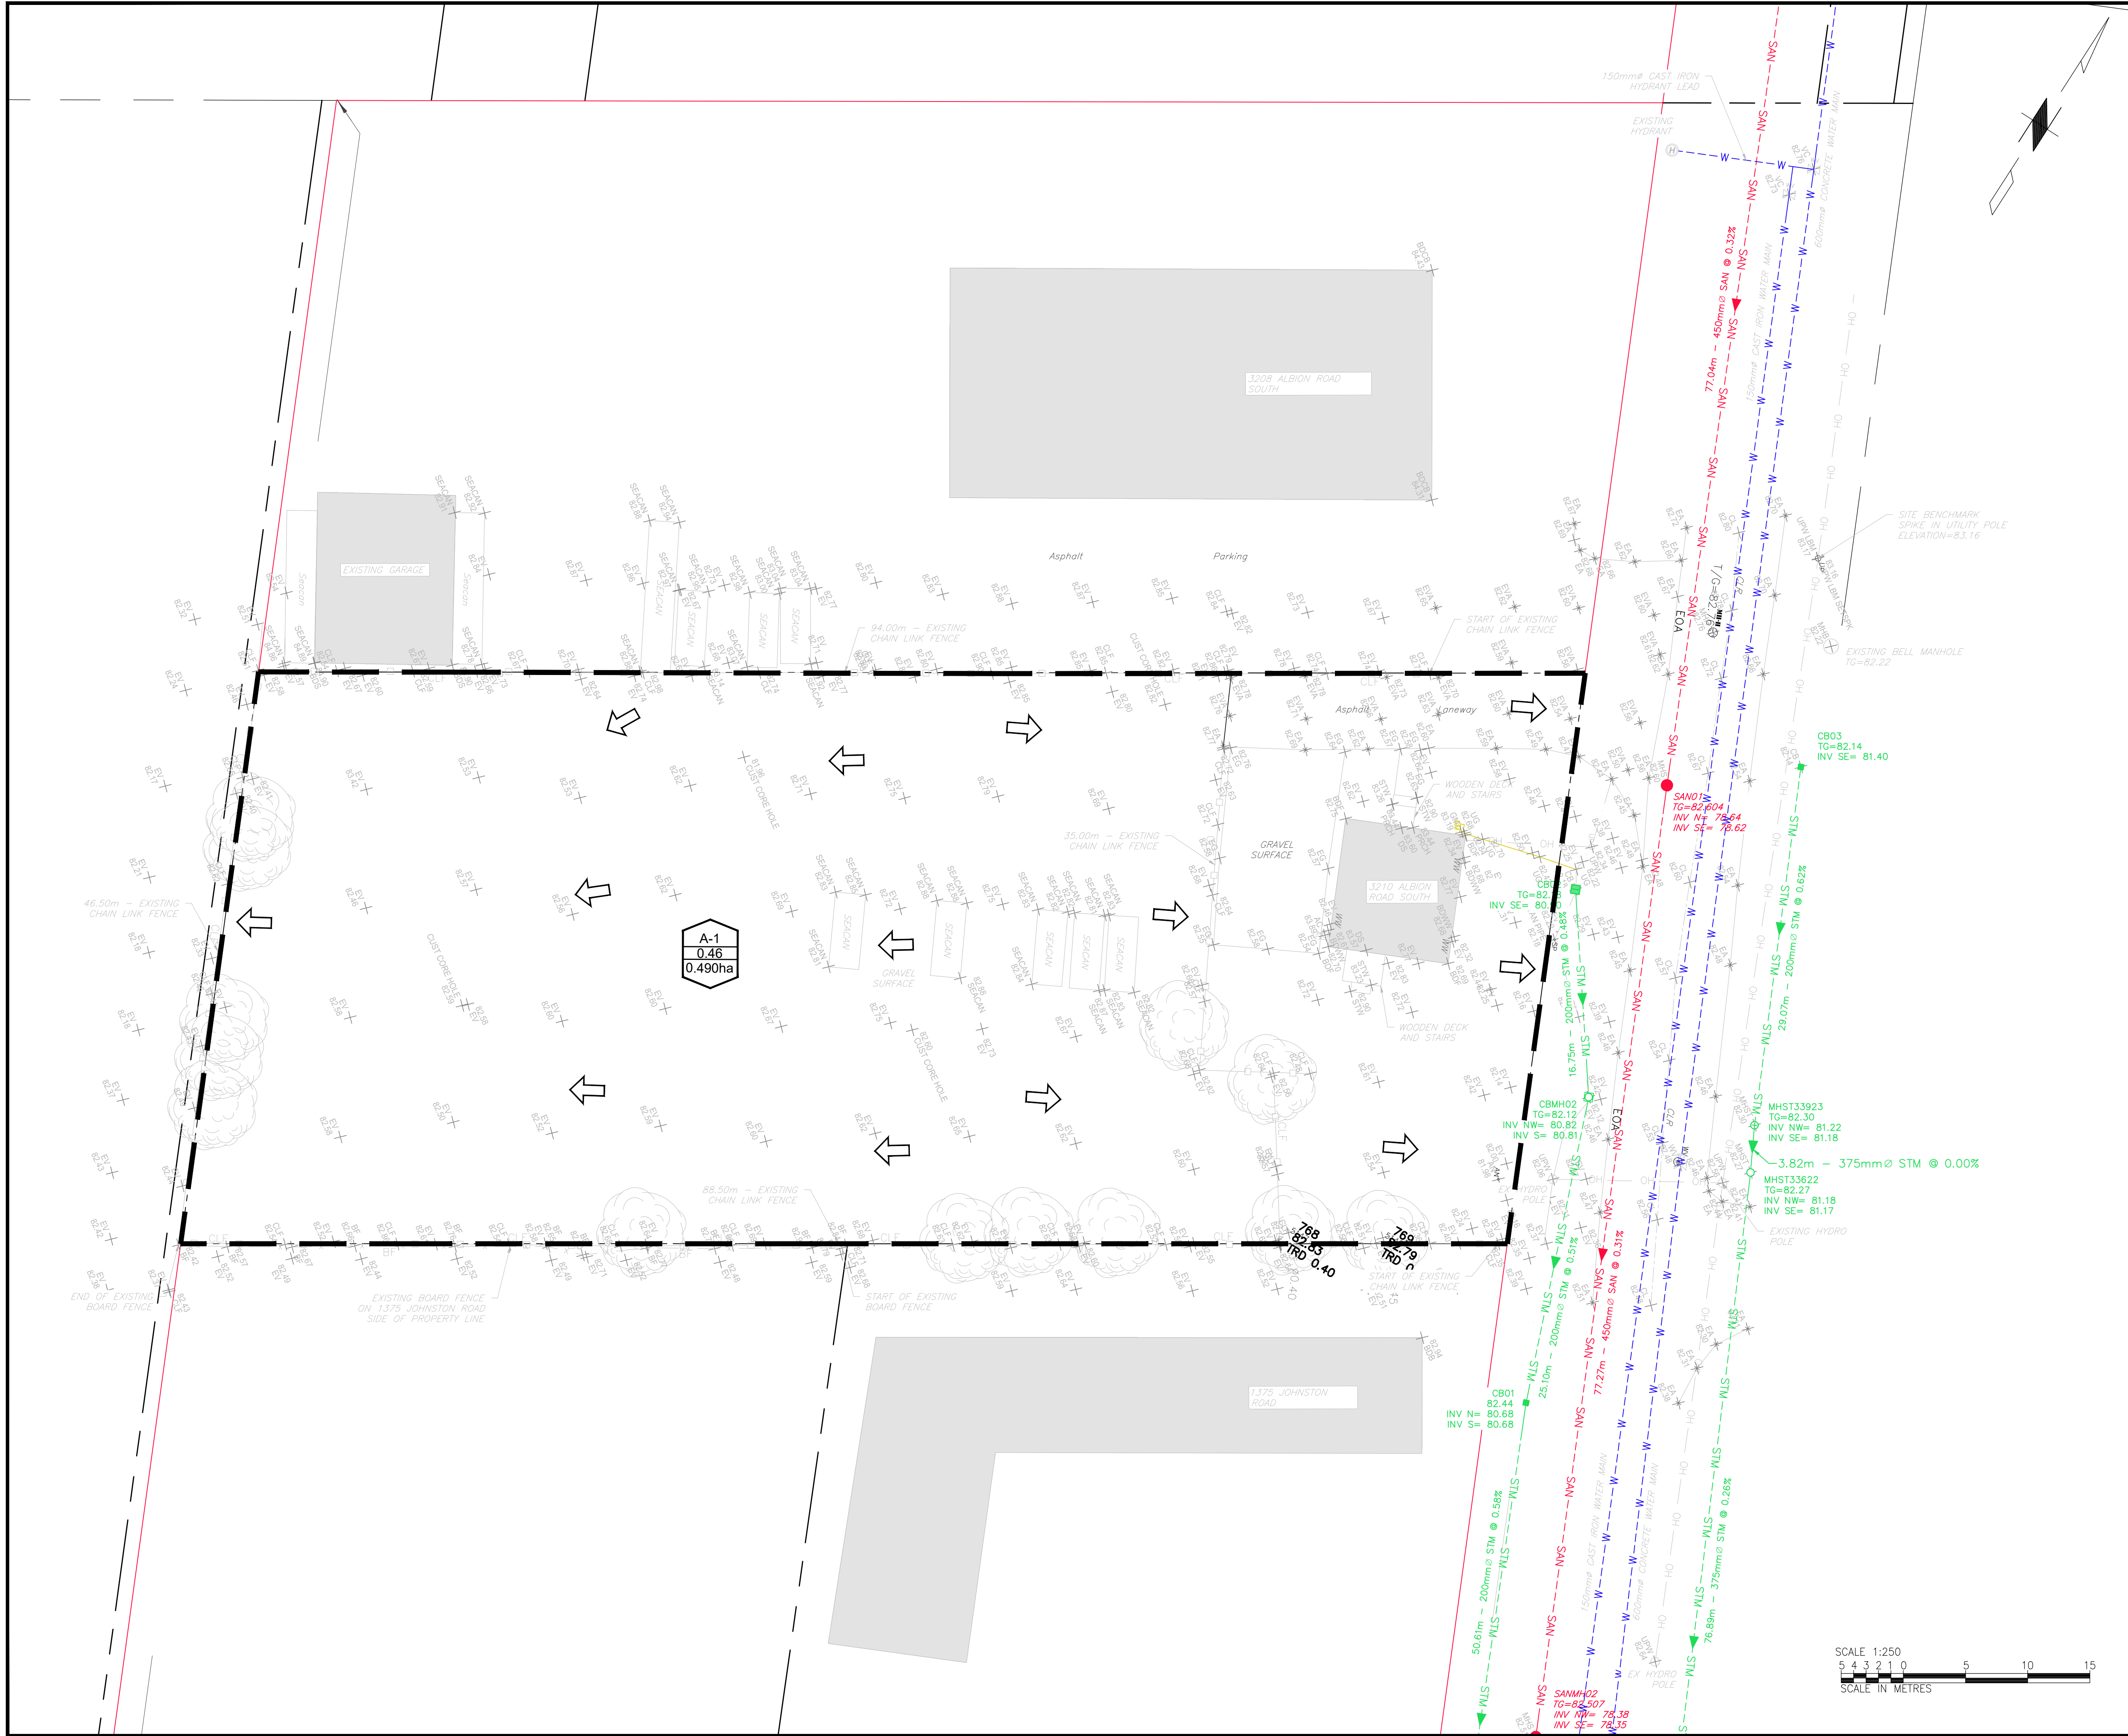

LEGEND:

- PROPERTY LINE
- CATCHMENT I.D.
0.27 RUNOFF COEFFICIENT
40.125ha AREA (ha)
- FLOW DIRECTION
- EXISTING STORM DRAINAGE AREA

25/09/29	01	ISSUED FOR SPA	RV	AK
----------	----	----------------	----	----

DATE	REV.	REVISIONS	BY	APP'D
------	------	-----------	----	-------

ISSUED STATUS: —

	INITIALS:	YYYY/MM/DD
DRAWN BY:	RV	2025/09/29
DESIGNED BY:	RV	2025/09/29
DRAWING CHECKED BY:	AK	2025/09/29
QC BY:	AK	2025/09/29
PM:	TR	2025/09/29

SEAL(S):

UNAUTHORIZED USE OF DATA, DISCLOSURE OF TECHNICAL INFORMATION CONTAINED HEREIN, OR REPRODUCTION OF THIS DOCUMENT IN WHOLE OR IN PART FOR USE BY THIRD PARTIES IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM EFI ENGINEERING INC.

EFI
ENGINEERING
ARCHITECTURE
PROCESS PROFESSIONALS

T: (613) 936-0148
engineer@efiengineering.com
www.efiengineering.com



CLIENT: ROOF MAINTENANCE SOLUTIONS
(2317290 ONTARIO INC)

SITE: 3210 ALBION ROAD SOUTH,
OTTAWA, ON

TITLE: PRE-DEVELOPMENT DRAINAGE
CONDITION PLAN

SCALE: 1:250	DATE: 2025/09/29
--------------	------------------

PROJECT NO: 7834	DRAWING NO: C106	REVISION: 1
---------------------	---------------------	----------------

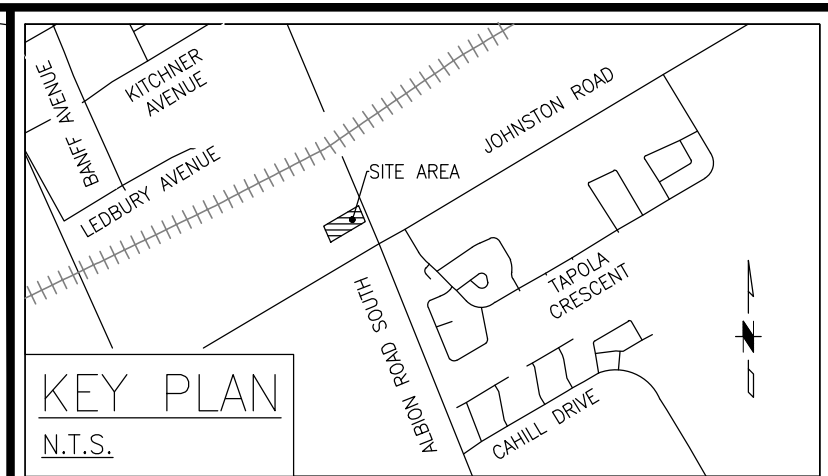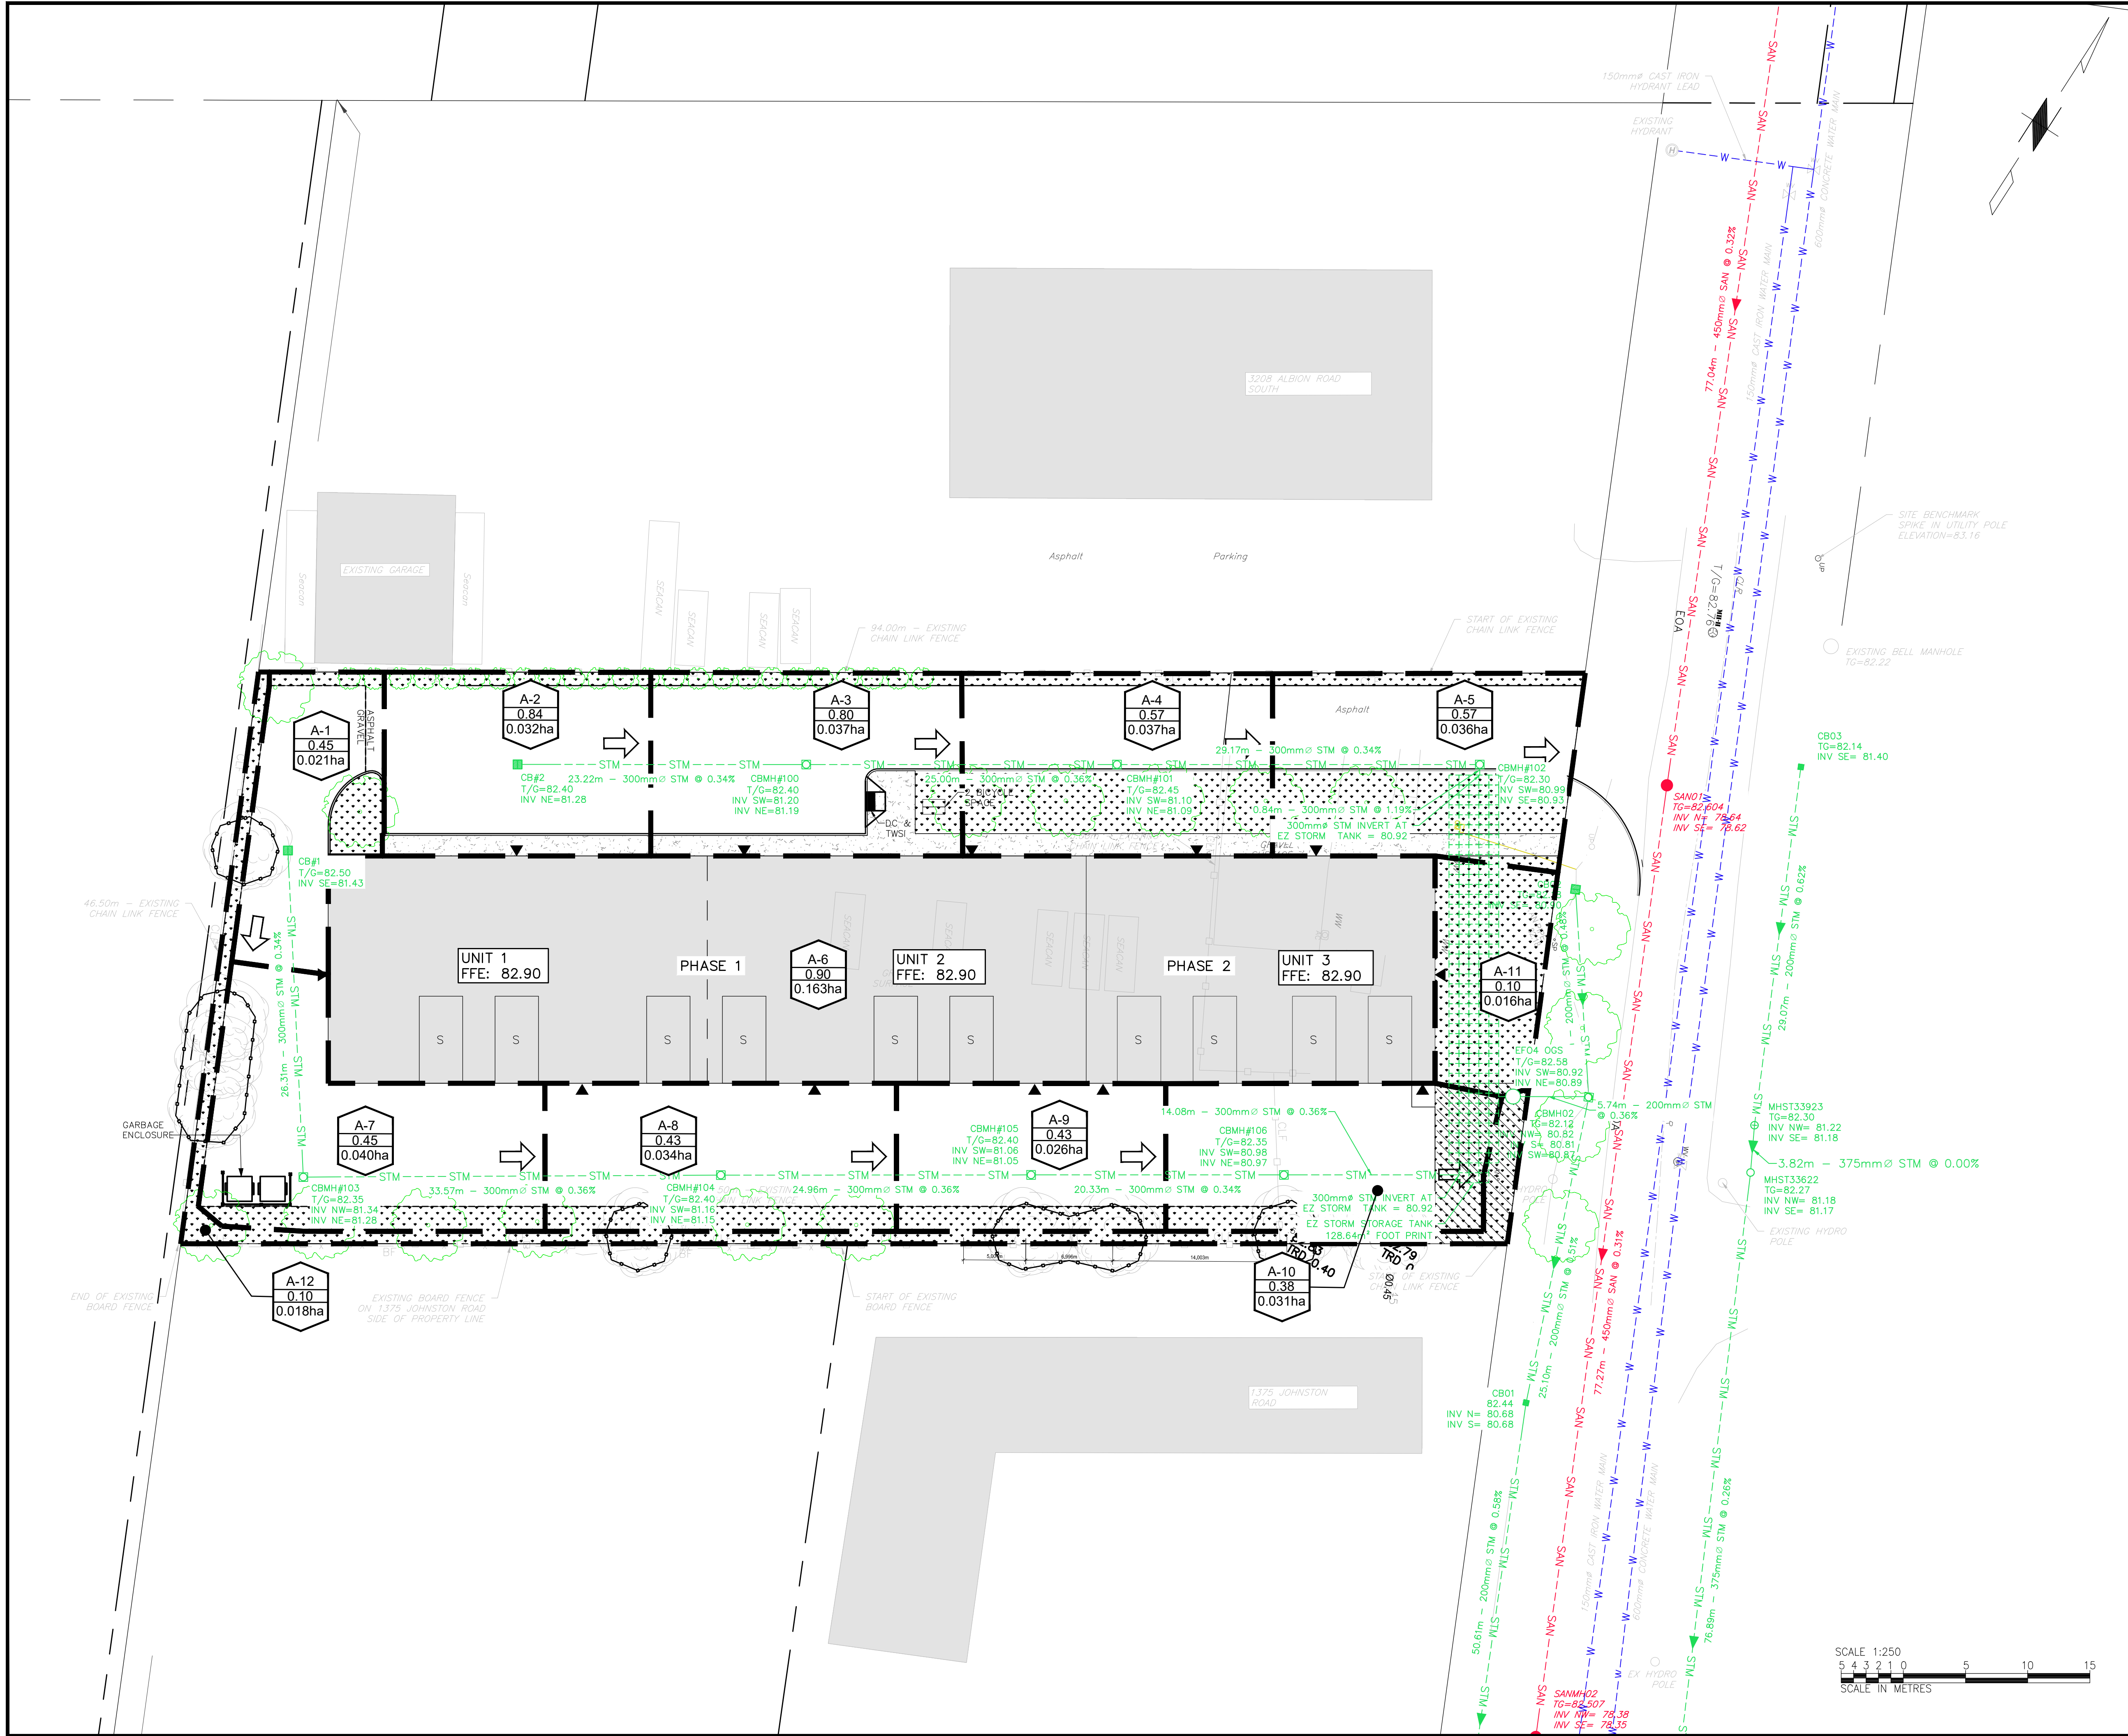

LEGEND:

- PROPERTY LINE
- CATCHMENT I.D.
RUNOFF COEFFICIENT
AREA (ha)
- FLOW DIRECTION
- STORM DRAINAGE AREA

25/09/29	01	ISSUED FOR SPA	RV	AK
----------	----	----------------	----	----

DATE	REV.	REVISIONS	BY	APP'D
------	------	-----------	----	-------

ISSUED STATUS: —

DRAWN BY:	INITIALS:	YYYY/MM/DD
DESIGNED BY:	RV	2025/09/29
DRAWING CHECKED BY:	AK	2025/09/29
QC BY:	AK	2025/09/29
PM:	TR	2025/09/29

SEAL(S):

UNAUTHORIZED USE OF DATA, DISCLOSURE OF TECHNICAL INFORMATION CONTAINED HEREIN, OR REPRODUCTION OF THIS DOCUMENT IN WHOLE OR IN PART FOR USE BY THIRD PARTIES IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM EFI ENGINEERING INC.

EFI
ENGINEERING
ARCHITECTURE
PROCESS PROFESSIONALS

T: (613) 936-0148
engineer@efiengineering.com
www.efiengineering.com

CLIENT: ROOF MAINTENANCE SOLUTIONS
(2317290 ONTARIO INC)

SITE: 3210 ALBION ROAD SOUTH,
OTTAWA, ON

TITLE: POST-DEVELOPMENT DRAINAGE
CONDITION PLAN

SCALE: 1:250	DATE: 2025/09/29
--------------	------------------

PROJECT NO: 7834	DRAWING NO: C107	REVISION: 1
---------------------	---------------------	----------------

NOTES:

- ALL WORK ON THIS PROJECT SHALL CONFORM TO THE 2024 ONTARIO BUILDING CODE (OBC), ANY LOCAL REGULATIONS AND BYLAWS, AND THE OCCUPATIONAL HEALTH AND SAFETY ACT (OHS) FOR CONSTRUCTION PROJECTS (LATEST VERSION). ALL APPLICABLE CODES AND STANDARDS SHALL BE THOSE REFERENCED IN OBC 2024.
- READ THESE DRAWINGS IN CONJUNCTION WITH ALL REFERENCE DRAWINGS LISTED.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL CONTRACT DOCUMENTS.
- THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS, UTILITIES & MEASUREMENTS AT THE SITE BEFORE THE START OF CONSTRUCTION. CONTRACTOR TO INFORM THE ENGINEER OF ANY DIFFERING SITE CONDITIONS & ANY DISCREPANCIES OR UNSATISFACTORY CONDITIONS WHICH MAY ADVERSELY AFFECT THE PROPER COMPLETION OF THE PROJECT BEFORE PROCEEDING WITH THE WORK.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY ALL EXISTING UTILITY LOCATIONS PRIOR TO THE COMMENCEMENT OF WORK AND TO PROVIDE ADEQUATE PROTECTION OF THESE UTILITIES FROM DAMAGE DURING CONSTRUCTION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO RESTORE ALL DISTURBED AREAS ON OR OFF SITE TO ORIGINAL CONDITION OR BETTER.
- THE CONTRACTOR SHALL PROTECT OWNER'S BUILDING AND EQUIPMENT DURING THE CONSTRUCTION PROCESS & REPLACE ANY DAMAGED ITEMS.
- THE CONTRACTOR SHALL MAKE ADEQUATE PROVISION FOR CONSTRUCTION LOADS AND TEMPORARY BRACING TO KEEP STRUCTURE PLUMB AND IN TRUE ALIGNMENT AT ALL PHASES OF CONSTRUCTION. ANY BRACING MEMBERS SHOWN ON THE DRAWINGS ARE REQUIRED FOR THE FINISHED STRUCTURE AND MAY NOT BE SUFFICIENT FOR ERECTION PURPOSES.
- THE CONTRACTOR SHALL SUPPLY ALL MATERIALS AS SPECIFIED ON THE CONTRACT DRAWINGS. ALL MATERIALS SUPPLIED SHALL BE NEW.
- THE CONTRACTOR SHALL MAINTAIN PROPER EXITING FREE OF CONSTRUCTION DEBRIS AND KEEP FIRE EXTINGUISHERS ON SITE AT ALL TIMES DURING CONSTRUCTION.
- THE CONTRACTOR SHALL ASSUME COMPLETE RESPONSIBILITY FOR FULL SUPERVISION OF CONSTRUCTION WORK. SITE VISITS AND REVIEW BY DESIGN ENGINEER OR THEIR REPRESENTATIVE ARE INTENDED FOR THE SOLE PURPOSE OF ASCERTAINING CONFORMANCE WITH THE GENERAL DESIGN CONCEPT. THEIR REVIEW SHALL NOT MEAN THAT THE ENGINEER HAS SEEN ALL CONSTRUCTION PROCEDURES, RESPONSIBILITY FOR WHICH SHALL REMAIN WITH THE CONTRACTOR PERFORMING THE WORK. REVIEW BY THE ENGINEER SHALL NOT RELIEVE THE CONTRACTOR OF THEIR RESPONSIBILITY OF ERRORS AND OMISSIONS AND FOR MEETING ALL THE REQUIREMENTS OF THE CONSTRUCTION DOCUMENTS.
- ALL WORKMANSHIP IS TO BE OF A STANDARD, EQUAL IN ALL RESPECTS TO GOOD BUILDING PRACTICE.
- ALL DIMENSIONS ARE IN METERS UNLESS NOTED OTHERWISE AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048.
- SURVEY DATA TAKEN FROM "TOPOGRAPHIC PLAN OF SURVEY OF PART OF LOT 3 – CONCESSION 3 (RIDEAU FRONT) – GEOGRAPHIC TOWNSHIP OF GLOUCESTER – CITY OF OTTAWA", MONUMENT – URSO SURVEYING LTD.
- ALL WORK INVOLVED IN THE CONSTRUCTION, RELOCATION, REPAIR OF MUNICIPAL SERVICES FOR THE PROJECT SHALL BE TO THE SATISFACTION OF THE PLANNING AND BUILDING DEPARTMENTS AT THE CITY OF OTTAWA.
- THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE OWNER'S BONDED CONTRACTOR FROM THE REQUIREMENTS TO OBTAIN THE VARIOUS PERMITS/APPROVALS NORMALLY REQUIRED TO COMPLETE A CONSTRUCTION PROJECT, SUCH AS, BUT NOT LIMITED TO THE FOLLOWING:
 - BUILDING PERMIT
 - SEWER AND WATER PERMITS
 - ROAD CUT PERMITS
 - RELOCATION OF SERVICES
 - APPROACH APPROVAL PERMITS
 - ENCROACHMENT AGREEMENTS (IF REQUIRED)
 - COMMITTEE OF ADJUSTMENT
- IF ASBESTOS OR ANY TOXIC WASTE MATERIALS ARE FOUND, THE CONTRACTOR WILL EXCAVATE AND DISPOSE OF THEM PER LOCAL REGULATIONS AND BY-LAWS.

SANITARY/STORM SEWERS, SERVICES, & MAINTENANCE HOLES

- THE CONSTRUCTION OF SANITARY SEWERS SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA SEWER DESIGN GUIDELINES (2012) SECTIONS 4, 5, AND 6.
- THE CONSTRUCTION OF STORM SEWERS & PRIVATE DRAINS SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA SEWER DESIGN GUIDELINES (2012) SECTIONS 5 AND 6.
- COVER AND BEDDING MATERIAL FOR THE PROPOSED SEWER SHALL BE IN ACCORDANCE WITH THE FOLLOWING RECOMMENDATIONS PROVIDED IN THE "GEOTECHNICAL INVESTIGATION REPORT – 3210 ALBION ROAD SOUTH (22599-001)" BY CAMBIUM INC.:
 - THE BEDDING AND COVER MATERIAL FOR FLEXIBLE PIPE MATERIALS SHOULD CONFORM TO OPSD 802.010 AND 802.013.
 - THE BEDDING AND COVER MATERIAL FOR RIGID PIPE MATERIALS SHOULD CONFORM TO OPSD 802.031 AND 802.033.
 - THE PIPE BEDDING SHOULD CONSIST OF 200mm OF OPSS,MUNI 1010 GRANULAR A WRAPPED BY A GEO-TEXTILE (TERRAFIX 270R OR AN APPROVED EQUIVALENT).
 - THE BEDDING AND COVER MATERIAL SHALL BE PLACED IN MAXIMUM 200mm THICK LIFTS AND SHOULD BE COMPACTED TO AT LEAST 95% SPMD0.
 - THE COVER MATERIAL SHALL EXTEND A MINIMUM OF 300mm ABOVE THE TOP OF THE PIPE AND BE COMPACTED TO A MINIMUM OF 95% OF SPMD0.
 - THE USE OF CLEAR STONE AS PIPE BEDDING AND COVER MATERIAL SHOULD NOT BE PERMITTED.
 - ALL SEWERS TO BE FLUSHED PRIOR TO VIDEO INSPECTION.
 - MAINTENANCE HOLE FRAMES AND COVERS SHALL BE AS SPECIFIED ON THE STRUCTURES TABLE ON THE EPI SERVICING PLAN (7834-1103) FOR THIS DEVELOPMENT.
 - SANITARY AND STORM SEWERS SHALL BE PVC PIPE, CSA B182.2. SDR-35.
 - MINIMUM COVER OVER STORM SEWERS SHALL BE 2.1.

WATERMANS AND SERVICES

- CONSTRUCTION OF WATERMANS & PRIVATE SERVICES SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA WATER DISTRIBUTION DESIGN GUIDELINES – JULY 2010 AND THE SUBSEQUENT TECHNICAL BULLETINS.
- THE MINIMUM DEPTH OF COVER FOR WATERMAIN SHALL BE 2.4m.
- WATERMAIN AND SERVICE PIPE IN SIZES 100–400mm SHALL BE PVC DR18 CONFORMING TO AWWA C900.
- PVC WATER PIPE, FITTINGS AND SOLVENT CEMENT SHALL BE CERTIFIED TO CAN/CSA-B137.3, "RIGID POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS FOR PRESSURE APPLICATIONS" OR CAN/CSA-B137.2, "POLYVINYL CHLORIDE (PVC) INJECTION-MOULDED GASKETED FITTINGS FOR PRESSURE APPLICATIONS", AND HAVE A MINIMUM PRESSURE RATING OF 1100 kPa. PVC WATER PIPE AND FITTINGS SHALL NOT BE USED IN A HOT WATER SYSTEM.
- TRACER WIRE SHALL BE INSTALLED ON ALL WATERMAIN AND SERVICES AS PER CITY OF OTTAWA TRACING WIRE SPECIFICATION MW-19.2.
- MOLDED PVC FITTINGS FOR PIPE SIZES 100MM TO 300MM SHALL CONFORM TO AWWA C900 AND CERTIFIED TO CSA B137.2.
- FABRICATED FITTINGS 250MM AND 300MM SHALL BE MANUFACTURED FROM SEGMENTS OF AWWA C900, CLASS 150 (DR18) PVC PIPE, BONDED TOGETHER AND OVER-WRAPPED WITH FIBERGLASS-REINFORCED POLYESTER TO MEET THE REQUIREMENTS OF CSA B137.3.
- WHERE METAL FITTINGS ARE TO BE USED ON PVC MAINS SUFFICIENT CATHODIC PROTECTION MUST BE PROVIDED AS PER THE FOLLOWING REQUIREMENTS:
 - MINIMUM OF ONE 13KG ZINC ANODE SHALL BE INSTALLED FOR EVERY 1000m OF TRACER WIRE;
 - ONE 13KG ZINC ANODE SHALL BE INSTALLED FOR EACH COPPER WATER SERVICE CONNECTION;
 - ONE 13KG ZINC ANODE SHALL BE INSTALLED ON EVERY VALVE, HYDRANT, BEND, TEE, SLEEVE, REDUCER, PLUG, CAP, JOINT RESTRAINT, COUPLING, ETC., CONNECTED TO THE PVC PIPE.







- WATERMAIN AND SERVICE BEDDING AND BACKFILL AS PER THE CITY OF OTTAWA WATER STANDARD DETAIL DRAWING W17.
- WATERMAIN DEFLECTION FOR PVC PIPE:
 - MAXIMUM ALLOWABLE DEFLECTION OF 1.5 DEGREES PER JOINT UP TO 250mm DIAMETER (160mm PER 6.1m PIPE LENGTH) AND 1.2 DEGREES FOR 300mm DIAMETER (128mm PER 6.1mm PIPE LENGTH) SHALL NOT BE EXCEEDED. ALL JOINTS SHALL BE DEFLECTED AN EQUAL AMOUNT.
- NEW, CLEANED AND REPAIRED WATER MAINS SHOULD BE DISINFECTED IN ACCORDANCE WITH AWWA STANDARD C651-05: DISINFECTING WATER MAINS OR AN EQUIVALENT PROCEDURE [AS REQUIRED BY THE PROCEDURE FOR DISINFECTION OF DRINKING WATER IN ONTARIO (DISINFECTION PROCEDURE)].
- COVER SHALL NOT BE LESS THAN 2.4m WITH THE COVER BEING MEASURED FROM THE OVERT OF THE PIPE.
- THRUST RESTRAINTS FOR HYDRANTS, TEES, CROSSES, BENDS AND PLUGS SHALL BE FORMED CONCRETE, BRACED AGAINST A SUFFICIENT AREA OF UN-EXCAVATED EARTH OR THEY SHALL BE TIED TO THE PIPE WITH SUITABLE METAL TIE RODS, CLAMPS, OR RETAINING GLANDS AS DIRECTED BY THE ENGINEER. TIE RODS, CLAMPS, OR OTHER COMPONENTS OF DISSIMILAR METAL SHALL BE PROTECTED AGAINST CORROSION BY HAND APPLICATION OF A BITUMINOUS COATING OR BY ENCASEMENT OF THE ENTIRE ASSEMBLY WITH 8 MIL (0.2mm) LOOSE POLYETHYLENE FILM IN ACCORDANCE WITH A.W.W.A. C-105, OR THE INSTALLATION OF MAGNESIUM OR ZINC SACRIFICIAL ANODES.
- WATER MAIN VALVES AND VALVE CHAMBERS SHALL BE AS PER THE APPLICABLE CITY OF OTTAWA STANDARD DETAIL DRAWINGS AND THE CITY OF OTTAWA VALVES SPECIFICATION MW-19.5.
- ALL WATERMAIN, AND SERVICE, PRODUCTS SHALL BE CONSISTENT WITH THE CITY OF OTTAWA 'S APPROVED PRODUCT LISTINGS.
- WATER SERVICE PIPE MATERIAL SHALL BE PVC, A.W.W.A. C-900, DR 18,
- ALL VALVE BOXES TO BE SET TO PROPOSED GRADES.
- VALVE PROTECTION, DENSO PROTROLEUM PRODUCTS TO PROTECT VALVING.
- VALVES ARE ONLY TO BE OPERATED BY CITY STAFF. 24 HOURS WRITTEN NOTICE TO BE PROVIDED FOR VALVE OPERATION.

FLUSHING, SWABBING AND TESTING


- ALL NEW WATERMANS ARE TO BE SWABBED IN ACCORDANCE WITH CITY SPECIFICATIONS.
- UPON COMPLETION OF INSTALLATION, THE CONTRACTOR SHALL PERFORM THE REQUIRED CITY OF OTTAWA PRESSURE TESTING TO THE SATISFACTION OF THE CITY'S WATERMAIN INSPECTOR.

EROSION & SEDIMENT CONTROL

- CONTRACTOR TO PROVIDE SEDIMENT CONTROL DURING SITE PLAN CONSTRUCTION. CONTRACTOR TO INSTALL, AND CONTINUOUSLY MONITOR AND MAINTAIN SEDIMENT CONTROL PLAN TO MINIMIZE EROSION AND SEDIMENT TRANSPORT.
- CONTRACTOR TO PROVIDE A LIGHT DUTY GEOTEXTILE SILT FENCE AROUND THE SITE PERIMETER, INSTALL PER MANUFACTURER'S INSTRUCTIONS. AT A MINIMUM, OR AS OTHERWISE DIRECTED BY THE ENGINEER, THE FENCE SHALL REMAIN IN PLACE UNTIL VEGETATION HAS BEEN ACHIEVED. INSTALL FENCE PER OPSD 219.110 LIGHT DUTY SILT FENCE BARRIER.
- SILTSACKS BY TERRAFIX OR EQUAL TO BE USED IN CATCH BASINS DURING CONSTRUCTION TO PROVIDE EROSION AND SEDIMENT CONTROL. THE CONTRACTOR IS TO MAINTAIN THE EROSION AND SILTATION CONTROL MEASURES TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF OTTAWA.
- ALL SILTSACKS SHALL BE CLEANED AND MAINTAINED AFTER EACH RAINFALL AS DIRECTED AND TO THE SATISFACTION OF THE CITY OF OTTAWA.
- ADDITIONAL SILT CONTROL LOCATIONS MAY BE REQUIRED AS DETERMINED BY THE CITY OF OTTAWA.
- CONTRACTOR TO PROVIDE MUD MAT AT THE SITE EXIT DURING CONSTRUCTION. MINIMUM 200mm DEPTH X 50mm & 100mm CLEAR STONE, SEE PLAN (CHECK CITY REQUIREMENTS AND/OR TERRAFIX BROCHURE).
- RIP RAP TYPE 2 WITH GEOTEXTILE PER OPSD 810.010 AROUND THE STRAWBALE CHECK DAM.
- STRAWBALE FLOW CHECK DAM SHALL BE AS PER OPSD 219.180.

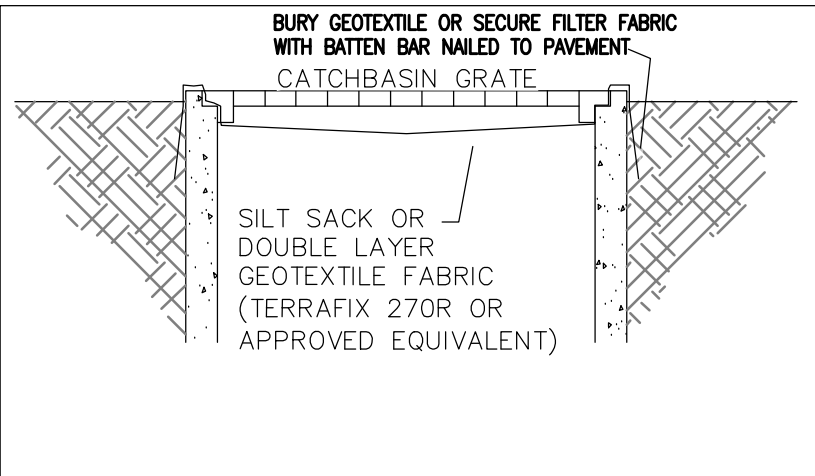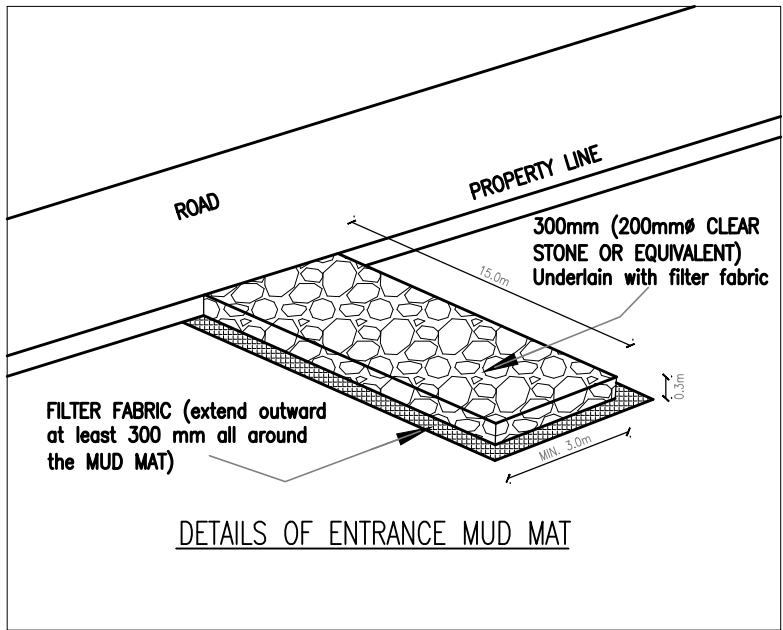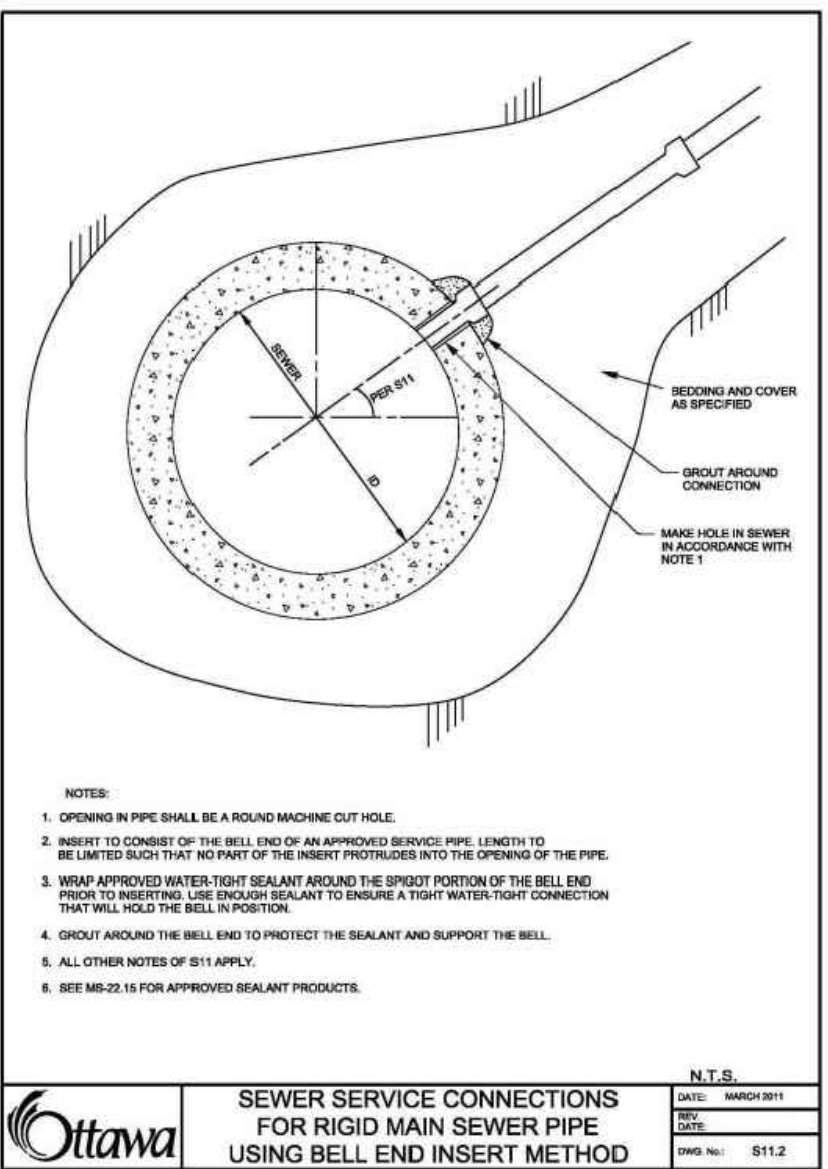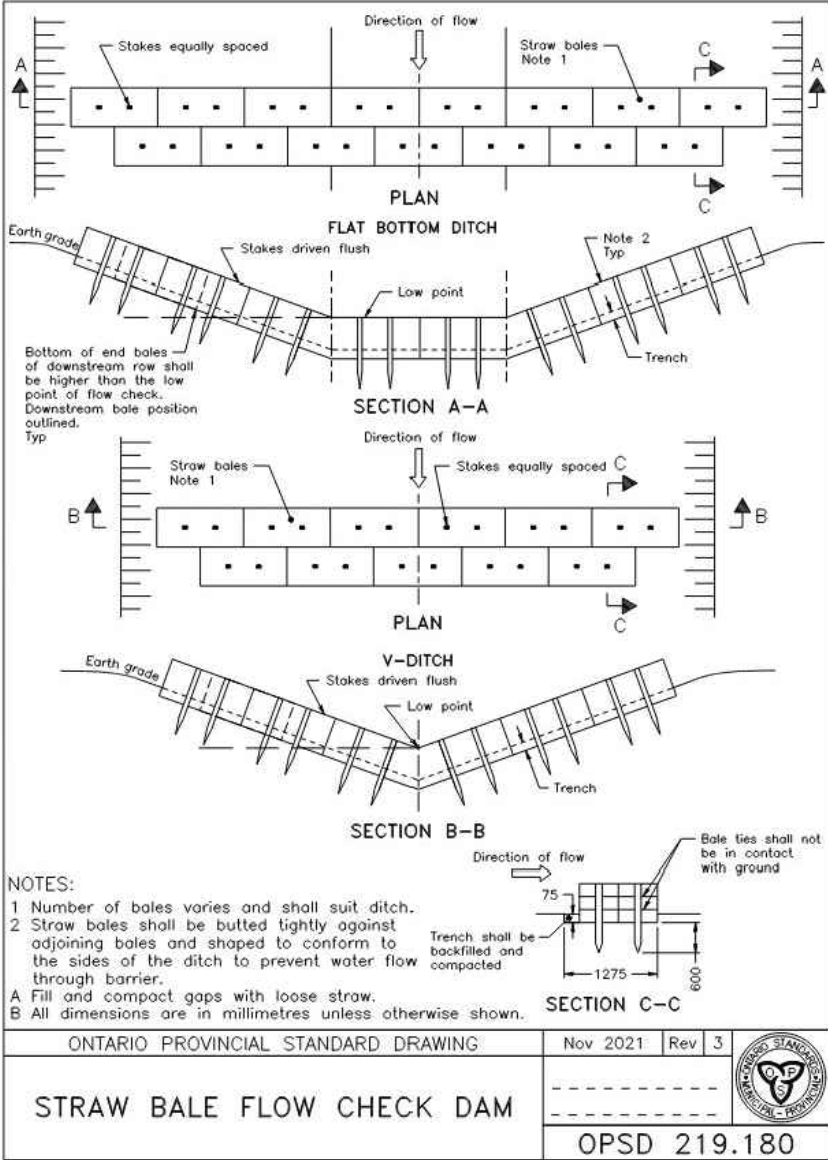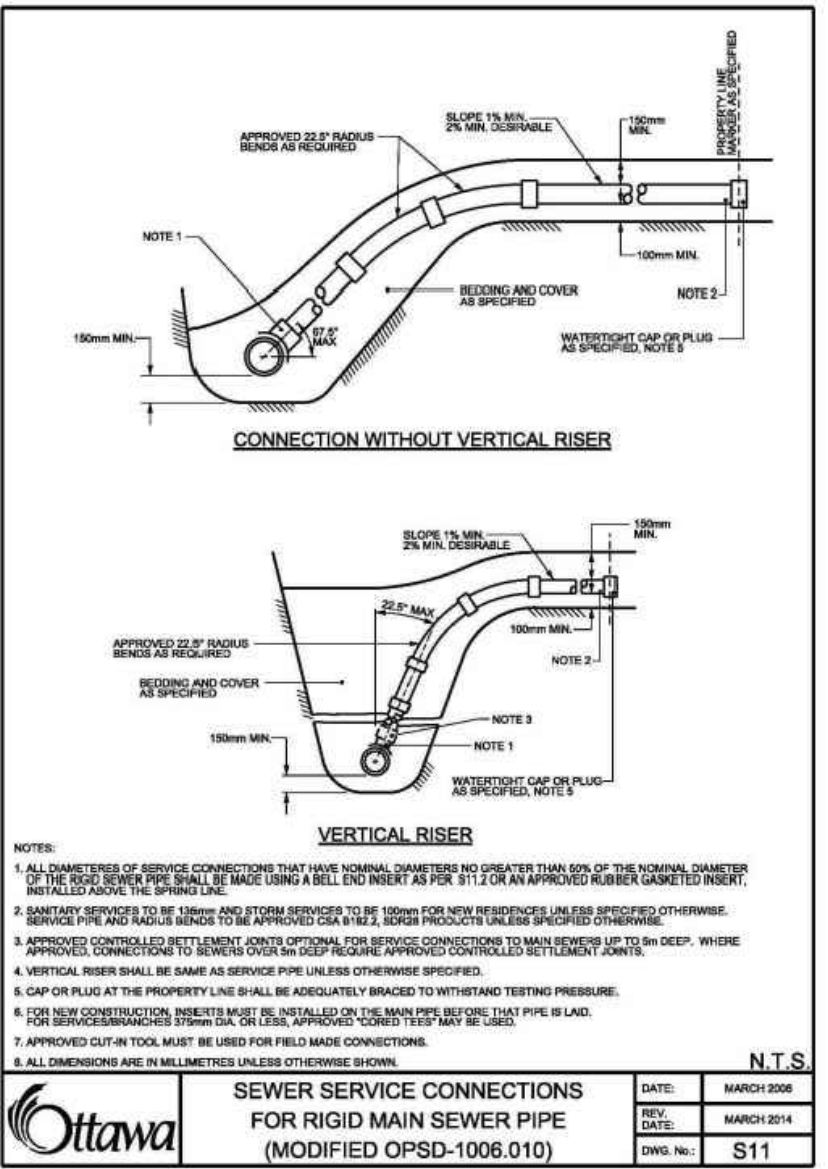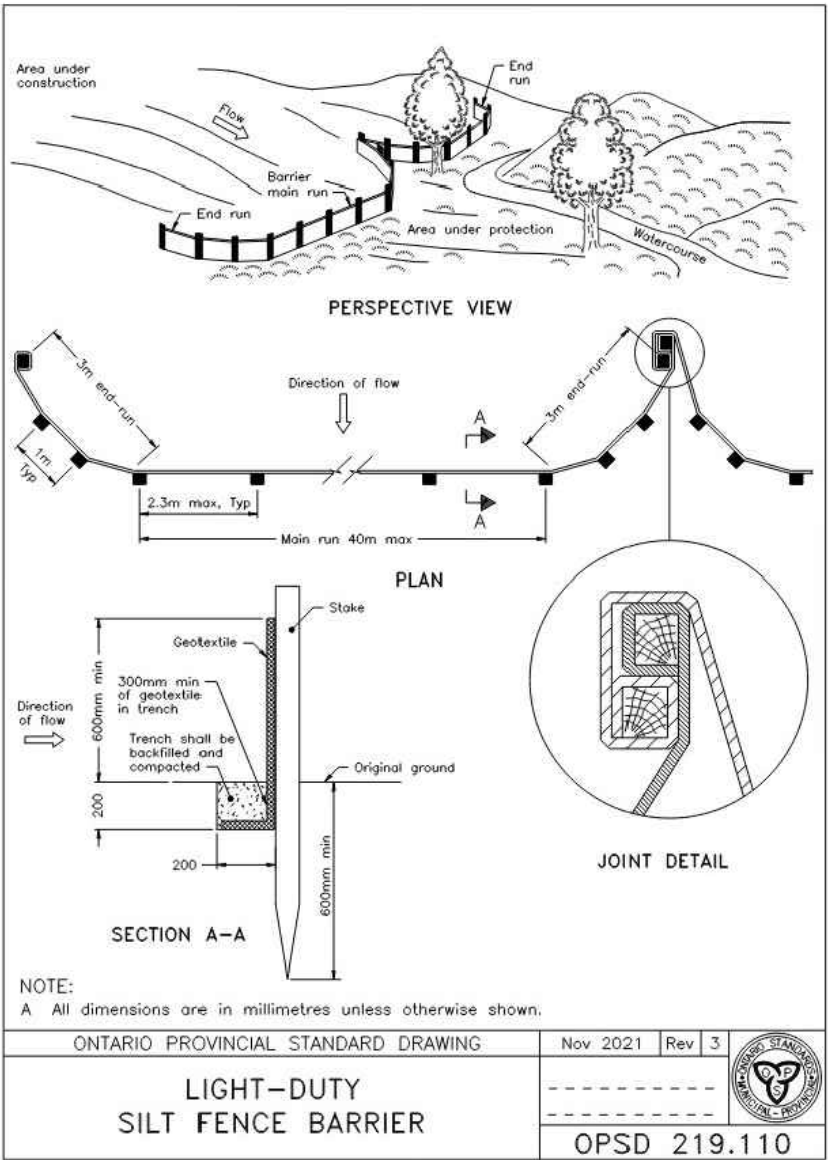


CATCH BASIN SILTATION CONTROL

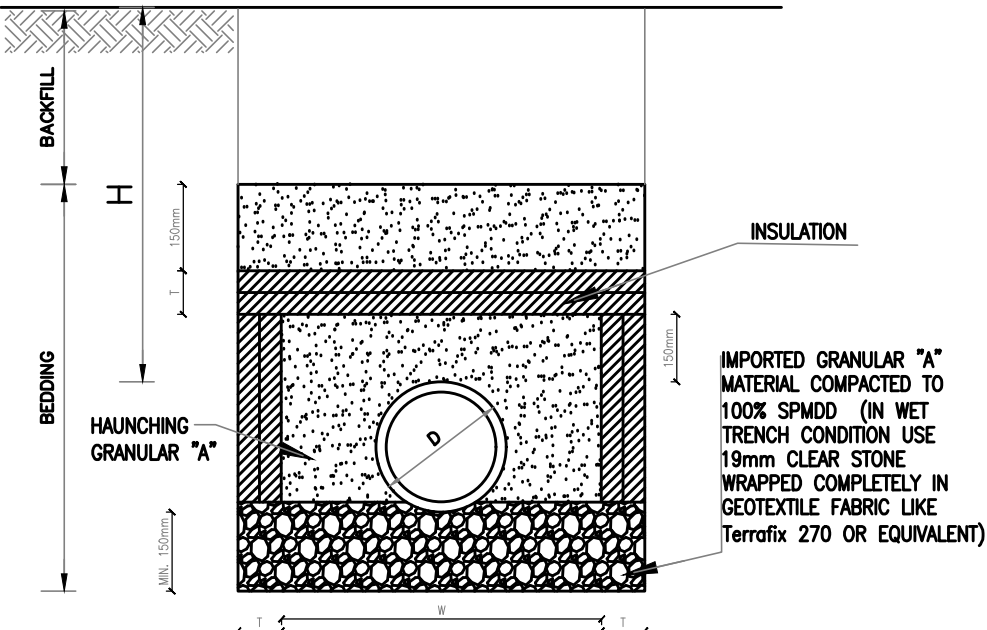

- FIRST PIPE LENGTH ADJACENT TO MH OR OTHER RIGID STRUCTURE TO HAVE 15 MPa CONCRETE BEDDING.
- IMPORTED GRANULAR "A" TO 300mm ABOVE PIPE OVERT (COMPACTED TO 100% SPMD0).
- BACKFILL MATERIAL TO BE NATIVE MATERIAL PLACED IN 300mm LIFTS AND COMPACTED TO 95% SPMD0.
- W=D+600mm (MIN. 1000mm).
- THE INSULATION MATERIAL SHALL BE EXTRUDED POLYSTYRENE ACCORDING TO OPSD 1605 WITH MIN. COMPRESSIVE STRENGTH OF 275 kPa & MAX. WATER ABSORPTION RATE OF 2.0%(VOLUME).
- INSULATION BOARD SHALL BE INSTALLED WITH MIN. 2 LAYERS, OVERLAPPED MIN. 300mm. JOINTS SHALL BE STAGGERED FOR MULTIPLE INSULATION SHEETS. ALL JOINTS SHALL BE TIGHTLY BUTTED TOGETHER (TAPE OR OTHERWISE SECURE JOINTS TO RESIST MOVEMENT DURING BACKFILL).
- MINIMUM INSULATION THICKNESS T SHALL BE IN ACCORDANCE WITH TABLE

Min. Insulation Thickness (mm)		
H (mm)	T min. for Water Pipes	T Min. for Sewer Pipes
1500<=H<2000	75	0
1200<=H<1500	100	75
900<=H<1200	125	100
600<=H<900	150	125

PIPE INSULATION DETAIL FOR PIPES WITH LESS COVER THAN THE REQUIRED MINIMUM

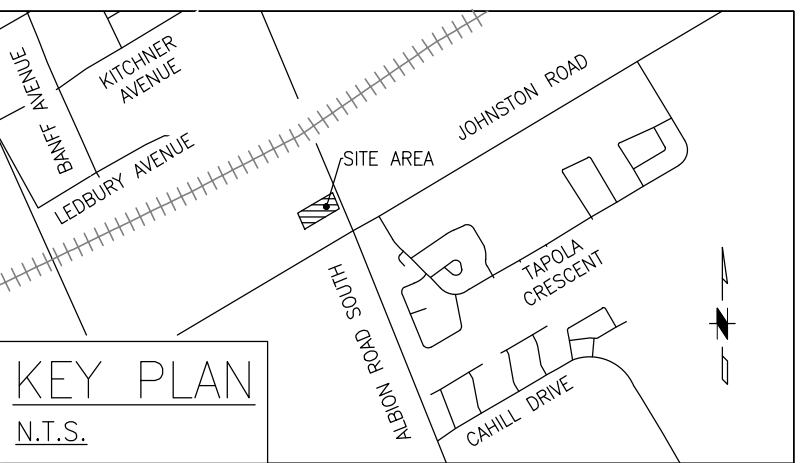

KEY PLAN
N.T.S.

25/09/29	01	ISSUED FOR SPA	RV	AK
----------	----	----------------	----	----

DATE	REV.	REVISIONS	BY	APP'D
------	------	-----------	----	-------

ISSUED STATUS:	—
----------------	---

DRAWN BY:	RV	2025/09/29
DESIGNED BY:	RV	2025/09/29
DRAWING CHECKED BY:	AK	2025/09/29
QC BY:	AK	2025/09/29
PM:	TR	2025/09/29



UNAUTHORIZED USE OF DATA, DISCLOSURE OF TECHNICAL INFORMATION CONTAINED HEREIN, OR REPRODUCTION OF THIS DOCUMENT IN WHOLE OR IN PART FOR USE BY THIRD PARTIES IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM EPI ENGINEERING INC.



CLIENT:	ROOF MAINTENANCE SOLUTIONS (2317290 ONTARIO INC)
---------	--

SITE:	3210 ALBION ROAD SOUTH, OTTAWA, ON
-------	------------------------------------

TITLE:	CIVIL NOTES AND DETAILS
--------	-------------------------

SCALE:	1:250	DATE:	2025/09/29
--------	-------	-------	------------

PROJECT NO:	7834	DRAWING NO:	C108	REVISION:	1
-------------	------	-------------	------	-----------	---