



Engineers, Planners & Landscape Architects

Engineering

Land/Site
Development

Municipal
Infrastructure

Environmental/
Water Resources

Traffic/
Transportation

Recreational

Planning

Land/Site
Development

Planning Application
Management

Municipal Planning

Urban Design

Expert Witness
(OLT)

Wireless Industry

Landscape Architecture

Streetscapes &
Public Amenities

Open Space, Parks &
Recreation

Community &
Residential

Commercial &
Institutional

Environmental
Restoration

5494-5510 Boundary Road Day and Ross

Servicing and Stormwater Management Report

Engineering excellence.

Planning progress.

Liveable landscapes.

SERVICING AND STORMWATER MANAGEMENT REPORT

**5494-5510 BOUNDARY ROAD
DAY AND ROSS
OTTAWA, ONTARIO.**

Prepared By:

NOVATECH

Suite 200, 240 Michael Cowpland Drive
Kanata, Ontario
K2M 1P6

October 3, 2024

Revised: November 14, 2025

Novatech File: 118168

Ref No. R-2024-095

November 14, 2025

City of Ottawa
Planning Infrastructure and Economic Development Department
110 Laurier Avenue West, 4th Floor
Ottawa, ON
K1P 1J1

Attention: Adam Brown

Dear Mr. Brown:

**Reference: 5494-5510 Boundary Road
Ottawa, ON
Servicing and Stormwater Management Report
Our File No. : 118168**

Please find enclosed the 'Servicing and Stormwater Management Report' for the above noted development. This report has been revised as per City of Ottawa and South Nation Conservation Authority comments and is hereby resubmitted for review in support of the Site Plan Application for the proposed development.

Should you have any questions or require additional information, please contact the undersigned.

Yours truly,

NOVATECH



Matt Hrehoriak, P.Eng.
Project Manager | Land Development Engineering

TABLE OF CONTENTS

1.0	INTRODUCTION	1
2.0	EXISTING CONDITIONS.....	1
3.0	PROPOSED DEVELOPMENT	1
4.0	SITE CONSTRAINTS	1
5.0	WATER SERVICING	4
6.0	SANITARY SERVICING	5
7.0	STORM SERVICING & STORMWATER MANAGEMENT	6
7.1	Existing Drainage Conditions	6
7.2	Stormwater Management Criteria	6
7.3	Proposed Stormwater Management System	6
7.4	Stormwater Management Modeling	7
7.4.1	Pre-Development	7
7.4.2	Post-Development	8
7.5	Stormwater Quality Control	10
7.6	Boundary Road Ditch Capacity.....	10
8.0	EROSION AND SEDIMENT CONTROL	11
9.0	CONCLUSIONS AND RECOMMENDATIONS.....	11
10.0	CLOSURE.....	12

LIST OF FIGURES

Figure 1	Key Plan
Figure 2	Existing Conditions
Figure 3	Proposed Site Plan
Figure 4	Pre-Development Drainage Area Plan

LIST OF APPENDICIES

Appendix A	Water Servicing Information
Appendix B	Sanitary Servicing Information
Appendix C	Stormwater Management Calculations
Appendix D	Referenced Reports
Appendix E	Drawings

LIST OF ENGINEERING DRAWINGS

Notes and Details Plan	(118168-ND, PND1,PND2)
Erosion and Sediment Control Plan	(118168-ESC)
General Plan of Services	(118168-GP)
Grading Plan	(118168-GR1, GR2)

1.0 INTRODUCTION

Novatech has been retained to prepare a Servicing and Stormwater Management Report for the proposed development located at 5494-5510 Boundary Road within the City of Ottawa. This report will support a Site Plan Application for the subject development. **Figure 1** Key Plan shows the site location.

2.0 EXISTING CONDITIONS

The subject site is approximately 8.5 hectares in size and is currently undeveloped. The site is generally covered with areas of tall grass and bare soil, bordered by wooded areas. There are two existing gravel entrances to the site from Boundary Rd. The topography of the site is relatively flat with general drainage to perimeter watercourse. There is ponding water along the north property line which is a result of extensive grade changes on the site over the past approximately 20 years. It is our understanding that the site was previously used as a pit where the native sand material was removed and replaced with miscellaneous fill material. The grade changes on site have trapped water on site from outletting to the roadside ditch on Boundary Road. **Figure 2** shows the existing site conditions.


3.0 PROPOSED DEVELOPMENT

It is proposed to develop the site with a cross-dock facility with 3,758m² of industrial floor space and 642m² of office floor space. The cross-dock facility will consist of 72 loading bays and will include associated secured truck and trailer parking. The office component will include associated car parking lots fronting the development. It is proposed to access the development from two paved entrances from Boundary Road. **Figure 3** shows the proposed development site plan.

4.0 SITE CONSTRAINTS

A geotechnical investigation was completed for the subject development and a report provided entitled 'Geotechnical Investigation Proposed Warehouse Complex – 5510 Boundary Road Ottawa, Ontario' prepared by Paterson Group dated September 10, 2018. The following is a summary of the findings of this report:

- From available geological mapping the bedrock is shale and at depth of 25-35m below ground surface.
- Groundwater levels are expected to be 2-3m below existing ground surface.
- A category 3 permit to take water (PTTW) may be required during construction if more than 400,000 L/day of surface and/ or ground water is to be pumped during the construction phase. A time allowance of 4-5 months is required to obtain a permit from the Ministry of Environment Conservation and Parks MECP.
- For typical ground and/ or surface water pumping (50,000-400,000 L/day) during construction a MECP permit to take water (PTTW) and registry with the Environmental Activity and Sector Registry (EASR) is required. A time allowance of 2-4 weeks should be allocated to complete the EASR registry and PTTW discharge plan.
- Due to the presence of a silty clay deposit, the site will be subject to a permissible grade raise restriction. It is anticipated that due to time constraints a surcharge program is not realistic and lightweight fill and granular material will be required on site to manage long-term settlement.

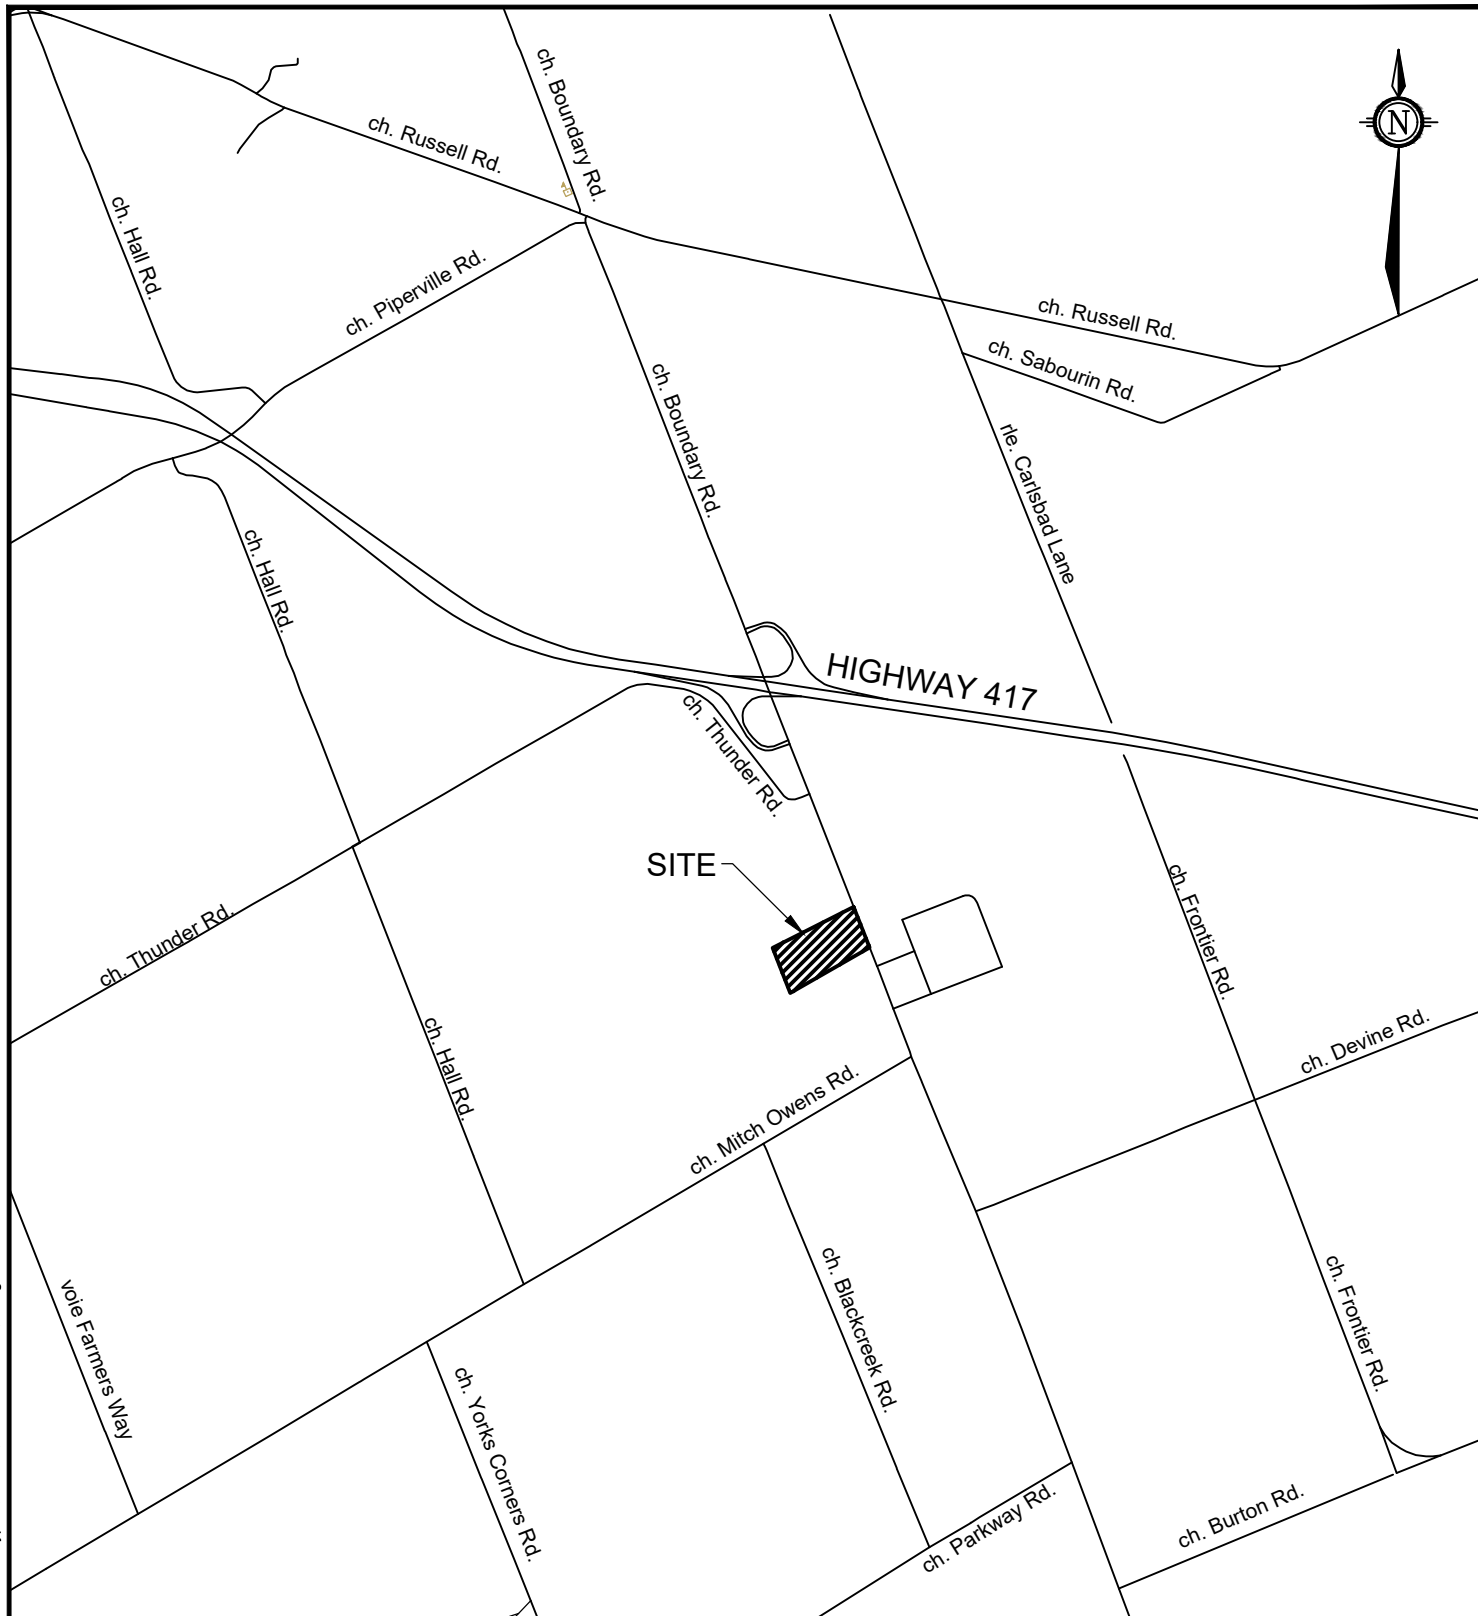

Engineers, Planners & Landscape Architects

Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com


KEY PLAN

5510 BOUNDARY ROAD
CITY OF OTTAWA

5510 BOUNDARY ROAD

DATE	JOB	FIGURE
NOV 2025	118168	1

M:\2018\118168\CAD\Design\Figures\118168-XCON.dwg, EX, Oct 09, 2025 - 12:01pm, rkargus

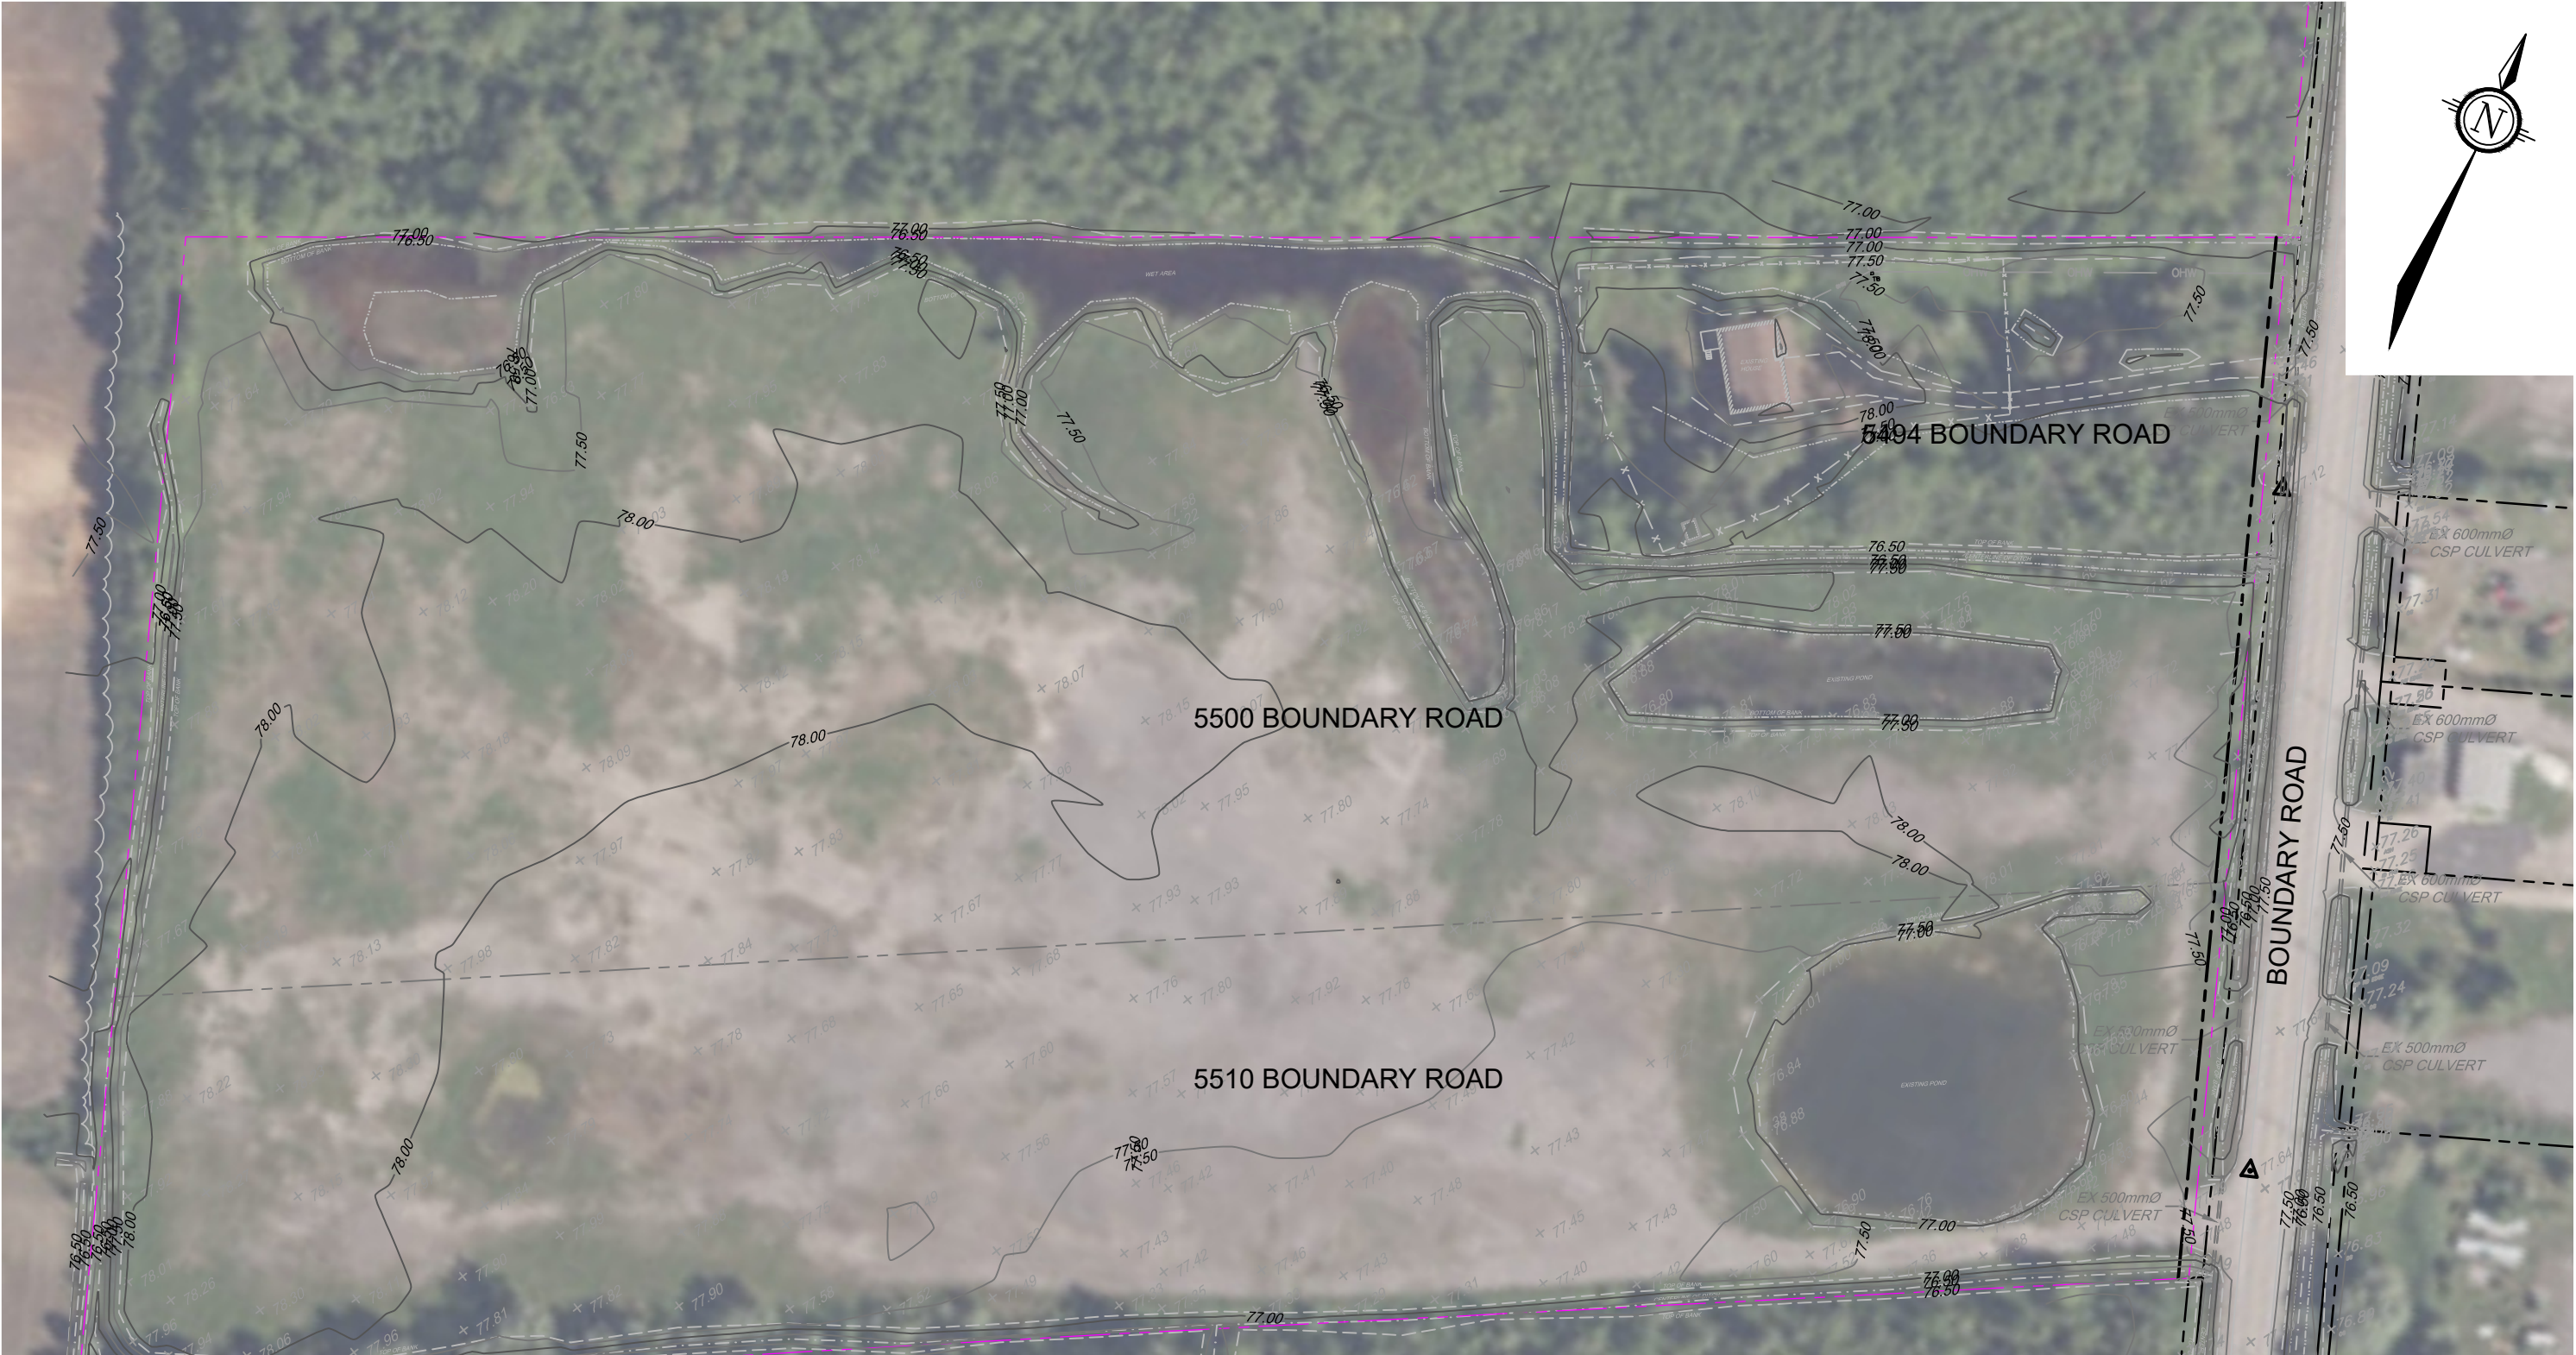

LEGEND

- PROPERTY LINE
- EXISTING TOP OF BANK
- EXISTING DITCH
- == EXISTING CULVERT
- 77.00 CONTOUR LINES

NOVATECH

Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

5510 BOUNDARY ROAD


EXISTING CONDITIONS

SCALE 1 : 1250

DATE NOV 2025 JOB 118168 FIGURE 2

CUT111V17 DWG 270mm V112mm

M:\2018\118168\CAD\Design\Figures\118168-SP.dwg, SP, Oct 09, 2025 - 12:03pm, rkargus

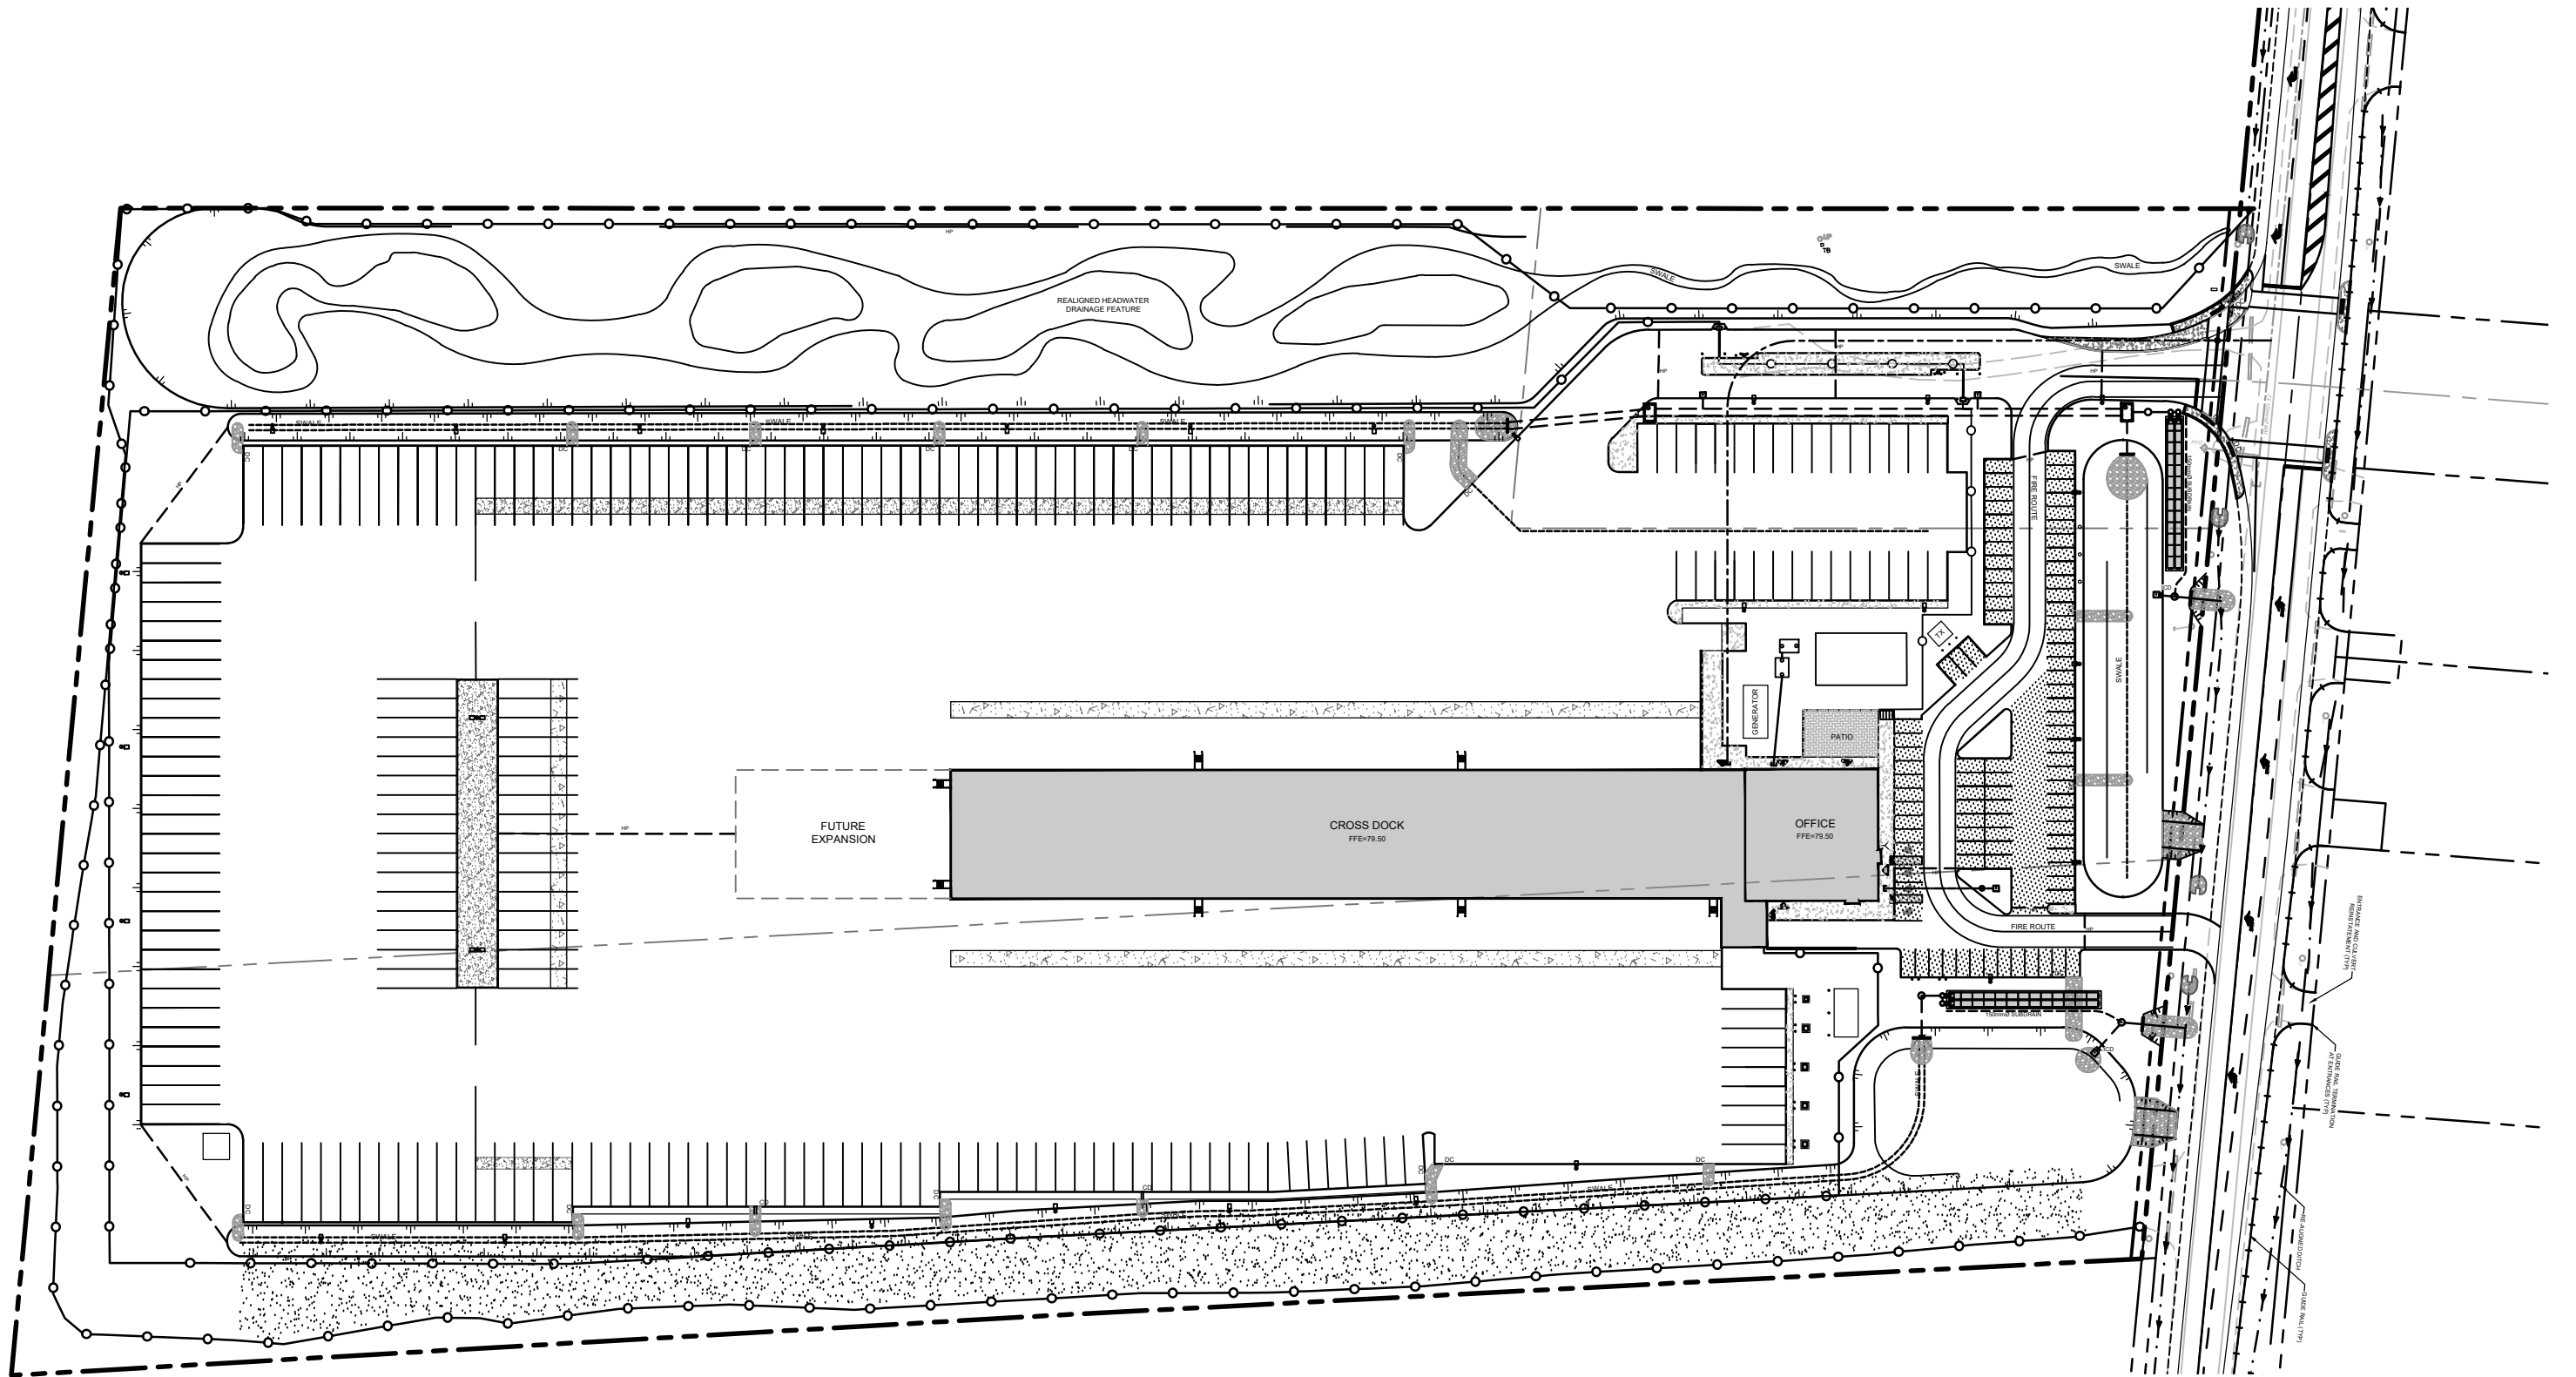

Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

5510 BOUNDARY ROAD

PROPOSED SITE PLAN

SCALE 1 : 1250

DATE NOV 2025 JOB 118168 FIGURE 3

CUT11V17 DWG 270mm x 122mm

- A permissible grade raise of 1.0-1.2m is recommended for slab-on-grade using 400mm EPS geofoam blocks to compensate for sustained slab on grade loading.
- A permissible grade raise of 1.4m is recommended for parking and loading areas away from the building foundations.
- It is recommended to limit plantings around structures and provide clay dikes on service trenches to reduce long term ground water lowering.
- Catchbasins are to be equipped with subdrains extending in four orthogonal directions and longitudinally when placed along curbs. Subdrains are to be placed 300mm below the subgrade level. Subgrade is to be shaped to promote water flow to the subdrains.

A subsequent memo was prepared by Paterson Group entitled 'Settlement Surcharge Monitoring Program Proposed Commercial development – 5510 Boundary Road, Ottawa, Ontario' dated August 12, 2024. The settlement surcharge memo outlines the requirements for surcharging the site to reduce and/or remove the requirements for lightweight fill on site. The following is a summary of the settlement surcharge program requirements:

- Surcharge pile to be constructed to a geodetic elevation of 81.50m and extend 2.4m horizontally beyond the limits of the building foundation.
- The surcharge pile will be constructed from imported granular material, placed in maximum 300mm thick loose lifts and compacted with the tracks of the leveling equipment.
- 4 settlement plates will be installed at the underside of footing elevation, 1 temporary benchmark settlement plate will be installed 1.8m below existing ground level a minimum of 30m away from the surcharge pile.
- Settlement monitoring surveys will be conducted monthly using a high accuracy, digital level.
- It is anticipated that a total of 18 months will be required to complete the settlement monitoring program.

An environmental impact study was completed for the subject development and a report provided entitled 'Environmental Impact Statement and Tree Conservation Report (EIS/TCR) – 5494-5510 Boundary Road Ottawa, Ontario' prepared by Holly Bickerton, BASc, MES. dated February 15, 2021, updated November 9, 2021. The subject site is designated as a Rural Natural Feature Area in the Official Plan. The EIS/TCR was required to determine that no negative impacts will occur to any natural heritage features on or within 120m of the property. The following is a summary of the findings of this report:

- There are no provincially significant or local wetlands on the subject site however, local wetlands exist to the north and south. Mitigating setbacks of 45m will be employed adjacent to wetlands.
- There are no species at risk observed within 120m of the site. Two regulated species the Bank Swallow and Barn Swallow were observed on site.
- The permanent headwater drainage features around the perimeter of the site are considered significant wildlife habitat as snapping turtle were observed on site.
- Fish habitats were observed on site and will be maintained in the proposed development. A proposed 15m setback will be maintained from limits of the fish habitat to the proposed development.
- Significant woodlands are present to the north and south of the site which are to be protected by restored naturalized setbacks.

- Any tree clearing on site is to occur outside the bird breeding season (April 15 – August 15) unless authorized by a qualified biologist.
- By implementing the mitigation measures identified in the EIS/TCR, the proposed development will have no negative impacts on the ecological features and functions of the applicable natural heritage features.

An Environmental Impact Statement Fisheries Component was prepared by Bowfin Environmental Consulting Inc. dated April 2021, updated November 2021. Several potential fish habitats were identified on site, generally confined to the perimeter and were likely a result of the fill brought to site by the previous owner. These features are part of the Upper Bear Brook sub watershed which is tributary to the South Nation River. The Fisheries Impact Statement outlines the potential impacts to fish and fish habitat and the required mitigation measures. The following is a summary of the findings of this report:

- Eight different features were identified on site plus the roadside ditch. Of these features only feature 5 along the north property line and the roadside ditch will be directly impacted by the proposed development.
- The roadside ditch will need to be piped and filled in for a portion of the ditch fronting the site. The culvert will need to be designed and installed to promote fish passage.
- Feature 5 will need to be realigned out of the development area, the total area of the fish habitat will be maintained in the proposed development.
- A minimum 15m buffer will be provided from the proposed development to the existing and realigned features.
- To maintain water quantity and quality reaching all features on site an infiltration berm will be constructed in the proposed conveyance ditches to promote filtration of water to the existing features.
- All in water works are required to be completed outside fish spawning periods (work between July 1 and March 14).

A subsequent report titled Environmental Impact Statement Update was prepared by CIMA+ dated October 3, 2024. The report was prepared for the recent updates to the Site Plan application and to update the mitigation measures to current guidelines. The following is a summary of the findings of this report:

- Consultation with DFO is required prior to any disturbance to the fish habitat.
- A complete flora Species at Risk inventory must be completed no earlier than 2 years prior to construction.
- Butternut and Black Ash inventories must be completed at the appropriate time of year.
- As a condition of Site Plan Approval, review and update the list of avoidance and mitigation measures, as needed, at the time of construction.

The City of Ottawa has recently adopted Zoning By Law 2024-238, which has rezoned the developable area of the Site to RG-Rural General Industrial which permits the proposed cross-dock facility. The rezoning also captures and designates the realigned headwater feature along the northern property limits and the setback to the wetland on the neighboring property to south as Open Space O1R Zone. The proposed development respects the required setbacks as per the Zoning Amendment.

5.0 WATER SERVICING

There is an existing 100mm dia. municipal watermain in Boundary Road which terminates in front of the proposed site. This existing watermain infrastructure is part of the Carlsbad Springs Trickle Feed Water System which was recently extended to service the Amazon distribution facility to the north of the site. This municipal water system would provide potable water for domestic use only.

The domestic water supply to the facility from the Carlsbad water system will be 3 Equivalent connections: $2,700\text{L/Day} \times 3 = 8,100\text{ Litres/day}$ [5.63l/min continuous flow]. The water meter and flow control valve will be designed to accommodate this continuous flow rate while not exceeding it.

It is proposed to service the development by connecting to the existing 100mm dia. watermain in Boundary Road and extending a 50mm dia. private watermain into the site. The 50mm water service will supply the internal water system which consists of a domestic water storage tank, booster pump and pressure tank to maintain the internal operating pressures while not exceeding the equivalent connection flow rate. The domestic water will be re-chlorinated on site prior to being distributed through the internal plumbing system to mitigate any potential stagnation in the Carlsbad water system or the onsite water storage tank. Refer to the Water Entry Room figure in **Appendix A** for details on the internal water system configuration.

Design Criteria from Section 4 of the City of Ottawa Water Distribution Guidelines and section 8 of the Ontario Building Code were used to calculate the theoretical water demands for the proposed development. The average water demand for the proposed development is calculated as follows:

Average Day Water Demand

The water demand is calculated for a total of 34 employees at the facility, which includes office and cross-dock workers.

29 cross-dock employees

Average demand per employee = 125 Litres/day (includes shower allotment)

5 office employees

Average demand per employee = 75 Litres/day

$(29 \times 125) + (5 \times 75) = 4,000\text{ Litres/day}$

There will also be miscellaneous external hose bib use throughout the day. Assuming a combined hose bib allowance of 1.5 hrs./day at a rate of 20 Litres/min, the average day flows are calculated as follows:

$1.5\text{ hrs/day} \times 20\text{Litres/minute} = 1,800\text{ Litres/day}$

It should be noted that hose bibs supplied directly from the Carlsbad municipal water system are not to be used for irrigation, truck washing or firefighting.

Average Day Summary

Employee use + hose bibs

$4,000\text{ Litres/day} + 1,800\text{ Litres/day}$

= 5,800 Litres / day

Fire Suppression

As previously indicated, the Carlsbad system will not provide fire suppression for the development. Fire suppression will be provided by a 400m³ underground storage tank located under the office component of the building. The required fire flows for the development were calculated based FM Global criteria to be 97.8L/s (1550GPM). The flow rate accounts for a 1300GPM sprinkler requirement and a 250GPM hose allowance. As per the FM Global criteria the required fire flow will need to be provided for a minimum duration of 60 minutes which equates to a required water storage volume of 352m³ (93,000 gallons). The fire flow requirements for the development were also calculated using the FUS and NFPA methods, a comparison of the flow and storage requirements is provided below in **Table 5.1**.

Table 5.1: Fire Protection Requirement Comparison

Fire Protection Method	Fire Flow (LPS)	Duration (min)	Storage Volume (m ³)
FM Global	97.8	60	352
Fire Underwriter Survey - FUS	133.0	120	960
National Fire Protection Association - NFPA	90.4	90	488

In the event of a fire, the fire department will draw water from the storage tank to pressurize the internal fire suppression system. A Siamese connection will be located near the main entrance of the office and a tank pull port will be located along the fire route in the landscaped island fronting the building. The pull port will be provided as per City of Ottawa Standard detail W51/52. Refer to the General Plan of Services (118168-GP) for additional details.

Based on the preceding it can be concluded that the municipal water supply along with the internal water system as designed, will provide adequate system pressures and flow for the domestic demand and the water storage tank will provide an adequate volume of water to meet the fire suppression requirements of the development.

6.0 SANITARY SERVICING

There is currently no existing municipal sanitary sewer fronting the development in Boundary Road as the development is not located within the City of Ottawa sanitary service area. A private onsite septic system is proposed to service the development as the daily flow rates are less than 10,000 L/day. The septic system was designed by Paterson Group for a total peak flow of 4,000L/day. Paterson has designed a Waterloo Biofilter system for the site, design drawings and details of the system are provided in **Appendix B** for reference.

7.0 STORM SERVICING & STORMWATER MANAGEMENT

There is no municipal storm sewer fronting the development. As previously indicated, the site currently sheet drains to a perimeter watercourse which outlets to the existing Boundary Road ditch. The storm drainage system has been designed to ensure there will be no negative impacts to the provincially significant wetland (PSW) northwest of the development, the realigned headwater feature along the northern property limits and the wetland to the south.

It is proposed to service the development with a perimeter swale system that will collect and convey surface runoff to two dry ponds which will attenuate peak flows from the site to pre-development levels prior to discharging to the Boundary Road ditch. Storm runoff from the site will not be conveyed to the PSW, the realigned headwater feature or the wetland to the south. The proposed storm drainage system has been sized to ensure no surface ponding on the paved surfaces during storms up to and including the 2-year event, and that all storm runoff is directed to the roadside ditch and not the realigned headwater feature or wetlands adjacent to the site during all storms up to and including the 100-year event. Refer to the General Plan of Services (118168-GP) for details on the storm servicing design.

7.1 Existing Drainage Conditions

As previously stated, the site in its current condition is relatively flat with general drainage to perimeter swales at the property limits. There is currently no municipal storm sewer fronting the development on Boundary Road. Boundary Road is a rural cross-section which includes roadside ditches on both sides of the road. Most of the site currently drains to the existing roadside ditch on Boundary Road. Refer to **Figure 4** in **Appendix C** for the Pre-Development Drainage Area Plan.

7.2 Stormwater Management Criteria

The stormwater management criteria and objectives for the site are as follows, per the City of Ottawa's requirements. For storm runoff directed to the Boundary Road ditch:

- Control post-development peak flows to pre-development levels for all storms up to and including the 100-year event.
- Provide a dual drainage system (i.e. minor and major system flows).
- Ensure that no surface ponding will occur on the paved surfaces during the 2-year storm event.
- Provide on-site water quality control equivalent to an 'Enhanced' Level of Protection (i.e., minimum 80% long-term TSS removal).
- Provide guidelines to ensure that site preparation and construction is in accordance with the current Best Management Practices for Erosion and Sediment Control.

7.3 Proposed Stormwater Management System

To effectively manage the post-development storm runoff from the site, the following measures are being proposed:

- Controlled flow roof drains will be provided to attenuate storm runoff from the roof area and to effectively utilize the roof storage. Roof leaders will discharge controlled flows to the surface on the south side of the building.
- Swales were designed around the north and south boundaries of the site to ensure efficient conveyance of stormwater and to provide sufficient storage capacity. It should be

noted that the perimeter swales have been designed below the MOE minimum slope criteria due to the shallow storm outlet (Boundary Road ditch) and the very flat topography of the site. As outlined in section 4.0 of the report the site has a strict grade raise restriction that limits the potential to raise the site to achieve the MOE minimum preferred slope of 0.5%. Any standing water in the swales will be mitigated through infiltration in the native sand layer below the swales. More frequent maintenance will be required to ensure sediment buildup is cleaned out regularly to ensure proper conveyance due to the lower flow velocities.

- Depressed curb spillways have been provided along the curb in the parking lot and truck court to convey sheet drainage from the pavement surface to the perimeter swales. Each subcatchment in the PCSWMM model outlets to a storage node that represents the surface storage in parking lot locally at each depressed curb. The stage-storage curves representing the parking lot surface storage were generated by surface contours from the Civil 3D surface model.
- Two dry ponds were strategically located at the downstream end of the north and south swale systems to effectively control peak flows to pre-development levels during all storms up to and including the 100-year event. The stage-storage curves for each pond were generated by surface contours from the Civil 3D surface model.
- An open-ended storm sewer system is proposed to convey stormwater from the north swale under the main driveway entrance to the north dry pond.
- Each pond was designed with a low flow outlet pipe directing the first flush flows to an Oil Grit Separator (OGS) unit and StormTech Isolator Row PLUS (IR+) chamber system to provide treatment.
- A major overland flow route will be provided for storms greater than the 100-year event and is shown on the Grading Plan (118168-GR).

It should be noted that the outlet elevation in the roadside ditch doesn't allow for adequate cover on the storm pipes to meet frost protection requirements. The storm sewers will require insulation over the pipe to provide frost protection for the pipe bedding.

7.4 Stormwater Management Modeling

7.4.1 Pre-Development

A technical memorandum was prepared by Novatech titled *Proposed Warehouse Complex, 5510 Boundary Road, Supplemental SWM Modeling Information*, dated October 5, 2020. This memo provides detailed hydrologic modeling of the existing site conditions and the pre-development release rates for the proposed site. The memo is provided in **Appendix D** for reference. The allowable release rates in the 2020 memo were based on an assumed development area of 6.94 ha; however, the development area has been since reduced to 6.14 ha due to increased development setbacks. The allowable release rate for the development has been revised to account for the development area reduction. A summary of the pre-development peak flows is provided in **Table 7.1**.

Table 7.1: Summary of Adjusted Pre-Development Peak Flows

Area ID	Drainage Area (ha)	Peak Flow (L/s)		
		2-year	5-year	100-year
PRE	6.14	118	188	445

7.4.2 Post-Development

The City of Ottawa Sewer Design Guidelines (October 2012) requires hydrologic / hydraulic modeling for all dual drainage systems. The performance of the proposed storm drainage system was evaluated using the PCSWMM model for this site. The results of the analysis were used to:

- Determine the total post-development runoff from the proposed site.
- Determine the required storage volumes for the proposed ponds.

A PCSWMM model has been prepared as part of this design submission. Model schematics and output files are provided in **Appendix C** for reference.

7.4.2.1 Design Storms

The hydrologic / hydraulic analysis was completed using the following synthetic design storms and historical storms. The IDF parameters used to generate the design storms were taken from the City of Ottawa Sewer Design Guidelines (October 2012).

Chicago Storms:

2-year 3-hour storm
5-year 3-hour storm
100-year 3-hour storm
100-year+20% 3-hour storm

SCS Type II Storms:

2-year 12-hour storm
5-year 12-hour storm
100-year 12-hour storm

Historical Storms:

July 1, 1979 storm
August 4, 1988 storm
August 8, 1996 storm

The 3-hour Chicago distribution generates the highest peak flows for both the minor and major systems and was determined to be the critical storm distribution for the design of the storm drainage system.

The proposed drainage system was also stress tested using a 3-hour Chicago design storm that has a 20% higher intensity and total volume compared to the 100-year event. The stress test and historical storm events were used to analyze how the drainage system functions under extreme conditions and ensure that there would be no severe flooding.

7.4.2.2 Modeling Parameters

The hydrologic parameters for each subcatchment were developed based on the proposed land use and grading. Subcatchments were modeled using the standard SWMM5 runoff module with Horton's Equation for infiltration. A table of the subcatchment parameters is provided in **Appendix C**.

Infiltration

Infiltration losses for all subcatchments were modeled using Horton's infiltration equation, which defines the infiltration capacity of soil over the duration of a precipitation event using a decay function that ranges from an initial maximum infiltration rate to a minimum rate as the storm progresses. The default values for the City of Ottawa were used for all catchments.

Horton's Equation:
$$f(t) = f_c + (f_o - f_c)e^{-k(t)}$$

Initial infiltration rate: $f_o = 76.2$ mm/hr
Final infiltration rate: $f_c = 13.2$ mm/hr
Decay Coefficient: $k = 4.14$ /hr

Depression Storage

The default values for depression storage in the City of Ottawa were used for all catchments. Rooftops were assumed to provide no depression storage (zero-impervious parameter).

- Depression Storage (pervious areas): 4.67 mm
- Depression Storage (impervious areas): 1.57 mm

Equivalent Width

'Equivalent Width' refers to the width of the subcatchment flow path. This parameter is calculated as described in Section 5.4.5.6 of the *City of Ottawa Sewer Design Guidelines* (October 2012).

Impervious Values

Runoff coefficients for each subcatchment were determined based on the proposed site plan. Percent impervious values were calculated using the following equation:

$$\%imp = (C - 0.20) / 0.70$$

7.4.2.3 Model Results

Peak Flows

A summary of the post-development peak flows from the site is provided in **Table 7.2**. The peak flows are based on the 3-hour Chicago storm distribution as the pre-development peak flows were established using this distribution. As shown in the table, post-development peak flows will be controlled to pre-development levels.

Table 7.2: Summary of Post-Development Peak Flows

Location	Contributing Area (ha)	Peak Flow (L/s)		
		2-year	5-year	100-year
North System				
STMMH-3*	3.04	70	79	82
Weir/Spillway**		0	0	256
South System				
STMMH-4*	2.99	41	45	54
Weir/Spillway**		0	0	4
Direct Runoff				
DR-01	0.11	10	19	45
Total***	6.14	111	124	394
Allowable	6.14	118	188	445

*Including outflows from the StormTech system (150mm subdrain) and the DICB outlet structure orifice.

**Provided by a depression in the pond berm.

***Calculated by adding the hydrographs at outfalls 'OF-1' and 'OF-2' (accounts for timing of peak flows).

Dry Ponds

The water levels and storage volumes in the dry ponds are summarized in **Table 7.3**. The results presented are based on the 3-hour Chicago storm distribution.

Table 7.3: Summary of Pond Water Levels & Storage Requirements

Pond	Water Level (m)			Storage Volume (m ³)		
	2-year	5-year	100-year	2-year	5-year	100-year
North	77.34	77.49	77.59	335	462	556
South	77.14	77.23	77.51	307	407	754

Stress Test

The stress test and historical storm events listed in **Section 7.4.2.1** were simulated in the PCSWMM model. It was determined that the stress test generated higher peak flows and runoff volumes than the historical storms. Based on the results of the PCSWMM model, during the stress test event, surface ponding will occur on the paved surfaces but will be localized to the depressed curb areas. The results also indicate that while the stress test flows will be contained in the south swale, there may be some overflow from the downstream end of the north swale to the realigned headwater feature to the north for a short period of time. The dry ponds have also been designed with sufficient freeboard to contain the water levels during the stress test event.

7.5 Stormwater Quality Control

Quality control of storm runoff from the site will be provided through the installation of two ADS StormTech IR+ chamber systems as well as two Hydro International First Defense High-Capacity OGS units for pretreatment. Each of the dry ponds near the outlet of the site will have low flow pipes directing the first flush flows to the OGS units and StormTech IR+ chambers, ensuring that all runoff from the first flush will be routed through the treatment train. Treated flows from the chambers will outlet via 150mm subdrains connecting to the downstream outlets to the Boundary Road ditch.

The OGS units in combination with the StormTech IR+ chamber systems will provide a net annual removal efficiency of approximately 86% while treating greater than 90% of the total runoff based on the ETV particle size distribution. Refer to **Appendix C** for detailed sizing of the OGS units and StormTech IR+ chambers. A summary of the water quality treatment unit sizing is provided in Table 7.4.

Table 7.4: Water Quality Treatment Unit Sizing Parameters

Location	Drainage Area (Ha)	Runoff Coefficient 'C'	OGS Model	No. of DC-780 Chambers	Total TSS Removal
North Outlet	3.04	0.81	FD-4HC	26	86.0%
South Outlet	2.99	0.79	FD-4HC	26	86.2%
TOTAL	6.03	0.80	-	52	86.1%

In addition to the OGS units and StormTech IR+ chamber systems, a sand berm will be constructed on the back slope of the south perimeter ditch system to promote infiltration and recharge to the existing watercourse. The sand berm will provide additional filtration treatment through infiltration of the sand layer.

7.6 Boundary Road Ditch Capacity

As indicated in section 7.4.2.3, the post-development flows from the site to the Boundary Roadside Ditch have been reduced from pre-development conditions. However, a capacity analysis was completed using Mannings equation to verify the ditch cross section fronting the development is adequately sized to convey the receiving runoff from the development and

upstream drainage areas. A summary of the flows and ditch conveyance capacity is provided in **Table 7.5**.

Table 7.5: Summary of Post-Development Peak Flows

Drainage Area	Contributing Area (ha)	Peak Flow (L/s)		
		2-year	5-year	100-year
North Pond	3.04	70.8	80.2	340.5
South Pond	2.99	40.9	44.4	57.7
Boundary Road North	0.342	33.9	45.8	88.7
Headwater Feature	1.346	113.4	153.6	304.2
Boundary Road South	0.236	26.5	35.8	69.1
Total	7.954	285.5	359.8	860.2
BR Ditch Capacity		1907.0		

Therefore, based on the analysis, the Boundary Road ditch cross section is adequately sized to convey runoff from the proposed development and upstream drainage areas. Refer to **Appendix C** for detailed calculations.

8.0 EROSION AND SEDIMENT CONTROL

Temporary erosion and sediment control measures will be implemented on-site during construction in accordance with the Best Management Practices for Erosion and Sediment Control. This includes the following temporary measures:

- Filter socks (catchbasin inserts) will be placed in existing and proposed catchbasins and catchbasin manholes and will remain in place until vegetation has been established and construction is completed.
- Silt fencing will be placed along the surrounding construction limits.
- Mud mats will be installed at the site entrances.
- Strawbale or rock check dams will be installed in swales and ditches.
- The contractor will be required to perform regular street sweeping and cleaning as required, to suppress dust and to provide safe and clean roadways adjacent to the construction site.

Erosion and sediment control measures should be inspected daily and after every rain event to determine maintenance, repair or replacement requirements. Sediments or granulars that enter site sewers shall be removed immediately by the contractor. These measures will be implemented prior to the commencement of construction and maintained in good order until vegetation has been established. Refer to the Erosion and Sediment Control Plan (Drawing 118168-ESC) for additional information.

9.0 CONCLUSIONS AND RECOMMENDATIONS

- The existing 100mm diameter dead end watermain fronting the development can service the proposed development for domestic use. A water storage tank and private fire suppression system will be installed to provide adequate volumes and flow to meet the fire demands for the proposed development.

- The site will be serviced by a private septic system. The detailed septic design has been completed by Paterson to treat a daily sewage volume of 4,000 L/day.
- The existing Boundary Road ditch can service the proposed development. Storage of stormwater will be provided on the building roof and within the perimeter swale / dry pond systems. Peak flows will be controlled to pre-development levels through the implementation of flow control roof drains and the pond outlet control structures.
- Stormwater quality control for the site will be provided through the implementation of Oil Grit Separator units combined with StormTech Isolator Row PLUS chambers to achieve 80% TSS removal using the ETV particle size distribution.
- The overland flow route to the Boundary Road ditch will be maintained.
- Erosion and sediment control measures will be implemented prior to and during construction.

10.0 CLOSURE

The preceding report is respectfully submitted for review and approval. Please contact the undersigned should you have questions or require additional information.

NOVATECH

Prepared by:

Prepared / Reviewed by:



Olivia Renn, P.Eng.
Project Engineer | Water Resources

Matt Hrehoriak, P.Eng.
Project Manager | Land Development Engineering

APPENDIX A

Water Servicing Information

Domestic Water Demands

Daily Demands from OBC Table 8.2.1.3

Establishment	Daily Demand Volume	
Industrial :	150	L/day/loading bay
Commercial	75	L/ea 9.3m ² of floor space

Industrial Peaking Factors City of Ottawa Water Distribution Guidelines

Conditions	Peaking Factor	
Maximum Day	1.5	x avg day
Peak Hour	1.8	x max day

Proposed Development Conditions

	Office Area (m ²)	No. Loading Bays	Avg Day (L/s)	Max Day (L/s)	Peak Hour (L/s)
Commercial Flows	642		0.06	0.09	0.16
Industrial Flows		116	0.20	0.30	0.54
Totals			0.26	0.39	0.70

FUS - Fire Flow Calculations

As per 2020 Fire Underwriter's Survey Guidelines




Novatech Project #: 118168
 Project Name: 5510 Boundary Road
 Date: 7/3/2024
 Input By: Matt Hrehoriak
 Reviewed By:

Legend

Input by User
 No Information or Input Required

Building Description: Single Story Warehouse
 Non-combustile construction

Step			Input		Value Used	Total Fire Flow (L/min)	
Base Fire Flow							
1	Construction Material			Multiplier		0.8	
	Coefficient related to type of construction C	Type V - Wood frame		1.5	0.8		
		Type IV - Mass Timber		Varies			
		Type III - Ordinary construction		1			
		Type II - Non-combustible construction	Yes	0.8			
		Type I - Fire resistive construction (2 hrs)		0.6			
2	Floor Area					12,000	
	A	Building Footprint (m ²)	4400				
		Number of Floors/Storeys	1				
		Area of structure considered (m ²)	4,400				
	F	Base fire flow without reductions					
	$F = 220 C (A)^{0.5}$						
Reductions or Surcharges							
3	Occupancy hazard reduction or surcharge			Reduction/Surcharge		12,000	
	(1)	Non-combustible		-25%	0%		
		Limited combustible		-15%			
		Combustible	Yes	0%			
		Free burning		15%			
		Rapid burning		25%			
4	Sprinkler Reduction (100% sprinkler coverage of building used)			Reduction		-3,600	
	(2)	Adequately Designed System (NFPA 13)	Yes	-30%	-30%		
		Standard Water Supply	No	-10%			
		Fully Supervised System	No	-10%			
		Cumulative Total			-30%		
5	Exposure Surcharge (cumulative %, Maximum Exposure Adjstement Charge Used)			Surcharge		0	
	(3)	North Side	> 45.1m		0%		
		East Side	> 45.1m		0%		
		South Side	> 45.1m		0%		
		West Side	> 45.1m		0%		
		Cumulative Total			0%		
Results							
6	(1) + (2) + (3)	Total Required Fire Flow, rounded to nearest 1000L/min			L/min	8,000	
		(2,000 L/min < Fire Flow < 45,000 L/min)			or	L/s	133
					or	USGPM	2,114
7	Storage Volume	Required Duration of Fire Flow (hours)			Hours	2	
		Required Volume of Fire Flow (m ³)			m ³	960	

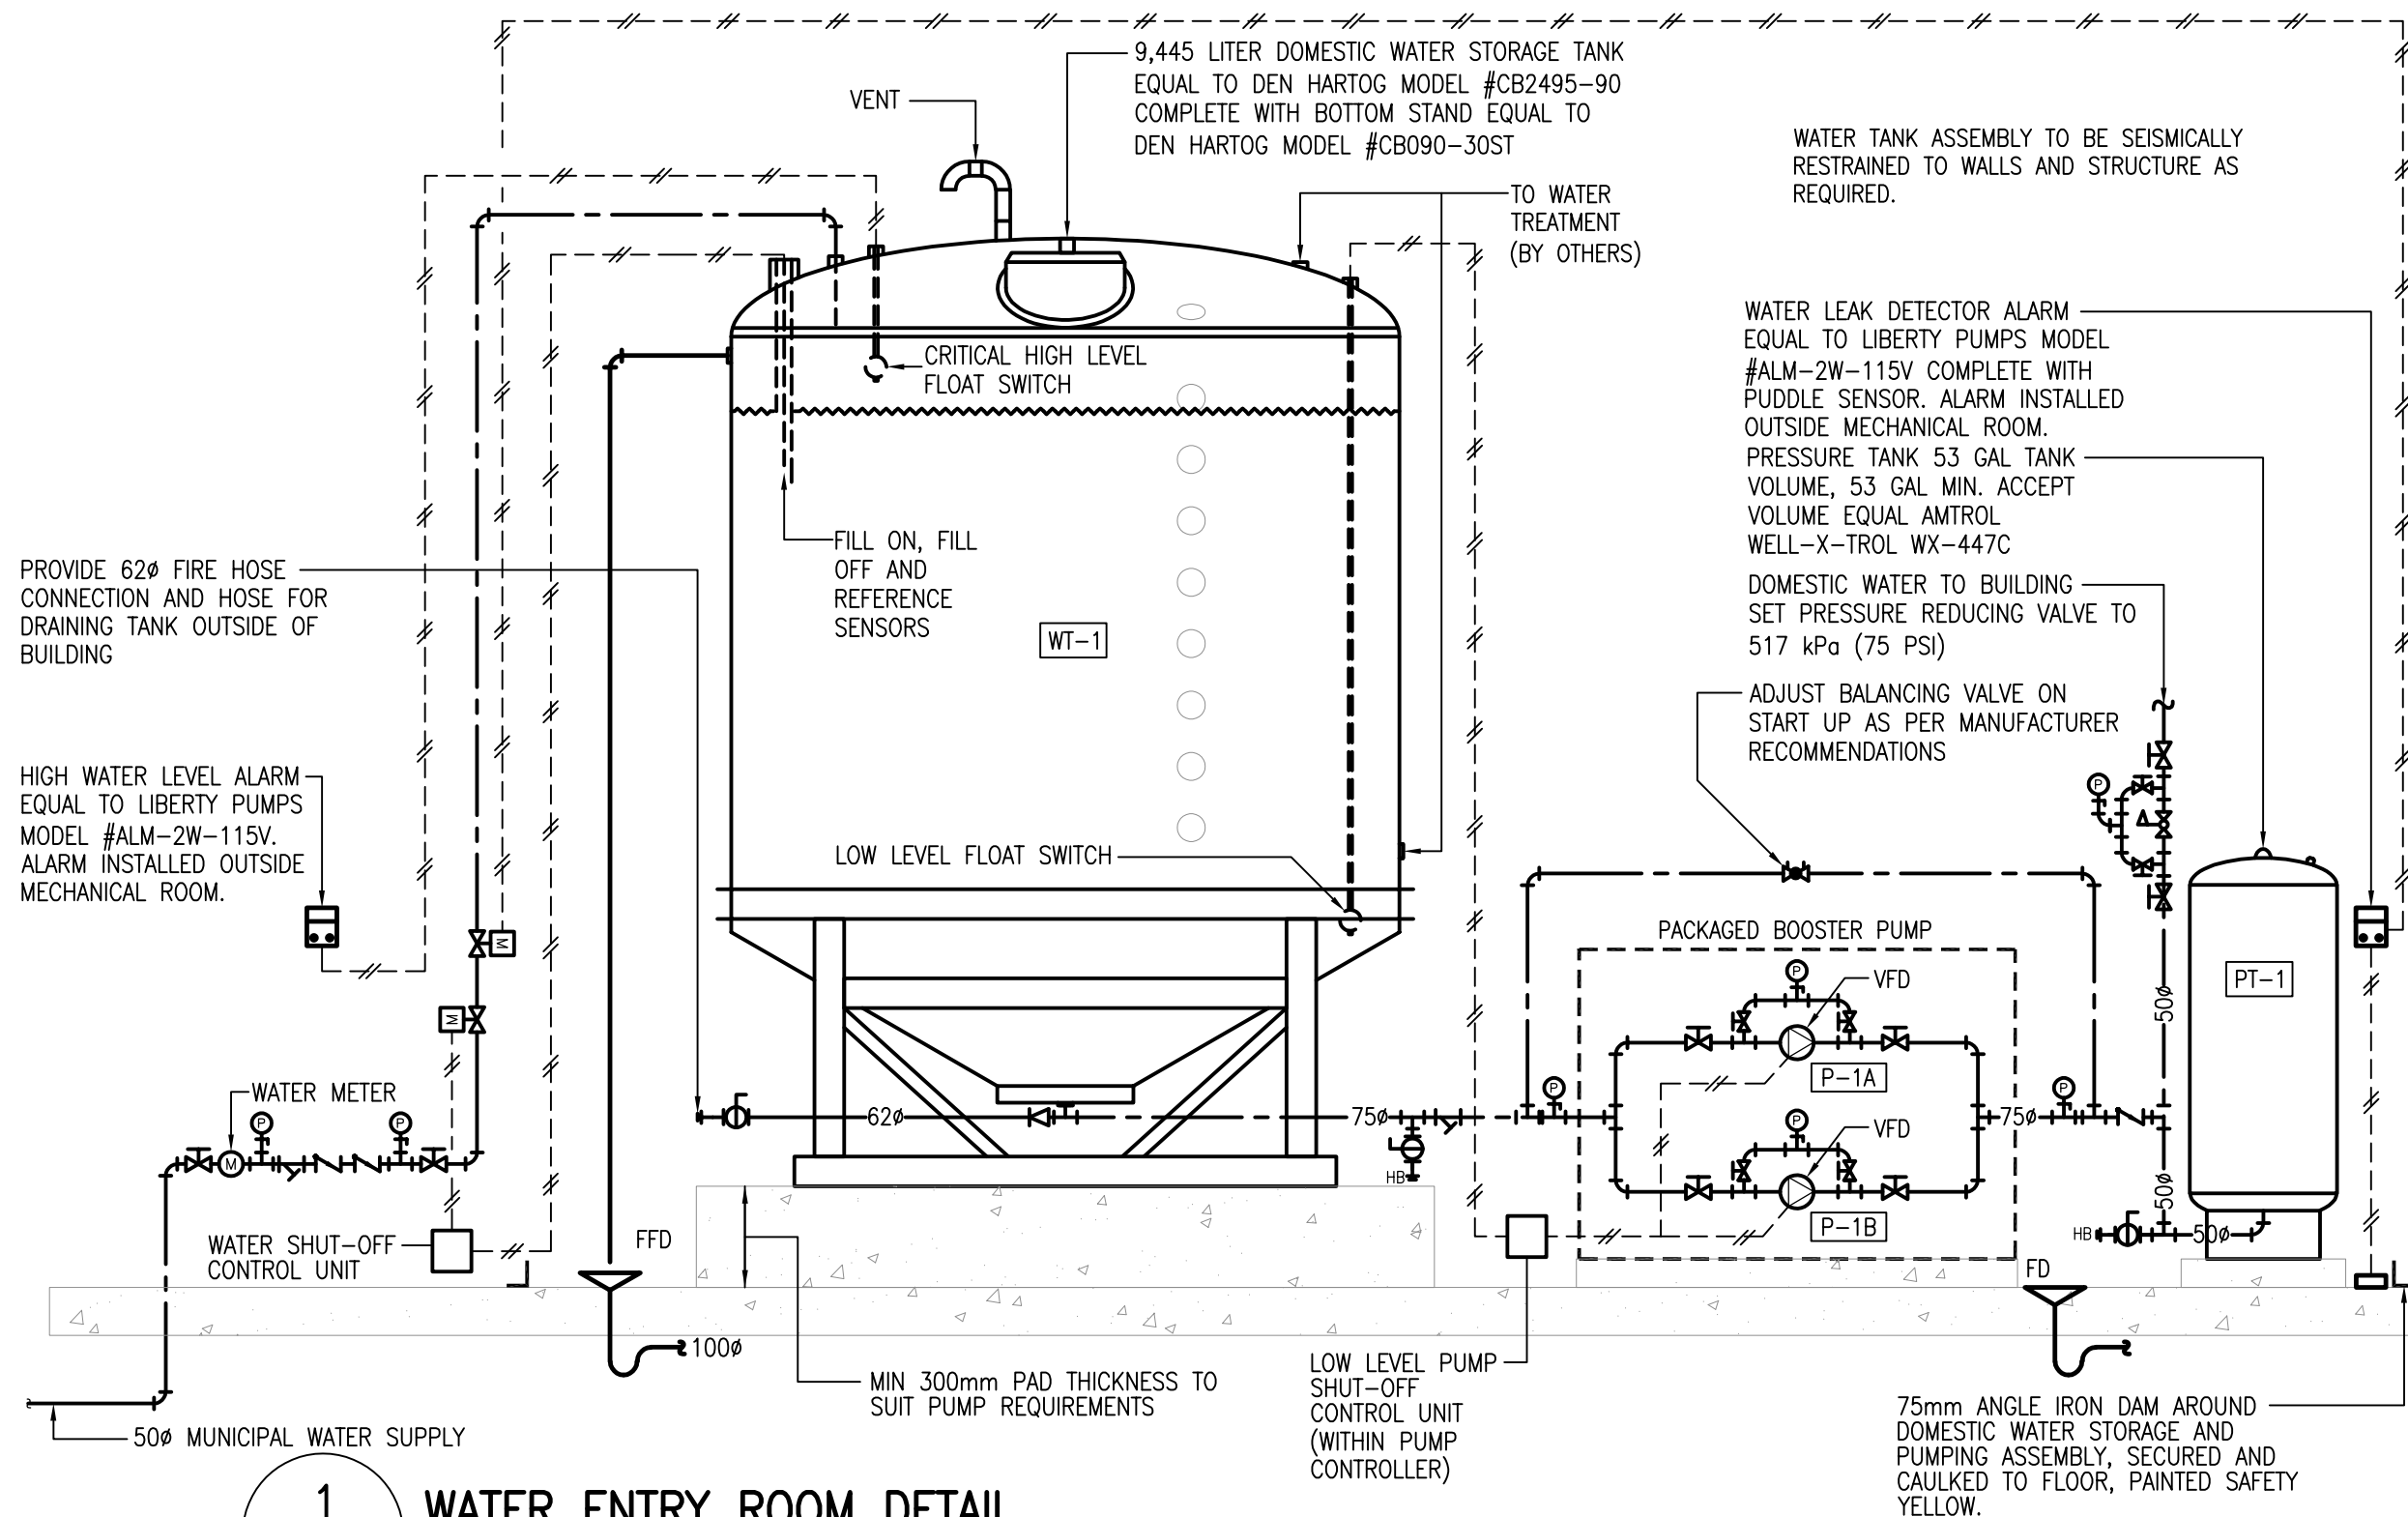

1
M003

WATER ENTRY ROOM DETAIL

N.T.S.

1.	ISSUED FOR SITE PLAN APPLICATION	SEPT 18/24
NO.	REVISION	DATE



PROJECT: **DAY & ROSS**
5494-5510 BOUNDARY ROAD GLOUCESTER, ON

DRAWING NAME: **WATER ENTRY ROOM DETAIL**

SCALE:
N.T.S.


DRAWING No.
Part of M003

JOB No.
24052

APPENDIX B

Sanitary Servicing Information

REFER TO PATERSON GROUP
DRAWING No. PH4942-1(rev.1)
FOR SEWAGE SYSTEM LAYOUT

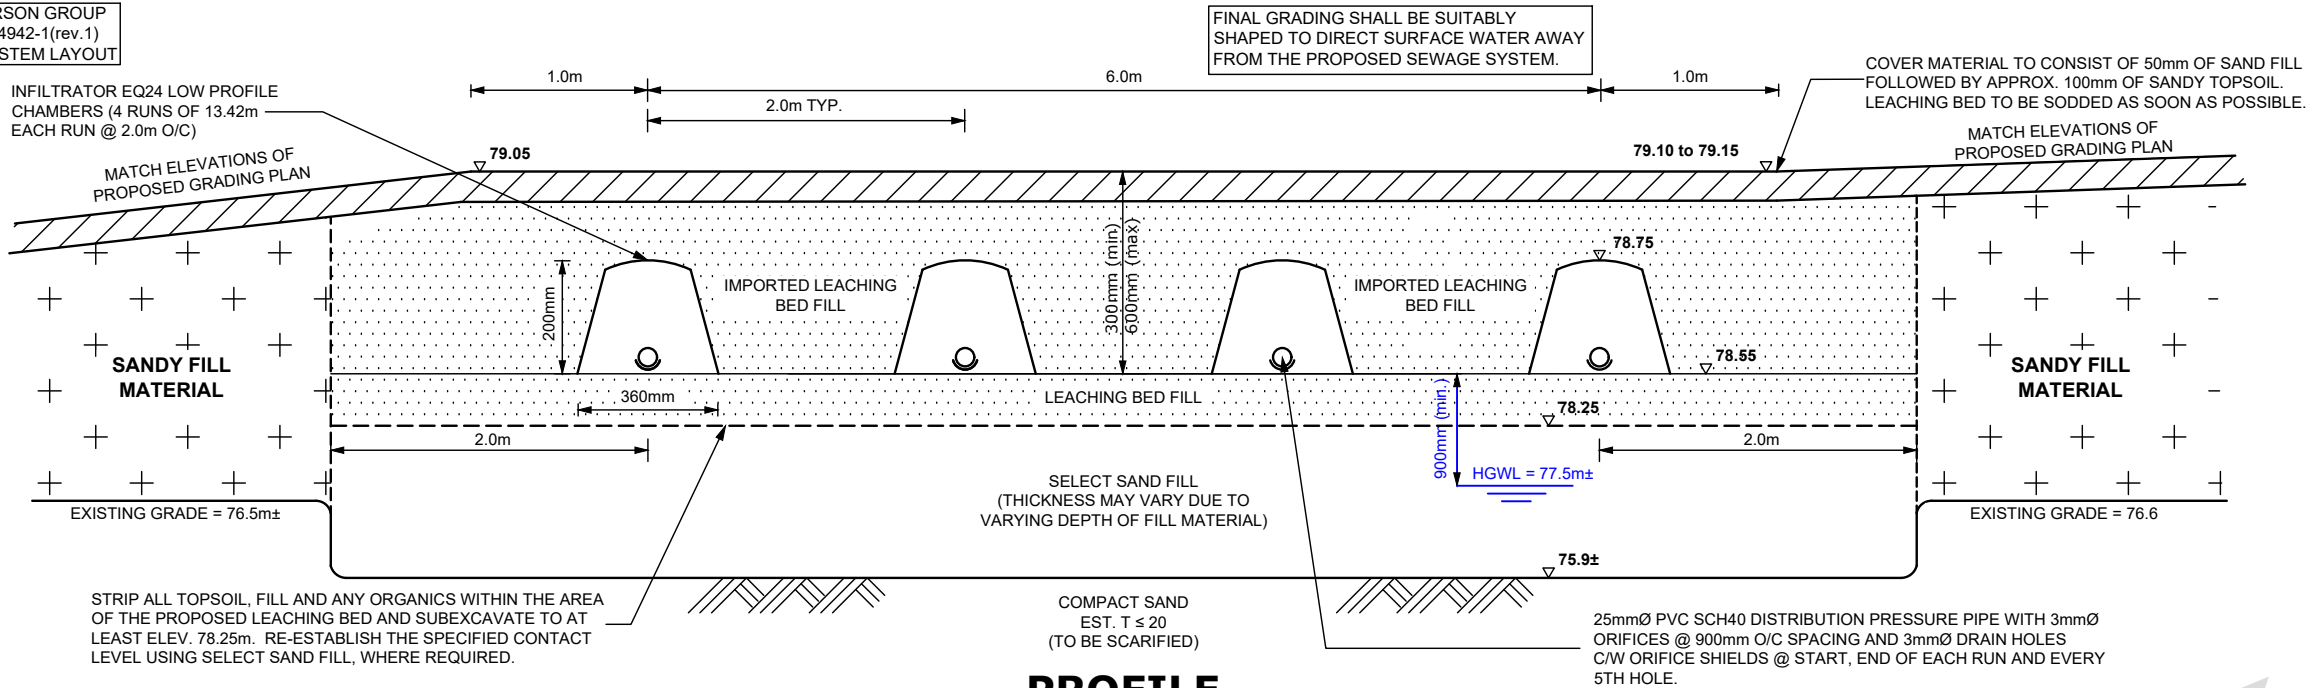

NOTES:

1) ESTIMATE OF DAILY SEWAGE FLOW (Q)

TOTAL DESIGN DAILY SANITARY SEWAGE FLOW (T.D.D.S.S.F) HAS BEEN DESIGNED IN ACCORDANCE WITH ONTARIO BUILDING CODE (OBC) TABLE 8.2.1.3.B. AND HAS BEEN REVIEWED / PRE-APPROVED BY THE OTTAWA SEPTIC SYSTEM OFFICE. (OSSO)

- OFFICE EMPLOYEES @ 75 L/DAY = 5 x 75 L/DAY = 375 L/DAY
- FACTORY TYPE EMPLOYEES w SHOWERS @ 125 L/DAY = 29 x 125 L/DAY = 3,625 L/DAY

TOTAL SEWAGE FLOW = 4,000 L/DAY

2) SOIL CONDITIONS

SOILS INFORMATION GATHERED BY PATERSON GROUP INC. ON AUGUST, 2018 (REFER TO PGI REPORT No. PG4592-1)

BH 3, ELEV. 77.67m		TP 9 ELEV. 78.17m	
0-0.05	TOPSOIL	0-3.50	FILL: BROWN, SILTY SAND, SOME CLAY
0.05-1.83	FILL: BROWN SILTY CLAY, SOME SAND		GRAVEL, COBBLES, BOULDERS AND
1.83-2.44	COMPACT BROWN SAND		CONSTRUCTION DEBRIS
2.44-9.75	SOFT GREY SILTY CLAY		

- G.W.L. @ 1.29m (76.4m±) - G.W.L. @ 0.65m (77.52m±)

3) ANAEROBIC DIGESTER

- REFER TO WATERLOO DESIGN AND INSTALLATION GUIDE WITH REGARDS TO MINIMUM TANKAGE SIZING, AND ADDITIONAL INSTALLATION REQUIREMENTS.
- TANK SHALL BE CONNECTED TO THE PROPOSED BUILDING BY A 100mm PVC SEWER PIPE.
- SEWER PIPE SHALL BE INSTALLED AT 2.0% MINIMUM SLOPE AND SHALL BE OVERLAIN WITH 50mm T x 600 mm WIDE RIGID INSULATION BOARDS.
- SEWER PIPE SHALL BE SLEEVED THROUGH A 150mm Ø SDR 28 PVC PIPE UNDER ANY HARDSCAPING (CONCRETE, ASPHALT, ETC.).
- SEWER PIPE SHALL BE BEDDED ON A LAYER OF OPSS GRANULAR 'A' WHICH SHALL BE COMPACTED TO 95% SPMD.
- IT IS RECOMMENDED THAT A NEW SINGLE-COMPARTMENT 10,000L CONCRETE ANAEROBIC DIGESTER WATERLOO MODEL ADIPC-10,000 BE INSTALLED.
- TANK SHALL BE BEDDED ON A LAYER OF OPSS GRANULAR 'A' OF AT LEAST 150mm IN THICKNESS AND SHALL BE COMPACTED TO AT LEAST 95% SPMD.
- TANK SHALL BE EQUIPPED WITH WATERTIGHT CONNECTIONS (I.E. STAINLESS LINK SEALS OR APPROVED EQUIVALENT).
- INLET PIPE OF DIGESTER SHALL BE EQUIPPED WITH A 800L (min.) WATERLOO INNER TUBE.
- THE DIGESTER TANK SHALL BE COVERED WITH 50mm (2") DOW HI-40 INSULATION BOARDS AND SHALL BE PROVIDED WITH 510 mm OF SOIL COVER PER THE DESIGN MANUAL.
- A POLY RISER AND INSULATED COVER ASSEMBLY, WHICH EXTENDS TO THE GROUND SURFACE, SHALL BE INSTALLED OVER THE EACH OF THE TANK OPENINGS.
- INTERNAL PUMP VAULT WITH, TIME CONTROLLED EFFLUENT PUMP (WATERLOO SPECIFIED EFFLUENT PUMP) OPERATED BY A WATERLOO SMART PANEL.
- ALL ELECTRICAL WORKS SHALL BE CARRIED OUT BY A QUALIFIED ELECTRICAL CONTRACTOR.
- ACCESS LIDS SHALL INCLUDE SAFETY DEVICES AS PER CSA B66-21.

4) TREATMENT UNIT

- THE TREATMENT UNIT SHALL BE INSTALLED IN SERIES AND DOWNSTREAM FROM THE ANAEROBIC DIGESTER TANK.
- THE TREATMENT UNIT SHALL CONSIST OF A BULK FILLED CONCRETE WATERLOO BIOFILTER MODEL BFCN-9,400 WASTEWATER TREATMENT.
- TANK SHALL BE BEDDED ON A LAYER OF OPSS GRANULAR 'A' OF AT LEAST 150mm IN THICKNESS AND SHALL BE COMPACTED TO AT LEAST 95% SPMD.
- A 50mm Ø SCH 40 PVC FORCEMAIN SHALL BE USED TO CARRY THE EFFLUENT FROM THE PUMP TANK IN THE ANAEROBIC DIGESTER TO THE BULK FILLED BIOFILTER IN THE FIRST COMPARTMENT OF THE TREATMENT UNIT.

- THE FIRST COMPARTMENT OF THE BIOFILTER TANK SHALL BE BULK FILLED WITH THE BIOFILTER FOAM FILTER MEDIA.
- THE SECOND COMPARTMENT OF THE TREATMENT UNIT SHALL BE EQUIPPED WITH A TIME OPERATED DUPLEX EFFLUENT PUMPS SPECIFIED BY WATERLOO. THE FINAL TREATED EFFLUENT COLLECTS ON THE FLOOR OF THE SECOND COMPARTMENT AND THE EFFLUENT PUMP, Doses THE LEACHING BED.
- MINIMUM RESIDUAL PRESSURE HEAD AT THE FURTHEST POINT FROM THE PUMP SHALL BE 600mm TO BE VERIFIED IN THE FIELD.
- THE DOSING TIME OPERATED DUPLEX PUMPING SYSTEM SHALL OPERATE HOURLY AND SHALL ALTERNATE BETWEEN THE LEACHING BED "CELLS".
- THE RECOMMENDED PUMP TIME DOSING CYCLE IS 167L + CHARGE (28L) (TOTAL OF 195 L), THE PUMP DISCHARGE TAKES A DURATION OF 75 SECONDS FOR EACH PUMP.
- THE TREATMENT UNIT SHALL BE PROVIDED WITH A MINIMUM OF 510 mm SOIL COVER AND OVERLAIN WITH 50mm THICK HI INSULATION BOARDS.
- A POLYLOK RISER AND CHARCOAL VENTED INSULATED COVER ASSEMBLY, WHICH EXTENDS TO THE GROUND SURFACE, SHALL BE INSTALLED OVER EACH OF THE TANK OPENINGS.
- ALL ELECTRICAL WORKS SHALL BE CARRIED OUT BY A QUALIFIED ELECTRICAL CONTRACTOR.
- ACCESS LIDS SHALL INCLUDE SAFETY DEVICES AS PER CSA B66-21.

5) FORCEMAIN (TO SHALLOW BURIED TRENCH)

- 2 x 50mm Ø SCH40 PVC FORCEMAINS SHALL BE USED TO CARRY THE EFFLUENT FROM THE TREATMENT UNIT TO THE DISPOSAL FIELD.
- THE FORCEMAINS SHALL BE INSTALLED TO GRAVITY DRAIN TO TREATMENT UNIT AND OVERLAY WITH 50mm T x 600mm W WITH INSULATION BOARDS.
- FORCEMAIN SHALL BE INSTALLED ON A 150mm THICK LAYER OF COMPACTED SAND BEDDING.

6) DISPOSAL FIELD

- THE DISPOSAL FIELD SHALL CONSIST OF SHALLOW BURIED TRENCHES (SBT) USING QUICK 4 EQ24 LOW PROFILE INFILTRATOR CHAMBERS.
- SBT LENGTH REQUIRED = $Q/50 = 4000/75 = 53.3$ LINEAR METERS/1.22 = 43.7 CHAMBERS.
- USE 4 RUNS OF 11 CHAMBERS, 44 CHAMBERS TOTAL (13.42m LENGTH EACH RUN) FOR A TOTAL LENGTH OF 53.7 LINEAR METRES.
- REMOVE ALL EXISTING TOPSOIL, FILL AND ANY ORGANIC MATERIAL AND SUBEXCAVATE TO AT LEAST ELEVATION 78.25m, ACTUAL FILL REMOVAL WILL BE TO APPROXIMATELY 75.9m±, WHICHEVER IS GREATER. ESTABLISH THE SPECIFIED CONTACT LEVEL WITH SELECT SAND FILL, WHERE REQUIRED.
- SCARIFY THE BASE AND SIDES OF EXCAVATED AREA USING A HAND RAKE. DO NOT WALK ON THE SCARIFIED SURFACES.
- ESTABLISH THE SPECIFIED CONTACT LEVEL, ELEV. 78.55m, WITH LEACHING BED FILL OVER THE APPROVED SUBGRADE SURFACE.
- LEACHING BED SAND FILL SHALL BE UNIFORM SAND WITH GRADING LIMITS SIMILAR TO 100% PASSING 13.2mm SIEVE, LESS THAN 5% PASSING 0.075mm SIEVE AND HAVING A PERCOLATION RATE OF 6 TO 8 min/cm.
- PREPARE THE 25mm Ø PVC SCH 40 PRESSURE PIPE BY DRILLING 3mm Ø HOLES @ 900mm SPACINGS ALONG THE TOP OF THE PIPE (I.E. 12 O'CLOCK POSITION). THE FIRST HOLE SHALL BE LOCATED 450mm FROM THE MANIFOLD.
- DRILL A 3mm Ø (1/8") DRAIN HOLE NEAR THE START, END OF EACH RUN AND EVERY 5TH HOLE. THE DRAIN HOLES SHOULD BE LOCATED AT THE 6 O'CLOCK POSITION. AN ORIFICE SHIELD SHALL BE INSTALLED OVER EACH DRAIN HOLE.
- THE PRESSURE PIPE SHALL BE INSTALLED ONTO THE PREPARED SAND LAYER @ DESIGN ELEVATION AND IN THE CONFIGURATION AS SPECIFIED ON THE PLAN VIEW. PIPES SHALL REST ON ORIFICE SHIELDS.
- THE PRESSURE SYSTEM MUST BE TESTED AND SQUIRT HEIGHTS VERIFIED PRIOR TO INSTALLING THE CHAMBERS.
- RUN THE PRESSURE PIPE THROUGH THE END PLATE OF THE CHAMBER.
- PLACE THE FIRST CHAMBER OVER THE PIPE AND ENSURE THE HOLES IN THE PRESSURE PIPE ARE FACING UP (I.E. 12 O'CLOCK POSITION).
- INSERT THE END PLATE TO THE FIRST CHAMBER.
- CONNECT EACH SUBSEQUENT CHAMBER TO THE END OF THE PROCEEDING CHAMBER. ENSURE THAT THE CHAMBERS ARE PROPERLY INTERLOCKED AS PER MANUFACTURER'S REQUIREMENTS.
- ATTACH AN END PLATE TO THE END OF EACH CHAMBER RUN.
- TO ALLOW FOR SERVICING, IT IS RECOMMENDED THAT THE END OF EACH PRESSURE PIPE BE SLEEVED THROUGH THE END PLATE AND BE FITTED WITH A 25mm Ø PVC LONG RADIUS 90° SWEEP C/W 1-25mm Ø PVC FPT x SLIP FIT ADAPTER AND 1-MPT PVC END CAP, COVER CLEAN-OUT ASSEMBLY WITH 150mm Ø IRRIGATION VALVE COVER (OR APPROVED EQUAL).

- BACKFILL THE CHAMBERS IN LIFTS, USING SELECT SAND FILL. BACKFILL MUST CONSIST OF SELECT SAND FILL FOLLOWED BY 100mm OF SANDY TOPSOIL. IT IS RECOMMENDED THAT THE LEACHING BED AREA BE SODDED AS SOON AS POSSIBLE.
- START BACKFILLING AT THE JOINTS, COMPACT THE BACKFILL ALONG THE SIDE OF THE CHAMBERS BY WALKING ALONG THE EDGES OF THE TRENCHES.
- THE GROUND SURFACE OVER THE LEACHING BED SHOULD BE CROWNED TO SHED SURFACE WATER AND SODDED IMMEDIATELY.

7) MINIMUM CLEARANCE DISTANCE FROM LEACHING BED

- 7.1m FROM ANY PROPERTY LINE
- 9.1m FROM ANY STRUCTURE
- 19.1m FROM ANY EXISTING DRILLED WELL

8) MINIMUM CLEARANCE DISTANCE FROM TANK(S)

- 1.5m FROM ANY STRUCTURE
- 15.0m FROM ANY DRILLED OR DUG WELL
- 3.0m FROM ANY PROPERTY LINE

9) GENERAL

- SNOW STORAGE SHALL NOT BE LOCATED OVER PROPOSED SEWAGE SYSTEM.
- THE SEWAGE SYSTEM HAS NOT BEEN DESIGNED TO SUPPORT TRAFFIC LOADING.
- THE BACKFILLING OF THE SEWAGE SYSTEM SHOULD MINIMIZE THE RISK OF OVER COMPACTION WITH THE USE RUBBER TRACKED EQUIPMENT AND BY AVOIDING THE CREATION OF ANY CONSTRUCTION ROUTES OR PATHWAYS OVER THE SYSTEM.
- ANY NEW IRRIGATION / SPRINKLER SYSTEM SHOULD NOT BE USED IN PROXIMITY OF THE PROPOSED SEWAGE SYSTEM.
- ENSURE WALKWAYS AND/OR SHRUBBERY ARE NOT PLACED WITHIN PROXIMITY OF THE TANKAGE.
- THE BACKWASH WATERS FROM ANY WATER TREATMENT UNIT, SUCH AS WATER SOFTENER, SHOULD NOT DISCHARGE INTO THE SEWAGE SYSTEM.
- THE SEWAGE SYSTEM HAS NOT BEEN DESIGNED FOR THE USE OF A GARBAGE DISPOSAL.
- SEWAGE SYSTEM INSTALLER SHALL BE QUALIFIED AND REGISTERED UNDER PART 8 OF THE ONTARIO BUILDING CODE AND SHALL BE AN AUTHORIZED WATERLOO TREATMENT SYSTEM INSTALLER.
- ALL WORK SHALL BE CARRIED OUT IN ACCORDANCE WITH THE LATEST BY-LAWS, CODES AND REGULATIONS.
- CONTRACTOR SHALL REVIEW DRAWINGS IN DETAIL AND SHALL INFORM THE CONSULTANT OF ANY ERRORS AND/OR OMISSIONS ON DESIGN DRAWINGS IMMEDIATELY.
- CONTRACTOR SHALL BE RESPONSIBLE TO LOCATE AND PROTECT ALL EXISTING UNDERGROUND SERVICES.
- CONTRACTOR SHALL VISIT THE SITE AND REVIEW ALL DOCUMENTATION TO BECOME FAMILIAR WITH THE SITE AND SUBSURFACE SOIL CONDITIONS TO DETERMINE SUITABLE METHODS OF CONSTRUCTION.
- THE MANUFACTURER PROVIDES A LIMITED WARRANTY OF THE SYSTEM COMPONENTS. THE OWNER OF THE SYSTEM MUST SIGN A MAINTENANCE AGREEMENT WITH THE MANUFACTURER'S REPRESENTATIVE. THE SYSTEM OWNER IS RESPONSIBLE FOR THE ANNUAL FEES ASSOCIATED WITH THE MAINTENANCE.
- THE FIRM OF PATERSON GROUP INC. HAS PROVIDED DESIGN SERVICES ONLY FOR THE SUBJECT SEWAGE SYSTEM. THE DESIGN HAS BEEN CARRIED OUT IN ACCORDANCE WITH THE MANUFACTURER'S GUIDELINES AND OUR INTERPRETATION OF PART 8 OF THE ONTARIO BUILDING CODE.
- THE PROPERTY LINE / SEPARATION DISTANCES SHOULD BE CONFIRMED PRIOR TO CONSTRUCTION.
- CONSTRUCTION INSPECTIONS DURING THE INSTALLATION OF THE SEWAGE SYSTEM MAY BE REQUIRED BY THE REGULATING AUTHORITY AND ARE STRONGLY RECOMMENDED BY THIS FIRM. IF THIS FIRM IS TO COMPLETE ANY CONSTRUCTION INSPECTION(S), ADDITIONAL FEES MAY BE APPLIED. CONFIRMATION OF PAYMENT WILL BE REQUIRED PRIOR TO THE INSPECTION.
- THE TEST HOLE INFORMATION PROVIDED, IS INTENDED TO BE USED FOR DESIGN PURPOSES ONLY, AND SHOULD NOT BE RELIED UPON FOR CONSTRUCTION PURPOSES. IF DISCREPANCIES ARE FOUND DURING THE CONSTRUCTION PROCESS, IT IS THE CLIENT'S RESPONSIBILITY TO CONTACT THIS FIRM TO MAKE ANY NECESSARY COMMENTS OR REVISIONS. ADDITIONAL REVISIONS ARE NOT CONSIDERED PART OF THE DESIGN WORKS AND WILL BE CONSIDERED AS AN ADDITIONAL COST.

PROFILE

N.T.S.

22/08/24	Reviser Dispersal Bed	1
14/08/24	Issued for Preliminary Review	0
DD/MM/YY	DESCRIPTION	REV.

Consultant:



Client:

**DAY AND ROSS
TRANSPORTATION**

Project:

**PROPOSED CROSS
DOCK BUILDING**

**5510 BOUNDARY ROAD
OTTAWA (CARLSBAD SPRINGS), ONTARIO**

Drawing:

**SEWAGE SYSTEM
DETAIL & NOTES**

Scale:	N.T.S.	Drawn by:	KB
Date:	08/2024	Checked by:	HV

Drawing No.:


PH4942-2(rev.1)

p:\autocad drawings\hydrogeology\ph49xx\ph4942 - day and ross
transportation - 5510 boundary road\ph4942-2(rev.1).dwg

APPENDIX C

Stormwater Management Calculations

M:\2018\118168\CAD\Design\Figures\118168-EXSWM rev2.dwg, EX SWM, Nov 13, 2025 - 3:29pm, rkargus

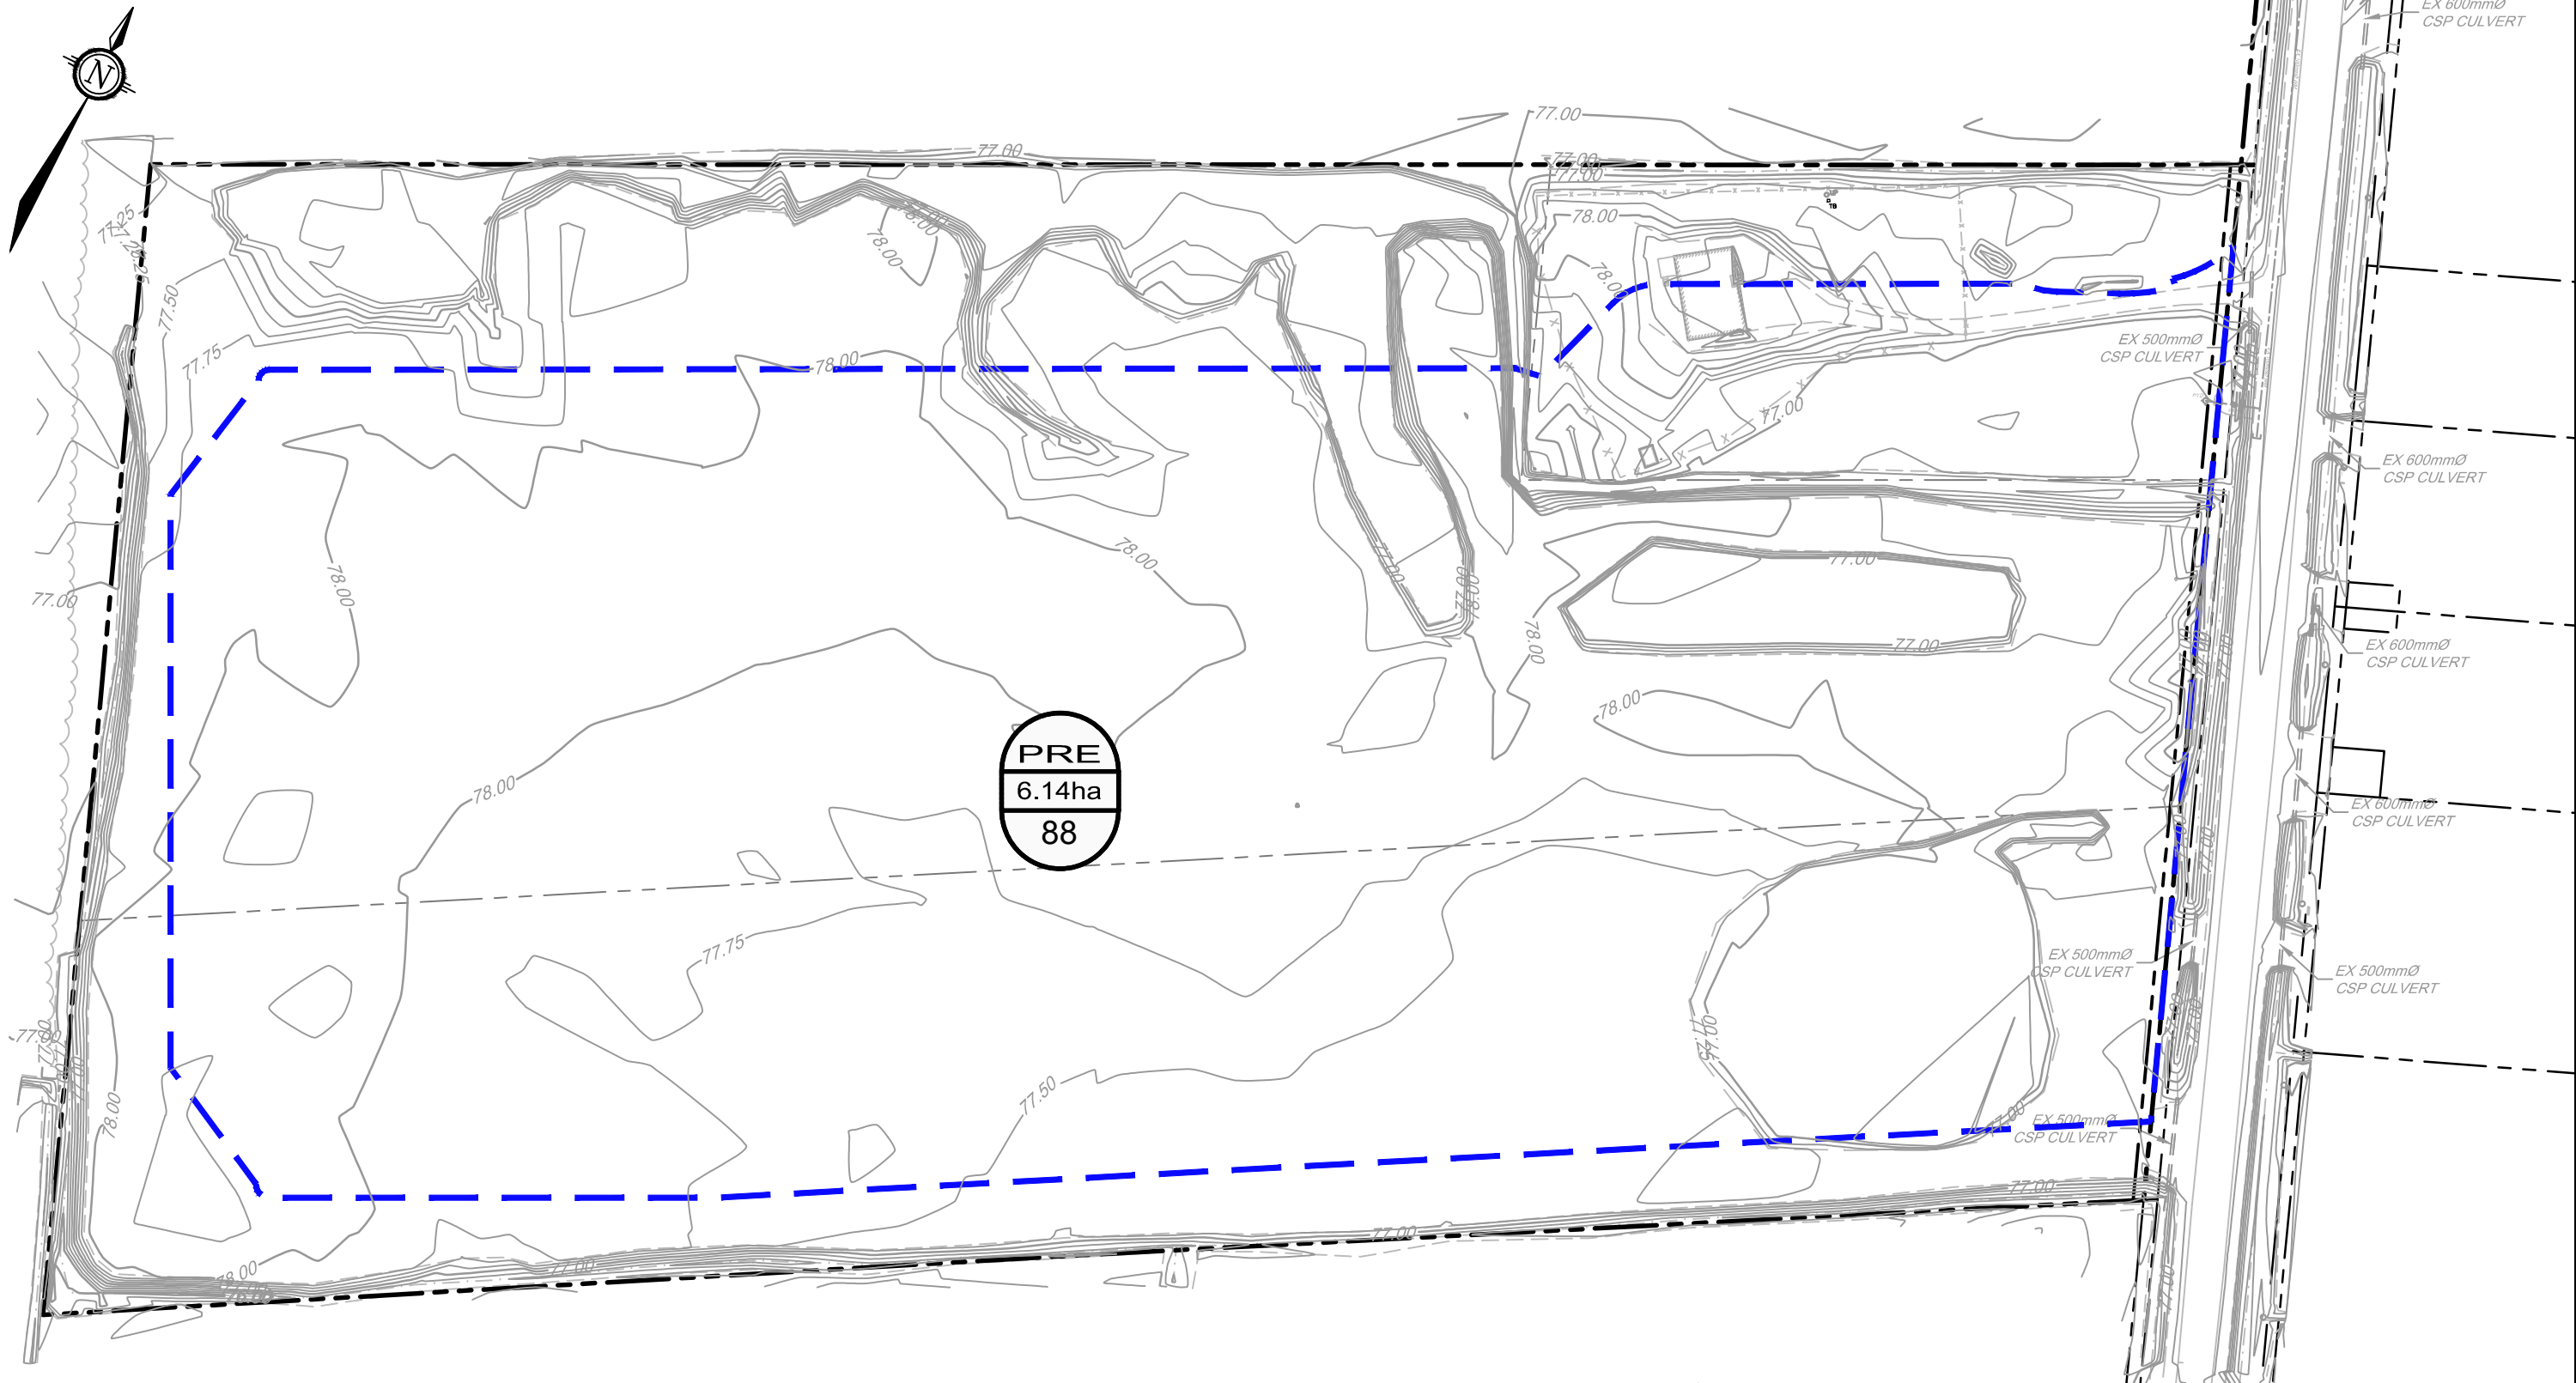

LEGEND

--- EXISTING STORM DRAINAGE AREA



DRAINAGE AREA ID
DRAINAGE AREA (ha)
SCS CURVE NUMBER

NOVATECH

Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com


5510 BOUNDARY ROAD

PRE-DEVELOPMENT DRAINAGE AREA PLAN

SCALE 1 : 1250

DATE NOV 2025 JOB 118168 FIGURE 4

CUT11V17 DWG 270mm x 12mm

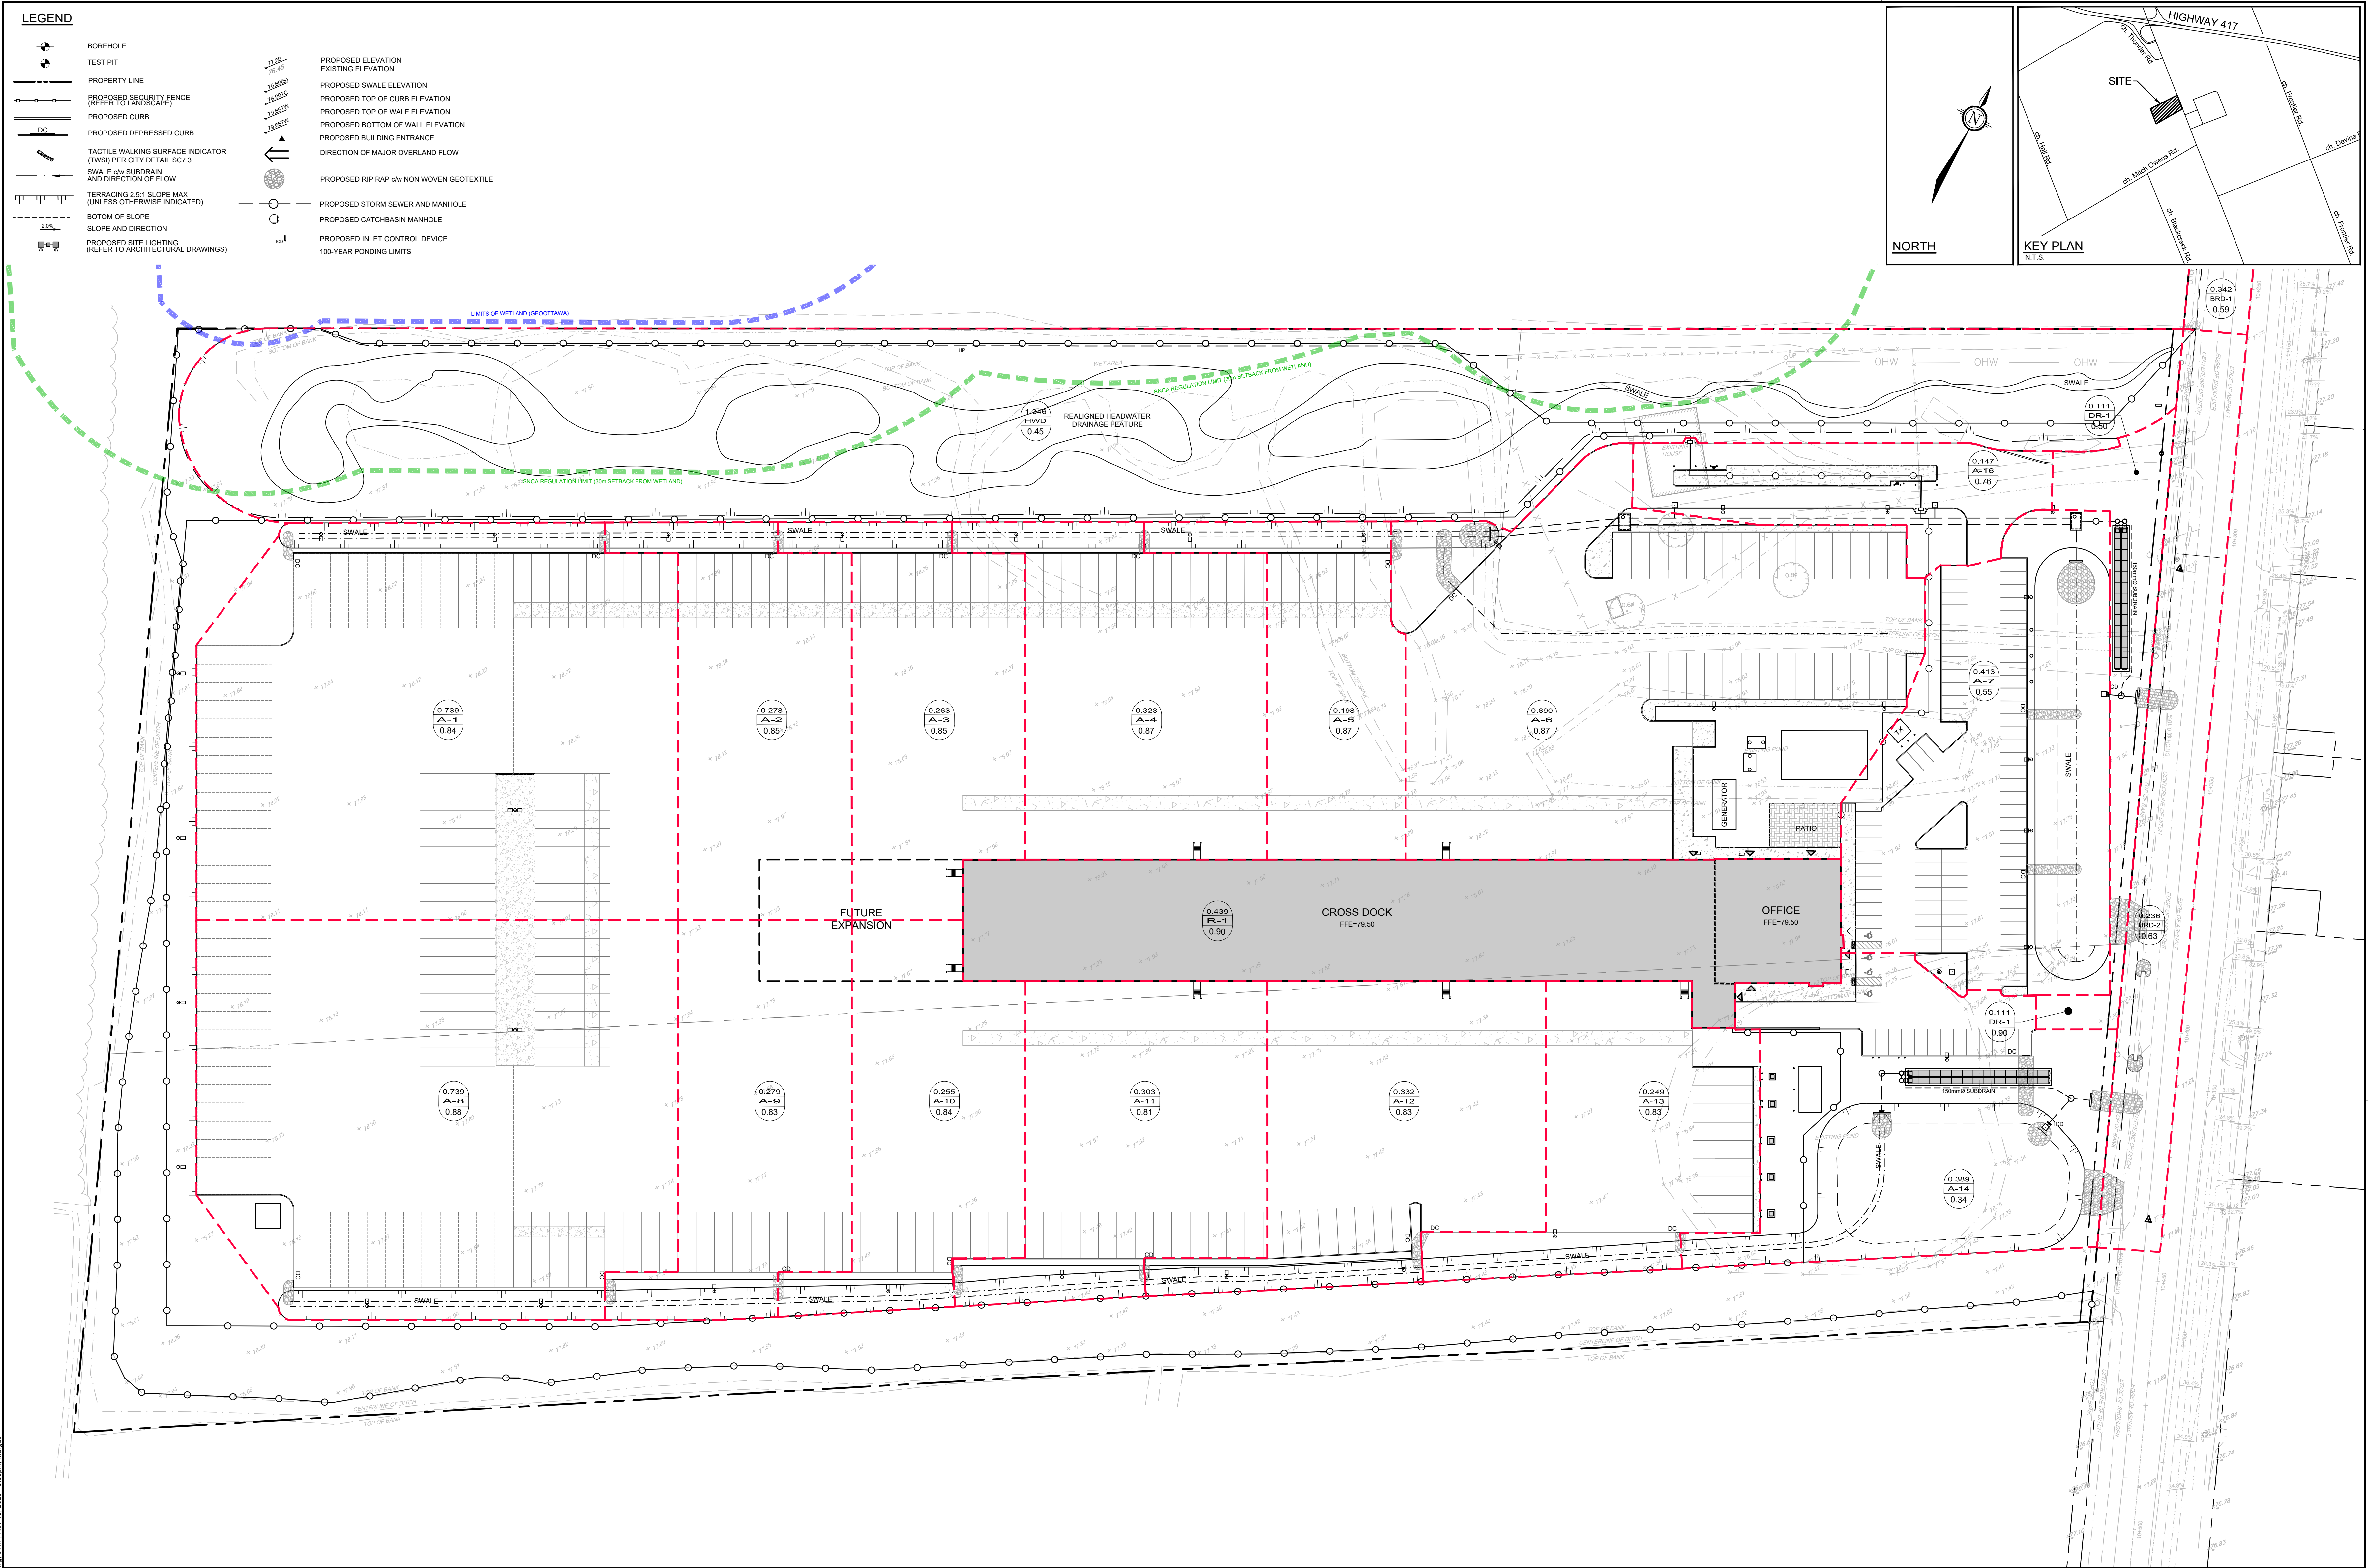

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS,
WATERMANS, SEWERS AND OTHER
UNDERGROUND AND OVERGROUND UTILITIES AND
STRUCTURES IS NOT NECESSARILY SHOWN ON
THE CONTRACT DRAWINGS, AND WHERE SHOWN,
THE ACCURACY OF THE POSITION OF SUCH
UTILITIES AND STRUCTURES IS NOT GUARANTEED.
BEFORE STARTING WORK, DETERMINE THE EXACT
LOCATION OF ALL SUCH UTILITIES AND
STRUCTURES AND ASSUME ALL LIABILITY FOR
DAMAGE TO THEM.

**NOT FOR
CONSTRUCTION**

No.	REVISION	DATE	BY
2	REVISED PER CITY AND SNCA COMMENTS	NOV 13/2025	MJH
1	ISSUED FOR SPA	OCT 3/2024	MJH

SCALE

1:500

0 5 10 15 20

DESIGN	FOR REVIEW ONLY
MJH	
JLS	
MJH	
JLS	
MJH	

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

LOCATION
CITY OF OTTAWA
5110 BOUNDARY ROAD


DRAWING NAME
**STORMWATER MANAGEMENT
PLAN**

PROJECT No. 118168
REV # 2
DRAWING No. 118168-SWM


Overall Model Schematic




Catchment IDs

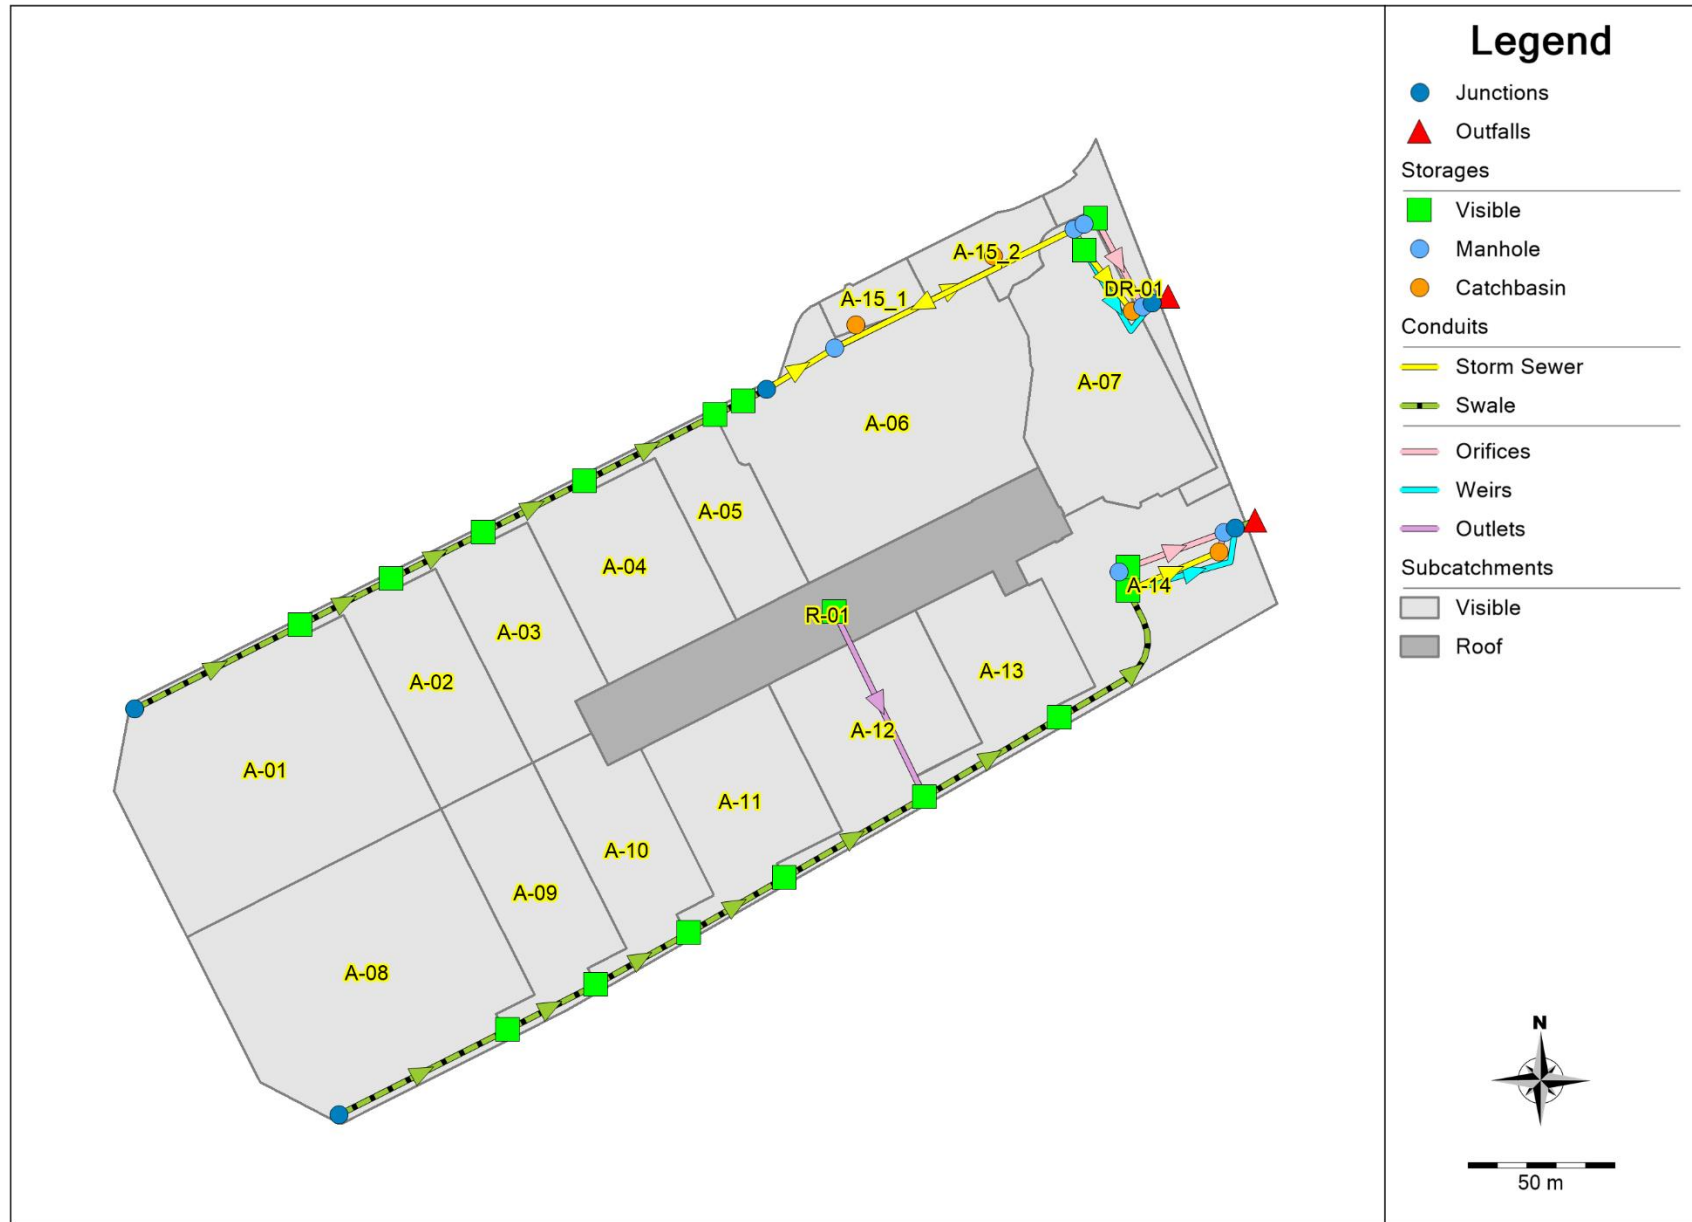

Catchbasins, Manholes, Storages & Outfalls

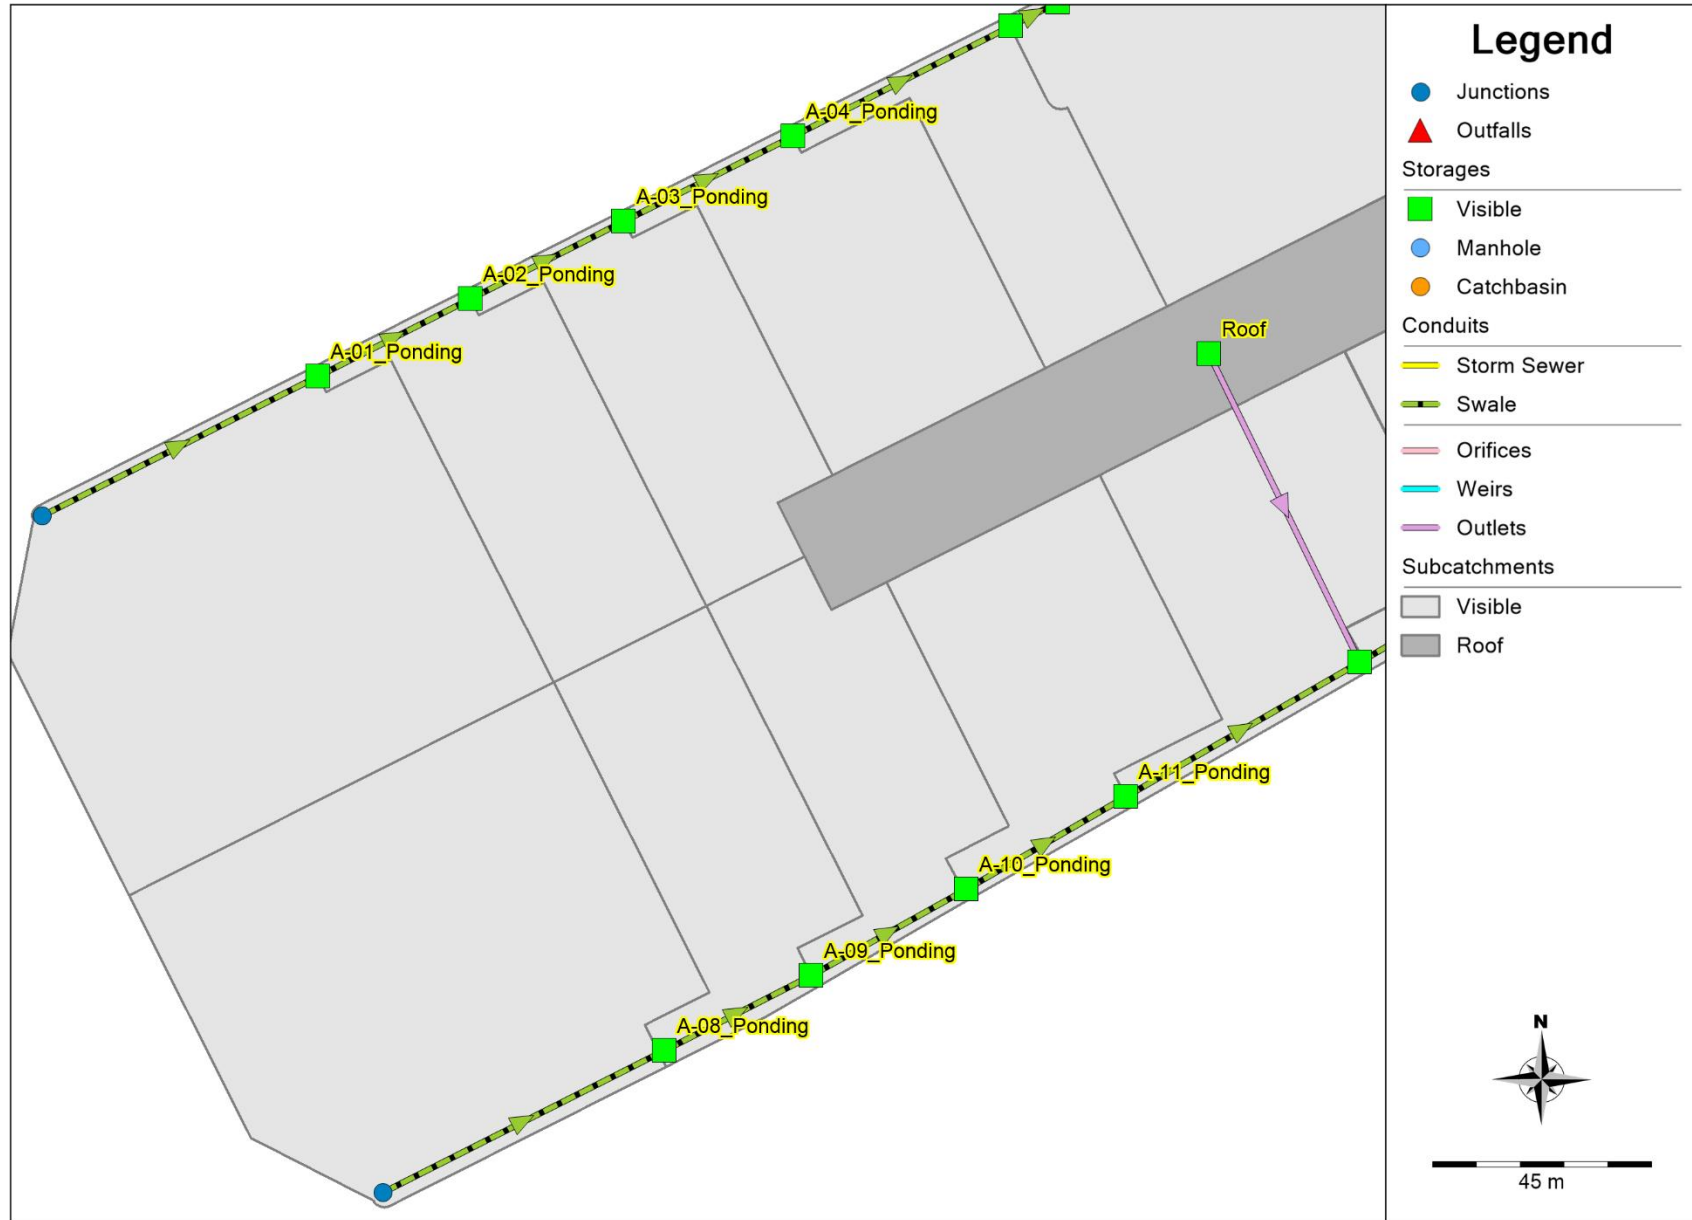

Catchbasins, Manholes, Storages & Outfalls (Cont'd)

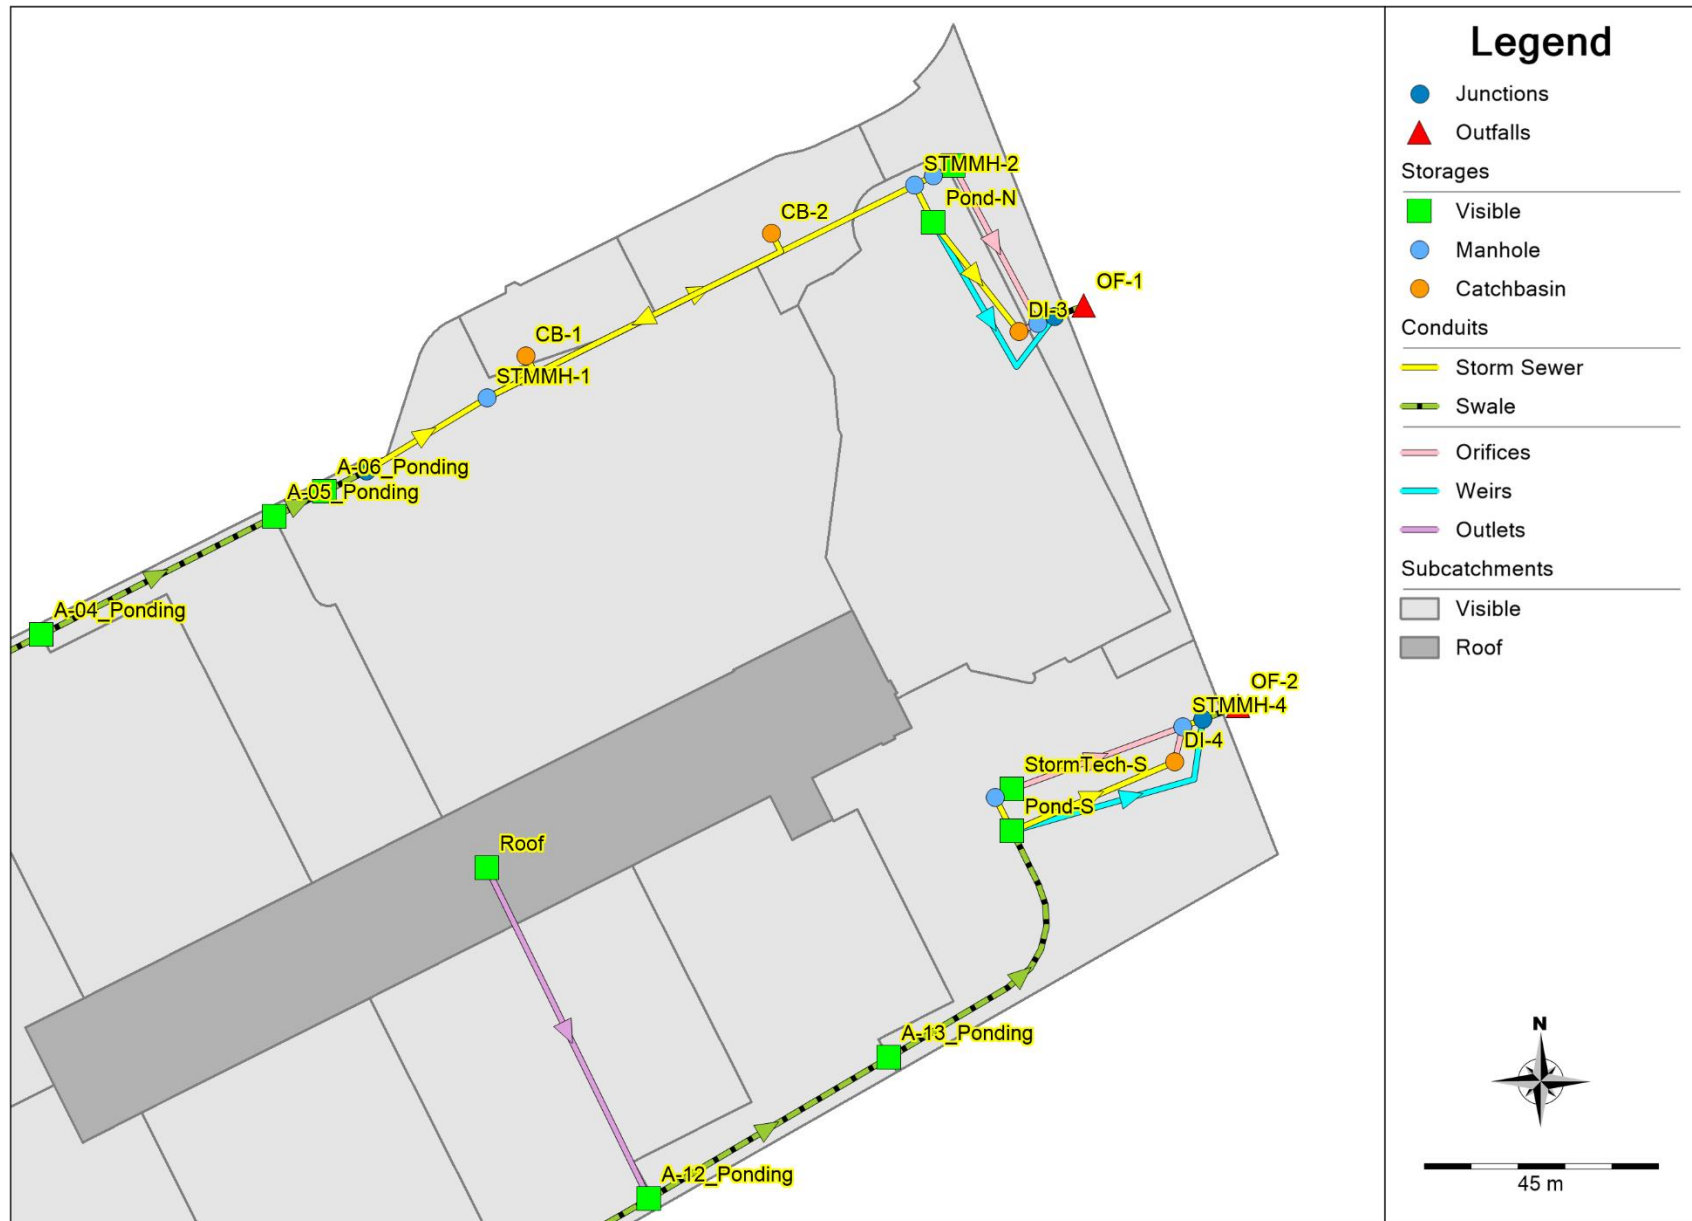

Name	Area (ha)	Width (m)	Flow Length (m)	Slope (%)	Imperv. (%)	Zero Imperv. (%)	Runoff Coeff.
A-01	0.735	67	110	2.0	91	0	0.84
A-02	0.276	37	75	1.0	93	0	0.85
A-03	0.262	35	75	1.0	93	0	0.85
A-04	0.321	53	61	1.0	96	0	0.87
A-05	0.195	30	65	1.0	96	0	0.87
A-06	0.689	55	125	1.5	96	0	0.87
A-07	0.413	103	40	2.0	50	0	0.55
A-08	0.739	68	109	2.0	97	0	0.88
A-09	0.279	39	72	1.0	90	0	0.83
A-10	0.255	36	71	1.5	91	0	0.84
A-11	0.303	48	63	1.5	87	0	0.81
A-12	0.332	66	50	1.5	90	0	0.83
A-13	0.249	50	50	1.5	90	0	0.83
A-14	0.389	54	72	2.0	20	0	0.34
A-15	0.147	113	13	2.0	80	0	0.76
DR-01	0.111	48	23	3.0	43	0	0.50
R-01	0.439	183	24	1.0	100	100	0.90

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.2 (Build 5.2.4)

WARNING 04: minimum elevation drop used for Conduit 18
WARNING 04: minimum elevation drop used for Conduit 20

Element Count

Number of rain gages 1
Number of subcatchments ... 18
Number of nodes 34
Number of links 36
Number of pollutants 0
Number of land uses 0

Raingage Summary

Name	Data Source	Data Type	Recording Interval
Raingage1	04-C3hr-100yr	INTENSITY	10 min.

Subcatchment Summary

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
A-01	0.73	67.00	91.00	2.0000	Raingage1	A-01_Ponding
A-02	0.28	37.00	93.00	1.0000	Raingage1	A-02_Ponding
A-03	0.26	35.00	93.00	1.0000	Raingage1	A-03_Ponding
A-04	0.32	53.00	96.00	1.0000	Raingage1	A-04_Ponding
A-05	0.20	30.00	96.00	1.0000	Raingage1	A-05_Ponding
A-06	0.69	55.00	96.00	1.5000	Raingage1	A-06_Ponding
A-07	0.41	103.00	50.00	2.0000	Raingage1	Pond-N
A-08	0.74	68.00	97.00	2.0000	Raingage1	A-08_Ponding

A-09	0.28	39.00	90.00	1.0000	Raingage1	A-09_Ponding
A-10	0.26	36.00	91.00	1.5000	Raingage1	A-10_Ponding
A-11	0.30	48.00	87.00	1.5000	Raingage1	A-11_Ponding
A-12	0.33	66.00	90.00	1.5000	Raingage1	A-12_Ponding
A-13	0.25	50.00	90.00	1.5000	Raingage1	A-13_Ponding
A-14	0.39	54.00	20.00	2.0000	Raingage1	Pond-S
A-15_1	0.05	39.00	80.00	2.0000	Raingage1	CB-1
A-15_2	0.10	74.00	80.00	2.0000	Raingage1	CB-2
DR-01	0.11	48.00	43.00	3.0000	Raingage1	OF-1
R-01	0.44	183.00	100.00	1.0000	Raingage1	Roof

Node Summary

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
1	JUNCTION	77.80	1.00	0.0	
2	JUNCTION	78.29	1.00	0.0	
HW-1	JUNCTION	77.00	1.00	0.0	
HW-3	JUNCTION	76.53	1.00	0.0	
HW-5	JUNCTION	76.48	1.00	0.0	
OF-1	OUTFALL	76.51	1.00	0.0	
OF-2	OUTFALL	76.41	1.00	0.0	
A-01_Ponding	STORAGE	77.35	1.00	0.0	
A-02_Ponding	STORAGE	77.28	1.00	0.0	
A-03_Ponding	STORAGE	77.21	1.00	0.0	
A-04_Ponding	STORAGE	77.13	1.00	0.0	
A-05_Ponding	STORAGE	77.03	1.00	0.0	
A-06_Ponding	STORAGE	77.01	1.00	0.0	
A-08_Ponding	STORAGE	77.35	1.00	0.0	
A-09_Ponding	STORAGE	77.28	1.00	0.0	
A-10_Ponding	STORAGE	77.21	1.00	0.0	
A-11_Ponding	STORAGE	77.13	1.00	0.0	
A-12_Ponding	STORAGE	77.02	1.00	0.0	
A-13_Ponding	STORAGE	76.91	1.00	0.0	
CB-1	STORAGE	77.15	1.05	0.0	
CB-2	STORAGE	77.05	1.10	0.0	

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

DI-3	STORAGE	76.60	1.70	0.0
DI-4	STORAGE	76.55	1.75	0.0
OGS-N	STORAGE	76.72	1.62	0.0
OGS-S	STORAGE	76.72	2.25	0.0
Pond-N	STORAGE	76.80	1.05	0.0
Pond-S	STORAGE	76.80	1.05	0.0
Roof	STORAGE	77.02	1.23	0.0
STMMH-1	STORAGE	76.94	1.34	0.0
STMMH-2	STORAGE	76.75	1.79	0.0
STMMH-3	STORAGE	76.55	1.19	0.0
STMMH-4	STORAGE	76.50	1.28	0.0
StormTech-N	STORAGE	76.55	1.35	0.0
StormTech-S	STORAGE	76.55	1.35	0.0

Link Summary

Name	From Node	To Node	Type	Length	%Slope	Roughness
1	1	A-01_Ponding	CONDUIT	63.0	0.7142	0.0300
10	A-10_Ponding	A-11_Ponding	CONDUIT	37.5	0.2136	0.0300
10_(STM)	OGS-S	StormTech-S	CONDUIT	4.0	0.5062	0.0130
11	A-11_Ponding	A-12_Ponding	CONDUIT	55.0	0.2002	0.0300
12	A-12_Ponding	A-13_Ponding	CONDUIT	52.9	0.2078	0.0300
14	A-13_Ponding	Pond-S	CONDUIT	40.0	0.1500	0.0300
15	HW-5	OF-2	CONDUIT	7.2	0.9715	0.0300
15_(1)_(STM)	STMMH-1	STMMH-2	CONDUIT	88.3	0.2039	0.0130
18	Pond-S	DI-4	CONDUIT	1.0	0.0305	0.0130
18_(STM)	Pond-N	STMMH-2	CONDUIT	6.2	0.6421	0.0130
2	A-01_Ponding	A-02_Ponding	CONDUIT	34.8	0.2010	0.0300
20	Pond-N	DI-3	CONDUIT	1.0	0.0305	0.0130
22	HW-3	OF-1	CONDUIT	5.9	0.3364	0.0300
27_(STM)	HW-1	STMMH-1	CONDUIT	25.8	0.1938	0.0130
28_(STM)	CB-1	STMMH-1	CONDUIT	2.1	0.9616	0.0130
29_(STM)	CB-2	STMMH-1	CONDUIT	2.1	0.9662	0.0130
3	A-02_Ponding	A-03_Ponding	CONDUIT	35.0	0.2002	0.0300
39_(1)_(STM)	STMMH-4	HW-5	CONDUIT	4.0	0.5006	0.0130
4	A-03_Ponding	A-04_Ponding	CONDUIT	38.5	0.2075	0.0300

40_(STM)	STMMH-2	OGS-N	CONDUIT	2.8	0.7042	0.0130
41_(STM)	OGS-N	StormTech-N	CONDUIT	4.3	0.4651	0.0130
46_(STM)	Pond-S	OGS-S	CONDUIT	8.0	0.5006	0.0130
47_(STM)	STMMH-3	HW-3	CONDUIT	3.0	0.6645	0.0130
5	A-04_Ponding	A-05_Ponding	CONDUIT	49.6	0.2014	0.0300
6_1	A-05_Ponding	A-06_Ponding	CONDUIT	10.7	0.1873	0.0300
6_2	A-06_Ponding	HW-1	CONDUIT	8.8	0.1133	0.0300
7	2	A-08_Ponding	CONDUIT	64.2	1.4633	0.0300
8	A-08_Ponding	A-09_Ponding	CONDUIT	33.6	0.2082	0.0300
9	A-09_Ponding	A-10_Ponding	CONDUIT	36.2	0.1936	0.0300
13	StormTech-S	STMMH-4	ORIFICE			
21	StormTech-N	STMMH-3	ORIFICE			
49_(STM)	DI-3	STMMH-3	ORIFICE			
6_(1)_(STM)	DI-4	STMMH-4	ORIFICE			
NorthSpillway	Pond-N	HW-3	WEIR			
SouthSpillway	Pond-S	HW-5	WEIR			
Roof_Outlet	Roof	A-12_Ponding	OUTLET			

Cross Section Summary

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
1	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	7528.90
10	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	4117.31
10_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	202.86
11	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3985.79
12	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	4060.90
14	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3450.35
15	TRIANGULAR	1.00	3.00	0.47	6.00	1	5995.14
15_(1)_(STM)	CIRCULAR	0.60	0.28	0.15	0.60	2	277.24
18	RECT_OPEN	1.00	1.20	0.37	1.20	1	838.09
18_(STM)	CIRCULAR	0.60	0.28	0.15	0.60	1	492.03
2	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3993.66
20	RECT_OPEN	1.00	1.20	0.37	1.20	1	838.09
22	TRIANGULAR	1.00	3.00	0.47	6.00	1	3527.99
27_(STM)	CIRCULAR	0.60	0.28	0.15	0.60	2	270.32

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

28_(STM)	CIRCULAR	0.20	0.03	0.05	0.20	1	32.16
29_(STM)	CIRCULAR	0.20	0.03	0.05	0.20	1	32.24
3	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3986.12
39_(1)_(STM)	CIRCULAR	0.30	0.07	0.07	0.30	1	68.43
4	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	4058.52
40_(STM)	CIRCULAR	0.53	0.22	0.13	0.53	1	360.93
41_(STM)	CIRCULAR	0.53	0.22	0.13	0.53	1	293.32
46_(STM)	CIRCULAR	0.45	0.16	0.11	0.45	1	201.74
47_(STM)	CIRCULAR	0.38	0.11	0.09	0.38	1	142.93
5	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3998.46
6_1	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3855.38
6_2	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	2999.23
7	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	10776.51
8	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	4065.25
9	TRAPEZOIDAL	1.00	4.00	0.55	7.00	1	3919.48

Analysis Options

Flow Units LPS

Process Models:

Rainfall/Runoff YES

RDII NO

Snowmelt NO

Groundwater NO

Flow Routing YES

Ponding Allowed YES

Water Quality NO

Infiltration Method HORTON

Flow Routing Method DYNWAVE

Surcharge Method EXTRAN

Starting Date 09/22/2021 00:00:00

Ending Date 09/23/2021 00:00:00

Antecedent Dry Days 0.0

Report Time Step 00:01:00

Wet Time Step 00:01:00

Dry Time Step 00:01:00

Routing Time Step 1.00 sec

Variable Time Step YES

Maximum Trials 8

Number of Threads 4

Head Tolerance 0.001500 m

	Volume	Depth
Runoff Quantity Continuity	hectare-m	mm
*****	-----	-----
Total Precipitation	0.440	71.667
Evaporation Loss	0.000	0.000
Infiltration Loss	0.043	6.995
Surface Runoff	0.390	63.504
Final Storage	0.007	1.221
Continuity Error (%)	-0.074	

	Volume	Volume
Flow Routing Continuity	hectare-m	10^6 ltr
*****	-----	-----
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.389	3.895
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	0.390	3.898
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.000	0.000
Continuity Error (%)	-0.086	

Highest Continuity Errors

Node A-13_Ponding (1.14%)

```

*****
Time-Step Critical Elements
*****
Link 18 (32.83%)
Link 10_(STM) (3.21%)
Link 40_(STM) (1.65%)
Link 20 (1.18%)

*****
Highest Flow Instability Indexes
*****
Link 49_(STM) (31)
Link 47_(STM) (22)
Link Roof_Outlet (17)
Link 6_(1)_(STM) (6)
Link 20 (3)

*****
Most Frequent Nonconverging Nodes
*****
Convergence obtained at all time steps.

```

```

*****
Routing Time Step Summary
*****
Minimum Time Step      :      0.50 sec
Average Time Step      :      0.83 sec
Maximum Time Step      :      1.00 sec
% of Time in Steady State :      0.00
Average Iterations per Step :      2.00
% of Steps Not Converging :      0.00
Time Step Frequencies  :
    1.000 - 0.871 sec :      62.36 %
    0.871 - 0.758 sec :      1.39 %
    0.758 - 0.660 sec :      5.19 %

```

```
0.660 - 0.574 sec      :      4.56 %
0.574 - 0.500 sec      :     26.51 %
```

Subcatchment Runoff Summary

	Total	Total	Total	Total	Imperv	Perv	Total	Total	Peak
Runoff									
Coeff	Precip	Runon	Evap	Infil	Runoff	Runoff	Runoff	Runoff	Runoff
Subcatchment	mm	mm	mm	mm	mm	mm	mm	10^6 ltr	LPS
A-01 0.925	71.67	0.00	0.00	4.02	63.83	2.44	66.26	0.49	351.86
A-02 0.937	71.67	0.00	0.00	3.11	65.23	1.91	67.14	0.19	133.55
A-03 0.937	71.67	0.00	0.00	3.11	65.23	1.91	67.14	0.18	126.76
A-04 0.955	71.67	0.00	0.00	1.76	67.34	1.11	68.45	0.22	157.52
A-05 0.955	71.67	0.00	0.00	1.76	67.34	1.11	68.44	0.13	95.56
A-06 0.955	71.67	0.00	0.00	1.77	67.33	1.10	68.42	0.47	332.09
A-07 0.672	71.67	0.00	0.00	22.79	35.10	13.06	48.16	0.20	154.68
A-08 0.961	71.67	0.00	0.00	1.32	68.03	0.83	68.87	0.51	361.33
A-09 0.919	71.67	0.00	0.00	4.47	63.13	2.70	65.83	0.18	133.34
A-10 0.925	71.67	0.00	0.00	4.00	63.83	2.46	66.29	0.17	123.34
A-11 0.901	71.67	0.00	0.00	5.80	61.03	3.52	64.56	0.20	144.32
A-12 0.919	71.67	0.00	0.00	4.43	63.14	2.75	65.89	0.22	161.14

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

A-13	71.67	0.00	0.00	4.43	63.14	2.75	65.89	0.16	120.88
0.919									
A-14	71.67	0.00	0.00	38.68	14.04	18.66	32.71	0.13	76.49
0.456									
A-15_1	71.67	0.00	0.00	8.79	56.17	5.57	61.74	0.03	24.54
0.861									
A-15_2	71.67	0.00	0.00	8.79	56.17	5.57	61.74	0.06	46.19
0.861									
DR-01	71.67	0.00	0.00	25.50	30.19	15.38	45.57	0.05	44.92
0.636									
R-01	71.67	0.00	0.00	0.00	71.74	0.00	71.74	0.31	217.73
1.001									

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
1	JUNCTION	0.00	0.00	77.80	0 00:00	0.00
2	JUNCTION	0.00	0.00	78.29	0 00:00	0.00
HW-1	JUNCTION	0.14	0.74	77.74	0 01:21	0.74
HW-3	JUNCTION	0.10	0.41	76.94	0 01:28	0.41
HW-5	JUNCTION	0.11	0.18	76.66	0 01:53	0.18
OF-1	OUTFALL	0.11	0.41	76.92	0 01:28	0.41
OF-2	OUTFALL	0.11	0.18	76.59	0 01:53	0.18
A-01_Ponding	STORAGE	0.04	0.39	77.74	0 01:20	0.39
A-02_Ponding	STORAGE	0.06	0.46	77.74	0 01:21	0.46
A-03_Ponding	STORAGE	0.07	0.53	77.74	0 01:21	0.53
A-04_Ponding	STORAGE	0.10	0.61	77.74	0 01:21	0.61
A-05_Ponding	STORAGE	0.13	0.71	77.74	0 01:21	0.71
A-06_Ponding	STORAGE	0.14	0.73	77.74	0 01:21	0.73
A-08_Ponding	STORAGE	0.03	0.37	77.72	0 01:10	0.37
A-09_Ponding	STORAGE	0.04	0.40	77.68	0 01:10	0.40
A-10_Ponding	STORAGE	0.06	0.43	77.64	0 01:10	0.43
A-11_Ponding	STORAGE	0.09	0.46	77.59	0 01:10	0.46

A-12_Ponding	STORAGE	0.14	0.49	77.51	0 01:52	0.49
A-13_Ponding	STORAGE	0.20	0.60	77.51	0 01:53	0.60
CB-1	STORAGE	0.09	0.57	77.72	0 01:20	0.57
CB-2	STORAGE	0.12	0.78	77.83	0 01:10	0.78
DI-3	STORAGE	0.21	0.99	77.59	0 01:27	0.99
DI-4	STORAGE	0.34	0.96	77.51	0 01:53	0.96
OGS-N	STORAGE	0.25	0.94	77.66	0 01:24	0.94
OGS-S	STORAGE	0.32	0.78	77.50	0 01:53	0.78
Pond-N	STORAGE	0.21	0.79	77.59	0 01:28	0.79
Pond-S	STORAGE	0.27	0.71	77.51	0 01:53	0.71
Roof	STORAGE	0.11	0.23	77.25	0 04:40	0.23
STMMH-1	STORAGE	0.16	0.78	77.72	0 01:22	0.78
STMMH-2	STORAGE	0.24	0.91	77.66	0 01:24	0.91
STMMH-3	STORAGE	0.11	0.42	76.97	0 01:28	0.42
STMMH-4	STORAGE	0.14	0.25	76.75	0 01:53	0.25
StormTech-N	STORAGE	0.33	1.11	77.66	0 01:24	1.11
StormTech-S	STORAGE	0.43	0.95	77.50	0 01:53	0.95

Node Inflow Summary

Node	Type	Maximum Lateral Inflow LPS	Maximum Total Inflow LPS	Time of Max Occurrence days hr:min	Lateral Inflow Volume 10^6 ltr	Total Inflow Volume 10^6 ltr	Flow Balance Error Percent
1	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
2	JUNCTION	0.00	0.00	0 00:00	0	0	0.000 ltr
HW-1	JUNCTION	0.00	522.54	0 01:04	0	1.67	0.006
HW-3	JUNCTION	0.00	333.55	0 01:28	0	1.97	0.000
HW-5	JUNCTION	0.00	57.70	0 01:53	0	1.88	0.000
OF-1	OUTFALL	44.92	340.52	0 01:28	0.0506	2.02	0.000
OF-2	OUTFALL	0.00	57.70	0 01:53	0	1.88	0.000
A-01_Ponding	STORAGE	351.86	351.86	0 01:10	0.487	0.487	-0.110
A-02_Ponding	STORAGE	133.55	440.87	0 01:10	0.185	0.673	-0.018
A-03_Ponding	STORAGE	126.76	492.30	0 01:08	0.176	0.849	-0.015

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

A-04_Ponding	STORAGE	157.52	550.45	0	01:06	0.22	1.07	-0.017
A-05_Ponding	STORAGE	95.56	454.11	0	01:05	0.133	1.2	0.074
A-06_Ponding	STORAGE	332.09	620.48	0	01:05	0.471	1.67	-0.005
A-08_Ponding	STORAGE	361.33	361.33	0	01:10	0.509	0.509	-0.072
A-09_Ponding	STORAGE	133.34	480.12	0	01:10	0.184	0.693	-0.023
A-10_Ponding	STORAGE	123.34	580.68	0	01:10	0.169	0.862	-0.017
A-11_Ponding	STORAGE	144.32	695.46	0	01:10	0.196	1.06	-0.106
A-12_Ponding	STORAGE	161.14	813.09	0	01:10	0.219	1.98	0.011
A-13_Ponding	STORAGE	120.88	861.64	0	01:10	0.164	1.81	1.152
CB-1	STORAGE	24.54	24.54	0	01:10	0.0315	0.0315	-0.004
CB-2	STORAGE	46.19	46.19	0	01:10	0.0593	0.0593	-0.003
DI-3	STORAGE	0.00	87.76	0	03:10	0	0.421	-0.568
DI-4	STORAGE	0.00	35.40	0	01:09	0	0.275	-0.185
OGS-N	STORAGE	0.00	106.04	0	01:05	0	0.896	0.014
OGS-S	STORAGE	0.00	123.07	0	01:10	0	1.6	-0.010
Pond-N	STORAGE	154.68	565.91	0	01:10	0.199	1.38	-0.003
Pond-S	STORAGE	76.49	907.49	0	01:10	0.127	1.88	-0.762
Roof	STORAGE	217.73	242.33	0	01:10	0.315	0.661	0.021
STMMH-1	STORAGE	0.00	557.23	0	01:05	0	1.76	-0.180
STMMH-2	STORAGE	0.00	501.30	0	01:05	0	2.08	-0.076
STMMH-3	STORAGE	0.00	82.25	0	01:16	0	1.32	-0.003
STMMH-4	STORAGE	0.00	54.00	0	01:53	0	1.87	-0.001
StormTech-N	STORAGE	0.00	104.72	0	01:05	0	0.896	-0.008
StormTech-S	STORAGE	0.00	119.84	0	01:10	0	1.6	-0.007

Node Surcharge Summary

No nodes were surcharged.

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

Storage Unit	Average Volume 1000 m³	Avg Pcnt Full	Evap Pcnt Loss	Exfil Pcnt Loss	Maximum Volume 1000 m³	Max Pcnt Full	Time of Max Occurrence days hr:min	Maximum Outflow LPS
A-01_Ponding	0.000	0.0	0.0	0.0	0.002	0.5	0 01:20	307.46
A-02_Ponding	0.000	0.1	0.0	0.0	0.015	2.4	0 01:21	368.57
A-03_Ponding	0.001	0.2	0.0	0.0	0.022	5.0	0 01:21	397.92
A-04_Ponding	0.003	0.5	0.0	0.0	0.060	11.7	0 01:21	363.68
A-05_Ponding	0.001	0.6	0.0	0.0	0.030	13.9	0 01:21	329.79
A-06_Ponding	0.003	0.8	0.0	0.0	0.067	17.7	0 01:21	522.54
A-08_Ponding	0.000	0.0	0.0	0.0	0.001	0.3	0 01:10	347.05
A-09_Ponding	0.000	0.0	0.0	0.0	0.004	0.7	0 01:10	459.51
A-10_Ponding	0.000	0.0	0.0	0.0	0.005	1.5	0 01:10	556.22
A-11_Ponding	0.000	0.0	0.0	0.0	0.007	1.6	0 01:10	662.97
A-12_Ponding	0.000	0.1	0.0	0.0	0.005	1.1	0 01:52	779.21
A-13_Ponding	0.000	0.3	0.0	0.0	0.005	3.4	0 01:53	841.65
CB-1	0.000	8.4	0.0	0.0	0.000	54.3	0 01:20	24.07
CB-2	0.000	11.1	0.0	0.0	0.000	71.0	0 01:10	45.71
DI-3	0.000	12.4	0.0	0.0	0.001	58.1	0 01:27	51.93
DI-4	0.000	19.6	0.0	0.0	0.001	54.6	0 01:53	12.70
OGS-N	0.000	0.0	0.0	0.0	0.000	0.0	0 00:00	104.72
OGS-S	0.000	0.0	0.0	0.0	0.000	0.0	0 00:00	119.84
Pond-N	0.130	15.7	0.0	0.0	0.556	67.2	0 01:28	295.40
Pond-S	0.258	20.8	0.0	0.0	0.754	61.0	0 01:53	154.16
Roof	0.229	0.7	0.0	0.0	0.656	2.1	0 04:40	24.61
STMMH-1	0.001	12.2	0.0	0.0	0.004	58.0	0 01:22	501.30
STMMH-2	0.001	13.4	0.0	0.0	0.005	50.8	0 01:24	478.79
STMMH-3	0.000	9.2	0.0	0.0	0.000	35.6	0 01:28	81.46
STMMH-4	0.000	10.8	0.0	0.0	0.000	19.5	0 01:53	54.00
StormTech-N	0.019	30.6	0.0	0.0	0.063	100.0	0 01:16	42.12
StormTech-S	0.025	40.0	0.0	0.0	0.056	88.8	0 01:53	41.30

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow LPS	Max Flow LPS	Total Volume 10^6 ltr
OF-1	62.51	57.60	340.52	2.020
OF-2	83.72	31.42	57.70	1.878
System	73.11	89.02	393.56	3.898

Link Flow Summary

Link	Type	Maximum Flow LPS	Time of Max Occurrence days hr:min	Maximum Veloc m/sec	Max/ Full Flow	Max/ Full Depth
1	CONDUIT	0.00	0 00:00	0.00	0.00	0.20
10	CONDUIT	556.22	0 01:10	0.54	0.14	0.44
10_(STM)	CONDUIT	119.84	0 01:10	1.26	0.59	1.00
11	CONDUIT	662.97	0 01:10	0.59	0.17	0.47
12	CONDUIT	754.61	0 01:10	0.64	0.19	0.54
14	CONDUIT	841.65	0 01:10	0.96	0.24	0.63
15	CONDUIT	57.70	0 01:53	0.63	0.01	0.18
15_(1)_(STM)	CONDUIT	501.30	0 01:05	0.92	0.90	1.00
18	CONDUIT	35.40	0 01:09	0.62	0.04	0.41
18_(STM)	CONDUIT	412.17	0 01:10	1.62	0.84	1.00
2	CONDUIT	307.46	0 01:08	0.41	0.08	0.43
20	CONDUIT	87.76	0 03:10	0.74	0.10	0.32
22	CONDUIT	333.54	0 01:28	0.65	0.09	0.41
27_(STM)	CONDUIT	493.02	0 01:05	1.03	0.91	1.00
28_(STM)	CONDUIT	24.07	0 01:09	0.80	0.75	1.00

29_(STM)	CONDUIT	45.71	0 01:10	1.46	1.42	1.00
3	CONDUIT	368.57	0 01:07	0.44	0.09	0.50
39_(1)_(STM)	CONDUIT	54.00	0 01:54	1.02	0.79	0.71
4	CONDUIT	397.92	0 01:06	0.43	0.10	0.57
40_(STM)	CONDUIT	106.04	0 01:05	0.77	0.29	1.00
41_(STM)	CONDUIT	104.72	0 01:05	0.81	0.36	1.00
46_(STM)	CONDUIT	123.07	0 01:10	1.06	0.61	1.00
47_(STM)	CONDUIT	81.46	0 01:17	0.95	0.57	1.00
5	CONDUIT	363.68	0 01:05	0.35	0.09	0.66
6_1	CONDUIT	329.79	0 01:05	0.31	0.09	0.72
6_2	CONDUIT	522.54	0 01:04	0.49	0.17	0.73
7	CONDUIT	0.00	0 00:00	0.00	0.00	0.18
8	CONDUIT	347.05	0 01:10	0.43	0.09	0.38
9	CONDUIT	459.51	0 01:10	0.49	0.12	0.42
13	ORIFICE	41.30	0 01:54			1.00
21	ORIFICE	42.12	0 01:16			1.00
49_(STM)	ORIFICE	40.22	0 01:17			1.00
6_(1)_(STM)	ORIFICE	12.70	0 01:53			1.00
NorthSpillway	WEIR	255.75	0 01:28			0.25
SouthSpillway	WEIR	3.71	0 01:53			0.02
Roof_Outlet	DUMMY	24.61	0 00:55			

Flow Classification Summary

Conduit	Adjusted /Actual Length	Fraction of Time in Flow Class								
		Up Dry	Down Dry	Sub Dry	Sup Crit	Up Crit	Down Crit	Norm Ltd	Inlet Ctrl	
1	1.00	0.02	0.98	0.00	0.00	0.00	0.00	0.00	0.00	0.00
10	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.78	0.00
10_(STM)	1.00	0.01	0.00	0.00	0.55	0.00	0.00	0.43	0.00	0.00
11	1.00	0.01	0.01	0.00	0.98	0.00	0.00	0.00	0.69	0.00
12	1.00	0.01	0.00	0.00	0.99	0.00	0.00	0.00	0.58	0.00
14	1.00	0.01	0.00	0.00	0.59	0.00	0.00	0.40	0.06	0.00
15	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.53	0.00

5494-5510 Boundary Road - Day & Ross (118168)
Post-Development PCSWMM Model Output (100-yr 3-hr Chicago)

15_(1)_(STM)	1.00	0.02	0.00	0.00	0.37	0.00	0.00	0.62	0.08	0.00
18	1.00	0.68	0.00	0.00	0.28	0.00	0.00	0.04	0.00	0.00
18_(STM)	1.00	0.02	0.00	0.00	0.32	0.00	0.00	0.66	0.00	0.00
2	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.85	0.00
20	1.00	0.86	0.00	0.00	0.12	0.00	0.00	0.02	0.00	0.00
22	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.56	0.00
27_(STM)	1.00	0.02	0.00	0.00	0.30	0.00	0.00	0.69	0.02	0.00
28_(STM)	1.00	0.02	0.00	0.00	0.20	0.00	0.00	0.78	0.01	0.00
29_(STM)	1.00	0.02	0.00	0.00	0.25	0.00	0.00	0.73	0.01	0.00
3	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.83	0.00
39_(1)_(STM)	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.32	0.00
4	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.81	0.00
40_(STM)	1.00	0.02	0.00	0.00	0.33	0.01	0.00	0.65	0.00	0.00
41_(STM)	1.00	0.02	0.00	0.00	0.31	0.00	0.00	0.67	0.00	0.00
46_(STM)	1.00	0.01	0.00	0.00	0.54	0.00	0.00	0.45	0.00	0.00
47_(STM)	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.59	0.00
5	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.78	0.00
6_1	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.72	0.00
6_2	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.71	0.00
7	1.00	0.02	0.98	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.85	0.00
9	1.00	0.02	0.00	0.00	0.98	0.00	0.00	0.00	0.83	0.00

Conduit Surcharge Summary

Conduit	Hours Full			Hours	
	Both Ends	Upstream	Dnstream	Above Full Normal Flow	Capacity Limited
10_(STM)	5.32	5.32	5.82	0.01	0.01
15_(1)_(STM)	1.17	1.17	2.78	0.01	0.01
18_(STM)	2.42	2.42	2.78	0.01	0.01
27_(STM)	0.90	0.90	1.11	0.01	0.01
28_(STM)	2.87	2.88	2.99	0.01	0.13
29_(STM)	3.68	3.69	3.88	0.16	0.19

40_(STM)	3.38	3.38	3.58	0.01	0.01
41_(STM)	3.69	3.69	3.87	0.01	0.01
46_(STM)	3.47	3.47	4.33	0.01	0.01
47_(STM)	0.52	0.61	0.52	0.01	0.52

Analysis begun on: Thu Oct 9 10:23:38 2025
Analysis ended on: Thu Oct 9 10:23:41 2025
Total elapsed time: 00:00:03



ADS Treatment Train Sizing

Project Name:	5510 Boundary Road North OGS		
Consulting Engineer:	Novatech Engineering		
Location:	Ottawa, Ontario		
Sizing Completed By:	Haider Nasrullah	Email:	haider.nasrullah@adspipe.com

Summary of Results	
Isolator Row PLUS TSS Removal:	80.0%
FD-4HC TSS Removal:	32.0%
Combined TSS Removal:	86.0%
Total Volume Treated:	>90%

Individual OGS Results		
Model	TSS Removal	Volume Treated
FD-4HC	32.0%	>90%
FD-5HC	34.0%	>90%
FD-6HC	36.0%	>90%
FD-8HC	39.0%	>90%
FD-10HC	41.0%	>90%

Overall System Capacities	
Total Sediment Storage Capacity:	5.88 m³
Oil Storage Capacity:	723 L
Max. OGS Pipe Diameter:	600 mm
Peak OGS Flow Capacity:	510 L/s
Peak Stormtech Inlet Flow Capacity:	---
Peak IR PLUS Water Quality Flow:	186.7 L/s

OGS Specifications	
Inlet Pipe Diameter (A):	525 mm
Unit Diameter (B):	1,200 mm
Outlet Pipe Diameter (C):	525 mm
Rim Elevation (D):	78.34 m
Bottom of Sump Elevation (E):	75.22 m
Inlet Pipe Elevation (F):	76.73 m
Outlet Pipe Elevation (G):	76.72 m


Site Details	
Site Area (ha):	3.05
Rational C:	0.81
Particle Size Distribution:	ETV
Rainfall Station:	Ottawa, ONT

Notes: OGS results based on ETV PSD and results from ETV testing protocols.

Stormtech Details	
Chamber Model:	DC-780
No. Chambers in Isolator Row PLUS:	26
Volume Treated by Isolator Row PLUS:	>90%

Notes: Refer to Stormtech drawings for full IR+ configuration.

Isolator Row PLUS must include Flared End Ramp (FLAMP) for proper performance.

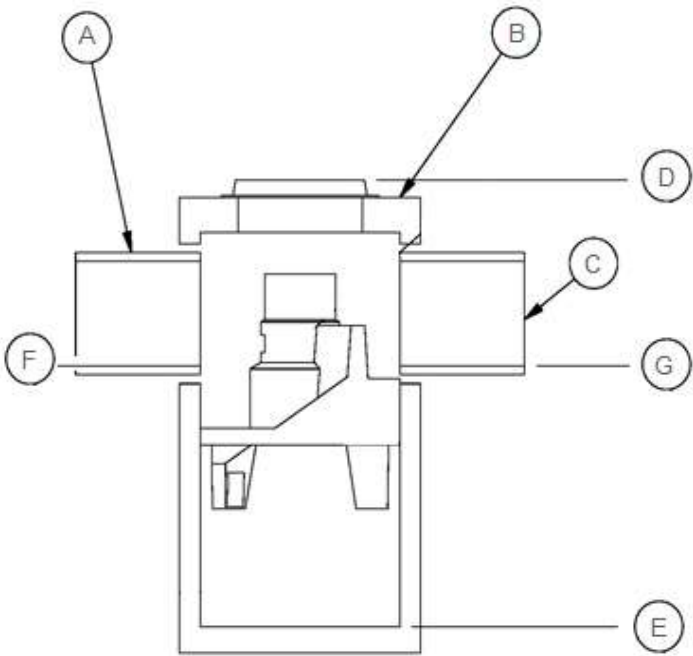

Notes:

Isolator Row PLUS removal efficiency based on verified ETV test report. For dimensions and configuration of Isolator Row PLUS, please see Stormtech drawing package.



Project Name: 5510 Boundary Road North OGS
 Consulting Engineer: Novatech Engineering
 Location: Ottawa, Ontario

Net Annual Removal Efficiency Summary

Rainfall Intensity	Fraction of Rainfall	Removal Efficiency		Combined Removal Efficiency	Combined Weighted Removal Efficiency
		FD-4HC	IR PLUS ⁽²⁾		
mm/hr	%	%	%	%	%
0.50	0.1%	54.0%	81.2%	91.3%	0.1%
1.00	14.1%	49.0%	81.2%	90.4%	12.8%
1.50	14.2%	46.0%	81.2%	89.9%	12.8%
2.00	14.1%	44.0%	81.2%	89.5%	12.6%
2.50	4.2%	42.4%	81.2%	89.2%	3.7%
3.00	1.5%	41.1%	81.2%	88.9%	1.3%
3.50	8.5%	39.9%	81.2%	88.7%	7.6%
4.00	5.4%	39.0%	81.2%	88.5%	4.8%
4.50	1.2%	38.1%	81.2%	88.4%	1.0%
5.00	5.5%	37.4%	81.2%	88.2%	4.9%
6.00	4.3%	36.1%	81.2%	88.0%	3.8%
7.00	4.5%	0.0%	81.2%	81.2%	3.7%
8.00	3.1%	0.0%	81.2%	81.2%	2.5%
9.00	2.3%	0.0%	81.2%	81.2%	1.9%
10.00	2.6%	0.0%	81.2%	81.2%	2.1%
20.00	9.2%	0.0%	81.2%	81.2%	7.5%
30.00	2.6%	0.0%	73.6%	73.6%	1.9%
40.00	1.2%	0.0%	55.2%	55.2%	0.6%
50.00	0.5%	0.0%	44.2%	44.2%	0.2%
100.00	0.7%	0.0%	22.1%	22.1%	0.2%
150.00	0.1%	0.0%	14.7%	14.7%	0.0%
200.00	0.0%	0.0%	11.0%	11.0%	0.0%
Total Net Annual Removal Efficiency					86.0%
Total Runoff Volume Treated					>90%

Notes:

- (1) Rainfall Data: 1960:2007, HLY03, Ottawa, ONT, 6105976 & 6105978.
- (2) IR PLUS removal based on ETV PSD and ETV protocols.
- (3) Rainfall adjusted to 5 min peak intensity based on hourly average.
- (4) Combined removal efficiencies calculated based on NCDENR Stormwater BMP Manual, Section 3.9.4, where
 Total Removal Efficiency = 1st BMP Efficiency + 2nd BMP Efficiency - (1st BMP Efficiency x 2nd BMP Efficiency)



ADS Treatment Train Sizing

Project Name:	5510 Boundary Road South OGS		
Consulting Engineer:	Novatech Engineering		
Location:	Ottawa, Ontario		
Sizing Completed By:	Haider Nasrullah	Email:	haider.nasrullah@adspipe.com

Summary of Results	
Isolator Row PLUS TSS Removal:	80.2%
FD-4HC TSS Removal:	32.0%
Combined TSS Removal:	86.2%
Total Volume Treated:	>90%

Individual OGS Results		
Model	TSS Removal	Volume Treated
FD-4HC	32.0%	>90%
FD-5HC	34.0%	>90%
FD-6HC	36.0%	>90%
FD-8HC	39.0%	>90%
FD-10HC	42.0%	>90%

Overall System Capacities	
Total Sediment Storage Capacity:	5.88 m³
Oil Storage Capacity:	723 L
Max. OGS Pipe Diameter:	600 mm
Peak OGS Flow Capacity:	510 L/s
Peak Stormtech Inlet Flow Capacity:	---
Peak IR PLUS Water Quality Flow:	186.7 L/s

OGS Specifications	
Inlet Pipe Diameter (A):	300 mm
Unit Diameter (B):	1,200 mm
Outlet Pipe Diameter (C):	300 mm
Rim Elevation (D):	78.74 m
Bottom of Sump Elevation (E):	75.22 m
Inlet Pipe Elevation (F):	76.76 m
Outlet Pipe Elevation (G):	76.72 m


Site Details	
Site Area (ha):	2.99
Rational C:	0.79
Particle Size Distribution:	ETV
Rainfall Station:	Ottawa, ONT

Notes: OGS results based on ETV PSD and results from ETV testing protocols.

Stormtech Details	
Chamber Model:	DC-780
No. Chambers in Isolator Row PLUS:	26
Volume Treated by Isolator Row PLUS:	>90%

Notes: Refer to Stormtech drawings for full IR+ configuration.

Isolator Row PLUS must include Flared End Ramp (FLAMP) for proper performance.

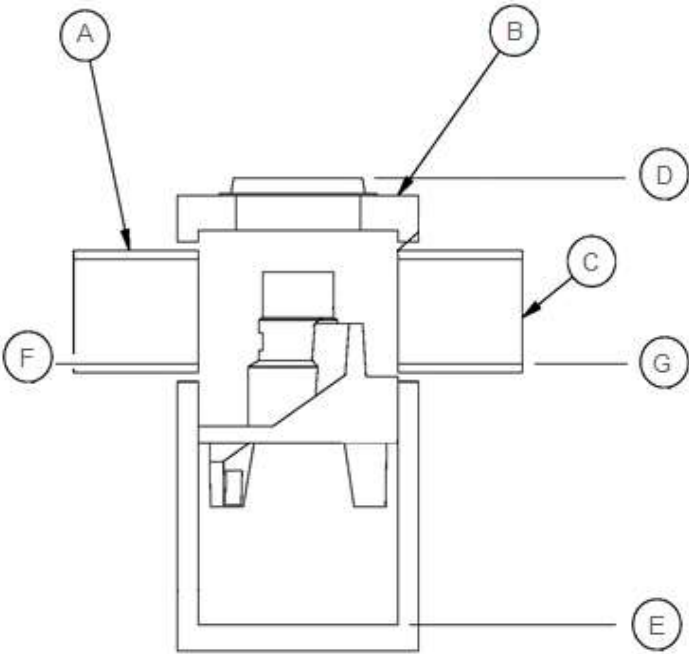

Notes:

Isolator Row PLUS removal efficiency based on verified ETV test report. For dimensions and configuration of Isolator Row PLUS, please see Stormtech drawing package.



Project Name: 5510 Boundary Road South OGS
 Consulting Engineer: Novatech Engineering
 Location: Ottawa, Ontario

Net Annual Removal Efficiency Summary

Rainfall Intensity	Fraction of Rainfall	Removal Efficiency		Combined Removal Efficiency	Combined Weighted Removal Efficiency
		FD-4HC	IR PLUS ⁽²⁾		
mm/hr	%	%	%	%	%
0.50	0.1%	54.3%	81.2%	91.4%	0.1%
1.00	14.1%	49.3%	81.2%	90.5%	12.8%
1.50	14.2%	46.4%	81.2%	89.9%	12.8%
2.00	14.1%	44.3%	81.2%	89.5%	12.6%
2.50	4.2%	42.7%	81.2%	89.2%	3.7%
3.00	1.5%	41.4%	81.2%	89.0%	1.3%
3.50	8.5%	40.3%	81.2%	88.8%	7.6%
4.00	5.4%	39.3%	81.2%	88.6%	4.8%
4.50	1.2%	38.5%	81.2%	88.4%	1.0%
5.00	5.5%	37.7%	81.2%	88.3%	4.9%
6.00	4.3%	36.4%	81.2%	88.0%	3.8%
7.00	4.5%	0.0%	81.2%	81.2%	3.7%
8.00	3.1%	0.0%	81.2%	81.2%	2.5%
9.00	2.3%	0.0%	81.2%	81.2%	1.9%
10.00	2.6%	0.0%	81.2%	81.2%	2.1%
20.00	9.2%	0.0%	81.2%	81.2%	7.5%
30.00	2.6%	0.0%	77.0%	77.0%	2.0%
40.00	1.2%	0.0%	57.8%	57.8%	0.7%
50.00	0.5%	0.0%	46.2%	46.2%	0.2%
100.00	0.7%	0.0%	23.1%	23.1%	0.2%
150.00	0.1%	0.0%	15.4%	15.4%	0.0%
200.00	0.0%	0.0%	11.6%	11.6%	0.0%
Total Net Annual Removal Efficiency				86.2%	
Total Runoff Volume Treated				>90%	

Notes:

- (1) Rainfall Data: 1960:2007, HLY03, Ottawa, ONT, 6105976 & 6105978.
- (2) IR PLUS removal based on ETV PSD and ETV protocols.
- (3) Rainfall adjusted to 5 min peak intensity based on hourly average.
- (4) Combined removal efficiencies calculated based on NCDENR Stormwater BMP Manual, Section 3.9.4, where
 Total Removal Efficiency = 1st BMP Efficiency + 2nd BMP Efficiency - (1st BMP Efficiency x 2nd BMP Efficiency)

PROJECT INFORMATION	
ENGINEERED PRODUCT MANAGER	
ADS SALES REP	
PROJECT NO.	



5510 BOUNDARY ROAD - NORTH

OTTAWA, ON, CANADA

DC-780 STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH DC-780.
- CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBERS SHALL BE CERTIFIED TO CSA B184, "POLYMERIC SUB-SURFACE STORMWATER MANAGEMENT STRUCTURES", AND MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE CSA S6 CL-625 TRUCK AND THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
- CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOUS (<1 MIN) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT (75-YR) COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK) AASHTO DESIGN TRUCK.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 50 mm (2").
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/FT³%, AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 23° C / 73° F), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:
 - THE STRUCTURAL EVALUATION SHALL BE SEALED BY A REGISTERED PROFESSIONAL ENGINEER.
 - THE STRUCTURAL EVALUATION SHALL DEMONSTRATE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY SECTIONS 3 AND 12.12 OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS FOR THERMOPLASTIC PIPE.
 - THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.
- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH NOTE #6.32 FOR MANIFOLD SIZING GUIDANCE. DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- ADS DOES NOT DESIGN OR PROVIDE MEMBRANE LINER SYSTEMS. TO MINIMIZE THE LEAKAGE POTENTIAL OF LINER SYSTEMS, THE MEMBRANE LINER SYSTEM SHOULD BE DESIGNED BY A KNOWLEDGEABLE GEOTEXTILE PROFESSIONAL AND INSTALLED BY A QUALIFIED CONTRACTOR.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF THE DC-780 CHAMBER SYSTEM

- STORMTECH DC-780 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
- STORMTECH DC-780 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM - 150 mm (6") SPACING BETWEEN THE CHAMBER ROWS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE OR RECYCLED CONCRETE; AASHTO M43 #3, 357, 4, 467, 5, 56, OR 57.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.


NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH DC-780 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
- THE USE OF CONSTRUCTION EQUIPMENT OVER DC-780 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER TIRED LOADERS, DUMP TRUCKS, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
- FULL 900 mm (36") OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.

USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO THE CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-800-821-6710 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT			PROPOSED ELEVATIONS		*INVERT ABOVE BASE OF CHAMBER			
26	STORMTECH DC-780 CHAMBERS	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):	81.117	PART TYPE	ITEM ON LAYOUT	DESCRIPTION	INVERT	MAX FLOW
4	STORMTECH DC-780 END CAPS	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):	78.069					
152	STONE ABOVE (mm)	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):	77.917	PREFABRICATED EZ END CAP	A	600 mm BOTTOM PREFABRICATED EZ END CAP, PART#: SC740ECEZ / TYP OF ALL 600 mm	3 mm	
152	STONE BELOW (mm)	MINIMUM ALLOWABLE GRADE (TOP OF RIGID CONCRETE PAVEMENT):	77.917	FLAMP	B	BOTTOM CONNECTIONS AND ISOLATOR PLUS ROWS		
40	STONE VOID	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):	77.917			INSTALL FLAMP ON 600 mm ACCESS PIPE / PART#: SC80024RAMP (TYP 2 PLACES)		
62.5	INSTALLED SYSTEM VOLUME (m³) (PERIMETER STONE INCLUDED) (BASE STONE INCLUDED)	TOP OF STONE:	77.917					
		TOP OF DC-780 CHAMBER:	77.612	NYLOPLAST (INLET W/ ISO PLUS ROW)	C	750 mm DIAMETER (610 mm SUMP MIN)		
		600 mm ISOLATOR ROW PLUS INVERT:	77.460					
98.2	SYSTEM AREA (m²)	600 mm ISOLATOR ROW PLUS INVERT:	76.700	NYLOPLAST (INLET W/ ISO PLUS ROW)	D	750 mm DIAMETER (610 mm SUMP MIN)		
65.3	SYSTEM PERIMETER (m)	BOTTOM OF DC-780 CHAMBER:	76.698					
		BOTTOM OF STONE:	76.546					

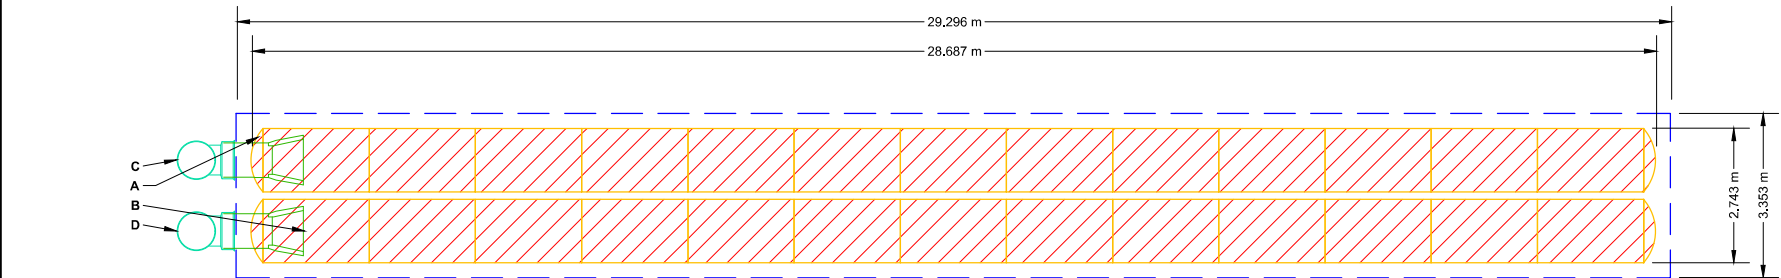

- ISOLATOR ROW PLUS (SEE DETAIL)
- NO WOVEN GEOTEXTILE
- BED LIMITS

NOTES

- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- NOT FOR CONSTRUCTION:** THIS LAYOUT IS FOR DIMENSIONAL PURPOSES ONLY TO PROVE CONCEPT & THE REQUIRED STORAGE VOLUME CAN BE ACHIEVED ON SITE.

5510 BOUNDARY ROAD - NORTH
OTTAWA, ON, CANADA

DATE: 10/07/2025
PROJECT #:
CHECKED: N/A

DATE: DWN: C-K

StormTech®
Chamber System

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473

SCALE = 1 : 100


SHEET
2 OF 6

THE DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADJUST TO THE DIRECTION OF THE PROJECT'S ENGINEER OF RECORD. THE DRAWING IS NOT INTENDED FOR USE IN BIDDING OR CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE EOR TO ENSURE THAT THE PRODUCTS/DETAILS DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LOCAL, STATE, AND FEDERAL REQUIREMENTS.

ACCEPTABLE FILL MATERIALS: STORMTECH DC-780 CHAMBER SYSTEMS

MATERIAL LOCATION		DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	ANY SOIL/ROCK MATERIALS, NATIVE SOILS, OR PER ENGINEER'S PLANS. CHECK PLANS FOR PAVEMENT SUBGRADE REQUIREMENTS.	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 18" (450 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	AASHTO M145 ¹ A-1, A-2-4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 12" (300 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 6" (150 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS. ROLLER GROSS VEHICLE WEIGHT NOT TO EXCEED 12,000 lbs (53 kN), DYNAMIC FORCE NOT TO EXCEED 20,000 lbs (89 kN).
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE OR RECYCLED CONCRETE ⁵	AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE OR RECYCLED CONCRETE ⁵	AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

- PLEASE NOTE:
- THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
 - STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR.
 - WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
 - ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.
 - WHERE RECYCLED CONCRETE AGGREGATE IS USED IN LAYERS 'A' OR 'B' THE MATERIAL SHOULD ALSO MEET THE ACCEPTABILITY CRITERIA OUTLINED IN TECHNICAL NOTE 6.20 "RECYCLED CONCRETE STRUCTURAL BACKFILL".

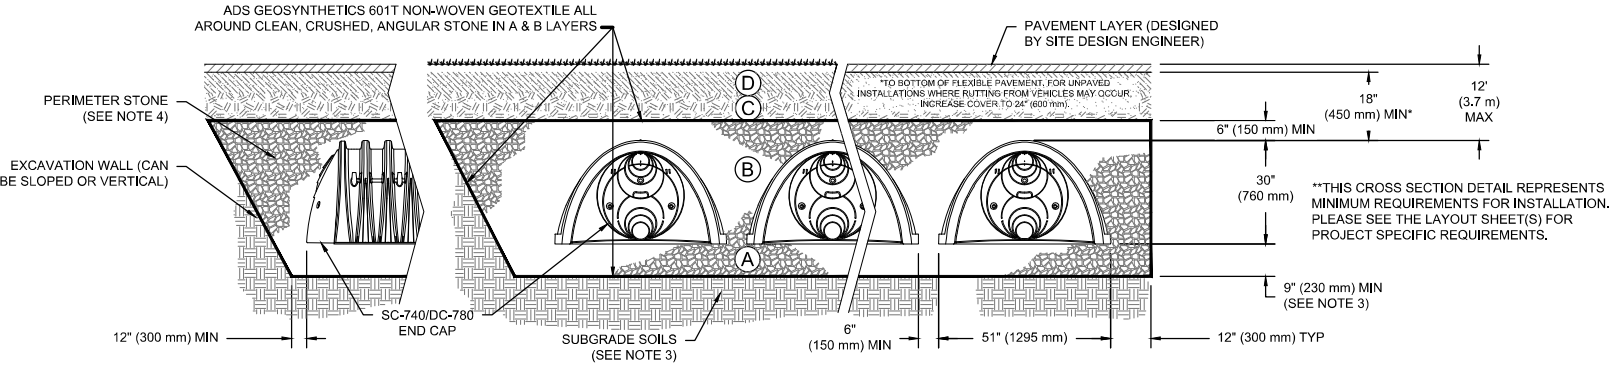

NOTES:


- CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- DC-780 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS. REFERENCE STORMTECH DESIGN MANUAL FOR BEARING CAPACITY GUIDANCE.
- PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 2".
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT SHALL BE GREATER THAN OR EQUAL TO 500 LBS/FT²%. THE ASC IS DEFINED IN SECTION 6.2.8 OF ASTM F2418, AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

5510 BOUNDARY ROAD - NORTH
OTTAWA, ON, CANADA
DATE: 10/07/2025
PROJECT #:
DRAWN: HN
CHECKED: N/A

StormTech®
Chamber System

4640 TRUENAM BLVD
HILLIARD, OH 43026
1-800-733-7473
ADS

SHEET
3 OF 6

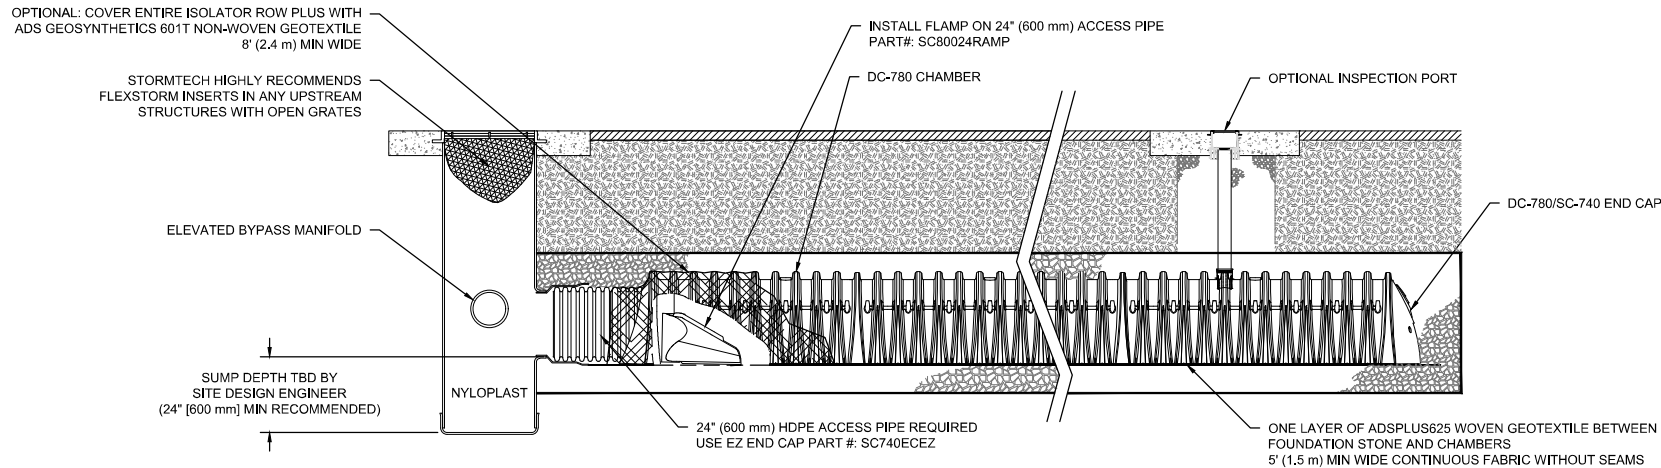

DC-780 ISOLATOR ROW PLUS DETAIL
NTS

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT
- A. INSPECTION PORTS (IF PRESENT)
- A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
- A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
- A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
- A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
- A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- B. ALL ISOLATOR PLUS ROWS
- B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS
- B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW PLUS THROUGH OUTLET PIPE
- i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
- ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
- B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS
- A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
- B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
- C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES

- INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
- CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

5510 BOUNDARY ROAD -
NORTH

OTTAWA, ON, CANADA

DATE: 10/07/2025

PROJECT #:

CHECKED: N/A

DRAWN: HN

DATE

DWN

CHK

StormTech®
Chamber System

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473




SHEET

4 OF 6

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS BY THE CLIENT. ADS MAKES NO WARRANTY, REPRESENTATION OR GUARANTEE, AND ASSUMES NO LIABILITY FOR ANY ERRORS, OMISSIONS, OR INADEQUACIES IN THE DESIGN OR CONSTRUCTION OF THE PROJECT. THE DRAWING IS NOT INTENDED FOR USE IN BIDDING OR CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE USER TO ENSURE THAT THE PRODUCTS/DETAILS DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LOCAL, STATE, AND FEDERAL REQUIREMENTS.

DC-780 TECHNICAL SPECIFICATION

NTS

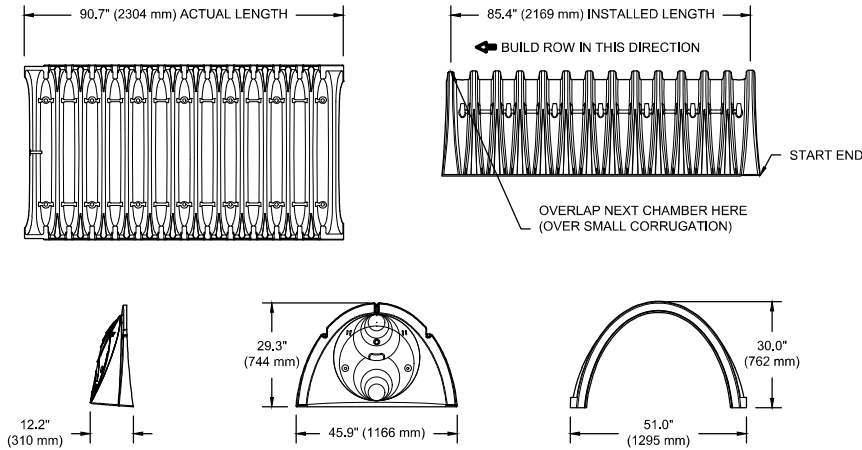

NOMINAL CHAMBER SPECIFICATIONS


SIZE (W X H X INSTALLED LENGTH)	51.0" X 30.0" X 85.4"	(1295 mm X 762 mm X 2169 mm)
CHAMBER STORAGE	46.2 CUBIC FEET	(1.30 m³)
MINIMUM INSTALLED STORAGE*	78.4 CUBIC FEET	(2.20 m³)
WEIGHT	75.0 lbs.	(33.6 kg)

NOMINAL END CAP SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	45.9" X 29.3" X 9.6"	(1166 mm X 744 mm X 244 mm)
END CAP STORAGE	2.6 CUBIC FEET	(0.07 m³)
MINIMUM INSTALLED STORAGE**	14.4 CUBIC FEET	(0.40 m³)
WEIGHT	11.7 lbs.	(5.3 kg)

* ASSUMES 6" (152 mm) STONE ABOVE, 9" (229 mm) BELOW, AND 6" (152 mm) BETWEEN CHAMBERS
** ASSUMES 6" (152 mm) STONE ABOVE, 9" (229 mm) BELOW END CAPS, 6" (152 mm) BETWEEN ROWS, 12" (305 mm) BEYOND END CAPS

PART #	STUB	B	C
SC740EPE06TPC	6" (150 mm)	18.5" (470 mm)	---
SC740EPE06BPC		---	0.5" (13 mm)
SC740EPE08TPC	8" (200 mm)	16.5" (419 mm)	---
SC740EPE08BPC		---	0.6" (15 mm)
SC740EPE10TPC	10" (250 mm)	14.5" (368 mm)	---
SC740EPE10BPC		---	0.7" (18 mm)
SC740EPE12TPC	12" (300 mm)	12.5" (318 mm)	---
SC740EPE12BPC		---	1.2" (30 mm)
SC740EPE15TPC	15" (375 mm)	9.0" (229 mm)	---
SC740EPE15BPC		---	1.3" (33 mm)
SC740EPE18TPC	18" (450 mm)	5.0" (127 mm)	---
SC740EPE18BPC		---	1.6" (41 mm)
SC740ECEZ*	24" (600 mm)	---	0.1" (3 mm)



ALL STUBS, EXCEPT FOR THE SC740ECEZ ARE PLACED AT BOTTOM OF END CAP SUCH THAT THE OUTSIDE DIAMETER OF THE STUB IS FLUSH WITH THE BOTTOM OF THE END CAP. FOR ADDITIONAL INFORMATION CONTACT STORMTECH AT 1-888-692-2694.

* FOR THE SC740ECEZ THE 24" (600 mm) STUB LIES BELOW THE BOTTOM OF THE END CAP APPROXIMATELY 1.75" (44 mm). BACKFILL MATERIAL SHOULD BE REMOVED FROM BELOW THE N-12 STUB SO THAT THE FITTING SITS LEVEL.

NOTE: ALL DIMENSIONS ARE NOMINAL; PRE-CORED END CAPS END WITH "PC"

5510 BOUNDARY ROAD -

NORTH

OTTAWA, ON, CANADA

DRAWN: HN


CHECKED: N/A

PROJECT #:

DATE: 10/07/2025

DATE DWN C-K

NTS

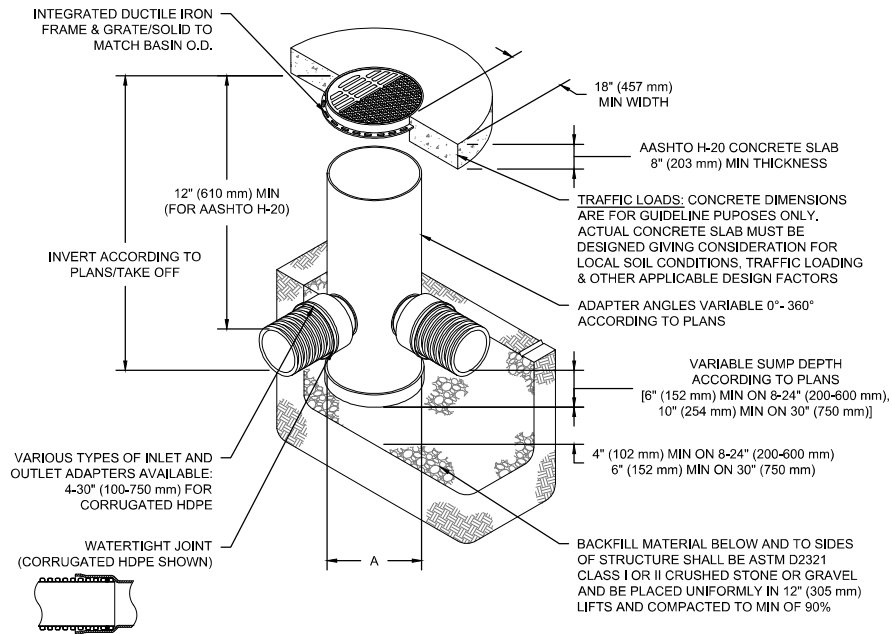

1. 8-30" (200-750 mm) GRATES/SOLID COVERS SHALL BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05
2. 12-30" (300-750 mm) FRAMES SHALL BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05
3. DRAIN BASIN TO BE CUSTOM MANUFACTURED ACCORDING TO PLAN DETAILS
4. DRAINAGE CONNECTION STUB JOINT TIGHTNESS SHALL CONFORM TO ASTM D3212 FOR CORRUGATED HDPE (ADD S HANCOR DUAL WALL) & SDR 35 PVC
5. FOR COMPLETE DESIGN AND PRODUCT INFORMATION: WWW.NYLOPLAST-US.COM
6. TO ORDER CALL: 800-821-6710

A	PART #	GRATE/SOLID COVER OPTIONS		
8" (200 mm)	2808AG	PEDESTRIAN LIGHT DUTY	STANDARD LIGHT DUTY	SOLID LIGHT DUTY
10" (250 mm)	2810AG	PEDESTRIAN LIGHT DUTY	STANDARD LIGHT DUTY	SOLID LIGHT DUTY
12" (300 mm)	2812AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
15" (375 mm)	2815AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
18" (450 mm)	2818AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
24" (600 mm)	2824AG	PEDESTRIAN AASHTO H-10	STANDARD AASHTO H-20	SOLID AASHTO H-20
30" (750 mm)	2830AG	PEDESTRIAN AASHTO H-20	STANDARD AASHTO H-20	SOLID AASHTO H-20

5510 BOUNDARY ROAD -
NORTH

DATE: 10/07/2025	DRAWN: HN
PROJECT #:	CHECKED: N/A


[illegible]

Nyloplast®

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ASSISTANT/ARCHITECT UNDER THE DIRECTION OF THE PROJECT'S ENGINEER OF RECORD. FOR YOUR PROTECT REPRESENTATIVE. THIS DRAWING IS NOT INTENDED FOR USE IN BIDDING OR CONSTRUCTION. THE DRAWING IS THE PROPERTY OF THE ENGINEER OF RECORD. IT IS THE ULTIMATE RESPONSIBILITY OF THE EOR TO ENSURE THAT THE PRODUCT(S) DEFICED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE AWS, REGULATIONS AND PROJECT REQUIREMENTS.

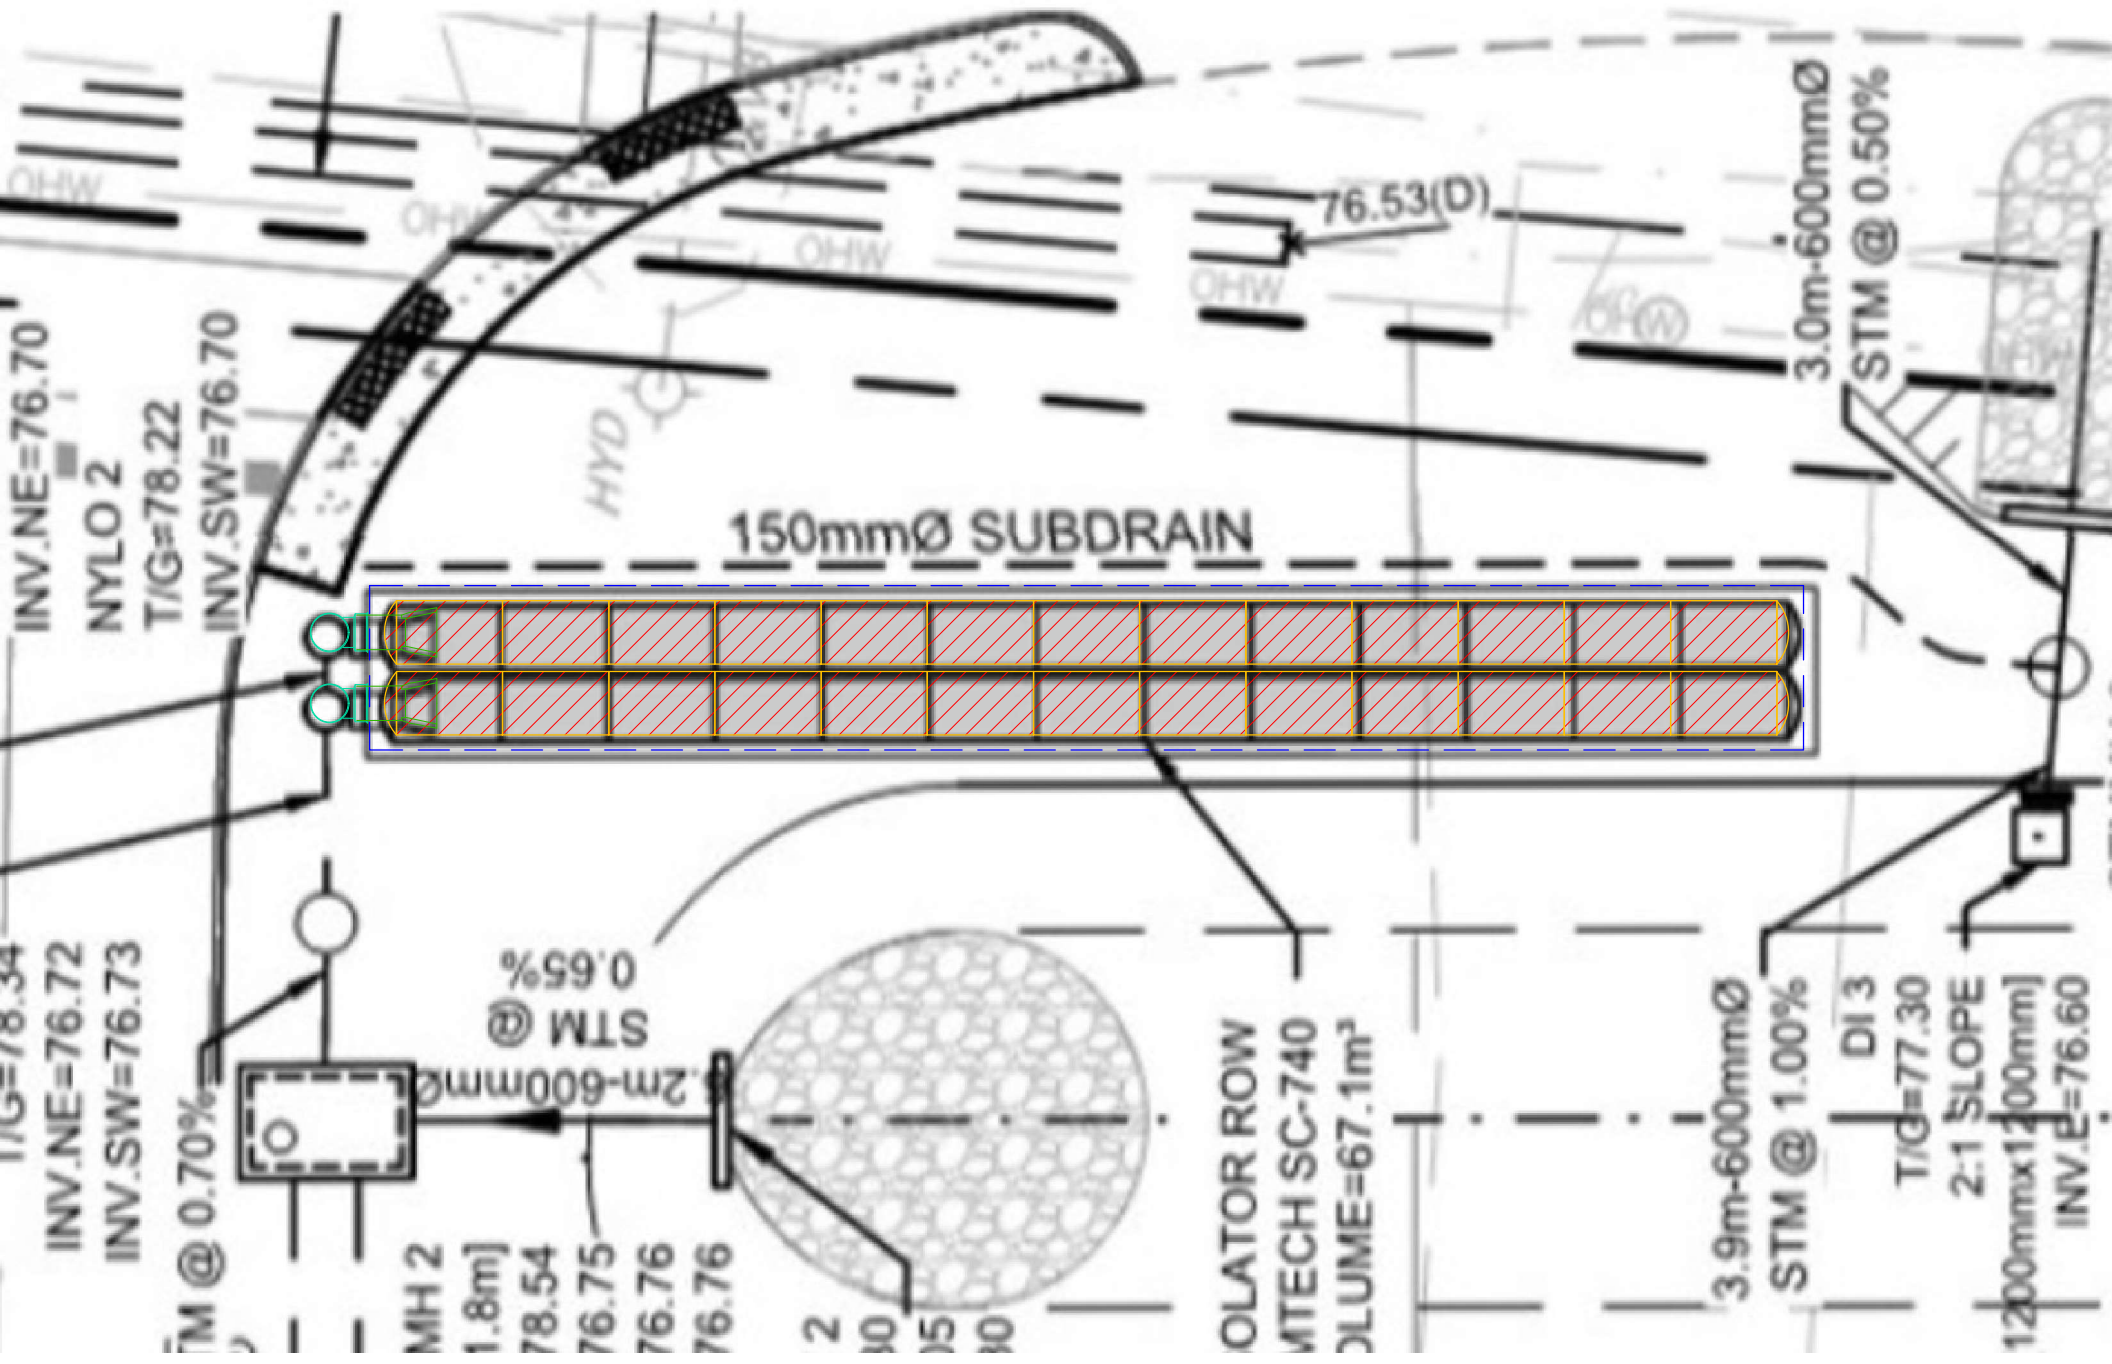

PROJECT INFORMATION	
ENGINEERED PRODUCT MANAGER	
ADS SALES REP	
PROJECT NO.	



5510 BOUNDARY ROAD - SOUTH

OTTAWA, ON, CANADA

DC-780 STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH DC-780.
- CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBERS SHALL BE CERTIFIED TO CSA B184, "POLYMERIC SUB-SURFACE STORMWATER MANAGEMENT STRUCTURES", AND MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE CSA S6 CL-625 TRUCK AND THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
- CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOUS (<1 MIN) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT (75-YR) COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK) AASHTO DESIGN TRUCK.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 50 mm (2").
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/FT³%, AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 23° C / 73° F), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:
 - THE STRUCTURAL EVALUATION SHALL BE SEALED BY A REGISTERED PROFESSIONAL ENGINEER.
 - THE STRUCTURAL EVALUATION SHALL DEMONSTRATE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY SECTIONS 3 AND 12.12 OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS FOR THERMOPLASTIC PIPE.
 - THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.
- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH NOTE #6.32 FOR MANIFOLD SIZING GUIDANCE. DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- ADS DOES NOT DESIGN OR PROVIDE MEMBRANE LINER SYSTEMS. TO MINIMIZE THE LEAKAGE POTENTIAL OF LINER SYSTEMS, THE MEMBRANE LINER SYSTEM SHOULD BE DESIGNED BY A KNOWLEDGEABLE GEOTEXTILE PROFESSIONAL AND INSTALLED BY A QUALIFIED CONTRACTOR.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF THE DC-780 CHAMBER SYSTEM

- STORMTECH DC-780 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
- STORMTECH DC-780 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM - 150 mm (6") SPACING BETWEEN THE CHAMBER ROWS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE OR RECYCLED CONCRETE; AASHTO M43 #3, 357, 4, 467, 5, 56, OR 57.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.


NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH DC-780 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
- THE USE OF CONSTRUCTION EQUIPMENT OVER DC-780 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER TIERED LOADERS, DUMP TRUCKS, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH SC-310/SC-740/DC-780 CONSTRUCTION GUIDE".
- FULL 900 mm (36") OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.

USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO THE CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-800-821-6710 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT			PROPOSED ELEVATIONS			*INVERT ABOVE BASE OF CHAMBER			
26	STORMTECH DC-780 CHAMBERS		MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):	81.117	PART TYPE	ITEM ON LAYOUT	DESCRIPTION	INVERT	MAX FLOW
4	STORMTECH DC-780 END CAPS		MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):	78.069					
152	STONE ABOVE (mm)	152	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):	77.917	PREFABRICATED EZ END CAP	A	600 mm BOTTOM PREFABRICATED EZ END CAP, PART#: SC740ECEZ / TYP OF ALL 600 mm	3 mm	
152	STONE BELOW (mm)		MINIMUM ALLOWABLE GRADE (TOP OF RIGID CONCRETE PAVEMENT):	77.917	FLAMP	B	BOTTOM CONNECTIONS AND ISOLATOR PLUS ROWS		
40	STONE VOID		MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):	77.917			INSTALL FLAMP ON 600 mm ACCESS PIPE / PART#: SC80024RAMP (TYP 2 PLACES)		
62.5	INSTALLED SYSTEM VOLUME (m³) (PERIMETER STONE INCLUDED)		TOP OF STONE:	77.917	NYLOPLAST (INLET W/ ISO PLUS ROW)	C	750 mm DIAMETER (610 mm SUMP MIN)		
	(BASE STONE INCLUDED)		TOP OF DC-780 CHAMBER:	77.612	NYLOPLAST (INLET W/ ISO PLUS ROW)	D	750 mm DIAMETER (610 mm SUMP MIN)		
98.2	SYSTEM AREA (m²)		600 mm ISOLATOR ROW PLUS INVERT:	77.460					
65.3	SYSTEM PERIMETER (m)		600 mm ISOLATOR ROW PLUS INVERT:	76.700					
			BOTTOM OF DC-780 CHAMBER:	76.698					
			BOTTOM OF STONE:	76.546					

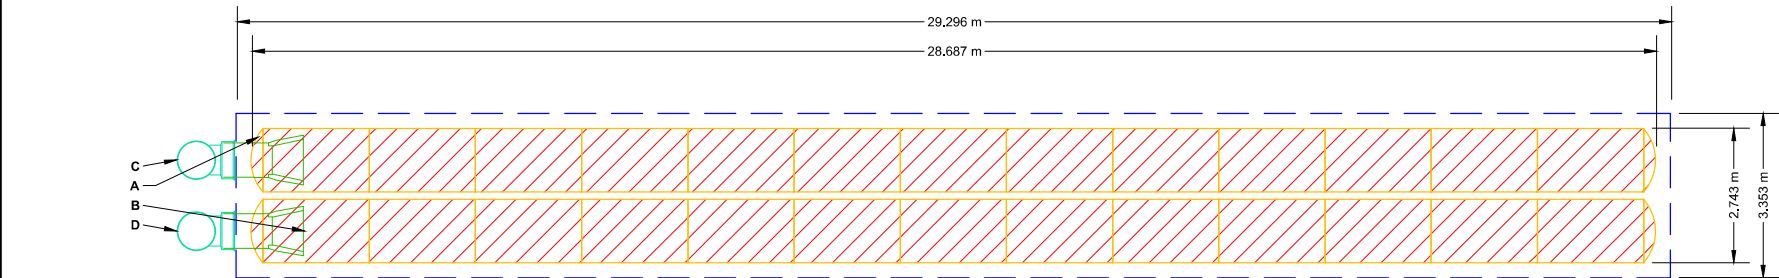

- ISOLATOR ROW PLUS (SEE DETAIL)
- NO WOVEN GEOTEXTILE
- BED LIMITS

NOTES

- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- NOT FOR CONSTRUCTION:** THIS LAYOUT IS FOR DIMENSIONAL PURPOSES ONLY TO PROVE CONCEPT & THE REQUIRED STORAGE VOLUME CAN BE ACHIEVED ON SITE.

5510 BOUNDARY ROAD - SOUTH
OTTAWA, ON, CANADA

DATE: 10/07/2025
PROJECT #:
CHECKED: N/A

DATE: DWN: C-K

StormTech®
Chamber System

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473

SCALE = 1 : 100

SHEET
2 OF 6


THE DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADJUST TO THE DIRECTION OF THE PROJECT. THE DRAWING IS NOT INTENDED FOR USE IN BIDDING OR CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE EOR TO ENSURE THAT THE PRODUCTS/DETAILS DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LOCAL, STATE, AND FEDERAL REQUIREMENTS.

ACCEPTABLE FILL MATERIALS: STORMTECH DC-780 CHAMBER SYSTEMS

MATERIAL LOCATION		DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	ANY SOIL/ROCK MATERIALS, NATIVE SOILS, OR PER ENGINEER'S PLANS. CHECK PLANS FOR PAVEMENT SUBGRADE REQUIREMENTS.	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 18" (450 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	AASHTO M145 ¹ A-1, A-2-4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 12" (300 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 6" (150 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS. ROLLER GROSS VEHICLE WEIGHT NOT TO EXCEED 12,000 lbs (53 kN). DYNAMIC FORCE NOT TO EXCEED 20,000 lbs (89 kN).
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE OR RECYCLED CONCRETE ²	AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE OR RECYCLED CONCRETE ²	AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

PLEASE NOTE:

1. THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR, FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
2. STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERS WITH A VIBRATORY COMPACTOR.
3. WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
4. ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.
5. WHERE RECYCLED CONCRETE AGGREGATE IS USED IN LAYERS 'A' OR 'B' THE MATERIAL SHOULD ALSO MEET THE ACCEPTABILITY CRITERIA OUTLINED IN TECHNICAL NOTE 6.20 "RECYCLED CONCRETE STRUCTURAL BACKFILL".

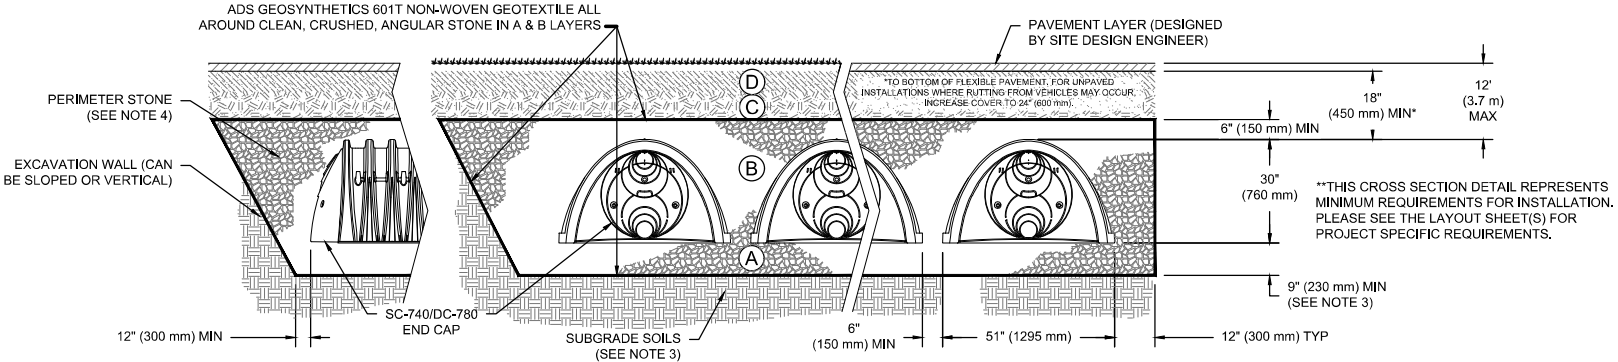

NOTES:

1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
2. DC-780 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
3. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS. REFERENCE STORMTECH DESIGN MANUAL FOR BEARING CAPACITY GUIDANCE.
4. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
5. REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 2".
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT SHALL BE GREATER THAN OR EQUAL TO 500 LBS/FT³. THE ASC IS DEFINED IN SECTION 6.2.8 OF ASTM F2418. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

5510 BOUNDARY ROAD -
SOUTH

DRAWN: HN

DATE: 10/07/2025

CHECKED: N/A


PROJECT #:

StormTech®
Chamber System

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



SHEET
OF 6

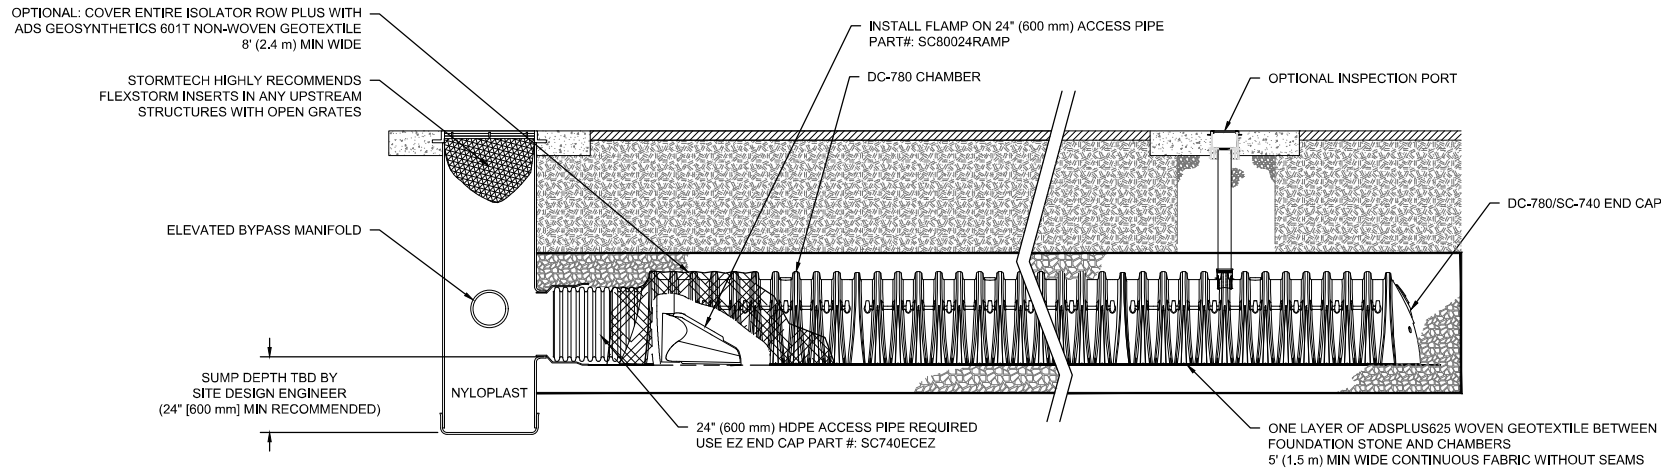

DC-780 ISOLATOR ROW PLUS DETAIL
NTS

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT
- A. INSPECTION PORTS (IF PRESENT)
- A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
- A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
- A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
- A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
- A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- B. ALL ISOLATOR ROW PLUS ROWS
- B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS
- B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW PLUS THROUGH OUTLET PIPE
- i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
- ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
- B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS
- A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
- B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
- C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES

1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
2. CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

5510 BOUNDARY ROAD -
SOUTH

OTTAWA, ON, CANADA


DRAWN: HN

CHECKED: N/A

DATE DWN C-K

StormTech®
Chamber System


4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



SHEET
4 OF 6


THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS BY THE CLIENT. ADS MAKES NO WARRANTY, REPRESENTATION OR GUARANTEE AS TO THE ACCURACY, COMPLETENESS OR RELIABILITY OF THE INFORMATION PROVIDED. THE DRAWING IS NOT INTENDED FOR USE IN BIDDING OR CONSTRUCTION. THE DRAWING IS THE PROPERTY OF ADS AND SHALL REMAIN THE PROPERTY OF ADS. IT IS THE ULTIMATE RESPONSIBILITY OF THE USER TO ENSURE THAT THE PRODUCTS/DETAILS DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LOCAL, STATE, AND FEDERAL REQUIREMENTS.

NTS

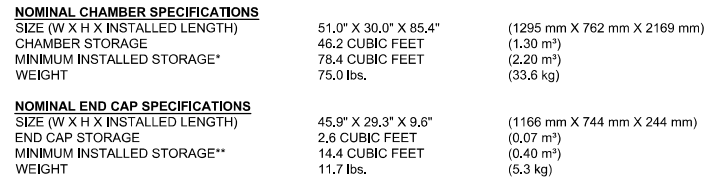

PART #	STUB	B	C
SC740EPE06TPC	6" (150 mm)	18.5" (470 mm)	---
SC740EPE06BPC		---	0.5" (13 mm)
SC740EPE08TPC	8" (200 mm)	16.5" (419 mm)	---
SC740EPE08BPC		---	0.6" (15 mm)
SC740EPE10TPC	10" (250 mm)	14.5" (368 mm)	---
SC740EPE10BPC		---	0.7" (18 mm)
SC740EPE12TPC	12" (300 mm)	12.5" (318 mm)	---
SC740EPE12BPC		---	1.2" (30 mm)
SC740EPE15TPC	15" (375 mm)	9.0" (229 mm)	---
SC740EPE15BPC		---	1.3" (33 mm)
SC740EPE18TPC	18" (450 mm)	5.0" (127 mm)	---
SC740EPE18BPC		---	1.6" (41 mm)
SC740ECEZ*	24" (600 mm)	---	0.1" (3 mm)

NOTE: ALL DIMENSIONS ARE NOMINAL; PRE-CORED END CAPS END WITH "PC"



PROJECT #:	CHECKED: N/A
------------	--------------


[illegible]

StormTech®
Chamber System

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



SHEET
OF 6

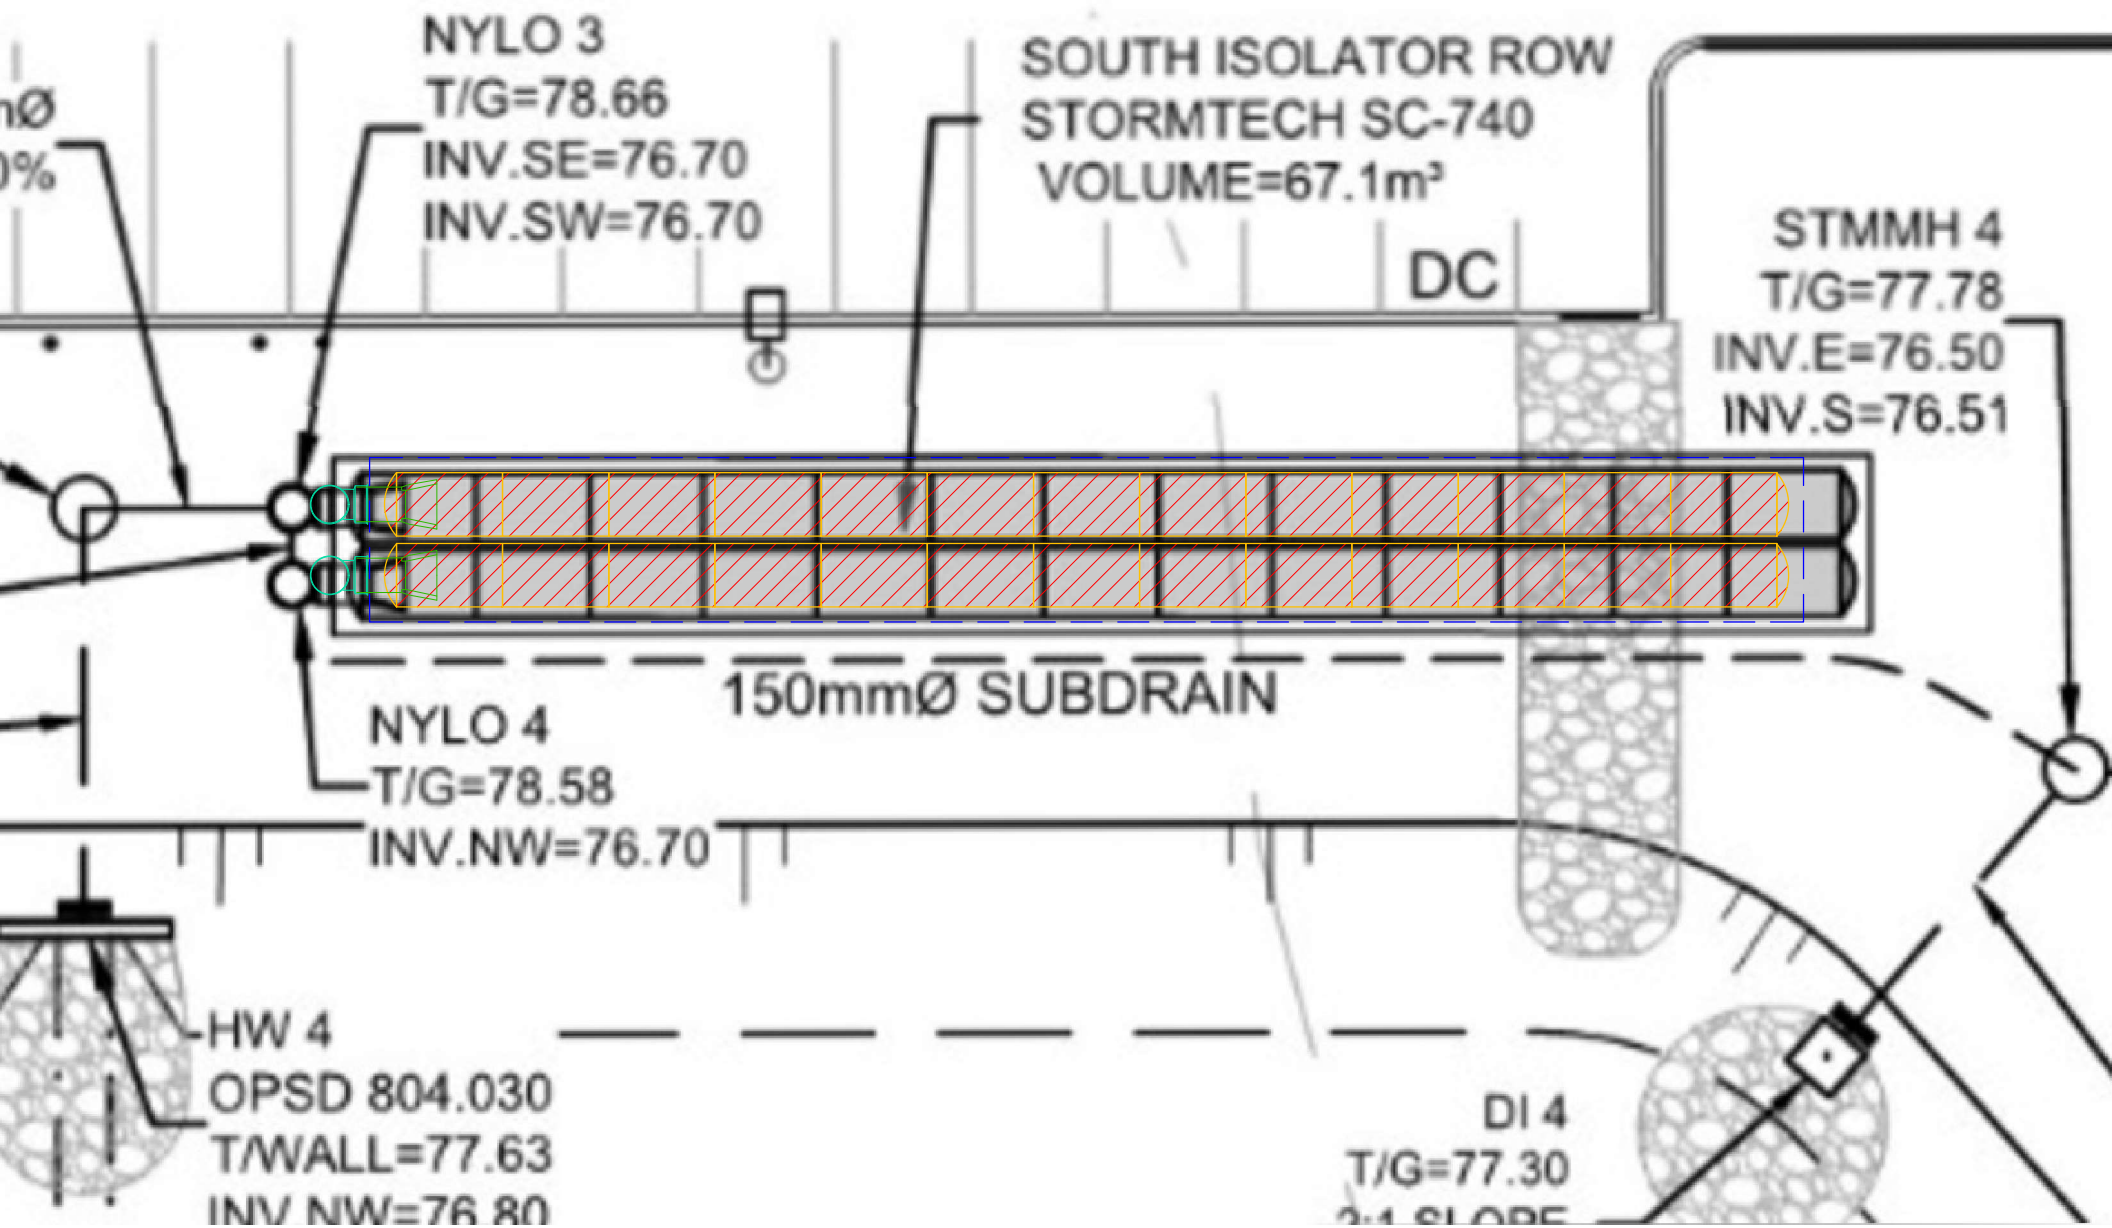

APPENDIX D

Referenced Reports

MEMORANDUM

DATE: OCTOBER 5, 2020
TO: MATT HREHORIAK
FROM: CONRAD STANG
RE: PROPOSED WAREHOUSE COMPLEX
5510 BOUNDARY ROAD (OTTAWA, ON)
SUPPLEMENTAL SWM MODELLING INFORMATION

PROJECT NO: 118168

This memorandum provides the supplemental stormwater management (SWM) modelling information for the proposed warehouse complex at 5510 Boundary Road (Ottawa, Ontario) in support of the detailed design report, prepared by Novatech.

The Visual Otthymo hydrologic model was used to estimate pre-development peak flows (quantity control targets) for the site. The pre-development drainage area is based on the proposed development area. Refer to the Pre-Development Storm Drainage Area Plan provided in the detailed design report.

Design Storms

The design storms are based on the IDF parameters presented in the City of Ottawa Sewer Design Guidelines (October 2012). Storm distributions include the 3-hour Chicago and 12-hour SCS Type II storm distributions. Design storms were created for the 2, 5, and 100-year return periods (i.e. storm events).

Model Parameters

Pre-development conditions were established using data collected through the latest aerial photography (current site conditions), latest topographic mapping and geotechnical investigations.

The pre-development catchments were modelled using the CALIB NASHYD routine with the following parameters:

- The “standard” CN values were estimated based on area weighting the CN values for each associated land cover and soil types (extracted from reference TR-55 CN values).
- The surficial soil type is primarily fill material consisting of silty clay with sand, gravel and cobbles overlying thin layer of very loose to compact silty sand (estimated hydrologic soil group (HSG) ‘C’). The geotechnical investigation was performed by Paterson Group; report dated September 10, 2018 (Report No. PG4592-1).
- The Ia values were estimated based on CN values using $0.10 * S$.

- The number of linear reservoirs (N) was estimated to be $N = 3.0$, which is typical for catchments within Ontario.
- Time-to-peak (T_p) values were calculated using Airport Method, with a minimum 10-minute time-of-concentration (T_c). $T_p = 0.67 * T_c$.

A summary of the pre-development model parameters, model schematic and detailed model output for the 2-year, 5-year, and 100-year storm events are attached.

Peak Flows

The estimated pre-development peak flows are presented in Table 1 below.

Table 1: Summary of Pre-development Peak Flows

Area ID	Drainage Area (ha)	Peak Flow (m³/s)					
		3-hour Chicago Storm			12-hour SCS Type II Storm		
		2-yr	5-yr	100-yr	2-yr	5-yr	100-yr
Area 'A'							
PRE	6.94	0.129	0.221	0.519	0.168	0.270	0.574

As the 3-hour Chicago storm distribution results in lower peak flows, the post-development quantity control requirements and release rates will need to adhere to these peak flows.


ATTACHMENTS:

- Visual Otthymo Model Parameters
- Visual Otthymo Detailed Model Output (3-hour Chicago & 12-hour SCS storm distributions)

M:\2018\118168\CAD\Design\Figures\118168-EXSWM.dwg, EX SWM, Mar 18, 2021 - 3:07pm, jkaloudas

LEGEND


--- EXISTING STORM DRAINAGE AREA



DRAINAGE AREA ID

DRAINAGE AREA (ha)

SCS CURVE NUMBER



NOVATECH

Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6


Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

5510 BOUNDARY ROAD

PRE-DEVELOPMENT DRAINAGE AREA PLAN

SCALE 1 : 1250

DATE MAR 2021 JOB 118168 FIGURE 5

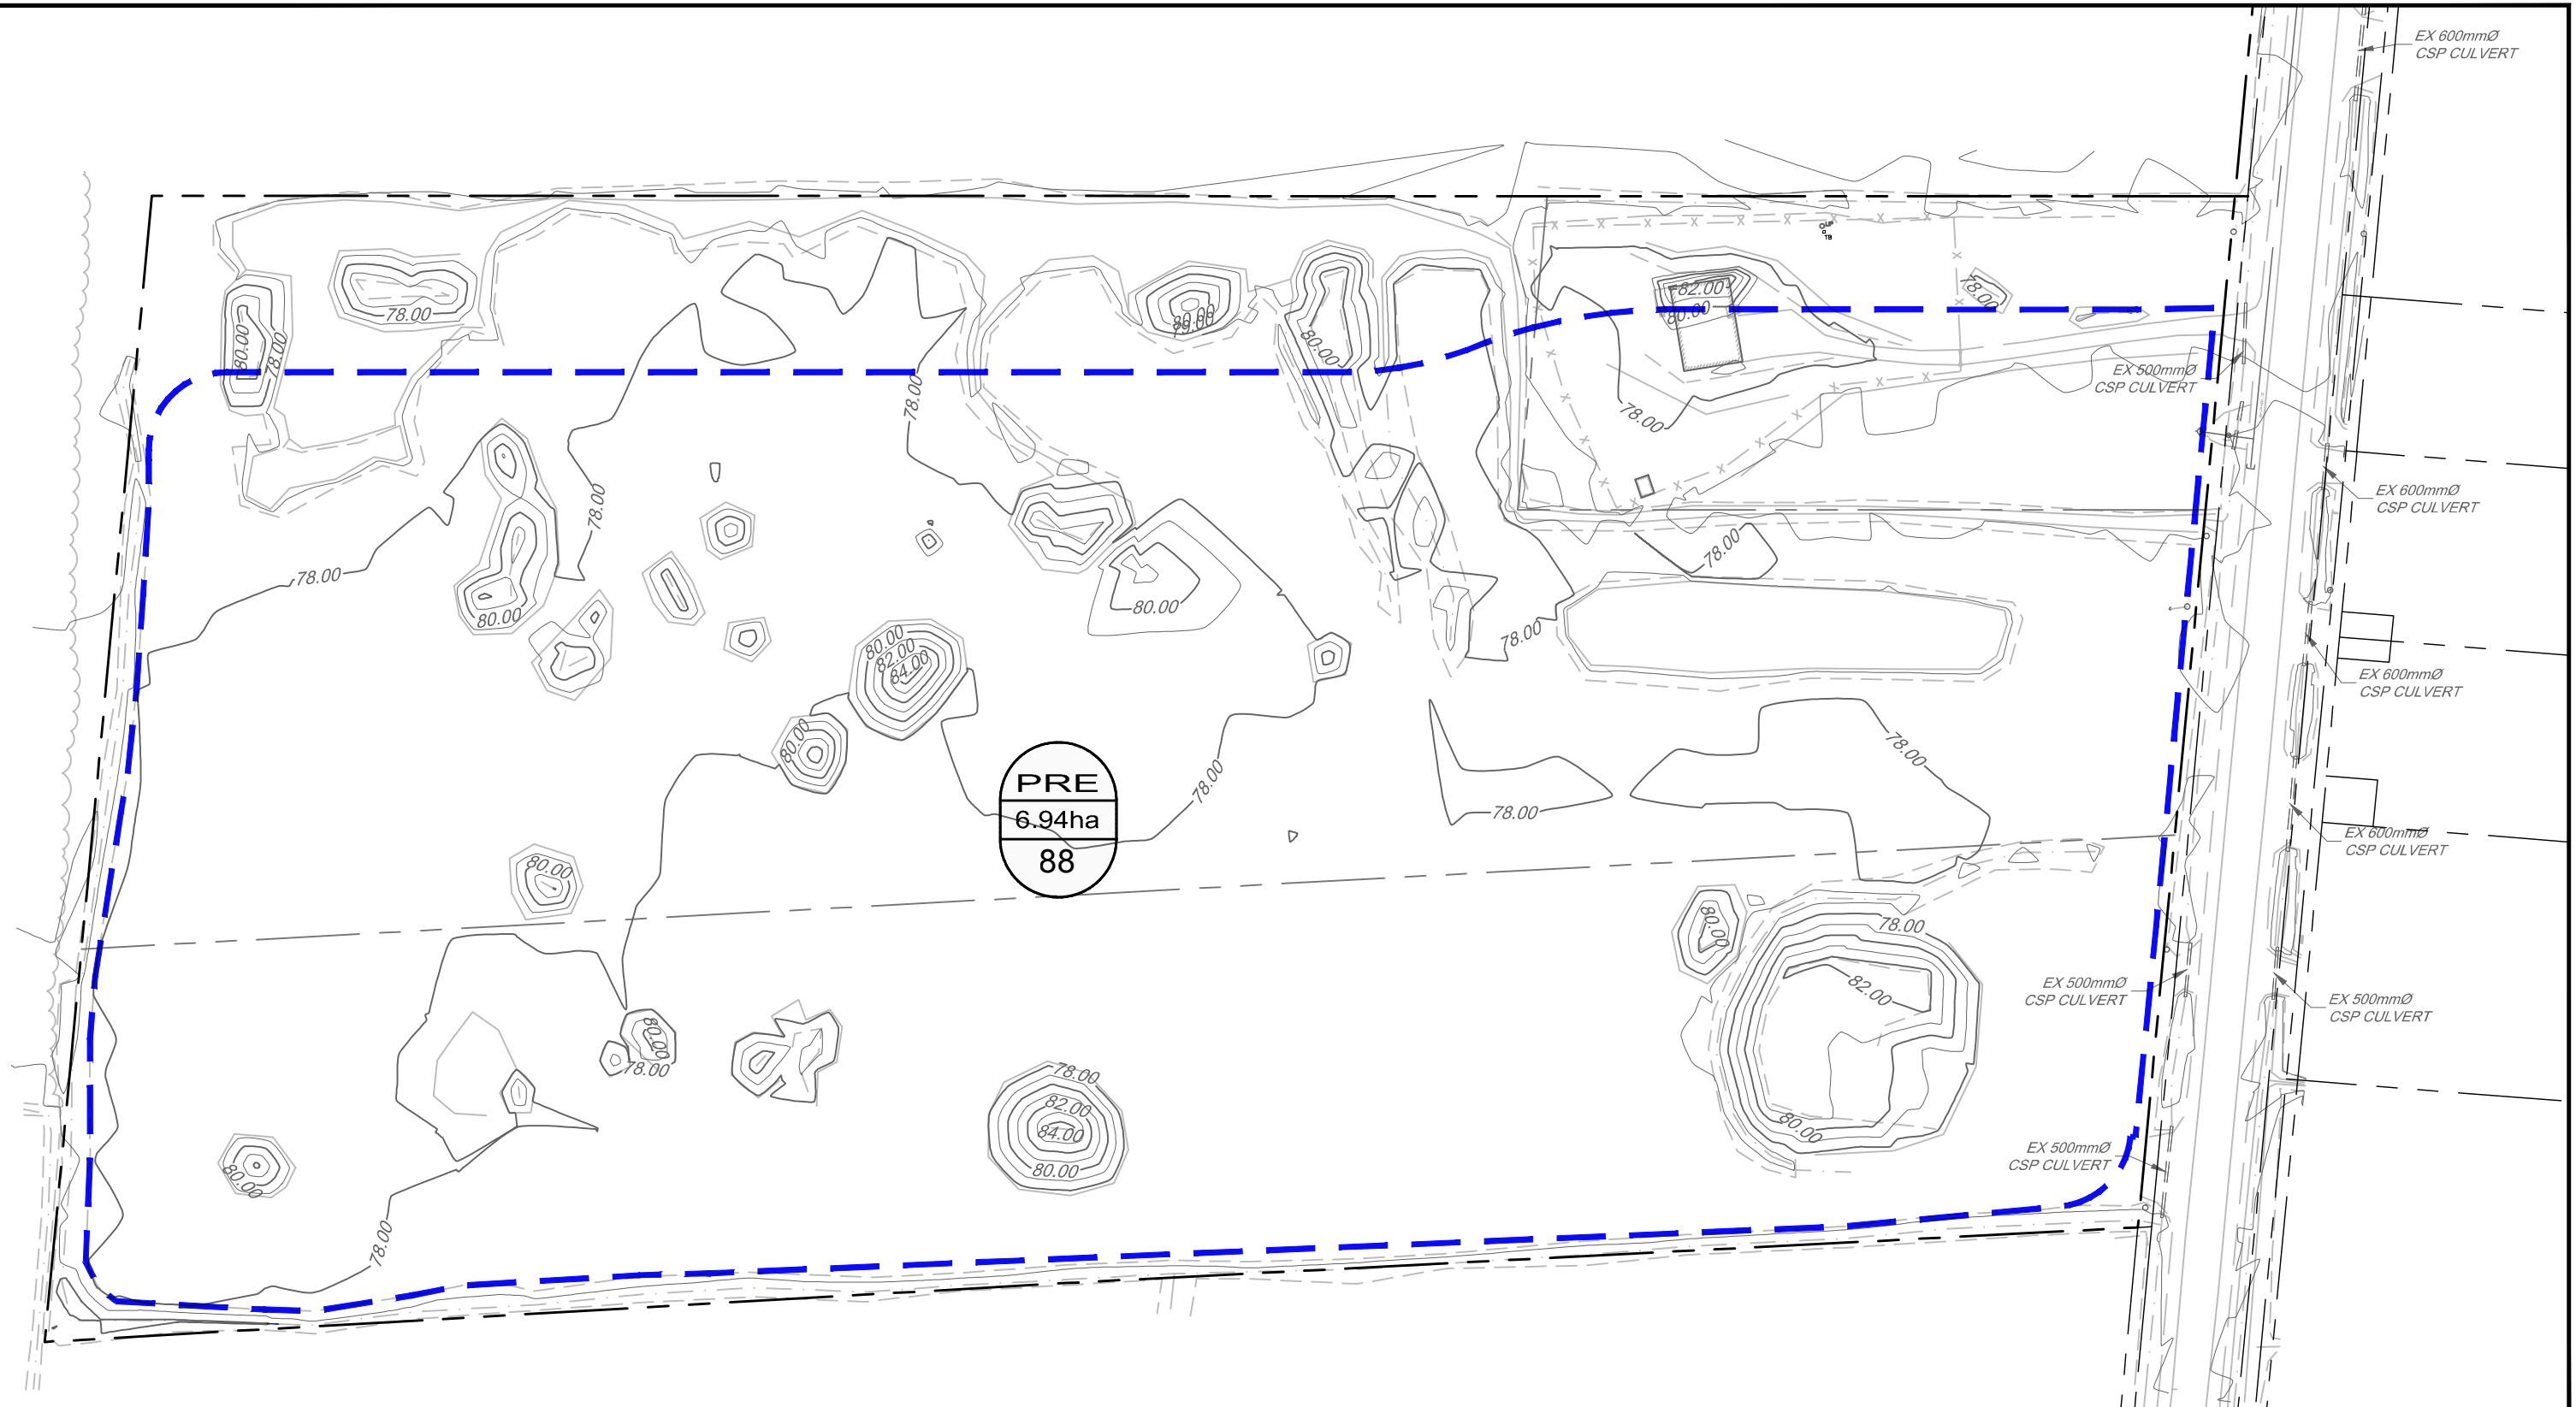

Proposed Warehouse Complex - 5510 Boundary Road (Ottawa, ON)
Visual Otthymo Model Parameters (118168)

NASHYD's (Pre-Development)				
Land Cover	Hydrologic Soil Group (HSG)	Area (ha)	SCS Curve Number (CN)	Initial Abstraction (Ia)* (mm)
Open Water	HSG 'C'	0.29	50	25.4
Meadow	HSG 'C'	0.50	71	10.4
Fallow Field (Bare Soil)	HSG 'C'	6.15	91	2.5
TOTAL (PRE)	-	6.94	88	5.0

*Initial Abstraction based on $0.10 \cdot S$. $S = 25400 / CN - 254$

Time-to-Peak (Tp) Calculations (Airport Method) (NASHYD's)				
Runoff Coefficient (C)	Average Slope (%)	Flow Path Length (m)	Time-of-Concentration (Tc) (min)	Time-to-Peak (Tp)* (hours)
0.20	0.25	150	57	0.63

* $Tp = 0.67 \cdot Tc$

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)

Visual Otthymo Model Schematic



Storm Distributions:

Run 01: 2-year, 3-hour Chicago Storm
Run 02: 5-year, 3-hour Chicago Storm
Run 03: 100-year, 3-hour Chicago Storm

Run 04: 2-year, 12-hour SCS Storm
Run 05: 5-year, 12-hour SCS Storm
Run 06: 100-year, 12-hour SCS Storm

=====

```
V  V  I  SSSSS  U  U  A  L  (v 5.1.2000)
V  V  I  SS    U  U  A  A  L
V  V  I  SS    U  U  AAAAA L
V  V  I  SS    U  U  A  A  L
VV    I  SSSSS  UUUUU  A  A  LLLLL

  OOO  TTTT  TTTT  H  H  Y  Y  M  M  OOO  TM
O  O  T      T  H  H  Y  Y  MM MM  O  O
O  O  T      T  H  H  Y  M  M  O  O
  OOO  T      T  H  H  Y  M  M  OOO
```

Developed and Distributed by Civica Infrastructure
Copyright 2007 – 2013 Civica Infrastructure
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 5.1\VO2\voin.dat
Output filename: C:\Users\cstang\AppData\Local\Civica\XH5\6c732c44-3f8e-4d1e-b713-5e03d621a144\0a3a2f80-fc19-4e8b-a3a4-fca80fbc9b41\scena
Summary filename: C:\Users\cstang\AppData\Local\Civica\XH5\6c732c44-3f8e-4d1e-b713-5e03d621a144\0a3a2f80-fc19-4e8b-a3a4-fca80fbc9b41\scena

DATE: 10/05/2020

TIME: 12:46:55

USER:

COMMENTS: _____

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)

** SIMULATION : Run 01 **

READ STORM	Filename: C:\Users\cstang\AppData Local\Temp\ 3423a1c4-1884-4f21-baad-4d458bc37917\d23ad515
Ptotal= 31.86 mm	Comments: C3-2

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.17	2.81	1.00	76.81	1.83	5.09	2.67	2.68
0.33	3.50	1.17	24.08	2.00	4.29	2.83	2.46
0.50	4.69	1.33	12.36	2.17	3.72	3.00	2.28
0.67	7.30	1.50	8.32	2.33	3.29		
0.83	18.21	1.67	6.30	2.50	2.95		

CALIB			
NASHYD (0001)	Area (ha)= 6.94	Curve Number (CN)= 88.0	
ID= 1 DT= 5.0 min	Ia (mm)= 5.00	# of Linear Res. (N)= 3.00	
	U.H. Tp(hrs)= 0.63		

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	2.81	0.833	18.21	1.583	6.30	2.33	3.29
0.167	2.81	0.917	76.81	1.667	6.30	2.42	2.95
0.250	3.50	1.000	76.81	1.750	5.09	2.50	2.95
0.333	3.50	1.083	24.08	1.833	5.09	2.58	2.68
0.417	4.69	1.167	24.08	1.917	4.29	2.67	2.68
0.500	4.69	1.250	12.36	2.000	4.29	2.75	2.46
0.583	7.30	1.333	12.36	2.083	3.72	2.83	2.46
0.667	7.30	1.417	8.32	2.167	3.72	2.92	2.28
0.750	18.21	1.500	8.32	2.250	3.29	3.00	2.28

Unit Hyd Qpeak (cms)= 0.421

PEAK FLOW (cms)= 0.129 (i)
TIME TO PEAK (hrs)= 1.750
RUNOFF VOLUME (mm)= 11.729
TOTAL RAINFALL (mm)= 31.857
RUNOFF COEFFICIENT = 0.368

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)

** SIMULATION : Run 02 **

READ STORM	Filename: C:\Users\cstang\AppData ata\Local\Temp\ 3423a1c4-1884-4f21-baad-4d458bc37917\b96d6d94
Ptotal= 42.51 mm	Comments: C3-5

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.17	3.68	1.00	104.19	1.83	6.69	2.67	3.51
0.33	4.58	1.17	32.04	2.00	5.63	2.83	3.22
0.50	6.15	1.33	16.34	2.17	4.87	3.00	2.98
0.67	9.61	1.50	10.96	2.33	4.30		
0.83	24.17	1.67	8.29	2.50	3.86		

CALIB			
NASHYD (0001)	Area (ha)= 6.94	Curve Number (CN)= 88.0	
ID= 1 DT= 5.0 min	Ia (mm)= 5.00	# of Linear Res. (N)= 3.00	
	U.H. Tp(hrs)= 0.63		

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	3.68	0.833	24.17	1.583	8.29	2.33	4.30
0.167	3.68	0.917	104.19	1.667	8.29	2.42	3.86
0.250	4.58	1.000	104.19	1.750	6.69	2.50	3.86
0.333	4.58	1.083	32.04	1.833	6.69	2.58	3.51
0.417	6.15	1.167	32.04	1.917	5.63	2.67	3.51
0.500	6.15	1.250	16.34	2.000	5.63	2.75	3.22
0.583	9.61	1.333	16.34	2.083	4.87	2.83	3.22
0.667	9.61	1.417	10.96	2.167	4.87	2.92	2.98
0.750	24.17	1.500	10.96	2.250	4.30	3.00	2.98

Unit Hyd Qpeak (cms)= 0.421

PEAK FLOW (cms)= 0.221 (i)
TIME TO PEAK (hrs)= 1.750
RUNOFF VOLUME (mm)= 19.503
TOTAL RAINFALL (mm)= 42.512
RUNOFF COEFFICIENT = 0.459

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)

** SIMULATION : Run 03 **

READ STORM	Filename: C:\Users\cstang\AppData ata\Local\Temp\ 3423a1c4-1884-4f21-baad-4d458bc37917\el438c1c
Ptotal= 71.67 mm	Comments: C3-100

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.17	6.05	1.00	178.56	1.83	11.06	2.67	5.76
0.33	7.54	1.17	54.05	2.00	9.29	2.83	5.28
0.50	10.16	1.33	27.32	2.17	8.02	3.00	4.88
0.67	15.97	1.50	18.24	2.33	7.08		
0.83	40.65	1.67	13.74	2.50	6.35		

CALIB			
NASHYD (0001)	Area (ha)= 6.94	Curve Number (CN)= 88.0	
ID= 1 DT= 5.0 min	Ia (mm)= 5.00	# of Linear Res. (N)= 3.00	
	U.H. Tp(hrs)= 0.63		

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	6.05	0.833	40.65	1.583	13.74	2.33	7.08
0.167	6.05	0.917	178.56	1.667	13.74	2.42	6.35
0.250	7.54	1.000	178.56	1.750	11.06	2.50	6.35
0.333	7.54	1.083	54.05	1.833	11.06	2.58	5.76
0.417	10.16	1.167	54.05	1.917	9.29	2.67	5.76
0.500	10.16	1.250	27.32	2.000	9.29	2.75	5.28
0.583	15.97	1.333	27.32	2.083	8.02	2.83	5.28
0.667	15.97	1.417	18.24	2.167	8.02	2.92	4.88
0.750	40.65	1.500	18.24	2.250	7.08	3.00	4.88

Unit Hyd Qpeak (cms)= 0.421

PEAK FLOW (cms)= 0.519 (i)
TIME TO PEAK (hrs)= 1.667
RUNOFF VOLUME (mm)= 43.872
TOTAL RAINFALL (mm)= 71.667
RUNOFF COEFFICIENT = 0.612

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)

** SIMULATION : Run 04 **

READ STORM	Filename: C:\Users\cstang\AppData Local\Temp\ 3423a1c4-1884-4f21-baad-4d458bc37917\fceefce
Ptotal= 42.34 mm	Comments: S12-2

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.50	1.27	3.50	1.69	6.50	9.23	9.50	1.27
1.00	0.59	4.00	1.69	7.00	4.06	10.00	1.02
1.50	1.10	4.50	2.29	7.50	2.71	10.50	1.44
2.00	1.10	5.00	2.88	8.00	2.37	11.00	0.93
2.50	1.44	5.50	4.57	8.50	1.86	11.50	0.85
3.00	1.27	6.00	36.24	9.00	1.95	12.00	0.85

CALIB			
NASHYD (0001)	Area (ha)= 6.94	Curve Number (CN)= 88.0	
ID= 1 DT= 5.0 min	Ia (mm)= 5.00	# of Linear Res.(N)= 3.00	
	U.H. Tp(hrs)= 0.63		

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	1.27	3.083	1.69	6.083	9.23	9.08	1.27
0.167	1.27	3.167	1.69	6.167	9.23	9.17	1.27
0.250	1.27	3.250	1.69	6.250	9.23	9.25	1.27
0.333	1.27	3.333	1.69	6.333	9.23	9.33	1.27
0.417	1.27	3.417	1.69	6.417	9.23	9.42	1.27
0.500	1.27	3.500	1.69	6.500	9.23	9.50	1.27
0.583	0.59	3.583	1.69	6.583	4.06	9.58	1.02
0.667	0.59	3.667	1.69	6.667	4.06	9.67	1.02
0.750	0.59	3.750	1.69	6.750	4.06	9.75	1.02
0.833	0.59	3.833	1.69	6.833	4.06	9.83	1.02
0.917	0.59	3.917	1.69	6.917	4.06	9.92	1.02
1.000	0.59	4.000	1.69	7.000	4.06	10.00	1.02
1.083	1.10	4.083	2.29	7.083	2.71	10.08	1.44
1.167	1.10	4.167	2.29	7.167	2.71	10.17	1.44
1.250	1.10	4.250	2.29	7.250	2.71	10.25	1.44
1.333	1.10	4.333	2.29	7.333	2.71	10.33	1.44
1.417	1.10	4.417	2.29	7.417	2.71	10.42	1.44
1.500	1.10	4.500	2.29	7.500	2.71	10.50	1.44
1.583	1.10	4.583	2.88	7.583	2.37	10.58	0.93
1.667	1.10	4.667	2.88	7.667	2.37	10.67	0.93
1.750	1.10	4.750	2.88	7.750	2.37	10.75	0.93
1.833	1.10	4.833	2.88	7.833	2.37	10.83	0.93
1.917	1.10	4.917	2.88	7.917	2.37	10.92	0.93
2.000	1.10	5.000	2.88	8.000	2.37	11.00	0.93
2.083	1.44	5.083	4.57	8.083	1.86	11.08	0.85
2.167	1.44	5.167	4.57	8.167	1.86	11.17	0.85
2.250	1.44	5.250	4.57	8.250	1.86	11.25	0.85
2.333	1.44	5.333	4.57	8.333	1.86	11.33	0.85
2.417	1.44	5.417	4.57	8.417	1.86	11.42	0.85
2.500	1.44	5.500	4.57	8.500	1.86	11.50	0.85
2.583	1.27	5.583	36.24	8.583	1.95	11.58	0.85
2.667	1.27	5.667	36.24	8.667	1.95	11.67	0.85

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)



2.750	1.27	5.750	36.24	8.750	1.95	11.75	0.85
2.833	1.27	5.833	36.24	8.833	1.95	11.83	0.85
2.917	1.27	5.917	36.24	8.917	1.95	11.92	0.85
3.000	1.27	6.000	36.24	9.000	1.95	12.00	0.85

Unit Hyd Qpeak (cms)= 0.421

PEAK FLOW (cms)= 0.168 (i)
TIME TO PEAK (hrs)= 6.583
RUNOFF VOLUME (mm)= 19.367
TOTAL RAINFALL (mm)= 42.335
RUNOFF COEFFICIENT = 0.457

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

** SIMULATION : Run 05 **

READ STORM	Filename: C:\Users\cstang\AppData Local\Temp\ 3423a1c4-1884-4f21-baad-4d458bc37917\8f07cf7d
Ptotal= 56.19 mm	Comments: S12-5

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.50	1.69	3.50	2.25	6.50	12.25	9.50	1.69
1.00	0.79	4.00	2.25	7.00	5.39	10.00	1.35
1.50	1.46	4.50	3.03	7.50	3.60	10.50	1.91
2.00	1.46	5.00	3.82	8.00	3.15	11.00	1.24
2.50	1.91	5.50	6.07	8.50	2.47	11.50	1.12
3.00	1.69	6.00	48.08	9.00	2.58	12.00	1.12

CALIB			
NASHYD (0001)	Area (ha)= 6.94	Curve Number (CN)= 88.0	
ID= 1 DT= 5.0 min	Ia (mm)= 5.00	# of Linear Res.(N)= 3.00	
	U.H. Tp(hrs)= 0.63		

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	1.69	3.083	2.25	6.083	12.25	9.08	1.69
0.167	1.69	3.167	2.25	6.167	12.25	9.17	1.69
0.250	1.69	3.250	2.25	6.250	12.25	9.25	1.69
0.333	1.69	3.333	2.25	6.333	12.25	9.33	1.69
0.417	1.69	3.417	2.25	6.417	12.25	9.42	1.69
0.500	1.69	3.500	2.25	6.500	12.25	9.50	1.69
0.583	0.79	3.583	2.25	6.583	5.39	9.58	1.35
0.667	0.79	3.667	2.25	6.667	5.39	9.67	1.35
0.750	0.79	3.750	2.25	6.750	5.39	9.75	1.35
0.833	0.79	3.833	2.25	6.833	5.39	9.83	1.35
0.917	0.79	3.917	2.25	6.917	5.39	9.92	1.35
1.000	0.79	4.000	2.25	7.000	5.39	10.00	1.35
1.083	1.46	4.083	3.03	7.083	3.60	10.08	1.91
1.167	1.46	4.167	3.03	7.167	3.60	10.17	1.91
1.250	1.46	4.250	3.03	7.250	3.60	10.25	1.91
1.333	1.46	4.333	3.03	7.333	3.60	10.33	1.91
1.417	1.46	4.417	3.03	7.417	3.60	10.42	1.91

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON) Visual OTTHYMO Model Output (118168)

1.500	1.46	4.500	3.03	7.500	3.60	10.50	1.91
1.583	1.46	4.583	3.82	7.583	3.15	10.58	1.24
1.667	1.46	4.667	3.82	7.667	3.15	10.67	1.24
1.750	1.46	4.750	3.82	7.750	3.15	10.75	1.24
1.833	1.46	4.833	3.82	7.833	3.15	10.83	1.24
1.917	1.46	4.917	3.82	7.917	3.15	10.92	1.24
2.000	1.46	5.000	3.82	8.000	3.15	11.00	1.24
2.083	1.91	5.083	6.07	8.083	2.47	11.08	1.12
2.167	1.91	5.167	6.07	8.167	2.47	11.17	1.12
2.250	1.91	5.250	6.07	8.250	2.47	11.25	1.12
2.333	1.91	5.333	6.07	8.333	2.47	11.33	1.12
2.417	1.91	5.417	6.07	8.417	2.47	11.42	1.12
2.500	1.91	5.500	6.07	8.500	2.47	11.50	1.12
2.583	1.69	5.583	48.08	8.583	2.58	11.58	1.12
2.667	1.69	5.667	48.08	8.667	2.58	11.67	1.12
2.750	1.69	5.750	48.08	8.750	2.58	11.75	1.12
2.833	1.69	5.833	48.08	8.833	2.58	11.83	1.12
2.917	1.69	5.917	48.08	8.917	2.58	11.92	1.12
3.000	1.69	6.000	48.08	9.000	2.58	12.00	1.12

Unit Hyd Qpeak (cms)= 0.421

PEAK FLOW (cms)= 0.270 (i)
TIME TO PEAK (hrs)= 6.583
RUNOFF VOLUME (mm)= 30.527
TOTAL RAINFALL (mm)= 56.185
RUNOFF COEFFICIENT = 0.543

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

** SIMULATION : Run 06 **

READ STORM	Filename: C:\Users\cstang\AppData Local\Temp\ 3423a1c4-1884-4f21-baad-4d458bc37917\4c999c78
Ptotal= 93.91 mm	Comments: S12-100

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.50	2.82	3.50	3.76	6.50	20.47	9.50	2.82
1.00	1.31	4.00	3.76	7.00	9.02	10.00	2.25
1.50	2.44	4.50	5.07	7.50	6.01	10.50	3.19
2.00	2.44	5.00	6.39	8.00	5.26	11.00	2.07
2.50	3.19	5.50	10.14	8.50	4.13	11.50	1.88
3.00	2.82	6.00	80.38	9.00	4.32	12.00	1.88

CALIB			
NASHYD (0001)	Area (ha)= 6.94	Curve Number (CN)= 88.0	
ID= 1 DT= 5.0 min	Ia (mm)= 5.00	# of Linear Res.(N)= 3.00	
	U.H. Tp (hrs)= 0.63		

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	2.82	3.083	3.76	6.083	20.47	9.08	2.82
0.167	2.82	3.167	3.76	6.167	20.47	9.17	2.82

Proposed Warehouse Complex – 5510 Boundary Road (Ottawa, ON)
Visual OTTHYMO Model Output (118168)

0.250	2.82	3.250	3.76	6.250	20.47	9.25	2.82
0.333	2.82	3.333	3.76	6.333	20.47	9.33	2.82
0.417	2.82	3.417	3.76	6.417	20.47	9.42	2.82
0.500	2.82	3.500	3.76	6.500	20.47	9.50	2.82
0.583	1.31	3.583	3.76	6.583	9.02	9.58	2.25
0.667	1.31	3.667	3.76	6.667	9.02	9.67	2.25
0.750	1.31	3.750	3.76	6.750	9.02	9.75	2.25
0.833	1.31	3.833	3.76	6.833	9.02	9.83	2.25
0.917	1.31	3.917	3.76	6.917	9.02	9.92	2.25
1.000	1.31	4.000	3.76	7.000	9.02	10.00	2.25
1.083	2.44	4.083	5.07	7.083	6.01	10.08	3.19
1.167	2.44	4.167	5.07	7.167	6.01	10.17	3.19
1.250	2.44	4.250	5.07	7.250	6.01	10.25	3.19
1.333	2.44	4.333	5.07	7.333	6.01	10.33	3.19
1.417	2.44	4.417	5.07	7.417	6.01	10.42	3.19
1.500	2.44	4.500	5.07	7.500	6.01	10.50	3.19
1.583	2.44	4.583	6.39	7.583	5.26	10.58	2.07
1.667	2.44	4.667	6.39	7.667	5.26	10.67	2.07
1.750	2.44	4.750	6.39	7.750	5.26	10.75	2.07
1.833	2.44	4.833	6.39	7.833	5.26	10.83	2.07
1.917	2.44	4.917	6.39	7.917	5.26	10.92	2.07
2.000	2.44	5.000	6.39	8.000	5.26	11.00	2.07
2.083	3.19	5.083	10.14	8.083	4.13	11.08	1.88
2.167	3.19	5.167	10.14	8.167	4.13	11.17	1.88
2.250	3.19	5.250	10.14	8.250	4.13	11.25	1.88
2.333	3.19	5.333	10.14	8.333	4.13	11.33	1.88
2.417	3.19	5.417	10.14	8.417	4.13	11.42	1.88
2.500	3.19	5.500	10.14	8.500	4.13	11.50	1.88
2.583	2.82	5.583	80.38	8.583	4.32	11.58	1.88
2.667	2.82	5.667	80.38	8.667	4.32	11.67	1.88
2.750	2.82	5.750	80.38	8.750	4.32	11.75	1.88
2.833	2.82	5.833	80.38	8.833	4.32	11.83	1.88
2.917	2.82	5.917	80.38	8.917	4.32	11.92	1.88
3.000	2.82	6.000	80.38	9.000	4.32	12.00	1.88

Unit Hyd Qpeak (cms)= 0.421

PEAK FLOW (cms)= 0.574 (i)

TIME TO PEAK (hrs)= 6.500

RUNOFF VOLUME (mm)= 63.982

TOTAL RAINFALL (mm)= 93.910

RUNOFF COEFFICIENT = 0.681

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

FINISH

Time of Concentration - Existing Conditions

Uplands Overland Flow Method

Area ID	Overland Flow						Mannings Pipe Flow							Overall Time of Concentration (min)
	Length (m)	Elevation U/S (m)	Elevation D/S (m)	Slope (%)	Velocity (m/s)	Travel Time (min)	Pipe Size (mm)	Length (m)	Elevation U/S (m)	Elevation D/S (m)	Slope (%)	Velocity (m/s)	Travel Time (min)	
EX D1	260	77.16	76.65	0.20%	0.28	15.48								
EX D2	185	76.65	76.38	0.15%	0.22	14.02								
HWD	130	76.80	76.67	0.10%	0.19	11.40								

Uplands Velocity Chart

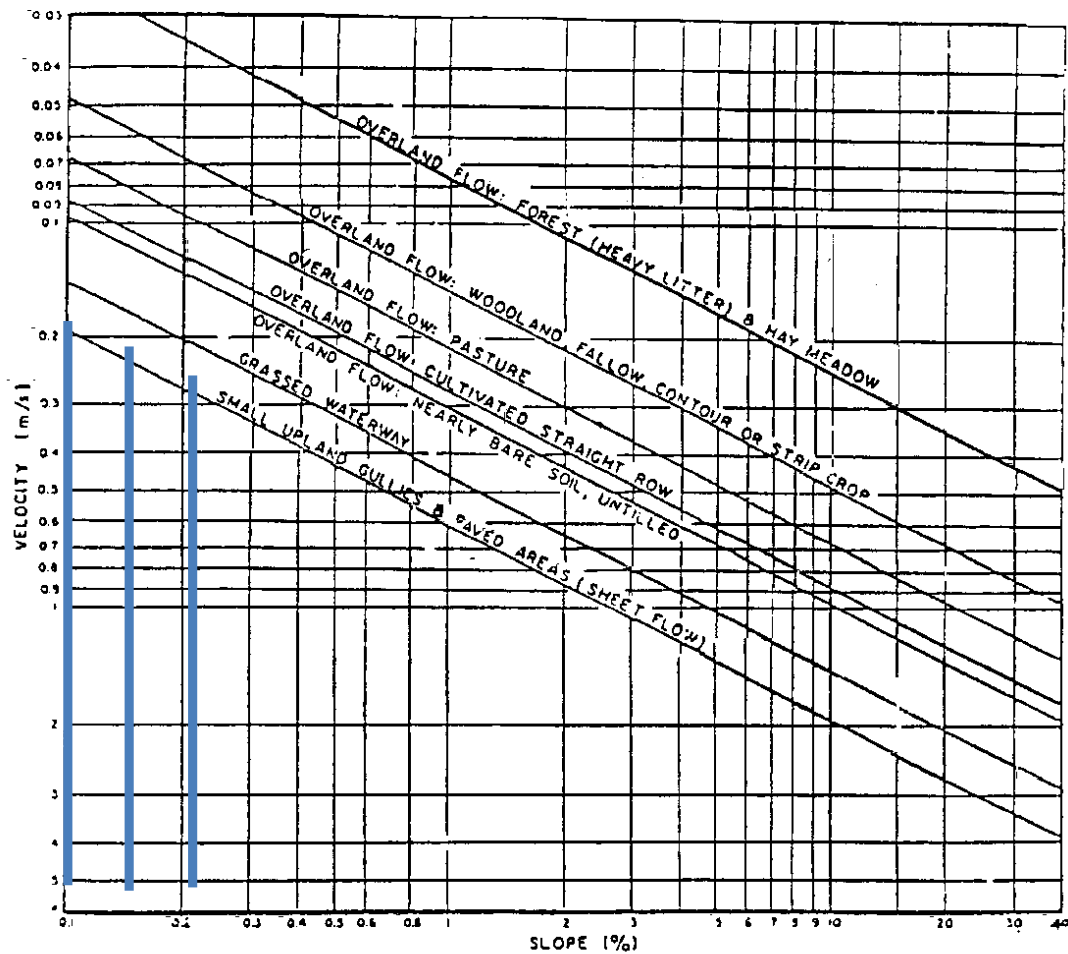


Figure A.5.2: Upland Method for Estimating Time of Concentration
 (SCS National Engineering Handbook, 1971)

TABLE 2A: Post-Development Runoff Coefficient "C" - A-1

Area	Surface	Ha	"C"	C _{avg}	*C ₁₀₀	Runoff Coefficient Equation
Total	Hard	0.190	0.90	0.59	0.67	C = (A _{hard} x 0.9 + A _{soft} x 0.2)/A _{Tot} * Runoff Coefficient increases by 25% up to a maximum value of 1.00 for the 100-Year event
0.342	Soft	0.152	0.20			

TABLE 2B: Post-Development A-1 Flows

Outlet Options	Area (ha)	C _{avg}	Tc (min)	Q _{2 Year} (L/s)	Q _{5 Year} (L/s)	Q _{100 Year} (L/s)
Boundary Road Ditch	0.342	0.59	15.5	33.9	45.8	88.7

Time of Concentration Tc= 15.5 min
 Intensity (2 Year Event) I₂= 60.67 mm/hr
 Intensity (5 Year Event) I₅= 82.05 mm/hr
 Intensity (100 Year Event) I₁₀₀= 140.29 mm/hr

Equations:
 Flow Equation
 $Q = 2.78 \times C \times I \times A$

Where:
 C is the runoff coefficient
 I is the rainfall intensity, City of Ottawa IDF
 A is the total drainage area

100 year Intensity = $1735.688 / (\text{Time in min} + 6.014)^{0.820}$
 5 year Intensity = $998.071 / (\text{Time in min} + 6.053)^{0.814}$
 2 year Intensity = $732.951 / (\text{Time in min} + 6.199)^{0.810}$

TABLE 3A: Post-Development Runoff Coefficient "C" - A-2

Area	Surface	Ha	"C"	C _{avg}	*C ₁₀₀	Runoff Coefficient Equation
Total	Hard	0.144	0.90	0.63	0.71	C = (A _{hard} x 0.9 + A _{soft} x 0.2)/A _{Tot} * Runoff Coefficient increases by 25% up to a maximum value of 1.00 for the 100-Year event
0.236	Soft	0.092	0.20			

TABLE 3B: Post-Development A-2 Flows

Outlet Options	Area (ha)	C _{avg}	Tc (min)	Q _{2 Year} (L/s)	Q _{5 Year} (L/s)	Q _{100 Year} (L/s)
Boundary Road Ditch	0.236	0.63	14.0	26.5	35.8	69.1

Time of Concentration Tc= 14.0 min
 Intensity (2 Year Event) I₂= 64.19 mm/hr
 Intensity (5 Year Event) I₅= 86.88 mm/hr
 Intensity (100 Year Event) I₁₀₀= 148.63 mm/hr

Equations:
 Flow Equation
 $Q = 2.78 \times C \times I \times A$

Where:
 C is the runoff coefficient
 I is the rainfall intensity, City of Ottawa IDF
 A is the total drainage area

100 year Intensity = $1735.688 / (\text{Time in min} + 6.014)^{0.820}$
 5 year Intensity = $998.071 / (\text{Time in min} + 6.053)^{0.814}$
 2 year Intensity = $732.951 / (\text{Time in min} + 6.199)^{0.810}$

TABLE 3A: Post-Development Runoff Coefficient "C" - HWD

Area	Surface	Ha	"C"	C _{avg}	*C ₁₀₀	Runoff Coefficient Equation
Total	Hard	0.427	0.90	0.42	0.49	C = (A _{hard} x 0.9 + A _{soft} x 0.2)/A _{Tot} * Runoff Coefficient increases by 25% up to a maximum value of 1.00 for the 100-Year event
1.346	Soft	0.919	0.20			

TABLE 3B: Post-Development HWD Flows

Outlet Options	Area (ha)	C _{avg}	Tc (min)	Q _{2 Year} (L/s)	Q _{5 Year} (L/s)	Q _{100 Year} (L/s)
Boundary Road Ditch	1.346	0.42	11.4	113.4	153.6	304.2

Time of Concentration Tc= 11.4 min
 Intensity (2 Year Event) I₂= 71.81 mm/hr
 Intensity (5 Year Event) I₅= 97.32 mm/hr
 Intensity (100 Year Event) I₁₀₀= 166.67 mm/hr

Equations:
 Flow Equation
 $Q = 2.78 \times C \times I \times A$

Where:
 C is the runoff coefficient
 I is the rainfall intensity, City of Ottawa IDF
 A is the total drainage area

100 year Intensity = $1735.688 / (\text{Time in min} + 6.014)^{0.820}$
 5 year Intensity = $998.071 / (\text{Time in min} + 6.053)^{0.814}$
 2 year Intensity = $732.951 / (\text{Time in min} + 6.199)^{0.810}$

North Pond Outlet Flow Summary

Storm Event	Flow (L/s)
2 Year Flow	70.8
5 Year Flow	80.2
100 Year Flow	340.5

South Pond Outlet Flow Summary

Storm Event	Flow (L/s)
2 Year Flow	40.9
5 Year Flow	44.4
100 Year Flow	57.7

Note: Flows taken from PCSWMM Hydraulic Model

Mannings Ditch Flow Capacity - V-bottom ditch

Ditch Criteria	Units	Value
Depth	m	1.15
Side slope (L)	1 to X	2.5
Side slope (R)	1 to X	3
Top Width (L)	m	2.9
Top Width (R)	m	3.5
Area	m ²	3.637
Perimeter	m	6.73
R=A/P	m	0.54
n		0.04
Slope	m/m	0.001
Q _{max}	m ³ /s	1.907
V _{max}	m/s	0.524

Boundary Road Ditch Flow Capacity = 1906.97 L/s
 Total Post-Development 100yr Flow= 860.20 L/s

Note: Therefore there is adequate capacity in the Boundary Road ditch for the proposed development flows.

APPENDIX E

Drawings

Notes and Details Plan (118168-ND,PND1,PND2)
Erosion and Sediment Control Plan (118168-ESC)
General Plan of Services (118168-GP)
Grading Plan (118168-GR1, GR2)