



## **Geotechnical Investigation**

Proposed Commercial Development  
6111 Hazeldean Road  
Ottawa, Ontario  
*Revision 2*

Prepared for:

MacEwen Petroleum Inc.  
18 Adelaide Street  
Maxville, Ontario  
K0C 1T0

Attention: Brad Moore

LRL File No.: 200100

September, 2020; *Revised: November, 2025*



## TABLE OF CONTENTS

<b>1</b>	<b>INTRODUCTION .....</b>	<b>1</b>
<b>2</b>	<b>SITE AND PROJECT DESCRIPTION .....</b>	<b>1</b>
<b>3</b>	<b>PROCEDURE .....</b>	<b>1</b>
<b>4</b>	<b>SUBSURFACE SOIL AND GROUNDWATER CONDITIONS .....</b>	<b>2</b>
4.1	General .....	2
4.2	Topsoil.....	2
4.3	Fill .....	3
4.4	Silty Sand Till .....	3
4.5	Bedrock .....	3
4.6	Groundwater Conditions .....	4
<b>5</b>	<b>GEOTECHNICAL CONSIDERATIONS .....</b>	<b>4</b>
5.1	Foundations .....	4
5.2	Shallow Foundation on Bedrock .....	4
5.2.1	Rock Anchors .....	4
5.3	Shallow Foundations on Structural Fill.....	5
5.4	Bedrock Excavation.....	6
5.5	Lateral Earth Pressure.....	6
5.6	Settlement .....	7
5.7	Liquefaction .....	7
5.8	Seismic .....	7
5.9	Frost Protection .....	7
5.10	Foundation Walls Backfill .....	8
5.11	Slab-on-grade Construction.....	8
5.12	Corrosion Potential and Cement Type .....	8
5.13	Infiltration Rates.....	9
<b>6</b>	<b>EXCAVATION AND BACKFILLING REQUIREMENTS .....</b>	<b>9</b>
6.1	Excavation.....	9
6.2	Groundwater Control.....	10
6.3	Pipe Bedding Requirements .....	10
6.4	Trench Backfill .....	10



<b>7</b>	<b>REUSE OF ON-SITE SOILS.....</b>	<b>11</b>
<b>8</b>	<b>RECOMMENDED PAVEMENT STRUCTURE.....</b>	<b>11</b>
<b>8.1</b>	<b>Paved Areas &amp; Subgrade Preparation.....</b>	<b>12</b>
<b>9</b>	<b>INSPECTION SERVICES.....</b>	<b>13</b>
<b>10</b>	<b>REPORT CONDITIONS AND LIMITATIONS.....</b>	<b>13</b>

## **LIST OF TABLES**

<b>Table 1 – Unconfined Compressive Strength of Select Rock Cores.....</b>	<b>3</b>
<b>Table 2 – Vibration Frequency and Limit.....</b>	<b>6</b>
<b>Table 3 – Material and Earth Pressure Properties.....</b>	<b>7</b>
<b>Table 4 – Results of Chemical Analysis.....</b>	<b>8</b>

## **APPENDICES**

<b>Appendix A</b>	<b>Site and Borehole Location Plans</b>
<b>Appendix B</b>	<b>Borehole Logs</b>
<b>Appendix C</b>	<b>Symbols and Terms Used in Borehole Logs</b>
<b>Appendix D</b>	<b>Laboratory Results</b>



## 1 INTRODUCTION

LRL Associates Ltd. (LRL) was retained by MacEwen Petroleum Inc. to perform a geotechnical investigation for the proposed commercial development to be located at 6111 Hazeldean Road, Ottawa, Ontario.

The purpose of the investigation was to identify the subsurface conditions across the site by the completion of a borehole drilling program. Based on the visual and factual information obtained, this report will provide guidelines on the geotechnical engineering aspects of the design of the project, including construction considerations.

**It should be noted, this report is applicable for all the proposed buildings intended to be constructed as part of this development for Phase 1.**

**A subsequent Geotechnical Memorandum pertaining to the proposed Phase 2 development has been generated by LRL, dated October 10, 2025.**

This report has been prepared in consideration of the terms and conditions noted above. Should there be any changes in the design features, which may relate to the geotechnical recommendations provided in the report, LRL should be advised in order to review the report recommendations.

## 2 SITE AND PROJECT DESCRIPTION

The site under investigation is currently vacant land, with no structures present. The site is covered with wild grasses and some mature trees in the middle of the site. The site can be considered to be relatively flat, with very minor grade changes across the site. Site access comes by way of Hazeldean Road, and is civically located at 6111 Hazeldean Road, Ottawa ON. The location is presented in Figure 1 included in **Appendix A**.

It is our understanding this site will be developed for commercial use. At the time of generating this report, the site buildings will consist of a Mr. Lube, a Starbucks, a Halo Car Wash, and two (2) other unnamed companies. Parking and access lanes will be also be constructed for the buildings as part of this development. All buildings will be serviced with municipal services.

## 3 PROCEDURE

The fieldwork for this investigation was carried out on September 16, 17 and 18, 2020. Prior to the fieldwork, the site was cleared for the presence of any underground services and utilities. A total of ten (10) boreholes were drilled onsite within the approximate locations of the proposed buildings and parking areas, and labelled BH1 through BH10. The approximate locations of the boreholes are shown in Figure 2 included in **Appendix A**.

The boreholes were advanced using a track mounted CME 850 drill rig equipped with 200 mm diameter continuous flight hollow stem auger supplied and operated by CCC Geotechnical and Environmental Drilling Ltd. A “two man” crew experienced with geotechnical drilling operated the drill rig and equipment.

Sampling of the overburden materials encountered in the boreholes was carried out at regular depth intervals using a 50.8 mm diameter drive open conventional spoon sampler in conjunction with standard penetration testing (SPT) “N” values. The SPT were



conducted following the method **ASTM D1586** and the results of SPT, in terms of the number of blows per 0.3 m of split-spoon sampler penetration after first 0.15 m designated as “N” value.

All boreholes were advanced until practical auger refusal over bedrock, four (4) of the boreholes consisted of NQ-size (Ø47.6mm) rock coring. The boreholes were terminated at depths ranging from 0.7 to 4.6 m below ground surface (bgs). Upon completion, the boreholes were backfilled and compacted using a combination of bentonite and overburden cuttings.

The fieldwork was supervised throughout by a member of our engineering staff who oversaw the drilling activities, cared for the samples obtained and logged the subsurface conditions encountered within each of the boreholes. All soil samples were transported back to our office for further evaluation. The recovered soil samples collected from the boreholes were classified based on visual examination of the materials recovered and the results of the in-situ testing.

Furthermore, all boreholes were located using a Garmin Etrex Legend GPS (Global Positioning System) receiver using NAD 83 datum (North American Datum). LRL’s field personnel determined the existing grade elevations at the borehole locations through a topographic survey carried out using a temporary site bench mark (top of circular traffic lid on sidewalk on NW corner of intersection at 6081 Hazeldean Road), given an elevation of 100.00 m. Ground surface elevations of the boring locations are shown on their respective borehole logs.

## **4 SUBSURFACE SOIL AND GROUNDWATER CONDITIONS**

### **4.1 General**

A review of local surficial geology maps provided by the Department of Energy, Mines and Resources Canada suggest that the surficial geology for this area is Ottawa Formation Bedrock, consisting of limestone with shaly partings.

The subsurface conditions encountered in the boreholes were classified based on visual and tactile examination of the materials recovered from the boreholes. The soil descriptions presented in this report are based on commonly accepted methods of classification and identification employed in geotechnical practice. Classification and identification of soil were conducted according to the procedure **ASTM D2487** and judgement, and LRL does not guarantee descriptions as exact, but infers accuracy to the extent that is common in current geotechnical practice.

The subsurface soil conditions encountered are given in their respective borehole logs presented in **Appendix B**. A greater explanation of the information presented in the borehole logs can be found in **Appendix C** of this report. These logs indicate the subsurface conditions encountered at a specific test location only. Boundaries between zones on the logs are often not distinct, but are rather transitional and have been interpreted as such.

### **4.2 Topsoil**

Topsoil of thickness ranging from 50 to 125 mm was found at all boring locations, with the exception of BH8.

This material was classified as topsoil based on colour and the presence of organic material and is intended as identification for geotechnical purposes only. It does not



constitute a statement as to the suitability of this layer for cultivation and sustaining plant growth.

#### 4.3 Fill

Underlying the topsoil in BH1 – BH7, BH9 and BH10 and at the surface of BH8 locations, a layer of fill material was encountered, and extended to depths ranging between 0.66 and 2.18 m bgs. This material can generally be described as a heterogenous soil matrix consisting of silt-sand-clay, mixed with some gravel sized stone, brown to dark brown, and moist. The natural moisture contents were found to range between 1 and 20%.

#### 4.4 Silty Sand Till

Underlying the fill in BH1, a deposit of till was encountered, and extended to a depth of 1.65 m bgs. This material can be described as a sandy silt till, some clay, some gravel sized stone, greyish brown, moist. The natural moisture content was found to be 11%.

#### 4.5 Bedrock

Underlying the fill material in BH1 – BH7, BH9, BH10, and the silty sand till in BH8, bedrock was encountered. The bedrock was encountered at depths ranging from 0.66 and 2.18 m bgs.

The bedrock formation in this area can be described as consisting of limestone, with shaly partings, and grey to dark grey in colour.

The Rock Quality Designation (RQD) was determined after the rock was cored, this is done by summing the lengths of the intact recovered cores which are greater than 100 mm in length, and dividing by the total length of the core run. The RQD values, expressed as a percent, ranged from 20 to 73%, indicating the rock was very poor to fair, with the majority of the values being in the fair range.

Four (4) rock core samples were selected to determine the unconfined compressive strengths at various depths. The results are summarized below in **Table 1**.

**Table 1: Unconfined Compressive Strength of Select Rock Cores**

Sample			Bedrock Type	Strength (MPa)
Borehole	Run #	Depth (m)		
BH1	Run 2	2.80 – 2.98	Limestone	101.7
BH4	Run 1	1.30 – 1.45	Limestone	92.4
BH5	Run 2	2.74 – 2.89	Limestone	39.7**
BH8	Run 2	1.40 – 1.52	Limestone	104.4

\*\*It should be noted; the rock core from BH5 was compromised during preparation for testing, and the strength value is considered to be an outlier and was omitted for design purposes.

The laboratory reports can be found in **Appendix D** of this report.



## 4.6 Groundwater Conditions

Groundwater conditions were carefully monitored during the field investigation. During drilling within the overburden material no water was encountered, and it is believed the groundwater table is found at deeper depths, within the bedrock.

It should be noted that groundwater levels could fluctuate with seasonal weather conditions, (i.e.: rainfall, droughts, spring thawing) and due to construction activities at or near the vicinity of the site.

## 5 GEOTECHNICAL CONSIDERATIONS

This section of the report provides general geotechnical recommendations for the design aspect of the proposed development based on our interpretation of the information gathered from the borehole data performed at this site and from the project requirements.

### 5.1 Foundations

Based on the subsurface soil conditions established at this site, it is recommended that the footings for the proposed buildings be founded over bedrock, or structural fill overlying the bedrock. To limit the potential of differential settlement, the footings shall be founded entirely on bedrock, or entirely on structural fill, and not a combination of the two. Therefore, all material, shall be removed from the proposed footprint down to the required founding depth.

### 5.2 Shallow Foundation on Bedrock

Conventional strip and column footings set over sound bedrock may be designed using a maximum allowable bearing pressure of **500 kPa** for Ultimate Limit State (**ULS**) factored bearing resistance. Serviceability Limit State (**SLS**) does not apply for footings founded on bedrock since failure of the concrete would occur before unacceptable settlement of the foundation. For footings founded on sound bedrock, there are no restrictions for maximum footing sizes and grade raise fill thickness. Prior to pouring the footing, the rock should be free of any soil, debris or deleterious substances and should be inspected by a geotechnical engineer.

The footings should be constructed on a relatively flat bedrock surface (10 degrees or less from the horizontal). If the footings will be founded on bedrock that is sloped greater than 10 degrees, and less than 30 degrees, rock anchors should be considered. For angles greater than 30 degrees, the bedrock must be levelled and step footings should be constructed.

Any excavations below the underside of footing for the proposed building to be founded on bedrock should be backfilled using lean concrete only, having a minimum compressive strength of 10 MPa at 28 days.

#### 5.2.1 Rock Anchors

If the need for rock anchors is required, they should be designed by a structural engineer. The engineer will design the rock anchors based on the type of bedrock and strength parameters.

Grouted rock anchor may fail in one or more of the following modes:

- Failure within the rock mass;
- Failure of the rock/grout bond;



- Failure of the grout/tendon bond; or
- Failure of the steel tendon, or top anchorage.

The capacity of rock anchors is dependent on the bond between the rock and grout. The method of installation will also affect the capacity of the bond between the rock and the grout. An invert cone angle of 90° may be used in the design of the anchors. Pull out testing should be carried out on the anchors to verify installations and to design load capacities. If bedrock is removed through mechanical hydraulic hammers (i.e. for levelling and installation of anchors), it is not expected to affect the contribution of the upper level of rock in the calculation of anchors capacity.

The bond length (grouted portion of the dowel) should be a minimum of 3.0 m. Generally, the bond between the grout and dowel are twice the bond developed between the grout and the bedrock. Therefore, the design should be based on failure between the grout and the bedrock.

Straight-shafted dowels anchor force is dependent on the ultimate bond stress of the bedrock or the grout. Typically, the ultimate bond force is taken as 10% of the average unconfined compressive strength of the bedrock, or the compressive strength of the grout, whichever is less (but not more than 3.1 MPa). The allowable bond stress is taken as 50% of the ultimate bond stress.

The required bond length can be determined using the following equation:

$$L(m) = P/(\pi \times d \times T_b)$$

Where;

P = Working Capacity of anchor (kg);

T<sub>b</sub> = working bond stress (kg/m<sup>2</sup>);

d = Core hole diameter (m).

### 5.3 Shallow Foundation on Structural Fill

Conventional strip and column footings set over properly compacted and approved structural fill (overlying bedrock) conforming to OPSS Granular B Type II or approved equivalent may be designed for a maximum allowable bearing pressure of **150 kPa** for Serviceability Limit State (SLS) and **225 kPa** for Ultimate Limit State (ULS) factored bearing resistance. The factored ULS value includes the geotechnical resistance factor of 0.5. For footings founded on properly compacted structural fill (having a minimum thickness 300 mm) overlying bedrock, there are no restrictions for maximum footing sizes and grade raise fill thickness.

Prior to placing the approved structural fill, the subgrade at bedrock level should be inspected and assessed by a geotechnical engineer, or a representative to identify any localised incompetent/unstable areas of the subgrade. Any incompetent subgrade areas as identified must be sub-excavated and backfilled with approved structural fill and compacted to 98% of its Standard Proctor Maximum Dry Density (SPMDD). In order to allow the spread of load beneath the footings and to prevent undermining during construction, the structural fill should extend minimum 1.0 m beyond the outside edges of the footings and then outward and downward at 1 horizontal to 1 vertical profile (or flatter) over a distance equal to the depth of the structural fill below the footing.



## 5.4 Bedrock Excavation

It is expected that some bedrock excavation will be required as part of this development. It is anticipated that bedrock removal will be possible with the use of heavy excavation equipment, but that removal of most of the bedrock could be facilitated by means of a hoe ramming operation. Both horizontal and vertical overbreak of the bedrock excavation face/bottom can be expected due to the hoe ramming operation. If control of potential bedrock overbreak is required, line drilling at the proposed excavation face is recommended. The smaller the distance between the drill holes, the fewer overbreaks is expected. It is generally considered that the drilling at 150 mm horizontal spacing to the full depth of the excavation should control overbreak to an acceptable level. Considering the proximity of the existing structures adjacent to the site and the potential for vibration during excavating and removal of the bedrock, monitoring of the hoe ramming shall be carried out throughout the operation on nearby buildings to ensure that the vibration limit is not exceeded. As outlined in **OPSS 120, Table 2** below summarizes the following vibration limits for the nearest existing structures.

In addition, a pre and post construction excavation condition survey of nearby structures is required to be carried out.

**Table 2: Vibration Frequency and Limit**

Frequency of Vibration (HZ)	Vibration Limit, PPV (Peak Particle Velocity) mm/sec
≤ 40	20
> 40	50

## 5.5 Lateral Earth Pressure

The following equation should be used to estimate the intensity of the lateral earth pressure against any earth retaining structure/foundation walls.

$$P = K (\gamma h + q)$$

Where;

P = Earth pressure at depth h;

K = Appropriate coefficient of earth pressure;

γ = Unit weight of compacted backfill, adjacent to the wall;

h = Depth (below adjacent to the highest grade) at which P is calculated;

q = Intensity of any surcharge distributed uniformly over the backfill surface (usually surcharge from traffic, equipment or soil stockpiled and typically considered 10 kPa).

The coefficient of earth pressure at rest ( $K_0$ ) should be used in the calculation of the earth pressure on the storm water manhole/basement walls, which are expected to be rather rigid and not to deflect.

The above expression assumes that perimeter drainage system prevents the build-up of any hydrostatic pressure behind the foundation wall.



**Table 3** below provides various material types and their respective earth pressure properties.

**Table 3: Material and Earth Pressure Properties**

Type of Material	Bulk Density (kN/m <sup>3</sup> )	Friction Angle (Φ)	Pressure Coefficient		
			At Rest (K <sub>0</sub> )	Active (K <sub>A</sub> )	Passive (K <sub>P</sub> )
Granular A	23.0	34	0.44	0.28	3.53
Granular B Type I	20.0	31	0.49	0.32	3.12
Granular B Type II	23.0	32	0.47	0.31	3.25

### 5.6 Settlement

The estimated total settlement of the shallow foundations, designed using the recommended serviceability limit state capacity value, as well as other recommendations given above, will be less than 25 mm. The differential settlement between adjacent column footings is anticipated to be 15 mm or less.

### 5.7 Liquefaction

For buildings founded over bedrock or structural fill, the potential of soil liquefaction is not considered to be a concern.

### 5.8 Seismic

Based on the results of this geotechnical investigation and in accordance with the Ontario Building Code 2012 (table 4.1.8.4.A.) and Canadian Foundation Engineering Manual (4<sup>th</sup> edition), the site can be classified as Class “C” as per the Site Classification for Seismic Site Response. It should be noted that a greater seismic site response class may be obtained by conducting seismic velocity testing using a multichannel analysis of surface waves (MASW).

The above classifications were recommended based on conventional method exercised for Site Classification for Seismic Site Response and in accordance with the generally accepted geotechnical engineering practice.

### 5.9 Frost Protection

All exterior footings located in any unheated portions of the proposed building should be protected against frost heaving by providing a minimum of 1.5 m of earth cover. Areas that are to be cleared of snow (i.e. sidewalks, paved areas, etc.) should be provided with at least 1.8 m of earth cover for frost protection purposes. Alternatively, the required frost protection could be provided using a combination of earth cover and extruded polystyrene insulation. Detailed guidelines for footing insulation frost protection can be provided upon request.

In the event that foundations are to be constructed during winter months, the foundation soils are required to be protected from freezing temperatures using suitable construction techniques. The base of all excavations should be insulated from freezing temperatures immediately upon exposure, until heat can be supplied to the building interior and the footings have sufficient soil cover to prevent freezing of the subgrade soils.



### 5.10 Foundation Walls Backfill

To prevent possible lateral loading, the backfill material against any foundation walls, grade beams, isolated walls, or piers should consist of free draining, non-frost susceptible material such as sand or sand and gravel meeting OPSS Granular B Type I, II or Select Subgrade Material (SSM).

The foundation wall backfill should be compacted to minimum 95% of its SPMDD using light compaction equipment, where no loads will be set over top. The compaction shall be increased to 98% of its SPMDD under walkways, slabs or paved areas close to the foundation or retaining walls. Backfilling against foundation walls should be carried out on both sides of the wall at the same time where applicable.

### 5.11 Slab-on-grade Construction

Concrete slab-on-grade should rest over compacted, free draining and well graded structural fill only. Therefore, all overburden soils should be removed from the proposed building's footprint down to the bedrock surface. The exposed undisturbed bedrock should then be inspected and approved by qualified geotechnical personnel.

Any underfloor fill needed to raise the general floor grade shall consist of OPSS Granular B Type I, II, or SSM, compacted to 95% of its SPMDD. The final lift shall Granular B Type II, and compacted to 98% of its SPMDD. A 200 mm Granular A meeting the **OPSS 1010** shall be placed underneath the slab and compacted to 100% of its SPMDD.

It is also recommended that the area of extensive exterior slab-on-grade (sidewalks, ramp etc.) shall be constructed using Granular A base of thickness 150 mm. The modulus of subgrade reaction (ks) for the design of the slabs set over structural fill is **18 MPa/m**.

In order to further minimize and control cracking, the floor slab shall be provided with wire or fibre mesh reinforcement and construction or control joints. The construction or control joints should be spaced equal distance in both directions and should not exceed 4.5 m. The wire or fibre mesh reinforcement shall be carried out through the joints.

If any areas of the proposed building area are to remain unheated during the winter period, thermal protection of the slab on grade may be required. The "Guide for Concrete Floor and Slab Construction", **ACI 302.1R-04** is recommended to follow for the design and construction of vapour retarders below the floor slab. Further details on the insulation requirements could be provided, if necessary.

### 5.12 Corrosion Potential and Cement Type

A soil sample was submitted to Paracel Laboratories Ltd. for chemical testing. The following **Table 4** below summarizes the results.

**Table 4: Results of Chemical Analysis**

Sample Location	Depth (m)	pH	Sulphate (µg/g)	Chloride (µg/g)	Resistivity (Ohm.cm)
BH1	0.8 – 1.4	7.2	35	24	5590
BH8	0.8 – 1.4	7.9	12	24	5100

The above results revealed a measured sulphate concentration of 35 and 12 µg/g in the sample. Based on the CAN/CSA-A23.1 standards (Concrete Materials and Methods of



Concrete Construction), a sulphate concentration of less than 1000 µg/g falls within the negligible category for sulphate attack on buried concrete. The test results from soil samples were below the noted threshold. As such, buried concrete for footings and foundations walls will not require any special additive to resist sulphate attack and the use of normal Portland cement is acceptable.

The pH, resistivity and chloride concentration provide an indication of the degree of corrosiveness of the sub-surface environment. The soil resistivity was measured to be 5590 and 5100 ohm.cm, which indicates a moderately corrosive environment.

### 5.13 Infiltration Rates

It is understood the site is located within the Carp River Sub Watershed Study; and infiltration rates of 104 mm/hr are targeted.

Bedrock was encountered between 0.25 and 1.20 m below existing grade for the Phase 2 development. This type of bedrock has a typical infiltration rate of about 0.01 – 1 mm/hr.

Based on the above information; it is not feasible to be able to achieve the infiltration targets.

## 6 EXCAVATION AND BACKFILLING REQUIREMENTS

### 6.1 Excavation

It is anticipated that the depth of excavation for any building or any proposed services will not extend below 2.4 m. Excavation must be carried-out in accordance with the Occupational Health and Safety Act and Regulations for Construction Projects.

According to the Ontario's Occupational Health and Safety Act (OHSA), O. Reg. 213/91 and its amendments, the surficial overburden expected to be excavated into at this site can be classified as Type 3 for fully drained excavations. Therefore, shallow temporary excavations in the overburden soil can be cut at 1 horizontal to 1 vertical, for a fully drained excavation starting from the base of the excavation and as per requirements of the OHSA regulations. When excavating into bedrock, the side of the excavation does not need to be sloped, and can be cut vertically from the base of excavation.

Any excavated material stockpiled near an excavation or trench should be stored at a distance equal to or greater than the depth of the excavation/trench and construction equipment traffic should be limited near open excavation.

Vibration impacts associated with the proposed excavation and foundation works have been reviewed with respect to the nearby 1050 mm diameter concrete sewer located northwest of the site and the existing residential dwellings to the north. Based on the findings of the geotechnical investigation, bedrock is present at shallow depths, and removal will likely be undertaken by hoe ramming.

Hoe ramming activities are expected to generate localized vibrations; however, given the anticipated separation distances between the excavation area, the municipal sewer, and nearby structures, vibration levels are expected to remain below thresholds that could result in structural or serviceability damage. **Consequently, a vibration monitoring program is not considered necessary for this project.**

Should construction methods change to include heavier mechanical breaking or blasting, a Vibration Monitoring Plan should be implemented at that time to document background and construction vibration levels near the sewer and adjacent dwellings.



## **6.2 Groundwater Control**

Based on the subsurface conditions encountered at this site, some minor groundwater seepage or infiltration from the native soils into the shallow temporary excavations during construction is expected, if any. However, it is anticipated that pumping from open sumps should be sufficient to control groundwater inflow. Any groundwater seepage or infiltration entering the excavation should be removed from the excavation by pumping from sumps within the excavations. Surface water runoff into the excavation should be minimized and diverted away from the excavation if possible.

A permit to take water (PTTW) is required from Ministry of Environment and Climate Change (MOECC), Ontario Reg. 387/04 and its latest amendments, if more than 379,000 litres per day of groundwater will be pumped during a construction period less than 30 days. Registration in the Environmental Activity and Sector Registry (EASR) is required when the takings of ground water and storm water for the purpose of dewatering construction projects range between 50,000 and 379,000 litres per day.

The actual amount of groundwater inflow into open excavations will depend on several factors such as the contractor's schedule, rate of excavation, the size of excavation, depth below the groundwater level, and at the time of year which the excavation is executed. It is expected that pumping rates will be less than 50,000 litres per day. As such, EASR registration is not required for the construction at this site.

## **6.3 Pipe Bedding Requirements**

It is anticipated that any underground services required as part of this project will be founded over properly prepared and approved structural fill. Consequently all organic material should be removed down to a suitable bearing layer. Any sub-excavation of disturbed soil should be removed and replaced with a Granular B Type II or I, or an approved equivalent, laid in loose lifts of thickness not exceeding 300 mm and compacted to 95% of its SPMDD. Bedding, thickness of cover material and compaction requirements for watermains and sewer pipes should conform to the manufacturer's design requirements and to the detailed installations outlined in the Ontario Provincial Standard Specifications (OPSS) or any other applicable standards.

## **6.4 Trench Backfill**

All service trenches should be backfilled using compactable material, free of organics, debris and large cobbles or boulders. Acceptable native materials (if encountered and where possible) should be used as backfill between the roadway subgrade level and the depth of seasonal frost penetrations (i.e. 1.8 m below finished grade) in order to reduce the potential for differential frost heaving between the new excavated trench and the adjacent section of roadway. Where native backfill is used, it should match the native materials exposed on the trench walls. Backfill below the zone of seasonal frost penetration could consist of either acceptable native material or imported granular material conforming to OPSS Granular B Type II. Any boulders larger than 150 mm in size should not be used as trench backfill.

To minimize future settlement of the backfill and achieve an acceptable subgrade for the roadway, the trench should be compacted in maximum 300 mm thick lifts to at least 95% of its SPMDD. The specified density may be reduced where the trench backfill is not located within or in close proximity to existing roadways or any other structures.



For trenches carried out in existing paved areas, transitions should be constructed to ensure that proper compaction is achieved between any new pavement structure and the existing pavement structure to minimize potential future differential settlement between the existing and new pavement structure. The transition should start at the subgrade level and extend to the underside of the asphaltic concrete level (if any) at a 1 horizontal to 1 vertical slope. This is especially important where trench boxes are used and where no side slopes is provided to the excavation. Where asphaltic concrete is present, it should be cut back to a minimum of 150 mm from the edge of the excavation to allow for proper compaction between the new and existing pavement structures.

## **7 REUSE OF ON-SITE SOILS**

The existing surficial overburden materials consists of fill material. This material is considered to be frost susceptible and should not be used as backfill material directly against foundation walls or underneath unheated concrete slabs. However, it could be reused as general backfill material (service trenches, general landscaping/backfilling) if it can be compacted according to the specifications outlined herein at the time of construction and found free from any waste, organics and debris.

It should be noted that the adequacy of any material for reuse as backfill will depend on its water content at the time of its use and on the weather conditions prevailing prior to and during that time. Therefore, all excavated materials to be reused shall be stockpiled in a manner that will prevent any significant changes in their moisture content, especially during wet conditions, and approved for reuse by a geotechnical engineer.

## **8 RECOMMENDED PAVEMENT STRUCTURE**

For predictable performance of the pavement areas, any organic, soft, and/or deleterious materials should be removed from the proposed pavement areas. The exposed subgrade should be inspected and approved by geotechnical personnel and any evidently loose and unstable areas should be sub-excavated and replaced with suitable earth borrow approved by the geotechnical engineer.

The subgrade material will consist of the existing fill material. This material may be an acceptable subgrade material provided it is properly compacted as outlined herein; and approved by the Geotechnical consultant. The subgrade should be shaped and crowned to promote drainage of the roadway.

The recommended pavement structures for the proposed light and heavy duty access roads and parking areas are provided below.

For light vehicle parking areas and access lanes, the pavement structure should consist of:

- 50 mm of hot mix asphaltic concrete (HL3/SP12.5) over;
- 150 mm of OPSS Granular A base over;
- 300 mm of OPSS Granular B Type II subbase.

For heavy duty access roads, the pavement should consist of:

- 40 mm of hot mix asphaltic concrete surface layer (HL3/SP12.5) over;
- 50 mm of hot mix asphaltic concrete binder layer (HL8/SP19.0) over;



- 150 mm of OPSS Granular A base over;
- 400 mm of OPSS Granular B, Type II subbase.

The base and subbase granular materials should conform to **OPSS 1010** material specifications. Prior to importing any granular material onto the site, it should be tested and approved by a geotechnical engineer prior to delivery to the site and should be compacted to 98% SPMDD. Compaction of the granular pavement materials should be carried out in maximum 300 mm thick loose lifts.

Asphaltic concrete should conform to **OPSS 1150** and be placed and compacted to at least 95% of the Marshall Density. The mix and its constituents should be reviewed, tested and approved by a geotechnical engineer prior to delivery to the site.

### **8.1 Paved Areas & Subgrade Preparation**

The proposed access lanes and parking areas should be stripped of, vegetation, topsoil, debris and other obvious objectionable material.

Following the backfilling and satisfactory compaction of any underground service trenches up to the subgrade level, the subgrade should be shaped, crowned and proof-rolled using heavy roller with any resulting soft areas sub-excavated down to an adequate bearing layer and replaced with approved backfill. Following approval of the preparation of the subgrade, the pavement structure may be placed.

If the roadway subgrade is disturbed or wetted due to construction operations or precipitation, the granular thicknesses given above may not be adequate and it may be necessary to increase the thickness of the Granular B Type II subbase and/or incorporate a non-woven geotextile separator between the roadway subgrade surface and the granular subbase material.

The performance of the pavement structure is highly dependent on the subsurface groundwater conditions and maintaining the subgrade and pavement structure in a dry condition. To intercept excess subsurface water within the pavement structure granular materials, sub-drains with suitable outlets should be installed below the pavement structure subgrade, if adequate overland flow drainage is not provided (i.e. ditches). The surface of the pavement should be properly graded to direct runoff water towards suitable drainage features. It is recommended that the lateral extent of the subbase and base layers not be terminated vertically immediately behind any proposed the curb/edge of pavement line but be extended beyond the curb.

For areas of the site that require the subgrade to be raised, the material should consist of OPSS Granular B Type I, II, or an approved equivalent. Any materials proposed for this use should be approved by the geotechnical engineer before placement. Materials used for raising the subgrade to the proposed roadway subgrade level should be placed in maximum 300 mm thick loose lifts and be compacted to at least 95% of the SPMDD using suitable compaction equipment.

The preparation of the subgrade should be scheduled and carried out in such a manner that a protective cover of overlying granular material is placed as quickly as possible in order to avoid unnecessary circulation by heavy equipment over the subgrade. Frost protection of the surface should be implemented (i.e. insulated tarps, etc.), if works are carried out during the winter months.

Transitions should be constructed between new and existing pavement structures where new access lanes will meet with existing road. In areas where the new pavement structure



will abut existing pavement structure, the depths of granular materials should be tapered up or down at 5 horizontal to 1 vertical, or flatter, to match the depths of the granular material(s) exposed in the existing pavement.

## **9 INSPECTION SERVICES**

The engagement of the services of the geotechnical consultant during construction is recommended to confirm that the subsurface conditions throughout the proposed site do not materially differ from those given in the report and that the construction activities do not adversely affect the intent of the design.

All footing areas and any structural fill areas for the proposed building should be inspected by LRL to ensure that a suitable subgrade has been reached and properly prepared. The placing and compaction of any granular materials beneath the foundations and slab-on-grade should be inspected to ensure that the materials used conform to the required gradation and compaction specifications.

If the footings are to be constructed during winter season, the footing subgrade should be protected from freezing temperatures using suitable construction techniques.

## **10 REPORT CONDITIONS AND LIMITATIONS**

It is stressed that the information presented in this report is provided for the guidance of the designers and is intended for this project only. The use of this report as a construction document or its use by a third party beyond the client specifically listed in the report is neither intended nor authorized by LRL Associates Ltd. Contractors bidding on or undertaking the works should examine the factual results of the investigation, satisfy themselves as to the adequacy of the information for construction, and make their own interpretation of the factual data as it affects their construction techniques, schedule, safety and equipment capabilities.

The professional services for this project include only the geotechnical aspects of the subsurface conditions at this site. The presence or implications of possible contamination resulting from previous uses or activities at this site or adjacent properties, and/or resulting from the introduction onto the site of materials from off-site sources are outside the terms of reference for this report.

The recommendations provided in this report are based on subsurface data obtained at the specific test pit locations only. Boundaries between zones presented on the test pit logs are often not distinct but transitional and were interpreted. Experience indicates that the subsurface soil and groundwater conditions can vary significantly between and beyond the test locations. For this reason, the recommendations given in this report are subject to a field verification of the subsurface soil conditions at the time of construction.

The recommendations are applicable only to the project described in this report. Any changes to the project will require a review by LRL Associates Ltd., to ensure compatibility with the recommendations contained in this project.


We trust this report provides sufficient information for your present purposes. If you have any questions concerning this report or if we may be of further services to you, please do not hesitate to contact the undersigned.

Yours truly,  
LRL Associates Ltd.



Geotechnical Investigation  
Proposed Commercial Development  
6111 Hazeldean Road, Ottawa ON.

LRL File: 200100  
September, 2020  
Page 14 of 14

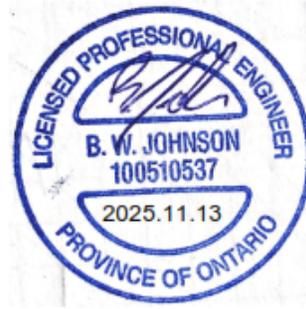

**Brad Johnson, P. Eng.**  
**Geotechnical Engineer**

W:\FILES 2020\200100\05 Geotechnical\01 Investigation\05 Reports\2021-01-28\_Geotechnical Investigation\_Proposed Commercial Development\_6111 Hazeldean\_Revision 2.docx



**APPENDIX A**  
**Site and Borehole Location Plan**



**LRJ**

ENGINEERING | INGÉNIÉRIE

5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lri.ca | (613) 842-3434

PROJECT

GEOTECHNICAL INVESTIGATION  
PROPOSED COMMERCIAL DEVELOPMENT  
6111 HAZELDEAN ROAD  
OTTAWA, ONTARIO

DRAWING TITLE

SITE LOCATION  
SOURCE: GEO-OTTAWA

CLIENT

MACEWEN PETROLEUM INC


DATE

SEPTEMBER 2020

PROJECT

200100

**FIGURE 1**

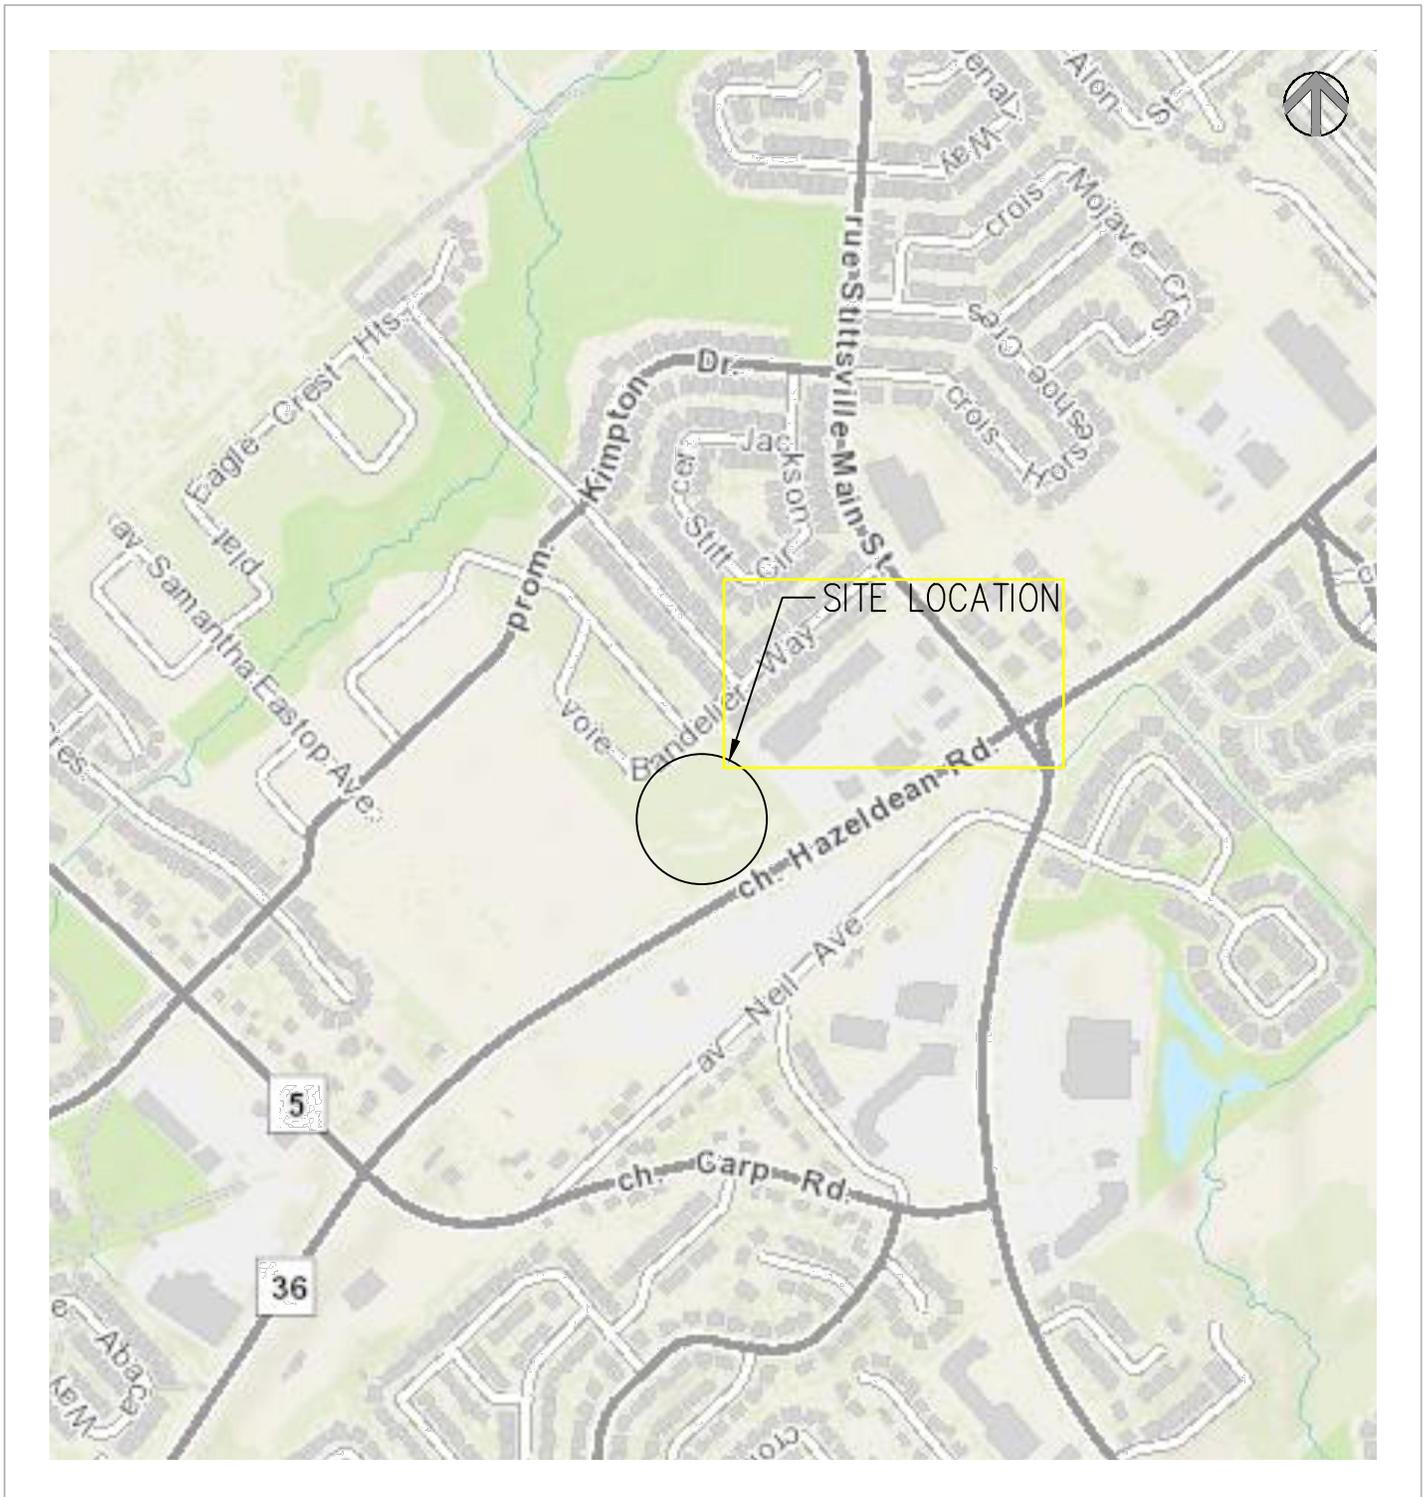



**LRJ**

ENGINEERING | INGÉNIÉRIE

5430 Canotek Road | Ottawa, ON, K1J 9G2  
www.lrj.ca | (613) 842-3434

PROJECT

GEOTECHNICAL INVESTIGATION  
PROPOSED COMMERCIAL DEVELOPMENT  
6111 HAZELDEAN ROAD  
OTTAWA, ONTARIO

DRAWING TITLE

BOREHOLE LOCATION  
SOURCE: Imagery 2020 Google, Digital Globe Map Data

CLIENT

MACEWEN PETROLEUM INC


DATE

SEPTEMBER 2020

PROJECT

200100

**FIGURE 2**

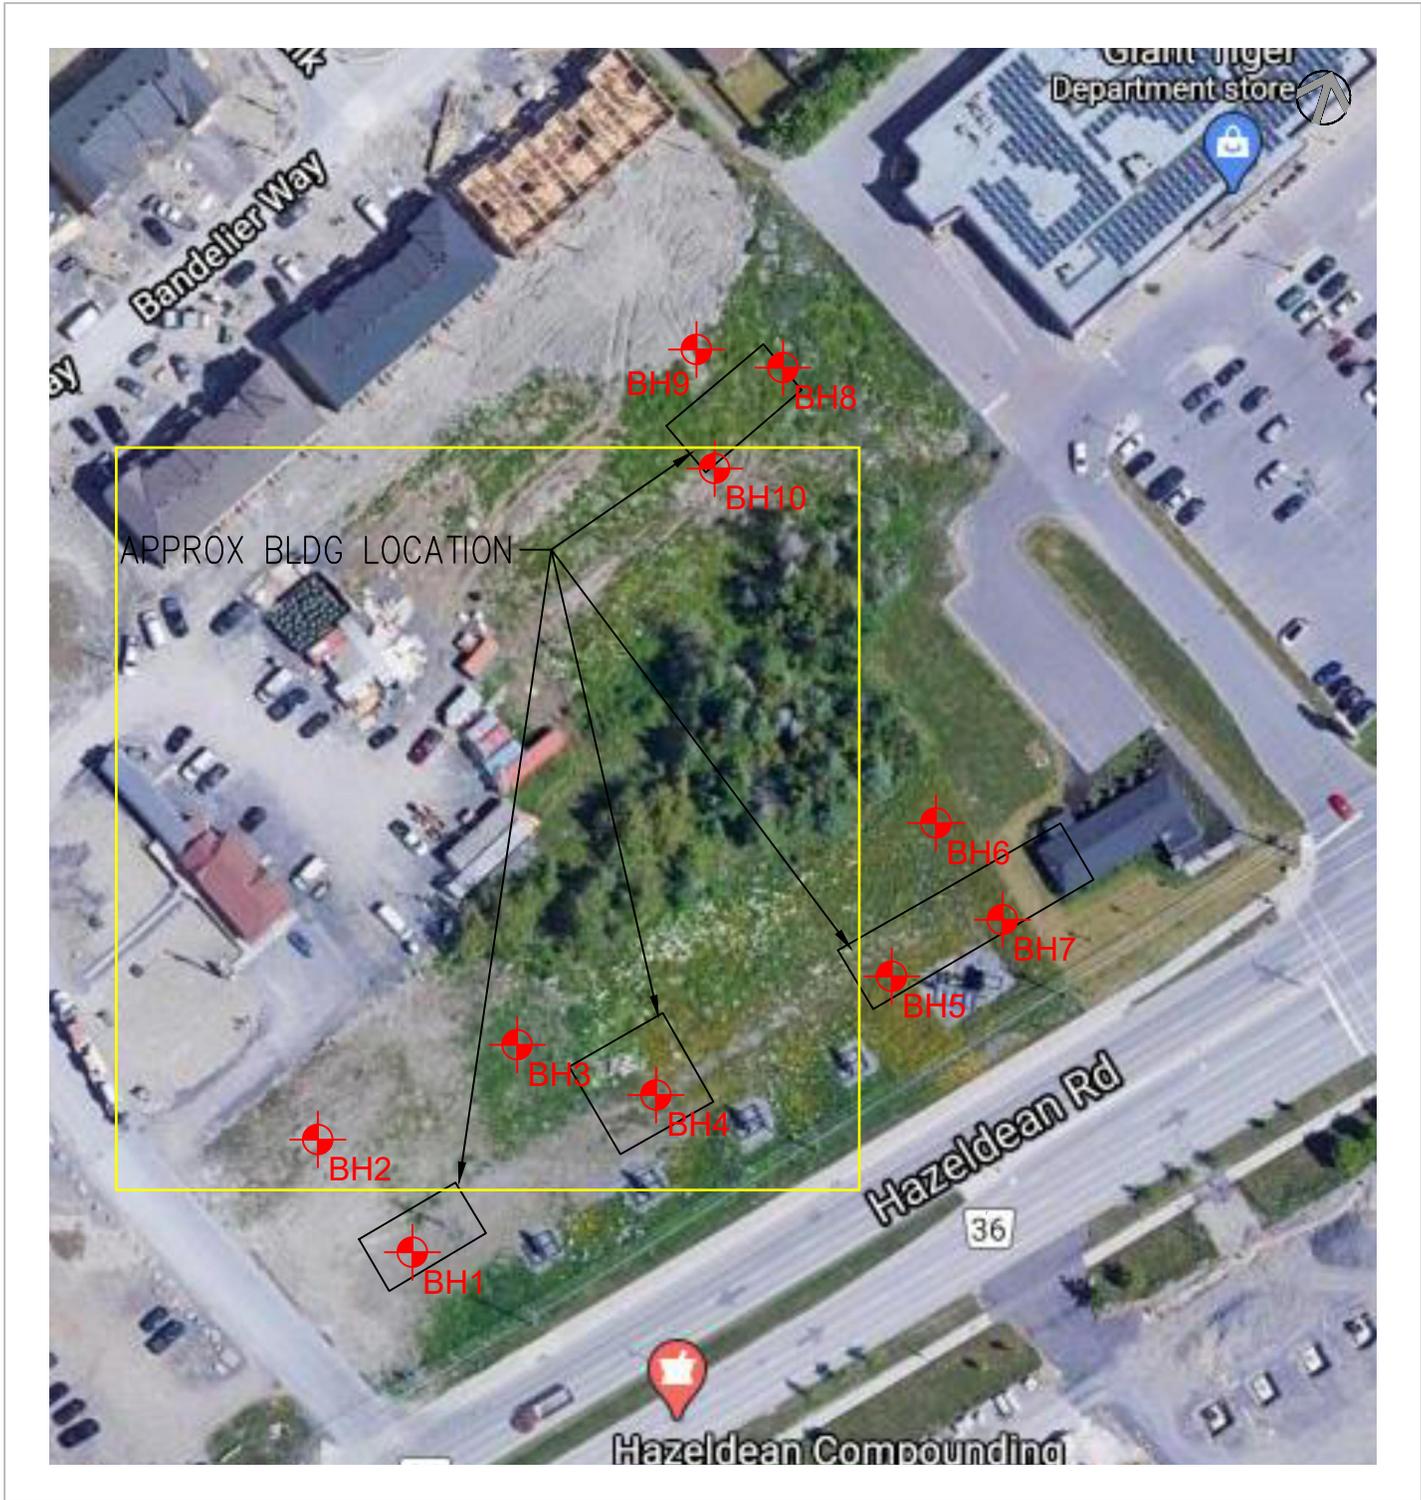

**APPENDIX B**  
**Borehole Logs**



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 16, 2020

**Borehole Log: BH1**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling      **Drilling Equipment:** Truck Mount CME 850      **Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50      150	25    50    75	
							SPT N Value (Blows/0.3 m)		
				20   40   60   80	25    50    75				
0	Ground Surface	101.03							
0	<b>TOPSOIL</b> About 100 mm thick	0.00							
1	<b>FILL</b> silt-sand-clay, some gravel sized stone, dark brown, compact, moist.	0.10		SS1	13	25	13	14	
2									
3	<b>TILL</b> silty sand till- some clay, some gravel sized stone, greyish brown, moist.	100.08		SS2	44	67	44	11	
4		0.95							
5									
6	<b>LIMESTONE</b> with shaly partings, grey.	99.38		SS3	50+	0	50+		
7		1.65							
8					Run 1	40	100		
9									
10					Run 2	72	100		
11									
12									
13									
14		96.69							
15	End of Borehole	4.34							
16									
17									
18									
19									

**Easting:** 426701 m      **Northing:** 5013453 m      **NOTES:**  
**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean  
**Groundsurface Elevation:** 101.035 m      **Top of Riser Elev.:** NA  
**Hole Diameter:** 200 mm      **Monitoring Well Diameter:** N/A



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 16, 2020

**Borehole Log: BH2**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details			
Depth ft m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50	150		25	50	75
							SPT N Value (Blows/0.3 m)			Liquid Limit (%)		
0	Ground Surface	100.74										
0	<b>TOPSOIL</b> About 75 mm thick	0.00										
0.08		0.08	SS1	54+	25		54+		10			
1	<b>FILL</b> silt-sand-clay, some gravel sized stone, brown, moist.											
2		99.95										
2.79		0.79	SS2	50+			50+					
3	End of Borehole Borehole terminated after practical auger refusal											

**Eastings:** 426687 m

**Northings:** 5013475 m

**NOTES:**

**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean

**Groundsurface Elevation:** 100.740 m

**Top of Riser Elev.:** NA

**Hole Diameter:** 200 mm

**Monitoring Well Diameter:** N/A



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 16, 2020

**Borehole Log: BH3**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
0	Ground Surface	100.53							
0	<b>TOPSOIL</b> About 125 mm thick	0.00	▲						
0.13		0.13	▲	SS1	53+	25	53+	17	
1	<b>FILL</b> silt-sand-clay, some gravel sized stone, brown, moist.		▲						
2									
3		99.59	▲	SS2	50+	0	50+		
3	End of Borehole	0.94							
4	Borehole terminated after practical auger refusal								
5									
6									
7									
8									
9									
10									
11									
12									
13									
14									
15									
16									
17									
18									
19									

**Easting:** 426721 m      **Northing:** 5013487 m      **NOTES:**  
**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean  
**Groundsurface Elevation:** 100.535 m      **Top of Riser Elev.:** NA  
**Hole Diameter:** 200 mm      **Monitoring Well Diameter:** N/A



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 16, 2020

**Borehole Log: BH4**

**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
0	Ground Surface	100.41							
0	<b>TOPSOIL</b> About 100 mm thick	0.00							
1	<b>FILL</b> silt-sand-clay, some gravel sized stone, dark brown, compact, moist.	0.10		SS1	18	42	18	16	
3		99.55		SS2	50+	33	50+	1	
1	<b>LIMESTONE</b> some shaly partings, grey.	0.86							
3				Run 1	73	100			
3				Run 2	67	100			
4	End of Borehole	96.37							
4		4.04							

**Easting:** 426716 m      **Northing:** 5013467 m  
**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean  
**Groundsurface Elevation:** 100.407 m      **Top of Riser Elev.:** NA  
**Hole Diameter:** 200 mm      **Monitoring Well Diameter:** N/A

**NOTES:**



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 16, 2020

**Borehole Log: BH5**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50      150	25   50   75	
							SPT N Value (Blows/0.3 m)		
0	Ground Surface	100.16							
0	<b>TOPSOIL</b> About 75 mm thick	0.00							
0.08		0.08	▲	SS1	10	29	10	20	
1	<b>FILL</b> silt-sand-clay mixed with black organics, some gravel sized stone, dark brown to black, loose, moist.		▲						
3			▲	SS2	52+	29	52+	20	
3.1		99.06	▲						
4	<b>LIMESTONE</b> some shaly partings, grey.	1.09	■						
6			■	Run 1	70	100			
9			■						
10			■	Run 2	57	100			
13			■						
13.4		95.95	■						
14	End of Borehole	4.20							

**Easting:** 426754 m      **Northing:** 5013491 m  
**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean  
**Groundsurface Elevation:** 100.155 m      **Top of Riser Elev.:** NA  
**Hole Diameter:** 200 mm      **Monitoring Well Diameter:** N/A

**NOTES:**



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 17, 2020

**Borehole Log: BH6**

**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50	25	
							150	50	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
							20	25	
0	Ground Surface	99.88							
	<b>TOPSOIL</b> About 100 mm thick	0.00							
1	<b>FILL</b> silt-sand-clay mixed with black organics, some gravel sized stone, dark brown, compact, moist.	0.08		SS1	14	50	14	11	
2		99.22							
		0.66							
3	End of Borehole Borehole terminated after practical auger refusal								
4									
5									
6									
7									
8									
9									
10									
11									
12									
13									
14									
15									
16									
17									
18									
19									

**Easting:** 426781 m

**Northing:** 5013517 m

**NOTES:**

**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean

**Groundsurface Elevation:** 99.878 m

**Top of Riser Elev.:** NA

**Hole Diameter:** 200 mm

**Monitoring Well Diameter:** N/A



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 17, 2020

**Borehole Log: BH7**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50      150	25   50   75	
							SPT N Value (Blows/0.3 m)		
0	Ground Surface	100.56							
0	<b>TOPSOIL</b> About 50 mm thick	0.00							
0.08		0.08							
1	<b>FILL</b> silty clay, some gravel sized stone, gryeish brown, moist stiff.			SS1	10	42	10	14	
2									
2		99.77							
3	<b>FILL</b> sandy, some gravel sized stone, brown, moist, loose to very dense	0.79		SS2	10	50	10	20	
4									
5									
6				SS3	60	75	60	10	
7		98.38							
7	End of Borehole Borehole terminated after practical auger refusal	2.18							
8									
9									
10									
11									
12									
13									
14									
15									
16									
17									
18									
19									

**Easting:** 426802 m      **Northing:** 5013514 m  
**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean  
**Groundsurface Elevation:** 100.565 m      **Top of Riser Elev.:** NA  
**Hole Diameter:** 200 mm      **Monitoring Well Diameter:** N/A

**NOTES:**



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 17, 2020

**Borehole Log: BH8**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50      150	25    50    75	
							SPT N Value (Blows/0.3 m)		
				20    40    60    80	25    50    75				
0	Ground Surface	98.41							
0	<b>FILL</b> silt-sand, some clay, some gravel sized stone, dark brown, compact, moist.	0.00		SS1	11	63	11	14	
2		97.72							
3	<b>FILL</b> sandy, some clay, some gravel sized stone, moist, brown, dense.	0.69		SS2	40	75	40	3	
4	<b>LIMESTONE</b> some shaly partings, grey.	97.29		Run 1	83	100			
5		1.12		Run 2	60	100			
6				Run 3	20	100			
7				Run 4	60	100			
8									
9									
10									
11									
12									
13									
14									
15	End of Borehole	93.86							
16		4.55							
17									
18									
19									

**Eastings:** 426767 m      **Northings:** 5013593 m  
**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean  
**Groundsurface Elevation:** 98.410 m      **Top of Riser Elev.:** NA  
**Hole Diameter:** 200 mm      **Monitoring Well Diameter:** N/A

**NOTES:**



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 17, 2020

**Borehole Log: BH9**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft / m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50      150	25   50   75	
							SPT N Value (Blows/0.3 m)		
						20   40   60   80	25   50   75		
0	Ground Surface	99.05							
	<b>TOPSOIL</b> About 50 mm thick	0.00							
1	<b>FILL</b> silt-sand-clay, some gravel sized stone, dark brown, loose to compact, moist.	0.13		SS1	10	8	10	8	
3				SS2	65+	50	65+	11	
4	End of Borehole	97.83							
5	Borehole terminated after practical auger refusal	1.22							
6									
7									
8									
9									
10									
11									
12									
13									
14									
15									
16									
17									
18									
19									

**Easting:** 426747 m

**Northing:** 5013601 m

**NOTES:**

**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean

**Groundsurface Elevation:** 99.05 m

**Top of Riser Elev.:** NA

**Hole Diameter:** 200 mm

**Monitoring Well Diameter:** N/A



**Project No.:** 200100  
**Client:** MacEwen Petroleum Inc.  
**Date:** September 17, 2020

**Borehole Log: BH10**  
**Project:** Proposed Commercial Development Stittsville  
**Location:** 6111 Hazeldean Road, Stittsville (Ottawa) ON  
**Field Personnel:** BJ

**Driller:** CCC Geotech and Enviro Drilling

**Drilling Equipment:** Truck Mount CME 850

**Drilling Method:** Hollow Stew Auger

SUBSURFACE PROFILE		SAMPLE DATA					Shear Strength (kPa)	Water Content (%)	Monitoring Well Details
Depth ft m	Soil Description	Elev./Depth (m)	Type	Sample Number	N or RQD	Recovery (%)	50 150	25 50 75	
							SPT N Value (Blows/0.3 m)	Liquid Limit (%)	
0	Ground Surface	97.80							
	<b>TOPSOIL</b> About 125 mm thick	0.00	▲						
1	<b>FILL</b> silt-sand-clay, some gravel sized stone, brown, loose, moist.	0.13	▲	SS1	50+	50	50+	12	
2		97.36							
		0.44							
3	End of Borehole Borehole terminated after practical auger refusal								
4									
5									
6									
7									
8									
9									
10									
11									
12									
13									
14									
15									
16									
17									
18									
19									

**Easting:** 426757 m

**Northing:** 5013586 m

**NOTES:**

**Site Datum:** Top of Traffic Lid on Sidewalk, NW corner of Intersection @ 6081 Hazeldean

**Groundsurface Elevation:** 97.800 m

**Top of Riser Elev.:** NA

**Hole Diameter:** 200 mm

**Monitoring Well Diameter:** N/A

**APPENDIX C**  
**Symbols and Terms used in Borehole Logs**

# Symbols and Terms Used on Borehole and Test Pit Logs

## 1. Soil Description

The soil descriptions presented in this report are based on commonly accepted methods of classification and identification employed in geotechnical practice. Classification and identification of soil involves some judgement and LRL Associates Ltd. does not guarantee descriptions as exact, but infers accuracy to the extent that is common in current geotechnical practice. Boundaries between zones on the logs are often not distinct but transitional and were interpreted.

### a. Proportion

The proportion of each constituent part, as defined by the grain size distribution, is denoted by the following terms:

Term	Proportions
“trace”	1% to 10%
“some”	10% to 20%
prefix (i.e. “sandy” silt)	20% to 35%
“and” (i.e. sand “and” gravel)	35% to 50%

### b. Compactness and Consistency

The state of compactness of granular soils is defined on the basis of the Standard Penetration Number (N) as per ASTM D-1586. It corresponds to the number of blows required to drive 300 mm of the split spoon sampler using a metal drop hammer that has a weight of 62.5 kg and free fall distance of 760 mm. For a 600 mm long split spoon, the blow counts are recorded for every 150 mm. The “N” value is obtained by adding the number of blows from the 2<sup>nd</sup> and 3<sup>rd</sup> count. Technical refusal indicates a number of blows greater than 50.

The consistency of clayey or cohesive soils is based on the shear strength of the soil, as determined by field vane tests and by a visual and tactile assessment of the soil strength.

The state of compactness of granular soils is defined by the following terms:

State of Compactness Granular Soils	Standard Penetration Number “N”	Relative Density (%)
Very loose	0 – 4	<15
Loose	4 – 10	15 – 35
Compact	10 - 30	35 – 65
Dense	30 - 50	65 - 85
Very dense	> 50	> 85

The consistency of cohesive soils is defined by the following terms:

Consistency Cohesive Soils	Undrained Shear Strength ( $C_u$ ) (kPa)	Standard Penetration Number “N”
Very soft	<12.5	<2
Soft	12.5 - 25	2 - 4
Firm	25 - 50	4 - 8
Stiff	50 - 100	8 - 15
Very stiff	100 - 200	15 - 30
Hard	>200	>30

### c. Field Moisture Condition

Description (ASTM D2488)	Criteria
Dry	Absence of moisture, dusty, dry to touch.
Moist	Damp, but not visible water.
Wet	Visible, free water, usually soil is below water table.

## 2. Sample Data

### a. Elevation depth

This is a reference to the geodesic elevation of the soil or to a benchmark of an arbitrary elevation at the location of the borehole or test pit. The depth of geological boundaries is measured from ground surface.

**b. Type**

Symbol	Type	Letter Code
	Auger	AU
▲	Split Spoon	SS
	Shelby Tube	ST
	Rock Core	RC

**c. Sample Number**

Each sample taken from the borehole is numbered in the field as shown in this column.

LETTER CODE (as above) – Sample Number.

**d. Recovery (%)**

For soil samples this is the percentage of the recovered sample obtained versus the length sampled. In the case of rock, the percentage is the length of rock core recovered compared to the length of the drill run.

**3. Rock Description**


Rock Quality Designation (RQD) is a rough measure of the degree of jointing or fracture in a rock mass. The RQD is calculated as the cumulative length of rock pieces recovered having lengths of 100 mm or more divided by the length of coring. The qualitative description of the bedrock based on RQD is given below.

Rock Quality Designation (RQD) (%)	Description of Rock Quality
0 – 25	Very poor
25 – 50	Poor
50 – 75	Fair
75 – 90	Good
90 – 100	Excellent

Strength classification of rock is presented below.


Strength Classification	Range of Unconfined Compressive Strength (MPa)
Extremely weak	< 1
Very weak	1 – 5
Weak	5 – 25
Medium strong	25 – 50
Strong	50 – 100
Very strong	100 – 250
Extremely strong	> 250

**4. General Monitoring Well Data**

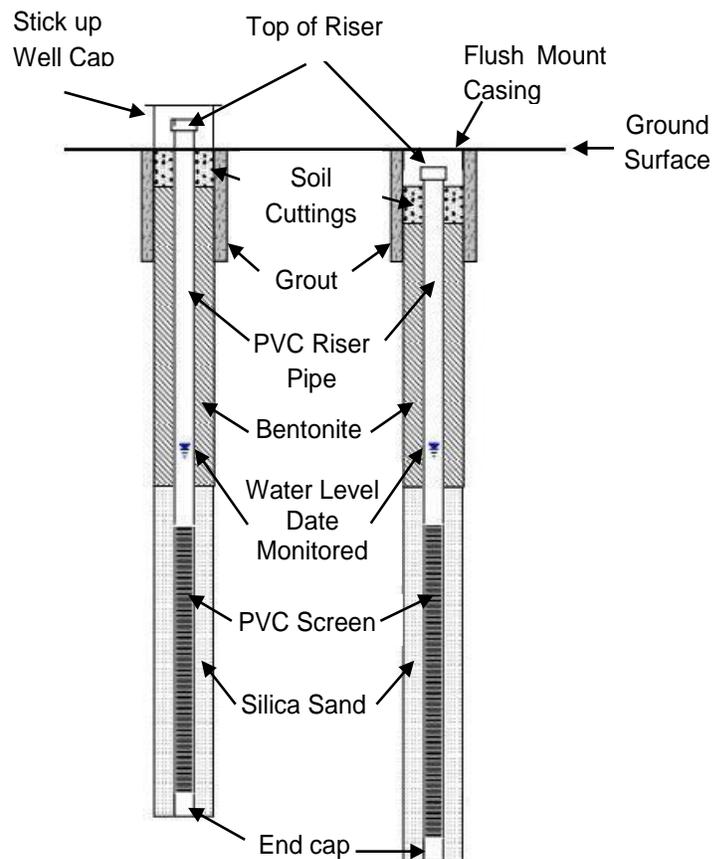

**5. Classification of Soils for Engineering Purposes (ASTM D2487)  
(United Soil Classification System)**

Major divisions		Group Symbol	Typical Names	Classification Criteria
Coarse-grained soils More than 50% retained on No. 200 sieve* (>0.075 mm)	Gravels More than 50% of coarse fraction retained on No. 4 sieve(4.75 mm)	Clean gravels <5% fines	GW Well-graded gravel	<p>Classification on basis of percentage of fines:                      Less than 5% pass No. 200 sieve - GW, GP, SW, SP                      More than 12% pass No. 200 sieve - GM, GC, SM, SC                      5 to 12% pass No. 200 sieve - Borderline classifications, use of dual symbols</p> <p><math>C_u = \frac{D_{60}}{D_{10}} \geq 4</math>; <math>C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}</math> between 1 and 3</p> <p>Not meeting either <math>C_u</math> or <math>C_c</math> criteria for GW</p> <p>Atterberg limits below "A" line or PI less than 4                      Atterberg limits on or above "A" line and PI &gt; 7                      Atterberg limits plotting in hatched area are borderline classifications requiring use of dual symbols                      If fines are organic add "with organic fines" to group name</p> <p><math>C_u = \frac{D_{60}}{D_{10}} \geq 6</math>; <math>C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}</math> between 1 and 3</p> <p>Not meeting either <math>C_u</math> or <math>C_c</math> criteria for SW</p> <p>Atterberg limits below "A" line or PI less than 4                      Atterberg limits on or above "A" line and PI &gt; 7                      Atterberg limits plotting in hatched area are borderline classifications requiring use of dual symbols                      If fines are organic add "with organic fines" to group name</p>
		GP Poorly graded gravel		
		Gravels with >12% fines	GM Silty gravel	
		GC Clayey gravel		
	Sands 50% or more of coarse fraction passes No. 4 sieve(<4.75 mm)	Clean sands <5% fines	SW Well-graded sand	
		SP Poorly graded sand		
		Sands with >12% fines	SM Silty sand	
		SC Clayey sand		
Fine-grained soils 50% or more passes No. 200 sieve* (<0.075 mm)	Silts and Clays Liquid Limit <50%	Inorganic	ML Silt	<p>If 15 to 29% coarse-grained, add "with sand" or "with gravel" as appropriate.                      If &gt; 30% coarse-grained, add "sandy" or "gravelly" as appropriate.                      Class as organic when oven dried liquid limit is &lt; 75% of undried liquid limit.</p>
		CL Lean Clay -low plasticity		
		Organic	OL Organic clay or silt (Clay plots above 'A' Line)	
	Silts and Clays Liquid Limit >50%	Inorganic	MH Elastic silt	
		CH Fat Clay -high plasticity		
		Organic	OH Organic clay or silt (Clay plots above 'A' Line)	
	Highly Organic Soils	PT	Peat, muck and other highly organic soils	

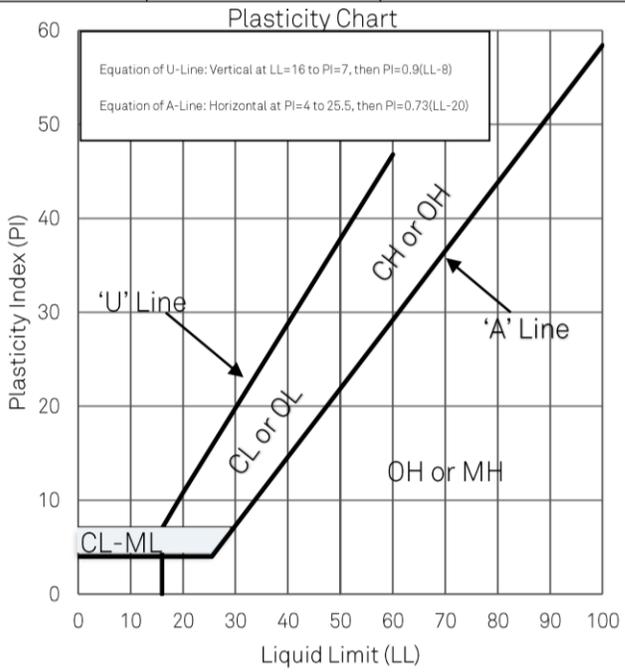

**APPENDIX D**  
**Laboratory Results**

**Unconfined Compressive Strength of Intact Rock Core**

ASTM D 7012: Method C



Client: Halo Car Wash Inc.  
 Project: Geotechnical Investigation  
 Location: 6111 Hazeldean Road, Ottawa, ON.

File No.: 200100  
 Report No.: 1  
 Date: September 17, 2020

**Drill Core Information**

Date(s) Sampled: September 17, 2020  
 Sampled By: LRL Associates Ltd.  
 Date Received: September 17, 2020

Laboratory Identification	Core No.	Field Identification	Borehole	Run	Depth, m	Location / Description
C01250	1		BH 1	2	2.80 - 2.98	6111 Hazeldean Road
C01251	2		BH 4	1	1.30 - 1.45	6111 Hazeldean Road
C01252	3		BH 5	2	2.74 - 2.89	6111 Hazeldean Road
C01253	4		BH 8	2	1.40 - 1.52	6111 Hazeldean Road

**Rock Core Unconfined Compressive Strength Test Data**

	Core No.	Conditioning	Length, mm	Diameter, mm	Density, kg/m <sup>3</sup>	MPa	Description of Failure
C01250	1	As received	92.0	45.0	2761	101.7	Columnar
C01251	2	As received	91.2	45.0	2718	92.4	Columnar, relatively well formed cone on each end
C01252	3	As received	92.2	45.0	2667	39.7	Columnar with horizontal break along shale seam, relatively well formed cone on one end
C01253	4	As received	89.5	45.0	2604	104.4	Columnar

Comments: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Date Issued: September 24, 2020Reviewed By: W.A.M. Laughlin

W.A.M. Laughlin, Geo.Tech., C.Tech.

## Certificate of Analysis

**LRL Associates Ltd.**

5430 Canotek Road  
Ottawa, ON K1J 9G2  
Attn: Brad Johnson

Client PO:  
Project: 200100  
Custody: 56634

Report Date: 25-Sep-2020  
Order Date: 22-Sep-2020

**Order #: 2039177**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Parcel ID	Client ID
2039177-01	BH1 SS2 2.5-4.5
2039177-02	BH8 SS2 2.5-4.5

Approved By:



Dale Robertson, BSc  
Laboratory Director

Certificate of Analysis

Report Date: 25-Sep-2020

Client: LRL Associates Ltd.

Order Date: 22-Sep-2020

Client PO:

Project Description: 200100

### Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Anions	EPA 300.1 - IC, water extraction	24-Sep-20	24-Sep-20
pH, soil	EPA 150.1 - pH probe @ 25 °C, CaCl buffered ext.	22-Sep-20	23-Sep-20
Resistivity	EPA 120.1 - probe, water extraction	24-Sep-20	24-Sep-20
Solids, %	Gravimetric, calculation	23-Sep-20	23-Sep-20

Certificate of Analysis

Report Date: 25-Sep-2020

Client: LRL Associates Ltd.

Order Date: 22-Sep-2020

Client PO:

Project Description: 200100

<b>Client ID:</b>	BH1 SS2 2.5-4.5	BH8 SS2 2.5-4.5	-	-
<b>Sample Date:</b>	17-Sep-20 09:00	17-Sep-20 12:00	-	-
<b>Sample ID:</b>	2039177-01	2039177-02	-	-
<b>MDL/Units</b>	Soil	Soil	-	-

**Physical Characteristics**

% Solids	0.1 % by Wt.	93.3	96.9	-	-
----------	--------------	------	------	---	---

**General Inorganics**

pH	0.05 pH Units	7.72	7.90	-	-
Resistivity	0.10 Ohm.m	55.9	51.0	-	-

**Anions**

Chloride	5 ug/g dry	24	24	-	-
Sulphate	5 ug/g dry	35	12	-	-

Certificate of Analysis

Report Date: 25-Sep-2020

Client: LRL Associates Ltd.

Order Date: 22-Sep-2020

Client PO:

Project Description: 200100

**Method Quality Control: Blank**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Anions</b>									
Chloride	ND	5	ug/g						
Sulphate	ND	5	ug/g						
<b>General Inorganics</b>									
Resistivity	ND	0.10	Ohm.m						

Certificate of Analysis  
 Client: LRL Associates Ltd.  
 Client PO:

Report Date: 25-Sep-2020  
 Order Date: 22-Sep-2020  
 Project Description: 200100

**Method Quality Control: Duplicate**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Anions</b>									
Chloride	31.5	5	ug/g dry	29.5			6.5	20	
Sulphate	7.38	5	ug/g dry	7.44			0.8	20	
<b>General Inorganics</b>									
pH	7.64	0.05	pH Units	7.67			0.4	2.3	
Resistivity	45.0	0.10	Ohm.m	46.0			2.3	20	
<b>Physical Characteristics</b>									
% Solids	95.4	0.1	% by Wt.	95.7			0.3	25	

Certificate of Analysis

Report Date: 25-Sep-2020

Client: LRL Associates Ltd.

Order Date: 22-Sep-2020

Client PO:

Project Description: 200100

**Method Quality Control: Spike**

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
<b>Anions</b>									
Chloride	124	5	ug/g	29.5	94.6	82-118			
Sulphate	103	5	ug/g	7.44	95.7	80-120			

Certificate of Analysis

Report Date: 25-Sep-2020

Client: LRL Associates Ltd.

Order Date: 22-Sep-2020

Client PO:

Project Description: 200100

**Qualifier Notes:**

None

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Soil results are reported on a dry weight basis when the units are denoted with 'dry'.

Where %Solids is reported, moisture loss includes the loss of volatile hydrocarbons.