



## Functional Servicing Report

*Chick-fil-A*

**Type of Document:**

Functional Servicing Report

**Project Name:**

Chick-fil-A College Square

**Project Number:**

BRM-23002042-W0

**Prepared and Reviewed By:**

Joo Ho Kim

**Approved By:**

Jordan Stern, P. Eng, Manager

**Date + Time Submitted:**

2026-05-14



Rev No.	Description	Originator	Checked	Approved	Date
B	Issued for SPA	JK	JS	JS	2026/05/15
A	Issued for SPA	JK	KL	SK	2025/11/14

# Table of Contents

<b>1</b>	<b>Legal Notification .....</b>	<b>1</b>
<b>2</b>	<b>Introduction .....</b>	<b>2</b>
2.1	Site Description .....	2
2.2	References .....	3
<b>3</b>	<b>Sanitary Sewer Servicing .....</b>	<b>3</b>
3.1	Sanitary Sewer System .....	3
3.2	Downstream Considerations.....	4
3.3	Proposed Sanitary Service.....	4
<b>4</b>	<b>Water Supply and Appurtenances .....</b>	<b>4</b>
4.1	Existing Water Supply .....	4
4.2	Proposed Water Demand .....	5
4.3	Proposed Connection.....	6
<b>5</b>	<b>Stormwater Management .....</b>	<b>7</b>
5.1	Pre-Development Hydrology.....	7
5.2	Stormwater Management Analysis.....	7
5.3	Allowable Release Rate .....	9
5.4	Stormwater Quantity Management.....	12
5.5	Stormwater Quality Management .....	12
5.6	Storm Conveyance .....	13
5.7	Water Balance.....	13
<b>6</b>	<b>Conclusion.....</b>	<b>15</b>

## List of Tables

Table 1: Proposed Sanitary Design Criteria (City of Ottawa Standards).....	3
Table 2: Dry Weather Sanitary Flow.....	4
Table 3: Wet Weather Sanitary Flow.....	4
Table 4: Maximum Flow to be considered from a given hydrant (City of Ottawa, Technical Bulletin ISTB-2018-02).....	5
Table 5: Proposed Water Distribution Design Criteria (City of Ottawa Water Design Guidelines).....	6
Table 6: Water Demand Calculations.....	6
Table 7: Rainfall IDF Parameters.....	8
Table 8: Predevelopment Catchment Parameter.....	9
Table 9: Predevelopment Release Rate.....	9
Table 10: Post Development Catchment Characteristic.....	10
Table 11: Pre & Post Development Peak Flow.....	11
Table 12: Storage Requirement Summary – Sewer and Surface.....	12
Table 13: Water Balance Volume.....	14

## List of Figures

Figure 1: Existing Site.....	2
------------------------------	---

## List of Appendices

Appendix A Site Plan
Appendix B Engineering Drawings
Appendix C Fire Flow Calculations
Appendix D Visual Otthymo Model
Appendix E Storm Water Management Calculation
Appendix F OGS Report
Appendix G Boundary Condition

## 1 Legal Notification

This Report was prepared by EXP Services Inc. for the account of Chick-fil-A.

Any use which a third party makes of the Report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. EXP Services Inc. accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this project.

## 2 Introduction

EXP Inc. has been retained by Chick-fil-A to prepare a Functional Servicing Report (FSR) to assess the servicing requirements relating to the proposed development located at 1984 Baseline Road which is located in Ottawa, Ontario. For additional background information, please refer to **Appendix A, EXP Drawing A100**.

This Functional Servicing Report (FSR) identifies and presents the servicing requirements for the proposed project. This FSR includes municipal water, sanitary drainage, and stormwater management (SWM) services, prior to the detailed design being undertaken. The Report will outline the requirements for site servicing for the proposed development and determine the available existing and proposed municipal servicing for discharge of storm and sanitary flows and water servicing.

### 2.1 Site Description

#### 2.1.1 Existing Site

The property under study is a 0.250 ha site located on the northwest corner of Baseline Road and Woodroffe Avenue in Ottawa, Ontario. The subject site is currently occupied by Beer Store and parking spaces and bounded by BMO Bank of Montreal and parking spaces to the south and an existing parking lot to the east.

The current site is an existing commercial development with parking spaces. See **Figure 1** for an aerial view of the existing site.



Figure 1: Existing Site

#### 2.1.2 Proposed Site

The project entails the construction of a proposed Chick-fil-A accompanied by the necessary sidewalks, landscape areas, parking lot and drive aisles.

The proposed development involves the construction of a proposed Chick-fil-A at the center of the site and will consist of a 464 m<sup>2</sup> building, parking spaces, sidewalk, landscape areas, and drive thru. The existing infrastructure on the subject site will be demolished and modified to meet the requirements of the proposed development. The proposed building for the subject site will be serviced from the existing systems within the existing plaza which will consider demonstrating the use of services and capacity.

For more detailed information regarding the building and site location, please refer to the **EXP Drawing A100 - Site Plan** provided in **Appendix A**.

## 2.2 References

The following documents were referred to in the preparation of this report:

- City of Ottawa Sewer Design Guidelines, Fourth Edition, December 2025
- Stormwater Management Design Criteria for the Pinecrest Creek/Westboro Area, May 2020
- Technical Bulletin PIEDTB-2018-01
- City of Ottawa Water Distribution Design Guidelines, May 2026
- Ontario Building Code or Fire Underwriter Surveys
- Technical Bulletin ISTB-2021-03
- Technical Bulletin ISTB-2018-02, Appendix I Table 1

## 3 Sanitary Sewer Servicing

### 3.1 Sanitary Sewer System

The proposed Chick-fil-A site at 1984 Baseline Road, Ottawa, Ontario will connect to the existing sanitary infrastructure within the existing commercial development. The sanitary sewage flow from the site will be directed to the existing sanitary MH situated south of the subject site and then to the internal system. The inverts, size and slope of the existing sanitary service is to be confirmed on field by the contractor. The existing sanitary sewers, maintenance holes, as well as the proposed sanitary sewer arrangement for the Chick-fil-A Development are shown on **EXP Drawing PS100 – Site Servicing** in **Appendix B**.

Sanitary sewage outflow from the site is calculated using the current City of Ottawa Sewer Design Guidelines and Technical Bulletin PIEDTB-2018-01 as depicted in **Table 1** below. Sewage flows will be calculated based on use as a commercial site with an average design flow of **0.324 L/sec/ha** (28,000 L/gross ha/day) plus allowances for infiltration. Based on the site area of **0.250 hectares**, the sanitary flow equates to **0.20 L/s**.

**Table 1: Proposed Sanitary Design Criteria (City of Ottawa Standards)**

<b>Avg. Flow Rate</b>	0.324	L/sec/ha
<b>Peak Hourly Factor</b>	1.0	(Building Less than 20% subject site)
<b>Total Area</b>	0.250	ha
<b>Infiltration</b>	0.33	L/s/ha

The Dry Weather proposed sanitary flow is depicted in **Table 2** below.

**Table 2: Dry Weather Sanitary Flow**

Type of Flow	Proposed Flow (L/s)
Average Domestic Flow (L/s)	0.324 L/sec/ha * 0.250 ha = <b>0.081 L/s</b>
Peak Domestic Flow (L/s)	0.081 L/s * 1.0 = <b>0.081 L/s</b>

The Wet Weather proposed sanitary flow is depicted in **Table 3** below.

**Table 3: Wet Weather Sanitary Flow**

Type of Flow	Proposed Flow (L/s)
Peak Domestic Flow (L/s)	0.081 L/s
Infiltration Flow (L/s)	0.33 L/sec/ha * 0.250 ha = <b>0.083 L/s</b>
<b>TOTAL FLOW (L/s)</b>	<b>0.164 L/s</b>

The sanitary sewage flow from the proposed Chick-fil-A site will discharge to the existing sanitary manhole located south of the proposed Chick-fil-A.

### 3.2 Downstream Considerations

The Asset Management team at the City of Ottawa analyzed that the system to ensure there is adequate residual capacity in the receiving and downstream wastewater system to support the proposed flow for the development. In the existing condition, the site is occupied with a similar size commercial building and has a similar total area. Hence, the proposed flow will have an insignificant difference from the existing flow. It is expected that the **0.164 L/s** is acceptable. Refer to **Appendix C** for calculations.

### 3.3 Proposed Sanitary Service

EXP proposes to service the proposed development with a proposed 150mm connection at 2.0% with a grease interceptor to the existing sanitary MH located south of the site. The setup will include venting. The proposed connection to the building will be 150mm at 2.0% slope. The sanitary service connection to the proposed building, will be designed to the Ottawa Standards, as shown on **EXP Drawing PS100 – Site Servicing Plan in Appendix B**.

## 4 Water Supply and Appurtenances

### 4.1 Existing Water Supply

According to the survey conducted by JD BARNES on July 7, 2025, there is an existing 150mm watermain and an existing 50mm water service located south and east of the proposed restaurant respectively. The existing watermain are shown on **EXP Drawing PS101 – Site Servicing and Novatech Drawing 101075 – GP – General Plan of Services in Appendix B**.

## 4.2 Proposed Water Demand

The unit rate and peaking factors of water consumption, minimum pipe size and allowable pressure in line were established from the City of Ottawa Water Design Guidelines.

The pressures and volumes must be sufficient for peak hour conditions and under fire conditions as established by the City of Ottawa Standards. New water supply and distribution systems should maintain normal operating pressures between 345 kPa (50 psi) and 552 kPa (80 psi) during maximum daily flow. The maximum sustained operating pressure shall not exceed 552 kPa (81 psi). Minimum residual pressure at any hydrant shall not be less than 140 KPa (20 PSI).

### 4.2.1.1 Fire Flow

A detailed Fire Flow calculation has been prepared using the recommendation for the Fire Underwriters Survey as per City of Ottawa Technical Bulletin ISTB-2021-03. The fire flow calculation indicates that the recommended fire flow for this proposed development will be **6,000 l/min (100 litres/sec)**.

Calculations for the required domestic and fire flow demand are provided in **Appendix C**.

Currently, there is an existing class AA fire hydrant south of the proposed building for fire fighting purposes. The proposed building is 30 m unobstructed distance to the proposed fire department connection. Fire protection of the proposed building will be via the existing fire hydrant since the building is located within the 45 m range permitted by the Ontario Building Code; therefore, a private fire hydrant is not required. Refer to the **EXP Drawing PS100 – Site Servicing** within **Appendix B** showing the extent of proposed water servicing to be installed. Under proposed conditions, the existing fire hydrant is utilized.

As per City of Ottawa Technical Bulletin ISTB-2018-02, the combined flow of all contributing fire hydrants within 150 meters of the building must meet or exceed the required fire flow. Appendix I of the same bulletin is summarized in **Table 4**.

**Table 4: Maximum Flow to be considered from a given hydrant (City of Ottawa, Technical Bulletin ISTB-2018-02)**

Class	Distance (m)	Contribution (L/min)
AA	≤ 75	5,700
	> 75 and ≤ 150	3,800

The nearest existing Class AA fire hydrant is within 75 meters of the proposed building. There are two additional municipal Class AA fire hydrant within 75 meters and 150 meters of the proposed building each. The existing development was serviced with the existing hydrants. With the similar building size, the proposed building that will have similar required fire flow will be serviced with the existing hydrants as the existing condition.

### 4.2.2 Demand Requirements

It is proposed that the site will be serviced via a new 50mm diameter water service for domestic flow, connected into the existing 50mm water service as continuation located to the east of the existing store. The proposed water service contains a water valve located at the connection to the existing watermain.

Water demands for the proposed development were determined from the City of Ottawa Water Design Guidelines; the design criteria is summarized in **Table 6**.

**Table 5: Proposed Water Distribution Design Criteria (City of Ottawa Water Design Guidelines)**

<b>Total Area</b>	0.250	ha
<b>Commercial Average Daily Demand</b>	28,000	L/ha/day
<b>Commercial Maximum Daily Demand</b>	1.5 * Average Day	L/gross ha/day
<b>Commercial Maximum Hour Demand</b>	1.8 * Average Day	L/gross ha/day
<b>Chick-fil-A Hours Open Hours</b>	11	Hours

The total water demand for the site is estimated as the maximum daily water demand plus fire, resulting in a total demand of approximately  $(0.27 \text{ l/s} + 100 \text{ l/s}) = 100.27 \text{ L/s}$ . The total water demand was calculated in **Table 6**.

**Table 6: Water Demand Calculations**

Demand Type	Total Demand (L/s)
<b>Commercial Average Daily Demand</b>	$((28,000 \text{ L/ha/day} * 0.250 \text{ ha}) / 11 \text{ Hours}) = 0.177 \text{ L/s}$
<b>Commercial Maximum Daily Demand</b>	<b>0.27 L/s</b>
<b>Commercial Maximum Hourly Demand</b>	0.32 L/s
<b>Fire Flow (FUS method)</b>	<b>100 L/s</b>
<b>Maximum Daily Demand + Fire Flow</b>	<b>100.27 L/s</b>

Fire protection of the proposed building will be via the existing fire hydrant at the south of the site since the building is located within the 90 m range of the existing fire hydrant.

Refer to the **EXP Drawing PS100 – Site Servicing Plan** within **Appendix B**, showing the extent of proposed water servicing, to be installed.

### 4.3 Proposed Connection

As part of the proposed project, we plan to connect the new Chick-fil-A building to the existing water infrastructure. This connection will ensure that the building has access to the necessary water supply for its operations and can utilize the existing infrastructure efficiently.

The City of Ottawa's asset management team has supplied the boundary conditions for the downstream municipal watermain at the subject property based on the following information: the type of development is a commercial development, with an average daily demand of 0.117 L/s, a maximum daily demand of 0.27 L/s, and a maximum hourly daily demand of 0.32 L/s. The required fire flow, according to the FUS Method, is 100 L/s, and according to the OBC Method, it is 30 L/s. For detailed correspondence with the City regarding these boundary conditions, please refer to Appendix D. The boundary conditions in the 406 mm, Woodroffe Avenue municipal watermain provided by the City of Ottawa at the subject property indicate a minimum HGL of 126.6 m and a maximum HGL of 132.6 m. Refer to Boundary Conditions for 1984 Baseline Road within Appendix G.

Based on these boundary conditions and the calculated headloss off the private watermain, the headloss calculation indicates a peak hour pressure of 58.73 psi at the building and a max day + Fire Flow #1 of 58.30 psi. The minimum requirement for maximum hourly demand is 40 psi, and the maximum requirement for maximum hourly demand is 80 psi. Therefore, there is sufficient pressure to service the proposed development. The calculated head loss calculations for the private watermain can be found in Appendix G.

Currently, the subject site is occupied with the existing building that is similar in size and use, commercial. Given that the proposed building is similar to the existing building, it is anticipated that the required flows will be similar. The water system will have adequate supply and pressure.

## 5 Stormwater Management

### 5.1 Pre-Development Hydrology

#### 5.1.1 Existing Drainage

The subject site is currently occupied by an existing commercial building with parking spaces. The subject site has on-site catch basins on the south side and on the east side of the existing building, which capture drainage from the parking spaces, concrete areas, and landscape areas around the building. In the predevelopment conditions, the catchment areas are divided into three as shown in **EXP Drawing SWM100 - Pre-Development Drainage Plan within Appendix B**. Area 101 is captured within the site. However, Area 102 and 103 are flowing towards the streets, Baseline Road and Woodroffe Avenue respectively. Refer to **Novatech Drawing 101075 – GR – Grading & Drainage Plan** for more information.

The existing storm sewer that drains this site is a private on site 200mm diameter STM, located south of the proposed site within the existing commercial development. According to **Novatech Drawing 101075 – GP – General Plan of Services**, the site drains to the existing 2100mm diameter storm sewer running along the east boundary. This existing servicing plan shows that the existing storm system does not have any Inlet Control Device and any treatment unit for the existing development.

The subject site falls within the **Ottawa River Watershed**.

#### 5.1.2 External Drainage

Based on the existing topography, there are no external drainage areas draining to the subject property. Refer to **EXP Drawing SWM100 - Pre-Development Drainage Plan within Appendix B**.

### 5.2 Stormwater Management Analysis

The storm drainage system for the Chick-fil-A site collects water through a series of catch basins, roof drains, and a catch basin manhole. According to the City of Ottawa requirements, the site must have an accessible storm sewer with a private storm main network internal to the site. As per these requirements, we are utilizing the existing storm infrastructure, and the storm flows from our site are then conveyed via the existing private on-site storm sewer system.

The proposed Chick-fil-A development is situated on what is currently an existing commercial building. Although the area is mostly hard surface in its current state, the proposed development will have more hard surface areas than the existing. An 80mm diameter orifice plate will be placed to control the flow to have less flow than the allowable release rate. However, the existing site does not have any inlet control device. Having the orifice tube will enhance the stormwater management of the subject site.

Although the proposed restaurant development will have a slight increase in the total amount of stormwater runoff generated due to the increase in hard surface and additional controlled area, proposed upgrade on the stormwater system will provide better management. Please refer to the Post-Development Drainage plan, **EXP Drawing SWM200**, available in **Appendix B**.

The City of Ottawa rainfall IDF Parameters have been used for the storm analysis. These parameters were taken from City of Ottawa Sewer Design Guidelines Second Edition dated October 2012. The rainfall intensity for the site was calculated using the following equation:

$$i = A \times (B + T_c) C$$

Where:

- i = Rainfall intensity (mm/hr)
- T<sub>c</sub> = Time of Concentration (minutes)
- A, B and C are IDF parameters

**Table 7: Rainfall IDF Parameters**

Storm Return Interval (yr)	A	B	C
1: 2	732.951	6.20	0.81
1: 5	998.071	6.05	0.814
1: 10	1174.184	6.01	0.816
1: 25	1402.884	6.02	0.819
1: 50	1569.58	6.01	0.82
1: 100	1735.688	6.01	0.82

For 25mm 4-hour Chicago design storm, 24 rainfall increments with 10 minutes storm time step that are provided from Visual OTTHYMO were used. The increment input are provided in **Appendix D**.

### 5.2.1 Analysis Methodology

Visual OTTHYMO v6 (VO) was used to calculate the predevelopment storm flow calculations and to determine the post development required storm detention volumes based on the required release rate. Visual OTTHYMO is a successful hydrologic management model that has been used for projects including Watershed Studies, Sub-watershed Studies, Master Drainage Plans, Functional Stormwater Management Plans, Site Plans, and Stormwater Management Pond Design. VO has been accepted by the Ministry of Environment, the Ministry of Natural Resources, the Ministry of Transportation, the Ministry of Municipal Affairs, the Association of Conservation Authorities of Ontario, and most municipal governments, as a valid hydrologic simulation model.

For drainage areas with significant imperviousness such as the allocated area, the “Standhyd” method is used to determine the effective rainfall in Otthymo. This method is used in urban watersheds to simulate runoff by

calculating the effective rainfall over the pervious and impervious areas and then adding the resulting unit hydrographs. **Table 8** below summarized the allowable catchment characteristics refer to **EXP Drawing SWM100** and **SWM200 within Appendix B**. Because the project is a commercial development, based on the City of Ottawa Sewer Design Guidelines, runoff coefficients for the existing areas were limited to 0.5.

**Table 8: Predevelopment Catchment Parameter**

Area ID	Ottymo Hydrograph No.	Area (ha)	Hydrograph Method	% Impervious	Imperviousness Directly Connected %	Loss Method for Pervious Area	CN for Pervious Area	Time to Peak (T <sub>p</sub> ) hr
Area 101A	1	0.119	STANHYD	43	43	SCS	80	-
Area 101B (Uncontrolled)	4	0.049	STANHYD	43	43	SCS	80	-
<b>TOTAL SITE</b>		0.168						
Area 102 & 103 (To ROW)	8	0.008	STANHYD	9	9	SCS	80	-

**Table 9:** Predevelopment Release Rate below presents a summary of the pre-development peak flows for all storm events generated from the VO model. For more detailed information, please refer to the Pre-Development VO model output provided in Appendix D. The predevelopment release rate below includes Area 101A and Area 10B.

**Table 9: Predevelopment Release Rate**

Storm Event (yr)	Peak Flow (cms)	Peak Flow (l/s)
2 Year	0.016	16.0
5 Year	0.023	23.0
10 Year	0.028	28.0
25 Year	0.037	37.0
50 Year	0.042	42.0
100 Year	0.048	48.0
25mm 4hr	0.010	10.0

### 5.3 Allowable Release Rate

The existing private on site 200mm diameter STM located south of the proposed restaurant has been designed to accommodate the stormwater flow from the subject site at a run-off co-efficient of 0.83.

*Existing Contributing Drainage Area = 0.119 ha & 0.046 ha (Area 101A & Area 101B)  
 Runoff Coefficient C (Area 101A) = 0.83*

Runoff Coefficient C (Area 101B) = 0.78

Proposed Contributing Drainage Area = 0.156 ha (Area 201, 202, 205 & 208)

Proposed Contributing Drainage Area (Uncontrolled) = 0.050 ha (Area 203 & 207)

Runoff Coefficient C (Area 201, 202, 205 & 208) = 0.88

Runoff Coefficient C (Area 203 & 207) = 0.64

Due to grading modifications, a portion of the site that was previously landscaped and drained uncontrolled to the street will now be captured by proposed storm structures within the proposed development and existing storm structures within existing internal driveways. However, as shown in the storm calculations included in **Appendix E**, the overall flow from the subject site can be accommodated by the proposed and existing storm systems.

The following **Table 10**: Post Development Catchment Characteristic summarises the parameters used in Visual Otthymo to model the post-development catchments. Note that Area 201 & Area202 are controlled by an inlet control device has been modeled as one catchment for modelling purposes. Storm catchments for the proposed development and the existing condition are shown in **SWM200** in Appendix B. The Post Development Visual Otthymo Model Schematic is included in Appendix D. The allowable flow rate will be controlled to Pre-Development levels.

**Table 10: Post Development Catchment Characteristic**

Area ID	Otthymo Hydrograph No.	Area (ha)	Hydrograph Method	% Impervious	Imperviousness Directly Connected %	Loss Method for Pervious Area	CN for Pervious Area	Time to Peak (T <sub>p</sub> ) hr
Area 201 & 202	1	0.088	STANHYD	0.97	0.97	SCS	80	-
Area 205	4	0.046	STANHYD	0.99	0.99	SCS	99	-
Area 208	14	0.022	STANHYD	0.98	0.98	SCS	80	
<b>CONTROLLED TOTAL SITE</b>		<b>0.156</b>						
Area 203 & 207 (Uncontrolled)	12	0.050	STANDHYD	0.63	0.63	SCS	80	
<b>TOTAL SITE</b>		<b>0.050</b>						
Area 204 & 206 (To ROW)	9	0.048	STANDHYD	0.27	0.27	SCS	80	

The comparison between the pre-development release rate and post development release rates can be found in **Table 11**: Pre & Post Development Peak Flow. As shown, the storm management was designed to accommodate 100-year storm event with stress test of additional 20%. The post-development peak flow with the stress event has less flow rate than the existing condition. Due to 0.50 runoff coefficient limit, there is some increase for the 2-year, 5-year, and 10-year storm events, but the remainder of the proposed flows are less than the pre-development

flows. Also, all proposed flows are less than the actual existing condition flows which are without the 0.50 runoff coefficient limit, meaning that the system is being improved than the current condition.

**Table 11: Pre & Post Development Peak Flow**

Storm Event (yr)	Pre-Dev. Peak Flow (cms)	Pre-Dev. Peak Flow (cms) Without 0.5 RC Limit	Post-Dev. Peak Flow (cms)
2	0.016	0.032	0.025
5	0.023	0.044	0.028
10	0.028	0.052	0.030
25	0.037	0.062	0.033
50	0.042	0.069	0.035
100	0.048	0.077	0.037
100 with Stress Test (20%)	0.048	0.077	0.044
25mm 4hr	0.010	0.020	0.018

While developing the proposed development, the stormwater system of the site will be upgraded, providing better stormwater management. The existing site does not have any inlet control device. The site has uncontrolled flow captured of 48.0 L/s (Area 101A & 101B) and uncontrolled flow to ROW of 13.0 L/s (Area 102 & 103) at 100-year. However, the proposed site will enhance the system by reducing the flow rates, having 37.0 L/s (Area 201, 202, 205 & 208 with an 80mm orifice plate and Area 203 & 207), from the site and uncontrolled 11.0 /s (Area 204 & 206) to ROW.

Although the proposed development will be primarily hard surface with an addition of controlled area, since the area is mostly hard surface in its current state, there will be a slight increase in storm runoff generated by the site. The uncontrolled area to ROW will be reduced from 0.085 ha to 0.048 ha, meaning that there will be more controlled area. By having an 80mm diameter orifice plate, there will be no negative impacts on the overall stormwater management systems. The existing drainage patterns at 1984 Baseline Road will be improved to self-contain the site. Furthermore, no additional flows will be directed to the existing municipal storm sewer systems beyond what they currently receive from the subject area.

For a detailed breakdown of the pre- and post-development run-off coefficient and storage, see calculations in **Appendix E**, as well as **Novatech Drawing 101075 – GP – General Plan of Services** within **Appendix B** for the downstream storm systems.

### 5.3.1 Post Development Storage Requirements

The following **Table 12: Storage Requirement Summary – Sewer and Surface** is a summary of the volume requirements for the minor and major storm events for the sewer system and surface storage. As shown, the volume provided exceeds the storage required. Please refer to Appendix E for Calculations and the Visual Otthymo output file in Appendix D for more information.

**Table 12: Storage Requirement Summary – Sewer and Surface**

Storm Event	Storage Volume Provided (m <sup>3</sup> )	Storage Volume Required (m <sup>3</sup> )	Water Elevation (m)	Ponding Depth (m)
2 yr	27.43	7	85.87	0.00
5 yr		9	86.32	0.00
10 yr		11	86.40	0.05
25 yr		16	86.44	0.09
50 yr		19	86.46	0.11
100 yr		22	86.47	0.12
25mm 4hr		4	86.39	0.04

#### 5.4 Stormwater Quantity Management

The existing system does not have any inlet control device nor control measure for quantity management. We are proposing new infrastructure to improve and control the post-development flows to avoid any negative impact.

Stormwater quantity will be controlled through the proposed ICD located at the downstream end of the private sewer system within the subject site before it releases to the private existing system. This approach ensures that post-development flows from the site that did not have any inlet control device are managed effectively and controlled to the acceptable allowable release rate for this commercial development.

#### 5.5 Stormwater Quality Management

The stormwater quality control for the development will adhere to the City of Ottawa’s stormwater management criteria:

- *Quality Control – Suspended Solids:*
  - a) *Provide enhanced level of protection for suspended soils removal through train treatment*
  - b) *Demonstrate ISO 14034 Environmental Technology Verification (ETV) protocol for sizing OGS units.*

This target will be achieved through the proposed stormwater management system. An oil grit separator, EFO4, will be installed for quality treatment to ensure compliance with the City of Ottawa’s standards.

The existing condition does not have any quality treatment unit. By having an EFO4 in the proposed development, the site will provide better and effective control, ensuring that the stormwater management system meets all required standards. The Area 201, 202, 205 and 208 will be treated with the treatment unit. Since Area 203 & 207 will not be controlled as the current state, the area will be untreated. However, having the treatment unit will improve the stormwater quality management compared to the existing condition.

## 5.6 Storm Conveyance

Storm drainage for the subject site will be collected by a series catch basins, roof drains and catch basin manhole. Storm flows are then conveyed via the proposed storm sewer system to the existing private onsite storm sewer system.

The existing sewer connection is located at the south of the existing commercial building. The proposed grading will improve the existing drainage patterns to self-contain the site. As shown in the site grading and site servicing drawings located in **Appendix B** this site has been designed to integrate both minor and major storm systems. The overall site grading ensures that the existing drainage pattern on adjacent properties has not been altered and stormwater runoff from the subject development has been self-contained.

### 5.6.1 Minor System: Storm Sewer

The site has been graded to contain the stormwater from the site, and to direct it through a series of catch basins located throughout the site and roof water leaders on the building. These catch basins and roof drains flow into an underground storm sewer system (minor system). The underground storm sewer has been designed to accommodate the 5-year peak storm event based on City of Ottawa's Intensity Duration Frequency (IDF) curve with Time of Concentration of (Tc) 10 minutes, using Rational Method. Storm sewer sizing and gradients will maintain a minimum velocity of 0.9 m/sec and maximum 3.0 m/sec. The detailed design of the minor system is provided in **Appendix E**.

### 5.6.2 Major System: Overland Flow

In the event of a major storm, defined as storms 100-year + 20% Stress Test post-development peak flow rate leaving the site area to the 100-year + 20% Stress pre-development peak flow rate, the outlet control provided in the system in the form of an Inlet Control Device will utilize the available storm sewer infrastructure by allowing the system to back up, thus providing the required storage. Outlet controls in the sewer system are designed to restrict the post-development flows exiting from the system to the 100-year predevelopment allowable release rate. Thus, effectively restricting the flows by detaining the water in the system to release it at an allowable release rate. This will ensure that it will not have any impact on downstream overland flow capacity, and the municipal sewers. The controlled release rates of stormwater are directed to a Stormceptor to ensure that runoff from the site is treated to the City of Ottawa water quality requirements before it is released from the site.

In events larger than the 100-year + 20% Stress Test return storm, the site has been graded to include an overland flow route. This route allows the stormwater to overtop the local highpoints and flow overland and off-site existing commercial development, consistent with the existing overland flow route. The existing overland discharge point is towards Baseline Road. The major overland flow routes are shown on **EXP Drawing SWM100**, and **SWM200** in **Appendix B**.

## 5.7 Water Balance

Water balance will be provided on site while abiding the water balance target, which is 10mm on-site retention, provided in the Design Guidelines for Pinecrest/Westboro area. The 10mm runoff volume for the development is approximately 25.3 m<sup>3</sup>, which needs to be maintained for enhancement in the post development condition.

Under the post-development condition, roof storage will be introduced at the top of the proposed building to retain the stormwater. The roof storage will be designed to retain 22.0 m<sup>3</sup> of runoff, as shown in Table 13 below. Please refer to calculations in Appendix C for more information.

**Table 13: Water Balance Volume**


Surface	Area (m2)	Initial Abstraction (mm)	Volume Capture (m3)
Conventional Roof	464	0	0
Roof Storage	-	-	22.0
Paved Surface	1580	2	3.2
Landscaping	200	5	1
<b>TOTAL VOLUME CAPTURE</b>			<b>26.2</b>

## 6 Conclusion

Implementation of the design outlined in this report will ensure that the site can be serviced and complies with the requirements of the reviewing authorities and is of acceptable quality both during and after construction. In summary:

- Type of development: Commercial Development
- The total development area is 0.250 ha.
- The site will discharge sanitary flows to the existing SAN MH situated south of the proposed restaurant. The proposed Wet Weather Sanitary Flow is 0.164 L/s.
- The proposed sanitary connection is 150mm diameter with slope of 2.0%.
- The average water daily demand is 0.18 L/s
- The maximum water daily demand: 0.27 L/s
- The maximum hourly daily demand: 0.32 L/s
- The required fire flow demand using the FUS Method is 100 L/s
- The combined flow of all four contributing fire hydrants is 158.3 L/s, which exceeds the required fire flow of 6,000 L/min (100 L/s).
- The total water demand for the site is estimated as the maximum day water demand plus fire, resulting in a total demand of approximately Maximum Daily Demand + Fire Flow= (0.27 l/s + 100 l/s) = 100.27 L/s.
- An 80mm orifice plate will be placed for quantity control, and the flow will be discharging to the private on-site storm sewers, while improving existing conditions.
- An EFO4 will be placed for quality treatment.

Appendix A  
Site Plan & Novatech Plans

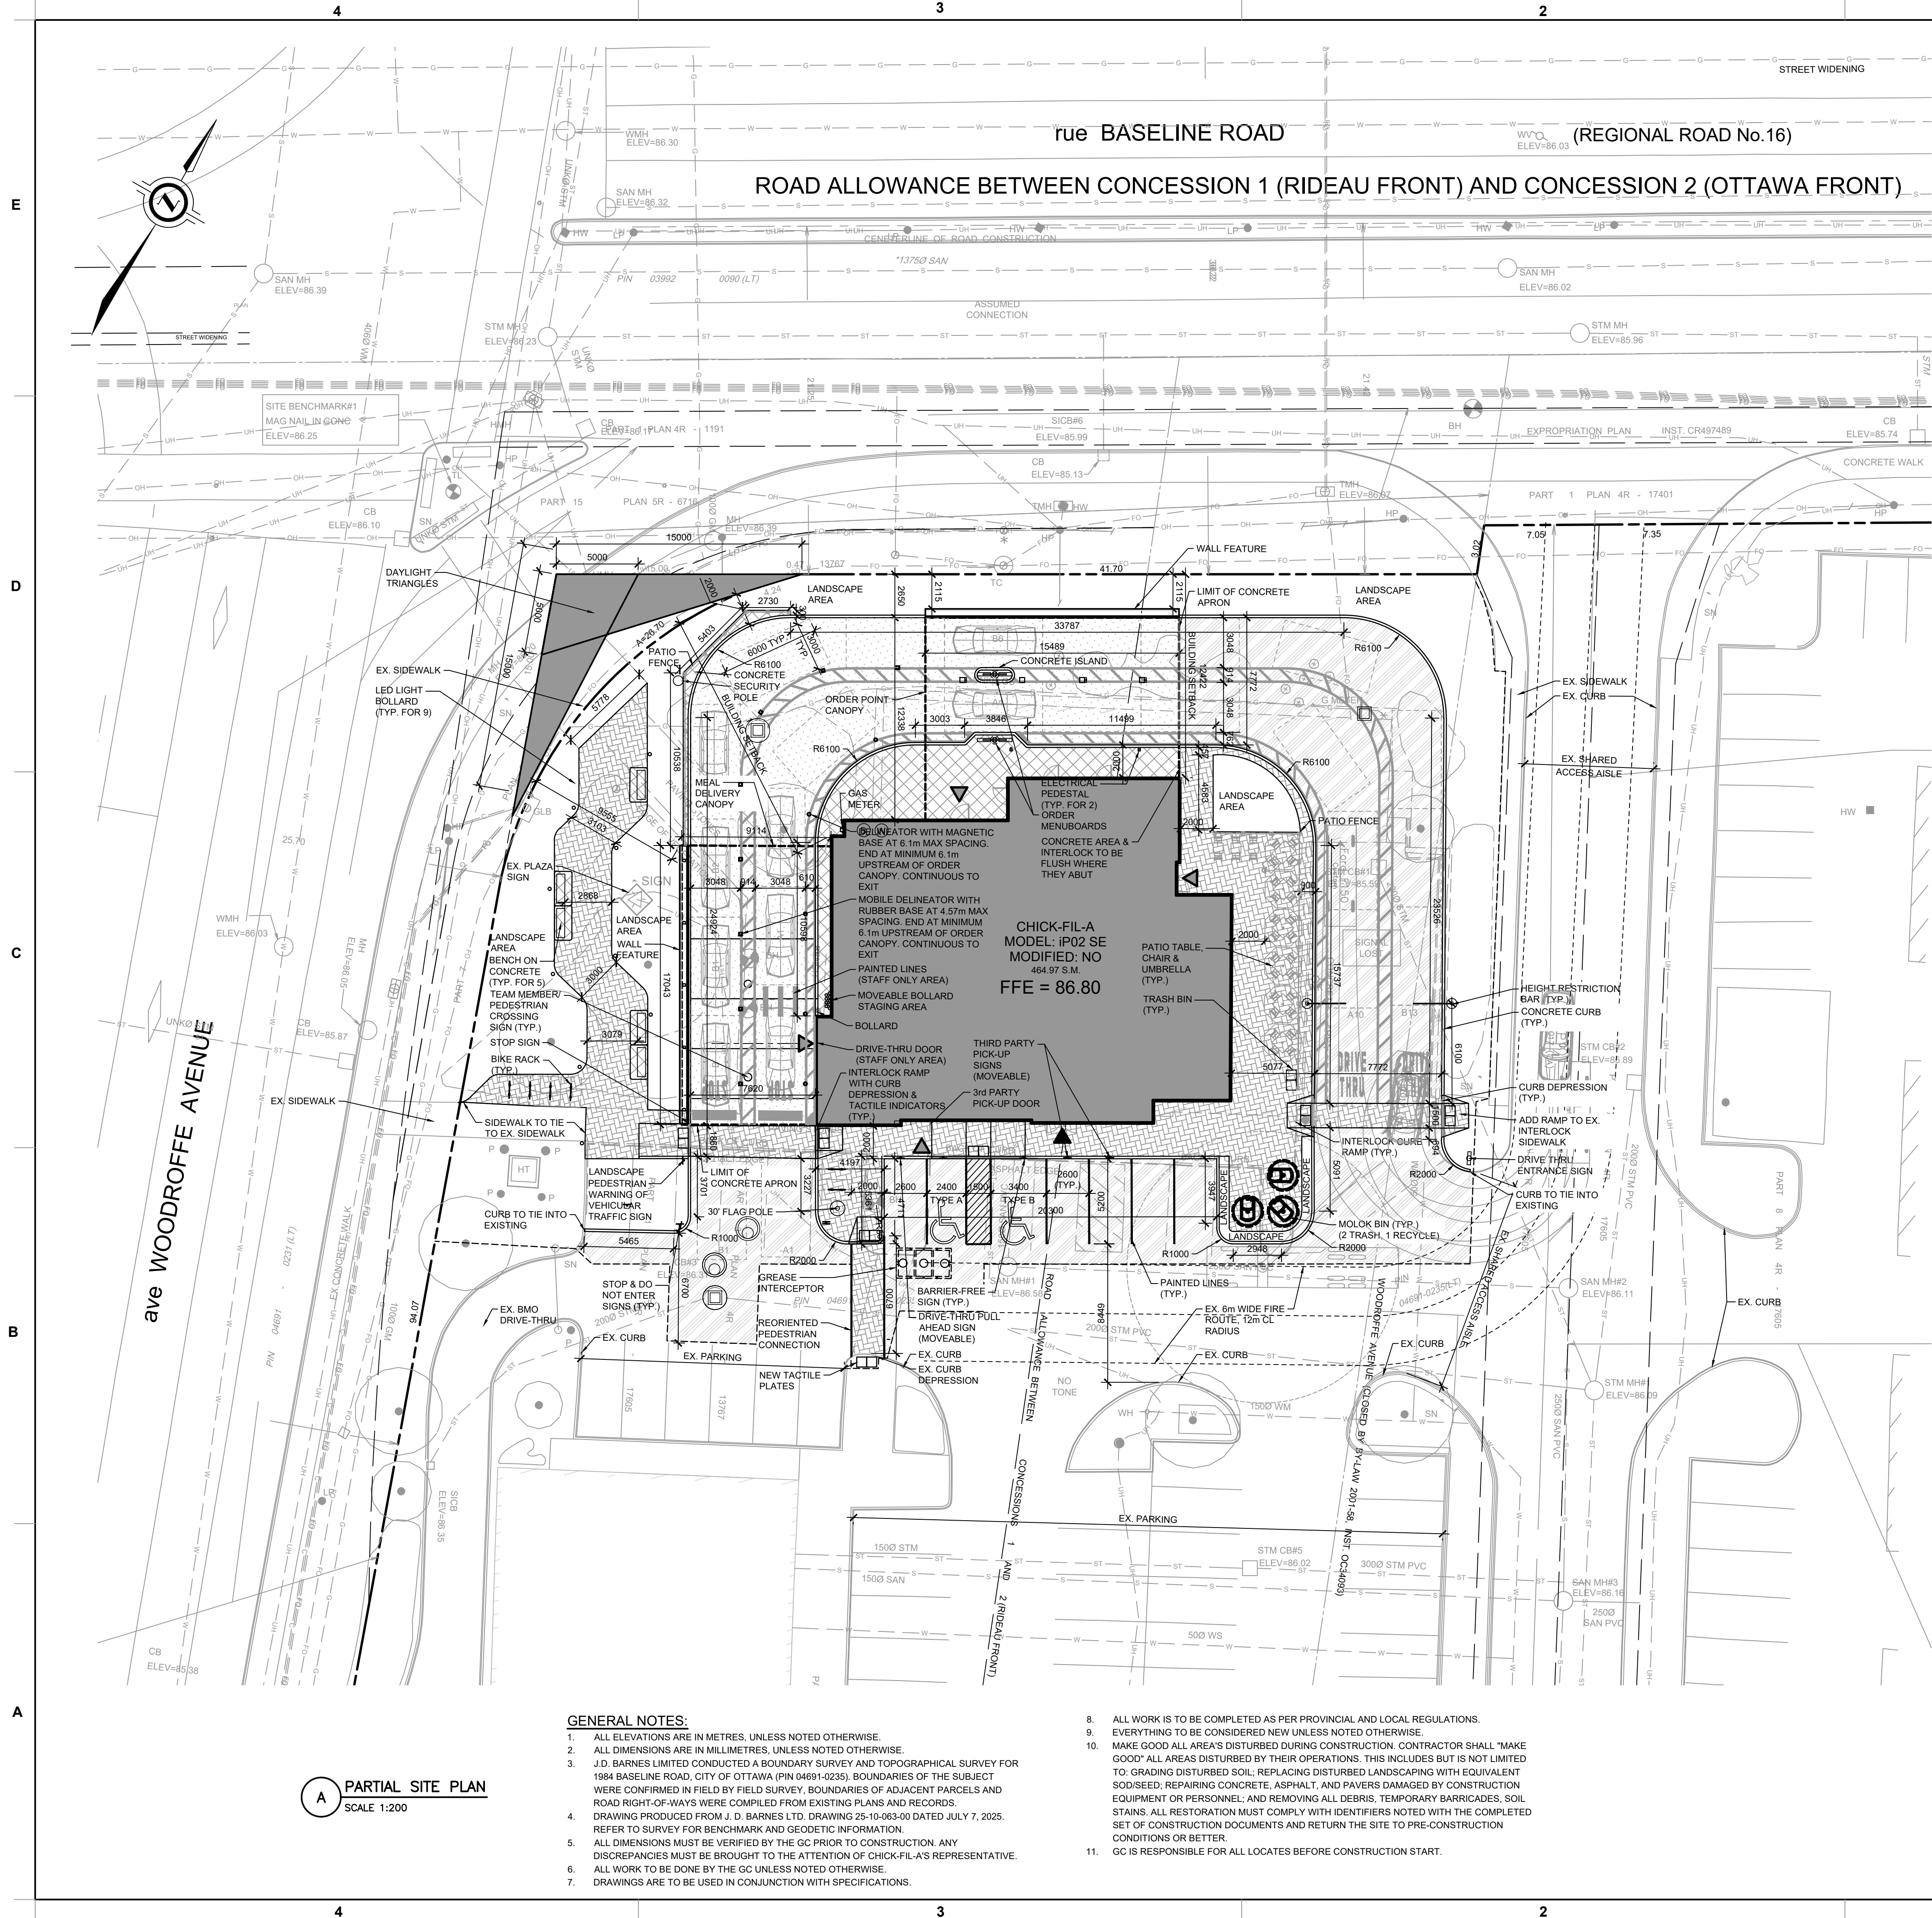

**A PARTIAL SITE PLAN**  
SCALE 1:200

- GENERAL NOTES:**
- ALL ELEVATIONS ARE IN METRES, UNLESS NOTED OTHERWISE.
  - ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS NOTED OTHERWISE.
  - J.D. BARNES LIMITED CONDUCTED A BOUNDARY SURVEY AND TOPOGRAPHICAL SURVEY FOR 1984 BASELINE ROAD, CITY OF OTTAWA (PIN 04691-0235). BOUNDARIES OF THE SUBJECT WERE CONFIRMED IN FIELD BY FIELD SURVEY. BOUNDARIES OF ADJACENT PARCELS AND ROAD RIGHT-OF-WAYS WERE COMPILED FROM EXISTING PLANS AND RECORDS.
  - DRAWING PRODUCED FROM J. D. BARNES LTD. DRAWING 25-10-063-00 DATED JULY 7, 2025. REFER TO SURVEY FOR BENCHMARK AND GEODETIC INFORMATION.
  - ALL DIMENSIONS MUST BE VERIFIED BY THE GC PRIOR TO CONSTRUCTION. ANY DISCREPANCIES MUST BE BROUGHT TO THE ATTENTION OF CHICK-FIL-A'S REPRESENTATIVE.
  - ALL WORK TO BE DONE BY THE GC UNLESS NOTED OTHERWISE.
  - DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SPECIFICATIONS.

- ALL WORK IS TO BE COMPLETED AS PER PROVINCIAL AND LOCAL REGULATIONS.
- EVERYTHING TO BE CONSIDERED NEW UNLESS NOTED OTHERWISE.
- MAKE GOOD ALL AREAS DISTURBED DURING CONSTRUCTION. CONTRACTOR SHALL "MAKE GOOD" ALL AREAS DISTURBED BY THEIR OPERATIONS. THIS INCLUDES BUT IS NOT LIMITED TO: GRADING DISTURBED SOIL; REPLACING DISTURBED LANDSCAPING WITH EQUIVALENT SOIL/SEED; REPAIRING CONCRETE, ASPHALT, AND PAVERS DAMAGED BY CONSTRUCTION EQUIPMENT OR PERSONNEL; AND REMOVING ALL DEBRIS, TEMPORARY BARRICADES, SOIL STAINS. ALL RESTORATION MUST COMPLY WITH IDENTIFIERS NOTED WITH THE COMPLETED SET OF CONSTRUCTION DOCUMENTS AND RETURN THE SITE TO PRE-CONSTRUCTION CONDITIONS OR BETTER.
- GC IS RESPONSIBLE FOR ALL LOCATES BEFORE CONSTRUCTION START.

DEVELOPMENT STATISTICS		
BY-LAW 2008-250: MIXED USE - COMMERCIAL ZONE II (MC F(1.5) H(34))		
	REQUIREMENT ZONING BY-LAW	PROPOSED
MIN. LOT AREA	0.0m	lease area -2,390sq.m.
MIN. LOT WIDTH	0.0m	lease area -42m
GFA (MEASURED FROM INTERIORS OF OUTSIDE WALLS)	0.0m	-424sq.m.
MIN. FRONT YARD & CORNER SIDE YARD SETBACK (ABUTTING RAPID TRANSIT CORRIDOR)	2.0m	2.65m CANOPY 12.4m BUILDING 1.965m FEATURE WALL
MIN. INTERIOR SIDE YARD SETBACK (ABUTTING RAPID TRANSIT CORRIDOR)	2.0m	
MIN. REAR YARD SETBACK (ABUTTING RAPID TRANSIT CORRIDOR)	2.0m	
MAX. FLOOR SPACE INDEX	1.5	0.19
MIN. BUILDING HEIGHT	6.7m	6.7m
MAX. BUILDING HEIGHT	34m	
LANDSCAPE COVERAGE		515.41m <sup>2</sup> -21.6%
MIN. WIDTH OF LANDSCAPE AREA	0.0m	2.0m
MIN. LANDSCAPE BUFFER ADJACENT TO STREET	2.0m	2.0m
MIN. LANDSCAPE BUFFER ALONG REAR AND SIDE YARDS	2.5m	
PARKING RATE FOR CHICK-FIL-A	MAX. 4'100SQ.M. OF GFA = 19	7
EX. SHARED PARKING		56
PARKING FOR CHICK-FIL-A	2.6x5.2m	2.6x5.2m
BARRIER-FREE FOR CHICK-FIL-A	1-25 SPACES = 1 26-50 SPACES = 2 TYPE 'A' 3.4x5.2m TYPE 'B' 2.4x5.2m	1 @ TYPE 'A' 3.4x5.2m 1 @ TYPE 'B' 2.4x5.2m
RESTAURANT STACKING FOR CHICK-FIL-A	MIN. 7 QUEUING SPACES @ 3.0x5.7m	27 @ 3.0x6.0m
LOADING FOR CHICK-FIL-A	GFA <1999SQ.M. = 0	0
AISLE WIDTH	MIN. 6.7m FOR DOUBLE LANE TRAFFIC	6.7m
BICYCLE PARKING FOR CHICK-FIL-A	MIN. 1/250SQ.M. OF GFA + 2	12
SIDEWALK ACCESS	MIN. 2.0m WIDE WITH DISTINGUISHED MATERIALS	2.0m
CURB SIDE PATIO	MIN. 2.0m CLEAR PEDESTRIAN PATH MIN. 0.8m SETBACK FROM EDGE OF CURB	2.0m & 0.9m

SITE STATS		
SEATING		
SE INTERIOR SEATING		86
PATIO SEATING		30
STACKING		
ENTRANCE TO PICK-UP POINT		25
PICK-UP POINT TO EXIT		2
ORDER POINT TO PICK-UP POINT		12
TOTAL STACK		27
ADJACENT PARCEL INFORMATION		
NORTH	MC 01[310]	COMMERCIAL PLAZA WITH RESTAURANTS & ANIMAL HOSPITAL HIKING AREA & SWIM POND
EAST	MC R5A[1157]	COMMERCIAL PLAZA WITH GROCERY & DEPT. STORE THIRD & FIFTH DENSITY RESIDENTIAL USES
SOUTH	MC 12	COMMERCIAL PLAZA WITH RESTAURANTS & RETAIL ALGONQUIN COLLEGE
WEST	MC[1331] 11A	RAIL CONSTRUCTION AREA & COMMERCIAL USES SIR GUY CARLETON SECONDARY SCHOOL

- LEGEND**
- HW EX. HANDWELL
  - BH EX. BOREHOLE
  - SN EX. SIGN
  - SB EX. POST/BOLLARD
  - TM EX. TELECOMMUNICATION MANHOLE
  - TE EX. TELECOMMUNICATION CHAMBER
  - TC EX. TELECOMMUNICATION MARK
  - EX. SHRUB
  - CONC EX. CONCRETE
  - ELEV EX. ELEVATION
  - CB EX. CATCH BASIN
  - MH EX. MANHOLE
  - SAN EX. MANHOLE
  - MH EX. MANHOLE
  - WK EX. WATER KEY
  - WH EX. WATER HYDRANT
  - EX. TREE
  - HT EX. HYDRO JUNCTION BOX
  - HMH EX. HYDRO MAN HOLE
  - NEW CONCRETE CURB
  - NEW CURB DEPRESSION
  - NEW STORM MH
  - NEW SANITARY MH
  - NEW STORM CB
  - NEW STORM CBMH
  - MAIN ENTRANCE
  - ALTERNATE ENTRANCE
  - LIGHT DUTY ASPHALT
  - HEAVY DUTY CONCRETE
  - LIGHT DUTY CONCRETE
  - INTERLOCKING PAVING STONES
  - STEEL BOLLARD (SEE DWGS. C9.1 & C9.4B)
  - MAGNETIC BOLLARD (SEE DWGS. C9.4A&B)
  - RUBBER BASE BOLLARD (SEE DWGS. C9.4A&B)
  - LIMIT OF DEVELOPMENT

**Chick-fil-A**  
5200 Buffington Road  
Atlanta, Georgia 30349-2998

exp Services Inc.  
t: +1.905.793.9800 | f: +1.905.793.0641  
1595 Clark Boulevard  
Brampton, ON L6T 4V1  
Canada  
www.exp.com

• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •  
• INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY

**CHICK-FIL-A**  
COLLEGE SQUARE  
1984 Baseline Road  
Ottawa, ON

**FSR#30088**  
BUILDING TYPE / SIZE: IP02 SPA  
RELEASE:

**REVISION SCHEDULE**

NO.	DATE	DESCRIPTION
E	2025-09-17	FOR SPA
F	2025-11-07	FOR SPA
G	2025-05-15	FOR SPA

CONSULTANT PROJECT # BIRM0023002042-W01  
PROJECT STATUS SPA  
DATE JULY 2025  
DRAWN BY T.M.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.

SHEET  
SITE PLAN

SHEET NUMBER  
**A100**  
FILE NUMBER 007-12-25-0159  
PLAN NUMBER 19453

- LEGEND**
- PROPOSED PAVEMENT ELEVATION
  - EXISTING ELEVATION
  - PROPOSED GROUND AT TOP OF RETAINING WALL ELEVATION
  - PROPOSED GROUND AT BOTTOM OF RETAINING WALL ELEVATION
  - T/O-07.55 PROPOSED TOP OF GRATE
  - FFE FINISHED FLOOR ELEVATION
  - T/C TOP OF CURB ELEVATION
  - R/C ROLLED CURB
  - D/C DEPRESSED CURB
  - PROPOSED BUILDING ENTRANCE
  - PROPOSED TERRACE ELEVATION
  - MAXIMUM 3:1 TERRACE
  - PROPOSED GRADE AND DIRECTION
  - PROPOSED STREETLIGHT
  - PROPOSED HYDRANT LOCATION
  - T/F TOP OF FLANGE
  - PROPOSED CATCH-BASIN MANHOLE
  - PROPOSED ROAD CATCH-BASIN
  - PROPOSED STORM MANHOLE
  - PROPOSED SANITARY MANHOLE
  - EXISTING MONITORING WELL
  - DECORATIVE RETAINING WALL
  - LOBLAWS LEASE AREA
  - GARBAGE ENCLOSURE
  - AREA OF SITE CONTAMINATION
  - LINE PAINTING
  - ASBUILT GRADE

**JOB BENCHMARK**  
 ALGONQUIN COLLEGE ON WOODROFFE AVENUE SOUTH OF SHOPPERS CITY, TABLE IN NORTH CONCRETE FOUNDATION OF PORTION OF BUILDING THAT PROJECTS TOWARDS WOODROFFE, 1.00M FROM NORTHWEST CORNER, 50CM BELOW WATER TABLE COURSE, 46CM ABOVE GROUND LEVEL.  
 ELEVATION: 86.75M  
 ESTABLISHED BY GEODETIC SURVEY DIVISION - MR CAN 1966


**INFORMATION SOURCES:**  
 1. INFORMATION SHOWN ON PLAN WAS PROVIDED FROM PLAN PROVIDED BY SHERRILL WESTRAH B GIBSON LTD AS WELL AS FROM DRAWINGS AND VERBAL CONFIRMATIONS WITH ANNE O'SULLIVAN, VOLLERCK LTD.

- GENERAL NOTES:**
1. CO-ORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
  2. DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THIS DRAWING.
  3. OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA AND THE REGION OF OTTAWA-CARLETON (R.O.C.) BEFORE COMMENCING CONSTRUCTION.
  4. RESTORE ALL TRENCHES AND SURFACES TO EXISTING CONDITIONS OR BETTER TO THE SATISFACTION OF THE ENGINEER.
  5. ALL ELEVATIONS ARE GEODETIC.
  6. ALL CURBS SHALL BE BARRIER CURB UNLESS OTHERWISE NOTED AND CONSTRUCTED AS PER CITY OF OTTAWA STANDARDS.
  7. CONTRACTOR SHALL RESTATE ALL ROAD CUTS AND OTHER SURFACES TO EXISTING CONDITIONS OR BETTER.

- GRADING NOTES:**
1. ALL ORGANIC MATTER, TOPSOIL AND UNSUITABLE MATERIAL IS TO BE STRIPPED FROM AREAS THAT ARE TO BE PAVED AND CURBED.
  2. THE PAVEMENT STRUCTURE MATERIALS SHOULD BE COMPACTED TO AT LEAST 100% OF THE STANDARD PROCTOR DRY DENSITY.
  3. GRADE AND/OR FILL BEHIND PROPOSED CURBS AND BETWEEN BUILDINGS AND CURBS, WHERE REQUIRED, TO PROVIDED POSITIVE DRAINAGE.
  4. ALL AREAS DISTURBED BY CONSTRUCTION ARE TO BE TREATED WITH IMPORTED TOPSOIL SEED AND MULCH.
  5. THE CONTRACTOR SHALL PLACE FILTER CLOTH UNDER THE CATCH-BASIN AND MANHOLE GRATES FOR THE DURATION OF GRADING ACTIVITIES. THE FILTER CLOTH IS TO REMAIN IN PLACE UNTIL GRASS GROWTH IS ESTABLISHED.
  6. REFER TO EROSION AND SEDIMENT CONTROL PLAN FOR DETAILS ON EROSION AND SEDIMENT CONTROL MEASURES TO BE USED DURING CONSTRUCTION.
  7. MATCH EXISTING ELEVATIONS AT ALL PROPERTY LINES. ENSURE POSITIVE DRAINAGE WHETHER INDICATED OR NOT.
  8. MINIMUM OF 2% GRADE FOR ALL GRASS AREAS UNLESS OTHERWISE NOTED.
  9. ALL GRADES BY CURBS ARE EDGE OF PAVEMENT GRADES UNLESS OTHERWISE INDICATED.

- PAVEMENT STRUCTURES:**
- HEAVY DUTY  
40mm GRAN "B" TYPE II  
150mm GRAN "A"  
50mm H.L.B  
40mm H.L.3
  - PARKING PAVEMENT  
30mm GRAN "B" TYPE II  
150mm GRAN "A"  
50mm H.L.3
  - HEAVY DUTY  
30mm GRAN "B" TYPE II  
150mm GRAN "A"  
40mm H.L.B  
40mm H.L.3
  - LOBLAWS PARKING PAVEMENT  
200mm GRAN "B" TYPE II  
150mm GRAN "A"  
60mm H.L.3

**NOTE:**  
 EDGE OF PAVEMENT GRADES AND BACK OF SIDEWALK GRADES ALONG NAVAHO DR. EXTENSION HAVE BEEN PROVIDED BY DILLON CONSULTING. FOR MORE DETAILED INFORMATION REFER ENGINEERING DRAWINGS BY DILLON CONSULTING

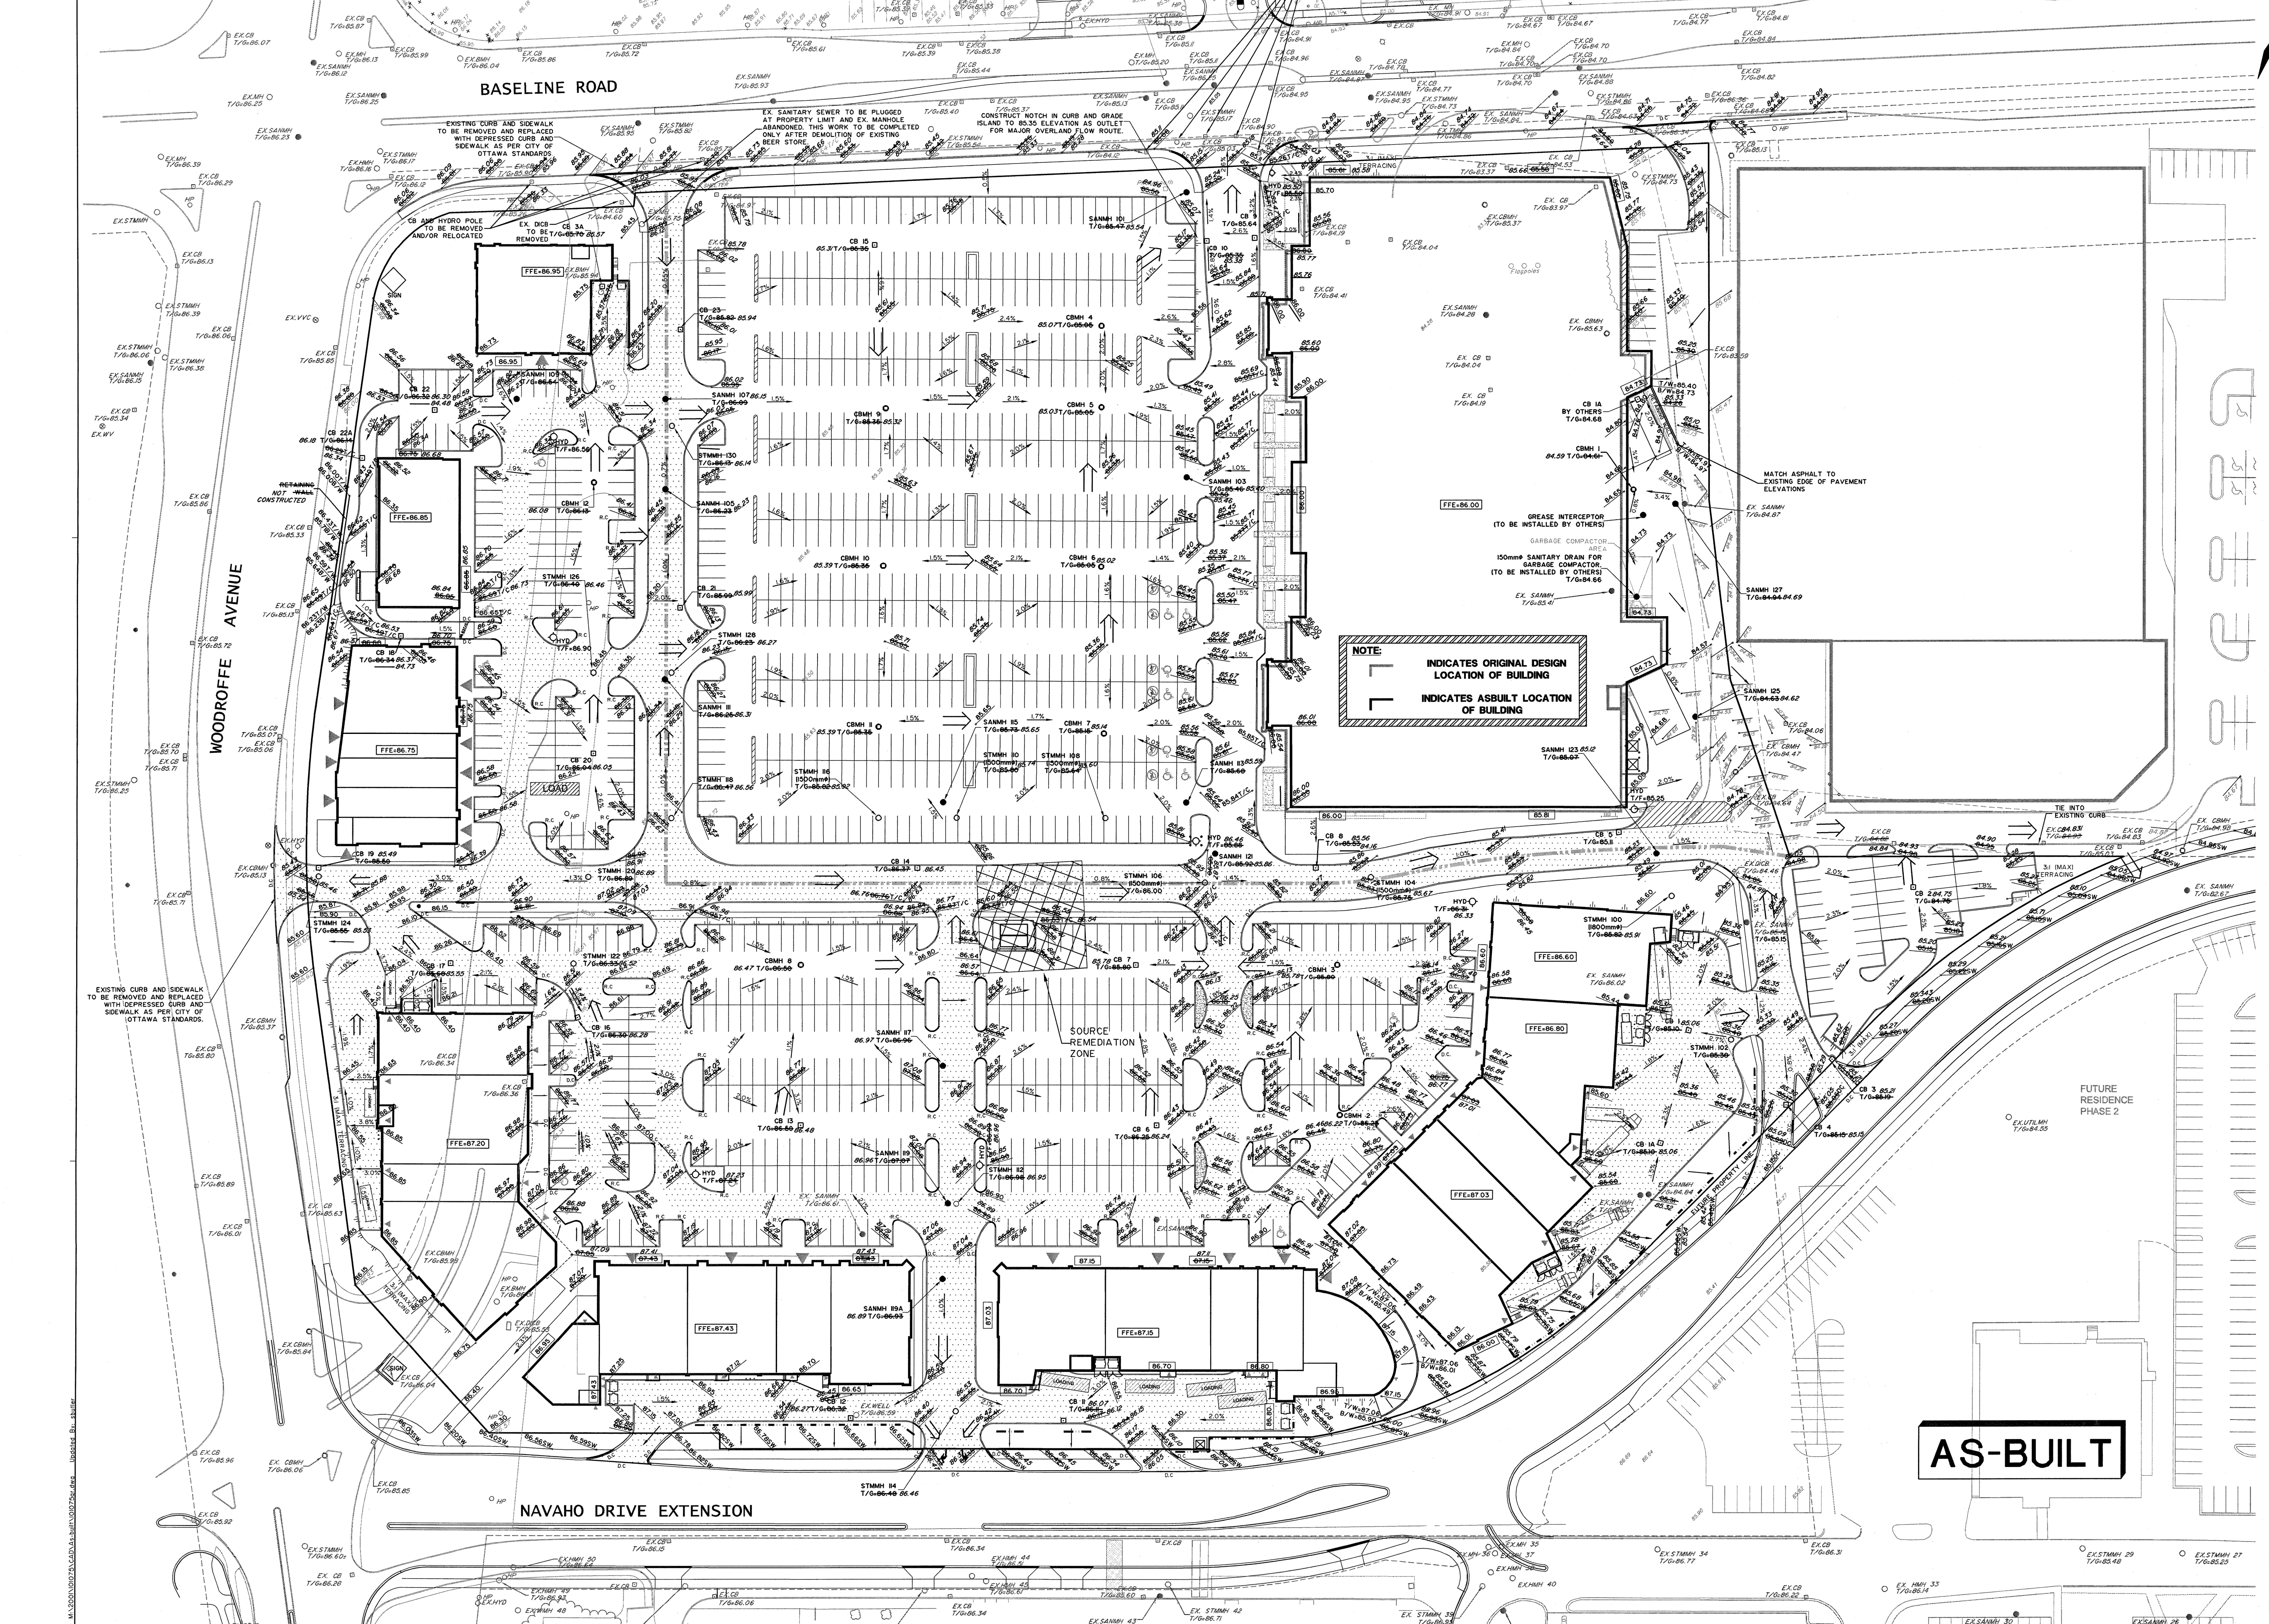

**NOTE:**  
 INDICATES ORIGINAL DESIGN LOCATION OF BUILDING  
 INDICATES ASBUILT LOCATION OF BUILDING

**AS-BUILT**

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED.

21. ASBUILT GRADING ADDED	DEC 19/03	SM	14. GRADING REVISED DUE TO BUILDING CHANGES DRAWING RE-ISSUED	MAY 08/03	CR	7. ISSUED TO CITY OF OTTAWA FOR APPROVAL	DEC 12/01	CR
20. ASBUILT GRADING ADDED	NOV 28/03	SM	13. ISSUED FOR CONSTRUCTION	FEB 15/02	CR	6. SOUTHERN PORTION OF SITE REVISED	DEC 12/01	CR
19. ISSUED FOR CONSTRUCTION	AUG 06/02	CR	12. RE-ISSUED FOR FINAL APPROVAL	FEB 14/02	CR	5. ISSUED FOR LOBLAWS PAD CONSTRUCTION	NOV 27/01	CR
18. RE-ISSUED FOR SURFACE WORKS TENDER	JUL 11/02	CR	11. REVISED PER CITY COMMENTS	FEB 12/02	CR	4. REVISED SITE SERVICES AND GRADING	NOV 26/01	CR


CITY OF OTTAWA  
 COLLEGE SQUARE  
 PROJECT NO. 101075  
 DATE: MAY 2004

**Novatech**  
 CONSULTING ENGINEERS & PLANNERS

SCALE: 1:500  
 DRAWN: JGR  
 CHECKED: CR

REGISTERED PROFESSIONAL ENGINEER  
 C.J. RUDELO

REGISTERED PROFESSIONAL ENGINEER  
 J.B. RIDDELL

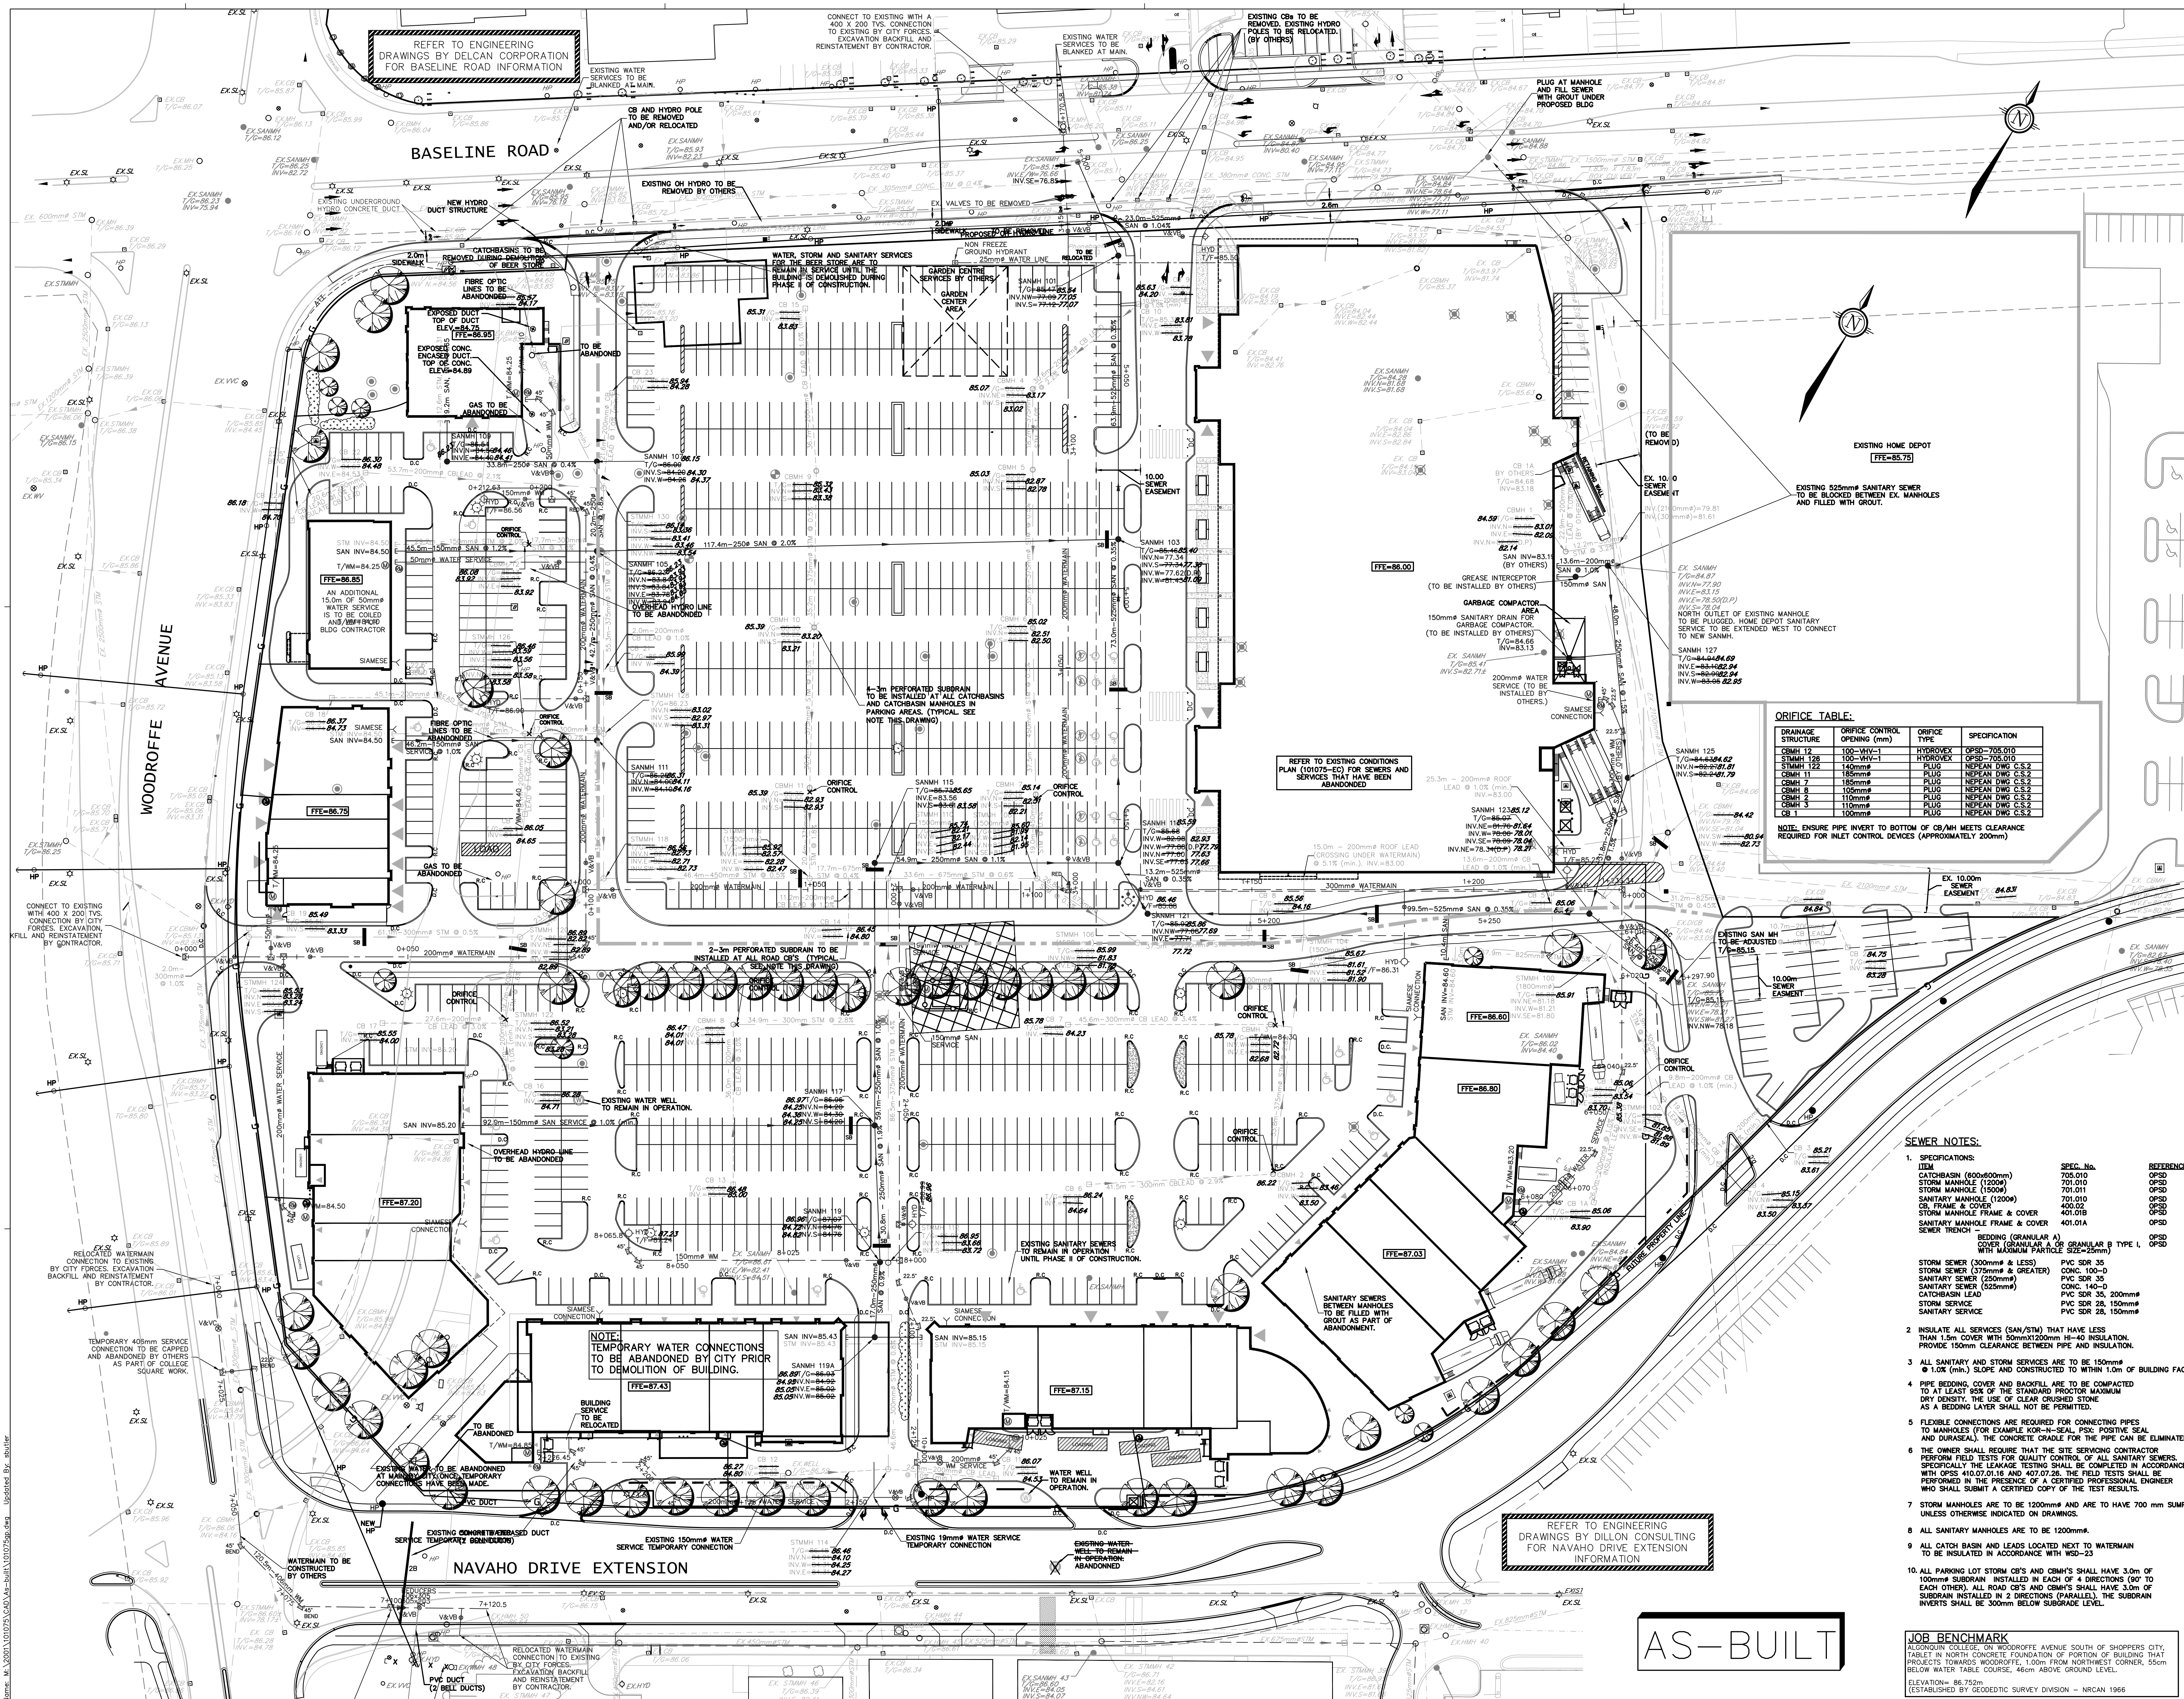

**LEGEND**

- PROPOSED WATERMAIN AND DIAMETER
- PROPOSED VALVE LOCATION
- VALVE & VALVE CHAMBER (PROPOSED)
- PROPOSED HYDRANT C/W VALVE & LEAD
- PROPOSED HYDRANT WITH BOLLARDS
- PROPOSED BEND AND THURSTROCK
- PROPOSED SANITARY MH & SEWER
- PROPOSED STORM MH & SEWER
- PROPOSED CATCHBASIN MANHOLE
- PROPOSED ROAD CATCHBASIN
- PROPOSED BUILDING ENTRANCE
- FINISHED FLOOR ELEVATION
- UNDERSIDE OF FOOTING ELEVATION
- DEPRESSED CURB
- DROP PIPE ELEVATION
- EXISTING SANITARY MH & SEWER
- EXISTING STORM MH & SEWER
- EXISTING WATERMAIN
- PROPOSED STREET LIGHT
- EXISTING STREET LIGHT
- EXISTING WELLS
- EXISTING HANDHOLES
- GARBAGE ENCLOSURE
- DECORATIVE RETAINING WALL
- LOBLAND LEASE AREA
- SANITARY EASEMENT
- PONDING AREA - 100 YEAR STORM
- PONDING AREA - 5 YEAR STORM
- MONITORING WELL (TO BE PROTECTED DURING CONSTRUCTION)
- MONITORING WELL (TO BE DECOMMISSIONED)
- BORING (TO BE PROTECTED DURING CONSTRUCTION)
- SEEPAGE BARRIER
- INTERLOCKING BRICK WALKWAY
- LINE PAINTING
- AREA OF SITE CONTAMINATION
- ASBULT ELEVATION

**INFORMATION SOURCES:**

1. INFORMATION SHOWN ON PLAN WAS PRODUCED FROM PLANS PROVIDED BY GIBSON & GIBSON LTD. AS WELL AS FROM DRAWINGS AND VERBAL CONFIRMATIONS WITH ANNE O'BRIEN, VOLLEBERG LTD.

- GENERAL NOTES:**
1. CONTRACTOR SHALL REINSTATE ALL ROAD CUTS AND OTHER SURFACES TO EXISTING CONDITIONS OR BETTER.
  2. REFER TO GEOTECHNICAL REPORT (REPORT NO. G5372-01) BY J.D. PATTERSON & ASSOCIATES LTD. DATED NOV. 2001 FOR BOREHOLE INFORMATION. INTERPRETATION OF INFORMATION IS RESPONSIBILITY OF THE CONTRACTOR.
  3. REFER TO ARCHITECT'S DRAWING FOR BUILDING DIMENSIONS AND SITE LAYOUT. CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING INFORMATION NECESSARY TO VERIFY THE ACCURACY OF ALL INFORMATION OBTAINED FROM THIS PLAN.
  4. THE ORIGINAL TOPOGRAPHY AND GROUND ELEVATIONS, SERVING AND SANITARY INFORMATION SHOWN ON THIS PLAN ARE SUPPLIED FOR INFORMATION PURPOSES ONLY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE ACCURACY OF ALL INFORMATION OBTAINED FROM THIS PLAN.
  5. COORDINATE AND SCHEDULE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
  6. BEFORE COMMENCING CONSTRUCTION PROVIDE PROOF OF COMPREHENSIVE ALL RISK AND OPERATIONAL LIABILITY INSURANCE INCLUDING BLASTING. INSURANCE POLICY TO NAME THE OWNER, ENGINEER AND ARCHITECT AS CO-INSURED. AMOUNT OF INSURANCE TO BE SPECIFIED BY OWNERS AGENT.
  7. DETERMINE THE EXACT LOCATION, SIZE, MATERIAL AND ELEVATION OF ALL EXISTING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT AND ASSUME ALL RESPONSIBILITY FOR ALL EXISTING UTILITIES WHETHER OR NOT SHOWN ON THESE DRAWINGS. REPORT ALL DISCREPANCIES TO THE ENGINEER.
  8. OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF OTTAWA AND THE IRMO BEFORE COMMENCING CONSTRUCTION.
  9. REMOVE FROM SITE ALL EXCESS EXCAVATED MATERIAL UNLESS OTHERWISE INSTRUCTED BY ENGINEER. EXCAVATE AND REMOVE FROM SITE ALL ORGANIC MATERIAL AND DEBRIS.
  10. ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS.
  11. FILL CLONTS TO BE PLACED UNDER GRATES OF ALL PROPOSED CATCHBASINS FOR TEMPORARY SEDIMENT CONTROL DURING CONSTRUCTION.
  12. ALL CONCRETE CATCH BASINS TO HAVE 600mm SUMPS
  13. CONTRACTOR TO PROVIDE ASBULT INFORMATION UPON COMPLETION OF WORK.

- SEEPAGE BARRIER NOTES:**
1. SEEPAGE BARRIER SHALL EXTEND FROM TRENCH WALL TO TRENCH WALL AND FROM SEEPAGE BARRIER LEVEL TO TERMINATE AT THE FRONT LINE (1.5m BELOW FINAL ELEVATIONS).
  - SEEPAGE BARRIERS SHALL CONSIST OF 1.5m WIDE WEATHERED SILTY CLAY COMPACTED IN THIN LIFTS TO AT LEAST 90% STANDARD PROCTOR DENSITY.

- SEWER NOTES:**
1. SPECIFICATIONS:
 

ITEM	SEC. No.	REFERENCE
CATCHBASIN (600x600mm)	701.010	OPSD
STORM MANHOLE (1200mm)	701.010	OPSD
STORM MANHOLE (1500mm)	701.010	OPSD
SANITARY MANHOLE (1200mm)	701.010	OPSD
STORM MANHOLE FRAME & COVER	401.01B	OPSD
SANITARY MANHOLE FRAME & COVER	401.01A	OPSD
SEWER TRENCH	300 (SIMILAR A) & 300 GRANULAR B TYPE I	OPSD
COVER (SIMILAR A)	300	OPSD
COVER (SIMILAR B)	300	OPSD
STORM SEWER (300mm & LESS)	PVC SDR 35	
STORM SEWER (375mm & GREATER)	CONC. 100-0	
SANITARY SEWER (250mm)	PVC SDR 35	
SANITARY SEWER (300mm)	CONC. 140-0	
CATCHBASIN LEAD	PVC SDR 35, 200mm	
STORM SERVICE	PVC SDR 28, 150mm	
SANITARY SERVICE	PVC SDR 28, 150mm	
  2. INSULATE ALL SERVICES (SAN/STM) THAT HAVE LESS THAN 1.5m COVER WITH 50mm(200mm R-10) INSULATION. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION.
  3. ALL SANITARY AND STORM SERVICES ARE TO BE 150mm MIN @ 1.0% (MIN) SLOPE AND CONSTRUCTED TO WITHIN 1.0m OF BUILDING FACE
  4. PIPE BEDDING COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 90% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY. THE USE OF CLEAN CRUSHED STONE AS A BEDDING LAYER SHALL NOT BE PERMITTED.
  5. FLEXIBLE CONNECTIONS ARE REQUIRED FOR CONNECTING PIPES TO MANHOLES (FOR EXAMPLE KOR-1=SEAL, PSD, POSITIVE SEAL AND DURASEAL). THE CONCRETE CRADE FOR THE PIPE CAN BE ELIMINATED.
  6. THE OWNER SHALL REQUIRE THAT THE SITE SERVING CONTRACTOR PERFORM TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. SPECIFICALLY THE LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSD 410.07 (B) AND 427.02 (B). FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.
  7. STORM MANHOLES ARE TO BE 1200mm AND ARE TO HAVE 700 mm SUMPS, UNLESS OTHERWISE INDICATED ON DRAWINGS.
  8. ALL SANITARY MANHOLES ARE TO BE 1200mm.
  9. ALL CATCH BASIN AND LEADS LOCATED NEXT TO WATERMAIN BY CITY OF OTTAWA FORSEVERAL ARE TO BE 1200mm.
  10. ALL PARKING LOT STORM DEFS AND CATCHES SHALL HAVE 3.0m OF 100mm SURBAN INSTALLED IN EACH OF 4 DIRECTIONS (90° TO EACH OTHER). ALL ROAD C&S AND C&S'S SHALL HAVE 3.0m OF SURBAN INSTALLED IN 2 DIRECTIONS (PARALLEL). THE SURBAN INVERTS SHALL BE 300mm BELOW SUBGRADE LEVEL.
  11. SUPPLY AND CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH CITY OF OTTAWA (FORMERLY REGION OF OTTAWA-CARLETON) STANDARDS AND SPECIFICATIONS. RESTORATION OF EXISTING WATERMANS AND APPURTENANCES TO PROVIDE THE NECESSARY ASSISTANCE TO CITY FOR DISINFECTION.
  12. VALUE AND VALVE BOXES TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD-11.2 AND WSD-24.
  13. WATER METER AND REMOTE RECEPTACLE TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD 20. 31 OR 32. METER TO BE BOED BY CITY.
  14. PROVIDE THERMAL INSULATION FOR WATERMAIN AT OPEN STRUCTURES PER WSD-53.
  15. IF WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS LESS THAN THAT RECOMMENDED BY THE MANUFACTURER.
  16. ALL WATERMAIN SERVICE INSTALLATIONS AT SEWER CROSSINGS TO BE AS PER WSD-58.
  17. SUPPLY AND CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH CITY OF OTTAWA (FORMERLY REGION OF OTTAWA-CARLETON) STANDARDS AND SPECIFICATIONS. RESTORATION OF EXISTING WATERMANS AND APPURTENANCES TO PROVIDE THE NECESSARY ASSISTANCE TO CITY FOR DISINFECTION.
  18. VALUE AND VALVE BOXES TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD-11.2 AND WSD-24.
  19. WATER METER AND REMOTE RECEPTACLE TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD 20. 31 OR 32. METER TO BE BOED BY CITY.
  20. NO WATERMAIN TO BE LAID ON FILL UNTIL THE DENSITY TEST REPORTS HAVE BEEN SUBMITTED TO AND APPROVED BY THE REGION. FILL TO BE PLACED TO MINIMUM ABOVE THE TOP OF THE WATERMAIN GRADES AND COMPACTED TO MINIMUM 100% STANDARD PROCTOR IN 0.3m LIFTS. TESTS SHALL BE TAKEN ALONG THE CENTRE OF THE LIFT. ALL TESTS HORIZONTAL BEDS, AND BRANCH VALVES IN FILL AREAS TO BE TIED WITH THURST RESTRAINING JOINTS AND THRUST BLOCKS AS APPROPRIATE. (RMOCD DESIGN GUIDELINES 3.4.4)
  21. WATERMANS SERVICES ARE TO BE 150mm AND CONSTRUCTED TO WITHIN 1.0m OF BUILDING FACE.

**ORIFICE TABLE:**

ORIFICE CONTROL STRUCTURE	ORIFICE CONTROL OPENING (mm)	ORIFICE TYPE	SPECIFICATION
CRIB 12	100	HYPEREX	OPSD-705.010
STORM 120	100	HYPEREX	OPSD-705.010
STORM 120	150	PLUG	NEPEAN DWG C-2.2
CRIB 11	150	PLUG	NEPEAN DWG C-2.2
CRIB 8	150	PLUG	NEPEAN DWG C-2.2
CRIB 7	150	PLUG	NEPEAN DWG C-2.2
CRIB 6	150	PLUG	NEPEAN DWG C-2.2
CRIB 5	150	PLUG	NEPEAN DWG C-2.2
CRIB 4	150	PLUG	NEPEAN DWG C-2.2
CRIB 3	150	PLUG	NEPEAN DWG C-2.2
CRIB 2	150	PLUG	NEPEAN DWG C-2.2
CRIB 1	150	PLUG	NEPEAN DWG C-2.2

- SEWER NOTES:**
1. SPECIFICATIONS:
 


ITEM	SEC. No.	REFERENCE
CATCHBASIN (600x600mm)	701.010	OPSD
STORM MANHOLE (1200mm)	701.010	OPSD
STORM MANHOLE (1500mm)	701.010	OPSD
SANITARY MANHOLE (1200mm)	701.010	OPSD
STORM MANHOLE FRAME & COVER	401.01B	OPSD
SANITARY MANHOLE FRAME & COVER	401.01A	OPSD
SEWER TRENCH	300 (SIMILAR A) & 300 GRANULAR B TYPE I	OPSD
COVER (SIMILAR A)	300	OPSD
COVER (SIMILAR B)	300	OPSD
STORM SEWER (300mm & LESS)	PVC SDR 35	
STORM SEWER (375mm & GREATER)	CONC. 100-0	
SANITARY SEWER (250mm)	PVC SDR 35	
SANITARY SEWER (300mm)	CONC. 140-0	
CATCHBASIN LEAD	PVC SDR 35, 200mm	
STORM SERVICE	PVC SDR 28, 150mm	
SANITARY SERVICE	PVC SDR 28, 150mm	
  2. INSULATE ALL SERVICES (SAN/STM) THAT HAVE LESS THAN 1.5m COVER WITH 50mm(200mm R-10) INSULATION. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION.
  3. ALL SANITARY AND STORM SERVICES ARE TO BE 150mm MIN @ 1.0% (MIN) SLOPE AND CONSTRUCTED TO WITHIN 1.0m OF BUILDING FACE
  4. PIPE BEDDING COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 90% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY. THE USE OF CLEAN CRUSHED STONE AS A BEDDING LAYER SHALL NOT BE PERMITTED.
  5. FLEXIBLE CONNECTIONS ARE REQUIRED FOR CONNECTING PIPES TO MANHOLES (FOR EXAMPLE KOR-1=SEAL, PSD, POSITIVE SEAL AND DURASEAL). THE CONCRETE CRADE FOR THE PIPE CAN BE ELIMINATED.
  6. THE OWNER SHALL REQUIRE THAT THE SITE SERVING CONTRACTOR PERFORM TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. SPECIFICALLY THE LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSD 410.07 (B) AND 427.02 (B). FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.
  7. STORM MANHOLES ARE TO BE 1200mm AND ARE TO HAVE 700 mm SUMPS, UNLESS OTHERWISE INDICATED ON DRAWINGS.
  8. ALL SANITARY MANHOLES ARE TO BE 1200mm.
  9. ALL CATCH BASIN AND LEADS LOCATED NEXT TO WATERMAIN BY CITY OF OTTAWA FORSEVERAL ARE TO BE 1200mm.
  10. ALL PARKING LOT STORM DEFS AND CATCHES SHALL HAVE 3.0m OF 100mm SURBAN INSTALLED IN EACH OF 4 DIRECTIONS (90° TO EACH OTHER). ALL ROAD C&S AND C&S'S SHALL HAVE 3.0m OF SURBAN INSTALLED IN 2 DIRECTIONS (PARALLEL). THE SURBAN INVERTS SHALL BE 300mm BELOW SUBGRADE LEVEL.
  11. SUPPLY AND CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH CITY OF OTTAWA (FORMERLY REGION OF OTTAWA-CARLETON) STANDARDS AND SPECIFICATIONS. RESTORATION OF EXISTING WATERMANS AND APPURTENANCES TO PROVIDE THE NECESSARY ASSISTANCE TO CITY FOR DISINFECTION.
  12. VALUE AND VALVE BOXES TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD-11.2 AND WSD-24.
  13. WATER METER AND REMOTE RECEPTACLE TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD 20. 31 OR 32. METER TO BE BOED BY CITY.
  14. PROVIDE THERMAL INSULATION FOR WATERMAIN AT OPEN STRUCTURES PER WSD-53.
  15. IF WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS LESS THAN THAT RECOMMENDED BY THE MANUFACTURER.
  16. ALL WATERMAIN SERVICE INSTALLATIONS AT SEWER CROSSINGS TO BE AS PER WSD-58.
  17. SUPPLY AND CONSTRUCT ALL WATERMANS AND APPURTENANCES IN ACCORDANCE WITH CITY OF OTTAWA (FORMERLY REGION OF OTTAWA-CARLETON) STANDARDS AND SPECIFICATIONS. RESTORATION OF EXISTING WATERMANS AND APPURTENANCES TO PROVIDE THE NECESSARY ASSISTANCE TO CITY FOR DISINFECTION.
  18. VALUE AND VALVE BOXES TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD-11.2 AND WSD-24.
  19. WATER METER AND REMOTE RECEPTACLE TO BE INSTALLED AS PER CITY STANDARD SPECIFICATION WSD 20. 31 OR 32. METER TO BE BOED BY CITY.
  20. NO WATERMAIN TO BE LAID ON FILL UNTIL THE DENSITY TEST REPORTS HAVE BEEN SUBMITTED TO AND APPROVED BY THE REGION. FILL TO BE PLACED TO MINIMUM ABOVE THE TOP OF THE WATERMAIN GRADES AND COMPACTED TO MINIMUM 100% STANDARD PROCTOR IN 0.3m LIFTS. TESTS SHALL BE TAKEN ALONG THE CENTRE OF THE LIFT. ALL TESTS HORIZONTAL BEDS, AND BRANCH VALVES IN FILL AREAS TO BE TIED WITH THURST RESTRAINING JOINTS AND THRUST BLOCKS AS APPROPRIATE. (RMOCD DESIGN GUIDELINES 3.4.4)
  21. WATERMANS SERVICES ARE TO BE 150mm AND CONSTRUCTED TO WITHIN 1.0m OF BUILDING FACE.

**AS-BUILT**

**JOB BENCHMARK**  
 ALGOMQUIN COLLEGE, ON WOODROFFE AVENUE SOUTH OF SHOPPERS CITY, TABLE IN NORTH CORNER, FOUNDATION OF PORTION OF BUILDING THAT PROJECTS TOWARDS WOODROFFE, 1.0m FROM NORTHWEST CORNER, 50m BELOW WATER TABLE COURSE, FROM ABOVE GROUND LEVEL.  
 ELEVATION= 86.72m  
 ESTABLISHED BY GEODETIC SURVEY DIVISION - NRCAN 1966

**NOTE:**  
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.


No.	REVISION	DATE	BY	No.	REVISION	DATE	BY
21.	ASBULT INFO ADDED BLOCK G	JUN 20/05	SAB	14.	REVISED PER CITY COMMENTS	FEB 19/02	RSC
20.	ASBULT INFO ADDED	DEC 19/03	AR	13.	ISSUED FOR CONSTRUCTION	FEB 14/02	CR
19.	ASBULT GRADING ADDED	NOV 28/03	SM	12.	RE-ISSUED FOR FINAL APPROVAL	FEB 13/02	CR
18.	PRELIMINARY ASBULTS	APRIL 03	CR	11.	REVISED PER CITY COMMENTS	FEB 12/02	CR
17.	ISSUED FOR SURFACE WORKS TENDER	JUN 18/02	CR	10.	ISSUED TO CITY FOR UTILITY CIRCULATION	JAN 25/02	CR
16.	REVISED PER CONSTRUCTION ISSUES & RE-ISSUED	MAY 08/02	CR	9.	ISSUED TO CITY FOR FINAL APPROVAL	JAN 25/02	CR
15.	NEW HYD & REV LOBLAWS SAMESE LOCATION	MAR 28/02	CR	8.	REVISED PER ADDENDUM No. 1	JAN 25/02	CR
No.	REVISION	DATE	BY	No.	REVISION	DATE	BY

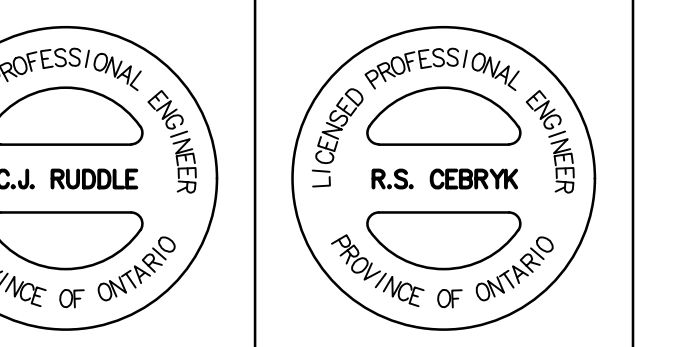

**NOVATECH**  
 CONSULTING ENGINEERS & PLANNERS  
 Suite 177, 77 Aurora Drive  
 Nepean, Ontario, Canada  
 Telephone: (613) 727-1658  
 Facsimile: (613) 727-6972  
 Email: novatech@novatech-eng.com

**CITY OF OTTAWA**  
**COLLEGE SQUARE**  
**GENERAL PLAN OF SERVICES**  
 PROJECT NO. 101075  
 DATE: MAY 2001  
 DRAWING NO. 101075-GP  
 SCALE: 1:500

Appendix B  
Engineering Drawings

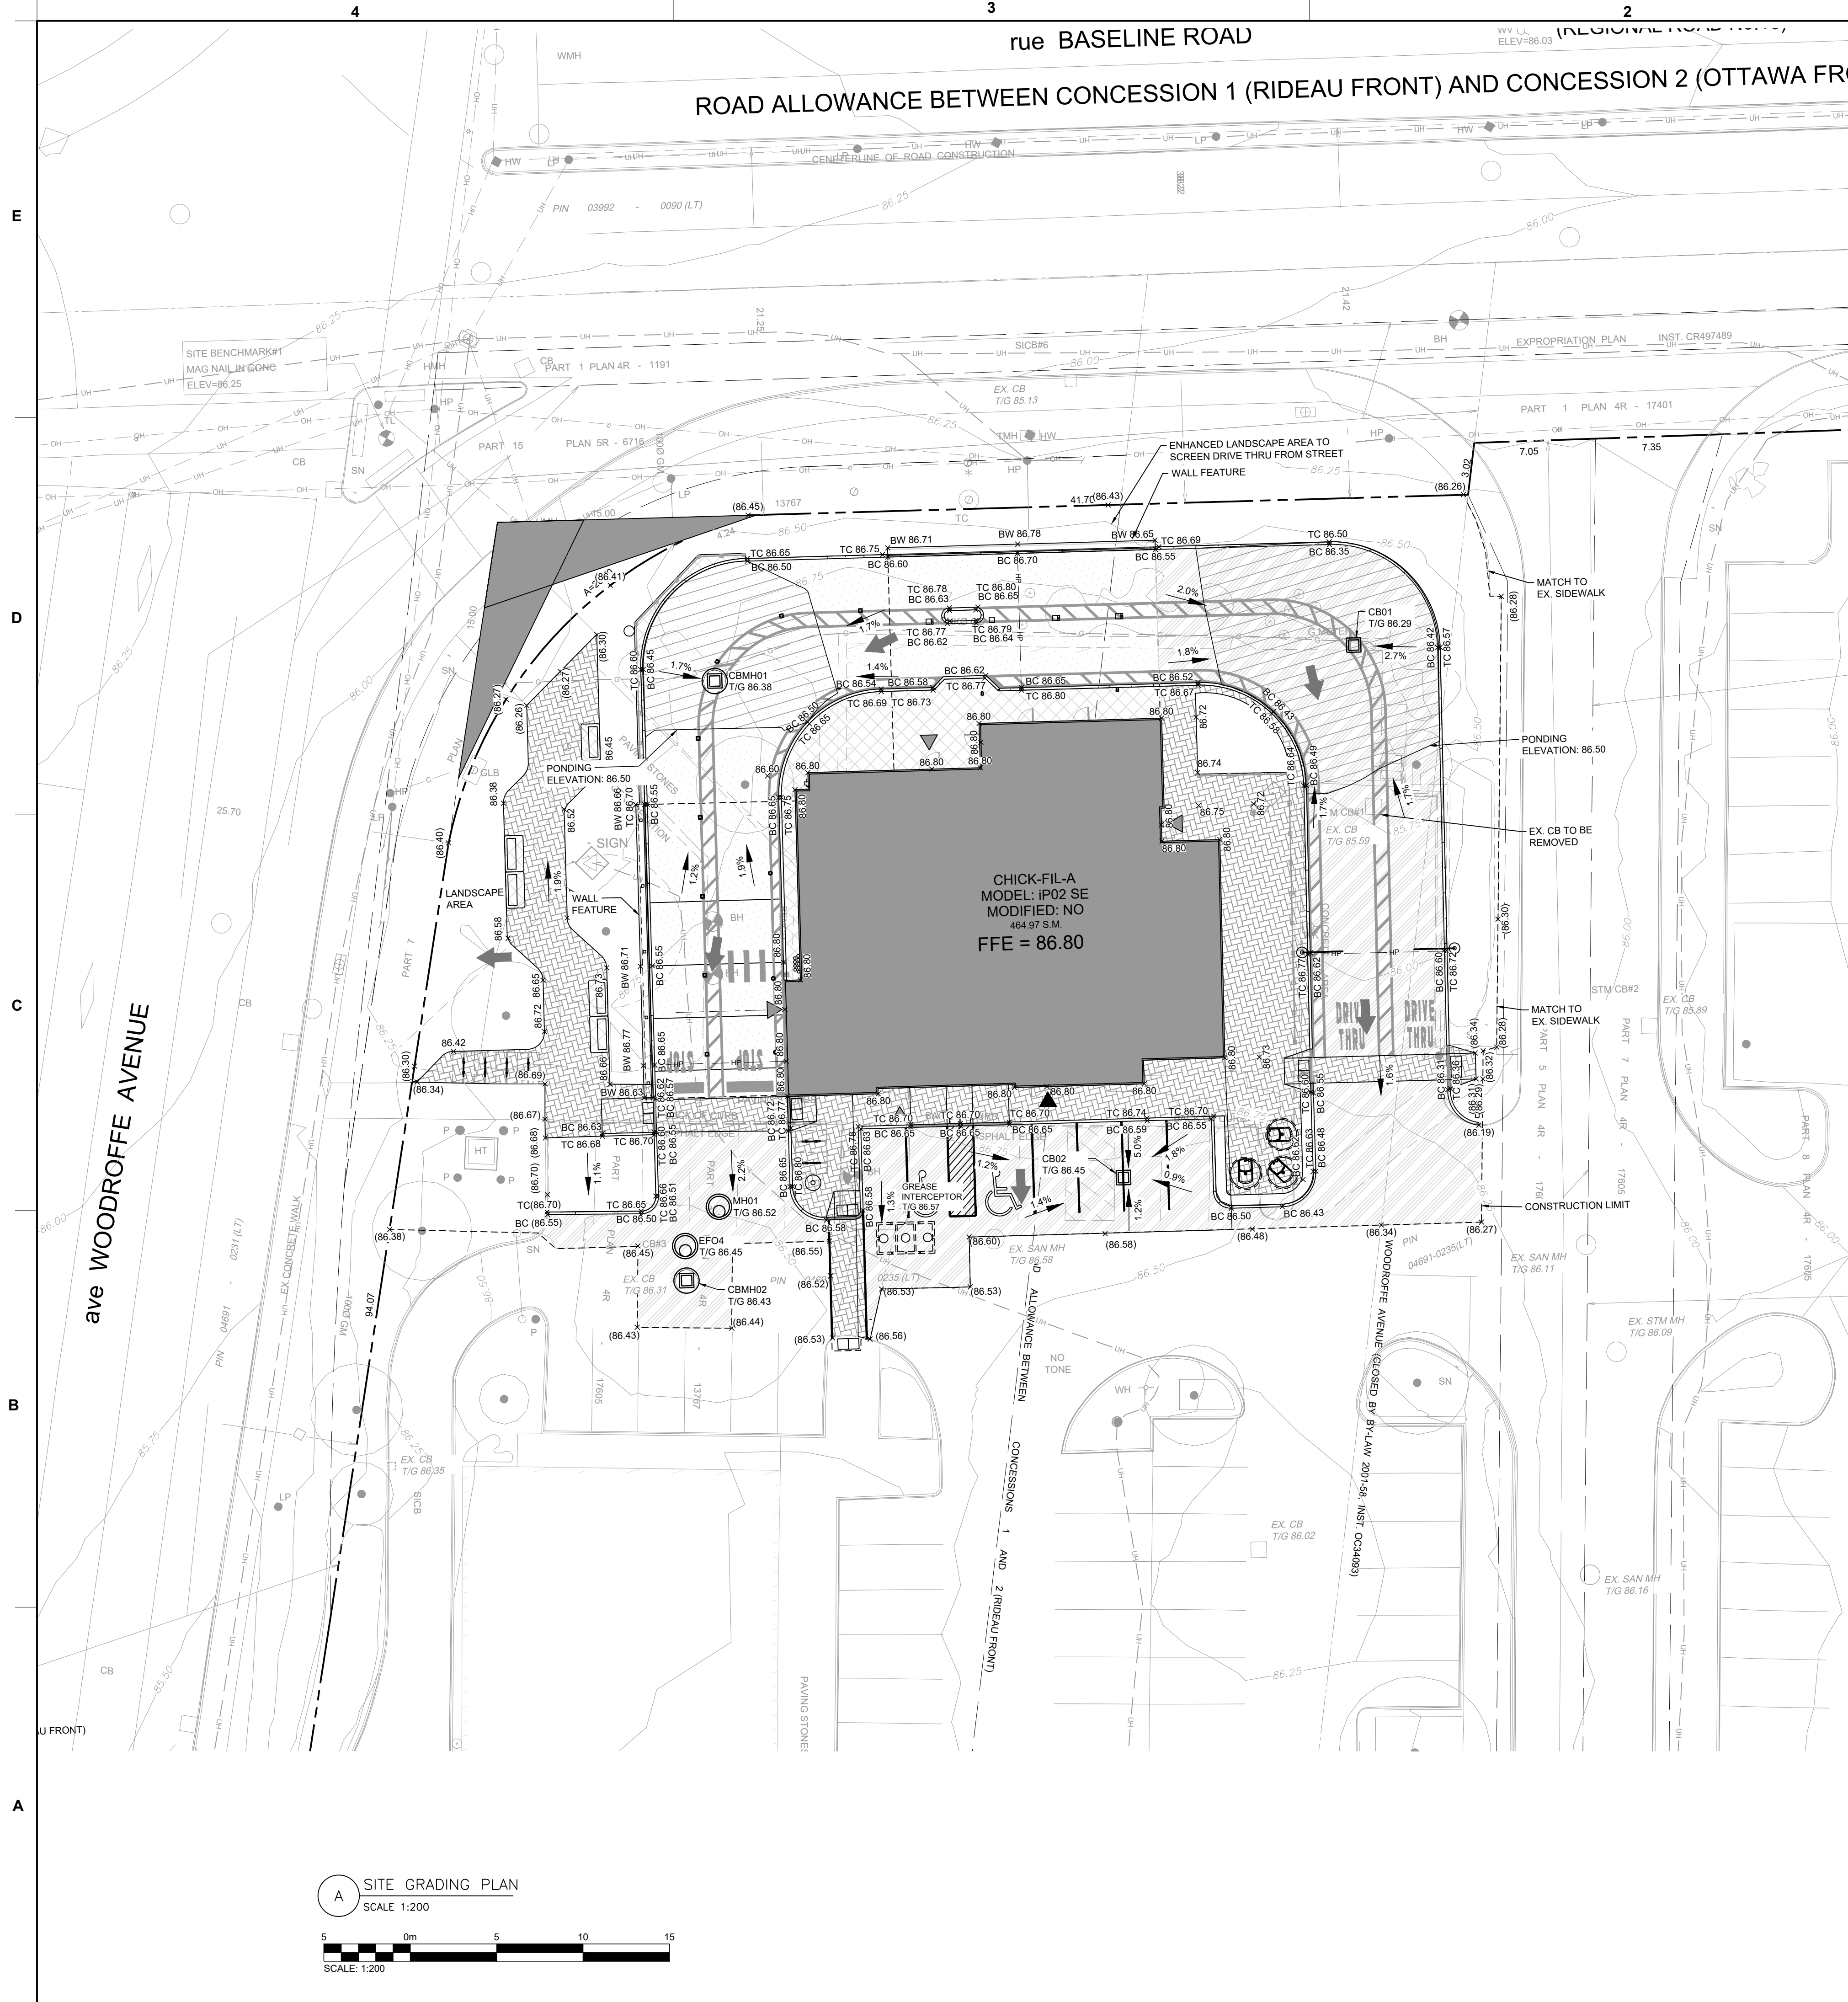

**A SITE GRADING PLAN**  
SCALE: 1:200

- GENERAL NOTES:**
1. ALL ELEVATIONS ARE IN METRES, UNLESS NOTED OTHERWISE.
  2. ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS NOTED OTHERWISE.
  3. DRAWING PRODUCED FROM J. D. BARNES LTD. DRAWING 25-10-063-00 DATED JULY 7, 2025. REFER TO SURVEY FOR BENCHMARK AND GEODETIC INFORMATION.
  4. ALL DIMENSIONS MUST BE VERIFIED BY THE GC PRIOR TO CONSTRUCTION. ANY DISCREPANCIES MUST BE BROUGHT TO THE ATTENTION OF CHICK-FIL-A'S REPRESENTATIVE.
  5. ALL WORK TO BE DONE BY THE GC UNLESS NOTED OTHERWISE.
  6. DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SPECIFICATIONS.
  7. ALL WORK IS TO BE COMPLETED AS PER PROVINCIAL AND LOCAL REGULATIONS.
  8. EVERYTHING TO BE CONSIDERED NEW UNLESS NOTED OTHERWISE.
  9. MAKE GOOD ALL AREA'S DISTURBED DURING CONSTRUCTION.
  10. GC IS RESPONSIBLE FOR ALL LOCATES BEFORE CONSTRUCTION START.

- LEGEND**
- HW EX. HANDWELL
  - BH EX. BOREHOLE
  - SN EX. SIGN
  - P EX. POST/BOLLARD
  - TC EX. TELECOMMUNICATION MANHOLE
  - CB EX. TELECOMMUNICATION CHAMBER
  - \* EX. TELECOMMUNICATION MARK
  - SHRUB EX. SHRUB
  - CONC EX. CONCRETE
  - ELEV EX. ELEVATION
  - CB EX. CATCH BASIN
  - MH EX. MANHOLE
  - SAN EX. MANHOLE
  - MH EX. MANHOLE
  - WK EX. WATER KEY
  - WH EX. WATER HYDRANT
  - EX. TREE
  - HT EX. HYDRO JUNCTION BOX
  - HM EX. HYDRO MANHOLE
  - HP EX. HYDRO POLE
  - TC EX. TELEPHONE CHAMBER
  - GLB EX. GROUND LEVEL BOX
- PROPERTY LINE**
- NEW CONCRETE CURB
  - NEW CURB DEPRESSION
  - NEW YARD LIGHT
  - NEW STORM MH
  - NEW SANITARY MH
  - NEW STORM CB
  - NEW STORM CBMH
  - MAIN ENTRANCE
  - ALTERNATE ENTRANCE
- LIGHT DUTY ASPHALT**
- 50mm - WEAR COURSE (SUPERPAVE 12.5 FC2 ASPHALTIC CONCRETE)
  - 150mm - BASE (OPSS GRANULAR A CRUSHED STONE)
  - 300mm - SUBBASE (OPSS GRANULAR B TYPE II CRUSHED STONE)
- HEAVY DUTY ASPHALT**
- 40mm - WEAR COURSE (SUPERPAVE 12.5 FC2 ASPHALTIC CONCRETE)
  - 50mm - UPPER BINDER COURSE (SUPERPAVE 19.0 ASPHALTIC CONCRETE)
  - 150mm - BASE (OPSS GRANULAR A CRUSHED STONE)
  - 400mm - SUBBASE (OPSS GRANULAR B TYPE II CRUSHED STONE)
- HEAVY DUTY CONCRETE**
- 150mm - REINFORCED CONCRETE (MINIMUM 32 MPa WITH 5 TO 8% AIR ENTRAINMENT)
  - 150mm - BASE (OPSS GRANULAR A CRUSHED STONE)
  - 450mm - SUBBASE (OPSS GRANULAR B TYPE II CRUSHED STONE)
  - 100mm - RIGID INSULATION (HIGH-DENSITY EXTRUDED POLYSTYRENE RIGID INSULATION BOARDS SUCH AS DUPONT STYROFOAM HL-40)
- LIGHT DUTY CONCRETE**
- 100mm - REINFORCED CONCRETE (MINIMUM 32 MPa WITH 5 TO 8% AIR ENTRAINMENT)
  - 150mm - BASE (OPSS GRANULAR A CRUSHED STONE)
  - 450mm - SUBBASE (OPSS GRANULAR B TYPE II CRUSHED STONE)
  - 100mm - RIGID INSULATION (HIGH-DENSITY EXTRUDED POLYSTYRENE RIGID INSULATION BOARDS SUCH AS DUPONT STYROFOAM HL-40)
- INTERLOCKING PAVING STONES**
- PONDING**
- EX. ELEVATION
  - MATCH EX. ELEVATION
  - PROP. ELEVATION
  - PROP. TOP OF CURB ELEVATION
  - PROP. BOTTOM OF CURB ELEVATION
  - PROP. SLOPE
- OVERLAND FLOW**
- EX. CONTOUR LINE
  - DEMOLITION



**Chick-fil-A**  
5200 Buffington Road  
Atlanta, Georgia 30349-2998

exp Services Inc.  
E: +1.905.793.9800 | F: +1.905.793.0641  
1595 Clark Boulevard  
Brampton, ON L6T 4V1  
Canada  
www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

# CHICK-FIL-A COLLEGE SQUARE

1984 Baseline Road  
Ottawa, ON

**FSR#30088**

BUILDING TYPE / SIZE: IP02 SE  
RELEASE:

**REVISION SCHEDULE**

NO.	DATE	DESCRIPTION
A	2025-09-17	ISSUED FOR UTILITY REVIEW
B	2025-09-23	ISSUED FOR SPA
C	2025-11-14	ISSUED FOR SPA
D	2026-05-25	AS PER CITY COMMENT

**CONSULTANT PROJECT #** BRM0023002042-W0  
**PROJECT STATUS** SPA  
**DATE** SEPTEMBER 2025  
**DRAWN BY** J.K.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.  
SHEET  
SITE GRADING PLAN

**CS100**  
FILE NUMBER D07-12-25-0159  
PLAN NUMBER 19453

Issued for SPA

4 3 2 1

WV CL ELEV=86.03 (REGIONAL ROAD 1)

rue BASELINE ROAD






ROAD ALLOWANCE BETWEEN CONCESSION 1 (RIDEAU FRONT) AND CONCESSION 2 (OTT.)

- GENERAL NOTES:**
1. ALL ELEVATIONS ARE IN METRES, UNLESS NOTED OTHERWISE.
  2. ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS NOTED OTHERWISE.
  3. DRAWING PRODUCED FROM J. D. BARNES LTD. DRAWING 25-10-063-00 DATED JULY 7, 2025. REFER TO SURVEY FOR BENCHMARK AND GEODETIC INFORMATION.
  4. ALL DIMENSIONS MUST BE VERIFIED BY THE GC PRIOR TO CONSTRUCTION. ANY DISCREPANCIES MUST BE BROUGHT TO THE ATTENTION OF CHICK-FIL-A'S REPRESENTATIVE.
  5. ALL WORK TO BE DONE BY THE GC UNLESS NOTED OTHERWISE.
  6. DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SPECIFICATIONS.
  7. ALL WORK IS TO BE COMPLETED AS PER PROVINCIAL AND LOCAL REGULATIONS.
  8. EVERYTHING TO BE CONSIDERED NEW UNLESS NOTED OTHERWISE.
  9. MAKE GOOD ALL AREAS DISTURBED DURING CONSTRUCTION.
  10. GC IS RESPONSIBLE FOR ALL LOCATES BEFORE CONSTRUCTION START.

**LEGEND**

HW	EX.	HANDWELL	---	PROPERTY LINE
BH	EX.	BOREHOLE	---	SILT FENCING
SN	EX.	SIGN	---	SILT TRAP
P	EX.	POST/BOLLARD	---	NEW CONCRETE CURB
TC	EX.	TELECOMMUNICATION MANHOLE	---	NEW CURB DEPRESSION
TC	EX.	TELECOMMUNICATION CHAMBER	---	NEW YARD LIGHT
TC	EX.	TELECOMMUNICATION MARK	---	NEW STORM MH
CONC	EX.	CONCRETE	---	NEW STORM CB
ELEV	EX.	ELEVATION	---	NEW STORM CBMH
CB	EX.	CATCH BASIN	---	MAIN ENTRANCE
MH	EX.	MANHOLE	---	ALTERNATE ENTRANCE
MANH	EX.	MANHOLE	---	LIGHT DUTY ASPHALT
HT	EX.	HYDRO JUNCTION BOX	---	HEAVY DUTY CONCRETE
HTMH	EX.	HYDRO MAN HOLE	---	LIGHT DUTY CONCRETE
HP	EX.	HYDRO POLE	---	HEAVY DUTY ASPHALT
TC	EX.	TELEPHONE CHAMBER	---	INTERLOCKING PAVING STONES
GLB	EX.	GROUND LEVEL BOX	---	PONDING

EX. ELEVATION  
 MATCH EX. ELEVATION  
 + XXX.XX  
 PROP. ELEVATION  
 + TCXXX.XX  
 PROP. TOP OF CURB ELEVATION  
 + BCXXX.XX  
 PROP. BOTTOM OF CURB ELEVATION  
 PROP. SLOPE  
 OVERLAND FLOW  
 EX. CONTOUR LINE  
 DEMOLITION

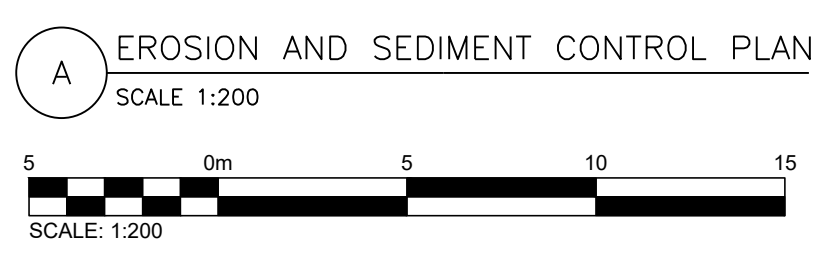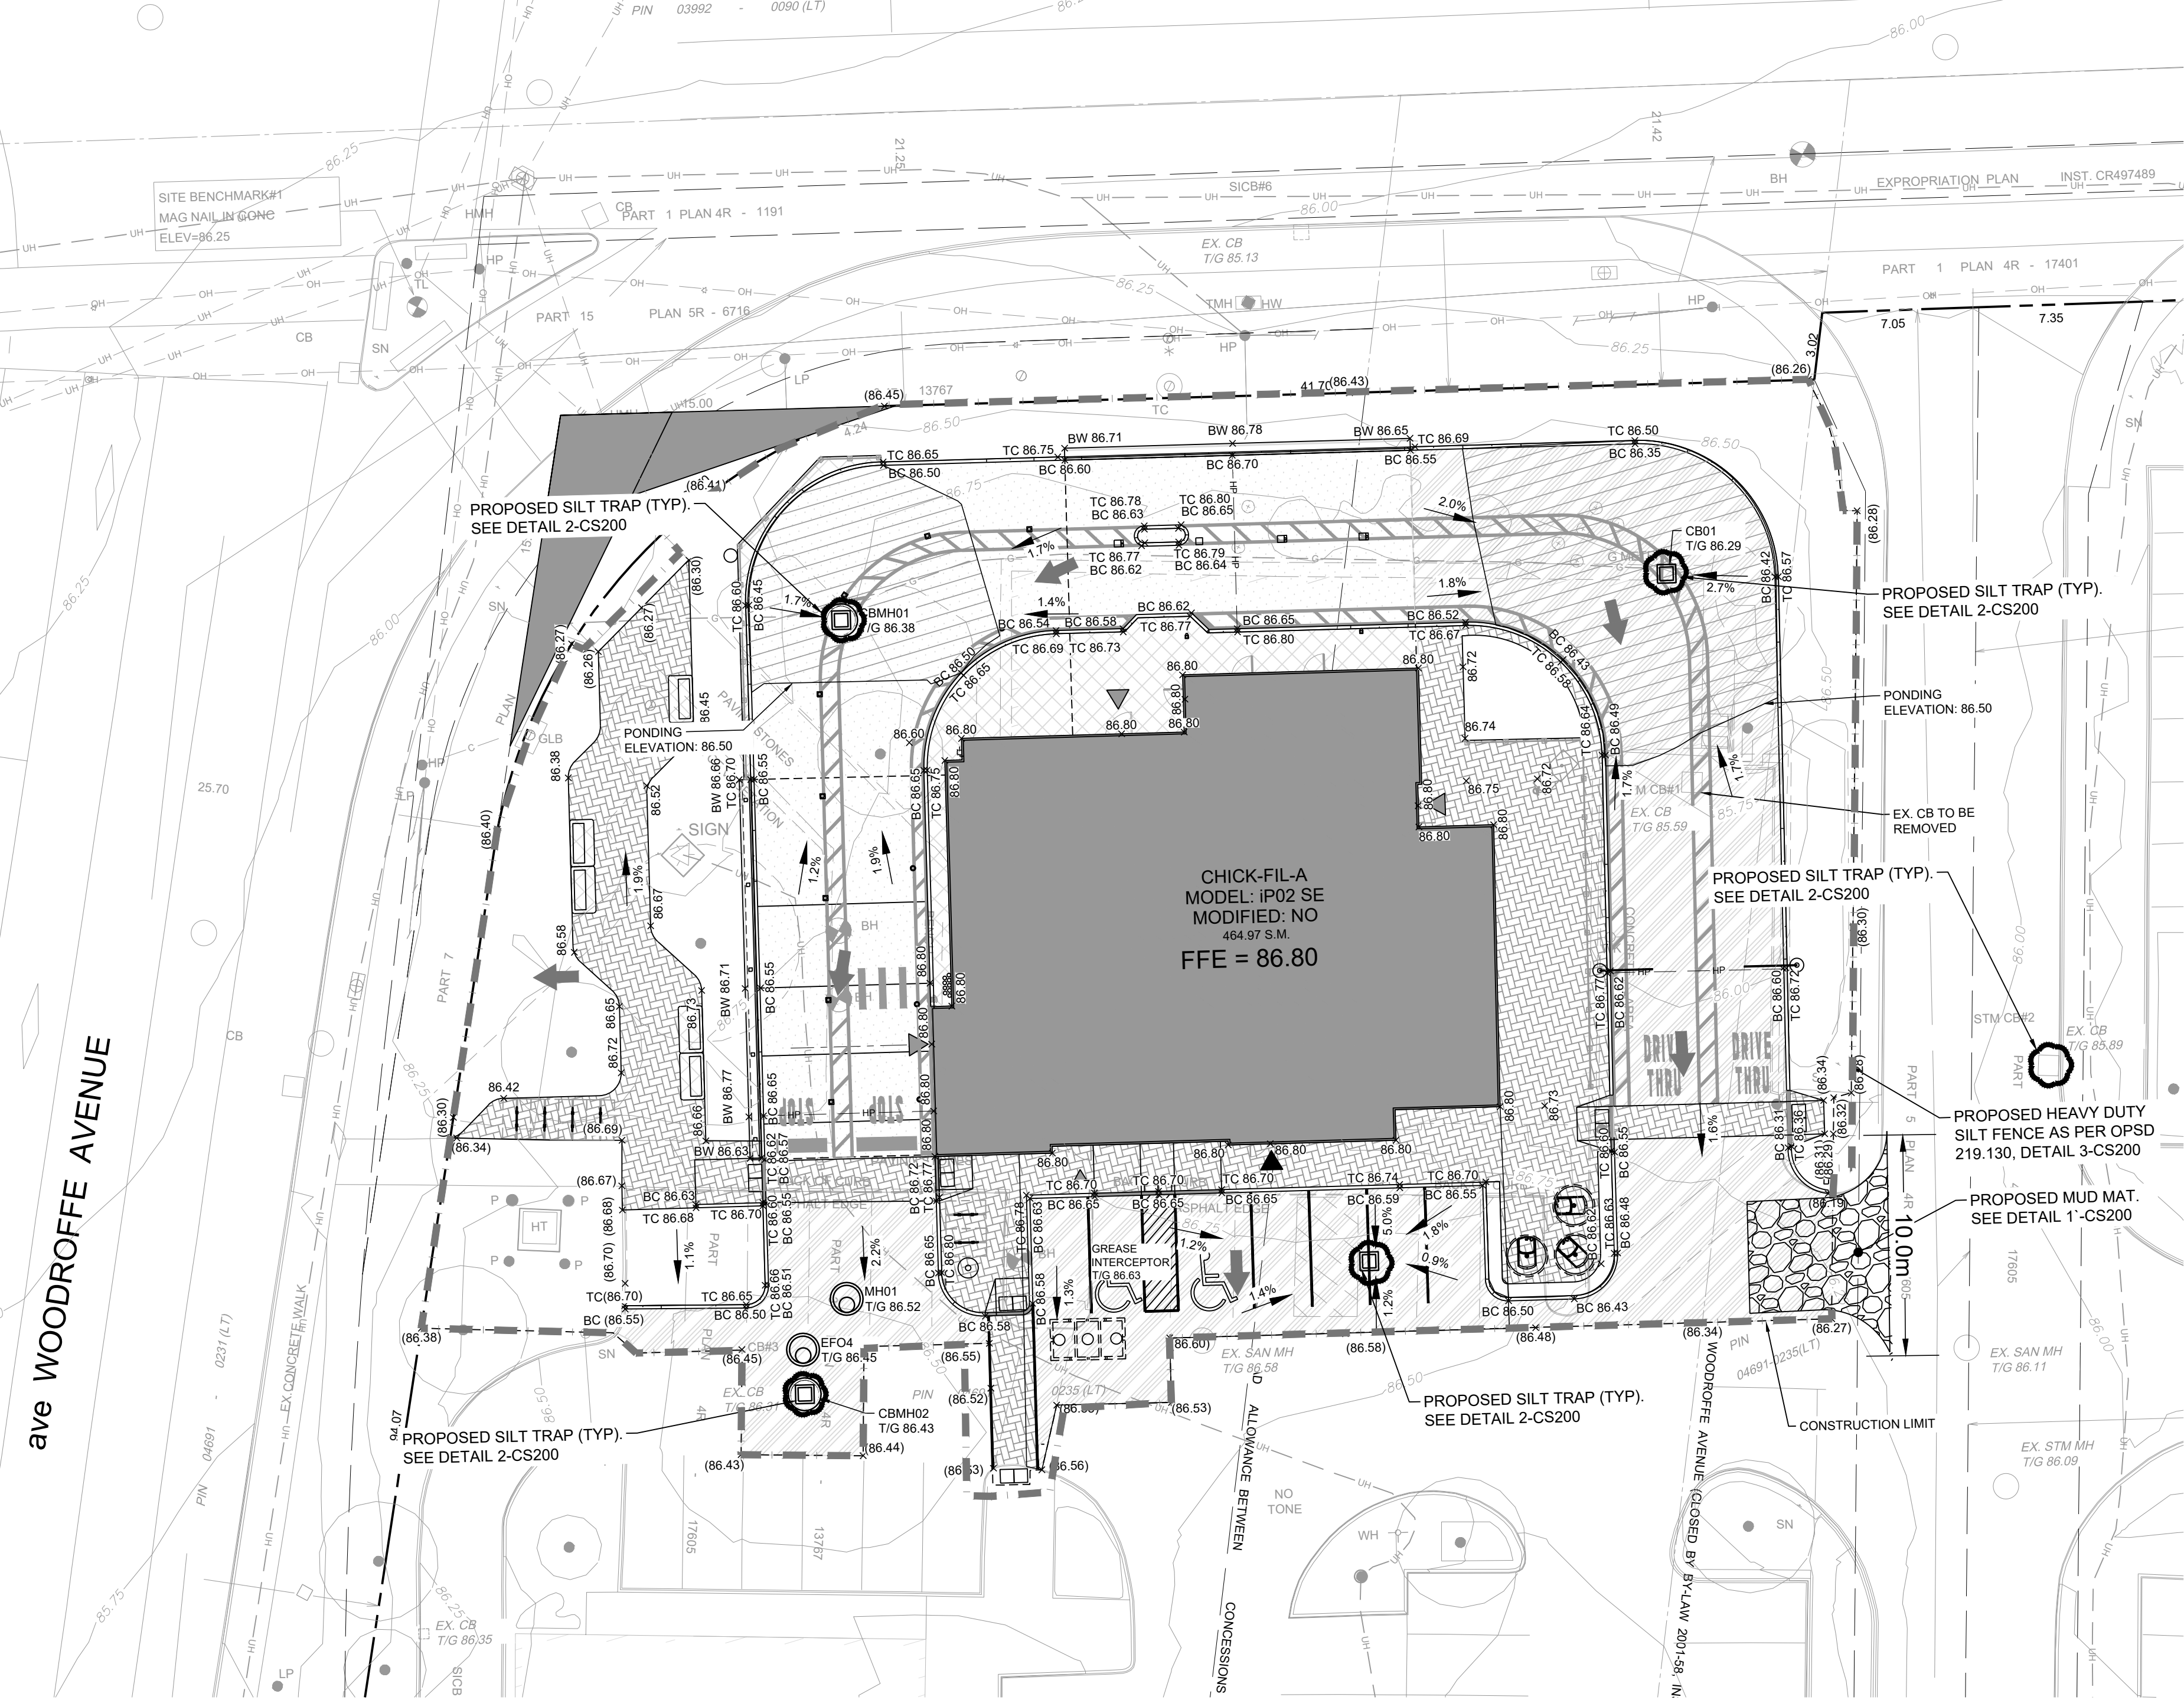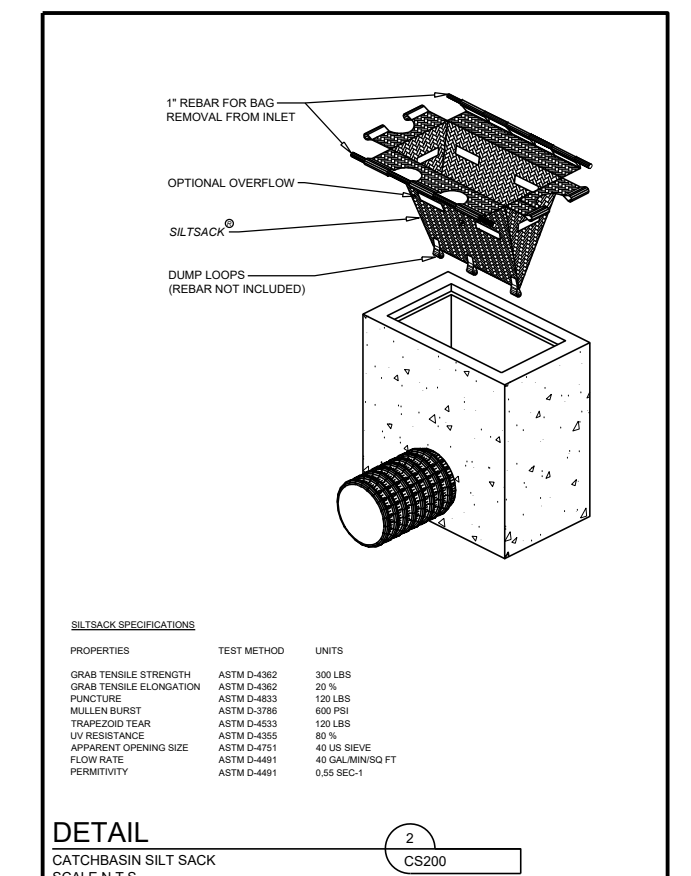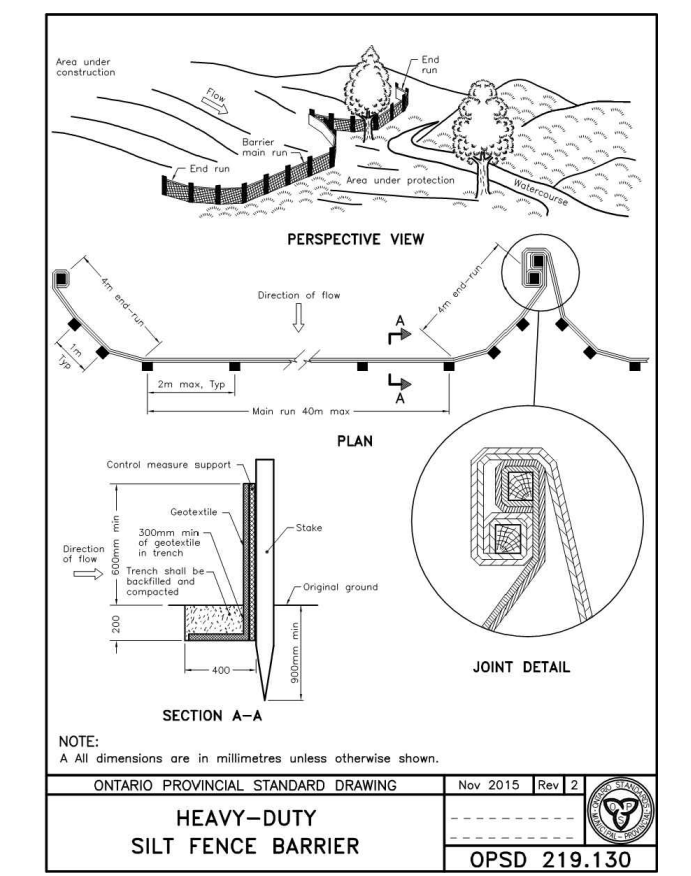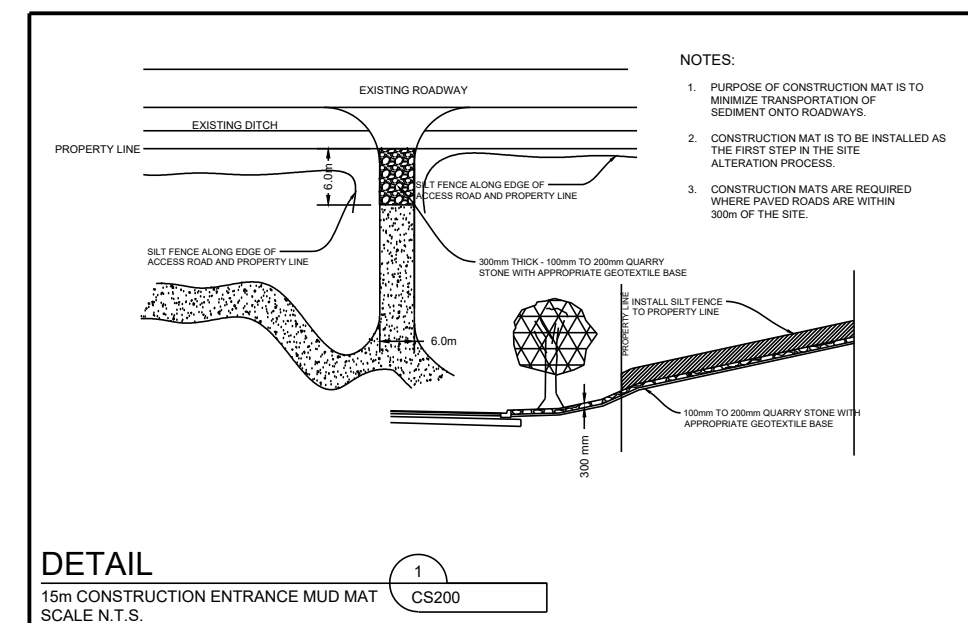

- ESC NOTES:**
1. THE CONTRACTOR SHALL ENDEAVOR TO PREVENT MUD TRACKING ONTO EXISTING RIGHTS-OF-WAY AND PROVIDE FOR CLEAN UP AT HIS OWN EXPENSE AS DIRECTED BY THE ENGINEER. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE TO CONTROL DUST IN THE PROJECT AND HE SHALL PROVIDE, AT HIS OWN EXPENSE, CONTROLLING MEASURES AS DIRECTED BY THE ENGINEER AND THE CITY.
  2. ALL EXTERNAL AREAS DISTURBED DUE TO CONSTRUCTION SHALL BE RESTORED TO THEIR ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE CITY. PRIOR TO THE COMMENCEMENT OF SITE GRADING WORKS, ALL SILT CONTROL DEVICES SHALL BE INSTALLED AND OPERATIONAL. THE EXACT LOCATION TO BE DETERMINED IN THE FIELD AND APPROVED BY THE CITY OF OTTAWA. THE CONTRACTOR SHALL MAINTAIN ALL WORKS UNTIL SERVICING CONSTRUCTION IS COMPLETED TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF OTTAWA.
  3. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE ROUTINELY INSPECTED AND MAINTAINED IN PROPER WORKING ORDER AND CLEANED PERIODICALLY AS REQUIRED BY THE COMMISSIONER OF ENGINEERING.
  4. ALL CONSTRUCTION VEHICLES SHALL EXIT THIS SITE VIA THE TEMPORARY CONSTRUCTION ACCESS.
  5. SILT CONTROL FENCE TO REMAIN IN PLACE UNTIL THE WORKING AREA HAS BEEN STABILIZED AND VEGETATED, TO THE SATISFACTION OF THE CITY OF OTTAWA.

6. CONTRACTOR TO CLEAN ADJACENT ROADS ON A REGULAR BASIS OF THE SATISFACTION OF THE AFFECTED AUTHORITY.
7. THE LOCATION AND ELEVATION OF ALL EXISTING SERVICES AND UTILITIES ARE TO BE VERIFIED IN THE FIELD BY THE CONTRACTOR AT THEIR EXPENSE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE RESTORATION AND/OR REPAIR OF EXISTING UTILITIES DISTURBED DURING CONSTRUCTION.
8. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS" - THE GENERAL CONTRACTOR SHALL BE DESIGNATED AS THE CONTRACTOR AS IN THE ACT.
9. IF ANY AREA OF THE SITE IS SCHEDULED TO REMAIN UNTOUCHED FOR THE MORE THAN 30 DAYS, IT SHOULD BE SEEDED IMMEDIATELY.
10. ALL WORKS TO BE IN ACCORDANCE WITH THE CITY OF OTTAWA.
11. THE EROSION AND SEDIMENT CONTROLS SHALL BE MODIFIED AS NECESSARY AND IN AN APPROPRIATE FASHION TO ENSURE ADEQUATE PROTECTION OF THE RECEIVING WATER COURSE AND NATURAL HERITAGE SYSTEM.
12. EROSION AND SEDIMENT CONTROLS WITHIN THE REGULATED AREA MUST BE INSTALLED, MAINTAINED AND REMOVED TO THE SATISFACTION OF CONSERVATION ALTON.
13. ALL EROSION AND SEDIMENT CONTROLS ARE TO BE INSTALLED ACCORDING TO THE APPROVED PLANS PRIOR TO COMMENCEMENT OF ANY EARTH MOVING WORK ON THE SITE AND SHALL REMAIN IN PLACE UNTIL ALL DISTURBED AREAS ARE STABILIZED WITH THE INTENDED GROUND COVER.
14. EROSION AND SEDIMENT CONTROLS SHALL BE INSPECTED BY THE BUILDER/DEVELOPER.
  - 15.1. WEEKLY
  - 15.2. BEFORE AND AFTER ANY PREDICTED RAINFALL EVENT.
  - 15.3. FOLLOWING AN UNPREDICTED RAINFALL EVENT.
  - 15.4. DAILY, DURING EXTENDED DURATION RAINFALL EVENTS.
  - 15.5. AFTER SIGNIFICANT SNOW MELT EVENTS.
15. EROSION AND SEDIMENT CONTROLS SHALL BE MAINTAINED IN PROPER WORKING ORDER AT ALL TIMES. DAMAGED OR CLOGGED DEVICES SHALL BE REPAIRED WITHIN 48 HOURS.
16. WHERE A SITE REQUIRES DEWATERING AND WHERE THE EXPELLED WATER CAN BE FREELY RELEASED TO A SUITABLE RECEIVER, THE EXPELLED WATER SHALL BE TREATED TO CAPTURE SUSPENDED PARTICLES GREATER THAN 40 MICRON IN SIZE. THE CAPTURED SEDIMENT SHALL BE DISPOSED OF PROPERLY PER MOECC GUIDELINES. THE CLEAN EXPELLED WATER SHALL FREELY RELEASE TO A SUITABLE RECEIVER THAT DOES NOT CREATE DOWNSTREAM ISSUES INCLUDING BUT NOT LIMITED TO EROSION, FLOODING - NUISANCE OR OTHERWISE.
17. INTERFERENCE ISSUES, ETC.
18. EXISTING STORM SEWER AND DRAINAGE DITCHES ADJACENT TO THE WORKS SHALL BE PROTECTED AT ALL TIMES FROM THE ENTRY OF SEDIMENT/SILT THAT MAY MIGRATE FROM THE SITE. FOR STORM SEWERS: ALL INLETS (REAR LOT CB, ROAD CB, PIPE INLETS, ETC.) MUST BE SECURED/FITTED WITH SILT CONTROL MEASURES. FOR DRAINAGE DITCHES: THE INSTALLATION OF ROCK CHECK DAMS, SILT FENCE, SEDIMENT CONTAINMENT DEVICES SHALL BE INSPECTED AND MAINTAINED PER ITEMS 15 AND 16 ABOVE.
19. IN THE EVENT OF A SPILL (RELEASE OF DELETERIOUS MATERIAL) ON OR EMANATING FROM THE SITE, THE OWNER OR OWNERS AGENT SHALL IMMEDIATELY NOTIFY THE MOECC AND FOLLOW ANY PRESCRIBED CLEAN UP PROCEDURE. THE OWNER OR OWNERS AGENT WILL ADDITIONALLY IMMEDIATELY NOTIFY THE CITY.
20. IT IS CONTRACTOR'S RESPONSIBILITY TO MAINTAIN ADJACENT AND OFF-SITE ROADS FREE OF SEDIMENT DURING CONSTRUCTION. SILT SACK TO BE USED FOR EXISTING ADJACENT CB.



**Chick-fil-A**

5200 Buffington Road  
Atlanta, Georgia 30349-2998

exp Services Inc.  
T: +1.905.793.8800 | F: +1.905.793.0641  
1595 Clark Boulevard  
Brampton, ON L6T 4V1  
Canada  
www.exp.com

- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

**CHICK-FIL-A**  
COLLEGE SQUARE

1984 Baseline Road  
Ottawa, ON

**FSR#30088**

BUILDING TYPE / SIZE: IP02 SE  
RELEASE:

**REVISION SCHEDULE**

NO.	DATE	DESCRIPTION
A	2025-09-17	ISSUED FOR UTILITY REVIEW
B	2025-09-23	ISSUED FOR SPA
C	2025-11-14	ISSUED FOR SPA
D	2026-05-25	AS PER CITY COMMENT

CONSULTANT PROJECT # BRM0023002042-WO  
PROJECT STATUS SPA  
DATE SEPTEMBER 2025  
DRAWN BY J.K.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.

SHEET  
EROSION AND SEDIMENT CONTROL PLAN  
SHEET NUMBER

**CS200**

FILE NUMBER 007-12-25-0159  
PLAN NUMBER 19453

**LEGISLATION, REGULATION AND CODES:**

- ALL WORK WITHIN THE CITY RIGHT-OF-WAY SHALL BE CONSTRUCTED ACCORDING TO THE LATEST CITY OF OTTAWA STANDARD DRAWINGS AND SPECIFICATIONS, ONTARIO PROVINCIAL STANDARD DRAWINGS AND SPECIFICATIONS MAY, SUBJECT TO THE APPROVAL OF CITY OF OTTAWA, BE USED WHERE NO CITY STANDARD OR SPECIFICATION IS AVAILABLE.
- ALL WORK SHALL BE COMPLETED ACCORDING TO THE CURRENT OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS. THE GENERAL CONTRACTOR SHALL BE DEEMED TO BE THE CONSTRUCTOR AS DEFINED IN THE ACT.
- ALL TEMPORARY TRAFFIC CONTROL AND SIGNAGE DURING CONSTRUCTION SHALL BE ACCORDING TO THE CURRENT ONTARIO TRAFFIC MANUAL BOOK 7: TEMPORARY CONDITIONS FIELD EDITION.
- ANY PERSON AUTHORIZED TO CARRY OUT WORK ON WATERMANS, SHALL COMPLY WITH THE QUALITY MANAGEMENT SYSTEM (QMS).

**CONSTRUCTION NOTES:**

- ALL AREAS DISTURBED DURING CONSTRUCTION WITHIN THE CITY'S RIGHT-OF-WAY SHALL BE RESTORED TO ORIGINAL OR BETTER CONDITION AND TO THE SATISFACTION OF THE CONTRACT ADMINISTRATOR. GRASS AREAS SHALL BE TREATED WITH 100mm OF TOPSOIL AND SHALL BE SOODED ACCORDING TO THE CITY STANDARDS.
- ALL EXISTING UTILITIES SHOWN ON DRAWINGS (PLAN AND PROFILE) ARE FOR REFERENCE PURPOSES ONLY. THE CONTRACTOR SHALL SATISFY THEMSELVES AS TO THE ACTUAL LOCATION AND DEPTH OF ANY UTILITY AND SHALL BE LIABLE FOR ALL OR ANY DAMAGE.
- ANY DISCREPANCIES BETWEEN SITE CONDITIONS AND CONSTRUCTION DRAWINGS MUST BE REPORTED TO THE ENGINEER PRIOR TO COMMENCEMENT OF CONSTRUCTION AND APPROPRIATE ACTION TAKEN TO THE SATISFACTION OF THE CONTRACT ADMINISTRATOR.
- ALL SURVEY STAKE LAYOUT POINTS SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO CONSTRUCTION. ANY DISCREPANCIES BETWEEN THE DRAWINGS AND THE LAYOUT SHALL BE IMMEDIATELY REPORTED TO THE ENGINEER.
- ATTENTION IS DIRECTED TO THE POSSIBILITY OF EXISTING PRIVATE SPRINKLERS AND LIGHTING SYSTEMS WITHIN THE RIGHT-OF-WAY, WHICH ARE NOT SHOWN ON THE PLANS. LOCATING, WORKING AROUND AND PROTECTING THESE SYSTEMS SHALL BE COMPLETED AT NO EXTRA COST TO THE REGIONAL MUNICIPALITY OF CITY.
- ALL DIMENSIONS ARE EXPRESSED IN METERS (m) AND PIPE SIZES ARE EXPRESSED IN MILLIMETERS (mm) UNLESS OTHERWISE NOTED.
- ALL MATERIAL FOR SEWER, FORCEMAIN, WATERMAIN, HYDRANTS AND APPURTENANCES, SHALL BE ACCORDING TO THE CITY OF OTTAWA STANDARDS/ GUIDELINES.
- SERVICE CONNECTIONS AND UTILITY CUTS MADE IN ROAD PAVEMENTS SHALL BE BACKFILLED WITH UNSHRINKABLE FILL.
- AT ALL LOCATIONS WHERE THE PROPOSED WATERMAIN CROSSES UNDER OR ABOVE THE EXISTING SEWERS, OR UTILITIES, GRANULAR 'A' NATIVE OR GRANULAR 'A' RCM BEDDING MATERIAL IS TO EXTEND FROM THE LOWER PIPE TO THE TOP OF THE UPPER PIPE. GRANULAR 'A' NATIVE OR GRANULAR 'A' RCM TO BE COMPACTED TO MINIMUM 98% OF MAXIMUM DRY DENSITY.
- CONTRACTOR TO PROVIDE ADEQUATE SUPPORT DURING CONSTRUCTION BETWEEN THE NEW WATERMAIN AND EXISTING GAS MAINS. MAINTAIN 300mm MINIMUM VERTICAL CLEARANCES BETWEEN THE NEW WATERMAIN AND EXISTING GAS MAINS LESS THAN 300mm IN DIAMETER. MAINTAIN 600mm MINIMUM VERTICAL CLEARANCES BETWEEN THE NEW WATERMAIN AND EXISTING GAS MAINS EQUAL TO OR GREATER THAN 300mm DIAMETER.
- ALL EXISTING WATERMANS AND SEWER PIPES LARGER THAN 300mm DIAMETER SHALL BE SUPPORTED ACCORDING TO THE CITY OF OTTAWA.

**WATERMAIN NOTES:**

- ALL WATERMAIN MATERIALS AND INSTALLATION SHALL CONFORM TO THE LATEST REVISIONS OF THE STANDARDS AND SPECIFICATIONS OF CITY OF OTTAWA, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS).
- PVC WATERMANS SHALL BE MINIMUM DR 18 CLASS 235 (AWWA) C900-07 OR MOLECULARLY ORIENTED POLYVINYL CHLORIDE (PVC) PIPES RANGING IN SIZE FROM 100mm TO 300mm DIA. PRESSURE CLASS 235 AWWA C909-09. PVC PIPES RANGING IN SIZE FROM 350mm THROUGH 600mm DIA., SHALL BE PRESSURE RATING 235, DR 18, ACCORDING TO AWWA C905-10.
- NO WORK SHALL COMMENCE UNLESS A CITY WATER WORKS INSPECTOR IS ON SITE. WATERMAIN CONNECTIONS BY CITY OF OTTAWA FORCES WITH ALL EXCAVATION BACKFILL AND ROAD REINSTATEMENT BY CONTRACTOR.
- VALVE BOXES SHALL BE INSTALLED AS PER CITY OF OTTAWA.
- ALL CURB AND VALVE BOXES TO BE LOCATED AT STREET LINE.
- ALL FIRE HYDRANTS TO BE CONSTRUCTED, INSTALLED AND LOCATED AS PER CITY OF OTTAWA STANDARDS.
- HYDRANT LEADS SHALL BE MINIMUM DR 18 CLASS 235 (AWWA) C900-07 OR PRESSURE CLASS 235 AWWA C909-09.
- EMBEDMENT MATERIAL FOR FLEXIBLE PIPE SHALL BE ACCORDING TO OPSD 802.010 AND USING GRANULAR 'A' NATIVE OR GRANULAR 'A' RCM AND COMPACTED TO MINIMUM 98% OF MAXIMUM DRY DENSITY.
- ALL WATERMANS TO BE INSTALLED AT MINIMUM COVER OF 1.8m.
- IF WATERMAIN MUST BE DEFLECTED TO MEET ALIGNMENT, ENSURE THAT THE AMOUNT OF DEFLECTION USED IS LESS THAN HALF THAT RECOMMENDED BY THE MANUFACTURER.
- DISINFECTION AND TESTING OF WATERMAIN TO BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
- WATER METERS TO BE INSTALLED AS PER CITY OF OTTAWA STANDARDS.
- THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY CAPS, PLUGS AND BLOW-OFFS AND NOZZLES REQUIRED FOR TESTING AND DISINFECTION OF THE WATERMAIN.
- INSULATION FOR WATERMAIN CROSSING OVER AND BELOW SEWER SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS, WHERE WATERMAIN COVER IS LESS THAN 1.7m.
- WHERE THE SEPARATION BETWEEN SERVICES AND MANHOLES IS LESS THAN 2.5m, WATER SERVICES ARE TO BE INSULATED AS PER CITY OF OTTAWA STARDS.
- WATERMANS MUST FOLLOW THE ONTARIO MINISTRY OF THE ENVIRONMENT PROCEDURE F-6-1 THAT GOVERNS THE SEPARATION OF SEWERS AND WATERMANS. A MINIMUM VERTICAL CLEARANCE OF 0.30m WHEN CROSSING OVER AND 0.50m WHEN CROSSING UNDER SEWERS AND ALL OTHER UTILITIES IS REQUIRED. WATERMANS MUST ALSO MAINTAIN 2.5m HORIZONTAL SEPARATION WITH SEWERS. ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER.
- MECHANICAL THRUST RESTRAINTS SHALL BE INSTALLED AT ALL FITTINGS, BENDS, TEES, CROSSES, REDUCERS, VALVES, CAPS AND PLUGS FOR ALL WATERMAIN SIZES. MECHANICAL RESTRAINTS AT JOINTS SHALL BE INSTALLED AT EVERY PIPE JOINT WITHIN 6.1m OF EITHER SIDE OF ALL FITTINGS FOR WATERMANS 100mm DIA. OR LARGER.
- CITY IN-SERVICE WATER VALVES, CURB STOPS, FIRE HYDRANTS CAN ONLY BE OPERATED BY CITY STAFF OR REPRESENTATIVES.
- ALL NEW WATERMANS SHALL BE INSULATED WHERE THE COVER IS LESS THAN 1.65m.

**WATERMAIN - FILL AREAS:**

- PIPES ARE NOT TO BE LAID ON FILL UNTIL THE FIELD DENSITY TEST REPORTS HAVE BEEN SUBMITTED AND APPROVED BY THE ENGINEER.
- FILL TO BE PLACES TO A MINIMUM OF 600mm ABOVE THE WATERMAIN GRADES AND 3m MINIMUM ON EACH SIDE PRIOR TO WATERMAIN LAYING COMPACTED TO A MINIMUM OF 100% OF MAXIMUM DRY DENSITY IN 300mm LIFTS.
- SOIL DENSITY TESTS SHALL BE TAKEN ALONG CENTERLINE OF THE WATERMAIN AND ON LINES 1.5m ON EITHER SIDE OF SAME AT A MAXIMUM INTERVAL OF 30m. TESTS TO BE TAKEN AT EACH 600mm LIFT.
- ALL HYDRANTS, TEES, VALVES, BENDS, PLUGS AND EACH PIPE JOINT ARE TO BE MECHANICALLY RESTRAINED.
- PIPE JOINT DEFLECTIONS ARE NOT ALLOWED.

**EROSION AND SEDIMENT CONTROL:**

- EROSION AND SEDIMENT CONTROL (ESC) MEASURES WILL BE IMPLEMENTED PRIOR TO, AND MAINTAINED DURING CONSTRUCTION PHASES, TO PREVENT ENTRY OF SEDIMENT INTO THE WATER. ALL DAMAGED EROSION AND SEDIMENT CONTROL MEASURES SHOULD BE REPAIRED OR REPLACED, OR BOTH, WITHIN 48 HOURS OF INSPECTION.
- ALL DISTURBED AREAS WILL BE MINIMIZED TO THE EXTENT POSSIBLE, AND TEMPORARILY OR PERMANENTLY STABILIZED OR RESTORED AS THE WORK PROGRESSES.
- THE EROSION AND SEDIMENT CONTROL STRATEGIES OUTLINED ON THE PLANS ARE NOT STATIC AND MAY NEED TO BE UPGRADED/AMENDED AS SITE CONDITIONS CHANGE TO MINIMIZE SEDIMENT LOADS RUNOFF FROM LEAVING THE WORK AREA. IF THE PRESCRIBED MEASURES ON THE PLANS ARE NOT EFFECTIVE IN PREVENTING RELEASE OF A DELETERIOUS SUBSTANCE, THEN ALTERNATIVE MEASURES MUST BE IMPLEMENTED IMMEDIATELY TO MINIMIZE POTENTIAL ECOLOGICAL IMPACTS AND A TORONTO REGION CONSERVATION AUTHORITY ENFORCEMENT OFFICE SHOULD BE IMMEDIATELY CONTACTED. ADDITIONAL ESC MEASURES TO BE KEPT ON SITE AND USED AS NECESSARY.
- ALL ACTIVITIES, INCLUDING MAINTENANCE PROCEDURES, WILL BE CONTROLLED TO PREVENT THE ENTRY OF PETROLEUM PRODUCTS, DEBRIS, RUBBLE, CONCRETE OR OTHER DELETERIOUS SUBSTANCES INTO THE WATER. VEHICULAR REFUELING AND MAINTENANCE WILL BE CONDUCTED A MINIMUM OF 30m FROM THE WATER.

- ALL GRADES WITHIN THE REGULATORY FLOOD PLAN WILL BE MAINTAINED OR MATCHED.

**SANITARY SERVICE NOTES:**

- ALL SANITARY SEWER MATERIALS AND INSTALLATION SHALL CONFORM TO THE LATEST REVISIONS OF THE STANDARDS AND SPECIFICATIONS OF THE CITY OF OTTAWA, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS).
- ALL SANITARY SEWERS SHALL BE PVC DR 28, INSTALLED AT 2%, UNLESS OTHERWISE NOTED.
- SANITARY SERVICE CONNECTIONS SHALL BE SINGLE, 150mm DIA. MINIMUM, PVC DR 28 INSTALLED AT 2%.
- SANITARY MAINTENANCE HOLES SHALL HAVE WATERTIGHT FRAMES AND COVERS IN PONDING AREAS ACCORDING TO OPSD 401.030.

**STORM SERVICE NOTES:**

- ALL STORM SEWER MATERIALS AND INSTALLATION SHALL CONFORM TO THE LATEST REVISIONS OF THE STANDARDS AND SPECIFICATIONS OF THE CITY OF OTTAWA, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS).
- ALL REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.2 (LATEST AMENDMENT), ALL NON-REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.1 (LATEST AMENDMENT), PIPE SHALL BE JOINTED WITH STD. RUBBER GASKETS AS PER CSA A257.3 (LATEST AMENDMENT).
- EMBEDMENT MATERIAL FOR FLEXIBLE PIPE SHALL BE ACCORDING TO OPSD 802.010 AND USING GRANULAR 'A' NATIVE OR GRANULAR 'A' RCM BEDDING MATERIAL AND COMPACTED TO MINIMUM 98% OF MAXIMUM DRY DENSITY.
- BEDDING FOR RIGID PIPE SHALL BE CLASS 'B' BEDDING MATERIAL ACCORDING TO OPSD 802.031 AND USING GRANULAR 'A' NATIVE OR GRANULAR 'A' RCM BEDDING MATERIAL ACCORDING TO TS 1010 AND COMPACTED TO MINIMUM 98% OF MAXIMUM DRY DENSITY.
- MINIMUM SOIL COVER TO BE 1.9m TO PROTECT SEWERS FROM FROST DAMAGE. IN AREAS WHERE ADEQUATE FROST COVER CANNOT BE ACHIEVED, EQUIVALENT THERMAL INSULATION TO BE INSTALLED AS PER DETAIL 1 CS300.
- STORM MANHOLE FRAME AND COVERS SHALL BE AS PER OPSD 701.010(1200mmØ) AND CBS SHALL BE AS PER OPSD 705.010.
- SAFETY PLATFORMS SHALL BE IN ACCORDANCE WITH OPSD 404.02.
- CONTRACTOR SHALL ENSURE THAT CATCHBASINS ARE INSTALLED AT THE LOW POINT OF SAG CURB WORKS.
- THE STORM SEWER CLASSES HAVE BEEN DESIGNED BASED ON BEDDING CONDITIONS SPECIFIED. WHERE THE SPECIFIED TRENCH WIDTH IS EXCEEDED, THE CONTRACTOR SHALL BE REQUIRED TO PROVIDE ADDITIONAL BEDDING, A DIFFERENT TYPE OF BEDDING OR A HIGHER PIPE STRENGTH AT HIS OWN EXPENSE AND SHALL ALSO BE RESPONSIBLE FOR EXTRA TEMPORARY AND/OR PERMANENT REPAIRS MADE NECESSARY BY THE WIDENED TRENCH.
- THE CONTRACTOR SHALL CONDUCT CCTV INSPECTION OF ALL NEWLY INSTALLED STORM SEWERS AND EXISTING SEWERS CONNECTED TO. THE TEST SHALL BE PERFORMED IMMEDIATELY AFTER SEWERS INSTALLED.
- SINGLE CATCHBASINS SHALL BE ACCORDING TO 705.010 COMPLETE WITH GOSS TRAP, WHERE SPECIFIED. FRAME AND COVER SHALL BE ACCORDING TO OPSD 400.070.
- CATCHBASIN LEADS TO BE 250mm PVC DR 35 FOR SINGLE CATCHBASINS AND 300mm PVC DR 35 FOR DOUBLE CATCHBASINS. THEY ARE TO BE AT A 1.0% SLOPE (MIN) UNLESS OTHERWISE NOTED.
- CONNECTION DETAIL FOR SEWER PIPE AT CATCHBASINS AND MAINTENANCE HOLES SHALL BE ACCORDING TO OPSD 708.020.



**GENERAL NOTES:**

- ALL WORKS AND MATERIALS SHALL CONFORM TO THE LATEST REVISIONS OF THE STANDARDS AND SPECIFICATIONS OF CITY OF OTTAWA, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS), WHERE APPLICABLE.
- THE LOCATION OF UTILITIES IS APPROXIMATE ONLY, AND THE EXACT LOCATION SHOULD BE DETERMINED BY CONSULTING THE MUNICIPAL AUTHORITIES AND UTILITY COMPANIES CONCERNED. THE CONTRACTOR IS RESPONSIBLE TO PROVIDE THE LOCATION AND STATUS OF UTILITIES AND SHALL BE RESPONSIBLE FOR ADEQUATE PROTECTION OF PLANT AND EQUIPMENT FROM DAMAGE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
- THE CONTRACTOR SHALL VERIFY THE LOCATION AND ELEVATION OF EXISTING SERVICES PRIOR TO ANY CONSTRUCTION. THE CONTRACTOR SHALL CONFIRM LOCATIONS AND ELEVATIONS OF EXISTING SERVICES AND STRUCTURES TO BE CONNECTED TO AND EXISTING SERVICES THAT MAY BE DAMAGED OR CAUSE CONFLICTS PRIOR TO CONSTRUCTION OF ANY NEW SEWER, WATER AND/OR STORM WATER WORKS. ALL DIMENSIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES, INTERPRETATIONS, CHANGES AND ADDITIONS TO THESE DRAWINGS MUST BE BROUGHT TO THE ATTENTION OF THE ENGINEER, WHEN NOTED AND BEFORE PROCEEDING WITH CONSTRUCTION WORKS. DO NOT CONTINUE CONSTRUCTION IN AREAS WHERE DISCREPANCIES APPEAR UNTIL SUCH DISCREPANCIES HAVE BEEN RESOLVED.
- ALL ELEVATIONS ARE GEODETIC AND UTILIZE METRIC UNITS. ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE SPECIFIED. ALL DRAWINGS SHOULD NOT BE SCALED BY THE CONTRACTOR. ANY MISSING OR QUESTIONABLE DIMENSIONS ARE TO BE CONFIRMED WITH THE ENGINEER IN WRITING.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS REQUIRED AND BEAR COST OF THE SAME.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL EXCAVATION, BACKFILL AND REINSTATEMENT OF ALL AREAS DISTURBED DURING CONSTRUCTION TO THE SATISFACTION OF THE ENGINEER, CITY OF OTTAWA AND THE AUTHORITY HAVING JURISDICTION.
- ANY AREAS BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTOR'S EXPENSE.
- THE CONTRACTOR SHALL COMPLY WITH CITY OF OTTAWA REQUIREMENTS FOR TRAFFIC CONTROL WHEN WORKING ON CITY STREETS. ALL CONSTRUCTION SIGNAGE MUST CONFORM TO THE M.T.O. MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (LATEST AMENDMENT).
- THE SUPPORT OF ALL UTILITIES SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
- THERE WILL BE NO SUBSTITUTION OF MATERIALS UNLESS WRITTEN APPROVAL BY THE ENGINEER HAS BEEN OBTAINED.
- EXCESS EXCAVATED MATERIAL SHALL BE REMOVED FROM THE SITE AS PER OPSS MUNI.180.
- THE SITE LAYOUT IS THE RESPONSIBILITY OF THE CONTRACTOR. AS-BUILT SITE SERVICING & GRADING DRAWINGS SHALL BE MAINTAINED ON SITE BY THE CONTRACTOR.
- THE CONTRACTOR WILL BE RESPONSIBLE FOR ADDITIONAL BEDDING OR ADDITIONAL STRENGTH PIPE IF THE MAXIMUM TRENCH WIDTH, AS SPECIFIED BY OPSD, IS EXCEEDED.
- ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH ENGINEER AND THE CITY OF OTTAWA PRIOR TO ANY TREE CUTTING.
- ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW CUT TO FORM A NEAT AND STRAIGHT LINE PRIOR TO PLACING NEW PAVEMENT. THE GRANULAR BASE COURSES AND ASPHALT LAYERS SHALL BE STEPPED AS PER DETAIL ON THIS DRAWING.
- THE CONTRACTOR SHALL APPRAISE THEMSELVES OF ALL SURFACE AND SUBSURFACE CONDITIONS TO BE ENCOUNTERED AND SHALL CARRY OUT THEIR OWN TEST PIT'S AS REQUIRED TO MAKE THEIR OWN INDEPENDENT ASSESSMENT OF GROUND CONDITIONS. THE CONTRACTOR SHALL NOT MAKE ANY CLAIM FOR ANY EXTRA COST DUE TO ANY SUCH GROUND CONDITIONS VARYING FROM THOSE ANTICIPATED BY THE CONTRACTOR.
- DO NOT CONSTRUCT USING DRAWINGS THAT ARE NOT MARKED "ISSUED FOR CONSTRUCTION".
- CIVIL DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL, LANDSCAPE AND LEGAL DRAWINGS.
- ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO ANY TREE CUTTING.
- ALL WORK TO BE DONE BY THE GENERAL CONTRACTOR UNLESS NOTED OTHERWISE.


**GENERAL NOTES FOR GRADING:**

- IT SHALL BE THE BUILDER'S RESPONSIBILITY TO ENSURE THAT GRADING AROUND HYDRANTS, TRANSFORMERS, AND UTILITY PEDESTALS, ETC., MEET CURRENT CITY OF OTTAWA, HYDRO AND UTILITY COMPANY REQUIREMENTS.
- ALL GROUND SURFACES SHALL BE EVENLY GRADED WITHOUT PONDING AREAS AND WITHOUT LOW POINTS EXCEPT WHERE APPROVED SWALE OR CATCH BASIN OUTLETS ARE PROVIDED.
- CONTRACTOR TO ADJUST EXISTING CATCH BASINS, MANHOLES, FIRE HYDRANTS, VALVE CHAMBERS AND VALVE BOXES TO FINAL GRADE AS REQUIRED.

- CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO PROTECT EXISTING FOUNDATIONS OF ADJACENT BUILDINGS DURING EXCAVATION AND CONSTRUCTION PERIOD.
- GRADING IN GRASSED AREAS WILL BE BETWEEN 2% TO 7%. GRADES IN EXCESS OF 7% WILL REQUIRE A MAXIMUM 3:1 TERRACING.

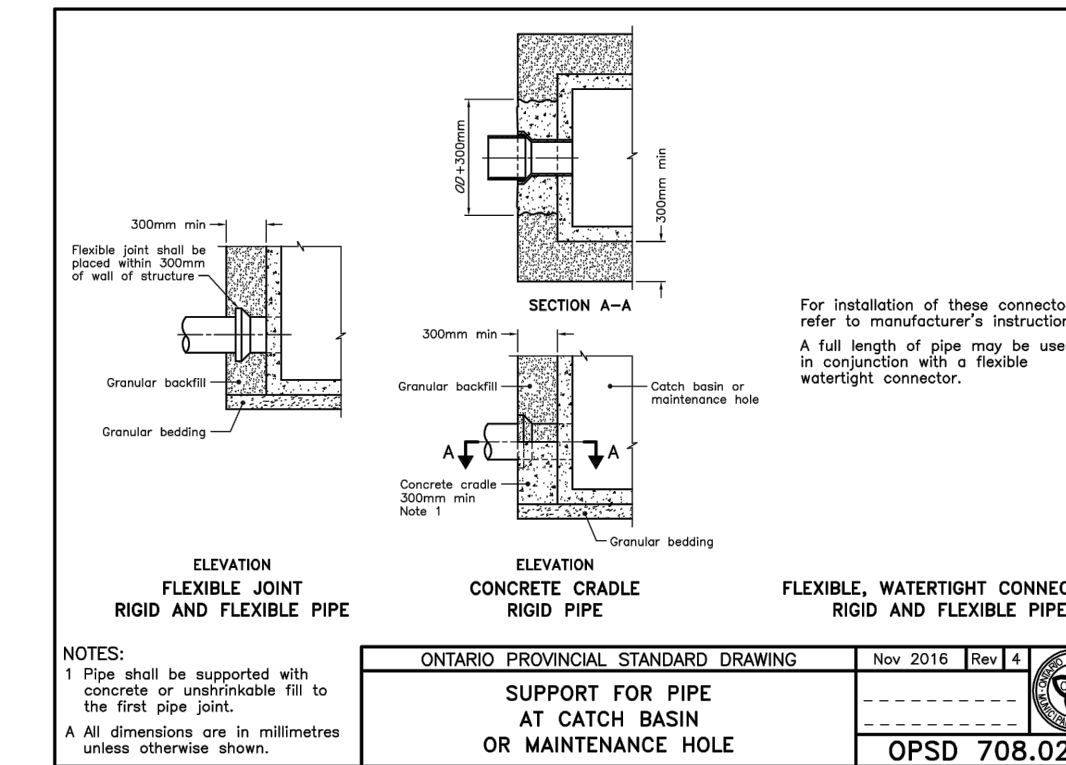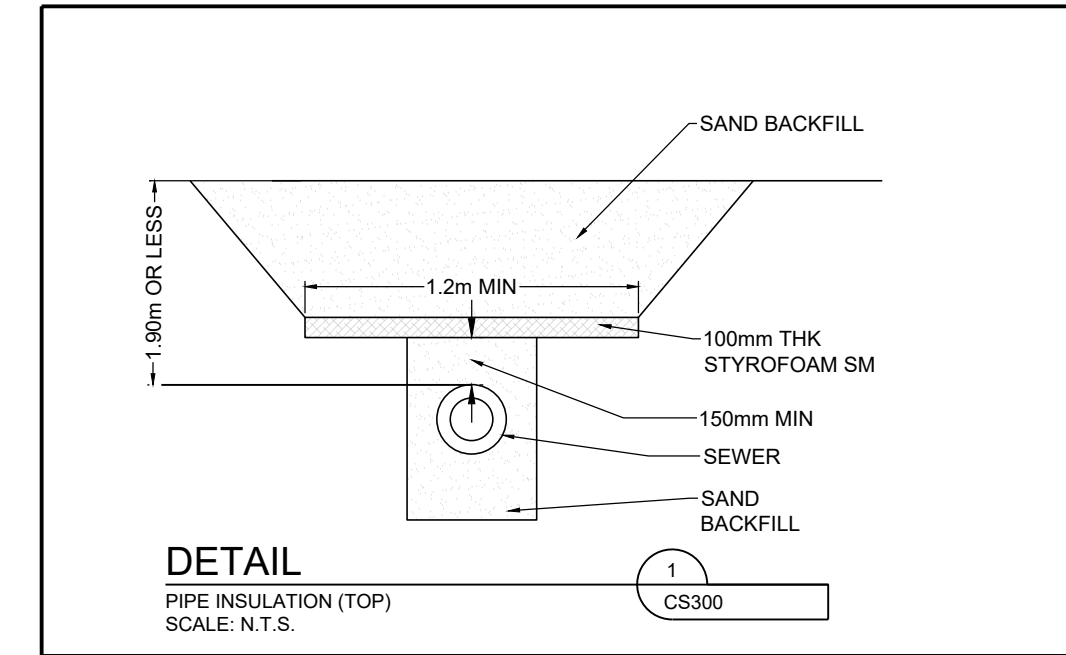

E:\BRM\BRM-23002042-W0160 Execution\65 Drawings\01-30096-CS300-RC.dwg 12 May 2026

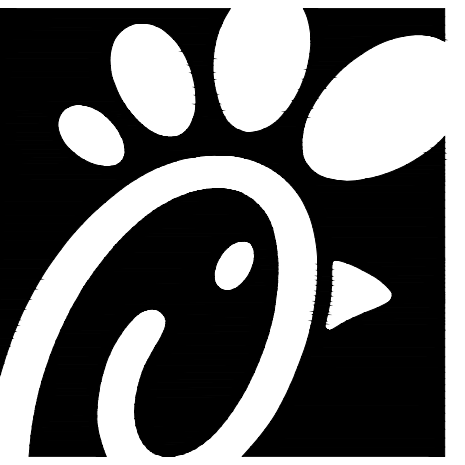

**Chick-fil-A**

**Chick-fil-A**  
5200 Buffington Road  
Atlanta, Georgia 30349-2998

exp Services Inc.  
T: +1.905.793.9800 | F: +1.905.793.0641  
1595 Clark Boulevard  
Brampton, ON L6T 4V1  
Canada

www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

**CHICK-FIL-A**  
COLLEGE SQUARE

1984 Baseline Road  
Ottawa, ON

**FSR#30088**

BUILDING TYPE / SIZE: IP02 SE  
RELEASE:

REVISION SCHEDULE		
NO.	DATE	DESCRIPTION
A	2025-09-17	ISSUED FOR UTILITY REVIEW
B	2025-09-23	ISSUED FOR SPA
C	2025-11-14	ISSUED FOR SPA
D	2026-05-25	AS PER CITY COMMENT

CONSULTANT PROJECT # BRM0023002042-W0  
PROJECT STATUS SPA  
DATE SEPTEMBER 2025  
DRAWN BY J.K.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.  
SHEET  
NOTES & DETAIL

SHEET NUMBER  
**CS300**  
FILE NUMBER D07-12-25-0159  
PLAN NUMBER 19453

Issued for SPA



**Chick-fil-A**  
 5200 Buffington Road  
 Atlanta, Georgia 30349-2998

exp Services Inc.  
 E: +1.905.793.9800 | F: +1.905.793.0641  
 1595 Clark Boulevard  
 Brampton, ON L6T 4V1  
 Canada  
 www.exp.com



• BUILDINGS • EARTH & ENVIRONMENT • ENERGY •  
 • INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

# CHICK-FIL-A COLLEGE SQUARE

1984 Baseline Road  
 Ottawa, ON

**FSR#30088**

BUILDING TYPE / SIZE: IP02 SE  
 RELEASE:

REVISION SCHEDULE		
NO.	DATE	DESCRIPTION
A	2025-09-17	ISSUED FOR UTILITY REVIEW
B	2025-09-23	ISSUED FOR SPA
C	2025-11-14	ISSUED FOR SPA
D	2026-05-25	AS PER CITY COMMENT


CONSULTANT PROJECT # BRM0023002042-WO  
 PROJECT STATUS SPA  
 DATE SEPTEMBER 2025  
 DRAWN BY J.K.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.

SHEET  
 SITE SERVICING PLAN

SHEET NUMBER  
**PS100**

FILE NUMBER D07-12-25-0159  
 PLAN NUMBER 19453

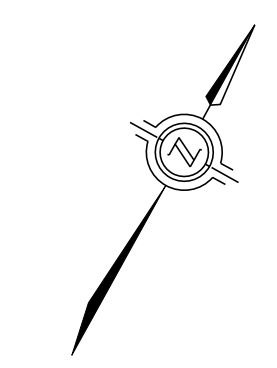


**GENERAL NOTES:**


- ALL ELEVATIONS ARE IN METRES, UNLESS NOTED OTHERWISE.
- ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS NOTED OTHERWISE.
- DRAWING PRODUCED FROM J. D. BARNES LTD. DRAWING 25-10-063-00 DATED JULY 7, 2025. REFER TO SURVEY FOR BENCHMARK AND GEODETIC INFORMATION.
- ALL DIMENSIONS MUST BE VERIFIED BY THE GC PRIOR TO CONSTRUCTION. ANY DISCREPANCIES MUST BE BROUGHT TO THE ATTENTION OF CHICK-FIL-A'S REPRESENTATIVE.
- ALL WORK TO BE DONE BY THE GC UNLESS NOTED OTHERWISE.
- DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SPECIFICATIONS.
- ALL WORK IS TO BE COMPLETED AS PER PROVINCIAL AND LOCAL REGULATIONS.
- EVERYTHING TO BE CONSIDERED NEW UNLESS NOTED OTHERWISE.
- MAKE GOOD ALL AREAS DISTURBED DURING CONSTRUCTION.
- GC IS RESPONSIBLE FOR ALL LOCATES BEFORE CONSTRUCTION START.
- CONTRACTOR TO PERFORM POST-CONSTRUCTION CCTV INVESTIGATION OF STORM AND SANITARY PIPES.
- CONTRACTOR TO PERFORM A CONDITION ASSESSMENT OF THE EXISTING RECEIVING SEWERS INCLUDING CCTV INVESTIGATION. ANY CONCERN SHALL BE NOTIFIED IMMEDIATELY TO CONSULTANT.
- THE EXISTING STORM, SANITARY, AND WATER SERVICES MUST BE IN A GREAT CONDITION IF THE SERVICES ARE REUSED.

**LEGEND**



- HW EX. HANDWELL
- BH EX. BOREHOLE
- SN EX. SIGN
- P EX. POST/BOLLARD
- EX. TELECOMMUNICATION MANHOLE
- EX. TELECOMMUNICATION CHAMBER
- \* EX. TELECOMMUNICATION MARK
- STM EX. SHRUB
- CONC EX. CONCRETE
- ELEV EX. ELEVATION
- CB EX. CATCH BASIN
- MH EX. MANHOLE
- SAN EX. MANHOLE
- MH EX. MANHOLE
- WK EX. WATER KEY
- WH EX. WATER HYDRANT
- EX. TREE
- HT EX. HYDRO JUNCTION BOX
- HMH EX. HYDRO MAN HOLE
- HP EX. HYDRO POLE
- TC EX. TELEPHONE CHAMBER
- GLB EX. GROUND LEVEL BOX
- PROPERTY LINE
- EX. CONC. CURB
- FO EX. UNDERGROUND FIBRE OPTICS
- ST EX. STORM SEWER
- S EX. SANITARY SEWER
- W EX. WATER MAINS
- G EX. NATURAL GAS
- OH EX. OVERHEAD HYDRO
- UH EX. UNDERGROUND HYDRO
- UH EX. UNDERGROUND CABLE
- UH EX. UNDERGROUND TELEPHONE
- NEW CONCRETE CURB
- NEW CURB DEPRESSION
- NEW YARD LIGHT
- NEW STORM MH
- NEW SANITARY MH
- NEW STORM CB
- NEW STORM CBMH
- MAIN ENTRANCE
- ALTERNATE ENTRANCE
- ST NEW STORM SEWER
- S NEW SANITARY SEWER
- W NEW WATER SERVICE
- G NEW GAS SERVICE
- UH NEW HYDRO SERVICE
- UB NEW BELL SERVICE
- /// REMOVAL
- PIPE INSULATION TYP.

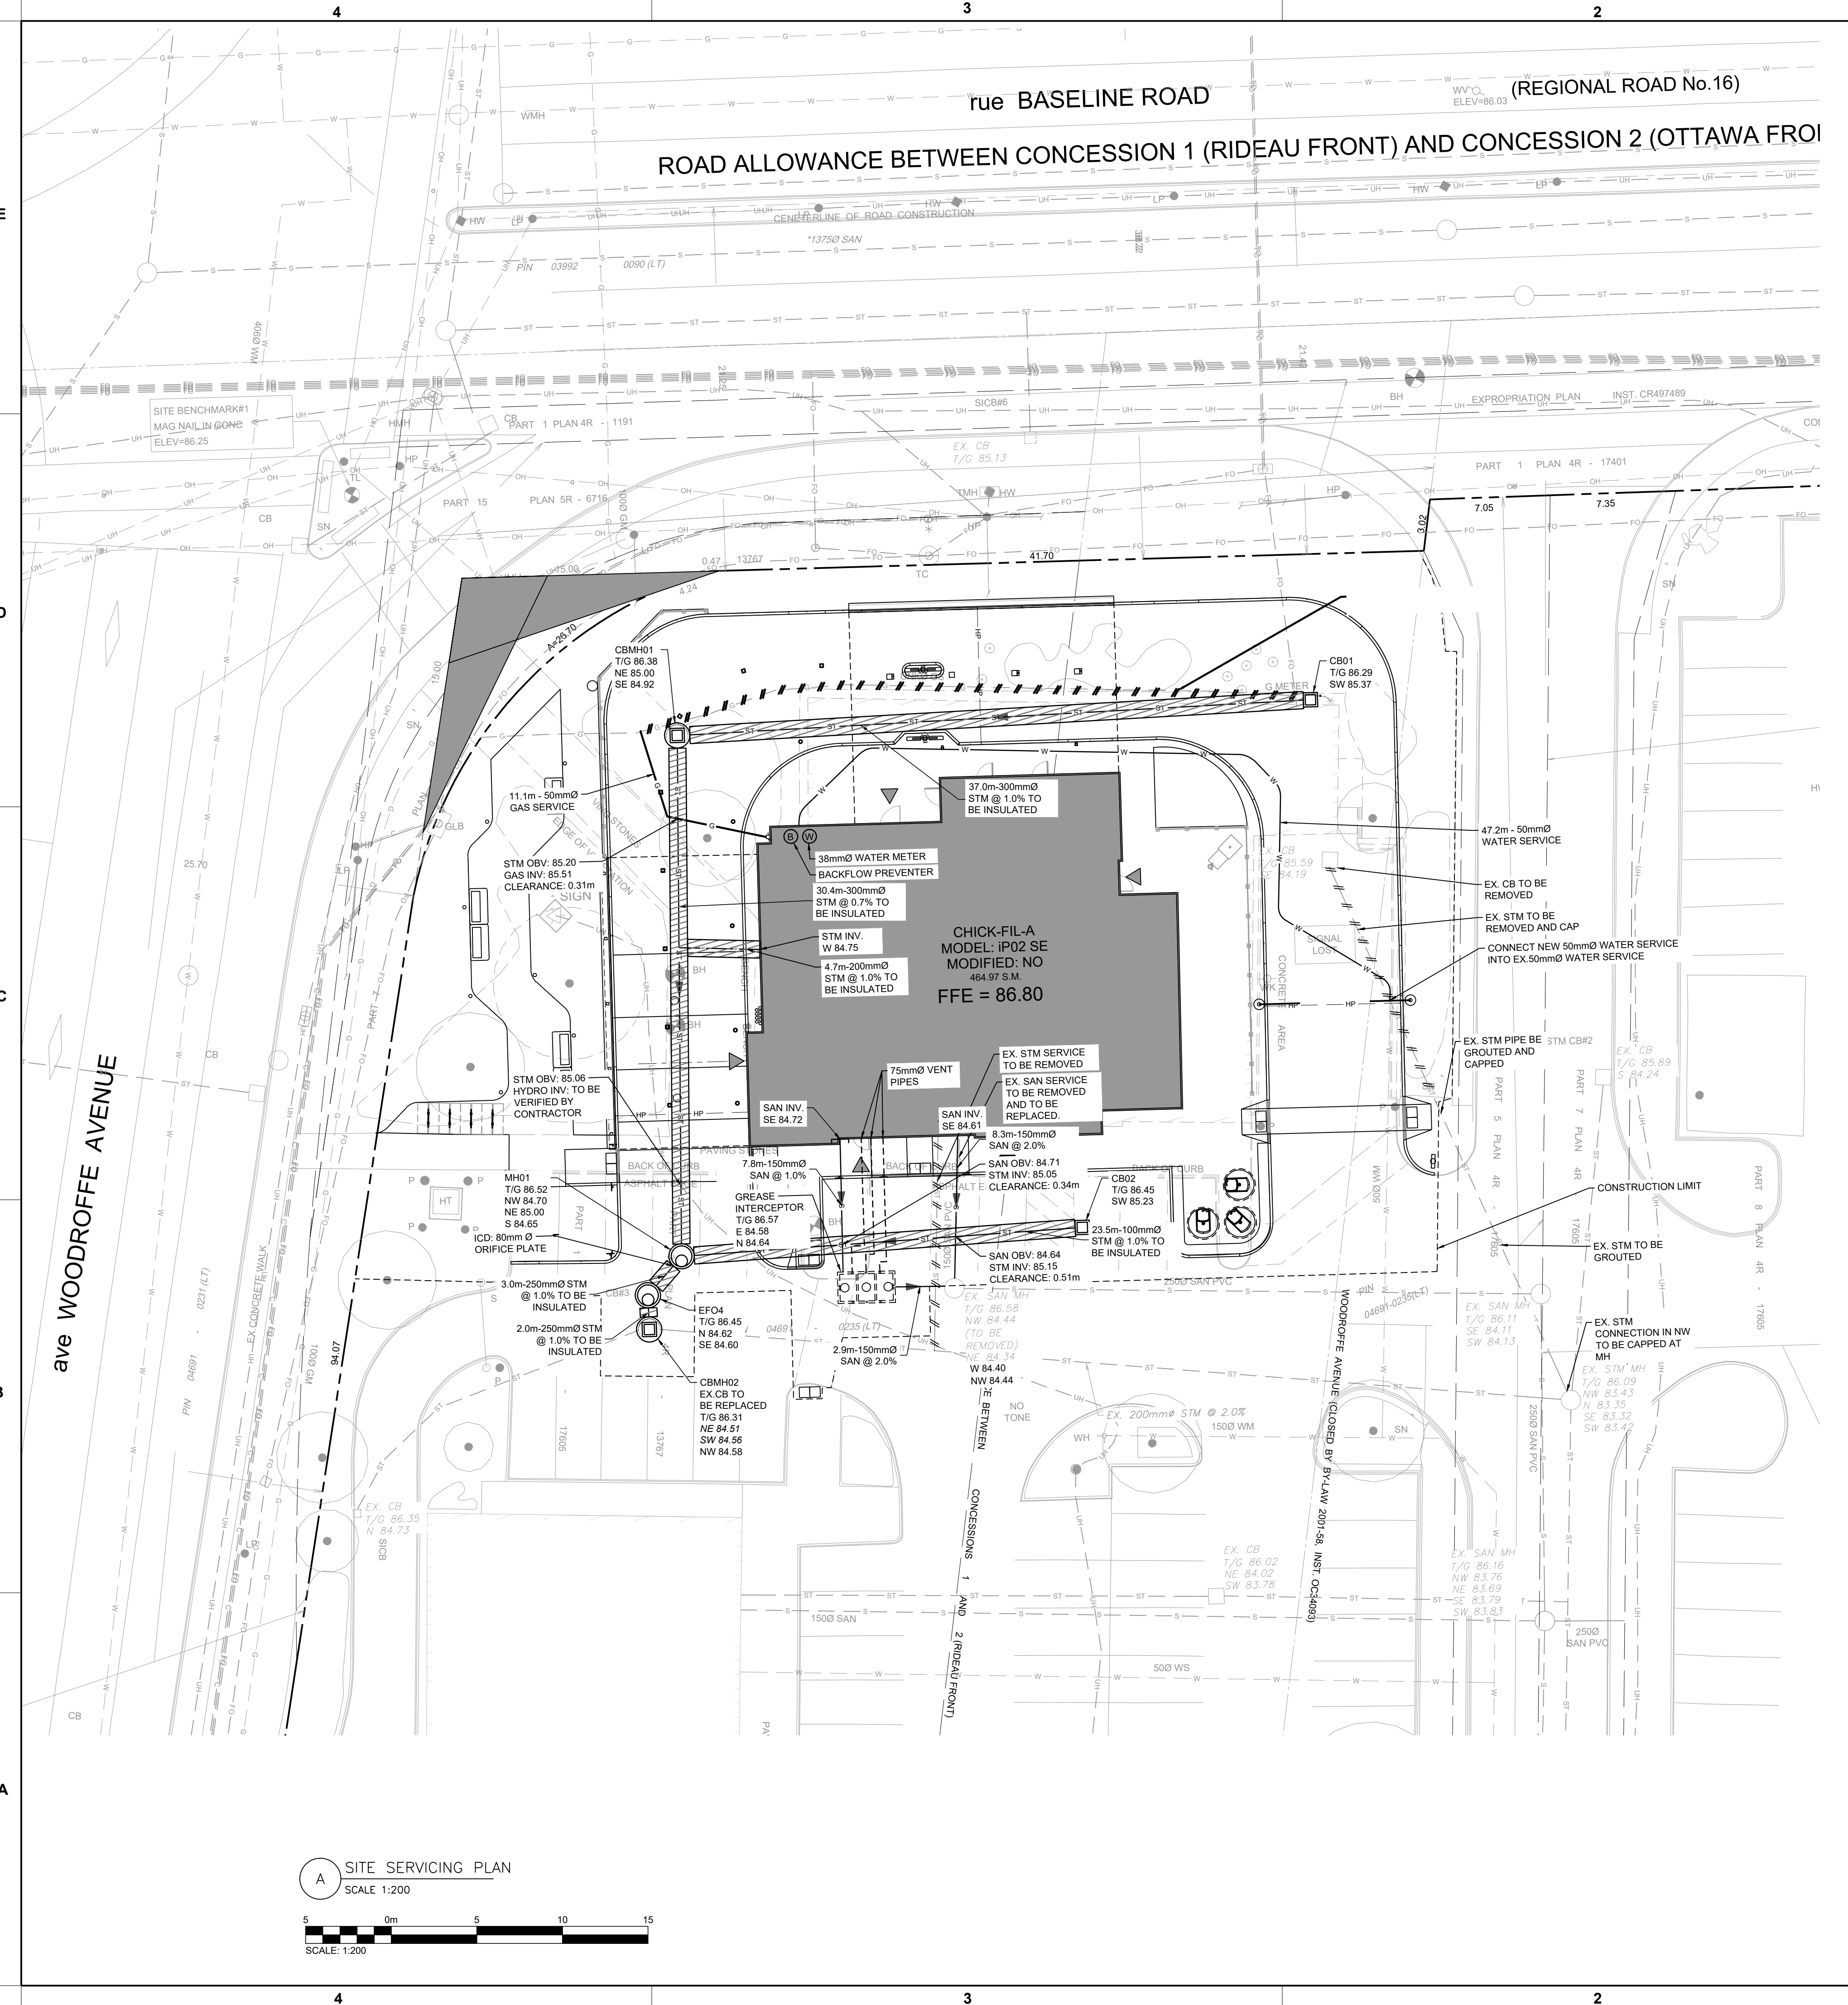

**A SITE SERVICING PLAN**  
 SCALE: 1:200

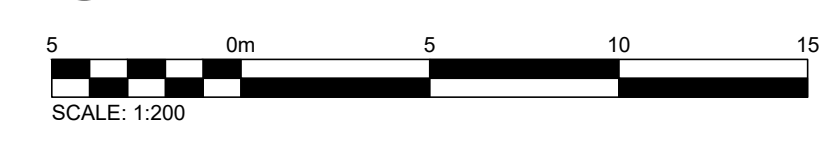


E:\BRM\BRM-23002042-WO\60 Execution\65 Drawings\01-30096-PS100-RC.dwg  
 22 May 2026

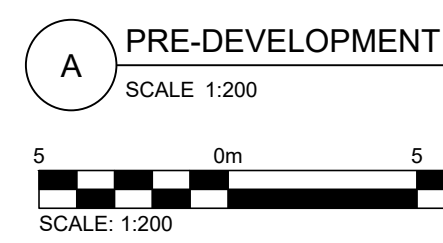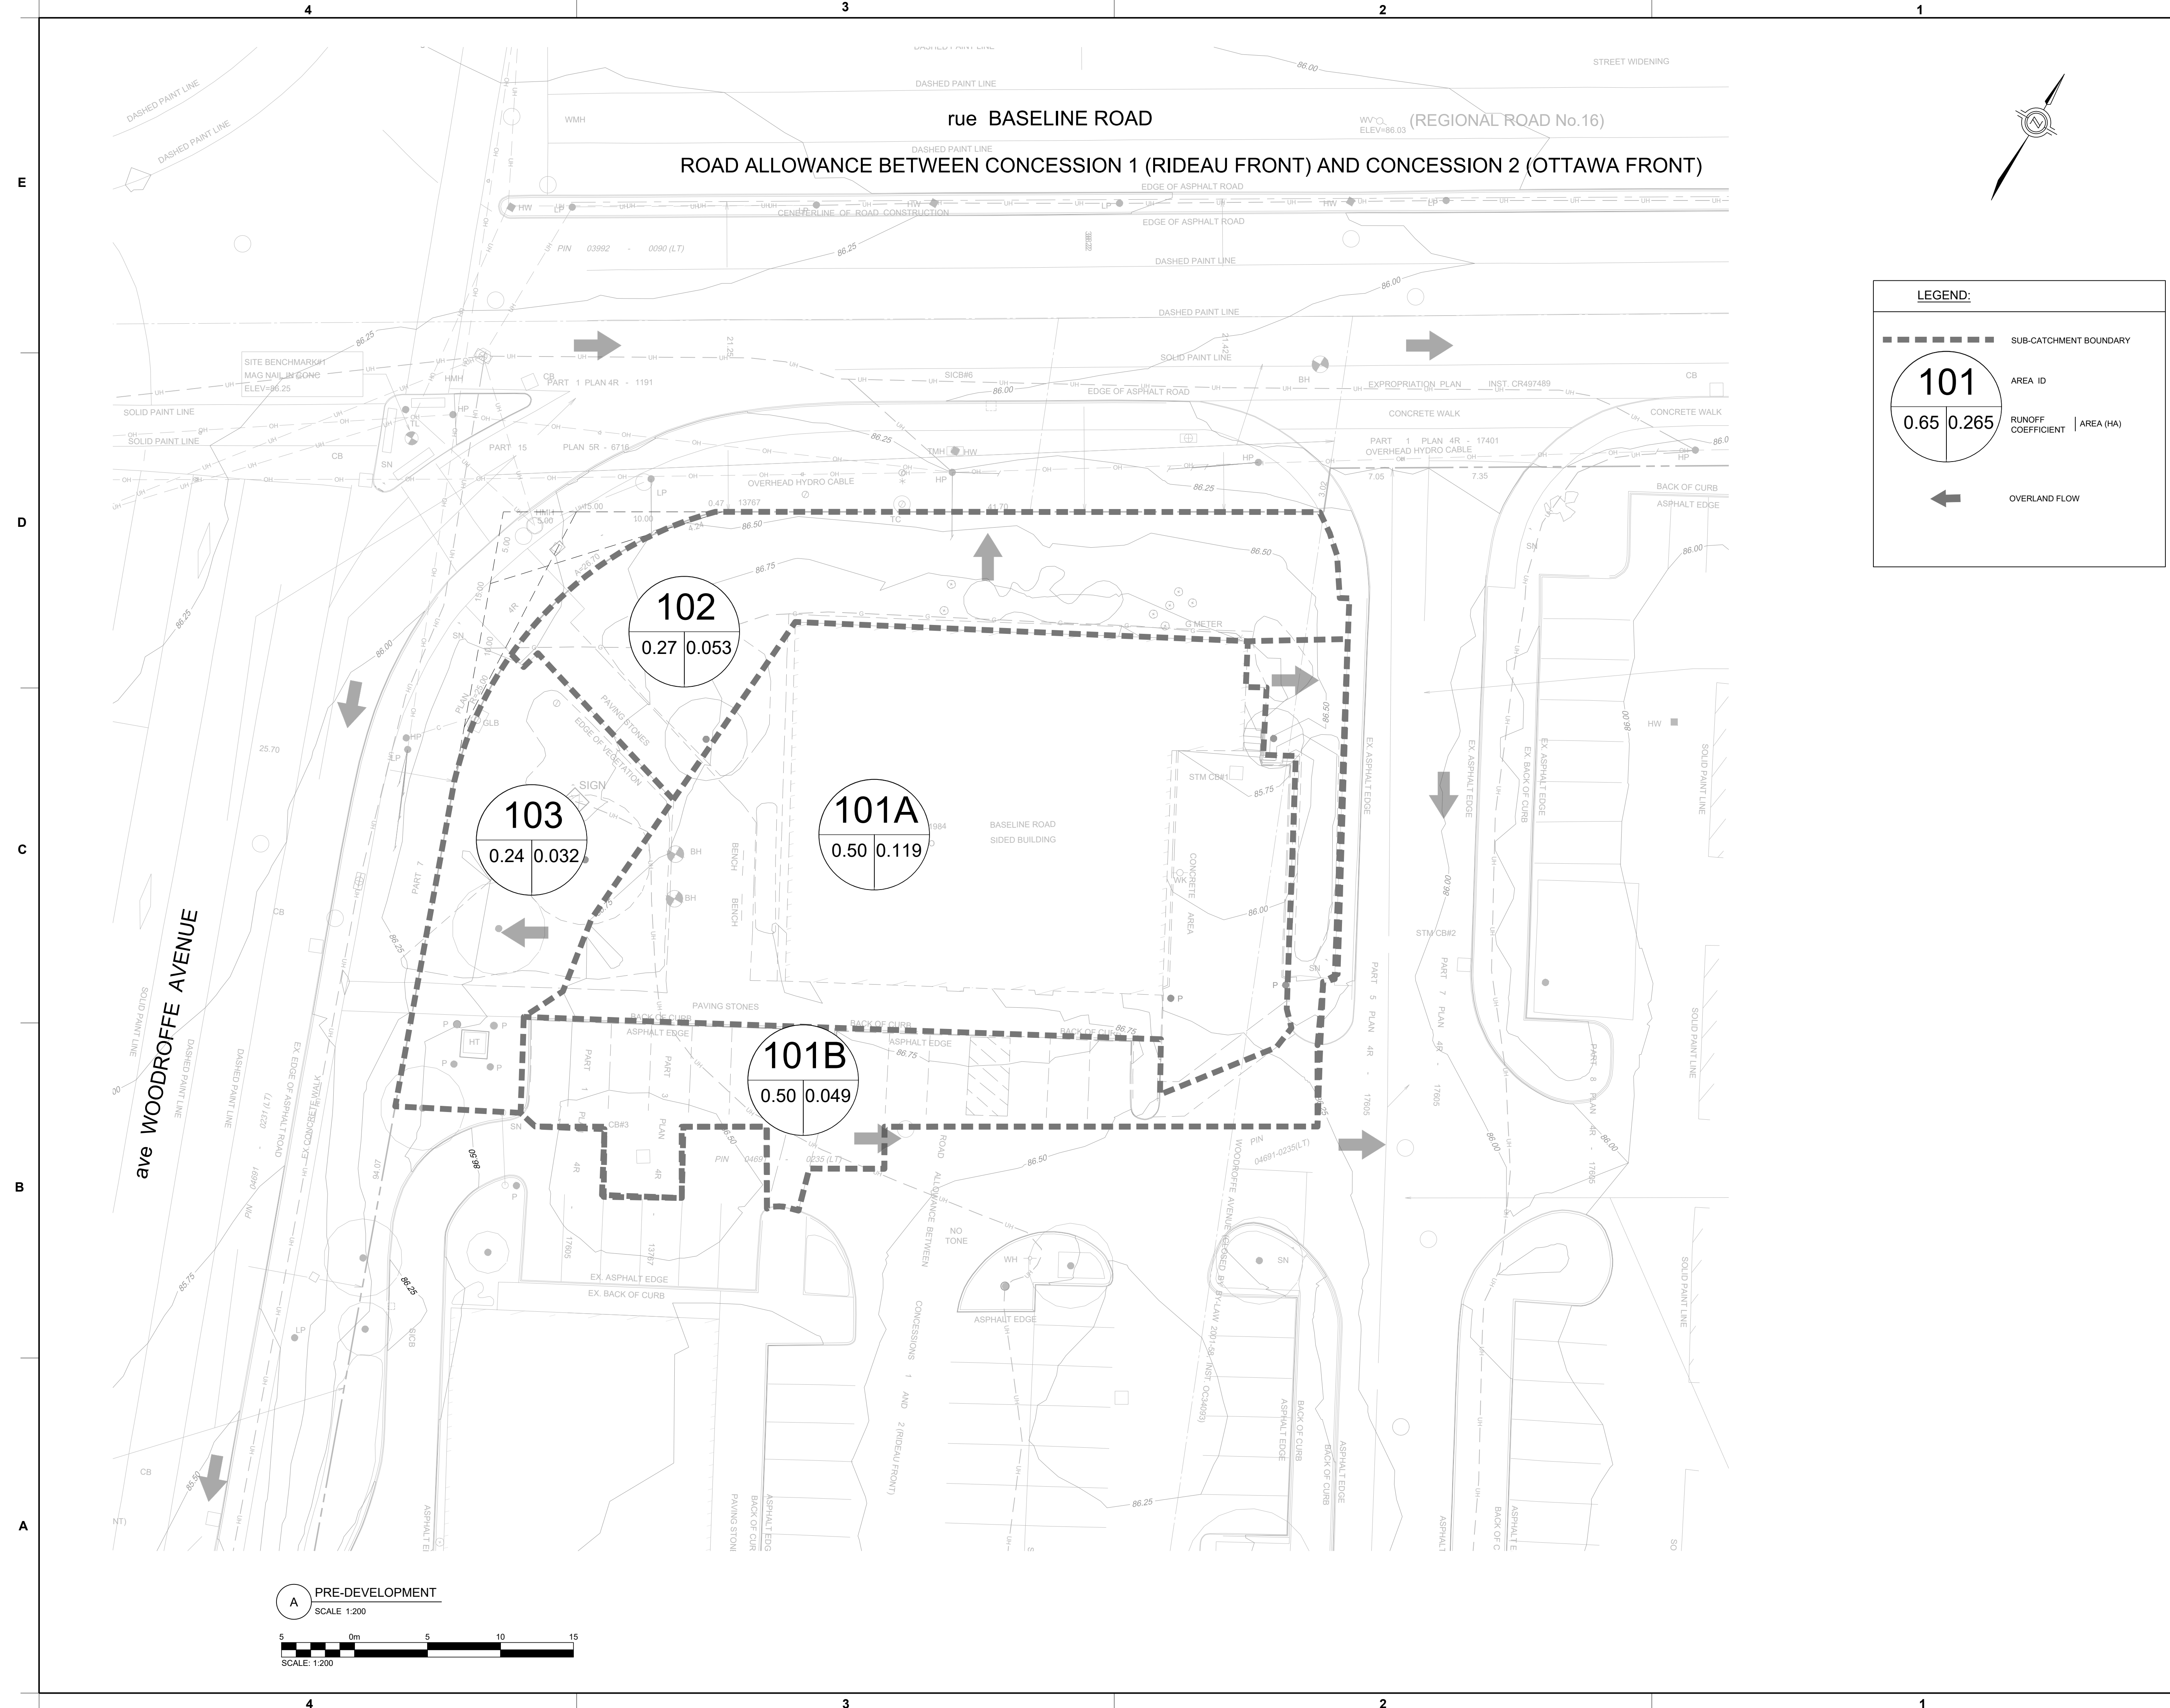

**LEGEND:**

- SUB-CATCHMENT BOUNDARY
- AREA ID
- RUNOFF COEFFICIENT | AREA (HA)
- OVERLAND FLOW

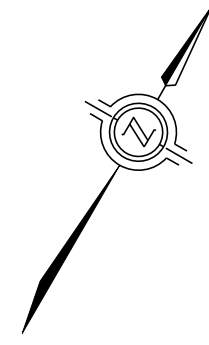

**Chick-fil-A**  
5200 Buffington Road  
Atlanta, Georgia 30349-2998

**exp Services Inc.**  
E: +1.905.793.9800 | F: +1.905.793.0641  
1595 Clark Boulevard  
Brampton, ON L6T 4V1  
Canada  
www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY

**CHICK-FIL-A**  
**COLLEGE SQUARE**  
1984 Baseline Road  
Ottawa, ON

**FSR#30088**  
BUILDING TYPE / SIZE: IP02 SE  
RELEASE:

**REVISION SCHEDULE**

NO.	DATE	DESCRIPTION
A	2025-09-17	ISSUED FOR UTILITY REVIEW
B	2025-09-23	ISSUED FOR SPA
C	2025-11-14	ISSUED FOR SPA
D	2026-05-25	AS PER CITY COMMENT


CONSULTANT PROJECT # BRM0023002042-W0  
PROJECT STATUS SPA  
DATE SEPTEMBER 2025  
DRAWN BY J.K.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.

SHEET  
**PRE-DEVELOPMENT DRAINAGE PLAN**

SHEET NUMBER  
**SWM100**  
FILE NUMBER D07-12-25-0159  
PLAN NUMBER 19453

Issued for SPA

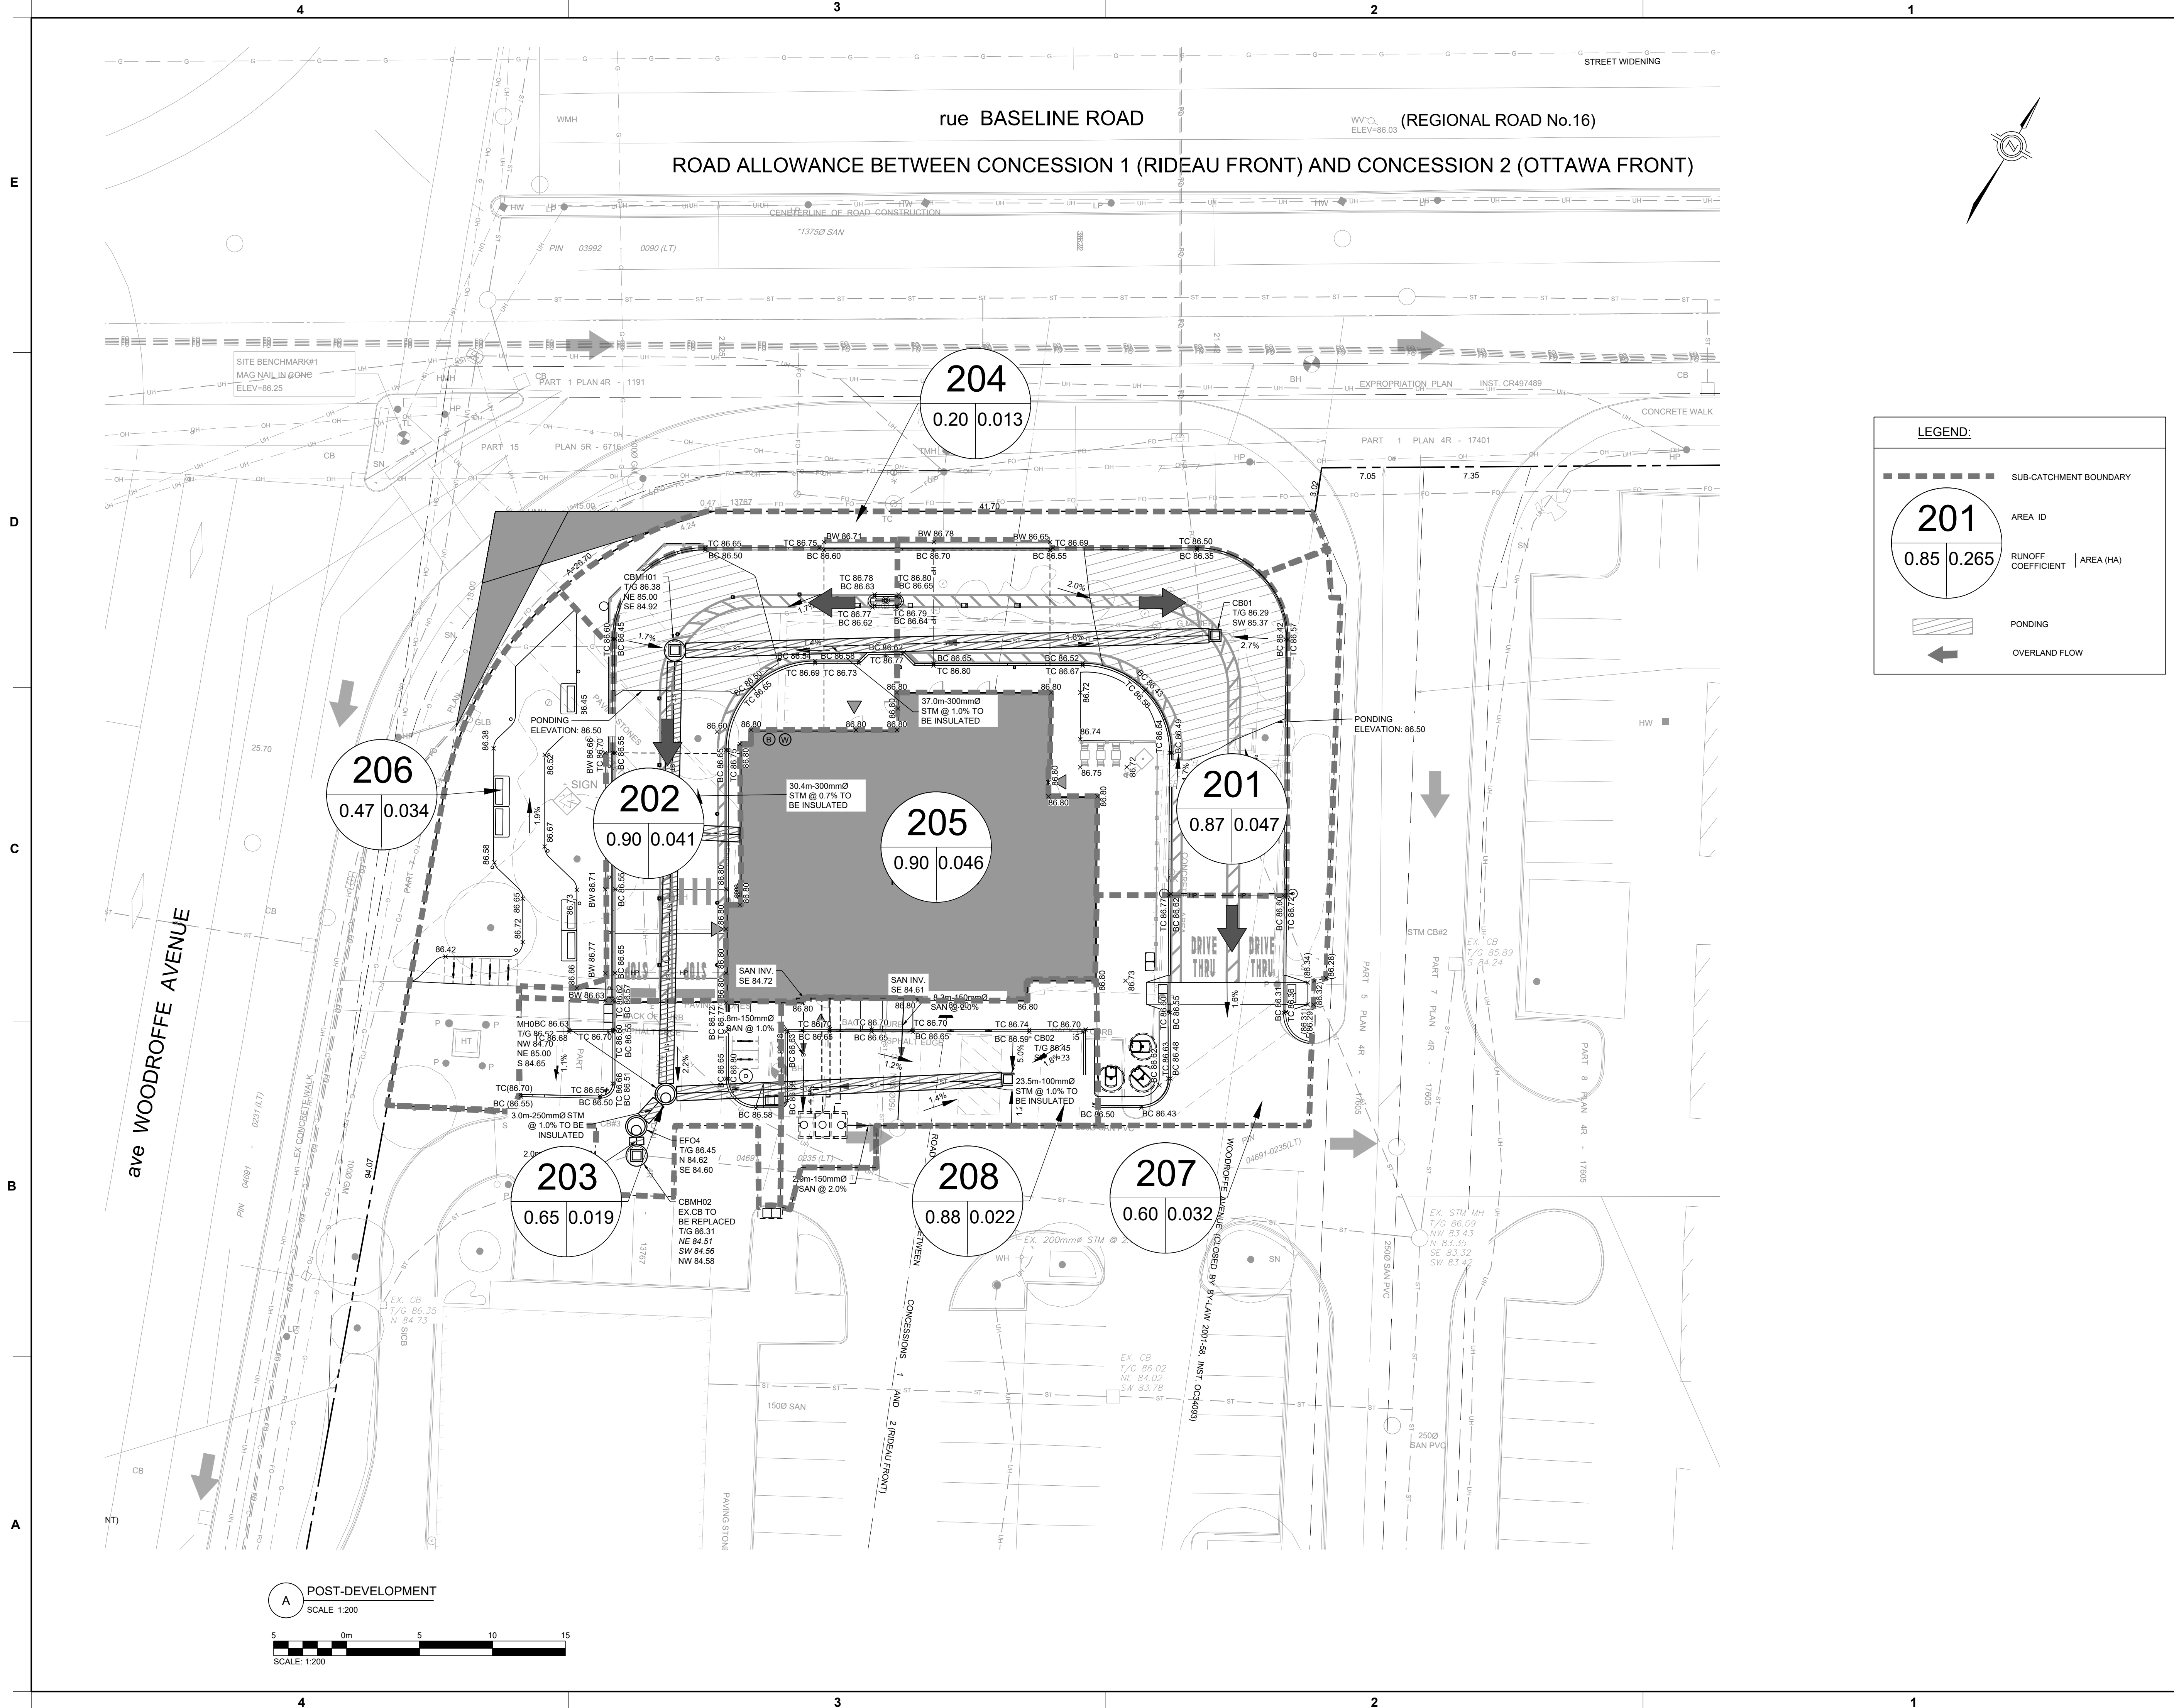


**LEGEND:**

- SUB-CATCHMENT BOUNDARY
- AREA ID
- RUNOFF COEFFICIENT | AREA (HA)
- PONDING
- OVERLAND FLOW

**A POST-DEVELOPMENT**  
SCALE: 1:200

SCALE: 1:200

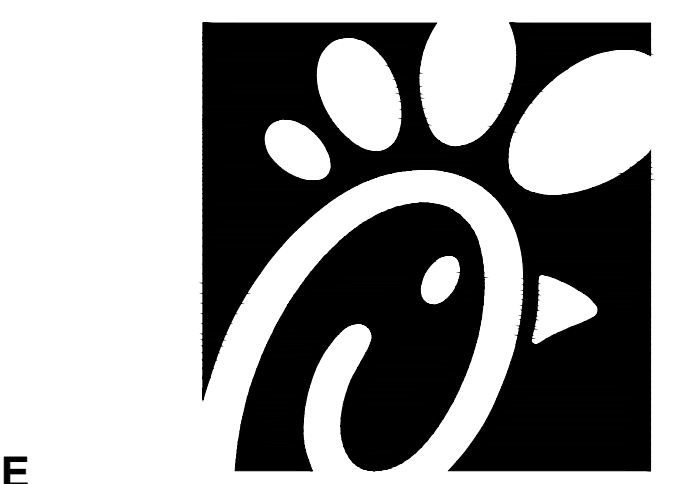

Chick-fil-A

**Chick-fil-A**  
5200 Buffington Road  
Atlanta, Georgia 30349-2998

exp Services Inc.  
T: +1.905.793.9800 | F: +1.905.793.0641  
1595 Clark Boulevard  
Brampton, ON L6T 4V1  
Canada  
www.exp.com



- BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
- INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY

# CHICK-FIL-A

## COLLEGE SQUARE

1984 Baseline Road  
Ottawa, ON

**FSR#30088**

BUILDING TYPE / SIZE: IP02 SE  
RELEASE:

**REVISION SCHEDULE**

NO.	DATE	DESCRIPTION
A	2025-09-17	ISSUED FOR UTILITY REVIEW
B	2025-09-23	ISSUED FOR SPA
C	2025-11-14	ISSUED FOR SPA
D	2026-05-25	AS PER CITY COMMENT

**CONSULTANT PROJECT #** BRM0023002042-W0

PROJECT STATUS	SPA
DATE	SEPTEMBER 2025
DRAWN BY	J.K.

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.

SHEET  
POST-DEVELOPMENT  
DRAINAGE PLAN

SHEET NUMBER

**SW200**  
FILE NUMBER D07-12-25-0159  
PLAN NUMBER 19453

Issued for SPA

Appendix C  
Calculations



City of Ottawa  
**Chick-fil-A College Square - 1984 Baseline Road, Ottawa ON**  
 Project Number: BRM-23002042-W0  
**Sanitary Sewer Design Calculations**

PIPE ROUGHNESS (n)		PEAKING FACTOR
< 600	= 0.013	<b>1.50</b>
≥ 600	= 0.013	
DESIGN VELOCITIES		<b>P = Population in Thousands</b>
MIN =	0.60 m/s	<b>COMMERCIAL RATE (L/sec/ha)</b>
MAX =	3.00 m/s	<b>0.324</b>
MAXIMUM PIPE CAPACITY		<b>INFILTRATION RATE (L/sec/ha)</b>
<b>80%</b>		<b>0.33</b>

DESIGNED BY : Joo Ho Kim  
 CHECKED BY : Saifullah Khan

AREA	MANHOLE		Development Type	AREA		FLOW CHARACTERISTICS (L/sec)					PROPOSED SEWER DESIGN			CAPACITY (L/s)	ACTUAL VELOCITY PERMITTED FLOWING FULL (m/s)	PERCENT FULL (%)	ACTUAL VELOCITY (m/s)	ACTUAL DEPTH (m)	FROUDE NUMBER	
	FROM	TO		INCREMENTAL (ha)	CUMMULATIVE (ha)	PEAK FACTOR	AVERAGE Q <sub>avg</sub>	PEAK Q <sub>peak</sub>	INFILTRATION Q <sub>infit</sub>	Foundation Q <sub>fdn</sub>	TOTAL Q <sub>tot</sub>	DIAMETRE (mm)	TYPE							GRADE (%)
										*Note 1										
1	Beer Store	EX. SAN	Commercial	0.068	0.068	1.50	0.02	0.03	0.02	0.00	0.06	150	S. PVC	2.00	21.538	1.22	0.3%	0.11	0.00	0.74
	EX. SAN	EX. SAN MH	Commercial	0.182	0.250	1.50	0.08	0.12	0.08	0.00	0.06	250	S. PVC	0.40	37.611	0.77	0.1%	0.05	0.00	0.29

NOTES: 1) Foundation drains to the sanitary sewer system is not permitted for new developments. Therefore, no allowance is made for foundation drain flow.



City of Ottawa  
**Chick-fil-A College Square - 1984 Baseline Road, Ottawa ON**  
 Project Number: BRM-23002042-W0  
**Sanitary Sewer Design Calculations**

DESIGNED BY : Joo Ho Kim

CHECKED BY: Saifullah Khan

PIPE ROUGHNESS (n)		PEAKING FACTOR
< 600	= 0.013	<b>1.50</b>
≥ 600	= 0.013	
DESIGN VELOCITIES		<b>P = Population in Thousands</b>
MIN =	0.60 m/s	COMMERCIAL RATE (L/sec/ha)
MAX =	3.00 m/s	0.324
MAXIMUM PIPE CAPACITY		INFILTRATION RATE (L/sec/ha)
80%		0.33

AREA	MANHOLE		Development Type	AREA		FLOW CHARACTERISTICS (L/sec)					PROPOSED SEWER DESIGN			CAPACITY (L/s)	ACTUAL VELOCITY PERMITTED FLOWING FULL (m/s)	PERCENT FULL (%)	ACTUAL VELOCITY (m/s)	ACTUAL DEPTH (m)	FROUDE NUMBER	
	FROM	TO		INCREMENTAL (ha)	CUMMULATIVE (ha)	PEAK FACTOR	AVERAGE $Q_{avg}$	PEAK $Q_{peak}$	INFILTRATION $Q_{infit}$	Foundation $Q_{fdn}$	TOTAL $Q_{tot}$	DIAMETRE (mm)	TYPE							GRADE (%)
										*Note 1										
1	Proposed CFA Store	Grease Interceptor	Commercial	0.250	0.250	1.00	0.08	0.08	0.08	0.00	0.16	150	S. PVC	2.00	21.538	1.22	0.8%	0.24	0.00	1.13
	Grease Interceptor	EX. SAN MH	Commercial	0.000	0.250	1.00	0.08	0.08	0.08	0.00	0.16	150	S. PVC	1.00	15.229	0.86	1.1%	0.22	0.01	0.88

NOTES: 1) Foundation drains to the sanitary sewer system is not permitted for new developments. Therefore, no allowance is made for foundation drain flow.



## Fire Underwriters Survey (FUS) Calculations

### Required Fire Flow Calculation

$$F = 220 \times C \times \sqrt{A} \quad \text{L/min} \quad \text{FUS Water Supply for Public Fire Protection, 2020}$$

F = Required Fire Flow  
 C = Construction Type Coefficient  
 A = Total Above-Ground Floor Area (m<sup>2</sup>)

#### 1 Estimate of Fire Flow (Baseline)

IBC Occupancy	Commercial	m <sup>2</sup>
Foot Print	465	
Number of Storeys	1	

Level	Area (m <sup>2</sup> )
1	465

#### Construction Class

Construction Class	Non Combustible
Coefficient	1.0

#### Total Area of Building

A=	465	m <sup>2</sup>
----	-----	----------------

#### Fire Flow

$$F = 220 * 1 * \sqrt{465}$$

$$F = 4744$$

F=	5000	L/min	<i>rounded to nearest 1000L/min, must be &gt;2000 L/min</i>
----	------	-------	---

#### 2 Occupancy Charge

Contents	Free Burning
Charge	0.15

$$O = F * \text{Occupancy Charge}$$

$$O = 5000 * 0.15$$

O=	750	L/min	<i>no rounding</i>
----	-----	-------	--------------------

#### 3 Automatic Sprinkler Reduction

NFPA Sprinkler Standard	No	0%	0%
Standard Water Supply	No	0%	
Fully Supervised System	No	0%	

$$S = F * \text{Sprinkler Reduction}$$

$$S = 5000 * 0\%$$

S=	0	L/min	<i>no rounding</i>
----	---	-------	--------------------

#### 4 Exposure Increase

Direction	Distance (m)	Charge	TOTAL
North	>45	0%	0%
East	>45	0%	
South	>45	0%	
West	>45	0%	

max 75%

$$E = F * \text{Exposure Charge}$$

$$E = 5000 * 0\%$$

E=	0	L/min	<i>no rounding</i>
----	---	-------	--------------------

#### H Adjusted Fire Flow

$$F_a = F + O + E + S$$

$$F_a = 5000 + 750 - 0 - 0$$


$$F_a = 5750 \text{ L/min}$$

Fa=	6000	L/min	<i>rounded to nearest 1000L/min</i>
-----	------	-------	-------------------------------------

REQUIRED FIRE FLOW	6000	L/min
	100	L/s
	1585	usgm

Appendix D  
Visual Otthymo Model

Pre-Development VOH Model Schematic

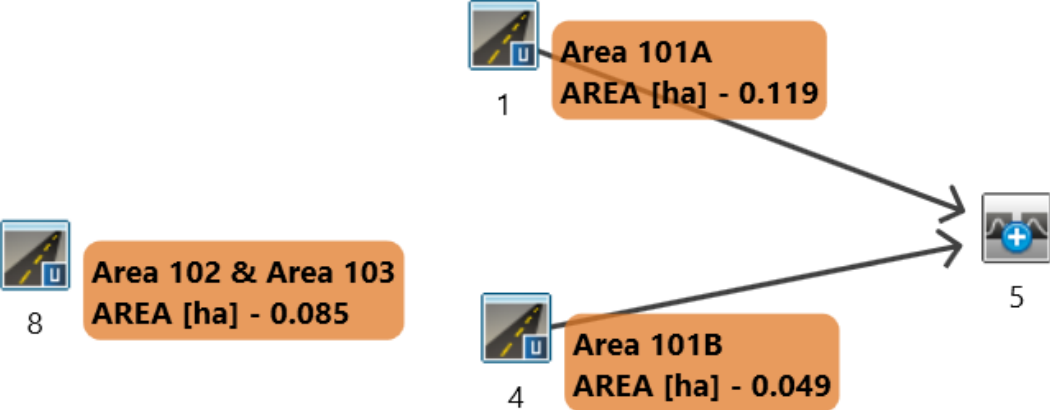

```

=====
V V I SSSS U U A L (v 6.2.2015)
V V I SS U U A A L
V V I SS U U A A A A L
V V I SS U U A A L
VV I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y M M O O
O O T T H H Y Y M M O O
OOO T T H H Y Y M M OOO

```

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voin.dat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87a1-436c-84fa-29e684f29ce0\df4f0f28-bffb-49f2-8753-d499fadd72bb\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87a1-436c-84fa-29e684f29ce0\df4f0f28-bffb-49f2-8753-d499fadd72bb\scenar

DATE: 05/27/2026 TIME: 10:56:32  
 USER:

COMMENTS:

\*\*\*\*\*  
 \*\* SIMULATION : 002yr 4hr 10min Chicago Copy \*\*  
 \*\*\*\*\*

CHICAGO STORM | IDF curve parameters: A= 732.951  
 | Ptotal= 33.89 mm | B= 6.200  
 C= 0.810

used in: INTENSITY = A / (t + B)^C

Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.00	2.05	1.00	18.21	2.00	5.10	3.00
2.28	0.17	2.37	1.17	76.80	2.17	4.29	3.17
2.12	0.33	2.81	1.33	24.08	2.33	3.72	3.33
1.99	0.50	3.50	1.50	12.36	2.50	3.29	3.50
1.87	0.67	4.69	1.67	8.32	2.67	2.95	3.67
1.77	0.83	7.31	1.83	6.30	2.83	2.68	3.83

CALIB |  
 STANDHYD ( 0001) | Area (ha)= 0.12  
 ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.07  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 28.17 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.083	2.05	1.083	18.21	2.083	5.10	3.08
2.46	0.167	2.05	1.167	18.21	2.167	5.10	3.17
2.28	0.250	2.37	1.250	76.80	2.250	4.29	3.25
2.28	0.333	2.37	1.333	76.80	2.333	4.29	3.33
2.12	0.417	2.81	1.417	24.08	2.417	3.72	3.42
2.12	0.500	2.81	1.500	24.08	2.500	3.72	3.50

1.99	0.583	3.50	1.583	12.36	2.583	3.29	3.58
1.99	0.667	3.50	1.667	12.36	2.667	3.29	3.67
1.87	0.750	4.69	1.750	8.32	2.750	2.95	3.75
1.87	0.833	4.69	1.833	8.32	2.833	2.95	3.83
1.77	0.917	7.31	1.917	6.30	2.917	2.68	3.92
1.77	1.000	7.31	2.000	6.30	3.000	2.68	4.00

Max.Eff.Inten.(mm/hr)= 76.80 12.53  
 over (min)= 5.00 20.00  
 Storage Coeff. (min)= 1.33 (ii) 17.53 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 20.00  
 Unit Hyd. peak (cms)= 0.33 0.06

\*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.011 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.58 1.33  
 RUNOFF VOLUME (mm)= 32.89 9.03 19.21  
 TOTAL RAINFALL (mm)= 33.89 33.89 33.89  
 RUNOFF COEFFICIENT = 0.97 0.27 0.57

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB |  
 STANDHYD ( 0004) | Area (ha)= 0.05  
 ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.03  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.07 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.083	2.05	1.083	18.21	2.083	5.10	3.08
2.46	0.167	2.05	1.167	18.21	2.167	5.10	3.17
2.28	0.250	2.37	1.250	76.80	2.250	4.29	3.25
2.28	0.333	2.37	1.333	76.80	2.333	4.29	3.33
2.12	0.417	2.81	1.417	24.08	2.417	3.72	3.42
2.12	0.500	2.81	1.500	24.08	2.500	3.72	3.50
1.99	0.583	3.50	1.583	12.36	2.583	3.29	3.58
1.99	0.667	3.50	1.667	12.36	2.667	3.29	3.67
1.87	0.750	4.69	1.750	8.32	2.750	2.95	3.75
1.87	0.833	4.69	1.833	8.32	2.833	2.95	3.83
1.77	0.917	7.31	1.917	6.30	2.917	2.68	3.92
1.77	1.000	7.31	2.000	6.30	3.000	2.68	4.00

Max.Eff.Inten.(mm/hr)= 76.80 12.53  
 over (min)= 5.00 20.00  
 Storage Coeff. (min)= 1.02 (ii) 17.21 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 20.00  
 Unit Hyd. peak (cms)= 0.34 0.06

\*TOTALS\*  
 PEAK FLOW (cms)= 0.00 0.00 0.005 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.58 1.33  
 RUNOFF VOLUME (mm)= 32.89 9.03 19.07  
 TOTAL RAINFALL (mm)= 33.89 33.89 33.89  
 RUNOFF COEFFICIENT = 0.97 0.27 0.56

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD ( 0005) |  
 | 1 + 2 = 3 | AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)



ID1= 1 ( 0001): 0.12 0.011 1.33 19.21  
 + ID2= 2 ( 0004): 0.05 0.005 1.33 19.07  
 =====  
 ID = 3 ( 0005): 0.17 0.016 1.33 19.17

USER:

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

COMMENTS:

-----  
 | CALIB |  
 | STANDHYD ( 0008) | Area (ha)= 0.09  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 9.00 Dir. Conn.(%)= 9.00  
 -----

\*\*\*\*\*  
 \*\* SIMULATION : 005yr 4hr 10min Chicago Copy \*\*  
 \*\*\*\*\*

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.01 0.08  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 23.80 40.00  
 Mannings n = 0.013 0.250

-----  
 | CHICAGO STORM | IDF curve parameters: A= 998.070  
 | Ptotal= 45.16 mm | B= 6.050  
 C= 0.814  
 -----  
 used in: INTENSITY = A / (t + B)^C

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.05	1.083	18.21	2.083	5.10	3.08	
2.46	0.167	1.167	18.21	2.167	5.10	3.17	
2.46	0.250	1.250	76.80	2.250	4.29	3.25	
2.28	0.333	1.333	76.80	2.333	4.29	3.33	
2.28	0.417	1.417	24.08	2.417	3.72	3.42	
2.12	0.500	1.500	24.08	2.500	3.72	3.50	
2.12	0.583	1.583	12.36	2.583	3.29	3.58	
1.99	0.667	1.667	12.36	2.667	3.29	3.67	
1.99	0.750	1.750	8.32	2.750	2.95	3.75	
1.87	0.833	1.833	8.32	2.833	2.95	3.83	
1.87	0.917	1.917	6.30	2.917	2.68	3.92	
1.77	1.000	2.000	6.30	3.000	2.68	4.00	

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.00	2.68	1.00	24.17	2.00	6.69	3.00	
3.22	0.17	3.10	1.17	104.21	2.17	5.63	3.17
2.98	0.33	3.68	1.33	32.03	2.33	4.87	3.33
2.77	0.50	4.58	1.50	16.34	2.50	4.30	3.50
2.60	0.67	6.15	1.67	10.96	2.67	3.86	3.67
2.44	0.83	9.61	1.83	8.29	2.83	3.51	3.83
2.31							

Max.Eff.Inten.(mm/hr)= 76.80 12.53  
 over (min) 5.00 20.00  
 Storage Coeff. (min)= 1.20 (ii) 17.40 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 20.00  
 Unit Hyd. peak (cms)= 0.33 0.06

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.07  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 28.17 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

\*TOTALS\*  
 PEAK FLOW (cms)= 0.00 0.00 0.002 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.58 1.33  
 RUNOFF VOLUME (mm)= 32.89 9.03 11.06  
 TOTAL RAINFALL (mm)= 33.89 33.89 33.89  
 RUNOFF COEFFICIENT = 0.97 0.27 0.33

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.68	1.083	24.17	2.083	6.69	3.08	
3.22	0.167	1.167	24.17	2.167	6.69	3.17	
3.22	0.250	1.250	104.21	2.250	5.63	3.25	
2.98	0.333	1.333	104.21	2.333	5.63	3.33	
2.98	0.417	1.417	32.03	2.417	4.87	3.42	
2.77	0.500	1.500	32.03	2.500	4.87	3.50	
2.77	0.583	1.583	16.34	2.583	4.30	3.58	
2.60	0.667	1.667	16.34	2.667	4.30	3.67	
2.60	0.750	1.750	10.96	2.750	3.86	3.75	
2.44	0.833	1.833	10.96	2.833	3.86	3.83	
2.44	0.917	1.917	8.29	2.917	3.51	3.92	
2.31	1.000	2.000	8.29	3.000	3.51	4.00	
2.31							

Max.Eff.Inten.(mm/hr)= 104.21 25.45  
 over (min) 5.00 15.00  
 Storage Coeff. (min)= 1.18 (ii) 13.38 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 15.00  
 Unit Hyd. peak (cms)= 0.33 0.08

\*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.016 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.50 1.33  
 RUNOFF VOLUME (mm)= 44.16 15.56 27.80  
 TOTAL RAINFALL (mm)= 45.16 45.16 45.16  
 RUNOFF COEFFICIENT = 0.98 0.34 0.62

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 \*\*\*\*\* WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20%  
 YOU SHOULD CONSIDER SPLITTING THE AREA.

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.

V V I SSSS U U A L (v 6.2.2015)  
 V V I SS U U A A L  
 V V I SS U U A A A A L  
 V V I SS U U A A L  
 V V I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM  
 O O T T H H Y Y M M O O  
 O O T T H H Y Y M M O O  
 OOO T T H H Y Y M M OOO

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\vo.in.dat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\1086d16f-1f16-4187-b879-1fe8d5c41a2e\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\1086d16f-1f16-4187-b879-1fe8d5c41a2e\scenar

DATE: 05/27/2026 TIME: 10:56:32



(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----
| CALIB |
| STANDHYD ( 0004) |
ID= 1 DT= 5.0 min

Area (ha)= 0.05
Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.02 0.03
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 18.07 40.00
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Table with 8 columns: TIME, RAIN, TIME, RAIN, TIME, RAIN, TIME, RAIN. Rows show transformed hyetograph data for various time steps (3.22, 2.98, 2.77, 2.60, 2.44, 2.31).

Max.Eff.Inten.(mm/hr)= 104.21 25.45
Storage Coeff. (min)= 0.90 (ii) 13.10 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.34 0.08
PEAK FLOW (cms)= 0.01 0.00 0.007 (iii)
TIME TO PEAK (hrs)= 1.33 1.50 1.33
RUNOFF VOLUME (mm)= 44.16 15.56 27.69
TOTAL RAINFALL (mm)= 45.16 45.16 45.16
RUNOFF COEFFICIENT = 0.98 0.34 0.61

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN\* = 80.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----

Table with 5 columns: ADD HYD ( 0005), AREA (ha), QPEAK (cms), TPEAK (hrs), R.V. (mm). Rows show peak flow data for different IDs.

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----
| CALIB |
| STANDHYD ( 0008) |
ID= 1 DT= 5.0 min
Area (ha)= 0.09
Total Imp(%)= 9.00 Dir. Conn.(%)= 9.00

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.01 0.08
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 23.80 40.00
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Table with 8 columns: TIME, RAIN, TIME, RAIN, TIME, RAIN, TIME, RAIN. Rows show transformed hyetograph data for various time steps (3.22).

Table with 8 columns: TIME, RAIN, TIME, RAIN, TIME, RAIN, TIME, RAIN. Rows show transformed hyetograph data for various time steps (3.22, 2.98, 2.77, 2.60, 2.44, 2.31).

Max.Eff.Inten.(mm/hr)= 104.21 25.45
Storage Coeff. (min)= 1.06 (ii) 13.26 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.34 0.08
PEAK FLOW (cms)= 0.00 0.00
TIME TO PEAK (hrs)= 1.33 1.50
RUNOFF VOLUME (mm)= 44.16 15.56
TOTAL RAINFALL (mm)= 45.16 45.16
RUNOFF COEFFICIENT = 0.98 0.34

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!
\*\*\*\*\* WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20% YOU SHOULD CONSIDER SPLITTING THE AREA.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN\* = 80.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----

V V I SSSS U U A L (v 6.2.2015)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2022 Smart City Water Inc
All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO
6.2\VO2\voin.dat
Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87a1-436c-84fa-29e684f29ce0\efea7f53-fad1-4174-9dde-0e7e139c7424\scenar
Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87a1-436c-84fa-29e684f29ce0\efea7f53-fad1-4174-9dde-0e7e139c7424\scenar

DATE: 05/27/2026 TIME: 10:56:32
USER:

COMMENTS: \_\_\_\_\_

\*\*\*\*\*
\*\* SIMULATION : 010yr 4hr 10min Chicago Copy \*\*
\*\*\*\*\*

| CHICAGO STORM | IDF curve parameters: A=1174.184
| Ptotal= 52.56 mm | B= 6.010
C= 0.816
used in: INTENSITY = A / (t + B)^C

Duration of storm = 4.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33

Table with 8 columns: TIME, RAIN, TIME, RAIN, TIME, RAIN, TIME, RAIN. Rows show transformed hyetograph data for various time steps (3.71).



3.43	0.17	3.57	1.17	122.17	2.17	6.50	3.17
3.20	0.33	4.25	1.33	37.28	2.33	5.62	3.33
2.99	0.50	5.29	1.50	18.95	2.50	4.97	3.50
2.81	0.67	7.11	1.67	12.70	2.67	4.46	3.67
2.66	0.83	11.13	1.83	9.59	2.83	4.05	3.83

-----  
 | CALIB |  
 | STANDHYD ( 0001) | Area (ha)= 0.12  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 -----

Surface Area	(ha)=	0.05	PERVIOUS (i)	0.07
Dep. Storage	(mm)=	1.00		5.00
Average Slope	(%)=	1.00		2.00
Length	(m)=	28.17		40.00
Mannings n	=	0.013		0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	3.09	1.083	28.10	2.083	7.73	3.08	3.71
0.167	3.09	1.167	28.10	2.167	7.73	3.17	3.71
0.250	3.57	1.250	122.17	2.250	6.50	3.25	3.43
0.333	3.57	1.333	122.17	2.333	6.50	3.33	3.43
0.417	4.25	1.417	37.28	2.417	5.62	3.42	3.20
0.500	4.25	1.500	37.28	2.500	5.62	3.50	3.20
0.583	5.29	1.583	18.95	2.583	4.97	3.58	2.99
0.667	5.29	1.667	18.95	2.667	4.97	3.67	2.99
0.750	7.11	1.750	12.70	2.750	4.46	3.75	2.81
0.833	7.11	1.833	12.70	2.833	4.46	3.83	2.81
0.917	11.13	1.917	9.59	2.917	4.05	3.92	2.66
1.000	11.13	2.000	9.59	3.000	4.05	4.00	2.66

Max.Eff.Inten.(mm/hr)=	122.17	42.11		
over (min)	5.00	15.00		
Storage Coeff. (min)=	1.10 (ii)	11.08 (ii)		
Unit Hyd. Tpeak (min)=	5.00	15.00		
Unit Hyd. peak (cms)=	0.34	0.09		
PEAK FLOW (cms)=	0.02	0.00	*TOTALS*	0.020 (iii)
TIME TO PEAK (hrs)=	1.33	1.50		1.33
RUNOFF VOLUME (mm)=	51.56	20.37		33.73
TOTAL RAINFALL (mm)=	52.56	52.56		52.56
RUNOFF COEFFICIENT	0.98	0.39		0.64

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0004) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 -----

Surface Area	(ha)=	0.02	PERVIOUS (i)	0.03
Dep. Storage	(mm)=	1.00		5.00
Average Slope	(%)=	1.00		2.00
Length	(m)=	18.07		40.00
Mannings n	=	0.013		0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	3.09	1.083	28.10	2.083	7.73	3.08	3.71
0.167	3.09	1.167	28.10	2.167	7.73	3.17	3.71
0.250	3.57	1.250	122.17	2.250	6.50	3.25	3.43

3.43	0.333	3.57	1.333	122.17	2.333	6.50	3.33
3.20	0.417	4.25	1.417	37.28	2.417	5.62	3.42
3.20	0.500	4.25	1.500	37.28	2.500	5.62	3.50
2.99	0.583	5.29	1.583	18.95	2.583	4.97	3.58
2.99	0.667	5.29	1.667	18.95	2.667	4.97	3.67
2.81	0.750	7.11	1.750	12.70	2.750	4.46	3.75
2.81	0.833	7.11	1.833	12.70	2.833	4.46	3.83
2.66	0.917	11.13	1.917	9.59	2.917	4.05	3.92
2.66	1.000	11.13	2.000	9.59	3.000	4.05	4.00

Max.Eff.Inten.(mm/hr)=	122.17	42.11		
over (min)	5.00	15.00		
Storage Coeff. (min)=	0.84 (ii)	10.82 (ii)		
Unit Hyd. Tpeak (min)=	5.00	15.00		
Unit Hyd. peak (cms)=	0.34	0.09		

PEAK FLOW (cms)=	0.01	0.00	*TOTALS*	0.008 (iii)
TIME TO PEAK (hrs)=	1.33	1.50		1.33
RUNOFF VOLUME (mm)=	51.56	20.37		33.67
TOTAL RAINFALL (mm)=	52.56	52.56		52.56
RUNOFF COEFFICIENT	0.98	0.39		0.64

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | ADD HYD ( 0005) |  
 | 1 + 2 = 3 | AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 ID1= 1 ( 0001): 0.12 0.020 1.33 33.73  
 + ID2= 2 ( 0004): 0.05 0.008 1.33 33.67  
 ID = 3 ( 0005): 0.17 0.028 1.33 33.71  
 -----

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0008) | Area (ha)= 0.09  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 9.00 Dir. Conn.(%)= 9.00  
 -----

Surface Area	(ha)=	0.01	PERVIOUS (i)	0.08
Dep. Storage	(mm)=	1.00		5.00
Average Slope	(%)=	1.00		2.00
Length	(m)=	23.80		40.00
Mannings n	=	0.013		0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	3.09	1.083	28.10	2.083	7.73	3.08	3.71
0.167	3.09	1.167	28.10	2.167	7.73	3.17	3.71
0.250	3.57	1.250	122.17	2.250	6.50	3.25	3.43
0.333	3.57	1.333	122.17	2.333	6.50	3.33	3.43
0.417	4.25	1.417	37.28	2.417	5.62	3.42	3.20
0.500	4.25	1.500	37.28	2.500	5.62	3.50	3.20
0.583	5.29	1.583	18.95	2.583	4.97	3.58	2.99
0.667	5.29	1.667	18.95	2.667	4.97	3.67	2.99
0.750	7.11	1.750	12.70	2.750	4.46	3.75	2.81
0.833	7.11	1.833	12.70	2.833	4.46	3.83	2.81
0.917	11.13	1.917	9.59	2.917	4.05	3.92	2.66
1.000	11.13	2.000	9.59	3.000	4.05	4.00	2.66

Max.Eff.Inten.(mm/hr)=	122.17	42.11		
over (min)	5.00	15.00		
Storage Coeff. (min)=	1.00 (ii)	10.97 (ii)		
Unit Hyd. Tpeak (min)=	5.00	15.00		
Unit Hyd. peak (cms)=	0.34	0.09		

PEAK FLOW (cms)=	0.00	0.01	*TOTALS*	0.006 (iii)
TIME TO PEAK (hrs)=	1.33	1.50		1.50



RUNOFF VOLUME (mm)= 51.56 20.37 23.10  
 TOTAL RAINFALL (mm)= 52.56 52.56 52.56  
 RUNOFF COEFFICIENT = 0.98 0.39 0.44

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 \*\*\*\*\* WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20%  
 YOU SHOULD CONSIDER SPLITTING THE AREA.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 -----  
 =====  
 =====

V V I SSSS U U A L (v 6.2.2015)  
 V V I SS U U A A L  
 V V I SS U U AAAAA L  
 V V I SS U U A A L  
 VV I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM  
 O O T T H H Y Y MM MM O O  
 O O T T H H Y Y M M O O  
 OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voain.dat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\9ac93451-0933-4936-99d5-17c12563a5d3\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\9ac93451-0933-4936-99d5-17c12563a5d3\scenar

DATE: 05/27/2026 TIME: 10:56:32

USER:

COMMENTS: \_\_\_\_\_

\*\*\*\*\*  
 \*\* SIMULATION : 025yr 4hr 10min Chicago Copy \*\*  
 \*\*\*\*\*

| CHICAGO STORM | IDF curve parameters: A=1402.884  
 | Ptotal= 61.76 mm | B= 6.020  
 C= 0.819  
 used in: INTENSITY = A / (t + B)^C

Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.00	3.58	1.00	33.04	2.00	9.01	3.00
4.31	0.17	4.14	1.17	144.68	2.17	7.57	3.17
3.98	0.33	4.93	1.33	43.91	2.33	6.54	3.33
3.71	0.50	6.15	1.50	22.23	2.50	5.78	3.50
3.47	0.67	8.28	1.67	14.85	2.67	5.18	3.67
3.26	0.83	13.01	1.83	11.19	2.83	4.70	3.83
3.08							

| CALIB |  
 | STANDHYD ( 0001) | Area (ha)= 0.12  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.07  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 28.17 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 57.63  
 over (min) 5.00 10.00  
 Storage Coeff. (min)= 1.03 (ii) 9.83 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.11

\*\*\*\*\*  
 PEAK FLOW (cms)= 0.02 0.01 0.026 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 60.76 26.79 41.35  
 TOTAL RAINFALL (mm)= 61.76 61.76 61.76  
 RUNOFF COEFFICIENT = 0.98 0.43 0.67

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 -----  
 =====  
 =====

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |  
 | STANDHYD ( 0004) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.03  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.07 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 57.63  
 over (min) 5.00 10.00  
 Storage Coeff. (min)= 0.79 (ii) 9.59 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.11

\*\*\*\*\*  
 PEAK FLOW (cms)= 0.01 0.00 0.011 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 60.76 26.79 41.27  
 TOTAL RAINFALL (mm)= 61.76 61.76 61.76  
 RUNOFF COEFFICIENT = 0.98 0.43 0.67



\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
6.2\VO2\voin.dat  
Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
87a1-436c-84fa-29e684f29ce0\75932167-5ae9-4d30-99a2-032d345df1f9\scenar  
Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
87a1-436c-84fa-29e684f29ce0\75932167-5ae9-4d30-99a2-032d345df1f9\scenar

DATE: 05/27/2026 TIME: 10:56:32

USER:

COMMENTS:

ADD HYD ( 0005)	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 1 ( 0001)	0.12	0.026	1.33	41.35
+ ID2= 2 ( 0004)	0.05	0.011	1.33	41.27
ID = 3 ( 0005)	0.17	0.037	1.33	41.33

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

CALIB	Area (ha)	IMPERVIOUS (%)	PERVIOUS (i)	Dir. Conn. (%)
STANDHYD ( 0008)	0.09	9.00		9.00
ID= 1 DT= 5.0 min				

Surface Area (ha)	IMPERVIOUS (%)	PERVIOUS (i)
0.01	0.08	
Dep. Storage (mm)	1.00	5.00
Average Slope (%)	1.00	2.00
Length (m)	23.80	40.00
Mannings n	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

\*\*\*\*\*  
\*\* SIMULATION : 050yr 4hr 10min Chicago Copy \*\*  
\*\*\*\*\*

CHICAGO STORM | IDF curve parameters: A=1569.580  
| Ptotal= 68.73 mm | B= 6.010  
C= 0.820

used in: INTENSITY = A / (t + B)^C

Duration of storm = 4.00 hrs  
Storm time step = 10.00 min  
Time to peak ratio = 0.33

--- TRANSFORMED HYETOGRAPH ---							
RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten. (mm/hr) over (min)	144.68	57.63
Storage Coeff. (min)	0.93 (ii)	9.73 (ii)
Unit Hyd. Tpeak (min)	5.00	10.00
Unit Hyd. peak (cms)	0.34	0.11

\*TOTALS\*

PEAK FLOW (cms)	0.00	0.01	0.009 (iii)
TIME TO PEAK (hrs)	1.33	1.42	1.33
RUNOFF VOLUME (mm)	60.76	26.79	29.77
TOTAL RAINFALL (mm)	61.76	61.76	61.76
RUNOFF COEFFICIENT	0.98	0.43	0.48

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
\*\*\*\*\* WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20%  
YOU SHOULD CONSIDER SPLITTING THE AREA.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.00	3.97	1.00	36.76	2.00	10.00	3.00
4.41	0.17	4.59	1.17	161.50	2.17	8.40	3.17
4.10	0.33	5.47	1.33	48.87	2.33	7.26	3.33
3.84	0.50	6.82	1.50	24.70	2.50	6.40	3.50
3.61	0.67	9.19	1.67	16.49	2.67	5.74	3.67
3.41	0.83	14.44	1.83	12.42	2.83	5.21	3.83

CALIB	Area (ha)	IMPERVIOUS (%)	PERVIOUS (i)	Dir. Conn. (%)
STANDHYD ( 0001)	0.12	43.00		43.00
ID= 1 DT= 5.0 min				

Surface Area (ha)	IMPERVIOUS (%)	PERVIOUS (i)
0.05	0.07	
Dep. Storage (mm)	1.00	5.00
Average Slope (%)	1.00	2.00
Length (m)	28.17	40.00
Mannings n	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

--- TRANSFORMED HYETOGRAPH ---							
RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.083	3.97	1.083	36.76	2.083	10.00	3.08
4.77	0.167	3.97	1.167	36.76	2.167	10.00	3.17
4.41	0.250	4.59	1.250	161.50	2.250	8.40	3.25
4.41	0.333	4.59	1.333	161.50	2.333	8.40	3.33
4.10	0.417	5.47	1.417	48.87	2.417	7.26	3.42
4.10	0.500	5.47	1.500	48.87	2.500	7.26	3.50
3.84	0.583	6.82	1.583	24.70	2.583	6.40	3.58
3.84	0.667	6.82	1.667	24.70	2.667	6.40	3.67
3.61	0.750	9.19	1.750	16.49	2.750	5.74	3.75
3.61	0.833	9.19	1.833	16.49	2.833	5.74	3.83
3.41	0.917	14.44	1.917	12.42	2.917	5.21	3.92
3.41	1.000	14.44	2.000	12.42	3.000	5.21	4.00

Max.Eff.Inten. (mm/hr) over (min)	161.50	70.15
	5.00	10.00

V V I SSSS U U A L (v 6.2.2015)  
V V I SS U U A A L  
V V I SS U U A A A A L  
V V I SS U U A A L  
VV I SSSS UUUU A A LLLL  
OOO TTTT TTTT H H Y Y M M OOO TM  
O O T T H H Y Y M M M M O O O  
O O T T H H Y Y M M O O O  
OOO T T H H Y M M OOO  
Developed and Distributed by Smart City Water Inc



Storage Coeff. (min)= 0.99 (ii) 9.12 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.12

\*TOTALS\*  
 PEAK FLOW (cms)= 0.02 0.01 0.030 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 67.73 31.92 47.27  
 TOTAL RAINFALL (mm)= 68.73 68.73 68.73  
 RUNOFF COEFFICIENT = 0.99 0.46 0.69

Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 23.80 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0004) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.03  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.07 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.083	3.97	1.083	36.76	2.083	10.00	3.08
4.77	0.167	3.97	1.167	36.76	2.167	10.00	3.17
4.41	0.250	4.59	1.250	161.50	2.250	8.40	3.25
4.41	0.333	4.59	1.333	161.50	2.333	8.40	3.33
4.10	0.417	5.47	1.417	48.87	2.417	7.26	3.42
4.10	0.500	5.47	1.500	48.87	2.500	7.26	3.50
3.84	0.583	6.82	1.583	24.70	2.583	6.40	3.58
3.84	0.667	6.82	1.667	24.70	2.667	6.40	3.67
3.61	0.750	9.19	1.750	16.49	2.750	5.74	3.75
3.61	0.833	9.19	1.833	16.49	2.833	5.74	3.83
3.41	0.917	14.44	1.917	12.42	2.917	5.21	3.92
3.41	1.000	14.44	2.000	12.42	3.000	5.21	4.00

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.083	3.97	1.083	36.76	2.083	10.00	3.08
4.77	0.167	3.97	1.167	36.76	2.167	10.00	3.17
4.41	0.250	4.59	1.250	161.50	2.250	8.40	3.25
4.41	0.333	4.59	1.333	161.50	2.333	8.40	3.33
4.10	0.417	5.47	1.417	48.87	2.417	7.26	3.42
4.10	0.500	5.47	1.500	48.87	2.500	7.26	3.50
3.84	0.583	6.82	1.583	24.70	2.583	6.40	3.58
3.84	0.667	6.82	1.667	24.70	2.667	6.40	3.67
3.61	0.750	9.19	1.750	16.49	2.750	5.74	3.75
3.61	0.833	9.19	1.833	16.49	2.833	5.74	3.83
3.41	0.917	14.44	1.917	12.42	2.917	5.21	3.92
3.41	1.000	14.44	2.000	12.42	3.000	5.21	4.00

Max.Eff.Inten.(mm/hr)= 161.50 70.15  
 over (min)= 5.00 10.00  
 Storage Coeff. (min)= 0.89 (ii) 9.02 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.12

\*TOTALS\*  
 PEAK FLOW (cms)= 0.00 0.01 0.011 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 67.73 31.92 35.07  
 TOTAL RAINFALL (mm)= 68.73 68.73 68.73  
 RUNOFF COEFFICIENT = 0.99 0.46 0.51

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 \*\*\*\*\* WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20%  
 YOU SHOULD CONSIDER SPLITTING THE AREA.

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

Max.Eff.Inten.(mm/hr)= 161.50 70.15  
 over (min)= 5.00 10.00  
 Storage Coeff. (min)= 0.76 (ii) 8.89 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.12

\*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.012 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 67.73 31.92 47.18  
 TOTAL RAINFALL (mm)= 68.73 68.73 68.73  
 RUNOFF COEFFICIENT = 0.99 0.46 0.69

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

V V I SSSS U U A L (v 6.2.2015)  
 V V I SS U U A A L  
 V V I SS U U AAAAA L  
 V V I SS U U A A L  
 VV I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM  
 O O T T H H Y Y MM MM O O  
 O O T T H H Y M M O O  
 OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voindat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\55260f8-7b04-4935-abb2-d390026d61b0\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\55260f8-7b04-4935-abb2-d390026d61b0\scenar

DATE: 05/27/2026 TIME: 10:56:33

-----  
 | ADD HYD ( 0005) |  
1 + 2 = 3
 ID1= 1 ( 0001): 0.12 0.030 1.33 47.27  
 + ID2= 2 ( 0004): 0.05 0.012 1.33 47.18  
 -----  
 ID = 3 ( 0005): 0.17 0.042 1.33 47.24

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0008) | Area (ha)= 0.09  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 9.00 Dir. Conn.(%)= 9.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.01 0.08



CHICAGO STORM | IDF curve parameters: A=1735.688  
 Ptotal= 76.00 mm | B= 6.010  
 C= 0.820  
 used in: INTENSITY = A / (t + B)^C

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
5.28	0.00	4.39	1.00	40.65	2.00	11.06	3.00
4.88	0.17	5.07	1.17	178.60	2.17	9.28	3.17
4.54	0.33	6.05	1.33	54.04	2.33	8.02	3.33
4.25	0.50	7.54	1.50	27.31	2.50	7.08	3.50
3.99	0.67	10.16	1.67	18.24	2.67	6.35	3.67
3.77	0.83	15.97	1.83	13.74	2.83	5.76	3.83

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	4.39	1.083	4.065	2.083	11.06	3.08	
0.167	4.39	1.167	4.065	2.167	11.06	3.17	
0.250	5.07	1.250	178.60	2.250	9.28	3.25	
0.333	5.07	1.333	178.60	2.333	9.28	3.33	
0.417	6.05	1.417	54.04	2.417	8.02	3.42	
0.500	6.05	1.500	54.04	2.500	8.02	3.50	
0.583	7.54	1.583	27.31	2.583	7.08	3.58	
0.667	7.54	1.667	27.31	2.667	7.08	3.67	
0.750	10.16	1.750	18.24	2.750	6.35	3.75	
0.833	10.16	1.833	18.24	2.833	6.35	3.83	
0.917	15.97	1.917	13.74	2.917	5.76	3.92	
1.000	15.97	2.000	13.74	3.000	5.76	4.00	

CALIB | Area (ha)= 0.12  
 STANDHYD ( 0001) | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 ID= 1 DT= 5.0 min |

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.07  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 28.17 40.00  
 Mannings n = 0.013 0.250

Max.Eff.Inten.(mm/hr)= 178.60 83.65  
 over (min) 5.00 10.00  
 Storage Coeff. (min)= 0.73 (ii) 8.31 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.13

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

PEAK FLOW (cms)= 0.01 0.00 \*TOTALS\*  
 TIME TO PEAK (hrs)= 1.33 1.42 0.014 (iii)  
 RUNOFF VOLUME (mm)= 75.00 37.48 1.33  
 TOTAL RAINFALL (mm)= 76.00 76.00 76.00  
 RUNOFF COEFFICIENT = 0.99 0.49 0.70

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	4.39	1.083	4.065	2.083	11.06	3.08	
0.167	4.39	1.167	4.065	2.167	11.06	3.17	
0.250	5.07	1.250	178.60	2.250	9.28	3.25	
0.333	5.07	1.333	178.60	2.333	9.28	3.33	
0.417	6.05	1.417	54.04	2.417	8.02	3.42	
0.500	6.05	1.500	54.04	2.500	8.02	3.50	
0.583	7.54	1.583	27.31	2.583	7.08	3.58	
0.667	7.54	1.667	27.31	2.667	7.08	3.67	
0.750	10.16	1.750	18.24	2.750	6.35	3.75	
0.833	10.16	1.833	18.24	2.833	6.35	3.83	
0.917	15.97	1.917	13.74	2.917	5.76	3.92	
1.000	15.97	2.000	13.74	3.000	5.76	4.00	

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD ( 0005) | AREA QPEAK TPEAK R.V.  
 | 1 + 2 = 3 | (ha) (cms) (hrs) (mm)  
 ID1= 1 ( 0001): 0.12 0.034 1.33 53.57  
 + ID2= 2 ( 0004): 0.05 0.014 1.33 53.54  
 ID = 3 ( 0005): 0.17 0.048 1.33 53.56

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

Max.Eff.Inten.(mm/hr)= 178.60 83.65  
 over (min) 5.00 10.00  
 Storage Coeff. (min)= 0.95 (ii) 8.53 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.12  
 \*TOTALS\*  
 PEAK FLOW (cms)= 0.03 0.01 0.034 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 75.00 37.48 53.57  
 TOTAL RAINFALL (mm)= 76.00 76.00 76.00  
 RUNOFF COEFFICIENT = 0.99 0.49 0.70

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.01 0.08  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 23.80 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB | Area (ha)= 0.05  
 STANDHYD ( 0004) | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 ID= 1 DT= 5.0 min |

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.03  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.07 40.00  
 Mannings n = 0.013 0.250

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	4.39	1.083	4.065	2.083	11.06	3.08	
0.167	4.39	1.167	4.065	2.167	11.06	3.17	
0.250	5.07	1.250	178.60	2.250	9.28	3.25	
0.333	5.07	1.333	178.60	2.333	9.28	3.33	
0.417	6.05	1.417	54.04	2.417	8.02	3.42	
0.500	6.05	1.500	54.04	2.500	8.02	3.50	
0.583	7.54	1.583	27.31	2.583	7.08	3.58	
0.667	7.54	1.667	27.31	2.667	7.08	3.67	
0.750	10.16	1.750	18.24	2.750	6.35	3.75	
0.833	10.16	1.833	18.24	2.833	6.35	3.83	
0.917	15.97	1.917	13.74	2.917	5.76	3.92	
1.000	15.97	2.000	13.74	3.000	5.76	4.00	



3.99 0.833 10.16 | 1.833 18.24 | 2.833 6.35 | 3.83  
 3.77 0.917 15.97 | 1.917 13.74 | 2.917 5.76 | 3.92  
 3.77 1.000 15.97 | 2.000 13.74 | 3.000 5.76 | 4.00

Max.Eff.Inten.(mm/hr)= 178.60 83.65  
 over (min) 5.00 10.00  
 Storage Coeff. (min)= 0.86 (ii) 8.44 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.12  
 \*TOTALS\*  
 PEAK FLOW (cms)= 0.00 0.01 0.014 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.42  
 RUNOFF VOLUME (mm)= 75.00 37.48 40.79  
 TOTAL RAINFALL (mm)= 76.00 76.00 76.00  
 RUNOFF COEFFICIENT = 0.99 0.49 0.54

-----  
 | CALIB |  
 | STANDHYD ( 0001) | Area (ha)= 0.12  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.07  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 28.17 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 \*\*\*\*\* WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20%  
 YOU SHOULD CONSIDER SPLITTING THE AREA.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

FINISH  
 =====  
 =====

V V I SSSS U U A L (v 6.2.2015)  
 V V I SS U U A A L  
 V V I SS U U A A A A L  
 V V I SS U U A A L  
 VV I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM  
 O O T T H H Y Y M M O O O  
 O O T T H H Y M M O O O  
 OOO T T H H Y M M OOO

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voindat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\576f806c-09fb-438f-b67e-3a6b27cf3fd8\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\576f806c-09fb-438f-b67e-3a6b27cf3fd8\scenar

DATE: 05/27/2026 TIME: 10:56:32

USER:

COMMENTS: \_\_\_\_\_

\*\*\*\*\*  
 \*\* SIMULATION : 25mm 4hr Chicago (VO) \*\*  
 \*\*\*\*\*

-----  
 | READ STORM | Filename: C:\Users\KimJo\AppData  
 | | ata\Local\Temp\  
 | | e848320a-63ec-4904-98f4-  
 739bcb12d336\234daf06  
 | Ptotal= 25.00 mm | Comments: 25mm 4hr Chicago (VO)  
 -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.80	0.00	2.07	1.00	5.70	2.00	5.19	3.00
2.62	0.17	2.27	1.17	10.78	2.17	4.47	3.17
2.48	0.33	2.52	1.33	50.21	2.33	3.95	3.33
2.35	0.50	2.88	1.50	13.37	2.50	3.56	3.50
2.23	0.67	3.38	1.67	8.29	2.67	3.25	3.67
2.14	0.83	4.18	1.83	6.30	2.83	3.01	3.83

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.80	0.083	2.07	1.083	5.70	2.083	5.19	3.08
2.80	0.167	2.07	1.167	5.70	2.167	5.19	3.17
2.62	0.250	2.27	1.250	10.78	2.250	4.47	3.25
2.62	0.333	2.27	1.333	10.78	2.333	4.47	3.33
2.48	0.417	2.52	1.417	50.21	2.417	3.95	3.42
2.48	0.500	2.52	1.500	50.21	2.500	3.95	3.50
2.35	0.583	2.88	1.583	13.37	2.583	3.56	3.58
2.35	0.667	2.88	1.667	13.37	2.667	3.56	3.67
2.23	0.750	3.38	1.750	8.29	2.750	3.25	3.75
2.23	0.833	3.38	1.833	8.29	2.833	3.25	3.83
2.14	0.917	4.17	1.917	6.30	2.917	3.01	3.92
2.14	1.000	4.18	2.000	6.29	3.000	3.01	4.00

Max.Eff.Inten.(mm/hr)= 50.21 4.50  
 over (min) 5.00 30.00  
 Storage Coeff. (min)= 1.57 (ii) 25.97 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 30.00  
 Unit Hyd. peak (cms)= 0.33 0.04  
 \*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.007 (iii)  
 TIME TO PEAK (hrs)= 1.50 2.00 1.50  
 RUNOFF VOLUME (mm)= 24.00 4.79 12.92  
 TOTAL RAINFALL (mm)= 25.00 25.00 25.00  
 RUNOFF COEFFICIENT = 0.96 0.19 0.52

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0004) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 43.00 Dir. Conn.(%)= 43.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.03  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.07 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.80	0.083	2.07	1.083	5.70	2.083	5.19	3.08
2.80	0.167	2.07	1.167	5.70	2.167	5.19	3.17
2.62	0.250	2.27	1.250	10.78	2.250	4.47	3.25
2.62	0.333	2.27	1.333	10.78	2.333	4.47	3.33
2.48	0.417	2.52	1.417	50.21	2.417	3.95	3.42
2.48	0.500	2.52	1.500	50.21	2.500	3.95	3.50
2.35	0.583	2.88	1.583	13.37	2.583	3.56	3.58
2.35	0.667	2.88	1.667	13.37	2.667	3.56	3.67
2.23	0.750	3.38	1.750	8.29	2.750	3.25	3.75



```

2.23      0.833  3.38 | 1.833  8.29 | 2.833  3.25 | 3.83
2.14      0.917  4.17 | 1.917  6.30 | 2.917  3.01 | 3.92
2.14      1.000  4.18 | 2.000  6.29 | 3.000  3.01 | 4.00

Max.Eff.Inten.(mm/hr)= 50.21      4.50
                    over (min) = 5.00      30.00
Storage Coeff. (min)= 1.21 (ii) 25.60 (ii)
Unit Hyd. Tpeak (min)= 5.00      30.00
Unit Hyd. peak (cms)= 0.33      0.04

PEAK FLOW (cms)= 0.00      0.00
TIME TO PEAK (hrs)= 1.50      2.00
RUNOFF VOLUME (mm)= 24.00      4.79
TOTAL RAINFALL (mm)= 25.00      25.00
RUNOFF COEFFICIENT = 0.96      0.19      0.51

```

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
    CN* = 80.0   Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
    THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

-----
| ADD HYD ( 0005) |
| 1 + 2 = 3 |
-----
ID1= 1 ( 0001):  0.12  0.007  1.50  12.92
+ ID2= 2 ( 0004):  0.05  0.003  1.50  12.70
-----
ID = 3 ( 0005):  0.17  0.010  1.50  12.86

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

```

-----
| CALIB |
| STANDHYD ( 0008) |
| ID= 1 DT= 5.0 min |
-----
                IMPERVIOUS  PERVIOUS (i)
Surface Area (ha)= 0.01      0.08
Dep. Storage (mm)= 1.00      5.00
Average Slope (%)= 1.00      2.00
Length (m)= 23.80      40.00
Mannings n = 0.013      0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

---- TRANSFORMED HYETOGRAPH ----

```

RAIN
TIME RAIN | TIME RAIN | TIME RAIN | TIME
hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
2.80 0.083 2.07 | 1.083 5.70 | 2.083 5.19 | 3.08
2.80 0.167 2.07 | 1.167 5.70 | 2.167 5.19 | 3.17
2.62 0.250 2.27 | 1.250 10.78 | 2.250 4.47 | 3.25
2.62 0.333 2.27 | 1.333 10.78 | 2.333 4.47 | 3.33
2.48 0.417 2.52 | 1.417 50.21 | 2.417 3.95 | 3.42
2.48 0.500 2.52 | 1.500 50.21 | 2.500 3.95 | 3.50
2.35 0.583 2.88 | 1.583 13.37 | 2.583 3.56 | 3.58
2.35 0.667 2.88 | 1.667 13.37 | 2.667 3.56 | 3.67
2.35 0.750 3.38 | 1.750 8.29 | 2.750 3.25 | 3.75
2.23 0.833 3.38 | 1.833 8.29 | 2.833 3.25 | 3.83
2.23 0.917 4.17 | 1.917 6.30 | 2.917 3.01 | 3.92
2.14 1.000 4.18 | 2.000 6.29 | 3.000 3.01 | 4.00
2.14

Max.Eff.Inten.(mm/hr)= 50.21      4.50
                    over (min) = 5.00      30.00
Storage Coeff. (min)= 1.42 (ii) 25.81 (ii)
Unit Hyd. Tpeak (min)= 5.00      30.00
Unit Hyd. peak (cms)= 0.33      0.04

PEAK FLOW (cms)= 0.00      0.00      0.001 (iii)
TIME TO PEAK (hrs)= 1.50      2.00      1.50
RUNOFF VOLUME (mm)= 24.00      4.79      6.35
TOTAL RAINFALL (mm)= 25.00      25.00      25.00
RUNOFF COEFFICIENT = 0.96      0.19      0.25

```

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!
***** WARNING:FOR AREAS WITH IMPERVIOUS RATIOS BELOW 20%
        YOU SHOULD CONSIDER SPLITTING THE AREA.

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
    CN* = 80.0   Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
    THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```


```

-----
FINISH
=====

```



# Post-Development VOH Model Schematic

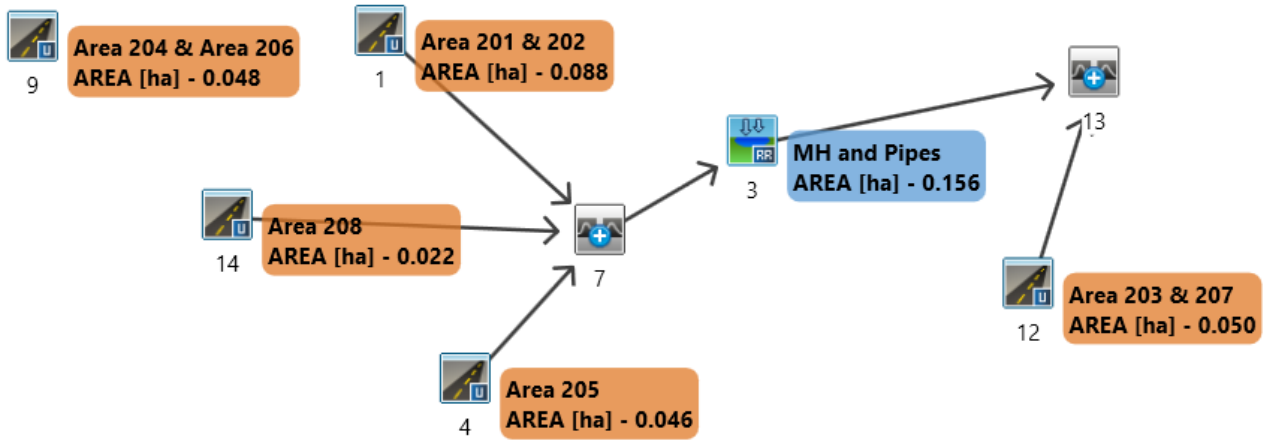

```

=====
V V I SSSSS U U A L (v 6.2.2015)
V V I SS U U A A L
V V I SS U U A A A A L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y M M O O
O O T T H H Y Y M M O O
OOO T T H H Y M M OOO

```

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

```

Input filename: C:\Program Files (x86)\Visual OTHYMO
6.2\VO2\voindat
Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-
87a1-436c-84fa-29e684f29ce0\cflle640-e193-465e-b0fc-241bf70b6776\scenar
Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-
87a1-436c-84fa-29e684f29ce0\cflle640-e193-465e-b0fc-241bf70b6776\scenar

```

DATE: 05/25/2026 TIME: 11:43:42  
 USER:

```

COMMENTS:
-----
*****
** SIMULATION : 002yr 4hr 10min Chicago Copy **
*****

```

```

| CHICAGO STORM | IDF curve parameters: A= 732.951
| Ptotal= 33.89 mm | B= 6.200
| C= 0.810
-----
used in: INTENSITY = A / (t + B)^C

Duration of storm = 4.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.00	2.05	1.00	18.21	2.00	5.10	3.00
2.46	0.17	2.37	1.17	76.80	2.17	4.29	3.17
2.28	0.33	2.81	1.33	24.08	2.33	3.72	3.33
2.12	0.50	3.50	1.50	12.36	2.50	3.29	3.50
1.99	0.67	4.69	1.67	8.32	2.67	2.95	3.67
1.87	0.83	7.31	1.83	6.30	2.83	2.68	3.83
1.77							

```

-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.01 0.04
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 17.89 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

---- TRANSFORMED HYETOGRAPH ----
RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME
mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
2.46 0.083 2.05 | 1.083 18.21 | 2.083 5.10 | 3.08
2.46 0.167 2.05 | 1.167 18.21 | 2.167 5.10 | 3.17
2.28 0.250 2.37 | 1.250 76.80 | 2.250 4.29 | 3.25
2.28 0.333 2.37 | 1.333 76.80 | 2.333 4.29 | 3.33
2.12 0.417 2.81 | 1.417 24.08 | 2.417 3.72 | 3.42
2.12 0.500 2.81 | 1.500 24.08 | 2.500 3.72 | 3.50

```

1.99	0.583	3.50	1.583	12.36	2.583	3.29	3.58
1.99	0.667	3.50	1.667	12.36	2.667	3.29	3.67
1.87	0.750	4.69	1.750	8.32	2.750	2.95	3.75
1.87	0.833	4.69	1.833	8.32	2.833	2.95	3.83
1.77	0.917	7.31	1.917	6.30	2.917	2.68	3.92
1.77	1.000	7.31	2.000	6.30	3.000	2.68	4.00

```

Max.Eff.Inten.(mm/hr)= 76.80 12.53
over (min)= 5.00 20.00
Storage Coeff. (min)= 1.01 (ii) 17.21 (ii)
Unit Hyd. Tpeak (min)= 5.00 20.00
Unit Hyd. peak (cms)= 0.34 0.06

```

```

*TOTALS*
PEAK FLOW (cms)= 0.00 0.00 0.003 (iii)
TIME TO PEAK (hrs)= 1.33 1.58 1.33
RUNOFF VOLUME (mm)= 32.89 9.03 15.19
TOTAL RAINFALL (mm)= 33.89 33.89 33.89
RUNOFF COEFFICIENT = 0.97 0.27 0.45

```

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 80.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

| CALIB |
| STANDHYD ( 0001) | Area (ha)= 0.09
| ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00

```

```

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.09 0.00
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 24.22 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

---- TRANSFORMED HYETOGRAPH ----
RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME
mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
2.46 0.083 2.05 | 1.083 18.21 | 2.083 5.10 | 3.08
2.46 0.167 2.05 | 1.167 18.21 | 2.167 5.10 | 3.17
2.28 0.250 2.37 | 1.250 76.80 | 2.250 4.29 | 3.25
2.28 0.333 2.37 | 1.333 76.80 | 2.333 4.29 | 3.33
2.12 0.417 2.81 | 1.417 24.08 | 2.417 3.72 | 3.42
2.12 0.500 2.81 | 1.500 24.08 | 2.500 3.72 | 3.50
1.99 0.583 3.50 | 1.583 12.36 | 2.583 3.29 | 3.58
1.99 0.667 3.50 | 1.667 12.36 | 2.667 3.29 | 3.67
1.87 0.750 4.69 | 1.750 8.32 | 2.750 2.95 | 3.75
1.87 0.833 4.69 | 1.833 8.32 | 2.833 2.95 | 3.83
1.77 0.917 7.31 | 1.917 6.30 | 2.917 2.68 | 3.92
1.77 1.000 7.31 | 2.000 6.30 | 3.000 2.68 | 4.00

```

```

Max.Eff.Inten.(mm/hr)= 76.80 16.12
over (min)= 5.00 5.00
Storage Coeff. (min)= 1.21 (ii) 3.17 (ii)
Unit Hyd. Tpeak (min)= 5.00 5.00
Unit Hyd. peak (cms)= 0.33 0.27

```

```

*TOTALS*
PEAK FLOW (cms)= 0.02 0.00 0.018 (iii)
TIME TO PEAK (hrs)= 1.33 1.33 1.33
RUNOFF VOLUME (mm)= 32.89 9.03 32.17
TOTAL RAINFALL (mm)= 33.89 33.89 33.89
RUNOFF COEFFICIENT = 0.97 0.27 0.95

```

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 80.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

| CALIB |
| STANDHYD ( 0004) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

```



IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.00  
 Dep. Storage (mm)= 1.00 1.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 17.59 40.00  
 Mannings n = 0.013 0.250

Max.Eff.Inten.(mm/hr)= 76.80 16.12  
 over (min) 5.00 5.00  
 Storage Coeff. (min)= 0.80 (ii) 2.45 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 5.00  
 Unit Hyd. peak (cms)= 0.34 0.30

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

\*TOTALS\*  
 PEAK FLOW (cms)= 0.00 0.00 0.005 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.33 1.33  
 RUNOFF VOLUME (mm)= 32.89 9.03 32.41  
 TOTAL RAINFALL (mm)= 33.89 33.89 33.89  
 RUNOFF COEFFICIENT = 0.97 0.27 0.96

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.083	2.05	1.083	18.21	2.083	5.10	3.08
2.46	0.167	2.05	1.167	18.21	2.167	5.10	3.17
2.28	0.250	2.37	1.250	76.80	2.250	4.29	3.25
2.28	0.333	2.37	1.333	76.80	2.333	4.29	3.33
2.12	0.417	2.81	1.417	24.08	2.417	3.72	3.42
2.12	0.500	2.81	1.500	24.08	2.500	3.72	3.50
1.99	0.583	3.50	1.583	12.36	2.583	3.29	3.58
1.99	0.667	3.50	1.667	12.36	2.667	3.29	3.67
1.87	0.750	4.69	1.750	8.32	2.750	2.95	3.75
1.87	0.833	4.69	1.833	8.32	2.833	2.95	3.83
1.77	0.917	7.31	1.917	6.30	2.917	2.68	3.92
1.77	1.000	7.31	2.000	6.30	3.000	2.68	4.00

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | ADD HYD ( 0007) |  
 | 1 + 2 = 3 | AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 ID1= 1 ( 0001): 0.09 0.018 1.33 32.17  
 + ID2= 2 ( 0014): 0.02 0.005 1.33 32.41  
 ID = 3 ( 0007): 0.11 0.023 1.33 32.22

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
 | ADD HYD ( 0007) |  
 | 3 + 2 = 1 | AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 ID1= 3 ( 0007): 0.11 0.023 1.33 32.22  
 + ID2= 2 ( 0004): 0.05 0.010 1.33 32.86  
 ID = 1 ( 0007): 0.16 0.033 1.33 32.41

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

Max.Eff.Inten.(mm/hr)= 76.80 73.96  
 over (min) 5.00 5.00  
 Storage Coeff. (min)= 1.00 (ii) 2.25 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 5.00  
 Unit Hyd. peak (cms)= 0.34 0.30  
 \*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.010 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.33 1.33  
 RUNOFF VOLUME (mm)= 32.89 30.51 32.86  
 TOTAL RAINFALL (mm)= 33.89 33.89 33.89  
 RUNOFF COEFFICIENT = 0.97 0.90 0.97

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 99.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | RESERVOIR( 0003) | OVERFLOW IS OFF  
 | IN= 2--> OUT= 1 |  
 | DT= 5.0 min |  
 OUTFLOW STORAGE | OUTFLOW STORAGE  
 (cms) (ha.m.) | (cms) (ha.m.)  
 0.0000 0.0000 | 0.0184 0.0017  
 0.0179 0.0010 | 0.0187 0.0027  
 0.0182 0.0011 | 0.0000 0.0000  
 AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 INFLOW : ID= 2 ( 0007) 0.156 0.033 1.33 32.41  
 OUTFLOW: ID= 1 ( 0003) 0.156 0.018 1.42 32.36

PEAK FLOW REDUCTION [Qout/Qin] (%) = 55.55  
 TIME SHIFT OF PEAK FLOW (min) = 5.00  
 MAXIMUM STORAGE USED (ha.m.) = 0.0014

-----  
 | CALIB |  
 | STANDHYD ( 0014) | Area (ha)= 0.02  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 98.00 Dir. Conn.(%)= 98.00

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.00  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 12.11 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

-----  
 | CALIB |  
 | STANDHYD ( 0012) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 63.00 Dir. Conn.(%)= 63.00

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.03 0.02  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.26 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.083	2.05	1.083	18.21	2.083	5.10	3.08
2.46	0.167	2.05	1.167	18.21	2.167	5.10	3.17
2.28	0.250	2.37	1.250	76.80	2.250	4.29	3.25
2.28	0.333	2.37	1.333	76.80	2.333	4.29	3.33
2.12	0.417	2.81	1.417	24.08	2.417	3.72	3.42
2.12	0.500	2.81	1.500	24.08	2.500	3.72	3.50
1.99	0.583	3.50	1.583	12.36	2.583	3.29	3.58
1.99	0.667	3.50	1.667	12.36	2.667	3.29	3.67
1.87	0.750	4.69	1.750	8.32	2.750	2.95	3.75
1.87	0.833	4.69	1.833	8.32	2.833	2.95	3.83
1.77	0.917	7.31	1.917	6.30	2.917	2.68	3.92
1.77	1.000	7.31	2.000	6.30	3.000	2.68	4.00

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
2.46	0.083	2.05	1.083	18.21	2.083	5.10	3.08
2.46	0.167	2.05	1.167	18.21	2.167	5.10	3.17
2.28	0.250	2.37	1.250	76.80	2.250	4.29	3.25
2.28	0.333	2.37	1.333	76.80	2.333	4.29	3.33
2.12	0.417	2.81	1.417	24.08	2.417	3.72	3.42
2.12	0.500	2.81	1.500	24.08	2.500	3.72	3.50
1.99	0.583	3.50	1.583	12.36	2.583	3.29	3.58
1.99	0.667	3.50	1.667	12.36	2.667	3.29	3.67
1.87	0.750	4.69	1.750	8.32	2.750	2.95	3.75



1.87 0.833 4.69 | 1.833 8.32 | 2.833 2.95 | 3.83  
 1.77 0.917 7.31 | 1.917 6.30 | 2.917 2.68 | 3.92  
 1.77 1.000 7.31 | 2.000 6.30 | 3.000 2.68 | 4.00

2.60 0.50 4.58 | 1.50 16.34 | 2.50 4.30 | 3.50  
 2.44 0.67 6.15 | 1.67 10.96 | 2.67 3.86 | 3.67  
 2.31 0.83 9.61 | 1.83 8.29 | 2.83 3.51 | 3.83

Max.Eff.Inten.(mm/hr)= 76.80 12.53  
 over (min)= 5.00 20.00  
 Storage Coeff. (min)= 1.02 (ii) 17.22 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 20.00  
 Unit Hyd. peak (cms)= 0.34 0.06  
 \*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.007 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.58 1.33  
 RUNOFF VOLUME (mm)= 32.89 9.03 23.92  
 TOTAL RAINFALL (mm)= 33.89 33.89 33.89  
 RUNOFF COEFFICIENT = 0.97 0.27 0.71

-----  
 | CALIB |  
 | STANDHYD ( 0009) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00  
 -----  
 IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.01 0.04  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 17.89 40.00  
 Mannings n = 0.013 0.250

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

-----  
 | ADD HYD ( 0013) |  
1 + 2 = 3
 ID1= 1 ( 0012): 0.05 0.007 1.33 23.92  
 + ID2= 2 ( 0003): 0.16 0.018 1.42 32.36  
 -----  
 ID = 3 ( 0013): 0.21 0.025 1.33 30.31

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.68	1.083	24.17	2.083	6.69	3.08	
0.167	2.68	1.167	24.17	2.167	6.69	3.17	
0.250	3.10	1.250	104.21	2.250	5.63	3.25	
0.333	3.10	1.333	104.21	2.333	5.63	3.33	
0.417	3.68	1.417	32.03	2.417	4.87	3.42	
0.500	3.68	1.500	32.03	2.500	4.87	3.50	
0.583	4.58	1.583	16.34	2.583	4.30	3.58	
0.667	4.58	1.667	16.34	2.667	4.30	3.67	
0.750	6.15	1.750	10.96	2.750	3.86	3.75	
0.833	6.15	1.833	10.96	2.833	3.86	3.83	
0.917	9.61	1.917	8.29	2.917	3.51	3.92	
1.000	9.61	2.000	8.29	3.000	3.51	4.00	

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

V V I SSSS U U A L (v 6.2.2015)  
 V V I SS U U A A L  
 V V I SS U U A A L  
 V V I SS U U A A L  
 VV I SSSS UUUU A A LLLL  
 OOO TTTT TTTT H H Y Y M M OOO TM  
 O O T T H H Y Y M M O O O  
 O O T T H H Y Y M M O O O  
 OOO T T H H Y Y M M OOO

Max.Eff.Inten.(mm/hr)= 104.21 25.45  
 over (min)= 5.00 15.00  
 Storage Coeff. (min)= 0.89 (ii) 13.10 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 15.00  
 Unit Hyd. peak (cms)= 0.34 0.08  
 \*TOTALS\*  
 PEAK FLOW (cms)= 0.00 0.00 0.004 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.50 1.33  
 RUNOFF VOLUME (mm)= 44.16 15.56 23.13  
 TOTAL RAINFALL (mm)= 45.16 45.16 45.16  
 RUNOFF COEFFICIENT = 0.98 0.34 0.51

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* DETAILED OUTPUT \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voain.dat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\049358d6-4baa-4291-9018-f01193c4ae89\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\049358d6-4baa-4291-9018-f01193c4ae89\scenar

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

DATE: 05/25/2026 TIME: 11:43:42  
 USER:

COMMENTS: \_\_\_\_\_

-----  
 | CALIB |  
 | STANDHYD ( 0001) | Area (ha)= 0.09  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00  
 -----

\*\*\*\*\*  
 \*\* SIMULATION : 005yr 4hr 10min Chicago Copy \*\*  
 \*\*\*\*\*  
 | CHICAGO STORM | IDF curve parameters: A= 998.070  
 | Ptotal= 45.16 mm | B= 6.050  
C= 0.814
 used in: INTENSITY = A / (t + B)^C

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.09 0.00  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 24.22 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.68	1.083	24.17	2.083	6.69	3.08	
0.167	2.68	1.167	24.17	2.167	6.69	3.17	
0.250	3.10	1.250	104.21	2.250	5.63	3.25	
0.333	3.10	1.333	104.21	2.333	5.63	3.33	
0.417	3.68	1.417	32.03	2.417	4.87	3.42	
0.500	3.68	1.500	32.03	2.500	4.87	3.50	
0.583	4.58	1.583	16.34	2.583	4.30	3.58	
0.667	4.58	1.667	16.34	2.667	4.30	3.67	
0.750	6.15	1.750	10.96	2.750	3.86	3.75	
0.833	6.15	1.833	10.96	2.833	3.86	3.83	
0.917	9.61	1.917	8.29	2.917	3.51	3.92	
1.000	9.61	2.000	8.29	3.000	3.51	4.00	

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.68	1.083	24.17	2.083	6.69	3.08	
0.167	2.68	1.167	24.17	2.167	6.69	3.17	
0.250	3.10	1.250	104.21	2.250	5.63	3.25	
0.333	3.10	1.333	104.21	2.333	5.63	3.33	
0.417	3.68	1.417	32.03	2.417	4.87	3.42	
0.500	3.68	1.500	32.03	2.500	4.87	3.50	
0.583	4.58	1.583	16.34	2.583	4.30	3.58	
0.667	4.58	1.667	16.34	2.667	4.30	3.67	
0.750	6.15	1.750	10.96	2.750	3.86	3.75	
0.833	6.15	1.833	10.96	2.833	3.86	3.83	
0.917	9.61	1.917	8.29	2.917	3.51	3.92	
1.000	9.61	2.000	8.29	3.000	3.51	4.00	



2.77	0.500	3.68	1.500	32.03	2.500	4.87	3.50
2.60	0.583	4.58	1.583	16.34	2.583	4.30	3.58
2.60	0.667	4.58	1.667	16.34	2.667	4.30	3.67
2.44	0.750	6.15	1.750	10.96	2.750	3.86	3.75
2.44	0.833	6.15	1.833	10.96	2.833	3.86	3.83
2.31	0.917	9.61	1.917	8.29	2.917	3.51	3.92
2.31	1.000	9.61	2.000	8.29	3.000	3.51	4.00

|ID= 1 DT= 5.0 min | Total Imp(%)= 98.00 Dir. Conn.(%)= 98.00

Surface Area	(ha)=	0.02	PERVIOUS (i)	0.00
Dep. Storage	(mm)=	1.00		5.00
Average Slope	(%)=	1.00		2.00
Length	(m)=	12.11		40.00
Mannings n	=	0.013		0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Max.Eff.Inten.(mm/hr)=	104.21	30.85	
over (min)	5.00	5.00	
Storage Coeff. (min)=	1.07 (ii)	2.80 (ii)	
Unit Hyd. Tpeak (min)=	5.00	5.00	
Unit Hyd. peak (cms)=	0.34	0.28	
*TOTALS*			
PEAK FLOW (cms)=	0.02	0.00	0.025 (iii)
TIME TO PEAK (hrs)=	1.33	1.33	1.33
RUNOFF VOLUME (mm)=	44.16	15.56	43.30
TOTAL RAINFALL (mm)=	45.16	45.16	45.16
RUNOFF COEFFICIENT =	0.98	0.34	0.96

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |  
| STANDHYD ( 0004) | Area (ha)= 0.05  
|ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

Surface Area	(ha)=	0.05	PERVIOUS (i)	0.00			
Dep. Storage	(mm)=	1.00		1.00			
Average Slope	(%)=	1.00		2.00			
Length	(m)=	17.59		40.00			
Mannings n	=	0.013		0.250			
NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.							
---- TRANSFORMED HYETOGRAPH ----							
RAIN	TIME	RAIN	TIME	RAIN	TIME		
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs		
3.22	0.083	2.68	1.083	24.17	2.083	6.69	3.08
3.22	0.167	2.68	1.167	24.17	2.167	6.69	3.17
2.98	0.250	3.10	1.250	104.21	2.250	5.63	3.25
2.98	0.333	3.10	1.333	104.21	2.333	5.63	3.33
2.77	0.417	3.68	1.417	32.03	2.417	4.87	3.42
2.77	0.500	3.68	1.500	32.03	2.500	4.87	3.50
2.60	0.583	4.58	1.583	16.34	2.583	4.30	3.58
2.60	0.667	4.58	1.667	16.34	2.667	4.30	3.67
2.44	0.750	6.15	1.750	10.96	2.750	3.86	3.75
2.44	0.833	6.15	1.833	10.96	2.833	3.86	3.83
2.31	0.917	9.61	1.917	8.29	2.917	3.51	3.92
2.31	1.000	9.61	2.000	8.29	3.000	3.51	4.00

Max.Eff.Inten.(mm/hr)=	104.21	30.85	
over (min)	5.00	5.00	
Storage Coeff. (min)=	0.71 (ii)	2.17 (ii)	
Unit Hyd. Tpeak (min)=	5.00	5.00	
Unit Hyd. peak (cms)=	0.34	0.31	
*TOTALS*			
PEAK FLOW (cms)=	0.01	0.00	0.006 (iii)
TIME TO PEAK (hrs)=	1.33	1.33	1.33
RUNOFF VOLUME (mm)=	44.16	15.56	43.59
TOTAL RAINFALL (mm)=	45.16	45.16	45.16
RUNOFF COEFFICIENT =	0.98	0.34	0.97

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD ( 0007)				
1 + 2 = 3				
	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 1 ( 0001):	0.09	0.025	1.33	43.30
+ ID2= 2 ( 0014):	0.02	0.006	1.33	43.59
=====				
ID = 3 ( 0007):	0.11	0.031	1.33	43.36

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD ( 0007)				
3 + 2 = 1				
	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 3 ( 0007):	0.11	0.031	1.33	43.36
+ ID2= 2 ( 0004):	0.05	0.013	1.33	44.14
=====				
ID = 1 ( 0007):	0.16	0.045	1.33	43.59

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

RESERVOIR( 0003)				
IN= 2---> OUT= 1				
DT= 5.0 min				
	OUTFLOW	STORAGE	OUTFLOW	STORAGE
	(cms)	(ha.m.)	(cms)	(ha.m.)
	0.0000	0.0000	0.0184	0.0017
	0.0179	0.0010	0.0187	0.0027
	0.0182	0.0011	0.0000	0.0000
=====				
	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 ( 0007)	0.156	0.045	1.33	43.59
OUTFLOW: ID= 1 ( 0003)	0.156	0.019	1.42	43.55

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 99.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |  
| STANDHYD ( 0014) | Area (ha)= 0.02

PEAK FLOW REDUCTION [Qout/Qin] (%)= 41.40  
TIME SHIFT OF PEAK FLOW (min)= 5.00  
MAXIMUM STORAGE USED (ha.m.)= 0.0021



Output filename: C:\Users\KimJo\AppData\Local\Civica\5f9falfb-87a1-436c-84fa-29e684f29ce0\3fd6a161-95ac-4054-9761-a718d909a9d2\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\5f9falfb-87a1-436c-84fa-29e684f29ce0\3fd6a161-95ac-4054-9761-a718d909a9d2\scenar

DATE: 05/25/2026 TIME: 11:43:42

USER:

COMMENTS: \_\_\_\_\_

```

-----
| CALIB |
| STANDHYD ( 0012) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 63.00 Dir. Conn.(%)= 63.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.03 0.02
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 18.26 40.00
Mannings n = 0.013 0.250
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----								
RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
3.22	0.083	2.68	1.083	24.17	2.083	6.69	3.08	
3.22	0.167	2.68	1.167	24.17	2.167	6.69	3.17	
2.98	0.250	3.10	1.250	104.21	2.250	5.63	3.25	
2.98	0.333	3.10	1.333	104.21	2.333	5.63	3.33	
2.77	0.417	3.68	1.417	32.03	2.417	4.87	3.42	
2.77	0.500	3.68	1.500	32.03	2.500	4.87	3.50	
2.60	0.583	4.58	1.583	16.34	2.583	4.30	3.58	
2.60	0.667	4.58	1.667	16.34	2.667	4.30	3.67	
2.44	0.750	6.15	1.750	10.96	2.750	3.86	3.75	
2.44	0.833	6.15	1.833	10.96	2.833	3.86	3.83	
2.31	0.917	9.61	1.917	8.29	2.917	3.51	3.92	
2.31	1.000	9.61	2.000	8.29	3.000	3.51	4.00	

```

Max.Eff.Inten.(mm/hr)= 104.21 25.45
over (min) = 5.00 15.00
Storage Coeff. (min)= 0.91 (ii) 13.11 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.34 0.08

PEAK FLOW (cms)= 0.01 0.00 0.009 (iii)
TIME TO PEAK (hrs)= 1.33 1.50 1.33
RUNOFF VOLUME (mm)= 44.16 15.56 33.43
TOTAL RAINFALL (mm)= 45.16 45.16 45.16
RUNOFF COEFFICIENT = 0.98 0.34 0.74
  
```

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0013) |
| 1 + 2 = 3 | AREA QPEAK TPEAK R.V.
| (ha) (cms) (hrs) (mm)
-----
ID1= 1 ( 0012): 0.05 0.009 1.33 33.43
+ ID2= 2 ( 0003): 0.16 0.019 1.42 43.55
=====
ID = 3 ( 0013): 0.21 0.028 1.33 41.10
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
V V I SSSSS U U A L (v 6.2.2015)
V V I SS U U A A L
V V I SS U U A A A A L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y M M O O
O O T T H H Y Y M M O O
OOO T T H H Y Y M M OOO
  
```

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voind.dat

```

-----
** SIMULATION : 010yr 4hr 10min Chicago Copy **
-----
  
```

```

-----
| CHICAGO STORM | IDF curve parameters: A=1174.184
| Ptotal= 52.56 mm | B= 6.010
-----
C= 0.816
used in: INTENSITY = A / (t + B)^C

Duration of storm = 4.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33
  
```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
3.71	0.00	3.09	1.00	28.10	2.00	7.73	3.00
3.71	0.17	3.57	1.17	122.17	2.17	6.50	3.17
3.43	0.33	4.25	1.33	37.28	2.33	5.62	3.33
3.20	0.50	5.29	1.50	18.95	2.50	4.97	3.50
2.99	0.67	7.11	1.67	12.70	2.67	4.46	3.67
2.81	0.83	11.13	1.83	9.59	2.83	4.05	3.83
2.66							

```

-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.01 0.04
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 17.89 40.00
Mannings n = 0.013 0.250
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----								
RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
3.71	0.083	3.09	1.083	28.10	2.083	7.73	3.08	
3.71	0.167	3.09	1.167	28.10	2.167	7.73	3.17	
3.43	0.250	3.57	1.250	122.17	2.250	6.50	3.25	
3.43	0.333	3.57	1.333	122.17	2.333	6.50	3.33	
3.20	0.417	4.25	1.417	37.28	2.417	5.62	3.42	
3.20	0.500	4.25	1.500	37.28	2.500	5.62	3.50	
2.99	0.583	5.29	1.583	18.95	2.583	4.97	3.58	
2.99	0.667	5.29	1.667	18.95	2.667	4.97	3.67	
2.81	0.750	7.11	1.750	12.70	2.750	4.46	3.75	
2.81	0.833	7.11	1.833	12.70	2.833	4.46	3.83	
2.81	0.917	11.13	1.917	9.59	2.917	4.05	3.92	
2.66	1.000	11.13	2.000	9.59	3.000	4.05	4.00	

```

Max.Eff.Inten.(mm/hr)= 122.17 42.11
over (min) = 5.00 15.00
Storage Coeff. (min)= 0.84 (ii) 10.81 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.34 0.09

PEAK FLOW (cms)= 0.00 0.00 0.006 (iii)
TIME TO PEAK (hrs)= 1.33 1.50 1.33
RUNOFF VOLUME (mm)= 51.56 20.37 28.65
TOTAL RAINFALL (mm)= 52.56 52.56 52.56
RUNOFF COEFFICIENT = 0.98 0.39 0.55
  
```



\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| CALIB          |
| STANDHYD ( 0001) | Area (ha)= 0.09
| ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00
-----

```

```

                IMPERVIOUS    PVIOUS (i)
Surface Area (ha)= 0.09      0.00
Dep. Storage (mm)= 1.00     5.00
Average Slope (%)= 1.00     2.00
Length (m)= 24.22          40.00
Mannings n   = 0.013       0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME  RAIN | TIME  RAIN | TIME  RAIN | TIME
mm/hr     hrs  mm/hr | hrs  mm/hr | hrs  mm/hr | hrs
-----
3.71      0.083  3.09 | 1.083 28.10 | 2.083  7.73 | 3.08
3.71      0.167  3.09 | 1.167 28.10 | 2.167  7.73 | 3.17
3.43      0.250  3.57 | 1.250 122.17 | 2.250  6.50 | 3.25
3.43      0.333  3.57 | 1.333 122.17 | 2.333  6.50 | 3.33
3.43      0.417  4.25 | 1.417 37.28 | 2.417  5.62 | 3.42
3.20      0.500  4.25 | 1.500 37.28 | 2.500  5.62 | 3.50
3.20      0.583  5.29 | 1.583 18.95 | 2.583  4.97 | 3.58
2.99      0.667  5.29 | 1.667 18.95 | 2.667  4.97 | 3.67
2.99      0.750  7.11 | 1.750 12.70 | 2.750  4.46 | 3.75
2.81      0.833  7.11 | 1.833 12.70 | 2.833  4.46 | 3.83
2.81      0.917 11.13 | 1.917  9.59 | 2.917  4.05 | 3.92
2.66      1.000 11.13 | 2.000  9.59 | 3.000  4.05 | 4.00
2.66

```

```

Max.Eff.Inten.(mm/hr)= 122.17      42.11
over (min)             = 5.00       5.00
Storage Coeff. (min)= 1.01 (ii)    2.63 (ii)
Unit Hyd. Tpeak (min)= 5.00       5.00
Unit Hyd. peak (cms)= 0.34        0.29
                *TOTALS*
PEAK FLOW (cms)= 0.03             0.00      0.029 (iii)
TIME TO PEAK (hrs)= 1.33          1.33      1.33
RUNOFF VOLUME (mm)= 51.56         20.37     50.62
TOTAL RAINFALL (mm)= 52.56        52.56     52.56
RUNOFF COEFFICIENT = 0.98         0.39      0.96

```

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| CALIB          |
| STANDHYD ( 0004) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00
-----

```

```

                IMPERVIOUS    PVIOUS (i)
Surface Area (ha)= 0.05      0.00
Dep. Storage (mm)= 1.00     1.00
Average Slope (%)= 1.00     2.00
Length (m)= 17.59          40.00
Mannings n   = 0.013       0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME  RAIN | TIME  RAIN | TIME  RAIN | TIME
mm/hr     hrs  mm/hr | hrs  mm/hr | hrs  mm/hr | hrs
-----
3.71      0.083  3.09 | 1.083 28.10 | 2.083  7.73 | 3.08
3.71      0.167  3.09 | 1.167 28.10 | 2.167  7.73 | 3.17
3.43      0.250  3.57 | 1.250 122.17 | 2.250  6.50 | 3.25
3.43      0.333  3.57 | 1.333 122.17 | 2.333  6.50 | 3.33
3.43

```

```

3.20      0.417  4.25 | 1.417 37.28 | 2.417  5.62 | 3.42
3.20      0.500  4.25 | 1.500 37.28 | 2.500  5.62 | 3.50
2.99      0.583  5.29 | 1.583 18.95 | 2.583  4.97 | 3.58
2.99      0.667  5.29 | 1.667 18.95 | 2.667  4.97 | 3.67
2.81      0.750  7.11 | 1.750 12.70 | 2.750  4.46 | 3.75
2.81      0.833  7.11 | 1.833 12.70 | 2.833  4.46 | 3.83
2.81      0.917 11.13 | 1.917  9.59 | 2.917  4.05 | 3.92
2.66      1.000 11.13 | 2.000  9.59 | 3.000  4.05 | 4.00
2.66

```

```

Max.Eff.Inten.(mm/hr)= 122.17      120.09
over (min)             = 5.00       5.00
Storage Coeff. (min)= 0.83 (ii)    1.87 (ii)
Unit Hyd. Tpeak (min)= 5.00       5.00
Unit Hyd. peak (cms)= 0.34        0.32

```

\*TOTALS\*

```

PEAK FLOW (cms)= 0.02             0.00      0.016 (iii)
TIME TO PEAK (hrs)= 1.33          1.33      1.33
RUNOFF VOLUME (mm)= 51.56         49.11     51.53
TOTAL RAINFALL (mm)= 52.56        52.56     52.56
RUNOFF COEFFICIENT = 0.98         0.93      0.98

```

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 99.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| CALIB          |
| STANDHYD ( 0014) | Area (ha)= 0.02
| ID= 1 DT= 5.0 min | Total Imp(%)= 98.00 Dir. Conn.(%)= 98.00
-----

```

```

                IMPERVIOUS    PVIOUS (i)
Surface Area (ha)= 0.02      0.00
Dep. Storage (mm)= 1.00     5.00
Average Slope (%)= 1.00     2.00
Length (m)= 12.11          40.00
Mannings n   = 0.013       0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN      TIME  RAIN | TIME  RAIN | TIME  RAIN | TIME
mm/hr     hrs  mm/hr | hrs  mm/hr | hrs  mm/hr | hrs
-----
3.71      0.083  3.09 | 1.083 28.10 | 2.083  7.73 | 3.08
3.71      0.167  3.09 | 1.167 28.10 | 2.167  7.73 | 3.17
3.43      0.250  3.57 | 1.250 122.17 | 2.250  6.50 | 3.25
3.43      0.333  3.57 | 1.333 122.17 | 2.333  6.50 | 3.33
3.43      0.417  4.25 | 1.417 37.28 | 2.417  5.62 | 3.42
3.20      0.500  4.25 | 1.500 37.28 | 2.500  5.62 | 3.50
2.99      0.583  5.29 | 1.583 18.95 | 2.583  4.97 | 3.58
2.99      0.667  5.29 | 1.667 18.95 | 2.667  4.97 | 3.67
2.81      0.750  7.11 | 1.750 12.70 | 2.750  4.46 | 3.75
2.81      0.833  7.11 | 1.833 12.70 | 2.833  4.46 | 3.83
2.81      0.917 11.13 | 1.917  9.59 | 2.917  4.05 | 3.92
2.66      1.000 11.13 | 2.000  9.59 | 3.000  4.05 | 4.00
2.66

```

```

Max.Eff.Inten.(mm/hr)= 122.17      42.11
over (min)             = 5.00       5.00
Storage Coeff. (min)= 0.66 (ii)    2.04 (ii)
Unit Hyd. Tpeak (min)= 5.00       5.00
Unit Hyd. peak (cms)= 0.34        0.31

```

\*TOTALS\*

```

PEAK FLOW (cms)= 0.01             0.00      0.007 (iii)
TIME TO PEAK (hrs)= 1.33          1.33      1.33
RUNOFF VOLUME (mm)= 51.56         20.37     50.93
TOTAL RAINFALL (mm)= 52.56        52.56     52.56
RUNOFF COEFFICIENT = 0.98         0.39      0.97

```

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.



```

-----
| ADD HYD ( 0007) |
| 1 + 2 = 3 |
-----
AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 1 ( 0001): 0.09 0.029 1.33 50.62
+ ID2= 2 ( 0014): 0.02 0.007 1.33 50.93
=====
ID = 3 ( 0007): 0.11 0.037 1.33 50.68

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0007) |
| 3 + 2 = 1 |
-----
AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 3 ( 0007): 0.11 0.037 1.33 50.68
+ ID2= 2 ( 0004): 0.05 0.016 1.33 51.53
=====
ID = 1 ( 0007): 0.16 0.052 1.33 50.94

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0003) | OVERFLOW IS OFF
| IN= 2--> OUT= 1 |
| DT= 5.0 min |
-----
OUTFLOW STORAGE | OUTFLOW STORAGE
(cms) (ha.m.) | (cms) (ha.m.)
0.0000 0.0000 | 0.0184 0.0017
0.0179 0.0010 | 0.0187 0.0027
0.0182 0.0011 | 0.0000 0.0000
-----
AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
INFLOW : ID= 2 ( 0007) 0.156 0.052 1.33 50.94
OUTFLOW: ID= 1 ( 0003) 0.156 0.019 1.42 50.89

```

PEAK FLOW REDUCTION [Qout/Qin](%) = 35.54  
 TIME SHIFT OF PEAK FLOW (min) = 5.00  
 MAXIMUM STORAGE USED (ha.m.) = 0.0026

```

-----
| CALIB |
| STANDHYD ( 0012) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 63.00 Dir. Conn.(%)= 63.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.03 0.02
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 18.26 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

-----
--- TRANSFORMED HYETOGRAPH ---
RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME
mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
3.71 0.083 3.09 | 1.083 28.10 | 2.083 7.73 | 3.08
3.71 0.167 3.09 | 1.167 28.10 | 2.167 7.73 | 3.17
3.43 0.250 3.57 | 1.250 122.17 | 2.250 6.50 | 3.25
3.43 0.333 3.57 | 1.333 122.17 | 2.333 6.50 | 3.33
3.20 0.417 4.25 | 1.417 37.28 | 2.417 5.62 | 3.42
3.20 0.500 4.25 | 1.500 37.28 | 2.500 5.62 | 3.50
2.99 0.583 5.29 | 1.583 18.95 | 2.583 4.97 | 3.58
2.99 0.667 5.29 | 1.667 18.95 | 2.667 4.97 | 3.67
2.81 0.750 7.11 | 1.750 12.70 | 2.750 4.46 | 3.75
2.81 0.833 7.11 | 1.833 12.70 | 2.833 4.46 | 3.83
2.66 0.917 11.13 | 1.917 9.59 | 2.917 4.05 | 3.92
2.66 1.000 11.13 | 2.000 9.59 | 3.000 4.05 | 4.00

```

```

Max.Eff.Inten.(mm/hr)= 122.17 42.11
over (min) 5.00 15.00
Storage Coeff. (min)= 0.85 (ii) 10.82 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.34 0.09
-----
*TOTALS*
PEAK FLOW (cms)= 0.01 0.00 0.011 (iii)
TIME TO PEAK (hrs)= 1.33 1.50 1.33
RUNOFF VOLUME (mm)= 51.56 20.37 39.85
TOTAL RAINFALL (mm)= 52.56 52.56 52.56
RUNOFF COEFFICIENT = 0.98 0.39 0.76

```

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL

THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0013) |
| 1 + 2 = 3 |
-----
AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 1 ( 0012): 0.05 0.011 1.33 39.85
+ ID2= 2 ( 0003): 0.16 0.019 1.42 50.89
=====
ID = 3 ( 0013): 0.21 0.030 1.33 48.22

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

V V I SSSSS U U A L (v 6.2.2015)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

```

```

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

```

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voin.dat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87al-436c-84fa-29e684f29ce0\32aaa68e-1688-4d17-94ad-e94a96a5aead\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87al-436c-84fa-29e684f29ce0\32aaa68e-1688-4d17-94ad-e94a96a5aead\scenar

DATE: 05/25/2026 TIME: 11:43:43

USER:

COMMENTS:

```

*****
** SIMULATION : 025yr 4hr 10min Chicago Copy **
*****

```

```

| CHICAGO STORM | IDF curve parameters: A=1402.884
| Ptotal= 61.76 mm | B= 6.020
C= 0.819

```

used in: INTENSITY = A / (t + B)<sup>C</sup>

Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

```

RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME
mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
0.00 0.00 3.58 | 1.00 33.04 | 2.00 9.01 | 3.00
4.31 0.17 4.14 | 1.17 144.68 | 2.17 7.57 | 3.17
3.98 0.33 4.93 | 1.33 43.91 | 2.33 6.54 | 3.33
3.71 0.50 6.15 | 1.50 22.23 | 2.50 5.78 | 3.50
3.47 0.67 8.28 | 1.67 14.85 | 2.67 5.18 | 3.67
3.26 0.83 13.01 | 1.83 11.19 | 2.83 4.70 | 3.83
3.08

```

```

-----
| CALIB |
| STANDHYD ( 0009) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00
-----

```

```

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.01 0.04
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 17.89 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.



---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 57.63  
over (min) 5.00 10.00  
Storage Coeff. (min)= 0.78 (ii) 9.58 (ii)  
Unit Hyd. Tpeak (min)= 5.00 10.00  
Unit Hyd. peak (cms)= 0.34 0.11

\*TOTALS\*

PEAK FLOW (cms)= 0.01 0.00 0.008 (iii)  
TIME TO PEAK (hrs)= 1.33 1.42 1.33  
RUNOFF VOLUME (mm)= 60.76 26.79 35.87  
TOTAL RAINFALL (mm)= 61.76 61.76 61.76  
RUNOFF COEFFICIENT = 0.98 0.43 0.58

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
| CALIB |  
| STANHYD ( 0001) | Area (ha)= 0.09  
| ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00  
-----

IMPERVIOUS PVIOUS (i)  
Surface Area (ha)= 0.09 0.00  
Dep. Storage (mm)= 1.00 5.00  
Average Slope (%)= 1.00 2.00  
Length (m)= 24.22 40.00  
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 57.63  
over (min) 5.00 5.00  
Storage Coeff. (min)= 0.94 (ii) 2.46 (ii)  
Unit Hyd. Tpeak (min)= 5.00 5.00  
Unit Hyd. peak (cms)= 0.34 0.30

\*TOTALS\*

PEAK FLOW (cms)= 0.03 0.00 0.035 (iii)  
TIME TO PEAK (hrs)= 1.33 1.33 1.33  
RUNOFF VOLUME (mm)= 60.76 26.79 59.74  
TOTAL RAINFALL (mm)= 61.76 61.76 61.76

RUNOFF COEFFICIENT = 0.98 0.43 0.97

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
| CALIB |  
| STANHYD ( 0004) | Area (ha)= 0.05  
| ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00  
-----

IMPERVIOUS PVIOUS (i)  
Surface Area (ha)= 0.05 0.00  
Dep. Storage (mm)= 1.00 1.00  
Average Slope (%)= 1.00 2.00  
Length (m)= 17.59 40.00  
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 142.85  
over (min) 5.00 5.00  
Storage Coeff. (min)= 0.78 (ii) 1.75 (ii)  
Unit Hyd. Tpeak (min)= 5.00 5.00  
Unit Hyd. peak (cms)= 0.34 0.32

\*TOTALS\*

PEAK FLOW (cms)= 0.02 0.00 0.019 (iii)  
TIME TO PEAK (hrs)= 1.33 1.33 1.33  
RUNOFF VOLUME (mm)= 60.76 58.30 60.74  
TOTAL RAINFALL (mm)= 61.76 61.76 61.76  
RUNOFF COEFFICIENT = 0.98 0.94 0.98

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

(i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 99.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
| CALIB |  
| STANHYD ( 0014) | Area (ha)= 0.02  
| ID= 1 DT= 5.0 min | Total Imp(%)= 98.00 Dir. Conn.(%)= 98.00  
-----

IMPERVIOUS PVIOUS (i)  
Surface Area (ha)= 0.02 0.00  
Dep. Storage (mm)= 1.00 5.00  
Average Slope (%)= 1.00 2.00  
Length (m)= 12.11 40.00  
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.31	0.083	3.58	1.083	33.04	2.083	9.01	3.08
4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33



3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.26	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.08	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 57.63  
 over (min) 5.00 5.00  
 Storage Coeff. (min)= 0.62 (ii) 1.90 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 5.00  
 Unit Hyd. peak (cms)= 0.34 0.32

\*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.009 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.33 1.33  
 RUNOFF VOLUME (mm)= 60.76 26.79 60.08  
 TOTAL RAINFALL (mm)= 61.76 61.76 61.76  
 RUNOFF COEFFICIENT = 0.98 0.43 0.97

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

| ADD HYD ( 0007) |
| 1 + 2 = 3 |
-----
ID1= 1 ( 0001): 0.09 0.035 1.33 59.74
+ ID2= 2 ( 0014): 0.02 0.009 1.33 60.08
=====
ID = 3 ( 0007): 0.11 0.044 1.33 59.81
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

| ADD HYD ( 0007) |
| 3 + 2 = 1 |
-----
ID1= 3 ( 0007): 0.11 0.044 1.33 59.81
+ ID2= 2 ( 0004): 0.05 0.019 1.33 60.74
=====
ID = 1 ( 0007): 0.16 0.062 1.33 60.09
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

| RESERVOIR( 0003) | OVERFLOW IS OFF
| IN= 2--> OUT= 1 |
| DT= 5.0 min |
-----
OUTFLOW STORAGE | OUTFLOW STORAGE
(cms) (ha.m.) | (cms) (ha.m.)
0.0000 0.0000 | 0.0184 0.0017
0.0179 0.0010 | 0.0187 0.0027
0.0182 0.0011 | 0.0000 0.0000
  
```

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 ( 0007)	0.156	0.062	1.33	60.09
OUTFLOW: ID= 1 ( 0003)	0.156	0.019	1.50	60.03

PEAK FLOW REDUCTION [Qout/Qin](%) = 30.29  
 TIME SHIFT OF PEAK FLOW (min) = 10.00  
 MAXIMUM STORAGE USED (ha.m.) = 0.0032

```

| CALIB |
| STANDHYD ( 0012) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 63.00 Dir. Conn.(%)= 63.00
  
```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)	0.03	0.02
Dep. Storage (mm)	1.00	5.00
Average Slope (%)	1.00	2.00
Length (m)	18.26	40.00
Mannings n	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

-----
--- TRANSFORMED HYETOGRAPH ---
TIME RAIN | TIME RAIN | TIME RAIN | TIME
RAIN hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
mm/hr
4.31 0.083 3.58 | 1.083 33.04 | 2.083 9.01 | 3.08
  
```

4.31	0.167	3.58	1.167	33.04	2.167	9.01	3.17
3.98	0.250	4.14	1.250	144.68	2.250	7.57	3.25
3.98	0.333	4.14	1.333	144.68	2.333	7.57	3.33
3.71	0.417	4.93	1.417	43.91	2.417	6.54	3.42
3.71	0.500	4.93	1.500	43.91	2.500	6.54	3.50
3.47	0.583	6.15	1.583	22.23	2.583	5.78	3.58
3.47	0.667	6.15	1.667	22.23	2.667	5.78	3.67
3.47	0.750	8.28	1.750	14.85	2.750	5.18	3.75
3.26	0.833	8.28	1.833	14.85	2.833	5.18	3.83
3.26	0.917	13.01	1.917	11.19	2.917	4.70	3.92
3.08	1.000	13.01	2.000	11.19	3.000	4.70	4.00

Max.Eff.Inten.(mm/hr)= 144.68 57.63  
 over (min) 5.00 10.00  
 Storage Coeff. (min)= 0.79 (ii) 5.72 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 10.00  
 Unit Hyd. peak (cms)= 0.34 0.15

\*TOTALS\*  
 PEAK FLOW (cms)= 0.01 0.00 0.015 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 60.76 26.79 48.10  
 TOTAL RAINFALL (mm)= 61.76 61.76 61.76  
 RUNOFF COEFFICIENT = 0.98 0.43 0.78

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!  
 (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

| ADD HYD ( 0013) |
| 1 + 2 = 3 |
-----
ID1= 1 ( 0012): 0.05 0.015 1.33 48.10
+ ID2= 2 ( 0003): 0.16 0.019 1.50 60.03
=====
ID = 3 ( 0013): 0.21 0.033 1.33 57.14
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

V V I SSSS U U A L (v 6.2.2015)
V V I SS U U A A L
V V I SS U U A A A A L
V V I SS U U A A L
VV I SSSS UUUU A A LLLL
  
```

```

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y Y M M O O
OOO T T H H Y Y M M OOO
  
```

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voindat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87a1-436c-84fa-29e684f29ce0\ae9c6d1d-4146-4a3e-9e23-728e819f5d3c\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-87a1-436c-84fa-29e684f29ce0\ae9c6d1d-4146-4a3e-9e23-728e819f5d3c\scenar

DATE: 05/25/2026 TIME: 11:43:43

USER:

COMMENTS:

```

*****
** SIMULATION : 050yr 4hr 10min Chicago Copy **
*****
  
```

```

| CHICAGO STORM | IDF curve parameters: A=1569.580
| Ptotal= 68.73 mm | B= 6.010
| | C= 0.820
-----
used in: INTENSITY = A / (t + B)^C
  
```



Duration of storm = 4.00 hrs  
 Storm time step = 10.00 min  
 Time to peak ratio = 0.33

RAIN mm/hr	TIME hrs	RAIN		TIME		RAIN		TIME	
		mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.00	3.97	1.00	36.76	2.00	10.00	3.00		
4.41	0.17	4.59	1.17	161.50	2.17	8.40	3.17		
4.10	0.33	5.47	1.33	48.87	2.33	7.26	3.33		
3.84	0.50	6.82	1.50	24.70	2.50	6.40	3.50		
3.61	0.67	9.19	1.67	16.49	2.67	5.74	3.67		
3.41	0.83	14.44	1.83	12.42	2.83	5.21	3.83		

-----  
 | CALIB |  
 | STANDHYD ( 0009) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00  
 -----

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.01	0.04
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	17.89	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

RAIN mm/hr	TIME hrs	RAIN		TIME		RAIN		TIME	
		mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.083	3.97	1.083	36.76	2.083	10.00	3.08		
4.77	0.167	3.97	1.167	36.76	2.167	10.00	3.17		
4.41	0.250	4.59	1.250	161.50	2.250	8.40	3.25		
4.41	0.333	4.59	1.333	161.50	2.333	8.40	3.33		
4.10	0.417	5.47	1.417	48.87	2.417	7.26	3.42		
4.10	0.500	5.47	1.500	48.87	2.500	7.26	3.50		
3.84	0.583	6.82	1.583	24.70	2.583	6.40	3.58		
3.84	0.667	6.82	1.667	24.70	2.667	6.40	3.67		
3.61	0.750	9.19	1.750	16.49	2.750	5.74	3.75		
3.61	0.833	9.19	1.833	16.49	2.833	5.74	3.83		
3.41	0.917	14.44	1.917	12.42	2.917	5.21	3.92		
3.41	1.000	14.44	2.000	12.42	3.000	5.21	4.00		

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.01	0.04
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	17.89	40.00
Mannings n =	0.013	0.250

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0001) | Area (ha)= 0.09  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00  
 -----

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.09	0.00
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	24.22	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN mm/hr	TIME hrs	RAIN		TIME		RAIN		TIME	
		mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.083	3.97	1.083	36.76	2.083	10.00	3.08		
4.77	0.167	3.97	1.167	36.76	2.167	10.00	3.17		
4.41	0.250	4.59	1.250	161.50	2.250	8.40	3.25		
4.41	0.333	4.59	1.333	161.50	2.333	8.40	3.33		
4.10	0.417	5.47	1.417	48.87	2.417	7.26	3.42		
4.10	0.500	5.47	1.500	48.87	2.500	7.26	3.50		
3.84	0.583	6.82	1.583	24.70	2.583	6.40	3.58		
3.84	0.667	6.82	1.667	24.70	2.667	6.40	3.67		
3.61	0.750	9.19	1.750	16.49	2.750	5.74	3.75		
3.61	0.833	9.19	1.833	16.49	2.833	5.74	3.83		
3.41	0.917	14.44	1.917	12.42	2.917	5.21	3.92		
3.41	1.000	14.44	2.000	12.42	3.000	5.21	4.00		

	IMPERVIOUS	PERVIOUS (i)
Max.Eff.Inten.(mm/hr)=	161.50	70.15
over (min)=	5.00	5.00
Storage Coeff. (min)=	0.90 (ii)	2.35 (ii)
Unit Hyd. Tpeak (min)=	5.00	5.00
Unit Hyd. peak (cms)=	0.34	0.30

	IMPERVIOUS	PERVIOUS (i)	*TOTALS*
PEAK FLOW (cms)=	0.04	0.00	0.039 (iii)
TIME TO PEAK (hrs)=	1.33	1.33	1.33
RUNOFF VOLUME (mm)=	67.73	31.92	66.65
TOTAL RAINFALL (mm)=	68.73	68.73	68.73
RUNOFF COEFFICIENT =	0.99	0.46	0.97

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0004) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00  
 -----

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.05	0.00
Dep. Storage (mm)=	1.00	1.00
Average Slope (%)=	1.00	2.00
Length (m)=	17.59	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

RAIN mm/hr	TIME hrs	RAIN		TIME		RAIN		TIME	
		mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
4.77	0.083	3.97	1.083	36.76	2.083	10.00	3.08		
4.77	0.167	3.97	1.167	36.76	2.167	10.00	3.17		
4.41	0.250	4.59	1.250	161.50	2.250	8.40	3.25		
4.41	0.333	4.59	1.333	161.50	2.333	8.40	3.33		
4.10	0.417	5.47	1.417	48.87	2.417	7.26	3.42		
4.10	0.500	5.47	1.500	48.87	2.500	7.26	3.50		
3.84	0.583	6.82	1.583	24.70	2.583	6.40	3.58		
3.84	0.667	6.82	1.667	24.70	2.667	6.40	3.67		
3.61	0.750	9.19	1.750	16.49	2.750	5.74	3.75		
3.61	0.833	9.19	1.833	16.49	2.833	5.74	3.83		
3.41	0.917	14.44	1.917	12.42	2.917	5.21	3.92		
3.41	1.000	14.44	2.000	12.42	3.000	5.21	4.00		

	IMPERVIOUS	PERVIOUS (i)
Max.Eff.Inten.(mm/hr)=	161.50	159.83
over (min)=	5.00	5.00
Storage Coeff. (min)=	0.74 (ii)	1.67 (ii)
Unit Hyd. Tpeak (min)=	5.00	5.00
Unit Hyd. peak (cms)=	0.34	0.32

	IMPERVIOUS	PERVIOUS (i)	*TOTALS*
PEAK FLOW (cms)=	0.02	0.00	0.021 (iii)
TIME TO PEAK (hrs)=	1.33	1.33	1.33
RUNOFF VOLUME (mm)=	67.73	65.25	67.70
TOTAL RAINFALL (mm)=	68.73	68.73	68.73



RUNOFF COEFFICIENT = 0.99 0.95 0.99

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES: CN\* = 99.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----
| CALIB |
| STANDHYD ( 0014) | Area (ha)= 0.02
| ID= 1 DT= 5.0 min | Total Imp(%)= 98.00 Dir. Conn.(%)= 98.00
-----

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.02 0.00
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 12.11 40.00
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Table with 8 columns: TIME, RAIN, TIME, RAIN, TIME, RAIN, TIME, RAIN. Rows show rainfall data for various times and rates.

Max.Eff.Inten.(mm/hr)= 161.50 70.15
over (min) 5.00 5.00
Storage Coeff. (min)= 0.59 (ii) 1.82 (ii)
Unit Hyd. Tpeak (min)= 5.00 5.00
Unit Hyd. peak (cms)= 0.34 0.32
\*TOTALS\*
PEAK FLOW (cms)= 0.01 0.00 0.010 (iii)
TIME TO PEAK (hrs)= 1.33 1.33 1.33
RUNOFF VOLUME (mm)= 67.73 31.92 67.01
TOTAL RAINFALL (mm)= 68.73 68.73 68.73
RUNOFF COEFFICIENT = 0.99 0.46 0.98

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES: CN\* = 80.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----
| ADD HYD ( 0007) |
| 1 + 2 = 3 | AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 1 ( 0001): 0.09 0.039 1.33 66.65
+ ID2= 2 ( 0014): 0.02 0.010 1.33 67.01
ID = 3 ( 0007): 0.11 0.049 1.33 66.72
NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----
| ADD HYD ( 0007) |
| 3 + 2 = 1 | AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 3 ( 0007): 0.11 0.049 1.33 66.72
+ ID2= 2 ( 0004): 0.05 0.021 1.33 67.70
ID = 1 ( 0007): 0.16 0.069 1.33 67.01
NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----
| RESERVOIR( 0003) | OVERFLOW IS OFF
-----

| IN= 2---> OUT= 1 |
DT= 5.0 min
OUTFLOW STORAGE | OUTFLOW STORAGE
(cms) (ha.m.) | (cms) (ha.m.)
0.0000 0.0000 | 0.0184 0.0017
0.0179 0.0010 | 0.0187 0.0027
0.0182 0.0011 | 0.0000 0.0000

AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
INFLOW : ID= 2 ( 0007) 0.156 0.069 1.33 67.01
OUTFLOW: ID= 1 ( 0003) 0.156 0.019 1.50 66.95

PEAK FLOW REDUCTION [Qout/Qin](%)= 27.35
TIME SHIFT OF PEAK FLOW (min)= 10.00
MAXIMUM STORAGE USED (ha.m.)= 0.0039

-----
| CALIB |
| STANDHYD ( 0012) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 63.00 Dir. Conn.(%)= 63.00
-----

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.03 0.02
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 18.26 40.00
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

Table with 8 columns: TIME, RAIN, TIME, RAIN, TIME, RAIN, TIME, RAIN. Rows show rainfall data for various times and rates.

Max.Eff.Inten.(mm/hr)= 161.50 70.15
over (min) 5.00 10.00
Storage Coeff. (min)= 0.76 (ii) 5.47 (ii)
Unit Hyd. Tpeak (min)= 5.00 10.00
Unit Hyd. peak (cms)= 0.34 0.16

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES: CN\* = 80.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----
| ADD HYD ( 0013) |
| 1 + 2 = 3 | AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 1 ( 0012): 0.05 0.017 1.33 54.44
+ ID2= 2 ( 0003): 0.16 0.019 1.50 66.95
ID = 3 ( 0013): 0.21 0.035 1.33 63.92
NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----
| ADD HYD ( 0007) |
| 3 + 2 = 1 | AREA QPEAK TPEAK R.V.
(ha) (cms) (hrs) (mm)
ID1= 3 ( 0007): 0.11 0.049 1.33 66.72
+ ID2= 2 ( 0004): 0.05 0.021 1.33 67.70
ID = 1 ( 0007): 0.16 0.069 1.33 67.01
NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.



```

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y M M O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO
Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2022 Smart City Water Inc
All rights reserved.

```

1.000 15.97 | 2.000 13.74 | 3.000 5.76 | 4.00

```

Max.Eff.Inten.(mm/hr)= 178.60 83.65
over (min) 5.00 10.00
Storage Coeff. (min)= 0.72 (ii) 8.30 (ii)
Unit Hyd. Tpeak (min)= 5.00 10.00
Unit Hyd. peak (cms)= 0.34 0.13

```

\*\*\*\*\* DETAILED OUTPUT \*\*\*\*\*

```

Input filename: C:\Program Files (x86)\Visual OTTHYMO
6.2\VO2\voindat
Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-
87a1-436c-84fa-29e684f29ce0\9a038490-6e6c-46f4-8ca4-c741903fd9f2\scenar
Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-
87a1-436c-84fa-29e684f29ce0\9a038490-6e6c-46f4-8ca4-c741903fd9f2\scenar

```

DATE: 05/25/2026 TIME: 11:43:43  
 USER:

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

COMMENTS: \_\_\_\_\_

```

| CALIB |
| STANDHYD ( 0001) | Area (ha)= 0.09
| ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00

```

```

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.09 0.00
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 24.22 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

| CHICAGO STORM | IDF curve parameters: A=1735.688
| Ptotal= 76.00 mm | B= 6.010
C= 0.820
used in: INTENSITY = A / (t + B)^C

```

```

Duration of storm = 4.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33

```

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
5.28	0.00	4.39	1.00	40.65	2.00	11.06	3.00
4.88	0.17	5.07	1.17	178.60	2.17	9.28	3.17
4.54	0.33	6.05	1.33	54.04	2.33	8.02	3.33
4.25	0.50	7.54	1.50	27.31	2.50	7.08	3.50
3.99	0.67	10.16	1.67	18.24	2.67	6.35	3.67
3.77	0.83	15.97	1.83	13.74	2.83	5.76	3.83

```

----- TRANSFORMED HYETOGRAPH -----
RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME
mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
0.083 4.39 | 1.083 40.65 | 2.083 11.06 | 3.08
5.28 0.167 4.39 | 1.167 40.65 | 2.167 11.06 | 3.17
5.28 0.250 5.07 | 1.250 178.60 | 2.250 9.28 | 3.25
4.88 0.333 5.07 | 1.333 178.60 | 2.333 9.28 | 3.33
4.88 0.417 6.05 | 1.417 54.04 | 2.417 8.02 | 3.42
4.54 0.500 6.05 | 1.500 54.04 | 2.500 8.02 | 3.50
4.54 0.583 7.54 | 1.583 27.31 | 2.583 7.08 | 3.58
4.25 0.667 7.54 | 1.667 27.31 | 2.667 7.08 | 3.67
4.25 0.750 10.16 | 1.750 18.24 | 2.750 6.35 | 3.75
3.99 0.833 10.16 | 1.833 18.24 | 2.833 6.35 | 3.83
3.77 0.917 15.97 | 1.917 13.74 | 2.917 5.76 | 3.92
3.77 1.000 15.97 | 2.000 13.74 | 3.000 5.76 | 4.00

```

```

| CALIB |
| STANDHYD ( 0009) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00

```

```

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.01 0.04
Dep. Storage (mm)= 1.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 17.89 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

```

Max.Eff.Inten.(mm/hr)= 178.60 83.65
over (min) 5.00 5.00
Storage Coeff. (min)= 0.87 (ii) 2.26 (ii)
Unit Hyd. Tpeak (min)= 5.00 5.00
Unit Hyd. peak (cms)= 0.34 0.30

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

----- TRANSFORMED HYETOGRAPH -----
RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME
mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs
0.083 4.39 | 1.083 40.65 | 2.083 11.06 | 3.08
5.28 0.167 4.39 | 1.167 40.65 | 2.167 11.06 | 3.17
5.28 0.250 5.07 | 1.250 178.60 | 2.250 9.28 | 3.25
4.88 0.333 5.07 | 1.333 178.60 | 2.333 9.28 | 3.33
4.88 0.417 6.05 | 1.417 54.04 | 2.417 8.02 | 3.42
4.54 0.500 6.05 | 1.500 54.04 | 2.500 8.02 | 3.50
4.54 0.583 7.54 | 1.583 27.31 | 2.583 7.08 | 3.58
4.25 0.667 7.54 | 1.667 27.31 | 2.667 7.08 | 3.67
4.25 0.750 10.16 | 1.750 18.24 | 2.750 6.35 | 3.75
3.99 0.833 10.16 | 1.833 18.24 | 2.833 6.35 | 3.83
3.99 0.917 15.97 | 1.917 13.74 | 2.917 5.76 | 3.92
3.77 1.000 15.97 | 2.000 13.74 | 3.000 5.76 | 4.00

```

```

| CALIB |
| STANDHYD ( 0004) | Area (ha)= 0.05
| ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

```

```

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.05 0.00
Dep. Storage (mm)= 1.00 1.00
Average Slope (%)= 1.00 2.00
Length (m)= 17.59 40.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.



---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
5.28	0.083	4.39	1.083	40.65	2.083	11.06	3.08
5.28	0.167	4.39	1.167	40.65	2.167	11.06	3.17
4.88	0.250	5.07	1.250	178.60	2.250	9.28	3.25
4.88	0.333	5.07	1.333	178.60	2.333	9.28	3.33
4.54	0.417	6.05	1.417	54.04	2.417	8.02	3.42
4.54	0.500	6.05	1.500	54.04	2.500	8.02	3.50
4.25	0.583	7.54	1.583	27.31	2.583	7.08	3.58
4.25	0.667	7.54	1.667	27.31	2.667	7.08	3.67
3.99	0.750	10.16	1.750	18.24	2.750	6.35	3.75
3.99	0.833	10.16	1.833	18.24	2.833	6.35	3.83
3.77	0.917	15.97	1.917	13.74	2.917	5.76	3.92
3.77	1.000	15.97	2.000	13.74	3.000	5.76	4.00

Max.Eff.Inten.(mm/hr)= 178.60 177.06  
over (min) 5.00 5.00  
Storage Coeff. (min)= 0.71 (ii) 1.60 (ii)  
Unit Hyd. Tpeak (min)= 5.00 5.00  
Unit Hyd. peak (cms)= 0.34 0.32

\*TOTALS\*

PEAK FLOW (cms)= 0.02 0.00 0.023 (iii)  
TIME TO PEAK (hrs)= 1.33 1.33 1.33  
RUNOFF VOLUME (mm)= 75.00 72.52 74.97  
TOTAL RAINFALL (mm)= 76.00 76.00 76.00  
RUNOFF COEFFICIENT = 0.99 0.95 0.99

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 99.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----

Area (ha)= 0.02	Dir. Conn.(%)= 98.00
Total Imp(%)= 98.00	

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.02	0.00
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	12.11	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
5.28	0.083	4.39	1.083	40.65	2.083	11.06	3.08
5.28	0.167	4.39	1.167	40.65	2.167	11.06	3.17
4.88	0.250	5.07	1.250	178.60	2.250	9.28	3.25
4.88	0.333	5.07	1.333	178.60	2.333	9.28	3.33
4.54	0.417	6.05	1.417	54.04	2.417	8.02	3.42
4.54	0.500	6.05	1.500	54.04	2.500	8.02	3.50
4.25	0.583	7.54	1.583	27.31	2.583	7.08	3.58
4.25	0.667	7.54	1.667	27.31	2.667	7.08	3.67
3.99	0.750	10.16	1.750	18.24	2.750	6.35	3.75
3.99	0.833	10.16	1.833	18.24	2.833	6.35	3.83
3.77	0.917	15.97	1.917	13.74	2.917	5.76	3.92
3.77	1.000	15.97	2.000	13.74	3.000	5.76	4.00

Max.Eff.Inten.(mm/hr)= 178.60 83.65  
over (min) 5.00 5.00  
Storage Coeff. (min)= 0.57 (ii) 1.75 (ii)  
Unit Hyd. Tpeak (min)= 5.00 5.00  
Unit Hyd. peak (cms)= 0.34 0.32

\*TOTALS\*

PEAK FLOW (cms)= 0.01 0.00 0.011 (iii)  
TIME TO PEAK (hrs)= 1.33 1.33 1.33  
RUNOFF VOLUME (mm)= 75.00 37.48 74.25  
TOTAL RAINFALL (mm)= 76.00 76.00 76.00

RUNOFF COEFFICIENT = 0.99 0.49 0.98

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----

ADD HYD ( 0007)	AREA	QPEAK	TPEAK	R.V.
1 + 2 = 3	(ha)	(cms)	(hrs)	(mm)
ID1= 1 ( 0001):	0.09	0.043	1.33	73.87
+ ID2= 2 ( 0014):	0.02	0.011	1.33	74.25
ID = 3 ( 0007):	0.11	0.054	1.33	73.95

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----

ADD HYD ( 0007)	AREA	QPEAK	TPEAK	R.V.
3 + 2 = 1	(ha)	(cms)	(hrs)	(mm)
ID1= 3 ( 0007):	0.11	0.054	1.33	73.95
+ ID2= 2 ( 0004):	0.05	0.023	1.33	74.97
ID = 1 ( 0007):	0.16	0.077	1.33	74.25

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----

RESERVOIR ( 0003)	OVERFLOW IS OFF
IN= 2---> OUT= 1	
DT= 5.0 min	
OUTFLOW (cms)	STORAGE (ha.m.)
0.0000	0.0000
0.0179	0.0010
0.0182	0.0011

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 ( 0007)	0.156	0.077	1.33	74.25
OUTFLOW: ID= 1 ( 0003)	0.156	0.019	1.50	74.19

PEAK FLOW REDUCTION [Qout/Qin] (%) = 24.93  
TIME SHIFT OF PEAK FLOW (min) = 10.00  
MAXIMUM STORAGE USED (ha.m.) = 0.0045

-----

Area (ha)= 0.05	Dir. Conn.(%)= 63.00
Total Imp(%)= 63.00	

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.03	0.02
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	18.26	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
5.28	0.083	4.39	1.083	40.65	2.083	11.06	3.08
5.28	0.167	4.39	1.167	40.65	2.167	11.06	3.17
4.88	0.250	5.07	1.250	178.60	2.250	9.28	3.25
4.88	0.333	5.07	1.333	178.60	2.333	9.28	3.33
4.54	0.417	6.05	1.417	54.04	2.417	8.02	3.42
4.54	0.500	6.05	1.500	54.04	2.500	8.02	3.50
4.25	0.583	7.54	1.583	27.31	2.583	7.08	3.58
4.25	0.667	7.54	1.667	27.31	2.667	7.08	3.67
3.99	0.750	10.16	1.750	18.24	2.750	6.35	3.75
3.99	0.833	10.16	1.833	18.24	2.833	6.35	3.83
3.77	0.917	15.97	1.917	13.74	2.917	5.76	3.92
3.77	1.000	15.97	2.000	13.74	3.000	5.76	4.00

Max.Eff.Inten.(mm/hr)= 178.60 83.65  
over (min) 5.00 10.00  
Storage Coeff. (min)= 0.73 (ii) 5.25 (ii)  
Unit Hyd. Tpeak (min)= 5.00 10.00



Unit Hyd. peak (cms)= 0.34 0.16  
 PEAK FLOW (cms)= 0.02 0.00 \*TOTALS\* 0.019 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.42 1.33  
 RUNOFF VOLUME (mm)= 75.00 37.48 61.07  
 TOTAL RAINFALL (mm)= 76.00 76.00 76.00  
 RUNOFF COEFFICIENT = 0.99 0.49 0.80

-----  
 IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.01 0.04  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 17.89 40.00  
 Mannings n = 0.013 0.250

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.07	1.083	5.70	2.083	5.19	3.08	
2.80	0.167	2.07	1.167	5.70	2.167	5.19	3.17
2.80	0.250	2.27	1.250	10.78	2.250	4.47	3.25
2.62	0.333	2.27	1.333	10.78	2.333	4.47	3.33
2.62	0.417	2.52	1.417	50.21	2.417	3.95	3.42
2.48	0.500	2.52	1.500	50.21	2.500	3.95	3.50
2.48	0.583	2.88	1.583	13.37	2.583	3.56	3.58
2.35	0.667	2.88	1.667	13.37	2.667	3.56	3.67
2.35	0.750	3.38	1.750	8.29	2.750	3.25	3.75
2.23	0.833	3.38	1.833	8.29	2.833	3.25	3.83
2.23	0.917	4.17	1.917	6.30	2.917	3.01	3.92
2.14	1.000	4.18	2.000	6.29	3.000	3.01	4.00
2.14							

-----  
 ADD HYD ( 0013) |  
 | 1 + 2 = 3 | AREA QPEAK TPEAK R.V.  
 | (ha) (cms) (hrs) (mm)  
 ID1= 1 ( 0012): 0.05 0.019 1.33 61.07  
 + ID2= 2 ( 0003): 0.16 0.019 1.50 74.19  
 =====  
 ID = 3 ( 0013): 0.21 0.037 1.33 71.01

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

V V I SSSS U U A L (v 6.2.2015)  
 V V I SS U U A A L  
 V V I SS U U A A A A L  
 V V I SS U U A A L  
 V V I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM  
 O O T T H H Y Y M M O O O  
 O O T T H H Y Y M M O O O  
 OOO T T H H Y Y M M OOO

Developed and Distributed by Smart City Water Inc  
 Copyright 2007 - 2022 Smart City Water Inc  
 All rights reserved.

\*\*\*\*\* D E T A I L E D O U T P U T \*\*\*\*\*

Max.Eff.Inten.(mm/hr)= 50.21 4.50  
 over (min) 5.00 30.00  
 Storage Coeff. (min)= 1.20 (ii) 25.59 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 30.00  
 Unit Hyd. peak (cms)= 0.33 0.04

PEAK FLOW (cms)= 0.00 0.00 \*TOTALS\* 0.002 (iii)  
 TIME TO PEAK (hrs)= 1.50 2.00 1.50  
 RUNOFF VOLUME (mm)= 24.00 4.79 9.52  
 TOTAL RAINFALL (mm)= 25.00 25.00 25.00  
 RUNOFF COEFFICIENT = 0.96 0.19 0.38

Input filename: C:\Program Files (x86)\Visual OTTHYMO  
 6.2\VO2\voain.dat  
 Output filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\658c5b84-3f86-42d7-a95f-7e4cdeda9bb7\scenar  
 Summary filename: C:\Users\KimJo\AppData\Local\Civica\XH5\5f9falbf-  
 87a1-436c-84fa-29e684f29ce0\658c5b84-3f86-42d7-a95f-7e4cdeda9bb7\scenar

DATE: 05/25/2026 TIME: 11:43:43

USER:

COMMENTS: \_\_\_\_\_

-----  
 | CALIB |  
 | STANDHYD ( 0001) | Area (ha)= 0.09  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 97.00 Dir. Conn.(%)= 97.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.09 0.00  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 24.22 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

-----  
 | READ STORM | Filename: C:\Users\KimJo\AppData  
 | | ata\Local\Temp\  
 | | b608b71e-8f98-4c02-b484-  
 7085e13c4b32\234daf06  
 | Ptotal= 25.00 mm | Comments: 25mm 4hr Chicago (VO)

----- TRANSFORMED HYETOGRAPH -----

RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME
mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs
0.083	2.07	1.083	5.70	2.083	5.19	3.08	
2.80	0.167	2.07	1.167	5.70	2.167	5.19	3.17
2.80	0.250	2.27	1.250	10.78	2.250	4.47	3.25
2.62	0.333	2.27	1.333	10.78	2.333	4.47	3.33
2.62	0.417	2.52	1.417	50.21	2.417	3.95	3.42
2.48	0.500	2.52	1.500	50.21	2.500	3.95	3.50
2.48	0.583	2.88	1.583	13.37	2.583	3.56	3.58
2.35	0.667	2.88	1.667	13.37	2.667	3.56	3.67
2.35	0.750	3.38	1.750	8.29	2.750	3.25	3.75
2.23	0.833	3.38	1.833	8.29	2.833	3.25	3.83
2.23	0.917	4.17	1.917	6.30	2.917	3.01	3.92
2.14	1.000	4.18	2.000	6.29	3.000	3.01	4.00
2.14							

-----  
 | CALIB |  
 | STANDHYD ( 0009) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 27.00 Dir. Conn.(%)= 27.00



Max.Eff.Inten.(mm/hr)= 50.21 6.66  
 over (min) 5.00 5.00  
 Storage Coeff. (min)= 1.44 (ii) 3.75 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 5.00  
 Unit Hyd. peak (cms)= 0.33 0.25

PEAK FLOW (cms)= 0.01 0.00  
 TIME TO PEAK (hrs)= 1.50 1.50  
 RUNOFF VOLUME (mm)= 24.00 4.79  
 TOTAL RAINFALL (mm)= 25.00 25.00  
 RUNOFF COEFFICIENT = 0.96 0.19 0.94

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0004) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.05 0.00  
 Dep. Storage (mm)= 1.00 1.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 17.59 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----  
 RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME  
 mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs  
 2.80 0.083 2.07 | 1.083 5.70 | 2.083 5.19 | 3.08  
 2.80 0.167 2.07 | 1.167 5.70 | 2.167 5.19 | 3.17  
 2.62 0.250 2.27 | 1.250 10.78 | 2.250 4.47 | 3.25  
 2.62 0.333 2.27 | 1.333 10.78 | 2.333 4.47 | 3.33  
 2.48 0.417 2.52 | 1.417 50.21 | 2.417 3.95 | 3.42  
 2.48 0.500 2.52 | 1.500 50.21 | 2.500 3.95 | 3.50  
 2.35 0.583 2.88 | 1.583 13.37 | 2.583 3.56 | 3.58  
 2.35 0.667 2.88 | 1.667 13.37 | 2.667 3.56 | 3.67  
 2.23 0.750 3.38 | 1.750 8.29 | 2.750 3.25 | 3.75  
 2.23 0.833 3.38 | 1.833 8.29 | 2.833 3.25 | 3.83  
 2.14 0.917 4.17 | 1.917 6.30 | 2.917 3.01 | 3.92  
 2.14 1.000 4.18 | 2.000 6.29 | 3.000 3.01 | 4.00

Max.Eff.Inten.(mm/hr)= 50.21 47.26  
 over (min) 5.00 5.00  
 Storage Coeff. (min)= 1.19 (ii) 2.67 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 5.00  
 Unit Hyd. peak (cms)= 0.33 0.29

PEAK FLOW (cms)= 0.01 0.00  
 TIME TO PEAK (hrs)= 1.50 1.50  
 RUNOFF VOLUME (mm)= 24.00 21.68  
 TOTAL RAINFALL (mm)= 25.00 25.00  
 RUNOFF COEFFICIENT = 0.96 0.87 0.96

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
 CN\* = 99.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | CALIB |  
 | STANDHYD ( 0014) | Area (ha)= 0.02  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 98.00 Dir. Conn.(%)= 98.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.02 0.00  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 12.11 40.00  
 Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

RAIN TIME RAIN | TIME RAIN | TIME RAIN | TIME  
 mm/hr hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs  
 2.80 0.083 2.07 | 1.083 5.70 | 2.083 5.19 | 3.08  
 2.80 0.167 2.07 | 1.167 5.70 | 2.167 5.19 | 3.17  
 2.62 0.250 2.27 | 1.250 10.78 | 2.250 4.47 | 3.25  
 2.62 0.333 2.27 | 1.333 10.78 | 2.333 4.47 | 3.33  
 2.48 0.417 2.52 | 1.417 50.21 | 2.417 3.95 | 3.42  
 2.48 0.500 2.52 | 1.500 50.21 | 2.500 3.95 | 3.50  
 2.35 0.583 2.88 | 1.583 13.37 | 2.583 3.56 | 3.58  
 2.35 0.667 2.88 | 1.667 13.37 | 2.667 3.56 | 3.67  
 2.23 0.750 3.38 | 1.750 8.29 | 2.750 3.25 | 3.75  
 2.23 0.833 3.38 | 1.833 8.29 | 2.833 3.25 | 3.83  
 2.14 0.917 4.17 | 1.917 6.30 | 2.917 3.01 | 3.92  
 2.14 1.000 4.18 | 2.000 6.29 | 3.000 3.01 | 4.00

Max.Eff.Inten.(mm/hr)= 50.21 6.66  
 over (min) 5.00 5.00  
 Storage Coeff. (min)= 0.95 (ii) 2.91 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 5.00  
 Unit Hyd. peak (cms)= 0.34 0.28

PEAK FLOW (cms)= 0.00 0.00  
 TIME TO PEAK (hrs)= 1.50 1.50  
 RUNOFF VOLUME (mm)= 24.00 4.79  
 TOTAL RAINFALL (mm)= 25.00 25.00  
 RUNOFF COEFFICIENT = 0.96 0.19 0.94

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PVIOUS LOSSES:  
 CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
 | ADD HYD ( 0007) |  
 | 1 + 2 = 3 | AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 ID1= 1 ( 0001): 0.09 0.012 1.50 23.41  
 + ID2= 2 ( 0014): 0.02 0.003 1.50 23.61  
 ID = 3 ( 0007): 0.11 0.015 1.50 23.45

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
 | ADD HYD ( 0007) |  
 | 3 + 2 = 1 | AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 ID1= 3 ( 0007): 0.11 0.015 1.50 23.45  
 + ID2= 2 ( 0004): 0.05 0.006 1.50 23.97  
 ID = 1 ( 0007): 0.16 0.021 1.50 23.61

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
 | RESERVOIR( 0003) | OVERFLOW IS OFF  
 | IN= 2--> OUT= 1 |  
DT= 5.0 min

OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
0.0000	0.0000	0.0184	0.0017
0.0179	0.0010	0.0187	0.0027
0.0182	0.0011	0.0000	0.0000

AREA QPEAK TPEAK R.V.  
 (ha) (cms) (hrs) (mm)  
 INFLOW : ID= 2 ( 0007) 0.156 0.021 1.50 23.61  
 OUTFLOW: ID= 1 ( 0003) 0.156 0.014 1.58 23.54

PEAK FLOW REDUCTION [Qout/Qin](%)= 63.05  
 TIME SHIFT OF PEAK FLOW (min)= 5.00  
 MAXIMUM STORAGE USED (ha.m.)= 0.0009

-----  
 | CALIB |  
 | STANDHYD ( 0012) | Area (ha)= 0.05  
 | ID= 1 DT= 5.0 min | Total Imp(%)= 63.00 Dir. Conn.(%)= 63.00  
 -----

IMPERVIOUS PERVIOUS (i)  
 Surface Area (ha)= 0.03 0.02  
 Dep. Storage (mm)= 1.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 18.26 40.00



Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

RAIN mm/hr	TIME		RAIN		TIME		RAIN		TIME	
	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
2.80	0.083	2.07	1.083	5.70	2.083	5.19	3.08			
2.80	0.167	2.07	1.167	5.70	2.167	5.19	3.17			
2.62	0.250	2.27	1.250	10.78	2.250	4.47	3.25			
2.62	0.333	2.27	1.333	10.78	2.333	4.47	3.33			
2.48	0.417	2.52	1.417	50.21	2.417	3.95	3.42			
2.48	0.500	2.52	1.500	50.21	2.500	3.95	3.50			
2.35	0.583	2.88	1.583	13.37	2.583	3.56	3.58			
2.35	0.667	2.88	1.667	13.37	2.667	3.56	3.67			
2.23	0.750	3.38	1.750	8.29	2.750	3.25	3.75			
2.23	0.833	3.38	1.833	8.29	2.833	3.25	3.83			
2.14	0.917	4.17	1.917	6.30	2.917	3.01	3.92			
2.14	1.000	4.18	2.000	6.29	3.000	3.01	4.00			

Max.Eff.Inten.(mm/hr)= 50.21 4.50  
 over (min) 5.00 30.00  
 Storage Coeff. (min)= 1.21 (ii) 25.60 (ii)  
 Unit Hyd. Tpeak (min)= 5.00 30.00

Unit Hyd. peak (cms)=	0.33	0.04	*TOTALS*
PEAK FLOW (cms)=	0.00	0.00	0.004 (iii)
TIME TO PEAK (hrs)=	1.50	2.00	1.50
RUNOFF VOLUME (mm)=	24.00	4.79	16.66
TOTAL RAINFALL (mm)=	25.00	25.00	25.00
RUNOFF COEFFICIENT =	0.96	0.19	0.67

\*\*\*\*\* WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 80.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0013) |
| 1 + 2 = 3 |
-----
ID1= 1 ( 0012): 0.05 0.004 1.50 16.66
+ ID2= 2 ( 0003): 0.16 0.014 1.58 23.54
=====
ID = 3 ( 0013): 0.21 0.018 1.50 21.88

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

FINISH



Appendix E  
Storm Water Management Calculation



## PREDEVELOPMENT FLOWS & ALLOWABLE FLOWS

### Area 101A

Area (A)=	0.119	ha
Runoff Coefficient (C)=	0.5	
Time of Concentration (tc)=	10	min
equiv % imp=	0.43	

### Area 101B

Area (A)=	0.049	ha
Runoff Coefficient (C)=	0.5	
Time of Concentration (tc)=	10	min
equiv % imp=	0.43	

### Area 102+103

Area (A)=	0.085	ha
Runoff Coefficient (C)=	0.26	
Time of Concentration (tc)=	10	min
equiv % imp=	0.09	

Yr Stm	A	B	C	I (mm/hr)
2	732.951	6.20	0.81	76.81
5	998.071	6.05	0.814	104.19
10	1174.184	6.01	0.816	122.14
25	1402.884	6.02	0.819	144.69
50	1569.58	6.01	0.82	161.47
100	1735.688	6.01	0.82	178.56

Q=2.78\*CiA

### Area 101A+ Area 101B

Yr Stm	Otthymo Peak Flow	
	cms	L/s
2	0.016	16.0
5	0.023	23.0
10	0.028	28.0
25	0.037	37.0
50	0.042	42.0
100	0.048	48.0
25mm 4hr	0.010	10.0

### Area 102 + Area 103 (To ROW)

Yr Stm	Otthymo Peak Flow	
	cms	L/s
2	0.002	2.0
5	0.004	4.0
10	0.006	6.0
25	0.009	9.0
50	0.011	11.0
100	0.013	13.0
25mm 4hr	0.001	1.0



## Post-Development :

Controlled Catchment Area (Area 201 & 202) (Orifice)	0.110	ha
Percent Impervious	0.97	%

Uncontrolled Catchment Area (Area 203 & Area 207)	0.050	ha
Percent Impervious	0.63	%

Roof Catchment Area (Area 205)	0.046	ha
--------------------------------	-------	----

TOTAL Controlled Catchment Area (Orifice)	0.156	ha
---	-------	----

### Orifice ICD Information

Location	STM MH01	
Type	Tube	
Coefficient	0.63	
Size	80	mm
Invert Elevation	84.68	m
Lowest Surface/Rim Elevation	86.35	m

### Orifice Storage Information

	Volume in Pipe (m3)	Volume in Structures (m3)	Ponding Volume (m3)	TOTAL Volume (m3)
At Lowest Surface - 86.35m	5.06	4.86	0.00	9.92
0.05m above Surface - 86.40m	5.06	4.96	1.36	11.38
0.10m above Surface - 86.45m	5.06	5.09	6.49	16.64
0.15m above Surface - 86.50m	5.06	5.09	17.28	27.43

### Orifice Stage Storage Discharge:

Stage ID	Elevation	Head	Discharge		Storage Volume	
	m	m	L/sec	m <sup>3</sup> /s	m <sup>3</sup>	ha-m
Orifice Centroid	84.72	0.00	0.00	0.0000	0.00	0.00000
Surface	86.35	1.63	17.91	0.0179	9.92	0.00099
0.05m above Surface	86.40	1.68	18.18	0.0182	11.38	0.00114
0.10m above Surface	86.45	1.73	18.45	0.0184	16.64	0.00166
0.15m above Surface	86.50	1.78	18.71	0.0187	27.43	0.00274

Allowable Flow	0.048	cms	(100-yr Predevelopment Flow)
----------------	-------	-----	------------------------------

### Storage Requirements

Storm Event	Total Peak Flow Offsite		Stress Test Factor	% Allowable with Stress Test Factor	Storage Volume Used (Sewers and Surface)		Water Elevation	Water Depth Above Surface
	m <sup>3</sup> /s	L/sec			ha-m	m <sup>3</sup>		
2 Year	0.025	25	1.0	52%	0.0007	7	85.87	0.00
5 Year	0.028	28	1.0	58%	0.0009	9	86.32	0.00
10 Year	0.030	30	1.0	63%	0.0011	11	86.40	0.05
25 Year	0.033	33	1.0	69%	0.0016	16	86.44	0.09
50 Year	0.035	35	1.0	73%	0.0019	19	86.46	0.11
100 Year	0.037	37	1.2	93%	0.0022	22	86.47	0.12
25mm 4hr	0.018	18	1.0	38%	0.0004	4	86.39	0.04

PROJECT NO. : BRM-23002042-W0  
 PROJECT NAME. : Proposed Chick fil A, 1984 Baseline Road, Ottawa, ON  
 Date: May 2026



## POST DEVELOPMENT FLOW (TO ROW)

### Area 204 & 206

Area (A)=	0.048	ha
Runoff Coefficient (C)=	0.39	
Time of Concentration (tc)=	10	min
equiv % imp=	0.27	

Yr Stm	A	B	C	I (mm/hr)
2	732.951	6.20	0.81	76.81
5	998.071	6.05	0.814	104.19
10	1174.184	6.01	0.816	122.14
25	1402.884	6.02	0.819	144.69
50	1569.58	6.01	0.82	161.47
100	1735.688	6.01	0.82	178.56

Q=2.78\*CiA

### Area 102 + Area 103 (To ROW)

Yr Stm	Otthymo Peak Flow	
	cms	L/s
2	0.003	3.0
5	0.004	4.0
10	0.006	6.0
25	0.008	8.0
50	0.009	9.0
100	0.011	11.0
25mm 4hr	0.002	2.0



## Site Quality Control - TSS Removal :

	Area (m2)	% of Site Area	Upstream TSS Removal Rate %	SWM Tank TSS Removal Rate %	OGS TSS Removal Rate %	TOTAL TSS Removal Rate* %	TSS Removal (% of Surface)
Roof (to OGS)*	464	30	80	50	50	95	28.3
Asphalt and Concrete (to OGS)*	1069	69	0	50	50	75	51.5
Landscape (to OGS)*	24	2	80	50	50	95	1.5
<b>TOTAL</b>	<b>1558</b>	<b>100</b>					<b>81.3</b>

OGS - Stormceptor (or approved equivalent)

\*Train Treatment

$$= A + B - (A \times B) / 100$$

where A= % TSS Removal Upstream  
 B= % TSS Removal Downstream

PROJECT NO. : BRM-23002042-W0

PROJECT NAME. : Proposed Chick fil A, 1984 Baseline Road, Ottawa, ON

Date: May 2026



## Water Balance :

### Water Balance Target

---

Site Area	2530	m <sup>2</sup>
Water Balance Target	10	mm
Water Balance Volume Target	25.3	m <sup>3</sup>

### Total Capture:

---

Surface	Area (m2)	Initial Abstraction (mm)	Volume Capture (m3)
Conventional Roof	464	2	0.0
Roof Storage	-	-	22.0
Infiltration Gallery	-	-	0.0
Asphalt and Concrete	1580	2	3.2
Landscaping	200	5	1.0
<b>TOTAL VOLUME CAPTURE</b>			<b>26.2</b>

Note: Initial Abstraction not included as per City requirements.

Appendix F  
OGS Report



**Imbrium® Systems**

**ESTIMATED NET ANNUAL SEDIMENT (TSS) LOAD REDUCTION**

05/26/2026

Province:	Ontario
City:	Ottawa
Nearest Rainfall Station:	OTTAWA CDA RCS
Climate Station Id:	6105978
Years of Rainfall Data:	20

Project Name:	CFA College Square
Project Number:	BRM-23002042-W0
Designer Name:	Joo Ho Kim
Designer Company:	EXP
Designer Email:	jooho.kim@exp.com
Designer Phone:	416-992-9942
EOR Name:	
EOR Company:	
EOR Email:	
EOR Phone:	

Site Name:

Drainage Area (ha): 0.16

Runoff Coefficient 'c': 0.88

Particle Size Distribution: Fine

Target TSS Removal (%): 80.0

Required Water Quality Runoff Volume Capture (%):	90.00
Estimated Water Quality Flow Rate (L/s):	4.54
Oil / Fuel Spill Risk Site?	Yes
Upstream Flow Control?	Yes
Upstream Orifice Control Flow Rate to Stormceptor (L/s):	19.00
Peak Conveyance (maximum) Flow Rate (L/s):	
Influent TSS Concentration (mg/L):	200
Estimated Average Annual Sediment Load (kg/yr):	202
Estimated Average Annual Sediment Volume (L/yr):	164

Net Annual Sediment (TSS) Load Reduction Sizing Summary	
Stormceptor Model	TSS Removal Provided (%)
EFO4	96
EFO5	98
EFO6	99
EFO8	100
EFO10	100
EFO12	100

**Recommended Stormceptor EFO Model: EFO4**

**Estimated Net Annual Sediment (TSS) Load Reduction (%): 96**

**Water Quality Runoff Volume Capture (%): > 90**



### THIRD-PARTY TESTING AND VERIFICATION

► **Stormceptor® EF and Stormceptor® EFO** are the latest evolutions in the Stormceptor® oil-grit separator (OGS) technology series, and are designed to remove a wide variety of pollutants from stormwater and snowmelt runoff. These technologies have been third-party tested in accordance with the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators** and performance has been third-party verified in accordance with the **ISO 14034 Environmental Technology Verification (ETV)** protocol.

### PERFORMANCE

► **Stormceptor® EF and EFO** remove stormwater pollutants through gravity separation and floatation, and feature a patent-pending design that generates positive removal of total suspended solids (TSS) throughout each storm event, including high-intensity storms. Captured pollutants include sediment, free oils, and sediment-bound pollutants such as nutrients, heavy metals, and petroleum hydrocarbons. Stormceptor is sized to remove a high level of TSS from the frequent rainfall events that contribute the vast majority of annual runoff volume and pollutant load. The technology incorporates an internal bypass to convey excessive stormwater flows from high-intensity storms through the device without resuspension and washout (scour) of previously captured pollutants. Proper routine maintenance ensures high pollutant removal performance and protection of downstream waterways.

### PARTICLE SIZE DISTRIBUTION (PSD)

► The **Canadian ETV PSD** shown in the table below was used, or in part, for this sizing. This is the identical PSD that is referenced in the Canadian ETV **Procedure for Laboratory Testing of Oil-Grit Separators** for both sediment removal testing and scour testing. The Canadian ETV PSD contains a wide range of particle sizes in the sand and silt fractions, and is considered reasonably representative of the particle size fractions found in typical urban stormwater runoff.

Particle Size (µm)	Percent Less Than	Particle Size Fraction (µm)	Percent
1000	100	500-1000	5
500	95	250-500	5
250	90	150-250	15
150	75	100-150	15
100	60	75-100	10
75	50	50-75	5
50	45	20-50	10
20	35	8-20	15
8	20	5-8	10
5	10	2-5	5
2	5	<2	5


**Upstream Flow Controlled Results**

Rainfall Intensity (mm / hr)	Percent Rainfall Volume (%)	Cumulative Rainfall Volume (%)	Flow Rate (L/s)	Flow Rate (L/min)	Surface Loading Rate (L/min/m <sup>2</sup> )	Removal Efficiency (%)	Incremental Removal (%)	Cumulative Removal (%)
0.50	8.6	8.6	0.20	12.0	10.0	100	8.6	8.6
1.00	20.3	29.0	0.39	23.0	20.0	100	20.3	29.0
2.00	16.2	45.2	0.78	47.0	39.0	100	16.2	45.2
3.00	12.0	57.2	1.17	70.0	59.0	100	12.0	57.2
4.00	8.4	65.6	1.57	94.0	78.0	100	8.4	65.6
5.00	5.9	71.6	1.96	117.0	98.0	97	5.8	71.4
6.00	4.6	76.2	2.35	141.0	117.0	95	4.4	75.8
7.00	3.1	79.3	2.74	164.0	137.0	92	2.8	78.6
8.00	2.7	82.0	3.13	188.0	157.0	89	2.5	81.1
9.00	3.3	85.3	3.52	211.0	176.0	87	2.9	84.0
10.00	2.3	87.6	3.91	235.0	196.0	84	1.9	85.9
11.00	1.6	89.2	4.31	258.0	215.0	83	1.3	87.2
12.00	1.3	90.5	4.70	282.0	235.0	82	1.1	88.3
13.00	1.7	92.2	5.09	305.0	254.0	81	1.4	89.7
14.00	1.2	93.5	5.48	329.0	274.0	80	1.0	90.6
15.00	1.2	94.6	5.87	352.0	294.0	79	0.9	91.5
16.00	0.7	95.3	6.26	376.0	313.0	78	0.5	92.1
17.00	0.7	96.1	6.65	399.0	333.0	77	0.6	92.7
18.00	0.4	96.5	7.05	423.0	352.0	76	0.3	93.0
19.00	0.4	96.9	7.44	446.0	372.0	75	0.3	93.3
20.00	0.2	97.1	7.83	470.0	391.0	74	0.2	93.4
21.00	0.5	97.5	8.22	493.0	411.0	73	0.3	93.8
22.00	0.2	97.8	8.61	517.0	431.0	72	0.2	93.9
23.00	1.0	98.8	9.00	540.0	450.0	72	0.7	94.7
24.00	0.3	99.1	9.39	564.0	470.0	71	0.2	94.9
25.00	0.9	100.0	9.79	587.0	489.0	70	0.7	95.5
30.00	0.9	100.9	11.74	705.0	587.0	66	0.6	96.1
35.00	-0.9	100.0	13.70	822.0	685.0	64	N/A	95.5
40.00	0.0	100.0	15.66	939.0	783.0	63	0.0	95.5
45.00	0.0	100.0	17.61	1057.0	881.0	62	0.0	95.5
<b>Estimated Net Annual Sediment (TSS) Load Reduction =</b>								<b>96 %</b>


Climate Station ID: 6105978 Years of Rainfall Data: 20



RAINFALL DATA FROM OTTAWA CDA RCS RAINFALL STATION

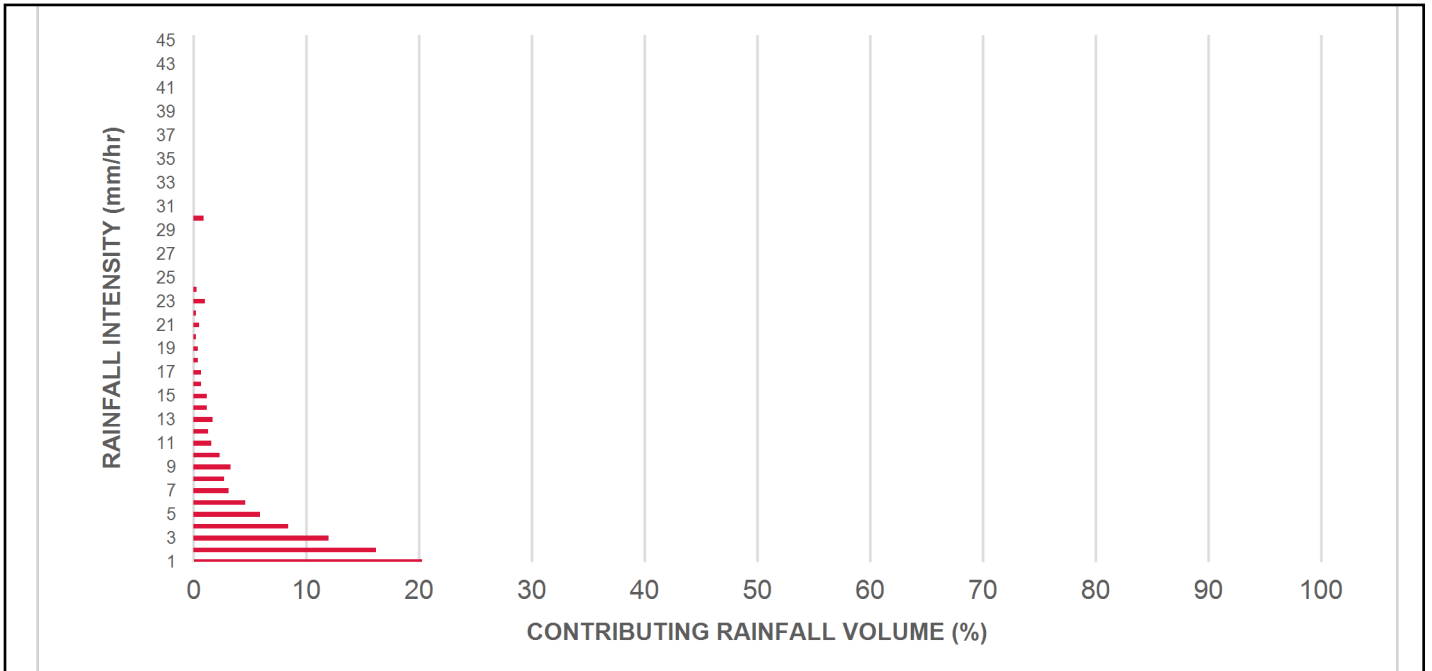

INCREMENTAL AND CUMULATIVE TSS REMOVAL FOR THE RECOMMENDED STORMCEPTOR® MODEL

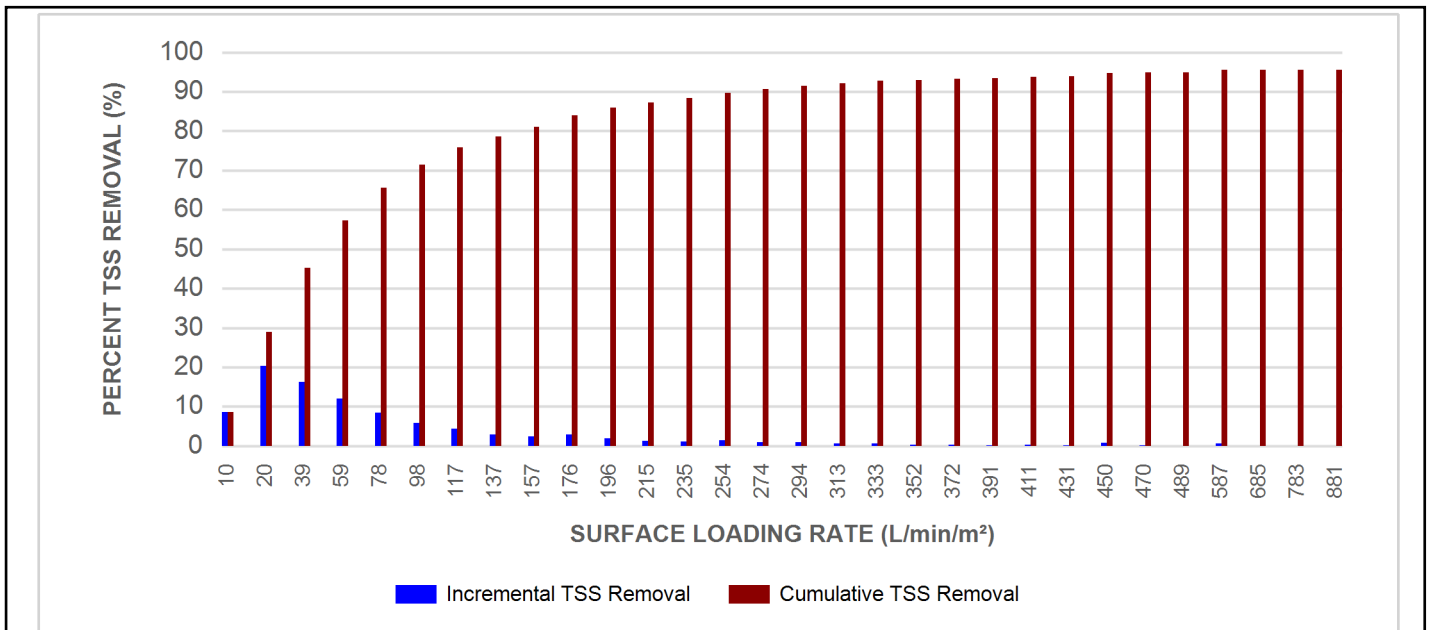

Maximum Pipe Diameter / Peak Conveyance

Stormceptor EF / EFO	Model Diameter		Min Angle Inlet / Outlet Pipes	Max Inlet Pipe Diameter		Max Outlet Pipe Diameter		Peak Conveyance Flow Rate	
	(m)	(ft)		(mm)	(in)	(mm)	(in)	(L/s)	(cfs)
EF4 / EFO4	1.2	4	90	609	24	609	24	425	15
EF5 / EFO5	1.5	5	90	762	30	762	30	710	25
EF6 / EFO6	1.8	6	90	914	36	914	36	990	35
EF8 / EFO8	2.4	8	90	1219	48	1219	48	1700	60
EF10 / EFO10	3.0	10	90	1828	72	1828	72	2830	100
EF12 / EFO12	3.6	12	90	1828	72	1828	72	2830	100

SCOUR PREVENTION AND ONLINE CONFIGURATION


► Stormceptor® EF and EFO feature an internal bypass and superior scour prevention technology that have been demonstrated in third-party testing according to the scour testing provisions of the Canadian ETV Procedure for Laboratory Testing of Oil-Grit Separators, and the exceptional scour test performance has been third-party verified in accordance with the ISO 14034 ETV protocol. As a result, Stormceptor EF and EFO are approved for online installation, eliminating the need for costly additional bypass structures, piping, and installation expense.


DESIGN FLEXIBILITY

► Stormceptor® EF and EFO offers design flexibility in one simplified platform, accepting stormwater flow from a single inlet pipe or multiple inlet pipes, and/or surface runoff through an inlet grate. The device can also serve as a junction structure, accommodate a 90-degree inlet-to-outlet bend angle, and can be modified to ensure performance in submerged conditions.

OIL CAPTURE AND RETENTION

► While Stormceptor® EF will capture and retain oil from dry weather spills and low intensity runoff, Stormceptor® EFO has demonstrated superior oil capture and greater than 99% oil retention in third-party testing according to the light liquid re-entrainment testing provisions of the Canadian ETV Procedure for Laboratory Testing of Oil-Grit Separators. Stormceptor EFO is recommended for sites where oil capture and retention is a requirement.

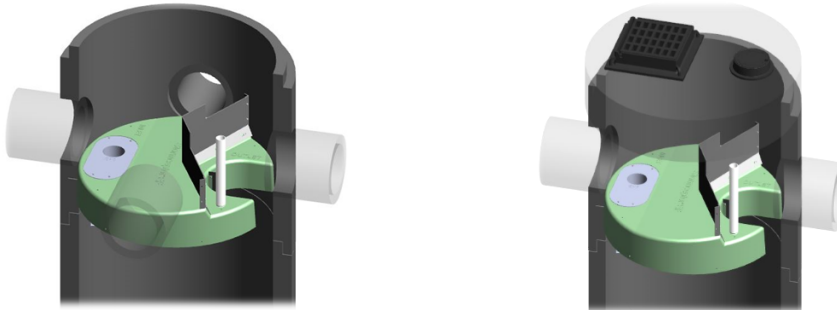

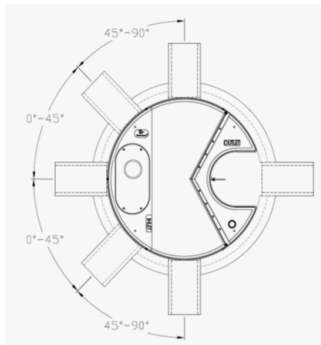

**INLET-TO-OUTLET DROP**

Elevation differential between inlet and outlet pipe inverts is dictated by the angle at which the inlet pipe(s) enters the unit.

0° - 45° : The inlet pipe is 1-inch (25mm) higher than the outlet pipe.

45° - 90° : The inlet pipe is 2-inches (50mm) higher than the outlet pipe.

**HEAD LOSS**

The head loss through Stormceptor EF is similar to that of a 60-degree bend structure. The applicable K value for calculating minor losses through the unit is 1.1. For submerged conditions the applicable K value is 3.0.

**Pollutant Capacity**

Stormceptor EF / EFO	Model Diameter		Depth (Outlet Pipe Invert to Sump Floor)		Oil Volume		Recommended Sediment Maintenance Depth *		Maximum Sediment Volume *		Maximum Sediment Mass **	
	(m)	(ft)	(m)	(ft)	(L)	(Gal)	(mm)	(in)	(L)	(ft³)	(kg)	(lb)
EF4 / EFO4	1.2	4	1.52	5.0	265	70	203	8	1190	42	1904	5250
EF5 / EFO5	1.5	5	1.62	5.3	420	111	305	10	2124	75	2612	5758
EF6 / EFO6	1.8	6	1.93	6.3	610	160	305	12	3470	123	5552	15375
EF8 / EFO8	2.4	8	2.59	8.5	1070	280	610	24	8780	310	14048	38750
EF10 / EFO10	3.0	10	3.25	10.7	1670	440	610	24	17790	628	28464	78500
EF12 / EFO12	3.6	12	3.89	12.8	2475	655	610	24	31220	1103	49952	137875

\*Increased sump depth may be added to increase sediment storage capacity

\*\* Average density of wet packed sediment in sump = 1.6 kg/L (100 lb/ft³ )

Feature	Benefit	Feature Appeals To
Patent-pending enhanced flow treatment and scour prevention technology	Superior, verified third-party performance	Regulator, Specifying & Design Engineer
Third-party verified light liquid capture and retention for EFO version	Proven performance for fuel/oil hotspot locations	Regulator, Specifying & Design Engineer, Site Owner
Functions as bend, junction or inlet structure	Design flexibility	Specifying & Design Engineer
Minimal drop between inlet and outlet	Site installation ease	Contractor
Large diameter outlet riser for inspection and maintenance	Easy maintenance access from grade	Maintenance Contractor & Site Owner

**STANDARD STORMCEPTOR EF/EFO DRAWINGS**

For standard details, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

**STANDARD STORMCEPTOR EF/EFO SPECIFICATION**

For specifications, please visit <http://www.imbriumsystems.com/stormwater-treatment-solutions/stormceptor-ef>

## STANDARD PERFORMANCE SPECIFICATION FOR “OIL GRIT SEPARATOR” (OGS) STORMWATER QUALITY TREATMENT DEVICE

### PART 1 – GENERAL

#### 1.1 WORK INCLUDED

This section specifies requirements for selecting, sizing, and designing an underground Oil Grit Separator (OGS) device for stormwater quality treatment, with third-party testing results and a Statement of Verification in accordance with ISO 14034 Environmental Management – Environmental Technology Verification (ETV).

#### 1.2 REFERENCE STANDARDS & PROCEDURES

ISO 14034:2016 Environmental management – Environmental technology verification (ETV)

Canadian Environmental Technology Verification (ETV) Program’s **Procedure for Laboratory Testing of Oil-Grit Separators**

#### 1.3 SUBMITTALS

1.3.1 All submittals, including sizing reports & shop drawings, shall be submitted upon request with each order to the contractor then forwarded to the Engineer of Record for review and acceptance. Shop drawings shall detail all OGS components, elevations, and sequence of construction.

1.3.2 Alternative devices shall have features identical to or greater than the specified device, including: treatment chamber diameter, treatment chamber wet volume, sediment storage volume, and oil storage volume.

1.3.3 Unless directed otherwise by the Engineer of Record, OGS stormwater quality treatment product substitutions or alternatives submitted within ten days prior to project bid shall not be accepted. All alternatives or substitutions submitted shall be signed and sealed by a local registered Professional Engineer, based on the exact same criteria detailed in Section 3, in entirety, subject to review and approval by the Engineer of Record.

### PART 2 – PRODUCTS

#### 2.1 OGS POLLUTANT STORAGE

The OGS device shall include a sump for sediment storage, and a protected volume for the capture and storage of petroleum hydrocarbons and buoyant gross pollutants. The minimum sediment & petroleum hydrocarbon storage capacity shall be as follows:

2.1.1	4 ft (1219 mm) Diameter OGS Units:	1.19 m <sup>3</sup> sediment / 265 L oil
	5 ft (1524 mm) Diameter OGS Units:	1.95 m <sup>3</sup> sediment / 420 L oil
	6 ft (1829 mm) Diameter OGS Units:	3.48 m <sup>3</sup> sediment / 609 L oil
	8 ft (2438 mm) Diameter OGS Units:	8.78 m <sup>3</sup> sediment / 1,071 L oil
	10 ft (3048 mm) Diameter OGS Units:	17.78 m <sup>3</sup> sediment / 1,673 L oil
	12 ft (3657 mm) Diameter OGS Units:	31.23 m <sup>3</sup> sediment / 2,476 L oil

### PART 3 – PERFORMANCE & DESIGN

### 3.1 GENERAL

The OGS stormwater quality treatment device shall be verified in accordance with ISO 14034:2016 Environmental management – Environmental technology verification (ETV). The OGS stormwater quality treatment device shall remove oil, sediment and gross pollutants from stormwater runoff during frequent wet weather events, and retain these pollutants during less frequent high flow wet weather events below the insert within the OGS for later removal during maintenance. The Manufacturer shall have at least ten (10) years of local experience, history and success in engineering design, manufacturing and production and supply of OGS stormwater quality treatment device systems, acceptable to the Engineer of Record.

### 3.2 SIZING METHODOLOGY

The OGS device shall be engineered, designed and sized to provide stormwater quality treatment based on treating a minimum of 90 percent of the average annual runoff volume and a minimum removal of an annual average 60% of the sediment (TSS) load based on the Particle Size Distribution (PSD) specified in the sizing report for the specified device. Sizing of the OGS shall be determined by use of a minimum ten (10) years of local historical rainfall data provided by Environment Canada. Sizing shall also be determined by use of the sediment removal performance data derived from the ISO 14034 ETV third-party verified laboratory testing data from testing conducted in accordance with the Canadian ETV protocol Procedure for Laboratory Testing of Oil-Grit Separators, as follows:

3.2.1 Sediment removal efficiency for a given surface loading rate and its associated flow rate shall be based on sediment removal efficiency demonstrated at the seven (7) tested surface loading rates specified in the protocol, ranging 40 L/min/m<sup>2</sup> to 1400 L/min/m<sup>2</sup>, and as stated in the ISO 14034 ETV Verification Statement for the OGS device.

3.2.2 Sediment removal efficiency for surface loading rates between 40 L/min/m<sup>2</sup> and 1400 L/min/m<sup>2</sup> shall be based on linear interpolation of data between consecutive tested surface loading rates.

3.2.3 Sediment removal efficiency for surface loading rates less than the lowest tested surface loading rate of 40 L/min/m<sup>2</sup> shall be assumed to be identical to the sediment removal efficiency at 40 L/min/m<sup>2</sup>. No extrapolation shall be allowed that results in a sediment removal efficiency that is greater than that demonstrated at 40 L/min/m<sup>2</sup>.

3.2.4 Sediment removal efficiency for surface loading rates greater than the highest tested surface loading rate of 1400 L/min/m<sup>2</sup> shall assume zero sediment removal for the portion of flow that exceeds 1400 L/min/m<sup>2</sup>, and shall be calculated using a simple proportioning formula, with 1400 L/min/m<sup>2</sup> in the numerator and the higher surface loading rate in the denominator, and multiplying the resulting fraction times the sediment removal efficiency at 1400 L/min/m<sup>2</sup>.

The OGS device shall also have sufficient annual sediment storage capacity as specified and calculated in Section 2.1.

### 3.3 CANADIAN ETV or ISO 14034 ETV VERIFICATION OF SCOUR TESTING

The OGS device shall have Canadian ETV or ISO 14034 ETV Verification of third-party scour testing conducted in accordance with the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**.

3.3.1 To be acceptable for on-line installation, the OGS device must demonstrate an average scour test effluent concentration less than 10 mg/L at each surface loading rate tested, up to and including 2600 L/min/m<sup>2</sup>.

### 3.4 LIGHT LIQUID RE-ENTRAINMENT SIMULATION TESTING


The OGS device shall have Canadian ETV or ISO 14034 ETV Verification of completed third-party Light Liquid

Re-entrainment Simulation Testing in accordance with the Canadian ETV **Program's Procedure for Laboratory Testing of Oil-Grit Separators**, with results reported within the Canadian ETV or ISO 14034 ETV verification. This re-entrainment testing is conducted with the device pre-loaded with low density polyethylene (LDPE) plastic beads as a surrogate for light liquids such as oil and fuel. Testing is conducted on the same OGS unit tested for sediment removal to assess whether light liquids captured after a spill are effectively retained at high flow rates.

3.4.1 For an OGS device to be an acceptable stormwater treatment device on a site where vehicular traffic occurs and the potential for an oil or fuel spill exists, the OGS device must have reported verified performance results of greater than 99% cumulative retention of LDPE plastic beads for the five specified surface loading rates (ranging 200 L/min/m<sup>2</sup> to 2600 L/min/m<sup>2</sup>) in accordance with the Light Liquid Re-entrainment Simulation Testing within the Canadian ETV Program's **Procedure for Laboratory Testing of Oil-Grit Separators**. However, an OGS device shall not be allowed if the Light Liquid Re-entrainment Simulation Testing was performed with screening components within the OGS device that are effective at retaining the LDPE plastic beads, but would not be expected to retain light liquids such as oil and fuel.

Appendix G  
Boundary Condition

# Boundary Conditions for 1984 Baseline Road

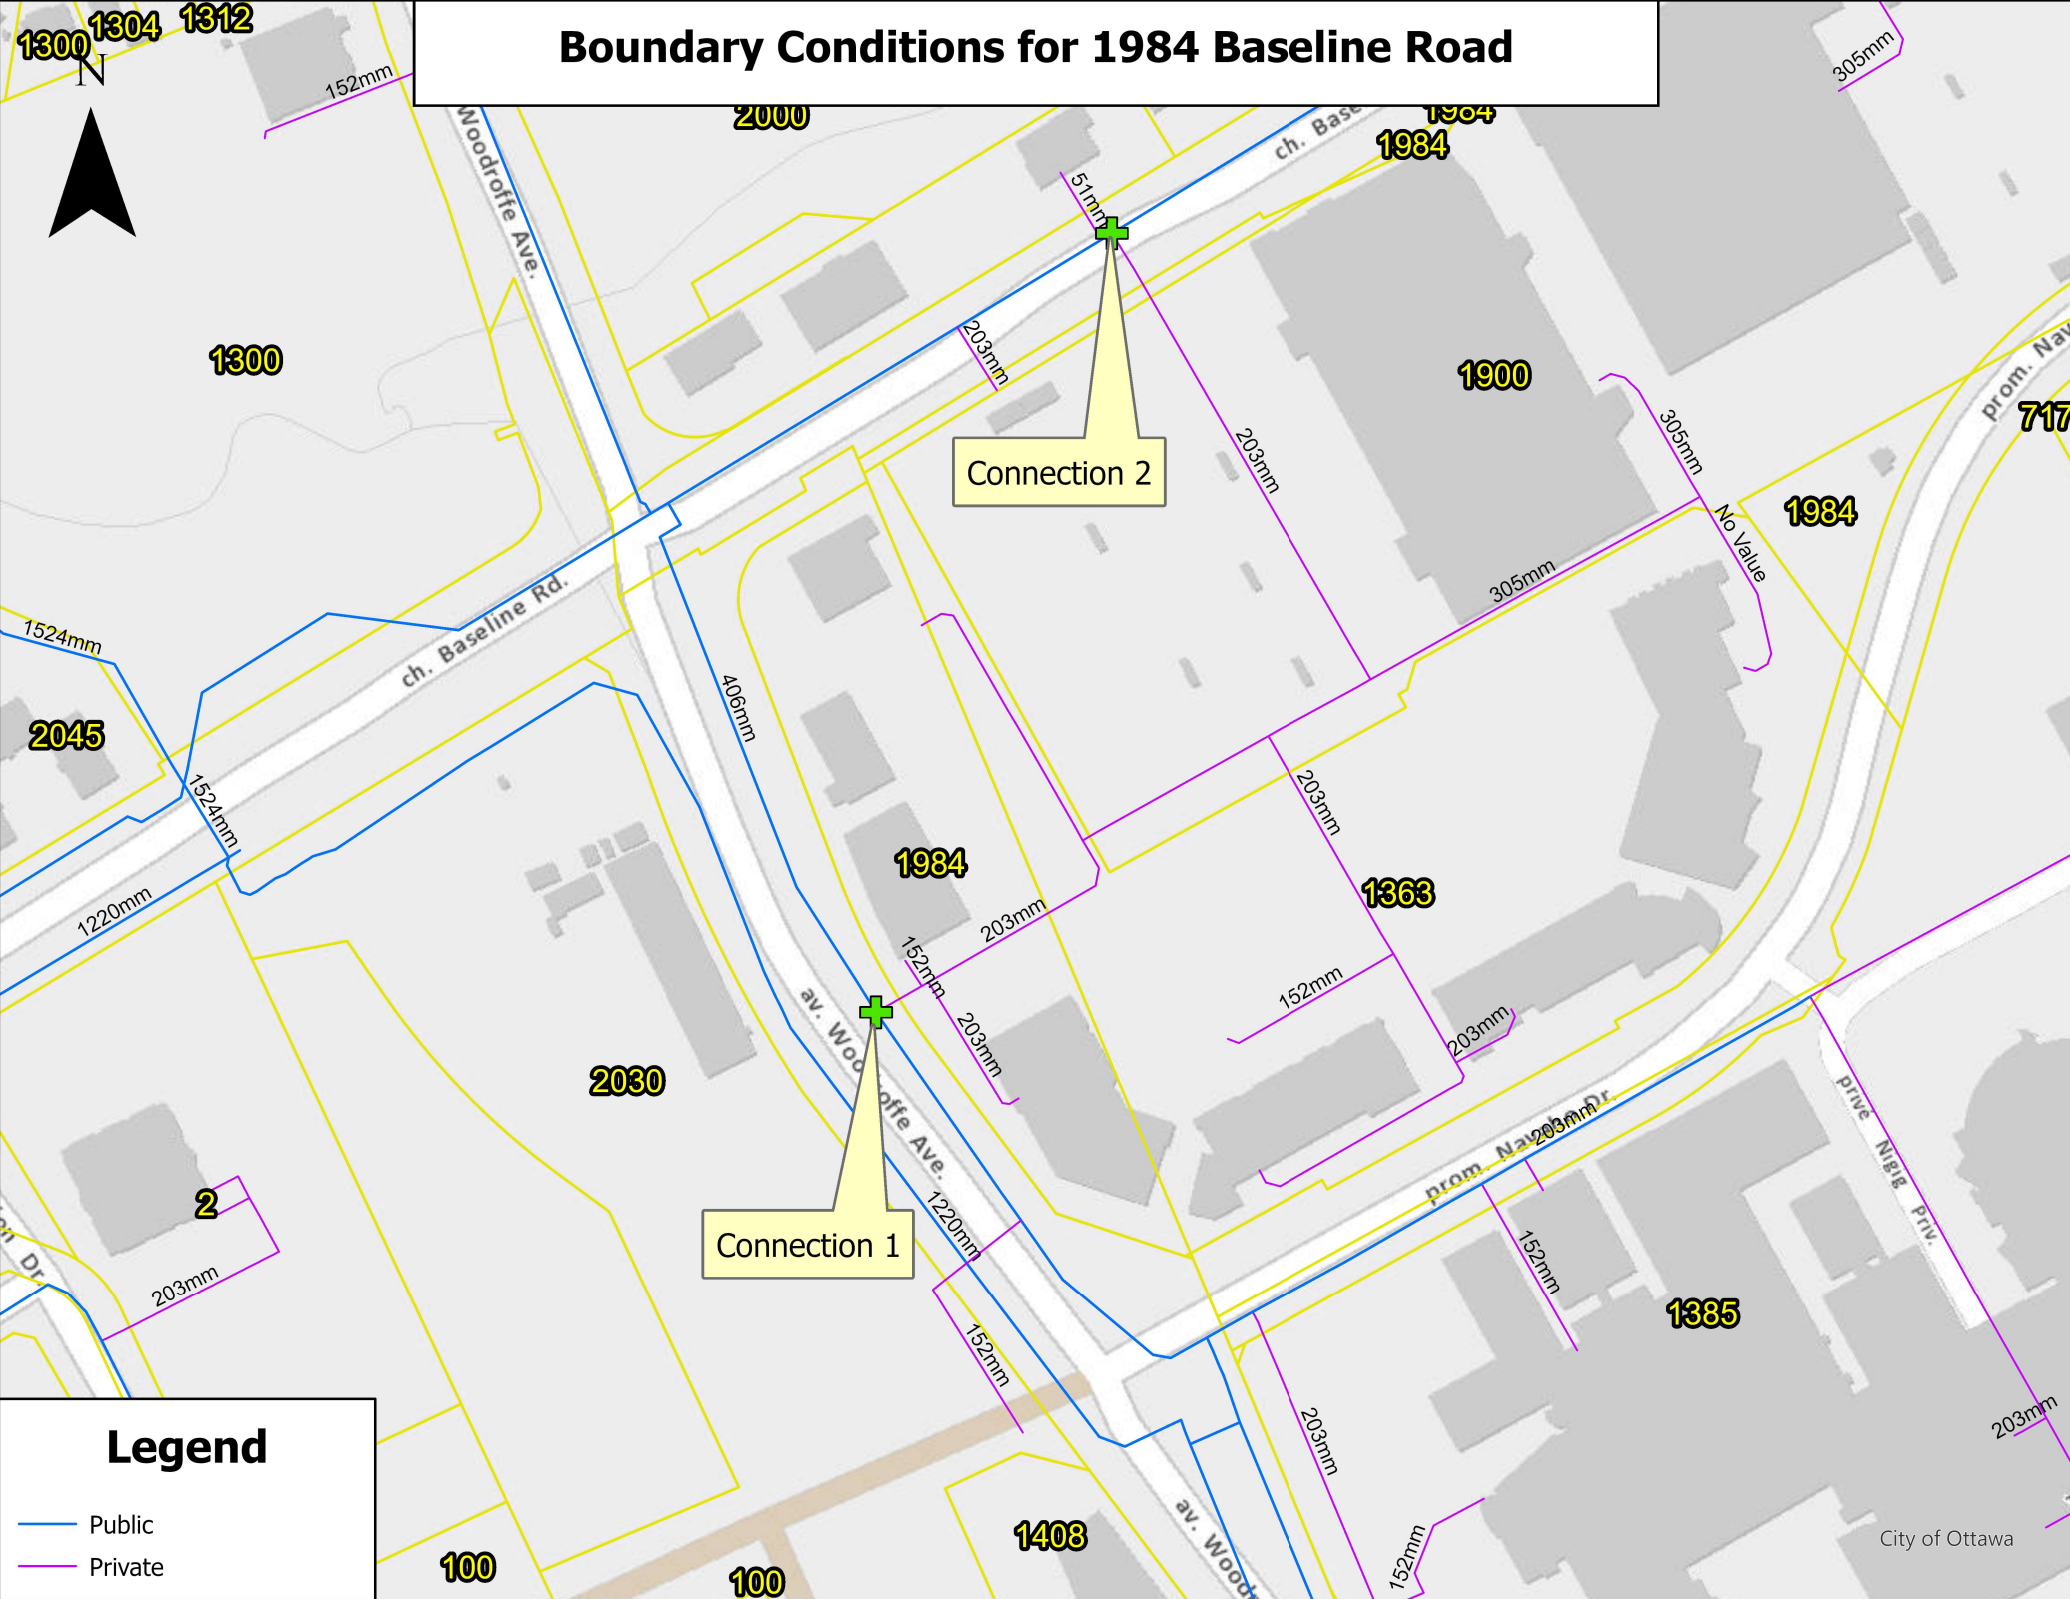

## Legend

- Public
- Private

Hi Saifullah,

The following are boundary conditions, HGL, for hydraulic analysis at 1984 Baseline Road (zone 2W2C) assumed to be connected to the 406mm on Woodroffe Avenue, the 406mm on Baseline Road and internally looped (see attached PDF for location).

**Connection 1- Woodroffe Ave:**

Minimum HGL = 126.6 m  
Maximum HGL = 132.6 m  
Max Day + Fire Flow (100.0 L/s) = 126.3 m

**Connection 2-Baseline Road:**

Minimum HGL = 126.4 m  
Maximum HGL = 132.5 m  
Max Day + Fire Flow (100.0 L/s) = 126.1 m

These are for current conditions and are based on computer model simulation.

*Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.*

*"The IWSD has recently updated their water modelling software. Any significant difference between previously received BC results and newly received BC results could be attributed to this update."*

Regards,

**Jean-Miguel Roy**

Project Manager, Infrastructure Approvals  
Planning, Real Estate and Economic Development Department  
Services de la planification, Direction générale de la planification, de l'immobilier et du développement économique  
110 Laurier Avenue West | 110 avenue Laurier Ouest  
City of Ottawa | Ville d'Ottawa

**CFA College Square - Peak Hour Pressure - Private Watermain - PRESSURE LOSS CALCULATION**

	Q = REQUIRED FLOW for FIRE PROTECTION (L/S)	Q = REQUIRED FLOW for DOMESTIC DEMAND (L/S)	D = NOMINAL PIPE DIAMETER (m)	L = LENGTH OF WATERMAIN (m)	TYPE	C VALUE	INSIDE DIAMETER (m)	WALL THICKNESS (m)	CROSS SECTIONAL AREA (m2)	V =FLOW VELOCITY (m/s)
Existing Private Watermain	n/a	0.3	0.050	34.6	n/a	100	0.046	0.003	0.002	0.19
Proposed Private Watermain	n/a	0.3	0.050	72.9	PEX	100	0.046	0.003	0.002	0.19

	START TOP OF PIPE ELEV (m)	END TOP OF PIPE ELEV (m)	STATIC HEAD (m)
Existing Private Watermain	84.74	84.20	0.54
Proposed Private Watermain	84.74	85.00	-0.26

	MINOR HEAD LOSSES					
	200 mm PVC			50mm PVC		
	Existing Private Watermain			Proposed Private Watermain		
	Number	K	Sub Total K	Number	K	Sub Total K
Inlet Anti Vortex Plate		1.00	0.00		1.00	0.00
Pipe Contraction		0.25	0.00		0.25	0.00
Pipe Expansion		0.25	0.00		0.25	0.00
Strainer/Reducer		0.50	0.00		0.50	0.00
Standard 90d Bend	1	0.90	0.90		0.90	0.00
Standard 45d Bend		0.45	0.00	0	0.45	0.00
Standard 22.5d Bend		0.23	0.00		0.23	0.00
Standard 11.25d Bend		0.10	0.00		0.10	0.00
Long Radius Bend, 45d / 90d		0.50	0.00		0.50	0.00
Tee - flow through run		0.60	0.00		0.60	0.00
Tee - flow through branch	1	1.80	1.80		1.80	0.00
Gate Valve	1	0.40	0.40		0.40	0.00
300mm to 400mm Pipe Expansion		0.20	0.00		0.20	0.00
Backflow Preventor		1.20	0.00	1	1.20	1.20
Meter		5.00	0.00	1	5.00	5.00
Drain Valve	1	0.40	0.40		0.40	0.00
Check Valve		4.00	0.00		4.00	0.00
Pipe Exit		1.00	0.00		1.00	0.00
K TOTALS			3.50			6.20

	H = STATIC HEAD = HIGHEST SYSTEM ELEV - PIPE CONNECTION ELEV (m)	HL1 = FITTINGS FRICTION HEAD LOSS = (K TOTAL) (V)**2/2G (m)	HL2 = PIPE WALL FRICTION HEAD LOSS = $6.78 (L)/(D)**1.1655 * (V/C)**1.85$ (m)	HL3 = VELOCITY HEAD = $(V)**2 / 2G$ (m)	H TOTAL = TOTAL DYNAMIC HEAD = H + HL1 + HL2 + HL3 (m)	SYSTEM PRESSURE LOSS (Kpa)	SYSTEM PRESSURE LOSS (psi)		
Existing Private Watermain	0.54	0.007	n/a	0.08	n/a	0.63	n/a	6.17	0.89
Proposed Private Watermain	-0.26	0.012	n/a	0.17	n/a	-0.08	n/a	-0.75	-0.11

Provided Max Day + Fire Flow Pressure at Connection 1

59.52

psi

Proposed Pressure at the Building

58.74

psi

**CFA College Square - Max Day + Fire Flow - Private Watermain - PRESSURE LOSS CALCULATION**

	Q = REQUIRED FLOW for FIRE PROTECTION (L/S)	Q = REQUIRED FLOW for DOMESTIC DEMAND (L/S)	D = NOMINAL PIPE DIAMETER (m)	L = LENGTH OF WATERMAIN (m)	TYPE	C VALUE	INSIDE DIAMETER (m)	WALL THICKNESS (m)	CROSS SECTIONAL AREA (m2)	V =FLOW VELOCITY (m/s)
Existing Private Watermain	n/a	0.3	0.050	34.6	n/a	100	0.046	0.003	0.002	0.19
Proposed Private Watermain	n/a	0.3	0.050	72.9	PEX	100	0.046	0.003	0.002	0.19

	START TOP OF PIPE ELEV (m)	END TOP OF PIPE ELEV (m)	STATIC HEAD (m)
Existing Private Watermain	84.74	84.20	0.54
Proposed Private Watermain	84.74	85.00	-0.26

	MINOR HEAD LOSSES					
	200 mm PVC			50mm PVC		
	Existing Private Watermain			Proposed Private Watermain		
	Number	K	Sub Total K	Number	K	Sub Total K
Inlet Anti Vortex Plate		1.00	0.00		1.00	0.00
Pipe Contraction		0.25	0.00		0.25	0.00
Pipe Expansion		0.25	0.00		0.25	0.00
Strainer/Reducer		0.50	0.00		0.50	0.00
Standard 90d Bend	1	0.90	0.90		0.90	0.00
Standard 45d Bend		0.45	0.00	0	0.45	0.00
Standard 22.5d Bend		0.23	0.00		0.23	0.00
Standard 11.25d Bend		0.10	0.00		0.10	0.00
Long Radius Bend, 45d / 90d		0.50	0.00		0.50	0.00
Tee - flow through run		0.60	0.00		0.60	0.00
Tee - flow through branch	1	1.80	1.80		1.80	0.00
Gate Valve	1	0.40	0.40		0.40	0.00
300mm to 400mm Pipe Expansion		0.20	0.00		0.20	0.00
Backflow Preventor		1.20	0.00	1	1.20	1.20
Meter		5.00	0.00	1	5.00	5.00
Drain Valve	1	0.40	0.40		0.40	0.00
Check Valve		4.00	0.00		4.00	0.00
Pipe Exit		1.00	0.00		1.00	0.00
K TOTALS			3.50			6.20

	H = STATIC HEAD = HIGHEST SYSTEM ELEV - PIPE CONNECTION ELEV (m)	HL1 = FITTINGS FRICTION HEAD LOSS = (K TOTAL) (V)**2/2G (m)	HL2 = PIPE WALL FRICTION HEAD LOSS = $6.78 (L)/(D)**1.1655 * (V/C)**1.85$ (m)	HL3 = VELOCITY HEAD = $(V)**2 / 2G$ (m)	H TOTAL = TOTAL DYNAMIC HEAD = H + HL1 + HL2 + HL3 (m)	SYSTEM PRESSURE LOSS (Kpa)	SYSTEM PRESSURE LOSS (psi)		
Existing Private Watermain	0.54	0.007	n/a	0.08	n/a	0.63	n/a	6.17	0.89
Proposed Private Watermain	-0.26	0.012	n/a	0.17	n/a	-0.08	n/a	-0.75	-0.11

Provided Max Day + Fire Flow Pressure at Connection 1

59.10

psi

Proposed Pressure at the Building

58.31

psi