




ADIPC & BFCN TANK ANCHORING DETAIL

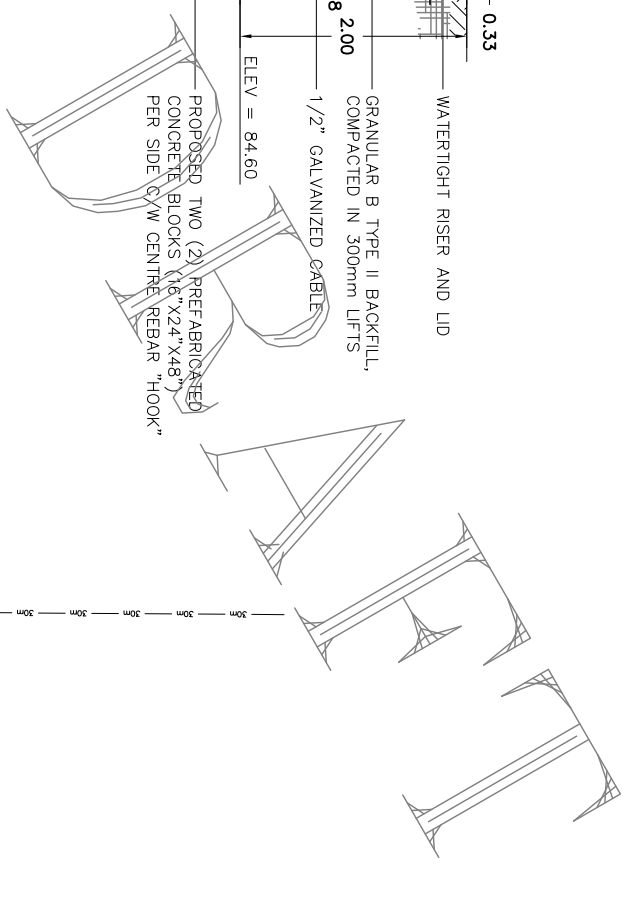

TREATMENT UNITS

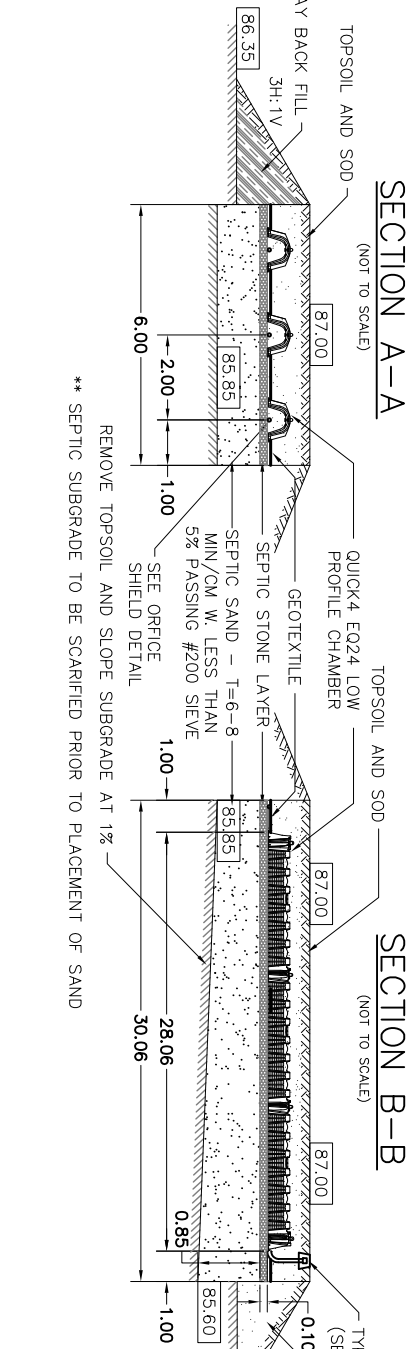

CLEANOUT DETAIL

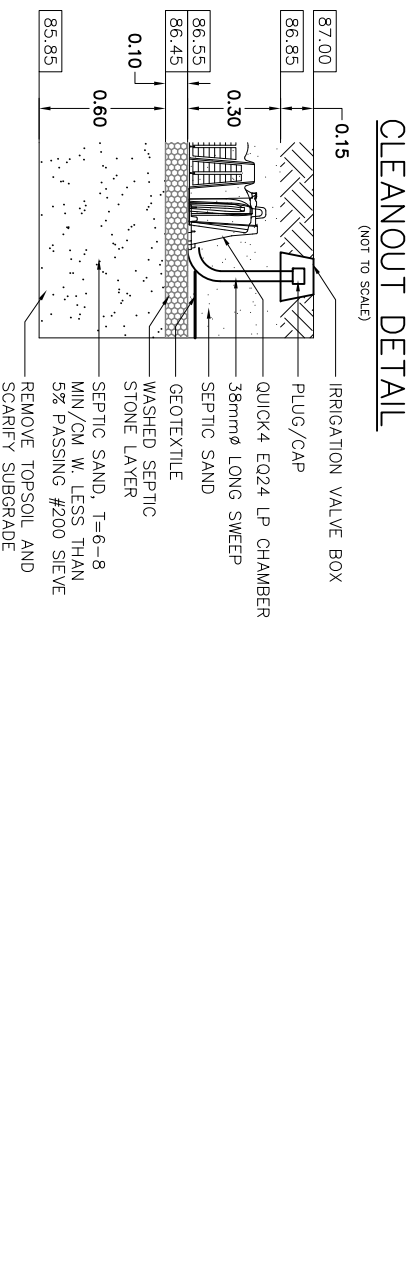

- CLEARANCE DISTANCES.**
- Minimum clearance from tanks to:
- structure = 1.5m
 - property line = 1.5m
 - drilled well = 15m
- Minimum clearance from distribution piping to:
- structure = 6.3m
 - property line = 4.3m
 - drilled well = 16.3m
- td.


Kollard Associates
Engineers

210 PRESCOTT STREET
2ND FLOOR
KEMPVILLE ONTARIO
K0G 1J0

FAX (613) 256-0475
www.kollard.ca
info@kollard.ca

3043 DUNNING ROAD,
R1 PLAN 4R-11019, PART 1
LOT 7 & 8, CONC. 4
CUMBERLAND, CITY OF OTTAWA

LAPLANTE POULTRY FARMS

SEWAGE SYSTEM DESIGN