
DRY HYDRANT INSTALLATION - SURFACE WATER SOURCE

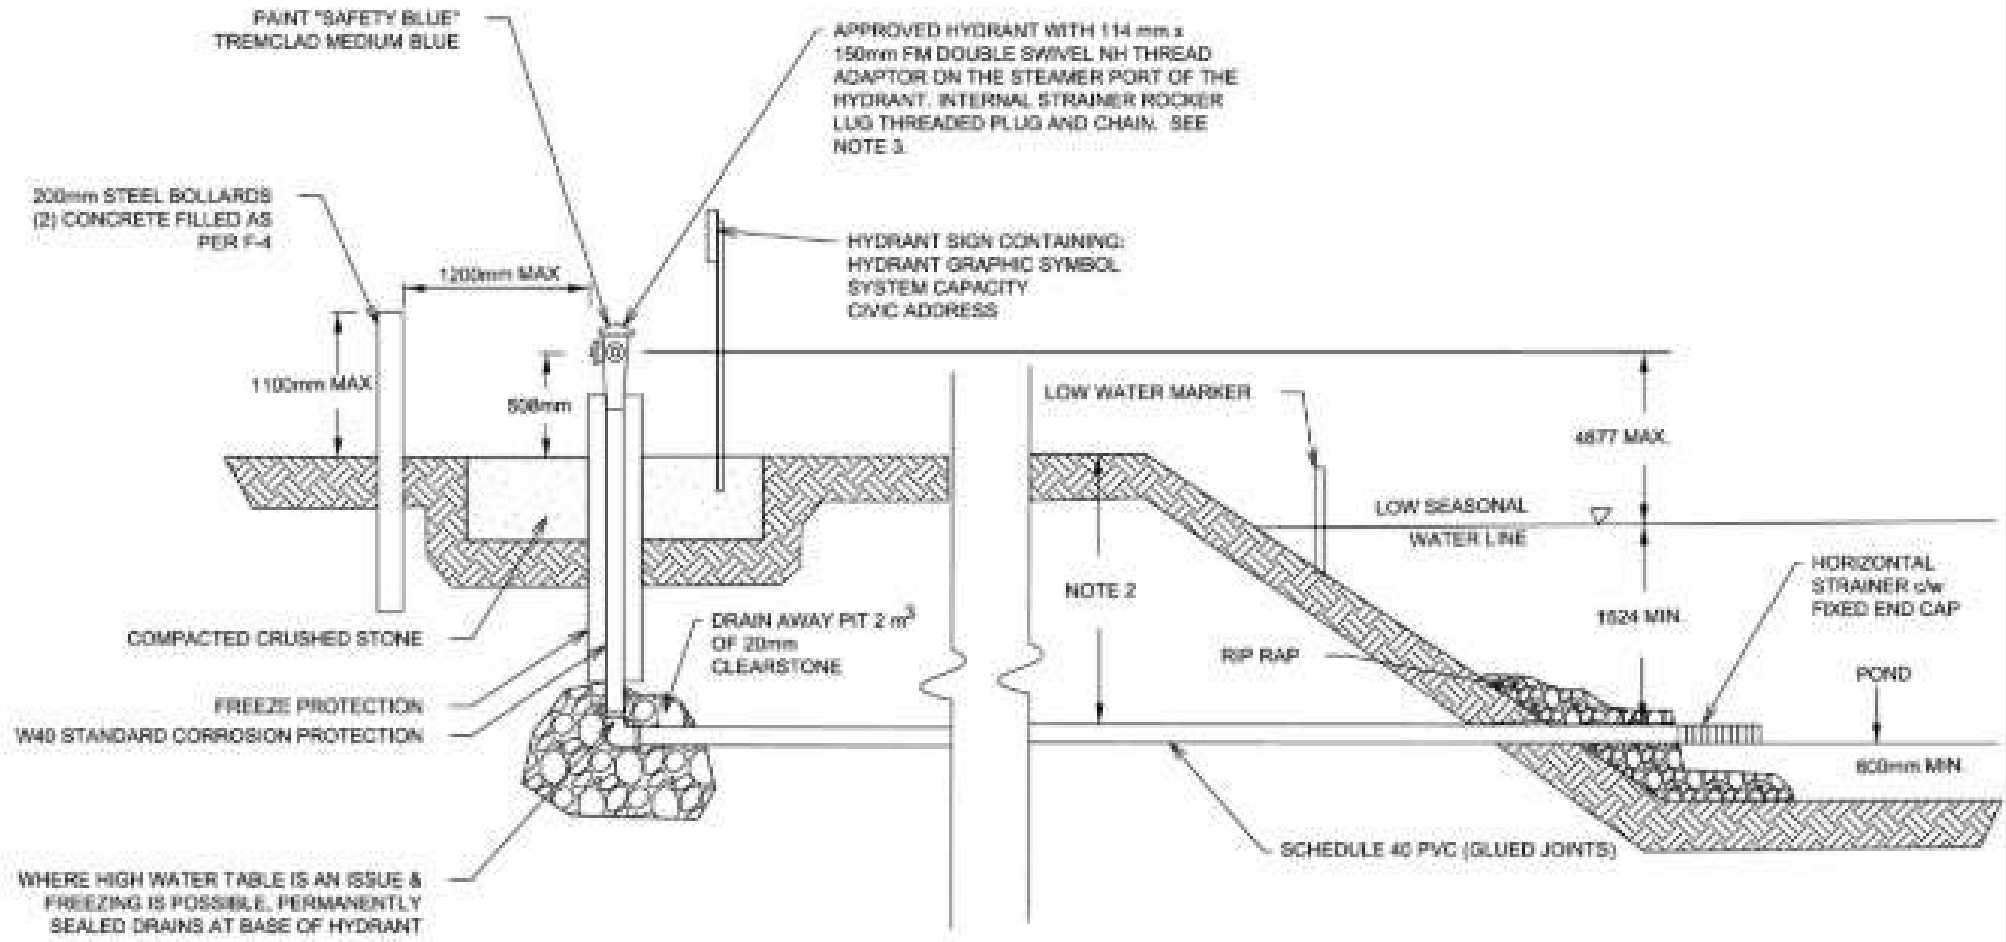

NOTES

1. THESE ARE TYPICAL SPECIFICATIONS. LOCAL CONDITIONS MAY REQUIRE DEVIATION. ANY DEVIATION MUST BE APPROVED BY CONTRACT ADMINISTRATOR.
2. PIPING TO BE INSTALLED AT POSITIVE GRADE WITH NO HIGH OR LOW POINTS BETWEEN HYDRANT BASE AND INTAKE.
3. ALTERNATE SCHEDULE 40 STEEL PIPE WITH 90° ELBOW AND COULING AT TOP OF RISER PREFERRED WHERE RISK OF FREEZING IS NOT A THREAT.
4. PROVIDE CORROSION AND THRUST RESTRAINT AS PER THE STANDARD.

N.T.S.

DWG. No.: W53

REV./ DATE:

DATE: MARCH 2018