
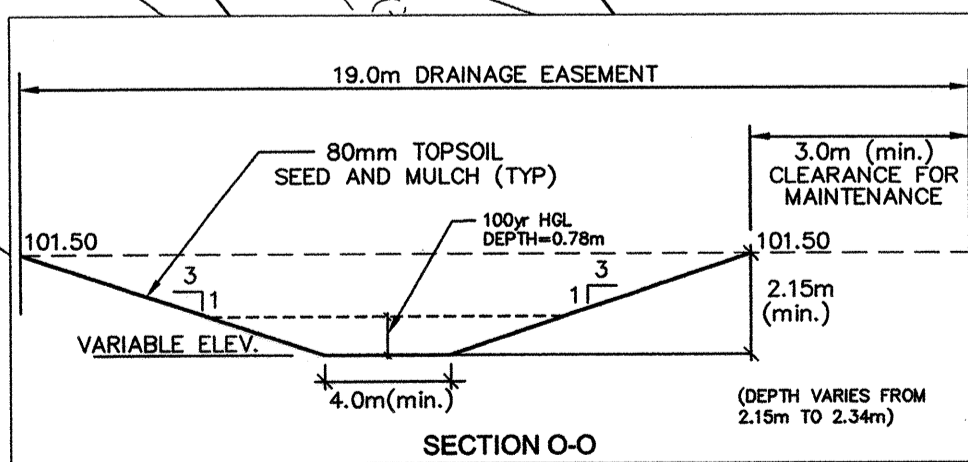
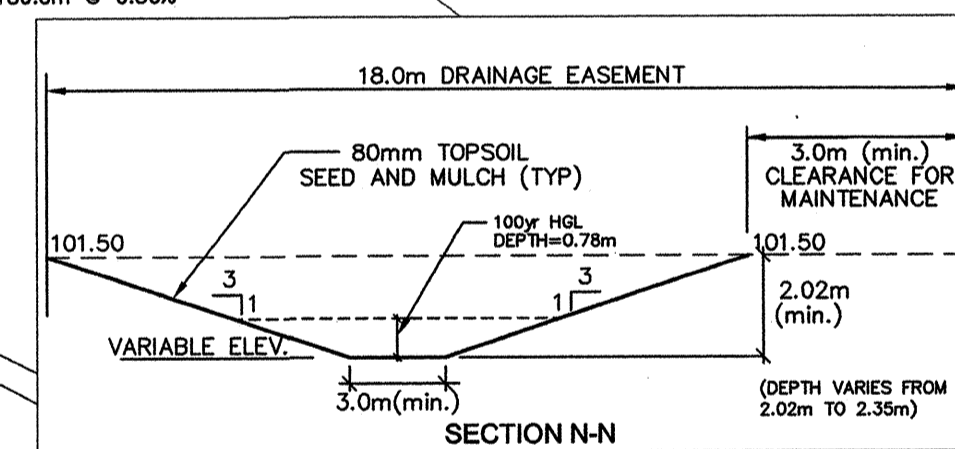



REGRADE EXISTING DITCH
400.0m @ 0.20%

I.D. NUMBER	CULVERT PIPE SIZE	REMARKS	CULVERT INVERTS UPSTREAM / DOWNSTREAM
B, C	(2) 1.03mx0.72m	CSPA, 2.81h	101.26 / 101.19
F, F1	600mm ϕ	CSP, 2.81h	102.66 / 102.58
G1, G2	600mm ϕ	CSP, 2.81h	102.69 / 102.65
G, H	(2) 1.39mx0.97m	CSPA, 2.81h	101.03 / 101.00
I, J	600mm ϕ	CSP, 2.81h	101.80 / 101.73
K, K1	(2) 1400mm ϕ	CSP, 2.81h	99.97 / 99.85
L, M	600mm ϕ	CSP, 2.81h	101.29 / 101.22
N, O	600mm ϕ	CSP, 2.81h	101.01 / 100.94
P, Q	600mm ϕ	CSP, 2.81h	101.08 / 101.01
R, S	800mm ϕ	CSP, 2.81h	100.16 / 100.09

* ALL DRIVEWAY AND TRANSFORMER CULVERTS SHALL BE 9.0m - 500mm SIZE, 2.01h WITH THE EXCEPTION OF LOTS B2 WHICH WILL BE (2) 1.39mx0.97m, 2.81h.

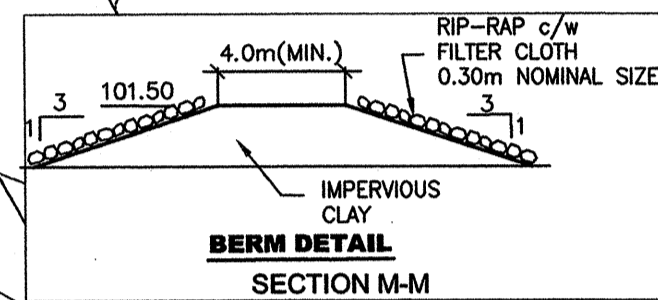

V:\01_2010\01\60400144\Drawings\60400144-TRP-15542.dwg
 2012-09-28 10:58:28 PLT:MMB By: MMB



Stantec Consulting Ltd.
1505 Laperriere Avenue
Ottawa On Canada
K1Z 7T1
Tel. 613.722.4420
Fax. 613.722.2799
www.stantec.com

Stantec

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec Consulting Ltd. without delay.
The Copyrights to all designs and drawings are the property of Stantec Consulting Ltd. Reproduction or use for other than that authorized by Stantec Consulting Ltd. is forbidden.

Legend

- PROPOSED CULVERT
- PROPOSED DITCH
- PROPOSED HOUSE ELEVATION AND LOT NUMBER, PROPOSED ELEVATION TO BE IMPLEMENTED AROUND ALL SIDES OF THE HOUSE ENVELOPES.
- LOTS NUMBERS INDICATED IN SQUARE BRACKETS REFER TO REGISTERED LOTS FOR PHASE 2
- PARTIALLY-RAISED LEACHING BED WITH NATIVE MATERIAL (8 RUNS OF 15m) MIN. 8m FROM ANY STRUCTURES MIN. 6m FROM ANY PROPERTY LINES. (REFER: J.D. PATTERSON AND ASSOC. REPORT #8329-03 DATED MAY 12, 2003. REVISED APRIL 04, 2005)
- SPARE AREA FOR PARTIALLY-RAISED LEACHING BED (8 RUNS OF 15m) AND BED ELEVATIONS
- PROPOSED DRILLED WELL
- HAND AUGER HOLE LOCATION
- TEST WELL LOCATION
- TREE RETENTION AREA
- PROPOSED LOT CORNER ELEVATION EXISTING LOT CORNER ELEVATION
- PROPOSED Q DITCH ELEVATION
- 100 YR FLD 100 YEAR FLOOD ELEVATION
- FILL TO PROVIDE DITCH BACK SLOPE
- CULVERT IDENTIFICATION
- GW=101.0m GROUND WATER ELEVATION (MARCH 17, 2005)
- USF(MIN) 101.80 LOWEST USF BASED ON GROUND WATER ELEVATIONS. SEE NOTES 4 & 5
- 100yr HGL ELEVATION
- NOISE FENCE


Notes

- ELEVATIONS AT HOUSES ARE BASED ON PARTIALLY RAISED TILE BEDS ON GRAVITY SYSTEM. IF PUMPING IS USED HOUSE ELEVATIONS CAN BE LOWERED. SEPTIC SYSTEM LAYOUT TO BE REVISED ON A LOT BY LOT BASIS.
- CAUTION: LOWERING OF FOUNDATIONS BELOW GROUND WATER TABLE WILL RESULT IN EXCESSIVE OPERATION OF PUMP PUMPS.
- REFER TO GP-4 FOR GRADING DETAILS.
- ALL DITCHES SHALL BE c/w 80mm TOPSOIL SEED AND MULCH.
- GW - RECORDED GROUND WATER ELEVATION. UNDERSIDE OF FOOTING (USF) ELEVATIONS SHALL BE 0.15m (MIN) ABOVE THIS ELEVATION. AS PER THE GEOTECHNICAL REPORT THE FOLLOWING OPTIONS ARE TO BE CONSIDERED FOR DRAINAGE AT THE RESIDENTIAL STRUCTURES:
 - DAMP PROOF THE EXTERIOR OF THE FOUNDATION WALLS AND BACKFILL THE WALLS WITH FREE DRAINING, NON-FROST SUSCEPTIBLE SAND OR SAND AND GRAVEL, SUCH AS THAT MEETING ONTARIO PROVINCIAL STANDARD SPECIFICATIONS (OPSS) REQUIREMENTS FOR GRANULAR 5 TYPE 1, OR
 - INSTALL AND APPROVED PROPRIETARY DRAINAGE MATERIAL (SUCH AS SYSTEM PLATION) ON THE EXTERIOR OF THE FOUNDATION WALLS AND BACKFILL THE WALLS WITH NATIVE MATERIAL OR IMPORTED SOIL.
- A PERFORATED DRAIN SHOULD BE INSTALLED AROUND THE BASEMENT AREA AT THE LEVEL OF THE BOTTOM OF THE FOOTINGS. THE DRAIN SHOULD OUTLET TO A SUMP FROM WHICH THE WATER IS PUMPED OR SHOULD DRAIN BY GRAVITY TO A SUITABLE CULVERT.
- USF IS TYPICALLY BASED ON THE FINISHED HOUSE ELEVATIONS (LESS 2.25m) HOWEVER THE (MINIMUM) USF IS THE LOWEST ELEVATION THE LOT CAN BE BASED ON EITHER THE GWL OR 100 YEAR FLOOD ELEVATION WHICH EVER IS GREATER.

Revision	By	Appd.	Date

File Name: 60400144-TRP-RETENTION G.B.U. TJW TJW 13.01.17
Dwn. Chkd. Dagn. Date

Seals

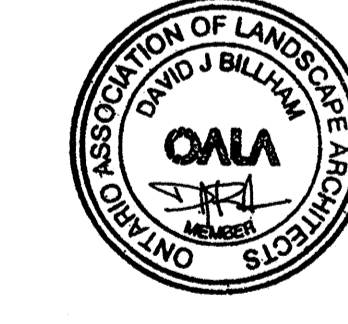

2012-12-0004
Reviewed By
Development Review Branch
Signed: [Signature]
Date: 29/01/2013

Client/Project
CAVANAGH CONSTRUCTION


EMERALD LINKS SUBDIVISION

Ottawa, Ontario

TITLE
TREE RETENTION PLAN (PHASE 2)

Project No.	Scale
60400144	0 7.5 22.5 37.5m 1:750

Drawing No.	Sheet	Revision
TRP-3	3 of 4	0

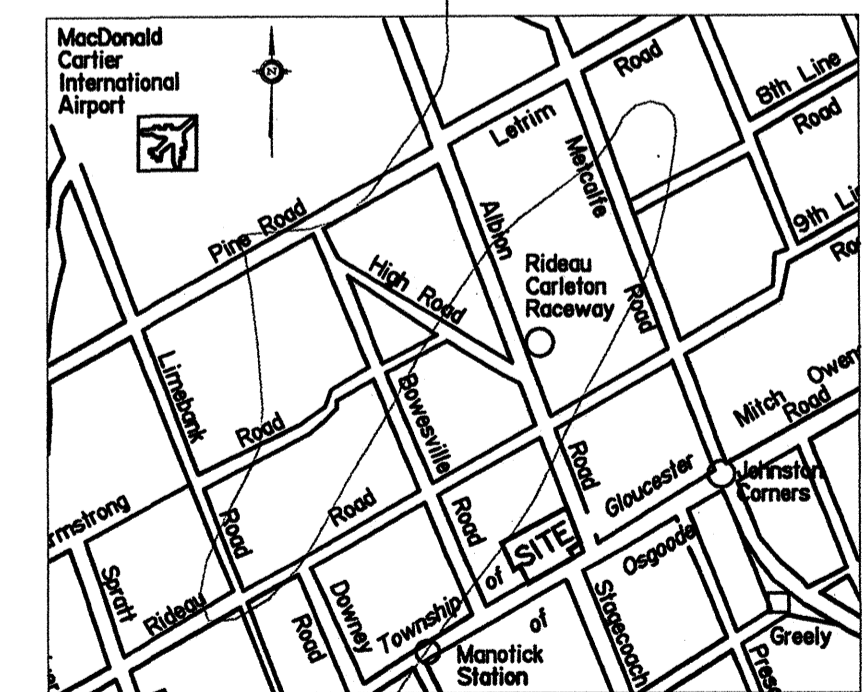

2012-12-0004
 DWG# 15542