


M:\2020\122040\CAD\Civil\122040-PP.dwg, PP2, Jul 10, 2024 - 2:39pm, amestwarp

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS,
WATERMAINS, SEWERS AND OTHER
UNDERGROUND AND OVERGROUND UTILITIES AND
STRUCTURES IS NOT NECESSARILY SHOWN ON
THE CONTRACT DRAWINGS, AND WHERE SHOWN,
THE ACCURACY OF THE POSITION OF SUCH
UTILITIES AND STRUCTURES IS NOT GUARANTEED,
BEFORE STARTING WORK, DETERMINE THE EXACT
LOCATION OF ALL SUCH UTILITIES AND
STRUCTURES AND ASSUME ALL LIABILITY FOR
DAMAGE TO THEM.


CLARIDGE HOMES

CLARIDGE HOMES
505 PRESTON STREET,
2ND FLOOR
OTTAWA , ONTARIO
K1S 4N7.

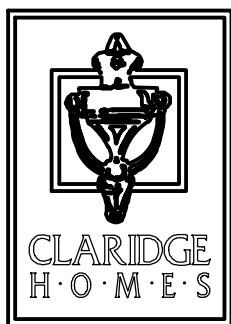

NOT FOR
CONSTRUCTION

No.	REVISION	DATE	BY
7.	ISSUED FOR CITY APPROVAL	AUG 13/24	ARM
6.	REVISED SITE PLAN	JULY 12/24	ARM
5.	REVISED PER CITY COMMENTS	JAN 31/24	ARM
4.	REVISED SITE PLAN	SEPT 29/23	ARM
3.	ISSUED FOR UTILITY COORDINATION	SEPT 20/23	ARM
2.	REVISED PER CITY COMMENTS	MAY 26/23	GJM
1.	ISSUED IN SUPPORT OF DEVELOPMENT APPLICATIONS	NOV 01/22	GJM

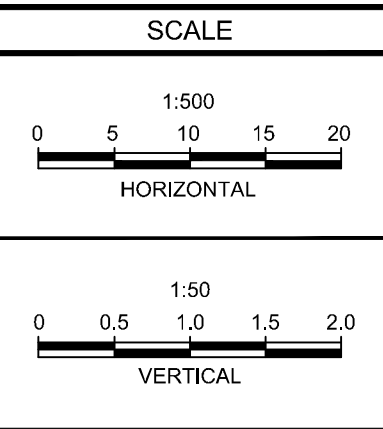

DESIGN	ARM
CHECKED	
DRAWN	GJM
CHECKED	CJF/ARM
APPROVED	ARM
	GJM

FOR REVIEW ONLY



LOCATION
CITY OF OTTAWA
2510 ST. LAURENT BOULEVARD

DRAWING NAME
PLAN & PROFILE
STREET 1 1+000.00 - 1+175.00

PROJECT No.

122040



REV

REV#7

DRAWING No.



122040 - PP2

PLANNING - 07/10/2024

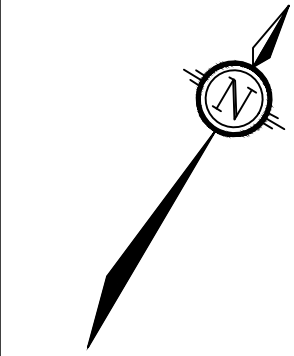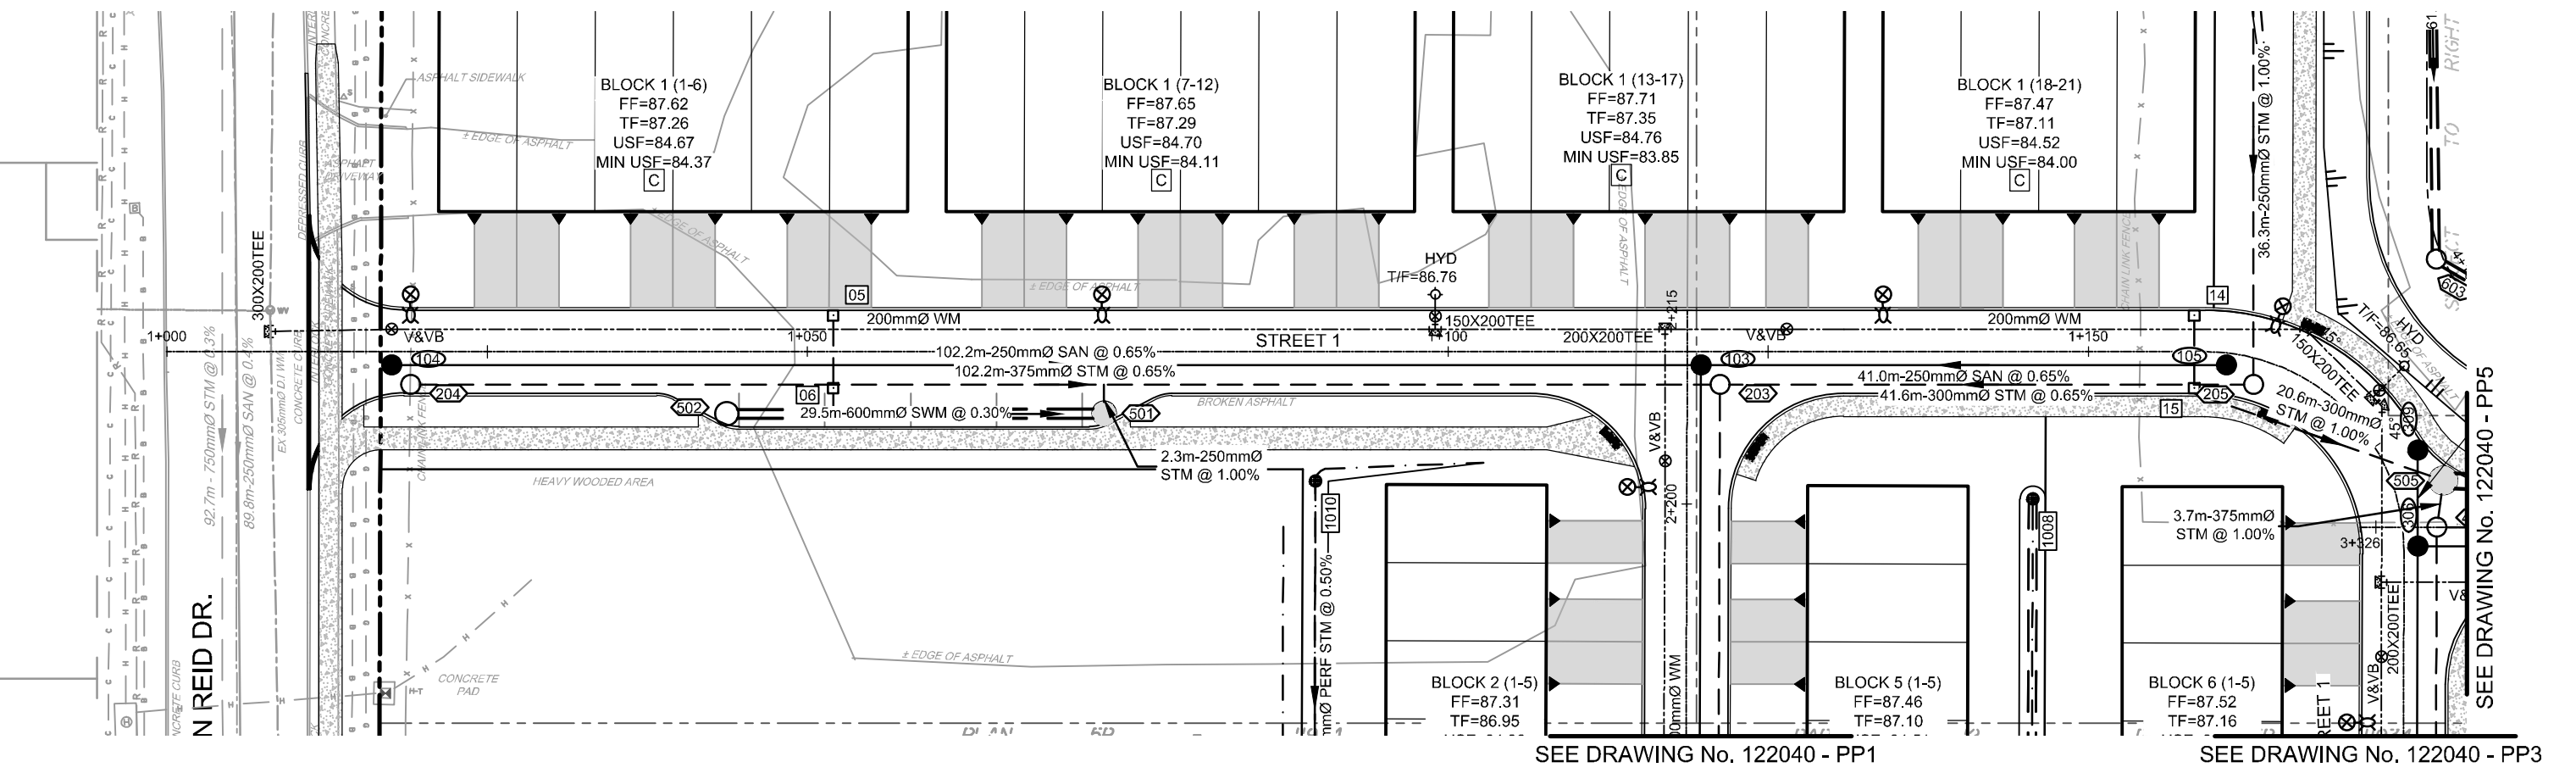

NORTH

KEY PLAN
N.T.S.

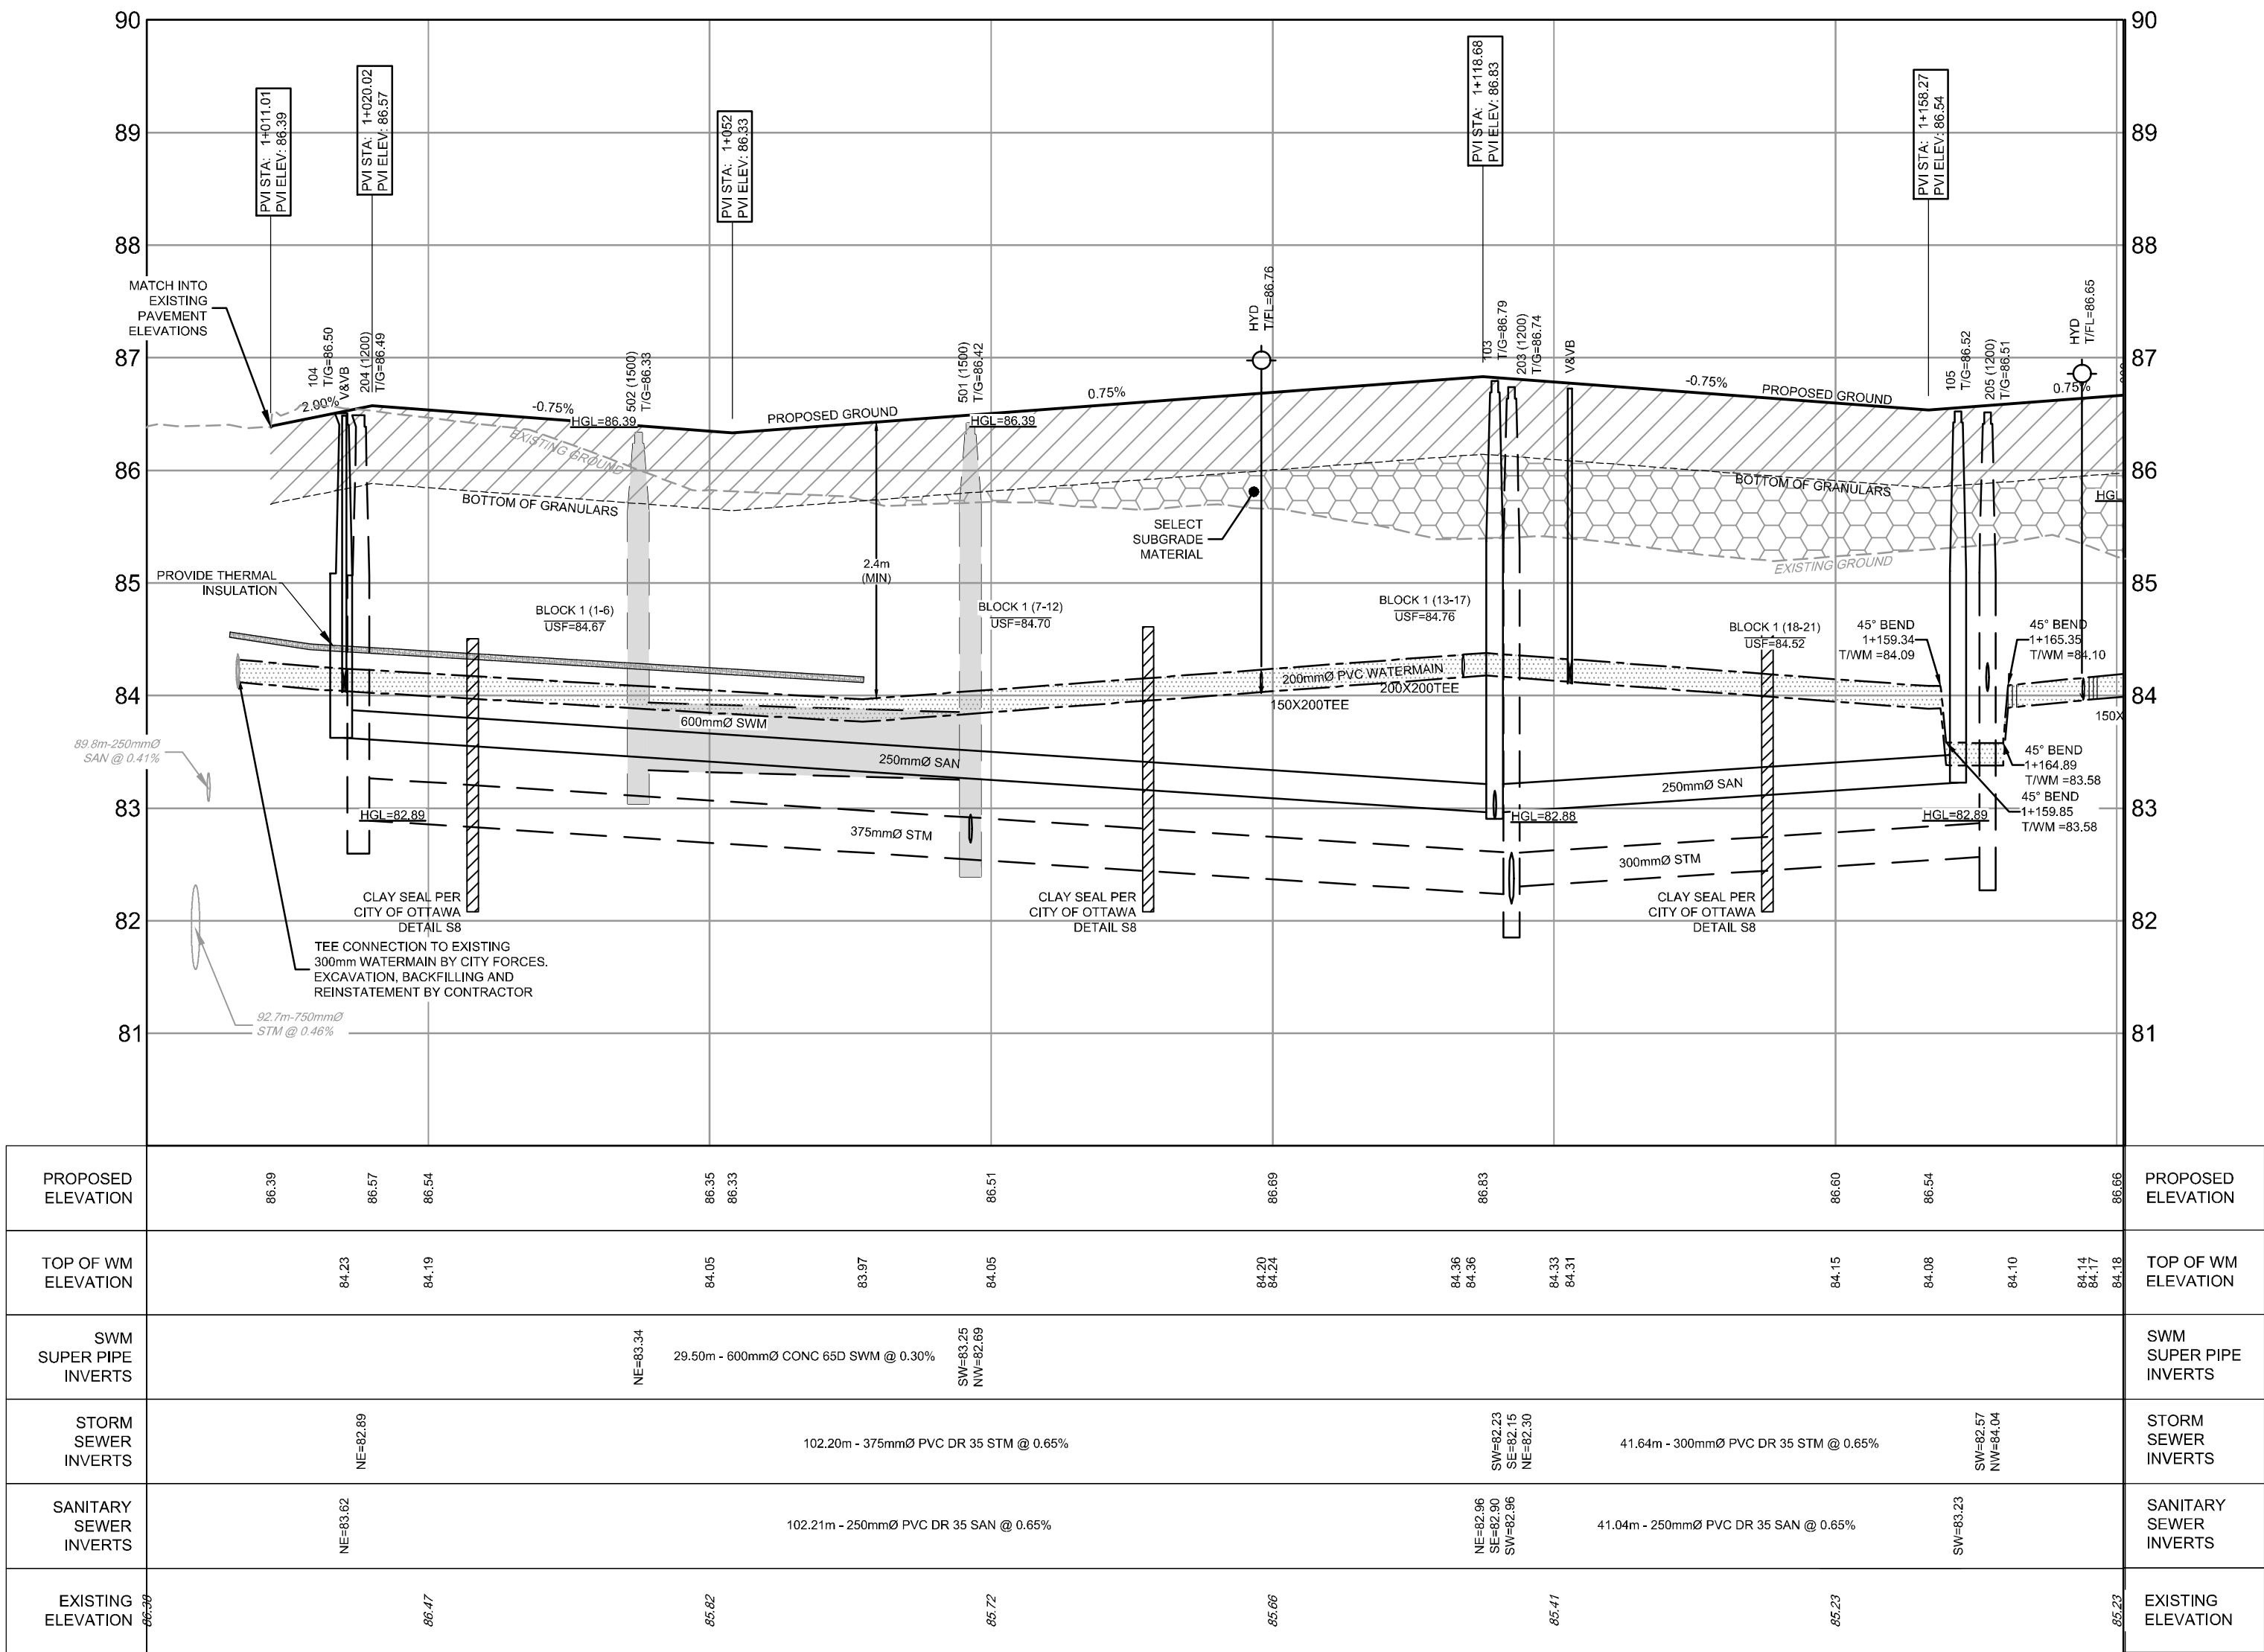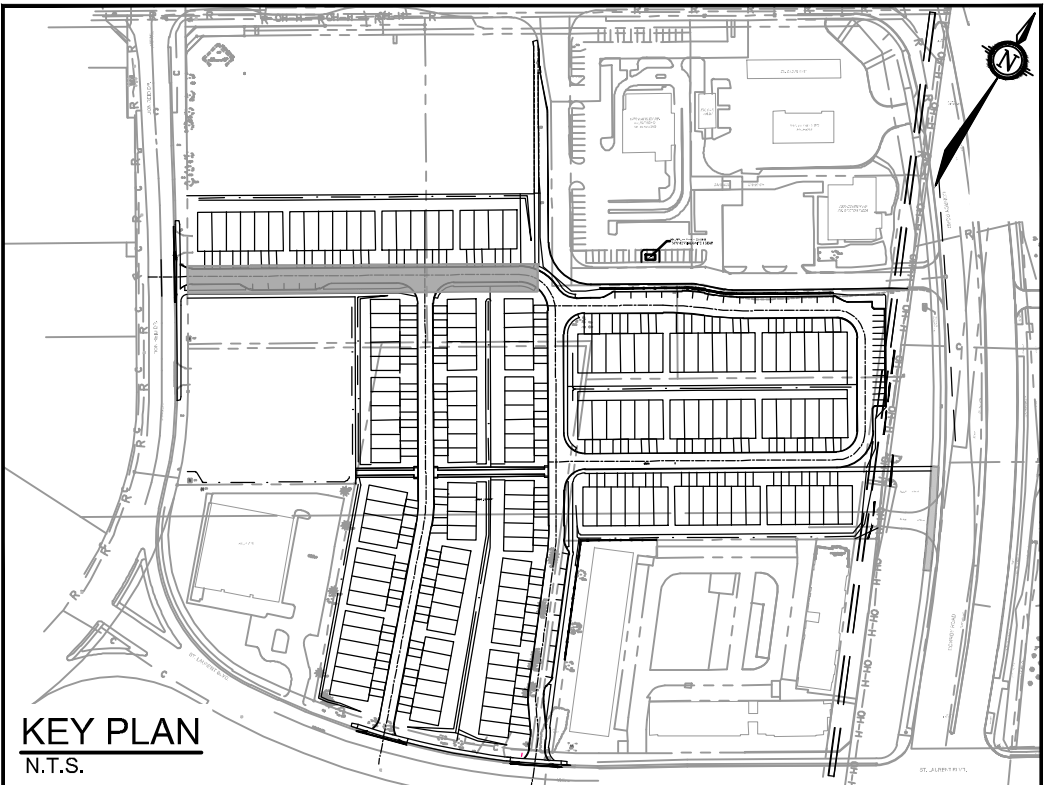

PROPOSED 200mmØ WATERMAIN			
STATION	SURFACE ELEVATION	T/W M ELEVATION	COMMENTS
1+008.1	86.37	±84.33'	CONNECTION TO EXISTING 300mmØ WATERMAIN
1+017.5	86.49	84.23	VALVE AND VALVE BOX
1+052.0	86.28	84.04	CROSS BELOW 300mmØ CB LEAD - INV 85.03 (0.99m CLEARANCE)
1+099.0	86.62	84.20	200mm X150mm TEE TO HYDRANT
1+116.9	86.77	84.36	200mmX200mm TEE
1+128.2	86.71	84.31	VALVE AND VALVE BOX
1+158.3	86.48	84.08	CROSS BELOW 300mmØ CB LEAD - INV 85.23 (1.15m CLEARANCE)
1+159.3	86.54	84.09	VERTICAL 45° BEND
1+159.9	86.55	83.58	VERTICAL 45° BEND
1+162.4	86.50	83.58	CROSS BELOW 250mmØ CB LEAD - INV 84.08 (0.50m CLEARANCE)
1+164.9	86.58	83.58	VERTICAL 45° BEND
1+165.4	86.58	84.10	VERTICAL 45° BEND
1+165.7	86.54	84.10	HORIZONTAL 45° BEND
1+172.0	86.57	84.16	200mm X150mm TEE TO HYDRANT
1+172.9	86.58	84.17	HORIZONTAL 45° BEND

* CONTRACTOR TO CONFIRM EXISTING WATERMAIN ELEVATION INFIELD AND NOTIFY ENGINEER IF DIFFERENT FROM THE PLANS