

**Geotechnical
Engineering**

**Environmental
Engineering**

Hydrogeology

**Geological
Engineering**

Materials Testing

Building Science

Archaeological Services

patersongroup

Geotechnical Investigation

Proposed Residential Development
Summerside West - Phases 4, 5 and 6
Tenth Line Road - Ottawa

Prepared For

2447591 Ontario Inc.

Paterson Group Inc.

Consulting Engineers
154 Colonnade Road South
Ottawa (Nepean), Ontario
Canada K2E 7J5

Tel: (613) 226-7381
Fax: (613) 226-6344
www.patersongroup.ca

August 8, 2018

Report: PG4049-2 Revision 1

Table of Contents

	Page
1.0 Introduction	1
2.0 Proposed Development	1
3.0 Method of Investigation	
3.1 Field Investigation	2
3.2 Field Survey	3
3.3 Laboratory Testing	3
3.4 Analytical Testing	4
4.0 Observations	
4.1 Surface Conditions	5
4.2 Subsurface Profile	5
4.3 Groundwater	7
4.4 Test Fill Settlement Monitoring Program	9
5.0 Discussion	
5.1 Geotechnical Assessment	10
5.2 Site Grading and Preparation	10
5.3 Foundation Design	11
5.4 Design of Earthquakes	13
5.5 Basement Slab	13
5.6 Pavement Structure	13
6.0 Design and Construction Precautions	
6.1 Foundation Drainage and Backfill	16
6.2 Protection Against Frost Action	16
6.3 Excavation Side Slopes	16
6.4 Pipe Bedding and Backfill	18
6.5 Groundwater Control	20
6.6 Winter Construction	20
6.7 Corrosion Potential and Sulphate	21
6.8 Landscaping Considerations	21
7.0 Recommendations	24
8.0 Statement of Limitations	25

Appendices

- Appendix 1 Soil Profile and Test Data Sheets
 Symbols and Terms
 Analytical Test Results
 Atterberg Limits Testing Results
 Grain Size Distribution Sheets
- Appendix 2 Figure 1 - Key Plan
 Figure 2 - Test Fill Pile Settlement Monitoring Program
 Drawing PG4049-1 - Test Hole Location Plan
 Drawing PG4049-3 - Tree Planting Setback Recommendations

1.0 Introduction

Paterson Group (Paterson) was commissioned by 2447591 Ontario Inc. to conduct a preliminary geotechnical investigation for the proposed residential development to be located between Mer Bleue Road and Tenth Line Road, in the City of Ottawa (refer to Figure 1 - Key Plan presented in Appendix 2). The objective of the investigation was to:

- ❑ determine the subsurface soil and groundwater conditions by means of a boreholes and a monitoring well program.
- ❑ provide geotechnical recommendations for the foundation design for the proposed buildings and pavement structure design of the proposed development including construction considerations which may affect the design.

The following report has been prepared specifically and solely for the aforementioned project which is described herein. The report contains our findings and includes geotechnical recommendations pertaining to the design and construction of the proposed development as understood at the time of this report.

Investigating the presence or potential presence of contamination on the subject property was not part of the scope of work of this present investigation. Therefore, the present report does not address environmental issues.

2.0 Proposed Development

It is understood that the proposed development will consist of low rise residential dwellings and townhouse style housing. Local roadways and residential driveways are also anticipated for the proposed development. It is further anticipated that the site will be serviced by future municipal services.

3.0 Method of Investigation

3.1 Field Investigation

The field program for the current investigation was carried out on February 27 and 28, 2017. At that time, 14 boreholes were completed to a maximum depth of 6.1 m below existing ground surface. The test hole locations were placed in a manner to provide general coverage of the subject site taking into consideration site features and underground utilities. The test hole locations for the current investigation are presented on Drawing PG4049-1 - Test Hole Location Plan included in Appendix 2.

The boreholes were completed using a track-mounted auger drill rig operated by a two person crew. All fieldwork was conducted under the full-time supervision of Paterson personnel under the direction of a senior engineer from the geotechnical division. The testing procedure consisted of augering to the required depths and at the selected locations sampling the overburden.

Sampling and In Situ Testing

Soil samples were collected from the boreholes using a 50 mm diameter split-spoon (SS) sampler, or from the auger flights. The depths at which the auger and split spoon samples were recovered from the test holes are shown as AU, and SS, respectively, on the Soil Profile and Test Data sheets in Appendix 1.

A Standard Penetration Test (SPT) was conducted in conjunction with the recovery of the split spoon samples. The SPT results are recorded as "N" values on the Soil Profile and Test Data sheets. The "N" value is the number of blows required to drive the split spoon sampler 300 mm into the soil after a 150 mm initial penetration using a 63.5 kg hammer falling from a height of 760 mm. This testing was done in general accordance with ASTM D1586-11 - Standard Test Method for Penetration Test and Split-Barrel Sampling of Soils.

Undrained shear strength testing was carried out in cohesive soils using a field vane apparatus.

The overburden thickness was evaluated by a dynamic cone penetration test (DCPT) completed at MW 3B. The DCPT consists of driving a steel drill rod, equipped with a 50 mm diameter cone at the tip, using a 63.5 kg hammer falling from a height of 760 mm. The number of blows required to drive the cone into the soil is recorded for each 300 mm increment.

Subsurface conditions observed in the test holes were recorded in detail in the field. Reference should be made to the Soil Profile and Test Data sheets presented in Appendix 1 for specific details of the soil profile encountered at the test hole locations

Groundwater

Groundwater monitoring wells were installed in all the boreholes to monitor the longterm groundwater level subsequent to the completion of the sampling program. The groundwater observations are discussed in Subsection 4.3 and presented in the Soil Profile and Test Data sheets in Appendix 1.

Sample Storage

All samples from the current investigation will be stored in the laboratory for a period of one month after issuance of this report. They will then be discarded unless we are otherwise directed.

3.2 Field Survey

The test hole locations were determined by Paterson personnel and were located and surveyed in the field by JD Barnes Limited. The locations of the boreholes are presented on Drawing PG4049-1 - Test Hole Location Plan in Appendix 2.

3.3 Laboratory Testing

The soil samples recovered from the our field investigation were examined in our laboratory. 17 Atterberg limits tests were completed on selected silty clay samples. Grain Size distribution (hydrometer) testing was also completed on four (4) selected soil samples and one (1) soil samples submitted for shrinkage testing. The results are presented in Subsection 4.2 of our current report.

3.4 Analytical Testing

One (1) soil sample was submitted for analytical testing to assess the corrosion potential for exposed ferrous metals and the potential of sulphate attacks against subsurface concrete structures. The sample was submitted to determine the concentration of sulphate and chloride, the resistivity and the pH of the sample. The results are presented in Appendix 1 and are discussed further in Subsection 6.7.

4.0 Observations

4.1 Surface Conditions

The subject site is currently undeveloped, agricultural land and is grass covered. McKinnons Creek transects the eastern portion of the property. Several shallow drainage ditches were also observed along the property lines and throughout the site for agricultural drainage purposes. The subject site is relatively flat and slightly below grade of Mer Bleue Road and Tenth Line Road. The site is bordered to the north by a residential development currently under construction, to the east by Tenth Line Road, to the West by Mer Bleue Road and to the south by mostly vacant land and some treed areas. Various piles of fill, topsoil and construction debris were observed along the north perimeter of the subject site.

4.2 Subsurface Profile

Generally, the soil profile encountered at the test hole locations consists of an agriculturally disturbed organic layer overlying a stiff brown silty clay crust followed by a deep, firm grey silty clay deposit. A silty sand layer approximately 1 m in thickness was present between the topsoil layer and silty clay deposit at MW 3A. A DCPT was completed at MW 3B with no practical refusal to a depth of 30 m below the existing ground surface. Reference should be made to the Soil Profile and Test Data sheets in Appendix 1 for the details of the soil profile encountered at each test hole location.

Based on available geological mapping, the bedrock in the area is part of the Lindsay formation, which consists of interbedded limestone and shale. Also, based on available geological mapping, the overburden thickness is expected to range from 25 to 50 m.

Silty Clay

Silty clay was encountered immediately beneath the topsoil at all test hole locations with the exception of MW 3A. The upper portion of the silty clay has been weathered to a firm to very stiff brown crust. The crust extends to depths varying between 1.5 and 3 m. In situ shear vane field testing carried out within the silty clay layer in the lower portion of the weathered crust yielded undrained shear strength values ranging from approximately 31 to 140 kPa. These values are indicative of a firm to very stiff consistency. In situ shear vane field testing carried out within the grey silty clay yielded undrained shear strengths ranging from approximately 24 to 39 kPa. These values are indicative of a soft to firm consistency.

Table 1 - Summary of Atterberg Limits Tests					
Sample	Moisture Content %	Liquid Limit %	Plastic Limit %	Plasticity Index %	Classification
BH 1-18 SS 3	n/a	63	26	37	CH
BH 2-18 SS 2	38.0	75	25	50	CH
BH 3-18 SS 3	n/a	57	21	35	CH
BH 4-18 SS 2	49.5	66	20	46	CH
BH 5-18 SS 2	38.0	65	24	41	CH
BH 6-18 SS 3	n/a	45	28	17	ML
BH 7-18 SS 2	37.6	66	22	44	CH
BH 8-18 SS 2	35.2	73	20	53	CH
BH 9-18 SS 3	41.2	59	22	37	CH
BH 10-18 SS 2	42.0	59	22	37	CH
BH 11-18 SS 3	65.2	60	22	38	CH
BH 12-18 SS 2	40.1	72	24	48	CH
BH 12-18 SS 3	n/a	70	24	46	CH
BH 13-18 SS 3	38.7	65	22	43	CH
BH 14-18 SS 2	47.2	77	25	52	CH
BH 15-18 SS 3	n/a	59	24	35	CH
BH 16-18 SS 2	47.2	73	25	48	CH

The results of the shrinkage testing of BH 4-18 - SS 2 resulted in a shrinkage limit of 20% with a shrinkage ratio of **1.80**. Sieve analysis and hydrometer testing was completed on selected silty clay samples collected between design underside of footing and 3.5 m depth below finished grade. The results of our testing are presented in the Grain Size Distribution sheets presented in Appendix 1.

4.3 Groundwater

Paterson personnel completed the initial groundwater readings at MW 1 to MW 7 on May 2, 2017. Follow-up groundwater level readings were taken in August 10 and October 25, 2017 and May 11, 2018. The measured groundwater levels (GWLs) in the monitoring wells installed in the boreholes are summarized in Table 2 on the following page. It should be noted that surficial water from rain events can become trapped within a monitoring well installed in low permeability soils. Therefore, as is typically noted at sites with low permeability soils close to surface, such as the current site, the recorded groundwater levels noted at the monitoring well/piezometer locations are suspected to be elevated above water levels that will be observed during construction.

Long-term groundwater level can more accurately be estimated based on the observed colour, moisture levels and consistency of the recovered soil samples. Based on these observations, the long-term groundwater level is expected between 1.5 to 2.5 m depth. It should be noted that groundwater levels are subject to seasonal fluctuations, therefore the groundwater levels could vary at the time of construction.

Table 1 - Summary of Groundwater Level Readings

Test Hole Number	Ground Surface Elevation, m	Groundwater Levels, m							
		May 2, 2017		August 10, 2017		October 25, 2017		May 11, 2018	
		Depth	Elevation	Depth	Elevation	Depth	Elevation	Depth	Elevation
MW 1A	86.76	0.19	86.57	1.03	85.73	0.30	86.46	-	-
MW 1B	86.76	0.20	86.56	0.83	85.93	0.23	86.53	0.54	86.22
MW 2A	86.40	0.29	86.11	0.44	85.96	0.42	85.98	-	-
MW 2B	86.40	0.30	86.10	0.77	85.63	0.08	86.32	0.71	85.69
MW 3A	86.82	0.12	86.70	1.03	85.79	0.30	86.52	-	-
MW 3B	86.82	0.28	86.54	0.80	86.02	0.44	86.38	0.81	86.01
MW 4A	86.41	0.48	85.93	0.76	85.65	1.16	85.25	-	-
MW 4B	86.41	0.34	86.07	0.73	85.68	0.63	85.78	0.62	85.79
MW 5A	86.55	0.60	85.95	0.62	85.93	0.60	85.95	-	-
MW 5B	86.55	0.38	86.17	0.75	85.80	0.49	86.06	0.42	86.13
MW 6A	86.17	0.62	85.55	0.37	85.80	0.45	85.72	-	-
MW 6B	86.17	0.10	86.07	0.40	85.77	0.18	85.99	0.25	85.92
MW 7A	86.60	0.38	86.22	0.45	86.15	0.48	86.12	-	-
MW 7B	86.60	0.17	86.43	0.75	85.85	0.16	86.44	0.30	86.30

Note: - The ground surface elevations at each borehole location were provided by J. D. Barnes Limited.

4.4 Test Fill Settlement Monitoring Program

The test fill pile settlement monitoring program was initiated in July 2017 by placing silty clay fill over the existing ground surface and installing two (2) settlement plates at each test fill pile to accurately monitor on-going settlement. On July 4, 2017, SP1B and SP2B, and SP1C and SP2C were installed within Test Fill Piles B and C, respectively. SP1A and SP2A were installed within test pile A on July 6, 2017 and the initial survey was completed the same day. SP1D and SP2D, and SP1E and SP2E were installed within Test Fill Piles D and E, respectively, on July 13, 2017 and the initial surveys were completed on July 14, 2017.

The majority of the fill material consisted of brown silty clay, placed in several lifts and compacted using the bucket of a hydraulic shovel. The piles were shaped with a 1 percent slope in order to shed water from the surface.

As part of the settlement monitoring program, a total of five (5) temporary benchmarks (TBM) consisting of a steel settlement monitoring plate were installed approximately 1.6 m below the ground surface at strategic locations adjacent to each of the test fill piles. Geodetic elevations were provided for each of the temporary benchmarks by Agrodrain Systems Limited (ASL).

The results of our survey are presented in Figure 2 - Test Fill Settlement Monitoring Program in Appendix 2. Total settlement of less than 25 mm was observed at all of the test fill piles, except Test Fill Pile A where total settlement of less than 35 mm was recorded up to May 2018. Less than 5 mm of settlement was observed at all settlement monitoring plates over the last 6 months. Therefore, it is expected that majority of the primary settlement has occurred to date.

Based on the settlement data recorded and available soils information from the borehole locations, our permissible grade raise recommendations have been updated for the subject site. Our permissible grade raise recommendations for the subject site are presented in Subsection 5.3.

5.0 Discussion

5.1 Geotechnical Assessment

From a geotechnical perspective, the subject site is satisfactory for the proposed residential development. However, due to the presence of the sensitive silty clay layer, the proposed development will be subjected to grade raise restrictions.

Based on preliminary road grades, permissible grade raise exceedances are anticipated within the east portion of the subject site. A settlement surcharge program has been initiated in recent months and the outline of the current surcharge area is presented in Drawing PG4049-1 - Test Hole Location Plan in Appendix 2. It is expected that the settlement surcharge program will require 12 to 24 months depending on observed settlement rates during the surcharge program. Early removal of the surcharge fill before completion of the overall surcharge program occurs is permitted for lots/blocks, however, lightweight fill will be required to compensate for the permissible grade raise exceedances taking into consideration the induced settlement from the surcharge program. For areas where the proposed roadway grades exceed our permissible grade raise recommendations, the settlement surcharge program is required until adequate settlement rates are observed. Lightweight fill thickness and extents will be specified by Paterson based on final grading plans for lots/blocks where permissible grade raise exceedances occur and a surcharge program will not be completed. A summary table with our lightweight fill recommendations for each lot/block will be prepared once final grading plans are available. The summary table will be submitted as part of the Sensitive Soil Protocol Matrix required by the City of Ottawa Building Permit branch.

The above and other considerations are further discussed in the following sections.

5.2 Site Grading and Preparation

Stripping Depth

Topsoil and deleterious fill, such as those containing organic materials, should be stripped from under any buildings, paved areas, pipe bedding and other settlement sensitive structures.

Fill Placement

Fill used for grading beneath the building areas should consist, unless otherwise specified, of clean imported granular fill, such as Ontario Provincial Standard Specifications (OPSS) Granular A or Granular B Type II. Granular material should be tested and approved prior to delivery to the site. The fill should be placed in loose lifts of 300 mm thick or less and compacted using suitable compaction equipment for the lift thickness. Fill placed beneath the building areas should be compacted to at least 98% of the Standard Proctor Maximum Dry Density (SPMDD).

Non-specified existing fill along with site-excavated soil can be used as general landscaping fill and beneath parking areas where settlement of the ground surface is of minor concern. In landscaped areas, these materials should be spread in thin lifts and at least compacted by the tracks of the spreading equipment to minimize voids. If these materials are to be used to build up the subgrade level for areas to be paved, they should be compacted in thin lifts to a minimum density of 95% of the SPMDD. Non-specified existing fill and site-excavated soils are not suitable for use as backfill against foundation walls unless a composite drainage blanket connected to a perimeter drainage system is provided.

5.3 Foundation Design

Bearing Resistance Values

Using continuously applied loads, footings for the proposed buildings can be designed using the bearing resistance values presented in Table 3.

Table 3 - Bearing Resistance Values		
Bearing Surface	Bearing Resistance Value at SLS (kPa)	Factored Bearing Resistance Value at ULS (kPa)
Stiff Silty Clay	75	140
Firm Silty Clay	60	125
Note: Strip footings, up to 1.5 m wide, and pad footings, up to 3 m wide, can be designed using the above noted bearing resistance values.		

The bearing resistance values are provided on the assumption that the footings will be placed on undisturbed soil bearing surfaces. An undisturbed soil bearing surface consists of one from which all topsoil and deleterious materials, such as loose, frozen or disturbed soil, whether in situ or not, have been removed, prior to the placement of concrete for footings.

Bearing resistance values for footing design should be determined on a per lot basis at the time of construction.

Lateral Support

The bearing medium under footing-supported structures is required to be provided with adequate lateral support with respect to excavations and different foundation levels. Adequate lateral support is provided to the in-situ bearing medium soils above the groundwater table when a plane extending down and out from the bottom edge of the footing at a minimum of 1.5H:1V passes only through in situ soil of the same or higher capacity as the bearing medium soil.

Settlement/Grade Raise

Consideration must be given to potential settlements which could occur due to the presence of the silty clay deposit and the combined loads from the proposed footings, any groundwater lowering effects, and grade raise fill.

Generally, the potential long term settlement is evaluated based on the compressibility characteristics of the silty clay. A test fill settlement monitoring program was recently completed for the subject site to accurately model the site permissible grade raise recommendations. Based on the test fill monitoring program results, a permissible grade raise restriction of **1.3 m** above original ground surface is recommended for grading within 4 m of the proposed buildings and a permissible grade raise of **1.5 m** is recommended for roadways. It should be noted that the abovenoted permissible grade raise recommendations are based on the results of our test fill settlement monitoring program and available soils information from the existing boreholes. Figure 2 - Test Fill Pile Settlement Monitoring Program in Appendix 2 presents the results of our test fill settlement monitoring program to date.

The total and differential settlements will be dependent on characteristics of the proposed buildings. For design purposes, the total and differential settlements are estimated to be 25 and 20 mm, respectively. A post-development groundwater lowering of 0.5 m was assumed.

The potential post construction total and differential settlements are dependent on the position of the long term groundwater level when buildings are situated over deposits of compressible silty clay. Efforts can be made to reduce the impacts of the proposed development on the long term groundwater level by placing clay dykes in the service trenches, reducing the sizes of paved areas, leaving green spaces to allow for groundwater recharge or limiting planting of trees to areas away from the buildings. However, it is not economically possible to control the groundwater level.

To reduce potential long term liabilities, consideration should be given to accounting for a larger groundwater lowering and to provide means to reduce long term groundwater lowering (e.g. clay dykes, restriction on planting around the dwellings, etc). Building on silty clay deposits increases the likelihood of movements and therefore of cracking. The use of steel reinforcement in foundations placed at key structural locations will tend to reduce foundation cracking compared to unreinforced foundations.

5.4 Design for Earthquakes

A seismic site response **Class E** should be used for design of the proposed buildings at the subject site according to the OBC 2012. The soils underlying the site are not susceptible to liquefaction.

5.6 Basement Slab

With the removal of all topsoil and deleterious fill, containing organic matter, within the footprints of the proposed buildings, the native soil surface will be considered an acceptable subgrade on which to commence backfilling for floor slab construction. Any soft areas should be removed and backfilled with appropriate backfill material. OPSS Granular B Type II, with a maximum particle size of 50 mm, are recommended for backfilling below the floor slab. It is recommended that the upper 200 mm of sub-slab fill consist of 19 mm clear crushed stone.

5.7 Pavement Structure

For design purposes, the pavement structure presented in the following tables could be used for the design of driveways, local residential streets and roadways with bus traffic. It should be noted that for residential driveways and car only parking areas, an Ontario Traffic Category A is applicable. For local roadways and roadways with bus traffic, an Ontario Traffic Category B and Category D should be used for design purposes, respectively.

Table 4 - Recommended Pavement Structure - Driveways

Thickness (mm)	Material Description
50	Wear Course - HL 3 or Superpave 12.5 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
300	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil or fill	

Table 5 - Recommended Pavement Structure - Local Residential Roadways

Thickness (mm)	Material Description
40	Wear Course - Superpave 12.5 Asphaltic Concrete
50	Binder Course - Superpave 19.0 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
400	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil or fill	

Table 6 - Recommended Pavement Structure - Roadways with Bus Traffic

Thickness mm	Material Description
40	Wear Course - Superpave 12.5 Asphaltic Concrete
50	Upper Binder Course - Superpave 19.0 Asphaltic Concrete
50	Lower Binder Course - Superpave 19.0 Asphaltic Concrete
150	BASE - OPSS Granular A Crushed Stone
600	SUBBASE - OPSS Granular B Type II
SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil or fill	

If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material. Weak subgrade conditions may be experienced over service trench fill materials. This may require the use of a geotextile, thicker subbase or other measures that can be recommended at the time of construction as part of the field observation program.

Minimum Performance Graded (PG) 58-34 asphalt cement should be used for driveways and local roadways and PG 64-34 asphalt cement should be used for roadways with bus traffic. The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 100% of the material's SPMDD using suitable vibratory equipment.

Pavement Structure Drainage

Satisfactory performance of the pavement structure is largely dependent on the contact zone between the subgrade material and the base stone in a dry condition. Failure to provide adequate drainage under conditions of heavy wheel loading can result in the fine subgrade soil being pumped into the voids in the stone subbase, thereby reducing load carrying capacity.

Due to the low permeability of the subgrade materials consideration should be given to installing subdrains during the pavement construction as per City of Ottawa standards. The subdrain inverts should be approximately 300 mm below subgrade level. The subgrade surface should be crowned to promote water flow to the drainage lines.

6.0 Design and Construction Precautions

6.1 Foundation Drainage and Backfill

A perimeter foundation drainage system is recommended for proposed structures. The system should consist of a 100 to 150 mm diameter, geotextile-wrapped, perforated, corrugated, plastic pipe, surrounded on all sides by 150 mm of 10 mm clear crushed stone, placed at the footing level around the exterior perimeter of the structure. The pipe should have a positive outlet, such as a gravity connection to the storm sewer.

Backfill against the exterior sides of the foundation walls should consist of free-draining, non frost susceptible granular materials. The site materials will be frost susceptible and, as such, are not recommended for re-use as backfill unless a composite drainage system (such as system Platon or Miradrain G100N) connected to a drainage system is provided.

6.2 Protection Against Frost Action

Perimeter footings of heated structures are required to be insulated against the deleterious effect of frost action. A minimum 1.5 m thick soil cover (or equivalent) should be provided in this regard.

A minimum of 2.1 m thick soil cover (or equivalent) should be provided for other exterior unheated footings.

6.3 Excavation Side Slopes

The excavations for the proposed development will be mostly through a sensitive grey silty clay. Where excavation is above the groundwater level to a depth of approximately 3 m, the excavation side slopes should be stable in the short term at 1H:1V. Flatter slopes could be required for deeper excavations or for excavation below the groundwater level. Where such side slopes are not permissible or practical, temporary shoring should be used. The subsoil at this site is considered to be mainly a Type 2 or 3 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects.

The slope cross-sections recommended above are for temporary slopes. Excavated soil should not be stockpiled directly at the top of excavations and heavy equipment should be kept away from the excavation sides.

It is recommended that a trench box be used at all times to protect personnel working in trenches with steep or vertical sides. It is expected that services will be installed by “cut and cover” methods and excavations will not be left open for extended periods of time.

It is expected that deep service trenches in excess of 3 m will be completed using a temporary shoring system designed by a structural engineer, such as stacked trench boxes in conjunction with steel plates. The trench boxes should be installed to ensure that the excavation sidewalls are tight to the outside of the trench boxes and that the steel plates are extended below the base of the excavation to prevent basal heave (if required).

Slopes in excess of 3 m in height should be periodically inspected by the geotechnical consultant in order to detect if the slopes are exhibiting signs of distress.

Excavation Base Stability

The base of supported excavations can fail by three (3) general modes:

- ☐ Shear failure within the ground caused by inadequate resistance to loads imposed by grade difference inside and outside of the excavation,
- ☐ Piping from water seepage through granular soils, and
- ☐ Heave of layered soils due to water pressures confined by intervening low permeability soils.

Shear failure of excavation bases is typically rare in granular soils if adequate lateral support is provided. Inadequate dewatering can cause instability in excavations made through granular or layered soils. The potential for base heave in cohesive soils should be determined for stability of flexible retaining systems.

The factor of safety with respect to base heave, FS_b , is:

$$FS_b = N_b s_u / \sigma_z$$

where:

N_b - stability factor dependent upon the geometry of the excavation and given in Figure 1 on the following page.

s_u - undrained shear strength of the soil below the base level

σ_z - total overburden and surcharge pressures at the bottom of the excavation

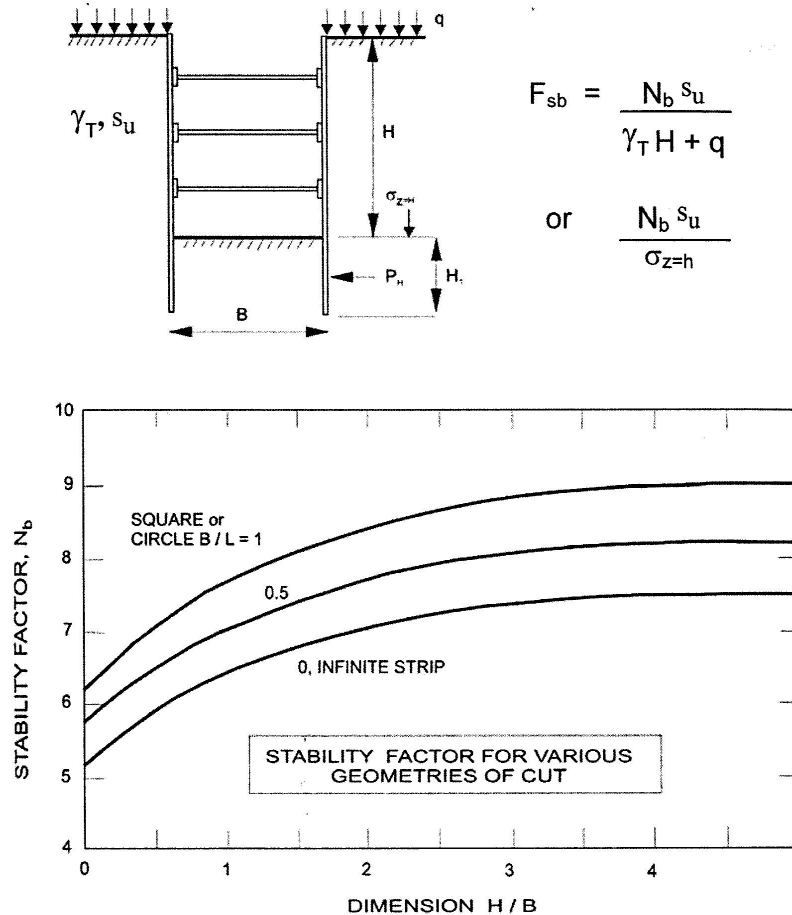


Figure 1 - Stability Factor for Various Geometries of Cut

In the case of soft to firm clays, a factor of safety of 2 is recommended for base stability.

6.4 Pipe Bedding and Backfill

Bedding and backfill materials should be in accordance with the most recent Material Specifications and Standard Detail Drawings from the City of Ottawa. These recommendations are for standard, open cut excavation placed services.

The pipe bedding for sewer and water pipes should consist of at least 150 mm of OPSS Granular A material. Where the bedding is located within the firm grey silty clay, the thickness of the bedding material should be increased to a minimum of 300 mm. The material should be placed in maximum 300 mm thick lifts and compacted to a minimum of 95% of its SPMDD. The bedding material should extend at least to the spring line of the pipe.

The cover material, which should consist of OPSS Granular A, should extend from the spring line of the pipe to at least 300 mm above the obvert of the pipe. The material should be placed in maximum 300 mm thick lifts and compacted to a minimum of 95% of its SPMDD.

Generally, it should be possible to re-use the moist (not wet) brown silty clay above the cover material if the excavation and filling operations are carried out in dry weather conditions. Wet silty clay materials will be difficult to re-use, as the high water contents make compacting impractical without an extensive drying period.

Where hard surface areas are considered above the trench backfill, the trench backfill material within the frost zone (about 1.8 m below finished grade) should match the soils exposed at the trench walls to minimize differential frost heaving. The trench backfill should be placed in maximum 300 mm thick loose lifts and compacted to a minimum of 95% of the material's SPMDD.

To reduce long-term lowering of the groundwater level at this site, clay seals should be provided in the service trenches. The seals should be at least 1.5 m long (in the trench direction) and should extend from trench wall to trench wall. The seals should extend from the frost line and fully penetrate the bedding, subbedding and cover material. The barriers should consist of relatively dry and compactable brown silty clay placed in maximum 225 mm thick loose layers and compacted to a minimum of 95% of the SPMDD. The clay seals should be placed at the site boundaries and at strategic locations at no more than 60 m intervals in the service trenches. Periodic inspection of the clay seal placement work should be completed by Paterson personnel during servicing installation work.

Bedding for Thrust Blocks

To increase the vertical allowable bearing capacity to 100 kPa or greater, Paterson suggests the following alternative bedding changes at the thrust block locations:

- ❑ Place a granular bedding to a minimum thickness of 400 mm using OPSS Granular A or OPSS Granular B, Type II compacted to 95% of the material's standard Proctor maximum dry density.

The bearing medium under the thrust blocks is required to be provided with adequate lateral support with respect to excavations and different foundation levels. Adequate lateral support is provided to the engineered fill and/or in-situ bearing medium soils when a plane extending down and out from the bottom edge of the thrust block at a minimum of 1.5H:1V passes only through in situ soil of the same or higher capacity as the bearing medium soil.

6.5 Groundwater Control

Due to the relatively impervious nature of the silty clay materials, it is anticipated that groundwater infiltration into the excavations should be low and controllable using open sumps. Pumping from open sumps should be sufficient to control the groundwater influx through the sides of shallow excavations.

Permit to Take Water

A temporary Ministry of the Environment and Climate Change (MOECC) permit to take water (PTTW) may be required for this project if more than 400,000 L/day of ground and/or surface water is to be pumped during the construction phase. A minimum 4 to 5 months should be allowed for completion of the PTTW application package and issuance of the permit by the MOECC.

For typical ground or surface water volumes, being pumped during the construction phase, between 50,000 to 400,000 L/day, it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of two to four weeks should be allotted for completion of the EASR registration and the Water Taking and Discharge Plan to be prepared by a Qualified Person as stipulated under O.Reg. 63/16. If a project qualifies for a PTTW based upon anticipated conditions, an EASR will not be allowed as a temporary dewatering measure while awaiting the MOECC review of the PTTW application.

The contractor should be prepared to direct water away from all bearing surfaces and subgrades, regardless of the source, to prevent disturbance to the founding medium.

6.6 Winter Construction

The subsurface conditions at this site mostly consist of frost susceptible materials. In presence of water and freezing conditions ice could form within the soil mass. Heaving and settlement upon thawing could occur. Precautions should be taken if winter construction is considered for this project.

In the event of construction during below zero temperatures, the founding stratum should be protected from freezing temperatures by the use of straw, propane heaters, tarpaulins or other suitable means. In this regard, the base of the excavations should be insulated from sub-zero temperatures immediately upon exposure and until such time as heat is adequately supplied to the building and the footings are protected with sufficient soil cover to prevent freezing at founding level.

The trench excavations should be constructed in a manner that will avoid the introduction of frozen materials into the trenches. As well, pavement construction is difficult during winter. The subgrade consists of frost susceptible soils which will experience total and differential frost heaving as the work takes place. In addition, the introduction of frost, snow or ice into the pavement materials, which is difficult to avoid, could adversely affect the performance of the pavement structure. Additional information could be provided, if required.

6.7 Corrosion Potential and Sulphate

One (1) sample was submitted for testing. The analytical test results of the soil sample indicate that the sulphate content is less than 0.01%. These results along with the chloride and pH value are indicative that Type 10 Portland cement (normal cement) would be appropriate for this site. The results of the resistivity indicate the presence of a moderate to very aggressive environment for exposed ferrous metals at this site, which is typical of silty clay samples submitted for the subject area. It is anticipated that standard measures for corrosion protection are sufficient for services placed within the silty clay deposit.

6.8 Landscaping Considerations

Tree Planting Restrictions

In accordance with the City of Ottawa Tree Planting in Sensitive Marine Clay Soils (2017 Guidelines), Paterson completed a soils review of the site to determine applicable tree planting setbacks. Atterberg limits testing was completed for recovered silty clay samples at selected locations throughout the subject site. Sieve analysis testing was also completed on selected soil samples. The abovenoted test results were completed between design underside of footing elevation and a 3.5 m depth below finished grade. The results of our testing are presented in Table 1 in Subsection 4.1 and in Appendix 1.

Based on the results of our review, the two tree planting setback areas are present within the proposed development. The two areas are detailed below and have been outlined in Drawing PG4049-3 - Tree Planting Setback Recommendations presented in Appendix 2.

Area 1 - Low to Medium Sensitivity Area

A low to medium sensitivity clay soil was encountered between design underside of footing elevations and 3.5 m below finished grade as per City Guidelines at the areas outlined in Drawing PG4049-3 - Tree Planting Setback Recommendations in Appendix 2. Based on our Atterberg Limits test results, the modified plasticity limit generally does not exceed 40% in these areas. The following tree planting setbacks are recommended for the low to medium sensitivity area. Large trees (mature height over 14 m) can be planted within these areas provided a tree to foundation setback equal to the full mature height of the tree can be provided (e.g. in a park or other green space). Tree planting setback limits may be reduced to 4.5 m for small (mature tree height up to 7.5m) and medium size trees (mature tree height 7.5 m to 14 m) provided that the conditions noted below are met.

Area 2 - High Sensitivity Area

A high sensitivity clay soil was encountered between design underside of footing elevations and 3.5 m below finished grade as per City Guidelines at the areas outlined in Drawing PG4049-3 - Tree Planting Setback Recommendations in Appendix 2. Based on our Atterberg Limits test results, the modified plasticity limit generally exceeds 40%. The following tree planting setbacks are recommended for these high sensitivity areas. Large trees (mature height over 14 m) can be planted within these provided a tree to foundation setback equal to the full mature height of the tree can be provided (e.g. in a park or other green space). Tree planting setback limits is 7.5 m for small (mature tree height up to 7.5m) and medium size trees (mature tree height 7.5 m to 14 m) provided that the following conditions are met:

- ☐ The underside of footing (USF) is 2.1 m or greater below the lowest finished grade must be satisfied for footings within 10 m from the tree, as measured from the centre of the tree trunk and verified by means of the Grading Plan as indicated procedural changes below.
- ☐ A small tree must be provided with a minimum of 25 m³ of available soil volume while a medium tree must be provided with a minimum of 30 m³ of available soil volume, as determined by the Landscape Architect. The developer is to ensure that the soil is generally un-compacted when backfilling in street tree planting locations.
- ☐ The tree species must be small (mature tree height up to 7.5 m) to medium size (mature tree height 7.5 m to 14 m) as confirmed by the Landscape Architect.

- ❑ The foundation walls are to be reinforced at least nominally (minimum of two upper and two lower 15M bars in the foundation wall).
- ❑ Grading surround the tree must promote drainage to the tree root zone (in such a manner as not to be detrimental to the tree), as noted on the subdivision Grading Plan.

Swimming Pools, Aboveground Hot Tubs, Decks and Additions

The in-situ soils are considered to be acceptable for swimming pools. Above ground swimming pools must be placed at least 5 m away from the residence foundation and neighbouring foundations. Otherwise, pool construction is considered routine, and can be constructed in accordance with the manufacturer's requirements.

Additional grading around the hot tub should not exceed permissible grade raises. Otherwise, hot tub construction is considered routine, and can be constructed in accordance with the manufacturer's specifications.

Additional grading around proposed deck or addition should not exceed permissible grade raises. Otherwise, standard construction practices are considered acceptable.

7.0 Recommendations

It is recommended that the following be completed once the master plan and site development are determined:

- ☐ Review detailed grading plan(s) from a geotechnical perspective.
- ☐ Observation of all bearing surfaces prior to the placement of concrete.
- ☐ Periodic observation of the condition of unsupported excavation side slopes in excess of 3 m in height, if applicable.
- ☐ Observation of all subgrades prior to placing backfilling materials.
- ☐ Observation of clay seal placement at specified locations.
- ☐ Field density tests to ensure that the specified level of compaction has been achieved.
- ☐ Sampling and testing of the bituminous concrete including mix design reviews.

A report confirming that these works have been conducted in general accordance with Paterson's recommendations could be issued upon request, following the completion of a satisfactory material testing and observation program by the geotechnical consultant.

8.0 Statement of Limitations

The recommendations made in this report are in accordance with Paterson's present understanding of the project. Paterson requests permission to review the grading plan once available. Paterson's recommendations should be reviewed when the drawings and specifications are complete.

The client should be aware that any information pertaining to soils and the test hole log are furnished as a matter of general information only. Test hole descriptions or logs are not to be interpreted as descriptive of conditions at locations other than those of the test holes.

A soils investigation is a limited sampling of a site. Should any conditions at the site be encountered which differ from those at the test locations, Paterson requests to be notified immediately in order to permit reassessment of the recommendations.

The present report applies only to the project described in this document. Use of this report for purposes other than those described herein or by person(s) other than 2447591 Ontario Inc. or their agent(s) is not authorized without review by this firm for the applicability of our recommendations to the altered use of the report.

Paterson Group Inc.

Colin Belcourt, M.Eng.



David J. Gilbert, P.Eng.

Report Distribution:

- ☐ 2447591 Ontario Inc. (4 copies)
- ☐ Paterson Group (1 copy)

APPENDIX 1

SOIL PROFILE AND TEST DATA SHEETS

SYMBOLS AND TERMS

ANALYTICAL TEST RESULTS

ATTERBERG LIMIT TESTING RESULTS

GRAIN SIZE DISTRIBUTION SHEETS

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 1-18

BORINGS BY CME 55 Power Auger

DATE February 20, 2018

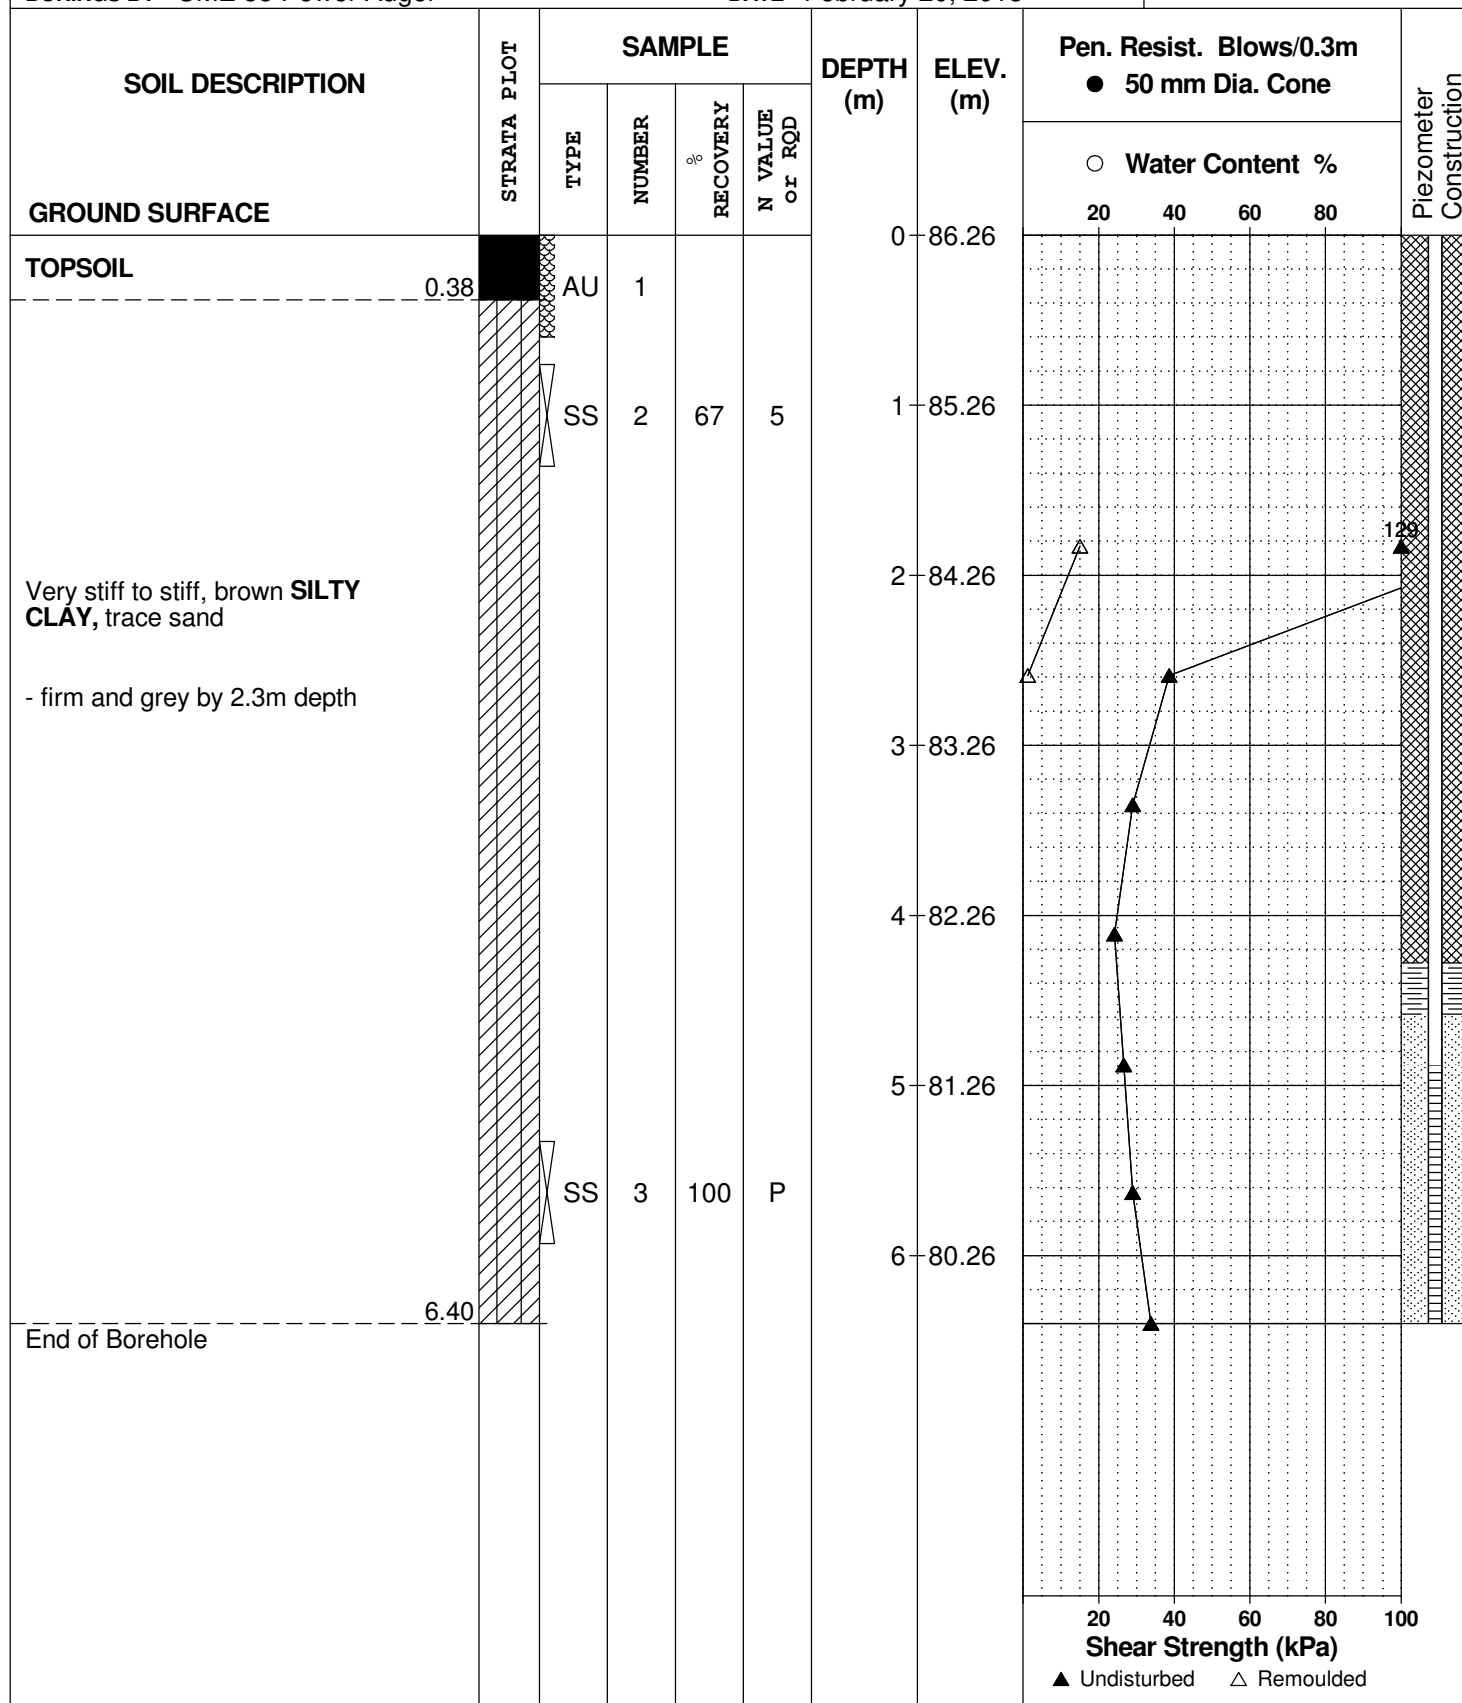

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 2-18

BORINGS BY CME 55 Power Auger

DATE February 20, 2018

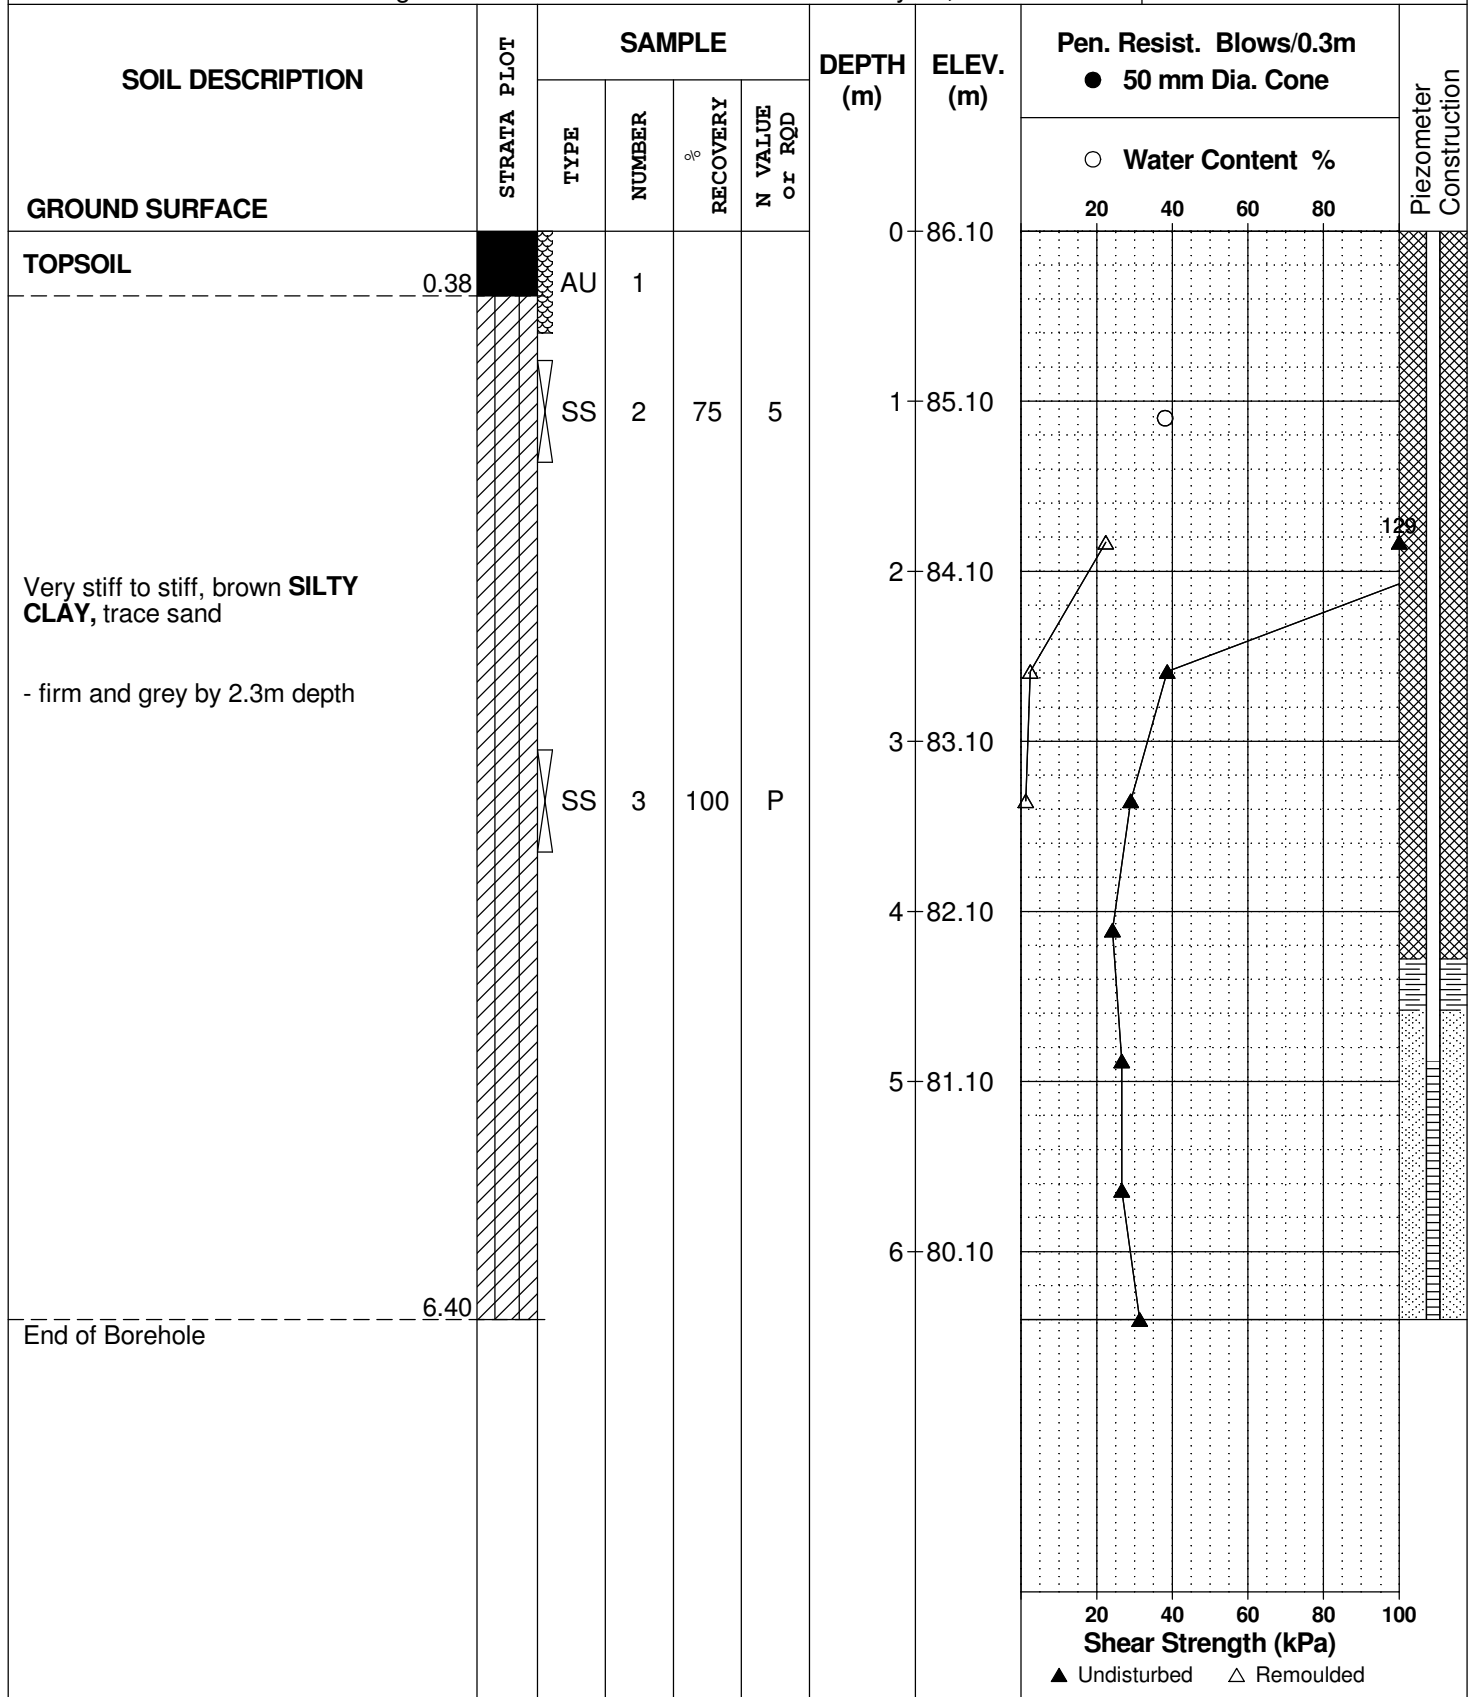

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 3-18

BORINGS BY CME 55 Power Auger

DATE February 20, 2018

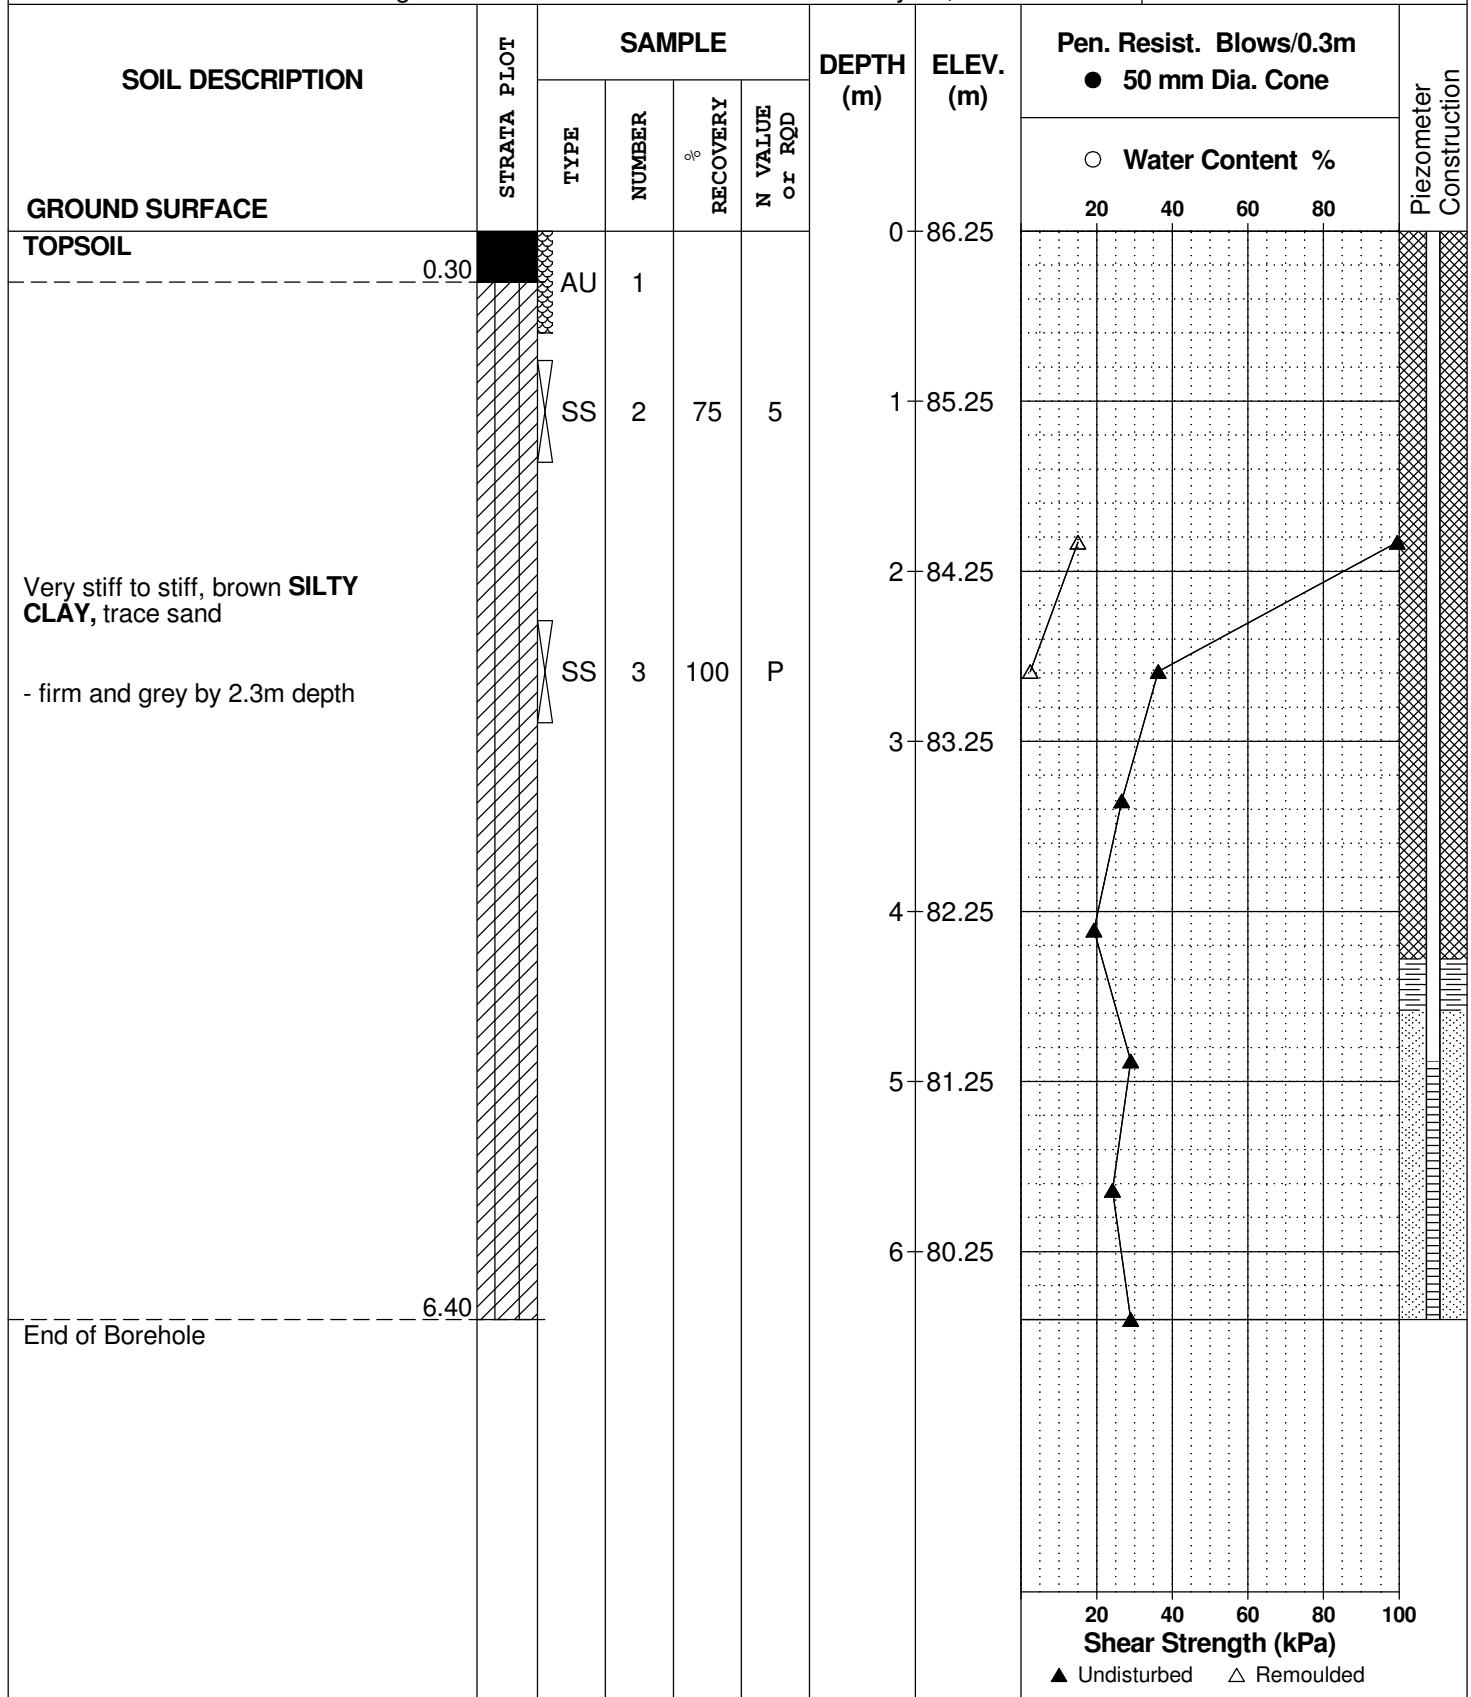

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 4-18

BORINGS BY CME 55 Power Auger

DATE February 20, 2018

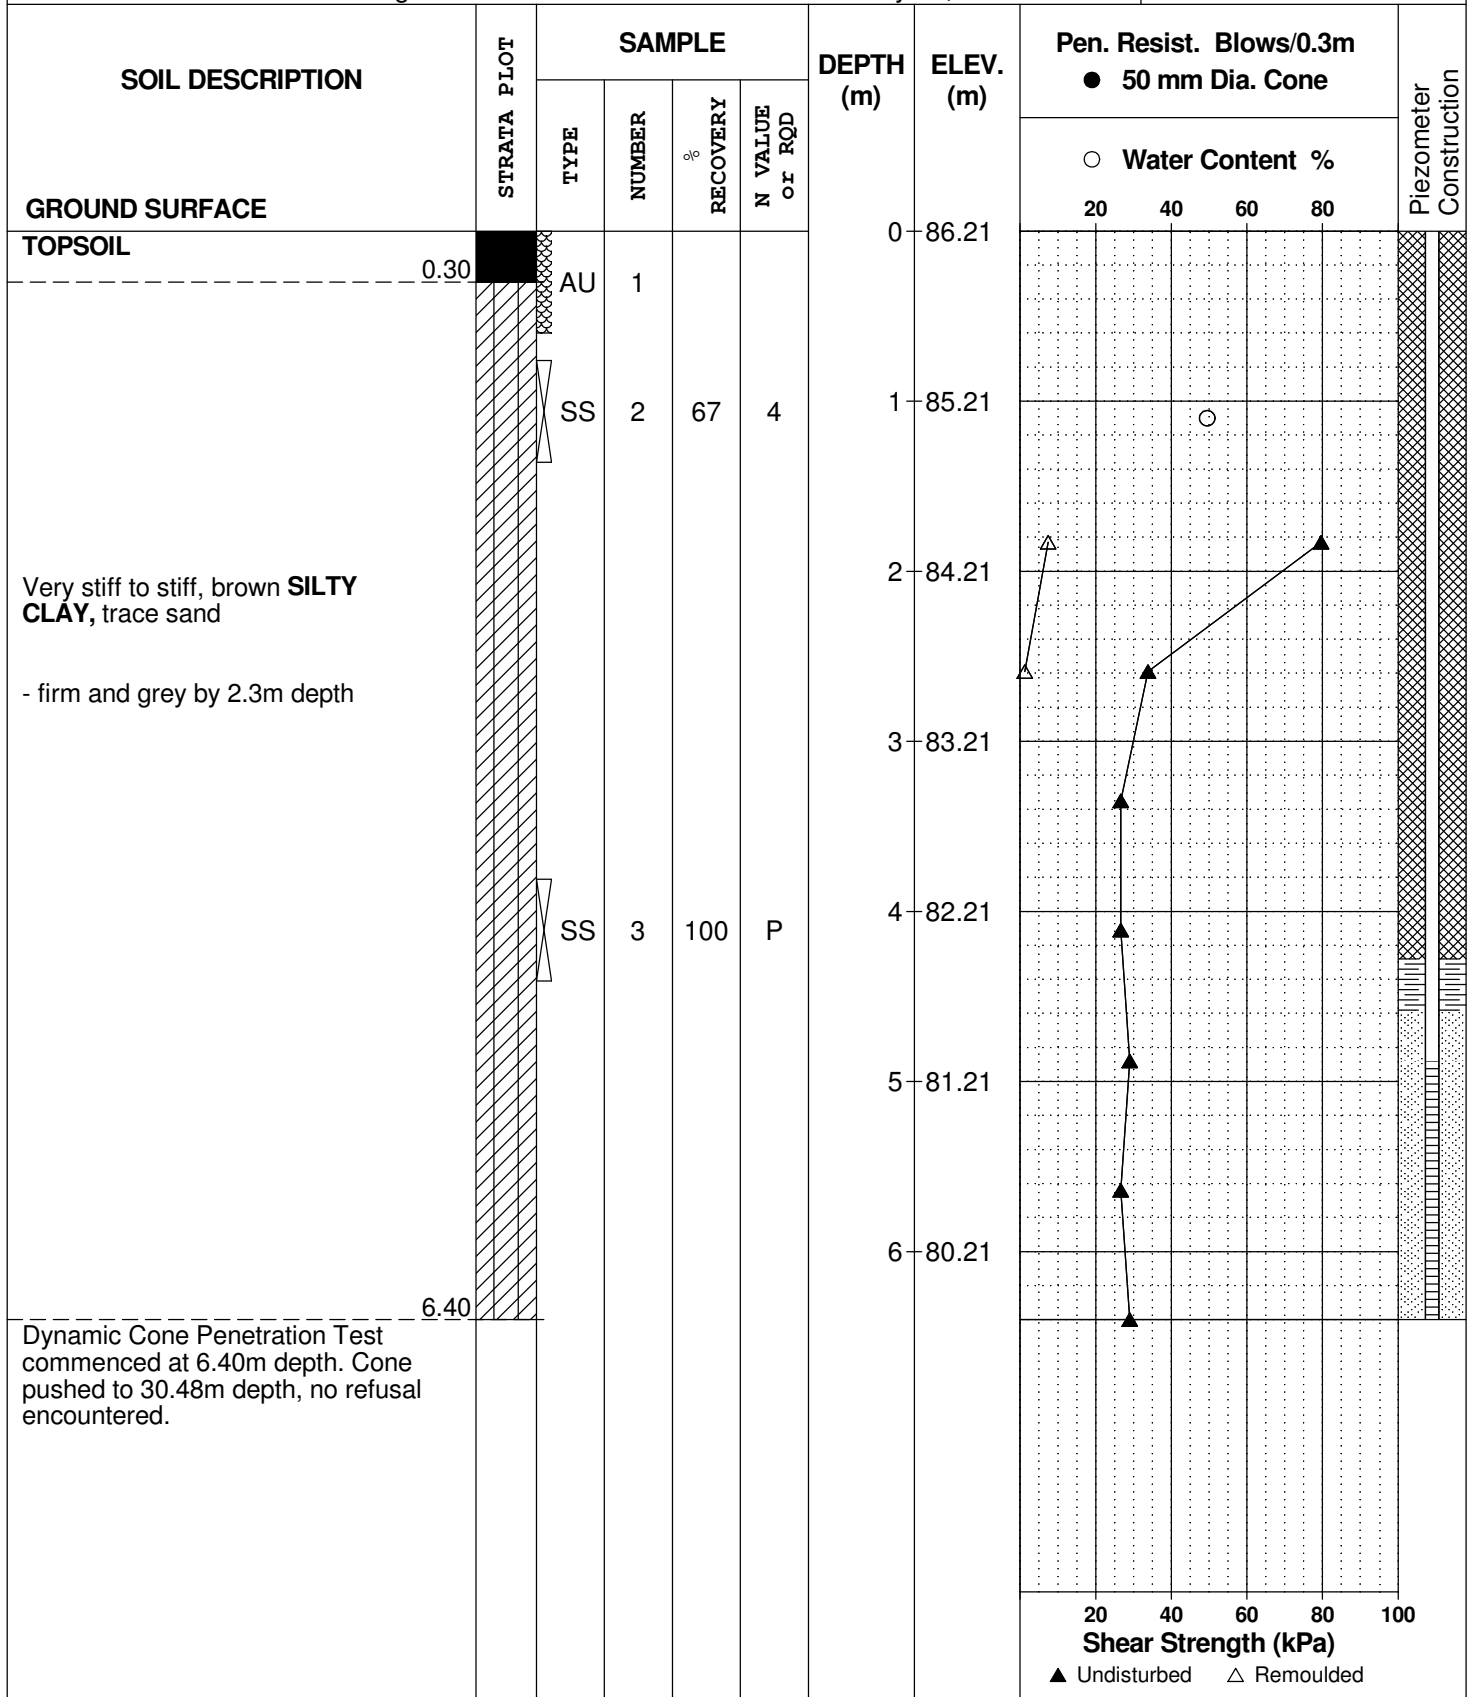

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 5-18

BORINGS BY CME 55 Power Auger

DATE February 20, 2018

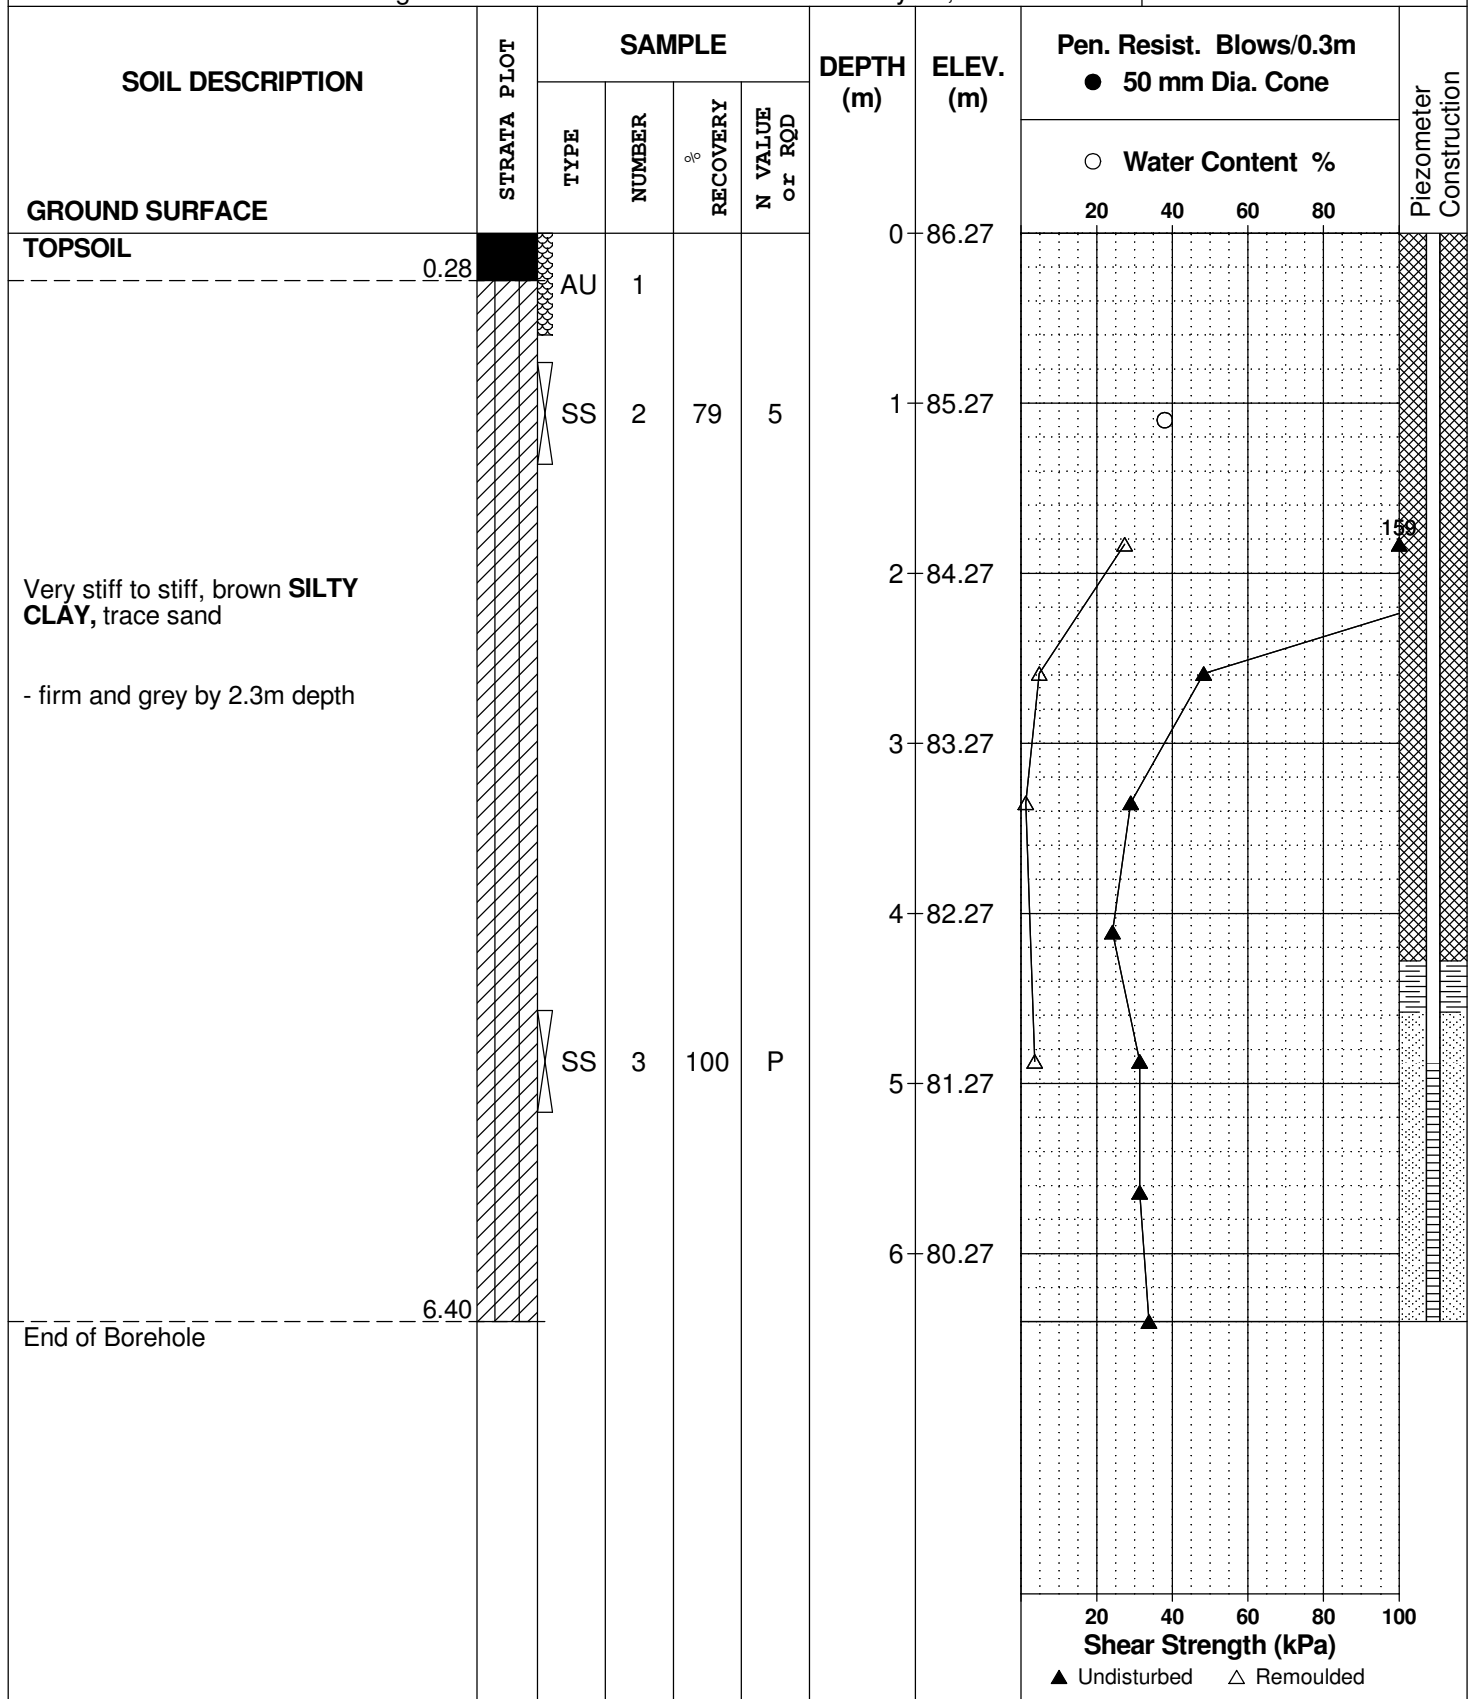

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 6-18

BORINGS BY CME 55 Power Auger

DATE February 21, 2018

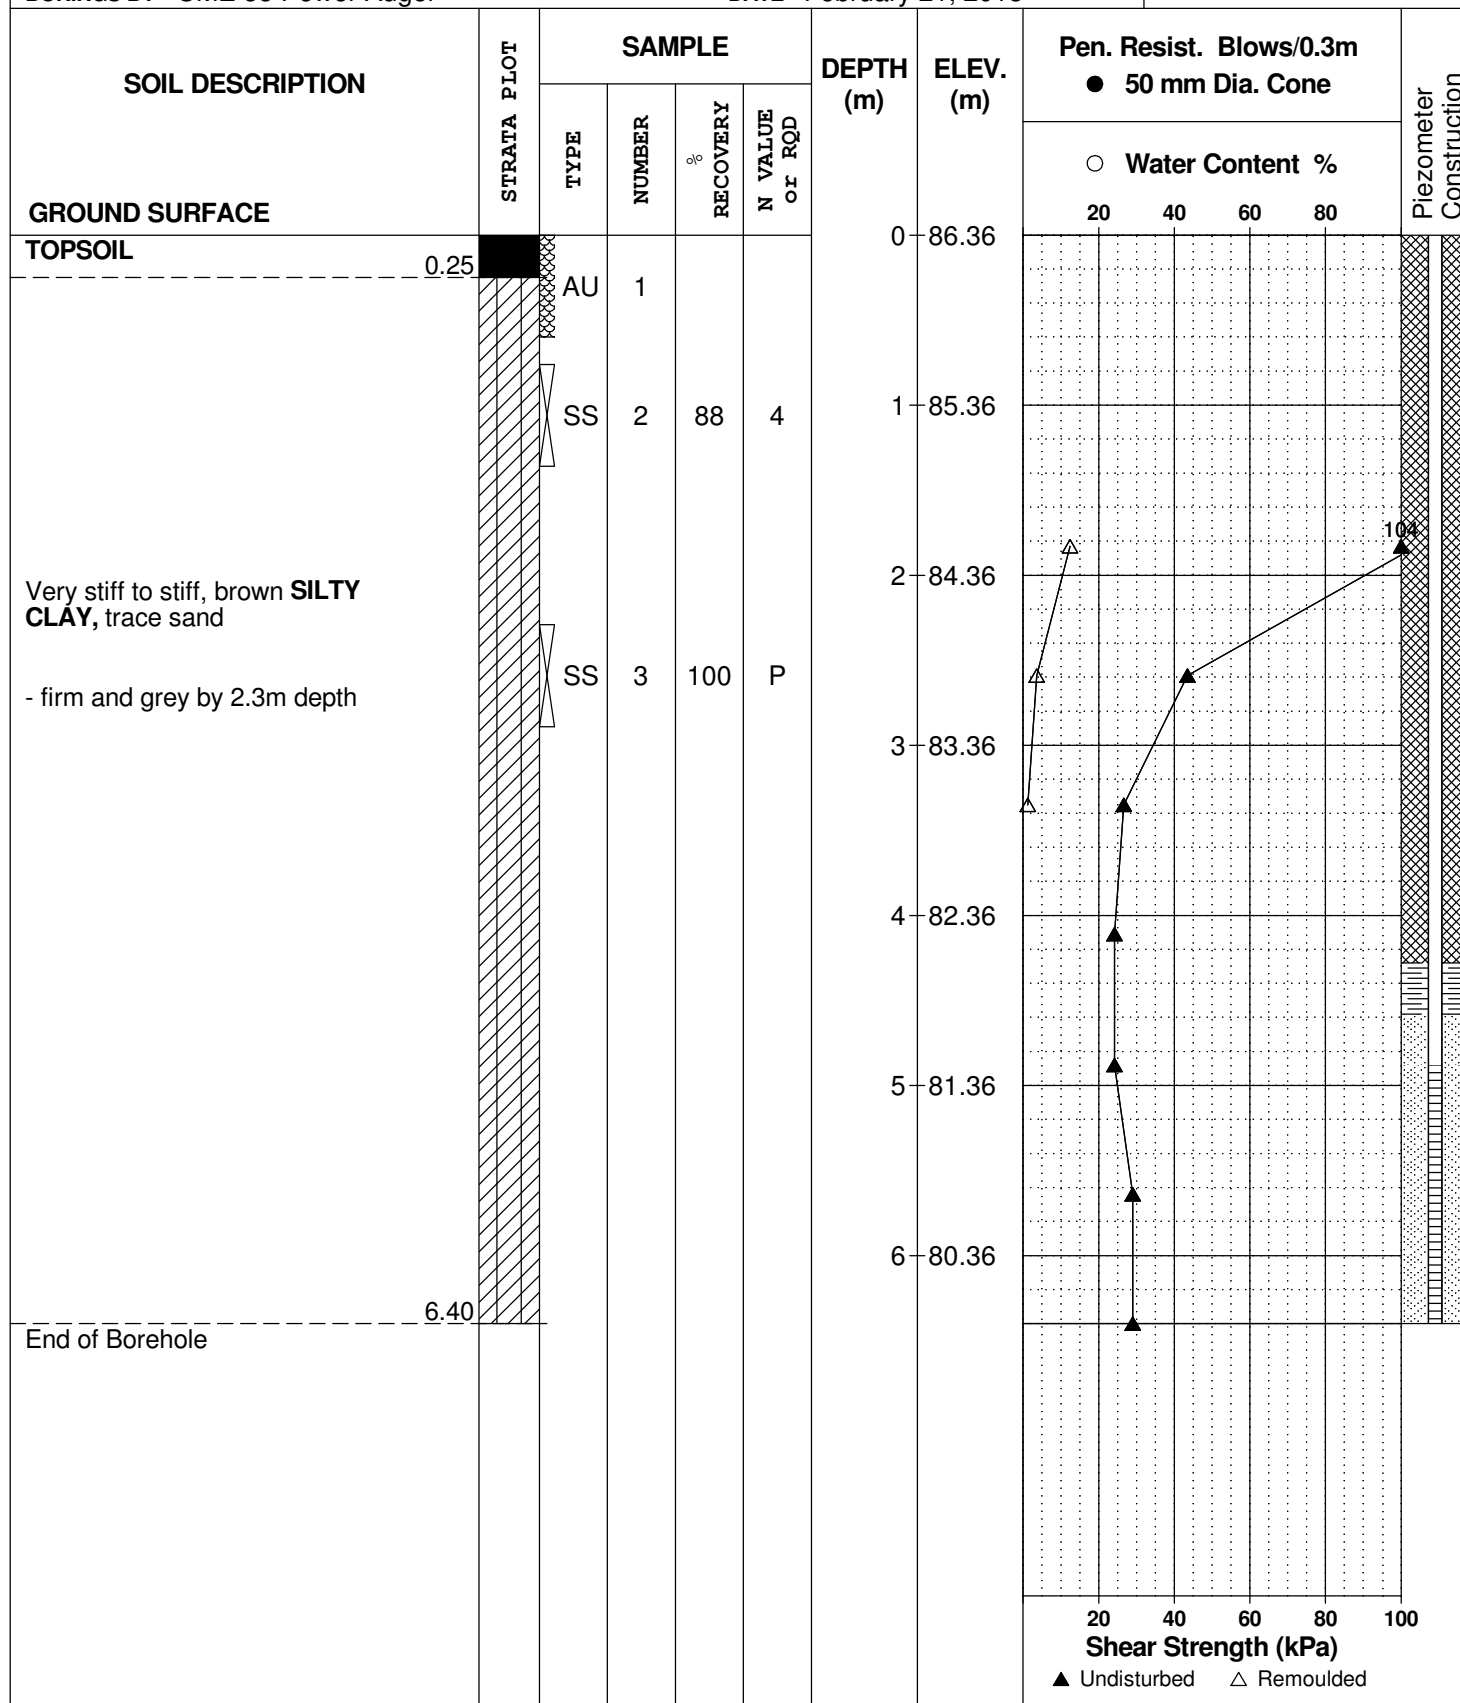

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 7-18

BORINGS BY CME 55 Power Auger

DATE February 21, 2018

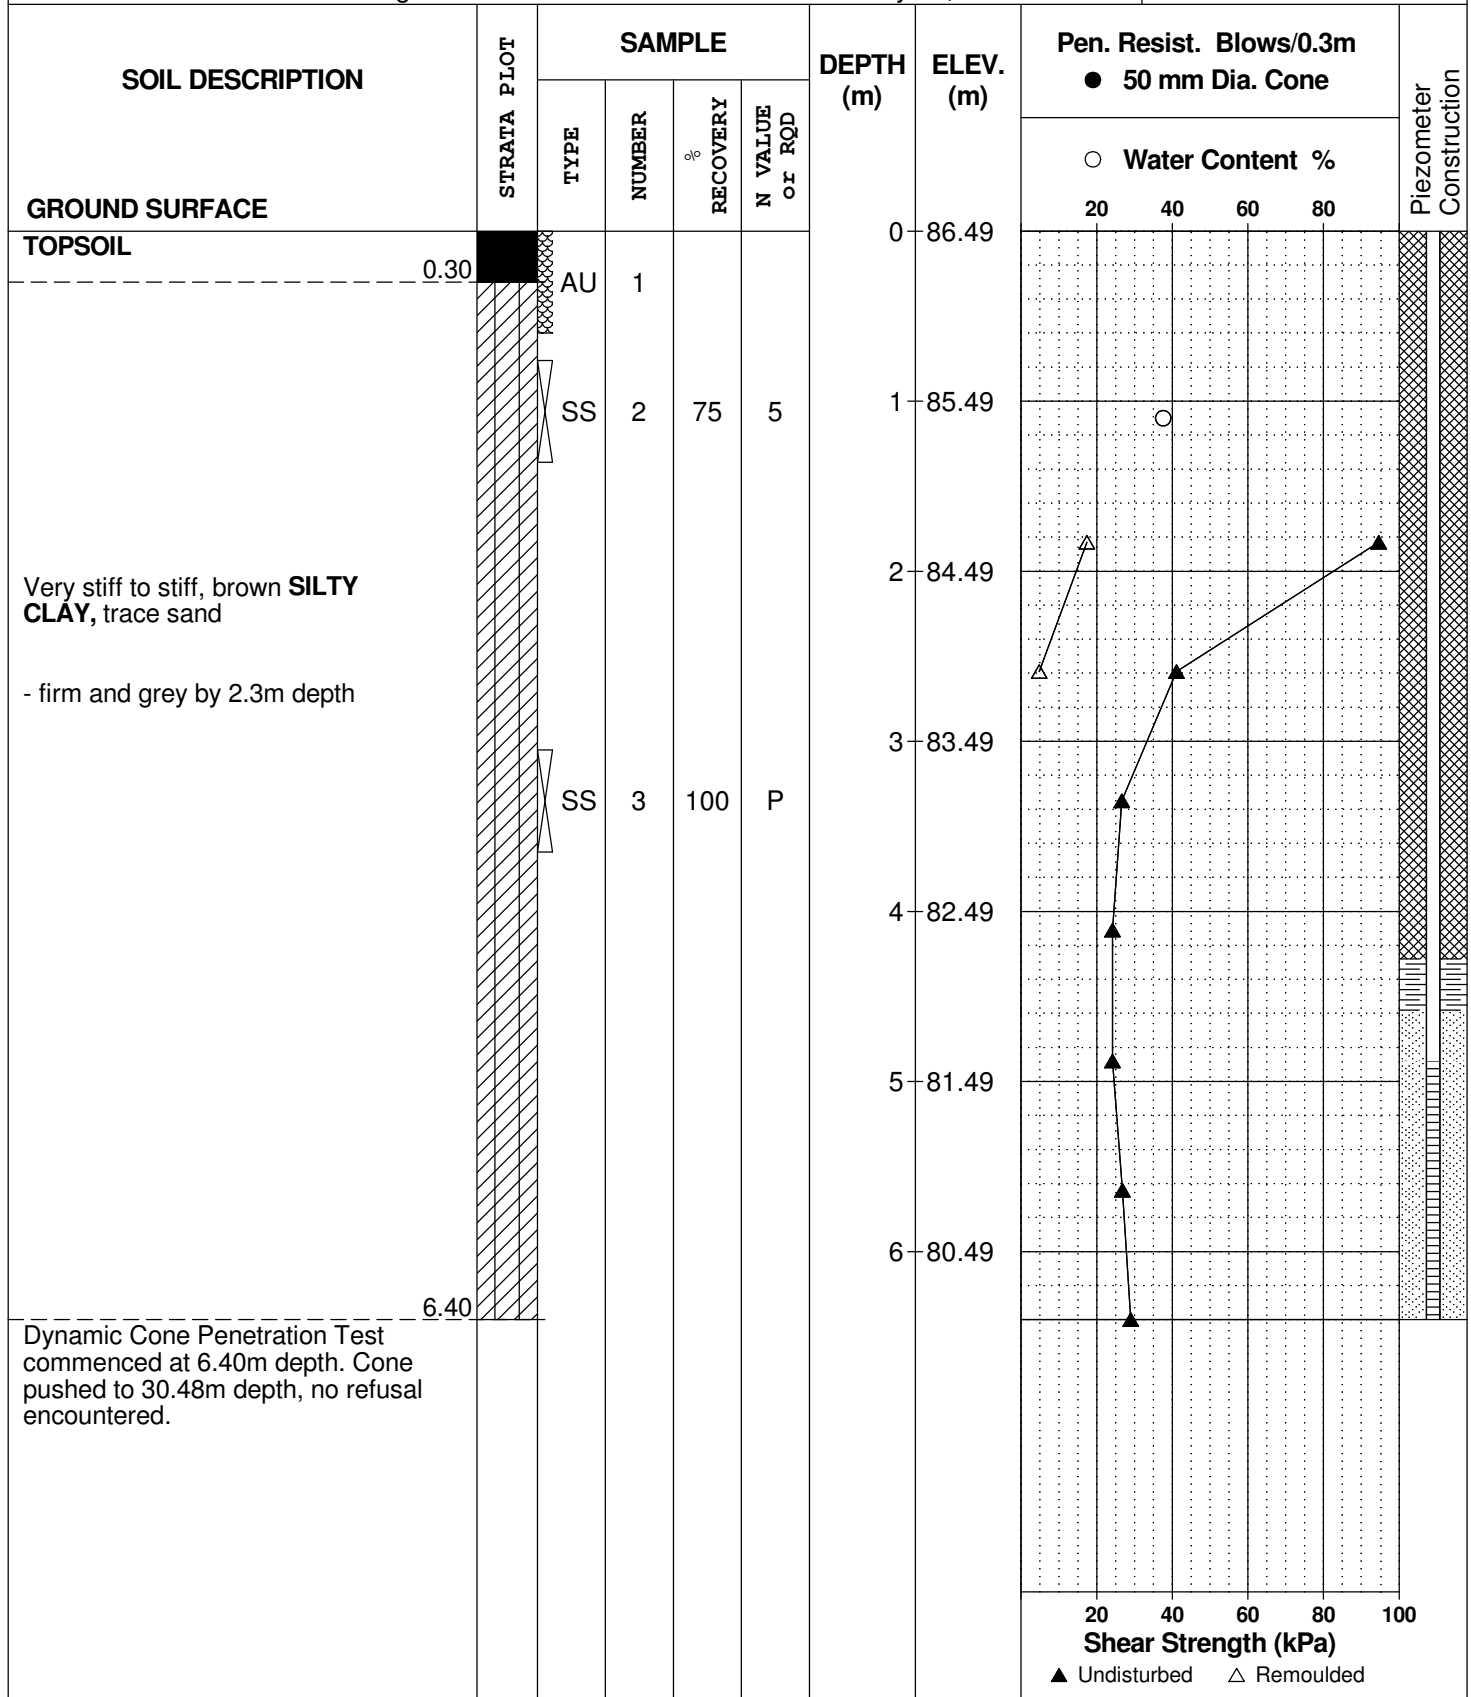

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 8-18

BORINGS BY CME 55 Power Auger

DATE February 21, 2018

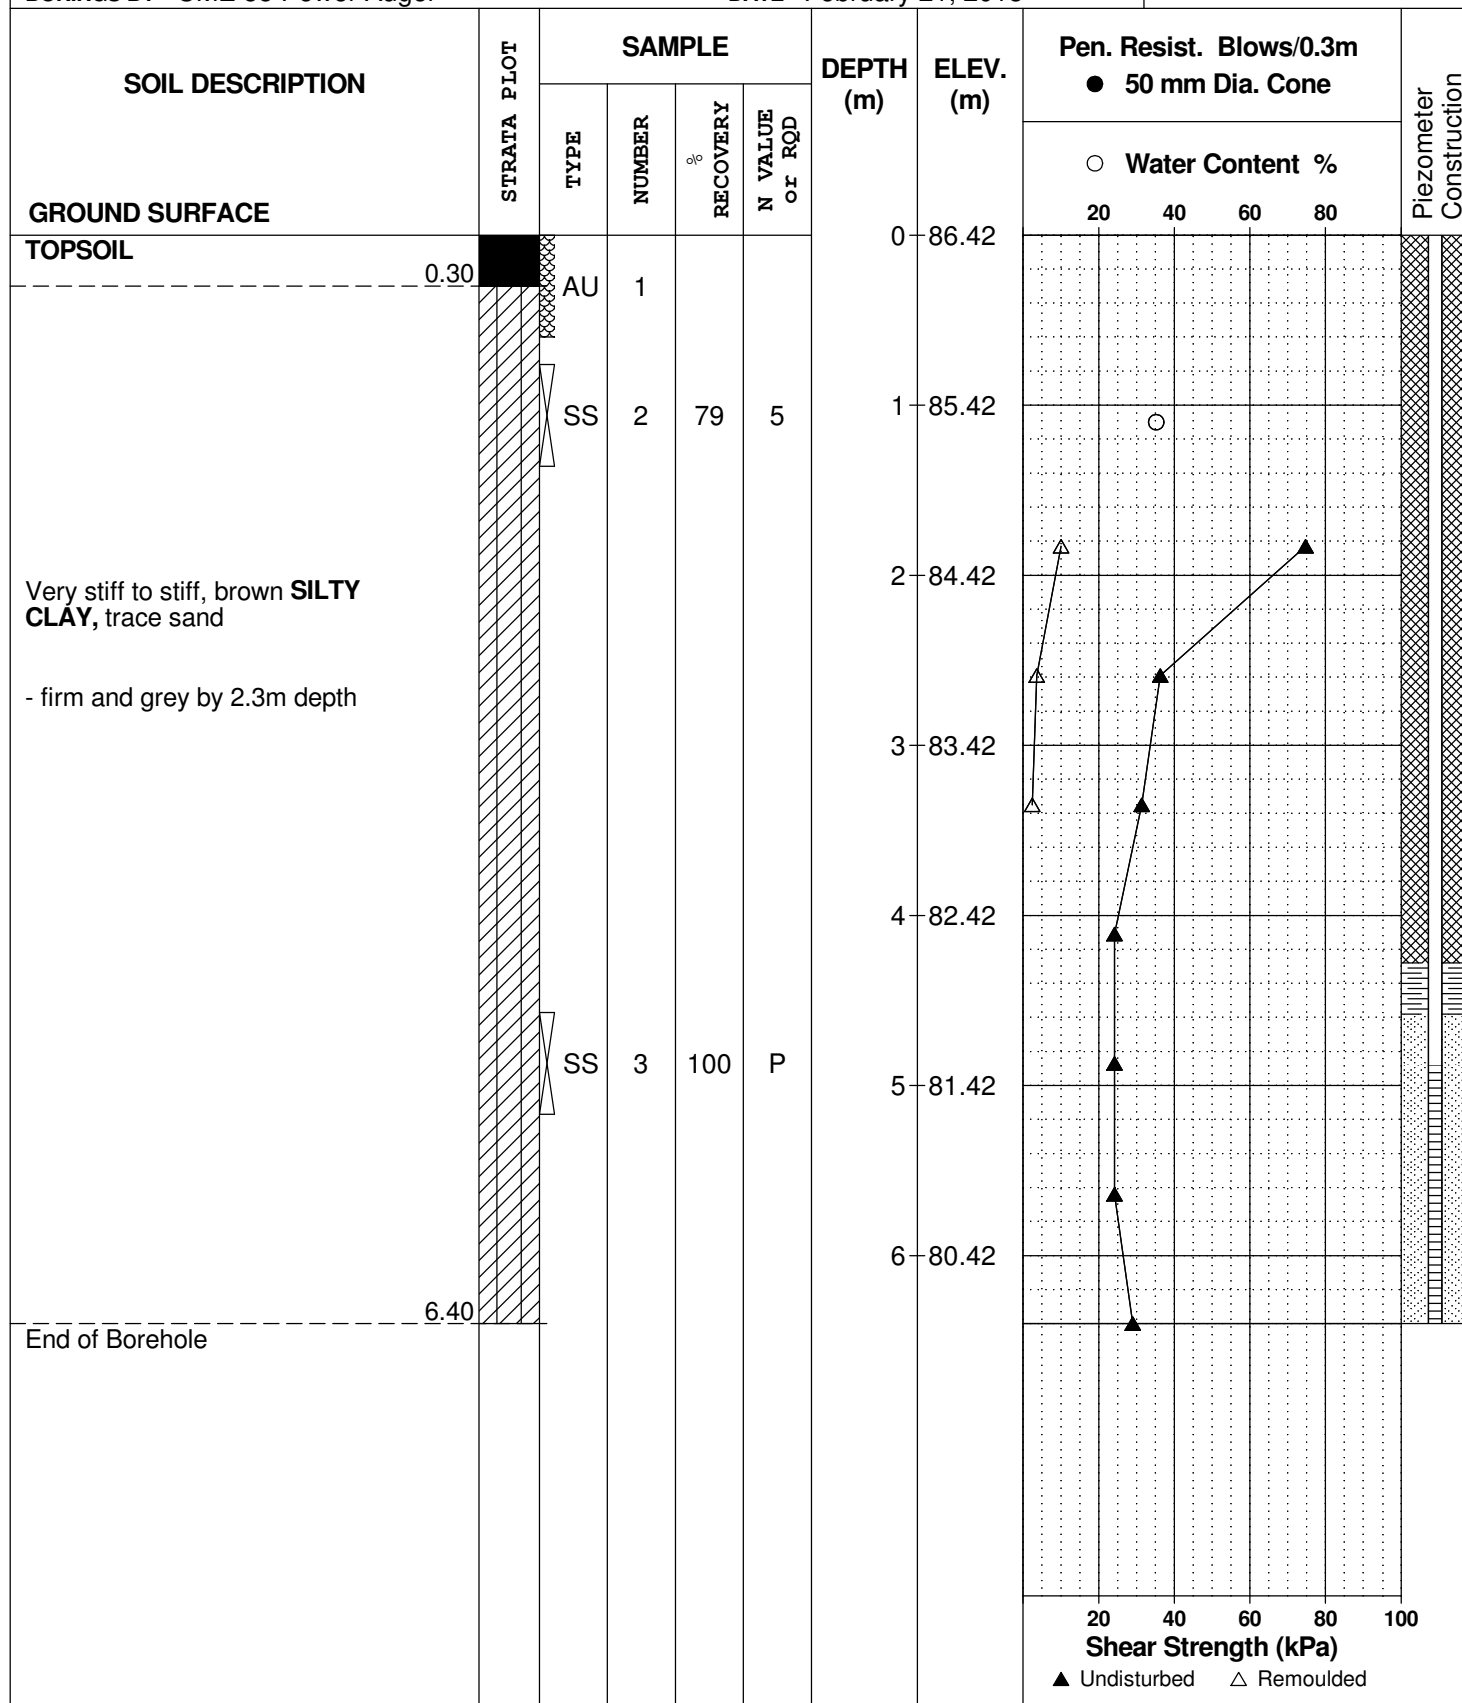

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH 9-18

BORINGS BY CME 55 Power Auger

DATE February 21, 2018

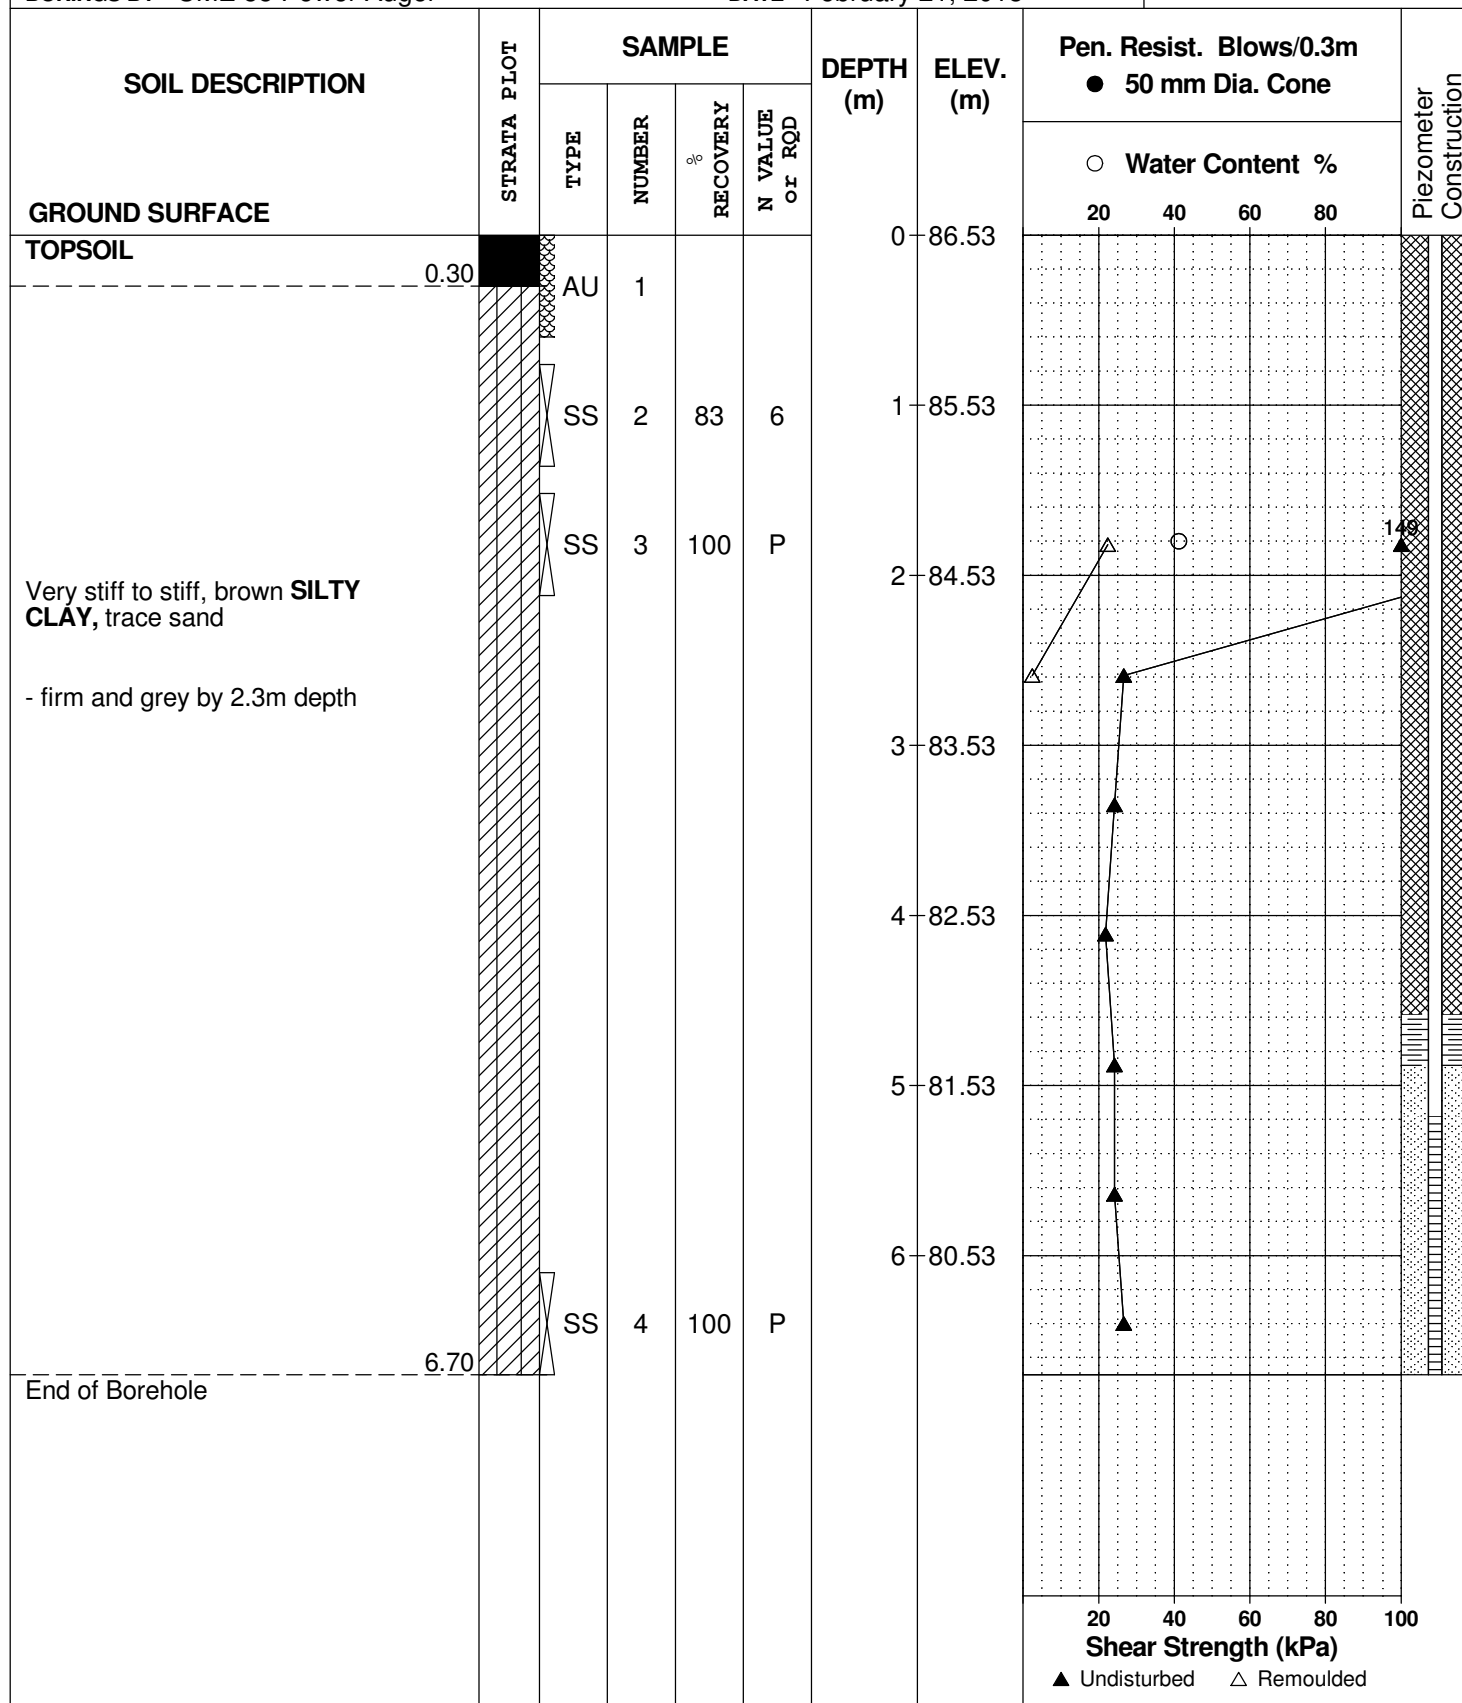

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH10-18

BORINGS BY CME 55 Power Auger

DATE February 21, 2018

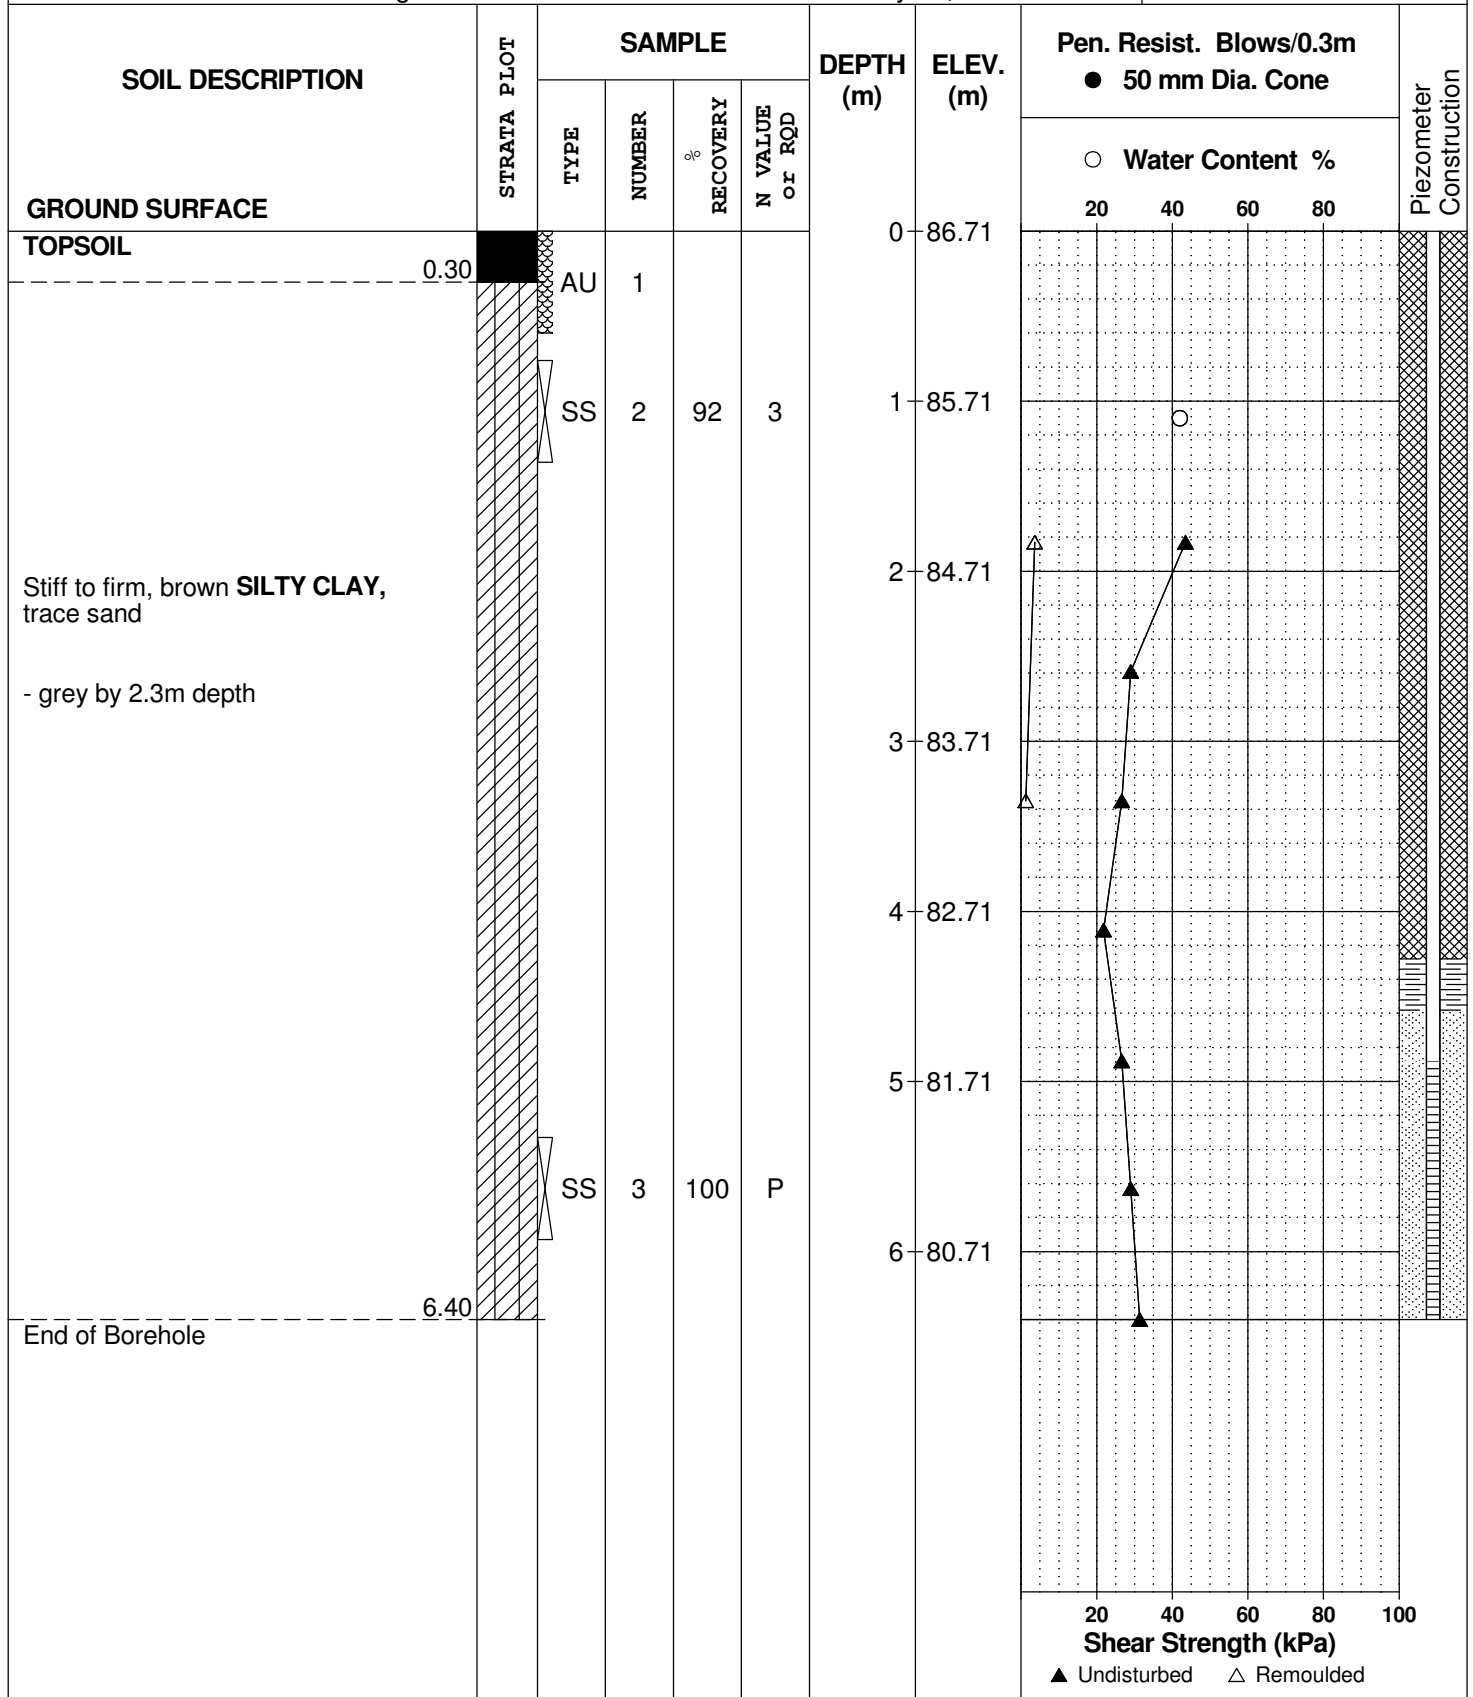

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH11-18

BORINGS BY CME 55 Power Auger

DATE February 21, 2018

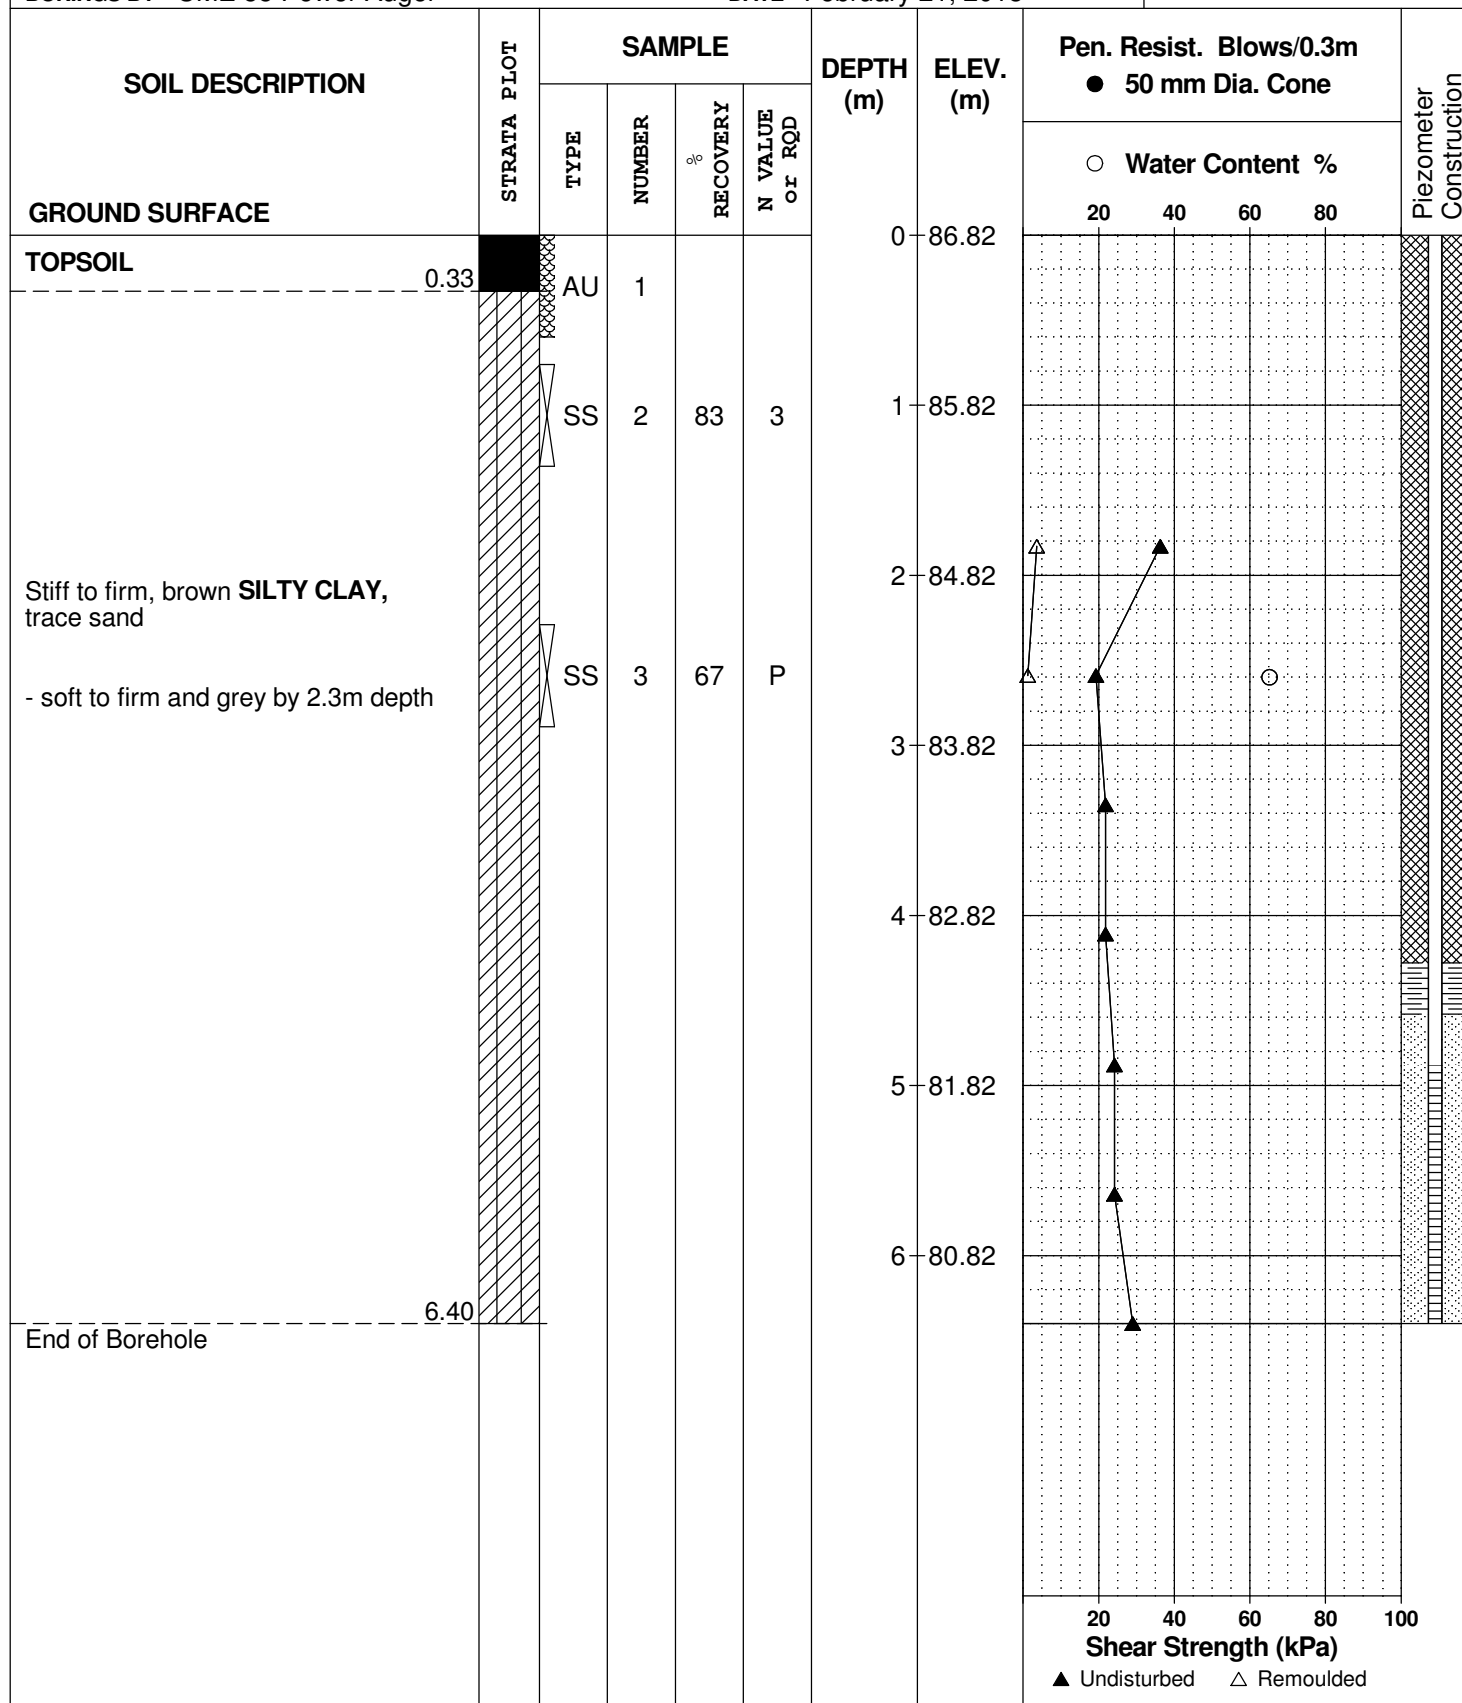

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH12-18

BORINGS BY CME 55 Power Auger

DATE February 22, 2018

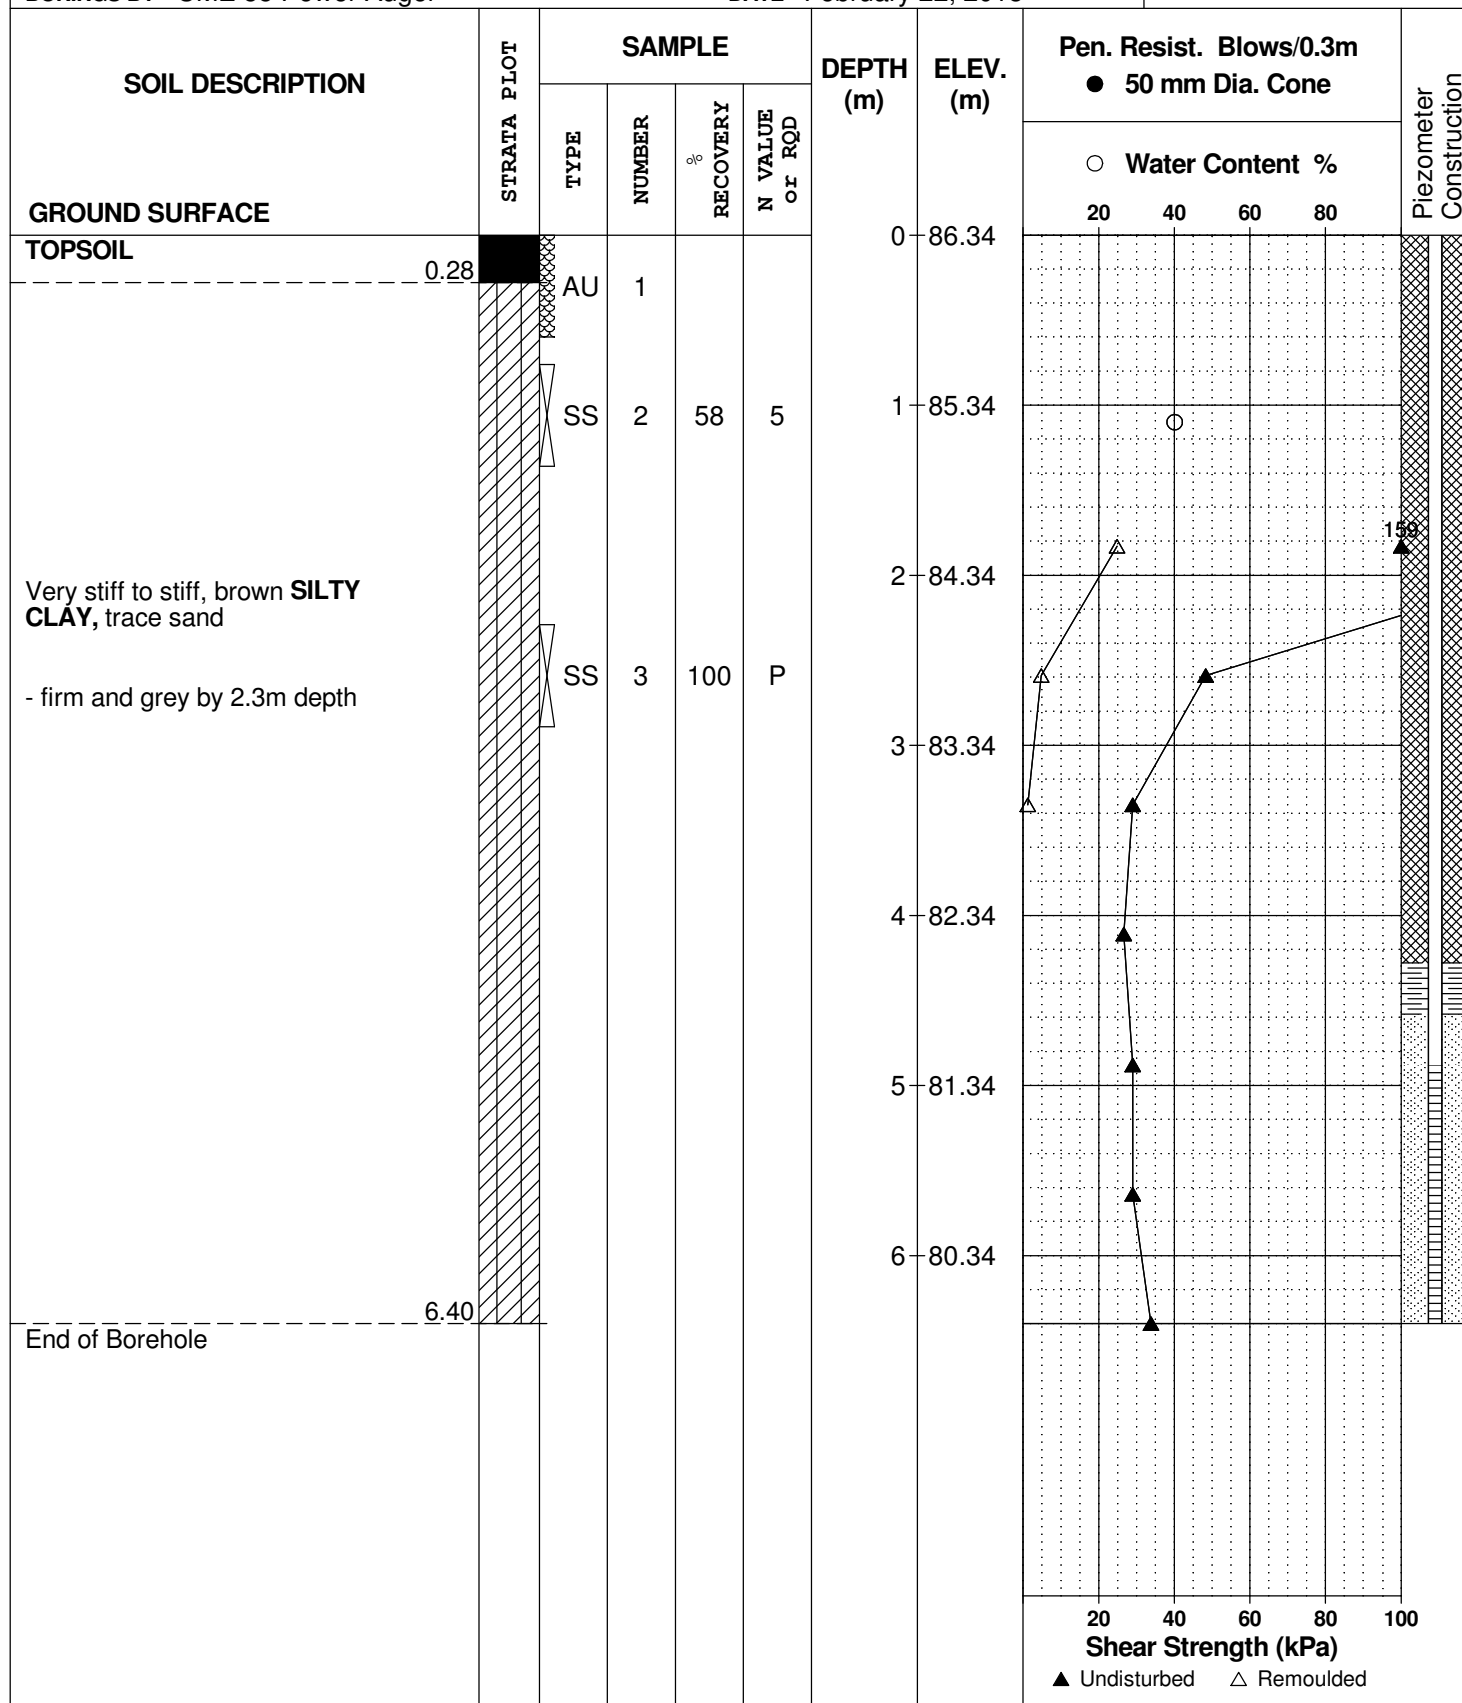

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH13-18

BORINGS BY CME 55 Power Auger

DATE February 22, 2018

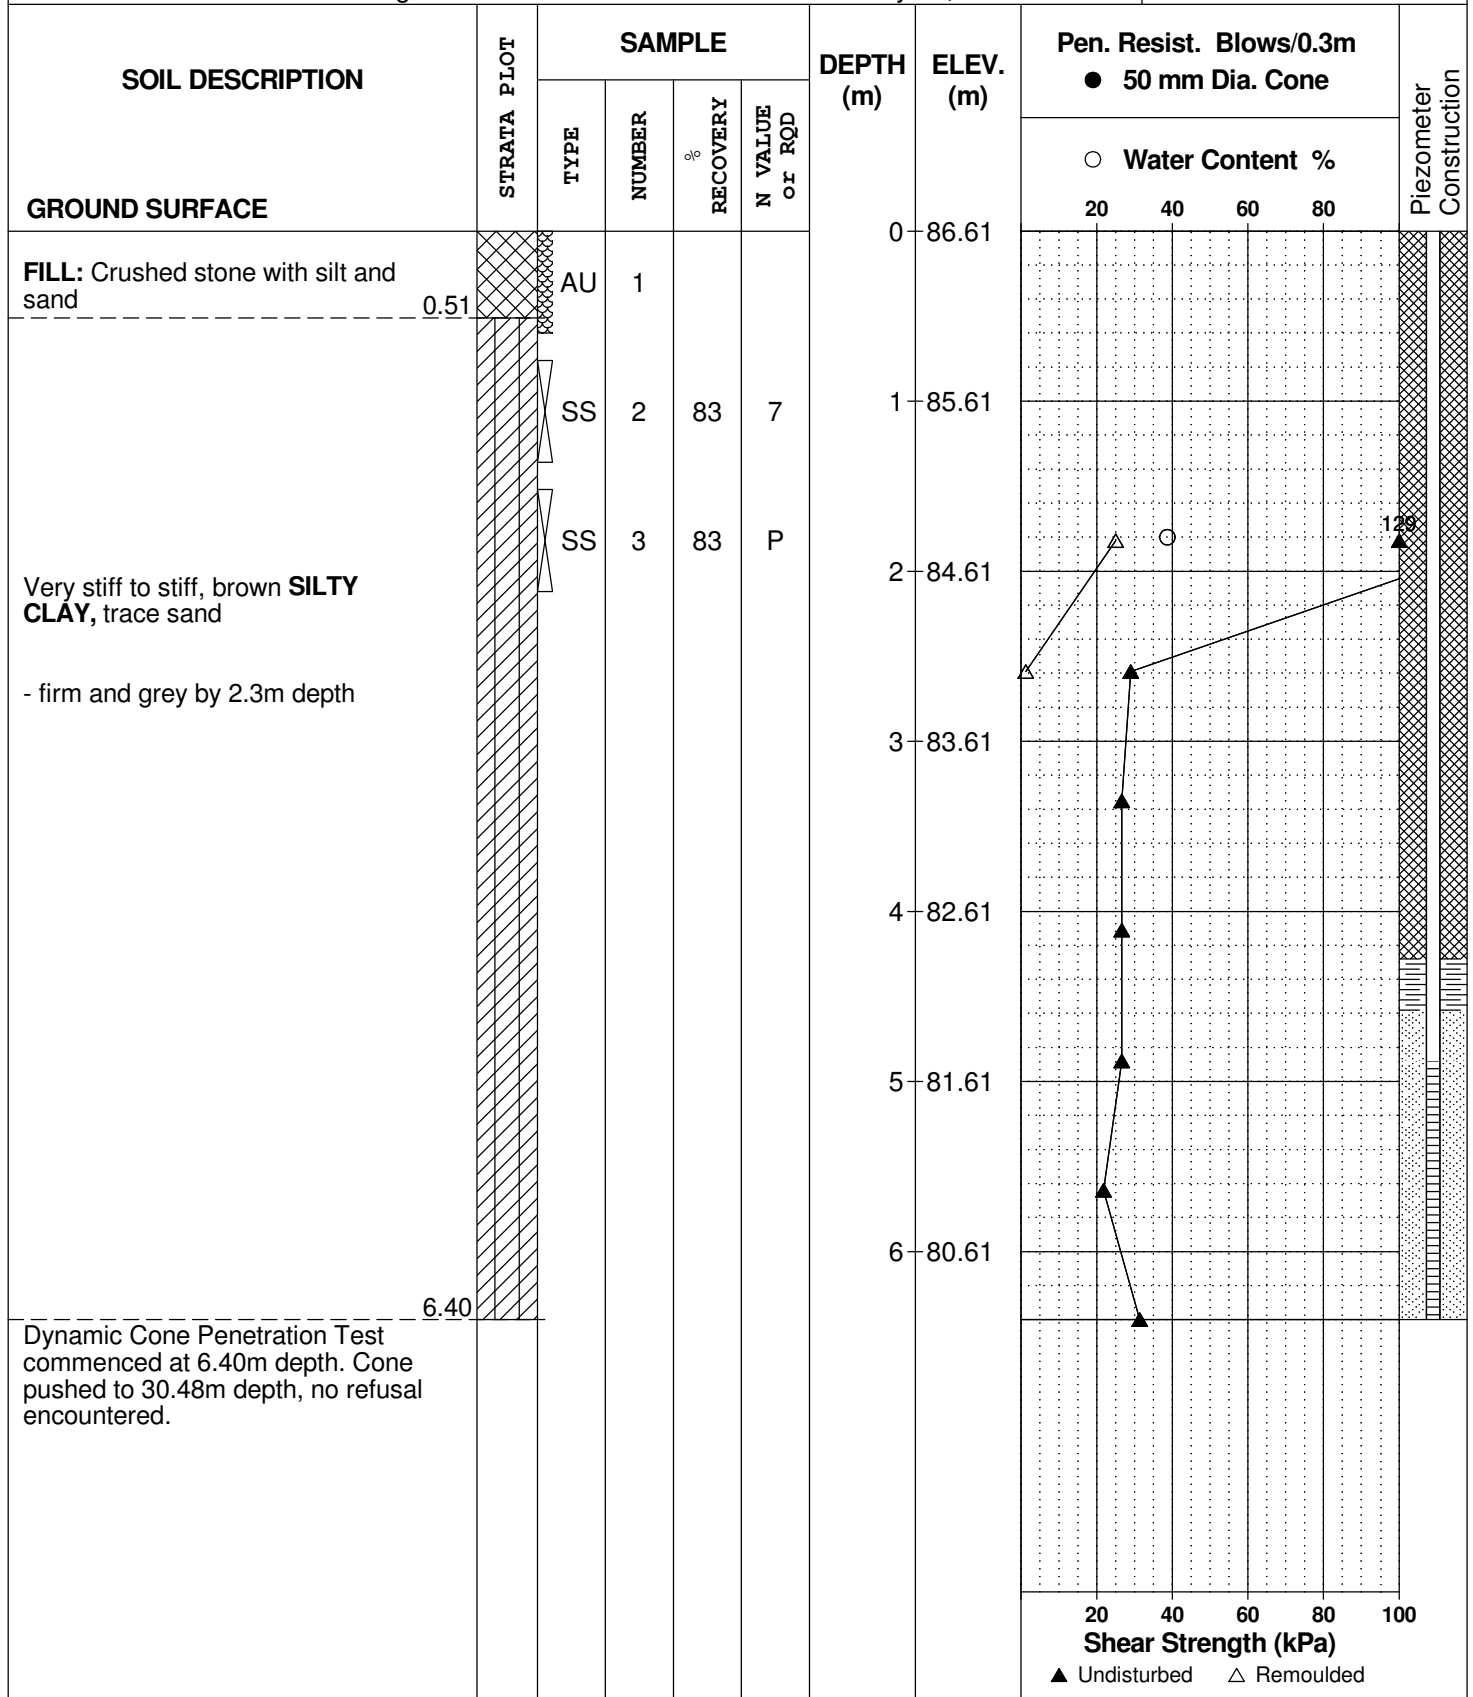

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH14-18

BORINGS BY CME 55 Power Auger

DATE February 22, 2018

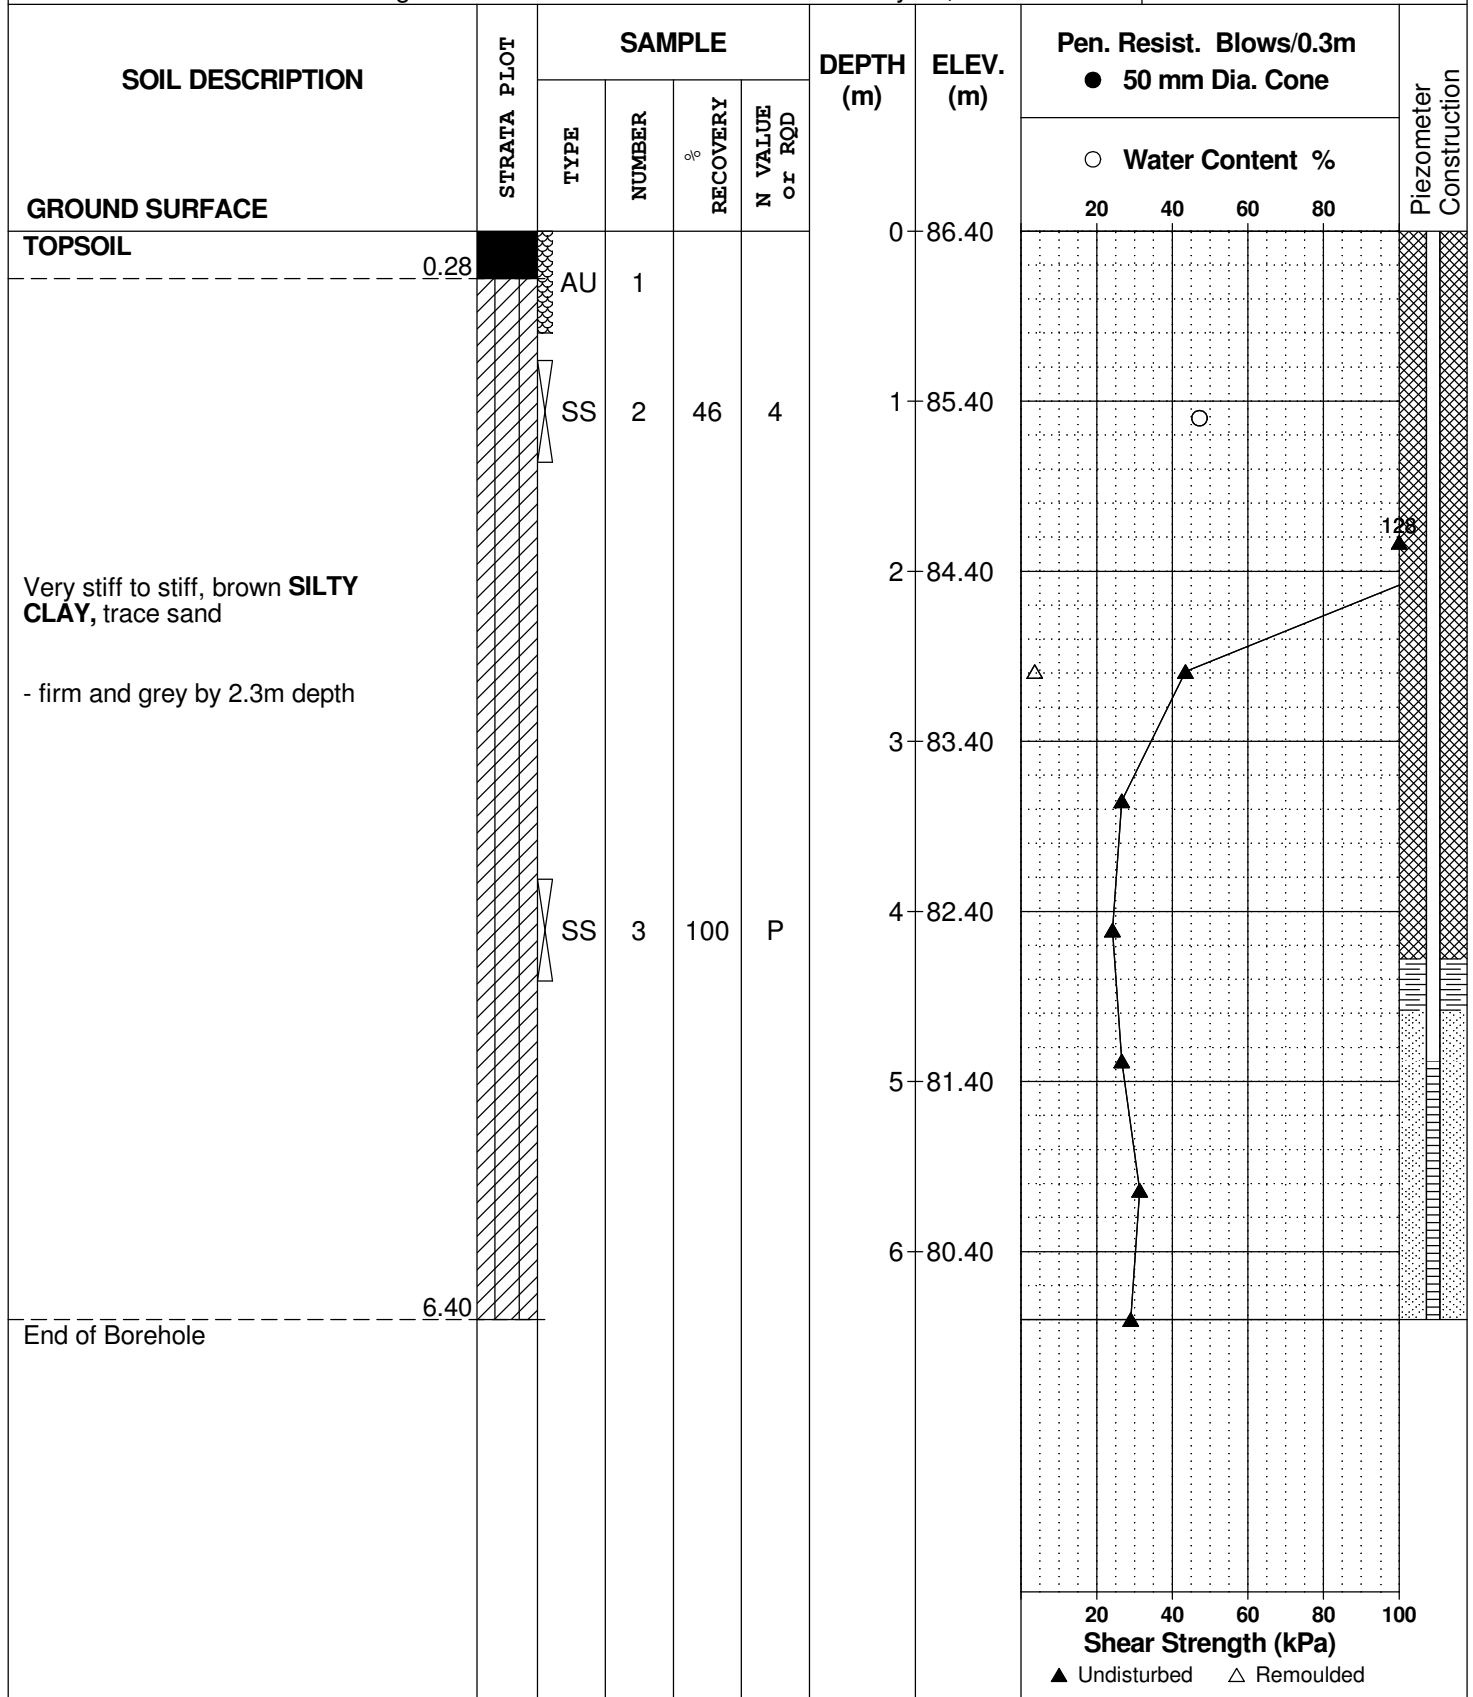

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Ph. 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH15-18

BORINGS BY CME 55 Power Auger

DATE February 23, 2018

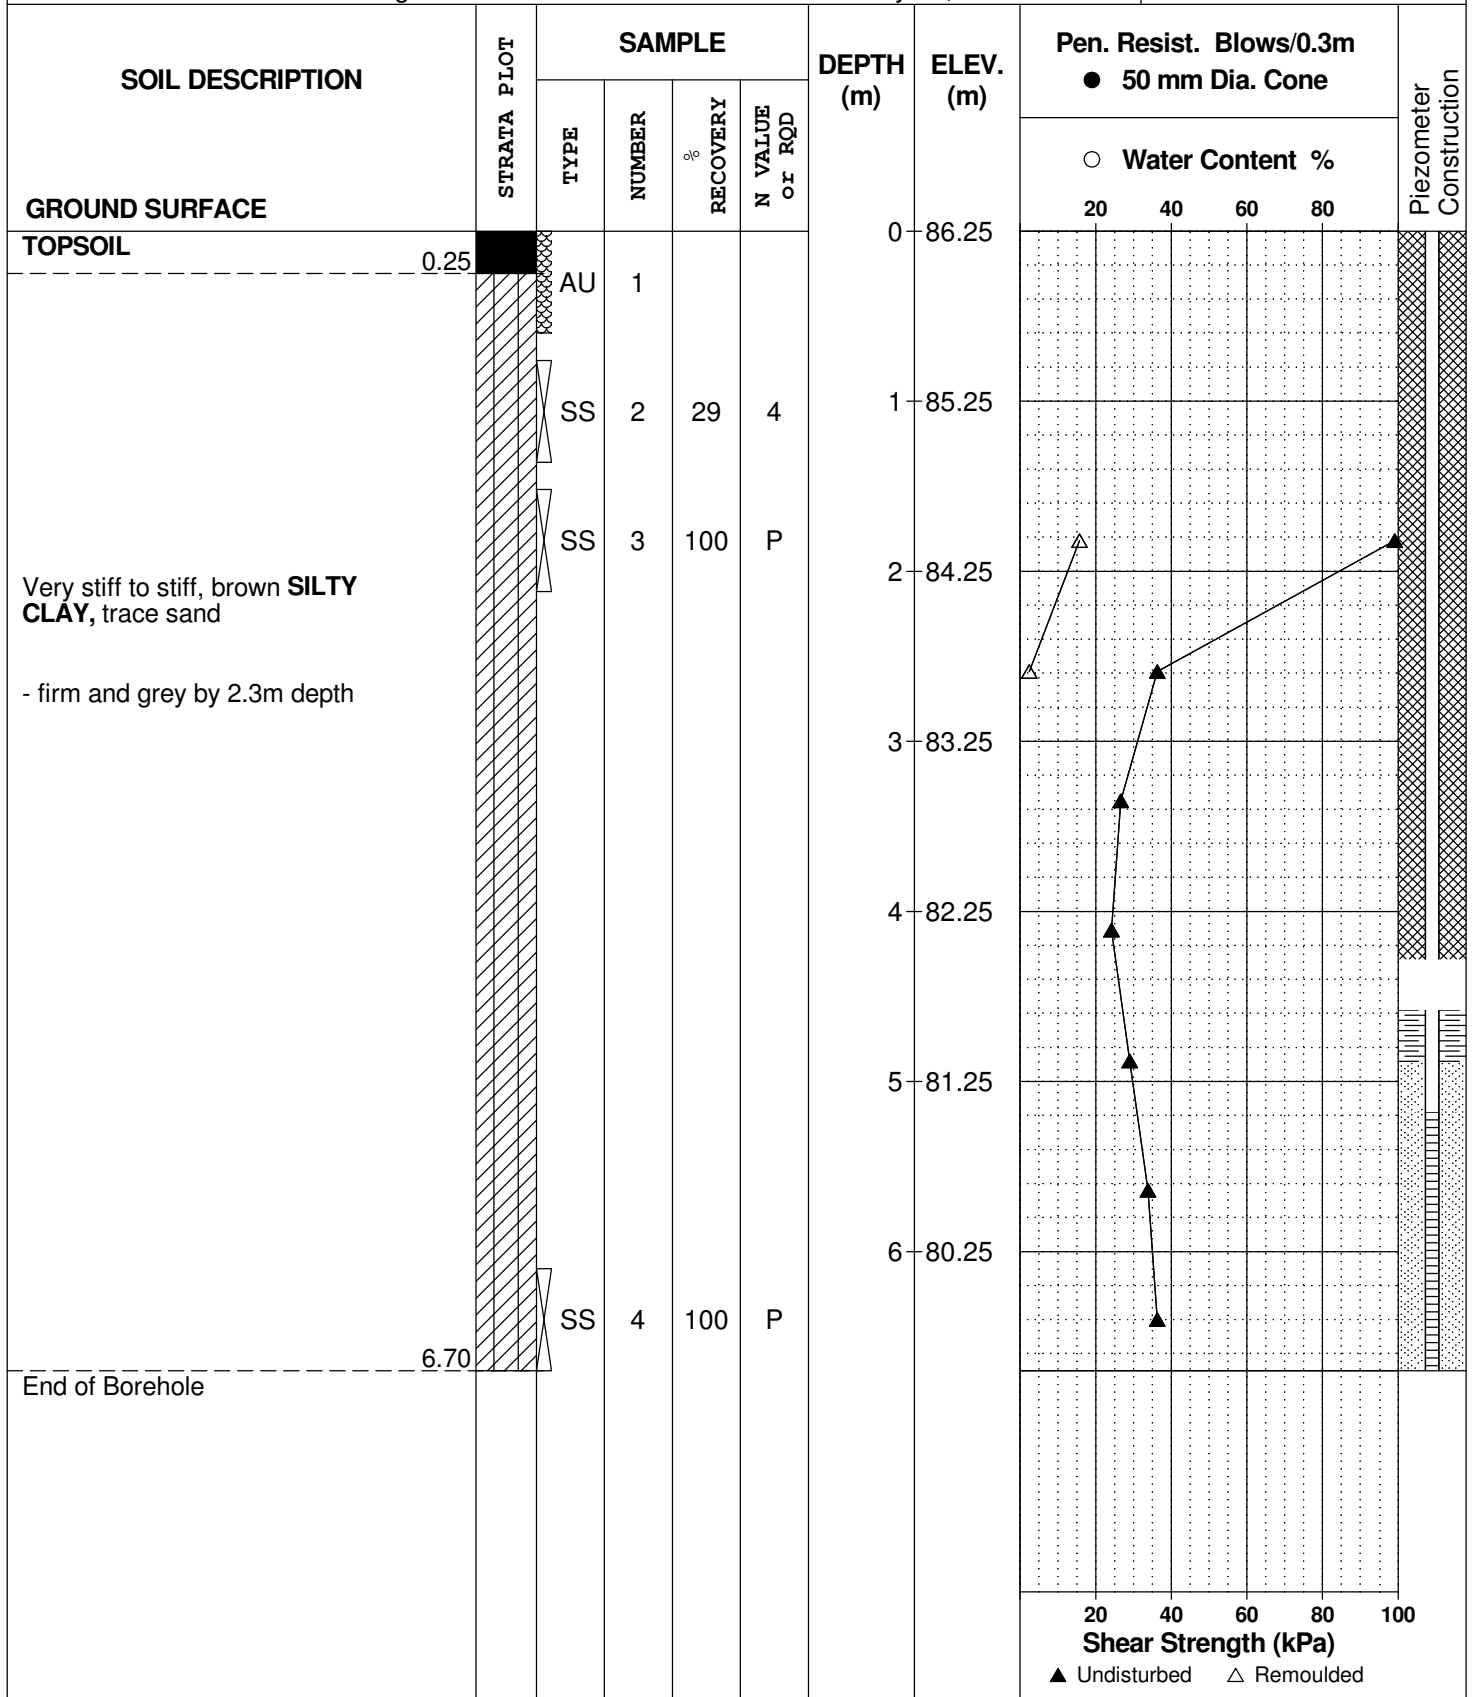

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
BH16-18

BORINGS BY CME 55 Power Auger

DATE February 23, 2018

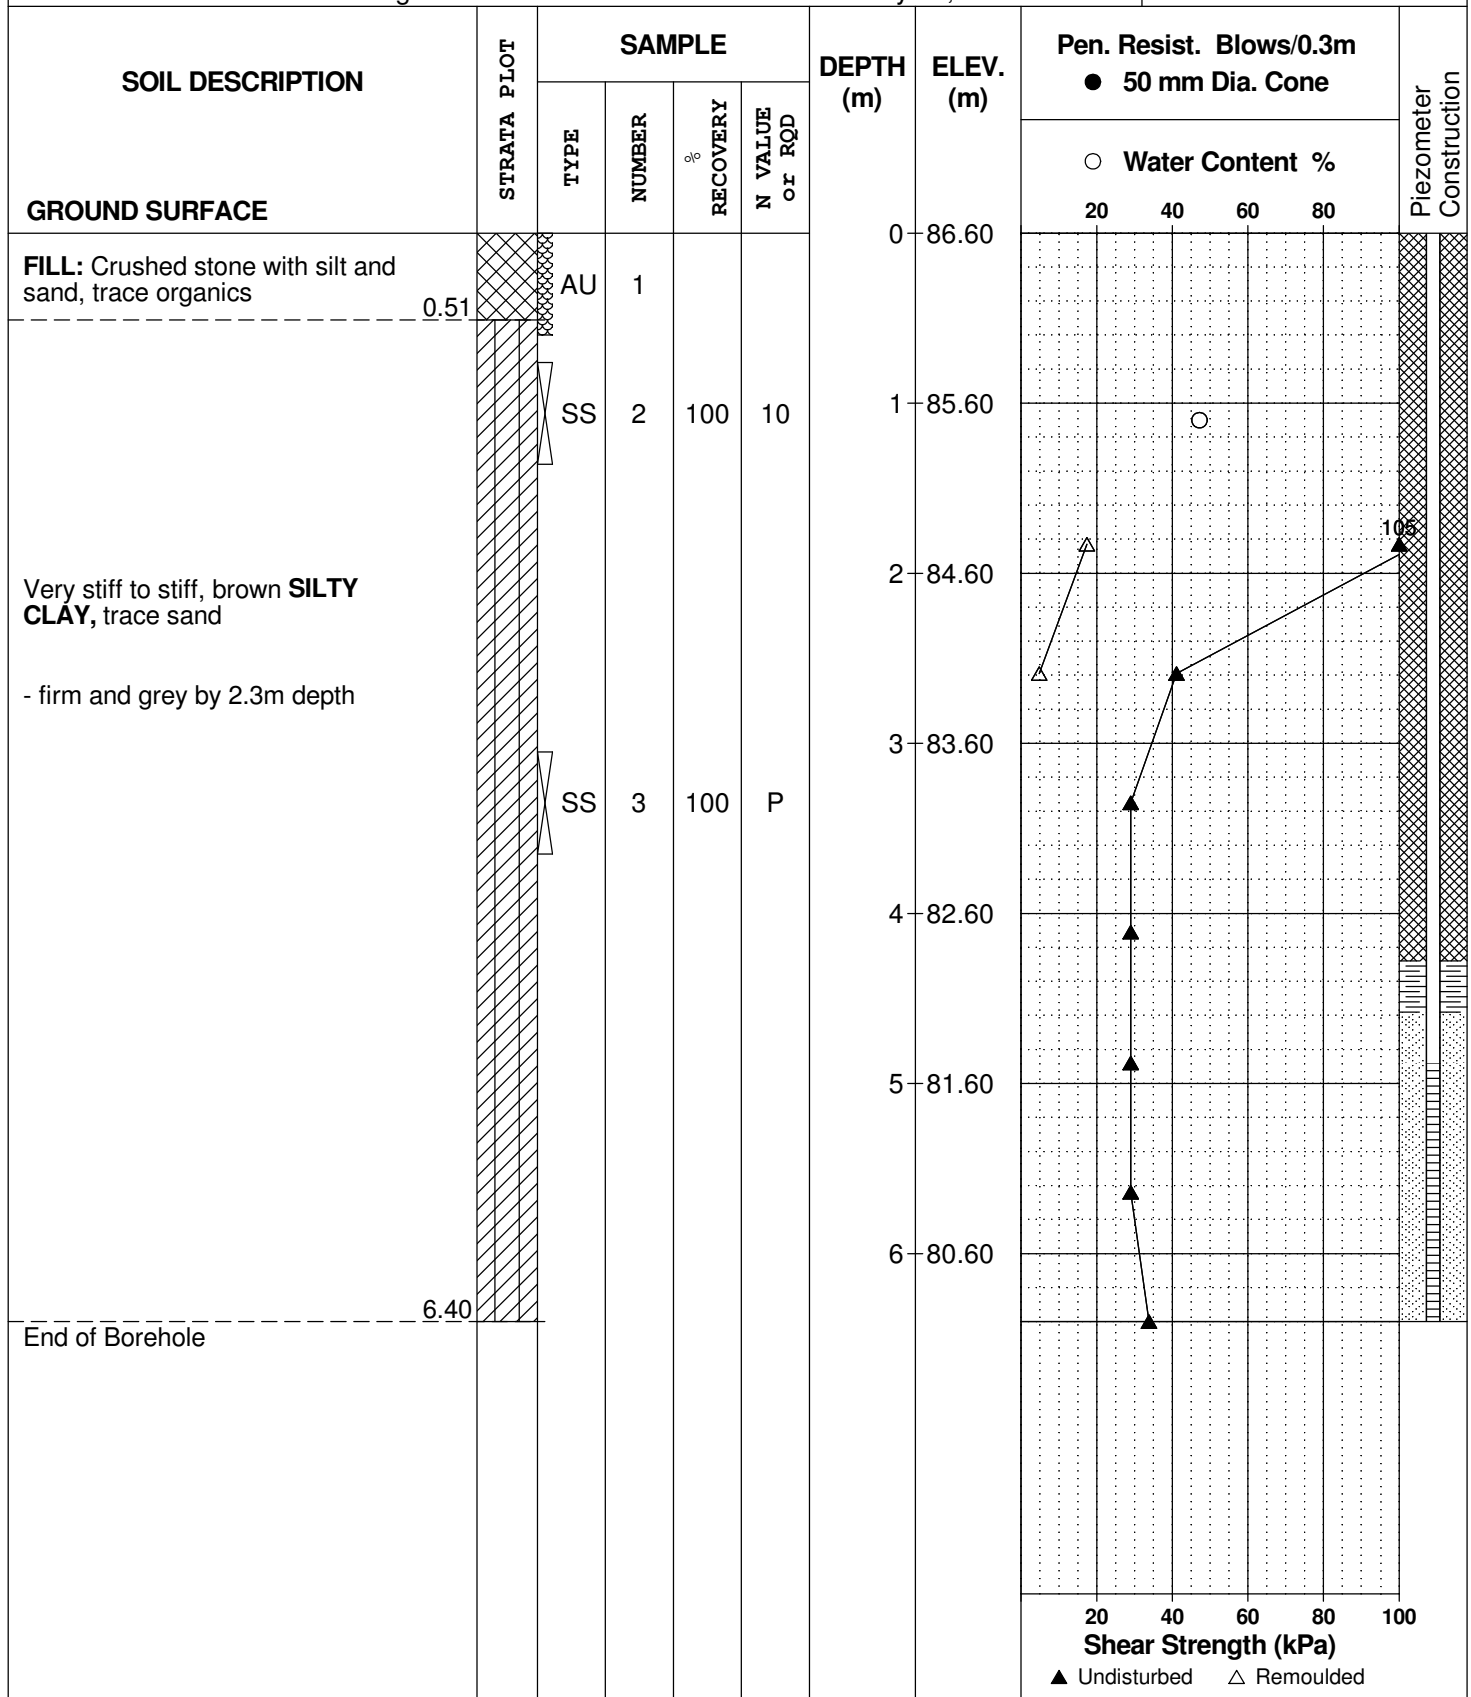

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 1A

BORINGS BY CME 55 Power Auger

DATE February 27, 2017

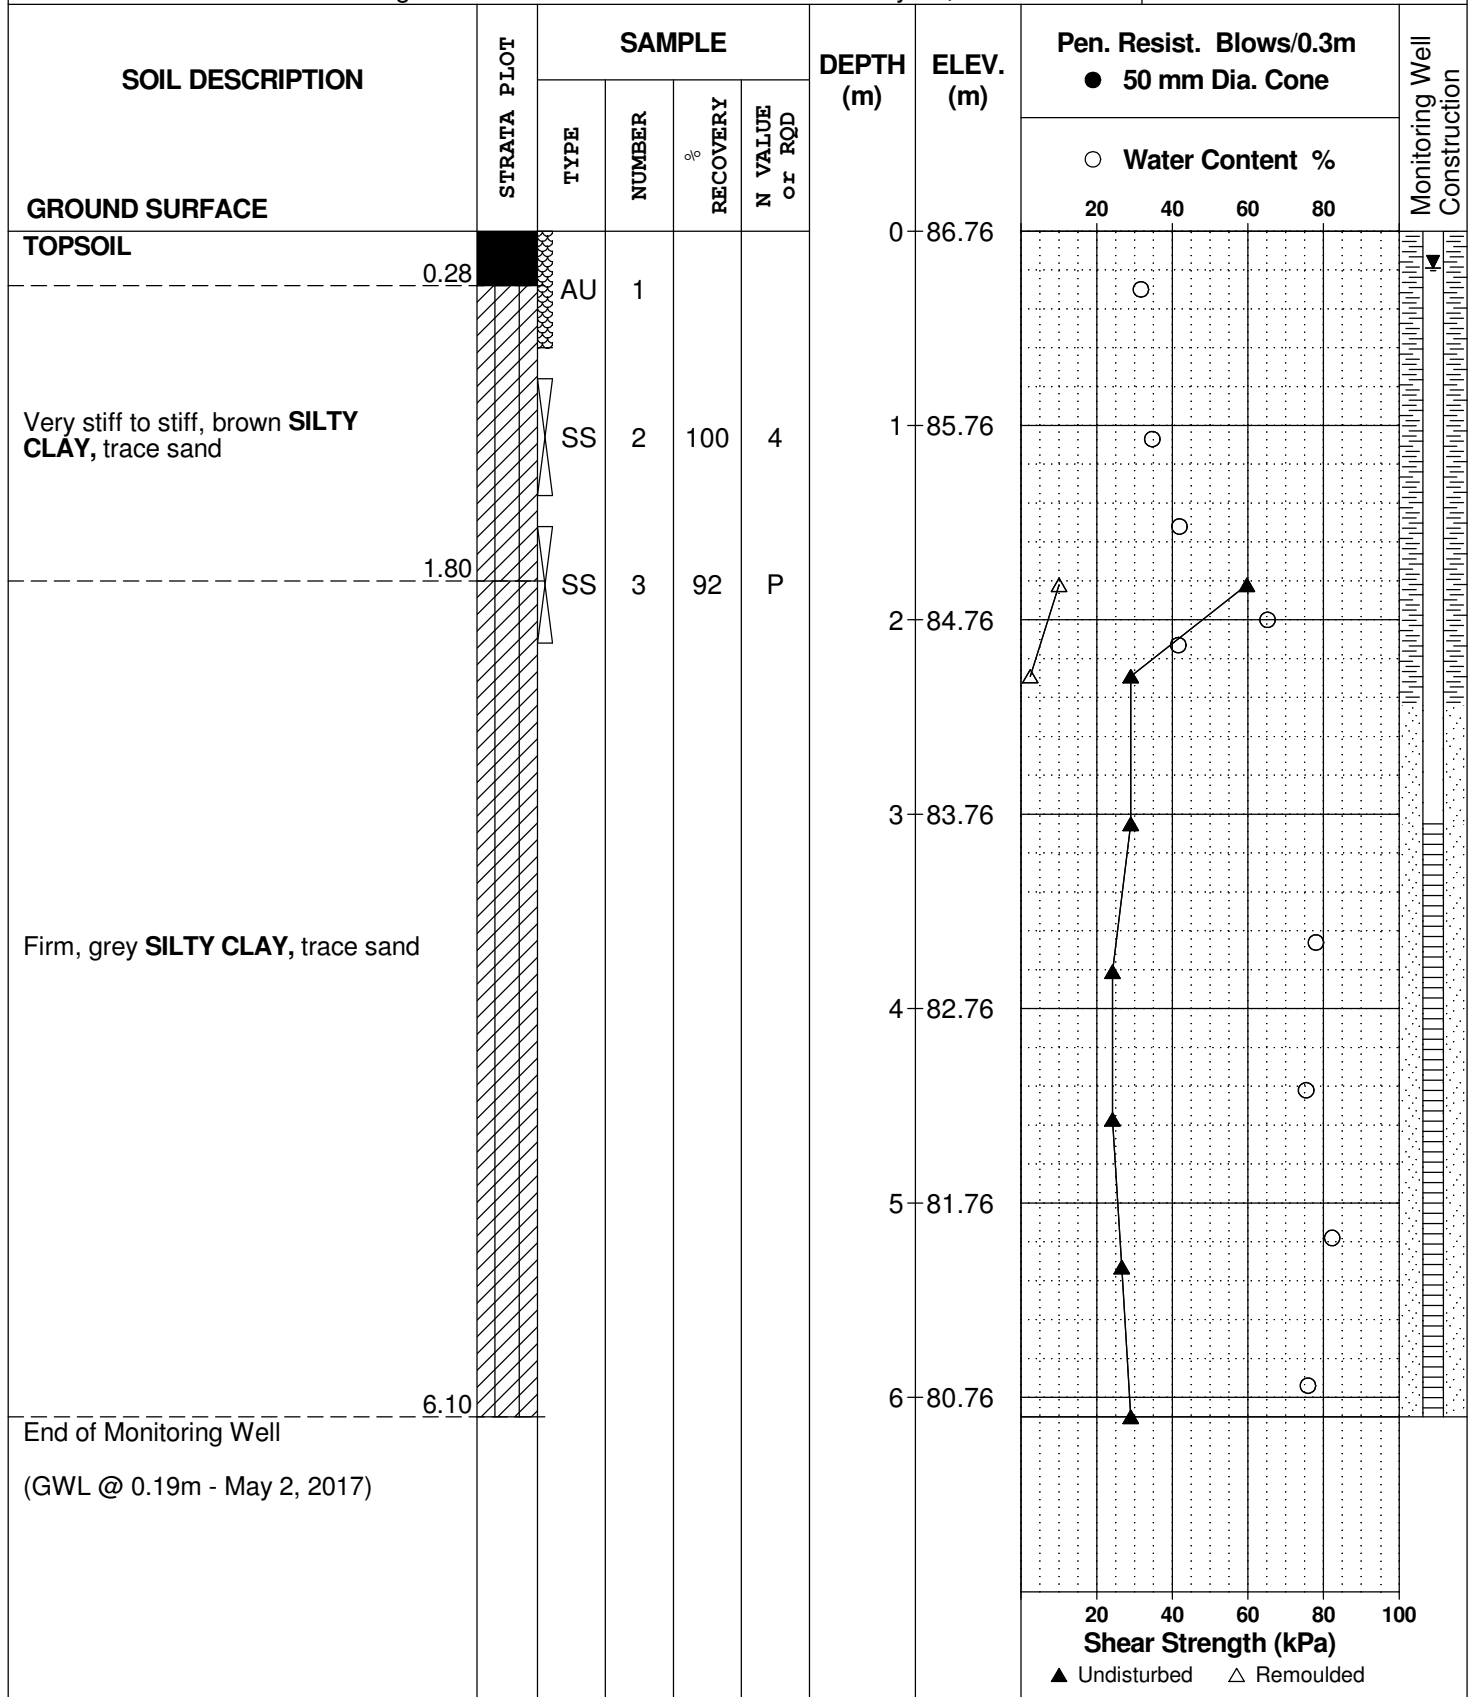

SOIL PROFILE AND TEST DATA

**Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario**

FILE NO. PG4049

HOLE NO. **MW 1B**

DATE February 27, 2017

[illegible]

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 2A

BORINGS BY CME 55 Power Auger

DATE February 27, 2017

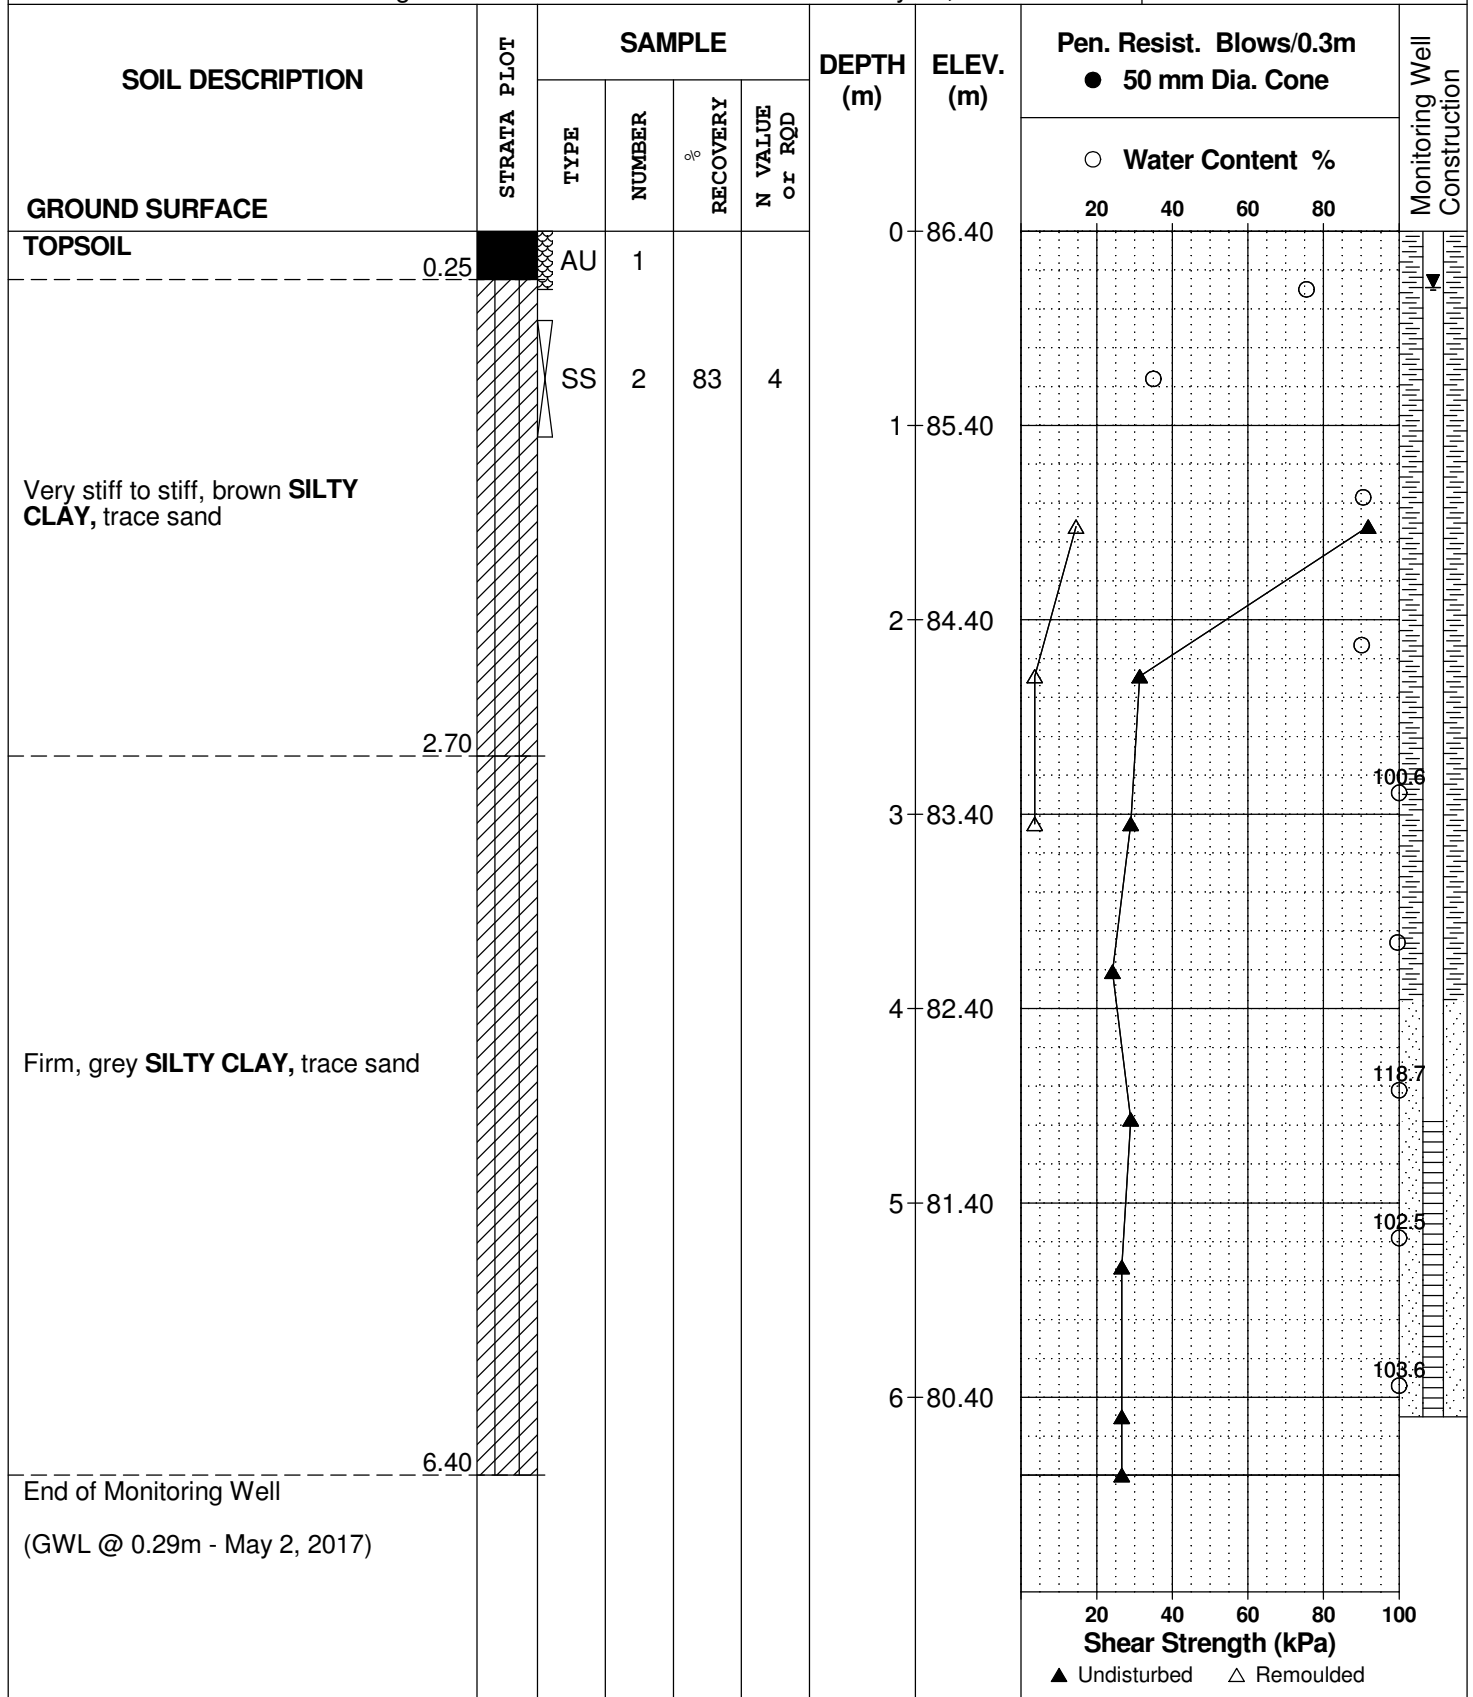

SOIL PROFILE AND TEST DATA

**Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario**

DATUM Ground surface elevations provided by J.D. Barnes Limited.

FILE NO. PG4049

REMARKS

HOLE NO. **MW 2B**

BORINGS BY CME 55 Power Auger

DATE February 27, 2017

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	% RECOVERY	N VALUE or RQD			○ Water Content %				
								20	40	60	80	
GROUND SURFACE						0	86.40					
TOPSOIL	0.25											
Very stiff to stiff, brown SILTY CLAY , trace sand	2.70					1	85.40					
						2	84.40					
						3	83.40					
Firm, grey SILTY CLAY , trace sand	3.66											
End of Monitoring Well (GWL @ 0.30m - May 2, 2017)												

▲ Undisturbed △ Remoulded

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 3A

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

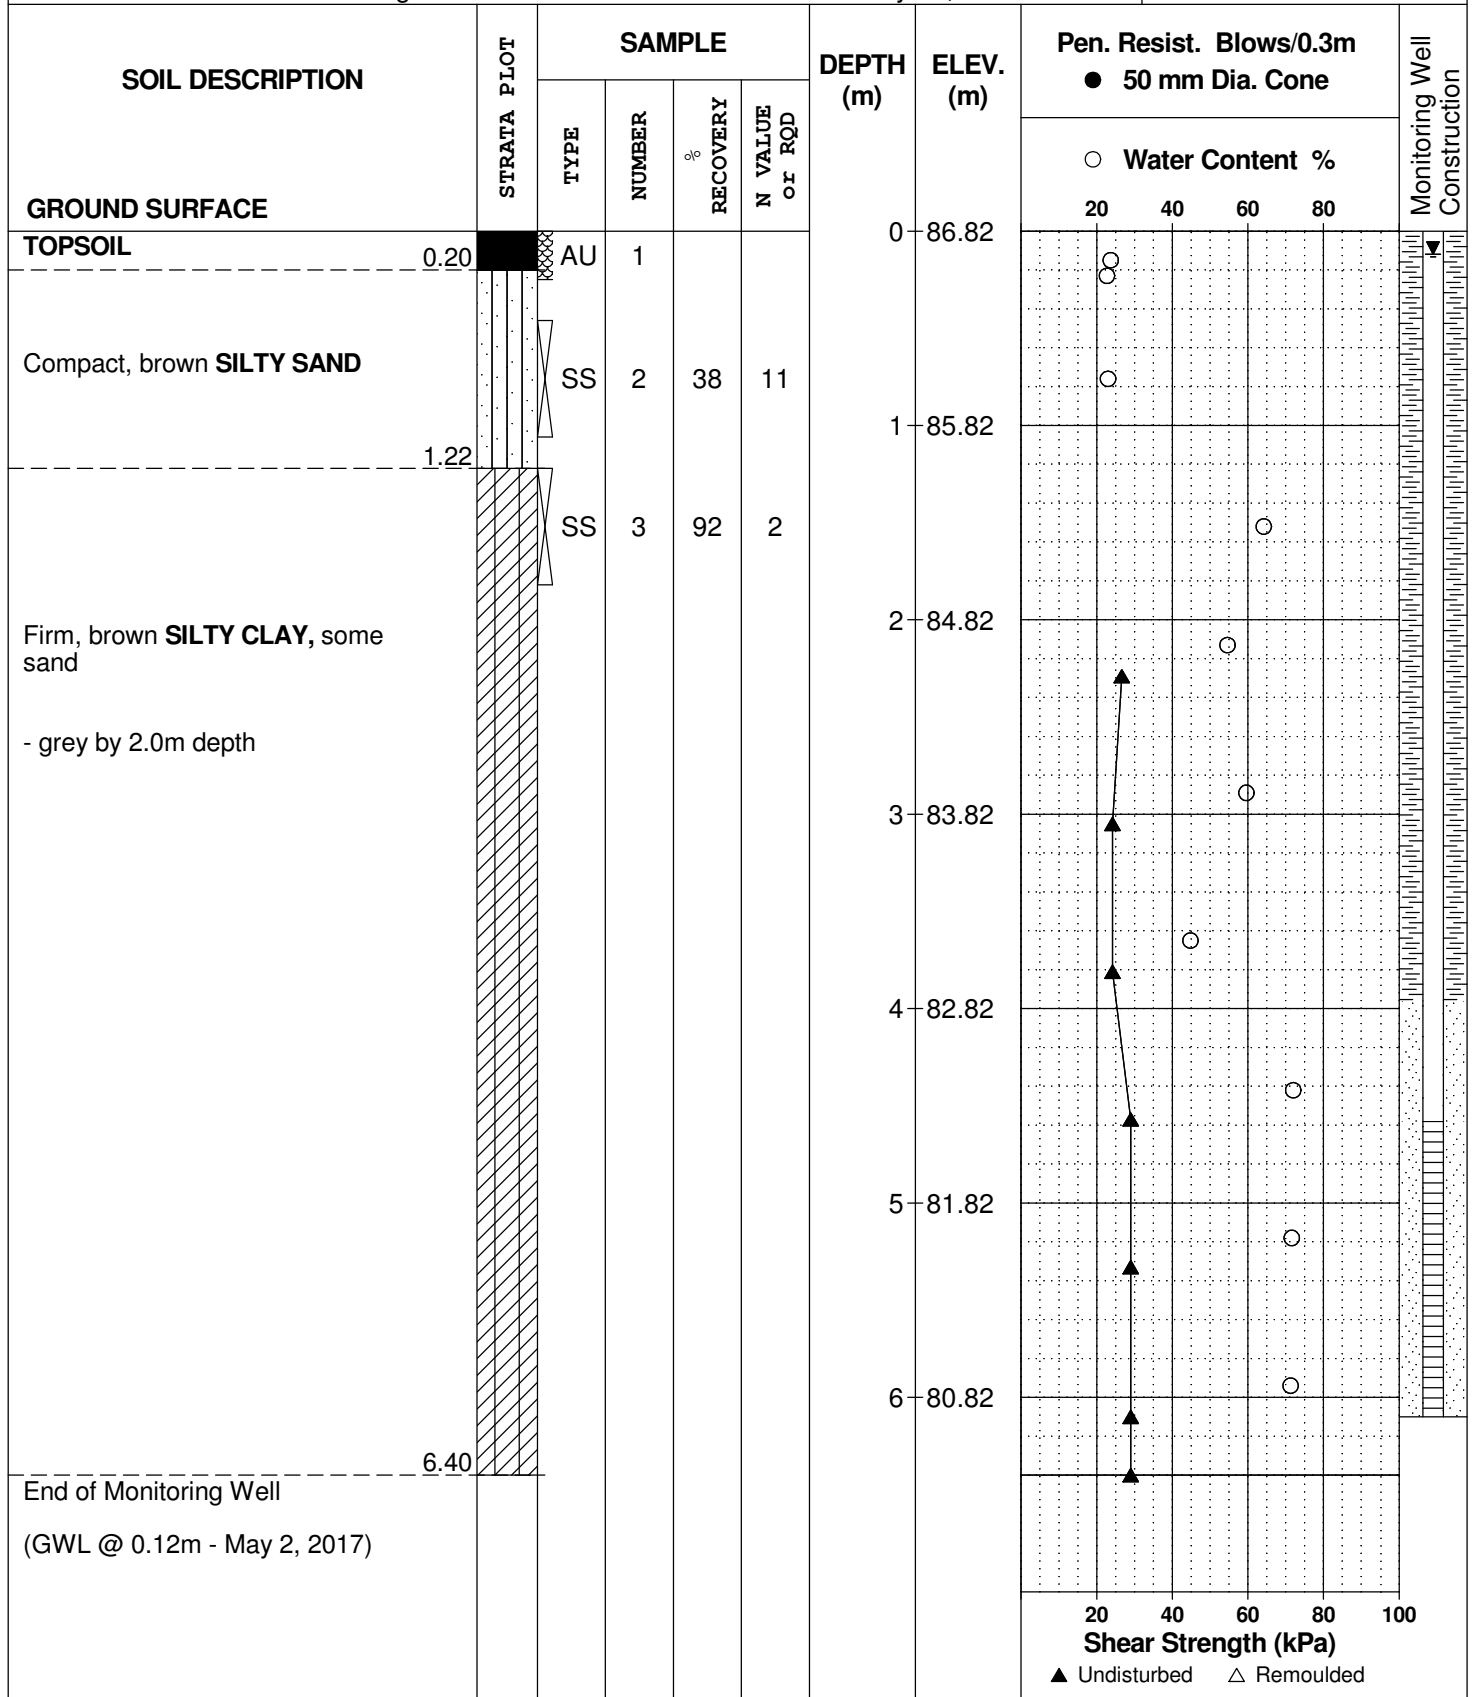

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.

FILE NO.
PG4049

REMARKS

HOLE NO.
MW 3B

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
GROUND SURFACE								20	40	60	80	
TOPSOIL	0.20					0	86.82					
Compact, brown SILTY SAND	1.22					1	85.82					
Firm, brown SILTY CLAY, some sand - grey by 2.0m depth	3.66					2	84.82					
						3	83.82					
Dynamic Cone Penetration Test (DCPT) commenced at 3.66m depth. Cone pushed to 30.48m depth. No refusal encountered. (GWL @ 0.28m - May 2, 2017)												
								20	40	60	80	100
								Shear Strength (kPa)				
								▲ Undisturbed △ Remoulded				

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 4A

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

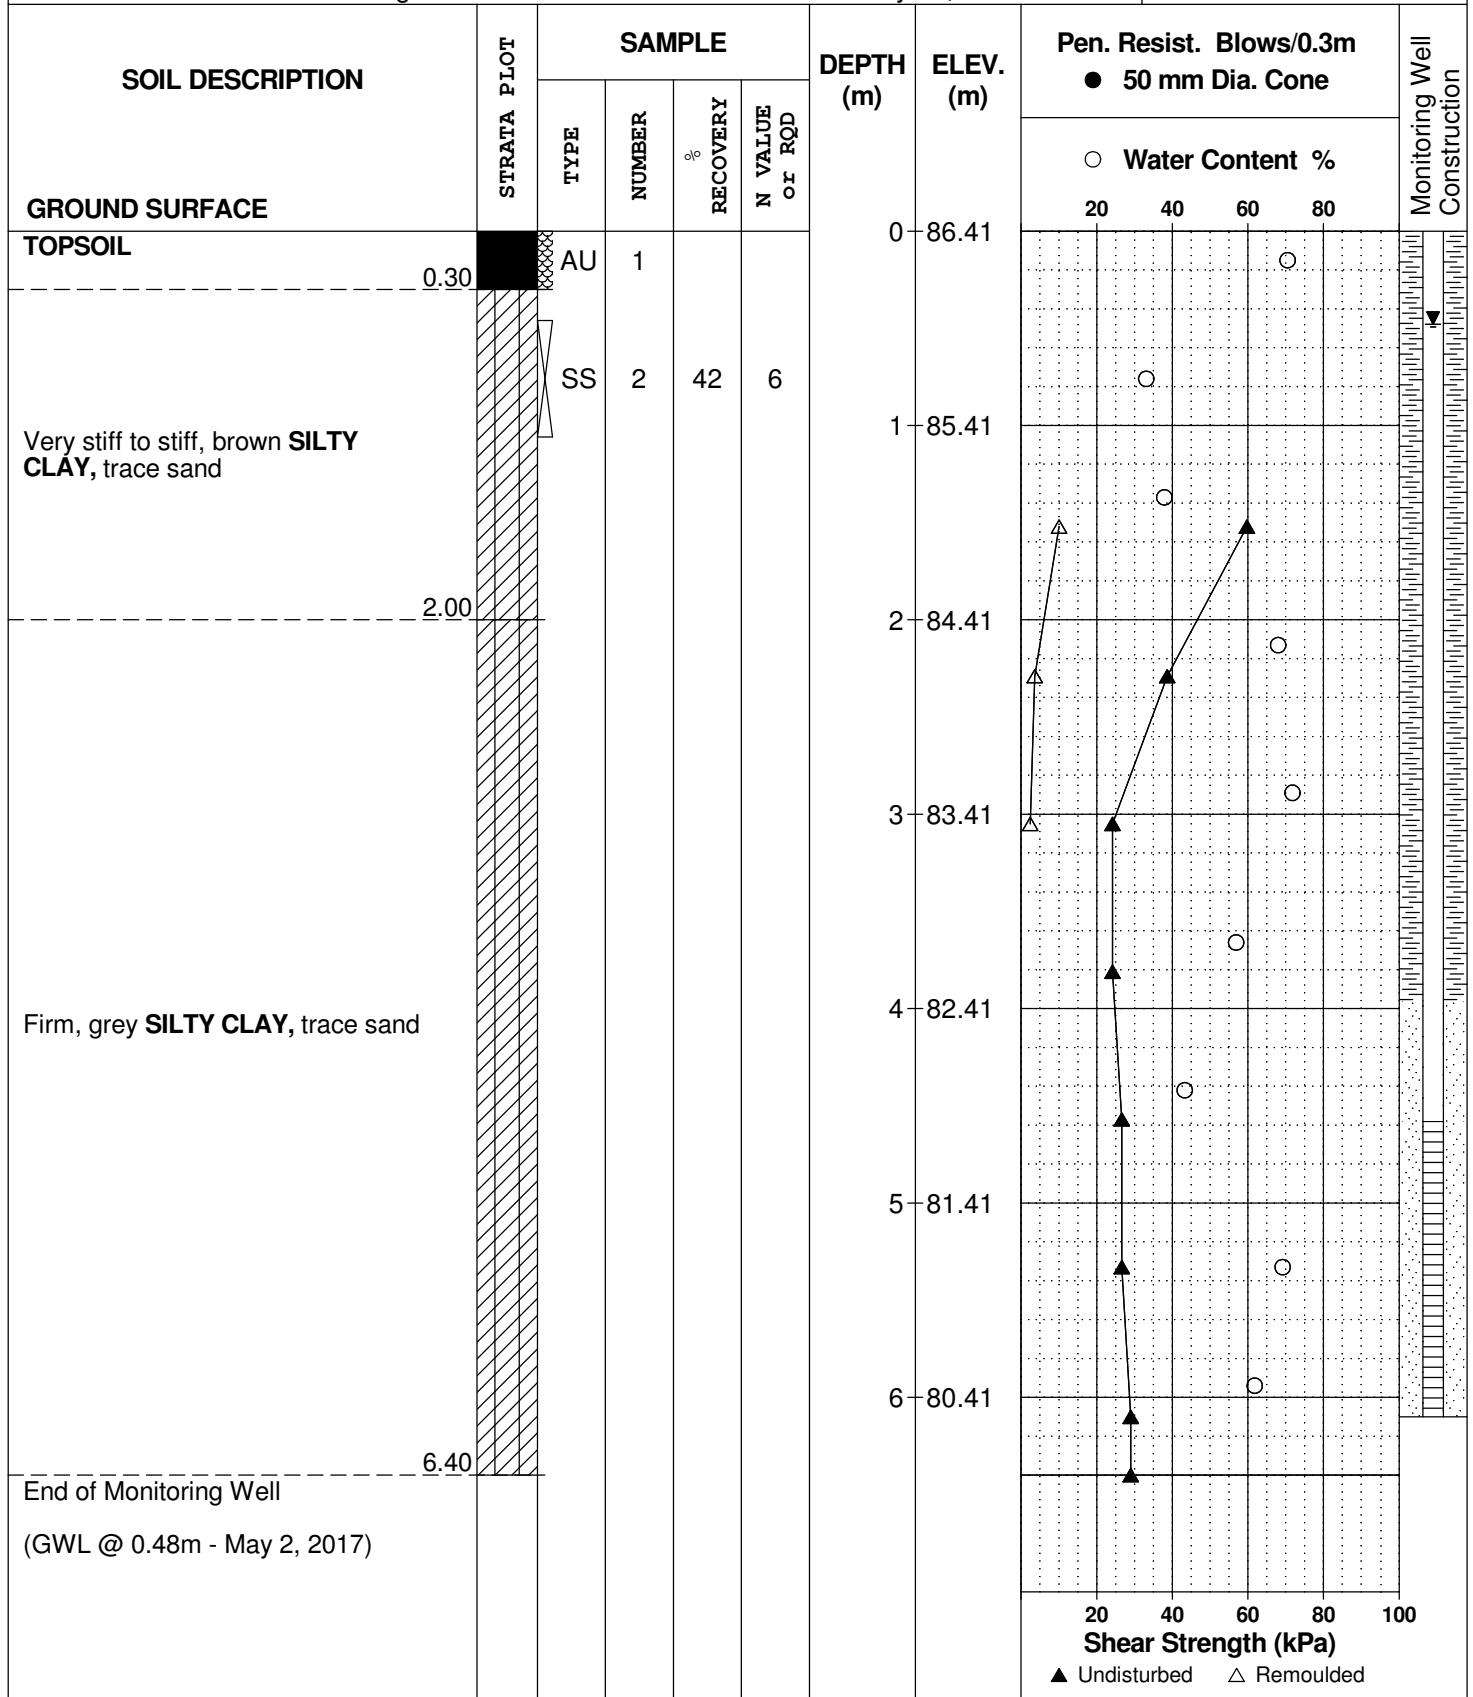

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.

FILE NO.
PG4049

REMARKS

HOLE NO.
MW 4B

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
								20	40	60	80	
GROUND SURFACE												
TOPSOIL	0.30					0	86.41					
Very stiff to stiff, brown SILTY CLAY , trace sand	2.00					1	85.41					
Firm, grey SILTY CLAY , trace sand	3.66					2	84.41					
End of Monitoring Well (GWL @ 0.34m - May 2, 2017)						3	83.41					

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 5A

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

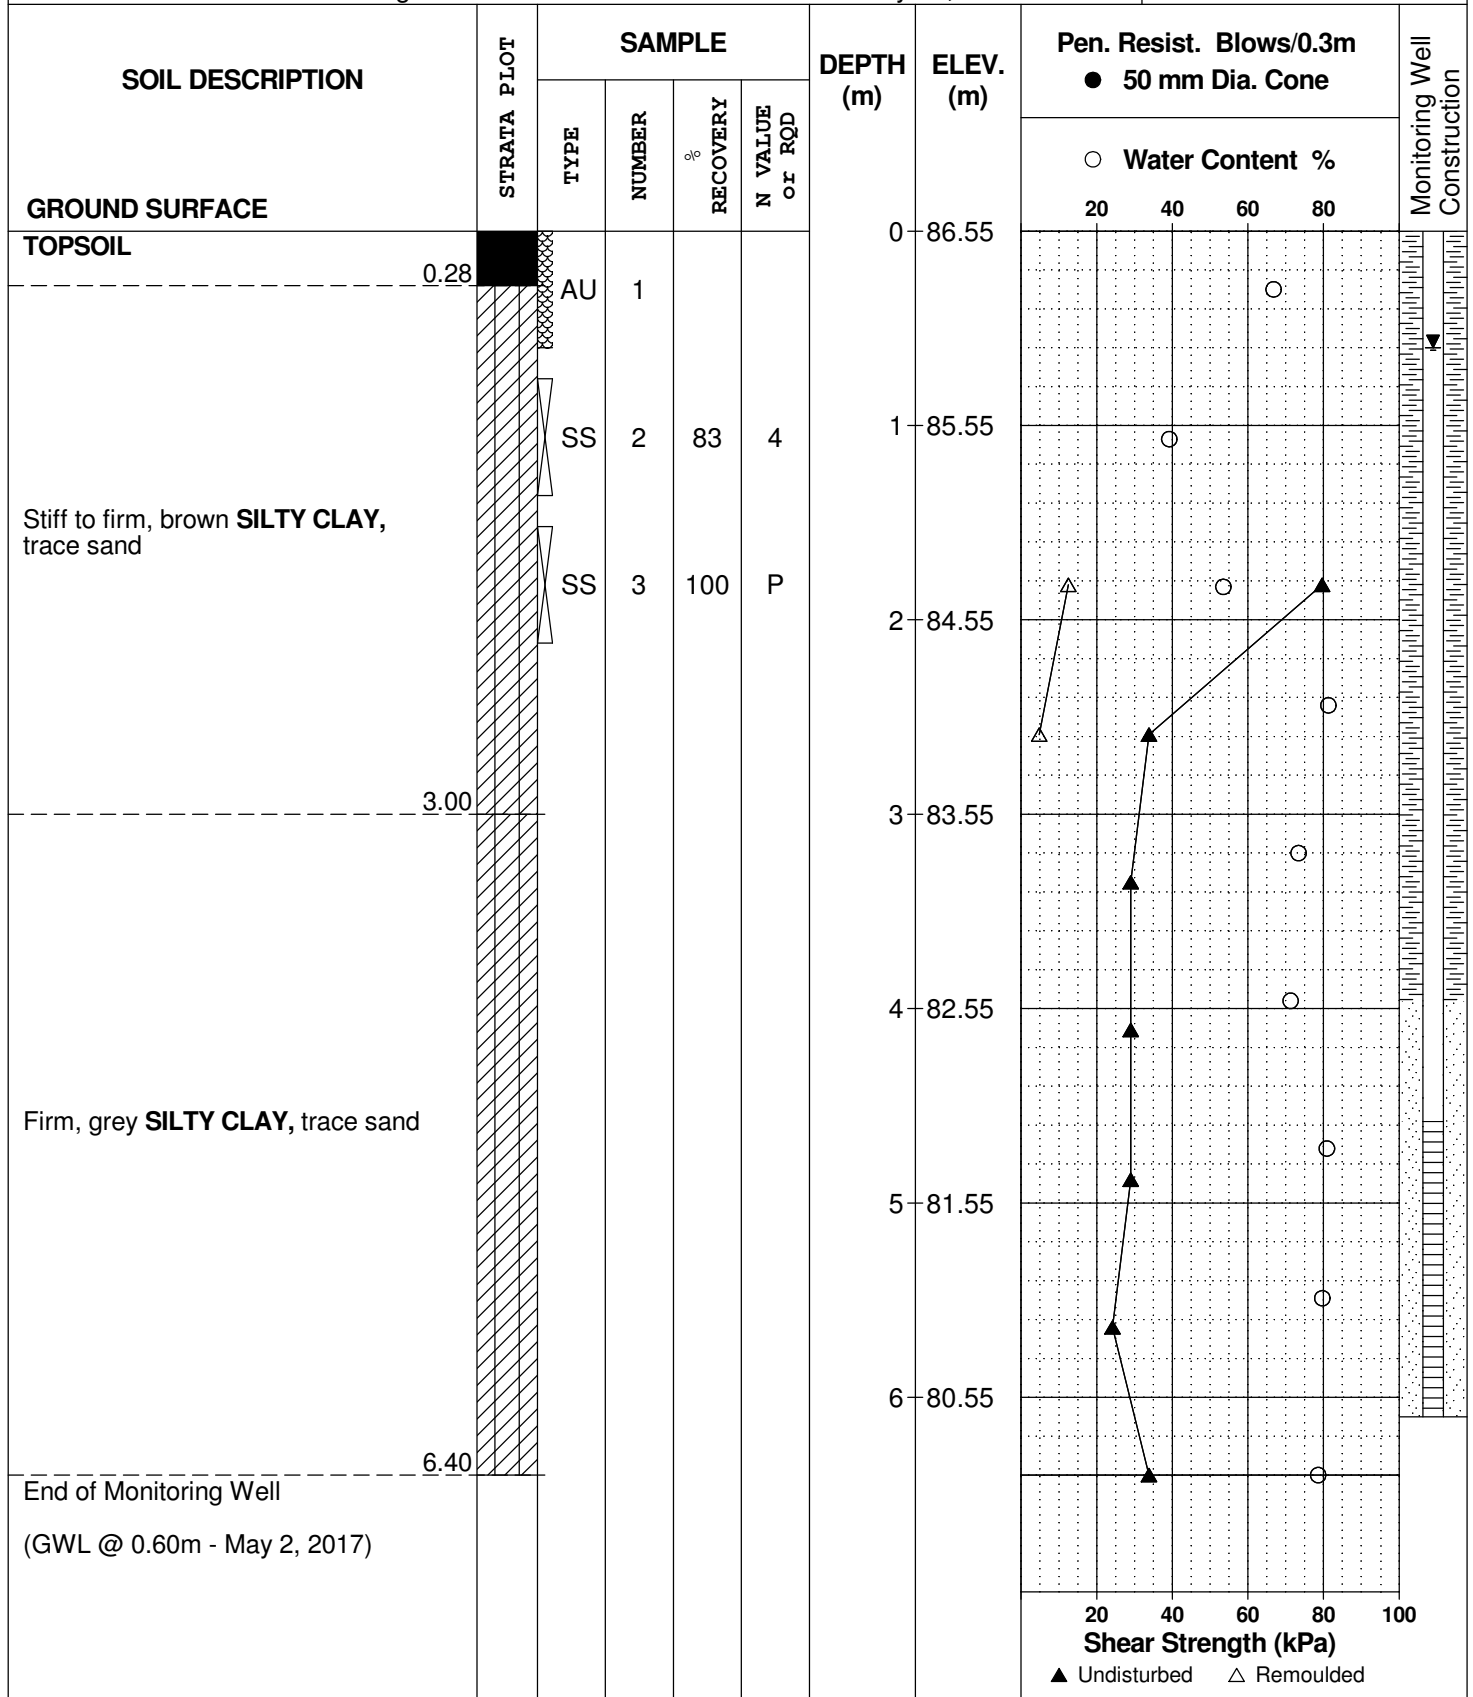

SOIL PROFILE AND TEST DATA

**Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario**

FILE NO. PG4049

HOLE NO. **MW 5B**

DATE February 28, 2017

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	% RECOVERY	N VALUE or RQD			○ Water Content % 20 40 60 80				
GROUND SURFACE												
TOPSOIL						0	86.55					
- - - - - 0.28												
Stiff to firm, brown SILTY CLAY , trace sand						1	85.55					
						2	84.55					
- - - - - 3.00												
Firm, grey SILTY CLAY , trace sand						3	83.55					
- - - - - 3.66												
End of Monitoring Well (GWL @ 0.38m - May 2, 2017)												

▲ Undisturbed △ Remoulded

Shear Strength (kPa)

20 40 60 80 100

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 6A

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

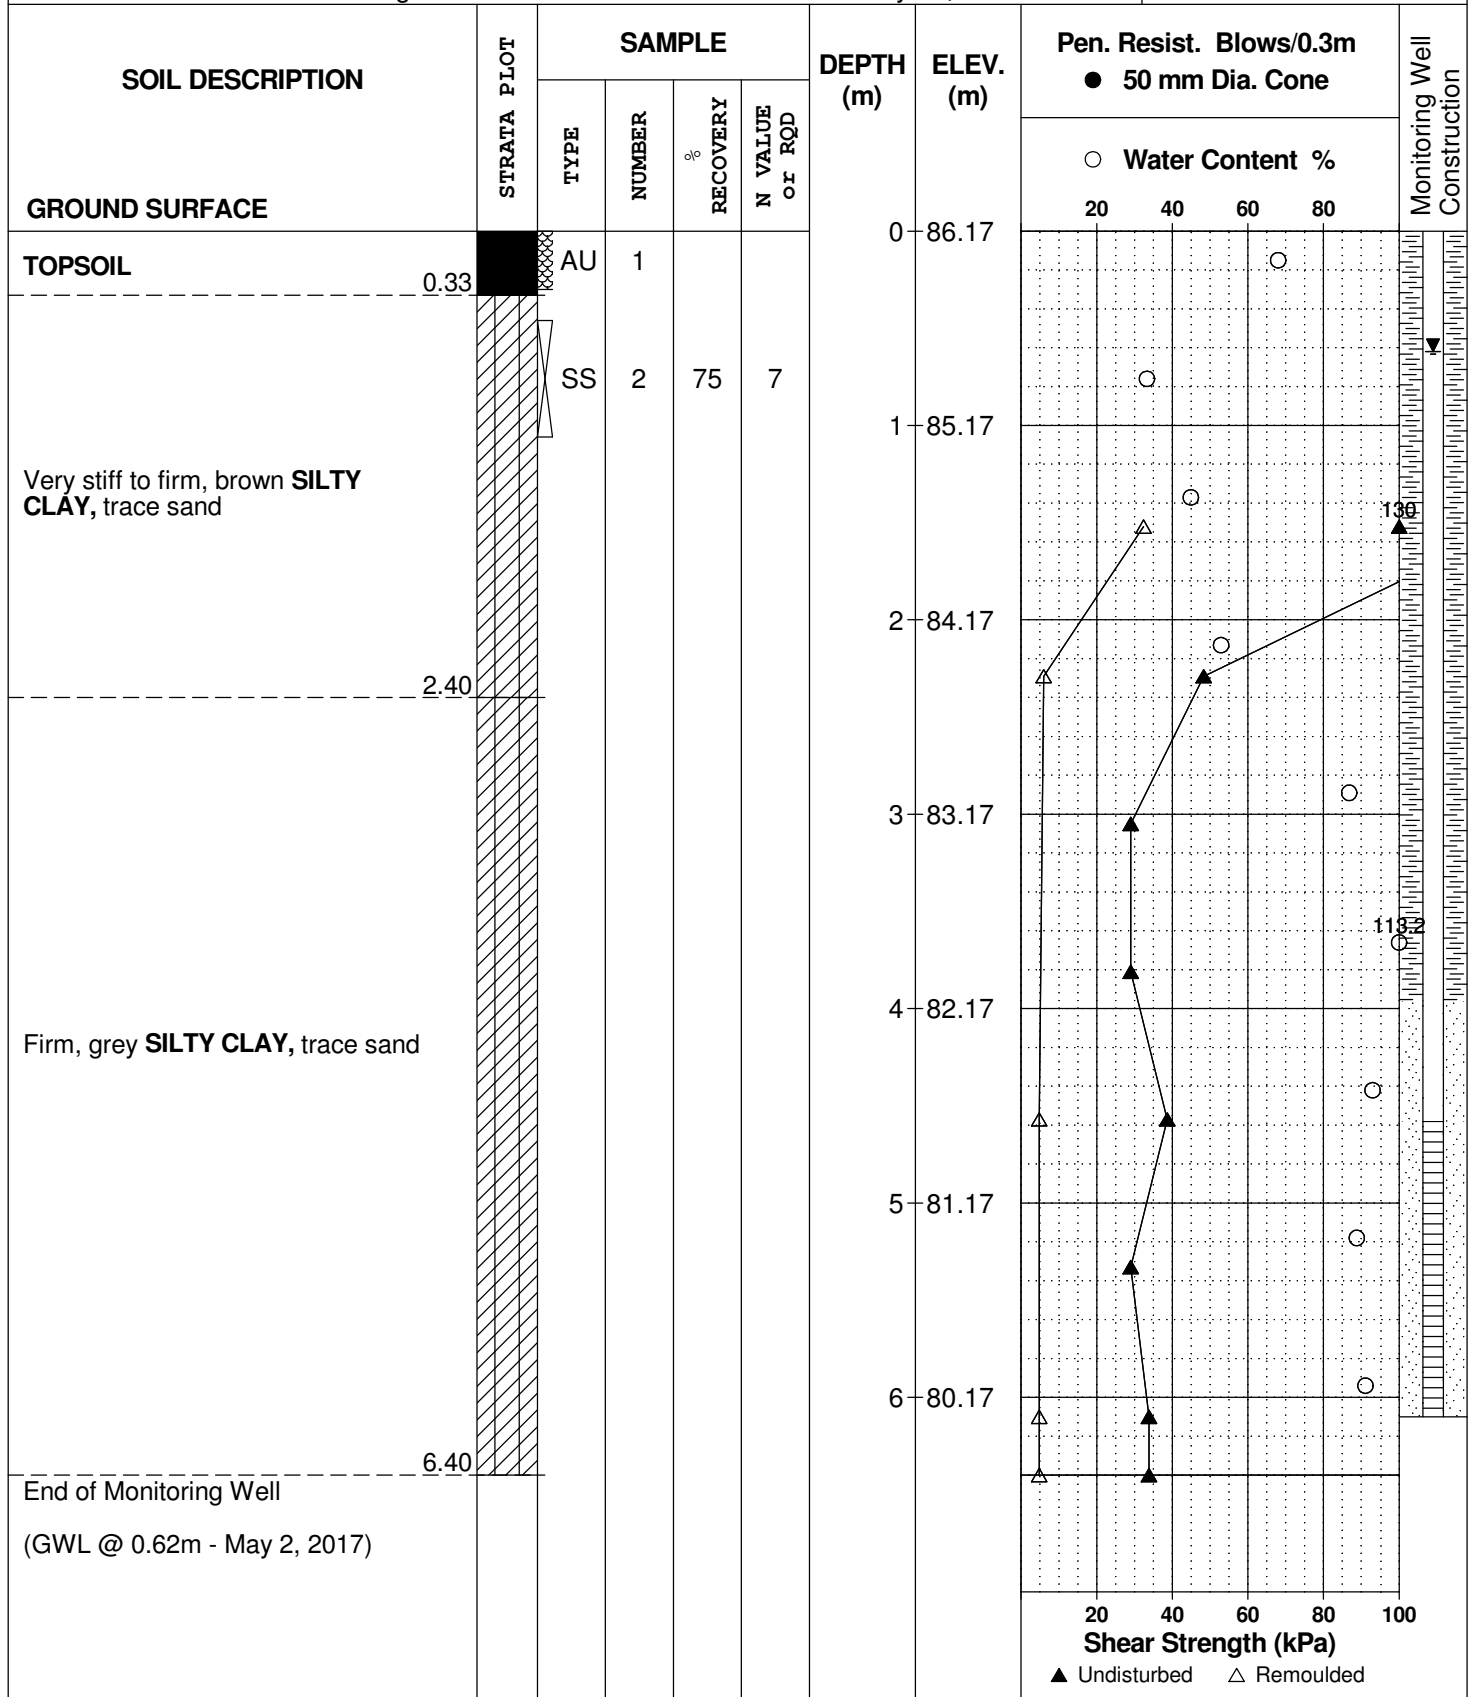

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.

FILE NO.
PG4049

REMARKS

HOLE NO.
MW 6B

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
						20	40	60	80			
GROUND SURFACE												
TOPSOIL	0.33					0	86.17					
Very stiff to firm, brown SILTY CLAY , trace sand						1	85.17					
	2.40					2	84.17					
Firm, grey SILTY CLAY , trace sand						3	83.17					
End of Monitoring Well (GWL @ 0.10m - May 2, 2017)	3.66											
								20	40	60	80	100
								Shear Strength (kPa)				
								▲ Undisturbed △ Remoulded				

SOIL PROFILE AND TEST DATA

Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario

DATUM Ground surface elevations provided by J.D. Barnes Limited.


FILE NO.
PG4049

REMARKS

HOLE NO.
MW 7A

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

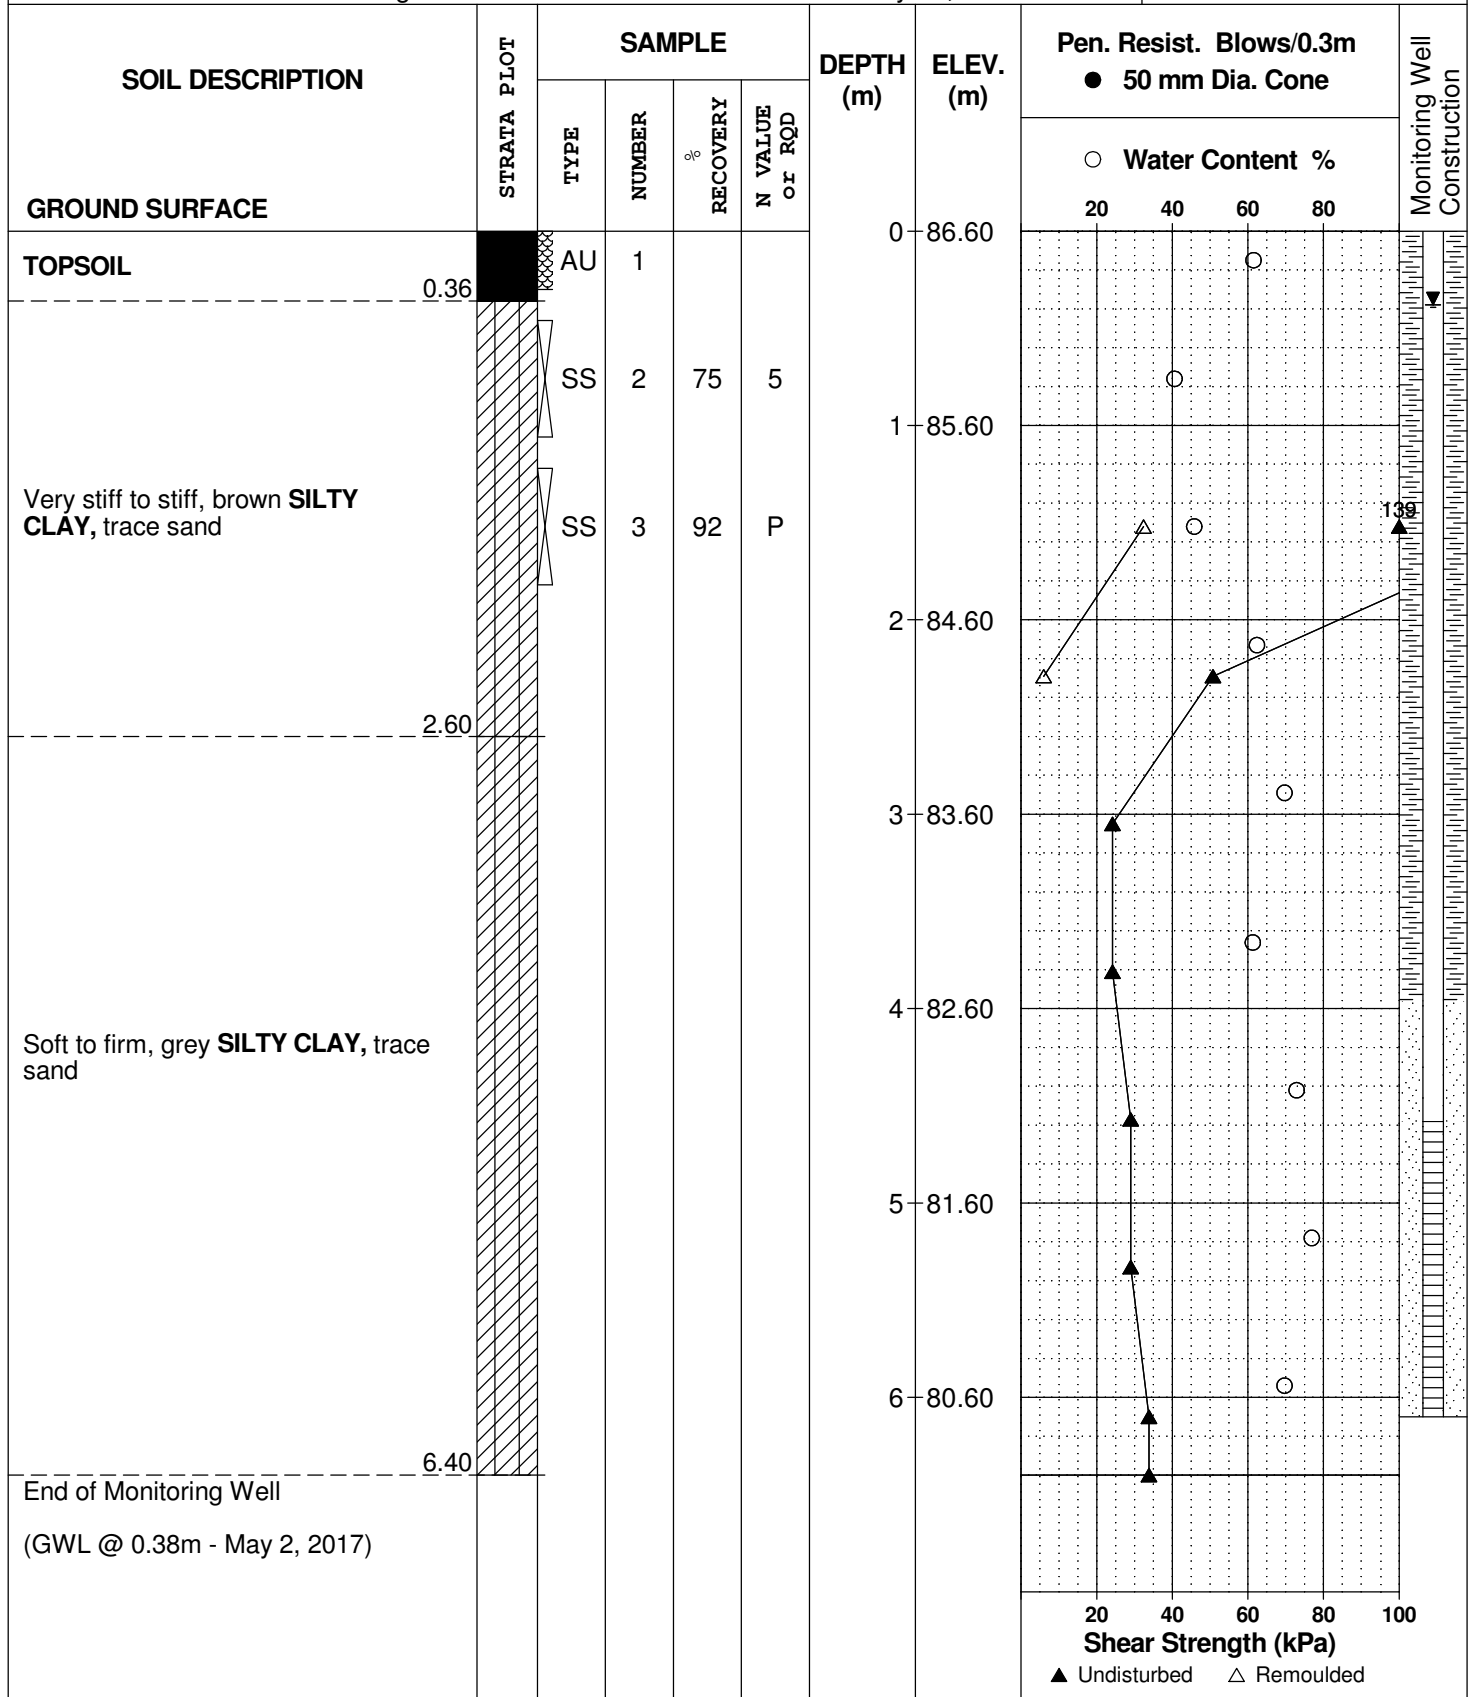

SOIL PROFILE AND TEST DATA

**Geotechnical Residential
Residential Development - Summerside West Phase 4 & 5
Tenth Line Road, Ottawa, Ontario**

DATUM Ground surface elevations provided by J.D. Barnes Limited.

FILE NO. PG4049

REMARKS

HOLE NO. **MW 7B**

BORINGS BY CME 55 Power Auger

DATE February 28, 2017

SOIL DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows/0.3m ● 50 mm Dia. Cone				Monitoring Well Construction
		TYPE	NUMBER	RECOVERY %	N VALUE or RQD			○ Water Content %				
GROUND SURFACE								20	40	60	80	
TOPSOIL	0.36					0	86.60					
Very stiff to stiff, brown SILTY CLAY , trace sand	2.60					1	85.60					
Soft to firm, grey SILTY CLAY , trace sand	3.66					2	84.60					
End of Monitoring Well (GWL @ 0.17m - May 2, 2017)						3	83.60					

SYMBOLS AND TERMS

SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

Desiccated	-	having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc.
Fissured	-	having cracks, and hence a blocky structure.
Varved	-	composed of regular alternating layers of silt and clay.
Stratified	-	composed of alternating layers of different soil types, e.g. silt and sand or silt and clay.
Well-Graded	-	Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution).
Uniformly-Graded	-	Predominantly of one grain size (see Grain Size Distribution).

The standard terminology to describe the strength of cohesionless soils is the relative density, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm.

Relative Density	'N' Value	Relative Density %
Very Loose	<4	<15
Loose	4-10	15-35
Compact	10-30	35-65
Dense	30-50	65-85
Very Dense	>50	>85

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory vane tests, penetrometer tests, unconfined compression tests, or occasionally by Standard Penetration Tests.

Consistency	Undrained Shear Strength (kPa)	'N' Value
Very Soft	<12	<2
Soft	12-25	2-4
Firm	25-50	4-8
Stiff	50-100	8-15
Very Stiff	100-200	15-30
Hard	>200	>30

SYMBOLS AND TERMS (continued)

SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their “sensitivity”. The sensitivity is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil.

Terminology used for describing soil strata based upon texture, or the proportion of individual particle sizes present is provided on the Textural Soil Classification Chart at the end of this information package.

ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NXL size core. However, it can be used on smaller core sizes, such as BX, if the bulk of the fractures caused by drilling stresses (called “mechanical breaks”) are easily distinguishable from the normal in situ fractures.

RQD %	ROCK QUALITY
90-100	Excellent, intact, very sound
75-90	Good, massive, moderately jointed or sound
50-75	Fair, blocky and seamy, fractured
25-50	Poor, shattered and very seamy or blocky, severely fractured
0-25	Very poor, crushed, very severely fractured

SAMPLE TYPES

SS	-	Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT))
TW	-	Thin wall tube or Shelby tube
PS	-	Piston sample
AU	-	Auger sample or bulk sample
WS	-	Wash sample
RC	-	Rock core sample (Core bit size AXT, BXL, etc.). Rock core samples are obtained with the use of standard diamond drilling bits.

SYMBOLS AND TERMS (continued)

GRAIN SIZE DISTRIBUTION

MC%	-	Natural moisture content or water content of sample, %
LL	-	Liquid Limit, % (water content above which soil behaves as a liquid)
PL	-	Plastic limit, % (water content above which soil behaves plastically)
PI	-	Plasticity index, % (difference between LL and PL)
D _{xx}	-	Grain size which xx% of the soil, by weight, is of finer grain sizes These grain size descriptions are not used below 0.075 mm grain size
D ₁₀	-	Grain size at which 10% of the soil is finer (effective grain size)
D ₆₀	-	Grain size at which 60% of the soil is finer
C _c	-	Concavity coefficient = $(D_{30})^2 / (D_{10} \times D_{60})$
C _u	-	Uniformity coefficient = D_{60} / D_{10}

C_c and C_u are used to assess the grading of sands and gravels:

Well-graded gravels have: $1 < C_c < 3$ and $C_u > 4$

Well-graded sands have: $1 < C_c < 3$ and $C_u > 6$

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

C_c and C_u are not applicable for the description of soils with more than 10% silt and clay
(more than 10% finer than 0.075 mm or the #200 sieve)

CONSOLIDATION TEST


p' _o	-	Present effective overburden pressure at sample depth
p' _c	-	Preconsolidation pressure of (maximum past pressure on) sample
C _{cr}	-	Recompression index (in effect at pressures below p' _c)
C _c	-	Compression index (in effect at pressures above p' _c)
OC Ratio		Overconsolidation ratio = p'_c / p'_o
Void Ratio		Initial sample void ratio = volume of voids / volume of solids
W _o	-	Initial water content (at start of consolidation test)

PERMEABILITY TEST

k	-	Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test.
---	---	--

SYMBOLS AND TERMS (continued)


STRATA PLOT




Topsoil




Asphalt




Fill




Peat




Sand




Silty Sand




Silt




Sandy Silt




Clay




Silty Clay




Clayey Silty Sand



Glacial Till



Shale




Bedrock

MONITORING WELL AND PIEZOMETER CONSTRUCTION

MONITORING WELL CONSTRUCTION



PIEZOMETER CONSTRUCTION

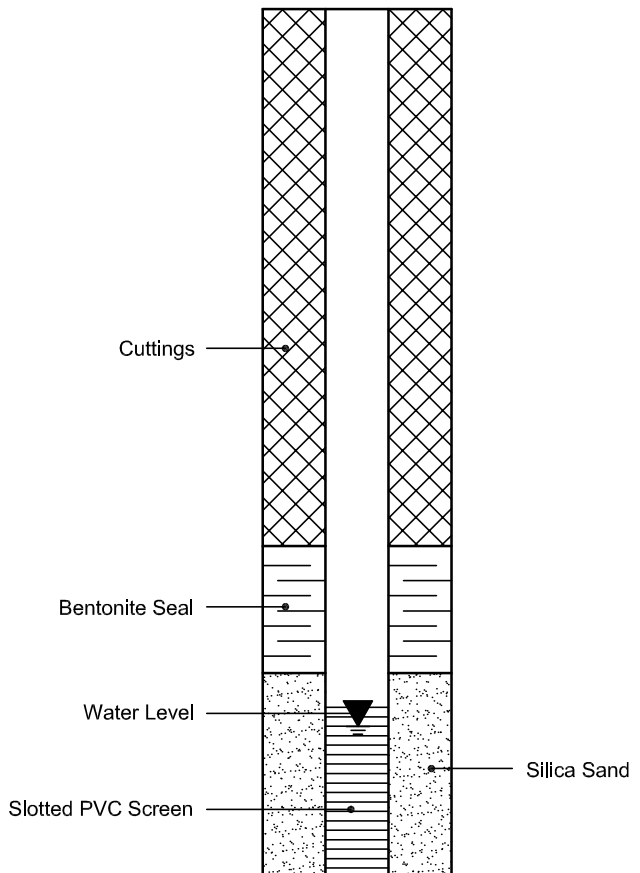

Certificate of Analysis

Client: Paterson Group Consulting Engineers

Client PO: 21693

Report Date: 07-Mar-2017

Order Date: 3-Mar-2017

Project Description: PG4049

Client ID:	MW1-SS3	-	-	-
Sample Date:	27-Feb-17	-	-	-
Sample ID:	1709440-01	-	-	-
MDL/Units	Soil	-	-	-

Physical Characteristics


% Solids	0.1 % by Wt.	69.4	-	-	-
----------	--------------	------	---	---	---

General Inorganics

pH	0.05 pH Units	7.62	-	-	-
Resistivity	0.10 Ohm.m	8.69	-	-	-

Anions

Chloride	5 ug/g dry	496	-	-	-
Sulphate	5 ug/g dry	177	-	-	-

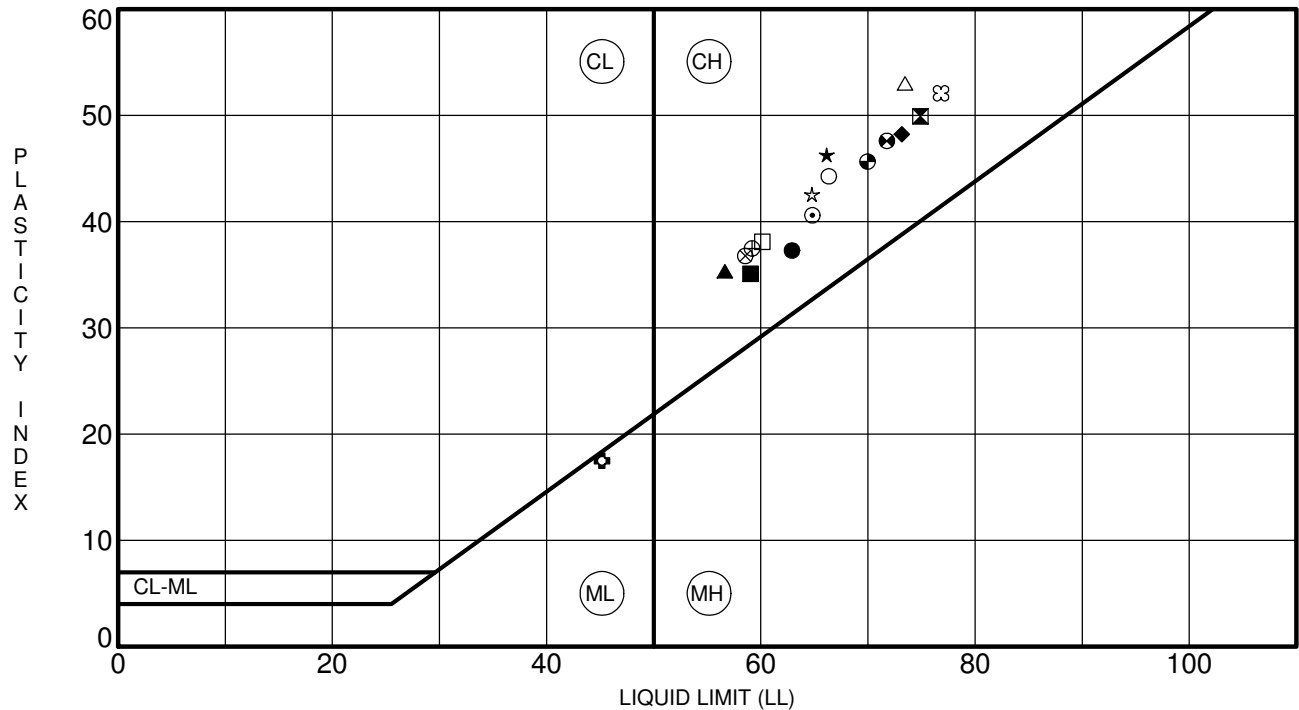

Specimen Identification	LL	PL	PI	Fines	Classification
● BH 1-18 SS 3	63	26	37		CH - Inorganic clays of high plasticity
⊠ BH 2-18 SS 2	75	25	50		CH - Inorganic clays of high plasticity
▲ BH 3-18 SS 3	57	21	35		CH - Inorganic clays of high plasticity
★ BH 4-18 SS 2	66	20	46		CH - Inorganic clays of high plasticity
⊙ BH 5-18 SS 2	65	24	41		CH - Inorganic clays of high plasticity
⊕ BH 6-18 SS 3	45	28	17		ML - Inorganic silt of low plasticity
○ BH 7-18 SS 2	66	22	44		CH - Inorganic clays of high plasticity
△ BH 8-18 SS 2	73	20	53		CH - Inorganic clays of high plasticity
⊗ BH 9-18 SS 3	59	22	37		CH - Inorganic clays of high plasticity
⊕ BH10-18 SS 2	59	22	37		CH - Inorganic clays of high plasticity
□ BH11-18 SS 3	60	22	38		CH - Inorganic clays of high plasticity
⊕ BH12-18 SS 2	72	24	48		CH - Inorganic clays of high plasticity
⊕ BH12-18 SS 3	70	24	46		CH - Inorganic clays of high plasticity
☆ BH13-18 SS 3	65	22	43		CH - Inorganic clays of high plasticity
⊗ BH14-18 SS 2	77	25	52		CH - Inorganic clays of high plasticity
■ BH15-18 SS 3	59	24	35		CH - Inorganic clays of high plasticity
◆ BH16-18 SS 2	73	25	48		CH - Inorganic clays of high plasticity

CLIENT 2447591 Ontario Inc.

PROJECT Geotechnical Residential - Residential

Development - Summerside West Ph. 4 & 5

FILE NO. PG4049


DATE 23 Feb 18

patersongroup Consulting Engineers

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

**ATTERBERG LIMITS'
RESULTS**

CLIENT:	2447591 Ontario Inc	DEPTH:	2.6' - 4.6'	FILE NO:	PG4049
CONTRACT NO.:		BH OR TP No.:	BH46-18	LAB NO:	99000
PROJECT:	Summerside West PH. 4 & 5			DATE RECEIVED:	14-Mar-18
DATE SAMPLED:	22-Feb-18			DATE TESTED:	16-Mar-18
SAMPLED BY:	Paterson Group			DATE REPORTED:	19-Mar-18
				TESTED BY:	D. Bertrand

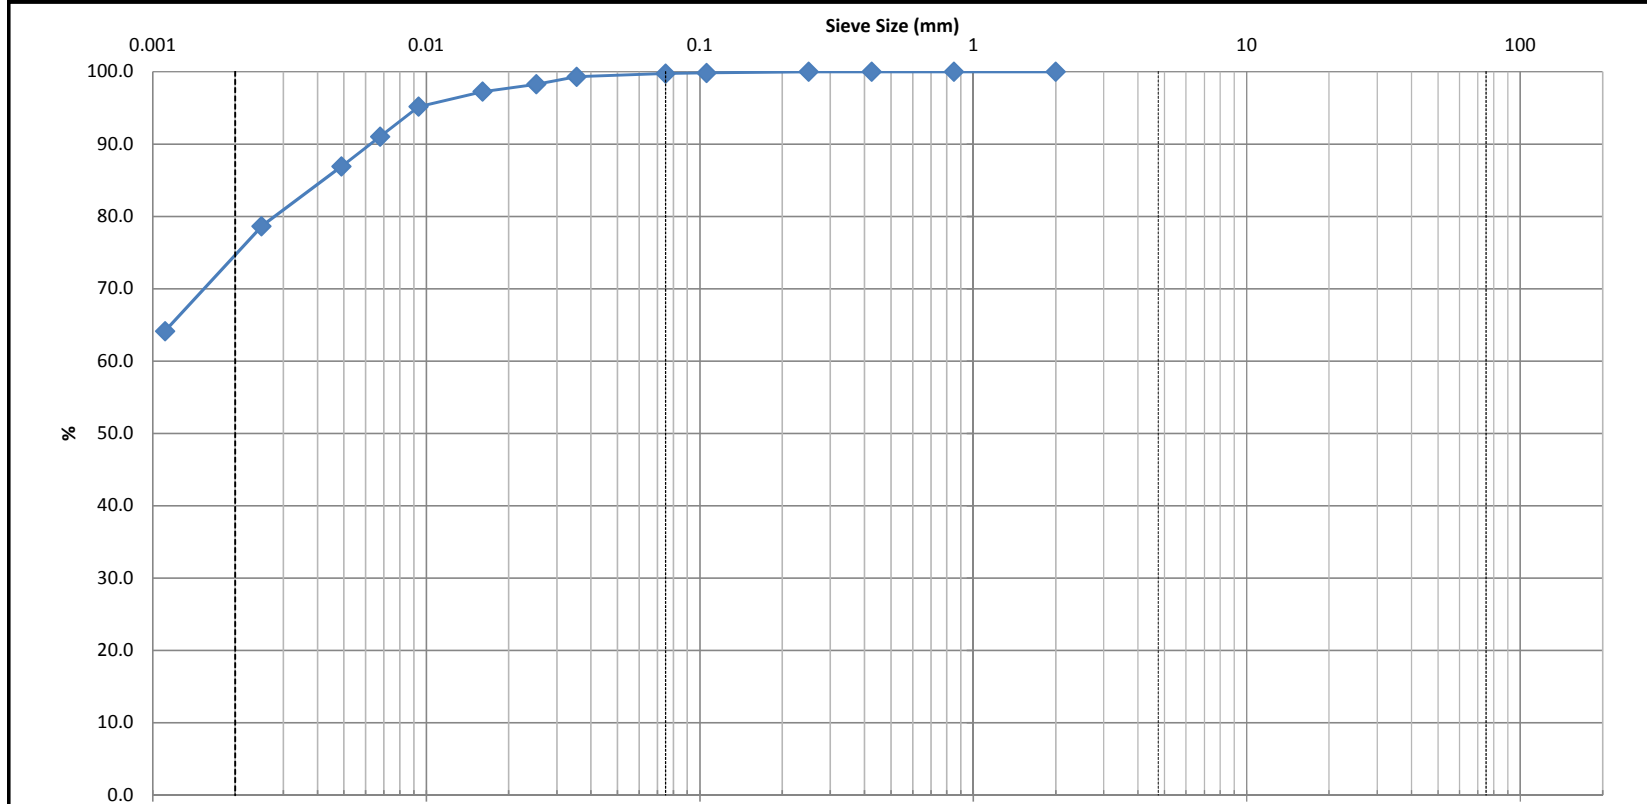

Identification	Soil Classification				MC(%)	LL	PL	PI	Cc	Cu
	D100	D60	D30	D10	Gravel (%)	Sand (%)	Silt (%)	Clay (%)		
					0.0	0.3	25.2	74.5		
Comments										

Low Risk

jeas

CLIENT:	2447591 Ontario Inc	DEPTH:	2.6' - 4.6'	FILE NO.:	PG4049
PROJECT:	Summerside West PH. 4 & 5	BH OR TP No.:	BH46-18	DATE SAMPLED:	22-Feb-18
LAB No. :	99000	TESTED BY:	D. Bertrand	DATE RECEIVED:	14-Mar-18
SAMPLED BY:	Paterson Group	DATE REPT'D:	19-Mar-18	DATE TESTED:	16-Mar-18

SAMPLE INFORMATION

SAMPLE MASS	125.1	50.02	REMARKS
SPECIFIC GRAVITY (Gs)	2.700		
HYGROSCOPIC MOISTURE	Tare No.		
TARE Wt.	50.00	ACTUAL Wt.	
AIR DRY (Wa)	150.00	100.00	
OVEN DRY (Wo)	145.55	95.55	
F=(Wo/Wa)	0.956		
INITIAL Wt. (Ma)	50.02		
Wt. CORRECTED	47.79		
Wt. AFTER WASH BACK SIEVE	0.2		
SOLUTION CONCENTRATION	40 g / L		

GRAIN SIZE ANALYSIS


SIEVE DIAMETER (mm)	WEIGHT RETAINED (g)	PERCENT RETAINED	PERCENT PASSING
63.0			
53.0			
37.5			
26.5			
19.0			
16.0			
13.2			
9.5			
4.75			
2.0	0.0	0.0	100.0
Pan	125.1		
0.850	0.00	0.0	100.0
0.425	0.00	0.0	100.0
0.250	0.00	0.0	100.0
0.106	0.08	0.2	99.8
0.075	0.13	0.3	99.7
Pan	0.20		
SIEVE CHECK	0.0	MAX = 0.3%	

HYDROMETER DATA


ELAPSED	TIME (24 hours)	Hs	Hc	Temp. (°C)	DIAMETER	(P)	TOTAL PERCENT PASSING
1	7:20	54.0	6.0	21.0	0.0355	99.3	99.3
2	7:21	53.5	6.0	21.0	0.0252	98.3	98.3
5	7:24	53.0	6.0	21.0	0.0161	97.2	97.2
15	7:34	52.0	6.0	21.0	0.0094	95.2	95.2
30	7:49	50.0	6.0	21.0	0.0068	91.0	91.0
60	8:19	48.0	6.0	21.0	0.0049	86.9	86.9
250	11:29	44.0	6.0	21.0	0.0025	78.6	78.6
1440	7:19	37.0	6.0	21.0	0.0011	64.1	64.1

COMMENTS

Moisture Content = 28.2%

REVIEWED BY:	Curtis Beadow	APPROVED BY:	Joe Forsyth, P. Eng.
			

CLIENT:	2447591 Ontario Inc	DEPTH:	15' - 16'	FILE NO:	PG4049
CONTRACT NO.:		BH OR TP No.:	BH48-18	LAB NO:	99001
PROJECT:	Summerside West PH. 4 & 5			DATE RECEIVED:	14-Mar-18
DATE SAMPLED:	23-Feb-18			DATE TESTED:	16-Mar-18
SAMPLED BY:	Paterson Group			DATE REPORTED:	19-Mar-18
				TESTED BY:	D. Bertrand

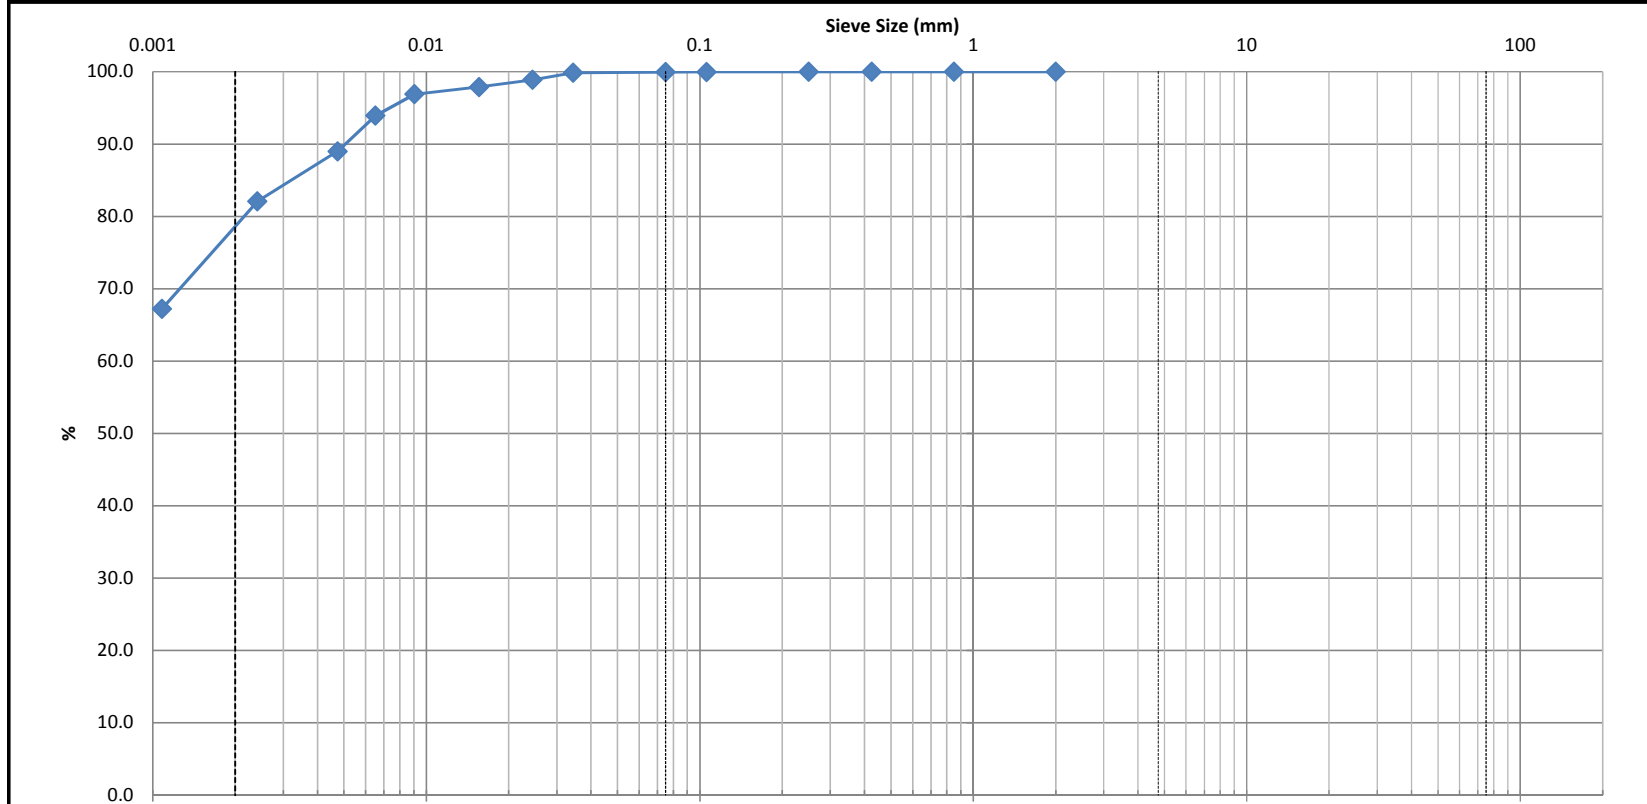

	Clay	Silt				Sand			Gravel			Cobble	
						Fine	Medium	Coarse	Fine	Coarse			
Identification	Soil Classification					MC(%)	LL	PL	PI	Cc	Cu		
						45.4							
	D100	D60	D30	D10	Gravel (%)	Sand (%)	Silt (%)	Clay (%)					
					0.0	0.1	20.9	79.0					
Comments													

Low Risk

jeff

CLIENT:	2447591 Ontario Inc	DEPTH:	15' - 16'	FILE NO.:	PG4049
PROJECT:	Summerside West PH. 4 & 5	BH OR TP No.:	BH48-18	DATE SAMPLED:	23-Feb-18
LAB No. :	99001	TESTED BY:	D. Bertrand	DATE RECEIVED:	14-Mar-18
SAMPLED BY:	Paterson Group	DATE REPT'D:	19-Mar-18	DATE TESTED:	16-Mar-18

SAMPLE INFORMATION

SAMPLE MASS	95.8	50.00	REMARKS
SPECIFIC GRAVITY (Gs)	2.700		
HYGROSCOPIC MOISTURE	Tare No.		
TARE Wt.	50.00	ACTUAL Wt.	
AIR DRY (Wa)	150.00	100.00	
OVEN DRY (Wo)	150.00	100.00	
F=(Wo/Wa)	1.000		
INITIAL Wt. (Ma)	50.00		
Wt. CORRECTED	50.00		
Wt. AFTER WASH BACK SIEVE	0.05		
SOLUTION CONCENTRATION	40 g / L		

GRAIN SIZE ANALYSIS

SIEVE DIAMETER (mm)	WEIGHT RETAINED (g)	PERCENT RETAINED	PERCENT PASSING
63.0			
53.0			
37.5			
26.5			
19.0			
16.0			
13.2			
9.5			
4.75			
2.0	0.0	0.0	100.0
Pan	95.8		
0.850	0.00	0.0	100.0
0.425	0.00	0.0	100.0
0.250	0.00	0.0	100.0
0.106	0.02	0.0	100.0
0.075	0.03	0.1	99.9
Pan	0.05		
SIEVE CHECK	0.0	MAX = 0.3%	

HYDROMETER DATA


ELAPSED	TIME (24 hours)	Hs	Hc	Temp. (°C)	DIAMETER	(P)	TOTAL PERCENT PASSING
1	7:32	56.5	6.0	21.0	0.0344	99.9	99.9
2	7:33	56.0	6.0	21.0	0.0245	98.9	98.9
5	7:36	55.5	6.0	21.0	0.0156	97.9	97.9
15	7:46	55.0	6.0	21.0	0.0091	96.9	96.9
30	8:01	53.5	6.0	21.0	0.0065	93.9	93.9
60	8:31	51.0	6.0	21.0	0.0047	89.0	89.0
250	11:41	47.5	6.0	21.0	0.0024	82.1	82.1
1440	7:31	40.0	6.0	21.0	0.0011	67.2	67.2

COMMENTS

Moisture Content = 45.4%

REVIEWED BY:	Curtis Beadow	APPROVED BY:	Joe Forsyth, P. Eng.
			

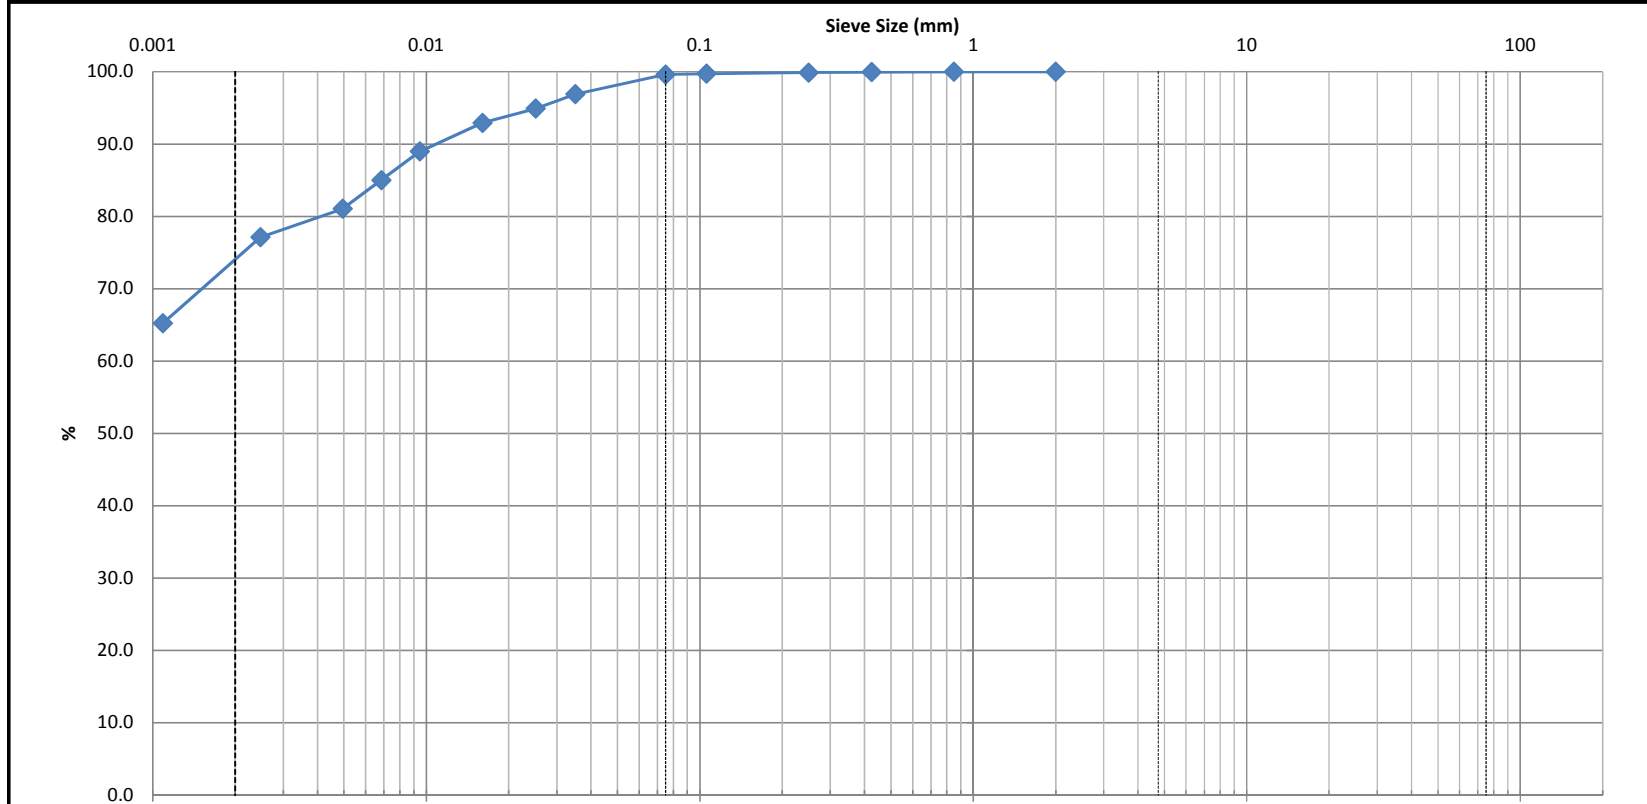


CLIENT:	2447591 Ontario Inc	DEPTH:	2.6' - 4.6'	FILE NO:	PG4049
CONTRACT NO.:		BH OR TP No.:	BH413-18	LAB NO:	99002
PROJECT:	Summerside West PH. 4 & 5			DATE RECEIVED:	14-Mar-18
DATE SAMPLED:	23-Feb-18			DATE TESTED:	16-Mar-18
SAMPLED BY:	Paterson Group			DATE REPORTED:	19-Mar-18
				TESTED BY:	D. Bertrand




Identification	Soil Classification					MC(%)	LL	PL	PI	Cc	Cu
	D100	D60	D30	D10	Gravel (%)	Sand (%)	Silt (%)	Clay (%)			
					0.0	0.4	25.1	74.5			
Comments											

Low Risk

jeff

				HYDROMETER LS-702 ASTM-422			
CLIENT:		2447591 Ontario Inc		DEPTH:		2.6' - 4.6'	
PROJECT:		Summerside West PH. 4 & 5		BH OR TP No.:		BH413-18	
LAB No. :		99002		TESTED BY:		D. Bertrand	
SAMPLED BY:		Paterson Group		DATE REPT'D:		19-Mar-18	
				DATE TESTED:		16-Mar-18	
SAMPLE INFORMATION							
SAMPLE MASS		128		50.01			
SPECIFIC GRAVITY (Gs)		2.700		REMARKS			
HYGROSCOPIC MOISTURE		Tare No.					
TARE Wt.		50.00					
AIR DRY (Wa)		150.00					
OVEN DRY (Wo)		150.00					
F=(Wo/Wa)		1.000					
INITIAL Wt. (Ma)		50.01					
Wt. CORRECTED		50.01					
Wt. AFTER WASH BACK SIEVE		0.2					
SOLUTION CONCENTRATION		40 g / L					
GRAIN SIZE ANALYSIS							
SIEVE DIAMETER (mm)		WEIGHT RETAINED (g)		PERCENT RETAINED		PERCENT PASSING	
63.0							
53.0							
37.5							
26.5							
19.0							
16.0							
13.2							
9.5							
4.75							
2.0		0.0		0.0		100.0	
Pan		128					
0.850		0.01		0.0		100.0	
0.425		0.03		0.1		99.9	
0.250		0.06		0.1		99.9	
0.106		0.14		0.3		99.7	
0.075		0.19		0.4		99.6	
Pan		0.20					
SIEVE CHECK		0.0		MAX = 0.3%			
HYDROMETER DATA							
ELAPSED	TIME (24 hours)	Hs	Hc	Temp. (°C)	DIAMETER	(P)	TOTAL PERCENT PASSING
1	7:45	55.0	6.0	21.0	0.0351	96.9	96.9
2	7:46	54.0	6.0	21.0	0.0251	94.9	94.9
5	7:49	53.0	6.0	21.0	0.0161	92.9	92.9
15	7:59	51.0	6.0	21.0	0.0095	89.0	89.0
30	8:14	49.0	6.0	21.0	0.0069	85.0	85.0
60	8:44	47.0	6.0	21.0	0.0049	81.1	81.1
250	11:54	45.0	6.0	21.0	0.0025	77.1	77.1
1440	7:44	39.0	6.0	21.0	0.0011	65.2	65.2
COMMENTS							
Moisture Content = 27.1%							
REVIEWED BY:	Curtis Beadow			APPROVED BY:	Joe Forsyth, P. Eng.		
							

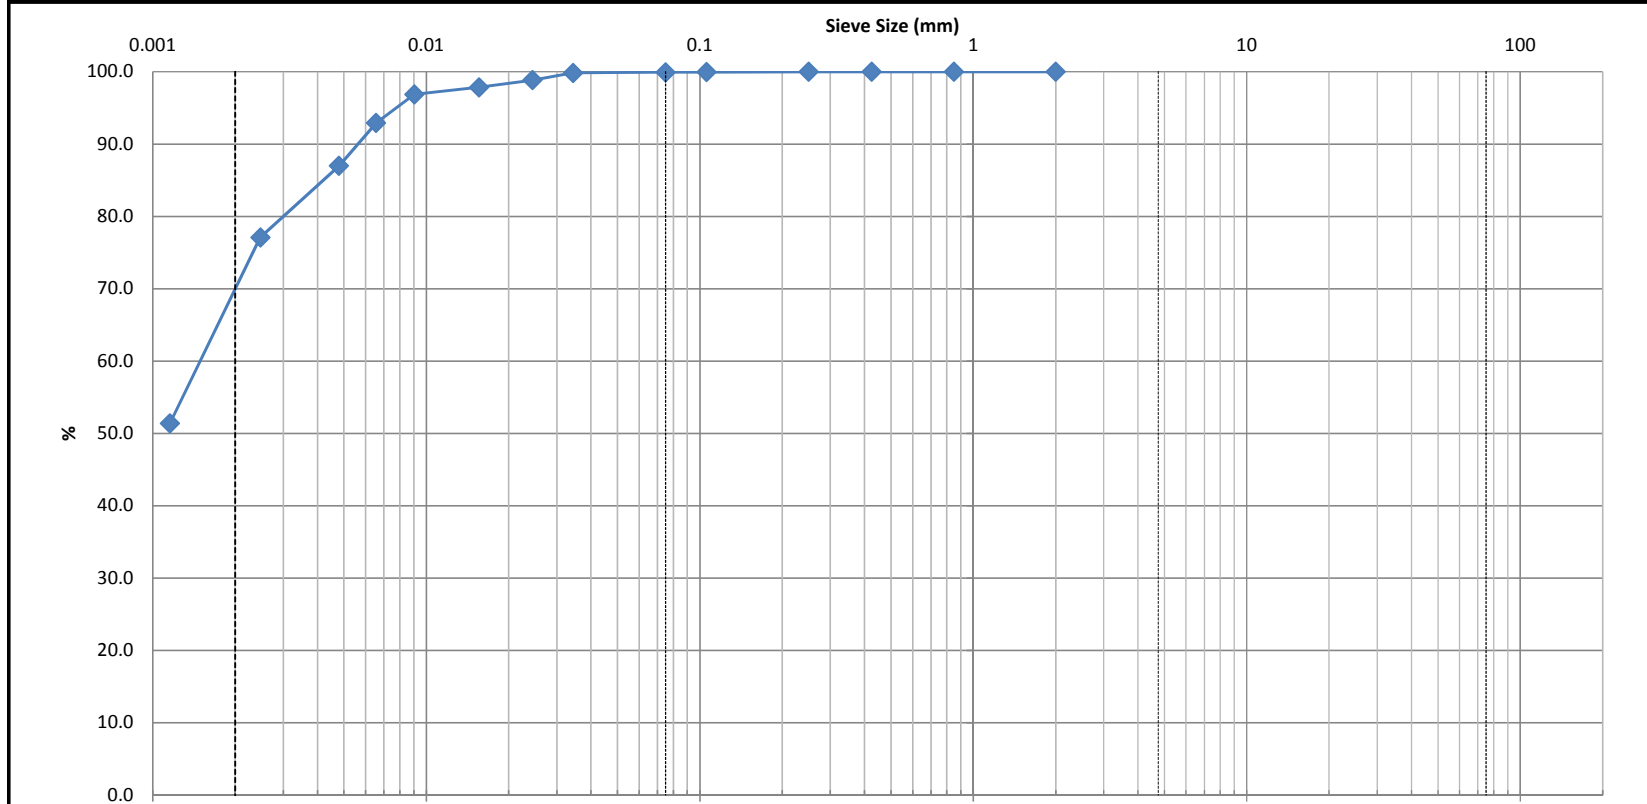


CLIENT:	2447591 Ontario Inc	DEPTH:	10' - 11'	FILE NO:	PG4049
CONTRACT NO.:		BH OR TP No.:	BH416-18	LAB NO:	99003
PROJECT:	Summerside West PH. 4 & 5			DATE RECEIVED:	14-Mar-18
DATE SAMPLED:	23-Feb-18			DATE TESTED:	16-Mar-18
SAMPLED BY:	Paterson Group			DATE REPORTED:	19-Mar-18
				TESTED BY:	D. Bertrand



Identification	Soil Classification				MC(%)	LL	PL	PI	Cc	Cu
	D100	D60	D30	D10	Gravel (%)	Sand (%)	Silt (%)	Clay (%)		
					0.0	0.1	30.4	69.5		
Comments										

Low Risk

jeas

				HYDROMETER LS-702 ASTM-422			
CLIENT:		2447591 Ontario Inc		DEPTH:		10' - 11'	
PROJECT:		Summerside West PH. 4 & 5		BH OR TP No.:		BH416-18	
LAB No. :		99003		TESTED BY:		D. Bertrand	
SAMPLED BY:		Paterson Group		DATE REPT'D:		19-Mar-18	
				DATE TESTED:		16-Mar-18	
SAMPLE INFORMATION							
SAMPLE MASS		107.1		50.02			
SPECIFIC GRAVITY (Gs)		2.700		REMARKS			
HYGROSCOPIC MOISTURE		Tare No.					
TARE Wt.		50.00					
AIR DRY (Wa)		150.00					
OVEN DRY (Wo)		150.00					
F=(Wo/Wa)		1.000					
INITIAL Wt. (Ma)		50.02					
Wt. CORRECTED		50.02					
Wt. AFTER WASH BACK SIEVE		0.07					
SOLUTION CONCENTRATION		40 g / L					
GRAIN SIZE ANALYSIS							
SIEVE DIAMETER (mm)		WEIGHT RETAINED (g)		PERCENT RETAINED		PERCENT PASSING	
63.0							
53.0							
37.5							
26.5							
19.0							
16.0							
13.2							
9.5							
4.75							
2.0		0.0		0.0		100.0	
Pan		107.1					
0.850		0.00		0.0		100.0	
0.425		0.01		0.0		100.0	
0.250		0.01		0.0		100.0	
0.106		0.03		0.1		99.9	
0.075		0.04		0.1		99.9	
Pan		0.07					
SIEVE CHECK		0.0		MAX = 0.3%			
HYDROMETER DATA							
ELAPSED	TIME (24 hours)	Hs	Hc	Temp. (°C)	DIAMETER	(P)	TOTAL PERCENT PASSING
1	7:56	56.5	6.0	21.0	0.0344	99.8	99.8
2	7:57	56.0	6.0	21.0	0.0245	98.8	98.8
5	8:00	55.5	6.0	21.0	0.0156	97.9	97.9
15	8:10	55.0	6.0	21.0	0.0091	96.9	96.9
30	8:25	53.0	6.0	21.0	0.0066	92.9	92.9
60	8:55	50.0	6.0	21.0	0.0048	87.0	87.0
250	12:05	45.0	6.0	21.0	0.0025	77.1	77.1
1440	7:55	32.0	6.0	21.0	0.0012	51.4	51.4
COMMENTS							
Moisture Content = 41.1%							
REVIEWED BY:	Curtis Beadow			APPROVED BY:	Joe Forsyth, P. Eng.		
							

APPENDIX 2

FIGURE 1 - KEY PLAN

FIGURE 2 - TEST FILL SETTLEMENT MONITORING PROGRAM


DRAWING PG4049-1 - TEST HOLE LOCATION PLAN


DRAWING PG4049-3 - TREE PLANTING SETBACK RECOMMENDATIONS



FIGURE 1
KEY PLAN

**Figure 2 - Test Fill Pile Settlement Monitoring Program
Summerside West - Phases 4, 5 and 6 - Mer Bleue Road**

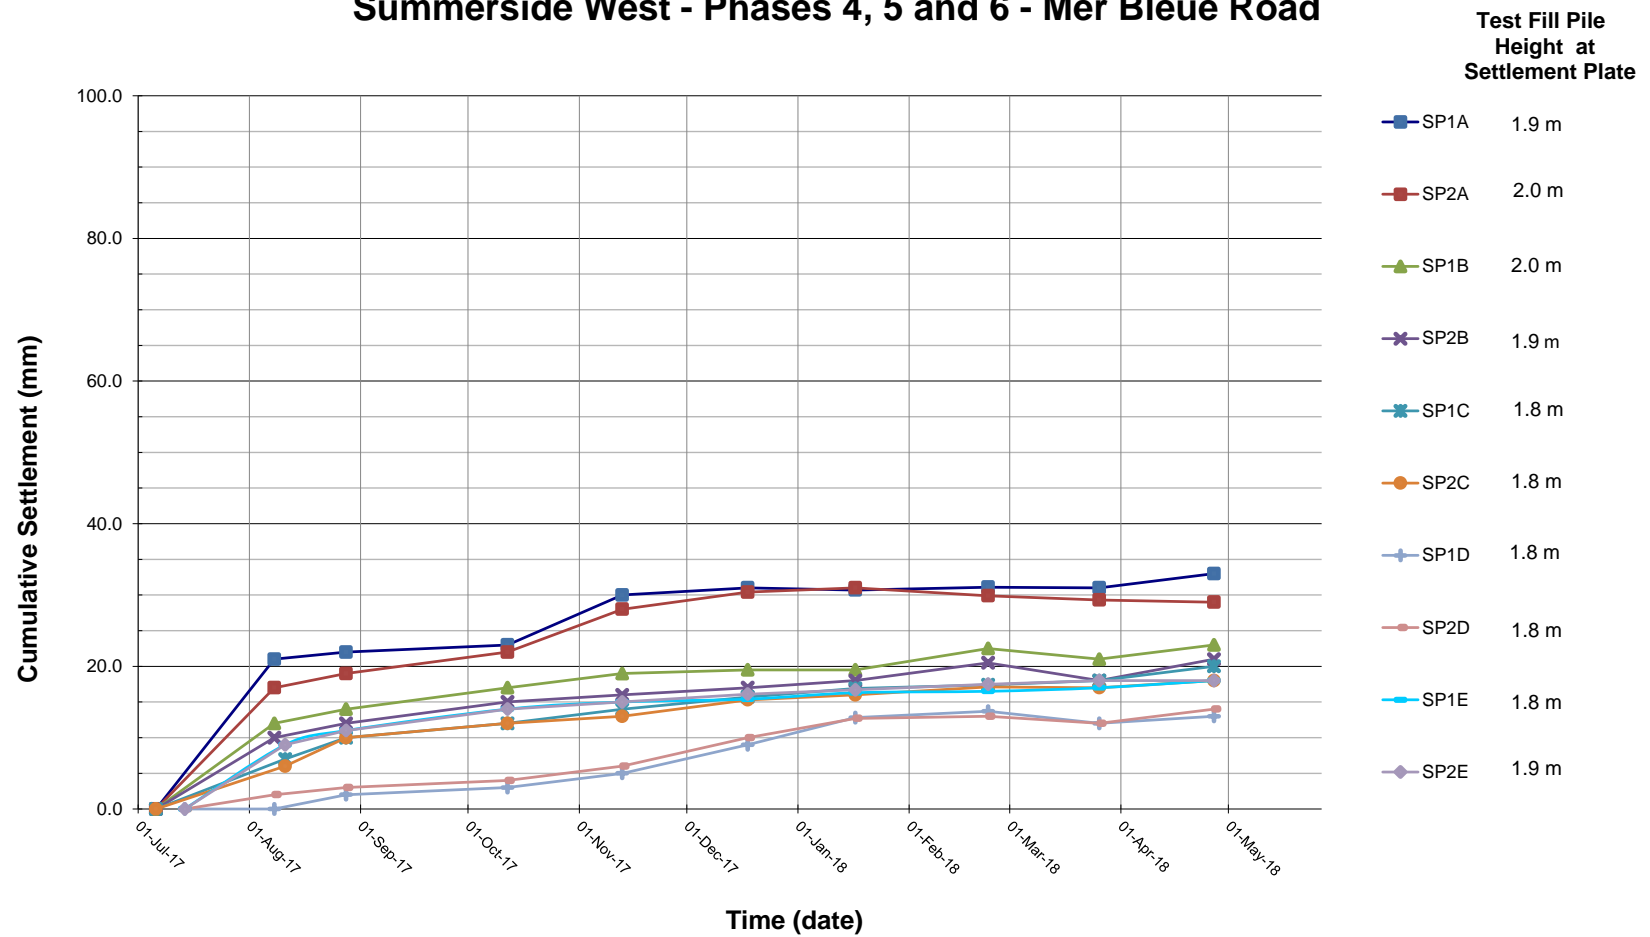

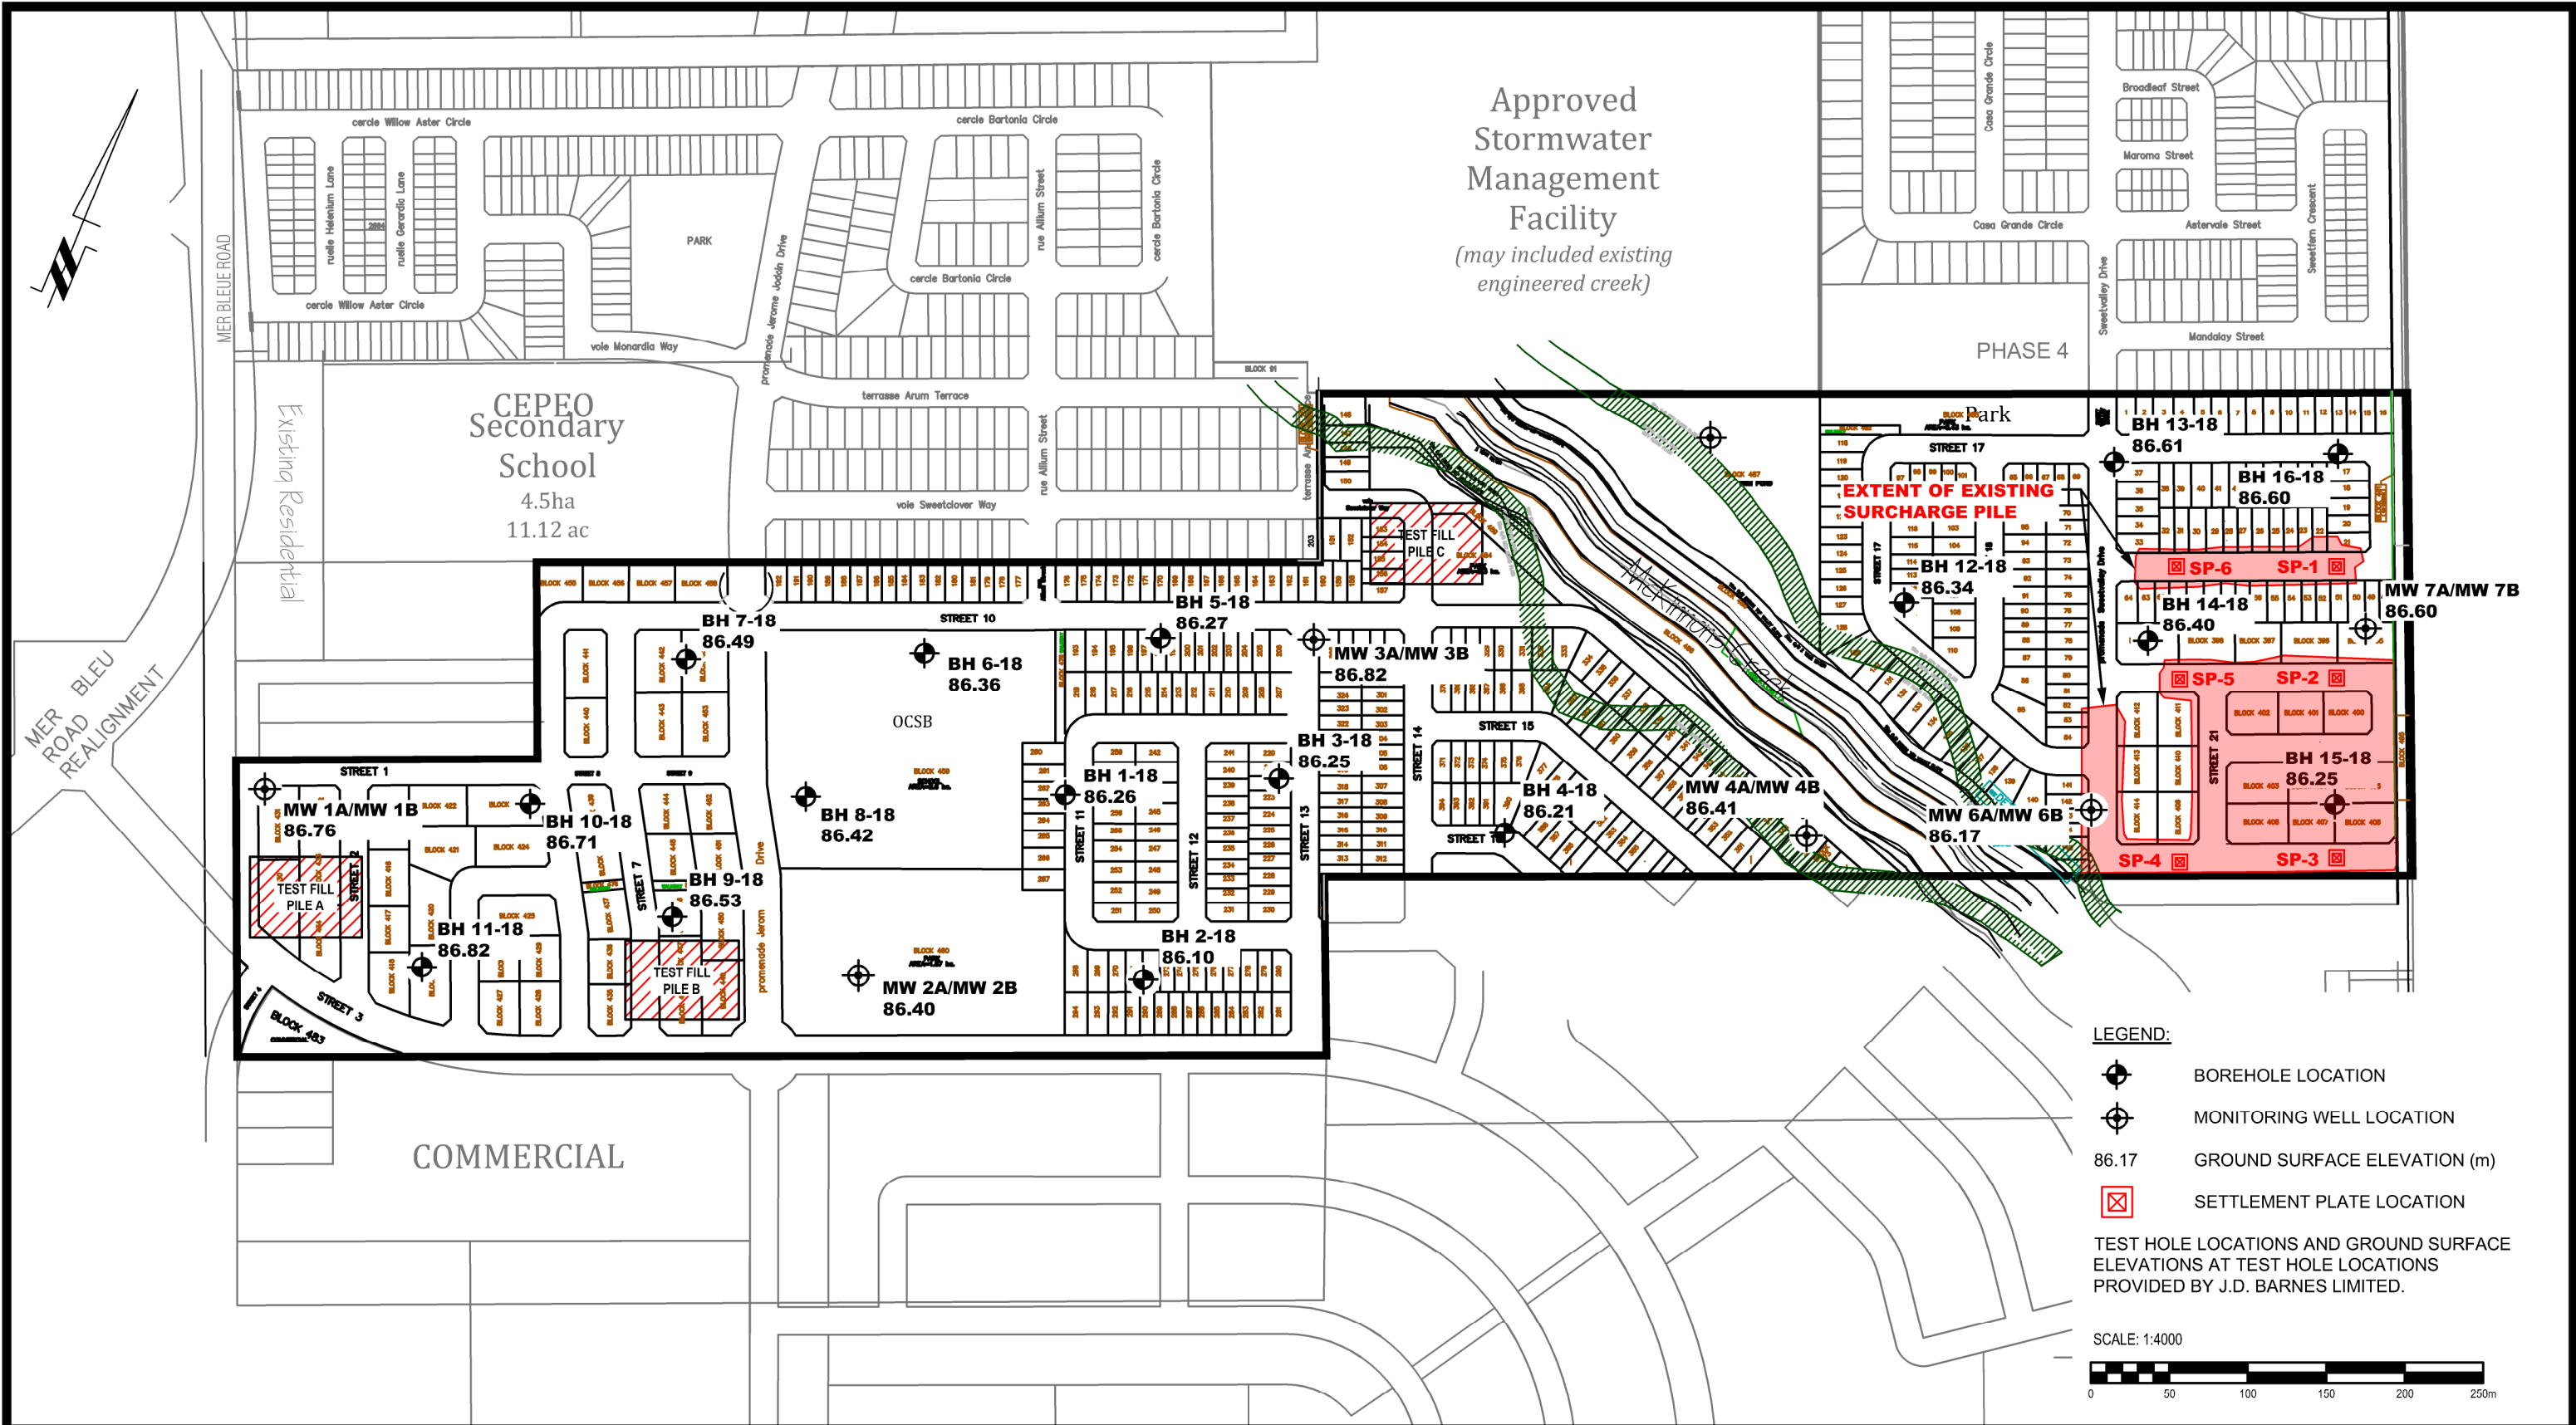

patersongroup
consulting engineers

154 Colonnade Road South
Ottawa, Ontario K2E 7J5
Tel: (613) 226-7381 Fax: (613) 226-6344

1	NEW SURCHARGE PILE AND SETTLEMENT PLATES ADDED	08/08/2018	DJG
NO.	REVISIONS	DATE	INITIAL

2447591 ONTARIO INC.	
GEOTECHNICAL INVESTIGATION	
RESIDENTIAL DEVELOPMENT - SUMMERSIDE WEST PHASES 4 & 5	
OTTAWA,	ONTARIO
Title: TEST HOLE LOCATION PLAN	

Scale:	1:4000	Date:	03/2018
Drawn by:	MPG	Report No.:	PG4049
Checked by:	SB	Dwg. No.:	PG4049-1
Approved by:	DJG	Revision No.:	1

p:\aioacad drawings\geotechnical\pg4049\pg4049-1 rev1 with surcharge pile (new plan).dwg

