Geotechnical Engineering

Environmental Engineering

Hydrogeology

Geological Engineering

Materials Testing

Building Science

Archaeological Services

patersongroup

Geotechnical Investigation

Proposed Residential Development The Meadows - Phase 5 Cambrian Road - Ottawa

Prepared For

Tamarack (Nepean) Corporation

Paterson Group Inc.

Consulting Engineers 154 Colonnade Road South Ottawa (Nepean), Ontario Canada K2E 7J5

Tel: (613) 226-7381 Fax: (613) 226-6344 www.patersongroup.ca March 16, 2018

Report: PG4242-1 Revision 1



Table of Contents

| | | | Page |
|-----|-------|----------------------------------|------|
| 1.0 | Intro | oduction | 1 |
| 2.0 | Prop | oosed Development | 1 |
| 3.0 | Meth | nod of Investigation | |
| | 3.1 | Field Investigation | 2 |
| | 3.2 | Field Survey | |
| | 3.3 | Laboratory Testing | 4 |
| | 3.4 | Analytical Testing | 4 |
| 2.0 | Obse | ervations | |
| | 4.1 | Surface Conditions | 5 |
| | 4.2 | Subsurface Profile | 5 |
| | 4.3 | Groundwater | 6 |
| 5.0 | Disc | eussion | |
| | 5.1 | Geotechnical Assessment | 7 |
| | 5.2 | Site Grading and Preparation | 7 |
| | 5.3 | Foundation Design | |
| | 5.4 | Design of Earthquakes | |
| | 5.5 | Basement Slab | |
| | 5.6 | Pavement Structure | 11 |
| 6.0 | Desi | ign and Construction Precautions | |
| | 6.1 | Foundation Drainage and Backfill | 14 |
| | 6.2 | Protection Against Frost Action | |
| | 6.3 | Excavation Side Slopes | |
| | 6.4 | Pipe Bedding and Backfill | |
| | 6.5 | Groundwater Control | |
| | 6.6 | Winter Construction | |
| | 6.7 | Landscaping Considerations | |
| | 6.8 | Corrosion Potential and Sulphate | 21 |
| 7.0 | Reco | ommendations | 22 |
| 8.0 | State | ement of Limitations | 23 |



Appendices

Appendix 1 Soil Profile and Test Data Sheets

Symbols and Terms

Grain Size Distribution Sheets

Atterberg Limit Testing Analytical Testing Results

Appendix 2 Figure 1 - Key Plan

Drawing PG4242-1 - Test Hole Location Plan

Drawing PG4242-2 - Permissible Grade Raise Areas - Housing Drawing PG4242-3 - Tree Planting Setback Recommendations



1.0 Introduction

Paterson Group (Paterson) was commissioned by Tamarack (Nepean) Corporation to conduct a geotechnical investigation for Phase 5 of The Meadows residential development located between Borrisokane Road and Grand Canal Street, in the City of Ottawa (refer to Figure 1 - Key Plan presv ented in Appendix 2).

The objective of the investigation was to:

| 」 | determine | the s | ubsoil an | d gro | oundwa | ter conditior | is at | this | site | by | means of |
|----------|------------|--------|------------|-------|--------|---------------|-------|------|------|-----|----------|
| | boreholes | and | relevant | test | holes | completed | as | part | of | the | previous |
| | geotechnic | al inv | estigation | | | | | | | | |

provide geotechnical recommendations for the design of the proposed development based on the results of the boreholes and other soil information available. These recommendations include permissible grade raises, long term settlements and other construction considerations which may affect the design.

The following report has been prepared specifically and solely for the aforementioned project which is described herein. The report contains our findings and includes geotechnical recommendations pertaining to the design and construction of the proposed development as understood at the time of this report.

Investigating the presence or potential presence of contamination on the proposed development was not part of the scope of work. Therefore, the present report does not address environmental issues.

2.0 Proposed Development

It is understood that the current phase of the proposed development will consist of townhouses, residential dwellings with attached garages, associated driveways, local roadways and landscaping areas.

It is further understood that the proposed development will be serviced by future municipal water, sanitary and storm services.

Page 1



3.0 Method of Investigation

3.1 Field Investigation

The field program for the current investigation was carried out between January 8 to 10, 2018. At that time, a total of three (3) boreholes and seven (7) test pits were placed in a manner to provide general coverage of the subject site taking into consideration site features, underground utilities and existing test holes completed during the previous investigations. The location of the test holes are presented on Drawing PG4242-1 - Test Hole Location Plan included in Appendix 2.

Several previous field programs were also carried out within the subject site by Paterson between 2004 and 2009. A total of 4 boreholes and 13 test pits were completed as part of our previous investigations. The relevant test hole logs from the previous investigations are presented in Appendix 1.

The boreholes were completed using a track-mounted auger drill rig operated by a two person crew and the test pits were completed using a hydraulic excavator. All fieldwork was conducted under the full-time supervision of Paterson personnel under the direction of a senior engineer from the geotechnical division. The testing procedure consisted of augering/excavating to the required depths and at the selected test hole locations sampling and testing the overburden.

Sampling and In Situ Testing

Soil samples were collected from the boreholes using a 50 mm diameter split-spoon (SS) sampler, 73 mm diameter thin walled (TW) Shelby tubes in conjunction with a piston sampler or from the auger flights. Grab samples were taken from the test pit locations (G). All soil samples were visually inspected and initially classified on site. The split-spoon samples were placed in sealed plastic bags and the Shelby tubes were sealed at both ends on site. All samples were transported to our laboratory for examination and classification. The depths at which the split-spoon, Shelby tube, auger and grab samples were recovered from the test holes are shown as SS, TW, AU and G respectively, on the Soil Profile and Test Data sheets presented in Appendix 1.

The Standard Penetration Test (SPT) was conducted in conjunction with the recovery of the split-spoon samples. The SPT results are recorded as "N" values on the Soil Profile and Test Data sheets. The "N" value is the number of blows required to drive the split-spoon sampler 300 mm into the soil after a 150 mm initial penetration using a 63.5 kg hammer falling from a height of 760 mm.

Report: PG4242-1 Revision 1





Undrained shear strength testing was conducted in cohesive soils using a field vane apparatus.

The thickness of the overburden was evaluated by a dynamic cone penetration testing (DCPT) completed at BH 2. The DCPT consists of driving a steel drill rod, equipped with a 50 mm diameter cone at the tip, using a 63.5 kg hammer falling from a height of 760 mm. The number of blows required to drive the cone into the soil is recorded for each 300 mm increment.

The subsurface conditions observed at the test hole locations were recorded in detail in the field. Our findings are presented in the Soil Profile and Test Data sheets in Appendix 1.

Groundwater Monitoring

51 mm diameter PVC groundwater monitoring well was installed at BH 2 to permit monitoring of the groundwater levels subsequent to the completion of the sampling program.

Monitoring Well Installation

Typical monitoring well construction details are described below:

| aforementioned |
|-----------------|
| |
| n to the ground |
| |
| |
| ve PVC slotted |
| |
| |
| וו |

The remainder of the boreholes (BH 1 and BH 3) were instrumented with flexible standpipes to monitor the groundwater level subsequent to the completion of the sampling program.

The groundwater observations are discussed in Subsection 4.3 and presented in the Soil Profile and Test Data sheets presented in Appendix 1.



Sample Storage

All samples will be stored in the laboratory for a period of one month after issuance of the report. They will then be discarded unless we are otherwise directed.

3.2 Field Survey

The test hole locations and ground surface elevations at the test hole locations completed during the current investigation were provided by Stantec Geomatics Ltd. It is understood that the ground surface elevations are referenced to a geodetic datum.

The test hole locations and ground surface elevations at the test hole locations are presented on Drawing PG4242-1 - Test Hole Location Plan in Appendix 2.

3.3 Laboratory Testing

The soil samples recovered from the subject site were examined in our laboratory to review the results of the field logging.

A total of 21 soil samples collected from the test holes during the current investigation were submitted for moisture contents.

A total of two (2) soil samples were selected for Atterberg Limits Testing to determine their modified plasticity index. The results of the testing are given in the Atterberg Limits Results in Appendix 1.

A total of two (2) soil samples collected from the test holes during the previous investigation were submitted for grain size distribution analysis. The relevant grain size distribution analyses testing results are presented in Appendix 1.

3.4 Analytical Testing

One (1) soil sample was submitted for analytical testing to assess the corrosion potential for exposed ferrous metals and the potential of sulphate attacks against subsurface concrete structures. The sample was submitted to determine the concentration of sulphate and chloride, the resistivity and the pH of the sample. The results are presented in Appendix 1 and are discussed further in Subsection 6.8.

Page 4



4.0 Observations

4.1 Surface Conditions

Currently, the subject site is a treed forest. One section of the west portion of the site has been cleared and is possibly being used as a snow dump area. Various fill piles, as well as scattered construction debris are located within this section of the site.

A large berm is located along the south perimeter of the site, between the subject site and the adjacent property. An elevated ridge is also located through the centre of the property running east-west prior to dropping down towards the section of the site which has been cleared as noted above.

The site is bordered to the north and west by additional treed areas followed by Cambrian road and Borrisokane Road, respectively. The site is bordered to the east by the on-going surcharge program for Phase 4 of the subject residential development, and to the south by a sand pit operation.

4.2 Subsurface Profile

Generally, the soil conditions encountered at the test hole locations consist of a thin layer of topsoil/organic layer followed by a layer of silty sand overlying either a sensitive silty clay deposit or a compact to dense glacial till and/or a loose, brown silty fine sand.

Practical refusal to DCPT was encountered at 8.2 m below existing ground surface on an inferred boulder at BH 2.

Based on available geological mapping, dolomite of the Oxford formation is present in this area with an overburden drift thickness ranging between 15 to 25 m.

Reference should be made to the Soil Profile and Test Data sheets in Appendix 1 for specific details of the soil profiles encountered at each test hole location.

Report: PG4242-1 Revision 1



4.3 Groundwater

The groundwater levels in the boreholes from the current and previous geotechnical investigations are presented in Tables 1 and 2 below. It is important to note that groundwater readings at piezometers can be influenced by surface water perched within the borehole backfill material. Long-term groundwater level can also be estimated based on the observed colour and consistency of the recovered soil samples. Groundwater levels are subject to seasonal fluctuations and therefore could vary during time of construction.

| Table 1 - Summary of Groundwater Level Readings | | | | | | | | | |
|---|---------------|-------|-----------|------------------|--|--|--|--|--|
| Borehole Ground Groundwater Levels (m) | | | | | | | | | |
| Number | Elevation (m) | Depth | Elevation | Recording Date | | | | | |
| BH 1 | 93.78 | 3.15 | 90.63 | January 15, 2018 | | | | | |
| BH 2 * | 97.02 | 0.20 | 96.82 | January 15, 2018 | | | | | |
| BH 3 | 96.64 | 0.30 | 96.94 | January 15, 2018 | | | | | |

Note:

Denotes boreholes instrumented with monitoring wells.

| Table 2 - Summary of Groundwater Level Readings - Previous Geotechnical Investigations | | | | | | | | | |
|--|---------------|-------|-----------|------------------|--|--|--|--|--|
| Borehole Ground Groundwater Levels (m) | | | | | | | | | |
| Number | Elevation (m) | Depth | Elevation | Recording Date | | | | | |
| BH 4-09 | 93.44 | 1.50 | 91.94 | January 15, 2018 | | | | | |
| BH 5-09 | 93.35 | 0.60 | 92.75 | March 11, 2009 | | | | | |
| BH 6-09 | 94.00 | 0.70 | 94.70 | March 11, 2009 | | | | | |
| BH 3 | 94.97 | 1.20 | 93.77 | May 1, 2004 | | | | | |

Report: PG4242-1 Revision 1 March 16, 2018

Page 6



5.0 Discussion

5.1 Geotechnical Assessment

It is anticipated that the proposed buildings will be supported by shallow footings placed over stiff to firm silty clay, loose to compact silty sand or compact to dense glacial till bearing surface. However, due to the presence of the sensitive silty clay layer, the proposed development will be subjected to grade raise restrictions.

Permissible grade raise recommendations are discussed in Subsection 5.3 and recommended permissible grade raise areas are presented in Drawing PG4242-2-Permissible Grade Raise Areas - Housing in Appendix 2. If higher than permissible grade raises are required, preloading with or without a surcharge, lightweight fill and/or other measures should be investigated to reduce the risks of unacceptable long-term post construction total and differential settlements.

The above and other considerations are further discussed in the following sections.

5.2 Site Grading and Preparation

Stripping Depth

Topsoil and deleterious fill, such as those containing organic materials, should be stripped from under any buildings, paved areas, pipe bedding and other settlement sensitive structures.

Fill Placement

Fill used for grading beneath the proposed building areas should consist, unless otherwise specified, of clean imported granular fill, such as Ontario Provincial Standard Specifications (OPSS) Granular A or Granular B Type II. The fill should be placed in lifts of 300 mm thick or less and compacted using suitable compaction equipment for the lift thickness. Fill placed beneath the building areas should be compacted to at least 98% of the Standard Proctor Maximum Dry Density (SPMDD).

Report: PG4242-1 Revision 1



Non-specified existing fill along with site-excavated soil can be used as general landscaping fill where settlement of the ground surface is of minor concern. These materials should be spread in thin lifts and at least compacted by the tracks of the spreading equipment to minimize voids. If excavated brown silty clay or silty sand, free of organics and deleterious materials, is to be used to build up the subgrade level for areas to be paved, it is recommended that the material be placed under dry conditions and in above freezing temperatures, compacted in thin lifts using a suitable compaction equipment for the lift thickness by making several passes and approved by the geotechnical consultant. Non-specified existing fill and site-excavated soils are not suitable for use as backfill against foundation walls unless a composite drainage blanket connected to a perimeter drainage system is provided.

Protection of Subgrade and Bearing Surfaces

It is expected that site grading and preparation will consist of stripping of the soils containing significant amounts of organic materials. The contractor should take appropriate precautions to avoid disturbing the subgrade and bearing surfaces from construction and worker traffic. Disturbance of the subgrade may result in having to sub-excavate the disturbed material and the placement of additional fill.


5.3 Foundation Design

Bearing Resistance Values

Using continuously applied loads, footings for the proposed buildings can be designed using the bearing resistance values presented in Table 3.

| Table 3 - Bearing Resistance Values | | | | | | | |
|-------------------------------------|---------------------------------------|--|--|--|--|--|--|
| Bearing Surface | Bearing Resistance Value at SLS (kPa) | Factored Bearing Resistance Value at ULS (kPa) | | | | | |
| Compact to Dense Glacial Till | 200 | 350 | | | | | |
| Stiff Silty Clay | 100 | 150 | | | | | |
| Compact Silty Sand | 60 | 125 | | | | | |
| Firm Silty Clay | 60 | 125 | | | | | |

Note: Strip footings, up to 2 m wide, and pad footings, up to 4 m wide, placed over a silty clay bearing surface can be designed using the above noted bearing resistance values.





The bearing resistance values are provided on the assumption that the footings will be placed on undisturbed soil bearing surfaces. An undisturbed soil bearing surface consists of one from which all topsoil and deleterious materials, such as loose, frozen or disturbed soil, whether in situ or not, have been removed, in the dry, prior to the placement of concrete for footings.

Bearing resistance values for footing design should be determined on a per lot basis at the time of construction.

It should be noted that if the silty sand layer is noted to be in a loose state of compactness at the subgrade level. It is recommended to proof roll the silty sand layer under dry conditions. Additionally, the subgrade should be inspected by a geotechnical consultant at the time of construction.

Lateral Support


The bearing medium under footing-supported structures is required to be provided with adequate lateral support with respect to excavations and different foundation levels. Adequate lateral support is provided to the in-situ bearing medium soils above the groundwater table when a plane extending down and out from the bottom edge of the footing at a minimum of 1.5H:1V passes only through in situ soil of the same or higher capacity as the bearing medium soil.

Settlement/Grade Raise

Consideration must be given to potential settlements which could occur due to the presence of the silty clay deposit and the combined loads from the proposed footings, any groundwater lowering effects, and grade raise fill. The foundation loads to be considered for the settlement case are the continuously applied loads which consist of the unfactored dead loads and the portion of the unfactored live load that is considered to be continuously applied. For dwellings, a minimum value of 50% of the live load is recommended by Paterson.

Based on the undrained shear strength values at the borehole locations, we have determined our permissible grade raise recommendations for the current phase of the proposed development. Our permissible grade raise recommendations for housing are presented in Drawing PG4242-2 - Permissible Grade Raise Areas - Housing in Appendix 2. It should be noted that our permissible grade raise recommendations for the roadways can be taken as the permissible grade raise values presented in Drawing PG4242-2 increased by 0.4 m at each area.

Report: PG4242-1 Revision 1





Based on the above discussion, several options could be considered to accommodate proposed grade raises with respect to our permissible grade raise recommendations, such as, the use of lightweight fill, which allow for raising the grade without adding a significant load to the underlying soils. Alternatively, it is possible to preload or surcharge the subject site in localized areas provided sufficient time is available to achieve the desired settlements. A test fill pile monitoring program could also be completed to permit further assessment of the permissible grade raises.

The total and differential settlements will be dependent on characteristics of the proposed buildings. For design purposes, the total and differential settlements are estimated to be 25 and 20 mm, respectively. A post-development groundwater lowering of 0.5 m was assumed.

The potential post construction total and differential settlements are dependent on the position of the long term groundwater level when buildings are situated over deposits of compressible silty clay. Efforts can be made to reduce the impacts of the proposed development on the long term groundwater level by placing clay dykes in the service trenches, reducing the sizes of paved areas, leaving green spaces to allow for groundwater recharge or limiting planting of trees to areas away from the buildings. However, it is not economically possible to control the groundwater level.

To reduce potential long term liabilities, consideration should be given to accounting for a larger groundwater lowering and to provide means to reduce long term groundwater lowering (e.g. clay dykes, restriction on planting around the dwellings, etc). Building on silty clay deposits increases the likelihood of movements and therefore of cracking. The use of steel reinforcement in foundations placed at key structural locations will tend to reduce foundation cracking compared to unreinforced foundations.

Underground Utilities

The underground services may be subjected to unacceptable total or differential settlements. In particular, the joints at the interface building/soil may be subjected to excessive stress if the differential settlements between the building and the services are excessive. This should be considered in the design of the underground services.

Once the required grade raises are established, the above options could be further discussed along with further recommendations on specific requirements.



5.4 Design for Earthquakes

The site class for seismic site response can be taken as **Site Class E** for the shallow foundations considered at this site. The soils underlying the proposed foundations are not susceptible to liquefaction. Reference should be made to the latest revision of the 2012 Ontario Building Code for a full discussion of the earthquake design requirements.

5.5 Basement Slab

With the removal of all topsoil and deleterious fill, containing organic matter, within the footprints of the proposed buildings, undisturbed native soil surface will be considered acceptable subgrade on which to commence backfilling for floor slab construction. Any soft areas should be removed and backfilled with appropriate backfill material. OPSS Granular B Type II, with a maximum particle size of 50 mm, are recommended for backfilling below the floor slab. It is recommended that the upper 200 mm of sub-slab fill consist of 19 mm clear crushed stone.

5.6 Pavement Structure

Car only parking areas, local and collector roadways are anticipated at this site. The proposed pavement structures are shown in Tables 6, 7 and 8.

| Table 4 - Recommended Pavement Structure - Driveways | | | | | | | |
|--|---|--|--|--|--|--|--|
| Thickness (mm) | Material Description | | | | | | |
| 50 | Wear Course - HL 3 or Superpave 12.5 Asphaltic Concrete | | | | | | |
| 150 | BASE - OPSS Granular A Crushed Stone | | | | | | |
| 300 | SUBBASE - OPSS Granular B Type II | | | | | | |

SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil or fill

Report: PG4242-1 Revision 1



| Table 5 - Recommended Pavement Structure - Local Residential Roadways (no bus traffic) | | | | | | |
|--|---|--|--|--|--|--|
| Thickness Material Description (mm) | | | | | | |
| 40 | Wear Course - Superpave 12.5 Asphaltic Concrete | | | | | |
| 50 | Binder Course - Superpave 19.0 Asphaltic Concrete | | | | | |
| 150 | BASE - OPSS Granular A Crushed Stone | | | | | |
| 400 SUBBASE - OPSS Granular B Type II | | | | | | |
| SUBGRADE - Either fill, in situ soil or OPSS Granular B Type I or II material placed over in situ soil | | | | | | |


| Table 6 - Recommended Pavement Structure - Roadways with Bus Traffic | | | | | | | | |
|--|--|--|--|--|--|--|--|--|
| Thickness mm | Material Description | | | | | | | |
| 40 | Wear Course - Superpave 12.5 Asphaltic Concrete | | | | | | | |
| 50 | Upper Binder Course - Superpave 19.0 Asphaltic Concrete | | | | | | | |
| 50 | Lower Binder Course - Superpave 19.0 Asphaltic Concrete | | | | | | | |
| 150 | BASE - OPSS Granular A Crushed Stone | | | | | | | |
| 600 | SUBBASE - OPSS Granular B Type II | | | | | | | |
| | SUBGRADE - Either in situ soil or OPSS Granular B Type II material placed over in situ soil | | | | | | | |

Minimum Performance Graded (PG) 58-34 asphalt cement should be used for this project.

If soft spots develop in the subgrade during compaction or due to construction traffic, the affected areas should be excavated and replaced with OPSS Granular B Type II material. Weak subgrade conditions may be experienced over service trench fill materials, which will require the use of a woven geotextile liner, such as a Terratrack 200 or equivalent, as well as, an additional 300 to 600 mm thick granular layer, consisting of a 150 mm minus, well graded granular fill or crushed concrete, to provide adequate construction access.

The pavement granular base and subbase should be placed in maximum 300 mm thick lifts and compacted to a minimum of 98% of the material's SPMDD using suitable vibratory equipment.

Report: PG4242-1 Revision 1





Pavement Structure Drainage

Satisfactory performance of the pavement structure is largely dependent on the contact zone between the subgrade material and the base stone in a dry condition. Failure to provide adequate drainage under conditions of heavy wheel loading can result in the fine subgrade soil being pumped into the voids in the stone subbase, thereby reducing load carrying capacity.

Due to the low permeability of the subgrade materials consideration should be given to installing subdrains during the pavement construction as per City of Ottawa standards. The subdrain inverts should be approximately 300 mm below subgrade level. The subgrade surface should be crowned to promote water flow to the drainage lines.



6.0 Design and Construction Precautions

6.1 Foundation Drainage and Backfill

A perimeter foundation drainage system is recommended for proposed structures. The system should consist of a 150 mm diameter, geotextile-wrapped, perforated, corrugated, plastic pipe, surrounded on all sides by 150 mm of 10 mm clear crushed stone, placed at the footing level around the exterior perimeter of the structure. The pipe should have a positive outlet, such as a gravity connection to the storm sewer or sump pit.

Backfill against the exterior sides of the foundation walls should consist of freedraining, non frost susceptible granular materials. The site materials will be frost susceptible and, as such, are not recommended for re-use as backfill unless a composite drainage system (such as system Platon or Miradrain G100N) connected to a drainage system is provided.


Based on our groundwater level observations, a sub-floor drain system for the proposed buildings with basements is recommended. It is recommended that a geosock wrapped, 150 mm diameter perforated corrugated plastic pipe be placed below the floor slab across the building footprint. A sleeve through the footing should be provided to connect the sub-floor drain to the perimeter foundation drainage system. It is further recommended that the perimeter drainage system have a positive outlet to the storm sewer.

6.2 Protection Against Frost Action

Perimeter footings of heated structures are required to be insulated against the deleterious effect of frost action. A minimum 1.5 m thick soil cover (or equivalent) should be provided in this regard.

A minimum of 2.1 m thick soil cover (or equivalent) should be provided for other exterior unheated footings.

Report: PG4242-1 Revision 1





6.3 Excavation Side Slopes

Excavations will be mostly through very loose to loose silty sand and sensitive grey silty clay. Above the groundwater level, for excavations to depths of approximately 3 m, the excavation side slopes should be stable in the short term at 1H:1V. Flatter slopes could be required for deeper excavations or for excavation below the groundwater level. Where such side slopes are not permissible or practical, temporary shoring should be used.

Based on observations at the test hole locations at the time of the field program and review of the recovered soil samples, the subsoil at this site is considered to be mainly a Type 3 soil according to the Occupational Health and Safety Act and Regulations for Construction Projects. The excavation side slopes above the groundwater level extending to a maximum depth of 3 m should be cut back at 1H:1V or flatter.

It should be noted that the very loose to loose wet silty sand and sandy silt with clay is very sensitive when wet, and upon disturbance is prone to running below the water table unless it is completely supported before excavation procedures. Unsupported excavations below the water table, specifically within the loose silty sand should be cut back at 1.5H:1V or flatter.

As a result, it is recommended that a dewatering program be completed as part of the deep service installation within the subject site. The dewatering program should consist of a series of well points designed and installed by a licensed contractor specializing in dewatering.

The slope cross-sections recommended above are for temporary slopes. Excavated soil should not be stockpiled directly at the top of excavations and heavy equipment should be kept away from the excavation sides. A minimum of 4 to 6 m setback should be considered from the excavation face depending on the excavation depth and soil consistency.

Slopes in excess of 3 m in height should be periodically inspected by the geotechnical consultant in order to detect if the slopes are exhibiting signs of distress.

It is recommended that a trench box be used at all times to protect personnel working in trenches with steep or vertical sides. It is expected that services will be installed by "cut and cover" methods and excavations will not be left open for extended periods of time.

March 16, 2018



Excavation Base Stability

The base of supported excavations can fail by three (3) general modes:

- Shear failure within the ground caused by inadequate resistance to loads imposed by grade difference inside and outside of the excavation,
- Piping from water seepage through granular soils, and
- Heave of layered soils due to water pressures confined by intervening low permeability soils.

Shear failure of excavation bases is typically rare in granular soils if adequate lateral support is provided. Inadequate dewatering can cause instability in excavations made through granular or layered soils. The potential for base heave in cohesive soils should be determined for stability of flexible retaining systems.

The factor of safety with respect to base heave, FS_b, is:

$$FS_b = N_b s_u / \sigma_z$$

where:

- $N_{\rm b}$ stability factor dependent upon the geometry of the excavation and given in Figure 1 on the following page.
- s_u undrained shear strength of the soil below the base level
- σ_z total overburden and surcharge pressures at the bottom of the excavation

Report: PG4242-1 Revision 1 March 16, 2018



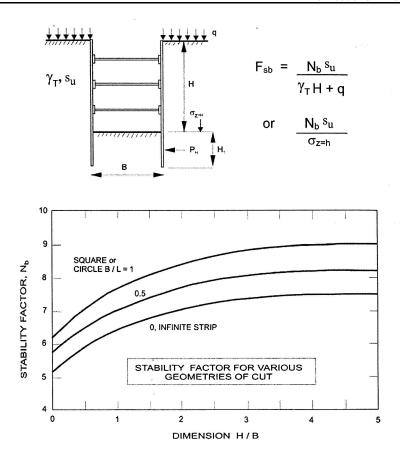


Figure 1 - Stability Factor for Various Geometries of Cut

In the case of soft to firm clays, a factor of safety of 2 is recommended for base stability.

6.4 Pipe Bedding and Backfill

Bedding and backfill materials should be in accordance with the most recent Material Specifications and Standard Detail Drawings from the City of Ottawa.

It is expected that the invert level of the municipal services will be installed at or below the long term groundwater level within the very loose to loose silty sand to sandy silt deposit. As a result, it is recommended that a dewatering program should be implemented prior to construction to temporarily draw down the long term groundwater level during the construction phase. It is recommended that the dewatering program consisting of a series of well points be designed and installed by a licensed contractor specialized in dewatering.



Proposed Residential Development The Meadows - Phase 5 - Cambrian Road - Ottawa

The pipe bedding for sewer and water pipes placed on a relatively dry, undisturbed subgrade surface should consist of at least 150 mm of OPSS Granular A material. Where the bedding is located within the firm grey silty clay, the thickness of the bedding material should be increased to a minimum of 300 mm. The material should be placed in maximum 300 mm thick lifts and compacted to a minimum of 95% of its SPMDD. The bedding material should extend at least to the spring line of the pipe.

The cover material, which should consist of OPSS Granular A, should extend from the spring line of the pipe to at least 300 mm above the obvert of the pipe. The material should be placed in maximum 300 mm thick lifts and compacted to a minimum of 95% of its SPMDD.

Generally, it should be possible to re-use the moist (not wet) brown silty clay and silty sand above the cover material if the excavation and filling operations are carried out in dry weather conditions. Wet silty clay and silty sand materials will be difficult to re-use, as the high water contents make compacting impractical without an extensive drying period.


Where hard surface areas are considered above the trench backfill, the trench backfill material within the frost zone (about 1.8 m below finished grade) should match the soils exposed at the trench walls to minimize differential frost heaving. The trench backfill should be placed in maximum 300 mm thick loose lifts and compacted to a minimum of 95% of the material's SPMDD.

To reduce long-term lowering of the groundwater at this site, clay seals should be provided within the service trenches excavated through the silty clay deposit. The seals should be at least 1.5 m long (in the trench direction) and should extend from trench wall to trench wall. The seals should extend from the frost line and fully penetrate the bedding, subbedding and cover material. The barriers should consist of relatively dry and compactable brown silty clay placed in maximum 225 mm thick loose layers and compacted to a minimum of 95% of the SPMDD. The clay seals should be placed at the site boundaries and at strategic locations at no more than 60 m intervals in the service trenches excavated through the silty clay deposit.

6.5 Groundwater Control

Due to the relatively permeable silty sand to sandy silt deposit encountered within the shallow groundwater table within the subject site, it is anticipated that conventional pumping with open sumps will be difficult to control the groundwater influx through the sides of the temporary excavation. As a result, it is recommended that a dewatering specialist be consulted to review the most effective dewatering methods.

March 16, 2018





Permit to Take Water

A temporary Ministry of the Environment and Climate Change (MOECC) permit to take water (PTTW) may be required for this project if more than 400,000 L/day of ground and/or surface water is to be pumped during the construction phase. A minimum 4 to 5 months should be allowed for completion of the PTTW application package and issuance of the permit by the MOECC.

For typical ground or surface water volumes, being pumped during the construction phase, between 50,000 to 400,000 L/day, it is required to register on the Environmental Activity and Sector Registry (EASR). A minimum of two to four weeks should be allotted for completion of the EASR registration and the Water Taking and Discharge Plan to be prepared by a Qualified Person as stipulated under O.Reg. 63/16. If a project qualifies for a PTTW based upon anticipated conditions, an EASR will not be allowed as a temporary dewatering measure while awaiting the MOECC review of the PTTW application.

The contractor should be prepared to direct water away from all bearing surfaces and subgrades, regardless of the source, to prevent disturbance to the founding medium.

6.6 Winter Construction

The subsurface conditions at this site mostly consist of frost susceptible materials. In presence of water and freezing conditions ice could form within the soil mass. Heaving and settlement upon thawing could occur. Precautions should be taken if winter construction is considered for this project.

In the event of construction during below zero temperatures, the founding stratum should be protected from freezing temperatures by the use of straw, propane heaters, tarpaulins or other suitable means. In this regard, the base of the excavations should be insulated from sub-zero temperatures immediately upon exposure and until such time as heat is adequately supplied to the building and the footings are protected with sufficient soil cover to prevent freezing at founding level.

The trench excavations should be constructed in a manner that will avoid the introduction of frozen materials into the trenches. As well, pavement construction is difficult during winter. The subgrade consists of frost susceptible soils which will experience total and differential frost heaving as the work takes place. In addition, the introduction of frost, snow or ice into the pavement materials, which is difficult to avoid, could adversely affect the performance of the pavement structure. Additional information could be provided, if required.

Report: PG4242-1 Revision 1



6.7 Landscaping Considerations

Tree Planting Restrictions

In accordance with the City of Ottawa Tree Planting in Sensitive Marine Clay Soils (2017 Guidelines), Paterson completed a soils review of the site to determine applicable tree planting setbacks. Atterberg limits testing was completed for recovered silty clay samples at selected locations throughout the subject site. A shrinkage limit test and sieve analysis testing was also completed on selected soil samples. The shrinkage limit testing indicates a shrinkage limit of 16% with a shrinkage ratio of 1.89. The results of our atterberg limit and sieve testing are presented in Appendix 1. Based on the results of our review, the two tree planting setback areas are present within the current phase of the proposed development. The two areas are detailed below and have been outlined in Drawing PG4242-3 - Tree Planting Setback Recommendations presented in Appendix 2.

Area 1 - No Tree Planting Setbacks


Based on the subsoil profile at the test hole locations, a silty sand deposit was encountered within 3.5 m of design finished grades. As a result, no tree planting restrictions are required for Area 1 illustrated on Drawing PG4242-3 - Tree Planting Setback Recommendations in Appendix 2.

Area 2 - Low/Medium Sensitivity Clay Soils

A low to medium sensitivity clay soil was encountered between design underside of footing elevations and 3.5 m below finished grade as per City Guidelines. Based on our Atterberg Limits test results, the modified plasticity limit generally does not exceed 40%. The following tree planting setbacks are recommended for Area 2. Large trees (mature height over 14 m) can be planted within Area 2 provided a tree to foundation setback equal to the full mature height of the tree can be provided (e.g. in a park or other green space). Tree planting setback limits may be reduced to 4.5 m for small (mature tree height up to 7.5m) and medium size trees (mature tree height 7.5 m to 14 m) provided that the following conditions are met:

| The underside of footing (USF) is 2.1 m or greater below the lowest finished |
|--|
| grade must be satisfied for footings within 10 m from the tree, as measured from |
| the centre of the tree trunk and verified by means of the Grading Plan as |
| indicated procedural changes below. |

A small tree must be provided with a minimum of 25 m³ of available soil volume





while a medium tree must be provided with a minimum of 30 m³ of available soil volume, as determined by the Landscape Architect. The developer is to ensure that the soil is generally un-compacted when backfilling in street tree planting locations.

- The tree species must be small (mature tree height up to 7.5 m) to medium size (mature tree height 7.5 m to 14 m) as confirmed by the Landscape Architect.
- The foundation walls are to be reinforced at least nominally (minimum of two upper and two lower 15M bars in the foundation wall).
- Grading surround the tree must promote drainage to the tree root zone (in such a manner as not to be detrimental to the tree), as noted on the subdivision Grading Plan.

Swimming Pools, Aboveground Hot Tubs, Decks and Additions

The in-situ soils are considered to be acceptable for swimming pools. Above ground swimming pools must be placed at least 5 m away from the residence foundation and neighbouring foundations. Otherwise, pool construction is considered routine, and can be constructed in accordance with the manufacturer's requirements.

Additional grading around the hot tub should not exceed permissible grade raises. Otherwise, hot tub construction is considered routine, and can be constructed in accordance with the manufacturer's specifications.

Additional grading around proposed deck or addition should not exceed permissible grade raises. Otherwise, standard construction practices are considered acceptable.

6.8 Corrosion Potential and Sulphate

One (1) sample was submitted for testing. The analytical test results of the soil sample indicate that the sulphate content is less than 0.01%. These results along with the chloride and pH value are indicative that Type 10 Portland cement (normal cement) would be appropriate for this site. The results of the resistivity indicate the presence of a moderate to very aggressive environment for exposed ferrous metals at this site, which is typical of silty clay samples submitted for the subject area. It is anticipated that standard measures for corrosion protection are sufficient for services placed within the silty clay deposit.

7.0 Recommendations

Report: PG4242-1 Revision 1 March 16, 2018





Proposed Residential Development The Meadows - Phase 5 - Cambrian Road - Ottawa

Review detailed grading plan(s) from a geotechnical perspective.
 Observation of all bearing surfaces prior to the placement of concrete.
 Periodic observation of the condition of unsupported excavation side slopes in excess of 3 m in height, if applicable.
 Observation of all subgrades prior to placing backfilling materials.
 Field density tests to ensure that the specified level of compaction has been achieved.

It is recommended that the following be completed once the master plan and site

A report confirming that these works have been conducted in general accordance with Paterson's recommendations could be issued upon request, following the completion of a satisfactory material testing and observation program by the geotechnical consultant.

Sampling and testing of the bituminous concrete including mix design reviews.

Page 22



8.0 Statement of Limitations

The recommendations made in this report are in accordance with Paterson's present understanding of the project. Paterson requests permission to review the grading plan once available. Paterson's recommendations should be reviewed when the drawings and specifications are complete.

The client should be aware that any information pertaining to soils and the test hole log are furnished as a matter of general information only. Test hole descriptions or logs are not to be interpreted as descriptive of conditions at locations other than those of the test holes.

A soils investigation is a limited sampling of a site. Should any conditions at the site be encountered which differ from those at the test locations, Paterson requests to be notified immediately in order to permit reassessment of the recommendations.

The present report applies only to the project described in this document. Use of this report for purposes other than those described herein or by person(s) other than Tamarack (Nepean) Corporation or their agent(s) is not authorized without review by this firm for the applicability of our recommendations to the altered use of the report.

Paterson Group Inc.

Colin Belcourt, M.Eng.

Mar. 23-2018
D. J. GILBERT
100116130

WCE OF ONTARIO

David J. Gilbert, P.Eng.

Report Distribution:

- ☐ Tamarack (Nepean) Corporation (3 copies)
- □ Paterson Group (1 copy)

APPENDIX 1

SOIL PROFILE AND TEST DATA SHEETS

SYMBOLS AND TERMS

GRAIN SIZE DISTRIBUTION SHEETS

ATTERBERG LIMIT TESTING

ANALYTICAL TESTING RESULTS

SOIL PROFILE AND TEST DATA

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

Geotechnical Investigation
Prop. Residential Development - Borrisokane Road
Ottawa, Ontario

DATUM Ground surface elevation provided by Stantec Geomatics Ltd.

FILE NO.

PG4242

HOLE NO.

PL 1 10

BH 1-18 BORINGS BY CME 55 Power Auger DATE January 9, 2018 **SAMPLE** Pen. Resist. Blows/0.3m STRATA PLOT **DEPTH** ELEV. Piezometer Construction **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) N VALUE or RQD RECOVERY NUMBER Water Content % **GROUND SURFACE** 80 20 0+93.78TOPSOIL, some clay 0.40 1 + 92.78SS 2 4 33 SS 3 2 25 0 Firm, grey-brown SILTY CLAY, 2 + 91.78trace sand - grey by 2.3m depth 3 + 90.784 + 89.785 + 88.786 + 87.78Ö End of Borehole (GWL @ 3.15m - Jan. 15, 2018) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

Ground surface elevation provided by Stantec Geomatics Ltd.

SOIL PROFILE AND TEST DATA

FILE NO.

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

DATUM

Geotechnical Investigation
Prop. Residential Development - Borrisokane Road
Ottawa, Ontario

PG4242 REMARKS HOLE NO. **BH 2-18 BORINGS BY** CME 55 Power Auger DATE January 9, 2018 **SAMPLE** Pen. Resist. Blows/0.3m Monitoring Well Construction STRATA PLOT **DEPTH** ELEV. **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) RECOVERY N VALUE or RQD NUMBER Water Content % **GROUND SURFACE** 80 20 0+97.02**TOPSOIL** 0.36 1 + 96.02SS 2 33 16 SS 3 33 21 Ō. 2+95.02 SS 4 29 20 Ö GLACIAL TILL: Compact to dense, brown silty sand with gravel, cobbles 3+94.02and boulders SS 5 42 38 0. 4+93.02SS 6 38 36 Ó - compact by 4.5m depth SS 7 42 25 Ö 5+92.02SS 8 46 27 O 6+91.02SS 8 21 28 0 6.70 Dynamic Cone Penetration Test 7 + 90.02commenced at 6.70m depth. Inferred GLACIAL TILL 8+89.02 8.23 End of Borehole Practical DCPT refusal at 8.23m depth (GWL @ 0.20m - Jan. 15, 2018) 20 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

Ground surface elevation provided by Stantec Geomatics Ltd.

SOIL PROFILE AND TEST DATA

FILE NO.

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

DATUM

Geotechnical Investigation
Prop. Residential Development - Borrisokane Road
Ottawa, Ontario

PG4242 REMARKS HOLE NO. **BH 3-18** BORINGS BY CME 55 Power Auger DATE January 10, 2018 **SAMPLE** Pen. Resist. Blows/0.3m STRATA PLOT **DEPTH** ELEV. Piezometer Construction **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) N VALUE or RQD RECOVERY NUMBER Water Content % **GROUND SURFACE** 80 20 0+95.74ΑU Loose to compact, brown SILTY **SAND** 1 + 94.74SS 2 9 38 SS 3 75 11 Ó 1.98 2 + 93.743 + 92.74SS 4 2 100 Firm to soft, grey SILTY CLAY, 4+91.74 trace sand 5 + 90.746 + 89.74O: End of Borehole (GWL @ 0.3m - Jan. 15, 2018) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

SOIL PROFILE AND TEST DATA

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

Geotechnical Investigation
Prop. Residential Development - Borrisokane Road
Ottawa, Ontario

DATUM Ground surface elevation provided by Stantec Geomatics Ltd. FILE NO. **PG4242 REMARKS** HOLE NO. **TP 1-18 BORINGS BY** Backhoe DATE January 8, 2018 **SAMPLE** Pen. Resist. Blows/0.3m STRATA PLOT DEPTH ELEV. Piezometer Construction **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) N VALUE or RQD RECOVERY NUMBER Water Content % **GROUND SURFACE** 80 20 0+93.42**TOPSOIL** G 1 0.30 G 2 Brown SILTY SAND 0.60 G 3 1 + 92.42Brown **CLAYEY SAND** with silt G 4 - grey by 2.1m depth 2+91.42 ⊻ G 5 3 + 90.42G 6 4.00 4+89.42 End of Test Pit (GWL @ 2.1m depth based on field observations) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

SOIL PROFILE AND TEST DATA

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

Geotechnical Investigation Prop. Residential Development - Borrisokane Road Ottawa, Ontario

DATUM Ground surface elevation provided by Stantec Geomatics Ltd. FILE NO. **PG4242 REMARKS** HOLE NO. **TP 2-18 BORINGS BY** Backhoe DATE January 8, 2018 **SAMPLE** Pen. Resist. Blows/0.3m STRATA PLOT DEPTH ELEV. Piezometer Construction **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) N VALUE or RQD RECOVERY NUMBER Water Content % **GROUND SURFACE** 80 20 0+93.78G 1 TOPSOIL with clay 0.38 G 2 Brown FINE SAND, trace clay 1 + 92.781.32 ⊻ G 3 **Grey CLAYEY SAND** 2 + 91.782.13 G 4 Grey SILTY CLAY with sand 3 + 90.78G 5 4+89.78 End of Test Pit (GWL @ 1.3m depth based on field observations) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

SOIL PROFILE AND TEST DATA

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

Geotechnical Investigation Prop. Residential Development - Borrisokane Road Ottawa, Ontario

DATUM Ground surface elevation provided by Stantec Geomatics Ltd. FILE NO. **PG4242 REMARKS** HOLE NO. **TP 3-18 BORINGS BY** Backhoe DATE January 8, 2018 **SAMPLE** Pen. Resist. Blows/0.3m STRATA PLOT DEPTH ELEV. Piezometer Construction **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) N VALUE or RQD RECOVERY NUMBER Water Content % **GROUND SURFACE** 80 20 0+96.11**TOPSOIL** G 0.30 G 2 1 + 95.11**Brown SILTY SAND** G 3 2 + 94.11G 4 ∇ 3 + 93.113.05 **Brown CLAYEY SAND** G 5 4.00 4+92.11 End of Test Pit (GWL @ 3.0m depth based on field observations) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

SOIL PROFILE AND TEST DATA

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

Geotechnical Investigation Prop. Residential Development - Borrisokane Road Ottawa, Ontario

| DATUM Ground surface elevation | n provid | ded by | / Stan | itec G | eoma | tics Ltd. | | | FILE NO. PG4242 | 2 |
|--|--|--------|--------|----------|-------------------|--------------|--------------|------|-------------------------------------|--|
| REMARKS | | | | _ | | 1 | 0040 | | HOLE NO. TP 4-18 | |
| BORINGS BY Backhoe | | | | | ATE . | January 8 | 3, 2018 | | | 1 |
| SOIL DESCRIPTION | | | | /IPLE | | DEPTH (m) | ELEV. (m) | | esist. Blows/0.3m 0 mm Dia. Cone | er |
| | STRATA | TYPE | NUMBER | RECOVERY | N VALUE or RQD | | | 0 V | /ater Content % | Piezometer Construction |
| GROUND SURFACE | 0, | | | 2 | Z | 0- | 97.13 | 20 | 40 60 80 | i⊑ ŏ |
| TOPSOIL 0.1 | 8 | G | 1 | | | | 37.10 | | | . \ <u>\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\</u> |
| | | G | 2 | | | | | | | |
| GLACIAL TILL: Brown silty sand with gravel, cobbles and boulders | | | | | | | | | | |
| | \^^^^ | G | 3 | | | 1- | 96.13 | | | |
| 1.5 | 52\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\ | | | | | | | | | |
| End of Test Pit | | | | | | | | | | |
| (GWL @ 0.3m depth based on field observations) | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | 20 | 40 60 80 | 100 |
| | | | | | | | | Shea | r Strength (kPa) | |

SOIL PROFILE AND TEST DATA

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

Geotechnical Investigation Prop. Residential Development - Borrisokane Road Ottawa, Ontario

| DATUM Ground surface elevation provided by Stantec Geomatics Ltd. FILE NO. PG4242 | | | | | | | | | | |
|---|--|------|--------|--------------------|-------------------|-----------|-------------------------------------|------------------------|----------------------------|-----|
| REMARKS BORINGS BY Backhoe | | | | - | ATE | January 9 | 2019 | | HOLE NO. TP 5-18 | |
| SOIL DESCRIPTION | | (m) | | | ELEV. (m) | | esist. Blows/0.3m 0 mm Dia. Cone | | | |
| | | TYPE | NUMBER | * RECOVERY N VALUE | N VALUE or RQD | 2 () | () | O W | Piezometer Construction | |
| GROUND SURFACE TOPSOIL | | | | Н Н | | 0- | 96.86 | 20 | 40 60 80 | + 0 |
| GLACIAL TILL: Brown silty sand with gravel, cobbles and boulders | | G | 2 | | | 2- | -95.86 -94.86 | | | |
| End of Test Pit | | | | | | | | | | |
| (GWL @ 0.6m depth based on field observations) | | | | | | | | 20 Shea ▲ Undist | ar Strength (kPa) | 100 |

Ground surface elevation provided by Stantec Geomatics Ltd.

SOIL PROFILE AND TEST DATA

FILE NO.

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

DATUM

Geotechnical Investigation Prop. Residential Development - Borrisokane Road Ottawa, Ontario

| REMARKS | | | | | | | | | | PG4242 | <u> </u> | |
|--|--|-------------|----------------------|---------------|-------------------|-------|------------------|---|----|---------------------------|---|--|
| | | | | | | | | HOLE NO. TP 6-18 | | | | |
| SOIL DESCRIPTION | | | DATE January 8, 2018 | | | | | | I | | | |
| | PLOT | | SAMPLE | | | DEPTH | ELEV. | Pen. Resist. Blows/0.3m ■ 50 mm Dia. Cone | | | | |
| | | F-I | Ä | ERY | 田の | (m) | (m) | ● 50 mm Dia. Cone ○ Water Content % 20 40 60 80 | | | | |
| | STRATA | TYPE | NUMBER | * RECOVERY | N VALUE or RQD | | | O Water Content % | | | | |
| GROUND SURFACE | Ŋ | | Ž | RE | zö | | 07.06 | 20 | 40 | 60 80 | ြန္မပ္မ | |
| TOPSOIL 0. | 10 | G | 1 | | | | 97.26 | | | | | |
| GLACIAL TILL: Brown silty sand with gravel, cobbles and boulders | \^^^^ | | | | | | | | | | | |
| | \^^^^ | 1 | | | | | | | | | | |
| | \^^^^ | | | | | | | | | | . | |
| | | G | 2 | | | 1- | -96.26 | | | | | |
| | | | | | | | | | | | _ | |
| | | | | | | | | | | | . \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ | |
| | \\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\ | | | | | | | | | | _ | |
| | | | | | | | | | | | | |
| | | - G - | 3 | | | 2- | -95.26 -94.26 | | | | | |
| | \^^^^ | | | | | | | | | | | |
| | \^,^,^, | | | | | | | | | | 4 | |
| | \^^^^ | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | 4 | | | | | | | | | |
| | | G | | | | | | | | | | |
| | | _ | | | | 3- | | | | | - | |
| | \^,^,^, | ^ | | | | | | | | | | |
| 4.0 | \^^^^ | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | <u></u> | | | | | | | | | | |
| | oo[^^^^^ | | | | | | | | | | | |
| End of Test Pit | <u> </u> | - | | | | 4- | 93.26 | | | | | |
| (GWL @ 1.2m depth based on field observations) | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | 20 40 60 | | | | | | 100 | | | | |
| | | | | | | | | She ▲ Undis | | ngth (kPa) △ Remoulded | | |
| | | | | 1 | 1 | | | | | | | |

patersongroup Consulting Engineers

Ground surface elevation provided by Stantec Geomatics Ltd.

SOIL PROFILE AND TEST DATA

FILE NO.

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

DATUM

Geotechnical Investigation Prop. Residential Development - Borrisokane Road Ottawa, Ontario

| DEMARKS | | | | | | | | | | | P | 34242 | |
|----------------------------|----------|------|--------|---------------|-------------------|-----------|--------|-----|-----------|-------------|---------------|---------|----------------------------|
| REMARKS BORINGS BY Backhoe | | | | п | ΔTF . | January 8 | 2018 | | | НОІ | LE NO. TP | 7-18 | |
| SOIL DESCRIPTION | PLOT | | SAN | /IPLE | | DEPTH | ELEV. | F | | | . Blows/0 | | |
| | STRATA E | 日 | BER | VERY | ROD | (m) | (m) | | | | | | Piezometer Construction |
| GROUND SURFACE | STR | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | | | | 0 ' 20 | Water 40 | Content 60 | % 80 | Piezo |
| | | | | | | 0- | 97.89 | | | | | Î | |
| | | - | | | | | | | | | | | |
| | | G | 1 | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | , | | | | | | | |
| | | | | | | 1- | -96.89 | | | | | | |
| | | G | 2 | | | | | | | | | | |
| | | - | _ | | | | | | | | | | |
| Brown SILTY SAND | | | | | | | | | | | | | |
| | | | | | | 2- | -95.89 | | | | | | |
| | | - | | | | | 33.03 | | | | | | |
| | | G | 3 | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | 3- | -94.89 | | | | | | |
| | | G | 4 | | | | | | | | | | |
| | | } | | | | | | | | | | | |
| 3.0 | 66 | | | | | | | | | | | | |
| Grey SANDY CLAY with silt | | G | 5 | | | | | | | | | | |
| 4.9 End of Test Pit | 00//// | | | | | 4- | -93.89 | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | : : | 20 | 40 | 60 | 80 1 | 00 |
| | | | | | | | | | | | rength (kF | Pa) | |

Consulting Engineers

SOIL PROFILE AND TEST DATA

Supplemental Geotechnical Investigation Prop. Residential Development-Greenbank Road Ottawa, Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7 DATUM Ground surface elevations provided by Taggart Group of Companies

REMARKS

FILE NO.

PG0214

| REMARKS BORINGS BY CME 55 Power Auger | | | | D | ATE (| 3 Mar 09 | | HOLE NO. BH 4-09 | |
|--|------------------|------|--------|---------------|-------------------|----------|--------|---|------------|
| SOIL DESCRIPTION | PLOT | | SAN | I PLE | 1 | DEPTH | ELEV. | Pen. Resist. Blows/0.3m • 50 mm Dia. Cone | iter |
| | STRATA P | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | | Piezometer |
| GROUND SURFACE | | ~ | | 24 | Z | 0- | -93.44 | 20 40 60 80 | |
| | 0 <u>5</u> 61 | AU | 1 | | | | | | |
| Loose, brown SANDY SILT , some clay | | ss | 2 | 25 | 5 | 1- | 92.44 | | ⊽ |
| | 13 | ss | 3 | 100 | 2 | 2- | -91.44 | | - |
| | | ss | 4 | 0 | 1 | | | | |
| Soft, grey SILTY CLAY | | ss | 5 | 100 | 1 | 3- | 90.44 | | |
| <u>4</u> . | 27 | | | | | 4- | -89.44 | | |
| End of Borehole BH terminated due to clay entering augers @ 4m depth. | | | | | | | | | |
| (Open hole GWL @ 1.5m depth) | | | | | | | | | |
| | | | | | | | | 20 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded |) |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Supplemental Geotechnical Investigation Prop. Residential Development-Greenbank Road Ottawa, Ontario

Ground surface elevations provided by Taggart Group of Companies **DATUM**

FILE NO.

PG0214

REMARKS

HOLE NO.

BH 5-09 DATE 3 Mar 00

| BORINGS BY CME 55 Power Auger | | | | D | ATE : | 3 Mar 09 | | ВН | 5-09 |
|--|----------|---------|--------|---------------|-------------------|----------|--------|---|--|
| SOIL DESCRIPTION | PLOT | | SAN | IPLE | I | DEPTH | ELEV. | Pen. Resist. Blows/0.3r • 50 mm Dia. Cone | m stion |
| | STRATA 1 | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | O Water Content % | Piezometer Construction |
| GROUND SURFACE | | | | R | Z | | -93.35 | 20 40 60 80 | |
| Brown SILTY SAND, some or gravel 0.08 | 11 1.1 | AU | 1 | | | | | | |
| | | SS 7 | 2 | 25 | 9 | 1- | -92.35 | | |
| Loose to compact, grey SAND , some gravel | | SS 7 | 3 | 33 | 9 | 2- | -91.35 | | |
| Critic, como gravor | | ss | 4 | 42 | 10 | 3- | -90.35 | | |
| 3.66 End of Borehole | | ss | 5 | 83 | 12 | | | | ······································ |
| (Open hole GWL @ 0.6m depth) | | | | | | | | 20 40 60 80 Shear Strength (kPa) ▲ Undisturbed △ Remould | |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Supplemental Geotechnical Investigation Prop. Residential Development-Greenbank Road Ottawa, Ontario

DATUM Ground surface elevations provided by Taggart Group of Companies

FILE NO.

PG0214

REMARKS

HOLE NO.

| BORINGS BY CME 55 Power Auger | | | | D | ATE (| 3 Mar 09 | | | HOLE NO. BH 6-0 | 9 |
|--|----------|---|--------|---------------|-------------------|----------|---------------|-------------------------|-------------------------------------|------------|
| SOIL DESCRIPTION | PLOT | | SAN | /IPLE | | DEPTH | ELEV. | | esist. Blows/0.3m 0 mm Dia. Cone | ețer |
| | STRATA E | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | | /ater Content % | Piezomețer |
| GROUND SURFACE | | | | 2 | z o | n- | -94.00 | 20 | 40 60 80 | |
| 25mm Topsoil | | AU | 1 | | | | | | | |
| Compact, brown SILTY SAND with clay and gravel | | :.X SS :7 | 2 | 33 | 13 | 1- | -93.00 | | | |
| | | ss ::// | 3 | 42 | 4 | 2- | -92.00 | | | |
| <u>3</u> . | 00: | ss : | 4 | 50 | 3 | 3- | -91.00 | | | |
| Soft, grey SILTY CLAY , some fossiliferous shells | | ss | 5 | 100 | 2 | | | | | |
| <u>4</u> . | 57 | SS | 6 | 100 | 2 | 4- | -90.00 | | | |
| | | ss ::// | 7 | 83 | 6 | 5- | -89.00 | | | |
| | | : SS : 7 | 8 | 100 | 4 | 6- | -88.00 | | | |
| Loose to compact, brown SILTY SAND | | :\\\\ SS :\ \\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\ | 9 | 83 | 4 | 7_ | -87.00 | | | |
| | | ss ::// | 10 | 100 | 6 | | <i>67.</i> 00 | | | |
| | | ss ::// | 11 | 83 | 10 | 8- | -86.00 | | | |
| | | SS SS | 12 | 67 | 13 | 9- | -85.00 | | | |
| 9. End of Borehole | 75 | <u> </u> | | | | | | | | |
| (GWL @ 0.70m-Mar. 11/09) | | | | | | | | | | |
| | | | | | | | | 20 Shea ▲ Undistu | ar Strength (kPa) | 00 |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

Ground surface elevations provided by Webster and Simmonds Surveying Ltd. **DATUM**

FILE NO.

PG0214

| REMARKS | | | | | | | | HOLE NO. | |
|--|--------|-------------|--------|---------------|-------------------|--------------|--------------|---|----------------------------|
| BORINGS BY Backhoe | | | | D | ATE 2 | 28 Apr 04 | | TP 1 | |
| SOIL DESCRIPTION | PLOT | | SAN | IPLE | | DEPTH (m) | ELEV. (m) | Pen. Resist. Blows/0.3m ■ 50 mm Dia. Cone | eter ction |
| | STRATA | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (111) | (111) | O Water Content % | Piezometer Construction |
| GROUND SURFACE | מ | | N N | REC | zö | 0- | -95.00 | 20 40 60 80 | _0 |
| TOPSOIL | 0.40 | G | 1 | | | O O | 93.00 | | |
| Firm, grey-brown SILTY CLAY , trace sand and shells | | - G - | 2 | | | 1- | -94.00 | | ፟፟፟፟፟፟፟፟ |
| | | | | | | 2- | -93.00 | | |
| - grey by 2.7m depth | 2.50 | | | | | 3- | -92.00 | | |
| End of Test Pit | 3.50 | | | | | | | | |
| (Water infiltration @ 1.5m depth) | | | | | | | | | |
| | | | | | | | | 20 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded | |

Consulting Engineers

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

FILE NO.

PG0214

DATUM

| REMARKS | | | | | | | | HOLE NO. |
|---|---|--------|--------|---------------|-------------------|--------------|--------------|--|
| BORINGS BY Backhoe | Ę | | SAN | (IPLE | OATE 2 | 28 Apr 04 | | TP 2 Pen. Resist. Blows/0.3m |
| SOIL DESCRIPTION | STRATA PLOT | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | DEPTH (m) | ELEV. (m) | Pen. Resist. Blows/0.3m • 50 mm Dia. Cone O Water Content % |
| GROUND SURFACE | ρχ | | N N | REC | z ö | 0- | 97.95 | 20 40 60 80 |
| TOPSOIL | _ 0.40 | | | | | | 37.33 | |
| Red-brown SAND with gravel, cobbles and boulders | _ 0.80 | | | | | | | |
| | | | | | | 1- | 96.95 | |
| Firm, grey-brown SILTY CLAY , some boulders, trace sand seams and shells | | | | | | 2- | -95.95 | |
| GLACIAL TILL: Grey silty clay with gravel, cobbles and | 3.10 | _ G | 1 | | | 3- | -94.95 | |
| with gravel, cobbles and boulders End of Test Pit | _ 4.00 \\ \(\) \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ | | | | | 4- | -93.95 | |
| (Water infiltration @ 2.0m depth) | | | | | | | | |
| | | | | | | | | 20 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded |

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

FILE NO. PG0214

REMARKS

DATUM

HOLE NO.

| BORINGS BY Backhoe | | | | | DATE 2 | 28 Apr 04 | | | TP 3 | |
|--|--------|------|--------|---------------|-------------------|-----------|---------|----------------|--|--|
| SOIL DESCRIPTION | PLOT | | SAN | /IPLE | | DEPTH | ELEV. | | esist. Blows/0.3m 0 mm Dia. Cone | eter ction |
| GROUND SURFACE | STRATA | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | O W | ### ################################## | Piezometer Construction |
| TOPSOIL | | | | | | 0- | -103.11 | | | |
| 0.2 | 0 | G | 1 | | | 1- | -102.11 | | | |
| GLACIAL TILL: Brown sand with gravel, cobbles and boulders | | _ | | | | 2- | -101.11 | | | |
| | | G | 2 | | | 3- | -100.11 | | | *************************************** |
| 4.5 | O 2000 | | | | | 4- | -99.11 | | | alteraterateraterateraterateraterateratera |
| End of Test Pit | | | | | | | | | | |
| (TP dry upon completion) | | | | | | | | | | |
| | | | | | | | | 20 | 40 60 80 10 | 00 |
| | | | | | | | | Shea Mundista | ar Strength (kPa) urbed △ Remoulded | |
| | | | | | | | | _ Ondisti | | |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

Ground surface elevations provided by Webster and Simmonds Surveying Ltd. DATUM

FILE NO.

REMARKS

PG0214

HOLE NO.

TP 4

| BORINGS BY Backhoe | | | | D | ATE | 28 Apr 04 | | 1 | | TP 4 | |
|-----------------------------------|-------|------|----------|---------------|-------------------|-----------|--------------|-----------|-------------------------|------------------------------|------------|
| SOIL DESCRIPTION | PLOT | | SAN | IPLE | 1 | DEPTH (m) | ELEV. (m) | | | Blows/0.3m Dia. Cone | eter |
| | 4: □ | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (111) | (111) | 0 | Water Co | ontent % | Piezometer |
| GROUND SURFACE | 0, | | Z | R | z o | 0 | -97.88 | 20 | 40 | 60 80 | |
| TOPSOIL 0.20 | | | | | |] 0- | -97.00 | | | | |
| Red-brown SAND with gravel | | | | | | | | | | | |
| 0.50 | | | | | | | | | | | |
| | ^^^^^ | | | | | | | | | | |
| | ^^^^ | | | | | | | | | | |
| | ^^^^ | | | | | 1- | -96.88 | | | | |
| Į. | ^^^^ | | | | | | 00.00 | | | | |
| | ^^^^ | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| GLACIAL TILL: Brown sand | | | | | | 2- | -95.88 | | | | |
| vith gravel, cobbles and soulders | ^^^^^ | | | | | | | | | | |
| poulders | ^^^^ | G | 1 | | | | | | | | |
| | ^^^^ | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | 3- | -94.88 | | | | |
| | | | | | | | | | | | |
| | ^^^^^ | | | | | | | | | | |
| Į. | ^^^^ | | | | | | | | | | |
| | ^^^^ | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | 4- | -93.88 | | | | |
| | | | | | | | | | | | |
| 4.50 | | | | | | | | | | | |
| 4.50[/ End of Test Pit | ^^^^ | | | | | | | | | | |
| Water infiltration @ 0.5m | | | | | | | | | | | |
| depth) | | | | | | | | | | | |
| | | | | | | | | 20 | :::::: 40 | 60 80 | i≓ 100 |
| | | | | | | | | She | ear Stren | ngth (kPa) | |
| | | | | | | | | 20 Sho | ear Stren | 60 8 ngth (kPa △ Remou | 1) |

Consulting Engineers

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Ottawa (Nepean), Ontario

REMARKS

DATUM

FILE NO.

PG0214

HOLE NO.

TP 5 **BORINGS BY** Backhoe **DATE** 28 Apr 04 SAMPLE Pen. Resist. Blows/0.3m STRATA PLOT **DEPTH** ELEV. **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) RECOVERY N VALUE or RQD NUMBER TYPE Water Content % 80 **GROUND SURFACE** 0 + 94.22**TOPSOIL** ∇ 1 + 93.22Firm, grey-brown **SILTY CLAY**, trace sand seams 2 + 92.223.00 3+91.22Very loose, grey SANDY SILT 4 + 90.224.50 End of Test Pit (Water infiltration @ 1.0m depth) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

Ground surface elevations provided by Webster and Simmonds Surveying Ltd. DATUM

FILE NO.

REMARKS

PG0214

HOLE NO.

TD 6

| BORINGS BY Backhoe | | | | D | DATE 2 | 28 Apr 04 | | | | TP 6 | |
|--|----------|------|--------|---------------|-------------------|-----------|--------|-----------|------------------------|---------------------|----------------------------|
| SOIL DESCRIPTION | PLOT | | SAN | /IPLE | | DEPTH | ELEV. | | esist. Blo 0 mm Dia | ows/0.3m . Cone | eter |
| | STRATA 1 | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | 0 V | Vater Con | tent % | Piezometer Construction |
| GROUND SURFACE | | | | 2 | Z | 0- | -99.11 | 20 | 40 6 | 0 80 | |
| TOPSOIL | _ 0.10 | | | | | | 00.11 | | | | |
| Brown medium to coarse SAND | _ 0.50 | G | 1 | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | 1- | 98.11 | | | | |
| | | G | 2 | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | _ | | | | | | | | | |
| -: CII TV | | | | | | 2- | 97.11 | | | | |
| Firm, grey-brown SILTY CLAY , some sand, trace shells | | | | | | _ | | | | | |
| shells | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | 3- | 96.11 | | | | ⊽ |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | 05.11 | | | | |
| | | | | | | 4- | -95.11 | | | | |
| | | | | | | | | | | | |
| | _ 4.50 | | | | | | | | | | |
| End of Test Pit | | | | | | | | | | | |
| (Water infiltration @ 3.0m depth) | | | | | | | | | | | |
| | | | | | | | | 20 She | ar Streng | 60 80 1 th (kPa) | ₫ 00 |

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

FILE NO. PG0214

REMARKS

DATUM

HOLE NO.

| BORINGS BY Backhoe | | | | | D | ATE 2 | 28 Apr 04 | | HOI | TP 7 | |
|---|------------|--------|--------|--------|---------------|-------------------|--------------|--------|-------------------------------------|-----------------------------------|----------------------------|
| SOIL DESCRIPTION | | PLOT | | SAN | IPLE | | DEPTH (m) | ELEV. | | t. Blows/0.3m n Dia. Cone | eter ction |
| | | STRATA | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (111) | (m) | | Content % | Piezometer Construction |
| GROUND SURFACE | | | | | 24 | 2 | 0- | -97.75 | 20 40 | 60 80 | |
| TOPSOIL | 0.30 :: | | | | | | | | | | |
| Brown medium to coarse SAND , trace gravel | | | - G | 1 | | | 1- | -96.75 | | | ⊽ |
| | | | | | | | 2- | -95.75 | | | |
| End of Test Pit (Water infiltration @ 1.0m | 3.00 | | | | | | 3- | -94.75 | | | |
| depth) | | | | | | | | | 20 40 Shear Str ▲ Undisturbed | 60 80 10 rength (kPa) △ Remoulded | 00 |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA


Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

Ground surface elevations provided by Webster and Simmonds Surveying Ltd. **DATUM**

FILE NO.

PG0214

REMARKS HOLE NO. TP8 **BORINGS BY** Backhoe **DATE** 28 Apr 04

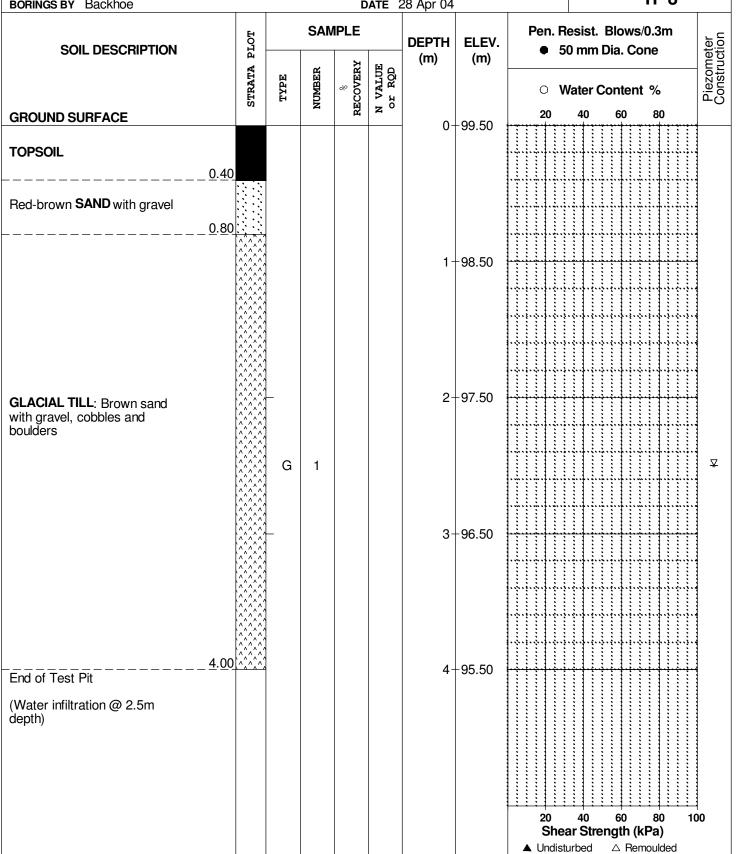

Consulting Engineers

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

FILE NO.

DATUM

PG0214

REMARKS

HOLE NO.

TD a

| BORINGS BY Backhoe | | | | D | ATE 2 | 28 Apr 04 | | _ | TP 9 | |
|--|----------|------|--------|---------------|-------------------|-----------|--------|-----------|-------------------------------------|----------------------------|
| SOIL DESCRIPTION | PLOT | | SAN | /IPLE | 1 | DEPTH | ELEV. | | esist. Blows/0.3m 0 mm Dia. Cone | eter Xion |
| | STRATA 1 | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | 0 V | /ater Content % | Piezometer Construction |
| GROUND SURFACE | | | | 2 | Z | 0- | -98.73 | 20 | 40 60 80 | |
| TOPSOIL0.14 | 1 | | | | | | 00.70 | | | |
| | | _ | | | | 1- | -97.73 | | | |
| Brown medium to coarse SAND, trace gravel | | G | 1 | | | | | | | |
| | | _ | | | | 2- | -96.73 | | | ⊽ |
| | | | | | | | | | | |
| 3.00 End of Test Pit |):::: | | | | | 3- | -95.73 | | | |
| (Water infiltration @ 2.1m depth) | | | | | | | | 20 She | 40 60 80 10 ar Strength (kPa) | 00 |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

DATUM Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

REMARKS

FILE NO.

PG0214

| BORINGS BY Backhoe SOIL DESCRIPTION FOR THE SAMPLE SAMPLE SAMPLE SAMPLE SAMPLE DEPTH (m) For many big services and services are services are services are services and services are services are services are services are services are services and services are services are services are services and services are services ar | | HOLE NO. | | | | | | | | | | REMARKS |
|---|---------------------------------------|------------------|------|--------|-----------|--------------|--------|------|--------|------|------|---|
| SOIL DESCRIPTION TOPSOIL Brown fine to medium SAND, trace gravel GG 3 Firm, grey SILTY CLAY, trace shells End of Test Pit (Water infiltration @ 1.1m) | | TP10 | | | 28 Apr 04 | ATE 2 | D | | | | | BORINGS BY Backhoe |
| GROUND SURFACE TOPSOIL Brown fine to medium SAND, trace gravel G 3 Firm, grey SILTY CLAY, trace shells End of Test Pit (Water infiltration @ 1.1m | eter | | | | | | IPLE | SAN | | PLOT | E | SOIL DESCRIPTION |
| TOPSOIL Brown fine to medium SAND, trace gravel G 2 1-98.00 Firm, grey SILTY CLAY, trace shells End of Test Pit (Water infiltration @ 1.1m | Piezometer Construction | /ater Content % | 0 W | (111) | (111) | VALUE RQD | SOVERY | MBER | IYPE | | | |
| TOPSOIL Brown fine to medium SAND, trace gravel G 2 1-98.00 Firm, grey SILTY CLAY, trace shells 2-97.00 End of Test Pit (Water infiltration @ 1.1m | | 40 60 80 | 20 | 00.00 | 0 | Z O | REC | Ħ | | ល | Ū | GROUND SURFACE |
| Brown fine to medium SAND, trace gravel 1.10 G 2 1-98.00 Firm, grey SILTY CLAY, trace shells 2-97.00 End of Test Pit (Water infiltration @ 1.1m | | | | -99.00 | 0- | | | | | | 0.30 | TOPSOIL |
| Firm, grey SILTY CLAY, trace shells G 3 2-97.00 End of Test Pit (Water infiltration @ 1.1m | | | | | | | | 1 | G | | | Brown fine to medium SAND , trace gravel |
| Firm, grey SILTY CLAY, trace shells 2-97.00 3-96.00 End of Test Pit (Water infiltration @ 1.1m | | | | -98.00 | 1 - | | | 2 | – G | | 1 10 | |
| Firm, grey SILTY CLAY, trace shells 2-97.00 3-96.00 End of Test Pit (Water infiltration @ 1.1m | | | | | | | | | _ | | | |
| 3.50 End of Test Pit (Water infiltration @ 1.1m | | | | | | | | 3 | G | | | |
| 3.50 End of Test Pit (Water infiltration @ 1.1m | | | | -97.00 | 2- | | | | _ | | | Firm, grey SILTY CLAY , trace shells |
| 3.50 End of Test Pit (Water infiltration @ 1.1m | | | | | | | | | | | | |
| 3.50 End of Test Pit (Water infiltration @ 1.1m | | | | | | | | | | | | |
| End of Test Pit (Water infiltration @ 1.1m | | | | -96.00 | 3- | | | | | | | |
| (Water infiltration @ 1.1m depth) | · · · · · · · · · · · · · · · · · · · | | | | | | | | | | 3.50 | End of Test Pit |
| | | | | | | | | | | | | (Water infiltration @ 1.1m depth) |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| 20 40 60 80 | 100 | 40 60 90 14 | 20 | | | | | | | | | |
| Shear Strength (kPa) | 100 | r Strength (kPa) | Shea | | | | | | | | | |

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

PG0214

REMARKS

DATUM

HOLE NO.

FILE NO.

| BORINGS BY Backhoe | | | | | DATE : | 28 Apr 04 | | | TP11 | |
|---|------------------|------------|--------|--|-------------------|-----------|--------------|----------|-------------------------------------|----------------------------|
| SOIL DESCRIPTION | SOIL DESCRIPTION | | SAN | /IPLE | | DEPTH (m) | ELEV. (m) | | esist. Blows/0.3m 0 mm Dia. Cone | eter ction |
| | STRATA | TYPE | NUMBER | % RECOVERY | N VALUE or RQD | (, | (111) | O W | /ater Content % | Piezometer Construction |
| GROUND SURFACE | | | | | | 0- | 98.98 | 20 | 40 60 80 | |
| TOPSOIL | 0.20 | | | | | | | | | |
| Red-brown SAND , some gravel | 0.50 | | | | | | | | | |
| Brown SAND with gravel, cobbles and boulders | 1.50 | | | | | 1- | -97.98 | | | |
| Brown SAND , some gravel | | G | 1 | | | 2- | -96.98 | | | |
| | | | | | | 3- | -95.98 | | | ፟ |
| End of Test Pit | <u>3.50 🗮 📑</u> | <u>: </u> | | | | | | | | |
| (Water infiltration @ 2.5m depth) | | | | | | | | 20 | 40 60 80 10 | 00 |
| | | | | | | | | Shea | ar Strength (kPa) | ,, |
| | | | | | | | | ▲ Undist | | |
| L | | - | | - | | | | 1 | | |

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Ottawa (Nepean), Ont

DATUM

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

FILE NO.

PG0214

REMARKS

HOLE NO.

TEMATIKO

TP12 BORINGS BY Backhoe **DATE** 28 Apr 04 **SAMPLE** Pen. Resist. Blows/0.3m STRATA PLOT **DEPTH** ELEV. **SOIL DESCRIPTION** 50 mm Dia. Cone (m) (m) RECOVERY N VALUE or RQD NUMBER TYPE Water Content % 80 20 **GROUND SURFACE** 0+96.33**TOPSOIL** 1 + 95.331.30 ∇ 2 + 94.33Firm, grey-brown SILTY CLAY, some sand seams - grey by 2.5m depth 3+93.33End of Test Pit (Water infiltration @ 1.3m depth) 40 60 80 100 Shear Strength (kPa) ▲ Undisturbed △ Remoulded

Consulting Engineers

Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Ottawa (Nepean), Ontario

DATUM REMARKS FILE NO.

PG0214

| BORINGS BY Backhoe | | D | ATE 2 | HOLE NO. TP13 | | | | | | |
|------------------------------------|----------|------|--------|---------------|-----|-------------|-----------------|----------------------------|--|--------------|
| SOIL DESCRIPTION | PLOT | | SAMPLE | | | DEPTH ELEV. | | | esist. Blows/0.3m 0 mm Dia. Cone | ster tion |
| | STRATA E | TYPE | | | (m) | | Vater Content % | Piezometer Construction | | |
| GROUND SURFACE | Ø | | Z | RE | z ° | 0- | -95.48 | 20 | 40 60 80 | |
| TOPSOIL0.40 | | | | | | | 00.10 | | | |
| Firm, grey-brown SILTY CLAY | | | | | | 1- | -94.48 | | | |
| - grey by 1.7m depth | | | | | | 2- | -93.48 | | | Ψ |
| 3.00 End of Test Pit | | | | | | 3- | -92.48 | | | |
| (Water infiltration @ 1.7m depth) | | | | | | | | | | |
| | | | | | | | | 20 She ▲ Undist | 40 60 80 100 ar Strength (kPa) urbed △ Remoulded |) |

28 Concourse Gate, Unit 1, Ottawa, ON K2E 7T7

Consulting Engineers

SOIL PROFILE AND TEST DATA

Preliminary Geotechnical Investigation Part 1, Lot 10 and Part 1, Lot 9, Concession 3 Ottawa (Nepean), Ontario

DATUM Ground surface elevations provided by Webster and Simmonds Surveying Ltd.

FILE NO.

PG0214

REMARKS

HOLE NO.

| BORINGS BY CME 55 Power Auge | er | | | 0 | ATE 2 | 22 Apr 04 | | | HOLE NO. | BH 3 | |
|---|-------------------------|------------------|--------|---------------|-------------------|-------------|--------|--|------------------------|----------|------------|
| SOIL DESCRIPTION | E | PLOT | SAN | /IPLE | | DEPTH ELEV. | | Pen. Resist. Blows/0.3m • 50 mm Dia. Cone | | | eter |
| | | STRATA | NUMBER | % RECOVERY | N VALUE or RQD | (m) | (m) | 0 W | ater Conter | nt % | Piezomețer |
| GROUND SURFACE | | . | ~ | R | z o | | 04.07 | 20 | 40 60 | 80 | |
| TOPSOIL | <u>0.36</u> | | | | | 0- | -94.97 | | | | |
| Stiff, brown CLAYEY SAND | | SS | 1 | 75 | 4 | 1- | -93.97 | | | | * |
| grey by 1.5m depth | | SS | 2 | 100 | W | 2- | 92.97 | | | | |
| | | SS | | 71 | W | 3- | -91.97 | | | | |
| Stiff. arev CLAYEY SAND to | _ <u>3</u> . <u>8</u> 0 | SS | | 100 | W | 4- | -90.97 | | | | |
| Stiff, grey CLAYEY SAND to SANDY SILT | _ <u>4.57</u> | SS SS | | 100 | 1 W | | | | | | |
| Very loose, grey fine to medium SAND | <u>5</u> . <u>60</u> | 33 | | 100 | VV | 5- | 89.97 | | | | |
| | | ss | 7 | 100 | W | 6- | -88.97 | | | | |
| Stiff, grey SILTY CLAY | | | | | | 7- | -87.97 | | | | |
| | | SS | 8 | 100 | W | 8- | -86.97 | | | | |
| | | \ ss | 9 | 100 | 1 | 9- | -85.97 | | | | |
| GLACIAL TILL: Loose, grey | 9.75 | ^^^^ | | | | 10- | -84.97 | | | | |
| silty sand with gravel, cobbles and boulders | 11.28\^^ | ^^^ ^^^ ss | 10 | 50 | 7 | 11- | -83.97 | | | | |
| End of Borehole (GWL @ 1.20m-May 1/04) | | | | | | | | | | | |
| | | | | | | | | 20 Shea | 40 60 ar Strength (| | ∄ 00 |
| | | | | | | | | ▲ Undistu | | emoulded | |

SYMBOLS AND TERMS

SOIL DESCRIPTION

Behavioural properties, such as structure and strength, take precedence over particle gradation in describing soils. Terminology describing soil structure are as follows:

| Desiccated | - | having visible signs of weathering by oxidation of clay minerals, shrinkage cracks, etc. |
|------------------|---|--|
| Fissured | - | having cracks, and hence a blocky structure. |
| Varved | - | composed of regular alternating layers of silt and clay. |
| Stratified | - | composed of alternating layers of different soil types, e.g. silt and sand or silt and clay. |
| Well-Graded | - | Having wide range in grain sizes and substantial amounts of all intermediate particle sizes (see Grain Size Distribution). |
| Uniformly-Graded | - | Predominantly of one grain size (see Grain Size Distribution). |

The standard terminology to describe the strength of cohesionless soils is the relative density, usually inferred from the results of the Standard Penetration Test (SPT) 'N' value. The SPT N value is the number of blows of a 63.5 kg hammer, falling 760 mm, required to drive a 51 mm O.D. split spoon sampler 300 mm into the soil after an initial penetration of 150 mm.

| Relative Density | 'N' Value | Relative Density % |
|------------------|-----------|--------------------|
| Very Loose | <4 | <15 |
| Loose | 4-10 | 15-35 |
| Compact | 10-30 | 35-65 |
| Dense | 30-50 | 65-85 |
| Very Dense | >50 | >85 |
| | | |

The standard terminology to describe the strength of cohesive soils is the consistency, which is based on the undisturbed undrained shear strength as measured by the in situ or laboratory vane tests, penetrometer tests, unconfined compression tests, or occasionally by Standard Penetration Tests.

| Consistency | Undrained Shear Strength (kPa) | 'N' Value | | |
|-------------|--------------------------------|-----------|--|--|
| Very Soft | <12 | <2 | | |
| Soft | 12-25 | 2-4 | | |
| Firm | 25-50 | 4-8 | | |
| Stiff | 50-100 | 8-15 | | |
| Very Stiff | 100-200 | 15-30 | | |
| Hard | >200 | >30 | | |
| | | | | |

SYMBOLS AND TERMS (continued)

SOIL DESCRIPTION (continued)

Cohesive soils can also be classified according to their "sensitivity". The sensitivity is the ratio between the undisturbed undrained shear strength and the remoulded undrained shear strength of the soil.

Terminology used for describing soil strata based upon texture, or the proportion of individual particle sizes present is provided on the Textural Soil Classification Chart at the end of this information package.

ROCK DESCRIPTION

The structural description of the bedrock mass is based on the Rock Quality Designation (RQD).

The RQD classification is based on a modified core recovery percentage in which all pieces of sound core over 100 mm long are counted as recovery. The smaller pieces are considered to be a result of closely-spaced discontinuities (resulting from shearing, jointing, faulting, or weathering) in the rock mass and are not counted. RQD is ideally determined from NXL size core. However, it can be used on smaller core sizes, such as BX, if the bulk of the fractures caused by drilling stresses (called "mechanical breaks") are easily distinguishable from the normal in situ fractures.

| RQD % | ROCK QUALITY |
|--------|--|
| 90-100 | Excellent, intact, very sound |
| 75-90 | Good, massive, moderately jointed or sound |
| 50-75 | Fair, blocky and seamy, fractured |
| 25-50 | Poor, shattered and very seamy or blocky, severely fractured |
| 0-25 | Very poor, crushed, very severely fractured |

SAMPLE TYPES

| SS | - | Split spoon sample (obtained in conjunction with the performing of the Standard Penetration Test (SPT)) |
|----|---|---|
| TW | - | Thin wall tube or Shelby tube |
| PS | - | Piston sample |
| AU | - | Auger sample or bulk sample |
| WS | - | Wash sample |
| RC | - | Rock core sample (Core bit size AXT, BXL, etc.). Rock core samples are obtained with the use of standard diamond drilling bits. |

SYMBOLS AND TERMS (continued)

GRAIN SIZE DISTRIBUTION

MC% - Natural moisture content or water content of sample, %

Liquid Limit, % (water content above which soil behaves as a liquid)
 PL - Plastic limit, % (water content above which soil behaves plastically)

PI - Plasticity index, % (difference between LL and PL)

Dxx - Grain size which xx% of the soil, by weight, is of finer grain sizes

These grain size descriptions are not used below 0.075 mm grain size

D10 - Grain size at which 10% of the soil is finer (effective grain size)

D60 - Grain size at which 60% of the soil is finer

Cc - Concavity coefficient = $(D30)^2 / (D10 \times D60)$

Cu - Uniformity coefficient = D60 / D10

Cc and Cu are used to assess the grading of sands and gravels:

Well-graded gravels have: 1 < Cc < 3 and Cu > 4 Well-graded sands have: 1 < Cc < 3 and Cu > 6

Sands and gravels not meeting the above requirements are poorly-graded or uniformly-graded.

Cc and Cu are not applicable for the description of soils with more than 10% silt and clay

(more than 10% finer than 0.075 mm or the #200 sieve)

CONSOLIDATION TEST

p'_o - Present effective overburden pressure at sample depth

p'c - Preconsolidation pressure of (maximum past pressure on) sample

Ccr - Recompression index (in effect at pressures below p'c)
Cc - Compression index (in effect at pressures above p'c)

OC Ratio Overconsolidaton ratio = p'_c/p'_o

Void Ratio Initial sample void ratio = volume of voids / volume of solids

Wo - Initial water content (at start of consolidation test)

PERMEABILITY TEST

Coefficient of permeability or hydraulic conductivity is a measure of the ability of water to flow through the sample. The value of k is measured at a specified unit weight for (remoulded) cohesionless soil samples, because its value will vary with the unit weight or density of the sample during the test.


SYMBOLS AND TERMS (continued)


STRATA PLOT




MONITORING WELL AND PIEZOMETER CONSTRUCTION



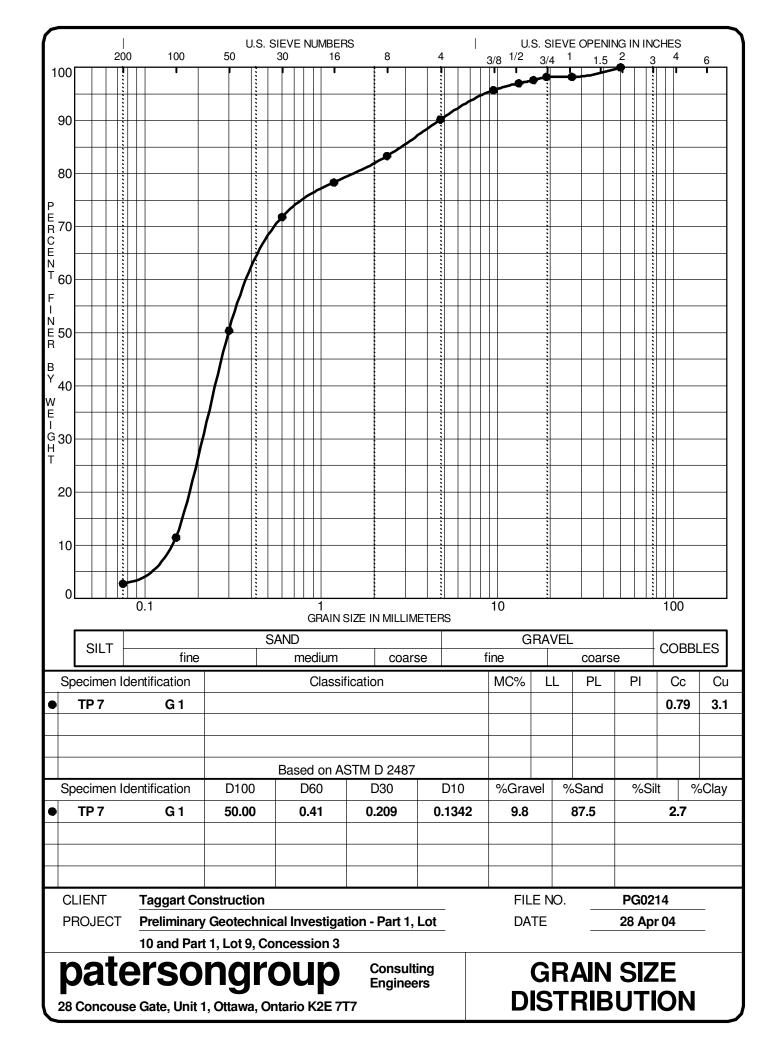

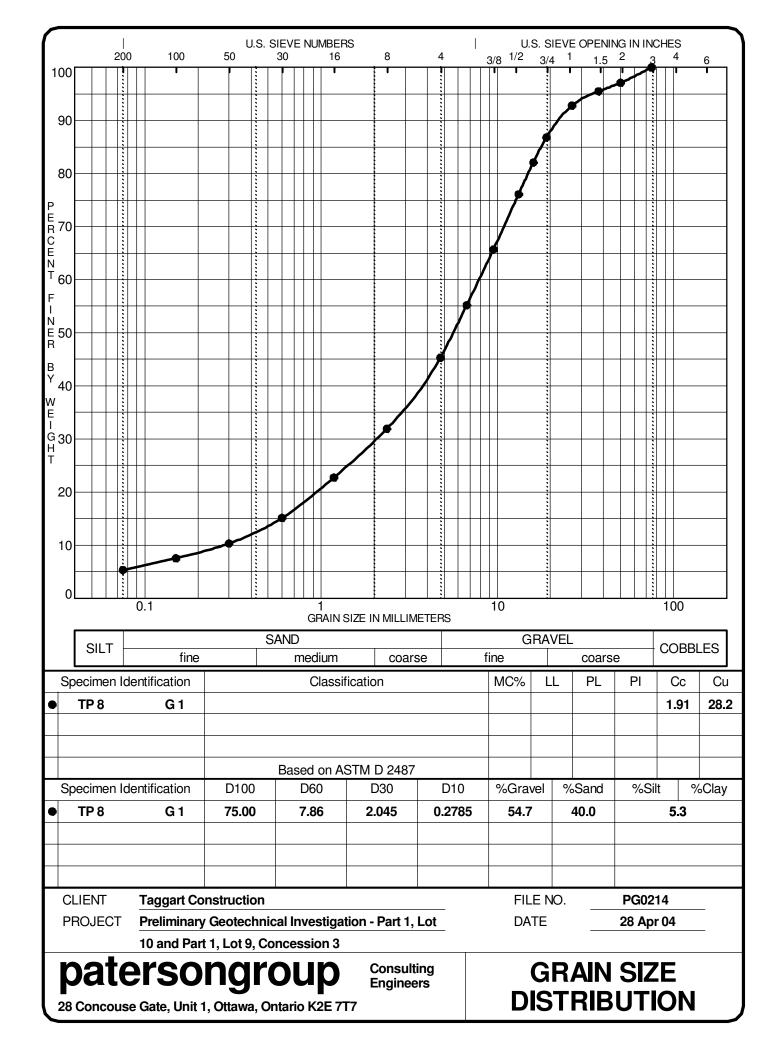

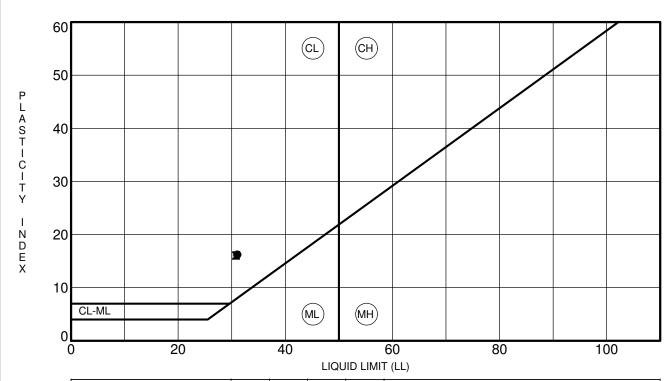

| S | Specimen Iden | tification | LL | PL | PI | Fines | Classification |
|---|---------------|------------|----|----|----|-------|--|
| • | BH 3-18 | SS4 | 31 | 15 | 16 | | CL - Inorganic clays of low plasticity |
| | TP 2-18 | G5 | 31 | 15 | 16 | | CL - Inorganic clays of low plasticity |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| П | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |

CLIENT Tamarack Developments FILE NO. PG4242
PROJECT Geotechnical Investigation - Prop. Residential DATE 8 Jan 18
Development - Borrisokane Road

patersongroup

Consulting Engineers

154 Colonnade Road South, Ottawa, Ontario K2E 7J5

ATTERBERG LIMITS'
RESULTS



Order #: 1802492

Certificate of Analysis

Client: Paterson Group Consulting Engineers

Client PO: 23395 Proje

Report Date: 17-Jan-2018 Order Date: 12-Jan-2018 **Project Description: PE4242**

| | Client ID: | TP1-G5 | - | - | - |
|--------------------------|---------------|------------|---|---|---|
| | Sample Date: | 08-Jan-18 | - | - | - |
| | Sample ID: | 1802492-01 | - | - | - |
| | MDL/Units | Soil | - | - | - |
| Physical Characteristics | | | | | |
| % Solids | 0.1 % by Wt. | 72.1 | - | - | - |
| General Inorganics | • | _ | | - | - |
| pH | 0.05 pH Units | 7.68 | - | - | - |
| Resistivity | 0.10 Ohm.m | 26.4 | - | - | - |
| Anions | | | | | |
| Chloride | 5 ug/g dry | 6 | - | - | - |
| Sulphate | 5 ug/g dry | 165 | - | - | - |

APPENDIX 2

FIGURE 1 - KEY PLAN

DRAWING PG4242-1 - TEST HOLE LOCATION PLAN

DRAWING PG4242-2 - PERMISSIBLE GRADE RAISE AREAS - HOUSING

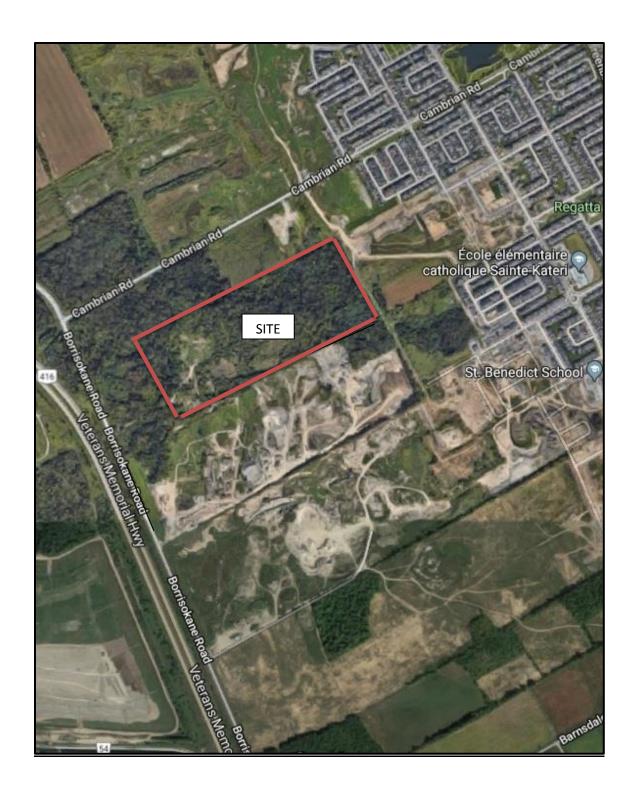


FIGURE 1 KEY PLAN

patersongroup

